


SYMBOLS:	
	EXIST SHUT OFF VALVE AND AREA OF CONTROL. EXIST HW, CW, HWR, SHUT OFF VALVES ABOVE CEILING.
	AREAS OF WORK, TO BE SCHEDULED WITH USERS.
	WORK AREA AFFECTS 3 PATIENT EXAM ROOMS, 1 PATIENT BEDRM 4 PATIENT TOILETS 1 TUB SHOWER, 4 PATIENT LAVS
	WORK AREA AFFECTS 4 PAT BEDRMS 4 PATIENT TOILETS. 1 TUB/SHOWER 3 HA SHOWERS 4 PATIENT LAVS
	WORK AFFECTS 7 PATIENT BEDRMS. 6 PATIENT TOILETS . 5 HA SHOWERS 6 PATIENT LAVS
	WORK AFFECTS 5 PATIENT BEDRMS. 5 PATIENT TOILETS. 4 HA SHOWERS
	EXISTING TYPICAL ZONE SHUT OFF VALVES, LOCATED ABOVE CEILING. CW, HW, GATE AND COMB GATE, BAL VALVE FOR RECIRCULATE PIPING.
REFER TO SPECIFICATIONS FOR INFECTION CONTROL PROCEDURES.	
REFER TO SPECIFICATION 01 32 16 FOR SCHEDULING OF WORK, AND PHASING. IN GENERAL WORK SHALL BE SCHEDULED INDIVIDUALLY FOR EACH OF THE WORK AREAS SHOWN, WHICH ARE VALVED ZONED AREAS. EACH ZONE AREA SHALL BE COMPLETED SEPARATLY TO ALLOW MOVEMENT OF PATIENTS OUT OF THE RMS INSTALLATION OF THE WORK, INSPECTION, TESTING AND STERILIZATION & ACCEPTANCE OF TEST RESULTS & STERILE CLEANING OF THE AREAS, AND RE-OCCUPYING. COMPLETE EACH ZONE BEFORE MOVING TO THE NEXT.	
PATIENTS WILL BE RELOCATED FROM AFFECTED BEDRMS WITHIN A ZONE TO AVAILABLE BED SPACE ON THIS POD, & TO OTHER PODS AS NECESSARY, FOR THE DURATION OF THE WORK IN THE AFFECTED WORK AREA.	
NOTE SPECIFICATION REQUIREMENTS FOR CLEANING AND DISINFECTION OF NEW AND EXISTING PIPING AFTER NEW SHOWER VALVES ARE INSTALLED. PATIENTS WILL BE VACATED AS NOTED ABOVE AND RETURNED TO RMS AFTER WORK IS COMPLETED.	
	POD 4D LR-BI-JLM SCHEDULE OF WK DWG
ROOM TITLE DESCRIPTOR	
WORK AREAS	

WORK AREA LOCATION  
FOURTH FLOOR--4D

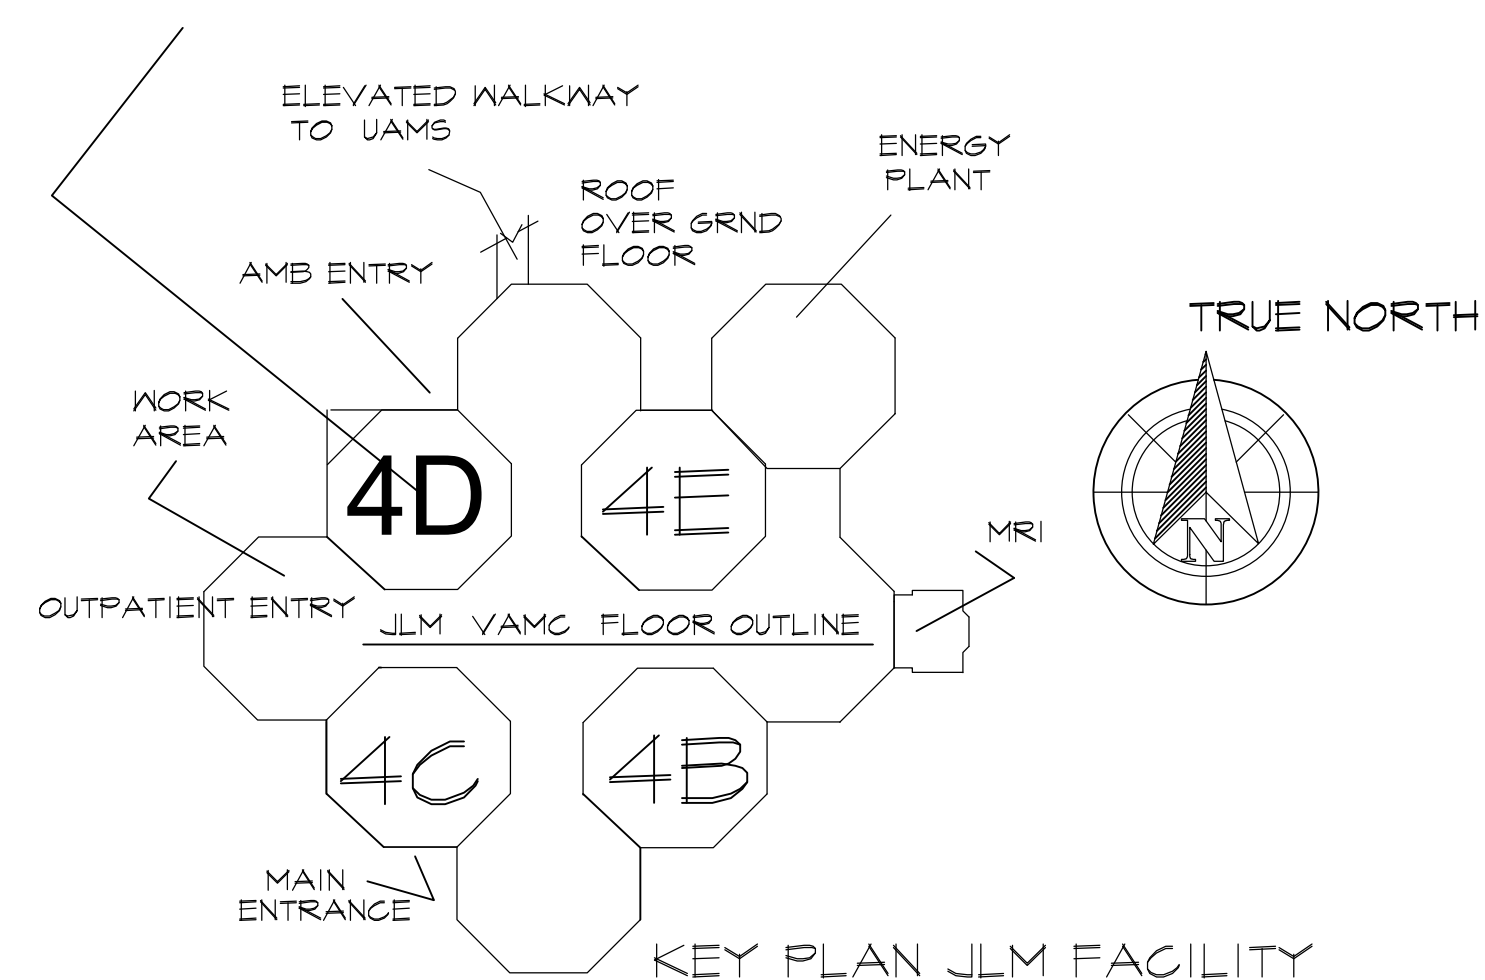

LOCATION PLAN - JLM

LR POD 4D - SHUT-OFF VALVES-ZONES-WORK AREAS

SCALE: 1/8" = 1'-0"


APPROVED: MEDICAL CENTER DIRECTOR	APPROVED: FACILITY PLANNER	APPROVED: SERVICE CHIEF
APPROVED: ASSOCIATE DIRECTOR	APPROVED: CHIEF ENGINEER	APPROVED: SERVICE CHIEF
APPROVED: ASSISTANT DIRECTOR	APPROVED: SERVICE CHIEF	APPROVED: SERVICE CHIEF

DRAWING TITLE  
**LR BLDG 1  
WORK AREAS PLAN**  
POD 4D-JLM

PROJECT TITLE  
**CORRECT  
LEGIONELLA  
PROBLEMS**  
BUILDING NUMBER: I-JLM  
CHECKED: KS  
DRAWN: RS  
LOCATION: V.A.M.C. LR DIVISION

DATE: 7/2017  
PROJECT NUMBER: 598-17-105  
DRAWING NO.: **WA-4D**  
Dwg 3 of 6

PROJECT 598-17-105

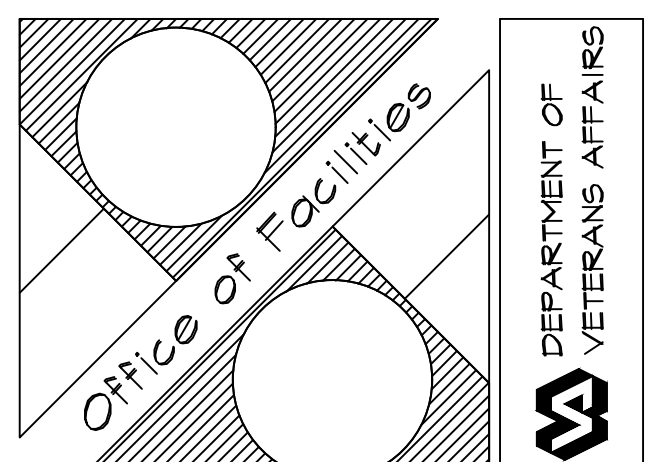

REVISIONS

DATE

