QC	
INI	%

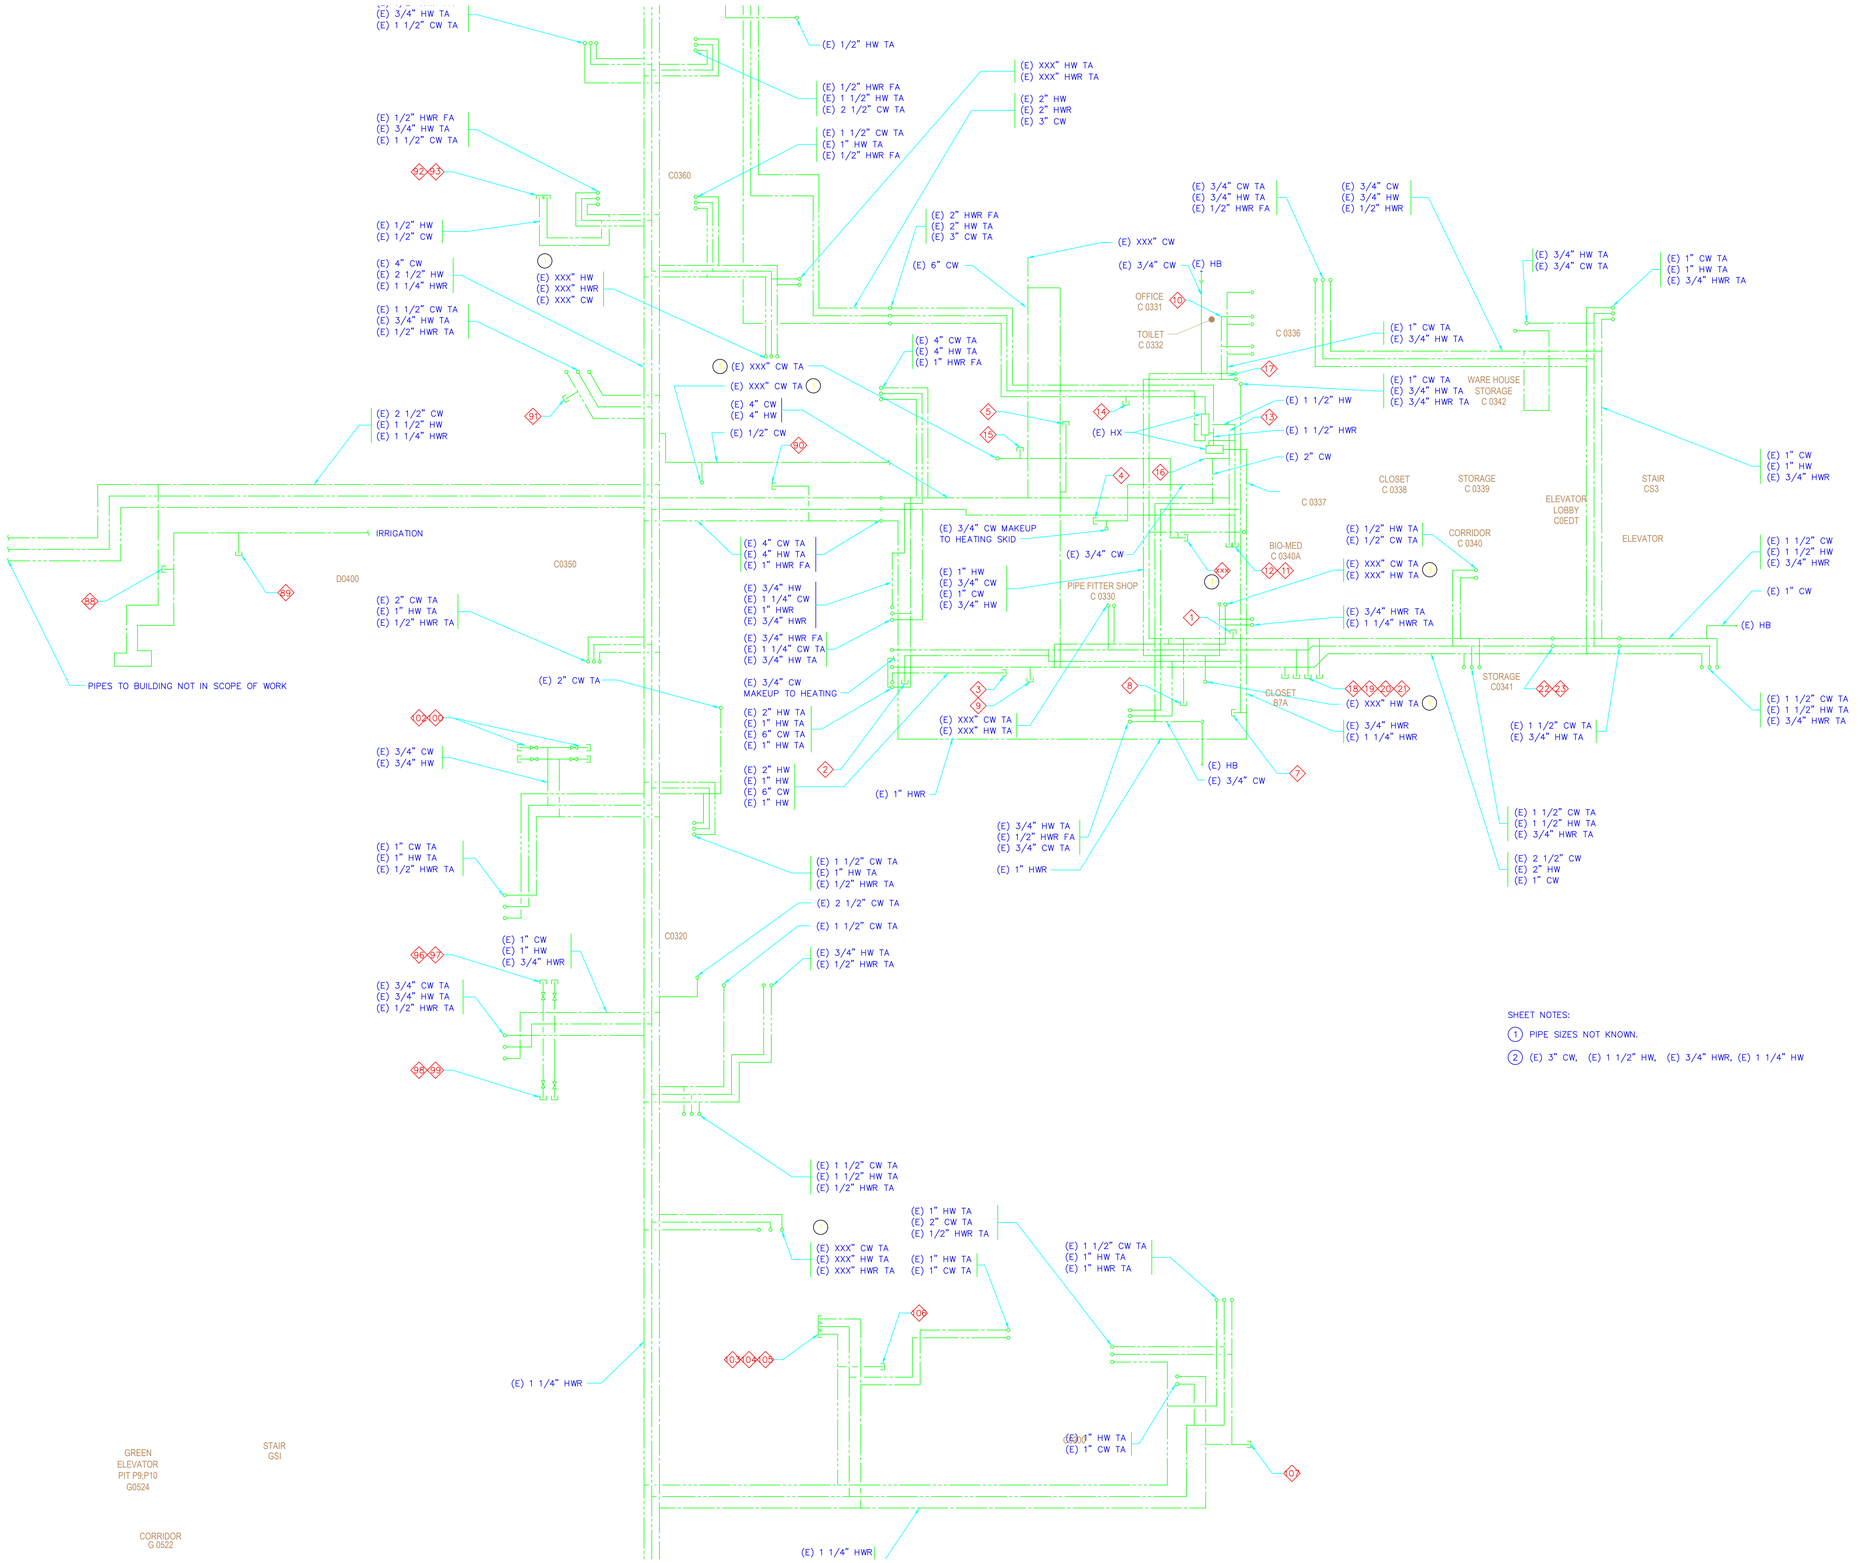

DEAD LEG LOCATIONS:

1. (E) 1" CW COPPER WITH 1/2" TEE (BOTH CAPPED) 5' AFF
2. (E) 1" HWR COPPER CAPPED AT 3' AFF
3. (E) 1" HW COPPER (ABANDONED)
4. (E) 3/4" CW COPPER 12' AFF
5. (E) 3/4" CW COPPER 12' AFF
6. (E) 1/2" CW COPPER CAPPED AT 8' AFF
7. (E) 3/4" HWR COPPER CAPPED IN CONDENSATE PIT
8. (E) 3/4" CW COPPER VALVED OFF AT 12' AFF
9. (E) 3/4" CW COPPER VALVED AND CAPPED AT 15' AFF
10. (E) 3/4" HW COPPER CAPPED ABOVE BATHROOM
11. (E) 4" HW COPPER WITH 4"x3"x3" TEE ALL CAPPED AT 14' AFF
12. (E) 4" CW COPPER WITH 4"x3"x3" TEE ALL CAPPED AT 14' AFF
13. (E) 3" CW COPPER AT 14' AFF
14. (E) 3/4" CW COPPER VALVED AND CAPPED AT 12' AFF
15. (E) 1/2" CW COPPER CAPPED AT 15' AFF
16. (E) 2" CW COPPER VALVED AND CAPPED AT 8' AFF
17. (E) 1/2" CW COPPER VALVED AND CAPPED ABOVE BATHROOM
18. (E) 1/2" HWR COPPER VALVED AND CAPPED AT 10' AFF
19. (E) 1" HW COPPER VALVED AND CAPPED AT 10' AFF
20. (E) 1" CW COPPER VALVED AND CAPPED AT 10' AFF
21. (E) 1" CW COPPER WITH 1"x3/4" TEE BOTH CAPPED AT 10' AFF
22. (E) 3/4" HW COPPER VALVED AND CAPPED AT 10' AFF
23. (E) 3/4" CW COPPER VALVED AND CAPPED AT 10' AFF
89. (E) 2" CW GALVANIZED VALVED OFF (IRRIGATION)
89. (E) 1/2" CW GALVANIZED VALVED OFF (IRRIGATION)
90. (E) 1 1/4" HWR COPPER VALVED AND CAPPED
91. (E) 1/2" HWR COPPER VALVED AND CAPPED
92. (E) 1/2" CW COPPER VALVED AND CAPPED
93. (E) 1/2" HW COPPER VALVED AND CAPPED
96. (E) 1/2" CW COPPER VALVED AND CAPPED
97. (E) 1/2" HW COPPER VALVED AND CAPPED
98. (E) 1/2" CW COPPER VALVED AND CAPPED
99. (E) 1/2" HW COPPER VALVED AND CAPPED
100. (E) 1/2" HW COPPER VALVED AND CAPPED
102. (E) 1/2" CW COPPER VALVED AND CAPPED
103. (E) 1/2" HWR COPPER VALVED AND CAPPED
104. (E) 3/4" HW COPPER VALVED AND CAPPED
105. (E) 1" CW COPPER VALVED AND CAPPED
106. (E) 1/2" HWR COPPER VALVED AND CAPPED
107. (E) 3/4" CW COPPER VALVED AND CAPPED

SHEET NOTES:

1. PIPE SIZES NOT KNOWN.
2. (E) 3" CW, (E) 1 1/2" HW, (E) 3/4" HWR, (E) 1 1/4" HW

BASEMENT EXISTING
PLUMBING FLOOR PLAN

M1.0E