


B8-112 Auditorium A/V Project

Proposed Installation

Key Notes:

- 1 LIMITED SURFACE MOUNTED CONDUIT ALLOWED. ANY SURFACE CONDUIT USED SHALL BE PAINTED TO MATCH ADJACENT SURFACE. NO SURFACED MOUNTED CONDUIT SHALL BE INSTALLED ON THE CEILING.
- 2 INSTALL ELECTRICAL OUTLET AND ANY ADDITIONAL POWER SUPPLY REQUIRED FOR NEW AUDIO/VISUAL EQUIPMENT.
- 3 ALL AUDIO/VISUAL EQUIPMENT SHALL BE PROTECTED WITH MANUFACTURER APPROVED SURGE PROTECTION DEVICE.
- 4 MEDIA CABINET SHALL BE APPROPRIATE FOR AUDIO/VISUAL EQUIPMENT, INCLUDING VENTILATION AND SECURITY. MEDIA CABINET DOORS SHALL ACCEPT BEST 7 PIN CORE FOR VA STANDARD KEYS.
- 5 ANY LOW VOLTAGE REQUIRED SHALL BE ADDED BY CONTRACTOR AS REQUIRED BY THEIR SYSTEM. LOW VOLTAGE SHALL BE INSTALLED IN CONDUIT. NO LESS THAN 3/4"
- 6 MEDIA CONTROL PEDESTAL SHALL BE OPERABLE WITHIN THIS AREA. IF CONTROL SYSTEM IS WIRED, WIRE CONTROL/MGMT. PROTECTION SHALL BE INCLUDED.
- 7 NO CONDUIT UNDER 3/4" SHALL BE USED
- 8 PATCH AND PAINT ALL DEMO SCARS FROM ROUGH-INS, REMOVAL AND INSTALLATION TO MATCH ADJACENT SURFACE.
- 9 EQUIPMENT CONTRACTOR SHALL FURNISH AND INSTALL A TURN-KEY SYSTEM. ALL UTILITY SYSTEMS INCLUDING PATHWAY REQUIRED BEYOND EXISTING ARE TO BE INSTALLED BY THE CONTRACTOR. REFERENCE ATTACHED INSTALLATION SPECIFICATION SECTION AS REQUIRED.
- 10 ALL NEW EQUIPMENT INSTALLED INTO THE AUDITORIUM SHALL HAVE PROTECTION DEVICES INSTALLED BY THE CONTRACTOR TO PROTECT EQUIPMENT FROM PROJECTILES SUCH AS VOLLEYBALLS AND BASKETBALLS
- 11 EXISTING SPEAKERS CONNECTED TO EXISTING PUBLIC ADDRESS SYSTEM. IF EXISTING PUBLIC ADDRESS SYSTEM CAN CONNECT TO NEW AUDIO/VISUAL SYSTEM, MAKE CONNECTION AND REMOVE OLD SPEAKERS. IF NOT, EXISTING SPEAKERS SHALL REMAIN.
- 12 AUDIO/VISUAL SYSTEM SHALL BE CUSTOMIZED FOR THE ENVIRONMENT OF THE AUDITORIUM. THE SYSTEM SHALL BE PROFESSIONALLY CALIBRATED, TUNED, BALANCED, PHASED, ETC. FOR ACCOUSTICAL SOUND QUALITY.

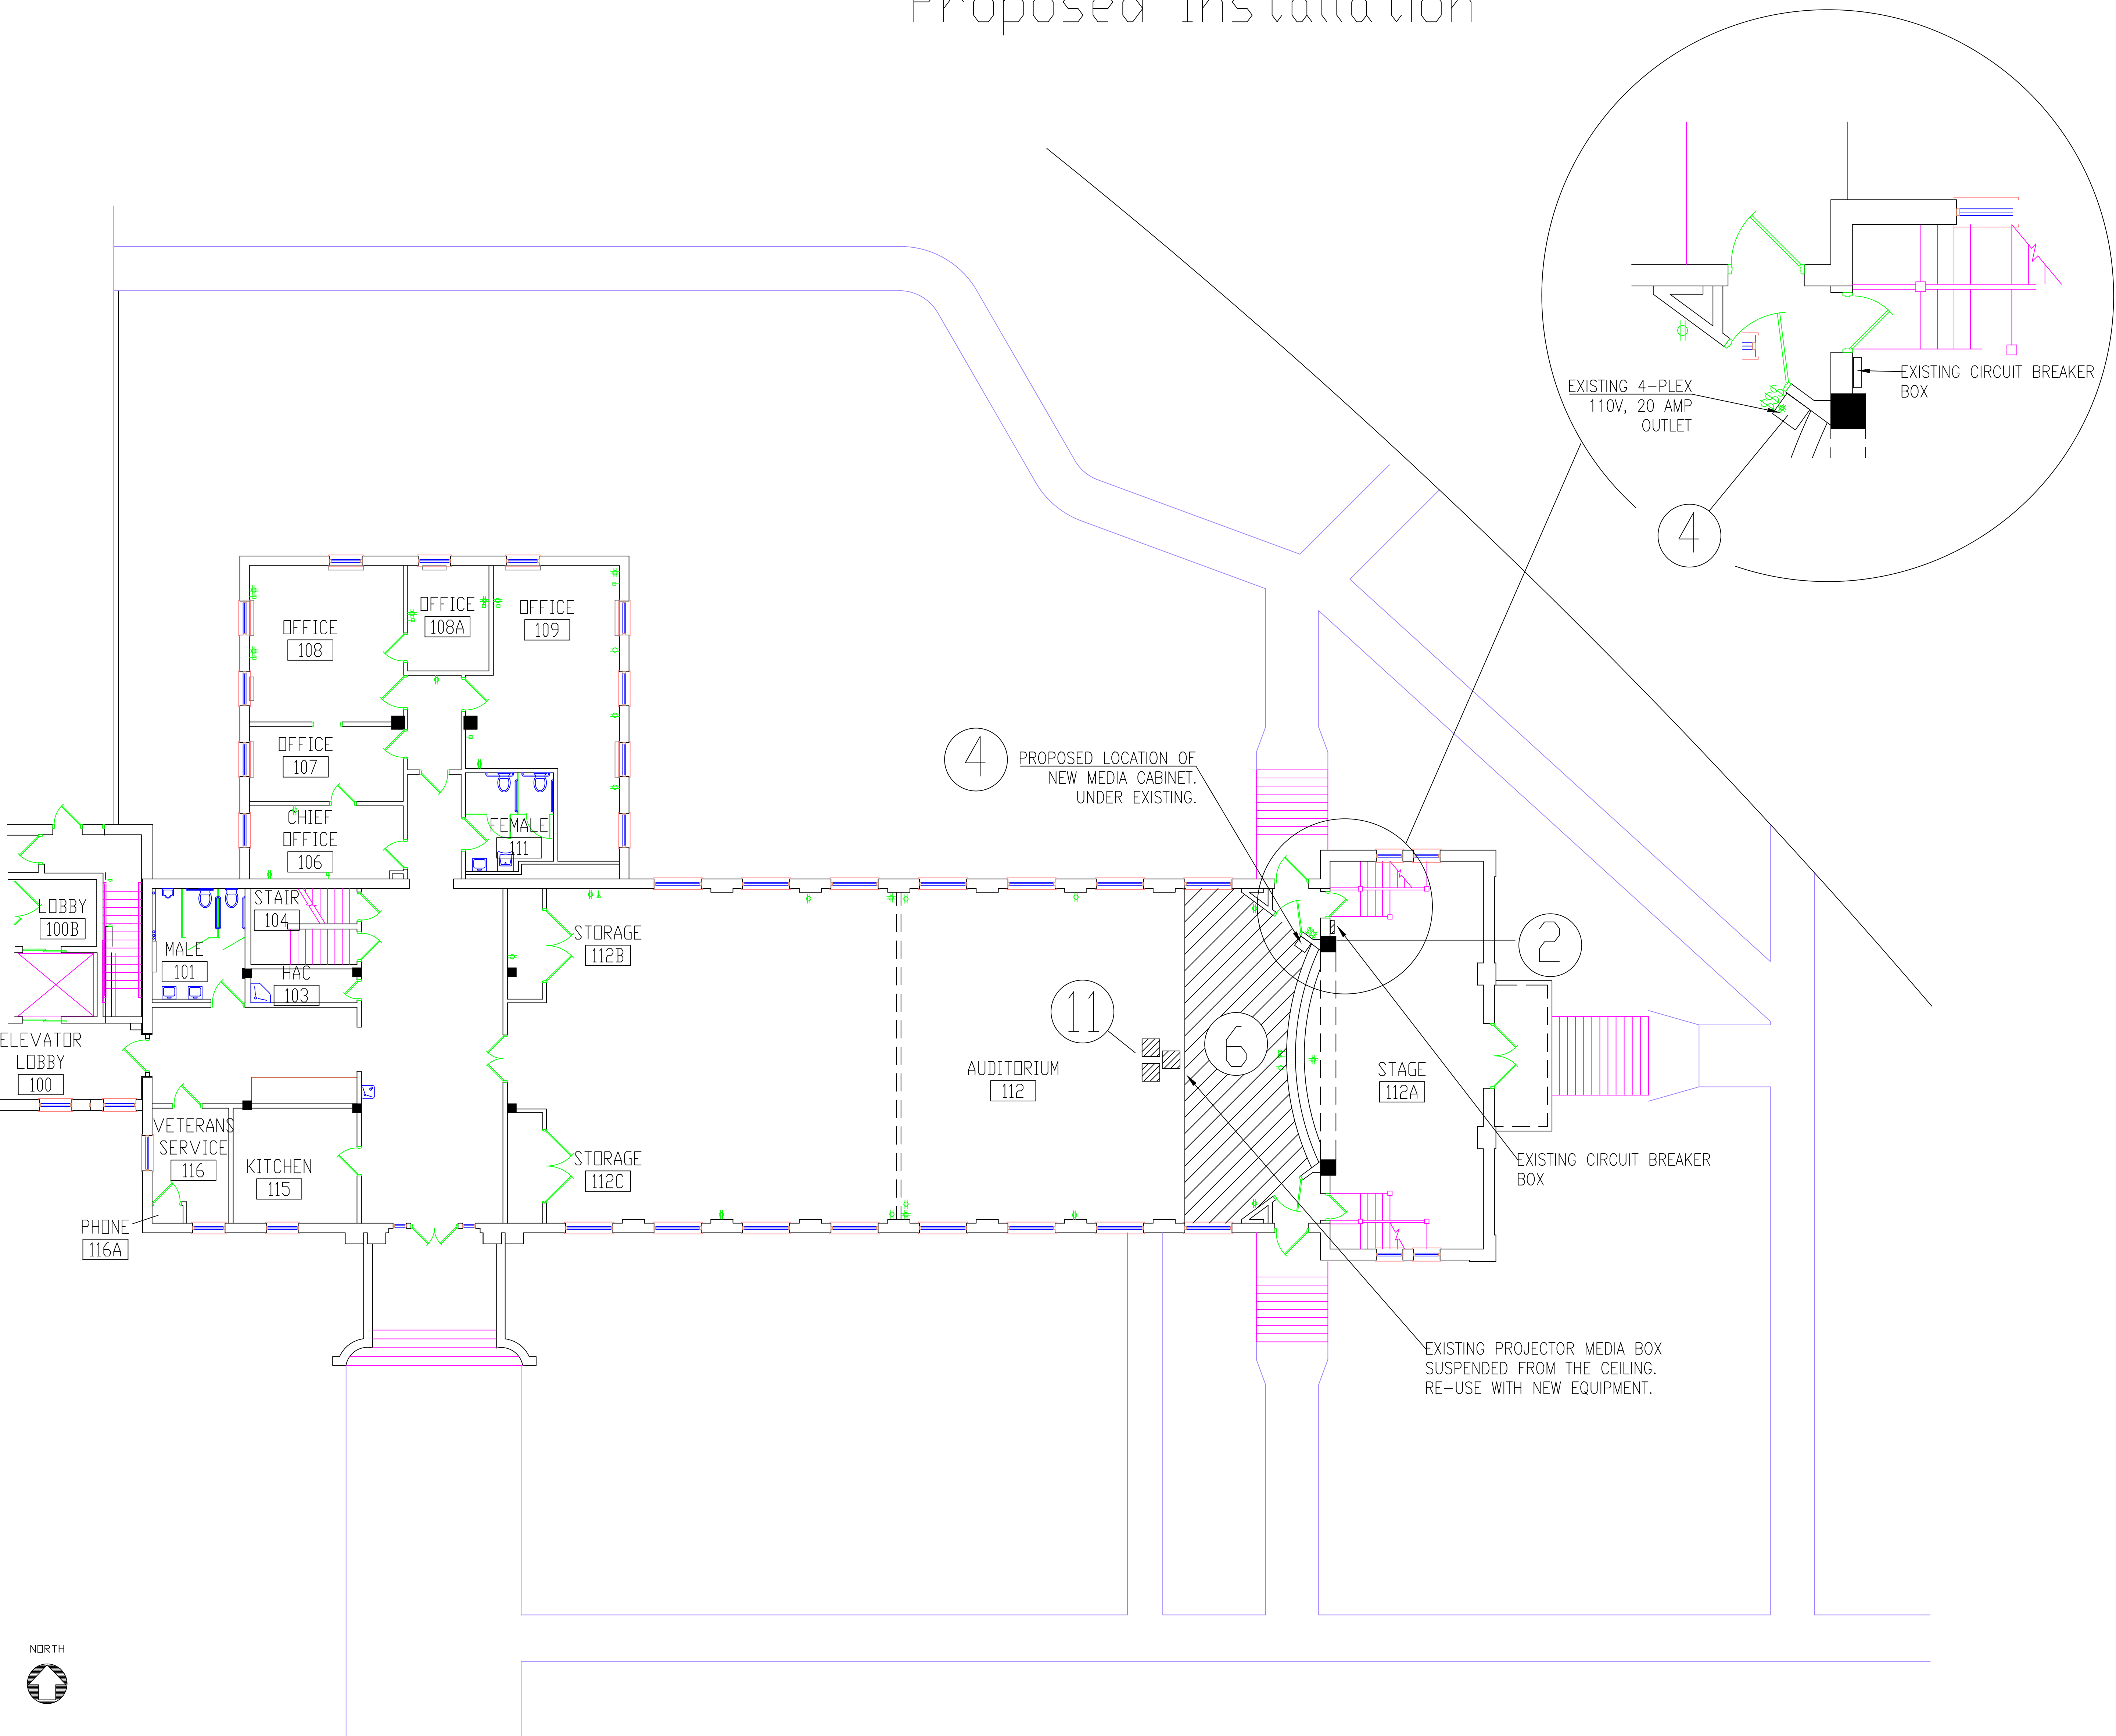

NO	REVISION	DATE

APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:	DRAWING TITLE	DATE	PROJECT TITLE	DATE
APPROVED: GENIC COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:	1ST FLOOR	8-9-17	B8 AUDITORIUM A/V PROJECT	8-9-17
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:		PROJECT NO.		XXX
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:		CAD FILE		XXX
					88-1		
					LOCATION		
					V.A. MEDICAL CENTER		
					ST. CLOUD, MN 56303		
					DRAWING NO.		
					XXX		
					ENC. 3 of 3		

