



DETAIL - CONCRETE EQUIPMENT PAD
SCALE: NONE

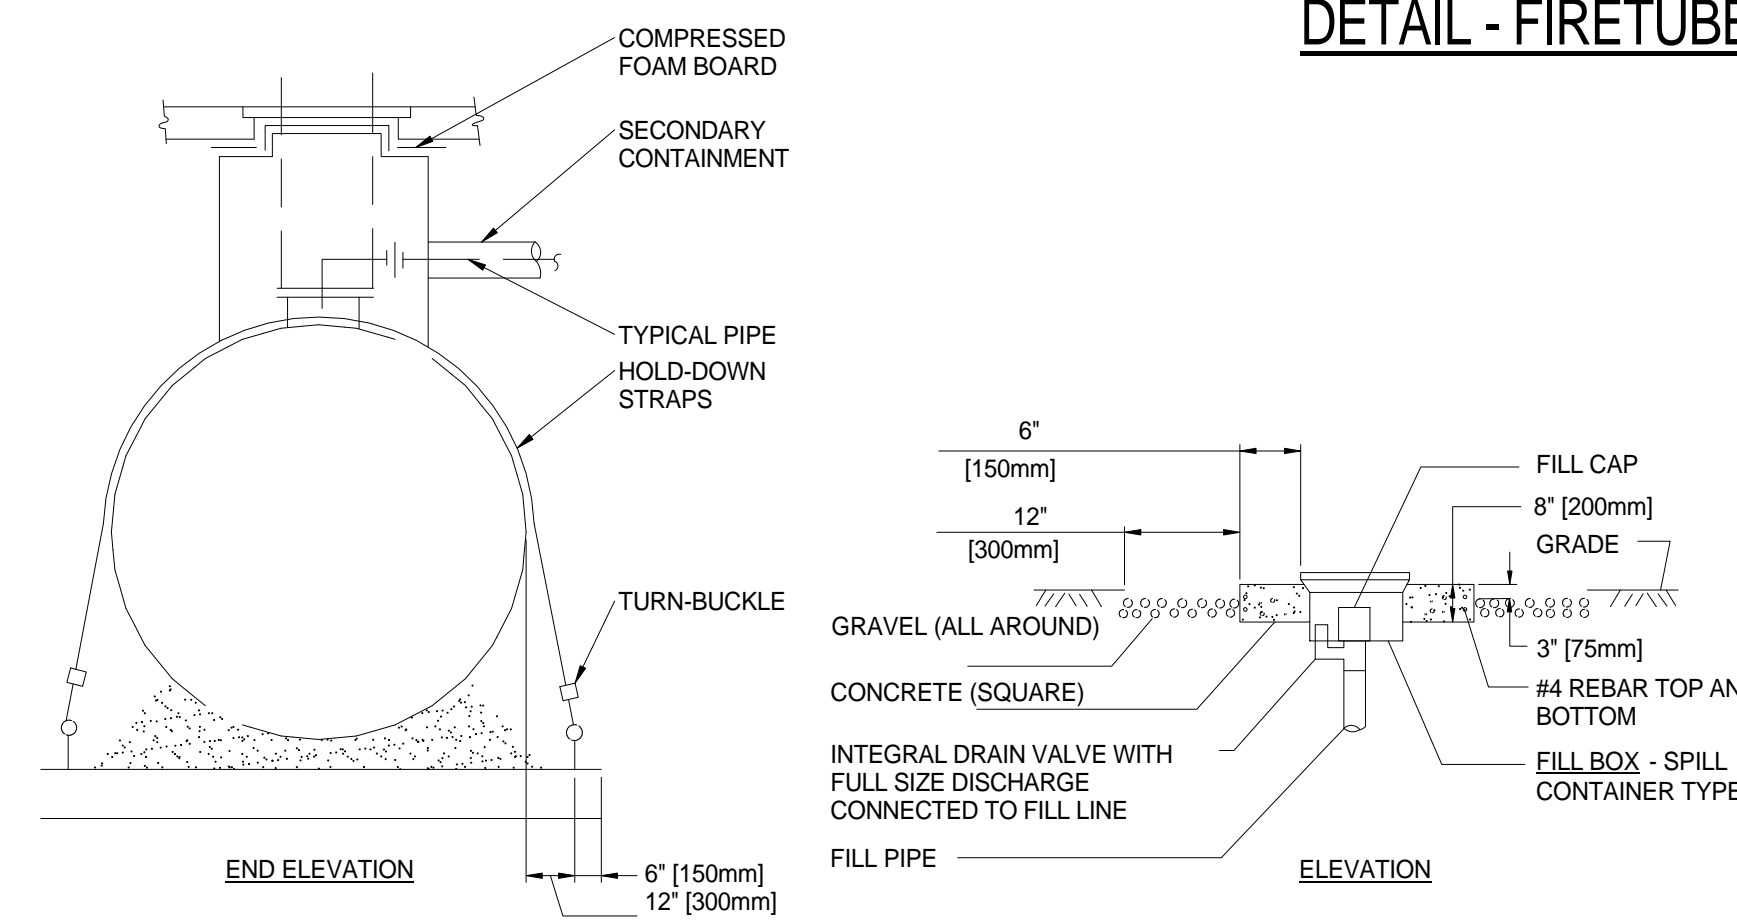

2"x1/2" THICK GALVANIZED STEEL WATER STOP AND ANCHOR COLLAR
 SCHED. 40, ASTM A106 GRADE B GALVANIZED STEEL PIPE SLEEVE (SIZE AS REQUIRED TO ACCOMMODATE PIPE AND SEAL/CAST WALLS WITH SLEEVES IN PLACE WHERE POSSIBLE)
 SERVICE PIPE (REFER TO PLAN FOR SIZE AND LOCATION)
 LINKED WATERTIGHT SLEEVE ASSEMBLY WITH NEOPRENE SEALS, END PRESSURE PLATES AND STAINLESS STEEL TIGHTENING NUTS AND BOLTS (PROVIDE APPROPRIATE MATERIALS FOR SERVICE PIPE TEMPERATURES)
 PROVIDE BITUMINOUS WATERPROOFING ON EXTERIOR SIDE OF WALL BELOW GRADE
 INSULATION SHALL EXTEND UP TO FACE OF WALL WHERE APPLICABLE (TYP. BOTH SIDES)
 EXTERIOR SIDE OF BUILDING WALL (CMU)
 INTERIOR SIDE OF BUILDING WALL (CMU)

UNDERGROUND FUEL OIL STORAGE TANK
SCALE: NONE

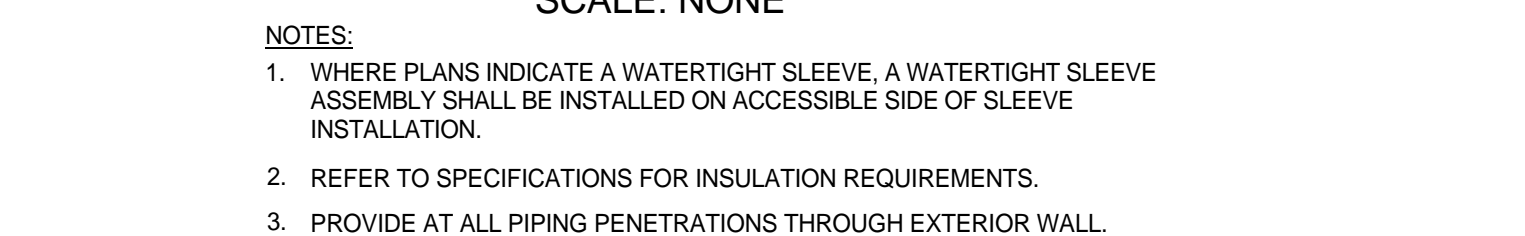

Office of
Construction
and Facilities
Management



FINAL DESIGN
APPROVED FOR CONSTRUCTION

Office of
Construction
and Facilities
Management

