


three inches = one foot
one and one half inches = one foot
one inch = one foot
three quarters inch = one foot
three eighths inch = one foot
one eighth inch = one foot
one quarter inch = one foot
one eighth inch = one foot

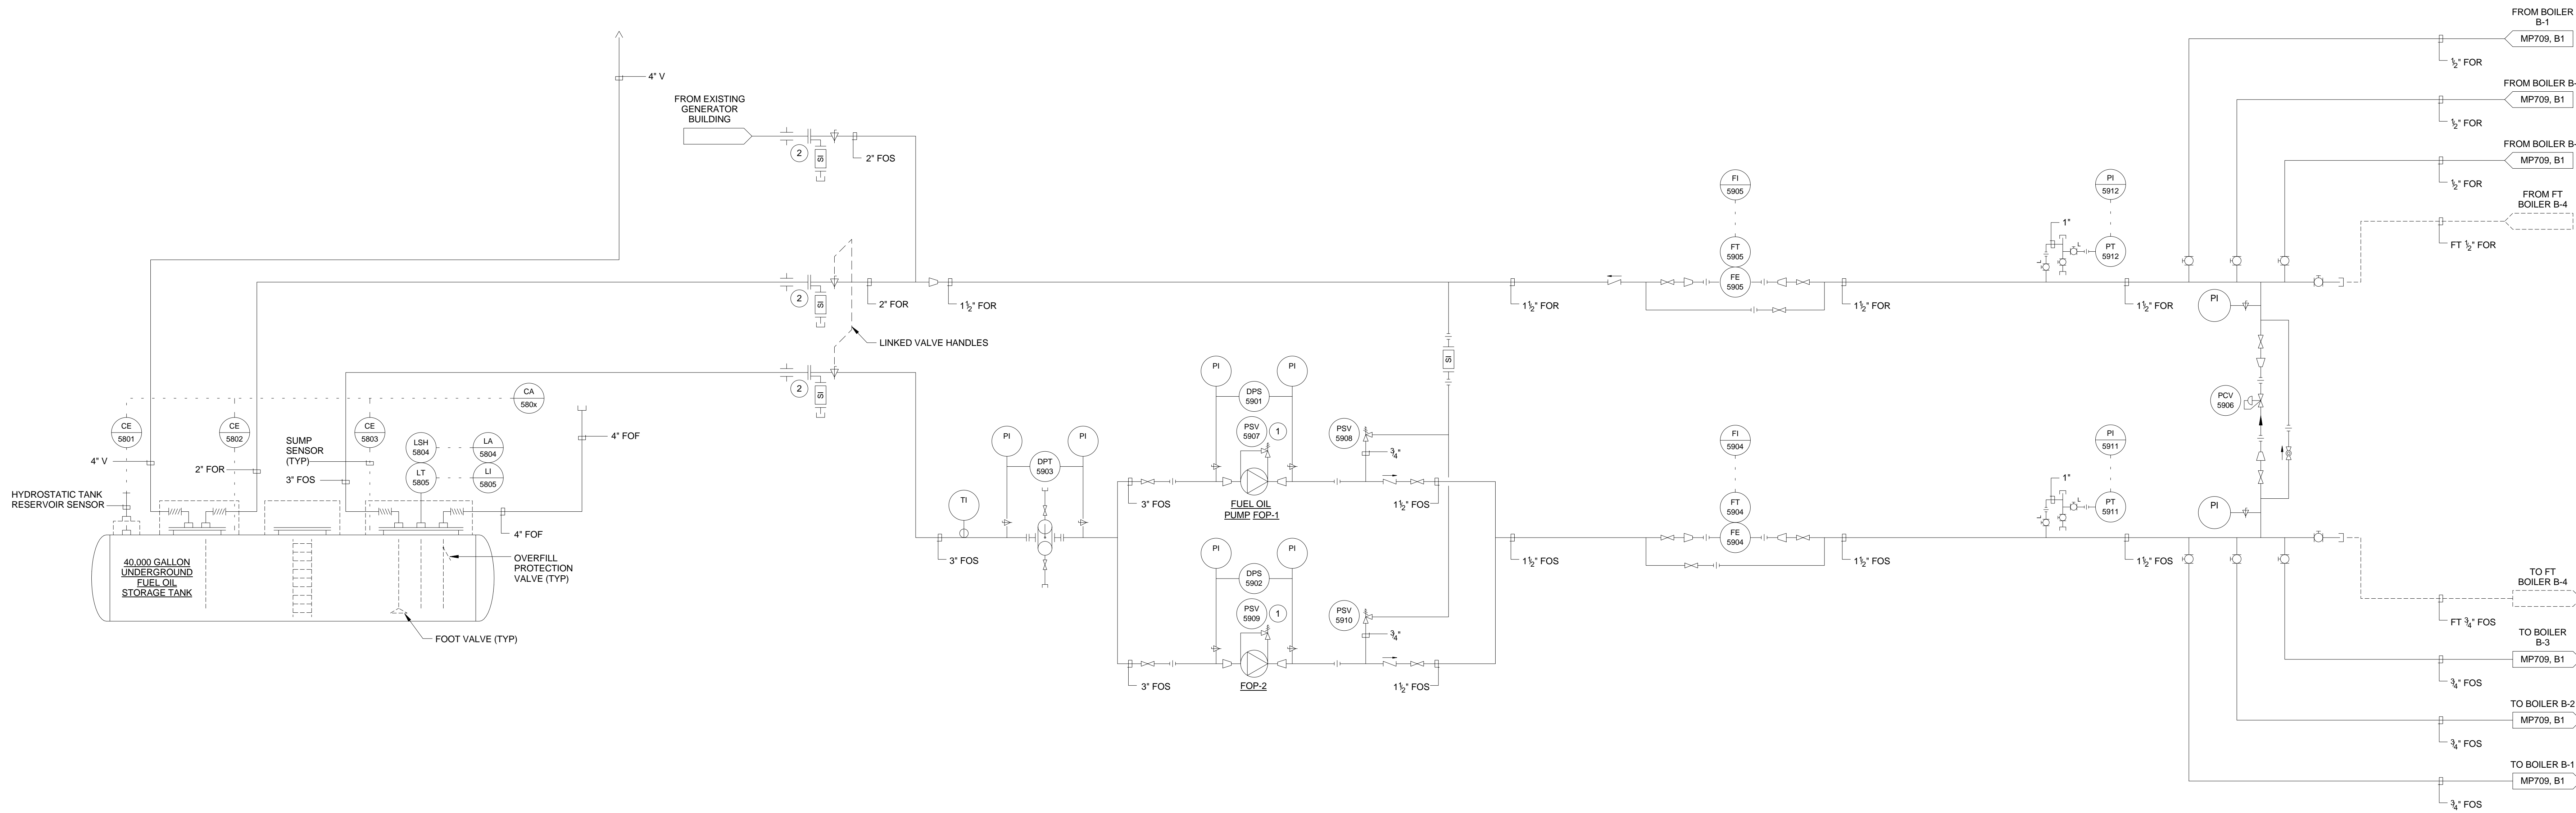

FUEL OIL SYSTEM SCHEMATIC

- DRAWING NOTES:
- 1) PUMP CASING, SAFETY VALVE, PROVIDED BY PUMP MANUFACTURER.
 - 2) TRANSITION FROM STEEL PIPE TO DOUBLE WALL FRP PIPE.

FINAL DESIGN
APPROVED FOR CONSTRUCTION

		<div>CONSULTANTS:</div> <div><div><div><div><div></div></div><div>Affiliated Engineers SE, Inc.</div></div><div><div><div>12921 SW 1st Road Ste 205</div><div>Gainesville, Florida 32669</div><div>Tel 352.376.5500 Fax 352.375.3479</div><div>CA-6140</div></div></div></div></div>	<div>ENGINEER-OF-RECORD JACK STEWART NEALE</div> <div>FL P.E. NO. 42678</div>	<div>ARCHITECT/ENGINEERS:</div> <div><div><div><div><div></div></div><div>AKEA INC.</div></div><div><div><div>3603 NW 98th Street, Suite B</div><div>Gainesville, FL 32606</div><div>Phone: (352) 474-6124</div><div>Fax: (352) 553-4437</div><div>COA: FL #26693</div><div>AKEA Project No. 083-14</div></div></div></div></div>	<div>Drawing Title</div> <div>FUEL OIL SYSTEM SCHEMATIC</div>	<div>Project Title</div> <div>REPLACE BOILERS - FCA D, ENERGY AT THE MALCOM RANDALL VAMC</div>	<div>Project Number</div> <div>573-14-600</div>	<div>Office of Construction and Facilities Management</div>	
					<div>Building Number</div>				
					<div>Drawing Number</div> <div>MP707</div>				
					<div>Location</div> <div>GAINESVILLE, FLORIDA</div>	<div>Date</div> <div>JULY 8, 2016</div>	<div>Checked</div> <div>JSN</div>		<div>Drawn</div> <div>RWD</div>
					<div>Approved: Project Director</div>				
<div>Revisions:</div>		<div>Date</div>							
<div></div>									