

EXISTING IN SHOWER SPACE FINISHES AND OTHERS				
FIN NO.	FLOOR	WALL	WC	CEIL
1F	TUB	CT	NONE	AT
2F	TUB	CT	NONE	FGB
3F	EPOXY	EOT	NONE	VCGB
3FA	CER TILE	FGB	CT	AT
4F	EPOXY	EPOXY	NONE	FGB
5F	EPOXY	EPOXY	NONE	EPOXY
6F	EPOXY	EPOXY	NONE	AT
7F	TILE	FGB	NONE	AT
8F	CER TILE	CT	NONE	VCGB
9F	CER TILE	CT	NONE	FGB
10F	CER TILE	CT	NONE	AT

CONTRACTOR VERIFIES FINISHES AS REQ'D

LOCATION-NEW WORK NOTES-DESCRIPTIONS

- LI

EXIST WALL MOUNTED LAVATORY WITH FAUCET AND SHUT OFF VALVES . INSTALL MIXING VALVE BENEATH LAV, AND CONNECT TO EXIST FIXTURE FAUCET VALVES. INSTALL NEW POINT OF USE MIXING VALVE - TYPE I. REFERENCE INSTALL. DETAIL FOU-1

20
- L2

SAME AS TYPE LI EXCEPT INSTALL BENEATH LAV IN CASEWORK.

0
- SV #

IN WALL OR CHASE NEW SHOWER VALVE-REMOVE EXIST. # IDENTIFIER INDICATES SIZE. (1-3/4", 2-1/2", 3-1") PROVIDE ACCESS TO NEW SHOWER VALVE FROM FRONT OR REAR AS INDICATED. PROVIDE ACCESS PANEL OR DOOR AS INDICATED. PROVIDE NEW PIPING AS REQ'D. ENLARGE OPENING AT EXIST SHOWER VALVE AS REQ'D TO INSTALL NEW. REPAIR DAMAGE TO EXISTING SURFACES AS REQUIRED TO INSTALL NEW ACCESS PLATE OR DOOR.

3
- NHS RSH

EXISTING FIXED SHOWER HEAD, REMOVE HEAD AND SPOUT PIPE. INSTALL NEW HAND SHOWER HOSE AND HEAD. INSTALL VAC CONNECTION, AND SLIDER BAR FOR HAND SHOWER HEAD.
- EHS RSC

EXIST HAND SHOWER HEAD AND HOSE. CONNECTED TO SHOWER SPOUT PIPE. REMOVE SPOUT AND INSTALL VAC CONN. RECONNECT HOSE AND HAND SHOWER HEAD.
- S/HS RSC

EXIST HAND SHOWER HEAD AND HAND HOSE. CONNECTED TO SHOWER SPOUT PIPE. REMOVE SPOUT AND INSTALL VAC . CONN. RECONNECT HOSE AND HAND SHOWER HEAD.

EXISTING OR NEW DEVICES OR ITEMS TOTAL ASD TO BE INSTALLED 23

- SH HS

EXIST SHOWER HEAD AND HAND SHOWER HEAD/HOSE.
- TS

EXIST TUB WITH SPOUT
- TS SH

EXIST TUB W/SPOUT AND SHOWER HD
- TS HSH

EXIST TUB W/SPOUT AND HAND SHOWER HD AND HOSE
- NAD #

NEW ACCESS DOOR AD - # SIZE -WALL ACCESS. # 1-16X16/ 2-24"X24"/SIZE 3-12"X12"/O- OTHER SIZE LOCATE WHERE SHOWN.
- AD

EXISTING ACCESS DOOR TO REMAIN
- R AD

EXIST AD TO BE REMOVED
- TOT 2

ASSE 1016 SV TYPE T/P
- NAP ASV

NEW CONTROL SIDE COVER PLATE AT NEW SHOWER VALVE. WITH OPENING FOR SHOWER VALVE, AND OPENINGS FOR ATTACHMENT. PROVIDE SIZE TO FIT. SECURE AND SEAL REFERENCE SPEC.
- SV

NEW IN WALL SHOWER VALVE-REMOVE EXIST. CONNECT TO IN WALL PIPE PROVIDE PIPE & CONNECTIONS. REPAIR WALL SURF AS REQD INSTALL PER MFG. REFERENCE WORK NOTE
- TOT 1

SV #
- HAS

EXIST HANDICAPPED ACCESSIBLE SHOWER.
- SH

EXIST FIXED SHOWER HEAD
- WT HS

THERAPUTIC TUB NO WORK
- HSH


EXISTING HAND SHOWER HEAD AND HOSE.

GENERAL NOTES

- 01

INSTALL ALL ITEMS AS INDICATED TO BE NEW OR TO BE RELOCATED.
- 02

REMOVAL AND REPLACEMENT OF EXISTING SHOWER VALVES IS TO BE FROM THE REAR OR BACK SIDE OF EXIST VALVE, WHERE NEW ACCESS DOORS ARE SHOWN.

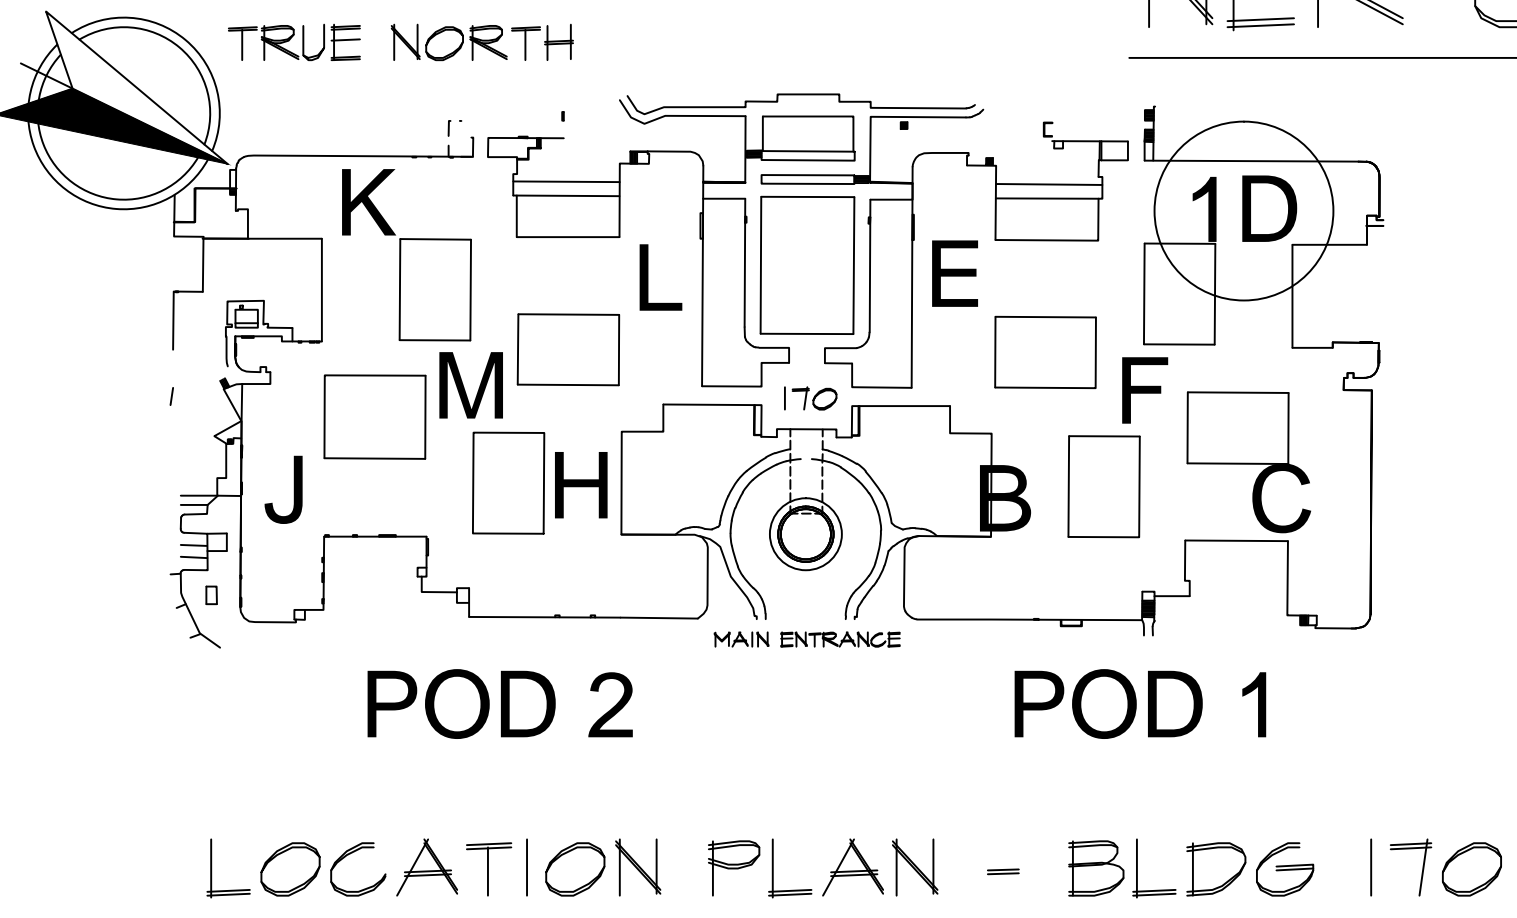

NLR QUAD ID - DEVICE LOCATIONS

1/8" = 1'-0"

KEYED NOTES

- 01

INSTALL TWO NEW ACCESS DOORS FOR ACCESS TO EXISTING SHOWER VALVES 2 AND 3 AS SHOWN. REPAIR AND REPLACE FINISHES TO MATCH. EXIST PLUMB FIXTURES REMAIN. RELOCATE MIRROR AND SOAP DISPENSER.
- 02

EXIST SHUT OFF VALVES - ABOVE CEIL
- 03

EXIST SHUT OFF VALVES - IN CHASE.

PROJECT 598-17-105

APPROVED: MEDICAL CENTER DIRECTOR	APPROVED: FACILITY PLANNER	APPROVED: SERVICE CHIEF
APPROVED: ASSOCIATE DIRECTOR	APPROVED: CHIEF ENGINEER	APPROVED: SERVICE CHIEF
APPROVED: ASSISTANT DIRECTOR	APPROVED: SERVICE CHIEF	APPROVED: SERVICE CHIEF

DRAWING TITLE	PROJECT TITLE			DATE
NLR WORK LOCATION PLAN & DETAILS	CORRECT LEGIONELLA PROBLEMS			1/2017
	BUILDING NUMBER	CHECKED	DRAWN	PROJECT NUMBER
QUAD 1D-NLR	170-NLR	KS	RS	598-17-105
LOCATION				DRAWING NO.
V.A.M.C. NLR DIVISION				ASD-1D
				Dwg 2 of 4



REVISIONS DATE