


LR POD 6E - DEVICE LOCATIONS

1/8" = 1'-0"

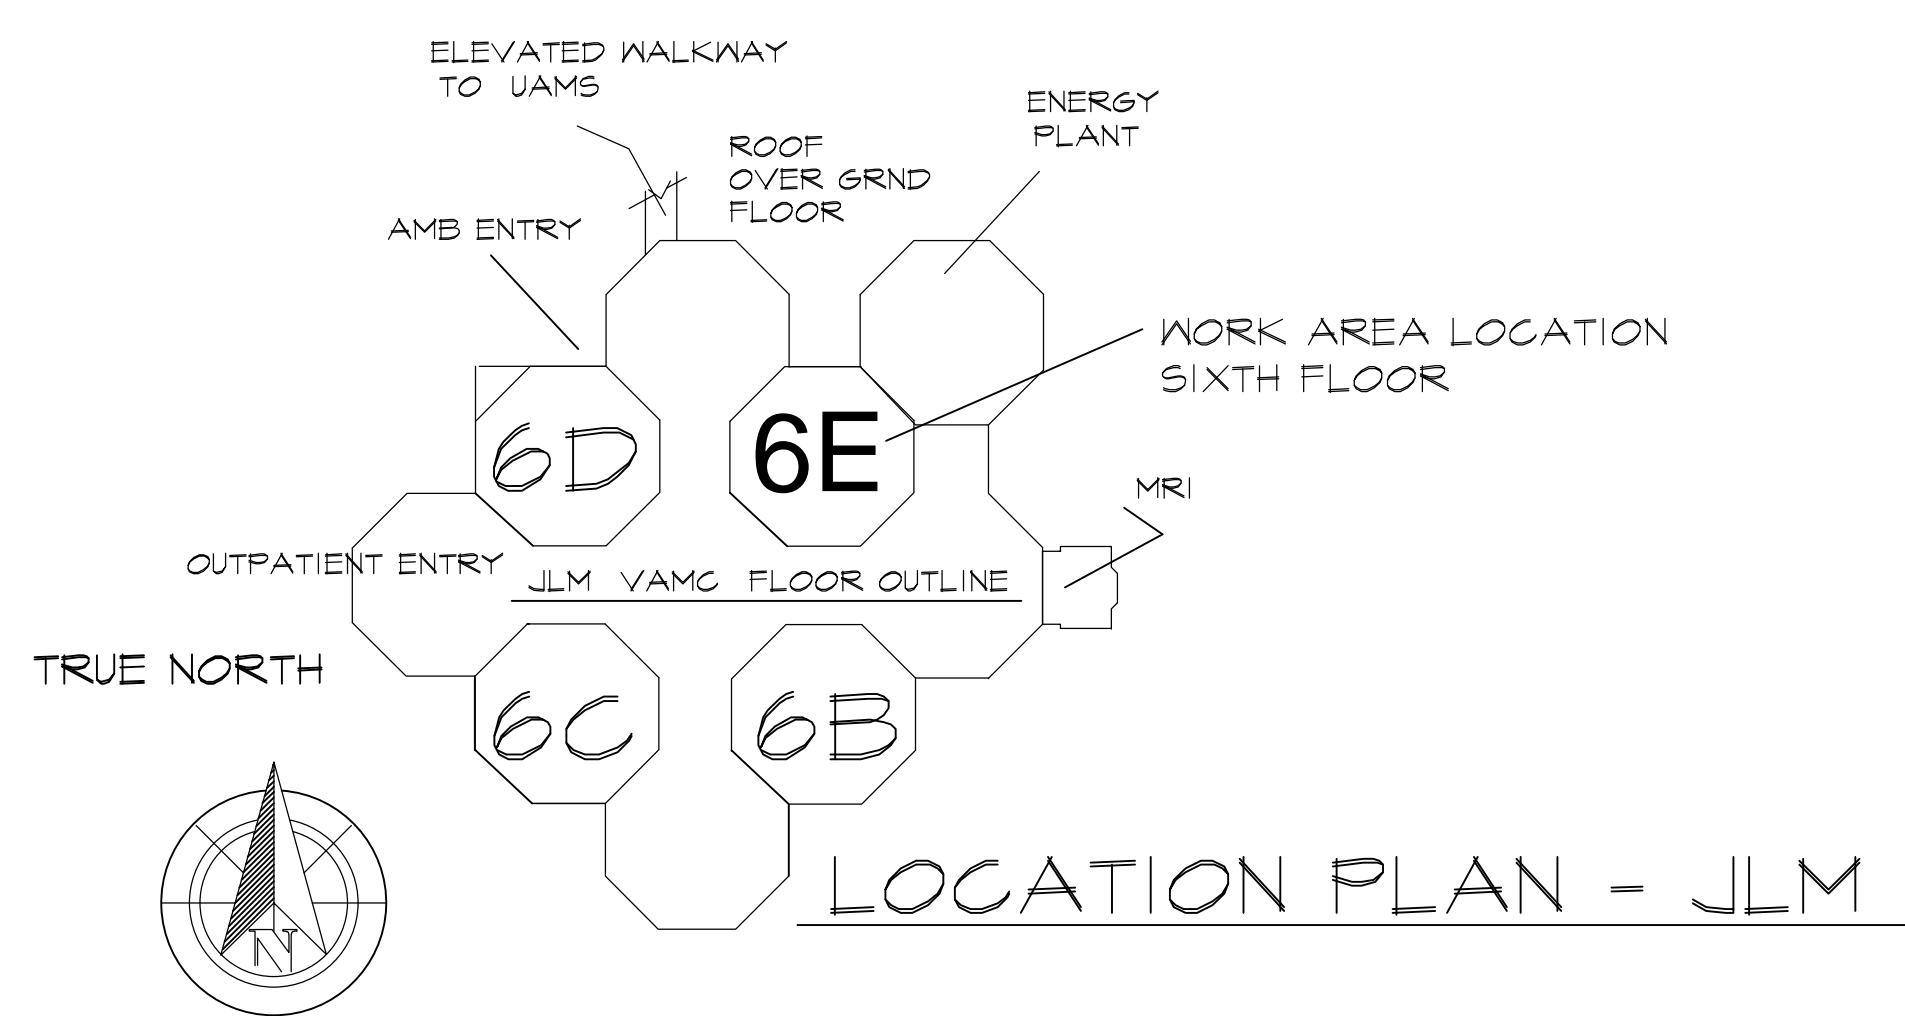

FIN NO.	FLOOR	WALL	WC	CEIL	NOTES
1F	TUB	CT	NONE	AT	
2F	TUB	CT	NONE	PGB	
3F	EPOXY	EOT	NONE	VCGB	507- EPOXY OVER CER TILE LAY IN TILE VGSB-W/RY COVERED BYT BO
3FA	CER TILE	PGB	CT	AT	NOT A SHOWER SP.
4F	EPOXY	EPOXY	NONE	PGB	
5F	EPOXY	EPOXY	NONE	EPOXY	
6F	EPOXY	EPOXY	NONE	AT	
7F	TILE	PGB	NONE	AT	NOT A SHOWER SP.
8F	CER TILE	CT	NONE	VCGB	
9F	CER TILE	CT	NONE	PGB	
10F	CER TILE	CT	NONE	AT	

CONTRACTOR VERIFIES FINISHES AS REQ'D

LOCATION-NEW WORK NOTES-DESCRIPTIONS

LI	EXIST WALL MOUNTED LAVATORY WITH FAUCET AND SHUT OFF VALVES . INSTALL MIXING VALVE BENEATH LAV, AND CONNECT TO EXIST FIXTURE FAUCET VALVES. INSTALL NEW POINT OF USE MIXING VALVE - TYPE I. REFERENCE INSTALL. DETAIL POU-I	15
L2	SAME AS TYPE LI EXCEPT INSTALL BENEATH LAV IN CASEWORK.	1
SV #	IN WALL OR CHASE NEW SHOWER VALVE-REMOVE EXIST. # IDENTIFIER INDICATES SIZE. ( 1-3/4", 2-1/2", 3-1") PROVIDE ACCESS TO NEW SHOWER VALVE FROM FRONT OR REAR AS INDICATED. PROVIDE ACCESS PANEL OR DOOR AS INDICATED. PROVIDE NEW PIPING AS REQ'D. ENLARGE OPENING AT EXIST SHOWER VALVE AS REQ'D TO INSTALL NEW. REPAIR DAMAGE TO EXISTING SURFACES AS REQUIRED TO INSTALL NEW ACCESS PLATE OR DOOR.	6
NHS RSH	EXISTING FIXED SHOWER HEAD, REMOVE HEAD AND SPOUT PIPE. INSTALL NEW HAND SHOWER HOSE AND HEAD. INSTALL VAC CONNECTION, AND SLIDER BAR FOR HAND SHOWER HEAD.	
EHS RSC	EXIST HAND SHOWER HEAD AND HOSE. CONNECTED TO SHOWER SPOUT PIPE. REMOVE SPOUT AND INSTALL VAC CONN. RECONNECT HOSE AND HAND SHOWER HEAD.	
S/HS RSC	EXIST HAND SHOWER HEAD AND HAND HOSE. CONNECTED TO SHOWER SPOUT PIPE. REMOVE SPOUT AND INSTALL VAC . CONN. RECONNECT HOSE AND HAND SHOWER HEAD.	

EXISTING OR NEW DEVICES OR ITEMS	TOTAL ASD TO BE INSTALLED	22
----------------------------------	---------------------------	----

(SH HS)	EXIST SHOWER HEAD AND HAND SHOWER HEAD/HOSE.	
(TS)	EXIST TUB WITH SPOUT	(TS SH) EXIST TUB W/SPOUT AND SHOWER HD
		(TS HSH) EXIST TUB W/SPOUT AND HAND SHOWER HD AND HOSE
(NAD #)	NEW ACCESS DOOR AD - # SIZE -WALL ACCESS. # 1-16X16/ 2-24"X24"/SIZE 3-12"X12"/O- OTHER SIZE LOCATE WHERE SHOWN.	(AD) EXISTING ACCESS DOOR TO REMAIN
(TOT 3)		(R AD) EXIST AD TO BE REMOVED
(NAP ASV)	NEW CONTROL SIDE COVER PLATE AT NEW SHOWER VALVE. WITH OPENING FOR SHOWER VALVE, AND OPENINGS FOR ATTACHMENT. PROVIDE SIZE TO FIT. SECURE AND SEAL REFERENCE SPEC.	(SV) ASSE 1016 SV TYPE T/P NEW IN WALL SHOWER VALVE-REMOVE EXIST. CONNECT TO IN WALL PIPE PROVIDE PIPE & CONNECTIONS. REPAIR WALL SURF AS REQD INSTALL PER MFG. REFERENCE WORK NOTE
(TOT 3)		(SV #)
(HAS)	EXIST HANDICAPPED ACCESSIBLE SHOWER.	(SH) EXIST FIXED SHOWER HEAD
		(HSH) EXISTING HAND SHOWER HEAD AND HOSE.

GENERAL NOTES

- INSTALL ALL ITEMS AS INDICATED TO BE NEW .
- REMOVAL AND REPLACEMENT OF EXISTING SHOWER VALVES IS TO BE FROM THE REAR OR BACK SIDE OF EXIST VALVE, WHERE NEW ACCESS DOORS ARE SHOWN.

PROJECT 598-17-105

REVISIONS	DATE		APPROVED: MEDICAL CENTER DIRECTOR	APPROVED: FACILITY PLANNER	APPROVED: SERVICE CHIEF	DRAWING TITLE <b>LR WORK LOCATION PLAN &amp; DETAILS</b>	PROJECT TITLE <b>CORRECT LEGIONELLA PROBLEMS</b>	DATE 1/2017		DEPARTMENT OF VETERANS AFFAIRS
			APPROVED: ASSOCIATE DIRECTOR	APPROVED: CHIEF ENGINEER	APPROVED: SERVICE CHIEF			PROJECT NUMBER 598-17-105		
			APPROVED: ASSISTANT DIRECTOR	APPROVED: SERVICE CHIEF	APPROVED: SERVICE CHIEF	POD 6E-JLM	BUILDING NUMBER 1-JLM	CHECKED KS	DRAWN RS	DRAWING NO. <b>ASD-6E</b>
							LOCATION V.A.M.C. LR DIVISION			Dwg 6 of 6