


FIN NO.	FLOOR	WALL	VC	CEIL	NOTES
1F	TUB	CT	NONE	AT	
2F	TUB	CT	NONE	PGB	
3F	EPOXY	EOT	NONE	PGB	EOT - EPOXY OVER CER TILE LAY IN TILE VES-VINT COVERED BY BD
3FA	CER TILE	PGB	CT	AT	NOT A SHOWER SP.
4F	EPOXY	EPOXY	NONE	PGB	
5F	EPOXY	EPOXY	NONE	EPOXY	
6F	EPOXY	EPOXY	NONE	AT	
7F	TILE	PGB	NONE	AT	NOT A SHOWER SP.
8F	CER TILE	CT	NONE	VCGB	
9F	CER TILE	CT	NONE	PGB	
10F	CER TILE	CT	NONE	AT	

CONTRACTOR VERIFIES FINISHES AS REQ'D

LR POD 6C - DEVICE LOCATIONS

1/8" = 1'-0"

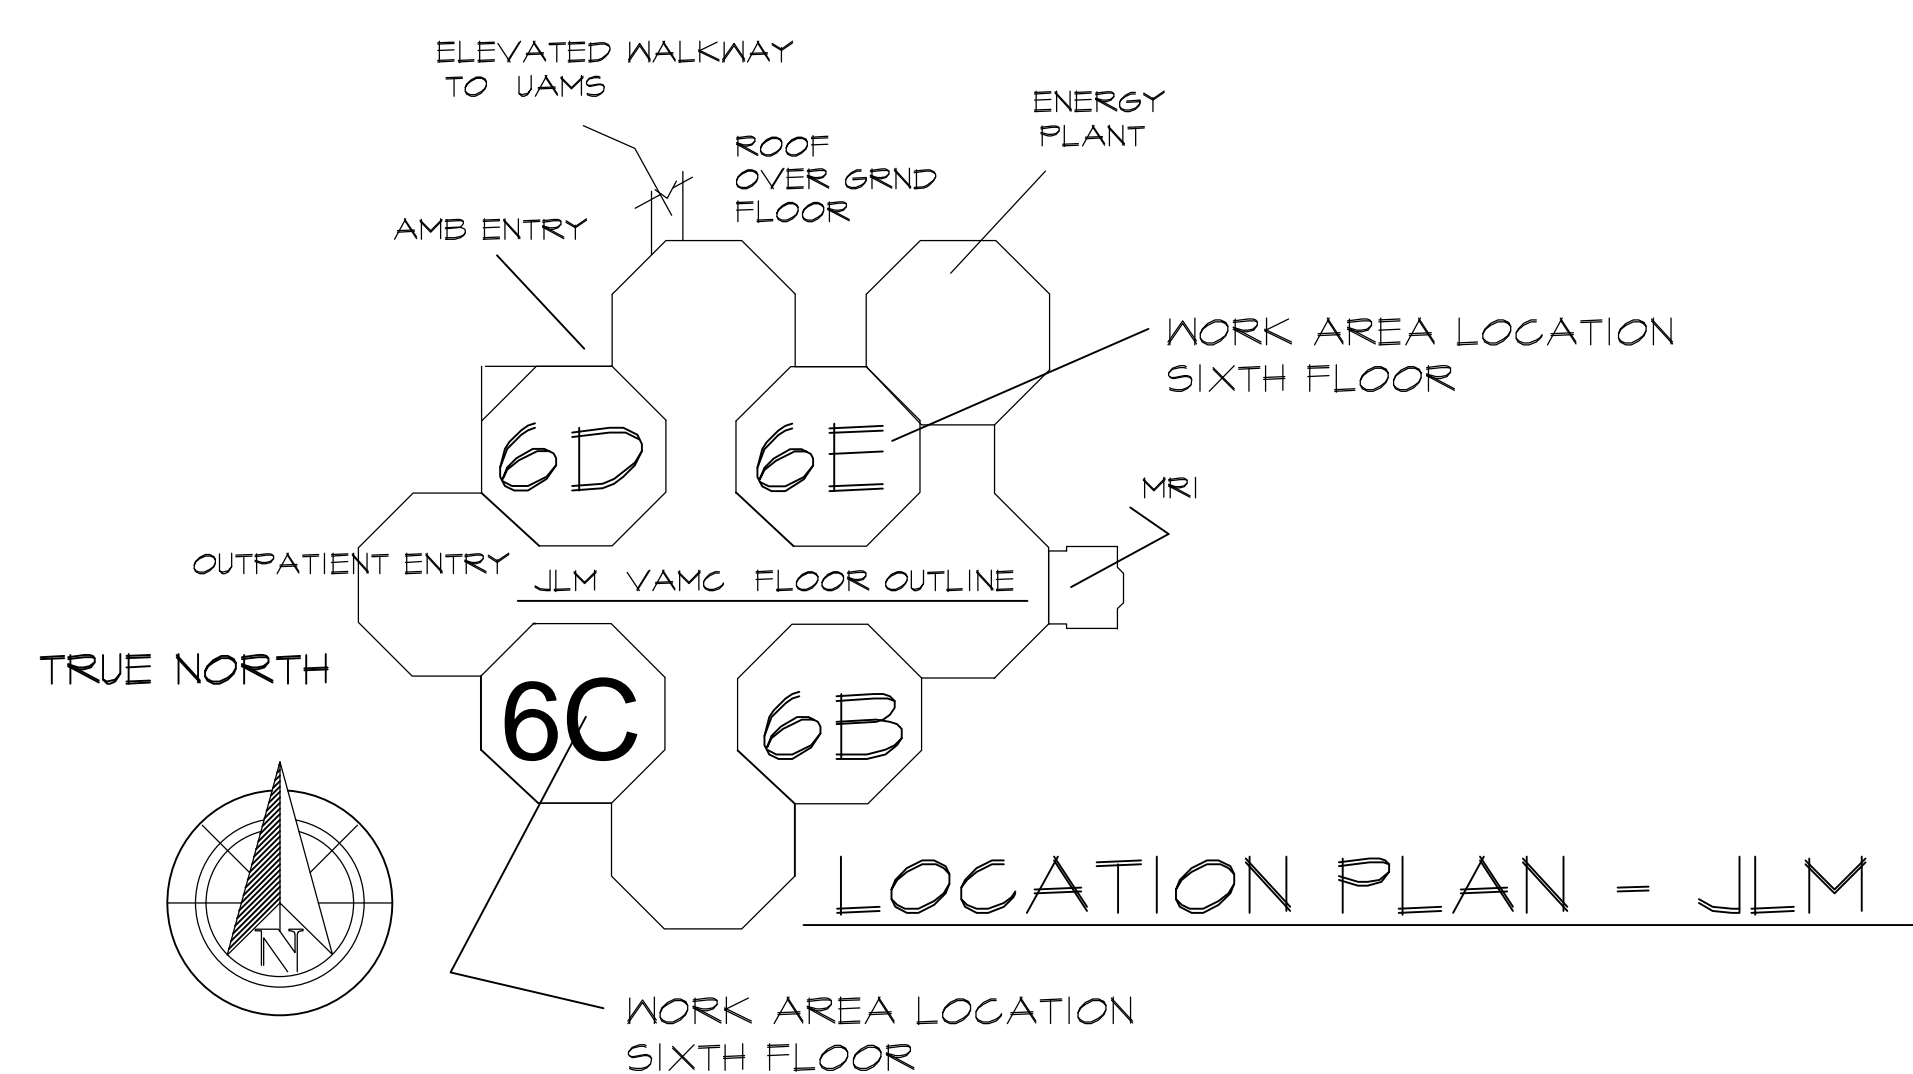

LOCATION-NEW WORK NOTES-DESCRIPTIONS

LI	EXIST WALL MOUNTED LAVATORY WITH FAUCET AND SHUT OFF VALVES . INSTALL MIXING VALVE BENEATH LAV, AND CONNECT TO EXIST FIXTURE FAUCET VALVES. INSTALL NEW POINT OF USE MIXING VALVE - TYPE I. REFERENCE INSTALL. DETAIL POU-I	15
L2	SAME AS TYPE LI EXCEPT INSTALL BENEATH LAV IN CASEWORK.	0
SV #	IN WALL OR CHASE NEW SHOWER VALVE-REMOVE EXIST. # IDENTIFIER INDICATES SIZE. (1-3/4", 2-1/2", 3-1") PROVIDE ACCESS TO NEW SHOWER VALVE FROM FRONT OR REAR AS INDICATED. PROVIDE ACCESS PANEL OR DOOR AS INDICATED. PROVIDE NEW PIPING AS REQ'D. ENLARGE OPENING AT EXIST SHOWER VALVE AS REQ'D TO INSTALL NEW. REPAIR DAMAGE TO EXISTING SURFACES AS REQUIRED TO INSTALL NEW ACCESS PLATE OR DOOR.	4
NHS RSH	EXISTING FIXED SHOWER HEAD, REMOVE HEAD AND SPOUT PIPE. INSTALL NEW HAND SHOWER HOSE AND HEAD. INSTALL VAC CONNECTION, AND SLIDER BAR FOR HAND SHOWER HEAD.	
EHS RSC	EXIST HAND SHOWER HEAD AND HOSE. CONNECTED TO SHOWER SPOUT PIPE. REMOVE SPOUT AND INSTALL VAC CONN. RECONNECT HOSE AND HAND SHOWER HEAD.	
S/HS RSC	EXIST HAND SHOWER HEAD AND HAND HOSE. CONNECTED TO SHOWER SPOUT PIPE. REMOVE SPOUT AND INSTALL VAC . CONN. RECONNECT HOSE AND HAND SHOWER HEAD.	

EXISTING OR NEW DEVICES OR ITEMS	TOTAL ASD TO BE INSTALLED	19
----------------------------------	---------------------------	----

SH HS	EXIST SHOWER HEAD AND HAND SHOWER HEAD/HOSE.	
TS	EXIST TUB WITH SPOUT	
TS SH	EXIST TUB W/SPOUT AND SHOWER HD	
TS HSH	EXIST TUB W/SPOUT AND HAND SHOWER HD AND HOSE	
NAD #	NEW ACCESS DOOR AD - # SIZE -WALL ACCESS. # 1-16X16/ 2-24"X24"/SIZE 3-12"X12"/O- OTHER SIZE LOCATE WHERE SHOWN.	
TOT O		
NAP ASV	NEW CONTROL SIDE COVER PLATE AT NEW SHOWER VALVE. WITH OPENING FOR SHOWER VALVE, AND OPENINGS FOR ATTACHMENT. PROVIDE SIZE TO FIT. SECURE AND SEAL REFERENCE SPEC.	
TOT 4		
HAS	EXIST HANDICAPPED ACCESSIBLE SHOWER.	
AD	EXISTING ACCESS DOOR TO REMAIN	
R AD	EXIST AD TO BE REMOVED	
SV	ASSE 1016 SV TYPE T/P NEW IN WALL SHOWER VALVE-REMOVE EXIST. CONNECT TO IN WALL PIPE PROVIDE PIPE & CONNECTIONS. REPAIR WALL SURF AS REQD INSTALL PER MFG. REFERENCE WORK NOTE SV #	
SH	EXIST FIXED SHOWER HEAD	
HSH	EXISTING HAND SHOWER HEAD AND HOSE.	

GENERAL NOTES

- INSTALL ALL ITEMS AS INDICATED TO BE NEW .
- REMOVAL AND REPLACEMENT OF EXISTING SHOWER VALVES IS TO BE FROM THE REAR OR BACK SIDE OF EXIST VALVE, WHERE NEW ACCESS DOORS ARE SHOWN.

APPROVED: MEDICAL CENTER DIRECTOR	APPROVED: FACILITY PLANNER	APPROVED: SERVICE CHIEF
APPROVED: ASSOCIATE DIRECTOR	APPROVED: CHIEF ENGINEER	APPROVED: SERVICE CHIEF
APPROVED: ASSISTANT DIRECTOR	APPROVED: SERVICE CHIEF	APPROVED: SERVICE CHIEF

DRAWING TITLE
LR WORK LOCATION PLAN & DETAILS
POD 6C-JLM

PROJECT TITLE
CORRECT LEGIONELLA PROBLEMS
BUILDING NUMBER
1-JLM
CHECKED
KS
DRAWN
RS
LOCATION
V.A.M.C. LR DIVISION

DATE
1/2017
PROJECT NUMBER
598-17-105
DRAWING NO.
ASD-6C
Dwg 4 of 6

PROJECT 598-17-105

