


EXISTING IN SHOWER SPACE FINISHES AND OTHERS				
FIN NO.	FLOOR	WALL	CEIL	NOTES
1F	TUB	CT	NONE	AT
2F	TUB	CT	NONE	FSB
3F	EPOXY	EOT	NONE	VCGB EOT-EPOXY OVER CER TILE LAY IN TILE NOT A SHOWER SP.
3FA	CER TILE	FSB	CT	AT
4F	EPOXY	EPOXY	NONE	FSB
5F	EPOXY	EPOXY	NONE	EPOXY
6F	EPOXY	EPOXY	NONE	AT
7F	TILE	FSB	NONE	AT
8F	CER TILE	CT	NONE	VCGB
9F	CER TILE	CT	NONE	FSB
10F	CER TILE	CT	NONE	AT
11F	TUB	EOT	NONE	AT


CONTRACTOR VERIFIES FINISHES AS REQ'D

POD 4D - DEVICE LOCATIONS

SCALE 1/8"=1'-0"

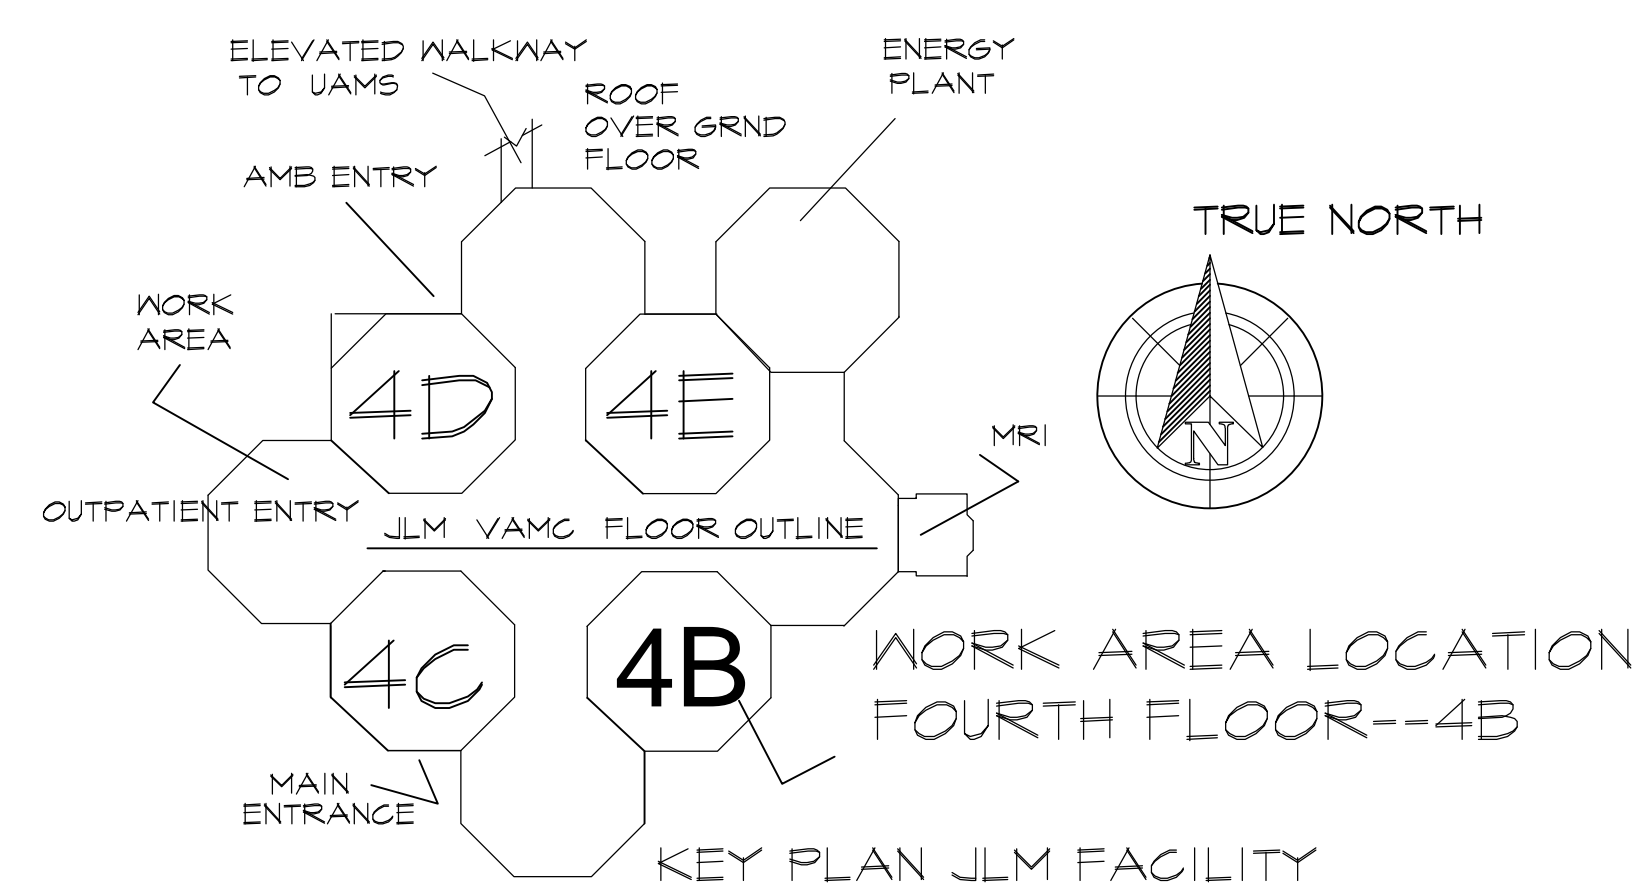

LOCATION PLAN - JLM

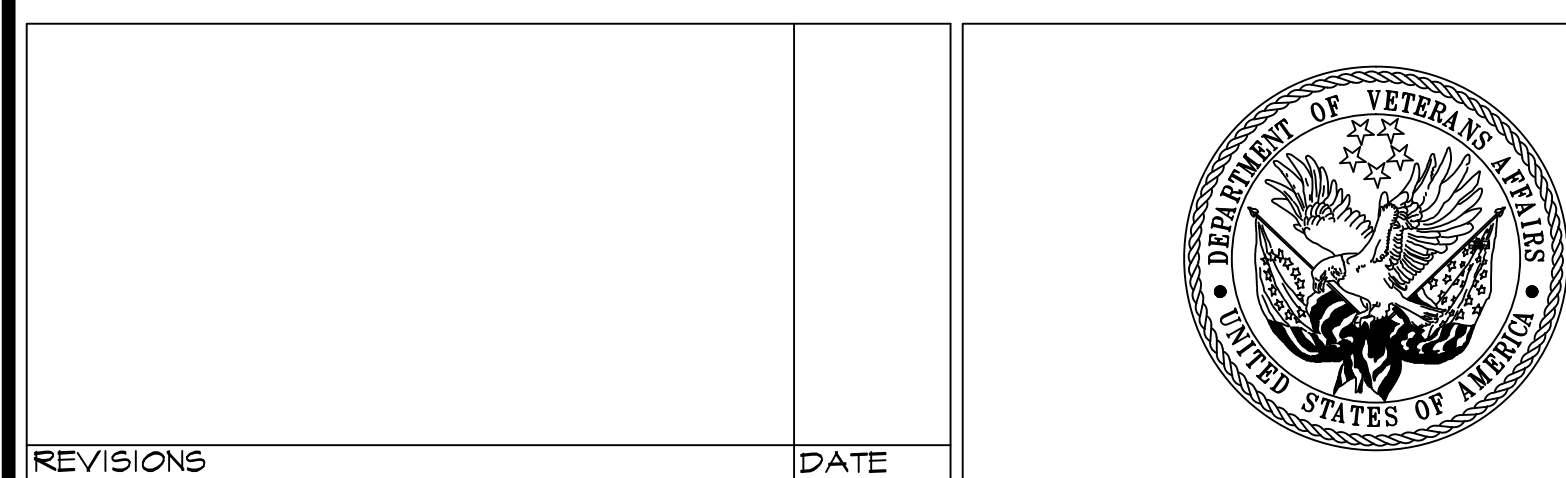

APPROVED: MEDICAL CENTER DIRECTOR	APPROVED: FACILITY PLANNER	APPROVED: SERVICE CHIEF
APPROVED: ASSOCIATE DIRECTOR	APPROVED: CHIEF ENGINEER	APPROVED: SERVICE CHIEF
APPROVED: ASSISTANT DIRECTOR	APPROVED: SERVICE CHIEF	APPROVED: SERVICE CHIEF

LOCATION-NEW WORK NOTES-DESCRIPTIONS		
LI	EXIST WALL MOUNTED LAVATORY WITH FAUCET AND SHUT OFF VALVES. INSTALL MIXING VALVE BENEATH LAV, AND CONNECT TO EXIST FIXTURE FAUCET VALVES. INSTALL NEW POINT OF USE MIXING VALVE - TYPE I. REFERENCE INSTALL. DETAIL POU-I	19
L2	SAME AS TYPE LI EXCEPT INSTALL BENEATH LAV IN CASEWORK.	0
SV #	IN WALL OR CHASE NEW SHOWER VALVE-REMOVE EXIST. # IDENTIFIER INDICATES SIZE. (1-3/4", 2-1/2", 3-1") PROVIDE ACCESS TO NEW SHOWER VALVE FROM FRONT OR REAR AS INDICATED. PROVIDE ACCESS PANEL OR DOOR AS INDICATED. PROVIDE NEW PIPING AS REQ'D. ENLARGE OPENING AT EXIST SHOWER VALVE AS REQ'D TO INSTALL NEW. REPAIR DAMAGE TO EXISTING SURFACES AS REQUIRED TO INSTALL NEW ACCESS PLATE OR DOOR.	14
NHS RSH	EXISTING FIXED SHOWER HEAD, REMOVE HEAD AND SPOUT PIPE. INSTALL NEW HAND SHOWER HOSE AND HEAD. INSTALL VAC CONNECTION, AND SLIDER BAR FOR HAND SHOWER HEAD.	
EHS RSC	EXIST HAND SHOWER HEAD AND HOSE. CONNECTED TO SHOWER SPOUT PIPE. REMOVE SPOUT AND INSTALL VAC CONN. RECONNECT HOSE AND HAND SHOWER HEAD.	
S/HS RSC	EXIST HAND SHOWER HEAD AND HAND HOSE. CONNECTED TO SHOWER SPOUT PIPE. REMOVE SPOUT AND INSTALL VAC CONN. RECONNECT HOSE AND HAND SHOWER HEAD.	
EXISTING OR NEW DEVICES OR ITEMS		TOTAL ASD TO BE INSTALLED
		33
SH HS	EXIST SHOWER HEAD AND HAND SHOWER HEAD/HOSE.	
TS	EXIST TUB WITH SPOUT	TS SHS
TS SHS	EXIST TUB W/SPOUT AND HAND SHOWER HD AND HOSE	
NAD #	NEW ACCESS DOOR AD - # SIZE -WALL ACCESS. # 1-16X16/ 2-24"X24"/5/12 3-12"X12"/O- OTHER SIZE LOCATE WHERE SHOWN.	AD
TOT 9		AD
NAP ASV	NEW CONTROL SIDE COVER PLATE AT NEW SHOWER VALVE. WITH OPENING FOR SHOWER VALVE, AND OPENINGS FOR ATTACHMENT. PROVIDE SIZE TO FIT. SECURE AND SEAL REFERENCE SPEC.	SV
TOT 5		SV
SH	EXIST FIXED SHOWER HEAD	
HAS	EXIST HANDICAPPED ACCESSIBLE SHOWER.	HSH
HSH	EXISTING HAND SHOWER HEAD AND HOSE.	
GENERAL NOTES		
01 INSTALL ALL ITEMS AS INDICATED TO BE NEW.		
02 REMOVAL AND REPLACEMENT OF EXISTING SHOWER VALVES IS TO BE FROM THE REAR OR BACK SIDE OF EXIST VALVE, WHERE NEW ACCESS DOORS ARE SHOWN.		

PROJECT 598-105-17

DRAWING TITLE	PROJECT TITLE	DATE	
LR WORK LOCATION PLAN & DETAILS	CORRECT LEGIONELLA PROBLEMS	12/2016	
POD 4D-JLM	BUILDING NUMBER	PROJECT NUMBER	
	I-JLM	598-105-17	
	CHECKED	DRAWN	
	KS	RS	
	LOCATION	DRAWING NO.	
	V.A.M.C. LR DIVISION	ASD-4D	
		Dwg 3 of 6	