

- SITE PLAN NOTES:**
1. TREE PROTECTION: ALL EXISTING TREES ARE TO BE PROTECTED FROM DAMAGE TO THEIR BRANCHES, TRUNK, OR ROOTS. TREE PROTECTION ZONE: THE AREA WITHIN THE DAPLINE OF THE TREE, OR WITHIN 10 FEET OF THE TRUNK, OR WITHIN TREE PROTECTION FENCE SHOWN ON PLANS, WHICHEVER IS GREATER. NO VEHICULAR TRAFFIC OR STORAGE OF MATERIALS ALLOWED WITHIN TREE PROTECTION ZONES. ANY UNAVOIDABLE TRENCHING, EXCAVATION, OR GRADING WITHIN TREE PROTECTION ZONES MUST UTILIZE ALTERNATE METHODS SUCH AS HAND DIGGER TO LOCATE ROOTS. THE CUTTING OF THE ROOTS GREATER THAN 100 FEET MUST BE APPROVED AND SUPERVISED BY A LICENSED ARBORIST. SEE 01/27/19 TEMPORARY ENVIRONMENTAL CONTROLS.
  2. PROTECTION OF EXISTING IMPROVEMENTS: PROTECT EXISTING LANDSCAPING, IRRIGATION, BENCH MARKS, UTILITIES, SIDEWALKS, PAVING AND CURBS FROM EQUIPMENT, VEHICULAR TRAFFIC AND GENERAL CONSTRUCTION ACTIVITIES. ITEMS INTENDED TO REMAIN THAT ARE DAMAGED BY THE CONTRACTOR SHALL BE REPLACED AT NO EXPENSE TO THE GOVERNMENT. DISTURBED AREAS SHALL BE RESTORED TO ORIGINAL CONDITION.
  3. UTILITY LOCATING: NOTIFY UTILITY LOCATOR SERVICE AT LEAST 3 WORKING DAYS PRIOR TO ANY DIGGING OR EXCAVATION. CALL 811.
  4. PROTECT EXISTING UTILITIES: ALL EXISTING UTILITIES SHALL BE PROTECTED. PROTECT EXISTING UTILITIES FROM DAMAGE. NO VEHICLES OVER 6,000 LB WHEEL LOAD 12,000 LB AXLE LOAD OR EQUIVALENT PRESSURE PER SQUARE INCH TO OPERATE WITHIN 30 FEET OF CRYPT FIELD BOUNDARY. USE EXTREME CAUTION DURING CONSTRUCTION.
  5. VERIFY LOCATION OF EXISTING PRE-PLACED CRYPTS BY EXCAVATING TO UNCOVER TOP OF CRYPT AT EACH CORNER OF THE CRYPT FIELD AND SUPERVISING THESE LOCATIONS INCLUDING NORTHING, EASTING AND ELEVATION OF TOP OF CRYPT LID. PROVIDE RECORD DRAWINGS.
  6. MARK BOUNDARY OF PRE-PLACED CRYPT FIELD WITH TREE PROTECTION FENCE. PROVIDE SIGNAGE AT 30 FT INTERVALS INDICATING 12,000 LB AXLE LOAD MAXIMUM WITHIN 30 FEET FENCE.
  7. DO NOT STORE OR STOCKPILE ANY STONE, SAND, BACKFILL, OR ANY OTHER MATERIAL WITHIN 30 FEET OF INSTALLED CRYPTS. AFFECTED CRYPTS SUBJECT TO SAID LOADING CONDITION AS DETERMINED BY THE CONTRACTOR. ALL EXCAVATION LID LIFTING, FILL REPLACEMENT AND ALL OTHER WORK AS NECESSARY TO DETERMINE EXTENT OF DAMAGE AND CORRECTIVE ACTION SHALL BE AT NO ADDITIONAL EXPENSE TO THE GOVERNMENT.
  8. ALL UTILITIES, POSTS, FURNISH AND INSTALL 10 POST CARS FOR EXISTING FENCE. CARS SHALL BE CAST ALUMINUM TO FIT 2-1/2" SQUARE POSTS. COLOR BLACK. FENCE IS INDUSTRIAL FENCE STYLE #101 BY JERRIT. 800-344-2242. ALL FENCE POSTS SHALL HAVE CARS FOR FINAL ACCEPTANCE.
  9. LOCATION OF UTILITIES SHOWN IS APPROXIMATE. OTHER UNDERGROUND UTILITIES MAY EXIST THAT ARE NOT SHOWN ON PLANS. EXERCISE EXTREME CAUTION WHEN DIGGING NEAR PC BUILDING. DAMAGE TO EXISTING UTILITIES SHALL BE REPAIRED AT NO ADDITIONAL EXPENSE TO THE GOVERNMENT.

**ROSTRUM PLAN**  
NO SCALE

CONSULTANTS:

ARCHITECT/ENGINEERS:



NATIONAL  
CEMETERY  
ADMINISTRATION

Location  
**FT. BAYARD NATIONAL CEMETERY**

Project Title  
**REMOVE AND REPLACE CONCRETE ROSTRUM**

Project Number  
**885-M&R-FY17-005**

Date  
**05/16/2017**


Drawing Number  
**1**

Drawn  
**1**



Checked  
**1**

Approved  
**1**

Approved Project Manager  
**1**

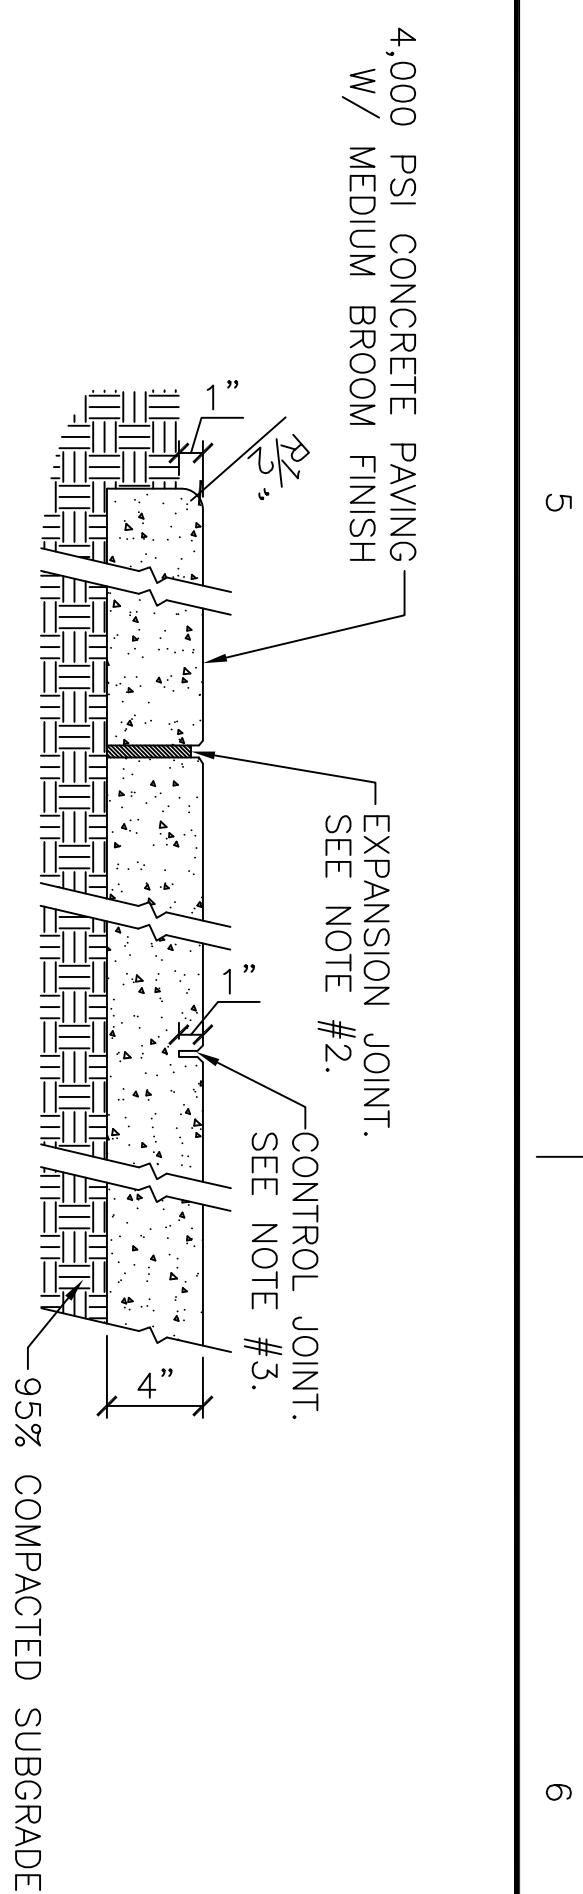

- GENERAL NOTES:
1. CONTROL JOINTS AND EXPANSION JOINTS SHALL BE SPACED AS SHOWN ON PLANS. ADDITIONALLY, CONTRACTOR SHALL CONSTRUCT EXPANSION JOINTS WHERE SIDEWALK ABUTS EXISTING BUILDINGS, CURBS, SEAWING WALLS, WALKS AND OTHER HARD CONSTRUCTION.
  2. 8" WIDE EXPANSION JOINT WITH BACKER ROD AND SEALANT. OPPOSING CONCRETE EDGES OF JOINT SHALL HAVE 1/4" RADIUS TOELED EDGE. TOP OF SEALANT SHALL BE FLUSH WITH (OR SLIGHTLY BELOW) TOP OF CONCRETE. FINISHED SEALANT SHALL HAVE A SMOOTH STRAIGHT UNIFORM EDGE, AND SHALL NOT EXTEND OVER SURFACE OF CONCRETE OR INTO ADJACENT CONTROL JOINTS. SEALANT COLOR TO MATCH ADJACENT CONCRETE.
  3. 5/8" WIDE X 1/4" SLAB DEPTH TOOLED CONTROL JOINT WITH 1/8" RADIUS EDGES. JOINTS MAY BE TOOLED FIRST, THEN SAW CUT TO REQUIRED DEPTH. THE SAW CUT JOINTS SHALL BE CUT WITHIN 1-4 HOURS (DEPENDENT UPON WEATHER CONDITIONS) AFTER FINISHING OF CONCRETE. JOINTS SHALL BE CUT WITH AN EARLY ENTRY TYPE DRY CUT SAW. SPALLING OF CONCRETE FINISH AT EDGE OF CUT IS NOT ACCEPTABLE.
  4. CONCRETE AT ROOSTRUM SHALL HAVE INTEGRAL COLOR. SEE SPECIFICATIONS.

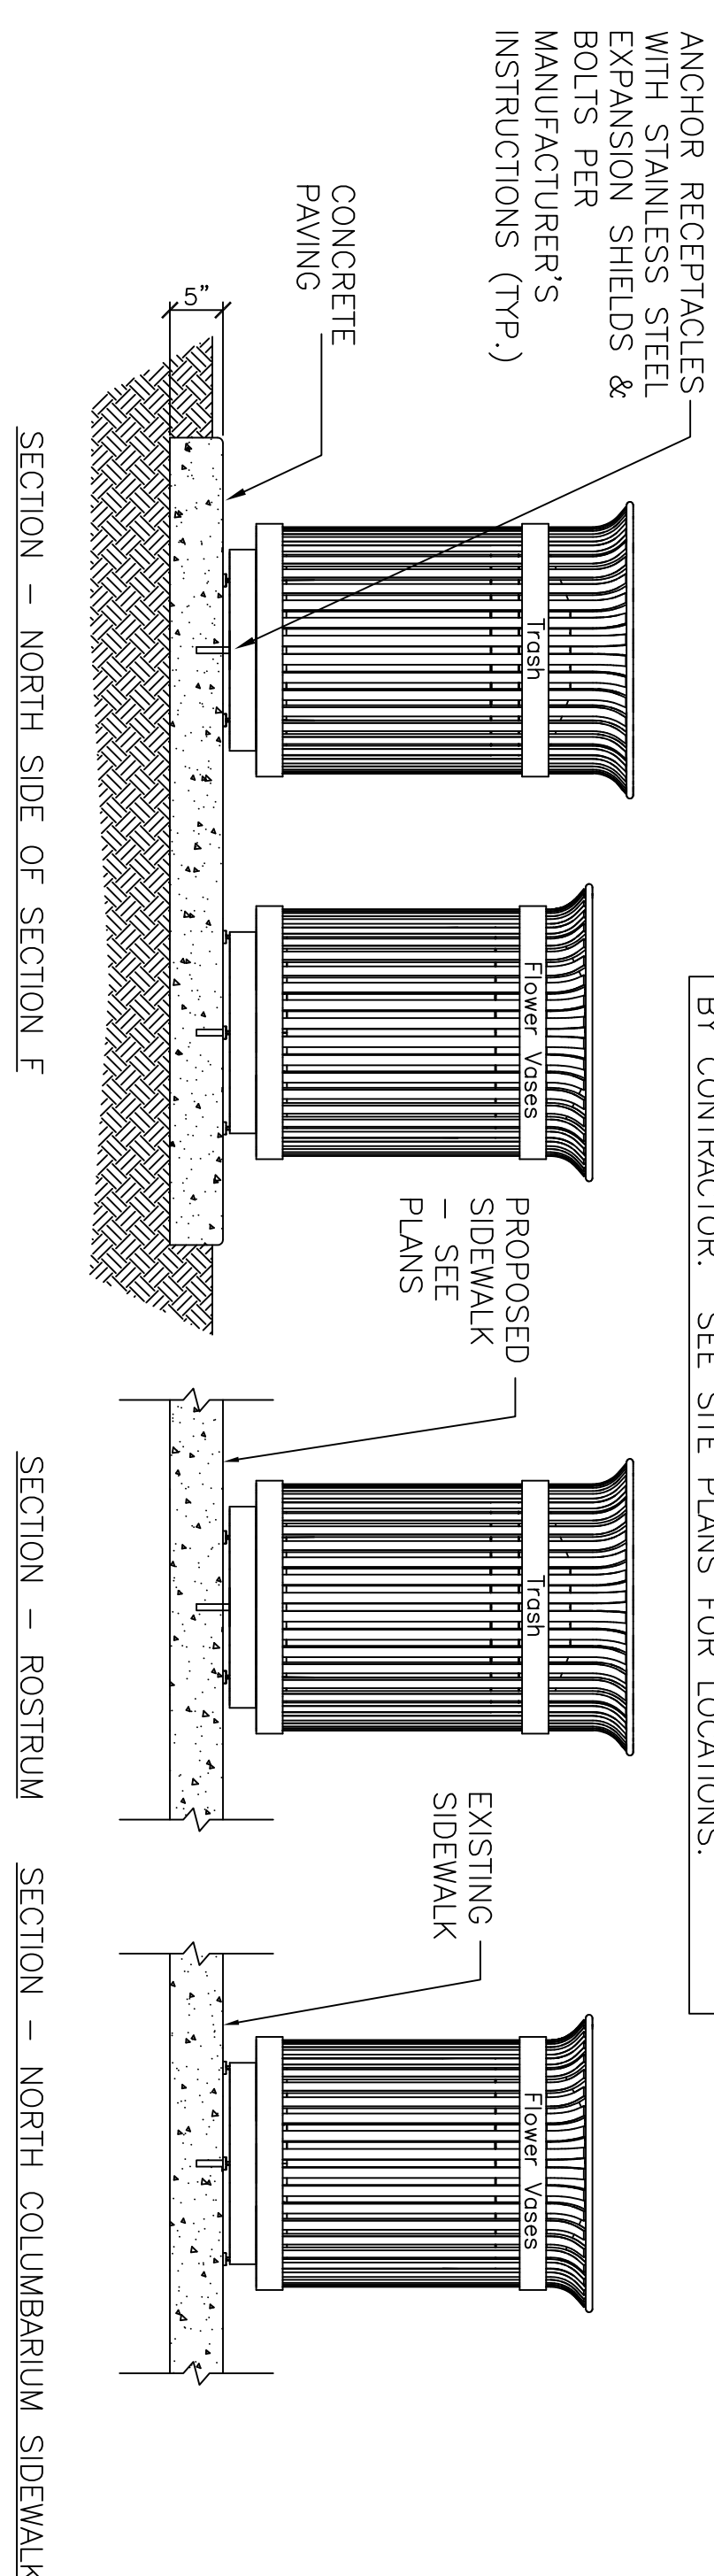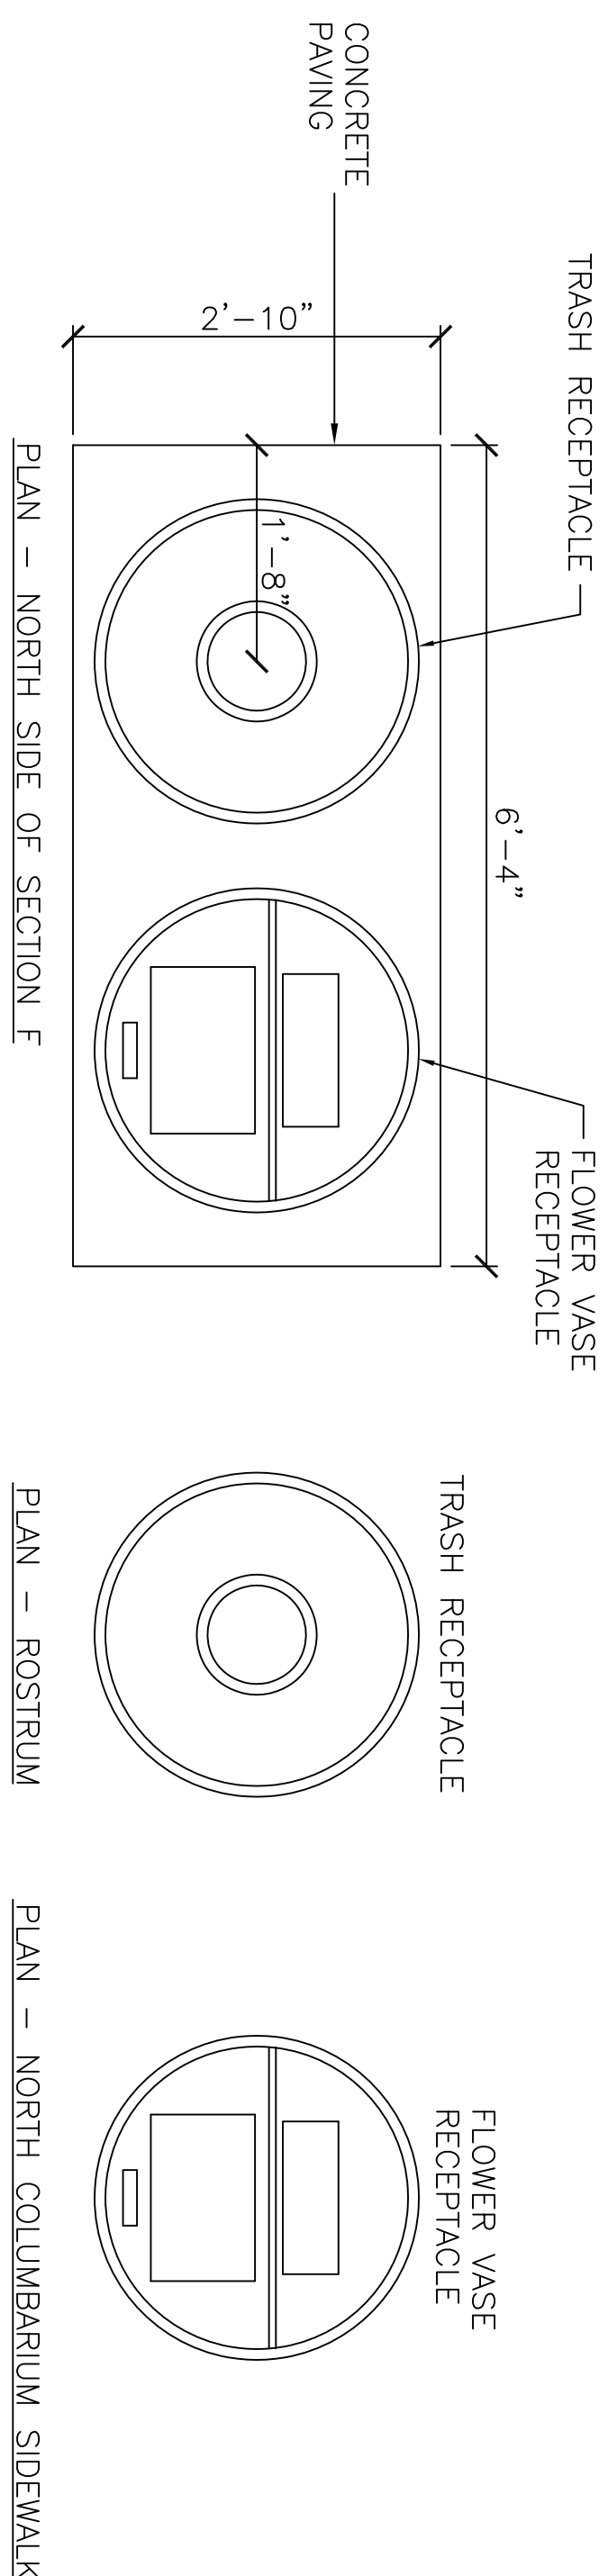

TRASH RECEPTACLE  
SCALE: 3/4"=1'-0"

NOTE: RECEIPTABLES ARE FURNISHED BY OWNER, INS BY CONTRACTOR. SEE SITE PLANS FOR LOCATIONS.

[illegible]