GENERAL DRAWING NOTES:

EQUIVALENCIES HAVE BEEN GRANTED FOR THE FOLLOWING:

1. SELF CLOSING DOOR HARDWARE IN DOMICILLIARY OCCUPANCIES–DATED 1/09/98
2. INSTALLATION OF WIRELESS ACCESS POINT EQUIPMENT WITHIN EXIT STAIR ENCLOSURES–DATED 2/11/10

DRAWING KEY NOTES:

(A) AUDIO BOOTHS INSTALLED UNDER 1985 VA DIRECTIVE (REPEALED IN 1998). SPRINKLERS INSTALLED ABOVE AND AROUND AUDIO BOOTHS.

SYMBOLS LIST

- ━ ·· ━ 2 HOUR FIRE BARRIER
- ━ · ━ 1 HOUR FIRE BARRIER
- ━ ○○ ━ 2 HOUR FIRE/SMOKE BARRIER
- ━ ○ ━ 1 HOUR FIRE/SMOKE BARRIER
- ○○○○○○○○ 30 MINUTE SMOKE BARRIER
- ++++++++ SMOKE RESISTIVE HAZARDOUS AREA

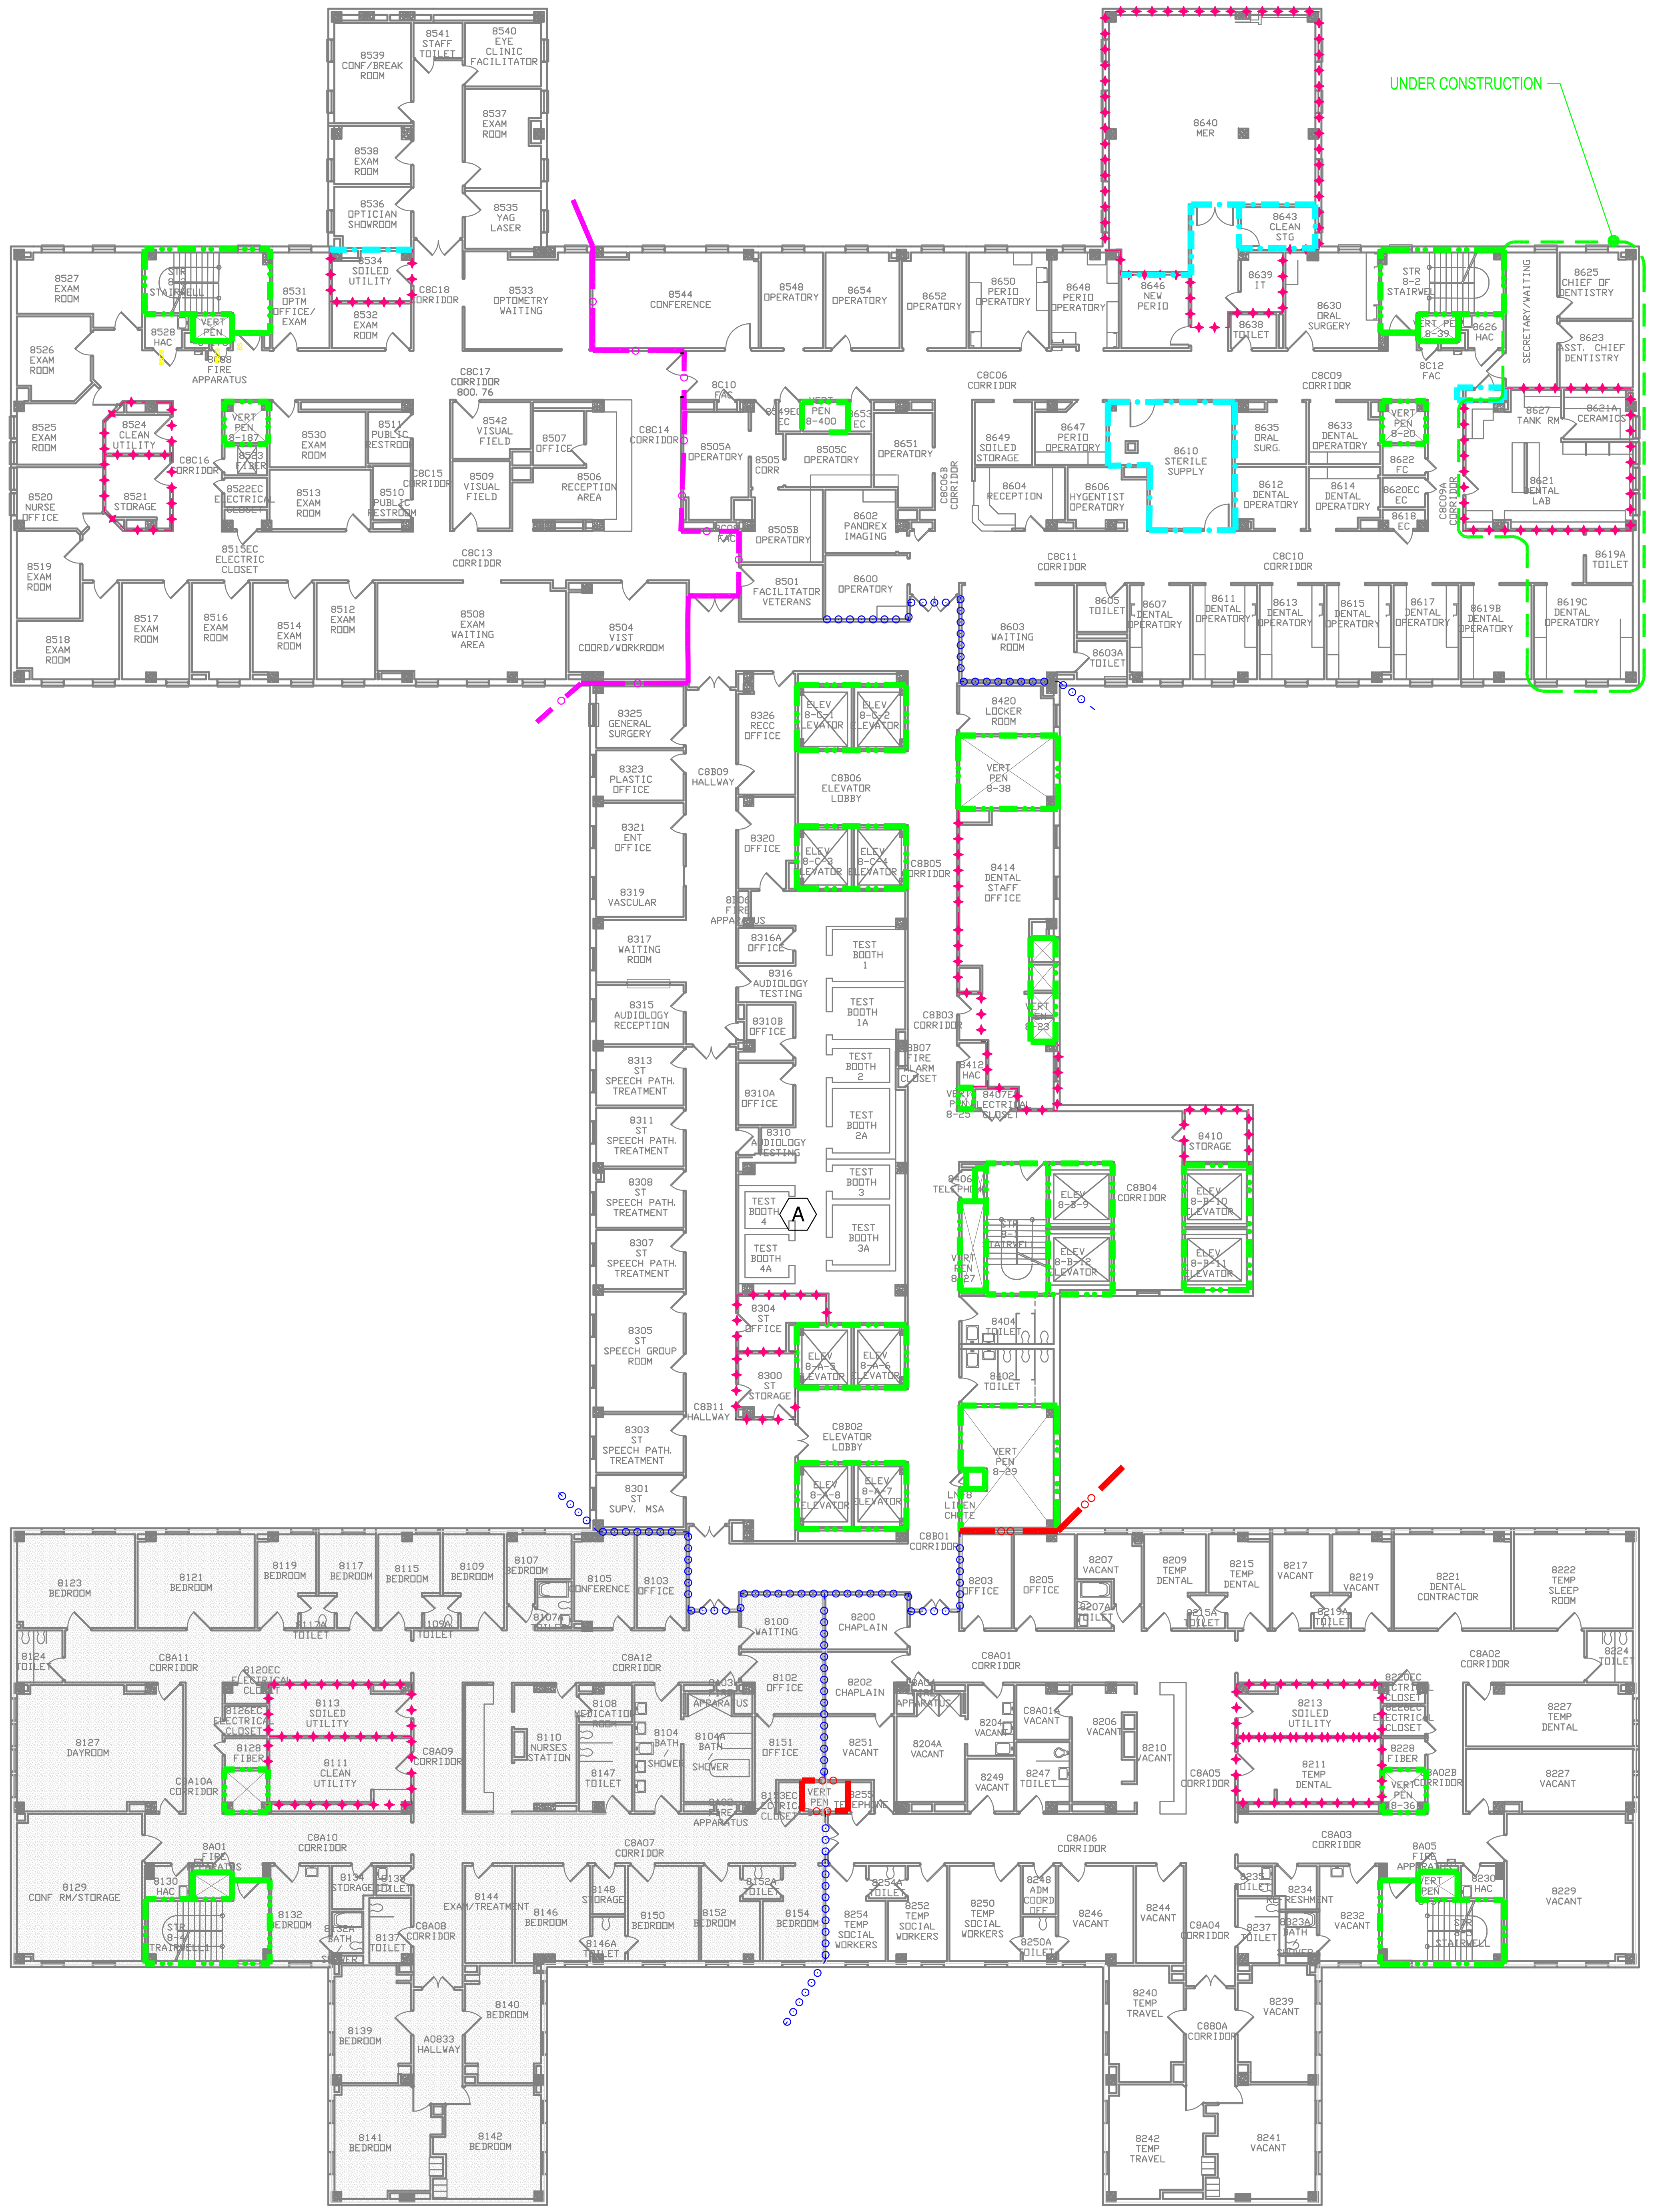

▨ HAP OCCUPANCY
20,9000s.f.

AMBULATORY OCCUPANCY
32,337s.f.

BUILDING 111 EIGHTH FLOOR

FULLY SPRINKLERED
HEALTH CARE OCCUPANCY

Revisions	Date	CLEMENT J. ZABLOCKI VAMC 5000 W. National Ave. Milwaukee, WI 53295	G:\2014 SOC\dwg\Border\dvaseal2.bmp	FP&C CONSULTANTS, INC. 1520 MAIN STREET INDIANAPOLIS, IN 46224 (317)486-5188	Drawing Title BUILDING 111 EIGHTH FLOOR	Client Project No.	Contract No.	Project Title STATEMENT OF CONDITIONS	Designed By BAA	Checked By BAA	Drawn By DN
FP&C Proj.#: 1751.54						Building No. 111	AutoCAD File Name SOC09 111-8		Location CLEMENT J. ZABLOCKI VAMC MILWAUKEE, WISCONSIN		

Date 12/2016

Scale: NO SCALE

Drawing No.
SOC-9
Sht. 9 Of 14