


PROJECT MANUAL

100% Submission

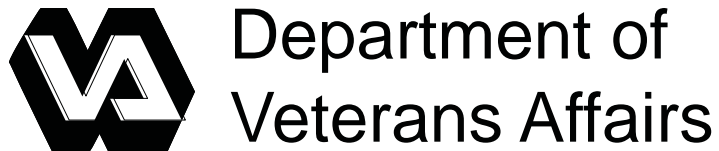

ADULT DAY CARE BUILDING

VA PROJECT NO. VA246-P-0568

VETERANS AFFAIRS MEDICAL CENTER
Beckley, West Virginia



Roanoke Charlotte


August 5, 2011 - Revised June 21, 2012
Commission No.10110.00

PROJECT MANUAL

FOR

VETERANS AFFAIRS MEDICAL CENTER

Beckley, West Virginia

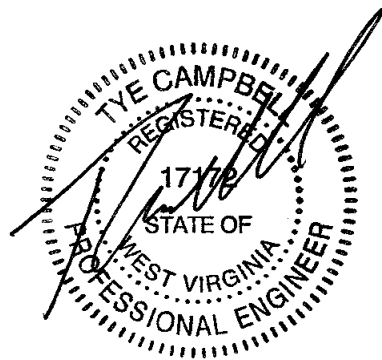

August 5, 2011
Revised June 21, 2012

Prepared By

SFCS Inc.
Architecture/Engineering/Planning/Interiors
305 S. Jefferson St., Roanoke, Virginia 24011
540-344-6664 FAX 540-343-6925

SFCS Commission Number 10110.00

**DEPARTMENT OF VETERANS AFFAIRS
VHA MASTER SPECIFICATIONS**

**TABLE OF CONTENTS
Section 00 01 10**

	DIVISION 00 - SPECIAL SECTIONS	DATE
00 01 15	List of Drawing Sheets	10-07
	DIVISION 01 - GENERAL REQUIREMENTS	
01 00 00	General Requirements	02-11
01 32 16.15	Project Schedules	04-10M
01 33 23	Shop Drawings, Product Data, and Samples	11-08
01 42 19	Reference Standards	11-08
01 45 29	Testing Laboratory Services	05-08
01 57 19	Temporary Environmental Controls	01-11
01 58 16	Temporary Interior Signage	10-07
01 74 19	Construction Waste Management	09-10
	DIVISION 02 - EXISTING CONDITIONS	
02 21 00	Site Surveys	11-07
02 41 00	Demolition	06-10
	DIVISION 03 - CONCRETE	
03 30 00	Cast-in-Place Concrete	03-11
	DIVISION 04 - MASONRY	
04 05 13	Masonry Mortaring	08-08
04 05 16	Masonry Grouting	06-08
04 20 00	Unit Masonry	08-08
04 42 00	Exterior Stone Veneer Cladding System	
	DIVISION 05 - METALS	
05 12 00	Structural Steel Framing	10-06
05 31 00	Steel Decking	11-08
05 36 00	Composite Metal Decking	12-05
05 40 00	Cold-Formed Metal Framing	05-04
05 50 00	Metal Fabrications	10-07
05 51 00	Metal Stairs	10-07
	DIVISION 06 - WOOD, PLASTICS AND COMPOSITES	
06 10 00	Rough Carpentry	10-07
06 11 50	Sheathing	

06 20 00	Finish Carpentry	05-10
	DIVISION 07 - THERMAL AND MOISTURE PROTECTION	
07 11 13	Bituminous Dampproofing	10-08
07 13 52	Modified Bituminous Sheet Waterproofing	08-08
07 21 13	Thermal Insulation	03-09
07 22 00	Roof and Deck Insulation	10-10
07 52 16.13	Styrene-Butadiene-Styrene Modified Bituminous Membrane, Roofing, Cold Applied	10-10
07 60 00	Flashing and Sheet Metal	10-10
07 71 00	Roof Specialties	10-07
07 72 00	Roof Accessories	
07 81 00	Applied Fireproofing	12-08
07 84 00	Firestopping	08-08
07 92 00	Joint Sealants	02-11
07 95 13	Expansion Joint Cover Assemblies	10-07
	DIVISION 08 - OPENINGS	
08 11 13	Hollow Metal Doors and Frames	02-09
08 21 00	Thermal Fused Flush Doors	
08 31 13	Access Doors and Frames	10-07
08 41 13	Aluminum-Framed Entrances and Storefronts	10-07
08 44 13	Glazed Aluminum Curtain Walls	08-08
08 71 00	Door Hardware	02-11
08 71 13	Automatic Door Operators	12-09
08 80 00	Glazing	12-10
08 90 00	Louvers and Vents	01-08
	DIVISION 09 - FINISHES	
09 06 00	Schedule for Finishes	09-10
09 22 16	Non-Structural Metal Framing	07-10
09 29 00	Gypsum Board	09-10
09 30 13	Ceramic Tiling	03-09
09 51 00	Acoustical Ceilings	10-10
09 65 13	Resilient Base and Accessories	04-08
09 65 16	Resilient Sheet Flooring	07-10
09 65 19	Resilient Tile Flooring	03-11
09 68 00	Carpeting	08-08
09 91 00	Painting	04-09
	DIVISION 10 - SPECIALTIES	
10 14 00	Signage	06-08
10 26 00	Wall and Door Protection	01-11
10 28 00	Toilet, Bath, and Laundry Accessories	02-08

10 44 13	Fire Extinguisher Cabinets	10-07
10 53 00	Aluminum Walkway Cover	
10 53 10	Aluminum Sunshades with Overhead Support Rod	
	DIVISION 11 - EQUIPMENT	
11 45 00	Residential Appliances	
	DIVISION 12 - FURNISHINGS	
12 24 00	Window Shades	02-08
12 32 00	Manufactured Wood Casework	11-07
12 36 00	Countertops	05-10
	DIVISION 13 - SPECIAL CONSTRUCTION (NOT USED)	
	DIVISION 14- CONVEYING EQUIPEMENT	
14 24 00	Hydraulic Elevators	09-08
	DIVISION 21- FIRE SUPPRESSION	
21 05 11	Common Work Results for Fire Suppression	11-09
21 10 00	Water-Based Fire-Suppression Systems	02-11
	DIVISION 22 - PLUMBING	
22 05 11	Common Work Results for Plumbing	12-09
22 05 12	General Motor Requirements for Plumbing Equipment	12-09
22 05 19	Meters and Gages for Plumbing Piping	02-10
22 05 23	General-Duty Valves for Plumbing Piping	12-09
22 11 00	Facility Water Distribution	10-06
22 11 23	Domestic Water Pumps	11-10
22 13 00	Facility Sanitary and Vent Piping	12-09
22 14 00	Facility Storm Drainage	12-09
22 14 29	Sump Pumps	01-11
22 35 00	Domestic Water Heat Exchangers	02-10
22 40 00	Plumbing Fixtures	03-11
	DIVISION 23 - HEATING, VENTILATING, AND AIR CONDITIONING (HVAC)	
23 05 11	Common Work Results for HVAC	11-10
23 05 12	General Motor Requirements for HVAC and Steam Generation Equipment	11-10
23 05 41	Noise and Vibration Control for HVAC Piping and Equipment	11-10
23 05 93	Testing, Adjusting, and Balancing for HVAC	12-06
23 07 11	HVAC, Plumbing, and Boiler Plant Insulation	12-06

23 08 00	Commissioning of HVAC	07-10
23 09 23	Direct-Digital Control System for HVAC	05-10
23 21 13	Hydronic Piping	03-10
23 21 23	Hydronic Pumps	02-10
23 22 13	Steam and Condensate Heating Piping	03-10
23 22 23	Steam Condensate Pumps	02-10
23 23 00	Refrigerant Piping	02-10
23 25 00	HVAC Water Treatment	02-10
23 31 00	HVAC Ducts and Casings	02-10
23 34 00	HVAC Fans	11-09
23 36 00	Air Terminal Units	03-10
23 37 00	Air Outlets and Inlets	11-09
23 40 00	HVAC Air Cleaning Devices	11-09
23 64 00	Packaged Water Chillers	02-10
23 73 00	Indoor Central-Station Air-Handling Units	03-11
23 81 00	Decentralized Unitary HVAC Equipment	02-11
23 82 00	Convection Heating and Cooling Units	09-08
23 82 16	Air Coils	04-11
	DIVISION 25 - INTEGRATED AUTOMATION	
25 10 10	Advanced Utility Metering System	02-10
	DIVISION 26 - ELECTRICAL	
26 05 11	Requirements for Electrical Installations	09-10
26 05 21	Low-Voltage Electrical Power Conductors and Cables (600 Volts and Below)	09-10
26 05 26	Grounding and Bonding for Electrical Systems	09-10
26 05 33	Raceway and Boxes for Electrical Systems	09-10
26 05 41	Underground Electrical Construction	09-10
26 05 71	Electrical System Protective Device Study	09-10
26 09 23	Lighting Controls	09-10
26 22 00	Low-Voltage Transformers	09-10
26 24 16	Panelboards	09-10
26 27 26	Wiring Devices	04-09
26 29 11	Motor Starters	09-10
26 29 21	Disconnect Switches	09-10
26 41 00	Facility Lightning Protection	04-09
26 43 13	Transient-Voltage Surge Suppression	04-09
26 51 00	Interior Lighting	04-09
26 56 00	Exterior Lighting	09-10
	DIVISION 27 - COMMUNICATIONS	
27 05 11	Requirements for Communications Installations	11-09
27 05 26	Grounding and Bonding for Communications Systems	10-06
27 05 33	Raceways and Boxes for Communications Systems	12-05
27 10 00	Structured Cabling	12-05
27 11 00	Communications Equipment Room Fittings	10-06

27 15 00	Communications Horizontal Cabling	10-06
27 31 00	Voice Communications Switching and Routing Equipment	10-06
27 51 23	Intercommunications and Program Systems	02-09
27 52 23	Nurse Call Systems	01-10
27 52 31	Security Emergency Call, Duress Alarm, and Telecommunications	02-09
	DIVISION 28 - ELECTRONIC SAFETY AND SECURITY	
28 05 11	Requirements for Electronic Safety and Security Installations	11-09
28 05 13	Conductors and Cables For Electronic Safety and Security	
28 05 26	Grounding and Bonding for Electronic Safety and Security	10-06
28 05 33	Raceways and Boxes for Electronic Safety and Security	12-05
28 13 11	Physical Access Control Systems	11-09
28 13 16	Access Control System and Database Management	11-09
28 13 53	Security Access Detection	11-09
28 16 11	Intrusion Detection System	11-09
28 23 00	Video Surveillance	11-09
28 26 00	Electronic Personal Protection System	11-09
28 31 00	Fire Detection and Alarm	09-05
	DIVISION 31 - EARTHWORK	
31 20 00	Earth Moving	10-06
31 23 19	Dewatering	
	DIVISION 32 - EXTERIOR IMPROVEMENTS	
32 05 23	Cement and Concrete for Exterior Improvements	04-10
32 12 16	Asphalt Paving	10-07
32 17 23	Pavement Markings	
32 31 53	Perimeter Security Fences and Gates	
32 32 23	Segmental Retaining Walls	
32 90 00	Planting	09-08
	DIVISION 33 - UTILITIES	
33 10 00	Water Utilities	12-05
33 30 00	Sanitary Sewerage Utilities	10-06
33 40 00	Storm Drainage Utilities	11-05
	DIVISION 34 - TRANSPORTATION (NOT USED)	

SECTION 00 01 15
LIST OF DRAWING SHEETS

The drawings listed below accompanying this specification form a part of
the contract.

<u>Drawing No.</u>	<u>Title</u>
TI	COVER SHEET
	CIVIL
C001	TITLE SHEET
C002	GENERAL NOTES
C101	EXISTING CONDITIONS
C201	SITE DEMOLITION PLAN
C301	SITE LAYOUT AND UTILITY PLAN
C302	UTILITY PROFILES
C401	GRADING AND DRAINAGE PLAN
C501	EROSION AND SEDIMENT CONTROL PLAN
C601	LANDSCAPE PLAN
C701	EROSION CONTROL DETAILS
C702	SITE DETAILS 1
C703	SITE DETAILS 2
	ARCHITECTURAL
A0.0	ARCHITECTURAL SYMBOLS, ABBREVIATIONS, AND PROJECT DATA
A0.1	FIRE PROTECTION PLAN - PARTIAL EXISTING
BUILDING	
A0.2	FIRE PROTECTION PLANS - NEW BUILDING
AD1.1	DEMOLITION PLAN AND NOTES
A1.1	GROUND FLOOR PLAN
A1.2	FIRST FLOOR PLAN
A1.3	ROOF PLAN AND DETAILS
A1.4	GROUND FLOOR DIMENSION PLAN
A1.5	FIRST FLOOR DIMENSION PLAN
A2.1	ENLARGED PLANS AND SCHEDULE
A2.2	CANAOPY PLANS
A3.1	REFLECTED CEILING PLAN - GROUND FLOOR
A3.2	REFLECTED CEILING PLAN -FIRST FLOOR
A4.1	DOOR SCHEDULE, PARTITION TYPES DOOR AND WINDOW DETAILS
A4.2	DOOR AND LOUVER DETAILS
A5.1	EXTERIOR ELEVATIONS
A5.2	EXTERIOR ELEVATIONS
A5.3	BUILDING SECTIONS
A6.1	WALL SECTIONS
A6.2	WALL SECTIONS
A6.3	WALL SECTIONS
A6.4	WALL SECTIONS
A7.1	ENLARGED INTERIOR DETAILS
A7.2	INTERIOR ELEVATIONS AND DETAILS
A8.1	STAIR AND ELEVATOR PLANS AND SECTIONS
A8.2	STAIR AND ELEVATOR DETAILS
A8.3	SECTION DETAILS

INTERIORS

I1.2 FIRST FLOOR FINISH PLAN

STRUCTURAL

S0.1 GENERAL NOTES, TYPICAL DETAILS AND SCHEDULES
 S0.2 TYPICAL DETAILS AND SCHEDULES
 S0.3 TYPICAL DETAILS AND SCHEDULES
 S0.4 TYPICAL DETAILS AND SCHEDULES
 S0.5 TYPICAL DETAILS AND SCHEDULES
 S1.1 FOUNDATION PLAN
 S1.2 FIRST FLOOR FOUNDATION AND FRAMING PLAN
 S1.3 ROOF FRAMING PLAN
 S2.1 FOUNDATION SECTIONS AND DETAILS
 S3.1 FRAMING SECTIONS AND DETAILS
 S3.2 FRAMING SECTIONS AND DETAILS
 S3.3 FRAMING SECTIONS AND DETAILS
 S4.1 BRACED FRAME ELEVATIONS AND DETAILS
 S5.1 GEOTECHNICAL BORING PLAN AND LOG DIAGRAMS

PLUMBING

P0.0 PLUMBING LEGEND, FIXTURE SCHEDULE, NOTES &
 STANDARD DETAILS
 P1.1 GROUND FLOOR PLAN - PLUMBING
 P1.2 FIRST FLOOR PLAN - PLUMBING
 P1.3 ROOF PLAN - PLUMBING

MECHANICAL

M0.1 LEGEND, ABBREVIATIONS AND EQUIPMENT SCHEDULES -
 HVAC
 M1.1 GROUND FLOOR PLAN - HVAC
 M1.1P GROUND FLOOR PLAN - HVAC PIPING
 M1.2 FIRST FLOOR PLAN - HVAC
 M1.2P FIRST FLOOR PLAN - HVAC PIPING
 M2.1 ENLARGED MECHANICAL ROOM PLAN - HVAC
 M3.1 DETAILS - HVAC
 M3.2 DETAILS - HVAC
 M4.1 ELECTRIC SEQUENCE CONTROLS
 M4.2 AUTOMATIC TEMPERATURE CONTROLS

ELECTRICAL

E0.1 ELECTRICAL SYMBOL LEGEND, ABBREVIATIONS,
 LUMINAIRE SCHEDULE AND MISC. DETAILS
 E0.2 ELECTRICAL SITE PLAN
 E1.1 GROUND FLOOR PLAN - LIGHTING
 E1.2 FIRST FLOOR PLAN - LIGHTING
 E2.1 GROUND FLOOR PLAN - POWER
 E2.2 FIRST FLOOR PLAN - POWER
 E4.1 ELECTRICAL RISER DIAGRAMS
 E5.1 PANELBOARD & TRANSFORMER SCHEDULES

- - - E N D - - -

SECTION 01 00 00
GENERAL REQUIREMENTS

TABLE OF CONTENTS

1.1 GENERAL INTENTION..... 1

1.2 STATEMENT OF BID ITEM(S)..... 2

1.3 SPECIFICATIONS AND DRAWINGS FOR CONTRACTOR..... 3

1.4 CONSTRUCTION SECURITY REQUIREMENTS..... 3

1.5 FIRE SAFETY..... 4

1.6 OPERATIONS AND STORAGE AREAS..... 6

1.7 ALTERATIONS..... 10

1.8 INFECTION PREVENTION MEASURES..... 11

1.9 DISPOSAL AND RETENTION..... 12

1.10 PROTECTION OF EXISTING VEGETATION, STRUCTURES, EQUIPMENT,
UTILITIES, AND IMPROVEMENTS..... 13

1.11 RESTORATION..... 14

1.12 PHYSICAL DATA..... 15

1.13 PROFESSIONAL SURVEYING SERVICES..... 16

1.14 LAYOUT OF WORK..... 16

1.15 AS-BUILT DRAWINGS..... 17

1.16 USE OF ROADWAYS..... 18

1.17 TEMPORARY USE OF MECHANICAL AND ELECTRICAL EQUIPMENT..... 18

1.18 TEMPORARY USE OF NEW ELEVATORS..... 19

1.19 TEMPORARY TOILETS..... 20

1.20 AVAILABILITY AND USE OF UTILITY SERVICES..... 20

1.21 NEW TELEPHONE EQUIPMENT..... 22

1.22 TESTS..... 22

1.23 INSTRUCTIONS..... 22

1.24 CONSTRUCTION SIGN..... 23

1.25 SAFETY SIGN..... 24

1.26 HISTORIC PRESERVATION..... 24

**SECTION 01 00 00
GENERAL REQUIREMENTS**

1.1 GENERAL INTENTION

- A. Contractor shall completely prepare site for building operations, including demolition and removal of existing structures, and furnish labor and materials and perform work for Adult Day Care Building as required by drawings and specifications.
- B. Offices of SFCS Inc., as Architect-Engineers, will render certain technical services during construction. Such services shall be considered as advisory to the Government and shall not be construed as expressing or implying a contractual act of the Government without affirmations by Contracting Officer or his duly authorized representative.
- C. Before placement and installation of work subject to tests by testing laboratory retained by Department of Veterans Affairs, the Contractor shall notify the Contracting Officer's Technical Representative (COTR) in sufficient time to enable testing laboratory personnel to be present at the site in time for proper taking and testing of specimens and field inspection. Such prior notice shall be not less than three work days unless otherwise designated by the COTR.
- D. All employees of general contractor and subcontractors shall comply with VA security management program and obtain permission of the VA police, be identified by project and employer, and restricted from unauthorized access.
- E. Prior to commencing work, general contractor shall provide proof that a OSHA certified "competent person" (CP) (29 CFR 1926.20(b)(2)) will maintain a presence at the work site whenever the general or subcontractors are present.
- F. Training:
 - 1. All employees of general contractor or subcontractors shall have the 10-hour OSHA certified Construction Safety course and /or other relevant competency training, as determined by VA CP with input from the ICRA team.
 - 2. Submit training records of all such employees for approval before the start of work.

1.2 STATEMENT OF BID ITEM(S)

- A. **BID ITEM I, (BASE BID):** The Contractor shall furnish all labor, materials, tools, equipment, transportation, and qualified supervision necessary to construct a two story adult day care building with associated memory garden. Work includes general construction, alterations, roads, walks, grading, drainage, mechanical and electrical work, utility systems, elevators, selective demolition and certain other items. All work, including final cleanup and completion of any punch list items, shall be performed within four hundred twenty (420) calendar days of receipt of the Notice to Proceed.
- B. **BID ITEM II (DEDUCT BID ALTERNATE NO. 1):** Perform all work as described in **BID ITEM I (Base Bid)** above, except **DELETE** all work indicated as Alternate 1 on the Drawings. Work deleted in this Alternate includes all work associated with installing asphalt paving at lower service drive and installing 4.5 inches of stone over the required 8 inch stone base as indicated on the civil drawings. All remaining work, including final cleanup and completion of any punch list items, shall be performed within three hundred seventy-five (375) calendar days of receipt of the Notice to Proceed.
- C. **BID ITEM III (DEDUCT BID ALTERNATE NO. 2):** Perform all work as described in **BID ITEM II (DEDUCT BID ALTERNATE NO. 1)** above except **DELETE** all work indicated as Alternate 2 on the Drawings. Work deleted in this Alternate includes all work associated with installing furring and drywall on north and east concrete and masonry walls and all floor, wall and ceiling finishes at CWT-Workshop C111. All remaining work, including final cleanup and completion of any punchlist items, shall be performed within three hundred thirty (330) calendar days of receipt of the Notice to Proceed.
- D. **BID ITEM IV (DEDUCT BID ALTERNATE NO. 3):** Perform all work as described in **BID ITEM III (DEDUCT BID ALTERNATE NO. 2)** above except **DELETE** all work indicated as Alternate 3 on the Drawings. Work deleted in this Alternate includes all work associated with installing sheet vinyl floor patterns as indicated on Drawing No. I1.2. All remaining work, including final cleanup and completion of any punch list items, shall be performed within two hundred eighty five (285) calendar days of receipt of the Notice to Proceed.

1.3 SPECIFICATIONS AND DRAWINGS FOR CONTRACTOR

- A. Additional sets of drawings may be made by the Contractor, at Contractor's expense, from reproducible sepia prints furnished by Issuing Office. Such sepia prints shall be returned to the Issuing Office immediately after printing is completed.

1.4 CONSTRUCTION SECURITY REQUIREMENTS

A. Security Plan:

1. The security plan defines both physical and administrative security procedures that will remain effective for the entire duration of the project.
2. The General Contractor is responsible for assuring that all sub-contractors working on the project and their employees also comply with these regulations.

B. Security Procedures:

1. General Contractor's employees shall not enter the project site without appropriate badge. They may also be subject to inspection of their personal effects when entering or leaving the project site.
2. For working outside the "regular hours" as defined in the contract, The General Contractor shall give 3 days notice to the Contracting Officer so that security arrangements can be provided for the employees. This notice is separate from any notices required for utility shutdown described later in this section.
3. No photography of VA premises is allowed without written permission of the Contracting Officer.
4. VA reserves the right to close down or shut down the project site and order General Contractor's employees off the premises in the event of a national emergency. The General Contractor may return to the site only with the written approval of the Contracting Officer.

C. Key Control:

1. The General Contractor shall provide duplicate keys and lock combinations to the COTR for the purpose of security inspections of every area of project including tool boxes and parked machines and take any emergency action.
2. The General Contractor shall turn over all permanent lock cylinders to the VA locksmith for permanent installation. See Section 08 71 00, DOOR HARDWARE and coordinate.

D. Document Control:

1. Before starting any work, the General Contractor/Sub Contractors shall submit an electronic security memorandum describing the approach to following goals and maintaining confidentiality of "sensitive information".
2. The General Contractor is responsible for safekeeping of all drawings, project manual and other project information. This information shall be shared only with those with a specific need to accomplish the project.
3. All electronic information shall be stored in specified location following VA standards and procedures using an Engineering Document Management Software (EDMS).
 - a. Security, access and maintenance of all project drawings, both scanned and electronic shall be performed and tracked through the EDMS system.

E. Motor Vehicle Restrictions

1. Separate permits shall be issued for General Contractor and its employees for parking in designated areas only.

1.5 FIRE SAFETY

A. Applicable Publications: Publications listed below form part of this Article to extent referenced. Publications are referenced in text by basic designations only.

1. American Society for Testing and Materials (ASTM):
 - E84-2009.....Surface Burning Characteristics of Building Materials
2. National Fire Protection Association (NFPA):
 - 10-2010.....Standard for Portable Fire Extinguishers
 - 30-2008.....Flammable and Combustible Liquids Code
 - 51B-2009.....Standard for Fire Prevention During Welding, Cutting and Other Hot Work
 - 70-2011.....National Electrical Code
 - 241-2009.....Standard for Safeguarding Construction, Alteration, and Demolition Operations
3. Occupational Safety and Health Administration (OSHA):
 - 29 CFR 1926.....Safety and Health Regulations for Construction

B. Fire Safety Plan: Establish and maintain a fire protection program in accordance with 29 CFR 1926. Prior to start of work, prepare a plan detailing project-specific fire safety measures, including periodic

status reports, and submit to COTR for review for compliance with contract requirements in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA AND SAMPLES Prior to any worker for the contractor or subcontractors beginning work, they shall undergo a safety briefing provided by the general contractor's competent person per OSHA requirements. This briefing shall include information on the construction limits, VAMC safety guidelines, means of egress, break areas, work hours, locations of restrooms, use of VAMC equipment, etc. Documentation shall be provided to the COTR that individuals have undergone contractor's safety briefing.

- C. Site and Building Access: Maintain free and unobstructed access to facility emergency services and for fire, police and other emergency response forces in accordance with NFPA 241.
- D. Separate temporary facilities, such as trailers, storage sheds, and dumpsters, from existing buildings and new construction by distances in accordance with NFPA 241. For small facilities with less than 6 m (20 feet) exposing overall length, separate by 3m (10 feet).
- E. Temporary Construction Partitions:
 - 1. Install and maintain temporary construction partitions to provide smoke-tight separations between construction areas and adjoining areas. Construct partitions of gypsum board or treated plywood (flame spread rating of 25 or less in accordance with ASTM E84) on both sides of fire retardant treated wood or metal steel studs. Extend the partitions through suspended ceilings to floor slab deck or roof. Seal joints and penetrations. At door openings, install Class C, ¾ hour fire/smoke rated doors with self-closing devices.
 - 2. Install one-hour fire-rated temporary construction partitions as shown on drawings to maintain integrity of existing exit passageways.
 - 3. Close openings in smoke barriers and fire-rated construction to maintain fire ratings. Seal penetrations with listed through-penetration firestop materials in accordance with Section 07 84 00, FIRESTOPPING.
- F. Means of Egress: Do not block exiting for occupied buildings, including paths from exits to roads. Minimize disruptions and coordinate with COTR.

- G. Egress Routes for Construction Workers: Maintain free and unobstructed egress. Inspect daily. Report findings and corrective actions weekly to Project Manager.
- H. Fire Extinguishers: Provide and maintain extinguishers in construction areas and temporary storage areas in accordance with 29 CFR 1926, NFPA 241 and NFPA 10.
- I. Flammable and Combustible Liquids: Store, dispense and use liquids in accordance with 29 CFR 1926, NFPA 241 and NFPA 30.
- J. Existing Fire Protection: Do not impair automatic sprinklers, smoke and heat detection, and fire alarm systems, except for portions immediately under construction, and temporarily for connections. Provide fire watch for impairments more than 4 hours in a 24-hour period. Request interruptions in accordance with Article, OPERATIONS AND STORAGE AREAS, and coordinate with Project Manager. All existing or temporary fire protection systems (fire alarms, sprinklers) located in construction areas shall be tested as coordinated with the medical center. Parameters for the testing and results of any tests performed shall be recorded by the medical center and copies provided to the COTR.
- K. Smoke Detectors: Prevent accidental operation. Remove temporary covers at end of work operations each day. Coordinate with Project Manager.
- L. Hot Work: Perform and safeguard hot work operations in accordance with NFPA 241 and NFPA 51B. Obtain permits from facility Safety Manager at least 24 hours in advance.
- M. Fire Hazard Prevention and Safety Inspections: Inspect entire construction areas weekly. Coordinate with, and report findings and corrective actions weekly to Project Engineer and facility Safety Manager.
- N. Smoking: Smoking is prohibited in and adjacent to construction areas inside existing buildings and additions under construction. In separate and detached buildings under construction, smoking is prohibited except in designated smoking rest areas.
- O. Dispose of waste and debris in accordance with NFPA 241. Remove from buildings daily.
- P. Perform other construction, alteration and demolition operations in accordance with 29 CFR 1926.

1.6 OPERATIONS AND STORAGE AREAS

- A. The Contractor shall confine all operations (including storage of materials) on Government premises to areas authorized or approved by

the Contracting Officer. The Contractor shall hold and save the Government, its officers and agents, free and harmless from liability of any nature occasioned by the Contractor's performance.

- B. Temporary buildings (e.g., storage sheds, shops, offices) and utilities may be erected by the Contractor only with the approval of the Contracting Officer and shall be built with labor and materials furnished by the Contractor without expense to the Government. The temporary buildings and utilities shall remain the property of the Contractor and shall be removed by the Contractor at its expense upon completion of the work. With the written consent of the Contracting Officer, the buildings and utilities may be abandoned and need not be removed.
- C. The Contractor shall, under regulations prescribed by the Contracting Officer, use only established roadways, or use temporary roadways constructed by the Contractor when and as authorized by the Contracting Officer. When materials are transported in prosecuting the work, vehicles shall not be loaded beyond the loading capacity recommended by the manufacturer of the vehicle or prescribed by any Federal, State, or local law or regulation. When it is necessary to cross curbs or sidewalks, the Contractor shall protect them from damage. The Contractor shall repair or pay for the repair of any damaged curbs, sidewalks, or roads.

(FAR 52.236-10)

- D. Working space and space available for storing materials shall be as determined by the COTR.
- E. Execute work in such a manner as to interfere as little as possible with work being done by others. Keep roads clear of construction materials, debris, standing construction equipment and vehicles at all times.
- F. Execute work so as to interfere as little as possible with normal functioning of Medical Center as a whole, including operations of utility services, fire protection systems and any existing equipment, and with work being done by others. Use of equipment and tools that transmit vibrations and noises through the building structure, are not permitted in buildings that are occupied, during construction, jointly by patients or medical personnel, and Contractor's personnel, except as permitted by COTR where required by limited working space.
 - 1. Do not store materials and equipment in other than assigned areas.

2. Schedule delivery of materials and equipment to immediate construction working areas within buildings in use by Department of Veterans Affairs in quantities sufficient for not more than two work days. Provide unobstructed access to Medical Center areas required to remain in operation.
 3. Where access by Medical Center personnel to vacated portions of buildings is not required, storage of Contractor's materials and equipment will be permitted subject to fire and safety requirements.
- G. Utilities Services: Where necessary to cut existing pipes, electrical wires, conduits, cables, etc., of utility services, or of fire protection systems or communications systems (except telephone), they shall be cut and capped at suitable places where shown; or, in absence of such indication, where directed by COTR. All such actions shall be coordinated with the Utility Company involved:
1. Whenever it is required that a connection fee be paid to a public utility provider for new permanent service to the construction project, for such items as water, sewer, electricity, gas or steam, payment of such fee shall be the responsibility of the Government and not the Contractor.
- H. Building No.1 will be occupied during performance of work.
- Contractor shall take all measures and provide all material necessary for protecting existing equipment and property in affected areas of construction against dust and debris, so that equipment and affected areas to be used in the Medical Centers operations will not be hindered. Contractor shall permit access to Department of Veterans Affairs personnel and patients through other construction areas which serve as routes of access to such affected areas and equipment. Coordinate alteration work in areas occupied by Department of Veterans Affairs so that Medical Center operations will continue during the construction period.
- I. Construction Fence: Before construction operations begin, Contractor shall provide a chain link construction fence, 2.1m (seven feet) minimum height, around the construction area indicated on the drawings. Provide gates as required for access with necessary hardware, including hasps and padlocks. Fasten fence fabric to terminal posts with tension bands and to line posts and top and bottom rails with tie wires spaced at maximum 375mm (15 inches). Bottom of fences shall extend to 25mm (one inch) above grade. Remove the fence when directed by COTR.

- J. Utilities Services: Maintain existing utility services for Medical Center at all times. Provide temporary facilities, labor, materials, equipment, connections, and utilities to assure uninterrupted services. Where necessary to cut existing water, steam, gases, sewer or air pipes, or conduits, wires, cables, etc. of utility services or of fire protection systems and communications systems (including telephone), they shall be cut and capped at suitable places where shown; or, in absence of such indication, where directed by COTR.
1. No utility service such as water, gas, steam, sewers or electricity, or fire protection systems and communications systems may be interrupted without prior approval of COTR. Electrical work shall be accomplished with all affected circuits or equipment de-energized. When an electrical outage cannot be accomplished, work on any energized circuits or equipment shall not commence without the Medical Center Director's prior knowledge and written approval. Refer to specification Sections 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS, 27 05 11 REQUIREMENTS FOR COMMUNICATIONS INSTALLATIONS and 28 05 11, REQUIREMENTS FOR ELECTRONIC SAFETY AND SECURITY INSTALLATIONS for additional requirements.
 2. Contractor shall submit a request to interrupt any such services to COTR, in writing, 48 hours in advance of proposed interruption. Request shall state reason, date, exact time of, and approximate duration of such interruption.
 3. Contractor will be advised (in writing) of approval of request, or of which other date and/or time such interruption will cause least inconvenience to operations of Medical Center. Interruption time approved by Medical Center may occur at other than Contractor's normal working hours.
 4. Major interruptions of any system must be requested, in writing, at least 15 calendar days prior to the desired time and shall be performed as directed by the COTR.
 5. In case of a contract construction emergency, service will be interrupted on approval of COTR. Such approval will be confirmed in writing as soon as practical.
 6. Whenever it is required that a connection fee be paid to a public utility provider for new permanent service to the construction project, for such items as water, sewer, electricity, gas or steam,

payment of such fee shall be the responsibility of the Government and not the Contractor.

- K. Abandoned Lines: All service lines such as wires, cables, conduits, ducts, pipes and the like, and their hangers or supports, which are to be abandoned but are not required to be entirely removed, shall be sealed, capped or plugged. The lines shall not be capped in finished areas, but shall be removed and sealed, capped or plugged in ceilings, within furred spaces, in unfinished areas, or within walls or partitions; so that they are completely behind the finished surfaces.
- L. To minimize interference of construction activities with flow of Medical Center traffic, comply with the following:
 - 1. Keep roads, walks and entrances to grounds, to parking and to occupied areas of buildings clear of construction materials, debris and standing construction equipment and vehicles.
 - 2. Method and scheduling of required cutting, altering and removal of existing roads, walks and entrances must be approved by the COTR.
- M. Coordinate the work for this contract with other construction operations as directed by COTR. This includes the scheduling of traffic and the use of roadways, as specified in Article, USE OF ROADWAYS.

1.7 ALTERATIONS

- A. Survey: Before any work is started, the Contractor shall make a thorough survey with the COTR of areas of buildings in which alterations occur and areas which are anticipated routes of access, and furnish a report, signed by both, to the Contracting Officer. This report shall list by rooms and spaces:
 - 1. Existing condition and types of resilient flooring, doors, windows, walls and other surfaces not required to be altered throughout affected areas of building.
- B. Protection: Provide the following protective measures:
 - 1. Wherever existing roof surfaces are disturbed they shall be protected against water infiltration. In case of leaks, they shall be repaired immediately upon discovery.
 - 2. Temporary protection against damage for portions of existing structures and grounds where work is to be done, materials handled and equipment moved and/or relocated.
 - 3. Protection of interior of existing structures at all times, from damage, dust and weather inclemency. Wherever work is performed, floor surfaces that are to remain in place shall be adequately

protected prior to starting work, and this protection shall be maintained intact until all work in the area is completed.

1.8 INFECTION PREVENTION MEASURES

- A. Implement the requirements of VAMC's Infection Control Risk Assessment (ICRA) team. ICRA Group may monitor dust in the vicinity of the construction work and require the Contractor to take corrective action immediately if the safe levels are exceeded.
- B. Establish and maintain a dust control program as part of the contractor's infection preventive measures in accordance with the guidelines provided by as specified here. Prior to start of work, prepare a plan detailing project-specific dust protection measures, including periodic status reports, and submit to Resident Project Engineer and Facility ICRA team for review for compliance with contract requirements in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA AND SAMPLES.
 - 1. All personnel involved in the construction or renovation activity shall be educated and trained in infection prevention measures established by the medical center.
- C. Medical center Infection Control personnel shall monitor for airborne disease (e.g. aspergillosis) as appropriate during construction. A baseline of conditions may be established by the medical center prior to the start of work and periodically during the construction stage to determine impact of construction activities on indoor air quality.
- D. In general, following preventive measures shall be adopted during construction to keep down dust and prevent mold.
 - 1. Dampen debris to keep down dust and provide temporary construction partitions in existing structures where directed by COTR. Blank off ducts and diffusers to prevent circulation of dust into occupied areas during construction.
 - 2. Do not perform dust producing tasks within occupied areas without the approval of the COTR. For construction in any areas that will remain jointly occupied by the medical Center and Contractor's workers, the Contractor shall:
 - a. Adhesive Walk-off/Carpet Walk-off Mats, minimum 600mm x 900mm (24" x 36"), shall be used at all interior transitions from the construction area to occupied medical center area. These mats shall be changed as often as required to maintain clean work areas directly outside construction area at all times.

- b. Vacuum and wet mop all transition areas from construction to the occupied medical center at the end of each workday. Vacuum shall utilize HEPA filtration. Maintain surrounding area frequently. Remove debris as they are created. Transport these outside the construction area in containers with tightly fitting lids.
- c. The contractor shall not haul debris through patient-care areas without prior approval of the COTR and the Medical Center. When, approved, debris shall be hauled in enclosed dust proof containers or wrapped in plastic and sealed with duct tape. No sharp objects should be allowed to cut through the plastic. Wipe down the exterior of the containers with a damp rag to remove dust. All equipment, tools, material, etc. transported through occupied areas shall be made free from dust and moisture by vacuuming and wipe down.
- d. There shall be no standing water during construction. This includes water in equipment drip pans and open containers within the construction areas. All accidental spills must be cleaned up and dried within 12 hours. Remove and dispose of porous materials that remain damp for more than 72 hours.
- e. At completion, remove construction barriers and ceiling protection carefully, outside of normal work hours. Vacuum and clean all surfaces free of dust after the removal.

E. Final Cleanup:

- 1. Upon completion of project, or as work progresses, remove all construction debris from above ceiling, vertical shafts and utility chases that have been part of the construction.
- 2. Perform HEPA vacuum cleaning of all surfaces in the construction area. This includes walls, ceilings, cabinets, furniture (built-in or free standing), partitions, flooring, etc.
- 3. All new air ducts shall be cleaned prior to final inspection.

1.9 DISPOSAL AND RETENTION

- A. Materials and equipment accruing from work removed and from demolition of buildings or structures, or parts thereof, shall be disposed of as follows:
 - 1. Reserved items which are to remain property of the Government are identified by attached tags as items to be stored. Items that remain property of the Government shall be removed or dislodged from present locations in such a manner as to prevent damage which would

be detrimental to re-installation and reuse. Store such items where directed by COTR.

2. Items not reserved shall become property of the Contractor and be removed by Contractor from Medical Center.
3. Items of portable equipment and furnishings located in rooms and spaces in which work is to be done under this contract shall remain the property of the Government. When rooms and spaces are vacated by the Department of Veterans Affairs during the alteration period, such items which are NOT required by drawings and specifications to be either relocated or reused will be removed by the Government in advance of work to avoid interfering with Contractor's operation.

1.10 PROTECTION OF EXISTING VEGETATION, STRUCTURES, EQUIPMENT, UTILITIES, AND IMPROVEMENTS

- A. The Contractor shall preserve and protect all structures, equipment, and vegetation (such as trees, shrubs, and grass) on or adjacent to the work site, which are not to be removed and which do not unreasonably interfere with the work required under this contract. The Contractor shall only remove trees when specifically authorized to do so, and shall avoid damaging vegetation that will remain in place. If any limbs or branches of trees are broken during contract performance, or by the careless operation of equipment, or by workmen, the Contractor shall trim those limbs or branches with a clean cut and paint the cut with a tree-pruning compound as directed by the Contracting Officer.
- B. The Contractor shall protect from damage all existing improvements and utilities at or near the work site and on adjacent property of a third party, the locations of which are made known to or should be known by the Contractor. The Contractor shall repair any damage to those facilities, including those that are the property of a third party, resulting from failure to comply with the requirements of this contract or failure to exercise reasonable care in performing the work. If the Contractor fails or refuses to repair the damage promptly, the Contracting Officer may have the necessary work performed and charge the cost to the Contractor.

(FAR 52.236-9)

- C. Refer to Section 01 57 19, TEMPORARY ENVIRONMENTAL CONTROLS, for additional requirements on protecting vegetation, soils and the environment. Refer to Articles, "Alterations", "Restoration", and

"Operations and Storage Areas" for additional instructions concerning repair of damage to structures and site improvements.

- D. Refer to FAR clause 52.236-7, "Permits and Responsibilities," which is included in General Conditions. A National Pollutant Discharge Elimination System (NPDES) permit is required for this project. The Contractor is considered an "operator" under the permit and has extensive responsibility for compliance with permit requirements. VA will make the permit application available at the (appropriate medical center) office. The apparent low bidder, contractor and affected subcontractors shall furnish all information and certifications that are required to comply with the permit process and permit requirements. Many of the permit requirements will be satisfied by completing construction as shown and specified. Some requirements involve the Contractor's method of operations and operations planning and the Contractor is responsible for employing best management practices. The affected activities often include, but are not limited to the following:
- Designating areas for equipment maintenance and repair;
 - Providing waste receptacles at convenient locations and provide regular collection of wastes;
 - Locating equipment wash down areas on site, and provide appropriate control of wash-waters;
 - Providing protected storage areas for chemicals, paints, solvents, fertilizers, and other potentially toxic materials; and
 - Providing adequately maintained sanitary facilities.

1.11 RESTORATION

- A. Remove, cut, alter, replace, patch and repair existing work as necessary to install new work. Except as otherwise shown or specified, do not cut, alter or remove any structural work, and do not disturb any ducts, plumbing, steam, gas, or electric work without approval of the COTR. Existing work to be altered or extended and that is found to be defective in any way, shall be reported to the COTR before it is disturbed. Materials and workmanship used in restoring work, shall conform in type and quality to that of original existing construction, except as otherwise shown or specified.
- B. Upon completion of contract, deliver work complete and undamaged. Existing work (walls, ceilings, partitions, floors, mechanical and electrical work, lawns, paving, roads, walks, etc.) disturbed or

removed as a result of performing required new work, shall be patched, repaired, reinstalled, or replaced with new work, and refinished and left in as good condition as existed before commencing work.

- C. At Contractor's own expense, Contractor shall immediately restore to service and repair any damage caused by Contractor's workmen to existing piping and conduits, wires, cables, etc., of utility services or of fire protection systems and communications systems (including telephone) which are indicated on drawings and which are not scheduled for discontinuance or abandonment.
- D. Expense of repairs to such utilities and systems not shown on drawings or locations of which are unknown will be covered by adjustment to contract time and price in accordance with clause entitled "CHANGES" (FAR 52.243-4 and VAAR 852.236-88) and "DIFFERING SITE CONDITIONS" (FAR 52.236-2).

1.12 PHYSICAL DATA

- A. Data and information furnished or referred to below is for the Contractor's information. The Government shall not be responsible for any interpretation of or conclusion drawn from the data or information by the Contractor.
 - 1. The indications of physical conditions on the drawings and in the specifications are the result of site investigations by Froehling & Robertson Inc.

(FAR 52.236-4)

- B. Subsurface conditions have been developed by core borings.
- C. A copy of the Report of Subsurface Exploration and Geotechnical Engineering Evaluation (December 2012) as prepared by Froehling & Robertson, Inc. will be made available for inspection by bidders upon request to the Engineering Officer at the VA Medical Center, Beckley, West Virginia and shall be considered part of the contract documents.
- D. Government does not guarantee that other materials will not be encountered nor that proportions, conditions or character of several materials will not vary from those indicated by explorations. Bidders are expected to examine site of work and logs of borings; and, after investigation, decide for themselves character of materials and make their bids accordingly. Upon proper application to Department of Veterans Affairs, bidders will be permitted to make subsurface explorations of their own at site.

1.13 PROFESSIONAL SURVEYING SERVICES

A registered professional land surveyor or registered civil engineer whose services are retained and paid for by the Contractor shall perform services specified herein and in other specification sections. The Contractor shall certify that the land surveyor or civil engineer is not one who is a regular employee of the Contractor, and that the land surveyor or civil engineer has no financial interest in this contract.

1.14 LAYOUT OF WORK

- A. The Contractor shall lay out the work from Government established base lines and bench marks, indicated on the drawings, and shall be responsible for all measurements in connection with the layout. The Contractor shall furnish, at Contractor's own expense, all stakes, templates, platforms, equipment, tools, materials, and labor required to lay out any part of the work. The Contractor shall be responsible for executing the work to the lines and grades that may be established or indicated by the Contracting Officer. The Contractor shall also be responsible for maintaining and preserving all stakes and other marks established by the Contracting Officer until authorized to remove them. If such marks are destroyed by the Contractor or through Contractor's negligence before their removal is authorized, the Contracting Officer may replace them and deduct the expense of the replacement from any amounts due or to become due to the Contractor.

(FAR 52.236-17)

- B. Establish and plainly mark center lines for each building and/or addition to each existing building, and such other lines and grades that are reasonably necessary to properly assure that location, orientation, and elevations established for each such structure and/or addition, roads, parking lots, are in accordance with lines and elevations shown on contract drawings.
- C. Following completion of general mass excavation and before any other permanent work is performed, establish and plainly mark (through use of appropriate batter boards or other means) sufficient additional survey control points or system of points as may be necessary to assure proper alignment, orientation, and grade of all major features of work. Survey shall include, but not be limited to, location of lines and grades of footings, exterior walls, center lines of columns in both directions, major utilities and elevations of floor slabs:

1. Such additional survey control points or system of points thus established shall be checked and certified by a registered land surveyor or registered civil engineer. Furnish such certification to the COTR before any work (such as footings, floor slabs, columns, walls, utilities and other major controlling features) is placed.
- D. During progress of work, and particularly as work progresses from floor to floor, Contractor shall have line grades and plumbness of all major form work checked and certified by a registered land surveyor or registered civil engineer as meeting requirements of contract drawings. Furnish such certification to the COTR before any major items of concrete work are placed. In addition, Contractor shall also furnish to the COTR certificates from a registered land surveyor or registered civil engineer that the following work is complete in every respect as required by contract drawings.
 1. Lines of each building and/or addition.
 2. Elevations of bottoms of footings and tops of floors of each building and/or addition.
 3. Lines and elevations of sewers and of all outside distribution systems.
- E. Whenever changes from contract drawings are made in line or grading requiring certificates, record such changes on a reproducible drawing bearing the registered land surveyor or registered civil engineer seal, and forward these drawings upon completion of work to COTR.
- F. The Contractor shall perform the surveying and layout work of this and other articles and specifications in accordance with the provisions of Article "Professional Surveying Services".

1.15 AS-BUILT DRAWINGS

- A. The contractor shall maintain two full size sets of as-built drawings which will be kept current during construction of the project, to include all contract changes, modifications and clarifications.
- B. All variations shall be shown in the same general detail as used in the contract drawings. To insure compliance, as-built drawings shall be made available for the COTR 's review, as often as requested.
- C. Contractor shall deliver two approved completed sets of as-built drawings to the COTR within 15 calendar days after each completed phase and after the acceptance of the project by the COTR.
- D. Paragraphs A, B, & C shall also apply to all shop drawings.

1.16 USE OF ROADWAYS

- A. For hauling, use only established public roads and roads on Medical Center property and, when authorized by the COTR, such temporary roads which are necessary in the performance of contract work. Temporary roads shall be constructed by the Contractor at Contractor's expense. When necessary to cross curbing, sidewalks, or similar construction, they must be protected by well-constructed bridges.
- B. When new permanent roads are to be a part of this contract, Contractor may construct them immediately for use to facilitate building operations. These roads may be used by all who have business thereon within zone of building operations.
- C. When certain buildings (or parts of certain buildings) are required to be completed in advance of general date of completion, all roads leading thereto must be completed and available for use at time set for completion of such buildings or parts thereof.

1.17 TEMPORARY USE OF MECHANICAL AND ELECTRICAL EQUIPMENT

- A. Use of new installed mechanical and electrical equipment to provide heat, ventilation, plumbing, light and power will be permitted subject to compliance with the following provisions:
 - 1. Permission to use each unit or system must be given by COTR. If the equipment is not installed and maintained in accordance with the following provisions, the COTR will withdraw permission for use of the equipment.
 - 2. Electrical installations used by the equipment shall be completed in accordance with the drawings and specifications to prevent damage to the equipment and the electrical systems, i.e. transformers, relays, circuit breakers, fuses, conductors, motor controllers and their overload elements shall be properly sized, coordinated and adjusted. Voltage supplied to each item of equipment shall be verified to be correct and it shall be determined that motors are not overloaded. The electrical equipment shall be thoroughly cleaned before using it and again immediately before final inspection including vacuum cleaning and wiping clean interior and exterior surfaces.
 - 3. Units shall be properly lubricated, balanced, and aligned. Vibrations must be eliminated.
 - 4. Automatic temperature control systems for preheat coils shall function properly and all safety controls shall function to prevent coil freeze-up damage.

5. The air filtering system utilized shall be that which is designed for the system when complete, and all filter elements shall be replaced at completion of construction and prior to testing and balancing of system.
6. All components of heat production and distribution system, metering equipment, condensate returns, and other auxiliary facilities used in temporary service shall be cleaned prior to use; maintained to prevent corrosion internally and externally during use; and cleaned, maintained and inspected prior to acceptance by the Government. Boilers, pumps, feedwater heaters and auxiliary equipment must be operated as a complete system and be fully maintained by operating personnel. Boiler water must be given complete and continuous chemical treatment.
- B. Prior to final inspection, the equipment or parts used which show wear and tear beyond normal, shall be replaced with identical replacements, at no additional cost to the Government.
- C. This paragraph shall not reduce the requirements of the mechanical and electrical specifications sections.

1.18 TEMPORARY USE OF NEW ELEVATORS

- A. The Contractor and his personnel shall be permitted use of new elevator(s) subject to the following provisions:
 1. Contractor shall make arrangements with the COTR for use of elevator(s). Contractor may obtain elevator(s) for exclusive use.
 2. Prior to the use of elevator(s), the Contractor shall have the elevator(s) inspected and accepted by an ASME accredited, certified elevator safety inspector. The acceptance report shall be submitted to the COTR.
 3. Submit to the COTR the schedule and procedures for maintaining equipment. Indicate the day or days of the week and total hours required for maintenance. A report shall be submitted to the COTR monthly indicating the type of maintenance conducted, hours used, and any repairs made to the elevator(s).
 4. The Contractor shall be responsible for enforcing the maintenance procedures.
 5. During temporary use of elevator(s) all repairs, equipment replacement and cost of maintenance shall be the responsibility of the Contractor.

6. Personnel for operating elevator(s) shall not be provided by the Department of Veterans Affairs.
7. Contractor shall cover and provide maximum protection of the entire elevator(s) installation.
8. The Contractor shall arrange for the elevator company to perform operation of the elevator(s) so that an ASME accredited, certified elevator safety inspector can evaluate the equipment. The Contractor shall be responsible for any costs of the elevator company.
9. All elevator(s) parts worn or damaged during temporary use shall be removed and replaced with new parts. This shall be determined by an ASME accredited certified elevator safety inspector after temporary use and before acceptance by the Government. Submit report to the COTR for approval.
10. Elevator shall be tested as required by the testing section of the elevator(s) specifications before acceptance by the Department of Veterans Affairs.

1.19 TEMPORARY TOILETS

- A. Provide where directed, (for use of all Contractor's workmen) ample temporary sanitary toilet accommodations with suitable sewer and water connections; or, when approved by COTR, provide suitable dry closets where directed. Keep such places clean and free from flies, and all connections and appliances connected therewith are to be removed prior to completion of contract, and premises left perfectly clean.

1.20 AVAILABILITY AND USE OF UTILITY SERVICES

- A. The Government shall make all reasonably required amounts of utilities available to the Contractor from existing outlets and supplies, as specified in the contract. The amount to be paid by the Contractor for chargeable electrical services shall be the prevailing rates charged to the Government. The Contractor shall carefully conserve any utilities furnished without charge.
- B. The Contractor, at Contractor's expense and in a workmanlike manner satisfactory to the Contracting Officer, shall install and maintain all necessary temporary connections and distribution lines, and all meters required to measure the amount of electricity used for the purpose of determining charges. Before final acceptance of the work by the Government, the Contractor shall remove all the temporary connections, distribution lines, meters, and associated paraphernalia.

- C. Contractor shall install meters at Contractor's expense and furnish the Medical Center a monthly record of the Contractor's usage of electricity as hereinafter specified.
- D. Heat: Furnish temporary heat necessary to prevent injury to work and materials through dampness and cold. Use of open salamanders or any temporary heating devices which may be fire hazards or may smoke and damage finished work, will not be permitted. Maintain minimum temperatures as specified for various materials:
 - 1. Obtain heat by connecting to Medical Center heating distribution system.
- E. Electricity (for Construction and Testing): Furnish all temporary electric services.
 - 1. Obtain electricity by connecting to the Medical Center electrical distribution system. The Contractor shall meter and pay for electricity required for electric cranes and hoisting devices, electrical welding devices and any electrical heating devices providing temporary heat. Electricity for all other uses is available at no cost to the Contractor.
- F. Water (for Construction and Testing): Furnish temporary water service.
 - 1. Obtain water by connecting to the Medical Center water distribution system. Provide reduced pressure backflow preventer at each connection. Water is available at no cost to the Contractor.
 - 2. Maintain connections, pipe, fittings and fixtures and conserve water-use so none is wasted. Failure to stop leakage or other wastes will be cause for revocation (at COTR 's discretion) of use of water from Medical Center's system.
- G. Steam: Furnish steam system for testing required in various sections of specifications.
 - 1. Obtain steam for testing by connecting to the Medical Center steam distribution system. Steam is available at no cost to the Contractor.
 - 2. Maintain connections, pipe, fittings and fixtures and conserve steam-use so none is wasted. Failure to stop leakage or other waste will be cause for revocation (at COTR 's discretion), of use of steam from the Medical Center's system.

1.21 NEW TELEPHONE EQUIPMENT

The contractor shall coordinate with the work of installation of telephone equipment by others. This work shall be completed before the building is turned over to VA.

1.22 TESTS

- A. Pre-test mechanical and electrical equipment and systems and make corrections required for proper operation of such systems before requesting final tests. Final test will not be conducted unless pre-tested.
- B. Conduct final tests required in various sections of specifications in presence of an authorized representative of the Contracting Officer. Contractor shall furnish all labor, materials, equipment, instruments, and forms, to conduct and record such tests.
- C. Mechanical and electrical systems shall be balanced, controlled and coordinated. A system is defined as the entire complex which must be coordinated to work together during normal operation to produce results for which the system is designed. For example, air conditioning supply air is only one part of entire system which provides comfort conditions for a building. Other related components are return air, exhaust air, steam, chilled water, refrigerant, hot water, controls and electricity, etc. Another example of a complex which involves several components of different disciplines is a boiler installation. Efficient and acceptable boiler operation depends upon the coordination and proper operation of fuel, combustion air, controls, steam, feedwater, condensate and other related components.
- D. All related components as defined above shall be functioning when any system component is tested. Tests shall be completed within a reasonably short period of time during which operating and environmental conditions remain reasonably constant.
- E. Individual test result of any component, where required, will only be accepted when submitted with the test results of related components and of the entire system.

1.23 INSTRUCTIONS

- A. Contractor shall furnish Maintenance and Operating manuals and verbal instructions when required by the various sections of the specifications and as hereinafter specified.
- B. Manuals: Maintenance and operating manuals (four copies each) for each separate piece of equipment shall be delivered to the COTR coincidental

with the delivery of the equipment to the job site. Manuals shall be complete, detailed guides for the maintenance and operation of equipment. They shall include complete information necessary for starting, adjusting, maintaining in continuous operation for long periods of time and dismantling and reassembling of the complete units and sub-assembly components. Manuals shall include an index covering all component parts clearly cross-referenced to diagrams and illustrations. Illustrations shall include "exploded" views showing and identifying each separate item. Emphasis shall be placed on the use of special tools and instruments. The function of each piece of equipment, component, accessory and control shall be clearly and thoroughly explained. All necessary precautions for the operation of the equipment and the reason for each precaution shall be clearly set forth. Manuals must reference the exact model, style and size of the piece of equipment and system being furnished. Manuals referencing equipment similar to but of a different model, style, and size than that furnished will not be accepted.

- C. Instructions: Contractor shall provide qualified, factory-trained manufacturers' representatives to give detailed instructions to assigned Department of Veterans Affairs personnel in the operation and complete maintenance for each piece of equipment. All such training will be at the job site. These requirements are more specifically detailed in the various technical sections. Instructions for different items of equipment that are component parts of a complete system, shall be given in an integrated, progressive manner. All instructors for every piece of component equipment in a system shall be available until instructions for all items included in the system have been completed. This is to assure proper instruction in the operation of inter-related systems. All instruction periods shall be at such times as scheduled by the COTR and shall be considered concluded only when the COTR is satisfied in regard to complete and thorough coverage. The Department of Veterans Affairs reserves the right to request the removal of, and substitution for, any instructor who, in the opinion of the COTR, does not demonstrate sufficient qualifications in accordance with requirements for instructors above.

1.24 CONSTRUCTION SIGN

- A. Provide a Construction Sign where directed by the COTR. All wood members shall be of framing lumber. Cover sign frame with 0.7 mm (24

gage) galvanized sheet steel nailed securely around edges and on all bearings. Provide three 100 by 100 mm (4 inch by 4 inch) posts (or equivalent round posts) set 1200 mm (four feet) into ground. Set bottom of sign level at 900 mm (three feet) above ground and secure to posts with through bolts. Make posts full height of sign. Brace posts with 50 x 100 mm (two by four inch) material as directed.

- B. Paint all surfaces of sign and posts two coats of white gloss paint. Border and letters shall be of black gloss paint, except project title which shall be blue gloss paint.
- C. Maintain sign and remove it when directed by the COTR.
- D. Detail Drawing of construction sign showing required legend and other characteristics of sign is / attached hereto and made a part of this specification.

1.25 SAFETY SIGN

- A. Provide a Safety Sign where directed by COTR. Face of sign shall be 19 mm (3/4 inch) thick exterior grade plywood. Provide two 100 mm by 100 mm (four by four inch) posts extending full height of sign and 900 mm (three feet) into ground. Set bottom of sign level at 1200 mm (four feet) above ground.
- B. Paint all surfaces of Safety Sign and posts with one prime coat and two coats of white gloss paint. Letters and design shall be painted with gloss paint of colors noted.
- C. Maintain sign and remove it when directed by COTR.
- D. Standard Detail Drawing Number SD10000-02(Found on VA TIL) of safety sign showing required legend and other characteristics of sign is attached hereto and is made a part of this specification.
- E. Post the number of accident free days on a daily basis.

1.26 HISTORIC PRESERVATION

Where the Contractor or any of the Contractor's employees, prior to, or during the construction work, are advised of or discover any possible archeological, historical and/or cultural resources, the Contractor shall immediately notify the COTR verbally, and then with a written follow up.

- - - E N D - - -

**SECTION 01 32 16.15
PROJECT SCHEDULES**

PART 1- GENERAL

1.1 DESCRIPTION:

- A. The Contractor shall develop a Critical Path Method (CPM) plan and schedule demonstrating fulfillment of the contract requirements (Project Schedule), and shall keep the Project Schedule up-to-date in accordance with the requirements of this section and shall utilize the plan for scheduling, coordinating and monitoring work under this contract (including all activities of subcontractors, equipment vendors and suppliers). Conventional Critical Path Method (CPM) technique shall be utilized to satisfy both time and cost applications.

1.2 CONTRACTOR'S REPRESENTATIVE:

- A. The Contractor shall designate an authorized representative responsible for the Project Schedule including preparation, review and progress reporting with and to the Contracting Officer's Technical Representative (COTR).
- B. The Contractor's representative shall have direct project control and complete authority to act on behalf of the Contractor in fulfilling the requirements of this specification section.
- C. The Contractor's representative shall have the option of developing the project schedule within their organization or to engage the services of an outside consultant. If an outside scheduling consultant is utilized, Section 1.3 of this specification will apply.

1.3 CONTRACTOR'S CONSULTANT:

- A. The Contractor shall submit a qualification proposal to the COTR, within 10 days of bid acceptance. The qualification proposal shall include:
1. The name and address of the proposed consultant.
 2. Information to show that the proposed consultant has the qualifications to meet the requirements specified in the preceding paragraph.
 3. A representative sample of prior construction projects, which the proposed consultant has performed complete project scheduling services. These representative samples shall be of similar size and scope.
- B. The COTR has the right to approve or disapprove the proposed consultant, and will notify the Contractor of the VA decision within

seven calendar days from receipt of the qualification proposal. In case of disapproval, the Contractor shall resubmit another consultant within 10 calendar days for renewed consideration. The Contractor shall have their scheduling consultant approved prior to submitting any schedule for approval.

1.4 COMPUTER PRODUCED SCHEDULES

- A. The contractor shall provide monthly, to the Department of Veterans Affairs (VA), all computer-produced time/cost schedules and reports generated from monthly project updates. This monthly computer service will include: three copies of up to five different reports (inclusive of all pages) available within the user defined reports of the scheduling software approved by the Contracting Officer; a hard copy listing of all project schedule changes, and associated data, made at the update and an electronic file of this data; and the resulting monthly updated schedule in PDM format. These must be submitted with and substantively support the contractor's monthly payment request and the signed look ahead report. The COTR shall identify the five different report formats that the contractor shall provide.
- B. The contractor shall be responsible for the correctness and timeliness of the computer-produced reports. The Contractor shall also responsible for the accurate and timely submittal of the updated project schedule and all CPM data necessary to produce the computer reports and payment request that is specified.
- C. The VA will report errors in computer-produced reports to the Contractor's representative within ten calendar days from receipt of reports. The Contractor shall reprocess the computer-produced reports and associated CD(s), when requested by the Contracting Officer's representative, to correct errors which affect the payment and schedule for the project.

1.5 THE COMPLETE PROJECT SCHEDULE SUBMITTAL

- A. Within 45 calendar days after receipt of Notice to Proceed, the Contractor shall submit for the Contracting Officer's review; three copies of the interim schedule on sheets of paper 765 x 1070 mm (30 x 42 inches) and an electronic file in the previously approved CPM schedule program. The submittal shall also include three copies of a computer-produced activity/event ID schedule showing project duration; phase completion dates; and other data, including event cost. Each activity/event on the computer-produced schedule shall contain as a

minimum, but not limited to, activity/event ID, activity/event description, duration, budget amount, early start date, early finish date, late start date, late finish date and total float. Work activity/event relationships shall be restricted to finish-to-start or start-to-start without lead or lag constraints. Activity/event date constraints, not required by the contract, will not be accepted unless submitted to and approved by the Contracting Officer. The contractor shall make a separate written detailed request to the Contracting Officer identifying these date constraints and secure the Contracting Officer's written approval before incorporating them into the network diagram. The Contracting Officer's separate approval of the Project Schedule shall not excuse the contractor of this requirement. Logic events (non-work) will be permitted where necessary to reflect proper logic among work events, but must have zero duration. The complete working schedule shall reflect the Contractor's approach to scheduling the complete project. **The final Project Schedule in its original form shall contain no contract changes or delays which may have been incurred during the final network diagram development period and shall reflect the entire contract duration as defined in the bid documents.** These changes/delays shall be entered at the first update after the final Project Schedule has been approved. The Contractor should provide their requests for time and supporting time extension analysis for contract time as a result of contract changes/delays, after this update, and in accordance with Article, ADJUSTMENT OF CONTRACT COMPLETION.

- D. Within 30 calendar days after receipt of the complete project interim Project Schedule and the complete final Project Schedule, the Contracting Officer or his representative, will do one or both of the following:
1. Notify the Contractor concerning his actions, opinions, and objections.
 2. A meeting with the Contractor at or near the job site for joint review, correction or adjustment of the proposed plan will be scheduled if required. Within 14 calendar days after the joint review, the Contractor shall revise and shall submit three blue line copies of the revised Project Schedule, three copies of the revised computer-produced activity/event ID schedule and a revised electronic file as specified by the Contracting Officer. The revised

submission will be reviewed by the Contracting Officer and, if found to be as previously agreed upon, will be approved.

- E. The approved baseline schedule and the computer-produced schedule(s) generated there from shall constitute the approved baseline schedule until subsequently revised in accordance with the requirements of this section.

1.6 WORK ACTIVITY/EVENT COST DATA

- A. The Contractor shall cost load all work activities/events except procurement activities. The cumulative amount of all cost loaded work activities/events (including alternates) shall equal the total contract price. Prorate overhead, profit and general conditions on all work activities/events for the entire project length. The contractor shall generate from this information cash flow curves indicating graphically the total percentage of work activity/event dollar value scheduled to be in place on early finish, late finish. These cash flow curves will be used by the Contracting Officer to assist him in determining approval or disapproval of the cost loading. Negative work activity/event cost data will not be acceptable, except on VA issued contract changes.
- B. The Contractor shall cost load work activities/events for guarantee period services, test, balance and adjust various systems in accordance with the provisions in Article, FAR 52.232 - 5 (PAYMENT UNDER FIXED-PRICE CONSTRUCTION CONTRACTS) and VAAR 852.236 - 83 (PAYMENT UNDER FIXED-PRICE CONSTRUCTION CONTRACTS).
- C. In accordance with FAR 52.236 - 1 (PERFORMANCE OF WORK BY THE CONTRACTOR) and VAAR 852.236 - 72 (PERFORMANCE OF WORK BY THE CONTRACTOR), the Contractor shall submit, simultaneously with the cost per work activity/event of the construction schedule required by this Section, a responsibility code for all activities/events of the project for which the Contractor's forces will perform the work.
- D. The Contractor shall cost load work activities/events for all BID ITEMS including ASBESTOS ABATEMENT. The sum of each BID ITEM work shall equal the value of the bid item in the Contractors' bid.

1.7 PROJECT SCHEDULE REQUIREMENTS

- A. Show on the project schedule the sequence of work activities/events required for complete performance of all items of work. The Contractor Shall:
 - 1. Show activities/events as:

- a. Contractor's time required for submittal of shop drawings, templates, fabrication, delivery and similar pre-construction work.
 - b. COTR's and Architect-Engineer's review and approval of shop drawings, equipment schedules, samples, template, or similar items.
 - c. Interruption of VA Facilities utilities, delivery of Government furnished equipment, and rough-in drawings, project phasing and any other specification requirements.
 - d. Test, balance and adjust various systems and pieces of equipment, maintenance and operation manuals, instructions and preventive maintenance tasks.
 - e. VA inspection and acceptance activity/event with a minimum duration of five work days at the end of each phase and immediately preceding any VA move activity/event required by the contract phasing for that phase.
2. Show not only the activities/events for actual construction work for each trade category of the project, but also trade relationships to indicate the movement of trades from one area, floor, or building, to another area, floor, or building, for at least five trades who are performing major work under this contract.
 3. Break up the work into activities/events of a duration no longer than 20 work days each or one reporting period, except as to non-construction activities/events (i.e., procurement of materials, delivery of equipment, concrete and asphalt curing) and any other activities/events for which the COTR may approve the showing of a longer duration. The duration for VA approval of any required submittal, shop drawing, or other submittals will not be less than 20 work days.
 4. Describe work activities/events clearly, so the work is readily identifiable for assessment of completion. Activities/events labeled "start," "continue," or "completion," are not specific and will not be allowed. Lead and lag time activities will not be acceptable.
 5. The schedule shall be generally numbered in such a way to reflect either discipline, phase or location of the work.
- B. The Contractor shall submit the following supporting data in addition to the project schedule:

1. The appropriate project calendar including working days and holidays.
 2. The planned number of shifts per day.
 3. The number of hours per shift.
- Failure of the Contractor to include this data shall delay the review of the submittal until the Contracting Officer is in receipt of the missing data.
- C. To the extent that the Project Schedule or any revised Project Schedule shows anything not jointly agreed upon, it shall not be deemed to have been approved by the COTR. Failure to include any element of work required for the performance of this contract shall not excuse the Contractor from completing all work required within any applicable completion date of each phase regardless of the COTR's approval of the Project Schedule.
- D. Compact Disk Requirements and CPM Activity/Event Record Specifications: Submit to the VA an electronic file(s) containing one file of the data required to produce a schedule, reflecting all the activities/events of the complete project schedule being submitted.

1.8 PAYMENT TO THE CONTRACTOR:

- A. Monthly, the contractor shall submit the AIA application and certificate for payment documents G702 & G703 reflecting updated schedule activities and cost data in accordance with the provisions of the following Article, PAYMENT AND PROGRESS REPORTING, as the basis upon which progress payments will be made pursuant to Article, FAR 52.232 - 5 (PAYMENT UNDER FIXED-PRICE CONSTRUCTION CONTRACTS) and VAAR 852.236 - 83 (PAYMENT UNDER FIXED-PRICE CONSTRUCTION CONTRACTS). The Contractor shall be entitled to a monthly progress payment upon approval of estimates as determined from the currently approved updated project schedule. Monthly payment requests shall include: a listing of all agreed upon project schedule changes and associated data; and an electronic file (s) of the resulting monthly updated schedule.
- B. Approval of the Contractor's monthly Application for Payment shall be contingent, among other factors, on the submittal of a satisfactory monthly update of the project schedule.

1.9 PAYMENT AND PROGRESS REPORTING

- A. Monthly schedule update meetings will be held on dates mutually agreed to by the COTR and the Contractor. Contractor and their CPM consultant (if applicable) shall attend all monthly schedule update meetings. The

Contractor shall accurately update the Project Schedule and all other data required and provide this information to the COTR three work days in advance of the schedule update meeting. Job progress will be reviewed to verify:

1. Actual start and/or finish dates for updated/completed activities/events.
 2. Remaining duration for each activity/event started, or scheduled to start, but not completed.
 3. Logic, time and cost data for change orders, and supplemental agreements that are to be incorporated into the Project Schedule.
 4. Changes in activity/event sequence and/or duration which have been made, pursuant to the provisions of following Article, ADJUSTMENT OF CONTRACT COMPLETION.
 5. Completion percentage for all completed and partially completed activities/events.
 6. Logic and duration revisions required by this section of the specifications.
 7. Activity/event duration and percent complete shall be updated independently.
- B. After completion of the joint review, the contractor shall generate an updated computer-produced calendar-dated schedule and supply the Contracting Officer's representative with reports in accordance with the Article, COMPUTER PRODUCED SCHEDULES, specified.
- C. After completing the monthly schedule update, the contractor's representative or scheduling consultant shall rerun all current period contract change(s) against the prior approved monthly project schedule. The analysis shall only include original workday durations and schedule logic agreed upon by the contractor and resident engineer for the contract change(s). When there is a disagreement on logic and/or durations, the Contractor shall use the schedule logic and/or durations provided and approved by the resident engineer. After each rerun update, the resulting electronic project schedule data file shall be appropriately identified and submitted to the VA in accordance to the requirements listed in articles 1.4 and 1.7. This electronic submission is separate from the regular monthly project schedule update requirements and shall be submitted to the resident engineer within fourteen (14) calendar days of completing the regular schedule update.
- Before inserting the contract changes durations, care must be taken to**

ensure that only the original durations will be used for the analysis, not the reported durations after progress. In addition, once the final network diagram is approved, the contractor must recreate all manual progress payment updates on this approved network diagram and associated reruns for contract changes in each of these update periods as outlined above for regular update periods. This will require detailed record keeping for each of the manual progress payment updates.

- D. Following approval of the CPM schedule, the VA, the General Contractor, its approved CPM Consultant, RE office representatives, and all subcontractors needed, as determined by the SRE, shall meet to discuss the monthly updated schedule. The main emphasis shall be to address work activities to avoid slippage of project schedule and to identify any necessary actions required to maintain project schedule during the reporting period. The Government representatives and the Contractor should conclude the meeting with a clear understanding of those work and administrative actions necessary to maintain project schedule status during the reporting period. This schedule coordination meeting will occur after each monthly project schedule update meeting utilizing the resulting schedule reports from that schedule update. If the project is behind schedule, discussions should include ways to prevent further slippage as well as ways to improve the project schedule status, when appropriate.

1.10 RESPONSIBILITY FOR COMPLETION

- A. If it becomes apparent from the current revised monthly progress schedule that phasing or contract completion dates will not be met, the Contractor shall execute some or all of the following remedial actions:
1. Increase construction manpower in such quantities and crafts as necessary to eliminate the backlog of work.
 2. Increase the number of working hours per shift, shifts per working day, working days per week, the amount of construction equipment, or any combination of the foregoing to eliminate the backlog of work.
 3. Reschedule the work in conformance with the specification requirements.
- B. Prior to proceeding with any of the above actions, the Contractor shall notify and obtain approval from the COTR for the proposed schedule changes. If such actions are approved, the representative schedule revisions shall be incorporated by the Contractor into the Project

Schedule before the next update, at no additional cost to the Government.

1.11 CHANGES TO THE SCHEDULE

- A. Within 30 calendar days after VA acceptance and approval of any updated project schedule, the Contractor shall submit a revised electronic file (s) and a list of any activity/event changes including predecessors and successors for any of the following reasons:
 - 1. Delay in completion of any activity/event or group of activities/events, which may be involved with contract changes, strikes, unusual weather, and other delays will not relieve the Contractor from the requirements specified unless the conditions are shown on the CPM as the direct cause for delaying the project beyond the acceptable limits.
 - 2. Delays in submittals, or deliveries, or work stoppage are encountered which make rescheduling of the work necessary.
 - 3. The schedule does not represent the actual prosecution and progress of the project.
 - 4. When there is, or has been, a substantial revision to the activity/event costs regardless of the cause for these revisions.
- B. CPM revisions made under this paragraph which affect the previously approved computer-produced schedules for Government furnished equipment, vacating of areas by the VA Facility, contract phase(s) and sub phase(s), utilities furnished by the Government to the Contractor, or any other previously contracted item, shall be furnished in writing to the Contracting Officer for approval.
- C. COTR's approval for the revised project schedule and all relevant data is contingent upon compliance with all other paragraphs of this section and any other previous agreements by the Contracting Officer or the VA representative.
- D. The cost of revisions to the project schedule resulting from contract changes will be included in the proposal for changes in work as specified in FAR 52.243 - 4 (Changes) and VAAR 852.236 - 88 (Changes - Supplemental), and will be based on the complexity of the revision or contract change, man hours expended in analyzing the change, and the total cost of the change.
- E. The cost of revisions to the Project Schedule not resulting from contract changes is the responsibility of the Contractor.

1.12 ADJUSTMENT OF CONTRACT COMPLETION

- A. The contract completion time will be adjusted only for causes specified in this contract. Request for an extension of the contract completion date by the Contractor shall be supported with a justification, CPM data and supporting evidence as the COTR may deem necessary for determination as to whether or not the Contractor is entitled to an extension of time under the provisions of the contract. Submission of proof based on revised activity/event logic, durations (in work days) and costs is obligatory to any approvals. The schedule must clearly display that the Contractor has used, in full, all the float time available for the work involved in this request. The Contracting Officer's determination as to the total number of days of contract extension will be based upon the current computer-produced calendar-dated schedule for the time period in question and all other relevant information.
- B. Actual delays in activities/events which, according to the computer-produced calendar-dated schedule, do not affect the extended and predicted contract completion dates shown by the critical path in the network, will not be the basis for a change to the contract completion date. The Contracting Officer will within a reasonable time after receipt of such justification and supporting evidence, review the facts and advise the Contractor in writing of the Contracting Officer's decision.
- C. The Contractor shall submit each request for a change in the contract completion date to the Contracting Officer in accordance with the provisions specified under FAR 52.243 - 4 (Changes) and VAAR 852.236 - 88 (Changes - Supplemental). The Contractor shall include, as a part of each change order proposal, a sketch showing all CPM logic revisions, duration (in work days) changes, and cost changes, for work in question and its relationship to other activities on the approved network diagram.
- D. All delays due to non-work activities/events such as RFI's, WEATHER, STRIKES, and similar non-work activities/events shall be analyzed on a month by month basis.

- - - E N D - - -

SECTION 01 33 23
SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES

- 1-1. Refer to Articles titled SPECIFICATIONS AND DRAWINGS FOR CONSTRUCTION (FAR 52.236-21) and, SPECIAL NOTES (VAAR 852.236-91), in GENERAL CONDITIONS.
- 1-2. For the purposes of this contract, samples (including laboratory samples to be tested), test reports, certificates, and manufacturers' literature and data shall also be subject to the previously referenced requirements. The following text refers to all items collectively as SUBMITTALS.
- 1-3. Submit for approval, all of the items specifically mentioned under the separate sections of the specification, with information sufficient to evidence full compliance with contract requirements. Materials, fabricated articles and the like to be installed in permanent work shall equal those of approved submittals. After an item has been approved, no change in brand or make will be permitted unless:
 - A. Satisfactory written evidence is presented to, and approved by Contracting Officer, that manufacturer cannot make scheduled delivery of approved item or;
 - B. Item delivered has been rejected and substitution of a suitable item is an urgent necessity or;
 - C. Other conditions become apparent which indicates approval of such substitute item to be in best interest of the Government.
- 1-4. Forward submittals in sufficient time to permit proper consideration and approval action by Government. Time submission to assure adequate lead time for procurement of contract - required items. Delays attributable to untimely and rejected submittals (including any laboratory samples to be tested) will not serve as a basis for extending contract time for completion.
- 1-5. Submittals will be reviewed for compliance with contract requirements by Architect-Engineer, and action thereon will be taken by Contracting Officer's Technical Representative (COTR) on behalf of the Contracting Officer.
- 1-6. Upon receipt of submittals, Architect-Engineer will assign a file number thereto. Contractor, in any subsequent correspondence, shall refer to this file and identification number to expedite replies relative to previously approved or disapproved submittals.

- 1-7. The Government reserves the right to require additional submittals, whether or not particularly mentioned in this contract. If additional submittals beyond those required by the contract are furnished pursuant to request therefor by Contracting Officer, adjustment in contract price and time will be made in accordance with Articles titled CHANGES (FAR 52.243-4) and CHANGES - SUPPLEMENT (VAAR 852.236-88) of the GENERAL CONDITIONS.
- 1-8. Schedules called for in specifications and shown on shop drawings shall be submitted for use and information of Department of Veterans Affairs and Architect-Engineer. However, the Contractor shall assume responsibility for coordinating and verifying schedules. The Contracting Officer and Architect-Engineer assumes no responsibility for checking schedules or layout drawings for exact sizes, exact numbers and detailed positioning of items.
- 1-9. Submittals must be submitted by Contractor only and shipped prepaid. Contracting Officer assumes no responsibility for checking quantities or exact numbers included in such submittals.
- A. Submit samples required by Section 09 06 00, SCHEDULE FOR FINISHES, in quadruplicate. Submit other samples in single units unless otherwise specified. Submit shop drawings, schedules, manufacturers' literature and data, and certificates in quadruplicate, except where a greater number is specified.
- B. Submittals will receive consideration only when covered by a transmittal letter signed by Contractor. Letter shall be sent via first class mail and shall contain the list of items, name of Medical Center, name of Contractor, contract number, applicable specification paragraph numbers, applicable drawing numbers (and other information required for exact identification of location for each item), manufacturer and brand, ASTM or Federal Specification Number (if any) and such additional information as may be required by specifications for particular item being furnished. In addition, catalogs shall be marked to indicate specific items submitted for approval.
1. A copy of letter must be enclosed with items, and any items received without identification letter will be considered "unclaimed goods" and held for a limited time only.
2. Each sample, certificate, manufacturers' literature and data shall be labeled to indicate the name and location of the Medical Center, name of Contractor, manufacturer, brand, contract number and ASTM or

Federal Specification Number as applicable and location(s) on project.

3. Required certificates shall be signed by an authorized representative of manufacturer or supplier of material, and by Contractor.
- C. In addition to complying with the applicable requirements specified in preceding Article 1.9, samples which are required to have Laboratory Tests (those preceded by symbol "LT" under the separate sections of the specification shall be tested, at the expense of Contractor, in a commercial laboratory approved by Contracting Officer.
1. Laboratory shall furnish Contracting Officer with a certificate stating that it is fully equipped and qualified to perform intended work, is fully acquainted with specification requirements and intended use of materials and is an independent establishment in no way connected with organization of Contractor or with manufacturer or supplier of materials to be tested.
 2. Certificates shall also set forth a list of comparable projects upon which laboratory has performed similar functions during past five years.
 3. Samples and laboratory tests shall be sent directly to approved commercial testing laboratory.
 4. Contractor shall send a copy of transmittal letter to both COTR and to Architect-Engineer simultaneously with submission of material to a commercial testing laboratory.
 5. Contractor shall forward a copy of transmittal letter to COTR simultaneously with submission to a commercial testing laboratory.
 6. Laboratory test reports shall be sent directly to COTR for appropriate action.
 7. Laboratory reports shall list contract specification test requirements and a comparative list of the laboratory test results. When tests show that the material meets specification requirements, the laboratory shall so certify on test report.
 8. Laboratory test reports shall also include a recommendation for approval or disapproval of tested item.
- D. If submittal samples have been disapproved, resubmit new samples as soon as possible after notification of disapproval. Such new samples shall be marked "Resubmitted Sample" in addition to containing other

previously specified information required on label and in transmittal letter.

- E. Approved samples will be kept on file by the COTR at the site until completion of contract, at which time such samples will be delivered to Contractor as Contractor's property. Where noted in technical sections of specifications, approved samples in good condition may be used in their proper locations in contract work. At completion of contract, samples that are not approved will be returned to Contractor only upon request and at Contractor's expense. Such request should be made prior to completion of the contract. Disapproved samples that are not requested for return by Contractor will be discarded after completion of contract.
- F. Submittal drawings (shop, erection or setting drawings) and schedules, required for work of various trades, shall be checked before submission by technically qualified employees of Contractor for accuracy, completeness and compliance with contract requirements. These drawings and schedules shall be stamped and signed by Contractor certifying to such check.
 - 1. For each drawing required, submit one legible photographic paper or vellum reproducible.
 - 2. Reproducible shall be full size.
 - 3. Each drawing shall have marked thereon, proper descriptive title, including Medical Center location, project number, manufacturer's number, reference to contract drawing number, detail Section Number, and Specification Section Number.
 - 4. A space 120 mm by 125 mm (4-3/4 by 5 inches) shall be reserved on each drawing to accommodate approval or disapproval stamp.
 - 5. Submit drawings, ROLLED WITHIN A MAILING TUBE, fully protected for shipment.
 - 6. One reproducible print of approved or disapproved shop drawings will be forwarded to Contractor.
 - 7. When work is directly related and involves more than one trade, shop drawings shall be submitted to Architect-Engineer under one cover.
- 1-10. Samples (except laboratory samples), shop drawings, test reports, certificates and manufacturers' literature and data, shall be submitted for approval to
SFCS Inc.
305 S. Jefferson Street

Roanoke, VA 24011

- 1-11. At the time of transmittal to the Architect-Engineer, the Contractor shall also send a copy of the complete submittal directly to the COTR.

- - - E N D - - -

**SECTION 01 42 19
REFERENCE STANDARDS**

PART 1 - GENERAL

1.1 DESCRIPTION

This section specifies the availability and source of references and standards specified in the project manual under paragraphs APPLICABLE PUBLICATIONS and/or shown on the drawings.

1.2 AVAILABILITY OF SPECIFICATIONS LISTED IN THE GSA INDEX OF FEDERAL SPECIFICATIONS, STANDARDS AND COMMERCIAL ITEM DESCRIPTIONS FPMR PART 101-29 (FAR 52.211-1) (AUG 1998)

- A. The GSA Index of Federal Specifications, Standards and Commercial Item Descriptions, FPMR Part 101-29 and copies of specifications, standards, and commercial item descriptions cited in the solicitation may be obtained for a fee by submitting a request to - GSA Federal Supply Service, Specifications Section, Suite 8100, 470 East L'Enfant Plaza, SW, Washington, DC 20407, Telephone (202) 619-8925, Facsimile (202) 619-8978.
- B. If the General Services Administration, Department of Agriculture, or Department of Veterans Affairs issued this solicitation, a single copy of specifications, standards, and commercial item descriptions cited in this solicitation may be obtained free of charge by submitting a request to the addressee in paragraph (a) of this provision. Additional copies will be issued for a fee.

1.3 AVAILABILITY FOR EXAMINATION OF SPECIFICATIONS NOT LISTED IN THE GSA INDEX OF FEDERAL SPECIFICATIONS, STANDARDS AND COMMERCIAL ITEM DESCRIPTIONS (FAR 52.211-4) (JUN 1988)

The specifications and standards cited in this solicitation can be examined at the following location:

DEPARTMENT OF VETERANS AFFAIRS
Office of Construction & Facilities Management
Facilities Quality Service (00CFM1A)
811 Vermont Avenue, NW - Room 462
Washington, DC 20420
Telephone Numbers: (202) 461-8217 or (202) 461-8292
Between 9:00 AM - 3:00 PM

1.4 AVAILABILITY OF SPECIFICATIONS NOT LISTED IN THE GSA INDEX OF FEDERAL SPECIFICATIONS, STANDARDS AND COMMERCIAL ITEM DESCRIPTIONS (FAR 52.211-3) (JUN 1988)

The specifications cited in this solicitation may be obtained from the associations or organizations listed below.

AA	Aluminum Association Inc. http://www.aluminum.org
AABC	Associated Air Balance Council http://www.aabchg.com
AAMA	American Architectural Manufacturer's Association http://www.aamanet.org
AAN	American Nursery and Landscape Association http://www.anla.org
AASHTO	American Association of State Highway and Transportation Officials http://www.aashto.org
AATCC	American Association of Textile Chemists and Colorists http://www.aatcc.org
ACGIH	American Conference of Governmental Industrial Hygienists http://www.acgi.org
ACI	American Concrete Institute http://www.aci-int.net
ACPA	American Concrete Pipe Association http://www.concrete-pipe.org
ACPPA	American Concrete Pressure Pipe Association http://www.acppa.org
ADC	Air Diffusion Council http://flexibleduct.org
AGA	American Gas Association http://www.aga.org
AGC	Associated General Contractors of America http://www.agc.org
AGMA	American Gear Manufacturers Association, Inc. http://www.agma.org
AHAM	Association of Home Appliance Manufacturers http://www.aham.org
AISC	American Institute of Steel Construction http://www.aisc.org
AISI	American Iron and Steel Institute http://www.steel.org
AITC	American Institute of Timber Construction http://www.aitc-glulam.org

AMCA	Air Movement and Control Association, Inc. http://www.amca.org
ANLA	American Nursery & Landscape Association http://www.anla.org
ANSI	American National Standards Institute, Inc. http://www.ansi.org
APA	The Engineered Wood Association http://www.apawood.org
ARI	Air-Conditioning and Refrigeration Institute http://www.ari.org
ASAE	American Society of Agricultural Engineers http://www.asae.org
ASCE	American Society of Civil Engineers http://www.asce.org
ASHRAE	American Society of Heating, Refrigerating, and Air-Conditioning Engineers http://www.ashrae.org
ASME	American Society of Mechanical Engineers http://www.asme.org
ASSE	American Society of Sanitary Engineering http://www.asse-plumbing.org
ASTM	American Society for Testing and Materials http://www.astm.org
AWI	Architectural Woodwork Institute http://www.awinet.org
AWS	American Welding Society http://www.aws.org
AWWA	American Water Works Association http://www.awwa.org
BHMA	Builders Hardware Manufacturers Association http://www.buildershardware.com
BIA	Brick Institute of America http://www.bia.org
CAGI	Compressed Air and Gas Institute http://www.cagi.org
CGA	Compressed Gas Association, Inc. http://www.cganet.com

CI	The Chlorine Institute, Inc. http://www.chlorineinstitute.org
CISCA	Ceilings and Interior Systems Construction Association http://www.cisca.org
CISPI	Cast Iron Soil Pipe Institute http://www.cispi.org
CLFMI	Chain Link Fence Manufacturers Institute http://www.chainlinkinfo.org
CPMB	Concrete Plant Manufacturers Bureau http://www.cpmc.org
CRA	California Redwood Association http://www.calredwood.org
CRSI	Concrete Reinforcing Steel Institute http://www.crsi.org
CTI	Cooling Technology Institute http://www.cti.org
DHI	Door and Hardware Institute http://www.dhi.org
EGSA	Electrical Generating Systems Association http://www.egsa.org
EEI	Edison Electric Institute http://www.eei.org
EPA	Environmental Protection Agency http://www.epa.gov
ETL	ETL Testing Laboratories, Inc. http://www.etl.com
FAA	Federal Aviation Administration http://www.faa.gov
FCC	Federal Communications Commission http://www.fcc.gov
FPS	The Forest Products Society http://www.forestprod.org
GANA	Glass Association of North America http://www.cssinfo.com/info/gana.html/
FM	Factory Mutual Insurance http://www.fmglobal.com
GA	Gypsum Association http://www.gypsum.org

GSA	General Services Administration http://www.gsa.gov
HI	Hydraulic Institute http://www.pumps.org
HPVA	Hardwood Plywood & Veneer Association http://www.hpva.org
ICBO	International Conference of Building Officials http://www.icbo.org
ICEA	Insulated Cable Engineers Association Inc. http://www.icea.net
\ICAC	Institute of Clean Air Companies http://www.icac.com
IEEE	Institute of Electrical and Electronics Engineers http://www.ieee.org
IMSA	International Municipal Signal Association http://www.imsasafety.org
IPCEA	Insulated Power Cable Engineers Association
NBMA	Metal Buildings Manufacturers Association http://www.mbma.com
MSS	Manufacturers Standardization Society of the Valve and Fittings Industry Inc. http://www.mss-hq.com
NAAMM	National Association of Architectural Metal Manufacturers http://www.naamm.org
NAPHCC	Plumbing-Heating-Cooling Contractors Association http://www.phccweb.org.org
NBS	National Bureau of Standards See - NIST
NBBPVI	National Board of Boiler and Pressure Vessel Inspectors http://www.nationboard.org
NEC	National Electric Code See - NFPA National Fire Protection Association
NEMA	National Electrical Manufacturers Association http://www.nema.org
NFPA	National Fire Protection Association http://www.nfpa.org
NHLA	National Hardwood Lumber Association http://www.natlhardwood.org

NIH National Institute of Health
<http://www.nih.gov>

NIST National Institute of Standards and Technology
<http://www.nist.gov>

NLMA Northeastern Lumber Manufacturers Association, Inc.
<http://www.nelma.org>

NPA National Particleboard Association
18928 Premiere Court
Gaithersburg, MD 20879
(301) 670-0604

NSF National Sanitation Foundation
<http://www.nsf.org>

NWWDA Window and Door Manufacturers Association
<http://www.nwwda.org>

OSHA Occupational Safety and Health Administration
Department of Labor
<http://www.osha.gov>

PCA Portland Cement Association
<http://www.portcement.org>

PCI Precast Prestressed Concrete Institute
<http://www.pci.org>

PPI The Plastic Pipe Institute
<http://www.plasticpipe.org>

PEI Porcelain Enamel Institute, Inc.
<http://www.porcelainenamel.com>

PTI Post-Tensioning Institute
<http://www.post-tensioning.org>

RFCI The Resilient Floor Covering Institute
<http://www.rfci.com>

RIS Redwood Inspection Service
See - CRA

RMA Rubber Manufacturers Association, Inc.
<http://www.rma.org>

SCMA Southern Cypress Manufacturers Association
<http://www.cypressinfo.org>

SDI Steel Door Institute
<http://www.steeldoor.org>

IGMA Insulating Glass Manufacturers Alliance
<http://www.igmaonline.org>

SJI Steel Joist Institute
<http://www.steeljoist.org>

SMACNA Sheet Metal and Air-Conditioning Contractors
 National Association, Inc.
<http://www.smacna.org>

SSPC The Society for Protective Coatings
<http://www.sspc.org>

STI Steel Tank Institute
<http://www.steeltank.com>

SWI Steel Window Institute
<http://www.steelwindows.com>

TCA Tile Council of America, Inc.
<http://www.tileusa.com>

TEMA Tubular Exchange Manufacturers Association
<http://www.tema.org>

TPI Truss Plate Institute, Inc.
 583 D'Onofrio Drive; Suite 200
 Madison, WI 53719
 (608) 833-5900

UBC The Uniform Building Code
 See ICBO

UL Underwriters' Laboratories Incorporated
<http://www.ul.com>

ULC Underwriters' Laboratories of Canada
<http://www.ulc.ca>

WCLIB West Coast Lumber Inspection Bureau
 6980 SW Varns Road, P.O. Box 23145
 Portland, OR 97223
 (503) 639-0651

WRCLA Western Red Cedar Lumber Association
 P.O. Box 120786
 New Brighton, MN 55112
 (612) 633-4334

WWPA Western Wood Products Association
<http://www.wwpa.org>

- - - E N D - - -

SECTION 01 45 29
TESTING LABORATORY SERVICES

PART 1 - GENERAL

1.1 DESCRIPTION:

This section specifies materials testing activities and inspection services required during project construction to be provided by a Testing Laboratory.

1.2 APPLICABLE PUBLICATIONS:

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referred to in the text by the basic designation only.
- B. American Association of State Highway and Transportation Officials (AASHTO):
 - T27-06.....Sieve Analysis of Fine and Coarse Aggregates
 - T96-02 (R2006).....Resistance to Degradation of Small-Size Coarse Aggregate by Abrasion and Impact in the Los Angeles Machine
 - T99-01 (R2004).....The Moisture-Density Relations of Soils Using a 2.5 Kg (5.5 lb.) Rammer and a 305 mm (12 in.) Drop
 - T104-99 (R2003).....Soundness of Aggregate by Use of Sodium Sulfate or Magnesium Sulfate
 - T180-01 (R2004).....Moisture-Density Relations of Soils using a 4.54 kg (10 lb.) Rammer and a 457 mm (18 in.) Drop
 - T191-02 (R2006).....Density of Soil In-Place by the Sand-Cone Method
- C. American Concrete Institute (ACI):
- D. American Society for Testing and Materials (ASTM):
 - A325-06.....Structural Bolts, Steel, Heat Treated, 120/105 ksi Minimum Tensile Strength
 - A370-07.....Definitions for Mechanical Testing of Steel Products
 - A490-06.....Heat Treated Steel Structural Bolts, 150 ksi Minimum Tensile Strength
 - C31/C31M-06.....Making and Curing Concrete Test Specimens in the Field
 - C33-03.....Concrete Aggregates

D2974-07.....Moisture, Ash, and Organic Matter of Peat and
Other Organic Soils

D3666-(2002).....Minimum Requirements for Agencies Testing and
Inspection Bituminous Paving Materials

D3740-07.....Minimum Requirements for Agencies Engaged in
the Testing and Inspecting Road and Paving
Material

E94-04.....Radiographic Testing

E164-03.....Ultrasonic Contact Examination of Weldments

E329-07.....Agencies Engaged in Construction Inspection
and/or Testing

E543-06.....Agencies Performing Non-Destructive Testing

E605-93(R2006).....Thickness and Density of Sprayed Fire-Resistive
Material (SFRM) Applied to Structural Members

E709-(2001).....Guide for Magnetic Particle Examination

E1155-96(R2008).....Determining FF Floor Flatness and FL Floor
Levelness Numbers

E. American Welding Society (AWS):

D1.1-07.....Structural Welding Code-Steel

1.3 REQUIREMENTS:

- A. Accreditation Requirements: Construction materials testing laboratories must be accredited by a laboratory accreditation authority and will be required to submit a copy of the Certificate of Accreditation and Scope of Accreditation. The laboratory's scope of accreditation must include the appropriate ASTM standards (i.e.; E 329, C 1077, D 3666, D3740, A 880, E 543) listed in the technical sections of the specifications. Laboratories engaged in Hazardous Materials Testing shall meet the requirements of OSHA and EPA. The policy applies to the specific laboratory performing the actual testing, not just the "Corporate Office."
- B. Inspection and Testing: Testing laboratory shall inspect materials and workmanship and perform tests described herein and additional tests requested by Contracting Officer's Technical Representative (COTR). When it appears materials furnished, or work performed by Contractor fail to meet construction contract requirements, Testing Laboratory shall direct attention of COTR to such failure.
- C. Written Reports: Testing laboratory shall submit test reports to COTR, Contractor, unless other arrangements are agreed to in writing by the

COTR. Submit reports of tests that fail to meet construction contract requirements on colored paper.

- D. Verbal Reports: Give verbal notification to COTR immediately of any irregularity.

PART 2 - PRODUCTS (NOT USED)

PART 3 - EXECUTION

3.1 EARTHWORK:

- A. General: The Testing Laboratory shall provide qualified personnel, materials, equipment, and transportation as required to perform the services identified/required herein, within the agreed to schedule and/or time frame. The work to be performed shall be as identified herein and shall include but not be limited to the following:

1. Observe fill and subgrades during proof-rolling to evaluate suitability of surface material to receive fill or base course. Provide recommendations to the COTR regarding suitability or unsuitability of areas where proof-rolling was observed. Where unsuitable results are observed, witness excavation of unsuitable material and recommend to COTR extent of removal and replacement of unsuitable materials and observe proof-rolling of replaced areas until satisfactory results are obtained.
2. Provide full time observation of fill placement and compaction and field density testing in building areas and provide observation of fill placement and compaction and field density testing in pavement areas to verify that earthwork compaction obtained is in accordance with contract documents.
3. Provide supervised geotechnical technician to inspect excavation, subsurface preparation, and backfill for structural fill.

B. Testing Compaction:

1. Determine maximum density and optimum moisture content for each type of fill, backfill and subgrade material used, in compliance with ASTM D698.
2. Make field density tests in accordance with the primary testing method following ASTM D2922 wherever possible. Field density tests utilizing ASTM D1556 or ASTM D2167 shall be utilized on a case by case basis only if there are problems with the validity of the results from the primary method due to specific site field conditions. Should the testing laboratory propose these alternative

methods, they should provide satisfactory explanation to the COTR before the tests are conducted.

- a. Building Slab Subgrade: At least one test of subgrade for every 185 m² (2000 square feet) of building slab, but in no case fewer than three tests. In each compacted fill layer, perform one test for every 185 m² (2000 square feet) of overlaying building slab, but in no case fewer than three tests.
 - b. Foundation Wall Backfill: One test per 30 m (100 feet) of each layer of compacted fill but in no case fewer than two tests.
 - c. Pavement Subgrade: One test for each 335 m² (400 square yards), but in no case fewer than two tests.
 - d. Curb, Gutter, and Sidewalk: One test for each 90 m (300 feet), but in no case fewer than two tests.
 - e. Trenches: One test at maximum 30 m (100 foot) intervals per 1200 mm (4 foot) of vertical lift and at changes in required density, but in no case fewer than two tests.
 - f. Footing Subgrade: At least one test for each layer of soil on which footings will be placed. Subsequent verification and approval of each footing subgrade may be based on a visual comparison of each subgrade with related tested subgrade when acceptable to COTR. In each compacted fill layer below wall footings, perform one field density test for every 30 m (100 feet) of wall. Verify subgrade is level, all loose or disturbed soils have been removed, and correlate actual soil conditions observed with those indicated by test borings.
- C. Testing for Footing Bearing Capacity: Evaluate if suitable bearing capacity material is encountered in footing subgrade.
- D. Testing Materials: Test suitability of on-site and off-site borrow as directed by COTR.

3.2 LANDSCAPING:

- A. Test topsoil for organic materials, pH, phosphate, potash content, and gradation of particles.
 1. Test for organic material by using ASTM D2974.
 2. Determine percent of silt, sand, clay, and foreign materials such as rock, roots, and vegetation.
- B. Submit laboratory test report of topsoil to COTR.

3.3 ASPHALT CONCRETE PAVING:

- A. Aggregate Base Course:

1. Determine maximum density and optimum moisture content for aggregate base material in accordance with ASTM D1557, Method D.
2. Make a minimum of three field density tests on each day's final compaction on each aggregate course in accordance with ASTM D1556.
3. Sample and test aggregate as necessary to insure compliance with specification requirements for gradation, wear, and soundness as specified in the applicable state highway standards and specifications.

B. Asphalt Concrete:

1. Aggregate: Sample and test aggregates in stock pile and hot-bins as necessary to insure compliance with specification requirements for gradation (AASHTO T27), wear (AASHTO T96), and soundness (AASHTO T104).
2. Temperature: Check temperature of each load of asphalt concrete at mixing plant and at site of paving operation.
3. Density: Make a minimum of two field density tests in accordance with ASTM D1188 of asphalt base and surface course for each day's paving operation.

3.4 SITE WORK CONCRETE:

Test site work concrete including materials for concrete as required in Article CONCRETE of this section.

3.5 CONCRETE:

A. Batch Plant Inspection and Materials Testing:

1. Perform continuous batch plant inspection until concrete quality is established to satisfaction of COTR with concurrence of Contracting Officer and perform periodic inspections thereafter as determined by COTR.
2. Periodically inspect and test batch proportioning equipment for accuracy and report deficiencies to COTR.
3. Sample and test mix ingredients as necessary to insure compliance with specifications.
4. Sample and test aggregates daily and as necessary for moisture content. Test the dry rodded weight of the coarse aggregate whenever a sieve analysis is made, and when it appears there has been a change in the aggregate.
5. Certify, in duplicate, ingredients and proportions and amounts of ingredients in concrete conform to approved trial mixes. When concrete is batched or mixed off immediate building site, certify

(by signing, initialing or stamping thereon) on delivery slips (duplicate) that ingredients in truck-load mixes conform to proportions of aggregate weight, cement factor, and water-cement ratio of approved trial mixes.

B. Field Inspection and Materials Testing:

1. Provide a technician at site of placement at all times to perform concrete sampling and testing.
2. Review the delivery tickets of the ready-mix concrete trucks arriving on-site. Notify the Contractor if the concrete cannot be placed within the specified time limits or if the type of concrete delivered is incorrect. Reject any loads that do not comply with the Specification requirements. Rejected loads are to be removed from the site at the Contractor's expense. Any rejected concrete that is placed will be subject to removal.
3. Take concrete samples at point of placement in accordance with ASTM C172. Mold and cure compression test cylinders in accordance with ASTM C31. Make at least three cylinders for each 40 m³ (50 cubic yards) or less of each concrete type, and at least three cylinders for any one day's pour for each concrete type. Label each cylinder with an identification number. COTR may require additional cylinders to be molded and cured under job conditions.
4. Perform slump tests in accordance with ASTM C143. Test the first truck each day, and every time test cylinders are made. Test pumped concrete at the hopper and at the discharge end of the hose at the beginning of each day's pumping operations to determine change in slump.
5. Determine the air content of concrete per ASTM C173. For concrete required to be air-entrained, test the first truck and every 20 m³ (25 cubic yards) thereafter each day. For concrete not required to be air-entrained, test every 80 m³ (100 cubic yards) at random. For pumped concrete, initially test concrete at both the hopper and the discharge end of the hose to determine change in air content.
6. If slump or air content fall outside specified limits, make another test immediately from another portion of same batch.
7. Perform unit weight tests in compliance with ASTM C138 for normal weight concrete and ASTM C567 for lightweight concrete. Test the first truck and each time cylinders are made.

8. Notify laboratory technician at batch plant of mix irregularities and request materials and proportioning check.
9. Verify that specified mixing has been accomplished.
10. Environmental Conditions: Determine the temperature per ASTM C1064 for each truckload of concrete during hot weather and cold weather concreting operations:
 - a. When ambient air temperature falls below 4.4 degrees C (40 degrees F), record maximum and minimum air temperatures in each 24 hour period; record air temperature inside protective enclosure; record minimum temperature of surface of hardened concrete.
 - b. When ambient air temperature rises above 29.4 degrees C (85 degrees F), record maximum and minimum air temperature in each 24 hour period; record minimum relative humidity; record maximum wind velocity; record maximum temperature of surface of hardened concrete.
11. Inspect the reinforcing steel placement, including bar size, bar spacing, top and bottom concrete cover, proper tie into the chairs, and grade of steel prior to concrete placement. Submit detailed report of observations.
12. Observe conveying, placement, and consolidation of concrete for conformance to specifications.
13. Observe condition of formed surfaces upon removal of formwork prior to repair of surface defects and observe repair of surface defects.
14. Observe curing procedures for conformance with specifications, record dates of concrete placement, start of preliminary curing, start of final curing, end of curing period.
15. Observe preparations for placement of concrete:
 - a. Inspect handling, conveying, and placing equipment, inspect vibrating and compaction equipment.
 - b. Inspect preparation of construction, expansion, and isolation joints.
16. Observe preparations for protection from hot weather, cold weather, sun, and rain, and preparations for curing.
17. Observe concrete mixing:
 - a. Monitor and record amount of water added at project site.
 - b. Observe minimum and maximum mixing times.
18. Measure concrete flatwork for levelness and flatness as follows:

- a. Perform Floor Tolerance Measurements F_F and F_L in accordance with ASTM E1155. Calculate the actual overall F - numbers using the inferior/superior area method.
 - b. Perform all floor tolerance measurements within 48 hours after slab installation.
 - c. Provide the Contractor and the COTR with the results of all profile tests, including a running tabulation of the overall F_F and F_L values for all slabs installed to date, within 72 hours after each slab installation.
19. Other inspections:
- a. Grouting under base plates.
 - b. Grouting anchor bolts and reinforcing steel in hardened concrete.
 - c. Continuous inspection of bolts installed in concrete prior to and during concrete placement.

C. Laboratory Tests of Field Samples:

1. Test compression test cylinders for strength in accordance with ASTM C39. For each test series, test one cylinder at 7 days and one cylinder at 28 days. Use remaining cylinder as a spare tested as directed by COTR. Compile laboratory test reports as follows:
Compressive strength test shall be result of one cylinder, except when one cylinder shows evidence of improper sampling, molding or testing, in which case it shall be discarded and strength of spare cylinder shall be used.
2. Furnish certified compression test reports (duplicate) to COTR. In test report, indicate the following information:
 - a. Cylinder identification number and date cast.
 - b. Specific location at which test samples were taken.
 - c. Type of concrete, slump, and percent air.
 - d. Compressive strength of concrete in MPa (psi).
 - e. Weight of lightweight structural concrete in kg/m^3 (pounds per cubic feet).
 - f. Weather conditions during placing.
 - g. Temperature of concrete in each test cylinder when test cylinder was molded.
 - h. Maximum and minimum ambient temperature during placing.
 - i. Ambient temperature when concrete sample in test cylinder was taken.
 - j. Date delivered to laboratory and date tested.

3.6 REINFORCEMENT:

- A. Review mill test reports furnished by Contractor.

3.7 MASONRY:**A. Mortar Tests:**

1. Laboratory compressive strength test:
 - a. Comply with ASTM C780.
 - b. Obtain samples during or immediately after discharge from batch mixer.
 - c. Furnish molds with 50 mm (2 inch), 3 compartment gang cube.
 - d. Test one sample at 7 days and 2 samples at 28 days.
2. Two tests during first week of operation; one test per week after initial test until masonry completion.

B. Grout Tests:

1. Laboratory compressive strength test:
 - a. Comply with ASTM C1019.
 - b. Test one sample at 7 days and 2 samples at 28 days.
 - c. Perform test for each 230 m² (2500 square feet) of masonry.
 - d. Provide continuous observation during grout placement.

C. Masonry Unit Tests:

1. Laboratory Compressive Strength Test:
 - a. Comply with ASTM C140.
 - b. Test 3 samples for each 460 m² (5000 square feet) of wall area.

- D. Prism Tests: For each type of wall construction indicated, test masonry prisms per ASTM C1314 for each 460 m² (5000 square feet) of wall area. Prepare one set of prisms for testing at 7 days and one set for testing at 28 days.

3.8 STRUCTURAL STEEL:

- A. General: Provide shop and field inspection and testing services to certify structural steel work is done in accordance with contract documents. Welding shall conform to AWS D1.1 Structural Welding Code.

B. Prefabrication Inspection:

1. Review design and shop detail drawings for size, length, type and location of all welds to be made.
2. Approve welding procedure qualifications either by pre-qualification or by witnessing qualifications tests.
3. Approve welder qualifications by certification or retesting.
4. Approve procedure for control of distortion and shrinkage stresses.

5. Approve procedures for welding in accordance with applicable sections of AWS D1.1.
- C. Fabrication and Erection:
1. Weld Inspection:
 - a. Inspect welding equipment for capacity, maintenance and working condition.
 - b. Verify specified electrodes and handling and storage of electrodes in accordance with AWS D1.1.
 - c. Inspect preparation and assembly of materials to be welded for conformance with AWS D1.1.
 - d. Inspect preheating and interpass temperatures for conformance with AWS D1.1.
 - e. Measure 25 percent of fillet welds.
 - f. Welding Magnetic Particle Testing: Test in accordance with ASTM E709 for a minimum of:
 - 1) 20 percent of all shear plate fillet welds at random, final pass only.
 - 2) 20 percent of all continuity plate and bracing gusset plate fillet welds, at random, final pass only.
 - 3) 100 percent of tension member fillet welds (i.e., hanger connection plates and other similar connections) for root and final passes.
 - 4) 20 percent of length of built-up column member partial penetration and fillet welds at random for root and final passes.
 - 5) 100 percent of length of built-up girder member partial penetration and fillet welds for root and final passes.
 - g. Welding Ultrasonic Testing: Test in accordance with ASTM E164 and AWS D1.1 for 100 percent of all full penetration welds, braced and moment frame column splices, and a minimum of 20 percent of all other partial penetration column splices, at random.
 - h. Verify that correction of rejected welds are made in accordance with AWS D1.1.
 - i. Testing and inspection do not relieve the Contractor of the responsibility for providing materials and fabrication procedures in compliance with the specified requirements.
 2. Bolt Inspection:

- a. Inspect high-strength bolted connections in accordance AISC Specifications for Structural Joints Using ASTM A325 or A490 Bolts.
 - b. Slip-Critical Connections: Inspect 10 percent of bolts, but not less than 2 bolts, selected at random in each connection in accordance with AISC Specifications for Structural Joints Using ASTM A325 or A490 Bolts. Inspect all bolts in connection when one or more are rejected.
 - c. Fully Pre-tensioned Connections: Inspect 10 percent of bolts, but not less than 2 bolts, selected at random in 25 percent of connections in accordance with AISC Specification for Structural Joints Using ASTM A325 or A490 Bolts. Inspect all bolts in connection when one or more are rejected.
 - d. Bolts installed by turn-of-nut tightening may be inspected with calibrated wrench when visual inspection was not performed during tightening.
 - e. Snug Tight Connections: Inspect 10 percent of connections verifying that plies of connected elements have been brought into snug contact.
 - f. Inspect field erected assemblies; verify locations of structural steel for plumbness, level, and alignment.
- D. Submit inspection reports, record of welders and their certification, and identification, and instances of noncompliance to COTR.

3.9 STEEL DECKING:

- A. Provide field inspection of welds of metal deck to the supporting steel, and testing services to insure steel decking has been installed in accordance with contract documents and manufacturer's requirements.
- B. Qualification of Field Welding: Qualify welding processes and welding operators in accordance with "Welder Qualification" procedures of AWS D1.1. Refer to the "Plug Weld Qualification Procedure" in Part 3 "Field Quality Control."
- C. Submit inspection reports, certification, and instances of noncompliance to COTR.

3.10 SHEAR CONNECTOR STUDS:

- A. Provide field inspection and testing services required by AWS D.1 to insure shear connector studs have been installed in accordance with contract documents.

- B. Tests: Test 20 percent of headed studs for fastening strength in accordance with AWS D1.1.
- C. Submit inspection reports, certification, and instances of noncompliance to COTR.

3.11 SPRAYED-ON FIREPROOFING:

- A. Provide field inspection and testing services to certify sprayed-on fireproofing has been applied in accordance with contract documents.
- B. Obtain a copy of approved submittals from COTR.
- C. Use approved installation in test areas as criteria for inspection of work.
- D. Test sprayed-on fireproofing for thickness and density in accordance with ASTM E605.
 - 1. Thickness gauge specified in ASTM E605 may be modified for pole extension so that overhead sprayed material can be reached from floor.
- E. Location of test areas for field tests shall be per 2009 IBC, Chapter 17, Part 1704.12.

- - - E N D - - -

SECTION 01 57 19
TEMPORARY ENVIRONMENTAL CONTROLS

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This section specifies the control of environmental pollution and damage that the Contractor must consider for air, water, and land resources. It includes management of visual aesthetics, noise, solid waste, radiant energy, and radioactive materials, as well as other pollutants and resources encountered or generated by the Contractor. The Contractor is obligated to consider specified control measures with the costs included within the various contract items of work.
- B. Environmental pollution and damage is defined as the presence of chemical, physical, or biological elements or agents which:
 - 1. Adversely effect human health or welfare,
 - 2. Unfavorably alter ecological balances of importance to human life,
 - 3. Effect other species of importance to humankind, or;
 - 4. Degrade the utility of the environment for aesthetic, cultural, and historical purposes.
- C. Definitions of Pollutants:
 - 1. Chemical Waste: Petroleum products, bituminous materials, salts, acids, alkalis, herbicides, pesticides, organic chemicals, and inorganic wastes.
 - 2. Debris: Combustible and noncombustible wastes, such as leaves, tree trimmings, ashes, and waste materials resulting from construction or maintenance and repair work.
 - 3. Sediment: Soil and other debris that has been eroded and transported by runoff water.
 - 4. Solid Waste: Rubbish, debris, garbage, and other discarded solid materials resulting from industrial, commercial, and agricultural operations and from community activities.
 - 5. Surface Discharge: The term "Surface Discharge" implies that the water is discharged with possible sheeting action and subsequent soil erosion may occur. Waters that are surface discharged may terminate in drainage ditches, storm sewers, creeks, and/or "water of the United States" and would require a permit to discharge water from the governing agency.

6. Rubbish: Combustible and noncombustible wastes such as paper, boxes, glass and crockery, metal and lumber scrap, tin cans, and bones.
7. Sanitary Wastes:
 - a. Sewage: Domestic sanitary sewage and human and animal waste.
 - b. Garbage: Refuse and scraps resulting from preparation, cooking, dispensing, and consumption of food.

1.2 QUALITY CONTROL

- A. Establish and maintain quality control for the environmental protection of all items set forth herein.
- B. Record on daily reports any problems in complying with laws, regulations, and ordinances. Note any corrective action taken.

1.3 REFERENCES

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referred to in the text by basic designation only.
- B. U.S. National Archives and Records Administration (NARA):
33 CFR 328.....Definitions

1.4 SUBMITTALS

- A. In accordance with Section, 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES, furnish the following:
 1. Environmental Protection Plan: After the contract is awarded and prior to the commencement of the work, the Contractor shall meet with the Contracting Officer's Technical Representative (COTR) to discuss the proposed Environmental Protection Plan and to develop mutual understanding relative to details of environmental protection. Not more than 20 calendar days after the meeting, the Contractor shall prepare and submit to the COTR and the Contracting Officer for approval, a written and/or graphic Environmental Protection Plan including, but not limited to, the following:
 - a. Name(s) of person(s) within the Contractor's organization who is (are) responsible for ensuring adherence to the Environmental Protection Plan.
 - b. Name(s) and qualifications of person(s) responsible for manifesting hazardous waste to be removed from the site.
 - c. Name(s) and qualifications of person(s) responsible for training the Contractor's environmental protection personnel.
 - d. Description of the Contractor's environmental protection personnel training program.

- e. A list of Federal, State, and local laws, regulations, and permits concerning environmental protection, pollution control, noise control and abatement that are applicable to the Contractor's proposed operations and the requirements imposed by those laws, regulations, and permits.
 - f. Methods for protection of features to be preserved within authorized work areas including trees, shrubs, vines, grasses, ground cover, landscape features, air and water quality, fish and wildlife, soil, historical, and archeological and cultural resources.
 - g. Procedures to provide the environmental protection that comply with the applicable laws and regulations. Describe the procedures to correct pollution of the environment due to accident, natural causes, or failure to follow the procedures as described in the Environmental Protection Plan.
 - h. Permits, licenses, and the location of the solid waste disposal area.
 - i. Environmental Monitoring Plans for the job site including land, water, air, and noise.
 - j. Work Area Plan showing the proposed activity in each portion of the area and identifying the areas of limited use or nonuse. Plan should include measures for marking the limits of use areas. This plan may be incorporated within the Erosion Control Plan.
- B. Approval of the Contractor's Environmental Protection Plan will not relieve the Contractor of responsibility for adequate and continued control of pollutants and other environmental protection measures.

1.5 PROTECTION OF ENVIRONMENTAL RESOURCES

- A. Protect environmental resources within the project boundaries and those affected outside the limits of permanent work during the entire period of this contract. Confine activities to areas defined by the specifications and drawings.
- B. Protection of Land Resources: Prior to construction, identify all land resources to be preserved within the work area. Do not remove, cut, deface, injure, or destroy land resources including trees, shrubs, vines, grasses, top soil, and land forms without permission from the COTR. Do not fasten or attach ropes, cables, or guys to trees for anchorage unless specifically authorized, or where special emergency use is permitted.

1. Work Area Limits: Prior to any construction, mark the areas that require work to be performed under this contract. Mark or fence isolated areas within the general work area that are to be saved and protected. Protect monuments, works of art, and markers before construction operations begin. Convey to all personnel the purpose of marking and protecting all necessary objects.
2. Protection of Landscape: Protect trees, shrubs, vines, grasses, land forms, and other landscape features shown on the drawings to be preserved by marking, fencing, or using any other approved techniques.
 - a. Box and protect from damage existing trees and shrubs to remain on the construction site.
 - b. Immediately repair all damage to existing trees and shrubs by trimming, cleaning, and painting with antiseptic tree paint.
 - c. Do not store building materials or perform construction activities closer to existing trees or shrubs than the farthest extension of their limbs.
3. Reduction of Exposure of Unprotected Erodible Soils: Plan and conduct earthwork to minimize the duration of exposure of unprotected soils. Clear areas in reasonably sized increments only as needed to use. Form earthwork to final grade as shown. Immediately protect side slopes and back slopes upon completion of rough grading.
4. Temporary Protection of Disturbed Areas: Construct diversion ditches, benches, and berms to retard and divert runoff from the construction site to protected drainage areas approved under paragraph 208 of the Clean Water Act.
 - a. Sediment Basins: Trap sediment from construction areas in temporary or permanent sediment basins that accommodate the runoff of a local 2011 (design year) storm. After each storm, pump the basins dry and remove the accumulated sediment. Control overflow/drainage with paved weirs or by vertical overflow pipes, draining from the surface.
 - b. Reuse or conserve the collected topsoil sediment as directed by the COTR. Topsoil use and requirements are specified in Section 31 20 00, EARTH MOVING.
 - c. Institute effluent quality monitoring programs as required by Federal, State, and local environmental agencies.

5. Erosion and Sedimentation Control Devices: The erosion and sediment controls selected and maintained by the Contractor shall be such that water quality standards are not violated as a result of the Contractor's activities. Construct or install all temporary and permanent erosion and sedimentation control features shown on the Environmental Protection Plan. Maintain temporary erosion and sediment control measures such as berms, dikes, drains, sedimentation basins, grassing, and mulching, until permanent drainage and erosion control facilities are completed and operative.
 6. Manage borrow areas on Government property to minimize erosion and to prevent sediment from entering nearby water courses or lakes.
 7. Manage and control spoil areas on Government property to limit spoil to areas shown on the Environmental Protection Plan and prevent erosion of soil or sediment from entering nearby water courses or lakes.
 8. Protect adjacent areas from despoilment by temporary excavations and embankments.
 9. Handle and dispose of solid wastes in such a manner that will prevent contamination of the environment. Place solid wastes (excluding clearing debris) in containers that are emptied on a regular schedule. Transport all solid waste off Government property and dispose of waste in compliance with Federal, State, and local requirements.
 10. Store chemical waste away from the work areas in corrosion resistant containers and dispose of waste in accordance with Federal, State, and local regulations.
 11. Handle discarded materials other than those included in the solid waste category as directed by the COTR.
- C. Protection of Water Resources: Keep construction activities under surveillance, management, and control to avoid pollution of surface and ground waters and sewer systems. Implement management techniques to control water pollution by the listed construction activities that are included in this contract.
1. Washing and Curing Water: Do not allow wastewater directly derived from construction activities to enter water areas. Collect and place wastewater in retention ponds allowing the suspended material to settle, the pollutants to separate, or the water to evaporate.

2. Control movement of materials and equipment at stream crossings during construction to prevent violation of water pollution control standards of the Federal, State, or local government.
 3. Monitor water areas affected by construction.
- D. Protection of Fish and Wildlife Resources: Keep construction activities under surveillance, management, and control to minimize interference with, disturbance of, or damage to fish and wildlife. Prior to beginning construction operations, list species that require specific attention along with measures for their protection.
- E. Protection of Air Resources: Keep construction activities under surveillance, management, and control to minimize pollution of air resources. Burning is not permitted on the job site. Keep activities, equipment, processes, and work operated or performed, in strict accordance with the State of West Virginia Air Pollution Statute, Rule, or Regulation and Federal emission and performance laws and standards. Maintain ambient air quality standards set by the Environmental Protection Agency, for those construction operations and activities specified.
1. Particulates: Control dust particles, aerosols, and gaseous by-products from all construction activities, processing, and preparation of materials at all times, including weekends, holidays, and hours when work is not in progress.
 2. Particulates Control: Maintain all excavations, stockpiles, haul roads, permanent and temporary access roads, plant sites, spoil areas, borrow areas, and all other work areas within or outside the project boundaries free from particulates which would cause a hazard or a nuisance. Sprinklering, chemical treatment of an approved type, light bituminous treatment, baghouse, scrubbers, electrostatic precipitators, or other methods are permitted to control particulates in the work area.
 3. Hydrocarbons and Carbon Monoxide: Control monoxide emissions from equipment to Federal and State allowable limits.
 4. Odors: Control odors of construction activities and prevent obnoxious odors from occurring.
- F. Reduction of Noise: Minimize noise using every action possible. Perform noise-producing work in less sensitive hours of the day or week as directed by the COTR. Maintain noise-produced work at or below the decibel levels and within the time periods specified.

1. Perform construction activities involving repetitive, high-level impact noise only between 8:00 a.m. EST and 6:00 p.m EST unless otherwise permitted by local ordinance or the COTR. Repetitive impact noise on the property shall not exceed the following dB limitations:

Time Duration of Impact Noise	Sound Level in dB
More than 12 minutes in any hour	70
Less than 30 seconds of any hour	85
Less than three minutes of any hour	80
Less than 12 minutes of any hour	75

2. Provide sound-deadening devices on equipment and take noise abatement measures that are necessary to comply with the requirements of this contract, consisting of, but not limited to, the following:
 - a. Maintain maximum permissible construction equipment noise levels at 15 m (50 feet) (dBA):

EARTHMOVING		MATERIALS HANDLING	
FRONT LOADERS	75	CONCRETE MIXERS	75
BACKHOES	75	CONCRETE PUMPS	75
DOZERS	75	CRANES	75
TRACTORS	75	DERRICKS IMPACT	75
SCAPERS	80	PILE DRIVERS	95
GRADERS	75	JACK HAMMERS	75
TRUCKS	75	ROCK DRILLS	80
PAVERS, STATIONARY	80	PNEUMATIC TOOLS	80
PUMPS	75	BLASTING	100
GENERATORS	75	SAWS	75
COMPRESSORS	75	VIBRATORS	75

- b. Use shields or other physical barriers to restrict noise transmission.
 - c. Provide soundproof housings or enclosures for noise-producing machinery.
 - d. Use efficient silencers on equipment air intakes.

- e. Use efficient intake and exhaust mufflers on internal combustion engines that are maintained so equipment performs below noise levels specified.
 - f. Line hoppers and storage bins with sound deadening material.
 - g. Conduct truck loading, unloading, and hauling operations so that noise is kept to a minimum.
3. Measure sound level for noise exposure due to the construction at least once every five successive working days while work is being performed above 55 dB(A) noise level. Measure noise exposure at the property line or 15 m (50 feet) from the noise source, whichever is greater. Measure the sound levels on the A weighing network of a General Purpose sound level meter at slow response. To minimize the effect of reflective sound waves at buildings, take measurements at 900 to 1800 mm (three to six feet) in front of any building face. Submit the recorded information to the COTR noting any problems and the alternatives for mitigating actions.
- G. Restoration of Damaged Property: If any direct or indirect damage is done to public or private property resulting from any act, omission, neglect, or misconduct, the Contractor shall restore the damaged property to a condition equal to that existing before the damage at no additional cost to the Government. Repair, rebuild, or restore property as directed or make good such damage in an acceptable manner.
- H. Final Clean-up: On completion of project and after removal of all debris, rubbish, and temporary construction, Contractor shall leave the construction area in a clean condition satisfactory to the COTR. Cleaning shall include off the station disposal of all items and materials not required to be salvaged, as well as all debris and rubbish resulting from demolition and new work operations.

- - - E N D - - -

SECTION 01 58 16
TEMPORARY INTERIOR SIGNAGE

PART 1 GENERAL

DESCRIPTION

This section specifies temporary interior signs.

PART 2 PRODUCTS

2.1 TEMPORARY SIGNS

- A. Fabricate from 50 Kg (110 pound) mat finish white paper.
- B. Cut to 100 mm (4-inch) wide by 300 mm (12 inch) long size tag.
- C. Punch 3 mm (1/8-inch) diameter hole centered on 100 mm (4-inch) dimension of tag. Edge of Hole spaced approximately 13 mm (1/2-inch) from one end on tag.
- D. Reinforce hole on both sides with gummed cloth washer or other suitable material capable of preventing tie pulling through paper edge.
- E. Ties: Steel wire 0.3 mm (0.0120-inch) thick, attach to tag with twist tie, leaving 150 mm (6-inch) long free ends.

PART 3 EXECUTION

3.1 INSTALLATION

- A. Install temporary signs attached to room door frame or room door knob, lever, or pull for doors on corridor openings.
- B. Mark on signs with felt tip marker having approximately 3 mm (1/8-inch) wide stroke for clearly legible numbers or letters.
- C. Identify room with numbers as designated on floor plans.

3.2 LOCATION

- A. Install on doors that have room, corridor, and space numbers shown.
- B. Doors that do not require signs are as follows:
 - 1. Corridor barrier doors (cross-corridor) in corridor with same number.
 - 2. Folding doors or partitions.
 - 3. Toilet or bathroom doors within and between rooms.
 - 4. Communicating doors in partitions between rooms with corridor entrance doors.
 - 5. Closet doors within rooms.
- C. Replace missing, damaged, or illegible signs.

- - - E N D - - -

SECTION 01 74 19
CONSTRUCTION WASTE MANAGEMENT

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This section specifies the requirements for the management of non-hazardous building construction and demolition waste.
- B. Waste disposal in landfills shall be minimized to the greatest extent possible. Of the inevitable waste that is generated, as much of the waste material as economically feasible shall be salvaged, recycled or reused.
- C. Contractor shall use all reasonable means to divert construction and demolition waste from landfills and incinerators, and facilitate their salvage and recycle not limited to the following:
 - 1. Waste Management Plan development and implementation.
 - 2. Techniques to minimize waste generation.
 - 3. Sorting and separating of waste materials.
 - 4. Salvage of existing materials and items for reuse or resale.
 - 5. Recycling of materials that cannot be reused or sold.
- D. At a minimum the following waste categories shall be diverted from landfills:
 - 1. Soil.
 - 2. Inerts (eg, concrete, masonry and asphalt).
 - 3. Clean dimensional wood and palette wood.
 - 4. Green waste (biodegradable landscaping materials).
 - 5. Engineered wood products (plywood, particle board and I-joists, etc).
 - 6. Metal products (eg, steel, wire, beverage containers, copper, etc).
 - 7. Cardboard, paper and packaging.
 - 8. Bitumen roofing materials.
 - 9. Plastics (eg, ABS, PVC).
 - 10. Carpet and/or pad.
 - 11. Gypsum board.
 - 12. Insulation.
 - 13. Paint.
 - 14. Fluorescent lamps.

1.2 RELATED WORK

- A. Section 02 41 00, DEMOLITION.
- B. Section 01 00 00, GENERAL REQUIREMENTS.

1.3 QUALITY ASSURANCE

- A. Contractor shall practice efficient waste management when sizing, cutting and installing building products. Processes shall be employed to ensure the generation of as little waste as possible. Construction /Demolition waste includes products of the following:
 - 1. Excess or unusable construction materials.
 - 2. Packaging used for construction products.
 - 3. Poor planning and/or layout.
 - 4. Construction error.
 - 5. Over ordering.
 - 6. Weather damage.
 - 7. Contamination.
 - 8. Mishandling.
 - 9. Breakage.
- B. Establish and maintain the management of non-hazardous building construction and demolition waste set forth herein. Conduct a site assessment to estimate the types of materials that will be generated by demolition and construction.
- C. Contractor shall develop and implement procedures to reuse and recycle new materials to a minimum of 50 percent.
- D. Contractor shall be responsible for implementation of any special programs involving rebates or similar incentives related to recycling. Any revenues or savings obtained from salvage or recycling shall accrue to the contractor.
- E. Contractor shall provide all demolition, removal and legal disposal of materials. Contractor shall ensure that facilities used for recycling, reuse and disposal shall be permitted for the intended use to the extent required by local, state, federal regulations. The Whole Building Design Guide website <http://www.wbdg.org> provides a Construction Waste Management Database that contains information on companies that haul, collect, and process recyclable debris from construction projects.
- F. Contractor shall assign a specific area to facilitate separation of materials for reuse, salvage, recycling, and return. Such areas are to be kept neat and clean and clearly marked in order to avoid contamination or mixing of materials.

- G. Contractor shall provide on-site instructions and supervision of separation, handling, salvaging, recycling, reuse and return methods to be used by all parties during waste generating stages.
- H. Record on daily reports any problems in complying with laws, regulations and ordinances with corrective action taken.

1.4 TERMINOLOGY

- A. Class III Landfill: A landfill that accepts non-hazardous resources such as household, commercial and industrial waste resulting from construction, remodeling, repair and demolition operations.
- B. Clean: Untreated and unpainted; uncontaminated with adhesives, oils, solvents, mastics and like products.
- C. Construction and Demolition Waste: Includes all non-hazardous resources resulting from construction, remodeling, alterations, repair and demolition operations.
- D. Dismantle: The process of parting out a building in such a way as to preserve the usefulness of its materials and components.
- E. Disposal: Acceptance of solid wastes at a legally operating facility for the purpose of land filling (includes Class III landfills and inert fills).
- F. Inert Backfill Site: A location, other than inert fill or other disposal facility, to which inert materials are taken for the purpose of filling an excavation, shoring or other soil engineering operation.
- G. Inert Fill: A facility that can legally accept inert waste, such as asphalt and concrete exclusively for the purpose of disposal.
- H. Inert Solids/Inert Waste: Non-liquid solid resources including, but not limited to, soil and concrete that does not contain hazardous waste or soluble pollutants at concentrations in excess of water-quality objectives established by a regional water board, and does not contain significant quantities of decomposable solid resources.
- I. Mixed Debris: Loads that include commingled recyclable and non-recyclable materials generated at the construction site.
- J. Mixed Debris Recycling Facility: A solid resource processing facility that accepts loads of mixed construction and demolition debris for the purpose of recovering re-usable and recyclable materials and disposing non-recyclable materials.
- K. Permitted Waste Hauler: A company that holds a valid permit to collect and transport solid wastes from individuals or businesses for the purpose of recycling or disposal.

- L. Recycling: The process of sorting, cleansing, treating, and reconstituting materials for the purpose of using the altered form in the manufacture of a new product. Recycling does not include burning, incinerating or thermally destroying solid waste.
 - 1. On-site Recycling - Materials that are sorted and processed on site for use in an altered state in the work, i.e. concrete crushed for use as a sub-base in paving.
 - 2. Off-site Recycling - Materials hauled to a location and used in an altered form in the manufacture of new products.
- M. Recycling Facility: An operation that can legally accept materials for the purpose of processing the materials into an altered form for the manufacture of new products. Depending on the types of materials accepted and operating procedures, a recycling facility may or may not be required to have a solid waste facilities permit or be regulated by the local enforcement agency.
- N. Reuse: Materials that are recovered for use in the same form, on-site or off-site.
- O. Return: To give back reusable items or unused products to vendors for credit.
- P. Salvage: To remove waste materials from the site for resale or re-use by a third party.
- Q. Source-Separated Materials: Materials that are sorted by type at the site for the purpose of reuse and recycling.
- R. Solid Waste: Materials that have been designated as non-recyclable and are discarded for the purposes of disposal.
- S. Transfer Station: A facility that can legally accept solid waste for the purpose of temporarily storing the materials for re-loading onto other trucks and transporting them to a landfill for disposal, or recovering some materials for re-use or recycling.

1.5 SUBMITTALS

- A. In accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES, furnish the following:
- B. Prepare and submit to the Resident Engineer a written demolition debris management plan. The plan shall include, but not be limited to, the following information:
 - 1. Procedures to be used for debris management.
 - 2. Techniques to be used to minimize waste generation.
 - 3. Analysis of the estimated job site waste to be generated:

- a. List of each material and quantity to be salvaged, reused, recycled.
 - b. List of each material and quantity proposed to be taken to a landfill.
- 4. Detailed description of the Means/Methods to be used for material handling.
 - a. On site: Material separation, storage, protection where applicable.
 - b. Off site: Transportation means and destination. Include list of materials.
 - 1) Description of materials to be site-separated and self-hauled to designated facilities.
 - 2) Description of mixed materials to be collected by designated waste haulers and removed from the site.
 - c. The names and locations of mixed debris reuse and recycling facilities or sites.
 - d. The names and locations of trash disposal landfill facilities or sites.
 - e. Documentation that the facilities or sites are approved to receive the materials.
- C. Designated Manager responsible for instructing personnel, supervising, documenting and administer over meetings relevant to the Waste Management Plan.
- D. Monthly summary of construction and demolition debris diversion and disposal, quantifying all materials generated at the work site and disposed of or diverted from disposal through recycling.

1.6 APPLICABLE PUBLICATIONS

- A Publications listed below form a part of this specification to the extent referenced. Publications are referenced by the basic designation only. In the event that criteria requirements conflict, the most stringent requirements shall be met.
- B. U.S. Green Building Council (USGBC):
LEED Green Building Rating System for New Construction

1.7 RECORDS

Maintain records to document the quantity of waste generated; the quantity of waste diverted through sale, reuse, or recycling; and the quantity of waste disposed by landfill or incineration.

PART 2 - PRODUCTS**2.1 MATERIALS**

- A. List of each material and quantity to be salvaged, recycled, reused.
- B. List of each material and quantity proposed to be taken to a landfill.
- C. Material tracking data: Receiving parties, dates removed, transportation costs, weight tickets, tipping fees, manifests, invoices, net total costs or savings.

PART 3 - EXECUTION**3.1 COLLECTION**

- A. Provide all necessary containers, bins and storage areas to facilitate effective waste management.
- B. Clearly identify containers, bins and storage areas so that recyclable materials are separated from trash and can be transported to respective recycling facility for processing.
- C. Hazardous wastes shall be separated, stored, disposed of according to local, state, federal regulations.

3.2 DISPOSAL

- A. Contractor shall be responsible for transporting and disposing of materials that cannot be delivered to a source-separated or mixed materials recycling facility to a transfer station or disposal facility that can accept the materials in accordance with state and federal regulations.
- B. Construction or demolition materials with no practical reuse or that cannot be salvaged or recycled shall be disposed of at a landfill or incinerator.

3.3 REPORT

- A. With each application for progress payment, submit a summary of construction and demolition debris diversion and disposal including beginning and ending dates of period covered.
- B. Quantify all materials diverted from landfill disposal through salvage or recycling during the period with the receiving parties, dates removed, transportation costs, weight tickets, manifests, invoices. Include the net total costs or savings for each salvaged or recycled material.
- C. Quantify all materials disposed of during the period with the receiving parties, dates removed, transportation costs, weight tickets, tipping fees, manifests, invoices. Include the net total costs for each disposal.

- - - E N D - - -

**SECTION 02 21 00
SITE SURVEYS**

PART 1 - GENERAL

1.1 DESCRIPTION

This section specifies the gathering of research documents, performance of a topographic survey and preparation of a topographic survey map.

1.2 DEFINITIONS

- A. Professional Land Surveyor: One who possesses a valid state license as a "Professional Land Surveyor" from the state in which they practice.
- B. Professional Civil Engineer: One who possesses a valid state license as a "Professional Civil Engineer" from the state in which they practice. For this section, the term "surveyor" shall also include Professional Civil Engineers authorized to practice Land Surveying under the laws of the state in which they practice.

PART 2 - EXECUTION

- A. The surveyor shall research available public records for all mapping, monumentation, plats, governmental surveys etc. that may pertain to the subject property. Research all applicable public utilities for substructure data such as sewers, storm drains, water lines, electrical conduits etc.
- B. The survey shall be performed on the ground in accordance with the current "Accuracy Standards for Land Title Surveys" as adopted, from time to time, by the American Congress on Surveying and Mapping, the National Society of Professional Surveyors, and the American Land Title Association.
- C. The surveyor, when applicable, shall consult with the project Architect to determine scale of plat or map and size of drawings.
- D. The surveyor shall furnish two sets of prints of the plat or map of survey and an electronic CADD file. If the plat or map of survey consists of more than one sheet, the sheets shall be numbered, the total number of sheets indicated and the match lines be shown on each sheet.
- E. On the plat or map, the survey boundary shall be drawn to a convenient scale, or the scale designated by the Architect, with the scale clearly indicated. A graphic scale, shown in feet or meters or both, shall be included. A north arrow shall be shown and when practicable, the plat or map of survey shall be oriented so that north is at the top of the drawing. Symbols or abbreviations used shall be identified on the face

of the plat or map by use of a legend or other means. Supplementary or exaggerated diagrams shall be presented accurately on the plat or map where dimensional data is too small to be shown clearly at full scale. The plat or map shall be 30 by 42 inches.

F. The survey shall contain the following applicable information:

1. The name, address, telephone number, and signature of the Professional Land Surveyor who made the survey, his or her official seal and registration number, the date the survey was completed and the dates of all revisions.
2. The survey drawing(s) submitted shall bear the following certification adjacent to the Engineer's official seal:

"I hereby certify that all information indicated on this drawing was obtained or verified by actual measurements in the field and that every effort has been made to furnish complete and accurate information."
3. Vicinity map showing the property surveyed in reference to nearby highways or major street intersections.
4. Flood zone designation (with proper annotation based on Federal Flood Insurance Rate Maps or the state or local equivalent, by scaled map location and graphic plotting only).
5. Land area as defined by the boundaries of the legal description of the surveyed premises.
6. All data necessary to indicate the mathematical dimensions and relationships of the boundary represented by bearings and distances, and the length and radius of each curve, together with elements necessary to mathematically define each curve. The point of beginning of the surveyor's description and the basis of bearings shall also be shown.
7. When record bearings or angles or distances differ from measured bearings, angles or distances, both record and measured bearings, angles, and distances shall be clearly indicated. If the record description fails to form a mathematically closed figure, the surveyor shall so indicate.
8. Measured and record distances from corners of parcels surveyed to the nearest right-of-way lines of streets in urban or suburban areas, together with recovered lot corners and evidence of lot corners, shall be noted. The distances to the nearest intersecting street shall be indicated and verified. Names and widths of streets

and highways abutting the property surveyed and widths of rights of way shall be given. Observable evidence of access (or lack thereof) to such abutting streets or highways shall be indicated. Observable evidence of private roads shall be so indicated. Streets abutting the premises, which have been described in Record Documents, but not physically opened, shall be shown and so noted.

9. The identifying titles of all recorded plats, filed maps, right of way maps, or similar documents which the survey represents, wholly or in part, with their appropriate recording data. The survey shall indicate platted setback or building restriction lines which have been recorded in subdivision plats or which appear in a Record Document which has been delivered to the surveyor. Contiguity, gores, and overlaps along the exterior boundaries of the survey premises, where ascertainable from field evidence or Record Documents, or interior to those exterior boundaries, shall be clearly indicated or noted. Where only a part of a recorded lot or parcel is included in the survey, the balance of the lot or parcel shall be indicated.
10. All evidence of found monuments shall be shown and noted. All evidence of monuments found beyond the surveyed premises on which establishment of the corners of the survey premises are dependent, and their application related to the survey shall be indicated.
11. The character of any and all evidence of possession shall be stated and the location of such evidence carefully given in relation to both the measured boundary lines and those established by the record. An absence of notation on the survey shall be presumptive of no observable evidence of possession. The term "possession" does not imply "ownership".
12. The location of all buildings upon the plot or parcel shall be shown and their locations defined by measurements perpendicular to the boundaries. If there are no buildings, so state. Proper street numbers shall be shown where available.
13. All easements evidenced by a Record Document which have been delivered to the surveyor shall be shown, both those burdening and those benefiting the property surveyed, indicating recording information. If such an easement cannot be located, a note to this affect shall be included. Observable evidence of easements and/or servitudes of all kinds, such as those created by roads, rights-of-

ways, water courses, drains, telephone, telegraph, or electric lines, water, sewer, oil or gas pipelines on or across the surveyed property and on adjoining properties if they appear to affect the surveyed property, shall be located and noted. Surface indications, if any, or of underground easements and/or servitudes shall also be shown.

14. The character and location of all walls, buildings, fences, and other visible improvements within five feet of each side of the boundary lines shall be noted. Without expressing a legal opinion, physical evidence of all encroaching structural appurtenances and projections, such as fire escapes, bay windows, windows and doors that open out, flue pipes, stoops, eaves, cornices, areaways, stoops, trip, etc., by or on adjoining property or on abutting streets, on any easement or over setback lines shown by Record Documents shall be indicated with the extent of such encroachment or projection.
15. Driveways and alleys on or crossing the property must be shown. Where there is evidence of use by other than the occupants of the property, the surveyor must so indicate on the plat or map. Where driveways or alleys on adjoining properties encroach, in whole or in part, on the property being surveyed, the surveyor must so indicate on the plat or map with appropriate measurements.
16. Location, alignment and dimensions of all roads, curbs, walks, parking and paved areas abutting the subject land. Indicate road centerlines with true bearings and lengths by 50 foot stationing. Describe curves by designating the points of curvature and tangency by station. Include all curve data as well a location of radius and vertex points. Elevations on 50' centers on centerline of roads, edges of roads and top and bottom of curbs.
17. As accurately as the evidence permits, the location of cemeteries and burial grounds disclosed in the process of researching title to the premises or observed in the process of performing the field work for the survey, shall be shown.
18. Ponds, lakes, springs, or rivers bordering on or running through the premises being surveyed shall be shown. When a property surveyed contains a natural water boundary, the surveyor shall measure the location of the boundary according to appropriate surveying methods and note on the plat or map the date of the measurement and the

caveat that the boundary is subject to change due to natural causes and that it may or may not represent the actual location of the limit of title. When the surveyor is aware of changes in such boundaries, the extent of those changes shall be identified.

19. Contours at a minimum interval of 2 feet. Base vertical control on the permanent (not assumed) National Geodetic Survey (NGS) or VA Medical Center Bench Mark. Note location, description and datum.
20. Identify and show if possible, setback, height, and floor space area restrictions of record or disclosed by applicable zoning or building codes (in addition to those recorded in subdivision maps). If none, so state.
21. Exterior dimensions of all buildings at ground level. Show square footage of exterior footprint of all buildings at ground level and gross floor area of all buildings.
22. Measured height of all buildings above grade at a defined location. If no defined location is provided, the point of measurement shall be shown.
23. Elevations at each entrance to buildings, service docks, building corners, steps, ramps and grade slabs.
24. Substantial, visible improvements (in addition to buildings) such as signs, parking areas, swimming pools, etc.
25. Parking areas and, if striped, the striping and the type (eg. handicapped, motorcycle, regular, etc.) and number of parking spaces.
26. Indication of access to a public way such as curb cuts and driveways.
27. Location of utilities existing on or serving the surveyed property as determined by observed evidence together with plans and markings provided by utility companies, and other appropriate sources (with references as to the source of information. Locate and show all fire hydrants located within 500 feet of the subject property.
28. Railroad tracks and sidings.
29. Manholes, catch basins, valve vaults or other surface indications of subterranean uses.
30. Wires and cables (including their function) crossing the survey premises, all poles on or within ten feet of the surveyed premises, and the dimensions of all cross-wires or overhangs affecting the surveyed premises.

31. Utility company installations on the surveyed premises.
32. Names of adjoining owners of platted lands.
33. Observable evidence of earth moving work, building construction or building additions within recent months.
34. Any changes in street right-of-way lines either completed or proposed, and available from the controlling jurisdiction.
Observable evidence of recent street or sidewalk construction or repairs.
35. Observable evidence of site use as a solid waste dump, sump or sanitary landfill.
36. All trees with a minimum diameter of 6 inches measured at 48 inches above the base of the tree. Perimeter outline only of thickly wooded areas with description of predominant vegetation.

- - - E N D - - -

**SECTION 02 41 00
DEMOLITION**

PART 1 - GENERAL

1.1 DESCRIPTION:

This section specifies demolition and removal of utilities and other structures from the site as shown.

1.2 RELATED WORK:

- A. Demolition and removal of roads, walks, curbs, and on-grade slabs outside buildings to be demolished: Section 31 20 00, EARTH MOVING.
- B. Safety Requirements: GENERAL CONDITIONS Article, ACCIDENT PREVENTION.
- C. Disconnecting utility services prior to demolition: Section 01 00 00, GENERAL REQUIREMENTS.
- D. Reserved items that are to remain the property of the Government: Section 01 00 00, GENERAL REQUIREMENTS.
- E. Environmental Protection: Section 01 57 19, TEMPORARY ENVIRONMENTAL CONTROLS.
- F. Construction Waste Management: Section 017419 CONSTRUCTION WASTE MANAGEMENT.
- G. Infectious Control: Section 01 00 00, GENERAL REQUIREMENTS, Article 1.8, INFECTION PREVENTION MEASURES.

1.3 PROTECTION:

- A. Perform demolition in such manner as to eliminate hazards to persons and property; to minimize interference with use of adjacent areas, utilities and structures or interruption of use of such utilities; and to provide free passage to and from such adjacent areas of structures. Comply with requirements of GENERAL CONDITIONS Article, ACCIDENT PREVENTION.
- B. Provide safeguards, including warning signs, barricades, temporary fences, warning lights, and other similar items that are required for protection of all personnel during demolition and removal operations. Comply with requirements of Section 01 00 00, GENERAL REQUIREMENTS, Article 1.10 PROTECTION OF EXISTING VEGETATION, STRUCTURES, EQUIPMENT, UTILITIES AND IMPROVEMENTS.
- C. Maintain fences, barricades, lights, and other similar items around exposed excavations until such excavations have been completely filled.
- D. Provide enclosed dust chutes with control gates from each floor to carry debris to truck beds and govern flow of material into truck.

- Provide overhead bridges of tight board or prefabricated metal construction at dust chutes to protect persons and property from falling debris.
- E. Prevent spread of flying particles and dust. Sprinkle rubbish and debris with water to keep dust to a minimum. Do not use water if it results in hazardous or objectionable condition such as, but not limited to; ice, flooding, or pollution.
 - F. In addition to previously listed fire and safety rules to be observed in performance of work, include following:
 - 1. Wherever a cutting torch or other equipment that might cause a fire is used, provide and maintain fire extinguishers nearby ready for immediate use. Instruct all possible users in use of fire extinguishers.
 - 2. Keep hydrants clear and accessible at all times. Prohibit debris from accumulating within a radius of 4500 mm (15 feet) of fire hydrants.
 - G. Before beginning any demolition work, the Contractor shall survey the site and examine the drawings and specifications to determine the extent of the work. The contractor shall take necessary precautions to avoid damages to existing items to remain in place, to be reused, or to remain the property of the Medical Center; any damaged items shall be repaired or replaced as approved by the COTR. The Contractor shall coordinate the work of this section with all other work and shall construct and maintain shoring, bracing, and supports as required. The Contractor shall ensure that structural elements are not overloaded and shall be responsible for increasing structural supports or adding new supports as may be required as a result of any cutting, removal, or demolition work performed under this contract. Do not overload structural elements. Provide new supports and reinforcement for existing construction weakened by demolition or removal works. Repairs, reinforcement, or structural replacement must have COTR's approval.
 - H. The work shall comply with the requirements of Section 01 57 19, TEMPORARY ENVIRONMENTAL CONTROLS.
 - I. The work shall comply with the requirements of Section 01 00 00, GENERAL REQUIREMENTS, Article 1.8 INFECTION PREVENTION MEASURES.

1.4 UTILITY SERVICES:

- A. Demolish and remove outside utility service lines shown to be removed.

- B. Remove abandoned outside utility lines that would interfere with installation of new utility lines and new construction.

PART 2 - PRODUCTS (NOT USED)

PART 3 - EXECUTION

3.1 DEMOLITION:

- A. Completely demolish and remove buildings and structures, including all appurtenances related or connected thereto, as noted below:
 - 1. As required for installation of new utility service lines.
 - 2. To full depth within an area defined by hypothetical lines located 1500 mm (5 feet) outside building lines of new structures.
- B. Debris, including brick, concrete, stone, metals and similar materials shall become property of Contractor and shall be disposed of by him daily, off the Medical Center to avoid accumulation at the demolition site. Materials that cannot be removed daily shall be stored in areas specified by the Resident Engineer. Break up concrete slabs below grade that do not require removal from present location into pieces not exceeding 600 mm (24 inches) square to permit drainage. Contractor shall dispose debris in compliance with applicable federal, state or local permits, rules and/or regulations.
- C. Remove and legally dispose of all materials, other than earth to remain as part of project work, from any trash dumps shown. Materials removed shall become property of contractor and shall be disposed of in compliance with applicable federal, state or local permits, rules and/or regulations. Materials that are located beneath the surface of the surrounding ground more than 1500 mm (5 feet), or materials that are discovered to be hazardous, shall be handled as unforeseen. The removal of hazardous material shall be referred to Hazardous Materials specifications.
- E. Remove existing utilities as indicated or uncovered by work and terminate in a manner conforming to the nationally recognized code covering the specific utility and approved by the COTR. When Utility lines are encountered that are not indicated on the drawings, the COTR shall be notified prior to further work in that area.

3.2 CLEAN-UP:

On completion of work of this section and after removal of all debris, leave site in clean condition satisfactory to COTR. Clean-up shall include off the Medical Center disposal of all items and materials not

required to remain property of the Government as well as all debris and rubbish resulting from demolition operations.

- - - E N D - - -

**SECTION 03 30 00
CAST-IN-PLACE CONCRETE**

PART 1 - GENERAL

1.1 DESCRIPTION:

This section specifies cast-in-place structural concrete and materials and mixes for other concrete.

1.2 RELATED WORK:

- A. Materials testing and inspection during construction: Section 01 45 29, TESTING LABORATORY SERVICES.
- B. Concrete roads, walks, and similar exterior site work: Section 32 05 23, CEMENT AND CONCRETE FOR EXTERIOR IMPROVEMENTS.

1.3 TESTING AGENCY FOR CONCRETE MIX DESIGN:

- A. Testing agency retained and reimbursed by the Contractor and approved by Contracting Officer's Technical Representative (COTR).
- B. Testing agency maintaining active participation in Program of Cement and Concrete Reference Laboratory (CCRL) of National Institute of Standards and Technology. Accompany request for approval of testing agency with a copy of Report of Latest Inspection of Laboratory Facilities by CCRL.
- C. Testing agency shall furnish equipment and qualified technicians to establish proportions of ingredients for concrete mixes.

1.4 TOLERANCES:

- A. Formwork: ACI 117, except the elevation tolerance of formed surfaces before removal of shores is +0 mm (+0 inch) and -20 mm (-3/4 inch).
- B. Reinforcement Fabricating and Placing: ACI 117, except that fabrication tolerance for bar sizes Nos. 10, 13, and 16 (Nos. 3, 4, and 5) (Tolerance Symbol 1 in Fig. 2.1(a), ACI, 117) used as column ties or stirrups is +0 mm (+0 inch) and -13 mm (-1/2 inch) where gross bar length is less than 3600 mm (12 feet), or +0 mm (+0 inch) and -20 mm (-3/4 inch) where gross bar length is 3600 mm (12 feet) or more.
- C. Cross-Sectional Dimension: ACI 117, except tolerance for thickness of slabs 12 inches or less is +20 mm (+3/4 inch) and - 6 mm (-1/4 inch). Tolerance of thickness of beams more than 300 mm (12 inch) but less than 900 mm (3 feet) is +20 mm (+3/4 inch) and -10 mm (-3/8 inch).
- D. Slab Finishes: ACI 117, Section 4.5.6, F-number method in accordance with ASTM E1155, except as follows:

1. Test entire slab surface, including those areas within 600 mm (2 feet) of construction joints and vertical elements that project through slab surface.
2. Maximum elevation change which may occur within 600 mm (2 feet) of any column or wall element is 6 mm (0.25 inches).
3. Allow sample measurement lines that are perpendicular to construction joints to extend past joint into previous placement no further than 1500 mm (5 feet).

1.5 REGULATORY REQUIREMENTS:

- A. ACI SP-66 - ACI Detailing Manual.
- B. ACI 318 - Building Code Requirements for Reinforced Concrete.
- C. ACI 301 - Standard Specifications for Structural Concrete.

1.6 SUBMITTALS:

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Shop Drawings: Reinforcing steel: Complete shop drawings
- C. Mill Test Reports:
 1. Reinforcing Steel.
 2. Cement.
- D. Manufacturer's Certificates:
 1. Abrasive aggregate.
 2. Air-entraining admixture.
 3. Chemical admixtures, including chloride ion content.
 4. Waterproof paper for curing concrete.
 5. Liquid membrane-forming compounds for curing concrete.
 6. Non-shrinking grout.
 7. Waterstops.
 8. Expansion joint filler.
 9. Adhesive binder.
- E. Testing Agency for Concrete Mix Design: Approval request including qualifications of principals and technicians and evidence of active participation in program of Cement and Concrete Reference Laboratory (CCRL) of National Institute of Standards and Technology and copy of report of latest CCRL, Inspection of Laboratory.
- F. Test Report for Concrete Mix Designs: Trial mixes including water-cement, fly ash ratio curves, concrete mix ingredients, and admixtures.

1.7 DELIVERY, STORAGE, AND HANDLING:

- A. Conform to ACI 304. Store aggregate separately for each kind or grade, to prevent segregation of sizes and avoid inclusion of dirt and other materials.
- B. Deliver cement in original sealed containers bearing name of brand and manufacturer, and marked with net weight of contents. Store in suitable watertight building in which floor is raised at least 300 mm (1 foot) above ground. Store bulk cement and fly ash in separate suitable bins.
- C. Deliver other packaged materials for use in concrete in original sealed containers, plainly marked with manufacturer's name and brand, and protect from damage until used.

1.8 PRE-CONCRETE CONFERENCE:

- A. General: At least 15 days prior to submittal of design mixes, conduct a meeting to review proposed methods of concrete construction to achieve the required results.
- B. Agenda: Includes but is not limited to:
 - 1. Submittals.
 - 2. Coordination of work.
 - 3. Availability of material.
 - 4. Concrete mix design including admixtures.
 - 5. Methods of placing, finishing, and curing.
 - 6. Finish criteria required to obtain required flatness and levelness.
 - 7. Timing of floor finish measurements.
 - 8. Material inspection and testing.
- C. Attendees: Include but not limited to representatives of Contractor; subcontractors involved in supplying, conveying, placing, finishing, and curing concrete; lightweight aggregate manufacturer; admixture manufacturers; COTR; Consulting Engineer; testing laboratories for concrete testing and finish (F-number) verification.
- D. Minutes of the meeting: Contractor shall take minutes and type and distribute the minutes to attendees within five days of the meeting.

1.9 APPLICABLE PUBLICATIONS:

- A. Publications listed below form a part of this specification to extent referenced. Publications are referenced in text by basic designation only.
- B. American Concrete Institute (ACI):
 - 117-10.....Tolerances for Concrete Construction and Materials

- 211.1-91(R2009).....Selecting Proportions for Normal, Heavyweight,
and Mass Concrete
- 214R-02.....Evaluation of Strength Test Results of Concrete
- 301-10.....Structural Concrete
- 304R-00(R2009).....Guide for Measuring, Mixing, Transporting, and
Placing Concrete
- 305R-10.....Hot Weather Concreting
- 306R-10.....Cold Weather Concreting
- 308R-01(R2008).....Standard Practice for Curing Concrete
- 309R-05.....Guide for Consolidation of Concrete
- 318-08.....Building Code Requirements for Reinforced
Concrete and Commentary
- 347-04.....Guide to Formwork for Concrete
- SP-66-04.....ACI Detailing Manual
- C. American National Standards Institute and American Hardboard
Association (ANSI/AHA):
- A135.4-2004.....Basic Hardboard
- D. American Society for Testing and Materials (ASTM):
- A82/A82M-07.....Steel Wire, Plain, for Concrete Reinforcement
- A185/185M-07.....Steel Welded Wire Fabric, Plain, for Concrete
Reinforcement
- A615/A615M-09.....Deformed and Plain Billet-Steel Bars for
Concrete Reinforcement
- A653/A653M-09.....Steel Sheet, Zinc-Coated (Galvanized) or Zinc-
Iron Alloy-Coated (Galvannealed) by the Hot-Dip
Process
- C31/C31M-09.....Making and Curing Concrete Test Specimens in
the field
- C33-08.....Concrete Aggregates
- C39/C39M-09.....Compressive Strength of Cylindrical Concrete
Specimens
- C94/C94M-09.....Ready-Mixed Concrete
- C150-09.....Portland Cement
- C171-07.....Sheet Materials for Curing Concrete
- C172-08.....Sampling Freshly Mixed Concrete
- C173-10.....Air Content of Freshly Mixed Concrete by the
Volumetric Method

- C192/C192M-07.....Making and Curing Concrete Test Specimens in
the Laboratory
- C231-09.....Air Content of Freshly Mixed Concrete by the
Pressure Method
- C260-06.....Air-Entraining Admixtures for Concrete
- C309-07.....Liquid Membrane-Forming Compounds for Curing
Concrete
- C494/C494M-10.....Chemical Admixtures for Concrete
- C618-08.....Coal Fly Ash and Raw or Calcined Natural
Pozzolan for Use as a Mineral Admixture in
Concrete
- C666/C666M-03.....Resistance of Concrete to Rapid Freezing and
Thawing
- C881/C881M-02.....Epoxy-Resin-Base Bonding Systems for Concrete
- C1107/1107M-08.....Packaged Dry, Hydraulic-Cement Grout (Non-
shrink)
- C1315-08.....Liquid Membrane-Forming Compounds Having
Special Properties for Curing and Sealing
Concrete
- D6-95(R2006).....Loss on Heating of Oil and Asphaltic Compounds
- D297-93(R2006).....Rubber Products-Chemical Analysis
- D1751-04(R2008).....Preformed Expansion Joint Filler for Concrete
Paving and Structural Construction (Non-
extruding and Resilient Bituminous Types)
- D4397-09.....Polyethylene Sheeting for Construction,
Industrial and Agricultural Applications
- E1155-96(R2008).....Determining F_F Floor Flatness and F_L Floor
Levelness Numbers
- E. American Welding Society (AWS):
- D1.4/D1.4M-11.....Structural Welding Code - Reinforcing Steel
- F. Concrete Reinforcing Steel Institute (CRSI):
- Handbook 2008
- G. U. S. Department of Commerce Product Standard (PS):
- PS 1.....Construction and Industrial Plywood
- PS 20.....American Softwood Lumber
- H. U. S. Army Corps of Engineers Handbook for Concrete and Cement:
- CRD C513.....Rubber Waterstops
- CRD C572.....Polyvinyl Chloride Waterstops

PART 2 - PRODUCTS:**2.1 FORMS:**

- A. Wood: PS 20 free from loose knots and suitable to facilitate finishing concrete surface specified; tongue and grooved.
- B. Plywood: PS-1 Exterior Grade B-B (concrete-form) 16 mm (5/8 inch), or 20 mm (3/4 inch) thick for unlined contact form. B-B High Density Concrete Form Overlay optional.
- C. Metal for Concrete Rib-Type Construction: Steel (removal type) of suitable weight and form to provide required rigidity.
- D. Permanent Steel Form for Concrete Slabs: Corrugated, ASTM A653, Grade E, and Galvanized, ASTM A653, G90. Provide venting where insulating concrete fill is used.
- E. Corrugated Fiberboard Void Boxes: Double faced, completely impregnated with paraffin and laminated with moisture resistant adhesive, size as shown. Design forms to support not less than 48 KPa (1000 psf) and not lose more than 15 percent of their original strength after being completely submerged in water for 24 hours and then air dried.
- F. Form Lining:
 - 1. Hardboard: ANSI/AHA A135.4, Class 2 with one (SIS) smooth side)
 - 2. Plywood: Grade B-B Exterior (concrete-form) not less than 6 mm (1/4 inch) thick.
 - 3. Plastic, fiberglass, or elastomeric capable of reproducing the desired pattern or texture.
- G. Form Ties: Develop a minimum working strength of 13.35 kN (3000 pounds) when fully assembled. Ties shall be adjustable in length to permit tightening of forms and not have any lugs, cones, washers to act as spreader within form, nor leave a hole larger than 20 mm (3/4 inch) diameter, or a depression in exposed concrete surface, or leave metal closer than 40 mm (1 1/2 inches) to concrete surface. Wire ties not permitted. Cutting ties back from concrete face not permitted.

2.2 MATERIALS:

- A. Portland Cement: ASTM C150 Type I or II.
- B. Fly Ash: ASTM C618, Class C or F including supplementary optional requirements relating to reactive aggregates and alkalies, and loss on ignition (LOI) not to exceed 5 percent.
- C. Coarse Aggregate: ASTM C33.
 - 1. Size 67 or Size 467 may be used for footings and walls over 300 mm (12 inches) thick.

2. Coarse aggregate for applied topping, encasement of steel columns, and metal pan stair fill shall be Size 7.
 3. Maximum size of coarse aggregates not more than one-fifth of narrowest dimension between sides of forms, one-third of depth of slabs, nor three-fourth of minimum clear spacing between reinforcing bars.
- D. Fine Aggregate: ASTM C33. Fine aggregate for applied concrete floor topping shall pass a 4.75 mm (No. 4) sieve, 10 percent maximum shall pass a 150 μ m (No. 100) sieve.
- E. Mixing Water: Fresh, clean, and potable.
- F. Admixtures:
1. Water Reducing Admixture: ASTM C494, Type A and not contain more chloride ions than are present in municipal drinking water.
 2. Water Reducing, Retarding Admixture: ASTM C494, Type D and not contain more chloride ions than are present in municipal drinking water.
 3. High-Range Water-Reducing Admixture (Superplasticizer): ASTM C494, Type F or G, and not contain more chloride ions than are present in municipal drinking water.
 4. Non-Corrosive, Non-Chloride Accelerator: ASTM C494, Type C or E, and not contain more chloride ions than are present in municipal drinking water. Admixture manufacturer must have long-term non-corrosive test data from an independent testing laboratory of at least one year duration using an acceptable accelerated corrosion test method such as that using electrical potential measures.
 5. Air Entraining Admixture: ASTM C260.
 6. Calcium Nitrite corrosion inhibitor: ASTM C494 Type C.
 7. Prohibited Admixtures: Calcium chloride, thiocyanate or admixtures containing more than 0.05 percent chloride ions are not permitted.
 8. Certification: Written conformance to the requirements above and the chloride ion content of the admixture prior to mix design review.
- G. Vapor Barrier: ASTM D4397, 0.25 mm (10 mil).
- H. Reinforcing Steel: ASTM A615, or ASTM A996, deformed, grade as shown.
- I. Welded Wire Fabric: ASTM A185.
- J. Reinforcement for Metal Pan Stair Fill: 50 mm (2 inch) wire mesh, either hexagonal mesh at .8Kg/m² (1.5 pounds per square yard), or square mesh at .6Kg/m² (1.17 pounds per square yard).

- K. Supports, Spacers, and Chairs: Types which will hold reinforcement in position shown in accordance with requirements of ACI 318 except as specified.
- L. Expansion Joint Filler: ASTM D1751.
- M. Sheet Materials for Curing Concrete: ASTM C171.
- N. Liquid Membrane-forming Compounds for Curing Concrete: ASTM C309, Type I, with fugitive dye. Compound shall be compatible with scheduled surface treatment, such as paint and resilient tile, and shall not discolor concrete surface.
- O. Abrasive Aggregate: Aluminum oxide grains or emery grits.
- P. Moisture Vapor Emissions & Alkalinity Control Sealer: 100% active colorless aqueous silicate solution concrete surface treatment applied the day of the concrete pour in lieu of other curing methods for all concrete slabs receiving resilient flooring, such as, sheet vinyl, vinyl composition tile, rubber, wood flooring, carpet, epoxy coatings and overlays .
 - 1. ASTM C1315 Type 1 Class A, and ASTM C309 Type 1 Class A, penetrating product to have no less than 34% solid content, leaving no sheen, volatile organic compound (VOC) content rating as required to suite regulatory requirements. The product shall have at least a five (5) year documented history in controlling moisture vapor emission from damaging floor covering, compatible with all finish materials.
 - 2. MVE 15-Year Warranty:
 - a. When a floor covering is installed on a below grade, on grade, or above grade concrete slab treated with Moisture Vapor Emissions & Alkalinity Control Sealer according to manufacturer's instruction, sealer manufacturer shall warrant the floor covering system against failure due to moisture vapor migration or moisture-born contaminates for a period of fifteen (15) years from the date of original installation. The warranty shall cover all labor and materials needed to replace all floor covering that fails due to moisture vapor emission & moisture born contaminates.
- Q. Non-Shrink Grout:
 - 1. ASTM C1107, pre-mixed, produce a compressive strength of at least 18 MPa at three days and 35 MPa (5000 psi) at 28 days. Furnish test data from an independent laboratory indicating that the grout when

placed at a fluid consistency shall achieve 95 percent bearing under a 1200 mm x 1200 mm (4 foot by 4 foot) base plate.

2. Where high fluidity or increased placing time is required, furnish test data from an independent laboratory indicating that the grout when placed at a fluid consistency shall achieve 95 percent under an 450 mm x 900 mm (18 inch by 36 inch) base plate.

R. Adhesive Binder: ASTM C881.

1. Polyvinyl Chloride Waterstop: CRD C572.
2. Rubber Waterstops: CRD C513.
3. Porous Backfill: Crushed stone or gravel graded from 25 mm to 20 mm (1 inch to 3/4 inch).
4. Synthetic Fibers: Monofilament or fibrillated polypropylene fibers for secondary reinforcing of concrete members. Use appropriate length and 0.9 kg/m^3 (1.5 lb. per cubic yard). Product shall have a UL rating.
5. Steel Fibers: ASTM A820, Type I cold drawn, high tensile steel wire for use as primary reinforcing in slab-on-grade. Minimum dosage rate 18 kg/m^3 (30 lb. per cubic yard).
6. Epoxy Joint Filler: Two component, 100 percent solids compound, with a minimum shore D hardness of 50.
7. Bonding Admixture: Non-rewettable, polymer modified, bonding compound.

2.3 CONCRETE MIXES:

- A. Mix Designs: Proportioned in accordance with Section 5.3, "Proportioning on the Basis of Field Experience and/or Trial Mixtures" of ACI 318.
1. Submit a report of results of each test series, include a detailed listing of the proportions of trial mix or mixes, including cement, fly ash, admixtures, weight of fine and coarse aggregate per m^3 (cubic yard) measured dry rodded and damp loose, specific gravity, fineness modulus, percentage of moisture, air content, water-cement -fly ash ratio, and consistency of each cylinder in terms of slump.
 2. Prepare a curve showing relationship between water-cement -fly ash ratio at 7-day and 28-day compressive strengths. Plot each curve using at least three specimens.
 3. If the field experience method is used, submit complete standard deviation analysis.

- B. Fly Ash Testing: Submit certificate verifying conformance with specifications initially with mix design and for each truck load of fly ash delivered from source. Notify COTR immediately when change in source is anticipated. Prior to beginning trial mixes submit to the COTR the following representative samples of material to be used, properly identified source and project description and number, type of testing (complete chemical and physical), suitably packaged for shipment, and addressed as specified. Allow 60 calendar days for test results after submittal of sample.
1. Fly ash - 2.25 kg (five pounds).
 2. Portland cement - 3.5 kg (8 pounds):
 - a. Address -Waterways Experiment Station (WES)
 - b. 3909 Halls Ferry Road
 - c. Vicksburg, MS 39180-6199
 - d. ATTN: Engineering Materials Group
- C. After approval of mixes no substitution in material or change in proportions of approval mixes may be made without additional tests and approval of COTR or as specified. Making and testing of preliminary test cylinders may be carried on pending approval of cement and fly ash, providing Contractor and manufacturer certify that ingredients used in making test cylinders are the same. COTR may allow Contractor to proceed with depositing concrete for certain portions of work, pending final approval of cement and fly ash and approval of design mix.
- D. Cement Factor: Maintain minimum cement factors in Table I regardless of compressive strength developed above minimums. Use Fly Ash as an admixture with 20% replacement by weight in all structural work. Increase this replacement to 40% for mass concrete, and reduce it to 10% for drilled piers and caissons.

TABLE I - CEMENT AND WATER FACTORS FOR CONCRETE

Concrete Strength		Non-Air-Entrained	Air-Entrained	
Min. 28 Day Comp. Str. MPa (psi)	Min. Cement kg/m ³ (lbs/c. yd)	Max. Water Cement Ratio	Min. Cement kg/m ³ (lbs/c. yd)	Max. Water Cement Ratio
35 (5000) ^{1,3}	375 (630)	0.45	385 (650)	0.40
30 (4000) ^{1,3}	325 (550)	0.55	340 (570)	0.50
25 (3000) ^{1,3}	280 (470)	0.65	290 (490)	0.55
25 (3000) ^{1,2}	300 (500)	*	310 (520)	*

1. If trial mixes are used, the proposed mix design shall achieve a compressive strength 8.3 MPa (1200 psi) in excess of f'_c . For concrete strengths above 35 Mpa (5000 psi), the proposed mix design shall achieve a compressive strength 9.7 MPa (1400 psi) in excess of f'_c .
 2. For concrete exposed to high sulfate content soils maximum water cement ratio is 0.44.
 3. Determined by Laboratory in accordance with ACI 211.1 for normal concrete or ACI 211.2 for lightweight structural concrete.
- E. Maximum Slump: Maximum slump, as determined by ASTM C143 with tolerances as established by ASTM C94, for concrete to be vibrated shall be as shown in Table II.

TABLE II - MAXIMUM SLUMP, MM (INCHES)*

Type of Construction	Normal Weight Concrete	Lightweight Structural Concrete
Reinforced Footings and Substructure Walls	75mm (3 inches)	N/A
Slabs, Beams, Reinforced Walls, and Building Columns	100 mm (4 inches)	N/A

- F. Slump may be increased by the use of the approved high-range water-reducing admixture (superplasticizer). Tolerances as established by ASTM C94. Concrete containing the high-range-water-reducing admixture may have a maximum slump of 225 mm (9 inches). The concrete shall arrive at the job site at a slump of 50 mm to 75 mm (2 inches to 3 inches), and 75 mm to 100 mm (3 inches to 4 inches) for lightweight

concrete. This should be verified, and then the high-range-water-reducing admixture added to increase the slump to the approved level.

- G. Air-Entrainment: Air-entrainment of normal weight concrete shall conform with Table III. Determine air content by either ASTM C173 or ASTM C231.

**TABLE III - TOTAL AIR CONTENT
FOR VARIOUS SIZES OF COARSE AGGREGATES (NORMAL CONCRETE)**

Nominal Maximum Size of Total Air Content	Coarse Aggregate, mm (Inches) Percentage by Volume
10 mm (3/8 in).6 to 10	13 mm (1/2 in).5 to 9
20 mm (3/4 in).4 to 8	25 mm (1 in).3-1/2 to 6-1/2
40 mm (1 1/2 in).3 to 6	

- H. High early strength concrete, made with Type III cement or Type I cement plus non-corrosive accelerator, shall have a 7-day compressive strength equal to specified minimum 28-day compressive strength for concrete type specified made with standard Portland cement.
- I. Concrete slabs placed at air temperatures below 10 degrees C (50 degrees Fahrenheit) use non-corrosive, non-chloride accelerator. Concrete required to be air entrained use approved air entraining admixture. Pumped concrete, synthetic fiber concrete, architectural concrete, concrete required to be watertight, and concrete with a water/cement ratio below 0.50 use high-range water-reducing admixture (superplasticizer).
- J. Durability: Use air entrainment for exterior exposed concrete subjected to freezing and thawing and other concrete shown or specified. Air content as shown in Table III or Table IV.
- K. Enforcing Strength Requirements: Test as specified in Section 01 45 29, TESTING LABORATORY SERVICES, during the progress of the work. Seven-day tests may be used as indicators of 28-day strength. Average of any three 28-day consecutive strength tests of laboratory-cured specimens representing each type of concrete shall be equal to or greater than specified strength. No single test shall be more than 3.5 MPa (500 psi) below specified strength. Interpret field test results in accordance with ACI 214. Should strengths shown by test specimens fall below required values, COTR may require any one or any combination of the following corrective actions, at no additional cost to the Government:

1. Require changes in mix proportions by selecting one of the other appropriate trial mixes or changing proportions, including cement content, of approved trial mix.
2. Require additional curing and protection.
3. If five consecutive tests fall below 95 percent of minimum values given in Table I or if test results are so low as to raise a question as to the safety of the structure, COTR may direct Contractor to take cores from portions of the structure. Use results from cores tested by the Contractor retained testing agency to analyze structure.
4. If strength of core drilled specimens falls below 85 percent of minimum value given in Table I, COTR may order load tests, made by Contractor retained testing agency, on portions of building so affected. Load tests in accordance with ACI 318 and criteria of acceptability of concrete under test as given therein.
5. Concrete work, judged inadequate by structural analysis, by results of load test, or for any reason, shall be reinforced with additional construction or replaced, if directed by the COTR.

2.4 BATCHING AND MIXING:

- A. General: Concrete shall be "Ready-Mixed" and comply with ACI 318 and ASTM C94, except as specified. Batch mixing at the site is permitted. Mixing process and equipment must be approved by COTR. With each batch of concrete, furnish certified delivery tickets listing information in Paragraph 16.1 and 16.2 of ASTM C94. Maximum delivery temperature of concrete is 38°C (100 degrees Fahrenheit). Minimum delivery temperature as follows:

Atmospheric Temperature	Minimum Concrete Temperature
-1. degrees to 4.4 degrees C (30 degrees to 40 degrees F)	15.6 degrees C (60 degrees F.)
-17 degrees C to -1.1 degrees C (0 degrees to 30 degrees F.)	21 degrees C (70 degrees F.)

PART 3 - EXECUTION

3.1 FORMWORK:

- A. General: Design in accordance with ACI 347 is the responsibility of the Contractor. The Contractor shall retain a registered Professional Engineer to design the formwork.

1. Form boards and plywood forms may be reused for contact surfaces of exposed concrete only if thoroughly cleaned, patched, and repaired and COTR approves their reuse.
 2. Provide forms for concrete footings unless COTR determines forms are not necessary.
 3. Corrugated fiberboard forms: Place forms on a smooth firm bed, set tight, with no buckled cartons to prevent horizontal displacement, and in a dry condition when concrete is placed.
- B. Treating and Wetting: Treat or wet contact forms as follows:
1. Coat plywood and board forms with non-staining form sealer. In hot weather, cool forms by wetting with cool water just before concrete is placed.
 2. Clean and coat removable metal forms with light form oil before reinforcement is placed. In hot weather, cool metal forms by thoroughly wetting with water just before placing concrete.
 3. Use sealer on reused plywood forms as specified for new material.
- C. Size and Spacing of Studs: Size and space studs, wales and other framing members for wall forms so as not to exceed safe working stress of kind of lumber used nor to develop deflection greater than $1/270$ of free span of member.
- D. Unlined Forms: Use plywood forms to obtain a smooth finish for concrete surfaces. Tightly butt edges of sheets to prevent leakage. Back up all vertical joints solidly and nail edges of adjacent sheets to same stud with 6d box nails spaced not over 150 mm (6 inches) apart.
- E. Lined Forms: May be used in lieu of unlined plywood forms. Back up form lining solidly with square edge board lumber securely nailed to studs with all edges in close contact to prevent bulging of lining. No joints in lining and backing may coincide. Nail abutted edges of sheets to same backing board. Nail lining at not over 200 mm (8 inches) on center along edges and with at least one nail to each square foot of surface area; nails to be 3d blue shingle or similar nails with thin flatheads.
- F. Wall Form Ties: Locate wall form ties in symmetrically level horizontal rows at each line of wales and in plumb vertical tiers. Space ties to maintain true, plumb surfaces. Provide one row of ties within 150 mm (6 inches) above each construction joint. Space through-ties adjacent to horizontal and vertical construction joints not over 450 mm (18 inches) on center.

1. Tighten row of ties at bottom of form just before placing concrete and, if necessary, during placing of concrete to prevent seepage of concrete and to obtain a clean line. Ties to be entirely removed shall be loosened 24 hours after concrete is placed and shall be pulled from least important face when removed.
 2. Coat surfaces of all metal that is to be removed with paraffin, cup grease or a suitable compound to facilitate removal.
- G. Inserts, Sleeves, and Similar Items: Flashing reglets, steel strips, masonry ties, anchors, wood blocks, nailing strips, grounds, inserts, wire hangers, sleeves, drains, guard angles, forms for floor hinge boxes, inserts or bond blocks for elevator guide rails and supports, and other items specified as furnished under this and other sections of specifications and required to be in their final position at time concrete is placed shall be properly located, accurately positioned, and built into construction, and maintained securely in place.
1. Locate inserts or hanger wires for furred and suspended ceilings only in bottom of concrete joists, or similar concrete member of overhead concrete joist construction.
 2. Install sleeves, inserts and similar items for mechanical services in accordance with drawings prepared specially for mechanical services. Contractor is responsible for accuracy and completeness of drawings and shall coordinate requirements for mechanical services and equipment.
 3. Minimum clear distance of embedded items such as conduit and pipe is at least three times diameter of conduit or pipe, except at stub-ups and other similar locations.
 4. Provide recesses and blockouts in floor slabs for door closers and other hardware as necessary in accordance with manufacturer's instructions.
- H. Construction Tolerances:
1. Set and maintain concrete formwork to assure erection of completed work within tolerances specified and to accommodate installation of other rough and finish materials. Accomplish remedial work necessary for correcting excessive tolerances. Erected work that exceeds specified tolerance limits shall be remedied or removed and replaced, at no additional cost to the Government.
 2. Permissible surface irregularities for various classes of materials are defined as "finishes" in specification sections covering

individual materials. They are to be distinguished from tolerances specified which are applicable to surface irregularities of structural elements.

3.2 PLACING REINFORCEMENT:

- A. General: Details of concrete reinforcement in accordance with ACI 318 unless otherwise shown.
- B. Placing: Place reinforcement conforming to CRSI DA4, unless otherwise shown.
 - 1. Place reinforcing bars accurately and tie securely at intersections and splices with 1.6 mm (16 gauge) black annealed wire. Secure reinforcing bars against displacement during the placing of concrete by spacers, chairs, or other similar supports. Portions of supports, spacers, and chairs in contact with formwork shall be made of plastic in areas that will be exposed when building is occupied. Type, number, and spacing of supports conform to ACI 318. Where concrete slabs are placed on ground, use concrete blocks or other non-corrodible material of proper height, for support of reinforcement. Use of brick or stone supports will not be permitted.
 - 2. Lap welded wire fabric at least 1 1/2 mesh panels plus end extension of wires not less than 300 mm (12 inches) in structural slabs. Lap welded wire fabric at least 1/2 mesh panels plus end extension of wires not less than 150 mm (6 inches) in slabs on grade.
- C. Spacing: Minimum clear distances between parallel bars shall be equal to nominal diameter of bars. Minimum clear spacing is 25 mm (1 inch) or 1-1/3 times maximum size of coarse aggregate.
- D. Splicing: Splices of reinforcement made only as required or shown or specified. Accomplish splicing as follows:
 - 1. Lap splices: Do not use lap splices for bars larger than Number 36 (Number 11). Minimum lengths of lap as shown.
 - 2. Welded splices: Splicing by butt-welding of reinforcement permitted providing the weld develops in tension at least 125 percent of the yield strength (f_y) for the bars. Welding conform to the requirements of AWS D1.4. Welded reinforcing steel conform to the chemical analysis requirements of AWS D1.4.
 - a. Submit test reports indicating the chemical analysis to establish weldability of reinforcing steel.
 - b. Submit a field quality control procedure to insure proper inspection, materials and welding procedure for welded splices.

- c. Testing agency shall test a minimum of three splices, for compliance, locations selected by COTR.
- 3. Mechanical Splices: Develop in tension and compression at least 125 percent of the yield strength (fy) of the bars. Stresses of transition splices between two reinforcing bar sizes based on area of smaller bar. Provide mechanical splices at locations indicated. Use approved exothermic, tapered threaded coupling, or swaged and threaded sleeve. Exposed threads and swaging in the field not permitted.
 - a. Initial qualification: In the presence of COTR, make three test mechanical splices of each bar size proposed to be spliced. Testing laboratory will perform load test.
 - b. During installation: Furnish, at no additional cost to the Government, one companion (sister) splice for every 50 splices for load testing. Testing laboratory will perform the load test.
- E. Bending: Bend bars cold, unless otherwise approved. Do not field bend bars partially embedded in concrete, except when approved by COTR.
- F. Cleaning: Metal reinforcement, at time concrete is placed, shall be free from loose flaky rust, mud, oil, or similar coatings that will reduce bond.

3.3 VAPOR BARRIER:

- A. Except where membrane waterproofing is required, interior concrete slab on grade shall be placed on a continuous vapor barrier.
 - 1. Place 100 mm (4 inches) of fine granular fill over the vapor barrier to act as a blotter for concrete slab.
 - 2. Vapor barrier joints lapped 150 mm (6 inches) and sealed with compatible waterproof pressure-sensitive tape. All joints to be cleaned prior to application of joint tape.
 - 3. Patch punctures and tears.

3.4 MOISTURE VAPOR EMISSIONS & ALKALINITY CONTROL SEALER:

- A. Sealer is applied on the day of the concrete pour or as as soon as harsh weather permits, prior to any other chemical treatments for concrete slabs either on grade, below grade or above grade receiving resilient flooring, such as, sheet vinyl, vinyl composition tile, rubber, wood flooring, carpet, epoxy coatings and overlays.
- B. Manufacturer's representative will be on the site the day of concrete pour to install or train its application and document. He shall return

on every application thereafter to verify that proper procedures are followed.

1. Apply Sealer to concrete slabs as soon as final finishing operations are complete and the concrete has hardened sufficiently to sustain floor traffic without damage.
2. Spray apply Sealer at the rate of 20 m² (200 square feet) per gallon. Lightly broom product evenly over the substrate and product has completely penetrated the surface.
3. If within two (2) hours after initial application areas are subjected to heavy rainfall and puddling occurs, reapply Sealer product to these areas as soon as weather condition permits.

3.5 CONSTRUCTION JOINTS:

- A. Unless otherwise shown, location of construction joints to limit individual placement shall not exceed 24,000 mm (80 feet) in any horizontal direction, except slabs on grade which shall have construction joints shown. Allow 48 hours to elapse between pouring adjacent sections unless this requirement is waived by COTR.
- B. Locate construction joints in suspended floors near the quarter-point of spans for slabs. Provide longitudinal keys as shown.

3.6 EXPANSION JOINTS:

- A. Clean expansion joint surfaces before installing premolded filler and placing adjacent concrete.

3.7 PLACING CONCRETE:

- A. Preparation:
 1. Remove hardened concrete, wood chips, shavings and other debris from forms.
 2. Remove hardened concrete and foreign materials from interior surfaces of mixing and conveying equipment.
 3. Have forms and reinforcement inspected and approved by COTR before depositing concrete.
 4. Provide runways for wheeling equipment to convey concrete to point of deposit. Keep equipment on runways which are not supported by or bear on reinforcement. Provide similar runways for protection of vapor barrier on coarse fill.
- B. Bonding: Before depositing new concrete on or against concrete which has been set, thoroughly roughen and clean existing surfaces of laitance, foreign matter, and loose particles.
 1. Preparing surface for applied topping:

- a. Remove laitance, mortar, oil, grease, paint, or other foreign material by sand blasting. Clean with vacuum type equipment to remove sand and other loose material.
 - b. Broom clean and keep base slab wet for at least four hours before topping is applied.
 - c. Use a thin coat of one part Portland cement, 1.5 parts fine sand, bonding admixture; and water at a 50: 50 ratio and mix to achieve the consistency of thick paint. Apply to a damp base slab by scrubbing with a stiff fiber brush. New concrete shall be placed while the bonding grout is still tacky.
- C. Conveying Concrete: Convey concrete from mixer to final place of deposit by a method which will prevent segregation. Method of conveying concrete subject to approval of COTR.
- D. Placing: For special requirements see Paragraphs, HOT WEATHER and COLD WEATHER.
1. Do not place concrete when weather conditions prevent proper placement and consolidation, or when concrete has attained its initial set, or has contained its water or cement content more than 1 1/2 hours.
 2. Deposit concrete in forms as near as practicable in its final position. Prevent splashing of forms or reinforcement with concrete in advance of placing concrete.
 3. Do not drop concrete freely more than 3000 mm (10 feet) for concrete containing the high-range water-reducing admixture (superplasticizer) or 1500 mm (5 feet) for conventional concrete. Where greater drops are required, use a tremie or flexible spout (canvas elephant trunk), attached to a suitable hopper.
 4. Discharge contents of tremies or flexible spouts in horizontal layers not exceeding 500 mm (20 inches) in thickness, and space tremies such as to provide a minimum of lateral movement of concrete.
 5. Continuously place concrete until an entire unit between construction joints is placed. Rate and method of placing concrete shall be such that no concrete between construction joints will be deposited upon or against partly set concrete, after it's initial set has taken place, or after 45 minutes of elapsed time during concrete placement.

6. On bottom of members with severe congestion of reinforcement, deposit 25 mm (1 inch) layer of flowing concrete containing the specified high-range water-reducing admixture (superplasticizer). Successive concrete lifts may be a continuation of this concrete or concrete with a conventional slump.
7. Concrete on metal deck:
 - a. Concrete on metal deck shall be minimum thickness shown. Allow for deflection of steel beams and metal deck under the weight of wet concrete in calculating concrete quantities for slab.
 - 1) The Contractor shall become familiar with deflection characteristics of structural frame. Uniform slab thickness above metal deck shall be provided.
- E. Consolidation: Conform to ACI 309. Immediately after depositing, spade concrete next to forms, work around reinforcement and into angles of forms, tamp lightly by hand, and compact with mechanical vibrator applied directly into concrete at approximately 450 mm (18 inch) intervals. Mechanical vibrator shall be power driven, hand operated type with minimum frequency of 5000 cycles per minute having an intensity sufficient to cause flow or settlement of concrete into place. Vibrate concrete to produce thorough compaction, complete embedment of reinforcement and concrete of uniform and maximum density without segregation of mix. Do not transport concrete in forms by vibration.
 1. Use of form vibration shall be approved only when concrete sections are too thin or too inaccessible for use of internal vibration.
 2. Carry on vibration continuously with placing of concrete. Do not insert vibrator into concrete that has begun to set.

3.8 HOT WEATHER:

Follow the recommendations of ACI 305 or as specified to prevent problems in the manufacturing, placing, and curing of concrete that can adversely affect the properties and serviceability of the hardened concrete. Methods proposed for cooling materials and arrangements for protecting concrete shall be made in advance of concrete placement and approved by COTR.

3.9 COLD WEATHER:

Follow the recommendations of ACI 306 or as specified to prevent freezing of concrete and to permit concrete to gain strength properly. Use only the specified non-corrosive, non-chloride accelerator. Do not

use calcium chloride, thiocyanates or admixtures containing more than 0.05 percent chloride ions. Methods proposed for heating materials and arrangements for protecting concrete shall be made in advance of concrete placement and approved by COTR.

3.10 PROTECTION AND CURING:

- A. Conform to ACI 308: Initial curing shall immediately follow the finishing operation. Protect exposed surfaces of concrete from premature drying, wash by rain and running water, wind, mechanical injury, and excessively hot or cold temperatures. Keep concrete not covered with membrane or other curing material continuously wet for at least 7 days after placing, except wet curing period for high-early-strength concrete shall be not less than 3 days. Keep wood forms continuously wet to prevent moisture loss until forms are removed. Cure exposed concrete surfaces as described below. Other curing methods may be used if approved by COTR.
1. Liquid curing and sealing compounds: Apply by power-driven spray or roller in accordance with the manufacturer's instructions. Apply immediately after finishing. Maximum coverage $10\text{m}^2/\text{L}$ (400 square feet per gallon) on steel troweled surfaces and $7.5\text{m}^2/\text{L}$ (300 square feet per gallon) on floated or broomed surfaces for the curing/sealing compound.
 2. Plastic sheets: Apply as soon as concrete has hardened sufficiently to prevent surface damage. Utilize widest practical width sheet and overlap adjacent sheets 50 mm (2 inches). Tightly seal joints with tape.
 3. Paper: Utilize widest practical width paper and overlap adjacent sheets 50 mm (2 inches). Tightly seal joints with sand, wood planks, pressure-sensitive tape, mastic or glue.

3.11 REMOVAL OF FORMS:

- A. Remove in a manner to assure complete safety of structure after the following conditions have been met.
1. Forms may be removed after 24 hours, provided concrete has hardened sufficiently to prevent surface damage and curing is continued without any lapse in time as specified for exposed surfaces.
 2. Take particular care in removing forms of architectural exposed concrete to insure surfaces are not marred or gouged, and that corners and arises are true, sharp and unbroken.

- B. Control Test: Use to determine if the concrete has attained sufficient strength and curing to permit removal of supporting forms. Cylinders required for control tests taken in accordance with ASTM C172, molded in accordance with ASTM C31, and tested in accordance with ASTM C39. Control cylinders cured and protected in the same manner as the structure they represent. Supporting forms or shoring not removed until strength of control test cylinders have attained at least 70 percent of minimum 28-day compressive strength specified. Exercise care to assure that newly unsupported portions of structure are not subjected to heavy construction or material loading.

3.12 CONCRETE SURFACE PREPARATION:

- A. Metal Removal: Unnecessary metal items cut back flush with face of concrete members.
- B. Patching: Maintain curing and start patching as soon as forms are removed. Do not apply curing compounds to concrete surfaces requiring patching until patching is completed. Use cement mortar for patching of same composition as that used in concrete. Use white or gray Portland cement as necessary to obtain finish color matching surrounding concrete. Thoroughly clean areas to be patched. Cut out honeycombed or otherwise defective areas to solid concrete to a depth of not less than 25 mm (1 inch). Cut edge perpendicular to surface of concrete. Saturate with water area to be patched, and at least 150 mm (6 inches) surrounding before placing patching mortar. Give area to be patched a brush coat of cement grout followed immediately by patching mortar. Cement grout composed of one part Portland cement, 1.5 parts fine sand, bonding admixture, and water at a 50:50 ratio, mix to achieve consistency of thick paint. Mix patching mortar approximately 1 hour before placing and remix occasionally during this period without addition of water. Compact mortar into place and screed slightly higher than surrounding surface. After initial shrinkage has occurred, finish to match color and texture of adjoining surfaces. Cure patches as specified for other concrete. Fill form tie holes which extend entirely through walls from unexposed face by means of a pressure gun or other suitable device to force mortar through wall. Wipe excess mortar off exposed face with a cloth.
- C. Upon removal of forms, clean vertical concrete surface that is to receive bonded applied cementitious application with wire brushes or by sand blasting to remove unset material, laitance, and loose particles

to expose aggregates to provide a clean, firm, granular surface for bond of applied finish.

3.13 CONCRETE FINISHES:

A. Vertical and Overhead Surface Finishes:

1. Unfinished areas: Vertical and overhead concrete surfaces exposed in pipe basements, elevator and dumbwaiter shafts, pipe spaces, pipe trenches, above suspended ceilings, manholes, and other unfinished areas will not require additional finishing.
2. Interior and exterior exposed areas to be painted: Remove fins, burrs and similar projections on surfaces flush, and smooth by mechanical means approved by COTR, and by rubbing lightly with a fine abrasive stone or hone. Use ample water during rubbing without working up a lather of mortar or changing texture of concrete.
3. Interior and exterior exposed areas finished: Give a grout finish of uniform color and smooth finish treated as follows:
 - a. After concrete has hardened and laitance, fins and burrs removed, scrub concrete with wire brushes. Clean stained concrete surfaces by use of a hone stone.
 - b. Apply grout composed of one part of Portland cement, one part fine sand, smaller than a 600 μm (No. 30) sieve. Work grout into surface of concrete with cork floats or fiber brushes until all pits, and honeycombs are filled.
 - c. After grout has hardened slightly, but while still plastic, scrape grout off with a sponge rubber float and, about 1 hour later, rub concrete vigorously with burlap to remove any excess grout remaining on surfaces.
 - d. In hot, dry weather use a fog spray to keep grout wet during setting period. Complete finish of area in same day. Make limits of finished areas at natural breaks in wall surface. Leave no grout on concrete surface overnight.
4. Textured: Finish as specified. Maximum quantity of patched area 0.2 m^2 (2 square feet) in each 93 m^2 (1000 square feet) of textured surface.

B. Slab Finishes:

1. **Monitoring and Adjustment:** Provide continuous cycle of placement, measurement, evaluation and adjustment of procedures to produce slabs within specified tolerances. Monitor elevations of structural steel in key locations before and after concrete placement to establish typical deflection patterns for the structural steel. Determine elevations of cast-in-place slab soffits prior to removal of shores. Provide information to COTR and floor consultant for evaluation and recommendations for subsequent placements.
2. Set perimeter forms to serve as screed using either optical or laser instruments. For slabs on grade, wet screeds may be used to establish initial grade during strike-off, unless COTR determines that the method is proving insufficient to meet required finish tolerances and directs use of rigid screed guides. Where wet screeds are allowed, they shall be placed using grade stakes set by optical or laser instruments. Use rigid screed guides, as opposed to wet screeds, to control strike-off elevation for all types of elevated (non slab-on-grade) slabs. Divide bays into halves or thirds by hard screeds. Adjust as necessary where monitoring of previous placements indicates unshored structural steel deflections to other than a level profile.
3. Place slabs monolithically. Once slab placement commences, complete finishing operations within same day. Slope finished slab to floor drains where they occur, whether shown or not.
4. Use straightedges specifically made for screeding, such as hollow magnesium straightedges or power strike-offs. Do not use pieces of dimensioned lumber. Strike off and screed slab to a true surface at required elevations. Use optical or laser instruments to check concrete finished surface grade after strike-off. Repeat strike-off as necessary. Complete screeding before any excess moisture or bleeding water is present on surface. Do not sprinkle dry cement on the surface.
5. Immediately following screeding, and before any bleed water appears, use a 3000 mm (10 foot) wide highway straightedge in a cutting and filling operation to achieve surface flatness. Do not use bull floats or darbys, except that darbying may be allowed for narrow slabs and restricted spaces.

6. Wait until water sheen disappears and surface stiffens before proceeding further. Do not perform subsequent operations until concrete will sustain foot pressure with maximum of 6 mm (1/4 inch) indentation.
7. Scratch Finish: Finish base slab to receive a bonded applied cementitious application as indicated above, except that bull floats and darbys may be used. Thoroughly coarse wire broom within two hours after placing to roughen slab surface to insure a permanent bond between base slab and applied materials.
8. Float Finish: Slabs to receive unbonded toppings, steel trowel finish, fill, mortar setting beds, or a built-up roof, and ramps, stair treads, platforms (interior and exterior), and equipment pads shall be floated to a smooth, dense uniform, sandy textured finish. During floating, while surface is still soft, check surface for flatness using a 3000 mm (10 foot) highway straightedge. Correct high spots by cutting down and correct low spots by filling in with material of same composition as floor finish. Remove any surface projections and re-float to a uniform texture.
9. Steel Trowel Finish: Concrete surfaces to receive resilient floor covering or carpet, monolithic floor slabs to be exposed to view in finished work, future floor roof slabs, applied toppings, and other interior surfaces for which no other finish is indicated. Steel trowel immediately following floating. During final troweling, tilt steel trowel at a slight angle and exert heavy pressure to compact cement paste and form a dense, smooth surface. Finished surface shall be smooth, free of trowel marks, and uniform in texture and appearance.
10. Broom Finish: Finish exterior slabs, ramps, and stair treads with a bristle brush moistened with clear water after surfaces have been floated. Brush in a direction transverse to main traffic. Match texture approved by COTR from sample panel.
11. Finished slab flatness (FF) and levelness (FL) values comply with the following minimum requirements:
 - a. Areas covered with carpeting, or not specified otherwise in b. below:
 - 1) Slab on Grade:

a) Specified overall value	$F_F 25/F_L 20$
b) Minimum local value	$F_F 17/F_L 15$

- 2) Level suspended slabs (shored until after testing) and topping slabs:
 - a) Specified overall value FF 25/FL 20
 - b) Minimum local value FF 17/FL 15
 - 3) Level tolerance such that 80 percent of all points fall within a 20 mm (3/4 inch) envelope +10 mm, -10 mm (+3/8 inch, -3/8 inch) from the design elevation.
 - b. Areas that will be exposed, receive thin-set tile or resilient flooring, or roof areas designed as future floors:
 - 1) Slab on grade:
 - a) Specified overall value FF 36/FL 20
 - b) Minimum local value FF 24/FL 15
 - 2) Level suspended slabs (shored until after testing) and topping slabs
 - a) Specified overall value FF 30/FL 20
 - b) Minimum local value FF 24/FL 15
 - 3) Unshored suspended slabs:
 - a) Specified overall value FF 30
 - b) Minimum local value FF 24
 - 4) Level tolerance such that 80 percent of all points fall within a 20 mm (3/4 inch) envelope +10 mm, -10 mm (+3/8 inch, -3/8 inch) from the design elevation.
 - c. "Specified overall value" is based on the composite of all measured values in a placement derived in accordance with ASTM E1155.
 - d. "Minimum local value" (MLV) describes the flatness or levelness below which repair or replacement is required. MLV is based on the results of an individual placement and applies to a minimum local area. Minimum local area boundaries may not cross a construction joint or expansion joint. A minimum local area will be bounded by construction and/or control joints, or by column lines and/or half-column lines, whichever is smaller.
12. Measurements
- a. Testing laboratory will take measurements as directed by COTR, to verify compliance with FF, FL, and other finish requirements. Measurements will occur within 72 hours after completion of concrete placement (weekends and holidays excluded). Make measurements before shores or forms are removed to insure the

"as-built" levelness is accurately assessed. Profile data for above characteristics may be collected using a laser level or any Type II apparatus (ASTM E1155, "profileograph" or "dipstick"). Contractor's surveyor shall establish reference elevations to be used by Testing laboratory.

- b. Contractor not experienced in using FF and FL criteria is encouraged to retain the services of a floor consultant to assist with recommendations concerning adjustments to slab thicknesses, finishing techniques, and procedures on measurements of the finish as it progresses in order to achieve the specific flatness and levelness numbers.

13. Acceptance/ Rejection:

- a. If individual slab section measures less than either of specified minimum local F_F/F_L numbers, that section shall be rejected and remedial measures shall be required. Sectional boundaries may be set at construction and contraction (control) joints, and not smaller than one-half bay.
- b. If composite value of entire slab installation, combination of all local results, measures less than either of specified overall F_F/F_L numbers, then whole slab shall be rejected and remedial measures shall be required.

14. Remedial Measures for Rejected Slabs: Correct rejected slab areas by grinding, planing, surface repair with underlayment compound or repair topping, retopping, or removal and replacement of entire rejected slab areas, as directed by COTR, until a slab finish constructed within specified tolerances is accepted.

3.14 SURFACE TREATMENTS:

- A. Use on exposed concrete floors and concrete floors to receive carpeting except those specified to receive non-slip finish.
- B. Liquid Densifier/Sealer: Apply in accordance with manufacturer's directions just prior to completion of construction.
- C. Non-Slip Finish: Except where safety nosing and tread coverings are shown, apply non-slip abrasive aggregate to treads and platforms of concrete steps and stairs, and to surfaces of exterior concrete ramps and platforms. Broadcast aggregate uniformly over concrete surface at rate of application of 8% per 1/10th m^2 (7.5 percent per square foot) of area. Trowel concrete surface to smooth dense finish. After curing, rub

treated surface with abrasive brick and water to slightly expose abrasive aggregate.

3.15 RESURFACING FLOORS:

Remove existing flooring areas to receive resurfacing to expose existing structural slab and extend not less than 25 mm (1 inch) below new finished floor level. Prepare exposed structural slab surface by roughening, broom cleaning, and dampening. Apply specified bonding grout. Place topping while the bonding grout is still tacky.

3.16 RETAINING WALLS:

- A. Use air-entrained concrete.
- B. Expansion and contraction joints, waterstops, weep holes, reinforcement and railing sleeves installed and constructed as shown.
- C. Exposed surfaces finished to match adjacent concrete surfaces, new or existing.
- D. Place porous backfill as shown.

- - - E N D - - -

**SECTION 04 05 13
MASONRY MORTARING**

PART 1 - GENERAL

1.1 DESCRIPTION:

Section specifies mortar materials and mixes.

1.2 RELATED WORK:

A. Mortar used in Section:

1. Section 04 05 16, MASONRY GROUTING.
2. Section 04 20 00, UNIT MASONRY.

B. Mortar Color: Section 09 06 00, SCHEDULE FOR FINISHES.

1.3 TESTING LABORATORY-CONTRACTOR RETAINED

- A. Engage a commercial testing laboratory approved by Contracting Officer's Technical Representative (COTR) to perform tests specified below.
- B. Submit information regarding testing laboratory's facilities and qualifications of technical personnel to COTR.

1.4 TESTS

- A. Test mortar and materials specified.
- B. Certified test reports.
- C. Identify materials by type, brand name and manufacturer or by origin.
- D. Do not use materials until laboratory test reports are approved by COTR.
- E. After tests have been made and materials approved, do not change without additional test and approval of COTR.
- F. Testing:
1. Test materials proposed for use for compliance with specifications in accordance with test methods contained in referenced specifications and as follows:
 2. Mortar:
 - a. Test for compressive strength and water retention; ASTM C270.
 - b. Mortar compressive strengths 28 days as follows:

Type M: Minimum 17230 kPa (2500 psi) at 28 days.

Type S: Minimum 12400 kPa (1800 psi) at 28 days.

Type N: Minimum 5170 kPa (750 psi) at 28 days.
 3. Cement:
 - a. Test for water soluble alkali (nonstaining) when nonstaining cement is specified.

- b. Nonstaining cement shall contain not more than 0.03 percent water soluble alkali.
- 4. Sand: Test for deleterious substances, organic impurities, soundness and grading.
- G. During progress of work, testing laboratory specified in Section 01 45 29, TESTING LABORATORY SERVICES, takes and tests samples as specified in that section. Testing procedures and test methods in ASTM C780.

1.5 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Certificates:
 - 1. Testing laboratory's facilities and qualifications of its technical personnel.
 - 2. Indicating that following items meet specifications:
 - a. Portland cement.
 - b. Masonry cement.
 - c. Mortar cement.
 - d. Hydrated lime.
 - e. Fine aggregate (sand).
 - g. Color admixture.
- C. Laboratory Test Reports:
 - 1. Mortar, each type.
 - 2. Admixtures.
- D. Manufacturer's Literature and Data:
 - 1. Cement, each kind.
 - 2. Hydrated lime.
 - 3. Admixtures.
 - 4. Liquid acrylic resin.

1.6 PRODUCT DELIVERY, STORAGE AND HANDLING

- A. Deliver masonry materials in original sealed containers marked with name of manufacturer and identification of contents.
- B. Store masonry materials under waterproof covers on planking clear of ground, and protect damage from handling, dirt, stain, water and wind.

1.7 APPLICABLE PUBLICATIONS

- A. Publications listed below form a part of specification to extent referenced. Publications are referenced in text by basic designation only.
- B. American Society for Testing and Materials (ASTM):

C40-04.....	Organic Impurities in Fine Aggregates for Concrete
C91-05.....	Masonry Cement
C109-07.....	Compressive Strength of Hydraulic Cement Mortars (Using 2-in. or 50-MM Cube Specimens)
C144-04.....	Aggregate for Masonry Mortar
C150-05.....	Portland Cement
C207-06.....	Hydrated Lime for Masonry Purposes
C270-07.....	Mortar for Unit Masonry
C348-02.....	Flexural Strength of Hydraulic Cement Mortars
C595-08.....	Blended Hydraulic Cement
C780-07.....	Preconstruction and Construction Evaluation of Mortars for Plain and Reinforced Unit Masonry
C1329-05.....	Mortar Cement

PART 2 - PRODUCTS

2.1 HYDRATED LIME

ASTM C207, Type S.

2.2 AGGREGATE FOR MASONRY MORTAR

A. ASTM C144 and as follows:

1. Light colored sand for mortar for laying face brick.
2. White plastering sand meeting sieve analysis for mortar joints for pointing and laying of structural facing tile units except that 100 percent passes No. 8 sieve, and not more than 5 percent retained on No. 16 sieve.

B. Test sand for color value in accordance with ASTM C40. Sand producing color darker than specified standard is unacceptable.

2.3 BLENDED HYDRAULIC CEMENT

ASTM C595, Type IS, IP.

2.4 MASONRY CEMENT

A. ASTM C91. Type N, S, or M.

2.5 MORTAR CEMENT

ASTM C1329, Type N, S or M.

2.6 PORTLAND CEMENT

A. ASTM C150, Type I.

2.7 LIQUID ACRYLIC RESIN

A formulation of acrylic polymers and modifiers in liquid form designed for use as an additive for mortar to improve physical properties.

2.8 WATER

Potable, free of substances that are detrimental to mortar, masonry, and metal.

2.9 MASONRY MORTAR

A. Conform to ASTM C270.

B. Admixtures:

1. Do not use mortar admixtures, and color admixtures unless approved by COTR.
2. Submit laboratory test report showing effect of proposed admixture on strength, water retention, and water repellency of mortar.
3. Do not use antifreeze compounds.

C. Colored Mortar:

1. Maintain uniform mortar color for exposed work throughout.
2. Match mortar color in approved sample or mock-up.
3. Color of mortar for exposed work in alteration work to match color of existing mortar unless specified otherwise in section 09 06 00, SCHEDULE FOR FINISHES.

D. Color Admixtures:

1. Proportion as specified by manufacturer.
2. For color, see Section 09 06 00, SCHEDULE FOR FINISHES.

2.10 COLOR ADMIXTURE

A. Pigments: ASTM C979.

B. Use mineral pigments only. Organic pigments are not acceptable.

C. Pigments inert, stable to atmospheric conditions, nonfading, alkali resistant and water insoluble.

PART 3 - EXECUTION**3.1 MIXING**

A. Mix in a mechanically operated mortar mixer.

1. Mix mortar for at least three minutes but not more than five minutes.

B. Measure ingredients by volume. Measure by the use of a container of known capacity.

C. Mix water with dry ingredients in sufficient amount to provide a workable mixture which will adhere to vertical surfaces of masonry units.

D. Pointing Mortar:

1. Mix dry ingredients with enough water to produce a damp mixture of workable consistency which will retain its shape when formed into a ball.
2. Allow mortar to stand in dampened condition for one to 1-1/2 hours.
3. Add water to bring mortar to a workable consistency prior to application.

3.2 MORTAR USE LOCATION

- A. Use Type M mortar for waterproof parging below grade.
- B. Use Type S mortar for masonry containing vertical reinforcing bars (non-engineered) masonry below grade and engineered reinforced unit masonry work.
- C. For brick veneer over frame back up walls, use Type N portland cement-lime mortar or Type S masonry cement or mortar cement mortar.
- D. Use Type N mortar for other masonry work, except as otherwise specified.

- - - E N D - - -

SECTION 04 05 16
MASONRY GROUTING

PART 1 - GENERAL

1.1 DESCRIPTION:

Section specifies grout materials and mixes.

1.2 RELATED WORK:

A. Grout used in Section:

1. Section 04 20 00, UNIT MASONRY.

1.3 TESTS:

- A. Test grout and materials specified.
- B. Certified test reports.
- C. Identify materials by type, brand name and manufacturer or by origin.
- D. Do not use materials until laboratory test reports are approved by Contracting Officer's Technical Representative (COTR).
- E. After tests have been made and materials approved, do not change without additional test and approval of COTR.
- F. Testing:
 1. Test materials proposed for use for compliance with specifications in accordance with test methods contained in referenced specifications and as follows:
 2. Grout:
 - a. Test for compressive strength; ASTM C1019.
 - b. Grout compressive strength of 13790 kPa (2000 psi) at 28 days.
 3. Cement:
 - a. Test for water soluble alkali (nonstaining) when nonstaining cement is specified.
 - b. Nonstaining cement shall contain not more than 0.03 percent water soluble alkali.
 4. Sand: Test for deleterious substances, organic impurities, soundness and grading.

1.4 SUBMITTALS:

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Certificates:
 1. Indicating that following items meet specifications:
 - a. Portland cement.
 - b. Masonry cement.

- c. Grout.
- d. Hydrated lime.
- e. Fine aggregate (sand).
- f. Coarse aggregate for grout.

C. Laboratory Test Reports:

- 1. Grout, each type.
- 2. Admixtures.

D. Manufacturer's Literature and Data:

- 1. Cement, each kind.
- 2. Hydrated lime.
- 3. Admixtures.
- 4. Liquid acrylic resin.

1.5 PRODUCT DELIVERY, STORAGE AND HANDLING:

- A. Deliver masonry materials in original sealed containers marked with name of manufacturer and identification of contents.
- B. Store masonry materials under waterproof covers on planking clear of ground, and protect damage from handling, dirt, stain, water and wind.

1.6 APPLICABLE PUBLICATIONS:

- A. Publications listed below form a part of specification to extent referenced. Publications are referenced in text by basic designation only.
- B. American Society for Testing and Materials (ASTM):
 - C40-04.....Organic Impurities in Fine Aggregates for
Concrete
 - C91-05.....Masonry Cement
 - C150-05.....Portland Cement
 - C207-06.....Hydrated Lime for Masonry Purposes
 - C404-07.....Aggregate for Masonry Grout
 - C476-07.....Grout for Masonry
 - C595-08.....Blended Hydraulic Cement
 - C1019-05.....Sampling and Testing Grout

PART 2 - PRODUCTS

2.1 HYDRATED LIME:

ASTM C207, Type S.

2.2 AGGREGATE FOR MASONRY GROUT:

ASTM C404, Size 8.

2.3 BLENDED HYDRAULIC CEMENT:

ASTM C595, Type IS, IP.

2.4 MASONRY CEMENT:

A. ASTM C91. Type N, S, or M.

2.5 PORTLAND CEMENT:

A. ASTM C150, Type I.

2.6 LIQUID ACRYLIC RESIN:

A formulation of acrylic polymers and modifiers in liquid form designed for use as an additive for mortar to improve physical properties.

2.7 WATER:

Potable, free of substances that are detrimental to grout, masonry, and metal.

2.8 GROUT:

A. Conform to ASTM C476 except as specified.

B. Grout type proportioned by volume as follows:

1. Fine Grout:

- a. Portland cement or blended hydraulic cement: one part.
- b. Hydrated lime: 0 to 1/10 part.
- c. Fine aggregate: 2-1/4 to three times sum of volumes of cement and lime used.

2. Coarse Grout:

- a. Portland cement or blended hydraulic cement: one part.
- b. Hydrated lime: 0 to 1/10 part.
- c. Fine aggregate: 2-1/4 to three times sum of volumes of cement and lime used.
- d. Coarse aggregate: one to two times sum of volumes of cement and lime used.

- 3. Sum of volumes of fine and coarse aggregates: Do not exceed four times sum of volumes of cement and lime used.

PART 3 - EXECUTION

3.1 MIXING:

- A. Mix in a mechanically operated grout mixer.
- B. Measure ingredients by volume. Measure by the use of a container of known capacity.
- C. Mix water with grout dry ingredients in sufficient amount to bring grout mixture to a pouring consistency.

3.2 GROUT USE LOCATIONS:

- A. Use fine grout for filling wall cavities and cells of concrete masonry units where the smallest dimension is 50 mm (2 inches) or less.

B. Use either fine grout or coarse grout for filling wall cavities and cells of concrete masonry units where the smallest dimension is greater than 50 mm (2 inches).

C. Do not use grout for filling bond beam or lintel units.

- - - E N D - - -

SECTION 04 20 00
UNIT MASONRY

PART 1 - GENERAL

1.1 DESCRIPTION

This section specifies requirements for construction of masonry unit walls.

1.2 RELATED WORK

- A. Mortars and grouts: Section 04 05 13, MASONRY MORTARING, Section 04 05 16, MASONRY GROUTING.
- B. Steel lintels and shelf angles: Section 05 50 00, METAL FABRICATIONS.
- C. Fluid-Applied Membrane Air Barrier: Section 06 11 50, SHEATHING.
- D. Damp-Proofing Below Grade: Section 07 11 13, BITUMINOUS DAMPPROOFING.
- E. Cavity insulation: Section 07 21 13, THERMAL INSULATION.
- F. Flashing: Section 07 60 00, FLASHING AND SHEET METAL.
- G. Sealants and sealant installation: Section 07 92 00, JOINT SEALANTS.
- H. Color and texture of masonry units: Section 09 06 00, SCHEDULE FOR FINISHES.

1.3 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA AND SAMPLES.
- B. Samples:
 - 1. Face brick, sample panel, 200 mm by 400 mm (8 inches by 16 inches,) showing full color range and texture of bricks, bond, and proposed mortar joints.
 - 2. Concrete masonry units, when exposed in finish work.
 - 3. Anchors, and ties, one each and joint reinforcing 1200 mm (48 inches) long.
- C. Shop Drawings:
 - 1. Special masonry shapes.
 - 2. Drawings, showing reinforcement, applicable dimensions and methods of hanging soffit or lintel masonry and reinforcing masonry for embedment of anchors for hung fixtures.
 - 3. Shop Drawings: Submit shop drawings for fabrication, bending, and placement of reinforcing bars. Comply with ACI 315. Show bar schedules, diagrams of bent bars, stirrup spacing, lateral ties and other arrangements and assemblies as required for fabrication and placement of reinforcement for unit masonry work.

D. Certificates:

1. Certificates signed by manufacturer, including name and address of contractor, project location, and the quantity, and date or dates of shipment of delivery to which certificate applies.
2. Indicating that the following items meet specification requirements:
 - a. Face brick.
 - b. Solid and load-bearing concrete masonry units, including fire-resistant rated units.
3. Testing laboratories facilities and qualifications of its principals and key personnel to perform tests specified.

E. Laboratory Test Reports:

1. Brick for pre-built masonry panels.

F. Manufacturer's Literature and Data:

1. Anchors, ties, and reinforcement.
2. Shear keys.
3. Reinforcing bars.

1.4 SAMPLE PANEL

- A. Before starting masonry, lay up a sample panel in accordance with Masonry Standards Joint Committee (MSJC) and Brick Industry Association (BIA).
 1. Use masonry units from random cubes of units delivered on site.
 2. Include reinforcing, ties, and anchors.
- B. Use sample panels approved by Contracting Officer's Technical Representative (COTR) for standard of workmanship of new masonry work.
- C. Use sample panel to test cleaning methods.

1.5 WARRANTY

Warrant exterior masonry walls against moisture leaks and subject to terms of "Warranty of Construction", FAR clause 52.246-21, except that warranty period shall be five years.

1.6 APPLICABLE PUBLICATIONS

- A. Publications listed below form a part of this specification to the extent referenced. Publications are referenced in the text by the basic designation only.
- B. American Society for Testing and Materials (ASTM):
 - A951-06.....Steel Wire for Masonry Joint Reinforcement.
 - A615/A615M-07.....Deformed and Plain Billet-Steel Bars for Concrete Reinforcement.

- A675/A675M-03.....Standard Specification for Steel Bars, Carbon,
Hot-Wrought, Special Quality, Mechanical
PropertiesC34-03
- C55-06.....Concrete Building Brick
- C62-05.....Building Brick (Solid Masonry Units Made From
Clay or Shale)
- C67-07.....Sampling and Testing Brick and Structural Clay
Tile
- C90-06.....Load-Bearing Concrete Masonry Units
- C126-99.....Ceramic Glazed Structural Clay Facing Tile,
Facing Brick, and Solid Masonry Units
- C216-07.....Facing Brick (Solid Masonry Units Made From
Clay or Shale)
- C476-02.....Standard Specification for Grout for Masonry
- C612-04.....Mineral Fiber Block and Board Thermal
Insulation
- D1056-07.....Flexible Cellular Materials - Sponge or
Expanded Rubber
- D3574-05.....Flexible Cellular Materials-Slab, Bonded, and
Molded Urethane Foams
- F1667-05.....Fasteners: Nails, Spikes and Staples
- C. Masonry Industry Council:
All Weather Masonry Construction Manual, 2000.
- D. American Welding Society (AWS):
D1.4-05 Structural Welding Code - Reinforcing Steel.
- E. Federal Specifications (FS):
FF-S-107C-00.....Screws, Tapping and Drive
- F. Brick Industry Association - Technical Notes on Brick Construction
(BIA):
- 11-1986.....Guide Specifications for Brick Masonry, Part I
- 11A-1988.....Guide Specifications for Brick Masonry, Part II
- 11B-1988.....Guide Specifications for Brick Masonry, Part
III Execution
- 11C-1998.....Guide Specification for Brick Masonry
Engineered Brick Masonry, Part IV
- 11D-1988.....Guide Specifications for Brick Masonry
Engineered Brick Masonry, Part IV continued

G. Masonry Standards Joint Committee; Specifications for Masonry Structures (ACI 530.1-05/ASCE 6-05/TMS 602-99) (MSJC).

PART 2 - PRODUCTS

2.1 BRICK

A. Face Brick:

1. ASTM C216, Grade SW, Type FBS.
2. Brick when tested in accordance with ASTM C67: Classified slightly efflorescent or better.
3. Size:
 - a. Modular

B. Building Brick: ASTM C62, Grade MW for backup and interior work; Grade SW where in contact with earth.

2.2 CONCRETE MASONRY UNITS

A. Hollow and Solid Load-Bearing Concrete Masonry Units: ASTM C90.

1. Unit Weight: Lightweight.
2. Fire rated units for fire rated partitions.
3. Sizes: Modular.
4. For molded faces used as a finished surface, use concrete masonry units with uniform fine to medium surface texture unless specified otherwise.
5. Use bullnose concrete masonry units at corners exposed in finished work with 25 mm (one inch) minimum radius rounded vertical exterior corners (bullnose units).

B. Concrete Brick: ASTM C55.

2.3 SHEAR KEYS

- A. ASTM D2000, solid extruded cross-shaped section of rubber, neoprene, or polyvinyl chloride, with a durometer hardness of approximately 80 when tested in accordance with ASTM D2240, and a minimum shear strength of 3.5 MPa (500 psi).
- B. Shear key dimensions: Approximately 70 mm by 8 mm for long flange and 38 mm by 16 mm for short flange (2-3/4 inches by 5/16 inch for long flange, and 1-1/2 inches by 5/8 inch for short flange).

2.4 REINFORCEMENT:

- A. Steel Reinforcing Bars: ASTM A615, deformed bars, 420 MPa (Grade 60) for bars No. 10 to No. 57 (No. 3 to No. 18), except as otherwise indicated.
- B. Shop-fabricate reinforcement bars which are shown to be bent or hooked.
- C. Joint Reinforcement:

1. Form from wire complying with ASTM A951.
2. Galvanized after fabrication.
3. Width of joint reinforcement 40 mm (1 5/8-inches) less than nominal width of masonry wall or partition.
4. Cross wires welded to longitudinal wires.
5. Joint reinforcing at least 3000 mm (10 feet) in length.
6. Joint reinforcing in rolls is not acceptable.
7. Joint reinforcing that is crimped to form drip is not acceptable.
8. Maximum spacing of cross wires 400 mm (16 inches) to longitudinal wires.
9. Ladder Design:
 - a. Longitudinal wires deformed 4 mm (0.16 inch) diameter wire.
 - b. Cross wires 4 mm (0.16 inch) diameter.
10. Multiple Wythes and Cavity wall ties:
 - a. Longitudinal wires 2.6 mm (0.10 inch), two in each wythe with ladder truss wires 2.6 mm (0.10 inch) overlay, welded to each longitudinal wire.
 - b. Longitudinal wires 4 mm (0.16 inch) with U shape 2.6 mm (0.10 inch) rectangular ties extending into other wythe not less than 75 mm (3 inches) spaced 400 mm o.c. (16 inches). Adjustable type with U shape tie designed to receive 4 mm (0.16 inch) pintle projecting into other wythe 75 mm (3 inches) minimum.

2.5 ANCHORS, TIES, AND REINFORCEMENT

- A. Steel Reinforcing Bars: ASTM A615M, deformed bars, grade as shown.
- B. Joint Reinforcement:
 1. Form from wire complying with ASTM A951.
 2. Galvanized after fabrication.
 3. Width of joint reinforcement 40 mm (0.16 inches) less than nominal width of masonry wall or partition.
 4. Cross wires welded to longitudinal wires.
 5. Joint reinforcement at least 3000 mm (10 feet) in length.
 6. Joint reinforcement in rolls is not acceptable.
 7. Joint reinforcement that is crimped to form drip is not acceptable.
 8. Maximum spacing of cross wires 400 mm (16 inch) to longitudinal wires.
 9. Ladder Design:
 - a. Longitudinal wires deformed 4 mm (0.16 inch).
 - b. Cross wires 2.6 mm (0.10 inch) diameter.

10. Multiple Wythes and Cavity wall ties:

- a. Longitudinal wires 4 mm (0.16 inch), two in each wythe with ladder truss wires 4 mm (0.16 inch) overlay, welded to each longitudinal wire.
- b. Longitudinal wires 4 mm (0.16 inch) with U shape 4 mm (0.16 inch) rectangular ties extending into other wythe not less than 75 mm (3 inches) spaced 400 mm o.c. (16 inches). Adjustable type with U shape tie designed to receive 4 mm (0.16 inch) pintle projecting into other wythe 75 mm (3 inches min.).

C. Adjustable Veneer Anchor for Frame Walls:

- 1. Two piece, adjustable anchor and tie.
- 2. Anchor and tie may be either type; use only one type throughout.
- 3. Loop Type:
 - a. Anchor: Screw-on galvanized steel anchor strap 2.75 mm (0.11 inch) by 19 mm (3/4 inch) wide by 225 mm (9 inches) long, with 9 mm (0.35 inch) offset and 100 mm (4 inch) adjustment. Provide 5 mm (0.20 inch) hole at each end for fasteners.
 - b. Ties: Triangular tie, fabricated of 5 mm (0.20 inch) diameter galvanized cold drawn steel wire. Ties long enough to engage the anchor and be embedded not less than 50 mm (2 inches) into the bed joint of the masonry veneer.
- 4. Angle Type:
 - a. Anchor: Minimum 2 mm (16 gage) thick galvanized steel angle shaped anchor strap. Provide hole in vertical leg for fastener. Provide hole near end of outstanding leg to suit upstanding portion of tie.
 - b. Tie: Fabricate from 5 mm (0.20 inch) diameter galvanized cold drawn steel wire. Form "L" shape to be embedded not less than 50 mm (2 inches) into the bed joint of the masonry veneer and provide upstanding leg to fit through hole in anchor and be long enough to allow 50 mm (2 inches) of vertical adjustment.

D. Dovetail Anchors:

- 1. Corrugated steel dovetail anchors formed of 1.5 mm (0.0598 inch) thick by 25 mm (1 inch) wide galvanized steel, 90 mm (3-1/2 inches) long where used to anchor 100 mm (4 inch) nominal thick masonry units, 140 mm (5-1/2 inches) long for masonry units more than 100 mm (4 inches) thick.

2. Triangular wire dovetail anchor 100 mm (4 inch) wide formed of 4 mm (9 gage) steel wire with galvanized steel dovetail insert. Anchor length to extend at least 75 mm (3 inches) into masonry, 25 mm (1 inch) into 40 mm (1-1/2 inch) thick units.
 3. Form dovetail anchor slots from 0.6 mm (0.0239 inch) thick galvanized steel (with felt or fiber filler).
- E. Individual ties:
1. Rectangular ties: Form from 5 mm (3/16 inch) diameter galvanized steel rod to a rectangular shape not less than 50 mm (2 inches) wide by sufficient length for ends of ties to extend within 25 mm (1 inch) of each face of wall. Ties that are crimped to form drip are not permitted.
 2. Adjustable Cavity Wall Ties:
 - a. Adjustable wall ties may be used at Contractor's option.
 - b. Two piece type permitting up to 40 mm (1-1/2 inch) adjustment.
 - c. Form ties from 5 mm (3/16 inch) diameter galvanized steel wire.
 - d. Form one piece to a rectangular shape 105 mm (4-1/8 inches) wide by length required to extend into the bed joint 50 mm (2 inches).
 - e. Form the other piece to a 75 mm (3 inch) long by 75 mm (3 inch) wide shape, having a 75 mm (3 inch) long bent section for engaging the 105 mm (4-1/8 inch) wide piece to form adjustable connection.
- F. Wall Ties, (Mesh or Wire):
1. Mesh wall ties formed of ASTM A82, W0.5, 2 mm, (16 gage) galvanized steel wire 13 mm by 13 mm (1/2 inch by 1/2 inch) mesh, 75 mm (3 inches) wide by 200 mm (8 inches) long.
 2. Rectangular wire wall ties formed of W1.4, 3 mm, (9 gage) galvanized steel wire 50 mm (2 inches) wide by 200 mm (8 inches) long.
- G. Corrugated Wall Tie:
1. Form from 1.5 mm (0.0598 inch) thick corrugated, galvanized steel 30 mm (1-1/4 inches) wide by lengths so as to extend at least 100 mm (4 inches) into joints of new masonry plus 38 mm (1-1/2 inch) turn-up.
 2. Provide 5 mm (3/16 inch) hole in turn-up for fastener attachment.
- H. Adjustable Steel Column Anchor:
1. Two piece anchor consisting of a 6 mm (1/4 inch) diameter steel rod to be welded to steel with offset ends, rod to permit 100 mm (4 inch) vertical adjustment of wire anchor.

2. Triangular shaped wire anchor 100 mm (4 inches) wide formed from 5 (3/16 inch) diameter galvanized wire, to extend at least 75 mm (3 inches) into joints of masonry.
- I. Adjustable Steel Beam Anchor:
1. Z or C type steel strap, 30 mm (1 1/4 inches) wide, 3 mm (1/8 inch) thick.
 2. Flange hook not less than 38 mm (1 1/2 inches) long.
 3. Length to embed in masonry not less than 50 mm (2 inches) in 100 mm (4 inch) nominal thick masonry and 100 mm (4 inches) in thicker masonry.
 4. Bend masonry end not less than 40 mm (1 1/2 inches).
- J. Ridge Wall Anchors:
1. Form from galvanized steel not less than 25 mm (1 inch) wide by 5 mm (3/16 inch) thick by 600 mm (24 inches) long, plus 50 mm (2 inch) bends.

2.6 PREFORMED COMPRESSIBLE JOINT FILLER

- A. Thickness and depth to fill the joint as specified.
- B. Closed Cell Neoprene: ASTM D1056, Type 2, Class A, Grade 1, B2F1.
- C. Non-Combustible Type: ASTM C612, Class 5, 1800 degrees F.

2.7 ACCESSORIES

- A. Weep Hole Wicks: Cotton fiber ropes, 10 mm (3/8 inch) minimum diameter, 300 mm (12 inches) long.
- B. Box Board:
 1. Mineral Fiber Board: ASTM C612, Class 1.
 2. 25 mm (1 inch) thickness.
 3. Other spacing material having similar characteristics may be used subject to the COTR's approval.
- C. Masonry Cleaner:
 1. Detergent type cleaner selected for each type masonry used.
 2. Acid cleaners are not acceptable.
 3. Use soapless type specially prepared for cleaning brick or concrete masonry as appropriate.
- D. Fasteners:
 1. Concrete Nails: ASTM F1667, Type I, Style 11, 19 mm (3/4 inch) minimum length.
 2. Masonry Nails: ASTM F1667, Type I, Style 17, 19 mm (3/4 inch) minimum length.
 3. Screws: FS-FF-S-107, Type A, AB, SF thread forming or cutting.

PART 3 - EXECUTION**3.1 JOB CONDITIONS****A. Protection:**

1. Cover tops of walls with nonstaining waterproof covering, when work is not in progress. Secure to prevent wind blow off.
2. On new work protect base of wall from mud, dirt, mortar droppings, and other materials that will stain face, until final landscaping or other site work is completed.

B. Cold Weather Protection:

1. Masonry may be laid in freezing weather when methods of protection are utilized.
2. Comply with MSJC and "Hot and Cold Weather Masonry Construction Manual".

3.2 CONSTRUCTION TOLERANCES**A. Lay masonry units plumb, level and true to line within the tolerances as per MSJC requirements and as follows:****B. Maximum variation from plumb:**

1. In 3000 mm (10 feet) - 6 mm (1/4 inch).
2. In 6000 mm (20 feet) - 10 mm (3/8 inch).
3. In 12 000 mm (40 feet) or more - 13 mm (1/2 inch).

C. Maximum variation from level:

1. In any bay or up to 6000 mm (20 feet) - 6 mm (1/4 inch).
2. In 12 000 mm (40 feet) or more - 13 mm (1/2 inch).

D. Maximum variation from linear building lines:

1. In any bay or up to 6000 mm (20 feet) - 13 mm (1/2 inch).
2. In 12 000 mm (40 feet) or more - 19 mm (3/4 inch).

E. Maximum variation in cross-sectional dimensions of columns and thickness of walls from dimensions shown:

1. Minus 6 mm (1/4 inch).
2. Plus 13 mm (1/2 inch).

F. Maximum variation in prepared opening dimensions:

1. Accurate to minus 0 mm (0 inch).
2. Plus 6 mm (1/4 inch).

3.3 INSTALLATION GENERAL**A. Keep finish work free from mortar smears or spatters, and leave neat and clean.****B. Anchor masonry as specified in Paragraph, ANCHORAGE.****C. Wall Openings:**

1. Fill hollow metal frames built into masonry walls and partitions solid with mortar as laying of masonry progresses.
2. If items are not available when walls are built, prepare openings for subsequent installation.

D. Tooling Joints:

1. Do not tool until mortar has stiffened enough to retain thumb print when thumb is pressed against mortar.
2. Tool while mortar is soft enough to be compressed into joints and not raked out.
3. Finish joints in exterior face masonry work with a jointing tool, and provide smooth, water-tight concave joint unless specified otherwise.
4. Tool Exposed interior joints in finish work concave unless specified otherwise.

E. Partition Height:

1. Extend partitions at least 100 mm (four inches) above suspended ceiling or to overhead construction where no ceiling occurs.
2. Extend following partitions to overhead construction.
 - a. Where noted smoke partitions, FHP (full height partition), and FP (fire partition) and smoke partitions (SP) on drawings.
 - b. Both walls at expansion joints.
 - c. Corridor walls.
 - d. Walls at stairway and stair halls, elevators, dumbwaiters, trash and laundry chute shafts, and other vertical shafts.
 - e. Walls at refrigerator space.
 - g. Reinforced masonry partitions
3. Extend finish masonry partitions at least four-inches above suspended ceiling and continue with concrete masonry units or structural clay tile to overhead construction:

F. Lintels:

1. Lintels are not required for openings less than 1000 mm (3 feet 4 inches) wide that have hollow metal frames.
2. Openings 1025 mm (3 feet 5 inches) wide to 1600 mm (5 feet 4 inches) wide with no structural steel lintel or frames, require a lintel formed of concrete masonry lintel or bond beam units filled with grout per ASTM C476 and reinforced with 1- #15m (1-#5) rod top and bottom for each 100 mm (4 inches) of nominal thickness unless shown otherwise.

3. Use steel lintels, for openings over 1600 mm (5 feet 4 inches) wide, brick masonry, and elevator openings unless shown otherwise.
 4. Doors having overhead concealed door closers require a steel lintel, and a pocket for closer box.
 5. Length for minimum bearing of 100 mm (4 inches) at ends.
 6. Build masonry openings or arches over wood or metal centering and supports when steel lintels are not used.
- G. Wall, Furring, and Partition Units:
1. Lay out field units to provide for running bond of walls and partitions, with vertical joints in second course centering on first course units unless specified otherwise.
 2. Align head joints of alternate vertical courses.
 3. At sides of openings, balance head joints in each course on vertical center lines of openings.
 4. Use no piece shorter than 100 mm (4 inches) long.
 5. On interior partitions provide a 6 mm (1/4 inch) open joint for caulking between existing construction, exterior walls, concrete work, and abutting masonry partitions.
 6. Use not less than 100 mm (4 inches) nominal thick masonry for free standing furring unless shown otherwise.
 7. Do not abut existing plastered surfaces except suspended ceilings with new masonry partitions.
- H. Use not less than 100 mm (4 inches) nominal thick masonry for fireproofing steel columns unless shown otherwise.
- I. Before connecting new masonry with previously laid, remove loosened masonry or mortar, and clean and wet work in place as specified under wetting.
- J. When new masonry partitions start on existing floors, machine cut existing floor finish material down to concrete surface.
- K. Structural Steel Encased in Masonry:
1. Where structural steel is encased in masonry and the voids between the steel and masonry are filled with mortar, provide a minimum 25 mm (1 inch) mortar free expansion space between the masonry and the steel by applying a box board material to the steel before the masonry is laid.
 2. Do not place spacing material where steel is bearing on masonry or masonry is bearing on steel.
- L. Chases:

1. Do not install chases in masonry walls and partitions exposed to view in finished work, including painted or coated finishes on masonry.
 2. Masonry 100 mm (4 inch) nominal thick may have electrical conduits 25 mm (1 inch) or less in diameter when covered with soaps, or other finishes.
 3. Full recess chases after installation of conduit, with mortar and finish flush.
 4. When pipes or conduits, or both occur in hollow masonry unit partitions retain at least one web of the hollow masonry units.
- M. Wetting and Wetting Test:
1. Test and wet brick or clay tile in accordance with BIA 11B.
 2. Do not wet concrete masonry units or glazed structural facing tile before laying.
- N. Temporary Formwork: Provide formwork and shores as required for temporary support of reinforced masonry elements.
- O. Construct formwork to conform to shape, line and dimensions shown. Make sufficiently tight to prevent leakage of mortar, grout, or concrete (if any). Brace, tie and support as required to maintain position and shape during construction and curing of reinforced masonry.
- P. Do not remove forms and shores until reinforced masonry members have hardened sufficiently to carry their own weight and all other reasonable temporary loads that may be placed on them during construction.
- Q. Allow not less than the following minimum time to elapse after completion of members before removing shores or forms, provided suitable curing conditions have been obtained during the curing period.
1. 10 days for girders and beams.
 2. 7 days for slabs.
 3. 7 days for reinforced masonry soffits.

3.4 ANCHORAGE

- A. Veneer to Frame Walls:
1. Use adjustable veneer anchors.
 2. Fasten anchor to stud through sheathing with self drilling and tapping screw, one at each end of loop type anchor.
 3. Space anchors not more than 400 mm (16 inches) on center vertically at each stud.
- B. Veneer to Concrete Walls:

1. Install dovetail slots in concrete vertically at 600 mm (2 feet) on centers.
 2. Locate dovetail anchors at 400 mm (16 inch) maximum vertical intervals.
 3. Anchor new masonry facing to existing concrete with corrugated wall ties spaced at 400 mm, (16 inch) maximum vertical intervals, and at 600 mm (2 feet) maximum horizontal intervals. Fasten ties to concrete with power actuated fasteners or concrete nails.
- C. Masonry Facing to Backup and Cavity Wall Ties:
1. Use individual ties for new work.
 2. Stagger ties in alternate courses, and space at 400 mm (16 inches) maximum vertically, and 600 mm (2 feet) horizontally.
 3. At openings, provide additional ties spaced not more than 900 mm (3 feet) apart vertically around perimeter of opening, and within 300 mm (12 inches) from edge of opening.
 4. Anchor new masonry facing to existing masonry with corrugated wall ties spaced at 400 mm (16 inch) maximum vertical intervals and at every second masonry unit horizontally. Fasten ties to masonry with masonry nails.
 5. Option: Use joint reinforcing for multiple wythes and cavity wall ties spaced not more than 400 mm (16 inches) vertically.
 6. Tie interior and exterior wythes of reinforced masonry walls together with individual ties. Provide ties at intervals not to exceed 600 mm (24 inches) on center horizontally, and 400 mm (16 inches) on center vertically. Lay ties in the same line vertically in order to facilitate vibrating of the grout pours.
- D. Anchorage of Abutting Masonry:
1. Anchor interior 100 mm (4 inch) thick masonry partitions to exterior masonry walls with wall ties. Space ties at 600 mm (2 foot) maximum vertical intervals. Extend ties 100 mm (4 inches) minimum into masonry.
 2. Anchor interior masonry bearing walls or interior masonry partitions over 100 mm (4 inches) thick to masonry walls with rigid wall anchors spaced at 400 mm (16 inch) maximum vertical intervals.
 3. Anchor abutting masonry walls and partitions to concrete with dovetail anchors. Install dovetail slots vertically in concrete at centerline of abutting wall or partition. Locate dovetail anchors at 400 mm (16 inch) maximum vertical intervals. Secure anchors to

existing wall with two 9 mm (3/8 inch) by 75 mm (3 inch) expansion bolts or two power-driven fasteners.

4. Anchor abutting interior masonry partitions to existing concrete and existing masonry construction, with corrugated wall ties. Extend ties at least 100 mm (4 inches) into joints of new masonry. Fastened to existing concrete and masonry construction, with powder actuated drive pins, nail or other means that provides rigid anchorage. Install anchors at 400 mm (16 inch) maximum vertical intervals.

E. Masonry Furring:

1. Anchor masonry furring less than 100 mm (4 inches) nominal thick to masonry walls or to concrete with corrugated wall ties or dovetail anchors.
2. Space not over 600 mm (2 feet) on centers in both directions.

F. Anchorage to Steel Beams or Columns:

1. Use adjustable beam anchors on each flange.
2. At columns weld the 6 mm (1/4 inch) steel rod to steel columns at 300 mm (12 inch) intervals, and place wire ties in masonry courses at 400 mm (16 inches) maximum vertically.

3.5 REINFORCEMENT

A. Joint Reinforcement:

1. Use as joint reinforcement in CMU wythe of combination brick and CMU, cavity walls, and single wythe concrete masonry unit walls or partitions.
2. Reinforcing may be used in lieu of individual ties for anchoring brick facing to CMU backup in exterior masonry walls.
3. Brick veneer over frame backing walls does not require joint reinforcement.
4. Locate joint reinforcement in mortar joints at 400 mm (16 inch) maximum vertical intervals.
5. Additional joint reinforcement is required in mortar joints at both 200 mm (8 inches) and 400 (16 inches) above and below windows, doors, louvers and similar openings in masonry, except where other type anchors are required for anchorage of masonry to concrete structure.
6. Joint reinforcement is required in every other course of stack bond CMU masonry.

7. Wherever brick masonry is backed up with stacked bond masonry, joint reinforcement is required in every other course of CMU backup, and in corresponding joint of facing brick.
- B. Steel Reinforcing Bars:
1. Install in cells of hollow masonry units where required for vertical reinforcement and in bond beam units for lintels and bond beam horizontal reinforcement. Install in wall cavities of reinforced masonry walls where shown.
 2. Use grade 60 bars if not specified otherwise.
 3. Bond Beams:
 - a. Form Bond beams of load-bearing concrete masonry units filled with ASTM C476 grout and reinforced with 2-#15m (#5) reinforcing steel unless shown otherwise. Do not cut reinforcement.
 - b. Brake bond beams only at expansion joints and at control joints, if shown.
 4. Grout openings:
 - a. Leave cleanout holes in double wythe walls during construction by omitting units at the base of one side of the wall.
 - b. Locate 75 mm x 75 mm (3 in. x 3 in.) min. clean-out holes at location of vertical reinforcement.
 - c. Keep grout space clean of mortar accumulation and sand debris. Clean the grout space every day using a high pressure jet stream of water, or compressed air, or industrial vacuum, or by laying wood strips on the metal ties as the wall is built. If wood strips are used, lift strips with wires as the wall progresses and before placing each succeeding course of wall ties.

3.6 BRICK EXPANSION AND CMU CONTROL JOINTS.

- A. Provide brick expansion (BEJ) and CMU control (CJ) joints where shown on drawings.
- B. Keep joint free of mortar and other debris.
- C. Where joints occur in masonry walls.
 1. Install preformed compressible joint filler in brick wythe.
 2. Install cross shaped shear keys in concrete masonry unit wythe with preformed compressible joint filler on each side of shear key unless otherwise specified.
 3. Install filler, backer rod, and sealant on exposed faces.

- D. Use standard notched concrete masonry units (sash blocks) made in full and half-length units where shear keys are used to create a continuous vertical joint.
- E. Interrupt steel joint reinforcement at expansion and control joints unless otherwise shown.
- F. Fill opening in exposed face of expansion and control joints with sealant as specified in Section 07 92 00, JOINT SEALANTS.

3.7 BUILDING EXPANSION AND SEISMIC JOINTS

- A. Keep joint free of mortar. Remove mortar and other debris.
- B. Install non-combustible, compressible type joint filler to fill space completely except where sealant is shown on joints in exposed finish work.
- C. Where joints are on exposed faces, provide depth for backer rod and sealant as specified in Section 07 92 00, JOINT SEALANTS, unless shown otherwise.

3.8 ISOLATION SEAL

- A. Where full height walls or partitions lie parallel or perpendicular to and under structural beams or shelf angles, provide a separation between walls or partitions and bottom of beams or shelf angles not less than the masonry joint thickness unless shown otherwise.
- B. Insert in the separation, a continuous full width strip of non-combustible type compressible joint filler.
- C. Where exposed in finish work, cut back filler material in the joint enough to allow for the joint to be filled with sealant material specified in Section 07 92 00, JOINT SEALANTS.

3.9 BRICKWORK

- A. Lay clay brick in accordance with BIA Technical Note 11 series.
- B. Laying:
 - 1. Lay brick in running bond with course of masonry bonded at corners unless shown otherwise. Match bond of existing building on alterations and additions.
 - 2. Maintain bond pattern throughout.
 - 3. Do not use brick smaller than half-brick at any angle, corner, break or jamb.
 - 4. Where length of cut brick is greater than one half but less than a whole brick, maintain the vertical joint location of such units.
 - 5. Lay exposed brickwork joints symmetrical about center lines of openings.

6. Do not structural bond multi wythe brick walls unless shown.
 7. Before starting work, lay facing brick on foundation wall and adjust bond to openings, angles, and corners.
 8. Lay brick for sills with wash and drip.
 9. Build solid brickwork as required for anchorage of items.
- C. Joints:
1. Exterior and interior joint widths: Lay for three equal joints in 200 mm (eight inches) vertically, unless shown otherwise.
 2. Rake joints for pointing with colored mortar when colored mortar is not full depth.
 3. Arches:
 - a. Flat arches (jack arches) lay with camber of 1 in 200 (1/16 inch per foot) of span.
 - b. Face radial arches with radial brick with center line of joints on radial lines.
 - c. Form Radial joints of equal width.
 - d. Bond arches into backing with metal ties in every other joint.
- D. Weep Holes:
1. Install weep holes at 600 mm (24 inches) on center in bottom of vertical joints of exterior masonry veneer or cavity wall facing over foundations, bond beams, and other water stops in the wall.
 2. Form weep holes using wicks made of cotton fiber insulation strips turned up 200 mm (8 inches) in cavity. Anchor top of strip to backup to securely hold in place.
 3. Install sand or pea gravel in cavity approximately 75 mm (3 inches) high between weep holes.
- E. Solid Exterior Walls:
1. Build with 100 mm (4 inches) of nominal thick facing brick, backed up with concrete masonry units or cast-in-place concrete.
 2. Construct solid brick jambs not less than 20 mm (.8 inches) wide at exterior wall openings and at recesses, except where exposed concrete unit backup is shown.
 3. Do not use full bonding headers.
 4. Parging:
 - a. For solid masonry walls, lay backup to height of six brick courses, parge backup with 13 mm (1/2 inch) of mortar troweled smooth; then lay exterior wythe to height of backup.

- b. Make parging continuous over backup, and extend 150 mm (six inches) onto adjacent concrete or masonry.
- c. Parge, with mortar, the ends and backs for recesses in exterior walls to a thickness of 13 mm (1/2 inch).
- d. Parge with mortar to true even surface the inside surface of exterior walls to receive insulation.

F. Cavity Type Exterior Walls:

- 1. Keep air space clean of mortar accumulations and debris.
 - a. Clean cavity by use of hard rubber, wood or metal channel strips having soft material on sides contacting wythes.
 - b. Lift strips with wires before placing next courses of horizontal joint reinforcement or individual ties or adjustable cavity wall ties.
- 2. For each lift lay two courses of concrete masonry units, followed by six courses of brick facing.
- 3. Lay the interior wythe of the masonry wall full height where fluid-applied air barrier is required on cavity face. Coordinate to install fluid-applied air barrier prior to laying outer wythe.
- 4. Insulated Cavity Type Exterior Walls:
 - a. Install the insulation against the cavity face of inner masonry wythe.
 - b. Place insulation between rows of ties or joint reinforcing or bond to masonry surface with a bonding agent as recommended by the manufacturer of the insulation.
 - c. Lay the outer masonry wythe up with an air space between insulation and masonry units.
- 5. Veneer Framed Walls:
 - a. Build with 100 mm (4 inches) of face brick over sheathed stud wall with air space.
 - b. Keep air space clean of mortar accumulations and debris.

3.10 CONCRETE MASONRY

A. Kind and Users:

- 1. Provide special concrete masonry shapes as required, including lintel and bond beam units, sash units, and corner units. Use solid concrete masonry units, where full units cannot be used, or where needed for anchorage of accessories.

2. Provide solid load-bearing concrete masonry units or grout the cell of hollow units at jambs of openings in walls, where structural members impose loads directly on concrete masonry, and where shown.
 3. Provide rounded corner (bullnose) shapes at opening jambs in exposed work and at exterior corners.
 4. Do not use brick jambs in exposed finish work.
 5. Use concrete building brick only as filler in backup material where not exposed.
 6. Masonry assemblies shall meet the required fire resistance in fire rated partitions of type and construction that will provide fire rating as shown.
- B. Laying:
1. Lay concrete masonry units with 10 mm (3/8 inch) joints, with a bond overlap of not less than 1/4 of the unit length, except where stack bond is required.
 2. Do not wet concrete masonry units before laying.
 3. Bond external corners of partitions by overlapping alternate courses.
 4. Lay first course in a full mortar bed.
 5. Set anchorage items as work progress.
 6. Where ends of anchors, bolts, and other embedded items, project into voids of units, completely fill such voids with mortar or grout.
 7. Provide a 6 mm (1/4 inch) open joint for caulking between existing construction, exterior walls, concrete work, and abutting masonry partitions.
 8. Lay concrete masonry units with full face shell mortar beds and fill head joint beds for depth equivalent to face shell thickness.
 9. Lay concrete masonry units so that cores of units, that are to be filled with grout, are vertically continuous with joints of cross webs of such cores completely filled with mortar. Unobstructed core openings not less than 50 mm (2 inches) by 75 mm (3 inches).
 10. Do not wedge the masonry against the steel reinforcing. Minimum 13 mm (1/2 inch) clear distance between reinforcing and masonry units.
 11. Install deformed reinforcing bars of sizes shown.
 12. Steel reinforcement, at time of placement, free of loose flaky rust, mud, oil, or other coatings that will destroy or reduce bond.
 13. Steel reinforcement in place before grouting.
 14. Minimum clear distance between parallel bars: One bar diameter.

15. Hold vertical steel reinforcement in place by centering clips, caging devices, tie wire, or other approved methods, vertically at spacings noted.
 16. Support vertical bars near each end and at intermediate intervals not exceeding 192 bar diameters.
 17. Reinforcement shall be fully encased by grout or concrete.
 18. Splice reinforcement or attach reinforcement to dowels by placing in contact and secured or by placing the reinforcement within 1/5 of the required bar splice length.
 19. Stagger splices in adjacent horizontal reinforcing bars. Lap reinforcing bars at splices a minimum of 40 bar diameters.
 20. Grout cells of concrete masonry units, containing the reinforcing bars, solid as specified under grouting.
 21. Cavity and joint horizontal reinforcement may be placed as the masonry work progresses.
 22. Rake joints 6 to 10 mm (1/4 to 3/8 inch) deep for pointing with colored mortar when colored mortar is not full depth.
- C. Waterproofing Parging:
1. Parge earth side of concrete masonry unit basement walls with mortar applied in two coats, each coat 6 mm (1/4 inch) thick.
 2. Clean wall surfaces to receive parging of dirt, oil, or grease, and moisten before application of first coat.
 3. Roughen first coat when partially set, permit to hardened for 24 hours, and moisten before application of second coat.
 4. Keep second coat damp for at least 48 hours.
 5. Thicken parging and round to form a cove at the junction of outside wall face and footing.

3.11 POINTING

- A. Fill joints with pointing mortar using rubber float trowel to rub mortar solidly into raked joints.
- B. Wipe off excess mortar from joints of glazed masonry units with dry cloth.
- C. Finish exposed joints in finish work with a jointing tool to provide a smooth concave joint unless specified otherwise.
- D. At joints with existing work match existing joint.

3.12 GROUTING

- A. Preparation:
1. Clean grout space of mortar droppings before placing grout.

2. Close cleanouts.
 3. Install vertical solid masonry dams across grout space for full height of wall at intervals of not more than 9000 mm (30 feet). Do not bond dam units into wythes as masonry headers.
 4. Verify reinforcing bars are in cells of units or between wythes as shown.
- B. Placing:
1. Place grout by hand bucket, concrete hopper, or grout pump.
 2. Consolidate each lift of grout after free water has disappeared but before plasticity is lost.
 3. Do not slush with mortar or use mortar with grout.
 4. Interruptions:
 - a. When grouting must be stopped for more than an hour, top off grout 40 mm (1-1/2 inch) below top of last masonry course.
 - b. Grout from dam to dam on high lift method.
 - c. A longitudinal run of masonry may be stopped off only by raking back one-half a masonry unit length in each course and stopping grout 100 mm (4 inches) back of rake on low lift method.
- C. Puddling Method:
1. Double wythe masonry constructed grouted in lifts not to exceed 300 mm (12 inches) or less than 50 mm (2 inches) wide.
 2. Consolidate by puddling with a grout stick during and immediately after placing.
 3. Grout the cores of concrete masonry units containing the reinforcing bars solid as the masonry work progresses.
- D. Low Lift Method:
1. Construct masonry to a height of 1.5 m (5 ft) maximum before grouting.
 2. Grout in one continuous operation and consolidate grout by mechanical vibration and reconsolidate after initial water loss and settlement has occurred.
- E. High Lift Method:
1. Do not pour grout until masonry wall has properly cured a minimum of 4 hours.
 2. Place grout in lifts not exceeding 1.5 m (5 ft).
 3. Exception:

Where the following conditions are met, place grout in lifts not exceeding 3.86 m (12.67 ft).

- a. The masonry has cured for at least 4 hours.
 - b. The grout slump is maintained between 254 and 279 mm (10 and 11 in).
 - c. No intermediate reinforced bond beams are placed between the top and the bottom of the pour height.
4. When vibrating succeeding lifts, extend vibrator 300 to 450 mm (12 to 18 inches) into the preceding lift to close any shrinkage cracks or separation from the masonry units.

3.13 PLACING REINFORCEMENT

- A. General: Clean reinforcement of loose rust, mill scale, earth, ice or other materials which will reduce bond to mortar or grout. Do not use reinforcement bars with kinks or bends not shown on the Contract Drawings or final shop drawings, or bars with reduced cross-section due to excessive rusting or other causes.
- B. Position reinforcement accurately at the spacing indicated. Support and secure vertical bars against displacement. Horizontal reinforcement may be placed as the masonry work progresses. Where vertical bars are shown in close proximity, provide a clear distance between bars of not less than the nominal bar diameter or 25 mm (1 inch), whichever is greater.
- C. For columns, piers and pilasters, provide a clear distance between vertical bars as indicated, but not less than 1 1/2 times the nominal bar diameter or 38 mm (1-1/2 inches), whichever is greater. Provide lateral ties as indicated.
- D. Splice reinforcement bars where shown; do not splice at other places unless accepted by the COTR. Provide lapped splices, unless otherwise indicated. In splicing vertical bars or attaching to dowels, lap ends, place in contact and wire tie.
- E. Provide not less than minimum lap as indicated on shop drawings, or if not indicated, as required by governing code.
- F. Embed metal ties in mortar joints as work progresses, with a minimum mortar cover of 15 mm (5/8 inch) on exterior face of walls and 13 mm (1/2 inch) at other locations.
- G. Embed prefabricated horizontal joint reinforcement as the work progresses, with a minimum cover of 15 mm (5/8 inch) on exterior face of walls and 13 mm (1/2 inch) at other locations. Lap joint reinforcement not less than 150 mm (6 inches) at ends. Use prefabricated "L" and "T" sections to provide continuity at corners and intersections. Cut and bend joint reinforcement as recommended by

manufacturer for continuity at returns, offsets, column fireproofing, pipe enclosures and other special conditions.

- H. Anchoring: Anchor reinforced masonry work to supporting structure as indicated.
- I. Anchor reinforced masonry walls to non-reinforced masonry where they intersect.

3.14 INSTALLATION OF REINFORCED CONCRETE UNIT MASONRY

- A. Do not wet concrete masonry units (CMU).
- B. Lay CMU units with full-face shell mortar beds. Fill vertical head joints (end joints between units) solidly with mortar from face of unit to a distance behind face equal to not less than the thickness of longitudinal face shells. Solidly bed cross-webs of starting courses in mortar. Maintain head and bed joint widths shown, or if not shown, provide 10 mm (3/8 inch) joints.
- C. Where solid CMU units are shown, lay with full mortar head and bed joints.
- D. Walls:
 - 1. Pattern Bond: Lay CMU wall units in 1/2-running bond with vertical joints in each course centered on units in courses above and below, unless otherwise indicated. Bond and interlock each course at corners and intersections. Use special-shaped units where shown, and as required for corners, jambs, sash, control joints, lintels, bond beams and other special conditions.
 - 2. Maintain vertical continuity of core or cell cavities, which are to be reinforced and grouted, to provide minimum clear dimension indicated and to provide minimum clearance and grout coverage for vertical reinforcement bars. Keep cavities free of mortar. Solidly bed webs in mortar where adjacent to reinforced cores or cells.
 - 3. Where horizontal reinforced beams (bond beams) are shown, use special units or modify regular units to allow for placement of continuous horizontal reinforcement bars. Place small mesh expanded metal lath or wire screening in mortar joints under bond beam courses over cores or cells of non-reinforced vertical cells, or provide units with solid bottoms.
- E. Columns, Piers and Pilasters:
 - 1. Use CMU units of the size, shape and number of vertical core spaces shown. If not shown, use units which provide minimum clearances and

grout coverage for number and size of vertical reinforcement bars shown.

2. Provide pattern bond shown, or if not shown, alternate head joints in vertical alignment.

F. Grouting:

1. Use "Fine Grout" per ASTM C476 for filling spaces less than 100 mm (4 inches) in one or both horizontal directions.
2. Use "Coarse Grout" per ASTM C476 for filling 100 mm (4 inch) spaces or larger in both horizontal directions.
3. Grouting Technique: At the Contractor's option, use either low-lift or high-lift grouting techniques subject to requirements which follow.

G. Low-Lift Grouting:

1. Provide minimum clear dimension of 50 mm (2 inches) and clear area of 5160 mm² (8 square inches) in vertical cores to be grouted.
2. Place vertical reinforcement prior to grouting of CMU. Extend above elevation of maximum pour height as required for splicing. Support in position at vertical intervals not exceeding 192 bar diameters nor 3 m (10 feet).
3. Lay CMU to maximum pour height. Do not exceed 1.5 m (5 foot) height, or if bond beam occurs below 1.5 m (5 foot) height, stop pour 38 mm (1-1/2 in) below top of bond beam.
4. Pour grout using chute container with spout or pump hose. Rod or vibrate grout during placing. Place grout continuously; do not interrupt pouring of grout for more than one hour. Terminate grout pours 38 mm (1-1/2 inches) below top course of pour.
5. Bond Beams: Stop grout in vertical cells 38 mm (1-1/2 inches) below bond beam course. Place horizontal reinforcement in bond beams; lap at corners and intersections as shown. Place grout in bond beam course before filling vertical cores above bond beam.

H. High-Lift Grouting:

1. Do not use high-lift grouting technique for grouting of CMU unless minimum cavity dimension and area is 75 mm (3 inches) and 6450 mm² (10 square inches), respectively.
2. Provide cleanout holes in first course at all vertical cells which are to be filled with grout.

3. Use units with one face shell removed and provide temporary supports for units above, or use header units with concrete brick supports, or cut openings in one face shell.
4. Construct masonry to full height of maximum grout pour specified, prior to placing grout.
5. Limit grout lifts to a maximum height of 1.5 m (5 feet) and grout pour to a maximum height of 7.3 m (24 feet), for single wythe hollow concrete masonry walls, unless otherwise indicated.
6. Place vertical reinforcement before grouting. Place before or after laying masonry units, as required by job conditions. Tie vertical reinforcement to dowels at base of masonry where shown and thread CMU over or around reinforcement. Support vertical reinforcement at intervals not exceeding 192 bar diameters nor 3 m (10 feet).
7. Where individual bars are placed after laying masonry, place wire loops extending into cells as masonry is laid and loosed before mortar sets. After insertion of reinforcement bar, pull loops and bar to proper position and tie free ends.
8. Where reinforcement is prefabricated into cage units before placing, fabricate units with vertical reinforcement bars and lateral ties of the size and spacing indicated.
9. Place horizontal beam reinforcement as the masonry units are laid.
10. Embed lateral tie reinforcement in mortar joints where indicated. Place as masonry units are laid, at vertical spacing shown.
11. Where lateral ties are shown in contact with vertical reinforcement bars, embed additional lateral tie reinforcement in mortar joints. Place as shown, or if not shown, provide as required to prevent grout blowout or rupture of CMU face shells, but provide not less than 4.1 mm diameter (8 gage) wire ties spaced 400 mm (16 inches) o.c. for members with 500 mm (20 inches) or less side dimensions, and 200 mm (8 inches) o.c. for members with side dimensions exceeding 500 mm (20 inches).
12. Preparation of Grout Spaces: Prior to grouting, inspect and clean grout spaces. Remove dust, dirt, mortar droppings, loose pieces of masonry and other foreign materials from grout spaces. Clean reinforcement and adjust to proper position. Clean top surface of structural members supporting masonry to ensure bond. After final cleaning and inspection, close cleanout holes and brace closures to resist grout pressures.

13. Do not place grout until entire height of masonry to be grouted has attained sufficient strength to resist displacement of masonry units and breaking of mortar bond. Install shores and bracing, if required, before starting grouting operations.
14. Place grout by pumping into grout spaces unless alternate methods are acceptable to the COTR.
15. Limit grout pours to sections which can be completed in one working day with not more than one hour interruption of pouring operation. Place grout in lifts which do not exceed 1.5 m (5 feet). Allow not less than 30 minutes, nor more than one hour between lifts of a given pour. Mechanically consolidate each grout lift during pouring operation.
16. Place grout in lintels or beams over openings in one continuous pour.
17. Where bond beam occurs more than one course below top of pour, fill bond beam course to within 25 mm (1 inch) of vertically reinforced cavities, during construction of masonry.
18. When more than one pour is required to complete a given section of masonry, extend reinforcement beyond masonry as required for splicing. Pour grout to within 38 mm (1-1/2 inches) of top course of first pour. After grouted masonry is cured, lay masonry units and place reinforcement for second pour section before grouting. Repeat sequence if more pours are required.

3.15 CLEANING AND REPAIR

A. General:

1. Clean exposed masonry surfaces on completion.
2. Protect adjoining construction materials and landscaping during cleaning operations.
3. Cut out defective exposed new joints to depth of approximately 19 mm (3/4 inch) and repoint.
4. Remove mortar droppings and other foreign substances from wall surfaces.

B. Brickwork:

1. First wet surfaces with clean water, then wash down with a solution of soapless detergent. Do not use muriatic acid.
2. Brush with stiff fiber brushes while washing, and immediately thereafter hose down with clean water.

3. Free clean surfaces of traces of detergent, foreign streaks, or stains of any nature.

C. Concrete Masonry Units:

1. Immediately following setting, brush exposed surfaces free of mortar or other foreign matter.
2. Allow mud to dry before brushing.

- - - E N D - - -

SECTION 04 42 00
EXTERIOR STONE VENEER CLADDING SYSTEM

PART 1 - GENERAL

1.1 DESCRIPTION

- A. Section Includes: Natural Stone Honeycomb Reinforced Wall Cladding System, including installation anchors and accessories.
- B. Related Sections:
 - 1. Section 05 40 00 - Cold Formed Metal Framing
 - 2. Section 07 60 00 - Sheet Metal Flashing and Trim
 - 3. Section 07 92 00 - Joint Sealant

1.2 REFERENCES (INDUSTRY STANDARDS)

- A. ASTM E 283 Test Method for Rate of Air Leakage
- B. ASTM E 331 Test Method for Water Penetration
- C. AAMA 501.1 Test Method for Dynamic Water Penetration
- D. ASTM E-84 Test Method for Measuring Flame Spread
- E. UFC 4-010-01 Unified Facilities Criteria (UFC) - DoD Minimum Antiterrorism Standard for Buildings

1.3 SYSTEM DESCRIPTION

- A. Panel System Performance Requirements:
 - 1. U.S. Code Approval - Per International Code Council (ICC-ES) Report ESR - 1500
 - 2. Accelerated Aging by Acid Freeze Thaw by Wiss, Janney, Elstner Assoc. Test Method: Flexural strength loss not to exceed 20% following 100 cycles + 170 (F) to -10(F) while immersed in 4-pH sulfuric acid solution.
 - 3. Large Missile Impact in accordance with Dade County Protocol PA 201-94: Resists large missile impact when fired at 50 ft. per second.
 - 4. Cyclic Wind Pressure Loading in accordance with Dade County Protocol PA 203-94: Resist 1342 repetitions of positive - negative 90 psf design wind pressure.
 - 5. ASTM E-84 Flame Spread: 5 maximum smoke development: 5 maximum. Fuel contributed: 0.
 - 6. Toxicity evaluation according to the University of Pittsburgh test method: No more toxic than Douglas fir wood.
 - 7. ASTM D-2015 Potential heat of combustion: 1150 BTU/lb. Maximum.
 - 8. UBC 17-6 Multi -Story fire evaluation: Meet acceptance criteria.
 - 9. Modified ASTM E-108 Fire evaluation: Resist 30 minute fire exposure.

- 10.Flat wise tension bond capacity: 385 psi following accelerated aging by rapid temperature cycling from -40 degrees (F) to +160 degrees (F).
- 11.Flat wise tension bond tests following ASTM C-67, section 8 freeze - thaw: 290 psi flat wise tension bond following 100 cycles freeze thaw consisting of 20 hours freezing at 0 degrees (F) and 4 hours thawing in water at 75 degrees (F).
- 12.ASTM E-72 Transverse load test: Average 215 lbs. per sq. ft. uniform load on 35.5 inch simple span causing 0.49 inch deflection average.
- 13.Racking shear load tests: No disengagement or major damage following application of 4,000 lb. load and 0.05" to 1.5" deflection on an 8 ft x 8ft specimen.
- 14.Air Infiltration: The test specimen shall be tested in accordance with ASTM E 283. Air infiltration rate shall not exceed 0.06 cfm/ft2 at a static air pressure differential of 6.24 psf.
- 15.Water Resistance: The test specimen shall be tested in accordance with ASTM E 331. There shall be no leakage at a minimum static air pressure differential of 10 psf as defined in AAMA 501.

1.4 SUBMITTALS

- A. General: Prepare, review, approve, and submit specified submittals in accordance with "Conditions of the Contract" and Division 1. Submittals Sections. Product data, shop drawings, samples, and similar submittals are defined in "Conditions of the Contract."
- B. Quality Assurance/Control Submittals:
 1. Test Reports: Submit independent laboratory certified test reports showing compliance with specified performance characteristics.
 2. Building Authority Acceptance: Submit documentation confirming Building Code Authority Acceptance.

1.5 WARRANTY

- A. Project Warranty: Refer to "Conditions of the Contract" for project warranty provisions.
- B. Manufacturer's Product Warranty: Submit, for Owner's acceptance, manufacturer's warranty as follows:
 1. Warranty Period: Ten (10) years from Date of Substantial Completion that the panel will be free from defects in lamination or separation of panel components.

1.6 QUALITY ASSURANCE

- A. Qualifications:
 1. Manufacturer Qualifications: Manufacturer shall have a minimum of 10 years demonstrated capability to produce reinforced stone veneer panels of the quality and scope required. Manufacturer shall have completed independent laboratory tests verifying performance capabilities and shall be able to furnish a list of references and previous projects of similar size and scope. Manufacturer must

have acceptance by the appropriate building code authority with established ongoing building authority quality control. Manufacturer shall be capable of providing detailed shop drawings, field service representation during construction, and approval of acceptable installers and approval of application method.

2. Installer Qualifications: Installer to demonstrate experience (as determined by contractor) to perform work of this section and who has specialized in the installation of work similar to that required for this project and is deemed acceptable to product manufacturer.

- B. Pre-Installation Meetings: Conduct pre-installation meeting to verify project requirements, substrate conditions, manufacturer's installation instructions, and manufacturer's warranty requirements.

1.7 DELIVERY, STORAGE, AND HANDLING

- A. Ordering: Comply with manufacturer's ordering instructions and lead-time requirements to avoid construction delays.
- B. Packing, Shipping, Handling and Unloading: Deliver materials in manufacturer's original, unopened, undamaged containers with identification labels intact.
- C. Storage and Protection: Store materials protected from exposure to harmful weather conditions. Handle material and components to avoid damage. Protect material against damage from elements, construction activities, and other hazards before, during and after installation.

PART 2 - PRODUCTS

2.1 MATERIALS

- A. Natural Stone Honeycomb Reinforced Wall Cladding System:
 1. Material Standard: Natural stone bonded to lightweight (aircraft quality) aluminum honeycomb having epoxy impregnated glass cloth skins.
 2. Facing: 3/16" (4.8mm) +/- 1/16" (1.6 mm) natural stone.
 3. Reinforcing: 3/4" (19mm) aluminum honeycomb bonded by high strength epoxy impregnated reinforced glass cloth.

2.2 ACCESSORIES

- A. Connection and anchorage hardware, including interlocking channels, anchor plates, Z-sections, angle clips and threaded inserts.

2.3 RELATED MATERIALS

- A. Sealants: Sealant materials specified in section 07 92 00 shall be tested for compatibility with the natural stone honeycomb reinforced wall cladding specified.

2.4 FABRICATION**A. General:**

1. Fabricate components on the structure intended to receive panels per manufacturer's installation instructions and with minimum clearances and shim spacing.

2.5 STONE TYPE AND FINISHES

Stone Type and finish to be selected from manufacturer's standard palette.

2.6 SOURCE QUALITY CONTROL

- A. Source Quality:** Provide Natural Stone Honeycomb Reinforced Wall Cladding System specified herein from a single source.

PART 3 - EXECUTION**3.1 EXAMINATION**

- A. Site Verification of Conditions:** Verify substrate conditions (which have been previously installed under other sections) are acceptable for product installation in accordance with manufacturer's instructions. Verify modules are sized to receive natural stone honeycomb reinforced wall cladding system in accordance with manufacturer's acceptable tolerances.
1. **Field Measurements:** Verify actual measurements/openings by field measurements before fabrication. Confirm recorded measurements on shop drawings. Coordinate field measurements and fabrication schedule with construction progress to avoid construction delays.

3.2 INSTALLATION

- A. General:** Install lightweight honeycomb reinforced natural stone panel systems plumb, level and true to line, with manufacturer's prescribed tolerances and installation instructions. Provide supports and anchor in place.
1. **Dissimilar Materials:** Provide separation of aluminum materials from sources of corrosion or electrolytic action contact points.
 2. **Weather Tight Construction:** Refer to installation instructions & consult sealant manufacture for project specific application. Coordinate installation with wall flashings and other components of construction.
- B. Related Products Installation Requirements:**
1. **Sealants (Perimeter):** Refer to Section 7 Joint Treatment (Sealants).

3.3 PROTECTION AND CLEANING

- A. Protection: Protect installed product's finish surfaces from damage during construction. Protect stone facing from damage from harmful contaminants.
- B. Cleaning: Repair or replace damaged installed products. Clean installed products in accordance with manufacturer's instructions prior to owner's acceptance. Remove construction debris from project site and legally dispose of debris.

- - - E N D - - -

**0SECTION 05 12 00
STRUCTURAL STEEL FRAMING**

PART 1 - GENERAL

1.1 DESCRIPTION:

This section specifies structural steel shown and classified by Section 2, Code of Standard Practice for Steel Buildings and Bridges and material and services required for installation of shear connection studs.

1.2 RELATED WORK:

- A. Materials testing and inspection during construction: Section 01 45 29, TESTING LABORATORY SERVICES.
- B. Painting: Section 09 91 00, PAINTING.
- C. Steel Decking: Section 05 31 00, STEEL DECKING.
- D. Composite Steel Deck: Section 05 36 00, COMPOSITE METAL DECKING.
- E. Fireproofing: Section 07 81 00, APPLIED FIREPROOFING.

1.3 QUALITY ASSURANCE:

- A. Fabricator and erector shall maintain a program of quality assurance in conformance with Section 8, Code of Standard Practice for Steel Buildings and Bridges. Work shall be fabricated in an AISC certified Category Conventional Steel Structures fabrication plant.
- B. Before authorizing the commencement of steel erection, the controlling contractor shall ensure that the steel erector is provided with the written notification required by 29 CFR 1926.752. Provide copy of this notification to the Contracting Officer's Technical Representative (COTR).

1.4 TOLERANCES:

Fabrication tolerances for structural steel shall be held within limits established by ASTM A6, by Section 7, Code of Standard Practice for Buildings and Bridges, and by Standard Mill Practice - General Information, except as follows:

- A. Elevation tolerance for column splice points at time member is erected is 10 mm (3/8 inch).
- B. Elevation tolerance for top surface of steel beams and girders at connections to columns at time floor is erected is 13 mm (1/2 inch).
- C. Elevation tolerance for closure plates at the building perimeter and at slab openings prior to concrete placement is 6 mm (1/4 inch).

1.5 DESIGN:

- A. Connections: Design and detail all connections for each member size, steel grade and connection type to resist the loads and reactions indicated on the drawings or specified herein. Use details consistent with the details shown on the Drawings, supplementing where necessary. The details shown on the Drawings are conceptual and do not indicate the required weld sizes or number of bolts unless specifically noted. Use rational engineering design and standard practice in detailing, accounting for all loads and eccentricities in both the connection and the members. Promptly notify the COTR of any location where the connection design criteria is not clearly indicated. The design of all connections is subject to the review and acceptance of the COTR. Submit structural calculations prepared and sealed by a qualified engineer registered in the state where the project is located. Submit calculations for review before preparation of detail drawings.

1.6 REGULATORY REQUIREMENTS:

- A. AISC: Specification for Structural Steel Buildings.
- B. AISC: Code of Standard Practice for Steel Buildings and Bridges.

1.7 SUBMITTALS:

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Shop and Erection Drawings: Complete
- C. Certificates:
 - 1. Structural steel.
 - 2. Steel for all connections.
 - 3. Welding materials.
 - 4. Shop coat primer paint.
- D. Test Reports:
 - 1. Welders' qualifying tests.
- E. Design Calculations and Drawings:
 - 1. Connection calculations, for braced frame connections.
- F. Record Surveys.
- G. Test Report - Stud base qualification.
- H. Welding power setting recommendation by shear stud manufacturer.
- I. Shear Stud Layouts: Submit drawings showing the number, pattern, spacing and configuration of the shear studs for each beam and girder.

1.8 APPLICABLE PUBLICATIONS:

- A. Publications listed below form a part of this specification to extent referenced. Publications are referenced in text by basic designation only.
- B. American Institute of Steel Construction (AISC):
 - 1. Specification for Structural Steel Buildings - Allowable Stress Design and Plastic Design (Ninth Edition, 1989)
 - 2. Load and Resistance Factor Design Specification for Structural Steel Buildings (Second Edition, 1995)
 - 3. Code of Standard Practice for Steel Buildings and Bridges (March 2000).
- C. American National Standards Institute (ANSI):
 - B18.22.1-98.....Plain Washers
 - B18.22M-00.....Metric Plain Washers
- D. American Society for Testing and Materials (ASTM):
 - A6/A6M-02.....Standard Specification for General Requirements for Rolled Structural Steel Bars, Plates, Shapes, and Sheet Piling
 - A36/A36M-01.....Standard Specification for Carbon Structural Steel
 - A53/A53M-01.....Standard Specification for Pipe, Steel, Black and Hot-Dipped, Zinc-Coated Welded and Seamless
 - A123/A123M-02.....Standard Specification for Zinc (Hot-Dip Galvanized) Coatings on Iron and Steel Products
 - A242/A242M-01.....Standard Specification for High-Strength Low-Alloy Structural Steel
 - A283/A283M-00.....Standard Specification for Low and Intermediate Tensile Strength Carbon Steel Plates
 - A307-00.....Standard Specification for Carbon Steel Bolts and Studs, 60,000 psi Tensile Strength
 - A325-02.....Standard Specification for Structural Bolts, Steel, Heat Treated, 120/105 ksi Minimum Tensile Strength
 - A500-01.....Standard Specification for Cold Formed Welded and Seamless Carbon Steel Structural Tubing in Rounds and Shapes
 - A992/A992M-02.....Standard Specification for Structural Steel Shapes

- E. American Welding Society (AWS):
 - D1.1-02.....Structural Welding Code-Steel
- F. Research Council on Structural Connections (RCSC) of The Engineering Foundation:
 - Specification for Structural Joints Using ASTM A325 or A490 Bolts
- G. Military Specifications (Mil. Spec.):
 - MIL-P-21035.....Paint, High Zinc Dust Content, Galvanizing, Repair
- H. Occupational Safety and Health Administration (OSHA):
 - 29 CFR Part 1926-2001...Safety Standards for Steel Erection

PART 2 - PRODUCTS

2.1 MATERIALS:

- A. Structural Steel: ASTM A992 for W-shapes; ASTM A36 for channels, angles and plate material.
- B. Structural Tubing: ASTM A500, Grade B.
- D. Steel Pipe: ASTM A53, Grade B.
- E. Bolts, Nuts and Washers:
 - 1. High-strength bolts, including nuts and washers: ASTM A325.
 - 2. Bolts and nuts, other than high-strength: ASTM A307, Grade A.
 - 3. Plain washers, other than those in contact with high-strength bolt heads and nuts: ANSI Standard B18.22.1.
- F. Zinc Coating: ASTM A123.
- G. Galvanizing Repair Paint: Mil. Spec. MIL-P-21035.
- H. Shear connector studs: ASTM A108, Grades 1015-1020, yield 350 Mpa (50,000 psi) minimum, tensile strength - 400 Mpa (60,000 psi) minimum, reduction of area 50 percent minimum. Studs of uniform diameter; heads shall be concentric and normal to shaft; stud, after welding free from any substance or defect which would interfere with its function as a shear connector. Studs shall not be painted or galvanized. Size of studs shall be as shown on drawings. Studs manufactured by a company normally engaged in the manufacture of shear studs and can furnish equipment suitable for weld-through installation of shear studs.

PART 3 - EXECUTION

3.1 CONNECTIONS (SHOP AND FIELD):

- A. Welding: Welding in accordance with AWS D1.1. Welds shall be made only by welders and welding operators who have been previously qualified by tests as prescribed in AWS D1.1 to perform type of work required.

- B. High-Strength Bolts: High-strength bolts tightened to a bolt tension not less than proof load given in Specification for Structural Joints Using ASTM A325 or A490 Bolts. Tightening done with properly calibrated wrenches, by turn-of-nut method or by use of direct tension indicators (bolts or washers). Tighten bolts in connections identified as slip-critical using Direct Tension Indicators or the turn-of-the-nut method. Twist-off torque bolts are not an acceptable alternate fastener for slip critical connections.

3.2 FABRICATION:

Fabrication in accordance with Chapter M, Specification for Steel Buildings.

3.3 SHOP PAINTING:

- A. General: Shop paint steel with primer in accordance with Section 6, Code of Standard Practice for Steel Buildings and Bridges.
- B. Shop paint for steel surfaces is specified in Section 09 91 00, PAINTING.
- C. Do not apply paint to following:
 - 1. Surfaces within 50 mm (2 inches) of joints to be welded in field.
 - 2. Surfaces which will be encased in concrete.
 - 3. Surfaces which will receive sprayed on fireproofing.
 - 4. Top flange of members which will have shear connector studs applied.
- D. Structural steel in the interstitial space that does not receive sprayed on fireproofing shall be painted with primer in accordance with general requirement of shop painting.
- E. Zinc Coated (Hot Dip Galvanized) per ASTM A123 (after fabrication):
Touch-up after erection: Clean and wire brush any abraded and other spots worn through zinc coating, including threaded portions of bolts and welds and touch-up with galvanizing repair paint.

3.4 ERECTION:

- A. General: Erection in accordance with Section 7, Code of Standard Practice for Steel Buildings and Bridges.
- B. Temporary Supports: Temporary support of structural steel frames during erection in accordance with Section 7, Code of Standard Practice for Steel Buildings and Bridges.
- C. Installation of shear connector studs through previously installed metal deck to conform to AWS D1.1, Section 7, except all studs will be installed with automatically timed welding equipment and as specified below:

1. Do not place reinforcing steel temperature mesh or other materials and equipment which will interfere with stud installation on steel deck until shear connector studs are installed.
2. Steel deck sheets shall be free of oil, rust, dirt, and paint. Release water in deck's valley so that it does not become entrapped between deck and beam. Surface to which stud is to be welded shall be clean and dry.
3. Rest metal deck tightly upon top flange of structural member with bottom of deck rib in full contact with top of beam flange.
4. Weld studs only through a single thickness of deck. Place decking so that a butt joint is obtained. Place studs directly over beam web, where one row of studs are required.
5. Ferrules specially developed for the weld-through technique must be used. Ferrules shall be appropriate for size of studs used and be removed after welding.
6. Submit report of successful test program for stud base qualification as required by AWS D1.1, Appendix K.

3.5 FIELD PAINTING:

- A. After erection, touch-up steel surfaces specified to be shop painted. After welding is completed, clean and prime areas not painted due to field welding.
- B. Finish painting of steel surfaces is specified in Section 09 91 00, PAINTING.

3.6 SURVEY:

Upon completion of finish bolting or welding on any part of the work, and prior to start of work by other trades that may be supported, attached, or applied to the structural steel work, submit a certified report of survey to COTR for approval. Reports shall be prepared by Registered Land Surveyor or Registered Civil Engineer as specified in Section 01 00 00, GENERAL REQUIREMENTS. Report shall specify that location of structural steel is acceptable for plumbness, level and alignment within specified tolerances specified in the AISC Manual.

- - - E N D - - -

**SECTION 05 31 00
STEEL DECKING**

PART 1 - GENERAL

1.1 DESCRIPTION:

This section specifies material and services required for installation of steel decking as shown and specified.

1.2 RELATED WORK:

- A. Materials testing and inspection during construction: Section 01 45 29, TESTING LABORATORY SERVICES.
- B. Finish Painting: Section 09 91 00, PAINTING.

1.3 DESIGN REQUIREMENTS:

- A. Design steel decking in accordance with AISI publication, "Specification for the Design of Cold-formed Steel Structural Members" except as otherwise shown or specified.
- B. Design all elements with the latest published version of applicable codes.

1.4 SUBMITTALS:

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Shop Drawings: Shop and erection drawings showing decking unit layout, connections to supporting members, and similar information necessary for completing installation as shown and specified, including supplementary framing, sump pans, ridge and valley plates, cant strips, cut openings, special jointing or other accessories. Show welding, side lap, closure, deck reinforcing and closure reinforcing details. Show openings required for work of other trades, including openings not shown on structural drawings. Indicate where temporary shoring is required to satisfy design criteria.
- C. Manufacturer's Literature and Data: Showing steel decking section properties and specifying structural characteristics.
- D. Certification: For each type and gauge of metal deck supporting concrete slab or fill, furnish certification of the specified fire ratings. Certify that the units supplied are U.L. listed as a "Steel Floor and Form Unit".
- E. Insurance Certification: Assist the Government in preparation and submittal of roof installation acceptance certification as may be necessary in connection with fire and extended coverage insurance.

1.5 QUALITY ASSURANCE:

- A. Underwriters' Label: Provide metal floor deck units listed in Underwriters' Laboratories "Fire Resistance Directory", with each deck unit bearing the UL label and marking for specific system detailed.
- B. FM Listing: Provide metal roof deck units which have been evaluated by Factory Mutual Global and are listed in "Factory Mutual Research Approval Guide" for "Class 1" fire rated construction.

1.6 APPLICABLE PUBLICATIONS:

- A. Publications listed below form a part of this specification to extent referenced. Publications are referenced in text by basic designation only.
- B. American Society for Testing and Materials (ASTM):
 - A36/A36M-08.....Standard Specification for Carbon Structural Steel
 - A611-97.....Standard Specification for Structural Steel (SS), Sheet, Carbon, Cold-Rolled
 - A653/A653M-08.....Standard Specification for Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy-Coated (Galvanized) by the Hot-Dip Process
 - C423-08.....Standard Test Method for Sound Absorption and Sound Absorption Coefficients by the Reverberation Room Method
- C. American Institute of Steel Construction (AISC):
 - 1. Specification for Structural Steel.
- D. American Iron and Steel Institute (AISI):
 - 1. Specification and Commentary for the Design of Cold-Formed Steel Structural Members
- E. American Welding Society (AWS):
 - D1.3-08.....Structural Welding Code - Sheet Steel
- F. Factory Mutual (FM Global):
 - 1. Loss Prevention Data Sheet 1-28: Wind Loads to Roof Systems and Roof Deck Securement
 - 2. Factory Mutual Research Approval Guide (2002)
- G. Military Specifications (Mil. Spec.)
 - MIL-P-21035B.....Paint, High Zinc Dust Content, Galvanizing Repair

PART 2 - PRODUCTS**2.1 MATERIALS:**

- A. Steel Decking: ASTM A653, Structural Quality.
- B. Galvanizing: ASTM A653, G60.
- C. Galvanizing Repair Paint: Mil. Spec. MIL-P-21035B.
- D. Primer for Shop Painted Sheets: Manufacturer's standard primer (2 coats). When finish painting of steel decking is specified in Section 09 91 00, PAINTING primer coating shall be compatible with specified finish painting.
- E. Miscellaneous Steel Shapes: ASTM A36.
- F. Welding Electrode: E60XX minimum.
- G. Sheet Metal Accessories: ASTM A653, galvanized, unless noted otherwise. Provide accessories of every kind required to complete the installation of metal decking in the system shown. Finish sheet metal items to match deck including, but not limited to, the following items:
 - 1. Metal Cover Plates: For end-abutting deck units, to close gaps at changes in deck direction, columns, walls and openings. Same quality as deck units but not less than 1.3 mm (18 gauge) sheet steel.
 - 2. Continuous Sheet Metal Edging: At openings, concrete slab edges and roof deck edges. Same quality as deck units but not less than 1.3 mm (18 gauge) steel. Side and end closures supporting concrete and their attachment to supporting steel shall be designed by the manufacturer to safely support the wet weight of concrete and construction loads. The deflection of cantilever closures shall be limited to 3 mm (1/8 inch) maximum.
 - 3. Metal Closure Strips: For openings between decking and other construction, of not less than 1.3 mm (18 gauge) sheet steel of the same quality as the deck units. Form to the configuration required to provide tight-fitting closures at open ends of flutes and sides of decking.
 - 4. Ridge and Valley Plates: Provide 1.3 mm (18 gauge), minimum 100 mm (4 inch) wide ridge and valley plates where roof slope exceeds 40 mm per meter (1/2 inch per foot).
 - 5. Cant Strips: Provide bent metal 45 degree leg cant strips where indicated on the Drawings. Fabricate cant strips from 1 mm (20 gauge) metal with a minimum 125 mm (5 inch) face width.
 - 6. Seat Angles for Deck: Provide where a beam does not frame into a column.

7. Sump Pans for Roof Drains: Fabricated from single piece of minimum 1.9 mm (14 gauge) galvanized sheet steel with level bottoms and sloping sides to direct water flow to drain, unless otherwise shown. Provide sump pans of adequate size to receive roof drains and with bearing flanges not less than 75 mm (3 inches) wide. Recess pans not less than 38 mm (1 1/2 inches) below roof deck surface, unless otherwise shown or required by deck configuration. Holes for drains will be cut in the field.

2.2 REQUIREMENTS:

- A. Provide steel decking of the type, depth, gauge, and section properties as shown.
- B. Metal Roof Deck: Single pan fluted units with flat horizontal top surfaces utilized to act as a permanent support for all superimposed loads. Comply with the depth and minimum gage requirements as shown on the Contract Documents.
 1. Wide Rib (Type B) deck.
 2. Finish: Galvanized G-60.
- C. Do not use steel deck for hanging supports for any type or kind of building components including suspended ceilings, electrical light fixtures, plumbing, heating, or air conditioning pipes or ducts or electrical conduits.

PART 3 - EXECUTION

3.1 ERECTION:

- A. Do not start installation of metal decking until corresponding steel framework has been plumbed, aligned and completed and until temporary shoring, where required, has been installed. Remove any oil, dirt, paint, ice, water and rust from steel surfaces to which metal decking will be welded.
- B. Coordinate and cooperate with structural steel erector in locating decking bundles to prevent overloading of structural members.
- C. Do not use deck units for storage or working platforms until permanently secured. Do not overload deck units once placed. Replace any deck units that become damaged after erection and prior to casting concrete at no cost to the Government.
- D. Provide steel decking in sufficient lengths to extend over 3 or more spans, except for interstitial levels.

- E. Place steel decking units at right angles to supporting members. End laps of sheets of roof deck shall be a minimum of 50 mm (2 inches) and shall occur over supports.
- F. Fastening Deck Units:
1. Fasten floor deck units to steel supporting members by not less than 16 mm (5/8 inch) diameter puddle welds or elongated welds of equal strength, spaced not more than 305 mm (12 inches) o.c. with a minimum of two welds per unit at each support. Where two units abut, fasten each unit individually to the supporting steel framework.
 2. Tack weld or use self-tapping No. 8 or larger machine screws at 915 mm (3 feet) o.c. for fastening end closures. Only use welds to attach longitudinal end closures.
 3. Fasten roof deck units to steel supporting members by not less than 16 mm (5/8 inch) diameter puddle welds or elongated welds of equal strength, spaced not more than 305 mm (12 inches) o.c. at every support, and at closer spacing where required for lateral force resistance by diaphragm action. Attach split or partial panels to the structure in every valley. In addition, secure deck to each supporting member in ribs where side laps occur. Power driven fasteners may be used in lieu of welding for roof deck if strength equivalent to the welding specified above is provided. Submit test data and design calculations verifying equivalent design strength.
 5. Mechanically fasten side laps of adjacent roof deck units with spans greater than 1524 mm (5 feet) between supports, at intervals not exceeding 915 mm (3 feet) o.c., or midspan, whichever is closer, using self-tapping No. 12 or larger machine screws.
 6. Provide any additional fastening necessary to comply with the requirements of Underwriters Laboratories to achieve the required ratings.
 7. Uplift Loading: Install and anchor roof deck units to resist gross uplift loading of 2.1 kPa (45 psf) at eave overhang and 1.4 kPa (30 psf) for other roof areas.
- G. Cutting and Fitting:
1. Cut all metal deck units to proper length in the shop prior to shipping.
 2. Field cutting by the metal deck erector is restricted to bevel cuts, notching to fit around columns and similar items, and cutting

openings that are located and dimensioned on the Structural Drawings.

3. Other penetrations shown on the approved metal deck shop drawings but not shown on the Structural Drawings are to be located, cut and reinforced by the trade requiring the opening.
4. Make all cuts neat and trim using a metal saw, drill or punchout device; cutting with torches is expressly prohibited.
5. Do not make any cuts in the metal deck that are not shown on the approved metal deck drawings. If an additional opening not shown on the approved shop drawings is required, submit a sketch, to scale, locating the required new opening and any other openings and supports in the immediate area. Do not cut the opening until the sketch has been reviewed and accepted by the Contracting Officer's Technical Representative (COTR). Provide any additional reinforcing or framing required for the opening at no cost to the Government. Failure to comply with these requirements is cause for rejection of the work and removal and replacement of the affected metal deck.
6. Reinforcement at Openings: Provide additional metal reinforcement and closure pieces as required for strength, continuity of decking, and support of other work shown.

3.2 WELDING:

Welds shall be made only by welders and welding operators who have been previously qualified by tests as prescribed in AWS D1.3.

3.3 FIELD REPAIR:

1. Areas scarred during erection.
2. Welds to be thoroughly cleaned and touched-up. Touch-up paint for zinc-coated units shall be zinc rich galvanizing repair paint.

- - - E N D - - -

**SECTION 05 36 00
COMPOSITE METAL DECKING**

PART 1 - GENERAL

1.1 DESCRIPTION:

This section specifies material and services required for installation of composite steel decking including miscellaneous closures required to prepare deck for concrete placement as shown and specified.

1.2 RELATED WORK:

Materials testing and inspection during construction: Section 01 45 29, TESTING LABORATORY SERVICES.

1.3 DESIGN REQUIREMENTS:

- A. Design steel decking in accordance with American Iron And Steel Institute publication "Specifications for the Design of Cold Formed Steel Structural Members", except as otherwise shown or specified.
- B. Design all elements with the latest published version of applicable codes.

1.4 SUBMITTALS:

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Shop Drawings: Shop and erection drawings showing decking unit layout, connections to supporting members, and information necessary to complete the installation as shown and specified, including supplementary framing, cant strips, cut openings, special jointing or other accessories. Show welding, side lap, closure, deck reinforcing and closure reinforcing details. Show openings required for work of other trades, including openings not shown on structural drawings. Indicate where temporary shoring is required to satisfy design criteria.
- C. Manufacturer's Literature and Data: Showing steel decking section properties and specifying structural characteristics as specified herein.
- D. Manufacturer's written recommendations for:
 - 1. Shape of decking section to be used.
 - 2. Cleaning of steel decking prior to concrete placement.
- E. Test Report - Establishing structural characteristics of composite concrete and steel decking system.

- F. Certification: For each type and gauge of metal deck supporting concrete slab or fill, furnish certification of the specified fire ratings. Certify that the units supplied are U.L. listed as a "Steel Floor and Form Unit".

1.5 QUALITY ASSURANCE:

Underwriters' Label: Provide metal floor deck units listed in Underwriters' Laboratories "Fire Resistance Directory", with each deck unit bearing the UL label and marking for specific system detailed.

1.6 APPLICABLE PUBLICATIONS:

- A. Publications listed below form a part of this specification to extent referenced. Publications are referenced in text by basic designation only. Refer to the latest edition of all referenced Standards and codes.
- B. American Iron and Steel Institute (AISI):
Specification and Commentary for the Design of Cold-Formed Steel Structural Members (Latest Edition).
- C. American Society of Testing and Materials (ASTM):
A36/A36M.....Standard Specification for Carbon Structural Steel
A108.....Standard Specification for Steel Bars, Carbon, Cold Finished, Standard Quality
A653/A653M.....Standard Specification for Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy-Coated (Galvanized) by the Hot-Dip Process
- D. American Institute of Steel Construction (AISC):
1. Specification for Structural Steel Buildings.
- E. American Welding Society (AWS):
D1.1.....Structural Welding Code - Steel
D1.3.....Structural Welding Code - Sheet Steel
- F. Military Specifications (Mil. Spec.):
MIL-P-21035B.....Paint, High Zinc Dust Content, Galvanizing Repair

PART 2 - PRODUCTS

2.1 MATERIALS:

- A. Steel Decking and all Flashings: ASTM A653, Structural Quality suitable for shear stud weld-through techniques.
- B. Galvanizing: ASTM A653, G60.
- C. Galvanizing Repair Paint: Mil. Spec. MIL-P-21035B.

- D. Miscellaneous Steel Shapes: ASTM A36.
- E. Welding Electrode: E60XX minimum.
- F. Sheet Metal Accessories: ASTM A653, galvanized, unless noted otherwise. Provide accessories of every kind required to complete the installation of metal decking in the system shown. Finish sheet metal items to match deck including, but not limited to, the following items:
 - 1. Metal Cover Plates: For end-abutting deck units, to close gaps at changes in deck direction, columns, walls and openings. Same quality as deck units but not less than 1.3 mm (18 gauge) sheet steel.
 - 2. Continuous sheet metal edging: at openings and concrete slab edges. Same quality as deck units but not less than 1.3 mm (18 gauge) steel. Side and end closures supporting concrete and their attachment to supporting steel shall be designed by the manufacturer to safely support the wet weight of concrete and construction loads. The deflection of cantilever closures shall be limited to 3 mm (1/8 inch) maximum.
 - 3. Metal Closure Strips: For openings between decking and other construction, of not less than 1.3 mm (18 gauge) sheet steel of the same quality as the deck units. Form to the configuration required to provide tight-fitting closures at open ends of flutes and sides of decking.
 - 4. Seat angles for deck: Where a beam does not frame into a column.

2.2 REQUIREMENTS:

- A. Steel decking depth, gage, and section properties to be as shown. Provide edges of deck with vertical interlocking male and female lip providing for a positive mechanical connection.
- B. Fabricate deck units with integral embossments to provide mechanical bond with concrete slab. In combination with concrete slab, capable of supporting total design loads on spans shown.
- C. Steel decking capable of safely supporting total, normal construction service loads without damage to decking unit.
- D. Steel decking units shall include an integral system which provides a simple point of attachment for light duty hanger devices for flexibility for attaching hangers for support of acoustical, lathing, plumbing, heating, air conditioning and electrical items. System shall provide for minimum spacing pattern of 300 mm (12 inches) on centers longitudinally and 600 mm or 900 mm (24 or 36 inches) on centers transversely. Suspension system shall be capable of safely supporting a

maximum allowable load of 45 kg (100 pounds) concentrated at any one hanger attachment point. System may consist of fold-down type hanger tabs or a lip hanger.

PART 3 - EXECUTION

3.1 ERECTION:

- A. Do not start installation of metal decking until corresponding steel framework has been plumbed, aligned and completed and until temporary shoring, where required, has been installed. Remove any oil, dirt, paint, ice, water and rust from steel surfaces to which metal decking will be welded.
- B. Coordinate and cooperate with structural steel erector in locating decking bundles to prevent overloading of structural members.
- C. Do not use floor deck units for storage or working platforms until permanently secured. Do not overload deck units once placed. Replace any deck units that become damaged after erection and prior to casting concrete at no cost to the Government.
- D. Erect steel deck in accordance with manufacturer's printed instructions.
- E. Ship steel deck units to project in standard widths and cut to proper length.
- F. Provide steel decking in sufficient lengths to extend over 3 or more spans, except where structural steel layout does not permit.
- G. Place steel decking units on supporting steel framework and adjust to final position before being permanently fastening. Bring each unit to proper bearing on supporting beams. Place deck units in straight alignment for entire length of run of flutes and with close registration of flutes of one unit with those of abutting unit. Maximum space between ends of abutting units is 13 mm (1/2 inch). If space exceeds 13 mm (1/2 inch), install closure plates at no additional cost to Government.
- H. Ceiling hanger loops, if used, must be flattened or removed to obtain bearing of units on structural steel.
- I. Fastening Deck Units:
 - 1. Fasten floor deck units to steel supporting members by not less than 16 mm (5/8 inch) diameter puddle welds or elongated welds of equal strength, spaced not more than 305 mm (12 inches) o.c. with a minimum of two welds per unit at each support. Where two units abut, fasten each unit individually to the supporting steel framework.

2. Tack weld or use self-tapping No. 8 or larger machine screws at 915 mm (3 feet) o.c. for fastening end closures. Only use welds to attach longitudinal end closures.
 3. Screw side laps of adjacent floor deck units with No. 12 x 3/4-inch long or larger machine screws. Fasten at midspan or 915 mm (16 inches) o.c., whichever is smaller.
- J. Welding to conform to AWS D1.3 and done by competent experienced welding mechanics.
- K. Areas scarred during erection and welds shall be thoroughly cleaned and touched-up with zinc rich galvanizing repair paint. Paint touch-up is not required for welds or scars that are to be in direct contact with concrete.
- L. Provide metal concrete stops at edges of deck as required.
- M. Cutting and Fitting:
1. Cut all metal deck units to proper length in the shop prior to shipping.
 2. Field cutting by the metal deck erector is restricted to bevel cuts, notching to fit around columns and similar items, and cutting openings that are located and dimensioned on the structural drawings.
 3. Other penetrations shown on the approved metal deck shop drawings but not shown on the structural drawings are to be located, cut and reinforced by the trade requiring the opening.
 4. Make all cuts neat and trim using a metal saw, drill or punchout device; cutting with torches is expressly prohibited.
 5. Do not make any cuts in the metal deck that are not shown on the approved metal deck drawings. If an additional opening not shown on the approved shop drawings is required, submit a sketch, to scale, locating the required new opening and any other openings and supports in the immediate area. Do not cut the opening until the sketch has been reviewed and accepted by the Contracting Officer's Technical Representative (COTR). Provide any additional reinforcing or framing required for the opening at no cost to the Government. Failure to comply with these requirements is cause for rejection of the work and removal and replacement of the affected metal deck.
 6. Reinforcement at Openings: Provide additional metal reinforcement and closure pieces as required for strength, continuity of decking and support of other work shown.

3.2 CLEANING:

Clean deck in accordance with manufacturer's recommendation before concrete placement.

- - - E N D - - -

**SECTION 05 40 00
COLD-FORMED METAL FRAMING**

PART 1 - GENERAL

1.1 DESCRIPTION:

A. This section specifies materials and services required for installation of cold-formed steel, including tracks and required accessories as shown and specified. This Section includes the following:

1. Exterior non-load-bearing steel stud curtain wall.

1.2 RELATED WORK:

- A. Structural steel framing: Section 05 12 00, STRUCTURAL STEEL FRAMING.
- B. Non-load-bearing metal stud framing assemblies: Section 09 22 16, NON-STRUCTURAL METAL FRAMING.
- C. Gypsum board assemblies: Section 09 29 00, GYPSUM BOARD.

1.3 DESIGN REQUIREMENTS:

- A. Design steel in accordance with American Iron and Steel Institute Publication "Specification for the Design of Cold-Formed Steel Structural Members", except as otherwise shown or specified.
- B. Structural Performance: Engineer, fabricate, and erect cold-formed metal framing to withstand design loads within limits and under conditions required.
 1. Design Loads: As indicated.
 2. Design framing systems to withstand design loads without deflections greater than the following:
 3. Design framing systems to provide for movement of framing members without damage or overstressing, sheathing failure, connection failure, undue strain on fasteners and anchors, or other detrimental effects when subject to a maximum ambient temperature change (range) of 67 degrees C (120 degrees F).
 4. Design framing system to accommodate deflection of primary building structure and construction tolerances, and to maintain clearances at openings.
 5. Design exterior non-load-bearing curtain wall framing to accommodate lateral deflection without regard to contribution of sheathing materials.
 6. Engineering Responsibility: Engage a fabricator who assumes undivided responsibility for engineering cold-formed metal framing

by employing a qualified professional engineer to prepare design calculations, shop drawings, and other structural data.

1.4 SUBMITTALS:

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Shop Drawings: Shop and erection drawings showing steel unit layout, connections to supporting members, and information necessary to complete installation as shown and specified.
- C. Manufacturer's Literature and Data: Showing steel component sections and specifying structural characteristics.
- D. For cold-formed metal framing indicated to comply with certain design loadings, include structural analysis data sealed and signed by the qualified professional engineer who was responsible for its preparation.

1.5 APPLICABLE PUBLICATIONS:

- A. Publications listed below form a part of this specification to extent referenced. Publications are referenced in text by basic designation only.
- B. American Iron and Steel Institute (AISI):
Specification and Commentary for the Design of Cold-Formed Steel Structural Members (1996)
- C. American Society of Testing and Materials (ASTM):
A36/A36M(REV. A)-2003...Standard Specifications for Carbon Structural Steel
A123/A123M-2002.....Standard Specifications for Zinc (Hot-Dip Galvanized) Coatings on Iron and Steel Products
A153/A153M-2003.....Standard Specifications for Zinc Coating (Hot-Dip) on Iron and Steel Hardware
A307-2002.....Standard Specifications for Carbon Steel Bolts and Studs
A653/A653M-2003.....Standard Specifications for Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy-Coated (Galvannealed) by the Hot-Dip Process
C955-2003.....Standard Specifications for Load-Bearing (Transverse and Axial) Steel Studs, Runners (Tracks), and Bracing or Bridging for Screw Application of Gypsum Panel Products and Metal Plaster Bases

- C1107-2002.....Standard Specifications for Packaged Dry,
Hydraulic-Cement Grout (Non-shrink)
- E488-96(Reapproved 2003)Standard Test Methods for Strength of Anchors
in Concrete and Masonry Elements
- E1190-95(Reapproved 2000)Standard Test Methods for Strength of Power-
Actuated Fasteners Installed in Structural
Members
- D. American Welding Society (AWS):
D1.3-(98).....Structural Welding Code-Sheet Steel
- E. Military Specifications (Mil. Spec.):
MIL-P-21035B(Reinst. Notice 2) Paint, High Zinc Dust Content,
Galvanizing Repair

PART 2 - PRODUCTS

2.1 MATERIALS:

- A. Sheet Steel for, studs and accessories 16 gage and heavier: ASTM A653, structural steel, zinc coated G90, with a yield of 340 MPa (50 ksi) minimum.
- B. Sheet Steel for joists, studs and accessories 18 gage and lighter: ASTM A653, structural steel, zinc coated G60, with a yield of 230 MPa (33 ksi) minimum.
- C. Galvanizing Repair Paint: MIL-P-21035B.
- D. Nonmetallic, Non-shrink Grout: Premixed, nonmetallic, noncorrosive, nonstaining grout containing selected silica sands, Portland cement, shrinkage-compensating agents, plasticizing and water-reducing agents, complying with ASTM C1107, with fluid consistency and a 30 minute working time.

2.2 WALL FRAMING:

- A. Steel Studs: Manufacturer's standard C-shaped steel studs of web depth indicated, with lipped flanges, and complying with the following:
1. Design Uncoated-Steel Thickness:
1.20 mm (0.0474 inch), unless otherwise indicated.
 2. Flange Width:
(1-5/8 inches)
 3. Web: Punched.
- B. Steel Track: Manufacturer's standard U-shaped steel track, unpunched, of web depths indicated, with straight flanges, and complying with the following:
1. Design Uncoated-Steel Thickness: Matching steel studs.

- 2. Flange Width: Manufacturer's standard deep flange where indicated, standard flange elsewhere.
- C. Rigid Stud Clip: Provide StiffClip CL600-118(H) by the Steel Network, Inc. or equal

2.3 FRAMING ACCESSORIES:

- A. Fabricate steel framing accessories of the same material and finish used for framing members, with a minimum yield strength of 230 MPa (33 ksi).
- B. Provide accessories of manufacturer's standard thickness and configuration, unless otherwise indicated, as follows:
 - 1. Supplementary framing.
 - 2. Bracing, bridging, and solid blocking.
 - 3. Web stiffeners.
 - 4. Gusset plates.
 - 5. Deflection track and vertical slide clips.
 - 6. Stud kickers and girts.
 - 7. Joist hangers and end closures.
 - 8. Reinforcement plates.

2.4 ANCHORS, CLIPS, AND FASTENERS:

- A. Steel Shapes and Clips: ASTM A36, zinc coated by the hot-dip process according to ASTM A123.
- B. Cast-in-Place Anchor Bolts and Studs: ASTM A307, Grade A, zinc coated by the hot-dip process according to ASTM A153.
- C. Expansion Anchors: Fabricated from corrosion-resistant materials, with capability to sustain, without failure, a load equal to 5 times the design load, as determined by testing per ASTM E488 conducted by a qualified independent testing agency.
- D. Power-Actuated Anchors: Fastener system of type suitable for application indicated, fabricated from corrosion-resistant materials, with capability to sustain, without failure, a load equal to 10 times the design load, as determined by testing per ASTM E1190 conducted by a qualified independent testing agency.
- E. Mechanical Fasteners: Corrosion-resistant coated, self-drilling, self-threading steel drill screws. Low-profile head beneath sheathing, manufacturer's standard elsewhere.

2.5 REQUIREMENTS:

- A. Welding in accordance with AWS D1.3
- B. Furnish members and accessories by one manufacturer only.

PART 3 - EXECUTION**3.1 FABRICATION:**

- A. Framing components may be preassembled into panels. Panels shall be square with components attached.
- B. Cut framing components squarely or as required for attachment. Cut framing members by sawing or shearing; do not torch cut.
- C. Hold members in place until fastened.
- D. Fasten cold-formed metal framing members by welding or screw fastening, as standard with fabricator. Wire tying of framing members is not permitted.
 - 1. Comply with AWS requirements and procedures for welding, appearance and quality of welds, and methods used in correcting welding work.
 - 2. Locate mechanical fasteners and install according to cold-formed metal framing manufacturer's instructions with screw penetrating joined members by not less than 3 exposed screw threads.
- E. Where required, provide specified insulation in double header members and double jamb studs which will not be accessible after erection.

3.2 ERECTION:

- A. Handle and lift prefabricated panels in a manner as to not distort any member.
- B. Securely anchor tracks to supports as shown.
- C. At butt joints, securely anchor two pieces of track to same supporting member or butt-weld or splice together.
- D. Plumb, align, and securely attach studs to flanges or webs of both upper and lower tracks.
- E. All axially loaded members shall be aligned vertically to allow for full transfer of the loads down to the foundation. Vertical alignment shall be maintained at floor/wall intersections.
- F. Install jack studs above and below openings and as required to furnish support. Securely attach jack studs to supporting members.
- G. Install headers in all openings that are larger than the stud spacing in that wall.
- H. Attach bridging for studs in a manner to prevent stud rotation. Space bridging rows as shown.
- I. Studs in one piece for their entire length, splices will not be permitted.
- J. Provide temporary bracing and leave in place until framing is permanently stabilized.

- K. Do not bridge building expansion joints with cold-formed metal framing. Independently frame both sides of joints.
- L. Fasten reinforcement plate over web penetrations that exceed size of manufacturer's standard punched openings.

3.3 TOLERANCES:

- A. Vertical alignment (plumbness) of studs shall be within 1/960th of the span.
- B. Horizontal alignment (levelness) of walls shall be within 1/960th of their respective lengths.
- C. Spacing of studs shall not be more than 3 mm (1/8 inch) +/- from the designed spacing providing that the cumulative error does not exceed the requirements of the finishing materials.
- D. Prefabricated panels shall be not more than 3 mm (1/8 inch) +/- out of square within the length of that panel.

3.4 FIELD REPAIR:

Touch-up damaged galvanizing with galvanizing repair paint.

- - - E N D - - -

SECTION 05 50 00
METAL FABRICATIONS

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This section specifies items and assemblies fabricated from structural steel shapes and other materials as shown and specified.
- B. Items specified.
 - 1. Support for Wall and Ceiling Mounted Items: (12, 14A, 14C)
 - 2. Frames: (24E)
 - 3. Gratings
 - 4. Loose Lintels
 - 5. Shelf Angles
 - 6. Ladders

1.2 RELATED WORK

- A. Railings attached to steel stairs: Section 05 51 00, METAL STAIRS.
- B. Colors, finishes, and textures: Section 09 06 00, SCHEDULE FOR FINISHES.
- C. Prime and finish painting: Section 09 91 00, PAINTING.
- D. Stainless steel corner guards: Section 10 26 00, WALL AND DOOR PROTECTION.

1.3 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Shop Drawings:
 - 1. Each item specified, showing complete detail, location in the project, material and size of components, method of joining various components and assemblies, finish, and location, size and type of anchors.
 - 2. Mark items requiring field assembly for erection identification and furnish erection drawings and instructions.
 - 3. Provide templates and rough-in measurements as required.
- C. Manufacturer's Certificates:
 - 1. Anodized finish as specified.
 - 2. Live load designs as specified.
- D. Design Calculations, for specified live loads including dead loads, prepared and sealed by a qualified engineer registered in the state

where the project is located. Provide calculations for all members and connections to supporting concrete, steel or masonry structure.

- E. Furnish setting drawings and instructions for installation of anchors to be preset into concrete and masonry work, and for the positioning of items having anchors to be built into concrete or masonry construction.

1.4 QUALITY ASSURANCE

- A. Each manufactured product shall meet, as a minimum, the requirements specified, and shall be a standard commercial product of a manufacturer regularly presently manufacturing items of type specified.
- B. Each product type shall be the same and be made by the same manufacturer.
- C. Assembled product to the greatest extent possible before delivery to the site.
- D. Include additional features, which are not specifically prohibited by this specification, but which are a part of the manufacturer's standard commercial product.

1.5 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American Society of Mechanical Engineers (ASME):
 - B18.6.1-81(R1997).....Wood Screws
 - B18.2.2-87(R2005).....Square and Hex Nuts
- C. American Society for Testing and Materials (ASTM):
 - A36/A36M-05.....Structural Steel
 - A47-99(R2004).....Malleable Iron Castings
 - A48-03.....Gray Iron Castings
 - A53-06.....Pipe, Steel, Black and Hot-Dipped, Zinc-Coated
Welded and Seamless
 - A123-02.....Zinc (Hot-Dip Galvanized) Coatings on Iron and
Steel Products
 - A167-99(R2004).....Stainless and Heat-Resisting Chromium-Nickel
Steel Plate, Sheet and Strip
 - A269-07.....Seamless and Welded Austenitic Stainless Steel
Tubing for General Service
 - A307-07.....Carbon Steel Bolts and Studs, 60,000 PSI
Tensile Strength

- A312/A312M-06.....Seamless, Welded, and Heavily Cold Worked
Austenitic Stainless Steel Pipes
- A391/A391M-01.....Grade 80 Alloy Steel Chain
- A653/A653M-07.....Steel Sheet, Zinc Coated (Galvanized) or Zinc-
Iron Alloy Coated (Galvannealed) by the Hot-Dip
Process
- A786/A786M-05.....Rolled Steel Floor Plate
- B221-06.....Aluminum and Aluminum-Alloy Extruded Bars,
Rods, Wire, Shapes, and Tubes
- B456-03.....Electrodeposited Coatings of Copper Plus Nickel
Plus Chromium and Nickel Plus Chromium
- B632-02.....Aluminum-Alloy Rolled Tread Plate
- C1107-07.....Packaged Dry, Hydraulic-Cement Grout
(Nonshrink)
- D3656-04.....Insect Screening and Louver Cloth Woven from
Vinyl-Coated Glass Yarns
- F436-07.....Hardened Steel Washers
- F468-06.....Nonferrous Bolts, Hex Cap Screws, and Studs for
General Use
- F593-02.....Stainless Steel Bolts, Hex Cap Screws, and
Studs
- F1667-05.....Driven Fasteners: Nails, Spikes and Staples
- D. American Welding Society (AWS):
- D1.1-04.....Structural Welding Code Steel
- D1.2-03.....Structural Welding Code Aluminum
- D1.3-98.....Structural Welding Code Sheet Steel
- E. National Association of Architectural Metal Manufacturers (NAAMM)
- AMP521-01.....Pipe Railing Manual
- AMP 500-505-1988.....Metal Finishes Manual
- MBG 531-00.....Metal Bar Grating Manual
- MBG 532-00.....Heavy Duty Metal Bar Grating Manual
- F. Structural Steel Painting Council (SSPC):
- SP 1-05.....No. 1, Solvent Cleaning
- SP 2-05.....No. 2, Hand Tool Cleaning
- SP 3-05.....No. 3, Power Tool Cleaning
- G. Federal Specifications (Fed. Spec):
- RR-T-650E.....Treads, Metallic and Nonmetallic, Nonskid

PART 2 - PRODUCTS**2.1 DESIGN CRITERIA**

- A. In addition to the dead loads, design fabrications to support the following live loads unless otherwise specified.
- B. Ladders and Rungs: 120 kg (250 pounds) at any point.
- C. Railings and Handrails: 900 N (200 pounds) in any direction at any point.
- D. Floor Plates, Gratings, Covers, Trap Doors, Catwalks, and Platforms: 500 kg/m² (100 pounds per square foot). Use 500 pounds for concentrated loads.
- E. Manhole Covers: 1200 kg/m² (250 pounds per square foot).

2.2 MATERIALS

- A. Structural Steel: ASTM A36.
- B. Stainless Steel: ASTM A167, Type 302 or 304.
- C. Aluminum, Extruded: ASTM B221, Alloy 6063-T5 unless otherwise specified. For structural shapes use alloy 6061-T6 and alloy 6061-T4511.
- D. Floor Plate:
 - 1. Steel ASTM A786.
 - 2. Aluminum: ASTM B632.
- E. Steel Pipe: ASTM A53.
 - 1. Galvanized for exterior locations.
 - 2. Type S, Grade A unless specified otherwise.
 - 3. NPS (inside diameter) as shown.
- F. Cast-Iron: ASTM A48, Class 30, commercial pattern.
- G. Malleable Iron Castings: A47.
- H. Primer Paint: As specified in Section 09 91 00, PAINTING.
- I. Stainless Steel Tubing: ASTM A269, type 302 or 304.
- J. Modular Channel Units:
 - 1. Factory fabricated, channel shaped, cold formed sheet steel shapes, complete with fittings bolts and nuts required for assembly.
 - 2. Form channel with in turned pyramid shaped clamping ridges on each side.
 - 3. Provide case hardened steel nuts with serrated grooves in the top edges designed to be inserted in the channel at any point and be given a quarter turn so as to engage the channel clamping ridges. Provide each nut with a spring designed to hold the nut in place.

4. Factory finish channels and parts with oven baked primer when exposed to view. Channels fabricated of ASTM A525, G90 galvanized steel may have primer omitted in concealed locations. Finish screws and nuts with zinc coating.
 5. Fabricate snap-in closure plates to fit and close exposed channel openings of not more than 0.3 mm (0.0125 inch) thick stainless steel.
- K. Grout: ASTM C1107, pourable type.
- L. Insect Screening: ASTM D3656.

2.3 HARDWARE

- A. Rough Hardware:
1. Furnish rough hardware with a standard plating, applied after punching, forming and assembly of parts; galvanized, cadmium plated, or zinc-coated by electro-galvanizing process. Galvanized G-90 where specified.
 2. Use G90 galvanized coating on ferrous metal for exterior work unless non-ferrous metal or stainless is used.
- B. Fasteners:
1. Bolts with Nuts:
 - a. ASME B18.2.2.
 - b. ASTM A307 for 415 MPa (60,000 psi) tensile strength bolts.
 - c. ASTM F468 for nonferrous bolts.
 - d. ASTM F593 for stainless steel.
 2. Screws: ASME B18.6.1.
 3. Washers: ASTM F436, type to suit material and anchorage.
 4. Nails: ASTM F1667, Type I, style 6 or 14 for finish work.

2.4 FABRICATION GENERAL

- A. Material
1. Use material as specified. Use material of commercial quality and suitable for intended purpose for material that is not named or its standard of quality not specified.
 2. Use material free of defects which could affect the appearance or service ability of the finished product.
- B. Size:
1. Size and thickness of members as shown.
 2. When size and thickness is not specified or shown for an individual part, use size and thickness not less than that used for the same

component on similar standard commercial items or in accordance with established shop methods.

C. Connections

1. Except as otherwise specified, connections may be made by welding, riveting or bolting.
2. Field riveting will not be approved.
3. Design size, number and placement of fasteners, to develop a joint strength of not less than the design value.
4. Holes, for bolts: Accurately punched or drilled and burrs removed.
5. Size and shape welds to develop the full design strength of the parts connected by welds and to transmit imposed stresses without permanent deformation or failure when subject to service loadings.
6. Use Rivets and bolts of material selected to prevent corrosion (electrolysis) at bimetallic contacts. Plated or coated material will not be approved.
7. Use stainless steel connectors for removable members machine screws or bolts.

D. Fasteners and Anchors

1. Use methods for fastening or anchoring metal fabrications to building construction as shown or specified.
2. Where fasteners and anchors are not shown, design the type, size, location and spacing to resist the loads imposed without deformation of the members or causing failure of the anchor or fastener, and suit the sequence of installation.
3. Use material and finish of the fasteners compatible with the kinds of materials which are fastened together and their location in the finished work.
4. Fasteners for securing metal fabrications to new construction only, may be by use of threaded or wedge type inserts or by anchors for welding to the metal fabrication for installation before the concrete is placed or as masonry is laid.
5. Fasteners for securing metal fabrication to existing construction or new construction may be expansion bolts, toggle bolts, power actuated drive pins, welding, self drilling and tapping screws or bolts.

E. Workmanship

1. General:
 - a. Fabricate items to design shown.

- b. Furnish members in longest lengths commercially available within the limits shown and specified.
 - c. Fabricate straight, true, free from warp and twist, and where applicable square and in same plane.
 - d. Provide holes, sinkages and reinforcement shown and required for fasteners and anchorage items.
 - e. Provide openings, cut-outs, and tapped holes for attachment and clearances required for work of other trades.
 - f. Prepare members for the installation and fitting of hardware.
 - g. Cut openings in gratings and floor plates for the passage of ducts, sumps, pipes, conduits and similar items. Provide reinforcement to support cut edges.
 - h. Fabricate surfaces and edges free from sharp edges, burrs and projections which may cause injury.
2. Welding:
- a. Weld in accordance with AWS.
 - b. Welds shall show good fusion, be free from cracks and porosity and accomplish secure and rigid joints in proper alignment.
 - c. Where exposed in the finished work, continuous weld for the full length of the members joined and have depressed areas filled and protruding welds finished smooth and flush with adjacent surfaces.
 - d. Finish welded joints to match finish of adjacent surface.
3. Joining:
- a. Miter or butt members at corners.
 - b. Where frames members are butted at corners, cut leg of frame member perpendicular to surface, as required for clearance.
4. Anchors:
- a. Where metal fabrications are shown to be preset in concrete, weld 32 x 3 mm (1-1/4 by 1/8 inch) steel strap anchors, 150 mm (6 inches) long with 25 mm (one inch) hooked end, to back of member at 600 mm (2 feet) on center, unless otherwise shown.
 - b. Where metal fabrications are shown to be built into masonry use 32 x 3 mm (1-1/4 by 1/8 inch) steel strap anchors, 250 mm (10 inches) long with 50 mm (2 inch) hooked end, welded to back of member at 600 mm (2 feet) on center, unless otherwise shown.
5. Cutting and Fitting:

- a. Accurately cut, machine and fit joints, corners, copes, and miters.
- b. Fit removable members to be easily removed.
- c. Design and construct field connections in the most practical place for appearance and ease of installation.
- d. Fit pieces together as required.
- e. Fabricate connections for ease of assembly and disassembly without use of special tools.
- f. Joints firm when assembled.
- g. Conceal joining, fitting and welding on exposed work as far as practical.
- h. Do not show rivets and screws prominently on the exposed face.
- i. The fit of components and the alignment of holes shall eliminate the need to modify component or to use exceptional force in the assembly of item and eliminate the need to use other than common tools.

F. Finish:

- 1. Finish exposed surfaces in accordance with NAAMM Metal Finishes Manual.
- 2. Aluminum: NAAMM AMP 501.
 - a. Mill finish, AA-M10, as fabricated, use unless specified otherwise.
 - b. Clear anodic coating, AA-C22A41, chemically etched medium matte, with Architectural Class 1, 0.7 mils or thicker.
 - c. Colored anodic coating, AA-C22A42, chemically etched medium matte with Architectural Class 1, 0.7 mils or thicker.
 - d. Painted: AA-C22R10.
- 3. Steel and Iron: NAAMM AMP 504.
 - a. Zinc coated (Galvanized): ASTM A123, G90 unless noted otherwise.
 - b. Surfaces exposed in the finished work:
 - 1) Finish smooth rough surfaces and remove projections.
 - 2) Fill holes, dents and similar voids and depressions with epoxy type patching compound.
 - c. Shop Prime Painting:
 - 1) Surfaces of Ferrous metal:
 - a) Items not specified to have other coatings.
 - b) Galvanized surfaces specified to have prime paint.

- c) Remove all loose mill scale, rust, and paint, by hand or power tool cleaning as defined in SSPC-SP2 and SP3.
- d) Clean of oil, grease, soil and other detrimental matter by use of solvents or cleaning compounds as defined in SSPC-SP1.
- e) After cleaning and finishing apply one coat of primer as specified in Section 09 91 00, PAINTING.

2) Non ferrous metals: Comply with MAAMM-500 series.

- 4. Stainless Steel: NAAMM AMP-504 Finish No. 4.
- 5. Chromium Plating: ASTM B456, satin or bright as specified, Service Condition No. SC2.

G. Protection:

- 1. Insulate aluminum surfaces that will come in contact with concrete, masonry, plaster, or metals other than stainless steel, zinc or white bronze by giving a coat of heavy-bodied alkali resisting bituminous paint or other approved paint in shop.
- 2. Spot prime all abraded and damaged areas of zinc coating which expose the bare metal, using zinc rich paint on hot-dip zinc coat items and zinc dust primer on all other zinc coated items.

2.5 SUPPORTS

A. General:

- 1. Fabricate ASTM A36 structural steel shapes as shown.
- 2. Use clip angles or make provisions for welding hangers and braces to overhead construction.
- 3. Field connections may be welded or bolted.

2.6 FRAMES

A. Elevator Entrance Wall Opening.

- 1. Fabricate of channel shapes, plates, and angles as shown.
- 2. Weld or bolt head to jamb as shown.
- 3. Weld clip angles to bottom of frame and top of jamb members extended to structure above for framed construction.
 - a. Provide holes for anchors.
 - b. Weld head to jamb members.

B. Channel Frames:

- 1. Fabricate of structural steel channels of size shown.
- 2. Miter and weld frames at corners.
- 3. Where anchored to masonry or embedded in concrete, weld to back of frame at each jamb, 5 mm (3/16 inch) thick by 44 mm (1-3/4 inch)

wide steel strap anchors with ends turned 50 mm (2 inches), and of sufficient length to extend at least 300 mm (12 inches) into wall. Space anchors 600 mm (24 inches) above bottom of frame and 600 mm (24 inches) o.c. to top of jamb. Weld clip angles to bottom of jambs and provide holes for expansion bolts.

4. Where anchored to concrete or masonry in prepared openings, drill holes at jambs for anchoring with expansion bolts. Weld clip angles to bottom of frame and provide holes for expansion bolt anchors as shown. Drill holes starting 600 mm (24 inches) above bottom of frame and 600 mm (24 inches) o.c. to top of jamb and at top of jamb. Provide pipe spacers at holes welded to channel.
5. Where closure plates are shown, continuously weld them to the channel flanges.
6. Weld continuous 19 x 19 x 3 mm (3/4 x 3/4 x 1/8 inch) thick steel angles to the interior side of each channel leg at the head and jambs to form a caulking groove.

2.7 GRATINGS

A. Steel Bar Gratings:

1. Fabricate grating using steel bars, frames, supports and other members shown in accordance with Metal Bar Grating Manual.
2. Galvanize steel members after fabrication in accordance with ASTM A123, G-90 for exterior gratings, gratings in concrete floors, and interior grating where specified.

2.8 LOOSE LINTELS

- A. Furnish lintels of sizes shown. Where size of lintels is not shown, provide the sizes specified.
- B. Fabricate lintels with not less than 150 mm (6 inch) bearing at each end for nonbearing masonry walls, and 200 mm (8 inch) bearing at each end for bearing walls.
- C. Provide one angle lintel for each 100 mm (4 inches) of masonry thickness as follows except as otherwise specified or shown.
 1. Openings 750 mm to 1800 mm (2-1/2 feet to 6 feet) - 100 x 90 x 8 mm (4 x 3-1/2 x 5/16 inch).
 2. Openings 1800 mm to 3000 mm (6 feet to 10 feet) - 150 x 90 x 9 mm (6 x 3-1/2 x 3/8 inch).
- D. For 150 mm (6 inch) thick masonry openings 750 mm to 3000 mm (2-1/2 feet to 10 feet) use one angle 150 x 90 x 9 mm (6 x 3-1/2 x 3/8 inch).
- E. Provide bearing plates for lintels where shown.

- F. Weld or bolt upstanding legs of double angle lintels together with 19 mm (3/4 inch bolts) spaced at 300 mm (12 inches) on centers.
- G. Insert spreaders at bolt points to separate the angles for insertion of metal windows, louver, and other anchorage.
- H. Where shown or specified, punch upstanding legs of single lintels to suit size and spacing of anchor bolts.
- I. Elevator Entrance:
 - 1. Fabricate lintel from plate bent to channel shape, and provide a minimum of 100 mm (4 inch) bearing each end.
 - 2. Cut away the front leg of the channel at each end to allow for concealment behind elevator hoistway entrance frame.

2.9 SHELF ANGLES

- A. Fabricate from steel angles of size shown.
- B. Fabricate angles with horizontal slotted holes for 19 mm (3/4 inch) bolts spaced at not over 900 mm (3 feet) on centers and within 300 mm (12 inches) of ends.
- C. Provide adjustable malleable iron inserts for embedded in concrete framing.

2.10 LADDERS

- A. Steel Ladders:
 - 1. Fixed-rail type with steel rungs shouldered and headed into and welded to rails.
 - 2. Fabricate angle brackets of 50 mm (2 inch) wide by 13 mm (1/2 inch) thick steel; brackets spaced maximum of 1200 mm (4 feet) apart and of length to hold ladder 175 mm (7 inches) from wall to center of rungs. Provide turned ends or clips for anchoring.
 - 3. Provide holes for anchoring with expansion bolts through turned ends and brackets.
 - 4. Where shown, fabricate side rails curved, twisted and formed into a gooseneck.
 - 5. Galvanize exterior ladders after fabrication, ASTM A123, G-90.

2.11 RAILINGS

- A. In addition to the dead load design railing assembly to support live load specified.
- B. Fabrication General:
 - 1. Provide continuous welded joints, dressed smooth and flush.
 - 2. Standard flush fittings, designed to be welded, may be used.
 - 3. Exposed threads will not be approved.

4. Form handrail brackets to size and design shown.
5. Exterior Post Anchors.
 - a. Fabricate tube or pipe sleeves with closed ends or plates as shown.
 - b. Where inserts interfere with reinforcing bars, provide flanged fittings welded or threaded to posts for securing to concrete with expansion bolts.
6. Interior Post Anchors:
 - a. Provide flanged fittings for securing fixed posts to floor with expansion bolts, unless shown otherwise.
 - b. Weld or thread flanged fitting to posts at base.
 - c. For securing removable posts to floor, provide close fitting sleeve insert or inverted flange base plate with stud bolts or rivets concrete anchor welded to the base plate.
 - d. Weld flange base plate to removable posts set in sleeves.
- C. Handrails:
 1. Close free ends of rail with flush metal caps welded in place except where flanges for securing to walls with bolts are shown.
 2. Make provisions for attaching handrail brackets to wall, posts, and handrail as shown.
- D. Steel Pipe Railings:
 1. Fabricate of steel pipe with welded joints.
 2. Number and space of rails as shown.
 3. Space posts for railings not over 1800 mm (6 feet) on centers between end posts.
 4. Form handrail brackets from malleable iron.

PART 3 - EXECUTION

3.1 INSTALLATION, GENERAL

- A. Set work accurately, in alignment and where shown, plumb, level, free of rack and twist, and set parallel or perpendicular as required to line and plane of surface.
- B. Items set into concrete or masonry.
 1. Provide temporary bracing for such items until concrete or masonry is set.
 2. Place in accordance with setting drawings and instructions.
 3. Build strap anchors, into masonry as work progresses.

- C. Set frames of gratings, covers, corner guards, trap doors and similar items flush with finish floor or wall surface and, where applicable, flush with side of opening.
- D. Field weld in accordance with AWS.
 - 1. Design and finish as specified for shop welding.
 - 2. Use continuous weld unless specified otherwise.
- E. Install anchoring devices and fasteners as shown and as necessary for securing metal fabrications to building construction as specified. Power actuated drive pins may be used except for removable items and where members would be deformed or substrate damaged by their use.
- F. Spot prime all abraded and damaged areas of zinc coating as specified and all abraded and damaged areas of shop prime coat with same kind of paint used for shop priming.
- G. Isolate aluminum from dissimilar metals and from contact with concrete and masonry materials as required to prevent electrolysis and corrosion.
- H. Secure escutcheon plate with set screw.

3.2 INSTALLATION OF SUPPORTS

- A. Anchorage to structure.
 - 1. Secure angles or channels and clips to overhead structural steel by continuous welding unless bolting is shown.
 - 2. Secure supports to concrete inserts by bolting or continuous welding as shown.
 - 3. Secure supports to mid height of concrete beams when inserts do not exist with expansion bolts and to slabs, with expansion bolts. unless shown otherwise.
 - 4. Secure steel plate or hat channels to studs as detailed.
- B. Supports for Wall Mounted items:
 - 1. Locate center of support at anchorage point of supported item.
 - 2. Locate support at top and bottom of wall hung cabinets.
 - 3. Locate support at top of floor cabinets and shelving installed against walls.
 - 4. Locate supports where required for items shown.

3.3 DOOR FRAMES

- A. Secure clip angles at bottom of frames to concrete slab with expansion bolts as shown.
- B. Level and plumb frame; brace in position required.

- C. At masonry, set frames in walls so anchors are built-in as the work progresses unless shown otherwise.
- D. Set frames in formwork for frames cast into concrete.
- E. Where frames are set in prepared openings, bolt to wall with spacers and expansion bolts.

3.4 OTHER FRAMES

- A. Set frame flush with surface unless shown otherwise.
- B. Anchor frames at ends and not over 450 mm (18 inches) on centers unless shown otherwise.
- C. Set in formwork before concrete is placed.

3.5 STEEL LINTELS

- A. Use lintel sizes and combinations shown or specified.
- B. Install lintels with longest leg upstanding, except for openings in 150 mm (6 inch) masonry walls install lintels with longest leg horizontal.
- C. Install lintels to have not less than 150 mm (6 inch) bearing at each end for nonbearing walls, and 200 mm (8 inch) bearing at each end for bearing walls.

3.6 SHELF ANGLES

- A. Anchor shelf angles with 19 mm (3/4 inch) bolts unless shown otherwise in adjustable malleable iron inserts, set level at elevation shown.
- B. Provide expansion space at end of members.

3.7 LADDERS

- A. Anchor ladders to walls and floors with expansion bolts through turned lugs or angle clips or brackets.
- B. In elevator pits, set ladders to clear all elevator equipment where shown on the drawings.
 - 1. Where ladders are interrupted by division beams, anchor ladders to beams by welding, and to floors with expansion bolts.
 - 2. Where ladders are adjacent to division beams, anchor ladders to beams with bent steel plates, and to floor with expansion bolts.
- C. Ladder Rungs:
 - 1. Set step portion of rung 150 mm (6 inches) from wall.
 - 2. Space rungs approximately 300 mm (12 inches) on centers.
 - 3. Where only one rung is required, locate it 400 mm (16 inches) above the floor.
- D. Handrails:
 - 1. Anchor brackets for metal handrails as detailed.

2. Install brackets within 300 mm (12 inches) of return of walls, and at evenly spaced intermediate points not exceeding 1200 mm (4 feet) on centers unless shown otherwise.
3. Expansion bolt to concrete or solid masonry.
4. Toggle bolt to installed supporting frame wall and to hollow masonry unless shown otherwise.

3.8 STEEL COMPONENTS FOR MILLWORK ITEMS

Coordinate and deliver to Millwork fabricator for assembly where millwork items are secured to metal fabrications.

3.9 CLEAN AND ADJUSTING

- A. Adjust movable parts including hardware to operate as designed without binding or deformation of the members centered in the opening or frame and, where applicable, contact surfaces fit tight and even without forcing or warping the components.
- B. Clean after installation exposed prefinished and plated items and items fabricated from stainless steel, aluminum and copper alloys, as recommended by the metal manufacture and protected from damage until completion of the project.

- - - E N D - - -

**SECTION 05 51 00
METAL STAIRS**

PART 1 - GENERAL

1.1 DESCRIPTION

- A. Section specifies steel stairs with railings.
- B. Type: Closed riser stairs with concrete filled treads and platforms.

1.2 RELATED WORK

- A. Concrete fill for treads and platforms: Section 03 30 00, CAST-IN-PLACE CONCRETE.
- B. Wall handrails and railings for other than steel stairs: Section 05 50 00, METAL FABRICATIONS.
- C. Requirements for shop painting: Section 09 91 00, PAINTING.

1.3 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Shop Drawings: Show design, fabrication details, installation, connections, material, and size of members.
- C. Design Calculations, for specified live loads including dead loads, prepared and sealed by a qualified engineer registered in the state where the project is located. Provide calculations for all members and connections to supporting concrete, steel or masonry structure.

1.4 APPLICATION PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by basic designation.
- B. American Society for Testing and Materials (ASTM):
 - A36/A36M-05.....Structural Steel
 - A47-99 (R2004).....Ferritic Malleable Iron Castings
 - A48-03.....Gray Iron Castings
 - A53-06.....Pipe, Steel, Black and Hot-Dipped Zinc-Coated
Welded and Seamless
 - A307-07.....Carbon Steel Bolts and Studs, 60000 psi Tensile
Strength
 - A653/653M-07.....Steel Sheet, Zinc Coated (Galvanized) or Zinc
Alloy Coated (Galvannealed) by the Hot-Dip
Process
 - A563-07.....Carbon and Alloy Steel Nuts

- A1008-07.....Steel, Sheet, Cold-Rolled, Carbon, Structural,
High-Strength, Low-Alloy
- A786/A786M-00.....Rolled Steel Floor Plates
- A1011-04.....Steel, Sheet and Strip, Strip, Hot-Rolled
Carbon, Structural, High-Strength, Low-Alloy
- C. American Welding Society (AWS):
- D1.1-04.....Structural Welding Code-Steel
- D1.3-98.....Structural Welding Code-Sheet Steel
- D. The National Association of Architectural Metal Manufacturers (NAAMM)
Manuals:
- Metal Bar Gratings (ANSI/NAAMM MBG 531-00)
- AMP521-01.....Pipe Railing Manual, Including Round Tube
- E. American Iron and Steel Institute (AISI):
- 2001.....Design of Cold-Formed Steel Structural Members

PART 2 - PRODUCTS

2.1 DESIGN CRITERIA

- A. Design stairs to support a live load of 500 kg/m² (100 pounds per square foot).
- B. Structural design, fabrication and assembly in accordance with requirements of NAAMM Metal Stairs Manual, except as otherwise specified or shown.
- C. Design pipe railings in accordance with NAAMM Pipe Railing Manual for 900 N (200 pounds) in any direction at any point.

2.2 MATERIALS

- A. Steel Pipe: ASTM A53, Standard Weight, zinc coated.
- B. Steel Grating: Metal bar type grating NAAMM BG.
- C. Sheet Steel: ASTM A1008.
- D. Structural Steel: ASTM A36.
- E. Steel Floor Plate: ASTM 786.
- F. Steel Decking: Form from zinc coated steel conforming to ASTM A446, with properties conforming to AISI Specification for the Design of Cold-Formed Steel Structural Members.
- G. Steel Plate: ASTM A1011.
- H. Iron Castings: ASTM A48, Class 30.
- I. Malleable Iron Castings: ASTM A47.

2.3 FABRICATION GENERAL

- A. Fasteners:

1. Conceal bolts and screws wherever possible.
 2. Use countersunk heads on exposed bolts and screws with ends of bolts and screws dressed flush after nuts are set.
- B. Welding:
1. Structural steel, AWS D1.1 and sheet steel, AWS D1.3.
 2. Where possible, locate welds on unexposed side.
 3. Grind exposed welds smooth and true to contour of welded member.
 4. Remove welding splatter.
- C. Remove sharp edges and burrs.
- D. Fit stringers to head channel and close ends with steel plates welded in place where shown.
- F. Shop Prime Painting: Prepare surface and apply primer as specified for ferrous metals in Section 09 91 00, PAINTING.

2.4 RAILINGS

- A. Fabricate railings, including handrails, from steel pipe with flush.
1. Connections may be standard fittings designed for welding, or coped or mitered pipe with full welds.
 2. Wall handrails are provided under Section 05 50 00, METAL FABRICATIONS.
- B. Return ends of handrail to wall and close free end.
- C. Space intermediate posts not over six feet on center between end post.
- D. Fabricate handrail brackets from cast malleable iron.
- E. Provide standard terminal fittings at ends of post and rails.

2.5 CLOSED RISER STAIRS

- A. Provide treads, risers, platforms, railings, stringers, headers and other supporting members.
- B. Fabricate pans for treads and platforms, and risers from sheet steel // Fabricate pans for platforms from steel decking where shown //.
- C. Form risers with sanitary cove.
- D. Fabricate stringers, headers, and other supporting members from structural steel.

PART 3 - EXECUTION

3.1 STAIR INSTALLATION

- A. Provide hangers and struts required to support the loads imposed.
- B. Perform job site welding and bolting as specified for shop fabrication.
- C. Set stairs and other members in position and secure to structure as shown.
- D. Install stairs plumb, level and true to line.

- E. Provide steel closure plate to fill any gap between the stringer and surrounding shaft wall. Weld and finish with prime and paint finish of adjoining steel.

3.2 RAILING INSTALLATION

- A. Install standard terminal fittings at ends of posts and rails.
- B. Secure brackets, posts and rails to steel by welds, and to masonry or concrete with expansion sleeves and bolts, except secure posts at concrete by setting in sleeves filled with commercial non-shrink grout.
- C. Set rails horizontal or parallel to rake of stairs to within 3 mm in 3650 mm (1/8-inch in 12 feet).
- D. Set posts plumb and aligned to within 3 mm in 3650 mm (1/8-inch in 12 feet).

3.3 FIELD PRIME PAINTING

- A. When installation is complete, clean field welds and surrounding areas to bright metal, and coat with same primer paint used for shop priming.
- B. Touch-up abraded areas with same primer paint used for shop priming.
- C. Touch up abraded galvanized areas with zinc rich paint as specified in section 09 91 00, PAINTING.

- - - E N D - - -

**SECTION 06 10 00
ROUGH CARPENTRY**

PART 1 - GENERAL

1.1 DESCRIPTION:

Section specifies wood blocking, framing, sheathing, furring, nailers, rough hardware, and light wood construction.

1.2 RELATED WORK:

- A. Milled woodwork: Section 06 20 00, FINISH CARPENTRY.
- B. Gypsum sheathing: Section 09 29 00, GYPSUM BOARD.

1.3 SUBMITTALS:

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Shop Drawings showing framing connection details, fasteners, connections and dimensions.

1.4 PRODUCT DELIVERY, STORAGE AND HANDLING:

- A. Protect lumber and other products from dampness both during and after delivery at site.
- B. Pile lumber in stacks in such manner as to provide air circulation around surfaces of each piece.
- C. Stack plywood and other board products so as to prevent warping.
- D. Locate stacks on well drained areas, supported at least 150 mm (6 inches) above grade and cover with well ventilated sheds having firmly constructed over hanging roof with sufficient end wall to protect lumber from driving rain.

1.5 APPLICABLE PUBLICATIONS:

- A. Publications listed below form a part of this specification to extent referenced. Publications are referenced in the text by basic designation only.
- B. American Forest and Paper Association (AFPA):
National Design Specification for Wood Construction
NDS-05.....Conventional Wood Frame Construction
- C. American Society of Mechanical Engineers (ASME):
B18.2.1A-96(R2005).....Square and Hex Bolts and Screws
B18.2.2-87(R2005).....Square and Hex Nuts
B18.6.1-81 (R97).....Wood Screws
B18.6.4-98(R2005).....Thread Forming and Thread Cutting Tapping
Screws and Metallic Drive Screws

- D. American Plywood Association (APA):
- E30-03.....Engineered Wood Construction Guide
- E. American Society for Testing And Materials (ASTM):
- A47-99 (R2004).....Ferritic Malleable Iron Castings
- A48-03.....Gray Iron Castings
- A653/A653M-07.....Steel Sheet Zinc-Coated (Galvanized) or Zinc-Iron Alloy Coated (Galvannealed) by the Hot Dip Process
- C954-04.....Steel Drill Screws for the Application of Gypsum Board or Metal Plaster Bases to Steel Studs from 0.033 inch (2.24 mm) to 0.112-inch (2.84 mm) in thickness
- C1002-04.....Steel Self-Piercing Tapping Screws for the Application of Gypsum Panel Products or Metal Plaster Bases to Wood Studs or Metal Studs
- D143-94 (R2004).....Small Clear Specimens of Timber, Method of Testing
- D1760-01.....Pressure Treatment of Timber Products
- D2559-04.....Adhesives for Structural Laminated Wood Products for Use Under Exterior (Wet Use) Exposure Conditions
- F844-07.....Washers, Steel, Plain (Flat) Unhardened for General Use
- F1667-05.....Nails, Spikes, and Staples
- F. Federal Specifications (Fed. Spec.):
- MM-L-736C.....Lumber; Hardwood
- G. Commercial Item Description (CID):
- A-A-55615.....Shield, Expansion (Wood Screw and Lag Bolt Self Threading Anchors)
- H. Military Specification (Mil. Spec.):
- MIL-L-19140E.....Lumber and Plywood, Fire-Retardant Treated
- I. U.S. Department of Commerce Product Standard (PS)
- PS 1-95.....Construction and Industrial Plywood
- PS 20-05.....American Softwood Lumber Standard

PART 2 - PRODUCTS**2.1 LUMBER:**

- A. Unless otherwise specified, each piece of lumber bear grade mark, stamp, or other identifying marks indicating grades of material, and rules or standards under which produced.
 - 1. Identifying marks in accordance with rule or standard under which material is produced, including requirements for qualifications and authority of the inspection organization, usage of authorized identification, and information included in the identification.
 - 2. Inspection agency for lumber approved by the Board of Review, American Lumber Standards Committee, to grade species used.
- B. Structural Members: Species and grade as listed in the AFPA, National Design Specification for Wood Construction having design stresses as shown.
- C. Lumber Other Than Structural:
 - 1. Unless otherwise specified, species graded under the grading rules of an inspection agency approved by Board of Review, American Lumber Standards Committee.
 - 2. Framing lumber: Minimum extreme fiber stress in bending of 1100.
 - 3. Furring, blocking, nailers and similar items 100 mm (4 inches) and narrower Standard Grade; and, members 150 mm (6 inches) and wider, Number 2 Grade.
- D. Sizes:
 - 1. Conforming to Prod. Std., PS20.
 - 2. Size references are nominal sizes, unless otherwise specified, actual sizes within manufacturing tolerances allowed by standard under which produced.
- E. Moisture Content:
 - 1. At time of delivery and maintained at the site.
 - 2. Boards and lumber 50 mm (2 inches) and less in thickness: 19 percent or less.
 - 3. Lumber over 50 mm (2 inches) thick: 25 percent or less.
- F. Fire Retardant Treatment:
 - 1. Mil Spec. MIL-L-19140 with piece of treated material bearing identification of testing agency and showing performance rating.
 - 2. Treatment and performance inspection, by an independent and qualified testing agency that establishes performance ratings.
- G. Preservative Treatment:

1. Do not treat Heart Redwood and Western Red Cedar.
2. Treat wood members and plywood exposed to weather or in contact with plaster, masonry or concrete, including framing of open roofed structures; sills, sole plates, furring, and sleepers that are less than 600 mm (24 inches) from ground; nailers, edge strips, blocking, crickets, curbs, cant, vent strips and other members used in connection with roofing and flashing materials.
3. Treat other members specified as preservative treated (PT).
4. Preservative treat by the pressure method complying with ASTM D1760, except any process involving the use of Chromated Copper arsenate (CCA) for pressure treating wood is not permitted.

2.2 PLYWOOD

- A. Comply with Prod. Std., PS 1.
- B. Bear the mark of a recognized association or independent inspection agency that maintains continuing control over quality of plywood which identifies compliance by veneer grade, group number, span rating where applicable, and glue type.
- C. Sheathing:
 1. APA rated Exposure 1 or Exterior; panel grade CD or better.
 2. Wall sheathing:
 - a. Minimum 9 mm (11/32 inch) thick with supports 400 mm (16 inches) on center and 12 mm (15/32 inch) thick with supports 600 mm (24 inches) on center unless specified otherwise.
 - b. Minimum 1200 mm (48 inches) wide at corners without corner bracing of framing.

2.4 ROUGH HARDWARE AND ADHESIVES:

- A. Anchor Bolts:
 1. ASME B18.2.1 and ANSI B18.2.2 galvanized, 13 mm (1/2 inch) unless shown otherwise.
 2. Extend at least 200 mm (8 inches) into masonry or concrete with ends bent 50 mm (2 inches).
- B. Miscellaneous Bolts: Expansion Bolts: C1D, A-A-55615; lag bolt, long enough to extend at least 65 mm (2-1/2 inches) into masonry or concrete. Use 13 mm (1/2 inch) bolt unless shown otherwise.
- C. Washers
 1. ASTM F844.
 2. Use zinc or cadmium coated steel or cast iron for washers exposed to weather.

D. Screws:

1. Wood to Wood: ANSI B18.6.1 or ASTM C1002.
2. Wood to Steel: ASTM C954, or ASTM C1002.

E. Nails:

1. Size and type best suited for purpose unless noted otherwise. Use aluminum-alloy nails, plated nails, or zinc-coated nails, for nailing wood work exposed to weather and on roof blocking.
2. ASTM F1667:
 - a. Common: Type I, Style 10.
 - b. Concrete: Type I, Style 11.
 - c. Barbed: Type I, Style 26.
 - d. Underlayment: Type I, Style 25.
 - e. Masonry: Type I, Style 27.
 - f. Use special nails designed for use with ties, strap anchors, framing connectors, joists hangers, and similar items. Nails not less than 32 mm (1-1/4 inches) long, 8d and deformed or annular ring shank.

PART 3 - EXECUTION**3.1 INSTALLATION OF FRAMING AND MISCELLANEOUS WOOD MEMBERS:****A. Conform to applicable requirements of the following:****B. Fasteners:**

1. Nails.
 - a. Nail in accordance with the Recommended Nailing Schedule as specified in AFPA Manual for House Framing where detailed nailing requirements are not specified in nailing schedule. Select nail size and nail spacing sufficient to develop adequate strength for the connection without splitting the members.
 - b. Use special nails with framing connectors.
 - c. For sheathing, select length of nails sufficient to extend 25 mm (1 inch) into supports.
 - d. Use eight penny or larger nails for nailing through 25 mm (1 inch) thick lumber and for toe nailing 50 mm (2 inch) thick lumber.
 - e. Use 16 penny or larger nails for nailing through 50 mm (2 inch) thick lumber.
 - f. Select the size and number of nails in accordance with the Nailing Schedule except for special nails with framing anchors.
2. Bolts:

- a. Fit bolt heads and nuts bearing on wood with washers.
- b. Countersink bolt heads flush with the surface of nailers.
- c. Embed in concrete and solid masonry or use expansion bolts.
Special bolts or screws designed for anchor to solid masonry or concrete in drilled holes may be used.
- d. Use toggle bolts to hollow masonry or sheet metal.
- e. Use bolts to steel over 2.84 mm (0.112 inch, 11 gage) in thickness. Secure wood nailers to vertical structural steel members with bolts, placed one at ends of nailer and 600 mm (24 inch) intervals between end bolts. Use clips to beam flanges.
- 3. Drill Screws to steel less than 2.84 mm (0.112 inch) thick.
 - a. ASTM C1002 for steel less than 0.84 mm (0.033 inch) thick.
 - b. ASTM C 954 for steel over 0.84 mm (0.033 inch) thick.
- 4. Power actuated drive pins may be used where practical to anchor to solid masonry, concrete, or steel.
- 5. Do not anchor to wood plugs or nailing blocks in masonry or concrete. Use metal plugs, inserts or similar fastening.
- 6. Screws to Join Wood:
 - a. Where shown or option to nails.
 - b. ASTM C1002, sized to provide not less than 25 mm (1 inch) penetration into anchorage member.
 - c. Spaced same as nails.
- C. Set sills or plates level in full bed of mortar on masonry or concrete walls.
 - 1. Space anchor bolts 1200 mm (4 feet) on centers between ends and within 150 mm (6 inches) of end. Stagger bolts from side to side on plates over 175 mm (7 inches) in width.
 - 2. Use shims of slate, tile or similar approved material to level wood members resting on concrete or masonry. Do not use wood shims or wedges.
 - 3. Closely fit, and set to required lines.
- D. Cut notch, or bore in accordance with NFPA Manual for House-Framing for passage of ducts wires, bolts, pipes, conduits and to accommodate other work. Repair or replace miscut, misfit or damaged work.
- E. Blocking Nailers, and Furring:
 - 1. Install furring, blocking, nailers, and grounds where shown.
 - 2. Use longest lengths practicable.

3. Use fire retardant treated wood blocking where shown at openings and where shown or specified.
4. Layers of Blocking or Plates:
 - a. Stagger end joints between upper and lower pieces.
 - b. Nail at ends and not over 600 mm (24 inches) between ends.
 - c. Stagger nails from side to side of wood member over 125 mm (5 inches) in width.
5. Unless otherwise shown, use wall furring 25 mm by 75 mm (1 inch by 3 inch) continuous wood strips installed plumb on walls, using wood shims where necessary so face of furring forms a true, even plane. Space furring not over 400 mm (16 inches) on centers, butt joints over bearings and rigidly secure in place. Anchor furring on 400 mm (16 inches) centers.

- - - E N D - - -

SECTION 06 11 50
SHEATHING

PART 1 - GENERAL

1.1 RELATED WORK SPECIFIED ELSEWHERE:

Wood Framing and Blocking: Section 06100

Drywall for Finished Surfaces: Section 09250

1.2 DEFINITIONS: Refer to ASTM C11 and GA505 for definitions of terms for gypsum board construction not otherwise defined in this Section or referenced standards.

1.3 SUBMITTALS:

A. Product data for each type of sheathing indicated.

1.4 QUALITY ASSURANCE:

A. Fire Resistance Ratings: Where gypsum sheathing is part of fire-resistance rated assemblies indicated, provide materials and construction which are identical to those of assemblies whose fire-resistance rating has been determined per ASTM E119.

B. Single Source Responsibility: Obtain each type of sheathing, joint treatment and accessories from a single manufacturer.

1.5 DELIVERY, STORAGE, AND HANDLING:

A. All materials shall be stored in an enclosed shelter providing protection from damage and exposure to the elements.

PART 2 - PRODUCTS

2.1 GLASS-MAT GYPSUM SHEATHING BOARD: ASTM C 1177, gypsum sheathing board consisting of non-combustible, moisture resistant treated gypsum core, surfaced on face, back and long edges with glass mat facings and bond enhancing primer coating; regular, 1/2 inch thick; 4 foot by 8 foot boards; square edges and ends unless indicated otherwise.

2.2 ACCESSORY MATERIALS:

A. Fluid-Applied, Vapor-Permeable Membrane Air Barrier: Provide synthetic polymer membrane air barrier capable of performing as a continuous vapor-permeable air barrier and as a liquid-water drainage plane flashed to discharge to the exterior incidental condensation or water penetration. Air barrier assemblies shall be capable of accommodating substrate movement and of sealing substrate expansion and control joints, construction material changes, and transitions at perimeter conditions without deterioration and air leakage exceeding

- specified limits. Include all accessory materials recommended by the air barrier manufacturer to produce a complete air barrier assembly.
- B. Metal Fasteners for Steel Studs: Fluorocarbon base coated steel self-drilling screws, #10 diameter, length required to penetrate steel stud flange by not less than 3 exposed threads; complying with ASTM C954 except with hex washer head. Screw shall show no signs of red rust or other metal corrosion when tested with 800 hours in salt spray per ASTM B117, and 20 cycles in Kesternich chamber. Acceptable manufacturers: Elco, Buildex, Atlas
 - C. Sealant: Solvent-release-curing joint sealant compatible with joint substrates formed by sheathing and other related materials and complying with requirements of Section 07900 - JOINT SEALERS.

PART 3 - EXECUTION

- 3.1 GYPSUM SHEATHING BOARDS: Except as otherwise indicated, comply with manufacturer's instructions, GA253, and the following:
- A. Cut boards at penetrations, edges and other obstructions of the work; fit tight against abutting work, unless otherwise indicated.
 - 1. Provide 3/8 inch setback where non-load-bearing work abuts structural elements at head and jambs.
 - 2. Provide 1/4 inch setback where sheathing abuts masonry or similar materials that might retain moisture to prevent wicking.
 - B. Coordinate installation of sheathing with installation of flashing and joint sealers so that these combined materials are installed in the sequence and manner which prevents exterior moisture from passing through completed exterior wall assembly to the interior.
 - C. Apply fasteners so that screw heads bear tightly against face of gypsum sheathing boards but do not cut into face paper.
 - D. Do not bridge building expansion joints with gypsum sheathing; cut and space edges to match spacing of structural support elements.
 - E. Do not leave gypsum sheathing board exposed to weather for longer than one month.

3.2 PLYWOOD SHEATHING PANELS: Comply with applicable recommendations of APA, Governing Building Code, and the National Forest Products Association unless shown or noted otherwise, for types of construction panels and applications indicated. Nail panels to framing as indicated. If not indicated, nail in accordance with the requirements of the applicable building codes and "The Manual for House Framing" by NFPA, whichever is more stringent. Install plywood 'H' clips at mid-span of roof sheathing at all joints.

3.3 MEMBRANE AIR BARRIER:

- A. Refer to manufacturer's literature for requirements for preparation of substrates. Surfaces shall be sound and free of voids, spalled areas, loose aggregate and sharp protrusions. Remove contaminants such as grease, oil and wax from exposed surfaces. Remove dust, dirt, loose stone and debris. Use repair materials and methods that are acceptable to manufacturer of the fluid-applied air barrier system.
- B. Exterior Sheathing Panels: Ensure that the boards are sufficiently stabilized with corners and edges fastened with appropriate screws. Pre-treat all board joints with 50 - 75mm (2-3 in.) wide, manufacturer's recommended self-adhesive tape. Gaps greater than 6mm (1/4 in) should be filled with mastic or caulk, allowing sufficient time to fully cure before application of the tape and fluid applied air barrier system.
- C. Masonry Substrates: Verify that masonry joints are struck flush and completely filled with mortar. Apply air and vapor barrier over concrete block with smooth trowel. Fill all voids and holes, particularly in the mortar joints, with a lean mortar mix, non-shrinking grout or parge coat.
- D. Apply primer to substrates to receive transition membrane at required rate and allow to dry. Limit priming to areas that will be covered by transition tape in same day. Reprime areas exposed for more than 24 hours.
 - 1. Prime glass-fiber-surfaced gypsum sheathing not covered with air membrane material with number of prime coats needed to achieve required bond, with adequate drying time between coats.
- E. Connect and seal exterior wall air barrier membrane continuously to roofing membrane air barrier, concrete below-grade structures, floor-to floor construction, exterior glazing and window systems, glazed curtain-wall systems, storefront systems, exterior louvers, exterior

door framing, and other construction used in exterior wall openings, using accessory materials.

- F. At end of each working day, seal top edge of strips and transition strips to substrate with termination mastic.
- G. Apply joint sealants forming part of air barrier assembly within manufacturer's recommended application temperature ranges. Consult manufacturer when sealant cannot be applied within these temperature ranges.
- H. Wall Openings: Prime concealed perimeter frame surfaces of windows, curtain walls, storefronts, and doors. Apply transition strip so that a minimum of 75 mm (3 inches) of coverage is achieved over both substrates. Maintain 75 mm (3 inches) of full contact over firm bearing to perimeter frames with not less than 25 mm (1 inch) of full contact.
 - 1. Transition Membrane: Roll firmly to enhance adhesion.
- I. Fill gaps in perimeter frame surfaces of windows, curtain walls, storefronts, and doors, and miscellaneous penetrations of air barrier membrane with foam sealant.
- J. Repair punctures, voids, and deficient lapped seams in strips and transition strips. Slit and flatten fishmouths and blisters. Patch with transition strips extending 150 mm (6 inches) beyond repaired areas in strip direction.

3.4 FIELD QUALITY CONTROL:

- A. Testing Agency: Owner may engage a qualified testing agency to perform tests and inspections and prepare test reports.
- B. Inspections: Air barrier materials and installation are subject to inspection for compliance with requirements. Inspections may include the following:
 - 1. Continuity of air barrier system has been achieved throughout the building envelope with no gaps or holes.
 - 2. Continuous structural support of air barrier system has been provided.
 - 3. Masonry and concrete surfaces are smooth, clean and free of cavities, protrusions, and mortar droppings.
 - 4. Site conditions for application temperature and dryness of substrates have been maintained.
 - 5. Maximum exposure time of materials to UV deterioration has not

been exceeded.

6. Surfaces have been primed, if applicable.
 7. Laps in strips and transition strips have complied with minimum requirements and have been shingled in the correct direction (or mastic has been applied on exposed edges), with no fishmouths.
 8. Termination mastic has been applied on cut edges.
 9. Strips and transition strips have been firmly adhered to substrate.
 10. Compatible materials have been used.
 11. Transitions at changes in direction and structural support at gaps have been provided.
 12. Connections between assemblies (membrane and sealants) have complied with requirements for cleanliness, preparation and priming of surfaces, structural support, integrity, and continuity of seal.
 13. All penetrations have been sealed.
- C. Remove and replace deficient air barrier components and retest as specified above.

3.5 CLEANING AND PROTECTION:

- A. Protect air barrier system from damage during application and remainder of construction period, according to manufacturer's written instructions.
- B. Protect air barrier from exposure to UV light and harmful weather exposure as required by manufacturer. Remove and replace air barrier exposed for more than 150 days.
- C. Clean spills, stains, and soiling from construction that would be exposed in the completed work using cleaning agents and procedures recommended by manufacturer of affected construction.
- D. Remove masking materials after installation.

- - - E N D - - -

SECTION 06 20 00
FINISH CARPENTRY

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This section specifies exterior and interior millwork.
- B. Items specified.
 - Seats and benches
 - Mounting Strips, Shelves, and Rods
 - Base

1.2 RELATED WORK

- A. Fabricated Metal brackets, bench supports and countertop legs: Section 05 50 00, METAL FABRICATIONS.
- B. Framing, furring and blocking: Section 06 10 00, ROUGH CARPENTRY.
- C. Wood doors: Section 08 14 00, WOOD DOORS.
- D. Color and texture of finish: Section 09 06 00, SCHEDULE FOR FINISHES.
- E. Stock Casework: Section 12 32 00, MANUFACTURED WOOD CASEWORK.
- F. Electrical light fixtures and duplex outlets: Division 26, ELECTRICAL.

1.3 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Shop Drawings:
 - 1. Millwork items - Half full size scale for sections and details 1:50 (1/4-inch) for elevations and plans.
 - 2. Show construction and installation.
- C. Samples:
 - Plastic laminate finished plywood or particleboard, 150 mm by 300 mm (six by twelve inches).
- D. Certificates:
 - 1. Indicating moisture content of materials meet the requirements specified.
- E. Manufacturer's literature and data:
 - 1. Finish hardware
 - 2. Sinks with fittings
 - 3. Electrical components

1.4 DELIVERY, STORAGE AND HANDLING

- A. Protect lumber and millwork from dampness, maintaining moisture content specified both during and after delivery at site.

- B. Store finishing lumber and millwork in weathertight well ventilated structures or in space in existing buildings designated by Contracting Officer's Technical Representative (COTR). Store at a minimum temperature of 21⁰C (70⁰F) for not less than 10 days before installation.
- C. Pile lumber in stacks in such manner as to provide air circulation around surfaces of each piece.

1.5 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. Builders Hardware Manufacturers Association (BHMA):
 - A156.9-03.....Cabinet Hardware
 - A156.11-04.....Cabinet Locks
 - A156.16-02.....Auxiliary Hardware
- C. Hardwood Plywood and Veneer Association (HPVA):
 - HP1-09.....Hardwood and Decorative Plywood
- D. National Particleboard Association (NPA):
 - A208.1-99.....Wood Particleboard
- E. Architectural Woodwork Institute (AWI):
 - AWI-99.....Architectural Woodwork Quality Standards and
Quality Certification Program
- F. U.S. Department of Commerce, Product Standard (PS):
 - PS20-05.....American Softwood Lumber Standard
- G. Federal Specifications (Fed. Spec.):
 - A-A-1922A.....Shield Expansion
 - A-A-1936.....Contact Adhesive
 - FF-N-836D.....Nut, Square, Hexagon Cap, Slotted, Castle
 - FF-S-111D(1).....Screw, Wood
 - MM-L-736(C).....Lumber, Hardwood

PART 2 - PRODUCTS

2.1 LUMBER

- A. Grading and Marking:
 - 1. Lumber shall bear the grade mark, stamp, or other identifying marks indicating grades of material.
 - 2. Such identifying marks on a material shall be in accordance with the rule or standard under which the material is produced, including requirements for qualifications and authority of the inspection

organization, usage of authorized identification, and information included in the identification.

3. The inspection agency for lumber shall be approved by the Board of Review, American Lumber Standards Committee, to grade species used.

B. Sizes:

1. Lumber Size references, unless otherwise specified, are nominal sizes, and actual sizes shall be within manufacturing tolerances allowed by the standard under which product is produced.
2. Millwork, standing and running trim, and rails: Actual size as shown or specified.

C. Hardwood: MM-L-736, species as specified for each item.

D. Softwood: PS-20, exposed to view appearance grades:

1. Use C select or D select, vertical grain for transparent finish including stain transparent finish.
2. Use Prime for painted or opaque finish.

E. Use edge grain Wood members exposed to weather.

2.2 PLYWOOD

A. Softwood Plywood:

1. Prod. Std.
2. Grading and Marking:
 - a. Each sheet of plywood shall bear the mark of a recognized association or independent inspection agency that maintains continuing control over the quality of the plywood.
 - b. The mark shall identify the plywood by species group or identification index, and shall show glue type, grade, and compliance with PS1.
3. Plywood, 13 mm (1/2 inch) and thicker; not less than five ply construction, except 32 mm (1-1/4 inch) thick plywood not less than seven ply.
4. Shelving Plywood:
 - a. Interior Type, any species group.
 - b. Veneer Grade: A-B or B-C.
5. Other: As specified for item.

B. Hardwood Plywood:

1. HPVA: HP.1
2. Species of face veneer shall be as shown or as specified in connection with each particular item.
3. Inside of Building:

- a. Use Type II (interior) A grade veneer for transparent finish.
- b. Use Type II (interior) Sound Grade veneer for paint finish.

2.3 PARTICLEBOARD

- A. NPA A208.1
- B. Plastic Laminate Particleboard Cores:
 - 1. Use Type 1, Grade 1-M-3, or Type 2, Grade 2-M-2, unless otherwise specified.
 - 2. Use Type 2, Grade 2-M-2, exterior bond, for tops with sinks.
- C. General Use: Type 1, Grade 1-M-3 or Type 2, Grade 2-M-2.

2.4 PLASTIC LAMINATE

- A. NEMA LD-3.
- B. Exposed decorative surfaces including countertops, both sides of cabinet doors, and for items having plastic laminate finish. Cabinetry doors shall be flush mounted. General Purpose, Type HGL.
- C. Cabinet Interiors including Shelving: Both of following options to comply with NEMA, CLS as a minimum.
 - 1. Plastic laminate clad plywood or particle board.
 - 2. Resin impregnated decorative paper thermally fused to particle board.
- D. Backing sheet on bottom of plastic laminate covered wood tops: Backer, Type HGP.
- E. Apply matching backsplash and endcaps. Edge detail beveled plastic laminate.

2.5 BUILDING BOARD (HARDBOARD)

- A. ANSI/AHA A135.4, 6 mm (1/4 inch) thick unless specified otherwise.

2.6 ADHESIVE

- A. For Plastic Laminate: Fed. Spec. A-A-1936.
- B. For Interior Millwork: Unextended urea resin, unextended melamine resin, phenol resin, or resorcinol resin.

2.7 STAINLESS STEEL

ASTM A167, Type 302 or 304.

- A. Finish Hardware
 - 1. Cabinet Hardware: ANSI A156.9.
 - a. Door/Drawer Pulls: As provided by casework manufacturer.
 - b. Drawer Slides: B05051 for drawers over 150 mm (6 inches) deep, B05052 for drawers 75 mm to 150 mm (3 to 6 inches) deep, and B05053 for drawers less than 75 mm (3 inches) deep.
 - c. Adjustable Shelf Standards: B4061 with shelf rest B04083.

- d. Concealed Hinges: B1601, minimum 110 degree opening.
- e. Butt Hinges: B01361, for flush doors, B01381 for inset lipped doors, and B01521 for overlay doors.
- f. Cabinet Door Catch: B0371 or B03172.
- g. Vertical Slotted Shelf Standard: B04103 with shelf brackets B04113, sized for shelf depth.
- 2. Cabinet Locks: ANSI A156.11.
 - a. Drawers and Hinged Door: E07262.
- 3. Auxiliary Hardware: ANSI A156.16.
 - a. Shelf Bracket: B04041, japanned or enameled finish.
 - b. Combination Garment rod and Shelf Support: B04051 japanned or enamel finish.
 - c. Handrail Brackets: L03081 or L03101.
 - 1) Cast Aluminum, satin polished finish.
 - 2) Cast Malleable Iron, japanned or enamel finish.

2.8 MOISTURE CONTENT

- A. Moisture content of lumber and millwork at time of delivery to site.
 - 1. Interior finish lumber, trim, and millwork 32 mm (1-1/4 inches) or less in nominal thickness: 12 percent on 85 percent of the pieces and 15 percent on the remainder.
 - 2. Exterior treated or untreated finish lumber and trim 100 mm (4 inches) or less in nominal thickness: 15 percent.
 - 3. Moisture content of other materials shall be in accordance with the standards under which the products are produced.

2.9 FABRICATION

- A. General:
 - 1. Except as otherwise specified, use AWI Custom Grade for architectural woodwork and interior millwork.
 - 2. Finish woodwork shall be free from pitch pockets.
 - 3. Except where special profiles are shown, trim shall be standard stock molding and members of the same species.
 - 4. Edges of members in contact with concrete or masonry shall have a square corner caulking rebate.
 - 5. Fabricate members less than 4 m (14 feet) in length from one piece of lumber, back channeled and molded as shown.
 - 6. Interior trim and items of millwork to be painted may be fabricated from jointed, built-up, or laminated members, unless otherwise shown on drawings or specified.

7. Plastic Laminate Work:
 - a. Factory glued to either a plywood or a particle board core, thickness as shown or specified.
 - b. Cover exposed edges with plastic laminate, except where aluminum, stainless steel, or plastic molded edge strips are shown or specified. Use plastic molded edge strips on 19 mm (3/4-inch) molded thick or thinner core material.
 - c. Provide plastic backing sheet on underside of countertops, vanity tops, thru-wall counter and sills including back splashes and end splashes of countertops.
 - d. Use backing sheet on concealed large panel surface when decorative face does not occur.
- B. Seats and Benches:
 1. Fabricate from 50 mm (2 inch) stock strips of plain-sawed Maple.
 2. Solid seats securely glued together of spliced, doweled, or double tongued and grooved wood pieces. Where open joints are indicated, work each wood piece from solid stock.
 3. Round top edges and corners where exposed.
- C. Mounting Strips, Shelves and Rods:
 1. Cut mounting strips from 25 mm by 100 mm (1 by 4 inches) softwood stock, with exposed edge slightly rounded.
 2. Cut wood shelf from softwood 1 inch stock, of width shown, exposed edge slightly rounded. Option: Use 19 mm (3/4 inch) thick plywood with 19 mm (3/4 inch) softwood edge nosing on exposed edge, slightly rounded.

PART 3 - EXECUTION

3.1 ENVIRONMENTAL REQUIREMENTS

- A. Maintain work areas and storage areas to a minimum temperature of 21⁰C (70⁰F) for not less than 10 days before and during installation of interior millwork.
- B. Do not install finish lumber or millwork in any room or space where wet process systems such as concrete, masonry, or plaster work is not complete and dry.

3.2 INSTALLATION

- A. General:
 1. Millwork receiving transparent finish shall be primed and back-painted on concealed surfaces. Set no millwork until primed and back-painted.

2. Secure trim with fine finishing nails, screws, or glue as required.
 3. Set nails for putty stopping. Use washers under bolt heads where no other bearing plate occurs.
 4. Seal cut edges of preservative and fire retardant treated wood materials with a certified acceptable sealer.
 5. Coordinate with plumbing and electrical work for installation of fixtures and service connections in millwork items.
 6. Plumb and level items unless shown otherwise.
 7. Nail finish at each blocking, lookout, or other nailer and intermediate points; toggle or expansion bolt in place where nails are not suitable.
 8. Exterior Work: Joints shall be close fitted, metered, tongue and grooved, rebated, or lapped to exclude water and made up in thick white lead paste in oil.
- B. Seats and Benches:
1. Wall Benches: Support within 150 mm (6 inches) near ends and not over 900 mm (3 feet) on centers with stainless steel bar brackets under bench secured to seat and wall.
 2. Install edge trim and base as shown, use solid wood members of same species as wall paneling.
- C. Shelves:
1. Install mounting strip at back wall and end wall for shelves in closets where shown secured with toggle bolts at each end and not over 600 mm (24 inch) centers between ends.
 - a. Nail Shelf to mounting strip at ends and to back wall strip at not over 900 mm (36 inches) on center.
 - b. Install metal bracket, ANSI A156.16, B04041, not over 1200 mm (4 feet) centers when shelves exceed 1800 mm (6 feet) in length.
 - c. Install metal bracket, ANSI A156.16, B04051, not over 1200 mm (4 feet) on centers where shelf length exceeds 1800 mm (6 feet) in length with metal rods, clothes hanger bars ANSI A156.16, L03131, of required length, full length of shelf.
 2. Install vertical slotted shelf standards, ANSI A156.9, B04103 to studs with toggle bolts through each fastener opening. Double slotted shelf standards may be used where adjacent shelves terminate.

- a. Install brackets ANSI A156.9, B04113, providing supports for shelf not over 900 mm (36 inches) on center and within 13 mm (1/2 inch) of shelf end unless shown otherwise.
- b. Install shelves on brackets so front edge is restrained by bracket.

- - - E N D - - -

**SECTION 07 11 13
BITUMINOUS DAMPPROOFING**

PART 1 - GENERAL

1.1 DESCRIPTION:

This section specifies materials and workmanship for bituminous dampproofing on concrete and masonry surfaces.

1.2 SUBMITTALS:

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturer's Literature and Data:
 - 1. Product description.
 - 2. Application instructions.

1.3 APPLICABLE PUBLICATIONS:

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
D449-03(R2008).....Asphalt Used in Dampproofing and Waterproofing

PART 2 - PRODUCTS

2.3 ASPHALT EMULSION (COLD APPLIED):

ASTM D1227, Type III (spray grade)

PART 3 - EXECUTION

3.1 SURFACE PREPARATION:

- A. Surfaces to receive dampproofing shall be clean and smooth.
- B. Remove foreign matter, loose particles of mortar or other cementitious droppings.
- C. Clean and wash soil or dirt particles from surface.
- D. Remove free water; surfaces may remain damp.

3.2 APPLICATION:

- A. Comply with Manufacturer written instructions for methods and rates of dampproofing application, cleaning and installation of any protection course.
- B. Apply each coat at the rate of not less than 1 L/m² (2-1/2 gallons per 100 square feet) and allow not less than 24 hours drying time after application.

3.3 LOCATION:

- A. Apply to surfaces where shown.

- - - E N D - - -

SECTION 07 13 52
MODIFIED BITUMINOUS SHEET WATERPROOFING

PART 1 - GENERAL

1.1 DESCRIPTION:

This section specifies modified bituminous sheet material used for exterior below grade waterproofing and split slab waterproofing.

1.2 MANUFACTURER'S QUALIFICATIONS:

- A. Approval by Contracting Officer is required of products and services of proposed manufacturers, and installers, and will be based upon submission by Contractor that:
 - 1. Manufacturer regularly and presently manufactures bituminous sheet waterproofing as one of its principal products.
 - 2. Installer has technical qualifications, experience, trained personnel and facilities to install specified items.
 - 3. Manufacturer's product submitted has been in satisfactory and efficient operation on three similar installations for at least three years.
 - 4. Submit list of installations, include name and location of project and name of owner.

1.3 SUBMITTALS:

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturer's Literature and Data:
 - 1. Bituminous sheet.
 - 2. Primer.
 - 3. Mastic.
 - 4. Protection material, temporary and permanent.
 - 5. Printed installation instructions for conditions specified.
- C. Certificates:
 - 1. Indicating bituminous sheet manufacturer's approval of primer, and roof cement.
 - 2. Indicating bituminous sheet waterproofing manufacturer's qualifications as specified.
 - 3. Approval of installer by bituminous sheet manufacturers.
 - 4. Water test report.

1.4 PRODUCT DELIVERY, STORAGE AND HANDLING:

- A. Deliver materials to job in manufacturer's original unopened container.

- B. Do not store material in areas where temperature is lower than 10 degrees C (50 degrees F,) or where prolonged temperature is above 32 degrees C (90 degrees F).

1.5 ENVIRONMENTAL REQUIREMENTS:

Ambient Surface and Material Temperature: Not less than 4 degrees C (40 degrees F), during application of waterproofing.

1.6 WARRANTY:

Warrant bituminous sheet waterproofing installation against moisture leaks and subject to terms of "Warranty of Construction", FAR clause 52.246-21, except that warranty period is two years.

1.7 APPLICABLE PUBLICATIONS:

- A. Publications listed below form a part of this specification to the extent referenced. Publications are referenced by basic designation only.
- B. Federal Specifications (Fed. Spec.):
 UU-B-790A.....Building Paper, Vegetable Fiber: (Kraft, Water-INT AMD 1 Proof, Water Repellent and Fire Resistant)
- C. American Society for Testing and Materials (ASTM):
 C578-07.....Rigid Cellular Polystyrene Thermal Insulation
 D41-05.....Asphalt Primer Used in Roofing, Dampproofing and Waterproofing
 D2822-05.....Asphalt Roof Cement
 D6380-03.....Asphalt Roll Roofing (Organic Felt)
- D. American Hardboard Association (AHA):
 A135.4-1995.....Basic Hardboard

PART 2 - PRODUCTS

2.1 BITUMINOUS SHEET:

- A. Cold applied waterproofing membrane composed primarily of modified bituminous material prefabricated in sheet form designed for below grade exterior and split slab waterproofing. Sheet reinforced with fibers at manufacturer's option.
- B. Thickness of Bituminous Sheet: 1.5 mm (60 mils), plus or minus 0.13 mm (5 mils), and bonded to a 0.1 mm (4 mil) thick plastic sheet.
- C. Provide with a release sheet to prevent bonding of bituminous sheet to itself.

2.2 PRIMER AND ROOF CEMENT:

- A. Furnished by manufacturer of bituminous sheet as required for particular application in accordance with sheet manufacturer's instructions.
- B. Primer: ASTM D41.
- C. Roof Cement: ASTM D4586.

2.3 PROTECTION MATERIAL:

- A. Hardboard: PS-58, Service Type, 6 mm (1/4-inch) thick.
- B. Roll Roofing: ASTM D6380, Class S (smooth), Type III with minimum net mass per unit area of roofing, 2495 g/m² (51 lb/100 ft²).

2.4 PATCHING COMPOUND:

A factory prepared, non-shrinking, fast setting, cementitious adhesive compound containing no ferrous metal or oxide.

PART 3 - EXECUTION**3.1 PREPARATION:**

- A. Surface Condition:
 - 1. Before applying waterproofing materials, ensure concrete and masonry surfaces are fully cured, smooth, clean, dry, and free from high spots, depressions, loose and foreign particles and other deterrents to adhesion.
 - 2. Fill voids, joints, and cracks with patching compound.
- B. Concrete surfaces cured a minimum of seven days, free from release agents, concrete curing agents, and other contaminants.

3.2 APPLICATION:

- A. Priming:
 - 1. Prime concrete and masonry surfaces.
 - 2. Application method, amount of primer and condition or primer before installation of bituminous sheet as recommended by primer manufacturer.
 - 3. Reprime when required in accordance with manufacturer's instructions.
- B. Bituminous Sheet Installation:
 - 1. Remove release sheet prior to application.
 - 2. Lay bituminous sheet from low point to high point so that laps shed water.
 - 3. Treat expansion, construction and control joints and evident working cracks as expansion joints. Apply bituminous sheet in double

thickness over joint by first applying a strip of bituminous sheet not less than 200 mm (8 inches) wide, centered over joint.

4. Lap seams not less than 50 mm (2 inches).
 5. Lay succeeding sheet with laps, and roll or press into place.
 6. Repair misaligned or inadequately lapped seams in accordance with manufacturer's instructions.
 7. Seal seams and terminations in accordance with sheet manufacturer's instructions.
- C. Corner Treatment:
1. At inside and outside corners apply double cover using an initial strip not less than 280 mm (11 inches) wide, centered along axis of corner.
 2. Cover each strip completely by the regular application of bituminous sheet.
 3. Provide a fillet or cant on inside corners.
 4. Form cants using patching compound
 5. Do not use wood, fiber, and insulating materials for cants.
- D. Projection Treatment:
1. Apply a double layer of bituminous sheet around pipes and similar projections at least 150 mm (6 inches) wide.
 2. At drains, apply a bead of roof cement over a double layer of bituminous sheet under clamping rings.

3.3 PROTECTION:

- A. Protect bituminous sheet before backfill or wearing courses are placed.
- B. Install protection material and hold in place in accordance with instructions of manufacturer of waterproofing materials.
- C. Permanent Protection:
1. Vertical Surfaces:
 - a. Install hardboard, polystyrene, or roll roofing protection material.
 - b. Extend protection full height from footing to top of backfill.
 - c. If graded backfill is used, use roll roofing or hardboard.
 - D. Horizontal Surfaces:
 1. Install roll roofing protection under concrete wearing courses.
 2. Install roll roofing, hardboard, or polystyrene under earth backfill.

3. Where no concrete wearing course occurs or when surfaces will bear heavy traffic and will not immediately be covered with a wearing course, use protection specified for vertical surfaces.

E. Temporary Protection:

When waterproofing materials are subjected to damage by sunlight and can not be immediately protected as specified, protect waterproofing materials by waterproof building paper or suitable coating approved by manufacturer of waterproofing system used.

3.4 PATCHING:

Repair tears, punctures, air blisters, and inadequately lapped seams, in accordance with manufacturer's instructions before protection course is applied.

3.5 TESTING:

- A. Before any protection or wearing course is applied, test all horizontal applications of waterproofing with a minimum of 25 mm (1-inch) head of water above highest point and leave for 24 hours.
- B. Mark leaks and repair when waterproofing is dry.
- C. Certify, to Resident Engineer, that water tests have been made and that areas tested were found watertight.

3.6 INSPECTION:

Do not cover waterproofed surfaces by other materials or backfill until work is approved by COTR.

- - - E N D - - -

**SECTION 07 21 13
THERMAL INSULATION**

PART 1 - GENERAL

1.1 DESCRIPTION:

- A. This section specifies thermal and acoustical insulation for buildings.
- B. Acoustical insulation is identified by thickness and words "Acoustical Insulation".

1.2 RELATED WORK

- A. Insulation in connection with roofing and waterproofing: Section 07 22 00, ROOF AND DECK INSULATION.
- B. Safing insulation: Section 07 84 00, FIRESTOPPING.

1.3 SUBMITTALS:

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES .
- B. Manufacturer's Literature and Data:
 - 1. Insulation, each type used
 - 2. Adhesive, each type used.
 - 3. Tape
- C. Certificates: Stating the type, thickness and "R" value (thermal resistance) of the insulation to be installed.

1.4 STORAGE AND HANDLING:

- A. Store insulation materials in weathertight enclosure.
- B. Protect insulation from damage from handling, weather and construction operations before, during, and after installation.

1.5 APPLICABLE PUBLICATIONS:

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by basic designation only.
- B. American Society for Testing and Materials (ASTM):
 - C270-08.....Mortar for Unit Masonry
 - C552-07.....Cellular Glass Thermal Insulation.
 - C553-08.....Mineral Fiber Blanket Thermal Insulation for
Commercial and Industrial Applications
 - C578-08.....Rigid, Cellular Polystyrene Thermal Insulation
 - C591-08.....Unfaced Preformed Rigid Cellular
Polyisocynurate Thermal Insulation

C612-04.....Mineral Fiber Block and Board Thermal
Insulation

C665-06.....Mineral Fiber Blanket Thermal Insulation for
Light Frame Construction and Manufactured
Housing

C728-05.....Perlite Thermal Insulation Board

C954-07.....Steel Drill Screws for the Application of
Gypsum Panel Products or Metal Plaster Base to
Steel Studs From 0.033 (0.84 mm) inch to 0.112
inch (2.84 mm) in thickness

C1002-07.....Steel Self-Piercing Tapping Screws for the
Application of Gypsum Panel Products or Metal
Plaster Bases to Wood Studs or Steel Studs

D312-00 (R2006).....Asphalt Used in Roofing

E84-08.....Surface Burning Characteristics of Building
Materials

F1667-05.....Driven Fasteners: Nails, Spikes and Staples.

PART 2 - PRODUCTS

2.1 INSULATION - GENERAL:

- A. Where thermal resistance ("R" value) is specified or shown for insulation, the thickness shown on the drawings is nominal. Use only insulation with actual thickness that is not less than that required to provide the thermal resistance specified.
- B. Where "R" value is not specified for insulation, use the thickness shown on the drawings.
- C. Where more than one type of insulation is specified, the type of insulation for each use is optional, except use only one type of insulation in any particular area.
- D. Insulation Products shall comply with following minimum content standards for recovered materials:

Material Type	Percent by Weight
Perlite composite board	23 percent post consumer recovered paper
Polyisocyanurate/polyurethane	
Rigid foam	9 percent recovered material
Foam-in-place	5 percent recovered material
Glass fiber reinforced	6 percent recovered material
Phenolic rigid foam	5 percent recovered material
Rock wool material	75 percent recovered material

The minimum-content standards are based on the weight (not the volume) of the material in the insulating core only.

2.2 MASONRY CAVITY WALL INSULATION:

- A. Mineral Fiber Board: ASTM C612, Type II, faced with a vapor retarder having a perm rating of not more than 0.5.
- B. Polyurethane or Polyisocyanurate Board: ASTM C591, Type I, faced with a vapor retarder having a perm rating of not more than 0.5.
- C. Polystyrene Board: ASTM C578, Type X.
- D. Perlite Board: ASTM C728.
- E. Cellular Glass Block: ASTM C552, Type I or IV.

2.3 PERIMETER INSULATION IN CONTACT WITH SOIL:

- A. Polystyrene Board: ASTM C578, Type IV, V, VI, VII, or IX where covered by soil or concrete.

2.4 EXTERIOR FRAMING OR FURRING INSULATION:

- A. Batt or Blanket: Optional.
- B. Mineral Fiber: ASTM C665, Type II, Class C, Category I where framing is faced with gypsum board.
- C. Mineral Fiber: ASTM C665, Type III, Class A where framing is not faced with gypsum board.

2.5 ACOUSTICAL INSULATION:

- A. Mineral Fiber boards: ASTM C553, Type II, flexible, or Type III, semirigid (4.5 pound nominal density).
- B. Mineral Fiber Batt or Blankets: ASTM C665. Maximum flame spread of 25 and smoke development of 450 when tested in accordance with ASTM E84.
- C. Thickness as shown; of widths and lengths to fit tight against framing.

2.6 SOUND DEADENING BOARD:

- A. Mineral Fiber Board: ASTM C612, Type IB, 13 mm (1/2 inch thick).

B. Perlite Board: ASTM C728, 13 mm (1/2 inch thick).

2.7 RIGID INSULATION:

- A. On the inside face of exterior walls, spandrel beams, floors, bottom of slabs, and where shown.
- B. Mineral Fiber Board: ASTM C612, Type IB or 2.
- C. Perlite Board: ASTM C728.
- D. Cellular Glass Block: ASTM C552, Type I.

2.8 FASTENERS:

- A. Staples or Nails: ASTM F1667, zinc-coated, size and type best suited for purpose.
- B. Screws: ASTM C954 or C1002, size and length best suited for purpose with washer not less than 50 mm (two inches) in diameter.
- C. Impaling Pins: Steel pins with head not less than 50 mm (two inches) in diameter with adhesive for anchorage to substrate. Provide impaling pins of length to extend beyond insulation and retain cap washer when washer is placed on the pin.

2.9 ADHESIVE:

- A. As recommended by the manufacturer of the insulation.
- B. Asphalt: ASTM D312, Type III or IV.
- C. Mortar: ASTM C270, Type 0.

2.10 TAPE:

- A. Pressure sensitive adhesive on one face.
- B. Perm rating of not more than 0.50.

PART 3 - EXECUTION

3.1 INSTALLATION - GENERAL

- A. Install insulation with the vapor barrier facing the heated side, unless specified otherwise.
- B. Install rigid insulating units with joints close and flush, in regular courses and with cross joints broken.
- C. Install batt or blanket insulation with tight joints and filling framing void completely. Seal cuts, tears, and unlapped joints with tape.
- D. Fit insulation tight against adjoining construction and penetrations, unless specified otherwise.

3.2 MASONRY CAVITY WALLS:

- A. Mount insulation on exterior faces of inner wythes of masonry cavity walls and brick faced concrete walls. Fill joints with same material used for bonding.

- B. Bond polystyrene board to surfaces with adhesive or Portland cement mortar mixed and applied in accordance with recommendations of insulation manufacturer.
- C. Bond mineral fiberboard, polyurethane or polyisocyanurate board, and perlite board to surfaces with adhesive as recommended by insulation manufacturer.
- D. Bond cellular glass insulation to surfaces with hot asphalt or adhesive cement.

3.3 PERIMETER INSULATION:

- A. Vertical insulation:
 - 1. Fill joints of insulation with same material used for bonding.
 - 2. Bond polystyrene board to surfaces with adhesive or Portland cement mortar mixed and applied in accordance with recommendations of insulation manufacturer.

3.4 EXTERIOR FRAMING OR FURRING BLANKET INSULATION:

- A. Pack insulation around door frames and windows and in building expansion joints, door soffits and other voids. Pack behind outlets around pipes, ducts, and services encased in walls. Open voids are not permitted. Hold insulation in place with pressure sensitive tape.
- B. Lap vapor retarder flanges together over face of framing for continuous surface. Seal all penetrations through the insulation.
- C. Fasten blanket insulation between metal studs or framing and exterior wall furring by continuous pressure sensitive tape along flanged edges.
- D. Ceiling Insulation and Soffit Insulation:
 - 1. At metal framing or ceilings suspension systems, install blanket insulation above suspended ceilings or metal framing at right angles to the main runners or framing. Tape insulation tightly together so no gaps occur and metal framing members are covered by insulation.
 - 2. In areas where suspended ceilings adjoin areas without suspended ceilings, install either blanket, batt, or mineral fiberboard extending from the suspended ceiling to underside of deck or slab above. Secure in place to prevent collapse or separation of hung blanket, batt, or board insulation and maintain in vertical position. Secure blanket or batt with continuous cleats to structure above.

3.5 RIGID INSULATION ON SURFACE OF EXTERIOR WALLS, FLOORS, AND UNDERSIDE OF FLOORS:

- A. On the interior face of solid masonry and concrete walls, beams, beam soffits, underside of floors, and to the face of studs for interior wall finish where shown.
- B. Bond to solid vertical surfaces with adhesive as recommended by insulation manufacturer. Fill joints with adhesive cement.
- C. Use impaling pins for attachment to underside of horizontal surfaces. Space fastenings as required to hold insulation in place and prevent sagging.
- D. Fasten board insulation to face of studs with screws, nails or staples. Space fastenings not more than 300 mm (12 inches) apart. Stagger fasteners at joints of boards. Install at each corner.

3.6 ACOUSTICAL INSULATION:

- A. Fasten blanket insulation between metal studs and wall furring with continuous pressure sensitive tape along edges or adhesive.
- B. Pack insulation around door frames and windows and in cracks, expansion joints, control joints, door soffits and other voids. Pack behind outlets, around pipes, ducts, and services encased in wall or partition. Hold insulation in place with pressure sensitive tape or adhesive.
- C. Do not compress insulation below required thickness except where embedded items prevent required thickness.
- D. Where acoustical insulation is installed above suspended ceilings install blanket at right angles to the main runners or framing. Extend insulation over wall insulation systems not extending to structure above.
- E. Where semirigid insulation is used which is not full thickness of cavity, adhere to one side of cavity maintaining continuity of insulation and covering penetrations or embedments in insulation.

- - - E N D - - -

**SECTION 07 22 00
ROOF AND DECK INSULATION**

PART 1 - GENERAL

1.1 DESCRIPTION

- A. Roof and deck insulation, on new construction ready to receive roofing membrane.
- B. Repairs and alteration work to existing roof insulation.

1.2 RELATED WORK

- A. Wood cants, blocking, and edge strips: Section 06 10 00, ROUGH CARPENTRY.
- B. Perimeter, rigid, and batt or blanket insulation not part of roofing system: Section 07 21 13, THERMAL INSULATION.
- C. Sheet metal components and wind uplift requirements for roof-edge design: Section 07 60 00, FLASHING AND SHEET METAL.

1.3 APPLICABLE PUBLICATIONS

- A. Publications listed below form a part of this specification to the extent referenced. Publications are referenced in the text by the basic designation only. Editions of applicable publications current on date of issue of bidding documents apply unless otherwise indicated.
- B. American Society of Heating, Refrigeration and Air Conditioning (ASHRAE):
 - 90.1-07.....Energy Standard for Buildings Except Low-Rise Residential Buildings
- C. ASTM International (ASTM):
 - C208-08.....Cellulosic Fiber Insulating Board
 - C552-07.....Cellular Glass Thermal Insulation
 - C726-05.....Mineral Fiber Roof Insulation Board
 - C728-05.....Perlite Thermal Insulation Board
 - C1177/C1177M-08.....Standard Specification for Glass Mat Gypsum Substrate for Use as Sheathing
 - C1278/C1278M-07.....Standard Specification for Fiber-Reinforced Gypsum Panel
 - C1289-10.....Faced Rigid Cellular Polyisocyanurate Thermal Insulation Board
 - C1396/C1396M-09.....Standard Specification for Gypsum Board
 - D41-05.....Asphalt Primer Used in Roofing, Dampproofing, and Waterproofing

- D312-06.....Asphalt Used in Roofing
- D2178-04.....Asphalt Glass Felt Used in Roofing and
Waterproofing
- D2822-05.....Asphalt Roof Cement
- D4586-07.....Standard Specification for Asphalt Roof Cement,
Asbestos-Free
- E84-09.....Standard Test Method for Surface Burning
Characteristics of Building Material
- F1667-05.....Driven Fasteners: Nails, Spikes, and Staples
- D. FM Approvals: RoofNav Approved Roofing Assemblies and Products.
- 4450-89.....Approved Standard for Class 1 Insulated Steel
Deck Roofs
- 4470-10.....Approved Standard for Class 1 Roof Coverings
- 1-28-09.....Loss Prevention Data Sheet: Design Wind Loads.
- 1-29-09.....Loss Prevention Data Sheet: Above-Deck Roof
Components
- 1-49-09.....Loss Prevention Data Sheet: Perimeter Flashing
- E. National Roofing Contractors Association: Roofing and Waterproofing
Manual
- F. Underwriters Laboratories, Inc. (UL): Fire Resistance Directory (2009)

1.4 PERFORMANCE REQUIREMENTS

- A. Thermal Performance: Provide roof insulation meeting minimum overall average R-value of 5.0 per inch, with minimum R-value at any location of 10.
- B. FM Approvals: Provide roof insulation complying with requirements in FM Approvals 4450 and 4470 as part of specified roofing system, listed in FM Approvals "RoofNav" as part of roofing system meeting Fire/Windstorm Classification in Division 07 roofing section.

1.5 QUALITY CONTROL

- A. Requirements of Division 07 roofing section for qualifications of roofing system insulation Installer; Work of this Section shall be performed by same Installer.
- B. Requirements of Division 07 roofing section for inspection of Work of this Section and qualifications of Inspector.
- C. Unless specified otherwise, comply with the recommendations of the NRCA "Roofing and Waterproofing Manual" applicable to insulation for storage, handling, and application.

- D. Requirements of roofing system uplift pressure design for specified roofing system.
- E. Requirements of applicable FM Approval for specified roofing system insulation attachment.
- F. Requirements of applicable Miami-Dade County approval for high-wind zone design.

1.6 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Product Data:
 - 1. Asphalt and adhesive materials, each type.
 - 2. Roofing cement, each type.
 - 3. Roof insulation, each type.
 - 4. Substrate board, each type.
 - 5. Cover board, each type.
 - 6. Fastening requirements.
 - 7. Insulation span data for flutes of metal decks.
- C. Shop Drawings: Include plans, sections, details, and attachments.
 - 1. Nailers, cants, and terminations.
 - 2. Layout of insulation showing slopes, tapers, penetration, and edge conditions.
- D. Samples:
 - 1. Roof insulation, each type.
 - 2. Nails and fasteners, each type.
- E. Certificates:
 - 1. Indicating type, thermal conductance, and minimum and average thickness of insulation.
 - 2. Indicating materials and method of application of insulation system meet the requirements of FM Approvals for specified roofing system.
- F. Laboratory Test Reports: Thermal values of insulation products.
- G. Layout of tapered roof system showing units required.
- H. Documentation of supervisors' and inspectors' qualifications.

1.7 DELIVERY, STORAGE AND MARKING

- A. Comply with the recommendations of the NRCA "Roofing and Waterproofing Manual" applicable to built-up roofing for storage, handling and installation requirements.

1.8 QUALITY ASSURANCE:

- A. Roof insulation on combustible or steel decks shall have a flame spread rating not greater than 75 and a smoke developed rating not greater than 150, exclusive of covering, when tested in accordance with ASTM E84, or shall have successfully passed FM Approvals 4450.
 - 1. Insulation bearing the UL label and listed in the UL Building Materials Directory as meeting the flame spread and smoke developed ratings will be accepted in-lieu-of copies of test reports.
 - 2. Compliance with flame spread and smoke developed ratings will not be required when insulation has been tested as part of a roof construction assembly of the particular type used for this project and the construction is listed as fire-classified in the UL Building Materials Directory or listed as Class I roof deck construction in the FM Approvals "RoofNav."
 - 3. Insulation tested as part of a roof construction assembly shall bear UL or FM labels attesting to the ratings specified herein.

PART 2 - PRODUCTS**2.1 ADHESIVE MATERIALS**

- A. Adhesive Materials, General: Adhesive and sealant materials recommended by roofing system manufacturer for intended use, identical to materials utilized in approved listed roofing system, and compatible with roofing membrane.
 - 1. Liquid-type adhesive materials shall comply with VOC limits of authorities having jurisdiction.
 - 2. Adhesives and sealants that are not on the exterior side of weather barrier shall comply with the following limits for VOC content when calculated according to 40 CFR 59, Subpart D (EPA Method 24):
 - a. Plastic Foam Adhesives: 50 g/L.
 - b. Multipurpose Construction Adhesives: 70 g/L.
 - c. Fiberglass Adhesives: 80 g/L.
 - d. Contact Adhesives: 80 g/L.
 - e. Other Adhesives: 250 g/L.
 - f. Nonmembrane Roof Sealants: 300 g/L.
 - g. Sealant Primers for Nonporous Substrates: 250 g/L.
 - h. Sealant Primers for Porous Substrates: 775 g/L.
- B. Primer: ASTM D41.
- C. Asphalt: ASTM D312, Type III or IV for vapor retarders and insulation.

- D. Bead-Applied Urethane Insulation Adhesive: Insulation manufacturer's recommended bead-applied, low-rise, one- or multicomponent urethane adhesive formulated to attach roof insulation to substrate or to another insulation layer.
- E. Roof Cement: Asbestos free, ASTM D2822, Type I or Type II, ; or, D4586, Type I or Type II.

2.2 ROOF AND DECK INSULATION

- A. Roof and Deck Insulation, General: Preformed roof insulation boards approved by roofing manufacturer and listed as component of FM Approvals-approved roofing system.
- B. Polyisocyanurate Board Insulation: ASTM C1289, Type II, Class 1, Grade 2, felt or glass-fiber mat facer on both major surfaces.
- C. Tapered Roof Insulation System:
 - 1. Fabricate of polyisocyanurate. Use only factory-tapered insulation.
 - 2. Cut to provide high and low points with crickets and slopes as shown.
 - 3. Minimum thickness of tapered sections; 38 mm (1-1/2 inch).
 - 4. Minimum slope 1:48 (1/4 inch per 12 inches).

2.3 INSULATION ACCESSORIES

- A. Glass (Felt): ASTM D2178, Type VI, heavy duty ply sheet.
- B. Cants and Tapered Edge Strips:
 - 1. Wood Cant Strips: Refer to Division 06 Section "Rough Carpentry."
 - 2. Tapered Edge Strips: 1:12 (one inch per foot), from 0 mm (0 inches), 300 mm to 450 mm (12 inches to 18 inches) wide.
 - a. Cellulosic Fiberboard: ASTM C208.
 - b. Mineral Fiberboard: ASTM C726.
 - c. Perlite Board: ASTM C728.
- C. Vapor Retarder:
 - 1. Glass-Fiber Felts: ASTM D2178, Type IV, asphalt impregnated.
 - 2. Type X gypsum board, ASTM C1396/C1396M, 16 mm (5/8 inch) thick.
- D. Cover Board:
 - 1. Glass-mat, water-resistant gypsum substrate, ASTM C1177/C1177M, 16 mm (5/8 inch) thick, factory primed.
 - 2. Cellulosic-fiber-reinforced, water-resistant gypsum substrate, ASTM C1278/C1278M, 16 mm (5/8 inch) thick.

2.4 FASTENERS

- A. Fasteners: Factory-coated steel fasteners and metal or plastic plates complying with FM Approvals 4470, designed for fastening substrate board to roof deck.
- B. Staples and Nails: ASTM F1667. Type as designated for item anchored and for substrate.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Comply with requirements of Division 07 roofing section.

3.2 PREPARATION

- A. Comply with requirements of Division 07 roofing section.

3.3 SUBSTRATE BOARD INSTALLATION

- A. Fasten substrate board to top flanges of steel deck to resist uplift pressures according to roofing system manufacturers instructions and requirements of FM Approvals listing for specified roofing system.

3.4 VAPOR RETARDER INSTALLATION

- A. Steel Deck:
 - 1. Material and method of application of roofing systems used on metal decks shall meet the requirements of FM Approvals for Class I-A Insulated Steel Roof Deck.
 - 2. Attach substrate board and subsequent components to meet the requirements of FM Approval's "RoofNav" listing for specified system meeting Fire/Windstorm Classification indicated in Division 07 roofing section.
 - 3. Locate the long dimension edge joints to have solid bearing on top of decking ribs; do not cantilever over rib openings or flutes.

3.5 RIGID INSULATION INSTALLATION

- A. Insulation Installation, General:
 - 1. Install roof insulation in accordance with roofing system manufacturer's written instructions.
 - 2. Install roof insulation in accordance with requirements of FM Approval's Listing for specified roofing system.
 - 3. Base Sheet: Where required by roofing system, install one lapped base sheet specified in Division 07 roofing section by mechanically fastening to roofing substrate (metal deck) bead-applied adhesive (concrete) prior to installation of insulation.

4. Cant Strips: Install wood cant strips specified in Division 06 Section ROUGH CARPENTRY at junctures of roofing system with vertical construction.
- B. Insulation Thickness:
1. Thickness of roof insulation shown on drawings is nominal. Actual thickness shall provide the average thermal resistance "R" value of not less than that specified in Performance Requirements Article.
 2. Insulation on Metal Decks: Provide minimum thickness of insulation for metal decks recommended by the insulation manufacturer to span rib opening (flute size) of metal deck used. Support edges of insulation on metal deck ribs.
 3. When thickness of insulation to be used is more or less than that shown on the drawings, make adjustments in the alignment and location of roof drains, flashing, gravel stops, fascias and similar items at no additional cost to the Government.
 4. Where tapered insulation is used, the thickness of the insulation at high points and roof edges shall be as shown on the drawings; the thickness at the low point (drains) shall be not less than 38 mm (1-1/2 inches).
 5. Use not less than two layers of insulation when insulation is 68 mm (2.7 inch) or more in thickness unless specified otherwise. Stagger joints minimum 150 mm (6 inches).
- C. Lay insulating units with close joints, in regular courses and with cross joints broken. When laid in more than one layer, break joints of succeeding layers of roof insulation with those in preceding layer.
- D. Lay units with long dimension perpendicular to the rolled (longitudinal) direction of the roofing felt.
- E. Seal all cut edges at penetrations and at edges against blocking with bitumen or roof cement.
- F. Cut to fit tight against blocking or penetrations.
- G. Cover all insulation installed on the same day; comply with temporary protection requirements of Division 07 roofing section.
- H. Installation Method:
1. Adhered Insulation:
 - a. Prime substrate as required.
 - b. Set each layer of insulation firmly in ribbons of bead-applied insulation adhesive.

- c. Set each layer of insulation firmly in uniform application of full-spread insulation adhesive.
- 2. Mechanically Fastened Insulation:
 - a. Fasten insulation in accordance with FM Approval's "RoofNav" requirement in Division 07 roofing section.
 - b. Fasten insulation to resist uplift pressures specified in Division 07 roofing section.
 - 3. Cover Board: Install cover boards over insulation with long joints in continuous straight lines with staggered end joints. Offset cover board joints from insulation joints minimum 150 mm (6 inches). Fasten cover boards according to "Adhered Insulation" requirements.

- - - E N D - - -

SECTION 07 52 16.13
STYRENE-BUTADIENE-STYRENE MODIFIED BITUMINOUS MEMBRANE ROOFING, COLD-APPLIED

PART 1 - GENERAL

1.1 DESCRIPTION:

- A. This section specifies modified bituminous sheet roofing and base flashing installed using cold-applied adhesive on new construction with solar reflective granular coating.

1.2 RELATED WORK:

- A. Wood cants, blocking and wood edge strips: Section 06 10 00, ROUGH CARPENTRY.
- B. Roof Insulation under Membrane: Section 07 22 00, ROOF AND DECK INSULATION.
- C. Sheet metal components and wind uplift requirements for roof-edge design: Section 07 60 00, FLASHING AND SHEET METAL.
- D. Miscellaneous items: Section 07 71 00, ROOF SPECIALTIES/ Section 07 72 00, ROOF ACCESSORIES.

1.3 APPLICABLE PUBLICATIONS:

- A. Publications listed below form a part of this specification to the extent referenced. Publications are referenced in the text by the basic designation only. Editions of applicable publications current on date of issue of bidding documents apply unless otherwise indicated.
- B. American National Standards Institute/Single-Ply Roofing Institute (ANSI/SPRI):
 ANSI/SPRI ES-1-03.....Wind Design Standards for Edge Systems Used with Low Slope Roofing Systems
- C. American Society of Civil Engineers/Structural Engineering Institute (ASCE/SEI):
 ASCE/SEI-7-10.....Minimum Design Loads for Buildings and Other Structures
- D. Asphalt Roofing Manufacturers Association/National Roofing Contractors Association (ARMA/NRCA): Quality Control Guidelines for the Application of Polymer Modified Bitumen Roofing
- E. ASTM International (ASTM):
 C1370-00 (R2005).....Standard Test Method for Determining the Chemical Resistance of Aggregates for Use in Chemical-Resistant Sulfur Polymer Cement

	Concrete and Other Chemical-Resistant Polymer Concretes
C1371-04.....	Standard Test Method for Determination of Emittance of Materials Near Room Temperature Using Portable Emissometers
C1549-04.....	Standard Test Method for Determination of Solar Reflectance Near Ambient Temperature Using a Portable Solar Reflectometer
D146-04.....	Standard Test Methods for Sampling and Testing Bitumen-Saturated Felts and Woven Fabrics for Roofing and Waterproofing
D1644-01 (R2006)	Standard Test Methods for Nonvolatile Content of Varnishes
D2523-00 (R2006)	Standard Practice for Testing Load-Strain Properties of Roofing Membranes
D2823-05.....	Standard Specification for Asphalt Roof Coatings, Asbestos Containing
D3960-05.....	Standard Practice for Determining Volatile Organic Compound (VOC) Content of Paints and Related Coatings
D4073-06.....	Standard Test Method for Tensile-Tear Strength of Bituminous Roofing Membranes
D4263-83 (2005)	Standard Test Method for Indicating Moisture in Concrete by the Plastic Sheet Method
D4586-07.....	Asphalt Roof Cement, Asbestos Free
D4601-04.....	Standard Specification for Asphalt-Coated Glass Fiber Base Sheet Used in Roofing
D4897-01.....	Asphalt Coated Glass Fiber Venting Base Sheet Used in Roofing
D5147-07.....	Standard Test Methods for Sampling and Testing Modified Bituminous Sheet Material
D5201-05 (R2010)	Standard Practice for Calculating Formulation Physical Constants of Paints and Coatings
D6162-00 (R2008)	Styrene Butadiene Styrene (SBS) Modified Bituminous Sheet Materials Using a Combination of Polyester and Glass Fiber Reinforcements

- D6163-00 (2008).....Styrene Butadiene Styrene (SBS) Modified
Bituminous Sheet Materials Using Glass Fiber
Reinforcements
- D6164-05.....Styrene Butadiene Styrene (SBS) Modified
Bituminous Sheet Materials Using Polyester
Reinforcements
- D6511-06.....Standard Test Methods for Solvent Bearing
Bituminous Compounds
- E108-10.....Standard Test Methods for Fire Tests of Roof
Coverings
- E408-71 (R2008).....Standard Test Methods for Total Normal
Emittance of Surfaces Using Inspection-Meter
Techniques
- E1918-06.....Standard Test Method for Measuring Solar
Reflectance of Horizontal and Low-Sloped
Surfaces in the Field
- E1980-01.....Standard Test Method for Measuring Solar
Reflectance of Horizontal and Low-Sloped
Surfaces in the Field
- WK 29032-10.....Standard Test Method for Determination of Solar
Reflectance Near Ambient Temperature Using a
Portable Solar Reflectometer
- F. American Society of Heating, Refrigeration, and Air Conditioning
Engineers (ASHRAE)
ASHRAE 90.1-2007.....Energy Standard for Buildings Except Low-Rise
Residential Buildings, Appendix f.
- G. Cool Roof Rating Council:
CRRC-1.....Product Rating Program, www.coolroofs.org
- H. FM Approvals: RoofNav Approved Roofing Assemblies and Products.
4450.....Approved Standard for Class 1 Insulated Steel
Deck Roofs
4470.....Approved Standard for Class 1 Roof Coverings
1-28.....Loss Prevention Data Sheet: Design Wind Loads.
1-49.....Loss Prevention Data Sheet: Perimeter Flashing
- I. National Roofing Contractors Association: Roofing and Waterproofing
Manual
- J. U.S. Environmental Protection Agency (EPA):

EPA 600/R13/116.....Method for the Determination of Asbestos in
Bulk Building Materials

1.4 PERFORMANCE REQUIREMENTS

- A. Material Compatibility: Provide roofing materials that are compatible with one another under conditions of service and application required, as demonstrated by membrane roofing manufacturer based on testing and field experience.
- B. Roofing Membrane System Load-Strain Properties: Provide a roofing membrane identical to component systems that have been successfully tested by a qualified independent testing and inspecting agency to meet the following minimum load-strain properties at membrane failure when tested according to ASTM D2523:
 - 1. Tensile strain at failure, at 0 deg F (-18 deg C): 600 lbf(2.67 kN) cross machine direction, minimum; 4.0 to 5.5 percent elongation at break.
- C. Roofing System Energy Performance Requirements: Provide a roofing system identical to components that that have been successfully tested by a qualified independent testing and inspecting agency to meet the following requirements:
 - 1. Energy Performance, Aged: Provide roofing system with minimum three-year aged solar reflectance not less than 0.55 when tested in accordance with ASTM C1549 or ASTM E1918, and in addition, a minimum three-year-aged thermal emittance of 0.75 when tested in accordance with ASTM C1371 or ASTM E408.
 - a. Where tested aged values are not available for proposed product, submit calculations to adjust initial solar reflectance to demonstrate compliance as indicated in ASHRAE 90.1-2007 Addendum f.
 - b. Alternatively, provide roofing system with minimum three-year aged Solar Reflectance Index of not less than 64 when determined in accordance with the Solar Reflectance Index method in ASTM E1980 using a convection coefficient of 2.1 BTU/h-ft² (12 W/m²K).

1.5 QUALITY CONTROL:

- A. Installer Qualifications:
 - 1. Licensed or approved in writing by manufacturer to perform work under warranty requirements of this Section.

2. Employ full-time supervisors knowledgeable and experienced in roofing of similar types and scopes, and able to communicate with owner and workers.
- B. Inspector Qualifications: Inspection of work by third-party technical inspector or technical representative of manufacturer experienced in the installation and maintenance of the specified roofing system, qualified to perform roofing observation and inspection specified in Field Quality Control Article, to determine Installer's compliance with the requirements of this Project, and approved by the manufacturer to issue warranty certification. The Roofing Inspector shall be one of the following:
1. An authorized full-time technical employee of the manufacturer, not engaged in the sale of products.
 2. An independent party certified as a Registered Roof Observer by the Roof Consultants Institute (RCI), retained by the Contractor or the Manufacturer and approved by the Manufacturer.
- C. Product/Material Qualifications:
1. Obtain products from single manufacturer or from sources recommended by manufacturer for use with roofing system and incorporated in manufacturer's warranty.
 2. Provide manufacturer's certification that field applied bituminous coatings and mastics, and field applied roof coatings comply with limits for Volatile Organic Compounds (VOC) per the National Volatile Organic Compound Emission Standards for Architectural Coatings pursuant to Section 183(e) of the Clean Air Act with limits as follows:
 - a. Bituminous Coatings and Mastics: 500 g/l (4.2 lb/gal.).
 - b. Roof Coatings: 250 g/l (2.1 lb/gal.).
- D. Roofing system design standard requirements:
1. Recommendations of the NRCA "Roofing and Waterproofing Manual" applicable to modified bituminous sheet roofing for storage, handling and application.
 2. Recommendations of FM Approvals 1-49 Loss Prevention Data Sheet for Perimeter Flashings.
 3. Recommendations of ANSI/SPRI ES-1 for roof edge design.
 4. FM Approvals Listing: Provide roofing membrane, base flashing, and component materials that comply with requirements in FM Approvals 4450 and FM Approvals 4470 as part of a roofing system and that are

listed in FM Approvals "RoofNav" for Class 1 or noncombustible construction, as applicable. Identify materials with FM Approvals markings.

a. Fire/Windstorm Classification: Class 1A-90.

b. Hail Resistance: MH.

E. Pre-Roofing Meeting:

1. Upon completion of roof deck installation and prior to any roofing application, hold a pre-roofing meeting arranged by the Contractor and attended by the Roofing Inspector, Material Manufacturers Technical Representative, Roofing Applicator, Contractor, and Contracting Officer's Technical Representative (COTR).
2. Discuss specific expectations and responsibilities, construction procedures, specification requirements, application, environmental conditions, job and surface readiness, material storage, and protection.
3. Inspect roof deck at this time to:
 - a. Verify that work of other trades which penetrates roof deck is completed.
 - b. Determine adequacy of deck anchorage, presence of foreign material, moisture and unlevel surfaces, or other conditions that would prevent application of roofing system from commencing or cause a roof failure.
 - c. Examine samples and installation instructions of manufacturer.

1.6 SUBMITTALS:

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, SAMPLES.
- B. Product Data:
 1. Asphalt and adhesive materials.
 2. Modified bituminous sheet roofing and flashing membrane.
 3. Roofing adhesive.
 4. Roof walkway.
 5. Fastening requirements.
 6. Application instructions.
- C. Samples:
 1. Nails and fasteners, each type.
- D. Shop Drawings: Include plans, sections, details, and attachments.
 1. Base flashings and terminations.

- 2. Nailers and cants.
- E. Certificates:
 - 1. Indicating materials and method of application of roofing system meets requirements of FM Approvals "RoofNav" for specified fire/windstorm classification.
 - 2. Indicating compliance with load/strain properties requirement.
 - 3. Indicating compliance with energy performance requirement.
- F. Warranty: As specified.
- G. Documentation of supervisors' and inspectors' qualifications.
- H. Field reports of roofing inspector.
- I. Temporary protection plan. Include list of proposed temporary materials.
- J. Contract Close-out Submittals:
 - 1. Maintenance Manuals.
 - 2. Warranty signed by installer and manufacturer.

1.7 DELIVERY, STORAGE AND MARKING:

- A. Comply with the recommendations of the NRCA "Roofing and Waterproofing Manual" applicable to built-up roofing for storage, handling and installation.

1.8 ENVIRONMENTAL REQUIREMENTS

- A. Weather Limitations: Proceed with installation only when existing and forecasted weather conditions permit roofing system to be installed according to manufacturer's written instructions and warranty requirements.
- B. Environmental Controls: Refer to Section 01 57 19, TEMPORARY ENVIRONMENTAL CONTROLS.
- C. Protection of interior spaces: Refer to Section 01 00 00, GENERAL REQUIREMENTS.

1.9 WARRANTY:

- A. Roofing work subject to the terms of the Article "Warranty of Construction", FAR clause 52.246-21, except extend warranty period to 10 years from acceptance of facility by the Government.

PART 2 - PRODUCTS

2.1 ADHESIVE AND ASPHALT MATERIALS:

- A. General: Adhesive and sealant materials recommended by roofing system manufacturer for intended use, identical to materials utilized in approved listed roofing system, and compatible with roofing membrane.
 - 1. Liquid-type auxiliary materials shall comply with VOC limits of authorities having jurisdiction.
- B. Cold-Applied Adhesive for sheet membrane: One-part, asbestos-free, low-volatile, cold-applied adhesive specially formulated for compatibility and use with specified roofing membranes and flashings, with the following physical properties:
 - 1. Asbestos Content, EPA 600 R13/116: None.
 - 2. Volatile Organic Compounds (VOC), maximum, ASTM D6511: <250 g/L.
 - 3. Nonvolatile Content, minimum, ASTM D6511: 75 percent.
 - 4. Uniformity and Consistency, ASTM D6511: Pass.
- C. Cold-Applied Adhesive for membrane flashing: One-part, cold-applied adhesive specially formulated for compatibility and use with specified roofing membranes and flashings, with the following physical properties:
 - 1. Asbestos Content, EPA 600 R13/116: None.
 - 2. Volatile Organic Compounds (VOC), maximum, ASTM D6511: <250 g/L.
 - 3. Nonvolatile Content, minimum, ASTM D6511: 75 percent.
 - 4. Uniformity and Consistency, ASTM D6511: Pass.
- D. Roof Cement: ASTM D4586, Type II.

2.2 MEMBRANE AND SHEET MATERIALS:

- A. Membrane Materials, General: Provide combination of base, ply, and cap sheet materials that have been tested in combination and comply with load/strain properties performance requirement in Part 1 of this Section.
- B. Base Sheet: ASTM D4601, Type II, nonperforated, asphalt-impregnated and coated glass-fiber sheet dusted with fine mineral surfacing on both sides, with the following properties:
 - 1. Breaking Strength, minimum, ASTM D146: cross machine direction, 12.2 kN/m (70 lbf/in).
 - 2. Pliability, 12.7 mm (1/2 inch) radius bend, ASTM D146: No failures.

C. Membrane Cap Sheet: ASTM D6163, Grade G, Type II, glass-fiber-reinforced, SBS/SEBS/SIS modified asphalt sheet; granular surfaced; and as follows:

1. Exterior Fire-Test Exposure, ASTM E108: Class A.
2. Tensile Strength at 23 deg. C (73 deg. F), minimum, cross machine direction, ASTM D5147: 24 kN/m (140 lbf/in).
3. Tear Strength at 23 deg. C (73 deg. F), minimum, cross machine direction, ASTM D5147: 880 N (200 lbf).
4. Elongation at 23 deg. C (73 deg. F), minimum, cross machine direction, at 5 percent maximum load ASTM D5147: 40 percent.
5. Low Temperature Flex, maximum, ASTM D5147: -31 deg. C (-25 deg. F).

D. Base Flashing Sheet: ASTM D6164, Grade G, Type II, polyester-reinforced, SBS-modified asphalt sheet; granular surfaced; Granule Color: White.

2.3 FASTENERS:

- A. Roofing Fasteners: Factory-coated steel fasteners and metal or plastic plates, where applicable, meeting requirements of FM Approvals 4470, tested by fastener manufacturer for required pullout strength, and recommended by roofing manufacturer for application.
- B. Accessory Fasteners: Corrosion-resistant fasteners compatible with adjacent materials and recommended for application by manufacturer of component to be fastened.

2.4 ROOF WALKWAY:

- A. Prefabricated asphalt plank consisting of a homogeneous core of asphalt, plasticizers and inert fillers, bonded by heat and pressure between two saturated and coated sheets of felt:
 1. Top side of plank surfaced with ceramic granules. Granule Color: White.
 2. Size: Minimum 13 mm (1/2-inch) thick, manufacturer's standard size, but not less than 300 mm (12 inches) in least dimension and 600 mm (24 inches) in length.

PART 3 - EXECUTION

3.1 EXAMINATION:

- A. Examine substrates and conditions with roofing Installer and roofing inspector to verify compliance with project requirements and

- suitability to accept subsequent roofing work. Correct unsatisfactory conditions before proceeding with roofing work.
- B. Do not apply roofing if roof surface will be used for subsequent work platform, storage of materials, or staging or scaffolding will be erected thereon unless system is protected.

3.2 PREPARATION

- A. Complete roof deck construction prior to commencing roofing work:
1. Install curbs, blocking, edge strips, nailers, cants, and other components where insulation, roofing, and base flashing is attached to, in place ready to receive insulation and roofing.
 2. Complete deck and insulation to provide designed drainage to working roof drains.
 3. Document installation of related materials to be concealed prior to installing roofing work.
- B. Dry out surfaces, including the flutes of metal deck that become wet from any cause during progress of the work before roofing work is resumed. Apply materials to dry substrates.
- C. Sweep decks to broom clean condition. Remove all dust, dirt or debris.
- D. Remove projections that might damage materials.
- E. Concrete Decks, except Insulating Concrete:
1. Test concrete decks for moisture prior to application of roofing materials. Test for capillary moisture by plastic sheet method according to ASTM D4263.
 2. Prime concrete decks, including precast units, with primer as specified. Keep primer back four inches from joints in precast units.
 3. Allow primer to dry before application of adhesive.

3.3 TEMPORARY PROTECTION

- A. Install temporary protection at the end of day's work and when work is halted for an indefinite period or work is stopped when precipitation is imminent. Comply with approved temporary protection plan.
- B. Install temporary cap flashing over the top of base flashings where permanent flashings are not in place to provide protection against moisture entering the roof system through or behind the base flashing. Securely anchor in place to prevent blow off and damage by construction activities.
- C. Provide for removal of water or drainage of water away from the work.

- D. Provide temporary protection over installed roofing by means of duckboard walkways, plywood platforms, or other materials, as approved by COTR, for roof areas that are to remain intact, and that are subject to foot traffic and damage. Provide notches in sleepers to permit free drainage.

3.4 INSTALLATION, GENERAL

- A. NRCA Installation Standard: Install roofing system in accordance with applicable NRCA Manual Plates and NRCA recommendations, including ARMA/NRCA's "Quality Control Guidelines for the Application of Polymer Modified Bitumen Roofing"
- B. Manufacturer Recommendations: Comply with roofing system manufacturer's written installation recommendations.
- C. Coordination with related work: Coordinate roof operations with roof insulation and sheet metal work so that insulation and flashings are installed concurrently to permit continuous roofing operations.
- D. Installation Conditions:
 - 1. Apply dry roofing materials. Apply roofing work over dry substrates and materials.
 - 2. Apply materials within temperature range and surface and ambient conditions recommended by manufacturer.
 - 3. Except for temporary protection, do not apply materials during damp or rainy weather, during excessive wind conditions, nor while moisture (dew, snow, ice, fog or frost) is present in any amount in or on the materials to be covered or installed:
 - a. Do not apply materials when the temperature is below 4 deg. C (40 deg. F).
 - b. Do not apply materials to substrate having temperature of 4 deg. C (40 deg. F) or less.

3.5 INSTALLATION OF MODIFIED BITUMEN MEMBRANE:

- A. Primer: Apply primer to substrates where recommended by roofing manufacturer, in application quantities recommended by roofing manufacturer.
- B. Cold-Applied Adhesive: Apply cold-applied adhesive in application quantities recommended by roofing manufacturer at substrate, between membrane sheets, and as glaze coat where required.
- C. Membrane Sheets:

1. Number of Plies: 2, minimum, including base sheet and cap sheet, and additional plies as required to meet load/strain properties specified in Part 1 of this Section.
 2. Commence the laying of sheets at the low points.
 3. Roll sheets into cold-applied adhesive brushing down to firmly embed, free of wrinkles, fish mouths, blisters, bubbles, voids, air pockets or other defects that prevent complete adhesion:
 4. Cut to fit closely around pipes, roof drains, bitumen stops, and similar roof projections.
 5. Lap sheets shingle fashion starting with starter strips at right angles to slope of roof.
 6. Laps for Top Sheet and Base Sheet:
 - a. Base sheet, lapped 75 mm (three inches).
 - b. Use 450 mm (18 inch) starting widths, lap top sheet 475 mm (19 inches).
 - c. Lap end joints of sheet 150 mm (six inches). Stagger end joints in relation to end joints in adjacent and proceeding plies.
- D. Roof edges and terminations:
1. Where nailers occur at roof edges under gravel stops or penetrations to receive metal base flashing, apply a continuous strip of underlayment over the nailers before the first ply sheet is applied. Strip shall be installed on top of venting base sheet if any.
 2. After membrane is installed, turn the underlayment back over the roofing, and secure in place with cold-applied adhesive before gravel stops or other metal flanges extending out onto the membrane are installed.
 3. Where cants occur at vertical surfaces, cut off roofing sheets two inches above top of cant strips, except at prefabricated curbs, scuttles and other roof accessories having integral cants, extend membrane over cant and up vertical surface to top of curb or nailer as shown.
 4. Where fascia-cant occurs at roof edges, extend membrane beyond outside cant face and cut off at outside after base flashing is installed.
 5. Where reglet occurs at vertical surfaces, extend plies roofing sheets up into reglet the full depth of the reglet.

3.6 BASE FLASHING:

- A. Provide built-up base flashing over cants and as necessary to make work watertight.
- B. Prime vertical surfaces of masonry and concrete with asphalt primer except where vented base sheet is required to provide edge venting.
- C. Apply flashing on top of roofing, up face of cant and up the face of the vertical surface, at least 200 mm (eight inches) above the roofing but not more than 350 mm (14 inches) above the roofing, generally full height beneath counter flashing or top of curb flashing.
 - 1. At fascia-cants, extend to top of cant and cut off at top of cant.
 - 2. At reglet, extend full depth into the reglet.
- D. Use two plies of modified bituminous sheet.
 - 1. Extend the first ply 100 mm (four inches) out on the roofing, and the second ply 75 mm (three inches) beyond the first ply. Lap ends 75 mm (three inches) with joints broken 450 mm (18 inches) in each ply. Use smooth surface modified bituminous sheet for first ply.
 - 2. Use granular surfaced modified bitumen cap sheet.
- E. Set base flashing in a solid application of cold-applied adhesive.
 - 1. Set cap sheet in cold-applied adhesive with laps sealed with cold-applied adhesive.
- F. Except at metal fascia cants, secure top edge of base flashing with nails on a line approximately 25 mm (one inch) below top edge, spaced not more than 200 mm (eight inches) on center.
 - 1. Cover nail heads with roof cement.
 - 2. Cover the top of the base flashing with counterflashing as specified in Section 07 60 00, FLASHING AND SHEET METAL. At the fascia cants secure the top edge of the flashing with fascia compression clamp as specified in Section 07 60 00, FLASHING AND SHEET METAL.

3.7 STRIPPING:

- A. Coordinate to set flanges of metal flashing in roof cement on top sheet of the modified bituminous roofing and mailing to blocking with Section 07 60 00, FLASHING AND SHEET METAL.
- B. Cover that portion of the horizontal flanges of metal base flashings, gravel stops, and other flanges extending out onto the roofing with modified bituminous sheet.

- C. Extend the sheet out on the roofing 150 mm six inches beyond the edge of the metal flange. Cut edge to fit tight against vertical members of flange.
- D. Prime flange before stripping, embed sheet in cold-applied adhesive.

3.8 ROOF WALKWAYS

- A. Install roof walkways where indicated.
- B. Set prefabricated planks in solid application of cold-applied adhesive. Maintain 75 mm (three inch) to 150 mm (six-inch) space between planks.

3.9 FIELD QUALITY CONTROL:

- A. Roofing Inspector: Contractor shall engage a qualified roofing inspector for a minimum of 5 full-time days on site to perform roof tests and inspections and to prepare start up, interim, and final reports. Roofing Inspector's quality assurance inspections shall comply with criteria established in ARMA/NRCA's "Quality Control Guidelines for the Application of Built-up Roofing."
- B. Final Roof Inspection: Arrange for roofing system manufacturer's technical personnel to inspect roofing installation on completion.
 - 1. Notify Architect and Owner 48 hours in advance of date and time of inspection.
- C. Repair or remove and replace components of roofing work where test results or inspections indicate that they do not comply with specified requirements.
 - 1. Additional testing and inspecting, at Contractor's expense, will be performed to determine if replaced or additional work complies with specified requirements.

3.10 PROTECTING AND CLEANING

- A. Protect membrane roofing system from damage and wear during remainder of construction period.
- B. Correct deficiencies in or remove membrane roofing system that does not comply with requirements; repair substrates; and repair or reinstall membrane roofing system to a condition free of damage and deterioration at time of acceptance by Owner.

C. Clean overspray and spillage from adjacent construction. Clean membrane and restore surface to like-new condition meeting solar reflectance requirements.

- - - E N D - - -

**SECTION 07 60 00
FLASHING AND SHEET METAL**

PART 1 - GENERAL

1.1 DESCRIPTION

Formed sheet metal work for wall and roof flashing, copings, roof edge metal, fasciae, drainage specialties, and formed expansion joint covers are specified in this section.

1.2 RELATED WORK

- A. Manufactured flashing, copings, roof edge metal, and fasciae: Section 07 71 00 ROOF SPECIALTIES.
- B. Membrane base flashings and stripping: Section 07 52 16 .13 STYRENE-BUTADIENE-STYRENE MODIFIED BITUMINOUS MEMBRANE ROOFING COLD APPLIED.
- C. Flashing components of factory finished roofing and wall systems: Division 07 roofing and wall system sections.
- D. Joint Sealants: Section 07 92 00, JOINT SEALANTS.
- E. Color of factory coated exterior architectural metal and anodized aluminum items: Section 09 06 00, SCHEDULE FOR FINISHES.
- F. Integral flashing components of manufactured roof specialties and accessories or equipment: Section 07 71 00, ROOF SPECIALTIES, Section 07 72 00, ROOF ACCESSORIES, Division 22, PLUMBING sections and Division 23 HVAC sections.
- G. Paint materials and application: Section 09 91 00, PAINTING.
- H. Flashing of Roof Drains: Section 22 14 00, FACILITY STORM DRAINAGE .

1.3 APPLICABLE PUBLICATIONS

- A. Publications listed below form a part of this specification to the extent referenced. Publications are referenced in the text by the basic designation only. Editions of applicable publications current on date of issue of bidding documents apply unless otherwise indicated.
- B. Aluminum Association (AA):
 - AA-C22A41.....Aluminum Chemically etched medium matte, with clear anodic coating, Class I Architectural, 0.7-mil thick
 - AA-C22A42.....Chemically etched medium matte, with integrally colored anodic coating, Class I Architectural, 0.7 mils thick

- AA-C22A44.....Chemically etched medium matte with
electrolytically deposited metallic compound,
integrally colored coating Class I
Architectural, 0.7-mil thick finish
- D. American Architectural Manufacturers Association (AAMA):
- AAMA 620.....Voluntary Specification for High Performance
Organic Coatings on Coil Coated Architectural
Aluminum
- AAMA 621.....Voluntary Specification for High Performance
Organic Coatings on Coil Coated Architectural
Hot Dipped Galvanized (HDG) and Zinc-Aluminum
Coated Steel Substrates
- E. ASTM International (ASTM):
- A167-99(R2009).....Stainless and Heat-Resisting Chromium-Nickel
Steel Plate, Sheet, and Strip
- A653/A653M-09.....Steel Sheet Zinc-Coated (Galvanized) or Zinc
Alloy Coated (Galvanized) by the Hot- Dip
Process
- B32-08.....Solder Metal
- B209-07.....Aluminum and Aluminum-Alloy Sheet and Plate
- B370-09.....Copper Sheet and Strip for Building
Construction
- D173-03.....Bitumen-Saturated Cotton Fabrics Used in
Roofing and Waterproofing
- D412-06.....Vulcanized Rubber and Thermoplastic Elastomers-
Tension
- D1187-97(R2002).....Asphalt Base Emulsions for Use as Protective
Coatings for Metal
- D1784-08.....Rigid Poly (Vinyl Chloride) (PVC) Compounds and
Chlorinated Poly (Vinyl Chloride) (CPVC)
Compounds
- D4586-07.....Asphalt Roof Cement, Asbestos Free
- F. Sheet Metal and Air Conditioning Contractors National Association
(SMACNA): Architectural Sheet Metal Manual.
- G. National Association of Architectural Metal Manufacturers (NAAMM):
- AMP 500-06.....Metal Finishes Manual
- H. Federal Specification (Fed. Spec):
- A-A-1925A.....Shield, Expansion; (Nail Anchors)

UU-B-790A.....Building Paper, Vegetable Fiber
 I. International Code Commission (ICC): International Building Code,
 Current Edition

1.4 PERFORMANCE REQUIREMENTS

- A. Wind Uplift Forces: Resist the following forces per FM Approvals 1-49:
 - 1. Wind Zone 1: 1.00 to 1.44 kPa (21 to 30 lbf/sq. ft.): 2.87-kPa (60-lbf/sq. ft.) perimeter uplift force, 4.31-kPa (90-lbf/sq. ft.) corner uplift force, and 1.44-kPa (30-lbf/sq. ft.) outward force.
- B. Wind Design Standard: Fabricate and install copings, roof-edge flashings tested per ANSI/SPRI ES-1 to resist design pressure indicated on Drawings.

1.5 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Shop Drawings: For all specified items, including:
 - 1. Flashings
 - 2. Copings
 - 3. Fascia-cant
- C. Manufacturer's Literature and Data: For all specified items, including:
 - 1. Two-piece counterflashing
 - 2. Thru wall flashing
 - 3. Nonreinforced, elastomeric sheeting
 - 4. Copper clad stainless steel
 - 5. Polyethylene coated copper
 - 6. Bituminous coated copper
 - 7. Copper covered paper
 - 8. Fascia-cant
- D. Certificates: Indicating compliance with specified finishing requirements, from applicator and contractor.

PART 2 - PRODUCTS

2.1 FLASHING AND SHEET METAL MATERIALS

- A. Stainless Steel: ASTM A167, Type 302B, dead soft temper.
- B. Copper ASTM B370, cold-rolled temper.
- C. Bituminous Coated Copper: Minimum copper ASTM B370, weight not less than 1 kg/m² (3 oz/sf). Bituminous coating shall weigh not less than 2 kg/m² (6 oz/sf); or, copper sheets may be bonded between two layers of coarsely woven bitumen-saturated cotton fabric ASTM D173. Exposed fabric surface shall be crimped.
- D. Copper Covered Paper: Fabricated of electro-deposit pure copper sheets ASTM B 370, bonded with special asphalt compound to both sides of creped, reinforced building paper, UU-B-790, Type I, style 5, or to a three ply sheet of asphalt impregnated creped paper. Grooves running along the width of sheet.
- E. Polyethylene Coated Copper: Copper sheet ASTM B370, weighing 1 Kg/m² (3 oz/sf) bonded between two layers of (two mil) thick polyethylene sheet.
- F. Aluminum Sheet: ASTM B209, alloy 3003-H14.
- G. Galvanized Sheet: ASTM, A653.
- H. Nonreinforced, Elastomeric Sheeting: Elastomeric substances reduced to thermoplastic state and extruded into continuous homogenous sheet (0.056 inch) thick. Sheeting shall have not less than 7 MPa (1,000 psi) tensile strength and not more than seven percent tension-set at 50 percent elongation when tested in accordance with ASTM D412. Sheeting shall show no cracking or flaking when bent through 180 degrees over a 1 mm (1/32 inch) diameter mandrel and then bent at same point over same size mandrel in opposite direction through 360 degrees at temperature of -30°C (-20 °F).

2.2 FLASHING ACCESSORIES

- A. Solder: ASTM B32; flux type and alloy composition as required for use with metals to be soldered.
- B. Rosin Paper: Fed-Spec. UU-B-790, Type I, Grade D, Style 1b, Rosin-sized sheathing paper, weighing approximately 3 Kg/10 m² (6 lbs/100 sf).
- C. Bituminous Paint: ASTM D1187, Type I.
- D. Fasteners:
 - 1. Use copper, copper alloy, bronze, brass, or stainless steel for copper and copper clad stainless steel, and stainless steel for

stainless steel and aluminum alloy. Use galvanized steel or stainless steel for galvanized steel.

2. Nails:
 - a. Minimum diameter for copper nails: 3 mm (0.109 inch).
 - b. Minimum diameter for aluminum nails 3 mm (0.105 inch).
 - c. Minimum diameter for stainless steel nails: 2 mm (0.095 inch) and annular threaded.
 - d. Length to provide not less than 22 mm (7/8 inch) penetration into anchorage.
3. Rivets: Not less than 3 mm (1/8 inch) diameter.
4. Expansion Shields: Fed Spec A-A-1925A.
- E. Sealant: As specified in Section 07 92 00, JOINT SEALANTS for exterior locations.
- F. Insect Screening: ASTM D3656, 18 by 18 regular mesh.
- G. Roof Cement: ASTM D4586.

2.3 SHEET METAL THICKNESS

- A. Except as otherwise shown or specified use thickness or weight of sheet metal as follows:
- B. Concealed Locations (Built into Construction):
 1. Copper: 30g (10 oz) minimum 0.33 mm (0.013 inch thick).
 2. Stainless steel: 0.25 mm (0.010 inch) thick.
 3. Copper clad stainless steel: 0.25 mm (0.010 inch) thick.
 4. Galvanized steel: 0.5 mm (0.021 inch) thick.
- C. Exposed Locations:
 1. Copper: 0.4 Kg (16 oz).
 2. Stainless steel: 0.4 mm (0.015 inch).
 3. Copper clad stainless steel: 0.4 mm (0.015 inch).
- D. Thickness of aluminum or galvanized steel is specified with each item.

2.4 FABRICATION, GENERAL

- A. Jointing:
 1. Joints shall conform to following requirements:
 - a. Flat-lock joints shall finish not less than 19 mm (3/4 inch) wide.
 - b. Lap joints subject to stress shall finish not less than 25 mm (one inch) wide and shall be soldered and riveted.
 - c. Unsoldered lap joints shall finish not less than 100 mm (4 inches) wide.

2. Edges of bituminous coated copper, copper covered paper, nonreinforced elastomeric sheeting and polyethylene coated copper shall be jointed by lapping not less than 100 mm (4 inches) in the direction of flow and cementing with asphalt roof cement or sealant as required by the manufacturer's printed instructions.
- B. Expansion and Contraction Joints:
1. Fabricate in accordance with the Architectural Sheet Metal Manual recommendations for expansion and contraction of sheet metal work in continuous runs.
 2. Space joints as shown or as specified.
 3. Space expansion and contraction joints for aluminum at intervals not exceeding 5400 mm (18 feet), except do not exceed 3000 mm (10 feet) for gravel stops and fascia-cant systems.
 4. Fabricate slip-type or loose locked joints and fill with sealant unless otherwise specified.
 5. Fabricate joint covers of same thickness material as sheet metal served.
- C. Cleats:
1. Fabricate cleats to secure flashings and sheet metal work over 300 mm (12 inches) wide and where specified.
 2. Provide cleats for maximum spacing of 300 mm (12 inch) centers unless specified otherwise.
 3. Form cleats of same metal and weights or thickness as the sheet metal being installed unless specified otherwise.
 4. Fabricate cleats from 50 mm (2 inch) wide strip. Form end with not less than 19 mm (3/4 inch) wide loose lock to item for anchorage. Form other end of length to receive nails free of item to be anchored and end edge to be folded over and cover nail heads.
- D. Edge Strips or Continuous Cleats:
1. Fabricate continuous edge strips where shown and specified to secure loose edges of the sheet metal work.
 2. Except as otherwise specified, fabricate edge strips or minimum 0.6 Kg (24 ounce) copper.
 3. Use material compatible with sheet metal to be secured by the edge strip.
 4. Fabricate in 3000 mm (10 feet) maximum lengths with not less than 19 mm (3/4 inch) loose lock into metal secured by edge strip.

5. Fabricate Strips for fascia anchorage to extend below the supporting wood construction to form a drip and to allow the flashing to be hooked over the lower edge at least 19 mm (3/4-inch).
 6. Fabricate anchor edge maximum width of 75 mm (3 inches) or of sufficient width to provide adequate bearing area to insure a rigid installation using 1 Kg (32 oz) copper.
- E. Drips:
1. Form drips at lower edge of sheet metal counter-flashings (cap flashings), fascias, gravel stops, wall copings, by folding edge back 13 mm (1/2 inch) and bending out 45 degrees from vertical to carry water away from the wall.
 2. Form drip to provide hook to engage cleat or edge strip for fastening for not less than 19 mm (3/4 inch) loose lock where shown.
- F. Edges:
1. Edges of flashings concealed in masonry joints opposite drain side shall be turned up 6 mm (1/4 inch) to form dam, unless otherwise specified or shown otherwise.
 2. Finish exposed edges of flashing with a 6 mm (1/4 inch) hem formed by folding edge of flashing back on itself when not hooked to edge strip or cleat. Use 6 mm (1/4 inch) minimum penetration beyond wall face with drip for through-wall flashing exposed edge.
 3. All metal roof edges shall meet requirements of IBC, current edition.
- G. Metal Options:
1. Where options are permitted for different metals use only one metal throughout.
 2. Stainless steel may be used in concealed locations for fasteners of other metals exposed to view.
 3. Where copper gravel stops, copings and flashings will carry water onto cast stone, stone, or architectural concrete, or stainless steel.

2.5 FINISHES

- A. Use same finish on adjacent metal or components and exposed metal surfaces unless specified or shown otherwise.
- B. In accordance with NAAMM Metal Finishes Manual AMP 500, unless otherwise specified.
- C. Finish exposed metal surfaces as follows, unless specified otherwise:

1. Aluminum:
 - a. Clear Finish: AA-C22A41 medium matte, clear anodic coating, Class 1 Architectural, 18 mm (0.7 mils) thick.
 - b. Colored Finish: AA-C22A42 (anodized) or AA-C22A44 (electrolytically deposited metallic compound) medium matte, integrally colored coating, Class 1 Architectural, 18 mm (0.7 mils) thick. Dyes will not be accepted.
 - c. Fluorocarbon Finish: AAMA 620, high performance organic coating.
 - d. Mill finish.
2. Steel and Galvanized Steel:
 - a. Finish painted under Section 09 91 00, PAINTING unless specified as prefinished item.
 - b. Manufacturer's finish:
 - 1) Baked on prime coat over a phosphate coating.
 - 2) Baked-on prime and finish coat over a phosphate coating.
 - 3) Fluorocarbon Finish: AAMA 621, high performance organic coating.

2.6 THROUGH-WALL FLASHINGS

- A. Form through-wall flashing to provide a mechanical bond or key against lateral movement in all directions. Install a sheet having 2 mm (1/16 inch) deep transverse channels spaced four to every 25 mm (one inch), or ribbed diagonal pattern, or having other deformation unless specified otherwise.
 1. Fabricate in not less than 2400 mm (8 feet) lengths; 3000 mm (10 feet) maximum lengths.
 2. Fabricate so keying nests at overlaps.
- B. For Masonry Work When Concealed Except for Drip:
 1. Either copper, stainless steel, or copper clad stainless steel.
 2. Form an integral dam at least 5 mm (3/16 inch) high at back edge.
 3. Form exposed portions of flashing with drip, approximately 6 mm (1/4 inch) projection beyond wall face.
- C. For Masonry Work When Exposed Edge Forms a Receiver for Counter Flashing:
 1. Use same metal and thickness as counter flashing.
 2. Form an integral dam at least 5 mm (3/16 inch) high at back edge.
 3. Form exposed portion as snap lock receiver for counter flashing upper edge.

D. Window Sill Flashing and Lintel Flashing:

1. Use either copper, stainless steel, copper clad stainless steel plane flat sheet, or nonreinforced elastomeric sheeting, bituminous coated copper, copper covered paper, or polyethylene coated copper.
2. Fabricate flashing at ends with folded corners to turn up 5 mm (3/16 inch) in first vertical masonry joint beyond masonry opening.
3. Turn up back edge as shown.
4. Form exposed portion with drip as specified or receiver.

E. Door Sill Flashing:

1. Where concealed, use either 0.5 Kg (20 oz) copper, 0.5 mm (0.018 inch) thick stainless steel, or 0.5 mm (0.018 inch) thick copper clad stainless steel.
2. Where shown on drawings as combined counter flashing under threshold, sill plate, door sill, or where subject to foot traffic, use either 0.6 Kg (24 ounce) copper, 0.6 mm (0.024 inch) stainless steel, or 0.6 mm (0.024 inch) thick stainless steel.
3. Fabricate flashing at ends to turn up 5 mm (3/16 inch) in first vertical masonry joint beyond masonry opening with folded corners.

2.7 BASE FLASHING

- A. Use metal base flashing at vertical surfaces intersecting built-up roofing without cant strips or where shown.
 1. Use either copper, or stainless steel, thickness specified unless specified otherwise.
 2. When flashing is over 250 mm (10 inches) in vertical height or horizontal width use either 0.5 Kg (20 oz) copper or 0.5 mm (0.018 inch) stainless steel.
 3. Use stainless steel at aluminum roof curbs where flashing contacts the aluminum.
 4. Use either copper, or stainless steel at pipe flashings.
- B. Fabricate metal base flashing up vertical surfaces not less than 200 mm (8 inch) nor more than 400 mm (16 inch).
- C. Fabricate roof flange not less than 100 mm (4 inches) wide unless shown otherwise. When base flashing length exceeds 2400 mm (8 feet) form flange edge with 13 mm (1/2 inch) hem to receive cleats.
- D. Form base flashing bent from strip except pipe flashing. Fabricate ends for riveted soldered lap seam joints. Fabricate expansion joint ends as specified.

- E. Pipe Flashing: (Other than engine exhaust or flue stack)
 - 1. Fabricate roof flange not less than 100 mm (4 inches) beyond sleeve on all sides.
 - 2. Extend sleeve up and around pipe and flange out at bottom not less than 13 mm (1/2 inch) and solder to flange and sleeve seam to make watertight.
 - 3. At low pipes 200 mm (8 inch) to 450 mm (18 inch) above roof:
 - a. Form top of sleeve to turn down into the pipe at least 25 mm (one inch).
 - b. Allow for loose fit around and into the pipe.
 - 4. At high pipes and pipes with goosenecks or other obstructions which would prevent turning the flashing down into the pipe:
 - a. Extend sleeve up not less than 300 mm (12 inch) above roofing.
 - b. Allow for loose fit around pipe.

2.8 COUNTERFLASHING (CAP FLASHING OR HOODS)

- A. Either copper or stainless steel, unless specified otherwise.
- B. Fabricate to lap base flashing a minimum of 100 mm (4 inches) with drip:
 - 1. Form lock seams for outside corners. Allow for lap joints at ends and inside corners.
 - 2. In general, form flashing in lengths not less than 2400 mm (8 feet) and not more than 3000 mm (10 feet).
 - 3. Two-piece, lock in type flashing may be used in-lieu-of one piece counter-flashing.
 - 4. Manufactured assemblies may be used.
 - 5. Where counterflashing is installed at new work use an integral flange at the top designed to be extended into the masonry joint or reglet in concrete.
 - 6. Where counterflashing is installed at existing work use surface applied type, formed to provide a space for the application of sealant at the top edge.
- C. One-piece Counterflashing:
 - 1. Back edge turned up and fabricate to lock into reglet in concrete.
 - 2. Upper edge formed to extend full depth of masonry unit in mortar joint with back edge turned up 6 mm (1/4 inch).
- D. Two-Piece Counterflashing:

1. Receiver to extend into masonry wall depth of masonry unit with back edge turned up 6 mm (1/4 inch) and exposed edge designed to receive and lock counterflashing upper edge when inserted.
 2. Counterflashing upper edge designed to snap lock into receiver.
- E. Pipe Counterflashing:
1. Form flashing for water-tight umbrella with upper portion against pipe to receive a draw band and upper edge to form a "V" joint sealant receiver approximately 19 mm (3/4 inch) deep.
 2. Fabricate 100 mm (4 inch) over lap at end.
 3. Fabricate draw band of same metal as counter flashing. Use 0.6 Kg (24 oz) copper or 0.33 mm (0.013 inch) thick stainless steel or copper coated stainless steel.
 4. Use stainless steel bolt on draw band tightening assembly.
 5. Vent pipe counter flashing may be fabricated to omit draw band and turn down 25 mm (one inch) inside vent pipe.
- F. Where vented edge decks intersect vertical surfaces, form in one piece, shape to slope down to a point level with and in front of edge-set notched plank; then, down vertically, overlapping base flashing.

2.9 GRAVEL STOPS

A. General:

1. Fabricate in lengths not less than 2400 mm (8 feet) long and maximum of 3000 mm (10 feet).
2. Fabricate internal and external corners as one-piece with legs not less than 600 mm (2 feet) or more than 1200 mm (4 feet) long.
3. Fabricate roof flange not less than 100 mm (4 inches) wide.
4. Fabricate top edge to extend above roof not less than 25 mm (one inch) for embedded gravel aggregate and not less than 100 mm (4 inches) for loose laid ballast.
5. Fabricate lower edge outward at an angle of 45 degrees to form drip and as fascia or as counter flashing as shown:
 - a. Fabricate of one-piece material of suitable width for fascia height of 250 mm (10 inch) maximum or counterflashing lap of not less than 100 mm (4 inch) over base flashing.
 - b. Fabricate bottom edge of formed fascia to receive edge strip.
 - c. When fascia bottom edge forms counter flashing over roofing lap roofing not less than 150 mm (6 inches).

B. Formed Flat Sheet Metal Gravel Stops and Fascia:

1. Fabricate as shown of 1.25 mm (0.050 inch) thick aluminum.
2. When fascia exceeds 150 mm (6 inches) in depth, form one or more horizontal stops not less than 13 mm (1/2 inch) high in the fascia.
3. Fabricate as two-piece fascia when fascia depth exceeds 250 mm (10 inches).
4. At joint between ends of sheets, provide a concealed clip soldered or welded near one end of each sheet to hold the adjoining sheet in lapped position. The clip shall be approximately 100 mm (4 inches) wide and shall be the full depth of the fascia less 25 mm (one inch) at top and bottom. Clip shall be of the same thickness as the fascia.
5. Provide edge strip as specified with lower hooked edge bent outward at an angle of 45 degrees.

2.10 BITUMEN STOPS

- A. Fabricate bitumen stops for bituminous roofing edges for use with formed sheet metal gravel stops, pipe penetrations, and other penetrations through roof deck without a curb.
- B. Fabricate with 19 mm (3/4 inch) vertical legs and 75 mm (3 inch) horizontal legs.
- C. When used with gravel stop or metal base flashing use same metal for bitumen stop in thickness specified for concealed locations.

2.11 REGLETS

- A. Fabricate reglets of one of the following materials:
 1. 0.4 Kg (16 ounce) copper.
 2. Stainless steel, not less than 0.3 mm (0.012 inch) thick.
 3. Plastic coated extruded aluminum, not less than 1.4 mm (0.055 inch) thick prefilled with butyl rubber sealer and complete with plastic wedges inserted at 1000 mm (40 inches) on centers.
 4. Plastic, ASTM D1784, Type II, not less than 2 mm (0.075 inch) thick.
- B. Fill open-type reglets with fiberboard or other suitable separator, to prevent crushing of the slot during installation.
- C. Bend edges of reglets for setting into concrete to an angle of not less than 45 degrees, and make wide enough to provide firm anchorage in the concrete.
- D. Fabricate reglets for building into horizontal masonry mortar joints not less than 19 mm (3/4 inch) deep, nor more than 25 mm (one inch) deep.

- E. Fabricate mitered corners, fittings, and special shapes as may be required by details.
- F. Reglets for concrete may be formed to receive flashing and have a 10 mm (3/8 inch), 45 degree snap lock.

2.12 INSULATED EXPANSION JOINT COVERS

- A. Types:
 - 1. Constructed of a 2 mm (1/16 inch) thick vinyl sheet, flanged at both sides with stainless steel strips not less than 0.4 mm (0.015 inch) thick. Vinyl sheet locked and encased by the stainless steel strip and prepunched for nailing. A 10 mm (3/8 inch) thick closed cell polyvinyl chloride foam insulating strip shall be heat laminated to the underside of the vinyl sheet between the stainless steel strips.
- B. Expansion joint covers shall have factory fabricated mitered corners, crossing tees, and other necessary accessories. Furnish in the longest available lengths.
- C. Metal flange of sufficient width to extend over the top of the curb and down curb sides 50 mm (2 inches) with hemmed edge for lock to edge strip.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. General:
 - 1. Install flashing and sheet metal items as shown in Sheet Metal and Air Conditioning Contractors National Association, Inc., publication, ARCHITECTURAL SHEET METAL MANUAL, except as otherwise shown or specified.
 - 2. Apply Sealant as specified in Section 07 92 00, JOINT SEALANTS.
 - 3. Apply sheet metal and other flashing material to surfaces which are smooth, sound, clean, dry and free from defects that might affect the application.
 - 4. Remove projections which would puncture the materials and fill holes and depressions with material compatible with the substrate. Cover holes or cracks in wood wider than 6 mm (1/4 inch) with sheet metal compatible with the roofing and flashing material used.
 - 5. Coordinate with masonry work for the application of a skim coat of mortar to surfaces of unit masonry to receive flashing material before the application of flashing.

6. Apply a layer of 7 Kg (15 pound) saturated felt followed by a layer of rosin paper to wood surfaces to be covered with copper. Lap each ply 50 mm (2 inch) with the slope and nail with large headed copper nails.
7. Confine direct nailing of sheet metal to strips 300 mm (12 inch) or less wide. Nail flashing along one edge only. Space nail not over 100 mm (4 inches) on center unless specified otherwise.
8. Install bolts, rivets, and screws where indicated, specified, or required in accordance with the SMACNA Sheet Metal Manual. Space rivets at 75 mm (3 inch) on centers in two rows in a staggered position. Use neoprene washers under fastener heads when fastener head is exposed.
9. Coordinate with roofing work for the installation of metal base flashings and other metal items having roof flanges for anchorage and watertight installation.
10. Nail continuous cleats on 75 mm (3 inch) on centers in two rows in a staggered position.
11. Nail individual cleats with two nails and bend end tab over nail heads. Lock other end of cleat into hemmed edge.
12. Install flashings in conjunction with other trades so that flashings are inserted in other materials and joined together to provide a water tight installation.
13. Where required to prevent galvanic action between dissimilar metal isolate the contact areas of dissimilar metal with sheet lead, waterproof building paper, or a coat of bituminous paint.
14. Isolate aluminum in contact with dissimilar metals others than stainless steel, white bronze or other metal compatible with aluminum by:
 - a. Paint dissimilar metal with a prime coat of zinc-chromate or other suitable primer, followed by two coats of aluminum paint.
 - b. Paint dissimilar metal with a coat of bituminous paint.
 - c. Apply an approved caulking material between aluminum and dissimilar metal.
15. Paint aluminum in contact with or built into mortar, concrete, plaster, or other masonry materials with a coat of bituminous paint.
16. Paint aluminum in contact with absorptive materials that may become repeatedly wet with two coats of bituminous paint or two coats of aluminum paint.

17. Bitumen Stops:

- a. Install bitumen stops for built-up roof opening penetrations through deck and at formed sheet metal gravel stops.
- b. Nail leg of bitumen stop at 300 mm (12 inch) intervals to nailing strip at roof edge before roofing material is installed.

3.2 THROUGH-WALL FLASHING

A. General:

1. Install continuous through-wall flashing between top of concrete foundation walls and bottom of masonry building walls; at top of concrete floors; under masonry, concrete, or stone copings and elsewhere as shown.
2. Where exposed portions are used as a counterflashings, lap base flashings at least 100 mm (4 inches) and use thickness of metal as specified for exposed locations.
3. Exposed edge of flashing may be formed as a receiver for two piece counter flashing as specified.
4. Terminate exterior edge beyond face of wall approximately 6 mm (1/4 inch) with drip edge where not part of counter flashing.
5. Turn back edge up 6 mm (1/4 inch) unless noted otherwise where flashing terminates in mortar joint or hollow masonry unit joint.
6. Terminate interior raised edge in masonry backup unit approximately 38 mm (1 1/2 inch) into unit unless shown otherwise.
7. Under copings terminate both edges beyond face of wall approximately 6 mm (1/4 inch) with drip edge.
8. Lap end joints at least two corrugations, but not less than 100 mm (4 inches). Seal laps with sealant.
9. Where dowels, reinforcing bars and fastening devices penetrate flashing, seal penetration with sealing compound. Sealing compound is specified in Section 07 92 00, JOINT SEALANTS.
10. Coordinate with other work to set in a bed of mortar above and below flashing so that total thickness of the two layers of mortar and flashing are same as regular mortar joint.
11. Where ends of flashing terminate turn ends up 25 mm (1 inch) and fold corners to form dam extending to wall face in vertical mortar or veneer joint.
12. Turn flashing up not less than 200 mm (8 inch) between masonry or behind exterior veneer.

13. When flashing terminates in reglet extend flashing full depth into reglet and secure with lead or plastic wedges spaced 150 mm (6 inch) on center.
14. Continue flashing around columns:
 - a. Where flashing cannot be inserted in column reglet hold flashing vertical leg against column.
 - b. Counterflash top edge with 75 mm (3 inch) wide strip of saturated cotton unless shown otherwise. Secure cotton strip with roof cement to column. Lap base flashing with cotton strip 38 mm (1 1/2 inch).
- B. Flashing at Top of Concrete Foundation Walls Where concrete is exposed. Turn up not less than 200 mm (8 inch) high and into masonry backup mortar joint or reglet in concrete backup as specified.
- C. Flashing at Top of Concrete Floors (except where shelf angles occur): Place flashing in horizontal masonry joint not less than 200 mm (8 inch) below floor slab and extend into backup masonry joint at floor slab 38 mm (1 1/2 inch).
- D. Flashing at Cavity Wall Construction: Where flashing occurs in cavity walls turn vertical portion up against backup under waterproofing, if any, into mortar joint. Turn up over insulation, if any, and horizontally through insulation into mortar joint.
- E. Flashing at Veneer Walls:
 1. Install near line of finish floors over shelf angles or where shown.
 2. Turn up against sheathing.
 3. At stud framing, hem top edge 19 mm (3/4 inch) and secure to each stud with stainless steel fasteners through sheathing.
 4. At concrete backing, extend flashing into reglet as specified.
 5. Coordinate with installation of waterproofing or asphalt felt for lap over top of flashing.
- F. Lintel Flashing when not part of shelf angle flashing:
 1. Install flashing full length of lintel to nearest vertical joint in masonry over veneer.
 2. Turn ends up 25 mm (one inch) and fold corners to form dam and extend end to face of wall.
 3. Turn back edge up to top of lintel; terminate back edge as specified for back-up wall.
- G. Window Sill Flashing:

1. Install flashing to extend not less than 100 mm (4 inch) beyond ends of sill into vertical joint of masonry or veneer.
 2. Turn back edge up to terminate under window frame.
 3. Turn ends up 25 mm (one inch) and fold corners to form dam and extend to face of wall.
- H. Flashing at Masonry, Stone, or Precast Concrete Copings:
1. Install flashing with drips on both wall faces unless shown otherwise.
 2. Form penetration openings to fit tight against dowel or other item with edge turned up. Seal penetrations with sealant.

3.3 BASE FLASHING

- A. Install where roof membrane type base flashing is not used and where shown.
1. Install flashing at intersections of roofs with vertical surfaces or at penetrations through roofs, to provide watertight construction.
 2. Install metal flashings and accessories having flanges extending out on top of the built-up roofing before final bituminous coat and roof aggregate is applied.
 3. Set flanges in heavy trowel coat of roof cement and nail through flanges into wood nailers over bituminous roofing.
 4. Secure flange by nailing through roofing into wood blocking with nails spaced 75 mm (3 inch) on centers or, when flange over 100 mm (4 inch) wide terminate in a 13 mm (1/2 inch) folded edge anchored with cleats spaced 200 mm (8 inch) on center. Secure one end of cleat over nail heads. Lock other end into the seam.
- B. For long runs of base flashings install in lengths of not less than 2400 mm (8 feet) nor more than 3000 mm (ten feet). Install a 75 mm (3 inch) wide slip type, loose lock expansion joint filled with sealant in joints of base flashing sections over 2400 mm (8 feet) in length. Lock and solder corner joints at corners.
- C. Extend base flashing up under counter flashing of roof specialties and accessories or equipment not less than 75 mm (3 inch).

3.4 COUNTERFLASHING (CAP FLASHING OR HOODS)

- A. General:
1. Install counterflashing over and in conjunction with installation of base flashings, except as otherwise specified or shown.

2. Install counterflashing to lap base flashings not less than 100 mm (4 inch).
 3. Install upper edge or top of counterflashing not less than 225 mm (9 inch) above top of the roofing.
 4. Lap joints not less than 100 mm (4 inch). Stagger joints with relation to metal base flashing joints.
 5. Use surface applied counterflashing on existing surfaces and new work where not possible to integrate into item.
 6. When fastening to concrete or masonry, use screws driven in expansion shields set in concrete or masonry. Use screws to wood and sheet metal. Set fasteners in mortar joints of masonry work.
- B. One Piece Counterflashing:
1. Where flashing is installed at new masonry, coordinate to insure proper height, embed in mortar, and end lap.
 2. Where flashing is installed in reglet in concrete insert upper edge into reglet. Hold flashing in place with lead wedges spaced not more than 200 mm (8 inch) apart. Fill joint with sealant.
 3. Where flashing is surface mounted on flat surfaces.
 - a. When top edge is double folded anchor flat portion below sealant "V" joint with fasteners spaced not over 400 mm (16 inch) on center:
 - 1) Locate fasteners in masonry mortar joints.
 - 2) Use screws to sheet metal or wood.
 - b. Fill joint at top with sealant.
 4. Where flashing or hood is mounted on pipe.
 - a. Secure with draw band tight against pipe.
 - b. Set hood and secure to pipe with a one by 25 mm x 3 mm (1 x 1/8 inch) bolt on stainless steel draw band type clamp, or a stainless worm gear type clamp.
 - c. Completely fill joint at top with sealant.
- C. Two-Piece Counterflashing:
1. Where receiver is installed at new masonry coordinate to insure proper height, embed in mortar, and lap.
 2. Surface applied type receiver:
 - a. Secure to face construction in accordance, with manufacturers instructions.
 - b. Completely fill space at the top edge of receiver with sealant.

- 3. Insert counter flashing in receiver in accordance with fabricator or manufacturer's instructions and to fit tight against base flashing.
- D. Where vented edge occur install so lower edge of counterflashing is against base flashing.
- E. When counter flashing is a component of other flashing install as shown.

3.5 REGLETS

- A. Install reglets in a manner to provide a watertight installation.
- B. Locate reglets not less than 225 mm (9 inch) nor more than 400 mm (16 inch) above roofing, and not less than 125 mm (5 inch) nor more than 325 mm (13 inch) above cant strip.
- C. Butt and align end joints on each section of reglet and securely hold in position until concrete or mortar are hardened:
 - 1. Coordinate reglets for anchorage into concrete with formwork construction.
 - 2. Coordinate reglets for masonry to locate horizontally into mortar joints.

3.6 GRAVEL STOPS

- A. General:
 - 1. Install gravel stops and fascias with allowance for expansion at each joint; minimum of 6 mm (1/4 inch).
 - 2. Extend roof flange of gravel stop and splice plates not less than four inches out over roofing and nail or screw to wood nailers. Space fasteners on 75 mm (3 inch) centers in staggered pattern.
 - 3. Install continuous cleat for fascia drip edge. Secure with fasteners as close to lower edge as possible on 75 mm (3 inch) centers.
 - 4. Where ends of gravel stops and fascias abut a vertical wall, provide a watertight, flashed and sealant filled joint.
 - 5. Set flange in roof cement when installed over built-up roofing.
 - 6. Edge securement for low-slope roofs: Low-slope membrane roof systems metal edge securement, except gutters, shall be designed in accordance with ANSI/SPRI ES-1, except the basic wind speed shall be determined from Figure 1609, of IBC 2003.
- B. Sheet metal gravel stops and fascia:
 - 1. Install with end joints of splice plates sheets lapped three inches.
 - 2. Hook the lower edge of fascia into a continuous edge strip.
 - 3. Lock top section to bottom section for two piece fascia.

C. Corrugated sheet gravel stops and fascia:

1. Install 300 mm (12 inch) wide sheet flashing centered under joint. A combination bottom and cover plate, extending above and beneath the joint, may be used.
2. Hook lower edge of fascia into a continuous edge strip.

3.7 COPINGS

A. General:

1. On walls topped with a wood plank, install a continuous edge strip on the front and rear edge of the plank. Lock the coping to the edge strip with a 19 mm (3/4 inch) loose lock seam.
2. Where shown turn down roof side of coping and extend down over base flashing as specified for counter-flashing. Secure counter-flashing to lock strip in coping at continuous cleat.
3. Install ends adjoining existing construction so as to form space for installation of sealants. Sealant is specified in Section 07 92 00, JOINT SEALANTS.

B. Aluminum Coping:

1. Install with 6 mm (1/4 inch) joint between ends of coping sections.
2. Install joint covers, centered at each joint, and securely lock in place.

3.8 EXPANSION JOINT COVERS, INSULATED

- A. Install insulated expansion joint covers at locations shown on curbs not less than 200 mm (8 inch) high above roof surface.
- B. Install continuous edge strips of same metal as expansion joint flange, nailed at not less than 75 mm (3 inch) centers.
- C. Install insulated expansion joint covers in accordance with manufacturer's directions locking edges to edge strips.

3.9 GOOSENECK ROOF VENTILATORS

- A. Install on structural curb not less than 200 mm (8 inch) high above roof surface.
- B. Securely anchor ventilator curb to structural curb with fasteners spaced not over 300 mm (12 inch) on center.
- C. Anchor gooseneck to curb with screws having nonprene washers at 150 mm (6 inch) on center.

- - - E N D - - -

**SECTION 07 71 00
ROOF SPECIALTIES**

PART 1 - GENERAL

1.1 DESCRIPTION

This section specifies roof hatches and equipment supports.

1.2 RELATED WORK

- A. Color and texture of finish: Section 09 06 00, SCHEDULE FOR FINISHES.
Sealant material and installation: Section 07 92 00, JOINT SEALANTS.
- B. General insulation: Section 07 21 13, THERMAL INSULATION. Rigid insulations for roofing: Section 07 22 00, ROOF AND DECK INSULATION

1.3 QUALITY CONTROL

- A. All roof accessories shall be the products of manufacturers regularly engaged in producing the kinds of products specified.
- B. Each accessory type shall be the same and be made by the same manufacturer.
- C. Each accessory shall be completely assembled to the greatest extent possible before delivery to the site.

1.4 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Shop Drawings: Each item specified showing design, details of construction, installation and fastenings.
- C. Manufacturer's Literature and Data: Each item specified.

1.5 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extend referenced. The publications are referenced in the text by the basic designation only.
- B. American Society for Testing and Material (ASTM):
 - A653/A653M-02.....Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy-Coated (Galvannealed) By the Hot-Dip Process
 - B209/209M-02.....Aluminum and Aluminum Alloy-Sheet and Plate
 - B221/221M-02.....Aluminum-Alloy Extruded Bars, Rods, Wire, Shapes, and Tubes
 - D1187-97.....Asphalt-Base Emulsions for Use as Protective Coatings for Metal
- C. National Association of Architectural Metal Manufacturers (NAAMM):

- AMP 500 Series.....Metal Finishes Manual
- D. American Architectural Manufacturers Association (AAMA):
- 605-98.....High Performance Organic Coatings on
- Architectural Extrusions and Panels.

PART 2 - PRODUCTS

2.1 DESCRIPTION

- A. Prefabricated roof hatch, 36 inches x 30 inches with integrally insulated curb and hatch door. Provide a telescoping tubular safety post that locks automatically when fully extended.

2.2 MATERIALS

- A. Galvanized Sheet Steel: ASTM A526/A526M; G-90 coating.

2.3 ROOF HATCH (SCUTTLE)

- A. Fabricate from galvanized steel.
- B. Curb and Cover:
1. Exterior facing: Minimum 14 GA Galv thick sheet steel.
 2. Minimum of 25 mm (one inch) thick mineral fiber insulation between facings of cover and over exterior face of curb.
 3. Form exterior curb facing with an integral three inch wide roof flange and cap flashing minimum 2.3 mm (0.09 inch) thick sheet aluminum.
 4. Make curb 300 mm (12 inches).
 5. Form cover to lap curb and cap flashing.
- C. Hardware:
1. Provide spring snap latch with inside and outside operating handles and padlock hasp on inside.
 2. Provide pintle hinges.
 3. Provide automatic hold open and operating arm with enclosed torsion or compression spring lifting mechanism.
 4. Covers shall automatically lock in the open position at not less than 70 degrees.
 5. Provide weatherstripping at cover closure.
 6. Galvanize all hardware items.
- D. Assembly:
1. Completely shop assemble roof hatch (scuttle).
 2. Fully weld all joints exposed to the weather and built into the roofing.
 3. Finish weld smooth where exposed.

4. Operation with minimum force to open and close.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Install roof specialties where shown.
- B. Secure with fasteners in accordance with manufacture's printed installation instructions and approved shop drawings unless shown otherwise.
- C. Coordinate to install insulation where shown; see Section 07 21 13, THERMAL INSULATION and Section 07 22 00, ROOF AND DECK INSULATION.
- D. Comply with section 07 92 00, JOINT SEALANTS to install sealants where manufactures installation instructions require sealant.
- E. Coordinate with roofing work for installation of items in sequence to prevent water infiltration.
 - b. After completion of base flashing bend down cap flashing flange and secure to blocking with screws.
 - c. Install expansion joint cover with 6 mm (1/4 inch) wide space at end joints and tension bars at 600 mm (24 inches) on center.
 - d. Install cover plates with formed flashing concealed and centered on joint. Flashing to lap cover not less than 100 mm (4 inches).

3.2 ADJUSTING

- A. Adjust roof hatch hardware to operate freely and so that cover will operate without binding, close tightly at perimeter, and latch securely.

3.3 PROTECTION

Protect roof accessories from damage during installation and after completion of the work from subsequent construction.

- - - E N D - - -

**SECTION 07 72 00
ROOF ACCESSORIES**

PART 1 - GENERAL

1.1 DESCRIPTION

This section specifies copings, gravel stops, fascias, and expansion joints.

1.2 RELATED WORK

- A. Color and texture of finish: Section 09 06 00, SCHEDULE FOR FINISHES
- B. Sealant material and installation: Section 07 92 00, JOINT SEALANTS.
- C. General insulation: Section 07 21 13, THERMAL INSULATION
- D. Rigid insulations for roofing: Section 07 22 00, ROOF AND DECK INSULATION

1.3 QUALITY CONTROL

- A. All roof accessories shall be the products of manufacturers regularly engaged in producing the kinds of products specified.
- B. Each accessory type shall be the same and be made by the same manufacturer.
- C. Each accessory shall be completely assembled to the greatest extent possible before delivery to the site.

1.4 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Samples: Representative sample panel of color anodized aluminum not less than 100 mm X 100 mm (four by four inches), except extrusions shall be a width not less than section to be used. Sample shall show coating with integral color and texture and shall include manufacturer's identifying label.
- C. Shop Drawings: Each item specified showing design, details of construction, installation and fastenings.
- D. Manufacturer's Literature and Data: Each item specified.
- E. Certificates: Stating that aluminum has been given specified thickness of anodizing.

1.5 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extend referenced. The publications are referenced in the text by the basic designation only.
- B. American Society for Testing and Material (ASTM):

- B209/209M-07.....Aluminum and Aluminum Alloy-Sheet and Plate
- B221/221M-07.....Aluminum-Alloy Extruded Bars, Rods, Wire,
Shapes, and Tubes
- C612-04.....Mineral Fiber Block and Board Thermal
Insulation
- D1187-97 (R2002).....Asphalt-Base Emulsions for Use as Protective
Coatings for Metal
- C. National Association of Architectural Metal Manufacturers (NAAMM):
AMP 500-505-88.....Metal Finishes Manual
- D. American Architectural Manufacturers Association (AAMA):
605-98.....High Performance Organic Coatings on
Architectural Extrusions and Panels.

PART 2 - PRODUCTS

2.1 MATERIALS

- A. Aluminum, Extruded: ASTM B221/B221M.
- B. Aluminum Sheet: ASTM B209/B209M.
- C. Galvanized Sheet Steel: ASTM A526/A526M; G-90 coating.
- D. Insulation: ASTM C612, Class 1 or 2.
- E. Asphalt Coating: ASTM D 1187, Type I, quick setting.

2.2 COPINGS

- A. Fabricate of aluminum not less than 3.2 mm 0.125 inch thick.
- B. Turn outer edges down each face of wall as shown.
- C. Maximum lengths of 3000 mm (10 feet).
- D. Shop fabricate external and internal corners as one piece assemblies with not less than 300 mm (12 inch) leg lengths.
- E. Copings shall be Category 5 FM rated.
- F. Provide 100 mm (four inch) wide 0.8 mm (0.032 inch) thick watertight joint covers.
- G. Provide anchor gutter bar of 0.8 mm (0.032 inch) thick with anchor holes formed for underside of joint.
- H. Provide concealed guttered splice plate of 0.8 mm (0.032 inch) thick with butyl or other resilient seal strips anchored to splice plate for underside of joint. Use galvanized steel anchor plate providing compression spring anchoring of coping cover.
- I. Finish: To be selected by Architect.

2.3 EXTRUDED ALUMINUM GRAVEL STOPS AND FASCIAS

- A. Fabricate of aluminum not less than 2 mm (0.078 inch) thick.
- B. Turn fascia down face of wall and up above roof as shown.

- C. Maximum lengths of 3000 mm (10-feet).
- D. Shop fabricate external and internal corners as one piece assemblies with not less than 300 mm (12 inch) leg lengths.
- E. Provide 100 mm (four inch) wide 2 mm (0.078 inch) thick watertight joint covers with 150 mm (six inch) wide 0.8 mm (0.030 inch) thick underside joint flashing.

2.4 FACTORY FABRICATED SCUPPER ASSEMBLIES

- A. Fabricate scupper assembly with extended plates to match gravel stops in 500 mm (20 inch) minimum lengths.
- B. Extend outlet opening not less than 50 mm (two inches) with drip edge.
- C. Fabricate with stainless steel cores or sleeve to drain water from toe of cant and flash in to built-up roofing with 100 mm (4 inch) wide flange.
- D. Finish on aluminum: To be selected by Architect.

2.5 FINISH

- A. In accordance with NAAMM Amp 500-505.
- B. Fluorocarbon Finish: AAMA 605.2 high performance organic coating.
Color to be selected by Architect.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Install roof accessories where shown.
- B. Secure with fasteners in accordance with manufacture's printed installation instructions and approved shop drawings unless shown otherwise.
- C. Coordinate to install insulation where shown; see Section 07 21 13, THERMAL INSULATION and Section 07 22 00, ROOF AND DECK INSULATION.
- D. Comply with section 07 92 00, JOINT SEALANTS to install sealants where manufactures installation instructions require sealant.
- E. Coordinate with roofing work for installation of items in sequence to prevent water infiltration.
- F. Gravel Stops and Fascias:
 1. Install gravel stops and fascia with butt joints with approximately 6 mm (1/4 inch) space for expansion.
 2. Over each joint provide cover plates of sheet aluminum, complete with concealed sheet aluminum flashing, centered under each joint.
 3. Lap cover plates and concealed flashing over the gravel stop and fascia not less than four inches.

4. Extend concealed flashing over built-up roofing, embed in roof cement and turn down over face of blocking at roof edge.
- G. Aluminum Coping:
1. Install sections of coping with approximately 6 mm (1/4-inch) space between ends of sections.
 2. Center joint gutter bar and covers at joints and securely lock in place.
 3. When snap-on system is used insure front and back edges are locked in place.
- H. Expansion Joint Covers:
1. Install to terminate base flashing 200 mm (8 inches) above roof.
 2. Install moisture seals to drain water to outlets that do not permit water to enter buildings construction.
 3. Use stainless steel screws when exposed.
 4. Two piece assembly:
 - a. Install curb section with screws allowing 6 mm (1/4 inch) space at end joints with splice plate at joint.
 - b. After completion of base flashing bend down cap flashing flange and secure to blocking with screws.
 - c. Install expansion joint cover with 6 mm (1/4 inch) wide space at end joints and tension bars at 600 mm (24 inches) on center.
 - d. Install cover plates with formed aluminum flashing concealed and centered on joint. Flashing to lap cover not less than 100 mm (4 inches).

3.2 PROTECTION OF ALUMINUM

- A. Provide protection for aluminum against galvanic action wherever dissimilar materials are in contact, by painting the contact surfaces of the dissimilar material with two coats of asphalt coating (complete coverage), or by separating the contact surfaces with a preformed neoprene tape having pressure sensitive adhesive coating on side.
- B. Paint aluminum in contact with wood, concrete and masonry, or other absorptive materials, that may become repeatedly wet, with two coats of asphalt coating.

3.3 ADJUSTING

Adjust expansion joints to close tightly and be watertight; insuring maximum allowance for building movement.

3.4 PROTECTION

Protect roof accessories from damage during installation and after completion of the work from subsequent construction.

- - - E N D - - -

**SECTION 07 81 00
APPLIED FIREPROOFING**

PART 1 - GENERAL

1.1 DESCRIPTION

This section specifies mineral fiber and cementitious coverings to provide fire resistance to interior structural steel members shown.

1.2 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturer's Literature and Data:
 - 1. Manufacturer's complete and detailed application instructions and specifications.
 - 2. Manufacturer's repair and patching instructions.
- C. Certificates:
 - 1. Certificate from testing laboratory attesting fireproofing material and application method meet the specified fire ratings.
 - a. List thickness and density of material required to meet fire ratings.
 - b. Accompanied by complete test report and test record.
 - 2. Manufacturer's certificate indicating sprayed-on fireproofing material supplied under the Contract is same within manufacturing tolerance as fireproofing material tested.
- D. Miscellaneous:
 - 1. Manufacturer's written approval of surfaces to receive sprayed-on fireproofing.
 - 2. Manufacturer's written approval of completed installation.
 - 3. Manufacturer's written approval of the applicators of fireproofing material.

1.3 PRODUCT DELIVERY, STORAGE AND HANDLING

- A. Deliver to job-site in sealed containers marked and labeled to show manufacturer's name and brand and certification of compliance with the specified requirements.
- B. Remove damaged containers from the site.
- C. Store the materials off the ground, under cover, away from damp surfaces.
- D. Keep dry until ready for use.

- E. Remove materials that have been exposed to water before installation from the site.

1.4 QUALITY CONTROL

- A. Test for fire endurance in accordance with ASTM E119, for fire rating specified, in a nationally recognized laboratory.
- B. Manufacturer's inspection and approval of surfaces to receive fireproofing as specified under paragraph Examination.
- C. Manufacturer's approval of fireproofing applications.
- D. Manufacturer's approval of completed installation.
- E. Manufacturer's representative shall observe and advise at the commencement of application, and shall visit the site as required thereafter for the purpose of ascertaining proper application.
- F. Pre-Application Test Area.
 - 1. Apply a test area consisting of a typical overhead fireproofing installation, including not less than 4.5 m (15 feet) of beam and deck.
 - a. Apply to one column.
 - b. Apply for the hourly ratings used.
 - 2. Install in location selected by the Resident Engineer, for approval by the representative of the fireproofing material manufacturer and by the Government.
 - 3. Perform Bond test on painted steel in accordance with ASTM E736.
 - 4. Do not proceed in other areas until installation of test area has been completed and approved.
 - 5. Keep approved installation area open for observation as criteria for sprayed-on fireproofing.

1.5 APPLICABLE PUBLICATIONS

- A. Publications listed below form a part of this specification to the extent referenced. Publications are referenced in the text by the basic designation only.
- B. American Society for Testing and Materials (ASTM):
 - C841-03.....Installation of Interior Lathing and Furring
 - C847-06.....Metal Lath
 - E84-08.....Surface Burning Characteristics of Building
Materials
 - E119-08.....Fire Tests of Building Construction and
Materials

- E605-93 (R2006).....Thickness and Density of Sprayed Fire-Resistive
Materials Applied to Structural Members
- E736-00.....Cohesion/Adhesion of Sprayed Fire-Resistive
Materials Applied to Structural Members
- E759-92 (R2005).....The Effect of Deflection on Sprayed Fire-
Resistive Material Applied to Structural
Members
- E760-92 (R2005).....Impact on Bonding of Sprayed Fire-Resistive
Material Applied to Structural Members
- E761-92 (R2005).....Compressive Strength of Fire-Resistive Material
Applied to Structural Members
- E859-93 (R2006).....Air Erosion of Sprayed Fire-Resistive Materials
Applied to Structural Members
- E937-93 (R2005).....Corrosion of Steel by Sprayed Fire-Resistive
Material Applied to Structural Members
- E1042-02.....Acoustically, Absorptive Materials Applied by
Trowel or Spray.
- G21-96 (R2002).....Determining Resistance of Synthetic Polymeric
Materials to Fungi
- C. Underwriters Laboratories, Inc. (UL):
Fire Resistance Directory...Latest Edition including Supplements
- D. Warnock Hersey (WH):
Certification Listings..Latest Edition
- E. Factory Mutual System (FM):
Approval Guide.....Latest Edition including Supplements

PART 2 - PRODUCTS

2.1 SPRAYED-ON FIREPROOFING

- A. ASTM E1042, Class (a), Category A.
 - 1. Type I, factory mixed cementitious materials with approved aggregate.
 - 2. Type II, factory mixed mineral fiber with integral inorganic binders minimum 240 kg/m³ (15 lb/ft³) density per ASTM E605 test unless specified otherwise. Use in areas that are completely encased.
- B. Materials containing asbestos are not permitted.

C. Fireproofing characteristics when applied in the thickness and density required to achieve the fire-rating specified.

	Characteristic	Test	Results
1.	Deflection	ASTM E759	No cracking, spalling, or delamination when backing to which it is applied has a deflection up to 1/120 in 3m (10 ft.)
2.	Corrosion-Resistance	ASTM E937	No promotion of corrosion of steel.
3.	Bond Impact	ASTM E760	No cracking, spalling, or delamination.
4.	Cohesion/Adhesion (Bond Strength)	ASTM E736	Minimum cohesive/adhesive strength of 9.57 kPa (200 lbf/ft ²) for protected areas. 19.15 kPa (400 lbf/ft ²) for exposed areas.
5.	Air Erosion	ASTM E859	Maximum gain weight of the collecting filter 0.27gm/m ² (0.025 gm/ft ²).
6.	Compressive Strength	ASTM E761	Minimum compressive strength 36 kPa (5 lbf/in ²).
7.	Surface Burning Characteristics with adhesive and sealer to be used	ASTM E84	Flame spread 25 or less smoke developed 50 or less
8.	Fungi Resistance	ASTM G21	Resistance to mold growth when inoculated with aspergillus niger (28 days for general application)

2.2 ADHESIVE

- A. Bonding adhesive for Type II (fibrous) materials as recommended and supplied by the fireproofing material manufacturer.
- B. Adhesive may be an integral part of the material or applied separately to surface receiving fireproofing material.

2.3 SEALER

- A. Sealer for Type II (fibrous) material as recommended and supplied by the fireproofing material manufacturer.
- B. Surface burning characteristics as specified for fireproofing material.
- C. Fungus resistant.
- D. Sealer may be an integral part of the material or applied separately to the exposed surface. When applied separately use contrasting color pigmented sealer, white preferred.

2.4 WATER

- A. Clean, fresh, and free from organic and mineral impurities.
- B. pH of 6.9 to 7.1.

2.5 MECHANICAL BOND MATERIAL

- A. Expanded Metal Lath: ASTM C847, minimum weight of 0.92 kg/m² (1.7 pounds per square yard).
- B. Fasteners: ASTM C841.

PART 3 - EXECUTION**3.1 EXAMINATION**

- A. Verify surfaces to receive fireproofing are clean and free of dust, soot, oil, grease, water soluble materials or any foreign substance which would prevent adhesion of the fireproofing material.
- B. Verify hangers, inserts and clips are installed before the application of fireproofing material.
- C. Verify ductwork, piping, and other obstructing material and equipment is not installed that will interfere with fireproofing installation.
- D. Verify concrete work on steel decking and concrete encased steel is completed.
- E. Verify temperature and enclosure conditions are required by fireproofing material manufacturer.

3.2 APPLICATION

- A. Do not start application until written approval has been obtained from manufacturer of fireproofing materials that surfaces have been inspected by the manufacturer or his representative, and are suitable to receive sprayed-on fireproofing.
- B. Coordinate application of fireproofing material with other trades.
- C. Application of Metal Lath:
 - 1. Apply to beam and columns having painted surfaces which fail ASTM E736 Bond Test requirements in pre-application test area.
 - 2. Apply to beam flanges 300 mm (12-inches) or more in width.
 - 3. Apply to column flanges 400 mm (16-inches) or more in width.
 - 4. Apply to beam or column web 400 mm (16-inches) or more in depth.
 - 5. Tack weld or mechanically fasten on maximum of 300 mm (12-inch) center.
 - 6. See design criteria section of the approved assemblies used.
 - 7. Lap and tie lath member in accordance with ASTM C841.
- D. Mix and apply in accordance with manufacturer's instructions.
 - 1. Mechanically control material and water ratios.

2. Apply adhesive and sealer, when not an integral part of the materials, in accordance with the manufacturer's instructions.
 3. Apply to density and thickness indicated in UL Fire Resistance Directory, FM Approval Guide, or WH Certification Listings unless specified otherwise. Test in accordance with ASTM E119.
 4. Minimum applied dry density per cubic meter (cubic foot) for the underside of the walk on deck (interstitial) hung purl in or beam and steel deck, columns in interstitial spaces and mechanical equipment rooms shall be as follows:
 - a. Type I - 240 kg/m³ (15 lb/ft³).
 - b. Type II - 350 kg/m³ (22 lb/ft³).
- E. Application shall be completed in one area, inspected and approved by Resident Engineer before removal of application equipment and proceeding with further work.

3.3 FIELD TESTS

- A. Tests of applied material will be performed by VA retained Testing Laboratory. See Section 01 45 29, TESTING LABORATORY SERVICES.
- B. Resident Engineer will select area to be tested in specific bays on each floor using a geometric grid pattern.
- C. Test for thickness and density in accordance with ASTM E605. Areas showing thickness less than that required as a result of fire endurance test will be rejected.
- D. Areas showing less than required fireproofing characteristics will be rejected on the following field tests.
 1. Test for cohesion/adhesion: ASTM E736.
 2. Test for bond impact strength: ASTM E760.

3.3 PATCHING AND REPAIRING

- A. Inspect after mechanical, electrical and other trades have completed work in contact with fireproofing material, but before sprayed material is covered by subsequent construction.
- B. Perform corrective measures in accordance with fireproofing material Manufacturer's recommendations.
 1. Respray areas requiring additional fireproofing material to provide the required thickness, and replace dislodged or removed material.
 2. Spray material for patching by machine directly on point to be patched, or into a container and then hand apply.
 3. Hand mixing of material is not permitted.
- C. Repair:

1. Respray all test and rejected areas.
 2. Patch fireproofing material which is removed or disturbed after approval.
- D. Perform final inspection of sprayed areas after patching and repair.

3.5 SCHEDULE

- A. Apply fireproofing material on interior primary structural steel members and on underside of connecting corridor roof deck, except on following surfaces:
1. Steel members in elevator hoist ways.
- B. Type I:
1. One hour fire rating.
 2. Two hour fire rating.
 3. Three hour fire rating.
- C. Type II:
1. One hour fire rating.
 2. Two hour fire rating.

- - - E N D - - -

**SECTION 07 84 00
FIRESTOPPING**

PART 1 GENERAL

1.1 DESCRIPTION

- A. Closures of openings in walls, floors, and roof decks against penetration of flame, heat, and smoke or gases in fire resistant rated construction.
- B. Closure of openings in walls against penetration of gases or smoke in smoke partitions.

1.2 RELATED WORK

- A. Expansion and seismic joint firestopping: Section 07 95 13, EXPANSION JOINT COVER ASSEMBLIES.
- B. Spray applied fireproofing: Section 07 81 00, APPLIED FIREPROOFING
- C. Sealants and application: Section 07 92 00, JOINT SEALANTS.
- D. Fire and smoke damper assemblies in ductwork: Section 23 31 00, HVAC DUCTS AND CASINGS and Section 23 37 00, AIR OUTLETS AND INLETS.

1.3 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturers literature, data, and installation instructions for types of firestopping and smoke stopping used.
- C. List of FM, UL, or WH classification number of systems installed.
- D. Certified laboratory test reports for ASTM E814 tests for systems not listed by FM, UL, or WH proposed for use.

1.4 DELIVERY AND STORAGE

- A. Deliver materials in their original unopened containers with manufacturer's name and product identification.
- B. Store in a location providing protection from damage and exposure to the elements.

1.5 WARRANTY

Firestopping work subject to the terms of the Article "Warranty of Construction", FAR clause 52.246-21, except extend the warranty period to five years.

1.6 QUALITY ASSURANCE

FM, UL, or WH or other approved laboratory tested products will be acceptable.

1.7 APPLICABLE PUBLICATIONS

- A. Publications listed below form a part of this specification to the extent referenced. Publications are referenced in the text by the basic designation only.
- B. American Society for Testing and Materials (ASTM):
 - E84-07.....Surface Burning Characteristics of Building Materials
 - E814-06.....Fire Tests of Through-Penetration Fire Stops
- C. Factory Mutual Engineering and Research Corporation (FM):
 - Annual Issue Approval Guide Building Materials
- D. Underwriters Laboratories, Inc. (UL):
 - Annual Issue Building Materials Directory
 - Annual Issue Fire Resistance Directory
 - 1479-03.....Fire Tests of Through-Penetration Firestops
- E. Warnock Hersey (WH):
 - Annual Issue Certification Listings

PART 2 - PRODUCTS**2.1 FIRESTOP SYSTEMS**

- A. Use either factory built (Firestop Devices) or field erected (through-Penetration Firestop Systems) to form a specific building system maintaining required integrity of the fire barrier and stop the passage of gases or smoke.
- B. Through-penetration firestop systems and firestop devices tested in accordance with ASTM E814 or UL 1479 using the "F" or "T" rating to maintain the same rating and integrity as the fire barrier being sealed. "T" ratings are not required for penetrations smaller than or equal to 100 mm (4 in) nominal pipe or 0.01 m² (16 sq. in.) in overall cross sectional area.
- C. Products requiring heat activation to seal an opening by its intumescence shall exhibit a demonstrated ability to function as designed to maintain the fire barrier.
- D. Firestop sealants used for firestopping or smoke sealing shall have following properties:
 - 1. Contain no flammable or toxic solvents.
 - 2. Have no dangerous or flammable out gassing during the drying or curing of products.
 - 3. Water-resistant after drying or curing and unaffected by high humidity, condensation or transient water exposure.

4. When used in exposed areas, shall be capable of being sanded and finished with similar surface treatments as used on the surrounding wall or floor surface.
- E. Firestopping system or devices used for penetrations by glass pipe, plastic pipe or conduits, unenclosed cables, or other non-metallic materials shall have following properties:
 1. Classified for use with the particular type of penetrating material used.
 2. Penetrations containing loose electrical cables, computer data cables, and communications cables protected using firestopping systems that allow unrestricted cable changes without damage to the seal.
 3. Intumescent products which would expand to seal the opening and act as fire, smoke, toxic fumes, and, water sealant.
- F. Maximum flame spread of 25 and smoke development of 50 when tested in accordance with ASTM E84.
- G. FM, UL, or WH rated or tested by an approved laboratory in accordance with ASTM E814.
- H. Materials to be asbestos free.

2.2 SMOKE STOPPING IN SMOKE PARTITIONS

- A. Use silicone sealant in smoke partitions as specified in Section 07 92 00, JOINT SEALANTS.
- B. Use mineral fiber filler and bond breaker behind sealant.
- C. Sealants shall have a maximum flame spread of 25 and smoke developed of 50 when tested in accordance with E84.
- D. When used in exposed areas capable of being sanded and finished with similar surface treatments as used on the surrounding wall or floor surface.

PART 3 - EXECUTION

3.1 EXAMINATION

Submit product data and installation instructions, as required by article, submittals, after an on site examination of areas to receive firestopping.

3.2 PREPARATION

- A. Remove dirt, grease, oil, loose materials, or other substances that prevent adherence and bonding or application of the firestopping or smoke stopping materials.

- B. Remove insulation on insulated pipe for a distance of 150 mm (six inches) on either side of the fire rated assembly prior to applying the firestopping materials unless the firestopping materials are tested and approved for use on insulated pipes.

3.3 INSTALLATION

- A. Do not begin work until the specified material data and installation instructions of the proposed firestopping systems have been submitted and approved.
- B. Install firestopping systems with smoke stopping in accordance with FM, UL, WH, or other approved system details and installation instructions.
- C. Install smoke stopping seals in smoke partitions.

3.4 CLEAN-UP AND ACCEPTANCE OF WORK

- A. As work on each floor is completed, remove materials, litter, and debris.
- B. Do not move materials and equipment to the next-scheduled work area until completed work is inspected and accepted by the Resident Engineer.
- C. Clean up spills of liquid type materials.

- - - E N D - - -

**SECTION 07 92 00
JOINT SEALANTS**

PART 1 - GENERAL

1.1 DESCRIPTION:

Section covers all sealant and caulking materials and their application, wherever required for complete installation of building materials or systems.

1.2 RELATED WORK:

- A. Sealing of site work concrete paving: Section 32 05 23, CEMENT AND CONCRETE FOR EXTERIOR IMPROVEMENTS.
- B. Masonry control and expansion joint: Section 04 20 00, UNIT MASONRY.
- C. Firestopping penetrations: Section 07 84 00, FIRESTOPPING.
- D. Glazing: Section 08 80 00, GLAZING.
- E. Glazed aluminum curtain wall: Section 08 44 13, GLAZED ALUMINUM CURTAIN WALLS.
- F. Sound rated gypsum partitions/sound sealants: Section 09 29 00, GYPSUM BOARD.
- G. Mechanical Work: Section 21 05 11, COMMON WORK RESULTS FOR FIRE SUPPRESSION Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION.

1.3 QUALITY CONTROL:

- A. Installer Qualifications: An experienced installer who has specialized in installing joint sealants similar in material, design, and extent to those indicated for this Project and whose work has resulted in joint-sealant installations with a record of successful in-service performance.
- B. Source Limitations: Obtain each type of joint sealant through one source from a single manufacturer.
- C. Product Testing: Obtain test results from a qualified testing agency based on testing current sealant formulations within a 12-month period.
 - 1. Testing Agency Qualifications: An independent testing agency qualified according to ASTM C1021.
 - 2. Test elastomeric joint sealants for compliance with requirements specified by reference to ASTM C920, and where applicable, to other standard test methods.
- D. VOC: Acrylic latex and Silicon sealants shall have less than 50g/l VOC content.

1.4 SUBMITTALS:

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturer's installation instructions for each product used.
- C. Cured samples of exposed sealants for each color where required to match adjacent material.
- D. Manufacturer's Literature and Data:
 - 1. Caulking compound
 - 2. Primers
 - 3. Sealing compound, each type, including compatibility when different sealants are in contact with each other.

1.5 PROJECT CONDITIONS:

- A. Environmental Limitations:
 - 1. Do not proceed with installation of joint sealants under following conditions:
 - a. When ambient and substrate temperature conditions are outside limits permitted by joint sealant manufacturer or are below 4.4 °C (40 °F).
 - b. When joint substrates are wet.
- B. Joint-Width Conditions:
 - 1. Do not proceed with installation of joint sealants where joint widths are less than those allowed by joint sealant manufacturer for applications indicated.
- C. Joint-Substrate Conditions:
 - 1. Do not proceed with installation of joint sealants until contaminants capable of interfering with adhesion are removed from joint substrates.

1.6 DELIVERY, HANDLING, AND STORAGE:

- A. Deliver materials in manufacturers' original unopened containers, with brand names, date of manufacture, shelf life, and material designation clearly marked thereon.
- B. Carefully handle and store to prevent inclusion of foreign materials.
- C. Do not subject to sustained temperatures exceeding 32° C (90° F) or less than 5° C (40° F).

1.7 DEFINITIONS:

- A. Definitions of terms in accordance with ASTM C717 and as specified.
- B. Back-up Rod: A type of sealant backing.

- C. Bond Breakers: A type of sealant backing.
- D. Filler: A sealant backing used behind a back-up rod.

1.8 WARRANTY:

- A. Warranty exterior sealing against leaks, adhesion, and cohesive failure, and subject to terms of "Warranty of Construction", FAR clause 52.246-21, except that warranty period shall be extended to two years.
- B. General Warranty: Special warranty specified in this Article shall not deprive Government of other rights Government may have under other provisions of Contract Documents and shall be in addition to, and run concurrent with, other warranties made by Contractor under requirements of Contract Documents.

1.9 APPLICABLE PUBLICATIONS:

- A. Publications listed below form a part of this specification to extent referenced. Publications are referenced in text by basic designation only.
- B. American Society for Testing and Materials (ASTM):
 - C509-06.....Elastomeric Cellular Preformed Gasket and Sealing Material.
 - C612-10.....Mineral Fiber Block and Board Thermal Insulation.
 - C717-10.....Standard Terminology of Building Seals and Sealants.
 - C834-10.....Latex Sealants.
 - C919-08.....Use of Sealants in Acoustical Applications.
 - C920-10.....Elastomeric Joint Sealants.
 - C1021-08.....Laboratories Engaged in Testing of Building Sealants.
 - C1193-09.....Standard Guide for Use of Joint Sealants.
 - C1330-02 (R2007).....Cylindrical Sealant Backing for Use with Cold Liquid Applied Sealants.
 - D1056-07.....Specification for Flexible Cellular Materials—Sponge or Expanded Rubber.
 - E84-09.....Surface Burning Characteristics of Building Materials.
- C. Sealant, Waterproofing and Restoration Institute (SWRI).
The Professionals' Guide

PART 2 - PRODUCTS**2.1 SEALANTS:**

A. S-1:

1. ASTM C920, polyurethane or polysulfide.
2. Type M.
3. Class 25.
4. Grade NS.
5. Shore A hardness of 20-40

B. S-2:

1. ASTM C920, polyurethane or polysulfide.
2. Type M.
3. Class 25.
4. Grade P.
5. Shore A hardness of 25-40.

C. S-3:

1. ASTM C920, polyurethane or polysulfide.
2. Type S.
3. Class 25, joint movement range of plus or minus 50 percent.
4. Grade NS.
5. Shore A hardness of 15-25.
6. Minimum elongation of 700 percent.

D. S-4:

1. ASTM C920 polyurethane or polysulfide.
2. Type S.
3. Class 25.
4. Grade NS.
5. Shore A hardness of 25-40.

E. S-5:

1. ASTM C920, polyurethane or polysulfide.
2. Type S.
3. Class 25.
4. Grade P.
5. Shore hardness of 15-45.

F. S-6:

1. ASTM C920, silicone, neutral cure.
2. Type S.
3. Class: Joint movement range of plus 100 percent to minus 50 percent.
4. Grade NS.

5. Shore A hardness of 15-20.
 6. Minimum elongation of 1200 percent.
- G. S-7:
1. ASTM C920, silicone, neutral cure.
 2. Type S.
 3. Class 25.
 4. Grade NS.
 5. Shore A hardness of 25-30.
 6. Structural glazing application.
- H. S-8:
1. ASTM C920, silicone, acetoxy cure.
 2. Type S.
 3. Class 25.
 4. Grade NS.
 5. Shore A hardness of 25-30.
 6. Structural glazing application.
- I. S-9:
1. ASTM C920 silicone.
 2. Type S.
 3. Class 25.
 4. Grade NS.
 5. Shore A hardness of 25-30.
 6. Non-yellowing, mildew resistant.
- J. S-10:
1. ASTM C920, coal tar extended fuel resistance polyurethane.
 2. Type M/S.
 3. Class 25.
 4. Grade P/NS.
 5. Shore A hardness of 15-20.
- K. S-11:
1. ASTM C920 polyurethane.
 2. Type M/S.
 3. Class 25.
 4. Grade P/NS.
 5. Shore A hardness of 35 to 50.
- L. S-12:
1. ASTM C920, polyurethane.
 2. Type M/S.

3. Class 25, joint movement range of plus or minus 50 percent.
4. Grade P/NS.
5. Shore A hardness of 25 to 50.

2.2 CAULKING COMPOUND:

- A. C-1: ASTM C834, acrylic latex.
- B. C-2: One component acoustical caulking, non drying, non hardening, synthetic rubber.

2.3 COLOR:

- A. Sealants used with exposed masonry shall match color of mortar joints.
- B. Sealants used with unpainted concrete shall match color of adjacent concrete.
- C. Color of sealants for other locations shall be light gray or aluminum, unless specified otherwise.
- D. Caulking shall be light gray or white, unless specified otherwise.

2.4 JOINT SEALANT BACKING:

- A. General: Provide sealant backings of material and type that are nonstaining; are compatible with joint substrates, sealants, primers, and other joint fillers; and are approved for applications indicated by sealant manufacturer based on field experience and laboratory testing.
- B. Cylindrical Sealant Backings: ASTM C1330, of type indicated below and of size and density to control sealant depth and otherwise contribute to producing optimum sealant performance:
 1. Type C: Closed-cell material with a surface skin.
- C. Elastomeric Tubing Sealant Backings: Neoprene, butyl, EPDM, or silicone tubing complying with ASTM D1056, nonabsorbent to water and gas, and capable of remaining resilient at temperatures down to minus 32° C (minus 26° F). Provide products with low compression set and of size and shape to provide a secondary seal, to control sealant depth, and otherwise contribute to optimum sealant performance.
- D. Bond-Breaker Tape: Polyethylene tape or other plastic tape recommended by sealant manufacturer for preventing sealant from adhering to rigid, inflexible joint-filler materials or joint surfaces at back of joint where such adhesion would result in sealant failure. Provide self-adhesive tape where applicable.

2.5 PRIMER:

- A. As recommended by manufacturer of caulking or sealant material.
- B. Stain free type.

2.6 CLEANERS-NON POUROUS SURFACES:

Chemical cleaners acceptable to manufacturer of sealants and sealant backing material, free of oily residues and other substances capable of staining or harming joint substrates and adjacent non-porous surfaces and formulated to promote adhesion of sealant and substrates.

PART 3 - EXECUTION**3.1 INSPECTION:**

- A. Inspect substrate surface for bond breaker contamination and unsound materials at adherent faces of sealant.
- B. Coordinate for repair and resolution of unsound substrate materials.
- C. Inspect for uniform joint widths and that dimensions are within tolerance established by sealant manufacturer.

3.2 PREPARATIONS:

- A. Prepare joints in accordance with manufacturer's instructions and SWRI.
- B. Clean surfaces of joint to receive caulking or sealants leaving joint dry to the touch, free from frost, moisture, grease, oil, wax, lacquer paint, or other foreign matter that would tend to destroy or impair adhesion.
 - 1. Clean porous joint substrate surfaces by brushing, grinding, blast cleaning, mechanical abrading, or a combination of these methods to produce a clean, sound substrate capable of developing optimum bond with joint sealants.
 - 2. Remove loose particles remaining from above cleaning operations by vacuuming or blowing out joints with oil-free compressed air. Porous joint surfaces include the following:
 - a. Concrete.
 - b. Masonry.
 - 3. Remove laitance and form-release agents from concrete.
 - 4. Clean nonporous surfaces with chemical cleaners or other means that do not stain, harm substrates, or leave residues capable of interfering with adhesion of joint sealants.
 - a. Metal.
- C. Do not cut or damage joint edges.
- D. Apply masking tape to face of surfaces adjacent to joints before applying primers, caulking, or sealing compounds.
 - 1. Do not leave gaps between ends of sealant backings.
 - 2. Do not stretch, twist, puncture, or tear sealant backings.

3. Remove absorbent sealant backings that have become wet before sealant application and replace them with dry materials.
- E. Apply primer to sides of joints wherever required by compound manufacturer's printed instructions.
 1. Apply primer prior to installation of back-up rod or bond breaker tape.
 2. Use brush or other approved means that will reach all parts of joints.
- F. Take all necessary steps to prevent three sided adhesion of sealants.

3.3 BACKING INSTALLATION:

- A. Install back-up material, to form joints enclosed on three sides as required for specified depth of sealant.
- B. Where deep joints occur, install filler to fill space behind the back-up rod and position the rod at proper depth.
- C. Cut fillers installed by others to proper depth for installation of back-up rod and sealants.
- D. Install back-up rod, without puncturing the material, to a uniform depth, within plus or minus 3 mm (1/8 inch) for sealant depths specified.
- E. Where space for back-up rod does not exist, install bond breaker tape strip at bottom (or back) of joint so sealant bonds only to two opposing surfaces.
- F. Take all necessary steps to prevent three sided adhesion of sealants.

3.4 SEALANT DEPTHS AND GEOMETRY:

- A. At widths up to 6 mm (1/4 inch), sealant depth equal to width.
- B. At widths over 6 mm (1/4 inch), sealant depth 1/2 of width up to 13 mm (1/2 inch) maximum depth at center of joint with sealant thickness at center of joint approximately 1/2 of depth at adhesion surface.

3.5 INSTALLATION:

- A. General:
 1. Apply sealants and caulking only when ambient temperature is between 5° C and 38° C (40° and 100° F).
 2. Do not use polysulfide base sealants where sealant may be exposed to fumes from bituminous materials, or where water vapor in continuous contact with cementitious materials may be present.
 3. Do not use sealant type listed by manufacture as not suitable for use in locations specified.

4. Apply caulking and sealing compound in accordance with manufacturer's printed instructions.
 5. Avoid dropping or smearing compound on adjacent surfaces.
 6. Fill joints solidly with compound and finish compound smooth.
 7. Tool joints to concave surface unless shown or specified otherwise.
 8. Finish paving or floor joints flush unless joint is otherwise detailed.
 9. Apply compounds with nozzle size to fit joint width.
 10. Test sealants for compatibility with each other and substrate. Use only compatible sealant.
- B. For application of sealants, follow requirements of ASTM C1193 unless specified otherwise.
- C. Where gypsum board partitions are of sound rated, fire rated, or smoke barrier construction, follow requirements of ASTM C919 only to seal all cut-outs and intersections with the adjoining construction unless specified otherwise.
1. Apply a 6 mm (1/4 inch) minimum bead of sealant each side of runners (tracks), including those used at partition intersections with dissimilar wall construction.
 2. Coordinate with application of gypsum board to install sealant immediately prior to application of gypsum board.
 3. Partition intersections: Seal edges of face layer of gypsum board abutting intersecting partitions, before taping and finishing or application of veneer plaster-joint reinforcing.
 4. Openings: Apply a 6 mm (1/4 inch) bead of sealant around all cut-outs to seal openings of electrical boxes, ducts, pipes and similar penetrations. To seal electrical boxes, seal sides and backs.
 5. Control Joints: Before control joints are installed, apply sealant in back of control joint to reduce flanking path for sound through control joint.

3.6 CLEANING:

- A. Fresh compound accidentally smeared on adjoining surfaces: Scrape off immediately and rub clean with a solvent as recommended by the caulking or sealant manufacturer.
- B. After filling and finishing joints, remove masking tape.
- C. Leave adjacent surfaces in a clean and unstained condition.

3.7 LOCATIONS:

- A. Exterior Building Joints, Horizontal and Vertical:

1. Metal to Masonry or Stone: Type S-1
 2. Masonry to Masonry or Stone: Type S-1
 3. Threshold Setting Bed: Type S-1, S-3, S-4
 4. Masonry Expansion and Control Joints: Type S-6
- B. Metal Reglets and Flashings:
1. Flashings to Wall: Type S-6
 2. Metal to Metal: Type S-6
- C. Sanitary Joints:
1. Walls to Plumbing Fixtures: Type S-9
 2. Counter Tops to Walls: Type S-9
 3. Pipe Penetrations: Type S-9
- D. Interior Caulking:
1. Typical Narrow Joint 6 mm, (1/4 inch) or less at Walls and Adjacent Components: Types C-1, C-2 and C-3.
 2. Perimeter of Doors, Windows, Access Panels which Adjoin Concrete or Masonry Surfaces: Types C-1, C-2 and C-3.
 3. Joints at Masonry Walls and Columns, Piers, Concrete Walls or Exterior Walls: Types C-1, C-2 and C-3.
 4. Exposed Isolation Joints at Top of Full Height Walls: Types C-1, C-2 and C-3.
 5. Exposed Acoustical Joint at Sound Rated Partitions Type C-2.
 6. Concealed Acoustic Sealant Type S-4, C-1, C-2 and C-3.

- - - E N D - - -

SECTION 07 95 13
EXPANSION JOINT COVER ASSEMBLIES

PART 1 - GENERAL

1.1 DESCRIPTION

A. Section specifies floor, wall and ceiling building expansion joint assemblies.

B. Types of assemblies:

Metal Plate Cover

1.2 RELATED WORK

A. Sheet Metal Expansion Joint Seals: Section 07 60 00, FLASHING AND SHEET METAL.

B. Roof Expansion Joint Cover Assemblies: Section 07 72 00, ROOF ACCESSORIES.

C. Steel Plate Expansion Joint Covers: Section 05 50 00, METAL FABRICATIONS.

1.3 QUALITY ASSURANCE

A. Project Conditions:

1. Check actual locations of walls and other construction, to which work must fit, by accurate field measurements before fabrication.

2. Show recorded measurements on final shop drawings.

B. Fire tests performed by Factory Mutual, Underwriters Laboratories, Inc., Warnock Hersey or other approved independent testing laboratory.

1.4 DELIVERY STORAGE AND HANDLING

A. Take care in handling of materials so as not to injure finished surface and components.

B. Store materials under cover in a dry and clean location off the ground.

C. Remove materials which are damaged or otherwise not suitable for installation from job site and replace with acceptable materials.

1.5 SUBMITTALS

A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.

B. Manufacturer's Literature and Data:

1. Submit copies of manufacturer's current literature and data for each item specified.

2. Clearly indicate movement capability of cover assemblies.

C. Certificates: Material test reports from approved independent testing laboratory indicating and interpreting test results relative to

compliance of fire-rated expansion joint assemblies with requirements specified.

D. Shop Drawings:

1. Showing full extent of expansion joint cover assemblies; include large-scale details indicating profiles of each type of expansion joint cover assembly, splice joints between sections, joiners with other type assemblies, special end conditions, anchorages, fasteners, and relationship to adjoining work and finishes.
2. Include description of materials and finishes and installation instructions.

E. Samples:

1. Samples of each type and color of metal finish on metal of same thickness and alloy used in work.
2. Samples of each type and color of flexible seal used in work.

1.6 APPLICABLE PUBLICATIONS

- A. Publications listed form part of this specification to extent referenced. Publications are referred to in text by basic designation only.
- B. American Society for Testing and Materials (ASTM):
- A36/A36M-05.....Structural Steel
 - A167-99 (R2004).....Stainless and Heat-Resisting Chromium-Nickel Steel Plate, Sheet, and Strip
 - A283/A283M-03.....Low and Intermediate Tensile Strength Carbon Steel Plates
 - A786/A786M-05.....Rolled Steel Floor Plates
 - B36/B36M-06.....Brass, Plate, Sheet, Strip, and Rolled Bar
 - B121-01 (R2006).....Leaded Brass Plate, Sheet, Strip and Rolled Bar
 - B209M-06.....Aluminum and Aluminum-Alloy Sheet and Plate (Metric)
 - B221M-06.....Aluminum and Aluminum-Alloy Extruded Bars, Rods, Wire, Shapes, and Tubes (Metric)
 - B455-05.....Copper-Zinc Lead Alloy (Leaded Brass) Extruded Shapes
 - C864-05.....Dense Elastomeric Compression Seal Gaskets, Setting Blocks, and Spacers
 - C920-05.....Elastomeric Joint Sealants
 - D1187-97 (R2002).....Asphalt Base Emulsions for Use as Protective Coatings for Metal

- D2287-96 (R2001).....Non-rigid Vinyl Chloride Polymer and Copolymer
Molding and Extrusion Compounds
- E119-07.....Fire Tests of Building Construction and
Materials
- E814-06.....Fire Tests of Through-Penetration Fire Stops
- C. Federal Specifications (Fed. Spec):
TT-P-645B.....Primer, Paint, Zinc-Molybdate, Alkyd Type
- D. The National Association of Architectural Metal Manufacturers (NAAMM):
AMP 500 Series.....Metal Finishes Manual.
- E. National Fire Protection Association (NFPA):
251-05.....Tests of Fire Endurance of Building
Construction and Materials
- F. Underwriters Laboratories Inc. (UL):
263-03.....Fire Tests of Building Construction and
Materials

PART 2 - PRODUCTS

2.1 MATERIALS

- A. Stainless Steel: ASTM A167, Type 302 or 304.
- B. Structural Steel Shapes: ASTM A36.
- C. Steel Plate: ASTM A283, Grade C.
- D. Rolled Steel Floor Plate: ASTM A786.
- E. Aluminum:
 - 1. Extruded: ASTM B221, alloy 6063-T5.
 - 2. Plate and Sheet: ASTM B209, alloy 6061-T6.
- F. Thermoplastic Rubber:
 - 1. ASTM C864.
 - 2. Dense Neoprene or other material standard with expansion joint
manufacturers having the same physical properties.
- G. Vinyl Invertor Sealant Waterstops: Manufacturers' standard shapes and
grade.
- H. Fire Barrier:
 - 1. Designed for indicated or required dynamic structural movement
without material degradation or fatigue.
 - 2. Tested in maximum joint width condition as a component of an
expansion joint cover assembly in accordance with UL 263 NFPA 251,
or ASTM E119 and E814, including hose steam test at full-rated
period.
- I. Zinc-Molybdate Primer: Fed. Spec. TT-P-645.

J. Accessories:

1. Manufacturer's standard anchors, fasteners, set screws, spacers, flexible secondary water stops or seals and filler materials, drain tubes, adhesive and other accessories as indicated or required for complete installations.
2. Compatible with materials in contact.
3. Water stops.

2.2 FABRICATION**A. General:**

1. Use ceiling and wall expansion joint cover assemblies of same design as floor to wall and floor to floor expansion joint cover assemblies. Unless shown otherwise.
2. Provide expansion joint cover assemblies of design, basic profile, materials and operation indicated required to accommodate joint size variations in adjacent surfaces, and as required for anticipated structural movement.
3. Deliver to job site ready for use and fabricated in as large sections and assemblies as practical. Assemblies identical to submitted and reviewed shop drawings, samples and certificates.
4. Furnish units in longest practicable lengths to minimize number of end joints. Provide mitered corners where joint changes directions or abuts other materials.
5. Include closure materials and transition pieces, tee-joints, corners, curbs, cross-connections and other assemblies.
6. Fire Performance Characteristics:
 - a. Provide expansion joint cover assemblies identical to those of assemblies whose fire resistance has been determined per ASTM E119 and E814, NFPA 251, or UL 263 including hose stream test at full-rated period.
 - b. Fire rating: Not less than rating of adjacent floor or wall construction.
7. Fire Barrier Systems:
 - a. Material to carry label of approved independent testing laboratory, and be subject to follow-up system for quality assurance.
 - b. Include thermal insulation where necessary, in accordance with above tests, with factory cut miters and transitions.

- c. For joint widths up to and including 150 mm (six inches), supply barrier in lengths up to 15000 mm (50 feet) to eliminate field splicing.
 - d. For joint widths of seven inches and wider, supply barrier 3000 mm (10-foot) modules with overlapping ends for field splicing.
 - e. For joints within enclosed spaces such as chase walls, include 1 mm (0.032-inch) thick galvanized steel cover where conventional expansion joint cover is not used.
8. Seal Strip factory - formed and bonded to metal frames and anchor members.
9. Compression Seals: Prefabricate from thermoplastic rubber or dense neoprene to sizes and approximate profiles shown.
- B. Floor-to-Wall Metal Plate Joints:
- 1. Provide one frame on floor side of joint only. Provide wall side frame where required by manufacturer's design.
 - 2. Angle Cover Plates: Provide angle cover plates for joints to wall with countersunk flat-head exposed fasteners for securing to wall unless shown otherwise.
 - 3. Space fasteners as recommended by manufacturer.
 - 4. Match cover of adjacent floor to floor cover.
- C. Interior Wall Joint Cover Assemblies:
- 1. Surface Mounted Metal Cover Plates:
 - a. Concealed frame for fastening to wall on one sides of joint.
 - b. Extend cover to lap each side of joint and to permit free movement on one side.
 - c. Provide concealed attachment of cover t frame cover in close contact with adjacent finish wall surfaces.
 - d. Use angle cover plates at intersection of walls.
 - e. Use smooth surface cover plates matching floor plates.
 - f. Use expansion fire inserts in fire rated walls, rated same as hour rating of wall.
- D. Exterior Wall Joint Assemblies:
- 1. Variable movement with seal designed to prevent water and air infiltration.
 - 2. Use vinyl seal strip as secondary seal behind primary seal.
 - 3. Cover Plate Assemblies:
 - a. Surface mounted cover plate.
 - b. Concealed frame for fastening to wall on one side of joint.

- c. Extend cover to lap each side of joint and to permit free movement on one side.
 - d. Provide concealed attachment of cover to frame for cover with cover in close contact with adjacent finish surfaces.
 - e. Use angle cover plate of intersection of walls.
- E. Ceiling and Soffit Assemblies:
- 1. Variable movement vinyl insert in metal frame on both sides of joint.
 - 2. Designed for flush mounting with no exposed fasteners.
 - 3. Vinyl insert locked into metal frame.
 - 4. Vinyl and metal finish as specified in section 09 06 00, SCHEDULE FOR FINISHES.
 - 5. Vinyl insert semi rigid either flush face or accordion shape as showed to span joint width without sagging.

2.3 METAL FINISHES

A. General:

- 1. Apply finishes in factory after products are fabricated.
- 2. Protect finishes on exposed surfaces with protective covering before shipment.

B. Aluminum Finishes:

- 1. Fluorocarbon Finish: NAAMM AMP 503 AAMA 605.2, high performance organic coating.
- 2. Factory-Primed Concealed Surface: NAAMM AMP 505 Protect concealed aluminum surfaces that will be in contact with plaster, concrete or masonry surfaces when installed by applying a shop coat of zinc-molybdate primer to contact surfaces. Provide minimum dry film thickness of 2.0 mils.

PART 3 EXECUTION

3.1 EXAMINATION

- A. Manufacturer's representative shall make a thorough examination of surfaces receiving work of this section.
- B. Before starting installation, notify prime contractor of defects which would affect satisfactory completion of work.

3.2 PREPARATION

- A. Verify measurements and dimensions at job site and cooperate in coordination and scheduling of work with work of related trades.
- B. Give particular attention to installation of items embedded in concrete and masonry so as not to delay job progress.

- C. Provide templates to related trade for location of support and anchorage items.

3.3 INSTALLATION

- A. Install in accordance with manufacturers installation instructions unless specified otherwise.
- B. Provide anchorage devices and fasteners for securing expansion joint assemblies to in-place construction including threaded fasteners with drilled-in fasteners for masonry and concrete where anchoring members are not embedded in concrete. Provide metal fasteners of type and size to suit type of construction indicated and provide for secure attachment of expansion joint cover assemblies.
- C. Perform cutting, drilling and fitting required for installation of expansion joint cover assemblies.
- D. Install joint cover assemblies in true alignment and proper relationship to expansion joint opening and adjoining finished surfaces measured from established lines and levels.
- E. Allow for thermal expansion and contraction of metal to avoid buckling.
- F. Set floor covers at elevations flush with adjacent finished floor materials unless shown otherwise.
- G. Material and method of grouting floor frames set in prepared recesses in accordance with manufacturer's instructions.
- H. Locate wall, ceiling and soffit covers in continuous contact with adjacent surfaces. Securely attach in place with required accessories.
- I. Locate anchors at interval recommended by manufacturer, but not less than 75 mm (3-inches) from each ends, and, not more than 600 mm (24-inches) on centers.
- J. Maintain continuity of expansion joint cover assemblies with end joints held to a minimum and metal members aligned mechanically using splice joints.
- K. Cut and fit ends to produce joints that will accommodate thermal expansion and contraction of metal to avoid buckling of frames or plates.
- L. Flush Metal Cover Plates:
 - 1. Secure flexible filler between frames so that it will compress and expand.
 - 2. Adhere flexible filler materials to frames with adhesive or pressure-sensitive tape as recommended by manufacturer.
- M. Waterstops:

1. Install in conjunction with floor joints and where shown, run continuously to prevent water damage to finish spaces.
2. Provide seal with frame to prevent water leakage.
3. Provide outlet tubes from waterstops to drain to prevent damage to finish spaces.

N. Fire Barriers:

1. Install in compliance with tested assembly.
2. Install in fire rated walls.
3. Use fire barrier sealant or caulk supplied with system.

O. Sealants:

Install to prevent water and air infiltration.

P. Vertical Exterior Extruded Thermoplastic Rubber.

1. Install side frames mounted on sealant or butyl caulk tape with appropriate anchors 600 mm (24 inches) on center complete with independent continuous PVC back seal.
2. Install primary seals retained in extruded aluminum side frames.

3.4 PROTECTION

- A. Take proper precautions to protect the expansion joint covers from damage after they are in place.

- - - E N D - - -

SECTION 08 11 13
HOLLOW METAL DOORS AND FRAMES

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This section specifies steel doors, steel frames and related components.
- B. Terms relating to steel doors and frames as defined in ANSI A123.1 and as specified.

1.2 RELATED WORK

- A. Frames fabricated of structural steel: Section 05 50 00, METAL FABRICATIONS.
- B. Aluminum frames entrance work: Section 08 41 13, ALUMINUM-FRAMED ENTRANCES AND STOREFRONTS.
- C. Door Hardware: Section 08 71 00, DOOR HARDWARE.
- D. Card readers and biometric devices: Section 28 13 00, ACCESS CONTROL.

1.3 TESTING

An independent testing laboratory shall perform testing.

1.4 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturers Literature and Data:
 - 1. Fire rated doors and frames, showing conformance with NFPA 80 and Underwriters Laboratory, Inc., or Intertek Testing Services or Factory Mutual fire rating requirements and temperature rise rating for stairwell doors. Submit proof of temperature rating.
 - 2. Sound rated doors, including test report from Testing Laboratory.

1.5 SHIPMENT

- A. Prior to shipment label each door and frame to show location, size, door swing and other pertinent information.
- B. Fasten temporary steel spreaders across the bottom of each door frame.

1.6 STORAGE AND HANDLING

- A. Store doors and frames at the site under cover.
- B. Protect from rust and damage during storage and erection until completion.

1.7 APPLICABLE PUBLICATIONS

- A. Publications listed below form a part of this specification to the extent referenced. Publications are referenced in the text by the basic designation only.
- B. Door and Hardware Institute (DHI):
 - A115 Series.....Steel Door and Frame Preparation for Hardware, Series A115.1 through A115.17 (Dates Vary)
- C. Steel Door Institute (SDI):
 - 113-01.....Thermal Transmittance of Steel Door and Frame Assemblies
 - 128-1997.....Acoustical Performance for Steel Door and Frame Assemblies
 - A250.8-03.....Standard Steel Doors and Frames
- D. American Society for Testing and Materials (ASTM):
 - A568/568-M-07.....Steel, Sheet, Carbon, and High-Strength, Low-alloy, Hot-Rolled and Cold-Rolled
 - A1008-08.....Steel, sheet, Cold-Rolled, Carbon, Structural, High Strength Low Alloy and High Strength Low Alloy with Improved Formability
 - B209/209M-07.....Aluminum and Aluminum-Alloy Sheet and Plate
 - B221/221M-08.....Aluminum and Aluminum-Alloy Extruded Bars, Rods, Wire, Profiles and Tubes
 - E90-04.....Laboratory Measurement of Airborne Sound Transmission Loss of Building Partitions
- E. The National Association Architectural Metal Manufacturers (NAAMM):
 - Metal Finishes Manual (1988 Edition)
- F. National Fire Protection Association (NFPA):
 - 80-09.....Fire Doors and Fire Windows
- G. Underwriters Laboratories, Inc. (UL):
 - Fire Resistance Directory
- H. Intertek Testing Services (ITS):
 - Certifications Listings...Latest Edition
- I. Factory Mutual System (FM):
 - Approval Guide

PART 2 - PRODUCTS**2.1 MATERIALS**

- A. Sheet Steel: ASTM A1008, cold-rolled for panels (face sheets) of doors.

- B. Anchors, Fastenings and Accessories: Fastenings anchors, clips connecting members and sleeves from zinc coated steel.
- C. Aluminum, Extruded: ASTM B221/221M.
- D. Prime Paint: Paint that meets or exceeds the requirements of A250.8.

2.2 FABRICATION GENERAL

A. GENERAL:

1. Follow SDI A250.8 for fabrication of standard steel doors, except as specified otherwise. Doors to receive hardware specified in Section 08 71 00, DOOR HARDWARE. Tolerances as per SDI A250.8. Thickness, 44 mm (1-3/4 inches), unless otherwise shown.
2. Close top edge of exterior doors flush and seal to prevent water intrusion.
3. When vertical steel stiffeners are used for core construction, fill spaces between stiffeners with mineral fiber insulation.

- B. Standard Duty Doors: SDI A250.8, Level 1, Model 2 of size and design shown. Use for interior locations only. Do not use for stairwell doors, security doors and detention doors.

C. Fire Rated Doors (Labeled):

1. Conform to NFPA 80 when tested by Underwriters Laboratories, Inc., Inchcape Testing Services, or Factory Mutual for the class of door or door opening shown.
2. Fire rated labels of metal, with raised or incised markings of approving laboratory shall be permanently attached to doors.
3. Close top and vertical edges of doors flush. Vertical edges shall be seamless. Apply steel astragal to the meeting stile of the active leaf of pairs of fire rated doors, except where vertical rod exit devices are specified for both leaves swinging in the same direction.
4. Construct fire rated doors in stairwell enclosures for maximum transmitted temperature rise of 230 °C (450 °F) above ambient temperature at end of 30 minutes of fire exposure when tested in accordance with ASTM E152.

2.3 METAL FRAMES

A. General:

1. SDI A250.8, 1.3 mm (0.053 inch) thick sheet steel, types and styles as shown or scheduled.
2. Frames for exterior doors: Fabricate from 1.7 mm (0.067 inch) thick galvanized steel conforming to ASTM A525.

3. Frames for labeled fire rated doors.
 - a. Comply with NFPA 80. Test by Underwriters Laboratories, Inc., Inchcape Testing Services, or Factory Mutual.
 - b. Fire rated labels of approving laboratory permanently attached to frames as evidence of conformance with these requirements.
Provide labels of metal or engraved stamp, with raised or incised markings.
5. Frames for detention door (Type 22): Minimum 2 mm (0.093 inch) thick.
6. Frames for doors specified to have automatic door operators; Security doors (Type 36); service window: minimum 1.7 mm (0.067 inch) thick.
- B. Terminated Stops: SDI A250.8.
- C. Glazed Openings:
 - a. Integral stop on exterior, corridor, or secure side of door.
 - b. Design rabbet width and depth to receive glazing material or panel shown or specified.
- D. Frame Anchors:
 1. Floor anchors:
 - a. Where floor fills occur, provide extension type floor anchors to compensate for depth of fill.
 - b. At bottom of jamb use 1.3 mm (0.053 inch) thick steel clip angles welded to jamb and drilled to receive two 6 mm (1/4 inch) floor bolts. Use 50 mm x 50 mm (2 inch by 2 inch) 9 mm by (3/8 inch) clip angle for lead lined frames, drilled for 9 mm (3/8 inch) floor bolts.
 - c. Where mullions occur, provide 2.3 mm (0.093 inch) thick steel channel anchors, drilled for two 6 mm (1/4 inch) floor bolts and frame anchor screws.
 - d. Where sill sections occur, provide continuous 1 mm (0.042 inch) thick steel rough bucks drilled for 6 mm (1/4 inch) floor bolts and frame anchor screws. Space floor bolts at 50 mm (24 inches) on center.
 2. Jamb anchors:
 - a. Locate anchors on jambs near top and bottom of each frame, and at intermediate points not over 600 mm (24 inches) apart, except for fire rated frames space anchors as required by labeling authority.

- b. Form jamb anchors of not less than 1 mm (0.042 inch) thick steel unless otherwise specified.
- c. Anchors set in masonry: Use adjustable anchors designed for friction fit against the frame and for extension into the masonry not less than 250 mm (10 inches). Use one of following type:
 - 1) Wire loop type of 5 mm (3/16 inch) diameter wire.
 - 2) T-shape or strap and stirrup type of corrugated or perforated sheet steel.
- d. Anchors for stud partitions: Either weld to frame or use lock-in snap-in type. Provide tabs for securing anchor to the sides of the studs.
- e. Anchors for frames set in prepared openings:
 - 1) Steel pipe spacers with 6 mm (1/4 inch) inside diameter welded to plate reinforcing at jamb stops or hat shaped formed strap spacers, 50 mm (2 inches) wide, welded to jamb near stop.
 - 2) Drill jamb stop and strap spacers for 6 mm (1/4 inch) flat head bolts to pass thru frame and spacers.
 - 3) Two piece frames: Subframe or rough buck drilled for 6 mm (1/4 inch) bolts.
- f. Anchors for observation windows and other continuous frames set in stud partitions.
 - 1) In addition to jamb anchors, weld clip anchors to sills and heads of continuous frames over 1200 mm (4 feet) long.
 - 2) Anchors spaced 600 mm (24 inches) on centers maximum.
- g. Modify frame anchors to fit special frame and wall construction and provide special anchors where shown or required.

2.4 SHOP PAINTING

SDI A250.8.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Plumb, align and brace frames securely until permanent anchors are set.
 - 1. Use triangular bracing near each corner on both sides of frames with temporary wood spreaders at midpoint.
 - 2. Use wood spreaders at bottom of frame if the shipping spreader is removed.
 - 3. Protect frame from accidental abuse.

4. Where construction will permit concealment, leave the shipping spreaders in place after installation, otherwise remove the spreaders after the frames are set and anchored.
 5. Remove wood spreaders and braces only after the walls are built and jamb anchors are secured.
- B. Jamb Anchors:
1. Anchors in masonry walls: Embed anchors in mortar. Fill space between frame and masonry wall with grout or mortar as walls are built.
 2. Coat frame back with a bituminous coating prior to lining of grout filling in masonry walls.
 3. Secure anchors to sides of studs with two fasteners through anchor tabs. Use steel drill screws to steel studs.
 4. Frames set in prepared openings of masonry or concrete: Expansion bolt to wall with 6 mm (1/4 inch) expansion bolts through spacers. Where subframes or rough bucks are used, 6 mm (1/4 inch) expansion bolts on 600 mm (24 inch) centers or power activated drive pins 600 mm (24 inches) on centers. Secure two piece frames to subframe or rough buck with machine screws on both faces.
- C. Install anchors for labeled fire rated doors to provide rating as required.
- D. Frames for Sound Rated Doors: Coordinate to line frames for sound rated doors with insulation.

3.2 INSTALLATION OF DOORS AND APPLICATION OF HARDWARE

Install doors and hardware as specified in Sections Section 08 11 13, HOLLOW METAL DOORS AND FRAMES Section 08 21 00, THERMAL FUSED FLUSH DOORS and Section 08 71 00, DOOR HARDWARE.

- - - E N D - - -

SECTION 08 21 00
THERMAL FUSED FLUSH DOORS

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This Section includes the following:
1. Solid-core doors with Low-Pressure Decorative Laminate (herein referred to as "LPDL") Thermal Fused faces.
 2. Factory fitting flush wood doors to frames and factory machining for hardware.
 3. Vision lite kits for flush wood doors.

1.2 RELATED WORK

1. Section 06 20 00 FINISH CARPENTRY
2. Section 08 80 00 GLAZING
3. Section 09 06 00 SCHEDULE FOR FINISHES

1.3 SUBMITTALS

- A. Product Data: For each type of door. Include details of core and edge construction and trim for openings.
- B. Shop Drawings: Indicate location, size, and hand of each door; elevation of each kind of door; construction details not covered in Product Data; and other pertinent data.
1. Indicate dimensions and locations of mortises and holes for hardware.
 2. Indicate dimensions and locations of cutouts.
 3. Indicate fire ratings for fire doors.
- C. Samples for Initial Selection: Color samples consisting of actual faces in small sections for the following:
1. LPDL Thermal Fused Door Faces: Show the full range of colors and woodgrains available.
- D. Samples for Verification:
1. Hinge corner sections of LPDL Thermal Fused doors, approximately 5 by 11 inches (127 by 279 mm) for each color or wood grain specified.
 2. Louver blade and frame sections, 6 inches (150 mm) long, for each material and finish specified.
 3. Frames for lite openings, 6 inches (150 mm) long, for each material, type, and finish required.
- E. Product Test Reports: Based on evaluation of comprehensive tests performed by a qualified independent third party testing agency, for

doors, showing compliance with specified performance requirements and physical properties.

1.4 QUALITY ASSURANCE

- A. Source Limitations: Obtain LPDL Thermal Fused Flush Wood Doors through one source from a single manufacturer.
- B. Quality Standard: Comply with WDMA I.S.1-A, 2004 edition "Industry Standard for Architectural Wood Flush Doors" and the following minimum values (for particle core doors):
 - 1. NWWDA TM-7 Cycle Slam Test: 1,000,000 cycles.
 - 2. NWWDA TM-8 Hinge Loading Test: 1,000 lbs.
 - 3. NWWDA TM-10 Edge Screw Holding: Test 850 lbs.
 - 4. NWWDA TM-10 Face Screw Holding: Test 650 lbs.
- C. Fire-Rated Wood Doors: Doors complying with NFPA 80 that are listed and labeled by a testing and inspecting agency acceptable to authorities having jurisdiction, for fire ratings indicated, based on testing according to **UL 10C and NFPA 252**.
 - 1. Test Pressure: **Test at atmospheric pressure. After 5 minutes into the test, the neutral pressure level in furnace shall be established at 40 inches (1000 mm) or less above the sill - positive pressure.**
 - 2. Temperature-Rise Rating: At exit enclosures, provide doors that have a temperature-rise rating of 250 deg F (121 deg C) maximum after 30 minutes of fire exposure. Doors with this temperature-rise rating are limited to 100 sq. inches of clear view area of glazing.
 - 3. Blocking: When through-bolts are not to be used, indicate size and location of blocking in 45, 60 and 90-minute mineral core doors.
- D. Security Rating for Particle Core Doors:
ASTM F 476, Grade 40.

1.5 DELIVERY AND STORAGE

- A. Certified efficacy after simulated long-term use.
- B. Package doors to prevent damage in transit. Place doors on cardboard or wooden skids and wrap entire bundles of doors in plastic sheeting.
- C. Mark each door on top rail with opening number used on Shop Drawings.

1.6 PROJECT CONDITIONS

- A. Environmental Limitations: Do not deliver or install doors until building is enclosed, wet work is complete, and HVAC system is operating and will maintain temperature and relative humidity at occupancy levels during the remainder of the construction period.

- B. Environmental Limitations: Do not deliver or install woodwork until building is enclosed, wet work is complete, and HVAC system is operating and maintaining temperature between 60 and 90 deg F (16 and 32 deg C) and relative humidity is between 25% and 55% during the remainder of the construction period.

1.7 WARRANTY

- A. Special Warranty: Manufacturer's standard form, signed by manufacturer, Installer, and Contractor, in which manufacturer agrees to repair or replace doors that are defective in materials or workmanship, have warped (bow, cup, or twist) more than 1/4 inch (6.4 mm) in a 48-by-84-inch (1219-by-2134-mm) section, or show telegraphing of core construction in face exceeding 0.01 inch in a 3-inch (0.25 mm in a 75-mm) span.
- B. Warranty shall be in effect for the life of the installation.

PART 2 - PRODUCTS

2.1 DOOR CONSTRUCTION, GENERAL

- A. Adhesives: Do not use adhesives containing urea formaldehyde.
- B. LPDL Thermal Fused Wood Flush Doors:
 - 1. LPDL Thermal Fused Wood Flush Doors:
 - 2. WDMA I.S. 1A Aesthetic Grade: Premium
 - 3. LPDL Thermal-Fused Faces: Decorative faces thermally fused to cores under heat and pressure, complying with Laminating Materials Association's Product Standard and Typical Physical Properties of Decorative Overlays. LMA.2003.
 - 4. Color or Woodgrain Pattern: **As selected by Architect from manufacturer's full range of products.**
 - 5. Edgebanding: Impact-resistant polymer edging, minimum .040" thick, applied to all four edges after faces on particle core doors, and on 2 vertical edges on mineral core doors. **As selected by Architect from manufacturer's full range of products.**
 - 6. Provide doors with pilot holes factory-drilled for vertical edge hinges and lock sets.

2.2 SOLID-CORE DOORS

- A. Particleboard Cores: Comply with the following requirements:
 - 1. Particleboard: ANSI A208.1, Grade M-2.
 - 2. Wood Stiles and Rails: Not required.
 - 3. Blocking: Not required.
- B. Mineral Core Fire-Rated Doors:

1. Construction: Construction and core specified above for type of face indicated or manufacturer's standard mineral-core construction as needed to provide fire rating indicated.
2. Blocking: For mineral-core doors, provide composite blocking with improved screw-holding capability approved for use in doors of fire ratings indicated as needed to eliminate through-bolting hardware, as follows:
 - a. 5-inch (125-mm) top-rail blocking for closer attachment.
 - b. 5-inch (125-mm) bottom-rail blocking, in doors indicated to have protection plates or mortised automatic door bottoms.
 - c. 5-inch (125-mm) midrail blocking, in doors indicated to have armor plates.
 - d. **5-inch (125-mm) midrail blocking**, in doors indicated to have exit devices.
3. Edge Construction: At hinge stiles, provide manufacturer's standard laminated-edge construction with improved screw-holding capability and split resistance and with outer stile matching polymer edging.
4. Edge Construction: Provide edge construction with intumescent seals concealed by outer stile matching polymer edging, and laminated backing for improved screw-holding capability and split resistance.
5. Pairs: Provide meeting stiles with concealed intumescents, to eliminate the need for metal meeting edges and/or overlapping astragal.

2.3 LOUVERS AND LITE FRAMES

- A. Wood Beads for Lite Openings in Particle Core Wood Doors:
 1. Wood Species: Factory finished to match door face
 2. Profile: Manufacturer's standard lipped profile.
 3. At 20-minute, fire-rated, wood-core doors, provide wood beads and intumescent glazingtape approved for such use.

2.4 FABRICATION

- A. Fabricate doors in sizes indicated for Project-site fitting.
- B. Factory fit doors to suit frame-opening sizes indicated, with the following uniform clearances and bevels, unless otherwise indicated:
 1. Comply with clearance requirements of referenced quality standard for fitting. Comply with requirements in NFPA 80 for fire-rated doors.

- C. Factory machine doors for hardware that is not surface applied. Comply with final hardware schedules, door frame Shop Drawings, and hardware templates.
 - 1. Coordinate measurements of hardware mortises in metal frames to verify dimensions and alignment before factory machining.
- D. Openings: Cut and trim openings through doors to comply with applicable requirements of referenced standards for kind(s) of door(s) required.
 - 1. Light Openings: Trim openings with moldings of material and profile indicated.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Examine doors and installed door frames before hanging doors.
 - 1. Verify that frames comply with indicated requirements for type, size, location, and swing characteristics and have been installed with level heads and plumb jambs.
 - 2. Reject doors with defects.
- B. Proceed with installation only after unsatisfactory conditions have been corrected.

3.2 INSTALLATION

- A. Manufacturer's Written Instructions: Install doors, lite kits, and glazing to comply with manufacturer's written instructions, referenced quality standard, and as indicated.
 - 1. Install fire-rated doors in corresponding fire-rated frames according to NFPA 80.
- B. Factory-Fitted Doors: Align in frames for uniform clearance at each edge.

3.3 ADJUSTING

- A. Operation: Rehang or replace doors that do not swing or operate freely.

- - - E N D - - -

SECTION 08 31 13
ACCESS DOORS AND FRAMES

PART 1 - GENERAL

1.1 DESCRIPTION:

Section specifies access doors or panels.

1.2 RELATED WORK:

- A. Lock Cylinders: Section 08 71 00, DOOR HARDWARE.
- B. Access doors in acoustical ceilings: Section 09 51 00, ACOUSTICAL CEILINGS.
- C. Locations of access doors for duct work cleanouts: Section 23 31 00, HVAC DUCTS AND CASINGS and Section 23 37 00, AIR OUTLETS AND INLETS .

1.3 SUBMITTALS:

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Shop Drawings: Access doors, each type, showing construction, location and installation details.
- C. Manufacturer's Literature and Data: Access doors, each type.

1.4 APPLICABLE PUBLICATIONS

- A. Publications listed below form a part of this specification to extent referenced. Publications are referenced in the text by basic designation only.
- B. American Society for Testing and Materials (ASTM):
A1008-07.....Steel Sheet, Cold-Rolled, Carbon, Structural,
High Strength Low-Alloy
- C. American Welding Society (AWS):
D1.3-98.....Structural Welding Code Sheet Steel
- D. National Fire Protection Association (NFPA):
80-06.....Fire Doors and Windows
- E. The National Association of Architectural Metal Manufacturers (NAAMM):
AMP 500 Series.....Metal Finishes Manual
- F. Underwriters Laboratories, Inc. (UL):
Fire Resistance Directory

PART 2 - PRODUCTS

2.1 FABRICATION, GENERAL

- A. Fabricate components to be straight, square, flat and in same plane where required.

1. Slightly round exposed edges and without burrs, snags and sharp edges.
 2. Exposed welds continuous and ground smooth.
 3. Weld in accordance with AWS D1.3.
- B. Number of locks and non-continuous hinges as required to maintain alignment of panel with frame. For fire rated doors, use hinges and locks as required by fire test.
- C. Provide anchors or make provisions in frame for anchoring to adjacent construction. Provide size, number and location of anchors on four sides to secure access door in opening. Provide anchors as required by fire test.

2.2 ACCESS DOORS, FIRE RATED:

- A. Shall meet requirements for "B" label 1-1/2 hours with maximum temperature rise of 120 degree C (250 degrees F).
- B. Comply with NFPA 80 and have Underwriters Laboratories Inc., or other nationally recognized laboratory label for Class B opening.
- C. Door Panel: Form of 0.9 mm (0.0359 inch) thick steel sheet, insulated sandwich type construction.
- D. Frame: Form of 1.5 mm (0.0598 inch) thick steel sheet of depth and configuration to suit material and type of construction where installed. Provide frame flange at perimeter where installed in concrete masonry or gypsum board openings.
1. Weld exposed joints in flange and grind smooth.
 2. Provide frame flange at perimeter where installed in concrete masonry or gypsum board.
- E. Automatic Closing Device: Provide automatic closing device for door.
- F. Hinge: Continuous steel hinge with stainless steel pin.
- G. Lock:
1. Self-latching, with provision for fitting flush a standard screw-in type lock cylinder. Lock cylinder specified in Section 08 71 00, DOOR HARDWARE.
 2. Provide latch release device operable from inside of door. Mortise case in door.

2.3 ACCESS DOORS, FLUSH PANEL:

- A. Door Panel:
1. Form of 1.9 mm (0.0747 inch) thick steel sheet.
 2. Reinforce to maintain flat surface.
- B. Frame:

1. Form of 1.5 mm (0.0598 inch) thick steel sheet of depth and configuration to suit material and type of construction where installed.
 2. Provide surface mounted units having frame flange at perimeter where installed in concrete, masonry, or gypsum board construction.
 3. Weld exposed joints in flange and grind smooth.
- C. Hinge:
1. Concealed spring hinge to allow panel to open 175 degrees.
 2. Provide removable hinge pin to allow removal of panel from frame.

2.4 FINISH:

- A. Provide in accordance with NAAMM AMP 500 series on exposed surfaces.
- B. Steel Surfaces: Baked-on prime coat over a protective phosphate coating.

2.5 SIZE:

Minimum 600 mm (24 inches) square door unless otherwise shown

PART 3 - EXECUTION**3.1 LOCATION:**

- A. Provide access panels or doors wherever any valves, traps, dampers, cleanouts, and other control items of mechanical, electrical and conveyor work are concealed in wall or partition, or are above ceiling of gypsum board or plaster.
- B. Use fire rated doors in fire rated partitions and ceilings.
- C. Use flush panels in partitions and gypsum board or plaster ceilings, except lay-in acoustical panel ceilings or upward access acoustical tile ceilings.

3.2 INSTALLATION, GENERAL:

- A. Install access doors in openings to have sides vertical in wall installations, and parallel to ceiling suspension grid or side walls when installed in ceiling.
- B. Set frames so that edge of frames without flanges will finish flush with surrounding finish surfaces.
- C. Set frames with flanges to overlap opening and so that face will be uniformly spaced from the finish surface.

3.3 ANCHORAGE:

- A. Secure frames to adjacent construction using anchors attached to frames or by use of bolts or screws through the frame members.

- B. Type, size and number of anchoring device suitable for the material surrounding the opening, maintain alignment, and resist displacement during normal use of access door.
- C. Anchors for fire rated access doors shall meet requirements of applicable fire test.

3.4 ADJUSTMENT:

- A. Adjust hardware so that door panel will open freely.
- B. Adjust door when closed so door panel is centered in the frame.

- - - E N D - - -

SECTION 08 41 13
ALUMINUM-FRAMED ENTRANCES AND STOREFRONTS

PART 1 - GENERAL

1.1 DESCRIPTION:

This section specifies aluminum entrance work including storefront construction, hung doors, interior ICU sliding doors, and other components to make a complete assembly.

1.2 RELATED WORK:

- A. Glass and Glazing: Section 08 80 00, GLAZING.
- B. Hardware: Section 08 71 00, DOOR HARDWARE.
- C. Automatic Door Operators: Section 08 71 13, AUTOMATIC DOOR OPERATORS.
- D. Texture and color of finish: Section 09 06 00, SCHEDULE FOR FINISHES.

1.3 SUBMITTALS:

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Shop Drawings: (1/2 full scale) showing construction, anchorage, reinforcement, and installation details.
- C. Manufacturer's Literature and Data:
 - 1. Doors, each type.
 - 2. Entrance and Storefront construction.
- D. Samples:
 - 1. Door corner section, 450 mm x 450 mm (18 x 18 inches), of each door type specified, showing vertical and top hinge edges, door closer reinforcement internal reinforcement and insulation, of flush panel door.
 - 2. Two samples of anodized aluminum of each color showing finish and maximum shade range.
 - 3. Two samples of organic finish of each color specified.
- E. Manufacturer's Certificates:
 - 1. Stating that aluminum has been given specified thickness of anodizing.
 - 2. Indicating manufacturer's qualifications specified.

1.4 QUALITY ASSURANCE:

- A. Approval by Contracting Officer is required of products of proposed manufacturer, or supplier, and will be based upon submission by Contractor certification.

- B. Certify manufacturer regularly and presently manufactures aluminum entrances and storefronts as one of their principal products.

1.5 DELIVERY, STORAGE AND HANDLING:

- A. Deliver aluminum entrance and storefront material to the site in packages or containers; labeled for identification with the manufacturer's name, brand and contents.
- B. Store aluminum entrance and storefront material in weather-tight and dry storage facility.
- C. Protect from damage from handling, weather and construction operations before, during and after installation.

1.6 APPLICABLE PUBLICATIONS:

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American Society for Testing and Materials (ASTM):
 - B209-06.....Aluminum and Aluminum-Alloy Sheet and Plate
 - B221-05.....Aluminum and Aluminum-Alloy Extruded Bars, Rods, Wire, Shapes, and Tubes
 - E283-04.....Rate of Air Leakage Through Exterior Windows, Curtain Walls, and Doors Under Specified Pressure Differences Across the Specimen
 - E331-00.....Water Penetration of Exterior Windows, Curtain Walls, and Doors by Uniform Static Air Pressure Difference
 - F468-06.....Nonferrous Bolts, Hex Cap Screws, and Studs for General Use
 - F593-04.....Stainless Steel Bolts, Hex Cap Screws, and Studs
- C. National Association of Architectural Metal Manufacturers (NAAMM):
 - AMP 500 Series.....Metal Finishes Manual
- D. American Architectural Manufacturer's Association (AAMA):
 - 2604-05.....High Performance Organic Coatings on Architectural Aluminum Extrusions and Panels
- E. American Welding Society (AWS):
 - D1.2-03.....Structural Welding Code Aluminum

1.7 PERFORMANCE REQUIREMENTS:

- A. Shapes and thickness of framing members shall be sufficient to withstand a design wind load of not less than 1.4 kilopascals (30

pounds per square foot) of supported area with a deflection of not more than 1/175 times the length of the member and a safety factor of not less than 1.65 (applied to overall load failure of the unit). Provide glazing beads, moldings, and trim of not less than 1.25 mm (0.050 inch) nominal thickness.

- B. Air Infiltration: When tested in accordance with ASTM E 283, air infiltration shall not exceed 2.63×10^{-5} cm per square meter (0.06 cubic feet per minute per square foot) of fixed area at a test pressure of 0.30 kPa (6.24 pounds per square foot) 80 kilometers (50 mile) per hour wind.
- C. Water Penetration: When tested in accordance with ASTM E 331, there shall be no water penetration at a pressure of 0.38 kPa (8 pounds per square foot) of fixed area.

PART 2 - PRODUCTS

2.1 MATERIALS:

- A. Aluminum, ASTM B209 and B221:
 - 1. Alloy 6063 temper T5 for doors, door frames, fixed glass sidelights storefronts and transoms.
 - 2. For color anodized finish, use aluminum alloy as required to produce specified color.
- B. Thermal Break: Manufacturer standard low conductive material retarding heat flow in the framework, where insulating glass is scheduled.
- C. Fasteners:
 - 1. Aluminum: ASTM F468, Alloy 2024.
 - 2. Stainless Steel: ASTM F593, Alloy Groups 1, 2 and 3.

2.2 FABRICATION:

- A. Fabricate doors, of extruded aluminum sections not less than 3 mm (0.125 inch) thick. Fabricate glazing beads of aluminum not less than 1.0 mm (0.050 inch) thick.
- B. Accurately form metal parts and accurately fit and rigidly assemble joints, except those joints designed to accommodate movement. Seal joints to prevent leakage of both air and water.
- C. Make welds in aluminum in accordance with the recommended practice AWA D1.2. Use electrodes and methods recommended by the manufacturers of the metals and alloys being welded. Make welds behind finished surfaces so as to cause no distortion or discoloration of the exposed side. Clean welded joints of welding flux and dress exposed and contact surfaces.

- D. Make provisions in doors and frames to receive the specified hardware and accessories. Coordinate schedule and template for hardware specified under Section 08 71 00, DOOR HARDWARE. Where concealed closers or other mechanisms are required, provide the necessary space, cutouts, and reinforcement for secure fastening.
- E. Fit and assemble the work at the manufacturer's plant. Mark work that cannot be permanently plant-assembled to assure proper assembly in the field.

2.3 PROTECTION OF ALUMINUM:

- A. Isolate aluminum from contact with dissimilar metals other than stainless steel, white bronze, or zinc by any of the following:
 - 1. Coat the dissimilar metal with two coats of heavy-bodied alkali resistant bituminous paint.
 - 2. Place caulking compound, or non-absorptive tape, or gasket between the aluminum and the dissimilar metal.
 - 3. Paint aluminum in contact with mortar, concrete and plaster, with a coat of aluminum paint primer.

2.4 FRAMES:

- A. Fabricate doors, frames, mullions, transoms, frames for fixed glass and similar members from extruded aluminum not less than 3 mm (0.125 inch) thick.
- B. Provide integral stops and glass rebates and applied snap-on type trim.
- C. Use concealed screws, bolts and other fasteners. Secure cover boxes to frames in back of all lock strike cutouts.
- D. Fabricate framework with thermal breaks in frames where insulating glass is scheduled and specified under Section 08 80 00, GLAZING.

2.5 STILE AND RAIL DOORS:

- A. Nominal 45 mm (1-3/4 inch) thick, with stile and head rail 90 mm (3-1/2 inches) wide, and bottom rail 250 mm (10 inches) wide.
- B. Bevel single-acting doors 3 mm (1/8 inch) at lock, hinge and meeting stile edges. Provide clearances of 2 mm (1/16 inch) at hinge stiles, 3 mm (1/8 inch) at lock stiles and top rails, and 5 mm (3/16 inch) at floors and thresholds. Form glass rebates integrally with stiles and rails. Glazing beads may be formed integrally with stiles and rails or applied type secured with fasteners at 150 mm (six inches) on centers.
- C. Construct doors with a system of welded joints or interlocking dovetail joints between stiles and rails. Clamp door together through top and bottom rails with 9 mm (3/8 inch) primed steel rod extending into the

stiles, and having a self-locking nut and washer at each end. Reinforce stiles and rails to prevent door distortion when tie rods are tightened. Provide a compensating spring-type washer under each nut to take up any stresses that may develop. Construct joints between rails and stiles to remain rigid and tight when door is operated.

- D. Weather-stripping: Provide removable, woven pile type (silicone-treated) weather-stripping attached to aluminum or vinyl holder. Make slots for applying weather-stripping integral with doors and door frame stops. Apply continuous weather-stripping to heads, jambs, bottom, and meeting stiles of doors and frames. Install weather-stripping so doors can swing freely and close positively.

2.6 REINFORCEMENT FOR BUILDERS HARDWARE:

- A. Fabricate from stainless steel plates.
- B. Hinge and pivot reinforcing: 4.55 mm (0.1793 inch) thick.
- C. Reinforcing for lock face, flush bolts, concealed holders, concealed or surface mounted closers: 2.66 mm (0.1046 inch) thick.
- D. Reinforcing for all other surface mounted hardware: 1.5 mm (0.0598 inch) thick.

2.7 FINISH

- A. In accordance with NAAMM AMP 500 series.
- B. Anodized Aluminum:
 - 1. Clear Finish: Chemically etched medium matte, with clear anodic coating, Class I Architectural, 7 mils thick.
 - 2. Color Finish: Chemically etched medium matte, with integrally colored anodic coating, Class I Architectural, 7 mils thick. More than 50 percent variation of the maximum shade range approved will not be accepted in a single component or in adjacent components, stiles, and rails on a continuous series.
- C. Fluorocarbon Finish: AAMA 605.2, high performance coating.

PART 3 - EXECUTION

3.1 INSTALLATION:

- A. Allowable Installation Tolerances: Install work plumb and true, in alignment and in relation to lines and grades shown. Variation of 3 mm (1/8 inch) in 2400 mm (eight feet), non-accumulative, is maximum permissible for plumb, level, warp, bow and alignment.
- B. Anchor aluminum frames to adjoining construction at heads, jambs and bottom and to steel supports, and bracing. Anchor frames with stainless steel or aluminum countersunk flathead, expansion bolts or machine

screws, as applicable. Use aluminum clips for internal connections of adjoining frame sections.

- C. Where work is installed within masonry or concrete openings, place no parts other than built-in anchors and provision for operating devices located in the floor, until after the masonry or concrete work is completed.
- D. Install hardware specified under Section 08 71 00, DOOR HARDWARE.
- E. Install hung door operators specified under Section 08 71 13, AUTOMATIC DOOR OPERATORS.

3.2 ADJUSTING:

After installation of entrance and storefront work is completed, adjust and lubricate operating mechanisms to insure proper performance.

3.3 PROTECTION, CLEANING AND REPAIRING:

Remove all mastic smears and other unsightly marks, and repair any damaged or disfiguration of the work. Protect the installed work against damage or abuse.

- - - E N D - - -

**SECTION 08 44 13
GLAZED ALUMINUM CURTAIN WALLS**

PART 1 - GENERAL

1.1 DESCRIPTION

- A. Section specifies glazed aluminum curtain wall system.
 - 1. Thermally isolated, pressure equalized on interior.
 - 2. Type: Unit and Mullion system to include following:
 - a. Glass Spandrel Panels.
 - b. Integral reinforcing.
 - c. Closures, trim, subsills and flashings.
 - d. Column covers.
 - e. Fasteners, anchors, and related reinforcement.

1.2 RELATED WORK

- A. Structural steel: Section 05 12 00, STRUCTURAL STEEL FRAMING.
- B. Miscellaneous metal members: Section 05 50 00, METAL FABRICATIONS.
- C. Firestopping between curtain wall and structure: Section 07 84 00, FIRESTOPPING.
- D. Sheet metal flashing and trim: Section 07 60 00, FLASHING AND SHEET METAL.
 - a. Joint sealants: Section 07 92 00, JOINT SEALANTS.
- E. Aluminum and glass hinged entry doors and storefront construction: Section 08 41 13, ALUMINUM-FRAMED ENTRANCES AND STOREFRONTS.

1.3 QUALITY ASSURANCE

- A. Qualifications:
 - 1. Approval is required of products or service of proposed manufacturer, suppliers and installers, and will be based upon submission by Contractor of certification that:
 - a. Manufacturers Qualifications: Manufacturer with five (5) years continuous documented experience in design, fabrication, and installation of glazed aluminum curtain wall systems of type and size required for that project.
 - b. Installer: Manufacturer approved in writing. Continuously installed glazed aluminum curtain walls systems for previous five (5) years.
 - c. Manufacturer shall provide technical field representation at project site, as a minimum, at start of project, during middle,

towards end of project, and during field testing of field mockup panel.

- d. Testing Laboratory: Contractor retained. Engage an AAMA accredited commercial testing laboratory to perform tests specified. Submit information regarding testing laboratory's facilities and qualifications of technical personnel to perform testing specified in this section.
- e. Product Options: Information on Drawings and in Specifications establishes requirements for aesthetic effects and performance characteristics of glazed aluminum curtain wall system. Aesthetic effects are indicated by dimensions, arrangements, alignment, and profiles of components and assemblies as they relate to sightlines, one another, and adjoining construction. Performance characteristics are indicated by criteria subject to verification by one or more methods including preconstruction testing, field testing, or in-service performance.
 - 1) Do not modify intended aesthetic effects. If modifications are proposed, submit comprehensive explanatory data for review.
- f. Qualification of Welders:
 - 1) Welding shall be performed by certified welders qualified in accordance with AWS D1.2, using procedures, materials, and equipment of the type required for this work.

B. Pre-Installation Conference

- 1. Prior to starting installation of glazed curtain wall system schedule conference with Contracting Officer to ensure following:
 - a. Clear understanding of drawings and specifications.
 - b. Onsite inspection and acceptance of structural and pertinent structural details relating to curtain wall system.
 - c. Coordination of work of various trades involved in providing system. Conference shall be attended by Contractor; personnel directly responsible for installation of curtain wall system, flashing and sheet metal work, firestopping system and curtain wall manufacturer and their Technical Field Representatives. Conflicts shall be resolved and confirmed in writing.

1.4 SUBMITTALS

- A. In accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturer's Literature and Product Data:

1. Manufacturer's standard details and fabrication methods.
 2. Data on finishing, components, and accessories.
 3. Instructions: Submit descriptive literature, detail specifications, available performance test data and instructions for installation, and adjustments.
 4. Recommendations for maintenance and cleaning of exterior surfaces.
- C. Shop Drawings:
1. Show elevations of glazed curtain wall system at 1:50 (1/4 inch) scale, metal gages, details of construction, methods of anchorage, glazing details, and details of installation.
 2. Submit for curtain wall system, accessories, and mock-up. Tentative approval of drawings shall be received before fabrication of mock-up. Final approval of drawings shall be deferred pending approval of mock-up and accessories. Drawings shall indicate in detail all system parts including elevations, full size sections, framing, jointing, panels, types and thickness of metal anchorage details, flashing and coping details, field connections, weep and drainage system, finishes, sealing methods, glazing, glass sizes and details, firestopping insulation materials, and erection details.
 3. Operation and Maintenance Manuals
 - a. Submit cleaning and maintenance instructions.
- D. Samples:
1. Submit pairs of samples of each specified color and finish on 300 mm (12-inch) long section by width of each tubular, or extruded shape section or 300 mm by 300 mm (12-inch by 12-inch) wide sections of sheet shapes.
 2. Submit corner section of framing members showing fasteners, panels, glazing methods, glazing materials, and weather-stripping. Submit one sample minimum 300 mm by 300 mm (12 inches by 12 inches). In lieu of submitting separate samples for corner section, intermediate section, and panel, one composite sample incorporating all components and features listed may be submitted.
 3. Where normal color variations are anticipated, include 2 or more units in set indicating extreme limits of color variations.
- E. Glass:
1. Specified in Section 08 80 00, GLAZING.
- F. Quality Control Submittals:
1. Design Data:

- a. Submit structural and thermal calculations for complete wall assembly. Structural calculations and design shop drawings shall be signed and sealed by a structural engineer registered in state in which project is to be located.

2. Factory Test Reports:

- a. Test Reports: Provide certified test reports, for each of following listed tests, from a qualified independent testing laboratory showing that glazed aluminum curtain wall system assembly has been tested in accordance with specified test procedures and complies with performance characteristics as indicated by manufacturer's testing procedures. Manufacturer shall submit appropriate testing numbers for specific tests indicated below.
 - 1) Deflection and structural tests.
 - 2) Water penetration tests.
 - 3) Air infiltration tests.
 - 4) Delamination tests.
 - 5) Thermal conductance tests.

G. Manufacturer's Certificates:

1. Submit Certificates of Compliance, with specification requirements, for the following:
 - a. Metal extrusions.
 - b. Metal accessories.
 - c. Stating that aluminum has been given specified thickness of anodizing or organic coating finish.
 - d. Indicating manufacturer's and installer's meet qualifications as specified.
 - e. Submit list of equivalent size installations, for both manufacturer and installer, which have had satisfactory and efficient operation.

H. Manufacturer's Field Reports:

1. Submit field reports of manufacturer's field representative observations of curtain wall installation indicating observations made during inspection at beginning of project, during middle of installation and at conclusion of project. Indicate results of field testing of mockup field panel, and any directions given Contractor for corrective action.

1.5 DELIVERY, STORAGE AND HANDLING

- A. Refer to AAMA CW 10 for care and handling of architectural aluminum from shop to site.
- B. Prior to packaging for shipment from factory, mark wall components to correspond with shop and erection drawings and their placement location and erection.
- C. Prior to shipment from factory, place knocked-down lineal members in cardboard containers and cover finished surfaces of members with protective covering of adhesive paper, waterproof tape, or strippable plastic. Do not cover metal surfaces that will be in contact with sealants after installation.
- D. Inspect materials delivered to site for damage; unload and store with ventilation, free from heavy dust, not subject to combustion products or sources of water, and shall permit easy access for inspection and handling. Sealing and caulking compounds, including handling, shall be in accordance with requirements of Section 07 92 00 JOINT SEALANTS.

1.6 PROJECT CONDITIONS

Field Measurements: Where glazed aluminum curtain wall systems are indicated to fit to other construction, verify dimensions of other construction by field measurements before fabrication and indicate measurements on Shop Drawings. Coordinate fabrication schedule with construction progress to avoid delaying Work.

1.7 APPLICABLE PUBLICATIONS

- A. Publications listed below form a part of this specification to extent referenced. Publications are referred to in text by basic designation only.
- B. American Architectural Manufacturers Association (AAMA):
 - MCWM-1-89.....Metal Curtain Wall Manual
 - CW 10-04.....Care and Handling of Architectural Aluminum
from Shop to Site
 - CW 11-85.....Design Windloads for Buildings and Boundary
Layer Wind Tunnel Testing
 - CW 13-85.....Structural Sealant Glazing Systems (A Design
Guide)
 - CWG 1-89.....Installation of Aluminum Curtain Walls
 - TIR A1-04.....Sound Control for Aluminum Curtain Walls and
Windows

- TIR A4-97.....Recommended Guide Lines for Reflective
Insulating Glass
- TIR A8-04.....Structural Performance of Poured and Debridged
Framing Systems
- TIR A9-91.....Metal Curtain Wall Fasteners
- TIR A11-96.....Maximum Allowable Deflection of Framing Systems
for Building Cladding Components of Design Wind
Loads
- 101-I.S.2/A440-05.....Windows, Doors and Unit Skylights
- 501-05.....Methods of Test for Exterior Walls
- 503-03.....Field Testing of Metal Storefronts, Curtain
walls and Sloped Glazing Systems
- 605-98.....High Performance Organic Coatings on
Architectural Extrusions and Panels
- 1503-98.....Thermal Transmission and Condensation
Resistance of Windows, Doors and Glazed Wall
Sections
- C. American National Standards Institute (ANSI):
- Z97.1-04.....Glazing Materials Used in Buildings, Safety
Performance Specifications and Methods of Test
- D. American Society of Civil Engineers (ASCE):
- 7-02-2003.....Minimum Design Loads for Buildings and Other
Structures
- E. American Society for Testing and Materials (ASTM):
- A36/A36M-05.....Structural Steel
- A123-02.....Zinc (Hot-Dip Galvanized) Coatings on Iron and
Steel Products
- A193-05.....Alloy-Steel and Stainless Steel Bolting
Materials for High Temperature Service
- A307-04.....Carbon Steel Bolts and Studs, 60,000 PSI
Tensile Strength
- B209-04.....Aluminum and Aluminum Alloy Sheet and Plate
- B211-03.....Aluminum and Aluminum Alloy Bar, Rod, Wire
- B221/B221M-05.....Aluminum and Aluminum Alloy Extruded Bars,
Rods, Wire, Shapes and Tubes
- B316/B316M-02.....Aluminum and Aluminum Alloy Rivet and Cold-
Heading, Wire, and Rods
- C578-05.....Rigid Cellular Polystyrene Thermal Insulation

- C612-04.....Mineral Fiber Block and Board Thermal
Insulation
- C920-05.....Elastomeric Joint Sealants
- C794-93.....Standard Test Method for Adhesion-In-Peel of
Elastomeric Joint Sealants.
- C1363-05.....Thermal Performance of Building Materials and
Envelope Assemblies by Means of a Hot Box
Apparatus
- D1037-99.....Evaluating the Properties of Wood-Base Fibers
and Particle Panel Materials
- E84-05.....Surface Burning Characteristics of Building
Materials
- E90-04.....Laboratory Measurement of Airborne Sound
Transmission Loss of Building Partitions and
Elements
- E283-04.....Determining Rate of Air Leakage Through
Exterior Windows, Curtain Walls, and Doors
under Specified Pressure Difference Across this
Specification
- E330-02.....Structural Performance of Exterior Windows,
Curtain Walls, and Doors by Uniform Static Air
Pressure Difference
- E331-00.....Water Penetration of Exterior Windows, Curtain
Walls, and Doors By Uniform Static Air Pressure
Difference
- E413-04.....Classification for Rating Sound Insulation
- E783-02.....Test Method for Field Measurement of Air
Leakage Through Installed Exterior Windows and
Doors.
- E1105-00.....Field Determination of Water Penetration of
Installed Exterior Windows, Curtain Walls, and
Doors By Uniform or Cyclic Static Air Pressure
Differences
- F. American Welding Society, Inc. (AWS):
- D1.2-03.....Structural Welding Code-Aluminum
- G. Consumer Product Safety Commission (CPSC):
- 16 CFR 1201.....Architectural Glazing Standards and Related
Material

H. Federal Specifications (FS):

TT-P-645B-90.....Primer, Paint, Zinc-Molybdate, Alkyd Type

I. Glass Association of North America (GANA):

01.....Glazing Manual (1997 Edition).

02.....Sealant Manual (1990 Edition).

03.....Laminated Glass Design Guide (2000 Edition).

04.....Tempered Glass Engineering Standard Manual
(2001 Edition).

J. Military Specifications (MIL):

MIL-C-18480.....(Rev. B) Coating Compound, Bituminous Solvent,
Coal Tar Base

K. National Association of Architectural Metal Manufacturers (NAAMM):

500 Series (1988).....Metal Finishes Manual.

L. Steel Structures Painting Council (SSPC)

Paint 25-97 (2004).....Red Iron Oxide Raw Linseed Oil and Alkyd Primer
(Without Lead and Chromate Pigments)

1.8 WARRANTY

A. Submit manufacturer's written warranty for materials, installation and weathertightness, and subject to terms of "Warranty of Construction", FAR clause 52.246-21, except that warranty period shall be extended to five (5) years from date of final acceptance of project by Government.

PART 2 - PRODUCTS**2.1 SYSTEM DESCRIPTION**

A. Design Requirements:

1. Curtain Wall System: Tubular aluminum sections with thermal break condition self supporting framing, factory prefinished, vision glass, spandrel infill and related flashings, anchorage and attachment devices.
2. No curtain wall framing member shall deflect, in a direction normal to plane of wall, more than 1/175 of its clear span or 20 mm (3/4 inch), whichever is less, when designed in accordance with requirements of TIR A11 and tested in accordance with ASTM E330, except that when a gypsum wallboard surface will be affected, deflection shall not exceed 1/360 of span. No framing member shall have a permanent deformation in excess of 0.2 percent of its clear span when tested in accordance with ASTM E330 for a minimum test period of 10 seconds at 1.5 times design wind pressures indicated as part of structural drawing wind load requirements. No glass

breakage, damage to fasteners, hardware or accessories shall be permitted due to deformation stated above:

- a. Provide system complete with framing, mullions, trim, fasteners, anchors, accessories, concealed auxiliary members, and attachment devices for securing wall to structure as specified or indicated. Unless noted otherwise, comply with MCWM-1.
 - b. Curtain wall system components shall be furnished by one manufacturer or fabricator; however, all components need not be products of same manufacturer.
 - c. Fully coordinate system accessories directly incorporated, and adjacent to contiguous related work and insure materials compatibility, deflection limitations, thermal movements, and clearances and tolerances as indicated or specified.
 - d. Provide system with adequate allowances for expansion and contraction of components and fastenings to prevent buckling damage, joint seal failure, glass breakage, undue stress on fastenings or other detrimental effects. For design purposes, base provisions for thermal movement on assumed ambient temperature range of from -18 degrees C to 49 degrees C (0 degrees F to 120 degrees F).
 - e. Provide wall system to accommodate tolerances in building frame and other contiguous work as indicated or specified.
- B. Manufacturer's Professional Engineer Qualifications: A professional engineer who is legally qualified to practice in jurisdiction where Project is located and who is experienced in providing engineering services of kind indicated. Engineering services are defined as those performed for installations of curtain walls that are similar to those indicated for this Project in material, design, and extent.
- C. Performance Requirements:
1. System shall meet or exceed all performance requirements specified.
 2. Curtain wall components shall have been tested in accordance with requirements below and shall meet performance requirements specified:
 3. System Design: Design and size components to withstand dead loads and live loads caused by positive and negative wind loads acting normal to plane of wall as calculated in accordance with ASCE 7- Minimum Design Loads for Buildings and Other Structures as measured in accordance with ASTM E330.

4. Seismic Loads: Design and size components to withstand seismic loads and sway displacement as calculated in accordance with applicable building codes.
5. Water Penetration:
 - a. No water penetration shall occur when wall is tested in accordance with ASTM E331 at a differential static test pressure of 20 percent of inward acting design wind pressure as indicated on structural drawings, but not less than 479 Pa (10 psf).
 - b. Make provision in wall construction for adequate drainage to outside of water leakage or condensation that occurs within outer face of wall. Leave drainage and weep openings in members and wall open during test.
6. Air Infiltration: Test glazed aluminum curtain wall system according to AAMA 503, which requires testing according to ASTM E783
 - a. Static-Air-Differential: 75 Pa (1.57 lbf/sq. ft.) minimum.
 - b. Air Leakage: 0.03 L/s per sq. m (0.06 cfm/sq ft) of surface maximum.
7. Deflections Test: ASTM E330, Procedure B:
 - a. No member shall deflect in a direction parallel to plane of wall, when carrying its full design load, more than an amount which will reduce edge cover or glass bite below 75 percent of design dimension. No member after deflection under full design load, shall have a clearance between itself and top of panel, glass, sash, or other part immediately below it less than 3 mm (1/8 inch); clearance between member and an operable window or door shall be minimum 1.5 mm (1/16 inch).

2.2 MATERIALS

- A. Extruded Aluminum Framing Members: ASTM B221M; 6063-T5 extruded aluminum for non-structural components or 6063-T6 extruded aluminum for structural members; temper and alloy as recommended by manufacturer.
- B. Sheet Aluminum: ASTM B209M; 6065-T5 temper and alloy as recommended by manufacturer.
 1. Formed flashing and closures: Minimum 1.58 mm (0.062 inch) thick aluminum, in finish as selected.
 2. Extruded sill members: Minimum 1.58 mm (0.062 inch) thick aluminum, in finish as selected.
- C. Steel Sections: ASTM A36M.
- D. Primer: TS TT-P-645; red, for shop application and field touch-up.

E. Fasteners:

1. For Exterior Cap Retainers: ASTM A193 B8 300 series, stainless steel screws.
2. For Framework Connections: ASTM B211M 2024-T4 aluminum, ASTM A193 B8 300 series, stainless steel, and ASTM B316 aluminum rivets, as required by connection.
3. For Anchoring Glazed Aluminum Curtain Wall to Support Structure: ASTM A307 zinc plated steel fasteners.

F. Shims: Metal or plastic.

G. Joint Sealants and Accessories:

1. In accordance with requirements specified in Section 07 92 00, JOINT SEALANTS.
2. Structural Flush Glazed Joints: High performance silicone sealant applied in accordance with manufacturer's recommendations.
3. Non-structural Flush Glazed Joints and Weather Seal Joints: Silicone sealants applied in accordance with manufacturer's recommendations.
4. Structural silicone sealant performance requirements: ASTM C920.
 - a. Hardness: Type A, 30 durometer.
 - b. Ultimate Tensile Strength: 1172 kPa (170 psi).
 - c. Tensile at 150% Elongation: 55 kPa (80 psi).
 - d. Joint Movement Capability after 14 Day Cure: +/- 50%.
 - e. Peel Strength aluminum, after 21 Day Cure: 599 g/mm (34 pounds per inch).
5. Structural silicone shall not be used to support dead weight of vertical glass or panels.
6. Comply with recommendations of sealant manufacturer for specific sealant selections.
7. Provide only sealants that have been tested per ASTM C794 to exhibit adequate adhesion to samples of glass and metal equivalent to those required for project.
8. Exposed metal to metal joints: Silicone sealant selected from manufacturer's standard colors.

H. Glazing Materials:

1. As specified under Section 08 80 00, GLAZING.
2. Glazing Gaskets:
 - a. Exterior: Continuous EPDM gaskets at each glass and spandrel panel.

- b. Interior: Continuous, closed cell PVC foam sealant tape, sealed at corners.
- 3. Glass Sizes and Clearances:
 - a. Accommodate up to 25 mm (1 inch) glazing.
 - b. Sizes indicated are nominal. Verify actual sizes required by measuring frames. Coordinate dimensions for glass and glass holding members to meet applicable minimum clearances as recommended by glass manufacturer. Do not nip glass to remove flares or to reduce oversized dimensions. All cutting shall occur in factory.
- 4. Glass Setting Materials:
 - a. Provide head bead and drive wedge required for glass installation to suit curtain wall system in accordance with manufacture's recommendations.
 - b. If used in psychiatric facilities, the glass shall be retained in the framing system in such a manner that it can withstand lateral forces in excess of force required to break the glass. Plastic clips for holding glass are not permitted.
- I. Column Covers Exterior and Interior Surfaces: manufacturer's standard material thickness full contact pressure bonded to ensure flat surface, finish to match curtain wall mullion sections.
- J. Firestopping: Refer to Section 07 84 00, FIRESTOPPING for requirements.

2.3 FABRICATION

- A. Curtain wall components shall be of materials and thickness indicated or specified. Details indicated are representative of required design and profiles. Maintain sightlines indicated on drawings. Unless specifically indicated or specified otherwise, methods of fabrication and assembly shall be at discretion of curtain wall manufacturer. Perform fitting and assembling of components in shop to maximum extent practicable. Anchorage devices shall permit adjustment in three directions. There shall be no exposed fasteners.
- B. Joints: Joints exceeding +1.5 mm (+1/16 inch) shall be mechanically fastened.
- C. Ventilation and Drainage: Direct water leakage to exterior by means of concealed drainage system and weeps. Flashings and other materials used internally shall be nonstaining, noncorrosive, and nonbleeding.
- D. Protection and Treatment of Metals:

1. Remove from metal surfaces lubricants used in fabrication and clean off other extraneous material before leaving shop.
 2. Provide protection against galvanic action wherever dissimilar metals are in contact, except in case of aluminum in permanent contact with galvanized steel, zinc, stainless steel, or relatively small areas of white bronze. Paint contact surfaces with one coat bituminous paint conforming to MIL-C-18480 or apply appropriate caulking material or nonabsorptive, noncorrosive, and nonstaining tape or gasket between contact surfaces.
- E. Metal sills and Closures: Fabricate accessories, spandrel panels, trim closures of sizes and shapes indicated from similar materials and finish as specified for wall system.
- F. Concealed Interior Mullion Reinforcing: ASTM A36M steel shapes as required for strength and mullion size limitations, hot dip galvanized after fabrication in accordance with ASTM A123.

2.4 PROTECTION

- A. Provide protection for aluminum against galvanic action, wherever dissimilar materials are in contact, by painting contact surfaces of dissimilar material with a heavy coat of bituminous paint (complete coverage), or by separating contact surfaces with a preformed neoprene tape having pressure sensitive adhesive coating on one side.

2.5 METAL FINISHES

- A. In accordance with NAAMM AMP500 series.
- B. Fluorocarbon Finish: AAMA 605.2.
1. Color as selected by Architect.
- C. Concealed Steel Items: Galvanized in accordance with ASTM A123 to 610.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Prior to installation of glazed curtain wall system, arrange for representative(s) of manufacturer to examine structure and substrate to determine that they are properly prepared, and ready to receive glazed curtain wall work included herein.
- B. Verifying Conditions and Adjacent Surfaces: After establishment of lines and grades and prior to system installation examine supporting structural elements. Verify governing dimensions, including floor elevations, floor to floor heights, minimum clearances between curtain wall and structural frames, and other permissible dimensional tolerances in building frame.

3.2 PREPARATION

- A. Take field dimensions and examine condition of substrates, supports, and other conditions under which work of this section is to be performed to verify that work may properly commence. Do not proceed with installation until unsatisfactory conditions have been corrected.
- B. Contact between aluminum and dissimilar metals shall receive a protective coating of asphaltic paint for prevention of electrolytic action and corrosion.

3.3 INSTALLATION

- A. Installation and erection of glazed curtain wall system and all components shall be in accordance with written directions of curtain wall manufacturer. Match profiles, sizes, and spacing indicated on approved shop drawings.
- B. Bench Marks and Reference Points: Establish and permanently mark bench marks for elevations and building line offsets for alignment at convenient points on each floor level. Should any error or discrepancy be discovered in location of marks, stop erection work in that area until discrepancies have been corrected.
- C. Ensure that drainage system operates properly in accord with AAMA 501 procedures.
- D. Do not proceed with structural silicone work when metal temperature is below 0 degrees C (32 degrees F).
- E. Isolate between aluminum and dissimilar metals with protective coating or plastic strip to prevent electrolytic corrosion.
- F. Install glazed aluminum curtain wall system so as to maintain a virtually flat face cap, with no visible bowing.
- G. Install entire system so that fasteners are not visible.
- H. Tolerances:
 - 1. Maximum variation from plane or location shown on approved shop drawings: 3 mm per 3600 mm (1/8 inch per 12 feet) of length up to not more than 13 mm (1/2 inch) in any total length.
 - 2. Maximum offset from true alignment between two identical members abutting end to end in line: 0.8 mm (1/32 inch).
 - 3. Sealant Space Between Curtain Wall Mullion and Adjacent Construction: Maximum of 19 mm (3/4 inch) and minimum of 6 mm (1/4 inch).
- I. Joint Sealants:

1. Joint Sealants: Shall be in accordance with requirements of Section 07 92 00, JOINT SEALANTS.
2. Surfaces to be primed and sealed shall be clean, dry to touch, free from frost, moisture, grease, oil, wax, lacquer, paint, or other foreign matter. Enclose joints on three sides. Clean out grooves to proper depth. Joint dimensions shall conform to approved detail drawings with a tolerance of plus 3 mm (1/8 inch). Do not apply compound unless ambient temperature is between 5 and 35 degrees C (40 and 90 degrees F). Clean out loose particles and mortar just before sealing. Remove protective coatings or coverings from surfaces in contact with sealants before applying sealants or tapes. Solvents used to remove coatings shall be of type that leave no residue on metals.
3. Match approved sample. Force compound into grooves with sufficient pressure to fill grooves solidly. Sealing compound shall be uniformly smooth and free of wrinkles and, unless indicated otherwise, shall be tooled and left sufficiently convex to result in a flush joint when dry. Do not trim edges of sealing material after joints are tooled. Mix only amount of multi-component sealant which can be installed within four hours, but at no time shall this amount exceed 19 liters (5 gallons).
4. Apply primer to masonry, concrete, wood, and other surfaces as recommended by sealant manufacturer. Do not apply primer to surfaces which will be exposed after caulking is completed.
5. Tightly pack backing in bottom of joints which are over 13 mm (1/2 inch) in depth with specified backing material to depth indicated or specified. Roll backing material of hose or rod stock into joints to prevent lengthwise stretching.
6. Install bond preventive material at back or bottom of joint cavities in which no backstop material is required, covering full width and length of joint cavities.
7. Remove compound smears from surfaces of materials adjacent to sealed joints as work progresses. Use masking tape on each side of joint where texture of adjacent material will be difficult to clean. Remove masking tape immediately after filling joint. Scrape off fresh compound from adjacent surfaces immediately and rub clean with approved solvent. Upon completion of caulking and sealing, remove

remaining smears, stains, and other soiling, and leave work in clean neat condition.

J. Glass:

1. Refer to Section 08 80 00, GLAZING, and drawing for glass types. Install in accordance with manufacturer's recommendations as modified herein.
2. Before installing glass, inspect sash and frames to receive glass for defects such as dimensional variations, glass clearances, open joints, or other conditions that will prevent satisfactory glass installation. Do not proceed with installation until defects have been corrected.
3. Clean sealing surfaces at perimeter of glass and sealing surfaces of rebates and stop beads before applying glazing compound, sealing compound, glazing tape, or gaskets. Use only approved solvents and cleaning agents recommended by compound or gasket manufacturer. All sashes shall be designed for outside glazing. Provide continuous snap in glazing beads to suit glass as specified.
4. Insulating and tempered glass, and glass of other types that exceed 100 united inches in size: Provide void space at head and jamb to allow glass to expand or move without exuding sealant. Perimeter frames and ventilator sections shall have glazing rebates providing an unobstructed glazing surface 19 mm (3/4 inch) in height. Glazing rebate surfaces must be sloped to shed water.
5. Provide adequate means to weep incidental water and condensation away from sealed edges of insulated glass units and out of wall system. Weeping of lock-strip gaskets should be in accordance with recommendation of glass manufacturer.

K. Metal Copings:

1. Refer to Section 07 60 00, FLASHING AND SHEET METAL for requirements of metal copings when they are not a part of glazed curtain wall system work.
2. Coordinate curtain wall installation with metal coping detail on contract drawings. Provide watertight seal to meet criteria set forth in this section regarding air and water penetration.

3.4 CLEANING

- A. Install curtain wall frame and associated metal to avoid soiling or smudging finish.

- B. Clean metal surfaces promptly after installation, exercising care to avoid damage to coatings.
- C. Remove excess glazing and sealant compounds, dirt, and other substances.
- D. Follow recommendations of manufacturer in selection of cleaning agents. Do not use cleaning agents containing ammonia or other compounds that might damage finished metal surfaces.
- E. Replace cracked, broken, and defective glass with new glass at no additional cost to Government. Just prior to final acceptance of curtain wall system clean glass surfaces on both sides, remove labels, paint spots, compounds, and other defacements, and clean metal fixed panels. Remove and replace components that cannot be cleaned successfully.

3.5 FIELD QUALITY CONTROL

- A. Testing Agency: Engage an AAMA accredited commercial qualified independent testing and inspecting agency to perform field quality-control tests specified, and to prepare test reports: Submit information regarding testing laboratory's facilities and qualifications of technical personnel to Contracting Officer for approval.
- B. Conduct field check test for water leakage on designated wall areas after erection to comply with MCWM-1. Conduct test on two wall areas, two bays wide by two stories high where directed. Conduct test and take necessary remedial action as directed by COTR.
- C. Test Specimen:
 - 1. Test specimen shall include curtain wall assembly and construction. Test chamber shall be affixed to exterior side of test specimen and test shall be conducted using positive static air pressure.
 - 2. Test specimens shall be selected by Contracting Officer after curtain wall system has been installed in accordance with contract drawings and specification.
- D. Sealant Adhesion Tests: Test installed sealant, in presence of sealant manufacturer's field representative, in a minimum of two areas and as follows:
 - 1. Test weatherseal sealant as recommended in writing by sealant manufacturer.
- E. Air Infiltration: Test glazed aluminum curtain wall system according to AAMA 503, which requires testing according to ASTM E783.

1. Field air leakage testing is not required for continuous curtain wall systems.
 2. Static-Air-Pressure Differential: 75 Pa (1.57 lbf/sq. ft.) minimum.
 3. Air Leakage: 0.03 L/s per sq. m (0.06 cfm/sq. ft.) of surface maximum.
- F. Water Penetration: Test glazed aluminum curtain wall system for compliance with requirements according to AAMA 503, which requires testing according to ASTM E1105.
1. Uniform Static-Air-Pressure Difference: 20 percent of positive design wind load, but not less than 479 Pa (10 psf). No uncontrolled water shall be present.
- G. Retesting:
1. Should system fail field test, system may be modified or repaired, and retested.
 2. Should system fail second field test, system may be additionally modified or repaired, and retested.
 3. All modifications and repairs made to tested areas shall be recorded, and same modifications and repairs made to all system and adjacent construction on project.
 4. Should second test fail, COTR may require testing of additional areas of the curtain wall.
- H. Rejection:
1. Failure of any of specimens to meet test requirements of third test shall be cause for rejection of wall system and adjacent construction on project.

3.6 PROTECTION

- A. After installation, protect windows, and other exposed surfaces from disfiguration, contamination, contact with harmful materials, and from other construction hazards that will interfere with their operation, or damage their appearance or finish. Protection methods shall be in accordance with recommendations of product manufacturers or of respective trade association. Remove paper or tape factory applied protection immediately after installation. Clean surfaces of mortar, plaster, paint, smears of sealants, and other foreign matter to present neat appearance and prevent fouling of operation. In addition, wash with a stiff fiber brush, soap and water, and thoroughly rinse. Where surfaces become stained or discolored, clean or restore finish in

accordance with recommendations of product manufacturer or respective
trade association.

- - - END - - -

**SECTION 08 71 00
DOOR HARDWARE**

PART 1 - GENERAL

1.1 DESCRIPTION

- A. Door hardware and related items necessary for complete installation and operation of doors.

1.2 RELATED WORK

- A. Caulking: Section 07 92 00 JOINT SEALANTS.
- B. Application of Hardware: Section 08 21 00, THERMAL FUSED FLUSH DOORS; Section 08 11 13, HOLLOW METAL DOORS AND FRAMES; Section 08 41 13, ALUMINUM-FRAMED ENTRANCES AND STOREFRONTS.
- C. Finishes: Section 09 06 00, SCHEDULE FOR FINISHES.
- D. Card Readers: Section 28 13 11, PHYSICAL ACCESS CONTROL SYSTEMS.

1.3 GENERAL

- A. All hardware shall comply with UFAS, (Uniform Federal Accessible Standards) unless specified otherwise.
- B. Provide rated door hardware assemblies where required by most current version of the International Building Code (IBC).
- C. Hardware for Labeled Fire Doors and Exit Doors: Conform to requirements of NFPA 80 for labeled fire doors and to NFPA 101 for exit doors, as well as to other requirements specified. Provide hardware listed by UL, except where heavier materials, large size, or better grades are specified herein under paragraph HARDWARE SETS. In lieu of UL labeling and listing, test reports from a nationally recognized testing agency may be submitted showing that hardware has been tested in accordance with UL test methods and that it conforms to NFPA requirements.
- D. Hardware for application on metal and wood doors and frames shall be made to standard templates. Furnish templates to the fabricator of these items in sufficient time so as not to delay the construction.
- E. The following items shall be of the same manufacturer, if possible, except as otherwise specified:
 - 1. Cylinder locksets.
 - 2. Hinges for hollow metal and wood doors.
 - 3. Surface applied overhead door closers.
 - 4. Exit devices.

1.4 WARRANTY

- A. Automatic door operators shall be subject to the terms of FAR Clause 52.24-21, except that the Warranty period shall be two years in lieu of one year for all items except as noted below:
1. Locks, latchsets, and panic hardware: 5 years.
 2. Door closers and continuous hinges: 10 years.

1.5 MAINTENANCE MANUALS

- A. In accordance with Section 01 00 00, GENERAL REQUIREMENTS Article titled "INSTRUCTIONS", furnish maintenance manuals and instructions on all door hardware.

1.6 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA AND SAMPLES. Submit 6 copies of the schedule per Section 01 33 23 plus 2 copies to the VAMC Locksmith (VISN Locksmith if the VAMC does not have a locksmith).
- B. Hardware Schedule: Prepare and submit hardware schedule in the following form:

Hardware Item	Quantity	Size	Reference Publication Type No.	Finish	Mfr. Name and Catalog No.	Key Control Symbols	UL Mark (if fire rated and listed)	ANSI/BHMA Finish Designation

- C. Samples and Manufacturers' Literature:

1. Samples: All hardware items (proposed for the project) that have not been previously approved by Builders Hardware Manufacturers Association shall be submitted for approval. Tag and mark all items with manufacturer's name, catalog number and project number.
2. Samples are not required for hardware listed in the specifications by manufacturer's catalog number, if the contractor proposes to use the manufacturer's product specified.

- D. Certificate of Compliance and Test Reports: Submit certificates that hardware conforms to the requirements specified herein. Certificates shall be accompanied by copies of reports as referenced. The testing shall have been conducted either in the manufacturer's plant and

certified by an independent testing laboratory or conducted in an independent laboratory, within four years of submittal of reports for approval.

1.7 DELIVERY AND MARKING

- A. Deliver items of hardware to job site in their original containers, complete with necessary appurtenances including screws, keys, and instructions. Tag one of each different item of hardware and deliver to Contracting Officer's Technical Representative (COTR) for reference purposes. Tag shall identify items by Project Specification number and manufacturer's catalog number. These items shall remain on file in COTR's office until all other similar items have been installed in project, at which time the COTR will deliver items on file to Contractor for installation in predetermined locations on the project.

1.8 PREINSTALLATION MEETING

- A. Convene a preinstallation meeting not less than 30 days before start of installation of door hardware. Require attendance of parties directly affecting work of this section, including Contractor and Installer, Architect, Project Engineer and VA Locksmith, Hardware Consultant, and Hardware Manufacturer's Representative. Review the following:
 - 1. Inspection of door hardware.
 - 2. Job and surface readiness.
 - 3. Coordination with other work.
 - 4. Protection of hardware surfaces.
 - 5. Substrate surface protection.
 - 6. Installation.
 - 7. Adjusting.
 - 8. Repair.
 - 9. Field quality control.
 - 10. Cleaning.

1.9 INSTRUCTIONS

- A. Hardware Set Symbols on Drawings: Except for protective plates, door stops, mutes, thresholds and the like specified herein, hardware requirements for each door are indicated on drawings by symbols. Symbols for hardware sets consist of letters (e.g., "HW") followed by a number. Each number designates a set of hardware items applicable to a door type.
- B. Manufacturers' Catalog Number References: Where manufacturers' products are specified herein, products of other manufacturers which are

considered equivalent to those specified may be used. Manufacturers whose products are specified are identified by abbreviations as follows:

Adams-Rite	Adams Rite Mfg. Co.	Pomona, CA
Best	Best Access Systems	Indianapolis, IN
Don-Jo	Don-Jo Manufacturing	Sterling, MA
G.E. Security	GE Security, Inc.	Bradentown, FL
Markar	Markar Architectural Products	Pomona, CA
Pemko	Pemko Manufacturing Co.	Ventura, CA
Rixson	Rixson	Franklin Park, IL
Rockwood	Rockwood Manufacturing Co.	Rockwood, PA
Securitron	Securitron Magnalock Corp.	Sparks, NV
Southern Folger	Southern Folger Detention Equipment Co.	San Antonio, TX
Stanley	The Stanley Works	New Britain, CT
Tice	Tice Industries	Portland, OR
Trimco	Triangle Brass Mfg. Co.	Los Angeles, CA
Zero	Zero Weather Stripping Co.	New York, NY

- C. Keying: All cylinders shall be keyed into existing Best Access System Great Grand Master Key System. Provide removable core cylinders that are removable only with a special key or tool without disassembly of knob or lockset. Cylinders shall be 7 pin type. Keying information shall be furnished at a later date by the COTR.

1.10 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only. In text, hardware items are referred to by series, types, etc., listed in such specifications and standards, except as otherwise specified.
- B. American National Standards Institute/Builders Hardware Manufacturers Association (ANSI/BHMA):
- A156.1-06.....Butts and Hinges
 - A156.2-03.....Bored and Pre-assembled Locks and Latches
 - A156.3-08.....Exit Devices, Coordinators, and Auto Flush Bolts
 - A156.4-08.....Door Controls (Closers)

- A156.5-01.....Auxiliary Locks and Associated Products
- A156.6-05.....Architectural Door Trim
- A156.8-05.....Door Controls-Overhead Stops and Holders
- A156.12-05Interconnected Locks and Latches
- A156.13-05.....Mortise Locks and Latches Series 1000
- A156.14-07Sliding and Folding Door Hardware
- A156.15-06.....Release Devices-Closer Holder, Electromagnetic
and Electromechanical
- A156.16-08.....Auxiliary Hardware
- A156.17-04Self-Closing Hinges and Pivots
- A156.18-06.....Materials and Finishes
- A156.21-09.....Thresholds
- A156.22-05.....Door Gasketing and Edge Seal Systems
- A156.23-04.....Electromagnetic Locks
- A156.24-03.....Delayed Egress Locking Systems
- A156.25-07Electrified Locking Devices
- A156.26-06.....Continuous Hinges
- A156.28-07Master Keying Systems
- A156.29-07Exit Locks and Alarms
- A156.30-03High Security Cylinders
- A156.31-07Electric Strikes and Frame Mounted Actuators
- A250.8-03.....Standard Steel Doors and Frames
- C. National Fire Protection Association (NFPA):
 - 80-10.....Fire Doors and Fire Windows
 - 101-09.....Life Safety Code
- D. Underwriters Laboratories, Inc. (UL):
 - Building Materials Directory (2008)

PART 2 - PRODUCTS

2.1 BUTT HINGES

- A. ANSI A156.1. The following types of butt hinges shall be used for the types of doors listed, except where otherwise specified:
 - 1. Exterior Doors: Type A2112/A5112 for doors 900 mm (3 feet) wide or less and Type A2111/A5111 for doors over 900 mm (3 feet) wide.
Hinges for exterior outswing doors shall have non-removable pins.
Hinges for exterior fire-rated doors shall be of stainless steel material.
 - 2. Interior Doors: Type A8112/A5112 for doors 900 mm (3 feet) wide or less and Type A8111/A5111 for doors over 900 mm (3 feet) wide.

Hinges for doors exposed to high humidity areas (shower rooms, toilet rooms, kitchens, janitor rooms, etc. shall be of stainless steel material.

B. Provide quantity and size of hinges per door leaf as follows:

1. Doors 1210 mm (4 feet) to 2260 mm (7 feet 5 inches) high: 3 hinges minimum.
2. Doors greater than 2260 mm (7 feet 5 inches) high: 4 hinges.
3. Doors up to 900 mm (3 feet) wide, standard weight: 114 mm x 114 mm (4-1/2 inches x 4-1/2 inches) hinges.
4. Doors over 900 mm (3 feet) to 1065 mm (3 feet 6 inches) wide, standard weight: 127 mm x 114 mm (5 inches x 4-1/2 inches).

2.2 DOOR CLOSING DEVICES

- A. Closing devices shall be products of one manufacturer for each type specified.

2.3 OVERHEAD CLOSERS

- A. Conform to ANSI A156.4, Grade 1.
- B. Closers shall conform to the following:
1. The closer shall have minimum 50 percent adjustable closing force over minimum value for that closer and have adjustable hydraulic back check effective between 60 degrees and 85 degrees of door opening.
 2. Where specified, closer shall have hold-open feature.
 3. Material of closer body shall be forged or cast.
 4. Arm and brackets for closers shall be steel, malleable iron or high strength ductile cast iron.
 5. Where closers are exposed to the exterior or are mounted in rooms that experience high humidity, provide closer body and arm assembly of stainless steel material.
 6. Closers shall have full size metal cover; plastic covers will not be accepted.
 7. Closers shall have adjustable hydraulic back-check, separate valves for closing and latching speed, adjustable back-check positioning valve, and adjustable delayed action valve.
 8. Closer arms or backcheck valve shall not be used to stop the door from overswing, except in applications where a separate wall, floor, or overhead stop cannot be used.

9. Where closers are to be installed on the push side of the door, provide parallel arm type except where conditions require use of top jamb arm.
10. Provide all surface closers with the same body attachment screw pattern for ease of replacement and maintenance.
11. All closers shall have a 1 1/2 inch (38mm) minimum piston diameter.

2.4 DOOR STOPS

- A. Conform to ANSI A156.16.
- B. Provide door stops wherever an opened door or any item of hardware thereon would strike a wall, column, equipment or other parts of building construction. For concrete, masonry or tile construction, use lead expansion shields for mounting door stops.
- C. Where cylindrical locks with turn pieces or pushbuttons occur, equip wall bumpers Type L02251 (rubber pads having concave face) to receive turn piece or button.
- D. Provide floor stops (Type L02141 or L02161 in office areas; Type L02121 x 3 screws into floor elsewhere. Wall bumpers, where used, must be installed to impact the trim or the door within the leading half of its width. Floor stops, where used, must be installed within 4-inches of the wall face and impact the door within the leading half of its width.
- E. Where drywall partitions occur, use floor stops, Type L02141 or L02161 in office areas, Type L02121 elsewhere.
- F. Provide stop Type L02011, as applicable for exterior doors. At outswing doors where stop can be installed in concrete, provide stop mated to concrete anchor set in 76mm (3-inch) core-drilled hole and filled with quick-setting cement.
- G. Omit stops where floor mounted door holders are required and where automatic operated doors occur.
- H. Provide appropriate roller bumper for each set of doors (except where closet doors occur) where two doors would interfere with each other in swinging.
- I. Provide appropriate door mounted stop on doors in individual toilets where floor or wall mounted stops cannot be used.
- J. Where the specified wall or floor stop cannot be used, provide concealed overhead stops (surface-mounted where concealed cannot be used).

2.5 LOCKS AND LATCHES

- A. Conform to ANSI A156.2. Locks and latches for doors 45 mm (1-3/4 inch) thick or over shall have beveled fronts. Lock cylinders shall have not less than seven pins. Cylinders for all locksets shall be removable core type. Cylinders shall be furnished with construction removable cores by Best Access Systems. Cylinder shall be removable by special key or tool. Construct all cores so that they will be interchangeable into the core housings of all mortise locks, rim locks, cylindrical locks, and any other type lock included in the Great Grand Master Key System. Disassembly of lever or lockset shall not be required to remove core from lockset. All locksets or latches on double doors with fire label shall have latch bolt with 19 mm (3/4 inch) throw, unless shorter throw allowed by the door manufacturer's fire label. Provide temporary keying device or construction core of allow opening and closing during construction and prior to the installation of final cores.
- B. In addition to above requirements, locks and latches shall comply with following requirements:
 - 1. Cylindrical Lock and Latch Sets: levers shall meet ADA (Americans with Disabilities Act) requirements. Cylindrical locksets shall be series 4000 Grade I. All locks and latchsets shall be furnished with 122.55 mm (4-7/8-inch) curved lip strike and wrought box. At outswing pairs with overlapping astragals, provide flat lip strip with 21mm (7/8-inch) lip-to-center dimension. Provide lever design to match design selected by Architect or to match existing lever design. Where two turn pieces are specified for lock F76, turn piece on inside knob shall lock and unlock inside knob, and turn piece on outside knob shall unlock outside knob when inside knob is in the locked position. (This function is intended to allow emergency entry into these rooms without an emergency key or any special tool.)
 - 2. Auxiliary locks shall be as specified under hardware sets and conform to ANSI A156.5.
 - 3 Privacy locks in non-mental-health patient rooms shall have an inside thumbturn for privacy and an outside thumbturn for emergency entrance.

2.6 ELECTRIC STRIKES

- A. ANSI/ BHMA A156.31 Grade 1.
- B. General: Use fail-secure electric strikes at fire-rated doors.

2.7 KEYS

- A. Stamp all keys with change number and key set symbol. Furnish keys in quantities as follows:

Locks/Keys	Quantity
Cylinder locks	2 keys each
Cylinder lock change key blanks	100 each different key way
Master-keyed sets	6 keys each
Grand Master sets	6 keys each
Great Grand Master set	5 keys
Control key	2 keys

2.8 KEY CABINET

- A. ANSI Standard A156.5. Provide key cabinet made of cold rolled, 1.2 mm (0.0478 inch) thick furniture steel electro-welded. Doors shall have "no sag" continuous brass-pin piano type hinge and be equipped with chrome plated locking door handles, hook cam and mechanical pushbutton door lock. Key Cabinet and Key Control System shall accommodate all keys for this project plus 25 percent. Provide minimum number of multiple cabinets where a single cabinet of largest size will not accommodate the required number of keys.
- B. Key tags shall consist of two sets: Permanent self-locking and loan key snaphook type with tag colors as follows: Red fiber marker of the permanent self-locking type approximately 32 mm (1-1/4 inch) in diameter engraved with the legend "FILE KEY MUST NOT BE LOANED." Also furnish for each hook a white cloverleaf key marker with snap-hooks engraved with the legend "LOAN KEY."
- C. The manufacturer of the lock cylinders and locks shall attach a key tag to keys of each lock cylinder and shall mark thereon the respective item number and key change number. Provide each group of keys in a key gathering envelope (supplied by Key Cabinet Manufacturer) in which the lock manufacturer shall include the following information: Item number, key change number and door number. The contractor shall furnish the Key Cabinet Manufacturer the hardware and keying schedules and change keys.
- D. The Key Cabinet Manufacturer shall set up a three-way cross index system, including master keys, listing the keys alphabetically, the hooks numerically and the key changes numerically on different colored index cards. Index cards shall be typewritten and inserted in a durable

binder. Attach the keys to the two sets of numbered tags supplied with the cabinet. (The permanent tag and the loan key tag). Instruct the owner in proper use of the system. Install cabinet as directed by the COTR.

2.9 ARMOR PLATES, KICK PLATES, MOP PLATES AND DOOR EDGING

- A. Conform to ANSI Standard A156.6.
- B. Provide protective plates as specified below:
 1. Kick plates, mop plates and armor plates of metal, Type J100 series.
 2. Provide kick plates and mop plates where specified. Kick plates shall be 254 mm (10 inches) or 305 mm (12 inches) high. Mop plates shall be 152 mm (6 inches) high. Both kick and mop plates shall be minimum 1.27 mm (0.050 inches) thick. Provide kick and mop plates beveled on all 4 edges (B4E). On push side of doors where jamb stop extends to floor, make kick plates 38 mm (1-1/2 inches) less than width of door, except pairs of metal doors which shall have plates 25 mm (1 inch) less than width of each door. Extend all other kick and mop plates to within 6 mm (1/4 inch) of each edge of doors. Kick and mop plates shall butt astragals. For jamb stop requirements, see specification sections pertaining to door frames.
 3. Kick plates and/or mop plates are not required on following door sides:
 - a. Armor plate side of doors;
 - b. Exterior side of exterior doors;
 - c. Closet side of closet doors;
 4. Armor plates for doors are listed under Article "Hardware Sets".
 Armor plates shall be thickness as noted in the hardware set, 875 mm (35 inches) high and 38 mm (1-1/2 inches) less than width of doors, except on pairs of metal doors. Provide armor plates beveled on all 4 edges (B4E). Plates on pairs of metal doors shall be 25 mm (1 inch) less than width of each door. Where top of intermediate rail of door is less than 875 mm (35 inches) from door bottom, extend armor plates to within 13 mm (1/2 inch) of top of intermediate rail. On doors equipped with panic devices, extend armor plates to within 13 mm (1/2 inch) of panic bolt push bar.
 5. Where louver or grille occurs in lower portion of doors, substitute stretcher plate and kick plate in place of armor plate. Size of stretcher plate and kick plate shall be 254 mm (10 inches) high.

2.10 EXIT DEVICES

- A. Conform to ANSI Standard A156.3. Exit devices shall be Grade 1; type and function are specified in hardware sets. Provide flush with finished floor strikes for vertical rod exit devices in interior of building. Trim shall have cast satin stainless steel lever handles of design similar to locksets, unless otherwise specified. Provide key cylinders for keyed operating trim and, where specified, cylinder dogging.
- B. Surface vertical rod panics shall only be provided less bottom rod; provide fire pins as required by exit device and door fire labels. Do not provide surface vertical rod panics at exterior doors.
- C. Concealed vertical rod panics shall be provided less bottom rod at interior doors, unless lockable or otherwise specified; provide fire pins as required by exit device and door fire labels. Where concealed vertical rod panics are specified at exterior doors, provide with both top and bottom rods.
- D. Where removable mullions are specified at pairs with rim panic devices, provide mullion with key-removable feature.
- E. At non-rated openings with panic hardware, provide panic hardware with key cylinder dogging feature.
- F. Exit devices for fire doors shall comply with Underwriters Laboratories, Inc., requirements for Fire Exit Hardware. Submit proof of compliance.

2.11 FLUSH BOLTS (LEVER EXTENSION)

- A. Conform to ANSI A156.16. Flush bolts shall be Type L24081 unless otherwise specified. Furnish proper dustproof strikes conforming to ANSI A156.16, for flush bolts required on lower part of doors.
- B. Lever extension manual flush bolts shall only be used at non-fire-rated pairs for rooms only accessed by maintenance personnel.
- C. Face plates for cylindrical strikes shall be rectangular and not less than 25 mm by 63 mm (1 inch by 2-1/2 inches).
- D. Friction-fit cylindrical dustproof strikes with circular face plate may be used only where metal thresholds occur.
- E. Provide extension rods for top bolt where door height exceeds 2184 mm (7 feet 2 inches).

2.12 THRESHOLDS

- A. Conform to ANSI A156.21, mill finish extruded aluminum, except as otherwise specified. In existing construction, thresholds shall be

installed in a bed of sealant with ¼-20 stainless steel machine screws and expansion shields. In new construction, embed aluminum anchors coated with epoxy in concrete to secure thresholds. Furnish thresholds for the full width of the openings.

- B. For thresholds at elevators entrances see other sections of specifications.
- C. At exterior doors and any interior doors exposed to moisture, provide threshold with non-slip abrasive finish.
- D. Provide with miter returns where threshold extends more than 12 mm (0.5 inch) from fame face.

2.13 WEATHERSTRIPS (FOR EXTERIOR DOORS)

- A. Conform to ANSI A156.22. Air leakage shall not to exceed 0.50 CFM per foot of crack length (0.000774m³/s/m).
- B. Mutes: Conform to ANSI A156.16. Provide door mutes or door silencers Type L03011 or L03021, depending on frame material, of white or light gray color, on each steel or wood door frame, except at fire-rated frames, lead-lined frames and frames for sound-resistant, lightproof and electromagnetically shielded doors. Furnish 3 mutes for single doors and 2 mutes for each pair of doors, except double-acting doors.

2.14 FINISHES

- A. Exposed surfaces of hardware shall have ANSI A156.18, finishes as specified below. Finishes on all hinges, pivots, closers, thresholds, etc., shall be as specified below under "Miscellaneous Finishes." For field painting (final coat) of ferrous hardware, see Section 09 91 00, PAINTING.

2.15 BASE METALS

- A. Apply specified U.S. Standard finishes on different base metals as following:

Finish	Base Metal
652	Steel
626	Brass or bronze
630	Stainless steel

PART 3 - EXECUTION

3.1 HARDWARE HEIGHTS

- A. For new buildings locate hardware on doors at heights specified below, with all hand-operated hardware centered within 864 mm (34 inches) to 1200 mm (48 inches), unless otherwise noted:
- B. Hardware Heights from Finished Floor:

1. Exit devices centerline of strike (where applicable) 1024 mm (40-5/16 inches).
2. Locksets and latch sets centerline of strike 1024 mm (40-5/16 inches).
3. Deadlocks centerline of strike 1219 mm (48 inches).
4. Centerline of door pulls to be 1016 mm (40 inches).
5. Push plates and push-pull shall be 1270 mm (50 inches) to top of plate.
6. Push-pull latch to be 1024 mm (40-5/16 inches) to centerline of strike.
7. Locate other hardware at standard commercial heights. Locate push and pull plates to prevent conflict with other hardware.

3.2 INSTALLATION

- A. Closer devices, including those with hold-open features, shall be equipped and mounted to provide maximum door opening permitted by building construction or equipment. Closers shall be mounted on side of door inside rooms, inside stairs, and away from corridors. At exterior doors, closers shall be mounted on interior side. Where closers are mounted on doors they shall be mounted with sex nuts and bolts; foot shall be fastened to frame with machine screws.

B. Hinge Size Requirements:

Door Thickness	Door Width	Hinge Height
45 mm (1-3/4 inch)	900 mm (3 feet) and less	113 mm (4-1/2 inches)
45 mm (1-3/4 inch)	Over 900 mm (3 feet) but not more than 1200 mm (4 feet)	125 mm (5 inches)
35 mm (1-3/8 inch) (hollow core wood doors)	Not over 1200 mm (4 feet)	113 mm (4-1/2 inches)

- C. Hinge leaves shall be sufficiently wide to allow doors to swing clear of door frame trim and surrounding conditions.

D. Hinges Required Per Door:

Doors 1500 mm (5 ft) or less in height	2 butts
Doors over 1500 mm (5 ft) high and not over 2280 mm (7 ft 6 in) high	3 butts
Doors over 2280 mm (7 feet 6 inches) high	4 butts
Dutch type doors	4 butts

Doors with spring hinges 1370 mm (4 feet 6 inches) high or less	2 butts
Doors with spring hinges over 1370 mm (4 feet 6 inches)	3 butts

- E. Fastenings: Suitable size and type and shall harmonize with hardware as to material and finish. Provide machine screws and lead expansion shields to secure hardware to concrete, ceramic or quarry floor tile, or solid masonry. Fiber or rawl plugs and adhesives are not permitted. All fastenings exposed to weather shall be of nonferrous metal.
- F. After locks have been installed; show in presence of COTR that keys operate their respective locks in accordance with keying requirements. (All keys, Master Key level and above shall be sent Registered Mail to the Medical Center Director along with the bitting list. Also a copy of the invoice shall be sent to the COTR for his records.) Installation of locks which do not meet specified keying requirements shall be considered sufficient justification for rejection and replacement of all locks installed on project.

3.3 FINAL INSPECTION

- A. Installer to provide letter to VA Resident/Project Engineer that upon completion, installer has visited the Project and has accomplished the following:
1. Re-adjust hardware.
 2. Evaluate maintenance procedures and recommend changes or additions, and instruct VA personnel.
 3. Identify items that have deteriorated or failed.
 4. Submit written report identifying problems.

3.4 DEMONSTRATION

- A. Demonstrate efficacy of mechanical hardware and electrical, and electronic hardware systems, including adjustment and maintenance procedures, to satisfaction of Resident/Project Engineer and VA Locksmith.

3.5 HARDWARE SETS

- A. Following sets of hardware correspond to hardware symbols shown on drawings. Only those hardware sets that are shown on drawings will be required. Disregard hardware sets listed in specifications but not shown on drawings.

ELECTRIC HARDWARE ABBREVIATIONS LEGEND:

ADO = Automatic Door Operator

EMCH = Electro-Mechanical Closer-Holder

HW-G2

Courtyard Gate to Have:

NON-RATED

1 Magnetic Lock

1 Stainless Steel Closer C52011/C22021 (PT4D, PT4F, PT4H)

BALANCE OF HARDWARE BY SECTION 32 31 53, PERIMETER SECURITY FENCES AND GATES

HW-2

Each Door to Have:

RATED/NON-RATED

Hinges

QUANTITY & TYPE AS REQUIRED

1 Keyed Privacy Indicator Lock F13 x OCCUPANCY INDICATOR

1 Closer C02011/C02021 (PT4D, PT4F, PT4H)

1 Kick Plate J102

1 Mop Plate (@ Inswing Doors) J102

1 Floor Stop L02121 x 3 FASTENERS

1 Set Self-Adhesive Seals R0E154

STONE THRESHOLD BY OTHER TRADES.

HW-3E

Each Door to Have:

NON-RATED

Hinges

QUANTITY & TYPE AS REQUIRED

1 Office Lock F04

1 Floor Stop L02121 x 3 FASTENERS

1 Set Self-Adhesive Seals R0E154

1 Coat Hook L03121

OMIT COAT HOOK WHERE GLASS LITE PREVENTS INSTALLATION.

HW-4SEach Door to Have:NON-RATED

1	Continuous Hinge	A51031B x INTEGRAL HINGE GUARD CHANNEL X ADJUSTA-SCREWS
1	Classroom Lock	F08
1	Heavy-Duty Armor Plate	J101 x 3.175 MM (0.125 INCH) THICKNESS
1	Lock Trim Protector Bar	R111LPB-630 (ROCKWOOD), OR EQUAL
1	Edge Guard (@ Wood Doors)	J208M / J211 (VERIFY), CUT: HARDWARE
1	Floor Stop	L02121 x 3 FASTENERS
1	Auto Door Bottom	R0Y346 - HEAVY DUTY
2	Sets Self-Adhesive Seals	R0E154

HW-5Each Door to Have:RATED

	Hinges	QUANTITY & TYPE AS REQUIRED
1	Storeroom Lock	F07
1	Closer	C02011/C02021 (PT4D, PT4F, PT4H)
1	Kick Plate	J102 (@ STORAGE, EVM, & HAC ROOMS ONLY)
1	Floor Stop	L02121 x 3 FASTENERS
1	Set Self-Adhesive Seals	R0E154

HW-5DEach Door to Have:NON-RATED

	Hinges	QUANTITY & TYPE AS REQUIRED
1	Storeroom Lock	F07
1	Kick Plate	J102 (@ STORAGE, EVM, & HAC ROOMS ONLY)
1	Floor Stop (@ Inswing Doors)	L02121 x 3 FASTENERS
1	Wall Stop (@ Outswing Doors)	L52101 CONVEX
3	Silencers	L03011

HW-5GEach Door to Have:NON-RATED

Hinges	QUANTITY & TYPE AS REQUIRED
1 Storeroom Lock	F07
1 Kick Plate	J102
1 Floor Stop	L02121 x 3 FASTENERS
1 Threshold	J32300 x 57 MM WIDTH (2-1/4 INCHES)
1 Auto Door Bottom	R0Y346 - HEAVY DUTY
2 Sets Self-Adhesive Seals	R0E154

HW-6Each Door to Have:RATED

Hinges	QUANTITY & TYPE AS REQUIRED
1 Exit Device	TYPE 1 F13 LEVER
1 Key Cylinder	TYPE AS REQUIRED
1 Closer	C02011/C02021 (PT4D, PT4F, PT4H)
1 Floor Stop	L02121 x 3 FASTENERS
1 Set Self-Adhesive Seals	R0E154
Door A102 shall be furnished with a magnetic lock and self-contained local alarm unit (see Electrical Specifications for additional information).	

HW-8AEach Aluminum Storefront Pair to Have:NON-RATED

2 Floor Closers	C06041 (PT8A, PT8F, PT8G, PT8J, PT8M)
2 Intermediate Pivots	C07321
2 Push/Pull Bar Sets	J505 - 305 MM (12 INCH) CENTER-TO-CENTER PULL
2 Overhead Stops	C01541-ADJUSTABLE

HW-12Each Pair to Have:RATED

Hinges	QUANTITY & TYPE AS REQUIRED
1 Exit Device	TYPE 7 or 8 F01
1 Exit Device	TYPE 7 or 8 F08 LEVER
1 Key Cylinder	TYPE AS REQUIRED
1 Set Meeting Stile Astragals	R3E834
2 Closers	C02011/C02021 (PT4D, PT4F, PT4H)
2 Floor Stops	L02121 x 3 FASTENERS
1 Set Self-Adhesive Seals	R0E154

Doors A101A and A114A shall be furnished with magnetic locks and a self-contained local alarm unit (see Electrical Specifications for additional information).

HW-E1Each Door to Have:NON-RATED

1 Continuous Hinge	A51031B
1 Entry Lock	F11
1 Latch Protector (outswing dr)	MLP-111 (DON-JO), OR EQUAL
1 Closer	C02011/C02021 (PT4D, PT4F, PT4H)
1 Kick Plate	J102
1 Floor Stop	1214CK x 1268CK (TRIMCO), OR EQUAL
1 Threshold (outswing door)	J35130 x SILICONE GASKET
1 Threshold (inswing door)	ALUMINUM, PER ARCHITECTURAL DETAIL
1 Door Sweep	90100CNB (PEMKO), OR EQUAL
1 Set Frame Seals	2891AS X CSK SCREWS (PEMKO), OR EQUAL
1 Drip	R0Y976

Doors A101B and A109 shall be furnished with magnetic locks and self-contained local alarm units (see Electrical Specifications for additional information).

EXTERIOR PAIRS OF DOORS

<u>Each Pair to Have:</u>		<u>HW-E6</u>	<u>NON-RATED</u>
2	Continuous Hinge	A51031B	
1	Set Auto Flush Bolts	TYPE 25	
1	Dust Proof Strike	L04021	
1	Entry Lock	F11	
1	Overlapping Astragal with Self-Adhesive Seal	R5Y634 x R0E154 x THRU-BOLTS	
1	Coordinator	TYPE 21A	
2	Closer	C02011/C02021 (PT4D, PT4F, PT4H)	
2	Kick Plate	J102	
2	Floor Stop	1214CK x 1268CK (TRIMCO), OR EQUAL	
1	Threshold (outswing door)	J35130 x SILICONE GASKET	
1	Threshold (inswing door)	ALUMINUM, PER ARCHITECTURAL DETAIL	
2	Door Sweep	90100CNB (PEMKO), OR EQUAL	
1	Set Frame Seals	2891AS X CSK SCREWS (PEMKO), OR EQUAL	
1	Drip	R0Y976	

- - - E N D - - -

SECTION 08 71 13
AUTOMATIC DOOR OPERATORS

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This section specifies equipment, controls and accessories for automatic operation of swing doors.

1.2 RELATED WORK

- A. Aluminum frames entrance work; Section 08 41 13, ALUMINUM-FRAMED ENTRANCES AND STOREFRONTS.
- B. Door hardware; Section 08 71 00, DOOR HARDWARE.
- C. Section 28 13 00, ACCESS CONTROL.
- D. Glass and glazing of doors and frames; Section 08 80 00, GLAZING.
- E. Electric general wiring, connections and equipment requirements; Division 26, ELECTRICAL.
- F. Section 28 31 00, FIRE DETECTION AND ALARM.

1.3 QUALITY ASSURANCE

- A. Automatic door operators, controls and other equipment shall be products of a manufacturer regularly engaged in manufacturing such equipment for a minimum of three years.
- B. One type of automatic door equipment shall be used throughout the building.
- C. Equipment installer shall have specialized experience and shall be approved by the manufacturer.

1.4 WARRANTY

- A. Automatic door operators shall be subject to the terms of the "Warranty of Construction" Article of Section 00 72 00, GENERAL CONDITIONS, except that the Warranty period shall be two years in lieu of one year.

1.5 MAINTENANCE MANUALS

- A. In accordance with Section 01 00 00, GENERAL REQUIREMENTS Article titled "INSTRUCTIONS", furnish maintenance manuals and instructions on automatic door operators.

1.6 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturer's literature and data describing operators, power units, controls, door hardware and safety devices.

C. Shop Drawings:

1. Showing location of controls and safety devices in relationship to each automatically operated door.
2. Showing layout, profiles, product components, including anchorage, accessories, as applicable.
3. Submit templates, wiring diagrams, fabrication details and other information to coordinate the proper installation of the automatic door operators.

D. Submit in writing to Contracting Officer's Technical Representative (COTR) that items listed in Article 1.3 are in compliance.

1.7 DESIGN CRITERIA

- A. As a minimum automatic door equipment shall comply with the requirements of BHMA 156.10. Except as otherwise noted on drawings, provide operators which will move the doors from the fully closed to fully opened position in five seconds maximum time interval, when speed adjustment is at maximum setting.
- B. Equipment: Conforming to UL 325. Provide key operated power disconnect wall switch for each door installation.
- C. Electrical Wiring, Connections and Equipment: Provide all motor, starter, controls, associated devices, and interconnecting wiring required for the installation. Equipment and wiring shall be as specified in Division 26, ELECTRICAL.

1.8 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. Builders Hardware Manufacturers Association, Inc. (BHMA):
A156.10-05.....Power Operated Pedestrian Doors (BHMA 1601)
- C. National Fire Protection Association (NFPA):
101-09.....Life Safety Code
- D. Underwriters Laboratory (UL):
325-10.....Door, Operators and Systems

1.9 DELIVERY AND STORAGE

- A. Delivery shall be in factory's original, unopened, undamaged container with identification labels attached.

PART 2 - PRODUCTS**2.1 SWING DOOR OPERATORS**

- A. General: Swing door operators shall be of institutional type, door panel size 600 mm to 1250 mm (2 feet to 5 feet) width, weight not to exceed 300 kg (600 pounds), electric operated for overhead mounting within the header or transom. Furnish metal mounting supports, brackets and other accessories necessary for the installation of operators at the head of the door frames. The motor on automatic door operator shall be provided with an interlock so that the motor will not operate when doors are electrically locked from opening.
- B. Operators shall have checking mechanism providing cushioning action at last part of door travel, in both opening and closing cycle. Operators shall be capable of recycling doors instantaneously to full open position from any point in the closing cycle when control switch is activated. Operators shall, when automatic power is interrupted or shut-off, permit doors to easily open manually without damage to automatic operator system.
- C. Operator, enclosed in housing, shall open door by energizing motor and shall stop by electrically reducing voltage and stalling motor against mechanical stop. Door shall close by means of spring energy, and close force shall be controlled by gear system and motor being used as dynamic break without power, or controlled by hydraulic closer in electro-hydraulic operators. System shall operate as manual door control in event of power failure. Opening and closing speeds shall be adjustable:
 - 1. Operator Housing: Housing shall be a minimum of 112 mm (4-1/2 inches) wide by 140 mm (5.5 inches) high aluminum extrusions with enclosed end caps for application to 100 mm (4 inches) and larger frame systems. All structural sections shall have a minimum thickness of 3.2 mm (0.125 inch) and be fabricated of a minimum of 6063-T5 aluminum alloy.
 - 2. Power Operator: Completely assembled and sealed unit which shall include gear drive transmission, mechanical spring and bearings, all located in aluminum case and filled with special lubricant for extreme temperature conditions. Complete unit shall be rubber mounted with provisions for easy maintenance and replacement, without removing door from pivots or frame.

3. Connecting hardware shall have drive arm attached to door with a pin linkage rotating in a self-lubricating bearing. Door shall not pivot on shaft of operator.
4. Electrical Control: Operator shall have a self contained electrical control unit, including necessary transformers, relays, rectifiers, and other electronic components for proper operation and switching of power operator. All connecting harnesses shall have interlocking plugs.

2.2 MICROPROCESSOR CONTROLS

- A. The system shall include a multi-function microprocessor control providing adjustable hold open time (1-30 seconds), LED indications for sensor input signals and operator status and power assist close options. Control shall be capable of receiving activation signals from any device with normally open dry contact output. All activation modes shall provide fully adjustable opening speed:
- B. The door shall be held open by low voltage applied to the continuous duty motor. The control shall include an adjustable safety circuit that monitors door operation and stops the opening direction of the door if an obstruction is sensed. The motor shall include a recycle feature that reopens the door if an obstruction is sensed at any point during the closing cycle. The control shall include a standard three position key switch with functions for ON, OFF, and HOLD OPEN, mounted on operator enclosure, door frame, or wall, as indicated in the architectural drawings.

2.3 POWER UNITS

Each power unit shall be self-contained, electric operated and independent of the door operator. Capacity and size of power circuits shall be in accordance with automatic door operator manufacturer's specifications and Division 26 - ELECTRICAL.

2.4 DOOR CONTROLS

- A. Opening and closing actions of doors shall be actuated by controls and safety devices specified, and conform to ANSI 156.10. Controls shall cause doors to open instantly when control device is actuated; hold doors in open positions; then, cause doors to close, unless safety device or reactivated control interrupts operation.
- B. Manual Controls:
 1. Push Plate Wall Switch: Recess type, stainless steel push plate minimum 100 mm by 100 mm (four-inch by four-inch), with 13 mm (1/2-

inch) high letters "To Operate Door--Push" engraved on face of plate.

- C. Motion Detector: The motion detector may be surface mounted or concealed, to provide a signal to actuate the door operator, and monitor the immediate zone, to detect intrusion by persons, carts or similar objects. The zone which the detector monitors shall be 1500 mm (five feet) deep and 1500 mm (five feet) across, plus or minus 150 mm (six inches) on all dimensions. The maximum response time shall be no less than 25 milliseconds. Unit shall be designed to operate on 24 volts AC. The control shall not be affected by cleaning material, solvents, dust, dirt and outdoor weather conditions.

2.5 SAFETY DEVICES

- A. General: Area over which doors swing or slide shall be a safety section and anyone standing in path of door's movement shall be protected by a safety device.
- B. Each swing door shall have installed on the pull side a presence sensor to detect any person standing in the door swing path and prevent the door from opening.
- C. Time delay switches shall be adjustable between 3 to 60 seconds and shall control closing cycle of doors.
- D. Decals with sign "In" or "Do Not Enter" shall be installed on both faces of each door where shown.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Coordinate installation of equipment with other related work. Manual controls and power disconnect switches shall be recessed or semi-flush mounted in partitions. Secure operator components to adjacent construction with suitable fastenings. Conceal conduits, piping, and electric equipment, in finish work.
- B. Install power units in locations shown. Where units are to be mounted on walls, provide metal supports or shelves for the units. All equipment, including time delay switches, shall be accessible for maintenance and adjustment.
- C. Operators shall be adjusted and must function properly for the type of traffic (pedestrians, carts, stretchers and wheelchairs) expected to pass through doors. Each door leaf of pairs of doors shall open and close in synchronization. On pairs of doors, operators shall allow either door to be opened manually without the other door opening.

- D. Install controls at positions shown and make them convenient for particular traffic expected to pass through openings. Maximum height of push plate wall switches from finished floors shall be 40 inches unless otherwise approved by the COTR.

3.2 INSTRUCTIONS

- A. Following the installation and final adjustments of the door operators, the installer shall fully instruct VA personnel on the operating, servicing and safety requirements for the swing and sliding automatic door operators.
- B. Coordinate instruction to VA personnel with VA COTR.

- - - E N D - - -

SECTION 08 80 00
GLAZING

PART 1 - GENERAL

1.1 DESCRIPTION

This section specifies glass, related glazing materials and accessories. Glazing products specified apply to factory or field glazed items.

1.2 RELATED WORK

- A. Factory glazed by manufacturer in following units:
 - 1. Section 08 11 13, HOLLOW METAL DOORS AND FRAMES, and Section 08 21 00, THERMAL FUSED FLUSH DOORS.
 - 2. Mirrors: Section 10 28 00, TOILET, BATH, AND LAUNDRY ACCESSORIES.
 - 3. Section 08 44 13, GLAZED ALUMINUM CURTAIN WALLS.
 - 4. Color of spandrel glass, tinted (heat absorbing or light reducing) glass, and reflective (metallic coated) glass: Section 09 06 00, SCHEDULE FOR FINISHES.
 - 5. Section 28 13 11, PHYSICAL ACCESS CONTROL SYSTEMS.
 - 6. Section 28 16 11, INTRUSION DETECTION SYSTEM.

1.3 LABELS

- A. Temporary labels:
 - 1. Provide temporary label on each light of glass identifying manufacturer or brand and glass type, quality and nominal thickness.
 - 2. Label in accordance with NFRC (National Fenestration Rating Council) label requirements.
 - 3. Temporary labels shall remain intact until glass is approved by Contracting Officer's Technical Representative (COTR).
- B. Permanent labels:
 - 1. Locate in corner for each pane.
 - 2. Label in accordance with ANSI Z97.1 and SGCC (Safety Glass Certification Council) label requirements.
 - a. Tempered glass.
 - b. Laminated glass or have certificate for panes without permanent label.
 - c. Organic coated glass.

1.4 PERFORMANCE REQUIREMENTS

- A. Building Enclosure Vapor Retarder and Air Barrier:

1. Utilize the inner pane of multiple pane sealed units for the continuity of the air barrier and vapor retarder seal.
 2. Maintain a continuous air barrier and vapor retarder throughout the glazed assembly from glass pane to heel bead of glazing sealant.
- B. Glass Thickness:
1. Select thickness of exterior glass to withstand dead loads and wind loads acting normal to plane of glass at design pressures calculated in accordance with ASCE 7.
 2. Test in accordance with ASTM E 1300.
 3. Thicknesses listed are minimum. Coordinate thicknesses with framing system manufacturers.

1.5 SUBMITTALS

- A. In accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturer's Certificates:
1. Certificates stating that wire glass, meets requirements for safety glazing material as specified in ANSI Z97.1.
 2. Certificate on shading coefficient.
 3. Certificate on "R" value when value is specified.
- C. Warranty: Submit written guaranty, conforming to General Condition requirements, and to "Warranty of Construction" Article in this Section.
- D. Manufacturer's Literature and Data:
1. Glass, each kind required.
 2. Insulating glass units.
 3. Elastic compound for metal sash glazing.
 4. Glazing cushion.
 5. Sealing compound.
- E. Samples:
1. Size: 150 mm by 150 mm (6 inches by 6 inches).
 2. Wire glass.
 3. Insulated glass.
 4. Insulated spandrel glass.
- F. Preconstruction Adhesion and Compatibility Test Report: Submit glazing sealant manufacturer's test report indicating glazing sealants were tested for adhesion to glass and glazing channel substrates and for compatibility with glass and other glazing materials.

1.6 DELIVERY, STORAGE AND HANDLING

- A. Delivery: Schedule delivery to coincide with glazing schedules so minimum handling of crates is required. Do not open crates except as required for inspection for shipping damage.
- B. Storage: Store cases according to printed instructions on case, in areas least subject to traffic or falling objects. Keep storage area clean and dry.
- C. Handling: Unpack cases following printed instructions on case. Stack individual windows on edge leaned slightly against upright supports with separators between each.

1.7 PROJECT CONDITIONS

Field Measurements: Field measure openings before ordering tempered glass products. Be responsible for proper fit of field measured products.

1.8 WARRANTY

- A. Warranty: Conform to terms of "Warranty of Construction", FAR clause 52.246-21, except extend warranty period for the following:
 - 1. Insulating glass units to remain sealed for 10 years.
 - 2. Laminated glass units to remain laminated for 5 years.

1.9 APPLICABLE PUBLICATIONS

- A. Publications listed below form a part of this specification to extent referenced. Publications are referenced in text by basic designation only.
- B. American National Standards Institute (ANSI):
 - Z97.1-04.....Safety Glazing Material Used in Building -
Safety Performance Specifications and Methods
of Test.
- C. American Society for Testing and Materials (ASTM):
 - C1363-05.....Thermal Performance of Building Assemblies, by
Means of A Hot Box Apparatus
 - C542-05.....Lock-Strip Gaskets.
 - C716-06.....Installing Lock-Strip Gaskets and Infill
Glazing Materials.
 - C794-06.....Adhesion-in-Peel of Elastomeric Joint Sealants.
 - C864-05.....Dense Elastomeric Compression Seal Gaskets,
Setting Blocks, and Spacers.
 - C920-08.....Elastomeric Joint Sealants.
 - C964-07.....Standard Guide for Lock-Strip Gasket Glazing.

- C1036-06.....Flat Glass.
- C1048-04.....Heat-Treated Flat Glass-Kind HS, Kind FT Coated
and Uncoated Glass.
- C1172-09.....Laminated Architectural Flat Glass.
- C1376-10.....Pyrolytic and Vacuum Deposition Coatings on
Flat Glass.
- E84-09.....Surface Burning Characteristics of Building
Materials.
- E1300-09.....Determining Load Resistance of Glass in
Buildings.
- E2190-08.....Insulating Glass Unit
- D. Code of Federal Regulations (CFR):
16 CFR 1201 - Safety Standard for Architectural Glazing Materials;
1977, with 1984 Revision.
- E. National Fire Protection Association (NFPA):
80-08.....Fire Doors and Windows.
- F. National Fenestration Rating Council (NFRC)
- G. Safety Glazing Certification Council (SGCC) 2009:
Certified Products Directory (Issued Semi-Annually).
- H. Glass Association of North America (GANA):
Glazing Manual (Latest Edition)
Sealant Manual (2008)
- I. American Society of Civil Engineers (ASCE):
ASCE 7-10.....Wind Load Provisions

PART 2 - PRODUCT

2.1 GLASS

- A. Use thickness stated unless specified otherwise in assemblies.
- B. Clear Glass:
 - 1. ASTM C1036, Type I, Class 1, Quality q3.
 - 2. Thickness, 6 mm (1/4 inch).
- C. Film-Faced Polished Wire Glass:
 - 1. ASTM C1036, Type II, Class 1, Form 1, Quality q6.
 - 2. Thickness, 6 mm (1/4 inch).

2.2 HEAT-TREATED GLASS

- A. Clear Tempered Glass:
 - 1. ASTM C1048, Kind FT, Condition A, Type I, Class 1, Quality q3.
 - 2. Thickness, 6 mm (1/4 inch).

2.3 COATED GLASS

A. Spandrel Glass:

1. ASTM C1048, Kind HS, Condition B, Type I.
2. Thickness, 6 mm (1/4 inch).

B. Low-E Tempered Glass:

1. ASTM C1048, Kind FT, Condition C, Type I, Class 1, Quality q3 with low emissivity pyrolytic coating having an E of 0.15.
2. Apply coating to third surface of insulating glass units.
3. Thickness, 4.8 mm (3/16 inch).

2.4 INSULATING GLASS UNITS

A. Provide factory fabricated, hermetically sealed glass unit consisting of two panes of glass separated by a dehydrated air space and comply with ASTM E2190.

B. Assemble units using glass types specified:

C. Sealed Edge Units (SEU):

1. Insulating Glass Unit Makeup

a. Outboard Lite

1. Glass type: Low E- Tempered
2. Nominal Thickness: 1/4 inch
3. Glass Strength: (Tempered)

b. Spacer

1. Nominal Thickness:

c. Inboard Lite

1. Glass Type:
3. Nominal Thickness: 1/4 inch
4. Glass Strength: (Tempered)
5. Coating Orientation: (Surface #3)

2. Performance Characteristics (Center of Glass)

- a. Visible Transmittance: 75%
- b. Visible Reflectance: 9%
- c. Winter U-factor (U-value): .47
- d. Shading Coefficient (SC): .56
- e. Solar heat Gain Coefficient (SHGC): .49

3. Glass shall be tempered as required by codes, or as required to meet thermal stress and wind loads.

4. Glass heat-treated by horizontal (roller hearth) process with inherent roller wave distortion parallel to the bottom edge of the glass as installed when specified.

D. FEU Clear Glass.

1. Interior and exterior panes, ASTM C1036, Type I, Class 1, Quality q3, 3 mm.
2. Thickness, 11 mm (7/16 inch) minimum.

2.5 GLAZING ACCESSORIES

A. As required to supplement the accessories provided with the items to be glazed and to provide a complete installation. Ferrous metal accessories exposed in the finished work shall have a finish that will not corrode or stain while in service.

B. Setting Blocks: ASTM C864:

1. Channel shape; having 6 mm (1/4 inch) internal depth.
2. Shore a hardness of 80 to 90 Durometer.
3. Block lengths: 50 mm (two inches) except 100 to 150 mm (four to six inches) for insulating glass.
4. Block width: Approximately 1.6 mm (1/16 inch) less than the full width of the rabbet.
5. Block thickness: Minimum 4.8 mm (3/16 inch). Thickness sized for rabbet depth as required.

C. Spacers: ASTM C864:

1. Channel shape having a 6 mm (1/4 inch) internal depth.
2. Flanges not less 2.4 mm (3/32 inch) thick and web 3 mm (1/8 inch) thick.
3. Lengths: One to 25 to 76 mm (one to three inches).
4. Shore a hardness of 40 to 50 Durometer.

D. Sealing Tapes:

1. Semi-solid polymeric based material exhibiting pressure-sensitive adhesion and withstanding exposure to sunlight, moisture, heat, cold, and aging.
2. Shape, size and degree of softness and strength suitable for use in glazing application to prevent water infiltration.

E. Spring Steel Spacer: Galvanized steel wire or strip designed to position glazing in channel or rabbeted sash with stops.

F. Glazing Gaskets: ASTM C864:

1. Firm dense wedge shape for locking in sash.
2. Soft, closed cell with locking key for sash key.
3. Flanges may terminate above the glazing-beads or terminate flush with top of beads.

- G. Lock-Strip Glazing Gaskets: ASTM C542, shape, size, and mounting as indicated.
- H. Glazing Sealants: ASTM C920, silicone neutral cure:
 - 1. Type S.
 - 2. Class 25
 - 3. Grade NS.
 - 4. Shore A hardness of 25 to 30 Durometer.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Verification of Conditions:
 - 1. Examine openings for glass and glazing units; determine they are proper size; plumb; square; and level before installation is started.
 - 2. Verify that glazing openings conform with details, dimensions and tolerances indicated on manufacturer's approved shop drawings.
- B. Advise Contractor of conditions which may adversely affect glass and glazing unit installation, prior to commencement of installation: Do not proceed with installation until unsatisfactory conditions have been corrected.
- C. Verify that wash down of adjacent masonry is completed prior to erection of glass and glazing units to prevent damage to glass and glazing units by cleaning materials.

3.2 PREPARATION

- A. For sealant glazing, prepare glazing surfaces in accordance with GANA-02 Sealant Manual.
- B. Determine glazing unit size and edge clearances by measuring the actual unit to receive the glazing.
- C. Shop fabricate and cut glass with smooth, straight edges of full size required by openings to provide GANA recommended edge clearances.
- D. Verify that components used are compatible.
- E. Clean and dry glazing surfaces.
- F. Prime surfaces scheduled to receive sealants, as determined by preconstruction sealant-substrate testing.

3.3 INSTALLATION - GENERAL

- A. Install in accordance with GANA-01 Glazing Manual and GANA-02 Sealant Manual unless specified otherwise.

- B. Glaze in accordance with recommendations of glazing and framing manufacturers, and as required to meet the Performance Test Requirements specified in other applicable sections of specifications.
- C. Set glazing without bending, twisting, or forcing of units.
- D. Do not allow glass to rest on or contact any framing member.
- E. Glaze doors and operable sash, in a securely fixed or closed and locked position, until sealant, glazing compound, or putty has thoroughly set.
- F. Tempered Glass: Install with roller distortions in horizontal position unless otherwise directed.
- G. Insulating Glass Units:
 - 1. Glaze in compliance with glass manufacturer's written instructions.
 - 2. When glazing gaskets are used, they shall be of sufficient size and depth to cover glass seal or metal channel frame completely.
 - 3. Do not use putty or glazing compounds.
 - 4. Do not grind, nip, cut, or otherwise alter edges and corners of fused glass units after shipping from factory.
 - 5. Install with tape or gunnable sealant in wood sash.
- H. Fire Resistant Glass:
 - 1. Film-Faced Wire glass: Glaze in accordance with NFPA 80.

3.4 INSTALLATION - DRY METHOD (TAPE AND GASKET SPLINE GLAZING)

- A. Cut glazing tape to length; install on glazing pane. Seal corners by butting and sealing junctions with butyl sealant.
- B. Place setting blocks at 1/3 points with edge block no more than 150 mm (6 inches) from corners.
- C. Rest glazing on setting blocks and push against fixed stop with sufficient pressure to attain full contact.
- D. Install removable stops without displacing glazing spline. Exert pressure for full continuous contact.
- E. Do not exceed edge pressures stipulated by glass manufacturers for installing glass lites.
- F. Trim protruding tape edge.

3.5 INSTALLATION - WET/DRY METHOD (PREFORMED TAPE AND SEALANT)

- A. Cut glazing tape to length and set against permanent stops, 5 mm (3/16 inch) below sight line. Seal corners by butting tape and dabbing with butyl sealant.
- B. Apply heel bead of butyl sealant along intersection of permanent stop with frame ensuring full perimeter seal between glass and frame to complete the continuity of the air and vapor seal.

- C. Place setting blocks at 1/3 points with edge block no more than 150 mm (6 inches) from corners.
- D. Rest glazing on setting blocks and push against tape and heel bead of sealant with sufficient pressure to achieve full contact at perimeter of pane or glass unit.
- E. Install removable stops, with spacer strips inserted between glazing and applied stops, 6 mm (1/4 inch) below sight line. Place glazing tape on glazing pane or unit with tape flush with sight line.
- F. Fill gap between glazing and stop with sealant to depth equal to bite of frame on glazing, but not more than 9 mm (3/8 inch) below sight line.
- G. Apply cap bead of sealant along void between the stop and the glazing, to uniform line, flush with sight line. Tool or wipe sealant surface smooth.

3.6 INSTALLATION - INTERIOR WET/DRY METHOD (TAPE AND SEALANT)

- A. Cut glazing tape to length and install against permanent stops, projecting 1.6 mm (1/16 inch) above sight line.
- B. Place setting blocks at 1/3 points with edge block no more than 150 mm (6 inches) from corners.
- C. Rest glazing on setting blocks and push against tape to ensure full contact at perimeter of pane or unit.
- D. Install removable stops, spacer shims inserted between glazing and applied stops at 600 mm (24 inch) intervals, 6 mm (1/4 inch) below sight line.
- E. Fill gaps between pane and applied stop with sealant to depth equal to bite on glazing, to uniform and level line.
- F. Trim protruding tape edge.

3.7 REPLACEMENT AND CLEANING

- A. Clean new glass surfaces removing temporary labels, paint spots, and defacement after approval by COTR.
- B. Replace cracked, broken, and imperfect glass, or glass which has been installed improperly.
- C. Leave glass, putty, and other setting material in clean, whole, and acceptable condition.

3.8 PROTECTION

Protect finished surfaces from damage during erection, and after completion of work. Strippable plastic coatings on colored anodized finish are not acceptable.

3.9 GLAZING SCHEDULE**A. Fire Resistant Glass:**

1. Install clear wire glass in interior fire rated or labeled doors and windows.
2. Install clear wire glass in exterior windows and doors indicated to receive wire glass.

B. Tempered Glass:

1. Install in full and half glazed doors unless indicated otherwise.
2. Install in storefront, windows, and door sidelights adjacent to doors.
3. Use clear tempered glass on interior side lights and doors, and on exterior doors and sidelights unless otherwise indicated or specified.
4. Use clear tempered glass in exterior and interior panes unless specified otherwise at insulating glass units adjacent to door.

C. Insulating Glass:

1. Install SEU clear tempered glass in windows, interior pane of dual glazed windows, storefronts, curtain walls, adjacent to entrances or walks.

D. Spandrel Glass: Install specified spandrel glazing where indicated.

- - - E N D - - -

**SECTION 08 90 00
LOUVERS AND VENTS**

PART 1 - GENERAL

1.1 DESCRIPTION

This section specifies fixed wall louvers, and wall vents.

1.2 RELATED WORK

- A. Louvers in steel doors: Section 08 11 13, HOLLOW METAL DOORS AND FRAMES.
- B. Color of finish: Section 09 06 00, SCHEDULE FOR FINISHES.

1.3 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Shop Drawings:
Each type, showing material, finish, size of members method of assembly, and installation and anchorage details.
- C. Manufacturer's Literature and Data:
Each type of louver and vent.

1.4 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. The Master Painters Institute (MPI):
Approved Product List - November 2007
- C. American Society for Testing and Materials (ASTM):
A167-99(R2004).....Stainless and Heat-Resisting Chromium - Nickel
Steel Plate, Sheet, and Strip
A1008/A1008M REV A-07...Steel, Sheet, Carbon, Cold Rolled, Structural,
and High Strength Low-Alloy with Improved
Formability
B209/B209M-07.....Aluminum and Aluminum Alloy, Sheet and Plate
B221-06.....Aluminum and Aluminum Alloy Extruded Bars,
Rods, Wire, Shapes, and Tubes
B221M-07.....Aluminum and Aluminum Alloy Extruded Bars,
Rods, Wire Shapes, and Tubes
- D. National Association of Architectural Metal Manufacturers (NAAMM):
AMP 500-505 (1988).....Metal Finishes Manual
- E. National Fire Protection Association (NFPA):

- 90A-02.....Installation of Air Conditioning and
Ventilating Systems
- F. American Architectural Manufacturers Association (AAMA):
605-98.....High Performance Organic Coatings on
Architectural Extrusions and Panels
- G. Air Movement and Control Association, Inc. (AMCA):
500-L-99.....Testing Louvers

PART 2 - PRODUCTS

2.1 MATERIALS

- A. Aluminum, Extruded: ASTM B221/B221M.
- B. Carbon Steel: ASTM A1008/A1008M.
- C. Aluminum, Plate and Sheet: ASTM B209/B209M.
- D. Fasteners: Fasteners for securing louvers and wall vents to adjoining construction, except as otherwise specified or shown, shall be toggle or expansion bolts, of size and type as required for each specific type of installation and service condition.
1. Where type, size, or spacing of fasteners is not shown or specified, submit shop drawings showing proposed fasteners, and method of installation.
 2. Fasteners for louvers, louver frames, and wire guards shall be of stainless steel or aluminum.
- E. Inorganic Zinc Primer: MPI No. 19.

2.2 EXTERIOR WALL LOUVERS

- A. General:
1. Provide fixed type louvers of size and design shown.
 2. Heads, sills and jamb sections shall have formed caulking slots or be designed to retain caulking. Head sections shall have exterior drip lip, and sill sections an integral water stop.
 3. Furnish louvers with sill extension or separate sill as shown.
 4. Frame shall be mechanically fastened or welded construction with welds dressed smooth and flush.
- B. Performance Characteristics:
1. Weather louvers shall have a minimum of 50 percent free area.
 2. Louvers shall bear AMCA certified rating seals for air performance and water penetration ratings.
- C. Aluminum Louvers:

1. General: Frames, blades, sills; 2 mm (0.081-inch) thick extruded aluminum. Blades shall be drainable type and have reinforcing bosses.
2. Louvers, fixed: Make frame sizes 13 mm (1/2-inch) smaller than openings. Single louvers frames shall not exceed 1700 mm (66 inches) wide. When openings exceed 1700 mm (66 inches), provide twin louvers separated by mullion members.

2.3 CLOSURE ANGLES AND CLOSURE PLATES

- A. Fabricate from 2 mm (0.074-inch) thick stainless steel or aluminum.
- B. Provide continuous closure angles and closure plates on inside head, jambs and sill of exterior wall louvers.
- C. Secure angles and plates to louver frames with screws, and to masonry or concrete with fasteners as specified.

2.4 WIRE GUARDS

- A. Provide wire guards on outside of all exterior louvers, except on exhaust air louvers.
- B. Fabricate frames from 2 mm (0.081-inch) thick extruded or sheet aluminum designed to retain wire mesh.
- C. Wire mesh shall be woven from not less than 1.6 mm (0.063-inch) diameter aluminum wire square mesh.
- D. Miter corners and join by concealed corner clips or locks extending about 57 mm (2-1/4 inches) into rails and stiles. Equip wire guards over four feet in height with a mid-rail constructed as specified for frame components.
- E. Fasten frames to outside of louvers with aluminum or stainless steel devices designed to allow removal and replacement without damage to the wire guard or the louver.

2.6 AIR INTAKE VENTS

- A. Fabricate exterior louvered wall ventilators for fresh air intake for air conditioning units from extruded aluminum, ASTM B221. Form with integral horizontal louvers and frame, with drip extending beyond face of wall and integral water stops.

2.7 FINISH

- A. In accordance with NAAMM Metal Finishes Manual: AMP 500-505
- B. Aluminum Louvers
 1. Organic Finish: AAMA 605 (Fluorocarbon coating).

2.8 PROTECTION

- A. Provide protection for aluminum against galvanic action wherever dissimilar materials are in contact, by painting the contact surfaces of the dissimilar material with a heavy coat of bituminous paint (complete coverage), or by separating the contact surfaces with a performed synthetic rubber tape having pressure sensitive adhesive coating on one side.
- B. Isolate the aluminum from plaster, concrete and masonry by coating aluminum with zinc-chromate primer.
- C. Protect finished surfaces from damage during fabrication, erection, and after completion of the work.

PART 3 - EXECUTION**3.1 INSTALLATION**

- A. Set work accurately, in alignment and where shown. Items shall be plumb, level, free of rack and twist, and set parallel or perpendicular as required to line and plane of surface.
- B. Furnish setting drawings and instructions for installation of anchors and for the positioning of items having anchors to be built into masonry construction. Provide temporary bracing for such items until masonry is set.
- C. Provide anchoring devices and fasteners as shown and as necessary for securing louvers to building construction as specified. Power actuated drive pins may be used, except for removal items and where members would be deformed or substrate damaged by their use.
- D. Generally, set wall louvers in masonry walls during progress of the work. If wall louvers and vents are not delivered to job in time for installation in prepared openings, make provision for later installation.

3.2 CLEANING AND ADJUSTING

- A. After installation, all exposed prefinished and plated items and all items fabricated from stainless steel and aluminum shall be cleaned as recommended by the manufacturer and protected from damage until completion of the project.
- B. All movable parts, including hardware, shall be cleaned and adjusted to operate as designed without binding or deformation of the members, so as to be centered in the opening of frame, and where applicable, to have all contact surfaces fit tight and even without forcing or warping the components

01-08M

- - - E N D - - -

**SECTION 09 06 00
SCHEDULE FOR FINISHES**

PART I - GENERAL

1.1 DESCRIPTION

This section contains a coordinated system in which requirements for materials specified in other sections shown are identified by abbreviated material names and finish codes in the room finish schedule or shown for other locations.

1.2 MANUFACTURERS

Manufacturer's trade names and numbers used herein are only to identify colors, finishes, textures and patterns. Products of other manufacturer's equivalent to colors, finishes, textures and patterns of manufacturers listed that meet requirements of technical specifications will be acceptable upon approval in writing by contracting officer for finish requirements.

1.3 SUBMITALS

Submit in accordance with SECTION 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES—provide quadruplicate samples for color approval of materials and finishes specified in this section.

PART II - PRODUCTS

2.1 DIVISION 31 - SITE AND STREET FURNISHINGS

Item	Style Name/No.	Finish	Manufacture	Mfg. Color Name/No.
Benches	Existing			
Game Tables	N/A			
Planters	N/A			
Tree Grates	N/A			
Trash Receptacles	Existing			
Ash Receptacles	Existing			

2.2 DIVISION 03 - CONCRETE

A. SECTION 03 30 00, CAST IN PLACE CONCRETE // SECTION 03 30 53, MISCELLANEOUS CAST-IN-PLACE CONCRETE //

Surface	Finish Description
Concrete without color additives	Float finish/Trowel Finish/Broom Finish

2.3 DIVISION 04 - MASONRY

A. Section 04 05 13, MASONRY MORTARING and Section 04 05 16, MASONRY GROUTING

Finish Code	Manufacturer	Mfg. Color Name
-	TBD	TBD

B. Section 04 20 00, UNIT MASONRY

1. FACE BRICK (FB)				
Finish Code	Size	Pattern	Manufacturer	Mfg. Color Name/No.
Modular	2 1/2"x3 5/8"x7 5/8"	Running Bond	TBD	TBD

3.CONCRETE MASONRY UNIT (CMU)				
Type	Size	Pattern	Finish	Mfg. Color Name/No.
CMU Standard	7 5/8"x15 5/8"	Running Bond	Standard	TBD

--	--	--	--	--	--

2.4 DIVISION 05 – METALS

A. SECTION 05 12 00, STRUCTURAL STEEL FRAMING

Component	Finish	Color
-		Primed

B. SECTION 05 21 00, STEEL JOIST FRAMING

Finish	Color
-	Primed

C. SECTION 05 31 00, STEEL DECKING, SECTION 05 36 00, COMPOSITE METAL DECKING

Finish	Color
-	-

D. SECTION 05 40 00, COLD-FORMED METAL FRAMING

Finish	Color

E. SECTION 05 50 00, METAL FABRICATION

Item	Finish
Modular Channel Units	N/A
Channel Door Frames	Primed
	N/A
Edge Guards Angles for Opening in Slabs	Mill

Steel Covers and Frames for pits and trenches	N/A
Cast Iron Covers and Frames for Pits and Trenches	N/A
Steel Grating and Frames	Mill
Aluminum Gratings and Frames	N/A
Steel Plank Gratings	N/A
Cast Iron Gratings	N/A
Loose Lintels	N/A
Steel Plate Door Sill	Mill
Aluminum Plate Door Sill	N/A
Steel Ladders	Primed
Steel Ladder Rungs	Primed

F. SECTION 05 51 00, METAL STAIRS

Component	Finish	Color
Guard Rails	Mill	Primed
Handrails	Mill	Primed
Stringers	Mill	Primed
Risers	Mill	Primed
Underside	Mill	Primed

G. SECTION 07 95 13, EXPANSION JOINT COVER ASSEMBLIES

	Material	Finish	Manufacturer	Mfg. Color Name/No.
Floor Component Cover Plate Frame Casket or Sealant (interior only)				

Wall Component Cover Plate Frame Casket or Sealant (interior only)				
Ceiling Component Cover Plate, Gasket or Sealant (interior only)	Alum	Mill	TBD	TBD
Exterior Wall Cover Plate Frame Thermoplastic Joint	Alum	Mill	TBD	TBD

2.5 DIVISION 06 WOOD, PLASTICS, AND COMPOSITES

A. SECTION 06 10 00, ROUGH CARPENTRY

Item	Finish	Color

B. SECTION 06 20 00, FINISH CARPENTRY

1. RECEPTION COUNTER PUBLIC OR PATIENT SIDE				
Room No. and Name	Component	Material	Species	Finish Color
Work Rooms A118 & A123 Toilets	Casework	Plastic Laminate	-	TBD

G109, G110, A108, A115, A117, A120 A122	Countertop	Solid Surface	-	TBD	TBD
Activity A109 Kitchen A110 Dining A111	Casework	Manufactured Casework	Maple	TBD	TBD
	Countertop	Quartz	-	TBD	TBD

2. BENCHES (TYPE 20 A, 12 E, 13 B)				
Room No. and Name	Component	Finish/Color		
A109 Activity & Corridor A138	Seat	Fabric Cushion: TBD		
A109 Activity & Corridor A138	Support	Arch Millwork - Stain Grade Color: TBD		

3. MOUNTING STRIPS, SHELVES AND RODS				
Room No. and Name	Component	Finish/Color		
A103, A104, A105 Closets	Strips	TBD		
Closets	Shelf	TBD		
Closets	Rod	TBD		

4. VANITIES (TYPES S4, S4 M)			
Room No. and Name	Component	Finish/Color	
	Countertop	TBD	
-	Trim	-	

2.6 DIVISION 07 - THERMAL AND MOISTURE PROTECTION

A. STYRENE-BUTADIENE-STYRENE MODIFIED BITUMINOUS MEMBRANE ROOFING (07 52 16)

Pavers	Size	Material	Color	Manufacturer	Mfg. Color Name/No.
Walkway	1/2"x24"x24"	Pre-fab Asphalt Plank	White	TBD	TBD

B. SECTION 07 60 00, FLASHING AND SHEET METAL

Item	Material	Finish
Coping	Copper	Manuf. Std.
	Stainless steel	
	Aluminum	
Roof Insulated Expansion Joint Covers	Vinyl sheet	Manuf. Std.
Gravel Stops		
	Aluminum	Manuf. Std.

C. SECTION 07 71 00 / 07 72 00, ROOF SPECIALITIES AND ACCESSORIES

Item	Material	Finish	Manufacturer	Manufacturer/Color Name/Number.
Roof Hatch	Aluminum	Mill	TBD	TBD
Equipment Support	Galv. Steel	Paint		
Gravity Ventilators	Aluminum	Mill		
Copings	Extruded Aluminum			
Gravel Stops and Fascia System	Extruded Aluminum			
Fascia Systems	Extruded Aluminum			
Roof Expansion Joint Covers	Copper			

D. SECTION 07 92 00, JOINT SEALANTS

Location	Color	Manufacturer	Manufacturer Color
Masonry Expansion Joints	TBD	TBD	
CMU Control Joints	TBD	TBD	
New to Existing Walls	TBD	TBD	
Building Expansion Joints	TBD	TBD	
Masonry Sealed Joints	TBD	TBD	
Stone Veneer Sealed Joints	TBD	TBD	

2.7 DIVISION 08 - OPENINGS

A. SECTION 08 11 13, HOLLOW METAL DOORS AND FRAMES

Paint both sides of door and frames same color including ferrous metal louvers, and hardware attached to door	
Component	Color of Paint Type and Gloss

Door	Factory Primed/Field Paint
Frame	Alkyd Enamel Semi-gloss (Color TBD)

B. SECTION 08 14 00, WOOD DOORS

Component	Finish/Color
Doors	TBD
Frames	Alkyd Enamel Semi-gloss (Color TBD)

C. SECTION 08 31 13, ACCESS DOORS AND FRAMES

Material	Finish/Color
Steel	TBD

D. SECTION 08 41 13, ALUMINUM-FRAMED ENTRANCES AND STOREFRONTS

Material	Finish	Manufacturer	Manufacturer Color Name/No.
Aluminum	Manuf. Std.	TBD	TBD
Glass	Manuf. Std.	TBD	TBD

E. SECTION 08 71 00, BUILDERS HARDWARE

Item	Material	Finish
Hinges	Steel	Chromium Plated
Door Closers	Aluminum	Painted
Floor Closers		
Floor Pivot Sets		

Closer/ Holder		
Floor Stops	Steel	Satin Chromium
Door Holders		
Lock/ Latches	Steel	Satin Chromium
Key Cabinet	Steel	
Armor Plates	Metal	Satin Stainless Steel
Kick Mop Plates	Metal	Satin Stainless Steel
Exit Device	Steel	Satin Stainless Steel
Flush Bolts	Steel	Satin Stainless Steel
Door Pulls	Steel	Satin Stainless Steel
Push Plates	Steel	Satin Stainless Steel
Weather Strip	Neoprene	TBD
Threshold	Aluminum	Manuf. Std.

F. SECTION 08 80 00, GLAZING

Glazing Type	Manufacturer	Mfg. Color Name/No.
Type 1	TBD	TBD
Type 2	TBD	TBD
Type 3	TBD	TBD
Type 4	TBD	TBD

G. SECTION 08 44 13, GLAZED ALUMINUM CURTAIN WALLS

Component	Material	Finish	Manufacturer	Mfg. Color Name/No.
Frame	Alum	TBD	TBD	TBD
Glazing		TBD	TBD	TBD

2.8 DIVISION 09 - FINISHES**A. SECTION 09 30 13, CERAMIC TILING**

1. CERAMIC MOSAIC TILE (FT)					
Color	Size	Shape	Pattern	Manufacturer	Mfg. Color Name/No.
TBD	TBD	TBD	TBD	Daltile or equal	TBD

B. SECTION 09 51 00, ACOUSTICAL CEILINGS

Location	Finish Code	Component	Color Pattern	Manufacturer	Mfg Name/No.
Typical	-	Exposed Suspension System	White	Armstrong	
Common Areas	ACT-1		White	Armstrong	Ultima-tegular (2x2)
Offices	ACT-2		White	Armstrong	Dune - Layin (2x2)
Wet Locations	ACT-3		White	Armstrong	Ultima healthzone (2x2)
Ground/Out	ACT-4		White	Armstrong	Dune layin (2x4)

C. SECTION 09 65 19, RESILIENT TILE FLOORING

Finish Code	Size	Material/Component	Manufacturer	Mfg Name/No.
VCT-1	12x12	VCT	Armstrong	TBD
		R		
		RT		

D. SECTION 09 65 16, VINYL SHEET FLOORING, CHEMICAL WELDSFAMS (VSF)

Finish Code	Pattern name	Manufacturer	Mfg. Color Name/No.
SV-1	Forestscapes	Teknoflor	TBD
SV-2	Forestscapes	Teknoflor	TBD
SV-3	Forestscapes	Teknoflor	TBD
SV-4	Stronghold 30	Altro	TBD
SV-5	Granit	Johnsonite	TBD

E. SECTION 09 65 13, RESILIENT BASE STAIR TREADS AND ACCESSORIES

Finish Code	Item	Height	Manufacturer	Mfg Name/No.
RB-1	Vinyl Base (VB)	TBD	Johnsonite	Millwork Profile TBD
RB-2	Vinyl Base (VB)	4"		Traditional TBD
RB-3	Vinyl Base (VB)	4"	Johnsonite	Traditional TBD
RB-4	Vinyl Base (VB)	4"	Johnsonite	Traditional TBD
	Resilient Stair Treads (RST)	-	Johnsonite	TBD
RUB-	Sheet Rubber Flooring (SRF)	-	Johnsonite	TBD

1. SECTION 09 68 00, CARPET EDGE STRIP			
Finish Code	Material	Manufacturer	Mfg. Color Name/No.
RE: I1.1 For Location	Metal	Schluter - Carpet to resilient sheet	TBD
RE: I1.1 For Location	Metal	Schluter - Resilient sheet to Resilient sheet	TBD

F. SECTION 09 68 00, CARPET MODULES (CFT)

Finish Code	Size	Pattern direction	Manufacturer	Mfg. Color Name/No.
CPT-1	24"x24"	Monolithic	Patgraft	Walkoff TBD
CPT-2	24"x24"	Brick	J & J invision	Impact 1452 Blend
CPT-3	24"x24"	TBD	Mannington	TBD
CPT-4	24"x24"	Monolithic	Mannington	TBD
CPT-5	24"x24"	TBD	Mannington	TBD

G. SECTION 09 91 00, PAINT AND COATINGS

1. MPI Gloss and Sheen Standards

Gloss Level 1	a traditional matte finish-flat	Gloss @60	Sheen @85
Gloss Level 2	a high side sheen flat-"a velvet-like" finish	max 5 units, and max 10 units, and	max 10 units
Gloss Level 3	a traditional "egg-shell like" finish	10-25 units, and	10-35 units
Gloss Level 4	a "satin-like" finish	20-35 units, and	10-35 units
Gloss Level 5	a traditional semi-gloss	35-70 units	min. 35 units
Gloss Level 6	a traditional gloss	70-85 units	
Gloss level 7	a high gloss	more than 85 units	

2. Paint code	Gloss	Manufacturer	Mfg. Color Name/No.
P-1	Level 3	TBD	TBD
P-2	Level 3	TBD	TBD
P-3	Level 3	TBD	TBD
P-4	Level 3	TBD	TBD
P-5	Level 3	TBD	TBD

P-6	Level 5	TBD	TBD
P-7	Level 1	TBD	TBD
P-8	Level 5	TBD	TBD
P-9	Level 5	TBD	TBD
P-10	Level 5	TBD	TBD
3. Stain Code (S)	Gloss and Transparency	Manufacturer	Mfg. Color Name/No.
S	Opaque-Semi-gloss	-	To match casework
S-1			

2.9 DIVISION 10 - SPECIALTIES

A. SECTION 10 11 13 / 10 11 23, CHALKBOARDS / TACKBOARDS

Room No. and Name	Component	Material	Manufacturer	Mfg. Color Name/No.
Workroom A118, A123	Consealed Hardware	Fabric wrapped homosote	Marharam or equal	TBD

B. SECTION 10 21 16, PREFABRICATED SHOWER

Room No. and Name	Component	Material	Manufacturer	Mfg. Color Name/No.
Unisex Toilet A115	Shower Stall	Fiberglass	Best Bath	TBD

C. SECTION 08 90 00, LOUVERS AND WALL VENTS

Item	Material	Finish	Manufacturer	Mfg. Color Name/No.
	Alum	TBD	TBD	TBD

D. SECTION 10 26 00, CORNER GUARDS

Item	Material	Manufacturer	Mfg. Color Name/No.
Corner Guards (CG-1)	-	Acrovyn	TBD
Corner Guard (CG-2)	-	Acrovyn	TBD

E. SECTION 10 28 00 / 10 14 00 / 11 17 36, MISCELLANEOUS SPECIALITIES

Room No. and Name	Item	Finish	Manufacturer	Mfg. Color Name/No.
Janitor Closets	Mop Racks	TBD	TBD	TBD

F. SECTION 10 14 00, EXTERIOR SIGNS

Component	Finish	Manufacturer	Mfg. Color Name/No.
Exterior Building Sign	To match existing campus	To match existing campus	To match existing campus

G. SECTION 10 13 00 / 10 14 00, INTERIOR SIGNS

Sign Type	Component	Manufacturer	Mfg. Color Name/No.
Interior Space Designation	Per space	To match existing campus	To match existing campus

H. SECTION 10 44 13, FIRE EXTINGUISHER CABINETS

Component	Material	Finish

I. SECTION 10 28 00, TOILET AND BATH ACCESSORIES

Item	Material	Manufacturer	Mfg. Color Name/No.
Robe Hook	Steel	Moen Decorator	TBD
Shower Rod	Steel	Franklin Brass	TBD
24" Towel Bar	Steel	Moen Decorator	TBD
Mirror	Steel	Uttermost	TBD
Grab Bar	Steel	Kohler	TBD
Grab Bar	Steel	Kohler	TBD
Paper Towel Dispenser	Steel	Bobrick	TBD
Toilet Paper Dispenser	Steel	Bobrick	TBD
Soap Dispenser	Steel	Bobrick	TBD
Sanitary Napkin Disposal	Steel	Bobrick	TBD
Mop Holder	Steel	Bobrick	TBD
Vertical Grab Bar	Steel	Kohler	TBD
Trash Receptical	Steel	Bobrick	TBD

2.10 DIVISION 12- FURNISHINGS**A. SECTION 12 32 00, WOOD CASEWORK**

Item Type	Location	Style/Finish/Color
-	Activities A109, Kitchen A110	TBD

B. SECTION 12 36 00, COUNTERTOPS AND ACCESSORIES

Type	Manuf/Finish/Color
Molded Resin (Solid Surface)	Corian/TBD
Quartz	Zodiaz/TBD

C. SECTION 12 24 00, WINDOW SHADES

Component	Material	Manufacturer	Mfg. Color Name/No.
Roller Shade	-	Mechoshade	TBD
Support Hardware	-	Mechoshade	TBD

2.11 DIVISION 13 - SPECIAL CONSTRUCTION**A. SECTION 14 24 00, HYDRAULIC ELEVATORS**

1. Passenger Elevator No. P	Component	Material	Color
	Hoistway Entrances		
	Hoistway Doors		
	Corridor Position Indicator		

	Car Canopy		
	Panels	Plastic Laminate	TBD
	Car Floor	Sheet vinyl - Teknoflor SV-1	TBD
	Corridor Call Buttons		
	Car Doors	Stainless Steel	-
	Car Door Frame	Stainless Steel	-
	Corridor Position Indicator		
	Car Operating Panel		

2.12 DIVISION 22 - PLUMBING

A. SECTION 22 40 00, PLUMBING FIXTURES AND TRIM

Item	Color
Water Closet	TBD
Urinal	TBD
Bathtubs	TBD
Lavatories	TBD
Service Sink Corner	TBD
Service Sink	TBD
Clinic Service Sink	TBD
Plaster Sink	TBD
Laundry Tub	TBD

2.13 DIVISION 26 - ELECTRICAL

A. SECTION 26 51 00, BUILDING LIGHTING INTERIOR

Fixture Type	Exterior Finish	Color

B. SECTION 26 56 00, SITE LIGHTING

Type and Component	Exterior Finish	Manufacturer	Mfg. Name/No.

PART III EXECUTION**3.1 FINISH SCHEDULES & MISCELLANEOUS ABBREVIATIONS**

FINISH SCHEDULE & MISCELLANEOUS ABBREVIATIONS	
Term	Abbreviation
Access Flooring	AF
Accordion Folding Partition	AFP
Acoustical Ceiling	ACT
Acoustical Ceiling, Special Faced	ACT (SP)
Acoustical Metal Pan Ceiling	AMP
Acoustical Wall Panel	AWP
Acoustical Wall Treatment	AWT
Acoustical Wallcovering	AWF

Anodized Aluminum Colored	AAC
Anodized Aluminum Natural Finish	AA
Baked On Enamel	BE
Brick Face	BR
Brick Flooring	BF
Brick Paving	BP
Carpet	CP
Carpet Athletic Flooring	CAF
Carpet Module Tile	CPT
Ceramic Glazed Facing Brick	CGFB
Ceramic Mosaic Tile	FTCT
Concrete	C
Concrete Masonry Unit	CMU
Divider Strips Marble	DS MB

Epoxy Coating	EC
Epoxy Resin Flooring	ERF
Existing	E
Exposed Divider Strips	EXP
Exterior	EXT
Exterior Finish System	EFS
Exterior Paint	EXT-P
Exterior Stain	EXT-ST
Fabric Wallcovering	WF
Facing Tile	SCT
Feature Strips	FS
Floor Mats & Frames	FM
Floor Tile, Mosaic	FT
Fluorocarbon	FC
Folding Panel Partition	FP
Foot Grille	FG
Glass Masonry Unit	GUMU
Glazed Face CMU	GCMU
Glazed Structural Facing Tile	SFTU
Granite	GT
Gypsum Wallboard	GWB
High Glazed Coating	SC
Latex Mastic Flooring	LM
Linear Metal Ceiling	LMC
Linear Wood Ceiling	LWC
Marble	MB
Material	MAT
Mortar	M
Multi-Color Coating	MC
Natural Finish	NF
Paint	P
Paver Tile	PVT
Perforated Metal Facing (Tile or Panels)	PMF
Plaster	PL
Plaster High Strength	HSPL
Plaster Keene Cement	KC

Plastic Laminate	HPDL
Polypropylene Fabric Wallcovering	PFW
Porcelain Paver Tile	PPT
Quarry Tile	QT
Radiant Ceiling Panel System	RCP
Resilient Stair Tread	RST
Rubber Base	RB
Rubber Tile Flooring	RT
Spandrel Glass	SLG
Stain	ST
Stone Flooring	SF
Structural Clay	SC
Suspension Decorative Grids	SDG
Terrazzo Portland Cement	PCT
Terrazzo Tile	TT
Terrazzo, Thin Set	
Textured Gypsum Ceiling Panel	TGC
Textured Metal Ceiling Panel	TMC
Thin set Terrazzo	TST
Veneer Plaster	VP
Vinyl Base	VB
Vinyl Coated Fabric Wallcovering	W
Vinyl Composition Tile	VCT
Vinyl Sheet Flooring	VSF
Vinyl Sheet Flooring (Welded Seams)	WSF
Wall Border	WB
Wood	WD

3.2 FINISH SCHEDULE SYMBOLS

Symbol	Definition
**	Same finish as adjoining walls
-	No color required
E	Existing
XX	To match existing
EFTR	Existing finish to remain
RM	Remove

3.3 ROOM FINISH SCHEDULE

- A. Match adjoining or existing similar surfaces colors, textures or patterns where disturbed or damaged by alterations or new work when not scheduled.
- B. ROOM FINISH SCHEDULE

ROOM FINISH SCHEDULE INSERT HERE

--- E N D---

SECTION 09 22 16
NON-STRUCTURAL METAL FRAMING

PART 1 - GENERAL

1.1 DESCRIPTION

This section specifies steel studs wall systems, shaft wall systems, ceiling or soffit suspended or furred framing, wall furring, fasteners, and accessories for the screw attachment of gypsum board, or other building boards.

1.2 RELATED WORK

- A. Load bearing framing: Section 05 40 00, COLD-FORMED METAL FRAMING.
- B. Support for wall mounted items: Section 05 50 00, METAL FABRICATIONS.
- C. Ceiling suspension systems for acoustical tile or panels and lay in gypsum board panels: Section 09 51 00, ACOUSTICAL CEILINGS.

1.3 TERMINOLOGY

- A. Description of terms shall be in accordance with ASTM C754, ASTM C11, ASTM C841 and as specified.
- B. Underside of Structure Overhead: In spaces where steel trusses or bar joists are shown, the underside of structure overhead shall be the underside of the floor or roof construction supported by beams, trusses, or bar joists. In interstitial spaces with walk-on floors the underside of the walk-on floor is the underside of structure overhead.
- C. Thickness of steel specified is the minimum bare (uncoated) steel thickness.

1.4 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturer's Literature and Data:
 - 1. Studs, runners and accessories.
 - 2. Hanger inserts.
 - 3. Channels (Rolled steel).
 - 4. Furring channels.
 - 5. Screws, clips and other fasteners.
- C. Shop Drawings:
 - 1. Typical ceiling suspension system.
 - 2. Typical metal stud and furring construction system including details around openings and corner details.
 - 3. Typical shaft wall assembly

4. Typical fire rated assembly and column fireproofing showing details of construction same as that used in fire rating test.
- D. Test Results: Fire rating test designation, each fire rating required for each assembly.

1.5 DELIVERY, IDENTIFICATION, HANDLING AND STORAGE

In accordance with the requirements of ASTM C754.

1.6 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American Society For Testing And Materials (ASTM)
- | | |
|---------------------|--|
| A123-09..... | Zinc (Hot-dip Galvanized) Coatings on Iron and Steel Products |
| A653/A653M-09..... | Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy Coated (Galvannealed) by the Hot-Dip Process |
| A641-09..... | Zinc-Coated (Galvanized) Carbon Steel Wire |
| C11-10..... | Terminology Relating to Gypsum and Related Building Materials and Systems |
| C635-07..... | Manufacture, Performance, and Testing of Metal Suspension System for Acoustical Tile and Lay-in Panel Ceilings |
| C636-06..... | Installation of Metal Ceiling Suspension Systems for Acoustical Tile and Lay-in Panels |
| C645-09..... | Non-Structural Steel Framing Members |
| C754-09..... | Installation of Steel Framing Members to Receive Screw-Attached Gypsum Panel Products |
| C841-03(R2008)..... | Installation of Interior Lathing and Furring |
| C954-07..... | Steel Drill Screws for the Application of Gypsum Panel Products or Metal Plaster Bases to Steel Studs from 0.033 in. (0.84 mm) to 0.112 in. (2.84 mm) in Thickness |
| C1002-07..... | Steel Self-Piercing Tapping Screws for the Application of Gypsum Panel Products or Metal Plaster Bases to Wood Studs or Steel Studs |
| E580-09..... | Application of Ceiling Suspension Systems for Acoustical Tile and Lay-in Panels in Areas Requiring Moderate Seismic Restraint. |

PART 2 - PRODUCTS**2.1 PROTECTIVE COATING**

Galvanize steel studs, runners (track), rigid (hat section) furring channels, and resilient furring channels, with coating designation of G-60 minimum, per ASTM 123.

2.2 STEEL STUDS AND RUNNERS (TRACK)

- A. ASTM C645, modified for thickness specified and sizes as shown.
 - 1. Use ASTM A525 steel, 0.8 mm (0.0329-inch) thick bare metal (33 mil).
 - 2. Runners same thickness as studs.
- B. Provide not less than two cutouts in web of each stud, approximately 300 mm (12 inches) from each end, and intermediate cutouts on approximately 600 mm (24-inch) centers.
- C. Doubled studs for openings and studs for supporting concrete backer-board.
- D. Studs 3600 mm (12 feet) or less in length shall be in one piece.
- E. Shaft Wall Framing:
 - 1. Conform to rated wall construction.
 - 2. C-H Studs.
 - 3. E Studs.
 - 4. J Runners.
 - 5. Steel Jamb-Strut.

2.3 FURRING CHANNELS

- A. Rigid furring channels (hat shape): ASTM C645.
- B. Resilient furring channels:
 - 1. Not less than 0.45 mm (0.0179-inch) thick bare metal.
- C. Rolled Steel Channels: ASTM C754, cold rolled; or, ASTM C841, cold rolled.

2.4 FASTENERS, CLIPS, AND OTHER METAL ACCESSORIES

- A. ASTM C754, except as otherwise specified.
- B. For fire rated construction: Type and size same as used in fire rating test.
- C. Fasteners for steel studs thicker than 0.84 mm (0.033-inch) thick. Use ASTM C954 steel drill screws of size and type recommended by the manufacturer of the material being fastened.
- D. Clips: ASTM C841 (paragraph 6.11), manufacturer's standard items.

Clips used in lieu of tie wire shall have holding power equivalent to that provided by the tie wire for the specific application.

- E. Concrete ceiling hanger inserts (anchorage for hanger wire and hanger straps): Steel, zinc-coated (galvanized), manufacturers standard items, designed to support twice the hanger loads imposed and the type of hanger used.
- F. Tie Wire and Hanger Wire:
 - 1. ASTM A641, soft temper, Class 1 coating.
 - 2. Gage (diameter) as specified in ASTM C754 or ASTM C841.
- G. Attachments for Wall Furring:
 - 1. Manufacturers standard items fabricated from zinc-coated (galvanized) steel sheet.
 - 2. For concrete or masonry walls: Metal slots with adjustable inserts or adjustable wall furring brackets. Spacers may be fabricated from 1 mm (0.0396-inch) thick galvanized steel with corrugated edges.
- H. Power Actuated Fasteners: Type and size as recommended by the manufacturer of the material being fastened.

2.5 SUSPENDED CEILING SYSTEM FOR GYPSUM BOARD (OPTION)

- A. Conform to ASTM C635, heavy duty, with not less than 35 mm (1-3/8 inch) wide knurled capped flange face designed for screw attachment of gypsum board.
- B. Wall track channel with 35 mm (1-3/8 inch) wide flange.

PART 3 - EXECUTION

3.1 INSTALLATION CRITERIA

- A. Where fire rated construction is required for walls, partitions, columns, beams and floor-ceiling assemblies, the construction shall be same as that used in fire rating test.
- B. Construction requirements for fire rated assemblies and materials shall be as shown and specified, the provisions of the Scope paragraph (1.2) of ASTM C754 and ASTM C841 regarding details of construction shall not apply.

3.2 INSTALLING STUDS

- A. Install studs in accordance with ASTM C754, except as otherwise shown or specified.
- B. Space studs not more than 610 mm (24 inches) on center.
- C. Cut studs 6 mm to 9 mm (1/4 to 3/8-inch) less than floor to underside of structure overhead when extended to underside of structure overhead.
- D. Where studs are shown to terminate above suspended ceilings, provide bracing as shown or extend studs to underside of structure overhead.

- E. Extend studs to underside of structure overhead for fire, rated partitions, smoke partitions, shafts, and sound rated partitions and insulated exterior wall furring.
- F. Openings:
 - 1. Frame jambs of openings in stud partitions and furring with two studs placed back to back or as shown.
 - 2. Fasten back to back studs together with 9 mm (3/8-inch) long Type S pan head screws at not less than 600 mm (two feet) on center, staggered along webs.
 - 3. Studs fastened flange to flange shall have splice plates on both sides approximately 50 X 75 mm (2 by 3 inches) screwed to each stud with two screws in each stud. Locate splice plates at 600 mm (24 inches) on center between runner tracks.
- G. Fastening Studs:
 - 1. Fasten studs located adjacent to partition intersections, corners and studs at jambs of openings to flange of runner tracks with two screws through each end of each stud and flange of runner.
 - 2. Do not fasten studs to top runner track when studs extend to underside of structure overhead.
- H. Chase Wall Partitions:
 - 1. Locate cross braces for chase wall partitions to permit the installation of pipes, conduits, carriers and similar items.
 - 2. Use studs or runners as cross bracing not less than 63 mm (2-1/2 inches wide).

3.3 INSTALLING WALL FURRING FOR FINISH APPLIED TO ONE SIDE ONLY

- A. In accordance with ASTM C754, or ASTM C841 except as otherwise specified or shown.
- B. Wall furring-Stud System:
 - 1. Framed with 63 mm (2-1/2 inch) or narrower studs, 600 mm (24 inches) on center.
 - 2. Brace as specified in ASTM C754 for Wall Furring-Stud System or brace with sections or runners or studs placed horizontally at not less than three foot vertical intervals on side without finish.
 - 3. Securely fasten braces to each stud with two Type S pan head screws at each bearing.
- C. Direct attachment to masonry or concrete; rigid channels or "Z" channels:

1. Install rigid (hat section) furring channels at 600 mm (24 inches) on center, horizontally or vertically.
 2. Install "Z" furring channels vertically spaced not more than 600 mm (24 inches) on center.
 3. At corners where rigid furring channels are positioned horizontally, provide mitered joints in furring channels.
 4. Ends of spliced furring channels shall be nested not less than 200 mm (8 inches).
 5. Fasten furring channels to walls with power-actuated drive pins or hardened steel concrete nails. Where channels are spliced, provide two fasteners in each flange.
 6. Locate furring channels at interior and exterior corners in accordance with wall finish material manufacturers printed erection instructions. Locate "Z" channels within 100 mm (4 inches) of corner.
- D. Installing Wall Furring-Bracket System: Space furring channels not more than 400 mm (16 inches) on center.

3.4 INSTALLING SUPPORTS REQUIRED BY OTHER TRADES

- A. Provide for attachment and support of electrical outlets, plumbing, laboratory or heating fixtures, recessed type plumbing fixture accessories, access panel frames, wall bumpers, wood seats, toilet stall partitions, dressing booth partitions, urinal screens, chalkboards, tackboards, wall-hung casework, handrail brackets, recessed fire extinguisher cabinets and other items like auto door buttons and auto door operators supported by stud construction.
- B. Provide additional studs where required. Install metal backing plates, or special metal shapes as required, securely fastened to metal studs.

3.5 INSTALLING SHAFT WALL SYSTEM

- A. Conform to UL Design No. U417 for two-hour fire rating. Provide two hour fire rating Shaft wall ceiling at Electrical Room.
- B. Position J runners at floor and ceiling with the short leg toward finish side of wall. Securely attach runners to structural supports with power driven fasteners at both ends and 600 mm (24 inches) on center.
- C. After liner panels have been erected, cut C-H studs and E studs, from 9 mm (3/8-inch) to not more than 13 mm (1/2-inch) less than floor-to-ceiling height. Install C-H studs between liner panels with liner panels inserted in the groove.

- D. Install full-length steel E studs over shaft wall line at intersections, corners, hinged door jambs, columns, and both sides of closure panels.
- E. Suitably frame all openings to maintain structural support for wall:
 - 1. Provide necessary liner fillers and shims to conform to label frame requirements.
 - 2. Frame openings cut within a liner panel with E studs around perimeter.
 - 3. Frame openings with vertical E studs at jambs, horizontal J runner at head and sill.

3.6 INSTALLING FURRED AND SUSPENDED CEILINGS OR SOFFITS

- A. Install furred and suspended ceilings or soffits in accordance with ASTM C754 or ASTM C841 except as otherwise specified or shown for screw attached gypsum board ceilings and for plaster ceilings or soffits.
 - 1. Space framing at 600 mm (24-inch) centers for gypsum board anchorage.
- B. New exposed concrete slabs:
 - 1. Use metal inserts required for attachment and support of hangers or hanger wires with tied wire loops for embedding in concrete.
 - 2. Furnish for installation under Division 3, CONCRETE.
 - 3. Suspended ceilings under concrete rib construction shall have runner channels at right angles to ribs and be supported from ribs with hangers at ends and at 1200 mm (48-inch) maximum intervals along channels. Stagger hangers at alternate channels.
- C. Concrete slabs on steel decking composite construction:
 - 1. Use pull down tabs when available.
 - 2. Use power activated fasteners when direct attachment to structural framing can not be accomplished.
- D. Where bar joists or beams are more than 1200 mm (48 inches) apart, provide intermediate hangers so that spacing between supports does not exceed 1200 mm (48 inches). Use clips, bolts, or wire ties for direct attachment to steel framing.
- E. Steel decking without concrete topping:
 - 1. Do not fasten to steel decking 0.76 mm (0.0299-inch) or thinner.
 - 2. Toggle bolt to decking 0.9 mm (0.0359-inch) or thicker only where anchorage to steel framing is not possible.
- F. Installing suspended ceiling system for gypsum board (ASTM C635 Option):

1. Install only for ceilings to receive screw attached gypsum board.
2. Install in accordance with ASTM C636.
 - a. Install main runners spaced 1200 mm (48 inches) on center.
 - b. Install 1200 mm (four foot) tees not over 600 mm (24 inches) on center; locate for edge support of gypsum board.
 - c. Install wall track channel at perimeter.
- G. Installing Ceiling Bracing System:
 1. Construct bracing of 38 mm (1-1/2 inch) channels for lengths up to 2400 mm (8 feet) and 50 mm (2 inch) channels for lengths over 2400 mm (8 feet) with ends bent to form surfaces for anchorage to carrying channels and over head construction. Lap channels not less than 600 mm (2 feet) at midpoint back to back. Screw or bolt lap together with two fasteners.
 2. Install bracing at an approximate 45 degree angle to carrying channels and structure overhead; secure as specified to structure overhead with two fasteners and to carrying channels with two fasteners or wire ties.
 3. Brace suspended ceiling or soffit framing in seismic areas in accordance with ASTM E580.

3.7 TOLERANCES

- A. Fastening surface for application of subsequent materials shall not vary more than 3 mm (1/8-inch) from the layout line.
- B. Plumb and align vertical members within 3 mm (1/8-inch.)
- C. Level or align ceilings within 3 mm (1/8-inch.)

- - - E N D - - -

**SECTION 09 29 00
GYPSUM BOARD**

PART 1 - GENERAL

1.1 DESCRIPTION

This section specifies installation and finishing of gypsum board.

1.2 RELATED WORK

- A. Installation of steel framing members for walls, partitions, furring, soffits, and ceilings: Section 05 40 00, COLD-FORMED METAL FRAMING, and Section 09 22 16, NON-STRUCTURAL METAL FRAMING.
- B. Sound deadening board: Section 07 21 13, THERMAL INSULATION.
- C. Acoustical Sealants: Section 07 92 00, JOINT SEALANTS.

1.3 TERMINOLOGY

- A. Definitions and description of terms shall be in accordance with ASTM C11, C840, and as specified.
- B. Underside of Structure Overhead: In spaces where steel trusses or bar joists are shown, the underside of structure overhead shall be the underside of the floor or roof construction supported by the trusses or bar joists.
- C. "Yoked": Gypsum board cut out for opening with no joint at the opening (along door jamb or above the door).

1.4 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturer's Literature and Data:
 - 1. Cornerbead and edge trim.
 - 2. Finishing materials.
 - 3. Laminating adhesive.
 - 4. Gypsum board, each type.
- C. Shop Drawings:
 - 1. Typical gypsum board installation, showing corner details, edge trim details and the like.
 - 2. Typical sound rated assembly, showing treatment at perimeter of partitions and penetrations at gypsum board.
 - 3. Typical shaft wall assembly.
 - 4. Typical fire rated assembly and column fireproofing, indicating details of construction same as that used in fire rating test.
- D. Samples:

1. Cornerbead.
2. Edge trim.
3. Control joints.

E. Test Results:

1. Fire rating test, each fire rating required for each assembly.
2. Sound rating test.

1.5 DELIVERY, IDENTIFICATION, HANDLING AND STORAGE

In accordance with the requirements of ASTM C840.

1.6 ENVIRONMENTAL CONDITIONS

In accordance with the requirements of ASTM C840.

1.7 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American Society for Testing And Materials (ASTM):
 - C11-08.....Terminology Relating to Gypsum and Related Building Materials and Systems
 - C475-02.....Joint Compound and Joint Tape for Finishing Gypsum Board
 - C840-08.....Application and Finishing of Gypsum Board
 - C919-08.....Sealants in Acoustical Applications
 - C954-07.....Steel Drill Screws for the Application of Gypsum Board or Metal Plaster Bases to Steel Stud from 0.033 in. (0.84mm) to 0.112 in. (2.84mm) in thickness
 - C1002-07.....Steel Self-Piercing Tapping Screws for the Application of Gypsum Panel Products or Metal Plaster Bases to Wood Studs or Steel Studs
 - C1047-05.....Accessories for Gypsum Wallboard and Gypsum Veneer Base
 - C1177-06.....Glass Mat Gypsum Substrate for Use as Sheathing
 - C1658-06.....Glass Mat Gypsum Panels
 - C1396-06.....Gypsum Board
 - E84-08.....Surface Burning Characteristics of Building Materials
- C. Underwriters Laboratories Inc. (UL):
 - Latest Edition.....Fire Resistance Directory
- D. Inchcape Testing Services (ITS):

Latest Editions.....Certification Listings

PART 2 - PRODUCTS

2.1 GYPSUM BOARD

- A. Gypsum Board: ASTM C1396, Type X, 16 mm (5/8 inch) thick unless shown otherwise. Shall contain a minimum of 20 percent recycled gypsum.
- B. Coreboard or Shaft Wall Liner Panels.
 - 1. ASTM C1396, Type X.
 - 2. ASTM C1658: Glass Mat Gypsum Panels,
 - 3. Coreboard for shaft walls 300, 400, 600 mm (12, 16, or 24 inches) wide by required lengths 25 mm (one inch) thick with paper faces treated to resist moisture.
- C. Water Resistant Gypsum Backing Board: ASTM C620, Type X, 16 mm (5/8 inch) thick.
- D. Gypsum cores shall contain a minimum of 95 percent post industrial recycled gypsum content. Paper facings shall contain 100 percent post-consumer recycled paper content.

2.2 GYPSUM SHEATHING BOARD

- A. ASTM C1396, Type X, water-resistant core, 16 mm (5/8 inch) thick.
- B. ASTM C1177, Type X.

2.3 ACCESSORIES

- A. ASTM C1047, except form of 0.39 mm (0.015 inch) thick zinc coated steel sheet or rigid PVC plastic.
- B. Flanges not less than 22 mm (7/8 inch) wide with punchouts or deformations as required to provide compound bond.

2.4 FASTENERS

- A. ASTM C1002 and ASTM C840, except as otherwise specified.
- B. ASTM C954, for steel studs thicker than 0.04 mm (0.33 inch).
- C. Select screws of size and type recommended by the manufacturer of the material being fastened.
- D. For fire rated construction, type and size same as used in fire rating test.
- E. Clips: Zinc-coated (galvanized) steel; gypsum board manufacturer's standard items.

2.5 FINISHING MATERIALS AND LAMINATING ADHESIVE

ASTM C475 and ASTM C840. Free of antifreeze, vinyl adhesives, preservatives, biocides and other VOC. Adhesive shall contain a maximum VOC content of 50 g/l.

PART 3 - EXECUTION**3.1 GYPSUM BOARD HEIGHTS**

- A. Extend all layers of gypsum board from floor to underside of structure overhead on following partitions and furring:
 - 1. Two sides of partitions:
 - a. Fire rated partitions.
 - b. Smoke partitions.
 - c. Sound rated partitions.
 - d. Full height partitions shown (FHP).
 - 2. One side of partitions or furring:
 - a. Inside of exterior wall furring or stud construction.
 - b. Room side of room without suspended ceilings.
 - c. Furring for pipes and duct shafts, except where fire rated shaft wall construction is shown.
 - 3. Extend all layers of gypsum board construction used for fireproofing of columns from floor to underside of structure overhead, unless shown otherwise.
- B. In locations other than those specified, extend gypsum board from floor to heights as follows:
 - 1. Not less than 100 mm (4 inches) above suspended acoustical ceilings.
 - 2. At ceiling of suspended gypsum board ceilings.
 - 3. At existing ceilings.

3.2 INSTALLING GYPSUM BOARD

- A. Coordinate installation of gypsum board with other trades and related work.
- B. Install gypsum board in accordance with ASTM C840, except as otherwise specified.
- C. Moisture and Mold-Resistant Assemblies: Provide and install moisture and mold-resistant glass mat gypsum wallboard products with moisture-resistant surfaces complying with ASTM C1658 where shown and in locations which might be subject to moisture exposure during construction.
- D. Use gypsum boards in maximum practical lengths to minimize number of end joints.
- E. Bring gypsum board into contact, but do not force into place.
- F. Ceilings:
 - 1. For single-ply construction, use perpendicular application.
 - 2. For two-ply assemblies:

- a. Use perpendicular application.
- b. Apply face ply of gypsum board so that joints of face ply do not occur at joints of base ply with joints over framing members.

G. Walls (Except Shaft Walls):

1. When gypsum board is installed parallel to framing members, space fasteners 300 mm (12 inches) on center in field of the board, and 200 mm (8 inches) on center along edges.
2. When gypsum board is installed perpendicular to framing members, space fasteners 300 mm (12 inches) on center in field and along edges.
3. Stagger screws on abutting edges or ends.
4. For single-ply construction, apply gypsum board with long dimension either parallel or perpendicular to framing members as required to minimize number of joints except gypsum board shall be applied vertically over "Z" furring channels.
5. For two-ply gypsum board assemblies, apply base ply of gypsum board to assure minimum number of joints in face layer. Apply face ply of wallboard to base ply so that joints of face ply do not occur at joints of base ply with joints over framing members.
6. For three-ply gypsum board assemblies, apply plies in same manner as for two-ply assemblies, except that heads of fasteners need only be driven flush with surface for first and second plies. Apply third ply of wallboard in same manner as second ply of two-ply assembly, except use fasteners of sufficient length enough to have the same penetration into framing members as required for two-ply assemblies.
7. No offset in exposed face of walls and partitions will be permitted because of single-ply and two-ply or three-ply application requirements.
8. Installing Two Layer Assembly Over Sound Deadening Board:
 - a. Apply face layer of wallboard vertically with joints staggered from joints in sound deadening board over framing members.
 - b. Fasten face layer with screw, of sufficient length to secure to framing, spaced 300 mm (12 inches) on center around perimeter, and 400 mm (16 inches) on center in the field.
9. Control Joints ASTM C840 and as follows:
 - a. Locate at both side jambs of openings if gypsum board is not "yoked". Use one system throughout.
 - b. Not required for wall lengths less than 9000 mm (30 feet).

- c. Extend control joints the full height of the wall or length of soffit/ceiling membrane.

H. Acoustical or Sound Rated Partitions, Fire and Smoke Partitions:

- 1. Cut gypsum board for a space approximately 3 mm to 6 mm (1/8 to 1/4 inch) wide around partition perimeter.
- 2. Coordinate for application of caulking or sealants to space prior to taping and finishing.
- 3. For sound rated partitions, use sealing compound (ASTM C919) to fill the annular spaces between all receptacle boxes and the partition finish material through which the boxes protrude to seal all holes and/or openings on the back and sides of the boxes. STC minimum values as shown.

I. Electrical and Telecommunications Boxes:

- 1. Seal annular spaces between electrical and telecommunications receptacle boxes and gypsum board partitions.

J. Accessories:

- 1. Set accessories plumb, level and true to line, neatly mitered at corners and intersections, and securely attach to supporting surfaces as specified.
- 2. Install in one piece, without the limits of the longest commercially available lengths.
- 3. Corner Beads:
 - a. Install at all vertical and horizontal external corners and where shown.
 - b. Use screws only. Do not use crimping tool.
- 4. Edge Trim (casings Beads):
 - a. At both sides of expansion and control joints unless shown otherwise.
 - b. Where gypsum board terminates against dissimilar materials and at perimeter of openings, except where covered by flanges, casings or permanently built-in equipment.
 - c. Where gypsum board surfaces of non-load bearing assemblies abut load bearing members.
 - d. Where shown.

3.3 INSTALLING GYPSUM SHEATHING

- A. Install in accordance with ASTM C840, except as otherwise specified or shown.
- B. Use screws of sufficient length to secure sheathing to framing.

- C. Space screws 9 mm (3/8 inch) from ends and edges of sheathing and 200 mm (8 inches) on center. Space screws a maximum of 200 mm (8 inches) on center on intermediate framing members.
- D. Apply 600 mm by 2400 mm (2 foot by 8 foot) sheathing boards horizontally with tongue edge up.
- E. Apply 1200 mm by 2400 mm or 2700 mm (4 ft. by 8 ft. or 9 foot) gypsum sheathing boards vertically with edges over framing.

3.4 CAVITY SHAFT WALL

- A. Coordinate assembly with Section 09 22 16, NON-STRUCTURAL METAL FRAMING, for erection of framing and gypsum board.
- B. Conform to UL Design No. U438 or FM WALL CONSTRUCTION 12-2/HR (Nonbearing for two-hour fire rating. // Conform to FM WALL CONSTRUCTION 25-1/HR (Non-loadbearing) for one-hour fire rating where shown. //
- C. Cut coreboard (liner) panels 25 mm (one inch) less than floor-to-ceiling height, and erect vertically between J-runners on shaft side.
 - 1. Where shaft walls exceed 4300 mm (14 feet) in height, position panel end joints within upper and lower third points of wall.
 - 2. Stagger joints top and bottom in adjacent panels.
 - 3. After erection of J-struts of opening frames, fasten panels to J-struts with screws of sufficient length to secure to framing staggered from those in base, spaced 300 mm (12 inches) on center.
- D. Gypsum Board:
 - 1. Two hour wall:
 - a. Erect base layer (backing board) vertically on finish side of wall with end joints staggered. Fasten base layer panels to studs with 25 mm (one inch) long screws, spaced 600 mm (24 inches) on center.
 - b. Use laminating adhesive between plies in accordance with UL or FM if required by fire test.
 - c. Apply face layer of gypsum board required by fire test vertically over base layer with joints staggered and attach with screws of sufficient length to secure to framing staggered from those in base, spaced 300 mm (12 inches) on center.
 - 2. One hour wall with one layer on finish side of wall: Apply face layer of gypsum board vertically. Attach to studs with screws of sufficient length to secure to framing, spaced 300 mm (12 inches) on center in field and along edges.

3. Where coreboard is covered with face layer of gypsum board, stagger joints of face layer from those in the coreboard base.
- E. Treat joints, corners, and fasteners in face layer as specified for finishing of gypsum board.

3.5 FINISHING OF GYPSUM BOARD

- A. Finish joints, edges, corners, and fastener heads in accordance with ASTM C840. Use Level 5 finish for all finished areas open to public view.
- B. Before proceeding with installation of finishing materials, assure the following:
 1. Gypsum board is fastened and held close to framing or furring.
 2. Fastening heads in gypsum board are slightly below surface in dimple formed by driving tool.
- C. Finish joints, fasteners, and all openings, including openings around penetrations, on that part of the gypsum board extending above suspended ceilings to seal surface of non decorated fire rated gypsum board construction. After the installation of hanger rods, hanger wires, supports, equipment, conduits, piping and similar work, seal remaining openings and maintain the integrity of the fire rated construction. Sanding is not required of non decorated surfaces.

3.6 REPAIRS

- A. After taping and finishing has been completed, and before decoration, repair all damaged and defective work, including nondecorated surfaces.
- B. Patch holes or openings 13 mm (1/2 inch) or less in diameter, or equivalent size, with a setting type finishing compound or patching plaster.
- C. Repair holes or openings over 13 mm (1/2 inch) diameter, or equivalent size, with 16 mm (5/8 inch) thick gypsum board secured in such a manner as to provide solid substrate equivalent to undamaged surface.
- D. Tape and refinish scratched, abraded or damaged finish surfaces including cracks and joints in non decorated surface to provide fire protection equivalent to the fire rated construction.

- - - E N D - - -

SECTION 09 30 13
CERAMIC TILING

PART 1 - GENERAL

1.1 DESCRIPTION

This section specifies ceramic, glass mosaic wall tile.

1.2 RELATED WORK

- A. Color, texture and pattern of field tile and trim shapes, size of field tile, trim shapes, and color of grout specified: Section 09 06 00, SCHEDULE FOR FINISHES.

1.3 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Samples:
1. Wall tile, each color, size and pattern.
 2. Trim shapes, bullnose cap and cove including bullnose cap and base pieces at internal and external corners of vertical surfaces, each type, color, and size.
- C. Product Data:
1. Ceramic, porcelain glass tile, marked to show each type, size, and shape required.
 2. Commercial Portland cement grout.
- D. Certification:
1. Master grade, ANSI A137.1.
 2. Manufacturer's certificates indicating that the following materials comply with specification requirements:
 - a. Latex-Portland cement mortar and grout.

1.4 DELIVERY AND STORAGE

- A. Deliver materials in containers with labels legible and intact and grade-seals unbroken.
- B. Store material to prevent damage or contamination.

1.5 APPLICABLE PUBLICATIONS

- A. Publications listed below form a part of this specification to the extent referenced. Publications are referenced in text by basic designation only.
- B. American National Standards Institute (ANSI):
- A10.20-05.....Safety Requirements for Ceramic Tile, Terrazzo, and Marble Works

- A108.1A-05.....Installation of Ceramic Tile in the Wet-Set
Method with Portland Cement Mortar
- A108.1B-05.....Installation of Ceramic Tile on a Cured
Portland Cement Mortar Setting Bed with dry-Set
or latex-Portland Cement Mortar
- A108.10-05.....Installation of Grout in Tilework
- A118.4-05.....Latex-Portland Cement Mortar
- A118.6-05.....Standard Cement Grouts for Tile Installation
- A137.1-88.....Ceramic Tile
- C. American Society For Testing And Materials (ASTM):
 - C627-93 (R2007).....Evaluating Ceramic Floor Tile Installation
Systems Using the Robinson-Type Floor Tester
 - C954-07.....Steel Drill Screws for the Application of
Gypsum Board on Metal Plaster Base to Steel
Studs from 0.033 in (0.84 mm) to 0.112 in (2.84
mm) in thickness
 - C1002-07.....Steel Self-Piercing Tapping Screws for the
Application of Panel Products
 - C1027-99 (R2004).....Determining "Visible Abrasion Resistance on
Glazed Ceramic Tile"
 - D4397-02.....Standard Specification for Polyethylene
Sheeting for Construction, Industrial and
Agricultural Applications
- D. Tile Council of America, Inc. (TCA):
 - 2007.....Handbook for Ceramic Tile Installation

PART 2 - PRODUCTS

2.1 TILE

- A. Comply with ANSI A137.1, Standard Grade, except as modified:
 - 1. Inspection procedures listed under the Appendix of ANSI A137.1.
 - 2. Factory Blending: For tile with color variations, within the ranges selected during sample submittals blend tile in the factory and package so tile units taken from one package show the same range in colors as those taken from other packages and match approved samples.
- B. Mosaic Tile: Nominal 13 mm (1/2 inch) thick, square edges.
- C. Glazed Mosaic Wall Tile: Cushion edges, glazing, as specified in Section 09 06 00, SCHEDULE FOR FINISHES.
- D. Trim Shapes:

1. Conform to applicable requirements of adjoining floor and wall tile.
2. Use trim shapes sizes conforming to size of adjoining field wall tile unless detailed or specified otherwise in Section 09 06 00, SCHEDULE FOR FINISHES.

2.2 GROUTING MATERIALS

A. Coloring Pigments:

1. Pure mineral pigments, limeproof and nonfading, complying with ASTM C979.
2. Job colored grout is not acceptable.
3. Use is required in Commercial Portland Cement Grout.

B. Commercial Portland Cement Grout: ANSI A118.6 color as specified.

1. Unsanded grout mixture for joints 3.2 mm (1/8 inch) and narrower.

2.3 WATER

Clean, potable and free from salts and other injurious elements to mortar and grout materials.

2.4 CLEANING COMPOUNDS

- A. Specifically designed for cleaning masonry and concrete and which will not prevent bond of subsequent tile setting materials including patching and leveling compounds and elastomeric waterproofing membrane and coat.
- B. Materials containing acid or caustic material not acceptable.

PART 3 - EXECUTION

3.1 ENVIRONMENTAL REQUIREMENTS

- A. Maintain ambient temperature of work areas at not less than 16 degree C (60 degrees F), without interruption, for not less than 24 hours before installation and not less than three days after installation.
- B. Maintain higher temperatures for a longer period of time where required by manufacturer's recommendation and ANSI Specifications for installation.
- C. Do not install tile when the temperature is above 38 degrees C (100 degrees F).
- D. Do not install materials when the temperature of the substrate is below 16 degrees C (60 degrees F).
- E. Do not allow temperature to fall below 10 degrees C (50 degrees F) after fourth day of completion of tile work.

3.2 CERAMIC TILE - GENERAL

- A. Workmanship:

1. Lay out tile work so that no tile less than one-half full size is used. Make all cuts on the outer edge of the field.
2. Set tile firmly in place with finish surfaces in true planes. Align tile flush with adjacent tile unless shown otherwise.
3. Form intersections and returns accurately.
4. Cut and drill tile neatly without marring surface.
5. Cut edges of tile abutting penetrations, finish, or built-in items:
 - a. Fit tile closely around electrical outlets, piping, fixtures and fittings, so that plates, escutcheons, collars and flanges will overlap cut edge of tile.
 - b. Seal tile joints water tight as specified in Section 07 92 00, JOINT SEALANTS, around electrical outlets, piping fixtures and fittings before cover plates and escutcheons are set in place.
6. Completed work shall be free from hollow sounding areas and loose, cracked or defective tile.
7. Remove and reset tiles that are out of plane or misaligned.
8. Back Buttering: For installations indicated below, obtain 100 percent mortar coverage by complying with applicable special requirements for back buttering of tile in referenced ANSI A108 series of tile installation standards:

3.3 GROUTING

- A. Grout Type and Location:
 1. Grout for glazed wall and base tile, commercial Portland cement grout.
- B. Workmanship:
 1. Install and cure grout in accordance with the applicable standard.
 2. Portland Cement grout: ANSI A108.10.

3.4 CLEANING

- A. Thoroughly sponge and wash tile. Polish glazed surfaces with clean dry cloths.
- B. Methods and materials used shall not damage or impair appearance of tile surfaces.
- C. The use of acid or acid cleaners on glazed tile surfaces is prohibited.
- D. Clean tile grouted with epoxy, furan and commercial Portland cement grout and tile set in elastomeric bond coat as recommended by the manufacturer of the grout and bond coat.

- - - E N D - - -

**SECTION 09 51 00
ACOUSTICAL CEILINGS**

PART 1- GENERAL

1.1 DESCRIPTION

- A. Metal ceiling suspension system for acoustical ceilings.
- B. Acoustical units.
- C. Adhesive application.

1.2 RELATED WORK

- A. Color, pattern, and location of each type of acoustical unit:
Section 09 06 00, SCHEDULE FOR FINISHES.

1.3 SUBMITTAL

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Samples:
 - 1. Acoustical units, each type, with label indicating conformance to specification requirements.
 - 2. Colored markers for units providing access.
- C. Manufacturer's Literature and Data:
 - 1. Ceiling suspension system, each type, showing complete details of installation.
 - 2. Acoustical units, each type
- D. Manufacturer's Certificates: Acoustical units, each type, in accordance with specification requirements.

1.4 DEFINITIONS

- A. Standard definitions as defined in ASTM C634.
- B. Terminology as defined in ASTM E1264.

1.5 APPLICABLE PUBLICATIONS

- A. Publications listed below form a part of this specification to extent referenced. Publications are referenced in the text by basic designation only.
- B. American Society for Testing and Materials (ASTM):
 - A641/A641M-03.....Zinc-coated (Galvanized) Carbon Steel Wire
 - A653/A653M-07.....Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy-coated (Galvannealed) by the Hot-Dip Process
 - C423-07.....Sound Absorption and Sound Absorption Coefficients by the Reverberation Room Method

C634-02 (E2007).....	Standard Terminology Relating to Environmental Acoustics
C635-04.....	Metal Suspension Systems for Acoustical Tile and Lay-in Panel Ceilings
E84-07.....	Surface Burning Characteristics of Building Materials
E119-07.....	Fire Tests of Building Construction and Materials
E413-04.....	Classification for Rating Sound Insulation.
E580-06.....	Application of Ceiling Suspension Systems for Acoustical Tile and Lay-in Panels in Areas Requiring Seismic Restraint
E1264-(R2005).....	Classification for Acoustical Ceiling Products

PART 2- PRODUCTS

2.1 METAL SUSPENSION SYSTEM

- A. ASTM C635, heavy-duty system, except as otherwise specified.
 - 1. Ceiling suspension system members may be fabricated from either of the following unless specified otherwise.
 - a. Galvanized cold-rolled steel, bonderized.
 - b. Extruded aluminum.
 - 2. Use same construction for cross runners as main runners. Use of lighter-duty sections for cross runners is not acceptable.
- B. Exposed grid suspension system for support of lay-in panels:
 - 1. Exposed grid width not less than 22 mm (7/8 inch) with not less than 8 mm (5/16 inch) panel bearing surface.
 - 2. Fabricate wall molding and other special molding from the same material with same exposed width and finish as the exposed grid members.
 - 3. On exposed metal surfaces apply baked-on enamel flat texture finish in color to match adjacent acoustical units unless specified otherwise in Section 09 06 00, SCHEDULE FOR FINISHES.

2.2 PERIMETER SEAL

- A. Vinyl, polyethylene or polyurethane open cell sponge material having density of 1.3 plus or minus 10 percent, compression set less than 10 percent with pressure sensitive adhesive coating on one side.
- B. Thickness as required to fill voids between back of wall molding and finish wall.
- C. Not less than 9 mm (3/8 inch) wide strip.

2.3 WIRE

- A. ASTM A641.
- B. For wire hangers: Minimum diameter 2.68 mm (0.1055 inch).
- C. For bracing wires: Minimum diameter 3.43 mm (0.1350 inch).

2.4 ANCHORS AND INSERTS

- A. Use anchors or inserts to support twice the loads imposed by hangers attached thereto.
- B. Hanger Inserts:
 - 1. Fabricate inserts from steel, zinc-coated (galvanized after fabrication).
 - 2. Nailing type option for wood forms:
 - a. Upper portion designed for anchorage in concrete and positioning lower portion below surface of concrete approximately 25 mm (one inch).
 - b. Lower portion provided with not less than 8 mm (5/16 inch) hole to permit attachment of hangers.
 - 3. Flush ceiling insert type:
 - a. Designed to provide a shell covered opening over a wire loop to permit attachment of hangers and keep concrete out of insert recess.
 - b. Insert opening inside shell approximately 16 mm (5/8 inch) wide by 9 mm (3/8 inch) high over top of wire.
 - c. Wire 5 mm (3/16 inch) diameter with length to provide positive hooked anchorage in concrete.
- C. Clips:
 - 1. Galvanized steel.
 - 2. Designed to clamp to steel beam or bar joists, or secure framing member together.
 - 3. Designed to rigidly secure framing members together.
 - 4. Designed to sustain twice the loads imposed by hangers or items supported.
- D. Tile Splines: ASTM C635.

2.5 ADHESIVE

- A. ASTM D1779, having flame spread index of 25 or less when tested in accordance with ASTM E84.
- B. Developing minimum strength of 7 kg/m² (one psi) of contact surface 48 hours after installation in temperature of 21 °C (70 °F).

2.6 ACOUSTICAL UNITS

A. General:

1. Ceiling Tile shall meet minimum 37% bio-based content in accordance with USDA Bio-Preferred Product requirements.
 2. ASTM E1264, weighing 3.6 kg/m² (3/4 psf) minimum for mineral fiber panels or tile.
 3. Class A Flame Spread: ASTM 84
 4. Minimum NRC (Noise Reduction Coefficient): 0.55 unless specified otherwise: ASTM C423.
 5. Minimum CAC (Ceiling Attenuation Class): 40-44 range unless specified otherwise: ASTM E413.
 6. Manufacturers standard finish, minimum Light Reflectance (LR) coefficient of 0.75 on the exposed surfaces, except as specified otherwise in Section 09 06 00, SCHEDULE FOR FINISHES.
 7. Lay-in panels: Sizes as shown, with square edges.
- B. Type III Units - Mineral base with water-based painted finish less than 10 g/l VOC, Form 2 - Water felted, minimum 16 mm (5/8 inch) thick. Mineral base to contain minimum 65 percent recycled content.
- C. Type IV Units - Mineral base with membrane-faced overlay, Form 2 - Water felted, minimum 16 mm (5/8 inch) thick. Apply over the paint coat on the face of the unit a poly (vinyl) chloride overspray having a flame spread index of 25 or less when tested in accordance with ASTM E84.

2.7 ACCESS IDENTIFICATION

A. Markers:

1. Use colored markers with pressure sensitive adhesive on one side.
 2. Make colored markers of paper or plastic, 6 to 9 mm (1/4 to 3/8 inch) in diameter.
- B. Use markers of the same diameter throughout building.
- C. Color Code: Use following color markers for service identification:
- | | |
|-------------|--|
| Color..... | Service |
| Red..... | Sprinkler System: Valves and Controls |
| Green..... | Domestic Water: Valves and Controls |
| Yellow..... | Chilled Water and Heating Water |
| Orange..... | Ductwork: Fire Dampers |
| Blue..... | Ductwork: Dampers and Controls |
| Black..... | Gas: Laboratory, Medical, Air and Vacuum |

PART 3 EXECUTION**3.1 CEILING TREATMENT**

- A. Treatment of ceilings shall include sides and soffits of ceiling beams, furred work 600 mm (24 inches) wide and over, and vertical surfaces at changes in ceiling heights unless otherwise shown. Install acoustic tiles after wet finishes have been installed and solvents have cured.
- B. Lay out acoustical units symmetrically about center lines of each room or space unless shown otherwise on reflected ceiling plan.
- C. Moldings:
 - 1. Install metal wall molding at perimeter of room, column, or edge at vertical surfaces.
 - 2. Install special shaped molding at changes in ceiling heights and at other breaks in ceiling construction to support acoustical units and to conceal their edges.
- D. Perimeter Seal:
 - 1. Install perimeter seal between vertical leg of wall molding and finish wall, partition, and other vertical surfaces.
 - 2. Install perimeter seal to finish flush with exposed faces of horizontal legs of wall molding.
- E. Existing ceiling:
 - 1. Where extension of existing ceilings occur, match existing.
 - 2. Where acoustical units are salvaged and reinstalled or joined, use salvaged units within a space. Do not mix new and salvaged units within a space which results in contrast between old and new acoustic units.
 - 3. Comply with specifications for new acoustical units for new units required to match appearance of existing units.

3.2 CEILING SUSPENSION SYSTEM INSTALLATION

- A. General:
 - 1. Install metal suspension system for acoustical tile and lay-in panels in accordance with ASTM C636, except as specified otherwise.
 - 2. Use direct or indirect hung suspension system or combination thereof as defined in ASTM C635.
 - 3. Support a maximum area of 1.48 m² (16 sf) of ceiling per hanger.
 - 4. Prevent deflection in excess of 1/360 of span of cross runner and main runner.

5. Provide extra hangers, minimum of one hanger at each corner of each item of mechanical, electrical and miscellaneous equipment supported by ceiling suspension system not having separate support or hangers.
 6. Provide not less than 100 mm (4 inch) clearance from the exposed face of the acoustical units to the underside of ducts, pipe, conduit, secondary suspension channels, concrete beams or joists; and steel beam or bar joist unless furred system is shown,
 7. Use main runners not less than 1200 mm (48 inches) in length.
 8. Install hanger wires vertically. Angled wires are not acceptable except for seismic restraint bracing wires.
- B. Anchorage to Structure:
1. Concrete:
 - a. Install hanger inserts and wire loops required for support of hanger and bracing wire in concrete forms before concrete is placed. Install hanger wires with looped ends through steel deck if steel deck does not have attachment device.
 2. Steel:
 - a. When steel framing does not permit installation of hanger wires at spacing required, install carrying channels for attachment of hanger wires.
 - (1) Size and space carrying channels to insure that the maximum deflection specified will not be exceeded.
 - (2) Attach hangers to steel carrying channels, spaced four feet on center, unless area supported or deflection exceeds the amount specified.
 - b. Attach carrying channels to the bottom flange of steel beams spaced not 1200 mm (4 feet) on center before fire proofing is installed. Weld or use steel clips to attach to beam to develop full strength of carrying channel.
 - c. Attach hangers to bottom chord of bar joists or to carrying channels installed between the bar joists when hanger spacing prevents anchorage to joist. Rest carrying channels on top of the bottom chord of the bar joists, and securely wire tie or clip to joist.
- B. Direct Hung Suspension System:
1. As illustrated in ASTM C635.
 2. Support main runners by hanger wires attached directly to the structure overhead.

3. Maximum spacing of hangers, 1200 mm (4 feet) on centers unless interference occurs by mechanical systems. Use indirect hung suspension system where not possible to maintain hanger spacing.
- D. Seismic Ceiling Bracing System:
1. Construct system in accordance with ASTM E580.
 2. Connect bracing wires to structure above as specified for anchorage to structure and to main runner or carrying channels of suspended ceiling at bottom.

3.3 ACOUSTICAL UNIT INSTALLATION

- A. Cut acoustic units for perimeter borders and penetrations to fit tight against penetration for joint not concealed by molding.
- B. Install lay-in acoustic panels in exposed grid with not less than 6 mm (1/4 inch) bearing at edges on supports.
 1. Install tile to lay level and in full contact with exposed grid.
 2. Replace cracked, broken, stained, dirty, or tile not cut for minimum bearing.

C. Markers:

1. Install markers of color code specified to identify the various concealed piping, mechanical, and plumbing systems.
2. Attach colored markers to exposed grid on opposite sides of the units providing access.

3.5 CLEAN-UP AND COMPLETION

- A. Replace damaged, discolored, dirty, cracked and broken acoustical units.
- B. Leave finished work free from defects.

- - - E N D - - -

**SECTION 09 65 13
RESILIENT BASE AND ACCESSORIES**

PART 1 - GENERAL

1.1 DESCRIPTION

This section specifies the installation of vinyl or rubber base and resilient stair treads with sheet rubber flooring on landings.

1.2 RELATED WORK

- A. Color and texture: Section 09 06 00, SCHEDULE FOR FINISHESS.
- B. Integral base with sheet flooring: Section 09 65 16, RESILIENT SHEET FLOORING.

1.3 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturer's Literature and Data:
 - 1. Description of each product.
 - 2. Base and stair material manufacturer's recommendations for adhesives.
 - 3. Application and installation instructions.
- C. Samples:
 - 1. Base: 150 mm (6 inches) long, each type and color.
 - 2. Resilient Stair Treads: 150 mm (6 inches) long.
 - 3. Sheet Rubber Flooring: 300 mm (12 inches) square.
 - 4. Adhesive: Literature indicating each type.

1.4 DELIVERY

- A. Deliver materials to the site in original sealed packages or containers, clearly marked with the manufacturer's name or brand, type and color, production run number and date of manufacture.
- B. Materials from containers which have been distorted, damaged or opened prior to installation will be rejected.

1.5 STORAGE

- A. Store materials in weather tight and dry storage facility.
- B. Protect material from damage by handling and construction operations before, during, and after installation.

1.6 APPLICABLE PUBLICATIONS

- A. The publication listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.

B. American Society for Testing and Materials (ASTM):

F1861-02.....Resilient Wall Base

C. Federal Specifications (Fed. Spec.):

RR-T-650E.....Treads, Metallic and Non-Metallic, Nonskid

PART 2 - PRODUCTS

2.1 GENERAL

Use only products by the same manufacturer and from the same production run.

2.2 RESILIENT BASE

- A. ASTM F1861, 3 mm (1/8 inch) thick, 100 mm (4 inches) high, Type TP Vinyl, Thermoplastics, Group 2-layered with molded top. Style B-cove.
- B. Vinyl profile base thickness and height to vary.
- C. Where carpet occurs, use Style A-straight.
- D. Use only one type of base throughout.

2.3 RESILIENT TREADS

- A. Fed. Spec. RR-T-650, Composition A, Type 2, 5 mm (3/16 inch) thick on wear surface tapering to 3 mm (1/8 inch) thick at riser end.
- B. Nosing shape to conform to sub-tread nosing shape.

2.4 SHEET RUBBER FLOORING

- A. ASTM F1344, F1859 or F1860, 900 mm (36 inches) wide, 3 mm (1/8 inch) thick, smooth face, material by the same manufacturer as the rubber treads, color and pattern to match treads.
- B. Use for stair landings.
- C. Use rubber flooring made with a minimum of 90% consumer rubber where possible.

2.5 PRIMER (FOR CONCRETE FLOORS)

As recommended by the adhesive and tile manufacturer.

2.6 LEVELING COMPOUND (FOR CONCRETE FLOORS)

Provide products with latex or polyvinyl acetate resins in the mix.

2.7 ADHESIVES

- A. Use products recommended by the material manufacturer for the conditions of use.
- B. Use low-VOC adhesive during installation. Water based adhesive with low VOC is preferred over solvent based adhesive.

PART 3 - EXECUTION

3.1 PROJECT CONDITIONS

- A. Maintain temperature of materials above 21° C (70 °F), for 48 hours before installation.

- B. Maintain temperature of rooms where work occurs, between 21° C and 27° C (70°F and 80°F) for at least 48 hours, before, during, and after installation.
- C. Do not install materials until building is permanently enclosed and wet construction is complete, dry, and cured.

3.2 INSTALLATION REQUIREMENTS

- A. The respective manufacturer's instructions for application and installation will be considered for use when approved by the Contracting Officer's Technical Representative.
- B. Submit proposed installation deviation from this specification to the COTR indicating the differences in the method of installation.
- C. The COTR reserves the right to have test portions of material installation removed to check for non-uniform adhesion and spotty adhesive coverage.

3.3 PREPARATION

- A. Examine surfaces on which material is to be installed.
- B. Fill cracks, pits, and dents with leveling compound.
- C. Level to 3 mm (1/8 inch) maximum variations.
- D. Do not use adhesive for leveling or filling.
- E. Grind, sand, or cut away protrusions; grind high spots.
- F. Clean substrate area of oil, grease, dust, paint, and deleterious substances.
- G. Substrate area dry and cured. Perform manufacturer's recommended bond and moisture test.
- H. Preparation of existing installation:
 - 1. Remove existing base and stair treads including adhesive.
 - 2. Do not use solvents to remove adhesives.
 - 3. Prepare substrate as specified.

3.4 BASE INSTALLATION

- A. Location:
 - 1. Extend base scheduled for room into adjacent closet, alcoves, and around columns.
- B. Application:
 - 1. Apply adhesive uniformly with no bare spots.
 - 2. Set base with joints aligned and butted to touch for entire height.
 - 3. Before starting installation, layout base material to provide the minimum number of joints with no strip less than 600 mm (24 inches) length.

- a. Short pieces to save material will not be permitted.
- b. Locate joints as remote from corners as the material lengths or the wall configuration will permit.
- C. Form corners and end stops as follows:
 - 1. Score back of outside corner.
 - 2. Score face of inside corner and notch cove.
- D. Roll base for complete adhesion.

3.5 STAIR TREAD INSTALLATION

- A. Prepare surfaces to receive the treads in accordance with applicable portions of paragraph, preparation.
- B. Layout of Treads.
 - 1. No joints will be accepted in treads.,
 - 2. Set full treads on intermediate and floor landings.
- C. Application:
 - 1. Apply adhesive uniformly with no bare spots.
 - 2. Roll and pound treads to assure adhesion.

3.6 SHEET RUBBER INSTALLATION.

- A. Prepare surfaces to receive sheet rubber in accordance with applicable portions of paragraph, preparation.
- B. Layout of Sheet Rubber:
 - 1. Use minimum number of joints compatible with material direction and symmetrical joint location.
 - 2. Where sheet rubber intersect vertical stair members, other sheets, stair treads, and other resilient materials at the floor landings, material shall touch for the entire length within 5 mils (0.005 inch).
 - 3. Install sheet rubber on floors and intermediate landings where resilient stair treads are installed; center joint with other flooring material under doors.
- C. Application:
 - 1. Apply adhesive uniformly with no bare spots.
 - 2. Roll sheet rubber to assure adhesion.

3.7 CLEANING AND PROTECTION

- A. Clean all exposed surfaces of base and adjoining areas of adhesive spatter before it sets.
- B. Keep traffic off resilient material for at least 72 hours after installation.
- C. Clean and polish materials in the following order:

1. After two weeks, scrub resilient base, sheet rubber and treads materials with a minimum amount of water and a mild detergent. Leave surfaces clean and free of detergent residue. Polish resilient base to a gloss finish.
 2. Do not polish tread and sheet rubber materials.
- D. When construction traffic is anticipated, cover tread materials with reinforced kraft paper and plywood or hardboard properly secured and maintained until removal is directed by the Contracting Officer's Technical Representative (COTR).
- E. Where protective materials are removed and immediately prior to acceptance, replace damaged materials and re-clean resilient materials. Damaged materials are defined as having cuts, gouges, scrapes or tears and not fully adhered.

- - - E N D - - -

**SECTION 09 65 16
RESILIENT SHEET FLOORING**

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This Section specifies the installation of sheet flooring and integral cove base.
- B. Grades of resilient sheet vinyl floor covering without backing having vinyl plastic wearlayer with backing.
- C. Installation of sheet flooring including following:
 - 1. Chemically welded seams.
 - 2. Integral cove base: Installed at intersection of floor and vertical surfaces where indicated.

1.2 RELATED WORK

- A. Concrete floors: Section 03 30 00, CAST-IN-PLACE CONCRETE.
- B. Color, pattern and texture: Section 09 06 00, SCHEDULE FOR FINISHES.
- C. Unbacked vinyl (homogenous) sheet flooring with chemical seaming:
Section 09 65 16, RESILIENT SHEET FLOORING.

1.3 QUALITY CONTROL-QUALIFICATIONS:

- A. The Contracting Officer shall approve products or service of proposed manufacturer, suppliers, and installers, and the Contractor shall submit certification that:
 - 1. Installer is approved by manufacturer of materials and has technical qualifications, experience, trained personnel, and facilities to install specified items.
 - 2. Manufacturer's product submitted has been in satisfactory operation, on three installations similar and equivalent in size to this project for three years. Submit list of installations.
- B. The sheet vinyl floor coverings shall meet fire performance characteristics as determined by testing products, per ASTM test method, indicated below by Underwriters Laboratories, Inc. (UL) or another recognized testing and inspecting agency acceptable to authorities having jurisdiction.
 - 1. Critical Radiant Flux: 0.45 watts per sq. cm or more, Class I, per ASTM E648.
 - 2. Smoke Density: Less than 450 per ASTM E662.
- C. The floor covering manufacturer shall certify that products supplied for installation comply with local regulations controlling use of volatile organic compounds (VOC's).

1.4 SUBMITTALS

- A. In accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES, submit following:
- B. Manufacturer's Literature and Data:
 - 1. Description of resilient material and accessories to be provided.
 - 2. Resilient material manufacturer's recommendations for adhesives, seaming, sealants, and underlayment.
 - 3. Application and installation instructions.
- C. Samples:
 - 1. Sheet material, 300 mm (12 inches) square for each type, pattern and color.
 - 2. Cap strip and fillet strip, 300 mm (12 inches) for integral base.
 - 3. Shop Drawings and Certificates: Layout of joints showing patterns where joints are expressed, and type and location of obscure type joints. Indicate orientation of directional patterns.
 - 4. Certificates: Quality Control Certificate Submittals and lists specified in paragraph, QUALIFICATIONS.
 - 5. Adhesive, underlayment and primer: Pint container, each type.

1.5 PROJECT CONDITIONS

- A. Maintain temperature of floor materials and room, where work occurs, above 18 ° C (65 °F) and below 38 ° C (100 °F) for 48 hours before, during and for 48 hours after installation. After above period, room temperature shall not fall below 13 ° C (55 °F).
- B. Construction in or near areas to receive flooring work shall be complete, dry and cured. Do not install resilient flooring over slabs until they have been cured and are sufficiently dry to achieve a bond with adhesive. Follow flooring manufacturer's recommendations for bond and moisture testing.
- C. Building shall be permanently enclosed. Schedule construction so that floor receives no construction traffic when completed.

1.6 DELIVERY, STORAGE AND HANDLING

- A. Deliver materials to site in original sealed packages or containers; labeled for identification with manufacturer's name and brand.
- B. Deliver sheet flooring full width roll, completely enclosed in factory wrap, clearly marked with the manufacturer's number, type and color, production run number and manufacture date.
- C. Store materials in weathertight and dry storage facility. Protect from damage due to handling, weather, and construction operations before,

during and after installation. Store sheet flooring on end with ambient temperatures maintained as recommended by manufacturer.

D. Store sheet flooring on end.

E. Move sheet vinyl floor coverings and installation accessories into spaces where they will be installed at least 48 hours in advance of installation.

1.7 APPLICABLE PUBLICATIONS

A. Publications listed below form a part of this specification to extent referenced. Publications are referenced in text by basic designation only.

B. American Society For Testing Materials (ASTM):

E648-09.....Critical Radiant Flux of Floor-Covering Systems
Using a Radiant Energy Source.

E662-09.....Specific Optical Density of Smoke Generated by
Solid Materials.

F710-08.....Practice for Preparing Concrete Floors and
Other Monolithic Floors to Receive Resilient
Flooring.

F1303-04.....Sheet Vinyl Floor Covering with Backing.

F1869-04.....Moisture Vapor Emission Rate of Concrete
Subfloor using Anhydrous Calcium Chloride

F1913-04.....Sheet Vinyl Flooring without Backing

F2170-09.....Determining Relative Humidity in Concrete Floor
Slabs using In-situ Probes

C. Resilient Floor Covering Institute (RFCI):

Recommended Work Practices for Removal of Resilient Floor Coverings.

1.8 SCHEDULING

Interior finish work such as drywall finishing, concrete, ceiling work, and painting work shall be complete and dry before installation.

Mechanical, electrical, and other work above ceiling line shall be completed. Heating, ventilating, and air conditioning systems shall be installed and operating in order to maintain temperature and humidity requirements.

1.9 WARRANTY:

Submit written warranty, in accordance with FAR clause 52.246-21, Warranty of Construction requirements except that warranty period shall be extended to include two (2) years.

PART 2 - PRODUCTS**2.1 SHEET VINYL FLOOR COVERINGS**

- A. Sheet Vinyl Floor Coverings: embossed face, minimum thickness nominal 2 mm (0.08 inch). Sheet flooring shall conform to ASTM F1913 and material requirements specified in ASTM F1303, Type II, Grade 1, backing classification not applicable. Foam backed sheet flooring is not acceptable.
- B. Size: Provide maximum size sheet vinyl material produced by manufacturer to provide minimum number of joints. Minimum size width acceptable - 1200 mm (48 inches).
- C. Each color and pattern of sheet flooring shall be of same production run.

2.2 CHEMICAL SEAMING:

Product of floor covering manufacturer in color shall match field color of sheet vinyl covering.

2.3 APPLICATION MATERIALS AND ACCESSORIES

- A. Floor and Base Adhesive: Type recommended by sheet flooring material manufacturer for conditions of use.
- B. Mastic Underlayment (for concrete floors): Provide products with latex or polyvinyl acetate resins in mix. Condition to be corrected shall determine type of underlayment selected for use.
- C. Base Accessories:
 - 1. Fillet Strip: 19 mm (3/4 inch) radius fillet strip compatible with resilient sheet material.
 - 2. Edge Strip: Metal edge strip by Schuter, height varies.

2.4 SHEET FLOORING

- A. ASTM F1303, Type II, Grade 1, except for backing requirements. Foam backed sheet flooring is not acceptable.
- B. Minimum nominal thickness 2 mm (0.08 inch); 1800 mm (6 ft) minimum width.
- C. Critical Radiant Flux: 0.45 watts per sq.cm or more, Class I, per ASTM E648.
- D. Smoke density: less than 450 per ASTM E662.
- E. Color and pattern of sheet flooring of the same production run.

2.5 ADHESIVES

Water resistant type recommended by the sheet flooring manufacturer for the conditions of use. VOC not to exceed 50g/L

2.6 BASE CAP STRIP AND COVE STRIP

- A. Extruded vinyl compatible with the sheet flooring.
- B. Cap strip "J" shape with feathered edge flange approximately 25 mm (one inch) wide; top designed to receive sheet flooring with 13 mm (1/2 inch) flange lapping top of flooring
- C. Cove strip 70 mm (2-3/4 inch) radius.

2.7 LEVELING COMPOUND (FOR CONCRETE FLOORS)

Provide cementitious products with latex or polyvinyl acetate resins in the mix.

2.8 PRIMER (FOR CONCRETE SUBFLOORS)

As recommended by the adhesive or sheet flooring manufacturer.

2.9 EDGE STRIPS

- A. Extruded aluminum, mill finish, mechanically cleaned.
- B. Drill and counter sink edge strips for flat head screws. Space holes near ends and approximately 225 mm (9 inches) on center in between.

2.10 SEALANT

- A. As specified in Section 07 92 00, JOINT SEALANTS.
- B. Compatible with sheet flooring.

PART 3 - EXECUTION**3.1 PROJECT CONDITIONS**

- A. Maintain temperature of sheet flooring above 36 °C (65 °F), for 48 hours before installation.
- B. Maintain temperature of rooms where sheet flooring work occurs above 36 °C (65 °F), for 48 hours, before installation and during installation.
- C. After installation, maintain temperature at or above 36 °C (65 °F.)
- D. Building is permanently enclosed.
- E. Wet construction in or near areas to receive sheet flooring is complete, dry and cured.

3.2 SUBFLOOR PREPARATION

- A. Concrete Subfloors: Verify that concrete slabs comply with ASTM F710.
 - 1. Installer shall examine surfaces on which resilient sheet flooring is to be installed, and shall advise Contractor, in writing, of areas which are unacceptable for installation of flooring material. Installer shall advise Contractor which methods are to be used to correct conditions that will impair proper installation.

Installation shall not proceed until unsatisfactory conditions have been corrected.

2. Slab substrates dry, free of curing compounds, sealers, hardeners, and other materials which would interfere with bonding of adhesive. Determine adhesion and dryness characteristics by performing bond and moisture tests recommended by Resilient Floor Covering Institute recommendations in manual RFCI-MRP.
- B. Broom or vacuum clean substrates to be covered by sheet vinyl floor coverings immediately before installation. Following cleaning, examine substrates to determine if there is visually any evidence of moisture, alkaline salts, carbonation, or dust.
- C. Primer: If recommended by flooring manufacturer, prior to application of adhesive, apply concrete slab primer in accordance with manufacturer's directions.
- D. Correct conditions which will impair proper installation, including trowel marks, pits, dents, protrusions, cracks or joints.
- E. Fill cracks, joints, depressions, and other irregularities in concrete with leveling compound.
 1. Do not use adhesive for filling or leveling purposes.
 2. Do not use leveling compound to correct imperfections which can be corrected by spot grinding.
 3. Trowel to smooth surface free of trowel marks, pits, dents, protrusions, cracks or joint lines.
- F. Clean floor of oil, paint, dust and deleterious substances. Leave floor dry and cured free of residue from existing curing or cleaning agents.
- G. Moisture Testing: Perform moisture and pH test as recommended by the flooring and adhesive manufacturers. Perform test locations starting on the deepest part of the concrete structure. Proceed with installation only after concrete substrates meet or exceed the manufacturer's requirements. In the absence of specific guidance from the flooring or adhesive manufacturer the following requirements are to be met:
 1. Perform moisture vapor emission tests in accordance with ASTM F1869. Proceed with installation only after substrates have a maximum moisture-vapor-emission rate of 1.36 kg of water/92.9 sq. m (3lb of water/1000 sq. ft.) in 24 hours.
 2. Perform concrete internal relative humidity testing using situ probes in accordance with ASTM F2170. Proceed with installation only

after concrete reaches maximum 75 percent relative humidity level measurement.

3.3 INSTALLATION OF FLOORING

- A. Install work in strict compliance with manufacturer's instructions and approved layout drawings.
- B. Maintain uniformity of sheet vinyl floor covering direction and avoid cross seams.
- C. Arrange for a minimum number of seams and place them in inconspicuous and low traffic areas, but in no case less than 150 mm (6 inches) away from parallel joints in flooring substrates.
- D. Match edges of resilient floor coverings for color shading and pattern at seams.
- E. Where resilient sheet flooring abuts other flooring material floors shall finish level.
- F. Extend sheet vinyl floor coverings into toe spaces, door reveals, closets, and similar openings.
- G. Inform the Contracting Officer's Technical Representative (COTR) of conflicts between this section and the manufacturer's instructions or recommendations for auxiliary materials, or installation methods, before proceeding.
- H. Install sheet in full coverage adhesives.
 - 1. Air pockets or loose edges will not be accepted.
 - 2. Trim sheet materials to touch in the length of intersection at pipes and vertical projections; seal joints at pipe with waterproof cement or sealant.
- I. Keep joints to a minimum; avoid small filler pieces or strips.
- J. Follow manufacturer's recommendations for seams at butt joints. Do not leave any open joints that would be readily visible from a standing position.
- K. Follow manufacturer's recommendations regarding pattern match, if applicable.
- L. Installation of Edge Strips:
 - 1. Locate edge strips under center lines of doors unless otherwise indicated.
 - 2. Set aluminum strips in adhesive, anchor with lead anchors and stainless steel Phillips screws.
- M. Integral Cove Base Installation:
 - 1. Set preformed fillet strip to receive base.

2. Install the base with adhesive, terminate expose edge with the cap strip.
3. Form internal and external corners to the geometric shape generated by the cove at either straight or radius corners.
4. Solvent weld joints as specified for the flooring. Seal cap strip to wall with an adhesive type sealant.
5. Unless otherwise specified or shown where sheet flooring is scheduled, provide integral base at intersection of floor and vertical surfaces. Provide sheet flooring and base scheduled for room on floors and walls under and behind areas where casework, laboratory and pharmacy furniture and other equipment occurs, except where mounted in wall recesses.

3.4 INSTALLATION OF INTEGRAL COVED BASE

- A. Set preformed cove to receive base. Install base material with adhesive and terminate exposed edge with cap strip. Integral base shall be 100 mm (4 inches) high.
- B. Internal and external corners shall be formed to geometric shape generated by cove at either square or radius corners.

3.5 JOINT SEAMING

- A. Chemical weld all joints of flooring and base using equipment and procedures recommended by flooring manufacturer.
- B. Upon completion of welding, surface across joint shall finish flush, free from voids, and recessed or raised areas.
- C. Fusion of Material: Joint shall be fused a minimum of 65 percent through thickness of material, and after welding shall meet specified characteristics for flooring.

3.6 CLEANING

- A. Clean small adhesive marks during application of sheet flooring and base before adhesive sets, excessive adhesive smearing will not be accepted.
- B. Remove visible adhesive and other surface blemishes using methods and cleaner recommended by floor covering manufacturers.
- C. Clean and polish materials per flooring manufacturer's written recommendations.
- D. Vacuum floor thoroughly.
- E. Do not wash floor until after period recommended by floor covering manufacturer and then prepare in accordance with manufacturer's recommendations.

- F. Upon completion, COTR shall inspect floor and base to ascertain that work was done in accordance with manufacturer's printed instructions.
- G. Perform initial maintenance according to flooring manufacturer's written recommendations.

3.7 PROTECTION:

- A. Protect installed flooring as recommended by flooring manufacturer against damage from rolling loads, other trades, or placement of fixtures and furnishings.
- B. Keep traffic off sheet flooring for 24 hours after installation.
- C. Where construction traffic is anticipated, cover sheet flooring with reinforced kraft paper properly secured and maintained until removal is authorized by the COTR.

D. Where protective materials are removed and immediately prior to acceptance, repair any damage, re-clean sheet flooring, lightly re-apply polish and buff floor.

- - - E N D - - -

**SECTION 09 65 19
RESILIENT TILE FLOORING**

PART 1 - GENERAL

1.1 DESCRIPTION

This section specifies the installation of, vinyl composition tile flooring, and accessories.

1.2 RELATED WORK

- A. Color and pattern and location in room finish schedule: Section 09 06 00, SCHEDULE FOR FINISHES.
- B. Resilient Base: Section 09 65 13, RESILIENT BASE AND ACCESSORIES.

1.3 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturer's Literature and Data:
 - 1. Description of each product.
 - 2. Resilient material manufacturers recommendations for adhesives, underlayment, primers and polish.
 - 3. Application and installation instructions.
- C. Samples:
 - 1. Tile: 300 mm by 300 mm (12 inches by 12 inches) for each type, pattern and color.
 - 2. Edge Strips: 150 mm (6 inches) long, each type.
 - 3. Feature Strips: 150 mm (6 inches) long.
- D. Shop Drawings:
 - 1. Layout of patterns shown on the drawings and in Section 09 06 00, SCHEDULE FOR FINISHES.
 - 2. Edge strip locations showing types and detail cross sections.
- E. Test Reports:
 - 1. Abrasion resistance: Depth of wear for each tile type and color and volume loss of tile, certified by independent laboratory.
 - 2. Tested per ASTM F510.

1.4 DELIVERY

- A. Deliver materials to the site in original sealed packages or containers, clearly marked with the manufacturer's name or brand, type and color, production run number and date of manufacture.
- B. Materials from containers which have been distorted, damaged or opened prior to installation will be rejected.

1.5 STORAGE

- A. Store materials in weathertight and dry storage facility.
- B. Protect from damage from handling, water, and temperature.

1.6 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American Society for Testing and Materials (ASTM):
 - D4078-02 (2008).....Water Emulsion Floor Finish
 - E648-10.....Critical Radiant Flux of Floor Covering Systems
Using a Radiant Energy Source
 - E662-09.....Specific Optical Density of Smoke Generated by
Solid Materials
 - E1155-96 (R2008).....Determining Floor Flatness and Floor Levelness
Numbers
 - F510-93 (R 2008).....Resistance to Abrasion of Resilient Floor
Coverings Using an Abrader with a Grit Feed
Method
 - F710-08.....Preparing Concrete Floors to Receive Resilient
Flooring
 - F1066-04 (R2010).....Vinyl Composition Floor Tile
- C. Resilient Floor Covering Institute (RFCI):
 - IP #2.....Installation Practice for Vinyl Composition
Tile (VCT)
- D. Federal Specifications (Fed. Spec.):
 - SS-T-312.....Tile Floor: Asphalt, Rubber, Vinyl and Vinyl
Composition

PART 2 - PRODUCTS**2.1 GENERAL**

- A. Furnish product type, materials of the same production run and meeting following criteria.
- B. Use adhesives, underlayment, primers and polish recommended by the floor resilient material manufacturer.
- C. Critical Radiant Flux: 0.45 watts per sq. cm or more, Class I, per ASTM E 648.
- D. Smoke density: Less than 450 per ASTM E662.

2.2 VINYL COMPOSITION TILE

- A. ASTM F1066, Composition 1, Class 2 (through pattern), 300 mm (12 inches) square, 3 mm (1/8 inch) thick.
- B. Color and pattern uniformly distributed throughout thickness.

2.3 ADHESIVES

- A. Comply with applicable regulations regarding toxic and hazardous materials Green Seal (GS-36) for commercial adhesive.
- B. Use low-VOC adhesive during installation. Water based is preferred over solvent based adhesives.

2.4 PRIMER (FOR CONCRETE SUBFLOORS)

As recommended by the adhesive and tile manufacturer.

2.5 LEVELING COMPOUND (FOR CONCRETE FLOORS)

- A. Provide cementitious products with latex or polyvinyl acetate resins in the mix.
- B. Determine the type of underlayment selected for use by the condition to be corrected.

2.6 POLISH AND CLEANERS

- A. Cleaners RFCI CL-1.
- B. Polish: ASTM D4078.

2.7 EDGE STRIPS

- A. Extruded aluminum profile, mill finish, mechanically cleaned:
 - 1. Drill and counter sink edge strip for flat head screws.
 - 2. Space holes near ends and approximately 225 mm (9 inches) on center between.

2.8 SCREWS

Stainless steel flat head screw.

PART 3 - EXECUTION**3.1 PROJECT CONDITIONS**

- A. Maintain temperature of materials a minimum of 22 °C (70 °F,) for 48 hours before installation.
- B. Maintain temperature of rooms where work occurs between 21 °C and 27 °C (70 °F and 80 °F), for at least 48 hours, before, during and after installation.
- C. Do not install flooring until building is permanently enclosed and wet construction in or near areas to receive tile materials is complete, dry and cured.

3.2 SUBFLOOR PREPARATION

- A. Verify that concrete slabs comply with ASTM F710. At existing slabs, determine levelness by F-number method in accordance with ASTM E1155. Overall value shall not exceed as follows:
FF30/FL20
- B. Correct conditions which will impair proper installation.
- C. Fill cracks, joints and other irregularities in concrete with leveling compound:
 - 1. Do not use adhesive for filling or leveling purposes.
 - 2. Do not use leveling compound to correct imperfections which can be corrected by spot grinding.
 - 3. Trowel to smooth surface free of trowel marks, pits, dents, protrusions, cracks or joints.
- D. Clean floor of oil, paint, dust, and deleterious substances: Leave floor dry and cured free of residue from existing curing or cleaning agents.
- E. Concrete Subfloor Testing:
Determine Adhesion and dryness of the floor by bond and moisture tests as recommended by RFCI manual MRP.
- F. Perform additional subfloor preparation to obtain satisfactory adherence of flooring if subfloor test patches allows easy removal of tile.
- G. Prime the concrete subfloor if the primer will seal slab conditions that would inhibit bonding, or if priming is recommended by the tile or adhesive manufacturers.

3.3 INSTALLATION

- A. Install in accordance with manufacturer's instructions for application and installation unless specified otherwise.
- B. Mix tile from at least two containers. An apparent line either of shades or pattern variance will not be accepted.
- C. Tile Layout:
 - 1. If layout is not shown on drawings, lay tile symmetrically about center of room or space with joints aligned.
 - 2. No tile shall be less than 150 mm (6 inches) and of equal width at walls.
 - 3. Place tile pattern in the same direction; do not alternate tiles.
- D. Trim tiles to touch for the length of intersections at pipes and vertical projections, seal joints at pipes with waterproof cement.

E. Application:

1. Apply adhesive uniformly with no bare spots.
 - a. Conform to RFC1-TM-6 for joint tightness and for corner intersection unless layout pattern shows random corner intersection.
 - b. More than 5 percent of the joints not touching will not be accepted.
2. The Contracting Officer's Technical Representative (COTR) may have test tiles removed to check for non-uniform adhesion, spotty adhesive coverage, and ease of removal. Install new tile for broken removed tile.

F. Installation of Edge Strips:

1. Locate edge strips under center line of doors unless otherwise shown.
2. Anchor metal edge strips with anchors and screws specified by Manufacturer.
3. Where tile edge is exposed, butt edge strip to touch along tile edge.

3.4 CLEANING AND PROTECTION

- A. Clean adhesive marks on exposed surfaces during the application of resilient materials before the adhesive sets. Exposed adhesive is not acceptable.
- B. Keep traffic off resilient material for a minimum 72 hours after installation.
- C. Clean and polish materials in the following order:
 1. For the first two weeks sweep and damp mopped only.
 2. After two weeks, scrub resilient materials with a minimum amount of water and a mild detergent. Leave surface clean and free of detergent residue.
 3. Apply polish to the floors in accordance with the polish manufacturer's instructions.
- D. When construction traffic occurs over tile, cover resilient materials with reinforced kraft paper properly secured and maintained until removal is directed by COTR. At entrances and where wheeled vehicles or carts are used, cover tile with plywood, hardboard, or particle board over paper, secured and maintained until removal is directed by COTR.

- E. When protective materials are removed and immediately prior to acceptance, replace any damage tile, re-clean resilient materials, lightly re-apply polish and buff floors.

3.5 LOCATION

- A. Unless otherwise specified or shown, install tile flooring, on floor under areas where casework, and other equipment occurs, except where mounted in wall recesses.

- - - E N D - - -

**SECTION 09 68 00
CARPETING**

PART 1 - GENERAL

1.1 DESCRIPTION

Section specifies carpet, edge strips, adhesives, and other items required for complete installation.

1.2 RELATED WORK

- A. Color and texture of carpet and edge strip: Section 09 06 00, SCHEDULE FOR FINISHES.
- B. Resilient wall base: Section 09 65 13, RESILIENT BASE AND ACCESSORIES.

1.3 QUALITY ASSURANCE

- A. Carpet installed by mechanics certified by the Floor Covering Installation Board.
- B. Certify and label the carpet that it has been tested and meets criteria of CRI IAQ Carpet Testing Program for indoor air quality.

1.4 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Product Data:
 - 1. Manufacturer's catalog data and printed documentation stating physical characteristics, durability, resistance to fading and flame resistance characteristics for each type of carpet material and installation accessory.
 - 2. Manufacturer's printed installation instructions for the carpet, including preparation of installation substrate, seaming techniques and recommended adhesives and tapes.
 - 3. Manufacturer's certificate verifying carpet containing recycled materials include percentage of recycled materials as specified.
- C. Samples:
 - 1. Carpet: "Production Quality" samples 300 x 300 mm (12 x 12 inches) of carpets, showing quality, pattern and color specified in Section 09 06 00, SCHEDULE FOR FINISHES.
- D. Shop Drawings: Installers layout plan showing seams and cuts for sheet carpet and carpet module.
- E. Maintenance Data: Carpet manufacturer's maintenance instructions describing recommended type of cleaning equipment and material, spotting and cleaning methods and cleaning cycles.

1.5 DELIVERY AND STORAGE

- A. Deliver carpet in manufacturer's original wrappings and packages clearly labeled with manufacturer's name, brand, name, size, dye lot number and related information.
- B. Deliver adhesives in containers clearly labeled with manufacturer's name, brand name, number, installation instructions, safety instructions and flash points.
- C. Store in a clean, dry, well ventilated area, protected from damage and soiling. Maintain storage space at a temperature above 16 degrees C (60 degrees F) for 2 days prior to installation.

1.6 ENVIRONMENTAL REQUIREMENTS

Areas in which carpeting is to be installed shall be maintained at a temperature above 16 degrees C (60 degrees F) for 2 days before installation, during installation and for 2 days after installation. A minimum temperature of 13 degrees C (55 degrees F) shall be maintained thereafter for the duration of the contract. Traffic or movement of furniture or equipment in carpeted area shall not be permitted for 24 hours after installation. Other work which would damage the carpet shall be completed prior to installation of carpet.

1.7 WARRANTY

Carpet and installation subject to terms of "Warranty of Construction" FAR clause 52.246-21, except that warranty period is extended to two years.

1.8 APPLICABLE PUBLICATIONS

- A. Publication listed below form a part of this specification to extent referenced. Publications are referenced in text by basic designation only.
- B. American Association of Textile Chemists and Colorists (AATCC):
 - AATCC 16-04.....Colorfastness to Light
 - AATCC 129-05.....Colorfastness to Ozone in the Atmosphere under High Humidities
 - AATCC 165-99.....Colorfastness to Crocking: Textile Floor Conerings-AATCC Crockmeter Method
- C. American Society for Testing and Materials (ASTM):
 - ASTM D1335-05.....Tuft Bind of Pile Yarn Floor Coverings
 - ASTM D3278-96 (R2004)...Flash Point of Liquids by Small Scale Closed-Cup Apparatus
 - ASTM D5252-05.....Operation of the Hexapod Tumble Drum Tester

ASTM D5417-05.....Operation of the Vettermann Drum Tester
 ASTM E648-06.....Critical Radiant Flux of Floor-Covering Systems
 Using a Radiant Heat Energy Source

D. The Carpet and Rug Institute (CRI):

CRI 104-02.....Installation of Commercial Carpet

PART 2 - PRODUCTS

2.1 CARPET

A. Physical Characteristics:

1. Carpet free of visual blemishes, streaks, poorly dyed areas, fuzzing of pile yarn, spots or stains and other physical and manufacturing defects.
2. Manufacturers standard construction commercial carpet:
 - a. Broadloom; maximum width to minimum use
 - b. Modular Tile: 660 mm (24 inches) square tile.
3. Pile Height: Varies RE: Finish Schedule.
4. Pile Fiber: Solution dyed nylon.
5. Pile Type:TBD.
6. Backing materials: Manufacturer's standard. (Moisture barrier properties in Activities A109).
7. Appearance Retention Rating (ARR): Carpet shall be tested and have the minimum 3.5-4.0 Severe ARR when tested in accordance with either the ASTM D 5252 (Hexapod) or ASTM D 5417 (Vettermann) test methods using the number of cycles for short and long term tests as specified.
8. Tuft Bind: Minimum force of 40 N (10 lb) required to pull a tuft or loop free from carpet backing. Test per ASTM D1335.
9. Colorfastness to Crocking: Dry and wet crocking and water bleed, comply with AATCC 165 Color Transference Chart for colors, minimum class 4 rating.
10. Colorfastness to Ozone: Comply with AATCC 129, minimum rating of 4 on the AATCC color transfer chart.
11. Delamination Strength: Minimum of 440 N/m (2.5 lb/inch) between secondary backing.
12. Flammability and Critical Radiant Flux Requirements:
 - a. Test Carpet in accordance with ASTM E 648.
 - b. Class I: Not less than 0.45 watts per square centimeter.

B. Color, Texture, and Pattern: As specified in Section 09 06 00, SCHEDULE FOR FINISHES.

2.2 ADHESIVE AND CONCRETE PRIMER

- A. Waterproof, resistant to cleaning solutions, steam and water, nonflammable, complies with air-quality standards as specified. Adhesives flashpoint minimum 60 degrees C (140 degrees F), complies with ASTM D 3278.
- B. Seam Adhesives: Waterproof, non-flammable and non-staining.

2.3 LEVELING COMPOUND (FOR CONCRETE FLOORS)

- A. Provide Portland cement bases polymer modifier with latex or polyvinyl acetate resin manufactured specifically for resurfacing and leveling concrete floors. Products containing gypsum are not acceptable.
- B. Determine the type of underlayment selected for use by condition to be corrected.

PART 3 - EXECUTION**3.1 SURFACE PREPARATION**

- A. Examine surfaces on which carpeting is to be installed.
- B. Clean floor of oil, waxy films, paint, dust and deleterious substances that prevent adhesion, leave floor dry and cured, free of residue from curing or cleaning agents.
- C. Correct conditions which will impair proper installation, including trowel marks, pits, dents, protrusions, cracks or joints.
- D. Fill cracks, joints depressions, and other irregularities in concrete with leveling compound.
 - 1. Do not use adhesive for filling or leveling purposes.
 - 2. Do not use leveling compound to correct imperfections which can be corrected by spot grinding.
 - 3. Trowel to smooth surface free of trowel marks, pits, dents, protrusions, cracks or joint lines.
- E. Test new concrete subfloor prior to adhesive application for moisture and surface alkalinity per CRI 104 Section 6.3.1 or per ASTM E1907.

3.2 CARPET INSTALLTION

- A. Do not install carpet until work of other trades including painting is complete and dry.
- B. Install in accordance with CRI 104 direct glue down installation.
 - 1. Relax carpet in accordance with Section 6.4.
 - 2. Comply with indoor air quality recommendations noted in Section 6.5.
 - 3. Maintain temperature in accordance with Section 15.3.

- C. Secure carpet to subfloor of spaces with adhesive applied as recommended by carpet manufacturer.
- D. Follow carpet manufacturer's recommendations for matching pattern and texture directions.
- E. Cut openings in carpet where required for installing equipment, pipes, outlets, and penetrations.
 - 1. Bind or seal cut edge of sheet carpet and replace flanges or plates.
 - 2. Use additional adhesive to secure carpets around pipes and other vertical projections.
- F. Carpet Modules:
 - 1. Install per CRI 104, Section 13, Adhesive Application.
 - 2. Lay carpet modules with pile in same direction unless specified other wise in Section 09 06 00, SCHEDULE FOR FINISHES.
 - 3. Install carpet modules so that cleaning methods and solutions do not cause dislocation of modules.
 - 4. Lay carpet modules uniformly to provide tight flush joints free from movement when subject to traffic.

3.3 EDGE STRIPS INSTALLATION

- A. Install edge strips over exposed carpet edges adjacent to resilient finish flooring.
- B. Anchor metal strips to floor with suitable fasteners.

3.4 PROTECTION AND CLEANING

- A. Remove waste, fasteners and other cuttings from carpet floors.
- B. Vacuum carpet and provide suitable protection. Do not use polyethylene film.
- C. Do not permit traffic on carpeted surfaces for at least 48 hours after installation. Protect the carpet in accordance with CRI 104.
- D. Do not move furniture or equipment on unprotected carpeted surfaces.
- E. Just before final acceptance of work, remove protection and vacuum carpet clean.

- - - E N D - - -

**SECTION 09 91 00
PAINTING**

PART 1-GENERAL

1.1 DESCRIPTION

- A. Section specifies field painting.
- B. Section specifies prime coats which may be applied in shop under other sections.
- C. Painting includes shellacs, stains, varnishes, coatings specified, and striping or markers and identity markings.

1.2 RELATED WORK

- A. Shop prime painting of steel and ferrous metals: Division 05 - METALS, Division 08 - OPENINGS, Division 10 - SPECIALTIES, Division 11 - EQUIPMENT, Division 12 - FURNISHINGS, Division 13 - SPECIAL CONSTRUCTION, Division 14 - CONVEYING EQUIPMENT, Division 21 - FIRE SUPPRESSION, Division 22 - PLUMBING, Division 23 - HEATING, VENTILATION AND AIR-CONDITIONING, Division 26 - ELECTRICAL, Division 27 - COMMUNICATIONS, and Division 28 - ELECTRONIC SAFETY AND SECURITY sections.
- B. Type of Finish, Color, and Gloss Level of Finish Coat: Section 09 06 00, SCHEDULE FOR FINISHES.

1.3 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturer's Literature and Data:
Before work is started, or sample panels are prepared, submit manufacturer's literature, the current Master Painters Institute (MPI) "Approved Product List" indicating brand label, product name and product code as of the date of contract award, will be used to determine compliance with the submittal requirements of this specification. The Contractor may choose to use subsequent MPI "Approved Product List", however, only one list may be used for the entire contract and each coating system is to be from a single manufacturer. All coats on a particular substrate must be from a single manufacturer. No variation from the MPI "Approved Product List" where applicable is acceptable.
- C. Sample Panels:
 - 1. After painters' materials have been approved and before work is started submit sample panels showing each type of finish and color specified.
 - 2. Panels to show color: Composition board, 100 by 250 by 3 mm (4 inch by 10 inch by 1/8 inch).

3. Panel to show transparent finishes: Wood of same species and grain pattern as wood approved for use, 100 by 250 by 3 mm (4 inch by 10 inch face by 1/4 inch) thick minimum, and where both flat and edge grain will be exposed, 250 mm (10 inches) long by sufficient size, 50 by 50 mm (2 by 2 inch) minimum or actual wood member to show complete finish.
4. Attach labels to panel stating the following:
 - a. Federal Specification Number or manufacturers name and product number of paints used.
 - b. Specification code number specified in Section 09 06 00, SCHEDULE FOR FINISHES.
 - c. Product type and color.
 - d. Name of project.
5. Strips showing not less than 50 mm (2 inch) wide strips of undercoats and 100 mm (4 inch) wide strip of finish coat.
- D. Sample of identity markers if used.
- E. Manufacturers' Certificates indicating compliance with specified requirements:
 1. Manufacturer's paint substituted for Federal Specification paints meets or exceeds performance of paint specified.

1.4 DELIVERY AND STORAGE

- A. Deliver materials to site in manufacturer's sealed container marked to show following:
 1. Name of manufacturer.
 2. Product type.
 3. Batch number.
 4. Instructions for use.
 5. Safety precautions.
- B. In addition to manufacturer's label, provide a label legibly printed as following:
 1. Federal Specification Number, where applicable, and name of material.
 2. Surface upon which material is to be applied.
 3. If paint or other coating, state coat types; prime, body or finish.
- C. Maintain space for storage, and handling of painting materials and equipment in a neat and orderly condition to prevent spontaneous combustion from occurring or igniting adjacent items.
- D. Store materials at site at least 24 hours before using, at a temperature between 18 and 30 degrees C (65 and 85 degrees F).

1.5 APPLICABLE PUBLICATIONS

- A. Publications listed below form a part of this specification to the extent referenced. Publications are referenced in the text by basic designation only.
- B. American Conference of Governmental Industrial Hygienists (ACGIH):
 - ACGIH TLV-BKLT-2008.....Threshold Limit Values (TLV) for Chemical Substances and Physical Agents and Biological Exposure Indices (BEIs)
 - ACGIH TLV-DOC-2008.....Documentation of Threshold Limit Values and Biological Exposure Indices, (Seventh Edition)
- C. American National Standards Institute (ANSI):
 - A13.1-07.....Scheme for the Identification of Piping Systems
- D. Commercial Item Description (CID):
 - A-A-1555.....Water Paint, Powder (Cementitious, White and Colors) (WPC) (cancelled)
 - A-A-3120.....Paint, For Swimming Pools (RF) (cancelled)
- E. Federal Specifications (Fed Spec):
 - TT-P-1411A.....Paint, Copolymer-Resin, Cementitious (For Waterproofing Concrete and Masonry Walls) (CEP)
- F. Master Painters Institute (MPI):
 - No. 4-07.....Interior/ Exterior Latex Block Filler
 - No. 5-07.....Exterior Alkyd Wood Primer
 - No. 7-07.....Exterior Oil Wood Primer
 - No. 8-07.....Exterior Alkyd, Flat MPI Gloss Level 1 (EO)
 - No. 9-07.....Exterior Alkyd Enamel MPI Gloss Level 6 (EO)
 - No. 10-07.....Exterior Latex, Flat (AE)
 - No. 11-07.....Exterior Latex, Semi-Gloss (AE)
 - No. 18-07.....Organic Zinc Rich Primer
 - No. 26-07.....Cementitious Galvanized Metal Primer
 - No. 27-07.....Exterior / Interior Alkyd Floor Enamel, Gloss (FE)
 - No. 31-07.....Polyurethane, Moisture Cured, Clear Gloss (PV)
 - No. 36-07.....Knot Sealer
 - No. 43-07.....Interior Satin Latex, MPI Gloss Level 4
 - No. 44-07.....Interior Low Sheen Latex, MPI Gloss Level 2
 - No. 45-07.....Interior Primer Sealer
 - No. 46-07.....Interior Enamel Undercoat
 - No. 47-07.....Interior Alkyd, Semi-Gloss, MPI Gloss Level 5 (AK)
 - No. 48-07.....Interior Alkyd, Gloss, MPI Gloss Level 6 (AK)

- No. 49-07.....Interior Alkyd, Flat, MPI Gloss Level 1 (AK)
 - No. 50-07.....Interior Latex Primer Sealer
 - No. 51-07.....Interior Alkyd, Eggshell, MPI Gloss Level 3
 - No. 52-07.....Interior Latex, MPI Gloss Level 3 (LE)
 - No. 53-07.....Interior Latex, Flat, MPI Gloss Level 1 (LE)
 - No. 54-07.....Interior Latex, Semi-Gloss, MPI Gloss Level 5 (LE)
 - No. 59-07.....Interior/Exterior Alkyd Porch & Floor Enamel, Low
Gloss (FE)
 - No. 60-07.....Interior/Exterior Latex Porch & Floor Paint, Low
Gloss
 - No. 66-07.....Interior Alkyd Fire Retardant, Clear Top-Coat (ULC
Approved) (FC)
 - No. 67-07.....Interior Latex Fire Retardant, Top-Coat (ULC
Approved) (FR)
 - No. 68-07.....Interior/ Exterior Latex Porch & Floor Paint,
Gloss
 - No. 71-07.....Polyurethane, Moisture Cured, Clear, Flat (PV)
 - No. 74-07.....Interior Alkyd Varnish, Semi-Gloss
 - No. 77-07.....Epoxy Cold Cured, Gloss (EC)
 - No. 90-07.....Interior Wood Stain, Semi-Transparent (WS)
 - No. 91-07.....Wood Filler Paste
 - No. 94-07.....Exterior Alkyd, Semi-Gloss (EO)
 - No. 95-07.....Fast Drying Metal Primer
 - No. 98-07.....High Build Epoxy Coating
 - No. 101-07.....Epoxy Anti-Corrosive Metal Primer
 - No. 108-07.....High Build Epoxy Coating, Low Gloss (EC)
 - No. 114-07.....Interior Latex, Gloss (LE) and (LG)
 - No. 119-07.....Exterior Latex, High Gloss (acrylic) (AE)
 - No. 135-07.....Non-Cementitious Galvanized Primer
 - No. 138-07.....Interior High Performance Latex, MPI Gloss Level 2
(LF)
 - No. 139-07.....Interior High Performance Latex, MPI Gloss Level 3
(LL)
 - No. 140-07.....Interior High Performance Latex, MPI Gloss Level 4
 - No. 141-07.....Interior High Performance Latex (SG) MPI Gloss
Level 5
- G. Steel Structures Painting Council (SSPC):
- SSPC SP 1-04 (R2004)....Solvent Cleaning

SSPC SP 2-04 (R2004)....Hand Tool Cleaning

SSPC SP 3-04 (R2004)....Power Tool Cleaning

PART 2 - PRODUCTS

2.1 MATERIALS

- A. Cementitious Paint (CEP): TT-P-1411A [Paint, Copolymer-Resin, Cementitious (CEP)], Type 1 for exterior use, Type II for interior use.
- B. Wood Sealer: MPI 31 (semi-gloss) thinned with thinner recommended by manufacturer at rate of about one part of thinner to four parts of varnish.
- C. Plastic Tape:
 - 1. Pigmented vinyl plastic film in colors as specified in Section 09 06 00, SCHEDULE FOR FINISHES or specified.
 - 2. Pressure sensitive adhesive back.
 - 3. Widths as shown.
- D. Identity markers options:
 - 1. Pressure sensitive vinyl markers.
 - 2. Snap-on coil plastic markers.
- E. Interior/Exterior Latex Block Filler: MPI 4.
- F. Organic Zinc rich Coating (HR): MPI 22.
- G. High Heat Resistant Coating (HR): MPI 22.
- H. Cementitious Galvanized Metal Primer: MPI 26.
- I. Exterior/ interior Alkyd Floor Enamel, Gloss (FE): MPI 27.
- J. Knot Sealer: MPI 36.
- K. Interior Satin Latex: MPI 43.
- L. Interior Low Sheen Latex: MPI 44.
- M. Interior Primer Sealer: MPI 45.
- M. Interior Enamel Undercoat: MPI 47.
- N. Interior Alkyd, Semi-Gloss (AK): MPI 47.
- O. Interior Alkyd, Gloss (AK): MPI 49.
- P. Interior Latex Primer Sealer: MPI 50.
- Q. Interior Alkyd, Eggshell: MPI 51
- R. Interior Latex, MPI Gloss Level 3 (LE): MPI 52.
- S. Interior Latex, Flat, MPI Gloss Level 1 (LE): MPI 53.
- T. Interior Latex, Semi-Gloss, MPI Gloss Level 5 (LE): MPI 54.
- U. Interior / Exterior Alkyd Porch & Floor Enamel, Low Gloss (FE): MPI 59.
- V. Interior/ Exterior Latex Porch & Floor Paint, Low Gloss: MPI 60.
- W. Interior Alkyd Fire Retardant, Clear Top-Coat (ULC Approved) (FC): MPI 66.
- X. Interior Latex Fire Retardant, Top-Coat (ULC Approved) (FR): MPI 67.

- Y. Interior/ Exterior Latex Porch & Floor Paint, gloss: MPI 68.
- Z. Epoxy Cold Cured, Gloss (EC): MPI 77.
- AA. Interior Wood Stain, Semi-Transparent (WS): MPI 90.
- BB. Wood Filler Paste: MPI 91.
- CC. Exterior Alkyd, Semi-Gloss (EO): MPI 94.
- DD. Fast Drying Metal Primer: MPI 95.
- EE. High Build Epoxy Coating: MPI 98.
- FF. Epoxy Anti-Corrosive Metal Primer: MPI 101.
- GG. High Build Epoxy Marine Coating (EC): MPI 108.
- HH. Interior latex, Gloss (LE) and (LG): MPI 114.
- II. Exterior Latex, High Gloss (acrylic) (AE): MPI 119.
- JJ. Waterborne Galvanized Primer: MPI 134.
- KK. Non-Cementitious Galvanized Primer: MPI 135.
- LL. Interior High Performance Latex, MPI Gloss Level 2 (LF): MPI 138.
- MM. Interior High Performance Latex, MPI Gloss Level 3 (LL): MPI 139.
- NN. Interior High Performance Latex, MPI Gloss Level 4: MPI 140.
- OO. Interior High Performance Latex (SG), MPI Gloss Level 5: MPI 141.

2.2 PAINT PROPERTIES

- A. Use ready-mixed (including colors), except polyurethanes.
- B. Where no requirements are given in the referenced specifications for primers, use primers with pigment and vehicle, compatible with substrate and finish coats specified.

2.3 REGULATORY REQUIREMENTS/QUALITY ASSURANCE

- A. Paint materials shall conform to the restrictions of the local Environmental and Toxic Control jurisdiction.
 - 1. Volatile Organic Compounds (VOC): VOC content of paint materials shall not exceed 10g/l for interior latex paints/primers and 50g/l for exterior latex paints and primers.
 - 2. Lead-Base Paint:
 - a. Comply with Section 410 of the Lead-Based Paint Poisoning Prevention Act, as amended, and with implementing regulations promulgated by Secretary of Housing and Urban Development.
 - b. Regulations concerning prohibition against use of lead-based paint in federal and federally assisted construction, or rehabilitation of residential structures are set forth in Subpart F, Title 24, Code of Federal Regulations, Department of Housing and Urban Development.
 - c. For lead-paint removal, see Section 02 83 33.13, LEAD-BASED PAINT REMOVAL AND DISPOSAL.

3. Asbestos: Materials shall not contain asbestos.
4. Chromate, Cadmium, Mercury, and Silica: Materials shall not contain zinc-chromate, strontium-chromate, Cadmium, mercury or mercury compounds or free crystalline silica.
5. Human Carcinogens: Materials shall not contain any of the ACGIH-BKLT and ACGHI-DOC confirmed or suspected human carcinogens.
6. Use high performance acrylic paints in place of alkyd paints, where possible.
7. VOC content for solvent-based paints shall not exceed 250g/l and shall not be formulated with more than one percent aromatic hydro carbons by weight.

PART 3 - EXECUTION

3.1 JOB CONDITIONS

- A. Safety: Observe required safety regulations and manufacturer's warning and instructions for storage, handling and application of painting materials.
 1. Take necessary precautions to protect personnel and property from hazards due to falls, injuries, toxic fumes, fire, explosion, or other harm.
 2. Deposit soiled cleaning rags and waste materials in metal containers approved for that purpose. Dispose of such items off the site at end of each days work.
- B. Atmospheric and Surface Conditions:
 1. Do not apply coating when air or substrate conditions are:
 - a. Less than 3 degrees C (5 degrees F) above dew point.
 - b. Below 10 degrees C (50 degrees F) or over 35 degrees C (95 degrees F), unless specifically pre-approved by the Contracting Officer and the product manufacturer. Under no circumstances shall application conditions exceed manufacturer recommendations.
 2. Maintain interior temperatures until paint dries hard.
 3. Do no exterior painting when it is windy and dusty.
 4. Do not paint in direct sunlight or on surfaces that the sun will soon warm.
 5. Apply only on clean, dry and frost free surfaces except as follows:
 - a. Apply water thinned acrylic and cementitious paints to damp (not wet) surfaces where allowed by manufacturer's printed instructions.
 - b. Dampened with a fine mist of water on hot dry days concrete and masonry surfaces to which water thinned acrylic and cementitious paints are applied to prevent excessive suction and to cool surface.

3.2 SURFACE PREPARATION

- A. Method of surface preparation is optional, provided results of finish painting produce solid even color and texture specified with no overlays.
- B. General:
 - 1. Remove prefinished items not to be painted such as lighting fixtures, escutcheon plates, hardware, trim, and similar items for reinstallation after paint is dried.
 - 2. Remove items for reinstallation and complete painting of such items and adjacent areas when item or adjacent surface is not accessible or finish is different.
 - 3. See other sections of specifications for specified surface conditions and prime coat.
 - 4. Clean surfaces for painting with materials and methods compatible with substrate and specified finish. Remove any residue remaining from cleaning agents used. Do not use solvents, acid, or steam on concrete and masonry.
- C. Wood:
 - 1. Sand to a smooth even surface and then dust off.
 - 2. Sand surfaces showing raised grain smooth between each coat.
 - 3. Wipe surface with a tack rag prior to applying finish.
 - 4. Surface painted with an opaque finish:
 - a. Coat knots, sap and pitch streaks with MPI 36 (Knot Sealer) before applying paint.
 - b. Apply two coats of MPI 36 (Knot Sealer) over large knots.
 - 5. After application of prime or first coat of stain, fill cracks, nail and screw holes, depressions and similar defects with wood filler paste. Sand the surface to make smooth and finish flush with adjacent surface.
 - 6. Before applying finish coat, reapply wood filler paste if required, and sand surface to remove surface blemishes. Finish flush with adjacent surfaces.
 - 7. Fill open grained wood such as oak, walnut, ash and mahogany with MPI 91 (Wood Filler Paste), colored to match wood color.
 - a. Thin filler in accordance with manufacturer's instructions for application.
 - b. Remove excess filler, wipe as clean as possible, dry, and sand as specified.

D. Ferrous Metals:

1. Remove oil, grease, soil, drawing and cutting compounds, flux and other detrimental foreign matter in accordance with SSPC-SP 1 (Solvent Cleaning).
2. Remove loose mill scale, rust, and paint, by hand or power tool cleaning, as defined in SSPC-SP 2 (Hand Tool Cleaning) and SSPC-SP 3 (Power Tool Cleaning). Exception: where high temperature aluminum paint is used, prepare surface in accordance with paint manufacturer's instructions.
3. Fill dents, holes and similar voids and depressions in flat exposed surfaces of hollow steel doors and frames, access panels, roll-up steel doors and similar items specified to have semi-gloss or gloss finish with TT-F-322D (Filler, Two-Component Type, For Dents, Small Holes and Blow-Holes). Finish flush with adjacent surfaces.
 - a. This includes flat head countersunk screws used for permanent anchors.
 - b. Do not fill screws of item intended for removal such as glazing beads.
4. Spot prime abraded and damaged areas in shop prime coat which expose bare metal with same type of paint used for prime coat. Feather edge of spot prime to produce smooth finish coat.
5. Spot prime abraded and damaged areas which expose bare metal of factory finished items with paint as recommended by manufacturer of item.

E. Zinc-Coated (Galvanized) Metal Surfaces Specified Painted:

1. Clean surfaces to remove grease, oil and other deterrents to paint adhesion in accordance with SSPC-SP 1 (Solvent Cleaning).
2. Spot coat abraded and damaged areas of zinc-coating which expose base metal on hot-dip zinc-coated items with MPI 18 (Organic Zinc Rich Coating). Prime or spot prime with MPI 134 (Waterborne Galvanized Primer) or MPI 135 (Non-Cementitious Galvanized Primer) depending on finish coat compatibility.

F. Masonry, Concrete, Cement Board, Cement Plaster and Stucco:

1. Clean and remove dust, dirt, oil, grease efflorescence, form release agents, laitance, and other deterrents to paint adhesion.
2. Use emulsion type cleaning agents to remove oil, grease, paint and similar products. Use of solvents, acid, or steam is not permitted.
3. Remove loose mortar in masonry work.

4. Replace mortar and fill open joints, holes, cracks and depressions with new mortar specified in Section 04 05 13, MASONRY MORTARING // Section 04 05 16, MASONRY GROUTING//. Do not fill weep holes. Finish to match adjacent surfaces.
 5. Neutralize Concrete floors to be painted by washing with a solution of 1.4 Kg (3 pounds) of zinc sulfate crystals to 3.8 L (1 gallon) of water, allow to dry three days and brush thoroughly free of crystals.
 6. Repair broken and spalled concrete edges with concrete patching compound to match adjacent surfaces as specified in CONCRETE Sections. Remove projections to level of adjacent surface by grinding or similar methods.
- G. Gypsum Board:
1. Remove efflorescence, loose and chalking plaster or finishing materials.
 2. Remove dust, dirt, and other deterrents to paint adhesion.
 3. Fill holes, cracks, and other depressions with CID-A-A-1272A [Plaster, Gypsum (Spackling Compound) finished flush with adjacent surface, with texture to match texture of adjacent surface. Patch holes over 25 mm (1-inch) in diameter as specified in Section for plaster or gypsum board.

3.3 PAINT PREPARATION

- A. Thoroughly mix painting materials to ensure uniformity of color, complete dispersion of pigment and uniform composition.
- B. Do not thin unless necessary for application and when finish paint is used for body and prime coats. Use materials and quantities for thinning as specified in manufacturer's printed instructions.
- C. Remove paint skins, then strain paint through commercial paint strainer to remove lumps and other particles.
- D. Mix two component and two part paint and those requiring additives in such a manner as to uniformly blend as specified in manufacturer's printed instructions unless specified otherwise.
- E. For tinting required to produce exact shades specified, use color pigment recommended by the paint manufacturer.

3.4 APPLICATION

- A. Start of surface preparation or painting will be construed as acceptance of the surface as satisfactory for the application of materials.

- B. Unless otherwise specified, apply paint in three coats; prime, body, and finish. When two coats applied to prime coat are the same, first coat applied over primer is body coat and second coat is finish coat.
- C. Apply each coat evenly and cover substrate completely.
- D. Allow not less than 48 hours between application of succeeding coats, except as allowed by manufacturer's printed instructions, and approved by Resident Engineer.
- E. Finish surfaces to show solid even color, free from runs, lumps, brushmarks, laps, holidays, or other defects.
- F. Apply by brush, roller or spray, except as otherwise specified.
- G. Do not spray paint in existing occupied spaces unless approved by Resident Engineer, except in spaces sealed from existing occupied spaces.
 - 1. Apply painting materials specifically required by manufacturer to be applied by spraying.
 - 2. In areas, where paint is applied by spray, mask or enclose with polyethylene, or similar air tight material with edges and seams continuously sealed including items specified in WORK NOT PAINTED, motors, controls, telephone, and electrical equipment, fronts of sterilizes and other recessed equipment and similar prefinished items.
- H. Do not paint in closed position operable items such as access doors and panels, window sashes, overhead doors, and similar items except overhead roll-up doors and shutters.

3.5 PRIME PAINTING

- A. After surface preparation prime surfaces before application of body and finish coats, except as otherwise specified.
- B. Spot prime and apply body coat to damaged and abraded painted surfaces before applying succeeding coats.
- C. Wood and Wood Particleboard:
 - 1. Use same kind of primer specified for exposed face surface.
 - a. Interior wood except for transparent finish: MPI 45 (Interior Primer Sealer) or MPI 46 (Interior Enamel Undercoat), thinned if recommended by manufacturer.
 - b. Transparent finishes as specified under Transparent Finishes on Wood except Floors.
- D. Metals except boilers, incinerator stacks, and engine exhaust pipes:
 - 1. Machinery not factory finished: MPI 9 (Exterior Alkyd Enamel (EO)).
 - 2. Metal over 94 degrees C. (200 degrees F), Boilers, Incinerator Stacks, and Engine Exhaust Pipes: MPI 22 (High Heat Resistant Coating (HR)).

E. Gypsum Board:

1. Surfaces scheduled to have MPI 53 (Interior Latex, Flat), MPI 54 (Interior Latex, Semi-Gloss, MPI Gloss Level 5 (LE)).
2. Primer: MPI 50 (Interior Latex Primer Sealer) except use MPI 45 (Interior Primer Sealer).

F. Concrete Masonry Units except glazed or integrally colored and decorative units:

3.6 INTERIOR FINISHES

A. Apply following finish coats over prime coats in spaces or on surfaces specified in Section 09 06 00, SCHEDULE FOR FINISHES.

B. Metal Work:

1. Apply to exposed surfaces.
2. Ferrous Metal, Galvanized Metal, and Other Metals Scheduled:
 - a. Apply two coats of MPI 47 (Interior Alkyd, Semi-Gloss (AK)) unless specified otherwise.

C. Gypsum Board:

1. One coat of MPI 45 (Interior Primer Sealer) plus one coat of MPI 54 (Interior Latex, Semi-Gloss, MPI Gloss Level 5 (LE)).

D. Masonry and Concrete Walls:

1. Over MPI 4 (Interior/Exterior Latex Block Filler) on CMU surfaces.
2. Two coats of MPI 54 (Interior Latex, Semi-Gloss, MPI Gloss Level 5 (LE)).

E. Wood:

1. Sanding:
 - a. Use 220-grit sandpaper.
 - b. Sand sealers and varnish between coats.
 - c. Sand enough to scarify surface to assure good adhesion of subsequent coats, to level roughly applied sealer and varnish, and to knock off "whiskers" of any raised grain as well as dust particles.
2. Sealers:
 - a. Apply sealers specified except sealer may be omitted where pigmented, penetrating, or wiping stains containing resins are used.
 - b. Allow manufacturer's recommended drying time before sanding, but not less than 24 hours or 36 hours in damp or muggy weather.
 - c. Sand as specified.
3. Paint Finish:
 - a. Plus one coat of MPI 47 (Interior Alkyd, Semi-Gloss (AK)) (SG).
4. Transparent Finishes on Wood Except Floors.

a. Natural Finish:

- 1) One coat of sealer as written in 2.1 E.
- 2) Two coats of MPI 71 MPI 31 (Polyurethane, Moisture Cured, Clear Semi-Gloss (PV)).

b. Stain Finish:

- 1) Use wood stain of type and color required to achieve finish to match adjacent wood casework.
- 2) One coat of sealer as written in 2.1 E.
- 3) Two coats of MPI 31 (Polyurethane Moisture Cured, Clear Semi-Gloss (PV)).

3.7 PAINT COLOR

A. Color and gloss of finish coats is specified in Section 09 06 00, SCHEDULE FOR FINISHES.

B. Coat Colors:

1. Color of priming coat: Lighter than body coat.
2. Color of body coat: Lighter than finish coat.

3.8 MECHANICAL AND ELECTRICAL WORK FIELD PAINTING SCHEDULE

A. Field painting of mechanical and electrical consists of cleaning, touching-up abraded shop prime coats, and applying prime, body and finish coats to materials and equipment if not factory finished in space scheduled to be finished.

B. In spaces not scheduled to be finish painted in Section 09 06 00, SCHEDULE FOR FINISHES paint as specified under paragraph H, colors.

C. Paint various systems specified in Division 02 - EXISTING CONDITIONS, Division 21 - FIRE SUPPRESSION, Division 22 - PLUMBING, Division 23 - HEATING, VENTILATION AND AIR-CONDITIONING, Division 26 - ELECTRICAL, Division 27 - COMMUNICATIONS, and Division 28 - ELECTRONIC SAFETY AND SECURITY.

D. Paint after tests have been completed.

E. Omit prime coat from factory prime-coated items.

F. Finish painting of mechanical and electrical equipment is not required when located in interstitial spaces, above suspended ceilings, in concealed areas such as pipe and electric closets, pipe basements, pipe tunnels, trenches, attics, roof spaces, shafts and furred spaces except on electrical conduit containing feeders 600 volts or more.

G. Omit field painting of items specified in paragraph, Building and Structural WORK NOT PAINTED.

H. Color:

1. Paint items having no color specified in Section 09 06 00, SCHEDULE FOR FINISHES to match surrounding surfaces.
2. Paint colors as specified in Section 09 06 00, SCHEDULE FOR FINISHES except for following:
 - a. WhiteExterior unfinished surfaces of enameled plumbing fixtures. Insulation coverings on breeching and uptake inside boiler house, drums and drum-heads, oil heaters, condensate tanks and condensate piping.
 - b. Gray:Heating, ventilating, air conditioning and refrigeration equipment (except as required to match surrounding surfaces), and water and sewage treatment equipment and sewage ejection equipment.

3.9 BUILDING AND STRUCTURAL WORK FIELD PAINTING

- A. Painting and finishing of interior and exterior work except as specified under paragraph 3.11 B.
- B. Building and Structural Work not Painted:
 1. Prefinished items:
 - a. Casework, doors, elevator entrances and cabs, metal panels, wall covering, and similar items specified factory finished under other sections.
 - b. Factory finished equipment and pre-engineered metal building components such as metal roof and wall panels.
 2. Finished surfaces:
 - a. Hardware except ferrous metal.
 - b. Anodized aluminum, stainless steel, chromium plating, copper, and brass, except as otherwise specified.
 - c. Signs, fixtures, and other similar items integrally finished.
 3. Concealed surfaces:
 - a. Inside dumbwaiter, elevator and duct shafts, interstitial spaces, except as otherwise specified.
 - b. Inside walls or other spaces behind access doors or panels.
 - c. Surfaces concealed behind permanently installed casework and equipment.
 4. Moving and operating parts:
 - a. Shafts, chains, gears, mechanical and electrical operators, linkages, and sprinkler heads, and sensing devices.
 - b. Tracks for overhead or coiling doors, shutters, and grilles.
 5. Labels:

- a. Code required label, such as Underwriters Laboratories Inc., Inchcape Testing Services, Inc., or Factory Mutual Research Corporation.
- b. Identification plates, instruction plates, performance rating, and nomenclature.
- 6. Galvanized metal:
 - a. Exterior chain link fence and gates, corrugated metal areaways, and gratings.

3.10 IDENTITY PAINTING SCHEDULE

- A. Identify designated service in accordance with ANSI A13.1, unless specified otherwise, on exposed piping, piping above removable ceilings, piping in accessible pipe spaces, interstitial spaces, and piping behind access panels.
 - 1. Legend may be identified using 2.1 G options or by stencil applications.
 - 2. Apply legends adjacent to changes in direction, on branches, where pipes pass through walls or floors, adjacent to operating accessories such as valves, regulators, strainers and cleanouts a minimum of 12 000 mm (40 feet) apart on straight runs of piping. Identification next to plumbing fixtures is not required.
 - 3. Locate Legends clearly visible from operating position.
 - 4. Use arrow to indicate direction of flow.
 - 5. Identify pipe contents with sufficient additional details such as temperature, pressure, and contents to identify possible hazard. Insert working pressure shown on drawings where asterisk appears for High, Medium, and Low Pressure designations as follows:
 - a. High Pressure - 414 kPa (60 psig) and above.
 - b. Medium Pressure - 104 to 413 kPa (15 to 59 psig).
 - c. Low Pressure - 103 kPa (14 psig) and below.
 - d. Add Fuel oil grade numbers.
 - 6. Legend name in full or in abbreviated form as follows:

PIPING	COLOR OF EXPOSED PIPING	COLOR OF BACKGROUND	COLOR OF LETTERS	LEGEND ABBREVIATIONS
Blow-off		Yellow	Black	Blow-off
Boiler Feedwater		Yellow	Black	Blr Feed
A/C Condenser Water Supply		Green	White	A/C Cond Wtr Sup
A/C Condenser Water Return		Green	White	A/C Cond Wtr Ret

Chilled Water Supply		Green	White	Ch. Wtr Sup
Chilled Water Return		Green	White	Ch. Wtr Ret
Shop Compressed Air		Yellow	Black	Shop Air
Air-Instrument Controls		Green	White	Air-Inst Cont
Drain Line		Green	White	Drain
Emergency Shower		Green	White	Emg Shower
High Pressure Steam		Yellow	Black	H.P. _____*
High Pressure Condensate Return		Yellow	Black	H.P. Ret _____*
Medium Pressure Steam		Yellow	Black	M. P. Stm _____*
Medium Pressure Condensate Return		Yellow	Black	M.P. Ret _____*
Low Pressure Steam		Yellow	Black	L.P. Stm _____*
Low Pressure Condensate Return		Yellow	Black	L.P. Ret _____*
High Temperature Water Supply		Yellow	Black	H. Temp Wtr Sup
High Temperature Water Return		Yellow	Black	H. Temp Wtr Ret
Hot Water Heating Supply		Yellow	Black	H. W. Htg Sup
Hot Water Heating Return		Yellow	Black	H. W. Htg Ret
Gravity Condensate Return		Yellow	Black	Gravity Cond Ret
Pumped Condensate Return		Yellow	Black	Pumped Cond Ret
Vacuum Condensate Return		Yellow	Black	Vac Cond Ret
Fuel Oil - Grade		Green	White	Fuel Oil-Grade ____*
Boiler Water Sampling		Yellow	Black	Sample
Chemical Feed		Yellow	Black	Chem Feed
Continuous Blow-Down		Yellow	Black	Cont. B D
Pumped Condensate		Black		Pump Cond
Pump Recirculating		Yellow	Black	Pump-Recirc.
Vent Line		Yellow	Black	Vent
Alkali		Yellow	Black	Alk
Bleach		Yellow	Black	Bleach
Detergent		Yellow	Black	Det
Liquid Supply		Yellow	Black	Liq Sup
Reuse Water		Yellow	Black	Reuse Wtr
Cold Water (Domestic)	White	Green	White	C.W. Dom
Hot Water (Domestic)				
Supply	White	Yellow	Black	H.W. Dom
Return	White	Yellow	Black	H.W. Dom Ret
Tempered Water	White	Yellow	Black	Temp. Wtr
Ice Water				
Supply	White	Green	White	Ice Wtr
Return	White	Green	White	Ice Wtr Ret
Reagent Grade Water		Green	White	RG
Reverse Osmosis		Green	White	RO
Sanitary Waste		Green	White	San Waste
Sanitary Vent		Green	White	San Vent
Storm Drainage		Green	White	St Drain
Pump Drainage		Green	White	Pump Disch

Chemical Resistant Pipe

Waste	Yellow	Black	Acid Waste
Vent	Yellow	Black	Acid Vent
Atmospheric Vent	Green	White	ATV
Silver Recovery	Green	White	Silver Rec
Oral Evacuation	Green	White	Oral Evac
Fuel Gas	Yellow	Black	Gas
Fire Protection Water			
Sprinkler	Red	White	Auto Spr
Standpipe	Red	White	Stand
Sprinkler	Red	White	Drain

7. Electrical Conduits containing feeders over 600 volts, paint legends using 50 mm (2 inch) high black numbers and letters, showing the voltage class rating. Provide legends where conduits pass through walls and floors and at maximum 6100 mm (20 foot) intervals in between. Use labels with yellow background with black border and words Danger High Voltage Class.
8. See Sections for methods of identification, legends, and abbreviations of the following:
 - a. Conduits containing high voltage feeders over 600 volts: Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS / Section 27 05 33, RACEWAYS AND BOXES FOR COMMUNICATIONS SYSTEMS / Section 28 05 33, RACEWAYS AND BOXES FOR ELECTRONIC SAFETY AND SECURITY.
- B. Fire and Smoke Partitions:
 1. Identify partitions above ceilings on both sides of partitions except within shafts in letters not less than 64 mm (2 1/2 inches) high.
 2. Stenciled message: "SMOKE BARRIER" or, "FIRE BARRIER" as applicable.
 3. Locate not more than 6100 mm (20 feet) on center on corridor sides of partitions, and with a least one message per room on room side of partition.
 4. Use semigloss paint of color that contrasts with color of substrate.
- C. Identify columns in pipe basements and interstitial space:
 1. Apply stenciled number and letters to correspond with grid numbering and lettering shown.
 2. Paint numbers and letters 100 mm (4 inches) high, locate 450 mm (18 inches) below overhead structural slab.
 3. Apply on four sides of interior columns and on inside face only of exterior wall columns.
 4. Color:

- a. Use black on concrete columns.
- b. Use white or contrasting color on steel columns.

3.11 PROTECTION CLEAN UP, AND TOUCH-UP

- A. Protect work from paint droppings and spattering by use of masking, drop cloths, removal of items or by other approved methods.
- B. Upon completion, clean paint from hardware, glass and other surfaces and items not required to be painted of paint drops or smears.
- C. Before final inspection, touch-up or refinished in a manner to produce solid even color and finish texture, free from defects in work which was damaged or discolored.

- - - E N D - - -

APPENDIX

Coordinate the following abbreviations used in Section 09 91 00, PAINTING, with other Sections, especially Section 09 06 00, SCHEDULE FOR FINISHES and other COATING SECTIONS listed. Use the same abbreviation and terms consistently.

Paint or coating Abbreviation

Acrylic Emulsion AE (MPI 10 - flat/MPI 11 - semigloss/MPI 119 - gloss)

Alkyd Flat Ak (MPI 49)

Alkyd Gloss Enamel G (MPI 48)

Alkyd Semigloss Enamel SG (MPI 47)

Aluminum Paint AP (MPI 1)

Cementitious Paint CEP (TT-P-1411)

Exterior Latex EL??(MPI 10 / 11 / 119)??

Exterior Oil EO (MPI 9 - gloss/MPI 8 - flat/MPI 94 - semigloss)

Epoxy Coating EC (MPI 77 - walls, floors/MPI 108 - CMU, concrete)

Fire Retardant Paint FR (MPI 67)

Fire Retardant Coating (Clear) FC (MPI 66, intumescent type)

Floor Enamel FE (MPI 27 - gloss/MPI 59 - eggshell)

Heat Resistant Paint HR (MPI 22)

Latex Emulsion LE (MPI 53, flat/MPI 52, eggshell/MPI 54, semigloss/MPI 114, gloss Level 6)

Latex Flat LF (MPI 138)

Latex Gloss LG (MPI 114)

Latex Semigloss SG (MPI 141)

Latex Low Luster LL (MPI 139)

Plastic Floor Coating PL

Polyurethane Varnish PV (MPI 31 - gloss/MPI 71 - flat)
Rubber Paint RF (CID-A-A-3120 - Paint for Swimming Pools (RF)).
Water Paint, Cement WPC (CID-A-A-1555 - Water Paint, Powder).
Wood Stain WS (MPI 90)

Verify abbreviations used in the following coating sections:

Section 09 96 59, HIGH-BUILD GLAZED COATINGS GC
Section 09 94 19, MULTICOLOR INTERIOR FINISHING MC

- - - E N D - - -

SECTION 10 14 00
SIGNAGE

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This section specifies interior signage for room numbers, directional signs, code required signs, telephone identification signs and temporary interior signs.
- B. This section also specifies exterior medical center identification signs, building identification signs, parking and traffic signs.
- C. Installation of Government furnished dedication plaque and VA seal.

1.2 RELATED WORK

- A. Electrical: Related Electrical Specification Sections.
- B. Lighted EXIT signs for egress purposes are specified under Division 26, ELECTRICAL.
- C. Color Finish: Section 09 06 00, SCHEDULE FOR FINISHES.

1.3 MANUFACTURER'S QUALIFICATIONS

Sign manufacturer shall provide evidence that they regularly and presently manufactures signs similar to those specified in this section as one of their principal products.

1.4 SUBMITTALS

- A. Submit in accordance with Section 01 33 00, SHOP DRAWINGS, PRODUCT DATA AND SAMPLES.
- B. Samples: Sign panels and frames, with letters and symbols, each type. Submit 2 sets. One set of samples will be retained by Resident Engineer, other returned to Contractor.
 - 1. Sign Panel, 200 mm x 250 mm (8 inches x 10 inches), with letters.
 - 2. Color samples of each color, 150 mm x 150 mm (6 inches x 6 inches. Show anticipated range of color and texture.
 - 3. Sample of typeface, arrow and symbols in a typical full size layout.
- C. Manufacturer's Literature:
 - 1. Showing the methods and procedures proposed for the concealed anchorage of the signage system to each surface type.
 - 2. Manufacturer's printed specifications, anchorage details, installation and maintenance instructions.
- D. Samples: Sign location plan, showing location, type and total number of signs required.

E. Shop Drawings: Scaled for manufacture and fabrication of sign types. Identify materials, show joints, welds, anchorage, accessory items, mounting and finishes.

F. Full size layout patterns for dimensional letters.

1.5 DELIVERY AND STORAGE

- A. Deliver materials to job in manufacturer's original sealed containers with brand name marked thereon. Protect materials from damage.
- B. Package to prevent damage or deterioration during shipment, handling, storage and installation. Maintain protective covering in place and in good repair until removal is necessary.
- C. Deliver signs only when the site and mounting services are ready for installation work to proceed.
- D. Store products in dry condition inside enclosed facilities.

1.6 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American Society for Testing and Materials (ASTM):
 - B209-07.....Aluminum and Aluminum-Alloy Sheet and Plate
 - B221-06.....Aluminum and Aluminum-Alloy Extruded Bars, Rods, Wire, Shapes, and tubes.
- C. Federal Specifications (Fed Spec):
 - MIL-PRF-8184F.....Plastic Sheet, Acrylic, Modified.
 - MIL-P-46144C.....Plastic Sheet, Polycarbonate

1.7 MINIMUM SIGN REQUIREMENTS

- A. Permanent Rooms and Spaces:
 - 1. Tactile and Braille Characters, raised minimum 0.793 mm (1/32 in). Characters shall be accompanied by Grade 2 Braille.
 - 2. Type Styles: Characters shall be uppercase, Helvetica Medium, Helvetica Medium Condensed and Helvetica Regular.
 - 3. Character Height: Minimum 16 mm (5/8 in) high, Maximum 50 mm (2 in).
 - 4. Symbols (Pictograms): Equivalent written description shall be placed directly below symbol, outside of symbol's background field. Border dimensions of symbol background shall be minimum 150 mm (6 in) high.
 - 5. Finish and Contrast: Characters and background shall match existing campus signage system.
 - 6. Mounting Location and Height: Mounted on wall adjacent to the latch side of the door and to avoid door swing and protruding objects.

B. Overhead Signs:

1. Type Styles: As shown. Characters shall have a width-to-height ratio between 3:5 and 1:1. Characters shall have a stroke width-to-height ratio of between 1:5 and 1:10.
2. Character Height: minimum 75 mm (3 in) high for overhead signs. As shown, for directional signs.
3. Finish and Contrast: Same as for signs of permanent rooms and spaces.
4. Mounting Location and Height: As shown.

1.8 COLORS AND FINISHES:

Colors and finishes are to match the existing campus sign system for both interior and exterior signage.

PART 2 - PRODUCTS**2.1 GENERAL**

- A. Signs of type, size and design as specified.
- B. Signs complete with lettering, framing and related components for a complete installation.
- C. Provide graphics items as completed units produced by a single manufacturer, including necessary mounting accessories, fittings and fastenings.
- D. Contractor to verify existing signage system requirements for sizes and mounting conditions. Resident Engineer to be notified of any discrepancy in drawing, in field directions or conditions, and/or of any changes required for all such construction details.
- E. The Sign Contractor, by commencing work of this section, assumes overall responsibility, as part of his warranty of work, to assure that assemblies, components and parts shown or required within the work of the section, comply with the Contract Documents. The Contractor shall further warrant: That all components, specified or required to satisfactorily complete the installation are compatible with each other and with conditions of installations.

2.2 PRODUCTS

- A. Aluminum:
 1. Sheet and Plate: ASTM B209.
 2. Extrusions and Tubing: ASTM B221.
- B. Cast Acrylic Sheet: MIL-PRF-8184F; Type II, class 1, Water white non-glare optically clear. Matt finish water white clear acrylic shall not be acceptable.

- C. Polycarbonate: MIL-P-46144C; Type I, class 1.
- D. Vinyl: 0.1 mm thick machine cut, having a pressure sensitive adhesive and integral colors.
- E. Electrical Signs:
 - 1. General: Furnish and install all lighting, electrical components, fixtures and lamps ready for use in accordance with the sign type drawings, details and specifications.
 - 2. Refer to Electrical Specifications Section, Division 26, ELECTRICAL, to verify line voltages for sign locations that require electrical signs.
 - 3. Quality Control: Installed electrical components and sign installations are to bear the label and certification of Underwriter's Laboratories, Inc., and are to comply with National Electrical Code as well as applicable federal, state and local codes for installation techniques, fabrication methods and general product safety.
 - 4. Ballast and Lighting Fixtures: See Electrical Specifications.
- F. Concrete Post Footings: See Section 03 30 53, MISCELLANEOUS CAST-IN-PLACE CONCRETE, Cast-in-place Concrete.
- G. Steel: See Section 05 12 00, STRUCTURAL STEEL FRAMING.

2.3 SIGN STANDARDS

- A. Topography:
 - 1. Type Style: To match existing campus signage system.
 - 2. Arrow: To match existing campus signage system.
 - 3. Letter spacing: To match existing campus signage system.
 - 4. Text shall be a true, clean, accurate reproduction of typeface(s) shown. Text shown in drawings are for layout purposes only.
- B. Project Colors and Finishes: To match existing campus signage system.

2.4 SIGN TYPES

- A. General:
 - 1. The interior sign system shall match the existing VAMC Beckley Campus signage system in appearance, format and functionality. The Contractor is responsible for reviewing the current signage system and providing interior signs as described in this section.
 - 2. The exterior building sign(s) for the Adult Day Care Building shall match the existing VAMC Beckley Campus signage system in appearance, format and functionality. The Contractor is responsible for reviewing the current exterior signage system and providing exterior

signs as described in this section with the VAMC building number designation as provided by the Owner.

B. Interior Signs:

1. The following permanent rooms or spaces shall be provided signs based on the current VAMC Beckley Campus signage system. The architectural space number is for reference only. Actual room names and number designations to be approved by the Owner.

a. Ground Floor

- 1) Mechanical Room G102
- 2) Maintenance and Operations G103
- 3) Riser Room G107
- 4) Janitor Storage G106
- 5) Elevator Equipment Room G105
- 6) Electrical Room G104
- 7) Communications Room G108
- 8) CWT-Workshop G111
- 9) Men's Toilet G109
- 10) Women's Toilet G110

b. First Floor

- 1) Closet A103
- 2) Closet A104
- 3) Closet A105
- 4) Laundry A113
- 5) Staff Toilet A108
- 6) Pantry A106
- 7) Office A112
- 8) Storage A112A
- 9) Unisex Toilet A115
- 10) Janitor A116
- 11) Unisex A117
- 12) Work Room A118
- 13) Communications Room A119
- 14) Men's Toilet A120

- 15) Janitor A121
- 16) Women's Toilet A122
- 17) Work Room A123
- 18) Office A125
- 19) Office A127
- 20) Office A129
- 21) Office A131
- 22) Office A124
- 23) Office A126
- 24) Office A128
- 25) Office A130
- 26) Office A132
- 27) Office A135

- 2. The following interior sign types shall be provided by the Contractor based on the current signage in use on the VAMCE Beckley Campus. Locations and sign content to be approved by Owner.
 - a. Evacuation (4 locations)
 - b. Fire Doors (4 locations)
 - c. Directional (6 locations)
 - d. No Smoking (4 locations)
 - e. Fire Department Connection (2 locations)
 - f. General Safety and Prohibited Items (4 locations)
 - g. Facility Entrance (from connecting corridor - 1 location)

C. Exterior Signs:

- 1. The following exterior signs shall be provided based on the current VAMC Beckley Campus signage system. Locations and sign content to be approved by Owner.
 - a. Building Designation (1 location)
 - b. Adult Day Care Center Entrance (1 location)
 - c. Office Suite Entrance (2 locations)
 - d. CWT- Workshop G111 (1 location)
 - e. Maintenance and Operations G103 (1 location)

D. Temporary Interior Signs:

1. Fabricated from 50 kg (110 pound) matte finished white paper cut to 100 mm (4 inch) wide by 300 mm (12 inch) long. Punched 3 mm (.125 inch) hole with edge of hole spaced 13 mm (.5 inch) in from edge and centered on 100 mm (4 inch) side. Reinforce hole on both sides with suitable material that prevents tie from pulling through hole. Ties are steel wire 0.3 mm (0.120 inch) thick attached to tag with twist leaving 150 mm (6 inch) long free ends.
2. Mark architectural room number on sign, with broad felt marker in clearly legible numbers or letters that identify room, corridor or space as shown on floor plans.
3. Install temporary signs to all rooms that have a room, corridor or space number. Attach to door frame, door knob or door pull.
 - a. Doors that do not require signs are: corridor doors in corridor with same number, folding doors or partitions, toilet doors, bathroom doors within and between rooms, closet doors within rooms, communicating doors in partitions between rooms with corridor entrance doors.
 - b. Replace and missing damaged or illegible signs.

2.5 FABRICATION

- A. Design components to allow for expansion and contraction for a minimum material temperature range of 56 °C (100 °F), without causing buckling, excessive opening of joints or over stressing of adhesives, welds and fasteners.
- B. Form work to required shapes and sizes, with true curve lines and angles. Provide necessary rebates, lugs and brackets for assembly of units. Use concealed fasteners whenever and wherever possible.
- C. Shop fabricate so far as practicable. Joints fastened flush to conceal reinforcement, or welded where thickness or section permits.
- D. Contact surfaces of connected members be true. Assembled so joints will be tight and practically unnoticeable, without use of filling compound.
- E. Signs shall have fine, even texture and be flat and sound. Lines and miters sharp, arises unbroken, profiles accurate and ornament true to pattern. Plane surfaces be smooth flat and without oil-canning, free of rack and twist. Maximum variation from plane of surface plus or minus 0.3 mm (0.015 inches). Restore texture to filed or cut areas.
- F. Level or straighten wrought work. Members shall have sharp lines and angles and smooth surfaces.

- G. Extruded members to be free from extrusion marks. Square turns and corners sharp, curves true.
- H. Drill holes for bolts and screws. Conceal fastenings where possible. Exposed ends and edges mill smooth, with corners slightly rounded. Form joints exposed to weather to exclude water.
- I. Finish hollow signs with matching material on all faces, tops, bottoms and ends. Edge joints tightly mitered to give appearance of solid material.
- J. All painted surfaces properly primed. Finish coating of paint to have complete coverage with no light or thin applications allowing substrate or primer to show. Finished surface smooth, free of scratches, gouges, drips, bubbles, thickness variations, foreign matter and other imperfections.
- K. Movable parts, including hardware, are be cleaned and adjusted to operate as designed without binding or deformation of members. Doors and covers centered in opening or frame. All contact surfaces fit tight and even without forcing or warping components.
- L. Pre-assemble items in shop to greatest extent possible to minimize field splicing and assembly. Disassemble units only as necessary for shipping and handling limitations. Clearly mark units for re-assembly and coordinated installation.
- M. No signs are to be manufactured until final sign message schedule and location review has been completed by the Resident Engineer & forwarded to contractor.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Protect products against damage during field handling and installation. Protect adjacent existing and newly placed construction, landscaping and finishes as necessary to prevent damage during installation. Paint and touch up any exposed fasteners and connecting hardware to match color and finish of surrounding surface.
- B. Mount signs in proper alignment, level and plumb according to the sign location plan and the dimensions given on elevation and sign location drawings. Where otherwise not dimensioned, signs shall be installed where best suited to provide a consistent appearance throughout the project. When exact position, angle, height or location is in doubt, contact Resident Engineer for clarification.

- C. Contractor shall be responsible for all signs that are damaged, lost or stolen while materials are on the job site and up until the completion and final acceptance of the job.
- D. Remove or correct signs or installation work Resident Engineer determines as unsafe or as an unsafe condition.
- E. At completion of sign installation, clean exposed sign surfaces. Clean and repair any adjoining surfaces and landscaping that became soiled or damaged as a result of installation of signs.
- F. Locate signs as shown on the Sign Location Plans.
- G. Certain signs may be installed on glass. A blank glass back up is required to be placed on opposite side of glass exactly behind sign being installed. This blank glass back up is to be the same size as sign being installed.
- H. Contractor will be responsible for verifying that behind each sign location there are no utility lines that will be affected by installation of signs. Any damage during installation of signs to utilities will be the sole responsibility of the Contractor to correct and repair.
- I. Furnish inserts and anchoring devices which must be set in concrete or other material for installation of signs. Provide setting drawings, templates, instructions and directions for installation of anchorage devices which may involve other trades.

- - - END - - -

**SECTION 10 26 00
WALL AND DOOR PROTECTION**

PART 1 - GENERAL

1.1 DESCRIPTION

This section specifies, corner guards and high impact wall covering.

1.2 RELATED WORK

- A. Armor plates and kick plates not specified in this section: Section 08 71 00, DOOR HARDWARE.

1.3 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Shop Drawings: Show design and installation details.
- C. Manufacturer's Literature and Data:
 - 1. Corner Guards.
 - 2. High Impact Wall covering
- D. Test Report: Showing that resilient material complies with specified fire and safety code requirements.

1.4 DELIVERY AND STORAGE

- A. Deliver materials to the site in original sealed packages or containers marked with the name and brand, or trademark of the manufacturer.
- B. Protect from damage from handling and construction operations before, during and after installation.
- C. Store in a dry environment of approximately 21° C (70 degrees F) for at least 48 hours prior to installation.

1.5 APPLICABLE PUBLICATIONS

- A. Publications listed below form a part of this specification to extent referenced. Publications are referenced in text by basic designation only.
- B. American Society for Testing and Materials (ASTM):
 - D256-06.....Impact Resistance of Plastics
 - D635-06.....Rate of Burning and/or Extent and Time of Burning of Self-Supporting Plastics in a Horizontal Position
 - E84-09.....Surface Burning Characteristics of Building Materials
- C. National Fire Protection Association (NFPA):
 - 80-10.....Standard for Fire Doors and Windows

D. Underwriters Laboratories Inc. (UL):

Annual Issue.....Building Materials Directory

PART 2 - PRODUCTS

2.1 MATERIALS

A. Resilient Material:

1. Extruded and injection molded acrylic vinyl or extruded polyvinyl chloride meeting following requirements:
 - a. Minimum impact resistance of 1197 ps (25 ft lbs per sq.ft) when tested in accordance with ASTM D256 (Izod impact, ft.lbs. per inch notch).
 - b. Class 1 fire rating when tested in accordance with ASTM E84, having a maximum flame spread of 25 and a smoke developed rating of 450 or less.
 - c. Rated self extinguishing when tested in accordance with ASTM D635.
 - d. Material shall be labeled and tested by Underwriters Laboratories or other approved independent testing laboratory.
 - e. Integral color with all colored components matched in accordance with SAE J 1545 to within plus or minus 1.0 on the CIE-LCH scales.
 - f. Same finish on exposed surfaces.

2.2 CORNER GUARDS

- A. Resilient, Shock-Absorbing Corner Guards: Surface mounted, type of 6 mm 1/4-inch corner formed to profile shown.
1. Snap-on corner guard formed from resilient material, minimum 2 mm (0.078-inch) thick, free floating on a continuous 1.6 mm (0.063-inch) thick extruded aluminum retainer. Provide appropriate mounting hardware, cushions and base plates as required.
 2. Provide factory fabricated end closure caps at top and bottom of surface mounted corner guards.

2.3 HIGH IMPACT WALL COVERING (JANITOR'S CLOSETS)

- A. Fabricate from vinyl acrylic or polyvinyl chloride resilient material minimum 6mm (0.06 inch) thick designed specially for interior use.
- B. Provide adhesive as recommended by the wall covering manufacturer.

2.4 FASTENERS AND ANCHORS

- A. Provide fasteners and anchors as required for each specific type of installation.

- B. Where type, size, spacing or method of fastening is not shown or specified, submit shop drawings showing proposed installation details.

2.5 FINISH

- A. In accordance with NAAMM AMP 500 series.
- B. Resilient Material: Embossed texture and color in accordance with SAE J 1545 and as specified in Section 09 06 00, SCHEDULE FOR FINISHES.

PART 3 - INSTALLATION

3.1 RESILIENT CORNER GUARDS

Install corner guards on walls in accordance with manufacturer's instructions.

3.2 DOOR, DOOR FRAME PROTECTION AND HIGH IMPACT WALL COVERING

- A. Surfaces to receive protection shall be clean, smooth and free of obstructions.
- B. Install protectors after frames are in place but preceding installation of doors in accordance with approved shop drawings and manufacturers specific instructions.
- C. Apply with adhesive in controlled environment according to manufacture's recommendations.
- D. Protection installed on fire rated doors and frames shall be installed according to NFPA 80 and installation procedures listed in UL Building Materials Directory; or, equal listing by other approved independent testing laboratory establishing the procedures.

- - - E N D - - -

SECTION 10 28 00
TOILET, BATH, AND LAUNDRY ACCESSORIES

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This section specifies manufactured items usually used in dressing rooms, toilets, baths, locker rooms and at sinks in related spaces.
- B. Items Specified:
 - 1. Paper towel dispenser.
 - 2. Waste receptacles.
 - 3. Toilet tissue dispenser.
 - 4. Grab bars.
 - 5. Shower curtain rods.
 - 6. Clothes hooks, robe or coat.
 - 7. Towel bars.
 - 8. Metal framed mirror
 - 9. Mop racks.
 - 10. Sanitary Napkin Disposal
 - 11. Soap Dispenser
- B. This section also specifies custom fabricated items used in toilets and related spaces.

1.2 RELATED WORK

- A. Color of finishes: Section 09 06 00, SCHEDULE FOR FINISHES
- B. Manufactured toilet and bath accessories: Section 10 28 00, TOILET, BATH, AND LAUNDRY ACCESSORIES.

1.3 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Shop Drawings:
 - 1. Each product specified.
 - 2. Paper towel dispenser and combination dispenser and disposal units.
 - 3. Metal framed mirrors, fillers, and design and installation of units when installed on ceramic tile wainscots and offset surfaces.
 - 4. Shower Curtain rods, showing required length for each location.

5. Grab bars, showing design and each different type of anchorage.
6. Show material and finish, size of members, and details of construction, installation and anchorage of mop racks.

C. Samples:

1. One of each type of accessory specified.
2. After approval, samples may be used in the work.

D. Manufacturer's Literature and Data:

1. All accessories specified.
2. Show type of material, gages or metal thickness in inches, finishes, and when required, capacity of accessories.
3. Show working operations of spindle for toilet tissue dispensers.
4. Mop racks.

E. Manufacturer's Certificates:

1. Attesting that soap dispensers are fabricated of material that will not be affected by liquid soap or aseptic detergents, PhisoHex and solutions containing hexachlorophene.
2. Finish to be selected by Architect.

1.4 QUALITY ASSURANCE

- A. Each product shall meet, as a minimum, the requirements specified, and shall be a standard commercial product of a manufacturer regularly presently manufacturing items of type specified.
- B. Each accessory type shall be the same and be made by the same manufacturer.
- C. Each accessory shall be assembled to the greatest extent possible before delivery to the site.
- D. Include additional features, which are not specifically prohibited by this specification, but which are a part of the manufacturer's standard commercial product.

1.5 PACKAGING AND DELIVERY

- A. Pack accessories individually to protect finish.
- B. Deliver accessories to the project only when installation work in rooms is ready to receive them.
- C. Deliver inserts and rough-in frames to site at appropriate time for building-in.
- D. Deliver products to site in sealed packages or containers; labeled for identification with manufacturer's name, brand, and contents.

1.6 STORAGE

- A. Store products in weathertight and dry storage facility.
- B. Protect from damage from handling, weather and construction operations before, during and after installation in accordance with manufacturer's instructions.

1.7 APPLICABLE PUBLICATIONS

- A. Publications listed below form a part of this specification to the extent referenced. Publications are referenced in the text by the basic designation only.
- B. American Society for Testing and Materials (ASTM):
 - A167-99(R2004).....Stainless and Heat-Resisting Chromium-Nickel Steel Plate, Sheet and Strip.
 - A176-99(R2004).....Stainless and Heat-Resisting Chromium Steel Plate, Sheet, and Strip
 - A269-07Seamless and Welded Austenitic Stainless Steel Tubing for General Service
 - A312/A312M-06.....Seamless and Welded Austenitic Stainless Steel Pipes
 - A653/A653M-07.....Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy-Coated (Galvannealed) by the Hot-Dip Process
 - B221-06.....Aluminum and Aluminum-Alloy Extruded Bars, Rods, Wire, Shapes, and Tubes
 - B456-03.....Electrodeposited Coatings of Copper Plus Nickel Plus Chromium and Nickel Plus Chromium
 - C1036-06.....Flat Glass
 - C1048-04.....Heat-Treated Flat Glass-Kind HS, Kind FT Coated and Uncoated Glass
 - D635-06Rate of Burning and/or Extent and Time of Burning of Self Supporting Plastics in a Horizontal Position
 - F446-85 (R2004).....Consumer Safety Specification for Grab Bars and Accessories Installed in the Bathing Area.
 - A269-07Seamless and Welded Austenitic Stainless Steel Tubing for General Service

- D3453-01Flexible Cellular Materials - Urethane for Furniture and
Automotive Cushioning, Bedding, and Similar
Applications
- D3690-02Vinyl-Coated and Urethane-Coated Upholstery Fabrics
- C. The National Association of Architectural Metal Manufacturers (NAAMM) :
AMP 500 SeriesMetal Finishes Manual
AMP 500-505-88Metal Finishes Manual and Finishes for Stainless Steel
- D. American Welding Society (AWS) :
D10.4-86 (R2000).....Welding Austenitic Chromium-Nickel Stainless Steel
Piping and Tubing
- E. Federal Specifications (Fed. Specs.):
A-A-3002Mirrors, Glass
FF-S-107C (2).....Screw, Tapping and Drive
FF-S-107C.....Screw, Tapping and Drive.
WW-P-541E(1).....Plumbing Fixtures (Accessories, Land Use) Detail
Specification

PART 2 - PRODUCTS

2.1 MATERIALS

- A. Aluminum: ASTM B221, alloy 6063-T5 and alloy 6463-T5.
- B. Stainless Steel:
1. Plate or sheet: ASTM A167, Type 302, 304, or 304L, except ASTM A176 where Type 430 is specified, 0.0299-inch thick unless otherwise specified.
 2. Tube: ASTM A269, Alloy Type 302, 304, or 304L.
- C. Stainless Steel Tubing: ASTM A269, Grade 304 or 304L, seamless or welded.
- D. Stainless Steel Pipe: ASTM A312; Grade TP 304 or TP 304L.
- E. Steel Sheet: ASTM A653, zinc-coated (galvanized) coating designation G90.
- F. Glass:
1. ASTM C1036, Type 1, Class 1, Quality q2, for mirrors, and for mirror doors in medicine cabinets.
 2. ASTM C1036, Type 1 Class 1 Quality q3, for shelves in medicine cabinets.

3. ASTM C1048, Kind FT, Condition A, Type 1, Class 1 (use in Mental Health and Behavior Nursing Unit Psychiatric Patient Areas and Security Examination Rooms where mirrors and glass are specified).

G. Foam Rubber: ASTM D3453, Grade BD, Type 2.

H. Vinyl Covering: ASTM D3690, Vinyl coated fabric, Class A.

I. Plywood: PS1, Grade CD.

2.2 FASTENERS

- A. Exposed Fasteners: Stainless steel or chromium plated brass, finish to match adjacent surface.
- B. Concealed Fasteners: Steel, hot-dip galvanized (except in high moisture areas such as showers or bath tubs use stainless steel).
- C. Toggle Bolts: For use in hollow masonry or frame construction.
- D. Hex bolts: For through bolting on thin panels.
- E. Expansion Shields: Lead or plastic as recommended by accessory manufacturer for component and substrate for use in solid masonry or concrete.
- F. Screws:
 1. ASME B18.6.4.
 2. Fed Spec. FF-S-107, Stainless steel Type A.
- G. Adhesive: As recommended by manufacturer for products to be joined.

2.3 FINISH

- A. In accordance with NAAMM AMP 500 series.
- B. Anodized Aluminum:
 1. AA-C22A41 Chemically etched medium matte, with clear anodic coating, Class I Architectural, 0.7-mil thick.
- C. AA-M32 Mechanical finish, medium satin.
 1. Chromium Plating: ASTM B456, satin or bright as specified, Service Condition No. SC2.
 2. Stainless Steel: NAAMM AMP 503, finish number 4.
 3. Ferrous Metal:
 - a. Shop Prime: Clean, pretreat and apply one coat of primer and bake.
 - b. Finish: Over primer apply two coats of alkyd or phenolic resin enamel, and bake.
 4. Nylon Coated Steel: Nylon coating powder formulated for a fluidized bonding process to steel to provide a hard smooth, medium gloss finish, not less than 0.3 mm

(0.012-inch) thick, rated as self-extinguishing when tested in accordance with ASTM D635.

2.4 FABRICATION - GENERAL

- A. Welding, AWS D10.4.
- B. Grind dress, and finish welded joints to match finish of adjacent surface.
- C. Form exposed surfaces from one sheet of stock, free of joints.
- D. Provide steel anchors and components required for secure installation.
- E. Form flat surfaces without distortion. Keep exposed surfaces free from scratches and dents. Reinforce doors to prevent warp or twist.
- F. Isolate aluminum from dissimilar metals and from contact with building materials as required to prevent electrolysis and corrosion.
- G. Hot-dip galvanized steel, except stainless steel, anchors and fastening devices.
- H. Shop assemble accessories and package with all components, anchors, fittings, fasteners and keys.
- I. Key items alike.
- J. Provide templates and rough-in measurements as required.
- K. Round and deburr edges of sheets to remove sharp edges.

2.5 PAPER TOWEL DISPENSERS

- A. Surface mounted type with sloping top.
- B. Dispensing capacity for 300 sheets of any type of paper toweling.
- C. Fabricate of stainless steel.
- D. Provide door with continuous hinge at bottom, and either spring tension cam lock or tumbler lock, keyed alike, at top and a refill sight slot in front.

2.6 WASTE RECEPTACLES

- A. Semi-recessed type, without doors. Fed. Spec WW-P-541, Type II.
- B. Fabricate of stainless steel.
- C. Form face frame from one piece.
- D. Provide removable waste receptacle of approximately (12 gallon) capacity, fabricated of stainless steel.
- E. Waste receptacle key locked in place.

2.7 TOILET TISSUE DISPENSERS

- A. Double roll surface mounted type.
- B. Mount on continuous backplate.
- C. Removable spindle ABS plastic or chrome plated plastic.

D. Wood rollers are not acceptable.

2.8 GRAB BARS

A. Fed. Spec WW-P-541/8B, Type IV, bars, surface mounted, Class 2, grab bars and ASTM F446.

B. Fabricate of stainless steel:

1. Stainless steel: Grab bars, flanges, mounting plates, supports, screws, bolts, and exposed nuts and washers.

C. Concealed mount, except grab bars mounted at floor, swing up and on partitions.

D. Bars:

1. Fabricate from 38 mm (1-1/2 inch) outside diameter tubing.
 - a. Stainless steel, minimum 1.2 mm (0.0478 inch) thick.
2. Fabricate in one continuous piece with ends turned toward walls, except swing up and where grab bars are shown continuous around three sides of showers, bars may be fabricated in two sections, with concealed slip joint between.
3. Continuous weld intermediate support to the grab bar.
4. Swing up bars manually operated. Designed to prevent bar from falling when in raised position.

E. Flange for Concealed Mounting:

1. Minimum of 2.65 mm (0.1046 inch) thick, approximately 75 mm (3 inch) diameter by 13 mm (1/2 inch) deep, with provisions for not less than three set screws for securing flange to back plate.
2. Insert grab bar through center of the flange and continuously weld perimeter of grab bar flush to back side of flange.

F. Back Plates:

1. Minimum 2.65 mm (0.1046 inch) thick metal.
2. Fabricate in one piece, approximately 6 mm (1/4 inch) deep, with diameter sized to fit flange. Provide slotted holes to accommodate anchor bolts.
3. Furnish spreaders, through bolt fasteners, and cap nuts, where grab bars are mounted on partitions.

2.9 SHOWER CURTAIN RODS

A. Stainless steel tubing, ASTM A569, minimum 1.27 mm (0.050 inch) wall thickness, 32 mm (1 1/4 inch) outside diameter.

- B. Flanges, stainless steel rings, 66 mm (2 5/8 inch) minimum outside diameter, with 2 holes opposite each other for 6 mm (1/4 inch) stainless steel fastening bolts. Provide a set screw within the curvature of each flange for securing the rod.

2.10 CLOTHES HOOKS-ROBE OR COAT

- A. Fabricate hook units either of chromium plated brass with a satin finish, or stainless steel, using 6 mm (1/4 inch) minimum thick stock, with edges and corners rounded smooth to the thickness of the metal, or 3 mm (1/8 inch) minimum radius.
- B. Fabricate each unit as a double hook on a single shaft, integral with or permanently fastened to the wall flange, provided with concealed fastenings.

2.11 TOWEL BARS

- A. Fed. Spec. WW-P-541/8B, Type IV, Bar, Surface mounted; Class 1, towel.
- B. Either stainless steel, or chromium plated copper alloy.
- C. Bar Length: 450 and 600 mm (18 and 24 inches) as shown.
- D. Finish of brackets or supports same as bar.

2.12 METAL FRAMED MIRRORS

- A. Fed. Spec. A-A-3002 metal frame; stainless steel, type 302 or 304.
- B. Mirror Glass:
 - 1. Minimum 6 mm (1/4 inch) thick.
 - 2. Set mirror in a protective vinyl glazing tape.
 - 3. Use tempered glass for mirrors in Mental Health and Behavioral Nursing units.
- C. Frames:
 - 1. Channel or angle shaped section with face of frame not less than 9 mm (3/8 inch) wide. Fabricate with square corners.
 - 2. Use either 0.9 mm (0.0359 inch) thick stainless steel, chrome finished steel, or extruded aluminum, with clear anodized finish 0.4 mils thick.
 - 3. Filler:
 - a. Where mirrors are mounted on walls having ceramic tile wainscots not flush with wall above, provide fillers at void between back of mirror and wall surface.
 - b. Fabricate fillers from same material and finish as the mirror frame, contoured to conceal the void behind the mirror at sides and top.
 - 4. Attached Shelf for Mirrors:
 - a. Fabricate shelf of the same material and finish as the mirror frame.

- b. Make shelf approximately 125 mm (five inches) in depth, and extend full width of the mirror.
- c. Close the ends and the front edge of the shelf to the same thickness as the mirror frame width.
- d. Form shelf for aluminum framed mirror as an integral part of the bottom frame member. Form stainless steel shelf with concealed brackets to attach to mirror frame.

D. Back Plate:

- 1. Fabricate backplate for concealed wall hanging of either zinc-coated, or cadmium plated 0.9 mm (0.036 inch) thick sheet steel, die cut to fit face of mirror frame, and furnish with theft resistant concealed wall fastenings.
- 2. Use set screw type theft resistant concealed fastening system for mounting mirrors.

E. Mounting Bracket:

- 1. Designed to support mirror tight to wall.
- 2. Designed to retain mirror with concealed set screw fastenings.

2.13 MOP RACKS

A. Minimum 1.0M (40 inches) long with five holders.

B. Clamps:

- 1. Minimum of 1.3 mm (0.050-inch) thick stainless steel bracket retaining channel with a hard rubber serrated cam; pivot mounted to channel.
- 2. Clamps to hold handles from 13 mm (1/2-inch) minimum to 32 mm (1-1/4 inch) maximum diameter.

C. Support:

- 1. Minimum of 1 mm (0.0375 inch) thick stainless steel hat shape channel to hold clamps away from wall as shown.
- 2. Drill wall flange for 3 mm (1/8 inch) fasteners above and below clamp locations.

D. Secure clamps to support with oval head machine screws or rivets into continuous reinforcing back of clamps.

E. Finish on stainless Steel: AMP 503-No. 4.

PART 3 - EXECUTION

3.1 PREPARATION

- A. Before starting work notify Resident Engineer in writing of any conflicts detrimental to installation or operation of units.
- B. Verify with the Resident Engineer the exact location of accessories.

3.2 INSTALLATION

- A. Set work accurately, in alignment and where shown. Items shall be plumb, level, free of rack and twist, and set parallel or perpendicular as required to line and plane of surface.
- B. Toggle bolt to steel anchorage plates in frame partitions or hollow masonry.
- C. Install accessories in accordance with the manufacturer's printed instructions and ASTM F446.
- D. Install accessories plumb and level and securely anchor to substrate.
- E. Install accessories in a manner that will permit the accessory to function as designed and allow for servicing as required without hampering or hindering the performance of other devices.
- F. Position and install dispensers, and other devices in countertops, clear of drawers, permitting ample clearance below countertop between devices, and ready access for maintenance as needed.
- G. Align mirrors, dispensers and other accessories even and level, when installed in battery.
- H. Install accessories to prevent striking by other moving, items or interference with accessibility.
- I. Install wall mirrors in Mental Health and Behavioral Units with tamper resistant screws that are flush mounted so that they will not support a rope or material for hanging.

3.3 SCHEDULE OF ACCESSORIES**3.4 CLEANING**

After installation, clean as recommended by the manufacturer and protect from damage until completion of the project.

- - - E N D - - -

SECTION 10 44 13
FIRE EXTINGUISHER CABINETS

PART 1 - GENERAL

1.1 DESCRIPTION

This section covers recessed fire extinguisher cabinets.

1.2 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturer's Literature and Data: Fire extinguisher cabinet including installation instruction and rough opening required.

1.3 APPLICATION PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American Society of Testing and Materials (ASTM):
 - D4802-02.....Poly (Methyl Methacrylate) Acrylic Plastic Sheet

PART 2 - PRODUCTS

2.1 FIRE EXTINGUISHER CABINET AND FIRE EXTINGUISHER

Recessed type with flat trim with multi-purpose dry chemical type; UL rated 4-A:60-B:C, 10 LB normal capacity in enameled steel container.

2.2 FABRICATION

- A. Form body of cabinet from 0.9 mm (0.0359 inch) thick sheet steel.
- B. Fabricate door and trim from 1.2 mm (0.0478 inch) thick sheet steel with all face joints fully welded and ground smooth.
 - 1. Glaze doors with 6 mm (1/4 inch) thick ASTM D4802, clear acrylic sheet, Category B-1, Finish 1.
 - 2. Design doors to open 180 degrees.
 - 3. Provide continuous hinge, pull handle, and adjustable roller catch.

2.3 FINISH

- A. Finish interior of cabinet body with baked-on semigloss white enamel.
- B. Finish door, frame with manufacturer's standard baked-on prime coat suitable for field painting.

PART 3 - EXECUTION

- A. Install fire extinguisher cabinets in prepared openings and secure in accordance with manufacturer's instructions.

B. Install cabinet so that bottom of cabinet is 975 mm (39 inches) above finished floor.

- - - E N D - - -

**SECTION 10 53 00
ALUMINUM WALKWAY COVER**

PART 1 - GENERAL

1.1 DESCRIPTION

This section covers aluminum walkway cover.

1.2 RELATED WORK

A. Concrete Footings: Section 03 30 00, CAST-IN-PLACE CONCRETE.

1.3 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturer's Literature and Data: including installation instruction and required details.

1.4 APPLICATION PUBLICATIONS

- A. International Building Code 2009
- B. ASCE 7-05, Minimum Design Loads for Buildings and Other Structures
- C. Aluminum Design Manual 2005

1.5 SUBMITTALS

- A. Shop Drawings - Submit complete shop drawings including:
 - 1. Overall canopy layout dimensions
 - 2. Cut section details including elevation, bent layout dimensions, and connection details
 - 3. Flashing details pertaining to aluminum canopy
 - 4. Concrete footing and/or canopy anchorage details
- B. Product Data - Submit manufacturer's product information, specifications, and installation instructions for the aluminum canopy.
- C. Samples - Submit color selection samples of actual coated aluminum material or actual anodized aluminum material.
- D. Design calculations, for specified live loads including dead loads, prepared and sealed by a qualified engineer registered in the state where the project is located. Provide calculations for all members and connections to supporting concrete, steel or masonry structure.

1.6 DELIVERY

- A. Deliver materials to the site in original sealed packages or containers, clearly marked with the Manufacturer's name or brand, type and color.
- B. Materials from containers which have been distorted, damaged or opened prior to installation will be rejected.

1.7 STORAGE

- A. Store materials in weather tight and dry storage facility.
- B. Protect material from damage by handling and construction operations before during, and after installation.

PART 2 - PRODUCTS**2.1 GENERAL****A. Columns**

- 1. Columns are to be radius cornered aluminum tubular extrusion of size indicated on architect's drawings. Column size shall be 6 inches x 6 inches at 0.125 inches thick.
- 2. Provide clear acrylic protection or bituminous paint protection between the aluminum column and the concrete footer.

B. Beams

- 1. Beams are to be open topped aluminum tubular extrusion of size indicated on architect's drawings.
- 2. Size of beam used shall accommodate applied loadings without over-stress or over-deflection. Minimum beam size shall be 4 inches x 6 inches at 0.125 inches thick.

C. Decking

- 1. Decking shall be a rigid roll-locked design that is self flashing and utilizes interlocking sections.
- 2. Extruded decking is to be of size indicated on architect's drawings.
- 3. Where decking is run parallel to walkway, the ends of the pans shall be welded closed where decking does not terminate into a drain beam.

D. Integral Gutter

- 1. Gutter shall be integral to canopy construction and extend around entire perimeter of canopy.

E. Flashing

- 1. Flashing shall be made of aluminum sheet painted to match the color of the canopy. Minimum flashing thickness shall be 0.040 inches thick

2.2 FASTENERS

1. All fasteners shall be stainless steel with neoprene washers and rivets are 3/16 inches aluminum.

2.3 FINISHES

- A. Factory applied finishes from manufacturer's standard color charts.
 1. Color is to be as selected by architect.

PART 3 - EXECUTION**3.1 INSTALLATION REQUIREMENTS**

- A. The respective manufacturer's instructions for application and installation will be considered for use when approved by the Contracting Officer's Technical Representative (COTR).
- B. Aluminum protective cover shall be mechanically fastened using internally welded brackets and concealed stainless steel fasteners. Welded connections can be used if shipping allows.
- C. Canopy shall use perimeter extruded gutter and extruded decking running perpendicular to length of sidewalk. Beams are to be notched to receive the extruded gutter to allow decking to sit flush to the top of the beam. Extruded Decking shall be a roll-locked design where the extruded cap and pan shall interlock to make a rigid structure. Crimped decking is not allowed. Roll formed decking shall be allowed upon approval by the architect.
- D. Extruded decking running parallel to length of sidewalk will be allowed if canopy spans exceed limitations of perpendicular decking and perimeter gutter. If used, pans are to be welded at ends to prevent water leakage. Standard T-flashing shall be used where decking is separated at a drain beam.
- E. Canopies shall drain from the decking to the perimeter gutter, into the drain columns and discharge below grade into storm water collection system. For canopies where decking is run parallel to sidewalk, the canopies shall drain from the decking into the drain columns and discharge into storm water collection system.
- F. Deflector plates are to be installed at the bottom of the column (below grade) to discharge the water into storm water collection system boots. The deflector plates are to be caulked inside the column and fastened to the column using a single rivet. Provide all required materials and

attachment hardware to install connection boots from canopy columns to storm water collection system.

3.2 ERECTION

- A. Canopies are to be installed according to approved shop drawings and plans.
- B. The entire structure shall be installed straight, true, and plumb according to standard construction procedures.
- C. Canopies shall be installed with positive and negative slope of 1/8 inches per foot to allow water drainage from top of canopy to draining columns and eliminate ponding.
- D. Non-draining columns shall have weep holes installed at top of concrete to remove condensation from post. Minimum weep hole size shall be 1/4 inches in diameter.
- E. All joints, corners, and connections shall be tight and clean.
- F. All exposed fasteners are to be painted to match the canopy color.
- G. Decking is to be aligned and secured to aluminum frame structure

- - - E N D - - -

SECTION 10 53 10
ALUMINUM SUNSHADES WITH OVERHEAD SUPPORT ROD

PART 1 - GENERAL

1.1 DESCRIPTION

This section covers aluminum sunshades with overhead support rods.

1.2 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturer's Literature and Data: including installation instruction and required details.

1.3 APPLICATION PUBLICATIONS

- A. International Building Code 2009
- B. ASCE 7-05, Minimum Design Loads for Buildings and Other Structures
- C. Aluminum Design Manual 2005

1.4 SUBMITTALS

- A. Shop Drawings - Submit complete shop drawings including:
 - 1. Overall sunshade layout dimensions
 - 2. Cut section details including elevation, airfoil layout dimensions, and sunshade connection details
 - 3. Connection details of sunshade to wall.
- B. Product Data - Submit manufacturer's product information, specifications, and installation instructions for the aluminum sunshades.
- C. Samples - Submit color selection samples of actual coated aluminum material or actual anodized aluminum material.
- D. Design calculations, for specified live loads including dead loads, prepared and sealed by a qualified engineer registered in the state where the project is located. Provide calculations for all members and connections to supporting concrete, steel or masonry structure.

1.5 DELIVERY

- A. Deliver materials to the site in original sealed packages or containers, clearly marked with the Manufacturer's name or brand, type and color.
- B. Materials from containers which have been distorted, damaged or opened prior to installation will be rejected.

1.6 STORAGE

- A. Store materials in weather tight and dry storage facility.

- B. Protect material from damage by handling and construction operations before during, and after installation.

PART 2 - PRODUCTS

2.1 GENERAL

F. Outriggers

- 3. Outriggers are to be 8 inches in height and have a projection of 48 inches or as indicated on architect's drawings. Minimum outrigger thickness shall be 1/4 inch.
- 4. Outriggers are to have holes pre-drilled to receive air foils/louvers per layout shown on drawings.
- 5. Outriggers shall have 4 pre-drilled holes to allow connection to the extruded outrigger bracket.
- 6. Outriggers are to have a square end for flat fascia.

G. Air Foils

- 3. Air foils are to be 6 inches or 8 inches in height and are to have a minimum thickness of 0.100 inch.

H. Outrigger Bracket

- 2. Outrigger brackets are to be 6 inches or 8 inches in height and have a minimum thickness of 0.50 inch.

I. Fascia

- 1. Fascia shall be square faced.
- 2. Square fascia shall be 8 inches in height and shall have a minimum thickness of 0.125 inch.

J. Support Rods

- 2. Support rods shall be fabricated from 1 inch diameter galvanized steel round rod.
- 3. Round rods shall have an eye bolt welded to each end to emulate a turnbuckle Design.

2.2 FASTENERS

- 2. All fasteners shall be 300 series stainless steel.

2.3 FINISHES

- B. Factory applied Kynar finish.
 - 2. Kynar finish is to comply with AAMA 2605.
 - 3. Color is to be as selected by architect from manufacturer's standard color chart.

PART 3 - EXECUTION**3.1 INSTALLATION REQUIREMENTS**

- G. The respective manufacturer's instructions for application and installation will be considered for use when approved by the Contracting Officer's Technical Representative (COTR).
- H. Aluminum sunshades shall consist of outrigger brackets, outriggers, air foils/louvers, overhead support rods, wall brackets, and fascias.
- I. The outriggers shall connect to the outrigger bracket using stainless steel nuts, bolts, and washers. Each outrigger bracket shall support two outriggers, unless it is the final outrigger at each end of the sunshade.
- J. The overhead support rod shall connect to two outriggers at each outrigger bracket location. The support rod shall be 1 inch diameter galvanized steel support rod. The support rod shall have an eye bolt welded to the center of a 6 inches x 6 inches galvanized plate. The 1 inch diameter support rod shall be connected to the wall bracket and to the outriggers using a 7/8 inch galvanized bolt, nut, and washers.
- K. The air foils and fascia shall attach to the outriggers using counter-sunk stainless steel fasteners. The air foils and fascia shall be attached to each "pair" of outriggers and shall have a 1/2 inch break at each connection point due to the outrigger bracket thickness.
- L. The air foils are to be angled and spaced to provide adequate shading of the area being covered.

3.2 ERECTION

- H. Sunshades are to be installed according to approved shop drawings and plans.
- I. The entire structure shall be installed straight, true, level, and plumb according to standard construction procedures.
- J. All joints, corners, and connections shall be tight and clean.

- K. All exposed fasteners are to be painted to match the canopy color.
- L. All air foils and fascias are to be mechanically fastened to the outriggers.

3.3 CLEANING

- A. All sunshade surfaces exposed are to be cleaned after installation is complete.
- B. Surplus materials and debris shall be removed from the jobsite after installation is complete.

3.4 PROTECTION

- A. General Contractor shall ensure protection of installed aluminum sunshades from other construction so that sunshades are without damage at time of substantial completion of project.

- - - E N D - - -

**SECTION 11 45 00
RESIDENTIAL APPLIANCES**

PART 1 - GENERAL

1.1 DESCRIPTION

A. This section specifies Residential Appliances as follows:

1. 30" self clean smooth top electric range with storage drawer.
2. 21.0 cu.ft. top freezer refrigerator
3. 4.1 cu.ft. front load washer.
4. 7.0 cu.ft front load electric dryer.

1.2 RELATED WORK

- A. Plumbing Connections: Section 22 05 19, METERS AND GAGES FOR PLUMBING PIPING, Section 22 05 23, GENERAL-DUTY VALVES FOR PLUMBING PIPING , Section 22 11 00, FACILITY WATER DISTRIBUTION, Section 22 13 00, FACILITY SANITARY SEWERAGE.
- B. Electrical Connections: Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

1.3 QUALITY CONTROL

A. Installer Qualifications: Experienced in appliance installation

1.4 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturer's Literature and Data:
1. Include manufacturer's address and telephone number.
 2. Include catalog or model numbers and illustrations and descriptions of cooking equipment.
- C. Operating Instructions: In accordance with requirements in Section 01 00 00, GENERAL REQUIREMENTS.

1.5 WARRANTY

Warrant equipment to be free from defects in materials and workmanship in accordance with requirements of "Warranty of Construction", FAR clause 52.246-21.

PART 2 - PRODUCTS - NOT USED

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Install residential appliances level and plumb; arranged for safe and convenient operation; with access clearances required for maintenance and cleaning; and according to manufacturer's written instructions.

3.2 CLEAN-UP

- A. At completion of the installation, clean and adjust appliances as required to produce ready-for-use condition.

3.3 INSTRUCTIONS

Instruct personnel and transmit operating instructions in accordance with requirements in Section 01 00 00, GENERAL REQUIREMENTS.

- - - E N D - - -

SECTION 12 24 00
WINDOW SHADES

PART 1 - GENERAL

1.1 DESCRIPTION

Cloth shades are specified in this section. Window shades shall be furnished complete, including brackets, fittings and hardware.

1.2 RELATED WORK

A. Color of shade cloth: Section 09 06 00, SCHEDULE FOR FINISHES.

1.3 QUALITY CONTROL

Manufacturer's Qualification: Cloth shade manufacturer shall provide evidence that the manufacture of blinds are a major product, and that the blinds have performed satisfactorily on similar installations.

1.4 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Samples:
 - 1. Shade cloth, each type, 600 mm (24 inch) square, including cord and ring, showing color, finish and texture.
- C. Manufacturer's literature and data; showing details of construction and hardware for:
 - Cloth and window shades

1.5 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced to in the text by the basic designation only.
- B. Federal Specifications (Fed. Spec.):
 - AA-V-00200B.....Venetian Blinds, Shade, Roller, Window, Roller, Slat, Cord, and Accessories
- C. American Society for Testing and Materials (ASTM):
 - A167-99 (R2004).....Stainless and heat-Resisting Chromium-Nickel Steel Plate, Sheet and Strip
 - B221/B221M-07.....Aluminum-Alloy Extruded Bars, Rods, Wire, Shapes, and Tubes
 - D635-06.....Rate of Burning and/or Extent and Time of Burning of Self-Supporting Plastics in a Horizontal Position

D648-07.....Deflection Temperature of Plastics Under
Flexural Load in the Edgewise Position

D1784 Rev.A-06.....Rigid Poly (Vinyl Chloride) (PVC) Compounds and
Chlorinated Poly (Vinyl Chloride) (CPVC)
Compounds

PART 2 - PRODUCTS

2.1 MATERIALS

- A. Shade Cloth: opaque.
- B. Staples (For Cloth Window Shades): Nonferrous metal or zinc-coated steel.
- C. Stainless Steel: ASTM A167
- D. Extruded Aluminum: ASTM B221/B221M.

2.2 FASTENINGS

Zinc-coated or cadmium plated metal, aluminum or stainless steel fastenings of proper length and type. Except as otherwise specified, fastenings for use with various structural materials shall be as follows:

Type of Fastening	Structural Material
Wood screw	Wood
Tap screw	Metal
Case-hardened, self-tapping screw	Sheet Metal
Screw or bolt in expansion shields	Solid masonry
Toggle bolts	Hollow blocks, wallboard and plaster

2.3 FABRICATION

- A. Fabricate cloth shades to fit measurements of finished openings obtained at site.
- B. Cloth Window Shades: Rolling type, constructed of shade cloth mounted on rollers. Shade cloth shall have plain sides, and with hem at bottom to accommodate wood slat. Separate shades are required for each individual sash within opening. Length of shades shall exceed height of window approximately 300 mm (12 inches) measured from head to sill, in addition to material required to make-up hem:

1. Provide rollers with spindles, nylon bearings, tempered steel springs, and all other related accessories required for positive action. Provide rollers of diameter recommended by shade manufacturer. Staple shade cloth to wood rollers to prevent wrinkling or folding, and on line parallel to axis of rollers so that shade will hang plumb. Space staples not over 90 mm (3-1/2 inches) on centers. Use of tacks is prohibited.
2. Wood slats shall be smooth, tapered, and inserted in the bottom hem of the shade cloth.
3. Eyelets shall have clear openings large enough to accommodate cords. Edges of eyelets shall not cut into cloth when set.
4. Cords shall be of sufficient length to permit shades to be drawn to bottom of opening with ends looped and held with cord rings. Attach cords to hems through metal eyelets in center of slats in bottom hems.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Cloth Window Shades: Mount window shades on end of face brackets, set on metal gussets, or casing of windows as required. Provide extension face brackets where necessary at mullions. In existing buildings, provide brackets similar to those on existing windows.
1. Locate rollers in level position as high as practicable at heads of windows to prevent infiltration of light over rollers.
 2. Where extension brackets are necessary, on mullions or elsewhere, for alignment of shades, provide metal lugs, and rigidly anchor lugs and brackets.
 3. Place brackets and rollers so that shades will not interfere with window and screen hardware.
 4. Mount shades at wire mesh window guards on head rails of hinged frame.
 5. Mount shades at detention, or protection screens on head rail (room side) of hinged frame, with face brackets located approximately 38 mm (1-1/2 inches) from outside edges.
 6. Shade installation methods not specifically described, are subject to approval of Contracting Officer's Technical Representative (COTR).

- - - E N D - - -

SECTION 12 32 00
MANUFACTURED WOOD CASEWORK

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This section as detailed on the drawings, including related components and accessories required to form integral units. Wood casework items shown on the drawings, but not specified below shall be included as part of the work under this section, and applicable portions of the specification shall apply to these items. Each like item of casework shall be of the same design and by one manufacturer.
- B. Where shown, provide wood veneer casework items as follows:
 - 1. Wall cabinets, base cabinets at Country Kitchen A110, Activity A109 and Dining A111.

1.2 RELATED WORK

- A. Custom Casework: Section 06 20 00, FINISH CARPENTRY.
- B. Color and Finish of Plastic Laminate: Section 09 06 00, SCHEDULE FOR FINISHES.
- C. Lavatories and Plumbing in Casework: Section 22 40 00, PLUMBING FIXTURES.

1.3 MANUFACTURER'S QUALIFICATIONS

The fabrication of casework shall be by a manufacturer who produces casework similar to the casework specified and shown.

1.4 SUBMITTALS

- A. Submit in accordance with Section `01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturer's Literature and Data:
 - Sinks, trim and fittings.
 - Locks for doors and drawers
 - Adhesive cements
- C. Samples:
 - Cabinet Wood Face Veneer or Hardwood Plywood in selected finish - Maple.
- D. Shop Drawings (1/2 full size):
 - 1. All casework, showing details of construction, including materials, hardware and accessories.

2. Cabinets and counters showing faucets in connection with sink bowls, and electrical fixtures and receptacles which are mounted on cabinets and counters.
3. Fastenings and method of installation.

1.5 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by basic designation only.
- B. American Society for Testing and Materials (ASTM):
A1008-07.....Steel, Sheet, Cold-Rolled, Carbon, Structural,
High Strength Low Alloy
- C. Composite Panel Association (CPA):
A208.1-99.....Particleboard
- D. U.S. Department of Commerce Product Standards (Prod. Std):
PS1-95.....Construction And Industrial Plywood
- E. Architectural Woodwork Institute (AWI):
Architectural Woodwork Quality Standards, Guide Specifications Quality
Certification Program - 1999
- F. American Society of Mechanical Engineers (ASME):
A112.18.1-05.....Plumbing Fixture Fittings
- G. National Electrical Manufacturers Association (NEMA):
LD3-05.....High Pressure Decorative Laminates
LD3.1-95.....Performance, Application Fabrication and
Installations of High-Pressure Decorative
Laminates
- H. Hardwood Plywood and Veneer Association
HP-1.....Hardwood and Decorative Plywood

PART 2 - PRODUCTS

2.1 PLYWOOD, HARDWOOD FACE VENEER

HPVA HP-1, Premium Grade Rotary cut Select Maple.

2.3 PLYWOOD, SOFTWOOD

Prod. Std. PS1, five ply construction from 13 mm to 28 mm (1/2 inch to 1-1/8 inch) thickness, and seven ply for 31 mm (1 1/4 inch) thickness.

2.4 PARTICLEBOARD

CPA A208.1, Type 1, Grade 1-M-3.

2.5 VINYL BASE**2.6 PLUMBING FIXTURES**

ASME A112.18.1, except die-cast zinc-alloy material is not acceptable.

2.7 SOLID WOOD

Wood required for edge banding, moldings shall be of same species as wood face veneer.

2.8 STAINLESS STEEL

ASTM A167, with No. 4 finish.

2.9 HARDWARE

- A. Where pin tumbler locks are specified, disc tumbler lock "Duo A", with brass working parts and case, as manufactured by the Illinois Lock Company will be an acceptable substitute. Locks for each type casework, shall be keyed differently and shall be master-keyed for each type service, such as Nurses, Psychiatric, and Administration. Provide two keys for each lock. Exposed hardware, except as otherwise specified, shall be satin finished chromium plated brass or nickel plated brass.
- B. Marking of Locks and Keys:
 - 1. The name of the manufacturer, or trademark by which manufacturer can readily be identified, legibly marked on each lock.
 - 2. The key change number marked on the exposed face of lock, and also stamped on each key.
 - 3. Key change numbers shall provide sufficient information for replacement of the key by the manufacturer.
- C. Hinged Doors:
 - 1. Doors 900 mm (36 inches) and more in height shall have three hinges and doors less than 900 mm (36 inches) in height shall have two hinges. Each door shall close against two rubber bumpers.
 - 2. Hinges: Fabricate hinges with minimum 2 mm (0.072 inch) thick chromium plated steel leaves, and with minimum 3.5 mm (0.139 inch) diameter stainless steel pin. Hinges shall be five knuckle design with 63 mm (2-1/2 inch) high leaves and hospital type tips.
 - 3. Fasteners: Provide full thread wood screws to fasten hinge leaves to door and cabinet frame. Finish screws to match finish of hinges.
- D. Door Catches:
 - 1. Friction or Magnetic type, fabricated with metal housing.
 - 2. Provide one catch for cabinet doors 1200 mm (48 inches) high and under, and two for doors over 1200 mm (48 inches) high.
- E. Locks:

1. Cylinder type pin tumbler.
 2. Equip doors and drawers where shown with locks.
- F. Drawer and Door Pulls:
- Style and finish to be determined.
- G. Drawer Slides:
1. Full extension steel slides with nylon ball-bearing rollers.
 2. Slides shall have positive stop.
 3. Equip drawers with rubber bumpers.
- H. Shelf Standards (Except For Fixed Shelves):
- Bright zinc-plated steel for recessed mounting with screws, 16 mm (5/8 inch) wide by 5 mm (3/16 inch) high providing 13 mm (1/2 inch) adjustment, complete with shelf supports.

2.10 FABRICATION

- A. Casework style and finish to be determined. Premium grade construction and of component thickness in conformance with AWI Quality Standards.
- B. Electrical fixtures, receptacles, wiring and junction boxes required for fixtures and receptacles:
1. Field installed in casework.
 2. For electrical lighting fixtures, see drawings.
 3. For electric receptacles and lighting fixtures installed below or adjacent to wall cabinets or above counter tops, see electrical sections or specifications.
 4. Install wiring in built-in raceways and terminate at junction box mounted on rear of cabinet and counter.
 5. For final hook-up at junction box see electrical sections of specifications.
- C. Base:
1. Provide base to match Manufacturer casework, flush joints; set with adhesive.
 2. Remove adhesive from exposed surfaces.
 3. Install base at floor line after casework has been accurately leveled.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Set casework in place; level, plumb and accurately scribe and secure to walls, and/or floors.
- B. The installation shall be complete including all trim and hardware. Leave the casework clean and free from defects.

3.2 FASTENINGS

- A. Fastenings for securing casework to adjoining construction shall be as detailed on the drawings or approved shop drawings.
- B. See Section 05 50 00, METAL FABRICATIONS for reinforcement of walls and partitions for casework anchorage.

- - - E N D - - -

**SECTION 12 36 00
COUNTERTOPS**

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This section specifies casework countertops with integral accessories.
- B. Integral accessories include:
 - 1. Sinks.

1.2 RELATED WORK

- A. Color and patterns of plastic laminate, quartz and solid surface:
SECTION 09 06 00, SCHEDULE FOR FINISHES.
- B. DIVISION 22, PLUMBING.
- C. DIVISION 26, ELECTRICAL.
- D. Equipment Reference Manual for SECTION 12 36 00, COUNTERTOPS.

1.3 SUBMITTALS

- A. Submit in accordance with SECTION 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Shop Drawings
 - 1. Show dimensions of section and method of assembly.
 - 2. Show details of construction at 1/2 scale.
- C. Samples:
 - 1. 150 mm (6 inch) square samples each top.
 - 2. Front edge, back splash, end splash and core with surface material and booking.

1.4 APPLICABLE PUBLICATIONS

- A. Publications listed below form a part of this specification to the extent referenced. Publications are referenced in the text by the basic designation only.
- B. American Hardboard Association (AHA):
A135.4-95.....Basic Hardboard
- C. `Composite Panel Association (CPA):
A208.1-09.....Particleboard
- D. American Society of Mechanical Engineers (ASME):
A112.18.1-05.....Plumbing Supply Fittings
A112.1.2-04.....Air Gaps in Plumbing System
A112.19.3-08 (R2004).....Stainless Steel Plumbing Fixtures (Designed for Residential Use)
- E. American Society for Testing and Materials (ASTM):

- D256-06.....Pendulum Impact Resistance of Plastic
- D570-98 (R2005).....Water Absorption of Plastics
- D638-08.....Tensile Properties of Plastics
- D785-08.....Rockwell Hardness of Plastics and Electrical
Insulating Materials
- D790-07.....Flexural Properties of Unreinforced and
Reinforced Plastics and Electrical Insulating
Materials
- D4690-99 (2005).....Urea-Formaldehyde Resin Adhesives
- G21-96 (R2002).....Determining Resistance of Synthetic Polymeric
Materials to Fungi
- F. Federal Specifications (FS):
 - A-A-1936.....Adhesive, Contact, Neoprene Rubber
- G. U.S. Department of Commerce, Product Standards (PS):
 - PS 1-95.....Construction and Industrial Plywood
- H. National Electrical Manufacturers Association (NEMA):
 - LD 3-05.....High Pressure Decorative Laminates
 - LD 3.1-95.....Performance, Application, Fabrication, and
Installation of High Pressure Decorative
Laminates

PART 2 - PRODUCTS

2.1 MATERIALS

- A. Plastic Laminate: NEMA LD 3.
 - 1. Concealed backing sheet Type BKL.
 - 2. Decorative surfaces:
 - a. Flat components: Type GP-HGL.
- B. Molded Resin (solid surface):
 - 1. Non-glare resin or compounded and cured.
 - 2. Material of uniform mixture throughout.
 - 3. Provide Class A (Class I) surface burning characteristics as
determined by testing identical products per UL 723 (ASTM E84):
 - a. Flame Spread Index: 25 or less.
 - b. Smoke Developed Index: 450 or less.
- C. Homogeneous quartz surfaces material.
 - 1. Thickness:
 - 2.3 cm (1 1/8")
 - 2. Edge Treatment:
 - Half Bullnose.

3. Seam Width:
<1/8" unless otherwise specified.
4. Sink Mounting:
Undermount.
5. Backsplash:
Applied.
6. Endsplash:
Applied.
7. Joint Adhesive:
Approved adhesive to create color-matched seam.
8. Sink/bowl mounting hardware:
Manufacturer's approved bowl clips, brass inserts and fasteners for attachment of undermount sinks/bowls.
- D. Performance characteristics: Quartz physical properties:
- | Property | Typical Result | Test |
|----------------------------|--|-----------------------------------|
| Flexural Strength | >5,300 psi | ASTM D 790 |
| Flexural Modulus | 5.3-5.7E ⁶ psi | ASTM D 790 |
| Flexural Elongation | >0.1% | ASTM D 790 |
| Compression Strength (Dry) | | ~27,000 psi ASTM C 170 |
| Compression Strength (Wet) | | ~24,000 psi ASTM C 170 |
| Hardness | 7 | Mohs' Hardness Scale |
| Thermal Expansion | 1.45 x 10 ⁻⁵ in./in./°C | ASTM D 696 |
| Gloss (60° Gardner) | 45-50 | ANSI Z 124 |
| Density | ~24,00 kg/m ³ | |
| Water Absorption | 0.12% | ASTM C 373 |
| Long- and Short-Term | <0.04% | ASTM D 570 |
| Moisture Expansion | <0.01% on average | ASTM C 370 |
| Flammability | For all colors tested
(Class I and Class A) | ASTM E 84, UL 723
and NFPA 255 |
| Flame Spread Index | FSI <10 for 3 cm and
<15 for 2 cm | |
| Smoke Developed Index | SDI <50 for 3 cm and
<100 for 2 cm | |
| Nominal Thickness | 3 cm | |
| Nominal Weight | 15 lb./ft. ² (3 cm) | |
- E. Stainless Steel: ASTM A167, Type 304.
- F. Sheet Steel: ASTM A1008, cold rolled, Class 1 finish, stretcher leveled.

- G. Particleboard: CPA A208.1, Grade 2-M-2.
- H. Plywood: PS 1, Exterior type, veneer grade AC not less than five ply construction.
- I. Hardboard: ANSI/AHA A135.4, Type I, tempered, fire retardant treated, smooth surface one side.
- J. Adhesive
 - 1. For Field Joints:
 - a. Per Manufacturer's recommendations.
- K. Fasteners:
 - 1. Metals used for welding same metal as materials joined.
 - 2. Use studs, bolts, spaces, threaded rods with nuts or screws suitable for materials being joined with metal splice plates, channels or other supporting shape.
 - 3. Cast into sheet form and bowl form.
 - 4. Color throughout with subtle veining through thickness.
 - 5. Joint adhesive and sealer: Manufacturers silicone adhesive and sealant for joining methyl methacrylic polymer sheet.
 - 6. Bio-based products will be preferred.
- L. Laminar Flow Control Device
 - 1. Smooth bright stainless steel or satin finish, chrome plated metal laminar flow device shall provide non-aeration, clear, coherent laminar flow that will not splash in basin. Device shall also have a flow control restrictor and have vandal resistant housing.
 - 2. Flow Control Restrictor:
 - a. Capable of restricting flow of 7.5 to 8.5 Lpm (2.0 to 2.2 gpm) for sinks provided in paragraph 2.2D.
 - b. Compensates for pressure fluctuation maintaining flow rate specified above within 10 percent between 175 and 550 kPa (25 and 80 psi).
 - c. Operates by expansion and contraction, eliminates mineral/sediment building up with self clearing action, and is capable of easy manual cleaning.

2.2 SINKS

- A. Molded Resin (solid surface):
 - 1. Cast or molded integral sink in one piece with 25 mm (one inch) minimum radius.
 - 2. Minimum thickness of sides and ends 13 mm (1/2 inch), bottom 16 mm (5/8 inch).

- 3. Molded resin outlet for drain and standpipe overflow.
- 4. Provide clamping collar permitting connection to 38 mm (1-1/2 inch) or 50 mm (2 inch) waste outlet and trap, making sealed but not permanent connection.
- B. Stainless Steel:
 - 1. ANSI/ASME A112.19.3, Type 304.
 - 3. Flat rim for welded into stainless steel tops.
 - 4. Ledge back or ledge sides with holes to receive required fixtures when mounted on countertop.
 - 5. Apply fire resistant sound deadening material to underside.
- C. Oval shaped bowl.

2.3 COUNTERTOPS

- A. Thickness:
 - 1/2 inch.
- B. Edge Treatment:
 - Half Bullnose.
- C. Integral Sink - Contrasting Color:
 - 1. Mounting:
 - a. Seamed undermount.
- D. Backsplash:
 - Applied.
- E. Sidesplash:
 - Applied.
- F. Joint Adhesive:
 - Manufacturer's standard one- or two-part adhesive kit to create inconspicuous nonpourous joints.
- G. Sealant:
 - Manufacturer's standard mildew-resistant, FDA-compliant, NSF 51-compliant (food zone - any type), UL-listed silicone sealant in colors matching components.
- H. Sink/lavatory mounting hardware:
 - Manufacturer's standard bowl clips, panel inserts and fasteners for attachment of undermount sinks/lavatories.
- I. Performance characteristics:

Property	Typical Result	Test
Tensile Strength	>6,000 psi	ASTM D 638
Tensile Modulus	1.5×10^{-6} psi	ASTM D 638
Tensile Elongation	0.4% min.	ASTM D 638
Flexural Strength	10,000 psi	ASTM D 790
Flexural Modulus	1.2×10^{-6} psi	ASTM D 790
Hardness	>85	Rockwell "M" Scale
		ASTM D 785
	56	Barcol Impressor
		ASTM D 2583
Thermal Expansion	3.02×10^{-5} in./in./°C (1.80×10^{-5} in./in./°F)	ASTM D 696
Gloss (60° Gardner)	5-75 (matte - highly Polished)	ANSI Z 124
Light Resistance	(Xenon Arc) No effect	NEMA LD 3-2000 Method 3.3
Flammability	All colors (Class I and Class A)	ASTM E 84, NFPA 255 and UL 723
Flame Spread Index	<25	
Smoke Developed Index	<25	

J. Molded Resin/Quartz Tops:

1. Tops with drip groove cut on underside of overhanging edge.
2. Joints: Epoxy Type.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Before installing countertops verify that wall surfaces have been finished as specified and that mechanical and electrical service locations are as required.
- B. Secure countertops to supporting rails of cabinets with metal fastening devices, or screws through pierced slots in rails.
 1. Where type, size or spacing of fastenings is not shown or specified, submit shop drawings showing proposed fastenings and method of installation.
 2. Use round head bolts or screws.
 3. Use epoxy or silicone to fasten the epoxy resin countertops to the cabinets.

4. Use wood or sheet metal screws for wood or plastic laminate tops; minimum penetration into top 16 mm (5/8 inch), screw size No 8, or 10.
5. Install molded resin sinks with epoxy compound to form watertight seal with underside of molded resin top.
 - a. Install sink with not less than two channel supports with threaded rods and nuts at each end, expansion bolted to molded resin top.
 - b. Design support for a twice the full sink weight.
 - c. Install with overflow standpipes.

3.2 PROTECTION AND CLEANING

- A. Tightly cover and protect against dirt, water, and chemical or mechanical injury.
- B. Clean at completion of work.

- - - E N D - - -

**SECTION 14 24 00
HYDRAULIC ELEVATORS**

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This section specifies the, engineering, furnishing and installation of the complete electro-hydraulic elevator system as described herein and shown on the drawings.
- B. Passenger elevator shall be telescopic roped holeless oil hydraulic type with microprocessor based control, single car selective collective automatic two stop collective automatic operation with car leveling device, signal system, power-operated two-speed side opening car and hoistway doors. Elevators shall have Class "A" loading.

1.2 QUALITY CONTROL

- A. Qualifications:
 - 1. Approval by the Contracting Officer is required of products or services of proposed manufacturer, suppliers, and installers and will be contingent upon submission by Contractor of a certificate stating the following:
 - a. Manufacturer is currently and regularly engaged in manufacturing of elevator equipment as one of his principal products.
 - b. Installer has technical qualifications of at least three years of successful experience, trained supervisory and installation personnel, and facilities to install elevator equipment specified herein.
 - c. Contractor shall submit a list of two or more prior hospital installations where all the elevator equipment the contractor proposes to furnish on this project has performed satisfactorily together under conditions of normal use. The list shall include projects that have been in operation for a period of not less than two years preceding the date of these specifications; include the name and addresses of the Medical Center and the Medical Center Administrators.
 - 2. All telescopic holeless hydraulic elevators shall be the product of the same manufacturer.
 - 3. Approval of manufacturer's equipment will be contingent upon his having a permanent and satisfactory maintenance service branch which shall render services within two hours of receipt of notification.

Manufacturer shall submit the names and address of his authorized branch or service department which will render service to this installation, together with certification that the quantity and quality of replacement parts stock on hand is sufficient to warranty continued operation of the elevator installation.

4. Approval will not be given to any Elevator Contractor and/or manufacturer who has established on prior projects, either Government, municipal, or commercial, a record for unsatisfactory elevator installations, or has repeatedly failed to complete contracts awarded to him within the contract time, or has not the requisite record of satisfactorily performing elevator installations of similar type and magnitude.

1.3 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only:

- B. Federal Specifications (Fed. Spec.):

J-C-30B(1).....Cable and Wire, Electrical (Power, Fixed Installation)

J-C-580B(1).....Cord, Electrical and Wire, Electrical (0 to 600-Volt Service)

W-C-596/12F.....Connector, Receptacle, Electrical, General Purpose, Duplex, Hospital Grade Grounding, 2 Pole, 3 Wire, 15 Amperes, 125 Volts, 50/60 Hertz

W-F-406D.....Fittings for Cable, Power, Electrical and Conduit, Metal Flexible

W-F-408E.....Fittings for Conduit, Metal, Rigid (Thick-Wall and Thin-Wall (EMT) Type)

W-S-610E.....Splice Connectors

FF-S-325.....Shield, Expansion; Nail Expansion; and Nail, Drive

QQ-S-766D.....Steel, Stainless and Heat Resisting, Alloys, Plate, Sheet and Strip

L-P-508H.....Plastic Sheet, Laminated, Decorative and Non-Decorative (Style "D" Type I Class 25 Plastic Laminate)

TT-E-489.....Enamel, Alkyd, Gloss, Low Voc Content

- WW-C-566C.....Conduit, Metal, Flexible
- C. American Society for Testing and Materials (ASTM):
- A1008/A1008M-02.....Steel, Sheet, Cold Rolled, Carbon, Structural,
High-Strength Low-Alloy and High Strength Low-
Alloy with Improved Formation
- C612-00a.....Mineral Fiber Block and Board Thermal
Insulation
- E1042-92(1997)e1.....Acoustically Absorptive Materials Applied by
Trowel or Spray
- D. Manufacturer's Standardization Society of the Valve and Fittings
Industry (MSS):
- SP-58-1993.....Pipe Hangers and Supports
- F. American Society of Mechanical Engineers (ASME):
- A17.1-2000.....Safety Code for Elevators and Escalators
- A17.2-2001.....Inspectors Manual for Elevators and Escalators
- G. National Fire Protection Association (NFPA):
- 70-2002 or current code. National Electric Code
- 252-2003.....Fire Test of Door Assemblies
- H. Society of Automotive Engineers, Inc. (SAE)
- J517-91.....Hydraulic Hose, Standard; April 1991
- I. Gages:
- For Sheet and Plate: U.S. Standard (USS)
- For Wires: American Wire Gauge (AWG)
- J. American Welding Society (AWS):
- D1.1-2002.....Structured Welding Code - Steel
- K. National Electrical Manufacturers' Association (NEMA):
- LD3-2000.....High-Pressure Decorative Laminates
- L. Underwriter's Laboratories (UL):
- 486A-97 Ninth Edition...Wire Connectors and Soldering Lugs for Use with
Copper Conductors
- 797-83.....High Safety Electrical Metallic Tubing
- M. Regulatory Standards:
- A Specification 16721 Fire Alarm - Local Building System
- VA Barrier Free Design Handbook (H-08-13)
- Uniform Federal Accessibility Standards - 1988
- Americans with Disabilities Act - 1991

1.4 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Complete scaled and dimensioned layout of each elevator installation in plan, elevation, and section.
- C. Complete layout showing location of storage tank; pump; controller; selectors and supervisory panels; outside diameter of cylinder; piping layout and working pressure; clearance of car at top and bottom of hoistway when car makes normal stops at terminals, and clearance of car at bottom of hoistway when buffers are fully compressed; car platform; size of car frame members; support assembly and weights of principal parts.
- D. Complete drawings of hoistway entrances and doors showing details of construction, and method of fastening to structural members of building.
- E. Drawing showing methods of fastening conduit or duct systems, fixture boxes, fascia plates, intermediate supports, rail brackets, and hoistway construction.
- F. Complete drawings of elevator car enclosure, showing dimensioned details of construction, location of car equipment, fastenings to platform, car lighting, ventilation, ceiling framing and top exit:
 - 1. Dimensioned drawings showing details of guide shoes.
- G. Dimensioned drawings showing details of all signal and car equipment and fixtures.
- H. Dimensioned drawings and description of power door operator and photo-electric devices.
- I. Dimensioned drawings and description of hoistway door hangers.
- J. Cuts of drawings of hydraulic fluid scavenger pump system.
- K. Complete dimensioned hydraulic fluid storage tank and jack unit.
- L. Samples (One each):
 - 1. Stainless steel plate, 75 mm by 125 mm (3-inches by 5-inches.)
 - 2. Baked enamel plate, 75 mm by 125 mm (3-inches by 5-inches.)
 - 3. Color vinyl floor tile, .31 mm (12-inch square.)
 - 4. Protection pads, 75 mm by 125 mm (3-inches by 5-inches.)
 - 5. No other samples of materials specified shall be submitted unless specifically requested after submission of manufacturer's name. In case such samples are furnished pursuant to request, adjustment in

contract price and time will be made as provided in Section 00 72 00, GENERAL CONDITIONS.

M. Materials Data: Submit the name of manufacturer and type or style designation of the following for approval:

1. Controllers.
2. Size of hydraulic power unit.
3. H.P. and R.P.M. of hydraulic power unit motor.
4. Electric control valves, including capacity range.
5. Electric power and power door operator.
6. Hoistway door interlocks and electric contacts.
7. Stroke, certified maximum and minimum loads and maximum striking speed of car buffers.
8. HP and CFM rating on cab ventilation unit.

1.5 WIRING DIAGRAMS

- A. Provide three (3) sets field wiring and straight line wiring diagrams showing all electrical circuits of all elevator equipment in the hoistway, as well as the machine room. One (1) set of diagrams shall be framed under plastic or on pivoted hardboards coated with an approved plastic sealer, and mounted in each elevator machine room as directed by COTR. In the event field modifications are found necessary during installation, diagrams shall be revised to include all corrections made prior to and during the final inspection.
- B. Diagrams shall be delivered to the Contracting Officer's Technical Representative (COTR) within 30 days of final acceptance.

1.6 ADDITIONAL EQUIPMENT

- A. Furnish and install any additional equipment required to operate specified equipment manufactured or contemplated for this installation.
- B. Special equipment not required by specification, but manufactured by elevator contractor, which would improve the operation as a whole, may be installed on or in conjunction with the specified equipment by the contractor at his option at no additional cost to the Government, provided prior approval is obtained from the COTR.

1.7 TOOL CABINET

Provide a metal tool cabinet, having two shelves and a hinged door. cabinet size shall be approximately 1200 mm (48 inches) high, 450 mm (18 inches) wide, 375 mm (15 inches) deep and shall contain not less than 213.4 cubic cm (7 cubic feet) of storage.

1.8 PERFORMANCE STANDARDS

- A. The elevators shall be capable of meeting the highest standards of the industry and specifically the following:
 - 1. Contract speed shall mean speed in the UP direction with full capacity load in the car. Speed variation under any load condition, regardless of direction, shall be no more than ten (10) percent.
 - 2. Starting, stopping, and leveling shall be smooth and comfortable without appreciable steps of acceleration and deceleration.
- B. The door opening time:
 - 1. Door opening shall be not more than 2 seconds maximum for Elevator
 - 2. Door closing time shall be 4 seconds minimum for Elevator.
- C. Cycle time shall be measured from the time the doors starts to close until the car has reached the next floor level, with the car stopped within the level allowance of plus or minus 3 mm (1/8 inch). Cycle time shall be not more than 20 seconds for Elevator. The measured floor-to-floor time interval shall be accomplished without re-leveling, and with advance door opening action.
- D. Pressure: Fluid system components shall be designed and factory tested for 500 p.s.i. maximum operating pressure shall be 500 p.s.i.
- E. Floor Accuracy
 - 1. Accuracy shall be maximum 3 mm (1/8 inch) above or below the floor, regardless of load condition.
- F. Electrical: 480 Volts, 3-phase, 25 HP.

1.9 WARRANTY

- A. Submit all labor and materials furnished in connection with elevator system and installation to terms of "Warranty of Construction" articles of FAR clause 52.246-21. Warranty shall commence upon final inspection and completion of performance test and upon full acceptance of the installation and shall concur with the length of the maintenance contract.
- B. If it becomes evident during warranty period that any device is not functioning properly or in accordance with specification requirements, or if in the opinion of the COTR, excessive maintenance and attention must be employed to keep device operational, device shall be removed and a new device meeting all requirements shall be installed as part of work until satisfactory operation of installation is obtained. Period of warranty shall start anew for such parts from date of completion of

each new installation performed, in accordance with foregoing requirements.

PART 2 - PRODUCTS

2.1 MATERIALS

- A. Where stainless steel is specified, it shall be corrosion resisting steel complying with Fed. Spec. QQ-S-766, Class 302 or 304, Condition A with Number 4 finish (150 grit) on exposed surfaces. Stainless steel shall have the grain of belting in the direction of the longest dimension and surfaces shall be smooth and without waves. During erection, protect all stainless steel surfaces with a suitable material.
- B. Where cold rolled steel is specified, it shall be low-carbon steel rolled to stretcher leveled standard flatness, complying with ASTM A109.

2.2 MANUFACTURED PRODUCTS

- A. Materials, devices and equipment furnished shall be of current production by manufacturers regularly engaged in the manufacture of such items.
- B. When two or more units of same class of materials, devices or equipment are required, these units shall be products of one manufacturer.
- C. Manufacturers of equipment assemblies which include components made by others shall assume complete responsibility for the final assembled unit.
 - 1. All components of an assembled unit shall be products of same manufacturer.
 - 2. Parts which are alike shall be the product of a single manufacturer.
 - 3. Components shall be compatible with each other and with the total assembly for the intended service.
- D. Welding: Welding at the project site shall be made by welders and welding operators who have previously qualified by test as prescribed in American Welding Society Publication AWS D1.1 to perform type of work required.
- E. Motor nameplates shall state manufacturer's name, rated horsepower, speed, volts, amperes and other characteristics required by NEMA standards, and shall be securely attached to the item of equipment in a conspicuous location.
- F. Where key-operated switches or key-operated cylinder locks are furnished in conjunction with any component of the elevator

installation, four keys for each individual switch or lock shall be furnished. Barrel keys are not acceptable. Attach each key to a tag bearing a stamped or etched legend identifying its purpose. Engrave tags and imprint "Property of U.S. Government" on reverse side.

2.3 CAPACITY, SPEED AND TRAVEL

- A. Each direct-plunger elevator shall have the capacity to lift the live load exclusive of the weight of entire car and plunger, as specified in the following schedule.

ELEVATOR SCHEDULE	
Elevator Number	Adult Day Care Building
Overall Platform Size	8'-0" wide x 5'-9" Deep
Rated Load - kg (pounds)	2100 lbs
Rated Speed - m/s (fpm)	100 FPM
Total Travel - m/s (fpm)	60'-0"
Number of Stops	2 (2 Future)
Number of Openings	2 in line (2 Future in line)
Entrance Type & Size	2 Speed side slide

- B. Actual elevator speed shall not vary more than 10 percent above nor more than 10 percent below specified speed.

2.4 POWER SUPPLY

- A. For power supply in each machine room see specification Division 26, ELECTRICAL and electrical drawings.
- B. It shall be the electrical contractor's responsibility to supply the labor and materials for the installation of the following:
1. A feeder from the power source indicated on the drawings to each hydraulic controller.
 2. Shunt Trip Circuit Breaker for each controller located at the strike side of the machine room door. Shall be lockable in the "Off" position.
 3. Auxiliary circuits for hydraulic signal and control systems as indicated on the drawings, from the indicated source to each hydraulic controller. The hydraulic controller, the elevator

contractor shall supply and install motor and power and signal wiring from the controller to the machine.

- C. Power for auxiliary power operation of elevator as specified hereinafter shall be available from auxiliary power generator, including wiring connection to the elevator control system, and be provided by the general contractor. See Section 14 24 00, HYDRAULIC ELEVATORS, Paragraph, 2.26 AUXILIARY POWER OPERATION.

2.5 CONDUIT PER NEC

- A. All conduit terminating in steel cabinets, junction boxes, wireways, switch boxes, outlet boxes and similar locations shall have approved insulation bushing. Install a steel locknut under the bushing if they are constructed completely of insulating materials. Protect the conductors at ends of conduits not terminating in steel cabinets or boxes by terminal fittings having an insulated opening for the conductors.
- B. Do not use set screws or indentations as a means of attachment or connection. Use compression fittings.
- C. Conduit size: 19mm (1/2") minimum.
- D. Flexible metal conduit not less than 9.5 mm(3/8-inch) electrical trade size may be used, not exceeding 457 mm (18 inches) in length, for short connections between risers and limit switches, interlocks, and for other applications permitted by the NEC. Flexible heavy-duty service cord, type S.O., may be used between fixed car wiring and switches on car doors for safety edges and light ray devices.
- E. Provide terminal boxes for the conduit and wiring connections to the pump motor.
- F. Size conduit, junction boxes, outlet boxes, etc., for future travel requirements.

2.6 CONDUCTORS

- A. Unless otherwise specified, conductors, exclusive of traveling cables, shall be stranded or solid coated annealed copper in accordance with Fed. Spec. J-C-30 for either Type RHW or THW. Where 16 and 18 AWG are permitted by NEC, either single conductor cable in accordance with Fed. Spec. J-C-580 for Type TF, or multiple conductor cable, may be used provided the insulation of single conductor cable and outer jacket of multiple conductor cable is flame retardant and moisture resistant. Multiple conductor cable shall have color coding or other suitable identification for each conductor. Conductors for control boards shall

- be in accordance with NEC. Permit no joints or splices in wiring except at outlets. Tap connectors may be used in wireways provided they meet all UL requirements.
- B. All wiring must test free from short circuits or grounds. Insulation resistance between individual external conductors and between conductors and ground shall be not less than one megohm.
 - C. Where size of conductors is not given, capacity shall be such that maximum current shall not exceed limits prescribed by NEC.
 - D. Provide equipment grounding. Ground conduits, supports, controller enclosures, motors, platform and car frames, and all other non-current conducting metal enclosures for electrical equipment in accordance with NEC. The ground wires shall be copper, green, insulated and sized as required by NEC. Bond the grounding wires to all junction boxes, cabinets, and wire raceways.
 - E. Terminal connections for all conductors used for external wiring between various items of elevator equipment shall be solderless pressure wire connectors in accordance with Fed. Spec. W-S-610. The Contractor may, at his option, make these terminal connections on No. 10 or smaller conductors with approved terminal eyelets set on the conductor with a special setting tool, or with an approved pressure type terminal block. Terminal blocks using pierce-through serrated washers are not acceptable.
 - F. Install conductors from junction box in hoistway to controller for future travel requirements.

2.7 TRAVELING CABLES

- A. Traveling cables from junction box on car to junction box in hoistway or directly to controller shall consist of flexible traveling cables conforming with requirements of NEC. Equip junction boxes in hoistway and on car with terminal blocks. Provide all connections to terminal blocks with either terminal eyelet connections or pressure wire connectors of the clamp type that meet UL 486A requirements from stranded wire. Terminal blocks shall have permanent indelible identifying numbers for each connection. Flame and moisture resistant outer covering must remain intact between junction boxes. Abrupt bending or twisting producing distortion of cable shall not be allowed.
- B. Provide 10 percent, but not less than 5 spare conductors in each traveling cable.

- C. Provide shielded traveling cable wires for the auto dial phone system in each elevator car. Cable shall extend from auto dial phone system in car directly to controller or from junction box in hoistway to controller.

2.8 CONTROLLERS

- A. Compartment: Securely mount all assemblies, power supplies, chassis switches, relays, etc., on a substantial, self supporting steel frame. Completely enclose equipment with covers. Provide means to prevent overheating.
- B. Wiring: Controller wiring shall be neatly arranged, readily accessible, easily traced and securely fastened in place. Identify all spare conductors to controller.
- C. Identify each device and fuse (ampere rating) on panels by name, letter, or standard symbol, in an approved indelible and legible manner on device or panel. Coordinate identification markings with identical markings or wiring diagrams.
- D. Provide solid state components and printed circuit boards to control the hydraulic machine or signal functions. If this option is exercised, complete details of the components and printed circuit boards, together with a complete operational description, shall be submitted for approval prior to manufacture. Incorporate the following features into the design:
 - 1. The electrical connections between the printed circuit boards (modules) and the circuit connectors incorporated in the mounting racks shall be made through individual tabs which shall be an integral part of each module. The tabs shall be nickel-gold plated or other approved metal of equal electrical characteristics. Notch modules so as to prevent insertion of the modules in the inverted position.
 - 2. Light emitting diode (LEDS) may be used for visual monitoring of individual modules.
 - 3. Components shall have interlocking circuits to assure fail-safe operation and to prevent unwarranted elevator movement in case any component fails to function properly.
 - 4. Submit method of wire wrappings for point to point wire connections on the mounting racks for approval.

5. Modules shall be of the type that plug into pre-wired mounting racks. No field wiring or alteration shall be necessary in order to replace defective modules.
6. Any field wiring changes required during construction shall be made only to the mounting rack connection points and not to the individual module circuitry or components. Any changes to individual modules shall be performed at the factory.
7. Fabricate module boards from non-conductive, non-corrosive material which is of sufficient strength so as to support all components mounted thereon without warping. Space mounting racks sufficiently apart to prevent accidental contact between individual modules.
8. All logic symbols and circuitry designations shall be in accordance with ASME Standards.
9. Design solid state components to operate at a maximum of 40 degrees C (104 degrees F).
10. Bring wiring connections for operating circuits and for external control circuits to terminal blocks mounted in an accessible location within the controller cabinet. Terminal blocks using pierce-through serrated washers shall not be acceptable.
11. Provide controllers with wiring and components for additional future travel, of 2 floors and approximate 28 feet of additional travel.

2.9 MICROPROCESSOR CONTROL SYSTEM

The Contractor shall, provide solid state components and printed circuit boards to control the hoisting machine and signal functions in accordance with these specifications. Complete details of the components and printed circuit boards, together with a complete operational description, shall be submitted for approval.

2.10 PUMP UNIT ASSEMBLY

- A. Completely integrate the pump unit for the control of the elevator and self-contain in a unit fabricated of structural steel. The unit shall consist of a hydraulic fluid pump driven by an induction motor together with oil control valves, piping, etc. Do not install hydraulic equipment within the storage tank. Completely enclose unit on four open sides of the power unit frame with not less than 16 gauge steel removable panel sections. Fully line panel sections on the interior with one-inch rigid board, mineral or glass fiber, or equivalent acoustical insulation.

- B. Design hydraulic system so that working pressure does not exceed 400 p.s.i. under any loading condition.
- C. Pump shall be positive-displacement, rotary screw type, specially designed for hydraulic elevator service, having a steady discharge without pulsation to give smooth and quiet operation. Pump output shall be capable of lifting elevator car with rated capacity, with a speed variation of no more than ten percent between no load and full load. Pump shall operate under flooded suction in an accurately machined case with the clearance required to assure maximum efficiency. Hydraulic fluid by-pass shall discharge directly into storage tank.
- D. Submersible pump unit not acceptable.
- E. Motor shall be squirrel-cage, drip proof, ball bearing, induction type, with a synchronous speed not in excess of 1800 RPM. Design motor specifically for elevator service, not to exceed nameplate full load current by more than 10% and be continuously rated 120 starts per hour without exceeding a rise of 40 degrees C. Include closed transition SCR soft start.
- F. Connect motor and pump with multiple V-belt. Size belts and sheaves for duty involved and design to prevent any metallic contact between motor and pump shaft. Provide isolation units of rubber in shear to prevent transmission of pump and motor vibration to the building. Install expanded metal sheave guard that can be easily removed for servicing and inspection.
- G. Design motor, pump, tank, and piping to accommodate future travel of the elevator.

2.11 HYDRAULIC SYSTEM

- A. Construct the storage tank of sheet steel, welded construction, and a steel cover. Suitable means for filling, a minimum one-inch protected vent opening, an overflow connection, and a valved drain connection. Tank shall act as a storage tank only, and sized to pass through machine room door as shown on drawings. Provide marked gauge to meter hydraulic fluid level. Tank shall be of capacity to hold volume of hydraulic fluid required to lift elevator to top terminal landing, plus a reserve of not less than ten gallons. Provide a baffle in the bottom of the tank to prevent entry of any sediment or foreign particles into hydraulic system. Baffle shall also minimize aeration of hydraulic fluid. Permissible minimum hydraulic fluid level shall be clearly indicated. Hydraulic fluid shall be of good grade to assure free flow

when cool, and have minimum flash point of 400 degrees F. Provide initial supply of hydraulic fluid for operation of elevator.

1. Thermostatically control the viscosity of the hydraulic fluid with thermal cooling unit or chilled water heat exchanger and temperature thermostat to maintain the fluid temperature in the reservoir, pump and valves at a constant operating viscosity.
 2. Provide a data plate on the tank framing indicating the characteristics of the hydraulic fluid used.
- B. Furnish and install connections between the storage tank, pump, muffler, operating valves, and cylinder complete with necessary valves, pipe supports, and fittings. All connections between the discharge side of the pump, check valve, muffler, cylinder, lowering valves shall be of schedule 40 steel with screw, flanged, welded, or approved flexible or mechanical couplings. Size of pipe and couplings between cylinder and pumping unit shall be such that fluid pressure loss is limited to 10 percent.
- C. Do not subject valves, piping, and fittings to working pressure greater than those recommended by the manufacturer.
- D. Support all horizontal piping. Place hangers or supports within 3 mm (12 inches) on each side of every change of direction of pipe line and space supports not over 3.0 meters (10 feet) apart. Secure vertical runs properly with iron clamps at sufficiently close intervals to carry weight of pipe and contents. Provide supports under pipe to floor.
1. Provide all piping from remote machine room to hoistway, including necessary supports or hangers. If remote piping is underground or in damp, inaccessible areas, install hydraulic piping thru PVC sleeve pipe.
- E. Install pipe sleeves where pipes pass through walls or floors. Set sleeves during construction. After installation of piping, equip the sleeves with snug fitting inner liner of either glass or mineral wool insulation.
- F. Install blowout-proof, non-hammering, oil-hydraulic muffler in the hydraulic fluid supply pressure line near power unit in machine room. Design muffler to reduce to a minimum any pulsation or noises that may be transmitted through the hydraulic fluid into the hoistway.
- G. Solenoid operate and arrange control valves so hydraulic fluid flow will be controlled in positive and gradual manner to insure smooth starting and stopping of elevator.

- H. Provide safety check valve between cylinder and flexible pump connection which will hold elevator with specified load at any point when pump stops or pressure drops below minimum operating levels.
- I. Provide an automatic shut-off valve in the oil supply line at the cylinder inlet. Weld pipe protruding from cylinder at inlet and thread to receive shut-off valve. Activate the automatic shut-off valve when there is a ten percent drop in no-load operating pressure. When activated, this device shall immediately stop the descent of the elevator, and hold the elevator until it is lowered by use of the manual lowering feature of the valve. Arrange the manual lowering feature of the automatic shut-off valve to limit the maximum descending speed of the elevator to 15 FPM. The exposed adjustments of the automatic shut-off valve shall have their means of adjustment sealed after being set to their correct position.
- J. Provide external tank shut-off valve to isolate hydraulic fluid during maintenance operations.
- K. Provide all pump relief and other auxiliary valves to comply with the requirements of the Code and to insure smooth, safe, and satisfactory operation of elevator.
- L. Furnish and adjust by-pass and relief valve in accordance with Rule 3.19.4.2 of ASME A17.1.
- M. Install check valve to hold the elevator car with rated load at any point when the pump stops.
- N. Provide a shut-off valve in the pit near the jack and in the machine room capable of withstanding 150 percent of design operating pressure. Manual valve shall have handle attached to the valve.
- O. Conveniently locate the manual lowering valve, easily accessible, and properly identified with a red arrow and not concealed within the storage tank. Mark the operating handle in red.
- P. Provide a low oil control feature which shall shut off the motor and pump and return the elevator to the lowest landing. Upon reaching the lowest landing, doors will open automatically allowing passengers to leave the car. Then doors shall close. All control buttons, except the door open button, shall be made ineffective.
- Q. Provide oil-tight drip pan for assembled pumping unit, including storage tank. Pan shall be not less than 16 gauge sheet steel, with one-inch sides.

- R. The entire hydraulic system, including muffler, shall be tested to withstand a pressure equal to twice the calculated working pressure. Submit certification that test has been performed.

2.12 CAR GUIDES

- A. Install on car frame four adjustable roller guides, each assembled on a substantial metal base, to permit individual self-alignment to the guide rails.
- B. Roller Guides
1. Each guide shall be of an approved type consisting of not less than three (3) wheels, each with a durable, resilient oil-resistant material tire rotating on ball bearings having sealed-in lubrication. Assemble rollers on a substantial metal base and mount to provide continuous spring pressure contact of all wheels with the corresponding rail surfaces under all conditions of loading and operation. The wheels shall be of ample diameter and shall run on three-machine finished dry rail surfaces. Secure the roller guides at top and bottom on each side of car frame and counterweight frame. All mounting bolts shall be fitted with nuts, flat washers, split lock washers and if required, beveled washers.
 2. Provide sheet metal guards to protect wheels on top of car.
 3. Minimum diameter of car rollers shall not be less than 152 mm (6 inches). The entire elevator car shall be properly balanced to equalize pressure on all guide rollers. Cars shall be balanced in post-wise and front-to-back directions. Test for this balanced condition shall be witnessed at time of final inspection.

2.13 CROSSHEAD DATA PLATE

Permanently attach a non-corrosive metal data plate to car crosshead. Data plate shall bear information required by Rule 2.16.3 and 2.20.2.1 of ASME A17.1. Etch or stamp such information on plate.

2.14 CAR BUFFERS

- A. Provide a minimum of two spring buffers for each car, in accordance with Rule 3.22 of ASME A17.1. Securely fasten buffers and supports to the pit channels, and in the alignment with striker plates on car. Permanently fasten to each buffer a metal plate showing stroke and loading rating. Buffer anchorage shall not puncture pit waterproofing.
- B. Design and install buffers to provide minimum car runby required by Rule 3.4.2 of ASME A17.1.

- C. Furnish pipe stanchions and struts, as required, to properly support the buffer.

2.15 NORMAL AND FINAL TERMINAL STOPPING DEVICES

- A. Mount normal stopping switch on car or in hoistway to slow speed of car and bring it to an automatic stop level with the terminal landings.
 - 1. Switch shall function with any load up to and including 125 percent of rated elevator capacity at any speed obtained in normal operation.
 - 2. Switch, when opened, shall permit operation of car in reverse direction.
 - 3. No normal stopping device, other than one mounted on car and activated by cams in hoistway, or mounted in hoistway and activated by cams on car, shall be permitted.
- B. Mount final terminal stopping switches in the hoistway.
 - 1. Switches shall be positively opened by car, should the car travel beyond the normal stopping switches.
 - 2. Switches shall be independent of other stopping devices.
 - 3. Switches, when opened, shall remove power from hoist motor, apply hoist machine brake, and prevent operation of car in either direction.
- C. After final stopping switches have been adjusted, through bolt switches to guide rail.

2.16 TOP-OF-CAR OPERATING DEVICE

- A. The device shall conform to ASME A17.1 and the following:
 - 1. Activate the device by a toggle switch mounted in the device. The switch shall have the "ON" and "OFF" positions permanently marked on the faceplate with 1/4-inch letters.
 - 2. Accomplish movement of the elevator by the continuous pressure on a direction button and a safety button.
 - 3. Provide an emergency stop toggle type switch as per ASME.
 - 4. Provide permanent identifications for the operation of all components in the device.
 - 5. Permanently attach the device to the elevator crosshead, on the side of the elevator which is nearest to the hoistway door opening.

2.17 WORKMAN'S LIGHTS AND OUTLETS

- A. Provide duplex GFCI protected type receptacles and lamp, with wire guards on top of elevator car and beneath platform.

- B. The receptacles shall be in accordance with Fed. Spec. W-C-596/12D for Type D7, 2-pole, 3-wire grounded type rated for 15 amperes and 125 volts.

2.18 CAR LEVELING DEVICE

- A. Provide car leveling device for elevator which shall automatically bring car to within 3 mm (1/8-inch) of exact level with floor landing regardless of load in car or direction of travel.
- B. When the car is traveling in the up direction, the car shall level up to the floor; and when the car is traveling in the down direction, the car shall level down to the floor. The car shall at all times level into the floor and shall not stop above or below the floor and level back.
- C. One-way leveling, augmented with an anti-creep device, shall not be acceptable.

2.19 EMERGENCY STOP SWITCHES

- A. Provide each top-of-car device, pit, etc., with emergency stop toggle switches. Mount stop switch on top-of-car in a common fixture with the top-of-car operating device and stop switch in the pit adjacent to pit access door or at top of pit ladder.
- B. Each stop switch shall be red in color and shall have its "Identity" and "STOP" and "RUN" positions legibly and indelibly identified.

2.20 OPERATING DEVICE FACEPLATES

- A. Fabricate faceplates for all elevator operating and signal devices from not less than 3 mm (1/8-inch) thick flat stainless steel, with all edges beveled at least 15 degrees. Install all faceplates flush with surface upon which they are mounted.
- B. Corridor push button faceplates shall be at least 65 mm (2 1/2-inches) wide by 200 mm (8 inches) high. The centerline of all corridor pushbutton fixtures shall be 1 meter (3 feet 6 inches) above the corridor floor.
- C. Fasten all car and corridor operating device and signal device faceplates with non-corrosive white metal spanner head or bristol head tamperproof screws.
- D. Design car and corridor pushbutton faceplates so that pressure on pushbuttons are independent of pressure on pushbutton contacts.
- E. Engraved legends or raised numerals in faceplates shall have lettering ¼ inch high filled with black paint.

2.21 OPERATING DEVICES AT HOISTWAY LANDINGS

- A. Provide a single riser of landing call buttons. Fixtures for intermediate landings shall contain "UP" and "DOWN" buttons. Each button shall contain an integral registration light which shall illuminate upon registration of a call and extinguish when the call is answered. If a landing button is operated while the car and hoistway doors are closing at the floor, the doors shall stop and reopen and remain open for a normal passenger transfer time.

2.22 ELEVATOR CAR OPERATING PANELS

- A. Locate main car operating panel in car enclosure so that the highest passenger use device shall be no more than 1200 mm (4 feet) above the finished floor. Locate the alarm bell button at the bottom of the panel with the centerline no less than 875 mm (35 inches) above the finished floor.
 - 1. All terminology on main car operating panel and auxiliary panel shall be engraved. Use 6 mm (1/4 inch) or larger letters for all passengers use devices in main and auxiliary car operating panels. Use 3 mm (1/8 inch) letters to identify all other devices in lower section of the main car operating panel.
 - a. Phase II firefighters' operating instructions
 - b. Unique car number
 - c. "No Smoking"
 - d. Car capacity in pounds
 - e. Medical emergency operation
- B. Main car operating panel with swing front return panel.
 - 1. The control panel shall contain:
 - a. A complete set of raised or flush illuminated pushbuttons with a minimum diameter of 25.4 mm (1 inch). Buttons shall have the floor designation indelibly marked on their face using 13 mm (1/2 inch) characters. The button illumination shall extinguish when the car reverses its travel. As the car stops for a floor, that corresponding button shall be extinguished.
 - b. Emergency stop key switch (red in color) with markings to show "RUN" and "STOP". Emergency stop switch shall be key operated.
 - 1) Connect emergency signal alarm bell button to a 150 mm (6 inch) vibrating bell located on top of car. Furnish and install bell including the necessary wiring and auxiliary devices.

- c. Emergency signal alarm bell button (red in color). Illuminate button when actuated.
- d. Two position key operated independent service transfer switch marked "INDEPENDENT SERVICE" with two positions marked "ON" and "OFF".
- e. A three position key operated fire service switch marked "FIRE OPERATION" with three positions marked "OFF, HOLD and ON".
- g. A red translucent light jewel with a visual graphic per ASME A17.1 which shall illuminate when required on fire service operation. It shall be marked "FIRE SERVICE".
- h. An audible signal system for fire service operation.
- i. A button marked "CALL CANCEL" for fire service operation.
- j. Door "OPEN" and door "CLOSE" buttons located below the car buttons. locate the door "OPEN" button adjacent to the car door entrance column.
- k. Emergency "Push to Call" button for two way communication with auto dial system. "Push to Call" button or adjacent light jewel shall illuminate and flash when call is acknowledged. Button shall match floor pushbutton design. Provide "Push to Call" button, tactile symbol and Braille adjacent to button mounted integral with car front return panel Engrave "Push To Talk" in 6 mm(1/4 inch) letters over button.
- l. Medical emergency service light jewel and buzzer. //

2.23 SINGLE CAR SELECTIVE COLLECTIVE AUTOMATIC OPERATION

- A. Provide selective collective automatic operation for passenger elevator.
- B. Design system so that upon registration of one or more landing calls, car shall start automatically, provided hoistway door interlock circuits and car door circuits are established, and shall stop at the first floor reached for which a car or landing call has been registered which corresponds to the direction in which the car is traveling. Car must stop at floors for which car and/or landing calls have been registered, in natural order in which floors are reached by car, without regard to sequence in which the calls have been registered, provided a call for a given floor has been registered sufficiently in advance of arrival at that floor to permit stop to be made. Arrange operation so that if no car calls have been registered and the car starts up in response to several "DOWN" landing calls, car shall travel

to highest "DOWN" call first and then reverse to collect other "DOWN" calls. Collect "UP" landing calls in the same manner, when the car starts down in response to "UP" calls by first stopping for lowest "UP" landing call. If while car is traveling in the up direction, "DOWN" landing calls are registered, the car shall make no response to the "DOWN" landing calls. However, "DOWN" calls shall remain registered and after highest "UP" call has been satisfied, car shall automatically proceed to the highest "DOWN" call and shall then collect "DOWN" calls as, hereinbefore, specified. Likewise, when the car is traveling down, no response shall be made to "UP" landing calls, but such "UP" calls shall remain registered and shall be answered by the car on its next up trip. Provide an adjustable time limit relay to hold car at landing for predetermined time after the car stops.

- C. When all calls in the system have been satisfied, the elevator shall shut down at the last landing served with the car and hoistway doors closed. Registration of a call at the landing where the car is parked shall automatically open the car and hoistway doors.

2.24 INDEPENDENT SERVICE

- A. Provide a two position key operated "INDEPENDENT SERVICE SWITCH" in the main car operating panel which shall have its positions marked "OFF" and "ON". When the switch is in the "ON" position, the car shall respond only to calls registered on landing push buttons. Car and hoistway door shall not close until a car button or the "DOOR CLOSE" button is pressed and held until the interlock circuits are established. Resume normal service when the switch is returned to the "OFF" position.

2.25 FIRE SERVICE

- A. Provide Fire Service as per ASME A17.1.
- B. Smoke Detectors:
 - 1. Smoke detection devices in each elevator lobby, and machine room, provided by General Contractor. Furnish and install the smoke detection devices, together with all necessary conduit, wiring, relay, etc., required between the Fire Alarm System and the junction box of the elevator lobby control panel, under "FIRE ALARM SYSTEMS". All necessary connections from the elevator lobby control panel to the elevator control system in the machine room shall be furnished and installed under this section of the specification.

2. Upon activation of an elevator lobby, and machine room smoke detection device, transmit a signal to the building fire alarm control console. Transmit an "Alarm" signal from the console to the elevators, which shall activate the "Fire Service" Phase I operation. The "Alarm" signal received from any elevator lobby, or machine room smoke detection device, except that device located in the main lobby shall activate the same sequence of operation activated by the "Fire Service" key operated switch in the main lobby control panel. Together the "Alarm" signal received from the smoke detection device, located in the main landing lobby, shall activate the same sequence of operation activated by sending the elevator to the designated alternate floor.
3. When an "Alarm" signal initiates Phase I operation, momentary movement of the "Fire Service" key in the lobby control panel to the "ON" position shall be required to return elevators to automatic operation if "Alarm" signal is cleared.

2.26 AUXILIARY POWER OPERATION

- A. The control system for elevator shall include provisions for operation on auxiliary power upon failure of the normal power supply.
- B. The electrical contractor provides auxiliary power supply, including its starting means, transfer switch for transfer of elevator supply from normal to auxiliary power, a pair of conductors in a conduit from an auxiliary contact on the transfer switch (contact closed on normal power - open on auxiliary power) to terminals on the elevator controller and other related work. If auxiliary power is not sufficient capacity to run all elevators, provide a timing relay from normal power to auxiliary power and another relay for delay back to normal power.
- C. The elevator contractor provides auxiliary equipment on elevator controllers, wiring between associated elevator controllers and wiring between elevator controllers and remote selector panel as required to permit the elevators to operate as detailed.
- D. Upon loss of normal power supply there shall be a delay before transferring to auxiliary power of three to fifteen seconds maximum the delay shall be accomplished through an adjustable timing device capable of delays from zero seconds to sixty seconds. Following this adjustable delay the associated elevators shall function as follows:
 1. Selector switch in automatic position:

- a. Elevator shall be automatically selected and returned to the main floor, at normal speed, open its doors and shut down.
- b. Any elevator which has manually been removed from automatic service, i.e., inspection service, independent service, fire service, main line switch, shall not receive an automatic return signal.
- c. When an elevator is given a signal to return and it is unable to start or complete its movement to the main floor within a minimum of 20 seconds, it shall be by passed.
- d. Any elevator or elevators by passed on initial return signal shall be signaled again.
- e. When all cars have returned to designated floor, elevator shall be designed for automatic operation. Individual car shall restart in five (5) seconds.

E. Selector Switch:

- 1. The selector switch shall have positions marked for elevator controlled. It shall have a position marked "AUTOMATIC". When the selector switch is set to the automatic position, car arriving at the main floor shall operate on auxiliary power operation, and be capable of functioning under all design features.
- 2. Change in selection of elevators shall be by means of the selection switch and shall occur only when the previous selected elevator is stopped at the main floor.
- 3. Lock the selector switch out of operation when the system is in the normal mode of operation.

F. Remote Selector Panel:

- 1. Locate as directed by COTR.
- 2. Provide selector panel in a NEMA 1B flush type enclosure furnished with a brushed finish stainless steel hinged door and frame. The door shall contain a tumbler type lock furnished with four keys. Identify the enclosure faceplate as "Auxiliary Power Control" with 13 mm (1/2 inch) engraved letters filled with black paint.
- 3. Brush finish the inside selector panel of stainless steel with each device identified with 3 mm (1/8 inch) engraved letters filled with black paint. The panel shall contain:
 - a. Selector switch or switches for selecting the elevators.

- b. Pilot lights to indicate normal mode of operation, auxiliary power service available, and which elevator is connected to auxiliary service.
 - c. A lamp test circuit consisting of a momentary contact pushbutton to test all pilot lights in the circuit.
 - d. Provide a permanently mounted, easy to read, instruction plate, which shall include operating instructions for auxiliary power service and instructions for lamp test circuits.
- G. Upon restoration of normal power supply, an adjustable time circuit shall be activated which will cause car to remain at the floor, if already there, or stop and remain at the nearest floor if in flight. Actual transfer of power from auxiliary power to normal building power shall take place after all cars are stopped at a floor. Individual car shall restart in five seconds.

2.27 CAR POSITION INDICATOR

- A. Provide an alpha-numeric LED digital position indicator in each main car operating panel, consisting of numerals and arrows not less than 50 mm (2 inch) high, to indicate position of car and direction of car travel. Indicator faceplate shall be stainless steel. Provide L.E.D. or L.C.D. illumination. Locate position indicator in the main car operating panel. When no direction has been established, neither arrow shall be illuminated.
- B. Provide an audible signal to momentarily sound as the car is stopping at, or passing a floor. It shall be no less than 20dB with a frequency no higher than 1500 Hz. Provide space, adapters and wiring for future floors.

2.28 CORRIDOR POSITION INDICATOR

- A. Provide alpha-numeric digital L.E.D. position indicators directly over hoistway landing entranceways at each floor. Indicator cover plates shall consist of faceplates of stainless steel. Numerals shall be not less than 50 mm (2 inches) high. Cover plates shall be readily removable for relamping. In addition to the row of numerals, each indicator shall have a "WHITE" up arrow and a "RED" down arrow. When car is standing at landing with no direction established, arrows shall not be illuminated. Each corridor position indicator shall be equipped with a clearly audible gong which shall sound once for "UPWARD" bound car and twice for "DOWNWARD" bound car. Audible signal shall not sound when a car passes the floor without stopping.

B. Provide space, adapters, and wiring for future floors.

2.29 CORRIDOR LANTERNS

A. Provide each car entrance with a digital corridor lantern mounted over the hoistway entrances at all floors except main and alternate fire response floors. Provide each terminal landing with a single "UP" or "DOWN" 50mm (2 inch) arrow lantern and each intermediate landing with "UP" and "DOWN" lanterns. Each lens shall be illuminated with L.E.D. illumination of proper intensity, so shielded to illuminate individual lens only. Connect lanterns to signal, in advance of approach and direction of stopping car whether or not corridor button has been operated at the floor. Each lantern shall be equipped with a clearly audible electronic tone which shall sound once for "UPWARD" bound car and twice for "DOWNWARD" bound car. Audible signal shall not sound when a car passes the floor without stopping. Provide adjustable sound level on audible signal.

2.30 AUDIO VOICE SYSTEM

A. Provide voice audio activated by stopping at a floor. Audio voice to give floor designations. The voice announcer shall be a digitized floor announcer that will announce the floor numbers and direction of travel and special announcements. The voice announcer will be a natural human voice that receives messages and shall comply with ADA requirements for audible car position indicators. The voice announcer shall have two separate volume controls. One for the floor announcement and another for the floor direction. The voice announcer shall be 250 mm W x 250 mm H x 150 mm D (10 inch W x 10 inch L x 6 inch D) voice box 450 mm (18 inch) full range loud speaker to be located on top of the cab. The voice box shall be concealed above the elevator dome. The speaker shall be mounted center of the elevator dome or as directed by the Engineering Officer. The voice announcer unit shall contain 21 ports which can accommodate 21 standard floors and direction messages. Install voice announcer per manufacturer's recommendations and instructions. The voice announcer shall be the product of one manufacturer of established reputation. Provide manufacturer literature and list of voice messages. Provide special messages for Fire Service, Medical Emergency, "Do not block doors" or others as directed by COTR.

2.31 HOISTWAY ACCESS SWITCHES

A. Provide hoistway access switch for elevator at top terminal landing to permit access to top of car, and at bottom terminal landing to permit

access to pit. When side slide doors are specified, mount the access key switch 1800 mm (six feet) above the corridor floor in the recessed portion of the strike jamb where it will be protected by the leading edge of the closed hoistway door. The exposed portion of each access switch or its faceplate shall have legible, indelible legends to indicate identity and "UP", "DOWN", and "OFF" positions. Design and location of access switches shall be submitted for approval. Each access switch shall be a constant pressure cylinder type lock having not less than five pins or five stainless steel disc combination with key removable only when switch is in "OFF" position. Barrel keys not acceptable. Lock shall not be operable by any other key which will operate any other lock or device used for any other purpose in the hospital. Arrange the hoistway switch to initiate and maintain movement of the car. When the car is moved down from the top terminal landing, limit the zone of travel to a distance not greater than the height of the car crosshead.

B. Provide emergency keyway for all hoistway entrances.

2.32 HOISTWAY ENTRANCES FOR PASSENGERS ELEVATORS

- A. Provide entrances of metal construction using cold rolled steel, except door frames which shall be of stainless steel. Complete entrances with sills, hanger supports, hangers, tracks, angle struts, unit frames, door panels, fascia plates, toe guards, hardware, bumpers, sight guards, and wall anchors.
- B. Provide one piece extruded aluminum sills with non-slip wearing surface, grooved for door guides and recessed for fascia plates. Sills shall have an overall height of not less than 19 mm (3/4 inch), thickness of not less than 3 mm (1/8 inch), and set true, straight and level, with hoistway edges plumb over each other, and top surfaces flush with finished floor. Grout sills full length after installation.
- C. Construct hanger supports of not less than 4.5 mm (3/16 inch) thick steel plate, and bolted to strut angles.
- D. Structural steel angles 75 mm by 75 mm by 9 mm (3-inches by 3-inches by 3/8-inch) shall extend from top of sill to bottom of floor beam above, and shall be securely fastened at maximum 457 mm (18 inch) O.C. and at each end with two bolts.
- E. Provide jambs and head soffits, of not less than 14 gauge stainless steel, for entrances. Jambs and head soffits shall be combination buck and jamb welded construction, and provided with three tile anchors each

side. Side jambs shall be curved type. Radius of curvature shall be about 90 mm (3 1/2-inches). Head jamb shall be square type, and shall overhang corridor face of side jambs by 6 mm (1/4 inch). Rigidly fasten jambs and head soffits to building structure. Provide jambs and head soffits with oiled paper covering suitably taped at factory, or other suitable type of protective covering. After installation, protect jambs and head soffits with wood framing to prevent damage to finish.

Solidly grout jambs.

- F. If drywall is used for hoistway construction, submit method of anchoring jambs to front hoistway walls for approval.
- G. Provide hoistway entrance with flush two speed side slide hoistway doors. Door panels shall be not less than 16 gauge sheet steel, flush type construction, and not less than 35 mm (1 1/2-inches) thick. Top and bottom of door panels shall have continuous stiffener channels welded in place. Reinforcement of the door panels shall be approximately 0.04-inch in thickness and of the hat section type. At bottom of each panel, provide two accurately fitted removable laminated phenolic or other approved material, guides with fire stops. Reinforce each door panel for hangers, interlock mechanism, power door operator and closer. One door panel of each entrance shall bear a BOCA label, Underwriters' label, or, in lieu of this, other labels may be furnished provided they are based on fire test reports and factory inspection procedures acceptable to Contracting Officer. Fasten sight guard of 16 gauge metal, extending full height of panel, to leading edge of fast speed panel of two-speed doors. Door finish shall be stainless steel.
- H. Provide rubber bumpers at top and bottom of strike jambs and/or struts for stopping door panels at limits of travel in opening and closing directions.
- I. Provide 14 gauge sheet steel fascia plates in hoistway to extend vertically from head of hanger support housing to sill above. Plates shall be the same width as the door opening of elevator and adequately reinforced to prevent waves and buckles. Below bottom terminal landing and over upper terminal landing provide suitable toe guard and dust cover beveled back to wall and adequately fastened. Provide cover plate the width of the door opening on hanger pockets.
- J. Provide hangers for hoistway door panels and have means to transmit motion from one door panel to the other. Fasten the hangers to the door sections. Provide with reinforcements at the point of attachment. The

hanger shall have provisions for vertical and lateral adjustment. The hanger shall be of the two-point suspension type, consisting of nylon or other non-metallic tired sheaves fitted with dustproof, grease packed ball or roller bearings mounted on a malleable iron or steel bracket. The hanger sheaves shall operate at a relatively low rotational speed, and shall roll on a high-carbon, cold-rolled or drawn steel track shaped so as to permit free movement of sheaves without regard to vertical adjustment of sheave, bracket or housing. Beneath the track and each hanger sheave, provide a hardened steel up-thrust roller capable of withstanding a vertical thrust equal to the carrying capacity of adjacent upper sheave. The up-thrust shall have fine vertical adjustments, and the face of the roller shaped so as to permit free movement of the hanger sheave. The up-thrust roller shall have ball or roller bearings. Provide the hanger sheaves with steel fire stops to prevent disengagement from tracks. Fit each hanger sheave with a felt, or similar material, wiper to provide a light lubricating film between the sheave and hanger track.

- K. Do not use hangers that are constructed integrally with the door panels.
- L. Provide raised numerals for all openings, with a centerline of 50 mm (2 inches) high, located on each side of entrance frame, at a height of 1500 mm (5-feet) above the landing sill. The numerals shall also contain Braille.
- M. Provide unique car number on every elevator entrance at designated level, minimum 75 mm (3 inches) in height.

2.33 ELECTRIC POWER DOOR OPERATORS, PASSENGER ELEVATORS

- A. Provide a high-speed, heavy duty, direct-current or alternating-current, master-type, door operator to automatically open the car and hoistway doors simultaneously when the car is leveling, and automatically close the doors simultaneously at the expiration of the door-open timing. Motor shall be of the high-internal resistance type, capable of withstanding high currents resulting from stall without damage to the motor. The door operator shall be capable of opening a car door and hoistway door simultaneously, at a maximum speed of not less than two feet per second. The closing speed of the doors shall be one foot per second. A reversal of direction of the doors from the closing to opening operation initiated by the infrared curtain unit reopening device, or the door "OPEN" button, shall be accomplished

within no more than 38 mm (1 1/2-inches) maximum of door movement. Particular emphasis is to be placed on obtaining quiet interlock and door operation, and smooth, fast, dynamic braking for door reversals and stopping of the doors reversals, and stopping of the door extremes of travel. Construct all levers, operating the doors, of heavy steel members, and all pivot points shall have ball or roller bearings. Use electric power to open and close the doors. Auxiliary automatic door closers required under Rule 2.11.3 of ASME A17.1 shall be torsion spring type.

- B. Design the door operator so that in case of interruption or failure of the electric power from any cause, it shall permit emergency manual operation of both the car door and the hoistway door from within the car, at door zone only, outside of door zone, doors are restricted to 100 mm (4 inch) opening.
 - 1. It shall not be possible for the doors to open by power unless the elevator is within the leveling zone.
 - 2. Provide infrared curtain unit. The device shall cause the car and hoistway doors to reverse automatically to the fully-open position should the unit be actuated while the doors are closing. Unit shall function at all times when the doors are not closed, irrespective of all other operating features. The leading edge of the unit shall have an approved black finish.
- C. Should the doors be prevented from closing for more than predetermined adjustable interval of 20 to 45 seconds by the interruption or failure of the infrared curtain unit door control shall be rendered inoperative and the doors shall close at reduced speed while a nudging buzzer located on the car shall sound.
 - 1. If an obstruction in the sill should not activate the infrared curtain unit door control device and prevent the doors from closing for more than a predetermined adjustable interval of 45 to 90 seconds, the doors shall reverse to the fully open position and reestablish the closing cycle.
- D. Provide door "OPEN" and "CLOSE" buttons. When the door "OPEN" button is pressed and held, the doors, if in the open position, shall remain open and, if the doors are closing, they shall stop, reverse and reopen. Momentary pressure of the door "CLOSE" button shall initiate the closing of the doors prior to the expiration of the normal door open time.

2.34 ELECTRIC INTERLOCKS

- A. Equip each hoistway door with true interlock, functioning as hoistway unit system, to prevent operation of car until all hoistway doors are locked in closed position as defined by ASME A17.1. Interlock shall prevent opening of hoistway door from corridor side, unless car is at rest at landing, is operating in leveling zone at landing, or hoistway access switch is used.
- B. Hoistway door interlock shall not be accepted, unless it has successfully met requirements of Rule 2.12.6 of ASME A17.1. Securely fasten approved devices to the car, and arrange to operate the interlocks without objectionable noise, shock or jar.
- C. Equip car doors with electric contact which prevents operation of car until doors are closed as defined in ASME A17.1 unless car is operating in leveling zone or hoistway access switch is used. Locate door contact to prevent its being tampered with from inside of car. Car door contact shall not be accepted, unless it has successfully met requirements of Rule 2.13 of ASME A17.1.
- D. Wiring installed from the hoistway riser to each door interlock shall be NEC type (SF-2), or equivalent.
 - 1. Type SF-2 cable terminations in the interlock housing shall be sleeved with glass braid fillers, or asbestos braid jackets.
- E. Provide devices, either mechanical or electrical, which shall prevent operation of the elevator in event an accident to or defective door operator equipment has permitted an independent car or hoistway door panel to remain in the "unclosed" or "unlocked" position.

2.35 CAR FRAME

Car frame shall conform with requirements of ASME A17.1, and constructed of steel plates and structural shapes securely riveted, bolted, or welded together. No iron casting will be permitted. The entire assembly shall be rugged construction, and amply braced to withstand unequal loading of platform. Car frame members shall be such as to relieve the car enclosure of all strains. Balance car front to back and side to side. Provide balancing weights and frames, properly located, to achieve the required true balance.

2.36 CAR PLATFORM FOR PASSENGER ELEVATORS

- A. Construct the car platform so as to comply with all the requirements of ASME A17.1. Provide car entrances with extruded aluminum sill or better with machined or extruded guide grooves. Cover underside and all

exposed edges of wood filled platform with black sheet iron of not less than 27 gauge, with all exposed joints and edges folded under. Fire resistant paint is not acceptable. Platform shall have flexible vinyl composition tile flooring not less than 3 mm (1/8 inch) thick. For color, see Section 09 06 00, SCHEDULE FOR FINISHES. Adhesive material shall be type recommended by manufacturer of tile. Lay tile flush with threshold plate and coved base. Equip platform with 533 mm (21 inch deep sheet-steel toe-guard apron of not less than 12 gauge at hoistway entrance side. Extend at least three-inches beyond each side of entrance jamb. Securely brace toe-guard apron to car construction, and bevel bottom edge at not less than 60 degree angle nor more than 75 degree angle from horizontal. Install platform in the hoistway, so that the clearance between front edge and landing threshold shall not exceed 32 mm (1 1/4-inches).

- B. Provide sound and vibration isolator of neoprene or other resilient material in compression, which will resist oil and aging, in conjunction with platform steel platen. Provide buffer strike plates securely fastened to car frame plank or bolster.
- C. Provide grounding connection between piston and underside of platform or car frame.

2.37 CAR ENCLOSURE FOR PASSENGER ELEVATORS

- A. Car enclosure for passenger and service elevators shall have a minimum dome height inside the cab of 2440 mm (8 feet).
- B. Securely fasten car enclosure to platform by through bolts located at intervals of not more than 457 mm (18 inches), running through an angle at the base of panels to underside of platform. Provide 6 mm (1/4 inch) bolts with nuts and lock washers.
- C. Front return wall panel, entrance columns, rear corner columns, entrance head, jamb and transom shall be 14 gauge stainless steel. Side and rear wall panels 1220 mm (48 inches) from finished floor to top of panel shall be 14 gauge stainless steel. Side and rear panels from 1220 mm (48 inches) above finished floor up to and including the canopy shall be 14 gauge cold rolled steel covered with high pressure plastic laminate. Apply the plastic laminate to a minimum thickness of 15 mm (5/8 inch) particle board that meets ASME and Federal requirements. Submit a method of fastening particle board to steel. This particle board shall be one piece on back and sides. It shall be flush with the face of the bottom section of the stainless steel. Plastic laminate

shall comply with Federal Spec. L-P-508, Style Type 1, Class 1. Color is specified in Section 09 06 00, SCHEDULE FOR FINISHES. Interior shall be flush panel construction with angles welded on exterior to insure adequate rigidity. Coat exterior of panels with mastic sound insulation material approximately 2.5 mm (3/32-inch) thick followed by a prime coat. Mastic material shall conform to ASTM E1042. Stainless steel wainscot and wall panels above shall be radius "vee" joint with ends of panels turned to exterior and bolted together.

1. Face side and rear wall panels above the stainless steel wainscot with high pressure plastic laminate. Smooth and flush all joints with no ragged or broken edges. Plastic laminate shall comply with NEMA LD3, textured finish, general purpose type, grade designation GP 50, 0.050-inch thickness, except with a minimum wear resistance of 1200 cycles, and backer sheet, grade designation BK 20, .51 mm (0.020-inch) thickness. For color and finish of plastic laminate see Section 09 06 00, SCHEDULE FOR FINISHES.
- D. Provide a hinged top emergency exit to conform to ASME A17.1. Exit shall be unobstructed when open, and shall have a mechanical and electrical stop. Provide contacts to prevent operation of the elevator when the emergency exit is open.
- E. Locate car position indicator in main car operating panel.
- F. Provide duplex, GFCI protected type receptacle in car. Locate flush-mounted receptacle on the centerline of the main car operating panel, 6-inches above the car floor. The receptacle shall be in accordance with Fed. Spec. W-C-596, 2-pole, 3-wire grounded type rated for 15 amperes and 125 volts. Receptacle face plate stainless steel, and if removable, fasten with white metal tamperproof spanner head or bristol head screws. Receptacle shall permit current to flow only while a standard plug is in the proper position in the receptacle.
- G. Construct canopy of not less than 12 gauge steel.
- H. Provide car lighting with indirect fluorescent, lamps mounted above lighting coves along each side of cab, front to back. Ballasts for fluorescent fixtures shall be rapid starting type, UL Class P with a power factor not less than 90 percent. Sound ratings shall be "A", except for ballast sizes which are not available with "A" ratings as standard products of any manufacturer. Such ballast shall have the quietest ratings available. Equip the fluorescent fixtures with a symmetrical reflector having specular ALZAK (or equal) finish.

Maintain light level at a minimum 20 foot candles. Enclose the entire vertical space between the light trough outer edge and the cab canopy with approved clear plastic sheeting. Install the plastic sheets so that they are removable for cleaning and relamping.

- I. Provide a blower unit arranged to exhaust through an opening in the canopy. Provide a stainless or chrome plated fan grill around the opening. Provide 2-speed type unit, capable of rated free delivery air displacement of approximately 380 and 700 cfm at respective speed. Mount unit on top of car with rubber isolation to prevent transmission of vibration to car structure. Provide screening over exhaust end of blower. Provide a 3-position switch to control the unit in main car operating panel.
- J. Car enclosure base shall be of 14-gauge stainless steel, 150 mm (6 inches) high. Provide straight type base at front return sides, and rear of car. Vertical face of base at sides and rear shall be flush with, or recessed behind, the wainscot directly above the base. Base shall be not less than 14 gauge. There shall be no exposed fastenings in base. Provide a series of baffled openings around the base of the enclosure which shall provide a minimum area of 450 square mm (18 square inches) and a maximum area of 610 square mm (24 square inches).
- K. Provide car enclosure with double handrails of solid stainless steel, not less than 75 mm (3 inches) wide by 9 mm (3/8 inch) thick. Locate handrails approximately 38 mm (1 1/2-inches) from cab wall. Install handrails on two sides and rear. Curve ends of handrails to wainscoting. Conceal all handrail fastenings, and handrails shall be removable from inside the car enclosure. The centerlines of the handrails shall be 75 mm and 1050 mm (30 and 42 inches) above the car floor.
- L. Provide car entrance with two-speed side opening horizontal sliding car doors. Construct door panels to be flush hollow metal construction, not less than 25 mm (1 inch) thick, consisting of not less than one piece continuous 16 gauge stainless steel on car side face and leading and trailing edges. Separate the two plates by a sound-deadening material, and reinforce by steel shapes welded to the plates at frequent intervals. Reinforce panels as required for installation of hangers, power-operating and door-opening devices. Hang doors on two-point suspension hangers having ball-bearing sheaves not less than 75 mm (3 inches) in diameter, with rubber or non-metallic sound-reducing tires.

Equip hangers with adjustable ball-bearing rollers to take upward thrust of panels. Upthrust roller shall be capable of being locked in position after adjustment to a maximum of 0.015-inch clearance. Provide two non-metallic gibs on each door panel. Gibs shall be replaceable without removal of door panel.

- M. Provide a permanently attached stainless steel capacity plate on elevator. Capacity plate shall be conspicuously located on the front return panel containing the main car-operating panel. Plate shall show the rated load of the elevator in pounds, with engraved or cast letters not less than 6 mm (1/4 inch) high. Fill engraved letters with black paint. The capacity may be engraved in the main car-operating panel faceplate, in lieu of a separate capacity plate.
- N. Provide an emergency car lighting system on each car, consisting of a rechargeable battery, charger, controls, and light fixture. The system shall automatically provide emergency light in the car upon failure or abnormal interruption of the normal car lighting service, and function irrespective of the position of the light control switch in the car. The system shall be capable of maintaining a minimum illumination of 1.0 foot-candle when measured four feet above the car floor, and approximately one foot in front of the car operating panel, for a period of not less than four hours. The emergency light shall be located in the main car operating panel.
- O. A constant pressure switch that automatically returns to the "OFF" position when released, and a pilot light, for the periodic testing of battery and lamps, shall be provided.

2.38 AUTO DIAL PHONE SYSTEM

- A. Furnish and install a complete intercommunication system, as part of this work.
- B. The auto dial system shall be located in the auxiliary car operating panel. The speaker and unit shall be mounted on the backside of the perforated stainless steel plate cover.
- C. An auto dial system shall be provided for each elevator. The auto dial, when activated by the "PUSH TO TALK" button, shall automatically dial to the 24 hour area.
- D. Each elevator shall have an individual phone number.

PART 3 - EXECUTION**3.1 PREPARATION**

- A. Examine work of other trades on which the work of this Section depends. Report defects to COTR in writing which may affect the work of this trade or equipment operation, dimensions from site for preparation of shop drawings.
- B. Ensure that shafts and openings for moving equipment are plumb, level and in line, and that pit is to proper depth, waterproofed and drained with necessary access doors, ladder, guard.
- C. Ensure that machine room is properly illuminated, heated and ventilated, and equipment, foundations, beams correctly located complete with floor and access door.
- D. Before fabrication, take necessary job site measurements, and verify where work is governed by other trades. Check measurement of space for equipment, and means of access for installation and operation. Obtain dimensions from site for preparation of shop drawings.
- E. Ensure the following preparatory work, provided under other Sections, has been properly completed to receive the elevator work:
 - 1. Supply of electric feeder wires to the terminals of the elevator control panel, including shunt trip circuit breaker. Provision of hoistway outlets for car light and for light in the pit and outlets in machine room for light. Furnishing of electric power for testing and adjusting elevator equipment.
 - 2. Furnish circuit breaker panel in machine room for car and hoistway lights and receptacles.
 - 3. Supply of power for emergency cab lighting and ventilation from a power panel specified in Division 26, ELECTRICAL and fed by building emergency circuits.
 - 4. Machine room enclosed and protected from moisture, with self closing, self locking door.
 - 5. Provide fire extinguisher in machine room.
- F. Supply in ample time for installation by other trades, inserts, anchors, bearing plates, brackets, supports and bracing including all setting templates and diagrams for placement.

3.2 INSTALLATION

- A. Perform work with competent mechanics skilled in this work and under the direct control and supervision of the elevator manufacturer's experienced foreman.

- B. Set hoistway entrances in alignment with car openings, and true with plumb sill lines.
- C. Install machinery, guides, controls, car and all equipment and accessories in accordance with manufacturer's instructions, applicable codes, and standards, to provide a quiet, smooth operating installation, free from side sway, oscillation or vibration.
- D. Isolate and dampen machine vibration with properly sized sound-reducing anti-vibration pads.
- E. Erect hoistway sills, headers and frames prior to erection of rough walls and doors. Erect fascias and toe guards after rough walls are finished.
- F. Grout sills and hoistway entrance frames.

3.3 CLEANING

Prior to final acceptance, remove protection from finished or ornamental surfaces, and clean and polish surfaces with due regard to type of material.

3.4 SPACE CONDITIONS

- A. Attention is called to overhead clearance, pit clearances, overall space in machine room, and construction conditions at building site in connection with elevator work. Addition or revision of space requirements, or construction changes that may be required for the complete installation of the elevators, must be arranged for and obtained by the Contractor, subject to approval of COTR. Include cost of such changes in bid, and form a part of the contract. Provide proper, satisfactory code legal installation of equipment as a whole, including all construction, accessories and devices in connection with elevator, mechanical and electrical work specified herein.
- B. Where concrete beams, floor slabs or other building construction protrude more than 50 mm (2 inches) into hoistway, bevel all top surfaces of said projections 20 gauge steel to an angle of at least seventy-five degrees with the horizontal.

3.5 ARRANGEMENT OF EQUIPMENT

- A. Clearance around elevator, mechanical and electrical equipment shall comply with applicable provisions of NEC.
- B. Arrange equipment in machine room so that major equipment components can be removed for repair or replacement, without dismantling or removing other equipment in same machine room.

- C. Where applicable, locate controller near and visible to its respective pump unit.

3.6 WORKMANSHIP AND PROTECTION

- A. All installations shall be made in a first class, neat and skillful manner by mechanics experienced in the trade involved. Mechanically and electrically correct all details of the installation. All materials and equipment shall be new, and without imperfections.
- B. Include recesses, cutouts, slots, holes, patching, grouting, refinishing and the like, to accommodate installation of equipment in the elevator contractor's work. Core drill all new holes in concrete.
- C. No structural members shall be cut or altered. Restore work in place, which has been damaged or defaced, equal to original condition.
- D. Finish work shall be straight, level and plumb, with true, sharp surfaces and lines. Protect all machinery and equipment against dirt, water or mechanical injury. Thoroughly clean all work at final completion, and deliver in perfect unblemished condition.
- E. Grease gun fittings shall be pressure relief type.
- F. Completely enclose selector cables or tapes, which are exposed to accidental contact in the machine room with 16 gauge sheet metal or expanded metal guards.
- G. Guard exposed gears, sprockets, selector drums, etc. from accidental contact, in accordance with Rule 2.10.1 of ASME A17.1.

3.7 PAINTING AND FINISHING

- A. Elevator equipment shall be factory painted with manufacturer's standard finish and color.
 - 1. Elevator pump unit, controllers, and crossheads of cars shall be identified by 100 mm (4 inch) high numerals and letters located as directed. Color of numbers shall contrast with color surfaces to which they are applied.
 - 2. Surface (except contact surfaces of working parts) of elevator items, such as, controllers, car frame, underside of platforms, guide rails, rail brackets, all uncoated ferrous metal items and hydraulic piping shall be given approved prime coat.
 - 3. Upon completion of installation and prior to final inspection, all equipment shall be thoroughly cleaned of grease oil, cement, plaster, and other debris. All equipment, except that which is otherwise specified to have factory finish, shall then be given two coats of paint of approved color.

4. Paint floor designation numbers not less than 100 mm (4 inches) high, on hoistway doors, fascias or walls as required by Rule 100.7 of ASME A17.1. The color of the paint used shall contrast with the color of the surfaces to which it is applied.
- B. Hoistway entrances of passenger and service elevators:
1. Door panels shall be parkerized or given equivalent rust resistant treatment and a factory finish of one coat of baked on primer and one factory finish coat of baked on enamel, unless stainless steel.
 2. Fascia plates, toe guards, dust covers, hanger covers and other metal work, including built-in or hidden work and structural metal, (except stainless steel entrance frames and surfaces to receive baked enamel finish) shall be given approved prime coat in the shop, and one field coat of paint of approved color.
- C. Hoistway entrances of freight elevators:
1. Metal surfaces of doors and frames shall receive approved shop prime coat.
 2. Finish painting, after erection, shall be one coat of paint of approved color. For color, see Section 09 06 00, SCHEDULES FOR FINISHES.
- D. Elevator cabs for passenger and service elevators:
1. Interior and exterior steel surfaces shall be parkerized or given equivalent rust resistant treatment before finish is applied.
 2. Factory finish interior steel surfaces with one coat of baked on enamel or proxylin lacquer. For color, see Section 09 06 00, SCHEDULES FOR FINISHES.
 3. Give exterior faces of car doors one finish coat of oil base paint of medium gray color.
- E. Elevator cabs for freight elevators:
1. Give interior of cab one approved prime coat and a minimum of one coat of oil based enamel. For color, see Section 09 06 00, SCHEDULES FOR FINISHES.
 2. Give exterior of cab one approved prime coat and one finish coat of an approved oil base paint.
 3. Surfaces of door frames, door panels, interior cab surfaces, etc., that become damaged or marred from any cause shall be restored to original condition in a satisfactory manner before final acceptance of work.

3.8 PRE-TESTS AND TEST

- A. Pre-test as per specifications, the elevators and related equipment, in the presence of the COTR. Test for proper operation before requesting final inspection. Conduct final inspection at other than normal working hours, if required by the COTR. Test elevators as specified in the presence of, and under the direction of, the COTR. Procedure outlined in the "Inspectors' Manual for Hydraulic Elevators ASME A17.2 shall apply.
- B. Upon completion of elevator installation, conduct operating and car testing for approval of COTR. Furnish test instruments and materials, including properly marked test weights, voltmeters, amp probe, sound level meter, centigrade thermometers, light meter, stop watch, MEGGER, pressure gauges, direct reading tachometer for making tests and a means of two-way communication. Conduct tests in the presence of, and witnessed by, a QEI certified elevator inspector.
- C. Speed Load Runs: Speed test with no load, 50 percent load, and contract load shall be made in both directions, before the full load run test and after the full load test.
- D. Full Load Run Test: Subject the elevator to a test for a period of one hour continuous run, with specified full load in the car. During test run, stop the car at all floors in both directions of travel, for a standing period of not less than eight nor more than twelve seconds per floor. Elevator starting, stopping, acceleration and deceleration shall remain consistent during the test.
- E. Temperature Rise Test: Test motors during Full Load Run Test to demonstrate that the temperature rise under operating conditions in the building will not exceed 40 degrees C, above ambient, when measured with a thermometer or other approved means. Do not make full load run tests until constant temperatures are reached on all such pieces of equipment.
- F. For installations where microprocessor controls are used:
 - 1. A diagnostic testing device, maintenance terminal or approved means of diagnostic and maintenance suitable for all trouble shooting procedures related to the specific type microprocessor controls installed on this project, shall be provided. This diagnostic testing device or maintenance terminal shall conform to the following:

- a. The diagnostic testing device or maintenance terminal shall become the property of the Veteran's Administration.
 - b. The diagnostic testing device or maintenance terminal shall be demonstrated and tested during the final testing of the elevator installation.
 - c. A series of not less than ten simulated malfunctions shall be diagnosed properly by the device.
 - d. A period of at least four hours shall be dedicated to the instruction of its use to a representative of the Department of Veterans Affairs designated by the COTR.
 - e. The diagnostic testing device shall be programmed specifically for this job and this job only.
 - f. The device shall not require recalibration or reconfiguration and shall be functional for the life of the equipment specified herein.
- G. Car Leveling Test: Test elevator car leveling device for accuracy of leveling at all floors with no load, 50 percent load, and full load in car, in both directions of travel before and after temperature test. Accuracy of floor leveling, as specified, shall be within plus or minus 3 mm (1/8 inch) of level with any landing floor for which the stop has been initiated (with a definite range of distance in advance of the landing), regardless of load in car or direction of travel. The car leveling device shall automatically correct over travel as well as under travel, and shall maintain the car floor within plus or minus 3 mm (1/8 inch) of level with the landing floor regardless of change in load.
- H. Setting of the Car-Door Contacts: Measure the position of the car door at which the car may be started. The distance from full closure shall not exceed that required by ASME A17.1. This test shall be made with the hoistway doors closed, or the hoistway door contact inoperative.
- I. Setting of Interlocks: Measure the position of the hoistway door at which the car may be started. And shall not exceed ASME A17.1 requirements.
- J. Overload Devices: Test all overload current protection devices in the system at final inspection.
- K. Operating and Signal Systems: Operate the car by the operating devices provided. The operation, signals, and automatic floor leveling shall function in accordance with the requirements specified. Starting,

stopping and leveling shall be smooth and comfortable, without bumps or jars.

- L. Working Pressure: Verify working pressure of the hydraulic system by pressure gauges placed in the system line. Take readings in the machine room with no load, 50 percent load, balanced load and full load in car.
- M. Test automatic shutoff valve for proper operation.
- N. Insulation Resistance: Elevator's complete wiring system shall be free from short circuits and grounds; and the insulation resistance for the system shall be determined by use of MEGGER.
- O. Evidence of malfunction in any tested system or parts of equipment or component part thereof that occurs during, or as a result of, the tests, shall be corrected, repaired, or replaced at no additional cost to the Government, and the test repeated.
- P. If any equipment fails test requirements and a reinspection is required, the Contractor shall be responsible for the cost of reinspection including salaries, transportation expenses and other expenses incurred by the representatives of the Contracting Officer.

3.9 INSTRUCTION OF PERSONNEL

- A. Provide competent instructors to train Veteran's Administration personnel in care and operation of all parts of equipment. Instruction on hydraulic elevator installation shall be given during regular working hours. Instruction shall commence upon completion of all work required and upon initial operation before final acceptance of work. Instructors shall be qualified representatives, possessing complete knowledge of equipment.
- B. Instructors shall be available for one 8-hour working day minimum, with instruction period directed by the COTR.
- C. In addition to oral instruction, written instructions in triplicate relative to care and operation of all parts of equipment shall be furnished and delivered to the COTR in independently bound folders. Video cassette recording will also be acceptable. Written instructions shall include complete, correct and legible wiring diagrams, nomenclature sheets of all electrical apparatus, including location of each device, complete and comprehensive sequence of operations, complete parts lists with descriptive literature and identification, diagrammatic cuts of equipment and parts, etc. Information shall also include electrical operating characteristics of all circuits, fields,

relays, timers and electronic devices, as well as RPM values and related characteristics for all rotating equipment. Provide any supplementary instructions for adjustment and care of new equipment as may become necessary due to changes, modifications and/or replacement of equipment or its operation, under requirements of paragraph entitled, "Warranty of Construction".

3.10 INSPECTIONS AND MAINTENANCE

- A. Furnish complete maintenance and inspection service on entire elevator installation for a period of (1) one year after completion and acceptance of the elevator installation by the COTR. This maintenance service shall begin concurrently with the warranty. Maintenance work shall be performed by skilled elevator personnel directly employed and supervised by the same company that furnished and installed the elevator equipment specified herein.
- B. The maintenance service shall include the following:
 - 1. Bi-weekly systematic examination of equipment.
 - 2. Cleaning, lubricating, adjusting, repairing and replacing of all parts as necessary to keep the equipment in first class condition and proper working order.
 - 3. Furnishing all lubricant, cleaning materials and parts required.
 - 4. The performance standards set forth in this specification, including flight time, cycle time, and door times shall be maintained at all times.
 - 5. The operational system shall be maintained to the standards specified hereinafter including any changes or adjustments required to meet varying conditions of hospital occupancy.
 - 6. Maintain smooth starting and stopping and accurate leveling at all times.
- C. Maintenance service shall not include the performance of any work required as a result of improper use, accidents, or negligence for which the contractor is not directly responsible.
- D. Provide 24 hour emergency call-back service which shall consist of promptly responding to calls within two hours for emergency service should a shutdown or emergency trouble develop between regular examinations. Overtime emergency call-back service shall be limited to minor adjustments and repairs required to protect the immediate safety of the equipment and persons in and about the elevator.

- E. Service and emergency personnel shall report to the COTR or his authorized representative upon arrival at the hospital and again upon completion of the required work. A copy of the work ticket containing a complete description of the work performed shall be given to the COTR.
- F. The contractor shall maintain a log in the machine room. The log shall list the date and time of all weekly examinations and all trouble calls. Each trouble call shall be fully described including the nature of the call, necessary correction performed or parts replaced.

- - - E N D - - -

**SECTION 21 05 11
COMMON WORK RESULTS FOR FIRE SUPPRESSION**

PART 1 - GENERAL

1.1 DESCRIPTION

- A. The requirements of this Section apply to all sections of Division 21.
- B. Definitions:
 - 1. Exposed: Piping and equipment exposed to view in finished rooms.
 - 2. Option or optional: Contractor's choice of an alternate material or method.

1.2 RELATED WORK

- A. Section 01 00 00, GENERAL REQUIREMENTS.
- B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- C. Excavation and Backfill: Section 31 20 00, EARTH MOVING.
- D. Concrete and Grout: Section 03 30 00, CAST-IN-PLACE CONCRETE.
- E. Building Components for Attachment of Hangers: Section 05 36 00, COMPOSITE METAL DECKING.
- F. Section 05 50 00, METAL FABRICATIONS.
- G. Section 07 84 00, FIRESTOPPING.
- H. Flashing for Wall and Roof Penetrations: Section 07 60 00, FLASHING AND SHEET METAL.
- I. Section 07 92 00, JOINT SEALANTS.
- J. Section 09 91 00, PAINTING.

1.3 QUALITY ASSURANCE

- A. Products Criteria:
 - 1. Standard Products: Material and equipment shall be the standard products of a manufacturer regularly engaged in the manufacture of the products for at least 3 years. See other specification sections for any exceptions.
 - 2. Equipment Service: Products shall be supported by a service organization which maintains a complete inventory of repair parts and is located reasonably close to the site.
 - 3. Multiple Units: When two or more units of materials or equipment of the same type or class are required, these units shall be products of one manufacturer.
 - 4. Assembled Units: Manufacturers of equipment assemblies, which use components made by others, assume complete responsibility for the final assembled product.

5. Nameplates: Nameplate bearing manufacturer's name or identifiable trademark shall be securely affixed in a conspicuous place on equipment, or name or trademark cast integrally with equipment, stamped or otherwise permanently marked on each item of equipment.
 6. Asbestos products or equipment or materials containing asbestos shall not be used.
- B. Manufacturer's Recommendations: Where installation procedures or any part thereof are required to be in accordance with the recommendations of the manufacturer of the material being installed, printed copies of these recommendations shall be furnished to the Contracting Officer's Technical Representative (COTR) prior to installation. Installation of the item will not be allowed to proceed until the recommendations are received. Failure to furnish these recommendations can be cause for rejection of the material.
- C. Guaranty: In GENERAL CONDITIONS.
- D. Supports for sprinkler piping shall be in conformance with NFPA 13.
- E. Supports for standpipe shall be in conformance with NFPA 14.

1.4 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturer's Literature and Data: Submit under the pertinent section rather than under this section.
1. Equipment and materials identification.
 2. Fire-stopping materials.
 3. Hangers, inserts, supports and bracing. Provide load calculations for variable spring and constant support hangers.
 4. Wall, floor, and ceiling plates.
- C. Coordination Drawings: Provide detailed layout drawings of all piping systems.
- D. Maintenance Data and Operating Instructions:
1. Maintenance and operating manuals in accordance with Section 01 00 00, GENERAL REQUIREMENTS, Article, INSTRUCTIONS, for systems and equipment.
 2. Provide a listing of recommended replacement parts for keeping in stock supply, including sources of supply, for equipment. Include in the listing belts for equipment.

1.5 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American Society for Testing and Materials (ASTM):
 - A36/A36M-2001.....Carbon Structural Steel
 - A575-96.....Steel Bars, Carbon, Merchant Quality, M-Grades R (2002)
 - E84-2003.....Standard Test Method for Burning Characteristics of Building Materials
 - E119-2000.....Standard Test Method for Fire Tests of Building Construction and Materials
- C. National Fire Protection Association (NFPA):
 - 90A-96.....Installation of Air Conditioning and Ventilating Systems
 - 101-97.....Life Safety Code

PART 2 - PRODUCTS

2.1 LIFTING ATTACHMENTS

Provide equipment with suitable lifting attachments to enable equipment to be lifted in its normal position. Lifting attachments shall withstand any handling conditions that might be encountered, without bending or distortion of shape, such as rapid lowering and braking of load.

2.2 ELECTRIC MOTORS

- A. Section 21 05 12, GENERAL MOTOR REQUIREMENTS FOR FIRE-SUPPRESSION EQUIPMENT, specifies the applicable requirements for electric motors. Provide special energy efficient motors as scheduled. Unless otherwise specified for a particular application use electric motors with the following requirements.
- B. Single-phase Motors: Capacitor-start type for hard starting applications. Motors for centrifugal fans and pumps may be split phase or permanent split capacitor (PSC).
- C. Poly-phase Motors: NEMA Design B, Squirrel cage, induction type. Each two-speed motor shall have two separate windings. Provide a time- delay (20 seconds minimum) relay for switching from high to low speed.
- D. Rating: Continuous duty at 100 percent capacity in an ambient temperature of 40 degrees centigrade (104 degrees F); minimum

horsepower as shown on drawings; maximum horsepower in normal operation not to exceed nameplate rating without service factor.

- E. Insulation Resistance: Not less than one-half meg-ohm between stator conductors and frame, to be determined at the time of final inspection.

2.3 EQUIPMENT AND MATERIALS IDENTIFICATION

- A. Use symbols, nomenclature and equipment numbers specified, shown on the drawings and shown in the maintenance manuals. Identification for piping is specified in Section 09 91 00, PAINTING.
- B. Interior (Indoor) Equipment: Engraved nameplates, with letters not less than 48 mm (3/16-inch) high of brass with black-filled letters, or rigid black plastic with white letters specified in Section 09 91 00, PAINTING permanently fastened to the equipment. Identify unit components such as coils, filters, fans, etc.
- C. Exterior (Outdoor) Equipment: Brass nameplates, with engraved black filled letters, not less than 48 mm (3/16-inch) high riveted or bolted to the equipment.
- D. Control Items: Label all temperature and humidity sensors, controllers and control dampers. Identify and label each item as they appear on the control diagrams.
- E. Valve Tags and Lists:
 - 1. Valve tags: Engraved black filled numbers and letters not less than 13 mm (1/2-inch) high for number designation, and not less than 6.4 mm (1/4-inch) for service designation on 19 gage 38 mm (1-1/2 inches) round brass disc, attached with brass "S" hook or brass chain.
 - 2. Valve lists: Typed or printed plastic coated card(s), sized 216 mm (8-1/2 inches) by 280 mm (11 inches) showing tag number, valve function and area of control, for each service or system. Punch sheets for a 3-ring notebook.
 - 3. Provide detailed plan for each floor of the building indicating the location and valve number for each valve. Identify location of each valve with a color coded thumb tack in ceiling.

2.4 FIRESTOPPING

Section 07 84 00, FIRESTOPPING specifies an effective barrier against the spread of fire, smoke and gases where penetrations occur for piping.

2.5 GALVANIZED REPAIR COMPOUND

Mil. Spec. DOD-P-21035B, paint form.

2.6 PIPE PENETRATIONS

- A. Install sleeves during construction for other than blocked out floor openings for risers in mechanical bays.
- B. To prevent accidental liquid spills from passing to a lower level, provide the following:
 - 1. For sleeves: Extend sleeve 25 mm (one inch) above finished floor and provide sealant for watertight joint.
 - 2. For blocked out floor openings: Provide 40 mm (1-1/2 inch) angle set in silicone adhesive around opening.
 - 3. For drilled penetrations: Provide 40 mm (1-1/2 inch) angle ring or square set in silicone adhesive around penetration.
- C. Penetrations are not allowed through beams or ribs, but may be installed in concrete beam flanges. Any deviation from this requirement must receive prior approval of COTR.
- D. Sheet Metal, Plastic, or Moisture-resistant Fiber Sleeves: Provide for pipe passing through floors, interior walls, and partitions, unless brass or steel pipe sleeves are specifically called for below.
- E. Cast Iron or Zinc Coated Pipe Sleeves: Provide for pipe passing through exterior walls below grade. Make space between sleeve and pipe watertight with a modular or link rubber seal. Seal shall be applied at both ends of sleeve.
- F. Galvanized Steel or an alternate Black Iron Pipe with asphalt coating Sleeves: Provide for pipe passing through concrete beam flanges, except where brass pipe sleeves are called for. Provide sleeve for pipe passing through floor of mechanical rooms, laundry work rooms, and animal rooms above basement. Except in mechanical rooms, connect sleeve with floor plate.
- G. Brass Pipe Sleeves: Provide for pipe passing through quarry tile, terrazzo or ceramic tile floors. Connect sleeve with floor plate.
- H. Sleeves are not required for wall hydrants for fire department connections or in drywall construction.
- I. Sleeve Clearance: Sleeve through floors, walls, partitions, and beam flanges shall be one inch greater in diameter than external diameter of pipe. Sleeve for pipe with insulation shall be large enough to accommodate the insulation. Interior openings shall be caulked tight with fire stopping material and sealant to prevent the spread of fire, smoke, and gases.

J. Sealant and Adhesives: Shall be as specified in Section 07 92 00, JOINT SEALANTS.

2.7 TOOLS AND LUBRICANTS

- A. Furnish, and turn over to the COTR, special tools not readily available commercially, that are required for disassembly or adjustment of equipment and machinery furnished.
- B. Grease Guns with Attachments for Applicable Fittings: One for each type of grease required for each motor or other equipment.
- C. Tool Containers: Hardwood or metal, permanently identified for intended service and mounted, or located, where directed by the COTR.
- D. Lubricants: A minimum of 0.95 L (one quart) of oil, and 0.45 kg (one pound) of grease, of equipment manufacturer's recommended grade and type, in unopened containers and properly identified as to use for each different application.

2.8 WALL, FLOOR AND CEILING PLATES

- A. Material and Type: Chrome plated brass or chrome plated steel, one piece or split type with concealed hinge, with set screw for fastening to pipe, or sleeve. Use plates that fit tight around pipes, cover openings around pipes and cover the entire pipe sleeve projection.
- B. Thickness: Not less than 2.4 mm (3/32-inch) for floor plates. For wall and ceiling plates, not less than 0.64 mm (0.025-inch) for up to 80 mm (3-inch pipe), 0.89 mm (0.035-inch) for larger pipe.
- C. Locations: Use where pipe penetrates floors, walls and ceilings in exposed locations, in finished areas only. Use also where insulation ends on exposed water supply pipe drop from overhead. Provide a watertight joint in spaces where brass or steel pipe sleeves are specified.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Coordinate location of piping, sleeves, inserts, hangers, and equipment. Locate piping, sleeves, inserts, hangers, and equipment clear of windows, doors, openings, light outlets, and other services and utilities. Follow manufacturer's published recommendations for installation methods not otherwise specified.
- B. Protection and Cleaning:
 - 1. Equipment and materials shall be carefully handled, properly stored, and adequately protected to prevent damage before and during installation, in accordance with the manufacturer's recommendations

- and as approved by the COTR. Damaged or defective items in the opinion of the COTR, shall be replaced.
2. Protect all finished parts of equipment, such as shafts and bearings where accessible, from rust prior to operation by means of protective grease coating and wrapping. Close pipe openings with caps or plugs during installation. Tightly cover and protect equipment against dirt, water chemical, or mechanical injury. At completion of all work thoroughly exposed materials and equipment.
- C. Concrete and Grout: Use concrete and shrink compensating grout 25 MPa (3000 psi) minimum, specified in Section 03 30 00, CAST-IN-PLACE CONCRETE.
- D. Install gages, valves, and other devices with due regard for ease in reading or operating and maintaining said devices. Locate and position gages to be easily read by operator or staff standing on floor or walkway provided. Servicing shall not require dismantling adjacent equipment or pipe work.
- E. Work in Existing Building:
1. Perform as specified in Article, OPERATIONS AND STORAGE AREAS, Article, ALTERATIONS, and Article, RESTORATION of the Section 01 00 00, GENERAL REQUIREMENTS for relocation of existing equipment, alterations and restoration of existing building(s).
 2. As specified in Section 01 00 00, GENERAL REQUIREMENTS, Article, OPERATIONS AND STORAGE AREAS, make alterations to existing service piping at times that will least interfere with normal operation of the facility.
 3. Cut required openings through existing masonry and reinforced concrete using diamond core drills. Use of pneumatic hammer type drills, impact type electric drills, and hand or manual hammer type drills, will be permitted only with approval of the COTR. Locate openings that will least effect structural slabs, columns, ribs or beams. Refer to the COTR for determination of proper design for openings through structural sections and opening layouts approval, prior to cutting or drilling into structure. After COTR's approval, carefully cut opening through construction no larger than absolutely necessary for the required installation.
- F. Switchgear Drip Protection: Every effort shall be made to eliminate the installation of pipe above electrical and telephone switchgear. If this is not possible, encase pipe in a second pipe with a minimum of joints.

G. Inaccessible Equipment:

1. Where the Government determines that the Contractor has installed equipment not conveniently accessible for operation and maintenance, equipment shall be removed and reinstalled or remedial action performed as directed at no additional cost to the Government.
2. The term "conveniently accessible" is defined as capable of being reached without the use of ladders, or without climbing or crawling under or over obstacles such as motors, fans, pumps, belt guards, transformers, high voltage lines, piping, and ductwork.

3.2 MOTOR AND DRIVE ALIGNMENT

- A. Belt Drive: Set driving and driven shafts parallel and align so that the corresponding grooves are in the same plane.
- B. Direct-connect Drive: Securely mount motor in accurate alignment so that shafts are free from both angular and parallel misalignment when both motor and driven machine are operating at normal temperatures.

3.3 LUBRICATION

Field check and lubricate equipment requiring lubrication prior to initial operation.

3.4 STARTUP AND TEMPORARY OPERATION

Start up equipment as described in equipment specifications. Verify that vibration is within specified tolerance prior to extended operation. Temporary use of equipment is specified in Section 01 00 00, GENERAL REQUIREMENTS, Article, TEMPORARY USE OF MECHANICAL AND ELECTRICAL EQUIPMENT.

3.5 OPERATING AND PERFORMANCE TESTS

- A. Prior to the final inspection, perform required tests as specified in Section 01 00 00, GENERAL REQUIREMENTS, Article, TESTS and submit the test reports and records to the COTR.
- B. Should evidence of malfunction in any tested system, or piece of equipment or component part thereof, occur during or as a result of tests, make proper corrections, repairs or replacements, and repeat tests at no additional cost to the Government.
- C. When completion of certain work or system occurs at a time when final control settings and adjustments cannot be properly made to make performance tests, then make performance tests for heating systems and for cooling systems respectively during first actual seasonal use of respective systems following completion of work.

3.6 INSTRUCTIONS TO VA PERSONNEL

Provide in accordance with Article, INSTRUCTIONS, of Section 01 00 00,
GENERAL REQUIREMENTS.

- - - E N D - - -

SECTION 21 10 00
WATER-BASED FIRE-SUPPRESSION SYSTEMS

PART 1 - GENERAL

1.1 DESCRIPTION

- A. The design and installation of a hydraulically calculated automatic fire sprinkler system complete and ready for operation, for the entire building including the penthouse, mechanical equipment rooms, attic space, elevator machine rooms, elevator pits, linen and trash chutes, and accessible shafts.
- B. The design and installation of a standpipe system combined with the sprinkler system.
- C. Installation of new sectional valves in the sprinkler system feed mains as indicated on the drawings.
- D. Replacement of all existing sprinklers. Work to include all necessary piping modifications, new sprinklers and new sprinkler escutcheons.
- E. Provide access doors or panels where control or drain valves are located behind plaster or gypsum walls or ceilings as necessary to install piping above suspended plaster or gypsum ceilings.
- F. Painting of exposed piping and supports to follow Section 09 91 00, PAINTING.

1.2 RELATED WORK

- A. Treatment of penetrations through rated enclosures: Section 07 84 00, FIRESTOPPING.
- B. Access panels for plaster ceilings: Section 08 31 13, ACCESS DOORS AND FRAMES.
- C. Painting of exposed pipe: Section 09 91 00, PAINTING.
- D. Section 21 05 11, COMMON WORK RESULTS FOR FIRE SUPPRESSION.
- E. Alarm Supervision: Section 28 31 00, FIRE DETECTION AND ALARM.
- F. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.

1.3 DESIGN CRITERIA

- A. The design, materials, equipment, installation, inspection, and testing of the automatic sprinkler system shall be in accordance with the required advisory provisions of NFPA 13. Exception to NFPA Fire Codes are as follows:
 - 1. Sprinklers are not required in interstitial areas, except along AGV track systems if the vehicle is combustible.

B. Base system design hydraulic calculations using the area/density method on the following criteria and in accordance with NFPA 13 latest edition.

1. Sprinkler Protection:

- a. All patient care, sleeping, treatment, office, waiting areas, educational areas, dining areas, corridors and attics: Light hazard, (0.10 gpm/sq. ft.) over the hydraulically most remote 140 m² (1500 sq. ft.).
- b. Patient Areas: Sprinklers with a residential listing shall be installed in accordance with their listed flows and pressures.
- c. Kitchen, Mechanical Equipment Rooms, Transformer Rooms, Electrical Switchgear Rooms, Electric Closets, Elevator Shafts (if required), Elevator Machine Rooms, Refrigeration Service Rooms, and storage between 9 and 23 m² (100 and 250 sq. ft.): Ordinary Hazard, Group 1, 6.1 L/minute/m² (0.15 gpm/sq. ft.) over the hydraulically most remote 140 m² (1500 sq. ft.).
- d. Clean and soiled linen rooms, trash rooms, clean and soiled utility rooms, laundry, laboratories, retail sales and storage rooms, storage room over 23 m² (250 sq. ft.), boiler plants, loading docks, warehouse spaces, energy centers, Pharmacy and SPD areas: Ordinary Group 2, 8.1 L/minute/m² (0.20 gpm/sq. ft.) over the hydraulically most remote 140 m² (1500 sq. ft.).
- e. File Storage Areas with "Rolling Files" Racks: Ordinary Group 2 for the entire area of the space up to 140 m² (1500 sq. ft.) area of sprinkler operation.
- f. Supply warehouse with storage height less than 3650 mm (12 ft. high): Ordinary Hazard Group 2. Storage height exceeding 3650 mm (12 ft.), per NFPA 13 latest edition.
- g. Provide sprinklers in accessible shafts per NFPA 13 latest edition.
- h. Provide sprinklers in gravity type metal chutes per NFPA 82.

2. Add water allowance of 15 L/s (250 gpm) for inside and outside hose streams to the sprinkler requirements at the connection to the distribution main.

3. Hydraulic Calculations: The calculated demand including hose stream requirements shall fall no less than 10 percent below the available supply curve.

- C. For each sprinkler zone provide a control valve, flow switch, self-contained test, drain assembly and pressure gage.
- D. Provide a separate sprinkler valve for each traction elevator machine room and other areas as required by NFPA 13 latest edition.
- E. Provide a guard for each sprinkler in the janitors closets, the elevator machine room and sprinklers within 2100 mm (7 ft.) of the floor and other areas as required by NFPA 13.

1.4 QUALIFICATIONS:

- A. Designer's Qualifications: Design work and shop drawings shall be prepared by a licensed engineer practicing in the field of Fire Protection Engineering or a NICET (National Institute for Certification in Engineering Technologies) Level III sprinkler technician.
- B. Installer's Qualifications: The installer shall possess a valid State fire protection contractor's license. The installer shall provide documentation of having successfully completed three projects of similar size and scope.
- C. On-site emergency service within six hours notification.

1.5 SUBMITTALS

- A. Submit as one package in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Sprinkler design shall be done by a certified professional. All plans shall be stamped by qualified P.E.
- C. Emergency service point of contact name and 24 hour emergency telephone number.
- D. Manufacturer's Literature and Data:
 - 1. Pipe and fittings.
 - 2. Valves
 - 3. Drips
 - 4. Fire Department Siamese Connection
 - 5. Sprinklers-each type, temperature and model
 - 6. Air Compressors
 - 7. Inspectors Test Alarm Modules
 - 8. Sprinkler Cabinets
 - 9. Sprinkler Plugs
 - 10. Pressure Gages
 - 11. Pressure Switches
 - 12. Pipe Hangers and Supports

13. Water Flow Switches
 14. Valve Tamper Switches
 15. Water Motor Alarm
 16. Double Detector Check Valve Assembly
 17. Water Measuring Device
 18. Test Header
 19. Valve Cabinet
- E. Detailed drawings in accordance with NFPA 13 the latest editions.
Drawings shall be prepared using CADD software stamped by fire protection professional engineer and include all new and existing sprinklers and piping. Use format in use at the VA medical center. Drawings are subject to change during the bidding and construction periods. Any wall and ceiling changes occurring prior to the submittal of contractors shop drawings shall be incorporated into the contractors detailed design at no additional contract cost.
- F. Hydraulic calculations for each sprinkler system in accordance with NFPA 13 latest edition.
- G. Operation and Maintenance Data:
1. Indicating Valves
 2. Water Flow and valve tamper switches
 3. Alarm Valves
 4. Pre-action Valves
 5. Air Compressor
- H. Recommended preventive maintenance schedule.

1.6 AS-BUILT DOCUMENTATION

- A. A mylar as-built drawing and two blue-line copies shall be provided for each drawing. One copy of final CADD drawing files for each drawing shall also be provided on a CD.
- B. Four sets of manufacturer's literature and data updated to include submittal review comments and any equipment substitutions.
- C. Four sets of hydraulic calculations for each sprinkler system updated to include submittal review comments and any changes to the installation which affect the calculations including one electronic set in PDF format.
- D. Four copies of the hydrostatic report and NFPA 13 material and test certificate for each sprinkler system.

- E. Four sets of operation and maintenance data updated to include submittal review comments and any equipment substitutions including one copy of NFPA 25.
- F. Manufacturers literature, hydraulic calculations, reports and operation and maintenance data shall be in a labeled 3-ring binder.

1.7 WARRANTY

- A. All work performed and materials and equipment furnished under this contract shall be free from defects for a period of one year from date of acceptance by the government.
- B. All new piping and equipment incorporated into the new system shall be hydrostatically tested and warranted as new.

1.8 APPLICABLE PUBLICATIONS

- A. Publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. National Fire Protection Association (NFPA)
 - 13-2002.....Installation of Sprinkler Systems
 - 14-2003.....Installation of Standpipe and Hose Systems
 - 17A-2002.....Standard for wet chemical extinguishing systems
 - 24-2002.....Installation of Private Fire Service Mains and
Their Appurtenances
 - 25-2004.....Inspection, Testing and Maintenance of water
Based Fire Protection Systems
 - 70-2004.....National Electrical Code
 - 72-2002.....National Fire Alarm Code
 - 82-2004.....Incinerators, Waste and Linen Handling Systems
and Equipment
 - 170-2005.....Standards for Fire Safety Symbols
 - 291-2002.....Fire Flow Testing and Marking of Hydrants
- C. Underwriters Laboratories Inc. (UL)
 - 2006.....Fire Protection Equipment Directory
- D. Factory Mutual Engineering Corporation (FM)
 - 2006.....Approval Guide
- E. American Society for Testing and Materials (ASTM)
 - F442-99(2005).....Chlorinated Poly (Vinyl Chloride) (CPVC)
Plastic Pipe
- F. American Society of Sanitary Engineering (ASSE)
 - 1015-2005.....Double Check Backflow Prevention Assembly

- G. Complete maintenance and inspection service for sprinkler systems shall be provided by a factory trained authorized representative of the manufacturer of the major equipment for a period of one year after acceptance of the entire installation by the government.
- H. Contractor shall provide all necessary test equipment, parts and labor to perform required maintenance.
- I. All inspections, testing and maintenance work required by NFPA 13 and recommended by the equipment manufacturer shall be provided. Work shall include operation of sprinkler system alarm and supervisory devices.
- J. Maintenance and testing shall be performed on a quarterly basis. A computerized preventive maintenance schedule shall be provided and shall describe the protocol for preventive maintenance of equipment. The schedule shall include a systematic examination, adjustment, and cleaning of all equipment.
- K. Non-included Work: Maintenance service shall not include the performance of any work due to improper use, accidents or negligence for what the contractor is not responsible.
- L. Service and emergency personnel shall report to the Engineering Office or their authorized representative upon arrival at the hospital and again upon the completion of the required work. A copy of the work ticket containing a complete description of work performed and parts replaced shall be provided.
- M. Emergency Service:
 - 1. Normal and overtime emergency call-back service shall consist of an on-site response to calls within four hours of notification.
 - 2. Overtime emergency call-back service shall be limited to minor adjustments and repairs to effect the integrity of the system.

PART 2 - PRODUCTS

2.1 GENERAL

All devices and equipment shall be Underwriters Laboratories Inc. listed for their intended purpose. All sprinklers shall be Factory Mutual approved.

2.2 PIPING AND FITTINGS

- A. Pipe and fittings from inside face of building 300 mm (12 in.) above finished floor to a distance of approximately 1500 mm (5 ft.) outside building: Ductile Iron, flanged fittings and 316 stainless steel bolting.

- B. Fire Protection water supply within the building up to sprinkler system isolation valves shall be per NFPA 13.
- C. Sprinkler piping downstream of the isolation valve on wet-pipe systems shall be per NFPA 13.
- D. Sprinkler piping of a dry pipe system shall be galvanized. Schedule 40 minimum.
- E. MRI Suite: Copper.
- F. Threaded or flanged fittings shall be ANSI B1 6.3 cast iron, class 125 minimum. Threaded fittings are not permitted on pipe with wall thickness less than schedule 40.
- G. All fittings on galvanized piping shall be galvanized in accordance with ASTM A53.
- H. Slip type or clamp-on type rubber gasketed fittings shall be listed for each piping application.
- I. Piping Materials Standards:
 - 1. Ferrous piping - follow ASTM A 795 Standard
 - 2. Welded and seamless steel pipe - follow ANSI/ASTM A 53
 - 3. Wrought steel pipe - follow ANSI/ASME B36.10M
 - 4. Electric resistance welded steel pipe - follow ASTM A 135
 - 5. Seamless copper tube - follow ASTM B 75
 - 6. Seamless copper water tube - follow ASTM B 88
 - 7. Wrought seamless copper and copper alloy tube - follow ASTM B 251
 - 8. Fluxes for soldering applications of copper and copper alloy tube - follow ASTM B 813
 - 9. Brazing filler metal - follow AWS A5.8
 - 10. Solder metal, 95-5 - follow ASTM B 32
 - 11. Alloy material - follow ASTM B 446
 - 12. Non-metallic piping CPVC pipe - follow ASTM F 442
- J. Fitting Materials Standards:
 - 1. Cast iron threaded fitting, Class 125 and 250 - follow ASME B16.4
 - 2. Cast iron pipe flanges and flanged fittings - follow ASME B16.1
 - 3. Malleable iron threaded fittings, Class 150 and 300 steel - follow ASME B16.3
 - 4. Factory made wrought steel butt weld fittings - follow ASME B16.9
 - 5. Buttwelding ends for pipe, valves, flanges, and fitting - follow ASME B16.25
 - 6. Wrought copper and copper alloy solder joint pressure fittings - follow ASME B16.22

- 7. Cast copper alloy solder joint pressure fitting - follow ASME B16.18
- 8. Chlorinated polyvinyl chloride (CPVC) - follow ASTM F 437
- K. Pipe Identification - All pipe, including specially listed pipe allowed by NFPA 13, shall be marked continuously along its length by the manufacturer in such a way as to properly identify the type of pipe. Pipe identification shall include the manufacturer's name, model designation, or schedule.

2.3 VALVES

- A. Listed Indicating Valves:
 - 1. Gate: OS&Y, 1200 kPa (175 lb.) WOG or equal.
 - 2. Butterfly: Gear operated, indicating type, 1200 kPa (175 lb.) WOG or equal. Butterfly valves are to be installed in a manner that does not interfere with the operation of any system component.
 - 3. Ball (inspectors test and drain only): iron body, stainless steel trim, for 2050 kPa (300 psi) service, indicating type.
 - 4. Ball and butterfly valves shall not be used on incoming water service, and on the suction side of either the fire pump or jockey pump.
- B. Check Valves: Swing type, rubber faced or wafer type spring loaded butterfly check valve, 1200 kPa (175 lb.) WOG or equal.
- C. Alarm Check: Iron body, bronze mounted, variable pressure type with retarding chamber. Provide basic trimmings for alarm test by pass, gages, drain connections, mounting supports for retarding chamber, and drip funnel. Provide pressure sensitive alarm switch to actuate the fire alarm system.
- D. Drain Valves: Threaded bronze angle, globe, ball or butterfly, 1000 kPa (150 lb.) WOG or equal equipped with reducer and hose connection with cap or connected to a drain line.
- E. Self-contained Test and Drain Valve:
 - 1. Ductile iron body with bronze "Drain" and "Test" bonnets. Acrylic sight glass for viewing test flow. Various sized orifice inserts to simulate flow through 14 mm (17/32 in.), 13 mm (1/2 in.), 12 mm (7/16 in.), and 10 mm (3/8 in.) diameter sprinklers, 32 mm (1 1/4 in.) female threaded outlets or 32 mm (1 1/4 in.) one-quarter turn locking lug outlets for plain end pipe (end preparation to be in accordance with manufacturer's recommendation).
 - 2. Bronze body, with chrome plated bronze ball, brass stem, steel handle, teflon seat and sight glasses. Provide valve with three

position indicator plate (off, test, and drain), 6 mm (1/4 in.) tapping for pressure gage and various other orifice inserts to simulate flow through 10 mm (3/8 in.), 12 mm (7/16 in.), 13 mm (1/2 in.), and 14 mm (17/32 in.) diameter sprinklers.

- F. Dry Pipe Valve: Flanged, iron body. Provide basic trimmings for alarm test bypass, water flow alarm, high and low pressure switches, gages, drain connections, drip funnel, accelerator and necessary pipe, fittings and accessories required to provide a complete installation.
- G. Double Check Backflow Prevention Assembly: Provide two independent check valves with OS&Y shut off valves, ball type test cocks. Maximum friction loss through assembly shall not exceed 35 kPa (5 psi) at design flow. Unit shall be functional in vertical or horizontal position, rated for 1200 kPa (175 psi) working pressure. Check valve assembly shall be in accordance with AWWA Class D. Double check backflow prevention assembly shall be FM approved, ASSE approved and UL listed.

2.4 AUTOMATIC BALL DRIPS

Cast brass 20 mm (3/4 in.) in line automatic ball drip with both ends threaded with iron pipe threads.

2.5 FIRE DEPARTMENT SIAMESE CONNECTION

Brass, flush wall type, exterior fire department connection with brass escutcheon plate, without sill cock, and a minimum of two 65 mm (2 1/2 in.) connections threaded to match those on the local fire protection service, with polished brass caps and chains. Provide escutcheon with integral raised letters "Automatic Sprinkler". Provide connection with a swing check valve. Install an automatic ball drip between fire department connection and check valve to discharge over an indirect drain connection or to the outside. When additional alarm valve is installed, additional check valve is not required. Check valves must be installed in accordance with their vertical or horizontal listing.

2.6 SPRINKLERS

- A. Quick response sprinklers shall be standard type except as noted below. The maximum distance from the deflector to finished ceiling shall be 50 mm (2 in.) for pendent sprinklers. Pendent sprinklers in finished areas shall be provided with semi-recessed adjustable screwed escutcheons and installed within the center one-third of their adjustment. The sprinkler shall be installed in the flush position with

the element exposed below the ceiling line. At the specified locations, provide the following type of sprinklers. All sprinklers except "institutional" type sprinklers shall be FM approved. Provide quick response sprinklers in all areas, except where specifically prohibited by their listing or approval, and the following:

LOCATION	TYPE
Mechanical Equipment Rooms, Electrical & Electrical Switch Gear Rooms	Quick Response, Upright or Telephone Closets, Transformer Vaults Pendent Brass [93 °C (200 °F)]
Elevator Shafts, Dumbwaiter Shafts, Elevator Machine Rooms, Elevator Pits	Standard Upright or Sidewall Brass [93 °C (200 °F)]
Controlled Temperature Rooms and Unheated Areas	Standard Pendent, Dry Type [66- 74 °C (150-165 °F)]
Kitchen Hoods, Exhaust Ducts & Duct Collars	Standard Pendent or Upright (Extra High Temperature [163-191 °C (325- 375 °F.)])
Generator Rooms	Standard Pendent or Upright [141 °C (286 °F)]
Operating Rooms, Radiology Rooms, Nuclear Medicine Rooms	Quick Response, Recessed Pendent, Chrome Plated, Sidewall [66-74 °C (150-165 °F)]
All Areas Not Listed Above	Quick Response, Recessed Pendent, Sidewall, Chrome Plated [66-74 °C (150-165 °F)]

B. Do not use quick response sprinklers in the same sprinkler zone with other sprinklers types. In sprinklered light hazard patient zones that are expanded into fully sprinklered zones, revise the existing system to contain quick response sprinklers.

C. Sprinklers to be installed as per NFPA 13.

2.7 TOOLS AND REPLACEMENT PARTS

A. Sprinkler Cabinet:

1. Provide a minimum 5 percent spare sprinklers with escutcheons with a minimum of two of each type/or as required by NFPA-13, whichever is more demanding.
2. Provide a minimum of two of each type sprinkler wrenches used.
3. Install cabinets in each building where directed by the Contracting Officer's Technical Representative (COTR).

- 4. Spare sprinklers shall be kept in a cabinet where ambient temperatures do not exceed 100 Deg F.
- B. Sprinkler system water flow switch: one of each size provided.
- C. Sprinkler system valve tamper switch: one of each type provided.
- D. Sprinkler system pressure switch: one of each type provided.
- E. Provide two sprinkler plugs attached to multi-section extension poles 2400 mm (8 ft.) minimum.

2.8 AIR COMPRESSOR

- A. Provide air compressor specifically approved for a dry sprinkler system with UL Listed FM Approved dry valves.
- B. Compressor shall maintain the required operating pressure on the dry system and be capable of full recovery within 30 minutes of an emergency.
- C. Provide a 120 volt electrical connection to a non-switched dedicated electrical connection and equip with an hourly run meter.
- D. A check valve or other positive backflow prevention device shall be installed in the air supply to each system to prevent airflow or waterflow from one system to another.
- E. Where the air compressor feeding the dry pipe system has less capacity than the discharge through a 1/8 in. orifice at 10 psig, no air maintenance device shall be required.
- F. A listed relief valve shall be provided between the compressor and controlling valve and shall be set to relieve at a pressure 10 psi in excess of the operating air pressure of the system.
- G. Automatic air supply to more than one dry pipe system shall be connected to enable individual maintenance of air pressure in each system.

2.9 IDENTIFICATION SIGNS

Provide for all new and existing sectional valves, riser control valves, system control valves, drain valves, test and drain connections and alarm devices with securely attached identification signs (enamel on metal) in accordance with NFPA 13.

2.10 HANGERS AND EARTHQUAKE BRACING

In accordance with NFPA 13 and 14. Comply with seismic requirements as per 15050 for seismic zone locations.

2.11 WATERFLOW SWITCHES

- A. Integral, mechanical, non-coded, non-accumulative retard type, with two sets of SPDT auxiliary contacts and adjustable from 0 to 90 seconds.
Set flow switches at an initial setting between 20 and 30 seconds.
- B. All conduit and wiring connected thereto, shall be provided in Section 28 31 00, FIRE DETECTION AND ALARM.

2.12 VALVE SUPERVISORY SWITCHES

- A. Provide each indicating sprinkler with adequate means for mounting a valve supervisory switch.
- B. Mount switch so as not to interfere with normal operation of the valve and adjust to operate within two revolutions toward the closed position of the valve control, or when the stem is moved no more than one fifth of the distance from its normal position.
- C. The mechanism shall be contained in a weatherproof die cast aluminum housing, which shall provide a 20 mm (3/4 in.) tapped conduit entrance and incorporate the necessary facilities for attachment to the valves.
- D. Switch housing to be finished in red baked enamel.
- E. Supervisory switches for ball and butterfly valves may be integral with the valve.
- F. All conduit and wiring connected thereto shall be provided in Section 28 31 00, FIRE DETECTION AND ALARM.

2.13 PRESSURE SWITCHES

- A. Provide with 15 mm (1/2 in.) NPT male pressure connection.
- B. Alarm switch shall be activated by any flow of water equal to or in excess of the discharge from one sprinkler.
- C. Supervisory switch shall be activated by either high or low air pressure condition.
- D. Furnish switch in a red baked enamel, weatherproof, oil resistant housing with tamper resistant screws.

2.14 WATER MOTOR GONG

Provide water powered mechanical device providing an audible signal when there is a flow of water in the automatic sprinkler system.

2.15 WALL, FLOOR AND CEILING PLATES

- A. Exposed piping passing through walls, floors or ceilings shall be provided with chrome colored escutcheon plates.
- B. Comply with NFPA 101 Fire Barrier Penetration codes.

2.16 HANGERS

- A. Hangers shall be designed to support five times the weight of the water filled pipe plus 250 Lb (114Kg) at each point of piping support.
- B. These points of support shall be adequate to support the system.
- C. The spacing between hangers shall not exceed the value given for the type of pipe as indicated in NFPA 13 tables.
- D. Hanger components shall be ferrous.
- E. Detailed calculations shall be submitted, when required by the reviewing Authority, showing stress developed in hangers, piping, fittings and safety factors allowed.

PART 3 - EXECUTION**3.1 INSTALLATION**

- A. Supervisory Switches: For each indicating sprinkler system riser, sprinkler zone, main service entrance, PIV (post indicator valve), control valve, provide a supervisory switch that is connected to the fire alarm system. Standpipe hose valves and test and drain valves shall not be provided with supervisory switches.
- B. Waterflow Switches: For each sprinkler zone and where indicated on drawings, provide a waterflow switch. Install waterflow switch and adjacent valves in easily accessible locations.
- C. Sprinkler Zone: Each sprinkler zone shall coincide with each fire alarm zone.
- D. Piping connections:
 - 1. Sprinkler System Only: Start at flanged outlet within the building at exterior wall.
- E. Drains, Test Pipes and Accessories:
 - 1. Provide a drain at base of risers, drain connection on valved sections, and drains at other locations for complete drainage of the system. Provide valve in drain lines and connect to the central drain riser. Discharge riser outside over splash block, indirectly over standpipe drain connected to storm sewer, or as indicated. The main drain shall be capable of full discharge test without allowing water to flow onto the floor.
 - 2. Provide test pipes in accordance with NFPA 13. Test pipes shall be valved and piped to discharge through proper orifice as specified above for drains.

- F. Provide a 690 kPa (100 psi) pressure gage at each flow alarm switch location, at the top of each sprinkler riser, at each main drain connection.
- G. Conceal all piping, except in pipe basements, stairwells and rooms without ceilings.
- H. Install new piping and sprinklers aligned with natural building and other sprinklers lines.
- I. Locate piping in stairways as near ceiling as possible to prevent tampering by unauthorized personnel. Provide a minimum headroom of 2250 mm (7 ft.-6 in.) for all piping.
- J. Piping arrangement shall avoid contact with other piping and equipment and allow clear access to other equipment or devices requiring access or maintenance.
- K. Install CPVC piping only above gypsum board or acoustical ceiling panels classified for surface burning characteristics (See UL product category BIYR in the Building Materials Directory), or behind a Listed Sprinkler Cover Support System. In unfinished areas with flat ceiling construction and sprinkler deflectors installed within 200 mm (8 in.) of the ceiling, piping may be exposed when listed quick response sprinklers are used. In addition to the above, use CPVC only when allowed by the local Authority Having Jurisdiction.
- L. Cutout disks, which are created by cutting holes in the walls of pipe for flow switches and non-threaded pipe connections, shall be affixed near to the pipe where the originated. They shall be displayed until final inspection and then removed.
- M. For each new or existing fire department connection, locate the symbolic sign given in NFPA 170 a distance of 2400 to 3000 mm (8 to 10 ft.) above each connection location. The sign shall be 450 x 450 mm (18 x 18 in.) with symbol at least 350 x 350 mm (14 x 14 in.).
- N. Firestopping shall comply with Section 07 84 00, FIRESTOPPING. All holes through stairways, smoke barrier walls, and fire walls shall be sealed on a daily basis.
- O. Provide hydraulic design information signage as required by NFPA 13 and 14.
- P. Install access doors in ceilings of rooms where above ceiling access is required.

3.2 TEST

- A. Automatic Sprinkler System: NFPA 13.

3.3 INSTRUCTIONS

Furnish the services of a competent instructor for not less than two four-hour periods for instructing personnel in the operation and maintenance of the fire pump and sprinkler system, on the dates requested by the COTR.

- - - END - - -

SECTION 22 05 11
COMMON WORK RESULTS FOR PLUMBING

PART 1 - GENERAL

1.1 DESCRIPTION

- A. The requirements of this Section shall apply to all sections of Division 22.
- B. Definitions:
 - 1. Exposed: Piping and equipment exposed to view in finished rooms.
 - 2. Option or optional: Contractor's choice of an alternate material or method.

1.2 RELATED WORK

- A. Section 01 00 00, GENERAL REQUIREMENTS.
- B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- C. Section 31 20 00, EARTH MOVING: Excavation and Backfill.
- D. Section 03 30 00, CAST-IN-PLACE CONCRETE: Concrete and Grout.
- E. Section 05 31 00, STEEL DECKING
- F. Section 05 50 00, METAL FABRICATIONS.
- G. Section 07 84 00, FIRESTOPPING.
- H. Section 07 60 00, FLASHING AND SHEET METAL: Flashing for Wall and Roof Penetrations.
- I. Section 07 92 00, JOINT SEALANTS.
- J. Section 09 91 00, PAINTING.
- K. Section 23 07 11, HVAC, PLUMBING, AND BOILER PLANT INSULATION.
- L. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS
- M. Section 22 05 12, GENERAL MOTOR REQUIREMENTS FOR PLUMBING EQUIPMENT.
- N. Section 26 29 11, LOW-VOLTAGE MOTOR STARTERS.

1.3 QUALITY ASSURANCE

- A. Products Criteria:
 - 1. Standard Products: Material and equipment shall be the standard products of a manufacturer regularly engaged in the manufacture of the products for at least 3 years. However, digital electronics devices, software and systems such as controls, instruments, computer work station, shall be the current generation of technology and basic design that has a proven satisfactory service record of at least three years.
 - 2. Equipment Service: There shall be permanent service organizations,

authorized and trained by manufacturers of the equipment supplied, located within 160 km (100 miles) of the project. These organizations shall come to the site and provide acceptable service to restore operations within four hours of receipt of notification by phone, e-mail or fax in event of an emergency, such as the shut-down of equipment; or within 24 hours in a non-emergency. Names, mail and e-mail addresses and phone numbers of service organizations providing service under these conditions for (as applicable to the project): pumps, critical instrumentation, computer workstation and programming shall be submitted for project record and inserted into the operations and maintenance manual.

3. All items furnished shall be free from defects that would adversely affect the performance, maintainability and appearance of individual components and overall assembly.
 4. The products and execution of work specified in Division 22 shall conform to the referenced codes and standards as required by the specifications. Local codes and amendments enforced by the local code official shall be enforced, if required by local authorities such as the natural gas supplier. If the local codes are more stringent, then the local code shall apply. Any conflicts shall be brought to the attention of the Contracting Officer's Technical Representative (COTR).
 5. Multiple Units: When two or more units of materials or equipment of the same type or class are required, these units shall be products of one manufacturer.
 6. Assembled Units: Manufacturers of equipment assemblies, which use components made by others, assume complete responsibility for the final assembled product.
 7. Nameplates: Nameplate bearing manufacturer's name or identifiable trademark shall be securely affixed in a conspicuous place on equipment, or name or trademark cast integrally with equipment, stamped or otherwise permanently marked on each item of equipment.
 8. Asbestos products or equipment or materials containing asbestos shall not be used.
- B. Welding: Before any welding is performed, contractor shall submit a certificate certifying that welders comply with the following requirements:

1. Qualify welding processes and operators for piping according to ASME "Boiler and Pressure Vessel Code", Section IX, "Welding and Brazing Qualifications".
 2. Comply with provisions of ASME B31 series "Code for Pressure Piping".
 3. Certify that each welder has passed American Welding Society (AWS) qualification tests for the welding processes involved, and that certification is current.
 4. All welds shall be stamped according to the provisions of the American Welding Society.
- C. Manufacturer's Recommendations: Where installation procedures or any part thereof are required to be in accordance with the recommendations of the manufacturer of the material being installed, printed copies of these recommendations shall be furnished to the COTR prior to installation. Installation of the item will not be allowed to proceed until the recommendations are received. Failure to furnish these recommendations can be cause for rejection of the material.
- D. Execution (Installation, Construction) Quality:
1. All items shall be applied and installed in accordance with manufacturer's written instructions. Conflicts between the manufacturer's instructions and the contract drawings and specifications shall be referred to the COTR for resolution. Written hard copies or computer files of manufacturer's installation instructions shall be provided to the COTR at least two weeks prior to commencing installation of any item.
 2. Complete layout drawings shall be required by Paragraph, SUBMITTALS. Construction work shall not start on any system until the layout drawings have been approved.
- E. Guaranty: Warranty of Construction, FAR clause 52.246-21.
- F. Plumbing Systems: IPC, International Plumbing Code.

1.4 SUBMITTALS

- A. Submittals shall be submitted in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Information and material submitted under this section shall be marked "SUBMITTED UNDER SECTION 22 05 11, COMMON WORK RESULTS FOR PLUMBING", with applicable paragraph identification.
- C. Contractor shall make all necessary field measurements and

- investigations to assure that the equipment and assemblies will meet contract requirements.
- D. If equipment is submitted which differs in arrangement from that shown, provide drawings that show the rearrangement of all associated systems. Approval will be given only if all features of the equipment and associated systems, including accessibility, are equivalent to that required by the contract.
- E. Prior to submitting shop drawings for approval, contractor shall certify in writing that manufacturers of all major items of equipment have each reviewed drawings and specifications, and have jointly coordinated and properly integrated their equipment and controls to provide a complete and efficient installation.
- F. Upon request by Government, lists of previous installations for selected items of equipment shall be provided. Contact persons who will serve as references, with telephone numbers and e-mail addresses shall be submitted with the references.
- G. Manufacturer's Literature and Data: Manufacturer's literature shall be submitted under the pertinent section rather than under this section.
1. Electric motor data and variable speed drive data shall be submitted with the driven equipment.
 2. Equipment and materials identification.
 3. Fire stopping materials.
 4. Hangers, inserts, supports and bracing. Provide load calculations for variable spring and constant support hangers.
 5. Wall, floor, and ceiling plates.
- H. Coordination Drawings: Complete consolidated and coordinated layout drawings shall be submitted for all new systems, and for existing systems that are in the same areas. The drawings shall include plan views, elevations and sections of all systems and shall be on a scale of not less than 1:32 (3/8-inch equal to one foot). Clearly identify and dimension the proposed locations of the principal items of equipment. The drawings shall clearly show the proposed location and adequate clearance for all equipment, piping, pumps, valves and other items. All valves, trap primer valves, water hammer arrestors, strainers, and equipment requiring service shall be provided with an access door sized for the complete removal of plumbing device, component, or equipment. Equipment foundations shall not be installed

until equipment or piping until layout drawings have been approved. Detailed layout drawings shall be provided for all piping systems. In addition, details of the following shall be provided.

1. Mechanical equipment rooms.
2. Interstitial space.
3. Hangers, inserts, supports, and bracing.
4. Pipe sleeves.
5. Equipment penetrations of floors, walls, ceilings, or roofs.

I. Maintenance Data and Operating Instructions:

1. Maintenance and operating manuals in accordance with Section 01 00 00, GENERAL REQUIREMENTS, Article, INSTRUCTIONS, for systems and equipment.
2. Listing of recommended replacement parts for keeping in stock supply, including sources of supply, for equipment shall be provided.
3. The listing shall include belts for equipment: Belt manufacturer, model number, size and style, and distinguished whether of multiple belt sets.

1.5 DELIVERY, STORAGE AND HANDLING

A. Protection of Equipment:

1. Equipment and material placed on the job site shall remain in the custody of the Contractor until phased acceptance, whether or not the Government has reimbursed the Contractor for the equipment and material. The Contractor is solely responsible for the protection of such equipment and material against any damage.
2. Damaged equipment shall be replaced with an identical unit as determined and directed by the COTR. Such replacement shall be at no additional cost to the Government.
3. Interiors of new equipment and piping systems shall be protected against entry of foreign matter. Both inside and outside shall be cleaned before painting or placing equipment in operation.
4. Existing equipment and piping being worked on by the Contractor shall be under the custody and responsibility of the Contractor and shall be protected as required for new work.

B. Cleanliness of Piping and Equipment Systems:

1. Care shall be exercised in the storage and handling of equipment and piping material to be incorporated in the work. Debris arising from

cutting, threading and welding of piping shall be removed.

2. Piping systems shall be flushed, blown or pigged as necessary to deliver clean systems.
3. The interior of all tanks shall be cleaned prior to delivery and beneficial use by the Government. All piping shall be tested in accordance with the specifications and the International Plumbing Code (IPC), latest edition. All filters, strainers, fixture faucets shall be flushed of debris prior to final acceptance.
4. Contractor shall be fully responsible for all costs, damage, and delay arising from failure to provide clean systems.

1.6 APPLICABLE PUBLICATIONS

- A. The publications listed below shall form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American Society of Mechanical Engineers (ASME):
Boiler and Pressure Vessel Code (BPVC):
SEC IX-2007.....Boiler and Pressure Vessel Code; Section IX,
Welding and Brazing Qualifications.
- C. American Society for Testing and Materials (ASTM):
A36/A36M-2008.....Standard Specification for Carbon Structural
Steel
A575-96 (R 2007).....Standard Specification for Steel Bars, Carbon,
Merchant Quality, M-Grades R (2002)
E84-2005.....Standard Test Method for Surface Burning
Characteristics of Building Materials
E119-2008a.....Standard Test Methods for Fire Tests of
Building Construction and Materials
- D. Manufacturers Standardization Society (MSS) of the Valve and Fittings Industry, Inc:
SP-58-02.....Pipe Hangers and Supports-Materials, Design and
Manufacture
SP 69-2003 (R 2004).....Pipe Hangers and Supports-Selection and
Application
- E. National Electrical Manufacturers Association (NEMA):
MG1-2003, Rev. 1-2007...Motors and Generators
- F. International Code Council, (ICC):
IBC-06, (R 2007).....International Building Code

IPC-06, (R 2007).....International Plumbing Code

PART 2 - PRODUCTS

2.1 FACTORY-ASSEMBLED PRODUCTS

- A. STANDARDIZATION OF COMPONENTS SHALL BE MAXIMIZED TO REDUCE SPARE PART requirements.
- B. Manufacturers of equipment assemblies that include components made by others shall assume complete responsibility for final assembled unit.
 - 1. All components of an assembled unit need not be products of same manufacturer.
 - 2. Constituent parts that are alike shall be products of a single manufacturer.
 - 3. Components shall be compatible with each other and with the total assembly for intended service.
 - 4. Contractor shall guarantee performance of assemblies of components, and shall repair or replace elements of the assemblies as required to deliver specified performance of the complete assembly.
- C. Components of equipment shall bear manufacturer's name and trademark, model number, serial number and performance data on a name plate securely affixed in a conspicuous place, or cast integral with, stamped or otherwise permanently marked upon the components of the equipment.
- D. Major items of equipment, which serve the same function, shall be the same make and model

2.2 COMPATIBILITY OF RELATED EQUIPMENT

- A. Equipment and materials installed shall be compatible in all respects with other items being furnished and with existing items so that the result will be a complete and fully operational system that conforms to contract requirements.

2.3 SAFETY GUARDS

- A. Pump shafts and couplings shall be fully guarded by a sheet steel guard, covering coupling and shaft but not bearings. Material shall be minimum 16-gage sheet steel; ends shall be braked and drilled and attached to pump base with minimum of four 6 mm (1/4-inch) bolts. Reinforce guard as necessary to prevent side play forcing guard onto couplings.
- B. All Equipment shall have moving parts protected from personal injury.

2.4 LIFTING ATTACHMENTS

Equipment shall be provided with suitable lifting attachments to enable

equipment to be lifted in its normal position. Lifting attachments shall withstand any handling conditions that might be encountered, without bending or distortion of shape, such as rapid lowering and braking of load.

2.5 ELECTRIC MOTORS, MOTOR CONTROL, CONTROL WIRING

- A. All material and equipment furnished and installation methods shall conform to the requirements of Section 22 05 12, GENERAL MOTOR REQUIREMENTS FOR PLUMBING EQUIPMENT; Section 26 29 11, LOW-VOLTAGE MOTOR STARTERS; and, Section 26 05 21, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES (600 VOLTS AND BELOW). All electrical wiring, conduit, and devices necessary for the proper connection, protection and operation of the systems shall be provided. Premium efficient motors shall be provided. Unless otherwise specified for a particular application, electric motors shall have the following requirements.
- B. Special Requirements:
 - 1. Where motor power requirements of equipment furnished deviate from power shown on plans, provide electrical service designed under the requirements of NFPA 70 without additional time or cost to the Government.
 - 2. Assemblies of motors, starters, and controls and interlocks on factory assembled and wired devices shall be in accordance with the requirements of this specification.
 - 3. Wire and cable materials specified in the electrical division of the specifications shall be modified as follows:
 - a. Wiring material located where temperatures can exceed 71° C (160° F) shall be stranded copper with Teflon FEP insulation with jacket. This includes wiring on the boilers.
 - b. Other wiring at boilers and to control panels shall be NFPA 70 designation THWN.
 - c. Shielded conductors or wiring in separate conduits for all instrumentation and control systems shall be provided where recommended by manufacturer of equipment.
 - 4. Motor sizes shall be selected so that the motors do not operate into the service factor at maximum required loads on the driven equipment. Motors on pumps shall be sized for non-overloading at all points on the pump performance curves.
 - 5. Motors utilized with variable frequency drives shall be rated

"inverter-ready" per NEMA Standard, MG1, Part 31.4.4.2.

- C. Motor Efficiency and Power Factor: All motors, when specified as "high efficiency or Premium Efficiency" by the project specifications on driven equipment, shall conform to efficiency and power factor requirements in Section 22 05 12, GENERAL MOTOR REQUIREMENTS FOR PLUMBING EQUIPMENT, with no consideration of annual service hours. Motor manufacturers generally define these efficiency requirements as "NEMA premium efficient" and the requirements generally exceed those of the Energy Policy Act of 1992 (EPACT). Motors not specified as "high efficiency or premium efficient" shall comply with EPACT.
- D. Single-phase Motors: Capacitor-start type for hard starting applications. Motors for centrifugal fans and pumps may be split phase or permanent split capacitor (PSC).
- E. Poly-phase Motors: NEMA Design B, Squirrel cage, induction type. Each two-speed motor shall have two separate windings. A time delay (20 seconds minimum) relay shall be provided for switching from high to low speed.
- F. Rating: Rating shall be continuous duty at 100 percent capacity in an ambient temperature of 40° C (104° F); minimum horsepower as shown on drawings; maximum horsepower in normal operation shall not exceed nameplate rating without service factor.
- G. Insulation Resistance: Not less than one-half meg-ohm between stator conductors and frame shall be measured at the time of final inspection.

2.6 VARIABLE SPEED MOTOR CONTROLLERS

- A. Refer to Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS and Section 26 29 11, LOW-VOLTAGE MOTOR STARTERS for specifications.
- B. The combination of controller and motor shall be provided by the respective pump manufacturer, and shall be rated for 100 percent output performance. Multiple units of the same class of equipment, i.e. pumps, shall be product of a single manufacturer.
- C. Motors shall be premium efficient type, "inverter duty", and be approved by the motor controller manufacturer. The controller-motor combination shall be guaranteed to provide full motor nameplate horsepower in variable frequency operation. Both driving and driven motor/fan sheaves shall be fixed pitch.
- D. Controller shall not add any current or voltage transients to the input AC power distribution system, DDC controls, sensitive medical

equipment, etc., nor shall be affected from other devices on the AC power system.

2.7 EQUIPMENT AND MATERIALS IDENTIFICATION

- A. Use symbols, nomenclature and equipment numbers specified, shown on the drawings, or shown in the maintenance manuals. Identification for piping is specified in Section 09 91 00, PAINTING.
- B. Interior (Indoor) Equipment: Engraved nameplates, with letters not less than 48 mm (3/16-inch) high of brass with black-filled letters, or rigid black plastic with white letters specified in Section 09 91 00, PAINTING shall be permanently fastened to the equipment. Unit components such as water heaters, tanks, coils, filters, fans, etc. shall be identified.
- C. Exterior (Outdoor) Equipment: Brass nameplates, with engraved black filled letters, not less than 48 mm (3/16-inch) high riveted or bolted to the equipment.
- D. Control Items: All temperature, pressure, and controllers shall be labeled and the component's function identified. Identify and label each item as they appear on the control diagrams.
- E. Valve Tags and Lists:
 - 1. Plumbing: All valves shall be provided with valve tags and listed on a valve list (Fixture stops not included).
 - 2. Valve tags: Engraved black filled numbers and letters not less than 13 mm (1/2-inch) high for number designation, and not less than 6.4 mm (1/4-inch) for service designation on 19 gage, 38 mm (1-1/2 inches) round brass disc, attached with brass "S" hook or brass chain.
 - 3. Valve lists: Valve lists shall be created using a word processing program and printed on plastic coated cards. The plastic coated valve list card(s), sized 216 mm (8-1/2 inches) by 280 mm (11 inches) shall show valve tag number, valve function and area of control for each service or system. The valve list shall be in a punched 3-ring binder notebook. A copy of the valve list shall be mounted in picture frames for mounting to a wall.
 - 4. A detailed plan for each floor of the building indicating the location and valve number for each valve shall be provided. Each valve location shall be identified with a color coded sticker or thumb tack in ceiling.

2.8 FIRE STOPPING

- A. Section 07 84 00, FIRESTOPPING specifies an effective barrier against the spread of fire, smoke and gases where penetrations occur for piping. Refer to Section 23 07 11, HVAC, PLUMBING, AND BOILER PLANT INSULATION, for pipe insulation.

2.9 GALVANIZED REPAIR COMPOUND

- A. Mil. Spec. DOD-P-21035B, paint.

2.10 PIPE AND EQUIPMENT SUPPORTS AND RESTRAINTS

- A. In lieu of the paragraph which follows, suspended equipment support and restraints may be designed and installed in accordance with the International Building Code (IBC), latest edition, and SECTION 13 05 41, SEISMIC RESTRAINT REQUIREMENTS FOR NON-STRUCTURAL COMPONENTS. Submittals based on the International Building Code (IBC), latest edition, SECTION 13 05 41 requirements, or the following paragraphs of this Section shall be stamped and signed by a professional engineer registered in a state where the project is located. The Support system of suspended equipment over 227 kg (500 pounds) shall be submitted for approval of the COTR in all cases. See these specifications for lateral force design requirements.
- B. Type Numbers Specified: MSS SP-58. For selection and application refer to MSS SP-69. Refer to Section 05 50 00, METAL FABRICATIONS, for miscellaneous metal support materials and prime coat painting.
- C. For Attachment to Concrete Construction:
 - 1. Concrete insert: Type 18, MSS SP-58.
 - 2. Self-drilling expansion shields and machine bolt expansion anchors: Permitted in concrete not less than 102 mm (4 inches) thick when approved by the COTR for each job condition.
 - 3. Power-driven fasteners: Permitted in existing concrete or masonry not less than 102 mm (4 inches) thick when approved by the COTR for each job condition.
- D. For Attachment to Steel Construction: MSS SP-58.
 - 1. Welded attachment: Type 22.
 - 2. Beam clamps: Types 20, 21, 28 or 29. Type 23 C-clamp may be used for individual copper tubing up to 23 mm (7/8-inch) outside diameter.
- E. Attachment to Metal Pan or Deck: As required for materials specified in Section 05 31 00, STEEL DECKING.
- F. For Attachment to Wood Construction: Wood screws or lag bolts.

- G. Hanger Rods: Hot-rolled steel, ASTM A36 or A575 for allowable load listed in MSS SP-58. For piping, provide adjustment means for controlling level or slope. Types 13 or 15 turn-buckles shall provide 38 mm (1-1/2 inches) minimum of adjustment and incorporate locknuts. All-thread rods are acceptable.
- H. Multiple (Trapeze) Hangers: Galvanized, cold formed, lipped steel channel horizontal member, not less than 41 mm by 41 mm (1-5/8 inches by 1-5/8 inches), 2.7 mm (No. 12 gage), designed to accept special spring held, hardened steel nuts. Trapeze hangers are not permitted for steam supply and condensate piping.
1. Allowable hanger load: Manufacturers rating less 91kg (200 pounds).
 2. Guide individual pipes on the horizontal member of every other trapeze hanger with 6 mm (1/4-inch) U-bolt fabricated from steel rod. Provide Type 40 insulation shield, secured by two 13 mm (1/2-inch) galvanized steel bands, or insulated calcium silicate shield for insulated piping at each hanger.
- I. Pipe Hangers and Supports: (MSS SP-58), use hangers sized to encircle insulation on insulated piping. Refer to Section 23 07 11, HVAC, PLUMBING, and BOILER PLANT INSULATION for insulation thickness. To protect insulation, provide Type 39 saddles for roller type supports or insulated calcium silicate shields. Provide Type 40 insulation shield or insulated calcium silicate shield at all other types of supports and hangers including those for insulated piping.
1. General Types (MSS SP-58):
 - a. Standard clevis hanger: Type 1; provide locknut.
 - b. Riser clamps: Type 8.
 - c. Wall brackets: Types 31, 32 or 33.
 - d. Roller supports: Type 41, 43, 44 and 46.
 - e. Saddle support: Type 36, 37 or 38.
 - f. Turnbuckle: Types 13 or 15.
 - g. U-bolt clamp: Type 24.
 - h. Copper Tube:
 - 1) Hangers, clamps and other support material in contact with tubing shall be painted with copper colored epoxy paint, plastic coated or taped with isolation tape to prevent electrolysis.
 - 2) For vertical runs use epoxy painted or plastic coated riser

clamps.

3) For supporting tube to strut: Provide epoxy painted pipe straps for copper tube or plastic inserted vibration isolation clamps.

4) Insulated Lines: Provide pre-insulated calcium silicate shields sized for copper tube.

i. Supports for plastic or glass piping: As recommended by the pipe manufacturer with black rubber tape extending one inch beyond steel support or clamp.

j. Spring hangers are required on all plumbing system pumps one horsepower and greater.

2. Plumbing Piping (Other Than General Types):

a. Horizontal piping: Type 1, 5, 7, 9, and 10.

b. Chrome plated piping: Chrome plated supports.

c. Hangers and supports in pipe chase: Prefabricated system ABS self-extinguishing material, not subject to electrolytic action, to hold piping, prevent vibration and compensate for all static and operational conditions.

d. Blocking, stays and bracing: Angle iron or preformed metal channel shapes, 1.3 mm (18 gage) minimum.

J. Pre-insulated Calcium Silicate Shields:

1. Provide 360 degree water resistant high density 965 kPa (140 psi) compressive strength calcium silicate shields encased in galvanized metal.

2. Pre-insulated calcium silicate shields to be installed at the point of support during erection.

3. Shield thickness shall match the pipe insulation.

4. The type of shield is selected by the temperature of the pipe, the load it must carry, and the type of support it will be used with.

a. Shields for supporting cold water shall have insulation that extends a minimum of one inch past the sheet metal.

b. The insulated calcium silicate shield shall support the maximum allowable water filled span as indicated in MSS-SP 69. To support the load, the shields shall have one or more of the following features: structural inserts 4138 kPa (600 psi) compressive strength, an extra bottom metal shield, or formed structural steel (ASTM A36) wear plates welded to the bottom sheet metal

jacket.

5. Shields may be used on steel clevis hanger type supports, roller supports or flat surfaces.

K. Seismic Restraint of Piping: Refer to Section 13 05 41, SEISMIC RESTRAINT REQUIREMENTS FOR NON-STRUCTURAL COMPONENTS.

2.11 PIPE PENETRATIONS

- A. Pipe penetration sleeves shall be installed for all pipe other than rectangular blocked out floor openings for risers in mechanical bays.
- B. Pipe penetration sleeve materials shall comply with all fire stopping requirements for each penetration.
- C. To prevent accidental liquid spills from passing to a lower level, provide the following:
 1. For sleeves: Extend sleeve 25 mm (1 inch) above finished floor and provide sealant for watertight joint.
 2. For blocked out floor openings: Provide 40 mm (1-1/2 inch) angle set in silicone adhesive around opening.
 3. For drilled penetrations: Provide 40 mm (1-1/2 inch) angle ring or square set in silicone adhesive around penetration.
- C. Penetrations are not allowed through beams or ribs, but may be installed in concrete beam flanges. Any deviation from these requirements must receive prior approval of COTR.
- D. Sheet metal, plastic, or moisture resistant fiber sleeves shall be provided for pipe passing through floors, interior walls, and partitions, unless brass or steel pipe sleeves are specifically called for below.
- E. Cast iron or zinc coated pipe sleeves shall be provided for pipe passing through exterior walls below grade. The space between the sleeve and pipe shall be made watertight with a modular or link rubber seal. The link seal shall be applied at both ends of the sleeve.
- F. Galvanized steel or an alternate black iron pipe with asphalt coating sleeves shall be for pipe passing through concrete beam flanges, except where brass pipe sleeves are called for. A galvanized steel Sleeve shall be provided for pipe passing through floor of mechanical rooms, laundry work rooms, and animal rooms above basement. Except in mechanical rooms, sleeves shall be connected with a floor plate.
- G. Brass Pipe Sleeves shall be provided for pipe passing through quarry

tile, terrazzo or ceramic tile floors. The sleeve shall be connected with a floor plate.

- H. Sleeve clearance through floors, walls, partitions, and beam flanges shall be 25 mm (1 inch) greater in diameter than external diameter of pipe. Sleeve for pipe with insulation shall be large enough to accommodate the insulation plus 25 mm (1 inch) in diameter. Interior openings shall be caulked tight with fire stopping material and sealant to prevent the spread of fire, smoke, and gases.
- I. Sealant and Adhesives: Shall be as specified in Section 07 92 00, JOINT SEALANTS.

2.12 TOOLS AND LUBRICANTS

- A. Furnish, and turn over to the COTR, special tools not readily available commercially, that are required for disassembly or adjustment of equipment and machinery furnished.
- B. Grease Guns with Attachments for Applicable Fittings: One for each type of grease required for each motor or other equipment.
- C. Tool Containers: metal, permanently identified for intended service and mounted, or located, where directed by the COTR.
- D. Lubricants: A minimum of 0.95 L (1 quart) of oil, and 0.45 kg (1 pound) of grease, of equipment manufacturer's recommended grade and type, in unopened containers and properly identified as to use for each different application.

2.13 WALL, FLOOR AND CEILING PLATES

- A. Material and Type: Chrome plated brass or chrome plated steel, one piece or split type with concealed hinge, with set screw for fastening to pipe, or sleeve. Use plates that fit tight around pipes, cover openings around pipes and cover the entire pipe sleeve projection.
- B. Thickness: Not less than 2.4 mm (3/32-inch) for floor plates. For wall and ceiling plates, not less than 0.64 mm (0.025-inch) for up to 80 mm (3 inch) pipe, 0.89 mm (0.035-inch) for larger pipe.
- C. Locations: Use where pipe penetrates floors, walls and ceilings in exposed locations, in finished areas only. Wall plates shall be used where insulation ends on exposed water supply pipe drop from overhead. A watertight joint shall be provided in spaces where brass or steel pipe sleeves are specified.

2.14 ASBESTOS

Materials containing asbestos are not permitted.

PART 3 - EXECUTION**3.1 ARRANGEMENT AND INSTALLATION OF EQUIPMENT AND PIPING**

- A. Location of piping, sleeves, inserts, hangers, and equipment, access provisions shall be coordinated with the work of all trades. Piping, sleeves, inserts, hangers, and equipment shall be located clear of windows, doors, openings, light outlets, and other services and utilities. Equipment layout drawings shall be prepared to coordinate proper location and personnel access of all facilities. The drawings shall be submitted for review.
- Manufacturer's published recommendations shall be followed for installation methods not otherwise specified.
- B. Operating Personnel Access and Observation Provisions: All equipment and systems shall be arranged to provide clear view and easy access, without use of portable ladders, for maintenance and operation of all devices including, but not limited to: all equipment items, valves, filters, strainers, transmitters, sensors, control devices. All gages and indicators shall be clearly visible by personnel standing on the floor or on permanent platforms. Maintenance and operating space and access provisions that are shown on the drawings shall not be changed nor reduced.
- C. Structural systems necessary for pipe and equipment support shall be coordinated to permit proper installation.
- D. Location of pipe sleeves, trenches and chases shall be accurately coordinated with equipment and piping locations.
- E. Cutting Holes:
1. Holes through concrete and masonry shall be cut by rotary core drill. Pneumatic hammer, impact electric, and hand or manual hammer type drill will not be allowed, except as permitted by RE/COTR where working area space is limited.
 2. Holes shall be located to avoid interference with structural members such as beams or grade beams. Holes shall be laid out in advance and drilling done only after approval by COTR. If the Contractor considers it necessary to drill through structural members, this matter shall be referred to COTR for approval.
 3. Waterproof membrane shall not be penetrated. Pipe floor penetration block outs shall be provided outside the extents of the waterproof membrane.

- F. Interconnection of Instrumentation or Control Devices: Generally, electrical and pneumatic interconnections are not shown but must be provided.
- G. Minor Piping: Generally, small diameter pipe runs from drips and drains, water cooling, and other service are not shown but must be provided.
- H. Protection and Cleaning:
 - 1. Equipment and materials shall be carefully handled, properly stored, and adequately protected to prevent damage before and during installation, in accordance with the manufacturer's recommendations and as approved by the COTR. Damaged or defective items in the opinion of the COTR, shall be replaced.
 - 2. Protect all finished parts of equipment, such as shafts and bearings where accessible, from rust prior to operation by means of protective grease coating and wrapping. Close pipe openings with caps or plugs during installation. Pipe openings, equipment, and plumbing fixtures shall be tightly covered against dirt or mechanical injury. At completion of all work thoroughly clean fixtures, exposed materials and equipment.
- I. Concrete and Grout: Concrete and shrink compensating grout 25 MPa (3000 psi) minimum, specified in Section 03 30 00, CAST-IN-PLACE CONCRETE, shall be used for all pad or floor mounted equipment. Gages, thermometers, valves and other devices shall be installed with due regard for ease in reading or operating and maintaining said devices. Thermometers and gages shall be located and positioned to be easily read by operator or staff standing on floor or walkway provided. Servicing shall not require dismantling adjacent equipment or pipe work.
- J. Interconnection of Controls and Instruments: Electrical interconnection is generally not shown but shall be provided. This includes interconnections of sensors, transmitters, transducers, control devices, control and instrumentation panels, instruments and computer workstations. Comply with NFPA-70.
- K. Work in Existing Building:
 - 1. Perform as specified in Article, OPERATIONS AND STORAGE AREAS, Article, ALTERATIONS, and Article, RESTORATION of the Section 01 00 00, GENERAL REQUIREMENTS for relocation of existing equipment,

alterations and restoration of existing building(s).

2. As specified in Section 01 00 00, GENERAL REQUIREMENTS, Article, OPERATIONS AND STORAGE AREAS, make alterations to existing service piping at times that will cause the least interfere with normal operation of the facility.
- L. Work in Animal Research Areas: Seal all pipe penetrations with silicone sealant to prevent entrance of insects.
- M. Work in bathrooms, restrooms, housekeeping closets: All pipe penetrations behind escutcheons shall be sealed with plumbers putty.
- N. Switchgear Drip Protection: Every effort shall be made to eliminate the installation of pipe above electrical and telephone switchgear. If this is not possible, encase pipe in a second pipe with a minimum of joints.
- O. Inaccessible Equipment:
 1. Where the Government determines that the Contractor has installed equipment not conveniently accessible for operation and maintenance, equipment shall be removed and reinstalled or remedial action performed as directed at no additional cost to the Government.
 2. The term "conveniently accessible" is defined as capable of being reached without the use of ladders, or without climbing or crawling under or over obstacles such as electrical conduit, motors, fans, pumps, belt guards, transformers, high voltage lines, piping, and ductwork.

3.2 TEMPORARY PIPING AND EQUIPMENT

- A. Continuity of operation of existing facilities may require temporary installation or relocation of equipment and piping. Temporary equipment or pipe installation or relocation shall be provided to maintain continuity of operation of existing facilities.
- B. The Contractor shall provide all required facilities in accordance with the requirements of phased construction and maintenance of service. All piping and equipment shall be properly supported, sloped to drain, operate without excessive stress, and shall be insulated where injury can occur to personnel by contact with operating facilities. The requirements of Para. 3.1 shall apply.
- C. Temporary facilities and piping shall be completely removed and any openings in structures sealed. Necessary blind flanges and caps shall be provided to seal open piping remaining in service.

3.3 RIGGING

- A. Openings in building structures shall be planned to accommodate design scheme.
- B. Alternative methods of equipment delivery may be offered and will be considered by Government under specified restrictions of phasing and service requirements as well as structural integrity of the building.
- C. All openings in the building shall be closed when not required for rigging operations to maintain proper environment in the facility for Government operation and maintenance of service.
- D. Contractor shall provide all facilities required to deliver specified equipment and place on foundations. Attachments to structures for rigging purposes and support of equipment on structures shall be Contractor's full responsibility.
- E. Contractor shall check all clearances, weight limitations and shall provide a rigging plan designed by a Registered Professional Engineer. All modifications to structures, including reinforcement thereof, shall be at Contractor's cost, time and responsibility.
- F. Rigging plan and methods shall be referred to RE/COTR for evaluation prior to actual work.

3.4 PIPE AND EQUIPMENT SUPPORTS

- A. Where hanger spacing does not correspond with joist or rib spacing, use structural steel channels secured directly to joist and rib structure that will correspond to the required hanger spacing, and then suspend the equipment and piping from the channels. Holes shall be drilled or burned in structural steel ONLY with the prior written approval of the COTR.
- B. The use of chain pipe supports, wire or strap hangers; wood for blocking, stays and bracing, or hangers suspended from piping above shall not be permitted. Rusty products shall be replaced.
- C. Hanger rods shall be used that are straight and vertical. Turnbuckles for vertical adjustments may be omitted where limited space prevents use. A minimum of 15 mm (1/2-inch) clearance between pipe or piping covering and adjacent work shall be provided.
- D. For horizontal and vertical plumbing pipe supports, refer to the International Plumbing Code (IPC), latest edition, and these specifications.
- E. Overhead Supports:

1. The basic structural system of the building is designed to sustain the loads imposed by equipment and piping to be supported overhead.
 2. Provide steel structural members, in addition to those shown, of adequate capability to support the imposed loads, located in accordance with the final approved layout of equipment and piping.
 3. Tubing and capillary systems shall be supported in channel troughs.
- F. Floor Supports:
1. Provide concrete bases, concrete anchor blocks and pedestals, and structural steel systems for support of equipment and piping. Concrete bases and structural systems shall be anchored and doweled to resist forces under operating and seismic conditions (if applicable) without excessive displacement or structural failure.
 2. Bases and supports shall not be located and installed until equipment mounted thereon has been approved. Bases shall be sized to match equipment mounted thereon plus 50 mm (2 inch) excess on all edges. Structural drawings shall be reviewed for additional requirements. Bases shall be neatly finished and smoothed, shall have chamfered edges at the top, and shall be suitable for painting.
 3. All equipment shall be shimmed, leveled, firmly anchored, and grouted with epoxy grout. Anchor bolts shall be placed in sleeves, anchored to the bases. Fill the annular space between sleeves and bolts with a grout material to permit alignment and realignment.
4. For seismic anchoring, refer to Section 13 05 41, SEISMIC RESTRAINT REQUIREMENTS FOR NON-STRUCTURAL COMPONENTS.

3.5 LUBRICATION

- A. All equipment and devices requiring lubrication shall be lubricated prior to initial operation. All devices and equipment shall be field checked for proper lubrication.
- B. All devices and equipment shall be equipped with required lubrication fittings. A minimum of one liter (one quart) of oil and 0.5 kg (one pound) of grease of manufacturer's recommended grade and type for each different application shall be provided. All materials shall be delivered to COTR in unopened containers that are properly identified as to application.
- C. A separate grease gun with attachments for applicable fittings shall be provided for each type of grease applied.

- D. All lubrication points shall be accessible without disassembling equipment, except to remove access plates.
- E. All lubrication points shall be extended to one side of the equipment.

3.6 CLEANING AND PAINTING

- A. Prior to final inspection and acceptance of the plant and facilities for beneficial use by the Government, the plant facilities, equipment and systems shall be thoroughly cleaned and painted. Refer to Section 09 91 00, PAINTING.
- B. In addition, the following special conditions apply:
 - 1. Cleaning shall be thorough. Solvents, cleaning materials and methods recommended by the manufacturers shall be used for the specific tasks. All rust shall be removed prior to painting and from surfaces to remain unpainted. Scratches, scuffs, and abrasions shall be repaired prior to applying prime and finish coats.
 - 2. The following Material And Equipment shall NOT be painted::
 - a. Motors, controllers, control switches, and safety switches.
 - b. Control and interlock devices.
 - c. Regulators.
 - d. Pressure reducing valves.
 - e. Control valves and thermostatic elements.
 - f. Lubrication devices and grease fittings.
 - g. Copper, brass, aluminum, stainless steel and bronze surfaces.
 - h. Valve stems and rotating shafts.
 - i. Pressure gages and thermometers.
 - j. Glass.
 - k. Name plates.
 - 3. Control and instrument panels shall be cleaned and damaged surfaces repaired. Touch-up painting shall be made with matching paint obtained from manufacturer or computer matched.
 - 4. Pumps, motors, steel and cast iron bases, and coupling guards shall be cleaned, and shall be touched-up with the same color as utilized by the pump manufacturer
 - 5. Temporary Facilities: Apply paint to surfaces that do not have existing finish coats.
 - 6. The final result shall be a smooth, even-colored, even-textured factory finish on all items. The entire piece of equipment shall be

repainted, if necessary, to achieve this.

3.8 IDENTIFICATION SIGNS

- A. Laminated plastic signs, with engraved lettering not less than 5 mm (3/16-inch) high, shall be provided that designates equipment function, for all equipment, switches, motor controllers, relays, meters, control devices, including automatic control valves. Nomenclature and identification symbols shall correspond to that used in maintenance manual, and in diagrams specified elsewhere. Attach by chain, adhesive, or screws.
- B. Factory Built Equipment: Metal plate, securely attached, with name and address of manufacturer, serial number, model number, size, performance shall be placed on factory built equipment.
- C. Pipe Identification: Refer to Section 09 91 00, PAINTING.

3.9 STARTUP AND TEMPORARY OPERATION

- A. Start up of equipment shall be performed as described in the equipment specifications. Vibration within specified tolerance shall be verified prior to extended operation. Temporary use of equipment is specified in Section 01 00 00, GENERAL REQUIREMENTS, Article, TEMPORARY USE OF MECHANICAL AND ELECTRICAL EQUIPMENT.

3.10 OPERATING AND PERFORMANCE TESTS

- A. Prior to the final inspection, all required tests shall be performed as specified in Section 01 00 00, GENERAL REQUIREMENTS, Article, TESTS and submit the test reports and records to the COTR.
- B. Should evidence of malfunction in any tested system, or piece of equipment or component part thereof, occur during or as a result of tests, make proper corrections, repairs or replacements, and repeat tests at no additional cost to the Government.
- C. When completion of certain work or system occurs at a time when final control settings and adjustments cannot be properly made to make performance tests, then make performance tests such systems respectively during first actual seasonal use of respective systems following completion of work.

3.11 OPERATION AND MAINTENANCE MANUALS

- A. Provide four bound copies. The Operations and maintenance manuals shall be delivered to COTR not less than 30 days prior to completion of a phase or final inspection.
- B. All new and temporary equipment and all elements of each assembly shall

- be included.
- C. Data sheet on each device listing model, size, capacity, pressure, speed, horsepower, impeller size, and other information shall be included.
 - D. Manufacturer's installation, maintenance, repair, and operation instructions for each device shall be included. Assembly drawings and parts lists shall also be included. A summary of operating precautions and reasons for precautions shall be included in the Operations and Maintenance Manual.
 - E. Lubrication instructions, type and quantity of lubricant shall be included.
 - F. Schematic diagrams and wiring diagrams of all control systems corrected to include all field modifications shall be included.
 - G. Set points of all interlock devices shall be listed.
 - H. Trouble-shooting guide for the control system troubleshooting guide shall be inserted into the Operations and Maintenance Manual.
 - I. The combustion control system sequence of operation corrected with submittal review comments shall be inserted into the Operations and Maintenance Manual.
 - J. Emergency procedures.

3.12 INSTRUCTIONS TO VA PERSONNEL

Instructions shall be provided in accordance with Article, INSTRUCTIONS, of Section 01 00 00, GENERAL REQUIREMENTS.

- - - E N D - - -

SECTION 22 05 12**GENERAL MOTOR REQUIREMENTS FOR PLUMBING EQUIPMENT****PART 1 - GENERAL****1.1 DESCRIPTION:**

This section describes the general motor requirements for plumbing equipment.

1.2 RELATED WORK:

- A. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: General electrical requirements common to more than one section of Division 26.
- B. Section 26 29 11, LOW-VOLTAGE MOTOR STARTERS: Starters, control and protection of motors:

1.3 SUBMITTALS:

- A. In accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS, submit the following:
- B. Shop Drawings:
 - 1. Sufficient information, clearly presented, shall be included to determine compliance with drawings and specifications.
 - 2. Motor nameplate information shall be submitted including electrical ratings, dimensions, mounting details, materials, horsepower, power factor, current as a function of speed, current efficiency, speed as a function of load, RPM, enclosure, starting characteristics, torque characteristics, code letter, full load and locked rotor current, service factor, and lubrication method.
 - 3. Motor parameters required for the determination of the Reed Critical Frequency of vertical hollow shaft motors shall be submitted.
- C. Manuals:
 - 1. Companion copies of complete maintenance and operating manuals, including technical data sheets and application data shall be submitted simultaneously with the shop drawings.
- D. Certification: Two weeks prior to final inspection, unless otherwise noted, four copies of the following certification shall be submitted to the Contracting Officer's Technical Representative (COTR):
 - 1. Certification shall be submitted stating that the motors have been properly applied, installed, adjusted, lubricated, and tested.

1.4 APPLICABLE PUBLICATIONS:

- A. The publications listed below (including amendments, addenda, revisions, supplements and errata) shall form a part of this specification to the extent referenced. Publications are referenced in

the text by designation only.

B. National Electrical Manufacturers Association (NEMA):

MG 1-07.....Motors and Generators

MG 2-01.....Safety Standard and Guide for Selection,
Installation and Use of Electric Motors and
Generators

C. National Fire Protection Association (NFPA):

70-08.....National Electrical Code (NEC)

PART 2 - PRODUCTS

2.1 MOTORS:

A. For alternating current, fractional and integral horsepower motors, NEMA Publications MG 1 and MG 2 shall apply.

B. Voltage ratings shall be as follows:

1. Single phase:

- a. Motors connected to 120-volt systems: 115 volts.
- b. Motors connected to 208-volt systems: 200 volts.
- c. Motors connected to 480 volt systems: 460 volts, dual connection.

2. Three phase:

- a. Motors connected to 208-volt systems: 200 volts.
- b. Motors, less than 74.6 kW (100 HP), connected to 480 volt systems: 460 volts, dual connection.
- c. Motors, 74.6 kW (100 HP) or larger, connected to 480-volt systems: 460 volts.
- d. Motors connected to high voltage systems: Shall conform to NEMA Standards for connection to the nominal system voltage shown on the drawings.

C. Number of phases shall be as follows:

- 1. Motors, less than 373 W (1/2 HP): Single phase.
- 2. Motors, 373 W (1/2 HP) and larger: 3 phase, unless otherwise noted on the electrical drawings.
- 3. Exceptions:
 - a. Hermetically sealed motors.
 - b. Motors for equipment assemblies, less than 746 W (1 HP), may be single phase provided the manufacturer of the proposed assemblies cannot supply the assemblies with three phase motors.

D. Horsepower ratings shall be adequate for operating the connected loads continuously in the prevailing ambient temperatures in areas where the motors are installed, without exceeding the NEMA standard temperature

- risers for the motor insulation.
- E. Motor designs, as indicated by the NEMA code letters, shall be coordinated with the connected loads to assure adequate starting and running torque.
- F. Motor Enclosures:
1. Shall be the NEMA types shown on the drawings for the motors.
 2. Where the types of motor enclosures are not shown on the drawings, they shall be the NEMA types, which are most suitable for the environmental conditions where the motors are being installed.
 3. Enclosures shall be primed and finish coated at the factory with manufacturer's prime coat and standard finish.
 4. All motors in hazardous locations shall be approved for the application and meet the Class and Group as required by the area classification.
- G. Electrical Design Requirements
1. Motors shall be continuous duty.
 2. The insulation system shall be rated minimum of class B, 130° C (266° F).
 3. The maximum temperature rise by resistance at rated power shall not exceed Class B limits, 80° C (176° F).
 4. The speed/torque and speed/current characteristics shall comply with NEMA Design A or B, as specified.
 5. Motors shall be suitable for full voltage starting, unless otherwise noted.
 6. Motors for variable frequency drive applications shall adhere to NEMA standards publication MG 1, Part 30, Application considerations for Constant Speed Motors Used on a Sinusoidal Bus with Harmonic Content and General Purpose Motors Used with Adjustable voltage or Adjustable frequency controls, or both, or Part 31, Definite Purpose Inverter Fed Polyphase Motors.
- H. Mechanical Design Requirements
1. Bearings shall be rated for a minimum of 26,280 hours L-10 life at full load direct coupled, except vertical high thrust motors.
 2. Vertical motors shall be capable of withstanding a momentary up thrust of at least 30% of normal down thrust.
 3. Grease lubricated bearings shall be designed for electric motor use. Grease shall be capable of the temperatures associated with electric motors and shall be compatible with Polyurea based greases.

4. Grease fittings, if provided, shall be Alemite type or equivalent.
 5. Oil lubricated bearings, when specified, shall have an externally visible sight glass to view oil level.
 6. Vibration shall not exceed 0.15 inch per second, unfiltered peak.
 7. Noise level shall meet the requirements of the application.
 8. Motors on 180 frames and larger shall have provisions for lifting eyes or lugs capable of a safety factor of 5.
 9. All external fasteners shall be corrosion resistant.
 10. Condensation heaters, when specified, shall keep motor windings at least 5° C (41° F) above ambient temperature.
 11. Winding thermostats, when specified shall be normally closed, connected in series.
 12. Grounding provisions shall be in the main terminal box.
- I. Additional requirements for specific motors, as indicated in other sections, shall also apply.
- J. NEMA Premium Efficiency Electric Motors, Motor Efficiencies: All permanently wired polyphase motors of 746 Watts (1 Horsepower) or more shall meet the minimum full-load efficiencies as indicated in the following table, and as specified in this specification. Motors of 746 Watts (one horsepower) or more with open, drip-proof or totally enclosed fan-cooled enclosures shall be NEMA premium efficiency type, unless otherwise indicated. Motors provided as an integral part of motor driven equipment are excluded from this requirement if a minimum seasonal or overall efficiency requirement is indicated for that equipment by the provisions of another section.

Minimum Efficiencies Open Drip- Proof	Minimum Efficiencies Total ly Enclo sed Fan- Coole d						
Rating kW (HP)	1200 RPM	1800 RPM	3600 RPM	Rating kW (HP)	1200 RPM	1800 RPM	3600 RPM
0.746 (1)	82.5%	85.5%	77.0%	0.746 (1)	82.5%	85.5%	77.0%
1.12 (1.5)	86.5%	86.5%	84.0%	1.12 (1.5)	87.5%	86.5%	84.0%
1.49 (2)	87.5%	86.5%	85.5%	1.49 (2)	88.5%	86.5%	85.5%
2.24 (3)	88.5%	89.5%	85.5%	2.24 (3)	89.5%	89.5%	86.5%
3.73 (5)	89.5%	89.5%	86.5%	3.73 (5)	89.5%	89.5%	88.5%
5.60 (7.5)	90.2%	91.0%	88.5%	5.60 (7.5)	91.0%	91.7%	89.5%
7.46 (10)	91.7%	91.7%	89.5%	7.46 (10)	91.0%	91.7%	90.2%
11.2 (15)	91.7%	93.0%	90.2%	11.2 (15)	91.7%	92.4%	91.0%
14.9 (20)	92.4%	93.0%	91.0%	14.9 (20)	91.7%	93.0%	91.0%
18.7 (25)	93.0%	93.6%	91.7%	18.7 (25)	93.0%	93.6%	91.7%
22.4 (30)	93.6%	94.1%	91.7%	22.4 (30)	93.0%	93.6%	91.7 %
29.8 (40)	94.1%	94.1%	92.4%	29.8 (40)	94.1%	94.1%	92.4%
37.3 (50)	94.1%	94.5%	93.0%	37.3 (50)	94.1%	94.5%	93.0%
44.8 (60)	94.5%	95.0%	93.6%	44.8 (60)	94.5%	95.0%	93.6%
56.9 (75)	94.5%	95.0%	93.6%	56.9 (75)	94.5%	95.4%	93.6%
74.6 (100)	95.0%	95.4%	93.6%	74.6 (100)	95.0%	95.4%	94.1%
93.3 (125)	95.0%	95.4%	94.1%	93.3 (125)	95.0%	95.4%	95.0%
112 (150)	95.4%	95.8%	94.1%	112 (150)	95.8%	95.8%	95.0%

149.2 (200)	95.4%	95.8%	95.0%	149.2 (200)	95.8%	96.2%	95.4%
----------------	-------	-------	-------	----------------	-------	-------	-------

K. Minimum Power Factor at Full Load and Rated Voltage: 90 percent at 1200 RPM, 1800 RPM and 3600 RPM. Power factor correction capacitors shall be installed unless the motor is controlled by a variable frequency drive. The power factor correction capacitors shall be able to withstand high voltage transients and power line variations without breakdown.

PART 3 - EXECUTION

3.1 INSTALLATION:

Install motors in accordance with manufacturer's recommendations, the NEC, NEMA, as shown on the drawings and/or as required by other sections of these specifications.

3.2 FIELD TESTS

Megger all motors after installation, before start-up. All shall test free from grounds.

- - - E N D - - -

SECTION 22 05 19
METERS AND GAGES FOR PLUMBING PIPING

PART 1 - GENERAL

1.1 DESCRIPTION

This section describes the requirements for water meters and pressure gages.

1.2 RELATED WORK

Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.

1.3 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Manufacturer's Literature and Data:
 - 1. Water Meter.
 - 2. Pressure Gages.
 - 3. BACnet communication protocol
 - 4. Product certificates for each type of meter and gauge
- C. Operations and Maintenance manual shall include:
 - 1. System Description
 - 2. Major assembly block diagrams
 - 3. Troubleshooting and preventive maintenance guidelines
 - 4. Spare parts information.
- D. Shop Drawings shall include the following:
 - 1. One line, wiring and terminal diagrams including terminals identified, protocol or communication modules, and Ethernet connections.

1.4 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American National Standards Institute (ANSI):
 - American Society of Mechanical Engineers (ASME): (Copyrighted Society)
 - B40.1-05.....Gauges-Pressure Indicating Dial Type-Elastic
- C. American Water Works Association (AWWA):
 - C700-07 (R 2003).....Standard for Cold Water Meters, Displacement Type, Bronze Main Case
 - C701-07.....Cold Water Meters-Turbine Type, for Customer

Service AWWA/ ANSI

C702-01.....Cold water meters - Compound Type

D. International Code Council (ICC):

IPC-06.....(2007 Supplement) International Plumbing Code

1.5 AS-BUILT DOCUMENTATION

- A. The electronic documentation and copies of the Operations and Maintenance Manual, approved submittals, shop drawings, and other closeout documentation shall be prepared by a computer software program complying with Section 508 of the Rehabilitation Act of 1973, as amended (29 U.S.C 794d). The manufacturer or vendor of the software used to prepare the electronic documentation shall have a Voluntary Product Accessibility Template made available for review and included as part of the Operations and Maintenance Manual or closeout documentation. All available accessibility functions listed in the Voluntary Accessibility Template shall be enabled in the prepared electronic files. As Adobe Acrobat is a common industry format for such documentation, following the document, "Creating Accessible Adobe PDF files, A Guide for Document Authors" that is maintained and made available by Adobe free of charge is recommended."
- B. Four sets of manufacturer's literature and data updated to include submittal review comments and any equipment substitutions.
- C. Four sets of operation and maintenance data updated to include submittal review comments shall be inserted into a three ring binder. All aspects of system operation and maintenance procedures, including piping isometrics, wiring diagrams of all circuits, a written description of system design, control logic, and sequence of operation shall be included in the operation and maintenance manual. The operations and maintenance manual shall include troubleshooting techniques and procedures for emergency situations. Notes on all special systems or devices such as damper and door closure interlocks shall be included. A List of recommended spare parts (manufacturer, model number, and quantity) shall be furnished. Information explaining any special knowledge or tools the owner will be required to employ shall be inserted into the As-Built documentation.

PART 2 - PRODUCTS

2.1 COMPOUND WATER METER.

- A. The compound water meter shall be a combination of a main line meter of

the turbine type and a meter of appropriate size for measuring low rates of flow. The compound meter shall have an automatic valve mechanism for diverting low rates of flow through the bypass meter. Both metering devices shall be provided with registers contained in the same case. The operating characteristics shall fully conform to AWWA C702. Peak domestic flow rate shall be 2.33 L/S (37 gpm). The bypass meter flow rate shall be 0.25 L/S (4 gpm). Each Register shall indicate in liters (U.S. gallons).

- B. The water meter shall be rated for use at temperatures ranging from -40° C (-40° F) and +70° C (158° F) and operate at a working pressure of 1034 kPa (150-psig).
- C. the main case shall be made of copper alloy containing no less than 75% copper.
- D. The register box rings and lids shall be made of a cast copper alloy
- E. the measuring chambers shall be made of a copper alloy containing not less than 84% copper.
- F. The measuring turbines shall be made of vulcanized hard rubber with specific gravity approximately equal to that of water. The measuring turbines shall have sufficient dimensional stability to retain operating clearances at working temperatures.
- G. The turbine meter shall have flanged ends and supplied with companion flanges, gaskets, and with bolts and nuts. The companion flanges shall be made of cast iron.
- H. The meter shall not register less than 97% and not more than 103% of the water actually passing through it at any rate of flow within the normal test flow limits specified in AWWA 702 except in the registration of flows within the changeover period from bypass meter to main meter.

2.4 WATER METER STRAINER

- A. All meters sizes 50 mm or DN50 (2 inches) and above, shall be fitted with a bronze inlet strainer with top access. The strainer shall conform to AWWA 702.

2.5 WATER METER PROGRAMMING

- A. All meters 50 mm or DN50 (2 inches) and above shall be programmable with software supplied by the meter manufacturer.
- B. The software shall have a Microsoft based interface and operate on the latest Windows operating system. The software shall allow the user to

configure the meter, troubleshoot the meter, query and display meter parameters, and configure data and stored values.

- C. The meter firmware shall be upgradeable through one of the communication ports without removing the unit from service.
- D. the meter shall include output for analog 4-20 milliamp signals and binary output.
- E. The meter shall have two dry contact relays outputs for alarm or control functions.

2.6 WATER METER COMMUNICATION PROTOCOL

- A. The meter shall use a native BACnet Ethernet communication protocol supporting HTTP. The communications shall be protected against surges induced on its communications channels.

2.7 PRESSURE GAGES FOR WATER AND SEWAGE USAGE

- A. ANSI B40.1 all metal case 114 mm (4-1/2 inches) diameter, bottom connected throughout, graduated as required for service, and identity labeled. Range shall be 0 to 1375 kPa (0 to 200 psi) gauge.
- B. The pressure element assembly shall be bourdon tube. The mechanical movement shall be lined to pressure element and connected to pointer.
- C. The dial shall be non-reflective aluminum with permanently etched scale markings graduated in kPa and psi.
- D. The pointer shall be dark colored metal.
- E. The window shall be glass.
- F. The ring shall be brass or stainless steel.
- G. The accuracy shall be grade A, plus or minus 1 percent of middle half of scale range.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Direct mounted pressure gages shall be installed in piping tees with pressure gage located on pipe at the most readable position.
- B. Valves and snubbers shall be installed in piping for each pressure gage.
- C. Test plugs shall be installed on the inlet and outlet pipes all heat exchangers or water heaters serving more than one plumbing fixture.
- D. Pressure gages shall be installed where indicated on the drawings and at the following locations:
 - 1. Building water service entrance into building
 - 2. Inlet and outlet of each pressure reducing valve

3. Suction and discharge of each domestic water pump or re-circulating hot water return pump.
- E. Water meter installation shall conform to AWWA C700, AWWA C701, and AWWA C702. Electrical installations shall conform to IEEE C2, NFPA 70 (National Electric Code), and to the requirements specified herein. New materials shall be provided.
- F. Each water meter shall communicate with the building energy management and control system and report daily water consumption and peak daily flow rate.

3.2 FIELD QUALITY CONTROL

- A. The meter assembly shall be visually inspected and operationally tested. The correct multiplier placement on the face of the meter shall be verified.

3.3 TRAINING

- A. A training course shall be provided to the medical center on meter configuration and maintenance. Training manuals shall be supplied for all attendee with four additional copies supplied. The training course shall cover meter configuration, troubleshooting, and diagnostic procedures.

- - - E N D - - -

SECTION 22 05 23
GENERAL-DUTY VALVES FOR PLUMBING PIPING

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This section describes the requirements for general-duty valves for domestic water and sewer systems.

1.2 RELATED WORK

- A. Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.

1.3 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Manufacturer's Literature and Data:
1. Valves.
 2. Backflow Preventers.
 3. Pressure Reducing Valves.
 4. Backwater Valves5. All items listed in Part 2 - Products.

1.4 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American Society for Testing and Materials (ASTM):A536-84(R 2004)
Standard Specification for Ductile Iron Castings
- C. American Society of Sanitary Engineering (ASSE)
ASSE 1003-01 (R 2003)...Performance Requirements for Water Pressure Reducing Valves
ASSE 1012-02.....Backflow Preventer with Intermediate Atmospheric Vent
ASSE 1013-05.....Reduced Pressure Principle Backflow Preventers and Reduced Pressure Fire Protection Principle Backflow Preventers
- D. International Code Council (ICC)
IPC-06 (R 2007).....International Plumbing Code
- E. Manufacturers Standardization Society of the Valve and Fittings Industry, Inc. (MSS):
SP-25-98.....Standard Marking System for Valves, Fittings, Flanges and UnionsSP-67-02a (R 2004) Butterfly Valve of the Single flange Type (Lug Wafer)

SP-70-06.....Cast Iron Gate Valves, Flanged and Threaded
Ends.

SP-72-99.....Ball Valves With Flanged or Butt Welding For
General Purpose

SP-80-03.....Bronze Gate, Globe, Angle and Check Valves.

SP-110-96.....Ball Valve Threaded, Socket Welding, Solder
Joint, Grooved and Flared Ends

1.5 DELIVERY, STORAGE, AND HANDLING

- A. Valves shall be prepared for shipping as follows:
 - 1. Protect internal parts against rust and corrosion.
 - 2. Protect threads, flange faces, grooves, and weld ends.
 - 3. Set angle, gate, and globe valves closed to prevent rattling.
 - 4. Set ball and plug valves open to minimize exposure of functional surfaces
 - 5. Set butterfly valves closed or slightly open.
 - 6. Block check valves in either closed or open position.
- B. Valves shall be prepared for storage as follows:
 - 1. Maintain valve end protection.
 - 2. Store valves indoors and maintain at higher than ambient dew point temperature.
- C. A sling shall be used for large valves. The sling shall be rigged to avoid damage to exposed parts. Hand wheels or stems shall not be used as lifting or rigging points.

PART 2 - PRODUCTS

2.1 VALVES

- A. Asbestos packing and gaskets are prohibited.
- B. Bronze valves shall be made with dezincification resistant materials. Bronze valves made with copper alloy (brass) containing more than 15 percent zinc shall not be permitted.
- C. Valves in insulated piping shall have 50 mm or DN50 (2 inch) stem extensions and extended handles of non-thermal conductive material that allows operating the valve without breaking the vapor seal or disturbing the insulation. Memory stops shall be fully adjustable after insulation is applied.
- D. Exposed Valves over 65 mm or DN65 (2-1/2 inches) installed at an elevation over 3.6 meters (12 feet) shall have a chain-wheel attachment to valve hand-wheel, stem, or other actuator.
- E. Ball valves, pressure regulating valves, gate valves, globe valves, and

plug valves used to supply potable water shall meet the requirements of NSF 61.

F. Shut-off:

1. Cold, Hot and Re-circulating Hot Water:

- a. 50 mm or DN50 (2 inches) and smaller: Ball, MSS SP-72, SP-110, Ball valve shall be full port three piece or two piece with a union design with adjustable stem package. Threaded stem designs are not allowed. The ball valve shall have a SWP rating of 1035 kPa (150 psig) and a CWP rating of 4140 kPa (600 psig). The body material shall be Bronze ASTM B584, Alloy C844. The ends shall be solder,
- b. Less than 100 mm DN100 (4 inches): Butterfly shall have an iron body with EPDM seal and aluminum bronze disc. The butterfly valve shall meet MSS SP-67, type I standard. The butterfly valve shall have a SWP rating of 1380 kPa (200 psig). The valve design shall be lug type suitable for bidirectional dead-end service at rated pressure. The body material shall meet ASTM A 536, ductile iron.
- c. 100 mm (DN100) (4 inches) and larger:
 - 1) Class 125, OS&Y, Cast Iron Gate Valve. The gate valve shall meet MSS-SP-70 type I standard. The gate valve shall have a CWP rating of 1380 kPa (200 psig). The valve materials shall meet ASTM A 126, grey iron with bolted bonnet, flanged ends, bronze trim, and solid wedge disc. The gate valve shall be gear operated for sizes under 200 mms or DN200 (8 inches) and crank operated for sizes 200 mms or DN200 (8 inches) and above
 - 2) Single flange, ductile iron butterfly valves: The single flanged butterfly valve shall meet the MSS SP-67 standard. The butterfly valve shall have a CWP rating of 1380 kPa (200 psig). The butterfly valve shall be lug type, suitable for bidirectional dead-end service at rated pressure without use of downstream flange. The body material shall comply with ASTM A536 ductile iron. The seat shall be EPDM with stainless steel disc and stem.
 - 3) Grooved end, ductile iron butterfly valves. The grooved butterfly valve shall meet the MSS SP-67 standard. The grooved butterfly valve shall have a CWP rating of 1380 kPa (200 psig). The valve materials shall be polyamide coated

ductile iron conforming to ASTM A536 with two piece stainless steel stem, EPDM encapsulated ductile iron disc, and EPDM seal. The butterfly valve shall be gear operated

2. Reagent Grade Water: Valves for reagent grade, reverse osmosis, or deionized water service shall be ball type of same material as used for pipe.

G. Balancing:

1. Hot Water Re-circulating, 80 mm or DN80 (3 inches) and smaller manual balancing valve shall be of bronze body, brass ball construction with glass and carbon filled TFE seat rings and designed for positive shutoff. The manual balancing valve shall have differential pressure read-out ports across the valve seat area. The read out ports shall be fitting with internal EPT inserts and check valves. The valve body shall have 8 mm or DN8 NPT ($\frac{1}{4}$ " NPT) tapped drain and purge port. The valves shall have memory stops that allow the valve to close for service and then reopened to set point without disturbing the balance position. All valves shall have calibrated nameplates to assure specific valve settings.
2. Larger than 80 mm or DN80 (3 inches): Manual balancing valves shall be of heavy duty cast iron flanged construction with 862 kPa (125 psi) flange connections. The flanged manual balancing valves shall have either a brass ball with glass and carbon filled TFE seal rings or fitted with a bronze seat, replaceable bronze disc with EPDM seal insert and stainless steel stem. The design pressure shall be 1207 kPa (175) at 121 deg C (250 deg F).

H. Check:

1. Check valves less than 80 mm or DN80 (3 inches) and smaller) shall be class 125, bronze swing check valves with non metallic Buna-N disc. The check valve shall meet MSS SP-80 Type 4 standard. The check valve shall have a CWP rating of 1380 kPa (200 psig). The check valve shall have a Y pattern horizontal body design with bronze body material conforming to ASTM B 62, solder joints, and PTFE or TFE disc.
2. Larger than 100 mm or DN100 (4 inches and larger):
 - a. Check valves shall be class 125, iron swing check valve with lever and weight closure control. The check valve shall meet MSS SP-71 Type I standard. The check valve shall have a CWP rating of 1380 kPa (200 psig). The check valve shall have a clear or

full waterway body design with gray iron body material conforming to ASTM A 126, bolted bonnet, flanged ends, bronze trim.

- b. All check valves on the discharge side of submersible sump pumps shall have factory installed exterior level and weight with sufficient weight to prevent the check valve from hammering against the seat when the sump pump stops.

I. Globe:

1. 80 mm or DN80 (3 inches) or smaller: Class 150, bronze globe valve with non metallic disc. The globe valve shall meet MSS SP-80, Type 2 standard. The globe valve shall have a CWP rating of 2070 kPa (300 psig). The valve material shall be bronze with integral seal and union ring bonnet conforming to ASTM B 62 with solder ends, copper-silicon bronze stem, TPFPE or TFE disc, malleable iron hand wheel.
2. Larger than 80 mm or DN80 (3 inches): Similar to above, except with cast iron body and bronze trim, class 125, iron globe valve. The globe valve shall meet MSS SP-85, Type 1 standard. The globe valve shall have a CWP rating of 1380 kPa (200 psig). The valve material shall be gray iron with bolted bonnet conforming to ASTM A 126 with flanged ends, bronze trim, malleable iron handwheel.

2.2 WATER PRESSURE REDUCING VALVE AND CONNECTIONS

- A. 80 mm or DN80 (3 inches) or smaller: The pressure reducing valve shall consist of a bronze body and bell housing, a separate access cover for the plunger, and a bolt to adjust the downstream pressure. The bronze bell housing and access cap shall be threaded to the body and shall not require the use of ferrous screws. The assembly shall be of the balanced piston design and shall reduce pressure in both flow and no flow conditions. The assembly shall be accessible for maintenance without having to remove the body from the line.
- B. 100 mm or DN100 (4 inches) and larger: The pressure reducing valve shall consist of a flanged cast iron body and rated to 1378-kPa (200-psig). The valve shall have a large Hycar diaphragm for sensitive response.
- C. The regulator shall have a tap for pressure gauge.
- D. The regulator shall have a temperature rating of 100° C (210° F) for hot water or hot water return service. Pressure regulators shall have accurate pressure regulation to 6.9-kPa (+/- 1 psig).
- E. Setting: Entering water pressure, discharge pressure, capacity, size,

and related measurements shall be as shown on the drawings.

- F. Connections Valves and Strainers: shut off valves shall be installed on each side of reducing valve and a bypass line equal in size to the regulator inlet pipe shall be installed with a normally closed globe valve. A strainer shall be installed on inlet side of, and same size as pressure reducing valve. A pressure gage shall be installed on the low pressure side of the line.

2.3 BACKWATER VALVE

- A. The backwater valve shall have a cast iron body, automatic type ABS valve seat and flapper which are slightly open during periods of non operation. The cleanout shall be extended to the finish floor and fit with a threaded countersunk plug. A clamping device shall be included when the cleanout extends through the waterproofing membrane.
- B. When the backwater valve is installed greater than 600 mm (24 inches) below the finish floor elevation, a pit or manhole large enough for a repair person can enter to service the backwater valve shall be installed.

2.4 BACKFLOW PREVENTERS

- A. A backflow prevention assembly shall be installed at any point in the plumbing system where the potable water supply comes in contact with a potential source of contamination. The backflow prevention assembly shall be ASSE 1013 listed and certified.
- B. Reduced pressure backflow preventers shall be installed in the following applications.
1. Water make up to heating systems, cooling tower, chilled water system, generators, and similar equipment consuming water.
 2. Water service entrance from loop system.
 3. Power washer
 4. Atmospheric Vacuum Breaker: ASSE 1001
 - a. Hose bibs and sinks w/threaded outlets.
 - b. Disposers.
 - c. Showers (telephone type).
 - d. All kitchen equipment, if not protected by air gap.
- C. The reduced pressure principle backflow prevention assembly shall be ASSE listed 1013 with full port OS&Y gate valves and an integral relief monitor switch. The main body and access cover shall be epoxy coated duct iron conforming to ASTM A536 grade 4. The seat ring and check valve shall be Noryl (NSF listed). The stem shall be stainless steel

conforming to ASTM A276. The seat disc elastomer shall be EPDM. The checks and the relief valve shall be accessible for maintenance without removing the device from the line. An epoxy coated wye type strainer with flanged connections shall be installed on the inlet.

- D. The atmospheric vacuum breaker shall be ASSE listed 1001. The main body shall be either cast bronze. All internal polymers shall be NSF listed. The seat disc elastomer shall be silicone. The device shall be accessible for maintenance without removing the device from the service line. The installation shall not be in a concealed or inaccessible location or where the venting of water from the device during normal operation is deemed objectionable.
- E. The double check detector backflow prevention assembly shall be ASSE listed 1048 and supply with full port OS&Y gate valves. The main body and access cover shall be epoxy coated ductile iron conforming to ASTM A536 grade. The seat ring and check valve shall be Noryl (NSF listed). The stem shall be stainless steel conforming to ASTM A 276. The seat disc elastomers shall be EPDM. The first and second check valve shall be accessible for maintenance without removing the device from the line.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Valve interior shall be examined for cleanliness, freedom from foreign matter, and corrosion. Special packing materials shall be removed, such as blocks, used to prevent disc movement during shipping and handling.
- B. Valves shall be operated in positions from fully open to fully closed. Guides and seats shall be examined and made accessible by such operations.
- C. Threads on valve and mating pipe shall be examined for form and cleanliness.
- D. Mating flange faces shall be examined for conditions that might cause leakage. Bolting shall be checked for proper size, length, and material. Gaskets shall be verified for proper size and that its material composition is suitable for service and free from defects and damage.
- E. Do not attempt to repair defective valves; replace with new valves.

3.2 VALVE INSTALLATION

- A. Install valves with unions or flanges at each piece of equipment

arranged to allow service, maintenance, and equipment removal without system shutdown.

- B. Valves shall be located for easy access and shall be provide with separate support. Valves shall be accessible with access doors when installed inside partitions or above hard ceilings.
- C. Valves shall be installed in horizontal piping with stem at or above center of pipe
- D. Valves shall be installed in a position to allow full stem movement.
- E. Check valves shall be installed for proper direction of flow and as follows:
 - 1. Swing Check Valves: In horizontal position with hinge pin level.

3.3 ADJUSTING

- A. Valve packing shall be adjusted or replaced after piping systems have been tested and put into service but before final adjusting and balancing. Replace valves shall be replaced if persistent leaking occurs.

- - E N D - - -

**SECTION 22 11 00
FACILITY WATER DISTRIBUTION**

PART 1 - GENERAL

1.1 DESCRIPTION

Domestic water systems, including piping, equipment and all necessary accessories as designated in this section.

1.2 RELATED WORK

- A. Penetrations in rated enclosures: Section 07 84 00, FIRESTOPPING.
- B. Preparation and finish painting and identification of piping systems: Section 09 91 00, PAINTING.
- C. Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.
- D. Pipe Insulation: Section 23 07 11, HVAC, PLUMBING, AND BOILER PLANT INSULATION.

1.3 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturer's Literature and Data:
 - 1. Piping.
 - 2. Strainers.
 - 3. All items listed in Part 2 - Products.

1.4 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. Federal Specifications (Fed. Spec.):
 - A-A-1427C.....Sodium Hypochlorite Solution
 - A-A-59617.....Unions, Brass or Bronze Threaded, Pipe
Connections and Solder-Joint Tube Connections
- C. American National Standards Institute (ANSI):
 - American Society of Mechanical Engineers (ASME): (Copyrighted Society)
 - A13.1-96.....Scheme for Identification of Piping Systems
 - B16.3-98.....Malleable Iron Threaded Fittings ANSI/ASME
 - B16.4-98.....Cast Iron Threaded Fittings Classes 125 and 250
ANSI/ASME
 - B16.9-01.....Factory-Made Wrought Steel Buttwelding Fittings

ANSI/ASME

B16.11-01.....Forged Steel Fittings, Socket-Welding and
Threaded ANSI/ASME

B16.12-98.....Cast Iron Threaded Drainage Fittings ANSI/ASME

B16.15-85(R 1994).....Cast Bronze Threaded Fittings ANSI/ASME

B16.18-01.....Cast Copper Alloy Solder-Joint Pressure
Fittings ANSI/ASME

B16.22-01.....Wrought Copper and Copper Alloy Solder Joint
Pressure Fittings ANSI/ASME
Element ANSI/ASME

D. American Society for Testing and Materials (ASTM):

A47-99.....Ferritic Malleable Iron Castings Revision 1989

A53-02.....Pipe, Steel, Black And Hot-Dipped, Zinc-coated
Welded and Seamless

A74-03.....Cast Iron Soil Pipe and Fittings

A183-83(R1998).....Carbon Steel Track Bolts and Nuts

A312-03.....Seamless and Welded Austenitic Stainless Steel
Pipe

A536-84(R1999) E1.....Ductile Iron Castings

A733-03.....Welded and Seamless Carbon Steel and Austenitic
Stainless Steel Pipe Nipples

B32-03.....Solder Metal

B61-02.....Steam or Bronze Castings

B62-02.....Composition Bronze or Ounce Metal Castings

B75-99(Rev A).....Seamless Copper Tube

B88-03.....Seamless Copper Water Tube

B584-00.....Copper Alloy Sand Castings for General
Applications Revision A

B687-99.....Brass, Copper, and Chromium-Plated Pipe Nipples

C564-03.....Rubber Gaskets for Cast Iron Soil Pipe and
Fittings

D4101-03b.....Propylene Plastic Injection and Extrusion
Materials

D2447-93.....Polyethylene (PE) Plastic Pipe, Schedule 40 and
80, Based on Outside Diameter

D2564-94.....Solvent Cements for Poly (Vinyl Chloride) (PVC)
Plastic Pipe and Fittings

D2665-94 Revision A.....Poly (Vinyl Chloride) (PVC) Plastic Drain,

- Waste, and Vent Pipe and Fittings
- D4101-03b.....Propylene Plastic Injection and Extrusion
Materials
- E1120.....Standard Specification For Liquid Chlorine
- E1229.....Standard Specification For Calcium Hypochlorite
- E. American Water Works Association (AWWA):
- C110-03/ A21.10-03.....Ductile Iron and Gray Iron Fittings - 75 mm
thru 1200 mm (3 inch thru 48 inches) for Water
and other liquids AWWA/ ANSI
- C151-00/ A21.51-02.....Ductile-Iron Pipe, Centrifugally Cast in Metal
Molds or Sand-Lined Molds, for Water or Other
Liquids AWWA/ ANSI
- C203-02.....Coal-Tar Protective Coatings and Linings for
Steel Water Pipelines - Enamel and Tape - Hot
Applied AWWA/ ANSI
- C651-99.....Disinfecting Water Mains
- F. American Welding Society (AWS):
- A5.8-92.....Filler Metals for Brazing
- G. National Association of Plumbing - Heating - Cooling Contractors
(PHCC):
- National Standard Plumbing Code - 1996
- H. International Association of Plumbing and Mechanical Officials (IAPMO):
- Uniform Plumbing Code - 2000
- IS6-93.....Installation Standard
- I. Manufacturers Standardization Society of the Valve and Fittings
Industry, Inc. (MSS):
- SP-72-99.....Ball Valves With Flanged or Butt Welding For
General Purpose
- SP-110-96.....Ball Valve Threaded, Socket Welding, Solder
Joint, Grooved and Flared Ends
- J. American Society of Sanitary Engineers (ASSE):
- 1001-02.....Pipe Applied Atmospheric Type Vacuum Breakers
- 1018-01.....Performance for trap seal primer valve-water
supply fed
- 1020-04.....Vacuum Breakers, Anti-Siphon, Pressure Type
- K. Plumbing and Drainage Institute (PDI):
- PDI WH-201.....Water Hammer Arrestor

PART 2 - PRODUCTS

2.1 WATER SERVICE CONNECTIONS TO BUILDINGS

- A. From inside face of exterior wall to a distance of approximately 1500 mm (5 feet) outside of building and underground inside building, material selected shall be the same for the size specified.
- B. Seventy five millimeters (3 inch) Diameter and Over: Ductile iron, AWWA C151, 850 kPa (125 pounds) water steam pressure (WSP), exterior bituminous coating, cement lined. Provide flanged and anchored connection to interior piping.
- C. Under 75 mm (3 inch) Diameter: Copper tubing, ASTM B88, Type K, seamless, annealed. Fittings as specified under Article, INTERIOR DOMESTIC WATER PIPING. Use brazing alloys, AWS A5.8, Classification BCuP.

2.2 INTERIOR DOMESTIC WATER PIPING

- A. Pipe: Copper tube, ASTM B88, Type K or L, drawn. For pipe 150 mm (6 inches) and larger, stainless, steel ASTM A312, schedule 10 may be used.
- B. Fittings for Copper Tube:
 - 1. Wrought copper or bronze castings conforming to ANSI B16.18 and B16.22. Unions shall be bronze, MSS SP72 & SP 110, Solder or braze joints.
 - 2. Grooved fittings, 50 to 150 mm (2 to 6 inch) wrought copper ASTM B75 C12200, 125 to 150 mm (5 to 6 inch) bronze casting ASTM B584, CDA 844. Mechanical grooved couplings, ductile iron, ASTM A536 (Grade 65-45-12), or malleable iron, ASTM A47 (Grade 32510) housing, with EPDM gasket, steel track head bolts, ASTM A183, coated with copper colored alkyd enamel.
 - 3. Mechanically formed tee connection: Form mechanically extracted collars in a continuous operation by drilling pilot hole and drawing out tube surface to form collar, having a height of not less than three times the thickness of tube wall. Adjustable collaring device shall insure proper tolerance and complete uniformity of the joint. Notch and dimple joining branch tube in a single process to provide free flow where the branch tube penetrates the fitting. Braze joints.
- C. Fittings for Stainless Steel:
 - 1. Stainless steel butt-welded fittings, Type 316, Schedule 10,

conforming to ANSI B16.9.

2. Grooved fittings, stainless steel, Type 316, Schedule 10, conforming to ASTM A403. Segmentally fabricated fittings are not allowed. Mechanical grooved couplings, ductile iron, ASTM A536 (Grade 65-45-12), or Malleable iron, ASTM A47 (Grade 32510) housing, with EPDM gasket, steel track head bolts, ASTM A183, coated with copper colored alkyd enamel.
- D. Adapters: Provide adapters for joining screwed pipe to copper tubing.
- E. Solder: ASTM B32 Composition Sb5 HA or HB. Provide non-corrosive flux.
- F. Brazing alloy: AWS A5.8, Classification BCuP.
- G. Polyethylene, food and medical grade, capable of transporting 10 megohm water with no loss of purity. Processed by continuous compression molding without the addition of fillers, polymer modifiers or processing aids. Uniform color with no cracks, flaws, blisters or other imperfections in appearance. Provide heat fusion butt welded joints. In accordance with manufacturer's recommendations, provide continuous channel support under all horizontal piping.

2.3 EXPOSED WATER PIPING

- A. Finished Room: Use full iron pipe size chrome plated brass piping for exposed water piping connecting fixtures, casework, cabinets, equipment and reagent racks when not concealed by apron including those furnished by the Government or specified in other sections.
 1. Pipe: Fed. Spec. WW-P-351, standard weight.
 2. Fittings: ANSI B16.15 cast bronze threaded fittings with chrome finish, (125 and 250).
 3. Nipples: ASTM B 687, Chromium-plated.
 4. Unions: Mss SP-72, SP-110, Brass or Bronze with chrome finish. Unions 65 mm (2-1/2 inches) and larger shall be flange type with approved gaskets.
- B. Unfinished Rooms, Mechanical Rooms and Kitchens: Chrome-plated brass piping is not required. Paint piping systems as specified in Section 09 91 00, PAINTING.

2.4 TRAP PRIMER WATER PIPING:

- A. Pipe: Copper tube, ASTM B88, type K, hard drawn.
- B. Fittings: Bronze castings conforming to ANSI B16.18 Solder joints.
- C. Solder: ASTM B32 composition Sb5. Provide non-corrosive flux.

2.5 WATERPROOFING

- A. Provide at points where pipes pass through membrane waterproofed floors or walls in contact with earth.
- B. Floors: Provide cast iron stack sleeve with flashing device and a underdeck clamp. After stack is passed through sleeve, provide a waterproofed caulked joint at top hub.
- C. Walls: See detail shown on drawings.

2.6 STRAINERS

- A. Provide on high pressure side of pressure reducing valves, on suction side of pumps, on inlet side of indicating and control instruments and equipment subject to sediment damage and where shown on drawings. Strainer element shall be removable without disconnection of piping.
- B. Water: Basket or "Y" type with easily removable cover and brass strainer basket.
- C. Body: Smaller than 80 mm (3 inches), brass or bronze; 80 mm (3 inches) and larger, cast iron or semi-steel.

2.7 DIELECTRIC FITTINGS

Provide dielectric couplings or unions between ferrous and non-ferrous pipe.

2.8 WATER HAMMER ARRESTER:

Closed copper tube chamber with permanently sealed 410 kPa (60 psig) air charge above a Double O-ring piston. Two high heat Buna-N O-rings pressure packed and lubricated with FDA approved Dow Corning No. 11 silicone compound. All units shall be designed in accordance with ASSE 1010 for sealed wall installations without an access panel. Size and install in accordance with Plumbing and Drainage Institute requirements (PDI WH 201). Unit shall be as manufactured by Precision Plumbing Products Inc., Watts or Sioux Chief. Provide water hammer arrestors at all solenoid valves, at all groups of two or more flush valves, at all quick opening or closing valves, and at all medical washing equipment.

PART 3 - EXECUTION**3.1 INSTALLATION**

- A. General: Comply with the PHCC National Standard Plumbing Code and the following:
 - 1. Install branch piping for water from the piping system and connect to all fixtures, valves, cocks, outlets, casework, cabinets and

equipment, including those furnished by the Government or specified in other sections.

2. Pipe shall be round and straight. Cutting shall be done with proper tools. Pipe, except for plastic and glass, shall be reamed to full size after cutting.
3. All pipe runs shall be laid out to avoid interference with other work.
4. Install union and shut-off valve on pressure piping at connections to equipment.
5. Pipe Hangers, Supports and Accessories:
 - a. All piping shall be supported per of the National Standard Plumbing Code, Chapter No. 8.
 - b. Shop Painting and Plating: Hangers, supports, rods, inserts and accessories used for Pipe supports shall be shop coated with red lead or zinc Chromate primer paint. Electroplated copper hanger rods, hangers and accessories may be used with copper tubing.
 - c. Floor, Wall and Ceiling Plates, Supports, Hangers:
 - 1) Solid or split unplated cast iron.
 - 2) All plates shall be provided with set screws.
 - 3) Pipe Hangers: Height adjustable clevis type.
 - 4) Adjustable Floor Rests and Base Flanges: Steel.
 - 5) Concrete Inserts: "Universal" or continuous slotted type.
 - 6) Hanger Rods: Mild, low carbon steel, fully threaded or Threaded at each end with two removable nuts at each end for positioning rod and hanger and locking each in place.
 - 7) Riser Clamps: Malleable iron or steel.
 - 8) Rollers: Cast iron.
 - 9) Self-drilling type expansion shields shall be "Phillips" type, with case hardened steel expander plugs.
 - 10) Hangers and supports utilized with insulated pipe and tubing shall have 180 degree (min.) metal protection shield Centered on and welded to the hanger and support. The shield shall be 4 inches in length and be 16 gauge steel. The shield shall be sized for the insulation.
 - 11) Miscellaneous Materials: As specified, required, directed or as noted on the drawings for proper installation of hangers, supports and accessories. If the vertical distance exceeds 6 m (20 feet) for cast iron pipe additional support shall be

provided in the center of that span. Provide all necessary auxiliary steel to provide that support.

6. Install cast escutcheon with set screw at each wall, floor and ceiling penetration in exposed finished locations and within cabinets and millwork.
7. Penetrations:
 - a. Fire Stopping: Where pipes pass through fire partitions, fire walls, smoke partitions, or floors, install a fire stop that provides an effective barrier against the spread of fire, smoke and gases as specified in Section 07 84 00, FIRESTOPPING. Completely fill and seal clearances between raceways and openings with the fire stopping materials.
 - b. Waterproofing: At floor penetrations, completely seal clearances around the pipe and make watertight with sealant as specified in Section 07 92 00, JOINT SEALANTS.
- B. Piping shall conform to the following:
 1. Domestic Water:
 - a. Where possible, grade all lines to facilitate drainage. Provide drain valves at bottom of risers. All unnecessary traps in circulating lines shall be avoided.
 - b. Connect branch lines at bottom of main serving fixtures below and pitch down so that main may be drained through fixture. Connect branch lines to top of main serving only fixtures located on floor above.

3.2 TESTS

- A. General: Test system either in its entirety or in sections.
- B. Potable Water System: Test after installation of piping and domestic water heaters, but before piping is concealed, before covering is applied, and before plumbing fixtures are connected. Fill systems with water and maintain hydrostatic pressure of 690 kPa (100 psi) gage for two hours. No decrease in pressure is allowed. Provide a pressure gage with a shutoff and bleeder valve at the highest point of the piping being tested.
- C. Reagent Grade Water Systems: Fill system with water and maintain hydrostatic pressure of 690 kPa (100 psi) gage during inspection and prove tight.
- D. All Other Piping Tests: Test new installed piping under 1 1/2 times actual operating conditions and prove tight.

3.3 STERILIZATION

- A. After tests have been successfully completed, thoroughly flush and sterilize the interior domestic water distribution system in accordance with AWWA C651.
- B. Use either liquid chlorine or hypochlorite for sterilization.

- - - E N D - - -

SECTION 22 11 23
DOMESTIC WATER PUMPS

PART 1 - GENERAL

1.1 DESCRIPTION

- A. Hot water circulating pump, hot water recirculation pump and domestic water pressure booster system.

1.2 RELATED WORK

- A. Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.
B. Section 22 05 12, GENERAL MOTOR REQUIREMENTS FOR PLUMBING EQUIPMENT.
C. Section 26 29 11, LOW-VOLTAGE MOTOR STARTERS.

1.3 QUALITY ASSURANCE

- A. Domestic Water Pressure Booster System:
1. Components shall be furnished by a single manufacturer and the system shall be the standard cataloged product of the manufacturer.
 2. Shop Test: Water booster unit and its component parts shall undergo a thorough electric and hydraulic operating test prior to shipment. Tests shall include a system operating flow test from zero to 100 percent of design flow rate under specified suction and system pressure conditions. Certified performance curves shall be furnished.

1.4 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturer's Literature and Data:
1. Pump:
 - a. Manufacturer and model.
 - b. Operating speed.
 - c. Capacity.
 - d. Characteristic performance curves.
 2. Motor:
 - a. Manufacturer and type.
 - b. Speed.
 - c. Current Characteristics.
 - d. Efficiency.
- C. Certificate of shop test for domestic water booster system. Provide certified performance curves.

- D. Certified copies of all the factory and construction site test data sheets and reports.
- E. Complete operating and maintenance manuals including wiring diagrams, technical data sheets and information for ordering replaceable parts:
 - 1. Include complete list indicating all components of the systems.
 - 2. Include complete diagrams of the internal wiring for each item of equipment.
 - 3. Diagrams shall have their terminals identified to facilitate installation, operation and maintenance.
- F. Completed System Readiness Checklist provided by the Commissioning Agent and completed by the contractor, signed by a qualified technician and dated on the date of completion, in accordance with the requirements of Section 22 08 00 COMMISSIONING OF PLUMBING SYSTEMS.

1.5 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. National Electrical Manufacturers Association (NEMA):
 - ICS6-93 (R2006).....Industrial Control and Systems Enclosures
 - 250-08.....Enclosures for Electrical Equipment (1000 Volts Maximum)
- C. American Society of Mechanical Engineers (ASME):
 - Boiler and Pressure Vessel Code: 2010
 - Section VIII.....Pressure Vessels, Division I and II
- D. Underwriters' Laboratories, Inc. (UL):
 - 508-99 (R2008)..... Standards for Industrial Control Equipment

PART 2 - PRODUCTS

2.1 CIRCULATING PUMP

- A. Centrifugal, single or multi stage, constructed to prevent contact of water with metal other than nonferrous. Driver shall be electric motor, close coupled or connected by flexible or magnetic coupling. Pump for hot water system shall be designed for 65 degrees C (150 degrees F) water service.
- B. Mounting shall be either of the following:
 - 1. In-line mounted.
 - 2. Floor mounted set on common bed plate with drip lip.
- C. Casings: Epoxy coated cast iron, bronze, stainless steel, vertically or

- horizontally split.
- D. Impeller: High grade, cast brass or bronze, accurately machined and properly balanced.
 - E. Motors: Maximum 40 degrees C (104 degrees F) ambient temperature rise, drip proof, for operation with current, voltage, phase and cycle shown in schedule on Electrical drawings, conforming to NEMA 250-Type 4. Size the motor capacity to operate the pump without overloading. In-line pump motors shall not exceed 1800 rpm and shall be provided with spring mountings or equal devices to assure quiet operation. Motors shall be equipped with thermal overload protection. When motor has cooled down it shall re-start automatically if the operating control has been left on and the system requires pump to start.
 - F. Pump shall operate continuously with "on-off" switch for shut down. In the inlet and outlet piping of the pump, shutoff valves shall be installed to permit service to the pump without draining the system.
 - G. A check valve shall be installed in the pump discharge piping immediately downstream of the pump

2.2 INLINE HOT WATER RECIRCULATING PUMP

- A. Centrifugal in-line horizontal oil lubricated pump designed for quiet operation and 862 kPa (125 psi).
- B. Pump controlled from on/off aquastat located at pump. In addition, the pump shall be provided with "on-off" switch for shut down. In the inlet and outlet piping of the pump shutoff valves shall be installed to permit service to the pump without draining the system. A check valve shall be installed in the pump discharge piping immediately downstream of the pump.

PART 3 - EXECUTION

3.1 STARTUP AND TESTING

- A. Make tests as recommended by product manufacturer and listed standards and under actual or simulated operating conditions and prove full compliance with design and specified requirements. Tests of the various items of equipment shall be performed simultaneously with the system of which each item is an integral part.
- B. System Test: After installation is completed provide an operational test of the completed system including flow rates, pressure compliance, alarms and all control functions.
- C. When any defects are detected, correct defects and repeat test.

- D. The Commissioning Agent will observe startup and contractor testing of selected equipment. Coordinate the startup and contractor testing schedules with the Contracting Officer's Technical Representative (COTR) and Commissioning Agent. Provide a minimum of 7 days prior to notice.

3.2 COMMISSIONING

- A. Provide Commissioning Documentation accordance with the requirements of Section 22 08 00 - COMMISSIONING OF PLUMBING SYSTEMS for all inspection, startup, and contractor testing required above and required by the System Readiness Checklist provided by the Commissioning Agent.
- B. Components provided under this Section of the specification will be tested as part of a larger system. Refer to Section 22 08 00 - COMMISSIONING OF PLUMBING SYSTEMS and related sections for contractor responsibilities for system commissioning.

3.3 DEMONSTRATION AND TRAINING

- A. Provide services of manufacturer's technical representative for four hours to instruct VA Personnel in operation and maintenance of units.
- B. Submit training plans and instructor qualifications in accordance with the requirements of Section 22 08 00 COMMISSIONING OF PLUMBING SYSTEMS.

- - - E N D - - -

SECTION 22 13 00
FACILITY SANITARY AND VENT PIPING

PART 1 - GENERAL

1.1 DESCRIPTION

This section pertains to sanitary sewer and vent systems, including piping, equipment and all necessary accessories as designated in this section.

1.2 RELATED WORK

- A. Section 07 84 00, FIRESTOPPING: Penetrations in rated enclosures.
- B. Section 09 91 00, PAINTING: Preparation and finish painting and identification of piping systems.
- C. Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING: Pipe Hangers and Supports, Materials Identification.
- D. Section 23 07 11, HVAC, PLUMBING, AND BOILER PLANT INSULATION: Pipe Insulation.
- E. Section 07 92 00 Joint Sealants: Sealant products.

1.3 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Manufacturer's Literature and Data:
 - 1. Piping.
 - 2. Floor Drains.
 - 3. Cleanouts.
 - 4. All items listed in Part 2 - Products.
- C. Detailed shop drawing of clamping device and extensions when required in connection with the waterproofing membrane or the floor drain.

1.4 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American Society of Mechanical Engineers (ASME): (Copyrighted Society)
 - A112.6.3-01 (R 2007)....Standard for Floor and Trench Drains
 - A13.1-07.....Scheme for Identification of Piping Systems
 - B16.3-06.....Malleable Iron Threaded Fittings, Classes 150 and 300.
 - B16.4-06.....Standard for Grey Iron Threaded Fittings
Classes 125 and 250

- B16.12-98 (R 2006).....Cast Iron Threaded Drainage Fittings
- B16.15-06.....Cast Bronze Threaded Fittings, Classes 125 and 250
- C. American Society for Testing and Materials (ASTM):
- A47/A47M-99 (R 2004)....Standard Specification for Steel Sheet,
Aluminum Coated, by the Hot Dip Process
- A53/A53M-07.....Standard Specification for Pipe, Steel, Black
And Hot-Dipped, Zinc-coated, Welded and
Seamless
- A74-06.....Standard Specification for Cast Iron Soil Pipe
and Fittings
- A183-03.....Standard Specification for Carbon Steel Track
Bolts and Nuts
- A536-84 (R 2004).....Standard Specification for Ductile Iron
Castings
- B32-08.....Standard Specification for Solder Metal
- B75-02.....Standard Specification for Seamless Copper Tube
- B306-02.....*Standard Specification for Copper Drainage Tube*
(DWV)
- C564-03a.....Standard Specification for Rubber Gaskets for
Cast Iron Soil Pipe and Fittings
- D2000-08.....Standard Classification System for Rubber
Products in Automotive Applications
- D2564-04E1.....Standard Specification for Solvent Cements for
Poly (Vinyl Chloride) (PVC) Plastic Pipe and
Fittings
- D2665-08.....*Standard Specification for Poly (Vinyl*
Chloride) (PVC) Plastic Drain, Waste, and Vent
Pipe and Fittings
- D. International Code Council:
- IPC-06.....International Plumbing Code
- E. Cast Iron Soil Pipe Institute (CISPI):
- 301-05.....Hubless Cast Iron Soil Pipe and Fittings for
Sanitary and Storm Drain, Waste, and Vent
Piping Applications
- 310-04.....Coupling for Use in Connection with Hubless
Cast Iron Soil Pipe and Fittings for Sanitary
and Storm Drain, Waste, and Vent Piping

Applications

F. American Society of Sanitary Engineers (ASSE):

1018-01.....Trap Seal Primer Valves - Potable, Water
Supplied

G. Plumbing and Drainage Institute (PDI):

PDI WH-201.....Water Hammer Arrestor

PART 2 - PRODUCTS**2.1 SANITARY WASTE, DRAIN, AND VENT PIPING**

A. Cast iron waste, drain, and vent pipe and fittings

1. Cast iron waste, drain, and vent pipe and fittings shall be used for the following applications:
 - a. pipe buried in or in contact with earth
 - b. sanitary pipe extensions to a distance of approximately 1500 mm (5 feet) outside of the building.
 - c. interior waste and vent piping above grade.
2. Cast iron Pipe shall be bell and spigot or hubless (plain end or no-hub or hubless).
3. The material for all pipe and fittings shall be cast iron soil pipe and fittings and shall conform to the requirements of CISPI Standard 301, ASTM A-888, or ASTM A-74.
4. Joints for hubless pipe and fittings shall conform to the manufacturer's installation instructions. Couplings for hubless joints shall conform to CISPI 310. Joints for hub and spigot pipe shall be installed with compression gaskets conforming to the requirements of ASTM Standard C-564 or be installed with lead and oakum.

B. Polyvinyl Chloride (PVC)

1. Polyvinyl chloride (PVC) pipe and fittings are permitted where the waste temperature is below 60°C (140°F).
2. PVC piping and fittings shall NOT be used for the following applications:
 - a. Waste collected from steam condensate drains
 - b. spaces such as mechanical equipment rooms, kitchens, SPD, and sterilizer areas.
 - b. Vertical waste and soil stacks serving more than two floors
 - c. Exposed in mechanical equipment rooms.
 - d. Exposed inside of ceiling return plenums
3. Polyvinyl chloride sanitary waste, drain, and vent pipe and fittings

shall be schedule 40 solid core sewer piping conforming to ASTM D 1785 and ASTM D2665, sewer and drain series with ends for solvent cemented joints.

4. Fittings:

- a. PVC fittings shall be solvent welded socket type using solvent cement conforming to ASTM D2564.

2.2 EXPOSED WASTE PIPING

- A. Full iron pipe size chrome plated brass piping shall be used in finished rooms for exposed waste piping connecting fixtures, casework, cabinets, equipment and reagent racks when not concealed by apron including those furnished by the Government or specified in other sections.
 - 1. The Pipe shall meet Fed. Spec. WW-P-351, standard weight.
 - 2. The Fittings shall conform to ANSI B16.15, cast bronze threaded fittings with chrome finish, (125 and 250).
 - 3. Nipples shall conform to ASTM B 687, Chromium-plated.
 - 4. Unions shall be brass or bronze with chrome finish. Unions 65 mm (2-1/2 inches) and larger shall be flange type with approved gaskets.
- B. In unfinished Rooms such as mechanical Rooms and Kitchens, Chrome-plated brass piping is not required. The pipe materials specified under the paragraph "Sanitary Waste, Drain, and Vent Piping" can be used. The sanitary pipe in unfinished rooms shall be painted as specified in Section 09 91 00, PAINTING.

2.3 SPECIALTY PIPE FITTINGS

- A. Transition pipe couplings shall join piping with small differences in outside diameters or different materials. End connections shall be of the same size and compatible with the pipes being joined. The transition coupling shall be elastomeric, sleeve type reducing or transition pattern and include shear and corrosion resistant metal, tension band and tightening mechanism on each end. The transition coupling sleeve coupling shall be of the following material:
 - 1. For cast iron soil pipes, the sleeve material shall be rubber conforming to ASTM C564.
 - 2. For PVC soil pipes, the sleeve material shall be elastomeric seal or PVC, conforming to ASTM F 477 or ASTM D5926.
 - 3. For dissimilar pipes, the sleeve material shall be PVC conforming to ASTM D5926, or other material compatible with the pipe materials

being joined.

- B. The dielectric fittings shall conform to ASSE 1079 with a pressure rating of 860 kPa (125 psig) at a minimum temperature of 82°C (180°F). The end connection shall be solder joint copper alloy and threaded ferrous.
- C. Dielectric flange insulating kits shall be of non conducting materials for field assembly of companion flanges with a pressure rating of 1035 kPa (150 psig). The gasket shall be neoprene or phenolic. The bolt sleeves shall be phenolic or polyethylene. The washers shall be phenolic with steel backing washers.
- D. The di-electric nipples shall be electroplated steel nipple complying with ASTM F 1545 with a pressure ratings of 2070 kPa (300 psig) at 107°C (225°F). The end connection shall be male threaded. The lining shall be inert and noncorrosive propylene.

2.4 CLEANOUTS

- A. Cleanouts shall be the same size as the pipe, up to 100 mm (4 inches); and not less than 100 mm (4 inches) for larger pipe. Cleanouts shall be easily accessible and shall be gastight and watertight. Minimum clearance of 600 mm (24 inches) shall be provided for clearing a clogged sanitary line.
- B. Floor cleanouts shall be gray iron housing with clamping device and round, secured, scoriated, gray iron cover conforming to ASME A112.36.2M. A gray iron ferrule with hubless, socket, inside calk or spigot connection and counter sunk, taper-thread, brass or bronze closure plug shall be included. The frame and cover material and finish shall be nickel-bronze copper alloy with a square shape. The cleanout shall be vertically adjustable for a minimum of 50 mm (2 inches). When a waterproof membrane is used in the floor system, clamping collars shall be provided on the cleanouts. Cleanouts shall consist of wye fittings and eighth bends with brass or bronze screw plugs. Cleanouts in the resilient tile floors, quarry tile and ceramic tile floors shall be provided with square top covers recessed for tile insertion. In the carpeted areas, carpet cleanout markers shall be provided. Two way cleanouts shall be provided where indicated on drawings and at every building exit. The loading classification for cleanouts in sidewalk areas or subject to vehicular traffic shall be heavy duty type.
- C. Cleanouts shall be provided at or near the base of the vertical stacks

with the cleanout plug located approximately 600 mm (24 inches) above the floor. If there are no fixtures installed on the lowest floor, the cleanout shall be installed at the base of the stack. The cleanouts shall be extended to the wall access cover. Cleanout shall consist of sanitary tees. Nickel-bronze square frame and stainless steel cover with minimum opening of 150 by 150 mm (6 by 6 inches) shall be furnished at each wall cleanout. Where the piping is concealed, a fixture trap or a fixture with integral trap, readily removable without disturbing concealed pipe, shall be accepted as a cleanout equivalent providing the opening to be used as a cleanout opening is the size required.

- D. In horizontal runs above grade, cleanouts shall consist of cast brass tapered screw plug in fitting or caulked/hubless cast iron ferrule. Plain end (hubless) piping in interstitial space or above ceiling may use plain end (hubless) blind plug and clamp.

2.5 FLOOR DRAINS

- A. Type A (FD-A) floor drain shall comply with ANSI A112.6.3. A caulking flange, inside gasket, or hubless connection shall be provided for connection to cast iron pipe, screwed or no hub outlets for connection to steel pipe. The drain connection shall be bottom outlet. A membrane clamp and extensions shall be provided, if required, where installed in connection with waterproof membrane. Puncturing membrane other than for drain opening will not be permitted. Double drainage pattern floor drains shall have integral seepage pan for embedding into floor construction, and weep holes to provide adequate drainage from pan to drain pipe. For drains not installed in connection with a waterproof membrane, a 2.2 kg (16-ounce) soft copper membrane, 600 mm (24 inches) square or another approved waterproof membrane shall be provided.
- B. Type B (FD-B) floor drain shall comply with ANSI A112.6.3. The type B floor drain shall be constructed of galvanized cast iron with medium duty nickel bronze grate, double drainage pattern, clamping device, without sediment bucket but with secondary strainer in bottom. The grate shall be 175 mm (7 inches) minimum.
- C. Type C (FD-C) floor drain shall comply with ANSI A112.6.3. The type C floor drain shall have a cast iron body, double drainage pattern, clamping device, light duty square or round nickel bronze adjustable strainer and grate with vandal proof screws. The grate shall be square,

150 mm (6 inches) minimum.

2.6 TRAPS

A. Traps shall be provided on all sanitary branch waste connections from fixtures or equipment not provided with traps. Exposed brass shall be polished brass chromium plated with nipple and set screw escutcheons. Concealed traps may be rough cast brass or same material as pipe connected to. Slip joints are not permitted on sewer side of trap. Traps shall correspond to fittings on cast iron soil pipe or steel pipe respectively, and size shall be as required by connected service or fixture.

2.7 TRAP SEAL PRIMER VALVES AND TRAP SEAL PRIMER SYSTEMS

- A. Trap Primer (TP-1): The trap seal primer system shall be electronic type conforming to ASSE 1044.
 - 1. The controller shall have a 24 hour programmable timer, solid state, 6 outlet zones, minimum adjustable run time of 1 minute for each zone, 12 hour program battery backup, manual switch for 120VAC power, 120VAC to 24VAC internal transformer, fuse protected circuitry, UL listed, 120VAC input-24VAC output, constructed of enameled steel or plastic.
 - 2. The cabinet shall be recessed mounting with a stainless steel cover.
 - 3. The solenoid valve shall have a brass body, Buna "N" seats, normally closed, 5.98 kPa (125 psi) rated, 24VAC.
 - 4. The control wiring shall be copper in accordance with the latest edition of the National Electric Code, Article 725 and not less than 18 gauge. All wiring shall be in conduit and in accordance with Division 26 of the specifications.
 - 5. The vacuum breaker shall conform to ASSE 1001.

2.8 WATERPROOFING

- A. A sleeve flashing device shall be provided at points where pipes pass through membrane waterproofed floors or walls. The sleeve flashing device shall be manufactured, cast iron fitting with clamping device that forms a sleeve for the pipe floor penetration of the floor membrane. A galvanized steel pipe extension shall be included in the top of the fitting that will extend 50 mm (2 inches) above finished floor and galvanized steel pipe extension in the bottom of the fitting that will extend through the floor slab. A waterproof caulked joint shall be provided at the top hub.
- B. Walls: See detail shown on drawings.

PART 3 - EXECUTION**3.1 PIPE INSTALLATION**

- A. The pipe installation shall comply with the requirements of the International Plumbing Code (IPC) and these specifications.
- B. Branch piping shall be installed for waste from the respective piping systems and connect to all fixtures, valves, cocks, outlets, casework, cabinets and equipment, including those furnished by the Government or specified in other sections.
- C. Pipe shall be round and straight. Cutting shall be done with proper tools. Pipe shall be reamed to full size after cutting.
- D. All pipe runs shall be laid out to avoid interference with other work.
- E. The piping shall be installed above accessible ceilings where possible.
- F. The piping shall be installed to permit valve servicing or operation.
- G. Unless specifically indicated on the drawings, the minimum slope shall be 2% slope.
- H. The piping shall be installed free of sags and bends.
- I. Seismic restraint shall be installed where required by code.
- J. Changes in direction for soil and waste drainage and vent piping shall be made using appropriate branches, bends and long sweep bends. Sanitary tees and short sweep quarter bends may be used on vertical stacks if change in direction of flow is from horizontal to vertical. Long turn double wye branch and eighth bend fittings shall be used if two fixtures are installed back to back or side by side with common drain pipe. Straight tees, elbows, and crosses may be used on vent lines. Do not change direction of flow more than 90 degrees. Proper size of standard increaser and reducers shall be used if pipes of different sizes are connected. Reducing size of drainage piping in direction of flow is prohibited.
- K. Buried soil and waste drainage and vent piping shall be laid beginning at the low point of each system. Piping shall be installed true to grades and alignment indicated with unbroken continuity of invert. Hub ends shall be placed upstream. Required gaskets shall be installed according to manufacturer's written instruction for use of lubricants, cements, and other installation requirements.
- L. Cast iron piping shall be installed according to CISPI's "Cast Iron Soil Pipe and Fittings Handbook," Chapter IV, "Installation of Cast Iron Soil Pipe and Fittings"
- M. Aboveground PVC piping shall be installed according to ASTM D2665.

Underground PVC piping shall be installed according to ASTM D2321.

3.2 JOINT CONSTRUCTION

- A. Hub and spigot, cast iron piping with gasket joints shall be joined in accordance with CISPI's "Cast Iron Soil Pipe and Fittings Handbook" for compression joints.
- B. Hub and spigot, cast iron piping with calked joints shall be joined in accordance with CISPI's "Cast Iron Soil Pipe and Fittings Handbook" for lead and oakum calked joints.
- C. Hubless or No-hub, cast iron piping shall be joined in accordance with CISPI's "Cast Iron Soil Pipe and Fittings Handbook" for hubless piping coupling joints.
- D. For threaded joints, thread pipe with tapered pipe threads according to ASME B1.20.1. The threads shall be cut full and clean using sharp disc cutters. Threaded pipe ends shall be reamed to remove burrs and restored to full pipe inside diameter. Pipe fittings and valves shall be joined as follows:
 - 1. Apply appropriate tape or thread compound to external pipe threads unless dry seal threading is required by the pipe service
 - 2. Pipe sections with damaged threads shall be replaced with new sections of pipe.
- E. For PVC piping, solvent cement joints shall be used for joints. All surfaces shall be cleaned and dry prior to applying the primer and solvent cement. Installation practices shall comply with ASTM F402. The joint shall conform to ASTM D2855 and ASTM D2665 appendixes.

3.3 SPECIALTY PIPE FITTINGS

- A. Transition coupling shall be installed at pipe joints with small differences in pipe outside diameters.
- B. Dielectric fittings shall be installed at connections of dissimilar metal piping and tubing.

3.3 PIPE HANGERS, SUPPORTS AND ACCESSORIES:

- A. All piping shall be supported according to the International Plumbing Code (IPC), Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING, and these specifications. Where conflicts arise between these the code and Section 22 05 11, the most restrictive or the requirement that specifies supports with highest loading or shortest spacing shall apply.
- B. Hangers, supports, rods, inserts and accessories used for pipe supports shall be shop coated with zinc chromate primer paint. Electroplated

- copper hanger rods, hangers and accessories may be used with copper tubing.
- C. Horizontal piping and tubing shall be supported within 300 mm (12 inches) of each fitting or coupling.
 - D. Horizontal cast iron piping shall be supported with the following maximum horizontal spacing and minimum hanger rod diameters:
 - 1. 40 mm or DN40 to 50 mm or DN50 (NPS 1-1/2 inch to NPS 2 inch): 1500 mm (60 inches) with 10 mm (3/8 inch) rod.
 - 2. 80 mm or DN 80 (NPS 3 inch): 1500 mm (60 inches) with 13 mm (1/2 inch) rod.
 - 3. 100 mm or DN100 to 125 mm or DN125 (NPS 4 to NPS 5): 1500 mm (60 inches) with 16 mm (5/8 inch) rod.
 - 4. 150 mm or DN150 to 200 mm or DN200 (NPS 6 inch to NPS 8 inch): 1500 mm (60 inches) with 19 mm (3/4 inch) rod.
 - 5. 250 mm or DN250 to 300 mm or DN 300 (NPS 10 inch to NPS 12 inch): 1500 mm (60 inch) with 22 mm (7/8 inch) rod.
 - E. The maximum spacing for plastic pipe shall be 1.22 m (4 feet).
 - F. Vertical piping and tubing shall be supported at the base, at each floor, and at intervals no greater than 4.57 m (15 feet).
 - G. In addition to the requirements in Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING, floor, Wall and Ceiling Plates, Supports, Hangers shall have the following characteristics:
 - 1. Solid or split unplated cast iron.
 - 2. All plates shall be provided with set screws.
 - 3. Height adjustable clevis type pipe hangers.
 - 4. Adjustable floor rests and base flanges shall be steel.
 - 5. Hanger rods shall be low carbon steel, fully threaded or threaded at each end with two removable nuts at each end for positioning rod and hanger and locking each in place.
 - 7. Riser clamps shall be malleable iron or steel.
 - 8. Rollers shall be cast iron.
 - 9. See Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING, for requirements on insulated pipe protective shields at hanger supports.
 - H. Miscellaneous materials shall be provided as specified, required, directed or as noted on the drawings for proper installation of hangers, supports and accessories. If the vertical distance exceeds 6 m (20 feet) for cast iron pipe additional support shall be provided in

the center of that span. All necessary auxiliary steel shall be provided to provide that support.

- I. Cast escutcheon with set screw shall be provided at each wall, floor and ceiling penetration in exposed finished locations and within cabinets and millwork.
- J. Penetrations:
 - 1. Fire Stopping: Where pipes pass through fire partitions, fire walls, smoke partitions, or floors, a fire stop shall be installed that provides an effective barrier against the spread of fire, smoke and gases as specified in Section 07 84 00, FIRESTOPPING. Clearances between raceways and openings shall be completely filled and sealed with the fire stopping materials.
 - 2. Water proofing: At floor penetrations, clearances shall be completely sealed around the pipe and make watertight with sealant as specified in Section 07 92 00, JOINT SEALANTS.
- K. Piping shall conform to the following:
 - 1. Waste and Vent Drain to main stacks:

Pipe Size	Minimum Pitch
80 mm or DN 80 (3 inches) and smaller	2%
100 mm or DN 100 (4 inches) and larger	1%

- 2. Exhaust vents shall be extended separately through roof. Sanitary vents shall not connect to exhaust vents.

3.4 TESTS

- A. Sanitary waste and drain systems shall be tested either in its entirety or in sections.
- B. Waste System tests shall be conducted before trenches are backfilled or fixtures are connected. A water test or air test shall be conducted, as directed.
 - 1. If entire system is tested for a water test, tightly close all openings in pipes except highest opening, and fill system with water to point of overflow. If the waste system is tested in sections, tightly plug each opening except highest opening of section under test, fill each section with water and test with at least a 3 m (10 foot) head of water. In testing successive sections, test at least

upper 3 m (10 feet) of next preceding section so that each joint or pipe except upper most 3 m (10 feet) of system has been submitted to a test of at least a 3 m (10 foot) head of water. Water shall be kept in the system, or in portion under test, for at least 15 minutes before inspection starts. System shall then be tight at all joints.

2. For an air test, an air pressure of 35 kPa (5 psig) gage shall be maintained for at least 15 minutes without leakage. A force pump and mercury column gage shall be used for the air test.
3. After installing all fixtures and equipment, open water supply so that all p-traps can be observed. For 15 minutes of operation, all p-traps shall be inspected for leaks and any leaks found shall be corrected.
3. Final Tests: Either one of the following tests may be used.
 - a. Smoke Test: After fixtures are permanently connected and traps are filled with water, fill entire drainage and vent systems with smoke under pressure of 1.3 kPa (1 inch of water) with a smoke machine. Chemical smoke is prohibited.
 - b. Peppermint Test: Introduce (2 ounces) of peppermint into each line or stack.

- - - E N D - - -

SECTION 22 14 00
FACILITY STORM DRAINAGE

PART 1 - GENERAL

1.1 DESCRIPTION

This section describes the requirements for storm drainage systems, including piping and all necessary accessories as designated in this section.

1.2 RELATED WORK

- A. Section 07 84 00, FIRESTOPPING: Penetrations in rated enclosures.
- B. Section 09 91 00, PAINTING: Preparation and finish painting and identification of piping systems.
- C. Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING: Pipe Hangers and Supports, Materials Identification.
- D. Section 23 07 11, HVAC, PLUMBING, AND BOILER PLANT INSULATION: Pipe Insulation.

1.3 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturer's Literature and Data:
 - 1. Piping.
 - 2. Roof Drains.
 - 3. Cleanouts.
 - 4. All items listed in Part 2 - Products.
- C. Detailed shop drawing of clamping device and extensions when required in connection with the waterproofing membrane.

1.4 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American National Standards Institute (ANSI).
- C. American Society of Mechanical Engineers (ASME): (Copyrighted Society)
 - A112.21.2m-83.....Roof Drains
 - A13.1-07.....Scheme for Identification of Piping Systems
 - B16.3-06.....Malleable Iron Threaded Fittings, Classes 150 and 300. B16.9-07 Factory-Made Wrought Steel Butt welding Fittings
 - B16.11-05.....Forged Steel Fittings, Socket-Welding and

	Threaded B16.12-98 (R 2006)	Cast Iron Threaded Drainage Fittings
B16.15-06).....	Cast Bronze Threaded Fittings, Class 125 and 250	
D. American Society for Testing and Materials (ASTM):		
A47-99 (R 2004).....	Standard Specification for Steel Sheet, Aluminum Coated, by the Hot-Dip Process	
A53-07.....	Standard Specification for Pipe, Steel, Black And Hot-Dipped, Zinc-coated Welded and Seamless	
A74-06.....	Standard Specification for Cast Iron Soil Pipe and Fittings	
A183-03).....	Standard Specification for Carbon Steel Track Bolts and Nuts	
A312-03.....	Standard Specification for Seamless and Welded Austenitic Stainless Steel Pipe	
A536-84 (R 2004).....	Standard Specification for Ductile Iron Castings	
A733-03.....	Standard Specification for Welded and Seamless Carbon Steel and Austenitic Stainless Steel Pipe Nipples	
B32-04.....	Standard Specification for Solder Metal	
B61-08.....	Standard Specification for Steam or Bronze Castings	
B62-02.....	Standard Specification for Composition Bronze or Ounce Metal Castings	
C564-06a.....	Standard Specification for Rubber Gaskets for Cast Iron Soil Pipe and Fittings	
D2000-08.....	Standard Classification System for Rubber Products in Automotive Applications	
D4101-07.....	Standard Specification for Propylene Plastic Injection and Extrusion Materials	
D2447-03.....	Standard Specification for Polyethylene (PE) Plastic Pipe, Schedule 40 and 80, Based on Outside Diameter	
D2564-04e1.....	Standard Specification for Solvent Cements for Poly (Vinyl Chloride) (PVC) Plastic Pipe and Fittings	
D2665-07.....	Standard Specification for Poly (Vinyl	

Chloride) (PVC) Plastic Drain, Waste, and Vent
Pipe and Fittings

E. American Welding Society (AWS):

A5.8-04.....Specification for Filler Metals for Brazing and
Braze Welding

F. International Code Council (ICC):

IPC-06.....International Plumbing Code

G. Cast Iron Soil Pipe Institute (CISPI):

301-05.....Hubless Cast Iron Soil and Fittings for
Sanitary and Storm Drain, Waste, and Vent
Piping Applications

310-04.....Couplings for Use in Connection with Hubless
Cast Iron Soil and Fittings for Sanitary and
Storm Drain, Waste, and Vent Piping
Applications

H. Manufacturers Standardization Society of the Valve and Fittings
Industry, Inc. (MSS):

SP-72-99.....Standard for Ball Valves with Flanged or Butt
Welding For General Purpose

SP-110-96.....Ball Valve Threaded, Socket Welding, Solder
Joint, Grooved and Flared Ends

PART 2 - PRODUCTS

2.1 STORM WATER DRAIN PIPING

A. Cast Iron Storm Pipe and Fittings:

1. Cast iron storm pipe and fittings shall be used for the following applications:
 - a. Pipe buried in or in contact with earth.
 - b. Extension of pipe to a distance of approximately 1500 mm (5 feet) outside of building walls.
 - c. Interior storm piping above grade.
 - d. All mechanical equipment rooms or other areas containing mechanical air handling equipment.
2. The cast iron storm Pipe shall be bell and spigot, or hubless (plain end or no-hub) as required by selected jointing method.
3. The material for all pipe and fittings shall be cast iron soil pipe and fittings and shall conform to the requirements of CISPI Standard 301, ASTM A-888, or ASTM A-74.
4. Joints for hubless pipe and fittings shall conform to the

manufacturer's installation instructions. Couplings for hubless joints shall conform to CISPI 310. Joints for hub and spigot pipe shall be installed with compression gaskets conforming to the requirements of ASTM Standard C-564 or be installed with leak and oakum.

B. Polyvinyl Chloride (PVC)

1. Polyvinyl chloride storm sewer pipe and fittings are permitted for single story structures except for mechanical equipment rooms and other areas containing air handling equipment or hot water generation equipment.
2. Polyvinyl chloride storm sewer pipe and fittings shall be schedule 40 solid core sewer piping conforming to ASTM D1785 and D 2665, Sewer and Drain Series, with ends for solvent cemented joints.
3. Polyvinyl chloride joints shall be solvent welded socket type using solvent cement conforming to ASTM D2564.

C. Roof drain piping in locations where the outdoor conditions are subject to freezing shall be insulated.

2.3 SPECIALTY PIPE FITTINGS

- A. Transition pipe couplings shall join piping with small differences in outside diameters or be of different materials. End connections shall be of the same size and compatible with the pipes being joined. The transition coupling shall be elastomeric, sleeve type reducing or transition pattern and include shear erring and corrosion resistant metal tension band and tightening mechanism on each end. The transition coupling sleeve coupling shall be of the following material:
1. For cast iron soil pipes, the sleeve material shall be rubber conforming to ASTM C564.
 2. For PVC soil pipes, the sleeve material shall be elastomeric seal or PVC, conforming to ASTM F 477 or ASTM D5926.
 3. For dissimilar pipes, the sleeve material shall be PVC conforming to ASTM D5926, or other material compatible with the pipe materials being joined.
- B. The dielectric fittings shall conform to ASSE 1079 with a pressure rating of 860 kPa (125 psig) at a minimum temperature of 82°C (180°F). The end connection shall be solder joint copper alloy and threaded ferrous.
- C. Dielectric flange insulating kits shall be of non conducting materials for field assembly of companion flanges with a pressure rating of 1035

- kPa (150 psig). The gasket shall be neoprene or phenolic. The bolt sleeves shall be phenolic or polyethylene. The washers shall be phenolic with steel backing washers.
- D. The dielectric nipples shall be electroplated steel nipple comply with ASTM F 1545 with a pressure ratings of 2070 kPa (300 psig) at 107°C (225°F). The end connection shall be male threaded. The lining shall be inert and noncorrosive propylene.

2.4 CLEANOUTS

- A. Cleanouts shall be the same size as the pipe, up to 100 mm (4 inches); not less than 100 mm (4 inches) for larger pipe. Cleanouts shall be easily accessible and shall be gastight and watertight. A minimum clearance of 600 mm (24 inches) shall be provided for clearing a clogged storm sewer line.
- B. Floor cleanouts shall be gray iron housing with clamping device and round, secured, scoriated, gray iron cover conforming to ASME A112.36.2M. A gray iron ferrule with hubless, socket, inside calk or spigot connection and counter sunk, taper-thread, brass or bronze closure plug shall be included. The frame and cover material and finish shall be nickel-bronze copper alloy with a square shape. The cleanout shall be vertically adjustable for a minimum of 50 mm (2 inches). When a waterproof membrane is used in the floor system, clamping collars shall be provided on the cleanouts. Cleanouts shall consist of wye fittings and eighth bends with brass or bronze screw plugs. Cleanouts in the resilient tile floors, quarry tile and ceramic tile floors shall be provided with square top covers recessed for tile insertion. In the carpeted areas, carpet cleanout markers shall be provided. Two way cleanouts where shall be provided where indicated on the drawings and at each building exit. The loading classification for cleanouts in sidewalk areas or subject to vehicular traffic shall be heavy duty.
- C. Cleanouts shall be provided at or near the base of the vertical stacks with the cleanout plug located approximately 600 mm (24 inches) above the floor. The cleanouts shall be extended to the wall access cover. Cleanout shall consist of sanitary tees. Nickel bronze square frame and stainless steel cover with minimum opening of 150 mm by 150 mm (6 inch by 6 inch) shall be provided at each wall cleanout.
- D. In horizontal runs above grade, cleanouts shall consist of cast brass tapered screw plug in fitting or caulked/no hub cast iron ferrule.

Plain end (no-hub) piping in interstitial space or above ceiling may use plain end (no-hub) blind plug and clamp.

2.5 ROOF DRAINS AND CONNECTIONS

- A. Roof Drains: Roof Drains (RD) shall be cast iron with clamping device for making watertight connection. Free openings through strainer shall be twice area of drain outlet. For roof drains not installed in connection with a waterproof membrane, a soft copper membrane shall be provided 300 mm (12 inches) in diameter greater than outside diameter of drain collar. An integral gravel stop shall be provided for drains installed on roofs having built up roofing covered with gravel or slag. Integral no-hub, soil pipe gasket or threaded outlet connection shall be provided.
1. Flat Roofs: The roof drain shall have a beehive or dome shaped strainer with integral flange not less than 300 mm (12 inches) in diameter. For an insulated roof, a roof drain with an adjustable drainage collar shall be provided, which can be raised or lowered to meet required insulation heights, sump receiver and deck clamp. The Bottom section shall serve as roof drain during construction before insulation is installed.
 2. Canopy Roofs: The roof drain shall have a beehive or dome shaped strainer with the integral flange not larger than 200 mm (8 inches) in diameter. For an insulated roof, the roof drain shall be provided with an adjustable drainage collar, which can be raised or lowered to meet the required insulation heights, sump receiver and deck clamp. Bottom section shall serve as roof drain during construction before insulation is installed.
 3. Promenade Decks: the roof drain shall be the same as for canopy roofs, except decks shall have flat, round, loose, non-slip, bronze grate set in square, non-slip, bronze frame.
 4. Portico Roofs and Gutters: Roof drains shall be horizontal angle type drain with flat bottom and horizontal outlet at the same elevation as the pipe to which it is connected. Strainer shall be removable angle grate type.
 5. Protective Roof Membrane Insulation Assembly: The roof drain shall have a perforated stainless steel extension filter, non puncturing clamp ring, large sump with extra wide roof flange and deck clamp.
 - a. Non pedestrian Roofs: The roof drain shall have large polypropylene or aluminum locking dome.

- b. Pedestrian Roof: The rood drain shall have a bronze promenade top 350 mm (14 inches) square, set in square secured frame support collar.
- 6. Roof Drains, Overflow: Roof Drains identified as overflow drains shall have a 50 mm (2 inch) water dam integral to the drain body.
- 7. Roof drains in areas subject to freezing shall have heat tape and shall be insulated.
- B. Expansion Joints: Expansions joints shall be heavy cast iron with cast brass or copper expansion sleeve having smooth bearing surface working freely against a packing ring held in place and under pressure of a bolted gland ring, forming a water and air tight flexible joint. Asbestos packing is prohibited.
- C. Interior Downspouts: An expansion joint shall be provided, specified above, at top of run on straight, vertical runs of downspout piping 12 m (40 feet) long or more.
- D. Downspout Nozzle: The downspout nozzle fitting shall be of brass, unfinished, with internal pipe thread for connection to downspout.

2.6 WATERPROOFING

- A. A sleeve flashing device shall be provided at points where pipes pass through membrane waterproofed floors or walls. The sleeve flashing device shall be manufactured, cast iron fitting with clamping device that forms a sleeve for the pipe floor penetration of the floor membrane. A galvanized steel pipe extension shall be included in the top of the fitting that will extend 50 mm (2 inches) above finished floor and galvanized steel pipe extension in the bottom of the fitting that will extend through the floor slab. A waterproofed caulked joint shall be provided at the top hub.
- B. Walls: See detail shown on drawings.

PART 3 - EXECUTION

3.1 PIPE INSTALLATION

- A. The pipe installation shall comply with the requirements of the International code and these specifications.
- B. Branch piping shall be installed from the piping system and connect to all drains and outlets.
- C. Pipe shall be round and straight. Cutting shall be done with proper tools. Pipe shall be reamed to full size after cutting.
- D. All pipe runs shall be laid out to avoid interference with other work.
- E. The piping shall be installed above accessible ceilings to allow for

- ceiling panel removal.
- F. Unless otherwise stated on the documents, minimum horizontal slope shall be one inch for every 1.22 m (4 feet) of pipe length.
 - G. The piping shall be installed free of sags and bends.
 - H. Seismic restraint shall be installed where required by code.
 - I. Changes in direction for storm drainage piping shall be made using appropriate branches, bends and long sweep bends. Sanitary tees and short sweep $\frac{1}{4}$ bends may be used on vertical stacks if change in direction of flow is from horizontal to vertical. Long turn double wye branch and $\frac{1}{8}$ bend fittings shall be used if two fixtures are installed back to back or side by side with common drain pipe. Do not change direction of flow more than 90 degrees. Proper size of standard increaser and reducers shall be used if pipes of different sizes are connected. Reducing size of drainage piping in direction of flow is prohibited.
 - J. Buried storm drainage piping shall be laid beginning at the low point of each system. Piping shall be installed true to grades and alignment indicated with unbroken continuity of invert. Hub ends shall be placed upstream. Required gaskets shall be installed according to manufacturer's written instruction for use of lubricants, cements, and other installation requirements.
 - K. Cast iron piping shall be installed according to CISPI's "Cast Iron Soil Pipe and Fittings Handbook," Chapter IV, "Installation of Cast Iron Soil Pipe and Fittings"
 - L. Aboveground PVC piping shall be installed according to ASTM D2665. Underground PVC piping shall be installed according to ASTM D2321.

3.2 JOINT CONSTRUCTION

- A. Hub and spigot, cast iron piping with gasket joints shall be joined in accordance with CISPI's "Cast Iron Soil Pipe and Fittings Handbook" for compression joints.
- B. Hub and spigot, cast iron piping with calked joints shall be joined in accordance with CISPI's "Cast Iron Soil Pipe and Fittings Handbook" for lead and oakum calked joints.
- C. Hubless, cast iron piping shall be joined in accordance with CISPI's "Cast Iron Soil Pipe and Fittings Handbook" for hubless piping coupling joints.
- D. For threaded joints, thread pipe with tapered pipe threads according to ASME B1.20.1. The threads shall be cut full and clean using sharp disc

cutters. Threaded pipe ends shall be reamed to remove burrs and restored to full pipe inside diameter. Pipe fittings and valves shall be joined as follows:

1. Apply appropriate tape or thread compound to external pipe threads unless dry seal threading is required by the pipe service
 2. Pipe sections with damaged threads shall be replaced with new sections of pipe.
- E. For PVC piping, solvent cement joints shall be used for joints. All surfaces shall be cleaned and dry prior to applying the primer and solvent cement. Installation practices shall comply with ASTM F402. The joint shall conform to ASTM D2855 and ASTM D2665 appendixes.

3.3 SPECIALTY PIPE FITTINGS

- A. Transition coupling shall be installed at pipe joints with small differences in pipe outside diameters.
- B. Dielectric fittings shall be installed at connections of dissimilar metal piping and tubing.

3.4 PIPE HANGERS, SUPPORTS AND ACCESSORIES:

- A. All piping shall be supported according to the International plumbing code, Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING, and these specifications.
- B. Hangers, supports, rods, inserts and accessories used for Pipe supports shall be shop coated with zinc Chromate primer paint. Electroplated copper hanger rods, hangers and accessories may be used with copper tubing.
- C. Horizontal piping and tubing shall be supported within 300 mm (12 inches) of each fitting or coupling.
- D. Horizontal cast iron piping shall be supported with the following maximum horizontal spacing and minimum hanger rod diameters:
 1. NPS 1-1/2 to NPS 2 (DN 40 to DN 50): 1500 mm (60 inches) with 10 mm (3/8 inch) rod.
 2. NPS 3 (DN 80): 1500 mm (60 inches) with 13 mm (1/2 inch) rod.
 3. NPS 4 to NPS 5 (DN 100 to DN 125): 1500 mm (60 inches) with 16 mm (5/8 inch) rod.
 4. NPS 6 to NPS 8 (DN 150 to DN 200): 1500 mm (60 inches) with 19 mm (3/4 inch) rod.
 5. NPS 10 to NPS 12 (DN 250 to DN 300): 1500 mm (60 inches) with 22 mm (7/8 inch) rod.
- E. The maximum support spacing for horizontal plastic shall be 1.22 m (4

- feet).
- F. Vertical piping and tubing shall be supported at the base, at each floor, and at intervals no greater than 4.57 m (15 feet).
 - G. In addition to the requirements in Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING, floor, Wall and Ceiling Plates shall have the following characteristics:
 - 1. Solid or split unplated cast iron.
 - 2. All plates shall be provided with set screws.
 - 3. Height adjustable clevis type pipe hangers.
 - 4. Adjustable Floor Rests and Base Flanges shall be steel.
 - 5. Hanger Rods shall be low carbon steel, fully threaded or Threaded at each end with two removable nuts at each end for positioning rod and hanger and locking each in place.
 - 6. Riser Clamps shall be malleable iron or steel.
 - 7. Roller shall be cast iron.
 - 8. Hangers and supports utilized with insulated pipe and tubing shall have 180 degree (min.) metal protection shield Centered on and welded to the hanger and support. The shield shall be 4 inches in length and be 16 gage steel. The shield shall be sized for the insulation.
 - H. Miscellaneous Materials shall be provided as specified, required, directed or as noted on the drawings for proper installation of hangers, supports and accessories. If the vertical distance exceeds 6 m (20 feet) for cast iron pipe additional support shall be provided in the center of that span. All necessary auxiliary steel shall be provided to provide that support.
 - I. Cast escutcheon with set screw shall be installed at each wall, floor and ceiling penetration in exposed finished locations and within cabinets and millwork.
 - J. Penetrations:
 - 1. Fire Stopping: Where pipes pass through fire partitions, fire walls, smoke partitions, or floors, a fire stop shall be installed that provides an effective barrier against the spread of fire, smoke and gases as specified in Section 07 84 00, FIRESTOPPING. Clearances between raceways and openings shall be completely filled and sealed with the fire stopping materials.
 - 2. Water proofing: At floor penetrations, Clearances around the pipe shall be completely sealed and made watertight with sealant as

specified in Section 07 92 00, JOINT SEALANTS.

K. Piping shall conform to the following:

1. Storm Water Drain and Vent Drain to main stacks:

Pipe Size	Minimum Pitch
80 mm (3 inches) and smaller	2%
100 mm (4 inches) (4 inches) and larger	1%

3.5 TESTS

- A. Storm sewer system shall be tested either in its entirety or in sections.
- B. Storm Water Drain tests shall be conducted before trenches are backfilled or fixtures are connected. A water test or air test shall be conducted, as directed.
 1. If entire system is tested with water, tightly close all openings in pipes except the highest opening, and fill system with water to point of overflow. If system is tested in sections, tightly plug each opening except highest opening of section under test, fill each section with water and test with at least a 3 m (10 foot) head of water. In testing successive sections, test at least upper 3 m (10 feet) of next preceding section so that each joint or pipe except upper most 3 m (10 feet) of system has been submitted to a test of at least a 3 m (10 foot) head of water. Water shall be kept in the system, or in portion under test, for at least 15 minutes before inspection starts. System shall then be tight at all joints.
 2. For an air test, an air pressure of 35 kPa (5 psi) gage shall be maintained for at least 15 minutes without leakage. A force pump and mercury column gage shall be used for the test.
 3. Final Tests: Either one of the following tests may be used.
 - a. Smoke Test: After fixtures are permanently connected and traps are filled with water, fill entire drainage and vent systems with smoke under pressure of 1.3 kPa (1 inch of water) with a smoke machine. Chemical smoke is prohibited.
 - b. Peppermint Test: Introduce .06 liters (2 ounces) of peppermint into each line or stack.

- - - E N D - - -

SECTION 22 14 29**SUMP PUMPS****PART 1 - GENERAL****1.1 DESCRIPTION**

Sump pumps.

1.2 RELATED WORK

- A. Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.
- B. Section 22 05 12, GENERAL MOTOR REQUIREMENTS FOR PLUMBING EQUIPMENT.

1.3 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturer's Literature and Data:
 - 1. Pump:
 - a. Manufacturer and model.
 - b. Operating speed.
 - c. Capacity.
 - d. Characteristic performance curves.
 - 2. Motor:
 - a. Manufacturer.
 - b. Speed.
 - c. Current Characteristics and W (HP).
 - d. Efficiency.
- C. Certified copies of all the factory and construction site test data sheets and reports.
- D. Complete operating and maintenance manuals including wiring diagrams, technical data sheets and information for ordering replaceable parts:
 - 1. Include complete connection which indicates all components of the system.
 - 2. Include complete diagrams of the internal wiring for each item of equipment.
 - 3. Diagrams shall have their terminals identified to facilitate installation, operation and maintenance.

1.4 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. National Electrical Manufacturers Association (NEMA):
 - ICS6-93 (R2001).....Industrial Control and Systems Enclosures

250-03.....Enclosures for Electrical Equipment (1000 Volts
Maximum)

C. Underwriters' Laboratories, Inc. (UL):

508-99 (R2002).....Safety Industrial Control Equipment

PART 2 - PRODUCTS

2.1 COMPACT, OIL SMART, SUBMERSIBLE ELEVATOR PIT SUMP PUMPS:

- A. Description: Simplex, submersible, direct-connected sump pump.
1. Casing: Cast iron or stainless steel with metal inlet strainer. Include discharge companion flange suitable for plain-end pipe connection arranged for vertical discharge.
 2. Impeller: Cast iron, bronze, brass, or stainless steel.
 3. Pump and Motor Shaft: Steel, with factory-sealed, grease-lubricated ball bearings.
 4. Seal: Mechanical type.
 5. Motor: Hermetically sealed, capacitor-start type; with built-in overload protection; and three-conductor waterproof power cable of length required, with grounding plug and cable-sealing assembly for connection at pump.
 6. Pump Discharge Piping: Factory or field fabricated, ASTM A 53, Schedule 40, galvanized-steel pipe or copper tube.
 7. Oil Smart Switch: Industrial grade, with 10 foot cord and plug.
 8. Oil Smart Alarm: High liquid audible alarm, red beacon; Oil present-amber light; Water present-white light.
 9. High Liquid Sensor Switch: Indicate oil or water.
 10. High Liquid Float Switch: Indicate high liquid level.
 11. Remote Flashing Strobe Light: Warning type, red in color, low voltage.

PART 3 - EXECUTION

3.1 TEST

- A. Make tests as recommended by product manufacturer and listed standards and under actual or simulated operating conditions and prove full compliance with design and specified requirements. Tests of the various items of equipment shall be performed simultaneously with the system of which each item is an integral part.
- B. When any defects are detected, correct defects and repeat test.

- - - E N D - - -

SECTION 22 35 00
DOMESTIC WATER HEAT EXCHANGERS

PART 1 - GENERAL

1.1 DESCRIPTION:

This section describes the requirements for domestic hot water heat exchangers including thermometers and all necessary accessories, connections and equipment.

1.2 RELATED WORK:

- A. Section 09 91 00, PAINTING: Preparation and finish painting.
- B. Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.
- C. Section 22 11 23, DOMESTIC WATER PUMPS: Circulating Pump.
- D. Section 23 07 11, HVAC, PLUMBING, AND BOILER PLANT INSULATION: Heater Insulation.
- E. Section 22 05 19, METERS AND GAGES FOR PLUMBING PIPING, 22 05 23, GENERAL-DUTY VALVES FOR PLUMBING PIPING, and 22 11 00, FACILITY WATER DISTRIBUTION: Piping, Fittings, Valves and Gages.

1.3 SUBMITTALS:

- A. Submit manufacturer's literature and data pertaining to the water heater in properly bound package, in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES. Include the following as a minimum:
 - 1. Heat Exchangers.
 - 2. Pressure and Temperature Relief Valves.
 - 3. Steam Control Valves.
 - 4. Thermometers.
 - 5. Pressure Gages.
 - 6. Vacuum Breakers.
- B. Equipment components in contact with potable water shall meet NSF compliance requirements in document NSF 61, "Drinking Water System Components - Health Effects.
- C. A form U-1 or other documentation stating compliance with the ASME Boiler and Pressure Vessel code.

1.4 APPLICABLE PUBLICATIONS:

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American National Standard Institute (ANSI):
 - Z21.22-00/4.4A-00.....Relief Valves for Hot Water Supply systems

C. American Society of Mechanical Engineers (ASME):

B1.20.1-01.....Pipe Threads, General Purpose

B16.5-03.....Pipe Flanges and Flanged Fittings, NPS ½
through NPS 24

B16.24-06.....Cast Copper Alloy Pipe Flanges, Class 150,
300,600, 900, 1500, 2500

PTC 25.3-02.....Pressure Relief Devices

Section IV-07.....Heating Boilers

Section VIII-07.....Pressure Vessels Division 1

1.5 AS-BUILT DOCUMENTATION

- A. The electronic documentation and copies of the Operations and Maintenance Manual, approved submittals, shop drawings, and other closeout documentation shall be prepared by a computer software program complying with Section 508 of the Rehabilitation Act of 1973, as amended (29 U.S.C 794d). The manufacturer or vendor of the software used to prepare the electronic documentation shall have a Voluntary Product Accessibility Template made available for review and included as part of the Operations and Maintenance Manual or closeout documentation. All available accessibility functions listed in the Voluntary Accessibility Template shall be enabled in the prepared electronic files. As Adobe Acrobat is a common industry format for such documentation, following the document, "Creating Accessible Adobe PDF files, A Guide for Document Authors" that is maintained and made available by Adobe free of charge is recommended."
- B. Four sets of manufacturer's literature and data updated to include submittal review comments and any equipment substitutions.
- C. Four sets of operation and maintenance data updated to include submittal review comments shall be inserted into a three ring binder. All aspects of system operation and maintenance procedures, including piping isometrics, wiring diagrams of all circuits, a written description of system design, control logic, and sequence of operation shall be included in the operation and maintenance manual. The operations and maintenance manual shall include troubleshooting techniques and procedures for emergency situations. Notes on all special systems or devices such as damper and door closure interlocks shall be included. A List of recommended spare parts (manufacturer, model number, and quantity) shall be furnished. Information explaining

any special knowledge or tools the owner will be required to employ shall be inserted into the As-Built documentation.

PART 2 - PRODUCTS

2.1 SHELL AND TUBE, DOMESTIC WATER HEAT EXCHANGERS:

- A. The shell and tube heat exchangers shall be semi-instantaneous type, vertical with water in the shell and steam in the tubes. The shell and tube heat exchanger shall be a packaged assembly of tank, heat exchanger coils, controls, and specialties constructed of ASME code copper lined, carbon steel shell with 1035 kPa (150 psig) minimum working pressure.
- B. The stand shall be factory fabricated for floor mounting.
- C. The tappings shall be factory fabricated of materials compatible with heat exchanger shell. For sizes 50 millimeter or DN50 (NPS 2) and smaller, the tappings shall be threaded ends fabricated in accordance to ASME B1.20.1. For sizes 65 millimeters or DN65 (NPS 2-1/2) and larger, the tappings shall be flanged according to ASME B16.5 for steel and stainless steel flanges and ASME 16.24 for copper and copper alloy flanges.
- D. Shell insulation shall comply with ASHRAE 890.1 and suitable for operating temperature. The entire shell and nozzles shall be completely surrounded except connections and controls.
- E. The heat exchanger coils shall be constructed from copper and fabricated in a helix wound for steam heating medium. The pressure rating shall be equal to or greater than the steam supply pressure plus 50%.
- F. The temperature controls shall be based upon an adjustable temperature transmitter that operates a control valve and is capable of maintaining outlet water temperature within 2 degrees C (4 degrees F) of setting.
- G. Safety control shall be automatic, high temperature limit shutoff device.
- H. The relief valves shall be ASME rated and stamped for combination temperature and pressure relief valves. One or more relief valves with total relieving capacity at least as great as heat input shall be included. The pressure setting shall be less than the working pressure rating of the heat exchanger minus 10 percent.
- I. The Pressure storage vessel shall be all welded construction and ASME Code Section VIII stamped for a working pressure of 1035 kPa (150 psig)

. The storage tank shall be carbon steel with 4.9 kg/sq. meter (3 lb./sq. ft) copper lining.

J. Controls:

1. Steam control valve shall regulate the control of steam flow to the heating coil to control water temperature and shall be electronic operated. The outlet water temperature shall not vary more than ± 1 degrees C (± 2.5 degrees F).
2. A drip trap, steam condensate trap (if required), Y strainer, vacuum breaker, and pressure gage shall be factory sized and piped with steam control valve.
3. A normally closed solenoid Valve shall be rated at 5 amps, 120-volt solenoid valve shall close the steam supply to the heating coil, should the water temperature in the tank reach the high set point.

2.2 CIRCULATING DOMESTIC WATER HEAT EXCHANGERS

- A. A packaged small capacity with hot water storage tank shall be provided with circulator, heat exchanger coil, controls, and specialties. The domestic water heat exchanger with circulator shall be based upon a standard flow arrangement with water from bottom of storage tank circulated across the heat exchanger coil and returned to tank.
- B. A hot water outlet shall be included at the top of the tank.
- C. A temperature sensor shall be located inside the storage tank.
- D. A circulating pump complying with UL 778, all bronze construction, overhung impeller, and separately coupled inline pump shall be included. The pump shall have mechanical seals. The working pressure shall be rated at 860 kPa (125 psig).
- E. The stand shall be factory fabricated for floor mounting.
- F. The tappings shall be factory fabricated of materials compatible with heat exchanger shell. For sizes 50 millimeters or DN50 (NPS 2) and smaller, the tappings shall be threaded ends fabricated in accordance to ASME B1.20.1. For sizes 65 millimeters or DN65 (NPS 2-1/2) and larger, the tappings shall be flanged according to ASME B16.5 for steel and stainless steel flanges and ASME 16.24 for copper and copper alloy flanges.
- G. Shell insulation shall comply with ASHRAE 890.1 and suitable for operating temperature. The entire shell and nozzles shall be completely surrounded except connections and controls.
- H. The heat exchanger coils shall be constructed from copper and fabricated in a helix wound for steam heating medium. The pressure

rating shall be equal to or greater than the steam supply pressure plus 50%.

- I. The temperature controls shall be based upon an adjustable temperature transmitter that operates a control valve and is capable of maintaining outlet water temperature within 2°C (4°F) of setting.
- J. Safety control shall be automatic, high temperature limit shutoff device.
- K. The relief valves shall be ASME rated and stamped for combination temperature and pressure relief valves. One or more relief valves with total relieving capacity at least as great as heat input shall be included. The pressure setting shall be less than the working pressure rating of the heat exchanger minus 10 percent.

2.3 THERMOMETERS:

- A. Thermometers shall be rigid stem or remote sensing, dial type with an aluminum, black metal, stainless steel, or chromium plated brass case. The thermometer shall be back connected, mercury, vapor, BI-metal or gas actuated, with circular dial 90 mm (3 1/2 inches) in diameter graduated from 4 to 100°C (40 to 210°F), with two-degree graduations guaranteed accurate within one scale division. The socket shall be separable, double-seat, micrometer-fittings, with extension neck not less than 65 mm (2 1/2 inches) to clear tank or pipe covering. The thermometer shall be suitable for 20 mm (3/4 inch) pipe threads. Thermometers may be consoles mounted with sensor installed in separate thermometer well.

2.4 SAFETY VALVES FOR SHELL AND STEAM HEATERS:

- A. Separate temperature relief valve and pressure relief valve or combination pressure/temperature relief valves shall be provided on each water heater. The safety valve discharge shall be routed to nearest floor drain.
- B. Temperature Relief Valves shall be constructed from all brass or bronze material. The temperature relief valves shall be automatic, self-closing reseating type valve, equipped with a noncorrosive metal thermostat with bulb extending into tank that can be manually displaced from its seat for test purposes. The temperature relief valve shall be tested and approved as to its BTU capacity by ASME or an independent laboratory satisfactory to the Contracting Officer. In no case shall total rated BTU relieving capacity of temperature relief valve, or valves, be less than BTU input into water heater. Temperature relief

- valve shall be completely open before temperature reaches 98°C (210°F) and shall close when temperature goes below 93°C (200°F).
- C. Pressure relief valves shall conform to requirements of ASME, Section IV. BTU relieving capacity of pressure relief valve, or valves, shall be not less than BTU input of the water heater. The pressure relief shall be set at 690 kPa (100 psig) pressure.
 - D. A double solenoid safety system shall be provided for each shell and steam coil heater to function as a safety over temperature prevention system. System shall consist of aquastat, pilot light, solenoid steam safety valve and solenoid water safety valve located in the control circuit. The aquastat shall be set at 60°C (140°F).

2.5 DOMESTIC HOT WATER COMPRESSION TANKS

- A. A steel pressure rated tank constructed with welded joints and factory installed butyl rubber diaphragm shall be installed as scheduled. The air pre-charge shall be set to minimum system operating pressure at tank.
- B. The tappings shall be factory fabricated steel, welded to the tank and include ASME B1.20.1 pipe thread.
- C. The interior finish shall comply with NSF 61 barrier materials for potable water tank linings and the liner shall extend into and through the tank fittings and outlets.
- D. The air charging valve shall be factory installed.

2.6 HEAT TRAPS

- A. Heat traps shall be installed in accordance with ASHRAE 90.1, latest edition.

2.7 COMBINATION TEMPERATURE AND PRESSURE RELIEF VALVES

- A. The combination temperature and pressure relief valves shall be ASME rated and stamped and include a relieving capacity at least as great as the heat input and include a pressure setting less than the water heater's working pressure rating.

PART 3 - EXECUTION

3.1 INSTALLATION:

- A. The water heaters shall be installed on concrete bases. Refer to Specification Section 03 30 00, CAST-IN-PLACE CONCRETE and Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING
- B. The water heaters shall be installed level and plumb.
- C. Water heaters shall be installed and connected in accordance with manufacturer's written instructions.

- D. All pressure and temperature relief valves discharge shall be pipe to nearby floor drains.
- E. Thermometers shall be installed on water heater inlet and outlet piping.
- F. The control thermostats shall be set for a maximum setting of 54°C (130°F).

3.2 LEAKAGE TEST:

- A. Before piping connections are made, the water heaters shall be tested at a hydrostatic pressure of 1375 kPa (200 psi) for water heaters rated at less than 1103 kPa (160 psig) and 1654 kPa (240 psig) for units with an maximum working pressure of 1103 kPa (160 psig) or over. Any failed test shall be corrected and the water heater shall be retested at no additional cost to the VA.

3.3 PERFORMANCE TEST:

- A. Ensure that all of the remote water outlets will have a minimum of 49°C (120°F) and a maximum of 54°C (130°F) water flow at all times. If necessary, make all correction to balance the return water system or reset the thermostat to make the system comply with design requirements.

- - - E N D - - -

**SECTION 22 40 00
PLUMBING FIXTURES**

PART 1 - GENERAL

1.1 DESCRIPTION

Plumbing fixtures, associated trim and fittings necessary to make a complete installation from wall or floor connections to rough piping, and certain accessories.

1.2 RELATED WORK

- A. Sealing between fixtures and other finish surfaces: Section 07 92 00, JOINT SEALANTS.
- B. Flush panel access doors: Section 08 31 13, ACCESS DOORS AND FRAMES.
- C. Through bolts: Section 10 21 13, TOILET COMPARTMENTS.
- D. Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.
- E. SECTION 22 08 00, COMMISSIONING OF PLUMBING SYSTEMS.
Requirements for commissioning, systems readiness checklist, and training.

1.3 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Submit plumbing fixture information in an assembled brochure, showing cuts and full detailed description of each fixture.

1.4 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American National Standard Institute (ANSI):
The American Society of Mechanical Engineers (ASME):
A112.6.1M-02(R2008).....Floor Affixed Supports for Off-the-Floor
Plumbing Fixtures for Public Use
A112.19.1M-08Enameled Cast Iron Plumbing Fixtures
A112.19.2M-03.....Vitreous China Plumbing Fixtures
A112.19.3-2001(R2008)...Stainless Steel Plumbing Fixtures (Designed for
Residential Use)
- C. American Society for Testing and Materials (ASTM):
A276-2010Stainless and Heat-Resisting Steel Bars and
Shapes
WW-P-541-E/GENPlumbing Fixtures with Amendment 1

- D. National Association of Architectural Metal Manufacturers (NAAMM):
 NAAMM AMP 500-505
 Metal Finishes Manual (1988)
- E. American Society of Sanitary Engineers (ASSE):
 1016-05.....Performance Requirements for Individual
 Thermostatic, Pressure Balancing and
 Combination Pressure Balancing and Thermostatic
 Control Valves for Individual Fixture Fittings
- F. National Sanitation Foundation (NSF)/American National Standards
 Institute (ANSI):
 61-2009Drinking Water System Components-Health Effects
- G. American with Disabilities Act (A.D.A) Section 4-19.4 Exposed Pipes and
 Surfaces
- H. Environmental Protection Agency EPA PL 93-523 1974; A 1999) Safe
 Drinking Water Act.
- I. International Building Code, ICC IPBC 2009.

PART 2 - PRODUCTS

2.1 STAINLESS STEEL

- A. Corrosion-resistant Steel (CRS):
 - 1. Plate, Sheet and Strip: CRS flat products shall conform to chemical composition requirements of any 300 series steel specified in ASTM A276.
 - 2. Finish: Exposed surfaces shall have standard polish (ground and polished) equal to NAAMM finish Number 4.
- B. Die-cast zinc alloy products are prohibited.

2.2 STOPS

- A. Provide lock-shield loose key or screw driver pattern angle stops, straight stops or stops integral with faucet, with each compression type faucet whether specifically called for or not, including sinks in wood and metal casework, laboratory furniture and pharmacy furniture. Locate stops centrally above or below fixture in accessible location.
- B. Furnish keys for lock shield stops to Contracting Officer's Technical Representative (COTR).
- C. Supply from stops not integral with faucet shall be chrome plated copper flexible tubing or flexible stainless steel with inner core of non-toxic polymer.
- D. Supply pipe from wall to valve stop shall be rigid threaded IPS copper alloy pipe, i.e. red brass pipe nipple, chrome plated where exposed.

- E. Psychiatric Area: Provide stainless steel drain guard for all lavatories not installed in casework.

2.3 ESCUTCHEONS

Heavy type, chrome plated, with set screws. Provide for piping serving plumbing fixtures and at each wall, ceiling and floor penetrations in exposed finished locations and within cabinets and millwork.

2.4 LAMINAR FLOW CONTROL DEVICE

- A. Smooth, bright stainless steel or satin finish, chrome plated metal laminar flow device shall provide non-aeration, clear, coherent laminar flow that will not splash in basin. Device shall also have a flow control restrictor and have vandal resistant housing.
- B. Flow Control Restrictor:
 - 1. Capable of restricting flow from 95 ml/s to 110 ml/s (1.5 gpm to 1.7 gpm) for lavatories; 125 ml/s to 140 ml/s (2.0 gpm to 2.2 gpm) for sinks P-505 through P-520, P-524 and P-528; and 170 ml/s to 190 ml/s (2.75 gpm to 3.0 gpm) for dietary food preparation and rinse sinks or as specified.
 - 2. Compensates for pressure fluctuation maintaining flow rate specified above within 10 percent between 170 kPa and 550 kPa (25 psi and 80 psi).
 - 3. Operates by expansion and contraction, eliminates mineral/sediment build-up with self-cleaning action, and is capable of easy manual cleaning.

2.5 CARRIERS

- A. ASME/ANSI A112.6.1M, with adjustable gasket faceplate chair carriers for wall hung closets with auxiliary anchor foot assembly, hanger rod support feet, and rear anchor tie down.
- B. ASME/ANSI A112.6.1M, lavatory, All lavatory chair carriers shall be capable of supporting the lavatory with a 250-pound vertical load applied at the front of the fixture.
- C. Where water closets, lavatories or sinks are installed back-to-back and carriers are specified, provide one carrier to serve both fixtures in lieu of individual carriers. The drainage fitting of the back to back carrier shall be so constructed that it prevents the discharge from one fixture from flowing into the opposite fixture.

2.6 WATER CLOSETS

- A. (P-101) Water Closet (Tank Type, ANSI A112.19.2M, Figure 7) domestic, elongated bowl with tank, closed coupled, flushometer tank, floor outlet. Top of rim shall be 457 mm (18 inches) above finished floor.
 - 1. Seat: Domestic solid molded plastic, elongated bowl. Color shall be white.
 - 2. Fittings: Tank fittings and accessories;
 - a. Flushing mechanism shall be: Pressure assisted, close coupled, flushometer tank, 6 L (1.6 gallons) per flush.
 - b. Stops, tank - angle.

2.7 URINALS: NOT USED**2.8 LAVATORIES**

- A. Dimensions for lavatories are specified, Length by width (distance from wall) and depth.
- B. Brass components in contact with water shall contain no more than 3 percent lead content by dry weight.
- C. (P-401) Lavatory integral to countertop (Single Lever Handle Control ASME/ANSI A112.19.2M, Figure 16) Punching for faucet on 102 mm (4 inches) centers. Set with rim 864 mm (34 inches) above finished floor.
 - 1. Faucet: Solid cast brass construction, vandal resistant, heavy-duty single lever handle, center set. Control shall be washerless ceramic disc cartridge type. Provide laminar flow control device, adjustable hot water limit stop, and vandal proof screws.
 - 2. Drain: Cast or wrought brass with flat grid strainer offset tailpiece, chrome plated. Provide cover per A.D.A 4-19.4.
 - 3. Stops: Angle type, see paragraph 2.2 Stops. Provide cover per A.D.A 4-19.4.
 - 4. Trap: Cast copper alloy, 38 mm by 32 mm (1 1/2 inches by 1 1/4 inches) P-trap. Adjustable with connected elbow and 1.4 mm thick (17 gauge) tubing extensions to wall. Exposed metal trap surface and connection hardware shall be chrome plated with a smooth bright finish. Set trap parallel to wall. Provide cover per A.D.A 4-19.4.

2.9 SINKS

- A. Dimensions for sinks and laundry tubs are specified, length by width (distance from wall) and depth.
- B. (P-501) Service Sink (Corner, Floor Mounted) stain resistant terrazzo, 711 mm by 711 mm by 305 mm (28 inches by 28 inches by 12 inches) with 152 mm (6 inches) drop front. Terrazzo, composed of marble chips and

white Portland cement, shall develop compressive strength of 20684 kPa (3000 psi) seven days after casting. Provide extruded aluminum cap on front side.

1. Faucet: Solid brass construction, combination faucet with replaceable monel seat, removable replacement unit containing all parts subject to wear, integral stops, mounted on wall above sink. Spout shall have a pail hook, 19 mm (3/4 inch) hose coupling threads, vacuum breaker, and top or bottom brace to wall. Four-arm handles on faucets shall be cast, formed, or drop forged copper alloy. Escutcheons shall be either forged copper alloy or CRS. Exposed metal parts, including exposed part under valve handle when in open position, shall have a smooth bright finish. Provide 914 mm (36 inches) hose with wall hook. Centerline of rough in is 1219 mm (48 inches) above finished floor.
 2. Drain: Seventy six millimeter (3 inches) cast brass drain with nickel bronze strainer.
 3. Trap: P-trap, drain through floor.
- C. (P-502) Sink, (CRS, Double Compartment, Undermount, ASME/ANSI A112.19.3M, Kitchen Sinks, Figure 6) self rimming, approximately 838 mm by 559 mm (33 inches by 22 inches) with two compartments inside dimensions approximately 343 mm by 406 mm by 191 mm (13 1/2 inches by 16 inches by 7 1/2 inches), minimum 20 gage CRS. Corners and edges shall be well rounded.
1. Faucet: Kitchen sink, solid brass construction, swing spout, chrome plated copper alloy with spray and hose.
 2. Drain: Drain plug with cup strainer, stainless steel.
 3. Trap: Cast copper alloy, 38 mm (1 1/2 inches) P-trap with cleanout plug, continuous drain with wall connection and escutcheon.
 4. Provide cover for drain, stops and trap per A.D.A 4-19.4.
- D. (P-503) Sink (CRS, Single Oval Compartment, Undermount, ASME/ANSI A112.19.2M, Work Sinks) self rimming, back faucet ledge, approximately 533 mm by 559 mm (21 inches by 22 inches) with single compartment inside dimensions approximately 406 mm round by 191 mm deep (16 oval by 7 1/2 inches) deep. Shall be minimum of 1.3 mm thick (18 gauge) CRS.
1. Faucet: Solid brass construction, deck mounted combination faucet with monel or ceramic seats, removable replacement unit containing all parts subject to wear, swivel gooseneck spout with approximately 203 mm (8 inches) reach with spout outlet 152 mm (6 inches) above

deck single lever with hose spray. Faucet shall be polished chrome plated.

2. Drain: Drain plug with cup strainer, stainless steel.
 3. Trap: Cast copper alloy 38 mm (1 1/2 inches) P-trap with cleanout plug. Provide wall connection and escutcheon.
 4. Provide cover for drain, stops and trap per A.D.A 4-19.4.
- E. (P-504) Sink (CRS, Single rectangle Compartment, drop-in, ASME/ANSI A112.19.2M, Work Sinks) self-rimming, back faucet ledge, approximately 533 mm by 559 mm (21 inches by 22 inches) with single compartment inside dimensions approximately 432 mm by 559mm by 191 mm deep(17x22 by 6 1/2 inches) deep. Shall be minimum of 1.3 mm thick (18 gauge) CRS.
1. Faucet: Solid brass construction, deck mounted combination faucet with monel or ceramic seats, removable replacement unit containing all parts subject to ware, swivel gooseneck spout with approximately 203 mm (8 inches) reach with spout outlet 152 mm (6 inches above deck single lever with hose spray. Faucet shall be polished chrome plated.
 2. Drain: Drain plug with cup strainer, stainless steel.
 3. Trap: Cast copper alloy 38 mm (1 1/2 inches) P-trap with cleanout plug. Provide wall connection and escutcheon.
 4. Provide cover for drain, stops and trap per A.D.A 4-19.4.

2.10 DISPENSER, DRINKING WATER

- A. Standard rating conditions: 10 degrees C (50 degrees F) water with 27 degrees C (80 degrees F) inlet water temperature and 32 degrees C (90 degrees F) ambient air temperature.
- B. (P-601) Electric Hi/Low Water Cooler (Mechanically Cooled, Wall Hung, Self-contained, Wheelchair) bubbler style, 5 ml/s (5 gph) minimum capacity, lead free. Top shall be CRS anti-splash design. Cabinet, CRS, satin finish, approximately 457 mm by 457 mm by 635 mm (18 inches by 18 inches by 25 inches) high with mounting plate. Set bubbler 914 mm (36 inches) above finished floor. Unit shall be push bar operated with front and side bar and automatic stream regulator. All trim polished chrome

2.11 SHOWER BATH FIXTURE

- A. (P-701) Shower Bath Fixture (Detachable, Wall Mounted, Concealed Supplies, Type T/P Combination Valve): Shower unit to be one-piece

fiberglass wheelchair roll-in shower unit with factory installed white 'L-shaped' corner grab bar, and seat, size 63" x 33".

1. Shower Installation: Wall mounted detachable spray assembly, 600 mm (24 inch) wall bar, elevated vacuum breaker, supply elbow and flange and valve. All external trim, chrome plated metal.
2. Shower Head Assembly: Plastic shower head with flow control to limit discharge to 160 ml/s (2.5 gpm), 1524 mm (60 inches) length of rubber lined CRS, chrome plated metal flexible, or white vinyl reinforced hose and supply wall elbow. Design showerhead to fit in palm of hand. Provide CRS or chrome plated metal wall bar with an adjustable swivel hanger for showerhead. Fasten wall bar securely to wall for hand support.
3. Valves: Type T/P combination thermostatic and pressure balancing, with chrome plated metal lever type operating handle adjustable for rough-in variations and chrome plated metal or CRS face plate. Valve body shall be any suitable copper alloy. Internal parts shall be copper, nickel alloy, CRS or thermoplastic material. Valve inlet and outlet shall be 13 mm (1/2 inch) IPS. Provide external screwdriver check stops, vacuum breaker and temperature limit stops. Set stops for a maximum temperature of 40 degrees C (105 degrees F). All exposed fasteners shall be vandal resistant. Valve shall provide a minimum of 160 ml/s at 310 kPa (2.5 gpm at 45 psi) pressure drop.

2.12 HYDRANT, HOSE BIBB AND MISCELLANEOUS DEVICES

- A. (P-801) Wall Hydrant: Cast bronze non-freeze hydrant with detachable T-handle. Brass operating rod within casing of bronze pipe of sufficient length to extend through wall and place valve inside building. Brass valve with coupling and union elbow having metal-to-metal seat. Valve rod and seat washer removable through face of hydrant; 19 mm (3/4 inch) hose thread on spout; 19 mm (3/4 inch) pipe thread on inlet. Finish may be rough; exposed surfaces shall be chrome plated. Set not less than 457 mm (18 inches) nor more than 914 mm (36 inches) above grade. On porches and platforms, set approximately 762 mm (30 inches) above finished floor. Provide integral vacuum breaker which automatically drains when shut off.
- B. (P-802) Washing Machine Supply and Drain Units: Fabricate of 16-gage steel with highly corrosion resistant epoxy finish. Unit to have 51 mm (2 inches) drain connection, 13 mm (1/2 inch) combination MPT brass sweat connection, ball type shut-off valve, 51 mm (2 inches) cast brass

P-trap, duplex electric grounding receptacle and dryer outlet. Size 229 mm by 375 mm (9 inches by 14 3/4 inches) rough wall opening 203 mm by 330 mm by 92 mm (8 inches by 13 inches by 3 5/8 inches). Centerline of box shall be 1118 mm (44 inches) above finished floor.

- C. (P-803): Ice Make Connection Box. Unit shall be recessed type, box and face plate shall be constructed of 16 gauge steel with stainless steel finish. Unit shall be fitted with chrome plated supply valve.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Fixture Setting: Opening between fixture and floor and wall finish shall be sealed as specified under Section 07 92 00, JOINT SEALANTS.
- B. Supports and Fastening: Secure all fixtures, equipment and trimmings to partitions, walls and related finish surfaces. Exposed heads of bolts and nuts in finished rooms shall be hexagonal, polished chrome plated brass with rounded tops.
- C. Through Bolts: For free standing marble and metal stud partitions refer to Section 10 21 13, TOILET COMPARTMENTS.
- D. Toggle Bolts: For hollow masonry units, finished or unfinished.
- E. Expansion Bolts: For brick or concrete or other solid masonry. Shall be 6 mm (1/4 inch) diameter bolts, and to extend at least 76 mm (3 inches) into masonry and be fitted with loose tubing or sleeves extending into masonry. Wood plugs, fiber plugs, lead or other soft metal shields are prohibited.
- F. Power Set Fasteners: May be used for concrete walls, shall be 6 mm (1/4 inch) threaded studs, and shall extend at least 32 mm (1 1/4 inches) into wall.
- G. Tightly cover and protect fixtures and equipment against dirt, water and chemical or mechanical injury.
- H. Where water closet waste pipe has to be offset due to beam interference, provide correct and additional piping necessary to eliminate relocation of water closet.
- I. Do not use aerators on lavatories and sinks.

3.2 CLEANING

At completion of all work, fixtures, exposed materials and equipment shall be thoroughly cleaned.

3.3 COMMISSIONING

- A. Provide commissioning documentation in accordance with the requirements of Section 22 08 00 - COMMISSIONING OF PLUMBING SYSTEMS for all

inspection, startup, and contractor testing required above and required by the System Readiness Checklist provided by the Commissioning Agent.

- B. Components provided under this section of the specification will be tested as part of a larger system. Refer to Section 22 08 00 - COMMISSIONING OF PLUMBING SYSTEMS and related sections for contractor responsibilities for system commissioning.

- - - E N D - - -

**SECTION 23 05 11
COMMON WORK RESULTS FOR HVAC**

PART 1 - GENERAL

1.1 DESCRIPTION

- A. The requirements of this Section apply to all sections of Division 23.
- B. Definitions:
 - 1. Exposed: Piping, ductwork, and equipment exposed to view in finished rooms.
 - 2. Option or optional: Contractor's choice of an alternate material or method.
 - 3. RE: Resident Engineer
 - 4. COTR: Contracting Officer's Technical Representative.

1.2 RELATED WORK

- D. Section 00 72 00, GENERAL CONDITIONS
- E. Section 01 00 00, GENERAL REQUIREMENTS
- F. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES
- D. Section 03 30 00, CAST-IN-PLACE CONCRETE: Concrete and Grout
- E. Section 05 31 00, STEEL DECKING
- F. Section 05 50 00, METAL FABRICATIONS
- G. Section 07 84 00, FIRESTOPPING
- H. Section 07 60 00, FLASHING AND SHEET METAL: Flashing for Wall and Roof Penetrations
- I. Section 07 92 00, JOINT SEALANTS
- J. Section 09 91 00, PAINTING
- K. Section 23 05 12, GENERAL MOTOR REQUIREMENTS FOR HVAC and STEAM GENERATION
- L. Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING and EQUIPMENT
- M. Section 23 05 93, TESTING, ADJUSTING, and BALANCING FOR HVAC
- N. Section 23 07 11, HVAC, PLUMBING, and Boiler Plant Insulation
- O. Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC
- P. Section 23 21 13, HYDRONIC PIPING
- Q. Section 23 21 23, HYDRONIC PUMPS
- R. Section 23 22 13, STEAM and CONDENSATE HEATING PIPING
- S. Section 23 22 23, STEAM CONDENSATE PUMPS
- T. Section 23 23 00, REFRIGERANT PIPING
- U. Section 23 25 00, HVAC WATER TREATMENT

- V. Section 23 31 00, HVAC DUCTS and CASINGS
- W. Section 23 34 00, HVAC FANS
- X. Section 23 36 00, AIR TERMINAL UNITS
- Y. Section 23 37 00, AIR OUTLETS and INLETS
- Z. Section 23 40 00, HVAC AIR CLEANING DEVICES
- AA. Section 23 64 00, PACKAGED WATER CHILLERS
- BB. Section 23 73 00, INDOOR CENTRAL-STATION AIR-HANDLING UNITS
- CC. Section 23 81 00, DECENTRALIZED UNITARY HVAC EQUIPMENT
- DD. Section 23 81 43, AIR-SOURCE UNITARY HEAT PUMPS
- EE. Section 23 82 00, CONVECTION HEATING and COOLING UNITS
- FF. Section 23 82 16, AIR COILS
- GG. Section 23 08 00, COMMISSIONING OF HVAC SYSTEMS: Requirements for commissioning, systems readiness checklists, and training
- HH. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS
- II. Section 26 29 11, LOW-VOLTAGE MOTOR STARTERS

1.3 QUALITY ASSURANCE

- A. Mechanical, electrical and associated systems shall be safe, reliable, efficient, durable, easily and safely operable and maintainable, easily and safely accessible, and in compliance with applicable codes as specified. The systems shall be comprised of high quality institutional-class and industrial-class products of manufacturers that are experienced specialists in the required product lines. All construction firms and personnel shall be experienced and qualified specialists in industrial and institutional HVAC
- B. Flow Rate Tolerance for HVAC Equipment: Section 23 05 93, TESTING, ADJUSTING, AND BALANCING FOR HVAC.
- C. Equipment Vibration Tolerance:
 - 1. Refer to Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING and EQUIPMENT. Equipment shall be factory-balanced to this tolerance and re-balanced on site, as necessary.
 - 2. After HVAC air balance work is completed and permanent drive sheaves are in place, perform field mechanical balancing and adjustments required to meet the specified vibration tolerance.
- D. Products Criteria:
 - 1. Standard Products: Material and equipment shall be the standard products of a manufacturer regularly engaged in the manufacture of the products for at least 3 years (or longer as specified elsewhere). The design, model and size of each item shall have been

in satisfactory and efficient operation on at least three installations for approximately three years. However, digital electronics devices, software and systems such as controls, instruments, computer work station, shall be the current generation of technology and basic design that has a proven satisfactory service record of at least three years. See other specification sections for any exceptions and/or additional requirements.

2. All items furnished shall be free from defects that would adversely affect the performance, maintainability and appearance of individual components and overall assembly.
 3. Conform to codes and standards as required by the specifications. Conform to local codes, if required by local authorities such as the natural gas supplier, if the local codes are more stringent than those specified. Refer any conflicts to the Resident Engineer.
 4. Multiple Units: When two or more units of materials or equipment of the same type or class are required, these units shall be products of one manufacturer.
 5. Assembled Units: Manufacturers of equipment assemblies, which use components made by others, assume complete responsibility for the final assembled product.
 6. Nameplates: Nameplate bearing manufacturer's name or identifiable trademark shall be securely affixed in a conspicuous place on equipment, or name or trademark cast integrally with equipment, stamped or otherwise permanently marked on each item of equipment.
 7. Asbestos products or equipment or materials containing asbestos shall not be used.
- E. Equipment Service Organizations:
1. HVAC: Products and systems shall be supported by service organizations that maintain a complete inventory of repair parts and are located within 50 miles to the site.
- F. HVAC Mechanical Systems Welding: Before any welding is performed, contractor shall submit a certificate certifying that welders comply with the following requirements:
1. Qualify welding processes and operators for piping according to ASME "Boiler and Pressure Vessel Code", Section IX, "Welding and Brazing Qualifications".
 2. Comply with provisions of ASME B31 series "Code for Pressure Piping".

3. Certify that each welder has passed American Welding Society (AWS) qualification tests for the welding processes involved, and that certification is current.
- G. Execution (Installation, Construction) Quality:
1. Apply and install all items in accordance with manufacturer's written instructions. Refer conflicts between the manufacturer's instructions and the contract drawings and specifications to the Resident Engineer for resolution. Provide written hard copies or computer files of manufacturer's installation instructions to the Resident Engineer at least two weeks prior to commencing installation of any item. Installation of the item will not be allowed to proceed until the recommendations are received. Failure to furnish these recommendations is a cause for rejection of the material.
 2. Provide complete layout drawings required by Paragraph, SUBMITTALS. Do not commence construction work on any system until the layout drawings have been approved.
- H. Upon request by Government, provide lists of previous installations for selected items of equipment. Include contact persons who will serve as references, with telephone numbers and e-mail addresses.

1.4 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES, and with requirements in the individual specification sections.
- B. Contractor shall make all necessary field measurements and investigations to assure that the equipment and assemblies will meet contract requirements.
- C. If equipment is submitted which differs in arrangement from that shown, provide drawings that show the rearrangement of all associated systems. Approval will be given only if all features of the equipment and associated systems, including accessibility, are equivalent to that required by the contract.
- D. Prior to submitting shop drawings for approval, contractor shall certify in writing that manufacturers of all major items of equipment have each reviewed drawings and specifications, and have jointly coordinated and properly integrated their equipment and controls to provide a complete and efficient installation.

- E. Submittals and shop drawings for interdependent items, containing applicable descriptive information, shall be furnished together and complete in a group. Coordinate and properly integrate materials and equipment in each group to provide a completely compatible and efficient.
- F. Layout Drawings:
1. Submit complete consolidated and coordinated layout drawings for all new systems, and for existing systems that are in the same areas. Refer to Section 00 72 00, GENERAL CONDITIONS, Article, SUBCONTRACTS AND WORK COORDINATION.
 2. The drawings shall include plan views, elevations and sections of all systems and shall be on a scale of not less than 1:32 (3/8-inch equal to one foot). Clearly identify and dimension the proposed locations of the principal items of equipment. The drawings shall clearly show locations and adequate clearance for all equipment, piping, valves, control panels and other items. Show the access means for all items requiring access for operations and maintenance. Provide detailed layout drawings of all piping and duct systems.
 3. Do not install equipment foundations, equipment or piping until layout drawings have been approved.
 4. In addition, for HVAC systems, provide details of the following:
 - a. Mechanical equipment rooms.
 - b. Hangers, inserts, supports, and bracing.
 - c. Pipe sleeves.
 - d. Duct or equipment penetrations of floors, walls, ceilings, or roofs.
- G. Manufacturer's Literature and Data: Submit under the pertinent section rather than under this section.
1. Submit belt drive with the driven equipment. Submit selection data for specific drives when requested by the Resident Engineer.
 2. Submit electric motor data and variable speed drive data with the driven equipment.
 3. Equipment and materials identification.
 4. Fire-stopping materials.
 5. Hangers, inserts, supports and bracing. Provide load calculations for variable spring and constant support hangers.
 6. Wall, floor, and ceiling plates.
- H. HVAC Maintenance Data and Operating Instructions:

1. Maintenance and operating manuals in accordance with Section 01 00 00, GENERAL REQUIREMENTS, Article, INSTRUCTIONS, for systems and equipment.
2. Provide a listing of recommended replacement parts for keeping in stock supply, including sources of supply, for equipment. Include in the listing belts for equipment: Belt manufacturer, model number, size and style, and distinguished whether of multiple belt sets.
- I. Provide copies of approved HVAC equipment submittals to the Testing, Adjusting and Balancing Subcontractor.

1.5 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. Air Conditioning, Heating and Refrigeration Institute (AHRI):
430-2009.....Central Station Air-Handling Units
- C. American National Standard Institute (ANSI):
B31.1-2007.....Power Piping
- D. Rubber Manufacturers Association (ANSI/RMA):
IP-20-2007.....Specifications for Drives Using Classical
V-Belts and Sheaves
IP-21-2009.....Specifications for Drives Using Double-V
(Hexagonal) Belts
IP-22-2007.....Specifications for Drives Using Narrow V-Belts
and Sheaves
- E. Air Movement and Control Association (AMCA):
410-96.....Recommended Safety Practices for Air Moving
Devices
- F. American Society of Mechanical Engineers (ASME):
Boiler and Pressure Vessel Code (BPVC):
Section I-2007.....Power Boilers
Section IX-2007.....Welding and Brazing Qualifications
Code for Pressure Piping:
B31.1-2007.....Power Piping
- G. American Society for Testing and Materials (ASTM):
A36/A36M-08.....Standard Specification for Carbon Structural
Steel
A575-96(2007).....Standard Specification for Steel Bars, Carbon,
Merchant Quality, M-Grades

- E84-10.....Standard Test Method for Surface Burning
Characteristics of Building Materials
- E119-09c.....Standard Test Methods for Fire Tests of
Building Construction and Materials
- H. Manufacturers Standardization Society (MSS) of the Valve and Fittings
Industry, Inc:
 - SP-58-2009.....Pipe Hangers and Supports-Materials, Design and
Manufacture, Selection, Application, and
Installation
 - SP 69-2003.....Pipe Hangers and Supports-Selection and
Application
 - SP 127-2001.....Bracing for Piping Systems, Seismic - Wind -
Dynamic, Design, Selection, Application
- I. National Electrical Manufacturers Association (NEMA):
 - MG-1-2009.....Motors and Generators
- J. National Fire Protection Association (NFPA):
 - 31-06.....Standard for Installation of Oil-Burning
Equipment
 - 54-09.....National Fuel Gas Code
 - 70-08.....National Electrical Code
 - 85-07.....Boiler and Combustion Systems Hazards Code
 - 90A-09.....Standard for the Installation of Air
Conditioning and Ventilating Systems
 - 101-09.....Life Safety Code

1.6 DELIVERY, STORAGE AND HANDLING

- A. Protection of Equipment:
 - 1. Equipment and material placed on the job site shall remain in the custody of the Contractor until phased acceptance, whether or not the Government has reimbursed the Contractor for the equipment and material. The Contractor is solely responsible for the protection of such equipment and material against any damage.
 - 2. Place damaged equipment in first class, new operating condition; or, replace same as determined and directed by the Resident Engineer. Such repair or replacement shall be at no additional cost to the Government.
 - 3. Protect interiors of new equipment and piping systems against entry of foreign matter. Clean both inside and outside before painting or placing equipment in operation.

4. Existing equipment and piping being worked on by the Contractor shall be under the custody and responsibility of the Contractor and shall be protected as required for new work.
- B. Cleanliness of Piping and Equipment Systems:
1. Exercise care in storage and handling of equipment and piping material to be incorporated in the work. Remove debris arising from cutting, threading and welding of piping.
 2. Piping systems shall be flushed, blown or pigged as necessary to deliver clean systems.
 3. Clean interior of all tanks prior to delivery for beneficial use by the Government.

1.7 JOB CONDITIONS - WORK IN EXISTING BUILDING

- A. Building Operation: Government employees will be continuously operating and managing all facilities, including temporary facilities, that serve the medical center.
- B. Maintenance of Service: Schedule all work to permit continuous service as required by the medical center.
- C. Steam and Condensate Service Interruptions: Limited steam and condensate service interruptions, as required for interconnections of new and existing systems, will be permitted by the Resident Engineer during periods when the demands are not critical to the operation of the medical center. These non-critical periods are limited to between 8 pm and 5 am in the appropriate off-season (if applicable). Provide at least one week advance notice to the Resident Engineer.
- D. Phasing of Work: Comply with all requirements shown on drawings or specified.
- E. Building Working Environment: Maintain the architectural and structural integrity of the building and the working environment at all times. Maintain the interior of building at 18 degrees C (65 degrees F) minimum. Limit the opening of doors, windows or other access openings to brief periods as necessary for rigging purposes. No storm water or ground water leakage permitted. Provide daily clean-up of construction and demolition debris on all floor surfaces and on all equipment being operated by VA.
- F. Acceptance of Work for Government Operation: As new facilities are made available for operation and these facilities are of beneficial use to the Government, inspections will be made and tests will be performed. Based on the inspections, a list of contract deficiencies will be

issued to the Contractor. After correction of deficiencies as necessary for beneficial use, the Contracting Officer will process necessary acceptance and the equipment will then be under the control and operation of Government personnel.

- G. Temporary Facilities: Refer to Article, TEMPORARY PIPING AND EQUIPMENT in this section.

PART 2 - PRODUCTS

2.1 FACTORY-ASSEMBLED PRODUCTS

- A. Provide maximum standardization of components to reduce spare part requirements.
- B. Manufacturers of equipment assemblies that include components made by others shall assume complete responsibility for final assembled unit.
 - 1. All components of an assembled unit need not be products of same manufacturer.
 - 2. Constituent parts that are alike shall be products of a single manufacturer.
 - 3. Components shall be compatible with each other and with the total assembly for intended service.
 - 4. Contractor shall guarantee performance of assemblies of components, and shall repair or replace elements of the assemblies as required to deliver specified performance of the complete assembly.
- C. Components of equipment shall bear manufacturer's name and trademark, model number, serial number and performance data on a name plate securely affixed in a conspicuous place, or cast integral with, stamped or otherwise permanently marked upon the components of the equipment.
- D. Major items of equipment, which serve the same function, must be the same make and model. Exceptions will be permitted if performance requirements cannot be met.

2.2 COMPATIBILITY OF RELATED EQUIPMENT

Equipment and materials installed shall be compatible in all respects with other items being furnished and with existing items so that the result will be a complete and fully operational plant that conforms to contract requirements.

2.3 BELT DRIVES

- A. Type: ANSI/RMA standard V-belts with proper motor pulley and driven sheave. Belts shall be constructed of reinforced cord and rubber.
- B. Dimensions, rating and selection standards: ANSI/RMA IP-20 and IP-21.

- C. Minimum Horsepower Rating: Motor horsepower plus recommended ANSI/RMA service factor (not less than 20 percent) in addition to the ANSI/RMA allowances for pitch diameter, center distance, and arc of contact.
- D. Maximum Speed: 25 m/s (5000 feet per minute).
- E. Adjustment Provisions: For alignment and ANSI/RMA standard allowances for installation and take-up.
- F. Drives may utilize a single V-Belt (any cross section) when it is the manufacturer's standard.
- G. Multiple Belts: Matched to ANSI/RMA specified limits by measurement on a belt measuring fixture. Seal matched sets together to prevent mixing or partial loss of sets. Replacement, when necessary, shall be an entire set of new matched belts.
- H. Sheaves and Pulleys:
 - 1. Material: Pressed steel, or close grained cast iron.
 - 2. Bore: Fixed or bushing type for securing to shaft with keys.
 - 3. Balanced: Statically and dynamically.
 - 4. Groove spacing for driving and driven pulleys shall be the same.
- I. Drive Types, Based on ARI 435:
 - 1. Provide adjustable-pitch or fixed-pitch drive as follows:
 - a. Fan speeds up to 1800 RPM: 7.5 kW (10 horsepower) and smaller.
 - b. Fan speeds over 1800 RPM: 2.2 kW (3 horsepower) and smaller.
 - 2. Provide fixed-pitch drives for drives larger than those listed above.
 - 3. The final fan speeds required to just meet the system CFM and pressure requirements, without throttling, shall be determined by adjustment of a temporary adjustable-pitch motor sheave or by fan law calculation if a fixed-pitch drive is used initially.

2.4 DRIVE GUARDS

- A. For machinery and equipment, provide guards as shown in AMCA 410 for belts, chains, couplings, pulleys, sheaves, shafts, gears and other moving parts regardless of height above the floor to prevent damage to equipment and injury to personnel. Drive guards may be excluded where motors and drives are inside factory fabricated air handling unit casings.
- B. Pump shafts and couplings shall be fully guarded by a sheet steel guard, covering coupling and shaft but not bearings. Material shall be minimum 16-gage sheet steel; ends shall be braked and drilled and attached to pump base with minimum of four 6 mm (1/4-inch) bolts.

Reinforce guard as necessary to prevent side play forcing guard onto couplings.

- C. V-belt and sheave assemblies shall be totally enclosed, firmly mounted, non-resonant. Guard shall be an assembly of minimum 22-gage sheet steel and expanded or perforated metal to permit observation of belts. 25 mm (one-inch) diameter hole shall be provided at each shaft centerline to permit speed measurement.
- D. Materials: Sheet steel, cast iron, expanded metal or wire mesh rigidly secured so as to be removable without disassembling pipe, duct, or electrical connections to equipment.
- E. Access for Speed Measurement: 25 mm (One inch) diameter hole at each shaft center.

2.5 LIFTING ATTACHMENTS

Provide equipment with suitable lifting attachments to enable equipment to be lifted in its normal position. Lifting attachments shall withstand any handling conditions that might be encountered, without bending or distortion of shape, such as rapid lowering and braking of load.

2.6 ELECTRIC MOTORS

- A. All material and equipment furnished and installation methods shall conform to the requirements of Section 23 05 12, GENERAL MOTOR REQUIREMENTS FOR HVAC AND STEAM GENERATION EQUIPMENT; Section 26 29 11, LOW-VOLTAGE MOTOR STARTERS; and, Section 26 05 21, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES (600 VOLTS AND BELOW). Provide all electrical wiring, conduit, and devices necessary for the proper connection, protection and operation of the systems. Provide special energy efficient premium efficiency type motors as scheduled.

2.7 VARIABLE SPEED MOTOR CONTROLLERS

- A. Refer to Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS and Section 26 29 11, LOW-VOLTAGE MOTOR STARTERS for specifications.
- B. The combination of controller and motor shall be provided by the manufacturer of the driven equipment, such as pumps and fans, and shall be rated for 100 percent output performance. Multiple units of the same class of equipment, i.e. air handlers, fans, pumps, shall be product of a single manufacturer.
- C. Motors shall be premium efficiency type and be approved by the motor controller manufacturer. The controller-motor combination shall be guaranteed to provide full motor nameplate horsepower in variable

- frequency operation. Both driving and driven motor/fan sheaves shall be fixed pitch.
- D. Controller shall not add any current or voltage transients to the input AC power distribution system, DDC controls, sensitive medical equipment, etc., nor shall be affected from other devices on the AC power system.
 - E. Controller shall be provided with the following operating features and accessories:
 - 1. Suitable for variable torque load.
 - 2. Provide thermal magnetic circuit breaker or fused switch with external operator and incoming line fuses. Unit shall be rated for minimum 25,000 AIC. Provide AC input line reactors (3% impedance) filters on incoming power line. Provide output line reactors on line between drive and motor where the distance between the breaker and motor exceeds 50 feet.

2.8 EQUIPMENT AND MATERIALS IDENTIFICATION

- A. Use symbols, nomenclature and equipment numbers specified, shown on the drawings and shown in the maintenance manuals. Identification for piping is specified in Section 09 91 00, PAINTING.
- B. Interior (Indoor) Equipment: Engraved nameplates, with letters not less than 48 mm (3/16-inch) high of brass with black-filled letters, or rigid black plastic with white letters specified in Section 09 91 00, PAINTING permanently fastened to the equipment. Identify unit components such as coils, filters, fans, etc.
- C. Exterior (Outdoor) Equipment: Brass nameplates, with engraved black filled letters, not less than 48 mm (3/16-inch) high riveted or bolted to the equipment.
- D. Control Items: Label all temperature and humidity sensors, controllers and control dampers. Identify and label each item as they appear on the control diagrams.
- E. Valve Tags and Lists:
 - 1. HVAC and Boiler Plant: Provide for all valves other than for equipment in Section 23 82 00, CONVECTION HEATING AND COOLING UNITS.
 - 2. Valve tags: Engraved black filled numbers and letters not less than 13 mm (1/2-inch) high for number designation, and not less than 6.4 mm (1/4-inch) for service designation on 19 gage 38 mm (1-1/2 inches) round brass disc, attached with brass "S" hook or brass chain.

3. Valve lists: Typed or printed plastic coated card(s), sized 216 mm(8-1/2 inches) by 280 mm (11 inches) showing tag number, valve function and area of control, for each service or system. Punch sheets for a 3-ring notebook.
4. Provide detailed plan for each floor of the building indicating the location and valve number for each valve. Identify location of each valve with a color coded thumb tack in ceiling.

2.9 FIRESTOPPING

Section 07 84 00, FIRESTOPPING specifies an effective barrier against the spread of fire, smoke and gases where penetrations occur for piping and ductwork. Refer to Section 23 07 11, HVAC, PLUMBING, AND BOILER PLANT INSULATION, for firestop pipe and duct insulation.

2.10 GALVANIZED REPAIR COMPOUND

Mil. Spec. DOD-P-21035B, paint form.

2.11 HVAC PIPE AND EQUIPMENT SUPPORTS AND RESTRAINTS

- A. Vibration Isolators: Refer to Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT.
- B. Pipe Supports: Comply with MSS SP-58. Type Numbers specified refer to this standard. For selection and application comply with MSS SP-69. Refer to Section 05 50 00, METAL FABRICATIONS, for miscellaneous metal support materials and prime coat painting requirements.
- C. Attachment to Concrete Building Construction:
 1. Concrete insert: MSS SP-58, Type 18.
 2. Self-drilling expansion shields and machine bolt expansion anchors: Permitted in concrete not less than 102 mm (four inches) thick when approved by the Resident Engineer for each job condition.
 3. Power-driven fasteners: Permitted in existing concrete or masonry not less than 102 mm (four inches) thick when approved by the Resident Engineer for each job condition.
- D. Attachment to Steel Building Construction:
 1. Welded attachment: MSS SP-58, Type 22.
 2. Beam clamps: MSS SP-58, Types 20, 21, 28 or 29. Type 23 C-clamp may be used for individual copper tubing up to 23mm (7/8-inch) outside diameter.
- E. Attachment to Metal Pan or Deck: As required for materials specified in Section 05 31 00, STEEL DECKING.
- F. Attachment to existing structure: Support from existing floor/roof frame.

- G. Hanger Rods: Hot-rolled steel, ASTM A36 or A575 for allowable load listed in MSS SP-58. For piping, provide adjustment means for controlling level or slope. Types 13 or 15 turn-buckles shall provide 38 mm (1-1/2 inches) minimum of adjustment and incorporate locknuts. All-thread rods are acceptable.
- H. Hangers Supporting Multiple Pipes (Trapeze Hangers): Galvanized, cold formed, lipped steel channel horizontal member, not less than 41 mm by 41 mm (1-5/8 inches by 1-5/8 inches), 2.7 mm (No. 12 gage), designed to accept special spring held, hardened steel nuts. Not permitted for steam supply and condensate piping.
 - 1. Allowable hanger load: Manufacturers rating less 91kg (200 pounds).
 - 2. Guide individual pipes on the horizontal member of every other trapeze hanger with 6 mm (1/4-inch) U-bolt fabricated from steel rod. Provide Type 40 insulation shield, secured by two 13mm (1/2-inch) galvanized steel bands, or preinsulated calcium silicate shield for insulated piping at each hanger.
- I. Supports for Piping Systems:
 - 1. Select hangers sized to encircle insulation on insulated piping. Refer to Section 23 07 11, HVAC, PLUMBING, AND BOILER PLANT INSULATION for insulation thickness. To protect insulation, provide Type 39 saddles for roller type supports or preinsulated calcium silicate shields. Provide Type 40 insulation shield or preinsulated calcium silicate shield at all other types of supports and hangers including those for preinsulated piping.
 - 2. Piping Systems except High and Medium Pressure Steam (MSS SP-58):
 - a. Standard clevis hanger: Type 1; provide locknut.
 - b. Riser clamps: Type 8.
 - c. Wall brackets: Types 31, 32 or 33.
 - d. Roller supports: Type 41, 43, 44 and 46.
 - e. Saddle support: Type 36, 37 or 38.
 - f. Turnbuckle: Types 13 or 15. Preinsulate.
 - g. U-bolt clamp: Type 24.
 - h. Copper Tube:
 - 1) Hangers, clamps and other support material in contact with tubing shall be painted with copper colored epoxy paint, plastic coated or taped with non adhesive isolation tape to prevent electrolysis.

- 2) For vertical runs use epoxy painted or plastic coated riser clamps.
- 3) For supporting tube to strut: Provide epoxy painted pipe straps for copper tube or plastic inserted vibration isolation clamps.
- 4) Insulated Lines: Provide pre-insulated calcium silicate shields sized for copper tube.
- i. Supports for plastic or glass piping: As recommended by the pipe manufacturer with black rubber tape extending one inch beyond steel support or clamp.
- 3. Medium Pressure Steam (MSS SP-58):
 - a. Provide eye rod or Type 17 eye nut near the upper attachment.
 - b. Piping 50 mm (2 inches) and larger: Type 43 roller hanger. For roller hangers requiring seismic bracing provide a Type 1 clevis hanger with Type 41 roller attached by flat side bars.
 - c. Piping with Vertical Expansion and Contraction:
 - 1) Movement up to 20 mm (3/4-inch): Type 51 or 52 variable spring unit with integral turn buckle and load indicator.
 - 2) Movement more than 20 mm (3/4-inch): Type 54 or 55 constant support unit with integral adjusting nut, turn buckle and travel position indicator.
- 4. Converter and Expansion Tank Hangers: May be Type 1 sized for the shell diameter. Insulation where required will cover the hangers.
- J. Pre-insulated Calcium Silicate Shields:
 - 1. Provide 360 degree water resistant high density 965 kPa (140 psi) compressive strength calcium silicate shields encased in galvanized metal.
 - 2. Pre-insulated calcium silicate shields to be installed at the point of support during erection.
 - 3. Shield thickness shall match the pipe insulation.
 - 4. The type of shield is selected by the temperature of the pipe, the load it must carry, and the type of support it will be used with.
 - a. Shields for supporting chilled or cold water shall have insulation that extends a minimum of 1 inch past the sheet metal. Provide for an adequate vapor barrier in chilled lines.
 - b. The pre-insulated calcium silicate shield shall support the maximum allowable water filled span as indicated in MSS-SP 69. To support the load, the shields may have one or more of the

following features: structural inserts 4138 kPa (600 psi) compressive strength, an extra bottom metal shield, or formed structural steel (ASTM A36) wear plates welded to the bottom sheet metal jacket.

5. Shields may be used on steel clevis hanger type supports, roller supports or flat surfaces.

2.12 PIPE PENETRATIONS

- A. Install sleeves during construction for other than blocked out floor openings for risers in mechanical bays.
- B. To prevent accidental liquid spills from passing to a lower level, provide the following:
 1. For sleeves: Extend sleeve 25 mm (one inch) above finished floor and provide sealant for watertight joint.
 2. For blocked out floor openings: Provide 40 mm (1-1/2 inch) angle set in silicone adhesive around opening.
 3. For drilled penetrations: Provide 40 mm (1-1/2 inch) angle ring or square set in silicone adhesive around penetration.
- C. Penetrations are not allowed through beams or ribs. Any deviation from these requirements must receive prior approval of Resident Engineer.
- D. Sheet Metal, Plastic, or Moisture-resistant Fiber Sleeves: Provide for pipe passing through floors, interior walls, and partitions, unless brass or steel pipe sleeves are specifically called for below.
- E. Cast Iron or Zinc Coated Pipe Sleeves: Provide for pipe passing through exterior walls below grade. Make space between sleeve and pipe watertight with a modular or link rubber seal. Seal shall be applied at both ends of sleeve.
- F. Galvanized Steel or an alternate Black Iron Pipe with asphalt coating Sleeves: Provide for pipe passing through concrete beam flanges, except where brass pipe sleeves are called for. Provide sleeve for pipe passing through floor of mechanical rooms. Except in mechanical rooms, connect sleeve with floor plate.
- G. Brass Pipe Sleeves: Provide for pipe passing through quarry tile, terrazzo or ceramic tile floors. Connect sleeve with floor plate.
- H. Sleeves are not required for wall hydrants for fire department connections or in drywall construction.
- I. Sleeve Clearance: Sleeve through floors, walls, partitions, and beam flanges shall be one inch greater in diameter than external diameter of pipe. Sleeve for pipe with insulation shall be large enough to

accommodate the insulation. Interior openings shall be caulked tight with fire stopping material and sealant to prevent the spread of fire, smoke, and gases.

- J. Sealant and Adhesives: Shall be as specified in Section 07 92 00, JOINT SEALANTS.

2.13 DUCT PENETRATIONS

- A. Provide firestopping for openings through fire and smoke barriers, maintaining minimum required rating of floor, ceiling or wall assembly. See section 07 84 00, FIRESTOPPING.

2.14 SPECIAL TOOLS AND LUBRICANTS

- A. Furnish, and turn over to the Resident Engineer, tools not readily available commercially, that are required for disassembly or adjustment of equipment and machinery furnished.
- B. Grease Guns with Attachments for Applicable Fittings: One for each type of grease required for each motor or other equipment.
- C. Refrigerant Tools: Provide system charging/Evacuation equipment, gauges, fittings, and tools required for maintenance of furnished equipment.
- D. Tool Containers: Hardwood or metal, permanently identified for intended service and mounted, or located, where directed by the Resident Engineer.
- E. Lubricants: A minimum of 0.95 L (one quart) of oil, and 0.45 kg (one pound) of grease, of equipment manufacturer's recommended grade and type, in unopened containers and properly identified as to use for each different application.

2.15 WALL, FLOOR AND CEILING PLATES

- A. Material and Type: Chrome plated brass or chrome plated steel, one piece or split type with concealed hinge, with set screw for fastening to pipe, or sleeve. Use plates that fit tight around pipes, cover openings around pipes and cover the entire pipe sleeve projection.
- B. Thickness: Not less than 2.4 mm (3/32-inch) for floor plates. For wall and ceiling plates, not less than 0.64 mm (0.025-inch) for up to 80 mm (3-inch pipe), 0.89 mm (0.035-inch) for larger pipe.
- C. Locations: Use where pipe penetrates floors, walls and ceilings in exposed locations, in finished areas only. Provide a watertight joint in spaces where brass or steel pipe sleeves are specified.

2.16 ASBESTOS

Materials containing asbestos are not permitted.

PART 3 - EXECUTION**3.1 ARRANGEMENT AND INSTALLATION OF EQUIPMENT AND PIPING**

- A. Coordinate location of piping, sleeves, inserts, hangers, ductwork and equipment. Locate piping, sleeves, inserts, hangers, ductwork and equipment clear of windows, doors, openings, light outlets, and other services and utilities. Prepare equipment layout drawings to coordinate proper location and personnel access of all facilities. Submit the drawings for review as required by Part 1. Follow manufacturer's published recommendations for installation methods not otherwise specified.
- B. Operating Personnel Access and Observation Provisions: Select and arrange all equipment and systems to provide clear view and easy access, without use of portable ladders, for maintenance and operation of all devices including, but not limited to: all equipment items, valves, filters, strainers, transmitters, sensors, control devices. All gages and indicators shall be clearly visible by personnel standing on the floor or on permanent platforms. Do not reduce or change maintenance and operating space and access provisions that are shown on the drawings.
- C. Equipment and Piping Support: Coordinate structural systems necessary for pipe and equipment support with pipe and equipment locations to permit proper installation.
- D. Location of pipe sleeves, trenches and chases shall be accurately coordinated with equipment and piping locations.
- E. Cutting Holes:
 - 1. Cut holes through concrete and masonry by rotary core drill. Pneumatic hammer, impact electric, and hand or manual hammer type drill will not be allowed, except as permitted by Resident Engineer where working area space is limited.
 - 2. Locate holes to avoid interference with structural members such as beams or grade beams. Holes shall be laid out in advance and drilling done only after approval by Resident Engineer. If the Contractor considers it necessary to drill through structural members, this matter shall be referred to Resident Engineer for approval.
 - 3. Do not penetrate membrane waterproofing.
- F. Interconnection of Instrumentation or Control Devices: Generally, electrical interconnections are not shown but must be provided.

- G. Minor Piping: Generally, small diameter pipe runs from drips and drains, water cooling, and other service are not shown but must be provided.
- H. Electrical Interconnection of Controls and Instruments: This generally not shown but must be provided. This includes interconnections of sensors, transmitters, transducers, control devices, control and instrumentation panels, instruments and computer workstations. Comply with NFPA-70.
- I. Protection and Cleaning:
 - 1. Equipment and materials shall be carefully handled, properly stored, and adequately protected to prevent damage before and during installation, in accordance with the manufacturer's recommendations and as approved by the Resident Engineer. Damaged or defective items in the opinion of the Resident Engineer, shall be replaced.
 - 2. Protect all finished parts of equipment, such as shafts and bearings where accessible, from rust prior to operation by means of protective grease coating and wrapping. Close pipe openings with caps or plugs during installation. Tightly cover and protect fixtures and equipment against dirt, water chemical, or mechanical injury. At completion of all work thoroughly clean fixtures, exposed materials and equipment.
- J. Concrete and Grout: Use concrete and shrink compensating grout 25 MPa (3000 psi) minimum, specified in Section 03 30 00, CAST-IN-PLACE CONCRETE.
- K. Install gages, thermometers, valves and other devices with due regard for ease in reading or operating and maintaining said devices. Locate and position thermometers and gages to be easily read by operator or staff standing on floor or walkway provided. Servicing shall not require dismantling adjacent equipment or pipe work.
- L. Install steam piping expansion joints as per manufacturer's recommendations.
- M. Work in Existing Building:
 - 1. Perform as specified in Article, OPERATIONS AND STORAGE AREAS, Article, ALTERATIONS, and Article, RESTORATION of the Section 01 00 00, GENERAL REQUIREMENTS for relocation of existing equipment, alterations and restoration of existing building(s).
 - 2. As specified in Section 01 00 00, GENERAL REQUIREMENTS, Article, OPERATIONS AND STORAGE AREAS, make alterations to existing service

piping at times that will least interfere with normal operation of the facility.

3. Cut required openings through existing masonry and reinforced concrete using diamond core drills. Use of pneumatic hammer type drills, impact type electric drills, and hand or manual hammer type drills, will be permitted only with approval of the Resident Engineer. Locate openings that will least effect structural slabs, columns, ribs or beams. Refer to the Resident Engineer for determination of proper design for openings through structural sections and opening layouts approval, prior to cutting or drilling into structure. After Resident Engineer's approval, carefully cut opening through construction no larger than absolutely necessary for the required installation.
- N. Switchgear/Electrical Equipment Drip Protection: Every effort shall be made to eliminate the installation of pipe above electrical and telephone switchgear. If this is not possible, encase pipe in a second pipe with a minimum of joints. Installation of piping, ductwork, leak protection apparatus or other installations foreign to the electrical installation shall be located in the space equal to the width and depth of the equipment and extending from to a height of 1.8 m (6 ft.) above the equipment of to ceiling structure, whichever is lower (NFPA 70).
- O. Inaccessible Equipment:
1. Where the Government determines that the Contractor has installed equipment not conveniently accessible for operation and maintenance, equipment shall be removed and reinstalled or remedial action performed as directed at no additional cost to the Government.
 2. The term "conveniently accessible" is defined as capable of being reached without the use of ladders, or without climbing or crawling under or over obstacles such as motors, fans, pumps, belt guards, transformers, high voltage lines, piping, and ductwork.

3.2 TEMPORARY PIPING AND EQUIPMENT

- A. Continuity of operation of existing facilities will generally require temporary installation or relocation of equipment and piping.
- B. The Contractor shall provide all required facilities in accordance with the requirements of phased construction and maintenance of service. All piping and equipment shall be properly supported, sloped to drain, operate without excessive stress, and shall be insulated where injury

can occur to personnel by contact with operating facilities. The requirements of Paragraph 3.1 apply.

- C. Temporary facilities and piping shall be completely removed and any openings in structures sealed. Provide necessary blind flanges and caps to seal open piping remaining in service.

3.3 RIGGING

- A. Design is based on application of available equipment. Openings in building structures are planned to accommodate design scheme.
- B. Alternative methods of equipment delivery may be offered by Contractor and will be considered by Government under specified restrictions of phasing and maintenance of service as well as structural integrity of the building.
- C. Close all openings in the building when not required for rigging operations to maintain proper environment in the facility for Government operation and maintenance of service.
- D. Contractor shall provide all facilities required to deliver specified equipment and place on foundations. Attachments to structures for rigging purposes and support of equipment on structures shall be Contractor's full responsibility. Upon request, the Government will check structure adequacy and advise Contractor of recommended restrictions.
- E. Contractor shall check all clearances, weight limitations and shall offer a rigging plan designed by a Registered Professional Engineer. All modifications to structures, including reinforcement thereof, shall be at Contractor's cost, time and responsibility.
- F. Rigging plan and methods shall be referred to Resident Engineer for evaluation prior to actual work.
- G. Restore building to original condition upon completion of rigging work.

3.4 PIPE AND EQUIPMENT SUPPORTS

- A. Where hanger spacing does not correspond with joist or rib spacing, use structural steel channels secured directly to joist and rib structure that will correspond to the required hanger spacing, and then suspend the equipment and piping from the channels. Drill or burn holes in structural steel only with the prior approval of the Resident Engineer.
- B. Use of chain, wire or strap hangers; wood for blocking, stays and bracing; or, hangers suspended from piping above will not be permitted. Replace or thoroughly clean rusty products and paint with zinc primer.

- C. Use hanger rods that are straight and vertical. Turnbuckles for vertical adjustments may be omitted where limited space prevents use. Provide a minimum of 15 mm (1/2-inch) clearance between pipe or piping covering and adjacent work.
- D. HVAC Horizontal Pipe Support Spacing: Refer to MSS SP-69. Provide additional supports at valves, strainers, in-line pumps and other heavy components. Provide a support within one foot of each elbow.
- E. HVAC Vertical Pipe Supports:
 - 1. Up to 150 mm (6-inch pipe), 9 m (30 feet) long, bolt riser clamps to the pipe below couplings, or welded to the pipe and rests supports securely on the building structure.
 - 2. Vertical pipe larger than the foregoing, support on base elbows or tees, or substantial pipe legs extending to the building structure.
- F. Overhead Supports:
 - 1. The basic structural system of the building is designed to sustain the loads imposed by equipment and piping to be supported overhead.
 - 2. Provide steel structural members, in addition to those shown, of adequate capability to support the imposed loads, located in accordance with the final approved layout of equipment and piping.
 - 3. Tubing and capillary systems shall be supported in channel troughs.
- G. Floor Supports:
 - 1. Provide concrete bases, concrete anchor blocks and pedestals, and structural steel systems for support of equipment and piping. Anchor and dowel concrete bases and structural systems to resist forces under operating and seismic conditions (if applicable) without excessive displacement or structural failure.
 - 2. Do not locate or install bases and supports until equipment mounted thereon has been approved. Size bases to match equipment mounted thereon plus 150 mm (6 inch) excess on all edges. Refer to structural drawings. Bases shall be neatly finished and smoothed, shall have chamfered edges at the top, and shall be suitable for painting.
 - 3. All equipment shall be shimmed, leveled, firmly anchored, and grouted with epoxy grout. Anchor bolts shall be placed in sleeves, anchored to the bases. Fill the annular space between sleeves and bolts with a granular material to permit alignment and realignment.

3.5 CLEANING AND PAINTING

- A. Prior to final inspection and acceptance of the plant and facilities for beneficial use by the Government, the plant facilities, equipment and systems shall be thoroughly cleaned and painted. Refer to Section 09 91 00, PAINTING.
- B. In addition, the following special conditions apply:
 - 1. Cleaning shall be thorough. Use solvents, cleaning materials and methods recommended by the manufacturers for the specific tasks. Remove all rust prior to painting and from surfaces to remain unpainted. Repair scratches, scuffs, and abrasions prior to applying prime and finish coats.
 - 2. Material And Equipment Not To Be Painted Includes:
 - a. Motors, controllers, control switches, and safety switches.
 - b. Control and interlock devices.
 - c. Regulators.
 - d. Pressure reducing valves.
 - e. Control valves and thermostatic elements.
 - f. Lubrication devices and grease fittings.
 - g. Copper, brass, aluminum, stainless steel and bronze surfaces.
 - h. Valve stems and rotating shafts.
 - i. Pressure gauges and thermometers.
 - j. Glass.
 - k. Name plates.
 - 3. Control and instrument panels shall be cleaned, damaged surfaces repaired, and shall be touched-up with matching paint obtained from panel manufacturer.
 - 4. Pumps, motors, steel and cast iron bases, and coupling guards shall be cleaned, and shall be touched-up with the same color as utilized by the pump manufacturer
 - 5. Temporary Facilities: Apply paint to surfaces that do not have existing finish coats.
 - 6. Paint shall withstand the following temperatures without peeling or discoloration:
 - a. Condensate and feedwater -- 38 degrees C (100 degrees F) on insulation jacket surface and 120 degrees C (250 degrees F) on metal pipe surface.

- b. Steam -- 52 degrees C (125 degrees F) on insulation jacket surface and 190 degrees C (375 degrees F) on metal pipe surface.
- 7. Final result shall be smooth, even-colored, even-textured factory finish on all items. Completely repaint the entire piece of equipment if necessary to achieve this.

3.6 IDENTIFICATION SIGNS

- A. Provide laminated plastic signs, with engraved lettering not less than 5 mm (3/16-inch) high, designating functions, for all equipment, switches, motor controllers, relays, meters, control devices, including automatic control valves. Nomenclature and identification symbols shall correspond to that used in maintenance manual, and in diagrams specified elsewhere. Attach by chain, adhesive, or screws.
- B. Factory Built Equipment: Metal plate, securely attached, with name and address of manufacturer, serial number, model number, size, performance.
- C. Pipe Identification: Refer to Section 09 91 00, PAINTING.

3.7 MOTOR AND DRIVE ALIGNMENT

- A. Belt Drive: Set driving and driven shafts parallel and align so that the corresponding grooves are in the same plane.
- B. Direct-connect Drive: Securely mount motor in accurate alignment so that shafts are free from both angular and parallel misalignment when both motor and driven machine are operating at normal temperatures.

3.8 LUBRICATION

- A. Lubricate all devices requiring lubrication prior to initial operation. Field-check all devices for proper lubrication.
- B. Equip all devices with required lubrication fittings or devices. Provide a minimum of one liter (one quart) of oil and 0.5 kg (one pound) of grease of manufacturer's recommended grade and type for each different application; also provide 12 grease sticks for lubricated plug valves. Deliver all materials to Resident Engineer in unopened containers that are properly identified as to application.
- C. Provide a separate grease gun with attachments for applicable fittings for each type of grease applied.
- D. All lubrication points shall be accessible without disassembling equipment, except to remove access plates.

3.9 COMMISSIONING

- A. Provide commissioning documentation in accordance with the requirements of Section 23 08 00 - COMMISSIONING OF HVAC SYSTEMS for all inspection,

start up, and contractor testing required above and required by the System Readiness Checklist provided by the Commissioning Agent.

- B. Components provided under this section of the specifications will be tested as part of a larger system. Refer to Section 23 08 00 - COMMISSIONING OF HVAC SYSTEMS and related sections for contractor responsibilities for system commissioning.

3.10 STARTUP AND TEMPORARY OPERATION

Start up equipment as described in equipment specifications. Verify that vibration is within specified tolerance prior to extended operation. Temporary use of equipment is specified in Section 01 00 00, GENERAL REQUIREMENTS, Article, TEMPORARY USE OF MECHANICAL AND ELECTRICAL EQUIPMENT.

3.11 OPERATING AND PERFORMANCE TESTS

- A. Prior to the final inspection, perform required tests as specified in Section 01 00 00, GENERAL REQUIREMENTS and submit the test reports and records to the Resident Engineer.
- B. Should evidence of malfunction in any tested system, or piece of equipment or component part thereof, occur during or as a result of tests, make proper corrections, repairs or replacements, and repeat tests at no additional cost to the Government.
- C. When completion of certain work or system occurs at a time when final control settings and adjustments cannot be properly made to make performance tests, then make performance tests for heating systems and for cooling systems respectively during first actual seasonal use of respective systems following completion of work.

3.12 INSTRUCTIONS TO VA PERSONNEL

Provide in accordance with Article, INSTRUCTIONS, of Section 01 00 00, GENERAL REQUIREMENTS.

- - - E N D - - -

SECTION 23 05 12
GENERAL MOTOR REQUIREMENTS FOR HVAC AND STEAM GENERATION EQUIPMENT

PART 1 - GENERAL

1.1 DESCRIPTION:

This section specifies the furnishing, installation and connection of motors for HVAC and steam generation equipment.

1.2 RELATED WORK:

- A. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: General electrical requirements common to more than one Section of Division 26.
- B. Section 26 29 11, LOW-VOLTAGE MOTOR STARTERS: Starters, control and protection for motors.
- C. Section 26 24 19, MOTOR-CONTROL CENTERS: Multiple motor control assemblies, which include motor starters.
- D. Section 23 05 11, COMMON WORK RESULTS FOR HVAC.
- E. Section 23 21 23, HYDRONIC PUMPS.
- F. Section 23 22 23, STEAM CONDENSATE PUMPS.
- G. Section 23 34 00, HVAC FANS.
- H. Section 23 36 00, AIR TERMINAL UNITS.
- I. Section 23 64 00, PACKAGED WATER CHILLERS.
- J. Section 23 73 00, INDOOR CENTRAL-STATION AIR-HANDLING UNITS.
- K. Section 23 81 00, DECENTRALIZED UNITARY HVAC EQUIPMENT.
- L. Section 23 81 43, AIR-SOURCE UNITARY HEAT PUMPS.
- M. Section 23 23 00, REFRIGERANT PIPING.
- N. Section 23 82 00, CONVECTION HEATING and COOLING UNITS.
- O. Section 23 08 00, COMMISSIONING OF HVAC SYSTEMS: Requirements for commissioning, systems readiness checklists, and training.

1.3 SUBMITTALS:

- A. In accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS, submit the following:
- B. Shop Drawings:
 - 1. Provide documentation to demonstrate compliance with drawings and specifications.
 - 2. Include electrical ratings, efficiency, bearing data, power factor, frame size, dimensions, mounting details, materials, horsepower, voltage, phase, speed (RPM), enclosure, starting characteristics, torque characteristics, code letter, full load and locked rotor current, service factor, and lubrication method.

C. Manuals:

1. Submit simultaneously with the shop drawings, companion copies of complete installation, maintenance and operating manuals, including technical data sheets and application data.

D. Certification: Two weeks prior to final inspection, unless otherwise noted, submit four copies of the following certification to the Resident Engineer:

1. Certification that the motors have been applied, installed, adjusted, lubricated, and tested according to manufacturer published recommendations.

E. Completed System Readiness Checklists provided by the Commissioning Agent and completed by the contractor, signed by a qualified technician and dated on the date of completion, in accordance with the requirements of Section 23 08 00 COMMISSIONING OF HVAC SYSTEMS.

1.4 APPLICABLE PUBLICATIONS:

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. National Electrical Manufacturers Association (NEMA):
 MG 1-2006 Rev. 1 2009 ..Motors and Generators
 MG 2-2001 Rev. 1 2007...Safety Standard for Construction and Guide for Selection, Installation and Use of Electric Motors and Generators
- C. National Fire Protection Association (NFPA):
 70-2008.....National Electrical Code (NEC)
- D. Institute of Electrical and Electronics Engineers (IEEE):
 112-04.....Standard Test Procedure for Polyphase Induction Motors and Generators
- E. American Society of Heating, Refrigerating and Air-Conditioning Engineers (ASHRAE):
 90.1-2007.....Energy Standard for Buildings Except Low-Rise Residential Buildings

PART 2 - PRODUCTS

2.1 MOTORS:

- A. For alternating current, fractional and integral horsepower motors, NEMA Publications MG 1 and MG 2 shall apply.
- B. All material and equipment furnished and installation methods shall conform to the requirements of Section 26 29 11, LOW-VOLTAGE MOTOR

- STARTERS; and Section 26 05 21, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES (600 VOLTS AND BELOW). Provide all electrical wiring, conduit, and devices necessary for the proper connection, protection and operation of the systems. Provide premium efficiency type motors as scheduled. Unless otherwise specified for a particular application, use electric motors with the following requirements.
- C. Single-phase Motors: Motors for centrifugal fans and pumps may be split phase or permanent split capacitor (PSC) type. Provide capacitor-start type for hard starting applications.
 - 1. Contractor's Option - Electrically Commutated motor (EC Type):
Motor shall be brushless DC type specifically designed for applications with heavy duty ball bearings and electronic commutation. The motor shall be speed controllable down to 20% of full speed and 85% efficient at all speeds.
 - D. Poly-phase Motors: NEMA Design B, Squirrel cage, induction type.
 - 1. Two Speed Motors: Each two-speed motor shall have two separate windings. Provide a time- delay (20 seconds minimum) relay for switching from high to low speed.
 - E. Voltage ratings shall be as follows:
 - 1. Single phase:
 - a. Motors connected to 120-volt systems: 115 volts.
 - b. Motors connected to 208-volt systems: 200 volts.
 - c. Motors connected to 240 volt or 480 volt systems: 230/460 volts, dual connection.
 - 2. Three phase:
 - a. Motors connected to 208-volt systems: 200 volts.
 - b. Motors, less than 74.6 kW (100 HP), connected to 240 volt or 480 volt systems: 208-230/460 volts, dual connection.
 - F. Number of phases shall be as follows:
 - 1. Motors, less than 373 W (1/2 HP): Single phase.
 - 2. Motors, 373 W (1/2 HP) and larger: 3 phase.
 - 3. Exceptions:
 - a. Hermetically sealed motors.
 - b. Motors for equipment assemblies, less than 746 W (one HP), may be single phase provided the manufacturer of the proposed assemblies cannot supply the assemblies with three phase motors.
 - G. Motors shall be designed for operating the connected loads continuously in a 40°C (104°F) environment, where the motors are installed, without

exceeding the NEMA standard temperature rises for the motor insulation. If the motors exceed 40°C (104°F), the motors shall be rated for the actual ambient temperatures.

- H. Motor designs, as indicated by the NEMA code letters, shall be coordinated with the connected loads to assure adequate starting and running torque.
- I. Motor Enclosures:
 - 1. Shall be the NEMA types as specified and/or shown on the drawings.
 - 2. Where the types of motor enclosures are not shown on the drawings, they shall be the NEMA types, which are most suitable for the environmental conditions where the motors are being installed. Enclosure requirements for certain conditions are as follows:
 - a. Motors located outdoors, indoors in wet or high humidity locations, or in unfiltered airstreams shall be totally enclosed type.
 - b. Where motors are located in an NEC 511 classified area, provide TEFC explosion proof motor enclosures.
 - c. Where motors are located in a corrosive environment, provide TEFC enclosures with corrosion resistant finish.
 - 3. Enclosures shall be primed and finish coated at the factory with manufacturer's prime coat and standard finish.
- J. Special Requirements:
 - 1. Where motor power requirements of equipment furnished deviate from power shown on plans, provide electrical service designed under the requirements of NFPA 70 without additional time or cost to the Government.
 - 2. Assemblies of motors, starters, controls and interlocks on factory assembled and wired devices shall be in accordance with the requirements of this specification.
 - 3. Wire and cable materials specified in the electrical division of the specifications shall be modified as follows:
 - a. Wiring material located where temperatures can exceed 71 degrees C (160 degrees F) shall be stranded copper with Teflon FEP insulation with jacket. This includes wiring on the boilers.
 - b. Other wiring to control panels shall be NFPA 70 designation THWN.
 - c. Provide shielded conductors or wiring in separate conduits for all instrumentation and control systems where recommended by manufacturer of equipment.

4. Select motor sizes so that the motors do not operate into the service factor at maximum required loads on the driven equipment. Motors on pumps shall be sized for non-overloading at all points on the pump performance curves.
5. Motors utilized with variable frequency drives shall be rated "inverter-duty" per NEMA Standard, MG1, Part 31.4.4.2. Provide motor shaft grounding apparatus that will protect bearings from damage from stray currents.
- K. Additional requirements for specific motors, as indicated in the other sections listed in Article 1.2, shall also apply.
- L. Energy-Efficient Motors (Motor Efficiencies): All permanently wired polyphase motors of 746 Watts (1 HP) or more shall meet the minimum full-load efficiencies as indicated in the following table. Motors of 746 Watts or more with open-, drip-proof or totally enclosed fan-cooled enclosures shall be NEMA premium efficiency type, unless otherwise indicated. Motors provided as an integral part of motor driven equipment are excluded from this requirement if a minimum seasonal or overall efficiency requirement is indicated for that equipment by the provisions of another section. Motors not specified as "premium efficiency" shall comply with the Energy Policy Act of 2005 (EPACT).

Minimum Premium Efficiencies Open Drip-Proof				Minimum Premium Efficiencies Totally Enclosed Fan-Cooled			
Rating kW (HP)	1200 RPM	1800 RPM	3600 RPM	Rating kW (HP)	1200 RPM	1800 RPM	3600 RPM
0.746 (1)	82.5%	85.5%	77.0%	0.746 (1)	82.5%	85.5%	77.0%
1.12 (1.5)	86.5%	86.5%	84.0%	1.12 (1.5)	87.5%	86.5%	84.0%
1.49 (2)	87.5%	86.5%	85.5%	1.49 (2)	88.5%	86.5%	85.5%
2.24 (3)	88.5%	89.5%	85.5%	2.24 (3)	89.5%	89.5%	86.5%
3.73 (5)	89.5%	89.5%	86.5%	3.73 (5)	89.5%	89.5%	88.5%
5.60 (7.5)	90.2%	91.0%	88.5%	5.60 (7.5)	91.0%	91.7%	89.5%
7.46 (10)	91.7%	91.7%	89.5%	7.46 (10)	91.0%	91.7%	90.2%
11.2 (15)	91.7%	93.0%	90.2%	11.2 (15)	91.7%	92.4%	91.0%
14.9 (20)	92.4%	93.0%	91.0%	14.9 (20)	91.7%	93.0%	91.0%
18.7 (25)	93.0%	93.6%	91.7%	18.7 (25)	93.0%	93.6%	91.7%
22.4 (30)	93.6%	94.1%	91.7%	22.4 (30)	93.0%	93.6%	91.7%
29.8 (40)	94.1%	94.1%	92.4%	29.8 (40)	94.1%	94.1%	92.4%
37.3 (50)	94.1%	94.5%	93.0%	37.3 (50)	94.1%	94.5%	93.0%

44.8 (60)	94.5%	95.0%	93.6%	44.8 (60)	94.5%	95.0%	93.6%
56.9 (75)	94.5%	95.0%	93.6%	56.9 (75)	94.5%	95.4%	93.6%
74.6 (100)	95.0%	95.4%	93.6%	74.6 (100)	95.0%	95.4%	94.1%
93.3 (125)	95.0%	95.4%	94.1%	93.3 (125)	95.0%	95.4%	95.0%
112 (150)	95.4%	95.8%	94.1%	112 (150)	95.8%	95.8%	95.0%
149.2 (200)	95.4%	95.8%	95.0%	149.2 (200)	95.8%	96.2%	95.4%

M. Minimum Power Factor at Full Load and Rated Voltage: 90 percent at 1200 RPM, 1800 RPM and 3600 RPM.

PART 3 - EXECUTION

3.1 INSTALLATION:

Install motors in accordance with manufacturer's recommendations, the NEC, NEMA, as shown on the drawings and/or as required by other sections of these specifications.

3.2 FIELD TESTS

- A. Perform an electric insulation resistance Test using a megohmmeter on all motors after installation, before start-up. All shall test free from grounds.
- B. Perform Load test in accordance with ANSI/IEEE 112, Test Method B, to determine freedom from electrical or mechanical defects and compliance with performance data.
- C. Insulation Resistance: Not less than one-half meg-ohm between stator conductors and frame, to be determined at the time of final inspection.

3.3 STARTUP AND TESTING

- A. The Commissioning Agent will observe startup and contractor testing of selected equipment. Coordinate the startup and contractor testing schedules with Resident Engineer and Commissioning Agent. Provide a minimum of 7 days prior notice.

3.4 COMMISSIONING

- A. Provide commissioning documentation in accordance with the requirements of Section 23 08 00 - COMMISSIONING OF HVAC SYSTEMS for all inspection, start up, and contractor testing required above and required by the System Readiness Checklist provided by the Commissioning Agent.
- B. Components provided under this section of the specification will be tested as part of a larger system. Refer to Section 23 08 00 - COMMISSIONING OF HVAC SYSTEMS and related sections for contractor responsibilities for system commissioning.

3.5 DEMONSTRATION AND TRAINING

- A. Provide services of manufacturer's technical representative for four hours to instruct VA personnel in operation and maintenance of units.
- B. Submit training plans and instructor qualifications in accordance with the requirements of Section 23 08 00 - COMMISSIONING OF HVAC SYSTEMS.

- - - E N D - - -

SECTION 23 05 41
NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT

PART 1 - GENERAL

1.1 DESCRIPTION

Noise criteria, vibration tolerance and vibration isolation for HVAC and plumbing work.

1.2 RELATED WORK

- A. Section 03 30 00, CAST-IN-PLACE CONCRETE: Requirements for concrete inertia bases.
- B. Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION: General mechanical requirements and items, which are common to more than one section of Division 23.
- C. Section 23 22 13, STEAM and CONDENSATE HEATING PIPING: Requirements for flexible pipe connectors to reciprocating and rotating mechanical equipment.
- D. Section 23 73 00, INDOOR CENTRAL-STATION AIR-HANDLING UNITS: Requirements for optional Air Handling Unit internal vibration isolation.
- E. Section 23 31 00, HVAC DUCTS and CASINGS: requirements for flexible duct connectors, sound attenuators and sound absorbing duct lining.
- F. SECTION 23 05 93, TESTING, ADJUSTING, and BALANCING FOR HVAC: requirements for sound and vibration tests.
- G. SECTION 23 37 00, AIR OUTLETS and INLETS: noise requirements for G-grilles.
- H. SECTION 23 21 23, HYDRONIC PUMPS: vibration isolation requirements for pumps.
- I. SECTION 23 34 00, HVAC FANS: sound and vibration isolation requirements for fans.
- J. Section 23 08 00, COMMISSIONING OF HVAC SYSTEMS: Requirements for commissioning, systems readiness checklists, and training.

1.3 QUALITY ASSURANCE

- A. Refer to article, QUALITY ASSURANCE in specification Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.
- B. Noise Criteria:
 - 1. Noise levels in all 8 octave bands due to equipment and duct systems shall not exceed following NC levels:

TYPE OF ROOM	NC LEVEL
Bathrooms and Toilet Rooms	40
Corridors (Public)	40
Dining Rooms, Food Services/ Serving	40
Lobbies, Waiting Areas	40
Offices, Large Open	40
Offices, Small Private	35
Recreation Rooms	40-45
Shops	50
Warehouse	50

2. For equipment which has no sound power ratings scheduled on the plans, the contractor shall select equipment such that the foregoing noise criteria, local ordinance noise levels, and OSHA requirements are not exceeded. Selection procedure shall be in accordance with ASHRAE Fundamentals Handbook, Chapter 7, Sound and Vibration.
3. An allowance, not to exceed 5db, may be added to the measured value to compensate for the variation of the room attenuating effect between room test condition prior to occupancy and design condition after occupancy which may include the addition of sound absorbing material, such as, furniture. This allowance may not be taken after occupancy. The room attenuating effect is defined as the difference between sound power level emitted to room and sound pressure level in room.
4. In absence of specified measurement requirements, measure equipment noise levels three feet from equipment and at an elevation of maximum noise generation.

1.4 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American Society of Heating, Refrigerating and Air-Conditioning Engineers, Inc. (ASHRAE):
2009Fundamentals Handbook, Chapter 7, Sound and Vibration
- C. American Society for Testing and Materials (ASTM):

- A123/A123M-09.....Standard Specification for Zinc (Hot-Dip
Galvanized) Coatings on Iron and Steel Products
- A307-07b.....Standard Specification for Carbon Steel Bolts
and Studs, 60,000 PSI Tensile Strength
- D2240-05 (2010).....Standard Test Method for Rubber Property -
Durometer Hardness
- D. Manufacturers Standardization (MSS):
- SP-58-2009.....Pipe Hangers and Supports-Materials, Design and
Manufacture
- E. Occupational Safety and Health Administration (OSHA):
- 29 CFR 1910.95.....Occupational Noise Exposure
- F. American Society of Civil Engineers (ASCE):
- ASCE 7-10Minimum Design Loads for Buildings and Other
Structures.
- G. American National Standards Institute / Sheet Metal and Air
Conditioning Contractor's National Association (ANSI/SMACNA):
- 001-2008.....Seismic Restraint Manual: Guidelines for
Mechanical Systems, 3rd Edition.
- H. International Code Council (ICC):
- 2009 IBC.....International Building Code.

PART 2 - PRODUCTS

2.1 GENERAL REQUIREMENTS

- A. Type of isolator, base, and minimum static deflection shall be as required for each specific equipment application as recommended by isolator or equipment manufacturer but subject to minimum requirements indicated herein and in the schedule on the drawings.
- B. Elastometric Isolators shall comply with ASTM D2240 and be oil resistant neoprene with a maximum stiffness of 60 durometer and have a straight-line deflection curve.
- C. Exposure to weather: Isolator housings to be either hot dipped galvanized or powder coated to ASTM B117 salt spray testing standards. Springs to be powder coated or electro galvanized. All hardware to be electro galvanized. In addition provide limit stops to resist wind velocity. Velocity pressure established by wind shall be calculated in accordance with section 1609 of the International Building Code. A minimum wind velocity of 75 mph shall be employed.
- D. Uniform Loading: Select and locate isolators to produce uniform loading and deflection even when equipment weight is not evenly distributed.

- E. Color code isolators by type and size for easy identification of capacity.

2.2 VIBRATION ISOLATORS

A. Floor Mountings:

1. Double Deflection Neoprene (Type N): Shall include neoprene covered steel support plated (top and bottom), friction pads, and necessary bolt holes.
2. Spring Isolators (Type S): Shall be free-standing, laterally stable and include acoustical friction pads and leveling bolts. Isolators shall have a minimum ratio of spring diameter-to-operating spring height of 1.0 and an additional travel to solid equal to 50 percent of rated deflection.
3. Spring Isolators with Vertical Limit Stops (Type SP): Similar to spring isolators noted above, except include a vertical limit stop to limit upward travel if weight is removed and also to reduce movement and spring extension due to wind loads. Provide clearance around restraining bolts to prevent mechanical short circuiting. // Isolators shall have a minimum seismic rating of one G. //
4. Pads (Type D), Washers (Type W), and Bushings (Type L): Pads shall be natural rubber or neoprene waffle, neoprene and steel waffle, or reinforced duck and neoprene. Washers and bushings shall be reinforced duck and neoprene. Washers and bushings shall be reinforced duck and neoprene. Size pads for a maximum load of 345 kPa (50 pounds per square inch).

B. Hangers: Shall be combination neoprene and springs unless otherwise noted and shall allow for expansion of pipe.

1. Combination Neoprene and Spring (Type H): Vibration hanger shall contain a spring and double deflection neoprene element in series. Spring shall have a diameter not less than 0.8 of compressed operating spring height. Spring shall have a minimum additional travel of 50 percent between design height and solid height. Spring shall permit a 15 degree angular misalignment without rubbing on hanger box.
2. Spring Position Hanger (Type HP): Similar to combination neoprene and spring hanger except hanger shall hold piping at a fixed elevation during installation and include a secondary adjustment feature to transfer load to spring while maintaining same position.

3. Neoprene (Type HN): Vibration hanger shall contain a double deflection type neoprene isolation element. Hanger rod shall be separated from contact with hanger bracket by a neoprene grommet.
 4. Spring (Type HS): Vibration hanger shall contain a coiled steel spring in series with a neoprene grommet. Spring shall have a diameter not less than 0.8 of compressed operating spring height. Spring shall have a minimum additional travel of 50 percent between design height and solid height. Spring shall permit a 15 degree angular misalignment without rubbing on hanger box.
 5. Hanger supports for piping 50 mm (2 inches) and larger shall have a pointer and scale deflection indicator.
- C. Thrust Restraints (Type THR): Restraints shall provide a spring element contained in a steel frame with neoprene pads at each end attachment. Restraints shall have factory preset thrust and be field adjustable to allow a maximum movement of 6 mm (1/4 inch) when the fan starts and stops. Restraint assemblies shall include rods, angle brackets and other hardware for field installation.

2.3 BASES

- A. Inertia Base (Type I): Base shall be a reinforced concrete inertia base. Pour concrete into a welded steel channel frame, incorporating prelocated equipment anchor bolts and pipe sleeves. Level the concrete to provide a smooth uniform bearing surface for equipment mounting. Provide grout under uneven supports. Channel depth shall be a minimum of 1/12 of longest dimension of base but not less than 150 mm (six inches). Form shall include 13-mm (1/2-inch) reinforcing bars welded in place on minimum of 203 mm (eight inch) centers running both ways in a layer 40 mm (1-1/2 inches) above bottom. Use height saving brackets in all mounting locations. Weight of inertia base shall be equal to or greater than weight of equipment supported to provide a maximum peak-to-peak displacement of 2 mm (1/16 inch).

2.4 SOUND ATTENUATING UNITS

Refer to specification Section 23 31 00, HVAC DUCTS and CASINGS.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Vibration Isolation:
1. No metal-to-metal contact will be permitted between fixed and floating parts.

2. Connections to Equipment: Allow for deflections equal to or greater than equipment deflections. Electrical, drain, piping connections, and other items made to rotating or reciprocating equipment (pumps, compressors, etc.) which rests on vibration isolators, shall be isolated from building structure for first three hangers or supports with a deflection equal to that used on the corresponding equipment.
 3. Common Foundation: Mount each electric motor on same foundation as driven machine. Hold driving motor and driven machine in positive rigid alignment with provision for adjusting motor alignment and belt tension. Bases shall be level throughout length and width. Provide shims to facilitate pipe connections, leveling, and bolting.
 4. Provide heat shields where elastomers are subject to temperatures over 38 degrees C (100 degrees F).
 5. Extend bases for pipe elbow supports at discharge and suction connections at pumps. Pipe elbow supports shall not short circuit pump vibration to structure.
 6. Non-rotating equipment such as heat exchangers and convertors shall be mounted on isolation units having the same static deflection as the isolation hangers or support of the pipe connected to the equipment.
- B. Inspection and Adjustments: Check for vibration and noise transmission through connections, piping, ductwork, foundations, and walls. Adjust, repair, or replace isolators as required to reduce vibration and noise transmissions to specified levels.

3.2 ADJUSTING

- A. Adjust vibration isolators after piping systems are filled and equipment is at operating weight.
- B. Adjust limit stops on restrained spring isolators to mount equipment at normal operating height. After equipment installation is complete, adjust limit stops so they are out of contact during normal operation.
- C. Attach thrust limits at centerline of thrust and adjust to a maximum of 1/4inch (6-mm) movement during start and stop.
- D. Adjust active height of spring isolators.

3.3 COMMISSIONING

- A. Provide commissioning documentation in accordance with the requirements of section 23 08 00 - COMMISSIONING OF HVAC SYSTEMS for all inspection, start up, and contractor testing required above and required by the System Readiness Checklist provided by the Commissioning Agent.

B. Components provided under this section of the specification will be tested as part of a larger system. Refer to section 23 08 00 - COMMISSIONING OF HVAC SYSTEMS and related sections for contractor responsibilities for system commissioning.

- - - E N D - - -

SELECTION GUIDE FOR VIBRATION ISOLATORS

EQUIPMENT			ON GRADE			20FT FLOOR SPAN			30FT FLOOR SPAN			40FT FLOOR SPAN			50FT FLOOR SPAN		
			BASE TYPE	ISOL TYPE	MIN DEFL	BASE TYPE	ISOL TYPE	MIN DEFL	BASE TYPE	ISOL TYPE	MIN DEFL	BASE TYPE	ISOL TYPE	MIN DEFL	BASE TYPE	ISOL TYPE	MIN DEFL
REFRIGERATION MACHINES																	
RECIPROCATING:																	
ALL			---	D	0.3	---	SP	0.8	R	SP	2.0	R	SP	2.5	R	SP	3.5
COMPRESSORS AND VACUUM PUMPS																	
UP THROUGH 1-1/2 HP			---	D, L, W	0.8	----	D, L, W	0.8	---	D, L, W	1.5	---	D, L, W	1.5	---	D, L, W	---
2 HP AND OVER:																	
500 - 750 RPM			---	D	0.8	---	S	0.8	---	S	1.5	---	S	1.5	---	S	2.5
750 RPM & OVER			---	D	0.8	---	S	0.8	---	S	1.5	---	S	1.5	---	S	2.5
PUMPS																	
CLOSE COUPLED	UP TO 1-1/2 HP	---	---	---	---	---	D, L, W	---	---	D, L, W	---	---	D, L, W	---	---	D, L, W	---
	2 HP & OVER	---	---	---	I	I	S	0.8	I	S	1.5	I	S	1.5	I	S	2.0
LARGE INLINE	Up to 25 HP	---	---	---	---	---	S	0.75	---	S	1.50	---	S	1.50	---	---	NA
	26 HP THRU 30 HP	---	---	---	---	---	S	1.0	---	S	1.50	---	S	2.50	---	---	NA

EQUIPMENT		ON GRADE			20FT FLOOR SPAN			30FT FLOOR SPAN			40FT FLOOR SPAN			50FT FLOOR SPAN		
		BASE TYPE	ISOL TYPE	MIN DEFL	BASE TYPE	ISOL TYPE	MIN DEFL	BASE TYPE	ISOL TYPE	MIN DEFL	BASE TYPE	ISOL TYPE	MIN DEFL	BASE TYPE	ISOL TYPE	MIN DEFL
BASE MOUNTED	UP TO 10 HP	---	---	---	---	D, L, W	---	---	D, L, W	---	---	D, L, W	---	---	D, L, W	---
	15 HP THRU 40 HP	I	S	1.0	I	S	1.0	I	S	2.0	I	S	2.0	I	S	2.0
	50 HP & OVER	I	S	1.0	I	S	1.0	I	S	2.0	I	S	2.5	I	S	2.5
CENTRIFUGAL FANS																
UP TO 50 HP:																
UP TO 200 RPM		B	N	0.3	B	S	2.5	B	S	2.5	B	S	3.5	B	S	3.5
201 - 300 RPM		B	N	0.3	B	S	2.0	B	S	2.5	B	S	3.5	B	S	3.5
301 - 500 RPM		B	N	0.3	B	S	2.0	B	S	2.0	B	S	3.5	B	S	3.5
501 RPM & OVER		B	N	0.3	B	S	2.0	B	S	2.0	B	S	2.5	B	S	2.5
AIR HANDLING UNIT PACKAGES																
SUSPENDED:																
7-1/2 HP & OVER:																
FLOOR MOUNTED:																
UP THRU 5 HP		---	D	---	---	S	1.0	---	S	1.0	---	S	1.0	---	S	1.0
7-1/2 HP & OVER:																

EQUIPMENT	ON GRADE			20FT FLOOR SPAN			30FT FLOOR SPAN			40FT FLOOR SPAN			50FT FLOOR SPAN		
	BASE TYPE	ISOL TYPE	MIN DEFL	BASE TYPE	ISOL TYPE	MIN DEFL	BASE TYPE	ISOL TYPE	MIN DEFL	BASE TYPE	ISOL TYPE	MIN DEFL	BASE TYPE	ISOL TYPE	MIN DEFL
UP TO 500 RPM	---	D	---	R	S, THR	1.5	R	S, THR	2.5	R	S, THR	2.5	R	S, THR	2.5
501 RPM & OVER	---	D	---	---	S, THR	0.8	---	S, THR	0.8	R	S, THR	1.5	R	S, THR	2.0
HEAT PUMPS															
ALL	---	S	0.75	---	S	0.75	---	S	0.75	CB	S	1.5	---	---	NA
CONDENSING UNITS															
ALL	---	SS	0.25	---	SS	0.75	---	SS	1.5	CB	SS	1.5	---	---	NA
IN-LINE CENTRIFUGAL AND VANE AXIAL FANS, FLOOR MOUNTED: (APR 9)															
UP THRU 50 HP:															
UP TO 300 RPM	---	D	---	R	S	2.5	R	S	2.5	R	S	2.5	R	S	3.5
301 - 500 RPM	---	D	---	R	S	2.0	R	S	2.0	R	S	2.5	R	S	2.5
501 - & OVER	---	D	---	---	S	1.0	---	S	1.0	R	S	2.0	R	S	2.5

SECTION 23 05 93
TESTING, ADJUSTING, AND BALANCING FOR HVAC

PART 1 - GENERAL

1.1 DESCRIPTION

- A. Testing, adjusting, and balancing (TAB) of heating, ventilating and air conditioning (HVAC) systems. TAB includes the following:
 - 1. Planning systematic TAB procedures.
 - 2. Design Review Report.
 - 3. Systems Inspection report.
 - 4. Duct Air Leakage test report.
 - 5. Systems Readiness Report.
 - 6. Balancing air and water distribution systems; adjustment of total system to provide design performance; and testing performance of equipment and automatic controls.
 - 7. Vibration and sound measurements.
 - 8. Recording and reporting results.
- B. Definitions:
 - 1. Basic TAB used in this Section: Chapter 37, "Testing, Adjusting and Balancing" of ASHRAE Handbook, "HVAC Applications".
 - 2. TAB: Testing, Adjusting and Balancing; the process of checking and adjusting HVAC systems to meet design objectives.
 - 3. AABC: Associated Air Balance Council.
 - 4. NEBB: National Environmental Balancing Bureau.
 - 5. Hydronic Systems: Includes chilled water, heating hot water systems.
 - 6. Air Systems: Includes all outside air, supply air, return air, exhaust air and relief air systems.
 - 7. Flow rate tolerance: The allowable percentage variation, minus to plus, of actual flow rate from values (design) in the contract documents.

1.2 RELATED WORK

- A. Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION: General Mechanical Requirements.
- B. Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT: Noise and Vibration Requirements.
- C. Section 23 07 11, HVAC, PLUMBING, AND BOILER PLANT INSULATION: Piping and Equipment Insulation.

- D. Section 23 64 00, PACKAGED WATER CHILLERS: Testing Refrigeration Equipment.
- E. Section 23 36 00, AIR TERMINAL UNITS: Terminal Units Performance.
- F. Section 23 31 00, HVAC DUCTS AND CASINGS: Duct Leakage.
- G. Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC: Controls and Instrumentation Settings.

1.3 QUALITY ASSURANCE

- A. Refer to Articles, Quality Assurance and Submittals, in Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION.
- B. Qualifications:
 1. TAB Agency: The TAB agency shall be a subcontractor of the General Contractor and shall report to and be paid by the General Contractor.
 2. The TAB agency shall be either a certified member of AABC or certified by the NEBB to perform TAB service for HVAC, water balancing and vibrations and sound testing of equipment. The certification shall be maintained for the entire duration of duties specified herein. If, for any reason, the agency loses subject certification during this period, the General Contractor shall immediately notify the Contracting Officer's Technical Representative (COTR) and submit another TAB firm for approval. Any agency that has been the subject of disciplinary action by either the AABC or the NEBB within the five years preceding Contract Award shall not be eligible to perform any work related to the TAB. All work performed in this Section and in other related Sections by the TAB agency shall be considered invalid if the TAB agency loses its certification prior to Contract completion, and the successor agency's review shows unsatisfactory work performed by the predecessor agency.
 3. TAB Specialist: The TAB specialist shall be either a member of AABC or an experienced technician of the Agency certified by NEBB. The certification shall be maintained for the entire duration of duties specified herein. If, for any reason, the Specialist loses subject certification during this period, the General Contractor shall immediately notify the COTR and submit another TAB Specialist for approval. Any individual that has been the subject of disciplinary action by either the AABC or the NEBB within the five years preceding Contract Award shall not be eligible to perform any duties

related to the HVAC systems, including TAB. All work specified in this Section and in other related Sections performed by the TAB specialist shall be considered invalid if the TAB Specialist loses its certification prior to Contract completion and must be performed by an approved successor.

4. TAB Specialist shall be identified by the General Contractor within 60 days after the notice to proceed. The TAB specialist will be coordinating, scheduling and reporting all TAB work and related activities and will provide necessary information as required by the COTR. The responsibilities would specifically include:

- a. Shall directly supervise all TAB work.
- b. Shall sign the TAB reports that bear the seal of the TAB standard. The reports shall be accompanied by report forms and schematic drawings required by the TAB standard, AABC or NEBB.
- c. Would follow all TAB work through its satisfactory completion.
- d. Shall provide final markings of settings of all HVAC adjustment devices.
- e. Permanently mark location of duct test ports.

5. All TAB technicians performing actual TAB work shall be experienced and must have done satisfactory work on a minimum of 3 projects comparable in size and complexity to this project. Qualifications must be certified by the TAB agency in writing.

C. Test Equipment Criteria: The instrumentation shall meet the accuracy/calibration requirements established by AABC National Standards or by NEBB Procedural Standards for Testing, Adjusting and Balancing of Environmental Systems and instrument manufacturer. Provide calibration history of the instruments to be used for test and balance purpose.

D. Tab Criteria:

- 1. One or more of the applicable AABC, NEBB or SMACNA publications, supplemented by ASHRAE Handbook "HVAC Applications" Chapter 36, and requirements stated herein shall be the basis for planning, procedures, and reports.
- 2. Flow rate tolerance: Following tolerances are allowed. For tolerances not mentioned herein follow ASHRAE Handbook "HVAC Applications", Chapter 36, as a guideline. Air Filter resistance

during tests, artificially imposed if necessary, shall be at least 90 percent of final values for pre-filters and after-filters.

- a. Air handling unit and all other fans, cubic meters/min (cubic feet per minute): Minus 0 percent to plus 10 percent.
 - b. Air terminal units (maximum values): Minus 2 percent to plus 10 percent.
 - c. Minimum outside air: 0 percent to plus 10 percent.
 - d. Individual room air outlets and inlets, and air flow rates not mentioned above: Minus 2 percent to plus 10 percent except if the air to a space is 100 CFM or less the tolerance would be 0 to plus 5 percent.
 - e. Heating hot water pumps and hot water coils: Minus 5 percent to plus 5 percent.
 - f. Chilled water pumps: 0 percent to plus 5 percent.
 - g. Chilled water coils: 0 percent to plus 5 percent.
3. Systems shall be adjusted for energy efficient operation as described in PART 3.
 4. Typical TAB procedures and results shall be demonstrated to the COTR for one air distribution system (including all fans, three terminal units, three rooms) and one hydronic system (pumps and three coils) as follows:
 - a. When field TAB work begins.
 - b. During each partial final inspection and the final inspection for the project if requested by VA.

1.4 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Submit names and qualifications of TAB agency and TAB specialists within 60 calendar days after the notice to proceed. Submit information on three recently completed projects and a list of proposed test equipment.
- C. For use by the COTR staff, submit one complete set of applicable AABC or NEBB publications that will be the basis of TAB work.
- D. Submit Following for Review and Approval:
 1. Design Review Report within 90 calendar days after the system layout on air and water side is completed by the Contractor.
 2. Systems inspection report on equipment and installation for conformance with design.

3. Duct Air Leakage Test Report.
 4. Systems Readiness Report.
 5. Intermediate and Final TAB reports covering flow balance and adjustments, performance tests, vibration tests and sound tests.
 6. Include in final reports uncorrected installation deficiencies noted during TAB and applicable explanatory comments on test results that differ from design requirements.
- E. Prior to request for Final or Partial Final inspection, submit completed Test and Balance report for the area.

1.5 APPLICABLE PUBLICATIONS

- A. The following publications form a part of this specification to the extent indicated by the reference thereto. In text the publications are referenced to by the acronym of the organization.
- B. American Society of Heating, Refrigerating and Air Conditioning Engineers, Inc. (ASHRAE):
- 2003.....HVAC Applications ASHRAE Handbook, Chapter 37,
Testing, Adjusting, and Balancing and Chapter
47, Sound and Vibration Control
- C. Associated Air Balance Council (AABC):
- 2002.....AABC National Standards for Total System
Balance
- D. National Environmental Balancing Bureau (NEBB):
- 7th Edition 2005Procedural Standards for Testing, Adjusting,
Balancing of Environmental Systems
- 1st Edition 1994Procedural Standards for the Measurement and
Assessment of Sound and Vibration
- 2nd Edition 1999Procedural Standards for Building Systems
Commissioning
- E. Sheet Metal and Air Conditioning Contractors National Association (SMACNA):
- 3rd Edition 2002HVAC SYSTEMS-Testing, Adjusting and Balancing

PART 2 - PRODUCTS

2.1 PLUGS

Provide plastic plugs to seal holes drilled in ductwork for test purposes.

2.2 INSULATION REPAIR MATERIAL

See Section 23 07 11, HVAC, PLUMBING, AND BOILER PLANT INSULATION.
Provide for repair of insulation removed or damaged for TAB work.

PART 3 - EXECUTION**3.1 GENERAL**

- A. Refer to TAB Criteria in Article, Quality Assurance.
- B. Obtain applicable contract documents and copies of approved submittals for HVAC equipment and automatic control systems.

3.2 DESIGN REVIEW REPORT

The TAB Specialist shall review the Contract Plans and specifications and advise the COTR of any design deficiencies that would prevent the HVAC systems from effectively operating in accordance with the sequence of operation specified or prevent the effective and accurate TAB of the system. The TAB Specialist shall provide a report individually listing each deficiency and the corresponding proposed corrective action necessary for proper system operation.

3.3 SYSTEMS INSPECTION REPORT

- A. Inspect equipment and installation for conformance with design.
- B. The inspection and report is to be done after air distribution equipment is on site and duct installation has begun, but well in advance of performance testing and balancing work. The purpose of the inspection is to identify and report deviations from design and ensure that systems will be ready for TAB at the appropriate time.
- C. Reports: Follow check list format developed by AABC, NEBB or SMACNA, supplemented by narrative comments, with emphasis on air handling units and fans. Check for conformance with submittals. Verify that diffuser and register sizes are correct. Check air terminal unit installation including their duct sizes and routing.

3.4 DUCT AIR LEAKAGE TEST REPORT

See paragraphs "Duct leakage Tests and Repairs" in Section 23 31 00, HVAC DUCTS AND CASINGS for TAB agency's role and responsibilities in witnessing, recording and reporting of deficiencies.

3.5 SYSTEM READINESS REPORT

- A. Inspect each System to ensure that it is complete including installation and operation of controls.
- B. Verify that all items such as ductwork piping, ports, terminals, connectors, etc., that is required for TAB are installed. Provide a report to the COTR.

3.6 TAB REPORTS

- A. Submit an intermediate report for 50 percent of systems and equipment tested and balanced to establish satisfactory test results.

- B. The TAB contractor shall provide raw data immediately in writing to the COTR if there is a problem in achieving intended results before submitting a formal report.
- C. If over 20 percent of readings in the intermediate report fall outside the acceptable range, the TAB report shall be considered invalid and all contract TAB work shall be repeated and re-submitted for approval.
- D. Do not proceed with the remaining systems until intermediate report is approved by the COTR.

3.7 TAB PROCEDURES

- A. Tab shall be performed in accordance with the requirement of the Standard under which TAB agency is certified by either AABC or NEBB.
- B. General: During TAB all related system components shall be in full operation. Fan and pump rotation, motor loads and equipment vibration shall be checked and corrected as necessary before proceeding with TAB. Set controls and/or block off parts of distribution systems to simulate design operation of variable volume air systems for test and balance work.
- C. Coordinate TAB procedures with any phased construction completion requirements for the project. Provide TAB reports for each phase of the project prior to partial final inspections of each phase of the project.
- D. Allow sufficient time in construction schedule for TAB and submission of all reports for an organized and timely correction of deficiencies.
- E. Air Balance and Equipment Test: Include air handling units, fans, terminal units, fan coil units, and room diffusers/outlets/inlets.
 - 1. Artificially load air filters by partial blanking to produce air pressure drop of at least 90 percent of the design final pressure drop.
 - 2. Adjust fan speeds to provide design air flow. V-belt drives, including fixed pitch pulley requirements, are specified in Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION.
 - 3. Test and balance systems in all specified modes of operation, including variable volume, economizer modes. Verify that dampers and other controls function properly.
 - 4. Variable air volume (VAV) systems:
 - a. Coordinate TAB, including system volumetric controls, with Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC.

- b. Section 23 36 00, AIR TERMINAL UNITS, specifies that maximum and minimum flow rates for air terminal units (ATU) be factory set. Check and readjust ATU flow rates if necessary. Balance air distribution from ATU on full cooling maximum scheduled cubic meters per minute (cubic feet per minute). Reset room thermostats and check ATU operation from maximum to minimum cooling, to the heating mode, and back to cooling. Record and report the heating coil leaving air temperature when the ATU is in the maximum heating mode.
- 5. Record final measurements for air handling equipment performance data sheets.
- F. Water Balance and Equipment Test: Include circulating pumps, convertors, coils, coolers and condensers:
 - 1. Coordinate water chiller flow balancing with Section 23 64 00, PACKAGED WATER CHILLERS.
 - 2. Adjust flow rates for equipment. Set coils and evaporator to values on equipment submittals, if different from values on contract drawings.
 - 3. Primary-secondary (variable volume) systems: Coordinate TAB with Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC. Balance systems at design water flow and then verify that variable flow controls function properly.
 - 4. Record final measurements for hydronic equipment on performance data sheets. Include entering and leaving water temperatures for heating and cooling coils, and for convertors. Include entering and leaving air temperatures (DB/WB for cooling coils) for air handling units and reheat coils. Make air and water temperature measurements at the same time.

3.8 VIBRATION TESTING

- A. Furnish instruments and perform vibration measurements as specified in Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT. Field vibration balancing is specified in Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION. Provide measurements for all rotating HVAC equipment of 373 watts (1/2 horsepower) and larger, including centrifugal/screw compressors, cooling towers, pumps, fans and motors.
- B. Record initial measurements for each unit of equipment on test forms and submit a report to the COTR. Where vibration readings exceed the

allowable tolerance Contractor shall be directed to correct the problem. The TAB agency shall verify that the corrections are done and submit a final report to the Resident Engineer.

3.9 SOUND TESTING

- A. Perform and record required sound measurements in accordance with Paragraph, QUALITY ASSURANCE in Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT.
 - 1. Take readings in rooms, approximately fifteen (15) percent of all rooms. The Resident Engineer may designate the specific rooms to be tested.
- B. Take measurements with a calibrated sound level meter and octave band analyzer of the accuracy required by AABC or NEBB.
- C. Sound reference levels, formulas and coefficients shall be according to ASHRAE Handbook, "HVAC Applications", Chapter 46, SOUND AND VIBRATION CONTROL.
- D. Determine compliance with specifications as follows:
 - 1. When sound pressure levels are specified, including the NC Criteria in Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT:
 - a. Reduce the background noise as much as possible by shutting off unrelated audible equipment.
 - b. Measure octave band sound pressure levels with specified equipment "off."
 - c. Measure octave band sound pressure levels with specified equipment "on."
 - d. Use the DIFFERENCE in corresponding readings to determine the sound pressure due to equipment.

DIFFERENCE:	0	1	2	3	4	5 to 9	10 or More
FACTOR:	10	7	4	3	2	1	0

Sound pressure level due to equipment equals sound pressure level with equipment "on" minus FACTOR.

- e. Plot octave bands of sound pressure level due to equipment for typical rooms on a graph which also shows noise criteria (NC) curves.
- 2. When sound power levels are specified:
 - a. Perform steps 1.a. thru 1.d., as above.

- b. For indoor equipment: Determine room attenuating effect, i.e., difference between sound power level and sound pressure level. Determined sound power level will be the sum of sound pressure level due to equipment plus the room attenuating effect.
 - c. For outdoor equipment: Use directivity factor and distance from noise source to determine distance factor, i.e., difference between sound power level and sound pressure level. Measured sound power level will be the sum of sound pressure level due to equipment plus the distance factor. Use 10 meters (30 feet) for sound level location.
- E. Where measured sound levels exceed specified level, the installing contractor or equipment manufacturer shall take remedial action approved by the COTR and the necessary sound tests shall be repeated.

3.10 MARKING OF SETTINGS

Following approval of Tab final Report, the setting of all HVAC adjustment devices including valves, splitters and dampers shall be permanently marked by the TAB Specialist so that adjustment can be restored if disturbed at any time. Style and colors used for markings shall be coordinated with the COTR.

3.11 IDENTIFICATION OF TEST PORTS

The TAB Specialist shall permanently and legibly identify the location points of duct test ports. If the ductwork has exterior insulation, the identification shall be made on the exterior side of the insulation. All penetrations through ductwork and ductwork insulation shall be sealed to prevent air leaks and maintain integrity of vapor barrier.

- - - E N D - - -

SECTION 23 07 11
HVAC, PLUMBING, AND BOILER PLANT INSULATION

PART 1 - GENERAL

1.1 DESCRIPTION

- A. Field applied insulation for thermal efficiency and condensation control for
 - 1. HVAC piping, ductwork and equipment.
 - 2. Plumbing piping and equipment.
- B. Definitions
 - 1. ASJ: All service jacket, white finish facing or jacket.
 - 2. Air conditioned space: Space having air temperature and/or humidity controlled by mechanical equipment.
 - 3. Cold: Equipment, ductwork or piping handling media at design temperature of 16 degrees C (60 degrees F) or below.
 - 4. Concealed: Ductwork and piping above ceilings and in chases, interstitial space, and pipe spaces.
 - 5. Exposed: Piping, ductwork, and equipment exposed to view in finished areas including mechanical, Boiler Plant and electrical equipment rooms or exposed to outdoor weather. Attics and crawl spaces where air handling units are located are considered to be mechanical rooms. Shafts, chases, interstitial spaces, are not considered finished areas.
 - 6. FSK: Foil-scrim-kraft facing.
 - 7. Hot: HVAC Ductwork handling air at design temperature above 16 degrees C (60 degrees F); HVAC and plumbing equipment or piping handling media above 41 degrees C (105 degrees F); and piping media and equipment 32 to 230 degrees C (90 to 450 degrees F)
 - 8. Density: kg/m^3 - kilograms per cubic meter (Pcf - pounds per cubic foot).
 - 9. Runouts: Branch pipe connections up to 25-mm (one-inch) nominal size to fan coil units or reheat coils for terminal units.
 - 10. Thermal conductance: Heat flow rate through materials.
 - a. Flat surface: Watt per square meter (BTU per hour per square foot).
 - b. Pipe or Cylinder: Watt per square meter (BTU per hour per linear foot).

11. Thermal Conductivity (k): Watt per meter, per degree C (BTU per inch thickness, per hour, per square foot, per degree F temperature difference).
12. MPS: Medium pressure steam (110 kPa [16 psig] thru 414 kPa [59 psig]).
13. MPR: Medium pressure steam condensate return.
14. LPS: Low pressure steam (103 kPa [15 psig] and below).
15. LPR: Low pressure steam condensate gravity return.
16. PC: Pumped condensate.
17. HWH: Hot water heating supply.
18. HWHR: Hot water heating return.
19. CTPD: Condensate transfer pump discharge.
20. CTPS: Condensate transfer pump suction.
21. CPD: Condensate pump discharge.
22. R: Pump recirculation.
23. CW: Cold water.
24. SW: Soft water.
25. HW: Hot water.
26. CH: Chilled water supply.
27. CHR: Chilled water return.
28. RS: Refrigerant suction.
29. PVDC: Polyvinylidene chloride vapor retarder jacketing, white.

1.2 RELATED WORK

- A. Section 07 84 00, FIRESTOPPING: Mineral fiber and bond breaker behind sealant.
- B. Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION: General mechanical requirements and items, which are common to more than one section of Division 23.
- C. Section 22 05 19, METERS AND GAGES FOR PLUMBING PIPING and Section 22 05 23, GENERAL-DUTY VALVES FOR PLUMBING PIPING: Hot and cold water piping.
- D. Section 23 64 00, PACKAGED WATER CHILLERS: Compressor, evaporator and piping.
- E. Section 23 23 00, REFRIGERANT PIPING: Requirements for refrigerant piping and fittings.
- F. Section 23 21 13, HYDRONIC PIPING and Section 23 22 13, STEAM AND CONDENSATE HEATING PIPING: Piping and equipment.
- G. Section 23 21 13, HYDRONIC PIPING: Chilled water piping.

H. Section 23 31 00, HVAC DUCTS AND CASINGS: Ductwork, plenum and fittings.

1.3 QUALITY ASSURANCE

A. Refer to article QUALITY ASSURANCE, in Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION.

B. Criteria:

1. Comply with NFPA 90A, particularly paragraphs 4.3.3.1 through 4.3.3.6, 4.3.10.2.6, and 5.4.6.4, parts of which are quoted as follows:

4.3.3.1 Pipe insulation and coverings, duct coverings, duct linings, vapor retarder facings, adhesives, fasteners, tapes, and supplementary materials added to air ducts, plenums, panels, and duct silencers used in duct systems, unless otherwise provided for in 4.3.3.1.2 or 4.3.3.1.3, shall have, in the form in which they are used, a maximum flame spread index of 25 without evidence of continued progressive combustion and a maximum smoke developed index of 50 when tested in accordance with NFPA 255, *Standard Method of Test of Surface Burning Characteristics of Building Materials*.

4.3.3.1.1 Where these products are to be applied with adhesives, they shall be tested with such adhesives applied, or the adhesives used shall have a maximum flame spread index of 25 and a maximum smoke developed index of 50 when in the final dry state. (See 4.2.4.2.)

4.3.3.1.2 The flame spread and smoke developed index requirements of 4.3.3.1.1 shall not apply to air duct weatherproof coverings where they are located entirely outside of a building, do not penetrate a wall or roof, and do not create an exposure hazard.

4.3.3.1.3 Smoke detectors required by 6.4.4 shall not be required to meet flame spread index or smoke developed index requirements.

4.3.3.2 Closure systems for use with rigid and flexible air ducts tested in accordance with UL 181, Standard for Safety Factory-Made Air Ducts and Air Connectors, shall have been tested, listed, and used in accordance with the conditions of their listings, in accordance with one of the following:

(1) UL 181A, Standard for Safety Closure Systems for Use with Rigid Air Ducts and Air Connectors

(2) UL 181B, Standard for Safety Closure Systems for Use with Flexible Air Ducts and Air Connectors

4.3.3.3 Air duct, panel, and plenum coverings and linings, and pipe insulation and coverings shall not flame, glow, smolder, or smoke when tested in accordance with a similar test for pipe covering, ASTM C 411, Standard Test Method for Hot-Surface Performance of High-Temperature Thermal Insulation, at the temperature to which they are exposed in service.

4.3.3.3.1 In no case shall the test temperature be below 121°C (250°F).

4.3.3.4 Air duct coverings shall not extend through walls or floors that are required to be fire stopped or required to have a fire resistance rating, unless such coverings meet the requirements of 5.4.6.4.

4.3.3.5* Air duct linings shall be interrupted at fire dampers to prevent interference with the operation of devices.

4.3.3.6 Air duct coverings shall not be installed so as to conceal or prevent the use of any service opening.

4.3.10.2.6 Materials exposed to the airflow shall be noncombustible or limited combustible and have a maximum smoke developed index of 50 or comply with the following.

4.3.10.2.6.1 Electrical wires and cables and optical fiber cables shall be listed as noncombustible or limited combustible and have a maximum smoke developed index of 50 or shall be listed as having a maximum peak optical density of 0.5 or less, an average optical density of 0.15 or less, and a maximum flame spread distance of 1.5 m (5 ft) or less when tested in accordance with NFPA 262, Standard Method of Test for Flame Travel and Smoke of Wires and Cables for Use in Air-Handling Spaces.

4.3.10.2.6.3 Nonferrous fire sprinkler piping shall be listed as having a maximum peak optical density of 0.5 or less, an average optical density of 0.15 or less, and a maximum flame spread distance of 1.5 m (5 ft) or less when tested in accordance with UL 1887, Standard for Safety Fire Test of Plastic Sprinkler Pipe for Visible Flame and Smoke Characteristics.

4.3.10.2.6.4 Optical-fiber and communication raceways shall be listed as having a maximum peak optical density of 0.5 or less, an average optical density of 0.15 or less, and a maximum flame spread distance of 1.5 m (5 ft) or less when tested in accordance with UL 2024, Standard for Safety Optical-Fiber Cable Raceway.

4.3.10.2.6.5 Loudspeakers and recessed lighting fixtures, including their assemblies and accessories, shall be permitted in the ceiling cavity plenum where listed as having a maximum peak optical density of 0.5 or less, an average optical density of 0.15 or less, and a peak heat release rate of 100 kW or less when tested in accordance with UL 2043, Standard for Safety Fire Test for Heat and Visible Smoke Release for Discrete Products and Their Accessories Installed in Air-Handling Spaces.

4.3.10.2.6.6 Supplementary materials for air distribution systems shall be permitted when complying with the provisions of 4.3.3.

4.3.10.2.6.7 Smoke detectors shall not be required to meet the provisions of this section.

5.4.6.4 Where air ducts pass through walls, floors, or partitions that are required to have a fire resistance rating and where fire dampers are not required, the opening in the construction around the air duct shall be as follows:

- (1) Not exceeding a 25.4 mm (1 in.) average clearance on all sides
- (2) Filled solid with an approved material capable of preventing the passage of flame and hot gases sufficient to

ignite cotton waste when subjected to the time-temperature fire conditions required for fire barrier penetration as specified in NFPA 251, *Standard Methods of Tests of Fire Endurance of Building Construction and Materials*

2. Test methods: ASTM E84, UL 723, or NFPA 255.
 3. Specified k factors are at 24 degrees C (75 degrees F) mean temperature unless stated otherwise. Where optional thermal insulation material is used, select thickness to provide thermal conductance no greater than that for the specified material. For pipe, use insulation manufacturer's published heat flow tables. For domestic hot water supply and return, run out insulation and condensation control insulation, no thickness adjustment need be made.
 4. All materials shall be compatible and suitable for service temperature, and shall not contribute to corrosion or otherwise attack surface to which applied in either the wet or dry state.
- C. Every package or standard container of insulation or accessories delivered to the job site for use must have a manufacturer's stamp or label giving the name of the manufacturer and description of the material.

1.4 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Shop Drawings:
 1. All information, clearly presented, shall be included to determine compliance with drawings and specifications and ASTM, federal and military specifications.
 - a. Insulation materials: Specify each type used and state surface burning characteristics.
 - b. Insulation facings and jackets: Each type used. Make it clear that white finish will be furnished for exposed ductwork, casings and equipment.
 - c. Insulation accessory materials: Each type used.
 - d. Manufacturer's installation and fitting fabrication instructions for flexible unicellular insulation.
 - e. Make reference to applicable specification paragraph numbers for coordination.

1.5 STORAGE AND HANDLING OF MATERIAL

Store materials in clean and dry environment, pipe covering jackets shall be clean and unmarred. Place adhesives in original containers. Maintain ambient temperatures and conditions as required by printed instructions of manufacturers of adhesives, mastics and finishing cements.

1.6 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by basic designation only.
- B. Federal Specifications (Fed. Spec.):
 - L-P-535E (2)-91.....Plastic Sheet (Sheeting): Plastic Strip; Poly (Vinyl Chloride) and Poly (Vinyl Chloride - Vinyl Acetate), Rigid.
- C. Military Specifications (Mil. Spec.):
 - MIL-A-3316C (2)-90.....Adhesives, Fire-Resistant, Thermal Insulation
 - MIL-A-24179A (1)-87.....Adhesive, Flexible Unicellular-Plastic Thermal Insulation
 - MIL-C-19565C (1)-88.....Coating Compounds, Thermal Insulation, Fire-and Water-Resistant, Vapor-Barrier
 - MIL-C-20079H-87.....Cloth, Glass; Tape, Textile Glass; and Thread, Glass and Wire-Reinforced Glass
- D. American Society for Testing and Materials (ASTM):
 - A167-99.....Standard Specification for Stainless and Heat-Resisting Chromium-Nickel Steel Plate, Sheet, and Strip
 - B209-04.....Standard Specification for Aluminum and Aluminum-Alloy Sheet and Plate
 - C411-97.....Standard test method for Hot-Surface Performance of High-Temperature Thermal Insulation
 - C449-00.....Standard Specification for Mineral Fiber Hydraulic-Setting Thermal Insulating and Finishing Cement
 - C533-04.....Standard Specification for Calcium Silicate Block and Pipe Thermal Insulation

- C534-05.....Standard Specification for Preformed Flexible
Elastomeric Cellular Thermal Insulation in
Sheet and Tubular Form
- C547-06.....Standard Specification for Mineral Fiber pipe
Insulation
- C552-03.....Standard Specification for Cellular Glass
Thermal Insulation
- C553-02.....Standard Specification for Mineral Fiber
Blanket Thermal Insulation for Commercial and
Industrial Applications
- C585-90.....Standard Practice for Inner and Outer Diameters
of Rigid Thermal Insulation for Nominal Sizes
of Pipe and Tubing (NPS System) R (1998)
- C612-04.....Standard Specification for Mineral Fiber Block
and Board Thermal Insulation
- C1126-04.....Standard Specification for Faced or Unfaced
Rigid Cellular Phenolic Thermal Insulation
- C1136-06.....Standard Specification for Flexible, Low
Permeance Vapor Retarders for Thermal
Insulation
- D1668-97a (2006).....Standard Specification for Glass Fabrics (Woven
and Treated) for Roofing and Waterproofing
- E84-06.....Standard Test Method for Surface Burning
Characteristics of Building
Materials
- E119-05a.....Standard Test Method for Fire Tests of Building
Construction and Materials
- E136-04.....Standard Test Methods for Behavior of Materials
in a Vertical Tube Furnace at 750 degrees C
(1380 F)
- E. National Fire Protection Association (NFPA):
- 90A-02.....Installation of Air Conditioning and
Ventilating Systems
- 96-04.....Standards for Ventilation Control and Fire
Protection of Commercial Cooking Operations
- 101-06.....Life Safety Code
- 251-06.....Standard methods of Tests of Fire Endurance of
Building Construction Materials

- 255-06.....Standard Method of tests of Surface Burning
Characteristics of Building Materials
- F. Underwriters Laboratories, Inc (UL):
- 723.....UL Standard for Safety Test for Surface Burning
Characteristics of Building Materials with
Revision of 08/03
- G. Manufacturer's Standardization Society of the Valve and Fitting
Industry (MSS):
- SP58-2002.....Pipe Hangers and Supports Materials, Design,
and Manufacture

PART 2 - PRODUCTS

2.1 MINERAL FIBER

- A. ASTM C612 (Board, Block), Class 1 or 2, $k = 0.037$ Watt per meter, per degree C (0.26), external insulation for temperatures up to 204 degrees C (400 degrees F).
- B. ASTM C553 (Blanket, Flexible) Type I, Class B-3, Density 16 kg/m^3 (1 pcf), $k = 0.045$ (0.31).
- C. ASTM C547 (Pipe Fitting Insulation and Preformed Pipe Insulation), Class 1, $k = 0.037$ (0.26) for use at temperatures 230 degrees C (450 degrees F).

2.2 MINERAL WOOL OR REFRACTORY FIBER

- A. Comply with Standard ASTM C612, Class 3, 450 degrees C (850 degrees F).

2.3 RIGID CELLULAR PHENOLIC FOAM

- A. Preformed (molded) pipe insulation, ASTM C1126, type III, grade 1, $k = 0.021$ (0.15), for temperatures up to 121 degrees C (250 degrees F) with vapor retarder and all service jacket with polyvinyl chloride premolded fitting covering.
- B. Equipment and Duct Insulation, ASTM C 1126, type II, grade 1, $k = 0.021$ (0.15), for temperatures up to 121 degrees C (250 degrees F) with rigid cellular phenolic insulation and covering, vapor retarder and all service jacket.

2.4 CELLULAR GLASS CLOSED-CELL

- A. Comply with Standard ASTM C177, C518, density 120 kg/m^3 (7.5 pcf) nominal, $k = 0.033$ (0.29) at 0 degrees C (75 degrees F).
- B. Pipe insulation for temperatures up to 200 degrees C (400 degrees F).

2.5 POLYISOCYANURATE CLOSED-CELL RIGID

- A. Preformed (fabricated) pipe insulation, ASTM C591, type IV, $K=0.027$ (0.19), for use at temperatures up to 149 degree C (300 degree

F) with factory applied PVDC or all service jacket vapor retarder with polyvinyl chloride premolded fitting covers.

- B. Equipment and duct insulation, ASTM C 591, type IV, $K=0.027(0.19)$, for use at temperatures up to 149 degrees C (300 degrees F) with PVDC or all service jacket vapor retarder jacket.

2.6 FLEXIBLE ELASTOMERIC CELLULAR THERMAL

- A. ASTM C177, C518, $k = 0.039$ Watt per meter, per degree C (0.27), at 24 degrees C (75 degrees F), flame spread not over 25, smoke developed not over 50, for temperatures from minus 4 degrees C (40 degrees F) to 93 degrees C (200 degrees F). No jacket required.

2.7 CALCIUM SILICATE

- A. Preformed pipe Insulation: ASTM C533, Type I and Type II with indicator denoting asbestos-free material.
- B. Premolded Pipe Fitting Insulation: ASTM C533, Type I and Type II with indicator denoting asbestos-free material.
- C. Equipment Insulation: ASTM C533, Type I and Type II
- D. Characteristics:

Insulation Characteristics		
ITEMS	TYPE I	TYPE II
Temperature, maximum degrees C (degrees F)	649 (1200)	927 (1700)
Density (dry), Kg/m^3 (lb/ ft ³)	232 (14.5)	288 (18)
Thermal conductivity: Min W/ m K (Btu in/h ft ² degrees F)@ mean temperature of 93 degrees C (200 degrees F)	0.059 (0.41)	0.078 (0.540)
Surface burning characteristics:		
Flame spread Index, Maximum	0	0
Smoke Density index, Maximum	0	0

2.8 INSULATION FACINGS AND JACKETS

- A. Vapor Retarder, higher strength with low water permeance ≤ 0.02 or less perm rating, Beach puncture 50 units for insulation facing on exposed ductwork, casings and equipment, and for pipe insulation jackets. Facings and jackets shall be all service type (ASJ) or PVDC Vapor Retarder jacketing.

- B. ASJ jacket shall be white kraft bonded to 0.025 mm (1 mil) thick aluminum foil, fiberglass reinforced, with pressure sensitive adhesive closure. Comply with ASTM C1136. Beach puncture 5 units, Suitable for painting without sizing. Jackets shall have minimum 40 mm (1-1/2 inch) lap on longitudinal joints and minimum 100 mm (4 inch) butt strip on end joints. Butt strip material shall be same as the jacket. Lap and butt strips shall be self-sealing type with factory-applied pressure sensitive adhesive.
- C. Vapor Retarder medium strength with low water vapor permeance of 0.02 or less perm rating), Beach puncture 25 units: Foil-Scrim-Kraft (FSK) or PVDC vapor retarder jacketing type for concealed ductwork and equipment.
- D. Glass Cloth Jackets: Presized, minimum 0.18 kg per square meter (7.8 ounces per square yard), 2000 kPa (300 psig) bursting strength with integral vapor retarder where required or specified. Weather proof if utilized for outside service.
- E. Factory composite materials may be used provided that they have been tested and certified by the manufacturer.
- F. Pipe fitting insulation covering (jackets): Fitting covering shall be premolded to match shape of fitting and shall be polyvinyl chloride (PVC) conforming to Fed Spec L-P-335, composition A, Type II Grade GU, and Type III, minimum thickness 0.7 mm (0.03 inches). Provide color matching vapor retarder pressure sensitive tape.
- G. Aluminum Jacket-Piping systems: ASTM B209, 3003 alloy, H-14 temper, 0.6 mm (0.023 inch) minimum thickness with locking longitudinal joints. Jackets for elbows, tees and other fittings shall be factory-fabricated to match shape of fitting and of 0.6 mm (0.024) inch minimum thickness aluminum. Fittings shall be of same construction as straight run jackets but need not be of the same alloy. Factory-fabricated stainless steel bands shall be installed on all circumferential joints. Bands shall be 20 mm (0.75 inch) wide on 450 mm (18 inch) centers. System shall be weatherproof if utilized for outside service.

2.9 PIPE COVERING PROTECTION SADDLES

- A. Cold pipe support: Premolded pipe insulation 180 degrees (half-shells) on bottom half of pipe at supports. Material shall be cellular glass or high density Polyisocyanurate insulation of the same thickness as adjacent insulation. Density of Polyisocyanurate insulation shall be a minimum of 48 kg/m³ (3.0 pcf).

Nominal Pipe Size and Accessories Material (Insert Blocks)	
Nominal Pipe Size mm (inches)	Insert Blocks mm (inches)
Up through 125 (5)	150 (6) long
150 (6)	150 (6) long
200 (8), 250 (10), 300 (12)	225 (9) long
350 (14), 400 (16)	300 (12) long
450 through 600 (18 through 24)	350 (14) long

B. Warm or hot pipe supports: Premolded pipe insulation (180 degree half-shells) on bottom half of pipe at supports. Material shall be high density Polyisocyanurate (for temperatures up to 149 degrees C [300 degrees F]), cellular glass or calcium silicate. Insulation at supports shall have same thickness as adjacent insulation. Density of Polyisocyanurate insulation shall be a minimum of 48 kg/m³ (3.0 pcf).

2.10 ADHESIVE, MASTIC, CEMENT

- A. Mil. Spec. MIL-A-3316, Class 1: Jacket and lap adhesive and protective finish coating for insulation.
- B. Mil. Spec. MIL-A-3316, Class 2: Adhesive for laps and for adhering insulation to metal surfaces.
- C. Mil. Spec. MIL-A-24179, Type II Class 1: Adhesive for installing flexible unicellular insulation and for laps and general use.
- D. Mil. Spec. MIL-C-19565, Type I: Protective finish for outdoor use.
- E. Mil. Spec. MIL-C-19565, Type I or Type II: Vapor barrier compound for indoor use.
- F. ASTM C449: Mineral fiber hydraulic-setting thermal insulating and finishing cement.
- G. Other: Insulation manufacturers' published recommendations.

2.12 MECHANICAL FASTENERS

- A. Pins, anchors: Welded pins, or metal or nylon anchors with tin-coated or fiber washer, or clips. Pin diameter shall be as recommended by the insulation manufacturer.
- B. Staples: Outward clinching monel or stainless steel.
- C. Wire: 1.3 mm thick (18 gage) soft annealed galvanized or 1.9 mm (14 gage) copper clad steel or nickel copper alloy.
- D. Bands: 20 mm (3/4 inch) nominal width, brass, galvanized steel, aluminum or stainless steel.

2.13 REINFORCEMENT AND FINISHES

- A. Glass fabric, open weave: ASTM D1668, Type III (resin treated) and Type I (asphalt treated).
- B. Glass fiber fitting tape: Mil. Spec MIL-C-20079, Type II, Class 1.
- C. Tape for Flexible Elastomeric Cellular Insulation: As recommended by the insulation manufacturer.
- D. Hexagonal wire netting: 25 mm (one inch) mesh, 0.85 mm thick (22 gage) galvanized steel.
- E. Corner beads: 50 mm (2 inch) by 50 mm (2 inch), 0.55 mm thick (26 gage) galvanized steel; or, 25 mm (1 inch) by 25 mm (1 inch), 0.47 mm thick (28 gage) aluminum angle adhered to 50 mm (2 inch) by 50 mm (2 inch) Kraft paper.
- F. PVC fitting cover: Fed. Spec L-P-535, Composition A, 11-86 Type II, Grade GU, with Form B Mineral Fiber insert, for media temperature 4 degrees C (40 degrees F) to 121 degrees C (250 degrees F). Below 4 degrees C (40 degrees F) and above 121 degrees C (250 degrees F). Provide double layer insert. Provide color matching vapor barrier pressure sensitive tape.

2.14 FIRESTOPPING MATERIAL

Other than pipe and duct insulation, refer to Section 07 84 00
FIRESTOPPING.

2.15 FLAME AND SMOKE

Unless shown otherwise all assembled systems shall meet flame spread 25 and smoke developed 50 rating as developed under ASTM, NFPA and UL standards and specifications. See paragraph 1.3 "Quality Assurance".

PART 3 - EXECUTION**3.1 GENERAL REQUIREMENTS**

- A. Required pressure tests of duct and piping joints and connections shall be completed and the work approved by the Resident Engineer for application of insulation. Surface shall be clean and dry with all foreign materials, such as dirt, oil, loose scale and rust removed.
- B. Except for specific exceptions, insulate entire specified equipment, piping (pipe, fittings, valves, accessories), and duct systems. Insulate each pipe and duct individually. Do not use scrap pieces of insulation where a full length section will fit.
- C. Where removal of insulation of piping, ductwork and equipment is required to comply with Section 02 82 11, TRADITIONAL ASBESTOS

- ABATEMENT and Section 02 82 13.13, GLOVEBAG ASBESTOS ABATEMENT, such areas shall be reinsulated to comply with this specification.
- D. Insulation materials shall be installed in a first class manner with smooth and even surfaces, with jackets and facings drawn tight and smoothly cemented down at all laps. Insulation shall be continuous through all sleeves and openings, except at fire dampers and duct heaters (NFPA 90A). Vapor retarders shall be continuous and uninterrupted throughout systems with operating temperature 16 degrees C (60 degrees F) and below. Lap and seal vapor barrier over ends and exposed edges of insulation. Anchors, supports and other metal projections through insulation on cold surfaces shall be insulated and vapor sealed for a minimum length of 150 mm (6 inches).
- E. Install vapor stops at all insulation terminations on either side of valves, pumps and equipment and particularly in straight lengths of pipe insulation.
- F. Construct insulation on parts of equipment such as chilled water pumps, convertors and heat exchangers that must be opened periodically for maintenance or repair, so insulation can be removed and replaced without damage. Install insulation with bolted 1 mm thick (20 gage) galvanized steel or aluminum covers as complete units, or in sections, with all necessary supports, and split to coincide with flange/split of the equipment.
- G. Insulation on hot piping and equipment shall be terminated square at items not to be insulated, access openings and nameplates. Cover all exposed raw insulation with white sealer or jacket material.
- H. Protect all insulations outside of buildings with aluminum jacket using lock joint or other approved system for a continuous weather tight system. Access doors and other items requiring maintenance or access shall be removable and sealable.
- I. HVAC work not to be insulated:
1. Internally insulated ductwork and air handling units.
 2. Relief air ducts (Economizer cycle exhaust air).
 3. Exhaust air ducts and plenums.
 4. Equipment: Expansion tanks, flash tanks, hot water pumps, steam condensate pumps.
 5. In hot piping: Unions, flexible connectors, control valves, PRVs, safety valves and discharge vent piping, vacuum breakers, thermostatic vent valves, steam traps 20 mm (3/4 inch) and smaller,

exposed piping through floor for convectors and radiators. Insulate piping to within approximately 75 mm (3 inches) of uninsulated items.

J. Plumbing work not to be insulated:

1. Piping and valves of fire protection system.
2. Chromium plated brass piping.
3. Water piping in contact with earth.
4. Small horizontal cold water branch runs in partitions to individual fixtures may be without insulation for maximum distance of 900 mm (3 feet).
5. Distilled water piping.

K. Boiler plant work not to be insulated:

1. Equipment:

- a. Condensate return pump units
- b. Pumps-inlet to outlet
- c. Flash tanks
- d. Safety valves
- e. Water meters
- f. Oil meters
- g. Air compressors and tanks
- h. Refrigerated or desiccant air drier
- i. Chemical feeders
- j. All nameplates

4. Specialties:

- a. Pressure reducing valves
- b. Control valves-water and steam
- c. Level sensors-piping, valves and blowdown
- d. Back pressure regulators-steam
- e. Strainers under 65 mm (2-1/2 inch) pipe size
- f. Expansion bellows
- g. Flexible connectors
- h. Ball joints except piping between joints

L. Apply insulation materials subject to the manufacturer's recommended temperature limits. Apply adhesives, mastic and coatings at the manufacturer's recommended minimum coverage.

M. Elbows, flanges and other fittings shall be insulated with the same material as is used on the pipe straights. The elbow/ fitting insulation shall be field-fabricated, mitered or factory prefabricated

to the necessary size and shape to fit on the elbow/ fitting. Use of polyurethane spray-foam to fill a PVC elbow jacket is prohibited on cold applications.

N. Firestop Pipe and Duct insulation:

1. Provide firestopping insulation at fire and smoke barriers through penetrations. Fire stopping insulation shall be UL listed as defines in Section 07 84 00, FIRESTOPPING.
2. Pipe and duct penetrations requiring fire stop insulation including, but not limited to the following:
 - a. Pipe risers through floors
 - b. Pipe or duct chase walls and floors
 - c. Smoke partitions
 - d. Fire partitions

O. Freeze protection of above grade outdoor piping (over heat tracing tape): 20 mm (0.75) thick insulation, for all pipe sizes 75 mm(3 inches) and smaller and 25 mm(1inch) thick insulation for larger pipes. Provide metal jackets for all pipes. Provide for and chilled water piping as described in Section 23 21 13, HYDRONIC PIPING (electrical heat tracing systems).

P. Provide metal jackets over insulation as follows:

- a. All piping and ducts exposed to outdoor weather.
- b. A 50 mm (2 inch) overlap is required at longitudinal and circumferential joints.

3.2 INSULATION INSTALLATION

A. Mineral Fiber Board:

1. Faced board: Apply board on pins spaced not more than 300 mm (12 inches) on center each way, and not less than 75 mm (3 inches) from each edge of board. In addition to pins, apply insulation bonding adhesive to entire underside of horizontal metal surfaces. Butt insulation edges tightly and seal all joints with laps and butt strips. After applying speed clips cut pins off flush and apply vapor seal patches over clips.
2. Plain board:
 - a. Insulation shall be scored, beveled or mitered to provide tight joints and be secured to equipment with bands spaced 225 mm (9 inches) on center for irregular surfaces or with pins and clips on flat surfaces. Use corner beads to protect edges of insulation.

- b. For hot equipment: Stretch 25 mm (1 inch) mesh wire, with edges wire laced together, over insulation and finish with insulating and finishing cement applied in one coat, 6 mm (1/4 inch) thick, trowel led to a smooth finish.
 - c. For cold equipment: Apply meshed glass fabric in a tack coat 1.5 to 1.7 square meter per liter (60 to 70 square feet per gallon) of vapor mastic and finish with mastic at 0.3 to 0.4 square meter per liter (12 to 15 square feet per gallon) over the entire fabric surface.
 - d. Chilled water pumps: Insulate with removable and replaceable 1 mm thick (20 gage) aluminum or galvanized steel covers lined with insulation. Seal closure joints/flanges of covers with gasket material. Fill void space in enclosure with flexible mineral fiber insulation.
 - 3. Exposed, unlined ductwork and equipment in unfinished areas, mechanical and electrical equipment rooms and attics, and duct work exposed to outdoor weather:
 - a. 40 mm (1-1/2 inch) thick insulation faced with ASJ (white all service jacket): Supply air duct.
 - b. 25 mm (1 inch) thick insulation faced with ASJ: Return air duct, mixed air plenums.
 - c. Outside air intake ducts: 25 mm (one inch) thick insulation faced with ASJ.
 - 4. Cold equipment: 40 mm (1-1/2 inch) thick insulation faced with ASJ.
 - a. Chilled water pumps, water filter, chemical feeder pot or tank.
 - b. Cold storage water tanks.
 - 5. Hot equipment: 40 mm (1-1/2 inch) thick insulation faced with ASJ.
 - a. Convertors, air separators, steam condensate pump receivers.
 - b. Reheat coil casing and separation chambers on steam humidifiers located above ceilings.
 - c. Domestic water heaters and hot water storage tanks (not factory insulated).
- B. Flexible Mineral Fiber Blanket:
- 1. Adhere insulation to metal with 100 mm (4 inch) wide strips of insulation bonding adhesive at 200 mm (8 inches) on center all around duct. Additionally secure insulation to bottom of ducts exceeding 600 mm (24 inches) in width with pins welded or adhered on 450 mm (18 inch) centers. Secure washers on pins. Butt insulation

edges and seal joints with laps and butt strips. Staples may be used to assist in securing insulation. Seal all vapor retarder penetrations with mastic. Sagging duct insulation will not be acceptable. Install firestop duct insulation where required.

2. Supply air ductwork to be insulated includes main and branch ducts from AHU discharge to room supply outlets, and the bodies of ceiling outlets to prevent condensation. Insulate sound attenuator units, coil casings and damper frames. To prevent condensation insulate trapeze type supports and angle iron hangers for flat oval ducts that are in direct contact with metal duct.
 3. Concealed supply air ductwork.
 - a. Above ceilings at a roof level: 50 mm (2 inch) thick insulation faced with FSK.
 - b. Above ceilings for other than roof level: 40 mm (1 ½ inch) thick insulation faced with FSK.
 4. Concealed return air duct above ceilings at a roof level, unconditioned areas, and in chases with external wall or containing steam piping; 40 mm (1-1/2 inch) thick, insulation faced with FSK. Concealed return air ductwork in other locations need not be insulated.
 5. Return air duct in interstitial spaces: 40 mm (1-1/2 inch thick insulation faced with FSK.
 6. Concealed outside air duct: 40 mm (1-1/2 inch) thick insulation faced with FSK.
- C. Molded Mineral Fiber Pipe and Tubing Covering:
1. Fit insulation to pipe or duct, aligning longitudinal joints. Seal longitudinal joint laps and circumferential butt strips by rubbing hard with a nylon sealing tool to assure a positive seal. Staples may be used to assist in securing insulation. Seal all vapor retarder penetrations on cold piping with a generous application of vapor barrier mastic. Provide inserts and install with metal insulation shields at outside pipe supports. Install freeze protection insulation over heating cable.
 2. Contractor's options for fitting, flange and valve insulation:
 - a. Insulating and finishing cement for sizes less than 100 mm (4 inches) operating at surface temperature of 16 degrees C (61 degrees F) or more.

- b. Factory premolded, one piece PVC covers with mineral fiber, (Form B), inserts. Provide two insert layers for pipe temperatures below 4 degrees C (40 degrees F), or above 121 degrees C (250 degrees F). Secure first layer of insulation with twine. Seal seam edges with vapor barrier mastic and secure with fitting tape.
- c. Factory molded, ASTM C547 or field mitered sections, joined with adhesive or wired in place. For hot piping finish with a smoothing coat of finishing cement. For cold fittings, 16 degrees C (60 degrees F) or less, vapor seal with a layer of glass fitting tape imbedded between two 2 mm (1/16 inch) coats of vapor barrier mastic.
- d. Fitting tape shall extend over the adjacent pipe insulation and overlap on itself at least 50 mm (2 inches).
3. Nominal thickness in millimeters and inches specified in table below, for piping above ground:

Nominal Thickness of Molded Mineral Fiber Insulation				
Nominal Pipe Size, millimeters (inches):	25 (1) & below	32- 75 (1-1/4- 3)	100-150 (4-6)	200 (8) and above
a. 122-177 degrees C (251-350 F) (HPS, MPS,)	50 (2.0)	65 (2.5)	90 (3.5)	90 (3.5)
b. 100-121 degrees C HPR, MPR (212-250 degrees F) (Vent piping from PRV safety valves, condensate receivers, and flash tanks)	25 (1.0)	50 (2.0)	50 (2.0)	50 (2.0)
c. 38-99 degrees C (100- 211 degrees F) (LPR, PC, HWH, HWHR, GH, GHR)	25 (1.0)	40 (1.5)	50 (2.0)	50 (2.0)
1. Runouts to fan coil units //	15 (0.5)	-	-	-

Nominal Thickness of Molded Mineral Fiber Insulation				
Nominal Pipe Size, millimeters (inches):	25 (1) & below	32- 75 (1-1/4- 3)	100-150 (4-6)	200 (8) and above
2. Runouts to // reheat coils // air terminal unit reheat coils //	15 (0.5)	-	-	-
d. Domestic hot water supply and return	15 (0.5)	20 (0.75)	25 (1.0)	40 (1.5)

D. Rigid Cellular Phenolic Foam:

1. Rigid closed cell phenolic insulation may be provided for piping, ductwork and equipment for temperatures up to 121 degrees C (250 degrees F).
2. Note the NFPA 90A burning characteristics requirements of 25/50 in paragraph 1.3.B
3. Provide secure attachment facilities such as welding pins.
4. Apply insulation with joints tightly drawn together
5. Apply adhesives, coverings, neatly finished at fittings, and valves.
6. Final installation shall be smooth, tight, neatly finished at all edges.
7. Minimum thickness in millimeters (inches) specified in table below, for piping above ground:

Nominal Thickness of Rigid Closed-Cell Phenolic Foam Insulation					
Nominal Pipe Size millimeters (inches):	25 (1) & below	32-75 (1 1/4-3)	100-150 (4-6)	200-300 (8-12)	350 (14) & above
1. 100-121 degrees C (212-250 degrees F), LPS, Vent piping from receivers and flash tanks.	15 (0.5)	25 (1)	25 (1)	--	--
2. 38-99 degrees C (100- 211 degrees F), LPR, PC, HWH, HWHR, GH and GHR.	15 (0.5)	20 (0.75)	25 (1)	--	--
a. // Run outs to Fan Coil units // reheat coils //.	15 (0.5)	--	--	--	--

Nominal Thickness of Rigid Closed-Cell Phenolic Foam Insulation					
Nominal Pipe Size millimeters (inches):	25 (1) & below	32-75 (1 1/4-3)	100-150 (4-6)	200-300 (8-12)	350 (14) & above
3. 4-16 degrees C (40-60 degrees F), CH, CHR, GC, and GCR.	20 (0.75)	20 (0.75)	25 (1)	40 (1.5)	50 (2.0)
//a.Run outs to Fan Coil Units //.	15 (0.5)	--	--	--	--
//b.Ice Water Piping //	15 (0.5)	20 (0.75)	25 (1)	--	--
4. 10 degrees C (50 degrees F) and less, RS for DX refrigerants.	15 (0.5)	20 (0.75)	--	--	--
5. Domestic hot water supply and return.	15 (0.5)	15 (0.5)	20 (0.75)	20 (0.75)	--

8. Condensation control insulation: Minimum 20 mm (0.75 inch) thick for all pipe sizes.

a. HVAC: Cooling coil condensation piping to waste piping fixture or drain inlet. Omit insulation on plastic piping in mechanical rooms.

b. Plumbing piping as follows:

- 1) Body of roof and overflow drains horizontal runs and offsets (including elbows) of interior downspout piping in all areas above pipe basement.
- 2) Waste piping from electric water coolers and icemakers to drainage system.
- 3) Waste piping located above basement floor from ice making and film developing equipment and air handling units, from fixture (including trap) to main vertical waste pipe.
- 4) Cold water piping.

E. Cellular Glass Insulation:

1. Pipe and tubing, covering nominal thickness in millimeters and inches as tabulated below for chilled water and refrigerant piping.

Nominal Thickness of Cellular Glass Insulation				
Millimeters (inches)	Thru 38 (1 1/2)	50- 150 (2-6)	200-300 (8-12)	over 350 (14)
1. 4-16 degrees C (40-60 degrees F) (CH and CHR within chiller room and pipe chase and underground)	50 (2.0)	80 (3.0)	80 (3.0)	100 (4.0)
2. 4-16 degrees C (40-60 degrees F) (CH and CHR outside chiller room)	40 (1.5)	50 (2.0)	50 (2.0)	65 (2.5)

2. Underground Piping Other than or in lieu of that Specified in Section 23 21 13, HYDRONIC PIPING: Type II, factory jacketed with a 3 mm laminate jacketing consisting of 3000 mm x 3000 mm (10 ft x 10 ft) asphalt impregnated glass fabric, bituminous mastic and outside protective plastic film.
 - a. 75 mm (3 inches) thick for hot water piping.
 - b. As tabulated above for chilled water piping.
 - c. Underground piping: Apply insulation with joints tightly butted. Seal longitudinal self-sealing lap. Use field fabricated or factory made fittings. Seal butt joints and fitting with jacketing as recommended by the insulation manufacturer. Use 100 mm (4 inch) wide strips to seal butt joints.
 - d. Provide expansion chambers for pipe loops, anchors and wall penetrations as recommended by the insulation manufacturer.
 - e. Underground insulation shall be inspected and approved by the Resident Engineer as follows:
 - 1) Insulation in place before coating.
 - 2) After coating.
 - f. Sand bed and backfill: Minimum 75 mm (3 inches) all around insulated pipe or tank, applied after coating has dried.
 3. Cold equipment: 50 mm (2 inch) thick insulation faced with ASJ for chilled water pumps, water filters, chemical feeder pots or tanks, expansion tanks, air separators and air purgers.
- F. Polyisocyanurate Closed-Cell Rigid Insulation:
1. Polyisocyanurate closed-cell rigid insulation (PIR) may be provided for piping, equipment and ductwork for temperature up to 149 degree C (300 degree F) provided insulation thickness requirement does not exceed 38 mm (1.5 inches).

2. Install insulation, vapor retarder and jacketing per manufacturer's recommendations. Particular attention should be paid to recommendations for joint staggering, adhesive application, external hanger design, expansion/contraction joint design and spacing and vapor retarder integrity.
3. Install insulation with all joints tightly butted (except expansion joints in hot applications).
4. If insulation thickness exceeds 63 mm (2.5 inches), install as a double layer system with longitudinal (lap) and butt joint staggering as recommended by manufacturer.
5. For cold applications, vapor retarder shall be installed in a continuous manner. No staples, rivets, screws or any other attachment device capable of penetrating the vapor retarder shall be used to attach the vapor retarder or jacketing. No wire ties capable of penetrating the vapor retarder shall be used to hold the insulation in place. Banding shall be used to attach PVC or metal jacketing.
6. Elbows, flanges and other fittings shall be insulated with the same material as is used on the pipe straights. The elbow/ fitting insulation shall be field-fabricated, mitered or factory prefabricated to the necessary size and shape to fit on the elbow/ fitting. Use of polyurethane spray-foam to fill PVC elbow jacket is prohibited on cold applications.
7. For cold applications, the vapor retarder on elbows/fittings shall be either mastic-fabric-mastic or 2 mil thick PVDC vapor retarder adhesive tape.
8. All PVC and metal jacketing shall be installed so as to naturally shed water. Joints shall point down and shall be sealed with either adhesive or caulking (except for periodic slip joints).
9. Underground piping: Follow instructions for above ground piping but the vapor retarder jacketing shall be 6 mil thick PVDC or minimum 30 mil thick rubberized bituminous membrane. Sand bed and backfill shall be a minimum of 150 mm (6 inches) all around insulated pipe.
10. Note the NFPA 90A burning characteristic requirements of 25/50 in paragraph 1.3B. Refer to paragraph 3.1 for items not to be insulated.
11. Minimum thickness in millimeter (inches) specified in table below, for piping:

Nominal Thickness of Polyisocyanurate Rigid Insulation				
Nominal Pipe Size millimeters(inches):	25(1) & below	32-75 (1 1/4- 3)	100-150 (4-6)	200-300 (8-12)
1. 122-149 degree C(251-300 degree F) (HPS, MPS)	40 (1.5)	--	--	--
2. 100-121 degrees C (211-250 degrees F), HPR, MPR, LPS, Vent piping from receivers and flash tanks	20 (0.75)	40(1.5)	40(1.5)	40(1.50)
3. 38-99 degrees C (100-211 degrees F), LPR, PC, HWH, HWHR, GH and GHR a. //Run outs to fan coil units //reheat coils//	20 (0.75) 20 (0.75)	25(1.0) --	40(1.5) --	40(1.50) --
4. 4-16 degrees C (40-60 degrees F), CH, CHR, GC and GCR for relative humidity up to 80 percent or underground location	25 (1.00)	25 (1.0)	40 (1.50)	40(1.5)
//a. Run outs to fan coil units//	20 (0.75)	25 (1.)	--	--
//b. Ice water piping//	25 (1.00)	25 (1.0)	40 (1.5)	--
5. 4-16 degrees C(40-60 degrees F) CH, CHR, GC and GCR for relative humidity 80 to 90 percent or higher	40 (1.50)	40 (1.5)	40 (1.5)	40 (1.5)
//a. Run out to fan coils units//	40 (1.5)	40 (1.5)	--	--
//b. Ice water piping//	40 (1.5)	40 (1.5)	40 (1.5)	--

Nominal Thickness of Polyisocyanurate Rigid Insulation				
6. 10 degrees C (50 degrees F) and less, RS for DX refrigerants	20 (0.75)	25 (1.0)	--	--
7. Domestic hot water supply and return	15 (0.5)	20 (0.74)	25 (1.0)	25(1.0)

12. Condensation control insulation: Minimum 20 mm (0.75 inch) thick for all pipe sizes.
- a. HVAC: Cooling coil condensation piping to waste piping fixture or drain inlet. Omit insulation on plastic piping in mechanical rooms.
 - b. Plumbing piping as follows:
 - 1) Body of roof and overflow drains and horizontal runs and offsets (including elbows) of interior downspout piping in all areas above pipe basement.
 - 2) Waste piping from electric water coolers to drainage system.
 - 3) Waste piping located above basement floor from ice making and film developing equipment and air handling units, from fixture (including trap) to main vertical waste pipe.
 - 4) Cold Water Piping.
- G. Flexible Elastomeric Cellular Thermal Insulation:
1. Apply insulation and fabricate fittings in accordance with the manufacturer's installation instructions and finish with two coats of weather resistant finish as recommended by the insulation manufacturer.
 2. Pipe and tubing insulation:
 - a. Use proper size material. Do not stretch or strain insulation.
 - b. To avoid undue compression of insulation, provide cork stoppers or wood inserts at supports as recommended by the insulation manufacturer. Insulation shields are specified under Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION.
 - c. Where possible, slip insulation over the pipe or tubing prior to connection, and seal the butt joints with adhesive. Where the slip-on technique is not possible, slit the insulation and apply it to the pipe sealing the seam and joints with contact adhesive.

Optional tape sealing, as recommended by the manufacturer, may be employed. Make changes from mineral fiber insulation in a straight run of pipe, not at a fitting. Seal joint with tape.

3. Apply sheet insulation to flat or large curved surfaces with 100 percent adhesive coverage. For fittings and large pipe, apply adhesive to seams only.
4. Pipe insulation: nominal thickness in millimeters (inches as specified in table below for piping above ground:

Nominal Thickness of Flexible Elastomeric Cellular Insulation				
Nominal Pipe Size millimeters (inches)	25 (1) & below	32-75 (1 1/4- 3)	100-150 (4-6)	200 (8)
1. 38-93 degrees C (100-200 degrees F) (HWH, HWHR, GH, GHR)	25 (1.0)	40 (1.5)	-	-
a. Runouts to // fan coil units // reheat coils // air terminal unit reheat coils //	20 (0.75)	40 (1.5)	-	-
2. 4-16 degrees C (40-60 degrees F) (CH, CHR, GC, GCR)	25 (1.0)	40 (1.5)	-	-
a. Runouts to // fan coil units // cooling coil condensate piping //	20 (0.75)	40 (1.5)	-	-
b. // Ice water piping // RS for DX refrigeration //	25 (1.0)	40 (1.5)	-	-
3. Domestic hot water supply and return	15 (0.50)	20 (0.75)	25 (1.0)	40 (1.50)

5. Minimum 20 mm (0.75 inch) thick insulation for pneumatic control lines for a minimum distance of 6 m (20 feet) from discharge side of the refrigerated dryer.
6. Use Class S (Sheet), 20 mm (3/4 inch) thick for the following:
 - a. Chilled water pumps
 - b. Bottom and sides of metal basins for winterized cooling towers (where basin water is heated).

- c. Chillers, insulate any cold chiller surfaces subject to condensation which has not been factory insulated.
- d. Piping inside refrigerators and freezers: Provide heat tape under insulation.

H. Calcium Silicate:

1. Minimum thickness in millimeter (inches) specified below for piping other than in boiler plant. See paragraphs 3.3 through 3.7 for Boiler Plant Applications.

Nominal Thickness Of Calcium Silicate Insulation (Non-Boiler Plant)				
Nominal Pipe Size Millimeters (Inches)	Thru 25 (1)	32 to 75 (1-1/4 to 3)	100-200 (4 to 6)	Over 200 (6)
93-260 degrees C (200- 500 degrees F) (HPS, HPR)	67 (2-1/2)	75 (3)	100 (4)	100 (4)

- - - E N D - - -

SECTION 23 08 00**COMMISSIONING OF HVAC SYSTEMS****PART 1 - GENERAL****1.1 DESCRIPTION**

- A. The requirements of this Section apply to all sections of Division 23.
- B. This project will have selected building systems commissioned. The complete list of equipment and systems to be commissioned are specified in Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS. The commissioning process, which the Contractor is responsible to execute, is defined in Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS. A Commissioning Agent (CxA) appointed by the Department of Veterans Affairs will manage the commissioning process.

1.2 RELATED WORK

- A. Section 01 00 00 GENERAL REQUIREMENTS.
- B. Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS.
- C. Section 01 33 23 SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.

1.3 SUMMARY

- A. This Section includes requirements for commissioning the HVAC systems, subsystems and equipment. This Section supplements the general requirements specified in Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS.
- B. The commissioning activities have been developed to support the VA requirements to meet guidelines for Federal Leadership in Environmental, Energy, and Economic Performance.
- C. Refer to Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS for more specifics regarding processes and procedures as well as roles and responsibilities for all Commissioning Team members.

1.4 DEFINITIONS

- A. Refer to Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS for definitions.

1.5 COMMISSIONED SYSTEMS

- A. Commissioning of a system or systems specified in this Division is part of the construction process. Documentation and testing of these systems, as well as training of the VA's Operation and Maintenance personnel, is required in cooperation with the VA and the Commissioning Agent.
- B. The following HVAC systems will be commissioned:

1. Air Handling Systems (including terminal units)
2. Air Handling Systems (Fans, motors, Variable Speed Drives, cooling coils and control valves, heating coils and control valves, filters, dampers, safeties such as smoke detectors or freezestats and damper end switches, controls, gages, and vibration isolation).
3. Heating Hot Water Systems, heating water pumps and motors, Variable Speed Drives, mixing valves).
4. Condensate Return Systems (Condensate receivers and transfer pumps, motors, controls, pump alternator, alarms and instrumentation, safeties).
5. Chilled Water Systems (Chilled water pumps and motors, Variable Speed Drives, chiller motor/compressor, controls, instrumentation and safeties, isolation valves, blending valves.
6. Exhaust Fans (Fan, motor, controls and safeties).
7. Steam System (Controls, gages and instrumentation, safety relief valves).
8. Direct Digital Control System (BACnet or similar Local Area Network (LAN), Operator Work Station hardware and software, building controller hardware and software, terminal unit controller hardware and software, all sequences of operation, system accuracy and response time).
9. HVAC Water Treatment Systems (Closed circuits - including shot feeders and final water analysis.

1.6 SUBMITTALS

- A. The commissioning process requires review of selected Submittals. The Commissioning Agent will provide a list of submittals that will be reviewed by the Commissioning Agent. This list will be reviewed and approved by the VA prior to forwarding to the Contractor. Refer to Section 01 33 23 SHOP DRAWINGS, PRODUCT DATA, and SAMPLES for further details.
- B. The commissioning process requires Submittal review simultaneously with engineering review. Specific submittal requirements related to the commissioning process are specified in Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS.

PART 2 - PRODUCTS (NOT USED)**PART 3 - EXECUTION****3.1 PRE-FUNCTIONAL CHECKLISTS**

- A. The Contractor shall complete Pre-Functional Checklists to verify systems, subsystems, and equipment installation is complete and systems are ready for Systems Functional Performance Testing. The Commissioning Agent will prepare Pre-Functional Checklists to be used to document equipment installation. The Contractor shall complete the checklists. Completed checklists shall be submitted to the VA and to the Commissioning Agent for review. The Commissioning Agent may spot check a sample of completed checklists. If the Commissioning Agent determines that the information provided on the checklist is not accurate, the Commissioning Agent will return the marked-up checklist to the Contractor for correction and resubmission. If the Commissioning Agent determines that a significant number of completed checklists for similar equipment are not accurate, the Commissioning Agent will select a broader sample of checklists for review. If the Commissioning Agent determines that a significant number of the broader sample of checklists is also inaccurate, all the checklists for the type of equipment will be returned to the Contractor for correction and resubmission. Refer to SECTION 01 91 00 GENERAL COMMISSIONING REQUIREMENTS for submittal requirements for Pre-Functional Checklists, Equipment Startup Reports, and other commissioning documents.

3.2 CONTRACTORS TESTS

- A. Contractor tests as required by other sections of Division 23 shall be scheduled and documented in accordance with Section 01 00 00 GENERAL REQUIREMENTS. The Commissioning Agent will witness selected Contractor tests. Contractor tests shall be completed prior to scheduling Systems Functional Performance Testing.

3.3 SYSTEMS FUNCTIONAL PERFORMANCE TESTING:

- A. The Commissioning Process includes Systems Functional Performance Testing that is intended to test systems functional performance under steady state conditions, to test system reaction to changes in operating conditions, and system performance under emergency conditions. The Commissioning Agent will prepare detailed Systems Functional Performance Test procedures for review and approval by the Resident Engineer. The Contractor shall review and comment on the tests prior to approval. The Contractor shall provide the required

labor, materials, and test equipment identified in the test procedure to perform the tests. The Commissioning Agent will witness and document the testing. The Contractor shall sign the test reports to verify tests were performed. See Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS, for additional details.

3.4 TRAINING OF VA PERSONNEL

- A. Training of the VA's operation and maintenance personnel is required in cooperation with the Resident Engineer and Commissioning Agent. Provide competent, factory authorized personnel to provide instruction to operation and maintenance personnel concerning the location, operation, and troubleshooting of the installed systems. The instruction shall be scheduled in coordination with the Resident Engineer after submission and approval of formal training plans. Refer to Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS and Division 23 Sections for additional Contractor training requirements.

----- END -----

SECTION 23 09 23
DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC

PART 1 - GENERAL

1.1 DESCRIPTION

A. Provide (a) direct-digital control system(s) as indicated on the project documents, point list, interoperability tables, drawings and as described in these specifications. Include a complete and working direct-digital control system. Include all engineering, programming, controls and installation materials, installation labor, commissioning and start-up, training, final project documentation and warranty.

1. The direct-digital control system(s) shall consist of high-speed, peer-to-peer network of DDC controllers, a control system server, and an Engineering Control Center. Provide a remote user using a standard web browser to access the control system graphics and change adjustable setpoints with the proper password.

2. The direct-digital control system(s) shall be native BACnet. All new controllers, devices and components shall be listed by BACnet Testing Laboratories. All new workstations, controller, devices and components shall be accessible using a Web browser interface and shall communicate exclusively using the ASHRAE Standard 135 BACnet communications protocol without the use of gateways, unless otherwise allowed by this Section of the technical specifications, specifically shown on the design drawings and specifically requested otherwise by the VA.

a. If used, gateways shall support the ASHRAE Standard 135 BACnet communications protocol.

b. If used, gateways shall provide all object properties and read/write services shown on VA-approved interoperability schedules.

3. The work administered by this Section of the technical specifications shall include all labor, materials, special tools, equipment, enclosures, power supplies, software, software licenses, Project specific software configurations and database entries, interfaces, wiring, tubing, installation, labeling, engineering, calibration, documentation, submittals, testing, verification, training services, permits and licenses, transportation, shipping, handling,

administration, supervision, management, insurance, Warranty, specified services and items required for complete and fully functional Controls Systems.

4. The control systems shall be designed such that each mechanical system shall operate under stand-alone mode. The contractor administered by this Section of the technical specifications shall provide controllers for each mechanical system. In the event of a network communication failure, or the loss of any other controller, the control system shall continue to operate independently. Failure of the ECC shall have no effect on the field controllers, including those involved with global strategies.
- B. Some products are furnished but not installed by the contractor administered by this Section of the technical specifications. The contractor administered by this Section of the technical specifications shall formally coordinate in writing and receive from other contractors formal acknowledgements in writing prior to submission the installation of the products. These products include the following:
1. Control valves.
 2. Flow switches.
 3. Flow meters.
 4. Sensor wells and sockets in piping.
 5. Terminal unit controllers.
- C. Some products are installed but not furnished by the contractor administered by this Section of the technical specifications. The contractor administered by this Section of the technical specifications shall formally coordinate in writing and receive from other contractors formal acknowledgements in writing prior to submission the procurement of the products. These products include the following:
1. Factory-furnished accessory thermostats and sensors furnished with unitary equipment.
- D. Some products are not provided by, but are nevertheless integrated with the work executed by, the contractor administered by this Section of the technical specifications. The contractor administered by this Section of the technical specifications shall formally coordinate in

writing and receive from other contractors formal acknowledgements in writing prior to submission the particulars of the products. These products include the following:

1. Fire alarm systems. If zoned fire alarm is required by the project-specific requirements, this interface shall require multiple relays, which are provided and installed by the fire alarm system contractor, to be monitored.
2. Chiller controls. These controls, if not native BACnet, will require a BACnet Gateway.
3. Terminal units' velocity sensors
4. Variable frequency drives. These controls, if not native BACnet, will require a BACnet Gateway.
5. The following systems have limited control (as individually noted below) from the ECC:
 - a. Domestic water heating systems: low temperature, high temperature and status alarms.
 - b. Elevators: status alarms.
 - c. Process conveyors: on/off control.

E. Responsibility Table:

Work/Item/System	Furnish	Install	Low Voltage Wiring	Line Power
Control system low voltage and communication wiring	23 09 23	23 09 23	23 09 23	N/A
Terminal units	23	23	N/A	26
Controllers for terminal units	23 09 23	23	23 09 23	16
LAN conduits and raceway	23 09 23	23 09 23	N/A	N/A
Automatic dampers (not furnished with equipment)	23 09 23	23	N/A	N/A
Automatic damper actuators	23 09 23	23 09 23	23 09 23	23 09 23
Manual valves	23	23	N/A	N/A
Automatic valves	23 09 23	23	23 09 23	23 09 23
Pipe insertion devices and taps, flow and pressure	23	23	N/A	N/A

Work/Item/System	Furnish	Install	Low Voltage Wiring	Line Power
stations.				
Thermowells	23 09 23	23	N/A	N/A
Current Switches	23 09 23	23 09 23	23 09 23	N/A
Control Relays	23 09 23	23 09 23	23 09 23	N/A
Power distribution system monitoring interfaces	23 09 23	23 09 23	23 09 23	26
Interface with chiller controls	23 09 23	23 09 23	23 09 23	26
Chiller controls interface with control system	23	23	23 09 23	26
All control system nodes, equipment, housings, enclosures and panels.	23 09 23	23 09 23	23 09 23	26
Smoke detectors	28 31 00	28 31 00	28 31 00	28 31 00
Fire/Smoke Dampers	23	23	28 31 00	28 31 00
Smoke Dampers	23	23	28 31 00	28 31 00
Fire Dampers	23	23	N/A	N/A
Chiller/starter interlock wiring	N/A	N/A	26	26
Chiller Flow Switches	23	23	23	N/A
VFDs	23 09 23	26	23 09 23	26
Fire Alarm shutdown relay interlock wiring	28	28	28	26
Control system monitoring of fire alarm smoke control relay	28	28	23 09 23	28
Fire-fighter's smoke control station (FSCS	28	28	28	28
Fan Coil Unit controls (not furnished with equipment)	23 09 23	23 09 23	23 09 23	26
Unit Heater controls (not furnished with equipment)	23 09 23	23 09 23	23 09 23	26
Starters, HOA switches	23	23	N/A	26

- F. This facility's existing direct-digital control system is manufactured by Siemens, and its ECC is located at the boiler plant. The contractor administered by this Section of the technical specifications shall observe the capabilities, communication network, services, spare

capacity of the existing control system and its ECC prior to beginning work.

1. Upgrade the existing direct-digital control system's ECC to include all properties and services required by an ASHRAE Standard 135 BACnet B-AWS Profile. The upgraded ECC shall continue to communicate with the existing direct-digital control system's devices. The upgraded ECC shall communicate directly with the new native-BACnet devices over the existing control system's communications network without the use of a gateway. Provide programming converting the existing non-BACnet devices, objects and services to ASHRAE Standard 135 BACnet-complaint BIBBs. The contractor administered by this Section of the technical specifications shall provide all necessary investigation and site-specific programming to execute the interoperability schedules.
 - a. The performance requirement for the combined system: the combined system shall operate and function as one complete system including one database of control point objects and global control logic capabilities. Facility operators shall have complete operations and control capability over all systems, new and existing including; monitoring, trending, graphing, scheduling, alarm management, global point sharing, global strategy deployment, graphical operations interface and custom reporting as specified.
 - b. The combined system shall operate and function as one complete system including one database of control point objects and global control logic capabilities. Facility operators shall have limited operations and control capability over the legacy systems, as described in the VA-approved interoperability schedules.

2. Responsibility Table:

Item/Task	Section 23 09 23 contractor	Control system integrator	VA
ECC expansion		X	
ECC programming		X	
Devices, controllers, control panels and equipment	X		
Point addressing: all hardware and software points including setpoint, calculated point, data point(analog/	X		

binary), and reset schedule point			
Point mapping		X	
Network Programming	X		
ECC Graphics		X	
Controller programming and sequences	X		
Integrity of LAN communications	X		
Electrical wiring	X		
Operator system training		X	
LAN connections to devices	X		
LAN connections to ECC		X	
IP addresses			X
Overall system verification		X	
Controller and LAN system verification	X		

G. Unitary standalone systems including Unit Heaters, Cabinet Unit Heaters, Fan Coil Units, Base Board Heaters, thermal comfort ventilation fans, and similar units for control of room environment conditions may be equipped with integral controls furnished and installed by the equipment manufacturer or field mounted. Refer to equipment specifications and as indicated in project documents. Application of standalone unitary controls is limited to at least those systems wherein remote monitoring, alarm and start-up are not necessary. Examples of such systems include:

1. Light-switch-operated toilet exhaust
2. Vestibule heater
3. Exterior stair heater
4. Mechanical or electrical room heating and ventilation.

H. The direct-digital control system shall start and stop equipment, move (position) damper actuators and valve actuators, and vary speed of equipment to execute the mission of the control system. Use electricity as the motive force for all damper and valve actuators.

1.2 RELATED WORK

- A. Section 14 24 00, Hydraulic Elevators.
- B. Section 21 05 11, Common Work Results for Fire Suppression.
- C. Section 21 10 00, Water-Based Fire-Suppression Systems.
- D. Section 22 15 00, General Service Compressed-Air Systems.
- E. Section 22 33 00, Electric Domestic Water Heaters.
- F. Section 23 21 13, Hydronic Piping.
- G. Section 23 22 13, Steam and Condensate Heating Piping.
- H. Section 23 31 00, HVAC Ducts and Casings.

- I. Section 23 36 00, Air Terminal Units.
- J. Section 23 64 00, Packaged Water Chillers.
- K. Section 23 73 00, Indoor Central-Station Air-Handling Units.
- L. Section 23 81 00, Decentralized Unitary HVAC Equipment.
- M. Section 23 81 43, Air-Source Unitary Heat Pumps.
- N. Section 26 05 11, Requirements for Electrical Installations.
- O. Section 26 05 21, Low-Voltage Electrical Power Conductors and Cables (600 Volts and Below).
- P. Section 26 05 26, Grounding and Bonding for Electrical Systems.
- Q. Section 26 05 33, Raceway and Boxes for Electrical Systems.
- R. Section 26 09 23, Lighting Controls.
- S. Section 26 22 21, Specialty Transformers.
- T. Section 26 27 26, Wiring Devices.
- U. Section 26 29 11, Motor Starters.
- V. Section 27 15 00, Communications Horizontal Cabling
- W. Section 28 31 00, Fire Detection and Alarm.

1.2 DEFINITION

- A. Algorithm: A logical procedure for solving a recurrent mathematical problem; A prescribed set of well-defined rules or processes for the solution of a problem in a finite number of steps.
- B. Analog: A continuously varying signal value (e.g., temperature, current, velocity etc.
- C. BACnet: A Data Communication Protocol for Building Automation and Control Networks , ANSI/ASHRAE Standard 135. This communications protocol allows diverse building automation devices to communicate data over and services over a network.
- D. BACnet/IP: Annex J of Standard 135. It defines and allows for using a reserved UDP socket to transmit BACnet messages over IP networks. A BACnet/IP network is a collection of one or more IP sub-networks that share the same BACnet network number.
- E. BACnet Internetwork: Two or more BACnet networks connected with routers. The two networks may sue different LAN technologies.
- F. BACnet Network: One or more BACnet segments that have the same network address and are interconnected by bridges at the physical and data link layers.
- G. BACnet Segment: One or more physical segments of BACnet devices on a BACnet network, connected at the physical layer by repeaters.

- H. BACnet Broadcast Management Device (BBMD): A communications device which broadcasts BACnet messages to all BACnet/IP devices and other BBMDs connected to the same BACnet/IP network.
- I. BACnet Interoperability Building Blocks (BIBBs): BACnet Interoperability Building Blocks (BIBBs) are collections of one or more BACnet services. These are prescribed in terms of an "A" and a "B" device. Both of these devices are nodes on a BACnet internetwork.
- J. BACnet Testing Laboratories (BTL). The organization responsible for testing products for compliance with the BACnet standard, operated under the direction of BACnet International.
- K. Baud: It is a signal change in a communication link. One signal change can represent one or more bits of information depending on type of transmission scheme. Simple peripheral communication is normally one bit per Baud. (e.g., Baud rate = 78,000 Baud/sec is 78,000 bits/sec, if one signal change = 1 bit).
- L. Binary: A two-state system where a high signal level represents an "ON" condition and an "OFF" condition is represented by a low signal level.
- M. BMP or bmp: Suffix, computerized image file, used after the period in a DOS-based computer file to show that the file is an image stored as a series of pixels.
- N. Bus Topology: A network topology that physically interconnects workstations and network devices in parallel on a network segment.
- O. Control Unit (CU): Generic term for any controlling unit, stand-alone, microprocessor based, digital controller residing on secondary LAN or Primary LAN, used for local controls or global controls
- P. Deadband: A temperature range over which no heating or cooling is supplied, i.e., 22-25 degrees C (72-78 degrees F), as opposed to a single point change over or overlap).
- Q. Device: a control system component that contains a BACnet Device Object and uses BACnet to communicate with other devices.
- R. Device Object: Every BACnet device requires one Device Object, whose properties represent the network visible properties of that device. Every Device Object requires a unique Object Identifier number on the BACnet internetwork. This number is often referred to as the device instance.
- S. Device Profile: A specific group of services describing BACnet capabilities of a device, as defined in ASHRAE Standard 135-2008, Annex L. Standard device profiles include BACnet Operator Workstations (B-

- OVS), BACnet Building Controllers (B-BC), BACnet Advanced Application Controllers (B-AAC), BACnet Application Specific Controllers (B-ASC), BACnet Smart Actuator (B-SA), and BACnet Smart Sensor (B-SS). Each device used in new construction is required to have a PICS statement listing which service and BIBBs are supported by the device.
- T. Diagnostic Program: A software test program, which is used to detect and report system or peripheral malfunctions and failures. Generally, this system is performed at the initial startup of the system.
 - U. Direct Digital Control (DDC): Microprocessor based control including Analog/Digital conversion and program logic. A control loop or subsystem in which digital and analog information is received and processed by a microprocessor, and digital control signals are generated based on control algorithms and transmitted to field devices in order to achieve a set of predefined conditions.
 - V. Distributed Control System: A system in which the processing of system data is decentralized and control decisions can and are made at the subsystem level. System operational programs and information are provided to the remote subsystems and status is reported back to the Engineering Control Center. Upon the loss of communication with the Engineering Control center, the subsystems shall be capable of operating in a stand-alone mode using the last best available data.
 - W. Download: The electronic transfer of programs and data files from a central computer or operation workstation with secondary memory devices to remote computers in a network (distributed) system.
 - X. DXF: An AutoCAD 2-D graphics file format. Many CAD systems import and export the DXF format for graphics interchange.
 - Y. Electrical Control: A control circuit that operates on line or low voltage and uses a mechanical means, such as a temperature sensitive bimetal or bellows, to perform control functions, such as actuating a switch or positioning a potentiometer.
 - Z. Electronic Control: A control circuit that operates on low voltage and uses a solid-state components to amplify input signals and perform control functions, such as operating a relay or providing an output signal to position an actuator.
 - AA. Engineering Control Center (ECC): The centralized control point for the intelligent control network. The ECC comprises of personal computer and connected devices to form a single workstation.

- BB. Ethernet: A trademark for a system for exchanging messages between computers on a local area network using coaxial, fiber optic, or twisted-pair cables.
- CC. Firmware: Firmware is software programmed into read only memory (ROM) chips. Software may not be changed without physically altering the chip.
- DD. Gateway: Communication hardware connecting two or more different protocols. It translates one protocol into equivalent concepts for the other protocol. In BACnet applications, a gateway has BACnet on one side and non-BACnet (usually proprietary) protocols on the other side.
- EE. GIF: Abbreviation of Graphic interchange format.
- FF. Graphic Program (GP): Program used to produce images of air handler systems, fans, chillers, pumps, and building spaces. These images can be animated and/or color-coded to indicate operation of the equipment.
- GG. Graphic Sequence of Operation: It is a graphical representation of the sequence of operation, showing all inputs and output logical blocks.
- HH. I/O Unit: The section of a digital control system through which information is received and transmitted. I/O refers to analog input (AI, digital input (DI), analog output (AO) and digital output (DO). Analog signals are continuous and represent temperature, pressure, flow rate etc, whereas digital signals convert electronic signals to digital pulses (values), represent motor status, filter status, on-off equipment etc.
- II. I/P: a method for conveying and routing packets of information over LAN paths. User Datagram Protocol (UDP) conveys information to "sockets" without confirmation of receipt. Transmission Control Protocol (TCP) establishes "sessions", which have end-to-end confirmation and guaranteed sequence of delivery.
- JJ. JPEG: A standardized image compression mechanism stands for Joint Photographic Experts Group, the original name of the committee that wrote the standard.
- KK. Local Area Network (LAN): A communication bus that interconnects operator workstation and digital controllers for peer-to-peer communications, sharing resources and exchanging information.
- LL. Network Repeater: A device that receives data packet from one network and rebroadcasts to another network. No routing information is added to the protocol.

- MM. MS/TP: Master-slave/token-passing (ISO/IEC 8802, Part 3). It is not an acceptable LAN option for VA health-care facilities. It uses twisted-pair wiring for relatively low speed and low cost communication.
- NN. Native BACnet Device: A device that uses BACnet as its primary method of communication with other BACnet devices without intermediary gateways. A system that uses native BACnet devices at all levels is a native BACnet system.
- OO. Network Number: A site-specific number assigned to each network segment to identify for routing. This network number must be unique throughout the BACnet internetwork.
- PP. Object: The concept of organizing BACnet information into standard components with various associated properties. Examples include analog input objects and binary output objects.
- QQ. Object Identifier: An object property used to identify the object, including object type and instance. Object Identifiers must be unique within a device.
- RR. Object Properties: Attributes of an object. Examples include present value and high limit properties of an analog input object. Properties are defined in ASHRAE 135; some are optional and some are required. Objects are controlled by reading from and writing to object properties.
- SS. Operating system (OS): Software, which controls the execution of computer application programs.
- TT. PCX: File type for an image file. When photographs are scanned onto a personal computer they can be saved as PCX files and viewed or changed by a special application program as Photo Shop.
- UU. Peripheral: Different components that make the control system function as one unit. Peripherals include monitor, printer, and I/O unit.
- VV. Peer-to-Peer: A networking architecture that treats all network stations as equal partners- any device can initiate and respond to communication with other devices.
- WW. PICS: Protocol Implementation Conformance Statement, describing the BACnet capabilities of a device. All BACnet devices have published PICS.
- XX. PID: Proportional, integral, and derivative control, used to control modulating equipment to maintain a setpoint.
- YY. Repeater: A network component that connects two or more physical segments at the physical layer.

ZZ. Router: a component that joins together two or more networks using different LAN technologies. Examples include joining a BACnet Ethernet LAN to a BACnet MS/TP LAN.

AAA. Sensors: devices measuring state points or flows, which are then transmitted back to the DDC system.

BBB. Thermostats : devices measuring temperatures, which are used in control of standalone or unitary systems and equipment not attached to the DDC system.

1.4 QUALITY ASSURANCE

A. Criteria:

1. Single Source Responsibility of subcontractor: The Contractor shall obtain hardware and software supplied under this Section and delegate the responsibility to a single source controls installation subcontractor. The controls subcontractor shall be responsible for the complete design, installation, and commissioning of the system. The controls subcontractor shall be in the business of design, installation and service of such building automation control systems similar in size and complexity.
2. Equipment and Materials: Equipment and materials shall be cataloged products of manufacturers regularly engaged in production and installation of HVAC control systems. Products shall be manufacturer's latest standard design and have been tested and proven in actual use.
3. The controls subcontractor shall provide a list of no less than five similar projects which have building control systems as specified in this Section. These projects must be on-line and functional such that the Department of Veterans Affairs (VA) representative would observe the control systems in full operation.
4. The controls subcontractor shall have in-place facility within 50 miles with technical staff, spare parts inventory for the next five (5) years, and necessary test and diagnostic equipment to support the control systems.
5. The controls subcontractor shall have minimum of three years experience in design and installation of building automation systems similar in performance to those specified in this Section. Provide evidence of experience by submitting resumes of the project manager, the local branch manager, project engineer, the application engineering staff, and the electronic technicians who would be

involved with the supervision, the engineering, and the installation of the control systems. Training and experience of these personnel shall not be less than three years. Failure to disclose this information will be a ground for disqualification of the supplier.

6. Provide a competent and experienced Project Manager employed by the Controls Contractor. The Project Manager shall be supported as necessary by other Contractor employees in order to provide professional engineering, technical and management service for the work. The Project Manager shall attend scheduled Project Meetings as required and shall be empowered to make technical, scheduling and related decisions on behalf of the Controls Contractor.

B. Codes and Standards:

1. All work shall conform to the applicable Codes and Standards.
2. Electronic equipment shall conform to the requirements of FCC Regulation, Part 15, Governing Radio Frequency Electromagnetic Interference, and be so labeled.

1.5 PERFORMANCE

A. The system shall conform to the following:

1. Graphic Display: The system shall display up to four (4) graphics on a single screen with a minimum of twenty (20) dynamic points per graphic. All current data shall be displayed within ten (10) seconds of the request.
2. Graphic Refresh: The system shall update all dynamic points with current data within eight (8) seconds. Data refresh shall be automatic, without operator intervention.
3. Object Command: The maximum time between the command of a binary object by the operator and the reaction by the device shall be two(2) seconds. Analog objects shall start to adjust within two (2) seconds.
4. Object Scan: All changes of state and change of analog values shall be transmitted over the high-speed network such that any data used or displayed at a controller or work-station will be current, within the prior six (6) seconds.
5. Alarm Response Time: The maximum time from when an object goes into alarm to when it is annunciated at the workstation shall not exceed ten (10) seconds.
6. Program Execution Frequency: Custom and standard applications shall be capable of running as often as once every (5) seconds. The

Contractor shall be responsible for selecting execution times consistent with the mechanical process under control.

7. Multiple Alarm Annunciations: All workstations on the network shall receive alarms within five (5) seconds of each other.
8. Performance: Programmable Controllers shall be able to execute DDC PID control loops at a selectable frequency from at least once every one (1) second. The controller shall scan and update the process value and output generated by this calculation at this same frequency.
9. Reporting Accuracy: Listed below are minimum acceptable reporting end-to-end accuracies for all values reported by the specified system:

Measured Variable	Reported Accuracy
Space temperature	$\pm 0.5^{\circ}\text{C}$ ($\pm 1^{\circ}\text{F}$)
Ducted air temperature	$\pm 0.5^{\circ}\text{C}$ [$\pm 1^{\circ}\text{F}$]
Outdoor air temperature	$\pm 1.0^{\circ}\text{C}$ [$\pm 2^{\circ}\text{F}$]
Dew Point	$\pm 1.5^{\circ}\text{C}$ [$\pm 3^{\circ}\text{F}$]
Water temperature	$\pm 0.5^{\circ}\text{C}$ [$\pm 1^{\circ}\text{F}$]
Relative humidity	$\pm 2\%$ RH
Water flow	$\pm 1\%$ of reading
Air flow (terminal)	$\pm 10\%$ of reading
Air flow (measuring stations)	$\pm 5\%$ of reading
Carbon Monoxide (CO)	$\pm 5\%$ of reading
Carbon Dioxide (CO ₂)	± 50 ppm
Air pressure (ducts)	± 25 Pa [± 0.1 "w.c.]
Air pressure (space)	± 0.3 Pa [± 0.001 "w.c.]
Water pressure	$\pm 2\%$ of full scale *Note 1
Electrical Power	$\pm 0.5\%$ of reading

Note 1: for both absolute and differential pressure

10. Control stability and accuracy: Control sequences shall maintain measured variable at setpoint within the following tolerances:

Controlled Variable	Control Accuracy	Range of Medium
Air Pressure	± 50 Pa (± 0.2 in. w.g.)	0-1.5 kPa (0-6 in. w.g.)
Air Pressure	± 3 Pa (± 0.01 in. w.g.)	-25 to 25 Pa (-0.1 to 0.1 in. w.g.)
Airflow	$\pm 10\%$ of full scale	
Space Temperature	$\pm 1.0^{\circ}\text{C}$ ($\pm 2.0^{\circ}\text{F}$)	
Duct Temperature	$\pm 1.5^{\circ}\text{C}$ ($\pm 3^{\circ}\text{F}$)	
Humidity	$\pm 5\%$ RH	
Fluid Pressure	± 10 kPa (± 1.5 psi)	0-1 MPa (1-150 psi)
Fluid Pressure	± 250 Pa (± 1.0 in. w.g.)	0-12.5 kPa (0-50 in. w.g.) differential

11. Extent of direct digital control: control design shall allow for at least the points indicated on the points lists on the drawings.

1.6 WARRANTY

- A. Labor and materials for control systems shall be warranted for a period as specified under Warranty in FAR clause 52.246-21.
- B. Control system failures during the warranty period shall be adjusted, repaired, or replaced at no cost or reduction in service to the owner. The system includes all computer equipment, transmission equipment, and all sensors and control devices.
- C. Controls and Instrumentation subcontractor shall be responsible for temporary operations and maintenance of the control systems during the construction period until final commissioning, training of facility operators and acceptance of the project by VA.

1.7 SUBMITTALS

- A. Submit shop drawings in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturer's literature and data for all components including the following:
 - 1. A wiring diagram for each type of input device and output device including DDC controllers, modems, repeaters, etc. Diagram shall show how the device is wired and powered, showing typical connections at the digital controllers and each power supply, as well as the device itself. Show for all field connected devices, including but not limited to, control relays, motor starters,

electric or electronic actuators, and temperature pressure, flow and humidity sensors and transmitters.

2. A diagram of each terminal strip, including digital controller terminal strips, terminal strip location, termination numbers and the associated point names.
3. Control dampers and control valves schedule, including the size and pressure drop.
4. Catalog cut sheets of all equipment used. This includes, but is not limited to software (by manufacturer and by third parties), DDC controllers, panels, peripherals, airflow measuring stations and associated components, and auxiliary control devices such as sensors, actuators, and control dampers. When manufacturer's cut sheets apply to a product series rather than a specific product, the data specifically applicable to the project shall be highlighted. Each submitted piece of literature and drawings should clearly reference the specification and/or drawings that it supposed to represent.
5. Sequence of operations for each HVAC system and the associated control diagrams. Equipment and control labels shall correspond to those shown on the drawings.
6. Color prints of proposed graphics with a list of points for display.
7. Furnish a BACnet Protocol Implementation Conformance Statement (PICS) for each BACnet-compliant device.
8. Schematic wiring diagrams for all control, communication and power wiring. Provide a schematic drawing of the central system installation. Label all cables and ports with computer manufacturers' model numbers and functions. Show all interface wiring to the control system.
9. An instrumentation list for each controlled system. Each element of the controlled system shall be listed in table format. The table shall show element name, type of device, manufacturer, model number, and product data sheet number.
10. Riser diagrams of wiring between central control unit and all control panels.
11. Scaled plan drawings showing routing of LAN and locations of control panels, controllers, routers, gateways, ECC, and larger controlled devices.

12. Construction details for all installed conduit, cabling, raceway, cabinets, and similar. Construction details of all penetrations and their protection.
 13. Quantities of submitted items may be reviewed but are the responsibility of the contractor administered by this Section of the technical specifications.
- C. Product Certificates: Compliance with Article, QUALITY ASSURANCE.
- D. Licenses: Provide licenses for all software residing on and used by the Controls Systems and transfer these licenses to the Owner prior to completion.
- E. As Built Control Drawings:
1. Furnish three (3) copies of as-built drawings for each control system. The documents shall be submitted for approval prior to final completion.
 2. Furnish one (1) stick set of applicable control system prints for each mechanical system for wall mounting. The documents shall be submitted for approval prior to final completion.
 3. Furnish one (1) CD-ROM in CAD DWG and/or .DXF format for the drawings noted in subparagraphs above.
- F. Operation and Maintenance (O/M) Manuals):
1. Submit in accordance with Article, INSTRUCTIONS, in Specification Section 01 00 00, GENERAL REQUIREMENTS.
 2. Include the following documentation:
 - a. General description and specifications for all components, including logging on/off, alarm handling, producing trend reports, overriding computer control, and changing set points and other variables.
 - b. Detailed illustrations of all the control systems specified for ease of maintenance and repair/replacement procedures, and complete calibration procedures.
 - c. One copy of the final version of all software provided including operating systems, programming language, operator workstation software, and graphics software.
 - d. Complete troubleshooting procedures and guidelines for all systems.
 - e. Complete operating instructions for all systems.
 - f. Recommended preventive maintenance procedures for all system components including a schedule of tasks for inspection, cleaning

and calibration. Provide a list of recommended spare parts needed to minimize downtime.

g. Training Manuals: Submit the course outline and training material to the Owner for approval three (3) weeks prior to the training to VA facility personnel. These persons will be responsible for maintaining and the operation of the control systems, including programming. The Owner reserves the right to modify any or all of the course outline and training material.

h. Licenses, guaranty, and other pertaining documents for all equipment and systems.

G. Submit Performance Report to Contracting Officer's Technical Representative (COTR) prior to final inspection.

1.8 INSTRUCTIONS

A. Instructions to VA operations personnel: Perform in accordance with Article, INSTRUCTIONS, in Specification Section 01 00 00, GENERAL REQUIREMENTS, and as noted below.

1. First Phase: Formal instructions to the VA facilities personnel for a total of 16 hours, given in multiple training sessions (each no longer than four hours in length), conducted sometime between the completed installation and prior to the performance test period of the control system, at a time mutually agreeable to the Contractor and the VA.
2. Second Phase: This phase of training shall comprise of on the job training during start-up, checkout period, and performance test period. VA facilities personnel will work with the Contractor's installation and test personnel on a daily basis during start-up and checkout period. During the performance test period, controls subcontractor will provide 8 hours of instructions, given in multiple training sessions (each no longer than four hours in length), to the VA facilities personnel.
3. The O/M Manuals shall contain approved submittals as outlined in Article 1.7, SUBMITTALS. The Controls subcontractor will review the manual contents with VA facilities personnel during second phase of training.
4. Training shall be given by direct employees of the controls system subcontractor.

1.9 PROJECT CONDITIONS (ENVIRONMENTAL CONDITIONS OF OPERATION)

- A. The ECC and peripheral devices and system support equipment shall be designed to operate in ambient condition of 20 to 35°C (65 to 90°F) at a relative humidity of 20 to 80% non-condensing.
- B. The CUs used outdoors shall be mounted in NEMA 4 waterproof enclosures, and shall be rated for operation at -40 to 65°C (-40 to 150°F).
- C. All electronic equipment shall operate properly with power fluctuations of plus 10 percent to minus 15 percent of nominal supply voltage.
- D. Sensors and controlling devices shall be designed to operate in the environment, which they are sensing or controlling.

1.10 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American Society of Heating, Refrigerating, and Air-Conditioning Engineers (ASHRAE):
Standard 135-08.....BACNET Building Automation and Control Networks
- C. American Society of Mechanical Engineers (ASME):
B16.18-05.....Cast Copper Alloy Solder Joint Pressure Fittings.
B16.22-05.....Wrought Copper and Copper Alloy Solder Joint Pressure Fittings.
- D. American Society of Testing Materials (ASTM):
B32-04.....Standard Specification for Solder Metal
B88-03.....Standard Specifications for Seamless Copper Water Tube
B88M-05.....Standard Specification for Seamless Copper Water Tube (Metric)
B280-03.....Standard Specification for Seamless Copper Tube for Air-Conditioning and Refrigeration Field Service
D2737-03.....Standard Specification for Polyethylene (PE) Plastic Tubing
- E. Federal Communication Commission (FCC):
Rules and Regulations Title 47 Chapter 1-2001 Part 15: Radio Frequency Devices.
- F. Institute of Electrical and Electronic Engineers (IEEE):
802.3-05.....Information Technology-Telecommunications and Information Exchange between Systems-Local and Metropolitan Area Networks- Specific Requirements-Part 3: Carrier Sense Multiple Access with Collision Detection (CSMA/CD) Access method and Physical Layer Specifications

G. National Fire Protection Association (NFPA):

- 70-08.....National Electric Code
- 90A-09.....Standard for Installation of Air-Conditioning
and Ventilation Systems

H. Underwriter Laboratories Inc (UL):

- 94-06.....Tests for Flammability of Plastic Materials for
Parts and Devices and Appliances
- 294-05.....Access Control System Units
- 486A/486B-04-.....Wire Connectors
- 555S-06.....Standard for Smoke Dampers
- 916-07.....Energy Management Equipment
- 1076-05.....Proprietary Burglar Alarm Units and Systems

PART 2 - PRODUCTS

2.1 MATERIALS

- A. Use new products that the manufacturer is currently manufacturing and that have been installed in a minimum of 25 installations. Spare parts shall be available for at least five years after completion of this contract.

2.2 CONTROLS SYSTEM ARCHITECTURE

A. General

1. The Controls Systems shall consist of multiple Nodes and associated equipment connected by industry standard digital and communication network arrangements.
2. Building controllers and principal communications network equipment shall be standard products of recognized major manufacturers available through normal PC and computer vendor channels - not "Clones" assembled by a third-party subcontractor.
3. The networks shall, at minimum, comprise, as necessary, the following:
 - a. A portable operator's terminal.
 - b. Network computer processing, data storage and BACnet-compliant communication equipment including Servers and digital data processors.
 - c. BACnet-compliant routers, bridges, switches, hubs, modems, gateways, interfaces and similar communication equipment.
 - d. Active processing BACnet-compliant building controllers connected to other BACNet-compliant controllers together with their power supplies and associated equipment.
 - e. Addressable elements, sensors, transducers and end devices.

- f. Third-party equipment interfaces and gateways as described and required by the Contract Documents.
 - g. Other components required for a complete and working Control Systems as specified.
- B. The Specifications for the individual elements and component subsystems shall be minimum requirements and shall be augmented as necessary by the Contractor to achieve both compliance with all applicable codes, standards and to meet all requirements of the Contract Documents.
- C. Network Architecture
 - 1. The Controls communication network shall utilize BACnet communications protocol operating over a standard Ethernet LAN and operate at a minimum speed of 100 Mb/sec.
 - 2. The networks shall utilize only copper and optical fiber communication media as appropriate and shall comply with applicable codes, ordinances and regulations.
 - 3. All necessary telephone lines, ISDN lines and internet Service Provider services and connections will be provided by the VA.
- D. Servers:
 - 1. Provide data storage server(s) to archive historical data including trends, alarm and event histories and transaction logs.
 - 2. Equip these server(s) with the same software tool set that is located in the BACnet building controllers for system configuration and custom logic definition and color graphic configuration.
 - 3. Access to all information on the data storage server(s) shall be through the same browser functionality used to access individual nodes. When logged onto a server the operator will be able to also interact with any other controller on the control system as required for the functional operation of the controls systems. The contractor administered by this Section of the technical specifications shall provide all necessary digital processor programmable data storage server(s).
 - 4. These server(s) shall be utilized for controls systems application configuration, for archiving, reporting and trending of data, for operator transaction archiving and reporting, for network information management, for alarm annunciation, for operator interface tasks, for controls application management and similar. These server(s) shall utilize IT industry standard data base

platforms such as Microsoft SQL Server and Microsoft Data Engine (MSDE) or approved equal.

2.3 COMMUNICATION

- A. Control products, communication media, connectors, repeaters, hubs, and routers shall comprise a BACnet internetwork. Controller and operator interface communication shall conform to ANSI/ASHRAE Standard 135-2008, BACnet.
 - 1. The Data link / physical layer protocol (for communication) acceptable to the VA throughout its facilities is Ethernet (ISO 8802-3) and BACnet/IP.
- B. Each controller shall have a communication port for connection to an operator interface.
- C. Project drawings indicate remote buildings or sites to be connected by a nominal 56,000 baud modem over voice-grade telephone lines. In each remote location a modem and field device connection shall allow communication with each controller on the internetwork as specified in Paragraph D.
- D. Internetwork operator interface and value passing shall be transparent to internetwork architecture.
 - 1. An operator interface connected to a controller shall allow the operator to interface with each internetwork controller as if directly connected. Controller information such as data, status, reports, system software, and custom programs shall be viewable and editable from each internetwork controller.
 - 2. Inputs, outputs, and control variables used to integrate control strategies across multiple controllers shall be readable by each controller on the internetwork. Program and test all cross-controller links required to execute specified control system operation. An authorized operator shall be able to edit cross-controller links by typing a standard object address.
- E. System shall be expandable to at least twice the required input and output objects with additional controllers, associated devices, and wiring. Expansion shall not require operator interface hardware additions or software revisions.
- F. Controllers with real-time clocks shall use the BACnet Time Synchronization service. The system shall automatically synchronize system clocks daily from an operator-designated device via the

internetwork. The system shall automatically adjust for daylight savings and standard time as applicable.

2.4 PORTABLE OPERATOR'S TERMINAL (POT)

- A. Provide a portable operator's terminal (POT) that shall be capable of accessing all system data. POT may be connected to any point on the system network or may be connected directly to any controller for programming, setup, and troubleshooting. POT shall communicate using BACnet protocol. POT may be connected to any point on the system network or it may be connected directly to controllers using the BACnet PTP (Point-To-Point) Data Link/ Physical layer protocol. The terminal shall use the Read (Initiate) and Write (Execute) BACnet Services. POT shall be an IBM-compatible notebook-style PC including all software and hardware required.
- B. Hardware: POT shall conform to the BACnet Advanced Workstation (B-AWS) Profile and shall be BTL-Listed as a B-AWS device.
 - 1. POT shall be commercial standard with supporting 32- or 64-bit hardware (as limited by the direct-digital control system software) and software enterprise server. Internet Explorer v6.0 SP1 or higher, Windows Script Hosting version 5.6 or higher, Windows Message Queuing, Windows Internet Information Services (IIS) v5.0 or higher, minimum 2.8 GHz processor, minimum 500 GB 7200 rpm SATA hard drive with 16 MB cache, minimum 2GB DDR3 SDRAM (minimum 1333 Mhz) memory, 512 MB video card, minimum 16 inch (diagonal) screen, 10-100-1000 Base-TX Ethernet NIC with an RJ45 connector or a 100Base-FX Ethernet NIC with an SC/ST connector, 56,600 bps modem, an ASCII RS-232 interface, and a 16 speed high density DVD-RW+/- optical drive.
- C. Software: POT shall include software equal to the software on the ECC.

2.5 BACNET PROTOCOL ANALYZER

- A. For ease of troubleshooting and maintenance, provide a BACnet protocol analyzer. Provide its associated fittings, cables and appurtenances, for connection to the communications network. The BACnet protocol analyzer shall be able to, at a minimum: capture and store to a file all data traffic on all network levels; measure bandwidth usage; filter out (ignore) selected traffic.

2.6 NETWORK AND DEVICE NAMING CONVENTION

- A. Network Numbers

1. BACnet network numbers shall be based on a "facility code, network" concept. The "facility code" is the VAMC's or VA campus' assigned numeric value assigned to a specific facility or building. The "network" typically corresponds to a "floor" or other logical configuration within the building. BACnet allows 65535 network numbers per BACnet internet work.
 2. The network numbers are thus formed as follows: "Net #" = "FFFNN" where:
 - a. FFF = Facility code (see below)
 - b. NN = 00-99 This allows up to 100 networks per facility or building
- B. Device Instances
1. BACnet allows 4194305 unique devices instances per BACnet internet work. Using Agency's unique device instances are formed as follows: "Dev #" = "FFFNNDD" where
 - a. FFF and N are as above and
 - b. DD = 00-99, this allows up to 100 devices per network.
 2. Note Special cases, where the network architecture of limiting device numbering to DD causes excessive subnet works. The device number can be expanded to DDD and the network number N can become a single digit. In NO case shall the network number N and the device number D exceed 4 digits.
 3. Facility code assignments:
 4. 000-400 Building/facility number
 5. Note that some facilities have a facility code with an alphabetic suffix to denote wings, related structures, etc. The suffix will be ignored. Network numbers for facility codes above 400 will be assigned in the range 000-399.
- C. Device Names
1. Name the control devices based on facility name, location within a facility, the system or systems that the device monitors and/or controls, or the area served. The intent of the device naming is to be easily recognized. Names can be up to 254 characters in length, without embedded spaces. Provide the shortest descriptive, but unambiguous, name. For example, in building #123 prefix the number with a "B" followed by the building number, if there is only one chilled water pump "CHWP-1", a valid name would be "B123.CHWP.1.STARTSTOP". If there are two pumps designated "CHWP-1", one in a

basement mechanical room (Room 0001) and one in a penthouse mechanical room (Room PH01), the names could be "B123.R0001.CHWP.1.STARTSTOP " or " B123.RPH01.CHWP.1.STARTSTOP". In the case of unitary controllers, for example a VAV box controller, a name might be "B123.R101.VAV". These names should be used for the value of the "Object_Name" property of the BACnet Device objects of the controllers involved so that the BACnet name and the EMCS name are the same.

2.7 BACNET DEVICES

- A. All BACnet Devices - controllers, gateways, routers, actuators and sensors shall conform to BACnet Device Profiles and shall be BACnet Testing Laboratories (BTL) -Listed as conforming to those Device Profiles. Protocol Implementation Conformance Statements (PICSs), describing the BACnet capabilities of the Devices shall be published and available of the Devices through links in the BTL website.
1. BACnet Building Controllers, historically referred to as NACs, shall conform to the BACnet B-BC Device Profile, and shall be BTL-Listed as conforming to the B-BC Device Profile. The Device's PICS shall be submitted.
 2. BACnet Advanced Application Controllers shall conform to the BACnet B-AAC Device Profile, and shall be BTL-Listed as conforming to the B-AAC Device Profile. The Device's PICS shall be submitted.
 3. BACnet Application Specific Controllers shall conform to the BACnet B-ASC Device Profile, and shall be BTL-Listed as conforming to the B-ASC Device Profile. The Device's PICS shall be submitted.
 4. BACnet Smart Actuators shall conform to the BACnet B-SA Device Profile, and shall be BTL-Listed as conforming to the B-SA Device Profile. The Device's PICS shall be submitted.
 5. BACnet Smart Sensors shall conform to the BACnet B-SS Device Profile, and shall be BTL-Listed as conforming to the B-SS Device Profile. The Device's PICS shall be submitted.
 6. BACnet routers and gateways shall conform to the BACnet B-OTH Device Profile, and shall be BTL-Listed as conforming to the B-OTH Device Profile. The Device's PICS shall be submitted.

2.8 CONTROLLERS

- A. General. Provide an adequate number of BTL-Listed B-BC building controllers and an adequate number of BTL-Listed B-AAC advanced application controllers to achieve the performance specified in the

Part 1 Article on "System Performance." Each of these controllers shall meet the following requirements.

1. The controller shall have sufficient memory to support its operating system, database, and programming requirements.
2. The building controller shall share data with the ECC and the other networked building controllers. The advanced application controller shall share data with its building controller and the other networked advanced application controllers.
3. The operating system of the controller shall manage the input and output communication signals to allow distributed controllers to share real and virtual object information and allow for central monitoring and alarms.
4. Controllers that perform scheduling shall have a real-time clock.
5. The controller shall continually check the status of its processor and memory circuits. If an abnormal operation is detected, the controller shall:
 - a. assume a predetermined failure mode, and
 - b. generate an alarm notification.
6. The controller shall communicate with other BACnet devices on the internetwork using the BACnet Read (Execute and Initiate) and Write (Execute and Initiate) Property services.
7. Communication.
 - a. Each controller shall reside on a BACnet network using the ISO 8802-3 (Ethernet) Data Link/Physical layer protocol for its communications. Each building controller also shall perform BACnet routing if connected to a network of custom application and application specific controllers.
 - b. The controller shall provide a service communication port using BACnet Data Link/Physical layer protocol for connection to a portable operator's terminal.
8. Keypad. A local keypad and display shall be provided for each controller. The keypad shall be provided for interrogating and editing data. Provide a system security password shall be available to prevent unauthorized use of the keypad and display.
9. Serviceability. Provide diagnostic LEDs for power, communication, and processor. All wiring connections shall be made to field-

removable, modular terminal strips or to a termination card connected by a ribbon cable.

10. Memory. The controller shall maintain all BIOS and programming information in the event of a power loss for at least 72 hours.
 11. The controller shall be able to operate at 90% to 110% of nominal voltage rating and shall perform an orderly shutdown below 80% nominal voltage. Controller operation shall be protected against electrical noise of 5 to 120 Hz and from keyed radios up to 5 W at 1 m (3 ft).
- B. Provide BTL-Listed B-ASC application specific controllers for each piece of equipment for which they are constructed. Application specific controllers shall communicate with other BACnet devices on the internetwork using the BACnet Read (Execute) Property service.
1. Each B-ASC shall be capable of stand-alone operation and shall continue to provide control functions without being connected to the network.
 2. Each B-ASC will contain sufficient I/O capacity to control the target system.
 3. Communication.
 - a. Each controller shall reside on a BACnet network using the ISO 8802-3 (Ethernet) Data Link/Physical layer protocol for its communications. Each building controller also shall perform BACnet routing if connected to a network of custom application and application specific controllers.
 - b. Each controller shall have a BACnet Data Link/Physical layer compatible connection for a laptop computer or a portable operator's tool. This connection shall be extended to a space temperature sensor port where shown.
 4. Serviceability. Provide diagnostic LEDs for power, communication, and processor. All wiring connections shall be made to field-removable, modular terminal strips or to a termination card connected by a ribbon cable.
 5. Memory. The application specific controller shall use nonvolatile memory and maintain all BIOS and programming information in the event of a power loss.

6. Immunity to power and noise. Controllers shall be able to operate at 90% to 110% of nominal voltage rating and shall perform an orderly shutdown below 80%. Operation shall be protected against electrical noise of 5-120 Hz and from keyed radios up to 5 W at 1 m (3 ft).
 7. Transformer. Power supply for the ASC must be rated at a minimum of 125% of ASC power consumption and shall be of the fused or current limiting type.
- C. Direct Digital Controller Software
1. The software programs specified in this section shall be commercially available, concurrent, multi-tasking operating system and support the use of software application that operates under DOS or Microsoft Windows.
 2. All points shall be identified by up to 30-character point name and 16-character point descriptor. The same names shall be used at the ECC.
 3. All control functions shall execute within the stand-alone control units via DDC algorithms. The VA shall be able to customize control strategies and sequences of operations defining the appropriate control loop algorithms and choosing the optimum loop parameters.
 4. All controllers shall be capable of being programmed to utilize stored default values for assured fail-safe operation of critical processes. Default values shall be invoked upon sensor failure or, if the primary value is normally provided by the central or another CU, or by loss of bus communication. Individual application software packages shall be structured to assume a fail-safe condition upon loss of input sensors. Loss of an input sensor shall result in output of a sensor-failed message at the ECC. Each ACU and RCU shall have capability for local readouts of all functions. The UCUs shall be read remotely.
 5. All DDC control loops shall be able to utilize any of the following control modes:
 - a. Two position (on-off, slow-fast) control.
 - b. Proportional control.
 - c. Proportional plus integral (PI) control.
 - d. Proportional plus integral plus derivative (PID) control. All PID programs shall automatically invoke integral wind up prevention routines whenever the controlled unit is off, under manual control of an automation system or time initiated program.

- e. Automatic tuning of control loops.
- 6. System Security: Operator access shall be secured using individual password and operator's name. Passwords shall restrict the operator to the level of object, applications, and system functions assigned to him. A minimum of six (6) levels of security for operator access shall be provided.
- 7. Application Software: The controllers shall provide the following programs as a minimum for the purpose of optimizing energy consumption while maintaining comfortable environment for occupants. All application software shall reside and run in the system digital controllers. Editing of the application shall occur at the ECC or via a portable operator's terminal, when it is necessary, to access directly the programmable unit.
 - a. Economizer: An economizer program shall be provided for VAV systems. This program shall control the position of air handler relief, return, and outdoors dampers. If the outdoor air dry bulb temperature and humidity fall below changeover set point the energy control center will modulate the dampers to provide 100 percent outdoor air. The operator shall be able to override the economizer cycle and return to minimum outdoor air operation at any time.
 - b. Night Setback/Morning Warm up Control: The system shall provide the ability to automatically adjust set points for this mode of operation.
 - c. Optimum Start/Stop (OSS): Optimum start/stop program shall automatically be coordinated with event scheduling. The OSS program shall start HVAC equipment at the latest possible time that will allow the equipment to achieve the desired zone condition by the time of occupancy, and it shall also shut down HVAC equipment at the earliest possible time before the end of the occupancy period and still maintain desired comfort conditions. The OSS program shall consider both outside weather conditions and inside zone conditions. The program shall automatically assign longer lead times for weekend and holiday shutdowns. The program shall poll all zones served by the associated AHU and shall select the warmest and coolest zones. These shall be used in the start time calculation. It shall be

possible to assign occupancy start times on a per air handler unit basis. The program shall meet the local code requirements for minimum outdoor air while the building is occupied. Modification of assigned occupancy start/stop times shall be possible via the ECC.

- d. **Event Scheduling:** Provide a comprehensive menu driven program to automatically start and stop designated points or a group of points according to a stored time. This program shall provide the capability to individually command a point or group of points. When points are assigned to one common load group it shall be possible to assign variable time advances/delays between each successive start or stop within that group. Scheduling shall be calendar based and advance schedules may be defined up to one year in advance. Advance schedule shall override the day-to-day schedule. The operator shall be able to define the following information:
 - 1) Time, day.
 - 2) Commands such as on, off, auto.
 - 3) Time delays between successive commands.
 - 4) Manual overriding of each schedule.
 - 5) Allow operator intervention.
- e. **Alarm Reporting:** The operator shall be able to determine the action to be taken in the event of an alarm. Alarms shall be routed to the ECC based on time and events. An alarm shall be able to start programs, login the event, print and display the messages. The system shall allow the operator to prioritize the alarms to minimize nuisance reporting and to speed operator's response to critical alarms. A minimum of six (6) priority levels of alarms shall be provided for each point.
- f. **Remote Communications:** The system shall have the ability to dial out in the event of an alarm to the ECC and alpha-numeric pagers. The alarm message shall include the name of the calling location, the device that generated the alarm, and the alarm message itself. The operator shall be able to remotely access and operate the system using dial up communications. Remote access shall allow the operator to function the same as local access.

- g. Maintenance Management (PM): The program shall monitor equipment status and generate maintenance messages based upon the operators defined equipment run time, starts, and/or calendar date limits. A preventative maintenance alarm shall be printed indicating maintenance requirements based on pre-defined run time. Each preventive message shall include point description, limit criteria and preventative maintenance instruction assigned to that limit. A minimum of 480-character PM shall be provided for each component of units such as air handling units.
- h. Chilled water Plant Operation: The program shall provide sequence of operation as described on the drawings and include the following as a minimum:
 - 1) Automatic start/stop of chillers and auxiliaries in accordance with the sequence of operation shown on the drawings, while incorporating requirements and restraints, such as starting frequency of the equipment imposed by equipment manufacturers.
 - 2) Generate chilled water plant load profiles for different seasons for use in forecasting efficient operating schedule.
 - 3) The chilled water plant program shall display the following as a minimum:
 - a) Outdoor air dry bulb temperature.
 - b) Outdoor air wet bulb temperature.
 - c) Ton-hours of chilled water per day/month/year.
 - d) On-off status for each chiller.
 - e) Chilled water flow rate.
 - f) Chilled water supply and return temperature.
 - g) Operating set points-temperature and pressure.
 - h) Kilowatts and power factor.
 - i) Current limit set point.
 - j) Date and time.
 - k) Operating or alarm status.
 - l) Operating hours.

2.9 SENSORS (AIR, WATER AND STEAM)

- A. Sensors' measurements shall be read back to the DDC system, and shall be visible by the ECC.

- B. Temperature and Humidity Sensors shall be electronic, vibration and corrosion resistant for wall, immersion, and/or duct mounting. Provide all remote sensors as required for the systems.
1. Temperature Sensors: thermistor type for terminal units and Resistance Temperature Device (RTD) with an integral transmitter type for all other sensors.
 - a. Duct sensors shall be rigid or averaging type as shown on drawings. Averaging sensor shall be a minimum of 1 linear ft of sensing element for each sq ft of cooling coil face area.
 - b. Immersion sensors shall be provided with a separable well made of stainless steel, bronze or monel material. Pressure rating of well is to be consistent with the system pressure in which it is to be installed.
 - c. Space sensors shall be equipped with in-space User set-point adjustment, override switch, numerical temperature display on sensor cover, and communication port. Match room thermostats. Provide a tooled-access cover.
 - 1) Public space sensor: setpoint adjustment shall be only through the ECC or through the DDC system's diagnostic device/laptop. Do not provide in-space User set-point adjustment. Provide an opaque keyed-entry cover if needed to restrict in-space User set-point adjustment.
 - d. Outdoor air temperature sensors shall have watertight inlet fittings and be shielded from direct sunlight.
 - e. Wire: Twisted, shielded-pair cable.
 - f. Output Signal: 4-20 ma.
 2. Humidity Sensors: Bulk polymer sensing element type.
 - a. Duct and room sensors shall have a sensing range of 20 to 80 percent with accuracy of ± 2 to ± 5 percent RH, including hysteresis, linearity, and repeatability.
 - b. Outdoor humidity sensors shall be furnished with element guard and mounting plate and have a sensing range of 0 to 100 percent RH.
 - c. 4-20 ma continuous output signal.
- C. Static Pressure Sensors: Non-directional, temperature compensated.
1. 4-20 ma output signal.
 2. 0 to 5 inches wg for duct static pressure range.
 3. 0 to 0.25 inch wg for Building static pressure range.

D. Water flow sensors:

1. Type: Insertion vortex type with retractable probe assembly and 2 inch full port gate valve.
 - a. Pipe size: 3 to 24 inches.
 - b. Retractor: ASME threaded, non-rising stem type with hand wheel.
 - c. Mounting connection: 2 inch 150 PSI flange.
 - d. Sensor assembly: Design for expected water flow and pipe size.
 - e. Seal: Teflon (PTFE).
2. Controller:
 - a. Integral to unit.
 - b. Locally display flow rate and total.
 - c. Output flow signal to BMCS: Digital pulse type.
3. Performance:
 - a. Turndown: 20:1
 - b. Response time: Adjustable from 1 to 100 seconds.
 - c. Power: 24 volt DC
4. Install flow meters according to manufacturer's recommendations. Where recommended by manufacturer because of mounting conditions, provide flow rectifier.

E. Steam Flow Sensor/Transmitter:

1. Sensor: Vortex shedder incorporating wing type sensor and amplification technology for high signal-to-noise ratio, carbon steel body with 316 stainless steel working parts, 24 VDC power, NEMA 4 enclosure.
 - a. Ambient conditions, -40°C to 80°C (-40°F to 175°F).
 - b. Process conditions, 900 kPa (125 psig) saturated steam.
 - c. Turn down ratio, 20 to 1.
 - d. Output signal, 4-20 ma DC.
 - e. Processor/Transmitter, NEMA 4 enclosure with keypad program selector and six digit LCD output display of instantaneous flow rate or totalized flow, solid state switch closure signal shall be provided to the nearest DDC panel for totalization.
 - 1) Ambient conditions, -20°C to 50°C (0°F-120°F), 0 95 percent non-condensing RH.
 - 2) Power supply, 120 VAC, 60 hertz or 24 VDC.
 - 3) Internal battery, provided for 24-month retention of RAM contents when all other power sources are removed.

- f. Sensor on all steam lines shall be protected by pigtail siphons installed between the sensor and the line, and shall have an isolation valve installed between the sensor and pressure source.

F. Flow switches:

- 1. Shall be either paddle or differential pressure type.
 - a. Paddle-type switches (liquid service only) shall be UL Listed, SPDT snap-acting, adjustable sensitivity with NEMA 4 enclosure.
 - b. Differential pressure type switches (air or water service) shall be UL listed, SPDT snap acting, NEMA 4 enclosure, with scale range and differential suitable for specified application.

- G. Current Switches: Current operated switches shall be self powered, solid state with adjustable trip current as well as status, power, and relay command status LED indication. The switches shall be selected to match the current of the application and output requirements of the DDC systems.

2.10 CONTROL CABLES

A. General:

- 1. Ground cable shields, drain conductors, and equipment to eliminate shock hazard and to minimize ground loops, common-mode returns, noise pickup, cross talk, and other impairments. Comply with Sections 27 05 26 and 26 05 26.
- 2. Cable conductors to provide protection against induction in circuits. Crosstalk attenuation within the System shall be in excess of -80 dB throughout the frequency ranges specified.
- 3. Minimize the radiation of RF noise generated by the System equipment so as not to interfere with any audio, video, data, computer main distribution frame (MDF), telephone customer service unit (CSU), and electronic private branch exchange (EPBX) equipment the System may service.
- 4. The as-installed drawings shall identify each cable as labeled, used cable, and bad cable pairs.
- 5. Label system's cables on each end. Test and certify cables in writing to the VA before conducting proof-of-performance testing. Minimum cable test requirements are for impedance compliance, inductance, capacitance, signal level compliance, opens, shorts, cross talk, noise, and distortion, and split pairs on all cables in the frequency ranges used. Make available all cable installation and test records at demonstration to the VA. All changes (used pair,

failed pair, etc.) shall be posted in these records as the change occurs.

6. Power wiring shall not be run in conduit with communications trunk wiring or signal or control wiring operating at 100 volts or less.
- B. Analogue control cabling shall be not less than No. 18 AWG solid, with thermoplastic insulated conductors as specified in Section 26 05 21.
- C. Copper digital communication cable between the ECC and the B-BC and B-AAC controllers shall be 100BASE-TX Ethernet, Category 5e or 6, not less than minimum 24 American Wire Gauge (AWG) solid, Shielded Twisted Pair (STP) or Unshielded Twisted Pair (UTP), with thermoplastic insulated conductors, enclosed in a thermoplastic outer jacket, as specified in Section 27 15 00.
1. Other types of media commonly used within IEEE Std 802.3 LANs (e.g., 10Base-T and 10Base-2) shall be used only in cases to interconnect with existing media.
- D. Optical digital communication fiber, if used, shall be Multimode or Singlemode fiber, 62.5/125 micron for multimode or 10/125 micron for singlemode micron with SC or ST connectors as specified in TIA-568-C.1. Terminations, patch panels, and other hardware shall be compatible with the specified fiber and shall be as specified in Section 27 15 00. Fiber-optic cable shall be suitable for use with the 100Base-FX or the 100Base-SX standard (as applicable) as defined in IEEE Std 802.3.

2.11 THERMOSTATS AND HUMIDISTATS

- A. Room thermostats controlling unitary standalone heating and cooling devices not connected to the DDC system shall have three modes of operation (heating - null or dead band - cooling). Thermostats for patient bedrooms shall have capability of being adjusted to eliminate null or dead band. Wall mounted thermostats shall have manufacturer's standard finish, setpoint range and temperature display and external adjustment:
 1. Electronic Thermostats: Solid-state, microprocessor based, programmable to daily, weekend, and holiday schedules.
 - a. Public Space Thermostat: Public space thermostat shall have a thermistor sensor and shall not have a visible means of set point adjustment. Adjustment shall be via the digital controller to which it is connected.

- b. Patient Room Thermostats: thermistor with in-space User set point adjustment and an on-casing room temperature numerical temperature display.
 - c. Battery replacement without program loss.
- B. Strap-on thermostats shall be enclosed in a dirt-and-moisture proof housing with fixed temperature switching point and single pole, double throw switch.
- C. Freezestats shall have a minimum of 300 mm (one linear foot) of sensing element for each 0.093 square meter (one square foot) of coil area. A freezing condition at any increment of 300 mm (one foot) anywhere along the sensing element shall be sufficient to operate the thermostatic element. Freezestats shall be manually-reset.

2.12 FINAL CONTROL ELEMENTS AND OPERATORS

- A. Fail Safe Operation: Control valves and dampers shall provide "fail safe" operation in either the normally open or normally closed position as required for freeze, moisture, and smoke or fire protection.
- B. Spring Ranges: Range as required for system sequencing and to provide tight shut-off.
- C. Power Operated Control Dampers (other than VAV Boxes): Factory fabricated, balanced type dampers. All modulating dampers shall be opposed blade type and gasketed. Blades for two-position, duct-mounted dampers shall be parallel, airfoil (streamlined) type for minimum noise generation and pressure drop.
 - 1. Leakage: Maximum leakage in closed position shall not exceed 7 L/S (15 CFMs) differential pressure for outside air and exhaust dampers and 200 L/S/ square meter (40 CFM/sq. ft.) at 50 mm (2 inches) differential pressure for other dampers.
 - 2. Frame shall be galvanized steel channel with seals as required to meet leakage criteria.
 - 3. Blades shall be galvanized steel or aluminum, 200 mm (8 inch) maximum width, with edges sealed as required.
 - 4. Bearing shall be nylon, bronze sleeve or ball type.
 - 5. Hardware shall be zinc-plated steel. Connected rods and linkage shall be non-slip. Working parts of joints shall be brass, bronze, nylon or stainless steel.
 - 6. Maximum air velocity and pressure drop through free area the dampers:

- a. Smoke damper in air handling unit: 305 meter per minute (1000 fpm).
 - b. Duct mounted damper: 600 meter per minute (2000 fpm).
 - c. Maximum static pressure loss: 50 Pascal (0.20 inches water gage).
- D. Smoke Dampers and Combination Fire/Smoke Dampers: Dampers and operators are specified in Section 23 31 00, HVAC DUCTS AND CASINGS. Control of these dampers is specified under this Section.
- E. Control Valves:
 - 1. Valves shall be rated for a minimum of 150 percent of system operating pressure at the valve location but not less than 900 kPa (125 psig).
 - 2. Valves 50 mm (2 inches) and smaller shall be bronze body with threaded or flare connections.
 - 3. Valves 60 mm (2 1/2 inches) and larger shall be bronze or iron body with flanged connections.
 - 4. Brass or bronze seats except for valves controlling media above 100 degrees C (210 degrees F), which shall have stainless steel seats.
 - 5. Flow characteristics:
 - a. Three way modulating valves shall be globe pattern. Position versus flow relation shall be linear relation for steam or equal percentage for water flow control.
 - b. Two-way modulating valves shall be globe pattern. Position versus flow relation shall be linear for steam and equal percentage for water flow control.
 - c. Two-way 2-position valves shall be ball, gate or butterfly type.
 - 6. Maximum pressure drop:
 - a. Two position steam control: 20 percent of inlet gauge pressure.
 - b. Modulating Steam Control: 80 percent of inlet gauge pressure (acoustic velocity limitation).
 - c. Modulating water flow control, greater of 3 meters (10 feet) of water or the pressure drop through the apparatus.
 - 7. Two position water valves shall be line size.
- F. Damper and Valve Operators and Relays:
 - 1. Electric operator shall provide full modulating control of dampers and valves. A linkage and pushrod shall be furnished for mounting the actuator on the damper frame internally in the duct or externally in the duct or externally on the duct wall, or shall be furnished with a direct-coupled design. Metal parts shall be

aluminum, mill finish galvanized steel, or zinc plated steel or stainless steel. Provide actuator heads which allow for electrical conduit attachment. The motors shall have sufficient closure torque to allow for complete closure of valve or damper under pressure. Provide multiple motors as required to achieve sufficient closeoff torque.

a. Minimum valve closeoff pressure shall be equal to the system pump's dead-head pressure, minimum 50 psig for valves smaller than 4 inches.

2. Electronic damper operators: Metal parts shall be aluminum, mill finish galvanized steel, or zinc plated steel or stainless steel. Provide actuator heads which allow for electrical conduit attachment. The motors shall have sufficient closure torque to allow for complete closure of valve or damper under pressure. Provide multiple motors as required to achieve sufficient closeoff torque.

a. VAV Box actuator shall be mounted on the damper axle or shall be of the air valve design, and shall provide complete modulating control of the damper. The motor shall have a closure torque of 35-inch pounds minimum with full torque applied at close off to attain minimum leakage.

3. See drawings for required control operation.

2.13 AIR FLOW CONTROL

A. Airflow and static pressure shall be controlled via digital controllers with inputs from airflow control measuring stations and static pressure inputs as specified. Controller outputs shall be analog or pulse width modulating output signals. The controllers shall include the capability to control via simple proportional (P) control, proportional plus integral (PI), proportional plus integral plus derivative (PID), and on-off. The airflow control programs shall be factory-tested programs that are documented in the literature of the control manufacturer.

B. Air Flow Measuring Station -- Electronic Thermal Type:

1. Air Flow Sensor Probe:

a. Each air flow sensor shall contain two individual thermal sensing elements. One element shall determine the velocity of the air stream while the other element shall compensate for changes in temperature. Each thermal flow sensor and its associated control

circuit and signal conditioning circuit shall be factory calibrated and be interchangeable to allow replacement of a sensor without recalibration of the entire flow station. The sensor in the array shall be located at the center of equal area segment of the duct and the number of sensors shall be adequate to accommodate the expected velocity profile and variation in flow and temperature. The airflow station shall be of the insertion type in which sensor support structures are inserted from the outside of the ducts to make up the complete electronic velocity array.

- b. Thermal flow sensor shall be constructed of hermetically sealed thermistors or nickel chromium or reference grade platinum wire, wound over an epoxy, stainless steel or ceramic mandrel and coated with a material suitable for the conditions to be encountered. Each dual sensor shall be mounted in an extruded aluminum alloy strut.

2. Air Flow Sensor Grid Array:

- a. Each sensor grid shall consist of a lattice network of temperature sensors and linear integral controllers (ICs) situated inside an aluminum casing suitable for mounting in a duct. Each sensor shall be mounted within a strut facing downstream of the airflow and located so that it is protected on the upstream side. All wiring shall be encased (out of the air stream) to protect against mechanical damage.
- b. The casing shall be made of welded aluminum of sufficient strength to prevent structural bending and bowing. Steel or iron composite shall not be acceptable in the casing material.
- c. Pressure drop through the flow station shall not exceed 4 Pascal (0.015" W.G.) at 1,000 meter per minute (3,000 FPM).

3. Electronics Panel:

- a. Electronics Panel shall consist of a surface mounted enclosure complete with solid-state microprocessor and software.
- b. Electronics Panel shall be A/C powered 120 VAC and shall have the capability to transmit signals of 0-5 VDC, 0-10 VCD or 4-20 ma for use in control of the HVAC Systems. The electronic panel

shall have the capability to accept user defined scaling parameters for all output signals.

c. Electronics Panel shall have the capability to digitally display airflow in CFM and temperature in degrees F. The displays shall be provided as an integral part of the electronics panel. The electronic panel shall have the capability to totalize the output flow in CFM for two or more systems, as required. A single output signal may be provided which will equal the sum of the systems totalized. Output signals shall be provided for temperature and airflow. Provide remote mounted air flow or temperature displays where indicated on the plans.

d. Electronics Panel shall have the following:

- 1) Minimum of 12-bit A/D conversion.
- 2) Field adjustable digital primary output offset and gain.
- 3) Airflow analog output scaling of 100 to 10,000 FPM.
- 4) Temperature analog output scaling from -45°C to 70°C (-50°F to 160°F).
- 5) Analog output resolution (full scale output) of 0.025%.

e. All readings shall be in I.P. units.

4. Thermal flow sensors and its electronics shall be installed as per manufacturer's instructions. The probe sensor density shall be as follows:

Probe Sensor Density	
Area (sq.ft.)	Qty. Sensors
<=1	2
>1 to <4	4
4 to <8	6
8 to <12	8
12 to <16	12
>=16	16

a. Complete installation shall not exhibit more than $\pm 2.0\%$ error in airflow measurement output for variations in the angle of flow of up to 10 percent in any direction from its calibrated orientation. Repeatability of readings shall be within $\pm 0.25\%$.

- D. Static Pressure Measuring Station: shall consist of one or more static pressure sensors and transmitters along with relays or auxiliary devices as required for a complete functional system. The span of the transmitter shall not exceed two times the design static pressure at the point of measurement. The output of the transmitter shall be true representation of the input pressure with plus or minus 25 Pascal (0.1 inch) W.G. of the true input pressure:
1. Static pressure sensors shall have the same requirements as Airflow Measuring Devices except that total pressure sensors are optional, and only multiple static pressure sensors positioned on an equal area basis connected to a network of headers are required.
 2. For systems with multiple major trunk supply ducts, furnish a static pressure transmitter for each trunk duct. The transmitter signal representing the lowest static pressure shall be selected and this shall be the input signal to the controller.
 3. The controller shall receive the static pressure transmitter signal and CU shall provide a control output signal to the supply fan capacity control device. The control mode shall be proportional plus integral (PI) (automatic reset) and where required shall also include derivative mode.
 4. In systems with multiple static pressure transmitters, provide a switch located near the fan discharge to prevent excessive pressure during abnormal operating conditions. High-limit switches shall be manually-reset.
- E. Airflow Synchronization:
1. Systems shall consist of an air flow measuring station for each supply and return duct, the CU and such relays, as required to provide a complete functional system that will maintain a constant flow rate difference between supply and return air to an accuracy of $\pm 10\%$. In systems where there is no suitable location for a flow measuring station that will sense total supply or return flow, provide multiple flow stations with a differential pressure transmitter for each station. Signals from the multiple transmitters shall be added through the CU such that the resultant signal is a true representation of total flow.
 2. The total flow signals from supply and return air shall be the input signals to the CU. This CU shall track the return air fan capacity in proportion to the supply air flow under all conditions.

PART 3 - EXECUTION**3.1 INSTALLATION****A. General:**

1. Examine project plans for control devices and equipment locations; and report any discrepancies, conflicts, or omissions to Resident Engineer for resolution before proceeding for installation.
2. Work Coordination: GENERAL CONDITIONS.
3. Install equipment, piping, wiring /conduit parallel to or at right angles to building lines.
4. Install all equipment and piping in readily accessible locations. Do not run tubing and conduit concealed under insulation or inside ducts.
5. Mount control devices, tubing and conduit located on ducts and apparatus with external insulation on standoff support to avoid interference with insulation.
6. Provide sufficient slack and flexible connections to allow for vibration of piping and equipment.
7. Run tubing and wire connecting devices on or in control cabinets parallel with the sides of the cabinet neatly racked to permit tracing.
8. Install equipment level and plum.

B. Electrical Wiring Installation:

1. All wiring cabling shall be installed in conduits. Install conduits and wiring in accordance with Specification Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS. Conduits carrying control wiring and cabling shall be dedicated to the control wiring and cabling: these conduits shall not carry power wiring. Provide plastic end sleeves at all conduit terminations to protect wiring from burrs.
2. Install analog signal and communication cables in conduit and in accordance with Specification Section 26 05 21. Install digital communication cables in conduit and in accordance with Specification Section 27 15 00, Communications Horizontal Cabling.
3. Install conduit and wiring between operator workstation(s), digital controllers, electrical panels, indicating devices, instrumentation, miscellaneous alarm points, thermostats, and relays as shown on the drawings or as required under this section.

4. Install all electrical work required for a fully functional system and not shown on electrical plans or required by electrical specifications. Where low voltage (less than 50 volt) power is required, provide suitable Class B transformers.
 5. Install all system components in accordance with local Building Code and National Electric Code.
 - a. Splices: Splices in shielded and coaxial cables shall consist of terminations and the use of shielded cable couplers. Terminations shall be in accessible locations. Cables shall be harnessed with cable ties.
 - b. Equipment: Fit all equipment contained in cabinets or panels with service loops, each loop being at least 300 mm (12 inches) long. Equipment for fiber optics system shall be rack mounted, as applicable, in ventilated, self-supporting, code gauge steel enclosure. Cables shall be supported for minimum sag.
 - c. Cable Runs: Keep cable runs as short as possible. Allow extra length for connecting to the terminal board. Do not bend flexible coaxial cables in a radius less than ten times the cable outside diameter.
 - d. Use vinyl tape, sleeves, or grommets to protect cables from vibration at points where they pass around sharp corners, through walls, panel cabinets, etc.
 6. Conceal cables, except in mechanical rooms and areas where other conduits and piping are exposed.
 7. Permanently label or code each point of all field terminal strips to show the instrument or item served. Color-coded cable with cable diagrams may be used to accomplish cable identification.
 8. Grounding: ground electrical systems per manufacturer's written requirements for proper and safe operation.
- C. Install Sensors and Controls:
1. Temperature Sensors:
 - a. Install all sensors and instrumentation according to manufacturer's written instructions. Temperature sensor locations shall be readily accessible, permitting quick replacement and servicing of them without special skills and tools.
 - b. Calibrate sensors to accuracy specified, if not factory calibrated.

- c. Use of sensors shall be limited to its duty, e.g., duct sensor shall not be used in lieu of room sensor.
 - d. Install room sensors permanently supported on wall frame. They shall be mounted at 1.5 meter (5.0 feet) above the finished floor.
 - e. Mount sensors rigidly and adequately for the environment within which the sensor operates. Separate extended-bulb sensors from contact with metal casings and coils using insulated standoffs.
 - f. Sensors used in mixing plenum, and hot and cold decks shall be of the averaging of type. Averaging sensors shall be installed in a serpentine manner horizontally across duct. Each bend shall be supported with a capillary clip.
 - g. All pipe mounted temperature sensors shall be installed in wells.
 - h. All wires attached to sensors shall be air sealed in their conduits or in the wall to stop air transmitted from other areas affecting sensor reading.
 - i. Permanently mark terminal blocks for identification. Protect all circuits to avoid interruption of service due to short-circuiting or other conditions. Line-protect all wiring that comes from external sources to the site from lightning and static electricity.
2. Pressure Sensors:
- a. Install duct static pressure sensor tips facing directly downstream of airflow.
 - b. Install high-pressure side of the differential switch between the pump discharge and the check valve.
 - c. Install snubbers and isolation valves on steam pressure sensing devices.
3. Actuators:
- a. Mount and link damper and valve actuators according to manufacturer's written instructions.
 - b. Check operation of damper/actuator combination to confirm that actuator modulates damper smoothly throughout stroke to both open and closed position.
 - c. Check operation of valve/actuator combination to confirm that actuator modulates valve smoothly in both open and closed position.
4. Flow Switches:

- a. Install flow switch according to manufacturer's written instructions.
- b. Mount flow switch a minimum of 5 pipe diameters up stream and 5 pipe diameters downstream or 600 mm (2 feet) whichever is greater, from fittings and other obstructions.
- c. Assure correct flow direction and alignment.
- d. Mount in horizontal piping-flow switch on top of the pipe.

D. Installation of network:

1. Ethernet:

- a. The network shall employ Ethernet LAN architecture, as defined by IEEE 802.3. The Network Interface shall be fully Internet Protocol (IP) compliant allowing connection to currently installed IEEE 802.3, Compliant Ethernet Networks.
- b. The network shall directly support connectivity to a variety of cabling types. As a minimum provide the following connectivity: 100 Base TX (Category 5e cabling) for the communications between the ECC and the B-BC and the B-AAC controllers.

E. Installation of digital controllers and programming:

- 1. Provide a separate digital control panel for each major piece of equipment, such as air handling unit, chiller, pumping unit etc. Points used for control loop reset such as outdoor air, outdoor humidity, or space temperature could be located on any of the remote control units.
- 2. Provide sufficient internal memory for the specified control sequences and trend logging. There shall be a minimum of 25 percent of available memory free for future use.
- 3. System point names shall be modular in design, permitting easy operator interface without the use of a written point index.
- 4. Provide software programming for the applications intended for the systems specified, and adhere to the strategy algorithms provided.
- 5. Provide graphics for each piece of equipment and floor plan in the building. This includes each chiller, cooling tower, air handling unit, fan, terminal unit, boiler, pumping unit etc. These graphics shall show all points dynamically as specified in the point list.

3.2 SYSTEM VALIDATION AND DEMONSTRATION

- A. As part of final system acceptance, a system demonstration is required (see below). Prior to start of this demonstration, the contractor is

to perform a complete validation of all aspects of the controls and instrumentation system.

B. Validation

1. Prepare and submit for approval a validation test plan including test procedures for the performance verification tests. Test Plan shall address all specified functions of the ECC and all specified sequences of operation. Explain in detail actions and expected results used to demonstrate compliance with the requirements of this specification. Explain the method for simulating the necessary conditions of operation used to demonstrate performance of the system. Test plan shall include a test check list to be used by the Installer's agent to check and initial that each test has been successfully completed. Deliver test plan documentation for the performance verification tests to the owner's representative 30 days prior to start of performance verification tests. Provide draft copy of operation and maintenance manual with performance verification test.
2. After approval of the validation test plan, installer shall carry out all tests and procedures therein. Installer shall completely check out, calibrate, and test all connected hardware and software to insure that system performs in accordance with approved specifications and sequences of operation submitted. Installer shall complete and submit Test Check List.

C. Demonstration

1. System operation and calibration to be demonstrated by the installer in the presence of the Architect or VA's representative on random samples of equipment as dictated by the Architect or VA's representative. Should random sampling indicate improper commissioning, the owner reserves the right to subsequently witness complete calibration of the system at no addition cost to the VA.
2. Demonstrate to authorities that all required safeties and life safety functions are fully functional and complete.
3. Make accessible , personnel to provide necessary adjustments and corrections to systems as directed by balancing agency.
4. The following witnessed demonstrations of field control equipment shall be included:
 - a. Observe HVAC systems in shut down condition. Check dampers and valves for normal position.

- b. Test application software for its ability to communicate with digital controllers, operator workstation, and uploading and downloading of control programs.
 - c. Demonstrate the software ability to edit the control program off-line.
 - d. Demonstrate reporting of alarm conditions for each alarm and ensure that these alarms are received at the assigned location, including operator workstations.
 - e. Demonstrate ability of software program to function for the intended applications-trend reports, change in status etc.
 - f. Demonstrate via graphed trends to show the sequence of operation is executed in correct manner, and that the HVAC systems operate properly through the complete sequence of operation, e.g., seasonal change, occupied/unoccupied mode, and warm-up condition.
 - g. Demonstrate hardware interlocks and safeties functions, and that the control systems perform the correct sequence of operation after power loss and resumption of power loss.
 - h. Prepare and deliver to the VA graphed trends of all control loops to demonstrate that each control loop is stable and the set points are maintained.
 - i. Demonstrate that each control loop responds to set point adjustment and stabilizes within one (1) minute. Control loop trend data shall be instantaneous and the time between data points shall not be greater than one (1) minute.
5. Witnessed demonstration of ECC functions shall consist of:
- a. Running each specified report.
 - b. Display and demonstrate each data entry to show site specific customizing capability. Demonstrate parameter changes.
 - c. Step through penetration tree, display all graphics, demonstrate dynamic update, and direct access to graphics.
 - d. Execute digital and analog commands in graphic mode.
 - e. Demonstrate DDC loop precision and stability via trend logs of inputs and outputs (6 loops minimum).
 - f. Demonstrate EMS performance via trend logs and command trace.
 - g. Demonstrate scan, update, and alarm responsiveness.
 - h. Demonstrate spreadsheet/curve plot software, and its integration with database.

- i. Demonstrate on-line user guide, and help function and mail facility.
- j. Demonstrate digital system configuration graphics with interactive upline and downline load, and demonstrate specified diagnostics.
- k. Demonstrate multitasking by showing dynamic curve plot, and graphic construction operating simultaneously via split screen.
- l. Demonstrate class programming with point options of beep duration, beep rate, alarm archiving, and color banding.

----- END -----

SECTION 23 21 13
HYDRONIC PIPING

PART 1 - GENERAL

1.1 DESCRIPTION

- A. Water piping to connect HVAC equipment, including the following:
 - 1. Chilled water, heating hot water and drain piping.
 - 2. Extension of domestic water make-up piping.

1.2 RELATED WORK

- A. Section 01 00 00, GENERAL REQUIREMENTS.
- B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- C. Section 31 20 00, EARTH MOVING: Excavation and backfill.
- D. Section 03 30 00, CAST-IN-PLACE CONCRETE.
- E. Section 07 13 52, MODIFIED BITUMINOUS SHEET WATERPROOFING.
- F. Section 33 10 00, WATER UTILITIES: Underground piping.
- G. Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION:
General mechanical requirements and items, which are common to more than one section of Division 23.
- H. Section 23 21 23, HYDRONIC PUMPS: Pumps.
- I. Section 23 07 11, HVAC, PLUMBING, and BOILER PLANT INSULATION: Piping insulation.
- J. Section 23 23 00, REFRIGERANT PIPING: Refrigerant piping and refrigerants.
- K. Section 23 25 00, HVAC WATER TREATMENT: Water treatment for closed systems.
- L. Section 23 82 00, CONVECTION HEATING AND COOLING UNITS: VAV and CV units, fan coil units.
- M. Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC: Temperature and pressure sensors and valve operators.

1.3 QUALITY ASSURANCE

- A. Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION, which includes welding qualifications.
- B. Submit prior to welding of steel piping a certificate of Welder's certification. The certificate shall be current and not more than one year old.
- C. For mechanical pressed sealed fittings, only tools of fitting manufacturer shall be used.

D. All grooved joint couplings, fittings, valves, and specialties shall be the products of a single manufacturer. Grooving tools shall be the same manufacturer as the grooved components.

1. All castings used for coupling housings, fittings, valve bodies, etc., shall be date stamped for quality assurance and traceability.

1.4 SUBMITTALS

A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.

B. Manufacturer's Literature and Data:

1. Pipe and equipment supports.
2. Pipe and tubing, with specification, class or type, and schedule.
3. Pipe fittings, including miscellaneous adapters and special fittings.
4. Flanges, gaskets and bolting.
5. Grooved joint couplings and fittings.
6. Valves of all types.
7. Strainers.
8. Flexible connectors for water service.
9. Pipe alignment guides.
10. Expansion joints.
11. Expansion compensators.
12. All specified hydronic system components.
13. Water flow measuring devices.
14. Gages.
15. Thermometers and test wells.
16. Electric heat tracing systems.

C. Manufacturer's certified data report, Form No. U-1, for ASME pressure vessels:

1. Air separators.
2. Expansion tanks.

D. Submit the welder's qualifications in the form of a current (less than one year old) and formal certificate.

E. Coordination Drawings: Refer to Article, SUBMITTALS of Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.

F. As-Built Piping Diagrams: Provide drawing as follows for chilled water, condenser water, and heating hot water system and other piping systems and equipment.

1. One wall-mounted stick file with complete set of prints. Mount stick file in the chiller plant or control room along with control diagram stick file.
2. One complete set of reproducible drawings.
3. One complete set of drawings in electronic Autocad and pdf format.

1.5 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only. American National Standards Institute, Inc.
- B. American Society of Mechanical Engineers/American National Standards Institute, Inc. (ASME/ANSI):
 - B1.20.1-83(R2006).....Pipe Threads, General Purpose (Inch)
 - B16.4-06.....Gray Iron Threaded Fittings B16.18-01 Cast
Copper Alloy Solder joint Pressure fittings
 - B16.23-02.....Cast Copper Alloy Solder joint Drainage
fittings
 - B40.100-05.....Pressure Gauges and Gauge Attachments
- C. American National Standards Institute, Inc./Fluid Controls Institute (ANSI/FCI):
 - 70-2-2006.....Control Valve Seat Leakage
- D. American Society of Mechanical Engineers (ASME):
 - B16.1-98.....Cast Iron Pipe Flanges and Flanged Fittings
 - B16.3-2006.....Malleable Iron Threaded Fittings: Class 150 and
300
 - B16.4-2006.....Gray Iron Threaded Fittings: (Class 125 and
250)
 - B16.5-2003.....Pipe Flanges and Flanged Fittings: NPS ½
through NPS 24 Metric/Inch Standard
 - B16.9-07.....Factory Made Wrought Butt Welding Fittings
 - B16.11-05.....Forged Fittings, Socket Welding and Threaded
 - B16.18-01.....Cast Copper Alloy Solder Joint Pressure
Fittings
 - B16.22-01.....Wrought Copper and Bronze Solder Joint Pressure
Fittings.
 - B16.24-06.....Cast Copper Alloy Pipe Flanges and Flanged
Fittings
 - B16.39-06.....Malleable Iron Threaded Pipe Unions
 - B16.42-06.....Ductile Iron Pipe Flanges and Flanged Fittings

B31.1-08.....	Power Piping
E. American Society for Testing and Materials (ASTM):	
A47/A47M-99 (2004).....	Ferritic Malleable Iron Castings
A53/A53M-07.....	Standard Specification for Pipe, Steel, Black and Hot-Dipped, Zinc-Coated, Welded and Seamless
A106/A106M-08.....	Standard Specification for Seamless Carbon Steel Pipe for High-Temperature Service
A126-04.....	Standard Specification for Gray Iron Castings for Valves, Flanges, and Pipe Fittings
A183-03	Standard Specification for Carbon Steel Track Bolts and Nuts
A216/A216M-08	Standard Specification for Steel Castings, Carbon, Suitable for Fusion Welding, for High Temperature Service
A234/A234M-07	Piping Fittings of Wrought Carbon Steel and Alloy Steel for Moderate and High Temperature Service
A307-07	Standard Specification for Carbon Steel Bolts and Studs, 60,000 PSI Tensile Strength
A536-84 (2004)	Standard Specification for Ductile Iron Castings
A615/A615M-08	Deformed and Plain Carbon Steel Bars for Concrete Reinforcement
A653/A 653M-08	Steel Sheet, Zinc-Coated (Galvanized) or Zinc- Iron Alloy Coated (Galvannealed) By the Hot-Dip Process
B32-08	Standard Specification for Solder Metal
B62-02	Standard Specification for Composition Bronze or Ounce Metal Castings
B88-03	Standard Specification for Seamless Copper Water Tube
B209-07	Aluminum and Aluminum Alloy Sheet and Plate
C177-04	Standard Test Method for Steady State Heat Flux Measurements and Thermal Transmission Properties by Means of the Guarded Hot Plate Apparatus
C478-09	Precast Reinforced Concrete Manhole Sections
C533-07	Calcium Silicate Block and Pipe Thermal Insulation

- C552-07 Cellular Glass Thermal Insulation
- D3350-08 Polyethylene Plastics Pipe and Fittings
Materials
- C591-08 Unfaced Preformed Rigid Cellular
Polyisocyanurate Thermal Insulation
- D1784-08 Rigid Poly (Vinyl Chloride) (PVC) Compounds and
Chlorinated Poly (Vinyl Chloride) (CPVC)
Compound
- D1785-06 Poly (Vinyl Chloride) (PVC) Plastic Pipe,
Schedules 40, 80 and 120
- D2241-05 Poly (Vinyl Chloride) (PVC) Pressure Rated Pipe
(SDR Series)
- F439-06 Standard Specification for Chlorinated Poly
(Vinyl Chloride) (CPVC) Plastic Pipe Fittings,
Schedule 80
- F441/F441M-02 Standard Specification for Chlorinated Poly
(Vinyl Chloride) (CPVC) Plastic Pipe, Schedules
40 and 80
- F477-08 Elastomeric Seals Gaskets) for Joining Plastic
Pipe
- F. American Water Works Association (AWWA):
- C110-08.....Ductile Iron and Grey Iron Fittings for Water
- C203-02.....Coal Tar Protective Coatings and Linings for
Steel Water Pipe Lines Enamel and Tape Hot
Applied
- G. American Welding Society (AWS):
- B2.1-02.....Standard Welding Procedure Specification
- H. Copper Development Association, Inc. (CDA):
- CDA A4015-06.....Copper Tube Handbook
- I. Expansion Joint Manufacturer's Association, Inc. (EJMA):
- EMJA-2003.....Expansion Joint Manufacturer's Association
Standards, Ninth Edition
- J. Manufacturers Standardization Society (MSS) of the Valve and Fitting
Industry, Inc.:
- SP-67-02a.....Butterfly Valves
- SP-70-06.....Gray Iron Gate Valves, Flanged and Threaded
Ends

- SP-71-05.....Gray Iron Swing Check Valves, Flanged and Threaded Ends
- SP-80-08.....Bronze Gate, Globe, Angle and Check Valves
- SP-85-02.....Cast Iron Globe and Angle Valves, Flanged and Threaded Ends
- SP-110-96.....Ball Valves Threaded, Socket-Welding, Solder Joint, Grooved and Flared Ends
- SP-125-00.....Gray Iron and Ductile Iron In-line, Spring Loaded, Center-Guided Check Valves
- K. National Sanitation Foundation/American National Standards Institute, Inc. (NSF/ANSI):
 - 14-06.....Plastic Piping System Components and Related Materials
 - 50-2009a.....Equipment for Swimming Pools, Spas, Hot Tubs and other Recreational Water Facilities - Evaluation criteria for materials, components, products, equipment and systems for use at recreational water facilities
 - 61-2008.....Drinking Water System Components - Health Effects
- L. Tubular Exchanger Manufacturers Association: TEMA 9th Edition, 2007

1.6 SPARE PARTS

- A. For mechanical pressed sealed fittings provide tools required for each pipe size used at the facility.

PART 2 - PRODUCTS

2.1 PIPE AND EQUIPMENT SUPPORTS, PIPE SLEEVES, AND WALL AND CEILING PLATES

- A. Provide in accordance with Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.

2.2 PIPE AND TUBING

- A. Chilled Water, Heating Hot Water, and Vent Piping:
 - 1. Steel: ASTM A53 Grade B, seamless or ERW, Schedule 40.
 - 2. Copper water tube option: ASTM B88, Type K or L, hard drawn.
- B. Extension of Domestic Water Make-up Piping: ASTM B88, Type K or L, hard drawn copper tubing.
- C. Cooling Coil Condensate Drain Piping:
 - 1. From air handling units: Copper water tube, ASTM B88, Type M, or schedule 40 PVC plastic piping.

- 2. From fan coil or other terminal units: Copper water tube, ASTM B88, Type L for runouts and Type M for mains.
- D. Pipe supports, including insulation shields, for above ground piping: Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.

2.3 FITTINGS FOR STEEL PIPE

- A. 50 mm (2 inches) and Smaller: Screwed or welded joints.
 - 1. Butt welding: ASME B16.9 with same wall thickness as connecting piping.
 - 2. Forged steel, socket welding or threaded: ASME B16.11.
 - 3. Screwed: 150 pound malleable iron, ASME B16.3. 125 pound cast iron, ASME B16.4, may be used in lieu of malleable iron. Bushing reduction of a single pipe size, or use of close nipples, is not acceptable.
 - 4. Unions: ASME B16.39.
 - 5. Water hose connection adapter: Brass, pipe thread to 20 mm (3/4 inch) garden hose thread, with hose cap nut.
- B. 65 mm (2-1/2 inches) and Larger: Welded or flanged joints. Contractor's option: Grooved mechanical couplings and fittings are optional.
 - 1. Butt welding fittings: ASME B16.9 with same wall thickness as connecting piping. Elbows shall be long radius type, unless otherwise noted.
 - 2. Welding flanges and bolting: ASME B16.5:
 - a. Water service: Weld neck or slip-on, plain face, with 6 mm (1/8 inch) thick full face neoprene gasket suitable for 104 degrees C (220 degrees F).
 - 1) Contractor's option: Convuluted, cold formed 150 pound steel flanges, with teflon gaskets, may be used for water service.
 - b. Flange bolting: Carbon steel machine bolts or studs and nuts, ASTM A307, Grade B.
- C. Welded Branch and Tap Connections: Forged steel weldolets, or branchlets and threadolets may be used for branch connections up to one pipe size smaller than the main. Forged steel half-couplings, ASME B16.11 may be used for drain, vent and gage connections.
- D. Grooved Mechanical Pipe Couplings and Fittings (Contractor's Option): Grooved Mechanical Pipe Couplings and Fittings may be used, with cut or roll grooved pipe, in water service up to 110 degrees C (230 degrees F) in lieu of welded, screwed or flanged connections. All joints must be rigid type.

1. Grooved mechanical couplings: Malleable iron, ASTM A47 or ductile iron, ASTM A536, fabricated in two or more parts, securely held together by two or more track-head, square, or oval-neck bolts, ASTM A449 and A183.
2. Gaskets: Rubber product recommended by the coupling manufacturer for the intended service.
3. Grooved end fittings: Malleable iron, ASTM A47; ductile iron, ASTM A536; or steel, ASTM A53 or A106, designed to accept grooved mechanical couplings. Tap-in type branch connections are acceptable.

2.4 FITTINGS FOR COPPER TUBING

A. Joints:

1. Solder Joints: Joints shall be made up in accordance with recommended practices of the materials applied. Apply 95/5 tin and antimony on all copper piping.
2. Contractor's Option: Mechanical press sealed fittings, double pressed type, NSF 50/61 approved, with EPDM (ethylene propylene diene monomer) non-toxic synthetic rubber sealing elements for up to 65 mm (2-1/2 inch) and below are optional for above ground water piping only.
3. Mechanically formed tee connection in water and drain piping: Form mechanically extracted collars in a continuous operation by drilling pilot hole and drawing out tube surface to form collar, having a height of not less than three times the thickness of tube wall. Adjustable collaring device shall insure proper tolerance and complete uniformity of the joint. Notch and dimple joining branch tube in a single process to provide free flow where the branch tube penetrates the fitting.

B. Bronze Flanges and Flanged Fittings: ASME B16.24.

C. Fittings: ANSI/ASME B16.18 cast copper or ANSI/ASME B16.22 solder wrought copper.

2.5 FITTINGS FOR PLASTIC PIPING

- A. Schedule 40, socket type for solvent welding.
- B. Schedule 40 PVC drain piping: Drainage pattern.
- C. Chemical feed piping for condenser water treatment: Chlorinated polyvinyl chloride (CPVC), Schedule 80, ASTM F439.

2.6 DIELECTRIC FITTINGS

- A. Provide where copper tubing and ferrous metal pipe are joined.
- B. 50 mm (2 inches) and Smaller: Threaded dielectric union, ASME B16.39.

- C. 65 mm (2 1/2 inches) and Larger: Flange union with dielectric gasket and bolt sleeves, ASME B16.42.
- D. Temperature Rating, 99 degrees C (210 degrees F).
- E. Contractor's option: On pipe sizes 2" and smaller, screwed end brass ball valves or dielectric nipples may be used in lieu of dielectric unions.

2.7 SCREWED JOINTS

- A. Pipe Thread: ANSI B1.20.
- B. Lubricant or Sealant: Oil and graphite or other compound approved for the intended service.

2.8 VALVES

- A. Asbestos packing is not acceptable.
- B. All valves of the same type shall be products of a single manufacturer.
- C. Provide chain operators for valves 150 mm (6 inches) and larger when the centerline is located 2400 mm (8 feet) or more above the floor or operating platform.
- D. Shut-Off Valves
 - 1. Ball Valves (Pipe sizes 2" and smaller): MSS-SP 110, screwed or solder connections, brass or bronze body with chrome-plated ball with full port and Teflon seat at 2760 kPa (400 psig) working pressure rating. Provide stem extension to allow operation without interfering with pipe insulation.
 - 2. Butterfly Valves (Pipe Sizes 2-1/2" and larger): Provide stem extension to allow 50 mm (2 inches) of pipe insulation without interfering with valve operation. MSS-SP 67, flange lug type or grooved end rated 1205 kPa (175 psig) working pressure at 93 degrees C (200 degrees F). Valves shall be ANSI Leakage Class VI and rated for bubble tight shut-off to full valve pressure rating. Valve shall be rated for dead end service and bi-directional flow capability to full rated pressure. Not permitted for direct buried pipe applications.
 - a. Body: Cast iron, ASTM A126, Class B. Malleable iron, ASTM A47 electro-plated, or ductile iron, ASTM A536, Grade 65-45-12 electro-plated.
 - b. Trim: Bronze, aluminum bronze, or 300 series stainless steel disc, bronze bearings, 316 stainless steel shaft and manufacturer's recommended resilient seat. Resilient seat shall be field replaceable, and fully line the body to completely

isolate the body from the product. A phosphate coated steel shaft or stem is acceptable, if the stem is completely isolated from the product.

- c. Actuators: Field interchangeable. Valves for balancing service shall have adjustable memory stop to limit open position.
 - 1) Valves 150 mm (6 inches) and smaller: Lever actuator with minimum of seven locking positions, except where chain wheel is required.
 - 2) Valves 200 mm (8 inches) and larger: Enclosed worm gear with handwheel, and where required, chain-wheel operator.
 - 3) 3. Gate Valves (Contractor's Option in lieu of Ball or Butterfly Valves):
 - a) 50 mm (2 inches) and smaller: MSS-SP 80, Bronze, 1034 kPa (150 psig), wedge disc, rising stem, union bonnet.
 - b) 65 mm (2 1/2 inches) and larger: Flanged, outside screw and yoke. MSS-SP 70, iron body, bronze mounted, 861 kPa (125 psig) wedge disc.

E. Globe and Angle Valves

1. Globe Valves

- a. 50 mm (2 inches) and smaller: MSS-SP 80, bronze, 1034 kPa (150 lb.) Globe valves shall be union bonnet with metal plug type disc.
- b. 65 mm (2 1/2 inches) and larger: 861 kPa (125 psig), flanged, iron body, bronze trim, MSS-SP-85 for globe valves.

2. Angle Valves:

- a. 50 mm (2 inches) and smaller: MSS-SP 80, bronze, 1034 kPa (150 lb.) Angle valves shall be union bonnet with metal plug type disc.
- b. 65 mm (2 1/2 inches) and larger: 861 kPa (125 psig), flanged, iron body, bronze trim, MSS-SP-85 for angle.

F. Check Valves

1. Swing Check Valves:

- a. 50 mm (2 inches) and smaller: MSS-SP 80, bronze, 1034 kPa (150 lb.), 45 degree swing disc.
- b. 65 mm (2 1/2 inches) and larger: 861 kPa (125 psig), flanged, iron body, bronze trim, MSS-SP-71 for check valves.

- 2. Non-Slam or Silent Check Valve: Spring loaded double disc swing check or internally guided flat disc lift type check for bubble

tight shut-off. Provide where check valves are shown in chilled water and hot water piping. Check valves incorporating a balancing feature may be used.

- a. Body: MSS-SP 125 cast iron, ASTM A126, Class B, or steel, ASTM A216, Class WCB, or ductile iron, ASTM 536, flanged, grooved, or wafer type.
- b. Seat, disc and spring: 18-8 stainless steel, or bronze, ASTM B62. Seats may be elastomer material.

G. Water Flow Balancing Valves: For flow regulation and shut-off. Valves shall be line size rather than reduced to control valve size.

- 1. Ball style valve.
- 2. A dual purpose flow balancing valve and adjustable flow meter, with bronze or cast iron body, calibrated position pointer, valved pressure taps or quick disconnects with integral check valves and preformed polyurethane insulating enclosure.
- 3. Provide a readout kit including flow meter, readout probes, hoses, flow charts or calculator, and carrying case.

H. Automatic Balancing Control Valves: Factory calibrated to maintain constant flow (plus or minus five percent) over system pressure fluctuations of at least 10 times the minimum required for control. Provide standard pressure taps and four sets of capacity charts. Valves shall be line size and be one of the following designs:

- 1. Gray iron (ASTM A126) or brass body rated 1205 kPa (175 psig) at 93 degrees C (200 degrees F), with stainless steel piston and spring.
- 2. Brass or ferrous body designed for 2067 kPa (300 psig) service at 121 degrees C (250 degrees F), with corrosion resistant, tamper proof, self-cleaning piston/spring assembly that is easily removable for inspection or replacement.
- 3. Combination assemblies containing ball type shut-off valves, unions, flow regulators, strainers with blowdown valves and pressure temperature ports shall be acceptable.
- 4. Provide a readout kit including flow meter, probes, hoses, flow charts and carrying case.

2.9 WATER FLOW MEASURING DEVICES

A. Minimum overall accuracy plus or minus three percent over a range of 70 to 110 percent of design flow. Select devices for not less than 110 percent of design flow rate.

- B. Venturi Type: Bronze, steel, or cast iron with bronze throat, with valved pressure sensing taps upstream and at the throat.
- C. Wafer Type Circuit Sensor: Cast iron wafer-type flow meter equipped with readout valves to facilitate the connecting of a differential pressure meter. Each readout valve shall be fitted with an integral check valve designed to minimize system fluid loss during the monitoring process.
- D. Self-Averaging Annular Sensor Type: Brass or stainless steel metering tube, shutoff valves and quick-coupling pressure connections. Metering tube shall be rotatable so all sensing ports may be pointed down-stream when unit is not in use.
- E. Insertion Turbine Type Sensor: Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC.
- F. Flow Measuring Device Identification:
 - 1. Metal tag attached by chain to the device.
 - 2. Include meter or equipment number, manufacturer's name, meter model, flow rate factor and design flow rate in l/m (gpm).
- G. Portable Water Flow Indicating Meters:
 - 1. Minimum 150 mm (6 inch) diameter dial, forged brass body, beryllium-copper bellows, designed for 1205 kPa (175 psig) working pressure at 121 degrees C (250 degrees F).
 - 2. Bleed and equalizing valves.
 - 3. Vent and drain hose and two 3000 mm (10 feet) lengths of hose with quick disconnect connections.
 - 4. Factory fabricated carrying case with hose compartment and a bound set of capacity curves showing flow rate versus pressure differential.
 - 5. Provide one portable meter for each range of differential pressure required for the installed flow devices.
- H. Permanently Mounted Water Flow Indicating Meters: Minimum 150 mm (6 inch) diameter, or 450 mm (18 inch) long scale, for 120 percent of design flow rate, direct reading in lps (gpm), with three valve manifold and two shut-off valves.

2.10 STRAINERS

- A. Y Type.
 - 1. Screens: Bronze, monel metal or 18-8 stainless steel, free area not less than 2-1/2 times pipe area, with perforations as follows: 1.1

mm (0.045 inch) diameter perforations for 100 mm (4 inches) and larger: 3.2 mm (0.125 inch) diameter perforations.

B. Suction Diffusers: Specified in Section 23 21 23, HYDRONIC PUMPS.

2.11 FLEXIBLE CONNECTORS FOR WATER SERVICE

A. Flanged Spool Connector:

1. Single arch or multiple arch type. Tube and cover shall be constructed of chlorobutyl elastomer with full faced integral flanges to provide a tight seal without gaskets. Connectors shall be internally reinforced with high strength synthetic fibers impregnated with rubber or synthetic compounds as recommended by connector manufacturer, and steel reinforcing rings.
2. Working pressures and temperatures shall be as follows:
 - a. Connector sizes 50 mm to 100 mm (2 inches to 4 inches), 1137 kPa (165psig) at 121 degrees C (250 degrees F).
 - b. Connector sizes 125 mm to 300 mm (5 inches to 12 inches), 965 kPa (140 psig) at 121 degrees C (250 degrees F).
3. Provide ductile iron retaining rings and control units.

B. Mechanical Pipe Couplings:

See other fittings specified under Part 2, PRODUCTS.

2.12 EXPANSION JOINTS

- A. Factory built devices, inserted in the pipe lines, designed to absorb axial cyclical pipe movement which results from thermal expansion and contraction. This includes factory-built or field-fabricated guides located along the pipe lines to restrain lateral pipe motion and direct the axial pipe movement into the expansion joints.
- B. Manufacturing Quality Assurance: Conform to Expansion Joints Manufacturers Association Standards.
- C. Bellows - Internally Pressurized Type:
 1. Multiple corrugations of Type 304 or Type A240-321 stainless steel.
 2. Internal stainless steel sleeve entire length of bellows.
 3. External cast iron equalizing rings for services exceeding 340 kPa (50 psig).
 4. Welded ends.
 5. Design shall conform to standards of EJMA and ASME B31.1.
 6. External tie rods designed to withstand pressure thrust force upon anchor failure if one or both anchors for the joint are at change in direction of pipeline.
 7. Integral external cover.

- D. Bellows - Externally Pressurized Type:
 - 1. Multiple corrugations of Type 304 stainless steel.
 - 2. Internal and external guide integral with joint.
 - 3. Design for external pressurization of bellows to eliminate squirm.
 - 4. Welded ends.
 - 5. Conform to the standards of EJMA and ASME B31.1.
 - 6. Threaded connection at bottom, 25 mm (one inch) minimum, for drain or drip point.
 - 7. Integral external cover and internal sleeve.
- E. Expansion Compensators:
 - 1. Corrugated bellows, externally pressurized, stainless steel or bronze.
 - 2. Internal guides and anti-torque devices.
 - 3. Threaded ends.
 - 4. External shroud.
 - 5. Conform to standards of EJMA.
- F. Expansion Joint (Contractor's Option): 2415 kPa (350 psig) maximum working pressure, steel pipe fitting consisting of telescoping body and slip-pipe sections, PTFE modified polyphenylene sulfide coated slide section, with grooved ends, suitable for axial end movement to 75 mm (3 inch).
- G. Expansion Joint Identification: Provide stamped brass or stainless steel nameplate on each expansion joint listing the manufacturer, the allowable movement, flow direction, design pressure and temperature, date of manufacture, and identifying the expansion joint by the identification number on the contract drawings.
- H. Guides: Provide factory-built guides along the pipe line to permit axial movement only and to restrain lateral and angular movement. Guides must be designed to withstand a minimum of 15 percent of the axial force which will be imposed on the expansion joints and anchors. Field-built guides may be used if detailed on the contract drawings.
- I. Supports: Provide saddle supports and frame or hangers for heat exchanger. Mounting height shall be adjusted to facilitate gravity return of steam condensate. Construct supports from steel, weld joints.

2.13 HYDRONIC SYSTEM COMPONENTS

- A. Air Purger: Cast iron or fabricated steel, 861 kPa (125 psig) water working pressure, for in-line installation.

- B. Tangential Air Separator: ASME Pressure Vessel Code construction for 861 kPa (125 psig) working pressure, flanged tangential inlet and outlet connection, internal perforated stainless steel air collector tube designed to direct released air into expansion tank, bottom blowdown connection. Provide Form No. U-1. If scheduled on the drawings, provide a removable stainless steel strainer element having 5 mm (3/16 inch) perforations and free area of not less than five times the cross-sectional area of connecting piping.
- C. Diaphragm Type Pre-Pressurized Expansion Tank: ASME Pressure Vessel Code construction for 861 kPa (125 psig) working pressure, welded steel shell, rust-proof coated, with a flexible elastomeric diaphragm suitable for a maximum operating temperature of 116 degrees C (240 degrees F). Provide Form No. U-1. Tank shall be equipped with system connection, drain connection, standard air fill valve and be factory pre-charged to a minimum of 83 kPa (12 psig).
- D. Pressure Reducing Valve (Water): Diaphragm or bellows operated, spring loaded type, with minimum adjustable range of 28 kPa (4 psig) above and below set point. Bronze, brass or iron body and bronze, brass or stainless steel trim, rated 861 kPa (125 psig) working pressure at 107 degrees C (225 degrees F).
- E. Pressure Relief Valve: Bronze or iron body and bronze or stainless steel trim, with testing lever. Comply with ASME Code for Pressure Vessels, Section 8, and bear ASME stamp.
- F. Automatic Air Vent Valves (where shown): Cast iron or semi-steel body, 1034 kPa (150 psig) working pressure, stainless steel float, valve, valve seat and mechanism, minimum 15 mm (1/2 inch) water connection and 6 mm (1/4 inch) air outlet. Air outlet shall be piped to the nearest floor drain.

2.14 WATER FILTERS AND POT CHEMICAL FEEDERS

See section 23 25 00, HVAC WATER TREATMENT, Article 2.2, CHEMICAL TREATMENT FOR CLOSED LOOP SYSTEMS.

2.15 GAGES, PRESSURE AND COMPOUND

- A. ASME B40.100, Accuracy Grade 1A, (pressure, vacuum, or compound for air, oil or water), initial mid-scale accuracy 1 percent of scale (Qualify grade), metal or phenolic case, 115 mm (4-1/2 inches) in diameter, 6 mm (1/4 inch) NPT bottom connection, white dial with black graduations and pointer, clear glass or acrylic plastic window,

suitable for board mounting. Provide red "set hand" to indicate normal working pressure.

- B. Provide brass lever handle union cock. Provide brass/bronze pressure snubber for gages in water service.
- C. Range of Gages: Provide range equal to at least 130 percent of normal operating range.
 - 1. For condenser water suction (compound): Minus 100 kPa (30 inches Hg) to plus 700 kPa (100 psig).

2.16 PRESSURE/TEMPERATURE TEST PROVISIONS

- A. Pete's Plug: 6 mm (1/4 inch) MPT by 75 mm (3 inches) long, brass body and cap, with retained safety cap, nodel self-closing valve cores, permanently installed in piping where shown, or in lieu of pressure gage test connections shown on the drawings.
- B. Provide one each of the following test items to the Resident Engineer:
 - 1. 6 mm (1/4 inch) FPT by 3 mm (1/8 inch) diameter stainless steel pressure gage adapter probe for extra long test plug. PETE'S 500 XL is an example.
 - 2. 90 mm (3-1/2 inch) diameter, one percent accuracy, compound gage, -- 100 kPa (30 inches) Hg to 700 kPa (100 psig) range.
 - 3. 0 - 104 degrees C (220 degrees F) pocket thermometer one-half degree accuracy, 25 mm (one inch) dial, 125 mm (5 inch) long stainless steel stem, plastic case.

2.17 THERMOMETERS

- A. Mercury or organic liquid filled type, red or blue column, clear plastic window, with 150 mm (6 inch) brass stem, straight, fixed or adjustable angle as required for each in reading.
- B. Case: Chrome plated brass or aluminum with enamel finish.
- C. Scale: Not less than 225 mm (9 inches), range as described below, two degree graduations.
- D. Separable Socket (Well): Brass, extension neck type to clear pipe insulation.
- E. Scale ranges:
 - 1. Chilled Water: 0-38 degrees C (32-100 degrees F).
 - 2. Hot Water: -1 - 116 degrees C (30-240 degrees F).

2.18 FIRESTOPPING MATERIAL

Refer to Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.

2.19 ELECTRICAL HEAT TRACING SYSTEMS

- A. Systems shall meet requirements of the National Electrical Code (NEC), Section 427.
- B. Provide tracing for outdoor piping subject to freezing temperatures (Below 38 degrees F) as follows:
 - 2. Make-up water
 - 3. Chilled water piping at areas exposed to the weather.
 - 4. Domestic water lines exposed to weather.
- C. Heat tracing shall be provided to the extent shown on the drawings (Floor plans and Elevations). Heat tracing shall extend below grade to below the defined frost line.
- D. Heating Cable: Flexible, parallel circuit construction consisting of a continuous self-limiting resistance, conductive inner core material between two parallel copper bus wires, designed for cut-to-length at the job site and for wrapping around valves and complex fittings. Self-regulation shall prevent overheating and burnouts even where the cable overlaps itself.
 - 1. Provide end seals at ends of circuits. Wire at the ends of the circuits is not to be tied together.
 - 2. Provide sufficient cable, as recommended by the manufacturer, to keep the pipe surface at 2.2 degrees C (36 degrees F) minimum during winter outdoor design temperature, but not less than the following:
 - a. 75 mm (3 inch) pipe and smaller with 25 mm (1 inch) thick insulation: 4 watts per foot of pipe.
 - b. 100 mm (4 inch) pipe and larger 38 mm (1-1/2 inch) thick insulation: 8 watts per feet of pipe.
- E. Electrical Heating Tracing Accessories:
 - 1. Power supply connection fitting and stainless steel mounting brackets. Provide stainless steel worm gear clamp to fasten bracket to pipe.
 - 2. 13 mm (1/2 inch) wide fiberglass reinforced pressure sensitive cloth tape to fasten cable to pipe at 300 mm (12 inch) intervals.
 - 3. Pipe surface temperature control thermostat: Cast aluminum, NEMA 4 (watertight) enclosure, 13 mm (1/2 inch) NPT conduit hub, SPST switch rated 20 amps at 480 volts AC, with capillary and copper bulb sensor. Set thermostat to maintain pipe surface temperature at not less than 1.1 degrees C (34 degrees F).

4. Signs: Manufacturer's standard (NEC Code), stamped "ELECTRIC TRACED" located on the insulation jacket at 3000 mm (10 feet) intervals along the pipe on alternating sides.

PART 3 - EXECUTION

3.1 GENERAL

- A. The drawings show the general arrangement of pipe and equipment but do not show all required fittings and offsets that may be necessary to connect pipes to equipment, fan-coils, coils, radiators, etc., and to coordinate with other trades. Provide all necessary fittings, offsets and pipe runs based on field measurements and at no additional cost to the government. Coordinate with other trades for space available and relative location of HVAC equipment and accessories to be connected on ceiling grid. Pipe location on the drawings shall be altered by contractor where necessary to avoid interferences and clearance difficulties.
- B. Store materials to avoid excessive exposure to weather or foreign materials. Keep inside of piping relatively clean during installation and protect open ends when work is not in progress.
- C. Support piping securely. Refer to PART 3, Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION. Install heat exchangers at height sufficient to provide gravity flow of condensate to the flash tank and condensate pump.
- D. Install piping generally parallel to walls and column center lines, unless shown otherwise on the drawings. Space piping, including insulation, to provide 25 mm (one inch) minimum clearance between adjacent piping or other surface. Unless shown otherwise, slope drain piping down in the direction of flow not less than 25 mm (one inch) in 12 m (40 feet). Provide eccentric reducers to keep bottom of sloped piping flat.
- E. Locate and orient valves to permit proper operation and access for maintenance of packing, seat and disc. Generally locate valve stems in overhead piping in horizontal position. Provide a union adjacent to one end of all threaded end valves. Control valves usually require reducers to connect to pipe sizes shown on the drawing. Install butterfly valves with the valve open as recommended by the manufacturer to prevent binding of the disc in the seat.
- F. Offset equipment connections to allow valving off for maintenance and repair with minimal removal of piping. Provide flexibility in equipment

- connections and branch line take-offs with 3-elbow swing joints where noted on the drawings.
- G. Tee water piping runouts or branches into the side of mains or other branches. Avoid bull-head tees, which are two return lines entering opposite ends of a tee and exiting out the common side.
 - H. Provide manual or automatic air vent at all piping system high points and drain valves at all low points. Install piping to floor drains from all automatic air vents.
 - I. Connect piping to equipment as shown on the drawings. Install components furnished by others such as:
 - 1. Water treatment pot feeders and condenser water treatment systems.
 - 2. Flow elements (orifice unions), control valve bodies, flow switches, pressure taps with valve, and wells for sensors.
 - J. Thermometer Wells: In pipes 65 mm (2-1/2 inches) and smaller increase the pipe size to provide free area equal to the upstream pipe area.
 - K. Firestopping: Fill openings around uninsulated piping penetrating floors or fire walls, with firestop material. For firestopping insulated piping refer to Section 23 07 11, HVAC, PLUMBING, and BOILER PLANT INSULATION.
 - L. Where copper piping is connected to steel piping, provide dielectric connections.

3.2 PIPE JOINTS

- A. Welded: Beveling, spacing and other details shall conform to ASME B31.1 and AWS B2.1. See Welder's qualification requirements under "Quality Assurance" in Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.
- B. Screwed: Threads shall conform to ASME B1.20; joint compound shall be applied to male threads only and joints made up so no more than three threads show. Coat exposed threads on steel pipe with joint compound, or red lead paint for corrosion protection.
- C. Mechanical Joint: Pipe grooving shall be in accordance with joint manufacturer's specifications. Lubricate gasket exterior including lips, pipe ends and housing interiors to prevent pinching the gasket during installation. Lubricant shall be as recommended by coupling manufacturer.
- D. 125 Pound Cast Iron Flange (Plain Face): Mating flange shall have raised face, if any, removed to avoid overstressing the cast iron flange.

E. Solvent Welded Joints: As recommended by the manufacturer.

3.3 EXPANSION JOINTS (BELLOWS AND SLIP TYPE)

- A. Anchors and Guides: Provide type, quantity and spacing as recommended by manufacturer of expansion joint and as shown. A professional engineer shall verify in writing that anchors and guides are properly designed for forces and moments which will be imposed.
- B. Cold Set: Provide setting of joint travel at installation as recommended by the manufacturer for the ambient temperature during the installation.
- C. Preparation for Service: Remove all apparatus provided to restrain joint during shipping or installation. Representative of manufacturer shall visit the site and verify that installation is proper.
- D. Access: Expansion joints must be located in readily accessible space. Locate joints to permit access without removing piping or other devices. Allow clear space to permit replacement of joints and to permit access to devices for inspection of all surfaces and for adding.

3.4 LEAK TESTING ABOVEGROUND PIPING

- A. Inspect all joints and connections for leaks and workmanship and make corrections as necessary, to the satisfaction of the Resident Engineer. Tests may be either of those below, or a combination, as approved by the Resident Engineer.
- B. An operating test at design pressure, and for hot systems, design maximum temperature.
- C. A hydrostatic test at 1.5 times design pressure. For water systems the design maximum pressure would usually be the static head, or expansion tank maximum pressure, plus pump head. Factory tested equipment (convertors, exchangers, coils, etc.) need not be field tested. Isolate equipment where necessary to avoid excessive pressure on mechanical seals and safety devices.

3.5 FLUSHING AND CLEANING PIPING SYSTEMS

- A. Water Piping: Clean systems as recommended by the suppliers of chemicals specified in Section 23 25 00, HVAC WATER TREATMENT.
 - 1. Initial flushing: Remove loose dirt, mill scale, metal chips, weld beads, rust, and like deleterious substances without damage to any system component. Provide temporary piping or hose to bypass coils, control valves, exchangers and other factory cleaned equipment unless acceptable means of protection are provided and subsequent inspection of hide-out areas takes place. Isolate or protect clean

system components, including pumps and pressure vessels, and remove any component which may be damaged. Open all valves, drains, vents and strainers at all system levels. Remove plugs, caps, spool pieces, and components to facilitate early debris discharge from system. Sectionalize system to obtain debris carrying velocity of 1.8 m/S (6 feet per second), if possible. Connect dead-end supply and return headers as necessary. Flush bottoms of risers. Install temporary strainers where necessary to protect down-stream equipment. Supply and remove flushing water and drainage by various type hose, temporary and permanent piping and Contractor's booster pumps. Flush until clean as approved by the Resident Engineer.

2. Cleaning: Using products supplied in Section 23 25 00, HVAC WATER TREATMENT, circulate systems at normal temperature to remove adherent organic soil, hydrocarbons, flux, pipe mill varnish, pipe joint compounds, iron oxide, and like deleterious substances not removed by flushing, without chemical or mechanical damage to any system component. Removal of tightly adherent mill scale is not required. Keep isolated equipment which is "clean" and where dead-end debris accumulation cannot occur. Sectionalize system if possible, to circulate at velocities not less than 1.8 m/S (6 feet per second). Circulate each section for not less than four hours. Blow-down all strainers, or remove and clean as frequently as necessary. Drain and prepare for final flushing.
3. Final Flushing: Return systems to conditions required by initial flushing after all cleaning solution has been displaced by clean make-up. Flush all dead ends and isolated clean equipment. Gently operate all valves to dislodge any debris in valve body by throttling velocity. Flush for not less than one hour.

3.6 WATER TREATMENT

- A. Install water treatment equipment and provide water treatment system piping.
- B. Close and fill system as soon as possible after final flushing to minimize corrosion.
- C. Charge systems with chemicals specified in Section 23 25 00, HVAC WATER TREATMENT.
- D. Utilize this activity, by arrangement with the Resident Engineer, for instructing VA operating personnel.

3.7 ELECTRIC HEAT TRACING

- A. Install tracing as recommended by the manufacturer.
- B. Coordinate electrical connections.

3.8 OPERATING AND PERFORMANCE TEST AND INSTRUCTION

- A. Refer to PART 3, Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.
- B. Adjust red set hand on pressure gages to normal working pressure.

- - - E N D - - -

RORSECTION 23 21 23
HYDRONIC PUMPS

PART 1 - GENERAL

1.1 DESCRIPTION

- A. Hydronic pumps for Heating, Ventilating and Air Conditioning.

1.2 RELATED WORK

- A. Section 01 00 00, GENERAL REQUIREMENTS.
- B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- C. Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.
- D. Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING and EQUIPMENT.
- E. Section 23 21 13, HYDRONIC PIPING.
- F. Section 23 05 12, GENERAL MOTOR REQUIREMENTS FOR HVAC and STEAM GENERATION EQUIPMENT.
- G. Section 26 29 11, LOW-VOLTAGE MOTOR STARTERS.

1.3 QUALITY ASSURANCE

- A. Refer to Paragraph, QUALITY ASSURANCE, in Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.
- B. Design Criteria:
1. Pumps design and manufacturer shall conform to Hydraulic Institute Standards.
 2. Pump sizes, capacities, pressures, operating characteristics and efficiency shall be as scheduled.
 3. Head-capacity curves shall slope up to maximum head at shut-off. Curves shall be relatively flat for closed systems. Select pumps near the midrange of the curve, so the design capacity falls to the left of the best efficiency point, to allow a cushion for the usual drift to the right in operation, without approaching the pump curve end point and possible cavitation and unstable operation. Select pumps for open systems so that required net positive suction head (NPSHR) does not exceed the net positive head available (NPSHA).
 4. Pump Driver: Furnish with pump. Size shall be non-overloading at any point on the head-capacity curve, including in a parallel or series pumping installation with one pump in operation.
 5. Provide all pumps with motors, impellers, drive assemblies, bearings, coupling guard and other accessories specified. Statically and dynamically balance all rotating parts.

6. Furnish each pump and motor with a nameplate giving the manufacturers name, serial number of pump, capacity in GPM and head in feet at design condition, horsepower, voltage, frequency, speed and full load current and motor efficiency.
 7. Test all pumps before shipment. The manufacturer shall certify all pump ratings.
 8. After completion of balancing, provide replacement of impellers or trim impellers to provide specified flow at actual pumping head, as installed.
- C. Allowable Vibration Tolerance for Pump Units: Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING and EQUIPMENT.

1.4 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Manufacturer's Literature and Data:
 1. Pumps and accessories.
 2. Motors and drives.
- C. Manufacturer's installation, maintenance and operating instructions, in accordance with Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.
- D. Characteristic Curves: Head-capacity, efficiency-capacity, brake horsepower-capacity, and NPSHR-capacity for each pump and for combined pumps in parallel or series service. Identify pump and show fluid pumped, specific gravity, pump speed and curves plotted from zero flow to maximum for the impeller being furnished and at least the maximum diameter impeller that can be used with the casing.

1.5 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only:
- B. American Iron and Steel Institute (AISI):
 - AISI 1045.....Cold Drawn Carbon Steel Bar, Type 1045
 - AISI 416.....Type 416 Stainless Steel
- C. American National Standards Institute (ANSI):
 - ANSI B15.1-00(R2008)..... Safety Standard for Mechanical Power Transmission Apparatus
 - ANSI B16.1-05.....Cast Iron Pipe Flanges and Flanged Fittings, Class 25, 125, 250 and 800

- D. American Society for Testing and Materials (ASTM):
 - A48-03 (2008).....Standard Specification for Gray Iron Castings
 - B62-2009.....Standard Specification for Composition Bronze
or Ounce Metal Castings
- E. Maintenance and Operating Manuals in accordance with Section 01 00 00,
General Requirements.

1.6 DEFINITIONS

- A. Capacity: Liters per second (L/s) (Gallons per minute (GPM) of the
fluid pumped.
- B. Head: Total dynamic head in kPa (feet) of the fluid pumped.
- C. Flat head-capacity curve: Where the shutoff head is less than 1.16
times the head at the best efficiency point.

1.7 SPARE MATERIALS

- A. Furnish one spare seal and casing gasket for each pump to the
Contracting Officer's Technical Representative (COTR).

PART 2 - PRODUCTS

2.1 CENTRIFUGAL PUMPS, BRONZE FITTED

- A. General:
 - 1. Provide pumps that will operate continuously without overheating
bearings or motors at every condition of operation on the pump
curve, or produce noise audible outside the room or space in which
installed.
 - 2. Provide pumps of size, type and capacity as indicated, complete with
electric motor and drive assembly, unless otherwise indicated.
Design pump casings for the indicated working pressure and factory
test at 1½ times the designed pressure.
 - 3. Provide pumps of the same type, the product of a single
manufacturer, with pump parts of the same size and type
interchangeable.
 - 4. General Construction Requirements
 - a. Balance: Rotating parts, statically and dynamically.
 - b. Construction: To permit servicing without breaking piping or
motor connections.
 - c. Pump Motors: Provide high efficiency motors, inverter duty for
variable speed service. Refer to Section 23 05 12, GENERAL MOTOR
REQUIREMENTS FOR HVAC and STEAM GENERATION EQUIPMENT. Motors
shall be Open Drip Proof and operate at 1750 rpm unless noted
otherwise.

- d. Heating pumps shall be suitable for handling water to 225°F.
 - e. Provide coupling guards that meet ANSI B15.1, Section 8 and OSHA requirements.
 - f. Pump Connections: Flanged.
 - g. Pump shall be factory tested.
 - h. Performance: As scheduled on the Contract Drawings.
- B. In-Line Type, Base Mounted End Suction Type:
- 1. Casing and Bearing Housing: Close-grained cast iron, ASTM A48.
 - 2. Casing Wear Rings: Bronze.
 - 3. Suction and Discharge: Plain face flange, 850 kPa (125 psig), ANSI B16.1.
 - 4. Casing Vent: Manual brass cock at high point.
 - 5. Casing Drain and Gage Taps: 15 mm (1/2-inch) plugged connections minimum size.
 - 6. Impeller: Bronze, ASTM B62, enclosed type, keyed to shaft.
 - 7. Shaft: Steel, AISI Type 1045 or stainless steel.
 - 8. Shaft Seal: Manufacturer's standard mechanical type to suit pressure and temperature and fluid pumped.
 - 9. Shaft Sleeve: Bronze or stainless steel.
 - 10. Motor: Furnish with pump. Refer to Section 23 05 12, GENERAL MOTOR REQUIREMENTS FOR HVAC AND STEAM GENERATION EQUIPMENT.
 - 11. Base Mounted Pumps:
 - a. Designed for disassembling for service or repair without disturbing the piping or removing the motor.
 - b. Impeller Wear Rings: Bronze.
 - c. Shaft Coupling: Non-lubricated steel flexible type or spacer type with coupling guard, ANSI B15.1, bolted to the baseplate.
 - d. Base: Cast iron or fabricated steel for common mounting to a concrete base.
 - 12. Provide line sized shut-off valve and suction strainer, maintain manufacturer recommended straight pipe length on pump suction (with blow down valve). Contractor option: Provide suction diffuser as follows:
 - a. Body: Cast iron with steel inlet vanes and combination diffuser-strainer-orifice cylinder with 5 mm (3/16-inch) diameter openings for pump protection. Provide taps for strainer blowdown and gage connections.
 - b. Provide adjustable foot support for suction piping.

- c. Strainer free area: Not less than five times the suction piping.
- d. Provide disposable start-up strainer.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Follow manufacturer's written instructions for pump mounting and start-up. Access/Service space around pumps shall not be less than minimum space recommended by pumps manufacturer.
- B. Provide drains for bases and seals for base mounted pumps, piped to and discharging into floor drains.
- C. Coordinate location of thermometer and pressure gauges as per Section 23 21 13, HYDRONIC PIPING.

3.2 START-UP

- A. Verify that the piping system has been flushed, cleaned and filled.
- B. Lubricate pumps before start-up.
- C. Prime the pump, vent all air from the casing and verify that the rotation is correct. To avoid damage to mechanical seals, never start or run the pump in dry condition.
- D. Verify that correct size heaters-motor over-load devices are installed for each pump controller unit.
- E. Field modifications to the bearings and or impeller (including trimming) are not permitted. If the pump does not meet the specified vibration tolerance send the pump back to the manufacturer for a replacement pump. All modifications to the pump shall be performed at the factory.
- F. Ensure the disposable strainer is free of debris prior to testing and balancing of the hydronic system.
- G. After several days of operation, replace the disposable start-up strainer with a regular strainer in the suction diffuser.

- - - E N D - - -

SECTION 23 22 13
STEAM AND CONDENSATE HEATING PIPING

PART 1 - GENERAL

1.1 DESCRIPTION

- A. Steam, condensate and vent piping inside buildings.

1.2 RELATED WORK

- A. General mechanical requirements and items, which are common to more than one section of Division 23: Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION.
- B. Pumps: Section 23 22 23, STEAM CONDENSATE PUMPS.
- C. Piping insulation: Section 23 07 11, HVAC, PLUMBING, AND BOILER PLANT INSULATION.
- D. Water treatment for closed systems: Section 23 25 00, HVAC WATER TREATMENT.
- E. Heating Coils and Humidifiers: Section 23 73 00, INDOOR CENTRAL-STATION AIR-HANDLING UNITS and SECTION 23 31 00, HVAC DUCTS AND CASING.
- F. Heating coils: Section 23 82 16, AIR COILS.
- G. Temperature and pressure sensors and valve operators: Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC.

1.3 QUALITY ASSURANCE

- A. Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION, which includes welding qualifications.

1.4 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Manufacturer's Literature and Data:
1. Pipe and equipment supports.
 2. Pipe and tubing, with specification, class or type, and schedule.
 3. Pipe fittings, including miscellaneous adapters and special fittings.
 4. Flanges, gaskets and bolting.
 5. Valves of all types.
 6. Strainers.
 7. Pipe alignment guides.
 8. Expansion joints.
 9. Expansion compensators.
 10. Flexible ball joints: Catalog sheets, performance charts, schematic drawings, specifications and installation instructions.

- 11. All specified steam system components.
- 12. Gages.
- 13. Thermometers and test wells.
- C. Manufacturer's certified data report, Form No. U-1, for ASME pressure vessels:
 - 1. Heat Exchangers (Steam-to-Hot Water).
 - 2. Flash tanks.
- D. Coordination Drawings: Refer to Article, SUBMITTALS of Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION.
- E. As-Built Piping Diagrams: Provide drawing as follows for steam and steam condensate piping and other central plant equipment.
 - 1. One wall-mounted stick file for prints. Mount stick file in the chiller plant or adjacent control room along with control diagram stick file.
 - 2. One set of reproducible drawings.

1.5 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American Society of Mechanical Engineers/American National Standards Institute (ASME/ANSI):
 - B1.20.1-83(R2006).....Pipe Threads, General Purpose (Inch)
 - B16.4-2006.....Gray Iron Threaded Fittings
- C. American Society of Mechanical Engineers (ASME):
 - B16.1-2005.....Gray Iron Pipe Flanges and Flanged Fittings
 - B16.3-2006.....Malleable Iron Threaded Fittings
 - B16.9-2007.....Factory-Made Wrought Buttwelding Fittings
 - B16.11-2005.....Forged Fittings, Socket-Welding and Threaded
 - B16.14-91.....Ferrous Pipe Plugs, Bushings, and Locknuts with
Pipe Threads
 - B16.22-2001.....Wrought Copper and Copper Alloy Solder-Joint
Pressure Fittings
 - B16.23-2002.....Cast Copper Alloy Solder Joint Drainage
Fittings
 - B16.24-2006.....Cast Copper Alloy Pipe Flanges and Flanged
Fittings, Class 150, 300, 400, 600, 900, 1500
and 2500

B16.39-98.....Malleable Iron Threaded Pipe Unions, Classes
150, 250, and 300

B31.1-2007.....Power Piping

B31.9-2008.....Building Services Piping

B40.100-2005.....Pressure Gauges and Gauge Attachments

Boiler and Pressure Vessel Code: SEC VIII D1-2001, Pressure Vessels,
Division 1

D. American Society for Testing and Materials (ASTM):

A47-99.....Ferritic Malleable Iron Castings

A53-2007.....Pipe, Steel, Black and Hot-Dipped, Zinc-Coated,
Welded and Seamless

A106-2008.....Seamless Carbon Steel Pipe for High-Temperature
Service

A126-2004.....Standard Specification for Gray Iron Castings
for Valves, Flanges, and Pipe Fittings

A181-2006.....Carbon Steel Forgings, for General-Purpose
Piping

A183-2003 Carbon Steel Track Bolts and Nuts

A216-2008 Standard Specification for Steel Castings,
Carbon, Suitable for Fusion Welding, for High
Temperature Service

A285-01 Pressure Vessel Plates, Carbon Steel, Low-and-
Intermediate-Tensile Strength

A307-2007 Carbon Steel Bolts and Studs, 60,000 PSI Tensile
Strength

A516-2006 Pressure Vessel Plates, Carbon Steel, for
Moderate-and- Lower Temperature Service

A536-84(2004)e1 Standard Specification for Ductile Iron Castings

B32-2008 Solder Metal

B61-2008 Steam or Valve Bronze Castings

B62-2009 Composition Bronze or Ounce Metal Castings

B88-2003 Seamless Copper Water Tube

F439-06 Socket-Type Chlorinated Poly (Vinyl Chloride)
(CPVC) Plastic Pipe Fittings, Schedule 80

F441-02(2008) Chlorinated Poly (Vinyl Chloride) (CPVC) Plastic
Pipe, Schedules 40 and 80

E. American Welding Society (AWS):

A5.8-2004.....Filler Metals for Brazing and Braze Welding

- B2.1-00.....Welding Procedure and Performance
Qualifications
- F. Manufacturers Standardization Society (MSS) of the Valve and Fitting Industry, Inc.:
- SP-67-95.....Butterfly Valves
- SP-70-98.....Cast Iron Gate Valves, Flanged and Threaded
Ends
- SP-71-97.....Gray Iron Swing Check Valves, Flanged and
Threaded Ends
- SP-72-99.....Ball Valves with Flanged or Butt-Welding Ends
for General Service
- SP-78-98.....Cast Iron Plug Valves, Flanged and Threaded
Ends
- SP-80-97.....Bronze Gate, Globe, Angle and Check Valves
- SP-85-94.....Cast Iron Globe and Angle Valves, Flanged and
Threaded Ends
- G. Military Specifications (Mil. Spec.):
- MIL-S-901D-1989.....Shock Tests, H.I. (High Impact) Shipboard
Machinery, Equipment, and Systems
- H. National Board of Boiler and Pressure Vessel Inspectors (NB): Relieving
Capacities of Safety Valves and Relief Valves
- I. Tubular Exchanger Manufacturers Association: TEMA 18th Edition, 2000

PART 2 - PRODUCTS

2.1 PIPE AND EQUIPMENT SUPPORTS, PIPE SLEEVES, AND WALL AND CEILING PLATES

- A. Provide in accordance with Section 23 05 11, COMMON WORK RESULTS FOR
HVAC AND STEAM GENERATION.

2.2 PIPE AND TUBING

- A. Steam Piping: Steel, ASTM A53, Grade B, seamless or ERW; A106 Grade B,
Seamless; Schedule 40.
- B. Steam Condensate and Pumped Condensate Piping:
1. Concealed above ceiling, in wall or chase: Copper water tube ASTM
B88, Type K, hard drawn.
 2. All other locations: Copper water tube ASTM B88, Type K, hard drawn;
or steel, ASTM A53, Grade B, Seamless or ERW, or A106 Grade B
Seamless, Schedule 80.
- C. Vent Piping: Steel, ASTM A53, Grade B, seamless or ERW; A106 Grade B,
Seamless; Schedule 40, galvanized.

2.3 FITTINGS FOR STEEL PIPE

- A. 50 mm (2 inches) and Smaller: Screwed or welded.
 - 1. Butt welding: ASME B16.9 with same wall thickness as connecting piping.
 - 2. Forged steel, socket welding or threaded: ASME B16.11.
 - 3. Screwed: 150 pound malleable iron, ASME B16.3. 125 pound cast iron, ASME B16.4, may be used in lieu of malleable iron, except for steam and steam condensate piping. Provide 300 pound malleable iron, ASME B16.3 for steam and steam condensate piping. Cast iron fittings or piping is not acceptable for steam and steam condensate piping. Bushing reduction of a single pipe size, or use of close nipples, is not acceptable.
 - 4. Unions: ASME B16.39.
 - 5. Steam line drip station and strainer quick-couple blowdown hose connection: Straight through, plug and socket, screw or cam locking type for 15 mm (1/2 inch) ID hose. No integral shut-off is required.
- B. 65 mm (2-1/2 inches) and Larger: Welded or flanged joints.
 - 1. Butt welding fittings: ASME B16.9 with same wall thickness as connecting piping. Elbows shall be long radius type, unless otherwise noted.
 - 2. Welding flanges and bolting: ASME B16.5:
 - a. Steam service: Weld neck or slip-on, raised face, with non-asbestos gasket. Non-asbestos gasket shall either be stainless steel spiral wound strip with flexible graphite filler or compressed inorganic fiber with nitrile binder rated for saturated and superheated steam service 750 degrees F and 1500 psi.
 - b. Flange bolting: Carbon steel machine bolts or studs and nuts, ASTM A307, Grade B.
- C. Welded Branch and Tap Connections: Forged steel weldolets, or branchlets and threadolets may be used for branch connections up to one pipe size smaller than the main. Forged steel half-couplings, ASME B16.11 may be used for drain, vent and gage connections.

2.4 FITTINGS FOR COPPER TUBING

- A. Solder Joint:
 - 1. Joints shall be made up in accordance with recommended practices of the materials applied. Apply 95/5 tin and antimony on all copper piping.

- B. Bronze Flanges and Flanged Fittings: ASME B16.24.
- C. Fittings: ANSI/ASME B16.18 cast copper or ANSI/ASME B16.22 solder wrought copper.

2.5 DIELECTRIC FITTINGS

- A. Provide where copper tubing and ferrous metal pipe are joined.
- B. 50 mm (2 inches) and Smaller: Threaded dielectric union, ASME B16.39.
- C. 65 mm (2 1/2 inches) and Larger: Flange union with dielectric gasket and bolt sleeves, ASME B16.42.
- D. Temperature Rating, 121 degrees C (250 degrees F) for steam condensate and as required for steam service.
- E. Contractor's option: On pipe sizes 2" and smaller, screwed end brass gate valves may be used in lieu of dielectric unions.

2.6 SCREWED JOINTS

- A. Pipe Thread: ANSI B1.20.
- B. Lubricant or Sealant: Oil and graphite or other compound approved for the intended service.

2.7 VALVES

- A. Asbestos packing is not acceptable.
- B. All valves of the same type shall be products of a single manufacturer.
- C. Provide chain operators for valves 150 mm (6 inches) and larger when the centerline is located 2100 mm (7 feet) or more above the floor or operating platform.
- D. Shut-Off Valves
 - 1. Gate Valves:
 - a. 50 mm (2 inches) and smaller: MSS-SP80, Bronze, 1034 kPa (150 lb.), wedge disc, rising stem, union bonnet.
 - b. 65 mm (2 1/2 inches) and larger: Flanged, outside screw and yoke.
 - 1) High pressure steam 413 kPa (60 psig) and above nominal MPS system): Cast steel body, ASTM A216 grade WCB, 1034 kPa (150 psig) at 260 degrees C (500 degrees F), 11-1/2 to 13 percent chrome stainless steel solid disc and seats. Provide 25 mm (1 inch) factory installed bypass with globe valve on valves 100 mm (4 inches) and larger.
 - 2) All other services: MSS-SP 70, iron body, bronze mounted, 861 kPa (125 psig) wedge disc.
- E. Globe and Angle Valves:
 - 1. Globe Valves:

- a. 50 mm (2 inches) and smaller: MSS-SP 80, bronze, 1034 kPa (150 lb.) Globe valves shall be union bonnet with metal plug type disc.
- b. 65 mm (2 1/2 inches) and larger:
 - 1) Globe valves for high pressure steam 413 kPa (60 psig) and above nominal MPS system): Cast steel body, ASTM A216 grade WCB, flanged, OS&Y, 1034 kPa (150 psig) at 260 degrees C (500 degrees F), 11-1/2 to 13 percent chrome stainless steel disc and renewable seat rings.
 - 2) All other services: 861 kPa (125 psig), flanged, iron body, bronze trim, MSS-SP-85 for globe valves.

2. Angle Valves

- a. 50 mm (2 inches) and smaller: MSS-SP 80, bronze, 1034 kPa (150 lb.) Angle valves shall be union bonnet with metal plug type disc.
- b. 65 mm (2 1/2 inches) and larger:
 - 1) Angle valves for high pressure steam 413 kPa (60 psig) and above nominal MPS system): Cast steel body, ASTM A216 grade WCB, flanged, OS&Y, 1034 kPa (150 psig) at 260 degrees C (500 degrees F), 11-1/2 to 13 percent chrome stainless steel disc and renewable seat rings.
 - 2) All other services: 861 kPa (125 psig), flanged, iron body, bronze trim, MSS-SP-85 for angle valves.

F. Swing Check Valves

- 1. 50 mm (2 inches) and smaller: MSS-SP 80, bronze, 1034 kPa (150 psig), 45 degree swing disc.
- 2. 65 mm (2-1/2 inches) and Larger:
 - a Check valves for high pressure steam 413 kPa (60 psig) and above nominal MPS system: Cast steel body, ASTM A216 grade WCB, flanged, OS&Y, 1034 kPa (150 psig) at 260 degrees C (500 degrees F), 11-1/2 to 13 percent chrome stainless steel disc and renewable seat rings.
 - b. All other services: 861 kPa (125 psig), flanged, iron body, bronze trim, MSS-SP-71 for check valves.

2.8 STRAINERS

- A. Basket or Y Type. Tee type is acceptable for gravity flow and pumped steam condensate service.
- B. High Pressure Steam: Rated 1034 kPa (150 psig) saturated steam.

1. 50 mm (2 inches) and smaller: Iron, ASTM A116 Grade B, or bronze, ASTM B-62 body with screwed connections (250 psig).
 2. 65 mm (2-1/2 inches) and larger: Flanged cast steel or 1723 kPa (250 psig) cast iron.
- C. All Other Services: Rated 861 kPa (125 psig) saturated steam.
1. 50 mm (2 inches) and smaller: Cast iron or bronze.
 2. 65 mm (2-1/2 inches) and larger: Flanged, iron body.
- D. Screens: Bronze, monel metal or 18-8 stainless steel, free area not less than 2-1/2 times pipe area, with perforations as follows:
1. 75 mm (3 inches) and smaller: 20 mesh for steam and 1.1 mm (0.045 inch) diameter perforations for liquids.
 2. 100 mm (4 inches) and larger: 1.1 mm (0.045) inch diameter perforations for steam and 3.2 mm (0.125 inch) diameter perforations for liquids.

2.9 PIPE ALIGNMENT

- A. Guides: Provide factory-built guides along the pipe line to permit axial movement only and to restrain lateral and angular movement. Guides must be designed to withstand a minimum of 15 percent of the axial force which will be imposed on the expansion joints and anchors. Field-built guides may be used if detailed on the contract drawings.

2.10 EXPANSION JOINTS

- A. Factory built devices, inserted in the pipe lines, designed to absorb axial cyclical pipe movement which results from thermal expansion and contraction. This includes factory-built or field-fabricated guides located along the pipe lines to restrain lateral pipe motion and direct the axial pipe movement into the expansion joints.
- B. Minimum Service Requirements:
1. Pressure Containment:
 - a. Steam Service 35-200 kPa (5-30 psig): Rated 345 kPa (50 psig) at 148 degrees C (298 degrees F).
 - b. Steam Service 214-850 kPa (31-125 psig): Rated 1025 kPa (150 psig) at 186 degrees C (366 degrees F).
 - c. Steam Service 869-1025 kPa (126-150 psig): Rated 1375 kPa (200 psig) at 194 degrees C (382 degrees F).
 - d. Condensate Service: Rated 690 kPa (100 psig) at 154 degrees C (310 degrees F).
 2. Number of Full Reverse Cycles without failure: Minimum 1000.

3. Movement: As shown on drawings plus recommended safety factor of manufacturer.
- C. Manufacturing Quality Assurance: Conform to Expansion Joints Manufacturers Association Standards.
- D. Bellows - Internally Pressurized Type:
1. Multiple corrugations of Type 304 or Type A240-321 stainless steel.
 2. Internal stainless steel sleeve entire length of bellows.
 3. External cast iron equalizing rings for services exceeding 340 kPa (50 psig).
 4. Welded ends.
 5. Design shall conform to standards of EJMA and ASME B31.1.
 6. External tie rods designed to withstand pressure thrust force upon anchor failure if one or both anchors for the joint are at change in direction of pipeline.
 7. Integral external cover.
- E. Bellows - Externally Pressurized Type:
1. Multiple corrugations of Type 304 stainless steel.
 2. Internal and external guide integral with joint.
 3. Design for external pressurization of bellows to eliminate squirm.
 4. Welded ends.
 5. Conform to the standards of EJMA and ASME B31.1.
 6. Threaded connection at bottom, 25 mm (one inch) minimum, for drain or drip point.
 7. Integral external cover and internal sleeve.
- F. Expansion Joint Identification: Provide stamped brass or stainless steel nameplate on each expansion joint listing the manufacturer, the allowable movement, flow direction, design pressure and temperature, date of manufacture, and identifying the expansion joint by the identification number on the contract drawings.

2.11 FLEXIBLE BALL JOINTS

- A. Design and Fabrication: One piece component construction, fabricated from steel with welded ends, designed for a working steam pressure of 1720 kPa (250 psig) and a temperature of 232 degrees C (450 degrees F). Each joint shall provide for 360 degrees rotation in addition to a minimum angular flexible movement of 30 degrees for sizes 6 mm (1/4 inch) to 150 mm (6 inch) inclusive, and 15 degrees for sizes 65 mm (2-1/2 inches) to 750 mm (30 inches). Joints through 350 mm (14 inches)

shall have forged pressure retaining members; while size 400 mm (16 inches) through 760 mm (30 inches) shall be of one piece construction.

B. Material:

1. Cast or forged steel pressure containing parts and bolting in accordance with Section II of the ASME Boiler Code or ASME B31.1. Retainer may be ductile iron ASTM A536, Grade 65-45-12, or ASME Section II SA 515, Grade 70.
2. Gaskets: Steam pressure molded composition design for a temperature range of from minus 10 degrees C (50 degrees F) to plus 274 degrees C (525 degrees F).

C. Certificates: Submit qualifications of ball joints in accordance with the following test data:

1. Low pressure leakage test: 41 kPa (6psig) saturated steam for 60 days.
2. Flex cycling: 800 Flex cycles at 3445 kPa (500 psig) saturated steam.
3. Thermal cycling: 100 saturated steam pressure cycles from atmospheric pressure to operating pressure and back to atmospheric pressure.
4. Environmental shock tests: Forward certificate from a recognized test laboratory, that ball joints of the type submitted has passed shock testing in accordance with Mil. Spec MIL-S-901.
5. Vibration: 170 hours on each of three mutually perpendicular axis at 25 to 125 Hz; 1.3 mm to 2.5 mm (0.05 inch to 0.1 inch) double amplitude on a single ball joint and 3 ball joint off set.

2.12 STEAM SYSTEM COMPONENTS

A. Heat Exchanger (Steam to Hot Water): Shell and tube type, U-bend removable tube bundle, steam in shell, water in tubes, equipped with support cradles.

1. Maximum tube velocity: 2.3 m/s (7.5 feet per second).
2. Tube fouling factor: TEMA Standards, but not less than $0.00018 \text{ m}^2\text{K/W}$ ($0.001 \text{ ft}^2\text{hrF/Btu}$).
3. Materials:
 - a. Shell: Steel.
 - b. Tube sheet and tube supports: Steel or brass.
 - c. Tubes: 20 mm (3/4 inch) OD copper.
 - d. Head or bonnet: Cast iron or steel.

4. Construction: In accordance with ASME Pressure Vessel Code for 861 kPa (125 psig) working pressure for shell and tubes. Provide manufacturer's certified data report, Form No. U-1.
- B. Steam Pressure Reducing Valves in PRV Stations:
1. Type: Single-seated, diaphragm operated, spring-loaded, external or internal steam pilot-controlled, normally closed, adjustable set pressure. Pilot shall sense controlled pressure downstream of main valve.
 2. Service: Provide controlled reduced pressure to steam piping systems.
 3. Pressure control shall be smooth and continuous with maximum drop of 10 percent. Maximum flow capability of each valve shall not exceed capacity of downstream safety valve(s).
 4. Main valve and pilot valve shall have replaceable valve plug and seat of stainless steel, monel, or similar durable material.
 - a. Pressure rating for high pressure steam: Not less than 1034 kPa (150 psig) saturated steam.
 - b. Connections: Flanged for valves 65 mm (2-1/2 inches) and larger; flanged or threaded ends for smaller valves.
 5. Select pressure reducing valves to develop less than 85 dbA at 1500 mm (5 feet) elevation above adjacent floor, and 1500 mm (5 feet) distance in any direction. Inlet and outlet piping for steam pressure reducing valves shall be Schedule 80 minimum for required distance to achieve required levels or sound attenuators shall be applied.

DESIGNER NOTE: Use pneumatically controlled valves for replacement of existing valves in existing facilities where continued use of pneumatics is required by the VA

- C. Safety Valves and Accessories: Comply with ASME Boiler and Pressure Vessel Code, Section VIII. Capacities shall be certified by National Board of Boiler and Pressure Vessel Inspectors, maximum accumulation 10 percent. Provide lifting lever. Provide drip pan elbow where shown.
- D. Steam PRV for Individual Equipment: Cast iron or bronze body, screwed or flanged ends, rated 861 kPa (125 psig) working pressure. Single-seated, diaphragm operated, spring loaded, adjustable range, all parts renewable.

- E. Flash Tanks: Horizontal or vertical vortex type, constructed of copper bearing steel, ASTM A516 or ASTM A285, for a steam working pressure of 861 kPa (125 psig) to comply with ASME Code for Unfired Pressure Vessels and stamped with "U" symbol. Perforated pipe inside tank shall be ASTM A53 Grade B, Seamless or ERW, or A106 Grade B Seamless, Schedule 80. Corrosion allowance of 1.6 mm (1/16 inch) may be provided in lieu of the copper bearing requirement. Provide data Form No. U-1.
- F. Steam Trap: Each type of trap shall be the product of a single manufacturer. Provide trap sets at all low points and at 61 m (200 feet) intervals on the horizontal main lines.
 - 1. Floats and linkages shall provide sufficient force to open trap valve over full operating pressure range available to the system. Unless otherwise indicated on the drawings, traps shall be sized for capacities indicated at minimum pressure drop as follows:
 - a. For equipment with modulating control valve: 1.7 kPa (1/4 psig), based on a condensate leg of 300 mm (12 inches) at the trap inlet and gravity flow to the receiver.
 - b. For main line drip trap sets and other trap sets at steam pressure: Up to 70 percent of design differential pressure. Condensate may be lifted to the return line.
 - 2. Trap bodies: Bronze, cast iron, or semi-steel, constructed to permit ease of removal and servicing working parts without disturbing connecting piping. For systems without relief valve traps shall be 5. Mechanism: Brass, stainless steel or corrosion resistant alloy. rated for the pressure upstream of the PRV supplying the system.
 - 3. Balanced pressure thermostatic elements: Phosphor bronze, stainless steel or monel metal.
 - 4. Valves and seats: Suitable hardened corrosion resistant alloy.
 - 6. Floats: Stainless steel.
 - 7. Inverted bucket traps: Provide bi-metallic thermostatic element for rapid release of non-condensables.
- G. Thermostatic Air Vent (Steam): Brass or iron body, balanced pressure bellows, stainless steel (renewable) valve and seat, rated 861 kPa (125 psig) working pressure, 20 mm (3/4 inch) screwed connections. Air vents shall be balanced pressure type that responds to steam pressure-temperature curve and vents air at any pressure.
- H. Steam Hose and Accessories: Hose shall be sufficiently flexible to be placed in a 100 mm (4 feet) diameter coil.

1. Furnish and install in the mechanical room housing each PRV station a 7500 mm (25 feet) length of 13 mm (1/2 inch) ID steam hose, rated 861 kPa (125 psig) and a hose rack. In one end of the hose install a quick-couple device, suitable for steam service, to match corresponding devices in the PRV blowdown connections.
2. Hose storage rack: Wall-mounted, steel, iron or aluminum, semi-circular shape, with capacity to store 7500 mm (25 feet) of 13 mm (1/2 inch) ID steam hose.

2.13 GAGES, PRESSURE AND COMPOUND

- A. ASME B40.1, Accuracy Grade 1A, (pressure, vacuum, or compound), initial mid-scale accuracy 1 percent of scale (Qualify grade), metal or phenolic case, 115 mm (4-1/2 inches) in diameter, 6 mm (1/4 inch) NPT bottom connection, white dial with black graduations and pointer, clear glass or acrylic plastic window, suitable for board mounting. Provide red "set hand" to indicate normal working pressure.
- B. Provide brass, lever handle union cock. Provide brass/bronze pressure snubber for gages in water service. Provide brass pigtail syphon for steam gages.
- C. Range of Gages: For services not listed provide range equal to at least 130 percent of normal operating range:

Low pressure steam and steam condensate to 103 kPa (15 psig)	0 to 207 kPa (30 psig).
Medium pressure steam and steam condensate nominal 413 kPa (60 psig)	0 to 689 kPa (100 psig).
High pressure steam and steam condensate nominal 620 kPa to 861 kPa (90 to 125 psig)	0 to 1378 kPa (200 psig).
Pumped condensate, steam condensate, gravity or vacuum (30" HG to 30 psig)	0 to 415 kPa (60 psig)

2.14 PRESSURE/TEMPERATURE TEST PROVISIONS

- A. Provide one each of the following test items to the Resident Engineer:
 1. 6 mm (1/4 inch) FPT by 3 mm (1/8 inch) diameter stainless steel pressure gage adapter probe for extra long test plug. PETE'S 500 XL is an example.
 2. 90 mm (3-1/2 inch) diameter, one percent accuracy, compound gage, 762 mm (30 inches) Hg to 689 kPa (100 psig) range.

3. 0 - 104 degrees C (32-220 degrees F) pocket thermometer one-half degree accuracy, 25 mm (one inch) dial, 125 mm (5 inch) long stainless steel stem, plastic case.

2.15 FIRESTOPPING MATERIAL

- A. Refer to Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION.

PART 3 - EXECUTION

3.1 GENERAL

- A. The drawings show the general arrangement of pipe and equipment but do not show all required fittings and offsets that may be necessary to connect pipes to equipment, fan-coils, coils, etc., and to coordinate with other trades. Provide all necessary fittings, offsets and pipe runs based on field measurements and at no additional cost to the government. Coordinate with other trades for space available and relative location of HVAC equipment and accessories to be connected on ceiling grid. Pipe location on the drawings shall be altered by contractor where necessary to avoid interferences and clearance difficulties.
- B. Store materials to avoid excessive exposure to weather or foreign materials. Keep inside of piping relatively clean during installation and protect open ends when work is not in progress.
- C. Support piping securely. Refer to PART 3, Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION. Install convertors and other heat exchangers at height sufficient to provide gravity flow of condensate to the flash tank and condensate pump.
- D. Install piping generally parallel to walls and column center lines, unless shown otherwise on the drawings. Space piping, including insulation, to provide 25 mm (one inch) minimum clearance between adjacent piping or other surface. Unless shown otherwise, slope steam, condensate and drain piping down in the direction of flow not less than 25 mm (one inch) in 12 m (40 feet). Provide eccentric reducers to keep bottom of sloped piping flat.
- E. Locate and orient valves to permit proper operation and access for maintenance of packing, seat and disc. Generally locate valve stems in overhead piping in horizontal position. Provide a union adjacent to one end of all threaded end valves. Control valves usually require reducers to connect to pipe sizes shown on the drawing. Install butterfly valves

- with the valve open as recommended by the manufacturer to prevent binding of the disc in the seat.
- F. Offset equipment connections to allow valving off for maintenance and repair with minimal removal of piping. Provide flexibility in equipment connections and branch line take-offs with 3-elbow swing joints where noted on the drawings.
 - G. Tee water piping runouts or branches into the side of mains or other branches. Avoid bull-head tees, which are two return lines entering opposite ends of a tee and exiting out the common side.
 - H. Connect piping to equipment as shown on the drawings. Install components furnished by others such as:
 - 1. Flow elements (orifice unions), control valve bodies, flow switches, pressure taps with valve, and wells for sensors.
 - I. Firestopping: Fill openings around uninsulated piping penetrating floors or fire walls, with firestop material. For firestopping insulated piping refer to Section 23 07 11, HVAC, PLUMBING, and BOILER PLANT INSULATION.
 - J. Where copper piping is connected to steel piping, provide dielectric connections.
 - K. Pipe vents to the exterior. Where a combined vent is provided, the cross sectional area of the combined vent shall be equal to sum of individual vent areas. Slope vent piping one inch in 40 feet (0.25 percent) in direction of flow. Provide a drip trap elbow on relief valve outlets if the vent rises to prevent backpressure. Terminate vent minimum 0.3 M (12 inches) above the roof or through the wall minimum 2.5 M (8 feet) above grade with down turned elbow.

3.2 PIPE JOINTS

- A. Welded: Beveling, spacing and other details shall conform to ASME B31.1 and AWS B2.1. See Welder's qualification requirements under "Quality Assurance" in Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.
- B. Screwed: Threads shall conform to ASME B1.20; joint compound shall be applied to male threads only and joints made up so no more than three threads show. Coat exposed threads on steel pipe with joint compound, or red lead paint for corrosion protection.
- C. 125 Pound Cast Iron Flange (Plain Face): Mating flange shall have raised face, if any, removed to avoid overstressing the cast iron flange.

3.3 EXPANSION JOINTS (BELLOWS AND SLIP TYPE)

- A. Anchors and Guides: Provide type, quantity and spacing as recommended by manufacturer of expansion joint and as shown. A professional engineer shall verify in writing that anchors and guides are properly designed for forces and moments which will be imposed.
- B. Cold Set: Provide setting of joint travel at installation as recommended by the manufacturer for the ambient temperature during the installation.
- C. Preparation for Service: Remove all apparatus provided to restrain joint during shipping or installation. Representative of manufacturer shall visit the site and verify that installation is proper.
- D. Access: Expansion joints must be located in readily accessible space. Locate joints to permit access without removing piping or other devices. Allow clear space to permit replacement of joints and to permit access to devices for inspection of all surfaces and for adding packing.

3.4 STEAM TRAP PIPING

- A. Install to permit gravity flow to the trap. Provide gravity flow (avoid lifting condensate) from the trap where modulating control valves are used. Support traps weighing over 11 kg (25 pounds) independently of connecting piping.

3.5 LEAK TESTING

- A. Inspect all joints and connections for leaks and workmanship and make corrections as necessary, to the satisfaction of the Resident Engineer in accordance with the specified requirements. Testing shall be performed in accordance with the specification requirements.
- B. An operating test at design pressure, and for hot systems, design maximum temperature.
- C. A hydrostatic test at 1.5 times design pressure. For water systems the design maximum pressure would usually be the static head, or expansion tank maximum pressure, plus pump head. Factory tested equipment (convertors, exchangers, coils, etc.) need not be field tested. Avoid excessive pressure on mechanical seals and safety devices.

3.6 FLUSHING AND CLEANING PIPING SYSTEMS

- A. Steam, Condensate and Vent Piping: No flushing or chemical cleaning required. Accomplish cleaning by pulling all strainer screens and cleaning all scale/dirt legs during start-up operation.

3.7 OPERATING AND PERFORMANCE TEST AND INSTRUCTION

- A. Refer to PART 3, Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.
- B. Adjust red set hand on pressure gages to normal working pressure.

- - - E N D - - -

SECTION 23 22 23
STEAM CONDENSATE PUMPS

PART 1 - GENERAL

1.1 DESCRIPTION

- A. Steam condensate pumps for Heating, Ventilating and Air Conditioning.

1.2 RELATED WORK

- A. Section 01 00 00, GENERAL REQUIREMENTS.
B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
C. Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.
D. Section 23 05 41, NOISE and VIBRATION CONTROL FOR HVAC PIPING and EQUIPMENT.
E. Section 23 22 13, STEAM AND CONDENSATE HEATING PIPING.
F. Section 23 05 12, GENERAL MOTOR REQUIREMENTS FOR HVAC and STEAM GENERATION EQUIPMENT.

1.3 QUALITY ASSURANCE

- A. Refer to Paragraph, QUALITY ASSURANCE in Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.
- B. Design Criteria:
1. Pumps design and manufacturer shall conform to Hydraulic Institute Standards.
 2. Pump sizes, capacities, pressures, operating characteristics and efficiency shall be as scheduled.
 3. Select pumps so that required net positive suction head (NPSHR) does not exceed the net positive head available (NPSHA).
 4. Pump Driver: Furnish with pump. Size shall be non-overloading at any point on the head-capacity curve including one pump operation in a parallel or series pumping installation.
 5. Provide all pumps with motors, impellers, drive assemblies, bearings, coupling guard and other accessories specified. Statically and dynamically balance all rotating parts.
 6. Furnish each pump and motor with a nameplate giving the manufacturers name, serial number of pump, capacity in GPM and head in feet at design condition, horsepower, voltage, frequency, speed and full load current and motor efficiency.
 7. Test all pumps before shipment. The manufacturer shall certify all pump ratings.

8. After completion of balancing, provide replacement of impellers or trim impellers to provide specified flow at actual pumping head, as installed.
9. Furnish one spare seal and casing gasket for each pump to the Contracting Officer's Technical Representative (COTR).
- C. Allowable Vibration Tolerance for Pump Units: Section 23 05 41, NOISE and VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT.

1.4 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Manufacturer's Literature and Data:
 1. Pumps and accessories.
 2. Motors and drives.
- C. Manufacturer's installation, maintenance and operating instructions, in accordance with Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.
- D. Characteristic Curves: Head-capacity, efficiency-capacity, brake horsepower-capacity, and NPSHR-capacity for each pump.

1.5 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only:
- B. American Iron and Steel Institute (AISI):
 - AISI 1045.....Cold Drawn Carbon Steel Bar, Type 1045
 - AISI 416.....Type 416 Stainless Steel
- C. American National Standards Institute (ANSI):
 - ANSI B15.1-00(R2008)....Safety Standard for Mechanical Power Transmission Apparatus
 - ANSI B16.1-05.....Cast Iron Pipe Flanges and Flanged Fittings, Class 25, 125, 250 and 800
- D. American Society for Testing and Materials (ASTM):
 - A48-03(2008).....Standard Specification for Gray Iron Castings
 - B62-09.....Standard Specification for Composition Bronze or Ounce Metal Castings
- E. Maintenance and Operating Manuals in accordance with Section 01 00 00, GENERAL REQUIREMENTS.

1.6 DEFINITIONS

- A. Capacity: Liters per second (L/s) (Gallons per minute (GPM)) of the fluid pumped.
- B. Head: Total dynamic head in kPa (feet) of the fluid pumped.

PART 2 - PRODUCTS

2.1 CONDENSATE PUMP, PAD-MOUNTED

- A. General: Factory assembled unit consisting of vented receiver tank, motor-driven pumps, interconnecting piping and wiring, motor controls (including starters, if necessary) and accessories, designed to receive, store, and pump steam condensate.
- B. Receiver Tank: Cast iron with threaded openings for connection of piping and accessories and facilities for mounting float switches. Receivers for simplex pumps shall include all facilities for future mounting of additional pump and controls.
- C. Furnish seals for condensate pump with a minimum temperature rating of 121 degrees C (250 degrees F).
- D. Centrifugal Pumps: Bronze fitted with mechanical shaft seals.
 - 1. Designed to allow removal of rotating elements without disturbing connecting piping or pump casing mounting.
 - 2. Shafts: Stainless steel, AISI Type 416 or alloy steel with bronze shaft sleeves.
 - 3. Bearings: Regreaseable ball or roller type.
 - 4. Casing wearing rings: Bronze.
- E. Motors: Refer to Section 23 05 12, GENERAL MOTOR REQUIREMENTS FOR HVAC and STEAM GENERATION EQUIPMENT.
- F. Pump Operation:
 - 1. Float Switches: NEMA 1, mounted on receiver tank, to start and stop pumps in response to changes in the water level in the receiver and adjustable to permit the controlled water levels to be changed. Floats and connecting rods shall be copper, bronze or stainless steel.
 - 2. Alternator: Provide for duplex units to automatically start the second pump when the first pump fails in keeping the receiver water level from rising and to alternate the order of starting the pumps. For units 0.25 kW (1/3 horsepower) and smaller, the alternator may be the mechanical type for use in lieu of float switches.
- G. Control Cabinet for 3 Phase (0.37 kW (1/2 hp) and larger) Units: NEMA 1, UL approved, factory wired, enclosing all controls, with indicating

lights, manual switches and resets mounted on the outside of the panel. Attach cabinet to the pump set with rigid steel framework, unless remote mounting is noted on the pump schedule.

1. Motor starters: Magnetic contact types with circuit breakers or combination fusible disconnect switches. Provide low voltage control circuits (120 volt maximum) and "hand-off-automatic" (H-O-A) switches for each pump.
 2. Indicating lights for each pump: Green to show that power is on, red to show that the pump is running.
- H. Electric Wiring: Suitable for 93 degrees C (200 degrees F) service; enclosed in liquid-tight flexible metal conduit where located outside of control cabinet.
- I. Receiver Accessories:
1. Thermometer: 34-216 degrees C (100 - 420 degrees F), mounted below minimum water level.
 2. Water level gage glass: Brass with gage cocks which automatically stop the flow of water when the glass is broken. Provide drain on the lower gage cock and protection rods for the glass.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Follow manufacturer's written instructions for pump mounting and start-up. Access/Service space around pumps shall not be less than minimum space recommended by pumps manufacturer.
- B. Permanently support in-line pumps by the connecting piping only, not from the casing or the motor eye bolt.
- C. Sequence of installation for base-mounted pumps:
 1. Level and shim the unit base and grout to the concrete pad.
 2. Shim the driver and realign the pump and driver. Correct axial, angular or parallel misalignment of the shafts.
 3. Connect properly aligned and independently supported piping.
 4. Recheck alignment.
- D. Pad-mounted Condensate Pump: Level, shim, bolt, and grout the unit base onto the concrete pad.
- E. Coordinate location of thermometer and pressure gauges as per Section 23 22 13, STEAM and CONDENSATE HEATING PIPING.

3.2 START-UP

- A. Verify that the piping system has been flushed, cleaned and filled.
- B. Lubricate pumps before start-up.

- C. Prime the pump, vent all air from the casing and verify that the rotation is correct. To avoid damage to mechanical seals, never start or run the pump in dry condition.
- D. Verify that correct size heaters-motor over-load devices are installed for each pump controller unit.
- E. Field modifications to the bearings and or impeller (including trimming) are not permitted. If the pump does not meet the specified vibration tolerance send the pump back to the manufacturer for a replacement pump. All modifications to the pump shall be performed at the factory.

- - - E N D - - -

**SECTION 23 23 00
REFRIGERANT PIPING**

PART 1 - GENERAL

1.1 DESCRIPTION

- A. Refrigerant piping shall be sized, selected, and designed either by the equipment manufacturer or in strict accordance with the manufacturer's published instructions. The schematic piping diagram shall show all accessories such as, stop valves, level indicators, liquid receivers, oil separator, gauges, thermostatic expansion valves, solenoid valves, moisture separators and driers to make a complete installation.
- B. Definitions:
1. Refrigerating system: Combination of interconnected refrigerant-containing parts constituting one closed refrigeration circuit in which a refrigerant is circulated for the purpose of extracting heat.
 - a. Low side means the parts of a refrigerating system subjected to evaporator pressure.
 - b. High side means the parts of a refrigerating system subjected to condenser pressure.
 2. Brazed joint: A gas-tight joint obtained by the joining of metal parts with alloys which melt at temperatures higher than 449 degrees C (840 degrees F) but less than the melting temperatures of the joined parts.

1.2 RELATED WORK

- A. Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION: General mechanical requirements and items, which are common to more than one section of Division 23.
- B. Section 23 07 11, HVAC, PLUMBING, and BOILER PLANT INSULATION: Requirements for piping insulation.
- C. Section 23 64 00, PACKAGED WATER CHILLERS: Piping requirements for air cooled chillers and condensing units.
- D. Section 23 21 13, HYDRONIC PIPING: Requirements for water and drain piping and valves.
- E. Section 23 81 00, DECENTRALIZED UNITARY HVAC EQUIPMENT.

1.3 QUALITY ASSURANCE

- A. Refer to specification Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.

- B. Comply with ASHRAE Standard 15, Safety Code for Mechanical Refrigeration. The application of this Code is intended to assure the safe design, construction, installation, operation, and inspection of every refrigerating system employing a fluid which normally is vaporized and liquefied in its refrigerating cycle.
- C. Comply with ASME B31.5: Refrigerant Piping and Heat Transfer Components.
- D. Products shall comply with UL 207 "Refrigerant-Containing Components and Accessories, "Nonelectrical"; or UL 429 "Electrical Operated Valves."

1.4 SUBMITTALS

- A. Submit in accordance with specification Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Shop Drawings:
 - 1. Complete information for components noted, including valves and refrigerant piping accessories, clearly presented, shall be included to determine compliance with drawings and specifications for components noted below:
 - a. Tubing and fittings
 - b. Valves
 - c. Strainers
 - d. Moisture-liquid indicators
 - e. Filter-driers
 - f. Flexible metal hose
 - g. Liquid-suction interchanges
 - h. Oil separators (when specified)
 - i. Gages
 - j. Pipe and equipment supports
 - k. Refrigerant and oil
 - l. Pipe/conduit roof penetration cover
 - m. Soldering and brazing materials
 - 2. Layout of refrigerant piping and accessories, including flow capacities, valves locations, and oil traps slopes of horizontal runs, floor/wall penetrations, and equipment connection details.
- C. Certification: Copies of certificates for welding procedure, performance qualification record and list of welders' names and symbols.

- D. Design Manual: Furnish two copies of design manual of refrigerant valves and accessories.

1.5 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. Air Conditioning, Heating, and Refrigeration Institute (ARI/AHRI):
- 495-1999 (R2002).....Standard for Refrigerant Liquid Receivers
 - 730-2005.....Flow Capacity Rating of Suction-Line Filters and Suction-Line Filter-Driers
 - 750-2007.....Thermostatic Refrigerant Expansion Valves
 - 760-2007.....Performance Rating of Solenoid Valves for Use with Volatile Refrigerants
- C. American Society of Heating Refrigerating and Air Conditioning Engineers (ASHRAE):
- ANSI/ASHRAE 15-2007.....Safety Standard for Refrigeration Systems (ANSI)
 - ANSI/ASHRAE 17-2008.....Method of Testing Capacity of Thermostatic Refrigerant Expansion Valves (ANSI)
 - 63.1-95 (RA 01).....Method of Testing Liquid Line Refrigerant Driers (ANSI)
- D. American National Standards Institute (ANSI):
- ASME (ANSI)A13.1-2007...Scheme for Identification of Piping Systems
 - Z535.1-2006.....Safety Color Code
- E. American Society of Mechanical Engineers (ASME):
- ANSI/ASME B16.22-2001 (R2005)
 - Wrought Copper and Copper Alloy Solder-Joint Pressure Fittings (ANSI)
 - ANSI/ASME B16.24-2006 Cast Copper Alloy Pipe Flanges and Flanged Fittings, Class 150, 300, 400, 600, 900, 1500 and 2500 (ANSI)
 - ANSI/ASME B31.5-2006....Refrigeration Piping and Heat Transfer Components (ANSI)
 - ANSI/ASME B40.100-2005..Pressure Gauges and Gauge Attachments
 - ANSI/ASME B40.200-2008..Thermometers, Direct Reading and Remote Reading
- F. American Society for Testing and Materials (ASTM)
- A126-04.....Standard Specification for Gray Iron Castings for Valves, Flanges, and Pipe Fittings
 - B32-08 Standard Specification for Solder Metal

- B88-03.....Standard Specification for Seamless Copper
Water Tube
- B88M-05.....Standard Specification for Seamless Copper
Water Tube (Metric)
- B280-08.....Standard Specification for Seamless Copper Tube
for Air Conditioning and Refrigeration Field
Service
- G. American Welding Society, Inc. (AWS):
Brazing Handbook
- A5.8/A5.8M-04.....Standard Specification for Filler Metals for
Brazing and Braze Welding
- H. Federal Specifications (Fed. Spec.)
Fed. Spec. GG
- I. Underwriters Laboratories (U.L.):
U.L.207-2009.....Standard for Refrigerant-Containing Components
and Accessories, Nonelectrical
- U.L.429-99 (Rev.2006)...Standard for Electrically Operated Valves

PART 2 - PRODUCTS

2.1 PIPING AND FITTINGS

- A. Refrigerant Piping: For piping up to 100 mm (4 inch) use Copper refrigerant tube, ASTM B280, cleaned, dehydrated and sealed, marked ACR on hard temper straight lengths. Coils shall be tagged ASTM B280 by the manufacturer. For piping over 100 mm (4 inch) use A53 Black SML steel.
- B. Water and Drain Piping: Copper water tube, ASTM B88M, Type B or C (ASTM B88, Type M or L). Optional drain piping material: Schedule 80 flame retardant Polypropylene plastic.
- C. Fittings, Valves and Accessories:
1. Copper fittings: Wrought copper fittings, ASME B16.22.
 - a. Brazed Joints, refrigerant tubing: Cadmium free, AWS A5.8/A5.8M, 45 percent silver brazing alloy, Class BAg-5.
 - b. Solder Joints, water and drain: 95-5 tin-antimony, ASTM B32 (95TA).
 2. Steel fittings: ASTM wrought steel fittings.
 - a. Refrigerant piping - Welded Joints.
 3. Flanges and flanged fittings: ASME B16.24.
 4. Refrigeration Valves:
 - a. Stop Valves: Brass or bronze alloy, packless, or packed type with gas tight cap, frost proof, back seating.

- b. Pressure Relief Valves: Comply with ASME Boiler and Pressure Vessel Code; UL listed. Forged brass with nonferrous, corrosion resistant internal working parts of high strength, cast iron bodies conforming to ASTM A126, Grade B. Set valves in accordance with ASHRAE Standard 15.
 - c. Solenoid Valves: Comply with ARI 760 and UL 429, UL-listed, two-position, direct acting or pilot-operated, moisture and vapor-proof type of corrosion resisting materials, designed for intended service, and solder-end connections. Fitted with suitable NEMA 250 enclosure of type required by location and normally // open // closed // holding coil.
 - d. Thermostatic Expansion Valves: Comply with ARI 750. Brass body with stainless-steel or non-corrosive non ferrous internal parts, diaphragm and spring-loaded (direct-operated) type with sensing bulb and distributor having side connection for hot-gas bypass and external equalizer. Size and operating characteristics as recommended by manufacturer of evaporator and factory set for superheat requirements. Solder-end connections. Testing and rating in accordance with ASHRAE Standard 17.
 - e. Check Valves: Brass or bronze alloy with swing or lift type, with tight closing resilient seals for silent operation; designed for low pressure drop, and with solder-end connections. Direction of flow shall be legibly and permanently indicated on the valve body.
5. Strainers: Designed to permit removing screen without removing strainer from piping system, and provided with screens 80 to 100 mesh in liquid lines DN 25 (NPS 1) and smaller, 60 mesh in liquid lines larger than DN 25 (NPS 1), and 40 mesh in suction lines. Provide strainers in liquid line serving each thermostatic expansion valve, and in suction line serving each refrigerant compressor not equipped with integral strainer.
6. Refrigerant Moisture/Liquid Indicators: Double-ported type having heavy sight glasses sealed into forged bronze body and incorporating means of indicating refrigerant charge and moisture indication. Provide screwed brass seal caps.
7. Refrigerant Filter-Dryers: UL listed, angle or in-line type, as shown on drawings. Conform to ARI Standard 730 and ASHRAE Standard 63.1. Heavy gage steel shell protected with corrosion-resistant

paint; perforated baffle plates to prevent desiccant bypass. Size as recommended by manufacturer for service and capacity of system with connection not less than the line size in which installed. Filter driers with replaceable filters shall be furnished with one spare element of each type and size.

8. Flexible Metal Hose: Seamless bronze corrugated hose, covered with bronze wire braid, with standard copper tube ends. Provide in suction and discharge piping of each compressor.
9. Water Piping Valves and Accessories: Refer to specification Section 23 21 13, HYDRONIC PIPING.

2.2 GAGES

- A. Temperature Gages: Comply with ASME B40.200. Industrial-duty type and in required temperature range for service in which installed. Gages shall have Celsius scale in 1-degree (Fahrenheit scale in 2-degree) graduations and with black number on a white face. The pointer shall be adjustable. Rigid stem type temperature gages shall be provided in thermal wells located within 1525 mm (5 feet) of the finished floor. Universal adjustable angle type or remote element type temperature gages shall be provided in thermal wells located 1525 to 2135 mm (5 to 7 feet) above the finished floor. Remote element type temperature gages shall be provided in thermal wells located 2135 mm (7 feet) above the finished floor.
- B. Vacuum and Pressure Gages: Comply with ASME B40.100 and provide with throttling type needle valve or a pulsation dampener and shut-off valve. Gage shall be a minimum of 90 mm (3-1/2 inches) in diameter with a range from 0 kPa (0 psig) to approximately 1.5 times the maximum system working pressure. Each gage range shall be selected so that at normal operating pressure, the needle is within the middle-third of the range.
 1. Suction: 101 kPa (30 inches Hg) vacuum to 1723 kPa (gage) (250 psig).
 2. Discharge: 0 to 3445 kPa (gage) (0 to 500 psig).

2.3 THERMOMETERS AND WELLS

- A. Refer to specification Section 23 21 13, HYDRONIC PIPING.

2.4 PIPE SUPPORTS

- A. Refer to specification Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.

2.5 REFRIGERANTS AND OIL

- A. Provide EPA approved refrigerant and oil for proper system operation.

2.6 PIPE INSULATION FOR DX HVAC SYSTEMS

Refer to specification Section 23 07 11, HVAC, PLUMBING, and BOILER PLANT INSULATION.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Install refrigerant piping and refrigerant containing parts in accordance with ASHRAE Standard 15 and ASME B31.5
 - 1. Install piping as short as possible, with a minimum number of joints, elbow and fittings.
 - 2. Install piping with adequate clearance between pipe and adjacent walls and hangers to allow for service and inspection. Space piping, including insulation, to provide 25 mm (1 inch) minimum clearance between adjacent piping or other surface. Use pipe sleeves through walls, floors, and ceilings, sized to permit installation of pipes with full thickness insulation.
 - 3. Locate and orient valves to permit proper operation and access for maintenance of packing, seat and disc. Generally locate valve stems in overhead piping in horizontal position. Provide a union adjacent to one end of all threaded end valves. Control valves usually require reducers to connect to pipe sizes shown on the drawing.
 - 4. Use copper tubing in protective conduit when installed below ground.
 - 5. Install hangers and supports per ASME B31.5 and the refrigerant piping manufacturer's recommendations.
- B. Joint Construction:
 - 1. Brazed Joints: Comply with AWS "Brazing Handbook" and with filler materials complying with AWS A5.8/A5.8M.
 - a. Use Type BcuP, copper-phosphorus alloy for joining copper socket fittings with copper tubing.
 - b. Use Type BAg, cadmium-free silver alloy for joining copper with bronze or steel.
 - c. Swab fittings and valves with manufacturer's recommended cleaning fluid to remove oil and other compounds prior to installation.
 - d. Pass nitrogen gas through the pipe or tubing to prevent oxidation as each joint is brazed. Cap the system with a reusable plug after each brazing operation to retain the nitrogen and prevent entrance of air and moisture.

- C. Protect refrigerant system during construction against entrance of foreign matter, dirt and moisture; have open ends of piping and connections to compressors, condensers, evaporators and other equipment tightly capped until assembly.
- D. Pipe relief valve discharge to outdoors for systems containing more than 45 kg (100 lbs) of refrigerant.
- E. Firestopping: Fill openings around uninsulated piping penetrating floors or fire walls, with firestop material. For firestopping insulated piping refer to Section 23 07 11, HVAC, PLUMBING, and BOILER PLANT INSULATION.

3.2 PIPE AND TUBING INSULATION

- A. Refer to specification Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.
- B. Apply two coats of weather-resistant finish as recommended by the manufacturer to insulation exposed to outdoor weather.

3.3 SIGNS AND IDENTIFICATION

- A. Each refrigerating system erected on the premises shall be provided with an easily legible permanent sign securely attached and easily accessible, indicating thereon the name and address of the installer, the kind and total number of pounds of refrigerant required in the system for normal operations, and the field test pressure applied.
- B. Systems containing more than 50 kg (110 lb) of refrigerant shall be provided with durable signs, in accordance with ANSI A13.1 and ANSI Z535.1, having letters not less than 13 mm (1/2 inch) in height designating:
 - 1. Valves and switches for controlling refrigerant flow, the ventilation and the refrigerant compressor(s).
 - 2. Signs on all exposed high pressure and low pressure piping installed outside the machinery room, with name of the refrigerant and the letters "HP" or "LP."

3.4 FIELD QUALITY CONTROL

Prior to initial operation examine and inspect piping system for conformance to plans and specifications and ASME B31.5. Correct equipment, material, or work rejected because of defects or nonconformance with plans and specifications, and ANSI codes for pressure piping.

- A. After completion of piping installation and prior to initial operation, conduct test on piping system according to ASME B31.5. Furnish

materials and equipment required for tests. Perform tests in the presence of Resident Engineer. If the test fails, correct defects and perform the test again until it is satisfactorily done and all joints are proved tight.

1. Every refrigerant-containing parts of the system that is erected on the premises, except compressors, condensers, evaporators, safety devices, pressure gages, control mechanisms and systems that are factory tested, shall be tested and proved tight after complete installation, and before operation.
 2. The high and low side of each system shall be tested and proved tight at not less than the lower of the design pressure or the setting of the pressure-relief device protecting the high or low side of the system, respectively, except systems erected on the premises using non-toxic and non-flammable Group A1 refrigerants with copper tubing not exceeding DN 18 (NPS 5/8). This may be tested by means of the refrigerant charged into the system at the saturated vapor pressure of the refrigerant at 20 degrees C (68 degrees F) minimum.
- B. Test Medium: A suitable dry gas such as nitrogen or shall be used for pressure testing. The means used to build up test pressure shall have either a pressure-limiting device or pressure-reducing device with a pressure-relief device and a gage on the outlet side. The pressure relief device shall be set above the test pressure but low enough to prevent permanent deformation of the system components.

3.5 SYSTEM TEST AND CHARGING

- A. System Test and Charging: As recommended by the equipment manufacturer or as follows:
1. Connect a drum of refrigerant to charging connection and introduce enough refrigerant into system to raise the pressure to 70 kPa (10 psi) gage. Close valves and disconnect refrigerant drum. Test system for leaks with halide test torch or other approved method suitable for the test gas used. Repair all leaking joints and retest.
 2. Connect a drum of dry nitrogen to charging valve and bring test pressure to design pressure for low side and for high side. Test entire system again for leaks.
 3. Evacuate the entire refrigerant system by the triplicate evacuation method with a vacuum pump equipped with an electronic gage reading in mPa (microns). Pull the system down to 665 mPa (500 microns) 665

mPa (2245.6 inches of mercury at 60 degrees F) and hold for four hours then break the vacuum with dry nitrogen (or refrigerant). Repeat the evacuation two more times breaking the third vacuum with the refrigeration to be charged and charge with the proper volume of refrigerant.

- - - E N D - - -

SECTION 23 25 00
HVAC WATER TREATMENT

PART 1 - GENERAL

1.1 DESCRIPTION

A. This section specifies cleaning and treatment of circulating HVAC water systems, including the following.

1. Cleaning compounds.
2. Chemical treatment for closed loop heat transfer systems.

1.2 RELATED WORK

- A. Test requirements and instructions on use of equipment/system: Section 01 00 00, GENERAL REQUIREMENTS.
- B. General mechanical requirements and items, which are common to more than one section of Division 23: Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.
- C. Piping and valves: Section 23 21 13, HYDRONIC PIPING and Section 23 22 13, STEAM and CONDENSATE HEATING PIPING.

1.3 QUALITY ASSURANCE

- A. Refer to paragraph, QUALITY ASSURANCE in Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.
- B. Technical Services: Provide the services of an experienced water treatment chemical engineer or technical representative to direct flushing, cleaning, pre-treatment, training, debugging, and acceptance testing operations; direct and perform chemical limit control during construction period and monitor systems for a period of 12 months after acceptance, including not less than 6 service calls and written status reports. Emergency calls are not included.
- C. Field Quality Control and Certified Laboratory Reports: During the one year guarantee period, the water treatment laboratory shall provide not less than 12 reports based on on-site periodic visits, as stated in paragraph 1.3.B, sample taking and testing, and review with VA personnel, of water treatment control for the previous period. In addition to field tests, the water treatment laboratory shall provide certified laboratory test reports. These monitoring reports shall assess chemical treatment accuracy, scale formation, fouling and corrosion control, and shall contain instructions for the correction of any out-of-control condition.

- D. Log Forms: Provide one year supply of preprinted water treatment test log forms.
- E. Chemicals: Chemicals shall be non-toxic approved by local authorities and meeting applicable EPA requirements.

1.4 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Manufacturer's Literature and Data including:
 - 1. Cleaning compounds and recommended procedures for their use.
 - 2. Chemical treatment for closed systems, including installation and operating instructions.
- C. Water analysis verification.
- D. Materials Safety Data Sheet for all proposed chemical compounds, based on U.S. Department of Labor Form No. L5B-005-4.
- E. Maintenance and operating instructions in accordance with Section 01 00 00, GENERAL REQUIREMENTS.

1.5 APPLICABLE PUBLICATIONS

- A. The publication listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. National Fire Protection Association (NFPA):
 - 70-2008.....National Electric Code (NEC)
- C. American Society for Testing and Materials (ASTM):
 - F441/F441M-02 (2008) ... Standard Specification for Chlorinated Poly (Vinyl Chloride) (CPVC) Plastic Pipe, Schedules 40 and 80

PART 2 - PRODUCTS

2.1 CLEANING COMPOUNDS

- A. Alkaline phosphate or non-phosphate detergent/surfactant/specific to remove organic soil, hydrocarbons, flux, pipe mill varnish, pipe compounds, iron oxide, and like deleterious substances, with or without inhibitor, suitable for system wetted metals without deleterious effects.
- B. All chemicals to be acceptable for discharge to sanitary sewer.
- C. Refer to Section 23 21 13, HYDRONIC PIPING and Section 23 22 13, STEAM and CONDENSATE HEATING PIPING, PART 3, for flushing and cleaning procedures.

2.2 CHEMICAL TREATMENT FOR CLOSED LOOP SYSTEMS

- A. Inhibitor: Provide sodium nitrite/borate, molybdate-based inhibitor or other approved compound suitable for make-up quality and make-up rate and which will cause or enhance bacteria/corrosion problems or mechanical seal failure due to excessive total dissolved solids. Shot feed manually. Maintain inhibitor residual as determined by water treatment laboratory, taking into consideration residual and temperature effect on pump mechanical seals.
- B. pH Control: Inhibitor formulation shall include adequate buffer to maintain pH range of 8.0 to 10.5.
- C. Performance: Protect various wetted, coupled, materials of construction including ferrous, and red and yellow metals. Maintain system essentially free of scale, corrosion, and fouling. Corrosion rate of following metals shall not exceed specified mills per year penetration; ferrous, 0-2; brass, 0-1; copper, 0-1. Inhibitor shall be stable at equipment skin surface temperatures and bulk water temperatures of not less than 121 degrees C (250 degrees F) and 52 degrees C (125 degrees Fahrenheit) respectively. Heat exchanger fouling and capacity reduction shall not exceed that allowed by fouling factor 0.0005.
- D. Pot Feeder: By-pass type, complete with necessary shut off valves, drain and air release valves, and system connections, for introducing chemicals into system, cast iron or steel tank with funnel or large opening on top for easy chemical addition. Feeders shall be 18.9 L (five gallon) minimum capacity at 860 kPa (125 psig) minimum working pressure.

2.3 EQUIPMENT AND MATERIALS IDENTIFICATION

Refer to Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Delivery and Storage: Deliver all chemicals in manufacturer's sealed shipping containers. Store in designated space and protect from deleterious exposure and hazardous spills.
- B. Install equipment furnished by the chemical treatment supplier and charge systems according to the manufacturer's instructions and as directed by the Technical Representative.
- C. Refer to Section 23 21 13 HYDRONIC PIPING for chemical treatment piping, installed as follows:

1. Provide a by-pass line around water meters and bleed off piping assembly. Provide ball valves to allow for bypassing, isolation, and servicing of components.
2. Bleed off water piping with bleed off piping assembly shall be piped from pressure side of circulating water piping to a convenient drain. Bleed off connection to main circulating water piping shall be upstream of chemical injection nozzles.
3. Provide piping for the flow assembly piping to the main control panel and accessories.
 - a. The inlet piping shall connect to the discharge side of the circulating water pump.
 - b. The outlet piping shall connect to the water piping serving the cooling tower downstream of the heat source.
 - c. Provide inlet Y-strainer and ball valves to isolate and service main control panel and accessories.
4. Install injection nozzles with corporation stops in the water piping serving the cooling tower downstream of the heat source.
5. Provide piping for corrosion monitor rack per manufacturer's installation instructions. Provide ball valves to isolate and service rack.
6. Provide installation supervision, start-up and operating instruction by manufacturer's technical representative.
- D. Before adding cleaning chemical to the closed system, all air handling coils and fan coil units should be isolated by closing the inlet and outlet valves and opening the bypass valves. This is done to prevent dirt and solids from lodging the coils.
- E. Do not valve in or operate system pumps until after system has been cleaned.
- F. After chemical cleaning is satisfactorily completed, open the inlet and outlet valves to each coil and close the by-pass valves. Also, clean all strainers.
- G. Perform tests and report results in accordance with Section 01 00 00, GENERAL REQUIREMENTS.
- H. After cleaning is complete, and water PH is acceptable to manufacturer of water treatment chemical, add manufacturer-recommended amount of chemicals to systems.
- I. Instruct VA personnel in system maintenance and operation in accordance with Section 01 00 00, GENERAL REQUIREMENTS.

- - - E N D - - -

**SECTION 23 31 00
HVAC DUCTS AND CASINGS**

PART 1 - GENERAL

1.1 DESCRIPTION

- A. Ductwork and accessories for HVAC including the following:
 - 1. Supply air, return air, outside air, exhaust, make-up air, and relief systems.
- B. Definitions:
 - 1. SMACNA Standards as used in this specification means the HVAC Duct Construction Standards, Metal and Flexible.
 - 2. Seal or Sealing: Use of liquid or mastic sealant, with or without compatible tape overlay, or gasketing of flanged joints, to keep air leakage at duct joints, seams and connections to an acceptable minimum.
 - 3. Duct Pressure Classification: SMACNA HVAC Duct Construction Standards, Metal and Flexible.
 - 4. Exposed Duct: Exposed to view in a finished room.

1.2 RELATED WORK

- A. Fire Stopping Material: Section 07 84 00, FIRESTOPPING.
- B. Outdoor and Exhaust Louvers: Section 08 90 00, LOUVERS and VENTS.
- C. General Mechanical Requirements: Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.
- D. Noise Level Requirements: Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING and EQUIPMENT.
- E. Duct Insulation: Section 23 07 11, HVAC, PLUMBING, and BOILER PLANT INSULATION
- F. Plumbing Connections: Section 22 11 00, FACILITY WATER DISTRIBUTION
- G. Terminal Units: Section 23 36 00, AIR TERMINAL UNITS.
- H. Duct Mounted Coils: Section 23 82 16, AIR COILS.
- I. Supply Air Fans: Section 23 73 00, INDOOR CENTRAL-STATION AIR-HANDLING UNITS.
- J. Return Air and Exhaust Air Fans: Section 23 34 00, HVAC FANS.
- K. Air Filters and Filters' Efficiencies: Section 23 40 00, HVAC AIR CLEANING DEVICES.
- L. Duct Mounted Instrumentation: Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC.

M. Testing and Balancing of Air Flows: Section 23 05 93, TESTING, ADJUSTING, and BALANCING FOR HVAC.

N. Smoke Detectors: Section 28 31 00, FIRE DETECTION and ALARM.

1.3 QUALITY ASSURANCE

- A. Refer to article, QUALITY ASSURANCE, in Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.
- B. Fire Safety Code: Comply with NFPA 90A.
- C. Duct System Construction and Installation: Referenced SMACNA Standards are the minimum acceptable quality.
- D. Duct Sealing, Air Leakage Criteria, and Air Leakage Tests: Ducts shall be sealed as per duct sealing requirements of SMACNA HVAC Air Duct Leakage Test Manual for duct pressure classes shown on the drawings.
- E. Duct accessories exposed to the air stream, such as dampers of all types (except smoke dampers) and access openings, shall be of the same material as the duct or provide at least the same level of corrosion resistance.

1.4 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Manufacturer's Literature and Data:
 - 1. Rectangular ducts:
 - a. Schedules of duct systems, materials and selected SMACNA construction alternatives for joints, sealing, gage and reinforcement.
 - b. Duct liner.
 - c. Sealants and gaskets.
 - d. Access doors.
 - 2. Round and flat oval duct construction details:
 - a. Manufacturer's details for duct fittings.
 - b. Duct liner.
 - c. Sealants and gaskets.
 - d. Access sections.
 - e. Installation instructions.
 - 3. Volume dampers, back draft dampers.
 - 4. Upper hanger attachments.
 - 5. Fire dampers, fire doors, and smoke dampers with installation instructions.

- 6. Flexible ducts and clamps, with manufacturer's installation instructions.
- 7. Flexible connections.
- 8. Instrument test fittings.
- 9. Details and design analysis of alternate or optional duct systems.
- 10 COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.
- C. Coordination Drawings: Refer to article, SUBMITTALS, in Section 23 05

1.5 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American Society of Civil Engineers (ASCE):
 - ASCE7-05.....Minimum Design Loads for Buildings and Other Structures
- C. American Society for Testing and Materials (ASTM):
 - A167-99(2009).....Standard Specification for Stainless and Heat-Resisting Chromium-Nickel Steel Plate, Sheet, and Strip
 - A653-09.....Standard Specification for Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy coated (Galvannealed) by the Hot-Dip process
 - A1011-09a.....Standard Specification for Steel, Sheet and Strip, Hot rolled, Carbon, structural, High-Strength Low-Alloy, High Strength Low-Alloy with Improved Formability, and Ultra-High Strength
 - B209-07.....Standard Specification for Aluminum and Aluminum-Alloy Sheet and Plate
 - C1071-05e1.....Standard Specification for Fibrous Glass Duct Lining Insulation (Thermal and Sound Absorbing Material)
 - E84-09a.....Standard Test Method for Surface Burning Characteristics of Building Materials
- D. National Fire Protection Association (NFPA):
 - 90A-09.....Standard for the Installation of Air Conditioning and Ventilating Systems
 - 96-08.....Standard for Ventilation Control and Fire Protection of Commercial Cooking Operations

- E. Sheet Metal and Air Conditioning Contractors National Association (SMACNA):
 - 2nd Edition - 2005.....HVAC Duct Construction Standards, Metal and Flexible
 - 1st Edition - 1985.....HVAC Air Duct Leakage Test Manual
 - 6th Edition - 2003.....Fibrous Glass Duct Construction Standards
- F. Underwriters Laboratories, Inc. (UL):
 - 181-08.....Factory-Made Air Ducts and Air Connectors
 - 555-06Standard for Fire Dampers
 - 555S-06Standard for Smoke Dampers

PART 2 - PRODUCTS

2.1 DUCT MATERIALS AND SEALANTS

- A. General: Except for systems specified otherwise, construct ducts, casings, and accessories of galvanized sheet steel, ASTM A653, coating G90; or, aluminum sheet, ASTM B209, alloy 1100, 3003 or 5052.
- B. Joint Sealing: Refer to SMACNA HVAC Duct Construction Standards, paragraph S1.9.
 - 1. Sealant: Elastomeric compound, gun or brush grade, maximum 25 flame spread and 50 smoke developed (dry state) compounded specifically for sealing ductwork as recommended by the manufacturer. Generally provide liquid sealant, with or without compatible tape, for low clearance slip joints and heavy, permanently elastic, mastic type where clearances are larger. Oil base caulking and glazing compounds are not acceptable because they do not retain elasticity and bond.
 - 2. Tape: Use only tape specifically designated by the sealant manufacturer and apply only over wet sealant. Pressure sensitive tape shall not be used on bare metal or on dry sealant.
 - 3. Gaskets in Flanged Joints: Soft neoprene.
- C. Approved factory made joints may be used.

2.2 DUCT CONSTRUCTION AND INSTALLATION

- A. Regardless of the pressure classifications outlined in the SMACNA Standards, fabricate and seal the ductwork in accordance with the following pressure classifications:
- B. Duct Pressure Classification:
 - 0 to 50 mm (2 inch)
 - > 50 mm to 75 mm (2 inch to 3 inch)
 - > 75 mm to 100 mm (3 inch to 4 inch)

Show pressure classifications on the floor plans.

- C. Seal Class: All ductwork shall receive Class A Seal
- D. Round and Flat Oval Ducts: Furnish duct and fittings made by the same manufacturer to insure good fit of slip joints. When submitted and approved in advance, round and flat oval duct, with size converted on the basis of equal pressure drop, may be furnished in lieu of rectangular duct design shown on the drawings.
1. Elbows: Diameters 80 through 200 mm (3 through 8 inches) shall be two sections die stamped, all others shall be gored construction, maximum 18 degree angle, with all seams continuously welded or standing seam. Coat galvanized areas of fittings damaged by welding with corrosion resistant aluminum paint or galvanized repair compound.
 2. Provide bell mouth, conical tees or taps, laterals, reducers, and other low loss fittings as shown in SMACNA HVAC Duct Construction Standards.
 3. Ribbed Duct Option: Lighter gage round/oval duct and fittings may be furnished provided certified tests indicating that the rigidity and performance is equivalent to SMACNA standard gage ducts are submitted.
 - a. Ducts: Manufacturer's published standard gage, G90 coating, spiral lock seam construction with an intermediate standing rib.
 - b. Fittings: May be manufacturer's standard as shown in published catalogs, fabricated by spot welding and bonding with neoprene base cement or machine formed seam in lieu of continuous welded seams.
 4. Provide flat side reinforcement of oval ducts as recommended by the manufacturer and SMACNA HVAC Duct Construction Standard S3.13.
Because of high pressure loss, do not use internal tie-rod reinforcement unless approved by the Resident Engineer.
- E. Casings and Plenums: Construct in accordance with SMACNA HVAC Duct Construction Standards Section 6, including curbs, access doors, pipe penetrations, eliminators and drain pans. Access doors shall be hollow metal, insulated, with latches and door pulls, 500 mm (20 inches) wide by 1200 - 1350 mm (48 - 54 inches) high. Provide view port in the doors where shown. Provide drain for outside air louver plenum. Outside air plenum shall have exterior insulation. Drain piping shall be routed to the nearest floor drain.

- F. Volume Dampers: Single blade or opposed blade, multi-louver type as detailed in SMACNA Standards. Refer to SMACNA Detail Figure 2-12 for Single Blade and Figure 2.13 for Multi-blade Volume Dampers.
- G. Duct Hangers and Supports: Refer to SMACNA Standards Section IV. Avoid use of trapeze hangers for round duct.

2.3 DUCT LINER (WHERE INDICATED ON DRAWINGS)

- A. Duct sizes shown on drawings for lined duct are clear opening inside lining.
- B. Duct liner is only permitted to be used for return, relief and general exhaust ducts. Duct liner is not permitted for outside air ducts, supply air ducts or any other positive pressure ductwork (provide exterior insulation only).
- C. Rectangular Duct or Casing Liner: ASTM C1071, Type I (flexible), or Type II (board), 25 mm (one inch) minimum thickness, applied with mechanical fasteners and 100 percent coverage of adhesive in conformance with SMACNA, Duct Liner Application Standard.
- D. Round and Oval Duct Liner: Factory fabricated double-walled with 25 mm (one inch) thick sound insulation and inner perforated galvanized metal liner. Construction shall comply with flame and smoke rating required by NFPA 90A. Metal liner shall be 1.0 to 0.60 mm (20 to 24 gage) having perforations not exceeding 2.4 mm (3/32 inch) diameter and approximately 22 percent free area. Metal liner for fittings need not be perforated. Assemblies shall be complete with continuous sheet Mylar liner, 2 mil thickness, between the perforated liner and the insulation to prevent erosion of the insulation. Provide liner couplings/spacer for metal liner. At the end of insulated sections, provide insulation end fittings to reduce outer shell to liner size. Provide liner spacing/concentricity leaving airway unobstructed.

2.4 DUCT ACCESS DOORS, PANELS AND SECTIONS

- A. Provide access doors, sized and located for maintenance work, upstream, in the following locations:
 - 1. Each duct mounted coil.
 - 2. Each fire damper (for link service), smoke damper and automatic control damper.
 - 3. Each duct mounted smoke detector.
- B. Openings shall be as large as feasible in small ducts, 300 mm by 300 mm (12 inch by 12 inch) minimum where possible. Access sections in

insulated ducts shall be double-wall, insulated. Transparent shatterproof covers are preferred for uninsulated ducts.

1. For rectangular ducts: Refer to SMACNA HVAC Duct Construction Standards (Figure 2-12).
2. For round and flat oval duct: Refer to SMACNA HVAC duct Construction Standards (Figure 2-11).

2.5 FIRE DAMPERS

- A. Galvanized steel, interlocking blade type, UL listing and label, 1-1/2 hour rating, 70 degrees C (160 degrees F) fusible line, 100 percent free opening with no part of the blade stack or damper frame in the air stream.
- B. Fire dampers in wet air exhaust shall be of stainless steel construction, all others may be galvanized steel.
- C. Minimum requirements for fire dampers:
 1. The damper frame may be of design and length as to function as the mounting sleeve, thus eliminating the need for a separate sleeve, as allowed by UL 555. Otherwise provide sleeves and mounting angles, minimum 1.9 mm (14 gage), required to provide installation equivalent to the damper manufacturer's UL test installation.
 2. Submit manufacturer's installation instructions conforming to UL rating test.

2.6 FLEXIBLE AIR DUCT

- A. General: Factory fabricated, complying with NFPA 90A for connectors not passing through floors of buildings. Flexible ducts shall not penetrate any fire or smoke barrier which is required to have a fire resistance rating of one hour or more. Flexible duct length shall not exceed 1.5 m (5 feet). Provide insulated acoustical air duct connectors in supply air duct systems and elsewhere as shown.
- B. Flexible ducts shall be listed by Underwriters Laboratories, Inc., complying with UL 181. Ducts larger than 200 mm (8 inches) in diameter shall be Class 1. Ducts 200 mm (8 inches) in diameter and smaller may be Class 1 or Class 2.
- C. Insulated Flexible Air Duct: Factory made including mineral fiber insulation with maximum C factor of 0.25 at 24 degrees C (75 degrees F) mean temperature, encased with a low permeability moisture barrier outer jacket, having a puncture resistance of not less than 50 Beach Units. Acoustic insertion loss shall not be less than 3 dB per 300 mm

(foot) of straight duct, at 500 Hz, based on 150 mm (6 inch) duct, of 750 m/min (2500 fpm).

D. Application Criteria:

1. Temperature range: -18 to 93 degrees C (0 to 200 degrees F) internal.
2. Maximum working velocity: 1200 m/min (4000 feet per minute).
3. Minimum working pressure, inches of water gage: 2500 Pa (10 inches) positive, 500 Pa (2 inches) negative.

- E. Duct Clamps: 100 percent nylon strap, 80 kg (175 pounds) minimum loop tensile strength manufactured for this purpose or stainless steel strap with cadmium plated worm gear tightening device. Apply clamps with sealant and as approved for UL 181, Class 1 installation.

2.7 FLEXIBLE DUCT CONNECTIONS

- A. Where duct connections are made to fans and air handling units, install a non-combustible flexible connection of 822 g (29 ounce) neoprene coated fiberglass fabric approximately 150 mm (6 inches) wide. For connections exposed to sun and weather provide hypalon coating in lieu of neoprene. Burning characteristics shall conform to NFPA 90A. Securely fasten flexible connections to round ducts with stainless steel or zinc-coated iron draw bands with worm gear fastener. For rectangular connections, crimp fabric to sheet metal and fasten sheet metal to ducts by screws 50 mm (2 inches) on center. Fabric shall not be stressed other than by air pressure. Allow at least 25 mm (one inch) slack to insure that no vibration is transmitted.

2.8 FIRESTOPPING MATERIAL

- A. Refer to Section 07 84 00, FIRESTOPPING.

2.9 DUCT MOUNTED THERMOMETER (AIR)

- A. Stem Type Thermometers: ASTM E1, 7 inch scale, red appearing mercury, lens front tube, cast aluminum case with enamel finish and clear glass or polycarbonate window, brass stem, 2 percent of scale accuracy to ASTM E77 scale calibrated in degrees Fahrenheit.
- B. Thermometer Supports:
1. Socket: Brass separable sockets for thermometer stems with or without extensions as required, and with cap and chain.
 2. Flange: 3 inch outside diameter reversible flange, designed to fasten to sheet metal air ducts, with brass perforated stem.

2.10 DUCT MOUNTED TEMPERATURE SENSOR (AIR)

- A. Refer to Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC.

2.11 INSTRUMENT TEST FITTINGS

- A. Manufactured type with a minimum 50 mm (two inch) length for insulated duct, and a minimum 25 mm (one inch) length for duct not insulated. Test hole shall have a flat gasket for rectangular ducts and a concave gasket for round ducts at the base, and a screw cap to prevent air leakage.
- B. Provide instrument test holes at each duct or casing mounted temperature sensor or transmitter, and at entering and leaving side of each heating coil, cooling coil, and heat recovery unit.

PART 3 - EXECUTION**3.1 INSTALLATION**

- A. Comply with provisions of Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION, particularly regarding coordination with other trades and work in existing buildings.
- B. Fabricate and install ductwork and accessories in accordance with referenced SMACNA Standards:
 - 1. Drawings show the general layout of ductwork and accessories but do not show all required fittings and offsets that may be necessary to connect ducts to equipment, boxes, diffusers, grilles, etc., and to coordinate with other trades. Fabricate ductwork based on field measurements. Provide all necessary fittings and offsets at no additional cost to the government. Coordinate with other trades for space available and relative location of HVAC equipment and accessories on ceiling grid. Duct sizes on the drawings are inside dimensions which shall be altered by Contractor to other dimensions with the same air handling characteristics where necessary to avoid interferences and clearance difficulties.
 - 2. Provide duct transitions, offsets and connections to dampers, coils, and other equipment in accordance with SMACNA Standards, Section II. Provide streamliner, when an obstruction cannot be avoided and must be taken in by a duct. Repair galvanized areas with galvanizing repair compound.
 - 3. Provide bolted construction and tie-rod reinforcement in accordance with SMACNA Standards.
 - 4. Construct casings, eliminators, and pipe penetrations in accordance with SMACNA Standards, Chapter 6. Design casing access doors to swing against air pressure so that pressure helps to maintain a tight seal.

- C. Install duct hangers and supports in accordance with SMACNA Standards, Chapter 4.
- D. Install fire dampers, smoke in accordance with the manufacturer's instructions to conform to the installation used for the rating test. Install fire dampers, at locations indicated and where ducts penetrate fire rated walls, shafts and where required by the Resident Engineer. Install with required perimeter mounting angles, sleeves, breakaway duct connections, corrosion resistant springs, bearings, bushings and hinges per UL and NFPA. Demonstrate re-setting of fire dampers to the Resident Engineer.
- E. Seal openings around duct penetrations of floors and fire rated partitions with fire stop material as required by NFPA 90A.
- F. Flexible duct installation: Refer to SMACNA Standards, Chapter 3. Ducts shall be continuous, single pieces not over 1.5 m (5 feet) long (NFPA 90A), as straight and short as feasible, adequately supported. Centerline radius of bends shall be not less than two duct diameters. Make connections with clamps as recommended by SMACNA. Clamp per SMACNA with one clamp on the core duct and one on the insulation jacket. Flexible ducts shall not penetrate floors, or any chase or partition designated as a fire barrier, including corridor partitions fire rated one hour or two hour. Support ducts SMACNA Standards.
- G. Where diffusers, registers and grilles cannot be installed to avoid seeing inside the duct, paint the inside of the duct with flat black paint to reduce visibility.
- H. Control Damper Installation:
 - 1. Provide necessary blank-off plates required to install dampers that are smaller than duct size. Provide necessary transitions required to install dampers larger than duct size.
 - 2. Assemble multiple sections dampers with required interconnecting linkage and extend required number of shafts through duct for external mounting of damper motors.
 - 3. Provide necessary sheet metal baffle plates to eliminate stratification and provide air volumes specified. Locate baffles by experimentation, and affix and seal permanently in place, only after stratification problem has been eliminated.
 - 4. Install all damper control/adjustment devices on stand-offs to allow complete coverage of insulation.

- I. Air Flow Measuring Devices (AFMD): Install units with minimum straight run distances, upstream and downstream as recommended by the manufacturer.
- J. Low Pressure Duct Liner: Install in accordance with SMACNA, Duct Liner Application Standard.
- K. Protection and Cleaning: Adequately protect equipment and materials against physical damage. Place equipment in first class operating condition, or return to source of supply for repair or replacement, as determined by the Resident Engineer. Protect equipment and ducts during construction against entry of foreign matter to the inside and clean both inside and outside before operation and painting. When new ducts are connected to existing ductwork, clean both new and existing ductwork by mopping and vacuum cleaning inside and outside before operation.

3.2 DUCT LEAKAGE TESTS AND REPAIR

- A. Ductwork leakage testing shall be performed by the Testing and Balancing Contractor directly contracted by the General Contractor and independent of the Sheet Metal Contractor.
- B. Ductwork leakage testing shall be performed for the entire air distribution system (including all supply, return, exhaust and relief ductwork), section by section, including fans, coils and filter sections.
- C. Test procedure, apparatus and report shall conform to SMACNA Leakage Test manual. The maximum leakage rate allowed is 4 percent of the design air flow rate.
- D. All ductwork shall be leak tested first before enclosed in a shaft or covered in other inaccessible areas.
- E. All tests shall be performed in the presence of the Resident Engineer and the Test and Balance agency. The Test and Balance agency shall measure and record duct leakage and report to the Resident Engineer and identify leakage source with excessive leakage.
- F. If any portion of the duct system tested fails to meet the permissible leakage level, the Contractor shall rectify sealing of ductwork to bring it into compliance and shall retest it until acceptable leakage is demonstrated to the Contracting Officer's Technical Representative (COTR).
- G. All tests and necessary repairs shall be completed prior to insulation or concealment of ductwork.

H. Make sure all openings used for testing flow and temperatures by TAB Contractor are sealed properly.

3.4 TESTING, ADJUSTING AND BALANCING (TAB)

A. Refer to Section 23 05 93, TESTING, ADJUSTING, and BALANCING FOR HVAC.

3.5 OPERATING AND PERFORMANCE TESTS

A. Refer to Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION

- - - E N D - - -

SECTION 23 34 00
HVAC FANS

PART 1 - GENERAL

1.1 DESCRIPTION

- A. Fans for heating, ventilating and air conditioning.
- B. Product Definitions: AMCA Publication 99, Standard 1-66.

1.2 RELATED WORK

- A. Section 01 00 00, GENERAL REQUIREMENTS.
- B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- C. Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION.
- D. Section 23 05 12, GENERAL MOTOR REQUIREMENTS FOR HVAC AND STEAM GENERATION EQUIPMENT.
- E. Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT.
- F. Section 23 05 93, TESTING, ADJUSTING, AND BALANCING FOR HVAC.
- G. Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC.
- H. Section 23 73 00, INDOOR CENTRAL-STATION AIR-HANDLING UNITS.
- I. Section 23 82 16, AIR COILS.
- J. Section 26 29 11, LOW-VOLTAGE MOTOR STARTERS.

1.3 QUALITY ASSURANCE

- A. Refer to paragraph, QUALITY ASSURANCE, in Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION.
- B. Fans and power ventilators shall be listed in the current edition of AMCA 261, and shall bear the AMCA performance seal.
- C. Operating Limits for Centrifugal Fans: AMCA 99 (Class I, II, and III).
- D. Fans and power ventilators shall comply with the following standards:
 - 1. Testing and Rating: AMCA 210.
 - 2. Sound Rating: AMCA 300.
- E. Vibration Tolerance for Fans and Power Ventilators: Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT.
- F. Performance Criteria:
 - 1. The fan schedule shall show the design air volume and static pressure. Select the fan motor HP by increasing the fan BHP by 10 percent to account for the drive losses and field conditions.
 - 2. Select the fan operating point as follows:
 - a. Forward Curve and Axial Flow Fans: Right hand side of peak pressure point

- b. Air Foil, Backward Inclined, or Tubular: At or near the peak static efficiency
- G. Safety Criteria: Provide manufacturer's standard screen on fan inlet and discharge where exposed to operating and maintenance personnel.
- H. Corrosion Protection:
 - 1. All steel shall be mill-galvanized, or phosphatized and coated with minimum two coats, corrosion resistant enamel paint. Manufacturers paint and paint system shall meet the minimum specifications of: ASTM D1735 water fog; ASTM B117 salt spray; ASTM D3359 adhesion; and ASTM G152 and G153 for carbon arc light apparatus for exposure of non-metallic material.
- I. Spark resistant construction: If flammable gas, vapor or combustible dust is present in concentrations above 20% of the Lower Explosive Limit (LEL), the fan construction shall be as recommended by AMCA's Classification for Spark Resistant Construction. Drive set shall be comprised of non-static belts for use in an explosive.

1.4 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Manufacturers Literature and Data:
 - 1. Fan sections, motors and drives.
 - 2. Centrifugal fans, motors, drives, accessories and coatings.
 - a. In-line centrifugal fans.
 - b. Industrial fans.
 - c. Utility fans and vent sets.
- C. Certified Sound power levels for each fan.
- D. Motor ratings types, electrical characteristics and accessories.
- E. Roof curbs.
- F. Belt guards.
- G. Maintenance and Operating manuals in accordance with Section 01 00 00, GENERAL REQUIREMENTS.
- H. Certified fan performance curves for each fan showing cubic feet per minute (CFM) versus static pressure, efficiency, and horsepower for design point of operation.

1.5 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.

- B. Air Movement and Control Association International, Inc. (AMCA):
 - 99-86.....Standards Handbook
 - 210-06.....Laboratory Methods of Testing Fans for
Aerodynamic Performance Rating
 - 261-09.....Directory of Products Licensed to bear the AMCA
Certified Ratings Seal - Published Annually
 - 300-08.....Reverberant Room Method for Sound Testing of
Fans
- C. American Society for Testing and Materials (ASTM):
 - B117-07a.....Standard Practice for Operating Salt Spray
(Fog) Apparatus
 - D1735-08.....Standard Practice for Testing Water Resistance
of Coatings Using Water Fog Apparatus
 - D3359-08.....Standard Test Methods for Measuring Adhesion by
Tape Test
 - G152-06.....Standard Practice for Operating Open Flame
Carbon Arc Light Apparatus for Exposure of Non-
Metallic Materials
 - G153-04.....Standard Practice for Operating Enclosed Carbon
Arc Light Apparatus for Exposure of Non-
Metallic Materials
- D. National Fire Protection Association (NFPA):
 - NFPA 96-08.....Standard for Ventilation Control and Fire
Protection of Commercial Cooking Operations
- E. Underwriters Laboratories, Inc. (UL):
 - 181-2005.....Factory Made Air Ducts and Air Connectors

1.6 EXTRA MATERIALS

- A. Provide one additional set of belts for all belt-driven fans.

PART 2 - PRODUCTS

2.1 FAN SECTION (CABINET FAN)

Refer to specification Section 23 73 00, INDOOR CENTRAL-STATION AIR-HANDLING UNITS.

2.2 CENTRIFUGAL FANS

- A. Standards and Performance Criteria: Refer to Paragraph, QUALITY ASSURANCE. Record factory vibration test results on the fan or furnish to the Contractor.
- B. Fan arrangement, unless noted or approved otherwise:
 - 1. SWS1 fans: Arrangement 1, 3, 9 or 10.

- C. Construction: Wheel diameters and outlet areas shall be in accordance with AMCA standards.
1. Housing: Low carbon steel, arc welded throughout, braced and supported by structural channel or angle iron to prevent vibration or pulsation, flanged outlet, inlet fully streamlined. Provide lifting clips, and casing drain. Provide manufacturer's standard access door. Provide 12.5 mm (1/2 inches) wire mesh screens for fan inlets without duct connections.
 2. Wheel: Steel plate with die formed blades welded or riveted in place, factory balanced statically and dynamically.
 3. Shaft: Designed to operate at no more than 70 percent of the first critical speed at the top of the speed range of the fans class.
 4. Bearings: Heavy duty ball or roller type sized to produce a B10 life of not less than 50,000 hours, and an average fatigue life of 200,000 hours. Extend filled lubrication tubes for interior bearings or ducted units to outside of housing.
 5. Belts: Oil resistant, non-sparking and non-static.
 6. Belt Drives: Factory installed with final alignment belt adjustment made after installation.
 7. Motors and Fan Wheel Pulleys: Adjustable pitch for use with motors through 15HP, fixed pitch for use with motors larger than 15HP. Select pulleys so that pitch adjustment is at the middle of the adjustment range at fan design conditions.
 8. Motor, adjustable motor base, drive and guard: Furnish from factory with fan. Refer to Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION for specifications. Provide protective sheet metal enclosure for fans located outdoors.
 9. Furnish variable speed fan motor controllers where shown on the drawings. Refer to Section, MOTOR STARTERS. Refer to Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION for controller/motor combination requirements.
- D. In-line Centrifugal Fans: In addition to the requirements of paragraphs A and 2.2.C3 thru 2.2.C9, provide minimum 18 Gauge galvanized steel housing with inlet and outlet flanges, backward inclined aluminum centrifugal fan wheel, bolted access door and supports as required. Motors shall be factory pre-wired to an external junction box.
- E. Utility Fans, Vent Sets and Small Capacity Fans: Class 1 design, arc welded housing, spun intake cone. Applicable construction

specification, paragraphs A and C, for centrifugal fans shall apply for wheel diameters 300 mm (12 inches) and larger. Requirement for AMCA seal is waived for wheel diameters less than 300 mm (12 inches) and housings may be cast iron.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Install fan, motor and drive in accordance with manufacturer's instructions.
- B. Align fan and motor sheaves to allow belts to run true and straight.
- C. Install vibration control devices as shown on drawings and specified in Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT.

3.2 PRE-OPERATION MAINTENANCE

- A. Lubricate bearings, pulleys, belts and other moving parts with manufacturer recommended lubricants.
- B. Rotate impeller by hand and check for shifting during shipment and check all bolts, collars, and other parts for tightness.
- C. Clean fan interiors to remove foreign material and construction dirt and dust.

3.3 START-UP AND INSTRUCTIONS

- A. Verify operation of motor, drive system and fan wheel according to the drawings and specifications.
- B. Check vibration and correct as necessary for air balance work.
- C. After air balancing is complete and permanent sheaves are in place perform necessary field mechanical balancing to meet vibration tolerance in Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT.

- - - E N D - - -

SECTION 23 36 00
AIR TERMINAL UNITS

PART 1 - GENERAL

1.1 DESCRIPTION

Air terminal units, air flow control valves.

1.2 RELATED WORK

- A. Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION: General mechanical requirements and items, which are common to more than one section of Division 23.
- B. Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT: Noise requirements.
- C. Section 23 31 00, HVAC DUCTS AND CASINGS: Ducts and flexible connectors.
- D. Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC: Valve operators.
- E. Section 23 05 93, TESTING, ADJUSTING, AND BALANCING FOR HVAC: Flow rates adjusting and balancing.
- F. Section 23 82 16, AIR COILS: Heating and Cooling Coils pressure ratings.

1.3 QUALITY ASSURANCE

Refer to Paragraph, QUALITY ASSURANCE, in Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION.

1.4 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Manufacturer's Literature and Data:
 - 1. Air Terminal Units: Submit test data.
- C. Certificates:
 - 1. Compliance with paragraph, QUALITY ASSURANCE.
 - 2. Compliance with specified standards.
- D. Operation and Maintenance Manuals: Submit in accordance with paragraph, INSTRUCTIONS, in Section 01 00 00, GENERAL REQUIREMENTS.

1.5 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.

- B. Air Conditioning and Refrigeration Institute (AHRI)/(ARI):
 880-08.....Air Terminals Addendum to ARI 888-98
 incorporated into standard posted 15th December
 2002
- C. National Fire Protection Association (NFPA):
 90A-09.....Standard for the Installation of Air
 Conditioning and Ventilating Systems
- D. Underwriters Laboratories, Inc. (UL):
 181-08.....Standard for Factory-Made Air Ducts and Air
 Connectors
- E. American Society for Testing and Materials (ASTM):
 C 665-06.....Standard Specification for Mineral-Fiber
 Blanket Thermal Insulation for Light Frame
 Construction and Manufactured Housing

1.6 GUARANTY

In accordance with the GENERAL CONDITIONS

PART 2 - PRODUCTS

2.1 GENERAL

- A. Coils:
 - 3. Water Heating Coils:
 - a. ARI certified, continuous plate or spiral fin type, leak tested at 2070 kPa (300 PSI).
 - b. Capacity: As indicated, based on scheduled entering water temperature.
 - c. Headers: Copper or Brass.
 - d. Fins: Aluminum, maximum 315 fins per meter (8 fins per inch).
 - e. Tubes: Copper, arrange for counter-flow of heating water.
 - f. Water Flow Rate: Minimum 0.032 Liters/second (0.5 GPM).
 - g. Provide vent and drain connection at high and low point, respectively of each coil.
 - h. Coils shall be guaranteed to drain.
- B. Labeling: Control box shall be clearly marked with an identification label that lists such information as nominal CFM, maximum and minimum factory-set airflow limits, coil type and coil connection orientation, where applicable.
- C. Factory calibrate air terminal units to air flow rate indicated. All settings including maximum and minimum air flow shall be field adjustable.

- D. Dampers with internal air volume control: See section 23 31 00 HVAC DUCTS and CASINGS.

2.2 AIR TERMINAL UNITS (BOXES)

- A. General: Factory built, pressure independent units, factory set-field adjustable air flow rate, suitable for single duct applications. Clearly show on each unit the unit number and factory set air volumes corresponding to the contract drawings. Section 23 05 93, TESTING, ADJUSTING, AND BALANCING FOR HVAC work assumes factory set air volumes. Coordinate flow controller sequence and damper operation details with the drawings and Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC. All air terminal units shall be brand new products of the same manufacturer.
- B. Capacity and Performance: The Maximum Capacity of a single terminal unit shall not exceed 566 Liters/second (1,200 CFM).
- C. Sound Power Levels:
Acoustic performance of the air terminal units shall be based on the design noise levels for the spaces stipulated in Section 23 05 41 (Noise and Vibration Control for HVAC Piping and Equipment). Equipment schedule shall show the sound power levels in all octave bands. Terminal sound attenuators shall be provided, as required, to meet the intent of the design.
- D. Casing: Unit casing shall be constructed of galvanized steel no lighter than 0.85 mm (22 Gauge). Provide hanger brackets for attachment of supports.
1. Lining material: Suitable to provide required acoustic performance, thermal insulation and prevent sweating. Meet the requirements of NFPA 90A and comply with UL 181 for erosion as well as ASTM C 665 antimicrobial requirements. Insulation shall consist of 13 mm (1/2 IN) thick non-porous foil faced rigid fiberglass insulation of 4-lb/cu.ft, secured by full length galvanized steel z-strips which enclose and seal all edges. Tape and adhesives shall not be used. Materials shall be non-friable and with surfaces, including all edges, fully encapsulated and faced with perforated metal or coated so that the air stream will not detach material.
 2. Access panels (or doors): Provide panels large enough for inspection, adjustment and maintenance without disconnecting ducts, and for cleaning heating coils attached to unit, even if there are no moving parts. Panels shall be insulated to same standards as the

- rest of the casing and shall be secured and gasketed airtight. It shall require no tool other than a screwdriver to remove.
3. Total leakage from casing: Not to exceed 2 percent of the nominal capacity of the unit when subjected to a static pressure of 750 Pa (3 inch WG), with all outlets sealed shut and inlets fully open.
- E. Construct dampers and other internal devices of corrosion resisting materials which do not require lubrication or other periodic maintenance.
1. Damper Leakage: Not greater than 2 percent of maximum rated capacity, when closed against inlet static pressure of 1 kPa (4 inch WG).
- F. Provide multi-point velocity pressure sensors with external pressure taps.
1. Provide direct reading air flow rate table pasted to box.
- G. Provide static pressure tubes.
- H. Externally powered DDC variable air volume controller and damper actuator to be furnished under Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC for factory mounting on air terminal units. The DDC controller shall be electrically actuated.
- I. Fan powered terminal units:
1. General: The fan will be in a series configuration inside the unit casing.
 2. Fan assembly: Forward curved centrifugal direct drive blower with adjustable speed controller.
 - a. Motor: Integral thermal overload protection.
 - 1) 277 V single phase.
 - b. Motor assembly: Completely isolated from cabinet with rubber vibration mounts.
 3. Wiring: Factory mounted and wire controls. Mount electrical components NEMA-1 control box with removable cover. Incorporate single point electrical connection to power source. Provide terminal strip in control box for field wiring of power source. Provide factory wired non-fused disconnect switch on each terminal unit.
 4. Provide 1-inch thick throwaway filter in the return air inlet.

PART 3 - EXECUTION**3.1 INSTALLATION**

- A. Work shall be installed as shown and according to the manufacturer's diagrams and recommendations.
- B. Handle and install units in accordance with manufacturer's written instructions.
- C. Support units rigidly so they remain stationary at all times. Cross-bracing or other means of stiffening shall be provided as necessary. Method of support shall be such that distortion and malfunction of units cannot occur.
- D. Locate air terminal units to provide a straight section of inlet duct for proper functioning of volume controls. See VA Standard Detail.

3.2 OPERATIONAL TEST

Refer to Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION.

- - - E N D - - -

SECTION 23 37 00
AIR OUTLETS AND INLETS

1.1 DESCRIPTION

A. Air Outlets and Inlets: Diffusers, Registers, and Grilles.

1.2 RELATED WORK

- A. Outdoor and Exhaust Louvers: Section 08 90 00, LOUVERS AND VENTS.
- B. General Mechanical Requirements: Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION.
- C. Noise Level Requirements: Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT.
- D. Testing and Balancing of Air Flows: Section 23 05 93, TESTING, ADJUSTING, AND BALANCING FOR HVAC.

1.3 QUALITY ASSURANCE

- A. Refer to article, QUALITY ASSURANCE, in Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION.
- B. Fire Safety Code: Comply with NFPA 90A.

1.4 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Manufacturer's Literature and Data:
 - 1. Diffusers, registers, grilles and accessories.
- C. Coordination Drawings: Refer to article, SUBMITTALS, in Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION.

1.5 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. Air Diffusion Council Test Code:
 - 1062 GRD-84.....Certification, Rating, and Test Manual 4th Edition
- C. American Society of Civil Engineers (ASCE):
 - ASCE7-05.....Minimum Design Loads for Buildings and Other Structures
- D. American Society for Testing and Materials (ASTM):
 - A167-99 (2004).....Standard Specification for Stainless and Heat-Resisting Chromium-Nickel Steel Plate, Sheet and Strip

- B209-07.....Standard Specification for Aluminum and
Aluminum-Alloy Sheet and Plate
- E. National Fire Protection Association (NFPA):
- 90A-09.....Standard for the Installation of Air
Conditioning and Ventilating Systems
- F. Underwriters Laboratories, Inc. (UL):
- 181-08.....UL Standard for Safety Factory-Made Air Ducts
and Connectors

PART 2 - PRODUCTS

2.1 EQUIPMENT SUPPORTS

Refer to Section 21 05 11, COMMON WORK RESULTS FOR FIRE SUPPRESSION, Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING, and Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION.

2.2 AIR OUTLETS AND INLETS

A. Materials:

1. Steel or aluminum. Use aluminum air outlets and inlets for facilities located in high-humidity areas. Exhaust air registers located in combination toilets and shower stalls shall be constructed from aluminum. Provide manufacturer's standard gasket.
2. Exposed Fastenings: The same material as the respective inlet or outlet. Fasteners for aluminum may be stainless steel.
3. Contractor shall review all ceiling drawings and details and provide all ceiling mounted devices with appropriate dimensions and trim for the specific locations.

B. Performance Test Data: In accordance with Air Diffusion Council Code 1062GRD. Refer to Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT for NC criteria.

C. Air Supply Outlets:

1. Ceiling Diffusers: Suitable for surface mounting, exposed T-bar or special tile ceilings, off-white finish, square or round neck connection as shown on the drawings. Provide plaster frame for units in plaster ceilings.
 - a. Perforated face type: Manual adjustment for one-, two-, three-, or four-way horizontal air distribution pattern without change of air volume or pressure. Provide equalizing or control grid and opposed blade over overlapping blade damper. Perforated face diffusers for VAV systems shall have the pattern controller on

the inner face, rather than in the neck and designed to discharge air horizontally at the ceiling maintaining a Coanda effect.

b. Slot diffuser/plenum:

- 1) Diffuser: Frame and support bars shall be constructed of heavy gauge extruded aluminum. Form slots or use adjustable pattern controllers, to provide stable, horizontal air flow pattern over a wide range of operating conditions.
- 2) Galvanized steel boot lined with 13 mm (1/2 inch) thick fiberglass conforming to NFPA 90A and complying with UL 181 for erosion. The internal lining shall be factory-fabricated, anti-microbial, and non-friable.
- 3) Provide inlet connection diameter equal to duct diameter shown on drawings or provide transition coupling if necessary. Inlet duct and plenum size shall be as recommended by the manufacturer.
- 4) Maximum pressure drop at design flow rate: 37 Pa (0.15 inch W.G.)

D. Return and Exhaust Registers and Grilles: Provide opposed blade damper without removable key operator for registers.

1. Finish: Off-white baked enamel for ceiling mounted units. Wall units shall have a prime coat for field painting, or shall be extruded aluminum with manufacturer's standard aluminum finish.
2. Standard Type: Fixed horizontal face bars set at 30 to 45 degrees, approximately 30 mm (1-1/4 inch) margin.
3. Perforated Face Type: To match supply units.
4. Grid Core Type: 13 mm by 13 mm (1/2 inch by 1/2 inch) core with 30 mm (1-1/4 inch) margin.
5. Linear Type: To match supply units.
6. Egg Crate Grilles: Aluminum or Painted Steel 1/2 by 1/2 by 1/2 inch grid providing 90% free area.
 - a. Heavy extruded aluminum frame shall have countersunk screw mounting. Unless otherwise indicated, register blades and frame shall have factory applied white finish.
 - b. Grille shall be suitable for duct or surface mounting as indicated on drawings. All necessary appurtenances shall be provided to allow for mounting.

2.3 WIRE MESH GRILLE

- A. Fabricate grille with 2 x 2 mesh 13 mm (1/2 inch) galvanized steel or aluminum hardware cloth in a spot welded galvanized steel frame with approximately 40 mm (1-1/2 inch) margin.
- B. Use grilles where shown in unfinished areas such as mechanical rooms.

PART 3 - EXECUTION**3.1 INSTALLATION**

- A. Comply with provisions of Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION, particularly regarding coordination with other trades and work in existing buildings.
- B. Protection and Cleaning: Protect equipment and materials against physical damage. Place equipment in first class operating condition, or return to source of supply for repair or replacement, as determined by Resident Engineer. Protect equipment during construction against entry of foreign matter to the inside and clean both inside and outside before operation and painting.

3.2 TESTING, ADJUSTING AND BALANCING (TAB)

Refer to Section 23 05 93, TESTING, ADJUSTING, AND BALANCING FOR HVAC.

3.3 OPERATING AND PERFORMANCE TESTS

Refer to Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION

- - - E N D - - -

**SECTION 23 40 00
HVAC AIR CLEANING DEVICES**

PART 1 - GENERAL

1.1 DESCRIPTION

- A. Air filters for heating, ventilating and air conditioning.
- B. Definitions: Refer to ASHRAE Standard 52.1 for definitions of face velocity, net effective filtering area, media velocity, resistance pressure drop), atmospheric dust spot efficiency and dust-holding capacity. ASHRAE Standard 52.1 measures arrestance, dust spot efficiency and dust holding capacity of filters.
- C. Refer to ASHRAE Standard 52.2 for definitions of MERV (Minimum Efficiency Reporting Value), PSE (Particle Size Efficiency) and particle size ranges for each MERV number. ASHRAE Standard 52.2 measures particle size efficiency (PSE).

1.2 RELATED WORK

- A. General mechanical requirements and items, which are common to more than one section of Division 23: Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION.
- B. Filter housing and racks: Section 23 73 00, INDOOR CENTRAL-STATION AIR-HANDLING UNITS.

1.3 QUALITY ASSURANCE

- A. Air Filter Performance Report for Extended Surface Filters:
 - 1. Submit a test report for each Grade of filter being offered. The report shall not be more than three (3) years old and prepared by using test equipment, method and duct section as specified by ASHRAE Standards 52.1 and 52.2 for type filter under test and acceptable to Resident Engineer, indicating that filters comply with the requirements of this specification. Test for 150 m/min (500 fpm) will be accepted for lower velocity rated filters provided the test report of an independent testing laboratory complies with all the requirements of this specification.
 - 3. Guarantee Performance: The manufacturer shall supply ASHRAE 52.2 test reports on each filter type submitted. Any filter supplied will be required to maintain the minimum efficiency shown on the ASHRAE Standard 52.2 report throughout the time the filter is in service. Within the first 6-12 weeks of service a filter may be pulled out of service and sent to an independent laboratory for ASHRAE Standard 52.2 testing for initial efficiency only. If this filter fails to

meet the minimum level of efficiency shown in the previously submitted reports, the filter manufacturer/distributor shall take back all filters and refund the owner all monies paid for the filters, cost of installation, cost of freight and cost of testing.

- B. Filter Warranty for Extended Surface Filters: Guarantee the filters against leakage, blow-outs, and other deficiencies during their normal useful life, up to the time that the filter reaches the final pressure drop. Defective filters shall be replaced at no cost to the Government.
- C. Comply with UL Standard 586 for flame test.
- D. Nameplates: Each filter shall bear a label or name plate indicating manufacturer's name, filter size, rated efficiency, UL classification, and file number.

1.4 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturer's Literature and Data:
 - 1. Extended surface filters.
 - 2. Magnehelic gages.
- C. Air Filter performance reports.
- D. Suppliers warranty.
- E. Field test results for HEPA filters as per paragraph 2.3.E.3.

1.5 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by basic designation only.
- B. American Society of Heating, Refrigerating and Air-conditioning Engineers, Inc. (ASHRAE):
 - 52.1-92R.....Gravimetric and Dust-Spot procedures for
Testing Air Cleaning Devices Used in General
Ventilation for Removing Particulate Matter
 - 52.2-2007.....Method of Testing General Ventilation Air-
Cleaning Devices for Removal Efficiency by
Particle Size
- C. American Society of Mechanical Engineers (ASME):
 - NQA-1-2008.....Quality Assurance Requirements for Nuclear
Facilities Applications

D. Underwriters Laboratories, Inc. (UL):

586;Amendment 20 March 2000 High-Efficiency, Particulate, Air Filter
Units

900;Revision 15 July 2009 Test Performance of Air Filter Units

PART 2 - PRODUCTS

2.1 REPLACEMENT FILTER ELEMENTS TO BE FURNISHED

- A. To allow temporary use of HVAC systems for testing and in accordance with Paragraph, TEMPORARY USE OF MECHANICAL AND ELECTRICAL SYSTEMS in Section 01 00 00, GENERAL REQUIREMENTS, provide one complete set of spare filters to the Resident Engineer.
- B. The Resident Engineer will direct whether these additional filters will either be installed as replacements for dirty units or turned over to VA for future use as replacements.

2.2 EXTENDED SURFACE AIR FILTERS

- A. Use factory assembled air filters of the extended surface type with supported or non-supported cartridges for removal of particulate matter in air conditioning, heating and ventilating systems. Filter units shall be of the extended surface type fabricated for disposal when the dust-load limit is reached as indicated by maximum (final) pressure drop.
- B. Filter Classification: UL approved Class 1 or Class 2 conforming to UL Standard 900.
- C. Filter Grades, Percent, Average ASHRAE Efficiency and Controlled Containment:

Table 2.2C

Filter Grades				
MERV Value ASHRAE 52.2	Application	Dust-Spot Efficiency ASHRAE 52.1	Particle Size	Thickness /Type
8	Pre-Filter	30 to 35%	3 to 10 Microns	50 mm (2-inch) Throwaway
13	After-Filter	80 to 90%	0.3 to 1 Micron	300 mm (12-inch) Rigid Cartridge

D. Filter Media:

- 1. MERV 11, 13, and 14 Supported (Rigid Pleated) Type: Media shall be composed of high density glass fibers or other suitable fibers.

Fastening methods used to maintain pleat shape, (metal backing or aluminum separators) shall be sealed in a proper enclosing frame to insure no air leakage for life of filter. Staples and stays are prohibited.

2. MERV 7 and 8 (Pleated) Type: Media shall be composed of synthetic/natural fibers. Media shall maintain uniform pleat shape and stability for proper air flow and maximum dust loading. The media frame shall be constructed of aluminized steel. Bond the pleated media pack on all four edges to insure no air leakage for the life of the filter. Staples and stays are prohibited.

E. Filter Efficiency and Arrestance: Efficiency and arrestance of filters shall be determined in accordance with ASHRAE Standard 52.1, and MERV value in accordance with ASHRAE Standard 52.2.

F. Maximum initial resistance, recommended change over pressure drop, and maximum recommended final resistance, PA (inches of water), for each filter cartridge when operated at 150 m/min (500 feet per minute) face velocity shall be as specified in Table 2.2.F:

Table 2.2.F

Filter Initial and Final Resistance			
	Initial Resistance	Maximum Recommended Change Over Pressure Drop	Maximum Final Resistance
MERV 8 (2-inch deep)	95 (0.38)	190 (0.76)	250 (1.00)
MERV 13 (12-inch deep)	125 (0.50)	250 (1.00)	375 (1.50)

G. Equipment Identification: Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION.

2.3 INSTRUMENTATION

- A. Magnehelic Differential Pressure Filter Gages: Nominal 100 mm (four inch) diameter, zero to 500 Pa (zero to two inch water gage), Gauges shall be flush-mounted in aluminum panel board, complete with static tips, copper or aluminum tubing, and accessory items to provide zero adjustment.
- B. DDC static (differential) air pressure measuring station. Refer to Specification Section 23 09 23 DIRECT DIGITAL CONTROL SYSTEM FOR HVAC
- C. Provide one DDC sensor across each extended surface filter. Provide Petcocks for each gauge or sensor.

- D. Provide one common filter gauge for two-stage filter banks with isolation valves to allow differential pressure measurement.

2.4 HVAC EQUIPMENT FACTORY FILTERS

- A. Manufacturer standard filters within fabricated packaged equipment should be specified with the equipment and should adhere to industry standard.
- B. Cleanable filters are not permitted.
- C. Automatic Roll Type filters are not permitted.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Install supports, filters and gages in accordance with manufacturer's instructions.

3.2 START-UP AND TEMPORARY USE

- A. Clean and vacuum air handling units and plenums prior to starting air handling systems.
- B. Install or deliver replacement filter units as directed by the Resident Engineer.

- - E N D - - -

SECTION 23 64 00
PACKAGED WATER CHILLERS

PART 1 - GENERAL

1.1 DESCRIPTION

- A. Rotary-Screw air-cooled chillers complete with accessories.

1.2 RELATED WORK

- A. Section 00 72 00, GENERAL CONDITIONS.
- B. Section 01 00 00, GENERAL REQUIREMENTS.
- C. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- D. Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.
- E. Section 23 21 23, HYDRONIC PUMPS.
- F. Section 23 05 41, NOISE and VIBRATION CONTROL FOR HVAC PIPING and EQUIPMENT.
- G. Section 23 21 13, HYDRONIC PIPING.
- H. Section 23 05 12, GENERAL MOTOR REQUIREMENTS FOR HVAC and STEAM GENERATION EQUIPMENT.
- I. Section 26 29 11, LOW-VOLTAGE MOTOR STARTERS.
- J. Section 23 81 00, DECENTRALIZED UNITARY HVAC EQUIPMENT.
- K. Section 01 91 00, GENERAL COMMISSIONING REQUIREMENTS
- L. Section 23 08 00, COMMISSIONING OF HVAC SYSTEMS: Requirements for commissioning, systems readiness checklists, and training.

1.3 DEFINITION

- A. Engineering Control Center (ECC): The centralized control point for the intelligent control network. The ECC comprises of personal computer and connected devices to form a single workstation.
- B. BACNET: Building Automation Control Network Protocol, ASHRAE Standard 135.
- C. Ethernet: A trademark for a system for exchanging messages between computers on a local area network using coaxial, fiber optic, or twisted-pair cables.
- D. FTT-10: Echelon Transmitter-Free Topology Transceiver.

1.4 QUALITY ASSURANCE

- A. Refer to Paragraph, QUALITY ASSURANCE, in Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION, and comply with the following.
- B. Refer to PART 3 herein after and Section 01 00 00, GENERAL REQUIREMENTS for test performance.

- C. Comply with AHRI requirements for testing and certification of the chillers.
- D. Refer to paragraph, WARRANTY, Section 00 72 00, GENERAL CONDITIONS, except as noted below:
 - 1. Provide a 5-year motor, and compressor warranty to include materials, parts and labor.
- E. Refer to OSHA 29 CFR 1910.95(a) and (b) for Occupational Noise Exposure Standard
- F. Refer to ASHRAE Standard 15, Safety Standard for Refrigeration System, for refrigerant vapor detectors and monitor.

1.5 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. Air Conditioning, Heating and Refrigeration Institute (AHRI):
 - 370-01.....Sound Rating of Large Outdoor Refrigerating and Air-Conditioning Equipment
 - 495-1999 (R2002).....Refrigerant Liquid Receivers
 - 550/590-03.....Standard for Water Chilling Packages Using the Vapor Compression Cycle
 - 560-00.....Absorption Water Chilling and Water Heating Packages
 - 575-94.....Methods for Measuring Machinery Sound within Equipment Space
- C. American Society of Heating, Refrigerating, and Air-Conditioning Engineers (ASHRAE):
 - ANSI/ASHRAE-15-2007....Safety Standard for Mechanical Refrigeration Systems
 - GDL 3-1996.....Guidelines for Reducing Emission of Halogenated Refrigerants in Refrigeration and Air-Conditioning Equipment and Systems
- D. American Society of Mechanical Engineers (ASME):
 - 2007ASME Boiler and Pressure Vessel Code, Section VIII, "Pressure Vessels - Division 1"
- E. American Society of Testing Materials (ASTM):
 - C 534/ C 534M-2008.....Preformed, Flexible Elastomeric Cellular Thermal Insulation in Sheet and Tubular Form

- C 612-04.....Mineral-fiber Block and Board Thermal
Insulation
- F. National Electrical Manufacturing Association (NEMA):
250-2008.....Enclosures for Electrical Equipment (1000 Volts
Maximum)
- G. National Fire Protection Association (NFPA):
70-2008.....National Electrical Code
- H. Underwriters Laboratories, Inc. (UL):
1995-2005..... Heating and Cooling Equipment

1.6 SUBMITTALS

- A. Submit in accordance with Specification Section 01 33 23, SHOP
DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Manufacturer's Literature and Data.
 - 1. Rotary-screw water chillers, including motor starters, control
panels, and vibration isolators, and remote condenser data shall
include the following:
 - a. Rated capacity.
 - b. Pressure drop.
 - c. Efficiency at full load and part load WITHOUT applying any
tolerance indicated in the AHRI 550/590/Standard.
 - d. Refrigerant
 - e. Fan performance (Air-Cooled Chillers only.)
 - f. Accessories.
 - g. Installation instructions.
 - h. Start up procedures.
 - i. Wiring diagrams, including factor-installed and field-installed
wiring.
 - j. Sound/Noise data report. Manufacturer shall provide sound
ratings. Noise warning labels shall be posted on equipment.
- C. Maintenance and operating manuals for each piece of equipment in
accordance with Section 01 00 00, GENERAL REQUIREMENTS.
- D. Run test report for all chillers.
- E. Product Certificate: Signed by chiller manufacturer certifying that
chillers furnished comply with AHRI requirements. The test report shall
include calibrated curves, calibration records, and data sheets for the
instrumentation used in factory tests.

PART 2 - PRODUCTS

2.1 AIR-COOLED SCROLL WATER CHILLERS

- A. General: Factory-assembled and-tested scroll water chillers, complete with evaporator, compressors, motor, starters, integral condenser, and controls mounted on a welded steel base. The chiller unit shall consist of two compressors minimum, but not more than eight, mounted on a single welded steel base. Where compressors are paralleled, not more than two shall be so connected and not less than two independent refrigerant circuits shall be provided. Chiller shall be capable of operating one of the following refrigerants: HCFC-134a or HCFC-410a.
- B. Performance: Provide the capacity as shown on the drawings. Part load and full load efficiency ratings of the chiller shall not exceed those shown on the drawings.
- C. Capacity of a single air-cooled chiller shall not exceed 250 Tons (Standard AHRI Conditions).
- D. Applicable Standard: Chillers shall be rated and certified according to AHRI 550/590, and shall be stamped in compliance with AHRI certification.
- E. Acoustics: Sound pressure levels shall not exceed the following specified levels. The manufacturer shall provide sound treatment if required to comply with the specified maximum levels. Testing shall be in accordance with AHRI requirements.

OCTAVE BAND							
<u>63</u>	<u>125</u>	<u>250</u>	<u>500</u>	<u>1000</u>	<u>2000</u>	<u>4000</u>	<u>8000</u>
<u>77</u>	<u>84</u>	<u>80</u>	<u>82</u>	<u>83</u>	<u>80</u>	<u>76</u>	<u>67</u>

- F. Compressor (Scroll Type): Three dimensional, positive-displacement, hermetically sealed design, with suction and discharge valves, crankcase oil heater and suction strainer. Compressor shall be mounted on vibration isolators. Rotating parts shall be factory balanced. Lubrication system shall consist of reversible, positive displacement pump, strainer, oil level sight glass, and oil charging valve. Capacity control shall be by on-off compressor cycling of single and multiple compressors and hot gas bypass.
- G. Refrigerants Circuit: Each circuit shall contain include an expansion valve, refrigerant charging connections, hot-gas muffler, compressor suction and discharge shutoff valves, replaceable-core filter drier,

- sight glass with moisture indicator, liquid-line solenoid valve and insulated suction line.
- H. Refrigerant and Oil: Sufficient volume of dehydrated refrigerant and lubricating oil shall be provided to permit maximum unit capacity operation before and during tests. Replace refrigerant charge lost during the warranty period, due to equipment failure, without cost to the Government.
- I. Condenser:
1. Air-cooled condenser as shown on the drawings and specified hereinafter.
 2. Integral Condenser: Condenser coils shall be extended surface fin and tube type, seamless copper tubes with aluminum fins. For corrosion protection, see Paragraph 2.7 below. Condenser coils shall be factory air tested at 3105 kPa (450 psig). Condenser fans shall be propeller type, directly connected to motor shaft. Fans shall be statically and dynamically balanced, with wire safety guards. Condenser fan motors with permanently lubricated ball bearings and three-phase thermal overload protection. Unit shall start -18°C (0°F) with external damper assemblies. Units shall have grilles factory mounted to prevent damage to coil surfaces.
- J. Evaporator: Braze plate and frame type heat exchanger design. Braze plate evaporator shall be constructed of stainless steel with copper brazing material. The evaporator shall be designed for a minimum of 1.5 times the working pressure produced by the water system, but not less than 10,350 kPa (150 psig). Refrigerant side working pressure shall comply with ASHRAE Standard 15. Evaporator for packaged air-cooled chiller units designed for outdoor installation shall be protected against freeze-up in ambient temperature down to -30 degrees C (-20 degrees F) by a resistance heater cable under insulation with thermostat set to operate below 3 degrees C (37 degrees F) ambient. If electric resistance heater is required and the chiller is connected to emergency power, provide emergency power to the heater cable.
- K. Insulation: Evaporator, suction piping, compressor, and all other parts subject to condensation shall be insulated with 20 mm (0.75 inch) minimum thickness of flexible-elastomeric thermal insulation, complying with ASTM C534.

- L. Refrigerant Receiver: Provide a liquid receiver for chiller units when system refrigerant charge exceeds 80 percent of condenser refrigerant volume. Liquid receivers shall be horizontal-type, designed, fitted, and rated in conformance with AHRI 495. Receiver shall be constructed and tested in conformance with Section VIII D1 of the ASME Boiler and Pressure Vessel Code. Each receiver shall have a storage capacity not less than 20 percent in excess of that required for fully charged system. Each receiver shall be equipped with inlet, outlet drop pipes, drain plug, purging valve, and relief devices as required by ASHRAE Standard 15.
- M. Controls: Chiller shall be furnished with unit mounted, stand-alone, microprocessor-based controls in NEMA 3R enclosure, hinged and lockable, factory wired with a single point power connection and separate control circuit. The control panel provide chiller operation, including monitoring of sensors and actuators, and shall be furnished with light emitting diodes or liquid-crystal display keypad.
1. Following shall display as a minimum on the panel:
 - a. Date and time.
 - b. Outdoor air temperature.
 - c. Operating and alarm status.
 - d. Entering and leaving water temperature-chilled water.
 - e. Operating set points-temperature and pressure.
 - f. Refrigerant temperature and pressure.
 - g. Operating hours.
 - h. Number of starts.
 - i. Current limit set point.
 - j. Maximum motor amperage (percent).
 2. Control Functions:
 - a. Manual or automatic startup and shutdown time schedule.
 - b. Entering and leaving chilled water temperature and control set points.
 - c. Automatic lead-lag switch.
 3. Safety Functions: Following conditions shall shut down the chiller and require manual reset to start:
 - a. Loss of chilled water flow.
 - b. Low chilled water temperature.
 - c. Compressor motor current-overload protection.
 - d. Freeze protection (for air-cooled chillers).

- e. Starter fault.
- f. High or low oil pressure.
- g. Recycling pumpdown.
- N. The chiller control panel shall provide leaving chilled water temperature reset based on signal from Energy Control Center (ECC).
- O. Provide contacts for remote start/stop, alarm for abnormal operation or shutdown, and for Engineering Control Center (ECC).
- P. Chiller control panel shall either reside on the "LonTalk FTT-10a network", and provide data using LonMark standard network variable types and configuration properties, or BACnet interworking using ARCNET or MS/TP physical data link layer protocol for communication with building automation control system.
- Q. Auxiliary hydronic system and the chiller(s) shall be interlocked to provide time delay and start sequencing as indicated on control drawings.
- R. Motor: Refer to Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION. Compressor motor furnished with the chiller shall be in accordance with the chiller manufacturer and the electrical specification Section 23 05 12, GENERAL MOTOR REQUIREMENTS FOR HVAC and STEAM GENERATION EQUIPMENT. Starting torque of motors shall be suitable for driven machines.
- S. Motor Starter: Refer to Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION. Provide a starter in NEMA I enclosure, designed for floor or unit mounted chiller using multiple compressors, with the lead compressor starting at its minimum capacity may be provided with across-the-line starter. See Section 26 29 11, LOW-VOLTAGE MOTOR STARTERS for additional requirements.

2.2 CONDENSING UNITS FOR AIR CONDITIONING SERVICE

Refer to Section 23 81 00 DECENTRALIZED UNITARY HVAC EQUIPMENT.

2.3 CORROSION PROTECTION

- A. Remote Outdoor Condenser Coils: Epoxy Immersion Coating - Electrically Deposited: The multi-stage corrosion-resistant coating application comprises of cleaning (heated alkaline immersion bath) and reverse-osmosis immersion rinse prior to the start of the coating process. The coating thickness shall be maintained between 0.6-mil and 1.2-mil. Before the coils are subjected to high-temperature oven cure, they are treated to permeate immersion rinse and spray. Where the coils are subject to UV exposure, UV protection spray treatment comprising of UV-

resistant urethane mastic topcoat shall be applied. Provide complete coating process traceability for each coil and minimum five years of limited warranty. The coating process shall be such that uniform coating thickness is maintained at the fin edges. The quality control shall be maintained by ensuring compliance to the applicable ASTM Standards for the following:

1. Salt Spray Resistance (Minimum 6,000 Hours)
 2. Humidity Resistance (Minimum 1,000 Hours)
 3. Water Immersion (Minimum 260 Hours)
 4. Cross-Hatch Adhesion (Minimum 4B-5B Rating)
 5. Impact Resistance (Up to 160 Inch/Pound)
- B. Exposed Outdoor Cabinet: Casing Surfaces (Exterior and Interior): All exposed and accessible metal surfaces shall be protected with a water-reducible acrylic with stainless steel pigment spray-applied over the manufacturer's standard finish. The spray coating thickness shall be 2-4 mils and provide minimum salt-spray resistance of 1,000 hours (ASTM B117) AND 500 hours UV resistance (ASTM D4587)

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Examine roughing-in for concrete equipment bases, anchor-bolt sizes and locations, piping and electrical to verify actual locations and sizes before chiller installation and other conditions that might affect chiller performance, maintenance, and operation. Equipment locations shown on drawings are approximate. Determine exact locations before proceeding with installation.

3.2 EQUIPMENT INSTALLATION

- A. Install chiller on concrete base with isolation pads or vibration isolators.
1. Concrete base is specified in Section 03 30 00, CAST-IN-PLACE CONCRETE
 2. Vibration isolator types and installation requirements are specified in Section 23 05 41, NOISE and VIBRATION CONTROL FOR HVAC PIPING and EQUIPMENT
 3. Anchor chiller to concrete base according to manufacturer's written instructions.
 4. Charge the chiller with refrigerant, if not factory charged.
 5. Install accessories and any other equipment furnished loose by the manufacturer, including remote starter, remote control panel, and

remote flow switches, according to the manufacturer written instructions and electrical requirements.

6. Chillers shall be installed in a manner as to provide easy access for tube pull and removal of compressor and motors etc.
- B. Install refrigerant piping as specified in Section 23 23 00, REFRIGERANT PIPING and ASHRAE Standard 15.
- C. Install thermometers and gages as recommended by the manufacturer and/or as shown on drawings.
- D. Piping Connections:
 1. Make piping connections to the chiller for chilled water, and other connections as necessary for proper operation and maintenance of the equipment.

3.3 STARTUP AND TESTING

- A. Engage manufacturer's factory-trained representative to perform startup and testing service.
- B. Inspect, equipment installation, including field-assembled components, and piping and electrical connections.
- C. After complete installation startup checks, according to the manufacturers written instructions, do the following to demonstrate to the VA that the equipment operate and perform as intended.
 1. Check refrigerant charge is sufficient and chiller has been tested for refrigerant leak.
 2. Check bearing lubrication and oil levels.
 3. Verify proper motor rotation.
 4. Verify pumps associated with chillers are installed and operational.
 5. Verify thermometers and gages are installed.
 6. Verify purge system, if installed, is functional and relief piping is routed outdoor.
 7. Operate chiller for run-in-period in accordance with the manufacturer's instruction and observe its performance.
 8. Check and record refrigerant pressure, water flow, water temperature, and power consumption of the chiller.
 9. Test and adjust all controls and safeties. Replace or correct all malfunctioning controls, safeties and equipment as soon as possible to avoid any delay in the use of the equipment.
10. Prepare a written report outlining the results of tests and inspections, and submit it to the VA.

- D. Engage manufacturer's certified factory trained representative to provide training for 8 hours for the VA maintenance and operational personnel to adjust, operate and maintain equipment, including self-contained breathing apparatus.

- - - E N D - - -

SECTION 23 73 00
INDOOR CENTRAL-STATION AIR-HANDLING UNITS

1.1 DESCRIPTION

- A. Air handling units including integral components specified herein.
- B. Definitions: Air Handling Unit (AHU): A factory fabricated and tested assembly of modular sections consisting of single or multiple plenum fans with direct-drive, coils, filters, and other necessary equipment to perform one or more of the following functions of circulating, cleaning, heating, cooling, and mixing of air. Design capacities of units shall be as scheduled on the drawings.

1.2 RELATED WORK

- A. General mechanical requirements and items, which are common to more than one section of Division 23: Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION.
- B. Sound and vibration requirements: Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT.
- C. Piping and duct insulation: Section 23 07 11, HVAC, PLUMBING, AND BOILER PLANT INSULATION.
- D. Piping and valves: Section 23 21 13, HYDRONIC PIPING.
- E. Heating and cooling coils and pressure requirements: Section 23 82 16, AIR COILS.
- F. Return and exhaust fans: Section 23 34 00, HVAC FANS.
- G. Requirements for flexible duct connectors, sound attenuators and sound absorbing duct lining, and air leakage: Section 23 31 00, HVAC DUCTS and CASINGS.
- H. Air filters and filters' efficiency: Section 23 40 00, HVAC AIR CLEANING DEVICES.
- I. HVAC controls: Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC.
- J. Testing, adjusting and balancing of air and water flows: Section 23 05 93, TESTING, ADJUSTING, AND BALANCING FOR HVAC.
- K. Types of motors: Section 23 05 12, GENERAL MOTOR REQUIREMENTS FOR HVAC AND STEAM GENERATION EQUIPMENT.
- L. Types of motor starters: Section 26 29 11, LOW-VOLTAGE MOTOR STARTERS.
- M. General Commissioning: Section 01 91 00, GENERAL COMMISSIONING REQUIREMENTS
- N. HVAC Commissioning: Section 23 08 00, COMMISSIONING OF HVAC SYSTEMS

1.3 QUALITY ASSURANCE

- A. Refer to Article, Quality Assurance, in Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION.
- B. Air Handling Units Certification
 - 1. Air Handling Units with Housed Centrifugal Fans: The air handling units shall be certified in accordance with AHRI 430 and tested/rated in accordance with AHRI 260.
 - 2. Air Handling Units with Plenum Fans:
 - a. Air Handling Units with a single Plenum Fan shall be certified in accordance with AHRI 430 and tested/rated in accordance with AHRI 260.
- C. Heating, Cooling, and Air Handling Capacity and Performance Standards: AHRI 430, AHRI 410, ASHRAE 51, and AMCA 210.
- D. Performance Criteria:
 - 1. The fan BHP shall include all system effects for all fans and v-belt drive losses for housed centrifugal fans.
 - 2. The fan motor shall be selected within the rated nameplate capacity, without relying upon NEMA Standard Service Factor.
 - 3. Select the fan operating point as follows:
 - a. Forward Curve and Axial Flow Fans: Right hand side of peak pressure point.
 - b. Air Foil, Backward Inclined, or Tubular Fans Including Plenum Fans: At or near the peak static efficiency but at an appropriate distance from the stall line.
 - 3. Operating Limits: AMCA 99 and Manufacturer's Recommendations.
- E. Units shall be factory-fabricated, assembled, and tested by a manufacturer, in business of manufacturing similar air-handling units for at least five (5) years.

1.4. SUBMITTALS:

- A. The contractor shall, in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES, furnish a complete submission for all air handling units covered in the project. The submission shall include all information listed below. Partial and incomplete submissions shall be rejected without reviews.
- B. Manufacturer's Literature and Data:
 - 1. Submittals for AHUs shall include fans, drives, motors, coils, mixing box with outside/return air dampers, filter housings, and all other related accessories. The contractor shall provide custom drawings showing total air handling unit assembly including

dimensions, operating weight, access sections, flexible connections, door swings, controls penetrations, electrical disconnect, lights, duplex receptacles, switches, wiring, utility connection points, unit support system, vibration isolators, drain pan, pressure drops through each component (filter, coil etc).

2. Submittal drawings of section or component only will not be acceptable. Contractor shall also submit performance data including performance test results, charts, curves or certified computer selection data; data sheets; fabrication and insulation details. If the unit cannot be shipped in one piece, the contractor shall indicate the number of pieces that each unit will have to be broken into to meet shipping and job site rigging requirements. This data shall be submitted in hard copies and in electronic version compatible to AutoCAD version used by the VA at the time of submission.
 3. Submit sound power levels in each octave band for the inlet and discharge of the fan and at entrance and discharge of AHUs at scheduled conditions. In absence of sound power ratings refer to Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT.
 4. Provide fan curves showing Liters/Second (cubic feet per minute), static pressure, efficiency, and horsepower for design point of operation and at maximum design Liters/Second (cubic feet per minute).
 5. Submit total fan static pressure, external static pressure, for AHU including total, inlet and discharge pressures, and itemized specified internal losses and unspecified internal losses. Refer to air handling unit schedule on drawings.
- C. Maintenance and operating manuals in accordance with Section 01 00 00, GENERAL REQUIREMENTS. Include instructions for lubrication, filter replacement, motor and drive replacement, spare part lists, and wiring diagrams.
- D. Submit written test procedures two weeks prior to factory testing. Submit written results of factory tests for approval prior to shipping.
- E. Submit shipping information that clearly indicates how the units will be shipped in compliance with the descriptions below.
1. Units shall be shipped in one (1) piece where possible and in shrink wrapping to protect the unit from dirt, moisture and/or road salt.

2. If not shipped in one (1) piece, provide manufacturer approved shipping splits where required for installation or to meet shipping and/or job site rigging requirements in modular sections. Indicate clearly that the shipping splits shown in the submittals have been verified to accommodate the construction constraints for rigging as required to complete installation and removal of any section for replacement through available access without adversely affecting other sections.
3. If shipping splits are provided, each component shall be individually shrink wrapped to protect the unit and all necessary hardware (e.g. bolts, gaskets etc.) will be included to assemble unit on site (see section 2.1.A4).
4. Lifting lugs will be provided to facilitate rigging on shipping splits and joining of segments. If the unit cannot be shipped in one piece, the contractor shall indicate the number of pieces that each unit will have to be broken into to meet shipping and job site rigging requirements.

1.5 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. Air-Conditioning, Heating, and Refrigeration Institute (AHRI)/(ARI):
 - 410-01.....Standard for Forced-Circulation Air-Heating and Air-Cooling Coils
 - 430-09.....Central Station Air Handling Units
- C. Air Movement and Control Association International, Inc. (AMCA):
 - 210-07.....Laboratory Methods of Testing Fans for Rating
- D. American Society of Heating, Refrigerating and Air-conditioning Engineers, Inc. (ASHRAE):
 - 170-2008.....Ventilation of Health Care Facilities
- E. American Society for Testing and Materials (ASTM):
 - ASTM B117-07a.....Standard Practice for Operating Salt Spray (Fog) Apparatus
 - ASTM D1654-08.....Standard Test Method for Evaluation of Painted or Coated Specimens Subjected to Corrosive Environments
 - ASTM D1735-08.....Standard Practice for Testing Water Resistance of Coatings Using Water Fog Apparatus

ASTM D3359-08.....Standard Test Methods for Measuring Adhesion by
Tape Test

F. Military Specifications (Mil. Spec.):

MIL-P-21035B-2003.....Paint, High Zinc Dust Content, Galvanizing
Repair (Metric)

G. National Fire Protection Association (NFPA):

NFPA 90A.....Standard for Installation of Air Conditioning
and Ventilating Systems, 2009

H. Energy Policy Act of 2005 (P.L.109-58)

PART 2 - PRODUCTS

2.1 AIR HANDLING UNITS

A. General:

1. AHUs shall be fabricated from insulated, solid double-wall galvanized steel without any perforations in draw-through configuration. Casing shall be fabricated as specified in section 2.1.C.2. Galvanizing shall be hot dipped conforming to ASTM A525 and shall provide a minimum of 0.275 kg of zinc per square meter (0.90 oz. of zinc per square foot) (G90). Aluminum constructed units, subject to VA approval, may be used in place of galvanized steel. The unit manufacturer shall provide published documentation confirming that the structural rigidity of aluminum air-handling units is equal or greater than the specified galvanized steel.
2. The contractor and the AHU manufacturer shall be responsible for ensuring that the unit will not exceed the allocated space shown on the drawings, including required clearances for service and future overhaul or removal of unit components. All structural, piping, wiring, and ductwork alterations of units, which are dimensionally different than those specified, shall be the responsibility of the contractor at no additional cost to the government.
3. AHUs shall be fully assembled by the manufacturer in the factory in accordance with the arrangement shown on the drawings. The unit shall be assembled into the largest sections possible subject to shipping and rigging restrictions. The correct fit of all components and casing sections shall be verified in the factory for all units prior to shipment. All units shall be fully assembled, tested, and then split to accommodate shipment and job site rigging. On units not shipped fully assembled, the manufacturer shall tag each section and include air flow direction to facilitate assembly at the job

site. Lifting lugs or shipping skids shall be provided for each section to allow for field rigging and final placement of unit.

4. The AHU manufacturer shall provide the necessary gasketing, caulking, and all screws, nuts, and bolts required for assembly. The manufacturer shall provide a factory-trained and qualified local representative at the job site to supervise the assembly and to assure that the units are assembled to meet manufacturer's recommendations and requirements noted on the drawings. Provide documentation to the Contracting Officer that the local representative has provided services of similar magnitude and complexity on jobs of comparable size. If a local representative cannot be provided, the manufacturer shall provide a factory representative.
5. Gaskets: All door and casing and panel gaskets and gaskets between air handling unit components, if joined in the field, shall be high quality which seal air tight and retain their structural integrity and sealing capability after repeated assembly and disassembly of bolted panels and opening and closing of hinged components. Bolted sections may use a more permanent gasketing method provided they are not disassembled.
6. Structural Rigidity: Provide structural reinforcement when required by span or loading so that the deflection of the assembled structure shall not exceed 1/200 of the span based on a differential static pressure of 1991 PA (8 inch WG) or higher.

B. Base:

1. Provide a heavy duty steel base for supporting all major AHU components. Bases shall be constructed of wide-flange steel I-beams, channels, or minimum 125 mm (5 inch) high 3.5 mm (10 Gauge) steel base rails. Welded or bolted cross members shall be provided as required for lateral stability. Contractor shall provide supplemental steel supports as required to obtain proper operation heights for cooling coil condensate drain trap as shown on drawings.
2. AHUs shall be completely self supporting for installation on concrete housekeeping pad, steel support pedestals, or suspended as shown on drawings.
3. The AHU bases not constructed of galvanized steel shall be cleaned, primed with a rust inhibiting primer, and finished with rust inhibiting exterior enamel.

C. Casing (including wall, floor and roof):

1. General: AHU casing shall be constructed as solid double wall, galvanized steel insulated panels without any perforations, integral of or attached to a structural frame. The thickness of insulation, mode of application and thermal breaks shall be such that there is no visible condensation on the exterior panels of the AHU located in the non-conditioned spaces.

2. Casing Construction:

Table 2.1.C.2

Outer Panel	0.8 mm (22 Gage) Minimum
Inner Panel	0.8 mm (22 Gage) Minimum
Insulation	Foam
Thickness	50 mm (2 inch) Minimum
Density	48 kg/m ³ (3.0 lb/ft ³) Minimum
Total R Value	2.3 m ² .K/W (13.0 ft ² .°F.hr/Btu) Minimum

3. Casing Construction (Contractor's Option):

Table 2.1.C.3

Outer Panel	1.3 mm (18 Gage) Minimum
Inner Panel	1.0 mm (20 Gage) Minimum
Insulation	Fiberglass
Thickness	50 mm (2 inch) Minimum
Density	24 kg/m ³ (1.5 lb/ft ³) Minimum
Total R Value	1.4 m ² .K/W (8.0 ft ² .°F.hr/Btu) Minimum

4. Blank-Off: Provide blank-offs as required to prevent air bypass between the AHU sections, around coils, and filters.
5. Casing panels shall be secured to the support structure with stainless steel or zinc-chromate plated screws and gaskets installed around the panel perimeter. Panels shall be completely removable to allow removal of fan, coils, and other internal components for future maintenance, repair, or modifications. Welded exterior panels are not acceptable.
6. Access Doors: Provide in each access section and where shown on drawings. Show single-sided and double-sided access doors with door

swings on the floor plans. Doors shall be a minimum of 50 mm (2 inch) thick with same double wall construction as the unit casing. Doors shall be a minimum of 600 mm (24 inches) wide, unless shown of different size on drawings, and shall be the full casing height up to a maximum of 1850 mm (6 feet). Doors shall be gasketed, hinged, and latched to provide an airtight seal.

- a. Hinges: Manufacturers standard, designed for door size, weight and pressure classifications. Hinges shall hold door completely rigid with minimum 45 kg (100 lb) weight hung on latch side of door.
 - b. Latches: Non-corrosive alloy construction, with operating levers for positive cam action, operable from either inside or outside. Doors that do not open against unit operating pressure shall allow the door to ajar and then require approximately 0.785 radian (45 degrees) further movement of the handle for complete opening. Latch shall be capable of restraining explosive opening of door with a force not less than 1991 Pa (8 inch WG).
 - c. Gaskets: Neoprene, continuous around door, positioned for direct compression with no sliding action between the door and gasket. Secure with high quality mastic to eliminate possibility of gasket slipping or coming loose.
7. Provide sealed sleeves, metal or plastic escutcheons or grommets for penetrations through casing for power and temperature control wiring and pneumatic tubing. Coordinate with electrical and temperature control subcontractors for number and location of penetrations. Coordinate lights, switches, and duplex receptacles and disconnect switch location and mounting. All penetrations and equipment mounting may be provided in the factory or in the field. All field penetrations shall be performed neatly by drilling or saw cutting. No cutting by torches will be allowed. Neatly seal all openings airtight.

D. Floor:

1. Unit floor shall be level without offset space or gap and designed to support a minimum of 488 kg/square meter (100 lbs per square foot) distributed load without permanent deformation or crushing of internal insulation. Provide adequate structural base members beneath floor in service access sections to support typical service foot traffic and to prevent damage to unit floor or internal insula-

tion. Unit floors in casing sections, which may contain water or condensate, shall be watertight with drain pan.

2. Where indicated, furnish and install floor drains, flush with the floor, with nonferrous grate cover and stub through floor for external connection.
- E. Condensate Drain Pan: Drain pan shall be designed to extend entire length of cooling coils including headers and return bends. Depth of drain pan shall be at least 43 mm (1.7 inches) and shall handle all condensate without overflowing. Drain pan shall be double-wall, double sloping type, and fabricated from stainless (304) with at least 50 mm (2 inch) thick insulation sandwiched between the inner and outer surfaces. Drain pan shall be continuous metal or welded watertight. No mastic sealing of joints exposed to water will be permitted. Drain pan shall be placed on top of casing floor or integrated into casing floor assembly. Drain pan shall be pitched in all directions to drain line.
1. An intermediate, stainless-steel (304) condensate drip pan with copper downspouts shall be provided on stacked cooling coils. Use of intermediate condensate drain channel on upper casing of lower coil is permissible provided it is readily cleanable. Design of intermediate condensate drain shall prevent upper coil condensate from flowing across face of lower coil.
 2. Drain pan shall be piped to the exterior of the unit. Drain pan shall be readily cleanable.
 3. Installation, including frame, shall be designed and sealed to prevent blow-by.
- F. Housed Centrifugal Fan Sections:
1. Fans shall be minimum Class II construction, double width, double inlet centrifugal, or forward curved type as indicated on drawings, factory balanced and rated in accordance with AMCA 210 or ASHRAE 51. Provide self-aligning, pillow block, regreasable ball-type bearings selected for a B (10) life of not less than 50,000 hours and an L (50) average fatigue life of 200,000 hours per AFBMA Standard 9. Extend bearing grease lines to motor and drive side of fan section. Fan shall be located in airstream to assure proper air flow.
 2. Provide internally vibration isolated fan, motor and drive, mounted on a common integral bolted or welded structural steel base with adjustable motor slide rail with locking device. Provide vibration isolators and flexible duct connections at fan discharge to

completely isolate fan assembly. Refer to Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT, for additional requirements.

Allowable vibration tolerances for fan shall not exceed a self-excited vibration maximum velocity of 0.005 m/s (0.20 inch per second) RMS, filter in, when measured with a vibration meter on bearing caps of machine in vertical, horizontal and axial directions or measured at equipment mounting feet if bearings are concealed. After field installation, compliance to this requirement shall be demonstrated with field test in accordance with Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT and Section 23 05 93, TESTING, ADJUSTING, AND BALANCING FOR HVAC. Following fan assembly, the complete fan assembly balance shall be tested using an electronic balance analyzer with a tunable filter and stroboscope. Vibration measurements shall be taken on each motor bearing housing in the vertical, horizontal, and axial planes (5 total measurements, 2 each motor bearing and 1 axial).

G. Fan Motor, Drive, and Mounting Assembly (Housed Centrifugal Fans):

1. Fan Motor and Drive: Motors shall be premium energy efficient type, as mandated by the Energy Policy Act of 2005, with efficiencies as shown in the Specifications Section 23 05 12 (General Motor Requirements For HVAC and Steam Equipment), on drawings and suitable for use in variable frequency drive applications on AHUs where this type of drive is indicated. Refer to Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION, for additional motor and drive specifications. Refer to Specification Section 26 29 11, LOW-VOLTAGE MOTOR STARTERS.
3. Fan drive and belts shall be factory mounted with final alignment and belt adjustment to be made by the Contractor after installation. Drive and belts shall be as specified in Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION. Provide additional drive(s) if required during balancing, to achieve desired airflow.

H. Mixing Boxes: Mixing box shall consist of casing and outdoor air and return air dampers in opposed blade arrangement with damper linkage for automatic operation. Coordinate damper operator with Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC. Dampers shall be of ultra-low leak design with metal compressible bronze jamb seals and extruded vinyl edge seals on all blades. Blades shall rotate on stainless steel

sleeve bearings or bronze bushings. Leakage rate shall not exceed 1.6 cubic meters/min/square meter (5 CFM per square foot) at 250 Pa (1 inch WG) and 2.8 cubic meters/min/square meter (9 CFM per square foot) at 995 Pa (4 inch WG) Electronic operators shall be furnished and mounted in an accessible and easily serviceable location by the air handling unit manufacturer at the factory. Damper operators shall be of same manufacturer as controls furnished under Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC.

- I. Filter Section: Refer to Section 23 40 00, HVAC AIR CLEANING DEVICES, for filter requirements.
 - 1. Filters including one complete set for temporary use at site shall be provided independent of the AHU. The AHU manufacturer shall install filter housings and racks in filter section compatible with filters furnished. The AHU manufacturer shall be responsible for furnishing temporary filters (pre-filters and after-filters, as shown on drawings) required for AHU testing.
 - 2. Factory-fabricated filter section shall be of the same construction and finish as the AHU casing including filter racks and hinged double wall access doors. Filter housings shall be constructed in accordance with side service or holding frame housing requirements in Section 23 40 00, HVAC AIR CLEANING DEVICES.

- J. Coils: Coils shall be mounted on hot dipped galvanized steel supports to assure proper anchoring of coil and future maintenance. Coils shall be face or side removable for future replacement thru the access doors or removable panels. Each coil shall be removable without disturbing adjacent coil. Cooling coils shall be designed and installed to insure no condensate carry over. Provide factory installed extended supply, return, drain, and vent piping connections.

- K. Discharge Section:

Provide aerodynamically designed framed discharge openings or spun bellmouth fittings to minimize pressure loss.

- L. Electrical and Lighting: Wiring and equipment specifications shall conform to Division 26, ELECTRICAL.
 - 1. Vapor-proof lights using cast aluminum base style with glass globe and cast aluminum guard shall be installed in access sections for fan, mixing box and any section over 300 mm (12 inch) wide. A switch shall control the lights in each compartment with pilot light

mounted outside the respective compartment access door. Wiring between switches and lights shall be factory installed. All wiring shall run in neatly installed electrical conduits and terminate in a junction box for field connection to the building system. Provide single point 115 volt - one phase connection at junction box.

2. Install compatible 100 watt bulb in each light fixture.
3. Provide a convenience duplex receptacle next to the light switch.
4. Disconnect switch and power wiring: Provide factory or field mounted disconnect switch. Coordinate with Division 26, ELECTRICAL.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Install air handling unit in conformance with ARI 435.
- B. Assemble air handling unit components following manufacturer's instructions for handling, testing and operation. Repair damaged galvanized areas with paint in accordance with Military Spec. DOD-P-21035. Repair painted units by touch up of all scratches with finish paint material. Vacuum the interior of air handling units clean prior to operation.
- C. Leakage and test requirements for air handling units shall be the same as specified for ductwork in Specification Section 23 31 00, HVAC DUCTS AND CASINGS except leakage shall not exceed Leakage Class (C₁) 12 listed in SMACNA HVAC Air Duct Leakage Test Manual when tested at 1.5 times the design static pressure. Repair casing air leaks that can be heard or felt during normal operation and to meet test requirements.
- D. Perform field mechanical (vibration) balancing in accordance with Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT.
- E. Seal and/or fill all openings between the casing and AHU components and utility connections to prevent air leakage or bypass.

3.2 STARTUP SERVICES

- A. The air handling unit shall not be operated for any purpose, temporary or permanent, until ductwork is clean, filters are in place, bearings are lubricated and fan has been test run under observation.
- B. After the air handling unit is installed and tested, provide startup and operating instructions to VA personnel.
- C. An authorized factory representative should start up, test and certify the final installation and application specific calibration of control components. Items to be verified include fan performance over entire operating range, noise and vibration testing, verification of proper

alignment, overall inspection of the installation, Owner/Operator training, etc.

3.3 COMMISSIONING

- A. Provide commissioning documentation in accordance with the requirements of Section 23 08 00 - COMMISSIONING OF HVAC SYSTEMS for all inspection, start up, and contractor testing required above and required by the System Readiness Checklist provided by the Commissioning Agent.
- B. Components provided under this section of the specification will be tested as part of a larger system. Refer to Section 23 08 00 - COMMISSIONING OF HVAC SYSTEMS and related sections for contractor responsibilities for system commissioning.

- - - E N D - - -

SECTION 23 81 00
DECENTRALIZED UNITARY HVAC EQUIPMENT

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This section specifies split-systems.
- B. Definitions:
 - 1. Energy Efficiency Ratio (EER): The ratio of net cooling capacity is Btu/h to total rate of electricity input in watts under designated operating conditions (Btu hour/Watt).
 - 2. Seasonal Energy Efficiency Ratio (SEER): The ratio of the total cooling output of an air conditioner during its normal annual usage period for cooling in Btu/h divided by total electric energy input in watts during the same period (Btu hour/Watt).
 - 3. Unitary: A Unitary Air Conditioner consists of one or more factory-made assemblies which normally include an evaporator or cooling coil, a compressor and condenser combination, and may include a heating function as well.
 - 4. Where such equipment is provided in more than one assembly the separated assemblies are to be designed to be used together and the requirements of rating are based upon use of matched assemblies.

1.2 RELATED WORK

- A. Section 23 05 11, COMMON WORK RESULTS FOR HVAC: General mechanical requirements and items, which are common to more than one section of Division 23.
- B. Section 23 05 41, NOISE and VIBRATION CONTROL FOR HVAC PIPING and EQUIPMENT: Requirements for different types of vibration isolators and noise ratings in the occupied areas.
- C. Section 23 07 11, HVAC and BOILER PLANT INSULATION: Requirements for piping insulation.
- D. Section 23 23 00, REFRIGERANT PIPING: Requirements for refrigerant pipes and fittings.
- E. Section 23 36 00, AIR TERMINAL UNITS and Section 23 82 00, CONVECTION HEATING and COOLING UNITS: Requirements for other similar units.
- F. Section 23 40 00, HVAC AIR CLEANING DEVICES: Requirements for air filtration.
- G. Section 23 08 00 - COMMISSIONING OF HVAC SYSTEMS: Requirements for commissioning, systems readiness checklists, and training.

- H. Section 23 05 93, TESTING, ADJUSTING, and BALANCING FOR HVAC:
Requirements for testing and adjusting air balance.

1.3 QUALITY ASSURANCE

- A. Refer to specification Section 23 05 11, COMMON WORK RESULTS FOR HVAC.
- B. Safety Standards: ASHRAE Standard 15, Safety Code for Mechanical Refrigeration.

1.4 SUBMITTALS

- A. Submit in accordance with specification Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES
- B. Manufacturer's literature and data:
 - 1. Sufficient information, including capacities, pressure drops and piping connections clearly presented, shall be included to determine compliance with drawings and specifications for units noted below:
 - a. Unitary air conditioners:
 - 1) Split systems
 - 2. Unit Dimensions required clearances, operating weights accessories and start-up instructions.
 - 3. Electrical requirements, wiring diagrams, interlocking and control wiring showing factory installed and portions to be field installed.
 - 4. Mounting and flashing of the roof curb to the roofing structure with coordinating requirements for the roof membrane system.
- C. Certification: Submit proof of specified ARI Certification.
- D. Performance Rating: Submit catalog selection data showing equipment ratings and compliance with required sensible-to-heat-ratio, energy efficiency ratio (EER), and coefficient of performance (COP).
- E. Operating and Maintenance Manual: Submit three copies of Operating and Maintenance manual to Resident Engineer three weeks prior to final inspection.
- F. Completed System Readiness Checklists provided by the Commissioning Agent and completed by the contractor, signed by a qualified technician and dated on the date of completion, in accordance with the requirements of Section 23 08 00 COMMISSIONING OF HVAC SYSTEMS.

1.5 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. Federal Specifications (Fed. Spec.):

- A-A-50502-90..... Air conditioner (Unitary Heat Pump) Air to Air
(3000-300,000 Btu)
- C. Military Specifications (Mil. Specs.):
- MIL-PRF-26915D-06.....Primer Coating, for Steel Surfaces
- D. Air-Conditioning, Heating, and Refrigeration Institute (AHRI):
- 210/240-08.....Performance Rating of Unitary Air-Conditioning
and Air-Source Heat Pump Equipment
- 270-08.....Sound Rating of Outdoor Unitary Equipment
- 340/360-07.....Performance Rating of Commercial and Industrial
Unitary Air-Conditioning and Heat Pump
Equipment
- 520-04.....Performance Rating of Positive Displacement
Condensing Units
- E. Air Movement and Control Association (AMCA):
- 210-07.....Laboratory Methods of Testing Fans for
Aerodynamic Performance Rating (ANSI)
- 410-96.....Recommended Safety Practices for Users and
Installers of Industrial and Commercial Fans
- F. American National Standards Institute (ANSI):
- S12.51-02 (R2007).....Acoustics - Determination of Sound Power Levels
of Noise Sources Using Sound Pressure -
Precision Method for Reverberation Rooms (same
as ISO 3741:1999)
- G. American Society of Heating, Refrigerating, and Air-Conditioning
Engineers (ASHRAE):
- 2008 Handbook.....HVAC Systems and Equipment
- 15-10.....Safety Standard for Refrigeration Systems
(ANSI)
- H. American Society of Testing and Materials (ASTM):
- B117-09.....Standard Practice for Operating Salt Spray
(Fog) Apparatus
- I. American Society of Civil Engineers (ASCE)
- ASCE 7-10.....Minimum Design Loads for Buildings and Other
Structures
- J. National Electrical Manufacturer's Association (NEMA):
- MG 1-09 (R2010).....Motors and Generators (ANSI)
- ICS 1-00 (R2005, R2008).Industrial Controls and Systems: General
Requirements

- K. National Fire Protection Association (NFPA) Publications:
 90A-09.....Standard for the Installation of Air-
 Conditioning and Ventilating Systems

PART 2 - PRODUCTS

2.1 UNITARY AIR CONDITIONERS - GENERAL

- A. Applicable ARI Standards:
1. Cooling Capacity 39.6 kW (135,000 Btu/h) and More: AHRI 340/ 360.
 2. Cooling Capacity Less Than 39.6 kW (135,000 Btu/h): AHRI 210/240.
 Units shall be listed in the ARI Directory of Certified Unitary Air-Conditioners.
- B. Performance Rating: Cooling capacity of units shall meet the sensible heat and total heat requirements shown in the contract documents. In selecting unit size, make true allowance for "sensible to total heat ratio" to satisfy required sensible cooling capacity.
- C. Machinery Guards: Provide guards as shown in AMCA 410 for belts, chains, couplings, pulleys, sheaves, shafts, gears and other moving parts regardless of height above the floor. Drive guards may be excluded where motors and drives are inside factory fabricated casings.

2.2 SPLIT-SYSTEM AIR CONDITIONERS

- A. Description: Factory assembled and tested, wall-mounted unit, with an air-cooled remote condensing unit, and field-installed refrigeration piping.
- B. Wall-Mounting, Evaporator-Fan Components:
1. Cabinet: Enameled steel with removable panels on front and ends in color selected by Architect, and discharge drain pans with drain connection.
 2. Airstream Surfaces: Surfaces in contact with the airstream shall comply with requirements in ASHRAE 62.1-2007.
 3. Drain Pan and Drain Connection: Comply with ASHRAE 62.1-2007.
 4. Refrigerant Coil: Copper tube, with mechanically bonded aluminum fins, complying with AHRI 210/240, and with thermal-expansion valve.
 5. Fan: Direct drive, centrifugal fan.
 6. Fan Motors: Comply with requirements in Section 23 05 12, GENERAL MOTOR REQUIREMENTS FOR HVAC and STEAM GENERATION EQUIPMENT for multi-tapped, multi-speed motors with internal thermal protection and permanent lubrication.
 7. Filters: Disposable, with MERV rating of 7 or higher according to ASHRAE 52.2.

C. Air-Cooled, Compressor-Condenser Components:

1. Casing: Steel, finished with baked enamel in color selected by Architect, with removable panels for access to controls, weep holes for water drainage, and mounting holes in base. Service valves, fittings, and gage ports shall be brass and located outside of the casing.
2. Compressor: Scroll with crankcase heater and mounted on vibration isolation. Compressor motor shall have thermal- and current-sensitive overload devices, start capacitor, relay, and contactor.
3. Compressor motor with manual-reset, high-pressure switch and automatic-reset, low-pressure switch.
4. Refrigerant: R-410A unless otherwise indicated.
5. Refrigerant Coil: Copper tube, with mechanically bonded aluminum fins, complying with AHRI 210/240, and with liquid subcooler.
6. Fan: Aluminum, propeller type, directly connected to motor.
7. Motor: Permanently lubricated, with integral thermal-overload protection.
8. Low Ambient Kit: Permit operation down to minus 18 deg C (0 deg F).
9. Mounting Base: Polyethylene.
10. Minimum Energy Efficiency: Comply with ASHRAE/IESNA 90.1-2004, "Energy Standard for Buildings except Low-Rise Residential Buildings."

PART 3 EXECUTION

3.1 INSTALLATION

- A. Install units level and plumb maintaining manufacturer's recommended clearances and tolerances.
- B. Install ground-mounting, compressor-condenser components on 100 mm (4-inch) thick, reinforced concrete base; 100 mm (4 inches) larger on each side than unit. Concrete, reinforcement, and formwork are specified in Section 03 30 00, CAST-IN-PLACE CONCRETE. Coordinate anchor installation with concrete base.
- C. Install ground-mounting, compressor-condenser components on polyethylene mounting base.
- D. Install compressor-condenser components on restrained, spring isolators with a minimum static deflection of 25 mm (1 inch) unless otherwise indicated. Refer to Section 23 05 41, NOISE and VIBRATION CONTROL FOR HVAC PIPING and EQUIPMENT.

- E. Install and connect precharged refrigerant tubing to component's quick-connect fittings. Install tubing to allow access to unit.
- F. Install wall sleeves in finished wall assembly and weatherproof.
Install and anchor wall sleeves to withstand, without damage seismic forces as required by code.

3.2 CONNECTIONS

- A. Verify condensate drainage requirements.
- B. Install condensate drain, minimum connection size, with trap and indirect connection to nearest roof drain or area drain.
- C. Install piping adjacent to units to allow service and maintenance.
- D. Ground equipment and install power wiring, switches, and controls for self contained and split systems.
- E. Connect refrigerant piping to coils with shutoff valves on the suction and liquid lines at the coil and a union or flange at each connection at the coil and condenser.
- F. Connect piping with shutoff duty valves on the supply and return side of the coil and unions at all connections and with a throttling valve on the return piping near the coil.

3.3 FIELD QUALITY CONTROL

- A. Perform tests and inspections and prepare test reports.
- B. Tests and Inspections: After installing units and after electrical circuitry has been energized, test units for compliance with requirements. Inspect for and remove shipping bolts, blocks, and tie-down straps. After electrical circuitry has been energized, start units to confirm proper motor rotation and unit operation. Test and adjust controls and safeties. Replace damaged and malfunctioning controls and equipment. Remove and replace malfunctioning units and retest as specified above.

3.4 INSTRUCTIONS

Provide services of manufacturer's technical representative for four hours to instruct VA personnel in operation and maintenance of units.

3.5 STARTUP AND TESTING

The Commissioning Agent will observe startup and contractor testing of selected equipment. Coordinate the startup and contractor testing schedules with the Resident Engineer and Commissioning Agent. Provide a minimum of 7 days prior notice.

3.6 COMMISSIONING

- A. Provide commissioning documentation in accordance with the requirements of Section 23 08 00 - COMMISSIONING OF HVAC SYSTEMS for all inspection, start up, and contractor testing required above and required by the System Readiness Checklist provided by the Commissioning Agent.
- B. Components provided under this section of the specification will be tested as part of a larger system. Refer to Section 23 08 00 - COMMISSIONING OF HVAC SYSTEMS and related sections for contractor responsibilities for system commissioning.

3.7 DEMONSTRATION AND TRAINING

- A. Provide services of manufacturer's technical representative for four hours to instruct VA personnel in operation and maintenance of units.
- B. Submit training plans and instructor qualifications in accordance with the requirements of Section 23 08 00 - COMMISSIONING OF HVAC SYSTEMS.

---END---

SECTION 23 82 00
CONVECTION HEATING AND COOLING UNITS

PART 1 - GENERAL

1.1 DESCRIPTION

Fan-coil units, unit heaters, convectors and finned-tube radiation.

1.2 RELATED WORK

- A. Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION: General mechanical requirements and items, which are common to more than one section of Division 23.
- B. Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT: Noise requirements.
- C. Section 23 21 13, HYDRONIC PIPING: Heating hot water and chilled water piping.
- D. Section 23 31 00, HVAC DUCTS AND CASINGS: Ducts and flexible connectors.
- E. Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC: Valve operators.
- F. Section 23 05 93, TESTING, ADJUSTING, AND BALANCING FOR HVAC: Flow rates adjusting and balancing.

1.3 QUALITY ASSURANCE

Refer to Paragraph, QUALITY ASSURANCE, in Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION.

1.4 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturer's Literature and Data:
 - 1. Fan-Coil units.
- C. Certificates:
 - 1. Compliance with paragraph, QUALITY ASSURANCE.
 - 2. Compliance with specified standards.
- D. Operation and Maintenance Manuals: Submit in accordance with paragraph, INSTRUCTIONS, in Section 01 00 00, GENERAL REQUIREMENTS.

1.5 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.

- B. Air Conditioning and Refrigeration Institute (ARI):
 - 440-05.....Room Fan Coils
- C. National Fire Protection Association (NFPA):
 - 90A-02.....Standard for the Installation of Air
Conditioning and Ventilating Systems
 - 70-05.....National Electrical Code
- D. Underwriters Laboratories, Inc. (UL):
 - 181-05.....Standard for Factory-Made Air Ducts and Air
Connectors
 - 1995-05.....Heating and Cooling Equipment

1.6 GUARANTY

In accordance with FAR clause 52.246-21.

PART 2 - PRODUCTS

2.1 ROOM FAN-COIL UNITS

- A. Capacity Certification: ARI 440.
- B. Safety Compliance: NEC compliant and UL listed.
- C. Noise Levels: Operating at full cooling capacity, sound power level shall not exceed by more than 5 dB the numerical value of sound pressure levels associated with noise criteria specified in Section 23 05 51, NOISE AND VIBRATION CONTROL FOR BOILER PLANT. Select units at intermediate speed, for compliance with the noise criteria.
- D. Chassis: Galvanized steel, acoustically and thermally insulated to attenuate noise and prevent condensation.
- E. Cabinet Type: Not lighter than 1.3 mm (18 gage) steel, reinforced and braced. Arrange components and provide adequate space for installation of piping package and control valves. Finish shall be factory-baked enamel in manufacturer's standard color as selected by the architect.
 - 1. Horizontal Unit: Hinged bottom access panel with cam-lock fasteners. Provide stamped integral discharged grilles in front of cabinet.
 - 2. Concealed Units: Enclosed type with inlet and outlet duct collars.
- F. Fans: Centrifugal, direct drive, galvanized steel or polyester resin.
 - 1. Motors: 3-speed permanent split capacitor type with integral thermal overload protection, for operation at not more than 1200 RPM.
 - 2. Provide a fan speed selector switch, with off, low, medium, and high positions. Switch shall have a set of auxiliary contacts which are open when the switch is in the "off" position and closed when the switch in any of the other positions. On vertical units, mount

switch in a junction box in the cabinet of each unit. On horizontal units, switch shall be wall mounted.

G. Cooling and Heating Coils:

1. Hydronic (two separate coils for cooling and heating): Copper tubes, 10 mm (three-eighths inch) minimum inside diameter, not less than 4.3 mm (0.017 inch) thick with copper or aluminum fins. Coils shall be pressure tested for bursting and strength in accordance with Underwriters Laboratories, Inc., requirements for pressure tested coils, and shall be designed to provide adequate heat transfer capacity. Provide manual air vent at high point of each coil and drain at each low point.

H. Piping Package: Furnished with unit by the manufacturer to fit control valves provided by the controls supplier. Submit manufacturer's detailed drawings of the piping in the end compartments for approval prior to fabrication of the piping packages. Provide ball stop valves on the supply and return pipes and balancing fittings on the return pipes.

I. Drain pans: Furnish galvanized steel with solderless drain connections and molded polystyrene foam insulating liner:

1. Auxiliary drain pan: Located under control valve and piping to prevent dripping.

J. Air Filter: Manufacturer's standard throwaway type, not less than one inch thick, supported to be concealed from sight and be tight fitting to prevent air by-pass. Filters shall have slide out frames and be easily replaced without removing enclosure or any part thereof.

K. Control valves and unit mounted return air thermostats are to be field installed.

L. Hot Water Coil: Aluminum fins bonded to seamless copper tubing by mechanical expansion of the tubing, designed for 517 kPa (75 psig) steam working pressure.

2.2 WALL HEATER

A. General: Electric heat, fan driven, thermostatic control, UL listed.

B. Enclosure:

1. Wall box: Not less than 1.3 mm (18 gage) steel, recessed type.
2. Ribbed 1.6 mm (16 gage) steel front cover.
3. Closely spaced discharge louvers.
4. Concealed screws for locking trim frame to front cover.

5. Finished in baked enamel of manufacturer's standard color with satin finish anodized aluminum trim frame.
- C. Heating Elements: Steel sheath enclosed finned-tube type.
- D. Integral Controls:
 1. Two-pole terminal block.
 2. Built-in fan delay switch.
 3. Automatic reset line voltage internal thermal overheats protection.
 4. Built-in thermostat comfort control with adjustment range between -1 to 32 degree C (30-90 degrees F), and manually set "No Heat" position; tamper resistant adjustment by inserting screwdriver through front cover louvers.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Work shall be installed as shown and according to the manufacturer's diagrams and recommendations.
- B. Handle and install units in accordance with manufacturer's written instructions.
- C. Support units rigidly so they remain stationary at all times. Cross-bracing or other means of stiffening shall be provided as necessary. Method of support shall be such that distortion and malfunction of units cannot occur.
- D. Install fiberglass blanket insulation above hydronic radiant panels.

3.2 OPERATIONAL TEST

Refer to Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION.

- - - E N D - - -

SECTION 23 82 16
AIR COILS

PART 1 - GENERAL

1.1 DESCRIPTION

Heating and cooling coils for air handling unit and duct applications.

1.2 RELATED WORK

- A. Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION.
- B. Section 23 73 00, INDOOR CENTRAL-STATION AIR-HANDLING UNITS.
- C. Reheat coils for VAV/CV terminals: Section 23 82 00, CONVECTION HEATING AND COOLING UNITS.

1.3 QUALITY ASSURANCE

- A. Refer to paragraph, QUALITY ASSURANCE, Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION.
- B. Unless specifically exempted by these specifications, heating and cooling coils shall be tested, rated, and certified in accordance with ARI Standard 410 and shall bear the ARI certification label.

1.4 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturer's Literature and Data for Heating and Cooling Coils: Submit type, size, arrangements and performance details. Present application ratings in the form of tables, charts or curves.
- C. Provide installation, operating and maintenance instructions.
- D. Certification Compliance: Evidence of listing in current ARI Directory of Certified Applied Air Conditioning Products.
- E. Coils may be submitted with Section 23 73 00, INDOOR CENTRAL-STATION AIR-HANDLING UNITS.

1.5 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. Air Conditioning and Refrigeration Institute (ARI):
Directory of Certified Applied Air Conditioning Products
ARI 410-02.....Forced-Circulation Air-Cooling Air-Heating
Coils.
- C. American Society for Testing and Materials (ASTM):
B75/75M-02.....Seamless Copper Tube (Metric)

- D. National Fire Protection Association (NFPA):
 70-05.....National Electric Code
- E. National Electric Manufacturers Association (NEMA):
 250-03.....Enclosures for Electrical Equipment (1,000
 Volts Maximum)
- F. Underwriters Laboratories, Inc. (UL):
 1996-01.....Electric Duct Heaters

PART 2 - PRODUCTS

2.1 HEATING AND COOLING COILS

- A. Conform to ASTM B75 and ARI 410.
- B. Tubes: Minimum 16 mm (0.625 inch) tube diameter; Seamless copper tubing.
- C. Fins: 0.1397 mm (0.0055 inch) aluminum or 0.1143 mm (0.0045 inch) copper mechanically bonded or soldered or helically wound around tubing. Provide copper fins for sprayed coil applications and reheat coils for Operating Rooms.
- D. Headers: Copper, welded steel or cast iron. Provide seamless copper tubing or resistance welded steel tube for volatile refrigerant coils.
- E. "U" Bends, Where Used: Machine die-formed, silver brazed to tube ends.
- F. Coil Casing: 1.6 mm (16 gage) galvanized steel with tube supports at 1200 mm (48 inch) maximum spacing. Construct casing to eliminate air bypass and moisture carry-over. Provide duct connection flanges.
- G. Pressures kPa (PSIG):

Pressure	Water Coil	Steam Coil	Refrigerant Coil
Test	2070 (300)	1725 (250)	2070 (300)
Working	1380 (200)	520 (75)	1725 (250)

- H. Protection: Unless protected by the coil casing, provide cardboard, plywood, or plastic material at the factory to protect tube and finned surfaces during shipping and construction activities.
- I. Vents and Drain: Coils that are not vented or drainable by the piping system shall have capped vent/drain connections extended through coil casing.
- J. Cooling Coil Condensate Drain Pan: Section 23 73 00, INDOOR CENTRAL-STATION AIR-HANDLING UNITS.

2.2 WATER COILS

- A. Drainable Type (Self-Draining, Self-Venting); manufacturer standard:

1. Cooling, all types.
2. Heating or preheat.

B. Cleanable Tube Type; manufacturer standard:

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Follow coil manufacturer's instructions for handling, cleaning, installation and piping connections.
- B. Comb fins, if damaged. Eliminate air bypass or leakage at coil sections.

- - - E N D - - -

SECTION 25 10 10
ADVANCED UTILITY METERING SYSTEM

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This Section includes the following for the advanced metering of the systems of the facility. The metered systems include the electrical power. The metering systems in each facility are part of a Corporate-Wide utility metering system, rendering the VA accurate and automated metering of its facilities' energy. Metering systems are comprised of:
1. PC-based workstation(s) or server(s) and software.
 2. Communication network and interface modules for RS-232, RS-485, Modbus TCP/IP, IEEE 802.3 data transmission protocols.
 3. Electric meters.

1.2 RELATED WORK

- A. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: General electrical requirements and items that are common to more than one section of Division 26.
- B. Section 26 05 21, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES (600 VOLTS AND BELOW): Low voltage cable.
- C. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS: Requirements for personnel safety and to provide a low impedance path for possible ground fault currents.
- D. Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS: Conduits.
- E. Section 26 04 16, PANELBOARDS: Panelboards.

1.3 DEFINITIONS

- A. AMR: Automatic meter reading is the technology of automatically collecting consumption, diagnostic, and status data from water and energy metering devices (water, gas, electric, steam) and transferring that data to a central database for billing, troubleshooting, and analyzing.
- B. AUMS: Advanced Utility Metering System: the system described by this Section.
- C. BACnet: BACnet is a Data Communications Protocol for Building Automation and Control Networks. It is defined by ASHRAE/ANSI Standard 135 (ISO 16484-5) standard protocol.
- D. Data Over Cable Service Interface Specification (DOCSIS): an international standard defining communications and operation support

- interface requirements for a data over cable system, by the Cable Television Laboratories, Inc. consortium
- E. Data Head (on meters): converts analog and pulse signals to digital signals for transmission to the Site Data Aggregation Device. Also provides for limited storage of the digital signals.
 - F. Device Accuracy: accuracy in this section is based on actual flow, not full scale or full range. Device accuracy measures the conversion of flow information to analog or pulse signals.
 - G. Ethernet: Local area network, based on IEEE 802.3 standards.
 - H. Firmware: Software (programs or data) that has been written onto read-only memory (ROM). Firmware is a combination of software and hardware. Storage media with ROMs that have data or programs recorded on them are firmware.
 - I. Gateway: Bi-directional protocol translator connecting control systems that use different communication protocols.
 - J. GB: gigabyte. When used to describe data storage, "GB" represents 1024 megabytes.
 - K. HTML: Hypertext markup language.
 - L. I/O: Input/output.
 - M. KB: Short for kilobyte. When used to describe data storage, "KB" represents 1024 bytes.
 - N. KY Pulse: A term used by the metering industry to describe a method of measuring consumption of electricity that is based on a relay changing status in response to the rotation of the disk in the meter.
 - O. LAN: Local area network. Sometimes plural as "LANs."
 - P. LCD: Liquid crystal display.
 - Q. LonMark: An association comprising of suppliers and installers of LonTalk products. The Association provides guidelines for the implementation of the LonTalk protocol to ensure interoperability through Standard implementation.
 - R. LonTalk: An open standard protocol developed by the Echelon Corporation that uses a "Neuron Chip" for communication.
 - S. LonWorks: Network technology developed by the Echelon Corporation.
 - T. Low Voltage: As defined in NFPA 70 for circuits and equipment operating at less than 50 V or remote-control, signaling and power-limited circuits.
 - U. MB: megabyte. When used to describe data storage, "MB" represents 1024 kilobytes.

- V. Mbps: Megabytes per second, equal to 8 megabits per second
- W. Modbus TCP/IP: An open protocol for exchange of process data.
- X. Monitoring: Acquisition, processing, communication, and display of equipment status data, metered electrical parameter values, power quality evaluation data, event and alarm signals, tabulated reports, and event logs.
- Y. OTDR: Optical Time Domain Reflectometer. A test instrument that analyzes the light loss in an optical fiber. Used to find faults, splices and bends in the line, it works by sending out a light pulse and measuring its reflection. Such devices can measure fiber lines that are longer than 150 miles
- Z. PC: Personal computer
- AA.PICS, Protocol Implementation Conformance Statement: A written document that identifies the particular options specified by BACnet that are implemented in a device.
- BB.REO: Resident Engineer Office: the VA office administering the construction contract.
- CC.Reporting Accuracy: this is the root-mean-square sum of all of the metering devices' inaccuracies: measurement inaccuracy, mechanical inaccuracy, analog-to-digital or pulse integration inaccuracy, etc., up to the meter's data head.
- DD.rms: Root-mean-square value of alternating voltage, which is the square root of the mean value of the square of the voltage values during a complete cycle.
- EE.Router: A device that connects two or more networks at the network layer.
- FF.RS-232: A Telecommunications Industry Association standard for asynchronous serial data communications between terminal devices.
- GG.RS-485: A Telecommunications Industry Association standard for multipoint communications using two twisted-pairs.
- HH.TB: terrabyte. When used to describe data storage, "TB" represents 1024 gigabytes.
- II.TCP/IP: Transport control protocol/internet protocol.
- JJ.Turn-down: the maximum flow divided by the minimum flow through a meter; used along with accuracy requirements. For example, a meter shall be accurate to within 2% of actual flow with throughout a 20:1 turndown
- KK.THd: Total harmonic distortion.

LL.UPS: Uninterruptible power supply; used both in singular and plural context.

MM.UTP: Unshielded twisted pair cabling, used to limit crosstalk and electromagnetic interference from the environment

NN.WAN: Wide area network.

1.4 QUALITY ASSURANCE

- A. Installer Qualifications: Manufacturer's authorized representative who is trained and approved for installation of units required for this Project.
- B. Manufacturer Qualifications: A firm experienced at least three years in manufacturing and installing power monitoring and control equipment similar to that indicated for this Project and with a record of successful in-service performance.
- C. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, Article 100, by a testing agency, and marked for intended use.
- D. System Modifications: Make recommendations for system modification in writing to the VA. No system modifications shall be made without prior written approval of the VA. Any modifications made to the system shall be incorporated into the Operations and Maintenance Instructions, and other documentation affected. Provide to the VA software updates for all software furnished under this specification during this contract's construction and verification periods and for the first two years after government acceptance. All updated software shall be verified as part of this contract.

1.5 PERFORMANCE

- A. The advanced utility metering system shall conform to the following:
 - 1. Site Data Aggregation Device Graphic Display: The system shall display up to 4 graphics on a single screen with a minimum of twenty (20) dynamic points per graphic. All current data shall be displayed within ten (10) seconds of the request.
 - 2. Site Data Aggregation Device Graphic Refresh: The system shall update all dynamic points with current data within ten seconds. Data refresh shall be automatic, without operator intervention.
 - 3. Meter Scan: All changes of metered values shall be transmitted over the high-speed network such that any data used or displayed at a controller or Site Data Aggregation Device will be current, within the prior ten seconds.

4. Alarm Response Time: The maximum time from when meter goes into alarm to when it is annunciated at the workstation shall not exceed ten seconds.
5. Reporting Accuracy: Listed below are minimum acceptable reporting accuracies for all values within the below minimum turn-down envelope reported by the meters:

Measured Variable	Units Measured	Minimum Turn-Down of Meter	Reporting Accuracy (Note 1)
Electricity	V, A, W, etc.	n/a	±0.5% of measured value

Table 1.5: Meter Performance Criteria

Table Notes:

1. This table shows reporting accuracy, not merely the meter's accuracy. Reporting accuracy includes meter accuracy and data conversion accuracy. See Article 1.3 in this Section for definition. Accuracy is shown against the measured value, not against the full range of the meter.

1.6 WARRANTY

- A. Labor and materials for advanced utility metering systems shall be warranted for a period as specified under Warranty in FAR clause 52.246-21.
- B. Advance utility metering system failures during the warranty period shall be adjusted, repaired, or replaced at no cost or reduction in service to the owner. The system includes all computer equipment, transmission equipment, and all sensors and metering devices.

1.7 SUBMITTALS

- A. Product Data: for each type of product indicated, Attach copies of approved Product Data submittals for products (panelboards) that describe advance utility metering features to illustrate coordination among related equipment and utility metering and control.
- B. Shop Drawings: include plans, elevations, sections, details, and attachments to other work.
 1. Outline Drawings: Indicate arrangement of meters, components and clearance and access requirements. Clearly identify system components, internal connections, and all field connections.
 2. Block Diagram: Show interconnections between components specified in this Section and devices furnished with power distribution system components. Indicate data communication paths and identify networks, data buses, data gateways, concentrators, and other

devices to be used. Describe characteristics of network and other data communication lines.

3. Detail equipment assemblies and indicate dimensions, weights, loads, required clearances, method of field assembly, components, and location and size of each field connection.
 4. Wiring Diagrams: Power, signal, and communications wiring. Coordinate nomenclature and presentation with a block diagram. Show all communications network components and include a communications single-line diagram indicating device interconnection and addressing information for all system devices. Identify terminal blocks used for interconnections and wire type to be used.
 5. UPS sizing calculations for workstation.
- C. Software and Firmware Operational Documentation:
1. Self-study guide describing the process for setting equipment's network address; setting Owner's options; procedures to ensure data access from any PC on the network, using a standard Web browser; and recommended firewall setup.
 2. Software operating and upgrade manuals.
 3. Software Backup: On a compact disc, complete with Owner-selected options.
 4. Device address list and the set point of each device and operator option, as set in applications software.
 5. Graphic file and printout of graphic screens and related icons, with legend.
 6. "Quick-Start" guide to describe a simple, three-step commissioning process for setting the equipment's Ethernet address, and ensuring trouble-free data access from any PC on the network, using a standard web browser.
- D. Software Upgrade Kit: For Owner to use in modifying software to suit future utility metering system revisions.
- E. Firmware Upgrade Kit: For Owner to use in modifying firmware to suit future power system revisions or advanced utility metering system revisions. Firmware updates, and necessary software tools for firmware updates, shall be downloadable from the internet. VA shall be able to update firmware, in equipment, without removing device from the equipment. VA shall be capable of updating firmware over the utility metering communication network or through local communication ports on the device.

- F. Software licenses and upgrades required by and installed for operating and programming digital and analog devices.
- G. Qualification Data: For installer and manufacturer
- H. Other Informational Submittals:
 - 1. System installation and setup guides, with data forms to plan and record options and setup decisions.
- I. Revise and update the Contract Drawings to include details of the system design. Drawings shall be on 17 by 11 inches sheets. Details to be shown on the Design Drawing include:
 - 1. Details on logical structure of the network. This includes logical location of all network hardware.
 - 2. Manufacturer and model number for each piece of computer and network hardware.
 - 3. Physical location for each piece of network or computer hardware.
 - 4. Physical routing of LAN cabling.
 - 5. Physical and qualitative descriptions of connectivities.

1.8 CLOSEOUT SUBMITTALS

- A. Operation and Maintenance Data: For advanced utility metering system components and meters, to include in emergency, operation, and maintenance manuals. Include the following:
 - 1. Operating and applications software documentation.
 - 2. Software licenses.
 - 3. Software service agreement.
 - 4. PC installation and operating documentation, manuals, and software for the PC and all installed peripherals. Software shall include system restore, emergency boot compact disks, and drivers for all installed hardware. Provide separately for each PC.
 - 5. Hard copies of manufacturer's specification sheets, operating specifications, design guides, user's guides for software and hardware, and PDF files on CD-ROM of the hard-copy submittal.
 - 6. In addition to the copies required by 01 00 00, provide 5 bound paper copies of the Operation and Maintenance Data and two compact disks (CD), with all Instructions as Acrobat PDF files. The pdf files shall identical to the paper copies and shall Acrobat navigation tools including Bookmarks for each Chapter.
 - 7. The advanced utility metering system Operation and Maintenance Instructions shall include:
 - a. Procedures for the AUMS system start-up, operation and shut-down.

- b. Final As-Built drawings, including actual LAN cabling routing shown on architectural backgrounds.
 - 1) IP address(es) as applicable for each piece of network hardware.
 - 2) IP address for each computer server, workstation and networked printer.
 - 3) Network identifier (name) for each printer, computer server and computer workstation.
 - 4) CEA-709.1B address (domain, subnet, node address) for each CEA-709.1B TP/FT-10 to IP Router.
- c. Routine maintenance checklist, rendered in a Microsoft Excel format. The routine maintenance checklist shall be arranged in a columnar format. The first column shall list all installed devices, the second column shall list each device's node identifier/address, the third column shall describe each device's physical location, the fourth column shall state the maintenance activity or state no maintenance required, the fifth column shall state the frequency of the maintenance activity, frequency of calibration and the sixth column for additional comments or reference.
- d. Qualified service organization list.
- e. In addition to the requirements in Section 01 33 23, the submittal shall include manufacturer Installation Requirements.
- f. Include complete instructions for calibration of each meter type and model.
- g. Start-Up and Start-Up Testing Report.
- h. Performance verification test procedures and reports.
- i. Preventive Maintenance Work Plan.
- j. In addition to factory-trained manufacturers' representatives requirements in 01 00 00, provide signed letter by factory-trained manufacturers' representatives stating that the system and components are installed in strict accordance with the manufacturers' recommendations.
- B. Field quality-control test reports.

1.9 LICENSING AGREEMENT

- A. Licenses procured as part of this work become the property of the government upon acceptance of the work. Licenses shall have no expiration.

- B. Technical Support: Beginning with Government Acceptance, provide software support for two years.
- C. Upgrade Service: Update software to latest version at Project completion. Install and program software upgrades that become available within two years from date of Government Acceptance. Upgrading software shall include the operating systems. Upgrade shall include new or revised licenses for use of software.
 - 1. Provide 30-day notice to Owner to allow scheduling and access to system and to allow Owner to upgrade computer equipment if necessary.

1.10 MAINTENANCE AND SERVICE

- A. Preventive Maintenance Requirements: provide a preventative maintenance plan with attached procedures indicated by meter and component manufacturers. Perform maintenance procedures for a period of 1 year after government acceptance, at frequencies and using procedures required by the meter and component manufacturers. At a minimum and if the manufacturer is silent on its preventative maintenance requirements, frequencies, deliverables and activities shall comply with the following:
 - 1. Preventive Maintenance Work Plan: Prepare a Preventive Maintenance Work Plan to schedule all required preventive maintenance. VA approval of the Work Plan shall be obtained. Adhere to the approved work plan to facilitate VA verification of work. If the Contractor finds it necessary to reschedule maintenance, a written request shall be made to the VA detailing the reasons for the proposed change at least five days prior to the originally scheduled date. Scheduled dates shall be changed only with the prior written approval of the REO.
 - 2. Semiannual Maintenance: perform the following Semiannual Maintenance as specified:
 - a. Perform data backups on all Server Hardware.
 - b. Run system diagnostics and correct diagnosed problems.
 - c. Perform fan checks and filter changes for AUMS hardware.
 - d. Perform all necessary adjustments on printers.
 - e. Resolve all outstanding problems.
 - f. Install new ribbons, ink cartridges and toner cartridges into printers, and ensure that there is at least one spare ribbon or cartridge located at each printer.

3. Maintenance Procedures
- a. Maintenance Coordination: Any scheduled maintenance event by Contractor that will result in component downtime shall be coordinated with the VA as follows. Time periods shall be measured as actual elapsed time from beginning of equipment off-line period, including working and non-working hours.
 - 1) For non-redundant computer server hardware, provide 14 days notice, components shall be off-line for no more than 8 hours.
 - 2) For redundant computer server hardware, provide 7 days notice, components shall be off-line for no more than 36 hours.
 - 3) For active (powered) network hardware, provide 14 days notice, components shall be off-line for no more than 6 hours.
 - 4) For cabling and other passive network hardware, provide 21 days notice, components shall be off-line for no more than 12 hours.
 - b. Software/Firmware: Software/firmware maintenance shall include operating systems, application programs, and files required for the proper operation of the advanced utility metering system regardless of storage medium. User- (project site-) developed software is not covered by this contract, except that the advanced utility metering system software/firmware shall be maintained to allow user creation, modification, deletion, and proper execution of such user-developed software as specified. Perform diagnostics and corrective reprogramming as required to maintain total advanced utility metering system operations as specified. Back up software before performing any computer hardware and software maintenance. Do not modify any parameters without approval from the VA. Any approved changes and additions shall be properly documented, and the appropriate manuals shall be updated.
 - c. Network: Network maintenance shall include testing transmission media and equipment to verify signal levels, system data rates, errors and overall system performance.
- B. Service Call Reception
- 1. A VA representative will advise the Contractor by phone or in person of all maintenance and service requests, as well as the classification of each based on the definitions specified. A description of the problem or requested work, date and time

notified, location, classification, and other appropriate information will be placed on a Service Call Work Authorization Form by the VA.

2. The Contractor shall have procedures for receiving and responding to service calls during regular working hours. A single telephone number shall be provided for receipt of service calls during regular working hours. Service calls shall be considered received by the Contractor at the time and date the telephone call is placed by the VA.
3. Separately record each service call request, as received on the Service Call Work Authorization form. Complete the Service Call Work Authorization form for each service call. The completed form shall include the serial number identifying the component involved, its location, date and time the call was received, nature of trouble, names of the service personnel assigned to the task, instructions describing what has to be done, the amount and nature of the materials to be used, the time and date work started, and the time and date of completion.
4. Respond to each service call request within two working hours. The status of any item of work must be provided within four hours of the inquiry during regular working hours, and within sixteen hours after regular working hours or as needed to repair equipment.

1.11 SPARE PARTS

- A. Furnish spare parts described below that match products installed and that are packaged with protective covering for storage and identified with labels describing contents.
 1. Addressable Relays: One for every ten installed. Furnish at least one of each type.
 2. Data Line Surge Suppressors: One for every ten of each type installed. Furnish at least one of each type.
- B. Furnish spare parts shall not be used for any warranty-required remediation.

1.12 APPLICABLE PUBLICATIONS

- A. Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced, unless otherwise noted. Publications are referenced in the text by the basic designation only.
- A. Consumer Electronics Association (CEA)

- 709.1B-2002.....Control Network Protocol Specification
- 709.3-1999.....Free-Topology Twisted-Pair Channel
Specification
- 852-A-2004.....Tunneling Component Network Protocols Over
Internet Protocol Channels
- B. Federal Communications Commission (FCC)
- EMC-2002.....FCC Electromagnetic Compliance Requirements
- C. Institute of Electrical and Electronics Engineers, Inc. (IEEE)
- 81-1983.....IEEE Guide for Measuring Earth Resistivity,
Ground Impedance, and Earth Surface Potentials
of a Ground System
- 100-2000.....The Authoritative Dictionary of IEEE Standards
Terms
- 802.1D-2004.....Media Access Control Bridges
- 802.2-2003.....Standards for Local Area Networks: Logical Link
Control
- 802.3-2005.....Information Technology - Telecommunications and
Information Exchange between Systems. Local and
Metropolitan Area Networks - Specific
Requirements - Part 3: Carrier Sense Multiple
Access with Collision Detection (CSMA/CD)
Access Method and Physical Layer Specifications
(ANSI)
- 1100-2005.....Recommended Practice for Powering and Grounding
Electronic Equipment (ANSI)
- C37.90.1-2002.....Surge Withstand Capability (SWC) Tests for
Relays and Relay Systems Associated with
Electric Power Apparatus
- C57.13-2008.....Standard Requirements for Instrument
Transformers
- C62.41.1-2002.....Guide on the Surges Environment in Low-
Voltage(1000 V and Less) AC Power Circuits
- C62.41.2-2002.....Recommended Practice on Characterization of
Surges in Low-Voltage (1000 V and Less) AC
Power Circuits
- D. International Electrotechnical Commission (IEC)

- IEC 61000-2005.....Electromagnetic Compatibility (EMC)- Part 4-5:
Testing and Measurement Techniques; Surge
Immunity Test
- E. National Electrical Contractors Association
NECA 1-2006.....Good Workmanship in Electrical Construction
- F. National Electrical Manufacturers Association (NEMA)
250-2008.....Enclosures for Electrical Equipment (1000 Volts
Maximum)
C12.1-2008.....Electric Meters; Code for Electricity Metering
C12.20-2002.....Electricity Meter - 0.2 and 0.5 Accuracy
Classes
C62.61-1993.....Gas Tube Surge Arresters on Wire Line Telephone
Circuits
ICS 1-2008.....Standard for Industrial Control and Systems
General Requirements
- G. National Institute of Standards and Technology (NIST)
800, Part 39-2008.....[DRAFT] Managing Risk from Information Systems:
An Organizational Perspective
800, Part 46-2009.....Guide to Enterprise Telework and Remote Access
Security
800, Part 52-2009.....Recommended Security Controls for Federal
Information Systems and Organizations
(FIPS) 200-2006.....Minimum Security Requirements for Federal
Information and Information Systems
- H. National Fire Protection Association (NFPA)
70-2008.....National Electrical Code (NEC)
101-06.....Life Safety Code
262-2007.....Test for Flame Travel and Smoke of Wires and
Cables for Use in Air-Handling Spaces
- I. Telecommunications Industry Association, (TIA/EIA)
H-088C3.....Pathway Design Handbook
232-F-2002.....Interface Between Data Terminal Equipment and
Data Circuit-Terminating Equipment Employing
Serial Binary Data Interchange
485-A-2003.....Electrical Characteristics of Generators and
Receivers for Use in Balanced Digital
Multipoint System

- 568-C.1-2009.....Commercial Building Telecommunications Cabling
Standard
- 606-A-2002.....Administration Standard for the
Telecommunications Infrastructure
- 607-A-2002.....Commercial Building Grounding (Earthing) and
Bonding Requirements for Telecommunications
- J. Underwriters Laboratories, Inc. (UL):
 - 916-2007.....Energy Management Equipment
 - 5085-3-2007.....UL Standard for Safety Standard Low Voltage
 - 1244-2000.....Electrical and Electronic Measuring and Testing
Equipment
 - 1581-2006.....Electrical Wires, Cables, and Flexible Cords

PART 2 - PRODUCTS

2.1 ADVANCED UTILITY METERING SYSTEM

A. Functional Description

1. Meter and record load profiles. Chart energy consumption patterns.
 - a. Calculate and record the following:
 - 1) Load factor.
 - 2) Peak demand periods.
 - 3) Consumption correlated with facility activities.
 - b. Measure and record metering data for the following:
 - 1) Electricity.
 - c. Software: calculate allocation of utility costs.
 - 1) Verify utility bills and analyze alternate energy rates.
 - d. Electric Power Quality Monitoring: Identify power system anomalies and measure, display, capture waveforms, and record trends and alarms of the following power quality parameters:
 - 1) Voltage regulation and unbalance.
 - 2) Continuous three-phase rms voltage.
 - 3) Periodic max./min./avg. samples.
 - 4) Harmonics.
 - 5) Voltage excursions.
 - e. Emergency Load Shedding. Preserve critical loads or avoid total shutdown due to unforeseen loss of power sources according to the following logic:
 - 1) Determine system topology.
 - 2) Evaluate remaining loads and sources.
 - 3) Shed loads in less than 100 ms.

f. Demand Management:

- 1) Peaking or co-generator control.
- 2) Load interlocking.
- 3) Load shedding.
- 4) Load trimming.

g. System: Report equipment status and power system control.

B. Communications Components and Networks

1. Site Data Aggregation Device and its networked meters shall communicate using BACNet protocol. Backbone shall communicate using ISO 8802-3 (Ethernet) Data Link/Physical layer protocol and BACnet/IP addressing as specified in ASHRAE/ANSI 135-2008, BACnet Annex J.
 - a. Control products, communication media, connectors, repeaters, hubs, and routers shall comprise a BACnet internetwork. Controller and operator interface communication shall conform to ANSI/ASHRAE Standard 135-2008, BACnet.
 - b. Each controller shall have a communication port for connection to an operator interface.
2. Network Configuration: High-speed, multi-access, open nonproprietary, industry standard LAN and WAN and Internetworked LAN.
3. Communication protocol; LANs complying with RS-485 or RS-485 accessed through Ethernet, 100 Base-TX Ethernet, and Modbus TCP/IP.
4. Network Hardware
 - a. Building Point of Connection Hardware
 - 1) Active equipment and communication interfaces.
 - 2) Switches, hubs, bridges, routers and servers.
 - b. IP Network Hardware
 - 1) Wire and Cables, copper connectivity devices.
 - 2) Fiber Optic Patch Panel.
 - 3) Fiber Optic Media Converter
 - 4) Ethernet Switch
 - 5) IP Router
5. Communication Security
 - a. Remote teleworking and remote access of the network shall be through a firewall, at the Site Data Aggregation Device, complying with the requirements associated with Level 1 security

in the Federal Information Processing Standard 140-2 (2002),
Security Requirements for Cryptographic Modules.

b. Direct access to network shall be restricted as described in

2.2 SITE DATA AGGREGATION DEVICE - PERSONAL COMPUTER WORKSTATION

A. Hardware

1. Printers: provide a dedicated, minimum resolution 600 dpi, color laser printer, connected to the Site Data Aggregation Device through a USB interface.
 - a. If a network printer is used instead of this dedicated printer, it shall have a 100Base-T interface with an RJ45 connection and shall have a firmware print spooler compatible with the Operating System print spooler.
 - b. RAM: 512 MB, minimum.
 - c. Printing Speed: Minimum twenty six pages per minute (color); minimum 30 pages per minute (black/white).
 - d. Paper Handling: Automatic sheet feeder with 250-sheet x 8.5 inch x 11 inch paper cassette and with automatic feed.
2. RS-232 ASCII Interface
 - a. ASCII interface shall allow RS-232 connections to be made between a meter or circuit monitor operating as the host PC and any equipment that will accept RS-232 ASCII command strings, such as local display panels, dial-up modems, and alarm transmitters.
 - b. Pager System Interface: Alarms shall be able to activate a pager system with customized message for each input alarm.
 - c. RS-232 output shall be capable of connection to a pager interface that can be used to call a paging system or service and send a signal to a portable pager. System shall allow an individual alphanumeric message per alarm input to be sent to paging system. This interface shall support both numeric and alphanumeric pagers.
 - d. Alarm System Interface: RS-232 output shall be capable of transmitting alarms from other monitoring and alarm systems to workstation software.
 - e. Cables: provide Plenum-Type, RS-232 Cable: Paired, 2 pairs, No. 22 AWG, stranded (7x30) tinned copper conductors, plastic insulation, and individual aluminum foil-polyester tape shielded pairs with 100 percent shield coverage; plastic jacket. Pairs

are cabled on common axis with No. 24 AWG, stranded (7x32) tinned copper drain wire.

1) NFPA 70, Type CMP.

2) Flame Resistance: NFPA 262, Flame Test.

3. Rack-Mounted Server Hardware

- a. Environmental Conditions: System components shall be capable of withstanding Indoor installation in spaces that have environmental controls to maintain ambient conditions of 36 to 140 deg F dry bulb temperature and 20 to 95% relative humidity, noncondensing environmental conditions without mechanical or electrical damage or degradation of operating capability.
- b. Computer: Commercial rack-mounted with supporting 32- or 64-bit hardware (as limited by the advanced utility metering system software) and software enterprise server. Internet Explorer v6.0 SP1 or higher, Windows Script Hosting version 5.6 or higher, Windows Message Queuing, Windows Internet Information Services (IIS) v5.0 or higher, minimum 2.8 GHz processor, minimum 4GB DDR3 SDRAM (minimum 1333 Mhz) memory, minimum 1 TB 7200 rpm SATA hard drive with 16 MB cache, and 16 speed high density DVD-RW+/- optical drive.
- c. Real-Time Clock:
 - 1) Accuracy: Plus or minus 1 minute per month.
 - 2) Time Keeping Format: 24-hour time format including seconds, minutes, hours, date, day, and month; automatic reset by software.
 - 3) Clock shall function for one year without power.
 - 4) Provide automatic time correction once every 24 hours by synchronizing clock with the Time Service Department of the U.S. Naval Observatory.
- d. Serial Ports: Four USB ports and two RS-232-F serial ports for general use, with additional ports as required. Data transmission rates shall be selectable under program control.
- e. Parallel Port: Enhanced.
- f. Removable Disk Storage: Include minimum 1 TB removable hard disk, maximum average access time of 10 ms, with appropriate controller:

- g. Network Interface Card (NIC): integrated 10-100-1000 Base-TX Ethernet NIC with an RJ45 connector or a 100Base-FX Ethernet NIC with an SC/ST connector.
 - h. Cable Modem: 42.88 Mbps, DOCSIS 2.0 Certified, also backwards compatible with DOCSIS 2.0 and DOCSIS 1.1/1.0 standards. Provide Ethernet or USB connectivity.
 - i. Optical Modem: full duplex link, for use on 10 GBase-R single-mode and multi-mode fiber with a XENPAK module.
 - j. Modem: 56,600 bits per second, full duplex for asynchronous communications. With error detection, auto answer/autodial, and call-in-progress detection. Modem shall comply with requirements in ITU-T v.34, ITU-T v.42, ITU-T v.42 Appendix VI for error correction, and ITU-T v.42 BIS for data compression standards; and shall be suitable for operating on unconditioned voice-grade telephone lines complying with 47 CFR 68.
 - k. Audible Alarm: Manufacturer's standard.
4. RS-232 ASCII Interface
- a. ASCII interface shall allow RS-232 connections to be made between a meter or circuit monitor operating as the host PC and any equipment that will accept RS-232 ASCII command strings, such as local display panels, dial-up modems, and alarm transmitters.
 - b. Pager System Interface: Alarms shall be able to activate a pager system with customized message for each input alarm.
 - c. RS-232 output shall be capable of connection to a pager interface that can be used to call a paging system or service and send a signal to a portable pager. System shall allow an individual alphanumeric message per alarm input to be sent to paging system. This interface shall support both numeric and alphanumeric pagers.
 - d. Alarm System Interface: RS-232 output shall be capable of transmitting alarms from other monitoring and alarm systems to workstation software.
 - e. Cables: provide Plenum-Type, RS-232 Cable: Paired, 2 pairs, No. 22 AWG, stranded (7x30) tinned copper conductors, plastic insulation, and individual aluminum foil-polyester tape shielded pairs with 100 percent shield coverage; plastic jacket. Pairs are cabled on common axis with No. 24 AWG, stranded (7x32) tinned copper drain wire.

- 1) NFPA 70, Type CMP.
- 2) Flame Resistance: NFPA 262, Flame Test.

B. Software

1. Operating System (OS)

- a. For a Site Data Aggregation Device connected to multiple utility meters, software shall reside on the Workstation or Server PC connected to a network able to poll and support over 1000 utility metering devices; software shall be web-enabled with the option to add custom graphics displays and additional web-enabled clients. BACNet, Ethernet, Modbus TCP/IP, RS-232, and RS-485 digital communications.
- b. Operating System Software: Based on 32- or 64-bit, Microsoft Windows operating system, as required by the metering and database software. Software shall have the following features:
 - 1) Multiuser and multitasking to allow independent activities and monitoring to occur simultaneously at different workstations.
 - 2) Graphical user interface to show pull-down menus and a menu tree format.
 - 3) Capability for future additions within the indicated system size limits.

2. Office Automation Software shall consist of the e-mail, spreadsheet and word processing portions of the project site's standard office automation software.
3. Virus Protection Software shall consist of the project site's standard virus protection software complete with a virus definition update subscription.
4. Configuration server shall meet the requirements of CEA-852-A.
5. Network configuration tool shall meet the following minimum requirements:
 - a. It shall allow configuration of the network while off-line such that an operator may set up changes to the network while disconnected from the network, and then execute all of them once connected.
 - b. It shall have a graphics-based user interface, and be able to display and print a graphical representation of the control network.

- c. It shall be capable of generating and printing a table containing domain/subnet/node address and node identifier for the entire network or any subset thereof, selected by the User.
- d. It shall be capable of merging two existing standard databases into a single standard database.

6. Metering Software

a. Basic Requirements:

- 1) Fully compatible with and based on the approved operating system.
- 2) Password-protected operator login and access; three levels, minimum.
- 3) Password-protected setup functions.
- 4) Context sensitive on-line help.
- 5) Capability of creating, deleting, and copying files; and automatically maintaining a directory of all files, including size and location of each sequential and random-ordered record.
- 6) Capability for importing custom icons into graphic views to represent alarms and I/O devices.
- 7) Automatic and encrypted backups for database and history; automatically stored at the Site Data Aggregation Device and encrypted with a nine-character alphanumeric password, which must be used to restore or read data contained in backup.
- 8) Operator audit trail for recording and reporting all changes made to user-defined system options.

b. Workstation and Server Functions:

- 1) Support other client PCs on the LAN and WAN.
- 2) Maintain recorded data in databases accessible from other PCs on the LAN and WAN.

c. Data Formats:

- 1) User-programmable export and import of data to and from commonly used Microsoft Windows spreadsheet, database, billing, and other applications; using dynamic data exchange technology.
- 2) Option to convert reports and graphics to HTML format.
- 3) Interactive graphics.
- 4) Option to send preprogrammed or operator designed e-mail reports.

- 5) Option to serve information to third-party applications via Object Linking and Embedding for Process Control using open standards.
- d. Metered data: Display metered values in real time with a rigid time-stamp. Couple all metered data with measured outside air conditions at the relevant facility.
- e. Metered Data alarms: Provide generic alarm modules to notify Users and highlight metered data gaps, data spikes outside of range, and data timestamp errors.
 - 1) Customize the generic alarm modules to the application.
 - 2) Modules shall allow for user adjustment of alarm criteria.
 - 3) Alarm notices shall be shown via hyperlinks on the graphical User interface, and shall also be shown by flags within the data set.
- f. Automatic Data Scrubbing: Provide tools for User-programming of rules to scrub the data of the followings errors: data gaps, data spikes outside of range, and data timestamp errors. Use these rules to scrub the raw metered data. Flag all data which has been so scrubbed.
- g. Equipment Documentation: Database for recording of equipment ratings and characteristics; with capability for graphic display on monitors.
- h. User-Defined Events: Display and record with date and time stamps accurate to 0.1 second, and including the following:
 - 1) Operator log on/off.
 - 2) Attempted operator log on/off.
 - 3) All alarms.
 - 4) Equipment operation counters.
 - 5) Out-of-limit, pickup, trip, and no-response events.
- i. (for electrical power monitoring) Waveform Data: Display and record waveforms on demand or automatically on an alarm or programmed event; include the graphic displays of the following, based on user-specified criteria:
 - 1) Phase voltages, phase currents, and residual current.
 - 2) Overlay of three-phase currents, and overlay each phase voltage and current.
 - 3) Waveforms ranging in length from 2 cycles to 5 minutes.

- 4) Disturbance and steady-state waveforms up to 512 points per cycle.
- 5) Transient waveforms up to 83,333 points per cycle on 60-Hz base.
- 6) Calculated waveform on a minimum of four cycles of data of the following:
 - a) THD.
 - b) rms magnitudes.
 - c) Peak values.
 - d) Crest factors.
 - e) Magnitude of individual harmonics.
- j. Data Sharing: Allow export of recorded displays and tabular data to third-party applications software on the local server.
- k. Activity Tracking Software:
 - 1) Automatically compute and prepare activity demand and energy-use statements based on metering of energy use and peak demand integrated over user-defined interval.
 - 2) Intervals shall be same as used by electric utilities, including current vendor.
 - 3) Import metered data from saved records that were generated by metering and monitoring software.
 - 4) Maintain separate directory for each activity's historical billing information.
 - 5) Prepare summary reports in user-defined formats and time intervals.
- l. Passwords
- m. Protocol Drivers
- n. System Graphic Displays: provide interactive color-graphics platform with pull-down menus and mouse-driven generation of power system graphics, in formats widely used for such drafting; to include the following:
 - 1) Site plan.
 - 2) Floor plans.
 - 3) Equipment elevations.
 - 4) Single-line diagrams.
 - 5) Custom graphic screens configured, not programmed, using drag-and-drop tools available within the software.

- o. Alarms: display and record alarm messages from discrete input and controls outputs, according to user programmable protocol.
 - 1) Functions requiring user acknowledgment shall run in background during computer use for other applications and override other presentations when they occur.
- p. Trending: display and record data acquired in real-time from different meters or devices, in historical format over user-defined time; unlimited as to interval, duration, or quantity of trends.
 - 1) Spreadsheet functions of sum, delta, percent, average, mean, standard deviation, and related functions applied to recorded data.
 - 2) Charting, statistical, and display functions of standard Windows-based spreadsheet.
- q. Report Generation: User commands initiate the reporting of a list of current alarm, supervisory, and trouble conditions in system or a log of past events.
 - 1) Print a record of user-defined alarm, supervisory, and trouble events on workstation printer.
 - a) Sort and report by device name and by function.
 - b) Report type of signal (alarm, supervisory, or trouble), description, date, and time of occurrence.
 - c) Differentiate alarm signals from other indications.
 - d) When system is reset, report reset event with same information concerning device, location, date, and time.
- 7. BACnet: Site Data Aggregation Device shall have demonstrated interoperability during at least one BMA Interoperability Workshop and shall substantially conform to BACnet Operator Workstation (BOWS) device profile as specified in ASHRAE/ANSI 135-2001, BACnet Annex L
- 8. Site Data Aggregation Device shall periodically upload metered data to the VA Corporate-wide server:
 - a. The metering software shall provide periodic upload (adjustable interval, initially set on 15-minute intervals) of the scrubbed and collected data.
 - b. The VA's Corporate wide server accepts the following data structures:

- 1) Information structured using the 2005 and 2008 SQL server database engine.
- 2) The following data stores are acceptable:
 - a) Databases: SQL Server, DB2, Oracle, Access, Sybase, MySQL.
 - b) Flat files: .CSV, .XLS, .TXT, .XML, .PQDIF
- c. The minimum data to be uploaded (per meter) includes:
 - 1) A time stamp
 - 2) A device identifier
 - 3) A flow (power or water flow) value
 - 4) A flow order of magnitude
 - 5) Description of the flow's units
 - 6) The outside air drybulb temperature at the time stamp
 - 7) The outside air wetbulb temperature at the time stamp
 - 8) A "scrubbed data" flag
 - 9) An irregular data alarm stamp
- C. Self-contained uninterruptible power supply (UPS):
 1. Size: Provide a minimum of six hours of operation of workstation station equipment, including two hours of alarm printer operation.
 2. Batteries: Sealed, valve regulated, recombinant, lead calcium.
 3. Accessories:
 - a. Transient voltage suppression.
 - b. Input-harmonics reduction.
 - c. Rectifier/charger.
 - d. Battery disconnect device.
 - e. Static bypass transfer switch.
 - f. First six subparagraphs below are optional accessories.
 - g. Internal maintenance bypass/isolation switch.
 - h. External maintenance bypass/isolation switch.
 - i. Output isolation transformer.
 - j. Remote UPS monitoring.
 - k. Battery monitoring.
 - l. Remote battery monitoring.

2.3 CABLE SYSTEMS - TWISTED PAIR AND FIBER OPTIC

- A. General:
 1. All metallic cable sheaths, etc. (i.e.: risers, underground, station wiring, etc. shall be grounded.
 2. Install temporary cable and wire pairs so as to not present a pedestrian safety hazard. Provide for all associated work for any

temporary installation and for removal when no longer necessary. Temporary cable installations are not required to meet Industry Standards; but, must be reviewed and approved by the VA prior to installation.

3. Cable conductors to provide protection against induction in circuits. Crosstalk attenuation within the System shall be in excess of -80 dB throughout the frequency ranges specified.
4. Minimize the radiation of RF noise generated by the System equipment so as not to interfere with audio, video, data, computer main distribution frame (MDF), telephone customer service unit (CSU), and electronic private branch exchange (EPBX) equipment the System may service.
5. The as-installed drawings shall identify each cable as labeled, used cable, and bad cable pairs.
6. Label system's cables on each end. Test and certify cables in writing to the VA before conducting proof-of-performance testing. Minimum cable test requirements are for impedance compliance, inductance, capacitance, signal level compliance, opens, shorts, cross talk, noise, and distortion, and split pairs on all cables in the frequency ranges specified. The cable tests shall demonstrate the operation of this cable at not less than 10 mega (m) Hertz (Hz) full bandwidth, fully channel loaded and a Bit Error Rate of a minimum of 10^{-6} at the maximum rate of speed. Make available all cable installation and test records at acceptance testing by the VA and shall thereafter be maintained in the Facility's Telephone Switch Room. All changes (used pair, failed pair, etc.) shall be posted in these records as the change occurs.
7. Coordinate with the Electrical Contractor to install the telephone entrance cable to the nearest point of entry into the Facility and as shown on the drawings. Coordinate with the VA and the Electrical Contractor to provide all cable pairs/circuits from the Facility point of entry to the Telephone Switch Room all telephone, FTS, DHCP, ATM, Frame Relay, data, pay stations, patient phones, and any low voltage circuits as described herein.
8. Provide all cable pairs/circuits from the Server Room and establish circuits throughout the Facility for all cabling as described herein.

9. Provide proper test equipment to demonstrate that cable pairs meet each OEM's standard transmission requirements, and guarantee the cable will carry data transmissions at the required speeds, frequencies, and fully loaded bandwidth.
- B. LAN COPPER CABLES
1. Comply with Section 27 15 00 "Communications Horizontal Cabling."
 2. RS-485 Cable:
 - a. PVC-Jacketed, RS-485 Cable: Paired, 2 pairs, twisted, No. 22 AWG, stranded (7x30) tinned copper conductors, PVC insulation, unshielded, PVC jacket, and NFPA 70, Type CMG.
 3. Unshielded Twisted Pair Cables: Category 5e or 6 as specified for horizontal cable for data service in Section 27 15 00 "Communications Horizontal Cabling."
 4. Cabling products shall be tested and certified for use at data speeds up to at least 100 Mbps. Other types of media commonly used within IEEE Std 802.3 LANs (e.g., 10Base-T and 10Base-2) shall be used only in cases to interconnect with existing media. Short lengths of media and transceivers may be used in these applications. Provide separately orderable media, taps and connectors.
 5. Ethernet Switch shall be IEEE Std 802.3 bridges which shall function as the center of a distributed-star architecture and shall be "learning" bridges with spanning tree algorithms in accordance with IEEE Std 802.1D. The switch shall support the connected media types and shall have a minimum of 150% the required ports and no fewer than 4 ports. One port shall be switch selectable as an uplink port.
 6. Provide IP router network equipment. The routers shall be fully configurable for protocol types, security, and routing selection of sub-networks. The router shall meet all requirements of RFC 1812.
- C. LAN FIBER OPTICAL CABLES
1. Interior Fiber Optic Cable: Interior Fiber Optic Cable shall be Multimode or Singlemode fiber, 62.5/125 micron for multimode or 10/125 micron for singlemode micron with SC or ST connectors as specified in TIA-568-C.1. Terminations, patch panels, and other hardware shall be compatible with the specified fiber and shall be as specified in Section 27 15 00 "Communications Horizontal Cabling." The data communications equipment shall use the 850-nm range of multimode or 1310-nm range of singlemode fiber-optic cable.

Fiber-optic cable shall be suitable for use with the 100Base-FX standard as defined in IEEE Std 802.3.

2. Exterior Fiber Optic Cable: Exterior Fiber Optic Cable shall be Multimode or Singlemode Fiber, 62.5/125 micron for multimode or 10/125 micron for singlemode micron with SC or ST connectors as specified in TIA-568-C.1. Terminations, patch panels, and other hardware shall be compatible with the specified fiber and shall be as specified in Section 27 15 00 "Communications Horizontal Cabling.". The data communications equipment shall use the 850-nm range of multimode or 1310-nm range of singlemode fiber-optic cable. Fiber-optic cable shall be suitable for use with the 100Base-FX standard as defined in IEEE Std 802.3.
3. Fiber Optic Patch Panels shall be wall or rack mountable and designed to provide termination facilities for up to 24 fibers. Unit shall also have capability to be equipped with spliced trays, six packs (for adapters), and blank panels for easy termination of the fiber bundles and tube cables. Fiber-optic terminating equipment shall provide for mounting of ST or SC connectors on an optical patch panel. Provide fiber-cable management and cable-routing hardware to assure conformance to minimum fiber and cable bend radii. Connectors on the patch panel shall be ST or SC feed through. Provide access to both sides of the panel. The patch panel for the connectors shall be mounted to facilitate rearrangement and identification. Each apparatus shall have cabling and connection instructions associated with it.
4. Fiber Optic media converter shall provide media conversion between layer 1 copper and fiber media to support data rates equal to the greater of the physical layer or 100 Mbps as specified in IEEE Std 802.3.

D. LOW-VOLTAGE WIRING

1. Low-Voltage Control Cable: Multiple conductor, color-coded, No. 20 AWG copper, minimum.
 - a. Sheath: PVC; except in plenum-type spaces, use sheath listed for plenums.
 - b. Ordinary Switching Circuits: Three conductors, unless otherwise indicated.
 - c. Switching Circuits with Pilot Lights or Locator Feature: Five conductors, unless otherwise indicated.

2.4 GROUNDING

- A. Ground cable shields, drain conductors, and equipment to eliminate shock hazard and to minimize ground loops, common-mode returns, noise pickup, cross talk, and other impairments. Comply with VA 27 05 26 Grounding and Bonding for Communications Systems and with VA 26 05 26 Grounding and Bonding for Electrical Systems.

2.5 METER COMMUNICATION

- A. Provide a BACNet network allowing communication from the meters' data heads to the Site Data Aggregation Device.
- B. Provide data heads at each meter, converting analog and pulsed information to digital information. Data heads shall allow for up to 24 hours of data storage (including time stamp, measured value, and scaling factor).
 - 1. Each data head shall reside on a BACnet network using the MS/TP Data Link/Physical layer protocol. Each data head shall have a communication port for connection to an operator interface.
 - 2. Environment: Data Head hardware shall be suitable for the conditions ranging from -29°C to 60°C (-20°F to 140°F). Data Heads used outdoors and/or in wet ambient conditions shall be mounted within waterproof enclosures and shall be rated for operation at conditions ranging from -29°C to 60°C (-20°F to 140°F).
 - 3. Provide a local keypad and display for interrogating and editing data. An optional system security password shall be available to prevent unauthorized use of the keypad and display.
 - 4. Serviceability. Provide diagnostic LEDs for power, communication, and processor. All wiring connections shall be made to field-removable, modular terminal strips or to a termination card connected by a ribbon cable.
 - 5. Memory. The building controller shall maintain all BIOS and data in the event of a power loss for at least 72 hours.
 - 6. Immunity to power and noise. Controller shall be able to operate at 90% to 110% of nominal voltage rating and shall perform an orderly shutdown below 80% nominal voltage. Operation shall be protected against electrical noise of 5 to 120 Hz and from keyed radios up to 5 W at 1 m (3 ft).

2.6 ELECTRICAL POWER METERS AND SUB-METERS

- A. ELECTRICAL METER APPLICATIONS

1. Energy meters in the advanced utility metering system shall have models available for amperage ranges of 100-2400 amperes.
 - a. The RS-485 communications shall provide communications links up to 10,000 feet long.
 2. Power meters shall be installed as part of the advanced utility metering system.
 - a. All setup parameters required by the power meter shall be stored in nonvolatile memory and retained in the event of a control power interruption.
 - b. The power meter may be applied in three-phase, three- or four-wire systems.
 - c. The power meter shall be capable of being applied without modification at nominal frequencies of 50, 60, or 400 Hz.
 - d. The power meter shall provide for onboard data logging, able to log data, alarms, waveforms and events.
- B. Physical and Common Requirements
1. Electrical power meters shall be separately mounted, and enclosed in a NEMA 250, Type 1 enclosure. Environmental Conditions: System components shall be capable of withstanding the following environmental conditions without mechanical or electrical damage or degradation of operating capability:
 - a. Ambient conditions of 0 to 140 deg F dry bulb and 20 to 95 percent relative humidity, noncondensing.
- C. Current and voltage ratings:
1. Designed for use with current inputs from standard instrument current transformers with 5-A secondary and shall have a metering range of 0-10 A.
 2. Withstand ratings shall be not less than 15 A, continuous; 50 A, lasting over 10 seconds, no more frequently than once per hour; 500 A, lasting 1 second, no more frequently than once per hour.
 3. Voltage inputs from standard instrument potential transformers with 120 volt secondary output. The power meter shall support PT primaries through 3.2 MV.
 4. The power meter shall operate properly over a wide range of control power including 90-457 VAC or 100-300 VDC.
- D. Electrical measurements and calculated values
1. Power meters shall include the following rms Real-Time Measurements:

- a. Current: Each phase, neutral, average of three phases, percent unbalance.
 - b. Voltage: Line-to-line each phase, line-to-line average of three phases, line-to-neutral each phase, line-to-neutral average of three phases, line-to-neutral percent unbalance.
 - c. Power: Per phase and three-phase total.
 - d. Reactive Power: Per phase and three-phase total.
 - e. Apparent Power: Per phase and three-phase total.
 - f. True Power Factor: Per phase and three-phase total.
 - g. Displacement Power Factor: Per phase and three-phase total.
 - h. Frequency.
 - i. THD: Current and voltage.
 - j. Accumulated Energy: Real kWh, reactive kVARh, apparent kVAh (signed/absolute).
 - k. Incremental Energy: Real kWh, reactive kVARh, apparent kVAh (signed/absolute).
 - l. Conditional Energy: Real kWh, reactive kVARh, apparent kVAh (signed/absolute).
2. Power meters shall perform the following demand current calculations, per phase, three-phase average and neutral:
 - a. Present.
 - b. Running average.
 - c. Last completed interval.
 - d. Peak.
 3. Power meters shall perform the following demand real power calculations, three-phase total:
 - a. Present.
 - b. Running average.
 - c. Last completed interval.
 - d. Predicted.
 - e. Peak.
 - f. Coincident with peak kVA demand.
 - g. Coincident with kVAR demand.
 4. Power meters shall perform the following demand reactive power calculations, three-phase total:
 - a. Present.
 - b. Running average.
 - c. Last completed interval.

- d. Predicted.
 - e. Peak.
 - f. Coincident with peak kVA demand.
 - g. Coincident with kVAR demand.
5. Power meters shall perform the following demand apparent power calculations, three-phase total:
- a. Present.
 - b. Running average.
 - c. Last completed interval.
 - d. Predicted.
 - e. Peak.
 - f. Coincident with peak kVA demand.
 - g. Coincident with kVAR demand.
6. Power meters shall perform the following average true power factor calculations, demand coincident, three-phase total:
- a. Last completed interval.
 - b. Coincident with kW peak.
 - c. Coincident with kVAR peak.
 - d. Coincident with kVA peak.
7. Power Analysis Values:
- a. THD, Voltage and Current: Per phase, three phase, and neutral.
 - b. Displacement Power Factor: Per phase, three phase.
 - c. Fundamental Voltage, Magnitude and Angle: Per phase.
 - d. Fundamental Currents, Magnitude and Angle: Per phase.
 - e. Fundamental Real Power: Per phase, three phase.
 - f. Fundamental Reactive Power: Per phase.
 - g. Harmonic Power: Per phase, three phase.
 - h. Phase rotation.
 - i. Unbalance: Current and voltage.
 - j. Harmonic Magnitudes and Angles for Current and Voltages: Per phase, up to 31st harmonic.
8. Power meters shall perform one of the following demand calculations, selectable by the User; meters shall be capable of performance of all of the following demand calculations.
- a. Block interval with optional subintervals: Adjustable for 1-minute intervals, from 1 to 60 minutes. User-defined parameters for the following block intervals:

- 1) Sliding block that calculates demand every second, with intervals less than 15 minutes, and every 15 seconds with an interval between 15 and 60 minutes.
 - 2) Fixed block that calculates demand at end of the interval.
 - 3) Rolling block subinterval that calculates demand at end of each subinterval and displays it at end of the interval.
- b. Demand calculations initiated by a Utility-furnished synchronization signal:
- 1) Signal is a pulse from an external source. Demand period begins with every pulse. Calculation shall be configurable as either a block or rolling block calculation.
 - 2) Signal is a communication signal. Calculation shall be configurable as either a block or rolling block calculation.
 - 3) Demand can be synchronized with clock in the power meter.
- c. Minimum and maximum values: Record monthly minimum and maximum values, including date and time of record. For three-phase measurements, identify phase of recorded value. Record the following parameters:
- 1) Line-to-line voltage.
 - 2) Line-to-neutral voltage.
 - 3) Current per phase.
 - 4) Line-to-line voltage unbalance.
 - 5) Line-to-neutral voltage unbalance.
 - 6) Power factor.
 - 7) Displacement power factor.
 - 8) Total power.
 - 9) Total reactive power.
 - 10) Total apparent power.
 - 11) THD voltage L-L.
 - 12) THD voltage L-N.
 - 13) THD current.
 - 14) Frequency.
- d. Harmonic calculation: display and record the following:
- 1) Harmonic magnitudes and angles for each phase voltage and current through 31st harmonic. Calculate for all three phases, current and voltage, and residual current. Current and voltage information for all phases shall be obtained simultaneously from same cycle.

- 2) Harmonic magnitude reported as a percentage of the fundamental or as a percentage of rms values, as selected by the VA.

E. Waveform Capture:

1. Capture and store steady-state waveforms of voltage and current channels; initiated manually. Each capture shall be for 3 cycles, 128 data points for each cycle, allowing resolution of harmonics to 31st harmonic of basic 60 Hz.
2. Capture and store disturbance waveform captures of voltage and current channels, initiated automatically based on an alarm event. Each capture shall be fully configurable for duration with resolution of at least 128 data points per cycle, for all channels simultaneously. Waveform shall be configurable to capture pre-event cycles for analysis.
3. Store captured waveforms in internal nonvolatile memory; available for PC display, archiving, and analysis.

F. Meter accuracy:

1. Comply with ANSI C12.20, Class 0.5; and IEC 60687, Class 0.5 for revenue meters.
2. Accuracy from Light to Full Rating:
 - a. Power: Accurate to 0.5 percent of reading.
 - b. Voltage and Current: Accurate to 0.5 percent of reading.
 - c. Power Factor: Plus or minus 0.005, from 0.5 leading to 0.5 lagging.
 - d. Frequency: Plus or minus 0.01 Hz at 45 to 67 Hz.

G. Meter input, sampling, display, output, recording and reading Capabilities

1. Input: One digital input signal.
 - a. Normal mode for on/off signal.
 - b. Demand interval synchronization pulse, accepting a demand synchronization pulse from a utility demand meter.
 - c. Conditional energy signal to control conditional energy accumulation.
 - d. GPS time synchronization.
2. Sampling:
 - a. Current and voltage shall be digitally sampled at a rate high enough to provide accuracy to 63rd harmonic of 60-Hz fundamental.

- b. Power monitor shall provide continuous sampling at a rate of 128 samples per cycle on all voltage and current channels in the meter.
- 3. Display Monitor:
 - a. Backlighted LCD to display metered data with touch-screen or touch-pad selecting device.
 - b. Touch-screen display shall be a minimum 12-inch diagonal, resolution of 800 by 600 RGB pixels, 256 colors; NEMA 250, Type 1 display enclosure.
 - c. Display four values on one screen at same time.
 - 1) Coordinate list below with meter capabilities specified in subparagraphs above.
 - 2) Current, per phase rms, three-phase average and neutral.
 - 3) Voltage, phase to phase, phase to neutral, and three-phase averages of phase to phase and phase to neutral.
 - 4) Real power, per phase and three-phase total.
 - 5) Reactive power, per phase and three-phase total.
 - 6) Apparent power, per phase and three-phase total.
 - 7) Power factor, per phase and three-phase total.
 - 8) Frequency.
 - 9) Demand current, per phase and three-phase average.
 - 10) Demand real power, three-phase total.
 - 11) Demand apparent power, three-phase total.
 - 12) Accumulated energy (MWh and MVARh).
 - 13) THD, current and voltage, per phase.
 - d. Reset: Allow reset of the following parameters at the display:
 - 1) Peak demand current.
 - 2) Peak demand power (kW) and peak demand apparent power (kVA).
 - 3) Energy (MWh) and reactive energy (MVARh).
- 4. Outputs:
 - a. Operated either by user command sent via communication link, or set to operate in response to user-defined alarm or event.
 - b. Closed in either a momentary or latched mode as defined by user.
 - c. Each output relay used in a momentary contact mode shall have an independent timer that can be set by user.
 - d. One digital KY pulse to a user-definable increment of energy measurement. Output ratings shall be up to 120-V ac, 300-V dc, 50 mA, and provide 3500-V rms isolation.

e. One relay output module, providing a load voltage range from 20- to 240-V ac or from 20- to 30-V dc, supporting a load current of 2 A.

f. Output Relay Control:

- 1) Relay outputs shall operate either by user command sent via communication link or in response to user-defined alarm or event.
- 2) Normally open and normally closed contacts, field configured to operate as follows:
 - a) Normal contact closure where contacts change state for as long as signal exists.
 - b) Latched mode when contacts change state on receipts of a pickup signal; changed state is held until a dropout signal is received.
 - c) Timed mode when contacts change state on receipt of a pickup signal; changed state is held for a preprogrammed duration.
 - d) End of power demand interval when relay operates as synchronization pulse for other devices.
 - e) Energy Pulse Output: Relay pulses quantities used for absolute kWh, absolute kVARh, kVAh, kWh In, kVARh In, kWh Out, and kVARh Out.
 - f) Output controlled by multiple alarms using Boolean-type logic.

5. Onboard Data Logging:

a. Store logged data, alarms, events, and waveforms in 2 MB of onboard nonvolatile memory.

b. Stored Data:

- 1) Billing Log: User configurable; data shall be recorded every 15 minutes, identified by month, day, and 15-minute interval. Accumulate 24 months of monthly data, 32 days of daily data, and between 2 to 52 days of 15-minute interval data, depending on number of quantities selected.
- 2) Custom Data Logs: three user-defined log(s) holding up to 96 parameters. Date and time stamp each entry to the second and include the following user definitions:
 - a) Schedule interval.
 - b) Event definition.

- c) Configured as "fill-and-hold" or "circular, first-in first-out."
- 3) Alarm Log: Include time, date, event information, and coincident information for each defined alarm or event.
- 4) Waveform Log: Store captured waveforms configured as "fill-and-hold" or "circular, first-in first-out."
- c. Default values for all logs shall be initially set at factory, with logging to begin on device power up.
- 6. Alarms.
 - a. User Options:
 - 1) Define pickup, dropout, and delay.
 - 2) Assign one of four severity levels to make it easier for user to respond to the most important events first.
 - 3) Allow for combining up to four alarms using Boolean-type logic statements for outputting a single alarm.
 - b. Alarm Events:
 - 1) Over/undercurrent.
 - 2) Over/undervoltage.
 - 3) Current imbalance.
 - 4) Phase loss, current.
 - 5) Phase loss, voltage.
 - 6) Voltage imbalance.
 - 7) Over kW demand.
 - 8) Phase reversal.
 - 9) Digital input off/on.
 - 10) End of incremental energy interval.
 - 11) End of demand interval.

PART 3 - EXECUTION

3.1 INSTALLATION REQUIREMENTS

A. Cabling

- 1. Install Category 5e UTP, Category 6 UTP, and optical fiber cabling system as detailed in TIA-568-C.1, TIA/EIA-568-B.2, or TIA-568-C.3.
- 2. Screw terminals shall not be used except where specifically indicated on plans.
- 3. Use an approved insulation displacement connection (IDC) tool kit for copper cable terminations.
- 4. Do not untwist Category 5e, Category 6 UTP cables more than 12 mm (1/2 inch) from the point of termination to maintain cable geometry.

5. Provide service loop on each end of the cable, 3 m (10 feet) at the server rack and 304 mm (12 inches) at the meter.
 6. Do not exceed manufacturers' cable pull tensions for copper and optical fiber cables.
 7. Provide a device to monitor cable pull tensions. Do not exceed 110 N (25 pounds) pull tension for four pair copper cables.
 8. Do not chafe or damage outer jacket materials.
 9. Use only lubricants approved by cable manufacturer.
 10. Do not over cinch cables, or crush cables with staples.
 11. For UTP cable, bend radii shall not be less than four times the cable diameter.
 12. Cables shall be terminated; no cable shall contain unterminated elements.
 13. Cables shall not be spliced.
 14. Label cabling in accordance with paragraph Labeling in this section.
- B. Labeling
1. Labels: Provide labeling in accordance with TIA/EIA-606-A.
Handwritten labeling is unacceptable. Stenciled lettering for all circuits shall be provided using laser printer.
 2. Cables: Cables shall be labeled using color labels on both ends with identifiers in accordance with TIA/EIA-606-A.
- C. Grounding: ground exposed, non-current-carrying metallic parts of electrical equipment, metallic raceway systems, grounding conductor in metallic and nonmetallic raceways, telecommunications system grounds, and grounding conductor of nonmetallic sheathed cables, as well as equipment to eliminate shock hazard and to minimize ground loops, common-mode returns, noise pickup, cross talk, and other impairments. Comply with VA 27 05 26 GROUNDING AND BONDING FOR COMMUNICATIONS SYSTEMS and with VA 26 05 26 GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS.
- D. Surge Protection
1. Provide surge protective devices on all metallic cables entering and leaving an interior environment to an exterior environment or vice versa, i.e. surge protective device at each interior location of a penetration to the exterior environment.
- E. Network Hardware
1. System components and appurtenances shall be installed in accordance with the manufacturer's instructions and as shown. Necessary

interconnections, services, and adjustments required for a complete and operable wired or wireless data transmission system shall be provided and shall be fully integrated with the configured network chosen for the project.

F. Computer Hardware

1. Provide the server(s) or personal computer workstation(s) where shown on the plans or indicated diagrammatically.

G. Computer Software

1. User friendly software shall be suitable for operation on computer workstations which serve as site data aggregation devices by monitoring the meters in the system, recording events, indicating alarm conditions, and logging and displaying system reports.
2. The software shall be developed by the manufacturer of the monitoring devices, and shall be designed specifically for energy, power monitoring and control. Additional utilities, i.e. water, air gas, electric and steam shall also be easily integrated.
3. The software shall be configured, not programmed. All software shall be configured by the vendor and delivered ready to use. This configuration shall include preparation of all graphics, displays, and interactive one-line diagrams required as a part of this project.
 - a. Configuration shall be to the point that when monitoring devices are required to be added, the user shall only convey to the software the communications address and type of device.
4. The software shall be a standard product offering with no customization required and clients shall interface with the server or computer workstation via Internet Explorer browser.
 - a. The web-enabled interactive graphics client shall only reside on the server PC, client PC not required to host any application software other than Internet Explorer 6.0 SP1 or higher browser to become a fully functional system.

H. Electrical Meters

1. Power monitoring and control components shall all be factory installed, wired and tested prior to shipment to the job site.
2. All control power, CT, PT and data communications wire shall be factory wired and harnessed within the equipment enclosure.
3. Where external circuit connections are required, terminal blocks shall be provided and the manufacturer's drawings must clearly

identify the interconnection requirements including wire type to be used.

4. All wiring required to externally connect separate equipment lineups shall be furnished and installed at the site as part of the contractor's responsibility.
5. Contractor interconnection wiring requirements shall be clearly identified on the power monitoring and control system shop drawings.

3.2 ADJUSTING AND IDENTIFICATION

- A. Install a permanent wire marker on each wire at each termination.
- B. Identifying numbers and letters on the wire markers shall correspond to those on the wiring diagrams used for installing the systems.
- C. Wire markers shall retain their markings after cleaning.

3.3 FIELD QUALITY CONTROL

- A. The power monitoring and control system vendor must be able to provide development, integration and installation services required to complete and turn over a fully functional system including:
 1. Project management to coordinate personnel, information and on-site supervision for the various levels and functions of suppliers required for completion of the project.
 2. All technical coordination, installation, integration, and testing of all components.
 3. Detailed system design and system drawings.
- B. Cabling, equipment and hardware manufacturers shall have a minimum of 5 years experience in the manufacturing, assembly, and factory testing of components which comply with EIA TIA/EIA-568-B.1, EIA TIA/EIA-568-B.2 and EIA TIA/EIA-568-B.3.
- C. The network cabling contractor shall be a firm which is regularly and professionally engaged in the business of the applications, installation, and testing of the specified network cabling systems and equipment. The contractor shall demonstrate experience in providing successful systems within the past 3 years. Submit documentation for a minimum of three and a maximum of five successful network cabling system installations.
 1. Supervisors and installers assigned to the installation of this system or any of its components shall be Building Industry Consulting Services International (BICSI) Registered Cabling Installers, Technician Level. Submit documentation of current BICSI certification for each of the key personnel.

3.4 ACCEPTANCE TESTING

- A. Develop testing procedures to address all specified functions and components of the Advanced Utility Metering System (AUMS). Testing shall demonstrate proper and anticipated responses to normal and abnormal operating conditions.
 - 1. Provide skilled technicians to start and operate equipment.
 - 2. Coordinate with equipment manufacturers to determine specific requirements to maintain the validity of the warranty.
 - 3. Correct deficiencies and make necessary adjustments to O&M manuals and as-built drawings for issues identified in testing.
 - 4. Provide all tools to start, check-out and functionally test equipment and systems.
 - 5. Correct deficiencies and make necessary adjustments to O&M manuals and as-built drawings for issues identified in any testing
 - 6. Review test procedures, testing and results with Government.
- B. Testing checklists: Develop project-specific checklists to document the systems and all components are installed in accordance with the manufacturers recommendation and the Contract Documents.
- C. Before testing, the following prerequisite items must be completed.
 - 1. All related equipment has been started and start-up reports and checklists submitted and approved as ready for testing:
 - 2. All associated system functions for all interlocking systems are programmed and operable per contract documents.
 - 3. All punchlist items for the AUMS and equipment are corrected.
 - 4. The test procedures reviewed and approved.
 - 5. Safeties and operating ranges reviewed.
- D. The following testing shall be included:
 - 1. Demonstrate reporting of data and alarm conditions for each point and ensure that alarms are received at the assigned location, including Site Data Collection Device.
 - 2. Demonstrate ability of software program to function for the intended application.
 - 3. Demonstrate via graphed trends to show the reports are executed in correct manner.
 - 4. Demonstrate that the meter readings are accurate using portable NIST traceable portable devices and calibrated valves in the piping system

5. Demonstrate that the systems perform during power loss and resumption of power.
- E. Copper cables: Contractor shall provide all necessary testing equipment to test all copper network circuit cables. Tests shall conform to EIA/TIA 568B Permanent Link testing criteria. All testers are to be EIA/TIA 568B, Level IIe compliant. The primary field test parameters are:
 1. Wire map: The wire map test is intended to verify pair to pin termination at each end and check for installation connectivity errors. For each of the conductors in the cable, the wire map indicates:
 - a. Continuity to the remote end
 - b. Shorts between any two or more conductors
 - c. Crossed pairs
 - d. Reversed pairs
 - e. Split pairs
 - f. Any other mis-wiring
 2. Length requirements: The maximum physical length of the basic link shall be 94 meters (including test equipment cords).
 3. Insertion Loss: Worst case insertion loss relative to the maximum insertion loss allowed shall be reported.
 4. Near-end crosstalk (NEXT) loss: Field tests of NEXT shall be performed at both ends of the test configuration.
 5. Power sum near-end crosstalk (PSNEXT) loss
 6. Equal-level far-end crosstalk (ELFEXT): Field tests of ELFEXT shall be performed at both ends of the test configuration
 7. Power sum equal-level far-end crosstalk (PSELFEXT): Must be determined from both ends of the cable. Power sum Near End Crosstalk is not a category 3 parameter. For all frequencies from 1 to 100 MHz, the category 5e PSELFEXT of the cabling shall be measured in accordance with annex E of ANSI/TIA/EIA-568-B.2 and shall meet the values determined using equations (12) and (13) for the permanent link. PSELFEXT is not a required category 3 measurement parameter.
 8. Return loss: Includes all the components of the link. The limits are based on the category of components and cable lengths. Return loss must be tested at both ends of the cable. Cabling return loss is not a required measurement for category 3 cabling.

9. Propagation delay and delay skew: Propagation delay is the time it takes for a signal to propagate from one end to the other.
Propagation delay shall be measured in accordance with annex D of ANSI/TIA/EIA-568 B.2. The maximum propagation delay for all category permanent link configurations shall not exceed 498 ns measured at 10 MHz. Delay skew is a measurement of the signaling delay difference from the fastest pair to the slowest. Delay skew shall be measured in accordance with annex D of ANSI/TIA/EIA-568-B.2. The maximum delay skew for all category permanent link configurations shall not exceed 44 ns.
 10. Administration: In addition to Pass/Fail indications, measured values of test parameters should be recorded in the administration system. Any reconfiguration of link components after testing may change the performance of the link and thus invalidates previous test results. Such links shall require retesting to regain conformance.
 11. Test equipment connectors and cords: Adapter cords that are qualified and determined by the test equipment manufacturer to be suitable for permanent link measurements shall be used to attach the field tester to the permanent link under consideration.
 12. Test setup: The permanent link test configuration is to be used by installers and users of data telecommunications systems to verify the performance of permanently installed cabling. A schematic representation of the permanent link is illustrated in figure 1. The permanent link consists of up to 90 m (295 ft) of horizontal cabling and one connection at each end and may also include an optional transition/consolidation point connection. The permanent link excludes both the cable portion of the field test instrument cord and the connection to the field test instrument.
 13. Replace or repair and cables, connectors, and/or terminations found to be defective.
 14. Repair, replace, and/or re-work any or all defective components to achieve cabling tests which meet or exceed 568B permanent link requirements prior to acceptance of the installation or payment for services.
- F. Optical Fiber cables: Contractor shall provide all necessary testing equipment to test all optical fiber cables.
1. Attenuation Testing:

- a. Singlemode testing shall conform to TIA/EIA 526-7 Method A.1 single jumper reference and TIA/EIA 568-B-1 requirements for link segment testing.
 - b. Multimode testing shall conform to TIA/EIA 526-14-A Method B single jumper reference and TIA/EIA 568-B-1 requirements for link segment testing.
 - c. Attenuation testing shall be performed in one direction at each operating wavelength.
 - d. Testing of backbone fiber optic cabling shall be performed from main telecommunications room to each telecommunications room.
 - e. Testing of horizontal fiber optic cabling shall be performed from telecommunications room to station outlet location.
 - f. Tester shall be capable of recording and reporting test reading in an electronic format.
2. OTDR Testing:
- a. OTDR testing is required on all backbone fiber optic cables
 - b. The test shall be preformed as per the EIA/TIA 455-61.
 - c. Multimode testing shall be performed with a minimum 80 meter launch cable.
 - d. Singlemode testing shall be performed with a minimum of 500 meter launch cable.
 - e. Tests shall be performed on each fiber in each direction at both operating wavelengths.
3. Test report data shall reference cables by cable labeling standards. Tests shall be submitted on a 1.5mb, 3.5" DOS formatted floppy disk. Contractor shall provide tests in the native file format of the tester. Contractor shall provide all software needed to view, print, and edit tests.
4. Replace or repair and defective cables, connectors, terminations, etc.
5. Mated connector pairs shall have no more than 0.5dB loss. Fusion splices shall have no more than .15dB loss per splice. Cable attenuation shall be no more than 2% more than the attenuation of the cable on the reel as certified at the factory. Repair, replace, and/or rework any or all defective components to achieve specified test results prior to acceptance of the installation or payment for services.

- G. Wireless Modems: Test system by sending 100,000 commands. Frame error rate shall not be greater than 5 out 100,000 commands.

3.5 DEMONSTRATION AND INSTRUCTION

- A. Furnish the services of a factory-trained engineer or technician for a total of two four-hour classes to instruct designated Facility Information Technologies personnel. Instruction shall include cross connection, corrective, and preventive maintenance of the wired network system and connectivity equipment.
- B. Before the System can be accepted by the VA, this training must be provided and executed. Training will be scheduled at the convenience of the Facilities Contracting Officer and Chief of Engineering Service.
- C. On-site start-up and training of the advanced utility metering system shall include a complete working demonstration of the system with simulation of possible operating conditions that may be encountered.
 - 1. Include any documentation and hands-on exercises necessary to enable electrical and mechanical operations personnel to assume full operating responsibility for the advanced utility monitoring system after completion of the training period.
- D. Include six (6) calendar days on-site start-up assistance and three (3) calendar days on-site training in two sessions separated by minimum of thirty (30) calendar days.
- E. Regularly schedule and make available factory training for VA staff training on all aspects of advanced utility metering system including:
 - 1. Comprehensive software and hardware setup, configuration, and operation.
 - 2. Advanced monitoring and data reporting.
 - 3. Advanced power quality and disturbance monitoring.
- F. Before the system is accepted by the VA, the contractor shall walk-through the installation with the VA's representative and the design engineer to verify proper installation. The contractor may be requested to open enclosures and terminal compartments to verify cable labeling and/or installation compliance.

G. As-built drawings shall be provided noting the exact cable path and cable labeling information. Drawings in .DWG format will be available to the contractor. As-builts shall be submitted to the VA on disk saved as .DXF or .DWG files. Redline hardcopies shall be provided as well. CAD generated as-built information shall be shown on a new layer named AS_BUILT.

----- END -----

SECTION 26 05 11
REQUIREMENTS FOR ELECTRICAL INSTALLATIONS

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This section applies to all sections of Division 26.
- B. Furnish and install electrical wiring, systems, equipment and accessories in accordance with the specifications and drawings. Capacities and ratings of motors, transformers, cable, switchboards, switchgear, panelboards, motor control centers, generators, automatic transfer switches, and other items and arrangements for the specified items are shown on drawings.
- C. Electrical service entrance equipment and arrangements for temporary and permanent connections to the utility's system shall conform to the utility's requirements. Coordinate fuses, circuit breakers and relays with the utility's system, and obtain utility approval for sizes and settings of these devices.
- D. Wiring ampacities specified or shown on the drawings are based on copper conductors, with the conduit and raceways accordingly sized. Aluminum conductors are prohibited.

1.2 MINIMUM REQUIREMENTS

- A. References to the International Building Code (IBC), National Electrical Code (NEC), Underwriters Laboratories, Inc. (UL) and National Fire Protection Association (NFPA) are minimum installation requirement standards.
- B. Drawings and other specification sections shall govern in those instances where requirements are greater than those specified in the above standards.

1.3 TEST STANDARDS

- A. All materials and equipment shall be listed, labeled or certified by a nationally recognized testing laboratory to meet Underwriters Laboratories, Inc., standards where test standards have been established. Equipment and materials which are not covered by UL Standards will be accepted provided equipment and material is listed, labeled, certified or otherwise determined to meet safety requirements of a nationally recognized testing laboratory. Equipment of a class which no nationally recognized testing laboratory accepts, certifies, lists, labels, or determines to be safe, will be considered if

inspected or tested in accordance with national industrial standards, such as NEMA, or ANSI. Evidence of compliance shall include certified test reports and definitive shop drawings.

B. Definitions:

1. Listed; Equipment, materials, or services included in a list published by an organization that is acceptable to the authority having jurisdiction and concerned with evaluation of products or services, that maintains periodic inspection of production or listed equipment or materials or periodic evaluation of services, and whose listing states that the equipment, material, or services either meets appropriate designated standards or has been tested and found suitable for a specified purpose.
2. Labeled; Equipment or materials to which has been attached a label, symbol, or other identifying mark of an organization that is acceptable to the authority having jurisdiction and concerned with product evaluation, that maintains periodic inspection of production of labeled equipment or materials, and by whose labeling the manufacturer indicates compliance with appropriate standards or performance in a specified manner.
3. Certified; equipment or product which:
 - a. Has been tested and found by a nationally recognized testing laboratory to meet nationally recognized standards or to be safe for use in a specified manner.
 - b. Production of equipment or product is periodically inspected by a nationally recognized testing laboratory.
 - c. Bears a label, tag, or other record of certification.
4. Nationally recognized testing laboratory; laboratory which is approved, in accordance with OSHA regulations, by the Secretary of Labor.

1.4 QUALIFICATIONS (PRODUCTS AND SERVICES)

- A. Manufacturers Qualifications: The manufacturer shall regularly and presently produce, as one of the manufacturer's principal products, the equipment and material specified for this project, and shall have manufactured the item for at least three years.
- B. Product Qualification:
 1. Manufacturer's product shall have been in satisfactory operation, on three installations of similar size and type as this project, for approximately three years.

2. The Government reserves the right to require the Contractor to submit a list of installations where the products have been in operation before approval.

C. Service Qualifications: There shall be a permanent service organization maintained or trained by the manufacturer which will render satisfactory service to this installation within eight hours of receipt of notification that service is needed. Submit name and address of service organizations.

1.5 APPLICABLE PUBLICATIONS

Applicable publications listed in all Sections of Division are the latest issue, unless otherwise noted.

1.6 MANUFACTURED PRODUCTS

- A. Materials and equipment furnished shall be of current production by manufacturers regularly engaged in the manufacture of such items, for which replacement parts shall be available.
- B. When more than one unit of the same class or type of equipment is required, such units shall be the product of a single manufacturer.
- C. Equipment Assemblies and Components:
 1. Components of an assembled unit need not be products of the same manufacturer.
 2. Manufacturers of equipment assemblies, which include components made by others, shall assume complete responsibility for the final assembled unit.
 3. Components shall be compatible with each other and with the total assembly for the intended service.
 4. Constituent parts which are similar shall be the product of a single manufacturer.
- D. Factory wiring shall be identified on the equipment being furnished and on all wiring diagrams.
- E. When Factory Testing Is Specified:
 1. The Government shall have the option of witnessing factory tests. The contractor shall notify the VA through the Contracting Officer's Technical Representative (COTR) a minimum of 15 working days prior to the manufacturers making the factory tests.
 2. Four copies of certified test reports containing all test data shall be furnished to the COTR prior to final inspection and not more than 90 days after completion of the tests.

3. When equipment fails to meet factory test and re-inspection is required, the contractor shall be liable for all additional expenses, including expenses of the Government.

1.7 EQUIPMENT REQUIREMENTS

Where variations from the contract requirements are requested in accordance with Section 00 72 00, GENERAL CONDITIONS and Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES, the connecting work and related components shall include, but not be limited to additions or changes to branch circuits, circuit protective devices, conduits, wire, feeders, controls, panels and installation methods.

1.8 EQUIPMENT PROTECTION

- A. Equipment and materials shall be protected during shipment and storage against physical damage, vermin, dirt, corrosive substances, fumes, moisture, cold and rain.
 1. Store equipment indoors in clean dry space with uniform temperature to prevent condensation. Equipment shall include but not be limited to switchgear, switchboards, panelboards, transformers, motor control centers, motor controllers, uninterruptible power systems, enclosures, controllers, circuit protective devices, cables, wire, light fixtures, electronic equipment, and accessories.
 2. During installation, equipment shall be protected against entry of foreign matter; and be vacuum-cleaned both inside and outside before testing and operating. Compressed air shall not be used to clean equipment. Remove loose packing and flammable materials from inside equipment.
 3. Damaged equipment shall be, as determined by the COTR, placed in first class operating condition or be returned to the source of supply for repair or replacement.
 4. Painted surfaces shall be protected with factory installed removable heavy kraft paper, sheet vinyl or equal.
 5. Damaged paint on equipment and materials shall be refinished with the same quality of paint and workmanship as used by the manufacturer so repaired areas are not obvious.

1.9 WORK PERFORMANCE

- A. All electrical work must comply with the requirements of NFPA 70 (NEC), NFPA 70B, NFPA 70E, OSHA Part 1910 subpart J, OSHA Part 1910 subpart S and OSHA Part 1910 subpart K in addition to other references required by contract.

- B. Job site safety and worker safety is the responsibility of the contractor.
- C. Electrical work shall be accomplished with all affected circuits or equipment de-energized. When an electrical outage cannot be accomplished in this manner for the required work, the following requirements are mandatory:
 - 1. Electricians must use full protective equipment (i.e., certified and tested insulating material to cover exposed energized electrical components, certified and tested insulated tools, etc.) while working on energized systems in accordance with NFPA 70E.
 - 2. Electricians must wear personal protective equipment while working on energized systems in accordance with NFPA 70E.
 - 3. Before initiating any work, a job specific work plan must be developed by the contractor with a peer review conducted and documented by the COTR and Medical Center staff. The work plan must include procedures to be used on and near the live electrical equipment, barriers to be installed, safety equipment to be used and exit pathways.
 - 4. Work on energized circuits or equipment cannot begin until prior written approval is obtained from the COTR.
- D. For work on existing stations, arrange, phase and perform work to assure electrical service for other buildings at all times. Refer to Article OPERATIONS AND STORAGE AREAS under Section 01 00 00, GENERAL REQUIREMENTS.
- E. New work shall be installed and connected to existing work neatly, safely and professionally. Disturbed or damaged work shall be replaced or repaired to its prior conditions, as required by Section 01 00 00, GENERAL REQUIREMENTS.
- F. Coordinate location of equipment and conduit with other trades to minimize interferences.

1.10 EQUIPMENT INSTALLATION AND REQUIREMENTS

- A. Equipment location shall be as close as practical to locations shown on the drawings.
- B. Working spaces shall not be less than specified in the NEC for all voltages specified.
- C. Inaccessible Equipment:
 - 1. Where the Government determines that the Contractor has installed equipment not conveniently accessible for operation and maintenance,

the equipment shall be removed and reinstalled as directed at no additional cost to the Government.

2. "Conveniently accessible" is defined as being capable of being reached quickly for operation, maintenance, or inspections without the use of ladders, or without climbing or crawling under or over obstacles such as, but not limited to, motors, pumps, belt guards, transformers, piping, ductwork, conduit and raceways.

1.11 EQUIPMENT IDENTIFICATION

- A. In addition to the requirements of the NEC, install an identification sign which clearly indicates information required for use and maintenance of items such as switchboards and switchgear, panelboards, cabinets, motor controllers (starters), fused and unfused safety switches, automatic transfer switches, separately enclosed circuit breakers, individual breakers and controllers in switchboards, switchgear and motor control assemblies, control devices and other significant equipment.
- B. Nameplates for Normal Power System equipment shall be laminated black phenolic resin with a white core with engraved lettering. Nameplates for Essential Electrical System (EES) equipment, as defined in the NEC, shall be laminated red phenolic resin with a white core with engraved lettering. Lettering shall be a minimum of 1/2 inch [12mm] high. Nameplates shall indicate equipment designation, rated bus amperage, voltage, number of phases, number of wires, and type of EES power branch as applicable. Secure nameplates with screws.
- C. Install adhesive arc flash warning labels on all equipment as required by NFPA 70E. Label shall indicate the arc hazard boundary (inches), working distance (inches), arc flash incident energy at the working distance (calories/cm²), required PPE category and description including the glove rating, voltage rating of the equipment, limited approach distance (inches), restricted approach distance (inches), prohibited approach distance (inches), equipment/bus name, date prepared, and manufacturer name and address.

1.12 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. The Government's approval shall be obtained for all equipment and material before delivery to the job site. Delivery, storage or

installation of equipment or material which has not had prior approval will not be permitted at the job site.

- C. All submittals shall include adequate descriptive literature, catalog cuts, shop drawings and other data necessary for the Government to ascertain that the proposed equipment and materials comply with specification requirements. Catalog cuts submitted for approval shall be legible and clearly identify equipment being submitted.
- D. Submittals for individual systems and equipment assemblies which consist of more than one item or component shall be made for the system or assembly as a whole. Partial submittals will not be considered for approval.
 - 1. Mark the submittals, "SUBMITTED UNDER SECTION_____".
 - 2. Submittals shall be marked to show specification reference including the section and paragraph numbers.
 - 3. Submit each section separately.
- E. The submittals shall include the following:
 - 1. Information that confirms compliance with contract requirements. Include the manufacturer's name, model or catalog numbers, catalog information, technical data sheets, shop drawings, pictures, nameplate data and test reports as required.
 - 2. Elementary and interconnection wiring diagrams for communication and signal systems, control systems and equipment assemblies. All terminal points and wiring shall be identified on wiring diagrams.
 - 3. Parts list which shall include those replacement parts recommended by the equipment manufacturer.
- F. Manuals: Submit in accordance with Section 01 00 00, GENERAL REQUIREMENTS.
 - 1. Maintenance and Operation Manuals: Submit as required for systems and equipment specified in the technical sections. Furnish four copies, bound in hardback binders, (manufacturer's standard binders) or an approved equivalent. Furnish one complete manual as specified in the technical section but in no case later than prior to performance of systems or equipment test, and furnish the remaining manuals prior to contract completion.
 - 2. Inscribe the following identification on the cover: the words "MAINTENANCE AND OPERATION MANUAL," the name and location of the system, equipment, building, name of Contractor, and contract number. Include in the manual the names, addresses, and telephone

- numbers of each subcontractor installing the system or equipment and the local representatives for the system or equipment.
3. Provide a "Table of Contents" and assemble the manual to conform to the table of contents, with tab sheets placed before instructions covering the subject. The instructions shall be legible and easily read, with large sheets of drawings folded in.
 4. The manuals shall include:
 - a. Internal and interconnecting wiring and control diagrams with data to explain detailed operation and control of the equipment.
 - b. A control sequence describing start-up, operation, and shutdown.
 - c. Description of the function of each principal item of equipment.
 - d. Installation instructions.
 - e. Safety precautions for operation and maintenance.
 - f. Diagrams and illustrations.
 - g. Periodic maintenance and testing procedures and frequencies, including replacement parts numbers and replacement frequencies.
 - h. Performance data.
 - i. Pictorial "exploded" parts list with part numbers. Emphasis shall be placed on the use of special tools and instruments. The list shall indicate sources of supply, recommended spare parts, and name of servicing organization.
 - j. List of factory approved or qualified permanent servicing organizations for equipment repair and periodic testing and maintenance, including addresses and factory certification qualifications.
 - G. Approvals will be based on complete submission of manuals together with shop drawings.
 - H. After approval and prior to installation, furnish the COTR with one sample of each of the following:
 1. A 300 mm (12 inch) length of each type and size of wire and cable along with the tag from the coils of reels from which the samples were taken.
 2. Each type of conduit coupling, bushing and termination fitting.
 3. Conduit hangers, clamps and supports.
 4. Duct sealing compound.
 5. Each type of receptacle, toggle switch, occupancy sensor, outlet box, manual motor starter, device wall plate, engraved nameplate,

wire and cable splicing and terminating material, and branch circuit single pole molded case circuit breaker.

1.13 SINGULAR NUMBER

Where any device or part of equipment is referred to in these specifications in the singular number (e.g., "the switch"), this reference shall be deemed to apply to as many such devices as are required to complete the installation as shown on the drawings.

1.14 ACCEPTANCE CHECKS AND TESTS

The contractor shall furnish the instruments, materials and labor for field tests.

1.15 TRAINING

- A. Training shall be provided in accordance with Article 1.25, INSTRUCTIONS, of Section 01 00 00, GENERAL REQUIREMENTS.
- B. Training shall be provided for the particular equipment or system as required in each associated specification.
- C. A training schedule shall be developed and submitted by the contractor and approved by the COTR at least 30 days prior to the planned training.

- - - E N D - - -

SECTION 26 05 21
LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES (600 VOLTS AND BELOW)

PART 1 - GENERAL

1.1 DESCRIPTION

This section specifies the furnishing, installation, and connection of the low voltage power and lighting wiring.

1.2 RELATED WORK

- A. Section 07 84 00, FIRESTOPPING: Sealing around penetrations to maintain the integrity of fire-rated construction.
- B. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: General electrical requirements that are common to more than one section.
- C. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS: Requirements for personnel safety and to provide a low impedance path for possible ground fault currents.
- D. Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS: Conduits for cables and wiring.
- E. Section 26 05 41, UNDERGROUND ELECTRICAL CONSTRUCTION: Installation of low-voltage conductors and cables in manholes and ducts.

1.3 QUALITY ASSURANCE

Refer to Paragraph, QUALIFICATIONS, in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

1.4 FACTORY TESTS

Low voltage cables shall be thoroughly tested at the factory per NEMA WC-70 to ensure that there are no electrical defects. Factory tests shall be certified.

1.5 SUBMITTALS

In accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS, submit the following:

- 1. Manufacturer's Literature and Data: Showing each cable type and rating.
- 2. Certifications: Two weeks prior to the final inspection, submit four copies of the following certifications to the COTR:
 - a. Certification by the manufacturer that the materials conform to the requirements of the drawings and specifications.
 - b. Certification by the contractor that the materials have been properly installed, connected, and tested.

1.6 APPLICABLE PUBLICATIONS

- A. Publications listed below (including amendments, addenda, revisions, supplements and errata) form a part of this specification to the extent referenced. Publications are reference in the text by designation only.
- B. American Society of Testing Material (ASTM):
 - D2301-04.....Standard Specification for Vinyl Chloride
Plastic Pressure-Sensitive Electrical
Insulating Tape
- C. National Fire Protection Association (NFPA):
 - 70-08.....National Electrical Code (NEC)
- D. National Electrical Manufacturers Association (NEMA):
 - WC 70-09.....Power Cables Rated 2000 Volts or Less for the
Distribution of Electrical Energy
- E. Underwriters Laboratories, Inc. (UL):
 - 44-05.....Thermoset-Insulated Wires and Cables
 - 83-08.....Thermoplastic-Insulated Wires and Cables
 - 467-071.....Electrical Grounding and Bonding Equipment
 - 486A-486B-03.....Wire Connectors
 - 486C-04.....Splicing Wire Connectors
 - 486D-05.....Sealed Wire Connector Systems
 - 486E-94.....Equipment Wiring Terminals for Use with
Aluminum and/or Copper Conductors
 - 493-07.....Thermoplastic-Insulated Underground Feeder and
Branch Circuit Cable
 - 514B-04.....Conduit, Tubing, and Cable Fittings
 - 1479-03.....Fire Tests of Through-Penetration Fire Stops

PART 2 - PRODUCTS

2.1 CONDUCTORS AND CABLES

- A. Conductors and cables shall be in accordance with NEMA WC-70 and as specified herein.
- B. Single Conductor:
 - 1. Shall be annealed copper.
 - 2. Shall be stranded for sizes No. 8 AWG and larger, solid for sizes No. 10 AWG and smaller.
 - 3. Shall be minimum size No. 12 AWG, except where smaller sizes are allowed herein.

C. Insulation:

1. XHHW-2 or THHN-THWN shall be in accordance with NEMA WC-70, UL 44, and UL 83.

D. Color Code:

1. Secondary service feeder and branch circuit conductors shall be color-coded as follows:

208/120 volt	Phase	480/277 volt
Black	A	Brown
Red	B	Orange
Blue	C	Yellow
White	Neutral	Gray *
* or white with colored (other than green) tracer.		

- a. Lighting circuit "switch legs" and 3-way switch "traveling wires" shall have color coding that is unique and distinct (e.g., pink and purple) from the color coding indicated above. The unique color codes shall be solid and in accordance with the NEC.
Coordinate color coding in the field with the COTR.
2. Use solid color insulation or solid color coating for No. 12 AWG and No. 10 AWG branch circuit phase, neutral, and ground conductors.
3. Conductors No. 8 AWG and larger shall be color-coded using one of the following methods:
 - a. Solid color insulation or solid color coating.
 - b. Stripes, bands, or hash marks of color specified above.
 - c. Color as specified using 0.75 in [19 mm] wide tape. Apply tape in half-overlapping turns for a minimum of 3 in [75 mm] for terminal points, and in junction boxes, pull-boxes, troughs, and manholes. Apply the last two laps of tape with no tension to prevent possible unwinding. Where cable markings are covered by tape, apply tags to cable, stating size and insulation type.
4. For modifications and additions to existing wiring systems, color coding shall conform to the existing wiring system.

2.2 SPLICES AND JOINTS

- A. In accordance with UL 486A, C, D, E, and NEC.
- B. Aboveground Circuits (No. 10 AWG and smaller):

1. Connectors: Solderless, screw-on, reusable pressure cable type, rated 600 V, 220° F [105° C], with integral insulation, approved for copper and aluminum conductors.
 2. The integral insulator shall have a skirt to completely cover the stripped wires.
 3. The number, size, and combination of conductors, as listed on the manufacturer's packaging, shall be strictly followed.
- C. Aboveground Circuits (No. 8 AWG and larger):
1. Connectors shall be indent, hex screw, or bolt clamp-type of high conductivity and corrosion-resistant material, listed for use with copper and aluminum conductors.
 2. Field-installed compression connectors for cable sizes 250 kcmil and larger shall have not fewer than two clamping elements or compression indents per wire.
 3. Insulate splices and joints with materials approved for the particular use, location, voltage, and temperature. Splice and joint insulation level shall be not less than the insulation level of the conductors being joined.
 4. Plastic electrical insulating tape: Per ASTM D2304, flame-retardant, cold and weather resistant.
- D. Underground Branch Circuits and Feeders:
1. Submersible connectors in accordance with UL 486D, rated 600 V, 190° F [90° C], with integral insulation.

2.3 CONTROL WIRING

- A. Unless otherwise specified elsewhere in these specifications, control wiring shall be as specified for power and lighting wiring, except that the minimum size shall be not less than No. 14 AWG.
- B. Control wiring shall be large enough such that the voltage drop under in-rush conditions does not adversely affect operation of the controls.

2.4 WIRE LUBRICATING COMPOUND

- A. Lubricating compound shall be suitable for the wire insulation and conduit, and shall not harden or become adhesive.

PART 3 - EXECUTION

3.1 GENERAL

- A. Install in accordance with the NEC, and as specified.
- B. Install all wiring in raceway systems.
- C. Splice cables and wires only in outlet boxes, junction boxes, pull-boxes, manholes, or handholes.

- D. Wires of different systems (e.g., 120 V, 277 V) shall not be installed in the same conduit or junction box system.
- E. Install cable supports for all vertical feeders in accordance with the NEC. Provide split wedge type which firmly clamps each individual cable and tightens due to cable weight.
- F. For panel boards, cabinets, wireways, switches, and equipment assemblies, neatly form, train, and tie the cables in individual circuits.
- G. Seal cable and wire entering a building from underground between the wire and conduit where the cable exits the conduit, with a non-hardening approved compound.
- H. Wire Pulling:
 - 1. Provide installation equipment that will prevent the cutting or abrasion of insulation during pulling of cables. Use lubricants approved for the cable.
 - 2. Use nonmetallic ropes for pulling feeders.
 - 3. Attach pulling lines for feeders by means of either woven basket grips or pulling eyes attached directly to the conductors, as approved by the COTR.
 - 4. All cables in a single conduit shall be pulled simultaneously.
 - 5. Do not exceed manufacturer's recommended maximum pulling tensions and sidewall pressure values.
- I. No more than three single-phase branch circuits shall be installed in any one conduit.

3.2 INSTALLATION IN MANHOLES

- A. Install and support cables in manholes on the steel racks with porcelain or equivalent insulators. Train the cables around the manhole walls, but do not bend to a radius less than six times the overall cable diameter.

3.3 SPLICE INSTALLATION

- A. Splices and terminations shall be mechanically and electrically secure.
- B. Tighten electrical connectors and terminals according to manufacturer's published torque values.
- C. Where the Government determines that unsatisfactory splices or terminations have been installed, remove the devices and install approved devices at no additional cost to the Government.

3.4 FEEDER IDENTIFICATION

- A. In each interior pull-box and junction box, install metal tags on all circuit cables and wires to clearly designate their circuit identification and voltage. The tags shall be the embossed brass type, 1.5 in [40 mm] in diameter and 40 mils thick. Attach tags with plastic ties.
- B. In each manhole and handhole, provide tags of the embossed brass type, showing the circuit identification and voltage. The tags shall be the embossed brass type, 1.5 in [40 mm] in diameter and 40 mils thick. Attach tags with plastic ties.

3.5 EXISTING WIRING

Unless specifically indicated on the plans, existing wiring shall not be reused for a new installation.

3.6 CONTROL AND SIGNAL WIRING INSTALLATION

- A. Unless otherwise specified in other sections, install wiring and connect to equipment/devices to perform the required functions as shown and specified.
- B. Except where otherwise required, install a separate power supply circuit for each system so that malfunctions in any system will not affect other systems.
- C. Where separate power supply circuits are not shown, connect the systems to the nearest panel boards of suitable voltages, which are intended to supply such systems and have suitable spare circuit breakers or space for installation.

3.7 CONTROL AND SIGNAL SYSTEM WIRING IDENTIFICATION

- A. Install a permanent wire marker on each wire at each termination.
- B. Identifying numbers and letters on the wire markers shall correspond to those on the wiring diagrams used for installing the systems.
- C. Wire markers shall retain their markings after cleaning.
- D. In each manhole and handhole, install embossed brass tags to identify the system served and function.

3.8 ACCEPTANCE CHECKS AND TESTS

- A. Feeders and branch circuits shall have their insulation tested after installation and before connection to utilization devices, such as fixtures, motors, or appliances. Test each conductor with respect to adjacent conductors and to ground. Existing conductors to be reused shall also be tested.

- B. Applied voltage shall be 500VDC for 300-volt rated cable, and 1000VDC for 600-volt rated cable. Apply test for one minute or until reading is constant for 15 seconds, whichever is longer. Minimum insulation resistance values shall not be less than 25 megohms for 300-volt rated cable and 100 megohms for 600-volt rated cable.
- C. Perform phase rotation test on all three-phase circuits.
- D. The contractor shall furnish the instruments, materials, and labor for all tests.

- - - E N D - - -

SECTION 26 05 26
GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This section specifies the general grounding and bonding requirements for electrical equipment and operations to provide a low impedance path for possible ground fault currents.
- B. "Grounding electrode system" refers to all electrodes required by NEC, as well as made, supplementary, and lightning protection system grounding electrodes.
- C. The terms "connect" and "bond" are used interchangeably in this specification and have the same meaning.

1.2 RELATED WORK

- A. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: General electrical requirements and items that are common to more than one section of Division 26.
- B. Section 26 05 21, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES (600 VOLTS AND BELOW): Low Voltage power and lighting wiring.
- C. Section 26 22 00, LOW-VOLTAGE TRANSFORMERS: Low voltage transformers.
- D. Section 26 24 11, DISTRIBUTION SWITCHBOARDS: Low voltage distribution switchboards.
- E. Section 26 24 16, PANELBOARDS: Low voltage panelboards.
- F. Section 26 41 00, FACILITY LIGHTNING PROTECTION: Requirements for lightning protection.

1.3 QUALITY ASSURANCE

Refer to Paragraph, QUALIFICATIONS, in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

1.4 SUBMITTALS

- A. Submit in accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
- B. Shop Drawings:
 - 1. Clearly present enough information to determine compliance with drawings and specifications.
 - 2. Include the location of system grounding electrode connections and the routing of aboveground and underground grounding electrode conductors.
- C. Test Reports: Provide certified test reports of ground resistance.

D. Certifications: Two weeks prior to final inspection, submit four copies of the following to the COTR:

1. Certification that the materials and installation are in accordance with the drawings and specifications.
2. Certification by the contractor that the complete installation has been properly installed and tested.

1.5 APPLICABLE PUBLICATIONS

Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by designation only.

A. American Society for Testing and Materials (ASTM):

B1-07.....Standard Specification for Hard-Drawn Copper Wire

B3-07.....Standard Specification for Soft or Annealed Copper Wire

B8-04.....Standard Specification for Concentric-Lay-Stranded Copper Conductors, Hard, Medium-Hard, or Soft

B. Institute of Electrical and Electronics Engineers, Inc. (IEEE):

81-1983.....IEEE Guide for Measuring Earth Resistivity, Ground Impedance, and Earth Surface Potentials of a Ground System

C2-07.....National Electrical Safety Code

C. National Fire Protection Association (NFPA):

70-08.....National Electrical Code (NEC)

99-2005.....Health Care Facilities

D. Underwriters Laboratories, Inc. (UL):

44-05Thermoset-Insulated Wires and Cables

83-08Thermoplastic-Insulated Wires and Cables

467-07Grounding and Bonding Equipment

486A-486B-03Wire Connectors

PART 2 - PRODUCTS

2.1 GROUNDING AND BONDING CONDUCTORS

A. Equipment grounding conductors shall be UL 44 or UL 83 insulated stranded copper, except that sizes No. 10 AWG [6 mm²] and smaller shall be solid copper. Insulation color shall be continuous green for all

equipment grounding conductors, except that wire sizes No. 4 AWG [25 mm²] and larger shall be identified per NEC.

- B. Bonding conductors shall be ASTM B8 bare stranded copper, except that sizes No. 10 AWG [6 mm²] and smaller shall be ASTM B1 solid bare copper wire.
- C. Conductor sizes shall not be less than shown on the drawings, or not less than required by the NEC, whichever is greater.

2.2 GROUND RODS

- A. Steel or copper clad steel, 0.75 in [19 mm] diameter by 10 ft [30 M] long, conforming to UL 467.
- B. Quantity of rods shall be as required to obtain the specified ground resistance, as shown on the drawings.

2.3 CONCRETE ENCASED ELECTRODE

Concrete encased electrode shall be No. 4 AWG bare copper wire, installed per NEC.

2.4 MEDIUM VOLTAGE SPLICES AND TERMINATIONS

Components shall meet or exceed UL 467 and be clearly marked with the manufacturer, catalog number, and permitted conductor size(s).

2.5 GROUND CONNECTIONS

- A. Below Grade: Exothermic-welded type connectors.
- B. Above Grade:
 - 1. Bonding Jumpers: Compression-type connectors, using zinc-plated fasteners and external tooth lockwashers.
 - 2. Connection to Building Steel: Exothermic-welded type connectors.
 - 3. Ground Busbars: Two-hole compression type lugs, using tin-plated copper or copper alloy bolts and nuts.
 - 4. Rack and Cabinet Ground Bars: One-hole compression-type lugs, using zinc-plated or copper alloy fasteners.

2.6 EQUIPMENT RACK AND CABINET GROUND BARS

Provide solid copper ground bars designed for mounting on the framework of open or cabinet-enclosed equipment racks with minimum dimensions of 0.375 in [4 mm] thick x 0.75 in [19 mm] wide.

2.7 GROUND TERMINAL BLOCKS

At any equipment mounting location (e.g., backboards and hinged cover enclosures) where rack-type ground bars cannot be mounted, provide screw lug-type terminal blocks.

2.8 GROUNDING BUS

Pre-drilled rectangular copper bar with stand-off insulators, minimum 0.25 in [6.3 mm] thick x 4 in [100 mm] high in cross-section, length as shown on drawings, with 0.281 in [7.1 mm] holes spaced 1.125 in [28 mm] apart.

PART 3 - EXECUTION**3.1 GENERAL**

- A. Ground in accordance with the NEC, as shown on drawings, and as specified herein.
- B. System Grounding:
 - 1. Secondary service neutrals: Ground at the supply side of the secondary disconnecting means and at the related transformers.
 - 2. Separately derived systems (transformers downstream from the service entrance): Ground the secondary neutral.
- C. Equipment Grounding: Metallic structures, including ductwork and building steel, enclosures, raceways, junction boxes, outlet boxes, cabinets, machine frames, and other conductive items in close proximity with electrical circuits, shall be bonded and grounded.
- D. Special Grounding: For patient care area electrical power system grounding, conform to NFPA 99 and NEC.

3.2 INACCESSIBLE GROUNDING CONNECTIONS

Make grounding connections, which are normally buried or otherwise inaccessible (except connections for which access for periodic testing is required), by exothermic weld.

3.3 SECONDARY VOLTAGE EQUIPMENT AND CIRCUITS

- A. Main Bonding Jumper: Bond the secondary service neutral to the ground bus in the service equipment.
- B. Metallic Piping, Building Steel, and Supplemental Electrode(s):
 - 1. Provide a grounding electrode conductor sized per NEC between the service equipment ground bus and all metallic water pipe systems, building steel, and supplemental or made electrodes. Provide jumper insulating joints in the metallic piping. All connections to electrodes shall be made with fittings that conform to UL 467.
 - 2. Provide a supplemental ground electrode and bond to the grounding electrode system.
- C. Service Disconnect (Separate Individual Enclosure): Provide a ground bar bolted to the enclosure with lugs for connecting the various grounding conductors.

D. Distribution Panels and Panelboards:

1. Connect the various feeder equipment grounding conductors to the ground bus in the enclosure with suitable pressure connectors.
2. For service entrance equipment, connect the grounding electrode conductor to the ground bus.
3. Provide ground bars, bolted to the housing, with sufficient lugs to terminate the equipment grounding conductors.
4. Connect metallic conduits that terminate without mechanical connection to the housing, by grounding bushings and grounding conductor to the equipment ground bus.

E. Transformers:

1. Exterior: Exterior transformers supplying interior service equipment shall have the neutral grounded at the transformer secondary. Provide a grounding electrode at the transformer.
2. Separately derived systems (transformers downstream from service equipment): Ground the secondary neutral at the transformer. Provide a grounding electrode conductor from the transformer to the nearest component of the grounding electrode system.

3.5 RACEWAY

A. Conduit Systems:

1. Ground all metallic conduit systems. All metallic conduit systems shall contain an equipment grounding conductor.
2. Non-metallic conduit systems, except non-metallic feeder conduits that carry a grounded conductor from exterior transformers to interior or building-mounted service entrance equipment, shall contain an equipment grounding conductor.
3. Conduit that only contains a grounding conductor, and is provided for its mechanical protection, shall be bonded to that conductor at the entrance and exit from the conduit.
4. Metallic conduits which terminate without mechanical connection to an electrical equipment housing by means of locknut and bushings or adapters, shall be provided with grounding bushings. Connect bushings with a bare grounding conductor to the equipment ground bus.

B. Feeders and Branch Circuits: Install equipment grounding conductors with all feeders and power and lighting branch circuits.

C. Boxes, Cabinets, Enclosures, and Panelboards:

1. Bond the equipment grounding conductor to each pullbox, junction box, outlet box, device box, cabinets, and other enclosures through which the conductor passes (except for special grounding systems for intensive care units and other critical units shown).
 2. Provide lugs in each box and enclosure for equipment grounding conductor termination.
- D. Wireway Systems:
1. Bond the metallic structures of wireway to provide 100% electrical continuity throughout the wireway system, by connecting a No. 6 AWG [16 mm²] bonding jumper at all intermediate metallic enclosures and across all section junctions.
 2. Install insulated No. 6 AWG [16 mm²] bonding jumpers between the wireway system, bonded as required above, and the closest building ground at each end and approximately every 50 ft [16 M].
 3. Use insulated No. 6 AWG [16 mm²] bonding jumpers to ground or bond metallic wireway at each end for all intermediate metallic enclosures and across all section junctions.
 4. Use insulated No. 6 AWG [16 mm²] bonding jumpers to ground cable tray to column-mounted building ground plates (pads) at each end and approximately every 49 ft [15 M].
- E. Receptacles shall not be grounded through their mounting screws. Ground receptacles with a jumper from the receptacle green ground terminal to the device box ground screw and a jumper to the branch circuit equipment grounding conductor.
- F. Ground lighting fixtures to the equipment grounding conductor of the wiring system when the green ground is provided; otherwise, ground the fixtures through the conduit systems. Fixtures connected with flexible conduit shall have a green ground wire included with the power wires from the fixture through the flexible conduit to the first outlet box.
- G. Fixed electrical appliances and equipment shall be provided with a ground lug for termination of the equipment grounding conductor.
- H. Panelboard Bonding in Patient Care Areas: The equipment grounding terminal buses of the normal and essential branch circuit panel boards serving the same individual patient vicinity shall be bonded together with an insulated continuous copper conductor not less than No. 10 AWG [16 mm²]. These conductors shall be installed in rigid metal conduit.

3.6 CORROSION INHIBITORS

When making ground and ground bonding connections, apply a corrosion inhibitor to all contact surfaces. Use corrosion inhibitor appropriate for protecting a connection between the metals used.

3.7 CONDUCTIVE PIPING

- A. Bond all conductive piping systems, interior and exterior, to the grounding electrode system. Bonding connections shall be made as close as practical to the equipment ground bus.
- B. In operating rooms and at intensive care and coronary care type beds, bond the gases and suction piping at the outlets directly to the room or patient ground bus.

3.8 LIGHTNING PROTECTION SYSTEM

Bond the lightning protection system to the electrical grounding electrode system.

3.9 ELECTRICAL ROOM GROUNDING

Building Earth Ground Busbars: Provide ground busbar and mounting hardware at each electrical room and connect to pigtail extensions of the building grounding ring.

3.10 EXTERIOR LIGHT POLES

Provide 20 ft [6.1 M] of No. 4 bare copper coiled at bottom of pole base excavation prior to pour, plus additional unspliced length in and above foundation as required to reach pole ground stud.

3.11 GROUND RESISTANCE

- A. Grounding system resistance to ground shall not exceed 5 ohms. Make any modifications or additions to the grounding electrode system necessary for compliance without additional cost to the Government. Final tests shall ensure that this requirement is met.
- B. Resistance of the grounding electrode system shall be measured using a four-terminal fall-of-potential method as defined in IEEE 81. Ground resistance measurements shall be made before the electrical distribution system is energized and shall be made in normally dry conditions not fewer than 48 hours after the last rainfall. Resistance measurements of separate grounding electrode systems shall be made before the systems are bonded together below grade. The combined resistance of separate systems may be used to meet the required resistance, but the specified number of electrodes must still be provided.

- C. Services at power company interface points shall comply with the power company ground resistance requirements.
- D. Below-grade connections shall be visually inspected by the COTR prior to backfilling. The contractor shall notify the COTR 24 hours before the connections are ready for inspection.

3.12 GROUND ROD INSTALLATION

- A. For outdoor installations, drive each rod vertically in the earth, until top of rod is 24 in [609 mm] below final grade.
- B. For indoor installations, leave 4 in [100 mm] of rod exposed.
- C. Where permanently concealed ground connections are required, make the connections by the exothermic process, to form solid metal joints. Make accessible ground connections with mechanical pressure-type ground connectors.
- D. Where rock prevents the driving of vertical ground rods, install angled ground rods or grounding electrodes in horizontal trenches to achieve the specified resistance.

- - - E N D - - -

SECTION 26 05 33
RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This section specifies the furnishing, installation, and connection of conduit, fittings, and boxes, to form complete, coordinated, grounded raceway systems. Raceways are required for all wiring unless shown or specified otherwise.
- B. Definitions: The term conduit, as used in this specification, shall mean any or all of the raceway types specified.

1.2 RELATED WORK

- A. Section 06 10 00, ROUGH CARPENTRY: Mounting board for telephone closets.
- B. Section 07 60 00, FLASHING AND SHEET METAL: Fabrications for the deflection of water away from the building envelope at penetrations.
- C. Section 07 84 00, FIRESTOPPING: Sealing around penetrations to maintain the integrity of fire rated construction.
- D. Section 07 92 00, JOINT SEALANTS: Sealing around conduit penetrations through the building envelope to prevent moisture migration into the building.
- E. Section 09 91 00, PAINTING: Identification and painting of conduit and other devices.
- F. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: General electrical requirements and items that are common to more than one section of Division 26.
- G. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS: Requirements for personnel safety and to provide a low impedance path for possible ground fault currents.
- H. Section 26 05 41, UNDERGROUND ELECTRICAL CONSTRUCTION: Underground conduits.
- I. Section 31 20 00, EARTH MOVING: Bedding of conduits.

1.3 QUALITY ASSURANCE

Refer to Paragraph, QUALIFICATIONS, in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

1.4 SUBMITTALS

In accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS, submit the following:

- A. Manufacturer's Literature and Data: Showing each cable type and rating. The specific item proposed and its area of application shall be identified on the catalog cuts.
- B. Shop Drawings:
 - 1. Size and location of main feeders.
 - 2. Size and location of panels and pull-boxes.
 - 3. Layout of required conduit penetrations through structural elements.
- C. Certifications:
 - 1. Two weeks prior to the final inspection, submit four copies of the following certifications to the Contracting Officer's Technical Representative (COTR):
 - a. Certification by the manufacturer that the material conforms to the requirements of the drawings and specifications.
 - b. Certification by the contractor that the material has been properly installed.

1.5 APPLICABLE PUBLICATIONS

- A. Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by designation only.
- B. American National Standards Institute (ANSI):
 - C80.1-05.....Electrical Rigid Steel Conduit
 - C80.3-05.....Steel Electrical Metal Tubing
 - C80.6-05.....Electrical Intermediate Metal Conduit
- C. National Fire Protection Association (NFPA):
 - 70-08.....National Electrical Code (NEC)
- D. Underwriters Laboratories, Inc. (UL):
 - 1-05.....Flexible Metal Conduit
 - 5-04.....Surface Metal Raceway and Fittings
 - 6-07.....Electrical Rigid Metal Conduit - Steel
 - 50-95.....Enclosures for Electrical Equipment
 - 360-093.....Liquid-Tight Flexible Steel Conduit
 - 467-07.....Grounding and Bonding Equipment
 - 514A-04.....Metallic Outlet Boxes
 - 514B-04.....Conduit, Tubing, and Cable Fittings
 - 514C-96.....Nonmetallic Outlet Boxes, Flush-Device Boxes and Covers

- 651-05.....Schedule 40 and 80 Rigid PVC Conduit and Fittings
- 651A-00.....Type EB and A Rigid PVC Conduit and HDPE Conduit
- 797-07.....Electrical Metallic Tubing
- 1242-06.....Electrical Intermediate Metal Conduit - Steel
- E. National Electrical Manufacturers Association (NEMA):
 - TC-2-03.....Electrical Polyvinyl Chloride (PVC) Tubing and Conduit
 - TC-3-04.....PVC Fittings for Use with Rigid PVC Conduit and Tubing
 - FB1-07.....Fittings, Cast Metal Boxes and Conduit Bodies for Conduit, Electrical Metallic Tubing and Cable

PART 2 - PRODUCTS

2.1 MATERIAL

- A. Conduit Size: In accordance with the NEC, but not less than 0.5 in [13 mm] unless otherwise shown. Where permitted by the NEC, 0.5 in [13 mm] flexible conduit may be used for tap connections to recessed lighting fixtures.
- B. Conduit:
 - 1. Rigid steel: Shall conform to UL 6 and ANSI C80.1.
 - 2. Rigid intermediate steel conduit (IMC): Shall conform to UL 1242 and ANSI C80.6.
 - 3. Electrical metallic tubing (EMT): Shall conform to UL 797 and ANSI C80.3. Maximum size not to exceed 4 in [105 mm] and shall be permitted only with cable rated 600 V or less.
 - 4. Flexible galvanized steel conduit: Shall conform to UL 1.
 - 5. Liquid-tight flexible metal conduit: Shall conform to UL 360.
 - 6. Direct burial plastic conduit: Shall conform to UL 651 and UL 651A, heavy wall PVC or high density polyethylene (PE).
 - 7. Surface metal raceway: Shall conform to UL 5.
- C. Conduit Fittings:
 - 1. Rigid steel and IMC conduit fittings:
 - a. Fittings shall meet the requirements of UL 514B and NEMA FB1.
 - b. Standard threaded couplings, locknuts, bushings, conduit bodies, and elbows: Only steel or malleable iron materials are

acceptable. Integral retractable type IMC couplings are also acceptable.

- c. Locknuts: Bonding type with sharp edges for digging into the metal wall of an enclosure.
 - d. Bushings: Metallic insulating type, consisting of an insulating insert, molded or locked into the metallic body of the fitting. Bushings made entirely of metal or nonmetallic material are not permitted.
 - e. Erickson (union-type) and set screw type couplings: Approved for use in concrete are permitted for use to complete a conduit run where conduit is installed in concrete. Use set screws of case-hardened steel with hex head and cup point to firmly seat in conduit wall for positive ground. Tightening of set screws with pliers is prohibited.
 - f. Sealing fittings: Threaded cast iron type. Use continuous drain-type sealing fittings to prevent passage of water vapor. In concealed work, install fittings in flush steel boxes with blank cover plates having the same finishes as that of other electrical plates in the room.
2. Electrical metallic tubing fittings:
- a. Fittings and conduit bodies shall meet the requirements of UL 514B, ANSI C80.3, and NEMA FB1.
 - b. Only steel or malleable iron materials are acceptable.
 - c. Compression couplings and connectors: Concrete-tight and rain-tight, with connectors having insulated throats.
 - d. Indent-type connectors or couplings are prohibited.
 - e. Die-cast or pressure-cast zinc-alloy fittings or fittings made of "pot metal" are prohibited.
3. Flexible steel conduit fittings:
- a. Conform to UL 514B. Only steel or malleable iron materials are acceptable.
 - b. Clamp-type, with insulated throat.
4. Liquid-tight flexible metal conduit fittings:
- a. Fittings shall meet the requirements of UL 514B and NEMA FB1.
 - b. Only steel or malleable iron materials are acceptable.
 - c. Fittings must incorporate a threaded grounding cone, a steel or plastic compression ring, and a gland for tightening. Connectors shall have insulated throats.

5. Direct burial plastic conduit fittings:

Fittings shall meet the requirements of UL 514C and NEMA TC3.
6. Surface metal raceway fittings: As recommended by the raceway manufacturer. Include couplings, offsets, elbows, expansion joints, adapters, hold-down straps, end caps, conduit entry fittings, accessories, and other fittings as required for complete system.
7. Expansion and deflection couplings:
 - a. Conform to UL 467 and UL 514B.
 - b. Accommodate a 0.75 in [19 mm] deflection, expansion, or contraction in any direction, and allow 30 degree angular deflections.
 - c. Include internal flexible metal braid, sized to guarantee conduit ground continuity and a low-impedance path for fault currents, in accordance with UL 467 and the NEC tables for equipment grounding conductors.
 - d. Jacket: Flexible, corrosion-resistant, watertight, moisture and heat-resistant molded rubber material with stainless steel jacket clamps.
- D. Conduit Supports:
 1. Parts and hardware: Zinc-coat or provide equivalent corrosion protection.
 2. Individual Conduit Hangers: Designed for the purpose, having a pre-assembled closure bolt and nut, and provisions for receiving a hanger rod.
 3. Multiple conduit (trapeze) hangers: Not less than 1.5 x 1.5 in [38 mm x 38 mm], 12-gauge steel, cold-formed, lipped channels; with not less than 0.375 in [9 mm] diameter steel hanger rods.
 4. Solid Masonry and Concrete Anchors: Self-drilling expansion shields, or machine bolt expansion.
- E. Outlet, Junction, and Pull Boxes:
 1. UL-50 and UL-514A.
 2. Cast metal where required by the NEC or shown, and equipped with rustproof boxes.
 3. Sheet metal boxes: Galvanized steel, except where otherwise shown.
 4. Flush-mounted wall or ceiling boxes shall be installed with raised covers so that the front face of raised cover is flush with the wall. Surface-mounted wall or ceiling boxes shall be installed with surface-style flat or raised covers.

- F. Wireways: Equip with hinged covers, except where removable covers are shown. Include couplings, offsets, elbows, expansion joints, adapters, hold-down straps, end caps, and other fittings to match and mate with wireways as required for a complete system.

PART 3 - EXECUTION

3.1 PENETRATIONS

- A. Cutting or Holes:
 - 1. Cut holes in advance where they should be placed in the structural elements, such as ribs or beams. Obtain the approval of the COTR prior to drilling through structural elements.
 - 2. Cut holes through concrete and masonry in new and existing structures with a diamond core drill or concrete saw. Pneumatic hammers, impact electric, hand, or manual hammer-type drills are not allowed, except where permitted by the COTR as required by limited working space.
- B. Firestop: Where conduits, wireways, and other electrical raceways pass through fire partitions, fire walls, smoke partitions, or floors, install a fire stop that provides an effective barrier against the spread of fire, smoke and gases as specified in Section 07 84 00, FIRESTOPPING.
- C. Waterproofing: At floor, exterior wall, and roof conduit penetrations, completely seal clearances around the conduit and make watertight, as specified in Section 07 92 00, JOINT SEALANTS.

3.2 INSTALLATION, GENERAL

- A. In accordance with UL, NEC, as shown, and as specified herein.
- B. Essential (Emergency) raceway systems shall be entirely independent of other raceway systems, except where shown on drawings.
- C. Install conduit as follows:
 - 1. In complete mechanically and electrically continuous runs before pulling in cables or wires.
 - 2. Unless otherwise indicated on the drawings or specified herein, installation of all conduits shall be concealed within finished walls, floors, and ceilings.
 - 3. Flattened, dented, or deformed conduit is not permitted. Remove and replace the damaged conduits with new undamaged material.
 - 4. Assure conduit installation does not encroach into the ceiling height head room, walkways, or doorways.
 - 5. Cut square, ream, remove burrs, and draw up tight.

6. Independently support conduit at 8 ft [2.4 M] on centers. Do not use other supports, i.e., suspended ceilings, suspended ceiling supporting members, lighting fixtures, conduits, mechanical piping, or mechanical ducts.
 7. Support within 12 in [300 mm] of changes of direction, and within 12 in [300 mm] of each enclosure to which connected.
 8. Close ends of empty conduit with plugs or caps at the rough-in stage until wires are pulled in, to prevent entry of debris.
 9. Conduit installations under fume and vent hoods are prohibited.
 10. Secure conduits to cabinets, junction boxes, pull-boxes, and outlet boxes with bonding type locknuts. For rigid and IMC conduit installations, provide a locknut on the inside of the enclosure, made up wrench tight. Do not make conduit connections to junction box covers.
 11. Flashing of penetrations of the roof membrane is specified in Section 07 60 00, FLASHING AND SHEET METAL.
 12. Conduit bodies shall only be used for changes in direction, and shall not contain splices.
- D. Conduit Bends:
1. Make bends with standard conduit bending machines.
 2. Conduit hickey may be used for slight offsets and for straightening stubbed out conduits.
 3. Bending of conduits with a pipe tee or vise is prohibited.
- E. Layout and Homeruns:
1. Install conduit with wiring, including homeruns, as shown on drawings.
 2. Deviations: Make only where necessary to avoid interferences and only after drawings showing the proposed deviations have been submitted approved by the COTR.

3.3 CONCEALED WORK INSTALLATION

- A. In Concrete:
1. Conduit: Rigid steel, IMC, or EMT. Do not install EMT in concrete slabs that are in contact with soil, gravel, or vapor barriers.
 2. Align and run conduit in direct lines.
 3. Install conduit through concrete beams only:
 - a. Where shown on the structural drawings.

- b. As approved by the COTR prior to construction, and after submittal of drawing showing location, size, and position of each penetration.
- 4. Installation of conduit in concrete that is less than 3 in [75 mm] thick is prohibited.
 - a. Conduit outside diameter larger than one-third of the slab thickness is prohibited.
 - b. Space between conduits in slabs: Approximately six conduit diameters apart, and one conduit diameter at conduit crossings.
 - c. Install conduits approximately in the center of the slab so that there will be a minimum of 0.75 in [19 mm] of concrete around the conduits.
- 5. Make couplings and connections watertight. Use thread compounds that are UL approved conductive type to ensure low resistance ground continuity through the conduits. Tightening setscrews with pliers is prohibited.
- B. Above Furred or Suspended Ceilings and in Walls:
 - 1. Conduit for conductors 600 V and below: Rigid steel, IMC, or EMT. Mixing different types of conduits indiscriminately in the same system is prohibited.
 - 2. Align and run conduit parallel or perpendicular to the building lines.
 - 3. Connect recessed lighting fixtures to conduit runs with maximum 6 ft [1.8 M] of flexible metal conduit extending from a junction box to the fixture.
 - 4. Tightening setscrews with pliers is prohibited.

3.4 EXPOSED WORK INSTALLATION

- A. Unless otherwise indicated on the drawings, exposed conduit is only permitted in mechanical and electrical rooms.
- B. Conduit for Conductors 600 V and Below: Rigid steel, IMC, or EMT. Mixing different types of conduits indiscriminately in the system is prohibited.
- C. Align and run conduit parallel or perpendicular to the building lines.
- D. Install horizontal runs close to the ceiling or beams and secure with conduit straps.
- E. Support horizontal or vertical runs at not over 8 ft [2.4 M] intervals.
- F. Surface metal raceways: Use only where shown.

G. Painting:

1. Paint exposed conduit as specified in Section 09 91 00, PAINTING.
2. Paint all conduits containing cables rated over 600 V safety orange. Refer to Section 09 91 00, PAINTING for preparation, paint type, and exact color. In addition, paint legends, using 2 in [50 mm] high black numerals and letters, showing the cable voltage rating. Provide legends where conduits pass through walls and floors and at maximum 20 ft [6 M] intervals in between.

3.5 DIRECT BURIAL INSTALLATION

Refer to Section 26 05 41, UNDERGROUND ELECTRICAL CONSTRUCTION.

3.6 HAZARDOUS LOCATIONS

- A. Use rigid steel conduit only, notwithstanding requirements otherwise specified in this or other sections of these specifications.
- B. Install UL approved sealing fittings that prevent passage of explosive vapors in hazardous areas equipped with explosion-proof lighting fixtures, switches, and receptacles, as required by the NEC.

3.7 WET OR DAMP LOCATIONS

- A. Unless otherwise shown, use conduits of rigid steel or IMC.
- B. Provide sealing fittings to prevent passage of water vapor where conduits pass from warm to cold locations, i.e., refrigerated spaces, constant-temperature rooms, air-conditioned spaces, building exterior walls, roofs, or similar spaces.
- C. Unless otherwise shown, use rigid steel or IMC conduit within 5 ft [1.5 M] of the exterior and below concrete building slabs in contact with soil, gravel, or vapor barriers. Conduit shall be half-lapped with 10 mil PVC tape before installation. After installation, completely recoat or retape any damaged areas of coating.

3.8 MOTORS AND VIBRATING EQUIPMENT

- A. Use flexible metal conduit for connections to motors and other electrical equipment subject to movement, vibration, misalignment, cramped quarters, or noise transmission.
- B. Use liquid-tight flexible metal conduit for installation in exterior locations, moisture or humidity laden atmosphere, corrosive atmosphere, water or spray wash-down operations, inside airstream of HVAC units, and locations subject to seepage or dripping of oil, grease, or water. Provide a green equipment grounding conductor with flexible metal conduit.

3.9 EXPANSION JOINTS

- A. Conduits 3 in [75 mm] and larger that are secured to the building structure on opposite sides of a building expansion joint require expansion and deflection couplings. Install the couplings in accordance with the manufacturer's recommendations.
- B. Provide conduits smaller than 3 in [75 mm] with junction boxes on both sides of the expansion joint. Connect conduits to junction boxes with sufficient slack of flexible conduit to produce 5 in [125 mm] vertical drop midway between the ends. Flexible conduit shall have a bonding jumper installed. In lieu of this flexible conduit, expansion and deflection couplings as specified above for conduits 15 in [375 mm] and larger are acceptable.
- C. Install expansion and deflection couplings where shown.

3.10 CONDUIT SUPPORTS, INSTALLATION

- A. Safe working load shall not exceed one-quarter of proof test load of fastening devices.
- B. Use pipe straps or individual conduit hangers for supporting individual conduits.
- C. Support multiple conduit runs with trapeze hangers. Use trapeze hangers that are designed to support a load equal to or greater than the sum of the weights of the conduits, wires, hanger itself, and 200 lbs [90 kg]. Attach each conduit with U-bolts or other approved fasteners.
- D. Support conduit independently of junction boxes, pull-boxes, fixtures, suspended ceiling T-bars, angle supports, and similar items.
- E. Fasteners and Supports in Solid Masonry and Concrete:
 - 1. New Construction: Use steel or malleable iron concrete inserts set in place prior to placing the concrete.
 - 2. Existing Construction:
 - a. Steel expansion anchors not less than 0.25 in [6 mm] bolt size and not less than 1.125 in [28 mm] embedment.
 - b. Power set fasteners not less than 0.25 in [6 mm] diameter with depth of penetration not less than 3 in [75 mm].
 - c. Use vibration and shock-resistant anchors and fasteners for attaching to concrete ceilings.
- F. Hollow Masonry: Toggle bolts.
- G. Bolts supported only by plaster or gypsum wallboard are not acceptable.
- H. Metal Structures: Use machine screw fasteners or other devices specifically designed and approved for the application.

- I. Attachment by wood plugs, rawl plug, plastic, lead or soft metal anchors, or wood blocking and bolts supported only by plaster is prohibited.
- J. Chain, wire, or perforated strap shall not be used to support or fasten conduit.
- K. Spring steel type supports or fasteners are prohibited for all uses except horizontal and vertical supports/fasteners within walls.
- L. Vertical Supports: Vertical conduit runs shall have riser clamps and supports in accordance with the NEC and as shown. Provide supports for cable and wire with fittings that include internal wedges and retaining collars.

3.11 BOX INSTALLATION

- A. Boxes for Concealed Conduits:
 - 1. Flush-mounted.
 - 2. Provide raised covers for boxes to suit the wall or ceiling, construction, and finish.
- B. In addition to boxes shown, install additional boxes where needed to prevent damage to cables and wires during pulling-in operations.
- C. Remove only knockouts as required and plug unused openings. Use threaded plugs for cast metal boxes and snap-in metal covers for sheet metal boxes.
- D. Outlet boxes mounted back-to-back in the same wall are prohibited. A minimum 24 in [600 mm] center-to-center lateral spacing shall be maintained between boxes.
- E. Minimum size of outlet boxes for ground fault interrupter (GFI) receptacles is 4 in [100 mm] square x 2.125 in [55 mm] deep, with device covers for the wall material and thickness involved.
- F. Stencil or install phenolic nameplates on covers of the boxes identified on riser diagrams; for example "SIG-FA JB No. 1."
- G. On all branch circuit junction box covers, identify the circuits with black marker.

- - - E N D - - -

SECTION 26 05 41
UNDERGROUND ELECTRICAL CONSTRUCTION

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This section specifies the furnishing, installation, and connection of precast manholes and pullboxes with ducts to form a complete underground raceway system.
- B. "Duct" and "conduit," and "rigid metal conduit" and "rigid steel conduit" are used interchangeably in this specification.

1.2 RELATED WORK

- A. Section 07 92 00, JOINT SEALANTS: Sealing of conduit penetrations.
- B. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: General electrical requirements and items that are common to more than one section of Division 26.
- C. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS: Requirements for personnel safety and to provide a low impedance path for possible ground fault currents.
- D. Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS: Conduits, fittings and boxes for raceway systems.
- E. Section 31 20 00, EARTH MOVING: Trenching, backfill and compaction.

1.3 QUALITY ASSURANCE

- A. Refer to Paragraph, QUALIFICATIONS, in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
- B. Coordinate layout and installation of ducts, manholes, pullboxes, and pull-boxes with final arrangement of other utilities, site grading, and surface features, as determined in the field.

1.4 SUBMITTALS

- A. Submit in accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
- B. Shop Drawings:
 - 1. Clearly present sufficient information to determine compliance with drawings and specifications.
 - 2. Include manholes, pullboxes, duct materials, and hardware. Submit plan and elevation drawings, showing openings, pulling irons, cable supports, cover, ladder, sump, and other accessories and details.
 - 3. Proposed deviations from details on the drawings shall be clearly marked on the submittals. If it is necessary to locate manholes or

pullboxes at locations other than shown on the drawings, show the proposed locations accurately on scaled site drawings, and submit four copies to the Contracting Officer's Technical Representative (COTR) for approval prior to construction.

- C. Certifications: Two weeks prior to the final inspection, submit four copies of the following certifications to the COTR:
1. Certification by the manufacturer that the materials conform to the requirements of the drawings and specifications.
 2. Certification by the contractor that the materials have been properly installed, connected, and tested.

1.5 APPLICABLE PUBLICATIONS

- A. Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by designation only.
- B. American Concrete Institute (ACI):
- Building Code Requirements for Structural Concrete
318/318M-05.....Building Code Requirements for Structural
Concrete & Commentary
SP-66-04.....ACI Detailing Manual
- C. American National Standards Institute (ANSI):
- 77-07.....Underground Enclosure Integrity
- D. American Society for Testing and Materials (ASTM):
- C478-09.....Standard Specification for Precast Reinforced
Concrete Manhole Sections
C858-09.....Underground Precast Concrete Utility Structures
C990-09.....Standard Specification for Joints for Concrete
Pipe, Manholes and Precast Box Sections Using
Preformed Flexible Joint Sealants.
- E. Institute of Electrical and Electronic Engineers (IEEE):
- C2-07National Electrical Safety Code
- F. National Electrical Manufacturers Association (NEMA):
- TC 2-03.....Electrical Polyvinyl Chloride (PVC) Tubing And
Conduit
TC 3-2004.....PVC Fittings for Use With Rigid PVC Conduit And
Tubing
TC 6 & 8 2003.....PVC Plastic Utilities Duct For Underground
Installations

- TC 9-2004.....Fittings For PVC Plastic Utilities Duct For
Underground Installation
- G. National Fire Protection Association (NFPA):
70-08.....National Electrical Code (NEC)
- H. Underwriters Laboratories, Inc. (UL):
6-07.....Electrical Rigid Metal Conduit-Steel
467-07.....Grounding and Bonding Equipment
651-05.....Schedule 40 and 80 Rigid PVC Conduit and
Fittings
651A-00.....Type EB and A Rigid PVC Conduit and HDPE
Conduit
651B-07.....Continuous Length HDPE Conduit
- I. U.S. General Services Administration (GSA):
A-A-60005-1998.....Frames, Covers, Gratings, Steps, Sump and Catch
Basin, Manhole

1.6 STORAGE

Lift and support pre-cast concrete structures only at designated
lifting or supporting points.

PART 2 - PRODUCTS

2.1 PULLBOXES

- A. General: Size as indicated on drawings. Provide pullboxes with
weatherproof, non-skid covers with recessed hook eyes, secured with
corrosion- and tamper-resistant hardware. Cover material shall be
identical to pullbox material. Covers shall have molded lettering,
ELECTRIC or SIGNAL as applicable. Pullboxes shall comply with the
requirements of ANSI/SCTE 77 Tier 15 loading. Provide pulling irons,
0.875 in [22 mm] diameter galvanized steel bar with exposed triangular-
shaped opening.
- B. Fiberglass Pullboxes: Shall be sheet-molded, fiberglass-reinforced,
polyester resin enclosure joined to polymer concrete top ring or frame.

2.2. DUCTS

- A. Number and sizes shall be as shown on drawings.
- B. Ducts (concrete-encased):
1. Plastic Duct:
 - a. UL 651 and 651A Schedule 40 PVC.
 - b. Duct shall be suitable for use with 194° F [90° C] rated
conductors.

- 2. Conduit Spacers: Prefabricated plastic.
- C. Ducts (direct-burial):
 - 1. Plastic duct:
 - a. NEMA TC2 and TC3
 - b. UL 651, 651A, and 651B, Schedule 40 PVC or HDPE.
 - c. Duct shall be suitable for use with 167° F [75° C] rated conductors.
 - 2. Rigid metal conduit: UL6 and NEMA RN1 galvanized rigid steel, threaded type, half-lapped with 10 mil PVC tape.

2.3 GROUNDING

- A. Rods: Per Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS.
- B. Ground Wire: Stranded bare copper 6 AWG [16 mm²] minimum.

2.4 WARNING TAPE

Standard 4-mil polyethylene 3 in [76 mm] wide detectable tape, red with black letters, imprinted with "CAUTION - BURIED ELECTRIC CABLE BELOW" or similar.

2.5 PULL ROPE FOR SPARE DUCTS

Plastic with 200 lb [890 N] minimum tensile strength.

PART 3 - EXECUTION

3.1 PULLBOX INSTALLATION

- A. Assembly and installation shall follow the printed instructions and recommendations of the manufacturer. Install pullboxes level and plumb.
 - 1. Units shall be installed on a 12 in [300 mm] level bed of 90% compacted granular fill, well-graded from the 1 in [25 mm] sieve to the No. 4 sieve. Granular fill shall be compacted with a minimum of four passes with a plate compactor.
 - 2. Seal duct terminations so they are watertight.
- B. Access: Ensure the top of frames and covers are flush with finished grade.

3.2 TRENCHING

- A. Refer to Section 31 20 00, EARTH MOVING for trenching, backfilling, and compaction.
- B. Before performing trenching work at existing facilities, the Ground Penetrating Radar Survey shall be carefully performed by certified technician to reveal all existing underground ducts, conduits, cables, and other utility systems.

- C. Work with extreme care near existing ducts, conduits, cables, and other utilities to avoid damaging them.
- D. Cut the trenches neatly and uniformly.
- E. For Concrete-Encased Ducts:
 - 1. After excavation of the trench, stakes shall be driven in the bottom of the trench at 4 ft [1.2 M] intervals to establish the grade and route of the duct bank.
 - 2. Pitch the trenches uniformly toward manholes or both ways from high points between manholes for the required duct line drainage. Avoid pitching the ducts toward buildings wherever possible.
 - 3. The walls of the trench may be used to form the side walls of the duct bank, provided that the soil is self-supporting and that concrete envelope can be poured without soil inclusions. Forms are required where the soil is not self-supporting.
 - 4. After the concrete-encased duct has sufficiently cured, the trench shall be backfilled to grade with earth, and appropriate warning tape installed.
- F. Conduits to be installed under existing paved areas and roads that cannot be disturbed shall be jacked into place. Conduits shall be heavy wall rigid steel.

3.3 DUCT INSTALLATION

- A. General Requirements:
 - 1. Ducts shall be in accordance with the NEC and IEEE C2, as shown on the drawings, and as specified.
 - 2. Slope ducts to drain towards manholes and pullboxes, and away from building and equipment entrances. Pitch not less than 4 in [100 mm] in 100 ft [30 M].
 - 3. Underground conduit stub-ups and sweeps to equipment inside of buildings shall be taped galvanized rigid steel, and shall extend a minimum of 5 ft [1.5 M] outside the building foundation. Tops of conduits below building slab shall be minimum 24 in [610 mm] below bottom of slab.
 - 4. Stub-ups, sweeps, and risers to equipment mounted on outdoor concrete slabs shall be taped galvanized rigid steel, and shall extend a minimum of 5 ft [1.5 M] away from the edge of slab.
 - 5. Install insulated grounding bushings on the terminations.

6. Radius for turns of direction shall be sufficient to accomplish pulls without damage. Minimum radius shall be six times conduit diameter. Use manufactured long sweep bends.
 7. Additional burial depth shall be required in order to accomplish NEC-required minimum bend radius of ducts.
 8. All multiple conduit runs shall have conduit spacers. Spacers shall securely support and maintain uniform spacing of the duct assembly a minimum of 3 in [75 mm] above the bottom of the trench during the concrete pour. Spacer spacing shall not exceed 5 ft [1.5 M]. Secure spacers to ducts and earth to prevent floating during concrete pour. Provide nonferrous tie wires to prevent displacement of the ducts during pouring of concrete. Tie wires shall not act as substitute for spacers.
 9. Duct lines shall be installed no less than 12 in [300 mm] from other utility systems, such as water, sewer, and chilled water.
 10. Clearances between individual ducts:
 - a. For like services, not less than 3 in [75 mm].
 - b. For power and signal services, not less than 6 in [150 mm].
 11. All ducts shall be fitted with end bells.
 12. Couple the ducts with proper couplings. Stagger couplings in rows and layers to ensure maximum strength and rigidity of the duct bank.
 13. Keep ducts clean of earth, sand, or gravel, and seal with tapered plugs upon completion of each portion of the work.
 14. Seal conduits, including spare conduits, at building entrances and at outdoor equipment terminations with a suitable compound to prevent entrance of moisture and gases.
- B. Concrete-Encased Ducts and Conduits:
1. Install concrete-encased ducts for medium-voltage systems, low-voltage systems, and signal systems, unless otherwise shown on the drawings.
 2. Duct lines shall consist of single or multiple duct assemblies encased in concrete. Ducts shall be uniform in size and material throughout the installation.
 3. Tops of concrete-encased ducts shall be:
 - a. Not less than 24 in [600 mm] and not less than shown on the drawings, below finished grade.
 - b. Not less than 30 in [750 mm] and not less than shown on the drawings, below roads and other paved surfaces.

- c. Conduits crossing under grade slab construction joints shall be installed a minimum of 4 ft [1.2 M] below slab.
- 4. Extend the concrete envelope encasing the ducts not less than 3 in [75 mm] beyond the outside walls of the outer ducts and conduits.
- 5. Within 10 ft [3 M] of building manhole and pullbox wall penetrations, install reinforcing steel bars at the top and bottom of each concrete envelope to provide protection against vertical shearing.
- 6. Install reinforcing steel bars at the top and bottom of each concrete envelope of all ducts underneath roadways and parking areas.
- 7. Where new ducts, conduits, and concrete envelopes are to be joined to existing manholes, pullboxes, ducts, conduits, and concrete envelopes, make the joints with the proper fittings and fabricate the concrete envelopes to ensure smooth durable transitions.
- 8. Conduit joints in concrete may be placed side by side horizontally, but shall be staggered at least 6 in [150 mm] vertically.
- 9. Pour each run of concrete envelope between manholes or other terminations in one continuous pour. If more than one pour is necessary, terminate each pour in a vertical plane and install 0.75 in [19 mm] reinforcing rod dowels extending 18 in [450 mm] into concrete on both sides of joint near corners of envelope.
- 10. Pour concrete so that open spaces are uniformly filled. Do not agitate with power equipment unless approved by COTR.
- 11. Duct Bank Markers:
 - a. Duct bank markers, where required, shall be located at the ends of duct banks except at pullboxes at approximately every 200 ft [60 M] along the duct run and at each change in direction of the duct run. Markers shall be placed 2 ft [0.6 M] to the right of the duct bank, facing the longitudinal axis of the run in the direction of the electrical load.
 - b. The letter "D" with two arrows shall be impressed or cast on top of the marker. One arrow shall be located below the letter and shall point toward the ducts. The second arrow shall be located adjacent to the letter and shall point in a direction parallel to the ducts. The letter and arrow adjacent to it shall each be approximately 2 in [75 mm] long. The letter and arrows shall be

V-shaped, and shall have a width of stroke at least 0.75 in [6 mm] at the top and a depth of 0.25 in [6 mm].

- c. In paved areas, the top of the duct markers shall be flush with the finished surface of the paving.
- d. Where the duct bank changes direction, the arrow located adjacent to the letter shall be cast or impressed with an angle in the arrow equivalent to the angular change of the duct bank.

C. Concrete-Encased Duct and Conduit Identification: Place continuous strip of warning tape approximately 12 in [300 mm] above ducts or conduits before backfilling trenches. Warning tape shall be preprinted with proper identification.

D. Spare Ducts and Conduits: Where spare ducts are shown, they shall have a nylon pull rope installed. They shall be capped at each end and labeled as to location of the other end.

E. Duct and Conduit Cleaning:

1. Upon completion of the duct installation, a standard flexible mandrel shall be pulled through each duct to loosen particles of earth, sand, or foreign material left in the duct. The mandrel shall be not less than 12 in [3600 mm] long, and shall have a diameter not less than 0.5 in [13 mm] less than the inside diameter of the duct. A brush with stiff bristles shall then be pulled through each duct to remove the loosened particles. The diameter of the brush shall be the same as, or slightly larger than, the diameter of the duct.
2. Mandrel pulls shall be witnessed by the COTR.

F. Duct and Conduit Sealing: Seal the ducts and conduits at building entrances, and at outdoor terminations for equipment, with a suitable non-hardening compound to prevent the entrance of moisture and gases.

G. Partially-Completed Duct Banks: During construction, wherever a construction joint is necessary in a duct bank, prevent debris such as mud and dirt from entering ducts by providing suitable conduit plugs. Fit concrete envelope of a partially completed duct bank with reinforcing steel extending a minimum of 2 ft [0.6 M] back into the envelope and a minimum of 2 ft [0.6 M] beyond the end of the envelope. Provide one No. 4 bar in each corner, 3 in [75 mm] from the edge of the envelope. Secure corner bars with two No. 3 ties, spaced approximately 12 in [300 mm] apart. Restrain reinforcing assembly from moving during pouring of concrete.

- - - E N D - - -

SECTION 26 05 71
ELECTRICAL SYSTEM PROTECTIVE DEVICE STUDY

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This section specifies the requirements of the Electrical System Protective Device Study (herein, "the study").
- B. A short-circuit and selective coordination study shall be prepared for the electrical overcurrent devices to be installed under this project.
- C. The study shall present an organized time-current analysis of each protective device in series from the individual device back to the utility and the on-site generator sources. The study shall reflect the operation of each device during normal and abnormal current conditions.

1.2 RELATED WORK

- A. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: General electrical requirements that are common to more than one section of Division 26.
- B. Section 26 24 16, PANEL BOARDS: Low-voltage panelboards.

1.3 QUALITY ASSURANCE

- A. Refer to Paragraph, QUALIFICATIONS, in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
- B. The protective device study shall be prepared by the equipment manufacturer's qualified engineers or an approved consultant. The contractor is responsible for providing all pertinent information required by the preparers to complete the study.

1.4 SUBMITTALS

- A. In accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS, submit the following:
- B. Product data on the software program to be used for the study. Software shall be in mainstream use in the industry, shall provide device settings and ratings, and shall show selective coordination by time-current drawings.
- C. Complete short-circuit and coordination study as described in paragraph 1.6.
- D. Protective equipment shop drawings shall be submitted simultaneously with or after the protective device study. Protective equipment shop drawings will not be accepted prior to protective device study.

E. Certification: Two weeks prior to final inspection, submit four copies of the following to the COTR:

Certification by the contractor that the protective devices have been adjusted and set in accordance with the approved protective device study.

1.5 APPLICABLE PUBLICATIONS

A. Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by designation only.

B. Institute of Electrical and Electronics Engineers (IEEE):

242-01.....Recommended Practice for Protection and
Coordination of Industrial and Commercial Power
Systems

399-97.....Recommended Practice for Power Systems Analysis

1584a-04.....Guide for Performing Arc-Flash Hazard
Calculations

SPEC WRITER NOTE: On small renovation projects, modify the scope to describe the proper extent of the study.

1.6 REQUIREMENTS

A. The complete study shall include a system one line diagram, short-circuit and ground fault analysis, and protective coordination plots for all overcurrent protective devices.

B. One Line Diagram:

1. On the one line diagram, show all electrical equipment and wiring to be protected by the overcurrent devices installed under this project.

2. On the one line diagram, also show the following specific information:

a. Calculated fault impedance, X/R ratios, and short-circuit values at each feeder and branch circuit bus.

b. Breaker and fuse ratings.

c. Generator kW and Transformer kVA and voltage ratings, percent impedance, X/R ratios, and wiring connections.

d. Voltage at each bus.

e. Identification of each bus, matching the identification on the construction drawings.

- f. Conduit, cable, and busway material and sizes, length, and X/R ratios.

C. Short-Circuit Study:

1. Systematically calculate the fault impedance to determine the available short-circuit and ground fault currents at each bus. Incorporate the motor contribution in determining the momentary and interrupting ratings of the protective devices.
2. The study shall be calculated by means of a computer program. Pertinent data and the rationale employed in developing the calculations shall be incorporated in the introductory remarks of the study.
3. Present the data conclusions of the short-circuit study in a table format. Include the following:
 - a. Device identification.
 - b. Operating voltage.
 - c. Protective device.
 - d. Device rating.
 - e. Calculated short-circuit current.

D. Coordination Curves:

1. Prepare the coordination curves to determine the required settings of protective devices to ensure selective coordination. Graphically illustrate on log-log paper that adequate time separation exists between series devices, including the utility company upstream device. Plot the specific time-current characteristics of each protective device in such a manner that all upstream devices are clearly depicted on one sheet.
2. The following specific information shall also be shown on the coordination curves:
 - a. Device identification.
 - b. Voltage and current ratio for curves.
 - c. 3-phase and 1-phase ANSI damage points for each transformer.
 - d. No-damage, melting, and clearing curves for fuses.
 - e. Cable damage curves.
 - f. Transformer in-rush points.
 - g. Maximum short-circuit cutoff point.
3. Develop a table to summarize the settings selected for the protective devices. Include the following in the table:
 - a. Device identification.

- b. Relay CT ratios, tap, time dial, and instantaneous pickup.
- c. Circuit breaker sensor rating, long-time, short-time, and instantaneous settings, and time bands.
- d. Fuse rating and type.
- e. Ground fault pickup and time delay.

1.7 ANALYSIS

- A. Analyze the short-circuit calculations, and highlight any equipment determined to be underrated as specified. Propose approaches to effectively protect the underrated equipment. Provide minor modifications to conform with the study (examples of minor modifications are trip sizes within the same frame, the time-current curve characteristics of induction relays, CT ranges, etc.).
- B. After developing the coordination curves, highlight areas lacking coordination. Present a technical evaluation with a discussion of the logical compromises for best coordination.

1.8 ADJUSTMENTS, SETTINGS AND MODIFICATIONS

- A. Necessary final field adjustments, settings, and minor modifications shall be made to conform with the study without additional cost to the Government.
- B. All final circuit breaker and relay settings and fuse sizes shall be made in accordance with the recommendations of the study.

- - - E N D - - -

SECTION 26 09 23
LIGHTING CONTROLS

PART 1 - GENERAL

1.1 DESCRIPTION

This section specifies the furnishing, installation and connection of the lighting controls.

1.2 RELATED WORK

- A. Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC: Interface of lighting controls with HVAC control systems.
- B. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: General requirements that are common to more than one section of Division 26.
- C. Section 26 05 21, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES (600 VOLTS AND BELOW): Cables and wiring.
- D. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS: Requirements for personnel safety and to provide a low impedance path to ground for possible ground fault currents.
- E. Section 24 26 16, PANELBOARDS: panelboard enclosure and interior bussing used for lighting control panels.
- F. Section 26 27 26, WIRING DEVICES: Wiring devices used for control of the lighting systems.

1.3 QUALITY ASSURANCE

Refer to Paragraph, QUALIFICATIONS, in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

1.4 SUBMITTALS

- A. In accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS, submit the following:
- B. Product Data: For each type of lighting control, submit the following information.
 - 1. Manufacturer's catalog data.
 - 2. Wiring schematic and connection diagram.
 - 3. Installation details.
- C. Manuals:
 - 1. Submit, simultaneously with the shop drawings companion copies of complete maintenance and operating manuals including technical data sheets, and information for ordering replacement parts.
 - 2. Two weeks prior to the final inspection, submit four copies of the final updated maintenance and operating manuals, including any

changes, to the Contracting Officer's Technical Representative (COTR).

D. Certifications:

1. Two weeks prior to final inspection, submit four copies of the following certifications to the COTR:
 - a. Certification by the Contractor that the equipment has been properly installed, adjusted, and tested.

1.5 APPLICABLE PUBLICATIONS

A. Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by designation only.

B. Green Seal (GS):

GC-12.....Occupancy Sensors

C. Illuminating Engineering Society of North America (IESNA):

IESNA LM-48.....Guide for Calibration of Photoelectric Control Devices

D. National Electrical Manufacturer's Association (NEMA)

C136.10.....American National Standard for Roadway Lighting Equipment-Locking-Type Photocontrol Devices and Mating Receptacles - Physical and Electrical Interchangeability and Testing

ICS-1.....Standard for Industrial Control and Systems General Requirements

ICS-2.....Standard for Industrial Control and Systems: Controllers, Contractors, and Overload Relays Rated Not More than 2000 Volts AC or 750 Volts DC: Part 8 - Disconnect Devices for Use in Industrial Control Equipment

ICS-6.....Standard for Industrial Controls and Systems Enclosures

E. Underwriters Laboratories, Inc. (UL):

20.....Standard for General-Use Snap Switches

773.....Standard for Plug-In Locking Type Photocontrols for Use with Area Lighting

773ANonindustrial Photoelectric Switches for Lighting Control

98.....Enclosed and Dead-Front Switches

917.....Clock Operated Switches

PART 2 - PRODUCTS

2.1 ELECTRONIC TIME SWITCHES

- A. Electronic, solid-state programmable units with alphanumeric display; complying with UL 917.
 - 1. Contact Configuration: SPST.
 - 2. Contact Rating: 20-A ballast load, 120/240-V ac.
 - 3. Astronomical Clock: Capable of switching a load on at sunset and off at sunrise, and automatically changing the settings each day in accordance with seasonal changes of sunset and sunrise. Additionally, it shall be programmable to a fixed on/off weekly schedule.
 - 4. Battery Backup: For schedules and time clock.

2.2 OUTDOOR PHOTOELECTRIC SWITCHES

- A. Solid state, with SPST dry contacts rated for 1800 VA tungsten or 1000 VA inductive, complying with UL 773A.
 - 1. Light-Level Monitoring Range: 1.5 to 10 fc [16.14 to 108 lx], with adjustable turn-on and turn-off levels.
 - 2. Time Delay: 15-second minimum.
 - 3. Surge Protection: Metal-oxide varistor.
 - 4. Mounting: Twist lock, with base-and-stem mounting or stem-and-swivel mounting accessories as required.

2.3 INDOOR OCCUPANCY SENSORS

- A. Wall- or ceiling-mounting, solid-state units with a power supply and relay unit, suitable for the environmental conditions in which installed.
 - 1. Operation: Unless otherwise indicated, turn lights on when covered area is occupied and off when unoccupied; with a 1 to 15 minute adjustable time delay for turning lights off.
 - 2. Sensor Output: Contacts rated to operate the connected relay. Sensor shall be powered from the relay unit.
 - 3. Relay Unit: Dry contacts rated for 20A ballast load at 120V and 277V, for 13A tungsten at 120V, and for 1 hp at 120V.
 - 4. Mounting:
 - a. Sensor: Suitable for mounting in any position on a standard outlet box.
 - b. Time-Delay and Sensitivity Adjustments: Recessed and concealed behind hinged door.

5. Indicator: LED, to show when motion is being detected during testing and normal operation of the sensor.
 6. Bypass Switch: Override the on function in case of sensor failure.
 7. Manual/automatic selector switch.
 8. Automatic Light-Level Sensor: Adjustable from 2 to 200 fc [21.5 to 2152 lx]; keep lighting off when selected lighting level is present.
 9. Faceplate for Wall-Switch Replacement Type: Refer to wall plate material and color requirements for toggle switches, as specified in Section 26 27 26, WIRING DEVICES.
- B. Dual-technology Type: Ceiling mounting; combination PIR and ultrasonic detection methods, field-selectable.
1. Sensitivity Adjustment: Separate for each sensing technology.
 2. Detector Sensitivity: Detect occurrences of 6-inch [150mm] minimum movement of any portion of a human body that presents a target of not less than 36 sq. in. [232 sq. cm], and detect a person of average size and weight moving not less than 12 inches [305 mm] in either a horizontal or a vertical manner at an approximate speed of 12 inches/s [305 mm/s].
 3. Detection Coverage: as scheduled on drawings.

2.4 LIGHTING CONTROL PANEL - RELAY TYPE

- A. Controller: Comply with UL 508; programmable, solid-state, astronomic 365-day control unit with non-volatile memory, mounted in preassembled relay panel with low-voltage-controlled, latching-type, single-pole lighting circuit relays. Controller shall be capable of receiving inputs from sensors and other sources, and capable of timed overrides and/or blink-warning on a per-circuit basis. Controller communication protocol shall be compatible with the building automation system specified in SECTION 23 09 23 DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC. Where indicated, a limited number of digital or analog, low-voltage control-circuit outputs shall be supported by control unit and circuit boards associated with relays.
- B. Cabinet: Steel with hinged, locking door. Barriers separate low-voltage and line-voltage components.
- C. Directory: Identifies each relay as to load controlled.
- D. Control Power Supply: Transformer and full-wave rectifier with filtered dc output.
- E. Single-Pole Relays: Mechanically held unless otherwise indicated; split-coil, momentary-pulsed type, rated 20 A, 125-V ac for tungsten

filaments and 20 A, 277-V ac for ballasts, 50,000 cycles at rated capacity.

PART 3 - EXECUTION

3.1 INSTALLATION:

- A. Installation shall be in accordance with the NEC, manufacturer's instructions and as shown on the drawings or specified.
- B. Aim outdoor photocell switch according to manufacturer's recommendations. Set adjustable window slide for 1 footcandle photocell turn-on.
- C. Aiming for wall-mounted and ceiling-mounted motion sensor switches shall be per manufacturer's recommendations.
- D. Set occupancy sensor "on" duration to 15 minutes.
- E. Locate light level sensors as indicated and in accordance with the manufacturer's recommendations. Adjust sensor for the scheduled light level at the typical work plane for that area.
- F. Label time switches and contactors with a unique designation.

3.2 ACCEPTANCE CHECKS AND TESTS

- A. Perform in accordance with the manufacturer's recommendations.
- B. Upon completion of installation, conduct an operating test to show that equipment operates in accordance with requirements of this section.
- C. Test for full range of dimming ballast and dimming controls capability. Observe for visually detectable flicker over full dimming range.
- D. Test occupancy sensors for proper operation. Observe for light control over entire area being covered.
- E. Program lighting control panels per schedule on drawings.

3.3 FOLLOW-UP VERIFICATION

Upon completion of acceptance checks and tests, the Contractor shall show by demonstration in service that the lighting control devices are in good operating condition and properly performing the intended function.

- - - E N D - - -

SECTION 26 22 00
LOW-VOLTAGE TRANSFORMERS

PART 1 - GENERAL

1.1 DESCRIPTION

This section specifies the furnishing, installation, and connection of dry-type general-purpose transformers.

1.2 RELATED WORK

- A. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: General electrical requirements and items common to more than one section of Division 26.
- B. Section 26 05 21, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES (600 VOLTS AND BELOW): Cables and wiring.
- C. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS: Requirements for personnel safety and to provide a low impedance path for possible ground fault currents.
- D. Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS: Conduits and outlet boxes.

1.3 QUALITY ASSURANCE

Refer to Paragraph, QUALIFICATIONS, in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

1.4 SUBMITTALS

- A. In accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS, submit the following:
- B. Shop Drawings:
 - 1. Clearly present sufficient information to determine compliance with drawings and specifications.
 - 2. Include electrical ratings, impedance, dimensions, weight, mounting details, decibel rating, terminations, temperature rise, no load and full load losses, and connection diagrams.
 - 3. Complete nameplate data, including manufacturer's name and catalog number.
- C. Manuals:
 - 1. When submitting the shop drawings, submit companion copies of complete maintenance and operating manuals, including technical data sheets and wiring diagrams.
 - 2. If changes have been made to the maintenance and operating manuals originally submitted, then submit four copies of the updated

maintenance and operating manuals to the COTR two weeks prior to final inspection.

- D. Certifications: Two weeks prior to the final inspection, submit four copies of the following to the COTR:
 - 1. Certification by the manufacturer that the materials conform to the requirements of the drawings and specifications.
 - 2. Certification by the contractor that the equipment has been properly installed and tested.

1.4 APPLICABLE PUBLICATIONS

- A. Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by designation only.
- B. National Fire Protection Association (NFPA):
 - 70-08.....National Electrical Code (NEC)
- C. National Electrical Manufacturers Association (NEMA):
 - ST20-92.....Dry-Type Transformers for General Applications
 - TP1-02.....Guide for Determining Energy Efficiency for
Distribution Transformers
 - TR1-00.....Transformers, Regulators, and Reactors

PART 2 - PRODUCTS

2.1 GENERAL PURPOSE DRY-TYPE TRANSFORMERS

- A. Unless otherwise specified, dry-type transformers shall be in accordance with NEMA, NEC, and as shown on the drawings. Transformers shall be UL-listed and labeled.
- B. Dry-type transformers shall have the following features:
 - 1. Transformers shall be self-cooled by natural convection, isolating windings, indoor dry-type. Autotransformers will not be accepted.
 - 2. Rating and winding connections shall be as shown on the drawings.
 - 3. Transformers shall have copper windings.
 - 4. Ratings shown on the drawings are for continuous duty without the use of cooling fans.
 - 5. Insulation systems:
 - a. Transformers 30 kVA and larger: UL rated 220° C system with an average maximum rise by resistance of 150 ° C in a maximum ambient of 40 ° C.

- b. Transformers below 30 kVA: Same as for 30 kVA and larger or UL rated 185 ° C system with an average maximum rise by resistance of 115 ° C in a maximum ambient of 40 ° C.
- 6. Core and coil assemblies:
 - a. Rigidly braced to withstand the stresses caused by short-circuit currents and rough handling during shipment.
 - b. Cores shall be grain-oriented, non-aging, and silicon steel.
 - c. Coils shall be continuous windings without splices except for taps.
 - d. Coil loss and core loss shall be minimized for efficient operation.
 - e. Primary and secondary tap connections shall be brazed or pressure type.
 - f. Coil windings shall have end filters or tie-downs for maximum strength.
- 7. Certified sound levels determined in accordance with NEMA, shall not exceed the following:

Transformer Rating	Sound Level Rating
0 - 9 KVA	40 dB
10 - 50 KVA	45 dB
51 - 150 KVA	50 dB
151 - 300 KVA	55 dB
301 - 500 KVA	60 dB

- 8. If not shown on drawings or required by the coordination study, nominal impedance shall be as permitted by NEMA.
- 9. Single phase transformers rated 15 kVA through 25 kVA shall have two 5% full capacity taps below normal rated primary voltage. All transformers rated 30 kVA and larger shall have two 2.5% full capacity taps above, and four 2.5% full capacity taps below normal rated primary voltage.
- 10. Core assemblies shall be grounded to their enclosures with adequate flexible ground straps.
- 11. Enclosures:
 - a. Comprised of not less than code gauge steel.
 - b. Outdoor enclosures shall be NEMA 3R.

- c. Temperature rise at hottest spot shall conform to NEMA Standards, and shall not bake and peel off the enclosure paint after the transformer has been placed in service.
 - d. Ventilation openings shall prevent accidental access to live components.
 - e. The enclosure at the factory shall be thoroughly cleaned and painted with manufacturer's prime coat and standard finish.
12. Standard NEMA features and accessories, including ground pad, lifting provisions, and nameplate with the wiring diagram and sound level indicated on it.
13. Dimensions and configurations shall conform to the spaces designated for their installations.
14. Transformers shall meet the minimum energy efficiency values per NEMA TP1 as listed below:

kVA Rating	Output efficiency (%)
15	97
30	97.5
45	97.7
75	98
112.5	98.2
150	98.3
225	98.5
300	98.6
500	98.7
750	98.8

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Installation of transformers shall be in accordance with the NEC, as recommended by the equipment manufacturer and as shown on the drawings.
- B. Install transformers with manufacturer's recommended clearance from wall and adjacent equipment for air circulation. Minimum clearance shall be 6 in [150 mm].
- C. Install transformers on vibration pads designed to suppress transformer noise and vibrations.

- D. Use flexible metal conduit to enclose the conductors from the transformer to the raceway systems.

3.2 ACCEPTANCE CHECKS AND TESTS

Perform tests in accordance with the manufacturer's recommendations. Include the following visual and mechanical inspections.

1. Compare equipment nameplate data with specifications and approved shop drawings.
2. Inspect physical and mechanical condition.
3. Inspect all field-installed bolted electrical connections, using the calibrated torque-wrench method to verify tightness of accessible bolted electrical connections.
4. Perform specific inspections and mechanical tests as recommended by manufacturer.
5. Verify correct equipment grounding.
6. Verify proper secondary phase-to-phase and phase-to-neutral voltage after energization and prior to connection to loads.

3.3 FOLLOW-UP VERIFICATION

Upon completion of acceptance checks, settings, and tests, the contractor shall demonstrate that the transformers are in good operating condition and properly performing the intended function.

- - - E N D - - -

SECTION 26 24 16
PANELBOARDS

PART 1 - GENERAL

1.1 DESCRIPTION

This section specifies the furnishing, installation, and connection of panelboards.

1.2 RELATED WORK

- A. Section 09 91 00, PAINTING: Identification and painting of panelboards.
- B. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: General electrical requirements and items that are common to more than one Section of Division 26.
- C. Section 26 05 21, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES (600 VOLTS AND BELOW): Cables and wiring.
- D. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS: Requirements for personnel safety and to provide a low impedance path for possible ground fault currents.
- E. Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS: Conduits and outlet boxes.
- F. Section 26 05 71, ELECTRICAL SYSTEM PROTECTIVE DEVICE STUDY: Requirements for installing the over-current protective devices to ensure proper equipment and personnel protection.
- G. Section 26 09 23, LIGHTING CONTROLS: Lighting controls integral to panelboards.
- H. Section 26 43 13, TRANSIENT-VOLTAGE SURGE SUPPRESSION: Surge suppressors installed in panelboards.

1.3 QUALITY ASSURANCE

Refer to Paragraph, QUALIFICATIONS, in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

1.4 SUBMITTALS

- A. Submit in accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
- B. Shop Drawings:
 - 1. Sufficient information shall be clearly presented to determine compliance with drawings and specifications.
 - 2. Include electrical ratings, dimensions, mounting details, materials, wiring diagrams, accessories, and weights of equipment. Complete nameplate data, including manufacturer's name and catalog number.

C. Manuals:

1. When submitting the shop drawings, submit companion copies of complete maintenance and operating manuals, including technical data sheets and wiring diagrams.
2. If changes have been made to the maintenance and operating manuals that were originally submitted, then submit four copies of updated maintenance and operating manuals to the COTR two weeks prior to final inspection.

D. Certification: Two weeks prior to final inspection, submit four copies of the following to the COTR:

1. Certification by the manufacturer that the materials conform to the requirements of the drawings and specifications.
2. Certification by the contractor that the materials have been properly installed, connected, and tested.

1.5 APPLICABLE PUBLICATIONS

A. Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by designation only.

B. National Electrical Manufacturers Association (NEMA):

PB-1-06.....Panelboards

250-08.....Enclosures for Electrical Equipment (1000V
Maximum)

C. National Fire Protection Association (NFPA):

70-2005National Electrical Code (NEC)

70E-2004.....Standard for Electrical Life Safety in the
Workplace

D. Underwriters Laboratories, Inc. (UL):

50-95.....Enclosures for Electrical Equipment

67-09.....Panelboards

489-09.....Molded Case Circuit Breakers and Circuit
Breaker Enclosures

PART 2 - PRODUCTS

2.1 PANELBOARDS

- A. Panelboards shall be in accordance with UL, NEMA, NEC, and as shown on the drawings.
- B. Panelboards shall be standard manufactured products.
- C. All panelboards shall be hinged "door in door" type with:

1. Interior hinged door with hand-operated latch or latches, as required to provide access only to circuit breaker operating handles, not to energized parts.
 2. Outer hinged door shall be securely mounted to the panelboard box with factory bolts, screws, clips, or other fasteners, requiring a tool for entry. Hand-operated latches are not acceptable.
 3. Push inner and outer doors shall open left to right.
- D. All panelboards shall be completely factory-assembled with molded case circuit breakers and integral accessories, such as surge protective devices per Section 26 43 13, TRANSIENT-VOLTAGE SURGE SUPPRESSION, metering devices per Section 25 10 10, ADVANCED UTILITY METERING, lighting controls per Section 26 09 23, LIGHTING CONTROLS, and as scheduled on the drawings or specified herein. Include one-piece removable, inner dead front cover, independent of the panelboard cover.
- E. Panelboards shall have main breaker or main lugs, bus size, voltage, phase, top or bottom feed, and flush or surface mounting as scheduled on the drawings.
- F. Panelboards shall conform to NEMA PB-1, NEMA AB-1, and UL 67 and have the following features:
1. Non-reduced size copper bus bars with current ratings as shown on the panel schedules, rigidly supported on molded insulators.
 2. Bus bar connections to the branch circuit breakers shall be the "distributed phase" or "phase sequence" type.
 3. Mechanical lugs furnished with panelboards shall be cast, stamped, or machined metal alloys of sizes suitable for the conductors to which they will be connected.
 4. Neutral bus shall be 200% rated, mounted on insulated supports.
 5. Grounding bus bar shall be equipped with screws or lugs for the connection of grounding wires.
 6. Buses shall be braced for the available short-circuit current.
Bracing shall not be less than 22,000 A symmetrical for 120/208 V panelboards, and 42,000 A symmetrical for 277/480 V panelboards.
 7. Branch circuit panelboards shall have buses fabricated for bolt-on type circuit breakers.
 8. Protective devices shall be designed so that they can easily be replaced.

9. Where designated on panel schedule "spaces," include all necessary bussing, device support, and connections. Provide blank cover for each space.
10. Series-rated panelboards are not permitted.

2.2 CABINETS AND TRIMS

Cabinets:

1. Provide galvanized steel cabinets to house panelboards. Cabinets for outdoor panelboards shall be factory primed and suitably treated with a corrosion-resisting paint finish meeting UL 50 and UL 67.
2. Cabinet enclosure shall not have ventilating openings.
3. Cabinets for panelboards may be of one-piece formed steel or of formed sheet steel with end and side panels welded, riveted, or bolted as required.

2.3 MOLDED CASE CIRCUIT BREAKERS FOR PANELBOARDS

- A. Circuit breakers shall be per UL 489, in accordance with the NEC, as shown on the drawings, and as specified.
- B. Circuit breakers in panelboards shall be bolt-on type.
- C. Molded case circuit breakers shall have minimum interrupting rating as required to withstand the available fault current, but not less than:
 1. 120/208 V Panelboard: 22,000 A symmetrical.
 2. 277/480 V Panelboard: 42,000 A symmetrical.
- D. Molded case circuit breakers shall have automatic, trip free, non-adjustable, inverse time, and instantaneous magnetic trips for 100 A frame or lower. Magnetic trip shall be adjustable from 3x to 10x for breakers with 600 A frames and higher. Breaker trip setting shall be set in the field, based on the approved protective device study as specified in Section 26 05 71, ELECTRICAL SYSTEM PROTECTIVE DEVICE STUDY.
- E. Breaker features shall be as follows:
 1. A rugged, integral housing of molded insulating material.
 2. Silver alloy contacts.
 3. Arc quenchers and phase barriers for each pole.
 4. Quick-make, quick-break, operating mechanisms.
 5. A trip element for each pole, thermal magnetic type with long time delay and instantaneous characteristics, a common trip bar for all poles and a single operator.
 6. Electrically and mechanically trip free.
 7. An operating handle which indicates ON, TRIPPED, and OFF positions.

8. An overload on one pole of a multipole breaker shall automatically cause all the poles of the breaker to open.
9. Ground fault current interrupting breakers, shunt trip breakers, lighting control breakers (including accessories to switch line currents), or other accessory devices or functions shall be provided where indicated.
10. For circuit breakers being added to existing panelboards, coordinate the breaker type with existing panelboards. Modify the panel directory accordingly.

2.4 SURGE SUPPRESSION

Where shown on drawings, furnish panelboard with integral transient voltage surge suppression device. Refer to Section 26 43 13, TRANSIENT-VOLTAGE SURGE SUPPRESSION.

2.5 SEPARATELY ENCLOSED MOLDED CASE CIRCUIT BREAKERS

- A. Where separately enclosed molded case circuit breakers are shown on the drawings, provide circuit breakers in accordance with the applicable requirements of those specified for panelboards.
- B. Enclosures are to be of the NEMA types shown on the drawings. Where the types are not shown, they are to be the NEMA type most suitable for the environmental conditions where the circuit breakers are being installed.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Installation shall be in accordance with the manufacturer's instructions, the NEC, as shown on the drawings, and as specified.
- B. Locate panelboards so that the present and future conduits can be conveniently connected.
- C. Install a printed schedule of circuits in each panelboard after approval by the COTR. Schedules shall be printed on the panelboard directory cards, installed in the appropriate panelboards, and incorporate all applicable contract changes. Information shall indicate outlets, lights, devices, or other equipment controlled by each circuit, and the final room numbers served by each circuit.
- D. Mount the fully-aligned panelboard such that the maximum height of the top circuit breaker above the finished floor shall not exceed 78 in [1980 mm]. Mount panelboards that are too high such that the bottom of the cabinets will not be less than 6 in [150 mm] above the finished floor.

- E. For panelboards located in areas accessible to the public, paint the exposed surfaces of the trims, doors, and boxes with finishes to match surrounding surfaces after the panelboards have been installed.
- F. Rust and scale shall be removed from the inside of existing backboxes where new panelboards are to be installed. Paint inside of backboxes with rust-preventive paint before the new panelboard interior is installed. Provide new trim and doors for these panelboards. Covers shall fit tight to the box with no gaps between the cover and the box.

3.2 ACCEPTANCE CHECKS AND TESTS

Perform in accordance with the manufacturer's recommendations. Include the following visual and mechanical inspections and electrical tests:

1. Visual and Mechanical Inspection
 - a. Compare equipment nameplate data with specifications and approved shop drawings.
 - b. Inspect physical, electrical, and mechanical condition.
 - c. Verify appropriate anchorage and required area clearances.
 - d. Verify that circuit breaker sizes and types correspond to approved shop drawings.
 - e. To verify tightness of accessible bolted electrical connections, use the calibrated torque-wrench method or perform thermographic survey after energization.
 - f. Clean panelboard.

3.3 FOLLOW-UP VERIFICATION

Upon completion of acceptance checks, settings, and tests, the contractor shall demonstrate that the panelboards are in good operating condition and properly performing the intended function.

- - - E N D - - -

SECTION 26 27 26
WIRING DEVICES

PART 1 - GENERAL

1.1 DESCRIPTION

This section specifies the furnishing, installation and connection of wiring devices.

1.2 RELATED WORK

- A. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: General electrical requirements that are common to more than one section of Division 26.
- B. Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS: Conduits and outlets boxes.
- C. Section 26 05 21, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES (600 VOLTS AND BELOW): Cables and wiring.
- D. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS: Requirements for personnel safety and to provide a low impedance path to ground for possible ground fault currents.

1.3 QUALITY ASSURANCE

Refer to Paragraph, QUALIFICATIONS, in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

1.4 SUBMITTALS

- A. In accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS, submit the following:
- B. Shop Drawings:
 - 1. Sufficient information, clearly presented, shall be included to determine compliance with drawings and specifications.
 - 2. Include electrical ratings, dimensions, mounting details, construction materials, grade and termination information.
- C. Manuals: Two weeks prior to final inspection, deliver four copies of the following to the Contracting Officer's Technical Representative (COTR): Technical data sheets and information for ordering replacement units.
- D. Certifications: Two weeks prior to final inspection, submit four copies of the following to the COTR: Certification by the Contractor that the devices comply with the drawings and specifications, and have been properly installed, aligned, and tested.

1.5 APPLICABLE PUBLICATIONS

- A. Publications listed below (including amendments, addenda, revisions, supplements and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by basic designation only.
- B. National Fire Protection Association (NFPA):
 - 70.....National Electrical Code (NEC)
- C. National Electrical Manufacturers Association (NEMA):
 - WD 1.....General Color Requirements for Wiring Devices
 - WD 6Wiring Devices - Dimensional Requirements
- D. Underwriter's Laboratories, Inc. (UL):
 - 5.....Surface Metal Raceways and Fittings
 - 20.....General-Use Snap Switches
 - 231.....Power Outlets
 - 467.....Grounding and Bonding Equipment
 - 498.....Attachment Plugs and Receptacles
 - 943.....Ground-Fault Circuit-Interrupters

PART 2 - PRODUCTS

2.1 RECEPTACLES

- A. General: All receptacles shall be listed by Underwriters Laboratories, Inc., and conform to NEMA WD 6.
 - 1. Mounting straps shall be plated steel, with break-off plaster ears and shall include a self-grounding feature. Terminal screws shall be brass, brass plated or a copper alloy metal.
 - 2. Receptacles shall have provisions for back wiring with separate metal clamp type terminals (four min.) and side wiring from four captively held binding screws.
 - 3. Hospital-grade receptacles shall be installed in all areas of the of the building.
- B. Duplex Receptacles: Hospital-grade, single phase, 20 ampere, 120 volts, 2-pole, 3-wire, and conform to the NEMA 5-20R configuration in NEMA WD 6. The duplex type shall have break-off feature for two-circuit operation. The ungrounded pole of each receptacle shall be provided with a separate terminal.
 - 1. Bodies shall be ivory in color.
 - 2. Switched duplex receptacles shall be wired so that only the top receptacle is switched. The remaining receptacle shall be unswitched.

3. Duplex Receptacles on Emergency Circuit:
 - a. In rooms without emergency powered general lighting, the emergency receptacles shall be of the self-illuminated type.
4. Ground Fault Interrupter Duplex Receptacles: Shall be an integral unit, hospital-grade, suitable for mounting in a standard outlet box.
 - a. Ground fault interrupter shall be consist of a differential current transformer, solid state sensing circuitry and a circuit interrupter switch. Device shall have nominal sensitivity to ground leakage current of five milliamperes and shall function to interrupt the current supply for any value of ground leakage current above five milliamperes (+ or - 1 milliamp) on the load side of the device. Device shall have a minimum nominal tripping time of 1/30th of a second.
 - b. Ground Fault Interrupter Duplex Receptacles (not hospital-grade) shall be the same as ground fault interrupter hospital-grade receptacles except for the "hospital-grade" listing.
5. Safety Type Duplex Receptacles:
 - a. Bodies shall be gray in color.
 - 1) Shall permit current to flow only while a standard plug is in the proper position in the receptacle.
 - 2) Screws exposed while the wall plates are in place shall be the tamperproof type.
- C. Receptacles; 20, 30 and 50 ampere, 250 volts: Shall be complete with appropriate cord grip plug. Devices shall meet UL 231.
- D. Weatherproof Receptacles: Shall consist of a duplex receptacle, mounted in box with a gasketed, weatherproof, cast metal cover plate and cap over each receptacle opening. The cap shall be permanently attached to the cover plate by a spring-hinged flap. The weatherproof integrity shall not be affected when heavy duty specification or hospital grade attachment plug caps are inserted. Cover plates on outlet boxes mounted flush in the wall shall be gasketed to the wall in a watertight manner.
- E. TVSS Receptacles. Shall comply with NEMA WD 1, NEMA WD 6, UL 498, and UL 1449, with integral TVSS in line to ground, line to neutral, and neutral to ground.
 1. TVSS Components: Multiple metal-oxide varistors; with a nominal clamp-level rating of 400 volts and minimum single transient pulse

energy dissipation of 240 J, according to IEEE C62.41.2 and IEEE C62.45.

2. Active TVSS Indication: Visual and audible, with light visible in face of device to indicate device is "active" or "no longer in service."
3. Install TVSS Receptacles in all Telecommunication Rooms.

2.2 TOGGLE SWITCHES

- A. Toggle Switches: Shall be totally enclosed tumbler type with bodies of phenolic compound. Toggle handles shall be ivory in color unless otherwise specified. The rocker type switch is not acceptable and will not be approved.
 1. Switches installed in hazardous areas shall be explosion proof type in accordance with the NEC and as shown on the drawings.
 2. Shall be single unit toggle, butt contact, quiet AC type, heavy-duty general-purpose use with an integral self grounding mounting strap with break-off fasteners ears and provisions for back wiring with separate metal wiring clamps and side wiring with captively held binding screws.
 3. Ratings:
 - a. 120 volt circuits: 20 amperes at 120-277 volts AC.
 - b. 277 volt circuits: 20 amperes at 120-277 volts AC.

2.3 MANUAL DIMMING CONTROL

- A. slide dimmer with on/off control, single-pole or three-way as shown on plans. Faceplates shall be ivory in color unless otherwise specified.
- B. Manual dimming controls shall be fully compatible with electronic dimming ballasts and approved by the ballast manufacturer, shall operate over full specified dimming range, and shall not degrade the performance or rated life of the electronic dimming ballast and lamp.

2.4 WALL PLATES

- A. Wall plates for switches and receptacles shall be type 302 stainless steel. Oversize plates are not acceptable.
- B. Standard NEMA design, so that products of different manufacturers will be interchangeable. Dimensions for openings in wall plates shall be accordance with NEMA WD 6.
- C. For receptacles or switches mounted adjacent to each other, wall plates shall be common for each group of receptacles or switches.
- D. In psychiatric areas, wall plates shall be 302 stainless steel, have tamperproof screws and beveled edges.

- E. Wall plates for data, telephone or other communication outlets shall be as specified in the associated specification.
- F. Duplex Receptacles on Emergency Circuit:
 - 1. Bodies shall be red in color. Wall plates shall be red with the word "EMERGENCY" engraved in 6 mm, (1/4 inch) white letters.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Installation shall be in accordance with the NEC and as shown as on the drawings.
- B. Ground terminal of each receptacle shall be bonded to the outlet box with an approved green bonding jumper, and also connected to the green equipment grounding conductor.
- C. Outlet boxes for light and dimmer switches shall be mounted on the strike side of doors.
- D. Provide barriers in multigang outlet boxes to separate systems of different voltages, Normal Power and Emergency Power systems, and in compliance with the NEC.
- E. Coordinate with other work, including painting, electrical boxes and wiring installations, as necessary to interface installation of wiring devices with other work. Coordinate the electrical work with the work of other trades to ensure that wiring device flush outlets are positioned with box openings aligned with the face of the surrounding finish material. Pay special attention to installations in cabinet work, and in connection with laboratory equipment.
- F. Exact field locations of floors, walls, partitions, doors, windows, and equipment may vary from locations shown on the drawings. Prior to locating sleeves, boxes and chases for roughing-in of conduit and equipment, the Contractor shall coordinate exact field location of the above items with other trades. In addition, check for exact direction of door swings so that local switches are properly located on the strike side.
- G. Install wall switches 48 inches [1200mm] above floor, OFF position down.
- H. Install wall dimmers 48 inches [1200mm] above floor; derate ganged dimmers as instructed by manufacturer; do not use common neutral.
- I. Install convenience receptacles 18 inches [450mm] above floor, and 6 inches [152mm] above counter backsplash or workbenches. Install specific-use receptacles at heights shown on the drawings.

- J. Label device plates with a permanent adhesive label listing panel and circuit feeding the wiring device.
- K. Test wiring devices for damaged conductors, high circuit resistance, poor connections, inadequate fault current path, defective devices, or similar problems using a portable receptacle tester. Correct circuit conditions, remove malfunctioning units and replace with new, and retest as specified above.
- L. Test GFCI devices for tripping values specified in UL 1436 and UL 943.

- - - E N D - - -

SECTION 26 29 11
MOTOR STARTERS

PART 1 - GENERAL

1.1 DESCRIPTION

All motor starters and variable speed motor controllers, including installation and connection (whether furnished with the equipment specified in other Divisions or otherwise), shall meet these specifications.

1.2 RELATED WORK

- A. Other sections which specify motor driven equipment, except elevator motor controllers.
- B. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: General electrical requirements and items that are common to more than one Section of Division 26.
- C. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS: Requirements for personnel safety and to provide a low impedance path for possible ground fault currents.

1.3 QUALITY ASSURANCE

Refer to Paragraph, QUALIFICATIONS, in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

1.4 SUBMITTALS

- A. Submit in accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS:
- B. Shop Drawings:
 - 1. Sufficient information, clearly presented, shall be included to determine compliance with drawings and specifications.
 - 2. Include electrical ratings, dimensions, weights, mounting details, materials, running over current protection, size of enclosure, over current protection, wiring diagrams, starting characteristics, interlocking and accessories.
- C. Manuals:
 - 1. Submit, simultaneously with the shop drawings, companion copies of complete maintenance and operating manuals, including technical data sheets, wiring diagrams and information for ordering replacement parts.
 - a. Wiring diagrams shall have their terminals identified to facilitate installation, maintenance and operation.

- b. Wiring diagrams shall indicate internal wiring for each item of equipment and interconnections between the items of equipment.
 - c. Elementary schematic diagrams shall be provided for clarity of operation.
- 2. Two weeks prior to the project final inspection, submit four copies of the final updated maintenance and operating manual to the Contracting Officer's Technical Representative (COTR).
- D. Certification: Two weeks prior to final inspection, unless otherwise noted, submit four copies of the following certifications to the COTR:
 - 1. Certification that the equipment has been properly installed, adjusted, and tested.
 - 2. Certification by the manufacturer that medium voltage motor controller(s) conforms to the requirements of the drawings and specifications. This certification must be furnished to the COTR prior to shipping the controller(s) to the job site.

1.5 APPLICABLE PUBLICATIONS

- A. Publications listed below (including amendments, addenda, revisions, supplements and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by basic designation only.
- B. Institute of Electrical and Electronic Engineers (IEEE):
 - 519.....Recommended Practices and Requirements for
Harmonic Control in Electrical Power Systems
 - C37.90.1.....Standard Surge Withstand Capability (SWC) Tests
for Protective Relays and Relay Systems
- C. National Electrical Manufacturers Association (NEMA):
 - ICS 1.....Industrial Control and Systems General
Requirements
 - ICS 1.1.....Safety Guidelines for the Application,
Installation and Maintenance of Solid State
Control
 - ICS 2.....Industrial Control and Systems, Controllers,
Contactors and Overload Relays Rated 600 Volts
DC
 - ICS 6.....Industrial Control and Systems Enclosures
 - ICS 7.....Industrial Control and Systems Adjustable-Speed
Drives

- ICS 7.1.....Safety Standards for Construction and Guide for
Selection, Installation and Operation of
Adjustable-Speed Drive Systems
- D. National Fire Protection Association (NFPA):
70.....National Electrical Code (NEC)
- E. Underwriters Laboratories Inc. (UL):
508.....Industrial Control Equipment

PART 2 - PRODUCTS

2.1 MOTOR STARTERS, GENERAL

- A. Shall be in accordance with the requirements of the IEEE, NEC, NEMA (ICS 1, ICS 1.1, ICS 2, ICS 6, ICS 7 and ICS 7.1) and UL.
- B. Shall have the following features:
 - 1. Separately enclosed unless part of another assembly.
 - 2. Circuit breakers and safety switches within the motor controller enclosures shall have external operating handles with lock-open padlocking provisions and shall indicate the ON and OFF positions.
 - 3. Motor control circuits:
 - a. Shall operate at not more than 120 volts.
 - b. Shall be grounded except as follows:
 - 1) Where isolated control circuits are shown.
 - 2) Where manufacturers of equipment assemblies recommend that the control circuits be isolated.
 - c. Incorporate a separate, heavy duty, control transformer within each motor controller enclosure to provide the control voltage for each motor operating over 120 volts.
 - d. Incorporate over current protection for both primary and secondary windings of the control power transformers in accordance with the NEC.
 - 4. Overload current protective devices:
 - a. Overload relay (thermal or induction type).
 - b. One for each pole.
 - c. Manual reset on the door of each motor controller enclosure.
 - d. Correctly sized for the associated motor's rated full load current.
 - e. Check every motor controller after installation and verify that correct sizes of protective devices have been installed.
 - f. Deliver four copies of a summarized list to the COTR, which indicates and adequately identifies every motor controller

installed. Include the catalog numbers for the correct sizes of protective devices for the motor controllers.

5. Hand-Off-Automatic (H-O-A) switch is required unless specifically stated on the drawings as not required for a particular starter. H-O-A switch is not required for manual motor starters.
6. Incorporate into each control circuit a 120-volt, solid state time delay relay (ON delay), minimum adjustable range from 0.3 to 10 minutes, with transient protection. Time delay relay is not required where H-O-A switch is not required.
7. Unless noted otherwise, equip with not less than two normally open and two normally closed auxiliary contacts. Provide green run pilot lights and H-O-A control devices as indicated, operable at front of enclosure without opening enclosure. Push buttons, selector switches, pilot lights, etc., shall be interchangeable.
8. Enclosures:
 - a. Shall be the NEMA types shown on the drawings for the motor controllers and shall be the NEMA types which are the most suitable for the environmental conditions where the motor controllers are being installed.
 - b. Doors mechanically interlocked to prevent opening unless the breaker or switch within the enclosure is open. Provision for padlock must be provided.
 - c. Enclosures shall be primed and finish coated at the factory with the manufacturer's prime coat and standard finish.
- C. Motor controllers incorporated with equipment assemblies shall also be designed for the specific requirements of the assemblies.
- D. Additional requirements for specific motor controllers, as indicated in other sections, shall also apply.
- E. Provide a disconnecting means or safety switch near and within sight of each motor. Provide all wiring and conduit required to facilitate a complete installation.

2.2 MANUAL MOTOR STARTERS

- A. Shall be in accordance with applicable requirements of 2.1 above.
- B. Manual motor starters.
 1. Starters shall be general-purpose Class A, manually operated type with full voltage controller for induction motors, rated in horsepower.

2. Units shall include overload protection, red pilot light, NO auxiliary contact and toggle operator.
- C. Fractional horsepower manual motor starters.
 1. Starters shall be general-purpose Class A, manually operated with full voltage controller for fractional horsepower induction motors.
 2. Units shall include thermal overload protection, red pilot light and toggle operator.
- D. Motor starting switches.
 1. Switches shall be general-purpose Class A, manually operated type with full voltage controller for fractional horsepower induction motors.
 2. Units shall include thermal overload protection, red pilot light, NO auxiliary contact and toggle operator.

2.3 MAGNETIC MOTOR STARTERS

- A. Shall be in accordance with applicable requirements of 2.1 above.
- B. Starters shall be general-purpose, Class A magnetic controllers for induction motors rated in horsepower. Minimum size 0.
- C. Where combination motor starters are used, combine starter with protective or disconnect device in a common enclosure.
- D. Provide phase loss protection for each starter, with contacts to de-energize the starter upon loss of any phase.
- E. Unless otherwise indicated, provide full voltage non-reversing across-the-line mechanisms for motors less than 75 HP, closed by coil action and opened by gravity. For motors 75 HP and larger, provide reduced voltage starters. Equip starters with 120V AC coils and individual control transformer unless otherwise noted. Locate "reset" button to be accessible without opening the enclosure.

2.4 REDUCED VOLTAGE MOTOR CONTROLLERS

- A. Shall be in accordance with applicable portions of 2.1 above.
- B. Shall be installed as shown for motors on the contract drawings.
- C. Shall have closed circuit transition for the types which can incorporate such transition.
- D. Shall limit inrush currents to not more than 70 percent of the locked rotor currents.
- E. Provide phase loss protection for each starter, with contacts to de-energize the starter upon loss of any phase.

2.5 VARIABLE SPEED MOTOR CONTROLLERS

- A. Shall be in accordance with applicable portions of 2.1 above.

- B. Shall be solid state, micro processor-based with adjustable frequency and voltage, three phase output capable of driving standard NEMA B design, three phase alternating current induction motors at full rated speed. The drives shall utilize a full wave bridge design incorporating diode rectifier circuitry with pulse width modulation (PWM). Other control techniques are not acceptable. Silicon controlled rectifiers (SCR) shall not be used in the rectifying circuitry. The drives shall be designed to be used on variable torque loads and shall be capable of providing sufficient torque to allow the motor to break away from rest upon first application of power.
- C. Unit shall be capable of operating within voltage parameters of plus 10 to minus 10 percent of line voltage, and be suitably rated for the full load amps of the maximum watts (HP) within its class.
- D. Operating and Design Conditions:
- Elevation: 2500 feet AMSL
 - Temperatures: Maximum +90°F, Minimum -10°F
 - Relative Humidity: 95%
 - Drive Location: Air conditioned Building
- E. Controllers shall have the following features:
1. Isolated power for control circuits.
 2. Manually re-settable motor overload protection for each phase.
 3. Adjustable current limiting circuitry to provide soft motor starting. Maximum starting current shall not exceed 200 percent of motor full load current.
 4. Independent acceleration and deceleration time adjustment, manually adjustable from 2 to 30 seconds. (Set timers to the equipment manufacturer's recommended time in the above range.)
 5. Provide 4 to 20 ma current follower circuitry for interface with mechanical sensor devices.
 6. Automatic frequency adjustment from 20 Hz to 60 Hz.
 7. Provide circuitry to initiate an orderly shutdown when any of the conditions listed below occur. The controller shall not be damaged by any of these electrical disturbances and shall automatically restart when the conditions are corrected. The drive shall be able to restart into a rotating motor operating in either the forward or reverse direction and matching that frequency.
 - a. Incorrect phase sequence.

- b. Single phasing.
 - c. Over voltage in excess of 10 percent.
 - d. Under voltage in excess of 10 percent.
 - e. Running over current above 110 percent (shall not automatically reset for this condition.)
 - f. Instantaneous overcurrent above 150 percent (shall not automatically reset for this condition).
 - g. Surge voltage in excess of 1000 volts.
 - h. Short duration power outages of 12 cycles or less (i.e., distribution line switching, generator testing, and automatic transfer switch operations.)
8. Automatic Reset/Restart: Attempt three restarts after drive fault or on return of power after an interruption and before shutting down for manual reset or fault correction; adjustable delay time between restart attempts.
9. Power-Interruption Protection: To prevent motor from re-energizing after a power interruption until motor has stopped, unless "Bidirectional Autospeed Search" feature is available and engaged.
10. Bidirectional Autospeed Search: Capable of starting VFC into rotating loads spinning in either direction and returning motor to set speed in proper direction, without causing damage to drive, motor, or load.
- F. Minimum efficiency shall be 95 percent at 100 percent speed and 85percent at 50 percent speed.
- G. The displacement power factor of the controller shall not be less than 95 percent under any speed or load condition.
- H. Controllers shall include a door interlocked fused safety disconnect switch or door interlocked circuit breaker switch which will disconnect all input power.
- I. Controller shall include a 3% line reactor, and RFI/EMI filter.
- J. The following accessories are to be door mounted:
- 1. AC Power on light.
 - 2. Ammeter (RMS motor current).
 - 3. HAND-OFF-AUTOMATIC switch.
 - 4. Manual speed control in HAND mode.
 - 5. System protection lights indicating that the system has shutdown and will not automatically restart.

6. System protection light indicating that the system has shutdown but will restart when conditions return to normal.
 7. Manual variable speed controller by-pass switch.
 8. Diagnostic shutdown indicator lights for each shutdown condition.
 9. Provide two N.O. and two N.C. dry contacts rated 120 volts, 10 amperes, 60 HZ for remote indication of the following:
 - a. System shutdown with auto restart.
 - b. System shutdown without auto restart.
 - c. System running.
 10. Incorporate into each control circuit a 120-volt, time delay relay (ON delay), adjustable from 0.3-10 minutes, with transient protection. Provide transformer/s for the control circuit/s.
 11. Controller shall not add any current or voltage transients to the input AC power distribution system nor shall transients from other devices on the AC power distribution system affect the controller. Controllers shall be protected to comply with IEEE C37.90.1 and UL-508. Line noise and harmonic voltage distortion shall not exceed the values allowed by IEEE 519.
- K. Hardware and software to enable the BAS to monitor, control, and display controller status and alarms.
- L. Network Communications Ports: Ethernet and RS-422/485.
- M. Embedded BAS Protocols for Network Communications: As specified in Division 22.
- N. Bypass Operation: Manually transfers motor between power converter output and bypass circuit, manually, automatically, or both. Unit is capable of stable operation (starting, stopping, and running) with motor completely disconnected from power converter. Transfer between power converter and bypass contactor and retransfer shall only be allowed with the motor at zero speed.
- O. Bypass Controller: Provide contactor-style bypass, arranged to isolate the power converter input and output and permit safe testing of the power converter, both energized and de-energized, while motor is operating in bypass mode. Motor overload protection shall be provided.
1. Bypass Contactor: Load-break NEMA-rated contactor.
 2. Input and Output Isolating Contactors: Non-load-break, NEMA-rated contactors.
 3. Isolating Switch: Non-load-break switch arranged to isolate power converter and permit safe troubleshooting and testing of the power

converter, both energized and de-energized, while motor is operating in bypass mode; pad-lockable, door-mounted handle mechanism.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Install motor control equipment in accordance with manufacturer's recommendations, the NEC, NEMA and as shown on the drawings.
- B. Furnish and install heater elements in motor starters and to match the installed motor characteristics. Submit a list of all motors listing motor nameplate rating and heater element installed.
- C. Motor Data: Provide neatly-typed label inside each motor starter enclosure door identifying motor served, nameplate horsepower, full load amperes, code letter, service factor, voltage/phase rating and heater element installed.
- D. Connect hand-off auto selector switches so that automatic control only is by-passed in "manual" position and any safety controls are not by-passed.
- E. Install manual motor starters in flush enclosures in finished areas.
- F. Examine control diagrams indicated before ordering motor controllers. Should conflicting data exist in specifications, drawings and diagrams, request corrected data prior to placing orders.

3.2 ADJUSTING

- A. Set field-adjustable switches, auxiliary relays, time-delay relays, timers, and overload-relay pickup and trip ranges.
- B. Adjust overload-relay heaters or settings if power factor correction capacitors are connected to the load side of the overload relays.
- C. Adjust trip settings of MCPs and thermal-magnetic circuit breakers with adjustable instantaneous trip elements. Initially adjust at six times the motor nameplate full-load ampere ratings and attempt to start motors several times, allowing for motor cooldown between starts. If tripping occurs on motor inrush, adjust settings in increments until motors start without tripping. Do not exceed eight times the motor full-load amperes (or 11 times for NEMA Premium Efficient motors if required). Where these maximum settings do not allow starting of a motor, notify COTR before increasing settings.
- D. Set the taps on reduced-voltage autotransformer controllers at 80 percent.
- E. In reduced-voltage solid-state controllers, set field-adjustable switches and program microprocessors for required start and stop sequences.

3.3 ACCEPTANCE CHECKS AND TESTS

A. Perform in accordance with the manufacturer's recommendations. Include the following visual and mechanical inspections and electrical tests:

1. Visual and Mechanical Inspection

- a. Compare equipment nameplate data with specifications and approved shop drawings.
- b. Inspect physical, electrical, and mechanical condition.
- c. Inspect contactors.
- d. Clean motor starters and variable speed motor controllers.
- e. Verify overload element ratings are correct for their applications.
- f. If motor-running protection is provided by fuses, verify correct fuse rating.
- g. Verify tightness of accessible bolted electrical connections by calibrated torque-wrench method in accordance with manufacturer's published data.

2. Variable speed motor controllers:

- a. Final programming and connections to variable speed motor controllers shall be by a factory-trained technician. Set all programmable functions of the variable speed motor controllers to meet the requirements and conditions of use.
- b. Test all control and safety features of the variable frequency drive.

3.4 FOLLOW-UP VERIFICATION

Upon completion of acceptance checks, settings, and tests, the Contractor shall show by demonstration in service that the motor starters and variable speed motor controllers are in good operating condition and properly performing the intended functions.

3.5 SPARE PARTS

Two weeks prior to the final inspection, provide one complete set of spare fuses (including heater elements) for each starter/controller installed on this project.

- - - E N D - - -

SECTION 26 29 21
DISCONNECT SWITCHES

PART 1 - GENERAL

1.1 DESCRIPTION

This section specifies the furnishing, installation, and connection of low voltage disconnect switches.

1.2 RELATED WORK

- A. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: General electrical requirements and items that are common to more than one section of Division 26.
- B. Section 26 05 21, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES 600 VOLTS AND BELOW: Cables and wiring.
- C. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS: Requirements for personnel safety and to provide a low impedance path for possible ground faults.
- D. Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS: Conduits for cables and wiring.
- E. Section 26 29 11, LOW-VOLTAGE MOTOR STARTERS: Motor rated toggle switches.

1.3 QUALITY ASSURANCE

Refer to Paragraph, QUALIFICATIONS, in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

1.4 SUBMITTALS

- A. Submit in accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
- B. Shop Drawings:
 - 1. Clearly present sufficient information to determine compliance with drawings and specifications.
 - 2. Include electrical ratings, dimensions, mounting details, materials, enclosure types, and fuse types and classes.
 - 3. Show the specific switch and fuse proposed for each specific piece of equipment or circuit.
- C. Manuals:
 - 1. Provide complete maintenance and operating manuals for disconnect switches, including technical data sheets, wiring diagrams, and information for ordering replacement parts. Deliver four copies to the COTR two weeks prior to final inspection.

2. Terminals on wiring diagrams shall be identified to facilitate maintenance and operation.
3. Wiring diagrams shall indicate internal wiring and any interlocking.
- D. Certifications: Two weeks prior to the final inspection, submit four copies of the following certifications to the COTR:
 1. Certification by the manufacturer that the materials conform to the requirements of the drawings and specifications.
 2. Certification by the contractor that the materials have been properly installed, connected, and tested.

1.5 APPLICABLE PUBLICATIONS

- A. Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by designation only.
- B. National Electrical Manufacturers Association (NEMA):
 - FU 1-07.....Low Voltage Cartridge Fuses
 - KS 1-06.....Enclosed and Miscellaneous Distribution Equipment Switches (600 Volts Maximum)
- C. National Fire Protection Association (NFPA):
 - 70-08.....National Electrical Code (NEC)
- D. Underwriters Laboratories, Inc. (UL):
 - 98-04.....Enclosed and Dead-Front Switches
 - 248-00.....Low Voltage Fuses
 - 977-94.....Fused Power-Circuit Devices

PART 2 - PRODUCTS

2.1 LOW VOLTAGE FUSIBLE SWITCHES RATED 600 AMPERES AND LESS

- A. In accordance with UL 98, NEMA KS1, and NEC.
- B. Shall have NEMA classification General Duty (GD) for 240 V switches and NEMA classification Heavy Duty (HD) for 480 V switches.
- C. Shall be HP rated.
- D. Shall have the following features:
 1. Switch mechanism shall be the quick-make, quick-break type.
 2. Copper blades, visible in the OFF position.
 3. An arc chute for each pole.
 4. External operating handle shall indicate ON and OFF position and have lock-open padlocking provisions.
 5. Mechanical interlock shall permit opening of the door only when the switch is in the OFF position, defeatable to permit inspection.

6. Fuse holders for the sizes and types of fuses specified.
7. Solid neutral for each switch being installed in a circuit which includes a neutral conductor.
8. Ground lugs for each ground conductor.
9. Enclosures:
 - a. Shall be the NEMA types shown on the drawings for the switches.
 - b. Where the types of switch enclosures are not shown, they shall be the NEMA types most suitable for the ambient environmental conditions. Unless otherwise indicated on the plans, all outdoor switches shall be NEMA 3R.
 - c. Shall be finished with manufacturer's standard gray baked enamel paint over pretreated steel (for the type of enclosure required).

2.2 LOW VOLTAGE UNFUSED SWITCHES RATED 600 AMPERES AND LESS

Shall be the same as Low Voltage Fusible Switches Rated 600 Amperes and Less, but without provisions for fuses.

2.3 LOW VOLTAGE FUSIBLE SWITCHES RATED OVER 600 AMPERES TO 1200 AMPERES

Shall be the same as Low Voltage Fusible Switches Rated 600 Amperes and Less, except for the minimum duty rating which shall be NEMA classification Heavy Duty (HD). These switches shall also be HP rated.

2.4 MOTOR RATED TOGGLE SWITCHES

Refer to Section 26 29 11, LOW-VOLTAGE MOTOR STARTERS.

2.5 LOW VOLTAGE CARTRIDGE FUSES

- A. In accordance with NEMA FU1.
- B. Service Entrance: Class RK1, time delay.
- C. Feeders: Class RK5, time delay.
- D. Motor Branch Circuits: Class RK5, time delay.
- E. Other Branch Circuits: Class RK5, time delay time delay.
- F. Control Circuits: Class CC, fast acting.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Install disconnect switches in accordance with the NEC and as shown on the drawings.
- B. Fusible disconnect switches shall be furnished complete with fuses. Arrange fuses such that rating information is readable without removing the fuse.

3.2 SPARE PARTS

Two weeks prior to the final inspection, furnish one complete set of spare fuses for each fusible disconnect switch installed on the project. Deliver the spare fuses to the COTR.

- - - E N D - - -

**SECTION 26 41 00
FACILITY LIGHTNING PROTECTION**

PART 1 - GENERAL

1.1 DESCRIPTION

This section specifies the furnishing and installation of a complete master labeled lightning protection system, complying with NFPA 780, UL 96 and UL 96A.

1.2 RELATED WORK

- A. Section 07 60 00, FLASHING AND SHEET METAL: penetrations through the roof.
- B. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: General electrical requirements that are common to more than one section of Division 26.
- C. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS: Requirements for personnel safety and to provide a low impedance path to ground for possible ground faults.

1.3 QUALITY ASSURANCE

Refer to Paragraph, QUALIFICATIONS, in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

1.4 SUBMITTALS

- A. In accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS, submit the following:
- B. Shop Drawings:
 - 1. Isometric and plan views showing layout and connections to the required metal surfaces.
 - 2. Show the methods of mounting the system to the adjacent construction.
- C. Qualifications: Submit proof that the installer of the lightning protection system is a certified Lightning Protection Institute (LPI) installer, and has had suitable and adequate experience installing other lightning protection systems, and is capable of installing the system as recommended by the manufacturer of the equipment.
- D. Certification: Two weeks prior to final inspection, submit four copies of the following certifications to the Contracting Officer's Technical Representative (COTR):
 - 1. Certification that the lightning protection system has been properly installed and tested.

2. Certification that the lightning protection system has been inspected by a UL representative and has been approved by UL without variation.

1.5 APPLICABLE PUBLICATIONS

- A. Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by designation only.
- B. National Fire Protection Association (NFPA):
 - 70.....National Electrical Code (NEC)
 - 780.....Standard for the Installation of Lightning Protection Systems
- C. Underwriters Laboratories, Inc. (UL):
 - 96.....Lightning Protection Components
 - 96A.....Installation Requirements for Lightning Protection Systems
 - UL 467Standard for Grounding and Bonding Equipment

PART 2 - PRODUCTS

2.1 MATERIALS

- A. Attach master labels to each item by its manufacturer as evidence that the materials have been manufactured in conformance with the UL Standards for master label lightning protection materials.
- B. In addition to conformance to UL 96, the component material requirements are as follows:
 1. Conductors: Electrical grade copper. Conductors shall be in accordance with NFPA 780 and UL 96 for Class I, Class II, or Class II modified materials as applicable.
 2. Air terminals: Solid copper, 18 inches long, not less than 3/8 inch [9mm] diameter, with sharp nickel-plated points.
 3. Ground rods: Copper clad steel, not less than 1/2 inch [13mm] diameter by 10 feet [2400mm] long. Rods made of copper-clad steel shall conform to UL 467 and galvanized ferrous rods shall conform to IEEE C135.30. Ground rods of copper-clad steel, steel, stainless steel, galvanized ferrous, and solid copper shall not be mixed on the project.
 4. Ground plates: Solid copper, not less than 1/16 inch [2mm] thick.
 5. Tubing: Stiff copper or brass.

- C. Anchors and fasteners: Bolt type which are most suitable for the specific anchor and fastener installations. Clamp-type connectors for splicing conductors shall conform to UL 96, class as applicable, and, Class 2, style and size as required for the installation. Clamp-type connectors shall only be used for the connection of the roof conductor to the air terminal and to the guttering. All other connections, bonds, and splices shall be done by exothermic welds or by high compression fittings. The exothermic welds and high compression fittings shall be listed for the purpose. The high compression fittings shall be the type which require a hydraulically operated mechanism to apply a minimum of 10,000 psi.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Installation shall be coordinated with the roofing manufacturer and installer.
- B. Install the conductors as inconspicuously as practical and with the proper bends.
- C. Install the vertical conductors within the concealed cavity of exterior walls. Run the conductors to the exterior at elevations below the finished grade and make the ground connections to the earth outside of the building or stack perimeter.
- D. Make connections of dissimilar metal with bimetallic type fittings to prevent electrolytic action.
- E. Use the exothermic welding type connections that form solid metal joints in the main vertical and horizontal conductors, and for connections that are not exposed in the finish work.
- F. Protect copper conductors with stiff copper or brass tubing, which enclose the conductors from the top to the bottom of the tubing, between one foot [300mm] below and seven feet [2100mm] above the finished grade. The conductor shall be bonded to the top and bottom of the tubing.
- G. Sheath copper conductors, which pass over cast stone, cut stone, architectural concrete and masonry surfaces, with not less than a 1/16 inch [2mm] thickness of lead to prevent staining of the exterior finish surfaces.
- H. For the earth connections, install ground rods and ground plates, and the conductor connections to them and the main water pipes in the presence of the COTR. For the conductors located outside of the

- building or stack, install the conductors not less than two feet [600mm] below the finished grade.
- I. For structural steel buildings, connect the steel framework of the buildings to the main water pipe near the water system entrance to the building.
 - J. Connect lightning protection cables to all metallic projections, equipment, and components above the roof as indicated on the drawings.
 - K. Connect exterior metal surfaces, located within three feet [900mm] of the lightning protection system conductors, to the lightning protection system conductors to prevent flashovers.
 - L. Maintain horizontal or downward coursing of main conductor and insure that all bends have at least an 8-inch radius and do not exceed 90 degrees.
 - M. Conductors shall be rigidly fastened every three feet [900mm] along the roof and down to the building to ground.
 - N. Air terminals shall be secured against overturning either by attachment to the object to be protected or by means of a substantial tripod or other braces permanently and rigidly attached to the building or structure. Install air terminal bases, cable holders and other roof-system supporting means without piercing roof metal.
 - O. Use clamp supports to secure supporting means to roof standing seams only.
 - P. Use through-roof connectors for down-conductor attachment to roof system. Provide flashing in accordance with Section 07 60 00, FLASHING AND SHEET METAL.
 - Q. Down-conductors coursed on or in reinforced concrete columns or on structural steel columns shall be connected to the reinforcing steel or the structural steel member at its upper and lower extremities. In the case of long vertical members an additional connection shall be made at intervals not exceeding 100 feet [30m].
 - R. A counterpoise, where shown, shall be of No. 1/0 copper cable or equivalent material having suitable resistance to corrosion and shall be laid around the perimeter of the structure in a trench not less than 2 feet [600mm] deep at a distance not less than 3 feet [900mm] nor more than 8 feet [2.5m] from the nearest point of the structure.
 - S. On construction utilizing post tensioning systems to secure precast concrete sections, the post tension rods shall not be used as a path for lightning to ground. Down conductors shall be provided on structures

using post tensioning systems. Down conductors shall have sufficient separation from post tension rods to prevent side-flashing. Post tension rods shall be bonded to the lightning protection and grounding systems only at the base of the structure; this bonding shall be performed in strict accordance with the recommendations of the post tension rod manufacturer, and shall be done by, or in the presence of, a representative of the manufacturer.

- T. Grounding: Test the ground resistance to earth by standard methods and conform to the ground resistance requirements specified in Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS.
- U. Where shown, use the structural steel framework or reinforcing steel as the main conductor:
 - 1. Weld or bond the non-electrically-continuous sections together and make them electrically continuous.
 - 2. Verify the electrical continuity by measuring the ground resistances to earth at the ground level, at the top of the building or stack, and at intermediate points with a sensitive ohmmeter. Compare the resistance readings.
 - 3. Connect the air terminals together with an exterior conductor connected to the structural steel framework at not more than 60 foot [18m] intervals.
 - 4. Install ground connections to earth at not more than 60 foot [18m] intervals around the perimeter of the building.
 - 5. Weld or braze bonding plates, not less than 8 inches [200mm] square, to cleaned sections of the steel and connect the conductors to the plates.
 - 6. Do not pierce the structural steel in any manner. Connections to the structural steel shall conform to UL Publication No. 96A.
- V. When the lightning protection systems have been installed, have the systems inspected by a UL representative. Obtain and install a UL numbered master label for each of the lightning protection systems at the location directed by the UL representative and the COTR.

- - - E N D - - -

SECTION 26 43 13
TRANSIENT-VOLTAGE SURGE SUPPRESSION

PART 1 - GENERAL

1.1 DESCRIPTION

Section includes transient voltage surge suppression equipment for low-voltage power distribution and control equipment.

1.2 RELATED WORK

- A. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: General requirements that are common to more than one section of Division 26.
- B. Section 26 24 16, PANELBOARDS: For factory-installed TVSS.

1.3 QUALITY ASSURANCE

Refer to Paragraph, QUALIFICATIONS, in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

1.4 SUBMITTALS

- A. Include rated capacities, operating weights, electrical characteristics, furnished specialties, and accessories.
- B. Operation and Maintenance Data: For TVSS devices to include in emergency, operation, and maintenance manuals.
- C. Warranties: Sample of special warranties.
- D. Certifications:
 - 1. Two weeks prior to final inspection, submit four copies of the following to the Contracting Officer's Technical Representative (COTR):
 - a. Certification by the Contractor that the assemblies have been properly installed, adjusted and tested.
 - b. Certified copies of all of the factory design and production tests, field test data sheets and reports for the assemblies.

1.5 APPLICABLE PUBLICATIONS

Publications listed below (including amendments, addenda, revisions, supplement and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by the basic designation only.

- A. Institute of Engineering and Electronic Engineers (IEEE):

- IEEE C62.41.2.....Recommended Practice on Characterization
of Surges in Low-Voltage (1000 V and
Less) AC Power Circuits
- IEEE C62.45.....Recommended Practice on Surge Testing for
Equipment Connected to Low-Voltage (1000
V and Less) AC Power Circuits
- B. National Electrical Manufacturers Association (NEMA):
NEMA LS 1.....Low Voltage Surge Protective Devices
- C. Underwriters Laboratories, Inc. (UL):
UL 1283.....Electromagnetic Interference Filters
UL 1449.....Surge Protective Devices
- D. National Fire Protection Association (NFPA):
NFPA 70.....National Electrical Code (NEC)

PART 2 - PRODUCTS

2.1 SWITCHGEAR/SWITCHBOARD SUPPRESSORS

A. Surge Protection Devices:

1. Comply with UL 1449.
2. Non-modular design.
3. Fuses, rated at 200-kA interrupting capacity.
4. Fabrication using bolted compression lugs for internal wiring.
5. Integral disconnect switch.
6. Redundant suppression circuits.
7. Redundant replaceable modules.
8. Arrangement with copper bus bars and for bolted connections to phase buses, neutral bus, and ground bus.
9. Arrangement with wire connections to phase buses, neutral bus, and ground bus.
10. LED indicator lights for power and protection status.
11. Audible alarm, with silencing switch, to indicate when protection has failed.
12. Form-C contacts rated at 5 A and 250-V ac, one normally open and one normally closed, for remote monitoring of protection status.
Contacts shall reverse on failure of any surge diversion module or on opening of any current-limiting device. Coordinate with building power monitoring and control system.
13. Four-digit transient-event counter set to totalize transient surges.

- B. Peak Single-Impulse Surge Current Rating: 240 kA per mode/480 kA per phase.
- C. Minimum single impulse current ratings, using 8-by-20-mic.sec waveform described in IEEE C62.41.2
 - 1. Line to Neutral: 70,000 A.
 - 2. Line to Ground: 70,000 A.
 - 3. Neutral to Ground: 50,000 A.
- D. Protection modes and UL 1449 SVR for grounded wye circuits shall be as follows:
 - 1. Line to Neutral: 800 V for 480Y/277 V, 400 V for 208Y/120 V.
 - 2. Line to Ground: 800 V for 480Y/277 V, 400 V for 208Y/120 V.
 - 3. Neutral to Ground: 800 V for 480Y/277 V, 400 V for 208Y/120 V.

2.2 PANELBOARD SUPPRESSORS

- A. Surge Protection Devices:
 - 1. Non-modular.
 - 2. LED indicator lights for power and protection status.
 - 3. Audible alarm, with silencing switch, to indicate when protection has failed.
- B. Peak Single-Impulse Surge Current Rating: 120 kA per mode/240 kA per phase.
- C. Minimum single impulse current ratings, using 8-by-20-mic.sec waveform described in IEEE C62.41.2:
 - 1. Line to Neutral: 70,000 A.
 - 2. Line to Ground: 70,000A.
 - 3. Neutral to Ground: 50,000A.
- D. Protection modes and UL 1449 SVR for grounded wye circuits shall be as follows:
 - 1. Line to Neutral: 800 V for 480Y/277 V, 400 V for 208Y/120 V.
 - 2. Line to Ground: 800 V for 480Y/277 V, 400 V for 208Y/120 V.
 - 3. Neutral to Ground: 800 V for 480Y/277 V, 400 V for 208Y/120 V.

2.3 ENCLOSURES

- A. Indoor Enclosures: NEMA Type 1.

PART 3 - EXECUTION**3.1 INSTALLATION**

- A. Install TVSS devices at panelboard on load side, with ground lead bonded to service entrance ground.
- B. Install TVSS devices for panelboards and auxiliary panels with conductors or buses between suppressor and points of attachment as short and straight as possible. Do not exceed manufacturer's recommended lead length. Do not bond neutral and ground.
 - 1. Provide a circuit breaker, sized by manufacturer, as a dedicated disconnecting means for TVSS unless otherwise shown on drawings.

3.2 ACCEPTANCE CHECKS AND TESTS

- A. Perform in accordance with the manufacturer's recommendations. Include the following visual and mechanical inspections and electrical tests:
 - 1. Visual and Mechanical Inspection
 - a. Compare equipment nameplate data with specifications and approved shop drawings.
 - b. Inspect physical, electrical, and mechanical condition.
 - c. Verify that disconnecting means and feeder size and maximum to TVSS unit correspond to approved shop drawings.
 - d. Verifying tightness of accessible bolted electrical connections by calibrated torque-wrench method.
 - e. Clean TVSS unit.
 - f. Complete startup checks according to manufacturer's written instructions.
 - g. Verify the correct operation of all sensing devices, alarms, and indicating devices.

3.3 STARTUP

- A. Do not energize or connect panelboards to their sources until TVSS devices are installed and connected.
- B. Do not perform insulation resistance tests of the distribution wiring equipment with the TVSS installed. Disconnect before conducting

insulation resistance tests, and reconnect immediately after the testing is over.

3.4 SPARE PARTS

A. Furnish extra materials that match products installed and that are packaged with protective covering for storage and identified with labels describing contents.

1. Replaceable Protection Modules: One of each size and type installed.

3.5 INSTRUCTION

Provide factory certified technician to train Government maintenance personnel to maintain TVSS devices. Training shall be provided for a total period of 4 hours of normal working time and shall start after the system is functionally complete but prior to final acceptance test. Training shall cover all essential items contained in the operation and maintenance manual.

- - -END OF SECTION - - -

SECTION 26 51 00
INTERIOR LIGHTING

PART 1 - GENERAL

1.1 DESCRIPTION:

This section specifies the furnishing, installation and connection of the interior lighting systems.

1.2 RELATED WORK

- A. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: General requirements that are common to more than one section of Division 26.
- B. Section 26 05 21, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES (600 VOLTS AND BELOW): Cables and wiring.
- C. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS: Requirements for personnel safety and to provide a low impedance path to ground for possible ground fault currents.
- D. Section 26 27 26, WIRING DEVICES: Wiring devices used for control of the lighting systems.

1.3 QUALITY ASSURANCE

Refer to Paragraph, QUALIFICATIONS, in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

1.4 SUBMITTALS

- A. In accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS, submit the following:
- B. Product Data: For each type of lighting fixture (luminaire) designated on the LIGHTING FIXTURE SCHEDULE, arranged in order of fixture designation, submit the following information.
 - 1. Material and construction details include information on housing, optics system and lens/diffuser.
 - 2. Physical dimensions and description.
 - 3. Wiring schematic and connection diagram.
 - 4. Installation details.
 - 5. Energy efficiency data.
 - 6. Photometric data based on laboratory tests complying with IESNA Lighting Measurements, testing and calculation guides.
 - 7. Lamp data including lumen output (initial and mean), color rendition index (CRI), rated life (hours) and color temperature (degrees Kelvin).

8. Ballast data including ballast type, starting method, ambient temperature, ballast factor, sound rating, system watts and total harmonic distortion (THD).
- C. Manuals:
1. Submit, simultaneously with the shop drawings companion copies of complete maintenance and operating manuals including technical data sheets, and information for ordering replacement parts.
 2. Two weeks prior to the final inspection, submit four copies of the final updated maintenance and operating manuals, including any changes, to the Contracting Officer's Technical Representative (COTR).
- D. Certifications:
1. Two weeks prior to final inspection, submit four copies of the following certifications to the COTR:
 - a. Certification by the Contractor that the equipment has been properly installed, adjusted, and tested.

1.5 APPLICABLE PUBLICATIONS

- A. Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by designation only.
- B. Institute of Electrical and Electronic Engineers (IEEE):
- C62.41-91.....Guide on the Surge Environment in Low Voltage
(1000V and less) AC Power Circuits
- C. National Fire Protection Association (NFPA):
- 70.....National Electrical Code (NEC)
- 101.....Life Safety Code
- D. National Electrical Manufacturer's Association (NEMA):
- C82.1-97.....Ballasts for Fluorescent Lamps - Specifications
- C82.2-02.....Method of Measurement of Fluorescent Lamp
Ballasts
- C82.4-02.....Ballasts for High-Intensity-Discharge and Low-
Pressure Sodium Lamps
- C82.11-02.....High Frequency Fluorescent Lamp Ballasts
- E. Underwriters Laboratories, Inc. (UL):
- 496-96.....Edison-Base Lampholders
- 542-99.....Lampholders, Starters, and Starter Holders for
Fluorescent Lamps

844-95.....Electric Lighting Fixtures for Use in Hazardous
(Classified) Locations

924-95.....Emergency Lighting and Power Equipment

935-01.....Fluorescent-Lamp Ballasts

1029-94.....High-Intensity-Discharge Lamp Ballasts

1029A-06.....Ignitors and Related Auxiliaries for HID Lamp
Ballasts

1598-00.....Luminaires

1574-04.....Standard for Track Lighting Systems

2108-04.....Standard for Low-Voltage Lighting Systems

8750-08.....Light Emitting Diode (LED) Light Sources for
Use in Lighting Products

F. Federal Communications Commission (FCC):

Code of Federal Regulations (CFR), Title 47, Part 18

PART 2 - PRODUCTS

2.1 LIGHTING FIXTURES (LUMINAIRES)

- A. Shall be in accordance with NFPA 70 and UL 1598, as shown on drawings, and as specified.
- B. Sheet Metal:
 - 1. Shall be formed to prevent warping and sagging. Housing, trim and lens frame shall be true, straight (unless intentionally curved) and parallel to each other as designed.
 - 2. Wireways and fittings shall be free of burrs and sharp edges and shall accommodate internal and branch circuit wiring without damage to the wiring.
 - 3. When installed, any exposed fixture housing surface, trim frame, door frame and lens frame shall be free of light leaks; lens doors shall close in a light tight manner.
 - 4. Hinged door closure frames shall operate smoothly without binding when the fixture is in the installed position, latches shall function easily by finger action without the use of tools.
- C. Ballasts shall be serviceable while the fixture is in its normally installed position, and shall not be mounted to removable reflectors or wireway covers unless so specified.
- D. Lamp Sockets:
 - 1. Fluorescent: Lampholder contacts shall be the biting edge type or phosphorous-bronze with silver flash contact surface type and shall conform to the applicable requirements of UL 542. Lamp holders for

bi-pin lamps shall be of the telescoping compression type, or of the single slot entry type requiring a one-quarter turn of the lamp after insertion.

- E. Recessed fixtures mounted in an insulated ceiling shall be listed for use in insulated ceilings.
- F. Mechanical Safety: Lighting fixture closures (lens doors, trim frame, hinged housings, etc.) shall be retained in a secure manner by captive screws, chains, captive hinges or fasteners such that they cannot be accidentally dislodged during normal operation or routine maintenance.
- G. Metal Finishes:
 - 1. The manufacturer shall apply standard finish (unless otherwise specified) over a corrosion resistant primer, after cleaning to free the metal surfaces of rust, grease, dirt and other deposits. Edges of pre-finished sheet metal exposed during forming, stamping or shearing processes shall be finished in a similar corrosion resistant manner to match the adjacent surface(s). Fixture finish shall be free of stains or evidence of rusting, blistering, or flaking, and shall be applied after fabrication.
 - 2. Interior light reflecting finishes shall be white with not less than 85 percent reflectances, except where otherwise shown on the drawing.
 - 3. Exterior finishes shall be as shown on the drawings.
- H. Lighting fixtures shall have a specific means for grounding metallic wireways and housings to an equipment grounding conductor.
- I. Light Transmitting Components for Fluorescent Fixtures:
 - 1. Shall be 100 percent virgin acrylic.
 - 2. Flat lens panels shall have not less than 1/8 inch [3.2mm] of average thickness. The average thickness shall be determined by adding the maximum thickness to the minimum unpenetrated thickness and dividing the sum by 2.
 - 3. Unless otherwise specified, lenses, diffusers and louvers shall be retained firmly in a metal frame by clips or clamping ring in such a manner as to allow expansion and contraction of the lens without distortion or cracking.
- J. Lighting fixtures in hazardous areas shall be suitable for installation in Class and Group areas as defined in NFPA 70, and shall comply with UL 844.

- K. Compact fluorescent fixtures shall be manufactured specifically for compact fluorescent lamps with ballast integral to the fixture. Assemblies designed to retrofit incandescent fixtures are prohibited except when specifically indicated for renovation of existing fixtures (not the lamp). Fixtures shall be designed for lamps as specified.

2.2 BALLASTS

- A. Linear Fluorescent Lamp Ballasts: Multi-voltage (120 - 277V) electronic instant-start type, complying with UL 935 and with ANSI C 82.11, designed for type and quantity of lamps indicated. Ballast shall be designed for full light output unless dimmer or bi-level control is indicated; including the following features:
1. Lamp end-of-life detection and shutdown circuit (T5 lamps only).
 2. Automatic lamp starting after lamp replacement.
 3. Sound Rating: Class A.
 4. Total Harmonic Distortion Rating: 10 percent or less.
 5. Transient Voltage Protection: IEEE C62.41.1 and IEEE C62.41.2, Category A or better.
 6. Operating Frequency: 20 kHz or higher.
 7. Lamp Current Crest Factor: 1.7 or less.
 8. Ballast Factor: 0.87 or higher unless otherwise indicated.
 9. Power Factor: 0.98 or higher.
 10. Interference: Comply with 47 CFT 18, Ch.1, Subpart C, for limitations on electromagnetic and radio-frequency interference for non-consumer equipment.
 11. To facilitate multi-level lamp switching, lamps within fixture shall be wired with the outermost lamp at both sides of the fixture on the same ballast, the next inward pair on another ballast and so on to the innermost lamp (or pair of lamps). Within a given room, each switch shall uniformly control the same corresponding lamp (or lamp pairs) in all fixture units that are being controlled.
 12. Where three-lamp fixtures are indicated, unless switching arrangements dictate otherwise, utilize a common two-lamp ballast to operate the center lamp in pairs of adjacent units that are mounted in a continuous row. The ballast fixture and slave-lamp fixture shall be factory wired with leads or plug devices to facilitate this circuiting. Individually mounted fixtures and the odd fixture in a row shall utilize a single-lamp ballast for operation of the center lamp.

13. Dimming ballasts shall be as per above, except dimmable from 100% to 5% of rated lamp lumens.

- B. Compact Fluorescent Lamp Ballasts: Multi-voltage (120 - 277V), electronic-programmed rapid-start type, complying with UL 935 and with ANSI C 82.11, designed for type and quantity of lamps indicated. Ballast shall be designed for full light output unless dimmer or bi-level control is indicated; including the following features:
1. Lamp end-of-life detection and shutdown circuit.
 2. Automatic lamp starting after lamp replacement.
 3. Sound Rating: Class A.
 4. Total Harmonic Distortion Rating: 10 percent or less.
 5. Transient Voltage Protection: IEEE C62.41.1 and IEEE C62.41.2, Category A or better.
 6. Operating Frequency: 20 kHz or higher.
 7. Lamp Current Crest Factor: 1.7 or less.
 8. Ballast Factor: 0.95 or higher unless otherwise indicated.
 9. Power Factor: 0.98 or higher.
 10. Interference: Comply with 47 CFR 18, Ch. 1, Subpart C, for limitations on electromagnetic and radio-frequency interference for non-consumer equipment.
 11. Dimming ballasts shall be as per above, except dimmable from 100% to 5% of rated lamp lumens.

2.3 LAMPS

- A. Linear and U-shaped T5 and T8 Fluorescent Lamps:
1. Rapid start fluorescent lamps shall comply with ANSI C78.1; and instant-start lamps shall comply with ANSI C78.3.
 2. Chromacity of fluorescent lamps shall comply with ANSI C78.376.
 3. Except as indicated below, lamps shall be low-mercury energy saving type, have a color temperature between 3500° and 4100°K, a Color Rendering Index (CRI) of greater than 70, average rated life of 20,000 hours, and be suitable for use with dimming ballasts, unless otherwise indicated. Low mercury lamps shall have passed the EPA Toxicity Characteristic Leachate Procedure (TCLP) for mercury by using the lamp sample preparation procedure described in NEMA LL 1.
- B. Compact Fluorescent Lamps:
1. T4, CRI 80 (minimum), color temperature 3500 K, and suitable for use with dimming ballasts, unless otherwise indicated.

C. Long Twin-Tube Fluorescent Lamps:

1. T5, CRI 80 (minimum), color temperature between 3500° and 4100°K, 20,000 hours average rated life.

2.4 EXIT LIGHT FIXTURES

A. Exit light fixtures shall meet applicable requirements of NFPA 101 and UL 924.

B. Housing and Canopy:

1. Shall be made of die-cast aluminum.
2. Optional steel housing shall be a minimum 20 gauge thick or equivalent strength aluminum.
3. Steel housing shall have baked enamel over corrosion resistant, matte black or ivory white primer.

C. Door frame shall be cast or extruded aluminum, and hinged with latch.

D. Finish shall be satin or fine-grain brushed aluminum.

E. There shall be no radioactive material used in the fixtures.

F. Fixtures:

1. Maximum fixture wattage shall be 1 watt or less.
2. Inscription panels shall be cast or stamped aluminum a minimum of 0.090 inch [2.25mm] thick, stenciled with 6 inch [150mm] high letters, baked with red color stable plastic or fiberglass. Lamps shall be luminous Light Emitting Diodes (LED) mounted in center of letters on red color stable plastic or fiberglass. The LED shall be rated minimum 25 years life.
3. Double-Faced Fixtures: Provide double-faced fixtures where required or as shown on drawings.
4. Directional Arrows: Provide directional arrows as part of the inscription panel where required or as shown on drawings. Directional arrows shall be the "chevron-type" of similar size and width as the letters and meet the requirements of NFPA 101.

G. Voltages: Refer to Lighting Fixture Schedule.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Installation shall be in accordance with the NEC, manufacturer's instructions and as shown on the drawings or specified.
- B. Align, mount and level the lighting fixtures uniformly.
- C. Fluorescent bed light fixtures shall be attached to the studs in the walls. Attachment to gypsum board only is not acceptable.
- D. Lighting Fixture Supports:

1. Shall provide support for all of the fixtures. Supports may be anchored to channels of the ceiling construction, to the structural slab or to structural members within a partition, or above a suspended ceiling.
2. Shall maintain the fixture positions after cleaning and relamping.
3. Shall support the lighting fixtures without causing the ceiling or partition to deflect.
4. Hardware for recessed fluorescent fixtures:
 - a. Where the suspended ceiling system is supported at the four corners of the fixture opening, hardware devices shall clamp the fixture to the ceiling system structural members, or plaster frame at not less than four points in such a manner as to resist spreading of the support members and safely lock the fixture into the ceiling system.
 - b. Where the suspended ceiling system is not supported at the four corners of the fixture opening, hardware devices shall independently support the fixture from the building structure at four points.
5. Hardware for surface mounting fluorescent fixtures to suspended ceilings:
 - a. In addition to being secured to any required outlet box, fixtures shall be bolted to a grid ceiling system at four points spaced near the corners of each fixture. The bolts shall be not less than 1/4 inch [6mm] secured to channel members attached to and spanning the tops of the ceiling structural grid members. Non-turning studs may be attached to the ceiling structural grid members or spanning channels by special clips designed for the purpose, provided they lock into place and require simple tools for removal.
 - b. In addition to being secured to any required outlet box, fixtures shall be bolted to ceiling structural members at four points spaced near the corners of each fixture. Pre-positioned 1/4 inch [6mm] studs or threaded plaster inserts secured to ceiling structural members shall be used to bolt the fixtures to the ceiling. In lieu of the above, 1/4 inch [6mm] toggle bolts may be used on new or existing ceiling provided the plaster and lath can safely support the fixtures without sagging or cracking.

- E. Furnish and install the specified lamps for all lighting fixtures installed and all existing lighting fixtures reinstalled under this project.
- F. Coordinate between the electrical and ceiling trades to ascertain that approved lighting fixtures are furnished in the proper sizes and installed with the proper devices (hangers, clips, trim frames, flanges), to match the ceiling system being installed.
- G. Bond lighting fixtures and metal accessories to the grounding system as specified in Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS.
- H. Exercise electronic dimming ballasts over full range of dimming capability by operating the control devices(s) in the presence of the COTR. Observe for visually detectable flicker over full dimming range.
- I. Burn-in all lamps that require specific aging period to operate properly, prior to occupancy by Government. Burn-in period to be 40 hours minimum, unless a lesser period is specifically recommended by lamp manufacturer. Burn-in fluorescent and compact fluorescent lamps intended to be dimmed, for at least 100 hours at full voltage. Replace any lamps and ballasts which fail during burn-in.
- J. At completion of project, relamp/reballast fixtures which have failed lamps/ballasts. Clean fixtures, lenses, diffusers and louvers that have accumulated dust/dirt/fingerprints during construction. Replace damaged lenses, diffusers and louvers with new.
- K. Dispose of lamps per requirements of Section 01 74 19, CONSTRUCTION WASTE MANAGEMENT.

- - - E N D - - -

SECTION 26 56 00
EXTERIOR LIGHTING

PART 1 - GENERAL

1.1 DESCRIPTION

This section specifies the furnishing, installation, and connection of exterior luminaires, poles, and supports.

1.2 RELATED WORK

- A. Section 09 06 00, SCHEDULE FOR FINISHES: Finishes for exterior light poles and luminaires.
- B. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: General electrical requirements and items that are common to more than one section of Division 26.
- C. Section 26 05 21, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES (600 VOLTS AND BELOW): Low voltage power and lighting wiring.
- D. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS: Requirements for personnel safety and to provide a low impedance path for possible ground fault currents.
- E. Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS: Conduits, fittings, and boxes for raceway systems.
- F. Section 26 05 41, UNDERGROUND ELECTRICAL CONSTRUCTION: Underground handholes and conduits.
- G. Section 26 09 23, LIGHTING CONTROLS: Controls for exterior lighting.

1.3 QUALITY ASSURANCE

Refer to Paragraph, QUALIFICATIONS, in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

1.4 SUBMITTALS

- A. Submit in accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
- B. Shop Drawings:
 - 1. Clearly present sufficient information to determine compliance with drawings and specifications.
 - 2. Include electrical ratings, dimensions, mounting, details, materials, required clearances, terminations, wiring and connection diagrams, photometric data, ballasts, poles, luminaires, lamps, and accessories.
- C. Manuals: Two weeks prior to final inspection, submit four copies of operating and maintenance manuals to the COTR. Include technical data

sheets, wiring and connection diagrams, and information for ordering replacement lamps, ballasts, and parts.

- D. Certifications: Two weeks prior to final inspection, submit four copies of the following to the COTR:
1. Certification by the manufacturer that the materials are in accordance with the drawings and specifications.
 2. Certification by the contractor that the complete installation has been properly installed and tested.

1.5 APPLICABLE PUBLICATIONS

- A. Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by designation only.
- B. Aluminum Association Inc. (AA):
AAH35.1-06.....Alloy and Temper Designation Systems for
Aluminum
- C. American Association of State Highway and Transportation Officials (AASHTO):
LTS-5-09Structural Supports for Highway Signs,
Luminaires and Traffic Signals
- D. American Concrete Institute (ACI):
318-05Building Code Requirements for Structural
Concrete
- E. American National Standards Institute (ANSI):
C81.61-09Electrical Lamp Bases - Specifications for
Bases (Caps) for Electric Lamps
- F. American Society for Testing and Materials (ASTM):
A123/A123M-09Zinc (Hot-Dip Galvanized) Coatings on Iron and
Steel Products
A153/A153M-09.....Zinc Coating (Hot-Dip) on Iron and Steel
Hardware
B108-03a-08Aluminum-Alloy Permanent Mold Castings
C1089-06Spun Cast Prestressed Concrete Poles
- G. Federal Aviation Administration (FAA):
AC 70/7460-IK-07.....Obstruction Lighting and Marking
AC 150/5345-43F-06.....Obstruction Lighting Equipment
- H. Illuminating Engineering Society of North America (IESNA)
HB-9-00.....Lighting Handbook

- RP-8-05.....Roadway Lighting
- RP-20-98.....Lighting for Parking Facilities
- RP-33-99.....Lighting for Exterior Environments
- LM-5-96.....Photometric Measurements of Area and Sports
Lighting Installations
- LM-50-99.....Photometric Measurements of Roadway Lighting
Installations
- LM-52-99.....Photometric Measurements of Roadway Sign
Installations
- LM-64-01.....Photometric Measurements of Parking Areas
- LM-72-97.....Directional Positioning of Photometric Data
- LM-79-08.....Approved Method for the Electrical and
Photometric Measurements of Solid-State Lighting
Products
- LM-80-08.....Approved Method for Measuring Lumen Maintenance
of LED Light Sources
- I. National Electrical Manufacturers Association (NEMA):
- C78.41-06.....Electric Lamps - Guidelines for Low-Pressure
Sodium Lamps
- C78.42-07Electric Lamps - Guidelines for High-Pressure
Sodium Lamps
- C78.43-07Electric Lamps - Single-Ended Metal-Halide
Lamps
- C78.1381-98.....Electric Lamps - 70-Watt M85 Double-Ended
Metal-Halide Lamps
- C82.4-02Ballasts for High-Intensity-Discharge and Low-
Pressure Sodium Lamps (Multiple-Supply Type)
- C136.3-05For Roadway and Area Lighting Equipment -
Luminaire Attachments
- C136.17-05Roadway and Area Lighting Equipment - Enclosed
Side-Mounted Luminaires for Horizontal-Burning
High-Intensity-Discharge Lamps - Mechanical
Interchangeability of Refractors
- ICS 2-00 (R2005)Controllers, Contactors and Overload Relays
Rated 600 Volts
- ICS 6-93 (R2006)Enclosures
- J. National Fire Protection Association (NFPA):
- 70-08National Electrical Code (NEC)

K. Underwriters Laboratories, Inc. (UL):

- 496-08Lampholders
- 773-95.....Plug-In, Locking Type Photocontrols for Use
with Area Lighting
- 773A-06Nonindustrial Photoelectric Switches for
Lighting Control
- 1029-94.....High-Intensity-Discharge Lamp Ballasts
- 1598-08Luminaires
- 8750-08.....Light Emitting Diode (LED) Light Sources for
Use in Lighting Products

1.6 DELIVERY, STORAGE, AND HANDLING

Provide manufacturer's standard provisions for protecting pole finishes during transport, storage, and installation. Do not store poles on ground. Store poles so they are at least 12 in [305 mm] above ground level and growing vegetation. Do not remove factory-applied pole wrappings until just before installing pole.

PART 2 - PRODUCTS

2.1 MATERIALS AND EQUIPMENT

Materials and equipment shall be in accordance with NEC, UL, ANSI, and as shown on the drawings and specified.

2.2 POLES

A. General:

1. Poles shall be as shown on the drawings, and as specified. Finish shall be as specified on the drawings.
2. The pole and arm assembly shall be designed for wind loading of 100 mph [161 km/hr], with an additional 30% gust factor, supporting luminaire(s) and accessories such as shields, banner arms, and banners that have the effective projected areas indicated. The effective projected area of the pole shall be applied at the height of the pole base, as shown on the drawings.
3. Poles shall be anchor-bolt type designed for use with underground supply conductors. Poles shall have handhole having a minimum clear opening of 2.5 x 5 in [65 x 125 mm]. Handhole covers shall be secured by stainless steel captive screws.
4. Provide a steel-grounding stud opposite handhole openings, designed to prevent electrolysis when used with copper wire.
5. Provide a base cover that matches the pole in material and color to conceal the mounting hardware pole-base welds and anchor bolts.

6. Hardware and Accessories: All necessary hardware and specified accessories shall be the product of the pole manufacturer.
7. Provide manufacturer's standard finish, as scheduled on the drawings.

B. Types:

1. Aluminum: Provide round fluted aluminum poles manufactured of corrosion-resistant AA AAH35.1 aluminum alloys conforming to AASHTO LTS-4. Poles shall be seamless extruded or spun seamless type.

2.3 FOUNDATIONS FOR POLES

- A. Foundations shall be cast-in-place concrete, having 3000 psi minimum 28-day compressive strength.
- B. Foundations shall support the effective projected area of the specified pole, arm(s), luminaire(s), and accessories, such as shields, banner arms, and banners, under wind conditions previously specified in this section.
- C. Place concrete in spirally-wrapped treated paper forms for round foundations, and construct forms for square foundations.
- D. Rub-finish and round all above-grade concrete edges to approximately 0.25 in [6 mm] radius.
- E. Anchor bolt assemblies and reinforcing of concrete foundations shall be as shown on the drawings. Anchor bolts shall be in a welded cage or properly positioned by the tiewire to stirrups.
- F. Prior to concrete pour, install electrode per Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS.

2.4 LUMINAIRES

- A. Per UL 1598 and NEMA C136.17. Luminaires shall be weatherproof, heavy duty, outdoor types designed for efficient light utilization, adequate dissipation of lamp and ballast heat, and safe cleaning and relamping.
- B. Light distribution pattern types shall be as shown on the drawings.
- C. Incorporate ballasts in the luminaire housing, except where otherwise shown on the drawings.
- D. Lenses shall be frame-mounted, heat-resistant, borosilicate glass, with prismatic refractors, unless otherwise shown on the drawings. Attach the frame to the luminaire housing by hinges or chain. Use heat and aging-resistant, resilient gaskets to seal and cushion lenses and refractors in luminaire doors.
- E. Pre-wire internal components to terminal strips at the factory.

- F. Bracket-mounted luminaires shall have leveling provisions and clamp-type adjustable slip-fitters with locking screws.
- G. Materials shall be rustproof. Latches and fittings shall be non-ferrous metal.
- H. Provide manufacturer's standard finish, as scheduled on the drawings. Where indicated on drawings, match finish process and color of pole or support materials.
- I. Luminaires shall carry factory labels, showing complete, specific lamp and ballast information.

2.5 LAMPS

- A. Install the proper lamps in every luminaire installed and every existing luminaire relocated or reinstalled.
- B. Lamps shall be general-service, outdoor lighting types.
- C. LED sources shall meet the following requirements:
 - 1. Operating temperature rating shall be between -40° F [-40° C] and 120° F [50° C].
 - 2. Correlated Color Temperature (CCT): 3000K.
 - 3. Color Rendering Index (CRI): ≥ 65 .
 - 4. The manufacturer shall have performed JEDEC (Joint Electron Devices Engineering Council) reliability tests on the LEDs as follows: High Temperature Operating Life (HTOL), Room Temperature Operating Life (RTOL), Low Temperature Operating Life (LTOL), Powered Temperature Cycle (PTMCL), Non-Operating Thermal Shock (TMSK), Mechanical Shock Variable Vibration Frequency, and Solder Heat Resistance (SHR).
- D. Mercury vapor lamps shall not be used.

2.6 LED DRIVERS

- A. LED drivers shall meet the following requirements:
 - 1. Drivers shall have a minimum efficiency of 85%.
 - 2. Starting Temperature: -40° F [-40° C].
 - 3. Input Voltage: 120 to 480 ($\pm 10\%$) V.
 - 4. Power Supplies: Class I or II output.
 - 5. Surge Protection: The system must survive 250 repetitive strikes of "C Low" (C Low: 6kV/1.2 x 50 μ s, 10kA/8 x 20 μ s) waveforms at 1-minute intervals with less than 10% degradation in clamping voltage. "C Low" waveforms are as defined in IEEE/ASNI C62.41.2-2002, Scenario 1 Location Category C.
 - 6. Power Factor (PF): ≥ 0.90 .
 - 7. Total Harmonic Distortion (THD): $\leq 20\%$.

- 8. Comply with FCC Title 47 CFR Part 18 Non-consumer RFI/EMI Standards.
- 9. Drivers shall be reduction of hazardous substances (ROHS)-compliant.

2.7 EXISTING LIGHTING SYSTEMS

- A. For modifications or additions to existing lighting systems, the new components shall be compatible with the existing systems.
- B. New poles and luminaires shall have approximately the same configurations and dimensions as the existing poles and luminaires, except where otherwise shown on the drawings.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Install lighting in accordance with the NEC, as shown on the drawings, and in accordance with manufacturer's recommendations.
- B. Pole Foundations:
 - 1. Excavate only as necessary to provide sufficient working clearance for installation of forms and proper use of tamper to the full depth of the excavation. Prevent surface water from flowing into the excavation. Thoroughly compact backfill with compacting arranged to prevent pressure between conductor, jacket, or sheath, and the end of conduit.
 - 2. Set anchor bolts according to anchor-bolt templates furnished by the pole manufacturer.
 - 3. Install poles as necessary to provide a permanent vertical position with the bracket arm in proper position for luminaire location.
 - 4. After the poles have been installed, shimmed, and plumbed, grout the spaces between the pole bases and the concrete base with non-shrink concrete grout material. Provide a plastic or copper tube, of not less than 0.375 in [9 mm] inside diameter through the grout, tight to the top of the concrete base to prevent moisture weeping from the interior of the pole.
- C. Install lamps in each luminaire.
- D. Adjust luminaires that require field adjustment or aiming.

3.2 GROUNDING

Ground noncurrent-carrying parts of equipment, including metal poles, luminaires, mounting arms, brackets, and metallic enclosures, as specified in Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS. Where copper grounding conductor is connected to a metal other than copper, provide specially-treated or lined connectors suitable and listed for this purpose.

3.3 ACCEPTANCE CHECKS AND TESTS

Verify operation after installing luminaires and energizing circuits.

- - - E N D - - -

SECTION 27 05 11
REQUIREMENTS FOR COMMUNICATIONS INSTALLATIONS

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This Section, Requirements for Communications Installations, applies to all sections of Division 27.
- B. Furnish and install communications cabling, systems, equipment, and accessories in accordance with the specifications and drawings. Capacities and ratings of transformers, cable, and other items and arrangements for the specified items are shown on drawings.

1.2 MINIMUM REQUIREMENTS

- A. References to industry and trade association standards and codes are minimum installation requirement standards.
- B. Drawings and other specification sections shall govern in those instances where requirements are greater than those specified in the above standards.

1.3 QUALIFICATIONS (PRODUCTS AND SERVICES)

- A. Manufacturers Qualifications: The manufacturer shall regularly and presently produce, as one of the manufacturer's principal products, the equipment and material specified for this project, and shall have manufactured the item for at least three years.
- B. Product Qualification:
 - 1. Manufacturer's product shall have been in satisfactory operation, on three installations of similar size and type as this project, for approximately three years.
 - 2. The Government reserves the right to require the Contractor to submit a list of installations where the products have been in operation before approval.
- C. Service Qualifications: There shall be a permanent service organization maintained or trained by the manufacturer which will render satisfactory service to this installation within eight hours of receipt of notification that service is needed. Submit name and address of service organizations.

1.4 MANUFACTURED PRODUCTS

- A. Materials and equipment furnished shall be of current production by manufacturers regularly engaged in the manufacture of such items, for which replacement parts shall be available.
- B. When more than one unit of the same class of equipment is required, such units shall be the product of a single manufacturer.
- C. Equipment Assemblies and Components:
 - 1. Components of an assembled unit need not be products of the same manufacturer.
 - 2. Manufacturers of equipment assemblies, which include components made by others, shall assume complete responsibility for the final assembled unit.
 - 3. Components shall be compatible with each other and with the total assembly for the intended service.
 - 4. Constituent parts which are similar shall be the product of a single manufacturer.
- D. Factory wiring shall be identified on the equipment being furnished and on all wiring diagrams.
- E. When Factory Testing Is Specified:
 - 1. The Government shall have the option of witnessing factory tests. The contractor shall notify the VA through the Contracting Officer's Technical Representative (COTR) a minimum of 15 working days prior to the manufacturers making the factory tests.
 - 2. Four copies of certified test reports containing all test data shall be furnished to the COTR prior to final inspection and not more than 90 days after completion of the tests.
 - 3. When equipment fails to meet factory test and re-inspection is required, the contractor shall be liable for all additional expenses, including expenses of the Government.

1.5 EQUIPMENT REQUIREMENTS

Where variations from the contract requirements are requested in accordance with the GENERAL CONDITIONS and Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES, the connecting work and related components shall include, but not be limited to additions or changes to branch circuits, circuit protective devices, conduits, wire, feeders, controls, panels and installation methods.

1.6 EQUIPMENT PROTECTION

- A. Equipment and materials shall be protected during shipment and storage against physical damage, dirt, moisture, cold and rain:
 - 1. During installation, enclosures, equipment, controls, controllers, circuit protective devices, and other like items, shall be protected against entry of foreign matter; and be vacuum cleaned both inside and outside before testing and operating and repainting if required.
 - 2. Damaged equipment shall be, as determined by the COTR, placed in first class operating condition or be returned to the source of supply for repair or replacement.
 - 3. Painted surfaces shall be protected with factory installed removable heavy kraft paper, sheet vinyl or equal.
 - 4. Damaged paint on equipment and materials shall be refinished with the same quality of paint and workmanship as used by the manufacturer so repaired areas are not obvious.

1.7 WORK PERFORMANCE

- A. Job site safety and worker safety is the responsibility of the contractor.
- B. For work on existing stations, arrange, phase and perform work to assure communications service for other buildings at all times. Refer to Article OPERATIONS AND STORAGE AREAS under Section 01 00 00, GENERAL REQUIREMENTS.
- C. New work shall be installed and connected to existing work neatly and carefully. Disturbed or damaged work shall be replaced or repaired to its prior conditions, as required by Section 01 00 00, GENERAL REQUIREMENTS.
- D. Coordinate location of equipment and pathways with other trades to minimize interferences. See the GENERAL CONDITIONS.

1.8 EQUIPMENT INSTALLATION AND REQUIREMENTS

- A. Equipment location shall be as close as practical to locations shown on the drawings.
- B. Inaccessible Equipment:
 - 1. Where the Government determines that the Contractor has installed equipment not conveniently accessible for operation and maintenance, the equipment shall be removed and reinstalled as directed at no additional cost to the Government.
 - 2. "Conveniently accessible" is defined as being capable of being reached without the use of ladders, or without climbing or crawling

under or over obstacles such as, but not limited to, motors, pumps, belt guards, transformers, piping, ductwork, conduit and raceways.

1.9 EQUIPMENT IDENTIFICATION

- A. Install an identification sign which clearly indicates information required for use and maintenance of equipment.
- B. Nameplates shall be laminated black phenolic resin with a white core with engraved lettering, a minimum of 6 mm (1/4 inch) high. Secure nameplates with screws. Nameplates that are furnished by manufacturer as a standard catalog item, or where other method of identification is herein specified, are exceptions.

1.10 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. The Government's approval shall be obtained for all equipment and material before delivery to the job site. Delivery, storage, or installation of equipment or material which has not had prior approval will not be permitted at the job site.
- C. All submittals shall include adequate descriptive literature, catalog cuts, shop drawings, and other data necessary for the Government to ascertain that the proposed equipment and materials comply with specification requirements. Catalog cuts submitted for approval shall be legible and clearly identify equipment being submitted.
- D. Submittals for individual systems and equipment assemblies which consist of more than one item or component shall be made for the system or assembly as a whole. Partial submittals will not be considered for approval.
 - 1. Mark the submittals, "SUBMITTED UNDER SECTION_____".
 - 2. Submittals shall be marked to show specification reference including the section and paragraph numbers.
 - 3. Submit each section separately.
- E. The submittals shall include the following:
 - 1. Information that confirms compliance with contract requirements. Include the manufacturer's name, model or catalog numbers, catalog information, technical data sheets, shop drawings, pictures, nameplate data and test reports as required.
 - 2. Elementary and interconnection wiring diagrams for communication and signal systems, control system and equipment assemblies. All terminal points and wiring shall be identified on wiring diagrams.

3. Parts list which shall include those replacement parts recommended by the equipment manufacturer, quantity of parts, current price and availability of each part.
- F. Manuals: Submit in accordance with Section 01 00 00, GENERAL REQUIREMENTS.
1. Maintenance and Operation Manuals: Submit as required for systems and equipment specified in the technical sections. Furnish four copies, bound in hardback binders, (manufacturer's standard binders) or an approved equivalent. Furnish one complete manual as specified in the technical section but in no case later than prior to performance of systems or equipment test, and furnish the remaining manuals prior to contract completion.
 2. Inscribe the following identification on the cover: the words "MAINTENANCE AND OPERATION MANUAL," the name and location of the system, equipment, building, name of Contractor, and contract number. Include in the manual the names, addresses, and telephone numbers of each subcontractor installing the system or equipment and the local representatives for the system or equipment.
 3. Provide a "Table of Contents" and assemble the manual to conform to the table of contents, with tab sheets placed before instructions covering the subject. The instructions shall be legible and easily read, with large sheets of drawings folded in.
 4. The manuals shall include:
 - a. Internal and interconnecting wiring and control diagrams with data to explain detailed operation and control of the equipment.
 - b. A control sequence describing start-up, operation, and shutdown.
 - c. Description of the function of each principal item of equipment.
 - d. Installation and maintenance instructions.
 - e. Safety precautions.
 - f. Diagrams and illustrations.
 - g. Testing methods.
 - h. Performance data.
 - i. Pictorial "exploded" parts list with part numbers. Emphasis shall be placed on the use of special tools and instruments. The list shall indicate sources of supply, recommended spare parts, and name of servicing organization.

- j. Appendix; list qualified permanent servicing organizations for support of the equipment, including addresses and certified qualifications.
- G. Approvals will be based on complete submission of manuals together with shop drawings.
- H. After approval and prior to installation, furnish the COTR with one sample of each of the following:
 - 1. A 300 mm (12 inch) length of each type and size of wire and cable along with the tag from the coils of reels from which the samples were taken.
 - 2. Each type of conduit and pathway coupling, bushing and termination fitting.
 - 3. Raceway and pathway hangers, clamps and supports.
 - 4. Duct sealing compound.
- I. In addition to the requirement of SUBMITTALS, the VA reserves the right to request the manufacturer to arrange for a VA representative to see typical active systems in operation, when there has been no prior experience with the manufacturer or the type of equipment being submitted.

1.11 SINGULAR NUMBER

Where any device or part of equipment is referred to in these specifications in the singular number (e.g., "the switch"), this reference shall be deemed to apply to as many such devices as are required to complete the installation as shown on the drawings.

1.12 TRAINING

- A. Training shall be provided in accordance with Article, INSTRUCTIONS, of Section 01 00 00, GENERAL REQUIREMENTS.
- B. Training shall be provided for the particular equipment or system as required in each associated specification.
- C. A training schedule shall be developed and submitted by the contractor and approved by the COTR at least 30 days prior to the planned training.

- - - E N D - - -

SECTION 27 05 26
GROUNDING AND BONDING FOR COMMUNICATIONS SYSTEMS

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This section specifies general grounding and bonding requirements of telecommunication installations for equipment operations.
- B. "Grounding electrode system" refers to all electrodes required by NEC, as well as including made, supplementary, telecommunications system grounding electrodes.
- D. The terms "connect" and "bond" are used interchangeably in this specification and have the same meaning.

1.2 RELATED WORK

- A. Section 27 05 11, REQUIREMENTS FOR COMMUNICATIONS INSTALLATIONS: General electrical requirements and items that are common to more than one section of Division 27.
- B. Section 27 10 00, STRUCTURED CABLING: Low Voltage power and lighting wiring.
- C. Section 26 41 00, FACILITY LIGHTNING PROTECTION: Requirements for a lightning protection system.

1.3 SUBMITTALS

- A. Submit in accordance with Section 27 05 11, REQUIREMENTS FOR COMMUNICATIONS INSTALLATIONS.
- B. Shop Drawings:
 - 1. Sufficient information, clearly presented, shall be included to determine compliance with drawings and specifications.
 - 2. Include the location of system grounding electrode connections and the routing of aboveground and underground grounding electrode conductors.
- C. Test Reports: Provide certified test reports of ground resistance.
- D. Certifications: Two weeks prior to final inspection, submit four copies of the following to the Contracting Officer's Technical Representative (COTR):
 - 1. Certification that the materials and installation is in accordance with the drawings and specifications.
 - 2. Certification, by the Contractor, that the complete installation has been properly installed and tested.

1.4 APPLICABLE PUBLICATIONS

Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by the basic designation only.

A. American Society for Testing and Materials (ASTM):

B1-2001.....Standard Specification for Hard-Drawn Copper Wire

B8-2004.....Standard Specification for Concentric-Lay-Stranded Copper Conductors, Hard, Medium-Hard, or Soft

B. Institute of Electrical and Electronics Engineers, Inc. (IEEE):

81-1983.....IEEE Guide for Measuring Earth Resistivity, Ground Impedance, and Earth Surface Potentials of a Ground System

C. National Fire Protection Association (NFPA):

70-2005.....National Electrical Code (NEC)

E. Telecommunications Industry Association, (TIA)

J-STO-607-A-2002.....Commercial Building Grounding (Earthing) and Bonding Requirements for Telecommunications

E. Underwriters Laboratories, Inc. (UL):

44-2005Thermoset-Insulated Wires and Cables

83-2003Thermoplastic-Insulated Wires and Cables

467-2004Grounding and Bonding Equipment

486A-486B-2003Wire Connectors

PART 2 - PRODUCTS

2.1 GROUNDING AND BONDING CONDUCTORS

- A. Equipment grounding conductors shall be UL 83 insulated stranded copper, except that sizes 6 mm² (10 AWG) and smaller shall be solid copper. Insulation color shall be continuous green for all equipment grounding conductors, except that wire sizes 25 mm² (4 AWG) and larger shall be permitted to be identified per NEC.
- B. Bonding conductors shall be ASTM B8 bare stranded copper, except that sizes 6 mm² (10 AWG) and smaller shall be ASTM B1 solid bare copper wire.
- C. Isolated Power System: Type XHHW-2 insulation with a dielectric constant of 3.5 or less.

- D. Telecom System Grounding Riser Conductor: Telecommunications Grounding Riser shall be in accordance with J STO-607A. Use a minimum 50mm² (1/0 AWG) insulated stranded copper grounding conductor unless indicated otherwise.

2.2 GROUND RODS

- A. Copper clad steel, 19 mm (3/4-inch) diameter by 3000 mm (10 feet) long, conforming to UL 467.
- B. Quantity of rods shall be as required to obtain the specified ground resistance.

2.3 SPLICES AND TERMINATION COMPONENTS

Components shall meet or exceed UL 467 and be clearly marked with the manufacturer, catalog number, and permitted conductor size(s).

2.4 TELECOMMUNICATION SYSTEM GROUND BUSBARS

- A. Provide solid copper busbar, pre-drilled from two-hole lug connections with a minimum thickness of 6 mm (1/4 inch) for wall and backboard mounting using standard insulators sized as follows:
 - 1. Room Signal Grounding: 300 mm x 100 mm (12 inches x 4 inch).
 - 2. Master Signal Ground: 600 mm x 100 mm (24 inches x 4 inch).

2.5 GROUND CONNECTIONS

- A. Below Grade: Exothermic-welded type connectors.
- B. Above Grade:
 - 1. Bonding Jumpers: compression type connectors, using zinc-plated fasteners and external tooth lockwashers.
 - 2. Ground Busbars: Two-hole compression type lugs using tin-plated copper or copper alloy bolts and nuts.
 - 3. Rack and Cabinet Ground Bars: one-hole compression-type lugs using zinc-plated or copper alloy fasteners.
- A. Cable Shields: Make ground connections to multipair communications cables with metallic shields using shield bonding connectors with screw stud connection.

2.6 EQUIPMENT RACK AND CABINET GROUND BARS

Provide solid copper ground bars designed for mounting on the framework of open or cabinet-enclosed equipment racks with minimum dimensions of 4 mm thick by 19 mm wide (3/8 inch x 3/4 inch).

2.7 GROUND TERMINAL BLOCKS

At any equipment mounting location (e.g. backboards and hinged cover enclosures) where rack-type ground bars cannot be mounted, provide screw lug-type terminal blocks.

2.8 SPLICE CASE GROUND ACCESSORIES

Splice case grounding and bonding accessories shall be supplied by the splice case manufacturer when available. Otherwise, use 16 mm² (6 AWG) insulated ground wire with shield bonding connectors.

PART 3 - EXECUTION**3.1 GENERAL**

- A. Ground in accordance with the NEC, as shown on drawings, and as hereinafter specified.
- B. System Grounding:
 - 1. Secondary service neutrals: Ground at the supply side of the secondary disconnecting means and at the related transformers.
 - 2. Separately derived systems (transformers downstream from the service entrance): Ground the secondary neutral.
 - 3. Isolation transformers and isolated power systems shall not be system grounded.
- C. Equipment Grounding: Metallic structures (including ductwork and building steel), enclosures, raceways, junction boxes, outlet boxes, cabinets, machine frames, and other conductive items in close proximity with electrical circuits shall be bonded and grounded.

3.2 INACCESSIBLE GROUNDING CONNECTIONS

Make grounding connections, which are buried or otherwise normally inaccessible (except connections for which periodic testing access is required) by exothermic weld.

3.3 SECONDARY EQUIPMENT AND CIRCUITS

- A. Main Bonding Jumper: Bond the secondary service neutral to the ground bus in the service equipment.
- B. Metallic Piping, Building Steel, and Supplemental Electrode(s):
 - 1. Provide a grounding electrode conductor sized per NEC between the service equipment ground bus and all metallic water and gas pipe systems, building steel, and supplemental or made electrodes. Jumper insulating joints in the metallic piping. All connections to electrodes shall be made with fittings that conform to UL 467.
 - 2. Provide a supplemental ground electrode and bond to the grounding electrode system.
- C. Conduit Systems:
 - 1. Ground all metallic conduit systems. All metallic conduit systems shall contain an equipment grounding conductor.

2. Non-metallic conduit systems shall contain an equipment grounding conductor, except that non-metallic feeder conduits which carry a grounded conductor from exterior transformers to interior or building-mounted service entrance equipment need not contain an equipment grounding conductor.
3. Conduit containing only a grounding conductor, and which is provided for mechanical protection of the conductor, shall be bonded to that conductor at the entrance and exit from the conduit.
- D. Feeders and Branch Circuits: Install equipment grounding conductors with all feeders and power and lighting branch circuits.
- E. Boxes, Cabinets, Enclosures, and Panelboards:
 1. Bond the equipment grounding conductor to each pullbox, junction box, outlet box, device box, cabinets, and other enclosures through which the conductor passes (except for special grounding systems for intensive care units and other critical units shown).
 2. Provide lugs in each box and enclosure for equipment grounding conductor termination.
 3. Provide ground bars in panelboards, bolted to the housing, with sufficient lugs to terminate the equipment grounding conductors.
- F. Receptacles shall not be grounded through their mounting screws. Ground with a jumper from the receptacle green ground terminal to the device box ground screw and the branch circuit equipment grounding conductor.

3.4 CORROSION INHIBITORS

When making ground and ground bonding connections, apply a corrosion inhibitor to all contact surfaces. Use corrosion inhibitor appropriate for protecting a connection between the metals used.

3.5 CONDUCTIVE PIPING

- A. Bond all conductive piping systems, interior and exterior, to the building to the grounding electrode system. Bonding connections shall be made as close as practical to the equipment ground bus.
- B. In operating rooms and at intensive care and coronary care type beds, bond the gases and suction piping, at the outlets, directly to the room or patient ground bus.

3.6 TELECOMMUNICATIONS SYSTEM

- A. Bond telecommunications system grounding equipment to the electrical grounding electrode system.

- B. Furnish and install all wire and hardware required to properly ground, bond and connect communications raceway, cable tray, metallic cable shields, and equipment to a ground source.
- C. Ground bonding jumpers shall be continuous with no splices. Use the shortest length of bonding jumper possible.
- D. Provide ground paths that are permanent and continuous with a resistance of 1 ohm or less from raceway, cable tray, and equipment connections to the building grounding electrode. The resistance across individual bonding connections shall be 10 milli ohms or less.
- E. Below-Grade Grounding Connections: When making exothermic welds, wire brush or file the point of contact to a bare metal surface. Use exothermic welding cartridges and molds in accordance with the manufacturer's recommendations. After welds have been made and cooled, brush slag from the weld area and thoroughly cleaned the joint area. Notify the COTR prior to backfilling any ground connections.
- F. Above-Grade Grounding Connections: When making bolted or screwed connections to attach bonding jumpers, remove paint to expose the entire contact surface by grinding where necessary; thoroughly clean all connector, plate and other contact surfaces; and apply an appropriate corrosion inhibitor to all surfaces before joining.
- G. Bonding Jumpers:
 - 1. Use insulated ground wire of the size and type shown on the Drawings or use a minimum of 16 mm² (6 AWG) insulated copper wire.
 - 2. Assemble bonding jumpers using insulated ground wire terminated with compression connectors.
 - 3. Use compression connectors of proper size for conductors specified. Use connector manufacturer's compression tool.
- H. Bonding Jumper Fasteners:
 - 1. Conduit: Fasten bonding jumpers using screw lugs on grounding bushings or conduit strut clamps, or the clamp pads on push-type conduit fasteners. When screw lug connection to a conduit strut clamp is not possible, fasten the plain end of a bonding jumper wire by slipping the plain end under the conduit strut clamp pad; tighten the clamp screw firmly. Where appropriate, use zinc-plated external tooth lockwashers.
 - 2. Wireway and Cable Tray: Fasten bonding jumpers using zinc-plated bolts, external tooth lockwashers, and nuts. Install protective

cover, e.g., zinc-plated acorn nuts on any bolts extending into wireway or cable tray to prevent cable damage.

3. Ground Plates and Busbars: Fasten bonding jumpers using two-hole compression lugs. Use tin-plated copper or copper alloy bolts, external tooth lockwashers, and nuts.
4. Unistrut and Raised Floor Stringers: Fasten bonding jumpers using zinc-plated, self-drill screws and external tooth lockwashers.

3.7 COMMUNICATION ROOM GROUNDING

A. Telecommunications Ground Busbars:

1. Provide communications room telecommunications ground busbar hardware at 950 mm (18 inches) at locations indicated on the Drawings.
2. Connect the telecommunications room ground busbars to other room grounding busbars as indicated on the Grounding Riser diagram.

B. Telephone-Type Cable Rack Systems: aluminum pan installed on telephone-type cable rack serves as the primary ground conductor within the communications room. Make ground connections by installing the following bonding jumpers:

1. Install a 16 mm² (6 AWG) bonding between the telecommunications ground busbar and the nearest access to the aluminum pan installed on the cable rack.
2. Use 16 mm² (6 AWG) bonding jumpers across aluminum pan junctions.

C. Self-Supporting and Cabinet-Mounted Equipment Rack Ground Bars:

1. When ground bars are provided at the rear of lineup of bolted together equipment racks, bond the copper ground bars together using solid copper splice plates supplied by the ground bar manufacturer.
2. Bond together nonadjacent ground bars on equipment racks and cabinets with 16 mm² (6 AWG) insulated copper wire bonding jumpers attached at each end with compression-type connectors and mounting bolts.
3. Provide a 16 mm² (6 AWG) bonding jumper between the rack and/or cabinet ground busbar and the aluminum pan of an overhead cable tray or the raised floor stringer as appropriate.

D. Backboards: Provide a screw lug-type terminal block or drilled and tapped copper strip near the top of backboards used for communications cross-connect systems. Connect backboard ground terminals to the aluminum pan in the telephone-type cable tray using an insulated 16 mm² (16 AWG) bonding jumper.

- E. Other Communication Room Ground Systems: Ground all metallic conduit, wireways, and other metallic equipment located away from equipment racks or cabinets to the cable tray pan or the telecommunications ground busbar, whichever is closer, using insulated 16 mm² (6 AWG) ground wire bonding jumpers.

3.8 COMMUNICATIONS CABLE GROUNDING

- A. Bond all metallic cable sheaths in multipair communications cables together at each splicing and/or terminating location to provide 100 percent metallic sheath continuity throughout the communications distribution system.
 - 1. At terminal points, install a cable shield bonding connector provide a screw stud connection for ground wire. Use a bonding jumper to connect the cable shield connector to an appropriate ground source like the rack or cabinet ground bar.
 - 2. Bond all metallic cable shields together within splice closures using cable shield bonding connectors or the splice case grounding and bonding accessories provided by the splice case manufacturer. When an external ground connection is provided as part of splice closure, connect to an approved ground source and all other metallic components and equipment at that location.

3.9 COMMUNICATIONS CABLE TRAY SYSTEMS:

- A. Bond the metallic structures of one cable tray in each tray run following the same path to provide 100 percent electrical continuity throughout this cable tray systems as follows:
 - 1. Splice plates provided by the cable tray manufacturer can be used for providing a ground bonding connection between cable tray sections when the resistance across a bolted connection is 10 milliohms or less. The Subcontractor shall verify this loss by testing across one splice plate connection in the presence of the Contractor.
 - 2. Install a 16 mm² (6 AWG) bonding jumper across each cable tray splice or junction where splice plates cannot be used.
 - 3. When cable tray terminations to cable rack, install 16 mm² (6 AWG) bonding jumper between cable tray and cable rack pan.

3.10 COMMUNICATIONS RACEWAY GROUNDING

- A. Conduit: Use insulated 16 mm² (6 AWG) bonding jumpers to ground metallic conduit at each end and to bond at all intermediate metallic enclosures.

- B. Wireway: use insulated 16 mm² (6 AWG) bonding jumpers to ground or bond metallic wireway at each end at all intermediate metallic enclosures and across all section junctions.
- C. Cable Tray Systems: Use insulated 16 mm² (6 AWG) bonding jumpers to ground cable tray to column-mounted building ground plates (pads) at each end and approximately every 16 meters (50 feet).

3.11 GROUND RESISTANCE

- A. Grounding system resistance to ground shall not exceed 5 ohms. Make necessary modifications or additions to the grounding electrode system for compliance without additional cost to the Government. Final tests shall assure that this requirement is met.
- B. Resistance of the grounding electrode system shall be measured using a four-terminal fall-of-potential method as defined in IEEE 81. Ground resistance measurements shall be made before the electrical distribution system is energized and shall be made in normally dry conditions not less than 48 hours after the last rainfall. Resistance measurements of separate grounding electrode systems shall be made before the systems are bonded together below grade. The combined resistance of separate systems may be used to meet the required resistance, but the specified number of electrodes must still be provided.
- C. Services at power company interface points shall comply with the power company ground resistance requirements.
- D. Below-grade connections shall be visually inspected by the COTR prior to backfilling. The Contractor shall notify the COTR 24 hours before the connections are ready for inspection.

3.12 GROUND ROD INSTALLATION

- A. Drive each rod vertically in the earth, not less than 3000 mm (10 feet) in depth.
- B. Where permanently concealed ground connections are required, make the connections by the exothermic process to form solid metal joints. Make accessible ground connections with mechanical pressure type ground connectors.
- C. Where rock prevents the driving of vertical ground rods, install angled ground rods or grounding electrodes in horizontal trenches to achieve the specified resistance.

- - - E N D - - -

SECTION 27 05 33
RACEWAYS AND BOXES FOR COMMUNICATIONS SYSTEMS

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This section specifies the furnishing, installation, and connection of conduit, fittings, and boxes to form complete, coordinated, raceway systems. Raceways are required for all communications cabling unless shown or specified otherwise.
- B. Definitions: The term conduit, as used in this specification, shall mean any or all of the raceway types specified.

1.2 RELATED WORK

- A. Bedding of conduits: Section 31 20 00, EARTH MOVING.
- B. Mounting board for communication closets: Section 06 10 00, ROUGH CARPENTRY.
- C. Sealing around penetrations to maintain the integrity of fire rated construction: Section 07 84 00, FIRESTOPPING.
- D. Fabrications for the deflection of water away from the building envelope at penetrations: Section 07 60 00, FLASHING AND SHEET METAL.
- E. Sealing around conduit penetrations through the building envelope to prevent moisture migration into the building: Section 07 92 00, JOINT SEALANTS.
- F. Identification and painting of conduit and other devices: Section 09 91 00, PAINTING.
- G. General electrical requirements and items that is common to more than one section of Division 27: Section 27 05 11, REQUIREMENTS FOR COMMUNICATIONS INSTALLATIONS.
- H. Requirements for personnel safety and to provide a low impedance path for possible ground fault currents: Section 27 05 26, GROUNDING AND BONDING FOR COMMUNICATIONS SYSTEMS.

1.3 SUBMITTALS

In accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES, furnish the following:

- A. Shop Drawings:
 - 1. Size and location of panels and pull boxes
 - 2. Layout of required conduit penetrations through structural elements.
 - 3. The specific item proposed and its area of application shall be identified on the catalog cuts.

- B. Certification: Prior to final inspection, deliver to the Contracting Officer's Technical Representative (COTR) four copies of the certification that the material is in accordance with the drawings and specifications and has been properly installed.

1.4 APPLICABLE PUBLICATIONS

- A. Publications listed below (including amendments, addenda, revisions, supplements and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by the basic designation only.
- B. National Fire Protection Association (NFPA):
- 70-05.....National Electrical Code (NEC)
- C. Underwriters Laboratories, Inc. (UL):
- 1-03.....Flexible Metal Conduit
- 5-01.....Surface Metal Raceway and Fittings
- 6-03.....Rigid Metal Conduit
- 50-03.....Enclosures for Electrical Equipment
- 360-03.....Liquid-Tight Flexible Steel Conduit
- 467-01.....Grounding and Bonding Equipment
- 514A-01.....Metallic Outlet Boxes
- 514B-02.....Fittings for Cable and Conduit
- 514C-05.....Nonmetallic Outlet Boxes, Flush-Device Boxes
and Covers
- 651-02.....Schedule 40 and 80 Rigid PVC Conduit
- 651A-03.....Type EB and A Rigid PVC Conduit and HDPE
Conduit
- 797-03.....Electrical Metallic Tubing
- 1242-00.....Intermediate Metal Conduit
- D. National Electrical Manufacturers Association (NEMA):
- TC-3-04.....PVC Fittings for Use with Rigid PVC Conduit and
Tubing
- FB1-03.....Fittings, Cast Metal Boxes and Conduit Bodies
for Conduit, Electrical Metallic Tubing and
Cable

PART 2 - PRODUCTS

2.1 MATERIAL

- A. Conduit Size: In accordance with the NEC, but not less than 13 mm (1/2 inch) unless otherwise shown. Where permitted by the NEC, 13 mm

(1/2 inch) flexible conduit may be used for tap connections to recessed lighting fixtures.

B. Conduit:

1. Rigid galvanized steel: Shall Conform to UL 6, ANSI C80.1.
2. Rigid aluminum: Shall Conform to UL 6A, ANSI C80.5.
3. Rigid intermediate steel conduit (IMC): Shall Conform to UL 1242, ANSI C80.6.
4. Electrical metallic tubing (EMT): Shall Conform to UL 797, ANSI C80.3. Maximum size not to exceed 105 mm (4 inch) and shall be permitted only with cable rated 600 volts or less.
5. Flexible galvanized steel conduit: Shall Conform to UL 1.
6. Liquid-tight flexible metal conduit: Shall Conform to UL 360.
7. Direct burial plastic conduit: Shall conform to UL 651 and UL 651A, heavy wall PVC or high density polyethylene (PE).
8. Surface metal raceway: Shall Conform to UL 5.

C. Conduit Fittings:

1. Rigid steel and IMC conduit fittings:
 - a. Fittings shall meet the requirements of UL 514B and ANSI/ NEMA FB1.
 - b. Standard threaded couplings, locknuts, bushings, and elbows: Only steel or malleable iron materials are acceptable. Integral retractable type IMC couplings are also acceptable.
 - c. Locknuts: Bonding type with sharp edges for digging into the metal wall of an enclosure.
 - d. Bushings: Metallic insulating type, consisting of an insulating insert molded or locked into the metallic body of the fitting. Bushings made entirely of metal or nonmetallic material are not permitted.
 - e. Erickson (union-type) and set screw type couplings: Approved for use in concrete are permitted for use to complete a conduit run where conduit is installed in concrete. Use set screws of case hardened steel with hex head and cup point to firmly seat in conduit wall for positive ground. Tightening of set screws with pliers is prohibited.
 - f. Sealing fittings: Threaded cast iron type. Use continuous drain type sealing fittings to prevent passage of water vapor. In concealed work, install fittings in flush steel boxes with blank

cover plates having the same finishes as that of other electrical plates in the room.

2. Rigid aluminum conduit fittings:
 - a. Standard threaded couplings, locknuts, bushings, and elbows: Malleable iron, steel or aluminum alloy materials; Zinc or cadmium plate iron or steel fittings. Aluminum fittings containing more than 0.4 percent copper are prohibited.
 - b. Locknuts and bushings: As specified for rigid steel and IMC conduit.
 - c. Set screw fittings: Not permitted for use with aluminum conduit.
3. Electrical metallic tubing fittings:
 - a. Fittings shall meet the requirements of UL 514B and ANSI/ NEMA FB1.
 - b. Only steel or malleable iron materials are acceptable.
 - c. Couplings and connectors: Concrete tight and rain tight, with connectors having insulated throats. Use gland and ring compression type couplings and connectors for conduit sizes 50 mm (2 inches) and smaller. Use set screw type couplings with four set screws each for conduit sizes over 50 mm (2 inches). Use set screws of case-hardened steel with hex head and cup point to firmly seat in wall of conduit for positive grounding.
 - d. Indent type connectors or couplings are prohibited.
 - e. Die-cast or pressure-cast zinc-alloy fittings or fittings made of "pot metal" are prohibited.
4. Flexible steel conduit fittings:
 - a. Conform to UL 514B. Only steel or malleable iron materials are acceptable.
 - b. Clamp type, with insulated throat.
5. Liquid-tight flexible metal conduit fittings:
 - a. Fittings shall meet the requirements of UL 514B and ANSI/ NEMA FB1.
 - b. Only steel or malleable iron materials are acceptable.
 - c. Fittings must incorporate a threaded grounding cone, a steel or plastic compression ring, and a gland for tightening. Connectors shall have insulated throats.
6. Direct burial plastic conduit fittings:
 - a. Fittings shall meet the requirements of UL 514C and NEMA TC3.
 - b. As recommended by the conduit manufacturer.

7. Surface metal raceway fittings: As recommended by the raceway manufacturer.
8. Expansion and deflection couplings:
 - a. Conform to UL 467 and UL 514B.
 - b. Accommodate, 19 mm (0.75 inch) deflection, expansion, or contraction in any direction, and allow 30 degree angular deflections.
 - c. Include internal flexible metal braid sized to guarantee conduit ground continuity and fault currents in accordance with UL 467, and the NEC code tables for ground conductors.
 - d. Jacket: Flexible, corrosion-resistant, watertight, moisture and heat resistant molded rubber material with stainless steel jacket clamps.
- D. Conduit Supports:
 1. Parts and hardware: Zinc-coat or provide equivalent corrosion protection.
 2. Individual Conduit Hangers: Designed for the purpose, having a pre-assembled closure bolt and nut, and provisions for receiving a hanger rod.
 3. Multiple conduit (trapeze) hangers: Not less than 38 mm by 38 mm (1-1/2 by 1-1/2 inch), 12 gage steel, cold formed, lipped channels; with not less than 9 mm (3/8 inch) diameter steel hanger rods.
 4. Solid Masonry and Concrete Anchors: Self-drilling expansion shields, or machine bolt expansion.
- E. Outlet, Junction, and Pull Boxes:
 1. UL-50 and UL-514A.
 2. Cast metal where required by the NEC or shown, and equipped with rustproof boxes.
 3. Sheet metal boxes: Galvanized steel, except where otherwise shown.
 4. Flush mounted wall or ceiling boxes shall be installed with raised covers so that front face of raised cover is flush with the wall. Surface mounted wall or ceiling boxes shall be installed with surface style flat or raised covers.
- G. Wireways: Equip with hinged covers, except where removable covers are shown.
- G. Warning Tape: Standard, 4-Mil polyethylene 76 mm (3 inch) wide tape detectable type, red with black letters, and imprinted with "CAUTION BURIED COMMUNICATIONS CABLE BELOW".

PART 3 - EXECUTION**3.1 PENETRATIONS****A. Cutting or Holes:**

1. Locate holes in advance where they are proposed in the structural sections such as ribs or beams. Obtain the approval of the COTR prior to drilling through structural sections.
2. Cut holes through concrete and masonry in new and existing structures with a diamond core drill or concrete saw. Pneumatic hammer, impact electric, hand or manual hammer type drills are not allowed, except where permitted by the COTR as required by limited working space.

B. Fire Stop: Where conduits, wireways, and other communications raceways pass through fire partitions, fire walls, smoke partitions, or floors, install a fire stop that provides an effective barrier against the spread of fire, smoke and gases as specified in Section 07 84 00, FIRESTOPPING, with rock wool fiber or silicone foam sealant only. Completely fill and seal clearances between raceways and openings with the fire stop material.**C. Waterproofing:** At floor, exterior wall, and roof conduit penetrations, completely seal clearances around the conduit and make watertight as specified in Section 07 92 00, JOINT SEALANTS.**3.2 INSTALLATION, GENERAL****A. Install conduit as follows:**

1. In complete runs before pulling in cables or wires.
2. Flattened, dented, or deformed conduit is not permitted. Remove and replace the damaged conduits with new undamaged material.
3. Assure conduit installation does not encroach into the ceiling height head room, walkways, or doorways.
4. Cut square with a hacksaw, ream, remove burrs, and draw up tight.
5. Mechanically continuous.
6. Independently support conduit at 8'0" on center. Do not use other supports i.e., (suspended ceilings, suspended ceiling supporting members, lighting fixtures, conduits, mechanical piping, or mechanical ducts).
7. Support within 300 mm (1 foot) of changes of direction, and within 300 mm (1 foot) of each enclosure to which connected.
8. Close ends of empty conduit with plugs or caps at the rough-in stage to prevent entry of debris, until wires are pulled in.

9. Conduit installations under fume and vent hoods are prohibited.
 10. Secure conduits to cabinets, junction boxes, pull boxes and outlet boxes with bonding type locknuts. For rigid and IMC conduit installations, provide a locknut on the inside of the enclosure, made up wrench tight. Do not make conduit connections to junction box covers.
 11. Flashing of penetrations of the roof membrane is specified in Section 07 60 00, FLASHING AND SHEET METAL.
 12. Do not use aluminum conduits in wet locations.
 13. Unless otherwise indicated on the drawings or specified herein, all conduits shall be installed concealed within finished walls, floors and ceilings.
- B. Conduit Bends:
1. Make bends with standard conduit bending machines.
 2. Conduit hickey may be used for slight offsets, and for straightening stubbed out conduits.
 3. Bending of conduits with a pipe tee or vise is prohibited.
- C. Layout and Homeruns:
1. Deviations: Make only where necessary to avoid interferences and only after drawings showing the proposed deviations have been submitted approved by the COTR.

3.3 CONCEALED WORK INSTALLATION

- A. In Concrete:
1. Conduit: Rigid steel, IMC or EMT. Do not install EMT in concrete slabs that are in contact with soil, gravel or vapor barriers.
 2. Align and run conduit in direct lines.
 3. Install conduit through concrete beams only when the following occurs:
 - a. Where shown on the structural drawings.
 - b. As approved by the COTR prior to construction, and after submittal of drawing showing location, size, and position of each penetration.
 4. Installation of conduit in concrete that is less than 75 mm (3 inches) thick is prohibited.
 - a. Conduit outside diameter larger than 1/3 of the slab thickness is prohibited.

- b. Space between conduits in slabs: Approximately six conduit diameters apart, except one conduit diameter at conduit crossings.
 - c. Install conduits approximately in the center of the slab so that there will be a minimum of 19 mm (3/4 inch) of concrete around the conduits.
- 5. Make couplings and connections watertight. Use thread compounds that are UL approved conductive type to insure low resistance ground continuity through the conduits. Tightening set screws with pliers is prohibited.
- B. Furred or Suspended Ceilings and in Walls:
 - 1. Conduit for conductors above 600 volts:
 - a. Rigid steel or rigid aluminum.
 - b. Aluminum conduit mixed indiscriminately with other types in the same system is prohibited.
 - 2. Conduit for conductors 600 volts and below:
 - a. Rigid steel, IMC, rigid aluminum, or EMT. Different type conduits mixed indiscriminately in the same system is prohibited.
 - 3. Align and run conduit parallel or perpendicular to the building lines.
 - 4. Connect recessed lighting fixtures to conduit runs with maximum 1800 mm (six feet) of flexible metal conduit extending from a junction box to the fixture.
 - 5. Tightening set screws with pliers is prohibited.

3.4 EXPOSED WORK INSTALLATION

- A. Unless otherwise indicated on the drawings, exposed conduit is only permitted in mechanical and electrical rooms.
- B. Conduit for conductors above 600 volts:
 - 1. Rigid steel or rigid aluminum.
 - 2. Aluminum conduit mixed indiscriminately with other types in the same system is prohibited.
- C. Conduit for Conductors 600 volts and below:
 - 1. Rigid steel, IMC, rigid aluminum, or EMT. Different type of conduits mixed indiscriminately in the system is prohibited.
- D. Align and run conduit parallel or perpendicular to the building lines.
- E. Install horizontal runs close to the ceiling or beams and secure with conduit straps.

- F. Support horizontal or vertical runs at not over 2400 mm (eight foot) intervals.
- G. Surface metal raceways: Use only where shown.
- H. Painting:
 - 1. Paint exposed conduit as specified in Section 09 91 00, PAINTING.
 - 2. Paint all conduits containing cables rated over 600 volts safety orange. Refer to Section 09 91 00, PAINTING for preparation, paint type, and exact color. In addition, paint legends, using 50 mm (two inch) high black numerals and letters, showing the cable voltage rating. Provide legends where conduits pass through walls and floors and at maximum 6000 mm (20 foot) intervals in between.

3.5 EXPANSION JOINTS

- A. Conduits 75 mm (3 inches) and larger, that are secured to the building structure on opposite sides of a building expansion joint, require expansion and deflection couplings. Install the couplings in accordance with the manufacturer's recommendations.
- B. Provide conduits smaller than 75 mm (3 inches) with junction boxes on both sides of the expansion joint. Connect conduits to junction boxes with sufficient slack of flexible conduit to produce 125 mm (5 inch) vertical drop midway between the ends. Flexible conduit shall have a copper green ground bonding jumper installed. In lieu of this flexible conduit, expansion and deflection couplings as specified above for 375 mm (15 inches) and larger conduits are acceptable.
- C. Install expansion and deflection couplings where shown.

3.6 CONDUIT SUPPORTS, INSTALLATION

- A. Safe working load shall not exceed 1/4 of proof test load of fastening devices.
- B. Use pipe straps or individual conduit hangers for supporting individual conduits. Maximum distance between supports is 2.5 m (8 foot) on center.
- C. Support multiple conduit runs with trapeze hangers. Use trapeze hangers that are designed to support a load equal to or greater than the sum of the weights of the conduits, wires, hanger itself, and 90 kg (200 pounds). Attach each conduit with U-bolts or other approved fasteners.
- D. Support conduit independently of junction boxes, pull boxes, fixtures, suspended ceiling T-bars, angle supports, and similar items.
- E. Fasteners and Supports in Solid Masonry and Concrete:

1. New Construction: Use steel or malleable iron concrete inserts set in place prior to placing the concrete.
2. Existing Construction:
 - a. Steel expansion anchors not less than 6 mm (1/4 inch) bolt size and not less than 28 mm (1-1/8 inch) embedment.
 - b. Power set fasteners not less than 6 mm (1/4 inch) diameter with depth of penetration not less than 75 mm (3 inches).
 - c. Use vibration and shock resistant anchors and fasteners for attaching to concrete ceilings.
- F. Hollow Masonry: Toggle bolts are permitted.
- G. Bolts supported only by plaster or gypsum wallboard are not acceptable.
- H. Metal Structures: Use machine screw fasteners or other devices specifically designed and approved for the application.
- I. Attachment by wood plugs, rawl plug, plastic, lead or soft metal anchors, or wood blocking and bolts supported only by plaster is prohibited.
- J. Chain, wire, or perforated strap shall not be used to support or fasten conduit.
- K. Spring steel type supports or fasteners are prohibited for all uses except: Horizontal and vertical supports/fasteners within walls.
- L. Vertical Supports: Vertical conduit runs shall have riser clamps and supports in accordance with the NEC and as shown. Provide supports for cable and wire with fittings that include internal wedges and retaining collars.

3.7 BOX INSTALLATION

- A. Boxes for Concealed Conduits:
 1. Flush mounted.
 2. Provide raised covers for boxes to suit the wall or ceiling, construction and finish.
- B. In addition to boxes shown, install additional boxes where needed to prevent damage to cables and wires during pulling in operations.
- C. Remove only knockouts as required and plug unused openings. Use threaded plugs for cast metal boxes and snap-in metal covers for sheet metal boxes.
- D. Stencil or install phenolic nameplates on covers of the boxes identified on riser diagrams; for example "SIG-FA JB No. 1".

3.8 COMMUNICATION SYSTEM CONDUIT

- A. Install the communication raceway system as shown on drawings.

- B. Minimum conduit size of 19 mm (3/4 inch), but not less than the size shown on the drawings.
- C. All conduit ends shall be equipped with insulated bushings.
- D. All 100 mm (four inch) conduits within buildings shall include pull boxes after every two 90 degree bends. Size boxes per the NEC.
- E. Vertical conduits/sleeves through closets floors shall terminate not less than 75 mm (3 inches) below the floor and not less than 75 mm (3 inches) below the ceiling of the floor below.
- F. Terminate conduit runs to/from a backboard in a closet or interstitial space at the top or bottom of the backboard. Conduits shall enter communication closets next to the wall and be flush with the backboard.
- G. Where drilling is necessary for vertical conduits, locate holes so as not to affect structural sections such as ribs or beams.
- H. All empty conduits located in communication closets or on backboards shall be sealed with a standard non-hardening duct seal compound to prevent the entrance of moisture and gases and to meet fire resistance requirements.
- I. Conduit runs shall contain no more than four quarter turns (90 degree bends) between pull boxes/backboards. Minimum radius of communication conduit bends shall be as follows (special long radius):

Sizes of Conduit Trade Size	Radius of Conduit Bends mm, Inches
3/4	150 (6)
1	230 (9)
1-1/4	350 (14)
1-1/2	430 (17)
2	525 (21)
2-1/2	635 (25)
3	775 (31)
3-1/2	900 (36)
4	1125 (45)

- J. Furnish and install 19 mm (3/4 inch) thick fire retardant plywood specified in Section 06 10 00, ROUGH CARPENTRY on the wall of communication closets where shown on drawings . Mount the plywood with the bottom edge 300 mm (one foot) above the finished floor.

K. Furnish and pull wire in all empty conduits. (Sleeves through floor are exceptions).

- - - E N D - - -

**SECTION 27 10 00
STRUCTURED CABLING**

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This section specifies the furnishing, installation, and connection of the structured cabling system to provide a comprehensive telecommunications infrastructure.

1.2 RELATED WORK

- A. Excavation and backfill for cables that are installed in conduit: Section 31 20 00, EARTH MOVING.
- B. Sealing around penetrations to maintain the integrity of time rated construction: Section 07 84 00, FIRESTOPPING.
- C. General electrical requirements that are common to more than one section in Division 27: Section 27 05 11, REQUIREMENTS FOR COMMUNICATIONS INSTALLATIONS.
- D. Conduits for cables and wiring: Section 27 05 33, RACEWAYS AND BOXES FOR COMMUNICATIONS SYSTEMS.
- E. Requirements for personnel safety and to provide a low impedance path for possible ground fault currents: Section 27 05 26, GROUNDING AND BONDING FOR COMMUNICATIONS SYSTEMS.

1.3 SUBMITTALS

- A. In accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES, furnish the following:
 - 1. Manufacturer's Literature and Data: Showing each cable type and rating.
 - 2. Certificates: Two weeks prior to final inspection, deliver to the COTR four copies of the certification that the material is in accordance with the drawings and specifications and has been properly installed.

1.4 APPLICABLE PUBLICATIONS

- A. Publications listed below (including amendments, addenda, revisions, supplements and errata) form a part of this specification to the extent referenced. Publications are reference in the text by the basic designation only.

- B. American Society of Testing Material (ASTM):
 - D2301-04.....Standard Specification for Vinyl Chloride
Plastic Pressure Sensitive Electrical
Insulating Tape
- C. Federal Specifications (Fed. Spec.):
 - A-A-59544-00.....Cable and Wire, Electrical (Power, Fixed
Installation)
- D. National Fire Protection Association (NFPA):
 - 70-05.....National Electrical Code (NEC)
- E. Underwriters Laboratories, Inc. (UL):
 - 44-02.....Thermoset-Insulated Wires and Cables
 - 83-03.....Thermoplastic-Insulated Wires and Cables
 - 467-01.....Electrical Grounding and Bonding Equipment
 - 486A-01.....Wire Connectors and Soldering Lugs for Use with
Copper Conductors
 - 486C-02.....Splicing Wire Connectors
 - 486D-02.....Insulated Wire Connector Systems for
Underground Use or in Damp or Wet Locations
 - 486E-00.....Equipment Wiring Terminals for Use with
Aluminum and/or Copper Conductors
 - 493-01.....Thermoplastic-Insulated Underground Feeder and
Branch Circuit Cable
 - 514B-02.....Fittings for Cable and Conduit
 - 1479-03.....Fire Tests of Through-Penetration Fire Stops

PART 2 - PRODUCTS

2.1 CONTROL WIRING

- A. Unless otherwise specified in other sections of these specifications, control wiring shall be as specified for power and lighting wiring, except the minimum size shall be not less than No. 14 AWG.
- B. Control wiring shall be large enough so that the voltage drop under inrush conditions does not adversely affect operation of the controls.

2.2 COMMUNICATION AND SIGNAL WIRING

- A. Shall conform to the recommendations of the manufacturers of the communication and signal systems; however, not less than what is shown.
- B. Wiring shown is for typical systems. Provide wiring as required for the systems being furnished.
- C. Multi-conductor cables shall have the conductors color coded.

2.3 WIRE LUBRICATING COMPOUND

- A. Suitable for the wire insulation and conduit it is used with, and shall not harden or become adhesive.
- B. Shall not be used on wire for isolated type electrical power systems.

2.4 FIREPROOFING TAPE

- A. The tape shall consist of a flexible, conformable fabric of organic composition coated one side with flame-retardant elastomer.
- B. The tape shall be self-extinguishing and shall not support combustion. It shall be arc-proof and fireproof.
- C. The tape shall not deteriorate when subjected to water, gases, salt water, sewage, or fungus and be resistant to sunlight and ultraviolet light.
- D. The finished application shall withstand a 200-ampere arc for not less than 30 seconds.
- E. Securing tape: Glass cloth electrical tape not less than 0.18 mm (7 mils) thick, and 19 mm (3/4 inch) wide.

PART 3 - EXECUTION**3.1 INSTALLATION, GENERAL**

- A. Install all wiring in raceway systems.
- B. Seal cable and wire entering a building from underground, between the wire and conduit where the cable exits the conduit, with a non-hardening approved compound.
- C. Wire Pulling:
 - 1. Provide installation equipment that will prevent the cutting or abrasion of insulation during pulling of cables.
 - 2. Use ropes made of nonmetallic material for pulling feeders.
 - 3. Attach pulling lines for feeders by means of either woven basket grips or pulling eyes attached directly to the conductors, as approved by the Contracting Officer's Technical Representative (COTR).
 - 4. Pull in multiple cables together in a single conduit.

3.2 CONTROL, COMMUNICATION AND SIGNAL WIRING INSTALLATION

- A. Unless otherwise specified in other sections, install wiring and connect to equipment/devices to perform the required functions as shown and specified.
- B. Except where otherwise required, install a separate power supply circuit for each system so that malfunctions in any system will not affect other systems.

- C. Where separate power supply circuits are not shown, connect the systems to the nearest panelboards of suitable voltages, which are intended to supply such systems and have suitable spare circuit breakers or space for installation.
- D. Install a red warning indicator on the handle of the branch circuit breaker for the power supply circuit for each system to prevent accidental de-energizing of the systems.
- E. System voltages shall be 120 volts or lower where shown on the drawings or as required by the NEC.

3.3 CONTROL, COMMUNICATION AND SIGNAL SYSTEM IDENTIFICATION

- A. Install a permanent wire marker on each wire at each termination.
- B. Identifying numbers and letters on the wire markers shall correspond to those on the wiring diagrams used for installing the systems.
- C. Wire markers shall retain their markings after cleaning.
- D. In each manhole and handhole, install embossed brass tags to identify the system served and function.

3.4 EXISTING WIRING

Unless specifically indicated on the plans, existing wiring shall not be reused for the new installation. Only wiring that conforms to the specifications and applicable codes may be reused. If existing wiring does not meet these requirements, existing wiring may not be reused and new wires shall be installed.

- - - E N D - - -

SECTION 27 11 00
COMMUNICATIONS EQUIPMENT ROOM FITTINGS

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This Section specifies the furnishing, installing, certification, testing, and guaranty of a complete and operating Voice and Digital Cable Distribution System (here-in-after referred to as "*the System*"), and associated equipment and hardware to be installed in the VA Medical Center here-in-after referred to as "*the Facility*". The System shall include, but not be limited to: equipment cabinets, interface enclosures, and relay racks; necessary combiners, traps, and filters; and necessary passive devices such as: splitters, couplers, cable "patch", "punch down", and cross-connector blocks or devices, voice and data distribution sub-systems, and associated hardware. The System shall additionally include, but not be limited to: telecommunication closets (TC); telecommunications outlets (TCO); copper and fiber optic distribution cables, connectors, "patch" cables, and/or "break out" devices.
- B. The System shall be delivered free of engineering, manufacturing, installation, and functional defects. It shall be designed, engineered and installed for ease of operation, maintenance, and testing.
- C. The term "provide", as used herein, shall be defined as: designed, engineered, furnished, installed, certified, and tested, by the Contractor.
- D. The Voice and Digital Telecommunication Distribution Cable Equipment and System provides the media which voice and data information travels over and connects to the Telephone System which is defined as an Emergency Critical Care Communication System by the National Fire Protection Association (NFPA). Therefore, since the System connects to or extends the telephone system, the System's installation and operation shall adhere to all appropriate National, Government, and/or Local Life Safety and/or Support Codes, which ever are the more stringent for this Facility. At a minimum , the System shall be installed according to NFPA, Section 70, National Electrical Code (NEC), Article 517 and Chapter 7; NFPA, Section 99, Health Care Facilities, Chapter 3-4; NFPA, Section 101, Life Safety Code, Chapters 7, 12, and/or 13; Joint Commission on Accreditation of Health Care

Organization (JCAHCO), Manual for Health Care Facilities, all necessary Life Safety and/or Support guidelines; this specification; and the original equipment manufacturer's (OEM) suggested installation design, recommendations, and instructions. The OEM and Contractor shall ensure that all management, sales, engineering, and installation personnel have read and understand the requirements of this specification before the System is designed, engineered, delivered, and provided.

- E. The VA Project Manager (PM) and/or if delegated, Contracting Officer's Technical Representative (COTR) are the approving authorities for all contractual and mechanical changes to the System. The Contractor is cautioned to obtain in writing, all approvals for system changes relating to the published contract specifications and drawings, from the PM and/or the RE before proceeding with the change.
- F. System Performance:
 - 1. At a minimum, the System shall be able to support the following voice and data operations for Category 6 Certified Telecommunication Service:
 - a. Provide the following interchange (or interface) capabilities:
 - 1) Basic Rate (BRI).
 - 2) Primary Rate (PRI).
 - b. ISDN:
 - 1) Narrow Band BRI:
 - a) B Channel: 64 kilo-Bits per second (kBps), minimum.
 - b) D Channel: 16 kBps, minimum.
 - c) H Channel: 384 kBps, minimum.
 - 2) Narrow Band PRI:
 - a) B Channel: 64 kBps, minimum.
 - b) D Channel: 64 kBps, minimum.
 - c) H Channel: 1,920 kBps, minimum.
 - 3) Wide (or Broad) Band: All channels: 140 mega(m)-Bps, minimum, capable to 565 mBps at "T" reference.
 - c. ATM operation and interface: ATM 155 mBps
 - d. Frame Relay: All stated compliance's
 - e. Integrated Data Communications Utility (IDCU) operation and interface.
 - f. Government Open Systems Interconnection Profile (GOSSIP) compliant.

- g. Fiberoptic Distributed Data Interface (FDDI): A minimum 100 mBps to a maximum of 1.8 giga(g)-Bps data bit stream speed (shall be Synchronous Optical Network [SONET] compliant).
 - h. System Sensitivity: Satisfactory service shall be provided for at least 3,000 feet for all voice and data and analog RF locations.
2. At a minimum the System shall support the following operating parameters:
- a. EPBX connection:
 - 1) System speed: 1.0 gBps per second, minimum.
 - 2) Impedance: 600 Ohms.
 - 3) Cross Modulation: -60 deci-Bel (dB).
 - 4) Hum Modulation: -55 dB.
 - 5) System data error: 10 to the -10 Bps, minimum.
 - 6) Loss: Measured at the frame output with reference Zero (0) deciBel measured (dBm) at 1,000 Hertz (Hz) applied to the frame input.
 - a) Trunk to station: 1.5 dB, maximum.
 - b) Station to station: 3.0 dB, maximum.
 - c) Internal switch crosstalk: -60 dB when a signal of ± 10 deciBel measured (dBm), 500-2,500 Hz range is applied to the primary path.
 - d) Idle channel noise: 25 dBm "C" or 3.0 dBm "O" above reference (terminated) ground noise, whichever is greater.
 - e) Traffic Grade of Service for Voice and Data:
 - (1) A minimum grade of service of P-01 with an average traffic load of 7.0 CCS per station per hour and a traffic overload in the data circuits will not interfere with, or degrade, the voice service.
 - (2) Average CCS per voice station: The average CCS capacity per voice station shall be maintained at 7.0 CCS when the EPBX is expanded up to the projected maximum growth as stated herein.
 - b. Telecommunications Outlet (TCO):
 - 1) Voice:
 - a) Isolation (outlet-outlet): 24 dB.
 - b) Impedance: 600 Ohms, balanced (BAL).
 - c) Signal Level: 0 deciBel per mili-Volt (dBmV) \pm 0.1 dBmV.
 - d) System speed: 100 mBps, minimum.

- e) System data error: 10 to the -6 Bps, minimum.
- 2) Data:
 - a) Isolation (outlet-outlet): 24 dB.
 - b) Impedance: 600 Ohms, BAL.
 - c) Signal Level: 0 dBmV \pm 0.1 dBmV.
 - d) System speed: 120 mBps, minimum.
 - e) System data error: 10 to the -8 Bps, minimum.
- 3) Fiber optic:
 - a) Isolation (outlet-outlet): 36 dB.
 - b) Signal Level: 0 dBmV \pm 0.1 dBmV.
 - c) System speed: 540 mBps, minimum.
 - d) System data error: 10 to the -6 bps, minimum.
- 4) Closed Circuit Analog Video Service: Analog video service is considered to be at baseband (below 100 mHz in frequency bandwidth). An analog video circuit requires a separate analog video from the audio connector. The following minimum operating parameters shall be capable over each installed analog video circuit:

Impedance	75 Ohm, unbalanced
Output Level	1.0 V peak to peak (P-P), for 87.5% depth of Modulation (Mod)
Diff Gain	± 1 dB at 87.5% Mod
Diff Phase	± 1.5 at 87.5% Mod
Signal to Noise (S/N) ratio	44 dB, minimum
Hum Modulation	-55 dB
Return Loss	-14 dB (or 1.5 Voltage Standing Wave Ratio [VSWR]), maximum
Isolation (outlet-outlet)	24 DB, MINIMUM
Bandwidth	6.0 mHz per channel, fully loaded, minimum

- 5) Closed Circuit Analog Audio Service: Analog audio service is considered to be at baseband (below 10 mHz in frequency bandwidth). Usually an analog audio circuit requires separate audio connectors and video connectors even though both are considered baseband signals. However, since each TCO has

multiple 600 (or 120) Ohm BAL line pairs, the analog audio circuit may be designated to one of the provided pairs of UTP or STP for each TCO and as shown on the drawings, in lieu of providing a separate baseband audio run to the TCO. The following minimum operating parameters shall be capable over each installed analog audio circuit:

Impedance	600 Ohm, BAL
Input Level	59 mV Root Mean Squared (RMS), minimum
Output Level	0 dBm
S/N ratio	55 dB, minimum
Hum Modulation	-50 dB, minimum
Return Loss	-14 dB (or 1.5 VSWR), maximum
Isolation (outlet-outlet)	24 DB, MINIMUM
Frequency Bandwidth	100 Hz - 10K Hz, minimum

1.2 RELATED WORK

- A. Specification Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Specification Section 27 05 11, REQUIREMENTS FOR COMMUNICATIONS INSTALLATIONS.
- C. Specification Section 27 05 33, RACEWAYS AND BOXES FOR COMMUNICATIONS SYSTEMS.
- D. Specification Section 27 10 00, STRUCTURED CABLING.
- E. Specification Section 26 27 26, WIRING DEVICES.
- F. Specification Section 27 05 26, GROUNDING AND BONDING FOR COMMUNICATIONS SYSTEMS.
- G. Specification Section 26 41 00, FACILITY LIGHTNING PROTECTION.
- H. Specification Section 27 31 00, VOICE COMMUNICATIONS SWITCHING AND ROUTING EQUIPMENT.
- I. H-088-C3, VA HANDBOOK DESIGN FOR TELEPHONE SYSTEMS.

1.3 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in text by basic designation only. Except for a specific date given the issue in effect (including amendments, addenda, revisions, supplements, and errata) on

the date the system's submittal is technically approved by VA, shall be enforced.

B. National Fire Protection Association (NFPA):

70	NATIONAL ELECTRICAL CODE (NEC)
75	Protection of Electronic Computer/Data Processing Equipment
77	Recommended Practice on Static Electricity
	Standard for Health Care Facilities
101	Life Safety Code
1221	Emergency Services Communication Systems

C. Underwriters Laboratories, Inc. (UL):

65	Wired Cabinets
96	Lightning Protection Components
96A	INSTALLATION REQUIREMENTS FOR LIGHTNING PROTECTION SYSTEMS
467	Grounding and Bonding Equipment
497/497A/497B	PROTECTORS FOR PAIRED CONDUCTORS/ COMMUNICATIONS CIRCUITS/DATA COMMUNICATIONS AND FIRE ALARM CIRCUITS
884	Underfloor Raceways and Fittings

D. ANSI/EIA/TIA Publications:

568B	Commercial Building Telecommunications Wiring Standard
569B	Commercial Building Standard for Telecommunications Pathways and Spaces
606A	ADMINISTRATION STANDARD FOR THE TELECOMMUNICATIONS INFRASTRUCTURE OF COMMERCIAL BUILDINGS
607A	Grounding and Bonding Requirements for Telecommunications in Commercial Buildings
758	Grounding and Bonding Requirements for Telecommunications in Commercial Buildings

E. Lucent Technologies: Document 900-200-318 "Outside Plant Engineering Handbook".

F. International Telecommunication Union - Telecommunication Standardization Sector (ITU-T).

- G. Federal Information Processing Standards (FIPS) Publications.
- H. Federal Communications Commission (FCC) Publications: Standards for telephone equipment and systems.
- I. United States Air Force: Technical Order 33K-1-100 Test Measurement and Diagnostic Equipment (TMDE) Interval Reference Guide.
- J. Joint Commission on Accreditation of Health Care Organization (JCAHO): Comprehensive Accreditation Manual for Hospitals.
- K. National and/or Government Life Safety Code(s): The more stringent of each listed code.

1.4 QUALITY ASSURANCE

- A. The authorized representative of the OEM, shall be responsible for the design, satisfactory total operation of the System, and its certification.
- B. The OEM shall meet the minimum requirements identified in Paragraph 2.1.A. Additionally, the Contractor shall have had experience with three or more installations of systems of comparable size and complexity with regards to coordinating, engineering, testing, certifying, supervising, training, and documentation. Identification of these installations shall be provided as a part of the submittal as identified in Paragraph 1.5.
- C. The System Contractor shall submit certified documentation that they have been an authorized distributor and service organization for the OEM for a minimum of three (3) years. The System Contractor shall be authorized by the OEM to certify and warranty the installed equipment. In addition, the OEM and System Contractor shall accept complete responsibility for the design, installation, certification, operation, and physical support for the System. This documentation, along with the System Contractor and OEM certification must be provided in writing as part of the Contractor's Technical Submittal.
- D. All equipment, cabling, terminating hardware, TCOs, and patch cords shall be sourced from the certifying OEM or at the OEM's direction, and support the System design, the OEM's quality control and validity of the OEM's warranty.
- E. The Contractor's Telecommunications Technicians assigned to the System shall be fully trained, qualified, and certified by the OEM on the engineering, installation, and testing of the System. The Contractor shall provide formal written evidence of current OEM certification(s)

for the installer(s) as a part of the submittal or to the RE before being allowed to commence work on the System.

1.5 SUBMITTALS

- A. Provide submittals in accordance with Specification Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES. The RE shall retain one copy for review and approval.
 - 1. If the submittal is approved the RE shall retain one copy for Official Records and return three (3) copies to the Contractor.
 - 2. If the submittal is disapproved, three (3) copies will be returned to the Contractor with a written explanation attached that indicates the areas the submittal deviated from the System specifications. The RE shall retain one copy for Official Records.
- B. Environmental Requirements: Technical submittals shall confirm the environmental specifications for physical TC areas occupied by the System. These environmental specifications shall identify the requirements for initial and expanded system configurations for:
 - 1. Floor loading for batteries and cabinets.
 - 2. Minimum floor space and ceiling heights.
 - 3. Minimum size of doors for equipment passage.
 - 4. Power requirements: The Contractor shall provide the specific voltage, amperage, phases, and quantities of circuits required.
 - 5. Air conditioning, heating, and humidity requirements. The Contractor shall identify the ambient temperature and relative humidity operating ranges required preventing equipment damage.
 - 6. Air conditioning requirements (expressed in BTU per hour, based on adequate dissipation of generated heat to maintain required room and equipment standards).
 - 7. Proposed floor plan, based on the expanded system configuration of the bidder's proposed EPBX for this FACILITY.
 - 8. Conduit size requirement (between main TC, computer, and console rooms).
 - 9. Main trunk line and riser pathways, cable duct, and conduit requirements between each MTC, TC, and TCO.
- C. Documents: The submittal shall be separated into sections for each subsystem and shall contain the following:
 - 1. Title page to include:
 - a. VA Medical Center.

- b. Contractor's name, address, and telephone (including FAX) numbers.
 - c. Date of Submittal.
 - d. VA Project No.
2. List containing a minimum of three locations of installations of similar size and complexity as identified herein. These locations shall contain the following:
- a. Installation Location and Name.
 - b. Owner's or User's name, address, and telephone (including FAX) numbers.
 - c. Date of Project Start and Date of Final Acceptance by Owner.
 - d. System Project Number.
 - e. Brief (three paragraphs minimum) description of each system's function, operation, and installation.
3. Narrative Description of the system.
4. A List of the equipment to be furnished. The quantity, make, and model number of each item is required. Select the required equipment items quantities that will satisfy the needs of the system and edit quantity. Delete equipment items that are not required add additional items required, and renumber section as per system design. The following is the minimum equipment required by the system:

QUANTITY	UNIT
As required	Cabinet Assembly(s)
As required	Environmental Cabinet
As required	Distribution/Interface Cabinet
As required	Equipment (Radio Relay) Rack
As required	Cross Connection (CCS) Systems
As required	Audio Alarm Panel
As required	TROUBLE ANNUNCIATOR PANEL
As required	Lightning Protection System
As required	Wire Management System/Equipment
As required	Telecommunications Outlets (TCO)
As Required	Distribution Cables
As required	TCO Connection Cables
As required	System Connectors

As required	Terminators
As required	Distribution Frames
As required	Telecommunications Closets (TC)
As required	Environmental Requirements
1 ea.	Installation Kit
As-required	Separate List Containing Each Equipment Spare(s)

5. Pictorial layouts of each MTC, IMTC, and RTCs; MCCS, IMCCS, VCCS, and HCCS termination cabinet(s), each distribution cabinet layout drawing, and TCO as each is expected to be installed and configured.
6. Equipment technical literature detailing the electrical and technical characteristics of each item of equipment to be furnished.
7. Engineering drawings of the System, showing calculated signal levels at the EPBX output, each input and output distribution point, proposed TCO values, and signal level at each TCO multipin, fiberoptic, and coaxial cable jack.
8. List of test equipment as per paragraph 1.5.D. below.
9. Letter certifying that the Contractor understands the requirements of the SAMPLES Paragraph 1.5.E.
10. Letter certifying that the Contractor understands the requirements of Section 3.2 concerning acceptance tests.

D. Test Equipment List:

1. The Contractor is responsible for furnishing all test equipment required to test the system in accordance with the parameters specified. Unless otherwise stated, the test equipment shall not be considered part of the system. The Contractor shall furnish test equipment of accuracy better than the parameters to be tested.
2. The test equipment furnished by the Contractor shall have a calibration tag of an acceptable calibration service dated not more than 12 months prior to the test. As part of the submittal, a test equipment list shall be furnished that includes the make and model number of the following type of equipment as a minimum:
 - a. Spectrum Analyzer.
 - b. Signal Level Meter.
 - c. Volt-Ohm Meter.
 - d. Time Domain Reflectometer (TDR) with strip chart recorder (Data and Optical Measuring).

- e. Bit Error Test Set (BERT).
 - f. Camera with a minimum of 60 pictures to that will develop immediately to include appropriate test equipment adapters. A video camera in VHS format is an acceptable alternate.
 - g. Video Waveform Monitor.
 - h. Video Vector Scope.
 - i. Color Video Monitor with audio capability.
 - j. 100 mHz Oscilloscope with video adapters
- E. Samples: A sample of each of the following items shall be furnished to the RE for approval prior to installation.
- 1. TCO Wall Outlet Box 4" x 4"x 2.5" with:
 - a. One each telephone (or voice) rj45 jack installed.
 - b. Two each multi pin data rj45 jacks installed.
 - c. Cover Plate installed.
 - d. Fiber optic ST jack(s) installed.
 - e. RF (F)/video (BNC)/audio (XL)jack(s) installed.
 - 2. Data CCS patch panel, punch block or connection device with RJ45 connectors installed.
 - 3. Telephone CCS system with IDC and/or RJ45 connectors and cable terminal equipment installed.
 - 4. Fiber optic CCS patch panel or breakout box with cable management equipment and "ST" connectors installed.
 - 5. 610 mm (2 ft.) section of each copper cable to be used with cable sweep tags as specified in paragraph 2.4.H and connectors installed.
 - 6. 610 mm (2 ft.) section of each fiber optic cable to be used with cable sweep tags as specified in paragraph 2.4.H and connectors installed.
 - 7. 610 mm (2 ft.) section of each analog RF, video coaxial and audio cable to be used with cable sweep tags as specified in paragraph 2.4.H and connectors installed.
 - 8. Analog video CCS patch panel or breakout box with cable management equipment and "BNC" connectors installed.
 - 9. Analog audio CCS patch panel or breakout box with cable management equipment and "XL" connectors installed.
 - 10. Analog RF patch panel or breakout box with cable management equipment and "F" connectors installed.
- F. Certifications:

1. Submit written certification from the OEM indicating that the proposed supervisor of the installation and the proposed provider of the contract maintenance are authorized representatives of the OEM. Include the individual's exact name and address and OEM credentials in the certification.
 2. Submit written certification from the OEM that the wiring and connection diagrams meet National and/or Government Life Safety Guidelines, NFPA, NEC, UL, this specification, and JCAHCO requirements and instructions, requirements, recommendations, and guidance set forth by the OEM for the proper performance of the System as described herein. The VA will not approve any submittal without this certification.
 3. Preacceptance Certification: This certification shall be made in accordance with the test procedure outlined in paragraph 3.2.B.
- G. Equipment Manuals: Fifteen (15) working days prior to the scheduled acceptance test, the Contractor shall deliver four complete sets of commercial operation and maintenance manuals for each item of equipment furnished as part of the System to the RE. The manuals shall detail the theory of operation and shall include narrative descriptions, pictorial illustrations, block and schematic diagrams, and parts list.
- H. Record Wiring Diagrams:
1. Fifteen (15) working days prior to the acceptance test, the Contractor shall deliver four complete sets of the Record Wiring Diagrams of the System to the RE. The diagrams shall show all inputs and outputs of electronic and passive equipment correctly identified according to the markers installed on the interconnecting cables, Equipment and room/area locations.
 2. The Record Wiring Diagrams shall be in hard copy and two compact disk (CD) copies properly formatted to match the Facility's current operating version of Computer Aided Drafting (AutoCAD) system. The RE shall verify and inform the Contractor of the version of AutoCAD being used by the Facility.
- I. Surveys Required As A Part Of The Technical Submittal: The Contractor shall provide the following surveys that depict various system features and capacities are required in addition to the on site survey requirements described herein. Each survey shall be in writing and contain the following information (the formats are suggestions and may

be used for the initial Technical Submittal survey requirements), as a minimum:

1. The required EPBX connections (each CSU shall be compatible with) shall be compatible with the following:
 - a. Initially connect:

<u>EQUIPPED ITEM</u>	<u>CAPACITY</u>	<u>WIREDCAPACITY</u>
Main Station Lines		
Single Line		
Multi Line (Equipped for direct input dial [DID])		
Central Office (CO) Trunks		
TWO WAY		
DID		
Two-way DRTL		
Foreign Exchange (FX)		
Conference		
Radio Paging Access		
Audio Paging Access		
Off-Premise Extensions		
CO Trunk By-pass		
CRT w/keyboard		
Printers		
Attendant Consoles		
T-1 Access/Equipment		
Maintenance console		

- b. Projected Maximum Growth: The Contractor shall clearly and fully indicate this category for each item identified in Paragraph 1.4.H.1.a. as a part of the technical submittal. For this purpose, the following definitions and sample connections are provided to detail the system's capability:

<u>EQUIPPED ITEM</u>	<u>CAPACITY</u>	<u>WIRED CAPACITY</u>
Servers		
PC's		

Projected Maximum Growth		
--------------------------	--	--

The Contractor shall clearly and fully indicate this category for each item identified in Paragraph 1.4.H.2.a. as a part of the technical submittal.

2. Cable Distribution System Design Plan: A design plan for the entire cable distribution systems requirements shall be provided with this document. A specific cable count shall coincide with the total growth items as described herein. It is the Contractor's responsibility to provide the Systems entire cable requirements and engineer a distribution system requirement plan using the format of the following paragraph(s), at a minimum:

a. UTP (and/or STP) Requirements/Column Explanation:

Column	Explanation
FROM BUILDING	Identifies the building by number, title, or location, and main signal closet or intermediate signal closet cabling is provided from
BUILDING	Identifies the building by number, title, or location cabling is to be provided in
TO BUILDING IMC	Identifies building main terminal signal closet, by room number or location, to which cabling is provided too, in, and from
FLOOR	Identifies the floor by number (i.e. 1st, 2nd, etc.) cabling and TCOs are to be provided
TC ROOM NUMBER	Identifies the floor signal closet room, by room number, which cabling shall be provided
ROOM NUMBER	Identifies the room, by number, from which cabling and TCOs shall be provided
NUMBER OF CABLE PAIR	Identifies the number of cable pair required to be provided on each floor designated OR the number of cable pair (VA Owned) to be retained
NUMBER OF STRANDS USED/SPARE	Identifies the number of strands provided in each run

b. Fiber Optic Cabling Requirements/Column Explanation:

Column	Explanation
--------	-------------

FROM BUILDING	Identifies the building by number, title, or location, and main signal closet or intermediate signal closet cabling is provided from
TO BUILDING IMC	Identifies building, by number, title, or location, to which cabling is provided
FLOOR	Identifies the floor by number (i.e. 1st, 2nd, etc.)
TC ROOM NUMBER	Identifies the room, by number, from which cabling shall be installed
NUMBER OF STRANDS	Identifies the number of strands in each run of fiber optic cable
INSTALLED METHOD	Identifies the method of installation in accordance with as designated herein
NOTES	Identifies a note number for a special feature or equipment
BUILDING MTC	Identifies the building by number or title

c. Analog RF Cabling Requirements/Column Explanation:

Column	Explanation
FLOOR	Identifies the floor by number (i.e. 1st, 2nd, etc.)
TC ROOM NUMBER	Identifies the room, by number, from which cabling shall be installed
TO FLOOR TC	Identifies building, by number or location, to which cabling is installed
NUMBER OF STRANDS	Identifies the number of strands in each run of RF cable
INSTALLED METHOD	Identifies the method of installation in accordance with as designated herein
NOTES	Identifies a note number for a special feature or equipment
BUILDING MTC	Identifies the building by number or title

d. Analog Video Cabling Requirements/Column Explanation:

Column	Explanation
FROM BUILDING	Identifies building, by number or location, from which cabling is installed
TC ROOM NUMBER	Identifies the room, by number, from which cabling shall be installed
TO BUILDING IMC	Identifies building, by number or location, to which cabling is installed
TC ROOM NUMBER	Identifies the room, by number, to which

	cabling shall be installed
NUMBER OF STRANDS	Identifies the number of strands in each run of fiber optic cable
INSTALLED METHOD	Identifies the method of installation in accordance with as designated herein
NOTES	Identifies a note number for a special feature or equipment
BUILDING MTC	Identifies the building by number or title

3. Telecommunication Outlets: The Contractor shall clearly and fully indicate this category for each outlet location and compare the total count to the locations identified above as a part of the technical submittal. Additionally, the Contractor shall indicate the total number of spares.

PART 2 - PRODUCTS

2.1 EQUIPMENT AND MATERIALS

A. System Requirements:

1. The System shall provide the following minimum services that are designed in accordance with and supported by an Original Equipment Manufacturer (OEM), and as specified herein. The System shall provide continuous inter and/or intra-Facility voice and data, and analog RF service. The System shall be capacity sized so that loss of connectivity to external telephone systems shall not affect the Facilities operation in specific designated locations. The System shall:
 - a. Be capable of inter-connecting and functioning fully with the existing Local Telephone Exchange (LEC) Network(s), Federal Telephone System (FTS) Inter-city Network(s), Inter-exchange Carriers, Integrated Services Digital Network (ISDN), Electronic Private Branch Exchange (EPBX) switches, asynchronous/synchronous data terminals and circuits including Automatic Transfer Mode (ATM), Frame Relay, and local area networks (LAN), at a minimum.
 - b. Be a voice and data cable distribution system that is based on a physical "Star", and/or "Ring", and/or "Bus" Topology. An Analog RF coaxial cable distribution system shall be provided in a "home run" configuration from each associated riser TC to identified locations and as shown on the drawings.
 - c. Be compatible with and able to provide direct digital connection to trunk level equipment including, but, not limited to: directly

accessing trunk level equipment including the telephone system, audio paging, Industry Standard "T" and/or "DS" carrier services and external protocol converters. Additionally, connections to "T" and/or "DS" access/equipment or Customer Service Units (CSU) that are used in FTS and other trunk applications shall be included in the System design. Provide T-1 access/equipment (or CSU), as required for use, in FTS and other trunk applications by system design if this equipment is not provided by the existing telephone system and/or will be deactivated by the installation of the System. The Contractor shall provide all T-1 equipment necessary to terminate and make operational the quantity of circuits designated. The CSU's shall be connected to the System's emergency battery power supply. The System shall be fully capable of operating in the Industry Standard "DS" protocol and provide that service when required.

- d. Where the System connects to an existing or future telephone system, refer to specification Section 27 31 00, VOICE COMMUNICATIONS SWITCHING AND ROUTING EQUIPMENT for specific telephone equipment and system operational performance standards.

- 2. Specific Subsystem Requirements: The System shall consist, as a minimum, of the following independent sub-systems to comprise a complete and functional voice and digital and analog RF telecommunications cabling system: "Main" (MTC), "intermediate" (IMTC), and "riser" (RTC) TC's; "vertical" (or "riser") trunk cabling system; vertical cross-connection (VCC) cabling systems, and TCO's with a minimum of three (3) RJ-45 jacks for the appropriate telephone, Data connections, and additional jacks, connectors, drop and patch cords, terminators, and adapters provided.

- a. Telecommunication Closet (TC):

- 1) There shall be a minimum of one TC for the MTC, each building IMTC, and each RTC per building floor location. However, in large building(s), where the horizontal distance to the farthest voice and digital work area may exceed 90 Meters (M) (or 295 feet [ft]), additional TC's shall be provided as described herein. The maximum DC resistance per cable pair shall be no more than 28.6 Ohms per 305 M (1,000 feet). Each TC shall be centrally located to cover the maximum amount of local floor space. The TC's house in cabinets or enclosures,

on relay racks, and/or on backboards, various telecommunication data equipment, controllers, multiplexers, bridges, routers, LAN hub(s), telephone cross-connecting, active and passive equipment.

- 2) Additionally, the TC's may house fire alarm, nurses call, video, and intercom. Regardless of the method of installation, mounting, termination, or cross-connecting used, all vertical copper and fiber optic and analog RF coaxial cables shall be terminated on appropriate cross-connection systems (CCS) containing patch panel(s), punch blocks, and/or breakout devices provided in enclosures and tested as described herein. A cable and/or wire management system shall be a part of each CCS.

- a) A minimum of three 110-120 VAC active quad outlets shall be provided, each with "U" grounded receptacles at a minimum of one outlet for each front, side and back wall. These outlets shall be separately protected by an AC circuit breaker provided in the designated Government Emergency Critical Care AC power panel, that is connected to the Facilities Emergency AC Power Distribution System. For larger building TC applications, a minimum of one additional quad AC outlet shall be provided for every 800M² (or 8,000 ft²) of useable floor space. Additional outlets shall be equally spaced along the wall.

- b) Climate control shall be provided in each TC 24 hours a day, seven days per week and 52 week per year to prevent failure of electronic components and for mission critical functional applications. The RE and/or Facility Chief Engineering Officer are responsible for informing the Contractor regarding the minimum climate control requirements. In identified hostile TC locations where it has been determined (by the COTR or Facility Chief Engineer) that proper TC climate or external signal radiation cannot be properly maintained or controlled, the Contractor may, at his/her option, provide a minimum of two individual and properly sized self contained climate controlled equipment cabinet enclosures; one designated for voice, and one designated for data, and one additional

cabinet designated for analog RF service, in each TC location identified on the drawings, in lieu of providing additional required TC air handling capability.

B. System Performance:

1. At a minimum, the System shall be able to support the following voice and data and analog RF operations for Category 6 Certified Telecommunication Service:
 - a. Provide the following interchange (or interface) capabilities:
 - 1) Basic Rate (BRI).
 - 2) Primary Rate (PRI).
 - b. ISDN:
 - 1) Narrow Band BRI.
 - a) B Channel: 64 kilo-Bits per second (kBps), minimum.
 - b) D Channel: 16 kBps, minimum.
 - c) H Channel: 384 kBps, minimum.
 - 2) Narrow Band PRI:
 - a) B Channel: 64 kBps, minimum.
 - b) D Channel: 64 kBps, minimum.
 - c) H Channel: 1,920 kBps, minimum.
 - 3) Wide (or Broad) Band:
 - a) All channels: 140 mega (m)-Bps, minimum, capable to 565 mBps at "T" reference.
 - c. ATM operation and interface: ATM 155 mBps.
 - d. Frame Relay: All stated compliance's.
 - e. Integrated Data Communications Utility (IDCU) operation and interface.
 - f. Government Open Systems Interconnection Profile (GOSSIP) compliant.
 - g. Fiberoptic Distributed Data Interface (FDDI): A minimum 100 mBps to a maximum of 1.8 giga(g)-Bps data bit stream speed (shall be Synchronous Optical Network [Sonet] compliant).
 - h. System Sensitivity: Satisfactory service shall be provided for at least 3,000 feet for all voice and data and analog RF locations.
2. At a minimum the System shall support the following operating parameters:
 - a. EPBX connection:
 - 1) System speed: 1.0 gBps per second, minimum.
 - 2) Impedance: 600 Ohms.

- 3) Cross Modulation: -60 deci-Bel (dB).
- 4) Hum Modulation: -55 Db.
- 5) System data error: 10 to the -10 Bps, minimum loss measured at the frame output with reference Zero (0) deciBel measured (dBm) at 1,000 Hertz (Hz) applied to the frame input.
 - a) Trunk to station: 1.5 dB, maximum.
 - b) Station to station: 3.0 dB, maximum.
 - c) Internal switch crosstalk: -60 dB when a signal of ± 10 deciBel measured (dBm), 500-2,500 Hz range is applied to the primary path.
 - d) Idle channel noise: 25 dBm "C" or 3.0 dBm "O" above reference (terminated) ground noise, whichever is greater.
 - e) Traffic Grade of Service for Voice and Data:
 - (1) A minimum grade of service of P-01 with an average traffic load of 7.0 CCS per station per hour and a traffic overload in the data circuits will not interfere with, or degrade, the voice service.
 - (2) Average CCS per voice station: The average CCS capacity per voice station shall be maintained at 7.0 CCS when the EPBX is expanded up to the projected maximum growth as stated herein.
- b. Telecommunications Outlet (TCO):
 - 1) Voice:
 - a) Isolation (outlet-outlet): 24 dB.
 - b) Impedance: 600 Ohms, balanced (BAL).
 - c) Signal Level: 0 deciBel per mili-Volt (dBmV) ± 0.1 dBmV.
 - d) System speed: 100 mBps, minimum.
 - e) System data error: 10 to the -6 Bps, minimum.
 - 2) Data:
 - a) Isolation (outlet-outlet): 24 dB.
 - b) Impedance: 600 Ohms, BAL.
 - c) Signal Level: 0 dBmV ± 0.1 dBmV.
 - d) System speed: 120 mBps, minimum.
 - e) System data error: 10 to the -8 Bps, minimum.
 - 3) Fiber optic:
 - a) Isolation (outlet-outlet): 36 dB.
 - b) Signal Level: 0 dBmV ± 0.1 dBmV.
 - c) System speed: 540 mBps, minimum.

- d) System data error: 10 to the -6 BPS, minimum.
- 4) Closed Circuit Analog Video Service: Analog video service is considered to be at baseband (below 100 MHz in frequency bandwidth). An analog video circuit requires a separate analog video from the audio connector. The following minimum operating parameters shall be capable over each installed analog video circuit:
 - a) Impedance: 75 Ohm, unbalanced.
 - b) Output Level: 1.0 V peak to peak (P-P), for 87.5% depth of Modulation (Mod).
 - c) Diff Gain: ± 1 dB at 87.5% Mod.
 - d) Diff Phase: ± 1.5 at 87.5% Mod.
 - e) Signal to Noise (S/N) ratio: 44 dB, minimum.
 - f) Hum Modulation: -55 dB.
 - g) Return Loss: -14 dB (or 1.5 Voltage Standing Wave Ratio [VSWR]), maximum.
 - h) Isolation (outlet-outlet): 24 dB, minimum.
 - i) Bandwidth: 6.0 MHz per channel, fully loaded, minimum.
- 5) Closed Circuit Analog Audio Service: Analog audio service is considered to be at baseband (below 10 MHz in frequency bandwidth). Usually an analog audio circuit requires separate audio connectors and video connectors even though both are considered baseband signals. However, since each TCO has multiple 600 (or 120) Ohm BAL line pairs, the analog audio circuit may be designated to one of the provided pairs of UTP or STP for each TCO and as shown on the drawings, in lieu of providing a separate baseband audio run to the TCO. The following minimum operating parameters shall be capable over each installed analog audio circuit:
 - a) Audio (NOT TELEPHONE VOICE):
 - (1) Impedance: 600 Ohm, BAL.
 - (2) Input Level: 59 mV Root Mean Squared (RMS), minimum.
 - (3) Output Level: 0 dBm.
 - (4) S/N ratio: 55 dB, minimum.
 - (5) Hum Modulation: -50 dB, minimum.
 - (6) Return Loss: -14 dB (or 1.5 VSWR), maximum.
 - (7) Isolation (outlet-outlet): 24 dB, minimum.
 - (8) Frequency Bandwidth: 100 Hz - 10K Hz, minimum.

C. General:

1. All equipment to be supplied under this specification shall be new and the current model of a standard product of an OEM or record. An OEM of record shall be defined as a company whose main occupation is the manufacture for sale of the items of equipment supplied and which:
 - a. Maintains a stock of replacement parts for the item submitted.
 - b. Maintains engineering drawings, specifications, and operating manuals for the items submitted.
 - c. Has published and distributed descriptive literature and equipment specifications on the items of equipment submitted at least 30 days prior to the Invitation for Bid.
2. Specifications of equipment as set forth in this document are minimum requirements, unless otherwise stated, and shall not be construed as limiting the overall quality, quantity, or performance characteristics of items furnished in the System. When the Contractor furnishes an item of equipment for which there is a specification contained herein, the item of equipment shall meet or exceed the specification for that item of equipment.
3. The Contractor shall provide written verification, in writing to the RE at time of installation, that the type of wire/cable being provided is recommended and approved by the OEM. The Contractor is responsible for providing the proper size and type of cable duct and/or conduit and wiring even though the actual installation may be by another subcontractor.
4. The Telephone Contractor is responsible for providing interfacing cable connections for the telephone and PA systems with the System.
5. The telephone equipment and PA interface equipment shall be the interface points for connection of the PA interface cabling from the telephone switch via the system telephone interface unit.
6. Active electronic component equipment shall consist of solid state components, be rated for continuous duty service, comply with the requirements of FCC standards for telephone equipment, systems, and service.
7. All passive distribution equipment shall meet or exceed -80 dB radiation shielding specifications.
8. All interconnecting twisted pair, fiber-optic or coaxial cables shall be terminated on equipment terminal boards, punch blocks,

breakout boxes, splice blocks, and unused equipment ports/taps shall be terminated according to the OEM's instructions for telephone cable systems without adapters. The Contractor shall not leave unused or spare twisted pair wire, fiber-optic, or coaxial cable unterminated, unconnected, loose or unsecured.

9. Color code all distribution wiring to conform to the Telephone Industry standard, EIA/TIA, and this document, which ever is the more stringent. At a minimum, all equipment, cable duct and/or conduit, enclosures, wiring, terminals, and cables shall be clearly and permanently labeled according to and using the provided record drawings, to facilitate installation and maintenance. Reference Specification Section 27 10 00, STRUCTURED CABLING and Section 27 31 00, VOICE COMMUNICATIONS SWITCHING AND ROUTING EQUIPMENT.
10. Connect the System's primary input AC power to the Facility's Critical Branch of the Emergency AC power distribution system as shown on the plans or if not shown on the plans consult with RE regarding a suitable circuit location prior to bidding.
11. Plug-in connectors shall be provided to connect all equipment, except coaxial cables and interface points. Coaxial cable distribution points and RF transmission lines shall use coaxial cable connections recommended by the cable OEM and approved by the System OEM. Base-band cable systems shall utilize barrier terminal screw type connectors, at a minimum. Crimp type connectors installed with a ratchet type installation tool are and acceptable alternate as long as the cable dress, pairs, shielding, grounding, and connections and labeling are provided the same as the barrier terminal strip connectors. Tape of any type, wire nuts, or solder type connections are unacceptable and will not be approved.
12. All equipment faceplates utilized in the System shall be stainless steel, anodized aluminum, or UL approved cycolac plastic for the areas where provided.
13. Noise filters and surge protectors shall be provided for each equipment interface cabinet, switch equipment cabinet, control console, local, and remote active equipment locations to ensure protection from input primary AC power surges and noise glitches are not induced into low Voltage data circuits.

14. Underground warning tape shall be standard, 4-Mil polyethylene 76 mm (3 inch) wide tape detectable type, red with black letters imprinted with "CAUTION BURIED ELECTRIC LINE BELOW", orange with black letters imprinted with "CAUTION BURIED TELEPHONE LINE BELOW" or orange with black letters imprinted with "CAUTION BURIED FIBER OPTIC LINE BELOW", as applicable.

D. Equipment Functional Characteristics:

FUNCTIONS	CHARACTERISTICS
Input Voltage	105 to 130 VAC
POWER LINE FREQUENCY	60 HZ \pm 2.0 HZ
Operating Temperature	0 to 50 degrees (°) Centigrade (C)
Humidity	80 percent (%) minimum rating

E. Equipment Standards and Testing:

- The System has been defined herein as connected to systems identified as Critical Care performing Life Support Functions. Therefore, at a minimum, the system shall conform to all aforementioned National and/or Local Life Safety Codes (which ever are the more stringent), NFPA, NEC, this specification, JCAHCO Life Safety Accreditation requirements, and the OEM recommendations, instructions, and guidelines.
- All supplies and materials shall be listed, labeled or certified by UL or a nationally recognized testing laboratory where such standards have been established for the supplies, materials or equipment. See paragraph minimum requirements Section 27 05 11, REQUIREMENTS FOR COMMUNICATIONS INSTALLATIONS, and the guidelines listed in paragraph 2.J.2.
- The provided active and passive equipment required by the System design and approved technical submittal must conform with each UL standard in effect for the equipment, as of the date of the technical submittal (or the date when the RE approved system equipment necessary to be replaced) was technically reviewed and approved by VA. Where a UL standard is in existence for equipment to be used in completion of this contract, the equipment must bear the approved UL seal.
- Each item of electronic equipment to be provided under this contract must bear the approved UL seal or the seal of the testing laboratory

that warrants the equipment has been tested in accordance with, and conforms to the specified standards.

2.2 EQUIPMENT ITEMS

A. Cabinet with Internal Equipment Mounting Rack:

1. The provided equipment cabinet shall be lockable, fabricated of heavy 16 gauge (ga) steel, and have fully adjustable internal equipment mounting racks or rails that allows front panel equipment mounting and access. It shall have baked-on iron phosphate primer and baked enamel paint finish in a color to be selected by the using Facility Service Chief. It shall be floor or wall mounted with knock-out holes for cable entrance and conduit connection, contain ventilation ports and a quiet fan with non disposable air filter for equipment cooling. Two keys shall be provided to the COTR for each lock when the VA accepts the System.
2. A minimum of one cabinet shall be provided with blank rack space, for additional equipment. Blank panels shall be installed to cover any open or unused rack space. In addition, provide two 120 VAC power strips connected to surge protectors, a ventilation fan with non-disposable air filter, and a conduit or cable duct interfaced to adjacent cabinet(s), as part of this cabinet.
3. Blank panels shall be color matched to the cabinet, 3.175 mm (1/8in.) aluminum with vertical dimensions in increments of one rack unit 45 mm (or 1.75in.) with mounting holes spaced to correspond to EIA 480 mm (or 19in.) rack dimensions. Single standard size blank panels shall be used to fill unused panel or rack spaces in lieu of numerous 45 mm (1.75in.) types. One blank 45 mm (1.75in.) high blank panel shall be installed between each item of equipment.
4. Technical Characteristics:

Overall Height	2180 mm (85 7/8in.), maximum
Overall Depth	650 mm (25 1/2in.), maximum
Overall Width	535 mm (21 1/16in.), maximum
Front Panel Opening Width	480 mm (19in.), EIA horizontal
Hole Spacing	per EIA and Industry Standards

5. Internal Cabinet Components (minimum required):
 - a. AC power outlet strip(s):

- 1) Power outlet strip(s) shall be provided as directed by the RE or the IRM. The additional equipment cabinet with no installed items in the cabinet, shall contain strip(s) with a minimum of 12 ea. AC power outlets. Each strip shall be mounted inside and at the rear of the cabinet. It shall contain "U" grounded AC outlets for distributing AC power to the installed electronic equipment. The strip shall be self-contained in a metal enclosure and may be provided with a 2 M (6 ft.) long (maximum) connecting cord with three prong plug.
 - 2) Technical Characteristics:
 - a) Power capacity 20 Ampere (AMP), 120 VAC continuous duty.
 - b) Wire gauge: Three conductor, #12 AWG copper.
- b. Cabinet AC Power Line Surge Protector and Filter:
- 1) Each cabinet shall be equipped with a AC Surge Protector and Filter. The Protector and Filter shall be housed in one single enclosure. The Protector and Filter shall perform instantaneous regulation of the AC input voltage and isolate and filter any noise present on the AC input line. The unit shall be equipped with AC voltage and current surge protectors to prevent damage to the electronic equipment from power line induced voltage spikes, surges, lightning, etc. It shall be cabinet mounted and the cabinet AC power strip (maximum of two strips) may be connected to it as long as the system design is met.
 - 2) Technical Characteristics:

Input Voltage range	120 VAC \pm 15%
Power capacity	20 AMP, 120 VAC
Voltage output regulation	\pm 3.0%
Circuit breaker	15 AMP, may be self contain
Noise filtering	Greater than -45 dB
AC outlets	Four duplex grounded types, minimum
Response time	5.0 ns
Surge suppression	10,000 AMPS
Noise suppression	
Common	-40 dB

Differential	-45 dB
--------------	--------

- 3) Specific requirements for current and surge protection shall include:
- a) Voltage protection threshold, line to neutral, starts at no more than 220 Volts peak. The transient voltage shall not exceed 300 volts peak. The Contractor shall furnish documentation on peak clamping voltage as a function of transient AMP.
 - b) Peak power dissipation minimum 35 Joules per phase, as measured for 1.0 mS at sub branch panels, 100 Joules per phase at branch panels and 300 Joules per phase at service entrance panels. The Contractor shall furnish an explanation of how the ratings were measured or empirically derived.
 - c) Surge protector must not short circuit the AC power line at any time.
 - (1) The primary surge protection components must be silicon semiconductors. Secondary stages, if used, may include other types of devices.
 - (2) Surge protectors shall incorporate a visual device which indicates whether the surge suppression component(s) is (are) functioning.
 - (3) Surge protection devices shall be UL listed.
 - (4) Voltage and current surge protectors shall be provided on all ancillary equipment provided by the Contractor.
 - d) Power dissipation 12,000 Watts (W) for 1.0 mS (or 12 Joules).
 - e) Voltage protection threshold starts at not more than 100 VAC.

B. Environmental Cabinet (if selected):

1. The Contractor shall provide this enclosure in lieu of a standard equipment cabinet identified in Paragraph 2.3.A to meet system design in hostile TC locations as identified on the drawings. The enclosure shall fully sustain the installed, including electronic, equipment in the same manner as the standard cabinet identified in Paragraph 2.3.A. Additionally, the enclosure shall fully support all installed equipment as if they were in a stand alone air handling

area regardless of the local area's air handling capabilities. The enclosure shall be a OEM's fully assembled unit. If more than two enclosures are required in any system location, those enclosures shall be OEM assembled for consolidating or combining two or more enclosures in a single unit to meet system space and equipment handling designs.

2. Technical Characteristics:

Environmental control	Automatic, heating and/or cooling, as required
Temperature conditions (rated at 1,300 W of install equipment heat generation):	
Internal Range	Maintains 80° to 105° of internal heat conditions, maximum
External Range	100° \pm 25°, maximum
Forced air unit	Required with non disposable air filter unobstructed and uninterruptible
Air conditioning	As required, fully internal mounted
Heater	As required, fully internal mounted
Uninterruptible power supply	As required, fully internal mounted
Front door	Full length, see through, EMI resistant, and lockable
Rear door	Full length, non-see through, EMI resistant, and lockable
Conduit wiring entrance	TOP AND/OR BOTTOM, FULLY SEALED
Input power	2 ea. minimum 120 VAC @ 20A, maximum, independent circuit, conduit for fixed or armored cable for moveable installations
Dimensions:	
Height	1980 mm (78in.), maximum
Width	635 mm (25in.), maximum
Depth	965 mm (38in.), maximum
Front panel opening	480 mm (19in.), w/ EIA mounting hole spacing

C. Distribution or System Interface Cabinet:

1. The cabinet shall be constructed of heavy 16 gauge cold rolled steel, have top and side panels and hinged front and rear (front door only if wall mounted) doors. It shall have baked-on iron

phosphate primer and baked enamel paint finish in a color to be selected by the using Facility Service Chief or the COTR, contain integral and adjustable predrilled rack mounting rails or frame that allows front panel equipment mounting and access. When all equipment, doors and panels are installed, snap-in-place chrome trim strip covers are required to be installed that will cover all front panel screw fasteners. It shall be equipped the same as the equipment cabinet.

2. Technical Characteristics:

Overall height	2180 mm (85 7/8in.), maximum
Overall depth	650 mm (25 1/2in.), maximum
Overall width	535 mm (21 1/16in.), maximum
Equipment vertical mounting space	1960 mm (77 1/8in.), maximum
Front panel horizontal	484 mm (19 1/16in.), maximum width

D. Stand Alone Equipment (or sometimes called Radio Relay) Rack:

1. The rack shall be constructed of heavy 16 gauge cold rolled steel and have fully adjustable equipment front mounting rails that allows front panel equipment mounting and access. It shall have baked-on iron phosphate primer and baked enamel paint finish in a color to be selected by the using Facility Service Chief or the COTR. It shall be floor or wall mounted or mounted on casters as directed by the COTR.

2. Technical Characteristics:

Overall Height	2180 mm (85 7/8in.), maximum
Overall Depth	650 mm (25 1/2in.), maximum
Overall Width	535 mm (21 1/16in.), maximum
Front Panel Opening	480 mm (19in.), EIA horizontal width
Hole Spacing	per EIA and Industry Standards

E. Cross-Connection System (CCS) Equipment Breakout, Termination Connector (or Bulkhead), and Patch Panels:

1. The connector panel(s) shall be made of flat smooth 3.175 mm (1/8 in.) thick solid aluminum, custom designed, fitted and installed in the cabinet. Bulkhead equipment connectors shall be mounted on the

panel to enable all cabinet equipment's signal, control, and coaxial cables to be connected through the panel. Each panel shall be color matched to the cabinet installed.

a. Voice (or Telephone):

- 1) The CSS for voice or telephone service shall be Industry Standard type 110 (minimum) punch blocks for voice or telephone, and control wiring in lieu of patch panels, each being certified for category six service. IDC punch blocks (with internal RJ45 jacks) are acceptable for use in all CCS and shall be specifically designed for category six telecommunications service and the size and type of UTP cable used as described herein. As a minimum, punch block strips shall be secured to an OEM designed physical anchoring unit on a wall location in the MTC, IMTC, RTC, and TC. However, console, cabinet, rail, panel, etc. mounting is allowed at the OEM recommendation and as approved by the RE. Punch blocks shall not be used for Class II or 120 VAC power wiring.

2) Technical Characteristics:

Number of horizontal rows	100, MINIMUM
Number of terminals per row	4, minimum
Terminal protector	required for each used or unused terminal
Insulation splicing	required between each row of terminals

b. Digital or High Speed Data:

- 1) The CSS for digital or high-speed data service shall be a patch panel with modular female RJ45 jacks installed in rows. Patch panels and RJ45 jacks shall be specifically designed for category six telecommunications service and the size and type of UTP or STP cable used. Each panel shall be 480 mm (19in.) horizontal EIA rack mountable dimensions with EIA standard spaced vertical mounting holes.

2) Technical Characteristics:

Number of horizontal rows	2, minimum
Number of jacks per row	24, MINIMUM

Type of jacks	RJ45
Terminal protector	required for each used or unused jack
Insulation	required between each row of jacks

c. Fiber optic, and Analog Audio:

- 1) Product reference of a Government Approved (US State Department) type is Telewire, PUP-17 with pre-punched chassis mounting holes arranged in two horizontal rows. This panel may be used for fiber optic, audio, control cable, and Class II Low Voltage Wiring installations when provided with the proper connectors. This panel is not allowed to be used for 120 VAC power connections.

2) Technical Characteristics:

Height	Two rack units (RUs), 88 mm (3.5in.) minimum
Width	484 mm (19 1/16in.), EIA minimum
Number of connections	12 pairs, minimum
Connectors	
Audio Service	Use RCA 6.35 mm (1/4in.) Phono, XL or Barrier Strips, surface mounted with spade lugs (punch block or wire wrap type strips are acceptable alternates for barrier strips as long as system design is maintained and RE approved)
Control Signal Service	Barrier strips surface mounted with spade lugs (punch block or wire wrap type strips are acceptable alternates for barrier strips as long as system design is maintained and RE approved)
Low voltage power (class II)	Barrier strips with spade lugs and clear full length plastic cover, surfaced mounted
Fiber optic	"ST" Stainless steel, female

d. Mounting Strips and Blocks:

- 1) Barrier Strips: Barrier strips are approved for AC power, data, voice, and control cable or wires. Barrier strips shall accommodate the size and type of audio spade (or fork type)

lugs used with insulating and separating strips between the terminals for securing separate wires in a neat and orderly fashion. Each cable or wire end shall be provided with an audio spade lug, which is connected to an individual screw terminal on the barrier strip. The barrier strips shall be surface secured to a console, cabinet, rail, panel, etc. 120 VAC power wires shall not be connected to signal barrier strips.

2) Technical Characteristics:

Terminal size	6-32, minimum
Terminal Count	ANY COMBINATION
Wire size	20 AWG, minimum
Voltage handling	100 V, minimum
Protective connector cover	Required for Class II and 120 VAC power connections

2. Solderless Connectors: The connectors (or fork connectors) shall be crimp-on insulated lug to fit a 6-32 minimum screw terminal. The fork connector shall be installed using a standard lug-crimping tool.
 3. Punch Blocks: As a minimum, Industry Standard 110 type punch blocks are approved for data, voice, and control wiring. Punch blocks shall be specifically designed for the size and type of wire used. Punch block strips shall be secured to a console, cabinet, rail, panel, etc. Punch blocks shall not be used for Class II or 120 VAC power wiring.
 4. Wire Wrap Strips: Industry Standard wire wrap strips (16.5 mm (0.065in.) wire wrap minimum) are approved for data, voice and control wiring. Wire wrap strips shall be secured to a cabinet, rail, panel, etc. Wire wrap strips shall not be used for Class II or 120 VAC power wiring.
- F. Wire Management System and Equipment:
1. Wire Management System: The system(s) shall be provided as the management center of the respective cable system, CCS, and TC it is incorporated. It shall perform as a platform to house peripheral equipment in a standard relay rack or equipment cabinet. It shall be arranged in a manner as to provide convenient access to all

installed management and other equipment. All cables and connections shall be at the rear of each system interface to IDC and/or patch panels, punch blocks, wire wrap strips, and/or barrier strip.

2. Wire Management Equipment: The wire management equipment shall be the focal point of each wire management system. It shall provide an orderly interface between outside and inside wires and cables (where used), distribution and interface wires and cables, interconnection wires and cables and associated equipment, jumper cables, and provide a uniform connection media for all system fire retardant wires and cables and other subsystems. It shall be fully compatible and interface to each cable tray, duct, wireway, or conduit used in the system. All interconnection or distribution wires and cables shall enter the system at the top (or from a wireway in the floor) via a overhead protection system and be uniformly routed down either side (or both at the same time) of the frames side protection system then laterally via a anchoring or routing shelf for termination on the rear of each respective terminating assembly. Each system shall be custom configured to meet the System design and user needs.

2.3 ENVIRONMENTAL REQUIREMENTS

Technical submittals shall identify the environmental specifications for housing the system. These environmental specifications shall identify the requirements for initial and expanded system configurations for:

- A. Floor loading for batteries and cabinets.
- B. Minimum floor space and ceiling heights.
- C. Minimum size of doors for equipment passage.
- D. Power requirements: The bidders shall provide the specific voltage, amperage, phases, and quantities of circuits required.
- E. Air conditioning, heating, and humidity requirements. The bidder shall identify the ambient temperature and relative humidity operating ranges required preventing equipment damage.
- F. Air conditioning requirements (expressed in BTU per hour, based on adequate dissipation of generated heat to maintain required room and equipment standards).
- G. Proposed floor plan based on the expanded system configuration of the bidder's proposed EPBX for this Facility.
- H. Conduit size requirement (between equipment room and console room).

2.4 INSTALLATION KIT

The kit shall be provided that, at a minimum, includes all connectors and terminals, labeling systems, audio spade lugs, barrier strips, punch blocks or wire wrap terminals, heat shrink tubing, cable ties, solder, hangers, clamps, bolts, conduit, cable duct, and/or cable tray, etc., required to accomplish a neat and secure installation. All wires shall terminate in a spade lug and barrier strip, wire wrap terminal or punch block. Unfinished or unlabeled wire connections shall not be allowed. Turn over to the RE all unused and partially opened installation kit boxes, coaxial, fiberoptic, and twisted pair cable reels, conduit, cable tray, and/or cable duct bundles, wire rolls, physical installation hardware. The following are the minimum required installation sub-kits:

A. System Grounding:

1. The grounding kit shall include all cable and installation hardware required. All radio equipment shall be connected to earth ground via internal building wiring, according to the NEC.
2. This includes, but is not limited to:
 - a. Coaxial Cable Shields.
 - b. Control Cable Shields.
 - c. Data Cable Shields.
 - d. Equipment Racks.
 - e. Equipment Cabinets.
 - f. Conduits.
 - g. Duct.
 - h. Cable Trays.
 - i. Power Panels.
 - j. Connector Panels.
 - k. Grounding Blocks.

- B. Coaxial Cable: The coaxial cable kit shall include all coaxial connectors, cable tying straps, heat shrink tabbing, hangers, clamps, etc., required to accomplish a neat and secure installation.
- C. Wire and Cable: The wire and cable kit shall include all connectors and terminals, audio spade lugs, barrier straps, punch blocks, wire wrap strips, heat shrink tubing, tie wraps, solder, hangers, clamps, labels etc., required to accomplish a neat and orderly installation.
- D. Conduit, Cable Duct, and Cable Tray: The kit shall include all conduit, duct, trays, junction boxes, back boxes, cover plates, feed through

nipples, hangers, clamps, other hardware required to accomplish a neat and secure conduit, cable duct, and/or cable tray installation in accordance with the NEC and this document.

- E. Equipment Interface: The equipment kit shall include any item or quantity of equipment, cable, mounting hardware and materials needed to interface the systems with the identified sub-system(s) according to the OEM requirements and this document.
- F. Labels: The labeling kit shall include any item or quantity of labels, tools, stencils, and materials needed to completely and correctly label each subsystem according to the OEM requirements, as-installed drawings, and this document.
- G. Documentation: The documentation kit shall include any item or quantity of items, computer discs, as installed drawings, equipment, maintenance, and operation manuals, and OEM materials needed to completely and correctly provide the system documentation as required by this document and explained herein.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Product Delivery, Storage and Handling:
 - 1. Delivery: Deliver materials to the job site in OEM's original unopened containers, clearly labeled with the OEM's name and equipment catalog numbers, model and serial identification numbers. The RE may inventory the cable, patch panels, and related equipment.
 - 2. Storage and Handling: Store and protect equipment in a manner, which will preclude damage as directed by the COTR.
- B. System Installation:
 - 1. After the contract's been awarded, and within the time period specified in the contract, the Contractor shall deliver the total system in a manner that fully complies with the requirements of this specification. The Contractor shall make no substitutions or changes in the System without written approval from the COTR and PM.
 - 2. The Contractor shall install all equipment and systems in a manner that complies with accepted industry standards of good practice, OEM instructions, the requirements of this specification, and in a manner which does not constitute a safety hazard. The Contractor shall insure that all installation personnel understands and complies with all the requirements of this specification.

3. The Contractor shall install suitable filters, traps, directional couplers, splitters, TC's, and pads for minimizing interference and for balancing the System. Items used for balancing and minimizing interference shall be able to pass telephone and data, and lightwave, and analog signals in the frequency bands selected, in the direction specified, with low loss, and high isolation, and with minimal delay of specified frequencies and signals. The Contractor shall provide all equipment necessary to meet the requirements of Paragraph 2.1.C and the System performance standards.
4. All passive equipment shall be connected according to the OEM's specifications to insure future correct termination, isolation, impedance match, and signal level balance at each telephone/data outlet.
5. Where TCOs are installed adjacent to each other, install one outlet for each instrument.
6. All lines shall be terminated in a suitable manner to facilitate future expansion of the System. There shall be a minimum of one spare 25 pair cable at each distribution point on each floor.
7. All vertical copper and fiber optic, and coaxial cables shall be terminated so any future changes only requires modifications of the existing and new EPBX or signal closet equipment only.
8. Terminating resistors or devices shall be used to terminate all unused branches, outlets, equipment ports of the System, and shall be devices designed for the purpose of terminating fiber optic or twisted pair, and coaxial, and lightwave cables carrying telephone and data, and analog signals in telephone and data, and analog video, and lightwave systems.
9. Equipment installed outdoors shall be weatherproof or installed in weatherproof enclosures with hinged doors and locks with two keys.
10. Equipment installed indoors shall be installed in metal cabinets with hinged doors and locks with two keys.

C. Conduit and Signal Ducts:

1. Conduit:
 - a. The Contractor shall employ the latest installation practices and materials. The Contractor shall provide conduit, junction boxes, connectors, sleeves, weatherheads, pitch pockets, and associated sealing materials not specifically identified in this document as GFE. Conduit penetrations of walls, ceilings, floors,

interstitial space, fire barriers, etc., shall be sleeved and sealed. The minimum conduit size shall be 19 mm (3/4 in.).

- b. All cables shall be installed in separate conduit and/or signal ducts (exception from the separate conduit requirement to allow telephone cables to be installed in partitioned cable tray with data cables may be granted in writing by the RE if requested.) Conduits shall be provided in accordance with Section 27 05 33, RACEWAYS AND BOXES FOR COMMUNICATIONS SYSTEMS, and NEC Articles 517 for Critical Care and 800 for Communications systems, at a minimum.
 - c. When metal, plastic covered, etc., flexible cable protective armor or systems are specifically authorized to be provided for use in the System, their installation guidelines and standards shall be as specified herein, Section 27 05 33, RACEWAYS AND BOXES FOR COMMUNICATIONS SYSTEMS, and the NEC.
 - d. When "innerduct" flexible cable protective systems is specifically authorized to be provided for use in the System, it's installation guidelines and standards shall be as the specified herein, Section 27 05 33, RACEWAYS AND BOXES FOR COMMUNICATIONS SYSTEMS, and the NEC.
 - e. Conduit (including GFE) fill shall not exceed 40%. Each conduit end shall be equipped with a protective insulator or sleeve to cover the conduit end, connection nut or clamp, to protect the wire or cable during installation and remaining in the conduit. Electrical power conduit shall be installed in accordance with the NEC. AC power conduit shall be run separate from signal conduit.
 - f. When metal, plastic covered, etc., flexible cable protective armor or systems are specifically authorized to be provided for use in the System, their installation guidelines and standards shall be as specified herein, Section 27 05 33, RACEWAYS AND BOXES FOR COMMUNICATIONS SYSTEMS, and the NEC.
 - g. Ensure that Critical Care ----- Nurse Call and PA systems (as identified by NEC Section 517) are completely separated and protected from all other systems.
2. Signal Duct, Cable Duct, or Cable Tray:
- a. The Contractor shall use existing signal duct, cable duct, and/or cable tray, when identified and approved by the RE.

- b. Approved signal and/or cable duct shall be a minimum size of 100 mm x 100 mm (4 in. X 4 in.) inside diameter with removable tops or sides, as appropriate. Protective sleeves, guides or barriers are required on all sharp corners, openings, anchors, bolts or screw ends, junction, interface and connection points.
 - c. Approved cable tray shall be fully covered, mechanically and physically partitioned for multiple electronic circuit use, and be UL certified and labeled for use with telecommunication circuits and/or systems. The RE shall approve width and height dimensions.
- F. Connectors: Circuits, transmission lines, and signal extensions shall have continuity, correct connection and polarity. A uniform polarity shall be maintained between all points in the system.
- 1. Wires:
 - a. Wire ends shall be neatly formed and where insulation has been cut, heat shrink tubing shall be employed to secure the insulation on each wire. Tape of any type is not acceptable.
 - b. Audio spade lugs shall be installed on each wire (including spare or unused) end and connect to screw terminals of appropriate size barrier strips. AC barrier strips shall be provided with a protective cover to prevent accidental contact with wires carrying live AC current. Punch blocks are approved for signal, not AC wires. Wire Nut or "Scotch Lock" connectors are not acceptable for signal wire installation.
 - 2. Cables: Each connector shall be designed for the specific size cable being used and installed with the OEM's approved installation tool. Typical system cable connectors include; but, are not limited to: Audio spade lug, punch block, wirewrap, etc.
 - 3. Line or Microphone Audio: Each connector shall be installed according to the cable or connector OEM's instructions and use the OEM's approved installation tool. Install the connector's to provide and maintain the following audio signal polarity:
 - a. XLR type connectors Signal or positive conductor is pin 3; common or neutral conductor is pin 2; ground conductor is pin 1.
 - b. Two and 3 conductor 1/4 inch Signal or positive conductor is tip; neutral or 1/8 inch phono plugs conductor is ring and ground or shield and jacks conductor is sleeve.

- c. RCA Phono Plugs the Signal or positive conductor is tip; and Jacks neutral or shield conductor is sleeve.

4. Speaker Line Audio:

- a. Each connector shall be installed according to the cable, transformer or speaker OEM instructions and using the OEM's approved installation tool. The Contractor shall ensure each speaker is properly phased and connected in the same manner throughout the System using two conductor type wires.
- b. One of the conductors shall be color coded to aid in establishing speaker signal polarity. Each speaker line shall be permanently soldered or audio spade lug connected to each appropriate speaker or line matching transformer connection terminal. Speaker line connection to each audio amplifier shall use audio spade lugs, as described herein.

G. AC Power: AC power wiring shall be run separately from signal cable.

H. Grounding:

- 1. General: The Contractor shall ground all Contractor Installed Equipment and identified Government Furnished Equipment to eliminate all shock hazards and to minimize, to the maximum extent possible, all ground loops, common mode returns, noise pickup, crosstalk, etc. The total ground resistance shall be 0.1 Ohm or less.
 - a. The Contractor shall install lightning arrestors and grounding in accordance with the NFPA and this specification.
 - b. Gas protection devices shall be provided on all circuits and cable pairs serving building distribution frames located in buildings other than the building in which it is located or in any area served by an unprotected distribution system (manhole, aerial, etc.). The Contractor shall install the gas protection devices at the nearest point of entrance in buildings where protection is required and on the same circuits on the MDF in the telephone switch room.
 - c. Under no conditions shall the AC neutral, either in a power panel or in a receptacle outlet, be used for system control, subcarrier or audio reference ground.
 - d. The use of conduit, signal duct or cable trays as system or electrical ground is not acceptable and will not be permitted. These items may be used only for the dissipation of internally generated static charges (not to be confused with externally

generated lightning) that may applied or generated outside the mechanical and/or physical confines of the System to earth ground. The discovery of improper system grounding shall be grounds to declare the System unacceptable and the termination of all system acceptance testing.

2. Cabinet Buss: A common ground buss of at least #10 AWG solid copper wire shall extend throughout each equipment cabinet and be connected to the system ground. Provide a separate isolated ground connection from each equipment cabinet ground buss to the system ground. Do not tie equipment ground busses together.
 3. Equipment: Equipment shall be bonded to the cabinet bus with copper braid equivalent to at least #12 AWG. Self grounding equipment enclosures, racks or cabinets, that provide OEM certified functional ground connections through physical contact with installed equipment, are acceptable alternates.
 4. Cable Shields: Cable shields shall be bonded to the cabinet ground buss with #12 AWG minimum stranded copper wire at only one end of the cable run. Cable shields shall be insulated from each other, faceplates, equipment racks, consoles, enclosures or cabinets; except, at the system common ground point. Coaxial and audio cables, shall have one ground connection at the source; in all cases, cable shield ground connections shall be kept to a minimum.
- I. Equipment Assembly:
1. Cabinets:
 - a. Each enclosure shall be: floor or wall mounted with standard knockout holes for conduit connections or cable entrance; provide for ventilation of the equipment; have front and rear locking doors (except wall mounted cabinets that require only a front locking door); power outlet strip(s), and connector or patch panel(s).
 - b. Rack (including freestanding radio relay) mounted equipment shall be installed in the enclosure's equipment adjustable mounting racks with equipment normally requiring adjustment or observation mounted so operational adjustment(s) can be conveniently made. Heavy equipment shall be mounted with rack slides or rails allowing servicing from the front of the enclosure. Heavy equipment shall not depend only upon front panel mounting screws for support. Equipment shall be provided with sufficient cable

slack to permit servicing by removal of the installed equipment from the front of the enclosure. A color matched blank panel (spacer) of 44 mm (1.75 in.) high, shall be installed between each piece of equipment (active or passive) to insure adequate air circulation. The enclosure shall be designed for efficient equipment cooling and air ventilation. Each console or cabinet shall be equipped with a quiet fan and nondisposable air filter.

- c. Enclosures and racks shall be installed plumb and square. Each shall be permanently attached to the building structure and held firmly in place. Fifteen inches of front vertical space opening shall be provided for additional equipment.
- d. Signal connector, patch, and bulkhead panels (i.e.: audio, data, control, analog video, etc.) shall be connected so that outputs from each source, device or system component shall enter the panel at the top row of jacks, beginning left to right as viewed from the front, which will be called "inputs". Each connection to a load, device or system component shall exit the panel at the bottom row of jacks, beginning left to right as viewed from the front, which will be called "outputs".
 - 1) Equipment located indoors shall be installed in metal racks or enclosures with hinged doors to allow access for maintenance without causing interference to other nearby equipment.
 - 2) Cables shall enter the equipment racks or enclosures in such a manner that allows all doors or access panels to open and close without disturbing or damaging the cables.
 - 3) All distribution hardware shall be securely mounted in a manner that allows access to the connections for testing and provides sufficient room for the doors or access panels to open and close without disturbing the cables.

J. Labeling: Provide labeling in accordance with ANSI/EIA/TIA-606-A. All lettering for voice and data circuits shall be stenciled using laser printers. Handwritten labels are not acceptable.

- 1. Cable and Wires (Hereinafter referred to as "Cable"): Cables shall be labeled at both ends in accordance with ANSI/EIA/TIA-606-A. Labels shall be permanent in contrasting colors. Cables shall be identified according to the System "Record Wiring Diagrams".
- 2. Equipment: System equipment shall be permanently labeled with contrasting plastic laminate or bakelite material. System equipment

shall be labeled on the face of the unit corresponding to its source.

3. Conduit, Cable Duct, and/or Cable Tray: The Contractor shall label all conduit, duct and tray, including utilized GFE, with permanent marking devices or spray painted stenciling a minimum of 3 meters (10 ft.) identifying it as the System. In addition, each enclosure shall be labeled according to this standard.
4. Termination Hardware: The Contractor shall label workstation outlets and patch panel connections using color coded labels with identifiers in accordance with ANSI/EIA/TIA-606-A and the "Record Wiring Diagrams".

3.2 TESTS

A. Interim Inspection:

1. This inspection shall verify that the equipment provided adheres to the installation requirements of this document. The interim inspection will be conducted by a factory-certified representative and witnessed by a Government Representative. Each item of installed equipment shall be checked to insure appropriate UL certification markings. This inspection shall verify cabling terminations in telecommunications rooms and at workstations adhere to color code for T568B or T568A pin assignments and cabling connections are in compliance with ANSI/EIA/TIA standards. Visually confirm Category 6 marking of outlets, faceplates, outlet/connectors and patch cords.
2. Perform fiber optical field inspection tests via attenuation measurements on factory reels and provide results along with manufacturer certification for factory reel tests. Remove failed cable reels from project site upon attenuation test failure.
3. The Contractor shall notify the COTR, in writing, of the estimated date the Contractor expects to be ready for the interim inspection, at least 20 working days before the requested inspection date.
4. Results of the interim inspection shall be provided to the COTR and PM. If major or multiple deficiencies are discovered, a second interim inspection may be required before permitting the Contractor to continue with the system installation.
5. The COTR and/or the PM shall determine if an additional inspection is required, or if the Contractor will be allowed to proceed with the installation. In either case, re-inspection of the deficiencies noted during the interim inspection(s), will be part of the proof of

performance test. The interim inspection shall not affect the Systems' completion date. The COTR shall ensure all test documents will become a part of the Systems record documentation.

B. Pretesting:

1. Upon completing the installation of the System, the Contractor shall align and balance the system. The Contractor shall pretest the entire system.
2. Pretesting Procedure:
 - a. During the system pretest, the Contractor shall verify (utilizing the approved spectrum analyzer and test equipment) that the System is fully operational and meets all the system performance requirements of this standard.
 - b. The Contractor shall pretest and verify that all System functions and specification requirements are met and operational, no unwanted aural effects, such as signal distortion, noise pulses, glitches, audio hum, poling noise, etc. are present. The Contractor shall measure and record the aural carrier levels of each system telephone and data channel, at each of the following points in the system:
 - 1) Local Telephone Company Interfaces or Inputs.
 - 2) EPBX interfaces or inputs and outputs.
 - 3) MDF interfaces or inputs and outputs.
 - 4) EPBX output S/NR for each telephone and data channel.
 - 5) Signal Level at each interface point to the distribution system, the last outlet on each trunk line plus all outlets installed as part of this contract.
3. The Contractor shall provide four (4) copies of the recorded system pretest measurements and the written certification that the System is ready for the formal acceptance test shall be submitted to the COTR.

C. Acceptance Test:

1. After the System has been pretested and the Contractor has submitted the pretest results and certification to the COTR, then the Contractor shall schedule an acceptance test date and give the COTR 30 calendar days written notice prior to the date the acceptance test is expected to begin. The System shall be tested in the presence of a Government Representative and an OEM certified representative. The System shall be tested utilizing the approved

test equipment to certify proof of performance and Life Safety compliance. The test shall verify that the total System meets the requirements of this specification. The notification of the acceptance test shall include the expected length (in time) of the test.

D. Verification Tests:

1. Test the UTP or STP copper cabling for DC loop resistance, shorts, opens, intermittent faults, and polarity between conductors, and between conductors and shield, if cable has an overall shield. Test the operation of shorting bars in connection blocks. Test cables after termination and prior to cross-connection.
2. Multimode Fiber Optic Cable: Perform end-to-end attenuation tests in accordance with ANSI/EIA/TIA-568-B.3 and ANSI/EIA/TIA-526-14A using Method A, Optical Power Meter and Light Source. Perform verification acceptance test.
3. Single mode Fiber Optic Cable: Perform end-to-end attenuation tests in accordance with ANSI/EIA/TIA-568-B.3 and ANSI/EIA/TIA-526-7 using Method A, Optical Power Meter and Light Source. Perform verification acceptance test.

E. Performance Testing:

1. Perform Category 6 tests in accordance with ANSI/EIA/TIA-568-B.1 and ANSI/EIA/TIA-568-B.2. Test shall include the following: wire map, length, insertion loss, return loss, NEXT, PSNEXT, ELFEXT, PSELFEXT, propagation delay and delay skew.
2. Fiber Optic Links: Perform end-to-end fiber optic cable link tests in accordance with ANSI/EIA/TIA-568-B.3.

F. Total System Acceptance Test: The Contractor shall perform verification tests for UTP or STP copper cabling system(s) and the multimode and single mode fiber optic cabling system(s) after the complete telecommunication distribution system and workstation outlet are installed.

1. Voice Testing: Connect to the network interface device at the demarcation point. Go off-hook and receive dial tone from the LEC. If a test number is available, place and receive a local, long distance, and FTS telephone call.
2. Data Testing: Connect to the network interface device at the demarcation point. Log onto the network to ensure proper connection to the network is achieved.

3.3 TRAINING

- A. Furnish the services of a factory-trained engineer or technician for a total of two four hour classes to instruct designated Facility IRM personnel. Instruction shall include cross connection, corrective, and preventive maintenance of the System and equipment.
- B. Before the System can be accepted by the VA, this training must be accomplished. Training will be scheduled at the convenience of the COTR and Chief of Engineering Service.

3.4 GUARANTEE PERIOD OF SERVICE

- A. Contractor's Responsibilities:
 - 1. The Contractor shall guarantee that all installed material and equipment will be free from defects, workmanship, and will remain so for a period of one year from date of final acceptance of the System by the VA. The Contractor shall provide OEM's equipment warranty documents, to the COTR (or Facility Contracting Officer if the Facility has taken possession of the building(s)), that certifies each item of equipment installed conforms to OEM published specifications.
 - 2. The Contractor's maintenance personnel shall have the ability to contact the Contractor and OEM for emergency maintenance and logistic assistance, remote diagnostic testing, and assistance in resolving technical problems at any time. The Contractor and OEM shall provide this contact capability at no additional cost to the VA.
 - 3. All Contractor installation, maintenance, and supervisor personnel shall be fully qualified by the OEM and must provide two (2) copies of current and qualified OEM training certificates and OEM certification upon request.
 - 4. Additionally, the Contractor shall accomplish the following minimum requirements during the one year guarantee period:
 - a. Response Time:
 - 1) The COTR (or facility Contracting Officer if the facility has taken possession of the building[s]) are the Contractor's reporting and contact officials for the System trouble calls, during the guarantee period.
 - 2) A standard workweek is considered 8:00 A.M. EST to 5:00 P.M. EST, Monday through Friday exclusive of Federal Holidays.

- 3) The Contractor shall respond and correct on-site trouble calls, during the standard work week to:
 - a) A routine trouble call within one working days of its report. A routine trouble is considered a trouble which causes a system outlet, station, or patch cord to be inoperable.
 - b) An emergency trouble call within 6 hours of its report. An emergency trouble is considered a trouble which causes a subsystem or distribution point to be inoperable at anytime. Additionally, the loss of a minimum of 50 station or system lines shall be deemed as this type of a trouble call.
- 4) The Contractor shall respond on-site to a catastrophic trouble call within 4 hours of its report. A catastrophic trouble call is considered total system failure.
 - a) If a system failure cannot be corrected within four hours (exclusive of the standard work time limits), the Contractor shall be responsible for providing alternate system CSS or TCO equipment, or cables. The alternate equipment and/or cables shall be operational within four hours after the four hour trouble shooting time.
 - b) Routine or emergency trouble calls in critical emergency health care facilities (i.e., cardiac arrest, intensive care units, etc.) shall also be deemed as a catastrophic trouble call if so determined by the COTR or Facility Director. The COTR or Facility Contracting Officer shall notify the Contractor of this type of trouble call at the direction of the Facilities Director.
- b. Required on-site visits during the one year guarantee period
 - 1) The Contractor shall visit, on-site, for a minimum of eight hours, once every 12 weeks, during the guarantee period, to perform system preventive maintenance, equipment cleaning, and operational adjustments to maintain the System according the descriptions identified in this SPEC.
 - a) The Contractor shall arrange all Facility visits with the COTR or Facility Contracting Officer prior to performing the required maintenance visits.

- b) The Contractor in accordance with the OEM's recommended practice and service intervals shall perform preventive maintenance during a non-busy time agreed to by the COTR or Facility Contracting Officer and the Contractor.
 - c) The preventive maintenance schedule, functions and reports shall be provided to and approved by the COTR or Facility Contracting Officer.
- 2) The Contractor shall provide the COTR or Facility Contracting Officer a type written report itemizing each deficiency found and the corrective action performed during each required visit or official reported trouble call. The Contractor shall provide the COTR with sample copies of these reports for review and approval at the beginning of the Total System Acceptance Test. The following reports are the minimum required:
- a) Monthly Report: The Contractor shall provide a monthly summary all equipment and sub-systems serviced during this guarantee period to COTR or Facilities Contracting Officer by the fifth working day after the end of each month. The report shall clearly and concisely describe the services rendered, parts replaced and repairs performed. The report shall prescribe anticipated future needs of the equipment and Systems for preventive and predictive maintenance
 - b) Contractor Log: The Contractor shall maintain a separate log entry for each item of equipment and each sub-system of the System. The log shall list dates and times of all scheduled, routine, and emergency calls. Each emergency call shall be described with details of the nature and causes of emergency steps taken to rectify the situation and specific recommendations to avoid such conditions in the future.
- 3) The COTR or Facility Contracting Officer shall provide the Facility Engineering Officer, two (2) copies of actual reports for evaluation.
- a) The COTR or Facility Contracting Officer shall ensure copies of these reports are entered into the System's official acquisition documents.

b) The Facilities Chief Engineer shall ensure copies of these reports are entered into the System's official technical as-installed documents.

B. Work Not Included: Maintenance and repair service shall not include the performance of any work due to improper use, accidents, other vendor, contractor, owner tampering or negligence, for which the Contractor is not directly responsible and does not control. The Contractor shall immediately notify the COTR or Facility Contracting Officer in writing upon the discovery of these incidents. The COTR or Facility Contracting Officer will investigate all reported incidents and render findings concerning any Contractor's responsibility.

- - - E N D - - -

**SECTION 27 15 00
COMMUNICATIONS HORIZONTAL CABLING**

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This Section specifies the furnishing, installing, certification, testing, and guaranty of a complete and operating Voice and Digital Cable Distribution System (here-in-after referred to as "*the System*"), and associated equipment and hardware to be installed in the VA Medical Center - Adult Daycare here-in-after referred to as "*the Facility*". The System shall include, but not be limited to: equipment cabinets, interface enclosures, and relay racks; necessary combiners, traps, and filters; and necessary passive devices such as: splitters, couplers, cable "patch", "punch down", and cross-connector blocks or devices, voice and data distribution sub-systems, and associated hardware. The System shall additionally include, but not be limited to: telecommunication closets (TC); telecommunications outlets (TCO); copper and fiber optic, and analog radio frequency (RF) systems coaxial distribution cables, connectors, "patch" cables, and/or "break out" devices.
- B. The System shall be delivered free of engineering, manufacturing, installation, and functional defects. It shall be designed, engineered and installed for ease of operation, maintenance, and testing.
- C. The term "provide", as used herein, shall be defined as: designed, engineered, furnished, installed, certified, and tested, by the Contractor.
- D. The Voice and Digital and Analog Telecommunication Distribution Cable Equipment and System provides the media which voice and data information travels over and connects to the Telephone System which is defined as an Emergency Critical Care Communication System by the National Fire Protection Association (NFPA). Therefore, since the System connects to or extends the telephone system, the System's installation and operation shall adhere to all appropriate National, Government, and/or Local Life Safety and/or Support Codes, which ever are the more stringent for this Facility. At a minimum , the System shall be installed according to NFPA, Section 70, National Electrical Code (NEC), Article 517 and Chapter 7; NFPA, Section 99, Health Care Facilities, Chapter 3-4; NFPA, Section 101, Life Safety Code, Chapters

- 7, 12, and/or 13; Joint Commission on Accreditation of Health Care Organization (JCAHCO), Manual for Health Care Facilities, all necessary Life Safety and/or Support guidelines; this specification; and the original equipment manufacturer's (OEM) suggested installation design, recommendations, and instructions. The OEM and Contractor shall ensure that all management, sales, engineering, and installation personnel have read and understand the requirements of this specification before the System is designed, engineered, delivered, and provided.
- E. The VA Project Manager (PM) and/or if delegated, Contracting Officer's Technical Representative (COTR) are the approving authorities for all contractual and mechanical changes to the System. The Contractor is cautioned to obtain in writing, all approvals for system changes relating to the published contract specifications and drawings, from the PM and/or the COTR before proceeding with the change.
- F. System Performance:
1. At a minimum, the System shall be able to support the following voice and data and analog RF operations for Category 6 Certified Telecommunication Service:
 - a. Provide the following interchange (or interface) capabilities:
 - 1) Basic Rate (BRI).
 - 2) Primary Rate (PRI).
 - b. ISDN:
 - 1) Narrow Band BRI:
 - a) B Channel: 64 kilo-Bits per second (kBps), minimum.
 - b) D Channel: 16 kBps, minimum.
 - c) H Channel: 384 kBps, minimum.
 - 2) Narrow Band PRI:
 - a) B Channel: 64 kBps, minimum.
 - b) D Channel: 64 kBps, minimum.
 - c) H Channel: 1,920 kBps, minimum.
 - 3) Wide (or Broad) Band: All channels: 140 mega(m)-Bps, minimum, capable to 565 mBps at "T" reference.
 - c. ATM operation and interface: ATM 155 mBps.
 - d. Frame Relay: All stated compliance's.
 - e. Integrated Data Communications Utility (IDCU) operation and interface.
 - f. Government Open Systems Interconnection Profile (GOSSIP) compliant.

- g. Fiberoptic Distributed Data Interface (FDDI): A minimum 100 mBps to a maximum of 1.8 giga(g)-Bps data bit stream speed (shall be Synchronous Optical Network [SONET] compliant).
 - h. System Sensitivity: Satisfactory service shall be provided for at least 3,000 feet for all voice and data and analog RF locations.
2. At a minimum the System shall support the following operating parameters:
- a. EPBX connection:
 - 1) System speed: 1.0 gBps per second, minimum.
 - 2) Impedance: 600 Ohms.
 - 3) Cross Modulation: -60 deci-Bel (dB).
 - 4) Hum Modulation: -55 dB.
 - 5) System data error: 10 to the -10 Bps, minimum.
 - 6) Loss: Measured at the frame output with reference Zero (0) deciBel measured (dBm) at 1,000 Hertz (Hz) applied to the frame input.
 - a) Trunk to station: 1.5 dB, maximum.
 - b) Station to station: 3.0 dB, maximum.
 - c) Internal switch crosstalk: -60 dB when a signal of ± 10 deciBel measured (dBm), 500-2,500 Hz range is applied to the primary path.
 - d) Idle channel noise: 25 dBm "C" or 3.0 dBm "O" above reference (terminated) ground noise, whichever is greater.
 - e) Traffic Grade of Service for Voice and Data:
 - (1) A minimum grade of service of P-01 with an average traffic load of 7.0 CCS per station per hour and a traffic overload in the data circuits will not interfere with, or degrade, the voice service.
 - (2) Average CCS per voice station: The average CCS capacity per voice station shall be maintained at 7.0 CCS when the EPBX is expanded up to the projected maximum growth as stated herein.
 - b. Telecommunications Outlet (TCO):
 - 1) Voice:
 - a) Isolation (outlet-outlet): 24 dB.
 - b) Impedance: 600 Ohms, balanced (BAL).
 - c) Signal Level: 0 deciBel per mili-Volt (dBmV) \pm 0.1 dBmV.
 - d) System speed: 100 mBps, minimum.

- e) System data error: 10 to the -6 Bps, minimum.
- 2) Data:
 - a) Isolation (outlet-outlet): 24 dB.
 - b) Impedance: 600 Ohms, BAL.
 - c) Signal Level: 0 dBmV \pm 0.1 dBmV.
 - d) System speed: 120 mBps, minimum.
 - e) System data error: 10 to the -8 Bps, minimum.
- 3) Fiber optic:
 - a) Isolation (outlet-outlet): 36 dB.
 - b) Signal Level: 0 dBmV \pm 0.1 dBmV.
 - c) System speed: 540 mBps, minimum.
 - d) System data error: 10 to the -6 bps, minimum.
- 4) Closed Circuit Analog Video Service: Analog video service is considered to be at baseband (below 100 mHz in frequency bandwidth). An analog video circuit requires a separate analog video from the audio connector. The following minimum operating parameters shall be capable over each installed analog video circuit:

Impedance	75 Ohm, unbalanced
Output Level	1.0 V peak to peak (P-P), for 87.5% depth of Modulation (Mod)
Diff Gain	± 1 dB at 87.5% Mod
Diff Phase	± 1.5 at 87.5% Mod
Signal to Noise (S/N) ratio	44 dB, minimum
Hum Modulation	-55 dB
Return Loss	-14 dB (or 1.5 Voltage Standing Wave Ratio [VSWR]), maximum
Isolation (outlet-outlet)	24 DB, MINIMUM
Bandwidth	6.0 mHz per channel, fully loaded, minimum

- 5) Closed Circuit Analog Audio Service: Analog audio service is considered to be at baseband (below 10 mHz in frequency bandwidth). Usually an analog audio circuit requires separate audio connectors and video connectors even though both are considered baseband signals. However, since each TCO has

multiple 600 (or 120) Ohm BAL line pairs, the analog audio circuit may be designated to one of the provided pairs of UTP or STP for each TCO and as shown on the drawings, in lieu of providing a separate baseband audio run to the TCO. The following minimum operating parameters shall be capable over each installed analog audio circuit:

Impedance	600 Ohm, BAL
Input Level	59 mV Root Mean Squared (RMS), minimum
Output Level	0 dBm
S/N ratio	55 dB, minimum
Hum Modulation	-50 dB, minimum
Return Loss	-14 dB (or 1.5 VSWR), maximum
Isolation (outlet-outlet)	24 DB, MINIMUM
Frequency Bandwidth	100 Hz - 10K Hz, minimum

1.2 RELATED WORK

- A. Specification Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Specification Section 27 05 11, REQUIREMENTS FOR COMMUNICATIONS INSTALLATIONS.
- C. Specification Section 27 05 33, RACEWAYS AND BOXES FOR COMMUNICATIONS SYSTEMS.
- D. Specification Section 27 10 00, STRUCTURED CABLING.
- E. Specification Section 26 27 26, WIRING DEVICES.
- F. Specification Section 27 05 26, GROUNDING AND BONDING FOR COMMUNICATIONS SYSTEMS.
- G. Specification Section 26 41 00, FACILITY LIGHTNING PROTECTION.
- H. Specification Section 27 31 00, VOICE COMMUNICATIONS SWITCHING AND ROUTING EQUIPMENT.
- I. H-088-C3 VA HANDBOOK DESIGN FOR TELEPHONE SYSTEMS

1.3 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in text by basic designation only. Except for a specific date given the issue in effect (including amendments, addenda, revisions, supplements, and errata) on

the date the system's submittal is technically approved by VA, shall be enforced.

B. National Fire Protection Association (NFPA):

70	NATIONAL ELECTRICAL CODE (NEC)
75	Protection of Electronic Computer/Data Processing Equipment
77	Recommended Practice on Static Electricity
	Standard for Health Care Facilities
101	Life Safety Code
1221	Emergency Services Communication Systems

C. Underwriters Laboratories, Inc. (UL):

65	Wired Cabinets
96	Lightning Protection Components
96A	INSTALLATION REQUIREMENTS FOR LIGHTNING PROTECTION SYSTEMS
467	Grounding and Bonding Equipment
497/497A/497B	PROTECTORS FOR PAIRED CONDUCTORS/ COMMUNICATIONS CIRCUITS/DATA COMMUNICATIONS AND FIRE ALARM CIRCUITS
884	Underfloor Raceways and Fittings

D. ANSI/EIA/TIA Publications:

568B	Commercial Building Telecommunications Wiring Standard
569B	Commercial Building Standard for Telecommunications Pathways and Spaces
606A	ADMINISTRATION STANDARD FOR THE TELECOMMUNICATIONS INFRASTRUCTURE OF COMMERCIAL BUILDINGS
607A	Grounding and Bonding Requirements for Telecommunications in Commercial Buildings
758	Grounding and Bonding Requirements for Telecommunications in Commercial Buildings

E. Lucent Technologies: Document 900-200-318 "Outside Plant Engineering Handbook".

- F. International Telecommunication Union - Telecommunication Standardization Sector (ITU-T).
- G. Federal Information Processing Standards (FIPS) Publications.
- H. Federal Communications Commission (FCC) Publications: Standards for telephone equipment and systems.
- I. United States Air Force: Technical Order 33K-1-100 Test Measurement and Diagnostic Equipment (TMDE) Interval Reference Guide.
- J. Joint Commission on Accreditation of Health Care Organization (JCAHO): Comprehensive Accreditation Manual for Hospitals.
- K. National and/or Government Life Safety Code(s): The more stringent of each listed code.

1.4 QUALITY ASSURANCE

- A. The authorized representative of the OEM, shall be responsible for the design, satisfactory total operation of the System, and its certification.
- B. The OEM shall meet the minimum requirements identified in Paragraph 2.1.A. Additionally, the Contractor shall have had experience with three or more installations of systems of comparable size and complexity with regards to coordinating, engineering, testing, certifying, supervising, training, and documentation. Identification of these installations shall be provided as a part of the submittal as identified in Paragraph 1.5.
- C. The System Contractor shall submit certified documentation that they have been an authorized distributor and service organization for the OEM for a minimum of three (3) years. The System Contractor shall be authorized by the OEM to certify and warranty the installed equipment. In addition, the OEM and System Contractor shall accept complete responsibility for the design, installation, certification, operation, and physical support for the System. This documentation, along with the System Contractor and OEM certification must be provided in writing as part of the Contractor's Technical Submittal.
- D. All equipment, cabling, terminating hardware, TCOs, and patch cords shall be sourced from the certifying OEM or at the OEM's direction, and support the System design, the OEM's quality control and validity of the OEM's warranty.
- E. The Contractor's Telecommunications Technicians assigned to the System shall be fully trained, qualified, and certified by the OEM on the engineering, installation, and testing of the System. The Contractor

shall provide formal written evidence of current OEM certification(s) for the installer(s) as a part of the submittal or to the COTR before being allowed to commence work on the System.

1.5 SUBMITTALS

- A. Provide submittals in accordance with Specification Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES. The COTR shall retain one copy for review and approval.
 - 1. If the submittal is approved the COTR shall retain one copy for Official Records and return three (3) copies to the Contractor.
 - 2. If the submittal is disapproved, three (3) copies will be returned to the Contractor with a written explanation attached that indicates the areas the submittal deviated from the System specifications. The COTR shall retain one copy for Official Records.
- B. Environmental Requirements: Technical submittals shall confirm the environmental specifications for physical TC areas occupied by the System. These environmental specifications shall identify the requirements for initial and expanded system configurations for:
 - 1. Floor loading for batteries and cabinets.
 - 2. Minimum floor space and ceiling heights.
 - 3. Minimum size of doors for equipment passage.
 - 4. Power requirements: The Contractor shall provide the specific voltage, amperage, phases, and quantities of circuits required.
 - 5. Air conditioning, heating, and humidity requirements. The Contractor shall identify the ambient temperature and relative humidity operating ranges required preventing equipment damage.
 - 6. Air conditioning requirements (expressed in BTU per hour, based on adequate dissipation of generated heat to maintain required room and equipment standards).
 - 7. Proposed floor plan, based on the expanded system configuration of the bidder's proposed EPBX for this FACILITY.
 - 8. Conduit size requirement (between main TC, computer, and console rooms).
 - 9. Main backbone, trunk line, riser, and horizontal cable pathways, cable duct, and conduit requirements between each MTC, TC, and TCO.
- C. Documents: The submittal shall be separated into sections for each subsystem and shall contain the following:
 - 1. Title page to include:
 - a. VA Medical Center.

- b. Contractor's name, address, and telephone (including FAX) numbers.
 - c. Date of Submittal.
 - d. VA Project No.
- 2. List containing a minimum of three locations of installations of similar size and complexity as identified herein. These locations shall contain the following:
 - a. Installation Location and Name.
 - b. Owner's or User's name, address, and telephone (including FAX) numbers.
 - c. Date of Project Start and Date of Final Acceptance by Owner.
 - d. System Project Number.
 - e. Brief (three paragraphs minimum) description of each system's function, operation, and installation.
- 3. Narrative Description of the system.
- 4. A List of the equipment to be furnished. The quantity, make, and model number of each item is required. Select the required equipment items quantities that will satisfy the needs of the system and edit. Delete equipment items that are not required add additional items required, and renumber section as per system design. The following is the minimum equipment required by the system:

QUANTITY	UNIT
As required	Cabinet Assembly(s)
As required	Environmental Cabinet
As required	Distribution/Interface Cabinet
As required	Equipment (Radio Relay) Rack
As required	Cross Connection (CCS) Systems
As required	Audio Alarm Panel
As required	TROUBLE ANNUNCIATOR PANEL
As required	Lightning Protection System
As required	Wire Management System/Equipment
As required	Telecommunications Outlets (TCO)
As Required	Distribution Cables
As required	TCO Connection Cables
As required	System Connectors
As required	Terminators

As required	Distribution Frames
As required	Telecommunications Closets (TC)
As required	Environmental Requirements
1 ea.	Installation Kit
As-required	Separate List Containing Each Equipment Spare(s)

5. Pictorial layouts of each MTC, IMTC, and RTCs; MCCS, IMCCS, VCCS, and HCCS termination cabinet(s), each distribution cabinet layout drawing, and TCO as each is expected to be installed and configured.
 6. Equipment technical literature detailing the electrical and technical characteristics of each item of equipment to be furnished.
 7. Engineering drawings of the System, showing calculated signal levels at the EPBX output, each input and output distribution point, proposed TCO values, and signal level at each TCO multipin, fiberoptic, and coaxial cable jack.
 8. List of test equipment as per paragraph 1.5.D. below.
 9. Letter certifying that the Contractor understands the requirements of the SAMPLES Paragraph 1.5.E.
 10. Letter certifying that the Contractor understands the requirements of Section 3.2 concerning acceptance tests.
- D. Test Equipment List:
1. The Contractor is responsible for furnishing all test equipment required to test the system in accordance with the parameters specified. Unless otherwise stated, the test equipment shall not be considered part of the system. The Contractor shall furnish test equipment of accuracy better than the parameters to be tested.
 2. The test equipment furnished by the Contractor shall have a calibration tag of an acceptable calibration service dated not more than 12 months prior to the test. As part of the submittal, a test equipment list shall be furnished that includes the make and model number of the following type of equipment as a minimum:
 - a. Spectrum Analyzer.
 - b. Signal Level Meter.
 - c. Volt-Ohm Meter.
 - d. Time Domain Reflectometer (TDR) with strip chart recorder (Data and Optical Measuring).
 - e. Bit Error Test Set (BERT).

- f. Camera with a minimum of 60 pictures to that will develop immediately to include appropriate test equipment adapters. A video camera in VHS format is an acceptable alternate.
 - g. Video Waveform Monitor.
 - h. Video Vector Scope.
 - i. Color Video Monitor with audio capability.
 - j. 100 MHz Oscilloscope with video adapters.
- E. Samples: A sample of each of the following items shall be furnished to the COTR for approval prior to installation.
 - 1. TCO Wall Outlet Box 4 inches x 4 inches x 2.5 inches with:
 - a. One each telephone (or voice) rj45 jack installed.
 - b. Two each multi pin data rj45 jacks installed.
 - c. Cover Plate installed.
 - d. Fiber optic ST jack(s) installed.
 - e. RF (F)/video (BNC)/audio (XL)jack(s) installed.
 - 2. Data CCS patch panel, punch block or connection device with RJ45 connectors installed.
 - 3. Telephone CCS system with IDC and/or RJ45 connectors and cable terminal equipment installed.
 - 4. Fiber optic CCS patch panel or breakout box with cable management equipment and "ST" connectors installed.
 - 5. 610 mm (2 ft.) section of each copper cable to be used with cable sweep tags as specified in paragraph 2.4.H and connectors installed.
 - 6. 610 mm (2 ft.) section of each fiber optic cable to be used with cable sweep tags as specified in paragraph 2.4.H and connectors installed.
 - 7. 610 mm (2 ft.) section of each analog RF, video coaxial and audio cable to be used with cable sweep tags as specified in paragraph 2.4.H and connectors installed.
 - 8. Analog video CCS patch panel or breakout box with cable management equipment and "BNC" connectors installed.
 - 9. Analog audio CCS patch panel or breakout box with cable management equipment and "XL" connectors installed.
 - 10. Analog RF patch panel or breakout box with cable management equipment and "F" connectors installed.
- F. Certifications:
 - 1. Submit written certification from the OEM indicating that the proposed supervisor of the installation and the proposed provider of

the contract maintenance are authorized representatives of the OEM. Include the individual's exact name and address and OEM credentials in the certification.

2. Submit written certification from the OEM that the wiring and connection diagrams meet National and/or Government Life Safety Guidelines, NFPA, NEC, UL, this specification, and JCAHCO requirements and instructions, requirements, recommendations, and guidance set forth by the OEM for the proper performance of the System as described herein. The VA will not approve any submittal without this certification.
 3. Preacceptance Certification: This certification shall be made in accordance with the test procedure outlined in paragraph 3.2.B.
- G. Equipment Manuals: Fifteen (15) working days prior to the scheduled acceptance test, the Contractor shall deliver four complete sets of commercial operation and maintenance manuals for each item of equipment furnished as part of the System to the COTR. The manuals shall detail the theory of operation and shall include narrative descriptions, pictorial illustrations, block and schematic diagrams, and parts list.
- H. Record Wiring Diagrams:
1. Fifteen (15) working days prior to the acceptance test, the Contractor shall deliver four complete sets of the Record Wiring Diagrams of the System to the COTR. The diagrams shall show all inputs and outputs of electronic and passive equipment correctly identified according to the markers installed on the interconnecting cables, Equipment and room/area locations.
 2. The Record Wiring Diagrams shall be in hard copy and two compact disk (CD) copies properly formatted to match the Facility's current operating version of Computer Aided Drafting (AutoCAD) system. The COTR shall verify and inform the Contractor of the version of AutoCAD being used by the Facility.
- I. Surveys Required As A Part Of The Technical Submittal: The Contractor shall provide the following surveys that depict various system features and capacities are required in addition to the on site survey requirements described herein. Each survey shall be in writing and contain the following information (the formats are suggestions and may be used for the initial Technical Submittal survey requirements), as a minimum:

1. The required EPBX connections (each CSU shall be compatible with) shall be compatible with the following:
- b. Initially connect:

<u>EQUIPPED ITEM</u>	<u>CAPACITY</u>	<u>WIREDCAPACITY</u>
Main Station Lines		
Single Line		
Multi Line (Equipped for direct input dial [DID])		
Central Office (CO) Trunks		
TWO WAY		
DID		
Two-way DRTL		
Foreign Exchange (FX)		
Conference		
Radio Paging Access		
Audio Paging Access		
Off-Premise Extensions		
CO Trunk By-pass		
CRT w/keyboard		
Printers		
Attendant Consoles		
T-1 Access/Equipment		
Maintenance console		

- b. Projected Maximum Growth: The Contractor shall clearly and fully indicate this category for each item identified in Paragraph 1.4.H.1.a. as a part of the technical submittal. For this purpose, the following definitions and sample connections are provided to detail the system's capability:

<u>EQUIPPED ITEM</u>	<u>CAPACITY</u>	<u>WIRED CAPACITY</u>
Servers		
PC's		
Projected Maximum Growth		

The Contractor shall clearly and fully indicate this category for each item identified in Paragraph 1.4.H.2.a. as a part of the technical submittal.

2. Cable Distribution System Design Plan: A design plan for the entire cable distribution systems requirements shall be provided with this document. A specific cable count shall coincide with the total growth items as described herein. It is the Contractor's responsibility to provide the Systems entire cable requirements and engineer a distribution system requirement plan using the format of the following paragraph(s), at a minimum:

a. UTP (and/or STP) Requirements/Column Explanation:

Column	Explanation
FROM BUILDING	Identifies the building by number, title, or location, and main signal closet or intermediate signal closet cabling is provided from
BUILDING	Identifies the building by number, title, or location cabling is to be provided in
TO BUILDING IMC	Identifies building main terminal signal closet, by room number or location, to which cabling is provided too, in, and from
FLOOR	Identifies the floor by number (i.e. 1st, 2nd, etc.) cabling and TCOs are to be provided
TC ROOM NUMBER	Identifies the floor signal closet room, by room number, which cabling shall be provided
ROOM NUMBER	Identifies the room, by number, from which cabling and TCOs shall be provided
NUMBER OF CABLE PAIR	Identifies the number of cable pair required to be provided on each floor designated OR the number of cable pair (VA Owned) to be retained
NUMBER OF STRANDS USED/SPARE	Identifies the number of strands provided in each run

b. Fiber Optic Cabling Requirements/Column Explanation:

Column	Explanation
FROM BUILDING	Identifies the building by number, title, or location, and main signal closet or intermediate signal closet cabling is

	provided from
TO BUILDING IMC	Identifies building, by number, title, or location, to which cabling is provided
FLOOR	Identifies the floor by number (i.e. 1st, 2nd, etc.)
TC ROOM NUMBER	Identifies the room, by number, from which cabling shall be installed
NUMBER OF STRANDS	Identifies the number of strands in each run of fiber optic cable
INSTALLED METHOD	Identifies the method of installation in accordance with as designated herein
NOTES	Identifies a note number for a special feature or equipment
BUILDING MTC	Identifies the building by number or title

c. Analog RF Cabling Requirements/Column Explanation:

Column	Explanation
FLOOR	Identifies the floor by number (i.e. 1st, 2nd, etc.)
TC ROOM NUMBER	Identifies the room, by number, from which cabling shall be installed
TO FLOOR TC	Identifies building, by number or location, to which cabling is installed
NUMBER OF STRANDS	Identifies the number of strands in each run of RF cable
INSTALLED METHOD	Identifies the method of installation in accordance with as designated herein
NOTES	Identifies a note number for a special feature or equipment
BUILDING MTC	Identifies the building by number or title

d. Analog Video Cabling Requirements/Column Explanation:

Column	Explanation
FROM BUILDING	Identifies building, by number or location, from which cabling is installed
TC ROOM NUMBER	Identifies the room, by number, from which cabling shall be installed
TO BUILDING IMC	Identifies building, by number or location, to which cabling is installed
TC ROOM NUMBER	Identifies the room, by number, to which cabling shall be installed
NUMBER OF STRANDS	Identifies the number of strands in each

	run of fiber optic cable
INSTALLED METHOD	Identifies the method of installation in accordance with as designated herein
NOTES	Identifies a note number for a special feature or equipment
BUILDING MTC	Identifies the building by number or title

3. Telecommunication Outlets: The Contractor shall clearly and fully indicate this category for each outlet location and compare the total count to the locations identified above as a part of the technical submittal. Additionally, the Contractor shall indicate the total number of spares.

PART 2 - PRODUCTS

2.1 EQUIPMENT AND MATERIALS

A. System Requirements:

1. The System shall provide the following minimum services that are designed in accordance with and supported by an Original Equipment Manufacturer (OEM), and as specified herein. The System shall provide continuous inter and/or intra-Facility voice and data, and analog RF service. The System shall be capacity sized so that loss of connectivity to external telephone systems shall not affect the Facilities operation in specific designated locations. The System shall:
 - a. Be capable of inter-connecting and functioning fully with the existing Local Telephone Exchange (LEC) Network(s), Federal Telephone System (FTS) Inter-city Network(s), Inter-exchange Carriers, Integrated Services Digital Network (ISDN), Electronic Private Branch Exchange (EPBX) switches, asynchronous/synchronous data terminals and circuits including Automatic Transfer Mode (ATM), Frame Relay, and local area networks (LAN), at a minimum.
 - b. Be a voice and data cable distribution system that is based on a physical "Star", and/or "Ring", and/or "Bus" Topology. An Analog RF coaxial cable distribution system shall be provided in a "home run" configuration from each associated riser TC to identified locations and as shown on the drawings.
 - c. Be compatible with and able to provide direct digital connection to trunk level equipment including, but, not limited to: directly accessing trunk level equipment including the telephone system, audio paging, Industry Standard "T" and/or "DS" carrier services

and external protocol converters. Additionally, connections to "T" and/or "DS" access/equipment or Customer Service Units (CSU) that are used in FTS and other trunk applications shall be included in the System design. Provide T-1 access/equipment (or CSU), as required for use, in FTS and other trunk applications by system design if this equipment is not provided by the existing telephone system and/or will be deactivated by the installation of the System. The Contractor shall provide all T-1 equipment necessary to terminate and make operational the quantity of circuits designated. The CSU's shall be connected to the System's emergency battery power supply. The System shall be fully capable of operating in the Industry Standard "DS" protocol and provide that service when required.

- d. Where the System connects to an existing or future telephone system, refer to specification Section 27 31 00, VOICE COMMUNICATIONS SWITCHING AND ROUTING EQUIPMENT for specific telephone equipment and system operational performance standards.

2. Cable Systems - Twisted Pair and Fiber optic, and Analog RF Coaxial:

a. General:

- 1) The Contractor shall be responsible for providing a new system conforming to current and accepted telephone and digital and analog RF industrial/commercial cable distribution standards. The distribution cable installation shall be fully coordinated with the Facility, the PM, the COTR and the Contractor prior to the start of installation.
- 2) The Contractor is responsible for complete knowledge of the space and cable pathways (i.e. equipment rooms, TCs, conduits, wireways, etc.) of the Facility. The Contractor shall at a minimum design and install the System using the Pathway Design Handbook H-088C3, TIA/EIA Telecommunications Building Wiring Standards, and Facility Chief of Information Resource Management's (IRM) instructions, as approved in writing by the PM and/or COTR.
- 3) The System cables shall be fully protected by cable duct, trays, wireways, conduit (rigid, thin wall, or flex), and when specifically approved, flexible innerduct. It is the responsibility of the Contractor to confirm all contract drawings and the Facility's physical layout to determine the

necessary cable protective devices to be provided. If flexible innerduct is used, it shall be installed in the same manner as conduit.

- 4) Cable provided in the system (i.e. backbone, outside plant, inside plant, and station cabling) shall conform to accepted industry and OEM standards with regards to size, color code, and insulation. The pair twists of any pair shall not be exactly the same as any other pair within any unit or sub-unit of cables that are bundled in twenty-five (25) pairs or less. The absence of specifications regarding details shall imply that best general industry practices shall prevail and that first quality material and workmanship shall be provided. Certification Standards, (i.e., EIA, CCITT, FIPPS, and NFPA) shall prevail.
- 5) Some areas of this Facility may be considered "plenum". All wire and cable used in support of the installation in those areas (if any) shall be in compliance with national and local codes pertaining to plenum environments. It is the responsibility of the Contractor to review the VA's cable and wire requirements with the COTR and the IRM prior to installation to confirm the type of environment present at each location.
- 6) The Contractor shall provide outside and inside plant cables that furnishes the number of cable pairs required in accordance with the System requirements described herein. The Contractor shall fully coordinate and obtain approval of the design with the OEM, COTR and the IRM prior to installation.
- 7) All metallic cable sheaths, etc. shall be grounded by the Contractor (i.e.: risers, underground, station wiring, etc.) as described herein.
- 8) If temporary cable and wire pairs are used, they shall be installed so as to not present a pedestrian safety hazard and the Contractor shall be responsible for all work associated with the temporary installation and for their removal when no longer necessary. Temporary cable installations are not required to meet Industry Standards; but, must be reviewed and approved by the and the IRM prior to installation.

- 9) Conductors shall be cabled to provide protection against induction in voice and data and analog RF circuits. Crosstalk attenuation within the System shall be in excess of -80 dB throughout the frequency ranges specified.
- 10) Measures shall be employed by the Contractor to minimize the radiation of RF noise generated by the System equipment so as not to interfere with audio, video, data, computer main distribution frame (MDF), telephone customer service unit (CSU), and electronic private branch exchange (EPBX) equipment the System may service.
- 11) The System's cables shall be labeled on each end and been fully tested and certified in writing by the Contractor to the COTR before proof of performance testing can be conducted. The as-installed drawings shall identify each cable as labeled, used cable, and bad cable pairs. Minimum test requirements are for impedance compliance, inductance, capacitance, signal level compliance, opens, shorts, cross talk, noise, and distortion, and split pairs on all cables in the frequency ranges specified. The tests required for data cable must be made to guarantee the operation of this cable at not less than 10 mega (m) Hertz (Hz) full bandwidth, fully channel loaded and a Bit Error Rate of a minimum of 10^{-6} at the maximum rate of speed. All cable installation and test records shall be made available at acceptance testing by the COTR or Contractor and thereafter maintained in the Facility's Telephone Switch Room. All changes (used pair, failed pair, etc.) shall be posted in these records as the change occurs.
- 12) The Contractor shall coordinate with the LEC to install the telephone entrance cable to the nearest point of entry into the Facility and as shown on the drawings. The Contractor shall coordinate with the COTR and the LEC to provide all cable pairs/circuits from the Facility point of entry to the Telephone Switch Room all telephone, FTS, DHCP, ATM, Frame Relay, data, pay stations, patient phones, and any low voltage circuits as described herein.
- 13) The Contractor shall coordinate with the COTR and the IRM to install the computer interface cable to the Facility Telephone Switch Room from the Facility's Computer Room for all data,

DHCP, FTS, ATM, Frame Relay, and telephone circuits and as shown on the drawings.

- 14) The Contractor shall coordinate with the COTR and the IRM to provide all cable pairs/circuits from the Facility Telephone Switch Room and establish circuits throughout the Facility for all voice, data, computer alarm (except fire alarm), private maintenance line, Radio Paging, PA, LAN, DHCP, and any low voltage circuits as described herein.
 - 15) The Contractor shall provide proper test equipment to guarantee that cable pairs and analog RF coaxial cable meet each OEM's standard transmission requirements, and guarantee the cable will carry data transmissions at the required speeds, frequencies, and fully loaded bandwidth.
 - 16) The Contractor shall coordinate with the Facility Chief of Medical Media Production Service (MMPS) to install baseband analog RF, video, and audio interface cables and circuits from each TC to designated TCO locations and as shown on the drawings. The Contractor shall work with the Facility Chief of MMPS to establish circuits throughout the Facility and shall provide proper test equipment to guarantee that analog RF, video, and audio cables meet each OEM's standard transmission requirements, and guarantee the cables will carry analog video and audio transmissions at the required speeds, frequencies, and fully loaded bandwidth.
- b. Telecommunications Closets (TC): In TC's that are served with both a UTP and STP backbone cable and a fiber optic backbone cable, the UTP and STP cable shall be terminated on separate RJ-45, 8-pin connectors with 110A or equivalent type punch down blocks located on the back or front of a 48-port modular patch panel dedicated to data applications. Only the UTP and STP backbone cable pairs, identified as being connected to the fiber optic backbone, shall be extended to the fiber optic interface device. All connecting cables required to extend these cables (i.e. patch cords, twenty-five pair connectors, etc.), to the fiber optic interface device, in the TC's shall also be provided by the Contractor to insure a complete and operational fiber optic distribution system:

- 1) In TC's, which are only served by a UTP and STP backbone cable, the cable shall be terminated on separate modular connecting devices (110A or equivalent) that are dedicated to data applications. In order to provide full service to all data cable pairs as identified in each TC/cabinet including spare capacity noted herein, the size of all vertical (riser) cables and/or outside cables serving these TC's shall be increased as required.

c. Backbone and Trunk Cables:

- 1) The Contractor shall identify, in the technical submittal, the voice and data (analog RF coaxial cable shall not be provided in main trunk or backbone lines) connecting arrangements required by the LEC for interconnection of the System to the commercial telephone and FTS networks. The Contractor shall provide all required voice and data connecting arrangements.
- 2) The Contractor shall be responsible for compatibility of the proposed TCs (to be compliant with the EPBX and CSU equipment) numbering scheme with the numbering plan for the FTS, DID, local stations, and the North American Numbering Plan. The Contractor shall consult with the VA and the LEC regarding the FTS and North American Numbering plan to be implemented for the Facility to ensure system compatibility.
- 3) All submitted equipment shall meet or exceed standards, rules, and regulations of the Federal Communications Commission (FCC) and shall be capable of operating without outboard or "extra" devices. The Contractor shall identify the FCC registration number of the System equipment, EPBX, and proposed CSU (if known) in the technical submittal.
- 4) A minimum of one (1) 400 shielded twisted pair (STP) cable shall be installed from the Telephone Switch Room cross connecting system (CCS) to the Main Computer Room MDF. This cable shall support the transmission of data information over twisted pair cable. The cable shall be tested and terminated on a Contractor provided cable management frame, RJ-45 modular jacks with eight (8) pin connectors, and 48 port modular patch panels located in the Main Computer Room and Telephone Switch Room. The cable shall be labeled, terminated, and separated from the other cables on the MDF and Telephone Switch Room

CCS. This requirement shall be fully coordinated and approved by the Facility Chief, IRM and the COTR prior to installation. The cabling requirements of this paragraph are in addition to the requirements specified in the System Design Plan identified herein.

d. Riser Cable:

- 1) All communication riser cables shall be listed as being suitable for the purpose and marked accordingly per Articles 517, 700, and 800 of the NEC.
- 2) All voice and data communication (analog RF coaxial cable is not to be provided in riser systems) riser cables shall be STP or Unshielded Twisted Pair (UTP), minimum 24 American Wire Gauge (AWG) solid, thermoplastic insulated conductors. They shall be enclosed with a thermoplastic outer jacket.
- 3) The Contractor shall provide and install inside riser cables to insure full service to all voice cable pairs identified in each TC terminating enclosure plus not less than 50% additional spare capacity.
- 4) The complete riser cabling system shall be labeled and tested as described herein.

e. Horizontal and Station Cable:

- 1) A Four (4) UTP 24 AWG station wiring cable shall be installed from the top TCO jack to the TC and shall be of a type designed to support Category 6 communications (250 mega-Hertz [mHz] or above). At the jack location, terminate all four pair on the RJ-45/11 jack. At the signal closet, all four pair shall be terminated on the modular punch down blocks dedicated to telephone applications.
- 2) A Four (4) UTP 24 AWG (in thermoplastic jacket unless otherwise specified by RE) station wiring cable shall be installed from each of the two (2) bottom TCO RJ-45 jacks (shall conform to EIA/TIA 568 Standard "T568A" and NFPA) to the TC and shall be of a type designed to support Category 6 communications (250 mHz or above).

f. Telecommunication Outlets (TCO), Jacks: All TCO's shall have a minimum of three (3) RJ-45 type jacks. The top jack shall be an eight pin RJ-45/11 compatible jack, labeled, and designated for telephone applications only. The bottom two jacks shall be eight

pin RJ-45 type unkeyed (sometimes called center keyed) jacks, labeled, and designated for data.

- g. Patient Bedside Prefabricated Units (PBPU): Where PBPU's exist in the Facility, the Contractor shall identify the single gang "box" location on the PBPU designated for installation of the telephone jack. This location shall here-in-after be identified as the PBTCO. The Contractor shall be responsible for obtaining written approval and specific instructions from the PBPU OEM regarding the necessary disassembly and reassembly of each PBPU to the extent necessary to pull wire from above the ceiling junction box to the PBPU box reserved for the PBTCO. A Contractor provided stainless steel cover plate approved for use by the PBPU OEM and Facility IRM Chief shall finish out the jack installation. Under no circumstances shall the Contractor proceed with the PBPU installations without the written approval of the PBPU OEM and the specific instructions regarding the attachment to or modifying of the PBPU. The COTR shall be available to assist the Contractor in obtaining these approvals and instructions in a timely manner as related to the project's time constraints. It is the responsibility of the Contractor to maintain the UL integrity of each PBPU. If the Contractor violates that integrity, it shall be the responsibility of the Contractor to obtain on site UL re-certification of the violated PBPU at the direction of the COTR and at the Contractor's expense.

h. Fiber Optics:

- 1) A complete fiber optic cable distribution system shall be provided as a part of the System. The Contractor shall provide a fiber optic cable that meets the minimum bandwidth requirements for FDDI, ATM, and Frame Relay services. This fiber optic cable shall be a 62.5/125 or 50/125 micron multimode, containing a minimum of 18 strands of fiber, unless otherwise specified, and shall not exceed a distance of 2,000 Meters (M), or 6,560 feet (ft.) in a single run. Loose tube cable, which separates the individual fibers from the environment, shall be installed for all outdoor runs or for any area which includes an outdoor run. Tight buffered fiber cable shall be used for indoor runs. The multimode fibers shall be terminated and secured at both ends in "ST" type

female stainless steel connectors installed in an appropriate patch or breakout panel with a cable management system. A 610 mm (2 ft.) cable loop (minimum) shall be provided at each end to allow for future movement.

- 2) In addition, a 12 strand (minimum), 8.3 mm single mode fiber optic cable shall be provided. Single mode fibers shall be terminated and secured at both ends with "ST" type female stainless steel connectors installed in an appropriate patch or breakout panel. The panel shall be provided with a cable management system. A 610 mm (2 ft.) cable loop (minimum) shall be provided at each end to allow for future movement.
- 3) The fiber optic backbone shall use a conventional hierarchical "star" design where each TC is wired to the primary hub (main cross-connect system) or a secondary hub (intermediate cross-connect system) and then to the primary hub. There shall be no more than two hierarchical levels of cross-connects in the backbone wiring. Each primary hub shall be connected and terminated to a CCS in the Telephone Switch Room. Additionally, a parallel separate fiber optic interconnection shall be provided between the Telephone Switch Room CCS and the MDF in the Main Computer Room.
- 4) In the TC's, Telephone Switch Room, and Main Computer Room, all fiber optic cables shall be installed in a CCS and/or MDF rack mounted fiber optic cable distribution component/splice case (Contractor provided and installed rack), patch, or breakout panel in accordance with industry standards. Female "ST" connectors shall be provided and installed on the appropriate panel for termination of each strand.
- 5) The Contractor shall test each fiber optic strand. Cable transmission performance specifications shall be in accordance with EIA/TIA standards. Attenuation shall be measured in accordance with EIA fiber optic test procedures EIA/TIA-455-46, -61, or -53 and NFPA. Information transmission capacity shall be measured in accordance with EIA/TIA-455-51 or -30 and NFPA. The written results shall be provided to the COTR for review and approval.

3. Specific Subsystem Requirements: The System shall consist, as a minimum, of the following independent sub-systems to comprise a

complete and functional voice and digital and analog RF telecommunications cabling system: "Main" (MTC), "intermediate" (IMTC), and "riser" (RTC) TC's; "backbone" cabling (BC) system; "vertical" (or "riser") trunk cabling system; "horizontal" (or "lateral") sub-trunk cabling system, vertical and horizontal cross-connection (VCC and HCC respectively) cabling systems, and TCO's with a minimum of three (3) RJ-45 jacks for the appropriate telephone, Data connections, and additional jacks, connectors, drop and patch cords, terminators, and adapters provided.

a. Telecommunication Closet (TC):

- 1) There shall be a minimum of one TC for the MTC, each building IMTC, and each RTC per building floor location. However, in large building(s), where the horizontal distance to the farthest voice and digital work area may exceed 90 Meters (M) (or 295 feet [ft]), additional TC's shall be provided as described herein. The maximum DC resistance per cable pair shall be no more than 28.6 Ohms per 305 M (1,000 feet). Each TC shall be centrally located to cover the maximum amount of local floor space. The TC's house in cabinets or enclosures, on relay racks, and/or on backboards, various telecommunication data equipment, controllers, multiplexers, bridges, routers, LAN hub(s), telephone cross-connecting, active and passive equipment.
- 2) Additionally, the TC's may house fire alarm, nurses call, code one (or blue), video, public address, radio entertainment, intercom, and radio paging equipment. Regardless of the method of installation, mounting, termination, or cross-connecting used, all backbone, vertical, and horizontal copper and fiber optic and analog RF coaxial cables shall be terminated on appropriate cross-connection systems (CCS) containing patch panel(s), punch blocks, and/or breakout devices provided in enclosures and tested as described herein. A cable and/or wire management system shall be a part of each CCS.
 - a) A minimum of three 110-120 VAC active quad outlets shall be provided, each with "U" grounded receptacles at a minimum of one outlet for each front, side and back wall. These outlets shall be separately protected by an AC circuit breaker provided in the designated Government Emergency

Critical Care AC power panel, that is connected to the Facilities Emergency AC Power Distribution System. For larger building TC applications, a minimum of one additional quad AC outlet shall be provided for every 800M² (or 8,000 ft²) of useable floor space. Additional outlets shall be equally spaced along the wall.

- b) Climate control shall be provided in each TC 24 hours a day, seven days per week and 52 week per year to prevent failure of electronic components and for mission critical functional applications. The COTR and/or Facility Chief Engineering Officer are responsible for informing the Contractor regarding the minimum climate control requirements. In identified hostile TC locations where it has been determined (by the COTR or Facility Chief Engineer) that proper TC climate or external signal radiation cannot be properly maintained or controlled, the Contractor may, at his/her option, provide a minimum of two individual and properly sized self contained climate controlled equipment cabinet enclosures; one designated for voice, and one designated for data, and one additional cabinet designated for analog RF service, in each TC location identified on the drawings, in lieu of providing additional required TC air handling capability.
- b. Cross-connect Systems (CCS):
 - 1) The CCS shall be selected based on the following criteria: requires the use of a single tool, has the fewest amount of parts, and requires the least amount of assembly or projected trouble shooting time during the life of the system.
 - 2) The CCS system used at the MTC, each IMTC, and each TC shall force cross-connect cable slack management through adherence to the OEM's installation methods, provided cable management systems, and as described herein, so that moves, adds, and changes can be administered easily and cost effectively.
 - 3) Copper Cables: The MTC, each IMTC, and TC shall contain a copper CCS sized to support the System TCO's and connections served by each individual TC and as shown on the drawings. The System layout shall allow for a minimum of 50% anticipated growth. Additionally, each CCS must provide maximum

flexibility, while maintaining performance, in order to meet system-changing requirements that are likely to occur throughout its useful life.

4) Fiber Optic Cables:

- a) The MTC and each TC shall contain a fiber CCS sized to support the System TCO's and connections served by each individual TC and as shown on the drawings. The System layout shall allow for a minimum of 50% anticipated growth.
- b) Each fiber CCS must provide maximum flexibility and cable management while maintaining performance in order to meet changing requirements that are likely to occur throughout the expected life of the system. All fiber optic cable slack shall be stored in protective enclosures.
- c) If it is determined that a fiber optic distribution system is not necessary for the immediate system needs. Each TC shall be provided with fiber optic cable(s) that contain a minimum of 12 strands "dark" multimode fiber and 12 strands "dark" single mode fiber, each fiber properly terminated on its respective female stainless steel connector mounted in an appropriate fiber termination enclosure provided in each TC.

5) The Contractor shall not "cross-connect" the copper or fiber optic cabling systems and subsystems even though appropriate "patch" cords are to be provided for each "patch", "punch", or "breakout" panel. In addition, the Contractor shall not provide active electronic distribution or interface equipment as a part of the System.

6) Grounding: Proper grounding and bonding shall be provided for each TC and all internal equipment. Reference shall be made to proper codes and standards, such that all grounding systems must comply with all applicable National, Regional, and Local Building and Electrical codes. The most stringent code of these governing bodies shall apply.

- a) If local grounding codes do not exist for the System location, then at a minimum, a #6 American Wire Gauge (AWG) stranded copper wire, or equivalent copper braid, shall be connected to a separate earth grounding system for each TC (the looping of TC's in a general location is allowed as

long as the specifications contained herein are met). Under no circumstance shall the AC neutral be used for this ground. See PART 3 - EXECUTION for specific grounding instructions.

- b) Each copper UTP or STP cable that enters a TC from the outside of a building (regardless if the cable is installed underground or aerial) shall be provided with a surge protector and grounded an to earth ground at each cable's entry point in and out of the MTC and each IMTC.
- c. Main Cross-connection Subsystem (MCCS): The MCCS shall be located in the MTC and it shall be the common point of appearance for inter and intra-building copper and fiber optic "backbone" system cables, and connections to the telephone and data cable systems. The MTC usually houses telephone EPBX, public address, radio paging interface, routers, and main hierarchical data LAN concentrating equipment. Additionally, it shall provide a single administration and management point for the entire System.
- d. Voice (or Telephone) Cable Cross-Connection Subsystem:
 - 1) Due to the usually high number of copper cable termination's required at the MCCS, Insulation Displacement Connection (IDC) hardware shall be used. Termination options shall include the following for a Category 6 Cabling System: IDC termination of cross-connection wire(s), IDC patch cord connector to IDC patch cord connector, and hybrid modular cord to IDC patch cord connector shall be the minimum provided.
 - 2) Additionally, due to the large or many MCCS (at initial installation and over the life of the System) copper termination points, the CCS that makes the best use of real estate while still following the OEM design and installation guidelines, and meeting the specifications described herein, shall be provided.
 - 3) For ease of maintenance purposes, all terminations shall be accessible without the need for disassembly of the IDC wafer. IDC wafers shall be removable from their mounts to facilitate testing on either side of the connector. Designation strips or labels shall be removable to allow for inspection of the terminations. The maximum number of terminations on a wall or on a rack frame or panel shall comply with the OEM

recommendations and guidelines, and as described herein. A cable management system shall be provided as a part of the IDC.

- 4) IDC connectors shall be capable of supporting cable re-terminations without damaging the connector and shall support a minimum of 200 (telephone equipment standard compliant) IDC insertions or withdrawals on either side of the connector panel.
 - 5) A non-impact termination method using a full-cycle terminating tool having both a tactile and an audible feedback to indicate proper termination is required. For personnel safety and ease of use in day to day administration, high impact installation tools shall not be used.
 - 6) All system "inputs" from the EPBX, FTS, Local Telephone System, or diverse routed voice distribution systems shall appear on the "left" side of the IDC (110A blocks with RJ45 connections are acceptable alternates to the IDC) of the M CCS.
 - 7) All system "outputs" from the M CCS to the voice backbone cable distribution system shall appear on the "right" side of the same IDC (or 110A blocks) of the M CCS.
 - 8) The splitting of pairs within cables between different jacks or connections shall not be allowed. In the case of ISDN and/or ATM and /or Frame Relay applications, terminating resistors shall be provided externally to the patch panel connector or jack.
 - 9) UTP or STP cross connecting wires shall be provided for each "pair" of connection terminals plus an additional 50% spare.
- e. Data Cross-Connection Subsystems:
- 1) The M CCS shall be a Main Distribution Terminating (MDT) data unit and shall be provided in the MTC. The MDT shall consist of a "patch" panel(s) provided with modular RJ45 female connectors for cross-connection of all copper data cable terminations. The panels shall provide for system grounding (where no dielectric cables are used) and be provided with a cable management system.
 - 2) Each panel shall conform to EIA dimensions and be suitable for mounting in standard equipment racks, have the RJ45 jacks aligned in two horizontal rows (up to a maximum of 48 jacks

per panel), and shall not exceed the OEM's recommendations. Each RJ45 jack shall be of modular design and capable of accepting and functioning with other modular (i.e. RJ11) plugs without damaging the jack. It is not necessary to provide a jack for unused positions that are not part of the 50% expansion requirement.

- a) All data system inputs from the server(s), data LAN, bridge, or interface distribution systems shall appear on the "top" row of jacks of the appropriate patch panel.
 - b) All System outputs or backbone cable connections shall appear on the "bottom" row of jacks of the same patch panel.
 - c) The splitting of pairs within cables between different jacks shall not be allowed. In the case of ISDN and/or ATM and/or Frame Relay applications, terminating resistors shall be provided externally to the patch panel connector or jack.
- 3) A patch cord shall be provided for each system "pair" of connection jacks. Each patch cord shall have modular RJ45 connectors provided on each end to match the panel's modular RJ45 female jack's being provided.
- f. Fiber optic Cross-Connection Subsystems: The MTC shall be provided with a separate fiber MCCS. Each TC shall be provided with a rack mounted patch or distribution panel that is installed inside a lockable cabinet or "breakout enclosure" that accommodates a minimum of 12 strands multimode fiber and 12 strand single mode fiber (these counts shall not be included the 50% spare requirement). Two of the single mode fibers shall be designated for educational analog video applications. A cable management system shall be provided for each panel.
- 1) The panel(s) shall contain a minimum of 24 female "ST" connectors, be able to accommodate splices and field mountable connectors and have capacity for additional connectors to be added up to the OEM's maximum standard panel size for this type of use. All patch panel sides, including the front and back, shall be protected by a cabinet or enclosure.
 - 2) The panel(s) shall conform to EIA dimensions and be suitable for installation in standard racks, cabinets, and enclosures.

The panels shall provide for system grounding (where no dielectric cables are used).

- 3) The patch panel with the highest OEM approved density of fiber "ST" termination's (maximum of 72 each), while maintaining a high level of manageability, shall be selected. Patch cables, with proper "ST" connectors installed on each end shall be provided for each pair of fiber optic cable "ST" connectors.
 - a) All System "inputs" from interface equipment or distribution systems shall appear on the "top" row of connectors of the appropriate patch panel.
 - b) All System "outputs" or backbone cable connections shall appear on the "bottom" row of connectors of the same patch panel.
- 4) In order to achieve a high level of reliability that approximates that of an OEM connector, field installable connectors shall have an OEM specified physical contact polish. Every fiber cable shall be terminated with the appropriate connector, and tested to ensure compliance to OEM and specifications outlines herein. Where a local fiber optic system connector standard, Industry Standard fiber optic "ST" female connector terminated with a fiber optic cable, shall be used. But, if the fiber optic cable is not used (or "dark"), a "ST" male terminating "cap" shall be provided for each unused "ST" female connector.
- g. Intermediate Cross-connection Subsystems (IMCCS): The MTC and each IMTC shall be provided with an IMCCS that shall be the connection point between the MCCA system and the distribution backbone cable and the IMCCS, that is located in one or more buildings on a campus, where each IMCCS is placed by system design. For a technical explanation of internal equipment and system requirements, refer to the above MTC and MCCA paragraphs.
- h. Distribution Cable Systems / Backbone Cable System (Common to Inter-buildings): The backbone cable system extends from the MCCA to each IMCCS to establish service between buildings on a campus. The media (copper and fiber optic) used in the BC system shall be designed according to the system requirements, OEM standards and guidelines, and as described herein. A multi-pair copper for

voice and data, and separate multiple fiber optic backbone system shall be provided as a part of the BC distribution system.

- 1) All outside cable shall be minimum of STP or UTP, 22 AWG solid conductors, solid PVC insulation, and filled core (flexgel - waterproof Rural Electric Association (REA) LISTED PE 39 CODE) between the outer armor or jacket and inner conductors protective lining.
- 2) The copper cable system shall be configured as a "Star" Topology with separate dedicated cables between the MCCA and each IMCCA.
- 3) UTP and STP copper cables shall consist of thermoplastic insulated conductors formed into binder groups. The groups are to be identified by distinctly colored binders and assembled to form a single compact core covered by a protective sheath. Each cable shall be rated for Category 6 Telecommunications System Service. A minimum of eight pairs per circuit, plus an additional 50% spare for growth shall be provided.
- 4) Where the distance limitations of UTP or STP may be exceeded, multimode (or single mode) fiber optic cable(s) shall be used to augment the voice and/or data backbone cable system(s). The total loss of each fiber shall not exceed 12 decibel (dB) at 850 nano-Meter (nm), 11 dB at 1,300 nm, or 10 dB at 1,500 nm.
- 5) All voice system "inputs" from the MCCA via the BC distribution system shall appear on the "left" side of IDC (minimum 110 blocks) punch terminals of the IMCCA.
- 6) All voice system "outputs" or trunk line connections shall appear on the "right" side of the same IDC (minimum 110 blocks) of the IMCCA.
- 7) All data system "inputs" from the MCCA via the BC distribution system shall appear on the "top" row of jacks of the appropriate patch panel of the IMCCA.
- 8) All data system "outputs" or trunk line connections shall appear on the "bottom" row of jacks in the same patch panel of the IMCCA.
- 9) The splitting of pairs within cables between different jacks shall not be allowed. In the case of ISDN and/or ATM and /or Frame Relay applications, terminating resistors shall be provided externally to the patch panel connector or jack.

- 10) A patch cord shall be provided for each system "pair" of connection jacks. Each patch cord shall have modular connectors provided on each end to match the panel's modular female jack.
 - 11) The fiber optic BC system shall be configured as a "Buss" Topology with separate dedicated fibers between the MCCS and each IMCCS. The System shall be sized to meet the system requirements plus an expansion capability of 50%. Fiber optic cable(s) having a minimum of 12 strands multimode fiber and 12 strands single mode fiber shall be provided. Two of the single mode fibers shall be designated for analog video service.
 - 12) All BC shall be identified with permanent labels at both ends. Labels will indicate system, floor, closet, and zone. The label designations shall match those used for cross-connect terminals and patch panels.
- i. Distribution (Common to Intra-Building) Cabling Systems: The intra-building trunk cabling system provides for connection between the IMCCS and each Riser TC's provided vertical cross-connecting system (VCCS) within a building. The media (copper, fiber optic, and RF coaxial) used in the intra-building backbone cabling system shall be designed according to the system requirements, OEM standards and guidelines, and as described herein. A multi-pair copper for voice and data, and separate multiple fiber optic, and analog RF coaxial trunk system shall be provided as a part of the System.
- 1) Category 6 UTP or STP multi-pair trunk cable(s) shall be used in the voice and data trunk-line-cabling systems. A minimum of eight pairs per circuit, plus an additional 50% spare for growth shall be provided.
 - 2) Where the distance limitations of UTP and/or STP will be exceeded, multimode (or single mode) fiber optic cable shall be used in the voice and/or trunk cabling systems. The total loss of the fiber trunks shall not exceed 12 dB at 850 nM , 11 dB at 1,300 nM, or 10 dB at 1,500 nM.
 - a) All voice system "outputs" from the IMCCS to the trunk-line distribution system shall appear on the "right" side of IDC (minimum 110A blocks) punch terminals of the IMCCS.

- b) All data system "outputs" from the IMCCS to the trunk-line distribution system shall appear on the "bottom" row of jacks of the same IDC (minimum 110A blocks) of the IMCCS.
 - c) The splitting of pairs within cables between different jacks shall not be allowed. In the case of ISDN and/or ATM and/or Frame Relay applications, terminating resistors shall be provided externally to the patch panel connector or jack.
 - d) A patch cord shall be provided for each system "pair" of connection jacks. Each patch cord shall have modular connectors provided on each end to match the panel's modular female jack.
- 3) The fiber optic trunk line system shall be configured as a "Buss" Topology with separate dedicated fibers between the IMCCS and each RCS. The System shall be sized to meet the System requirements with a expansion capability of 50% provided. Separate individual fiber optic cable(s) with a minimum of 18 strands multimode fiber and/or 12 strands single mode fiber shall be provided. Two of the single mode fibers shall be designated for analog video service.
- 4) All trunk lines shall be identified with permanent labels at both ends. Labels will indicate system, floor, closet, and zone. The label designations shall match those used for cross-connects and patch panels.
- a) All System outputs from the IMCCS to the trunk-line distribution system shall appear on the "bottom" row of "ST" connectors in the appropriate patch panel.
 - b) A patch cord shall be provided for each system "pair" of connection "ST" connectors. As a minimum, each patch cord shall have "ST" male connectors provided on each end to match the panel's female "ST" connector provided.
- 5) An analog RF coaxial cable trunk system shall be provided. A minimum of two coaxial cables shall be provided between the IMCCS and each Riser VCCS to comprise an individual circuit as designated and as shown on the drawings. Additional analog RF coaxial cables shall be provided as system design dictates and as shown on the drawings.

- 6) The analog RF coaxial trunk-line systems shall be connected between each IMCCS "bottom" row of "F" connectors and shall terminate on the VCCS "top" row of "F" connectors on an appropriate patch panel. A minimum of six coaxial cables shall be provided in the riser trunk-line system.
- j. VCCS and Horizontal Cross-connecting (HCCS) Systems: Each TC shall be provided with a separate VCCS and HCCS located within the TC. The VCCS and HCCS shall interconnect and interface the riser (vertical) trunk line cables with the horizontal (or station) sub-trunk line cables. The media (copper, fiber optic and analog RF coaxial) used in the CCS system shall be designed according to the System requirements, OEM standards and guidelines, and as described herein. A multi-pair copper for voice and data, and separate multiple fiber optic and RF coaxial CCS system shall be provided as a part of the System.
 - 1) The UTP, STP, and fiber optic and RF coaxial trunk-line cabling systems are that connected between the trunk-lines and Riser VCCS, shall be terminated:
 - a) On the "left" or "top" IDC (or 110A blocks) for each UTP or STP voice cable.
 - b) On the "top" row of RJ45 jacks on the appropriate patch panel for each UTP or STP data cable.
 - c) On the "top" row of "ST" connectors on the appropriate patch panel for each fiber and "F" connectors for each analog RF coaxial cable.
 - 2) The UTP, STP, and fiber optic and analog RF coaxial sub-trunk (lateral) floor distribution cabling systems that are connected between each RTC and each TCO or secondary system distribution or connection point, shall terminate on an appropriate HCCS, at the:
 - a) On the "right" IDC (or 110A block) used as the VCCS input for each UTP or STP voice cable.
 - b) On the "bottom" row of RJ45 jacks on the appropriate patch panel used as the VCCS input for each UTP or STP data cable.
 - c) On the "bottom" row of "ST" connectors on the appropriate patch panel used as the VCCS input for each fiber and "F" connectors for each analog RF coaxial cable.

- d) The technical requirements of the VCCS and HCCS "patch", "terminating", or "breakout" panels and cable management assemblies for voice, data and fiber optic (and RF coaxial) cables shall be as described in the above MCCS, IMCCS, and TC technical paragraphs.
- 3) The Contractor shall not "cross-connect" the VCCS or HCCS cabling systems even though appropriate patch cords are provided for each "patch", "punch", or "breakout" panel. Also, the Contractor shall not provide active interface or distribution electronic equipment as a part of the System.
- 4) The analog RF coaxial cabling systems shall be connected between each IMCS and RTC shall terminate on the VCCS on the "top" row of "F" connectors on an appropriate patch panel. Additionally, each horizontal distribution analog RF coaxial cable shall terminate on the HCCS on the "bottom" row of "F" connectors of the same panel.
- 5) The analog RF terminating panel(s) shall be the "patch" type. Each panel shall be the 19 inch EIA rack dimensions and provided with a minimum of 12 double female "F" connector rows. Each patch panel shall be provided with the expansion capability of a maximum of 24 double row "F" slots that can be field activated.
- 6) Each analog RF "patch" panel shall be provided inside a lockable cabinet or enclosure. Stacking of the "patch" panels is permitted as long as installation guidelines are met.
- k. Horizontal (or Station) Cabling (HC): The HC distribution cabling systems connects the distribution field of the voice and data HCCS, in a "Star" Topology, to each TCO or connector and as shown on the drawings via the sub-trunk system.
 - 1) Horizontal cables shall consist of insulated, UTP or STP conductors that are rated for Category 6 telecommunications service for voice and data systems.
 - 2) The number of UTP or STP distribution pairs dedicated to each floor from the HC shall be sufficient to accommodate all the horizontal voice and data circuits served by the distribution cable to each TCO.

- a) A minimum of four pairs for voice shall be connected to the "right" side of the IDC (or 110A block) that the VCCS "input" connections appear in the RTC.
 - b) A minimum of two separate sets of four pairs each for data shall be connected to the "bottom" row of RJ45 jacks that the VCCS "input" connections appear in the RTC.
- 3) The horizontal cable length to the farthest system outlet shall be limited to a maximum of 90M (or 295 ft). These maximum lengths must be derated, adjusted and reduced to include cross-connection and distribution system losses. Additional TC(s) shall be provided on large floor areas of buildings to limit the horizontal distribution to a maximum of 90M (or 295 ft).
 - 4) The splitting of pairs within a cable between different jacks shall not be permitted.
 - 5) The installation of the HC shall conform to appropriate OEM recommendations and standards outlined herein. This requirement will insure adequate protection for Electro-Magnetic Interference (EMI) sources.
 - 6) A system design where "looping" the HC distribution cables from room to room shall not be permitted.
 - 7) The number of fiber optic cables dedicated from the "bottom" row of "ST" connectors of the appropriate patch panel that the VCCS "input" connections were made, to each floor shall be sufficient to accommodate all the horizontal TCO's served by the distribution cable system in a "home run" configuration minimum of two cables (one multimode and one single mode) per each TCO and as shown on the drawings.
 - 8) The analog RF coaxial cables dedicated from the "bottom" row of "F" connectors of the appropriate VCCS patch panel where the "input" connections were made, to each floor TCO shall provided in the "home run" configuration and be sufficient to accommodate all the TCO's served by the HC distribution cable system minimum of one analog RF coaxial cable shall be provided for each TCO circuit and as shown on the drawings).
1. System Telecommunication Outlets (TCO): The System shall be capable of receiving the specified telephone (or voice) and data signals acquired from the LEC, FTS contracted carrier and

computer system, and one each analog RF cable, and one each fiber optic single mode and multimode cables and shall process and distribute them to the designated TCO's and as shown on the drawings. At a minimum, one TCO shall be provided on each room wall, associated with an active 120 VAC shall be provided and as shown on the drawings. The only exception to the general rule, of one outlet per wall, shall be those "special" locations (e.g., surgical suites, radiology MRI rooms, labs, patient bed rooms, warehouse, loading docks, storage rooms, etc.) where there is usually only one TCO provided as designated on the drawings.

- 1) Each TCO shall consist of three multipin modular RJ45 jacks, one designated for telephone and two for data service, and two fiber optic "ST" connectors, one designated for multimode fiber optic cable and the other for single mode fiber optic cable connection(s) and one analog RF coaxial "F" connector. Each TCO with appropriate jacks installed shall be provided by the Contractor in each designated location and as shown on the drawings.
- 2) The Contractor shall connect each telephone multipin modular RJ45 jack to a separate "right side as you look at it" telephone HC distribution system HCCS "punch down" 110A block or approved IDC terminating device in each associated RTC. The modular RJ45 jack shall be able to accept and operate with smaller modular RJ11 plugs while providing proper connection and not damaging the modular jack. The OEM shall warrant all modular RJ45/11 jacks in such a manner to be usable for modular RJ11 plugs.
- 3) The Contractor shall connect each TCO data multipin modular RJ45 jack to a separate lower row jack on the HCCS "patch panel" in each associated RTC. The Contractor is not to "cross-connect" VCCS and HCCS data distribution cables or provides active electronic data distribution equipment as a part of the System.
- 4) A non-impact termination method, using either a stuffer cap with installation tool or full-cycle terminating tool having both tactile and audible feedback to indicate proper termination shall be used. High impact installation tools shall not be used.

- 5) Each terminated conductor end shall be properly trimmed to assure a minimum clearance of 6.35 mm (0.250 in) clearance between the conductors of adjacent modules.
- 6) The multipin RJ45 jack shall be modular in construction that will accept and operate with a modular UTP and STP RJ45 connector and its pin assignments.
- 7) The Contractor shall connect each fiber optic TCO "ST" connector to a separate fiber optic "bottom" row "ST" connector HCCS "patch panel" or "breakout" terminating device in each associated TC. The Contractor is not to "interconnect" VCCS and HCCS fiber optic distributions cables or provide active fiber optic electronic distribution equipment as a part of the system.
- 8) The Contractor shall connect each analog RF cable to a female "F" connector provided on each TCO and as shown on the drawings and to each bottom row of "F" connectors on the HCCS patch panel(s) serving the area. The Contractor is not to "interconnect" VCCS and HCCS analog RF distribution cables OR provides active analog RF distribution equipment as a part of the System.

B. System Performance:

1. At a minimum, the System shall be able to support the following voice and data and analog RF operations for Category 6 Certified Telecommunication Service:
 - a. Provide the following interchange (or interface) capabilities:
 - 1) Basic Rate (BRI).
 - 2) Primary Rate (PRI).
 - b. ISDN:
 - 1) Narrow Band BRI.
 - a) B Channel: 64 kilo-Bits per second (kBps), minimum.
 - b) D Channel: 16 kBps, minimum.
 - c) H Channel: 384 kBps, minimum.
 - 2) Narrow Band PRI:
 - a) B Channel: 64 kBps, minimum.
 - b) D Channel: 64 kBps, minimum.
 - c) H Channel: 1,920 kBps, minimum.
 - 3) Wide (or Broad) Band:

- a) All channels: 140 mega(m)-Bps, minimum, capable to 565 mBps at "T" reference.
 - c. ATM operation and interface: ATM 155 mBps
 - d. Frame Relay: All stated compliance's.
 - e. Integrated Data Communications Utility (IDCU) operation and interface.
 - f. Government Open Systems Interconnection Profile (GOSSIP) compliant.
 - g. Fiberoptic Distributed Data Interface (FDDI): A minimum 100 mBps to a maximum of 1.8 giga(g)-Bps data bit stream speed (shall be Synchronous Optical Network [Sonet] compliant).
 - h. System Sensitivity: Satisfactory service shall be provided for at least 3,000 feet for all voice and data and analog RF locations.
- 2. At a minimum the System shall support the following operating parameters:
 - a. EPBX connection:
 - 1) System speed: 1.0 gBps per second, minimum.
 - 2) Impedance: 600 Ohms.
 - 3) Cross Modulation: -60 deci-Bel (dB).
 - 4) Hum Modulation: -55 Db.
 - 5) System data error: 10 to the -10 Bps, minimum loss measured at the frame output with reference Zero (0) deciBel measured (dBm) at 1,000 Hertz (Hz) applied to the frame input.
 - a) Trunk to station: 1.5 dB, maximum.
 - b) Station to station: 3.0 dB, maximum.
 - c) Internal switch crosstalk: -60 dB when a signal of ± 10 deciBel measured (dBm), 500-2,500 Hz range is applied to the primary path.
 - d) Idle channel noise: 25 dBm "C" or 3.0 dBm "O" above reference (terminated) ground noise, whichever is greater.
 - e) Traffic Grade of Service for Voice and Data:
 - (1) A minimum grade of service of P-01 with an average traffic load of 7.0 CCS per station per hour and a traffic overload in the data circuits will not interfere with, or degrade, the voice service.
 - (2) Average CCS per voice station: The average CCS capacity per voice station shall be maintained at 7.0 CCS when the

EPBX is expanded up to the projected maximum growth as stated herein.

b. Telecommunications Outlet (TCO):

1) Voice:

- a) Isolation (outlet-outlet): 24 dB.
- b) Impedance: 600 Ohms, balanced (BAL).
- c) Signal Level: 0 deciBel per mili-Volt (dBmV) \pm 0.1 dBmV.
- d) System speed: 100 mBps, minimum.
- e) System data error: 10 to the -6 Bps, minimum.

2) Data:

- a) Isolation (outlet-outlet): 24 dB.
- b) Impedance: 600 Ohms, BAL.
- c) Signal Level: 0 dBmV \pm 0.1 dBmV.
- d) System speed: 120 mBps, minimum.
- e) System data error: 10 to the -8 Bps, minimum.

3) Fiber optic:

- a) Isolation (outlet-outlet): 36 dB.
- b) Signal Level: 0 dBmV \pm 0.1 dBmV.
- c) System speed: 540 mBps, minimum.
- d) System data error: 10 to the -6 BPS, minimum.

4) Closed Circuit Analog Video Service: Analog video service is considered to be at baseband (below 100 mHz in frequency bandwidth). An analog video circuit requires a separate analog video from the audio connector. The following minimum operating parameters shall be capable over each installed analog video circuit:

- a) Impedance: 75 Ohm, unbalanced.
- b) Output Level: 1.0 V peak to peak (P-P), for 87.5% depth of Modulation (Mod).
- c) Diff Gain: \pm 1 dB at 87.5% Mod.
- d) Diff Phase: \pm 1.5 at 87.5% Mod.
- e) Signal to Noise (S/N) ratio: 44 dB, minimum.
- f) Hum Modulation: -55 dB.
- g) Return Loss: -14 dB (or 1.5 Voltage Standing Wave Ratio [VSWR]), maximum.
- h) Isolation (outlet-outlet): 24 dB, minimum.
- i) Bandwidth: 6.0 mHz per channel, fully loaded, minimum.

5) Closed Circuit Analog Audio Service: Analog audio service is considered to be at baseband (below 10 mHz in frequency bandwidth). Usually an analog audio circuit requires separate audio connectors and video connectors even though both are considered baseband signals. However, since each TCO has multiple 600 (or 120) Ohm BAL line pairs, the analog audio circuit may be designated to one of the provided pairs of UTP or STP for each TCO and as shown on the drawings, in lieu of providing a separate baseband audio run to the TCO. The following minimum operating parameters shall be capable over each installed analog audio circuit:

a) Audio (NOT TELEPHONE VOICE):

- (1) Impedance: 600 Ohm, BAL.
- (2) Input Level: 59 mV Root Mean Squared (RMS), minimum.
- (3) Output Level: 0 dBm.
- (4) S/N ratio: 55 dB, minimum.
- (5) Hum Modulation: -50 dB, minimum.
- (6) Return Loss: -14 dB (or 1.5 VSWR), maximum.
- (7) Isolation (outlet-outlet): 24 dB, minimum.
- (8) Frequency Bandwidth: 100 Hz - 10K Hz, minimum.

C. General:

1. All equipment to be supplied under this specification shall be new and the current model of a standard product of an OEM or record. An OEM of record shall be defined as a company whose main occupation is the manufacture for sale of the items of equipment supplied and which:
 - a. Maintains a stock of replacement parts for the item submitted.
 - b. Maintains engineering drawings, specifications, and operating manuals for the items submitted.
 - c. Has published and distributed descriptive literature and equipment specifications on the items of equipment submitted at least 30 calendar days prior to the Invitation for Bid.
2. Specifications of equipment as set forth in this document are minimum requirements, unless otherwise stated, and shall not be construed as limiting the overall quality, quantity, or performance characteristics of items furnished in the System. When the Contractor furnishes an item of equipment for which there is a

- specification contained herein, the item of equipment shall meet or exceed the specification for that item of equipment.
3. The Contractor shall provide written verification, in writing to the COTR at time of installation, that the type of wire/cable being provided is recommended and approved by the OEM. The Contractor is responsible for providing the proper size and type of cable duct and/or conduit and wiring even though the actual installation may be by another subcontractor.
 4. The Telephone Contractor is responsible for providing interfacing cable connections for the telephone, PA systems with the System.
 5. The telephone equipment and PA interface equipment shall be the interface points for connection of the PA interface cabling from the telephone switch via the system telephone interface unit.
 6. Active electronic component equipment shall consist of solid state components, be rated for continuous duty service, comply with the requirements of FCC standards for telephone equipment, systems, and service.
 7. All passive distribution equipment shall meet or exceed -80 dB radiation shielding specifications.
 8. All interconnecting twisted pair, fiber-optic or coaxial cables shall be terminated on equipment terminal boards, punch blocks, breakout boxes, splice blocks, and unused equipment ports/taps shall be terminated according to the OEM's instructions for telephone cable systems without adapters. The Contractor shall not leave unused or spare twisted pair wire, fiber-optic, or coaxial cable unterminated, unconnected, loose or unsecured.
 9. Color code all distribution wiring to conform to the Telephone Industry standard, EIA/TIA, and this document, which ever is the more stringent. At a minimum, all equipment, cable duct and/or conduit, enclosures, wiring, terminals, and cables shall be clearly and permanently labeled according to and using the provided record drawings, to facilitate installation and maintenance. Reference Specification Section 27 10 00, STRUCTURED CABLING and Section 27 31 00, VOICE COMMUNICATIONS SWITCHING AND ROUTING EQUIPMENT.
 10. Connect the System's primary input AC power to the Facility's Critical Branch of the Emergency AC power distribution system as shown on the plans or if not shown on the plans consult with COTR regarding a suitable circuit location prior to bidding.

11. Plug-in connectors shall be provided to connect all equipment, except coaxial cables and interface points. Coaxial cable distribution points and RF transmission lines shall use coaxial cable connections recommended by the cable OEM and approved by the System OEM. Base- band cable systems shall utilize barrier terminal screw type connectors, at a minimum. Crimp type connectors installed with a ratchet type installation tool are and acceptable alternate as long as the cable dress, pairs, shielding, grounding, and connections and labeling are provided the same as the barrier terminal strip connectors. Tape of any type, wire nuts, or solder type connections are unacceptable and will not be approved.
12. All equipment faceplates utilized in the System shall be stainless steel, anodized aluminum, or UL approved cycolac plastic for the areas where provided.
13. Noise filters and surge protectors shall be provided for each equipment interface cabinet, switch equipment cabinet, control console, local, and remote active equipment locations to ensure protection from input primary AC power surges and noise glitches are not induced into low Voltage data circuits.
14. Underground warning tape shall be standard, 4-Mil polyethylene 76 mm (3 inch) wide tape detectable, red with black letters imprinted with "CAUTION BURIED ELECTRIC LINE BELOW", orange with black letters imprinted with "CAUTION BURIED TELEPHONE LINE BELOW" or orange with black letters imprinted with "CAUTION BURIED FIBER OPTIC LINE BELOW", as applicable.

D. Equipment Functional Characteristics:

FUNCTIONS	CHARACTERISTICS
Input Voltage	105 to 130 VAC
POWER LINE FREQUENCY	60 HZ \pm 2.0 HZ
Operating Temperature	0 to 50 degrees (°) Centigrade (C)
Humidity	80 percent (%) minimum rating

E. Equipment Standards and Testing:

1. The System has been defined herein as connected to systems identified as Critical Care performing Life Support Functions. Therefore, at a minimum, the system shall conform to all aforementioned National and/or Local Life Safety Codes (which ever

are the more stringent), NFPA, NEC, this specification, JCAHCO Life Safety Accreditation requirements, and the OEM recommendations, instructions, and guidelines.

2. All supplies and materials shall be listed, labeled or certified by UL or a nationally recognized testing laboratory where such standards have been established for the supplies, materials or equipment. See paragraph minimum requirements Section 27 05 11, REQUIREMENTS FOR COMMUNICATIONS INSTALLATIONS, and the guidelines listed in paragraph 2.J.2.
3. The provided active and passive equipment required by the System design and approved technical submittal must conform with each UL standard in effect for the equipment, as of the date of the technical submittal (or the date when the COTR approved system equipment necessary to be replaced) was technically reviewed and approved by VA. Where a UL standard is in existence for equipment to be used in completion of this contract, the equipment must bear the approved UL seal.
4. Each item of electronic equipment to be provided under this contract must bear the approved UL seal or the seal of the testing laboratory that warrants the equipment has been tested in accordance with, and conforms to the specified standards.

2.2 DISTRIBUTION EQUIPMENT AND SYSTEMS

A. Telecommunication Outlet (TCO):

1. The TCO shall consist of one telephone multipin jack and two data multipin jacks, and one single mode fiber optic, and one multimode fiber optic, and one baseband analog RF, video, or audio (not Telephone) jacks mounted in a steel outlet box. A separate 100mm (4in.) x 100mm (4in.) x 63mm (2.5in.) steel outlet box with a labeled stainless steel faceplate will be used. A second 100mm (4in.) x 100mm (4in.) x 63mm (2.5in.) steel outlet box with a labeled faceplate shall be provided as required adjacent to the first box to ensure system connections and expandability requirements are met.
2. All telephone multipin connections shall be RJ-45/11 compatible female types. All data multipin connections shall be RJ-45 female types. All fiber optic (single mode and multimode) connections shall be "ST" stainless steel female types. All analog RF, video, and

audio connections shall be "F", "BNC", or "XL" female types respectively.

3. The TCO shall be fed from the appropriate CCS located in the respective RTC in a manner to provide a uniform and balanced distribution system.
 4. Interface of the data multipin jacks to appropriate patch panels (or approved "punch down" blocks) in the associated RTC, is the responsibility of the Contractor. The Contractor shall not extend data cables from the RTCs to data terminal equipment or install data terminal equipment.
 5. The wall outlet shall be provided with a stainless steel or approve alternate cover plate to fit the telephone multipin jack, data multi-pin jacks, fiber optic jacks, analog jack(s) and the outlet box provided (100mm (4in.) x 100mm (4in.) for single and 100mm (4in.) x 200mm (8in.) for dual outlet box applications). For PBPU installations, the cover plate shall be stainless steel.
 6. Interface of the fiber optic "ST" jacks to appropriate patch panels in the associated RTC, is the responsibility of the Contractor. The Contractor shall not cross-connect fiber optic cables in the to fiber optic equipment or install fiber optic equipment.
 7. Interface of the analog RF "F", video "BNC", and audio "XL" jacks to appropriate patch panels in the associated RTC, is the responsibility of the Contractor. The Contractor shall not cross-connect analog cables in the RTCs to analog equipment or install active analog equipment.
- B. Distribution Cables: Each cable shall meet or exceed the following specifications for the specific type of cable. Each cable reel shall be sweep tested and certified by the OEM by tags affixed to each reel. The Contractor shall turn over all sweep tags to the COTR or PM. Additionally, the Contractor shall provide a 610 mm (2 ft.) sample of each provided cable, to the COTR and receive approval before installation. Cables installed in any outside location (i.e. above ground, under ground in conduit, ducts, pathways, etc.) shall be filled with a waterproofing compound between outside jacket (not immediately touching any provided armor) and inter conductors to seal punctures in the jacket and protect the conductors from moisture.
1. Remote Control:

- a. The remote control cable shall be multi-conductor with stranded (solid is permissible) conductors. The cable shall be able to handle the power and voltage necessary to control specified system equipment from a remote location. The cable shall be UL listed and pass the FR-1 vertical flame test, at a minimum. Each conductor shall be color-coded. Combined multi-conductor and coaxial cables are acceptable for this installation, as long as all system performance standards are met.
- b. Technical Characteristics:

Length	As required, in 1K (3,000 ft.) reels minimum
Connectors	As required by system design
Size	18 AWG, minimum, Outside 20 AWG, minimum, Inside
Color coding	Required, EIA industry standard
Bend radius	10X the cable outside diameter
Impedance	As required
Shield coverage	As required by OEM specification
Attenuation	
Frequency in MHz	dB per 305 M (1,000ft.), maximum
0.7	5.2
1.0	6.5
4.0	14.0
8.0	19.0
16.0	26.0
20.0	29.0
25.0	33.0
31.0	36.0
50.0	52.0

2. Telephone:

- a. The System cable shall be provided by the Contractor to meet the minimum system requirements of Category Six service. The cable shall interconnect each part of the system. The cable shall be completely survivable in areas where it is installed.

b. Technical Characteristics:

Length	As required, in 1K (3,000 ft.) reels minimum
Cable	Voice grade category six
Connectors	As required by system design
Size	22 AWG, minimum, Outside 24 AWG, minimum, Inside
Color coding	Required, telephone industry standard
Bend radius	10X the cable outside diameter
Impedance	120 Ohms \pm 15%, BAL
Shield coverage	As required by OEM specification
Attenuation	
Frequency in mHz	dB per 305 M (1,000ft.), maximum
0.7	5.2
1.0	6.5
4.0	14.0
8.0	19.0
16.0	26.0
20.0	29.0
25.0	33.0
31.0	36.0
62.0	52.0
100.0	68.0

3. Data Multi-Conductor:

- a. The cable shall be multi-conductor, shielded or unshielded cable with stranded conductors. The cable shall be able to handle the power and voltage used over the distance required. It shall meet Category Six service at a minimum.

b. Technical Characteristics:

Wire size	22 AWG, minimum
Working shield	350 V
Bend radius	10X the cable outside diameter
Impedance	100 Ohms \pm 15%, BAL
Bandwidth	100 mHz, minimum

DC RESISTANCE	10.0 Ohms/100M, maximum
Shield coverage	
Overall Outside (if OEM specified)	100%
Individual Pairs (if OEM specified)	100%
Attenuation	
Frequency in MHz	dB per 305 M (1,000ft.), maximum
0.7	5.2
1.0	6.5
4.0	14.0
8.0	19.0
16.0	26.0
20.0	29.0
25.0	33.0
31.0	36.0
62.0	52.0
100.0	68.0

4. Fiber Optic:

a. Multimode Fiber:

- 1) The general purpose multimode fiber optic cable shall be a dual window type installed in conduit for all system locations. A load-bearing support braid shall surround the inner tube for strength during cable installation.
- 2) Technical Characteristics:

Bend radius	6.0", minimum Outer jacket, As required
FIBER DIAMETER	62.5 MICRONS
Cladding	125 microns
Attenuation	
850 nM	4.0 dB per kM, maximum
1,300 nM	2.0 dB per kM, maximum
Bandwidth	
850 nM	160 MHz, minimum
1,300 nM	500 MHz, minimum

Connectors	Stainless steel
------------	-----------------

b. Single mode Fiber:

- 1) The general purpose single mode fiber optic cable shall be a dual window type installed in conduit for all system locations. A load-bearing support braid shall surround the inner tube for strength during cable installation.

2) Technical Characteristics:

Bend radius	100 mm (4 in.) minimum
Outer jacket	PVC
Fiber diameter	8.7 microns
Cladding	125 microns
Attenuation at 850 nM	1.0 dBm per km
Connectors	Stainless Steel

5. AC Power Cable: AC power cable(s) shall be 3-conductor, no. 12 AWG minimum, and rated for 13A-125V and 1,625W. Master AC power, installation specification and requirements, are given in the NEC and herein.

6. General Purpose Analog RF:

- a. The coaxial cable shall be an RG-6/U type (or equal), minimum and shall be increased in size (i.e. RG-11/U, .500", .750", etc.) as required to meet system design. It may also be used for baseband signals as approved by the OEM.

b. Technical Characteristics:

Impedance	75 OHM, UNBAL
Center conductor	20 AWG, solid or stranded copper, or copper plated steel or aluminum
Dielectric	Cellular polyethylene
Shield coverage	95%, copper braid
Connector type	BNC or UHF
Attenuation	
Frequency (k or MHz)	Maximum dB/30.5M (100ft.)
10 kHz	0.20

100 kHz	0.22
1.0 kHz	0.25
4.5 mHz	0.85
10.0 mHz	1.40
100 mHz	5.00

7. General Purpose Audio:

- a. The audio cable shall be two-conductor, STP cable with stranded conductors. The cable shall be able to handle the power used for the load impedance over the distance required, with not more than 5% power loss. This cable is to be provided in local PA areas only and is not to be used as a part of the telephone system.
- b. Technical Characteristics:

Impedance	70.7VRMS audio signal
Wire size	20 AWG, minimum
Working shield	350 V
Color coding	Required, EIA audio industry standard
Connectors	As required
Bend radius	10X the cable outside diameter
Impedance	100 Ohms \pm 15%, BAL
Bandwidth	20 mHz, minimum
DC resistance	10.0 Ohms/100M (330 ft.), maximum
Shield coverage	
Overall Outside (if OEM specified)	100%
Individual Pairs (if OEM specified)	100%
Attenuation	
Frequency in mHz	dB per 305 M (1,000ft.), maximum
0.7	5.2
1.0	6.5
4.0	14.0
8.0	19.0
16.0	26.0
20.0	29.0

8. General Purpose Analog Video:

- a. The coaxial cable shall be an RG-59/U type (or equal), minimum.
It may also be used for baseband signals as approved by the OEM.
- b. Technical Characteristics:

Impedance	75 Ohm, UNBAL
Center conductor	20 AWG, SOLID OR STRANDED COPPER
Dielectric	Cellular polyethylene
Shield coverage	95%, copper braid
Connector type	BNC or UHF
Attenuation	
Frequency (k or mHz)	Maximum dB/30.5M (100ft.)
10 kHz	0.20
100 kHz	0.22
1.0 kHz	0.25
4.5 mHz	0.85
10.0 mHz	1.40
100 mHz	5.00

C. Outlet Connection Cables:

1. Telephone:

- a. The Contractor shall provide a connection cable for each TCO telephone jack in the System with 10% spares. The telephone connection cable shall connect the telephone instrument to the TCO telephone jack. The Contractor shall not provide telephone instrument(s) or equipment.
- b. Technical Characteristics:

Length	1.8M (6ft.), minimum
Cable	Voice Grade
Connector	RJ-11/45 compatible male on each end
Size	24 AWG, minimum
Color coding	Required, telephone industry standard

2. Data:

- a. The Contractor shall provide a connection cable for each TCO data jack in the system with 10% spares. The data connection cable shall connect a data instrument to the TCO data jack. The Contractor shall not provide data terminal(s)/equipment.
- b. Technical Characteristics:

Length	1.8M (6 ft.), minimum
Cable	Data grade Category Six
Connector	RJ-45 male on each end
Color coding	Required, data industry standard
Size	24 AWG, minimum

3. Fiber Optic:

- a. The Contractor shall provide a connection cable for each TCO fiber optic connector in the System with 10% spares. The data connection cable shall connect a fiber optic instrument to the TCO fiber optic jack. The Contractor shall not provide fiber optic instrument(s)/equipment.
- b. Technical Characteristics:

Length	1.8M (6 ft.), minimum
Cable	Flexible single conductor with jacket
Connector	ST male on each end
Size	To fit single mode or multimode cable

4. Analog RF:

- a. The Contractor shall provide a connection cable for each TCO analog RF connector in the System with 10% spares. The analog RF connection cable shall connect a analog RF instrument to the TCO analog RF jack. The Contractor shall not provide analog RF equipment.
- b. Technical Characteristics:

Length	1.8M (6 ft.), minimum
Cable	Flexible RG-6/U, minimum
Connector	"F" male on each end

5. Analog Video:

- a. The Contractor shall provide a connection cable for each TCO analog video jack in the System with 10% spares. The analog video connection cable shall connect a analog video instrument to the TCO analog video jack. The Contractor shall not provide analog video instrument(s)/equipment.
- b. Technical Characteristics:

Length	1.8M (6 ft.), minimum
Cable	Flexible RG-59/U, minimum
Connector	BNC male on each end

6. Analog Audio:

- a. The Contractor shall provide a connection cable for each TCO analog audio jack in the System with 10% spares. The analog audio connection cable shall connect a analog audio instrument to the TCO analog audio jack. The Contractor shall not provide analog audio instrument(s)/equipment.
- b. Technical Characteristics:

Length	1.8M (6 ft.), minimum
Cable	Flexible 22 AWG, STP, minimum
Connector	"XL" male on each end

D. System Connectors:

1. Solderless (Forked Connector):

- a. The connector shall have a crimp-on coupling for quick connect/disconnect of wires or cables. The crimp-on connector shall be designed to fit the wire or cable furnished. The connector barrel shall be insulated and color-coded.
- b. Technical Characteristics:

Impedance	As required
Working Voltage	500 V

2. Multipin:

- a. The connector shall have a crimp-on coupling for quick connect/disconnect of wires or cables. The crimp-on connector shall be designed to fit the wire or cable furnished. The connector housing shall be fully enclosed and shielded. It shall be secured to the cable group by screw type compression sleeves.
- b. Technical Characteristics:

Impedance	As required
Working Voltage	500 V
Number of pins	As requires, usually 25 pairs minimum

3. Modular (RJ-45/11 and RJ-45): The connectors shall be commercial types for voice and high speed data transmission applications. he connector shall be compatible with telephone instruments, computer terminals, and other type devices requiring linking through the modular telecommunications outlet to the System. The connector shall be compatible with UTP and STP cables.

- a. Technical Characteristics:

Type	Number of Pins
RJ-11/45	Compatible with RJ45
RJ-45	Eight
Dielectric	Surge
Voltage	1,000V RMS, 60 Hz @ one minute, minimum
Current	2.2A RMS @ 30 Minutes or 7.0A RMS @ 5.0 seconds
Leakage	100 μ A, maximum
Connectability	
Initial contact resistance	20 mili-Ohms, maximum
Insulation displacement	10 mili-Ohms, maximum
Interface	Must interface with modular jacks from a variety of OEMs. RJ-11/45 plugs shall provide connection when used in RJ-45 jacks.
Durability	200 insertions/withdrawals, minimum

4. Fiber Optic: The connectors shall be commercial types for voice and high speed data transmission applications. The connector shall be compatible with telephone instruments, computer terminals, and other type devices requiring linking through the modular telecommunications outlet to the system. The connector shall be compatible with UTP and STP cables.

5. "BNC" Type:

a. The BNC connector shall have a bayonet locking coupling for quick connect/disconnect of coaxial cable/termination's. It shall be a crimp-on (twist on are acceptable) connector designed to fit the coaxial cable furnished.

b. Technical Characteristics:

Impedance	50 or 75 Ohms, UNBAL
Working Voltage	500 V

6. "F" Type:

a. The "F" connector shall have a screw type coupling for quick connect/disconnect of coaxial cable/termination's. It shall be a crimp-on connector designed to fit the coaxial cable furnished with integral 12.7 mm ($\frac{1}{2}$ in.) ferrule.

b. Technical Characteristics:

Impedance	75 Ohms, UNBAL
Working Voltage	500 V

7. "XL" Type:

a. The XL connector shall have three solder pins (screw types are acceptable) with a metal cover to firmly attach to the connector and cable protecting the internal connections. It shall be a coupling for quick connect/disconnect of audio cable/termination's. It shall be a connector designed to fit the coaxial cable furnished.

b. Technical Characteristics:

Impedance	120 or 600 Ohms, BAL
Working Voltage	500 V

E. Terminators:

1. Coaxial:

- a. These units shall be metal-housed precision types in the frequency ranges selected. They shall be the screw-on type that has low VSWR when installed and the proper impedance to terminate the required system unit or coaxial cable.
- b. Technical Characteristics:

Frequency	0-1 GHz
Power blocking	As required
Return loss	25 dB
Connectors	"F", "BNC", minimum
Impedance	50 or 75 Ohms, UNBAL

2. Audio:

- a. These units shall be metal-housed precision types in the frequency ranges selected. They shall be the screw-on audio spade lug, twin plug, XL types that has low VSWR when installed and the proper impedance to terminate the required system unit or coaxial cable.
- b. Technical Characteristics:

Frequency	20-20 kHz, minimum
Power blocking	As required
Return loss	15 dB
Connectors	"Audio spade lug", "1/4", "1/8", "XL" or "RCA"
Impedance	
Bal	100 Ohms, minimum
Unbal	75 Ohm, minimum

3. Fiber Optic:

- a. These units shall be metal-housed precision types in the frequency ranges selected. They shall be the screw-on type that has low VSWR when installed and the proper impedance to terminate the required system unit or fiber optic cable.
- b. Technical Characteristics:

Frequency	Lightwave
Power blocking	As required
Return loss	25 dB
Connectors	"ST", minimum
Construction	Stainless steel
Impedance	As required

F. Distribution Frames:

1. A new stand-alone (i.e., self supporting, free standing) MDF shall be provided to interconnect the EPBX and computer room. The MDF shall be modular and equipped with modular terminating mini blocks (i.e. Ericsson, 3M, etc.), and patch panels that are as small as possible and provide all the requirements of this specifications as described herein.
2. All cable distribution closets and MDFs shall be wired in accordance with industry standards and shall employ "latest state-of-the-art" modular cross-connect devices. The MDF/telephone closet riser cable shall be sized to satisfy all voice requirements plus not less than 50% spare (growth) capacity in each telephone closet which includes a fiber optic backbone. The MDF/telephone closet riser cable shall be sized to satisfy all voice and data requirements plus not less than 50% spare (growth) capacity in each telephone closet which does not include a fiber optic backbone.
3. The MDF and all intermediate distribution frames shall be connected to the EPBX system ground.
4. Technical Characteristics:

Telephone	
IDC type unit	As described in Part 2
Contact wires	50 micron of Gold over Nickel
Contact pressure	100 Grams, MIN
110A Punch blocks	Acceptable alternate to IDC
Data	110A blocks as described in Part 2
Fiber optic	Patch panel as described in Part 2
Analog Video	Patch panel as described in Part 2

2.3 TELECOMMUNICATIONS CLOSET REQUIREMENTS

Refer to VA Handbook H-088C3, Telephone System Requirements, for specific TC guidelines for size, power input, security, and backboard mounting requirements. It is the Contractors responsibility to ensure TC compliance with the System Requirements.

2.4 ENVIRONMENTAL REQUIREMENTS

Technical submittals shall identify the environmental specifications for housing the system. These environmental specifications shall identify the requirements for initial and expanded system configurations for:

- A. Floor loading for batteries and cabinets.
- B. Minimum floor space and ceiling heights.
- C. Minimum size of doors for equipment passage.
- D. Power requirements: The bidders shall provide the specific voltage, amperage, phases, and quantities of circuits required.
- E. Air conditioning, heating, and humidity requirements. The bidder shall identify the ambient temperature and relative humidity operating ranges required preventing equipment damage.
- F. Air conditioning requirements (expressed in BTU per hour, based on adequate dissipation of generated heat to maintain required room and equipment standards).
- G. Proposed floor plan based on the expanded system configuration of the bidder's proposed EPBX for this Facility.
- H. Conduit size requirement (between equipment room and console room).

2.5 INSTALLATION KIT

The kit shall be provided that, at a minimum, includes all connectors and terminals, labeling systems, audio spade lugs, barrier strips, punch blocks or wire wrap terminals, heat shrink tubing, cable ties, solder, hangers, clamps, bolts, conduit, cable duct, and/or cable tray, etc., required to accomplish a neat and secure installation. All wires shall terminate in a spade lug and barrier strip, wire wrap terminal or punch block. Unfinished or unlabeled wire connections shall not be allowed. Turn over to the COTR all unused and partially opened installation kit boxes, coaxial, fiberoptic, and twisted pair cable reels, conduit, cable tray, and/or cable duct bundles, wire rolls, physical installation hardware. The following are the minimum required installation sub-kits:

- A. System Grounding:

1. The grounding kit shall include all cable and installation hardware required. All radio equipment shall be connected to earth ground via internal building wiring, according to the NEC.
2. This includes, but is not limited to:
 - a. Coaxial Cable Shields.
 - b. Control Cable Shields.
 - c. Data Cable Shields.
 - d. Equipment Racks.
 - e. Equipment Cabinets.
 - f. Conduits.
 - g. Duct.
 - h. Cable Trays.
 - i. Power Panels.
 - j. Connector Panels.
 - k. Grounding Blocks.
- B. Coaxial Cable: The coaxial cable kit shall include all coaxial connectors, cable tying straps, heat shrink tabbing, hangers, clamps, etc., required to accomplish a neat and secure installation.
- C. Wire and Cable: The wire and cable kit shall include all connectors and terminals, audio spade lugs, barrier straps, punch blocks, wire wrap strips, heat shrink tubing, tie wraps, solder, hangers, clamps, labels etc., required to accomplish a neat and orderly installation.
- D. Conduit, Cable Duct, and Cable Tray: The kit shall include all conduit, duct, trays, junction boxes, back boxes, cover plates, feed through nipples, hangers, clamps, other hardware required to accomplish a neat and secure conduit, cable duct, and/or cable tray installation in accordance with the NEC and this document.
- E. Equipment Interface: The equipment kit shall include any item or quantity of equipment, cable, mounting hardware and materials needed to interface the systems with the identified sub-system(s) according to the OEM requirements and this document.
- F. Labels: The labeling kit shall include any item or quantity of labels, tools, stencils, and materials needed to completely and correctly label each subsystem according to the OEM requirements, as-installed drawings, and this document.
- G. Documentation: The documentation kit shall include any item or quantity of items, computer discs, as installed drawings, equipment, maintenance, and operation manuals, and OEM materials needed to

completely and correctly provide the system documentation as required by this document and explained herein.

PART 3 - EXECUTION

3.1 INSTALLATION

A. Product Delivery, Storage and Handling:

1. **Delivery:** Deliver materials to the job site in OEM's original unopened containers, clearly labeled with the OEM's name and equipment catalog numbers, model and serial identification numbers. The COTR may inventory the cable, patch panels, and related equipment.
2. **Storage and Handling:** Store and protect equipment in a manner, which will preclude damage as directed by the RE.

B. System Installation:

1. After the contract's been awarded, and within the time period specified in the contract, the Contractor shall deliver the total system in a manner that fully complies with the requirements of this specification. The Contractor shall make no substitutions or changes in the System without written approval from the COTR and PM.
2. The Contractor shall install all equipment and systems in a manner that complies with accepted industry standards of good practice, OEM instructions, the requirements of this specification, and in a manner which does not constitute a safety hazard. The Contractor shall insure that all installation personnel understands and complies with all the requirements of this specification.
3. The Contractor shall install suitable filters, traps, directional couplers, splitters, TC's, and pads for minimizing interference and for balancing the System. Items used for balancing and minimizing interference shall be able to pass telephone and data, and lightwave, and analog signals in the frequency bands selected, in the direction specified, with low loss, and high isolation, and with minimal delay of specified frequencies and signals. The Contractor shall provide all equipment necessary to meet the requirements of Paragraph 2.1.C and the System performance standards.
4. All passive equipment shall be connected according to the OEM's specifications to insure future correct termination, isolation, impedance match, and signal level balance at each telephone/data outlet.

5. Where TCOs are installed adjacent to each other, install one outlet for each instrument.
6. All lines shall be terminated in a suitable manner to facilitate future expansion of the System. There shall be a minimum of one spare 25 pair cable at each distribution point on each floor.
7. All vertical and horizontal copper and fiber optic, and coaxial cables shall be terminated so any future changes only requires modifications of the existing and new EPBX or signal closet equipment only.
8. Terminating resistors or devices shall be used to terminate all unused branches, outlets, equipment ports of the System, and shall be devices designed for the purpose of terminating fiber optic or twisted pair, and coaxial, and lightwave cables carrying telephone and data, and analog signals in telephone and data, and analog video, and lightwave systems.
9. Equipment installed outdoors shall be weatherproof or installed in weatherproof enclosures with hinged doors and locks with two keys.
10. Equipment installed indoors shall be installed in metal cabinets with hinged doors and locks with two keys.

C. Conduit and Signal Ducts:

1. Conduit:

- a. The Contractor shall employ the latest installation practices and materials. The Contractor shall provide conduit, junction boxes, connectors, sleeves, weatherheads, pitch pockets, and associated sealing materials not specifically identified in this document as GFE. Conduit penetrations of walls, ceilings, floors, interstitial space, fire barriers, etc., shall be sleeved and sealed. The minimum conduit size shall be 19 mm (3/4 in.).
- b. All cables shall be installed in separate conduit and/or signal ducts (exception from the separate conduit requirement to allow telephone cables to be installed in partitioned cable tray with data cables may be granted in writing by the COTR if requested.) Conduits shall be provided in accordance with Section 27 05 33, RACEWAYS AND BOXES FOR COMMUNICATIONS SYSTEMS, and NEC Articles 517 for Critical Care and 800 for Communications systems, at a minimum.
- c. When metal, plastic covered, etc., flexible cable protective armor or systems are specifically authorized to be provided for

use in the System, their installation guidelines and standards shall be as specified herein, Section 27 05 33, RACEWAYS AND BOXES FOR COMMUNICATIONS SYSTEMS, and the NEC.

- d. When "innerduct" flexible cable protective systems is specifically authorized to be provided for use in the System, it's installation guidelines and standards shall be as the specified herein, Section 27 05 33, RACEWAYS AND BOXES FOR COMMUNICATIONS SYSTEMS, and the NEC.
- e. Conduit (including GFE) fill shall not exceed 40%. Each conduit end shall be equipped with a protective insulator or sleeve to cover the conduit end, connection nut or clamp, to protect the wire or cable during installation and remaining in the conduit. Electrical power conduit shall be installed in accordance with the NEC. AC power conduit shall be run separate from signal conduit.
- f. When metal, plastic covered, etc., flexible cable protective armor or systems are specifically authorized to be provided for use in the System, their installation guidelines and standards shall be as specified herein, Section 27 05 33, RACEWAYS AND BOXES FOR COMMUNICATIONS SYSTEMS, and the NEC.
- g. Ensure that Critical Care ----- Nurse Call and PA Systems (as identified by NEC Section 517) are completely separated and protected from all other systems.

2. Signal Duct, Cable Duct, or Cable Tray:

- a. The Contractor shall use existing signal duct, cable duct, and/or cable tray, when identified and approved by the RE.
- b. Approved signal and/or cable duct shall be a minimum size of 100 mm x 100 mm (4 in. X 4 in.) inside diameter with removable tops or sides, as appropriate. Protective sleeves, guides or barriers are required on all sharp corners, openings, anchors, bolts or screw ends, junction, interface and connection points.
- c. Approved cable tray shall be fully covered, mechanically and physically partitioned for multiple electronic circuit use, and be UL certified and labeled for use with telecommunication circuits and/or systems. The COTR shall approve width and height dimensions.

D. Distribution System Signal Wires and Cables:

1. Wires and cables shall be provided in the same manner and use like construction practices as Fire Protective and other Emergency Systems that are identified and outlined in NFPA 101, Life Safety Code, Chapters 7, 12, and/or 13, NFPA 70, National Electrical Code, Chapter 7, Special Conditions. The wires and cables shall be able to withstand adverse environmental conditions in their respective location without deterioration. Wires and cables shall enter each equipment enclosure, console, cabinet or rack in such a manner that all doors or access panels can be opened and closed without removal or disruption of the cables.
 - a. Each wire and cable shall terminate on an item of equipment by direct connection. Spare or unused wire and cable shall be provided with appropriate connectors (female types) that are installed in appropriate punch blocks, barrier strips, patch, or bulkhead connector panels.
 - b. Fiber optic cables that are spare, unused or dark shall be provided with Industry Standard "ST" type female connectors installed in appropriate break out, patch, or bulkhead connector panels provided in enclosure(s) and shall be protected from the environment.
 - c. Coaxial cables that are spare, unused or dark shall be provided with the cable OEM specified type female connectors installed in appropriate break out, patch, or bulkhead connector panels provided in enclosure(s) and shall be protected from the environment.
 - d. All cable junctions and taps shall be accessible. Provide an 8 inch X 8 inch X 4 inch (minimum) junction box attached to the cable duct or raceway for installation of distribution system passive equipment. Ensure all equipment and tap junctions are accessible.
2. Routing and Interconnection:
 - a. Wires or cables between consoles, cabinets, racks and other equipment shall be in an approved conduit, signal duct, cable duct, or cable tray that is secured to building structure.
 - b. Wires and cables shall be insulated to prevent contact with signal or current carrying conductors. Wires or cables used in assembling consoles, panels, equipment cabinets and racks shall be formed into harnesses that are bundled and tied. Harnessed

wires or cables shall be combed straight, formed and dressed in either a vertical or horizontal relationship to equipment, controls, components or terminations.

- c. Harnesses with intertwined members are not acceptable. Each wire or cable that breaks out from a harness for connection or termination shall have been tied off at that harness or bundle point, and be provided with a neatly formed service loop.
- d. Wires and cables shall be grouped according to service (i.e.: AC, grounds, signal, DC, control, etc.). DC, control and signal cables may be included with any group. Wires and cables shall be neatly formed and shall not change position in the group throughout the conduit run. Wires and cables in approved signal duct, conduit, cable ducts, or cable trays shall be neatly formed, bundled, tied off in 600 mm to 900 mm (24 in. to 36 in.) lengths and shall not change position in the group throughout the run. Concealed splices are not allowed.
- e. Separate, organize, bundle, and route wires or cables to restrict EMI, channel crosstalk, or feedback oscillation inside any enclosure. Looking at any enclosure from the rear (wall mounted enclosures, junction, pull or interface boxes from the front), locate AC power, DC and speaker wires or cables on the left; coaxial, control, microphone and line level audio and data wires or cables, on the right. This installation shall be accomplished with ties and/or fasteners that will not damage or distort the wires or cables. Limit spacing between tied off points to a maximum of 150 mm (6 inches).
- f. Do not pull wire or cable through any box, fitting or enclosure where change of cable tray or signal or cable duct alignment or direction occurs. Ensure the proper bend radius is maintained for each wire or cable as specified by it's OEM.
- g. Employ temporary guides, sheaves, rollers, and other necessary items to protect the wire or cable from excess tension or damage from bending during installation. Abrasion to wire or cable jackets is not acceptable and will not be allowed. Replace all cables whose jacket has been abraded. The discovery of any abraded and/or damaged cables during the proof of performance test shall be grounds for declaring the entire system unacceptable and the termination of the proof of performance

- test. Completely cover edges of wire or cable passing through holes in chassis, cabinets or racks, enclosures, pull or junction boxes, conduit, etc., with plastic or nylon grommeting.
- h. Cable runs shall be splice free between conduit junction and interface boxes and equipment locations.
 - i. Cables shall be installed and fastened without causing sharp bends or rubbing of the cables against sharp edges. Cables shall be fastened with hardware that will not damage or distort them.
 - j. Cables shall be labeled with permanent markers at the terminals of the electronic and passive equipment and at each junction point in the System. The lettering on the cables shall correspond with the lettering on the record diagrams.
 - k. Completely test all of the cables after installation and replace any defective cables.
 - l. Wires or cables that are installed outside of buildings shall be in conduit, secured to solid building structures. If specifically approved, on a case by case basis, to be run outside of conduit, the wires or cables shall be installed, as described herein. The bundled wires or cables must: Be tied at not less than 460 mm (18 in.) intervals to a solid building structure; have ultra violet protection and be totally waterproof (including all connections). The laying of wires or cables directly on roof tops, ladders, drooping down walls, walkways, floors, etc. is not allowed and will not be approved.
 - m. Wires or cables installed outside of conduit, cable trays, wireways, cable duct, etc.
 - 1) Only when specifically authorized as described herein, will wires or cables be identified and approved to be installed outside of conduit. The wire or cable runs shall be UL rated plenum and OEM certified for use in air plenums.
 - 2) Wires and cables shall be hidden, protected, fastened and tied at 600 mm (24 in.) intervals, maximum, as described herein to building structure.
 - 3) Closer wire or cable fastening intervals may be required to prevents sagging, maintain clearance above suspended ceilings, remove unsightly wiring and cabling from view and discourage tampering and vandalism. Wire or cable runs, not provided in conduit, that penetrate outside building walls, supporting

walls, and two hour fire barriers shall be sleeved and sealed with an approved fire retardant sealant.

- 4) Wire or cable runs to system components installed in walls (i.e.: volume attenuators, circuit controllers, signal, or data outlets, etc.) may, when specifically authorized by the RE, be fished through hollow spaces in walls and shall be certified for use in air plenum areas.

n. Wires or cables installed in underground conduit, duct, etc.

- 1) Wires or cables installed in underground installations shall be waterproofed by the inclusion of a water protective barrier (i.e. gel, magma, etc.) or flooding compound between the outside jacket and first shield. Each underground connection shall be accessible in a manhole, recessed ground level junction box, above ground pedestal, etc., and shall be provided with appropriate waterproof connectors to match the cable being installed. Once the System has been tested and found to meet the System performance standards and accepted by VA, the Contractor shall provide waterproof shrink tubing or approved mastic to fully encompass each wire or cable connection and overlay at least 150 mm (6 inches) above each wire or cable jacket trim point.
- 2) It is not acceptable to connect waterproofed cable directly to an inside CCS punch block or directly to an equipment connection port. When an under ground cable enters a building, it shall be routed directly to the closest TC that has been designated as the building's IMTC. The Contractor shall provide a "transition" splice in this TC where the "water proofed" cable enters on one side and "dry" cable exits on the other side. The "transition" splice shall be fully waterproof and be capable of reentry for system servicing. Additionally, the transition splice shall not allow the waterproofing compound to migrate from the water proof cable to the dry cable.
- 3) Warning tape shall be continuously placed 300 mm (12 inches) above buried conduit, cable, etc.

E. Outlet Boxes, Back Boxes, and Faceplates:

1. Outlet Boxes: Signal, power, interface, connection, distribution, and junction boxes shall be provided as required by the system design, on-site inspection, and review of the contract drawings.
 2. Back Boxes: Back boxes shall be provided as directed by the OEM as required by the approved system design, on-site inspection, and review of the contract drawings.
 3. Face Plates (or Cover Plates): Faceplates shall be of a standard type, stainless steel, anodized aluminum or UL approved cyclac plastic construction and provided by the Contractor for each identified system outlet location. Connectors and jacks appearing on the faceplate shall be clearly and permanently marked.
- F. Connectors: Circuits, transmission lines, and signal extensions shall have continuity, correct connection and polarity. A uniform polarity shall be maintained between all points in the system.
1. Wires:
 - a. Wire ends shall be neatly formed and where insulation has been cut, heat shrink tubing shall be employed to secure the insulation on each wire. Tape of any type is not acceptable.
 - b. Audio spade lugs shall be installed on each wire (including spare or unused) end and connect to screw terminals of appropriate size barrier strips. AC barrier strips shall be provided with a protective cover to prevent accidental contact with wires carrying live AC current. Punch blocks are approved for signal, not AC wires. Wire Nut or "Scotch Lock" connectors are not acceptable for signal wire installation.
 2. Cables: Each connector shall be designed for the specific size cable being used and installed with the OEM's approved installation tool. Typical system cable connectors include; but, are not limited to: Audio spade lug, punch block, wirewrap, etc.
 3. Line or Microphone Audio: Each connector shall be installed according to the cable or connector OEM's instructions and use the OEM's approved installation tool. Install the connector's to provide and maintain the following audio signal polarity:
 - a. XLR type connectors Signal or positive conductor is pin 3; common or neutral conductor is pin 2; ground conductor is pin 1.
 - b. Two and 3 conductor 1/4 inch Signal or positive conductor is tip; neutral or 1/8 inch phono plugs conductor is ring and ground or shield and jacks conductor is sleeve.

- c. RCA Phono Plugs the Signal or positive conductor is tip; and Jacks neutral or shield conductor is sleeve.

4. Speaker Line Audio:

- a. Each connector shall be installed according to the cable, transformer or speaker OEM instructions and using the OEM's approved installation tool. The Contractor shall ensure each speaker is properly phased and connected in the same manner throughout the System using two conductor type wires.
- b. One of the conductors shall be color coded to aid in establishing speaker signal polarity. Each speaker line shall be permanently soldered or audio spade lug connected to each appropriate speaker or line matching transformer connection terminal. Speaker line connection to each audio amplifier shall use audio spade lugs, as described herein.

G. AC Power: AC power wiring shall be run separately from signal cable.

H. Grounding:

- 1. General: The Contractor shall ground all Contractor Installed Equipment and identified Government Furnished Equipment to eliminate all shock hazards and to minimize, to the maximum extent possible, all ground loops, common mode returns, noise pickup, crosstalk, etc. The total ground resistance shall be 0.1 Ohm or less.
 - a. The Contractor shall install lightning arrestors and grounding in accordance with the NFPA and this specification.
 - b. Gas protection devices shall be provided on all circuits and cable pairs serving building distribution frames located in buildings other than the building in which it is located or in any area served by an unprotected distribution system (manhole, aerial, etc.). The Contractor shall install the gas protection devices at the nearest point of entrance in buildings where protection is required and on the same circuits on the MDF in the telephone switch room.
 - c. Under no conditions shall the AC neutral, either in a power panel or in a receptacle outlet, be used for system control, subcarrier or audio reference ground.
 - d. The use of conduit, signal duct or cable trays as system or electrical ground is not acceptable and will not be permitted. These items may be used only for the dissipation of internally generated static charges (not to be confused with externally

generated lightning) that may applied or generated outside the mechanical and/or physical confines of the System to earth ground. The discovery of improper system grounding shall be grounds to declare the System unacceptable and the termination of all system acceptance testing.

2. Cabinet Buss: A common ground buss of at least #10 AWG solid copper wire shall extend throughout each equipment cabinet and be connected to the system ground. Provide a separate isolated ground connection from each equipment cabinet ground buss to the system ground. Do not tie equipment ground busses together.
 3. Equipment: Equipment shall be bonded to the cabinet bus with copper braid equivalent to at least #12 AWG. Self grounding equipment enclosures, racks or cabinets, that provide OEM certified functional ground connections through physical contact with installed equipment, are acceptable alternates.
 4. Cable Shields: Cable shields shall be bonded to the cabinet ground buss with #12 AWG minimum stranded copper wire at only one end of the cable run. Cable shields shall be insulated from each other, faceplates, equipment racks, consoles, enclosures or cabinets; except, at the system common ground point. Coaxial and audio cables, shall have one ground connection at the source; in all cases, cable shield ground connections shall be kept to a minimum.
- I. Labeling: Provide labeling in accordance with ANSI/EIA/TIA-606-A. All lettering for voice and data circuits shall be stenciled using laser printers. Handwritten labels are not acceptable.
1. Cable and Wires (Hereinafter referred to as "Cable"): Cables shall be labeled at both ends in accordance with ANSI/EIA/TIA-606-A. Labels shall be permanent in contrasting colors. Cables shall be identified according to the System "Record Wiring Diagrams".
 2. Equipment: System equipment shall be permanently labeled with contrasting plastic laminate or bakelite material. System equipment shall be labeled on the face of the unit corresponding to its source.
 3. Conduit, Cable Duct, and/or Cable Tray: The Contractor shall label all conduit, duct and tray, including utilized GFE, with permanent marking devices or spray painted stenciling a minimum of 3 meters (10 ft.) identifying it as the System. In addition, each enclosure shall be labeled according to this standard.

4. Termination Hardware: The Contractor shall label workstation outlets and patch panel connections using color coded labels with identifiers in accordance with ANSI/EIA/TIA-606-A and the "Record Wiring Diagrams".

3.2 TESTS

A. Interim Inspection:

1. This inspection shall verify that the equipment provided adheres to the installation requirements of this document. The interim inspection will be conducted by a factory-certified representative and witnessed by a Government Representative. Each item of installed equipment shall be checked to insure appropriate UL certification markings. This inspection shall verify cabling terminations in telecommunications rooms and at workstations adhere to color code for T568B or T568A pin assignments and cabling connections are in compliance with ANSI/EIA/TIA standards. Visually confirm Category 6 marking of outlets, faceplates, outlet/connectors and patch cords.
2. Perform fiber optical field inspection tests via attenuation measurements on factory reels and provide results along with manufacturer certification for factory reel tests. Remove failed cable reels from project site upon attenuation test failure.
3. The Contractor shall notify the RE, in writing, of the estimated date the Contractor expects to be ready for the interim inspection, at least 20 working days before the requested inspection date.
4. Results of the interim inspection shall be provided to the COTR and PM. If major or multiple deficiencies are discovered, a second interim inspection may be required before permitting the Contractor to continue with the system installation.
6. The COTR and/or the PM shall determine if an additional inspection is required, or if the Contractor will be allowed to proceed with the installation. In either case, re-inspection of the deficiencies noted during the interim inspection(s), will be part of the proof of performance test. The interim inspection shall not affect the Systems' completion date. The Contracting Officer shall ensure all test documents will become a part of the Systems record documentation.

B. Pretesting:

1. Upon completing the installation of the System, the Contractor shall align and balance the system. The Contractor shall pretest the entire system.
2. Pretesting Procedure:
 - a. During the system pretest, the Contractor shall verify (utilizing the approved spectrum analyzer and test equipment) that the System is fully operational and meets all the system performance requirements of this standard.
 - b. The Contractor shall pretest and verify that all System functions and specification requirements are met and operational, no unwanted aural effects, such as signal distortion, noise pulses, glitches, audio hum, poling noise, etc. are present. The Contractor shall measure and record the aural carrier levels of each system telephone and data channel, at each of the following points in the system:
 - 1) Local Telephone Company Interfaces or Inputs.
 - 2) EPBX interfaces or inputs and outputs.
 - 3) MDF interfaces or inputs and outputs.
 - 4) EPBX output S/NR for each telephone and data channel.
 - 5) Signal Level at each interface point to the distribution system, the last outlet on each trunk line plus all outlets installed as part of this contract.
3. The Contractor shall provide four (4) copies of the recorded system pretest measurements and the written certification that the System is ready for the formal acceptance test shall be submitted to the RE.
- C. Acceptance Test: After the System has been pretested and the Contractor has submitted the pretest results and certification to the RE, then the Contractor shall schedule an acceptance test date and give the COTR 30 calendar days written notice prior to the date the acceptance test is expected to begin. The System shall be tested in the presence of a Government Representative and an OEM certified representative. The System shall be tested utilizing the approved test equipment to certify proof of performance and Life Safety compliance. The test shall verify that the total System meets the requirements of this specification. The notification of the acceptance test shall include the expected length (in time) of the test.
- D. Verification Tests:

1. Test the UTP or STP backbone copper cabling for DC loop resistance, shorts, opens, intermittent faults, and polarity between conductors, and between conductors and shield, if cable has an overall shield. Test the operation of shorting bars in connection blocks. Test cables after termination and prior to cross-connection.
 2. Multimode Fiber Optic Cable: Perform end-to-end attenuation tests in accordance with ANSI/EIA/TIA-568-B.3 and ANSI/EIA/TIA-526-14A using Method A, Optical Power Meter and Light Source. Perform verification acceptance test.
 3. Single mode Fiber Optic Cable: Perform end-to-end attenuation tests in accordance with ANSI/EIA/TIA-568-B.3 and ANSI/EIA/TIA-526-7 using Method A, Optical Power Meter and Light Source. Perform verification acceptance test.
- E. Performance Testing:
1. Perform Category 6 tests in accordance with ANSI/EIA/TIA-568-B.1 and ANSI/EIA/TIA-568-B.2. Test shall include the following: wire map, length, insertion loss, return loss, NEXT, PSNEXT, ELFEXT, PSELFEXT, propagation delay and delay skew.
 2. Fiber Optic Links: Perform end-to-end fiber optic cable link tests in accordance with ANSI/EIA/TIA-568-B.3.
- F. Total System Acceptance Test: The Contractor shall perform verification tests for UTP or STP copper cabling system(s) and the multimode and single mode fiber optic cabling system(s) after the complete telecommunication distribution system and workstation outlet are installed.
1. Voice Testing: Connect to the network interface device at the demarcation point. Go off-hook and receive dial tone from the LEC. If a test number is available, place and receive a local, long distance, and FTS telephone call.
 2. Data Testing: Connect to the network interface device at the demarcation point. Log onto the network to ensure proper connection to the network is achieved.

3.3 TRAINING

- A. Furnish the services of a factory-trained engineer or technician for a total of two four hour classes to instruct designated Facility IRM personnel. Instruction shall include cross connection, corrective, and preventive maintenance of the System and equipment.

- B. Before the System can be accepted by the VA, this training must be accomplished. Training will be scheduled at the convenience of the Facilities Contracting Officer and Chief of Engineering Service.

3.4 GUARANTEE PERIOD OF SERVICE

A. Contractor's Responsibilities:

1. The Contractor shall guarantee that all installed material and equipment will be free from defects, workmanship, and will remain so for a period of one year from date of final acceptance of the System by the VA. The Contractor shall provide OEM's equipment warranty documents, to the COTR (or Facility Contracting Officer if the Facility has taken possession of the building, that certifies each item of equipment installed conforms to OEM published specifications.
2. The Contractor's maintenance personnel shall have the ability to contact the Contractor and OEM for emergency maintenance and logistic assistance, remote diagnostic testing, and assistance in resolving technical problems at any time. The Contractor and OEM shall provide this contact capability at no additional cost to the VA.
3. All Contractor installation, maintenance, and supervisor personnel shall be fully qualified by the OEM and must provide two (2) copies of current and qualified OEM training certificates and OEM certification upon request.
4. Additionally, the Contractor shall accomplish the following minimum requirements during the one year guarantee period:
 - a. Response Time:
 - 1) The COTR (or facility Contracting Officer if the facility has taken possession of the building) are the Contractor's reporting and contact officials for the System trouble calls, during the guarantee period.
 - 2) A standard workweek is considered 8:00 A.M. EST to 5:00 P.M. EST, Monday through Friday exclusive of Federal Holidays.
 - 3) The Contractor shall respond and correct on-site trouble calls, during the standard work week to:
 - a) A routine trouble call within one working days of its report. A routine trouble is considered a trouble which causes a system outlet, station, or patch cord to be inoperable.

- b) An emergency trouble call within 6 hours of its report. An emergency trouble is considered a trouble which causes a subsystem or distribution point to be inoperable at anytime. Additionally, the loss of a minimum of 50 station or system lines shall be deemed as this type of a trouble call.
- 4) The Contractor shall respond on-site to a catastrophic trouble call within 4 hours of its report. A catastrophic trouble call is considered total system failure.
 - a) If a system failure cannot be corrected within four hours (exclusive of the standard work time limits), the Contractor shall be responsible for providing alternate system CSS or TCO equipment, or cables. The alternate equipment and/or cables shall be operational within four hours after the four hour trouble shooting time.
 - b) Routine or emergency trouble calls in critical emergency health care facilities (i.e., cardiac arrest, intensive care units, etc.) shall also be deemed as a catastrophic trouble call if so determined by the COTR or Facility Director. The COTR or Facility Contracting Officer shall notify the Contractor of this type of trouble call at the direction of the Facilities Director.
- b. Required on-site visits during the one year guarantee period
 - 1) The Contractor shall visit, on-site, for a minimum of eight hours, once every 12 weeks, during the guarantee period, to perform system preventive maintenance, equipment cleaning, and operational adjustments to maintain the System according the descriptions identified in this SPEC.
 - a) The Contractor shall arrange all Facility visits with the COTR or Facility Contracting Officer prior to performing the required maintenance visits.
 - b) The Contractor in accordance with the OEM's recommended practice and service intervals shall perform preventive maintenance during a non-busy time agreed to by the COTR or Facility Contracting Officer and the Contractor.
 - c) The preventive maintenance schedule, functions and reports shall be provided to and approved by the COTR or Facility Contracting Officer.

- 2) The Contractor shall provide the COTR or Facility Contracting Officer a type written report itemizing each deficiency found and the corrective action performed during each required visit or official reported trouble call. The Contractor shall provide the COTR with sample copies of these reports for review and approval at the beginning of the Total System Acceptance Test. The following reports are the minimum required:
 - a) Monthly Report: The Contractor shall provide a monthly summary all equipment and sub-systems serviced during this guarantee period to COTR or Facilities Contracting Officer by the fifth working day after the end of each month. The report shall clearly and concisely describe the services rendered, parts replaced and repairs performed. The report shall prescribe anticipated future needs of the equipment and Systems for preventive and predictive maintenance
 - b) Contractor Log: The Contractor shall maintain a separate log entry for each item of equipment and each sub-system of the System. The log shall list dates and times of all scheduled, routine, and emergency calls. Each emergency call shall be described with details of the nature and causes of emergency steps taken to rectify the situation and specific recommendations to avoid such conditions in the future.
 - 3) The COTR or Facility Contracting Officer shall provide the Facility Engineering Officer, two (2) copies of actual reports for evaluation.
 - a) The COTR or Facility Contracting Officer shall ensure copies of these reports are entered into the System's official acquisition documents.
 - b) The Facilities Chief Engineer shall ensure copies of these reports are entered into the System's official technical as-installed documents.
- C. Work Not Included: Maintenance and repair service shall not include the performance of any work due to improper use, accidents, other vendor, contractor, owner tampering or negligence, for which the Contractor is not directly responsible and does not control. The Contractor shall immediately notify the COTR or Facility Contracting Officer in writing

upon the discovery of these incidents. The COTR or Facility Contracting Officer will investigate all reported incidents and render findings concerning any Contractor's responsibility.

- - - E N D - - -

SECTION 27 31 00
VOICE COMMUNICATIONS SWITCHING AND ROUTING EQUIPMENT

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This section specifies the furnishing, installing, certification, testing, and guaranty of a complete and operating Telephone Electronic Private Branch Exchange (EPBX) equipment and interconnecting cable (not cable distribution plant) system (here-in-after referred to as "the System"), and associated equipment to be installed in the VA Medical Center - Adult Daycare here-in-after referred to as "the Facility". The System shall include, but not be limited to, telephone processing switch, equipment cabinets, interface enclosures, and relay racks, stand-by battery(s), necessary combiners, traps, and filters; interconnection nodes and/or amplifiers; telephone instruments; auxiliary systems; and necessary passive devices such as: protectors, isolators, splitters, couplers, cable "patch", "punch down", and cross-connector blocks or devices, cable management items, voice and digital cable distribution system, and associated hardware. The System shall additionally include, but not be limited to: telecommunication closets (TC); telecommunication outlets (TCO) copper and fiber-optic interconnecting cables, connectors, "patch" cables, and/or "break out" devices.
- B. The System shall be delivered free of engineering, manufacturing, installation, and operating defects. It shall be designed, engineered and installed for ease of operation, maintenance, and testing.
- C. The term "provide", as used herein, shall be defined as: designed, engineered, furnished, installed, certified, and tested, by the Contractor.
- D. The Telephone System is defined as an Emergency Critical Care Communication System by the National Fire Protection Association (NFPA). Therefore, its installation and operation shall adhere to all appropriate National, Government, and/or Local Life Safety and/or Support Codes, which ever are the more stringent for this Facility. At a minimum, the System shall be installed according to NFPA, Section 70, National Electrical Code (NEC), Article 517 and Chapter 7; NFPA, Section 99, Health Care Facilities, Chapter 3-4; NFPA, Section 101, Life Safety Code, Chapters 7, 12, and/or 13; Joint Commission on

Accreditation of Health Care Organization (JCAHCO), Manual for Health Care Facilities, all necessary Life Safety and/or Support guidelines; this specification; and the original equipment manufacturer's (OEM) suggested installation design, recommendations, and instructions. The OEM and Contractor shall ensure that all management, sales, engineering, and installation personnel have read and understand the requirements of this specification before the System is designed, engineered, delivered, and provided.

- E. The VA Project Manager (PM) and/or if delegated, Contracting Officer's Technical Representative (COTR) are the approving authorities for all contractual and mechanical changes to the System. The Contractor is cautioned to obtain in writing, all approvals for system changes relating to the published contract specifications and drawings, from the PM and/or COTR before proceeding with the change.

1.2 RELATED WORK

- A. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Section 27 05 11, REQUIREMENTS FOR COMMUNICATIONS INSTALLATIONS.
- C. Section 27 05 33, RACEWAYS AND BOXES FOR COMMUNICATIONS SYSTEMS.
- D. Section 27 10 00, STRUCTURED CABLING.
- E. Section 26 27 26, WIRING DEVICES.
- F. Section 27 05 26, GROUNDING AND BONDING FOR COMMUNICATIONS SYSTEMS.
- G. Section 26 41 00, FACILITY LIGHTNING PROTECTION .
- H. Section 27 15 00, COMMUNICATIONS HORIZONTAL CABLING.

1.3 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in text by basic designation only. Except for a specific date given, the issue in effect (including amendments, addenda, revisions, supplements, and errata) on the date the system's submittal is technically approved by VA, shall be enforced.
- B. Joint Commission on Accreditation of Health Care Organization (JCAHO) Comprehensive Accreditation Manual for Hospitals
- C. National and/or Government Life Safety Code(s): The more stringent of each listed code.
- D. National Fire Protection Association (NFPA):

70	National Electrical Code (NEC)
----	--------------------------------

75	Protection of Electronic Computer/Data Processing Systems
77	Recommended Practice on Static Electricity
99	Standard for Health Care Facilities
101	Life Safety Code
1221	Emergency Services Communication Systems

E. Underwriter's Laboratories, Inc. (UL):

65	Wired Cabinets
96	Lightning Protection Components
96A	Installation Requirements for Lightning Protection Systems
467	Grounding and Bonding Equipment
497/497A /497B	Protectors for Paired Conductors/Communications Circuits/Data Communication and Fire Alarm Circuits
884	Underfloor Raceways and Fittings

F. American National Standards Institute/Electronic Industries
/Telecommunications Publications (ANSI/EIA/TIA):

568B	Commercial Building Telecommunications Wiring Standard
569B	Commercial Building Standard for Telecommunications Pathways and Spaces
598C	Optical Fiber Cable Color Coding
606A	Administration Standard for the Telecommunications Infrastructure of Commercial Buildings
607A	Grounding and Bonding Requirements for Telecommunications in Commercial Buildings
758	Customer-Owned Outside Plant Telecommunications

	Infrastructure Standard
--	-------------------------

- G. Lucent Technologies: Document 900-200-318 "Outside Plant Engineering Handbook."
- H. International Telecommunication Union - Telecommunication (Standardization Sector (ITU-T).
- I. Federal Information Processing Standards (FIPS) Publications.
- J. Federal Communications Commission (FCC) Publications: Standards for telephone equipment and systems.
- K. United States Air Force: Technical Order 33K-1-100 Test Measurement and Diagnostic Equipment (TMDE) Interval Reference Guide.

1.4 QUALITY ASSURANCE

- A. The authorized representative of the System's OEM shall be responsible for the design, satisfactory total operation of the system, and its certification.
- B. The OEM shall meet the minimum requirements identified in Paragraph 2.1.A. Additionally, the Contractor shall have had experience with three or more installations of systems of comparable size and complexity with regard to coordinating, engineering, testing, certifying, supervising, training, and documentation. Each of these installations shall have been in successful operation for a minimum of three years after final acceptance by the user. These installations shall be provided as a part of the submittal identified in Paragraph 1.5.
- C. The System Contractor shall submit certified documentation that they have been an authorized distributor and service organization for the OEM for a minimum of three (3) years. The System Contractor shall be authorized by the OEM to certify and warranty the installed equipment. In addition, the OEM and System Contractor shall accept complete responsibility for the design installation, certification, and physical support for the system. This documentation, along with the System Contractor and OEM certifications must be provided in writing as a part of the Contractor's Technical submittal.
- D. The Contractor's Telecommunications Technicians assigned to the system shall be fully trained, qualified, and certified by the OEM on the engineering, installation, and testing of the System. The Contractor shall provide formal written evidence of current OEM certification(s)

for the installer(s) as a part of the submittal or to the COTR before being allowed to commence work on the System.

1.5 SUBMITTALS

- A. Provide submittals in accordance with Specification Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES. The COTR shall retain one copy for review and approval.
 - 1. If the submittal is approved the COTR shall retain one copy for Official Records and return three (3) copies to the Contractor.
 - 2. If the submittal is disapproved, three copies will be returned to the Contractor with a written explanation attached indicating the areas where the submittal deviated from the System Specifications. The COTR shall retain one copy for Official Records.
- B. Documents: The submittal shall be separated into sections for each subsystem and shall contain the following:
 - 1. Title page to include:
 - a. VA Medical Center
 - b. Contractor's name, address, and telephone (including FAX) numbers
 - c. Date of Submittal
 - d. VA Project No.
 - 2. List containing a minimum of three locations of installations of similar size and complexity as identified herein. These locations shall contain the following:
 - a. Installation Location and Name: Owner's or User's name, address, and telephone (including FAX) numbers.
 - b. Date of Project Start and Date of Final Acceptance by Owner.
 - c. System Project Number.
 - d. Brief (three paragraphs minimum) description of each system's function, operation, and installation.
 - 3. Narrative Description of the system as it is expected to be installed.
 - 4. A list of the equipment to be furnished. The quantity, make and model number of each item is required.

The following is the minimum equipment required by the System:

QUANTITY	UNIT
1 ea.	EPBX
1 ea.	Back-up Battery Power Supply
As required	AC Power Supply
As required	TMS
As required	Attendant Console
1 ea.	Lightning Protection System
As required	Equipment Cabinets
As Required	Environmental Cabinet
As required	Audio Monitor Panel
As required	Trouble Annunciator Panel
As required	Interface/Distribution Cabinet
As required	Microphone Page Console
As required	Stand Alone Relay Rack
As required	CCS
As require	Wire Management System/Equipment
Reference Only	Telephone Instruments
Reference Only	Distribution System
1 ea.	Installation Kit
As required	Separate List Containing Each Equipment Spare(s)
As required	System Conduits, Cable Duct, and/or Cable Tray
As required	Telephone Paging Adapter (one each required for PA, Radio, and Dial Dictation sub-systems)
As required	Time Out Device (one each required for PA, Radio, and Dial Dictation sub-systems)

5. EPBX cabinet and each interface cabinet layout drawing, as each is to be installed.
 6. Equipment technical literature detailing the electrical and technical characteristics of each item of equipment to be furnished.
 7. Engineering drawings of the System, showing calculated signal levels at the EPBX output, each input and output distribution point, proposed telephone outlet values, and signal level at each telephone outlet multipin jack.
 8. List of test equipment as per paragraph 1.5.D below.
 9. Letter certifying that the Contractor understands the requirements of the Samples Paragraph 1.5.E.
 10. Letter certifying that the Contractor understands the requirements of Section 3.2 concerning tests.
- C. Environmental Requirements. Technical submittals shall confirm the environmental specifications for physical TC areas occupied by the System. These environmental specifications shall identify the requirements for initial and expanded System configurations for:
1. Floor loading for batteries and cabinets.
 2. Minimum floor space and ceiling heights.
 3. Minimum size of doors for equipment passage.
 4. Power requirements: The Contractor shall provide the specific voltage, amperage, phases, and quantities of circuits required.
 5. Air conditioning, heating, and humidity requirements. The Contractor shall identify the ambient temperature and relative humidity operating ranges required to prevent equipment damage.
 6. Air conditioning requirements (expressed in BTU per hour, based on adequate dissipation of generated heat to maintain required room and equipment standards).
 7. Proposed floor plan, based on the expanded system configuration of the bidder's proposed EPBX for this Facility.
 8. Conduit size requirement (between main TC, computer, and console rooms).
- D. Test Equipment List
1. The Contractor is responsible for furnishing all test equipment required to test the System in accordance with the parameters specified. Unless otherwise stated, the test equipment shall not be

considered part of the System. The Contractor shall furnish test equipment of an accuracy better than the parameters to be tested.

2. The test equipment furnished by the Contractor shall have a calibration tag of an acceptable calibration service dated not more than 12 months prior to the test. As part of the submittal, a test equipment list shall be furnished that includes the make and model number of the following type of equipment as a minimum:
 - a. Spectrum Analyzer
 - b. Signal Level Meter
 - c. Volt-Ohm Meter
 - d. Time Domain Reflectometer (TDR) with strip chart recorder
 - e. Bit Error Test Set (BERT)
 - f. Camera with a minimum of 60 pictures to that will develop immediately to include appropriate test equipment adapters. A video camera in VHS format is an acceptable alternate.
- E. Samples: A sample of each of the following items shall be furnished to the COTR for approval prior to installation. The samples may be returned to the Contractor at the discretion of the RE:
1. TCO Wall Outlet Box 100 mm x 100 mm x 63 mm (4 inch x 4 inch x 2.5 inches) with:
 - a. One each telephone (or voice) RJ45 jack installed.
 - b. Two each multi pin data RJ45 jacks installed.
 - c. Cover Plate installed.
 - d. Fiber optic ST jack(s) installed.
 - e. RF (F)/video (BNC)/audio (XL) jack(s) installed.
 2. Data CCS patch panel, punch block or connection device with RJ45 connectors installed.
 3. Telephone CCS system with IDC and/or RJ45 connectors, cable terminal, and cable management equipment installed.
 4. 610 mm (2 foot) section of each copper cable to be used with connectors installed and OEM cable sweep compliance and/or certification tags as specified in Section 27 15 00, COMMUNICATIONS HORIZONTAL CABLING, paragraph 2.4.B.
 5. 610 mm (2 foot) section of each fiber optic cable to be used with connectors installed and OEM cable sweep compliance and/or certification tags as specified in Section 27 15 00, COMMUNICATIONS HORIZONTAL CABLING, paragraph 2.4.B.

6. Fiber optic CCS patch panel or breakout box with cable management equipment and "ST" connectors installed.

7. UPS equipment (if required by system design).

F. Certifications:

1. Submit written certification from the OEM indicating that the proposed supervisor of the installation and the proposed provider of the contract maintenance are authorized representatives of the OEM. Include the individual's exact name and address and OEM credentials in the certification.
2. Submit written certification from the OEM that the wiring and connection diagrams meet National and/or Local (whichever is the more stringent) Life Safety Guidelines, NFPA, NEC, UL, this specification, and JCAHCO requirements and instructions, requirements, recommendations, and guidance set forth by the OEM for the proper performance of the System as described herein. The VA will not approve any submittal without this certification.
3. Preacceptance Certification: This certification shall be made in accordance with the test procedure paragraph 3.2.B.

G. Equipment Manuals: Ten (10) working days prior to the scheduled acceptance test, the Contractor shall deliver four (4) complete sets of commercial operation and maintenance manuals for each item of equipment furnished as part of the System to the COTR. The manuals shall detail the theory of operation and shall include narrative descriptions, pictorial illustrations, block and schematic diagrams, and parts list.

H. Record Wiring Diagrams:

1. Fifteen (15) working days prior to the scheduled acceptance test, the Contractor shall deliver four complete sets of the record wiring diagrams of the System to the COTR. The diagrams shall show all inputs and outputs of electronic and passive equipment correctly identified according to the markers installed on the interconnecting cables, equipment and room/area locations. The wiring diagrams shall show the signal levels of the aural carriers of each audio channel at the input and output of all electronic equipment, at the beginning and end of each distribution line, and at the speakers. The record wiring diagrams shall be provided in hard copy and two compact disk copies properly formatted to match the Facility's current operating version of Computer aided drafting (AUTO CAD)

system. The COTR shall verify and inform the Contractor of the current version of AutoCAD being used by the Facility.

2. Ten (10) days prior to the start of the intermediate test, provide a typewritten detailed description of the System testing plan that meets this specification's performance standards as indicated in paragraph 2.1.B including illustrations and utilizes the test equipment specified in paragraph 1.5.D. The test plan will need to be evaluated and approved by the COTR before intermediate testing begins.
- I. Provide two copies of an OEM developed training videotape presentation (reference paragraph 3.3.B) for evaluation and approval by the COTR.
- J. Provide a typewritten document that details the complete record program in memory for all associated station assignments.
- K. Needs Analysis (required for replacement of existing systems): The Contractor shall conduct a needs analysis of the existing Facility with representative's from the IRM and various departments to determine the System's requirements. The analysis shall depict System features and capacities, in addition to specific site requirements. The analysis shall be typewritten and contain the following information as a minimum:
 1. The EPBX shall initially provide:

ITEM WIRED	EQUIPPED CAPACITY	WIRED CAPACITY
Main Station Lines:		
Single Line		
Multi Line (Equipped for DID)		
Central Office Trunks:		
Two Way		
DID		
Two-way DRTL		
Foreign Exchange (FX)		
Conference		
Audio Paging Access		
Off-Premise Extensions		
CO Trunk By-Pass		
CRT w/keyboard(s)		
Printer(s)		

Operator Console(s)		
T-1 Access/Equipment		
Maintenance Terminal		

2. Projected Maximum Growth: The Contractor shall identify the projected maximum growth for each item identified in Paragraph 1.5.B.4. as a part of the needs analysis. For this purpose, the following definitions are provided to detail the System's capability:
 - a) All software and hardware required to completely equip the EPBX with all items listed under equipped capacity, shall be provided and installed by the contractor 30 calendar days prior to system cut-over.
 - b) Wired Capacity" is to include all wiring and equipment listed under wired capacity, with the exception of line, data, and trunk cards, and shall be provided, installed, and tested 30 calendar days prior to system cutover.
 - c) The EPBX shall be capable of expansion to the projected maximum growth through the use of printed circuit boards and/or modular cabinets that do not require extensive re-wiring and reprogramming.
3. Cable Distribution System: See Specification Section 27 15 00, COMMUNICATIONS HORIZONTAL CABLING, for specific cable distribution system requirements. The Contractor is required to formulate a projected cable and TCO count that coincides with the Projected Maximum Growth described herein.
4. Telephone Instruments (Stations): Telephone instruments are an integral component of the System. The Contractor shall indicate each instrument location, type of instrument and class of service as determined by the needs analysis.

PART 2 - PRODUCTS

2.1 EQUIPMENT AND MATERIALS

A. SYSTEM REQUIREMENTS:

1. The System shall perform the following minimum services that are designed in accordance with and supported by an Original Equipment Manufacturer (OEM), and as specified herein. The System shall provide continuous inter and/or intra-Facility voice service. The System shall be capacity sized so that loss of connectivity to an

external telephone system(s) shall not affect the Facility's operation in specific designated emergency operating locations and instruments. The System shall:

- a. Inter-operate, connect, and function fully with the existing Local (Telephone) Exchange Company (LEC) Network(s), Federal Telephone System (FTS) Inter-city Network(s), Inter-exchange Carriers, and Integrated Services Digital Network (ISDN), at a minimum.
- b. Contain control and switching equipment that shall be a voice and digital EPBX with attendant console(s). Contain voice mail and automatic attendant functions and continuous intra and/or inter Facility voice service. Additionally, a universal night answering function from Facility designated remote locations shall be provided.
- c. Direct access to trunk level equipment including audio paging, Industry Standard "T" and/or "DS" carrier protocols, and external protocol converters. Additionally, connections to "T" and/or "DS" access/equipment or Customer Service Units (CSU) that are used in FTS and other trunk applications shall be included in the System design. The Contractor shall provide all T-1 equipment necessary to terminate and make operational the quantity of circuits designated. The CSUs shall be connected to the System's emergency battery power supply. The System shall be fully capable of operating in the Industry Standard "DS" protocol and provide that level of service when required.
- d. Contain attendant and operator consoles, video monitors with keyboards, and printers to provide employee directory access from the Traffic Management System (TMS). All console positions, video monitors, and keyboards shall have identical capabilities. The System shall accept a mixture of trunk types at the attendant console and extend calls received via these trunks to station users.
- e. Be capable of interfacing and operating with Direct-Incoming-Dial (DID) service to stations as identified herein. Assignment to DID shall not affect intra-Facility operation. A DID trunk group, which will operate as a separate trunk group from other Central Office (CO) trunks shall be provided as described herein.

- f. Contain the designated number of telephone instruments, where each instrument (also referred to as "station") shall have the ability to direct dial other Facility telephone stations, the public telephone network, tie-lines, and FTS telephone numbers without attendant assistance. Each station shall be dual tone multi-frequency (DTMF) for intra-Facility and external-Facility calling. The term DTMF, as used herein, shall be defined as "a dialing operation (e.g., push-button, digit dialing, or tone dialing, other than rotary/pulse dialing).
 - 1) Standard digital telephone instruments shall be provided to the designated TCOs and as shown on the drawings.
 - 2) "Special hands free" digital telephone instruments shall be provided at designated TCOs and as shown on the drawings.
- g. Receive the specified telephone signals acquired from the LEC and FTS contracted carrier, shall process and distribute them to the designated telephone stations, as determined by Class Of Service and indicated on the drawings.
- h. At a minimum, one TCO(s) shall be provided on each telephone switch room, computer room, or TC wall and on either side of each door opening, and shall be supplied with an associated (within 305 mm (one foot)) active duplex 120 Volts Alternating Current (VAC) outlet (using a quad receptacle box for the TCO and a separate duplex receptacle box for the AC outlet) and as shown on the drawings.
 - 1) The telephone multipin jack shall be interfaced and connected to the system via 110 or equivalent type punch blocks the switch room, computer room, and TC. All connections shall support Category 6 level of service requirements.
 - 2) The construction of distribution TCOs is found in Specification Section 27 15 00, COMMUNICATIONS HORIZONTAL CABLING.
 - 3) The appropriate distribution cable termination method is found in Specification Section 27 15 00, COMMUNICATIONS HORIZONTAL CABLING.
 - 4) The appropriate distribution TC construction is found in Specification Section 27 15 00, COMMUNICATIONS HORIZONTAL CABLING.

- i. Perform adjacent channel operation of a minimum of local, long distance, and FTS telephone signals. The System equipment shall be installed and interfaced according to the OEM's schematic diagram for adjacent telephone channel operation. The System shall be provided with testing capability in each equipment rack and have test ports that provide access for each telephone channel without the need to disconnect distribution cables or equipment. Each telephone channel shall be processed as a single channel. A means of monitoring the complete system along with appropriate printout and computer disk archiving of each processed and distributed channel.
2. The System shall be designed to minimize cross talk, background processor noise, inter-modulation, and other signal interference. The EPBX equipment shall be installed and interfaced according to the OEM head-end schematic diagram for adjacent audio channel operation. Each audio input channel shall be processed as a single separate channel and combined into one output channel. Additionally, an audio and visual monitoring panel shall be provided in the telephone switch room to test each converted audio input and distribution channel, and analog RF channels transmitted and received signal functions as described herein. The System shall continuously electronically or electrically supervise the EPBX's Alternating Current (AC) power input, stand by batteries and charger, and internal Direct Current (DC) power supply primary Voltages and/or Currents; each remote control unit, audio, and analog RF interface unit, from the telephone switch room. A trouble panel shall be provided in the telephone switch room and at the telephone operator room, Security Service Control Console, MAS Emergency Room to check the supervisory signals, signal level, audio sound and visual level, and alert personnel to problems as described herein.
3. Refer to Section 1.3 for initial voice sizing requirements. Also refer to Section 1.3 for initial data sizing requirements.
4. At a minimum, the EPBX shall be equipped with:
5. Point Of Local (Telephone) Exchange Company Interface: The Contractor is not responsible for the condition of the telephone signals of the LEC system. If the telephone signals at the LEC interface point do not meet the minimum signal level and quality as

stated herein, the Contractor shall notify the RE, in writing, detailing the nature of the deficiencies, and the expected effect on the telephone signals in the new system. The COTR will coordinate with the Facility Engineering Officer so the necessary repairs for the identified deficiencies can be accomplished.

7. EPBX location selection. The EPBX cabinets and associated equipment shall be located in the basement.

B. System Performance:

1. The System shall support and fully operate in the following functional modes, at a minimum:
 - a. Bit Rate Interchange (BRI) Functions.
 - b. ISDN in both Standard and Broad Bandwidths.
 - c. Fiber-optic Distributed Data Interface (FDDI).
 - d. Industry Standard "T" Carrier in single and multiple channels.
 - e. Industry Standard "DS" Carrier in single and multiple channels.
2. System Sensitivity: Satisfactory service shall be provided for at least 3,000 feet (ft) for all voice locations.
3. At a minimum, the System shall meet the following operating parameters:
 - a. EPBX:
 - 1) System speed: 1.0 giga-Bits (gb) per second, minimum
 - 2) Impedance: 600 Ohms, BA1
 - 3) Cross Modulation: -60 deci-Bel (dB)
 - 4) Hum Modulation: -55 dB
 - 5) System data error: 10 to the -10 Bits per second (Bps), minimum
 - 6) Loss: Measured at the frame output with reference Zero (0) deci-Bel measured (dBm) at 1,000 Hertz (Hz) applied to the frame input:
 - a) Trunk to station: 1.5 dB, maximum
 - b) Station to station: 3.0 dB, maximum
 - c) Internal switch crosstalk: -60 dB when a signal of ± 10 dBm, 500-2,500 Hz range is applied to the primary path.
 - 7) Idle channel noise: 25 dB relative noise per channel (rnC) or 3.0 dBm @ 0 above (terminated) ground noise, whichever is greater

- 8) Traffic Grade of Service for Voice: The minimum grade of service shall be P-01 with an average traffic load of 7.0 One Hundred Call Seconds (CCS) per station per hour.
- 9) Average CCS per voice station: The average CCS capacity per voice station shall be maintained at 7.0 CCS when the EPBX is expanded up to the projected maximum growth as stated herein.

b. Voice and Audio Standards:

- 1) Input and Output Signal Level: 0.0 dBm at 1 kilo Hertz (kHz) test tone modulation level. Each level shall be variable over a 6.0 dB range.
- 2) Input and Output Impedance: 600 Ohms Balanced (BAL)
- 3) Input and Output Signals: Terminated on each EPBX Unit
- 4) Frequency Range: 50 Hertz (Hz) to 3.0 kHz \pm 1.0 %, minimum
- 5) S/N Ratio: 60 deci-Bell per mili-Volt (dBmV) \pm 1.0 dBmV
- 6) Cross Modulation: -46 dB
- 7) Hum Modulation: -55 dB
- 8) Isolation (control unit to unit): 24 dB, minimum

c. Control Signal Standards:

- 1) Input and Output Signal: 0.0 dBmV \pm 1.0 dBmV Level
- 2) Input and Output Signals Terminated on each EPBX Unit
- 3) Input and Output Impedance 600 Ohms, BAL
- 4) Channel Bandwidth:
 - b) Voice: 50 Hz to 3.0 kHz, \pm 5.0%, minimum
- 5) S/N Ratio: 60 dBmV \pm 1.0 dBmV

d. Telephone Outlet (TCO):

- 1) Isolation (outlet-outlet): 24 dB
- 2) Impedance: 600 Ohms
- 3) Signal Level: 0 dBmV \pm 0.1 dBmV
- 4) System speed: 100 mega-Bits (mb) per second, minimum
- 5) System data error: 10 to the -6 Bits per second, minimum

C. General:

- 1. All equipment to be supplied under this specification shall be new and the current model of a standard product of an OEM of record. An OEM of record shall be defined as a company whose main occupation is the manufacture for sale of the items of equipment supplied and which:
 - a. Maintains a factory production line for the item submitted.
 - b. Maintains a stock of replacement parts for the item submitted.

- c. Maintains engineering drawings, specifications, and operating manuals for the items submitted.
 - d. Has published and distributed descriptive literature and equipment specifications on the items of equipment submitted at least 30 days prior to the Invitation for Bid.
2. Specifications of equipment as set forth in this document are minimum requirements, unless otherwise stated, and shall not be construed as limiting the overall quality, quantity, or performance characteristics of items furnished in the System. When the Contractor furnishes an item of equipment for which there is a specification contained herein, the item shall meet or exceed the specification for that item of equipment.
 3. Each item of equipment to be provided under this contract must bear the approved UL seal or the seal of the testing laboratory that warrants the equipment has been tested in accordance with, and conforms to the specified standards.
 4. All supplies and materials shall be listed, labeled or certified by UL or a nationally recognized testing laboratory where such standards have been established for the supplies, materials or equipment. See paragraph Minimum Requirements Section 27 05 11, REQUIREMENTS FOR COMMUNICATIONS INSTALLATIONS and the guidelines listed in paragraph 2.J.2.
 5. The Contractor shall provide written verification, to the COTR at time of installation, that the type of wire/cable being provided is recommended and approved by the OEM. Cabling shall meet the requirements of U.L., the ANSI/EIA/TIA Wiring Standards and the requirements of NFPA 70 (NEC). The Contractor is responsible for providing the correct protection, cable duct and/or conduit and wiring even though the actual installation may be by another subcontractor.
 6. The Telephone Contractor is responsible for interfacing the telephone and PA systems with the System. The Contractor shall utilize interfacing methods that are approved by the OEM and VA. At a minimum, an acceptable interfacing method, requires not only a physical and mechanical connection; but, includes matching of signal, voltage, and processing levels, with regard to signal quality and impedance. Each interface point must adhere to all

standards described herein for full separation of the Critical Care, Life Safety, and Emergency systems.

7. The telephone equipment and PA interface equipment shall be the interface points for connection of the PA interface cabling from the telephone switch via the System telephone interface unit. The telephone interface unit and PA interface unit shall be provided by the Telephone Contractor. The Telephone Contractor is not allowed to make any connections to the PA system.
8. Active electronic component equipment shall consist of solid state components, be rated for continuous duty service, and comply with the FCC standards for telephone equipment, systems, and service.
9. All passive distribution equipment shall meet or exceed -80 dB radiation shielding specifications.
10. All interconnecting twisted pair, fiber-optic cables shall be terminated on equipment terminal boards, punch blocks, breakout boxes, splice blocks, and unused equipment ports/taps shall be terminated according to the OEM's instructions for telephone cable systems without adapters. The Contractor shall not leave unused or spare twisted pair wire, fiber-optic cable unterminated, unconnected, loose or unsecured.
11. The System shall utilize microprocessor components for all signaling, programming circuits and functions. Program memory shall be non-volatile or protected from erasure during power outages for a minimum of three days.
12. The System shall provide continuous electrical supervision of all telephone switch cabinet mounted equipment, interconnecting cabling, distribution cable plant, and the UPS back up battery and charger to determine change in status and to assist in trouble shooting System faults.
13. All voltages, except for the primary power to the power supply circuits, shall not exceed 30V AC Root Mean Squared (RMS) or 42V direct current (DC).
14. Color code all distribution wiring to conform to the Telephone Industry standard, ANSI/EIA/TIA, and this document, which ever is the more stringent. At a minimum, all equipment, cable duct and/or conduit, enclosures, wiring, terminals, and cables shall be clearly and permanently labeled according to and using the provided record wiring diagrams, to facilitate installation and maintenance.

Reference Specification (Section 27 10 00, STRUCTURED CABLING) and Section 27 15 00, COMMUNICATIONS HORIZONTAL CABLING.

15. Connect the System's primary input AC power to the Facility' Critical Branch of the Emergency AC Power Distribution System as shown on the Drawings or if not shown on the Drawings consult with the COTR regarding a suitable circuit location, prior to bidding.
16. Provide a UPS complete with backup battery for the System to operate and function normally (as if there was no AC power failure) in the event of an AC power failure for a minimum of four hours.
17. All equipment shall function and operate normally from the furnished power source, and also, during input power fluctuations or loss of power for a minimum of four hours.
18. Plug-in connectors shall be provided to connect all equipment, with the exception of interface points. Base band cable systems shall utilize barrier terminal screw type connectors, at a minimum. Crimp type connectors installed with a ratchet type installation tool are an acceptable alternate as long as the cable dress, pairs, shielding, grounding, connections and labeling are provided the same as the barrier terminal strip connectors. Tape of any type, wire nuts, or solder type connections are unacceptable and will not be approved.
19. All equipment faceplates utilized in the System shall be stainless steel, anodized aluminum, or UL approved cyclac plastic that matches the equipment item where it is installed. All faceplates shall be constructed of the same material throughout the Facility.
20. Noise filters and surge protectors shall be provided for each equipment interface cabinet, switch equipment cabinet, control console, local, and remote active equipment locations to ensure protection from input primary AC power surges and noise glitches are not induced into low voltage circuits.

D. Equipment Functional Characteristics

FUNCTIONS	CHARACTERISTICS
Input Voltage	105 to 130 VAC
POWER LINE FREQUENCY	60 Hz \pm 2.0 Hz
Operating Temperature	0 to 50 degrees (°) Centigrade (C)
Humidity	80 percent (%) minimum rating

2.2 EQUIPMENT ITEMS

A. Electronic Private Branch Exchange (EPBX) Equipment

1. The EPBX shall be fully self contained, electronic, digital in operation, and provide, as a minimum, the following functions:
 - a. Intra-Facility station-to-station four digit direct dialing to include those telephone instruments equipped with the DID features.
 - b. Direct-output-dial (DOD) from any unrestricted telephone instrument to any CO trunk or FTS access lines by dialing a pre-designated access code. Also, DOD from any station to tie lines by dialing a pre-designated access code.
 - c. Incoming calls from FTS access lines and tie lines shall have the ability to direct dial all EPBX stations without attendant assistance.
 - d. Restricted telephone instruments shall have access to outside lines through the operator's console.
 - e. Unrestricted telephone instruments shall have access to all features, functions, CO trunks, FTS access lines, tie-lines, toll free 800 numbers, and long distance directory assistance.
 - f. A minimum of 40 class-of-service (COS) restrictions shall be provided. These restrictions are to be applied individually or in combination as dictated by individual telephone number service requirements. Technical submittals shall describe the number and type of COS restrictions available.
 - g. Provide all station users with the standard feature package listed below. The ability to restrict any of these features on a station by station basis shall be provided:
 - 1) Line Hunt Capability: Sequential and circular line hunting lines shall be assigned to a hunt group and need not be in a numerical sequence. The Contractor shall specify the number of hunt groups available and the capacity of each group.
 - 2) Consultation Hold: Telephone instruments or attendant console shall be able to place an incoming call on hold while making a consulting call, then return to the original call.
 - 3) Call Transfer: Telephone instrument call transfer shall permit a user to transfer an incoming or outgoing CO trunk, FTS, or tie-line call to another EPBX station without attendant assistance.

- 4) Call Pick-Up: Telephone instruments shall have the capability of answering a ringing, but unanswered call, within a pre-designated group of station lines by dialing a feature code or activating a feature button.
- 5) Call Forwarding: Call forwarding "follow me" functions, when activated by telephone instruments, shall automatically reroute incoming calls to another selected telephone number. Selected telephone instruments shall have the capability of activating and deactivating this feature at their discretion. "Busy and don't answer" functions, shall automatically reroute calls to a pre-programmed secondary telephone instrument when a given telephone instrument is busy or does not answer within a prescribed time interval.
- 6) Call Queuing: The EPBX shall allow a telephone instrument encountering a busy trunk, e.g. CO, FTS, FX, and tie-lines, to be automatically connected to the trunk when it becomes available.
- 7) Call back/Ring back: When a telephone or data instrument initiates a call to another internal busy instrument, call back/ring back is activated at the calling instrument by an access code or feature button. When both instruments become idle, the EPBX shall automatically ring the calling instrument and, when answered, rings the called instrument. Activation of this feature shall not prevent the calling instrument from originating or receiving other calls.
- 8) Music on Hold: The Contractor shall provide music on hold to all EPBX station lines, CO trunks, FTS access lines, and tie-lines when placed on hold. The acceptable music sources are compact disc player or audio cassette recorder player. The COTR will inform the Contractor of the desired type of unit. Under no circumstances shall an off air AM or FM radio be used for this music.
- 9) Conferencing: A telephone instrument initiated conference (minimum of three parties) which allows stations to conference any combination of telephone instrument, CO, or FTS calls.
- 10) Automatic Number Identification: A facility where the directory number or equipment number of a calling instrument is obtained automatically for use in message accounting.

- 11) Station to Station Call Waiting: Busy telephone instruments shall be allowed to receive a second incoming call from another telephone instrument. The busy instrument, upon receiving a second incoming call shall receive a call waiting tone. The busy instrument shall be able to place the initial call on hold and answer the second call. The instrument shall have the capability of alternating between both calls.
- 12) Station and System Speed Dialing:
 - a) System Speed Dialing (not less than 50 numbers) shall be provided to allow designated telephone instruments to originate speed calls to CO, FTS, FX, or tie lines.
 - b) Station Speed Dialing shall be provided to support ten numbers per instrument. The instrument shall have the capability of entering, removing, or changing numbers programmed on their Station Speed dialing list.
- 13) Call Park: A telephone instrument feature will be provided which allows non-preselected internal instruments to access an attendant initiated feature in response to an internal / external paging situation.
- 14) Universal Night Answer Service: Provide a means of night service transfer for answering all incoming calls, which would normally be answered at the console, from locations other than the console. Chimes, with cut-off switches, to announce incoming calls shall be strategically placed at two locations.
- 15) Line Load Control: A pre-programmed attendant controlled feature which, when activated from the console positions, restricts all but selected stations from accessing the FTS and CO trunks during emergency conditions. The activation of line load control shall not affect intra-facility communications, e.g., station to station, access to the Public Address system, audio-page, etc.
- 16) Dual Common Controls: The following are the minimum features required:
 - a) Systems offering a stored program technology control feature shall provide a redundant common processing unit with automatic transfer capability.
 - b) Either common control shall be capable of handling the total EPBX traffic load without degradation of service.

- c) In event of failure of the primary common control, the system shall automatically switch to the redundant unit with no interruption to calls in progress and no loss of program features.

17) Line Lock Out:

- a) In the event a telephone instrument handset is not replaced in the telephone instrument cradle, after a pre-determined time interval with no dial action, that station line shall be locked out, i.e., not tie up EPBX switch equipment.
- b) Locked out station lines shall have audible tone applied.
- c) When a locked out telephone instrument handset is restored, the associated station line shall automatically be restored to full service.

18) Supervisory Telephone (not Electrical or Electronic) Signaling and Ringing:

- a) Provide dual solid state signal generating devices, or equivalent, which produce standard supervisory signaling, i.e., ringing, dial tone, busy tone, etc. The failure of any one signal generating device shall not affect more than one-third of the installed main station line capacity.
- b) Dual solid state signal generating devices shall provide automatic transfer to the alternate signal generating device in the event of failure of the primary device.
- c) All supervisory signaling and ringing shall be equivalent to the telephone industry standard, as follows:
 - (1) Tones shall be provided to indicate the progress of a call through the exchange, i.e. dial tone - to indicate that the switching equipment is ready to receive dial digits and, when required, provide a secondary dial tone for FTS 2000 access; busy tone (60 to 120 IPM) - to indicate that a busy line or trunk has been encountered; audible ring back tone - to indicate to the calling subscriber that the number dialed is being called.
 - (2) All supervisory signaling and ringing devices shall be capable of operating from the emergency DC power source.

19) Fusing:

- a) The EPBX shall be equipped with fuses to protect the total telephone system and individual segments of the EPBX so

that a problem in one segment may be isolated without damaging the total EPBX.

- b) Fuses shall be of the alarm indicating type and their rating designated by numerical or color code on fuse panels that are easily visible.

20) Equipment Power Supply:

- a) The EPBX shall be equipped with a complete on-line power supply. The system shall consist of AC surge protection, dual load-sharing rectifiers/chargers, batteries, and inverter.
- b) The power supply shall have a capacity sufficient to support the EPBX including it's projected maximum growth and as required in this specification for interfaced equipment.
- c) The Contractor shall coordinate with the Local Exchange Company (LEC) to determine CO trunk, FTS access line, and other required interface unit power requirements and provide power to the LEC or Contractor furnished and installed interface units so they will continue to function in event of a commercial AC power failure.

21) UPS w/Battery Back-up or Reserve Battery Power Supply:

- a) The reserve battery power supply shall have sufficient capacity to supply the EPBX for four (4) hours including the projected maximum growth and interfaced equipment. The battery power supply shall consist of not less than 24 sealed maintenance-free cells. Dry cell batteries are not acceptable.
- b) The system shall be capable of adjustable voltage for float or equalizing batteries. A fully redundant system (not including batteries and inverter) shall be provided. Each rectifier or charger shall have the capacity to support the combined load requirements of the EPBX at its maximum growth and all interfaced equipment.

22) Alarms and Trouble Indicators: It is acceptable to combine the required electrical and/or electronic supervision functions in these panels provided the supervisory standards are completely met:

- a) The Contractor shall provide and make operational visual and audible alarms, equipped with cut-off switches, indicating AC power failure, rectifier failure, major and minor trouble, temperature/humidity, electrical or electronic supervisory alarms. The Contractor shall be responsible for providing the required sensors for the environmental alarms. These alarms shall be remoted to the attendant console area and one other location to be as specified herein. These alarms shall be separate and in addition to the major and minor alarms on the attendant consoles.
 - b) The alarm panel shall contain small red indicator lamps for each alarm with cut-off switches or one switch for all alarms and a distinctive audible alarm(s). If one cutoff switch is provided for all audible alarms, it shall restore the alarms to the ready status condition for the audible registration of additional alarms.
 - c) The technical submittal shall describe any other EPBX alarms that are remoted and shall describe EPBX alarms/indicators of malfunction(s) that are located on the equipment.
- 23) The EPBX shall be capable of providing four-digit intra-station dialing and the desired functions described herein.
- 24) Due to the varied trunk group requirements and possible future trunk group requirements, e.g. public address system access, alternate access codes may be proposed. Grouping of similar type trunk group/features, e.g. 5-1 public address system (all call), 5-2 public address system zone 1, etc. is acceptable.
- 25) The EPBX shall provide emergency numbers accessible by all station users. The numbers shall appear on the console or a multi-line instrument and at least one other designated location. There shall be a distinctive audible and visual signal associated with the emergency number to ensure an immediate response to calls. The console or multi-line instrument shall have the capability of priority answering the emergency number and extending the call as the situation dictates. A modified trunk circuit may be used for this purpose.

- 26) The EPBX equipment shall have such sensitivity as required to provide satisfactory service up to 3,000 feet for all voice.
- h. The Contractor shall provide a complete set of EPBX electronic modules and/or cards to be used as on-hand operational emergency spare equipment. One each of T-1, DS-**, interface cards etc. is the minimum required or a compliment as directed by the OEM. Additionally, the Contractor shall confer with the COTR to determine other spare items that may be required to fully equip the system with emergency repair capabilities that completely adhere to the System Guarantee Requirements described herein.
- i. Voice Mail Requirements
- 1) General
- a) The requirement is for an automated call processing capability. The automated attendant shall be connected to the EPBX and configured to answer and route calls received on a predetermined number of central office trunks. The system shall be configured so that, if the called extension is busy or does not answer within a predetermined number of rings, then the caller shall be routed to the person's voice mail box. A complete voice mail system will allow a predetermined number of users to send complete and confidential messages in the users own voice and receive complete and confidential messages in the sender's own voice. The system shall provide 24 hours per day, 7 days per week access. The system shall be integrated into the operation of the EPBX and be compatible with the local telephone company central office.
- b) The system shall provide capacity for the following number of ports (minimum):

	Equipped Capacity	Wired Capacity
Automated Attendant	12	20
Voice Mail	12	20

- 2) The voice mail system shall initially provide for 500 mailboxes and 40 hours of storage with growth to 60 hours of storage.

- 3) Voice Mail Features. The system shall have the following features:
- a) Access to the system and its features from any instrument anywhere that provides DTMF signaling.
 - b) The ability of those leaving a message to review the message and/or edit the message that is being placed in the mailbox.
 - c) Privacy/Security through the use of a "PASSWORD".
 - d) The ability to send messages to users on the voice mail system in the following manner:
 - (1) To any user on the same voice mail system.
 - (2) To more than one user on the same voice mail system - an ad hoc distribution list determined by the sender at the time of message transmission.
 - (3) To a predetermined distribution list.
 - (4) Broadcast to all users on the same voice mail system.
 - e) Verification, With Receipt - The ability of a user to request and receive verification of when a message is actually played through the use of a touch-tone command. The system shall indicate the time and date of when a message is played and place that information in the sender's mailbox.
 - f) Envelope Information - The ability of a user to request and receive time and date information of when specific messages were left in the user's mailbox.
 - g) Connection to the voice mail system shall be through an EPBX extension number or a seven/ten digit telephone number from the LEC.
 - h) Message "PROMPTS" shall be provided for every transaction. Messages shall be provided for "GREETINGS" and "INSTRUCTIONS FOR RECORDING OR EDITING A MESSAGE".
 - i) A message waiting tone, lamp, and/or display shall notify the user that messages are in the user's mailbox.
 - j) A message shall notify the user, upon accessing the system, of how many messages are in the user mailbox.
 - k) The user, upon accessing the system, shall have the following response alternatives:

- (1) Respond or send a reply to another user on the same voice mail system.
- (2) Route the message to another user on the same voice mail system.
- (3) Delete the message.
- (4) Save the message.
- l) A "Default Path" shall be provided to allow those callers who do not have touch-tone capability or who need to talk to someone to be routed to an operator or some other predetermined answering position.
- m) The system shall have the ability to fast forward or rewind recorded messages while being reviewed by the user.
- n) The system shall present messages to the user on a "FIFO" basis.
- o) User Administration - As a minimum, the system shall provide management information and statistics in the following categories;
- p) Port Usage - Traffic statistics on each of the different access paths into the system.
- q) Usage of Storage Capacity - Remaining storage capacity at any one time and during peak periods.
- r) Mailbox Usage - Connect time and number of new or saved messages.
- s) The user administration terminal shall allow for "Class Of Service Controls" in the following areas and for the following parameters:

Initial Authorization:
Ability to enable a mailbox.
Record the "Owner's" name.
Set initial Pass Number.
Usage Control:
Length of personal greeting.
Length of messages received.
Number of messages.
Message retention time.

Feature Authorizations - Allowed or Not:
Group List Creation.
Group List Usage.
Broadcast Messages.

B. Voice Traffic Management System (TMS)

1. A complete and self-contained on-site TMS shall be provided that is fully compatible with and compliments the system.
2. The Following Functions Shall Be Provided at a minimum:
 - a. A 300 dots per inch(DPI) letter quality printer, shall be provided for reports generated by the EPBX and/or the maintenance administration terminal.
 - b. The TMS shall be connected to the EPBX emergency battery power supply.
 - c. All screen menus shall be standard and provide access to each category of reports.
 - d. Traffic Accounting and Management Call Detail Recording (CDR) Package shall be provided for all Voice circuits. The TMS shall:
 - 1) Include all necessary hardware, software, and interconnections to the EPBX.
 - 2) Contain a database that shall be stored on non-volatile media. Tape drives are not acceptable.
 - 3) Provide line numbers, physical locations of equipment by building and room number, the department to which a line is assigned, the name of the person(s) assigned to a particular number, the type of equipment, and any comments regarding EPBX features.
 - 4) Support additional input and/or output (I/O) ports for video monitors or other terminals which will allow a passive display of the data base(s) by authorized medical center personnel other than those individuals responsible for data input and conducting studies.
 - 5) Exhibit security that shall be provided by User ID and password to protect the data base(s).
 - 6) Provide separate voice line reports, on demand and predetermined schedule, for automatic printing. As a minimum, the following reports are required:
 - a) Originating trunk traffic by trunk group, expressed in CCS.

- b) Terminating trunk traffic by trunk group, expressed in CCS.
 - c) All trunks busy, by trunk group, expressed as blocked call count.
 - d) All equipment busy, i.e., no dial tone and failure to complete cross-office call because of all equipment busy, expressed in blocked call count.
 - e) List of all equipment alarms, error tables, trouble logs, history files, etc.
- e. The following console measurements shall be accomplished for each console:
- 1) Incoming calls.
 - 2) Calls answered.
- f. Remote video monitors shall be provided in the immediate vicinity of the telephone operators for use as an on-line directory lookup system of VAMC personnel. The Contractor provided monitors shall be compatible with the proposed TMS hardware and software.
- g. All reports shall be in English notation and will not require interpretation of abbreviations or codes by the user.
- h. Sufficient storage on disk shall be provided to prevent a purge of stored data. Call record and facility usage data shall be maintained in the database for a minimum of 30 days. Storage must be capable of accommodating a minimum of 5,000 calls per day.
- i. Samples of all reports generated by the TMS are to be submitted with the technical submittal for evaluation of formats and compliance with information field content.
- j. Normal system traffic data shall be furnished to the appropriate Facility staff within seven days of a Facility request. A complete and comprehensive traffic study, to include the required traffic data with the Contractor's comments and recommendations, will be prepared and submitted to the appropriate Facility staff quarterly. These studies shall be provided at no additional cost to the VA.
- k. Automatic directory service shall generate a telephone directory that includes, name, title, organization, location, extension, and class-of-service. The contractor shall be responsible for loading and maintaining the directory.
- l. A Cable plant management function shall be provided with the following minimum requirements:

- 1) A list of off-premise cable by circuit number, numbers of pairs for each circuit, and circuit definition.
 - 2) Provide a complete cable plant distribution record to identify the location (cable pair) on the MDF, the riser, the size cable, cable pair in-use (main cable feeder and station cable), building and room number of the termination, and the type equipment terminated.
 - 3) Automatically provide when the service order is entered, the cable number and pair assignments.
- m. Equipment inventory list shall be provided containing the following minimum requirements:
- 1) EPBX cabinets, cards (active and spares), batteries, current and surge protectors, rectifiers, all peripheral equipment, i.e. public address etc.
 - 2) Quantity of single and multi-line telephones, speakerphones, dial intercom units, speakers, gongs, loud horns, bells, chimes, recorders, etc.
 - 3) A list of equipment as being used or spare; ordered or received; installed date, warranty date, cost, location, serial number, etc.
- n. Electrical and/or Electronic supervisory alarms and faults reports.

C. Attendant Console:

1. The attendant console(s) shall be compatible with the local commercial telephone system and shall:
 - a. Be powered from the EPBX's emergency battery power supply.
 - b. Be load sharing to insure that all incoming calls are evenly distributed among all consoles regardless of the traffic load.
 - c. Provide telephone signal (not electrical or electronic) supervision over all calls connected through the console e.g., indication of:
 - 1) Called party answer (revert back to attendant if no answer).
 - 2) Trunk group busy.
 - 3) Station recall to attendant. In the event of an incoming call being placed (in a hold status) prior to a station being dialed after a specified time this call will revert to the attendant.
 - d. Call transfer capability by attendant.

- e. Automatic ring of called station with ring back tone provided to the calling party.
- f. The console shall be designed to allow installation as far as 1,000 feet from the EPBX equipment cabinets, serviced by a 24 gauge cable.
- g. The Attendant Console shall have:
 - 1) The ability to enter any on-going voice call, regardless of whether the call was connected through the console, direct-in-dial, or originated as an intra-station call. A warning tone shall be applied when the attendant enters an on-going voice call.
 - 2) "Call-splitting" ability that will permit the attendant to exclude either the outside or inside party when handling trunk calls.
 - 3) "Camp-on busy" feature, which will allow the attendant to place incoming voice calls on hold until called station number, is available. Tone burst to be applied to the busy line to alert that a call is waiting.
 - 4) When the busy line becomes free, the waiting call shall be automatically connected. If the waiting call is not connected after a pre-determined time, the waiting call shall revert to the attendant.
 - 5) Universal Night Answering Service that shall provide the ability for all incoming calls to be answered from a location other than the console.
 - 6) Attendant headsets consistent with the latest state-of-the-art shall be provided for 10 attendants. The headsets shall be on the ear models, equipped with coiled cord, plug-In case amplifier, and quick disconnect. Indicate in the technical submittal the type of headsets to be provided.
 - 7) One supervisor plug-in handset with a push-to-talk button and a nine-foot cord.
 - 8) Dual tone multi-frequency dialing for attendant completion of all incoming, outgoing, and intra-station calls.
- h. Automated Attendant shall perform the following features:
 - 1) Access from any instrument anywhere that provides DTMF signaling.
 - 2) Voice "PROMPTS" shall be provided for every transaction.

- 3) An introductory greeting shall be provided.
- 4) The system shall provide, as the initial option, the ability of the caller to enter the extension of the person being called and connection to that extension or enter zero for connection to the operator.
- 5) For the persons calling who do not have touch-tone capability or wish to talk to an operator, the system shall provide the option of "WAITING ON THE LINE" and having an operator assist the caller. As a minimum at least one port on the system shall provide support for rotary dial service.
- 6) The system shall have the capability of providing the caller with a directory and sub-directories of telephone numbers and the ability to enter the desired extension at any time while listening to the directory.

D. Equipment Cabinet with Internal Mounting Rails:

1. The equipment cabinet shall be lockable, heavy gauge steel with baked on paint finish. It shall be floor or wall mounted with knock-out holes for cable entrance and conduit connection, provided with ventilation ports and quiet fan with non disposable air filter for equipment cooling. The COTR shall be provided with a minimum of two keys for each lock when the System is accepted.
2. A minimum of one cabinet shall be provided with blank rack space, for additional equipment. Blank panels shall be installed to cover any open or unused rack space. Two 120 VAC power strips connected to surge protectors, cooling fan with non-disposable air filter, and conduit or cable duct interface to adjacent cabinet(s) shall be a part of this cabinet.
3. Blank panels shall be color matched to the cabinet, 3.175 mm (1/8 inch) aluminum with vertical dimensions in increments of 30 mm (1.75 inch) with mounting holes spaced to correspond to EIA 480 mm (19 inch) dimensions. Single standard size blank panels shall be used to fill unused panel or rack spaces in lieu of numerous 30 mm (1.75 inch) types. One blank 30 mm (1.75 inch) high blank panel shall be installed between each item of equipment.
4. AC power outlet strip(s):
 - a. A strip shall be provided with an outlet for each item of equipment and a minimum of four spare AC power outlets. Each strip shall be mounted inside and at the rear of each equipment

cabinet. It shall contain "U" ground AC outlets for distributing AC power to the installed electronic equipment. The strip shall be self-contained in a metal enclosure with a maximum of 1.8 meters (6 feet) connecting wire with three prong plug.

b. Technical Characteristics:

Power capacity: 20 AMP, 120 VAC continuous duty

Wire gauge: Three conductor, #12 AWG copper

5. Cabinet AC Power Line Surge Protector and Filter:

- a. Each cabinet containing active electronic equipment shall be equipped with a AC Surge Protector and Filter. The Protector and Filter shall be housed in one single enclosure. The Protector and Filter shall provide instantaneous regulation of the AC input voltage and isolate and filter any noise present on the AC input line. It shall be cabinet mounted and the cabinet AC power strip (maximum of two strips) may be connected to it.

b. Technical Characteristics:

Input Voltage range	120 VAC \pm 15%
Power capacity	20 AMP, 120 VAC
Voltage output regulation	\pm 3.0%
Circuit breaker	15 AMP, may be self contain
Noise filtering	Greater than 45 dB
AC outlets	Four duplex grounded types, minimum
Response time	5.0 NS
Surge suppression	10,000 AMPS
Noise suppression:	
Common	-40 dB
Differential	-45 dB

- c. Main AC input line: The main AC circuit supplying power to the system shall be the Facility's Critical AC Branch of the Emergency Distribution System:

- 1) The EPBX shall be equipped with AC voltage and current surge protectors to prevent damage to the EPBX and rectifiers from power line induced voltage spikes, surges, lightning, etc.
- 2) Specific requirements for current and surge protection shall include:

- a) Five nS response time to the transient.
- b) Voltage protection threshold, line to neutral, starts at no more than 220 V peak. The transient voltage shall not exceed 300 volts peak. Vendor shall furnish documentation on peak clamping voltage as a function of transient AMP.
- c) Peak power dissipation 35 Joules per phase (minimum), as measured for 1 millisecond at sub branch panels, 100 Joules per phase at branch panels and 300 joules per phase at service entrance panels. Vendor shall furnish an explanation of how the ratings were measured or empirically derived.
- d) Surge protector must not short circuit the AC power line at any time:
 - (1) The primary surge protection components must be silicon semiconductors. Secondary stages, if used, may include other types of devices.
 - (2) Surge protectors shall incorporate a visual device which indicates whether the surge suppression component(s) is (are) functioning.
 - (3) Surge protection devices shall be UL listed.
 - (4) Voltage and current surge protectors shall be provided on all ancillary equipment provided by the Contractor, not powered from the EPBX primary power supply and emergency battery, e.g., electronic telephones, service units, custom telephones, speaker phones, modems, data terminal interface, etc.
- e) Power dissipation 12,000 W for 1 mS (or 12 Joules).
- f) Voltage protection threshold starts at not more than 110 VAC.
- g) Surge protectors must not short-circuit the A/C line at any time.
- h) Surge protectors shall be self contained, plug in type for 110/120 VAC, 15 AMP, duplex receptacle.

E. Environmental Cabinet (If Selected)

- 1. The Contractor shall provide this enclosure in lieu of a standard equipment cabinet identified in Paragraph 2.3.A to meet system design in hostile TC locations as identified on the drawings. The enclosure shall fully sustain the installed, including electronic,

equipment in the same manner as the standard cabinet identified in Paragraph 2.3.A. Additionally, the enclosure shall fully support all installed equipment as if they were in a stand alone air handling area regardless of the local area's air handling capabilities. The enclosure shall be a fully OEM assembled unit. If more than two enclosures are required in any system location, those enclosures shall be OEM assembled for consolidating or combining two or more enclosures in a single unit to meet system space and equipment handling designs.

2. Technical Characteristics:

Environmental control	Automatic, heating and/or cooling, as required
TEMPERATURE CONDITIONS (RATED AT 1,300 W OF INSTALL EQUIPMENT HEAT GENERATION)	
Internal Range	Maintains 80° to 105° of internal heat conditions, maximum
External Range	100° \pm 25°, maximum
Forced air unit	Required with non disposable air filter unobstructed and uninterruptible
Air conditioning	As required, fully internal mounted
Heater	As required, fully internal mounted
Uninterruptible power supply	As required, fully internal mounted
Front door	Full length, see through, EMI resistant, and lockable
Rear door	Full length, non-see through, EMI resistant, and lockable
Conduit wiring entrance	Top and/or bottom, fully sealed
Input power	2 ea. minimum 120 VAC @ 20A, maximum, independent circuit, conduit for fixed or armored cable for moveable installations
Dimensions	
Height	1980 mm (78"), maximum
Width	635 mm (25"), maximum
Depth	965 mm (38"), maximum
Front panel opening	480 mm (19"), w/ EIA mounting hole spacing

F. Distribution or System Interface Cabinet:

1. The cabinet shall be constructed of heavy 16 gauge cold rolled steel, have top and side panels and hinged front and rear (front door only if wall mounted) doors. It shall have baked-on iron phosphate primer and baked enamel paint finish in a color to be selected by the using Facility Service Chief or COTR, contain integral and adjustable predrilled rack mounting rails or frame that allows front panel equipment mounting and access. When all equipment, doors and panels are installed, snap-in-place chrome trim strip covers are required to be installed that will cover all front panel screw fasteners. It shall be equipped in the same manner as the equipment cabinet.
2. Technical Characteristics:

Overall height	2180 MM (85 7/8"), MAXIMUM
Overall depth	650 mm (25 1/2"), maximum
Overall width	535 mm (21 1/16"), maximum
Equipment vertical	1960 mm (77 1/8"), maximum
Mounting space	
Front panel horizontal	484 mm (19 1/16"), maximum width

G. Stand Alone Equipment Rack:

1. The rack shall be constructed of heavy 16 gauge cold rolled steel and have fully adjustable equipment front mounting rails that allows front panel equipment mounting and access. It shall have baked-on iron phosphate primer and baked enamel paint finish in a color to be selected by the using Facility Service Chief or COTR. It shall be floor or wall mounted or mounted on casters as directed by the RE.
2. Technical Characteristics:

Overall Height	2180 MM (85 7/8"), MAXIMUM
Overall Depth	650 mm (25 1/2"), maximum
Overall Width	535 mm (21 1/16"), maximum
Front Panel Opening	484 mm (19 1/16"), EIA horizontal width
Hole Spacing	per EIA

H. Cross-Connection System (CCS) Equipment - Breakout, Termination Connector (or Bulkhead), and Patch Panels, and Connection Assemblies

1. The connector panel(s) shall be made of flat smooth 1/8 inch thick solid aluminum, custom designed, fitted and installed in the cabinet. Bulkhead equipment connectors shall be mounted on the panel to enable all cabinet equipment's signal, control, and coaxial cables to be connected through the panel. Each panel shall be color matched to the cabinet installed.

- a. Voice (or Telephone)

- 1) The CCS for voice or telephone service will be Industry Standard 110 type punch blocks. This represents the minimum requirement for voice or telephone, and control wiring in lieu of patch panels, each being certified for category six service. IDC punch blocks (with internal RJ45 jacks) are acceptable for use in all CCS and shall be specifically designed for category six telecommunications service suitable for the size and type of UTP cable used as described herein. As a minimum punch block strips shall be secured to an OEM designed physical anchoring unit located on a wall in the MTC, IMTC, and TC. However, console, cabinet, rail, panel, etc. mounting is allowed at the OEM recommendation and as approved by the RE. Punch blocks shall not be used for Class II or 120 VAC power wiring.

- 2) Technical Characteristics:

Number of horizontal rows	100, minimum
Number of terminals per row	4, minimum
Terminal protector	required for each used or unused terminal
Insulation splicing	required between each row of terminals

- b. Fiber optic and Analog Audio

- 1) Product reference of a Government Approved (US State Department) type is Telewire, PUP-17 with prepunched chassis mounting holes arranged in two horizontal rows. This panel may be used for fiber optic, audio, control cable, and Class II Low Voltage Wiring installations when provided with the proper connectors. This panel IS NOT allowed to be used for 120 VAC power connections.

2) Technical Characteristics:

Size	
Height	Two RUs, 89 mm (3.5") minimum
Width	484 mm (19 1/16"), EIA minimum
Number of connections	12 pairs, minimum
Connectors	
Audio Service	Use RCA 6.35 mm (1/4") Phono, XL or Barrier Strips, surface mounted with spade lugs (punch block or wire wrap type strips are acceptable alternates for barrier strips as long as system design is maintained)
Control Signal Service	Barrier strips surface mounted with spade lugs (punch block or wire wrap type strips are acceptable alternates for barrier strips as long as system design is maintained)
Low voltage power (class II)	Barrier strips with spade lugs and clear full length plastic cover, surfaced mounted
FIBER OPTIC	"ST" STAINLESS STEEL, FEMALE

c. Mounting Strips and Blocks:

1) Barrier Strips:

- a) Barrier strips are approved for AC power, data, voice, and control cable or wires. Barrier strips shall accommodate the size and type of audio spade (or fork type) lugs used with insulating and separating strips between the terminals for securing separate wires in a neat and orderly fashion. Each cable or wire end shall be provided with an audio spade lug, which is connected to an individual screw terminal on the barrier strip. The barrier strips shall be surface secured to a console, cabinet, rail, panel, etc. 120 VAC power wires shall not be connected to signal barrier strips.

b) Technical Characteristics:

Terminal size	6-32, minimum
Terminal Count	ANY COMBINATION
Wire size	20 AWG, minimum

Voltage handling	100 V, minimum
Protective connector cover	Required for Class II and 120 VAC power connections

- 2) Solderless Connectors. The connectors (or fork connectors) shall be crimp-on insulated lug to fit a 6-32 minimum screw terminal. The fork connector shall be installed using a standard lug-crimping tool.
- 3) Punch Blocks. Industry Standard 110 type punch blocks are approved for voice and control wiring at a minimum. Punch blocks shall be specifically designed for the size and type of wire used. Punch block strips shall be secured to a console, cabinet, rail, panel, etc. Punch blocks shall not be used for Class II or 120 VAC power wiring.
- 4) Wire Wrap Strips. Wire wrap strips (minimum of 0.065" wire wrap) are approved for voice and control wiring and shall meet Industry Standards. Wire wrap strips shall be secured to a cabinet, rail, panel, etc. Wire wrap strips shall not be used for Class II or 120 VAC power wiring.

I. Wire Management System and Equipment:

1. Wire Management System. The system(s) shall be provided as the management center of the respective cable system, CCS, and TC it is incorporated. It shall perform as a platform to house peripheral equipment in a standard relay rack or equipment cabinet. It shall be arranged in a manner as to provide convenient access to all installed management and other equipment. All cables and connections shall be at the rear of each system interface to IDC and/or patch panels, punch blocks, wire wrap strips, and/or barrier strip.
2. Wire Management Equipment. The wire management equipment shall be the focal point of each wire management system. It shall provide an orderly interface between outside and inside wires and cables (where used), distribution and interface wires and cables, interconnection wires and cables and associated equipment, jumper cables, and provide a uniform connection media for all System fire retardant wires and cables and other subsystems. It shall be fully compatible and interface to each cable tray, duct, wireway, or conduit used in the system. All interconnection or distribution wires and cables shall enter the system at the top (or from a wireway in the floor)

via a overhead protection system and be uniformly routed down either side (or both at the same time) of the frame in side protection system then laterally via a anchoring or routing shelf for termination on the rear of each respective terminating assembly. Each system shall be custom configured to meet the System design and user needs.

J. Telephone Instruments:

1. Telephone instruments (or station equipment) that are initially installed shall be configured as indicated herein. Final location of some station equipment shall be coordinated with designated VA official prior to installation.
2. All telephone instruments shall be equipped with the inductive capability to radiate a magnetic field required to activate the hearing aid telecoil and to provide personnel, who use hearing aids, access to all telephones within the Facility.
3. Station equipment shall consist of standard single line instruments, patient bedside instruments, and multi-line digital electronic telephone instruments with digital display, of the latest state-of-the-art design.
4. All telephone instruments except patient bedside phones, shall be equipped with a flash button (or equivalent feature button) with pre-determined timing feature to initiate consultation hold and other features normally initiated by operation of the hook-switch. Flash button shall be distinct from the hook-switch.
5. All telephone instruments, except patient bedside phones, shall be equipped with a laminated faceplate listing the most common user features and their appropriate access codes. The faceplates may be an integral part of the instrument housing or may be an adhesive backed decal that shall be applied over the tone pad area of the housing at the time of telephone set installation.
6. Station instruments shall be feature compatible and have transmission characteristics which are compatible with the proposed System.
7. Telephone instrument signaling shall be by means of standard adjustable, buzzers, chimes, or electronic tone, unless otherwise specified.
 - a. Single Line:

- 1) Single line instruments may be electronic or 2500-type analog phones.
 - 2) Single line instruments used must be capable of supporting bridged cabling to allow a single phone number on multiple instruments without using multiple switch ports.
 - 3) Single line instruments must be capable of supporting auxiliary equipment, such as amplified hand sets; external chimes, light, or bells; and other similar equipment without using multiple switch ports.
- b. Multi-Line, Digital and Electronic:
- 1) The instruments shall be equipped with a digital read-out display and shall have no less than 14 programmable (lines or features) buttons.
 - 2) The instruments shall employ only one adjustable ringer, bell, buzzer, chime or electronic tone to announce calls. The signaling device shall detect an incoming call to the multi-button instrument and provide an audible signal only on designated lines.
 - 3) Each instrument shall be equipped with lights to identify the called line and remain illuminated for the duration of the call.
 - 4) Telephone intercom systems shall normally be associated with these instruments.
 - 5) The equipment associated with intercom systems may require special features such as built in microphone and speaker. Telephone Intercom Systems shall be required to provide secretaries with a means of announcing calls to offices with extensions or pickups on the System. The provision of intercom systems shall be identified during the data base survey required as described herein. Any required intercom systems shall be provided and installed by the contractor.
 - 6) This equipment must be capable of supporting auxiliary equipment, such as amplified handsets; external chimes, light, or bells; and other similar equipment. The use of analog switch ports to provide ringing voltage, if required, is acceptable and these switch ports shall be included in the Equipped Capacity as described herein.

- 7) Hot Line Telephones shall be provided between two identified points and as shown on the drawings. These hot lines shall be equipped with two-way automatic ring and cut-off controlled by the telephone hook-switch, i.e. when near-end hand set is removed from the hook switch, the far-end telephone shall ring until the hand set is removed from the hook-switch.
- 8) Hands Free telephone stations shall be required. In this configuration, a speaker shall be used as both transmitter and receiver to answer or initiate a call. These facilities will normally be used as a hot line between two points.
Requirements for hands-free operated facilities shall be identified on the drawings.

K. Lightning Protection System. Each protection system shall be provided, in its entirety, totally and externally to the building. The use of internal electrical wiring for lightning grounding systems is not acceptable and will not be approved. Provide 5% spare protectors.

1. EPBX. The EPBX, cabinets, racks, wire management systems, cable shields, etc. shall be grounded with copper wire run external to the building and connected to the earth ground. If these items are installed in an area not protected by lightning protection system, the Contractor shall immediately notify the COTR in writing of the lightning strike hazard and make the appropriate contractual updates to accommodate this system.
2. Telephone, Data, Audio, and/or Coaxial Cable Lightning Protector:
 - a. The protector shall be an in-line device equipped with screw type connectors to match the coaxial and/or STP or UTP cable specified. It shall be located at each building entrance where each cable enters a building from the outside and grounded with stranded copper wire run external to the building connected to the earth ground. It shall be able to shunt high current surges to earth ground protecting the System's signal receiving equipment. The protector shall have a minimal effect on the quality of the signal being received or transmitted. It shall be made of non-corrosive metal and waterproof. Refer to EPBX technical data for additional required specifications.
 - b. Technical Characteristics:

Peak Pulse Power	1500 W @ 77° F
Protection Device	Gas Tube or as required by OEM
Dissipation	1.0 Mili Seconds (MS)
Response Time	5.0 nS
Connectors	As Specified
Ground Wire	#6 AWG Stranded Copper, minimum, or as required by the OEM, and/or VA

L. Audio Monitor Panel:

1. The panel shall be EIA/TIA standard for 480 mm (19") cabinet mounting. It shall be provided in the upper portion of the EPBX equipment cabinet. This unit may be combined in the EPBX Annunciating System and/or Electrical Supervision Panel in order to achieve the minimum electrical supervision requirements of the System. Refer to EPBX technical data for additional required specifications. Provide one spare panel.
2. Technical Characteristics:

Monitor speaker	A permanent magnet, 76 mm (3 inch) minimum diameter, and a monitor volume control
Audiometer	Easy to read volume unit (vu) or similar meter with illuminated scale and meter calibrating control.
Channel selector switch	Six positions (Off, 1, 2, 3, 4, and Spare) which shall connect the monitor speaker and VU meter to the selected audio channel.

M. Electrical Supervision Panel:

1. An electrical supervision panel shall be provided in the EPBX cabinet and Telephone Operator locations and as designated on the contract drawings. The panel shall be compatible the EPBX Trouble Annunciation Panel and Audio Monitor Panel to generate electrical and/or electronic supervising signals to continuously monitor the operating condition for the system EPBX, CSU, telephone instruments and interconnecting cable trunks. The panel shall generate an audible and visual signal when the system's supervising system detects an EPBX, CSU, or trunk line is malfunctioning. Refer to EPBX technical data for additional required specifications. Provide one spare panel.

2. Technical Characteristics:

Silence button or switch	Shall silence the audible signal. However, the visual signal will continue until the supervisory circuit indicates the fault is corrected.
Visual enunciators	Visually show the amplifier and/or trunk-line unit or supervisory circuit is in fault condition.

2.3 DISTRIBUTION EQUIPMENT AND SYSTEMS

The System shall be provided with a complete cable backbone and building distribution system consisting of copper, fiber optic, and other specified cable and connectors, signal closets, cross connection or terminating systems, telecommunication outlets and interface points as identified in Section 27 15 00, COMMUNICATIONS HORIZONTAL CABLING and with technical instructions and approval from the RE.

2.4 INSTALLATION KIT

The kit provided shall include, at a minimum, all connectors and terminals, labeling systems, audio spade lugs, barrier strips, punch blocks or wire wrap terminals, heat shrink tubing, cable ties, solder, hangers, clamps, bolts, conduit, cable duct, and/or cable tray, etc., required to accomplish a neat and secure installation. All wires shall terminate in a spade lug and barrier strip, wire wrap terminal or punch block. Unfinished or unlabeled wire connections shall not be allowed. The Contractor shall turn over all unused and partially opened installation kit boxes, coaxial, fiber-optic and twisted pair cable reels, conduit, cable tray, and/or cable duct bundles, wire rolls and physical installation hardware to the COTR. At a minimum, the following installation sub-kits are required:

A. System Grounding:

1. The grounding kit shall include all cable and installation hardware required. All EPBX equipment shall be connected to earth ground via internal building wiring, according to the NEC.
2. This includes, but is not limited to:
 - a. Voice Cable Shields
 - b. Control Cable Shields
 - c. Cable Trays
 - d. Equipment Racks

- e. Equipment Cabinets
 - f. Conduits
 - g. Cable Duct
 - h. Cable Trays
 - i. Power Panels
 - j. Connector Panels
 - k. Grounding Blocks
- B. Wire and Cable. The wire and cable kit shall include all connectors and terminals, audio spade lugs, barrier straps, punch blocks, wire wrap strips, heat shrink tubing, tie wraps, solder, hangers, clamps, labels etc., required to accomplish a neat and orderly installation.
- C. Conduit, Cable Duct and Cable Tray. The kit shall include all conduit, duct, trays, junction boxes, back boxes, cover plates, feed through nipples, hangers, clamps, other hardware required to accomplish a neat and secure conduit, cable duct, and/or cable tray installation in accordance with the NEC and this document.
- D. Equipment Interface. The equipment kit shall include any item or quantity of equipment, cable, mounting hardware and materials needed to interface the System with the identified sub-system(s) according to the OEM requirements and this document.
- E. Labels. The labeling kit shall include any item or quantity of labels, tools, stencils, and materials needed to completely and correctly label each subsystem according to the OEM requirements, record wiring diagrams, and this document.
- F. Documentation. The documentation kit shall include any item or quantity of items, computer discs, as installed drawings, equipment, maintenance, and operation manuals, and OEM materials needed to completely and correctly provide the System documentation as required by this document and explained herein.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Product Delivery, Storage and Handling:
1. Delivery: Deliver materials to the job site in OEM's original unopened containers, clearly labeled with the OEM's name and equipment model and serial identification numbers. The COTR may inventory the EPBX equipment at the time of delivery and reject items that do not conform to this requirement.

2. Storage and Handling: Store and protect equipment in a manner which will preclude damage as directed by the COTR.

B. System Installation:

1. After the contract's been awarded, and within the time period specified in the contract, the Contractor shall deliver the total System in a manner that fully complies with the requirements of this specification. The Contractor shall make no substitutions or changes in the System without written approval from the COTR and PM.
2. The Contractor shall install all equipment and systems in a manner that complies with accepted industry standards of good practice, the requirements of this specification, and in a manner which does not constitute a safety hazard. The Contractor shall insure that all installation personnel understands and complies with all the requirements of this specification.
3. The Contractor shall install suitable filters, traps, directional couplers, splitters, telephone outlets, and pads for minimizing interference and for balancing the amplifiers and distribution system(s). Items used for balancing and minimizing interference shall be able to pass telephone signals in the frequency bands selected, in the directions specified, with low loss, and high isolation and with minimum delay of specified frequencies and signals. The Contractor shall provide all equipment necessary to meet the requirements of paragraph 2.1.C and the System performance standards.
4. All passive equipment shall be connected according to the OEM's specifications to insure correct termination, isolation, impedance match and signal level balance at each telephone outlet.
5. All lines shall be terminated in a suitable manner to facilitate future expansion of the System.
6. All vertical and horizontal copper and fiber optic, *and coaxial* lines shall be terminated so shall require modifications of the system EPBX or signal closet equipment only.
7. Terminating resistors or devices shall be used to terminate all unused branches, outlets, equipment ports of the system, and shall be devices designed for the purpose of terminating fiber optic or twisted pair, and coaxial cables carrying telephone, and analog video signals in telephone, and analog systems.

8. Equipment installed outdoors shall be weatherproof or installed in weatherproof enclosures with hinged doors and locks. Provide a minimum of two keys for each lock.
 9. Equipment installed indoors shall be installed in metal cabinets with hinged doors and locks. Provide a minimum of two keys for each lock.
- C. Equipment Assembly:
1. Cabinets:
 - a. Each enclosure shall be: Floor or wall mounted with standard knockout holes for conduit connection or cable entrance; provide for ventilation of the equipment; have front and rear locking doors (except, wall mounted cabinets that require only a front locking door); power outlet strip(s), bulkhead connector and patch panel(s).
 - b. Each enclosure shall be equipped with a quiet fan and nondisposable air filter.
 - c. Enclosures and stand alone racks shall be installed plumb and square. Each shall be permanently attached to the building structure and be held firmly in place as approved by the COTR.
 - d. Rack mounted equipment shall be installed on the enclosure's equipment adjustable mounting racks with equipment normally requiring adjustment or observation mounted so operational adjustment(s) can be conveniently made. Heavy equipment shall be mounted with rack slides or rails allowing servicing from the front of the enclosure. Heavy equipment shall not depend only upon front panel mounting screws for support. Equipment shall be provided with sufficient cable slack to permit servicing by removal of the installed equipment from the front of the enclosure. A color matched blank panel (spacer) of 44 mm (1.75 inches) high, shall be installed between each piece of equipment (active or passive) to insure adequate air circulation. The enclosure shall be designed for efficient equipment cooling and air ventilation.
 - e. Provide 380 mm (15 inches) of front vertical space opening for additional equipment. Install color matched blank panels to cover any unused enclosure openings.
 - f. Signal connector, patch, and bulkhead panels (i.e. PA, telephone, control, etc.) shall be connected so that outputs from each

source, device or system component shall enter the panel at the top row of jacks, beginning left to right as viewed from the front. These will be called "inputs". Each connection to a load, device or system component shall exit the panel at the bottom row of jacks, beginning left to right as viewed from the front. These will be called "outputs".

- 1) Equipment located indoors shall be installed in metal racks or enclosures with hinged doors and be accessible for maintenance without interference to other nearby equipment.
- 2) Cables shall enter the equipment racks or enclosures in a manner that allows all doors or access panels to open and close without disturbing or damaging the cables.
- 3) All distribution hardware shall be securely mounted in a manner that allows access to the connections for testing and provides sufficient room for the doors or access panels to open and close without disturbing the cables.

2. Installation of the EPBX:

a. General:

- 1) The EPBX installation shall comply with all laws, codes and standard industry practices applying to interconnected telephone installations in effect.
- 2) In the absence of specifications regarding installation details, standard industry practices shall prevail and first quality material and workmanship shall be provided.
- 3) All material, provided by the Contractor, shall be new and thoroughly tested. The installation shall be carried out in a professional manner.
- 4) Installation of all equipment shall be fully coordinated with the COTR and the Facility staff. No area shall be left without minimal telephone service as described herein.
- 5) The Contractor shall provide a triplex outlet with modular jacks with stainless steel cover plate for each telephone outlet as shown on the drawings. The Contractor shall provide the appropriate modular jack (single or triplex) with appropriate cover plate for each 'OUTLET' location identified and verified on the drawings.

- 6) The Contractor shall install all patient and wall telephone instruments on a single modular jack designed for wall telephone instruments and patient wall or PBPU installations.
 - 7) All permanent telephone cables and wires shall be installed in conduit or an enclosed duct system or be of the type approved for installation, as determined by VA requirements, without conduit or enclosed duct system. Cable and wire not installed in conduit or an enclosed duct system must be installed in cable tray or mechanically supported and separated from other signal cable systems as described herein.
 - 8) Where cable and wire penetrate through fire/smoke partitions, firewalls, or floors, the Contractor shall provide fire/smoke stopping around the outside of any installed conduit/cable tray. The Contractor shall provide and install fire stopping material, type approved by the COTR, inside the provided conduit/cable tray after installation is complete.
- b. The Contractor shall:
- 1) Install the equipment in accordance with the specifications for the EPBX as specified and recommended by the OEM.
 - 2) Provide a full time on-site Project Manager effective with VA issuance of the notice to proceed. The Project Manager shall be responsible to fully coordinate and supervise all contractor/sub-contractor personnel in all phases of the installation, training, inspection, cutover, and final acceptance of the System. The Project Manager shall be provided a complete copy of these specifications to include all amendments prior to start of installation of the telephone system.
 - 3) Coordinate and conduct the EPBX data base survey with the COTR and a member of the IRM. The Contractor is responsible for identifying all programming of features, classes of service, and equipment to be installed by type and physical location as specified in this document and all attachments thereto. After the survey is completed, a complete list of equipment shall be provided to the COTR for approval prior to start of installation.
 - 4) Be responsible for the removal and replacement of damaged ceiling tiles during installation and maintenance service of

the cable and wire distribution system. The Contractor shall be responsible for restoring immediate areas (that are approximately one meter (three feet) in diameter) that were damaged during the system installation and maintenance service.

- 5) Run all cross connects to established circuits during installation and maintenance service for the contract life.
- 6) Remove, on a daily basis, all debris and scrap generated in the conduct of work.
- 7) Provide the COTR, for review, coordination, and approval a Proof of Performance Test Plan 90 days prior to cut-over of the EPBX. The plan shall be used for testing and acceptance of the system. It shall include sufficient tests to demonstrate the Systems capabilities of providing the services outlined in this document. Test equipment required for demonstration shall be Contractor provided and approved by the COTR. A list of test equipment required shall be included with the acceptance test plan. Test equipment shall have undergone calibration certification within six months of system cut-over.
- 8) Provide Contractor personnel (switch technicians, installers, trainers, and the project manager, etc.) on premise for seven consecutive days after cutover to clear any malfunctions which may develop, to assign/reassign any software features/COS, and conduct any additional training as required.
- 9) Insure that the project manager and sufficient skilled personnel remain on premise until all items on the punch list, developed during inspection, cut-over, and acceptance testing of the system are completed, inspected, and accepted by the RE.
- 10) Be responsible for any and all coordination with the LEC relative to interface with the commercial telephone system. The Contractor shall also be responsible for the removal of all voice and/or data equipment and cabling abandoned by the LEC, VA, or other organizations and not retained for exclusive use by VA as a result of this installation
- 11) Connect all telephone equipment located in the equipment room to a common provided ground buss. The common system ground

shall be located in all telephone closets and the EPBX switch room.

- 12) Provide EPBX ground between EPBX and all interfaced systems such as PA system equipment chassis, etc.
- 13) Ensure that other dedicated telecommunications systems applications within the Facility (i.e., pay stations, electro-writing equipment, facsimile etc.) that require space within switch room/telephone closets, conduits, and cable pair are accommodated. Coordination between applicable parties will be necessary to ensure accommodation of these systems. It shall be the responsibility of the bidders to determine the requirements and include them in their proposal.
- 14) All portions of the System installation shall conform to local building and fire codes.
- 15) The Contractor shall not use gasoline, benzene, alcohol, naphtha, carbon tetrachloride, or turpentine for cleaning any part of the equipment. Flammable materials shall be kept in suitable places outside the building. OSHA safety standards and local Facility safety standards shall prevail.

D. Conduit, Cables And Wiring, Cable Tray, Raceways, Signal Ducts, Etc.

1. General:

- a. The Contractor shall employ the latest installation practices and materials.
- b. All cables shall be installed in conduit and/or signal ducts. Conduits shall be installed in accordance with Section 27 05 33, RACEWAYS AND BOXES FOR COMMUNICATIONS SYSTEMS and Section 27 15 00, COMMUNICATIONS HORIZONTAL CABLING.
- c. Ensure that Telephone, and PA Systems (as identified by NEC Section 517) are completely separated and protected from all other systems.

3.2 PROOF OF PERFORMANCE TESTS

A. Interim Inspection:

1. An interim inspection of the installed equipment will be conducted in the presence of the COTR prior to the proof of performance testing. This inspection shall verify that the equipment provided, adheres to the installation requirements of this document.
2. The Contractor shall have 50% of the system equipment installed to include, but not be limited to: EPBX, interface, origination and

- junction enclosures powered with the permanent AC wiring, outlets, conduit and cables, before the interim inspection can take place.
3. The Contractor shall notify the RE, in writing, of the estimated date the Contractor expects to be ready for the interim inspection, at least 7 working days before the requested inspection date.
 4. Results of the interim inspection shall be provided to the COTR and PM. If major or multiple deficiencies are discovered, a second interim inspection may be required before permitting the Contractor to continue with the System installation.
 5. The COTR in conjunction with PE shall determine if an additional inspection is required, or if the Contractor will be allowed to proceed with the installation. In either case, re-inspection of deficiencies noted during the interim inspection(s), will be part of the proof of performance test. The interim inspection shall not affect the Systems' completion date. The COTR shall ensure all test documents will become a part of the Systems record wiring diagrams.
- B. Pretesting. Upon completing the installation of the System, the Contractor shall align and balance the system. The Contractor shall pretest the entire system.
- C. Pretesting Procedure. During the System pretest, the Contractor shall verify (utilizing the approved spectrum analyzer and test equipment) that the System is fully operational and meets all the System performance requirements of this document. The Contractor shall measure and record the aural carrier levels of each system telephone, at each of the following points in the system:
1. Local Exchange Company (LEC) Inputs.
 2. EPBX inputs and outputs;
 3. MDU, BIU, amplifiers, channel processor and converter inputs and outputs.
 4. PBX output S/NR for each telephone.
 5. Signal Level at each interface point to the distribution system, the last outlet on each trunk line plus all outlets installed as part of this contract.
 6. Four copies of the recorded system pretest measurements shall be submitted, along with the pretest certification, to the COTR. The COTR shall forward three copies of the pretest documents and a copy of the certification to the PM.

D. Pretesting Certification. After pretesting the System, the Contractor shall notify the COTR, in writing, that the system is ready for proof of performance testing in the presence of a Government Representative, and that it meets all requirements stated in this document. The Contractor as described herein shall accomplish submission of this notification of system readiness no later than twenty (20) working days prior to the beginning of the scheduled Government proof of performance test. Failure of the Contractor to comply with these pretest requirements, shall be grounds for automatically canceling the scheduled acceptance test.

E. Acceptance Test

1. After the System has been pretested and the Contractor has submitted the pretest results and certification to the COTR, the Contractor shall schedule an acceptance test date and give the COTR 30 calendar days written notice prior to the date the acceptance test is expected to begin. The System shall be tested in the presence of a Government Representative and an OEM certified representative. The System shall be tested utilizing the approved test equipment to certify proof of performance. The test shall verify that the total System meets all the requirements of this document under operating conditions, and complies with all system performance standards listed herein. The notification of acceptance test shall include the expected length (in time) of the test.
2. The acceptance test shall be performed on a "go-no-go" basis. Only those operator adjustments required to show proof of performance shall be allowed. The test shall demonstrate and verify that the installed System does comply with all the operational requirements of this specification under operating conditions. The System shall be rated as either acceptable or unacceptable at the conclusion of the test. Failure of any part of the System that precludes completion of the system testing, and which cannot be repaired within four (4) hours, shall be cause for terminating the acceptance test of the System. Repeated failures that result in a cumulative time of eight (8) hours to effect repairs, shall cause the entire System to be declared unacceptable. Retesting of the entire System shall be rescheduled at the convenience of the Government.

F. Acceptance Test Procedure:

1. Mechanical and Physical Inspection:

- a. The Government Representative will tour all major areas where the System and all sub-systems are located to insure they are completely and properly installed in place and are operationally ready for proof of performance acceptance testing. A system inventory including available spare parts will be taken at this time. Each item of installed equipment shall be checked to ensure appropriate UL certification labels are affixed.
- b. The System diagrams, record drawings, equipment manuals, AutoCAD Disks, intermediate and pretest results shall be formally inventoried and reviewed.
- c. Failure of the System to meet the installation requirements of this specification shall be grounds for terminating all testing.

2. Subsystem Operational Test:

- a. After the Mechanical and Physical Inspection, the Contractor shall perform an operational test of each sub-system to verify that all equipment is properly connected, interfaced and is functionally operational to meet the requirements of this document. If any sub-system is not functionally ready, that sub-system shall be declared unacceptable and all testing shall be terminated. At this point, the Contractor shall be permitted one hour to correct the deficiencies.
- b. It may be mutually agreed upon, at this time, to wait one hour or to commence testing of the next sub-system.
- c. Repeated failures of sub-system testing or total system testing, which results in a cumulative time of four hours to effect repairs, shall be grounds for declaring the entire system unacceptable and all testing to be terminated. Retesting shall be rescheduled at the convenience of the Government.

3. Sub-system Performance Test: After the operational test, each sub-system shall be checked to verify that all performance requirements and standards are met. The performance requirements shall be verified using the necessary test equipment. A spectrum analyzer, signal level meter and BERT shall be used to verify there are no visible signal distortions, such as intermodulation, beats, etc. appearing on any received or generated telephone.

4. Total System Test: The testing shall proceed until the System and sub-systems have been operationally and functionally tested and accepted. The total System tests shall verify that the requirements have been met for all system signals as described herein.
 - a. LEC Point of Demarcation: The System output(s) shall be checked to verify that all performance requirements are met.
 - b. EPBX: This test shall be conducted within 30 calendar days following successful pretesting of the EPBX. In addition to compliance with the technical characteristics and quantities of equipment specified herein, the Final Acceptance Test shall contain the provision that 30 continuous days of uninterrupted telephone service, must be completed prior to the Contractor being deemed to be in compliance with the contract.
 - 1) For the purpose of final acceptance, the telephone service shall be considered interrupted when the failure of any Contractor provided telephone equipment including batteries, results in an interruption of service. This includes a failure of more than 20% of any trunk group, 15% of any number group (15 or more stations), operator console, or telephone service to any area determined to be critical by the Facility Director. Response time to restore service shall have no bearing upon the term "interrupted service".
 - 2) To facilitate the EPBX Acceptance Test and to allow familiarization and training of VA employees, the Contractor shall activate the EPBX, including the operator consoles, stations, and equipment a minimum of 30 calendar days prior to the acceptance test date. All installed equipment and circuits shall be fully tested prior to the acceptance by VA. During this "burn-in" period, the Contractor shall de-bug the EPBX. The Contractor shall make the EPBX available for in-house communications and demonstrate to the Facility staff the required features. The VA and Contractor will make certain trunks and tie line circuits available to the EPBX during this "burn-in" period for testing.
5. Individual Item Test: The Government Representative may select individual items of equipment for detailed proof-of-performance testing. The item(s) selected shall meet or exceed the minimum requirements of the specification.

6. Interface Cable Sub-system: To ensure that the System meets all performance requirements, a minimum of 75% of the System outlets and interface points shall be checked. Additionally, each sub-system interface, junction, and connection point or location will be checked. Each distribution active and passive item of equipment, signal input(s) and output(s) will be tested.
 7. Distribution Cable Plant Sub-system: For specific distribution testing instructions refer to Section 27 15 00, COMMUNICATIONS HORIZONTAL CABLING.
- G. Test Conclusion:
1. At the conclusion of the Acceptance Test, using the generated punch list (or discrepancy list) the VA and the Contractor shall jointly agree to the results of the test, and reschedule testing on deficiencies and shortages with the COTR. Any retesting to comply with these specifications will be done at the Contractor's expense.
 2. If the System is declared unacceptable without conditions, all rescheduled retest expenses will be born by the Contractor as described herein.

3.3 TRAINING

- A. Furnish the services of an OEM trained and certified engineer or technician for two eight-hour classes to instruct designated Facility maintenance personnel. Instruction shall include cross connection, corrective, and preventive maintenance of the telephone system and equipment.
- B. Also, furnish the services of an OEM trained and certified engineer or technician, familiar with the functions and operation of the System and equipment, for two eight-hour periods to train designated Facility IRM personnel. Instructions shall be provided for staff personnel in each area where the System is installed under this contract. When multiple areas are involved, classes will be grouped. Periods of training shall be coordinated with the COTR. The COTR shall coordinate with the Facility to ensure all shifts receive the required training. Each session shall include instructions utilizing "hands-on" operation and functions of the system.
- C. Before the System can be accepted by VA, this training must be accomplished. Training will be scheduled at the convenience of the Facilities Contracting Officer and Chief of Engineering Service.

3.4 GUARANTEE PERIOD OF SERVICE

- A. Contractor's Responsibility: The Contractor shall guarantee that all installed material and equipment will be free from defects, workmanship, and will remain so for a period of one year from date of final acceptance of the System by the VA. The Contractor shall provide OEM's equipment warranty documents, to the COTR (or the Facility Contracting Officer if the Facility has taken possession of the building), that certifies each item of equipment installed under this document conforms to its OEM published specifications.
- B. The Contractor shall provide a written commitment from the System equipment OEM to supply parts and on-site engineering support services for the one year guarantee service (materials and labor) in the event of default or unsatisfactory service by the Contractor.
 - 1. The OEM certification shall describe, in the event of default or unsatisfactory service by the Contractor, the OEM or an authorized distributor shall fully support the contract (initial installation, guarantee service for the one year warranty period of the contract).
 - 2. The System equipment OEM's signatory of the certified written commitment must be of an individual who has the full authority to obligate the OEM to this commitment. Names, corporate addresses, and telephone numbers of the individuals who have this authority shall be provided as a part of the commitment.
- C. The Contractor's maintenance personnel shall have the ability to contact the Contractor and OEM's central emergency assistance maintenance center and request remote diagnostic testing and assistance in resolving technical problems at any time, 365 days a year. The Contractor via a business telephone line at no additional cost shall provide this contact capability to VA. Each Contractor maintenance and supervisor individual shall be fully qualified by the OEM and provide the COTR and Facility Contracting Officer with copies of current and qualified OEM training certificates.
- D. Additionally, defining the FAR's warranty outlines concerning this System, the Contractor shall accomplish the following minimum requirements during the one year guarantee period:
 - 1. Response Time During the One Year Guarantee Period:
 - a. The Contractor shall respond on-site, during the standard workweek, to a routine trouble call within 24 hours of its

report. A routine trouble is considered a trouble that causes a sub-system to be inoperable.

- b. The Contractor shall respond on-site to an emergency trouble call within four hours of its report. An emergency trouble is considered a trouble that causes a System to be inoperable at anytime.
 - 1) An emergency trouble call shall be deemed appropriate when a failure involves more than 20 voice circuits.
 - 2) In addition, the failure of a common control unit, power supply, signal generating device or attendant console shall also be deemed as an emergency maintenance call.
- c. The Contractor shall respond on-site to a catastrophic trouble call within two hours of its report. A catastrophic trouble call is considered an EPBX failure.
 - 1) If an EPBX failure cannot be corrected within six hours, the Contractor shall be responsible for providing an alternate CPU equipped for a minimum of 100 main station lines, 10 CO trunks, 10 FTS access lines and two operator's console.
 - 2) This alternate system shall be operational within 12 hours (time to commence at the end of the six-hour trouble shooting period) and shall provide emergency service to critical areas as determined by the VAMC Director.
 - 3) The alternate system shall be a programmable system and a pre-written program tape shall be provided to the VAMC Contracting Officer prior to cut-over of the main telephone system.
- d. Failures affecting operation of critical emergency health care facilities (i.e., cardiac arrest teams, intensive care units, etc.) shall also be deemed as a catastrophic trouble call if so determined by the Facility Director. The Facility Contracting Officer shall notify the Contractor of this type of trouble call at the direction of the Facility Director.
- e. The Contractor shall respond on-site to installation of station or equipment requests or service within:
 - 1) Eight hours for emergency installations designated by the Facility Contracting Officer, and
 - 2) Three working days for routine installations designated by the Facility Contracting Officer.

- f. A standard workweek is considered 8:00 A.M. EST to 5:00 P.M. EST, Monday through Friday exclusive of Federal Holidays. If any trouble cannot be corrected within one working day, the Contractor shall furnish and install compatible substitute equipment returning the System or sub-system to full operational capability, as described herein, until repairs are completed.
 - g. The COTR and/or Facility Contracting Officer are the Contractor's reporting and contact officials for System trouble calls, during the guarantee period.
2. Required On-Site Visits During The One Year Guarantee Period
- a. The Contractor shall visit, on-site, for a minimum of eight hours, once every twelve (12) weeks, during the guarantee period, to perform system preventive maintenance, equipment cleaning and operational adjustments to maintain the System according the descriptions identified in this document.
 - 1) The Contractor shall arrange all Facility visits with the COTR or Facility Contracting Officer prior to performing the required maintenance visits.
 - 2) Preventive maintenance shall be performed by the Contractor in accordance with the OEM's recommended practice and service intervals during non-busy times agreed to by the COTR or Facility Contracting Officer and Contractor.
 - 3) The preventive maintenance schedule shall be provided to and approved by the COTR and Facility Contracting Officer.
 - 4) Provide on-site a stock of replacement spare parts and equipment, plus test equipment, as specified herein, ensuring they meet the OEM's minimum recommended spare parts stock sizing requirements for this specific system.
 - b. The Contractor shall provide the Facility Contracting Officer a type written report itemizing each deficiency found and the corrective action performed during each required visit or official reported trouble call. The Contractor shall provide the COTR with sample copies of these reports for review and approval at the beginning of the Acceptance Test. The following reports are the minimum required:
 - 1) The Contractor shall provide a monthly summary of all equipment and sub-systems serviced during this guarantee period to the COTR or Facility Contracting Officer by the

fifth working day after the end of each month. The report shall clearly and concisely describe the services rendered, parts replaced and repairs performed. The report shall prescribe anticipated future needs of the equipment and systems for preventive and predictive maintenance.

- 2) The Contractor shall maintain a separate log entry for each item of equipment and each sub-system of the System. The log shall list dates and times of all scheduled, routine, and emergency calls. Each emergency call shall be described with details of the nature and causes of emergency steps taken to rectify the situation and specific recommendations to avoid such conditions in the future. The COTR or Facility Contracting Officer shall convey to the Facility Engineering Officer, two (2) copies of actual reports for evaluation.
- 3) The COTR or Facility Contracting Officer shall ensure a copy of these reports is entered into the System's official acquisition documents.
- 4) The Facility Chief Engineer shall ensure a copy of these reports is entered into the System's official technical record documents.

3. Government Furnished Equipment (GFE). GFE that was accepted by the Contractor and interfaced and installed in this System shall become part of this System and included in the Guarantee requirements.

E. Work Not Included: Maintenance and repair service shall not include the performance of any work due to improper use; accidents; other vendor, contractor, or owner tampering or negligence, for which the Contractor is not directly responsible and does not control. The Contractor shall immediately notify the COTR or Facility Contracting Officer in writing upon discovery of these incidents. The COTR or Facility Contracting officer will investigate all reported incidents and render findings concerning any Contractor's responsibility.

- - E N D - -

SECTION 27 51 23
INTERCOMMUNICATIONS AND PROGRAM SYSTEMS

PART 1 - GENERAL

1.1 SECTION SUMMARY

- A. Work covered by this document includes design, engineering, labor, material, products, guaranty, training and services for, and incidental to, the complete installation of a new and fully operating National Fire Protection Association (NFPA) Listed Emergency/Public Safety Public Address and Mass Notification communication (PA) system as detailed herein.
- B. Work shall be complete, tested, labeled, certified and ready for operation

1.2 RELATED SECTIONS

- A. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA AND SAMPLES
- B. Section 26 05 21, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES (600 Volts and Below)
- C. Section 26 41 00, FACILITY LIGHTNING PROTECTION
- D. Section 27 05 26, GROUNDING AND BONDING FOR COMMUNICATIONS SYSTEMS
- E. Section 27 05 11, REQUIREMENTS FOR COMMUNICATIONS INSTALLATIONS
- F. Section 27 10 00, STRUCTURED CABLING
- G. Section 27 15 00, COMMUNICATIONS HORIZONTAL CABLING
- H. Section 27 05 33, RACEWAYS AND BOXES FOR COMMUNICATIONS SYSTEMS

1.3 DEFINITIONS

- A. Provide: Design, engineer, furnish, install, connect complete, test, certify and guarantee.
- B. Work: Materials furnished and completely installed.
- C. Review of contract drawings: A service by the engineer to reduce the possibility of materials being ordered which do not comply with contract documents. The engineer's review shall not relieve the Contractor of responsibility for dimensions or compliance with the contract documents. The reviewer's failure to detect an error does not constitute permission for the Contractor to proceed in error.
- D. Headquarters Technical Review, for National/VA communications and security, codes, frequency licensing, standards, guidelines compliance:
 - Office of Telecommunications
 - Special Communications Team (0050P2B)
 - 1335 East West Highway - 3rd Floor

Silver Spring, Maryland 20910

E. Contractor: Radio Contractor; you; successful bidder.

1.4 REFERENCES

A. The installation shall comply fully with all governing authorities, laws and ordinances, regulations, codes and standards, including, but not limited to:

1. United States Federal Law and Codes:

a. Departments of:

1) CFR, Title 15 - Department of Commerce, Under the Information Technology Management Reform Act (Public Law 104-106), the Secretary of Commerce approves standards and guidelines that are developed by the:

a) Chapter II, National Institute of Standards Technology (NIST - formerly the National Bureau of Standards). Under Section 5131 of the Information Technology Management Reform Act of 1996 and the Federal Information Security Management Act of 2002 (Public Law 107-347), NIST develops - Federal Information Processing Standards Publication (FIPS) 140-2-Security Requirements for Cryptographic Modules.

b) Chapter XXIII, National Telecommunications and Information Administration (NTIA - aka 'Red Book') Chapter 7.8/9 Federal communications Commission (FCC) Title 47 (CFR), Part 15, Radio Frequency Restriction of Use and Compliance in "Safety of Life" Functions and Locations.

2) CFR, Title 29, Department of Labor, Chapter XVII - Occupational Safety and Health Administration (OSHA), Part 1910 - Occupational Safety and Health Standard:

a) Subpart 7 - Definition and requirements for a National Recognized Testing Laboratory (NRTL - 15 Laboratory's, for complete list, contact http://www.osha.gov/dts/otpc/nrtl/faq_nrtl.html)

(1) Underwriter's Laboratories (UL):

65	Standard for Wired Cabinets.
468	Standard for Grounding and Bonding Equipment.
1449	Standard for Transient Voltage Surge

	Suppressors.
1069	Hospital Signaling and Nurse Call Equipment.
60950-1/2	Information Technology Equipment - Safety.

- (2) Canadian Standards Association (CSA): same tests as for UL.
- (3) Communications Certifications Laboratory (CCL): same tests as for UL.
- (4) Intertek Testing Services NA, Inc. (ITSNA formerly Edison Testing Laboratory [ETL]): same tests as for UL.
- b) Subpart 35, Compliance with NFPA 101 - Life Safety Code.
- c) Subpart 36, Design and construction requirements for exit routes.
- d) Subpart 268, Telecommunications.
- e) Subpart 305, Wiring methods, components, and equipment for general use.
- 3) Title 42, CFC, Department of Health, Chapter IV Health and Human Services, Subpart 1395(a) (b) Joint Commission on Accreditation of Healthcare Organizations (JCAHO) "a hospital that meets JCAHO accreditation is deemed to meet the Medicare conditions of Participation by meeting Federal Directives:" All guidelines for Life, Personal and Public Safety; and, Essential and Emergency Communications.
- 4) All guidelines for Life, Personal and Public Safety; and, Essential and Emergency Communications.
- 5) CFR, Title 47, Telecommunications, FCC: Part 15 - Restrictions of use for Part 15 listed Radio Equipment in Safety of Life/Emergency Functions/Equipment/Locations (also see CFR, Title 15, Department of Commerce, Chapter XXIII - NTIA).
- 6) Public Law No. 100-527, Department of Veterans Affairs:
 - a) Office of Telecommunications:
 - (1) Handbook 6100, Telecommunications.
 - b) Office of Cyber and Information Security (OCIS):
 - (1) Handbook 6500, Information Security Program.
 - (2) Wireless and Handheld Device Security Guideline Version 3.2, August 15, 2005.

- c) Spectrum Management FCC and NTIA Radio Frequency Compliance and Licensing Program.

2. National Codes:

- a. American Institute of Architects (AIA): Guidelines for Healthcare Facilities.
- b. American National Standards Institute and Electronic Industries Association/Telecommunications Industry Association (ANSI/EIA/TIA):

568-B	Commercial Building Telecommunications Wiring Standards:
569	Commercial Building Standard for Telecommunications Pathways and Spaces.
606	Administration Standard for the Telecommunications Infrastructure of Communications Buildings.
607	Commercial Building Grounding and Bonding Requirements for Telecommunications.
REC 127-49	Power Supplies.
RS 27	Tools, Crimping, Solderless Wiring Devices, Recommended Procedures for User Certification.

- c. Institute of Electrical and Electronics Engineers (IEEE):

SO/TR 21730:2007	Use of mobile wireless communication and computing technology in healthcare facilities - Recommendations for electromagnetic compatibility (management of unintentional electromagnetic interference) with medical devices.
0739- 5175/08/\$25. 00©2008IEEE	Medical Grade - Mission Critical - Wireless Networks.
C62.41	Surge Voltages in Low-Voltage AC Power Circuits.

- d. NFPA:

70	National Electrical Code (current date of issue)
----	--

	- Articles 517, 645 and 800.
75	Standard for Protection of Electronic Computer Data- Processing Equipment.
77	Recommended Practice on Static Electricity.
99	Healthcare Facilities.
101	Life Safety Code.

3. State Hospital Code(s).

4. Local Codes.

1.5 QUALIFICATIONS

- A. The OEM shall have had experience with three or more installations of Public Address Systems of comparable size and complexity with regards to type and design as specified herein. Each of these installations shall have performed satisfactorily for at least 1 year after final acceptance by the user. Include the names, locations and point of contact for these installations as a part of the submittal.
- B. The Contractor shall submit certified documentation that they have been an authorized distributor and service organization for the OEM for a minimum of 3 years. The Contractor shall be authorized by the OEM to pass thru the OEM's warranty of the installed equipment to VA. In addition, the OEM and Contractor shall accept complete responsibility for the design, installation, certification, operation, and physical support for the system. This documentation, along with the system Contractor and OEM certifications must be provided in writing as part of the Contractor's Technical submittal.
- C. The Contractor's Communications Technicians assigned to the system shall be fully trained, qualified, and certified by the OEM on the engineering, installation, operation, and testing of the system. The Contractor shall provide formal written evidence of current OEM certification(s) for the installer(s) as a part of the submittal or to the Contracting Officer's Technical Representative (COTR) before being allowed to commence work on the system.
- D. Applicable national, state and local licenses.
- E. Certificate of successful completion of OEM's installation and training school for installing technicians of the equipment being proposed.

1.6 CODES AND PERMITS

- A. Provide all necessary permits and schedule all inspections as identified in the contract's milestone chart, so that the system is

proof of performance tested and ready for operation on a date directed by the Owner.

- B. The Contractor is responsible to adhere to all codes described herein and associated contractual, state and local codes.

1.7 SCHEDULING

- A. After the award of contract, the Contractor shall prepare a detailed schedule (aka milestone chart) using "Microsoft Project" software or equivalent. The Contractor Project Schedule (CPS) shall indicate detailed activities for the projected life of the project. The CPS shall consist of detailed activities and their restraining relationships. It will also detail manpower usage throughout the project.
- B. It is the responsibility of the Contractor to coordinate all work with the other trades for scheduling, rough-in, and finishing all work specified. The owner will not be liable for any additional costs due to missed dates or poor coordination of the supplying contractor with other trades.

1.8 REVIEW OF CONTRACT DRAWINGS AND EQUIPMENT DATA SUBMITTALS

- A. Submit at one time within 10 working days of contract awarding, drawings and product data on all proposed equipment and system. Check for compliance with contract documents and certify compliance with Contractor's "APPROVED" stamp and signature.
- B. Support all submittals with descriptive materials, i.e., catalog sheets, product data sheets, diagrams, and charts published by the manufacturer. These materials shall show conformance to specification and drawing requirements.
- C. Where multiple products are listed on a single cut-sheet, circle or highlight the one that you propose to use. Provide a complete and through equipment list of equipment expected to be installed in the system, with spares, as a part of the submittal. Special Communications (0050P3B - herein after referred to as 0050P3B) will not review any submittal that does not have this list.
- D. Provide four copies to the COTR for technical review. The COTR will provide a copy to the offices identified in Paragraph 1.3.C and D, at a minimum for compliance review as described herein where each responsible individual(s) shall respond to the COTR within 10 working days of receipt of their acceptance or rejection of the submittal(s).

1.9 PROJECT RECORD DOCUMENTS (AS BUILTS)

- A. Throughout progress of the work, maintain an accurate record of changes in Contract Documents. Upon completion of Work, transfer recorded changes to a set of Project Record Documents.
- B. The floor plans shall be marked in pen to include the following:
 - 1. All device locations with labels.
 - 2. Conduit locations.
 - 3. Head-end equipment and specific location.
 - 4. Wiring diagram.
 - 5. Labeling and administration documentation.
 - 6. Warranty certificate.
 - 7. System test results.

1.10 WARRANTIES AND GUARANTY

- A. The Contractor shall warrant the installation to be free from defect in material and workmanship for a period of 1 year from the date of acceptance of the project by the owner. The Contractor shall agree to remedy covered defects within 8 hours of notification of major failures or within twenty-four (24) hours of notification for individual station related problems.
- B. Refer to Part 4 for applicable System Guarantee requirements.

1.11 USE OF THE SITE

- A. Use of the site shall be at the GC's direction.
- B. Coordinate with the GC for lay-down areas for product storage and administration areas.
- C. Coordinate work with the GC and their sub-contractors.
- D. Access to buildings wherein the work is performed shall be directed by the GC.

1.12 DELIVERY, STORAGE, AND HANDLING

- A. Deliver, store, and handle products using means and methods that will prevent damage, deterioration, and loss, including theft.
- B. Store products in original containers.
- C. Coordinate with the GC for product storage. There may be little or no storage space available on site. Plan to potentially store materials off site.
- D. Do not install damaged products. Remove damaged products from the site and replaced with new product at no cost to the Owner.

1.13 PROJECT CLOSE-OUT

- A. Prior to final inspection and acceptance of the work, remove all debris, rubbish, waste material, tools, construction equipment, machinery and surplus materials from the project site and thoroughly clean your work area.
- B. Before the project closeout date, the Contractor shall submit:
 - 1. Warranty certificate.
 - 2. Evidence of compliance with requirements of governing authorities such as the Low Voltage Certificate of Inspection.
 - 3. Project record documents.
 - 4. Instruction manuals and software that is a part of the system.
- C. Contractor shall submit written notice that:
 - 1. Contract Documents have been reviewed.
 - 2. Project has been inspected for compliance with contract.
 - 3. Work has been completed in accordance with the contract

PART 2 - PRODUCTS AND FUNCTIONAL REQUIREMENTS**2.1 GENERAL REQUIREMENTS FOR EQUIPMENT AND MATERIALS**

- A. Coordinate features and select components to form an integrated system. Match components and interconnections for optimum performance of specified functions.
- B. Expansion Capability: Increase number of stations in the future by 25 percent above those indicated without adding any internal or external components or main trunk cable conductors.
- C. Equipment: Modular type using solid-state components, fully rated for continuous duty unless otherwise indicated. Select equipment for normal operation on input power usually supplied at 110 to 130 V, 60 Hz.
- D. Weather-Resistant Equipment: Listed and labeled by an OSHA certified National Recognized Testing Laboratory (NRTL - i.e. UL) for duty outdoors or in damp locations.

2.2 SYSTEM DESCRIPTION

- A. The intercom system shall allow voice communication between existing master station at the existing operator's booth.
- B. All necessary equipment required to meet the intent of these specifications, whether or not enumerated within these specifications, shall be supplied and installed to provide a complete and operating nurse and patient communications network.
- C. Systems firmware shall be the product of a reputable firmware OEM of record with a proven history of product reliability and sole control

over all source code. Manufacturer shall provide, free of charge, product firmware and software upgrades for a period of two years from date of acceptance by VA for any product feature enhancements. System configuration programming changes shall not require any exchange of parts and shall be capable of being executed remotely via a modem connection (when specifically approved by 005OP3B).

- D. The Intercom System (IC) equipment shall be located in room A119. The IC equipment shall be capable of being connected to the existing phone system.
- E. When the IC system is approved to connect to a separate communications system (i.e. LAN, WAN, Telephone, Nurse Call, radio paging, wireless systems, etc) the connection point shall meet the following minimum requirements for each hard wired connection (note each wireless system connection MUST BE APPROVED PRIOR TO CONTRACT BID BY VA HEADQUARTERS 005OP3B AND 005OP2B):
 - 1. UL 60950-1/2.
 - 2. FIPS 142.
 - 3. FCC Part 15 Listed Radio Equipment is not allowed.
- F. Contractor is responsible for pricing all accessories and miscellaneous equipment required to form a complete and operating system. Unless otherwise noted in this Part, equipment quantities shall be as indicated on the drawings.

2.3 MANUFACTURERS

- A. The products specified shall be new, UL Listed, and produced by OEM manufacturer of record.
- B. The following equipment items are the salient requirements of VA to provide an acceptable system described herein.
- C. Provide speakers by manufacture equal to or compatible with Nutone.

2.4 FUNCTIONAL DESCRIPTION OF SWITCHED SYSTEMS

- A. Manually Switched:
 - 1. Master Station:
 - a. Communicating selectively with other master and speaker-microphone stations by actuating selector switches.
 - b. Communicating simultaneously with all other stations by actuating a single all-call switch.
 - c. Communicating with individual stations in privacy.
 - d. Including other master-station connections in a multiple-station conference call.

- e. Overriding any conversation by a designated master station.
- 2. Room Speaker-Microphone Station:
 - a. Having privacy from remote monitoring without a warning tone signal at monitored station. Designated speaker-microphone stations have a privacy switch to prevent another station from listening and to permit incoming calls.
 - b. Communicating hands free.
 - c. Calling master station by actuating call switch.
 - d. Returning a busy signal to indicate that station is already in use.
 - e. Being free of noise and distortion during operation and when in standby mode.
- 3. Speakers: Free of noise and distortion during operation and when in standby mode.
- B. Microprocessor-Switched:
 - 1. Master Station:
 - a. Communicating selectively with other master and speaker-microphone stations by dialing station's number on a 12-digit keypad.
 - b. Communicating simultaneously with all other stations by dialing a designated number on a 12-digit key-pad.
 - c. Communicating with individual stations in privacy.
 - d. Including other master-station connections in a multiple-station conference call.
 - e. Accessing separate paging speakers or groups of paging speakers by dialing designated numbers on a 12-digit keypad.
 - f. Overriding any conversation by a designated master station.
 - g. Displaying selected station.
 - h. Volume Control: Regulates incoming-call volume.
 - i. Identifies calling stations and stations in use. LED remains on until call is answered.
 - j. Momentary audible tone signal announces incoming calls.
 - k. Handset with Hook Switch: Telephone type with 18-inch- long, permanently coiled cord. Arrange to disconnect speaker when handset is lifted.
 - l. Reset Control: Cancels call and resets system for next call.
 - m. Equipment Cabinet: Comply with TIA/EIA-310-D. Lockable, ventilated metal cabinet houses terminal strips, power supplies,

amplifiers, system volume control, and other switching and control devices required for conversation channels and control functions

n. Vertical Equipment Rack:

- 1) 28" (16RU) rack space. Welded Steel construction. Minimum 78" usable depth. Adjustable front mounting rails.
- 2) Install the following products in rack provided by same manufacturer or as specified:
 - a) Security screws w/ nylon isolation bushings.
 - b) Textured blank panels.
 - c) Custom mounts for components without rack mount kits.
 - d) Security covers.
 - e) Copper Bus Bar.
 - f) Power Sequencer- rack-mounted power conditioner and (provide as-needed) delayed sequencer(s) with (2) unswitched outlets each and contact closure control inputs.

2. Room Speaker-Microphone Station:

- a. Having privacy from remote monitoring without a warning tone signal at monitored station. Designated speaker-microphone stations have a privacy switch to prevent another station from listening and to permit incoming calls.
- b. Communicating hands free.
- c. Calling master station by actuating call switch.
- d. Returning a busy signal to indicate that station is already in use.
- e. Being free of noise and distortion during operation and when in standby mode.

C. Wireless:

1. Radio Paging Equipment and Systems:

- a. The IC system shall have the ability to interface ONLY with VA Certified and Licensed radio paging system (FCC Part 15 listed pagers and transmitters are not allowed for "Safety of Life" functions or installed in those specific areas. VA Headquarters TVE - 0050PB2 and SM - 0050PB2 are the ONLY approving authorities for this function) and must have the following minimum system features:

- 1) Ability to pass-through location information (such as a room number) and call-type as well as other text messages simultaneously to shift supervisor identified staff members
- 2) System shall allow the operator to select staff members by name and pager number and to select a message consisting of a room number and a condition code (aka priority level). Operator may also choose to type in a unique alpha-numeric text message (the text message shall meet or exceed all HIPA and VA OCIS Communications Security Guidelines for the transmission of Patient or Staff Specific information [aka PII] - VA Headquarters TVE - 0050P2B is the approving authority for this function) into the system to be read by the holder of the pager unit.
- 3) While a patient station is connected to the nurse's master station, the system shall allow the operator to automatically page the staff member assigned to that room. An alternate staff member may be selected for paging purposes in place of the primary staff member. The system must allow an alternate staff member to be paged when the primary staff member is unable to respond to patient's needs within a specified period of time. The system must have the ability to assign any bed to any pager or pager group, and to assign an unlimited amount of pagers to any patient bed.
- 4) System shall have the ability to send all code blue calls to staff members by predetermined group (as required) automatically by simply pressing one "Code Blue" button. Pager shall indicate room number of code call, and state "Code Blue" in plain English format on pagers (FCC Part 15 listed pagers are not allowed to be use as "Safety of Life" functions or those specific locations. VA Headquarters TVE - 0050P2B is the approving authority for this requirement).

2. Personal Wireless Communicator:

- a. The IC system will only be allowed to connect to the personal wireless communications system, pass text data and provide a 2-way communication between the Telephone Interface and the personal wireless communicator as long as it is not a FCC Part 15 listed device(s), meets or exceeds UL 60950-1/2, meets OCIS Guide Lines for FIPS 140-2 certification and the using staff shows an

extensive training program along with recertification(s) according to the Facility Emergency Plan concerning HIPA requirements.

- b. VA Headquarters TVE - 0050P3B and SM - 0050P2B are the approving authority for this requirement.

3. Other Wireless Equipment/Systems:

- a. Each proposed wireless system and/or equipment to be connected to or be a part of the IC system, each shall meet the minimum requirements outlines in Paragraph 2.7.A.
- b. Contact TVE - 0050P3B and SM - 0050P2B for specific required pre-approvals (full or conditional) as described herein.

2.5 HEAD-END EQUIPMENT

- A. Provide all required power supplies, communications hubs, network switches, intelligent controllers and other devices necessary to form a complete system. Head-end components may be rack mounted or wall mounted in a metal enclosure.
- B. Provide the head-end equipment in the closed telecommunications closet where the IC system is installed to include at a minimum the equipment listed in Paragraph 2.3.
- C. Provide minimum of 15 minute battery back-up to system components.
- D. Equipment Cabinet: Comply with TIA/EIA-310-D. Lockable, ventilated metal cabinet houses terminal strips, power supplies, amplifiers, system volume control, and other switching and control devices required for conversation channels and control functions
- E. Vertical Equipment Rack, Wall Mounted (to be included inside of the Equipment Cabinet):
 - 1. 28 inch (16RU) rack space. Welded Steel construction. Minimum 20 inch usable depth. Adjustable front mounting rails.
 - 2. Install the following products in rack provided by same manufacturer or as specified:
 - a. Security screws w/ nylon isolation bushings.
 - b. Textured blank panels.
 - c. Custom mounts for components without rack mount kits.
 - d. Security covers.
 - e. Copper Bus Bar.
 - f. Power Sequencer- rack-mounted power conditioner and (provide as-needed) delayed sequencer(s) with (2) unswitched outlets each and contact closure control inputs.

2.6 SYSTEM CABLES

- A. Refer to OFM approved Master Construction Specification, SECTION 27 10 00, STRUCTURED CABLING for specific installation and testing requirements.
- B. Conductors: Jacketed, twisted pair and twisted multipair, untinned solid copper. Sizes as recommended by system manufacturer, but no smaller than No. 22 AWG.
- C. Insulation: Thermoplastic, not less than 1/32 inch thick.
- D. Shielding: For speaker-microphone leads and elsewhere where recommended by manufacturer; No. 34 AWG, tinned, soft-copper strands formed into a braid or equivalent foil.
- E. Minimum Shielding Coverage on Conductors: 60 percent.
- F. All cabling shall be plenum rated.
- G. Provide one spare 1,000 foot roll of approved system (not microphone) cable only.

2.7 RACEWAYS

- A. Intercommunication and Program System Raceways and Boxes: Comply with requirements in Division 26, Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS.
- B. Each raceway that is open top, shall be: UL certified for telecommunications systems, partitioned with metal partitions in order to comply with NEC Parts 517 and 800 to "mechanically separate telecommunications systems of different service, protect the installed cables from falling out when vertically mounted and allow junction boxes to be attached to the side to interface "drop" type conduit cable feeds.
- C. Intercommunication System Cable Infrastructure: EMT or in J-hooks above accessible ceilings, 24 inches on center.
- D. Junction boxes shall be not less than 2-1/2 inches deep and 6 inches wide by 6 inches long.
- E. Flexible metal conduit is prohibited unless specifically approved by 0050P3B.
- F. Install manufactured conduit sweeps and long-radius elbows whenever possible

2.8 SYSTEM CONDUIT

- A. The nurse call/code blue system is NFPA listed as Emergency/Public Safety Communication System that requires the entire system to be installed in a separate conduit system.

- B. The use of centralized mechanically partitioned wireways may be used to augment main distribution conduit on a case by case basis when specifically approved by VA Headquarters (0050P3B).

2.9 CONDUIT SLEEVES

- A. The Engineer has made a good effort to identify where conduit sleeves through full-height and fire rated walls on the drawings, and has instructed the electrician to provide the sleeves as shown on the drawings.
- B. While the sleeves shown on the drawings will be provided by others, the contractor is responsible for installing conduit sleeves and fire-proofing where necessary. It is often the case, that due to field conditions, the nurse-call cable may have to be installed through an alternate route. Any conduit sleeves required due to field conditions or those omitted by the engineer shall be provided by the cabling contractor.

2.10 DEVICE BACKBOXES

- A. Furnish to the electrical contractor all backboxes required for the PAS devices.
- B. The electrical contractor shall install the backboxes as well as the system conduit. Coordinate the delivery of the backboxes with the construction schedule.

2.11 UNINTERRUPTIBLE POWER SUPPLY (UPS)

- A. Provide a backup battery or a UPS for the system to allow normal operation and function (as if there was no AC power failure) in the event of an AC power failure or during input power fluctuations for a minimum of 15 minutes.
- B. As an alternate solution, the telephone system UPS may be utilized to meet this requirement at the head-end location, as long as this function is specifically approved by the Telephone Contractor and the RE.
- C. The PA Contractor shall not make any attachments or connection to the telephone system until specifically directed to do so, in writing, by the RE.
- D. Provide UPS for all active system components including but not limited to:
 - 1. System Amplifiers.
 - 2. Microphone Consoles.
 - 3. System Interface Units.

4. Head-end Equipment Rack(s).

PART 3 - EXECUTION

3.1 PROJECT MANAGEMENT

- A. Assign a single project manager to this project who will serve as the point of contact for the Owner, the General Contractor, and the Engineer.
- B. The Contractor shall be proactive in scheduling work at the hospital, specifically the Contractor will initiate and maintain discussion with the general contractor regarding the schedule for ceiling cover up and install cables to meet that schedule.
- C. Contact the Office of Telecommunications, Special Communications Team (0050P3B) at (301) 734-0350 to have a VA Certified Telecommunications COTR assigned to the project for telecommunications review, equipment and system approval and co-ordination with VA's Spectrum Management and OCIS Teams.

3.2 COORDINATION WITH OTHER TRADES

- A. Coordinate with the cabling contractor the location of intercom equipment in the Telecommunications Closets.
- B. Before beginning work, verify the location, quantity, size and access for the following:
 1. Isolated ground AC power circuits provided for systems.
 2. Junction boxes, wall boxes, wire troughs, conduit stubs and other related infrastructure for the systems.
 3. System components installed by others.
 4. Overhead supports and rigging hardware installed by others.
- C. Immediately notify the Owner, General Contractor and Consultant in writing of any discrepancies.

3.3 NEEDS ASSESSMENT

Provide a one-on-one meeting with the particular nursing manager of each unit affected by the installation of the new nurse call/code blue system. Review the floor plan drawing, educate the nursing manager with the functions of the equipment that is being provided and gather details specific to the individual units; coverage and priorities of calls; staffing patterns; and other pertinent details that will affect system programming and training

3.4 INSTALLATION

- A. General:

1. Execute work in accordance with National, State and local codes, regulations and ordinances.
 2. Install work neatly, plumb and square and in a manner consistent with standard industry practice. Carefully protect work from dust, paint and moisture as dictated by site conditions. The Contractor will be fully responsible for protection of his work during the construction phase up until final acceptance by the Owner.
 3. Install equipment according to OEM's recommendations. Provide any hardware, adaptors, brackets, rack mount kits or other accessories recommended by OEM for correct assembly and installation.
 4. Secure equipment firmly in place, including receptacles, speakers, equipment racks, system cables, etc.:
 - a. All supports, mounts, fasteners, attachments and attachment points shall support their loads with a safety factor of at least 5:1.
 - b. Do not impose the weight of equipment or fixtures on supports provided for other trades or systems.
 - c. Any suspended equipment or associated hardware must be certified by the OEM for overhead suspension.
 - d. The Contractor is responsible for means and methods in the design, fabrication, installation and certification of any supports, mounts, fasteners and attachments.
 5. Finishes for any exposed work such as plates, racks, panels, speakers, etc. shall be approved by the Architect, Owner and 0050P3B.
 6. Coordinate cover plates with field conditions. Size and install cover plates as necessary to hide joints between back boxes and surrounding wall. Where cover plates are not fitted with connectors, provide grommeted holes in size and quantity required. Do not allow cable to leave or enter boxes without cover plates installed.
- B. Equipment Racks:
1. Fill unused equipment mounting spaces with blank panels or vent panels. Match color to equipment racks.
 2. Provide security covers for all devices not requiring routine operator control.
 3. Provide vent panels and cooling fans as required for the operation of equipment within the OEM' specified temperature limits. Provide adequate ventilation space between equipment for cooling. Follow

manufacturer's recommendations regarding ventilation space between amplifiers.

4. Provide insulated connections of the electrical raceway to equipment racks.
 5. Provide continuous raceway/conduit with no more than 40 percent fill between wire troughs and equipment racks for all non-plenum-rated cable. Ensure each system is mechanically separated from each other in the wireway.
- C. Wiring Practice: In addition to the mandatory infrastructure requirements outlined in VA Construction Specification, Section 27 10 00, STRUCTURED CABLING, the following additional practices shall be adhered to:
1. Comply with requirements for raceways and boxes specified in Division 26, Section 27 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS.
 2. Execute all wiring in strict adherence to the National Electrical Code, applicable local building codes and standard industry practices.
 3. Where raceway is to be EMT (conduit), wiring of differing classifications shall be run in separate conduit. Where raceway is to be an enclosure (rack, tray, wire trough, utility box) wiring of differing classifications which share the same enclosure shall be mechanically partitioned and separated by at least 4 inches. Where Wiring of differing classifications must cross, they shall cross perpendicular to one another.
 4. Do not splice wiring anywhere along the entire length of the run. Make sure cables are fully insulated and shielded from each other and from the raceway for the entire length of the run.
 5. Do not pull wire through any enclosure where a change of raceway alignment or direction occurs. Do not bend wires to less than radius recommended by manufacturer.
 6. Replace the entire length of the run of any wire or cable that is damaged or abraided during installation. There are no acceptable methods of repairing damaged or abraided wiring.
 7. Use wire pulling lubricants and pulling tensions as recommended by the OEM.
 8. Use grommets around cut-outs and knock-outs where conduit or chase nipples are not installed.

9. Do not use tape-based or glue-based cable anchors.
10. Ground shields and drain wires as indicated by the drawings.
11. Field wiring entering equipment racks shall be terminated as follows:
 - a. Provide ample service loops at harness break-outs and at plates, panels and equipment. Loops should be sufficient to allow plates, panels and equipment to be removed for service and inspection.
 - b. Line level and speaker level wiring may be terminated inside the equipment rack using specified terminal blocks (see "Products.") Provide 15 percent spare terminals inside each rack. Microphone level wiring may only be terminated at the equipment served.
 - c. If specified terminal blocks are not designed for rack mounting, utilize 3/4 inch plywood or 1/8 inch thick aluminum plates/blank panels as a mounting surface. Do not mount on the bottom of the rack.
 - d. Employ permanent strain relief for any cable with an outside diameter of 1 inch or greater.
12. Use only balanced audio circuits unless noted otherwise
13. Make all connections as follows:
 - a. Make all connections using rosin-core solder or mechanical connectors appropriate to the application.
 - b. For crimp-type connections, use only tools that are specified by the manufacturer for the application.
 - c. Use only insulated spade lugs on screw terminals. Spade lugs shall be sized to fit the wire gauge. Do not exceed two lugs per terminal.
 - d. Wire nuts, electrical tape or "Scotch Lock" connections are not acceptable for any application.
- D. Cable Installation - In addition to the mandatory infrastructure requirements outlined in VA Master Construction Specification, Section 27 10 00, STRUCTURED CABLING, the following additional practices shall be adhered to:
 1. Support cable on maximum 4'-0" centers. Acceptable means of cable support are cable tray, j-hooks, and bridal rings. Velcro wrap cable bundles loosely to the means of support with plenum rated Velcro straps. Plastic tie wraps are not acceptable as a means to bundle cables.
 2. Run cables parallel to walls.

3. Install maximum of 10 cables in a single row of J-hooks. Provide necessary rows of J-hooks as required by the number of cables.
4. Do not lay cables on top of light fixtures, ceiling tiles, mechanical equipment, or ductwork. Maintain at least 2 feet clearance from all shielded electrical apparatus.
5. All cables shall be tested after the total installation is fully complete. All test results are to be documented. All cables shall pass acceptable test requirements and levels. Contractor shall remedy any cabling problems or defects in order to pass or comply with testing. This includes the re-pull of new cable as required at no additional cost to the Owner.
6. Ends of cables shall be properly terminated on both ends per industry and OEM's recommendations.
7. Provide proper temporary protection of cable after pulling is complete before final dressing and terminations are complete. Do not leave cable lying on floor. Bundle and tie wrap up off of the floor until you are ready to terminate.
8. Cover the end of the overall jacket with a 1 inch (minimum) length of transparent heat-shrink tubing. Cut unused insulated conductors 2 inches (minimum) past the heat-shrink, fold back over jacket and secure with cable-tie. Cut unused shield/drain wires 2 inches (minimum) past the Heat-shrink and serve as indicated below.
9. Cover shield/drain wires with heat-shrink tubing extending back to the overall jacket. Extend tubing 1/4 inch past the end of unused wires, fold back over jacket and secure with cable tie.
10. For each solder-type connection, cover the bare wire and solder connection with heat-shrink tubing.
11. Terminate conductors; no cable shall contain unterminated elements. Make terminations only at outlets and terminals.
12. Splices, Taps, and Terminations: Arrange on numbered terminal strips in junction, pull, and outlet boxes; terminal cabinets; and equipment enclosures. Cables may not be spliced.
13. Bundle, lace, and train conductors to terminal points without exceeding OEM's limitations on bending radii. Install lacing bars and distribution spools.
14. Cold-Weather Installation: Bring cable to room temperature before dereeling. Heat lamps shall not be used.

15. Cable shall not be run through structural members or be in contact with pipes, ducts, or other potentially damaging items.
 16. Separation of Wires: (Refer to Raceway Installation) Separate speaker-microphone, line-level, speaker-level, and power wiring runs. Install in separate raceways or, where exposed or in same enclosure, separate conductors at least 12 inches apart for speaker microphones and adjacent parallel power and telephone wiring. Separate other intercommunication equipment conductors as recommended by equipment manufacturer.
 17. Serve all cables as follows:
 - a. Cover the end of the overall jacket with a 1 inch (minimum) length of transparent heat-shrink tubing. Cut unused insulated conductors 2 inches (minimum) past the heat-shrink, fold back over jacket and secure with cable-tie. Cut unused shield/drain wires 2 inches (minimum) past the Heat-shrink and serve as indicated below.
 - b. Cover shield/drain wires with heat-shrink tubing extending back to the overall jacket. Extend tubing 1/4 inch past the end of unused wires, fold back over jacket and secure with cable tie.
 - c. For each solder-type connection, cover the bare wire and solder connection with heat-shrink tubing.
- E. Labeling:
1. Clearly, consistently, logically and permanently mark switches, connectors, jacks, relays, receptacles and electronic and other equipment.
 2. Engrave and paint fill all receptacle panels using 1/8 inch (minimum) high lettering and contrasting paint.
 3. For rack-mounted equipment, use engraved Lamacoid labels with white 1/8 inch (minimum) high lettering on black background. Label the front and back of all rack-mounted equipment
 4. Where multiple pieces of equipment reside in the same rack group, clearly and logically label each indicating to which room, channel, receptacle location, etc. they correspond.
 5. Permanently label cables at each end, including intra-rack connections. Labels shall be covered by the same, transparent heat-shrink tubing covering the end of the overall jacket. Alternatively, computer generated labels of the type which include a clear protective wrap may be used.

6. Contractor's name shall appear no more than once on each continuous set of racks. The Contractor's name shall not appear on wall plates or portable equipment.
7. Ensure each OEM supplied equipment has appropriate UL Labels/Marks for the service the equipment is performed permanently attached and marked. Equipment installed not bearing these UL marks will not be allowed to be a part of the PAS System. The Contractor shall bear all costs required to provide replacement equipment with approved UL marks.

3.5 PROTECTION OF NETWORK DEVICES

Contractor shall protect network devices during unpacking and installation by wearing manufacturer approved electrostatic discharge (ESD) wrist straps tied to chassis ground. The wrist strap shall meet OSHA requirements for prevention of electrical shock, should technician come in contact with high voltage.

3.6 CUTTING AND PATCHING

- A. It shall be the responsibility of the contractor to keep their work area clear of debris and clean area daily at completion of work.
- B. It shall be the responsibility of the contractor to patch and paint any wall or surface that has been disturbed by the execution of this work.
- C. The Contractor shall be responsible for providing any additional cutting, drilling, fitting or patching required that is not indicated as provided by others to complete the Work or to make its parts fit together properly.
- D. The Contractor shall not damage or endanger a portion of the work or fully or partially completed construction of the Owner or separate contractors by cutting, patching or otherwise altering such construction, or by excavation. The Contractor shall not cut or otherwise alter such construction by the Owner or a separate contractor except with written consent of the Owner and of such separate contractor; such consent shall not be unreasonably withheld. The Contractor shall not unreasonably withhold from the Owner or a separate Contractor the Contractor's consent to cutting or otherwise altering the work.
- E. Where coring of existing (previously installed) concrete is specified or required, including coring indicated under unit prices, the location of such coring shall be clearly identified in the field and the

location shall be approved by the Project Manager prior to commencement of coring work.

3.7 FIREPROOFING

- A. Where nurse-call cables penetrate fire rated walls, floors and ceilings, fireproof the opening.
- B. Provide conduit sleeves (if not already provided by electrical contractor) for cables that penetrate fire rated walls. After the cabling installation is complete, install fire proofing material in and around all conduit sleeves and openings. Install fire proofing material thoroughly and neatly. Seal all floor and ceiling penetrations.
- C. Use only materials and methods that preserve the integrity of the fire stopping system and its rating.

3.8 GROUNDING

- A. Ground cable shields and equipment to eliminate shock hazard and to minimize ground loops, commonmode returns, noise pickup, cross talk, and other impairments.
- B. Signal Ground Terminal: Locate at main equipment cabinet. Isolate from power system and equipment grounding.
- C. Install grounding electrodes as specified in Division 26 Section "Grounding and Bonding for Electrical Systems."
- D. Do not use "3rd or 4th" wire internal electrical system conductors for ground.
- E. Do not connect system ground to the building's external lightning protection system.
- F. Do not "mix grounds" of different systems.

PART 4 - TESTING, GUARANTY AND TRAINING

4.1 PROOF OF PERFORMANCE TESTING

- A. Acceptance Test:
 - 1. The Contractor shall schedule an acceptance test date and give the COTR 30 calendar days written notice prior to the date the acceptance test is expected to begin. The system shall be tested in the presence of a Government Representative and an OEM certified representative. The system shall be tested utilizing the approved test equipment to certify proof of performance and Emergency compliance. The test shall verify that the total system meets all the requirements of this specification. The notification of the acceptance test shall include the expected length (in time) of the test.

B. Acceptance Test Procedure:

1. Physical and Mechanical Inspection:

- a. The Government Representative will tour all areas where the system and all sub-systems are completely and properly installed to insure they are operationally ready for proof of performance testing. A system inventory including available spare parts will be taken at this time. Each item of installed equipment shall be checked to ensure appropriate UL certification labels are affixed.
- b. The system diagrams, record drawings, equipment manuals, Auto CAD Disks, intermediate, and pretest results shall be formally inventoried and reviewed.
- c. Failure of the system to meet the installation requirements of this specification shall be grounds for terminating all testing.

2. Operational Test:

- a. The Contractor shall demonstrate the full functionality of the system including:
 - 1. Station to master calls
 - 2. Station to station calls
 - 3. Broadcast calls
 - 4. Location identification of stations at the intercom master station

3. Test Conclusion:

- a. At the conclusion of the Acceptance Test, using the generated punch list (or discrepancy list) the VA and the Contractor shall jointly agree to the results of the test, and reschedule testing on deficiencies and shortages with the RE. Any retesting to comply with these specifications will be done at the Contractor's expense.
- b. If the system is declared unacceptable without conditions, all rescheduled testing expenses will be bore by the Contractor.

4.2 SYSTEM GUARANTEE PERIOD OF SERVICE

A. Contractor's Responsibility:

- 1. The Contractor shall guarantee that all provided material and equipment will be free from defects, workmanship and will remain so for a period of one year from date of final acceptance of the system by the VA. The Contractor shall provide OEM's equipment warranty documents, to the COTR (or Facility Contracting Officer if the

Facility has taken possession of the building), that certifies each item of equipment installed conforms to OEM published specifications.

2. The Contractor's maintenance personnel shall have the ability to contact the Contractor and OEM for emergency maintenance and logistic assistance, remote diagnostic testing, and assistance in resolving technical problems at any time. This contact capability shall be provided by the Contractor and OEM at no additional cost to the VA.
3. All Contractor maintenance and supervisor personnel shall be fully qualified by the OEM and must provide two copies of current and qualified OEM training certificates and OEM certification upon request.
4. Additionally, the Contractor shall accomplish the following minimum requirements during the two year guaranty period:
 - a. Response Time during the Two Year Guaranty Period:
 - 1) The COTR (or Facility Contracting Officer if the system has been turned over to the Facility) is the Contractor's ONLY OFFICIAL reporting and contact official for nurse call system trouble calls, during the guaranty period.
 - 2) A standard work week is considered 8:00 A.M. EST to 5:00 P.M. EST or as designated by the COTR (or Facility Contracting Officer), Monday through Friday exclusive of Federal Holidays.
 - 3) The Contractor shall respond and correct on-site trouble calls, during the standard work week to:
 - a) A routine trouble call within 1 working day of its report. A routine trouble is considered a trouble which causes a pillow speaker or cordset, one master IC control station, room station or emergency station to be inoperable.
 - b) Routine trouble calls in critical emergency health care facilities (i.e., cardiac arrest, intensive care units, etc.) shall also be deemed as an emergency trouble call. The COTR (or Facility Contracting Officer) shall notify the Contractor of this type of trouble call.
 - c) An emergency trouble call within 4 hours of its report. An emergency trouble is considered a trouble which causes a sub-system (ward), distribution point, terminal cabinet, or all call system to be inoperable at anytime.

- 4) If a IC component failure cannot be corrected within 4 hours (exclusive of the standard work time limits), the Contractor shall be responsible for providing alternate IC equipment. The alternate equipment/system shall be operational within a maximum of 20 hours after the 4 hour trouble shooting time and restore the effected location operation to meet the system performance standards. If any sub-system or major system trouble cannot be corrected within one working day, the Contractor shall furnish and install compatible substitute equipment returning the system or sub-system to full operational capability, as described herein, until repairs are complete.
- b. Required On-Site Visits during the Two Year Guaranty Period
 - 1) The Contractor shall visit, on-site, for a minimum of 8 hours, once every 12 weeks, during the guaranty period, to perform system preventive maintenance, equipment cleaning, and operational adjustments to maintain the system according the descriptions identified in this document.
 - 2) The Contractor shall arrange all Facility visits with the COTR (or Facility Contracting Officer) prior to performing the required maintenance visits.
 - 3) Preventive maintenance shall be performed by the Contractor in accordance with the OEM's recommended practice and service intervals during non-busy time agreed to by the COTR (or Facility Contracting Officer) and Contractor.
 - 4) The preventive maintenance schedule, functions and reports shall be provided to and approved by the COTR (or Facility Contracting Officer).
 - 5) The Contractor shall provide the COTR (or Facility Contracting Officer) a type written report itemizing each deficiency found and the corrective action performed during each required visit or official reported trouble call. The Contractor shall provide the COTR with sample copies of these reports for review and approval at the beginning of the Acceptance Test. The following reports are the minimum required:
 - a) The Contractor shall provide a monthly summary all equipment and sub-systems serviced during this guarantee period to COTR (or Facility Contracting Officer) by the

fifth (5th) working day after the end of each month. The report shall clearly and concisely describe the services rendered, parts replaced and repairs performed. The report shall prescribe anticipated future needs of the equipment and systems for preventive and predictive maintenance.

- b) The Contractor shall maintain a separate log entry for each item of equipment and each sub-system of the system. The log shall list dates and times of all scheduled, routine, and emergency calls. Each emergency call shall be described with details of the nature and causes of emergency steps taken to rectify the situation and specific recommendations to avoid such conditions in the future.
- 6) The COTR (or Facility Contracting Officer) shall convey to the Facility Engineering Officer, 2 copies of actual reports for evaluation.
 - a) The COTR (or Facility Contracting Officer) shall ensure a copy of these reports is entered into the system's official acquisition documents.
 - b) The Facility Chief Engineer shall ensure a copy of these reports is entered into the system's official technical record documents.

B. Work Not Included:

Maintenance and repair service shall not include the performance of any work due to improper use; accidents; other vendor, contractor, or owner tampering or negligence, for which the Contractor is not directly responsible and does not control. The Contractor shall immediately notify the COTR or Facility Contracting Officer in writing upon the discovery of these incidents. The COTR or Facility Contracting Officer will investigate all reported incidents and render

4.3 TRAINING

- A. Provide thorough training of the owner's engineering and maintenance staff.
- B. Provide the following minimum training times and durations:
 - 1. 24 hours prior to opening
 - 2. 24 hours during the opening week
 - 3. 24 hours for supervisors and system administrators

- - - E N D - - -

**SECTION 27 52 23
NURSE CALL SYSTEMS**

PART 1 - GENERAL

1.1 SECTION SUMMARY

- A. Work covered by this document includes design, engineering, labor, material and products, equipment warranty and system guarantee, training and services for, and incidental to, the complete installation of new and fully operating National Fire Protection Association (NFPA) - Life Safety Code 101.3-2 (a) Labeled and (b) Listed, Emergency Service Nurse-Call Communication System and associated equipment (herein-after referred to as the System) provided in approved locations indicated on the contract drawings. These items shall be tested and certified capable of receiving, distributing, interconnecting and supporting Nurse-Call communications signals generated local and remotely as detailed herein.
- B. Work shall be complete, Occupational Safety and Health Administration (OSHA), National Recognized Testing Laboratory (NRTL - i.e. Underwriters Laboratory [UL]) Listed and Labeled; and VA Central Office (VACO), Telecommunications Voice Engineering (TVE 0050P3B) tested, certified and ready for operation.
- C. The System shall be delivered free of engineering, manufacturing, installation, and functional defects. It shall be designed, engineered and installed for ease of operation, maintenance, and testing.
- D. The term "provide", as used herein, shall be defined as: designed, engineered, furnished, installed, certified, tested, and guaranteed by the Contractor.
- E. Specification Order of Precedence: In the event of a conflict between the text of this document and the Project's Contract Drawings outlined and/or cited herein; THE TEXT OF THIS DOCUMENT TAKES PRECEDENCE. *HOWEVER, NOTHING IN THIS DOCUMENT WILL SUPERSEDE APPLICABLE EMERGENCY LAWS AND REGULATIONS, SPECIFICALLY NATIONAL AND/OR LOCAL LIFE AND PUBLIC SAFETY CODES.* The Local Fire Marshall and/or VA Public Safety Officer are the only authorities that may modify this document's EMERGENCY CODE COMPLIANCE REQUIREMENTS, on a case by case basis, in writing and confirmed by VA's Project Manager (PM), Contracting Officer's Technical Representative (COTR) and TVE-0050P3B. The VA PM is the only approving authority for other amendments to this document that may be granted, on a case by case basis, in writhing with

technical concurrencies by VA's PM, COTR, TVE-0050P3B and identified Facility Project Personnel.

- F. The Original Equipment Manufacturer (OEM) and Contractor shall ensure that all management, sales, engineering and installation personnel have read and understand the requirements of this specification before the system is designed, engineered, delivered and provided. The Contractor shall furnish a written statement stating this requirement as a part of the technical submittal that includes each name and certification, including the OEMs. The Contractor is cautioned to obtain in writing, all approvals for system changes relating to the published contract specifications and drawings, from the PM and/or the COTR before proceeding with the change.

1.2 RELATED SECTIONS

- A. 01 33 23 - Shop Drawings, Product Data and Samples.
- B. 07 84 00 - Firestopping.
- C. 26 05 21 - Low - Voltage Electrical Power Conductors and Cables (600 Volts and Below).
- D. 26 41 00 - Facility Lightning Protection.
- E. 27 05 11 - Requirements for Communications Installations.
- F. 27 05 26 - Grounding and Bonding for Communications Systems.
- G. 27 05 33 - Raceways and Boxes for Communications Systems.
- H. 27 10 00 - TIP Structured Communications Systems Cabling.
- I. 27 11 00 - TIP Communications Interface and Equipment Rooms Fittings.
- J. 27 15 00 - TIP Communications Horizontal and Vertical Cabling.

1.3 DEFINITION

- A. Provide: Design, engineer, furnish, install, connect complete, test, certify and guarantee.
- B. Work: Materials furnished and completely installed.
- C. Review of contract drawings: A service by the engineer to reduce the possibility of materials being ordered which do not comply with contract documents. The engineer's review shall not relieve the Contractor of responsibility for dimensions or compliance with the contract documents. The reviewer's failure to detect an error does not constitute permission for the Contractor to proceed in error.
- D. Headquarters (aka VACO) Technical Review, for National and VA Communications and Security, Codes, Frequency Licensing Standards, Guidelines and Compliance:

Office of Telecommunications

Special Communications Team (0050P3B)
 1335 East West Highway - 3rd Floor
 Silver Spring, Maryland 20910,
 (O) 301-734-0350, (F) 301-734-0360

E. Contractor: Systems Contractor; you; successful bidder.

1.4 REFERENCES

A. The installation shall comply fully with all governing authorities, laws and ordinances, regulations, codes and standards, including, but not limited to:

1. United States Federal Law:

a. Departments of:

1) Commerce, Consolidated Federal Regulations (CFR), Title 15 - Under the Information Technology Management Reform Act (Public Law 104-106), the Secretary of Commerce approves standards and guidelines that are developed by the:

a) Chapter II, National Institute of Standards Technology (NIST - formerly the National Bureau of Standards). Under Section 5131 of the Information Technology Management Reform Act of 1996 and the Federal Information Security Management Act of 2002 (Public Law 107-347), NIST develops - Federal Information Processing Standards Publication (FIPS) 140-2-Security Requirements for Cryptographic Modules.

b) Chapter XXIII, National Telecommunications and Information Administration (NTIA - aka 'Red Book') Chapter 7.8 / 9; CFR, Title 47 Federal communications Commission (FCC) Part 15, Radio Frequency Restriction of Use and Compliance in "Safety of Life" Functions & Locations.

2) FCC - Communications Act of 1934, as amended, CFR, Title 47 - Telecommunications, in addition to Part 15 - Restrictions of use for Part 15 listed Radio Equipment in Safety of Life / Emergency Functions / Equipment/ Locations (also see CFR, Title 15 - Department of Commerce, Chapter XXIII - NTIA):

a) Part 15 - Restrictions of use for Part 15 listed Radio Equipment in Safety of Life / Emergency Functions / Equipment/Locations.

b) Part 58 - Television Broadcast Service.

c) Part 90 - Rules and Regulations, Appendix C.

- 3) Health, (Public Law 96-88), CFR, Title 42, Chapter IV Health & Human Services, CFR, Title 46, Subpart 1395(a)(b) JCAHO "a hospital that meets JCAHO accreditation is deemed to meet the Medicare conditions of Participation by meeting Federal Directives:"
 - a) All guidelines for Life, Personal and Public Safety; and, Essential and Emergency Communications.
- 4) Labor, CFR, Title 29, Part 1910, Chapter XVII - Occupational Safety and Health Administration (OSHA), Occupational Safety and Health Standard:
 - a) Subpart 7 - Definition and requirements (for a NRTL - 15 Laboratory's, for complete list, contact http://www.osha.gov/dts/otpca/nrtl/faq_nrtl.html):
 - 1) UL:
 - a) 44-02 - Standard for Thermoset-Insulated Wires and Cables.
 - b) 65 - Standard for Wired Cabinets.
 - c) 83-03 - Standard for Thermoplastic-Insulated Wires and Cables.
 - d) 467-01 - Standard for Electrical Grounding and Bonding Equipment
 - e) 468 - Standard for Grounding and Bonding Equipment.
 - f) 486A-01 - Standard for Wire Connectors and Soldering Lugs for Use with Copper Conductors
 - g) 486C-02 - Standard for Splicing Wire Connectors.
 - h) 486D-02 - Standard for Insulated Wire Connector Systems for Underground Use or in Damp or Wet Locations.
 - i) 486E-00 - Standard for Equipment Wiring Terminals for Use with Aluminum and/or Copper Conductors.
 - j) 493-01 - Standard for Thermoplastic-Insulated Underground Feeder and Branch Circuit Cable.
 - k) 514B-02 - Standard for Fittings for Cable and Conduit.
 - l) 1069 version 7 - Hospital Signaling and Nurse Call Equipment.
 - m) 1449 - Standard for Transient Voltage Surge Suppressors.

- n) 1479-03 - Standard for Fire Tests of Through-Penetration Fire Stops.
- o) 1666 - Standard for Wire/Cable Vertical (Riser) Tray Flame Tests.
- p) 1863 - Standard for Safety, Communications Circuits Accessories.
- q) 2024 - Standard for Optical Fiber Raceways.
- r) 60950-1/2 - Information Technology Equipment - Safety.
- 2) Canadian Standards Association (CSA): same tests as for UL.
- 3) Communications Certifications Laboratory (CCL): same tests as for UL.
- 4) Intertek Testing Services NA, Inc. (ITSNA formerly Edison Testing Laboratory [ETL]): same tests as for UL.
- b) Subpart 35 - Compliance with NFPA 101 - Life Safety Code.
- c) Subpart 36 - Design and construction requirements for exit routes.
- d) Subpart 268 - Telecommunications.
- e) Subpart 305 - Wiring methods, components, and equipment for general use.
- 5) Department of Transportation, CFR, Title 49 (Public Law 89-670), Part 1, Subpart C - Federal Aviation Administration (FAA):
 - a) Standards AC 110/460-ID & AC 707 / 460-2E - Advisory Circulars for Construction of Antenna Towers.
 - b) Forms 7450 and 7460-2 - Antenna Construction Registration.
- 6) Veterans Affairs (Public Law No. 100-527), CFR, Title 38, Volumes I & II:
 - a) Office of Telecommunications:
 - 1) Handbook 6100 - Telecommunications.
 - a) Spectrum Management FCC & NTIA Radio Frequency Compliance and Licensing Program.
 - b) Special Communications Proof of Performance Testing, VACO Compliance and Life Safety Certification(s).
 - b) Office of Cyber and Information Security (OCIS):
 - 1) Handbook 6500 - Information Security Program.

- 2) Wireless and Handheld Device Security Guideline Version 3.2, August 15, 2005.
- c) VA's National Center for Patient Safety - Veterans Health Administration Warning System, Failure of Medical Alarm Systems using Paging Technology to Notify Clinical Staff, July 2004.
- d) VA's Center for Engineering Occupational Safety and Health, concurrence with warning identified in VA Directive 7700.
- e) Office of Construction and Facilities Management (CFM):
 - 1) Master Construction Specifications (PG-18-1).
 - 2) Standard Detail and CAD Standards (PG-18-4).
 - 3) Equipment Guide List (PG-18-5).
 - 4) Electrical Design Manual for VA Facilities (PG 18-10), Articles 7 & 8.
 - 5) Minimum Requirements of A/E Submissions (PG 18-15):
 - a) Volume B, Major New Facilities, Major Additions; and Major Renovations, Article VI, Paragraph B.
 - b) Volume C - Minor and NRM Projects, Article III, Paragraph S.
 - c) Volume E - Request for Proposals Design/Build Projects, Article II, Paragraph F.
 - 6) Mission Critical Facilities Design Manual (Final Draft - 2007).
 - 7) Life Safety Protected Design Manual (Final Draft - 2007).
 - 8) Solicitation for Offerors (SFO) for Lease Based Clinics - (05-2009).
- b. Federal Specifications (Fed. Specs.):
 - 1) A-A-59544-00 - Cable and Wire, Electrical (Power, Fixed Installation).
- 2. National Codes:
 - a. American Institute of Architects (AIA): Guidelines for Healthcare Facilities.
 - b. American National Standards Institute/Electronic Industries Association/Telecommunications Industry Association (ANSI/EIA/TIA):
 - 1) 568-B - Commercial Building Telecommunications Wiring Standards:

- a) B-1 - General Requirements.
- b) B-2 - Balanced twisted-pair cable systems.
- c) B-3 - Fiber optic cable systems.
- 2) 569 - Commercial Building Standard for Telecommunications Pathways and Spaces.
- 3) 606 - Administration Standard for the Telecommunications Infrastructure of Communications Buildings.
- 4) 607 - Commercial Building Grounding and Bonding Requirements for Telecommunications.
- 5) REC 127-49 - Power Supplies.
- 6) RS 270 - Tools, Crimping, Solderless Wiring Devices, Recommended Procedures for User Certification.
- c. American Society of Mechanical Engineers (ASME):
 - 1) Standard 17.4 - Guide for Emergency Personnel.
 - 2) Standard 17.5 - Elevator & Escalator Equipment (prohibition of installing non-elevator equipment in Elevator Equipment Room / Mechanical Penthouse).
- d. American Society of Testing Material (ASTM):
 - 1) D2301-04 - Standard Specification for Vinyl Chloride Plastic Pressure Sensitive Electrical Insulating Tape.
- e. Building Industries Communications Services Installation (BICSI):
 - 1) All standards for smart building wiring, connections and devices for commercial and medical facilities.
 - 2) Structured Building Cable Topologies.
 - 3) In consort with ANSI/EIA/TIA.
- f. Institute of Electrical and Electronics Engineers (IEEE):
 - 1) SO/TR 21730:2007 - Use of mobile wireless communication and computing technology in healthcare facilities - Recommendations for electromagnetic compatibility (management of unintentional electromagnetic interference) with medical devices.
 - 2) 0739-5175/08/©2008 IEEE - Medical Grade - Mission Critical - Wireless Networks.
 - 3) C62.41 - Surge Voltages in Low-Voltage AC Power Circuits.
- g. NFPA:
 - 1) 70 - National Electrical Code (current date of issue) - Articles 517, 645 & 800.

- 2) 75 - Standard for Protection of Electronic Computer Data-Processing Equipment.
- 3) 77 - Recommended Practice on Static Electricity.
- 4) 99 - Healthcare Facilities.
- 5) 101 - Life Safety Code.
- 3. State Hospital Code(s).
- 4. Local Town, City and/or County Codes.
- 5. Accreditation Organization(s):
 - a. Joint Commission on Accreditation of Hospitals Organization (JCAHO) - Section VI, Part 3a - Operating Features.

1.5 QUALIFICATIONS

- A. The OEM shall have had experience with three (3) or more installations of Nurse Call systems of comparable size and interfacing complexity with regards to type and design as specified herein. Each of these installations shall have performed satisfactorily for at least one (1) year after final acceptance by the user. Include the names, locations and point of contact for these installations as a part of the submittal.
- B. The Contractor shall submit certified documentation that they have been an authorized distributor and service organization for the OEM for a minimum of three (3) years. The Contractor shall be authorized by the OEM to pass thru the OEM's warranty of the installed equipment to VA. In addition, the OEM and Contractor shall accept complete responsibility for the design, installation, certification, operation, and physical support for the System. This documentation, along with the System Contractor and OEM certifications must be provided in writing as part of the Contractor's Technical submittal.
- C. The Contractor's Communications Technicians assigned to the System shall be fully trained, qualified, and certified by the OEM on the engineering, installation, operation, and testing of the System. The Contractor shall provide formal written evidence of current OEM certification(s) for the installer(s) as a part of the submittal or to the COTR before being allowed to commence work on the System.
- D. The Contractor shall display all applicable national, state and local licenses.
- E. The Contractor shall submit copy (s) of Certificate of successful completion of OEM's installation/training school for installing technicians of the System's Nurse Call equipment being proposed.

1.6 CODES AND PERMITS

- A. Provide all necessary permits and schedule all inspections as identified in the contract's milestone chart, so that the system is proof of performance tested, certified and approved by VA and ready for operation on a date directed by the Owner.
- B. The contractor is responsible to adhere to all codes described herein and associated contractual, state and local codes.

1.7 SCHEDULING

- A. After the award of contract, the Contractor shall prepare a detailed schedule (aka milestone chart) using "Microsoft Project" software or equivalent. The Contractor Project Schedule (CPS) shall indicate detailed activities for the projected life of the project. The CPS shall consist of detailed activities and their restraining relationships. It will also detail manpower usage throughout the project.
- B. It is the responsibility of the Contractor to coordinate all work with the other trades for scheduling, rough-in, and finishing all work specified. The owner will not be liable for any additional costs due to missed dates or poor coordination of the supplying contractor with other trades.

1.8 REVIEW OF CONTRACT DRAWINGS AND EQUIPMENT DATA SUBMITTALS (AKA TECHNICAL SUBMITTAL[S])

(Note: The Contractor is encouraged, but not required, to submit separate technical submittal(s) outlining alternate technical approach(s) to the system requirements stated here-in as long as each alternate technical document(s) is complete, separate, and submitted in precisely the same manner as outlined herein. VA will review and rate each received alternate submittal, which follows this requirement, in exactly the same procedure as outlined herein. Partial, add-on, or addenda type alternates will not be accepted or reviewed.)

- A. Submit at one time within 10 days of contract awarding, drawings and product data on all proposed equipment and system. Check for compliance with contract documents and certify compliance with Contractor's "APPROVED" stamp and signature.
- B. Support all submittals with descriptive materials, i.e., catalog sheets, product data sheets, diagrams, and charts published by the manufacturer. These materials shall show conformance to specification and drawing requirements.

- C. Where multiple products are listed on a single cut-sheet, circle or highlight the one that you propose to use. Provide a complete and through equipment list of equipment expected to be installed in the system, with spares, as a part of the submittal. Special Communications (TVE-005OP3B) will not review any submittal that does not have this list.
- D. Provide four (4) copies to the COTR for technical review. The COTR will provide a copy to the offices identified in Paragraph 1.3.C & D, at a minimum for compliance review as described herein where each responsible individual(s) shall respond to the PM within 10 working days of receipt of their acceptance or rejection of the submittal(s).
- E. Provide interconnection methods, conduit (where not already installed), junction boxes (J-Boxes), cable, interface fixtures and equipment lists for the: ENR(s) (aka DMARC), TER, TCR, MCR, MCOR, PCR, ECR, Stacked Telecommunications Rooms (STR), Nurses Stations (NS), Head End Room (HER), Head End Cabinet (HEC), Head End Interface Cabinet (HEIC) and approved TCO locations TIP interface distribution layout drawing, as they are to be installed and interconnected to teach other (REFER TO APPENDIX B - SUGGESTED TELECOMMUNI-CAITONS ONE LINE TOPOLOGY pull-out drawing).
- F. Equipment technical literature detailing the electrical and technical characteristics of each item of equipment to be furnished.
- G. Engineering drawings of the System, showing calculated of expected signal levels at the headend input and output, each input and output distribution point, and signal level at each telecommunications outlet.
- H. Surveys Required as a Part of The Technical Submittal:
 - 1. The Contractor shall provide the following System surveys that depict various system features and capacities required **in addition to** the on-site survey requirements described herein (**see Specification Paragraph 2.4.3**). Each survey shall be in writing and contain the following information (the formats are suggestions and may be used for the initial Technical Submittal Survey requirements), as a minimum:
 - a. Nurse Call Cable System Design Plan:
 - 1) An OEM and contractor designed functioning Nurse Call System cable plan **to populate the entire TIP empty conduit/pathway distribution systems provided as a part of Specification 27 11 00** shall be provided as a part of the technical proposal. A

specific functioning Nurse Call: cable, interfaces, J-boxes and back boxes shall coincide with the total growth items as described herein. It is the Contractor's responsibility to provide the Systems' entire Nurse Call cable and accessory requirements and engineer a functioning Nurse Call distribution system and equipment requirement plan of the following paragraph(s), at a minimum:

2) The required Nurse Call Equipment Locations:

<u>EQUIPPED ITEM</u>	<u>CAPACITY</u>	<u>GROWTH</u>
Master Stations		
Dome Lights		
Room		
Corridor		
Other		
Patient Stations		
Single		
Dual		
Isolation		
Other		
Emergency Stations		
Bath		
Toilet		
Isolation		
Other		
Staff Stations		
Duty Stations		
Radio Paging Access (when pre-approved by TVE-0050P3B)		
Audio Paging Access (when pre-approved by TVE-0050P3B)		
Wireless Access (when pre-approved by TVE-0050P3B)		
Maintenance/Programming Console		
Location(s)		
Central Control Cabinet/Equipment		
Location		
Power Supply(s)		

UPS(s)		
--------	--	--

3) The required Nurse Call Cable Plant/Connections:

The Contractor shall clearly and fully indicate this category for each item identified herein as a part of the technical submittal. For this purpose, the following definitions and sample connections are provided to detail the system's capability:

<u>EQUIPPED ITEM</u>	<u>CAPACITY</u>	<u>GROWTH</u>
Central Control Cabinet/Equipment		
Location		
Power Supply(s)		
UPS(s)		
Essential Electrical Power Panel(s)		
Other		
Cable Plant		
Supply to Locations Identified in Paragraph 1.8.H.1.a.2)		
Remote Locations		
Telephone Operator Room		
Police Control Room		
Other		
Maintenance/Program Console		
Location(s)		
Other		
LAN (Local Facility) Access/Equipment/Location (when pre-approved by TVE-0050P3B)		
Wireless Access/Equipment/Location (when pre-approved by TVE-0050P3B)		
PA Access/Equipment/Location (when pre-approved by TVE-0050P3B)		
Other		

1.9 PROJECT RECORD DOCUMENTS (AS BUILTS)

- A. Throughout progress of the Work, maintain an accurate record of changes in Contract Documents. Upon completion of Work, transfer recorded changes to a set of Project Record Documents.
- B. The floorplans shall be marked in pen to include the following:

1. Each device specific locations with UL labels affixed.
2. Conduit locations.
3. Each interface and equipment specific location.
4. Head-end equipment and specific location.
5. Wiring diagram.
6. Labeling and administration documentation.
7. Warranty certificate.
8. System test results.

1.10 WARRANTIES / GUARANTY

- A. The Contractor shall warrant the installation to be free from defect in material and workmanship for a period of two (2) years from the date of acceptance of the project by the owner. The Contractor shall agree to remedy covered defects within four (4) hours of notification of major failures or within twenty-four (24) hours of notification for individual station related problems.
- B. The Contractor shall agree to grantee the system according to the guidelines outlined in Article 4 herein.

1.11 USE OF THE SITE

- A. Use of the site shall be at the GC's direction.
- B. Coordinate with the GC for lay-down areas for product storage and administration areas.
- C. Coordinate work with the GC and their sub-contractors.
- D. Access to buildings wherein the work is performed shall be directed by the GC.

1.12 DELIVERY, STORAGE, AND HANDLING

- A. Deliver, store, and handle products using means and methods that will prevent damage, deterioration, and loss, including theft.
- B. Store products in original containers.
- C. Coordinate with the GC for product storage. There may be little or no storage space available on site. Plan to potentially store materials off site.
- D. Do not install damaged products. Remove damaged products from the site and replaced with new product at no cost to the Owner.

1.13 PROJECT CLOSE-OUT

- A. Prior to final inspection and acceptance of the work, remove all debris, rubbish, waste material, tools, construction equipment, machinery and surplus materials from the project site and thoroughly clean your work area.

- B. Before the project closeout date, the Contractor shall submit:
 - 1. OEM Equipment Warranty Certificates.
 - 2. Evidence of compliance with requirements of governing authorities such as the Low Voltage Certificate of Inspection.
 - 3. Project record documents.
 - 4. Instruction manuals and software that is a part of the system.
 - 5. System Guaranty Certificate.
- C. Contractor shall submit written notice that:
 - 1. Contract Documents have been reviewed.
 - 2. Project has been inspected for compliance with contract.
 - 3. Work has been completed in accordance with the contract.

PART 2 - PRODUCTS / FUNCTIONAL REQUIREMENTS

2.0 GENERAL REQUIREMENTS FOR EQUIPMENT AND MATERIALS

- A. Furnish and install a complete and fully functional and operable Nurse Call System for each location shown on the contract drawings and TCOs **WHOSE EMPTY CONDUIT SYSTEM WAS PROVIDED AS A PART OF SPECIFICATION 27 11 00.**
- B. The specific location for each Nurse Call: Central Control Cabinet is Telecom Room A119, Power Supply is Telecom Room A119, Electrical Supervisor Panel is Telecom Room A119, UPS is Telecom Room A119, Two (2) Remote Annunciation Consoles in locations as required by the VA, Master Stations are Office A112 and Work Room A118, Emergency Station is Toilets A108, A115, and A117, Dome Light is above outside of Toilets A108, A115, and A117 above doors.
- C. Coordinate features and select interface components to form an integrated Nurse Call system. Match components and interconnections between the systems for optimum performance of specified functions.
- D. Expansion Capability: The Nurse Call equipment interfaces and cables shall be able to increase number of enunciation points in the future by a minimum of 50 percent (%) above those indicated without adding any internal or external components or main trunk cable conductors.
- E. Equipment: Active electronic type shall use solid-state components, fully rated for continuous duty unless otherwise indicated. Select equipment for normal operation on input power usually supplied between 110 to 130 VAC, 60 Hz supplied from the Facility's Emergency Electrical Power System.
- F. Meet all FCC requirements regarding equipment listing, low radiation and/or interference of RF signal(s). The system shall be designed to

prevent direct pickup of signals from within and outside the building structure.

- G. Weather/Water Proof Equipment: Listed and labeled by an OSHA certified NRTL (i.e. UL) for duty outdoors or in damp locations.

2.1 SYSTEM DESCRIPTION

- A. Furnish and install a complete and fully functional and operable Nurse Call System **WHOSE EMPTY CONDUIT SYSTEM WAS PROVIDED AS A PART OF SPECIFICATION 27 11 00.**
- B. The Contractor shall continually employ interfacing methods that are approved by the OEM and VA. At a minimum, an acceptable interfacing method requires not only a physical and mechanical connection, but also a matching of signal, voltage, and processing levels with regard to signal quality and impedance. The interface point must adhere to all standards described herein for the full separation of Critical Care and Life Safety systems.
- C. The System Contractor shall connect the System ensuring that all NFPA and UL Critical Care and Life Safety Circuit and System separation guidelines are satisfied. The System Contractor is not allowed to make any connections to the Telephone System. VA shall arrange for the interconnection between the
- D. System hardware shall consist of a **standalone (separate)** nurse call patient communications network comprised of nurse consoles, control stations, dome lights, pull cord and/or emergency push button stations, wiring. And, other options such as, **pocket page interfaces**, computer interfaces, printer interfaces, wireless / telephone network interfaces, and nurse locating system interface **(when specifically approved first by TVE 0050P3B)** and as shown on drawings. All necessary equipment required to meet the intent of these specifications, whether or not enumerated within these specifications, shall be supplied and installed to provide a complete and operating nurse call patient communications network. **It is not acceptable to utilize the telephone cable system for the control and distribution of nurse call signals and equipment.**
- E. System firmware shall be the product of a reputable firmware OEM of record with a proven history of product reliability and sole control over all source code. Manufacturer shall provide, free of charge, product firmware/software upgrades for a period of two (2) years from date of acceptance by VA for any product feature enhancements. System

- configuration programming changes shall not require any exchange of parts and shall be capable of being executed remotely via a modem connection **(when specifically approved first by TVE 0050P3B)** .
- F. The Nurse Call Head End Equipment shall be located in Telecommunications Room A119. The Nurse Call System may interface the PA system when specifically approved by VA Headquarters TVE 0050P3B during the project approval process prior to contract bidding.
 - G. The System shall utilize microprocessor components for all signaling and programming circuits and functions. Self contained or on board system program memory shall be non-volatile and protected from erasure from power outages for a minimum of 12 hours.
 - H. Provide a backup battery or a UPS for the System (including each distribution cabinet/point, CRT and Monitor) to allow normal operation and function (as if there was no AC power failure) in the event of an AC power failure or during input power fluctuations for a minimum of 30 minutes.
 - I. The System is defined as Critical Service and the functions is defined as Life Safety/Support by NFPA (re Part 1.1.A) and so evaluated by JCAHCO.
 - 1. These two (2) additional remote locations shall be fully manned:
 - a. 24/7/365 for certified Adult Daycare.
 - b. As long as other identified VA Medical / Servicing Facilities are open for servicing patients.
 - c. The minimum remote enunciation locations shall be:
 - 1) The Telephone / PBX Operator Room.
 - 2) The Police Control / Operations Room.
 - 3) Other location(s) that is specifically approved by VA Headquarters TVE - 0050P3B DURING THE PROJECT DEVELOPMENT STAGES AND PRIOR TO EQUIPMENT PURCHASE.
 - 2. In addition to the two (2) remote locations afore described, the following locations are the minimum required for additional Nurse Call Annunciation:
 - a. Each Nurse Master Station.
 - 3. The MAXIMUM enunciation time period from placement of the Call to enunciation at each remote locations is 10 seconds; and, 15 seconds to the subsequent enunciating media stations (i.e. PA, Radio Paging, Emergency Telephone or Radio Backup, etc.).

- J. Each Nurse Call System shall be designed to provide continuous electrical supervision of the complete and entire system (i.e. dome light bulbs [each light will be considered supervised if they use any one or a combination of (UL) approved electrical supervision alternates, as identified in UL-1069 version 7, 1992 revision], wires, contact switch connections, circuit boards, data, audio, and communication busses, main and UPS power, etc.). All alarm initiating and signaling circuits shall be supervised for open circuits, short circuits, and system grounds. Main and UPS power circuits shall be supervised for a change in state (i.e. primary to backup, low battery, UPS on line, etc.). When an open, short or ground occurs in any system circuit, an audible and visual fault alarm signal shall be initiated at the nurse control station and all remote locations.
- K. When the System is approved to connect to a separate communications system (i.e. LAN, WAN, Telephone, Public Address, radio raging, wireless systems, etc) the connection point shall meet the following minimum requirements for each hard wired / wireless connection (note each wireless system connection MUST BE APPROVED PRIOR TO CONTRACT BID BY VA HEADQUARTERS TVE - 0050P3B AND SPECTRUM MANAGEMENT - 0050P2B - hereinafter referred to as SM - 0050P2B):
1. UL 60950-1/2.
 2. FIPS 142.
 3. FCC Part 15 Listed Radio Equipment restriction compliance approved by SM - 0050P2B.
- L. All passive distribution equipment shall meet or exceed -80 dB radiation shielding (aka RFI) shielding specifications and be provided with connectors specified by the OEM.
- M. All equipment face plates utilized in the system shall be stainless steel, anodized aluminum or UL approved cycolac plastic for the areas where provided.
- N. Noise filters and surge protectors shall be provided for each equipment interface cabinet, headend cabinet, control console and local and remote amplifier locations to insure protection from input primary AC power surges and to insure noise glitches are not induced into low voltage data circuits.
- O. Plug-in connectors shall be provided to connect all equipment, except coaxial cables. Coaxial cable distribution points shall use coaxial cable connections recommended by the cable OEM and approved by the

system OEM. Base band cable systems shall utilize barrier terminal screw type connectors, at a minimum. As an alternate, crimp type connectors installed with a ratchet type installation tool are acceptable provided the cable dress, pairs, shielding, grounding, connections and labeling are the same as the barrier terminal strip connectors. Tape of any type, wire nuts or solder type connections are unacceptable and will not be approved.

- P. Audio Level Processing: The control equipment shall consist of audio mixer(s), volume limiter(s) and/or compressor(s), and power amplifier(s) to process, adjust, equalize, isolate, filter, and amplify each audio channel for each sub-zone in the system and distribute them into the System's RF interfacing distribution trunks and amplification circuits. It is acceptable to use identified Telephone System cable pairs designated for Two-Way Radio interface and control use or identified as spare telephone cable pairs by the Facility's Telephone System Contractor. The use of telephone cable to distribute RF signals, carrying system or sub-system AC or DC voltage is not acceptable and will not be approved. Additionally, each control location shall be provided with the equipment required to insure the system can produce its designed audio channel capacity at each speaker identified on the contract drawings. The Contractor shall provide: a spare set of telephone paging modules as recommended by the OEM (as a minimum provide one spare module for each installed module); one spare audio power amplifier, one spare audio mixer, one spare audio volume limiter and/or compressor, and one spare audio automatic gain adjusting device, and minimum RF equipment recommended by the OEM.
- Q. Contractor is responsible for pricing all accessories and miscellaneous equipment required to form a complete and operating system. Unless otherwise noted in this Part, equipment quantities shall be as indicated on the drawings.
- R. System Performance:
1. At a minimum, each distribution, interconnection, interface, terminating point and TCO shall be capable of supporting the Facility's Nurse Call System voice and data service as follows:
 - a. Shall be compliant with and not degrade the operating parameters of the Public Switched Telephone Network (PSTN) and the Federal Telecommunications System (FTS) at each PSTN and FTS interface

(if attachment is permitted by TVE 0050P3B), interconnection and TCO terminating locations detailed on the contract drawings.

- b. The System shall provide the following minimum operational functions:

- 1) Nurse calls shall be cancelable at the calling station only.

The nurse call master station(s) that manages functions shall not have the ability to cancel nurse calls.

- 2. Each System Nurse Call location shall generate a minimum of distinct calls:

- a. Routine: single flashing dome lights & master station color and audio tone,
- b. Staff Assist: rapid flashing dome lights & master station color and audio tone,
- c. Emergency: Red flashing dome lights & master station color and audio tone,
- d. Each generated call shall be cancelable at ONLY the originating location,

2.3 MANUFACTURERS

- A. The products specified shall be new, FCC and UL Listed, labeled and produced by OEM manufacturer of record. An OEM of record shall be defined as a company whose main occupation is the manufacture for sale of the items of equipment supplied and which:
 - 1. New Nurse Call System shall be equal to and capable of interfacing with Rollins Responder 4,
 - 2. Maintains a stock of replacement parts for the item submitted,
 - 3. Maintains engineering drawings, specifications, and operating manuals for the items submitted, and
 - 4. Has published and distributed descriptive literature and equipment specifications on the items of equipment submitted at least 30 days prior to the Invitation for Bid.
- B. Specifications contained herein as set forth in this document detail the salient operating and performance characteristics of equipment in order for VA to distinguish acceptable items of equipment from unacceptable items of equipment. When an item of equipment is offered or furnished for which there is a specification contained herein, the item of equipment offered or furnished shall meet or exceed the specification for that item of equipment.
- C. Equipment Standards and Testing:

1. The System has been defined herein as connected to systems identified as Critical Service performing various Emergency and Life Support Functions. Therefore, at a minimum, the system shall conform to all aforementioned National and/or Local Life Safety Codes (which ever are the more stringent), NFPA, NEC, this specification, JCAHCO Life Safety Accreditation requirements, and the OEM recommendations, instructions, and guidelines.
2. All supplies and materials shall be listed, labeled or certified by UL or a NRTL where such standards have been established for the supplies, materials or equipment.
3. The provided equipment required by the System design and approved technical submittal must conform with each UL standard in effect for the equipment, as of the date of the technical submittal (or the date when the COTR approved system equipment necessary to be replaced) was technically reviewed and approved by VA. Where a UL standard is in existence for equipment to be used in completion of this contract, the equipment must bear the approved UL seal.
4. Each item of electronic equipment to be provided under this contract must bear the approved UL seal or the seal of the testing laboratory that warrants the equipment has been tested in accordance with, and conforms to the specified standards. The placement of the UL Seal shall be a permanent part of the electronic equipment that is not capable of being transportable from one equipment item to another.

2.4 PRODUCTS

A. General.

1. Contractor is responsible for pricing all accessories and miscellaneous equipment required to form a complete and operating system. The equipment quantities provided herein shall be as indicated on the drawings with the exception of the indicated spare equipment.
2. Contractor Furnished Equipment List (CFEs):
 - a. The Contractor is required to provide a list of the CFE equipment to be furnished. The quantity, make and model number of each item is required. Select the required equipment items quantities that will satisfy the needs of the system as described herein and with the OEM's concurrence applied to the list(s), in writing.

<u>Item</u>	<u>Quantity</u>	<u>Unit</u>
-------------	-----------------	-------------

1.	As required	Interface Panel(s)
1.a	As required	Electrical Supervision
		Trouble Enunciator
1.a.1	As required	Equipment Back Box(s)
1.b	As required	Telephone
1.c	As required	Public Address
1.d	As required	Radio Paging / Equipment
1.e	As required	Wireless / Equipment
1.f.	As required	Radio Pager / Equipment
1.g	As required	Wireless / Equipment
1.f	As required	Personal Communicator / Equipment
2.	As required	Lightning Arrestor
3.	As required	Head End Equipment/Locations
3.a	As required	Cabinet(s)
3.a.1	As required	AC Power Conditioner & Filter
3.a.2	As required	AC Power Strip
3.a.3	As required	UPS
3.a.4	As required	Interconnecting Wire/Cables
3.a.5	As required	Wire / Cable Connector(s)
3.a.6	As required	Wire / Cable Terminator(s)
3.b	As required	Wire Management System
3.b	As required	Head End Function(s)
3.b.1	As required	H7 Interface
3.b.2	As required	Nurse Locator
3.b.3	As required	Staff Locator
4.	2	Master Station(s)
4.a	As required	Nurse Locator
4.b	As required	Staff Locator

5.	As required	Distribution System(s)
5.a	As required	Staff Station
5.a.1	As required	Equipment Back Box(s)
5.b	As required	Duty Station
5.b.1	As required	Equipment Back Box(s)
5.c	As required	Code Blue Station
5.c.1	As required	Equipment Back Box(s)
5.c.2	2 (MIN)	Remote Station(s)
5.d	As required	Patient Station(s)
5.d.1	As required	Equipment Back Box(s)
5.d.2	As required	Bed Interface(s)
5.d.3	As required	Pillow Speaker
5.d.4	As required	Push Button Cordset
5.d.5	As required	Dummy Plugs
5.d.6	As required	Bed Integrated Control
5.d.7	As required	Lighting Interface Module
5.d.8	As required	TV Control Interface
5.d.9	As required	TV Control Jack
5.d.10	As required	TV Interconnection Cables
5.d.11	As required	HDTV Coaxial
5.d.12	As required	HDTV/Nurses Call Interface/ Control
5.d.13	As required	Auxiliary Mounting Interface
5.e	3	Emergency Station(s)
5.e.1	As required	Equipment Back Box(s)
5.e.2	As required	Toilet Emergency Station (waterproof)

5.e.3	1	Shower Emergency Station (waterproof)
5.e.4	As required	Lavatory Emergency Station (waterproof)
5.f.	As required	Room Dome Light
5.f.1	As required	Equipment Back Box(s)
5.g	3	Other Dome Light(s)
5.g.1	As required	Equipment Back Box(s)
5.g.2	As required	Corridor Dome Light
5.g.3	As required	Intersectional Dome Light
5.h	As required	System Cable(s)
5.h.1	As required	Coaxial
5.h.2	As required	System Pin
5.h.3	As required	Audio
5.h.4	As required	Control
5.h.5	As required	Video
5.i	As required	System Connector(s)
5.i.1	As required	Coaxial
5.i.2	As required	System Pin
5.i.2	As required	Audio
5.i.3	As required	Control
5.i.4	As required	Video
5.j	As required	Wire Management Required as described herein

B. NS Room(s) :

Refer to CFM Physical Security Manual (07-2007) for VA Facilities, Chapters 9.3 & 1) and PG 18-10, EDM, Chapters 7- Table 7-1, 8 & Appendix B, Telecommunications One Line Topology for specific Room and TIP Connection Requirements.

C. TER, SCC, PCR, STR, HER Rooms and Equipment:

Refer to CFM Physical Security Manual (07-2007) for VA Facilities, Chapters 9.3 & 1) and PG 18-10, EDM, Chapters 7- Table 7-1, 8 & Appendix B, Telecommunications One Line Topology for specific Room and TIP Connection Requirements.

D. Telecommunications Room(s) (TR):

1. Locate the Nurse Call floor distribution equipment as required by system design and OEM direction. Provide secured and lockable cabinet/rack(s) as required.
2. Head-End Equipment:
 - a. Provide all required power supplies, communications hubs, network switches, intelligent controllers and other devices necessary to form a complete system. Head-end components may be rack mounted or wall mounted in an enclosed metal enclosure.
 - b. Provide the head end equipment in the closest Telecommunications Room where the System is installed.
 - c. Provide the System UPS inside the cabinet or in a separate cabinet adjacent to the head end cabinet that shall maintain a minimum of 30 minute battery back-up to all system components.
 - d. Equipment Cabinet: Comply with TIA/EIA-310-D. Lockable, ventilated metal cabinet houses terminal strips, power supplies, amplifiers, system volume control, and other switching and control devices required for conversation channels and control functions. See Paragraph 2.5.E for the Cabinet's minimum internal items that are in addition to the installed System equipment.
 - e. Vertical Equipment Rack, Wall Mounted (to be included inside of the Equipment Cabinet) containing the following minimum items:
 - 1) 36 inch (28RU) internal rack space, welded steel construction, minimum 20 inch usable depth, adjustable front mounting rails.
 - 2) Install the following products in rack provided by same manufacturer or as specified:
 - a) Security screws w/ nylon isolation bushings.
 - b) Textured blank panels.
 - c) Custom mounts for components without rack mount kits.
 - d) Security covers.
 - e) Internal system ground copper buss (may be substituted with a bare #0 AWG copper wire or equivalent size copper mesh

strip connected to ONLY THE FACILITY'S SIGNAL GROUNDING SYSTEM.

- f) Power Sequencer- rack-mounted power conditioner and (provide as-needed) delayed sequencer(s) with (2) unswitched outlets each and contact closure control inputs. Connect the conditioner to one of the dual duplex outlets.
- g) Two (2) each 120VAC @ 20A dual duplex outlets, connected via conduit to the nearest Electrical Service Panel that is supplied by the Facility's Essential Electrical System.
- h) One (1) each 120VAC @ 15A Power Distribution Strip(s). Connect each strip to the unstitched outlet on the power conditioner.

3. HL7 Interface:

- a. The system may support downloading and updating of patient data from the hospital admission system (or other database) via the HL7 standard. The data only has to travel one way, i.e. from the admission system to the nurse-call system.
- b. Coordinate with the Owner the exact fields that will be populated from the admissions system in the nurse-call system.
- c. The Facility's LAN/WAN is not allowed for Nurses Call main wiring / function that must be a "stand alone primary cable infrastructure" as described herein.
- d. Connections to the VA LAN/WAN for functional or operable conditions will be allowed ONLY when the LAN/WAN system has been demonstrated and NFPA (at a minimum by TVE-0050PB3B) Certified meeting Life Safety Standards.
- e. Provide one (1) spare HL Interface unit.

4. Wireless:

- a. Radio Paging Equipment / Systems
 - 1) The nurse call system shall have the ability to interface ONLY with VA Certified and Licensed radio paging system (FCC Part 15 listed pagers and transmitters are not allowed for "Safety of Life" functions or installed in those specific areas - VA Headquarters TVE - 0050PB2 and SM - 0050PB2 are the ONLY approving authorities for this function) and must have the following minimum system features:

- a) Ability to pass-through location information (such as a room number) and call-type as well as other text messages simultaneously to shift supervisor identified staff members
 - b) System shall allow the operator to select staff members by name and pager number and to select a message consisting of a room number and a condition code (aka priority level). Operator may also choose to type in a unique alpha-numeric text message (the text message shall meet or exceed all HIPA and VA OCIS Communications Security Guidelines for the transmission of Patient or Staff Specific information [aka PII] - VA Headquarters TVE - 0050P2B is the approving authority for this function) into the system to be read by the holder of the pager unit.
 - c) While a patient station is connected to the nurse's master station, the system shall allow the operator to automatically page the staff member assigned to that room. An alternate staff member may be selected for paging purposes in place of the primary staff member. The System must allow an alternate staff member to be paged when the primary staff member is unable to respond to patient's needs within a specified period of time. The System must have the ability to assign any bed to any pager or pager group, and to assign an unlimited amount of pagers to any patient bed.
 - d) System shall have the ability to send all nurse calls to staff members by predetermined group (as required) automatically by simply pressing one button. Pager shall indicate room number of code call, and state "Emergency" in plain English format on pagers (*FCC Part 15 listed pagers are not allowed to be use as "Safety of Life" functions or those specific locations - VA Headquarters TVE - 0050P2B is the approving authority for this requirement*).
- 2) When pagers are approved, provide a minimum of ten (10) spare pagers with one spare pager for each 10 issued.

5. Personal Wireless Communicator

- a. The System will only be allowed to connect to the personal wireless communications system, pass text data and provide a 2-way communication between the Telephone Interface and the

personal wireless communicator as long as it is not a FCC Part 15 listed device(s), meets or exceeds UL 60950-1/2, meets OCIS Guide Lines for FIPS 140-2 certification and the using staff shows an extensive training program along with recertification(s) according to the Facility Emergency Plan concerning HIPA requirements.

- b. VA Headquarters TVE - 0050P3B and SM - 0050P2B are the approving authority for this requirement.
- c. When communicators are approved, provide a minimum of ten (10) spare communicators for each 10 communicators issued.

6. Other Wireless Equipment / Systems

- a. Each proposed wireless system and/or equipment to be connected to or be a part of the System, each shall meet the minimum requirements outlines in Paragraph 2.7.A.
- b. Contact TVE - 0050P3B and SM - 0050P2B for specific required PRE approvals (full or conditional) as described herein.
- c. When approved, TVE-0050P3B and SM-0050P2B will provide the spare equipment requirements.
- d. When other wireless components are approved, provide ten (10) components with one spare components for each 10 issued.

F. TIP Cable Systems:

Connect the system to the TIP system provided as a part of Speciation Section 27 15 00. Provide additional TIP equipment, interfaces and connections as required by System design. Provide secured pathway(s) and lockable cabinet/rack(s) as required.

G. Interface Equipment:

1. TCR:

a. Electrical Supervision Trouble Annunciator Panel:

- 1) The Electrical Supervision Trouble Annunciation Panel shall be located in the Telephone Operators Room, Police Control Center, associate Nurses Station(s).
- 2) The panel(s) shall be compatible with the generated electrical and/or electronic supervising signals to continuously monitor the operating condition for the System head-end processing equipment, master stations, staff stations, patient stations, duty stations, audio power amplifier(s), UPS, power supplies, dome lights and interconnecting trunks. The panels shall generate an audible and visual signal when the System's

supervising system detects a system and equipment trouble or trunk-line is malfunctioning.

3) Provide one (1) spare panel.

H. Call Initiation, Annunciation and Response:

1. Light and Tones:

a Calls may be initiated through:

- 1) Toilet Emergency Station pull cord / push button.
- 2) Shower Emergency Station pull cord.

b Once a call is initiated, it must be annunciated at the following locations:

- 1) The Corridor, Intersectional and Room dome light associated with the initiating device.
- 2) A local master control station indicating the call location and priority.

c) All calls must be displayed until they are cleared by the nursing staff **ONLY** from the initiating device location.

2. Voice:

a Calls may be initiated through:

- 1) Toilet Emergency pull cord / push button station.
- 2) Shower Emergency pull cord station.

b. Once a call is initiated, it must be annunciated at the following locations:

- 1) The Corridor, Intersectional and Room dome light associated with the initiating device.
- 2) A master station indicating the call location and priority.
- 3) Any duty stations associated with the unit.
- 4) Any staff Stations associated with the unit.
- 5) Each remote location.

c. All calls must be displayed until they are cleared by the nursing staff **ONLY** from the initiating device location.

3. Provide two-way voice communication between a master station and each of the two (2) remote stations.

4. Failure of voice intercom portion of system shall not interfere with visual and audible signal systems.

5. All calls must be displayed on the master station until they are cleared by the nursing staff at **ONLY** the originating station. If multiple calls are received at the master station within a short period of time, they shall be stacked based on priority and wait

time. If there are more calls than the master station screen can display at one time (four [4] minimum), the system must provide a simple scrolling feature. The nurse must be able to answer any call in any order at the master station. The nurse must also be able to forward calls to staff members. If a call is not answered within a programmable time period, then the system must forward the call to appropriate back-up staff identified by each shift supervisor in a manner technically approved by VA Headquarters 0050P3B.

6. Radio pager (within the restrictions identified herein)
7. Wireless personal communicator (within the restrictions identified herein)

I. Patient and Staff Assignment:

1. System may provide for transfer of one or more individual or groups of stations from one master station to another without mechanical switches or additional wiring of the stations. The transfer may be initiated manually by the nurse or automatically at certain times of the day.

2. The Facility's LAN/WAN IS NOT ALLOWED for Nurses Call main wiring which must be a "stand alone primary cable infrastructure."

Connections to the VA LAN/WAN will be allowed ONLY when the LAN/WAN system has been demonstrated and certified by TVE - 0050P3B meeting the minimum guidelines and requirements of the Life Safety Code.

J. Reports:

1. The system's generated reports logging all calls, alarms, response time, bed, and staff assignments may be allowed to transmit these reports to a central archiving entity.
2. Reports function shall be limited by passwords and security tier level access, so that only supervisors may access it when desired.
3. Provide instructions to the owner on how to enable/disable the reporting functions.
4. The Facility's LAN/WAN IS NOT ALLOWED for Nurses Call main wiring that must be a "stand alone primary cable infrastructure."
Connections to the VA LAN/WAN will be allowed ONLY when the system has been demonstrated and certified by 0050P2B meeting the minimum guidelines and requirements of the Life Safety Code.

K. System/Management Software:

1. Provide and install system/management software on minimum of three (3) owner-provided computers.

- a. The management software shall at a minimum provide all historical reporting features of the system as well as real-time monitoring of events.
 - b. The system software shall at a minimum provide the system's operating and functioning parameters and script. The OEM shall provide VA with access to the software's script writing and functions.
2. Provide two (2) spare CD's with the software installed and operable.
3. Rights in Data: VA shall have the right to all script and programming language of system management software. If commercial off the shelf (COTS) or a memorandum of understanding (MOU) is required for follow-on maintenance, the Contractor is required to accomplish the COTS Survey document and the COTR is required to accomplish the COTS Acquisition document supplied in Part 5 Attachments herein.
- L. Distribution System: Refer to Specification Sections 27 11 00, Structured TIP Communications Cables; 27 11 00, TIP Communications Interface and Equipment Rooms Fittings and 27 15 00, HORIZONTAL and Vertical TIP Communications Cabling for additional specific TIP wire and cable standards and installation requirements used to install the Facility's TIP network.
 1. In addition to the TIP provided under the aforementioned Specification Sections, the contractor shall provide the following additional TIP installation and testing requirements, provide the following minimum additional System TIP requirements, cables & interconnections:
 - a. Each wire and cable used in the System shall be specifically OEM certified by tags on each reel and recommended and approved for installation in the Facility.
 - b. The Contractor shall provide the COTR a 610 mm (2 foot) sample of each wire and/or cable actually employed in the System and each certification tag for approval before continuing with the installation as described herein.
 - c. Fiberoptic Cables: Refer to Specification Section 27 15 00, Horizontal and Vertical TIP Communications Cabling; Paragraph 2.4.C12.d. Fiberoptic Cables - for minimum technical standards and requirements for additional System cables.

- d. Copper Cables: Refer to Specification Section 27 15 00, Horizontal and Vertical TIP Communications Cabling; Paragraph 2.4.C12.c. Copper Cables - for minimum technical standards and requirements for additional System voice and data cables.
 - e. Line Level Audio and Microphone Cable:
 - 1) Line level audio and microphone cable for inside racks and conduit.
 - 2) Shielded, twisted pair Minimum 22AWG, stranded conductors and 24AWG drain wire with overall jacket.
 - f. Speaker Level Audio (70.7Volt RMS):
 - 1) For use with 70.7V speaker circuits.
 - 2) 18AWG stranded pair, minimum.
 - g. All cabling shall be plenum or riser (UL-1666) rated.
 - h. Provide one (1) spare 1,000 foot roll of approved System (not microphone) cable only.
2. Raceways, Back Boxes and conduit:
- a. In addition to the Raceways, Equipment Room Fittings provided under Specification Sections 27 15 00 TIP Communication Room Fittings and 27 15 00 - TIP Communications Horizontal and Vertical Cabling, provide the following additional TIP raceway and fittings:
 - b. Each raceway that is open top, shall be: UL certified for telecommunications systems, partitioned with metal partitions in order to comply with NEC Parts 517 & 800 to "mechanically separate telecommunications systems of different service, protect the installed cables from falling out when vertically mounted and allow junction boxes to be attached to the side to interface "drop" type conduit cable feeds.
 - c. Intercommunication System cable infrastructure: EMT or in J-hooks above accessible ceilings, 24 inches on center.
 - d. Junction boxes shall be not less than 2-1/2 inches deep and 6 inches wide by 6 inches long.
 - e. Flexible metal conduit is prohibited unless specifically approved by 0050P3B.
 - f. System Conduit:
 - 1) The PA system is NFPA listed as Emergency / Public Safety Communication System which requires the entire system to be installed in a separate conduit system.

- 2) The use of centralized mechanically partitioned wireways may be used to augment main distribution conduit on a case by case basis when specifically approved by VA Headquarters (0050P3B).

- 3) Conduit Sleeves:

- a) The AE has made a good effort to identify where conduit sleeves through full-height and fire rated walls on the drawings, and has instructed the electrician to provide the sleeves as shown on the drawings.
- b) While the sleeves shown on the drawings will be provided by others, the contractor is responsible for installing conduit sleeves and fire-proofing where necessary. It is often the case, that due to field conditions, the nurse-call cable may have to be installed through an alternate route. Any conduit sleeves required due to field conditions or those omitted by the engineer shall be provided by the cabling contractor.

- g. Device Back Boxes:

- 1) Furnish to the electrical contractor all back boxes required for the PA system devices.
- 2) The electrical contractor shall install the back boxes as well as the system conduit. Coordinate the delivery of the back boxes with the construction schedule.

3. UPS:

- a. Provide a backup battery or a UPS for the System to allow normal operation and function (as if there was no AC power failure) in the event of an AC power failure or during input power fluctuations for a minimum of 30 minutes.
- b. As an alternate solution, the telephone system UPS may be utilized to meet this requirement at the headend location, as long as this function is specifically approved by the Telephone Contractor and the COTR.
- c. The Nurse Call Contractor shall not make any attachments or connection to the telephone system until specifically directed to do so, in writing, by the COTR.
- d. Provide UPS for all active system components including but not limited to:
 - 1) System Amplifiers.
 - 2) Microphone Consoles.

- 3) Telephone Interface Units.
- 4) TER, TR & Headend Equipment Rack(s).

M. Installation Kit:

1. General: The kit shall be provided that, at a minimum, includes all connectors and terminals, labeling systems, audio spade lugs, barrier strips, punch blocks or wire wrap terminals, heat shrink tubing, cable ties, solder, hangers, clamps, bolts, conduit, cable duct, and/or cable tray, etc., required to accomplish a neat and secure installation. All wires shall terminate in a spade lug and barrier strip, wire wrap terminal or punch block. Unfinished or unlabeled wire connections shall not be allowed. Turn over to the COTR all unused and partially opened installation kit boxes, coaxial, fiberoptic, and twisted pair cable reels, conduit, cable tray, and/or cable duct bundles, wire rolls, physical installation hardware. The following are the minimum required installation sub-kits:
 2. System Grounding:
 - a. The grounding kit shall include all cable and installation hardware required. All radio equipment shall be connected to earth ground via internal building wiring, according to the NEC.
 - b. This includes, but is not limited to:
 - 1) Fiberoptic Optic Cable Armor/External Braid
 - 2) Coaxial Cable Shields.
 - 3) Control Cable Shields.
 - 4) Data Cable Shields.
 - 5) Equipment Racks.
 - 6) Equipment Cabinets.
 - 7) Conduits.
 - 8) Cable Duct.
 - 9) Cable Trays.
 - 10) Interduct
 - 11) Power Panels.
 - 12) Connector Panels.
 - 13) Grounding Blocks.
 3. Fiberoptic Cable: The fiberoptic cable kit shall include all fiberoptic connectors, cable tying straps, interduct, heat shrink tubing, hangers, clamps, etc. required to accomplish a neat and secure installation.

4. Coaxial Cable: The coaxial cable kit shall include all coaxial connectors, cable tying straps, heat shrink tubing, hangers, clamps, etc., required to accomplish a neat and secure installation.
5. Wire and Cable: The wire and cable kit shall include all connectors and terminals, audio spade lugs, barrier straps, punch blocks, wire wrap strips, heat shrink tubing, tie wraps, solder, hangers, clamps, labels etc., required to accomplish a neat and orderly installation.
6. Conduit, Cable Duct, and Cable Tray: The kit shall include all conduit, duct, trays, junction boxes, back boxes, cover plates, feed through nipples, hangers, clamps, other hardware required to accomplish a neat and secure conduit, cable duct, and/or cable tray installation in accordance with the NEC and this document.
7. Equipment Interface: The equipment kit shall include any item or quantity of equipment, cable, mounting hardware and materials needed to interface the systems with the identified sub-system(s) according to the OEM requirements and this document.
8. Labels: The labeling kit shall include any item or quantity of labels, tools, stencils, and materials needed to completely and correctly label each subsystem according to the OEM requirements, as-installed drawings, and this document.
9. Documentation: The documentation kit shall include any item or quantity of items, computer discs, as installed drawings, equipment, maintenance, and operation manuals, and OEM materials needed to completely and correctly provide the system documentation as required by this document and explained herein.

PART 3 - EXECUTION

3.1 PROJECT MANAGEMENT

- A. Assign a single project manager to this project who will serve as the point of contact for the Owner, the General Contractor, and the Engineer.
- B. The Contractor shall be proactive in scheduling work at the hospital, specifically the Contractor will initiate and maintain discussion with the general contractor regarding the schedule for ceiling cover up and install cables to meet that schedule.
- C. Contact the Office of Telecommunications, Special Communications Team (0050P2B) at (301) 734-0350 to have a VA Certified Telecommunications COTR assigned to the project for telecommunications review, equipment and system approval and co-ordination with VA's Spectrum Management and OCIS Teams.

3.2 COORDINATION WITH OTHER TRADES

- A. Coordinate with the cabling contractor the location of the TV faceplate and the faceplate opening for the nurse call TV control jack.
- B. Coordinate with the cabling contractor the location of TIP equipment in the **TER, TCR, PCR, SCC, ECR, STRs, NSs, and TCOs in order to connect to the TIP cable network that was installed as a part of Section Specification 27 11 00. Contact the COTR immediately, in writing, if additional location(s) are discovered to be activated that was not previously provided.**
- C. Before beginning work, verify the location, quantity, size and access for the following:
 - 1. Isolated ground AC power circuits provided for systems.
 - 2. Primary, emergency and extra auxiliary AC power generator requirements.
 - 3. Junction boxes, wall boxes, wire troughs, conduit stubs and other related infrastructure for the systems.
 - 4. System components installed by others.
 - 5. Overhead supports and rigging hardware installed by others.
- D. Immediately notify the Owner, GC and Consultant(s) in writing of any discrepancies.

3.3 NEEDS ASSESSMENT

Provide a one-on-one meeting with the particular nursing manager of each unit affected by the installation of the new nurse call system. Review the floor plan drawing, educate the nursing manager with the functions of the equipment that is being provided and gather details specific to the individual units; coverage and priorities of calls; staffing patterns; and other pertinent details that will affect system programming and training.

3.4 INSTALLATION

- A. General:
 - 1. Execute work in accordance with National, State and local codes, regulations and ordinances.
 - 2. Install work neatly, plumb and square and in a manner consistent with standard industry practice. Carefully protect work from dust, paint and moisture as dictated by site conditions. The Contractor will be fully responsible for protection of his work during the construction phase up until final acceptance by the Owner.

3. Install equipment according to OEM's recommendations. Provide any hardware, adaptors, brackets, rack mount kits or other accessories recommended by OEM for correct assembly and installation.
4. Secure equipment firmly in place, including receptacles, speakers, equipment racks, system cables, etc.
 - a. All supports, mounts, fasteners, attachments and attachment points shall support their loads with a safety factor of at least 5:1.
 - b. Do not impose the weight of equipment or fixtures on supports provided for other trades or systems.
 - c. Any suspended equipment or associated hardware must be certified by the OEM for overhead suspension.
 - d. The Contractor is responsible for means and methods in the design, fabrication, installation and certification of any supports, mounts, fasteners and attachments.
5. Finishes for any exposed work such as plates, racks, panels, speakers, etc. shall be approved by the Architect, Owner and TVE 0050P3B.
6. Coordinate cover plates with field conditions. Size and install cover plates as necessary to hide joints between back boxes and surrounding wall. Where cover plates are not fitted with connectors, provide grommeted holes in size and quantity required. Do not allow cable to leave or enter boxes without cover plates installed.
7. Active electronic component equipment shall consist of solid state components, be rated for continuous duty service, comply with the requirements of FCC standards for telephone and data equipment, systems, and service.
8. Color code all distribution wiring to conform to the Nurse Call Industry Standard, EIA/TIA, and this document, whichever is the more stringent. At a minimum, all equipment, cable duct and/or conduit, enclosures, wiring, terminals, and cables shall be clearly and permanently labeled according to and using the provided record drawings, to facilitate installation and maintenance.
9. Connect the System's primary input AC power to the Facility's Critical Branch of the Emergency AC power distribution system as shown on the plans or if not shown on the plans consult with COTR regarding a suitable circuit location prior to bidding.

10. Product Delivery, Storage and Handling:
 - a. Delivery: Deliver materials to the job site in OEM's original unopened containers, clearly labeled with the OEM's name and equipment catalog numbers, model and serial identification numbers. The COTR may inventory the cable, patch panels, and related equipment.
 - b. Storage and Handling: Store and protect equipment in a manner, which will preclude damage as directed by the RE.
 11. Where TCOs are installed adjacent to each other, install one outlet for each instrument.
 12. Equipment installed outdoors shall be weatherproof or installed in weatherproof enclosures with hinged doors and locks with two keys.
- B. Equipment Racks/Cabinets:
1. Fill unused equipment mounting spaces with blank panels or vent panels. Match color to equipment racks/cabinets.
 2. Provide security covers for all devices not requiring routine operator control.
 3. Provide vent panels and cooling fans as required for the operation of equipment within the OEM' specified temperature limits. Provide adequate ventilation space between equipment for cooling. Follow manufacturer's recommendations regarding ventilation space between amplifiers.
 4. Provide insulated connections of the electrical raceway to equipment racks.
 5. Provide continuous raceway/conduit with no more than 40% fill between wire troughs and equipment racks/cabinets for all non-plenum-rated cable. Ensure each system is mechanically separated from each other in the wireway.
 6. Ensure a minimum of 36 inches around each cabinet and/or rack to comply with OSHA Safety Standards. Cabinets and/or Racks installed side by side - the 36 inch rule applies to around the entire assembly
- C. Distribution Frames.
1. A new stand-alone (i.e., self supporting, free standing) PA rack/frame may be provided in each TR to interconnect the TCR, PCR, SCC, NS, STRs & ECRs. Rack/frames shall be wired in accordance with industry standards and shall employ "latest state-of-the-art"

modular cross-connect devices. The PA riser cable shall be sized to satisfy all voice/digital requirements plus not less than 50% spare (growth) capacity in each TR which includes a fiber optic backbone.

2. The frames/racks shall be connected to the TER/MCR system ground.
- D. Wiring Practice - in addition to the MANDATORY infrastructure requirements outlined in VA Construction Specifications 27 10 00 - TIP Structured Communications Cabling, 27 11 00 - TIP Communications Rooms Fittings and 27 15 00 - TIP Horizontal and Vertical Communicators Cabling, the following additional practices shall be adhered too:
1. Comply with requirements for raceways and boxes specified in Division 26 Section "Raceway and Boxes for Electrical Systems."
 2. Execute all wiring in strict adherence to the National Electrical Code, applicable local building codes and standard industry practices.
 3. Wiring shall be classified according to the following low voltage signal types:
 - a. Balanced microphone level audio (below -20dBm) or Balanced line level audio (-20dBm to +30dBm)
 - b. 70V audio speaker level audio.
 - c. Low voltage DC control or power (less than 48VDC)
 4. Where raceway is to be EMT (conduit), wiring of differing classifications shall be run in separate conduit. Where raceway is to be an enclosure (rack, tray, wire trough, utility box) wiring of differing classifications which share the same enclosure shall be mechanically partitioned and separated by at least four (4) inches. Where Wiring of differing classifications must cross, they shall cross perpendicular to one another.
 5. Do not splice wiring anywhere along the entire length of the run. Make sure cables are fully insulated and shielded from each other and from the raceway for the entire length of the run.
 6. Do not pull wire through any enclosure where a change of raceway alignment or direction occurs. Do not bend wires to less than radius recommended by manufacturer.
 7. Replace the entire length of the run of any wire or cable that is damaged or abraided during installation. There are no acceptable methods of repairing damaged or abraided wiring.
 8. Use wire pulling lubricants and pulling tensions as recommended by the OEM.

9. Use grommets around cut-outs and knock-outs where conduit or chase nipples are not installed.
10. Do not use tape-based or glue-based cable anchors.
11. Ground shields and drain wires to the Facility's signal ground system as indicated by the drawings.
12. Field wiring entering equipment racks shall be terminated as follows:
 - a. Provide OEM directed service loops at harness break-outs and at plates, panels and equipment. Loops should be sufficient to allow plates, panels and equipment to be removed for service and inspection.
 - b. Line level and speaker level wiring may be terminated inside the equipment rack using specified terminal blocks (see "Products.") Provide 15% spare terminals inside each rack. Microphone level wiring may only be terminated at the equipment served.
 - c. If specified terminal blocks are not designed for rack mounting, utilize 3/4 inch plywood or 1/8 inch thick aluminum plates/blank panels as a mounting surface. Do not mount on the bottom of the rack.
 - d. Employ permanent strain relief for any cable with an outside diameter of 1" or greater.
13. Use only balanced audio circuits unless noted otherwise directed and indicated on the drawings.
14. Make all connections as follows:
 - a. Make all connections using rosin-core solder or mechanical connectors appropriate to the application.
 - b. For crimp-type connections, use only tools that are specified by the manufacturer for the application.
 - c. Use only insulated spade lugs on screw terminals. Spade lugs shall be sized to fit the wire gauge. Do not exceed two lugs per terminal.
 - d. Wire nuts, electrical tape or "Scotch Lock" connections are not acceptable for any application.
15. Noise filters and surge protectors shall be provided for each equipment interface cabinet, switch equipment cabinet, control console, local, and remote active equipment locations to ensure protection from input primary AC power surges and noise glitches are not induced into low Voltage data circuits.

16. Wires or cables **previously approved** to be installed outside of conduit, cable trays, wireways, cable duct, etc:
- a Only when specifically authorized as described herein, will wires or cables be identified and approved to be installed outside of conduit. The wire or cable runs shall be UL rated plenum and OEM certified for use in air plenums.
 - b Wires and cables shall be hidden, protected, fastened and tied at 600 mm (24 in.) intervals, maximum, as described herein to building structure.
 - c Closer wire or cable fastening intervals may be required to prevents sagging, maintain clearance above suspended ceilings, remove unsightly wiring and cabling from view and discourage tampering and vandalism. Wire or cable runs, not provided in conduit, that penetrate outside building walls, supporting walls, and two hour fire barriers shall be sleeved and sealed with an approved fire retardant sealant.
 - d Wire or cable runs to system components installed in walls (i.e.: volume attenuators, circuit controllers, signal, or data outlets, etc.) may, when specifically authorized by the RE, be fished through hollow spaces in walls and shall be certified for use in air plenum areas.
 - e Completely test all of the cables after installation and replace any defective cables.
 - f Wires or cables that are installed outside of buildings shall be in conduit, secured to solid building structures. If specifically approved, on a case by case basis, to be run outside of conduit, the wires or cables shall be installed, as described herein. The bundled wires or cables must: Be tied at not less than 460 mm (18 in.) intervals to a solid building structure; have ultra violet protection and be totally waterproof (including all connections). The laying of wires or cables directly on roof tops, ladders, drooping down walls, walkways, floors, etc. is not allowed and will not be approved.
- E. Cable Installation - Cable Installation - In addition to the **MANDATORY** infrastructure requirements outlined in VA Construction Specifications 27 10 00 - Structured TIP Communications Cabling, 27 11 00 - TIP Communications Rooms and Fittings and 27 15 00 - TIP Communications

Horizontal and Vertical Cabling and the following additional practices shall be adhered too:

1. Support cable on maximum 2'-0" centers. Acceptable means of cable support are cable tray, j-hooks, and bridal rings. Velcro wrap cable bundles loosely to the means of support with plenum rated Velcro straps. Plastic tie wraps are not acceptable as a means to bundle cables.
2. Run cables parallel to walls.
3. Install maximum of 10 cables in a single row of J-hooks. Provide necessary rows of J-hooks as required by the number of cables.
4. Do not lay cables on top of light fixtures, ceiling tiles, mechanical equipment, or ductwork. Maintain at least 2 foot clearance from all shielded electrical apparatus.
5. All cables shall be tested after the total installation is fully complete. All test results are to be documented. All cables shall pass acceptable test requirements and levels. Contractor shall remedy any cabling problems or defects in order to pass or comply with testing. This includes the re-pull of new cable as required at no additional cost to the Owner.
6. Ends of cables shall be properly terminated on both ends per industry and OEM's recommendations.
7. Provide proper temporary protection of cable after pulling is complete before final dressing and terminations are complete. Do not leave cable lying on floor. Bundle and tie wrap up off of the floor until you are ready to terminate.
8. Terminate all conductors; no cable shall contain unterminated elements. Make terminations only at outlets and terminals.
9. Splices, Taps, and Terminations: Arrange on numbered terminal strips in junction, pull, and outlet boxes; terminal cabinets; and equipment enclosures. Cables may not be spliced.
10. Bundle, lace, and train conductors to terminal points without exceeding OEM's limitations on bending radii. Install lacing bars and distribution spools.
11. Cold-Weather Installation: Bring cable to room temperature before dereeling. Heat lamps shall not be used.
12. Cable shall not be run through structural members or be in contact with pipes, ducts, or other potentially damaging items.

13. Separation of Wires: (REFER TO RACEWAY INSTALLATION) Separate speaker-microphone, line-level, speaker-level, and power wiring runs. Install in separate raceways or, where exposed or in same enclosure, separate conductors at least 12 inches apart for speaker microphones and adjacent parallel power and telephone wiring. Separate other intercommunication equipment conductors as recommended by equipment manufacturer.
 14. Serve all cables as follows:
 - a. Cover the end of the overall jacket with a 1 inch (minimum) length of transparent heat-shrink tubing. Cut unused insulated conductors 2 inch (minimum) past the heat-shrink, fold back over jacket and secure with cable-tie. Cut unused shield/drain wires 2 inch (minimum) past the Heatshrink and serve as indicated below.
 - b. Cover shield/drain wires with heat-shrink tubing extending back to the overall jacket. Extend tubing 1/4 inch past the end of unused wires, fold back over jacket and secure with cable tie.
 - c. For each solder-type connection, cover the bare wire and solder connection with heat-shrink tubing.
- F. Labeling: Provide labeling in accordance with ANSI/EIA/TIA-606-A. All lettering for Nurse Call circuits shall be stenciled using **laser printers**.
1. Cable and Wires (Hereinafter referred to as "Cable"): Cables shall be labeled at both ends in accordance with ANSI/EIA/TIA-606-A. Labels shall be permanent in contrasting colors. Cables shall be identified according to the System "Record Wiring Diagrams."
 2. Equipment: System equipment shall be permanently labeled with contrasting plastic laminate or Bakelite material. System equipment shall be labeled on the face of the unit corresponding to its source.
 - a. Clearly, consistently, logically and permanently mark switches, connectors, jacks, relays, receptacles and electronic and other equipment.
 - b. Engrave and paint fill all receptacle panels using 1/8 inch (minimum) high lettering and contrasting paint.
 - c. For rack-mounted equipment, use engraved Lamacoid labels with white 1/8 inch (minimum) high lettering on black background. Label the front and back of all rack-mounted equipment.

3. Conduit, Cable Duct, and/or Cable Tray: The Contractor shall label all conduit, duct and tray, including utilized GFE, with permanent marking devices or spray painted stenciling a minimum of 3 meters (10 ft.) identifying it as the System. In addition, each enclosure shall be labeled according to this standard.
 4. Termination Hardware: The Contractor shall label TCOs and patch panel connections using color coded labels with identifiers in accordance with ANSI/EIA/TIA-606-A and the "Record Wiring Diagrams."
 5. Where multiple pieces of equipment reside in the same rack group, clearly and logically label each indicating to which room, channel, receptacle location, etc. they correspond.
 6. Permanently label cables at each end, including intra-rack connections. Labels shall be covered by the same, transparent heat-shrink tubing covering the end of the overall jacket. Alternatively, computer generated labels of the type which include a clear protective wrap may be used.
 7. Contractor's name shall appear no more than once on each continuous set of racks. The Contractor's name shall not appear on wall plates or portable equipment.
 8. Ensure each OEM supplied item of equipment has appropriate UL Labels / Marks for the service the equipment is performed permanently attached / marked to a non-removal board in the unit. EQUIPMENT INSTALLED NOT BEARING THESE UL MARKS WILL NOT BE ALLOWED TO BE A PART OF THE SYSTEM. THE CONTRACTOR SHALL BEAR ALL COSTS REQUIRED TO PROVIDE REPLACEMENT EQUIPMENT WITH APPROVED UL MARKS.
- G. Conduit and Signal Ducts: When the Contractor and/or OEM determines additional system conduits and/or signal ducts are required in order to meet the system minimum performance standards outlined herein, the contractor shall provide these items as follows:
1. Conduit:
 - a. The Contractor shall employ the latest installation practices and materials. The Contractor shall provide conduit, junction boxes, connectors, sleeves, weather heads, pitch pockets, and associated sealing materials not specifically identified in this document as GFE. Conduit penetrations of walls, ceilings, floors, interstitial space, fire barriers, etc., shall be sleeved and sealed.

- b. All cables shall be installed in separate conduit and/or signal ducts (exception from the separate conduit requirement to allow Nurse Call cables to be installed in partitioned cable tray with voice cables may be granted in writing by the COTR if requested). Conduits shall be provided in accordance with Section 27 05 33, RACEWAYS AND BOXES FOR COMMUNICATIONS SYSTEMS, and NEC Articles 517 for Critical Care and 800 for Communications systems, at a minimum.
 - c. When metal, plastic covered, etc., flexible cable protective armor or systems are specifically authorized to be provided for use in the System, their installation guidelines and standards shall be as specified herein, Section 27 05 33, RACEWAYS AND BOXES FOR COMMUNICATIONS SYSTEMS, and the NEC.
 - d. When "interduct" flexible cable protective systems is specifically authorized to be provided for use in the System, its installation guidelines and standards shall be as specified herein, Section 27 05 33, RACEWAYS AND BOXES FOR COMMUNICATIONS SYSTEMS, and the NEC.
 - e. Conduit fill (including GFE approved to be used in the system) shall not exceed 40%. Each conduit end shall be equipped with a protective insulator or sleeve to cover the conduit end, connection nut or clamp, to protect the wire or cable during installation and remaining in the conduit. Electrical power conduit shall be installed in accordance with the NEC. AC power conduit shall be run separate from signal conduit.
 - f. Ensure that Critical Care Nurse Call Systems (as identified by NEC Section 517) are completely separated and protected from all other systems.
2. Signal Duct, Cable Duct, or Cable Tray:
- a. The Contractor shall use GFE signal duct, cable duct, and/or cable tray, when identified and approved by the RE.
 - b. Approved signal and/or cable duct shall be a minimum size of 100 mm x 100 mm (4 in. X 4 in.) inside diameter with removable tops or sides, as appropriate. Protective sleeves, guides or barriers are required on all sharp corners, openings, anchors, bolts or screw ends, junction, interface and connection points.
 - c. Approved cable tray shall be fully covered, mechanically and physically partitioned for multiple electronic circuit use, and

be UL certified and labeled for use with telecommunication circuits and/or systems. The COTR shall approve width and height dimensions.

- d. All cable junctions and taps shall be accessible. Provide an 8 in. X 8 in. X 4 in. (minimum) junction box attached to the cable duct or raceway for installation of distribution system passive equipment. Ensure all equipment and tap junctions are accessible

3.5 PROTECTION OF NETWORK DEVICES

- A. Contractor shall protect network devices during unpacking and installation by wearing manufacturer approved electrostatic discharge (ESD) wrist straps tied to chassis ground. The wrist strap shall meet OSHA requirements for prevention of electrical shock, should technician come in contact with high voltage.

3.6 CUTTING, CLEANING AND PATCHING

- A. It shall be the responsibility of the contractor to keep their work area clear of debris and clean area daily at completion of work.
- B. It shall be the responsibility of the contractor to patch and paint any wall or surface that has been disturbed by the execution of this work.
- C. The Contractor shall be responsible for providing any additional cutting, drilling, fitting or patching required that is not indicated as provided by others to complete the Work or to make its parts fit together properly.
- D. The Contractor shall not damage or endanger a portion of the Work or fully or partially completed construction of the Owner or separate contractors by cutting, patching or otherwise altering such construction, or by excavation. The Contractor shall not cut or otherwise alter such construction by the Owner or a separate contractor except with written consent of the Owner and of such separate contractor; such consent shall not be unreasonably withheld. The Contractor shall not unreasonably withhold from the Owner or a separate Contractor the Contractor's consent to cutting or otherwise altering the Work.
- E. Where coring of existing (previously installed) concrete is specified or required, including coring indicated under unit prices, the location of such coring shall be clearly identified in the field and the location shall be approved by the COTR prior to commencement of coring work.

3.7 FIREPROOFING

- A. Where Nurse Call wires, cables and conduit penetrate fire rated walls, floors and ceilings, fireproof the opening.
- B. Provide conduit sleeves (if not already provided by electrical contractor) for cables that penetrate fire rated walls and Telecommunications Rooms floors and ceilings. After the cabling installation is complete, install fire proofing material in and around all conduit sleeves and openings. Install fire proofing material thoroughly and neatly. Seal all floor and ceiling penetrations.
- C. Use only materials and methods that preserve the integrity of the fire stopping system and its rating.
- D. Install fireproofing where low voltage cables are installed in the same manholes with high voltage cables; also cover the low voltage cables with arc proof and fireproof tape.
- E. Use approved fireproofing tape of the same type as used for the high voltage cables, and apply the tape in a single layer, one-half lapped or as recommended by the manufacturer. Install the tape with the coated side towards the cable and extend it not less than 25 mm (one inch) into each duct.
- F. Secure the tape in place by a random wrap of glass cloth tape.

3.8 GROUNDING

- A. Ground Nurse Call cable shields and equipment to eliminate shock hazard and to minimize ground loops, commonmode returns, noise pickup, cross talk, and other impairments as specified in CFM Division 27, Section 27 05 26 - Grounding and Bonding for Communications Systems.
- B. Facility Signal Ground Terminal: Locate at main room or area signal ground within the room (i.e. head end and telecommunications rooms) or area(s) and indicate each signal ground location on the drawings.
- C. Extend the signal ground to inside each equipment cabinet and/or rack. Ensure each cabinet and/or rack installed item of equipment is connected to the extended signal ground. Isolate the signal ground from power and major equipment grounding systems.
- D. When required, install grounding electrodes as specified in CFM Division 26, Section 26 05 26 -Grounding and Bonding for Electrical Systems.
- E. Do not use "3rd or 4th" wire internal electrical system conductors for communications signal ground.

- F. Do not connect the signal ground to the building's external lightning protection system.
- G. Do Not "mix grounds" of different systems.
- H. Insure grounds of different systems are installed as to not violate OSHA Safety and NEC installation requirements for protection of personnel.

PART 4 - TESTING / GUARANTY / TRAINING

4.0 SYSTEM LISTING

The Nurses Call System is NFPA listed as an "Emergency" Communication system. Therefore, the following testing and guaranty provisions are the minimum to be performed and provided by the contractor and Warranted by the OEM.

4.1 PROOF OF PERFORMANCE TESTING

A. Intermediate Testing:

1. After completion of 30 - 40% of the installation of a head end cabinet(s) and equipment, one master stations, local and remote stations, treatment rooms, and prior to any further work, this portion of the system must be pretested, inspected, and 1certified. Each item of installed equipment shall be checked to ensure appropriate UL Listing and Certification Labels are affixed as required by NFPA -Life Safety Code 101-3.2 (a) & (b), UL Nurse Call Standard 1069 and JCHCO evaluation guidelines, and proper installation practices are followed. The intermediate test shall include a full operational test.
2. All inspections and tests shall be conducted by an OEM-certified contractor representative and witnessed by TVE-0050P3B if there is no local Government Representative that processes OEM and VA approved Credentials to inspect and certify the system. The results of the inspection will be officially recorded by the Government Representative and maintained on file by the RE, until completion of the entire project. The results will be compared to the Acceptance Test results. An identical inspection may be conducted between the 65 - 75% of the system construction phase, at the direction of the COTR.

B. Pretesting:

1. Upon completing installation of the Nurse Call System, the Contractor shall align, balance, and completely pretest the entire system under full operating conditions.
 2. Pretesting Procedure:
 - a. During the System Pretest the Contractor shall verify (utilizing approved test equipment) that the System is fully operational and meets all the System performance requirements of this standard.
 - b. The Contractor shall pretest and verify that all PSM System functions and specification requirements are met and operational, no unwanted aural effects, such as signal distortion, noise pulses, glitches, audio hum, poling noise, etc. are present. At a minimum, each of the following locations shall be fully pretested:
 - 1) Central Control Cabinets.
 - 2) Nurse Control Stations.
 - a) Master Stations
 - b) Emergency Stations
 - 3) Dome Lights.
 - 4) STRs
 - 5) Local and Remote Enunciation Panels.
 - 6) Electrical Supervision Panels/Functions/locations.
 - 7) All Networked locations.
 - 8) System interface locations (i.e. wireless, PA, telephone, etc.).
 - 9) System trouble reporting.
 - 10) System electrical supervision.
 - 11) UPS operation.
 - 12) Primary / Emergency AC Power Requirements
 - 13) Extra Auxiliary Generator Requirements.
 - 14) NSs.
 3. The Contractor shall provide four (4) copies of the recorded system pretest measurements and the written certification that the System is ready for the formal acceptance test shall be submitted to the COTR.
- C. Acceptance Test:
1. After the Nurse Call System has been pretested and the Contractor has submitted the pretest results and certification to the RE, then the Contractor shall schedule an acceptance test date and give the

COTR 15 working days written notice prior to the date the acceptance test is expected to begin. The System shall be tested in the presence of a TVE 0050P3B and OEM certified representatives. The System shall be tested utilizing the approved test equipment to certify proof of performance and Life Safety / Critical Service compliance. The tests shall verify that the total System meets all the requirements of this specification. The notification of the acceptance test shall include the expected length (in time) of the test.

2. The acceptance test shall be performed on a "go-no-go" basis. Only those operator adjustments required to show proof of performance shall be allowed. The test shall demonstrate and verify that the installed System does comply with all requirements of this specification under operating conditions. The System shall be rated as either acceptable or unacceptable at the conclusion of the test. Failure of any part of the System that precludes completion of system testing, and which cannot be repaired in four (4) hours, shall be cause for terminating the acceptance test of the System. Repeated failures that result in a cumulative time of eight (8) hours to affect repairs shall cause the entire System to be declared unacceptable.
3. Retesting of the entire System shall be rescheduled at the convenience of the Government and costs borne by the Contractor at the direction of the COTR.

D. Acceptance Test Procedure:

1. Physical and Mechanical Inspection:

- a. The TVE 0050P3B Representative will tour all major areas where the Nurse Call System and all sub-systems are completely and properly installed to insure they are operationally ready for proof of performance testing. A system inventory including available spare parts will be taken at this time. Each item of installed equipment shall be checked to ensure appropriate UL certification labels are affixed.
- b. The System diagrams, record drawings, equipment manuals, TIP Auto CAD Disks, intermediate, and pretest results shall be formally inventoried and reviewed.
- c. Failure of the System to meet the installation requirements of this specification shall be grounds for terminating all testing.

2. Operational Test:

- a. After the Physical and Mechanical Inspection, the central terminating and nurse call master control equipment shall be checked to verify that it meets all performance requirements outlined herein. A spectrum analyzer and sound level meter may be utilized to accomplish this requirement.
- b. The distribution system shall be checked at each interface, junction, and distribution point, first, middle, and last intersectional, room, and bed dome light in each leg to verify that the nurse call distribution system meets all system performance standards.
- c. Additionally, each installed emergency station, dome light, power supply, code one, and remote annunciator panels shall be checked insuring they meet the requirements of this specification.
- d. Once these tests have been completed, each installed sub-system function shall be tested as a unified, functioning and fully operating system. The typical functions are: nurse follower, three levels of emergency signaling (i.e. flashing red emergency), minimum of 10 minutes of UPS operation, memory saving, minimum of ten station audio paging, canceling emergency calls at each originating station only, and storage and prioritizing of calls.
- e. Individual Item Test: The TVE 0050P3B Representative will select individual items of equipment for detailed proof of performance testing until 100% of the System has been tested and found to meet the contents of this specification. Each item shall meet or exceed the minimum requirements of this document.

3. Test Conclusion:

- a. At the conclusion of the Acceptance Test, using the generated punch list (or discrepancy list) the VA and the Contractor shall jointly agree to the results of the test, and reschedule testing on deficiencies and shortages with the COTR. Any retesting to comply with these specifications will be done at the Contractor's expense.
- b. If the System is declared unacceptable without conditions, all rescheduled testing expenses will be borne by the Contractor.

E. Acceptable Test Equipment: The test equipment shall furnished by the Contractor shall have a calibration tag of an acceptable calibration

service dated not more than 12 months prior to the test. As part of the submittal, a test equipment list shall be furnished that includes the make and model number of the following type of equipment as a minimum:

1. Spectrum Analyzer.
2. Signal Level Meter.
3. Volt-Ohm Meter.
4. Sound Pressure Level (SPL) Meter.
5. Oscilloscope.
6. Pillow Speaker Test Set (Pillow Speaker with appropriate load and cross connections in lieu of the set is acceptable).
7. Patient Push Button Cord Test Set.
8. Patient Bed with connecting multiple conductor cord.

4.2 SYSTEM GUARANTEE PERIOD OF SERVICE

A. Contractor's Responsibility:

1. The Contractor shall guarantee that all provided material and equipment will be free from defects, workmanship and will remain so for a period of one year from date of final acceptance of the System by the VA. The Contractor shall provide OEM's equipment warranty documents, to the COTR (or Facility Contracting Officer if the Facility has taken possession of the building), that certifies each item of equipment installed conforms to OEM published specifications.
2. The Contractor's maintenance personnel shall have the ability to contact the Contractor and OEM for emergency maintenance and logistic assistance, remote diagnostic testing, and assistance in resolving technical problems at any time. This contact capability shall be provided by the Contractor and OEM at no additional cost to the VA.
3. All Contractor maintenance and supervisor personnel shall be fully qualified by the OEM and must provide two (2) copies of current and qualified OEM training certificates and OEM certification upon request.
4. Additionally, the Contractor shall accomplish the following minimum requirements during the two year guaranty period:
 - a. Response Time during the Two Year Guaranty Period:
 - 1) The COTR (or Facility Contracting Officer if the system has been turned over to the Facility) is the Contractor's ONLY

OFFICIAL reporting and contact official for nurse call system trouble calls, during the guaranty period.

- 2) A standard work week is considered 8:00 A.M. EST to 5:00 P.M. EST or as designated by the COTR (or Facility Contracting Officer), Monday through Friday exclusive of Federal Holidays.
- 3) The Contractor shall respond and correct on-site trouble calls, during the standard work week to:
 - a) A routine trouble call within one (1) working day of its report. A routine trouble is considered a trouble which causes a pillow speaker or cordset, one (1) master nurse control station, patient station, emergency station, or dome light to be inoperable.
 - b) Routine trouble calls in critical emergency health care facilities (i.e., cardiac arrest, intensive care units, etc.) shall also be deemed as an emergency trouble call. The COTR (or Facility Contracting Officer) shall notify the Contractor of this type of trouble call.
 - c) An emergency trouble call within four hours of its report. An emergency trouble is considered a trouble which causes a sub-system (ward), distribution point, terminal cabinet, or code one system to be inoperable at anytime.
- 4) If a Nurse Call component failure cannot be corrected within four (4) hours (exclusive of the standard work time limits), the Contractor shall be responsible for providing alternate nurse call equipment. The alternate equipment/system shall be operational within a maximum of 20 hours after the four (4) hour trouble shooting time and restore the effected location operation to meet the System performance standards. If any sub-system or major system trouble cannot be corrected within one working day, the Contractor shall furnish and install compatible substitute equipment returning the System or sub-system to full operational capability, as described herein, until repairs are complete.
- b. Required On-Site Visits during the Two Year Guaranty Period
 - 1) The Contractor shall visit, on-site, for a minimum of eight (8) hours, once every 12 weeks, during the guaranty period, to perform system preventive maintenance, equipment cleaning, and

operational adjustments to maintain the System according the descriptions identified in this document.

- 2) The Contractor shall arrange all Facility visits with the COTR (or Facility Contracting Officer) prior to performing the required maintenance visits.
- 3) Preventive maintenance shall be performed by the Contractor in accordance with the OEM's recommended practice and service intervals during non-busy time agreed to by the COTR (or Facility Contracting Officer) and Contractor.
- 4) The preventive maintenance schedule, functions and reports shall be provided to and approved by the COTR (or Facility Contracting Officer).
- 5) The Contractor shall provide the COTR (or Facility Contracting Officer) a type written report itemizing each deficiency found and the corrective action performed during each required visit or official reported trouble call. The Contractor shall provide the COTR with sample copies of these reports for review and approval at the beginning of the Acceptance Test. The following reports are the minimum required:
 - a) The Contractor shall provide a monthly summary all equipment and sub-systems serviced during this guarantee period to COTR (or Facility Contracting Officer) by the fifth (5th) working day after the end of each month. The report shall clearly and concisely describe the services rendered, parts replaced and repairs performed. The report shall prescribe anticipated future needs of the equipment and systems for preventive and predictive maintenance.
 - b) The Contractor shall maintain a separate log entry for each item of equipment and each sub-system of the System. The log shall list dates and times of all scheduled, routine, and emergency calls. Each emergency call shall be described with details of the nature and causes of emergency steps taken to rectify the situation and specific recommendations to avoid such conditions in the future.
- 6) The COTR (or Facility Contracting Officer) shall convey to the Facility Engineering Officer, two (2) copies of actual reports for evaluation.

- a) The COTR (or Facility Contracting Officer) shall ensure a copy of these reports is entered into the System's official acquisition documents.
 - b) The Facility Chief Engineer shall ensure a copy of these reports is entered into the System's official technical record documents.
- B. Work Not Included: Maintenance and repair service shall not include the performance of any work due to improper use; accidents; other vendor, contractor, or owner tampering or negligence, for which the Contractor is not directly responsible and does not control. The Contractor shall immediately notify the COTR or Facility Contracting Officer in writing upon the discovery of these incidents. The COTR or Facility Contracting Officer will investigate all reported incidents and render

4.3 TRAINING

- A. Provide thorough training of all nursing staff assigned to those nursing units receiving new networked nurse/patient communications equipment. This training shall be developed and implemented to address two different types of staff. Floor nurses/staff shall receive training from their perspective, and likewise, unit secretaries (or any person whose specific responsibilities include answering patient calls and dispatching staff) shall receive operational training from their perspective. A separate training room will be set up that allows this type of individualized training utilizing in-service training unit, prior to cut over of the new system.
- B. Provide the following minimum training times and durations:
 - 1. **48** hours prior to opening for nursing staff (in 8-hour increments) - split evenly over 3 weeks and day and night shifts. Coordinate schedule with Owner.
 - 2. **32** hours during the opening week for nursing staff - both day and night shifts.
 - 3. **24** hours for supervisors and system administrators.

5.0 ATTACHMENTS

- A. The following items are required as a part of the system:
 - 1. COTS Documents:
 - a. Checklist for Software Licensing Agreements
 - b. Solicitation / Contract / Order for Commercial Items

- c. Memorandum of Understanding (MOU) for Non-VA Licensed Wireless Operations
- d. VA Headquarters (VACO) Memorandum of Understanding (MOU) for Federal Communications Commission (FCC) Part 15 Listed "Non-Regulated Equipment Wireless Operations"

CHECKLIST FOR SOFTWARE LICENSING AGREEMENTS
(For use in commercial item acquisition [COTS] conforming to – FAR Part 12)

The Government may not be able to accept standard commercial licensing agreement without modification; <u>you must</u> negotiate terms and conditions so it is consistent with the FAR and the VAAR.		
Is the license (check all that apply):	Yes	No
Exclusive		
Non-exclusive		
Perpetual		
Limited term		
If limited term, state the period (months or years):		
If limited term, is there an automatic renewal provision?		
CPU based		
If CPU based, state number of machines and whether simultaneous use is permitted:		
Site license		
If site license, state the site/location:		
Network license		
Other basis (e.g., # of users, # of transactions, etc.) (state specifics)		
Applicable to only the current version (doesn't apply to future versions)		
Software maintenance included at no extra cost		
Allow for office relocation or transfer		
Allow copying for backup or archival purpose		
Allow no cost copy at disaster recovery site		
Restricted on Use: (see note below)		
Restricted on the processing of data by or for user's subsidiaries and affiliates		
Restricted on processing of third party data (or use in service bureau)		
Restricted on network use		
Restricted on site and equipment limitations		
Restricted on number of users (e.g., cannot exceed # of users)		
Terms and Conditions that may need to be negotiated:	Yes	No
Does the license prohibit use of the software outside of the Government? If yes, this needs to be deleted/modified if other Government contractors need access to the software (as GFP) to fulfill obligations of their own contracts.		
Does license state that the software is Year 2000 compliant or include a Year 2000 warranty? If no, must ensure it is compliant per FAR 39 or include a Y2K warranty.		
Does the license state that it provides no warranties or guarantees of any kind? If yes, need to determine whether additional warranty would be in the best interest of the Government.		
Does the license warrant that the software does not contain any code (e.g., virus) that will disable the software, and if such code exists, that Licensor agrees to indemnify the licensee (user) for all damages suffered as a result of such code? If no, need to negotiate for such warranty.		
Does the license allow access to source code? If no, negotiate for access if software will be modified or customized for the Government's needs or if the Government intends to maintain the software itself.		
Does the license require Licensor to deposit source code in escrow account? If no and source code is needed, consider negotiating for this provision, and state what "release conditions" are.		
Does the license allow the Government to hold the rights to customized code and to the data that the software manipulates? If no, negotiate for the rights if the Government (customer) requires them.		
Does the license authorize us to copy user manuals for internal purposes? If no, negotiate for authorization if multiple copies must be made for our internal use or ensure that the vendor supplies adequate number of copies. May also negotiate for updated manuals at periodic intervals, e.g., with each major update.		
Does the license state that licensee modifications to the software void all warranties? If yes, ensure that the vendor still warrants the unmodified portions.		
Does the license include clauses that prohibit needed uses of software, restrict the use of output from the software, or inappropriately burden the operation of the computer facilities? If yes, need to negotiate better terms and conditions.		
Is the dispute clause in the license consistent with FAR 52.233-1, Disputes Clause? If no, then need to modify license to be consistent with FAR.		
Does the default clause in the license allow for the Government to terminate for convenience or for cause, consistent with FAR 52.212-4(l) or FAR 52.212-4(m)? If no, then need to modify license to be consistent with FAR Part 12 (not FAR Part 49).		

b.

SOLICITATION/CONTRACT/ORDER FOR COMMERCIAL ITEMS OFFEROR TO COMPLETE BLOCKS 12, 17, 23, 24, & 30			1. REQUISITION NUMBER		PAGE 1 OF 7
2. CONTRACT NO.	3. AWARD/EFFECTIVE DATE SEE BLOCK 31C	4. ORDER NUMBER	5. SOLICITATION NO.		6. SOLICITATION ISSUE DATE
7. FOR SOLICITATION	a. NAME		b. TELEPHONE NUMBER (No collect calls)		8. OFFER DUE DATE/
9. ISSUED BY: CODE			10. THIS ACQUISITION IS <input type="checkbox"/> UNRESTRICTED <input type="checkbox"/> SETASIDE: 100 % FOR <input type="checkbox"/> SMALL BUSINESS <input type="checkbox"/> HUBZONE SMALL BUSINESS <input type="checkbox"/> 8 (A) NAICS: 541511 SIZE STANDARD:		11. DELIVERY FOR FOB DESTINATION UNLESS BLOCK IS MARKED <input type="checkbox"/> SEE SCHEDULE <input type="checkbox"/> 13a. THIS CONTRACT IS A RATED ORDER UNDER DPAS (15 CFR 700) 13b. RATING 14. METHOD OF SOLICITATION <input checked="" type="checkbox"/> RFQ <input type="checkbox"/> IFB <input type="checkbox"/> RFP
15. DELIVER TO CODE			16. ADMINISTERED BY CODE		

See #9 above

17a. CONTRACTOR/ CODE		FACILI TY		18a. PAYMENT WILL BE MADE BY	CODE	
OFFEROR		CODE		UNITED STATES OF AMERICA		
				Department of Veterans Affairs		
				FMS		
				P.O. Box 149971		
TELEPHONE NO: 703.246-0392				Austin, TX 78714-8971		

<input type="checkbox"/> 17b. CHECK IF REMITTANCE IS DIFFERENT AND PUT SUCH ADDRESS IN OFFER	18b. SUBMIT INVOICES TO ADDRESS SHOWN IN BLOCK 18a. UNLESS BLOCK BELOW IS CHECKED <input checked="" type="checkbox"/> SEE ADDENDUM
--	--

19. ITEM NO.	20. SCHEDULE OF SUPPLIES/SERVICES	21. QUANTITY	22. UNIT	23. UNIT PRICE	24. AMOUNT
	See page 2				
	Use Reverse and/or (Attach Additional Sheets as Necessary)				

25. ACCOUNTING AND APPROPRIATION DATA	26. TOTAL AWARD AMOUNT (For Govt. Use Only)
---------------------------------------	--

☐ 27a. SOLICITATION INCORPORATES BY REFERENCE FAR 52.212-1, 52.212-4, FAR 52.212-3 AND 52.212-5 ARE ATTACHED. ADDENDA ☐ ARE NOT ATTACHED.

☒ 27b. CONTRACT/PURCHASE ORDER INCORPORATES BY REFERENCE FAR 52.212-4, 52.227-14, 52.227-16, and 52.227-19. ADDENDA ☒ ARE NOT ATTACHED.

<input checked="" type="checkbox"/> 28. CONTRACTOR IS REQUIRED TO SIGN THIS DOCUMENT AND RETURN <u> 1 </u> COPIES TO ISSUING OFFICE. CONTRACTOR AGREES TO FURNISH AND DELIVER ALL ITEMS SET FORTH OR OTHERWISE IDENTIFIED ABOVE AND ON ANY ADDITIONAL SHEETS SUBJECT TO THE TERMS AND CONDITIONS SPECIFIED HEREIN.	<input type="checkbox"/> 29. AWARD OF CONTRACT: REF. _____ OFFER DATED _____. YOUR OFFER ON SOLICITATION (BLOCK 5), INCLUDING ANY ADDITIONS OR CHANGES WHICH ARE SET FORTH HEREIN, IS ACCEPTED AS TO ITEMS:		
30A. SIGNATURE OF OFFEROR/CONTRACTOR	31a. UNITED STATES OF AMERICA (SIGNATURE OF CONTRACTING OFFICER)		
30b. NAME AND TITLE OF SIGNER (Type or Print)	30c. DATE SIGNED	31b. NAME OF CONTRACTING OFFICER (Type or Print) Contracting Officer	31c. DATE SIGNED

AUTHORIZED FOR LOCAL
REPRODUCTION

COMPUTER-GENERATED

STANDARD FORM 1449
(REV. 4/2002)

PREVIOUS EDITION IS NOT
USABLE

Prescribed By GSA
- FAR (48CFR) 53.212

19.	20.	21.	22.	23.	24.
ITEM NO.	SCHEDULE OF SUPPLIES/SERVICES	QUANTITY	UNIT	UNIT PRICE	AMOUNT

This Contract is Firm Fixed Price (FFP). The Contractor is required to provide the software, software license, and software maintenance services for the computer software identified below. Distribution of maintenance copies shall be accomplished by using an appropriate magnetic, electronic or printed media. Software maintenance includes periodic updates, enhancements and corrections to the software, and reasonable technical support, all of which are customarily provided by the Contractor to its customers.

The name of the software is: Word 2008

License Type: Perpetual or Term?????

Software Manufacturer: Microsoft

Governing Law. Federal law and regulations, including the Federal Acquisition Regulations ("FAR"), shall govern this Contract or Order (Contract/Order). Commercial license agreements may be made a part of this Contract/Order but only if both parties expressly make them an addendum. If the commercial license agreement is not made an addendum, it shall not apply, govern, be a part of or have any effect whatsoever on this Contract/Order; this includes, but is not limited to, any agreement embedded in the computer software (clickwrap) or any agreement that is otherwise delivered with or provided to the Government with the commercial computer software or documentation (shrinkwrap), or any other license agreement otherwise referred to in any document. If a commercial license agreement is made an addendum, only those provisions addressing data rights regarding the Government's use, duplication and disclosure of data (e.g., restricted computer software) are included and made a part of this Contract/Order, and only to the extent that those provisions are not duplicative or inconsistent with Federal law, Federal regulation or the incorporated FAR clauses; those provisions in the commercial license agreement that do not address data rights regarding the Government's use, duplication and disclosure of data shall not be included or made a part of the Contract/Order. Federal law and regulation, including without limitation, the Contract Disputes Act (41 U.S.C. §601-613), the Anti-Deficiency Act (31 U.S.C. §1341 et seq.), the Competition in Contracting Act (41 U.S.C. §251, et seq), the Prompt Payment Act (31 U.S.C. §3901, et seq.) and FAR clauses 27.52-23-60, 52.212-4, 52.227-14, 52.227-19 shall supersede, control and render ineffective any inconsistent, conflicting or duplicative provision in any commercial license

	Microsoft Word 2008 Software License, Part No. 9891-7069.				
	Software may be installed on four separate personal computers and be used by any VA employee or support service contractor.				
1	Licenses are perpetual.	4	EA	\$10,000.00	\$40,000.00
	12 months of Standard Microsoft Word Software Maintenance and Technical Support Services for the software being acquired under CLIN 1; Part No. 9891-7069.	4	EA	\$2,500.00	\$10,000.00
2	Total				\$50,000.00

32a. QUANTITY IN COLUMN 21 HAS BEEN

☐ RECEIVED
 ☐ INSPECTED
 ☐ ACCEPTED, AND CONFORMS TO THE CONTRACT, EXCEPT AS NOTED:

32b. SIGNATURE OF AUTHORIZED GOVT. REPRESENTATIVE	32c. DATE	32d. PRINTED NAME AND TITLE OF AUTHORIZED GOVERNMENT REPRESENTATIVE
32e. MAILING ADDRESS OF AUTHORIZED GOVERNMENT REPRESENTATIVE		32f. TELEPHONE NO. OF AUTHORIZED GOVERNMENT REPRESENTATIVE
		32g. E-MAIL OF AUTHORIZED GOVERNMENT REPRESENTATIVE

33. SHIP NUMBER	34. VOUCHER NUMBER	35. AMOUNT VERIFIED CORRECT FOR	36. PAYMENT <input type="checkbox"/> COMPLETE <input type="checkbox"/> PARTIAL <input type="checkbox"/> PARTIAL <input type="checkbox"/> FINAL	37. CHECK NUMBER
<input type="checkbox"/> PARTIAL <input type="checkbox"/> FINAL				
38. S/R ACCOUNT NUMBER	39. S/R VOUCHER NUMBER	40. PAID BY		
41a. I CERTIFY THIS ACCOUNT IS CORRECT AND PROPER FOR PAYMENT			42a. RECEIVED BY (Print)	

41b. SIGNATURE AND TITLE OF CERTIFYING OFFICER	41c. DATE		
		42b. RECEIVED AT (Location)	
		42c. DATE REC'D (YY/MM/DD)	42d. TOTAL CONTAINERS

STANDARD FORM

1449 (REV. 4/2002) BACK

**ADDENDUM A -ADDITIONAL TERMS AND CONDITIONS FOR CONTRACT # _____ OR
ORDER# _____**

A.1 Federal Acquisition Regulation (FAR) Incorporated by Reference. The Contractor agrees to comply with the following FAR clauses, which the Contracting Officer has indicated as being incorporated in this Contract/Order by reference, to implement provisions of law or executive orders applicable to acquisitions of this nature, to implement department policy or to clarify the Government's requirement. Copies of clauses in full text will be provided on request. FAR Clauses can be viewed at <http://www.arnet.gov/far/>.

- 1) FAR 52.212-4, Contract Terms and Conditions-Commercial Items (Oct 2003)
- 2) FAR 52.227-14, Rights in Data-General (Dec 2007), Alt III
- 3) FAR 52.227-16, Additional Data Requirements (Jun 1987)
- 4) FAR 52.227-19, Commercial Computer Software License (Dec 2007)

A.2 Contracting Officer's Authority. The Contracting Officer is the only person authorized to make or approve any changes in any of the requirements of this Contract, and notwithstanding any provisions contained elsewhere in this Contract/Order, the said authority remains solely within the Contracting Officer. In the event the Contractor makes any changes at the direction of any person other than the Contracting Officer, the changes will be considered to have been made without authority and no adjustment will be made in the contract price to cover any increase in costs incurred as a result thereof.

A.3 VAAR 852.270-1 Representatives of Contracting Officers (APR 1984). The Contracting Officer reserves the right to designate representatives to act for him/her in furnishing technical guidance and advice or generally supervise the work to be performed under this Contract/Order. Such designation will be in writing and will define the scope and limitations of

the designee's authority. A copy of the designation shall be furnished the Contractor.

A.4 VAAR 852.270-4 Commercial Advertising (NOV 1984). The Contractor will not advertise the award of this Contract/Order in his/her commercial advertising in such a manner as to state or imply that the Department of Veterans Affairs endorses a product, project or commercial line of endeavor.

A.5 VAAR 852.237-70 Contractor Responsibilities (APR 1984) The Contractor shall obtain all necessary licenses and/or permits required to perform this work. He/she shall take all reasonable precautions necessary to protect persons and property from injury or damage during the performance of the Contract/Order. He/she shall be responsible for any injury to himself/herself, his/her employees, as well as for any damage to personal or public property that occurs during the performance of the Contract/Order that is caused by his/her employees fault or negligence, and shall maintain personal liability and property damage insurance having coverage for a limit as required by the laws of the state where services are performed. Further, it is agreed that any negligence of the Government, its officers, agents, servants and employees, shall not be the responsibility of the Contractor hereunder with the regard to any claims, loss, damage, injury, and liability resulting there from.

A.6 Indemnification. The Contractor shall save and hold harmless and indemnify the Government against any and all liability claims, and cost of whatsoever kind and nature for injury to or death of any person or persons and for loss or damage to any Contractor property or property owned by a third party occurring in connection with or in any way incident to or arising out of the occupancy, use service, operation, or performance of work under the terms of the Contract/Order, resulting in whole or in part from the acts or omissions of the Contractor, any subcontractor, or any employee, agent, or representative of the Contractor or subcontractor.

A.7 Government's Liability. The Government shall not be liable for any injury to the Contractor's personnel or damage to the Contractor's property unless such injury or damage is due to negligence on the part of the Government and is recoverable under the Federal Torts Claims Act, or pursuant to other Federal statutory authority.

A.10 Uniform Computer Information Transaction Act (UCITA). UCITA is not applicable to the Contract/Order.

A.11 Software License and Software Maintenance Subscription and Technical Support.

(1) Definitions.

- (a) Licensee. The term "licensee" shall mean the U.S. Department of Veterans Affairs ("VA") and is synonymous with "Government."
- (b) Licensor. The term "licensor" shall mean the software manufacturer of the computer software being acquired. The term "Contractor" is the company identified in Block 17a on the SF1449. If the Contractor is a reseller and not the Licensor, the Contractor remains responsible for performance under this Contract.
- (c) Software. The term "software" shall mean the licensed computer software product(s) cited in the Schedule of Supplies (Page 2).
- (d) Maintenance. The term "maintenance" is the process of enhancing and optimizing software, as well as remedying defects. It shall include all new fixes, patches, releases, updates, versions and upgrades, as further defined below.
- (e) Technical Support. The term "technical support" refers to the range of services providing assistance for the software via the telephone, email, a website or otherwise.
- (f) Release or Update. The term "release" or "update" are terms that refer to a revision of software that contains defect corrections, minor enhancements or improvements of the software's functionality. This is usually designated by a change in the number to the right of the decimal point (e.g., from Version 5.3 to 5.4). An example of an update is the addition of new hardware.
- (g) Version or Upgrade. The term "version" or "upgrade" are terms that refer to a revision of software that contains new or improved functionality. This is usually designated by a change in the number to the left of the decimal point (e.g., from Version 5.4 to 6).

(2) License. Grant of License and Term.

- (a) See also Addendum B.
- (b) Unless otherwise stated in the Schedule of Supplies/Services, the software license provided to the Government is a perpetual, nonexclusive license to use the software.
- (c) The license authorizes the Government to use the software in processing data for other federal agencies.
- (d) If the licensed software requires a password (or license key) to be operational, it shall be delivered with the software media and have no expiration date.
- (e) If the Government decides to outsource or contract its services, the Government may allow the outsourcer to use the licensed software solely to provide the services on its behalf. The outsourcer shall be bound by the provisions of this Contract relating to the use of the software.
- (f) If the software is for use in a networked environment, as may be reflected by the number of servers or users described in the Contract/Order, the license grant provided by the Contractor

includes the Government's use of the software in such environment.

- (g) Any dispute regarding the license grant or usage limitations shall be resolved in accordance with the Disputes Clause incorporated in FAR 52.212-4(d).
- (h) If the Government purchases additional licenses, the terms and conditions for those additional licenses (including technical support and upgrade subscription) shall be the same as agreed to in this Contract/Order, unless negotiated otherwise by mutual agreement of the parties.
- (i) The licensed software contains critical product functionality that meets the minimum needs of the Government and is the basis for the Government's procurement of the software; consequently, the Contractor agrees that the Government has the right to successor products at no additional cost when functionality is later unbundled from the product licensed herein and bundled into a new or different product, provided the Government is current on maintenance.
- (j) If the Contractor is a reseller for the computer software being acquired under this Contract/Order, it is permissible for the actual software manufacturer (Licensor) to deliver the software directly to the Government.
- (k) All limitations of software usage are expressly stated in the SF 1449 and Addendum A and Addendum B.

(3) Software Maintenance Subscription and Technical Support.

- (a) See also Addendum B.
- (b) Software maintenance and technical support are included at the agreed upon price. However, if additional charges are assessed during the maintenance and technical support period as a result of negotiated changes in the license (e.g., CPU upgrades), the fee shall be by mutual agreement of the parties and any dispute thereof shall be resolved in accordance with the Disputes Clause incorporated herein at FAR 52.212-4(g).
- (c) If the Government desires to continue software maintenance and support beyond the period identified in this Contract/Order, the Government will issue a separate contract or order to renew annual maintenance and technical support. Conversely, if an order or contract to renew software maintenance and technical support is not received, no assumption by the Contractor shall be made that it has been renewed. It shall not be automatically renewed.
- (d) Unless otherwise agreed, for any new additional software that may be licensed, the Contractor shall provide for software maintenance and technical support for the first year of the license at no additional cost.
- (e) Unless otherwise agreed, the Contractor shall provide VA with software maintenance, which includes periodic updates, upgrades, enhancements and corrections to the software, and reasonable technical support, all of which are customarily provided by the Contractor to its customers so as to cause the software to perform according to its specifications, documentation or demonstrated claims.
- (f) Any telephone support provided by Contractor shall be at no additional cost.

- (g) All technical support services will be provided in a timely manner in accordance with the Contractor's customary practice. However, prolonged delay in resolving software problems will be noted in the Government's various past performance records on the Contractor (e.g., www.ppirs.gov).
- (h) If the Government allows the maintenance and/or technical support to lapse and subsequently wishes to reinstate maintenance and technical support, any reinstatement fee charged shall not exceed the amounts that would have been charged if the Government had not allowed it to lapse.

A.12 Disabling Software Code. The Government requires delivery of computer software that does not contain any code that will, upon the occurrence or the nonoccurrence of any event, disable the software. Such code includes but is not limited to a computer virus, restrictive key, node lock, time-out or other function, whether implemented by electronic, mechanical, or other means, which limits or hinders the use or access to any computer software based on residency on a specific hardware configuration, frequency of duration of use, or other limiting criteria. If any such code is present, the Contractor agrees to indemnify the Government for all damages suffered as a result of a disabling caused by such code, and the Contractor agrees to remove such code upon the Government's request at no extra cost to the Government. Inability of the Contractor to remove the disabling software code will be considered an inexcusable delay and a material breach of contract, and the Government may exercise its right to terminate for cause. In addition, the Government is permitted to remove the code as it deems appropriate and charge the Contractor for consideration for the time and effort in removing the code.

A.13 Disaster Recovery Clause. Government hereby certifies to Contractor that it has a bona fide disaster plan with respect to the computer software programs used in its operations. The Contract/Order authorizes the Government's operation to maintain a second copy of software on tape for use at loading at sites that are not live (e.g. subscription-based disaster recovery services) for the sole purpose of duplicating or mirroring the software environment of the "primary" licenses at the designated licensed site and as described herein. Additionally, use of the software at the contingency sites must not include general access or any processing for program development or production. Contractor shall permit operation and testing of all licensed programs at the contingency sites as designated by the Government without prior approval and at no additional cost to the Government solely for the purpose of maintaining or implementing disaster recovery readiness including continuity of business operations. CPU's, MIPS or MSU's at these contingency sites are excluded from the total CPU's, MIPS or MSU's count included elsewhere in the Contract/Order and are not separately billable. Activation of operations at a contingency site shall be at Government's discretion. Government is authorized to install all software at the contingency sites for testing, problem resolution purposes, and to

ensure there will be no operational delays in association with transition of workload from the designated licensed site to the contingency sites. Use of the software at the contingency sites in the event of a disaster shall continue until such time as normal processing can be resumed at the "primary" site regardless of the duration required. Nothing in the Contract/Order diminishes the Government's rights in accordance with the data rights clause(s). Any license keys, codes, or passwords required by the Contractor in order to use the software at the contingency sites shall be provided to the Government within 10 days of the Government's request.

A.14 NOTICE OF THE FEDERAL ACCESSIBILITY LAW AFFECTING ALL ELECTRONIC AND INFORMATION TECHNOLOGY PROCUREMENTS (SECTION 508)

On August 7, 1998, Section 508 of the Rehabilitation Act of 1973 was amended to require that when Federal departments or agencies develop, procure, maintain, or use Electronic and Information Technology, that they shall ensure it allows Federal employees with disabilities to have access to and use of information and data that is comparable to the access to and use of information and data by other Federal employees.

Section 508 required the Architectural and Transportation Barriers Compliance Board (Access Board) to publish standards setting forth a definition of electronic and information technology and the technical and functional criteria for such technology to comply with Section 508. These standards have been developed were published with an effective date of December 21, 2000. Federal departments and agencies must develop all Electronic and Information Technology requirements to comply with the standards found in 36 CFR 1194 ._____*____ in performing this contract. (*Fill in Section Number and Title*)

ADDENDUM B - STATEMENT OF WORK FOR CONTRACT

#_____ or ORDER#_____

B.1 License. BROADLY DESCRIBE COMPUTING ENVIRONMENT AND HOW VA INTENDS TO USE THE SOFTWARE, HOW ITS LICENSED, WHAT THE SOFTWARE IS EXPECTED TO DO, ETC. TO GET YOU STARTED: The Department of Veterans Affairs (VA) has a need for the computer software identified on the Schedule of Supplies/Services (page 2) (software media and license) and software support services. The software will be installed **onto multiple servers** at the ITAC in Austin Texas for support/training/staging of the _____ Project. These are processor-based licenses that allow for unlimited users utilizing the processor(s). Contractor shall grant the Government the necessary license to

accommodate this need. VA may move the software to any other location or hardware at any time.

B.2 Maintenance. The Contractor will provide software maintenance services, which includes periodic updates, enhancements and corrections to the software, and reasonable technical support, all of which are customarily provided by the Contractor to its customers so as to cause the software to perform according to its specifications, documentation or demonstrated claims. Add detailed, specific maintenance and support information here. The Contractor will distribute maintenance updates or releases by using an appropriate magnetic, electronic, or printed media to the address in Block 15 of page one, but to the attention of Joe Smith. Alternatively, the Contractor may offer access to maintenance copies through its website. All maintenance services will be provided in a timely manner in accordance with the Contractor's customary practice. However, prolonged delay in resolving software problems will be noted in the Government's various past performance records on the Contractor (e.g., www.ppirs.gov).

2. MOU

Department of Veterans Affairs

Memorandum

Date: (Current Date)

From: Department of Veterans Affairs
Office of Telecommunications (005OP)
Spectrum Management (005OP2H3 – Room 047))
Telecommunications Voice Engineering (005OP2H2)
810 Vermont Avenue, NW
Washington, DC 20420

Subj: Memorandum of Understanding (MOU) for Non - VA Licensed Wireless Operations

To: Facility Director (00)
(Address)
(Address)

1. The following circumstances are the minimum necessary for conditional use of Wireless Equipment / System (s) in VA Owned or Leased Facilities (here-in after referred to as ‘the Facility’). VA Headquarters OI&T’s (005) Spectrum Management (005OP2H3), Telecommunications Voice Engineering, Special Communications (TVE - 005OP2H2) and Office of Cyber Security (OCIS – 0050P2) are the responsible entities insuring conformity of each requirement:
 - a. Each item of equipment or system whose Radio Frequency (RF) equipment is listed under Consolidated Federal Regulations (CFR), Title 47 – Federal Communications Commission (FCC), Part 15, Chapter 7, Use of Non Licensed Devices must be installed and operated in a manner consistent with Part 15’s “Safety of Life” restrictions. This information is re-emphasized in CFR, Title 15 – Department of Commerce, Under the Information Technology Management Reform Act (Public Law 104-106), National Telecommunications Information Administration (NTIA) Manual of Regulations and Procedures for Federal Radio Frequency Management (aka ‘The Red Book’).
 - b. FCC Part 15 listed RF devices ***shall not*** be Installed or used in areas where “Safety of Life” functions / operations are accomplished or where a ‘Code Blue’ enunciation may occur. A list of the minimum areas affected by this statement is provided as Attachment One.
 - c. If external or internal interference is detected and cannot be corrected, ***the FCC Part 15 Listed RF Equipment affected must be turned off until corrections and/or substitutions can be made.*** Contact VA’s Office of Spectrum Management (OSM – 005OP2H3), 202 461-5301 for specific conditional approval(s) concerning this issue.

3. Risk Assessment

Memorandum

Department of
Veterans Affairs

Date: (current date)

From: Director (XXXXX)

Address

Address

Address

Subj: VA Headquarters (VACO) Memorandum of Understanding (MOU) for
Federal Communications Commission (FCC) Part 15 Listed "Non-Regulated
Equipment Wireless Operations"

To: Department of Veterans Affairs
Office of Telecommunications (0050P)
Spectrum Management (0050P2H3)
Telecommunications Voice Engineering (0050P2H2)
1335 East West Highway, 3rd Floor
Silver Spring, Maryland 20420

1. We have received the subject VACO MOU (signed copy attached), and are pleased to provide the following information and comments for your review that includes our risks and risk-mitigation factors that prompted our Facility's decision:

a. RISK ASSESSMENT AND MITIGATION:

(1) Background:

(a) (name) VAMC (here-in-after referred to as "the Facility") has used (OEM Mdl Nr©) for over 10 years to allow nurses in the telemetry studio to communicate with nurses at the patients' bedside. This communication medium is a vital patient safety tool that allows for rapid response to the development of a potentially fatal arrhythmia such as ventricular tachycardia. The only information the telemetry technician states on the phone is "bed 109-2 Smith has an alarm for XXXXX." Last four is never communicated. In terms of the pager we have limited the information on the pager to sector, bed number and last name. We must include the last name as occasionally the patients are moved without the knowledge of the telemetry technician, if we were to have a patient mix up the page must contain the last name for safety reasons. Facility Management Services (FMS) has restricted paging access to the telemetry system only. Because pager access is restricted, only an administrator from Technology and Information Management (TIM) or FMS can troubleshoot a pager malfunction.

VAMC (City), (State - ZIP Code), Unregulated FCC Equipment Use, Risk Assessment and Mitigation, Page Two

(b) Because the phones are used 24X7 and have exceeded their life expectancy, many of them have begun to fail which creates a need to purchase newer models that will continue to insure system integrity.

(c) Our Facility has been prevented from purchasing replacement phones because VACO now has updated security and Information Technology (IT) connection controls along with continuing FCC Part 15 restrictions (described in the attached MOU) on devices of which these wireless phones are but one example. These updated security and connection controls are in place to address risks related life safety, information security, personal privacy and IT system integrity. The FCC restrictions continue to warn against the use of "non-regulated radio / wireless based equipment in safety of life locations and functions." Of note, these controls are intended to prevent use of these devices in areas especially where a code-blue announcement might occur, yet our devices have been used in such areas for over 10 years and so far has not prevented a code-blue announcement from happening.

(d) Because the Facility does not have a near-term alternative to the current wireless phones, it now faces a set of competing risks. On the one hand are the risks of privacy, connection and interference or security breach(s) that are behind the controls in place for these devices. On the other hand are risks to patient safety if the current phones were to fail and telemetry nurses would lose the ability to rapidly communicate with nurses at the bedside. Our Facility does have a Life Safety approved Nurses Call hardwired

system that is installed in those affected areas as the primary Enunciation media.

(2) SECURITY:

(a) NEC provides a proprietary scrambling algorithm that is applied to handset registration / authentication and all communications. Every time a (OEM Mdl Nr©) user enters a designated area within the systems' coverage; an automatic user authentication process is performed to confirm the device is authorized for service on the system. This information is scrambled using a proprietary coding scheme to prevent duplication. All voice conversations are also scrambled to enhance security.

(b) The (OEM Mdl Nr©) has several built in security features in each of the wireless handsets are administered through the Facility's Telephone Private Branch Exchange (PBX) administration tool; therefore, the PBX Administrator has full control over the (OEM Mdl Nr©) wireless phones, if one gets lost or stolen it can be disabled immediately. Because of this feature you cannot purchase a similar wireless phone and have it work on our network. These phones have a 50 ft radius from the Zone radio frequency (RF) transceiver; they can only be used within the hospital as there is no handoff via other cellular networks.

(c) These items are not NIST FIPS compliant; but based on the aforementioned facts, we feel patient / staff privacy and HIPAA instructions have been and will continue to be met.

(d) Our Facility will work with (OEM) and VACO's Office of Cyber Security (Name and Phone Nr) to secure the appropriate NIST FIPS certifications will allow VA to issue a Official Approvals from the onset in the IT equipment / system procurement process.

VAMC (City), (State - ZIP Code), Unregulated FCC Equipment Use, Risk Assessment and Mitigation, Page Three

(3) RADIO FREQUENCY (RF) INTERFERENCE:

(a) (OEM) engineers provided us with extensive information on the potential for RF along with electromagnetic (EM) interference to medical equipment within our Facility from the (OEM System) Wireless radio transceivers.

1) Field Experience: Since introduction of the (OEM System) Wireless product in 1996, NEC has installed this system at many health care institutions across the spectrum of medical departments. In all this time there have been zero reports of either suspected or actual RF and EM interference. This includes the experience using these devices at Portland VAMC and our continued testing documentation is available for review if requested.

2) Potential interference called Near Field Coupling: In these cases, an EM field emanating from one device may cause another

device within its field area to malfunction. Typically the distances for these fields are less than six (6) inches. In attempts to mitigate these sources of interference, standards have been put in place, namely IEC 60601. This standard calls for devices susceptible to interference to provide shielding against fields of up to three (3) Volts per Meter. In contrast, the (OEM System) wireless products are classified under the FCC Part 15 rules as Class B unlicensed devices, and as such must meet very tight restrictions regarding field emissions of a maximum of from 100 to 500 micro (μ) Volts per Meter across the band of RFs from 30 Hz to 18 GHz. Thus, any medical device even marginally meeting the IEC Standard has not had problems with any near field emissions.

3) Potential phenomenon known as Far Field Induced RFI: should be considered when studying RF and EM interference sources. In this case, a part of the device subject to interference (e.g., a wire, probe, or the casing itself) can inadvertently act as a receiving antenna for a signal transmitted from another device within close proximity (within 6 to 18 inches, depending on the source power levels). To realize this type of interference, the source transmitter power must be fairly strong to conduct through the inefficient nature of the unintended antenna of the receiving device, and the material acting as the antenna must be of a shape and length that matches or is a near multiple of the wavelength of the transmitted RF signal. Finally, this unintentional antenna must not have the typical shielding between it and the subject device's electronics, which if present would prevent such a received signal from causing interference. In the case of the (OEM System) Wireless transmission, which operates between 1,920 MHz and 1,930 MHz, a probe or such piece of any medical device measuring at about six (6) inches would match the wavelength of the RF carrier, and if not properly shielded from the units electronics may indeed conduct the RF energy within. However, even in this case, one must consider the power level at the so-called antenna receiving the signal. The average output of the (OEM Mdl Nr©) handset is approximately 10 mili (m) Watts when in use. This very low power, even further reduced by the distance between any handset in use and the subject receiving equipment, considered along with the high loss of the "antenna", results in a very low probability of actual interference. These facts, along with the standard procedures of your engineering department's efforts to check the medical equipment for such shielding and filtering defects, should mitigate this potential source.

4) Potential interference between intentional radiators operating in the RF band. Known as either in-band or out-of-band interference, these are cases where a transmitter broadcasts a signal of significant power at the other device's receiver to either overload the receiving radio or mix with the subject's transmitted signal to cause an interfered signal to be received. In-band interference

VAMC (City), (State - ZIP Code), Unregulated FCC Equipment Use, Risk Assessment and Mitigation, Page Four

in the Unlicensed PCS band of which the (OEM System) Wireless system operates is prevented by the FCC rules requiring our equipment to monitor the carrier on which a device intends to transmit on before

doing so, so as to sense any current use by another device. If such a signal is received during monitoring, we move to another carrier and try again. This protocol has been demonstrated many times within the FCC labs as well as at many industry trade shows where 5 or more vendors with U-PCS devices have operated in booths close to each other without interference. As for out-of-band interference, because of the extremely low power our devices operate with and the very strict out-of-band emission requirements placed upon the U-PCS devices, and the additional factor of a wide separation in the operating frequencies of our system and the typical radio telemetry equipment used in many hospital environments, such interference is very remote and would require extremely close proximity of the two devices.

5) All of our (OEM Mdl Nr©) are FCC listed and has not interfered with other traffic within the same band. We expect the FCC listed (OEM Mdl Nr©) equipment will perform in the same manner.

(b) Our Facility will work with (OEM) and VACO's Spectrum Management (0050P2H3) to find a RF band that can be utilized for this operation that will allow VA to issue a formal and Official Radio Use Permit that will negate the "unregulated equipment use" issues.

(4) CONNECTION TO IT/CABLE NETWORKS:

(a) Each item or system that attaches to a VA IT Network (telephone or data) must be Department of Commerce's National Recognized Testing Laboratory (NRTL) Underwriters Laboratory (UL) 60950-1/2; Information Technology Equipment - Safety listed and bears UL's mark.

1) Paragraph 1.1.1; Equipment Covered by this Standard specifically identifies these systems / networks as one affected system.

2) Paragraph 1.1.2; Additional Requirements further identifies this requirement for electromedical applications with physical connections to the patient be met.

(b) This requirement is paramount since the Facility's Telephone PABX and associated system is listed by the National Fire Protection Association as Critical Service. Additionally, since it carries our Radio and Overhead Audio Paging Signals, VA elevates it to Life Safety Service.

(c) Presently the (OEM Mdl Nr©) wireless phones are UL Listed but does not have the aforementioned specific UL certification. Our Facility is working with (The OEM) in this arena to have them meet or exceed this UL requirement. In the meantime we will abide within the confines outlined in the attached MOU for insuring an approved IT Network / System connection is maintained until the appropriate UL certification has been obtained allowing it to be directly connected to our telephone system.

b. The Facility Director after careful review of the attached MOU and consultation with the Facility's CIO, (OEM) engineers, Biomedical and NFPA Engineers, ISO, HIPAA / Privacy Officer, Clinical Staff and

JACHAO Officials has decided this risk-benefit analysis strongly favors purchasing replacement (OEM Mdl Nr) phones.

VAMC (City), (State - ZIP Code), Unregulated FCC Equipment Use, Risk Assessment and Mitigation, Page Four

2. Please feel free to contact me concerning the contents of this document.

DIRECTOR's NAME IN CAPS

cc: Office of General Consul
 Office of Telecommunications (05)
 VA Enterprise Infrastructure Engineering
 Telecommunications Engineering and Design
 Office of Cyber Security

Attachment: VACO MOU

- - - E N D - - -

SECTION 27 52 31
SECURITY EMERGENCY CALL, DURESS ALARM, AND TELECOMMUNICATIONS

PART 1 - GENERAL

1.1 SECTION SUMMARY

- A. Work covered by this document includes design, engineering, labor, material, products, guaranty, training and services for, and incidental to, the complete installation of a new and fully operating National Fire Protection Association (NFPA) Listed Critical Service Nurse-Call and Life Safety Code Blue communication system as detailed herein.
- B. Work shall be complete, tested, labeled, certified and ready for operation.

1.2 RELATED SECTIONS

- A. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA AND SAMPLES.
- B. Section 26 05 21, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES (600 Volts and Below).
- C. Section 26 41 00, FACILITY LIGHTNING PROTECTION.
- D. Section 27 05 26, GROUNDING AND BONDING FOR COMMUNICATIONS SYSTEMS.
- E. Section 27 05 11, REQUIREMENTS FOR COMMUNICATIONS INSTALLATIONS.
- F. Section 27 10 00, STRUCTURED CABLING.
- G. Section 27 15 00, COMMUNICATIONS HORIZONTAL CABLING.
- H. Section 27 05 33, RACEWAYS AND BOXES FOR COMMUNICATIONS SYSTEMS.

1.3 DEFINITIONS

- A. Provide: Design, engineer, furnish, install, connect complete, test, certify and guarantee.
- B. Work: Materials furnished and completely installed.
- C. Review of contract drawings: A service by the engineer to reduce the possibility of materials being ordered which do not comply with contract documents. The engineer's review shall not relieve the Contractor of responsibility for dimensions or compliance with the contract documents. The reviewer's failure to detect an error does not constitute permission for the Contractor to proceed in error.
- D. Headquarters (aka VACO) Technical Review, for National and VA Communications and Security, Codes, Frequency Licensing Standards, Guidelines and Compliance:

Office of Telecommunications
Special Communications Team (0050P3B)
1335 East West Highway - 3rd Floor
Silver Spring, Maryland 20910,

(O) 301-734-0350, (F) 301-734-0360

F. Owner: VA MEDICAL CENTER, Beckley, WV

G. General Contractor (GC): TBD

H. Contractor: Systems Contractor; you; successful bidder.

1.4 REFERENCES

- A. The installation shall comply fully with all governing authorities, laws and ordinances, regulations, codes and standards, including, but not limited to:
1. United States:
 - a. Department of Commerce:
 - 1) National Telecommunications and Information Administration (NTIA), Red Book, Chapter 7.8/9 Radio Frequency Restriction of Use and Compliance.
 - 2) National Institute of Standards Technology (NIST), Federal Information Processing Standards Publication (FIPS) 140-2, Security Requirements for Cryptographic Modules.
 - b. Department of Labor, Occupational Safety and Health Administration (OSHA): All standards for personnel physical and life safety.
 - c. Department of Veterans Affairs, Office of Cyber and Information Security (OCIS):
 - 1) Handbook 6500, Information Security Program.
 - 2) Spectrum Management Radio Frequency Compliance and Licensing Program.
 - 3) Wireless and Handheld Device Security Guideline Version 3.2, August 15, 2005.
 - d. Federal Communications Commission (FCC): Part 15, Restrictions of use for Part 15 listed Radio Equipment in Safety of Life / Emergency Functions / Equipment/Locations.
 2. American National Standards Institute/Electronic Industries Association/Telecommunications Industry Association (ANSI/EIA/TIA):

568-B	Commercial Building Telecommunications Wiring Standards:
569	Commercial Building Standard for Telecommunications Pathways and Spaces.
606	Administration Standard for the Telecommunications

	Infrastructure of Communications Buildings.
607	Commercial Building Grounding and Bonding Requirements for Telecommunications.
REC 127-49	Power Supplies.
RS 27	Tools, Crimping, Solderless Wiring Devices, Recommended Procedures for User Certification.

3. Institute of Electrical and Electronics Engineers (IEEE):

SO/TR 21730:2007	Use of mobile wireless communication and computing technology in healthcare facilities - Recommendations for electromagnetic compatibility (management of unintentional electromagnetic interference) with medical devices.
0739-5175/08/\$25.00©2008IEEE	Medical Grade - Mission Critical - Wireless Networks.
C62.41	Surge Voltages in Low-Voltage AC Power Circuits.

4. Joint Commission on Accreditation of Healthcare Organizations (JCAHO): All guidelines for Life and Public Safety and Emergency Communications.

5. NFPA:

70	National Electrical Code (current date of issue) - Articles 517, 645 and 800.
75	Standard for Protection of Electronic Computer Data-Processing Equipment.
77	Recommended Practice on Static Electricity.
99	Healthcare Facilities.
101	Life Safety Code.

6. Underwriters Laboratories (UL):

65	Standard for Wired Cabinets.
468	Standard for Grounding and Bonding Equipment.
1449	Standard for Transient Voltage Surge Suppressors.

1069	Hospital Signaling and Nurse Call Equipment.
60950-1/2	Information Technology Equipment - Safety.

7. State Hospital Code(s).

8. Local Codes.

1.5 QUALIFICATIONS

- A. The OEM shall have had experience with three or more installations of Public Address Systems of comparable size and complexity concerning type and design as specified herein. Each of these installations shall have performed satisfactorily for at least 1 year after final acceptance by the user. Include the names, locations and point of contact for these installations as a part of the submittal.
- B. The Contractor shall submit certified documentation that they have been an authorized distributor and service organization for the OEM for a minimum of 3 years. The Contractor shall be authorized by the OEM to pass thru the OEM's warranty of the installed equipment to VA. In addition, the OEM and Contractor shall accept complete responsibility for the design, installation, certification, operation, and physical support for the system. This documentation, along with the system Contractor and OEM certifications must be provided in writing as part of the Contractor's Technical submittal.
- C. The Contractor's Communications Technicians assigned to the system shall be fully trained, qualified, and certified by the OEM on the engineering, installation, operation, and testing of the system. The Contractor shall provide formal written evidence of current OEM certification(s) for the installer(s) as a part of the submittal or to the Contracting Officer's Technical Representative (COTR) before being allowed to commence work on the system.
- D. Applicable national, state and local licenses.
- E. Certificate of successful completion of OEM's installation/training school for installing technicians of the equipment being proposed.

1.6 CODES AND PERMITS

Provide all necessary permits and schedule all inspections as identified in the contract's milestone chart, so that the system is proof of performance tested and ready for operation on a date directed by the Owner.

1.7 SCHEDULING

- A. After the award of contract, the Contractor shall prepare a detailed schedule (aka milestone chart) using "Microsoft Project" software or equivalent. The Contractor Project Schedule (CPS) shall indicate detailed activities for the projected life of the project. The CPS shall consist of detailed activities and their restraining relationships. It will also detail manpower usage throughout the project.
- B. It is the responsibility of the Contractor to coordinate all work with the other trades for scheduling, rough-in, and finishing all work specified. The owner will not be liable for any additional costs due to missed dates or poor coordination of the supplying Contractor with other trades.

1.8 REVIEW OF CONTRACT DRAWINGS AND EQUIPMENT DATA SUBMITTALS

- Submit at one time within 10 days of contract awarding, drawings and product data on all proposed equipment and system. Check for compliance with contract documents and certify compliance with Contractor's "APPROVED" stamp and signature.
- B. Support all submittals with descriptive materials, i.e., catalog sheets, product data sheets, diagrams, and charts published by the manufacturer. These materials shall show conformance to specification and drawing requirements.
- C. Where multiple products are listed on a single cut-sheet, circle or highlight the one that you propose to use. Provide a complete and thorough equipment list of equipment expected to be installed in the system, with spares, as a part of the submittal. Special Communications (0050P3B - herein after referred to as 0050P3B) will not review any submittal that does not have this list.
- D. Provide four copies to the PM for technical review. The PM will provide a copy to the offices identified in Paragraph 1.3.C and D, at a minimum for compliance review as described herein where each responsible individual(s) should respond to the PM within 10 working days of receipt of their acceptance or rejection of the submittal(s).

1.9 PROJECT RECORD DOCUMENTS (AS BUILTS)

- A. Throughout progress of the work, maintain an accurate record of changes in Contract Documents. Upon completion of Work, transfer recorded changes to a set of Project Record Documents.
- B. The floor plans shall be marked in pen to include the following:

1. All device locations with labels.
2. Conduit locations.
3. Head-end equipment and specific location.
4. Wiring diagram.
5. Labeling and administration documentation.
6. Warranty certificate.
7. System test results.

1.10 WARRANTIES/GUARANTY

- A. The Contractor shall warrant the installation to be free from defect in material and workmanship for a period of 1 year from the date of acceptance of the project by the owner. The Contractor shall agree to remedy covered defects within 8 hours of notification of major failures or within twenty-four (24) hours of notification for individual station related problems.
- B. Refer to Part 4 for applicable System Guarantee requirements.

1.11 USE OF THE SITE

- A. Use of the site shall be at the GC's direction.
- B. Coordinate with the GC for lay-down areas for product storage and administration areas.
- C. Coordinate work with the GC and their sub-Contractors.
- D. Access to buildings wherein the work is performed shall be directed by the GC.

1.12 DELIVERY, STORAGE, AND HANDLING

- A. Deliver, store, and handle products using means and methods that will prevent damage, deterioration, and loss, including theft.
- B. Store products in original containers.
- C. Coordinate with the GC for product storage. There may be little or no storage space available on site. Plan to potentially store materials off site.
- D. Do not install damaged products. Remove damaged products from the site and replaced with new product at no cost to the Owner.

1.13 PROJECT CLOSEOUT

- A. Prior to final inspection and acceptance of the work, remove all debris, rubbish, waste material, tools, construction equipment, machinery and surplus materials from the project site and thoroughly clean your work area.
- B. Before the project closeout date, the Contractor shall submit:
 1. Warranty certificate.

2. Evidence of compliance with requirements of governing authorities such as the Low Voltage Certificate of Inspection.
 3. Project record documents.
 4. Instruction manuals and software that is a part of the system.
- C. Contractor shall submit written notice that:
1. Contract Documents have been reviewed.
 2. Project has been inspected for compliance with contract.
 3. Work has been completed in accordance with the contract

PART 2 - PRODUCTS AND FUNCTIONAL REQUIREMENTS

2.1 GENERAL REQUIREMENTS FOR EQUIPMENT AND MATERIALS

- A. Coordinate features and select components to form an integrated system. Match components and interconnections for optimum performance of specified functions.
- B. Expansion Capability: Increase number of stations in the future by 25 percent above those indicated without adding any internal or external components or main trunk cable conductors.
- C. Equipment: Modular type using solid-state components, fully rated for continuous duty unless otherwise indicated. Select equipment for normal operation on input power usually supplied at 110 to 130 V, 60 Hz.
- D. Weather-Resistant Equipment: Listed and labeled by an OSHA certified National Recognized Testing Laboratory (NRTL - i.e. UL) for duty outdoors or in damp locations.

2.2 SYSTEM DESCRIPTION

- A. System hardware shall consist of an indoor or outdoor enclosures, poles, strobe lights, intercom system, intercom stations, intercom master stations, and power supplies. All necessary equipment required to meet the intent of these specifications, whether or not enumerated within these specifications, shall be supplied and installed to provide a complete and operating nurse and patient communications network.
- B. Systems firmware shall be the product of a reputable firmware OEM of record with a proven history of product reliability and sole control over all source code. Manufacturer shall provide, free of charge, product firmware/software upgrades for a period of two year from date of acceptance by VA for any product feature enhancements. System configuration programming changes shall not require any exchange of parts and shall be capable of being executed remotely via a modem connection (when specifically approved by 0050P2B).

2.3 EMERGENCY CALL STATIONS

- A. The emergency call station shall be a dual button emergency phone. The unit shall be an ADA compliant, multi-function, high strength, vandal resistant security unit. The unit shall include a high quality, vandal resistant, hands free communications device, a powerful (1 million candlepower) strobe light and a vivid blue area light, which serves to identify the unit from great distances. The unit shall include an integrated wall mount enclosure assembly and an emergency phone station.
- B. The unit shall have an integrated blue light and strobe encased in Lexan. The blue light shall be always lit, calling attention to the location of the emergency communication unit. When the emergency phone is activated, the strobe shall flash at 1 million candlepower and 60 fpm. The strobe shall flash until either actively terminated by the personnel receiving the call or automatically upon termination of the call itself.
- C. The wall mount enclosure shall be made of a vandal resistant, 12-gauge No.4 vertical brushed stainless steel. It shall be designed to withstand prolonged exposure to harsh environments. The unit shall have a blue light/strobe located at the top of the unit, housed in a vandal resistant, blue polycarbonate refractor housing. This blue light and strobe shall be further enclosed in a clear polycarbonate security enclosure. The wall mount shall measure 12 1/8 inches w x 32 1/4 inches h x 7 9/16 inches d and weigh approximately 75 lbs. The ADA-compliant, hands-free emergency phone shall be flush mounted into the wall mount enclosure. Emergency phone station faceplate shall be 12-gauge No.4 brushed stainless steel or as otherwise approved.
- D. The housing for pole mount unit shall be a concentric steel cylinder (bollard) with an 8.75 inch diameter, a .25 inch wall thickness and a height of 84 inches. The unit shall have a blue light and strobe located at the top of the unit. A deep blue polycarbonate prismatic refractor that distributes the light in a horizontal pattern, making the flash bright and visible even at great distances, shall cover the strobe. The ADA-compliant, hands-free emergency phone shall be flush mounted into the pole mount housing. The unit weight approximately 275 lbs.
- E. The blue light and strobe shall be controlled via the emergency phone, and connect to an auxiliary output of the emergency phone. The

emergency phone shall connect via its RJ-11 connector to a standard phone line or PBX extension. The emergency phone should not require connection to any power source other than the telephone line. The blue light, strobe, and faceplate light require 24VAC, 60Hz power.

F. The unit shall have the following features:

1. Interface with Owner's PBX or regular phone line.
2. Vandal resistant stainless steel faceplate and metal button(s).
3. Phone line powered; no power supply or battery backup required.
4. LED indicator for hearing impaired.
5. Cast metal raised letter and Braille signage for ADA compliance.
6. Auto-answer that allows security to monitor and initiate calls with Owner provided phone.
7. Auxiliary input and outputs programmable to integrate with CCTV and security systems.

G. Tamper resistant fasteners shall be used. It shall not be possible to enter the unit or remove any component without a special computer designed bit-wrench designed for the purpose. These bit-wrenches are available only from the manufacturer of the unit. All other types of fasteners shall not be acceptable due to the abundance of non-proprietary tools available for their removal.

H. The entire unit shall be water and insect resistant when fully assembled.

I. The system shall immediately and automatically dial the security desk when activated. In addition, activation shall simultaneously cause the blue strobe light to flash at no less than 60 times per minute and where indicated activate CCTV camera switching via an interface to the CCTV system and the access control system.

J. Mounting:

1. Wall mount security call stations shall be attached to the wall with anchors bolts as recommended by the manufacturer or otherwise indicated herein.
2. Security call station poles shall be secured as shown on the drawings.

K. Electrical:

1. All electrical components shall have quick-disconnect terminals with plug and receptacle attachments for easy service or removal. All wiring shall be concealed within the unit and shall not be visible from the outside.

2. The unit shall require 24 VAC under normal operation. The entire unit shall be surge protected.

L. Strobe Lights:

1. The strobe light shall generate approximately 1,000,000 candlepower, and have a flash rate of no less than 60 flashes per minute. It shall be covered by a deep blue polycarbonate, prismatic refractor that distributes the light in a horizontal pattern, making the flash bright and visible even at great distances. The strobe light shall be situated within the housing, inaccessible to vandals and weather resistant.
2. The strobe shall be automatically activated when the "Emergency" button is touched, and shall flash until the receiving party of the call deactivates it. The strobe cannot be deactivated at the unit itself.

M. Communications:

1. Each unit shall have a high quality, vandal resistant and ADA compliant communications device.
2. The speakerphone shall have the following standard features:
 - a. Three number dialing capability.
 - b. Programmable from a remote location.
 - c. Two input relays.
 - d. Two output relays.
 - e. Remote speaker volume adjustment.
 - f. Capable of playing up to two digitally stored voice messages.
 - g. Programmable passwords.
 - h. Capable of using interchangeable faceplates.
 - i. Silent dial out.
 - j. Output sound level >80 dB at 1 meter for normal conversation.
 - k. Waterproof speaker.
 - l. Waterproof microphone.
 - m. Auto answer and auto shut-off.
 - n. Operating temperatures of -40°F to +150°F (-40° to +65°C).
 - o. Speakerphone electronics are conformal coated to withstand harsh environments.

N. Graphics:

1. The graphics shall be cut from an engineering grade reflective vinyl for high visibility and legibility, with a seven-year durability.

2. The standard graphics text shall be "Emergency". Standard colors shall be reflective white, reflective blue and reflective black.
- O. Finish:
1. For wall mounted unit, the finish shall be stainless steel. The finish shall be uniform and free of visible defects.
 2. For pole mounted unit, the unit shall be finished with a coating process known to be highly graffiti resistant and UV resistant.
- P. Security Call Station Power Supply:
1. Security Call Station power supply shall power multiple call stations.
 2. Power supply shall include the following:
 - a. Steel, NEMA 1 rated enclosure.
 - b. AC power indicator with power On/Off switch.
 - c. 120 or 230 VAC selectable input.
 - d. 24VAC output or 28VAC output for longer runs.
 - e. Main fused input.
 - f. 10A current capacity.
 - g. 8 fused outputs.
 - h. Input wire size 12-16 gauge.
 - i. Output wire size 12-22 gauge solid or stranded wire.
- Q. Security Call Station Cable
1. Call Station communication cable shall meet manufacturers' requirement.
 2. Call Station power cable shall be minimum 14 awg wire or as otherwise approved. Power cable for each call station shall be home run from the power supply to the respective call station unit.
 3. Cables installed underground or in underground conduits must be rated for direct burial installation.
 4. Cables used inside a building must be labeled for indoor use as described in NFPA 70, the National Electric Code. Cables shall be plenum rated if used in a plenum space and riser rated in all other areas.

2.4 UNINTERRUPTIBLE POWER SUPPLY (UPS)

- A. Provide a backup battery or a UPS for the system to allow normal operation and function (as if there was no AC power failure) in the event of an AC power failure or during input power fluctuations for a minimum of 15 minutes.

- B. As an alternate solution, the telephone system UPS may be utilized to meet this requirement at the head-end location, as long as this function is specifically approved by the Telephone Contractor and the COTR.
- C. The Contractor shall not make any attachments or connection to the telephone system until specifically directed to do so, in writing, by the COTR.
- D. Provide UPS for all active system components including but not limited to:
 - 1. Intercom head-end
 - 2. Master intercom stations
 - 3. Remoted intercom stations

PART 3 - EXECUTION

3.1 PROJECT MANAGEMENT

- A. Assign a single project manager to this project who will serve as the point of contact for the Owner, the General Contractor, and the Engineer.
- B. The Contractor shall be proactive in scheduling work at the hospital, specifically the Contractor will initiate and maintain discussion with the General Contractor regarding the schedule for ceiling cover up and install cables to meet that schedule.
- C. Contact the Office of Telecommunications, Special Communications Team (0050P3B) at (301) 734-0350 to have a VA Certified Telecommunications COTR assigned to the project for telecommunications review, equipment and system approval and co-ordination with VA's Spectrum Management and OCIS Teams.

3.2 COORDINATION WITH OTHER TRADES

- A. Coordinate with the cabling contractor the location of security emergency call and duress alarm equipment in the Telecommunications Closets.
- B. Before beginning work, verify the location, quantity, size and access for the following:
 - 1. Isolated ground AC power circuits provided for systems.
 - 2. Junction boxes, wall boxes, wire troughs, conduit stubs and other related infrastructure for the systems.
 - 3. System components installed by others.
 - 4. Overhead supports and rigging hardware installed by others.

- C. Immediately notify the Owner, General Contractor and Engineer in writing of any discrepancies.

3.3 INSTALLATION

A. General:

1. Execute work in accordance with National, State and local codes, regulations and ordinances.
2. Install work neatly, plumb and square and in a manner consistent with standard industry practice. Carefully protect work from dust, paint and moisture as dictated by site conditions. The Contractor will be fully responsible for protection of his work during the construction phase up until final acceptance by the Owner.
3. Install equipment according to OEM's recommendations. Provide any hardware, adaptors, brackets, rack mount kits or other accessories recommended by OEM for correct assembly and installation.
4. Secure equipment firmly in place, including intercom stations, equipment racks, system cables, etc.
 - a. All supports, mounts, fasteners, attachments and attachment points shall support their loads with a safety factor of at least 5:1.
 - b. Do not impose the weight of equipment or fixtures on supports provided for other trades or systems.
 - c. Any suspended equipment or associated hardware must be certified by the OEM for overhead suspension.
 - d. The Contractor is responsible for means and methods in the design, fabrication, installation and certification of any supports, mounts, fasteners and attachments.
5. Finishes for any exposed work such as plates, racks, panels, towers, enclosures, intercom stations, etc. shall be approved by the Architect, Owner and 0050P3B.
6. Coordinate cover plates with field conditions. Size and install cover plates as necessary to hide joints between back boxes and surrounding wall. Where cover plates are not fitted with connectors, provide grommets in size and quantity required. Do not allow cable to leave or enter boxes without cover plates installed.

B. Equipment Racks:

1. Fill unused equipment mounting spaces with blank panels or vent panels. Match color to equipment racks.

2. Provide security covers for all devices not requiring routine operator control.
 3. Provide vent panels and cooling fans as required for the operation of equipment within the OEM's specified temperature limits. Provide adequate ventilation space between equipment for cooling. Follow manufacturer's recommendations regarding ventilation space between amplifiers.
 4. Provide insulated connections of the electrical raceway to equipment racks.
 5. Provide continuous raceway and conduit with no more than 40 percent fill between wire troughs and equipment racks for all non-plenum-rated cable. Ensure each system is mechanically separated from each other in the wireway.
- C. Wiring Practice:
1. Comply with requirements for raceways and boxes specified in Division 26, Section 26 05 33 RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS.
 2. Execute all wiring in strict adherence to the National Electrical Code, applicable local building codes and standard industry practices.
 3. Wiring shall be classified according to the following low voltage signal types:
 - a. Voice audio
 - b. Low voltage DC control or power (less than 48VDC).
 4. Where raceway is to be EMT (conduit), wiring of differing classifications shall be run in separate conduit. Where raceway is to be an enclosure (rack, tray, wire trough, utility box) wiring of differing classifications which share the same enclosure shall be mechanically partitioned and separated by at least four (4) inches. Where Wiring of differing classifications must cross, they shall cross perpendicular to one another.
 5. Do not splice wiring anywhere along the entire length of the run. Make sure cables are fully insulated and shielded from each other and from the raceway for the entire length of the run.
 6. Do not pull wire through any enclosure where a change of raceway alignment or direction occurs. Do not bend wires to less than radius recommended by manufacturer.

7. Replace the entire length of the run of any wire or cable that is damaged or abraded during installation. There are no acceptable methods of repairing damaged or abraded wiring.
8. Use wire pulling lubricants and pulling tensions as recommended by the OEM.
9. Use grommets around cut-outs and knock-outs where conduit or chase nipples are not installed.
10. Do not use tape-based or glue-based cable anchors.
11. Ground shields and drain wires as indicated by the drawings or recommended by the OEM.
12. Field wiring entering equipment racks shall be terminated as follows:
 - a. Provide ample service loops at harness break-outs and at plates, panels and equipment. Loops should be sufficient to allow plates, panels and equipment to be removed for service and inspection.
 - b. If specified terminal blocks are not designed for rack mounting, utilize 3/4 inch plywood or 1/8 inch thick aluminum plates/blank panels as a mounting surface. Do not mount on the bottom of the rack.
 - c. Employ permanent strain relief for any cable with an outside diameter of 1 inch or greater.
13. Make all connections as follows:
 - a. Make all connections using rosin-core solder or mechanical connectors appropriate to the application.
 - b. For crimp-type connections, use only tools that are specified by the manufacturer for the application.
 - c. Use only insulated spade lugs on screw terminals. Spade lugs shall be sized to fit the wire gauge. Do not exceed two lugs per terminal.
 - d. Wire nuts, electrical tape or "Scotch Lock" connections are not acceptable for any application.
- D. Cable Installation - In addition to the mandatory infrastructure requirements outlined in VA Construction Specification, Section 27 10 00, STRUCTURED CABLING, the following additional practices shall be adhered to:
 1. Support cable on maximum 2 foot centers. Acceptable means of cable support are cable tray, j-hooks, and bridal rings. Velcro wrap cable bundles loosely to the means of support with plenum rated Velcro

straps. Plastic tie wraps are not acceptable as a means to bundle cables.

2. Run cables parallel to walls.
3. Install maximum of 10 cables in a single row of J-hooks. Provide necessary rows of J-hooks as required by the number of cables.
4. Do not lay cables on top of light fixtures, ceiling tiles, mechanical equipment, or ductwork. Maintain at least 2 foot clearance from all shielded electrical apparatus.
5. All cables shall be tested after the total installation is fully complete. All test results are to be documented. All cables shall pass acceptable test requirements and levels. Contractor shall remedy any cabling problems or defects in order to pass or comply with testing. This includes the re-pull of new cable as required at no additional cost to the Owner.
6. Ends of cables shall be properly terminated on both ends per industry and OEM's recommendations.
7. Provide proper temporary protection of cable after pulling is complete before final dressing and terminations are complete. Do not leave cable lying on floor. Bundle and tie wrap up off the floor until you are ready to terminate.
8. Cover the end of the overall jacket with a 1 inch (minimum) length of transparent heat-shrink tubing. Cut unused insulated conductors 2 inches (minimum) past the heat-shrink, fold back over jacket and secure with cable-tie. Cut unused shield/drain wires 2 inches (minimum) past the Heat-shrink and serve as indicated below.
9. Cover shield/drain wires with heat-shrink tubing extending back to the overall jacket. Extend tubing 1/4 inch past the end of unused wires, fold back over jacket and secure with cable tie.
10. For each solder-type connection, cover the bare wire and solder connection with heat-shrink tubing.
11. Terminate conductors; no cable shall contain unterminated elements. Make terminations only at outlets and terminals.
12. Splices, Taps, and Terminations: Arrange on numbered terminal strips in junction, pull, and outlet boxes; terminal cabinets; and equipment enclosures. Cables may not be spliced.
13. Bundle, lace, and train conductors to terminal points without exceeding OEM's limitations on bending radii. Install lacing bars and distribution spools.

14. Cold-Weather Installation: Bring cable to room temperature before dereeling. Heat lamps shall not be used.
 15. Cable shall not be run through structural members or be in contact with pipes, ducts, or other potentially damaging items.
 16. Separation of Wires: (Refer to Raceway Installation) Separate speaker-microphone, line-level, speaker-level, and power wiring runs. Install in separate raceways or, where exposed or in same enclosure, separate conductors at least 12 inches apart for speaker microphones and adjacent parallel power and telephone wiring. Separate other intercommunication equipment conductors as recommended by equipment manufacturer.
 17. Serve all cables as follows:
 - a. Cover the end of the overall jacket with a 1 inch (minimum) length of transparent heat-shrink tubing. Cut unused insulated conductors 2 inches (minimum) past the heat-shrink, fold back over jacket and secure with cable-tie. Cut unused shield/drain wires 2 inches (minimum) past the heat-shrink and serve as indicated below.
 - b. Cover shield/drain wires with heat-shrink tubing extending back to the overall jacket. Extend tubing 1/4 inch past the end of unused wires, fold back over jacket and secure with cable tie.
 - c. For each solder-type connection, cover the bare wire and solder connection with heat-shrink tubing.
- F. Labeling:
1. Clearly, consistently, logically and permanently mark switches, connectors, jacks, relays, receptacles and electronic and other equipment.
 2. Engrave and paint fill all receptacle panels using 1/8 inch (minimum) high lettering and contrasting paint.
 3. For rack-mounted equipment, use engraved Lamacoid labels with white 1/8 inch (minimum) high lettering on black background. Label the front and back of all rack-mounted equipment.
 4. Where multiple pieces of equipment reside in the same rack group, clearly and logically label each indicating to which room, channel, receptacle location, etc. they correspond.
 5. Permanently label cables at each end, including intra-rack connections. Labels shall be covered by the same, transparent heat-shrink tubing covering the end of the overall jacket. Alternatively,

computer generated labels of the type which include a clear protective wrap may be used.

6. Contractor's name shall appear no more than once on each continuous set of racks. The Contractor's name shall not appear on wall plates or portable equipment.
7. Provide printed labels at both ends of the cable.
8. Ensure each OEM supplied equipment has appropriate UL Labels/Marks for the service the equipment is performed permanently attached/marked. Equipment installed not bearing these UL marks will not be allowed to be part of the system. The Contractor shall bear all costs required to provide replacement equipment with approved UL marks.

3.4 SYSTEM PROGRAMMING

Provide all programming required for a complete and operational system. Coordinate programming parameters with Owner and Engineer.

3.5 PROTECTION OF NETWORK DEVICES

Contractor shall protect network devices during unpacking and installation by wearing manufacturer approved electrostatic discharge (ESD) wrist straps tied to chassis ground. The wrist strap shall meet OSHA requirements for prevention of electrical shock, should technician come in contact with high voltage.

3.6 CLEANING AND PATCHING

- A. It shall be the responsibility of the contractor to keep their work area clear of debris and clean area daily at completion of work.
- B. It shall be the responsibility of the contractor to patch and paint any wall or surface that has been disturbed by the execution of this work.
- C. The Contractor shall be responsible for providing any additional cutting, drilling, fitting or patching required that is not indicated as provided by others to complete the Work or to make its parts fit together properly.
- D. The Contractor shall not damage or endanger a portion of the Work or fully or partially completed construction of the Owner or separate contractors by cutting, patching or otherwise altering such construction, or by excavation. The Contractor shall not cut or otherwise alter such construction by the Owner or a separate contractor except with written consent of the Owner and of such separate contractor; such consent shall not be unreasonably withheld. The Contractor shall not unreasonably withhold from the Owner or a separate

Contractor the Contractor's consent to cutting or otherwise altering the Work.

- E. Where coring of existing (previously installed) concrete is specified or required, including coring indicated under unit prices, the location of such coring shall be clearly identified in the field and the location shall be approved by the Project Manager prior to commencement of coring work.

3.7 FIREPROOFING

- A. Where cables penetrate fire rated walls, floors and ceilings, fireproof the opening.
- B. Provide conduit sleeves (if not already provided by electrical contractor) for cables that penetrate fire rated walls. After the cabling installation is complete, install fireproofing material in and around all conduit sleeves and openings. Install fire proofing material thoroughly and neatly. Seal all floor and ceiling penetrations.
- C. Use only materials and methods that preserve the integrity of the fire stopping system and its rating.

3.8 GROUNDING

- A. Ground cable shields and equipment to eliminate shock hazard and to minimize ground loops, commonmode returns, noise pickup, cross talk, and other impairments.
- B. Signal Ground Terminal: Locate at main equipment cabinet. Isolate from power system and equipment grounding.
- C. Install grounding electrodes as specified in Division 26, Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS.
- D. Do not use "3rd or 4th" wire internal electrical system conductors for ground.
- E. Do not connect system ground to the building's external lightning protection system.
- F. Do not "mix grounds" of different systems

PART 4 -TESTING/GUARANTY/TRAINING

4.1 PROOF OF PERFORMANCE TESTING

- A. Intermediate Testing:
 - 1. After completion of 25 - 30 percent of the installation of a head end cabinet(s) and equipment, one IC master station, local and remote intercom stations, and prior to any further work, this portion of the system must be pretested, inspected, and certified. Each item of installed equipment shall be checked to ensure

appropriate UL certification labels are affixed, NFPA, Life Safety, and JCAHCO guidelines are followed, and proper installation practices are followed. The intermediate test shall include a full operational test.

2. The inspection and test will be conducted by a factory-certified representative and witnessed by a Government Representative. The results of the inspection will be officially recorded by the Government Representative and maintained on file by the COTR, until completion of the entire project. The results will be compared to the Acceptance Test results. An identical inspection may be conducted between the 65 - 75 percent of the system construction phase, at the direction of the COTR.

B. Pretesting:

1. Upon completing installation of the system, the Contractor shall align, balance, and completely pretest the entire system under full operating conditions.
2. Pretesting Procedure:
 - a. During the system pretest the Contractor shall verify (utilizing approved test equipment) that the system is fully operational and meets all the system performance requirements of this standard.
 - b. The Contractor shall pretest and verify that all system functions and specification requirements are met and operational, no unwanted aural effects, such as signal distortion, noise pulses, glitches, audio hum, poling noise, etc. are present. At a minimum, each of the following locations shall be fully pretested:
 - 1) Central Control Cabinets.
 - 2) All Networked locations.
 - 3) System trouble reporting.
 - 4) System electrical supervision.
 - 5) UPS operation.
3. The Contractor shall provide four (4) copies of the recorded system pretest measurements and the written certification that the system is ready for the formal acceptance test shall be submitted to the COTR.

C. Acceptance Test:

1. After the system has been pretested and the Contractor has submitted the pretest results and certification to the COTR, then the

Contractor shall schedule an acceptance test date and give the COTR 30 calendar days written notice prior to the date the acceptance test is expected to begin. The system shall be tested in the presence of a Government Representative and an OEM certified representative. The system shall be tested utilizing the approved test equipment to certify proof of performance. The test shall verify that the total system meets all the requirements of this specification. The notification of the acceptance test shall include the expected length (in time) of the test.

2. The acceptance test shall be performed on a "go-no-go" basis. Only those operator adjustments required to show proof of performance shall be allowed. The test shall demonstrate and verify that the installed system does comply with all requirements of this specification under operating conditions. The system shall be rated as either acceptable or unacceptable at the conclusion of the test. Failure of any part of the system that precludes completion of system testing, and which cannot be repaired in four (4) hours, shall be cause for terminating the acceptance test of the system. Repeated failures that result in a cumulative time of eight (8) hours to affect repairs shall cause the entire system to be declared unacceptable. Retesting of the entire system shall be rescheduled at the convenience of the Government.

D. Acceptance Test Procedure:

1. Physical and Mechanical Inspection:

- a. The Government Representative will tour all major areas where the system is and all sub-systems are completely and properly installed to insure they are operationally ready for proof of performance testing. A system inventory including available spare parts will be taken at this time. Each item of installed equipment shall be checked to ensure appropriate UL certification labels are affixed.
- b. The system diagrams, record drawings, equipment manuals, Auto CAD Disks, intermediate, and pretest results shall be formally inventoried and reviewed.
- c. Failure of the system to meet the installation requirements of this specification shall be grounds for terminating all testing.

2. Operational Test:

- a. After the Physical and Mechanical Inspection, the central terminating and nurse call master control equipment shall be checked to verify that it meets all performance requirements outlined herein. A spectrum analyzer and sound level meter may be utilized to accomplish this requirement.
 - b. Individual Item Test: The Government Representative will select individual items of equipment for detailed proof of performance testing until 100 percent of the system has been tested and found to meet the contents of this specification. Each item shall meet or exceed the minimum requirements of this document.
3. Test Conclusion:
- a. At the conclusion of the Acceptance Test, using the generated punch list (or discrepancy list) the VA and the Contractor shall jointly agree to the results of the test, and reschedule testing on deficiencies and shortages with the COTR. Any retesting to comply with these specifications will be done at the Contractor's expense.
 - b. If the system is declared unacceptable without conditions, all rescheduled testing expenses will be born by the Contractor.
- E. Acceptable Test Equipment:
- 1. The test equipment shall furnished by the Contractor shall have a calibration tag of an acceptable calibration service dated not more than 12 months prior to the test. As part of the submittal, a test equipment list shall be furnished that includes the make and model number of the following type of equipment as a minimum:
 - 2. Spectrum Analyzer.
 - 3. Signal Level Meter.
 - 4. Volt-Ohm Meter.
 - 5. Sound Pressure Level (SPL) Meter.
 - 6. Oscilloscope.

4.2 SYSTEM GUARANTEE PERIOD OF SERVICE

- A. Contractor's Responsibility:
- 1. The Contractor shall guarantee that all provided material and equipment will be free from defects, workmanship and will remain so for a period of one year from date of final acceptance of the system by the VA. The Contractor shall provide OEM's equipment warranty documents, to the COTR, that certifies each item of equipment installed conforms to OEM published specifications.

2. The Contractor's maintenance personnel shall have the ability to contact the Contractor and OEM for emergency maintenance and logistic assistance, remote diagnostic testing, and assistance in resolving technical problems at any time. This contact capability shall be provided by the Contractor and OEM at no additional cost to the VA.
3. All Contractor maintenance and supervisor personnel shall be fully qualified by the OEM and must provide two (2) copies of current and qualified OEM training certificates and OEM certification upon request.
4. Additionally, the Contractor shall accomplish the following minimum requirements during the two year guaranty period:
 - a. Response Time During the Two Year Guaranty Period:
 - 1) The COTR is the Contractor's ONLY OFFICIAL reporting and contact official for Security Emergency Call and Duress Alarm system trouble calls, during the guaranty period.
 - 2) A standard work week is considered 8:00 A.M. EST to 5:00 P.M. EST or as designated by the COTR, Monday through Friday exclusive of Federal Holidays.
 - 3) The Contractor shall respond and correct on-site trouble calls, during the standard work week to:
 - a) A routine trouble call within one (1) working day of its report. A routine trouble is considered a trouble which causes a single intercom station inoperable.
 - b) An emergency trouble call within four hours of its report. An emergency trouble is considered a trouble which causes a sub-system (ward), distribution point, terminal cabinet, to be inoperable at anytime.
 - b. Required On-Site Visits During the Two Year Guaranty Period
 - 1) The Contractor shall visit, on-site, for a minimum of eight (8) hours, once every 12 weeks, during the guaranty period, to perform system preventive maintenance, equipment cleaning, and operational adjustments to maintain the system according the descriptions identified in this document.
 - 2) The Contractor shall arrange all Facility visits with the COTR prior to performing the required maintenance visits.
 - 3) Preventive maintenance shall be performed by the Contractor in accordance with the OEM's recommended practice and service

intervals during non-busy time agreed to by the COTR and Contractor.

- 4) The preventive maintenance schedule, functions and reports shall be provided to and approved by the COTR.
 - 5) The Contractor shall provide the COTR a type written report itemizing each deficiency found and the corrective action performed during each required visit or official reported trouble call. The Contractor shall provide the COTR with sample copies of these reports for review and approval at the beginning of the Acceptance Test. The following reports are the minimum required:
 - a) The Contractor shall provide a monthly summary all equipment and sub-systems serviced during this guarantee period to COTR by the fifth (5th) working day after the end of each month. The report shall clearly and concisely describe the services rendered, parts replaced and repairs performed. The report shall prescribe anticipated future needs of the equipment and systems for preventive and predictive maintenance.
 - b) The Contractor shall maintain a separate log entry for each item of equipment and each sub-system of the system. The log shall list dates and times of all scheduled, routine, and emergency calls. Each emergency call shall be described with details of the nature and causes of emergency steps taken to rectify the situation and specific recommendations to avoid such conditions in the future.
 - 6) The COTR shall convey to the Facility Engineering Officer, two (2) copies of actual reports for evaluation.
 - a) The COTR shall ensure a copy of these reports is entered into the system's official acquisition documents.
 - b) The Facility Chief Engineer shall ensure a copy of these reports is entered into the system's official technical record documents.
- B. Work Not Included: Maintenance and repair service shall not include the performance of any work due to improper use; accidents; other vendor, contractor, or owner tampering or negligence, for which the Contractor is not directly responsible and does not control. The Contractor shall

immediately notify the COTR in writing upon the discovery of these incidents. The COTR will investigate all reported incidents and render

4.3 TRAINING

- A. Provide thorough training of all nursing staff assigned to those nursing units receiving new networked nurse/patient communications equipment. This training shall be developed and implemented to address two different types of staff. Floor nurses/staff shall receive training from their perspective, and likewise, unit secretaries (or any person whose specific responsibilities include answering patient calls and dispatching staff) shall receive operational training from their perspective. A separate training room will be set up that allows this type of individualized training utilizing in-service training unit, prior to cut over of the new system.
- B. Provide the following minimum training times and durations:
 - 1. //32// hours during the opening week for security staff - both day and night shifts.
 - 2. //24// hours for supervisors and system administrators.

---END---

SECTION 28 05 11
REQUIREMENTS FOR ELECTRONIC SAFETY AND SECURITY INSTALLATIONS

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This Section, Requirements for Electronic Safety and Security Installations, applies to all sections of Division 28.
- B. Furnish and install electronic safety and security cabling, systems, equipment and accessories in accordance with the specifications and drawings. Capacities and ratings of, cable and other items and arrangements for the specified items are shown on drawings.

1.2 MINIMUM REQUIREMENTS

- A. References to industry and trade association standards and codes are minimum installation requirement standards.
- B. Drawings and other specification sections shall govern in those instances where requirements are greater than those specified in the above standards.

1.3 QUALIFICATIONS (PRODUCTS AND SERVICES)

- A. Manufacturers Qualifications: The manufacturer shall regularly and presently produce, as one of the manufacturer's principal products, the equipment and material specified for this project, and shall have manufactured the item for at least three years.
- B. Product Qualification:
 - 1. Manufacturer's product shall have been in satisfactory operation, on three installations of similar size and type as this project, for approximately three years.
 - 2. The Government reserves the right to require the Contractor to submit a list of installations where the products have been in operation before approval.
- C. Service Qualifications: There shall be a permanent service organization maintained or trained by the manufacturer which will render satisfactory service to this installation within eight hours of receipt of notification that service is needed. Submit name and address of service organizations.

1.4 MANUFACTURED PRODUCTS

- A. Materials and equipment furnished shall be of current production by manufacturers regularly engaged in the manufacture of such items, for which replacement parts shall be available.
- B. When more than one unit of the same class of equipment is required, such units shall be the product of a single manufacturer.
- C. Equipment Assemblies and Components:
 - 1. Components of an assembled unit need not be products of the same manufacturer.
 - 2. Manufacturers of equipment assemblies, which include components made by others, shall assume complete responsibility for the final assembled unit.
 - 3. Components shall be compatible with each other and with the total assembly for the intended service.
 - 4. Constituent parts which are similar shall be the product of a single manufacturer.
- D. Factory wiring shall be identified on the equipment being furnished and on all wiring diagrams.
- E. When Factory Testing Is Specified:
 - 1. The Government shall have the option of witnessing factory tests.
The contractor shall notify the VA through the Contracting Officer's Technical Representative (COTR) a minimum of 15 working days prior to the manufacturers making the factory tests.
 - 2. Four copies of certified test reports containing all test data shall be furnished to the COTR prior to final inspection and not more than 90 calendar days after completion of the tests.
 - 3. When equipment fails to meet factory test and re-inspection is required, the contractor shall be liable for all additional expenses, including expenses of the Government.

1.5 EQUIPMENT REQUIREMENTS

Where variations from the contract requirements are requested in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES, the connecting work and related components shall include, but not be limited to additions or changes to branch circuits, circuit protective devices, conduits, wire, feeders, controls, panels and installation methods.

1.6 EQUIPMENT PROTECTION

- A. Equipment and materials shall be protected during shipment and storage against physical damage, dirt, moisture, cold and rain:
 - 1. During installation, enclosures, equipment, controls, controllers, circuit protective devices, and other like items, shall be protected against entry of foreign matter; and be vacuum cleaned both inside and outside before testing and operating and repainting if required.
 - 2. Damaged equipment shall be, as determined by the COTR, placed in first class operating condition or be returned to the source of supply for repair or replacement.
 - 3. Painted surfaces shall be protected with factory installed removable heavy kraft paper, sheet vinyl or equal.
 - 4. Damaged paint on equipment and materials shall be refinished with the same quality of paint and workmanship as used by the manufacturer so repaired areas are not obvious.

1.7 WORK PERFORMANCE

- A. Job site safety and worker safety is the responsibility of the contractor.
- B. For work on existing stations, arrange, phase and perform work to assure electronic safety and security service for other buildings at all times. Refer to Article OPERATIONS AND STORAGE AREAS under Section 01 00 00, GENERAL REQUIREMENTS.
- C. New work shall be installed and connected to existing work neatly and carefully. Disturbed or damaged work shall be replaced or repaired to its prior conditions, as required by Section 01 00 00, GENERAL REQUIREMENTS.
- D. Coordinate location of equipment and conduit with other trades to minimize interferences.

1.8 EQUIPMENT INSTALLATION AND REQUIREMENTS

- A. Equipment location shall be as close as practical to locations shown on the drawings.
- B. Inaccessible Equipment:
 - 1. Where the Government determines that the Contractor has installed equipment not conveniently accessible for operation and maintenance, the equipment shall be removed and reinstalled as directed at no additional cost to the Government.
 - 2. "Conveniently accessible" is defined as being capable of being reached without the use of ladders, or without climbing or crawling

under or over obstacles such as, but not limited to, motors, pumps, belt guards, transformers, piping, ductwork, conduit and raceways.

1.9 EQUIPMENT IDENTIFICATION

- A. Install an identification sign which clearly indicates information required for use and maintenance of equipment.
- B. Nameplates shall be laminated black phenolic resin with a white core with engraved lettering, a minimum of 6 mm (1/4 inch) high. Secure nameplates with screws. Nameplates that are furnished by manufacturer as a standard catalog item, or where other method of identification is herein specified, are exceptions.

1.10 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. The Government's approval shall be obtained for all equipment and material before delivery to the job site. Delivery, storage or installation of equipment or material which has not had prior approval will not be permitted at the job site.
- C. All submittals shall include adequate descriptive literature, catalog cuts, shop drawings and other data necessary for the Government to ascertain that the proposed equipment and materials comply with specification requirements. Catalog cuts submitted for approval shall be legible and clearly identify equipment being submitted.
- D. Submittals for individual systems and equipment assemblies which consist of more than one item or component shall be made for the system or assembly as a whole. Partial submittals will not be considered for approval.
 - 1. Mark the submittals, "SUBMITTED UNDER SECTION_____".
 - 2. Submittals shall be marked to show specification reference including the section and paragraph numbers.
 - 3. Submit each section separately.
- E. The submittals shall include the following:
 - 1. Information that confirms compliance with contract requirements. Include the manufacturer's name, model or catalog numbers, catalog information, technical data sheets, shop drawings, pictures, nameplate data and test reports as required.
 - 2. Elementary and interconnection wiring diagrams for communication and signal systems, control system and equipment assemblies. All terminal points and wiring shall be identified on wiring diagrams.

3. Parts list which shall include those replacement parts recommended by the equipment manufacturer, quantity of parts, current price and availability of each part.
- F. Manuals: Submit in accordance with Section 01 00 00, GENERAL REQUIREMENTS.
1. Maintenance and Operation Manuals: Submit as required for systems and equipment specified in the technical sections. Furnish four copies, bound in hardback binders, (manufacturer's standard binders) or an approved equivalent. Furnish one complete manual as specified in the technical section but in no case later than prior to performance of systems or equipment test, and furnish the remaining manuals prior to contract completion.
 2. Inscribe the following identification on the cover: the words "MAINTENANCE AND OPERATION MANUAL," the name and location of the system, equipment, building, name of Contractor, and contract number. Include in the manual the names, addresses, and telephone numbers of each subcontractor installing the system or equipment and the local representatives for the system or equipment.
 3. Provide a "Table of Contents" and assemble the manual to conform to the table of contents, with tab sheets placed before instructions covering the subject. The instructions shall be legible and easily read, with large sheets of drawings folded in.
 4. The manuals shall include:
 - a. Internal and interconnecting wiring and control diagrams with data to explain detailed operation and control of the equipment.
 - b. A control sequence describing start-up, operation, and shutdown.
 - c. Description of the function of each principal item of equipment.
 - d. Installation and maintenance instructions.
 - e. Safety precautions.
 - f. Diagrams and illustrations.
 - g. Testing methods.
 - h. Performance data.
 - i. Pictorial "exploded" parts list with part numbers. Emphasis shall be placed on the use of special tools and instruments. The list shall indicate sources of supply, recommended spare parts, and name of servicing organization.

- j. Appendix; list qualified permanent servicing organizations for support of the equipment, including addresses and certified qualifications.
- G. Approvals will be based on complete submission of manuals together with shop drawings.
- H. After approval and prior to installation, furnish the COTR with one sample of each of the following:
 - 1. A 300 mm (12 inch) length of each type and size of wire and cable along with the tag from the coils of reels from which the samples were taken.
 - 2. Each type of conduit and pathway coupling, bushing and termination fitting.
 - 3. Conduit hangers, clamps and supports.
 - 4. Duct sealing compound.
- I. In addition to the requirement of SUBMITTALS, the VA reserves the right to request the manufacturer to arrange for a VA representative to see typical active systems in operation, when there has been no prior experience with the manufacturer or the type of equipment being submitted.

1.11 SINGULAR NUMBER

Where any device or part of equipment is referred to in these specifications in the singular number (e.g., "the switch"), this reference shall be deemed to apply to as many such devices as are required to complete the installation as shown on the drawings.

1.12 TRAINING

- A. Training shall be provided in accordance with Article, INSTRUCTIONS, of Section 01 00 00, GENERAL REQUIREMENTS.
- B. Training shall be provided for the particular equipment or system as required in each associated specification.
- C. A training schedule shall be developed and submitted by the contractor and approved by the COTR at least 30 days prior to the planned training.

- - - E N D - - -

SECTION 28 05 13
CONDUCTORS AND CABLES FOR ELECTRONIC SAFETY AND SECURITY

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This section specifies the furnishing, installation, and connection of the conductors and cables for electronic safety and security.

1.2 RELATED WORK

- A. Excavation and backfill for cables that are installed in conduit: Section 31 20 00, EARTH MOVING.
- B. Sealing around penetrations to maintain the integrity of time rated construction: Section 07 84 00, FIRESTOPPING.
- C. General electrical requirements that are common to more than one section in Division 28: Section 28 05 11, REQUIREMENTS FOR ELECTRONIC SAFETY AND SECURITY INSTALLATIONS.
- D. Conduits for cables and wiring: Section 28 05 33, RACEWAYS AND BOXES FOR ELECTRONIC SAFETY AND SECURITY.
- E. Requirements for personnel safety and to provide a low impedance path for possible ground fault currents: Section 28 05 26, GROUNDING AND BONDING FOR ELECTRONIC SAFETY AND SECURITY.

1.3 SUBMITTALS

- A. In accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES, furnish the following:
1. Manufacturer's Literature and Data: Showing each cable type and rating.
 2. Certificates: Two weeks prior to final inspection, deliver to the COTR four copies of the certification that the material is in accordance with the drawings and specifications and has been properly installed.

1.4 APPLICABLE PUBLICATIONS

- A. Publications listed below (including amendments, addenda, revisions, supplements and errata) form a part of this specification to the extent referenced. Publications are reference in the text by the basic designation only.
- B. American Society of Testing Material (ASTM):
- D2301-04.....Standard Specification for Vinyl Chloride
Plastic Pressure Sensitive Electrical
Insulating Tape

- C. Federal Specifications (Fed. Spec.):
 - A-A-59544-00.....Cable and Wire, Electrical (Power, Fixed Installation)
- D. National Fire Protection Association (NFPA):
 - 70-05.....National Electrical Code (NEC)
- E. Underwriters Laboratories, Inc. (UL):
 - 44-02.....Thermoset-Insulated Wires and Cables
 - 83-03.....Thermoplastic-Insulated Wires and Cables
 - 467-01.....Electrical Grounding and Bonding Equipment
 - 486A-01.....Wire Connectors and Soldering Lugs for Use with Copper Conductors
 - 486C-02.....Splicing Wire Connectors
 - 486D-02.....Insulated Wire Connector Systems for Underground Use or in Damp or Wet Locations
 - 486E-00.....Equipment Wiring Terminals for Use with Aluminum and/or Copper Conductors
 - 493-01.....Thermoplastic-Insulated Underground Feeder and Branch Circuit Cable
 - 514B-02.....Fittings for Cable and Conduit
 - 1479-03.....Fire Tests of Through-Penetration Fire Stops

PART 2 - PRODUCTS

2.1 CONTROL WIRING

- A. Unless otherwise specified in other sections of these specifications, control wiring shall be as specified for power and lighting wiring, except the minimum size shall be not less than No. 14 AWG.
- B. Control wiring shall be large enough so that the voltage drop under inrush conditions does not adversely affect operation of the controls.

2.2 COMMUNICATION AND SIGNAL WIRING

- A. Shall conform to the recommendations of the manufacturers of the communication and signal systems; however, not less than what is shown.
- B. Wiring shown is for typical systems. Provide wiring as required for the systems being furnished.
- C. Multi-conductor cables shall have the conductors color coded.

2.3 WIRE LUBRICATING COMPOUND

- A. Suitable for the wire insulation and conduit it is used with, and shall not harden or become adhesive.
- B. Shall not be used on wire for isolated type electrical power systems.

2.4 FIREPROOFING TAPE

- A. The tape shall consist of a flexible, conformable fabric of organic composition coated one side with flame-retardant elastomer.
- B. The tape shall be self-extinguishing and shall not support combustion. It shall be arc-proof and fireproof.
- C. The tape shall not deteriorate when subjected to water, gases, salt water, sewage, or fungus and be resistant to sunlight and ultraviolet light.
- D. The finished application shall withstand a 200-ampere arc for not less than 30 seconds.
- E. Securing tape: Glass cloth electrical tape not less than 0.18 mm (7 mils) thick, and 19 mm (3/4 inch) wide.

PART 3 - EXECUTION

3.1 INSTALLATION, GENERAL

- A. Splice cables and wires only in outlet boxes, junction boxes, or pull boxes.
- B. Seal cable and wire entering a building from underground, between the wire and conduit where the cable exits the conduit, with a non-hardening approved compound.
- C. Wire Pulling:
 - 1. Provide installation equipment that will prevent the cutting or abrasion of insulation during pulling of cables.
 - 2. Use ropes made of nonmetallic material for pulling feeders.
 - 3. Attach pulling lines for feeders by means of either woven basket grips or pulling eyes attached directly to the conductors, as approved by the Resident Engineer.
 - 4. Pull in multiple cables together in a single conduit.

3.2 INSTALLATION IN MANHOLES

- A. Install and support cables in manholes on the steel racks with porcelain or equal insulators. Train the cables around the manhole walls, but do not bend to a radius less than six times the overall cable diameter.

3.3 SPLICE INSTALLATION

- A. Splices and terminations shall be mechanically and electrically secure.
- B. Where the Government determines that unsatisfactory splices or terminations have been installed, remove the devices and install approved devices at no additional cost to the Government.

3.4 CONTROL, COMMUNICATION AND SIGNAL WIRING INSTALLATION

- A. Unless otherwise specified in other sections, install wiring and connect to equipment/devices to perform the required functions as shown and specified.
- B. Except where otherwise required, install a separate power supply circuit for each system so that malfunctions in any system will not affect other systems.
- C. Where separate power supply circuits are not shown, connect the systems to the nearest panelboards of suitable voltages, which are intended to supply such systems and have suitable spare circuit breakers or space for installation.
- D. Install a red warning indicator on the handle of the branch circuit breaker for the power supply circuit for each system to prevent accidental de-energizing of the systems.
- E. System voltages shall be 120 volts or lower where shown on the drawings or as required by the NEC.

3.5 CONTROL, COMMUNICATION AND SIGNAL SYSTEM IDENTIFICATION

- A. Install a permanent wire marker on each wire at each termination.
- B. Identifying numbers and letters on the wire markers shall correspond to those on the wiring diagrams used for installing the systems.
- C. Wire markers shall retain their markings after cleaning.
- D. In each manhole and handhole, install embossed brass tags to identify the system served and function.

3.5 EXISTING WIRING

Unless specifically indicated on the plans, existing wiring shall not be reused for the new installation. Only wiring that conforms to the specifications and applicable codes may be reused. If existing wiring does not meet these requirements, existing wiring may not be reused and new wires shall be installed.

- - - E N D - - -

SECTION 28 05 26
GROUNDING AND BONDING FOR ELECTRONIC SAFETY AND SECURITY

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This section specifies general grounding and bonding requirements of electronic safety and security installations for equipment operations.
- B. "Grounding electrode system" refers to all electrodes required by NEC, as well as including made, supplementary, grounding electrodes.
- F. The terms "connect" and "bond" are used interchangeably in this specification and have the same meaning.

1.2 RELATED WORK

- A. Section 28 05 11, REQUIREMENTS FOR ELECTRONIC SAFETY AND SECURITY INSTALLATIONS: General electrical requirements and items that are common to more than one section of Division 28.
- B. Section 28 05 13, CONDUCTORS AND CABLES FOR ELECTRONIC SAFETY AND SECURITY: Low Voltage power and lighting wiring.
- C. Section 26 41 00, FACILITY LIGHTNING PROTECTION: Requirements for a lightning protection system.

1.3 SUBMITTALS

- A. Submit in accordance with Section 28 05 11, REQUIREMENTS FOR ELECTRONIC SAFETY AND SECURITY INSTALLATIONS.
- B. Shop Drawings:
 - 1. Sufficient information, clearly presented, shall be included to determine compliance with drawings and specifications.
 - 2. Include the location of system grounding electrode connections and the routing of aboveground and underground grounding electrode conductors.
- C. Test Reports: Provide certified test reports of ground resistance.
- D. Certifications: Two weeks prior to final inspection, submit four copies of the following to the Contracting Officer's Technical Representative (COTR):
 - 1. Certification that the materials and installation is in accordance with the drawings and specifications.
 - 2. Certification, by the Contractor, that the complete installation has been properly installed and tested.

1.4 APPLICABLE PUBLICATIONS

Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by the basic designation only.

A. American Society for Testing and Materials (ASTM):

B1-2001.....Standard Specification for Hard-Drawn Copper
Wire

B8-2004.....Standard Specification for Concentric-Lay-
Stranded Copper Conductors, Hard, Medium-Hard,
or Soft

B. Institute of Electrical and Electronics Engineers, Inc. (IEEE):

81-1983.....IEEE Guide for Measuring Earth Resistivity,
Ground Impedance, and Earth Surface Potentials
of a Ground System

C. National Fire Protection Association (NFPA):

70-2005.....National Electrical Code (NEC)

D. Underwriters Laboratories, Inc. (UL):

44-2005Thermoset-Insulated Wires and Cables

83-2003Thermoplastic-Insulated Wires and Cables

467-2004Grounding and Bonding Equipment

486A-486B-2003Wire Connectors

PART 2 - PRODUCTS

2.1 GROUNDING AND BONDING CONDUCTORS

A. Equipment grounding conductors shall be UL 83 insulated stranded copper, except that sizes 6 mm² (10 AWG) and smaller shall be solid copper. Insulation color shall be continuous green for all equipment grounding conductors, except that wire sizes 25 mm² (4 AWG) and larger shall be permitted to be identified per NEC.

B. Bonding conductors shall be ASTM B8 bare stranded copper, except that sizes 6 mm² (10 AWG) and smaller shall be ASTM B1 solid bare copper wire.

C. Isolated Power System: Type XHHW-2 insulation with a dielectric constant of 3.5 or less.

2.2 GROUND RODS

A. Copper clad steel, 19 mm (3/4-inch) diameter by 3000 mm (10 feet) long, conforming to UL 467.

- B. Quantity of rods shall be as required to obtain the specified ground resistance.

2.3 SPLICES AND TERMINATION COMPONENTS

Components shall meet or exceed UL 467 and be clearly marked with the manufacturer, catalog number, and permitted conductor size(s).

2.4 GROUND CONNECTIONS

- A. Below Grade: Exothermic-welded type connectors.
- B. Above Grade:
 - 1. Bonding Jumpers: compression type connectors, using zinc-plated fasteners and external tooth lockwashers.
 - 2. Ground Busbars: Two-hole compression type lugs using tin-plated copper or copper alloy bolts and nuts.
 - 3. Rack and Cabinet Ground Bars: one-hole compression-type lugs using zinc-plated or copper alloy fasteners.

2.5 EQUIPMENT RACK AND CABINET GROUND BARS

Provide solid copper ground bars designed for mounting on the framework of open or cabinet-enclosed equipment racks with minimum dimensions of 4 mm thick by 19 mm wide (3/8 inch x ¾ inch).

2.6 GROUND TERMINAL BLOCKS

At any equipment mounting location (e.g. backboards and hinged cover enclosures) where rack-type ground bars cannot be mounted, provide screw lug-type terminal blocks.

2.7 SPLICE CASE GROUND ACCESSORIES

Splice case grounding and bonding accessories shall be supplied by the splice case manufacturer when available. Otherwise, use 16 mm² (6 AWG) insulated ground wire with shield bonding connectors.

2.8 COMPUTER ROOM GROUND

Provide 50mm² (1/0 AWG) bare copper grounding conductors bolted at mesh intersections to form an equipotential grounding grid. The equipotential grounding grid shall form a 600mm (24 inch) mesh pattern. The grid shall be bonded to each of the access floor pedestals.

PART 3 - EXECUTION

3.1 GENERAL

- A. Ground in accordance with the NEC, as shown on drawings, and as hereinafter specified.
- B. System Grounding:
 - 1. Secondary service neutrals: Ground at the supply side of the secondary disconnecting means and at the related transformers.

2. Separately derived systems (transformers downstream from the service entrance): Ground the secondary neutral.
 3. Isolation transformers and isolated power systems shall not be system grounded.
- C. Equipment Grounding: Metallic structures (including ductwork and building steel), enclosures, raceways, junction boxes, outlet boxes, cabinets, machine frames, and other conductive items in close proximity with electrical circuits shall be bonded and grounded.

3.2 INACCESSIBLE GROUNDING CONNECTIONS

Make grounding connections, which are buried or otherwise normally inaccessible (except connections for which periodic testing access is required) by exothermic weld.

3.3 CORROSION INHIBITORS

When making ground and ground bonding connections, apply a corrosion inhibitor to all contact surfaces. Use corrosion inhibitor appropriate for protecting a connection between the metals used.

3.4 CONDUCTIVE PIPING

- A. Bond all conductive piping systems, interior and exterior, to the building to the grounding electrode system. Bonding connections shall be made as close as practical to the equipment ground bus.
- B. In operating rooms and at intensive care and coronary care type beds, bond the gases and suction piping, at the outlets, directly to the room or patient ground bus.

3.5 COMPUTER ROOM GROUNDING

- A. Conduit: Ground and bond metallic conduit systems as follows:
 1. Ground metallic service conduit and any pipes entering or being routed within the computer room at each end using 16 mm² (6AWG) bonding jumpers.
 2. Bond at all intermediate metallic enclosures and across all joints using 16 mm² (6 AWG) bonding jumpers.
 4. Bond every metallic conduit that penetrates the plan of the raised floor to the raised floor stringer system as follows:
 - a. Unpainted Supports Attached to Raised Floor System: When conduit/strut clamps are used to attach conduit to Unistrut, no additional bonding is required.
 - b. Unpainted Supports Not Attached to Raised Floor System: When conduit/strut clamps are used to attach conduit to Unistrut, use

16 mm² (6 AWG) bonding jumpers to connect Unistrut to the raised floor system.

- c. Painted Supports: Use 16 mm² (6 AWG) bonding jumpers to connect conduit to the stringer system. Mount a push-type conduit fastener onto every metallic conduit. Place fasteners no higher or lower than 75 mm (3 inches) from the raised floor stringer.

B. Equipotential Grounding Grid:

1. Install a bolted stringer system to serve as the computer room equipotential grounding grid.
2. If a bolted stringer system is not provided, install equipotential grounding grid in a 600 mm square grid consisting of 50 mm² (1/0 AWG) bare copper conductor welded at the intersection of each grid.
3. Attach the equipotential ground grid to the room signal ground bus using a 50 mm² (1/0 AWG) bare copper grounding conductor.

3.6 WIREWAY GROUNDING

A. Ground and Bond Metallic Wireway Systems as follows:

2. Bond the metallic structures of wireway to provide 100 percent electrical continuity throughout the wireway system by connecting a 16 mm² (6 AWG) bonding jumper at all intermediate metallic enclosures and across all section junctions.
3. Install insulated 16 mm² (6 AWG) bonding jumpers between the wireway system bonded as required in paragraph 1 above, and the closest building ground at each end and approximately every 16 meters (50 feet).
4. Use insulated 16 mm² (6 AWG) bonding jumpers to ground or bond metallic wireway at each end at all intermediate metallic enclosures and cross all section junctions.
5. Use insulated 16 mm² (6 AWG) bonding jumpers to ground cable tray to column-mounted building ground plates (pads) at each end and approximately every 15 meters.

3.7 GROUND RESISTANCE

- A. Grounding system resistance to ground shall not exceed 5 ohms. Make necessary modifications or additions to the grounding electrode system for compliance without additional cost to the Government. Final tests shall assure that this requirement is met.
- B. Resistance of the grounding electrode system shall be measured using a four-terminal fall-of-potential method as defined in IEEE 81. Ground resistance measurements shall be made before the electrical

distribution system is energized and shall be made in normally dry conditions not less than 48 hours after the last rainfall. Resistance measurements of separate grounding electrode systems shall be made before the systems are bonded together below grade. The combined resistance of separate systems may be used to meet the required resistance, but the specified number of electrodes must still be provided.

- C. Services at power company interface points shall comply with the power company ground resistance requirements.
- D. Below-grade connections shall be visually inspected by the COTR prior to backfilling. The Contractor shall notify the COTR 24 hours before the connections are ready for inspection.

3.8 GROUND ROD INSTALLATION

- A. Drive each rod vertically in the earth, not less than 3000 mm (10 feet) in depth.
- B. Where permanently concealed ground connections are required, make the connections by the exothermic process to form solid metal joints. Make accessible ground connections with mechanical pressure type ground connectors.
- C. Where rock prevents the driving of vertical ground rods, install angled ground rods or grounding electrodes in horizontal trenches to achieve the specified resistance.

- - - E N D - - -

SECTION 28 05 33
RACEWAYS AND BOXES FOR ELECTRONIC SAFETY AND SECURITY

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This section specifies the furnishing, installation, and connection of conduit, fittings, and boxes to form complete, coordinated, raceway systems. Raceways are required for all electronic safety and security cabling unless shown or specified otherwise.
- B. Definitions: The term conduit, as used in this specification, shall mean any or all of the raceway types specified.

1.2 RELATED WORK

- A. Bedding of conduits: Section 31 20 00, EARTH MOVING.
- B. Mounting board for communication closets: Section 06 10 00, ROUGH CARPENTRY.
- C. Sealing around penetrations to maintain the integrity of fire rated construction: Section 07 84 00, FIRESTOPPING.
- D. Fabrications for the deflection of water away from the building envelope at penetrations: Section 07 60 00, FLASHING AND SHEET METAL.
- E. Sealing around conduit penetrations through the building envelope to prevent moisture migration into the building: Section 07 92 00, JOINT SEALANTS.
- F. Identification and painting of conduit and other devices: Section 09 91 00, PAINTING.
- G. General electrical requirements and items that is common to more than one section of Division 28: Section 28 05 11, REQUIREMENTS FOR ELECTRONIC SAFETY AND SECURITY INSTALLATIONS.
- H. Requirements for personnel safety and to provide a low impedance path for possible ground fault currents: Section 28 05 26, GROUNDING AND BONDING FOR ELECTRONIC SAFETY AND SECURITY.

1.3 SUBMITTALS

In accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES, furnish the following:

- A. Shop Drawings:
 - 1. Size and location of main feeders;
 - 2. Size and location of panels and pull boxes
 - 3. Layout of required conduit penetrations through structural elements.

4. The specific item proposed and its area of application shall be identified on the catalog cuts.
- B. Certification: Prior to final inspection, deliver to the Contracting Officer's Technical Representative (COTR) four copies of the certification that the material is in accordance with the drawings and specifications and has been properly installed.

1.4 APPLICABLE PUBLICATIONS

- A. Publications listed below (including amendments, addenda, revisions, supplements and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by the basic designation only.
- B. National Fire Protection Association (NFPA):
- 70-05.....National Electrical Code (NEC)
- C. Underwriters Laboratories, Inc. (UL):
- 1-03.....Flexible Metal Conduit
- 5-01.....Surface Metal Raceway and Fittings
- 6-03.....Rigid Metal Conduit
- 50-03.....Enclosures for Electrical Equipment
- 360-03.....Liquid-Tight Flexible Steel Conduit
- 467-01.....Grounding and Bonding Equipment
- 514A-01.....Metallic Outlet Boxes
- 514B-02.....Fittings for Cable and Conduit
- 514C-05.....Nonmetallic Outlet Boxes, Flush-Device Boxes
and Covers
- 651-02.....Schedule 40 and 80 Rigid PVC Conduit
- 651A-03.....Type EB and A Rigid PVC Conduit and HDPE
Conduit
- 797-03.....Electrical Metallic Tubing
- 1242-00.....Intermediate Metal Conduit
- D. National Electrical Manufacturers Association (NEMA):
- TC-3-04.....PVC Fittings for Use with Rigid PVC Conduit and
Tubing
- FB1-03.....Fittings, Cast Metal Boxes and Conduit Bodies
for Conduit, Electrical Metallic Tubing and
Cable

PART 2 - PRODUCTS**2.1 MATERIAL**

- A. Conduit Size: In accordance with the NEC, but not less than 13 mm (1/2 inch) unless otherwise shown. Where permitted by the NEC, 13 mm (1/2 inch) flexible conduit may be used for tap connections to recessed lighting fixtures.
- B. Conduit:
 - 1. Rigid galvanized steel: Shall Conform to UL 6, ANSI C80.1.
 - 2. Rigid aluminum: Shall Conform to UL 6A, ANSI C80.5.
 - 3. Rigid intermediate steel conduit (IMC): Shall Conform to UL 1242, ANSI C80.6.
 - 4. Electrical metallic tubing (EMT): Shall Conform to UL 797, ANSI C80.3. Maximum size not to exceed 105 mm (4 inch) and shall be permitted only with cable rated 600 volts or less.
 - 5. Flexible galvanized steel conduit: Shall Conform to UL 1.
 - 6. Liquid-tight flexible metal conduit: Shall Conform to UL 360.
 - 7. Direct burial plastic conduit: Shall conform to UL 651 and UL 651A, heavy wall PVC or high density polyethylene (PE).
 - 8. Surface metal raceway: Shall Conform to UL 5.
- C. Conduit Fittings:
 - 1. Rigid steel and IMC conduit fittings:
 - a. Fittings shall meet the requirements of UL 514B and ANSI/ NEMA FB1.
 - b. Standard threaded couplings, locknuts, bushings, and elbows: Only steel or malleable iron materials are acceptable. Integral retractable type IMC couplings are also acceptable.
 - c. Locknuts: Bonding type with sharp edges for digging into the metal wall of an enclosure.
 - d. Bushings: Metallic insulating type, consisting of an insulating insert molded or locked into the metallic body of the fitting. Bushings made entirely of metal or nonmetallic material are not permitted.
 - e. Erickson (union-type) and set screw type couplings: Approved for use in concrete are permitted for use to complete a conduit run where conduit is installed in concrete. Use set screws of case hardened steel with hex head and cup point to firmly seat in conduit wall for positive ground. Tightening of set screws with pliers is prohibited.

- f. Sealing fittings: Threaded cast iron type. Use continuous drain type sealing fittings to prevent passage of water vapor. In concealed work, install fittings in flush steel boxes with blank cover plates having the same finishes as that of other electrical plates in the room.
- 2. Rigid aluminum conduit fittings:
 - a. Standard threaded couplings, locknuts, bushings, and elbows: Malleable iron, steel or aluminum alloy materials; Zinc or cadmium plate iron or steel fittings. Aluminum fittings containing more than 0.4 percent copper are prohibited.
 - b. Locknuts and bushings: As specified for rigid steel and IMC conduit.
 - c. Set screw fittings: Not permitted for use with aluminum conduit.
 - 3. Electrical metallic tubing fittings:
 - a. Fittings shall meet the requirements of UL 514B and ANSI/ NEMA FB1.
 - b. Only steel or malleable iron materials are acceptable.
 - c. Couplings and connectors: Concrete tight and rain tight, with connectors having insulated throats. Use gland and ring compression type couplings and connectors for conduit sizes 50 mm (2 inches) and smaller. Use set screw type couplings with four set screws each for conduit sizes over 50 mm (2 inches). Use set screws of case-hardened steel with hex head and cup point to firmly seat in wall of conduit for positive grounding.
 - d. Indent type connectors or couplings are prohibited.
 - e. Die-cast or pressure-cast zinc-alloy fittings or fittings made of "pot metal" are prohibited.
 - 4. Flexible steel conduit fittings:
 - a. Conform to UL 514B. Only steel or malleable iron materials are acceptable.
 - b. Clamp type, with insulated throat.
 - 5. Liquid-tight flexible metal conduit fittings:
 - a. Fittings shall meet the requirements of UL 514B and ANSI/ NEMA FB1.
 - b. Only steel or malleable iron materials are acceptable.
 - c. Fittings must incorporate a threaded grounding cone, a steel or plastic compression ring, and a gland for tightening. Connectors shall have insulated throats.

6. Direct burial plastic conduit fittings:
 - a. Fittings shall meet the requirements of UL 514C and NEMA TC3.
 - b. As recommended by the conduit manufacturer.
 7. Surface metal raceway fittings: As recommended by the raceway manufacturer.
 8. Expansion and deflection couplings:
 - a. Conform to UL 467 and UL 514B.
 - b. Accommodate, 19 mm (0.75 inch) deflection, expansion, or contraction in any direction, and allow 30 degree angular deflections.
 - c. Include internal flexible metal braid sized to guarantee conduit ground continuity and fault currents in accordance with UL 467, and the NEC code tables for ground conductors.
 - d. Jacket: Flexible, corrosion-resistant, watertight, moisture and heat resistant molded rubber material with stainless steel jacket clamps.
- D. Conduit Supports:
1. Parts and hardware: Zinc-coat or provide equivalent corrosion protection.
 2. Individual Conduit Hangers: Designed for the purpose, having a pre-assembled closure bolt and nut, and provisions for receiving a hanger rod.
 3. Multiple conduit (trapeze) hangers: Not less than 38 mm by 38 mm (1-1/2 by 1-1/2 inch), 12 gage steel, cold formed, lipped channels; with not less than 9 mm (3/8 inch) diameter steel hanger rods.
 4. Solid Masonry and Concrete Anchors: Self-drilling expansion shields, or machine bolt expansion.
- E. Outlet, Junction, and Pull Boxes:
1. UL-50 and UL-514A.
 2. Cast metal where required by the NEC or shown, and equipped with rustproof boxes.
 3. Sheet metal boxes: Galvanized steel, except where otherwise shown.
 4. Flush mounted wall or ceiling boxes shall be installed with raised covers so that front face of raised cover is flush with the wall. Surface mounted wall or ceiling boxes shall be installed with surface style flat or raised covers.
- H. Wireways: Equip with hinged covers, except where removable covers are shown.

- G. Warning Tape: Standard, 4-Mil polyethylene 76 mm (3 inch) wide tape detectable type, red with black letters, and imprinted with "CAUTION BURIED ELECTRONIC SAFETY AND SECURITY CABLE BELOW".

PART 3 - EXECUTION

3.1 PENETRATIONS

- A. Cutting or Holes:
1. Locate holes in advance where they are proposed in the structural sections such as ribs or beams. Obtain the approval of the COTR prior to drilling through structural sections.
 2. Cut holes through concrete and masonry in new and existing structures with a diamond core drill or concrete saw. Pneumatic hammer, impact electric, hand or manual hammer type drills are not allowed, except where permitted by the COTR as required by limited working space.
- B. Fire Stop: Where conduits, wireways, and other electronic safety and security raceways pass through fire partitions, fire walls, smoke partitions, or floors, install a fire stop that provides an effective barrier against the spread of fire, smoke and gases as specified in Section 07 84 00, FIRESTOPPING, with rock wool fiber or silicone foam sealant only. Completely fill and seal clearances between raceways and openings with the fire stop material.
- C. Waterproofing: At floor, exterior wall, and roof conduit penetrations, completely seal clearances around the conduit and make watertight as specified in Section 07 92 00, JOINT SEALANTS.

3.2 INSTALLATION, GENERAL

- A. Install conduit as follows:
1. In complete runs before pulling in cables or wires.
 2. Flattened, dented, or deformed conduit is not permitted. Remove and replace the damaged conduits with new undamaged material.
 3. Assure conduit installation does not encroach into the ceiling height head room, walkways, or doorways.
 4. Cut square with a hacksaw, ream, remove burrs, and draw up tight.
 5. Mechanically continuous.
 6. Independently support conduit at 8 foot on center. Do not use other supports i.e., (suspended ceilings, suspended ceiling supporting members, lighting fixtures, conduits, mechanical piping, or mechanical ducts).

7. Support within 300 mm (1 foot) of changes of direction, and within 300 mm (1 foot) of each enclosure to which connected.
 8. Close ends of empty conduit with plugs or caps at the rough-in stage to prevent entry of debris, until wires are pulled in.
 9. Conduit installations under fume and vent hoods are prohibited.
 10. Secure conduits to cabinets, junction boxes, pull boxes and outlet boxes with bonding type locknuts. For rigid and IMC conduit installations, provide a locknut on the inside of the enclosure, made up wrench tight. Do not make conduit connections to junction box covers.
 11. Flashing of penetrations of the roof membrane is specified in Section 07 60 00, FLASHING AND SHEET METAL.
 12. Do not use aluminum conduits in wet locations.
 13. Unless otherwise indicated on the drawings or specified herein, all conduits shall be installed concealed within finished walls, floors and ceilings.
- B. Conduit Bends:
1. Make bends with standard conduit bending machines.
 2. Conduit hickey may be used for slight offsets, and for straightening stubbed out conduits.
 3. Bending of conduits with a pipe tee or vise is prohibited.
- C. Layout and Homeruns:
1. Install conduit with wiring, including homeruns, as shown.
 2. Deviations: Make only where necessary to avoid interferences and only after drawings showing the proposed deviations have been submitted approved by the COTR.
- D. Fire Alarm:
1. Fire alarm conduit shall be painted red (a red "top-coated" conduit from the conduit manufacturer may be used in lieu of painted conduit) in accordance with the requirements of Section 28 31 00, Fire Detection and Alarm.

3.3 CONCEALED WORK INSTALLATION

- A. In Concrete:
1. Conduit: Rigid steel, IMC or EMT. Do not install EMT in concrete slabs that are in contact with soil, gravel or vapor barriers.
 2. Align and run conduit in direct lines.
 3. Install conduit through concrete beams only when the following occurs:

- a. Where shown on the structural drawings.
 - b. As approved by the COTR prior to construction, and after submittal of drawing showing location, size, and position of each penetration.
- 4. Installation of conduit in concrete that is less than 75 mm (3 inches) thick is prohibited.
 - a. Conduit outside diameter larger than 1/3 of the slab thickness is prohibited.
 - b. Space between conduits in slabs: Approximately six conduit diameters apart, except one conduit diameter at conduit crossings.
 - c. Install conduits approximately in the center of the slab so that there will be a minimum of 19 mm (3/4 inch) of concrete around the conduits.
- 5. Make couplings and connections watertight. Use thread compounds that are UL approved conductive type to insure low resistance ground continuity through the conduits. Tightening set screws with pliers is prohibited.
- B. Furred or Suspended Ceilings and in Walls:
 - 1. Conduit for conductors above 600 volts:
 - a. Rigid steel or rigid aluminum.
 - b. Aluminum conduit mixed indiscriminately with other types in the same system is prohibited.
 - 2. Conduit for conductors 600 volts and below:
 - a. Rigid steel, IMC, rigid aluminum, or EMT. Different type conduits mixed indiscriminately in the same system is prohibited.
 - 3. Align and run conduit parallel or perpendicular to the building lines.
 - 4. Connect recessed lighting fixtures to conduit runs with maximum 1800 mm (six feet) of flexible metal conduit extending from a junction box to the fixture.
 - 5. Tightening set screws with pliers is prohibited.

3.4 EXPOSED WORK INSTALLATION

- A. Unless otherwise indicated on the drawings, exposed conduit is only permitted in mechanical and electrical rooms.
- B. Conduit for conductors above 600 volts:
 - 1. Rigid steel or rigid aluminum.

- 2. Aluminum conduit mixed indiscriminately with other types in the same system is prohibited.
- C. Conduit for Conductors 600 volts and below:
 - 1. Rigid steel, IMC, rigid aluminum, or EMT. Different type of conduits mixed indiscriminately in the system is prohibited.
- D. Align and run conduit parallel or perpendicular to the building lines.
- E. Install horizontal runs close to the ceiling or beams and secure with conduit straps.
- F. Support horizontal or vertical runs at not over 2400 mm (eight foot) intervals.
- G. Surface metal raceways: Use only where shown.
- H. Painting:
 - 1. Paint exposed conduit as specified in Section 09 91 00, PAINTING.
 - 2. Paint all conduits containing cables rated over 600 volts safety orange. Refer to Section 09 91 00, PAINTING for preparation, paint type, and exact color. In addition, paint legends, using 50 mm (two inch) high black numerals and letters, showing the cable voltage rating. Provide legends where conduits pass through walls and floors and at maximum 6000 mm (20 foot) intervals in between.

3.5 EXPANSION JOINTS

- A. Conduits 75 mm (3 inches) and larger, that are secured to the building structure on opposite sides of a building expansion joint, require expansion and deflection couplings. Install the couplings in accordance with the manufacturer's recommendations.
- B. Provide conduits smaller than 75 mm (3 inches) with junction boxes on both sides of the expansion joint. Connect conduits to junction boxes with sufficient slack of flexible conduit to produce 125 mm (5 inch) vertical drop midway between the ends. Flexible conduit shall have a copper green ground bonding jumper installed. In lieu of this flexible conduit, expansion and deflection couplings as specified above for 375 mm (15 inches) and larger conduits are acceptable.
- C. Install expansion and deflection couplings where shown.

3.6 CONDUIT SUPPORTS, INSTALLATION

- A. Safe working load shall not exceed 1/4 of proof test load of fastening devices.
- B. Use pipe straps or individual conduit hangers for supporting individual conduits. Maximum distance between supports is 2.5 m (8 foot) on center.

- C. Support multiple conduit runs with trapeze hangers. Use trapeze hangers that are designed to support a load equal to or greater than the sum of the weights of the conduits, wires, hanger itself, and 90 kg (200 pounds). Attach each conduit with U-bolts or other approved fasteners.
- D. Support conduit independently of junction boxes, pull boxes, fixtures, suspended ceiling T-bars, angle supports, and similar items.
- E. Fasteners and Supports in Solid Masonry and Concrete:
 - 1. New Construction: Use steel or malleable iron concrete inserts set in place prior to placing the concrete.
 - 2. Existing Construction:
 - a. Steel expansion anchors not less than 6 mm (1/4 inch) bolt size and not less than 28 mm (1-1/8 inch) embedment.
 - b. Power set fasteners not less than 6 mm (1/4 inch) diameter with depth of penetration not less than 75 mm (3 inches).
 - c. Use vibration and shock resistant anchors and fasteners for attaching to concrete ceilings.
- F. Hollow Masonry: Toggle bolts are permitted.
- G. Bolts supported only by plaster or gypsum wallboard are not acceptable.
- H. Metal Structures: Use machine screw fasteners or other devices specifically designed and approved for the application.
- I. Attachment by wood plugs, rawl plug, plastic, lead or soft metal anchors, or wood blocking and bolts supported only by plaster is prohibited.
- J. Chain, wire, or perforated strap shall not be used to support or fasten conduit.
- K. Spring steel type supports or fasteners are prohibited for all uses except: Horizontal and vertical supports/fasteners within walls.
- L. Vertical Supports: Vertical conduit runs shall have riser clamps and supports in accordance with the NEC and as shown. Provide supports for cable and wire with fittings that include internal wedges and retaining collars.

3.7 BOX INSTALLATION

- A. Boxes for Concealed Conduits:
 - 1. Flush mounted.
 - 2. Provide raised covers for boxes to suit the wall or ceiling, construction and finish.
- B. In addition to boxes shown, install additional boxes where needed to prevent damage to cables and wires during pulling in operations.

- C. Remove only knockouts as required and plug unused openings. Use threaded plugs for cast metal boxes and snap-in metal covers for sheet metal boxes.
- D. Outlet boxes in the same wall mounted back-to-back are prohibited. A minimum 600 mm (24 inch), center-to-center lateral spacing shall be maintained between boxes.)
- E. Minimum size of outlet boxes for ground fault interrupter (GFI) receptacles is 100 mm (4 inches) square by 55 mm (2-1/8 inches) deep, with device covers for the wall material and thickness involved.
- F. Stencil or install phenolic nameplates on covers of the boxes identified on riser diagrams; for example "SIG-FA JB No. 1".
- G. On all Branch Circuit junction box covers, identify the circuits with black marker.

3.8 ELECTRONIC SAFETY AND SECURITY CONDUIT

- A. Install the electronic safety and security raceway system as shown on drawings.
- B. Minimum conduit size of 19 mm (3/4 inch), but not less than the size shown on the drawings.
- C. All conduit ends shall be equipped with insulated bushings.
- D. All 100 mm (four inch) conduits within buildings shall include pull boxes after every two 90 degree bends. Size boxes per the NEC.
- E. Vertical conduits/sleeves through closets floors shall terminate not less than 75 mm (3 inches) below the floor and not less than 75 mm (3 inches) below the ceiling of the floor below.
- F. Terminate conduit runs to/from a backboard in a closet or interstitial space at the top or bottom of the backboard. Conduits shall enter communication closets next to the wall and be flush with the backboard.
- G. Where drilling is necessary for vertical conduits, locate holes so as not to affect structural sections such as ribs or beams.
- H. All empty conduits located in communications closets or on backboards shall be sealed with a standard non-hardening duct seal compound to prevent the entrance of moisture and gases and to meet fire resistance requirements.
- I. Conduit runs shall contain no more than four quarter turns (90 degree bends) between pull boxes/backboards. Minimum radius of communication conduit bends shall be as follows (special long radius):

Sizes of Conduit Trade Size	Radius of Conduit Bends mm, Inches
$\frac{3}{4}$	150 (6)
1	230 (9)
1-1/4	350 (14)
1-1/2	430 (17)
2	525 (21)
2-1/2	635 (25)
3	775 (31)
3-1/2	900 (36)
4	1125 (45)

- J. Furnish and install 19 mm (3/4 inch) thick fire retardant plywood specified in on the wall of communication closets where shown on drawings . Mount the plywood with the bottom edge 300 mm (one foot) above the finished floor.
- K. Furnish and pull wire in all empty conduits. (Sleeves through floor are exceptions).

- - - E N D - - -

SECTION 28 13 11
PHYSICAL ACCESS CONTROL SYSTEM (PACS)

PART 1 - GENERAL

1.1 DESCRIPTION

Provide and install a complete Physical Access Control System, hereinafter referred to as the PACS.

1.2 RELATED WORK

- A. For firestopping application and use, Section 07 84 00, FIRESTOPPING.
- B. For labeling and signs, Section 10 14 00, SIGNAGE.
- C. For connection of high voltage, Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
- D. For power cables, Section 26 05 21, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES (600 VOLTS AND BELOW).
- E. For grounding of equipment, Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS.
- F. For infrastructure, Section 26 05 33, RACEWAYS AND BOXES FOR ELECTRICAL SYSTEMS.
- G. For perimeter lighting, Section 26 56 00, EXTERIOR LIGHTING.
- H. For screening of personnel and shipments, Section 28 13 53, SECURITY ACCESS DETECTION.
- I. For alarm systems, Section 28 16 11, INTRUSION DETECTION SYSTEM (IDS).
- J. For control and operation of all security systems, Section 28 13 16, ACCESS CONTROL SYSTEM AND DATABASE MANAGEMENT.
- K. For security camera systems, Section 28 23 00 VIDEO SURVEILLANCE.
- L. For emergency and interior communications, Section 28 26 00, ELECTRONIC PERSONAL PROTECTION SYSTEM (EPPS).
- M. For Warranty of Construction, see GENERAL CONDITIONS.
- N. For General Requirements, Section 01 00 00, GENERAL REQUIREMENTS.

1.3 QUALITY ASSURANCE

- A. The Contractor shall be responsible for providing, installing, and the operation of the PACS as shown. The Contractor shall also provide certification as required.
- B. The security system will be installed and tested to ensure all components are fully compatible as a system and can be integrated with all associated security subsystems, whether the security system is stand-alone or a part of a complete Information Technology (IT) computer network.

- C. The Contractor or security sub-contractor shall be a licensed security Contractor as required within the state or jurisdiction of where the installation work is being conducted.

1.4 SUBMITTALS

- A. Submit below items in conjunction with Master Specification Sections 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES, and Section 02 41 00, DEMOLITION.
- B. Provide certificates of compliance with Section 1.3, Quality Assurance.
- C. Provide a complete and thorough pre-installation and as-built design package in both electronic format and on paper, minimum size 48 x 48 inches (1220 x 1220 millimeters); drawing submittals shall be per the established project schedule.
- D. Pre-installation design and as-built packages shall include, but not be limited to:
 - 1. Index Sheet that shall:
 - a. Define each page of the design package to include facility name, building name, floor, and sheet number.
 - b. Provide a complete list of all security abbreviations and symbols.
 - c. Reference all general notes that are utilized within the design package.
 - d. Specification and scope of work pages for all individual security systems that are applicable to the design package that will:
 - 1) Outline all general and job specific work required within the design package.
 - 2) Provide a detailed device identification table outlining device Identification (ID) and use for all security systems equipment utilized in the design package.
 - 2. Drawing sheets that will be plotted on the individual floor plans or site plans shall:
 - a. Include a title block as defined above.
 - b. Clearly define the drawings scale in both standard and metric measurements.
 - c. Provide device identification and location.
 - d. Address all signal and power conduit runs and sizes that are associated with the design of the electronic security system and other security elements (e.g., barriers, etc.).

- e. Identify all pull box and conduit locations, sizes, and fill capacities.
 - f. Address all general and drawing specific notes for a particular drawing sheet.
3. A detailed riser drawing for each applicable security subsystem shall:
- a. Indicate the sequence of operation.
 - b. Relationship of integrated components on one diagram.
 - c. Include the number, size, identification, and maximum lengths of interconnecting wires.
 - d. Wire/cable types shall be defined by a wire and cable schedule. The schedule shall utilize a lettering system that will correspond to the wire/cable it represents (example: A = 18 AWG/1 Pair Twisted, Unshielded). This schedule shall also provide the manufacturer's name and part number for the wire/cable being installed.
4. A detailed system drawing for each applicable security system shall:
- a. Clearly identify how all equipment within the system, from main panel to device, shall be laid out and connected.
 - b. Provide full detail of all system components wiring from point-to-point.
 - c. Identify wire types utilized for connection, interconnection with associate security subsystems.
 - d. Show device locations that correspond to the floor plans.
 - e. All general and drawing specific notes shall be included with the system drawings.
5. A detailed schedule for all of the applicable security subsystems shall be included. All schedules shall provide the following information:
- a. Device ID.
 - b. Device Location (e.g. site, building, floor, room number, location, and description).
 - c. Mounting type (e.g. flush, wall, surface, etc.).
 - d. Power supply or circuit breaker and power panel number.
 - e. In addition, for the PACS, provide the door ID, door type (e.g. wood or metal), locking mechanism (e.g. strike or electromagnetic lock) and control device (e.g. card reader or biometrics).

6. Detail and elevation drawings for all devices that define how they were installed and mounted.
- E. Pre-installation design packages shall go through a full review process conducted by the Contractor along with a VA representative to ensure all work has been clearly defined and completed. All reviews shall be conducted in accordance with the project schedule. There shall be four (4) stages to the review process:
 1. 35 percent
 2. 65 percent
 3. 90 percent
 4. 100 percent
- F. Provide manufacturer security system product cut-sheets. Submit for approval at least 30 calendar days prior to commencement of formal testing, a Security System Operational Test Plan. Include procedures for operational testing of each component and security subsystem, to include performance of an integrated system test.
- G. Submit manufacture's certification of Underwriters Laboratories, Inc. (UL) listing as specified. Provide all maintenance and operating manuals per Section 01 00 00, GENERAL REQUIREMENTS.

1.5 APPLICABLE PUBLICATIONS

- A. The publications listed below (including amendments, addenda, revisions, supplement, and errata) form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American National Standards Institute (ANSI)/ Security Industry Association (SIA):
 - AC-01.....Access Control: Wiegand Card Reader Interface
Standard
 - AC-03.....Access Control: Badging Techniques
- C. American National Standards Institute (ANSI)/ International Code Council (ICC):
 - A117.1.....Standard on Accessible and Usable Buildings and
Facilities
- D. Department of Justice American Disability Act (ADA)
 - 28 CFR Part 36-90.....ADA Standards for Accessible Design
- E. Government Accountability Office (GAO):
 - GAO-03-8-02.....Security Responsibilities for Federally Owned
and Leased Facilities

- F. National Electrical Contractors Association
 - 303-2005.....Installing Closed Circuit Television (CCTV) Systems
- G. National Electrical Manufacturers Association (NEMA):
 - 250-03.....Enclosures for Electrical Equipment (1000 Volts Maximum)
- H. National Fire Protection Association (NFPA):
 - 70-05..... Article 780-National Electrical Code
- I. Underwriters Laboratories, Inc. (UL):
 - 294-99.....Standard for Access Control
 - 305-97.....Standard for Panic Hardware
 - 639-97.....Standard for Intrusion-Detection Units
 - 752-05.....Standard for Bullet-Resisting Equipment
 - 827-96.....Central Station Alarm Services
 - 1076-95.....Standards for Proprietary Burglar Alarm Units and Systems
 - 1981-03.....Central Station Automation System
 - 2058-05.....High Security Electronic Locks
- J. Homeland Security Presidential Directive (HSPD):
 - HSPD-12.....Policy for a Common Identification Standard for Federal Employees and Contractors
- K. Federal Information Processing Standards (FIPS):
 - FIPS-201.....Personal Identity Verification (PIV) of Federal Employees and Contractors
- L. National Institute of Standards and Technology (NIST):
 - IR 6887 V2.1.....Government Smart Card Interoperability Specification (GSC-IS)
 - Special Pub 800-96.....PIV Card Reader Interoperability Guidelines
- M. Institute of Electrical and Electronics Engineers (IEEE):
 - C62.41.....IEEE Recommended Practice on Surge Voltages in Low-Voltage AC Power Circuits
- N. International Organization for Standardization (ISO):
 - 7810.....Physical Characteristics of Credit Card Size Document
 - 7811.....Physical Characteristics for Magnetic Stripe Cards
 - 7816-1.....Physical Characteristics of the Card
 - 7816-2.....Dimensions and Contact Position of the card

7816-3.....Electrical Signals and Transmission Protocols
 7816-4.....Inter-Industry Command for Interchange
 14443.....RFID cards; Contactless Proximity Cards
 Operating at 13.56 MHz in up to 5 inches
 distance
 15693.....RFID cards; Contactless Vicinity Cards
 Operating at 13.56 MHz in up to 50 inches
 distance

O. Uniform Federal Accessibility Standards (UFAS) 1984

P. ADA Standards for Accessible Design 1994

1.6 WARRANTY OF CONSTRUCTION.

Warrant PACS work subject to the Article "Warranty of Construction" of FAR clause 52.246-21.

PART 2 - PRODUCTS

2.1 EQUIPMENT AND MATERIALS

- A. All equipment associated within the PACS shall be UL 294 compliant and rated for continuous operation. Environmental conditions (i.e. temperature, humidity, wind, and seismic activity) shall be taken under consideration at each facility and site location prior to installation of the equipment.
- B. All equipment shall operate on a 120 volts alternating current (VAC); 60 Hz AC power system unless documented otherwise in subsequent sections listed within this specification. All equipment shall have a back-up source of power that will provide a minimum of 96 hours of run time in the event of a loss of primary power to the facility.
- C. The system shall be designed, installed, and programmed in a manner that will allow for easy of operation, programming, servicing, maintenance, testing, and upgrading of the system.
- D. All PACS components located in designated "HAZARDOUS ENVIRONMENT" areas where fire or explosion could occur due to the presence of natural gases or vapors, flammable liquids, combustible residue, or ignitable fibers or debris, shall be rated Class II, Division I, Group F, and installed in accordance with NFPA 70, Chapter 5.
- E. All equipment and materials for the system will be compatible to ensure correct operation as outlined in FIPS 201, March 2006 and HSPD-12.

2.2 EQUIPMENT ITEMS

- A. The security system characteristics listed in this section will serve as a guide in selection of equipment and materials for the PACS. If

- updated or more suitable versions are available then the Contracting Officer will approve the acceptance of prior to an installation.
- B. PACS equipment shall meet or exceed all requirements listed below.
- C. A PACS shall be comprised of, but not limited to, the following components:
1. Control/Communications Panels
 2. Electronic Security Management System
 3. Card Reader and Credential Cards
 4. Picture ID and Badging Station (To be provided in accordance with the VA PIV enrollment and issuance system.)
 5. Biometrics
 6. Portal Control Devices
 7. Door Status Indicators
 8. Entry Control Device
 9. Power Supplies
 10. Wires and Cables
- D. Control/Communication Panels:
1. Shall be a central point provided for monitoring, controlling, and programming the PACS.
 2. Shall provide a means of controlling up to 16 doors per panel.
 3. Shall be expandable and provide a means of networking multiple panels to provide overall control of all doors on the PACS via a primary panel.
 4. Shall be system specific addressable, Internet Protocol (IP) addressable, and programmable via a computer.
 5. Shall be able to be interfaced directly from a computer or via the Internet or Intranet. Access to the panels shall be password protected. All individuals with access to the panels shall have a user specific password.
 6. Shall be of the same manufacturer and part number to ensure full compatibility within the system.
 7. The operating system for the panel must utilize a single seamlessly integrated relational database for all functionality. This integration shall be provided with one operating environment. The operating environment shall be the fully multi-tasking multi-threading Microsoft Windows 2003/2000/Windows XP Operating System.
 8. The panel's web enabled client applications shall be capable of running on independent client operating systems including Windows

- 2003/2000, Windows XP, Windows NT, Windows 98, Windows 95, Macintosh, UNIX, Linux, and Solaris. The web-enabled applications shall utilize the same common database as the other system modules.
9. The panel programming shall be written so that all system modules (e.g. access control, alarm monitoring, credential management, digital video, visitor management, intrusion detection, asset management, etc.) are developed and built from a unified 32-bit source code set. There absolutely shall not be separate source code bases for the individual modules of the PACS.
 10. Shall allow for the operation and control of up to 16 doors.
 11. Shall consist of or have the equivalent of, at a minimum, a General Control Module and an Access Control Module. Both modules shall be programmable via a computer.
 12. The General Control Module shall:
 - a. Provide for full distributed processing of access control and alarm monitoring operations.
 - b. Store the following information and function using a high speed, local 32-bit microprocessor:
 - 1) access levels
 - 2) hardware configurations
 - 3) programmed alarm outputs assigned at a administration client workstation
 - c. Process all access granted/denied decisions to provide fast responses to card reader transactions. A fully configured general control module with 64 card readers shall require less than one-half (0.5) seconds to grant access to an authorized cardholder or deny access to an unauthorized cardholder.
 - d. Meet the following minimum requirements:
 - 1) A minimum host communications speed of 115,200 bps.
 - 2) Support direct connect connections.
 - 3) Have remote dial up.
 - 4) Minimum on-board memory of eight (8) MB.
 - 5) Local Area Network (LAN) Support RJ45 (10/100baseT) Ethernet Interface Token Ring four (4) MB connectivity.
 - 6) Minimum memory storage of up to 5,000 cardholders and 100,000 events.
 - 7) Downstream ports for connecting card readers and data gathering panels via RS-485 multi-drop wiring configuration.

- 8) Support of multiple card technologies.
 - 9) Supervised Communications with PACS system software.
 - 10) Support of up to eight card formats and facility codes.
 - 11) RS-485 Full Duplex, UL 1076 Grade AA communication channel to the system head-end.
 - 12) Integration with all manufacturers' card readers.
 - 13) Biometric Interface Support.
 - 14) 12 VAC or 12 volts direct current (VDC) input power via a UL certified step-down transformer or power supply.
 - 15) Issue Code Support for both Magnetic and Wiegand Card Formats.
 - 16) Individual Shunt Times
 - 17) Up to Nine Digit PIN Codes.
 - 18) Downstream serial RS-232 device support.
 - 19) Status LED's to identify normal component and communication status.
13. The access control module shall:
- a. Control up to 16 doors utilizing input and output relays that are fully programmable via network software.
 - b. Input relays shall meet the following minimum requirements:
 - 1) Provide up to 16 UL 1076 analog unsupervised alarm input zones to monitor and report alarm conditions, power faults, and tampers.
 - 2) Operate independently and in conjunction with output relays, which will send an output signal to a corresponding output device upon alarm input activation. Once an alarm has been received, the input relay shall activate any or all alarm outputs.
 - 3) Contain the following features:
 - a) UL 294 Certified.
 - b) Alarm contact status scanning at up to 120 times per second for each zone.
 - c) A low power Complementary-symmetry/metal-oxide semiconductor (CMOS) microprocessor.
 - d) Filtered data for noise rejection to prevent false alarms.
 - e) Up to 16 supervised inputs.
 - f) 12 VAC or 12 VDC Input Power.
 - g) Two (2) dedicated inputs for tamper and power status.
14. Output relays shall meet the following minimum requirements:

- a. Shall be capable of controlling a corresponding output device upon any input activation or on command from the PACS.
- b. Shall be capable of responding to:
 - 1) Input alarms.
 - 2) Commands from a System Operator.
 - 3) Time zone control commands for automatic operation.
- c. Shall be capable of:
 - 1) Pulsing for a predetermined duration. Duration shall be programmable for each relay individually.
 - 2) Responding on command from the System Operator to pulse, command on, command off, or reset to normal state.
 - 3) Operating outputs rated at 5 amps (A) @ 30 VDC.

E. Electronic Security Management System (SMS):

- 1. Shall allow the configuration of an enrollment and badging, alarm monitoring, administrative, asset management, digital video management, intrusion detection, visitor enrollment, remote access level management, and integrated client workstations or any combination of all or some.
- 2. Shall be expandable to support an unlimited number of individual module or integrated client workstations. All access control field hardware, including Intelligent System Controllers (ISC), shall be connected to all Windows 2003/2000/XP based access control system workstation on the network.
- 3. Shall have the ability to compose, file, maintain, update, and print reports for either individuals or the system as follows.
 - a. Individual reports that consist of an employees name, office location, phone number or direct extension, and normal hours of operation. The report shall provide a detail listing of the employee's daily events in relation to accessing points within a facility.
 - b. System reports shall be able to produce information on a daily/weekly/monthly basis for all events, alarms, and any other activity associated with a system user.
 - c. All reports shall be in a date/time format and all information shall be clearly presented.
- 4. Shall be designed to allow it to work with any industry standard network protocol and topology listed below:
 - a. Transmission Control Protocol (TCP)/IP

- b. Novell Netware (IPX/SPX)
 - c. Banyan VINES
 - d. IBM LAN Server (NetBEUI)
 - e. Microsoft LAN Manager (NetBEUI)
 - f. Network File System (NFS) Networks
 - g. Remote Access Service (RAS) via ISDN, x.25, and standard phone lines.
5. Shall provide full interface and control of the PACS to include the following subsystems within the PACS:
- a. Public Key Infrastructure
 - b. Card Management
 - c. Identity and Access Management
 - d. Personal Identity Verification
6. Shall have the following features or compatibilities:
- a. The ability to be operated locally or remotely via a LAN, WAN, internet, or intranet.
 - b. Event and Alarm Monitoring
 - c. Database Partitioning
 - d. Ability to fully integrate with all other security subsystems
 - e. Enhanced Monitoring Station with Split Screen Views
 - f. Alternate and Extended Shunt by Door
 - g. Escort Management
 - h. Enhanced IT-based Password Protection
 - i. N-man Rule and Occupancy Restrictions
 - j. Open Journal Data Format for Enhanced Reporting
 - k. Automated Personnel Import
 - l. ODBC Support
 - m. Windows 2000 Professional, Windows Server 2003, Windows XP Professionals for Servers
 - n. Field-Level Audit Trail
 - o. Cardholder Access Events
7. For the SMS network a server and client workstation shall be required and must meet the following minimum technical characteristics:

a. Server:

Processor	1.8 GHz Intel Pentium IV
Free Hard Disk Space	3.0 GB

Memory	1.0 GB
Network Card	10/100 Base-T
CD-ROM Drive	10X
Monitor/Video Adapter board	17" SVGA (1024 x 768)
Operating System	Windows 2000 Professional, Windows Server 2003, Windows XP Professional
Ports	2 serial, 1 parallel, USB
Backup	Tape or CDRW
Modem	56.7 Kbps

b. Client Workstation:

Processor	1.5 GHz Intel Pentium III
Free Hard Disk Space	2.0 GB
Memory	512 MB RAM
Network Card	10 Base-T
CD-ROM Drive	10X
Monitor/Video Adapter board	17" SVGA (1024 x 768), 64 MB RAM
Operating Systems	Windows 2000 Professional or XP Professional

F. Card Readers and Credential Cards:

1. Shall be utilized for controlling the locking hardware on a door and allows for reporting back to the main control panel with the time/date the door was accessed, the name of the person accessing the point of entry, and its location.
2. Will be fully programmable and addressable, locally and remotely, and hardwired to the system.
3. Shall be individually home run to the main panel.
4. Shall be installed in a manner that they comply with:
 - a. The Uniform Federal Accessibility Standards (UFAS)

- b. The Americans with Disabilities Act (ADA)
 - c. The ADA Standards for Accessible Design
5. Shall support a variety of card readers that must encompass a wide functional range. The PACS may combine any of the card readers described below for installations requiring multiple types of card reader capability (i.e., card only, card and/or PIN, supervised inputs, etc.). These card readers shall be available in the approved technology to meet FIPS 201 and is ISO 14443 A or B compliant. The reader output can be Wiegand, RS-22, 485 or TCP/IP.
 6. Are to be housed in an aluminum bezel with a wide lead-in for easy card entry.
 7. Shall contain read head electronics, and a sender to encode digital door control signals.
 8. LED's shall be utilized to indicate card reader status and access status.
 9. Shall be able to support a user defined downloadable off-line mode of operation (e.g. locked, unlocked, or facility code), which will go in effect during loss of communication with the main control panel.
 10. Shall provide audible feedback to indicate access granted/denied decisions. Upon a card swipe, two audible tones or beeps shall indicate access granted and three tones or beeps shall indicate access denied. All keypad buttons shall provide (tactile?? What does this mean) audible feedback.
 11. Shall have a minimum of two programmable inputs and two programmable outputs.
 12. All card readers that utilize keypad controls along with a reader and shall meet the following specifications:
 - a. Entry control keypads shall use a unique combination of alphanumeric and other symbols as an identifier. Keypads shall contain an integral alphanumeric/special symbols keyboard with symbols arranged in ascending ASCII code ordinal sequence. Communications protocol shall be compatible with the local processor.
 - b. Shall include a Light Emitting Diode (LED) or other type of visual indicator display and provide visual or visual and audible status indications and user prompts. The display shall indicate power on/off, and whether user passage requests have been

accepted or rejected. The design of the keypad display or keypad enclosure shall limit the maximum horizontal and vertical viewing angles of the keypad. The maximum horizontal viewing angle shall be plus and minus five (5) degrees or less off a vertical plane perpendicular to the plane of the face of the keypad display. The maximum vertical viewing angle shall be plus and minus 15 degrees or less off a horizontal plane perpendicular to the plane of the face of the keypad display.

- c. Shall respond to passage requests by generating a signal to the local processor. The response time shall be 800 milliseconds or less from the time the last alphanumeric symbol is entered until a response signal is generated.
 - d. Shall be powered from the source as designed and shall not dissipate more than 150 Watts.
 - e. Shall be suitable for surface, semi-flush, pedestal, or weatherproof mounting as required.
 - f. Shall provide a means for users to indicate a duress situation by entering a special code.
13. Card readers shall come in the following formats:
- a. Magnetic Stripe Card Reader
 - 1) Shall be utilized during the transition from the existing technology to the contactless smart card technology as defined in FIPS-201.
 - 2) Shall read credential cards that utilize single layer 4000 units of magnetic field strength per magnetic tape material.
 - 3) The magnetic tape material shall be coated with Teflon and affixed to the back of the credential card near the top. This reader shall allow the card to either be swiped or inserted into the reader.
 - 4) Shall meet or exceed the following minimum technical characteristics:

Card Speed	5 to 30 inches (203 to 1270mm) per second
Data Rate	1 ms per bit
Connections	Plug-in with 8" (200mm) pigtail cable
Output Format	26 or 34-bit

Power	Per Manufacturers Specifications
Lifetime	250,000 wear cycles with a MTBF 22,000 hours
Error Rate	5% false reject 2×10^{-6} false accept
Static Discharge	Withstands up to 20,000 volts
LED	If required per the design package.
Card Format Output Format	EMPI 26 or 34-bit ANSI/ABA All bits Clock-and-Data up to 37 characters 10 Digit ANSI/ABA 26 or 34-bit

b. Wiegand Card Reader:

- 1) Shall be utilized during the transition from the existing technology to the contactless smart card technology as defined in FIPS-201.
- 2) Shall read credential cards which are encoded using Wiegand effect ferromagnetic wires laminated into the credential card.
- 3) Shall create a magnetic field and output a coded representation of the unique pattern of magnetic flux changes produced by moving the credential card through the card reader.
- 4) The output shall be a series of electrical signals and shall constitute a unique identification code number.
- 5) Wiegand credential cards shall use at least 24 binary digits to generate a unique credential card identification code.
- 6) The card reader shall meet or exceed the following technical characteristics:

Card Speed	5 to 30 inches (203 to 1270mm) per second
Data Rate	1ms per bit
Connections	RJ-45 Jack or multi- conductor quick disconnect
Output Formats	26 or 34-bit
Power	Per Manufacturers Specifications

Lifetime	600,000 pass read head
Error Rate	false accept
Static Discharge	Withstands 20,000 volts
LED	If required per the design package
Card Output Format	EMPI 26 or 34-bit ANSI/ABA All bits Clock-and-Data up to 37 characters 10 Digit ANSI/ABA 26 or 34-bit

c. Contactless Smart Cards and Readers:

- 1) Smart card readers shall read credential cards whose characteristics of size and technology meet those defined by ISO/IEC 7816, 14443, 15693.
- 2) The readers shall have "flash" download capability to accommodate card format changes.
- 3) The card reader shall have the capability of reading the card data and transmitting the data to the main monitoring panel.
- 4) The card reader shall be contactless and meet or exceed the following technical characteristics:
 - a) Data Output Formats: FIPS 201 low outputs the FASC-N in an assortment of Wiegand bit formats from 40 - 200 bits. FIPS 201 medium outputs a combination FASC-N and HMAC in an assortment of Wiegand bit formats from 32 - 232 bits. All Wiegand formats or the upgradeability from Low to Medium Levels can be field configured with the use of a command card.
 - b) FIPS 201 readers shall be able to read, but not be limited to, DESfire and iCLASS cards.

Reader range shall comply with ISO standards 7816, 14443, and 15693, and also take into consideration conditions, are at a minimum 1 to 2 inches (2.5 - 5 cm).

d. Proximity (PROX) Card Reader:

- 1) Shall be utilized during the transition from the existing technology to the contactless smart card technology as defined in FIPS-201.

- 2) Shall use active/passive proximity detection and shall not require contact with the proximity credential card for operation.
 - a) Active detection proximity card readers shall provide power to compatible credential cards through magnetic induction and receive and decode a unique identification code number transmitted from the credential card.
 - b) Passive detection proximity card readers shall use a swept-frequency, radio frequency field generator to read the resonant frequencies of tuned circuits laminated into compatible credential cards. The resonant frequencies read shall constitute a unique identification code number.
- 3) Shall read proximity cards in a range from 0 to at least six (6) inches (0 to at least 15 cm) from the reader. The credential card design shall allow for a minimum of 32,000 unique identification codes per facility.
- 4) Shall be able to read cards from two (2) inches (5cm) to 6 inches (15cm).
- 5) For exterior parking lots or garages shall be 16 inches (40 cm).
- 6) The operating frequency shall be determined by the type of access control system being utilized.

e. Credential Cards: Shall be in accordance with FIPS 201 and controlled by the PIV enrollment and issuance system.

G. Picture ID and Badging Station:

1. Shall be FIPS 201 compliant and will be controlled by the PIV enrollment and issuance system.
2. Shall provide a form-based interface for the entry of badge holder data and access information. All data, including images, shall be stored on the system server.
3. Shall allow image and signature capture for use in badge production, and provides tools for badge design. Both video and digital cameras may be utilized.
4. Shall meet the following minimum characteristics:
 - a. Windows 2000/XP
 - b. Support for all ID Cards, Reader and Printer Technologies
 - c. Centralized User Enrollment
 - d. Password Protected

- e. High Speed Photo Capture
- f. Signature and/or Biometric Data Capture
- g. Digital Certificate Management
- h. Report Generator
- i. Intelli-Check ID Check Integration or Equivalent
- j. Photo Capture via Digital or Video Camera
- k. In-line Encoding of Magnetic Stripe and Barcode
- l. ZD (PDF-417) Barcode Support
- m. Image Compression Control
- n. Image FX Gallery
- o. Program Badge
- p. Chromakey and Ghosting

H. Portal Control Devices:

1. Shall be used to assist the PACS.
2. Such devices shall:
 - a. Provide a means of monitoring the doors status.
 - b. Allow for exiting a space via either a push button, request to exit, or panic/crash bar.
 - c. Provide a means of override to the PACS via a keypad or key bypass.
 - d. Assist door operations utilizing automatic openers and closures.
 - e. Provide a secondary means of access to a space via a keypad.
3. Shall be connected to and monitored by the main PACS panel.
4. Shall be installed in a manner that they comply with:
 - a. The Uniform Federal Accessibility Standards (UFAS)
 - b. The Americans with Disabilities Act (ADA)
 - c. The ADA Standards for Accessible Design
5. Shall provide a secondary means of access control within a secure area.
6. Keypads: Refer to Section 2.2.F.12 for keypad requirements.
7. Push-Button Switches:
 - a. Shall be momentary contact, back lighted push buttons, and stainless steel switch enclosures for each push button as shown. Buttons are to be utilized for secondary means of releasing a locking mechanism.
 - b. In an area where a push button is being utilized for remote access of the locking device then no more than two (2) buttons

shall operate one door from within one secure space. Buttons will not be wired in series with one other.

- C. In an area where locally stationed guards control entry to multiple secure points via remote switches. An interface board shall be designed and constructed for only the amount of buttons it shall house. These buttons shall be flush mounted and clearly labeled for ease of use. All buttons shall be connected to the PACS and SMS system for monitoring purposes.
- d. Shall have double-break silver contacts that will make 720 VA at 60 amperes and break 720 VA at 10 amperes.

8. Crash Bar:

a. Emergency Exit with Alarm (Panic):

- 1. Entry control portals shall include panic bar emergency exit hardware as designed.
- 2. Panic bar emergency exit hardware shall provide an alarm shunt signal to the PACS and SMS.
- 3. The panic bar shall include a conspicuous warning sign with one (1) inch (2.5 cm) high, red lettering notifying personnel that an alarm will be annunciated if the panic bar is operated.
- 4. Operation of the panic bar hardware shall generate an intrusion alarm that reports to both the SMS and Intrusion Detection System. The use of a micro switch installed within the panic bar shall be utilized for this.
- 5. The panic bar shall a fully mechanical connection only and shall not depend upon electric power for operation.
- 6. The panic bar shall be compatible with mortise or rim mount door hardware and shall operate by retracting the bolt manually by either pressing the panic bar or with a key bypass. Refer to Section 2.2.I.9 for key-bypass specifications.

b. Normal Exit:

- 1) Entry control portals shall include panic bar non-emergency exit hardware as designed.
- 2) Panic bar non-emergency exit hardware shall be monitored by and report to the SMS.
- 3) Operation of the panic bar hardware shall not generate a locally audible or an intrusion alarm within the IDS.

- 4) When exiting, the panic bar shall depend upon a mechanical connection only. The exterior, non-secure side of the door shall be provided with an electrified thumb latch or lever to provide access after the credential I.D. authentication by the SMS.
- 5) The panic bar shall be compatible with mortise or rim mount door hardware and shall operate by retracting the bolt manually by either pressing the panic bar or with a key bypass. Refer to Section 2.2.I.9 for key-bypass specifications. The strikes/bolts shall include a micro switch to indicate to the system when the bolt is not engaged or the strike mechanism is unlocked. The signal switches shall report a forced entry to the system in the event the door is left open or accessed without the identification credentials.

9. Key Bypass:

- a. Shall be utilized for all doors that have a mortise or rim mounted door hardware.
- b. Each door shall be individually keyed with one master key per secured area.
- c. Cylinders shall be six (6)-pin and made of brass or equivalent. Keys for the cylinders shall be constructed of solid material and produced and cut by the same distributor. Keys shall not be purchased, cut, and supplied by multiple dealers.
- d. All keys shall have a serial number cut into the key. No two serial numbers shall be the same.
- e. All keys and cylinders shall be stored in a secure area that is monitored by the Intrusion Detection System.

10. Automatic Door Opener and Closer:

- a. Shall be low energy operators.
- b. Door closing force shall be adjustable to ensure adequate closing control.
- c. Shall have an adjustable back-check feature to cushion the door opening speed if opened violently.
- d. Motor assist shall be adjustable from 0 to 30 seconds in five (5) second increments. Motor assist shall restart the time cycle with each new activation of the initiating device.
- e. Unit shall have a three-position selector mode switch that shall permit unit to be switched "ON" to monitor for function

activation, switched to "H/O" for indefinite hold open function or switched to "OFF," which shall deactivate all control functions but will allow standard door operation by means of the internal mechanical closer.

- f. Door control shall be adjustable to provide compliance with the requirements of the Americans with Disabilities Act (ADA) and ANSI standards A117.1.
- g. All automatic door openers and closers shall:
 - 1) Meet UL standards.
 - 2) Be fire rated.
 - 3) Have push and go function to activate power operator or power assist function.
 - 4) Have push button controls for setting door close and door open positions.
 - 5) Have open obstruction detection and close obstruction detection built into the unit.
 - 6) Have door closer assembly with adjustable spring size, back-check valve, sweep valve, latch valve, speed control valve and pressure adjustment valve to control door closing.
 - 7) Have motor start-up delay, vestibule interface delay; electric lock delay and door hold open delay up to 30 seconds. All operators shall close door under full spring power when power is removed.
 - 8) Are to be hard wired with power input of 120 VAC, 60Hz and connected to a dedicated circuit breaker located on a power panel reserved for security equipment.

I. Door Status Indicators:

- 1. Shall monitor and report door status to the SMS.
- 2. Door Position Sensor:
 - a. Shall provide an open or closed indication for all doors operated on the PACS and report directly to the SMS.
 - b. Shall also provide alarm input to the Intrusion Detection System for all doors operated by the PACS and all other doors that require monitoring by the intrusion detection system.
 - c. Switches for doors operated by the PACS shall be double pole double throw (DPDT). One side of the switch shall monitor door position and the other side if the switch shall report to the intrusion detection system. For doors with electromagnetic locks

a magnetic bonding sensor (MBS) can be used in place of one side of a DPDT switch, in turn allowing for the use of a single pole double throw (SPDT) switch in it place of a DPDT switch.

- d. Switches for doors not operated by the PACS shall be SPDT and report directly to the IDS.
 - e. Shall be surface or flush mounted and wide gap with the ability to operate at a maximum distance of up to 2" (5 cm).
3. Request-to-Exit (RTE) :
- a. Shall be utilized to de-energize the locking hardware on a door to allow for exiting a secure area.
 - b. Shall be either an infrared sensor or a push button.
 - c. Infrared sensors shall meet the following minimum technical characteristics:

Alarm Output	2 Form "C" relay contacts
Indicators	1 activation LED
Power Requirements	12 or 24 VAC, 12 or 24 VDC, 26 mA @ 12 VDC
Relay Latch	Time Adjustable to 60 seconds

J. Entry Control Devices:

- 1. Shall be hardwired to the PACS main control panel and operated by a card reader via a relay on the main control panel.
- 2. Shall be fail-safe in the event of power failure to the PACS system.
- 3. Shall operate at 24 VCD, with the exception of turnstiles and be powered by a separate power supply dedicated to the door control system. Each power supply shall be rated to operate a minimum of two doors simultaneously without error to the system or overload the power supply unit.
- 4. Shall have a diode or metal-oxide veristor (MOV) to protect the controller and power supply from reverse current surges or back-check.
- 5. Electric Strikes/Bolts: Shall be:
 - a. Made of heavy-duty construction and tamper resistant design.
 - b. Tested to over one million cycles.
 - c. Rated for a minimum of 1000 lbs. holding strength.

- d. Utilize an actuating solenoid for the strike/bolt. The solenoid shall move from fully open to fully closed position and back in not more than 500 milliseconds and be rated for continuous duty.
 - e. Utilize a signal switch that will indicate to the system if the strike/bolt is not engaged or is unlocked when it should be secured.
 - f. Flush mounted within the door frame.
6. Electric Mortise Locks: Shall be installed within the door and an electric transfer hinge shall be utilized to allow the wires to be transferred from the door frame to the lock. If utilized with a double door then the lock shall be installed inside the active leaf.
7. Electromagnetic Locks:
- a. These locks shall be without mechanical linkage utilizing no moving parts, and securing the door to its frame solely on electromagnetic force.
 - b. Shall be comprised of two pieces, the mag-lock and the door plate. The mag-lock shall be surface mounted to the door frame and the door plate shall be surface mounted to the door.
 - c. Ensure a diode or MOV is installed in line with the DC voltage supplying power to the unit in order to prevent back-check on the system when the mag-lock is powered.
 - d. Shall utilize a magnetic bonding sensor (MBS) to monitor the door status and report that status to the SMS.
 - e. Electromagnetic locks shall meet the following minimum technical characteristics:

Operating Voltage		24 VDC
Current Draw		.5A
Holding Force	Swing Doors	1500 lbs (675 Kg)
	Sliding Doors	500 lbs (225 Kg)

8. Turnstiles:
- a. Shall operate at 110 VAC, 60 Hz or 220 VAC, 50 Hz supplied from a dedicated circuit breaker on a security power panel. This device does not require a back-up power source.
 - b. Shall be utilized as a means of monitoring and controlling access in a lobby.

c. Shall meet the following minimum requirements:

- 1) Be UFAS compliant.
- 2) Provide either an audible or visual confirmation that access has been granted to a cleared individual.
- 3) Provide an audible alarm in the event a non-cleared individual is attempting to gain access.
- 4) Interface with the SMS and utilize a card reader for accessing and exiting a facility, and provide a recorded event of personnel accessing these points.
- 5) Have a built-in step-down transformer to provide power to a card reader unit.
- 6) Have built-in signal wiring chassis to allow for plug and play capabilities with the PACS.
- 7) Have the ability to detect tailgating within one quarter on an inch to prevent unauthorized access to a facility.

K. Power Supplies:

1. Shall be UL rated and able to adequately power two entry control devices on a continuous base without failure.
2. Shall meet the following minimum technical characteristics:

INPUT POWER	110 VAC 60 HZ 2 amp
OUTPUT VOLTAGE	12 VDC Nominal (13.8 VDC) 24 VDC Nominal (27.6 VDC) Filtered and Regulated
BATTERY	Dependant on Output Voltage shall provide up to 14 Ah
OUTPUT CURRENT	10 amp max. @ 13.8 VDC 5 amp max. @ 27.6 VDC
PRIMARY FUSE SIZE	6.3 amp (non-removable)
BATTERY FUSE SIZE	12 amp, 3AG
CHARGING CIRCUIT	Built-in standard

L. Wires and Cables

1. Shall meet or exceed the manufactures recommendations for power and signal.
2. Shall be carried in an enclosed conduit system, utilizing electromagnetic tubing (EMT) to include the equivalent in flexible metal, rigid galvanized steel (RGS) to include the equivalent of liquid tight, polyvinylchloride (PVC) schedule 40 or 80.
3. All conduits will be sized and installed per the NEC. All security system signal and power cables that traverse or originate in a high security office space will contained in either EMT or RGS conduit.
4. All conduit, pull boxes, and junction boxes shall be clearly marked every with colored permanent tape or paint that will allow it to be distinguished from all other conduit and infrastructure.
5. Conduit fills shall not exceed 50 percent unless otherwise documented.
6. A pull rope shall be pulled along with signal and power cables to assist in future work.
7. At all locations where core drilling is conducted to allow for conduit to be installed, then fire stopping shall be applied to that area.
8. High power and signal cables shall not share the same conduit and shall be kept separate up to the point of connection. High power for the security system shall be defined as any cable or sets of cables carrying 30 VDC/VAC or higher.
9. Signal Cables:
 - a. Shall meet or exceed all specifications and requirements called out by the manufactures.
 - b. Shall be twisted pairs.
 - c. All cables and conductors, except fiber optic cables, that act as a control, communication, or signal lines shall include surge protection. Surge protection shall be furnished at the equipment end and additional triple electrode gas surge protectors rated for the application on each wire line circuit shall be installed within 3 feet, (1 meter) of the building cable entrance. The inputs and outputs shall be tested in both normal and common mode using the following wave forms:
 - 1) A 10 microsecond rise time by 1000 microsecond pulse width waveform with a peak voltage of 1500 volts and peak current of 60 amperes.

- 2) An 8 microsecond rise time by 20 microsecond pulse width wave form with a peak voltage of 1000 volts and peak current of 500 amperes.

10. Power Cables:

- a. Shall be rated for either 110 or 220 VAC, 50 or 60 Hz, and shall comply with VA Master Spec 26 05 21 Low Voltage Electrical Power Conductors and Cables (600 Volts and Below).
- b. Shall be sized according and comply with the NEC. High voltage power cables will be a minimum of three conductors, 14 AWG, stranded, and coated with a non-conductive polyvinylchloride (PVC) jacket.
- c. Low Voltage Power Cables:
 - 1) All cables shall be a minimum of 18 AWG, Stranded and have a polyvinylchloride outer jacket.
 - 2) Specific cable size shall determined using a basic voltage over distance calculation and shall comply with the NEC's requirements for low voltage cables.
- d. All equipment connected to AC power shall be protected from surges. Equipment protection shall withstand surge test waveforms described in IEEE C62.41. Fuses shall not be used as a means of surge protection.

2.3 INSTALLATION KIT

- A. General: The kit shall be provided that at, a minimum includes all connectors and terminals, labeling systems, audio spade lugs, barrier strips, punch blocks or wire wrap terminals, heat shrink tubing, cable ties, solder, hangers, clamps, bolts, conduit, cable duct, and/or cable tray, etc., required to accomplish a neat and secure installation. All wires shall terminate in a spade lug and barrier strip, wire wrap terminal or punch block. Unfinished or unlabeled wire connections shall not be allowed. All unused and partially opened installation kit boxes, coaxial, fiber-optic, and twisted pair cable reels, conduit, cable tray, and/or cable duct bundles, wire rolls, physical installation hardware shall be turned over to the Contracting Officer. The following sections outlined are the minimum required installation sub-kits:

1. System Grounding:

- a. The grounding kit shall include all cable and installation hardware required. All head end equipment and power supplies

shall be connected to earth ground via internal building wiring, according to the NEC.

b. This includes, but is not limited to:

- 1) Coaxial Cable Shields
- 2) Control Cable Shields
- 3) Data Cable Shields
- 4) Equipment Racks
- 5) Equipment Cabinets
- 6) Conduits
- 7) Cable Duct blocks
- 8) Cable Trays
- 9) Power Panels
- 10) Grounding
- 11) Connector Panels

2. Coaxial Cable: The coaxial cable kit shall include all coaxial connectors, cable tying straps, heat shrink tabbing, hangers, clamps, etc., required to accomplish a neat and secure installation.
3. Wire and Cable: The wire and cable kit shall include all connectors and terminals, audio spade lugs, barrier straps, punch blocks, wire wrap strips, heat shrink tubing, tie wraps, solder, hangers, clamps, labels etc., required to accomplish a neat and orderly installation.
4. Conduit, Cable Duct, and Cable Tray: The kit shall include all conduit, duct, trays, junction boxes, back boxes, cover plates, feed through nipples, hangers, clamps, other hardware required to accomplish a neat and secure conduit, cable duct, and/or cable tray installation in accordance with the NEC and this document.
5. Equipment Interface: The equipment kit shall include any item or quantity of equipment, cable, mounting hardware and materials needed to interface the systems with the identified sub-system(s) according to the OEM requirements and this document.
6. Labels: The labeling kit shall include any item or quantity of labels, tools, stencils, and materials needed to label each subsystem according to the OEM requirements, as-installed drawings, and this document.
7. Documentation: The documentation kit shall include any item or quantity of items, computer discs, as installed drawings, equipment, maintenance, and operation manuals, and OEM materials needed to

provide the system documentation as required by this document and explained herein.

PART 3

3.1 INSTALLATION

- A. System installation shall be in accordance with UL 294, manufacturer and related documents and references, for each type of security subsystem designed, engineered and installed.
- B. Components shall be configured with appropriate "service points" to pinpoint system trouble in less than 30 minutes.
- C. The Contractor shall install all system components including Government furnished equipment, and appurtenances in accordance with the manufacturer's instructions, documentation listed in Sections 1.4 and 1.5 of this document, and shall furnish all necessary connectors, terminators, interconnections, services, and adjustments required for a operable system.
- D. The PACS will be designed, engineered, installed, and tested to ensure all components are fully compatible as a system and can be integrated with all associated security subsystems, whether the system is a stand alone or a network.
- E. For integration purposes, the PACS shall be integrated where appropriate with the following associated security subsystems:
 - 1. CCTV:
 - a. Provide 24 hour coverage of all entry points to the perimeter and agency buildings. As well as all emergency exits utilizing a fixed color camera.
 - b. Be able to monitor, control and record cameras on a 24 hours basis.
 - c. Be programmed automatically call up a camera when an access point is but into an alarm state.
 - d. For additional PACS system requirements as they relate to the CCTV, refer to Section 28 23 00, VIDEO SURVEILLANCE.
 - 2. IDS:
 - a. Be able monitor door control sensors.
 - b. Be able to monitor and control the IDS on a 24 hours basis.
 - c. Be programmed to go into an alarm state when an IDS device is put into an alarm state, and notify the operator via an audible alarm.

- d. For additional PACS system requirements as they relate to the IDS, refer to Section 28 16 11, INTRUSION DETECTION SYSTEM.
- 3. Security Access Detection:
 - a. Be able to monitor all objects that have been screened with an x-ray machine and be able to monitor all data acquired by the bomb detection unit.
 - b. For additional PACS system requirements as they relate to the Security Access Detection, refer to Section 28 13 53, SECURITY ACCESS DETECTION.
- 4. EPPS:
 - a. Be programmed to go into an alarm state when an emergency call box or duress alarm/panic device is activated, and notify the Access Control System and Database Management of an alarm event.
 - b. For additional PACS requirements as they relate to the EPPS, refer to Section 28 26 00, ELECTRONIC PERSONAL PROTECTION SYSTEM.
- E. Integration with these security subsystems shall be achieved by computer programming or the direct hardwiring of the systems.
- F. For programming purposes refer to the manufacturers requirements for correct system operations. Ensure computers being utilized for system integration meet or exceed the minimum system requirements outlined on the systems software packages.
- G. The Contractor shall visit the site and verify that site conditions are in agreement with the design package. The Contractor shall report all changes to the site or conditions that will affect performance of the system. The Contractor shall not take any corrective action without written permission from the Government.
- H. The Contractor shall visit the site and verify that site conditions are in agreement/compliance with the design package. The Contractor shall report all changes to the site or conditions that will affect performance of the system to the Contracting Officer's Technical Representative (COTR) in the form of a report. The Contractor shall not take any corrective action without written permission received from the COTR.
- I. Existing Equipment:
 - 1. The Contractor shall connect to and utilize existing door equipment, control signal transmission lines, and devices as outlined in the design package. Door equipment and signal lines that are usable in

their original configuration without modification may be reused with COTR approval.

2. The Contractor shall perform a field survey, including testing and inspection of all existing door equipment and signal lines intended to be incorporated into the PACS, and furnish a report to the Contracting Officer as part of the site survey report. For those items considered nonfunctioning, provide (with the report) specification sheets, or written functional requirements to support the findings and the estimated cost to correct the deficiency. As part of the report, the Contractor shall include a schedule for connection to all existing equipment.
 3. The Contractor shall make written requests and obtain approval prior to disconnecting any signal lines and equipment, and creating equipment downtime. Such work shall proceed only after receiving Contracting Officer approval of these requests. If any device fails after the Contractor has commenced work on that device, signal or control line, the Contractor shall diagnose the failure and perform any necessary corrections to the equipment.
 4. The Contractor shall be held responsible for repair costs due to Contractor negligence, abuse, or improper installation of equipment.
 5. The COTR shall be provided a full list of all equipment that is to be removed or replaced by the Contractor, to include description and serial/manufacturer numbers where possible. The Contractor shall dispose of all equipment that has been removed or replaced based upon approval of the COTR after reviewing the equipment removal list. In all areas where equipment is removed or replaced the Contractor shall repair those areas to match the current existing conditions.
- J. Enclosure Penetrations: All enclosure penetrations shall be from the bottom of the enclosure unless the system design requires penetrations from other directions. Penetrations of interior enclosures involving transitions of conduit from interior to exterior, and all penetrations on exterior enclosures shall be sealed with rubber silicone sealant to preclude the entry of water and will comply with VA Master Specification 07 84 00, Firestopping. The conduit riser shall terminate in a hot-dipped galvanized metal cable terminator. The terminator shall be filled with an approved sealant as recommended by the cable manufacturer and in such a manner that the cable is not damaged.

- K. Cold Galvanizing: All field welds and brazing on factory galvanized boxes, enclosures, and conduits shall be coated with a cold galvanized paint containing at least 95 percent zinc by weight.
- L. Control Panels:
1. Connect power and signal lines to the controller.
 2. Program the panel as outlined by the design and per the manufacturer's programming guidelines.
- M. SMS:
1. Coordinate with the VA agency's IT personnel to place the computer on the local LAN or Intranet and provide the security system protection levels required to insure only authorized VA personnel have access to the system.
 2. Program and set-up the SMS to ensure it is in fully operation.
- N. Card Readers:
1. Connect all signal inputs and outputs as shown and specified.
 2. Terminate input signals as required.
 3. Program and address the reader as per the design package.
 4. Readers shall be surface or flushed mounted and all appropriate hardware shall be provided to ensure the unit is installed in an enclosed conduit system.
- O. Portal Control Devices:
1. Install all signal input and output cables as well as all power cables.
 2. Devices shall be surface or flush mounted as per the design package.
 3. Program all devices and ensure they are working.
- P. Door Status Indicators:
1. Install all signal input and output cables as well as all power cables.
 2. RTE's shall be surface mounted and angled in a manner that they cannot be compromised from the non-secure side of a windowed door, or allow for easy release of the locking device from a distance no greater than 6 feet from the base of the door.
 3. Door position sensors shall be surface or flush mounted and wide gap with the ability to operate at a maximum distance of up to 2" (5 cm).
- Q. Entry Control Devices:
1. Install all signal input and power cables.
 2. Strikes and bolts shall be mounted within the door frame.

3. Mortise locks shall be mounted within the door and an electric transfer hinge shall be utilized to transfer the wire from within the door frame to the mortise lock inside the door.
 4. Electromagnetic locks shall be installed with the mag-lock mounted to the door frame and the metal plate mounted to the door.
- R. System Start-Up:
1. The Contractor shall not apply power to the PACS until the following items have been completed:
 - a. PACS equipment items and have been set up in accordance with manufacturer's instructions.
 - b. A visual inspection of the PACS has been conducted to ensure that defective equipment items have not been installed and that there are no loose connections.
 - c. System wiring has been tested and verified as correctly connected as indicated.
 - d. All system grounding and transient protection systems have been verified as installed and connected as indicated.
 - e. Power supplies to be connected to the PACS have been verified as the correct voltage, phasing, and frequency as indicated.
 2. Satisfaction of the above requirements shall not relieve the Contractor of responsibility for incorrect installation, defective equipment items, or collateral damage as a result of Contractor work efforts.
- S. Supplemental Contractor Quality Control:
1. The Contractor shall provide the services of technical representatives who are familiar with all components and installation procedures of the installed PACS; and are approved by the COTR.
 2. The Contractor will be present on the job site during the preparatory and initial phases of quality control to provide technical assistance.
 3. The Contractor shall also be available on an as needed basis to provide assistance with follow-up phases of quality control.
 4. The Contractor shall participate in the testing and validation of the system and shall provide certification that the system installed is fully operational as all construction document requirements have been fulfilled.

3.2 TESTING AND TRAINING

All testing and training shall be compliant with the VA General Requirements, Section 01 00 00, GENERAL REQUIREMENTS.

-----END-----

SECTION 28 13 16
ACCESS CONTROL SYSTEM AND DATABASE MANAGEMENT

PART 1 - GENERAL

1.1 DESCRIPTION

Provide and install a complete Access Control System and Database Management as specified in this section.

1.2 RELATED WORK

- A. For firestopping application and use, Section 07 84 00, FIRESTOPPING.
- B. For all signage and labeling applications and use, Section 10 14 00, SIGNAGE.
- C. For power connections and cables, Section 26 05 21, LOW VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES (600 VOLTS AND BELOW).
- D. For grounding of equipment, Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS.
- E. For infrastructure, Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS.
- F. For infrastructure, Section 26 05 36, CABLE TRAYS FOR ELECTRICAL SYSTEMS.
- G. For perimeter lighting, Section 26 56 00, EXTERIOR LIGHTING.
- H. For access control, Section 28 13 11, PHYSICAL ACCESS CONTROL SYSTEM (PACS).
- I. For screening of personnel and shipments, Section 28 13 53, SECURITY ACCESS DETECTION.
- J. For alarm systems, Section 28 16 11, INTRUSION DETECTION SYSTEM (IDS).
- K. For security cameras, Section 28 23 00, VIDEO SURVEILLANCE.
- L. For emergency and interior communications, Section 28 26 00, ELECTRONIC PERSONAL PROTECTION SYSTEM (EPPS).
- M. For Warranty of Construction see GENERAL CONDITIONS.
- N. For General Requirements, Section 01 00 00, GENERAL REQUIREMENTS.

1.3 QUALITY ASSURANCE

- A. The Contractor shall be responsible for providing, installing, and the operation of the Access Control System and Database Management as shown. The Contractor shall also provide certification as required.
- B. The security system shall be installed and tested to ensure all components are fully compatible as a system and can be integrated with all associated security subsystems, whether the security system is stand-alone or a part of a Information Technology (IT) computer network.

- C. The Contractor or security sub-contractor shall be a licensed security Contractor as required within the state or jurisdiction of where the installation work is being conducted.

1.4 SUBMITTALS

- A. Submit below items in conjunction with Master Specification Sections 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES, and Section 02 41 00, DEMOLITION.
- B. Provide certificates of compliance with Section 1.3, Quality Assurance.
- C. Provide a pre-installation and as-built design package in both electronic format and on paper, minimum size 48 x 48 inches (1220 x 1220 millimeters); drawing submittals shall be per the established project schedule.
- D. Pre-installation design and as-built packages shall include, but not be limited to:
 - 1. Index Sheet that shall:
 - a. Define each page of the design package to include facility name, building name, floor, and sheet number.
 - b. Provide a list of all security abbreviations and symbols.
 - c. Reference all general notes that are utilized within the design package.
 - d. Specification and scope of work pages for all security systems that are applicable to the design package that will:
 - 1) Outline all general and job specific work required within the design package.
 - 2) Provide a device identification table outlining device Identification (ID) and use for all security systems equipment utilized in the design package.
 - 2. Drawing sheets that will be plotted on the individual floor plans or site plans shall:
 - a. Include a title block as defined above.
 - b. Define the drawings scale in both standard and metric measurements.
 - c. Provide device identification and location.
 - d. Address all signal and power conduit runs and sizes that are associated with the design of the electronic security system and other security elements (e.g., barriers, etc.).
 - e. Identify all pull box and conduit locations, sizes, and fill capacities.

- f. Address all general and drawing specific notes for a particular drawing sheet.
- 3. A riser drawing for each applicable security subsystem shall:
 - a. Indicate the sequence of operation.
 - b. Relationship of integrated components on one diagram.
 - c. Include the number, size, identification, and maximum lengths of interconnecting wires.
 - d. Wire/cable types shall be defined by a wire and cable schedule. The schedule shall utilize a lettering system that will correspond to the wire/cable it represents (example: A = 18 AWG/1 Pair Twisted, Unshielded). This schedule shall also provide the manufacturer's name and part number for the wire/cable being installed.
- 4. A system drawing for each applicable security system shall:
 - a. Identify how all equipment within the system, from main panel to device, shall be laid out and connected.
 - b. Provide full detail of all system components wiring from point-to-point.
 - c. Identify wire types utilized for connection, interconnection with associate security subsystems.
 - d. Show device locations that correspond to the floor plans.
 - e. All general and drawing specific notes shall be included with the system drawings.
- 5. A schedule for all of the applicable security subsystems shall be included. All schedules shall provide the following information:
 - a. Device ID.
 - b. Device Location (e.g. site, building, floor, room number, location, and description).
 - c. Mounting type (e.g. flush, wall, surface, etc.).
 - d. Power supply or circuit breaker and power panel number.
 - e. In addition, for the CCTV Systems, provide the camera ID, camera type (e.g. fixed or pan/tilt/zoom (P/T/Z), lens type (e.g. for fixed cameras only) and housing model number.
- 6. Detail and elevation drawings for all devices that define how they were installed and mounted.
- E. Pre-installation design packages shall be reviewed by the Contractor along with a VA representative to ensure all work has been completed.

All reviews shall be conducted in accordance with the project schedule. There shall be four (4) stages to the review process:

1. 35 percent
 2. 65 percent
 3. 90 percent
 4. 100 percent
- F. Provide manufacturer security system product cut-sheets. Submit for approval at least 30 days prior to commencement of formal testing, a Security System Operational Test Plan. Include procedures for operational testing of each component and security subsystem, to include performance of an integrated system test.
- G. Submit manufacture's certification of Underwriters Laboratories, Inc. (UL) listing as specified. Provide all maintenance and operating manuals per Section 01 00 00, GENERAL REQUIREMENTS.

1.5 APPLICABLE PUBLICATIONS

- A. The publications listed below (including amendments, addenda, revisions, supplement, and errata) form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American National Standards Institute (ANSI)/Electronic Industries Alliance (EIA):
- 310D.....Racks, Panels, and Associated Equipment
- C. National Electrical Manufacturers Association (NEMA):
- 250-03.....Enclosures for Electrical Equipment
- D. National Fire Protection Association (NFPA):
- 70-05.....Article 780-National Electrical Code
- E. Underwriters Laboratories, Inc. (UL):
- 752-05.....Ballistic Level Protection (Class III)
- 827-96.....Central Station Alarm Services
- 1981-03.....Central Station Automation System
- F. Uniform Federal Accessibility Standards (UFAS) 1984
- G. Americans with Disabilities Act (ADA) 1975
- ADA Standards for Accessible Design 1994

1.6 WARRANTY OF CONSTRUCTION.

Warrant CCTV System work subject to the Article "Warranty of Construction" of FAR clause 52.246-21.

PART 2 - PRODUCTS**2.1 EQUIPMENT AND MATERIALS**

- A. All equipment associated within the Access Control System and Database Management shall be UL 827 and UL 1981 compliant and rated for continuous operation. Environmental conditions (i.e. temperature, humidity, wind, and seismic activity) shall be taken under consideration at each facility and site location prior to installation of the equipment.
- B. All equipment shall operate on a 120 or 240 volts alternating current (VAC); 50 Hz or 60 Hz AC power system unless documented otherwise in subsequent sections listed within this specification. All equipment shall have a back-up source of power that will provide a minimum of 96 hours of run time in the event of a loss of primary power to the facility.
- C. The system shall be designed, installed, and programmed in a manner that will allow for easy of operation, programming, servicing, maintenance, testing, and upgrading of the system.
- D. All equipment and materials for the system will be compatible to ensure correct operation.

2.2 EQUIPMENT ITEMS

- A. The Access Control System and Database Management shall be set up as a Security System Network (SSN).
- B. A SSN shall provide full interface with all components of the security subsystem as follows:
 - 1. Shall allow for communication between the Access Control System and Database Management and all subordinate work and monitoring stations, enrollment centers for badging and biometric devices as part of the PACS, local annunciation centers, the electronic Security Management System (SMS), and all other VA redundant or backup command center or other workstations locations.
 - 2. Shall provide automatic continuous communication with all systems that are monitored by the Access Control System and Database Management, and shall automatically annunciate any communication failures or system alarms to the Access Control System and Database Management operator providing identification of the system, nature of the alarm, and location of the alarm.
 - 3. Controlling devices shall be utilized to interface the Access Control System and Database Management with all field devices.

4. The Access Control System and Database Management and security console will be supported by an uninterrupted power supply (UPS) or dedicated backup generator power circuit.
5. The Access Control System and Database Management shall house the following equipment i.e. refer to individual master specifications for each security subsystem's specific requirements:
 - a. Security Console Bays and Equipment Racks
 - b. Security Network Server and Workstation
 - c. CCTV Monitoring, Controlling, and Recording Equipment
 - d. PACS Monitoring and Controlling Equipment
 - e. IDS Monitoring and Controlling Equipment
 - f. Security Access Detection Monitoring Equipment
 - g. EPPS Monitoring and Controlling Equipment
 - h. Main Panels for all Security Systems
 - i. Power Supply Units (PSU) for all field devices
 - j. Life safety and power monitoring equipment
 - k. All other building systems deemed necessary by the VA to include, but not limited to, heating, ventilation and air conditioning (HVAC), elevator control, portable radio, fire alarm monitoring, and other potential systems.
- C. Security Console Bays. Shall be EIA 310D compliant and:
 1. Utilize stand-up, sit-down, and vertical equipment racks in any combination to monitor and control the security subsystems.
 2. Shall be wide enough for equipment that requires a minimum 19 inch (47.5 cm) mounting area.
 3. Shall be made of metal, furnished with wire ways, a power strip, a thermostatic controlled bottom or top mounted fan units, a hinge mounted rear door, a hinge mounted front door made of plexiglass, and a louvered top. When possible, pre-fabricated (standard off-the-shelf) security console equipment shall be used in place of customized designed consoles.
 4. A wire management system shall be designed and installed so that all cables are mounted in a manner that they do not interfere with day-to-day operations, are labeled for quick identification, and so that high voltage power cables do not cause signal interference with low voltage and data carrying cables.
 5. Shall be mounted on lockable casters.

6. Shall be ergonomically designed so that all devices requiring repetitive interaction with by the operator can be easily accessed, observed, and accomplished.
7. Controls and displays shall be located so that they are not obscured during normal operation. Control and display units installed with a work bench shall be a minimum of 3 in. (7.5 cm) from all edges of the work bench area.
8. All security subsystem controls shall be installed within the same operating console bay of their associated equipment.
9. Video monitors shall be mounted above all controls within a console bay and positioned in a manner that minimum strain is placed on the operator viewing them at the console.
10. At least one workbench for every three (3) console bays shall be provided free of control equipment to allow for appropriate operator workspace.
11. All console devices shall be labeled and marked with a minimum of quarter inch bold print.
12. All non-security related equipment that is required to be monitored shall be installed in a console bay separate from the security subsystem equipment and clearing be identified as such.
13. Console bays and related equipment shall be arranged in priority order and sequenced based upon their pre-defined security subsystem operations criticality established by the Contracting Officer.
14. The following minimum console technical characteristics shall be taken into consideration when designing for and installing the security console and equipment racks:

	Stand-Up	Sit-Down	Vertical Equipment Rack
Workstation Height	No Greater than 84 in. (210 cm)	No greater than 72 in. (150 cm)	No greater than 96 in. (240 cm)
Bench board Slope	21 in. (52.5 cm)	25 in. (62.5 cm)	N/A
Bench board Angle	15 degrees	15 degrees	N/A

Depth of Console	24 in. (60 cm)	24 in. (60 cm)	N/A
Leg and Feet Clearance	6 sq. ft. from center of Console Slope front	6 sq. ft. from center of Console Slope front	6 sq. ft. from center of Console Slope front
Distance Between Console Rows	96 in. (240 cm)	96 in. (240 cm)	96 in. (240 cm)
Distance Between Console and Wall	36 in. (90 cm) from the rear and/or side of console or rack	36 in. (90 cm) from the rear and/or side of console or rack	36 in. (90 cm) from the rear and/or side of console or rack

D. Access Control System and Database Management and Security Console Configuration:

1. The size shall be defined by the number of console bays required to house and operate the security subsystems, as well as any other factors that may influence the overall design of the space. A small Access Control System and Database Management shall contain no more than four (4) security console bays. A large Access Control System and Database Management shall contain no less than five (5) and no more than eight (8) security console bays.
2. Shall meet the following minimum spacing requirements to ensure that a Access Control System and Database Management is provided to house existing and future security subsystems and other equipment listed in paragraph 2.3.C:
 - a. 500 square feet for a large Access Control System and Database Management.
 - b. 300 square feet for a small Access Control System and Database Management.
 - c. If office, training room and conference space, is a processing area as well as holding cell space is to be located adjacent to

the Access Control System and Database Management, these space requirements also need to be considered.

3. Shall be located in an area within, at a minimum, the first level/line of security defense defined by the VA. If the Access Control System and Database Management is to be located outside the first level of security, then the area shall be constructed or retrofit to meet or exceed those requirements outlined in associated VA Master Specifications.
4. Shall not be located within or near an area with little to no blast mitigation standoff space protection, adjacent to an outside wall exposed to vehicle parking and traffic, within a basement or potential flood zone area, in close approximately to major utility areas, or near an exposed air intake(s).
5. Access shall meet UFAS and ADA accessibility requirements.
6. Construction shall be slab to slab and free of windows, with the exception of a service window. All penetrations into the room shall be sealed with fire stopping materials. This material shall apply in accordance with Section 07 84 00, FIRESTOPPING.
7. A service window shall be installed in the wall next to the main entrance of the Access Control System and Database Management or where it best can be monitored and accessed by the security console operator. The window shall meet all requirements set forth in UL 752, to include at a minimum, Class III ballistic level protection. The windows shall be set in a minimum of four (4) inches (100 mm) solid concrete units to ceiling height with either masonry or gypsum wall board to the underside of the slab above. It shall also contain a service tray constructed in a manner that only objects no larger than 3 inches (7.5 cm) in width may pass through it.
8. The walls making up or surrounding the Access Control System and Database Management shall be made of materials that at a minimum offer Class III ballistic level protection for the security console operator(s).
9. There will be a main power cut-off button/switch located inside the Access Control System and Database Management in the event of an electrical fire or related event occurs.
10. Shall have a fire alarm detection unit that is tied into the main building fire alarm system and have at least two fire extinguishers located within it.

11. Shall utilize a fire suppression system similar to that used by the VA's computer and telecommunications room operating areas.
 12. The floor shall be raised a minimum of 4 inches (10 cm) from the concrete floor base. Wire ways shall be utilized under the raised floor for separation of signal and power wires and cables.
 13. Access shall be monitored and controlled by the PACS via card reader and fixed camera that utilizes a 2.8mm lens. A 1 in. (2.5 cm) deadbolt shall be utilized as a mechanical override for the door in the event of electrical failure of the PACS, card reader, or locking mechanism.
 14. There shall only be one point of ingress and egress to and from the Access Control System and Database Management. The door shall be made of solid core wood or better. If a window is required for the door, then the window shall be ballistic resistant with a Millar covering.
 15. A two-way intercom shall be placed at the point of entry into the Access Control System and Database Management for access-communication control purposes.
 16. A remote push-button door unlocking device shall not be installed for the electronic PACS locking mechanism providing access control into the Access Control System and Database Management.
 17. All controlling equipment and power supplies that must be wall mounted shall be mounted in a manner that maximizes usability of the Access Control System and Database Management wall space. All equipment shall be mounted to three quarter inch fire retardant plywood. The plywood shall be fastened to the wall from slab to slab and fixed to the existing walls supports.
- E. Access Control System and Database Management Room Ventilation
1. Shall meet or exceed all requirements laid out in VA Master Specification listed in Division 23, HEATING, VENTILATION, AND AIR CONDITIONING.
 2. Controls shall be via a separate air handling system that provides an isolated supply and return system. The Access Control System and Database Management shall have a dedicated thermostat control unit and cut-off switch to be able to shut off ventilation to the control room in the event of a chemical, biological, or radiological (CBR) event or other related emergency.

3. There shall be a louver installed in the control room door to assist with ventilation of the room. The louver shall be exactly 12 x 12 inches (30 x 30 cm) and closeable.

F. Control Room Lighting:

1. The following factors shall taken into consideration for lighting of the Access Control System and Database Management and console area:
 - a. Shadows: To reduce eye strain and fatigue, shadows shall be avoided.
 - b. Glare: The readability of all display panels, labels, and equipment shall not be interfered with or create visibility problems.
2. The following table shall provide guidance on the amount of footcandles required per work area and type of task performed:

Work Area/Type of Task		Footcandles
Main Operating Panels		50
Secondary Display Panels		50
Seated Workstations		100
Reading	Handwriting	100
	Typed Documents	50
	Visual Display Units	10
Logbook Recording		100
Maintenance Area		50
Emergency/Back-up Lighting		10

G. Remote/Secondary Access Control System and Database Management's: For facilities that have a remote, secondary back-up control console or workstation shall apply the following requirements:

1. The secondary stations shall the requirements outlined in Sections 2.2.A-G.
2. Installation of an intercom station or telephone line shall be installed and provide direct one touch call-up for communications between the primary Access Control System and Database Management and secondary Access Control System and Database Management.

3. Secondary stations shall not have priority over a primary Access Control System and Database Management.
 4. The primary Access Control System and Database Management shall have the ability to shut off power and a signal to a secondary control station in the event the area has been compromised.
- H. Wires and Cables:
1. Shall meet or exceed the manufactures recommendation for power and signals.
 2. Shall be carried in an enclosed conduit system, utilizing electromagnetic tubing (EMT) to include the equivalent in flexible metal, rigid galvanized steel (RGS) to include the equivalent of liquid tight, polyvinylchloride (PVC) schedule 40 or 80.
 3. All conduits will be sized and installed per the NEC. All security system signal and power cables that traverse or originate in a high security office space will contained in either EMT or RGS conduit.
 4. All conduit, pull boxes, and junction boxes shall be marked with colored permanent tape or paint that will allow it to be distinguished from all other infrastructure conduit.
 5. Conduit fills shall not exceed 50 percent unless otherwise documented.
 6. A pull string shall be pulled along and provided with signal and power cables to assist in future installations.
 7. At all locations where there is a wall penetration or core drilling is conducted to allow for conduit to be installed, fire stopping materials shall be applied to that area.
 8. High voltage and signal cables shall not share the same conduit and shall be kept separate up to the point of connection. High voltage for the security subsystems shall be any cable or sets of cables carrying 30 VDC/VAC or higher.
 9. For all equipment that is carrying digital data between the Access Control System and Database Management or at a remote monitoring station, it shall not be less that 20 AWG and stranded copper wire for each conductor. The cable or each individual conductor within the cable shall have a shield that provides 100% coverage. Cables with a single overall shield shall have a tinned copper shield drain wire.
 10. All cables and conductors, except fiber optic cables, that act as a control, communication, or signal lines shall include surge

protection. Surge protection shall be furnished at the equipment end and additional triple electrode gas surge protectors rated for the application on each wire line circuit shall be installed within three (3) ft. (one (1) m.) of the building cable entrance. The inputs and outputs shall be tested in both normal and common mode using the following wave forms:

- a. A 10 microsecond rise time by 1000 microsecond pulse width waveform with a peak voltage of 1500 watts and peak current of 60 amperes.
- b. An 8 microsecond rise time by 20 microsecond pulse width waveform with a peak voltage of 1000 volts and peak current of 500 amperes.

- 11. The surge suppression device shall not attenuate or reduce the video or sync signal under normal conditions. Fuses and relays shall not be used as a means of surge protection.

2.3 INSTALLATION KIT

A. General:

- 1. The kit shall be provided that, at a minimum, includes all connectors and terminals, labeling systems, audio spade lugs, barrier strips, punch blocks or wire wrap terminals, heat shrink tubing, cable ties, solder, hangers, clamps, bolts, conduit, cable duct, and/or cable tray, etc., required to accomplish a neat and secure installation. All wires shall terminate in a spade lug and barrier strip, wire wrap terminal or punch block. Unfinished or unlabeled wire connections shall not be allowed. All unused and partially opened installation kit boxes, coaxial, fiber-optic, and twisted pair cable reels, conduit, cable tray, and/or cable duct bundles, wire rolls, physical installation hardware shall be turned over to the Contracting Officer. The following sections outline the minimum required installation sub-kits to be used:

2. System Grounding:

- a. The grounding kit shall include all cable and installation hardware required. All head end equipment and power supplies shall be connected to earth ground via internal building wiring, according to the NEC.
- b. This includes, but is not limited to:
 - 1) Coaxial Cable Shields
 - 2) Control Cable Shields

- 3) Data Cable Shields
 - 4) Equipment Racks
 - 5) Equipment Cabinets
 - 6) Conduits
 - 7) Cable Duct blocks
 - 8) Cable Trays
 - 9) Power Panels
 - 10) Grounding
 - 11) Connector Panels
3. Coaxial Cable: The coaxial cable kit shall include all coaxial connectors, cable tying straps, heat shrink tabbing, hangers, clamps, etc., required to accomplish a neat and secure installation.
 4. Wire and Cable: The wire and cable kit shall include all connectors and terminals, audio spade lugs, barrier straps, punch blocks, wire wrap strips, heat shrink tubing, tie wraps, solder, hangers, clamps, labels etc., required to accomplish a neat and orderly installation.
 5. Conduit, Cable Duct, and Cable Tray: The kit shall include all conduit, duct, trays, junction boxes, back boxes, cover plates, feed through nipples, hangers, clamps, other hardware required to accomplish a neat and secure conduit, cable duct, and/or cable tray installation in accordance with the NEC and this document.
 6. Equipment Interface: The equipment kit shall include any item or quantity of equipment, cable, mounting hardware and materials needed to interface the systems with the identified sub-system(s) according to the OEM requirements and this document.
 7. Labels: The labeling kit shall include any item or quantity of labels, tools, stencils, and materials needed to label each subsystem according to the OEM requirements, as-installed drawings, and this document.
 8. Documentation: The documentation kit shall include any item or quantity of items, computer discs, as installed drawings, equipment, maintenance, and operation manuals, and OEM materials needed to provide the system documentation as required by this document and explained herein.

PART 3**3.1 INSTALLATION**

- A. System installation shall be in accordance with manufacturer and related documents and references, for each type of security subsystem designed, engineered and installed.
- B. All equipment shall be installed per the design package and the manufacturer's installation specifications.
- C. The Access Control System and Database Management will be designed, engineered, installed, and tested to ensure all components are fully compatible as a system and can be integrated with all associated security subsystems, whether the system is a stand alone or a network.
- D. For integration purposes, the Access Control System and Database Management shall operate and control the following associated security subsystems:
 - 1. The Access Control System and Database Management shall be the central point of monitoring, controlling, programming, and recording all security subsystems utilizing the Electronic Security Management System (SMS).
 - 2. The SMS shall utilize a central computer station that is capable of being connected to the VA's Local Area Network (LAN) or Internet.
- E. Integration with security subsystems shall be achieved by computer programming and the direct hardwiring of the systems. Determination of methodology should be addressed and outlined in advance with the Contracting Officer prior to the system(s) is/are being designed and engineered.
- F. For programming purposes, the Contractor shall refer to the manufacturer's requirements for correct system operations. Ensure computers being utilized for system integration meet or exceed the minimum system requirements outlined on the systems software packages.
- G. The Contractor shall visit the site and verify that site conditions are in agreement with the design package. The Contractor shall report all changes to the site or conditions that will affect performance of the security subsystems. The Contractor shall not take any corrective action without written permission from the Contracting Officer.
- H. System Startup:
 - 1. The Contractor shall not apply power to the Access Control System and Database Management or security console until the following items have been completed:

- a. Access Control System and Database Management equipment items and have been set up in accordance with manufacturer's instructions.
 - b. A visual inspection of the Access Control System and Database Management has been conducted to ensure that defective equipment items have not been installed and that there are no loose connections.
 - c. System wiring has been tested and verified as correctly connected as indicated.
 - d. All system grounding and transient protection systems have been verified as installed and connected as indicated.
 - e. Power to be connected to all systems has been verified as the correct voltage, phasing, and frequency as indicated.
2. Satisfaction of the above requirements shall not relieve the Contractor of responsibility for incorrect installations, defective equipment items, or collateral damage as a result of Contractor work/equipment installation efforts.
- I. Supplemental Contractor Quality Control:
1. The following requirements supplement the contractor quality control requirements specified elsewhere in the contract:
- a. The Contractor shall provide the services of technical representatives who are familiar with all components and installation procedures of the installed Access Control System and Database Management and security console; and are approved by the Contracting Officer in advance.
 - b. The Contractor representatives will be present on the job site during the preparatory and initial phases of quality control to provide technical assistance.
 - c. The Contractor representatives shall also be available on an as needed basis to provide assistance with follow-up phases of quality control.
 - d. The Contractor technical representatives shall participate in the testing and validation of the system and shall provide certification that their respective system portions meet its contractual requirements.

3.2 TESTING AND TRAINING

All testing and training shall be compliant with the VA General Requirements, Section 01 00 00, GENERAL REQUIREMENTS.

-----END-----

SECTION 28 13 53
SECURITY ACCESS DETECTION

PART 1 - GENERAL

1.1 DESCRIPTION

Provide and install a complete Detection and Screening System, hereinafter referred to as the Security Access Detection as specified in this section.

1.2 RELATED WORK

- A. For firestopping application and use, Section 07 84 00, FIRESTOPPING.
- B. For labeling and signs, Section 10 14 00, SIGNAGE.
- C. For connection of high voltage, Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
- D. For power cables, Section 26 05 21, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES (600 VOLTS AND BELOW).
- E. For grounding of equipment, Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS.
- F. For infrastructure, Section 26 05 33, RACEWAYS AND BOXES ELECTRICAL SYSTEMS.
- G. For perimeter lighting, Section 26 56 00, EXTERIOR LIGHTING.
- H. For access control, Section 28 13 11, PHYSICAL ACCESS CONTROL SYSTEM (PACS).
- I. For alarm systems, Section 28 16 11, INTRUSION DETECTION SYSTEM (IDS).
- J. For control and operation of all security systems, Section 28 13 16, ACCESS CONTROL SYSTEM AND DATABASE MANAGMENT.
- K. For security cameras, Section 28 23 00, VIDEO SURVEILLANCE.
- L. For emergency and interior communications, Section 28 26 00, ELECTRONIC PERSONAL PROTECTION SYSTEM (EPPS).
- M. For Warranty of Construction, see GENERAL CONDITIONS.
- N. For General Requirements, Section 01 00 00, GENERAL REQUIREMENTS.

1.3 QUALITY ASSURANCE

- A. The Contractor shall be responsible for providing, installing, and the operation of the Security Access Detection as shown. The Contractor shall also provide certification as required.
- B. The security system shall be installed and tested to ensure all components are fully compatible as a system and can be integrated with all associated security subsystems, whether the security system is stand-alone or a part of a complete Information Technology (IT) computer network.

- C. The Contractor or security sub-contractor shall be a licensed security Contractor as required within the state or jurisdiction of where the installation work is being conducted.

1.4 SUBMITTALS

- A. Submit below items in conjunction with Master Specification Sections 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES, and Section 02 41 00, DEMOLITION.
- B. Provide certificates of compliance with Section 1.3, Quality Assurance.
- C. Provide a complete and thorough pre-installation and as-built design package in both electronic format and on paper, minimum size 48 x 48 inches (in.) (1220 x 1220 millimeters)(mm); drawing submittals shall be per the established project schedule.
- D. Pre-installation design and as-built packages shall include, but not be limited to:
 - 1. Index Sheet that shall:
 - a. Clearly define each page of the design package to include facility name, building name, floor, and sheet number.
 - b. Provide a complete list of all security abbreviations and symbols.
 - c. Reference all general notes that are utilized within the design package.
 - d. Specification and scope of work pages for all individual security systems that are applicable to the design package that will:
 - 1) Outline all general and job specific work required within the design package.
 - 2) Provide a detailed device identification table outlining device Identification (ID) and use for all security systems equipment utilized in the design package.
 - 2. Drawing sheets that will be plotted on the individual floor plans or site plans shall:
 - a. Include a title block as defined above.
 - b. Clearly define the drawings scale in both standard and metric measurements.
 - c. Provide device identification and location.
 - d. Address all signal and power conduit runs and sizes that are associated with the design of the electronic security system and other security elements.

- e. Identify all pull box and conduit locations, sizes, and fill capacities.
 - f. Address all general and drawing specific notes for a particular drawing sheet.
3. A detailed riser drawing for each applicable security subsystem shall:
- a. Indicate the sequence of operation.
 - b. Relationship of integrated components on one (1) diagram.
 - c. Include the number, size, identification, and maximum lengths of interconnecting wires.
 - d. Wire/cable types shall be defined by a wire and cable schedule. The schedule shall utilize a lettering system that will correspond to the wire/cable it represents (example: A = 18 AWG/1 Pair Twisted, Unshielded). This schedule shall also provide the manufacturer's name and part number for the wire/cable being installed.
4. A detailed system drawing for each applicable security system shall:
- a. Clearly identify how all equipment within the system, from main panel to device, shall be laid out and connected.
 - b. Provide full detail of all system components wiring from point-to-point.
 - c. Identify wire types utilized for connection, interconnection with associate security subsystems.
 - d. Show device locations that correspond to the floor plans.
 - e. All general and drawing specific notes shall be included with the system drawings.
5. A detailed schedule for all of the applicable security subsystems shall be included. All schedules shall provide the following information:
- a. Device ID.
 - b. Device Location (e.g. site, building, floor, room number, location, and description).
 - c. Mounting type (e.g. flush, wall, surface, etc.).
 - d. Power supply or circuit breaker and power panel number.
 - e. In addition, provide the Security Access Detection detector or screening device ID, type (e.g. walk-through screener, X-ray, explosive detector, etc.), type of technology used by system for detection and model number.

6. Provide detail and elevation drawings for all devices that define how they were installed and mounted.
- D. The pre-installation design packages shall go through a full review process conducted by the Contractor along with a VA representative to ensure all work has been clearly defined and completed. All reviews shall be conducted in accordance with the project schedule. There shall be four (4) stages to the review process:
 1. 35 percent
 2. 65 percent
 3. 90 percent
 4. 100 percent
- E. The Contractor shall provide manufacturer security system product cut-sheets that clearly and completely indicate the description and function of each component of the security systems they are associated with. Also, indicate all termination points of devices and interconnections required for operation of the system, and between modules and devices.
- F. The Contractor shall submit for approval at least 30 days prior to commencement of formal testing, a Security System Operational Test Plan. Include detailed procedures for operational testing of each component and security subsystem, to include performance of an integrated system test.
- G. The Contractor shall submit manufacture's certification of Underwriters Laboratories, Inc. (UL) listing for all security system devices, power sources, control panels, and monitoring equipment.
- H. The Contractor shall provide complete maintenance and operating manuals from the manufacturer that support as-builts and system design, to include all technical product sheets and overall system schematics. Two (2) weeks prior to the final inspection, four (4) copies of the maintenance and operating manuals also need to be submitted to the RE.
- I. Certifications: Two (2) weeks prior to final inspection, submit four (4) copies of the following to the RE:
 1. Complete maintenance and operating manuals from the manufacturer that support as-built and systems design, to include all technical data sheets and overall system schematics.
 2. Certification by the Contractor that the materials submitted is in accordance with the drawings and specifications.

3. Certification by the Contractor that a complete security system installation has been installed, tested and adjusted.

1.5 APPLICABLE PUBLICATIONS

- A. The publications listed below (including amendments, addenda, revisions, supplement, and errata) form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American Society for Testing and Materials (ASTM)
C1238-97 (R03).....Standard Guide for Installation of Walk-Through Metal Detectors
- C. Department of Justice American Disability Act (ADA)
28 CFR Part 36-90.....ADA Standards for Accessible Design
- D. Government Accountability Office (GAO):
GAO-03-8-02.....Security Responsibilities for Federally Owned and Leased Facilities
- E. Institute of Electrical and Electronics Engineers (IEEE):
C95.1-05.....Standards for Safety Levels with Respect to Human Exposure in Radio Frequency Electromagnetic Fields
- F. National Fire Protection Association (NFPA):
70-05..... Article 780-National Electrical Code
- G. National Institute of Justice (NIJ)
0601.02-03.....Standards for Walk-Through Metal Detectors for use in Weapons Detection
0602.02-03.....Hand-Held Metal Detectors for Use in Concealed Weapon and Contraband Detection
- H. National Electrical Manufacturers Association (NEMA)
250-03.....Enclosures for Electrical Equipment (1000 Volts Maximum)
- I. Occupational and Safety Health Administration (OSHA):
29 CFR 1910.97.....Radiation Protection Guide
- J. Security Industry Association (SIA):
AG-01.....Security CAD Symbols Standards
- K. Underwriters Laboratories, Inc. (UL):
187-98.....Standard for X-ray Equipment
464-03.....Audible Signal Appliances
- L. United States Department of Commerce:

Special Pub 500-101Care and Handling of Computer Magnetic Storage
Media

M. Uniform Federal Accessibility Standards (UFAS), 1984

N. Architectural Barriers Act (ABA), 1968

1.6 WARRANTY OF CONSTRUCTION.

Warrant Security Access Detection work subject to the Article "Warranty of Construction" of FAR clause 52.246-21.

PART 2 - PRODUCTS

2.1 EQUIPMENT AND MATERIALS

- A. All equipment shall operate on a 240 volts alternating current (VAC); or 60 Hz alternating current (AC) power system unless documented otherwise in subsequent sections listed within this spec. All equipment shall have a battery back-up source of power that will provide 12 hours (hrs.) of run time in the event of a loss of primary power to Security Access Detection systems until a backup generator comes on-line.
- B. Walk-through metal detectors and X-ray machines shall meet the National Institute of Justice (NIJ) Standards and Safety requirements.
- C. The Security Access Detection shall be designed, installed, and programmed in a manner that will allow for easy of operation, programming, servicing, maintenance, testing, and upgrading of the system.
- D. All Security Access Detection components located in designated "HAZARDOUS ENVIRONMENT" areas where fire or explosion could occur due to the presence of natural gases or vapors, flammable liquids, combustibile residue, or ignitable fibers or debris, shall be rated Class II, Division I, Group F, and installed in accordance with NFPA 70, Chapter 5.
- E. All Security Access Detection equipment and materials provided shall be new, first grade, standard, current products of the manufacturer and shall be suitable for the systems being installed and the intent of the design.
- F. All Security Access Detection equipment and materials shall be stored, adequately protected and carefully handled to prevent damage before and during installation and according to manufacture's instructions.
- G. All Security Access Detection equipment provided with a factory finish shall be maintained free of dust, dirt and foreign matter. Dents, marred finishes and other damage shall be repaired to its original condition or shall be replaced, at no additional cost to the Owner.

- H. The Contractor shall provide the RE with written verification, that the type of wire/cable being provided is recommended and approved by the OEM. Cabling shall meet the interconnecting wiring requirements of NFPA 70 (NEC). The Contractor is responsible for providing the correct protection cable duct and/or conduit and wiring.
- I. The Contractor is responsible for interfacing Security Access Detection with other security subsystems. The Contractor shall utilize interfacing methods that are approved by the OEM and RE. At a minimum, an acceptable interfacing method requires not only a physical and mechanical connection; but also a matching of signal, voltage, and processing levels with regard to signal quality and impedance. The interface point must adhere to all standards described herein.
- J. The characteristics listed in this section will serve as a guide in selection of equipment and materials for the Security Access Detection. If updated or more suitable versions are available then the RE will approve the acceptance of prior to an installation.
- K. If any obsolete, incompatible, or damaged equipment is offered by the Contractor at the time of installation, then the equipment will be returned and replaced with equipment at no cost to the government.

2.2 EQUIPMENT ITEMS

A. General

- 1. All specifications listed within this section are the minimum requirements to be met to ensure a working Security Access Detection is in place.
- 2. Detection Sensor subsystems shall consist of sensors capable of:
 - a. Locating and identifying prohibited, threatening, contraband materials and items the system is designed to detect and protect against being brought into a facility.
 - b. Sensors shall be adjustable to maximize capabilities based on environmental and security requirement changes.
- 3. Annunciation: Shall contain one (1) or more indicator lamps, alphanumeric displays that provide status information about a circuit or condition of the operating units. Walk-Through or conveyer pass through units must provide a uniform two-digit error code to identify different types of system failures.
- 4. Audible Signal Device: Shall consist of audible sound for alarms, supervisory, and trouble signals and shall be distinctive.

5. **Assessment:** Shall consist of electronic devices required to visually and audibly verify the validity and functionality of Security Access Detection. Assessment also includes providing indication of tampering, fail-safe, low battery, and power losses.
 6. **Alarm Reporting:** Shall consist of electronic devices to annunciate Security Access Detection information to at least two (2) separate locations. The alarms shall maintain the capability to respond with local and remote visible and audible signals upon activation of detection sensors. The alarms should have the capability of a silent mode only alerting personnel using the system.
 7. **Power Supply:** Security Access Detection shall be capable of continuous operation and include a battery backup module capable of 12 hrs. of backup use. All non-portable systems shall operate on 100-240 VAC. Hand-Held Security Access Detection (Metal and Explosive Detectors) shall have the capability to operate on rechargeable batteries.
- H. **Walk-Through Metal Detectors:**
1. Shall meet NIJ Standard 0601.02 and be able to detect and locate guns, knives, and other flat and rod-shaped objects regardless of orientation.
 2. All electronics shall be modular in design for easy plug-in and replacement. The Detector shall use multiple coil circuits with dual alarm lights to indicate which side of the individual the detected item is located.
 3. Shall be capable of self-diagnostics and conduct self-test of all systems to automatically identify failures or problems with components as displayed on the control unit liquid crystal display (LCD). The detection unit shall not require re-calibration each time the system is turned off and back on.
 4. Shall provide for full body coverage: coverage on the left, center, right, front, and back of the body from head to floor, providing uniform detection.
 5. Shall include individual zones that are adjustable for customization of detection characteristics and/or compensation for metallic environmental challenges.
 6. Shall have the capability to detect and discriminate signals from two (2) or more detectable items located in close proximity that may be detected as only one (1).

7. Shall include adjustable legs to provide for accurate leveling on uneven floors.
8. Major components include:
 - a. Walk-through portal/passage way
 - b. Control Unit
 - c. Test Unit
9. Technical Characteristics:

Operating Temperatures	-4°F (-20°C) to 158°F (70°C) 95% humidity non-condensing
Power Supply Unit	Fully automatic input 100 to 240 VAC 50 or 60 Hz - five (5) watts Uninterrupted Power supply (UPS) Battery Backup (12 hours)
Construction	Minimum 3/32 in. (2.381mm) aluminum in strength and weather resistant
Opening Sizes	Interior Width: 30 in. (762mm) Interior Height: 80 in. (2.032 meters)
Programmable	Capable of 16 independent programs settings for zones and sensitivity
Sensitivity Boost	Three (3) levels at ankle level
Detection Sensors	Multi-dimensional coil 33 distinct pin-point zones - customizable
Sensitivity Levels	200
Interference Protection	Faraday shielding
Alarms	Audible and light-emitting diode (LED) Visual
Testing Device	Simulate size, shape, and composition of threat objects meet FAA testing requirements
Traffic Flow Indicators	LED Lights
Infrared Sensor	Traffic control and counter

9. Control Unit: Shall consist of the components to constantly monitor, input settings, and verify inputs of sensors.
 - a. The control unit is to be attached to the exit side of the scanner or shall be able to be detached and operational from up to 50 feet (ft.) (15.24 meters) (m) from detector.
 - b. The control unit will consist of a multiple functional electronic digital keypad/touchpad. The keypad/touchpad requires human/machine interface (HMI) with numerical or function keys

that can activate, deactivate, observe or change sensitivity and detector settings using secure codes.

- c. The Control Unit shall be programmed to be self-prompting for input.
- d. The LCD display shall be large, easily seen, backlit with alpha-numeric display that reports in words to regulate, control and provide self-prompt functions of the control unit.
- e. Control Unit Technical Characteristics:

Display	LCD
Connection to Unit	Wired with extension of 50 ft. (15.24m) for remote use
Touchpad Controls	Operate, Off, Counter, Volume, +/-, Program and Access
Displays	LED bar-graphs for detection sensitivity Alarm lights Functionality Program in operation Errors Traffic Count Alarm activations Alarm Percentages
Tamper alarm	10 seconds after access of touchpad
Access Control	Dual-level access codes for: Operators Supervisors

10. Control Unit Interface:

- a. The system shall include an interface module for network transmission of data and remote monitoring of system at the Access Control System and Database Management.
- b. Integration with the Access Control System and Database Management shall allow for control, real time monitoring and diagnostics capabilities.
- c. Control Unit Interface Technical Characteristics:

Display	LCD (laptop or Desktop Monitor)
Connection	10-Base T Network
System Capabilities	Monitor up to 4 scanners
Capabilities	Change settings LED bar-graph display Functionality Program in operation Errors

	Traffic Count Alarm activations Alarm Percentages Technician trouble-shoot
Access Control	Dual-level access codes Operators Supervisory

I. Hand-Held Metal Detectors:

1. Shall meet NIJ Standard 0602.02 and be rugged in design and water-proof; lightweight to reduce stress of handling; and provide ease of freedom of movement and control.
2. Shall be easily made operational with a one (1) switch operation that does not require any adjustments.
3. Technical Characteristics:

Operating Temperatures	-35°F (-37°C) to 158°F (70°C) 95% humidity non-condensing
Operating Frequency	93 kHz
Audio Frequency	2kHz Warble Earphone capable
Tuning	Automatic
Controls	Power switch On/Off Interference Elimination
LED Alert Lights	Power On, Battery Low, Alarm
Indicators	Silent/Vibrate Audible Speaker LED Alert Lights
Power	Standard 9 volt and Nickel-Metal Hydride (NiMH) rechargeable battery
Battery life	60 hours continuous operations
Minimum Detection Capability Distances	Medium Pistol - 9 in. (228.6mm) Large Knife- 5 in. (127mm) Razor Blade- 3 in. (76.2mm) Small foil and jewelry - 1 in.

2. Desktop:

- a. Shall have a built-in networking and communication capability.
The device shall easily interface with other screening systems and printer if it is not part of the unit.
- b. Shall be self-contained, self-cleaning, self-calibrating, and require no external gas supply.
- c. A touch screen display shall be provided that displays both alarm and compound identification information Red flashing light on unit and audible alarm Automatic "Print on Alarm" option.

d. Contractor shall provide collection device for input of data.

e. Technical Characteristics:

Power	90 to 265 volts alternating current (VAC) 50-60 Hz
Technology	Dual- gas chromatography and Ion mobility spectrometer
Power Consumption	Less than 500 watts
Device Controls	Touch screen display Power switch
Operating Modes	Continuous and Single Cycle
Warm up time	< 20 minutes (cold start)
Memory	Store a minimum of 1000 previous readings
Detection	Dual vapor and particulate
Analysis Time	< 20 seconds
Detection Capabilities	Nanogram levels of: 1) Explosives: PETN, RDX, TNT, NG, Dynamite, Semtex, C4 2) Narcotics: Cocaine, Opiates (heroin & morphine), Cannabis marijuana & hashish), Amphetamine-type stimulants amphetamine, ecstasy & methamphetamine.

2.3 INSTALLATION KIT

A. A kit shall be provided and used, that at a minimum, includes all labeling systems, wire wrap terminals, cable ties, bolts, etc., required to accomplish a neat and secure installation. Unfinished or unlabeled wire connections shall not be allowed. All unused and partially opened installation kit boxes physical installation hardware shall be turned over to the Contracting Officer. The following sections outline the minimum required installation sub-kits to be used:

1. System grounding shall include all cable and installation hardware required. All equipment shall be connected to earth ground via internal building wiring, according to the NEC.
2. Equipment Interface: The equipment kit shall include any item or quantity of equipment, cable, mounting hardware and materials needed to interface the systems with other security subsystems, as required.
3. The labeling kit shall include any item or quantity of labels, tools, stencils, and materials needed to completely and correctly

label each subsystem according to the OEM requirements, as depicted on installation drawings, and referenced in this document.

- B. Documentation: The documentation kit shall include any item or quantity of items, computer discs, as installed drawings, equipment, maintenance, and operation manuals, and OEM materials needed to completely and correctly provide the system documentation as required and outlined in this document.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. System installation shall be in accordance with appropriate NEC, UL, NFPA, Related Work VA specifications, and appropriate installation manual for each type of Security Access Detection.
- B. The Security Access Detection system will be designed, engineered, installed, and tested to ensure all components are fully compatible as a system and can be integrated with all associated security subsystems, whether the system is a stand alone or a complete network.
- C. Components shall be configured with appropriate "service points" to pinpoint system trouble in less than 30 minutes.
- D. All Security Access Detection requiring VAC connection will be installed with surge protection and Uninterrupted Power Supply (UPS).
- E. Architectural space planning design requirements need to be considered and defined prior to the installation of metal detection, x-ray and explosive detection equipment at main lobby entrance or other security control points. This also applies to the use of x-ray and explosive detectors in mail and shipping/receiving facility areas.
- F. The Contractor shall install all system components including Government furnished equipment, and appurtenances in accordance with the manufacturer's instructions, documentation listed in Sections 1.4 and 1.5 of this document, and shall furnish all necessary connectors, terminators, interconnections, services, and adjustments required for a complete and operable system.
- G. Walk-through metal detectors will not be located on floors with high metal content that may interfere with screening without protection between the floor and detector being considered.
- H. The Contractor shall provide walk-through metal detectors with the capability for floor mounting (OEM recommended brackets) to increase stability.

- I. Cleaning: Subsequent to installation, clean each system component of dust, dirt, grease, or oil incurred during installation in accordance to manufacture instructions.
- J. Adjustment/Alignment/Synchronization: Contractor shall prepare for system activation by following manufacturer's recommended procedures for adjustment, alignment, programming, or synchronization. Prepare each component in accordance with appropriate provisions of the component's installation, operations, and maintenance instructions.
- K. For integration purposes, the Security Access Detection system shall be integrated with the Access Control System and Database Management via CAT-V cables and where appropriate with CCTV and EPPS. The CCTV Security System will:
 - 1. Provide full coverage of all lobby entrance screening areas utilizing a fixed color camera.
 - 2. Record activity on a 24 hours basis.
 - 3. The CCTV system should have facial recognition software to assist in identifying individuals for current and future purposes.
 - 4. For additional CCTV system requirements as they relate to the Security Access Detection, refer to Section 28 13 53, SECURITY ACCESS DETECTION.
- L. Integration with CCTV and EPPS security subsystems shall be achieved by computer programming or the direct hardwiring of the systems.
- M. For programming purposes, refer to the manufacturers requirements for correct system operations. Ensure computer hardware being utilized for system integration meets or exceeds the minimum system requirements as well as systems software requirements.
- N. The Contractor shall visit the site and verify that site conditions are in agreement/compliance with the design package. The Contractor shall report all changes to the site or conditions that will affect performance of the system to the Contracting Officer in the form of a report. The Contractor shall not take any corrective action without written permission received from the Contracting Officer.
- O. Existing Equipment
 - 1. The Contractor shall connect to and utilize existing equipment, and control signal transmission lines, and devices as outlined in the design package. Equipment and signal lines that are usable in their original configuration without modification may be reused with Contracting Officer approval.

2. The Contractor shall perform a field survey, including testing and inspection of all existing equipment, power outlets, and signal lines intended to be used by the Security Access Detection, and furnish a report to the Contracting Officer as part of the site survey report. For those items considered nonfunctioning, provide (with the report) specification sheets, or written functional requirements to support the findings and the estimated cost to correct the deficiency. As part of the report, the Contractor shall include a schedule for connection to all existing equipment.
 3. The Contractor shall make written requests and obtain approval prior to disconnecting any signal lines and equipment, and creating equipment downtime. Such work shall proceed only after receiving Contracting Officer approval of these requests. If any device fails after the Contractor has commenced work on that device, signal or control line, the Contractor shall diagnose the failure and perform any necessary corrections to the equipment.
 4. The Contractor shall be held responsible for repair costs due to Contractor negligence, abuse, or improper installation of equipment.
 5. The Contracting Officer shall provide a full list of all equipment that is to be removed or replaced by the Contractor. The Contractor shall dispose of all equipment that has been removed or replaced. In all areas where equipment is removed or replaced the Contractor shall repair those areas to match the current existing conditions.
- P. System Start-Up
1. The Contractor shall not apply power to any installed Security Access Detection until the following items have been completed:
 - a. Security Access Detection equipment items have been set up in accordance with manufacturer's instructions.
 - b. A visual inspection of the Security Access Detection system has been conducted to ensure that defective equipment items have not been installed and that there are no loose connections.
 - c. System wiring has been tested and verified as correctly connected as indicated.
 - d. All system grounding and transient protection systems have been verified as installed and connected as indicated.
 - e. Power supplies to be connected to the Security Access Detection system have been verified as the correct voltage, phasing, and frequency as indicated by the manufacturer.

2. Satisfaction of the above requirements shall not relieve the Contractor of responsibility for incorrect installation, defective equipment items, or collateral damage as a result of Contractor work efforts.
- Q. Supplemental Contractor Quality Control: The following requirements supplement the Contractor quality control requirements specified elsewhere in the contract:
1. The Contractor shall provide the services of technical representatives who are familiar with all components and installation procedures of any installed Security Access Detection; and are approved by the Contracting Officer.
 2. The Contractor will be present on the job site during the preparatory and initial phases of quality control to provide technical assistance.
 3. The Contractor shall also be available on an as needed basis to provide assistance with follow-up phases of quality control.
 4. The Contractor shall participate in the testing and validation of the system and shall provide certification that the system installed is fully operational as all construction document requirements have been fulfilled.

3.2 TESTING AND TRAINING

All testing and training shall be compliant with the VA General Requirements, Section 01 00 00, GENERAL REQUIREMENTS.

-----END-----

SECTION 28 16 11
INTRUSION DETECTION SYSTEM

PART 1 - GENERAL

1.1 DESCRIPTION

Provide and install a complete Intrusion Detection System, hereinafter referred to as IDS, as specified in this section.

1.2 RELATED WORK

- A. For firestopping application and use, Section 07 84 00, FIRESTOPPING.
- B. For door installation, Section 08 11 73, SLIDING METAL FIRE DOORS.
- C. For door and gate installation, Section 08 34 59, VAULT DOORS AND DAY GATES.
- D. For door installation, Section 08 35 13.13, ACCORDING FOLDING DOORS.
- E. For window installation, Section 08 51 13, ALUMINUM WINDOWS.
- F. For door installation, Section 08 71 00, DOOR HARDWARE.
- G. For electrical installation, Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
- H. For power cables, Section 26 05 21, LOW VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES (600 VOLTS AND BELOW).
- I. For grounding of equipment, Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS.
- J. For infrastructure, Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS.
- K. For underground installation of wiring, Section 26 05 41, UNDERGROUND ELECTRICAL CONSTRUCTION.
- L. For access control integration, Section 28 13 11, PHYSICAL ACCESS CONTROL SYSTEMS (PACS).
- M. For screening of personnel and shipments, Section 28 13 53, SECURITY ACCESS DETECTION.
- N. For security cameras, Section 28 23 00, VIDEO SURVEILLANCE.
- O. For control and operation of all security systems, Section 28 13 16, ACCESS CONTROL SYSTEM AND DATABASE MANAGEMENT.
- P. For emergency and interior communications, Section 28 26 00, ELECTRONIC PERSONAL PROTECTION SYSTEM (EPPS).
- Q. For Warranty Construction, see GENERAL CONDITIONS.
- R. For General Requirements, Section 01 00 00, GENERAL REQUIREMENTS.

1.3 QUALITY ASSURANCE

- A. The Contractor shall be responsible for providing, installing, and the operation of the IDS as shown. The Contractor shall also provide certification as required.
- B. The security system shall be installed and tested to ensure all components are fully compatible as a system and can be integrated with all associated security subsystems, whether the security system is stand-alone or a part of a complete Information Technology (IT) computer network.
- C. The Contractor or security sub-contractor shall be a licensed security Contractor as required within the state or jurisdiction of where the installation work is being conducted.

1.4 SUBMITTALS

- A. Submit below items in conjunction with Master Specification Sections 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES, and Section 02 41 00, DEMOLITION.
- B. Provide certificates of compliance with Section 1.3, Quality Assurance.
- C. Provide a pre-installation and as-built design package in both electronic format and on paper, minimum size 48 x 48 inches (1220 x 1220 millimeters); drawing submittals shall be per the established project schedule.
- D. Pre-installation design and as-built packages shall include, but not be limited to:
 - 1. Index Sheet that shall:
 - a. Define each page of the design package to include facility name, building name, floor, and sheet number.
 - b. Provide a list of all security abbreviations and symbols.
 - c. Reference all general notes that are utilized within the design package.
 - d. Specification and scope of work pages for all security systems that are applicable to the design package that will:
 - 1) Outline all general and job specific work required within the design package.
 - 2) Provide a device identification table outlining device Identification (ID) and use for all security systems equipment utilized in the design package.
 - 2. Drawing sheets that will be plotted on the individual floor plans or site plans shall:

- a. Include a title block as defined above.
 - b. Define the drawings scale in both standard and metric measurements.
 - c. Provide device identification and location.
 - d. Address all signal and power conduit runs and sizes that are associated with the design of the electronic security system and other security elements (e.g., barriers, etc.).
 - e. Identify all pull box and conduit locations, sizes, and fill capacities.
 - f. Address all general and drawing specific notes for a particular drawing sheet.
3. A riser drawing for each applicable security subsystem shall:
- a. Indicate the sequence of operation.
 - b. Relationship of integrated components on one diagram.
 - c. Include the number, size, identification, and maximum lengths of interconnecting wires.
 - d. Wire/cable types shall be defined by a wire and cable schedule. The schedule shall utilize a lettering system that will correspond to the wire/cable it represents (example: A = 18 AWG/1 Pair Twisted, Unshielded). This schedule shall also provide the manufacturer's name and part number for the wire/cable being installed.
4. A system drawing for each applicable security system shall:
- a. Identify how all equipment within the system, from main panel to device, shall be laid out and connected.
 - b. Provide full detail of all system components wiring from point-to-point.
 - c. Identify wire types utilized for connection, interconnection with associate security subsystems.
 - d. Show device locations that correspond to the floor plans.
 - e. All general and drawing specific notes shall be included with the system drawings.
5. A schedule for all of the applicable security subsystems shall be included. All schedules shall provide the following information:
- a. Device ID.
 - b. Device Location (e.g. site, building, floor, room number, location, and description).
 - c. Mounting type (e.g. flush, wall, surface, etc.).

- d. Power supply or circuit breaker and power panel number.
- e. In addition, for the IDS, provide the sensor ID, sensor type and housing model number.
- 6. Detail and elevation drawings for all devices that define how they were installed and mounted.
- E. Pre-installation design packages shall be reviewed by the Contractor along with a VA representative to ensure all work has been clearly defined and completed. All reviews shall be conducted in accordance with the project schedule. There shall be four (4) stages to the review process:
 - 1. 35 percent
 - 2. 65 percent
 - 3. 90 percent
 - 4. 100 percent
- F. Provide manufacturer security system product cut-sheets. Submit for approval at least 30 days prior to commencement of formal testing, a Security System Operational Test Plan. Include procedures for operational testing of each component and security subsystem, to include performance of an integrated system test.
- G. Submit manufacture's certification of Underwriters Laboratories, Inc. (UL) listing as specified. Provide all maintenance and operating manuals per the VA General Requirements, Section 01 00 00, GENERAL REQUIREMENTS.

1.5 APPLICABLE PUBLICATIONS

- A. The publications listed below (including amendments, addenda, revisions, supplement, and errata) form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American National Standards Institute (ANSI)/Security Industry Association (SIA):
 - PIR-01-00.....Passive Infrared Motion Detector Standard -
Features for Enhancing False Alarm Immunity
 - CP-01-00Control Panel Standard-Features for False Alarm
Reduction
- C. Department of Justice American Disability Act (ADA)
 - 28 CFR Part 36-90.....ADA Standards for Accessible Design
- D. National Electrical Manufacturers Association (NEMA):

- 250-03.....Enclosures for Electrical Equipment (1000 Volts
Maximum)
- E. National Fire Protection Association (NFPA):
 - 70-05.....National Electrical Code
 - 731-06.....Standards for the Installation of Electric
Premises Security Systems
- F. Underwriters Laboratories, Inc. (UL):
 - 464-03.....Audible Signal Appliances
 - 609-96.....Local Burglar Alarm Units and Systems
 - 634-00.....Standards for Connectors with Burglar-Alarm
Systems
 - 639-97.....Standards for Intrusion Detection Units
 - 1037-99.....Standard for Anti-theft Alarms and Devices
 - 1635-96.....Digital Alarm Communicator System Units
- G. Uniform Federal Accessibility Standards (UFAS), 1984

1.6 WARRANTY OF CONSTRUCTION.

Warrant IDS work subject to the Article "Warranty of Construction" of FAR 52.246-21.

PART 2 - PRODUCTS

2.1 EQUIPMENT AND MATERIALS

A. General

1. All equipment associated within the IDS shall be rated for continuous operation. Environmental conditions (i.e. temperature, humidity, wind, and seismic activity) shall be taken under consideration at each facility and site location prior to installation of the equipment.
2. All equipment shall operate on a 120 or 240 volts alternating current (VAC); 50 Hz or 60 Hz AC power system unless documented otherwise in subsequent sections listed within this specification. All equipment shall have a back-up source of power that will provide a minimum of 96 hours of run time in the event of a loss of primary power to the facility.
3. The system shall be designed, installed, and programmed in a manner that will allow for ease of operation, programming, servicing, maintenance, testing, and upgrading of the system.
4. All IDS components located in designated "HAZARDOUS ENVIRONMENT" areas where fire or explosion could occur due to the presence of natural gases or vapors, flammable liquids, combustible residue, or

ignitable fibers or debris, shall be rated Class II, Division I, Group F, and installed in accordance with National Fire Protection Association (NFPA) 70 National Electric Code, Chapter 5.

5. All equipment and materials for the system will be compatible to ensure functional operation in accordance with requirements.

2.2 EQUIPMENT ITEMS

A. General:

1. All requirements listed below are the minimum specifications that need to be met in order to comply with the IDS.
2. All IDS sensors shall conform to UL 639, Intrusion Detection Standard.
3. Ensure that IDS is fully integrated with other security subsystems as required to include, but not limited to, the CCTV, PACS, EPPS, and Access Control System and Database Management. The IDS provided shall not limit the expansion and growth capability to a single manufacturer and shall allow modular expansion with minimal equipment modifications.

B. IDS Components: The IDS shall consist of, but not be limited to, the following components:

1. Control Panel
2. Exterior Detection Devices (Sensors)
3. Interior Detection Devices (Sensors)
4. Power Supply
5. Enclosures

C. Control Panel:

1. The Control panel shall be the main point of programming, monitoring, accessing, securing, and troubleshooting the IDS. Refer to American National Standards Institute (ANSI) CP-01 Control Panel Standard-Features for False Alarm Reduction.
2. The Control Panel shall provide a means of reporting alarms to an Access Control System and Database Management via a computer interface or direct connection to an alarm control monitoring panel.
3. The Control panel shall utilize a Multifunctional Keypad, Input and Output Modules for expansion of alarm zones, interfacing with additional security subsystems, programming, monitoring and controlling the IDS.

4. The Control panel shall meet or exceed the following minimum functional requirements for programming outputs, system response, and user interface:

a. Programming Outputs:

- 1) 2 Amps (A) alarm power at 12 VDC
- 2) 1.4 A auxiliary power at 12 VDC
- 3) Four alarm output patterns
- 4) Programmable bell test
- 5) Programmable bell shut-off timer

b. System Response:

- 1) Selectable point response time
- 2) Cross point capability
- 3) Alarm verification
- 4) Watch mode
- 5) Scheduled events arm, disarm, bypass and un-bypass points, control relays, and control authority levels

c. User Interface:

- 1) Supervises up to eight command points (e.g. Up to 16 unsupervised keypads can be used)
- 2) Provides custom keypad text
- 3) Addresses full function command menu including custom functions
- 4) Allows user authority by defined area and 16-character name
- 5) Provides for 14 custom authority control levels allowing user's authority to change, add, delete pass codes, disarm, bypass points, and start system tests.

5. The Control panel shall meet or exceed the following technical characteristics:

Input Voltage via 110 VAC or 220 VAC Step-down Transformer	16 or 18 VAC
Operating Voltage	12 VDC
Output Voltage	12 VDC @ 2 A max
Direct Hardwire Zones	7
Partitions	8
Multifunctional Keypads	16 (2 per partition)

Communications Port	RJ-11
---------------------	-------

6. A multifunctional keypad shall be utilized as a user interface for arming, disarming, monitoring, troubleshooting, and programming the alarm control panel.
7. Keypads shall have the following features:
 - a. Multiple function keypads suitable for remote mounting, no greater than 4000 ft (1333 m), shall be provided from the control panel and have a light emitting diode (LED) readout of alarm and trouble conditions by zone.
 - b. An alphanumeric English language display, with keypad programmability, and EE-PROM memory, shall also be provided.
 - c. Trouble alarm indicators shall be distinguishable from intrusion alarms.
 - d. A minimum of four (4) zones selectable as entry and exit with programmable time delay.
 - e. Complete system test activated capability at the keypad.
 - f. Capability for opening and closing reports to a remote monitoring location.
 - g. Adjustable entry and exit delay times.
 - h. Capability for a minimum of two (2) multiple function keypads.
 - i. Capability to shunt or bypass selected interior zones while arming perimeter protection and remaining interior zones.
 - j. Capability for a minimum of seven assignable pass-codes that are keypad programmable from a suppressed master code.
8. Keypads shall meet or exceed the following technical characteristics:

Connections	4-wire flying lead for data and power
Operating Temperature	0°C to +50°C (+32°F to +122°F)
Display Window	8-point LED
Indicators: Illuminated keys	Armed Status-LED
	Point Status-LED
	Command Mode-LED
	Power-LED

Voltage	Nominal 12 VDC
---------	----------------

9. An input module shall be utilized to connect additional detection devices to the control panel. This module will meet or exceed the following technical characteristics:

Operating Voltage	8.5 to 14.5 VDC Nominal
Zone Inputs	Style A (Class B) Supervised
Operating Temperature	32 to 140 degrees F (0 to 40 degrees C)

10. An output module shall be utilized to interface the control panel with other security subsystems. The output module shall meet or exceed the following technical characteristics:

Operating Voltage	8.5 to 14.5 VDC Nominal
Output Relays	"Form C" Dry Relay Contracts
Relay Contact Rating	4A @ 24 VDC
	4A @ 24 VAC
	1A @ 70 VAC
Operating Temperature	32 to 140 degrees F (0 to 40 degrees C)

11. The control panel shall have a communications port that will allow for communications with a computer for programming, monitoring, and troubleshooting purposes. The communications port will be, at a minimum, and RJ-11 or better.
12. The control panel will have a systems success probability of 95% or better, and shall include the following success considerations:
- False Alarm: Shall not exceed one (1) false alarm per 30 days per sensor zone.
 - Nuisance Alarm: Shall not exceed a rate of one (1) alarm per seven (7) days per zone within the first 60 days after installation and acceptance. Sensor adjustments will be made and then shall not exceed one (1) alarm per 30 days.
13. The Control Panel will be able to detect either a line fault or power loss for all supervised data cables.

- a. Line Fault Detection: Communication links of the IDS shall have an active mode for line fault detection. Fault isolation at the systems level shall have the same geographic resolutions as provided for intrusion detection. The line fault alarm shall be clearly distinguishable from other alarms.
- b. Power Loss Detection: Provide the capability to detect when critical components experience temporary or permanent loss of power and annunciate to clearly identify the component experiencing power loss.

D. Exterior Detection Devices: (Sensors)

- 1. The IDS shall consist of interior, exterior, and other detection devices that are capable of:
 - a. Locating intrusions at individually protected asset areas or at an individual portal;
 - b. Locating intrusions within a specific area of coverage;
 - c. Locating failures or tampering of individual sensors or components.
- 2. Audible annunciation shall meet UL 464 Audible Signal Appliance requirements as well as other stated within this specification. IDS shall provide and adjust for devices so that coverage is maximized in the space or area it is installed in. For large areas where multiple devices are required, ensure exterior device coverage is overlapping.
- 3. Detection sensitivity shall be set up to ensure maximum coverage of the secure area is obtained while at the same time limiting excessive false alarms due to the environment and impact of small animals. All detection devices shall be anti-masking with exception of video motion detection.
- 4. Dual sensor technology shall be used when possible. Sensor technology shall not be of the same type that is easily defeated by a single method. This will reduce the amount of false alarms.
- 5. Exterior sensors described in this section are intended for outdoor use for perimeter and fence control monitoring purposes. Some sensors described in the interior sensor section may be utilized that can provide both outdoor and indoor protection.
- 6. External Sensors Environmental Characteristics:

Temperature	-25°F - 140°F (-32°C - 60°C)
-------------	------------------------------

Pressure	Sea Level to 15,000 ft. (4573m) above sea level
Solar Radiation	Six (6) hrs. exposure at dry bulb temp. 120°F (60°C)
Rain	Two (2) in. (50 mm) per hour
Humidity	5% - 95%
Fungus	Components of non-fungus nutrient materials
Salt/fog	Atmosphere 5% salinity
Snow loading	48 lbs per sq. ft. (234 kg per sq. meter)
Ice accumulation	Up to ½ in. (12.7 mm) radial ice
Wind limitations	50 mph (80 km/h) Gusts to 66 mph (106 km/h)
Acoustical Noise Suitability	> 110 decibels (dB)

7. Electromechanical Fence Sensors: Shall sense mechanical vibrations or motion associated with scaling, cutting, or attempting to lift standard security chain link fence as follows: Note: Dead zones shall not exist from a monitoring and alarm coverage perspective.
- The sensor zone control unit shall alarm when a sufficient number of sensing unit activations surface within a specified time period.
 - Individual sensing units and the alarm thresholds shall be field adjustable (i.e., performed by an authorized technician or trained maintenance personnel). Midrange sensitivity settings shall alarm a sensor when an intruder attempts to scale or climb the fence in areas of reduced sensitivity (e.g. around poles and rigid supports, etc.) and attempted lifting or scaling of a fence, including using assisted methods (e.g. items leaned against the fence, etc.) occur. Sensors shall allow gradual changes in fence positioning due to expansion, settling, and aging, without increased numbers of nuisance alarms taking place.
 - Exterior sensor components shall be housed in rugged, corrosion-resistant enclosures, protected from environmental impact and degradation.

d. Fence cable support hardware shall be weather-resistant.

Interfacing between sensor zones and alarm enunciators, require they be installed in underground conduit and cables.

e. Fencing Cable Technical Characteristics:

Input voltage	12-30 V DC
Current requirement	4 mA quiescent 25 mA (max) in alarm
Transient suppression	On data, power input lines and on relay output
Enclosure	Weatherproof
Sensor type	Inertial band-pass-filter
Transponder	4 zone controller Output relays for dry contacts, or RS-485 communication Inputs for weather sensor
Sensor spacing	8.2 to 9.9 ft. (2.5 to 3 m)
Data I/O	RS 485 communications
Data output	<ul style="list-style-type: none"> • Vibration alarm (in either line) • Line alarm (in either line) • End of line action • Wind situation • Weather sensor line failure • Enclosure tamper switch • Program fail • A dry contact output with end of line resistor per each of 4 vibration inputs

8. Strain-Sensitive Cable Sensors: These devices shall detect movement on a standard security chain link fence associated with an intruder scaling, cutting through, or attempting to lift the fence fabric.

The entire sensor system shall be mounted directly on the fence and able to withstand the same environmental condition exposures. Note: The length of the fence shall also maintain no sensor monitoring dead zones.

- a. Individual sensing units and the alarm threshold shall be field adjustable (i.e. by authorized technicians or trained maintenance personnel) for compensation of winds up to 25 mph (40 km/h) or by zone without increased nuisance alarms while maintaining specified sensor performance as under ambient conditions.
- b. Sensor zone control units shall provide an analog audio output for interface to an external audio amplifier to permit remote audio assessment regardless of sensor alarm status. The sensor zone control unit alarm output interface shall be a separately supervised relay contact normally open or normally closed.
- c. The length of the fence shall be divided into 300 ft. (100 m) zones.
- d. The sensing unit shall consist of transducer cable capable of achieving specified performance either by attachment directly to the fence fabric by plastic cable every 12 to 18 in. (300 to 455 mm) or by installation inside electrical metallic tubing conduit mounted on the fence.
- e. The sensing unit shall have equal adjustable sensitivity throughout the entire fence length. Only conventional waterproof coaxial cable connectors shall be used for connections of the sensing unit to avoid electrical magnetic interference.
- f. The entire sensor system shall be tamper resistant and capable of detecting tampering within each portion of the system by sensor zone.

g. Magnetic Sensor Cable Technical Characteristics:

Magnetic Sensor Cable	
Type cable	Four (4) conductor magnetically loaded, aluminum foil shield and ground wire
Maximum zone length	1000 ft. (300 m)
Life expectancy	10 years
Sensitivity	Uniform over length of cable
Audio Bandwidth	Five (5) kHz

Outer Cover	Black Polyurethane, Ultraviolet resistant
Insensitive Cable (remote processing)	
Type cable	2 twisted pair, individually sealed
Outer Cover	Black Polyurethane, Ultraviolet resistant
Dual Channel Signal Processor	
Input Power	10.2 - 13.8 VDC 65 mA
Alarm Output	Alarm contacts SPNC 0.75 mA, 200 VDC
Indicators	Three (3):Alarm, tamper, events
Cut processor	Sensitivity - 10 settings Time window - 0.5 - 4.5 min Event Counter - nine (9)
Climb processor	Sensitivity - 10 settings

9. Buried Electromagnetic Cable Sensor:

- a. The system shall be able to function as a standalone system or as an integral component of a centralized security control system.
- b. The detection field shall be formed by radio-frequency (RF) signals carried by sensor cables that are buried along the perimeter.
- c. The RF signals shall form an invisible electromagnetic detection field around the sensor cables that can detect the presence of an intruder passing through the field.
- d. The system shall detect moving intruders that have a significant electromagnetic field (e.g. humans, vehicles, and other large conductive objects) while rejecting other environmental stimuli such as birds, small animals, weather elements.
- e. A sensor module shall contain the electronics required to:
 - 1) Transmit and receive the RF signal without the use of an external antenna.
 - 2) Monitor the detection fields of two (2) zones and produce an alarm when an intruder enters the zones.

- f. Field power modules shall be available for standalone systems and networked systems.
- g. As a standalone system, the primary operator interface shall be a local interface module that is connected directly to the sensor module.
- h. As part of a network configuration, the primary operator interface shall be a personal computer (PC) based central controller. The central controller shall monitor the performance of the entire buried coaxial cable outdoor intrusion detection system and any auxiliary sensors. The central controller shall have the capability of acknowledging, processing and reporting alarms. A customized color site map that is displayed on the PC monitor shall be an available option for the system to monitor sensor locations.
- i. Transmission and reception shall be accomplished without the use of antennae. The RF signal shall be monitored and analyzed by the sensor module for any changes in the detection field properties that would indicate the presence of an intruder.
- j. Alarms generated by internal electronic processes (cables excluded) shall not exceed one (1) per zone per month. System generated alarms are averaged based on the total number of zones in the system.
- k. When the system is calibrated in accordance with the manufacturers' recommendations, the detection field shall be continuous and uniform over the protected site perimeter.
- l. When system sensitivity is calibrated according to manufacturers' recommendations, the detection field shall not detect a valid target that is a minimum of 6.5 ft. (2 m) from the nearest sensor cable.
- m. Buried Electromagnetic Cable Sensor Technical Characteristics:

Burial Medium	Clay, sand, soil, asphalt, concrete
Snow limitation	Up to 1 ft. (30cm) deep
Degradation Guaranty	Minimum 10 yr.
Detection Medium	Radio Frequency (RF)
Detection Coverage	Maximum 656 ft. (200m) per zone

Detection Capability	Human: >75 lbs. (34 kg)
Detection Speed	Human walk, crawl, run, roll, jump 1 in./sec. (2.5 cm/sec) - 50 ft./sec. (15 m/sec. regardless of direction across field)
Velocity Response	Programmable
Detection Probability	Human: 99% with 95% confidence factor Animal: Less than 22 lbs. (10 kg.) Less than 5% with 90% confidence factor
Terrain Detection Capabilities	Even to uneven ground with maximum (max) grade 13 ft. (4 m) Corner bend radius 22 ft. (6.5m)
Detection Field Cross Section	Upright walking; Height: 3.2 ft. (1m) above ground Width: 6.5 ft. (2m) single cable 9.75 ft. (3m) double cable
Sensing Element	Ported (leaky) coaxial cables
Cable Construction	Abrasion and chemical resistant, high density polyethylene, with flooding compound
Cable Requirements	Two (2):Transmit cable, receive cable
Configurations Available	Two (2):Single cable, double cable
Cable Lengths	164 ft. (50 m), 328 ft. (100 m), 492 ft. (150 m), 656 ft. (200 m)
Zone Length Minimum	33 ft. (10 m)
Antenna Requirements	None
False alarm rate	Less than one (1) per day

n. **Sensor Module:** Each sensor module shall transmit, receive and process the electromagnetic detection fields independently from other sensor modules. Failure of one (1) sensor module shall not affect the remainder of the perimeter. The sensor module shall operate as either a standalone unit, or in a network configuration in conjunction with a central controller. The sensor module shall be mounted in a weatherproof enclosure when installed outdoors as follows.

- 1) The sensor module shall use an adaptive filter to analyze the detection signal and adjust the signal processing to reduce nuisance alarms caused by environmental factors such as rainfall or slow-running water.
- 2) The sensor module shall identify, by type, sensor, tamper, and failure alarms either locally at the sensor module, or centrally at a central controller. The sensor cables shall provide the data paths between the sensor modules, for the transmission, reception and display of alarm conditions.
- 3) Each sensor module shall include an internal interface for the collection of auxiliary sensor data.
- 4) It shall be possible to supply power directly to each unit for applications that require either a single sensor module or multiple sensor modules with independent power sources.
- 5) The sensor module's response shall be demonstrated by an analog output signal that can be displayed on a voltmeter or on an analog voltage-recording device. The output signal shall be encoded to indicate the alarm trip-point, thereby showing the sensor module's degree of detection above or below the level required to cause an alarm.

6) **Sensor Module Technical Characteristics:**

Sensor Module Power Output	12 VDC at 150 milliampere (mA)
Sensor Module Power Requirements	Stand-alone: 12 VDC 500 mA max Network: 48 VDC 175 mA max
Sensor capability	Two (2) zones independent of other sensor modules
Sensor coverage	1,312 ft. (400 m)

Calibration	Locally and remotely from Central Controller
Self Test	Via 4 relay drive points
Detection coverage	Unlimited expansion using multiple modules
Nuisance avoidance	Adaptive filtering
Connectivity	RS-485 twisted pair cable
Sensor Support	Dual redundant data paths
Transmission capability	Eight (8) contact-closure signals

- o. The field power module shall be capable of supplying power to sensor modules as follows:
- 1) In a network configuration where power is supplied redundantly via the sensor cables, the sensor modules shall operate within specifications when power is removed from either of the two (2) sensor cables.
 - 2) Each cable zone shall be capable of being calibrated either locally at the sensor module, or remotely from a central controller. Additional signal processing parameters, including high speed and low speed response, shall be capable of being set from a central controller.
 - 3) Detection sensitivity for each zone shall be adjusted either locally at the sensor module with a local interface module, or from a central controller. Access to the local calibration controls shall require the removal of the enclosure's cover and shall cause a tamper alarm to be generated.
 - 4) Power Module Technical Characteristics:

Output support	Nine (9) sensor modules max 3,063 yards (yds.) (2,800 m)
System block configuration	1,531 yds. (1,400 m)
Power Output	Stand-alone: 12 VDC 500 mA max Network: 48 VDC 175 mA max

10. Microwave Sensors: The system shall be a modular microwave outdoor intrusion detection sensor based on microwave radar technology. The detection field shall be formed by radio frequency (RF) signals, in the X-band, carried between a transmitter and a receiver. The RF signals shall form an invisible electromagnetic detection field that can detect the presence of an intruder who walks, crawls, rolls, jumps, or runs through a detection field as follows.
- a. transmitter shall create the RF signals that form the detection field. A receiver shall house the necessary electronics to monitor the detection field and to raise an alarm when an intruder enters the field. The transmitter and receiver shall be powered individually, as a standalone unit.
 - b. An electromagnetic wave is emitted by the antenna of the transmitter and received by the antenna of the receiver. The receiver shall detect changes that are caused by the presence of an intruder.
 - c. The system shall detect moving intruders having a significant electromagnetic cross-section (e.g. humans, vehicles, and other large conductive objects) rejecting other environmental stimuli.
 - d. The system shall be capable of detecting human intruders moving through the detection field regardless of the direction of motion.
 - e. Processor description: The receiver shall contain the necessary electronics to perform the signal processing for the detection zone. The transmitter and receiver shall be operated as a standalone unit with independent power and data. Both the transmitter and receiver shall be installed in weatherproof enclosures.
 - f. Distributed processing: Transmitter-receiver pairs distributed along a perimeter shall provide extended range and fail-safe operation. The failure of one (1) pair shall not affect the coverage of the remainder of the perimeter.
 - g. Alarms: The signal processor shall identify intrusion and tamper/fail alarms locally, at the transmitter or receiver.
 - 1) An alarm caused by opening the outer enclosure of the transmitter or receiver shall be identified as a tamper alarm. Tamper alarms shall be distinctive from intrusion alarms.

- 2) Alarms caused by power failure or internal electronic failure are fail alarms, distinctive from intrusion alarms.

h. Microwave Sensor System Technical Characteristics:

Operating voltage Transmitter	11 - 15 VDC 70mA max. current
Operating voltage Receiver	11 - 15 VDC 30mA max. current
Operating Environment	-22F (-30°C) and 140 F (60°C)
LEDs	POWER ON, WRONG CHANNEL, ALARM
Maximum zone length	33 ft. (10 m) and a maximum of 1500 ft. (457 m) per zone.
Detection Success Probability	75 lbs. (34 kg) 99% with a 95% confidence factor
Operating frequency	X Band 10.525 \pm 0.025 gigahertz (GHz)
Type modulation	Class A2 with one (1) of six (6) selectable crystal-controlled frequencies.
Detection movement speed	2.0 in. sec. (5 cm/sec.) to 26 ft. sec. (8 m/sec.)
Audio assessment	Via 1/8 in. phone jack on receiver
Alarms	Tamper, failure, intrusion
Tamper/fail alarm	Via sealed relay rated one (1) ampere 28 VDC
Intrusion field alarm	Via sealed relay rated two (2) ampere 28 VDC.
Intrusion alarm latch time	Adjustable: 0.5 sec and 10 sec
Processing	Distributed: receiver/transmitter pairs
Perimeter Length	Single Receiver/transmitter pair: 1500 ft. (457 m) Multiple pairs: Unlimited

11. Taut-wire Sensors: These sensors shall consist of a perimeter intrusion detection sensor incorporated into a wire security fence.

Intrusion detection shall be achieved by sensing the cutting of any single wire or deflection of the fence, such as by climbing.

- a. Sensor zone: Includes one (1) or more 200 ft. (61 m) maximum sections of seven (7) ft. (2.3 m) high parallel fence. Each sector shall consist of 13 horizontal barbed wires attached to the taut-wire fence posts, and three (3) strands as outriggers, and an "anti-ladder" trip wire supported by rods extending from the outriggers for a total vertical height of approximately eight (8) ft. (2.6 m).
- b. Displacement switches for each horizontal wire shall be mounted within a pre-wired channel fastened to the fabric fence post at the midpoint of each section. Outrigger barbed wire and tripwire may share the same switch in these locations.
- c. Abnormal displacement of a switch lever resulting from cutting or deflecting its attached wire, as by climbing on or through fence strands, shall initiate an alarm condition. A damping mechanism within the sensor shall reduce alarm thresholds due to slowly changing environmental phenomena such as the ground shifting, daily and seasonal temperature variations, winds changes, etc.
- d. Sensor switches shall be provided with electrical contact closures as a means for initiating an alarm condition.
- e. The system shall provide relay outputs to interface alarm outputs with the overall IDS.
- f. Taut-wire Sensor Technical Characteristics:

Power requirements	Input: 120 - 208 VAC
Sensor zone control unit capability	Up to 10 zones
Sensitivity	0.75 in. (19 mm)
Environment Limits	Winds up to 35 mph (56 km/h)

12. Electrostatic Field Sensors: These sensors generate an electrostatic field around one (1) or more horizontal wires and detect intrusion of the electrostatic field as follows.

- a. Sensors shall initiate an alarm when an intruder attempts to approach or scale a fence or physical barrier. Electrostatic field sensors shall detect human presence by generating an

- electric field around one (1) or more horizontal wires that detects the induced signal in parallel sensing wires.
- b. Sensors shall monitor the induced signal for changes that result from the presence of a human body, which distorts coupling between transmitting and sensor wires.
 - c. Sensor components shall consist of one (1) or more signal generator field wires and mounting hardware, sensing wires, an amplifier/signal processors, power supplies, and necessary circuitry hardware. Mounting and support hardware shall be provided by the equipment manufacturer.
 - d. Wires shall be spring tension-mounted and provided with end-of-line terminators to detect cutting, shorting, or breaking of the wires.
 - e. Sensor configuration shall be able to detect an intruder that may crawl under the bottom wire, through the wires, or over the top wire by divided sensor zones.
 - f. Signal processing circuitry shall provide filtering to distinguish nuisance alarms.
 - g. Sensor configuration shall incorporate balanced, opposed field construction to eliminate distant field noise.
 - h. Sensor sensitivity shall be adjustable. Adjustment controls shall be inaccessible to operating personnel and system sensitivity controls shall be set at approximately midrange.
 - i. Sensors shall provide some means of indicating an alarm condition at the protected perimeter to facilitate installation and calibration.
 - j. The sensor system shall include an indicator disabling device within a tamperproof enclosure.
 - k. Electrostatic Field Sensor Technical Characteristics:

Power	115 -120 VAC transformer
Operating Power Requirements	16-22 VAC, 225 mA single zone 275 dual zone
Detection Sensitivity	77 lbs within 3 ft. (915 mm) - midrange setting
Detection Velocity	0.1 ft. (30 m) - 10 ft. (300 m) per sec

Supervision	AC Monitoring of fence and field wires - open, short, and grounded circuits
Tamper Switch	One (1)-pole, two (2) position
Lightening arrestor	Transistors on all relay output and power inputs
Battery Charger	Built-in
Processor Enclosure	Base plate, steel NEMA enclosure Weather resistant

13. Gate Sensors: They shall be provided in accordance with specific fence sensor manufacturer's recommendations to ensure continuous fence sensor zone protection for the entire protected perimeter.
- When gate units are not provided by the fence sensor manufacturer, provide separately zoned Balanced Magnetic Switch (BMS) gate sensors.
 - Sensors shall perform as specified in Section 2.3-E.6 entitled "Balanced Magnetic Switches (BMS)."
- E. Interior Detection Devices: (Sensors)
- The IDS shall consist of interior, exterior, and other detection devices that are capable of:
 - Locating intrusions at individually protected asset areas or at an individual portal;
 - Locating intrusions within a specific area of coverage;
 - Locating failures or tampering of individual sensors or components.
 - Provide and adjust for devices so that coverage is maximized in the space or area it is installed in. For large rooms where multiple devices are required, ensure device coverage is overlapping.
 - Detection sensitivity shall be set up to ensure maximum coverage of the secure area is obtained while at the same time limiting excessive false alarms due to the environment and impact of small animals. All detection devices shall be anti-masking with exception of video motion detection.

4. Dual sensor technology shall be used when possible. Sensor technology shall not be of the same type that is easily defeated by a single method. This will reduce the amount of false alarms.
5. Interior Environmental Conditions: Systems shall be able to operate in environmentally protected interior areas and shall meet operational performance requirements for the following ambient conditions:
 - a. If components are installed in unheated areas they shall be able to operate in temperatures as low as 0 F (-17 C);
 - b. Interior Sensor Environmental Characteristics:

Temperatures	32F to 120 F (0 to 50 C)
Pressure	Sea Level to 15,000 ft. (4573m) above sea level
Humidity	5% - 95%
Fungus	Components of non-fungus nutrient materials
Acoustical Noise	Suitable for high noise environments above 100db

6. Balanced Magnetic Switches (BMS)
 - a. BMS switches shall be surface or recessed mounted according to manufacture's instructions. Recessed mounted is the preferred method to reduce tampering or defeating of the system. Switches shall activate when a disturbance in the balanced magnetic field occurs.
 - b. Switches shall have a minimum of two (2) encapsulated reed switches.
 - c. Contractor shall provide each BMS with a current protective device, rated to limit current to 80% of the switch capacity.
 - d. Surface Mounted BMS: For exterior application, components shall be housed in weatherproof enclosures.
 - e. BMS field adjustments in the fixed space between magnet and switch housing shall not be possible. Attempts to adjust or disturb the magnetic field shall cause a tamper alarm.

f. BMS Technical Characteristics:

Maximum current	.25 amperes
Maximum voltage	30 VDC
Maximum power	3.0 W (without internal terminating resistors). 1.0 W (with internal terminating resistors).
Components	Three (3) pre-adjusted reed switches Three (3) pre-adjusted magnets
Output contacts	Transfer type SPDT
Contact rating	0.5 amperes, 28 VDC
Switch mechanism	Internally adjustable $\frac{1}{4}$ - $\frac{1}{2}$ in. (6-13 mm)
Wiring	Two (2) wires #22 American Wire Gauge (AWG), three (3) or 11 foot attached cable
Activation lifetime	1,000,000 activations
Enclosure	Nonferrous materials
Tamper alarm activation	Cover opened 1/8 in. (3 mm) and inaccessible until actuated

7. Window Intrusion Detection: These IDS devices shall detect intrusions thru inertia (shock) or by sound, and shall utilize either a Breakwire Sensor or Acoustic and Seismic Sensor.

a. Breakwire Sensors (wire trap):

- 1) Detect intrusion thru shock or breakage of window glazing.
Also used for the protection of utility openings.
- 2) Sensors shall consist of fine wire embedded in or affixed to interior of glazing. Breakage of protected glazing shall result in wire breakage.
- 3) Wire shall be hard-drawn copper up to #26 AWG diameter.
- 4) If sensors are affixed to glazing the sensor shall be protected by a clear coating which shall not affect sensor functioning.

- 5) Sensor shall be terminated in insulated connectors which are concealed and tamper resistant.
- 6) Protection of inlet openings:
 - a) Shall consist of up to 26 AWG hard-drawn copper wire with a tensile strength of 17.8 N 4 pounds maximum.
 - b) Wire shall be interlaced throughout the opening such that no opening between wires shall be larger than 4 in. (100 mm) on center.
 - c) Sensors shall be terminated so that attempts to cut the wire or otherwise enlarge openings between wires shall cause an alarm.
 - d) Sensors shall be terminated in insulated connectors which are concealed and tamper resistant.
- b. Acoustic and Seismic Glass Break Detectors:
 - 1) Detects intrusion thru the use of audible sound and vibration emitted from the breaking of glass using a tuned frequency range and sound pattern recognition. This initiates an alarm when glass they protect is broken or cracked.
 - 2) Detectors shall be installed in strict conformance with manufacture's installation instructions.
 - 3) The detector's power circuit shall be switched via an output relay on the control panel to provide latching alarm LED reset capability.
 - 4) Sensors shall be contained in a fire-resistant ABS plastic housing and must be mounted in contact with a window.
 - 5) Sensing shall be accomplished through the use of a mechanical filtered piezoelectric element.
 - 6) Sensors shall have a sensitivity adjustment controlling output voltage from the piezoelectric element which triggers a solid-state latching device.
 - 7) Sensors shall selectively filter input to minimize false alarms and not initiate alarm in response to ambient seismic vibrations or other ambient stimuli.
 - 8) A manufacture's test unit will be used to validate the sensor by simulating glass breakage.
 - 9) The Contractor shall provide sensors for adjusting sensitivity and two-sided polyurethane tape with acrylic adhesive for window attachment.

10) Sensor shall include exterior label to protect adhesive tape from direct sunlight.

11) Window Intrusion Detection Sensor Technical Specifications:

Power	Auxiliary power supply 12 VDC @ 25 mA (+/-) 10%
Power Input	10 - 15 VDC at 16mA protected against reverse polarity, 20 mA during relay closure
Relay Output Rating	Minimum of 25 VDC mA
Coverage Audio	6,000 Square ft.
Coverage Glass Break	25 ft. (7.5 m) wide by 25 ft. wide (7.5 m) Minimum: 25 feet (7.62 m) from the detector to the furthest point on protected glass.
Audio Output	300 - 12,000 HZ
Alarm Output	Relay NO or NC selectable
Interconnection	12 pin Panduit connector, 22 AWG
Radio Frequency Interface	No alarm or setup on between frequencies 26 - 100 MHz 50 v/m Immunity to mobile RF interference 100 watts @ 9.8 Ft. (3 m) in 27-100 MHz range
Alarm period	Two (2) to three (3)
Mounting	Ceiling, same wall, adjacent wall, opposite wall
Features	Test and alarm LEDs for acoustic seismic and alarm condition latching, Alarm LED and tamper switch on cover.
Alarm verification	Digital signal processing or dual acoustic processing technologies

Detection ability	Single and multi-pane glass, wired glass, tempered and laminated glass to ¼ inch (6 mm) or thickness
-------------------	--

8. Screening: This material shall be used on windows to protect and detect intrusion as follows.
- Security screens shall be constructed from a maximum of 26 AWG insulated hard-drawn copper.
 - Screens shall be connected to an alarm circuitry by means of flexible armored cords. Security screen circuitry shall provide end-of-line resistors in series or equivalent methods ensuring alarm activation if short-circuiting of the screen is attempted.
 - If unable to install a break wire sensor (wire traps), then tamper switches will be provided.
 - Contractor shall provide tamper switches in the frames as required with not less than one (1) switch on each side if dimensions are two (2) ft. square (610 mm) or less, and two (2) switches if dimensions exceed two (2) ft. square (610 mm). Tamper switches shall be corrosion-resistant, spring-operated, and shall initiate an alarm with a movement of two (2) in. (50 mm) or less before access to the switch is possible.
 - Electrical characteristics of the switch shall match the alarm system requirements.
9. Vibration Sensors: These sensors shall initiate alarms upon detecting drilling, cutting, or blasting through walls, or other methods of forced entry through a structure as follows.
- Sensors shall detect and selectively amplify signals generated by forced penetration of a protective structure.
 - Sensors shall be designed to give peak response to structurally conveyed vibrations associated with forcible attack on the protected surface.
 - Sensors will initiate an alarm if attempts are made to remove them from the surface of the wall.
 - Sensors shall be enclosed in protective mountings.
 - Sensors shall include an adjustable alarm discriminator to prevent incidental vibrations which may occur from triggering the alarm circuit.
 - Sensors shall be provided with a tamper switch.

- g. Sensor sensitivity shall be individually adjustable unless a sensor is designed to accommodate vibration ranges of specific surface type on which it will be mounted. Sensitivity adjustments shall not be accessible without removing the sensor cover. Also, a sensor shall not be responsive to airborne sound.
- h. Vibration Sensor Technical Characteristics:

Power requirements	External DC power source Eight (8)- 14.5 VDC, two (2) volt max peak to peak ripple
Alarm output	Form C (NO/C/NC) solid state alarm relay, rated 100 mA, 28 VDC
Tamper Connection	Tamper switch and external magnetic
Current rating and alarm output	No alarm state 20mA SPDT relay contact rating (Form C)
Sensor range	Concrete (poured) 13.2 ft. (4 m) Concrete block 6.6 ft. (2 m) Brick block 3.3 ft. (1 m)
Frequency range	3kHz-20kHz (-15db) 7kHz-10kHz (-10db)
Adjustable	Sensitivity eight (8) steps Alarm response 0-30 sec

10. Passive Infrared Motion Sensors (PIR): These sensors shall detect an intruder presence by monitoring the level of infrared energy emitted by objects within a protected zone and meet ANSI PIR-01 Passive Infrared Motion Detector Standards Features for Enhancing False Alarm Immunity. An alarm shall be initiated when motion and temperature changes within set patterns are detected as follows.
- The detector shall provide multiple detection zones distributed at a variety of angles and distance.
 - Sensors shall be passive in nature; no transmitted energy shall be required for detection.

- c. Sensors shall be sensitive to infrared energy emitted at wavelengths corresponding to human body and other objects at ambient temperatures.
- d. Sensors shall not alarm in response to general area thermal variations and shall be immune to radio frequency interference.
- e. Sensors shall not be susceptible to changes in temperature due to an air conditioner being turned on or off.
- f. Sensors shall be housed in a tamper-alarmed enclosure.
- g. Sensor detectors shall include motion analyzer processing, adjustable lens, and walk test LED's visible from any angle.
- h. Sensors shall provide some means of indicating an alarm condition during installation and calibration. A means of disabling the indication shall be provided within the sensor enclosure.
- i. Sensor detectors shall include a motion monitoring verification circuit that will signal trouble or alarm if the detector fails to detect motion for an extended period.
- j. PIR Technical Characteristics:

Power	Six (6) - 12 VDC 25 mA continuous current draw 38 mA peaks
Alarm Velocity	Five (5) ft. (1500 mm) at a velocity of 0.1 ft. (30 mm) per second, and one (1) step per second, assuming 6 in. (150 mm) per step. Also, faster than 0.1 foot (30 mm) per second, up to 10 feet (3000 mm) per second
Maximum detection range	35 ft. (10.6 m)
Frequency range- non activation or setup use	26 to 950 MHz using a 50 watt transmitter located 1 ft. from the unit or attached wiring
Infrared detection	3°F (1 1/2°C) different from the background temperature
Detection Pattern	180 degrees for volumetric units, non PIR 360

PIR 360°Detection Pattern	Programmable 60 detection zones including one directly below
Mounting	Ceiling and walls
Ceiling heights	Eight (8) ft. (2.4 m) – 18 ft (5.4 m)
Sensitivity adjustments	Three (3) levels

11. Microwave-Passive Infrared Detector: This sensor shall be designed to detect the motion of a human body within a protected area by means of a combination of microwave sensing technology and passive infrared (MPIR) sensing technology as follows.
- The sensor shall require both technologies to sense intrusion before an alarm may occur.
 - The sensor shall be designed for wall mounting on swivel bracket. A high-security gimbaled bracket shall be provided.
 - The PIR fields of view shall be focused on the pyroelectric element by means of an internal multi-faceted mirror.
 - The sensor shall incorporate a look-down lens system that detects the passing of an intruder directly beneath the sensor.
 - The sensor shall incorporate a microwave supervision system which shall activate the trouble output if the device technology fails.
 - The sensor shall incorporate self-diagnostics which shall monitor the sensor systems and report a trouble to the control panel if any system device fails.
 - The sensor shall have compensation against loss of sensitivity as the ambient temperature nears human body temperature.
 - MPIR Technical Characteristics:

Technology	Microwave and Passive Infrared
Power	Nine (9) – 15 VDC max current consumption 22 mA at 12 VDC
Operating Temperature	32°F (0° C) – 120° F (49° C)
Detection Area	98 ft. (30 m) long by 9.8 ft. (3 m) wide or 69 ft. (21 m) long by 69 ft. (21m) wide
Electronics	Microcontroller based

Alarm Contact	Form-C rated 125 mA, 28 VDC
Tamper Contact	125 mA, 28 VDC
Trouble Contact	Form-B rated 25 mA, 30 VDC
Microwave Operating Frequency	10.525 GHz
Microwave Sensitivity	Adjustable on circuit board
Detection pattern adjustment	Changing of internal lens
Sensing element	Pyro-electric
LED Indicators	PIR, microwave, alarm
Bug and Dust protection	zero-clearance, gasket bug guard
Lens	Interchangeable: standard 60x80 ft. (18x24 m), corner mounting, ultra-wide, pet alley, long range, room and corridor combo, room and ceiling combo, creep zone

12. Ultrasonic Sensors: These sensors shall transmit ultrasonic energy into a protected zone, receiving the direct and reflected energy, and monitoring frequency shift between transmitted and received signals as follows.
- Sensors shall automatically adapt to changing levels of air turbulence and shall consist of a control unit and as many transceivers as required to protect a zone within limitations of the control unit per manufacture's instructions.
 - Ultrasonic system sensors shall provide a means of indicating an alarm condition at the protected zone during installation and calibration. This indication shall be provided with a disabling device within the sensor enclosure.
 - Transceivers shall consist of an adjustable-gain preamplifier, an ultrasonic-to-electrical transducer, and an electrical-to-ultrasonic transducer in a single enclosure. Transducers shall be adjustable in position to allow adequate adjustment and directivity.

- d. Each sensor will consist of sensitivity adjustments. Controls shall be inaccessible to operating personnel and sensitivity requirements shall be set approximately at midrange.
- e. Sensor elements shall be housed in a tamper-alarmed enclosure.
- f. Ultrasonic Sensor Technical Characteristics:

Power output	Peak not to exceed 105 dB at three (3) ft. (900 mm)
Transceiver protection zone	20 ft. (6 m) by 30 ft. (9.2 m) in a zone with an 8 ft. (2440 mm) to 12 ft. (3660 mm) ceiling
Nuisance alarm reduction	Selective filtering
Detection frequency range	Above 24 kHz and below 30 kHz (nominally 26 kHz)
Detection velocity	5 ft. (1500 mm) at a velocity of 0.5 ft. (150 mm) per second to 15 feet (4570 mm) per second, also Higher than 0.5 foot (150 mm) per second, up to eight (8) ft. (2440 mm) per second

- 13. Photoelectric Sensors: The sensor devices shall be able to detect an intruder presence by sending out a series of infrared or ultraviolet beams. Intrusion is based on disruption of the signal beams as follows.
 - a. Sensors shall consist of a modulating transmitter, focusing lenses, mirrors, demodulating receiver, power supply, and interconnecting lines.
 - b. Beam transmitters shall be designed to emit light. Beams may be reflected by one (1) or more mirrors before being received and amplified.
 - c. The photoelectric sensor shall initiate an alarm when the beam is interrupted with monitoring controls set at midrange.
 - d. Transmitted beams shall be uniquely modulated to prohibit defeat of the IDS system by shining another light source into the receiver.

- e. Sensors shall provide a means of local alarm indication on the detector for use at the protected zone during installation and calibration.
- f. Sensors shall include an indicator-disabling device within the sensor enclosure.
- g. Sensors shall utilize automatic gain control or be provided with sensitivity adjustments to allow for various beam lengths.
- h. Sensor controls shall be inaccessible to operating personnel.
- i. Sensors that use multiple beams shall be tested by attempting to crawl under and jump through and over beams. Each system sensor shall provide cutoffs of at least 90% to handle a high percentage of light cutoffs prior to initiating an alarm.
- j. Sensor components shall be housed in tamper-alarmed enclosure.
- k. Photoelectric Sensor Technical Characteristics:

Power requirements	Nine (9)-16 VDC, protected against reverse polarity
Relay output	Normally closed. 18 ohm resistor in series with contacts. 0.5 amperes resistance/24 VDC
Current	Transmitter 15 mA, Receiver 15 mA
LED	Alignment, walk-test alarm, off
Range	Indoor: 130 ft. (39 m) Outdoor: 65 ft. (19.5 m)
Alarm relay contacts	Two (2) amperes at 120 VAC minimum
Enclosure	High impact acrylic
Type	Dual beam
Mounting	Wall, corner, flush
Beam width	Six (6) degrees
Receiver field of view	Six (6) degrees horizontal and vertical
Adjustments	Vertical +10 - 20 degrees Horizontal 30 degrees
Alarm period	Two (2) - three (3) sec

Infrared source	Long-life Gallium Arsenide LED
Infrared sensor	PIN photodiode
Transmitter Frequency	One (1) kHz 10 microsecond pulse width
IR Wavelength	950 nm

14. CCTV Video Motion Detection Sensors: Refer to Section 28 23 00 VIDEO SURVEILLANCE that outlines related video motion detection requirements.

15. Pressure Mat Detectors: These devices shall be able to detect the presence of people in a localized zone. Pressure from standing or walking across an area where a mat is place detects a closed circuit as follows.

- a. The mat shall be easily interfaced directly to a micro-sensor controller.
- b. Shall be sealed on all edges and pre-wired and made of durable material that is waterproof for indoor/outdoor use.
- c. This pressure sensitive mat shall be capable of being easily hidden under existing carpet or other entry mat without effecting operation, to include the prevention of false or nuisance alarms.
- d. Shall have a slip resistant surface with four (4) lead fail-safe wiring.
- e. Mat detectors shall be resistant to water and dust and the wiring circuitry shall be capable of direct supervision.
- f. Pressure Mat Detector Technical Characteristics:

Operating Voltage	15 VDC AC with max current 20 mA
Activation Weight	80 lbs. (36.28kg. per 3 in. (76.2mm) square
Activation Lifespan	500,000 activations without failure

16. Tamper Alarm Switches: The following IDS sensors shall be used to monitor and detect potential tampering of sensors, control panels and enclosures.

- a. Tamper Switches: All enclosures including cabinets, housings, boxes, raceways, and fittings with hinged doors or removable covers containing circuits and power supplies related to the IDS shall include corrosion-resistant tamper switches.
- b. Tamper alarms shall be annunciated to be clearly distinguishable from IDS alarms.
- c. Tamper switches will not be in a viewable from a direct line of sight perspective. The minimum amount of time the tamper switch becomes active and sends a signal after an enclosure is opened or panel removable is attempted, shall be one (1) second.
- d. Tamper switches will initiate when enclosure doors or covers is removed as little as 1/4 in. (6.35 mm) from the closed position unless otherwise indicated. Tamper switches shall be:
 - 1) Push/pull automatic reset type;
 - 2) Inaccessible until switch is activated;
 - 3) Spring-loaded and held in closed position by door or cover; and
 - 4) Wired to break a circuit when door or cover is removed with each sensor annunciated individually at a central reporting processor.
- e. Fail-Safe Mode: Shall provide the capability to detect and annunciate diminished functional capabilities and perform self-tests. Fail-safe alarms shall be annunciated to be clearly distinguishable from other types of alarms.

F. Power Supply

- 1. A power supply shall only be utilized if the control panel is unable to support the load requirements of the IDS system.
- 2. All power supplies shall be UL rated and able to adequately power two entry control devices on a continuous base without failure.
- 3. Power supplies shall meet the following minimum technical characteristics:

INPUT POWER	110 VAC 60 HZ 2 amp
OUTPUT VOLTAGE	12 VDC Nominal (13.8 VDC) 24 VDC Nominal (27.6 VDC) Filtered and Regulated
BATTERY	Dependant on Output Voltage shall

	provide up to 14 Ah, rechargeable
OUTPUT CURRENT	4 amp max. @ 13.8 VDC 3 amp max. @ 27.6 VDC
BATTERY FUSE SIZE	3.5 A @ 250 VAC
CHARGING CIRCUIT	Built-in standard

G. Enclosures:

1. All control panels, input and output modules, and power supplies shall be housed inside a metal enclosure in accordance with National Electrical Manufacturers Association (NEMA) 250 Enclosures for Electrical Equipment.
2. The enclosure shall be UL rated, lockable and alarmed with a tamper alarm switch that is monitored by the control panel.
3. The enclosures will be NEMA 4 rated if exterior mounted.
4. All connections to the enclosure shall meet or exceed the requirements set forth in the NEC.

2.3 INSTALLATION KIT

A. General

1. The kit shall be provided that, at a minimum, includes all connectors and terminals, labeling systems, audio spade lugs, barrier strips, punch blocks or wire wrap terminals, heat shrink tubing, cable ties, solder, hangers, clamps, bolts, conduit, cable duct, and/or cable tray, etc., required to accomplish a neat and secure installation. All wires shall terminate in a spade lug and barrier strip, wire wrap terminal or punch block. Unfinished or unlabeled wire connections shall not be allowed. All unused and partially opened installation kit boxes, coaxial, fiber-optic, and twisted pair cable reels, conduit, cable tray, and/or cable duct bundles, wire rolls, physical installation hardware shall be turned over to the Contracting Officer. The following sections outline the minimum required installation sub-kits to be used:
2. System Grounding
 - a. The grounding kit shall include all cable and installation hardware required. All head end equipment and power supplies shall be connected to earth ground via internal building wiring, according to the NEC.

- b. This includes, but is not limited to:
- 1) Coaxial Cable Shields
 - 2) Control Cable Shields
 - 3) Data Cable Shields
 - 4) Equipment Racks
 - 5) Equipment Cabinets
 - 6) Conduits
 - 7) Cable Duct blocks
 - 8) Cable Trays
 - 9) Power Panels
 - 10) Grounding
 - 11) Connector Panels
3. Coaxial Cable: The coaxial cable kit shall include all coaxial connectors, cable tying straps, heat shrink tabbing, hangers, clamps, etc., required to accomplish a neat and secure installation.
4. Wire and Cable: The wire and cable kit shall include all connectors and terminals, audio spade lugs, barrier straps, punch blocks, wire wrap strips, heat shrink tubing, tie wraps, solder, hangers, clamps, labels etc., required to accomplish a neat and orderly installation.
5. Conduit, Cable Duct, and Cable Tray: The kit shall include all conduit, duct, trays, junction boxes, back boxes, cover plates, feed through nipples, hangers, clamps, other hardware required to accomplish a neat and secure conduit, cable duct, and/or cable tray installation in accordance with the NEC and this document.
6. Equipment Interface: The equipment kit shall include any item or quantity of equipment, cable, mounting hardware and materials needed to interface the systems with the identified sub-system(s) according to the OEM requirements and this document.
7. Labels: The labeling kit shall include any item or quantity of labels, tools, stencils, and materials needed to label each subsystem according to the OEM requirements, as-installed drawings, and this document.
8. Documentation: The documentation kit shall include any item or quantity of items, computer discs, as installed drawings, equipment, maintenance, and operation manuals, and OEM materials needed to correctly provide the system documentation as required by this document and explained herein.

3.0 EXECUTION

3.1 INSTALLATION

- A. IDS installation shall be in accordance with Underwriters Laboratories (UL) 639 Standards for Intrusion Detection Units and UL 634 Standards for Connectors with Burglar Alarm Systems, and appropriate manufacture's installation manuals for each type of IDS.
- B. Components shall be configured with appropriate "service points" to pinpoint system trouble in less than 30 minutes.
- C. The Contractor shall install all system components including VA furnished equipment, and appurtenances in accordance with the manufacturer's instructions and shall furnish all necessary connectors, terminators, interconnections, services, and adjustments required for a complete and operable system.
- D. The IDS will be designed, engineered, installed, and tested to ensure all components are fully compatible as a system and can be integrated with all associated security subsystems, whether the system is a stand alone or designed as a computer network.
- E. The IDS shall be able to be integrated with other security subsystems. Integration with these security subsystems shall be achieved by computer programming and the direct hardwiring of the systems. Determination for methodology shall be outlined when the system(s) is/are being designed and engineered. For installation purposes, the IDS shall utilize an output module for integration with other security subsystems. The Contractor will ensure all connections are per the OEM and that any and all software upgrades required to integrate the systems are installed prior to system start-up.
- F. For programming purposes, the Contractor shall refer to the manufacturer's requirements and Contracting Officer instructions for correct system operations. This includes ensuring computers being utilized for system integration meet or exceeds the minimum system requirements outlined in the IDS software packages.
- G. Lightning and power surges to the central alarm reporting and display unit shall be protected at both ends against excessive voltages. This requirement shall apply for circuits that are routed both in underground conduits and overhead runs.
- H. At a minimum, the Contractor shall install primary detection devices, such as three electrode gas-type surge arresters, and secondary

protectors to reduce dangerous voltages to levels that will cause no damage. Fuses shall not be permitted as protection devices.

- I. The Contractor shall provide fail-safe gas tube type surge arresters on exposed IDS data circuits. In addition, transient protection shall protect against spikes up to 1000 volts peak voltage with a one-microsecond rise time and 100-microsecond decay time, without causing false alarms. The protective device shall be automatic and self-restoring. Also, circuits shall be designed or selected assuming a maximum of 25 ohms to ground.

J. Product Delivery, Storage and Handling:

- 1. Delivery: Deliver materials to the job site in OEM's original unopened containers, clearly labeled with the OEM's name, equipment model and serial identification numbers, and UL logo. The Contracting Officer may inventory the IDS equipment at the time of delivery and reject items that do not conform to this requirement.
- 2. Storage and Handling: Store and protect equipment in a manner that will preclude damage as directed by the Contracting Officer.

K. Cleaning and Adjustments:

- 1. Cleaning: Subsequent to installation, clean each system component of dust, dirt, grease, or oil incurred during installation in accordance to manufacture instructions.
- 2. Prepare for system activation by following manufacturer's recommended procedures for adjustment, alignment, or synchronization. Prepare each component in accordance with appropriate provisions of the component's installation, operations, and maintenance instructions.

L. Tamper Switches

- 1. Install tamper switches to initiate an alarm signal when a panel, box, or component housing door or cover is moved as little as 6.35 mm 1/4 inch from the normally closed position unless otherwise specified.
- 2. Locate tamper switches within enclosures, cabinets, housings, boxes, raceways, and fittings to prevent direct line of sight to any internal components and to prevent tampering with switch or circuitry.
- 3. Conceal tamper switch mounting hardware so that the location of the switch within the enclosure cannot be determined from the exterior.

M. Unique IDS Installation Components:

1. BMS Surface Mounted:

- a. Surface mounted BMS housing for the switch element shall have the capability to receive threaded conduit. Housing covers for surface mounted BMS, if made of cast aluminum, shall be secured by stainless steel screws. Magnet housing cover shall not be readily removable and BMS housings shall be protected from unauthorized access by a cover operated, corrosion-resistant tamper device.
- b. Conductors running from a door to alarm circuits shall be contained within a flexible armored cord constructed from corrosion-resistant metal. Each end of the armored cord shall terminate in a junction box or other enclosure. Armored cord ends shall be mechanically secured to the junction boxes by clamps or bushings. Conductors within the armored cord shall be provided with lug terminals at each end. Conductors and the armored cord shall experience no mechanical strain as the door is removed from fully open to closed position. Switch circuits shall initiate an alarm if a short circuit is applied to the door cord.
- c. For exterior application on double gates, both BMS elements must be mounted on the gate. Flexible armored cord constructed from corrosion-resistant metal shall be used to provide electrical connection.

2. BMS Recessed Mounted:

- a. Ball bearing door trips shall be mounted within vault door headers such that when the locking mechanism is secured, the door bolt engages an actuator, mechanically closing the switch.
- b. Door bolt locking mechanisms shall be fully engaged before the ball bearing door trip is activated. Also, circuit jumpers from the door shall be provided.

3. Vibration Sensors:

- a. Mount vibration sensors directly contacting the surface to be protected.
- b. Provide at least one (1) sensor on each monolithic slab or wall section, even though spacing closer than that required for midrange sensitivity may result.
- c. House sensors in protective mountings and fasten to surface with concealed mounting screws or an epoxy.

- d. Adjust discriminator on the job to precise needs of application. Connect sensors to an electronic control unit by means of wiring or fiber optics cable run in rigid steel conduit or electrical metallic tubing (EMT).
- 4. Ultrasonic Sensors:
 - a. Installation shall ensure that transceiver zones slightly overlap.
 - b. Care shall be taken to ensure adequate sensitivity in area abundant in acoustic-absorbing materials such as carpets and drapes.
 - c. When the protected zone is broken up by furniture or large objects, it shall not be possible to traverse the zone undetected by moving the blind zones created by the objects.
- 5. Passive Infrared Detectors: (PIR)
 - a. The protective beam shall be focused in a straight line.
 - b. Installed beam distance from transmitter to receiver shall not exceed 80% of the manufacturer's maximum recommended rating.
 - c. Mirrors may be used to extend the beam or to establish a network of beams. Each mirror used shall not lower the rated maximum system range by more than 50%.
 - d. Mirrors and photoelectric sources used in outdoor applications shall have self-heating capability to eliminate condensation and shall be housed in weatherproof enclosures.
- 6. Taunt-Wire:
 - a. Housing for switch assembly shall be covered by a neoprene cap to retain the center bolt (lever arm), which functions as a lever to translate movement of the attached horizontal wire into contact closure. When the neoprene cap is firmly seated on the cup-shaped polycarbonate housing, it shall function as the fulcrum for the lever (bolt).
 - b. Upper exposed end of the lever shall be threaded to accommodate clamping to the horizontal wire. The lower end of the lever, which is fashioned to serve as the movable electrical contact, shall be held suspended in a small cup-shaped contact that floats in a plastic putty material.
 - c. Plastic putty used shall retain a degree of elasticity under varying temperature conditions and provide the sensor switch with a self-adjusting property. This provides the switch with a built-

in compensating mechanism that ignores small, very slow changes in lever alignment (i.e. which may result from environmental changes such as extreme temperature variations and ground seepage due to weather conditions) and to react to fast changes only, as caused by manual deflection or cutting of the wires.

- d. Contractor shall provide metal slider strips having slots through which the barbed wires pass. Wires shall be prevented from leaving the slots by rivets. A slider strip shall be used to translate normal forces to the barbed wire and to the horizontal displacement of the sensor.
 - e. Install one (1) slider strip pair, upper and lower, on every fence post except where sensor posts or anchor strips are installed.
 - f. Separation between slider elements along the fence shall be 10 feet (3000 mm).
 - g. Attach wires of sensor to existing, specially installed fence posts, called anchor posts, located equidistant on both sides of sensor posts and at ends of sensor zone run.
 - h. Anchor strip shall be a strip of steel plate on which fastening plates are installed. Weld or otherwise attach the strip to anchor post and ends of tensed barbed wires wrapped around the fastening plates. Attempts to climb on fastening plates or on the attached barbed wires shall cause plates to break off, creating an alarm and making it impossible to defeat the system by climbing at the anchor post.
 - i. The use of barbed wire as part of the IDS system shall be suitable for installation under a preload tension of approximately 392 N 88 pounds and be flexible enough for convenient manipulation during tensioning. Double-strand 15 1/2-gage barbed wire shall be the minimum acceptable.
7. Electromechanical Fence Sensors:
- a. The fence length shall be divided into 300 ft. (100 m) or zones.
 - b. Sensors shall consist of individual electromechanical sensing units mounted every three-thousand and 10 ft. (3045 mm) on the fence fabric or posts and wired in series to a sensor zone control unit and associated power supply.
8. Electrostatic Field Sensors:

- a. Sensors shall be capable of following irregular contours and barrier bends without degrading sensitivity below the specified detection level.
- B In no case shall a single sensor zone exceed 300 ft. (100 m) or be long enough to significantly degrade sensitivity.
- c. Adjacent zones shall provide continuous coverage to avoid a dead zone. Adjacent zones shall be designed to prevent crosstalk interference.
- d. Exterior components shall be housed in rugged corrosion-resistant enclosures, protected from environmental degradation and include tamper switches.
- e. Interfacing between exterior units shall be carried in underground cables.
- f. Exterior support hardware shall be stainless or galvanized to avoid tension degradation.
- g. Sensor and field wires shall be stainless steel. Wire spacing for various configurations shall be maintained constant throughout each zone and shall be uniform with respect to the ground and follow manufacturer's specifications.
- h. Signal processing equipment shall be separately mounted such that no desensitized zones are created within the zone of detection.
- 9. Microwave: Do not install microwave sensors where fluorescent lights may pose a problem due to radiated ionization from lights.

3.2 TESTS AND TRAINING

All testing and training shall be compliant with the VA General Requirements, Section 01 00 00, GENERAL REQUIREMENTS.

-----END-----

**SECTION 28 23 00
VIDEO SURVEILLANCE**

PART 1 - GENERAL

1.1 DESCRIPTION

Provide and install a complete Video Surveillance System, which is identified as the Closed Circuit Television System hereinafter referred to as the CCTV System as specified in this section.

1.2 RELATED WORK

- A. For firestopping application and use, Section 07 84 00, FIRESTOPPING.
- B. For labeling and signs, Section 10 14 00, SIGNAGE.
- C. For connection of high voltage, Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
- D. For power cables, Section 26 05 21, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES (600 VOLTS AND BELOW).
- E. For grounding of equipment, Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS.
- F. For infrastructure, Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS.
- G. For perimeter lighting, Section 26 56 00, EXTERIOR LIGHTING.
- H. For access control, Section 28 13 11, PHYSICAL ACCESS CONTROL SYSTEMS (PACS).
- I. For screening of personnel and shipments, Section 28 13 53, SECURITY ACCESS DETECTION.
- J. For control and operation of all security systems, Section 28 13 16, ACCESS CONTROL SYSTEM AND DATABASE MANAGEMENT.
- K. For emergency and interior communications, Section 28 26 00, ELECTRONIC PERSONAL PROTECTION SYSTEM (EPPS).
- L. For Warranty of Construction see GENERAL CONDITIONS.
- M. For General Requirements, Section 01 00 00, GENERAL REQUIREMENTS.

1.3 QUALITY ASSURANCE

- A. The Contractor shall be responsible for providing, installing, and the operation of the CCTV System as shown. The Contractor shall also provide certification as required.
- B. The security system shall be installed and tested to ensure all components are fully compatible as a system and can be integrated with all associated security subsystems, whether the security system is stand-alone or a part of a complete Information Technology (IT) computer network.

- C. The Contractor or security sub-contractor shall be a licensed security Contractor as required within the state or jurisdiction of where the installation work is being conducted.

1.4 SUBMITTALS

- A. Submit below items in conjunction with Master Specification Sections 01 33 23, Shop Drawings, Product Data, and Samples, and Section 02 41 00, Demolition Drawings.
- B. Provide certificates of compliance with Section 1.3, Quality Assurance.
- C. Provide a pre-installation and as-built design package in both electronic format and on paper, minimum size 48 x 48 inches (1220 x 1220 millimeters); drawing submittals shall be per the established project schedule.
- D. Pre-installation design and as-built packages shall include, but not be limited to:
 - 1. Index Sheet that shall:
 - a. Define each page of the design package to include facility name, building name, floor, and sheet number.
 - b. Provide a list of all security abbreviations and symbols.
 - c. Reference all general notes that are utilized within the design package.
 - d. Specification and scope of work pages for all security systems that are applicable to the design package that will:
 - 1) Outline all general and job specific work required within the design package.
 - 2) Provide a device identification table outlining device Identification (ID) and use for all security systems equipment utilized in the design package.
 - 2. Drawing sheets that will be plotted on the individual floor plans or site plans shall:
 - a. Include a title block as defined above.
 - b. Define the drawings scale in both standard and metric measurements.
 - c. Provide device identification and location.
 - d. Address all signal and power conduit runs and sizes that are associated with the design of the electronic security system and other security elements (e.g., barriers, etc.).
 - e. Identify all pull box and conduit locations, sizes, and fill capacities.

- f. Address all general and drawing specific notes for a particular drawing sheet.
 - 3. A riser drawing for each applicable security subsystem shall:
 - a. Indicate the sequence of operation.
 - b. Relationship of integrated components on one diagram.
 - c. Include the number, size, identification, and maximum lengths of interconnecting wires.
 - d. Wire/cable types shall be defined by a wire and cable schedule. The schedule shall utilize a lettering system that will correspond to the wire/cable it represents (example: A = 18 AWG/1 Pair Twisted, Unshielded). This schedule shall also provide the manufacturer's name and part number for the wire/cable being installed.
 - 4. A system drawing for each applicable security system shall:
 - a. Identify how all equipment within the system, from main panel to device, shall be laid out and connected.
 - b. Provide full detail of all system components wiring from point-to-point.
 - c. Identify wire types utilized for connection, interconnection with associate security subsystems.
 - d. Show device locations that correspond to the floor plans.
 - e. All general and drawing specific notes shall be included with the system drawings.
 - 5. A schedule for all of the applicable security subsystems shall be included. All schedules shall provide the following information:
 - a. Device ID.
 - b. Device Location (e.g. site, building, floor, room number, location, and description).
 - c. Mounting type (e.g. flush, wall, surface, etc.).
 - d. Power supply or circuit breaker and power panel number.
 - e. In addition, for the CCTV Systems, provide the camera ID, camera type (e.g. fixed or pan/tilt/zoom (P/T/Z), lens type (e.g. for fixed cameras only) and housing model number.
 - 6. Detail and elevation drawings for all devices that define how they were installed and mounted.
- E. Pre-installation design packages shall be reviewed by the Contractor along with a VA representative to ensure all work has been clearly defined and completed. All reviews shall be conducted in accordance

with the project schedule. There shall be four (4) stages to the review process:

1. 35 percent
 2. 65 percent
 3. 90 percent
 4. 100 percent
- F. Provide manufacturer security system product cut-sheets. Submit for approval at least 30 calendar days prior to commencement of formal testing, a Security System Operational Test Plan. Include procedures for operational testing of each component and security subsystem, to include performance of an integrated system test.
- G. Submit manufacture's certification of Underwriters Laboratories, Inc. (UL) listing as specified. Provide all maintenance and operating manuals per the VA General Requirements, Section 01 00 00, GENERAL REQUIREMENTS.

1.5 APPLICABLE PUBLICATIONS

- A. The publications listed below (including amendments, addenda, revisions, supplement, and errata) form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American National Standards Institute (ANSI)/Electronic Industries Alliance (EIA):
- 330.....Electrical Performance Standards for CCTV
Cameras
 - 375A.....Electrical Performance Standards for CCTV
Monitors
- C. Institute of Electrical and Electronics Engineers (IEEE):
- C62.41.....IEEE Recommended Practice on Surge Voltages in
Low-Voltage AC Power Circuits
 - 802.3af.....Power over Ethernet Standard
- D. National Electrical Contractors Association (NECA):
- 303-2005.....Installing Closed Circuit Television (CCTV)
Systems
- E. National Fire Protection Association (NFPA):
- 70-05.....Article 780-National Electrical Code
- F. Federal Information Processing Standard (FIPS):
- 140-2.....Security Requirements for Cryptographic Modules
- G. Underwriters Laboratories, Inc. (UL):

983-06.....Standard for Surveillance Camera Units
 3044-01.....Standard for Surveillance Closed Circuit
 Television Equipment

1.6 WARRANTY OF CONSTRUCTION.

Warrant CCTV System work subject to the Article "Warranty of Construction" of FAR clause 52.246-21.

PART 2 - PRODUCTS

2.1 EQUIPMENT AND MATERIALS

- A. Security camera system shall be equal to and compatible to existing GE Security FCWinX Security Management System. Cameras shall be equal to and compatible to existing Ultra View IP Vandal Dome Day/Night Camera with WDR (Pan/Tilt/Zoom). Connect new security camera system to existing security camera system in police monitoring system in existing Hospital room 1B124K. Provide new DVR for new security camera system.
- B. All equipment associated within the CCTV System shall be UL 3004 compliant and rated for continuous operation. Environmental conditions (i.e. temperature, humidity, wind, and seismic activity) shall be taken under consideration at each facility and site location prior to installation of the equipment.
- C. All equipment shall operate on a 120 volts alternating current (VAC); 60 Hz AC power system unless documented otherwise in subsequent sections listed within this specification. All equipment shall have a back-up source of power that will provide a minimum of 96 hours of run time in the event of a loss of primary power to the facility.
- D. The system shall be designed, installed, and programmed in a manner that will allow for easy of operation, programming, servicing, maintenance, testing, and upgrading of the system.
- E. All CCTV System components located in designated "HAZARDOUS ENVIRONMENT" areas where fire or explosion could occur due to the presence of natural gases or vapors, flammable liquids, combustible residue, or ignitable fibers or debris, shall be rated Class II, Division I, Group F, and installed in accordance with NFPA 70, Chapter 5.
- F. All equipment and materials for the system will be compatible to ensure correct operation.

2.2 EQUIPMENT ITEMS

- A. CCTV system shall meet following requirements:
- B. All Cameras will be EIA 330 and UL 983 compliant as well as:

1. Will be charge coupled device (CCD) cameras and shall conform to National Television System Committee (NTSC) formatting.
2. Fixed cameras shall be color and the primary choice for monitoring following the activities described below. Pan/Tilt/Zoom (P/T/Z) cameras shall be color and are to be utilized to compliment the fixed cameras.
3. Shall be powered by either 12 volts direct current (VDC) or 24 VAC. Power supplies shall be Class 2 and UL compliant and have a back-up power source to ensure cameras are still operational in the event of loss of primary power to the CCTV System.
4. Shall be rated for continuous operation under the following environmental conditions:
 - a. Ambient temperatures of minus 10 degrees C (14 degrees F) to 55 degrees C (131 degrees F) utilizing equipment that will provide automatic heating and cooling.
 - b. Humidity, wind gusts, ice loading, and seismic conditions specified or encountered for locations where CCTV cameras will be utilized.
5. Will be home run to a monitoring and recording device via a controlling device such as a matrix switcher or network server and monitored on a 24 hour basis at a designated Access Control System and Database Management location.
6. Each function and activity shall be addressed within the system by a unique twenty (20) character user defined name. The use of codes or mnemonics identifying the CCTV action shall not be accepted.
7. Shall come with built-in video motion detection that shall automatically monitor and process information from each camera. The camera motion detection shall detect motion within the camera's field of view and provide automatic visual, remote alarms, and motion-artifacts as a result of detected motion as follows:
 - a. Motion-detection settings shall include adjustable object size and velocity, as well as a selectable detection area of 132 zones in a twelve (12) x eleven (11) grid.
 - b. Sensors shall accept video signals from CCTV cameras and when synchronizing is required, it shall be in composite synchronization.
 - c. Sensor processors shall detect motion by digitizing multiple pixels within each video scene and by comparing the gray scale of

the pixels to a previously stored reference. The number of pixels digitized depends on the application. The designer of the system shall consider cost effectiveness as a factor since digitizing a large number of pixels could increase cost dramatically with little additional actual detection capability for a specific application.

- d. An alarm shall be initiated when the comparison varies by six (6) percent or more.
8. Appropriate signage shall be designed, provided, and posted that notifies people that an area is under camera surveillance.
9. Dummy or fake cameras will not be utilized at any time.
10. Shall be programmed to digitally flip from color to black and white at dusk and vise versa at dawn.
11. Will be fitted with auto-iris lenses to ensure the image is maintained in low light.
12. Lightning protection shall be IEEE C62.41 compliant and provided for all cameras. Either surge protectors or a lightning grid may be utilized. Ensure all lightning protection equipment is compliant with Article 780 of the National Electrical Code (NEC). The use of Fuses and Circuit Breakers as a means of lightning protection shall not be allowed.
13. If using the camera as part of a CCTV network a video encoder shall be used to convert the signal from National Television System(s) Committee (NTSC) to Moving Picture Experts Group (MPEG) format.
14. P/T/Z cameras shall be utilized in a manner that they compliment fixed cameras and shall not be used as a primary means of monitoring activity.
15. Fixed Color Cameras Technical Characteristics:

Imaging Device	1/3-inch interline transfer CCD
Picture Elements	NTSC 510 (H) x 492 (V)
Scanning System	NTSC 525 lines, 21 interlace
Synchronization System	AC line lock/internal
Horizontal Resolution	330 TV lines
Iris Control	Selectable on/off
Electronic Shutter Range	NTSC 1/60-1/100,000 second
Auto Iris Lens Type	DC/video drive (auto sensing)
Minimum Illumination	0.6 lux

Signal to Noise Ratio	>50 dB
Automatic Gain Control	On/off switchable
Backlight Compensation	On/off switchable
Auto White Balance	On/off switchable
Video Output	1 Vp-p, 75 ohms
Power Consumption	Less than 5 watts
Video Connector	BNC
Lens Mount	C/CS mount (adjustable)

16. P/T/Z Cameras Technical Characteristics:

Effective Pixels	768 (H) x 494 (V)
Scanning Area	1/4-type CCD
Synchronization	Internal/Line-lock/Multiplexed Vertical Drive (VD2)
Video Output	1.0 v[p-p] NTSC composite/75 ohm
H. Resolution	570-line at B/W, or 480-line at color imaging
Signal-to-noise Ratio	50dB (AGC off, weight on)
Super Dynamic II	64 times (36dB) (selectable on/off)
Minimum Illumination	0.06 lx (0.006 fc) at B/W, 1 lx(0.1 fc)
Zoom Speed	Approx. 2.1s (TELE/WIDE) in sequence mode
Focus Speed	Approx. 2s (FAR/NEAR) in sequence mode
Iris	Automatic (Open/Close is possible)/manual
Maximum Aperture Ratio	1:1.6 (Wide) ~ 3.0 (Tele)
Focal Length	3.79 ~ 83.4 mm
Angular Field of View	H 2.6° ~ 51.7° V 2.0° ~ 39.9°
Electronic Shutter	1/60 (off), 1/100, 1/250, 1/500, 1/1,000, 1/2,000, 1/4,000, 1/10,000 s
Zoom Ratio	Optical 22x w/10x electronic zoom
Iris Range	F1.6 ~ 64, Close

Panning Range	360° endless
Panning Speed	Manual: Approx. 0.1°/s ~ 120°/s 16 steps
Tilting Range	0 ~ 90° (Digital Flip off), 0 ~180° (Digital Flip on)
Tilting Speed	Manual: Approx. 0.1°/s ~ 120°/s. 16 steps
Pan/Tilt	Manual/Sequential position/Auto Pan
Controls	Pan/Tilt, Lens, 64 Preset Positions, Home Position
Video Connector	BNC
Controller I/F	Multiplex-coaxial

17. Power over Ethernet (PoE) Cameras

- a. Shall be IEEE 802.3af compliant only be utilized as part of a CCTV Network and should not be integrated with standard analog or digital CCTV System equipment.
- b. Shall be utilized for interior and exterior purposes.
- c. A Category (CAT)-V cable will be the primary source for carrying signals up to 300 ft. (100 m) from a switch hub or network server. If any camera is installed greater than 300 ft. (100 m) from the controlling device then the following will be required:
 - 1) A local or remote 12 VDC or 24 VAC power source will be required from a Class 2, UL compliant power supply.
 - 2) A signal converter will be required to convert from a CAT-V cable over to a fiber optic or standard signal cable. The signal will need to be converted back to a CAT-V cable at the controlling device using a signal converter card.
- d. Shall:
 - 1) Be routed to a controlling device via a network switcher or direct connection to a network server.
 - 2) Be of hybrid design with both an Internet Protocol (IP) output and a monitor video output which produces a picture equivalent to an analog camera, and allows simultaneous output of both.

- 3) Provide at a minimum 200,000 effective pixels with built-in complementary color filter for accurate color with no image lag or distortion.
- 4) Be a programmable IP address that allows for installation of multiple units in the same Local Area Network (LAN) environment.
- 5) Incorporate a minimum of Transmission Control Protocol (TCP)/IP, User Datagram Protocol (UDP), Hypertext Transfer Protocol (HTTP), File Transfer Protocol (FTP), Internet Control Message Protocol (ICMP), Address Resolution Protocol (ARP), Real-Time Transport Protocol (RTP), Dynamic Host Configuration Protocol (DHCP), Network Time Protocol (NTP), Simple Mail Transfer Protocol (SMTP), Internet Group Management Protocol (IGMP), and Differentiated Service Code Point (DSCP) protocols for various network applications.

e. Technical Characteristics:

Video Standards	MPEG-4; M-JPEG
Video Data Rate	9.6 Kbps - 6 Mbps Constant & variable
Image Resolution	768x494 (NTSC)
Video Resolution	704 x 576/480 (4CIF: 25/30 IPS) 704 x 288/240 (2CIF: 25/30 IPS) 352 x 288/240 (CIF: 25/30 IPS) 176 x 144/120 (QCIF: 25/30 IPS)
Select Frame Rate	1-25/30 IPS (PAL/NTSC); Field/frame based coding
Network Protocols	RTP, Telnet, UDP, TCP, IP, HTTP, IGMP, ICMP
Software Update	Flash ROM, remote programmable
Configuration	Via web browser, built-in web server interfaces
Video Out	1x Analog composite: NTSC or PAL; BNC connector 75 Ohm
Sensitivity	1 0.65 lux (color) 0.26 lux

	(NightSense)
Minimum Illumination	0.30 lux (color) 0.12 lux (NightSense)
Video Signal-to-Noise Ratio	50 dB
Video Signal Gain	21 dB, (max) Electronic Shutter Automatic, up to 1/150000 sec. (NTSC)
Alarm In	Automatic sensing (2500 - 9000 K)
Input Voltage	+5 V nominal, +40 VDC max VDC: 11-36 V (700 mA) VAC: 12-28 V (700 mA) PoE: IEEE 802.3af compliant

18. Wireless Cameras

- a. Prior to installation of any wireless camera, ensure operating frequency is given full approval by the VA controlling authority. Wireless cameras shall be utilized as either part of a CCTV network or a standard analog system.
- b. Power for a wireless camera will be 110 VAC tied into a dedicated circuit breaker on a power panel that is dedicated to the security system and is fed from a power source with back-up in the event primary power to the CCTV System is lost. Power will be run to the camera and connected at both ends in accordance with Division 26 of the VA Master Specification and the VA Electrical Manual. In addition, wireless systems are line of sight dependant and all considerations for environmental layout must be taken into consideration prior to design, engineering, and installation of this type of camera system. Proximity to transmitting and receiving devices, cell phone towers, and any and all electrical devices can also cause interference with the camera signal and must be considered in advance.
- c. Shall be located within a minimum of one quarter of a mile from the receiving unit. Repeaters shall be used as required to ensure the strongest possible signal between transmitters and receivers.

- d. Shall be Federal Communication Commission (FCC) approved and compliant.
- e. If using wireless cameras, the following equipment shall be utilized to ensure operation of the system:
 - 1) Receiver
 - 2) Receiver antenna as required
 - 3) Repeater as required
 - 4) Mounting Hardware
- f. Receivers shall only handle up to four (4) cameras per unit.
- g. Technical Characteristics
 - 1) Wireless Cameras:

Imaging Device	1/3-inch interline transfer CCD
Picture Elements	NTSC 510 (H) x 492 (V)
Sensing Area	6 mm diagonal
Scanning System	NTSC 525 lines, 21 interlace
Synchronization System	AC line lock/internal
Horizontal Resolution	330 TV lines
Iris Control	Selectable on/off
Electronic Shutter Range NTSC	1/60-1/100,000 second
Frequency range	2.41-2.47GHz
Modulation	FM
Video signal/noise ratio	48dB
Audio signal/noise ratio	45db
Minimum Illumination	0.6 lux
Signal to Noise Ratio	>50 dB
Automatic Gain Control	On/off switchable
Backlight Compensation	On/off switchable
Auto White Balance	On/off switchable
Video Output	1 Vp-p, 75 ohms
Lens Mount	C/CS mount (adjustable)

2) Receivers

Frequency range	2.4-2.49GHz
Video output	1V P/P
Signal/noise ratio	38dB

C. Lenses: Shall be utilized in a manner that provides maximum coverage of the area being monitored by the camera. The lenses shall:

1. Be 1/3 inch to fit CCD fixed camera.
2. Be all glass with coated optics.
3. Have mounts that are compatible with the camera selected.
4. Be packaged and supplied with the camera.
5. Have a maximum f-stop of f/1.3 for fixed lenses, and a maximum f-stop of f/1.6 for variable focus lenses.
6. Be equipped with an auto-iris mechanism.
7. Have sufficient circle of illumination to cover the image sensor evenly.
8. Not be used on a camera with an image format larger than the lens is designed to cover.
9. Be provided with pre-set capability.

D. Two types of lenses shall be utilized for both interior and exterior fixed cameras:

1. Manual Variable Focus
2. Auto Iris Fixed

E. Manual Variable Focus:

1. Shall be utilized in large areas that are being monitored by the camera. Examples of this are perimeter fence lines, vehicle entry points, parking areas, etc.
2. Shall allow for setting virtually any angle of field, which maximizes surveillance effects.
3. Technical Characteristics:

Image format	1/3 inch
Focal length	5-50mm
Iris range	F1.4 to close
Focus range	1m (3.3 ft)
Back focus distance	10.05 mm (0.4 in)
Angle view Wide (1/3 in)	53.4 x 40.1
Angle view Tele (1/3 in)	5.3 x 4.1
Iris control	manual

Focus ctrl	manual
Zoom ctrl	manual

F. Auto Iris Fixed

1. Shall be utilized in areas where a small specific point of reference is to be monitored. Examples of this are doorways, elevators, cashier booths, etc.
2. To determine the exact size of the fixed lens required, complete a focal length calculation using either a focal length calculator or a focal length chart provided by the product manufacturer.
3. Technical Characteristics:

Image format	1/3 inch	1/3 inch	1/3 inch
Focal length	2.8 mm	4 mm	8 mm
Iris range	F1.2 - 200	F1.2 - 200	F1.2 - 200
Min. Object	0.3 m (1 ft)	0.3 m (1 ft)	0.3 m (1 ft)
Lens mount	CS-mount	CS-mount	CS-mount
Angle of view	94 X 72	64 X 49	33 x 25
Focus control	Manual	Manual	manual

G. Video Display Equipment

1. Will consist of color monitors and shall be EIA 375A compliant.
2. Shall be able to display analog, digital, and other images in either NTSC or MPEG format associated with the operation of the Security Management System (SMS).
3. Shall:
 - a. Have front panel controls that provide for power on/off, horizontal and vertical hold, brightness, and contrast.
 - b. Accept multiple inputs, either directly or indirectly.
 - c. Have the capabilities to observe and program the CCTV System.
 - d. Be installed in a manner that they cannot be witnessed by the general public.
4. Color Video Monitors Technical Characteristics:

Sync Format	PAL/NTSC
Display Tube	90° deflection angle

Horizontal Resolution	250 TVL minimum, 300 TVL typical
Video Input	1.0 Vp-p, 75 Ohm
Front Panel Controls	Volume, Contrast, Brightness, Color
Connectors	BNC

5. Liquid Crystal Display (LCD) Flat Panel Display Monitor

a. Technical Characteristics:

Sync Format	PAL/NTSC
LCD Panel	TFT LCD
Resolution	1280 x 1024 pixels; 500 TV
Contrast Ratio (CR)	500:1
Viewing Angle	140° horizontal, 130° vertical
Video Input	(CVBS) 1.0 Vp-p (0.5-1.5 Vp-p), 75 Ohm Y/C (S-video) 0.7 Vp-p, 0.3 Vp-p, 75 Ohm
Video 1	Composite video two (2) BNC (1 in, 1 out)
Video 2	Composite video two (2) BNC (1 in, 1 out)
Y/C (S-video)	two (2) mini-dins, 4-pin (1 in, 1 out)

H. Camera Housings and Mounts:

1. This section pertains to all interior and exterior housings, domes, and applicable wall, ceiling, corner, pole, and rooftop mounts associated with the housing. Housings and mounts shall be specified in accordance to the type of cameras used.
2. All cameras and lenses shall be enclosed in a tamper resistant housing. Any additional mounting hardware required to install the camera housing at its specified location shall be provided along with the housing.
3. The camera and lens contained inside the housing shall be installed on a camera mount. All additional mounting hardware required to

install the camera housing at its specified location shall be provided along with the housing.

4. Shall be manufactured in a manner that are capable of supporting a maximum of three (3) cameras with housings, and meet environmental requirements for the geographical area the camera support equipment is being installed on or within.
5. Environmentally Sealed
 - a. Shall:
 - 1) Be designed in manner that it provides a condensation free environment for correct camera operation.
 - 2) Operate in a 100 percent condensing humidity atmosphere.
 - 3) Be constructed in a manner that:
 - a) Has a fill valve to allow for the introduction of nitrogen into the housing to eliminate existing atmospheric air and pressurize the housing to create moisture free conditions.
 - b) Has an overpressure valve to prevent damage to the housing in the event of over pressurization.
 - c) Is equipped with a humidity indicator that is visible to the eye to ensure correct atmospheric conditions at all times.
 - d) The leak rate of the housing is not to be greater than 13.8kPa or 2 pounds per square inch at sea level within a 90 day period.
 - e) It shall contain camera mounts or supports as needed to allow for correct positioning of the camera and lens.
 - f) The housing and sunshield are to be white in color.
 - b. All electrical and signal cables required for correct operations shall be supplied in a hardened carrier system from the controller to the camera.
 - c. The mounting bracket shall be adjustable to allow for the housing weight of the camera and the housing unit it is placed in.
 - d. Accessibility to the camera and mounts shall be taken into consideration for maintenance and service purposes.
6. Indoor Mounts
 - a. Ceiling Mounts:
 - 1) This enclosure and mount shall be installed in a finished or suspended ceiling.

- 2) The enclosure and mount shall be fastened to the finished ceiling, and shall not depend on the ceiling tile grid for complete support.
- 3) Suspended ceiling mounts shall be low profile, and shall be suitable for replacement of 2 foot by 2 foot (610mm x 610mm) ceiling tiles.

b. Wall Mounts:

- 1) The enclosure shall be installed in manner that it matches the existing décor and placed at a height that it will be unobtrusive, unable to cause personal harm, and prevents tampering and vandalism.
- 2) The mount shall contain a manual pan/tilt head that will provide 360 degrees of horizontal and vertical positioning from a horizontal position, and has a locking bar or screw to maintain its fixed position once it has been adjusted.

7. Interior Domes

- a. The interior dome shall be a pendant mount, pole mount, ceiling mount, surface mount, or corner mounted equipment.
- b. The lower portion of the dome that provides camera viewing shall be made of black opaque acrylic and shall have a light attenuation factor of no more than 1 f-stop.
- c. The housing shall be equipped with integral pan/tilt capabilities complete with wiring, wiring harness, connectors, receiver/driver, pan/tilt control system, pre-position cards, or any other hardware and equipment as needed to fully provide a fully functional pan/tilt dome.
- d. The pan/tilt mechanism shall be:
 - 1) Constructed of heavy duty bearings and hardened steel gears.
 - 2) Permanently lubricated to ensure smooth and consistent movement of all parts throughout the life of the product.
 - 3) Equipped with motors that are thermally or impedance protected against overload damage.
- e. Pan movements shall be 360 degrees and tilt movement shall not be less than +/- 90 degrees.
- f. Pan speed shall be a minimum of 10 degrees per second.

8. Exterior Domes

- a. The exterior dome shall meet all requirements outlined in the interior dome paragraph above.

- b. The housing shall be constructed to be dust and water tight, and fully operational in 100 percent condensing humidity.

9. Exterior Wall Mounts

- a. Shall have an adjustable head for mounting the camera.
- b. Shall be constructed of aluminum, stainless steel, or steel with a corrosion-resistant finish.
- c. The head shall be adjustable for not less than plus and minus 90 degrees of pan, and not less than plus and minus 45 degrees of tilt. If the bracket is to be used in conjunction with a pan/tilt, the bracket shall be supplied without the adjustable mounting head, and shall have a bolt-hole pattern to match the pan/tilt base.
- d. Shall be installed at a height that allows for maximum coverage of the area being monitored.

10. Explosion Proof Housing

- a. This housing shall meet or exceed all requirements of NEMA four (4) standards for hazardous locations.
- b. It shall be supplied with the mounting brackets for the specified camera and lens.

I. Controlling Equipment

- 1. Shall be utilized to call up, operate, and program all cameras associated CCTV System components.
- 2. Will have the ability to operate the cameras locally and remotely. A matrix switcher or a network server shall be utilized as the CCTV System controller.
- 3. The controller shall be able to fit into a standard 19 inch (47.5 cm) equipment rack.
- 4. Control and programming keyboards shall be provided with its own type of switcher. All keyboards shall:
 - a. Be located at each monitoring station.
 - b. Be addressable for programming purposes.
 - c. Provide interface between the operator and the CCTV System.
 - d. Provide full control and programming of the switcher.
 - e. Have the minimum following controls:
 - 1) programming
 - 2) switching
 - 3) lens function
 - 4) P/T/Z

- 5) environmental housing
 - 6) annotation
5. Matrix Switcher: The matrix switcher shall meet the following minimum requirements:
- a. Take multiple camera inputs and route them to multiple monitoring stations.
 - b. Allow for centralized user management controlling configurations.
 - c. Provide live viewing of all cameras.
 - d. Provide P/T/Z, focus, and iris control of all unitized cameras.
 - e. Be expandable to allow for the addition of multiple cameras and monitoring stations over the life of the system visual identification system by utilizing input and output video and controller cards.
 - f. Input cards shall allow for the addition of a minimum of four (4) camera inputs per card.
 - g. Output cards shall allow for the addition of a minimum of eight (8) outputs per card.
 - h. Have the ability to be programmed either locally or remotely.
 - i. Remotely operate multiple cameras from multiple stations.
 - j. Be able to fully interface with a digital video recorder (DVR) for recording of all events.
 - k. Utilize RS-232 or fiber optic connections for integration with the SMS computer station via a remote port on a network hub.
 - l. Shall have an alarm interface that is compatible with all associated security subsystems. Alarm inputs shall be via either a relay or an EIA ANSI/EIA/TIA-232-F interface. The interface shall allow for a minimum of 24 alarm inputs and 12 alarm outputs.
 - m. The switcher response time to an alarm input shall not be less than 200 milliseconds from the time an alarm is sensed until a picture is displayed on a monitor.
 - n. The switcher shall have a built in buffer to allow for back-log of alarms. These alarms shall be viewable by an operator.
 - o. Be addressable in the event multiple matrix switchers are connected to the SMS.
 - p. Be configured, i.e. camera names, monitor names, sequences, alarms and alarm actions, etc. utilizing the configuration program and tools provided by the matrix manufacturer.

- q. The matrix switcher shall meet the following minimum input/output requirements:

Camera inputs	16
Video outputs	4
Keyboard/Controller Outputs	4
Alarm inputs	323

- r. The matrix switcher will have the following components and technical characteristics:

1) Main Unit:

Functions	Monitor control Camera selection, tour sequence, group sequence, group preset, OSD display, Camera/Receiver control via coaxial or RS-485 cable communication, Recorder control
Alarm control	Alarm event, Alarm Acknowledge, Alarm reset, Alarm suspension, Alarm History Display, Timer event, and Camera event
RS-485 (Camera) Port	6-conductor modular jack x 12 (2-wire or 4-wire communication, With termination switches (MODE 1 to 4))
Extension Port	6-conductor modular jack x 2 (With a (EXTENSION 1 IN, OUT) termination switch (TERM: ON, OFF))
Extension Port	37-pin D-sub connector x 2 (EXTENSION IN 2 or 3)
Extension Port	37-pin D-sub connector x 2 (EXTENSION OUT 2 or 3)

2) Input Board:

Camera Input	1 V [P-P]/75 Ohm (BNC), composite video signal 0.5 V [P-P]/75 Ohm data signal and 2.5 V [P-P]/75 Ohm (25 pin D sub connector x 4)
Alarm Input	N.O. (Normally Open contact) or N.C. (Normally Close contact) selectable x 32 (37 pin D sub connector)

3) Output Board:

Monitor Output	1 V [P-P]/75 Ohm (BNC)
Alarm Output	Open collector output x 32, Max. 24 VDC, 100 mA
Extension Port	6-conductor modular jack x 2
Serial Port	9-pin D-sub connector x 2

6. Network Server

- a. Allow for the transmission of live video, data, and audio over either an existing Ethernet network or a dedicated security system network, requiring an IP address or Internet Explorer 5.5 or higher, or shall work as an analog-to-Ethernet "bridge" controlling matrices, multiplexers, and pan/tilt/zoom cameras. The network shall operate in a box-to-box configuration allowing for encoded video to be decoded and displayed on an analog monitor.
- b. If a CCTV System network is going to be utilized as the primary means of monitoring, operating, and recording cameras then the following equipment shall be required as part of the system:
 - 1) System Server
 - 2) Computer Workstation
 - 3) Recording Device
 - 4) Encoder/Decoder
 - 5) Monitor
 - 6) Hub/Switch
 - 7) Router
 - 8) Encryptor
- c. Shall provide overall control, programming, monitoring, and recording of all cameras and associated devices within the CCTV System.
- d. All equipment on the network shall be IP addressable.
- e. The CCTV System network shall meet or exceed the following design and performance specifications:

- 1) Two MPEG-4 video streams for a total of 40 images per second will be provided.
 - 2) PC Software that manages the installation and maintenance of all hardware transmitters and receivers on the network shall be provided.
 - 3) Video Source that supports any NTSC video source to the computer network shall be addressed.
 - 4) Receivers that could be used to display the video on a standard analog NTSC or PAL monitor will be addressed.
- f. The system shall support the following network protocols:
- 1) Internet connections: RTP, Real Time Control Protocol (RTCP), UDP, IP, TCP, ICMP, HTTP, Simple Network Management Protocol (SNMP), IGMP, DHCP, and ARP.
 - 2) Video Display: MPEG-4, M-JPEG in server push mode only.
 - 3) Have the ability to adjust bandwidth, image quality and image rate.
 - 4) Support image sizes of either 704 x 576 pixels or 352 x 288 pixels.
 - 5) Have an audio coding format of G.711 or G.728.
 - 6) Provide a video frame rate of at least 30 images per second.
 - 7) Support LAN Interface Ethernet 10/100BaseT and be auto sensing.
 - 8) Have a LAN Data Rate of 9.6 Kbps to 5.0 Mbps.
 - 9) Utilize data interface RS-232/RS-422/RS-485.
- g. All connections within the system shall be via CAT-V cable and RJ-45 jacks. If analog equipment is used as part of the system, then either an encoder or a decoder will be utilized to convert the analog signal to a digital one.
- h. The CCTV network system shall conform to all VA agency wide security standards for administrator and operator use.
- i. Server Technical Characteristics:

Hardware	Personal Computer
CPU	Pentium IV, 3.0 GHz or better
Hard Disk Interface	IDE or better
RAM	256 MB
OS	Windows XP Home/XP Professional

Graphic Card	NVIDIA GeForce 6600 NVIDIA Quadro FX 1400 ATI RADEON X600/X800 or better
Ethernet Card	100 Mb
Software	DirectX 9.0c
Free Memory	120 MB

j. Network Switch Technical Characteristics

Protocol and standard	IEEE802.3 IEEE802.3u IEEE802.3ab
Ports	24 10/100/1000M auto-negotiation RJ-45 ports with auto MDI/MDI-X
Network media	Cat 5 UTP for 1,000Mbps Cat 3 UTP for 10Mbps
Transmission method	store-and-forward
LED	indicator power, act/link, speed

k. Router Technical Characteristics

Network Standards	IEEE 802.3, 802.3u 10Base-T Ethernet (WAN) 100Base-T Ethernet (LAN) IEEE 802.3x Flow Control IEEE802.1p Priority Queue ANS/IEEE 802.3 NWay auto-negotiation
Protocol	CSMA/CD, TCP, IP, UDP, PPPoE, AND DHCP (client and server)
VPN Supported	PPTP, IPSec pass-through
Management	Browser
Ports	4 x 10/100Base-T Auto sensing RJ45 ports, and an auto uplink RJ45port(s) 1 x 10Base-T RJ45 port, WAN
LEDs	Power, WAN Activity, LAN Link

	(10/100), LAN Activity
--	------------------------

1. Encryptor Technical Characteristics:

Cryptography	Standard - Triple DES 168-bit (ANSI 9.52) Rijndael - AES (128, 192, 256)
Performance	Throughput (end-to-end) @ 100 Mbps line speed: >188 Mbps full duplex (large frames) >200 kfps full duplex (small frames) Latency (end-to-end) @ 100 Mbps
Key Management	Automatic KEK/DEK Exchange Using Signed Diffie-Hellman Unit Authentication Using X.509 Certificates
Physical Interfaces	10BaseT or 10/100BaseT Ethernet (Host and Network Ports) 10BaseT Ethernet Management Port Back and Front-Panel Serial Control Port
Device Management	THALES Element Manager, Front Panel Viewer, and Certificate Manager 10Base T (RJ-45) or 9- pin Serial Control Port SNMP Network Monitoring
Security Features	Tamper Proof Cryptographic Envelope Tamper Evident Chassis Hardware Random Number Generator
Management	Channel Encrypted Using Same Algorithm as Data Traffic
Security Certification s	FIPS 140-2 Level 3 CAPS Baseline and Enhanced Grades Common Criteria EAL4 and EAL5 (under evaluation)
Regulatory	EN60950, FCC, UL, CE, EN 50082-1, and EN 55022

J. Recording Devices

1. All cameras on the CCTV System shall be recorded in real time using a Digital Video Recorder (DVR), Network Video Recorder (NVR), or a Time Lapse Video Recorder (VCR). The type of recording device utilized should be determined by the size and type of CCTV System designed and installed, and to what extent the system is to be utilized.
2. All recording devices shall be 19 inch (47.5 cm) rack-mountable.
3. All DVR's and NVR's that are viewable over an Intranet or Internet will be routed through an encryptor. Encryptors shall:
 - a. Comply with FIPS PUB 140-2.
 - b. Support TCP/IP.
 - c. Directly interfaces to low-cost commercial routers.
 - d. Provide packet-based crypto synchronization.
 - e. Encrypt source and destination IP addresses.
 - f. Support web browser based management requiring no additional software.
 - g. Have a high data sustained throughput – 1.544 Mbps (T1) full duplex data rate.
 - h. Provide for both bridging and routing network architecture support.
 - i. Support Electronic Key Management System (EKMS) compatible.
 - j. Have remote management ability.
 - k. Automatically reconfigure when secure network or wide area network changes.
4. Digital Video Recorder (DVR):
 - a. Shall record video to a hard drive-based digital storage medium in either NTSC or MPEG format.
 - b. Shall meet the following minimum requirements:
 - 1) Record at minimum rate of 30 images per second (IPS).
 - 2) Have a minimum of eight (8) to 16 looping inputs.
 - 3) Have a minimum of eight (8) to 16 alarm inputs and two (2) relay outputs.
 - 4) Shall provide instantaneous playback of all recorded images.
 - 5) Be IP addressable, if part of a CCTV network.

- 6) Have built-in digital motion detection with masking and sensitivity adjustments.
- 7) Provide easy playback and forward/reverse search capabilities.
- 8) Complete audit trail database, with minimum of a six-month history that tracks all events related to the alarm; specifically who, what, where and when.
- 9) DVR management capability providing automatic video routing to a back-up spare recorder in case of failure.
- 10) Accessible locally and remotely via the Internet, Intranet, or a personal digital assistant (PDA).
- 11) Records all alarm events in real time, ensuring 60 seconds before and after the event are included in the recording.
- 12) Utilize RS-232 or fiber optic connections for integration with the SMS computer station via a remote port on a network hub.
- 13) Allow for independently adjustable frame rate settings.
- 14) Be compatible with the matrix switcher utilized to operate the cameras. The DVR could be utilized as a matrix switcher only if it meets all of the requirements listed in the matrix switcher section.

c. Technical Characteristics:

Processor	Intel Pentium III 750 MHz
Memory	256 MB RAM
Operating System	Windows 98, NT, ME, 2000, and XP
Video Card	4 MB of RAM capable of 24-bit true color display
Free Hard Disk Space	160 MB for software installation
Network Card	10Base-T network for LAN operation
Archiving	80 GB, 160 GB, 320 GB and 640 GB Hard Drive; CD-RW
Video Input	1.0 Vpp (signal 714mV, sync 286mV) 75 ohms (BNC unbalanced)
Video Output Level	1.0 Vpp +/-10%, 75 ohms (BNC unbalanced)
Impedance	75 ohms/Hi- impedance x 16 switchable

Network Interface	Ethernet (RJ-45, 10/100M)
Network Protocol	TCP/IP, DHCP, HTTP, UDP
Network Capabilities	Live/Playback/P/T/Z control
Recording Rate	30 ips for 720 x 240 (NTSC)
Password Protection	Menu Setup, Remote Access
Recording Capacity	160 (1 or 2 fixed HDD) 1 CD-RW
Power Interrupt	Auto recovered to recording mode

5. Network Video Recorder (NVR)

- a. Shall record video to a hard drive-based digital storage medium in MPEG format.
- b. Shall meet the following minimum requirements:
 - 1) Record at minimum rate of 30 IPS.
 - 2) Have a minimum of eight (8) to 16 looping inputs.
 - 3) Have a minimum of eight (8) to 16 alarm inputs and two (2) relay outputs.
 - 4) Shall provide instantaneous playback of all recorded images.
 - 5) Be IP addressable, if part of a CCTV network.
 - 6) Have built-in digital motion detection with masking and sensitivity adjustments.
 - 7) Easy playback and forward/reverse search capabilities.
 - 8) Complete audit trail database, with minimum of a six-month history that tracks all events related to the alarm; specifically who, what, where and when.
 - 9) NVR management capability providing automatic video routing to a back-up spare recorder in case of failure.
 - 10) Accessible locally and remotely via the internet, intranet, or a personal digital assistant (PDA).
 - 11) Records all alarm events in real time, ensuring 60 seconds before and after the event are included in the recording.
 - 12) Utilize RS-232 or fiber optic connections for integration with the SMS computer station via a remote port on a network hub.

13) Allow for independently adjustable frame rate settings.

14) Be compatible with the matrix switcher utilized to operate the cameras.

c. Technical Characteristics:

Hardware/CPU	Pentium III Xeon or IV, 1.8 GHz
HDD Interface	IDE or better; optional: SCSI II, SCSI Ultra, or Fiber Channel
RAM	1024 MB
Operating System	Windows 2000/XP Professional/Server 2003 Standard
Graphic	Card VGA
Ethernet Card	100/1000 MB
Memory	20 MB
Software Setup	Centralized setup from each authorized PC; access via VIDOS or integrated web server
Storage Media	All storage media possible (e.g., HD, RAID), depending on operating system
Storage Mode	Linear mode, ring mode (capacity-based)
Recording Configuration	Camera name assignment, bandwidth limit, frame rate, video quality
Recording Content	Video and/or audio data
Search Parameters	Time, date, event
Playback	Playback via VIDOS over any IP network (LAN/WAN) simultaneous recording, playback, and backup
Network Interface	Ethernet (RJ-45, 10/100M)
Network Protocol	TCP/IP, DHCP, HTTP, UDP
Network Capabilities	Live/Playback/P/T/Z control
Recording Rate	30 ips for 720 x 240 (NTSC)
Password Protection	Menu Setup, Remote Access
Recording Capacity	160 (1 or 2 fixed HDD) 1 CD-RW
Power Interrupt	Auto recovered to recording mode

6. Time Lapse Video Recorder (VCR)

- a. Shall be specifically designed as a time lapse recorder within the CCTV System and shall meet the following minimum requirements:
- 1) Allow for repeat recording.
 - 2) Allow for series recording with multiple recorders.
 - 3) Be able to record Daily/Weekly/Holiday schedules.
 - 4) Jog/Shuttle for easy forward or reverse field playback.
 - 5) Search using alarm index, time and date, skip, counter memory stop.
 - 6) Have a built in time and date generator that can be turned on and off, and shall impose the time and date on the video during recording.
 - 7) Have a built in alarm that shall annunciate the end of tape, excessive condensation, transport malfunction, or tape jam.
 - 8) Have on-screen programming.
 - 9) Interface with the matrix switcher.
 - 10) Have automatic head cleaning.
 - 11) Have battery backup for internal settings.
 - 12) Have a tape use counter.
 - 13) Have a daylight saving time setting.
- b. Video tape used in the recorder shall:
- 1) Be contained in a cassette mechanism.
 - 2) Be self loading and not require the operator the thread the tape.
 - 3) Load through the front of the recorder.
 - 4) Be labeled with the date and times of coverage.
 - 5) Stored for a period not less then that specified in the VA CCTV standards.
- c. Shall be locally installed at the monitoring station.
- d. Technical Characteristics:

Tape Format	Standard 1/2 inch VHS
Video Recording Standard	6/8 Hour in NTSC
Time Lapse Recording	18/30/54/78/102/126/174 or 24/40/72/104/136/160/232 hour
Video Recording System	Rotary 2-head azimuth
Video Head Configuration	4-head double azimuth Tape

	Transport
Rewind/FF Speed	Within 120 seconds (with T-120 VHS tape)
Head Cleaning	Automatic
Record/Playback	Time Mode (EP) 6H, L18H, L30H, 48H, 72H, 96H, 0H
Horizontal Resolution	(SR Mode) 400 lines (VHS Mode) 240 lines
Video Input/Output	(BNC) 1.0 Vp-p, 75 Ohm
Audio System Record/Playback	6H, L18H, L30H
Timer Recording	8 event programmability
Display	Month/Day/Year and Time

K. Wires and Cables

1. Shall meet or exceed the manufactures recommendation for power and signal.
2. Will be carried in an enclosed conduit system, utilizing electromagnetic tubing (EMT) to include the equivalent in flexible metal, rigid galvanized steel (RGS) to include the equivalent of liquid tight, polyvinylchloride (PVC) schedule 40 or 80.
3. All conduits will be sized and installed per the NEC. All security system signal and power cables that traverse or originate in a high security office space will contained in either EMT or RGS conduit.
4. All conduit, pull boxes, and junction boxes shall be clearly marked with colored permanent tape or paint that will allow it to be distinguished from all other conduit and infrastructure.
5. Conduit fills shall not exceed 50 percent unless otherwise documented.
6. A pull string shall be pulled along and provided with signal and power cables to assist in future installations.
7. At all locations where there is a wall penetration or core drilling is conducted to allow for conduit to be installed, fire stopping materials shall be applied to that area
8. High voltage and signal cables shall not share the same conduit and shall be kept separate up to the point of connection. High voltage

for the security system shall be defined as any cable or sets of cables carrying 30 VDC/VAC or higher.

9. For all equipment that is carrying digital data between the Access Control System and Database Management or at a remote monitoring station, shall not be less than 20 AWG and stranded copper wire for each conductor. The cable or each individual conductor within the cable shall have a shield that provides 100% coverage. Cables with a single overall shield shall have a tinned copper shield drain wire.
10. All cables and conductors, except fiber optic cables, that act as a control, communication, or signal lines shall include surge protection. Surge protection shall be furnished at the equipment end and additional triple electrode gas surge protectors rated for the application on each wire line circuit shall be installed within three (3) ft. (one (1) m.) of the building cable entrance. The inputs and outputs shall be tested in both normal and common mode using the following wave forms:
 - a. A 10 microsecond rise time by 1000 microsecond pulse width waveform with a peak voltage of 1500 volts and peak current of 60 amperes.
 - b. An 8 microsecond rise time by 20 microsecond pulse width waveform with a peak voltage of 1000 volts and peak current of 500 amperes.
11. The surge suppression device shall not attenuate or reduce the video or sync signal under normal conditions. Fuses and relays shall not be used as a means of surge protection.
12. Coaxial Cables
 - a. All video signal cables for the CCTV System, with exception to the PoE cameras, shall be a coaxial cable and have a characteristic impedance of 75 ohms plus or minus 3 ohms.
 - b. For runs up to 750 feet use of an RG-59/U is required. The RG-59/U shall be shielded which provides a minimum of 95 percent coverage, with a stranded copper center conductor of a minimum 23 AWG, polyethylene insulation, and black non-conductive polyvinylchloride (PVC) jacket.
 - c. For runs between 750 feet and 1250 feet, RG-6/U is required. RG-6/U shall be shielded which provides a minimum of 95 percent coverage, with a stranded copper center conductor of a minimum 18

AWG, polyethylene insulation, and black non-conductive polyvinylchloride (PVC) jacket.

- d. For runs of 1250 to 2750 feet, RG-11/U is required. RG-11/U shall be shielded which provides a minimum of 95 percent coverage, with a stranded copper center conductor of a minimum 14 AWG, polyethylene insulation, and black non-conductive polyvinylchloride (PVC) jacket.
- e. All runs greater than 2750 feet will be substituted with a fiber optic cable. If using fiber optics as a signal carrier then the following equipment will be utilized:
 - 1) Multimode fiber optic cable a minimum size of 62 microns
 - 2) Video transmitter, installed at the camera that utilizes 12 VDC or 24 VAC for power.
 - 3) Video receiver, installed at the switcher.
- f. RG-59/U Technical Characteristics

AWG	22
Stranding	7x29
Conductor Diameter	.031 in.
Conductor Material	BCC
Insulation Material	Gas-injected FHDPE
Insulation Diameter	.145 in.
Outer Shield Type	Braid/Braid
Outer Jacket Material	PVC
Overall Nominal Diameter	.242 in.
UL Temperature Rating	75°C
Nom. Characteristic Impedance	75 Ohms
Nom. Inductance	0.094 μ H/ft
Nom. Capacitance	Conductor to Shield 17.0 pF/ft
Nom. Velocity of Propagation	80 %
Nom. Delay	1.3 ns/ft
Nom. Conductor DC Resistance @ 20°C	12.2 Ohms/1000 ft

Nom. Outer Shield DC Resistance @ 20°C	2.4 Ohms/1000 ft
Max. Operating Voltage	UL 300 V RMS

g. RG-6/U Technical Characteristics:

AWG	18
Stranding	7x27
Conductor Diameter	.040 in.
Conductor Material	BC
Insulation Material	Gas-injected FHDPE
Insulation Diameter	.180 in.
Outer Shield Material	Trade Name Duofoil
Outer Shield Type	Tape/Braid
Outer Shield %Coverage	100 %
Outer Jacket Material	PVC
Overall Nominal Diameter	.274 in.
Nom. Characteristic Impedance	75 Ohms
Nom. Inductance	0.106 μ H/ft
Nom. Capacitance	Conductor to Shield 16.2 pF/ft
Nom. Velocity of Propagation	82 %
Nom. Delay	1.24 ns/ft
Nom. Conductor DC Resistance	6.4 Ohms/1000 ft
Nominal Outer Shield DC Resistance @ 20°C	2.8 Ohms/1000 ft
Max. Operating Voltage	UL 300 V RMS

h. RG-11/U Technical Characteristics:

AWG	15
Stranding	19x27
Conductor Diameter	.064 in.
Conductor Material	BC
Insulation Material	Gas-injected FHDPE
Insulation Diameter	.312 in.
Inner Shield Type	Braid
Inner Shield Material	BC - Bare Copper
Inner Shield %Coverage	95 %
Inner Jacket Material	PE - Polyethylene
Inner Jacket Diameter	.391 in.
Outer Shield Type	Braid
Outer Shield Material	BC - Bare Copper
Outer Shield %Coverage	95 %
Outer Jacket Material	Trade Name Belflex
Outer Jacket Material	PVC Blend
Overall Nominal Diameter	.520 in.
Operating Temperature Range	-35°C To +75°C
Non-UL Temperature Rating	75°C
Nom. Characteristic Impedance	75 Ohms
Nom. Inductance	0.097 μ H/ft
Nom. Capacitance	Conductor to Shield 17.3 pF/ft
Nom. Velocity of Propagation	78 %
Nom. Delay	1.30 ns/ft
Nom. Conductor DC Resistance	3.1 Ohms/1000 ft
Nom. Inner Shield DC Resistance	1.8 Ohms/1000 ft
Nom. Outer Shield DC Resistance	1.4 Ohms/1000 ft
Max. Operating Voltage Non-UL	300 V RMS

13. Signal Cables:

- a. Signal wiring for PoE cameras depends on the distance the camera is being installed from either a hub or the server.
- b. If the camera is up to 300 ft from a hub or the server, then use a shielded UTP category 5 (CAT-V) cable with standard RJ-45 connector at each end. The cable will comply with the Power over Ethernet, IEEE802.3af, Standard.
- c. If the camera is over 300 ft from a hub or server then utilize a multimode fiber optic cable with a minimum size of 62 microns.
- d. Provide a separate cable for power.
- e. CAT-5 Technical Characteristics:

Number of Pairs	4
Total Number of Conductors	8
AWG	24
Stranding	Solid
Conductor Material	BC - Bare Copper
Insulation Material	PO - Polyolefin
Overall Nominal Diameter	.230 in.
IEC Specification	11801 Category 5
TIA/EIA Specification	568-B.2 Category 5e
Max. Capacitance Unbalance	(pF/100 m) 150 pF/100 m
Nom. Velocity of Propagation	70 %
Max. Delay	(ns/100 m) 538 @ 100MHz
Max. Delay Skew	(ns/100m) 45 ns/100 m
Max. Conductor DC Resistance	9.38 Ohms/100
Max. DCR Unbalance@ 20°C	3 %
Max. Operating Voltage	UL 300 V RMS

- f. Fiber Optic Cables Technical Characteristics:

Fiber Type	62.5 Micron
Number of Fibers	4
Core Diameter	2.5 +/- 2.5 microns

Core Non-Circularity	5% Maximum
Clad Diameter	125 +/- 2 microns
Clad Non-Circularity	1% Maximum
Core-clad Offset	1.5 Microns Maximum
Primary Coating Material	Acrylate
Primary Coating Diameter	245 +/- 10 microns
Secondary Coating Material	Engineering Thermoplastic
Secondary Coating Diameter	900 +/- 50 microns
Strength Member Material	Aramid Yarn
Outer Jacket Material	PVC
Outer Jacket Color	Orange
Overall Diameter	.200 in.
Numerical Aperture	.275
Maximum Gigabit Ethernet	300 meters
Maximum Gigabit Ethernet	550 meters

14. Power Cables

- a. Will be sized accordingly and shall comply with the NEC. High voltage power cables will be a minimum of three conductors, 14 AWG, stranded, and coated with a non-conductive polyvinylchloride (PVC) jacket. Low voltage cables will be a minimum of 18 AWG, stranded and non-conductive polyvinylchloride (PVC) jacket.
- b. Will be utilized for all components of the CCTV System that require either a 110 VAC 60 Hz or 220 VAC 50 Hz input. Each feed will be connected to a dedicated circuit breaker at a power panel that is primarily for the security system.
- c. All equipment connected to AC power shall be protected from surges. Equipment protection shall withstand surge test waveforms described in IEEE C62.41. Fuses shall not be used as a means of surge protection.

- d. Shall be rated for either 110 or 220 VAC, 50 or 60 Hz, and shall comply with VA Master Spec 26 05 21 Low Voltage Electrical Power Conductors and Cables (600 Volts and Below).
- e. Low Voltage Power Cables
 - 1) Shall be a minimum of 18 AWG, Stranded and have a polyvinylchloride outer jacket.
 - 2) Cable size shall determined using a basic voltage over distance calculation and shall comply with the NEC's requirements for low voltage cables.

2.3 INSTALLATION KIT

A. General:

- 1. The kit shall be provided that, at a minimum, includes all connectors and terminals, labeling systems, audio spade lugs, barrier strips, punch blocks or wire wrap terminals, heat shrink tubing, cable ties, solder, hangers, clamps, bolts, conduit, cable duct, and/or cable tray, etc., required to accomplish a neat and secure installation. All wires shall terminate in a spade lug and barrier strip, wire wrap terminal or punch block. Unfinished or unlabeled wire connections shall not be allowed. All unused and partially opened installation kit boxes, coaxial, fiber-optic, and twisted pair cable reels, conduit, cable tray, and/or cable duct bundles, wire rolls, physical installation hardware shall be turned over to the Contracting Officer. The following sections outline the minimum required installation sub-kits to be used:
- 2. System Grounding:
 - a. The grounding kit shall include all cable and installation hardware required. All head end equipment and power supplies shall be connected to earth ground via internal building wiring, according to the NEC.
 - b. This includes, but is not limited to:
 - 1) Coaxial Cable Shields
 - 2) Control Cable Shields
 - 3) Data Cable Shields
 - 4) Equipment Racks
 - 5) Equipment Cabinets
 - 6) Conduits
 - 7) Cable Duct blocks
 - 8) Cable Trays

- 9) Power Panels
 - 10) Grounding
 - 11) Connector Panels
3. Coaxial Cable: The coaxial cable kit shall include all coaxial connectors, cable tying straps, heat shrink tabbing, hangers, clamps, etc., required to accomplish a neat and secure installation.
 4. Wire and Cable: The wire and cable kit shall include all connectors and terminals, audio spade lugs, barrier straps, punch blocks, wire wrap strips, heat shrink tubing, tie wraps, solder, hangers, clamps, labels etc., required to accomplish a neat and orderly installation.
 5. Conduit, Cable Duct, and Cable Tray: The kit shall include all conduit, duct, trays, junction boxes, back boxes, cover plates, feed through nipples, hangers, clamps, other hardware required to accomplish a neat and secure conduit, cable duct, and/or cable tray installation in accordance with the NEC and this document.
 6. Equipment Interface: The equipment kit shall include any item or quantity of equipment, cable, mounting hardware and materials needed to interface the systems with the identified sub-system(s) according to the OEM requirements and this document.
 7. Labels: The labeling kit shall include any item or quantity of labels, tools, stencils, and materials needed to correctly label each subsystem according to the OEM requirements, as-installed drawings, and this document.
 8. Documentation: The documentation kit shall include any item or quantity of items, computer discs, as installed drawings, equipment, maintenance, and operation manuals, and OEM materials needed to correctly provide the system documentation as required by this document and explained herein.

PART 3

3.1 INSTALLATION

- A. System installation shall be in accordance with NECA 303, manufacturer and related documents and references, for each type of security subsystem designed, engineered and installed.
- B. Components shall be configured with appropriate "service points" to pinpoint system trouble in less than 30 minutes.
- C. The Contractor shall install all system components including Government furnished equipment, and appurtenances in accordance with the manufacturer's instructions, documentation listed in Sections 1.4 and

- 1.5 of this document, and shall furnish all necessary connectors, terminators, interconnections, services, and adjustments required for a complete and operable system.
- D. The CCTV System will be designed, engineered, installed, and tested to ensure all components are fully compatible as a system and can be integrated with all associated security subsystems, whether the system is a stand alone or a complete network.
- E. For integration purposes, the CCTV System shall be integrated where appropriate with the following associated security subsystems:
1. PACS:
 - a. Provide 24 hour coverage of all entry points to the perimeter and agency buildings. As well as all emergency exits utilizing a fixed color camera.
 - b. Record cameras on a 24 hours basis.
 - c. Be programmed go into an alarm state when an emergency exit is opened, and notify the Access Control System and Database Management of an alarm event.
 - d. For additional CCTV System requirements as they relate to the PACS, refer to Section 28 13 11, PHYSICAL ACCESS CONTROL SYSTEMS.
 2. IDS:
 - a. Provide a recorded alarm event via a color camera that is connected to the IDS system by either direct hardwire or a security system computer network.
 - b. Record cameras on a 24 hours basis.
 - c. Be programmed to go into an alarm state when an IDS device is put into an alarm state, and notify the.
 - d. For additional CCTV System requirements as they relate to the IDS, refer to Master Specification 28 16 11.
 3. Security Access Detection:
 - a. Provide full coverage of all vehicle and lobby entrance screening areas utilizing a fixed color camera.
 - b. Record cameras on a 24 hours basis.
 - c. The CCTV System should have facial recognition software to assist in identifying individuals for current and future purposes.
 - d. For additional CCTV System requirements as they relate to the Security Access Detection, refer to Master Specification 28 13 53.
 4. EPPS:

- a. Provide a recorded alarm event via a color camera that is connected to the EPPS system by either direct hardwire or a security system computer network.
 - b. Record cameras on a 24 hours basis.
 - c. Be programmed to go into an alarm state when an emergency call box or duress alarm/panic device is activated, and notify the Access Control System and Database Management of an alarm event.
 - d. For additional CCTV System requirements as they relate to the EPPS, refer to Master Specification 28 26 00.
- F. Integration with these security subsystems shall be achieved by computer programming or the direct hardwiring of the systems.
- G. For programming purposes refer to the manufacturers requirements for correct system operations. Ensure computers being utilized for system integration meet or exceed the minimum system requirements outlined on the systems software packages.
- H. A complete CCTV System shall be comprised of, but not limited to, the following components:
 - 1. Cameras
 - 2. Lenses
 - 3. Video Display Equipment
 - 4. Camera Housings and Mounts
 - 5. Controlling Equipment
 - 6. Recording Devices
 - 7. Wiring and Cables
- I. The Contractor shall visit the site and verify that site conditions are in agreement/compliance with the design package. The Contractor shall report all changes to the site or conditions that will affect performance of the system to the Contracting Officer's Technical Representative (COTR) in the form of a report. The Contractor shall not take any corrective action without written permission received from the COTR.
- J. Existing Equipment
 - 1. The Contractor shall connect to and utilize existing video equipment, video and control signal transmission lines, and devices as outlined in the design package. Video equipment and signal lines that are usable in their original configuration without modification may be reused with COTR approval.

2. The Contractor shall perform a field survey, including testing and inspection of all existing video equipment and signal lines intended to be incorporated into the CCTV System, and furnish a report to the COTR as part of the site survey report. For those items considered nonfunctioning, provide (with the report) specification sheets, or written functional requirements to support the findings and the estimated cost to correct the deficiency. As part of the report, the Contractor shall include a schedule for connection to all existing equipment.
 3. The Contractor shall make written requests and obtain approval prior to disconnecting any signal lines and equipment, and creating equipment downtime. Such work shall proceed only after receiving COTR approval of these requests. If any device fails after the Contractor has commenced work on that device, signal or control line, the Contractor shall diagnose the failure and perform any necessary corrections to the equipment.
 4. The Contractor shall be held responsible for repair costs due to Contractor negligence, abuse, or incorrect installation of equipment.
 5. The COTR shall be provided a full list of all equipment that is to be removed or replaced by the Contractor, to include description and serial/manufacture numbers where possible. The Contractor shall dispose of all equipment that has been removed or replaced based upon approval of the COTR after reviewing the equipment removal list. In all areas where equipment is removed or replaced the Contractor shall repair those areas to match the current existing conditions.
- K. Enclosure Penetrations: All enclosure penetrations shall be from the bottom of the enclosure unless the system design requires penetrations from other directions. Penetrations of interior enclosures involving transitions of conduit from interior to exterior, and all penetrations on exterior enclosures shall be sealed with rubber silicone sealant to preclude the entry of water and will comply with VA Master Specification 07 84 00, Firestopping. The conduit riser shall terminate in a hot-dipped galvanized metal cable terminator. The terminator shall be filled with an approved sealant as recommended by the cable manufacturer and in such a manner that the cable is not damaged.

- L. Cold Galvanizing: All field welds and brazing on factory galvanized boxes, enclosures, and conduits shall be coated with a cold galvanized paint containing at least 95 percent zinc by weight.
- M. Interconnection of Console Video Equipment: The Contractor shall connect signal paths between video equipment as specified by the OEM. Cables shall be as short as practicable for each signal path without causing strain at the connectors. Rack mounted equipment on slide mounts shall have cables of sufficient length to allow full extension of the slide rails from the rack.
- N. Cameras:
 - 1. Install the cameras with the focal length lens as indicated for each zone.
 - 2. Connect power and signal lines to the camera.
 - 3. Set cameras with fixed iris lenses to the f-stop to give full video level.
 - 4. Aim camera to give field of view as needed to cover the alarm zone.
 - 5. Aim fixed mounted cameras installed outdoors facing the rising or setting sun sufficiently below the horizon to preclude the camera looking directly at the sun.
 - 6. Focus the lens to give a sharp picture (to include checking for day and night focus and image quality) over the entire field of view; and synchronize all cameras so the picture does not roll on the monitor when cameras are selected. Dome cameras shall have all preset positions defined and installed.
- O. Monitors:
 - 1. Install the monitors as shown and specified in design and construction documents.
 - 2. Connect all signal inputs and outputs as shown and specified.
 - 3. Terminate video input signals as required.
 - 4. Connect the monitor to AC power.
- P. Switcher:
 - 1. Install the switcher as shown in the design and construction documents, and according to the OEM.
 - 2. Connect all subassemblies as specified by the manufacturer and as shown.
 - 3. Connect video signal inputs and outputs as shown and specified; terminate video inputs as required.

4. Connect alarm signal inputs and outputs as shown and specified; connect control signal inputs and outputs for ancillary equipment or secondary control/monitoring sites as specified by the manufacturer and as shown.
 5. Connect the switcher CPU and switcher subassemblies to AC power.
 6. Load all software as specified and required for an operational CCTV System configured for the site and building requirements, including data bases, operational parameters, and system, command, and application programs.
 7. Provide the original and 2 backup copies for all accepted software upon successful completion of the endurance test.
 8. Program the video annotation for each camera.
- Q. Video Recording Equipment:
1. Install the video recording equipment as shown in the design and construction documents, and as specified by the OEM.
 2. Connect video signal inputs and outputs as shown and specified.
 3. Connect alarm signal inputs and outputs as shown and specified.
 4. Connect video recording equipment to AC power.
- R. Video Signal Equipment:
1. Install the video signal equipment as shown in the design and construction documents, and as specified by the OEM.
 2. Connect video or signal inputs and outputs as shown and specified.
 3. Terminate video inputs as required.
 4. Connect alarm signal inputs and outputs as required.
 5. Connect control signal inputs and outputs as required
 6. Connect electrically powered equipment to AC power.
- S. Camera Housings, Mounts, and Poles:
1. Install the camera housings and mounts as specified by the manufacturer and as shown, provide mounting hardware sized appropriately to secure each camera, housing and mount with maximum wind and ice loading encountered at the site.
 2. Provide a foundation for each camera pole as specified and shown.
 3. Provide a ground rod for each camera pole and connect the camera pole to the ground rod as specified in Division 26 of the VA Master Specification and the VA Electrical Manual 730.
 4. Provide electrical and signal transmission cabling to the mount location via a hardened carrier system from the Access Control System and Database Management to the device.

5. Connect signal lines and AC power to the housing interfaces.
 6. Connect pole wiring harness to camera.
- T. System Start-Up
1. The Contractor shall not apply power to the CCTV System until the following items have been completed:
 - a. CCTV System equipment items and have been set up in accordance with manufacturer's instructions.
 - b. A visual inspection of the CCTV System has been conducted to ensure that defective equipment items have not been installed and that there are no loose connections.
 - c. System wiring has been tested and verified as correctly connected as indicated.
 - d. All system grounding and transient protection systems have been verified as installed and connected as indicated.
 - e. Power supplies to be connected to the CCTV System have been verified as the correct voltage, phasing, and frequency as indicated.
 2. Satisfaction of the above requirements shall not relieve the Contractor of responsibility for incorrect installation, defective equipment items, or collateral damage as a result of Contractor work efforts.
- U. Supplemental Contractor Quality Control
1. The Contractor shall provide the services of technical representatives who are familiar with all components and installation procedures of the installed CCTV System; and are approved by the COTR.
 2. The Contractor will be present on the job site during the preparatory and initial phases of quality control to provide technical assistance.
 3. The Contractor shall also be available on an as needed basis to provide assistance with follow-up phases of quality control.
 4. The Contractor shall participate in the testing and validation of the system and shall provide certification that the system installed is fully operational as all construction document requirements have been fulfilled.

3.2 TESTING AND TRAINING

All testing and training shall be compliant with the VA General Requirements, Section 01 00 00, GENERAL REQUIREMENTS.

11-09

-----END-----

SECTION 28 26 00
ELECTRONIC PERSONAL PROTECTION SYSTEM (EPPS)

PART 1 - GENERAL

1.1 DESCRIPTION

Provide and install complete Duress-Panic Alarms, Emergency Phones/
Call-Boxes, and Intercom Systems, hereafter referred to as EPPS System.

1.2 RELATED WORK

- A. For firestopping application and use, Section 07 84 00, FIRESTOPPING.
- B. For labeling and signs, Section 10 14 00, SIGNAGE.
- C. For parking equipment requirements, Section 11 12 00, PARKING CONTROL EQUIPMENT.
- D. For connections, Section 26 05 21, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES (600 VOLTS AND BELOW).
- E. For other communication systems, Section 27 05 11, REQUIREMENTS FOR COMMUNICATIONS INSTALLATIONS.
- F. For grounding of equipment, Section 27 05 26, GROUNDING AND BONDING FOR COMMUNICATIONS SYSTEMS.
- G. For infrastructure, Section 26 05 33, RACEWAY AND BOXES FOR ELCTRICAL SYSTEMS.
- H. For cabling requirements, Section 27 15 00, COMMUNICATIONS HORIZONTAL CABLING.
- I. For routing requirements, Section 27 31 00, VOICE COMMUNICATIONS SWITCHING AND ROUTING EQUIPMENT.
- J. For integration with PACS, Section 28 13 11, PHYSICAL ACCESS CONTROL SYSTEM (PACS).
- K. For integration with IDS, Section 28 16 11, INTRUSION DETECTION SYSTEM (IDS).
- L. For security cameras, Section 28 23 00, VIDEO SURVEILLANCE.
- M. For monitoring of equipment, Section 28 13 16, ACCESS CONTROL SYSTEM AND DATABASE MANAGEMENT.
- N. For Warranty of Construction see GENERAL CONDITIONS.
- O. For General Requirements, Section 01 00 00, GENERAL REQUIREMENTS.

1.3 QUALITY ASSURANCE

- A. The Contractor shall be responsible for providing, installing, and the operation of the EPPS System as shown. The Contractor shall also provide certification as required.
- B. The security system shall be installed and tested to ensure all components are fully compatible as a system and can be integrated with

all associated security subsystems, whether the security system is stand-alone or a part of a complete Information Technology (IT) computer network.

- C. The Contractor or security sub-contractor shall be a licensed security Contractor as required within the state or jurisdiction of where the installation work is being conducted.

1.4 SUBMITTALS

- A. Submit below items in conjunction with Master Specification Sections 01 33 23, SHOP DRAWING, PRODUCT DATA, AND SAMPLES, and Section 02 41 00, DEMOLITION.
- B. Provide certificates of compliance with Section 1.3, Quality Assurance.
- C. Provide a pre-installation and as-built design package in both electronic format and on paper, minimum size 48 x 48 inches (1220 x 1220 millimeters); drawing submittals shall be per the established project schedule.
- D. Pre-installation design and as-built packages shall include, but not be limited to:
 - 1. Index Sheet that shall:
 - a. Define each page of the design package to include facility name, building name, floor, and sheet number.
 - b. Provide a list of all security abbreviations and symbols.
 - c. Reference all general notes that are utilized within the design package.
 - d. Specification and scope of work pages for all security systems that are applicable to the design package that will:
 - 1) Outline all general and job specific work required within the design package.
 - 2) Provide a device identification table outlining device Identification (ID) and use for all security systems equipment utilized in the design package.
 - 2. Drawing sheets that will be plotted on the individual floor plans or site plans shall:
 - a. Include a title block as defined above.
 - b. Define the drawings scale in both standard and metric measurements.
 - c. Provide device identification and location.

- d. Address all signal and power conduit runs and sizes that are associated with the design of the electronic security system and other security elements (e.g., barriers, etc.).
 - e. Identify all pull box and conduit locations, sizes, and fill capacities.
 - f. Address all general and drawing specific notes for a particular drawing sheet.
3. A riser drawing for each applicable security subsystem shall:
- a. Indicate the sequence of operation.
 - b. Relationship of integrated components on one diagram.
 - c. Include the number, size, identification, and maximum lengths of interconnecting wires.
 - d. Wire/cable types shall be defined by a wire and cable schedule. The schedule shall utilize a lettering system that will correspond to the wire/cable it represents (example: A = 18 AWG/1 Pair Twisted, Unshielded). This schedule shall also provide the manufacturer's name and part number for the wire/cable being installed.
4. A system drawing for each applicable security system shall:
- a. Identify how all equipment within the system, from main panel to device, shall be laid out and connected.
 - b. Provide full detail of all system components wiring from point-to-point.
 - c. Identify wire types utilized for connection, interconnection with associate security subsystems.
 - d. Show device locations that correspond to the floor plans.
 - e. All general and drawing specific notes shall be included with the system drawings.
5. A schedule for all of the applicable security subsystems shall be included. All schedules shall provide the following information:
- a. Device ID.
 - b. Device Location (e.g. site, building, floor, room number, location, and description).
 - c. Mounting type (e.g. flush, wall, surface, etc.).
 - d. Power supply or circuit breaker and power panel number.
6. Detail and elevation drawings for all devices that define how they were installed and mounted.

- E. Pre-installation design packages shall be reviewed by the Contractor along with a VA representative to ensure all work has been clearly defined and completed. All reviews shall be conducted in accordance with the project schedule. There shall be four (4) stages to the review process:
 - 1. 35 percent
 - 2. 65 percent
 - 3. 90 percent
 - 4. 100 percent
- F. Provide manufacturer security system product cut-sheets. Submit for approval at least 30 days prior to commencement of formal testing, a Security System Operational Test Plan. Include procedures for operational testing of each component and security subsystem, to include performance of an integrated system test.
- G. Submit manufacture's certification of Underwriters Laboratories, Inc. (UL) listing as specified. Provide all maintenance and operating manuals per the VA General Requirements, Section 01 00 00, GENERAL REQUIREMENTS.

1.5 PUBLICATIONS

- A. The publications listed below (including amendments, addenda, revisions, supplement, and errata) form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American National Standards Institute (ANSI):
 - ANSI S3.2-99.....Method for measuring the Intelligibility of
Speech over Communications Systems
- C. Department of Justice American Disability Act (ADA)
 - 28 CFR Part 36.....ADA Standards for Accessible Design
- D. National Fire Protection Association (NFPA):
 - 70-05.....National Electrical Code
- E. National Electrical Manufacturers Association (NEMA)
 - 250-03.....Enclosures for Electrical Equipment (1000 Volts
Maximum)
- F. Underwriters Laboratories, Inc. (UL):
 - 305-00.....Standard for Panic Hardware
 - 444-02.....Communications Cables
 - 636-95.....Standard for Holdup Alarm Units and Systems
- G. Uniform Federal Accessibility Standards (UFAS), 1984

1.6 WARRANTY OF CONSTRUCTION.

Warrant EPPS System work subject to the Article "Warranty of Construction" of FAR clause 52.246-21.

PART 2 - PRODUCTS**2.1 EQUIPMENT AND MATERIALS****A. General:**

1. All equipment shall be rated for continuous operation.
Environmental conditions (i.e. temperature, humidity, wind, and seismic activity) shall be taken under consideration at each facility and site location prior to installation of the equipment.
2. All equipment shall operate on a 120 Volts alternating current (VAC); 60 Hz Alternating Current (AC) power system unless documented otherwise in subsequent sections listed within this spec. All equipment shall have a battery back-up source of power that will provide 12 hours (hrs.) of run time in the event of a loss of primary power to the security systems until a backup generator comes on-line.
3. The EPPS systems shall be designed, installed, and programmed in a manner that will allow for easy of operation, programming, servicing, maintenance, testing, and upgrading of the system.
4. All EPPS components located in designated "HAZARDOUS ENVIRONMENT" areas where fire or explosion could occur due to the presence of natural gases or vapors, flammable liquids, combustible residue, or ignitable fibers or debris, shall be rated Class II, Division I, Group F, and installed in accordance with National Fire Protection Association (NFPA) 70, National Electrical Code Chapter 5.
5. The Contractor shall provide the Contracting Officer with written verification, that the type of wire/cable being provided is recommended and approved by the OEM. Cabling shall meet the interconnecting wiring requirements of NFPA 70, National Electrical Code. The Contractor is responsible for providing the correct protection cable duct and/or conduit and wiring.
6. When interfacing with other communications or security subsystems the Contractor shall utilize interfacing methods that are approved by the Contracting Officer. At a minimum, an acceptable interfacing method requires not only a physical and mechanical connection; but also a matching of signal, voltage, and processing levels with

regard to signal quality and impedance. The interface point must adhere to all standards described herein.

7. Systems shall be scaleable, not vendor specific, and allow expansion as required.
8. Wireless systems shall use ultrasonic, infrared and radio frequency waves to link distributed transmitters and receivers. Specific characteristics of particular facility will determine best application. Contractor is responsible for determining best system using prediction program to determine where readable signals can be obtained and identify "dead spots".
9. All hardwired alarms, switches, and junction boxes shall be protected from tampering and include line supervision.
10. The installation and placement of intercom units and emergency-call boxes in strategic locations shall also require that signage be posted near these devices. The signage, in accordance with Section 10 14 00, SIGNAGE shall communicate the location of the device and its unique identification number, and brief instruction on how to access/use the device. The signage may appear on the device, on a pole or wall near the device location and shall be printed in a manner that is easily read during daylight and hours of darkness.

2.2 EQUIPMENT ITEMS

- A. All systems shall be designed to provide continuous electrical supervision of the complete and entire system.
- B. Noise filters and surge protectors shall be provided for all intercommunications equipment to ensure protection from primary AC power surges and to ensure noise interference is not induced into low voltage data circuits.
- C. All alarm and initiating and signaling circuits shall be supervised for open circuits, short circuits, and system grounds. Main and Uninterrupted Power Supply (UPS) power circuits shall be supervised for any change in operating conditions (e.g. low battery, primary to back up battery, and UPS online). When an open, short or ground occurs in any system circuit, an audible and visual fault alarm signal shall be initiated at the master control station and all remote locations.
- D. Control Unit: Shall consist of the components to constantly monitor and verify alarm activation; identify zone of activation and location of activation.

- E. Audible Signal Device for Duress-Panic: Provides alarm activation and audible sound for alarms, as well as supervisory and trouble signals that shall be distinctive.
- F. Assessment: This capability shall consist of electronic devices required to visually and audibly verify the validity of alarms. Assessment also includes providing indication of tampering, fail-safe, low battery, and power losses.
- G. Alarm Monitoring and Reporting: Shall annunciate information to at least two (2) separate locations. The alarms shall maintain the capability to respond with local and remote visible and audible signals upon activation of an alarm. The alarms shall have the capability of operating in a silent mode, alerting personnel monitoring the system that the device has been activated.
- H. The intercom and emergency call-box systems shall be provided with normally acceptable speech intelligibility, defined as a score of at least 70% in accordance with ANSI S3.2
- I. Master Stations for Emergency Call Box and Security Intercoms:
 - 1. All master stations shall have a "call-in" switch to provide an audible and visual indication of incoming calls from remote stations. Individual visual indication shall identify the calling station and status, and remain actuated until a call is answered by a master station.
 - 2. Master stations shall be equipped with a handset with a switch for private conversations.
 - 3. Intercom master stations shall also have an all-call feature, and have the ability to receive video from a video intercom unit.
 - 4. Master stations shall have the capability to selectively communicate with any remote station by actuating assigned station number on a keypad or select button for that station.
 - 5. Master stations may be standalone or can be integrated with the Access Control System and Database Management. The Contractor will be responsible for the integration of the Master station with the Access Control System and Database Management in accordance with OEM instructions and Section 28 13 16, ACCESS CONTROL SYSTEM AND DATABASE MANAGEMENT.
- J. Duress-Panic Alarms:

1. Housing shall be a rugged corrosion-resistant housing of stainless steel or Acrylonitrile Butadiene Styrene (ABS) molded plastic or similar material that is weather and dust proof.
2. Actuating device shall include a minimum of a plunger button whose head is recessed from the face/front edge of the housing and be designed to avoid accidental activation using switch guard or multiple buttons (i.e., requires pressing two (2) buttons simultaneously)
3. Wireless stationary devices will meet the same specifications as Personal Duress/Panic Alarms.
4. Alarm switch/button shall lock-in upon activation until manually reset with key or manufacture provided device.
5. The switch shall be a positive-acting, double-pole, and double-throw switch.
6. Duress/Panic alarms shall meet UL 305 Standard for Panic Alarms. To reduce the possibility of false alarms and ensure installation functionality UL 636 Standard for Holdup Alarms standards shall be met.
7. Alarms used for concealed application requires silent alarm notification to a monitoring station. They shall annunciate at the Access Control System and Database Management, monitored by a central station or direct connect to local police, depending on local ordinance requirements.
8. Shall be capable of being mounted for hand or foot use in a manner that is unable to be viewed by the public. Larger systems use a computer that intercepts and processes alarms and displays them on a monitor. The central computer can make an announcement over facility hand held radios, pagers or telephones, or at the Access Control System and Database Management so that the other security personnel can be immediately notified. These systems shall be hardwired.
9. Components:
 - a. Transmitter
 - b. Locator subsystem
 - c. Receiver
 - d. Software
10. Wiring will be four (4) conductor #18 American Wire Gauge (AWG).
11. Duress-Panic Alarm Technical Characteristics:

Temperature Range	0° to 110°F (-17.8°C to 43.3°C)
Nominal Voltage	12 V DC @ 6 mA
Current	Max 8 mA
Operational Voltage	7 V DC to 15 V DC
Operational life	Rated for 0,000 activations
Battery Activations	500
Actuator	Dual button plunger with activation lock
LED	Bi-color - on and activated

K. Personal Duress-Panic Alarm:

1. These systems are wireless only and can be worn as a belt clip, with a neck lanyard or with a wrist band. These alarms can be either active (manually operated) or passive mode (if detached from body, or body position changes to a prone position) alarm activates. They also provide identification of individual and location.
2. Components:
 - a. Transmitter
 - b. Repeaters (for wireless and increase distance)
 - c. Locator subsystem
 - d. Receiver
 - e. Software
3. Wireless transmitters shall send a periodic check in signal to the main computer or processor. If the signal is not received according to a definable time window, a supervisory alert will be generated. Wireless devices shall report a low battery condition well in advance to the failure of the battery.
4. Shall consist of a compact lightweight transmitter enclosed in a durable fire-retardant ABS plastic case that can be easily worn.
5. Transmitters may use ultrasonic, radio frequency (RF), or infrared (IR) to transmit signals. Each has advantages and disadvantages. Selection of system shall be dependent on defined usage and range of communications required.
6. Sensors shall be adjustable to activate automatically when mounted on a belt and the user is in a horizontal position for longer than

one (1) to fifteen (15) minutes. Adjustment capability shall not be accessible to personnel wearing the panic alarm device.

7. Radio frequencies for transmitter will comply with Federal Communication Commission (FCC) regulations.
8. Radio frequency transmitters will use frequency modulation signal hopping.
9. Personal Duress-Panic Alarm Technical Characteristics:

Temperature Range	0° to 110°F (-17.8°C to 43.3°C)
Nominal Voltage	12 V DC @ 6 mA
Current	Max 8 mA
Operational Voltage	7 V DC to 15 V DC
Battery Life	Regular battery 60 hour duration or Nickel-Metal Hydride (NiMH) rechargeable 12 hrs. 20 hr. per charge
Battery Lifespan	500 activations
Actuator	Plunger with activation lock
LED	Bi-color - on and activated
Passive Activation	Adjustable Prone position 1-15 minutes

L. Emergency Call Box Enclosures:

1. Consist of remote call stations, master station and a telephone Private Branch Exchange (PBX). They shall have two-way voice communications. Calls are directed to a pre-programmed extension. These systems are effective for a multi-facility environment or stand-alone facility with a parking structure or large parking lot. In addition, they may contain built-in CCTV system capabilities or can be integrated to work with standalone CCTV systems.
2. Emergency Call Boxes will be housed in an National Electric Manufacturers Association (NEMA) 250 Enclosures for Electrical Equipment compliant enclosures. Call-box enclosure shall include blue light/or similar strobe mounted behind or on top of the call box: A blue light or color lit strobe shall be activated (e.g. to

inform others visually that assistance is required) when the emergency switch/button/phone is pressed/taken off-hook and shall flash for the duration of a call.

3. The faceplate shall be constantly lit by ultra bright LEDs.
4. Enclosure and bracket system shall be designed to resist extreme weather conditions and constructed of weather resistant stainless steel.
5. Emergency Call Box Enclosure Technical Characteristics:

Construction	Minimum 11 gauge stainless steel Impact resistant polycarbonate window for lights
Mounting	Wall, pole or kiosk
Power	120 VAC: 44 Watts Maximum or 24 VDC: 18 Watts Maximum
Lighting	Strobe: 1.5 million candlepower 70 flashes per minute. Blue Light: 7 watt high efficiency 10,000 hour compact fluorescent. Faceplate Light: Ultra bright LEDs 100,000 hour lifetime.

M. Emergency Call Boxes:

1. Emergency Call Box shall be indoor/outdoor-rated, Uniform Federal Accessibility Standards (UFAS) and Americans with Disability Act (ADA) compliant, and provide hands-free usage. Phone shall also include cast metal raised letter and Braille signage for UFAS/ADA compliance.
2. Emergency Call Box shall include built-in auto-dialer that dials two (2) numbers: if first number doesn't answer, automatically dials a second number.
3. The System shall include auto-answer to allow for monitoring and initiating calls with an Emergency Phone.
4. Emergency Call Box shall use flush mount enclosure (FME,) shall include two (2) piece housing construction with full front lip to allow tight gasket seal between the speakerphone and enclosure. Screws shall be tamper free.

5. When activated the Emergency Call Box shall automatically place a call to the pre-programmed number(s). If the number is busy it should automatically call a second number.
6. The electronics enclosure shall be capable of using interchangeable faceplates: a single-button faceplate, a two-button faceplate, or a two-button faceplate with keypad.
7. The system shall use a "plain old telephone service" (POTS) line or analog PBX and shall be capable of integration with existing CCTV and Access Control System and Database Management via software at the SMS head-end.
8. Depending on distance and existing phone line capabilities, RF or use of wireless phone connections may be considered. The Contractor and Contracting Officer shall select appropriate system based on facility telecommunication system capabilities and desired system requirements.
9. Monitoring/Diagnostic capability at control and monitoring stations shall include the capability to automatically poll each Emergency Call Box, report incoming calls, identify location, and keep permanent records of all events with the use of a Windows based compatible software package and shall also meet the requirements of the Security Management System (SMS).
10. If speaker/handset stations are used, lifting the handset shall automatically cut out the loudspeaker in the station and all conversation shall be carried through the handset. Where noise does not exceed 55 dB, hands-free operations may be performed from distances up to 20 feet (ft.) (6.096 m). In higher noise environments only a talk-listen switch shall be utilized.
11. If system is a hardware type master station it shall be capable of:
 - a. LED display of identification code for emergency phones;
 - b. Indicate whether call was initiated by pushing button or by an auxiliary device;
 - c. Include RJ11 ports for connection to telephone line and standard telephone; and
 - d. Powered by 9 VDC, 500mA power supply that connects to 120 volt alternating current (VAC).
12. System shall include auto-answer to allow security to monitor and initiate calls with Emergency Call Box.

13. Contractor shall provide the capability to connect up to 8 phones on one (1) phone line while retaining ability to call each phone individually and without affecting performance. System shall also be able to create a closed system without need for any phone lines.
14. The System shall include the capability to record a message identifying the location of the caller.
15. It shall remotely be able to adjust speakerphone & microphone sensitivity.
16. Emergency Call Box Technical Characteristics:

Construction	12 gauge (2.8mm) #4 brushed stainless steel face plate
Operating Temperature	-4°F to +149°F (-20°C to +65°C)
Communication	2-way hands-free communication
Digital Capacity	Up to 18 digits, including pauses, for each of two (2) phone numbers
Dialing Speed	Minimum 10 tones per second
Power Source	Phone line powered (requires 20mA at 24 v off-hook)
Connection	Parallel tip and ring connected to RJ11 connector for quick installation
Memory	Erasable Programmable Read-only Memory (EPROM)
Circuit Protection	Lightening suppressed and full wave polarity guarded
Programming	Non-volatile EEPROM programming can be done from any telephone. No battery back-up needed
Wiring Requirements	1 twisted-shielded pair (gauge depends on distance)
Camera	Option for pin-hole color camera or Integration with existing CCTV
LED	Call confirmation

Activation	Sound or 1.5 in. minimum piezoelectric button
Labeling	"Push for Help" or "Emergency"

N. Strobes and Beacon:

1. Used for visual recognition of device activation once an emergency phone or intercom is activated. They provide unit identification and quick location of the caller.
2. Strobes and Beacons Technical Characteristics:

STROBE	
Input Voltage	10.5 - 28 VDC or VAC
Input Current	Average 1 amp
Input Current	Peak 3 amp
Intensity	1,000,000 candlepower
Control Circuit Output	2 mA max
Flash Rate	60 - 75 times per minute
BEACON	
Input Voltage	10.5 - 28 VAC or VDC
Input Current	@24.0 : 427 MA

O. Security Intercoms:

1. Shall be utilized to assist in controlling entry to a site, parking lot, facility, main and alternate entries, loading dock areas. They are also used for emergencies. These systems shall have both two-way voice communications and video (CCTV) capabilities built in. Intercoms may also have key-pads that allow for specific call connections or may provide a directory. These systems consist of both remote and master stations. Intercom shall be externally powered for distances over 1,500 feet (457.2 meters) (m) from the master control unit.
2. The Intercom shall be programmable from a remote location and have a three number dialing capability per activation button, or include a keypad for dialing authorized and published extensions.

3. The Intercom shall have an internally mounted electronics enclosure and auxiliary power.
4. The Contractor shall be responsible for integration of intercom with auxiliary output to electronic or magnetic door releases, as well as CCTV, as required.
5. Security Intercom Technical Characteristics:

Construction	12 gauge (2.8mm) #4 brushed stainless steel face plate
Operating Temperature	-4°F to +149°F (-20°C to +65°C)
Communication	2-way hands-free communication
Digital Capacity	Up to 18 digits, including pauses, for each of two (2) phone numbers
Dialing Speed	Minimum 10 tones per second
Power Source	Phone line powered or PBX
Connection	Parallel tip and ring connected to RJ11 connector for quick installation
Memory	EPROM
Circuit Protection	Lightening suppressed and full wave polarity guarded
Programming	Non-volatile EEPROM programming can be done from any telephone. No battery back-up needed
Wiring Requirements	1 twisted-shielded pair (gauge depends on distance)
Camera	Option for pin-hole color camera or Integration with existing CCTV
LED	Call confirmation
Activation	1.5 in. (38.1mm) minimum piezoelectric button
Labeling	"Information" or "Help"

2.3 INSTALLATION KIT

- A. General: A kit shall be provided that, at a minimum, includes all connectors and terminals, labeling systems, barrier strips, wiring blocks or wire wrap terminals, heat shrink tubing, cable ties, solder, hangers, clamps, bolts, etc., required to accomplish a neat and secure installation. Unfinished or unlabeled wire connections will not be allowed. Contractor shall turn over to the Contracting Officer all unused and partially opened installation kit boxes, coaxial cable reels, conduit, cable tray, and/or cable duct bundles, wire rolls, and physical installation hardware. This is an acceptable alternate to the individual spare equipment requirement as long as the minimum spare items are provided in this count. The following installation sub-kits are required as a minimum:
- B. System Grounding:
 - 1. The grounding kit shall include all cable in accordance with UL 444 Communications Cables, and installation hardware required. All grounding will be according to the NEC.
 - 2. This includes, but is not limited to:
 - a. Coaxial Cable Shields
 - b. Control Cable Shields
 - c. Data Cable Shields
 - d. Conduits
 - e. Cable Duct
 - f. Cable Trays
 - g. Power Panels
 - h. Connector Panels
- C. Coaxial Cable: The coaxial cable kit shall include all coaxial connectors, cable tying straps, heat shrink tabbing, hangers, clamps, etc., required to accomplish a neat and secure installation.
- D. Wire And Cable: The wire and cable kit shall include all connectors and terminals, barrier straps, wiring blocks, wire wrap strips, heat shrink tubing, tie wraps, solder, hangers, clamps, labels etc., required to accomplish a neat and orderly installation.
- E. Equipment Interface: The equipment interface kit shall include any item or quantity of equipment, cable, mounting hardware and materials needed to interface Systems and Subsystems according to the OEM requirements and this specification.

- F. Labels: The labeling kit shall include any item or quantity of labels, tools, stencils, and materials needed to label each subsystem according to the OEM requirements, as-installed drawings, and this specification.
- G. Documentation: The documentation kit shall include any item or quantity of items, computer discs, as installed drawings, equipment, maintenance, and operation manuals, and OEM materials needed to correctly provide the system documentation as required by this document and explained herein.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. System installation shall be installed in accordance with NFPA 731 Standards for the Installation of Electric Premises Security Systems and appropriate installation manual for each type of subsystem designed, engineered, and installed.
- B. The location and type of duress, intercom, or call-box to be installed will be in accordance with physical security requirements unique to each VA facility.
- C. For EPPS systems (i.e. use current panic/duress and emergency call boxes) that can operate through existing VA facility telephone system lines, software programming and hardware, refer to Section 27 51 23, INTERCOMMUNICATIONS AND PROGRAM SYSTEMS to integrate additional EPPS equipment.
- D. Concealed duress/panic devices shall be mounted in such a way that their location is only known by the person having knowledge of the activating device location. No wiring shall be exposed to identify the location of the activation device.
- E. Floor mounted duress alarms shall be attached to millwork on floor. When mounted under millwork, wiring shall be routed in millwork to conduit system via flexible conduit.
- F. Hard-wired switches shall be wired to individual alarm points within the Advanced Processing Controller (apC).
- G. Wall and post mounted stations shall be mounted to meet UFAS/ADA requirements and use tamper proof bolts and screws. Testing will be finished before installation of fasteners.
- H. Cleaning: Subsequent to installation, clean each system component of dust, dirt, grease, or oil incurred during installation in accordance to manufacture instructions.

- I. Provisions shall be made for systems in high-noise areas or areas with electrical interference environments.
- J. Adjustment/Alignment/Synchronization: Contractor shall prepare for system activation by following manufacturer's recommended procedures for adjustment, alignment, or programming. Prepare each component in accordance with appropriate provisions of the component's installation, operations, and maintenance instructions.

3.2 TESTS AND TRAINING

All testing and training shall be compliant with the VA General Requirements, Section 01 00 00, GENERAL REQUIREMENTS.

-----END-----

SECTION 28 31 00
FIRE DETECTION AND ALARM

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This section of the specifications includes the furnishing, installation, and connection of the fire alarm equipment to form a complete coordinated system ready for operation. It shall include, but not be limited to, alarm initiating devices, alarm notification appliances, control units, fire safety control devices, annunciators, power supplies, and wiring as shown on the drawings and specified.
- B. Fire alarm systems shall comply with requirements of NFPA 72 unless variations to NFPA 72 are specifically identified within these contract documents by the following notation: "variation". The design, system layout, document submittal preparation, and supervision of installation and testing shall be provided by a technician that is certified NICET level III or a registered fire protection engineer. The NICET certified technician shall be on site for the supervision and testing of the system. Factory engineers from the equipment manufacturer, thoroughly familiar and knowledgeable with all equipment utilized, shall provide additional technical support at the site as required by the Contracting Officer's Technical Representative (COTR) or his authorized representative. Installers shall have a minimum of two years experience installing fire alarm systems.
- C. Fire alarm signals:
 - 1. The new Building shall have an automatic digitized voice fire alarm signal with emergency manual voice override to notify occupants to evacuate. The digitized voice message shall identify the area of the building (smoke zone) from which the alarm was initiated.
 - 2. The new Building shall have a general evacuation fire alarm signal in accordance with ASA S3.41 to notify all occupants in the respective building to evacuate.
- D. Alarm signals (by device), supervisory signals (by device) and system trouble signals (by device not reporting) shall be distinctly transmitted to the main fire alarm system control unit located in the security office in the existing Medical Center.

- E. The main fire alarm control unit shall automatically transmit alarm signals to a listed central station using a digital alarm communicator transmitter in accordance with NFPA 72.

1.2 SCOPE

- A. A new fire alarm system shall be designed and installed in accordance with the specifications and drawings. Device location and wiring runs shown on the drawings are for reference only unless specifically dimensioned. Actual locations shall be in accordance with NFPA 72 and this specification.
 - 1. The existing buildings that are involved in this project are the new building and the existing Medical Center Building.
 - 2. Where doors are connected on magnetic door hold openers they shall be connected to the fire alarm system so that they close upon activation of the fire alarm system as specified within these specifications.
 - 3. Interface with the elevator shall be as indicated within these specifications (shut down and recall).
 - 4. Where fire alarm system is activated the HVAC system fans shall shut down for smoke control.
 - 5. Interface with fire sprinkler system shall be as specified in these specifications.
 - 6. Interface with door locking systems shall be provided so that when building is in alarm the egress doors automatically unlock.
 - 7. The new fire alarm system in the new building shall interface with the existing fire alarm system (main fire alarm control panel or fire command station) in the existing Medical Center. Provide new interface modules for the existing fire alarm system to make the connection. The interface between the new building and the fire department shall be through the existing fire command station in the existing Medical Center. Reprogram the existing fire alarm control panel in the Medical Center to include the new fire alarm system in the new building.
- B. Basic Performance:
 - 1. Alarm and trouble signals from each building fire alarm control panel shall be digitally encoded by UL listed electronic devices onto a multiplexed communication system.

2. Response time between alarm initiation (contact closure) and recording at the main fire alarm control unit (appearance on alphanumeric read out) shall not exceed five (5) seconds.
3. The signaling line circuits (SLC) between building fire alarm control units shall be wired Style 7 in accordance with NFPA 72. Isolation shall be provided so that no more than one building can be lost due to a short circuit fault.
4. Initiating device circuits (IDC) shall be wired Style C in accordance with NFPA 72.
5. Signaling line circuits (SLC) within buildings shall be wired Style 4 in accordance with NFPA 72. Individual signaling line circuits shall be limited to covering 22,500 square feet of floor space or 3 floors whichever is less.
6. Notification appliance circuits (NAC) shall be wired Style Y in accordance with NFPA 72.

1.3 RELATED WORK

- A. Section 01 00 00, GENERAL REQUIREMENTS: Restoration of existing surfaces.
- B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES: Procedures for submittals.
- C. Section 07 84 00, FIRESTOPPING: Fire proofing wall penetrations.
- D. Section 08 71 00, DOOR HARDWARE: Combination Closer-Holders.
- E. Section 09 91 00, PAINTING: Painting for equipment and existing surfaces.
- F. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: General electrical requirements for items which are common to other Division 26 sections.
- G. Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS: Conduits and boxes for cables/wiring.
- H. Section 26 05 21, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES (600 VOLTS AND BELOW: Cables/wiring.

1.4 SUBMITTALS

- A. General: Submit 4 copies and 1 reproducible in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES, and Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
- B. Drawings:
 1. Prepare drawings using AutoCAD Release 14 software and include all contractors information. Layering shall be by VA criteria as

provided by the COTR. Bid drawing files on AutoCAD will be provided to the Contractor at the pre-construction meeting. The contractor shall be responsible for verifying all critical dimensions shown on the drawings provided by VA.

2. Floor plans: Provide locations of all devices (with device number at each addressable device corresponding to control unit programming), appliances, panels, equipment, junction/terminal cabinets/boxes, risers, electrical power connections, individual circuits and raceway routing, system zoning; number, size, and type of raceways and conductors in each raceway; conduit fill calculations with cross section area percent fill for each type and size of conductor and raceway. Only those devices connected and incorporated into the final system shall be on these floor plans. Do not show any removed devices on the floor plans. Show all interfaces for all fire safety functions.
3. Riser diagrams: Provide, for the entire system, the number, size and type of riser raceways and conductors in each riser raceway and number of each type device per floor and zone. Show door holder interface, elevator control interface, HVAC shutdown interface, fire extinguishing system interface, and all other fire safety interfaces. Show wiring Styles on the riser diagram for all circuits. Provide diagrams both on a per building and campus wide basis.
4. Detailed wiring diagrams: Provide for control panels, modules, power supplies, electrical power connections, auxiliary relays and annunciators showing termination identifications, size and type conductors, circuit boards, LED lamps, indicators, adjustable controls, switches, ribbon connectors, wiring harnesses, terminal strips and connectors, spare zones/circuits. Diagrams shall be drawn to a scale sufficient to show spatial relationships between components, enclosures and equipment configuration.
5. Two weeks prior to final inspection, the Contractor shall deliver to the COTR one (1) set of reproducible, as-built drawings, two blue-line copies and one (1) set of the as-built drawing computer files (using AutoCAD Release 14 or later). As-built drawings (floor plans) shall show all new and existing conduit used for the fire alarm system.

C. Manuals:

1. Submit simultaneously with the shop drawings, companion copies of complete maintenance and operating manuals including technical data sheets for all items used in the system, power requirements, device wiring diagrams, dimensions, and information for ordering replacement parts.
 - a. Wiring diagrams shall have their terminals identified to facilitate installation, operation, expansion and maintenance.
 - b. Wiring diagrams shall indicate internal wiring for each item of equipment and the interconnections between the items of equipment.
 - c. Include complete listing of all software used and installation and operation instructions including the input/output matrix chart.
 - d. Provide a clear and concise description of operation that gives, in detail, the information required to properly operate, inspect, test and maintain the equipment and system. Provide all manufacturer's installation limitations including but not limited to circuit length limitations.
 - e. Complete listing of all digitized voice messages.
 - f. Provide standby battery calculations under normal operating and alarm modes. Battery calculations shall include the magnets for holding the doors open for one minute.
 - g. Include information indicating who will provide emergency service and perform post contract maintenance.
 - h. Provide a replacement parts list with current prices. Include a list of recommended spare parts, tools, and instruments for testing and maintenance purposes.
 - i. A computerized preventive maintenance schedule for all equipment. The schedule shall be provided on disk in a computer format acceptable to the VAMC and shall describe the protocol for preventive maintenance of all equipment. The schedule shall include the required times for systematic examination, adjustment and cleaning of all equipment. A print out of the schedule shall also be provided in the manual. Provide the disk in a pocket within the manual.
 - j. Furnish manuals in 3 ring loose-leaf binder or manufacturer's standard binder.

- k. A print out for all devices proposed on each signaling line circuit with spare capacity indicated.
- 2. Two weeks prior to final inspection, deliver four copies of the final updated maintenance and operating manual to the COTR.
 - a. The manual shall be updated to include any information necessitated by the maintenance and operating manual approval.
 - b. Complete "As installed" wiring and schematic diagrams shall be included that shows all items of equipment and their interconnecting wiring. Show all final terminal identifications.
 - c. Complete listing of all programming information, including all control events per device including an updated input/output matrix.
 - d. Certificate of Installation as required by NFPA 72 for each building. The certificate shall identify any variations from the National Fire Alarm Code.
 - e. Certificate from equipment manufacturer assuring compliance with all manufacturers installation requirements and satisfactory system operation.
- D. Certifications:
 - 1. Together with the shop drawing submittal, submit the technician's NICET level III fire alarm certification as well as certification from the control unit manufacturer that the proposed performer of contract maintenance is an authorized representative of the major equipment manufacturer. Include in the certification the names and addresses of the proposed supervisor of installation and the proposed performer of contract maintenance. Also include the name and title of the manufacturer's representative who makes the certification.
 - 2. Together with the shop drawing submittal, submit a certification from either the control unit manufacturer or the manufacturer of each component (e.g., smoke detector) that the components being furnished are compatible with the control unit.
 - 3. Together with the shop drawing submittal, submit a certification from the major equipment manufacturer that the wiring and connection diagrams meet this specification, UL and NFPA 72 requirements.

1.5 WARRANTY

All work performed and all material and equipment furnished under this contract shall be free from defects and shall remain so for a period of

five (5) years from the date of acceptance of the entire installation by the COTR.

1.6 GUARANTY PERIOD SERVICES

- A. Complete inspection, testing, maintenance and repair service for the fire alarm system shall be provided by a factory trained authorized representative of the manufacturer of the major equipment for a period of five years from the date of acceptance of the entire installation by the COTR.
- B. Contractor shall provide all necessary test equipment, parts and labor to perform required inspection, testing, maintenance and repair.
- C. All inspection, testing, maintenance and permanent records required by NFPA 72, and recommended by the equipment manufacturer shall be provided by the contractor. Work shall include operation of sprinkler system alarm and supervisory devices as well as all reused existing equipment connected to the fire alarm system. It shall include all interfaced equipment including but not limited to elevators, HVAC shutdown, and extinguishing systems.
- D. Maintenance and testing shall be performed in accordance with NFPA 72. A computerized preventive maintenance schedule shall be provided and shall describe the protocol for preventive maintenance of equipment. The schedule shall include a systematic examination, adjustment and cleaning of all equipment.
- E. Non-included Work: Repair service shall not include the performance of any work due to improper use, accidents, or negligence for which the contractor is not responsible.
- F. Service and emergency personnel shall report to the Engineering Office or their authorized representative upon arrival at the hospital and again upon the completion of the required work. A copy of the work ticket containing a complete description of the work performed and parts replaced shall be provided to the COTR.
- G. Emergency Service:
 - 1. Warranty Period Service: Service other than the preventative maintenance, inspection, and testing required by NFPA 72 shall be considered emergency call-back service and covered under the warranty of the installation during the first year of the warranty period, unless the required service is a result of abuse or misuse by the Government. Written notification shall not be required for emergency warranty period service and the contractor shall respond

as outlined in the following sections on Normal and Overtime Emergency Call-Back Service. Warranty period service can be required during normal or overtime emergency call-back service time periods at the discretion of the COTR.

2. Normal and overtime emergency call-back service shall consist of an on-site response within two hours of notification of a system trouble.
 3. Normal emergency call-back service times are between the hours of 7:30 a.m. EST and 4:00 p.m. EST, Monday through Friday, exclusive of federal holidays. Service performed during all other times shall be considered to be overtime emergency call-back service. The cost of all normal emergency call-back service for years 2 through 5 shall be included in the cost of this contract.
 4. Overtime emergency call-back service shall be provided for the system when requested by the Government. The cost of the first 40 man hours per year of overtime call-back service during years 2 through 5 of this contract shall be provided under this contract. Payment for overtime emergency call-back service in excess of the 40 man hours per year requirement will be handled through separate purchase orders. The method of calculating overtime emergency call-back hours is based on actual time spent on site and does not include travel time.
- H. The contractor shall maintain a log at each fire alarm control unit. The log shall list the date and time of all examinations and trouble calls, condition of the system, and name of the technician. Each trouble call shall be fully described, including the nature of the trouble, necessary correction performed, and parts replaced.
- I. In the event that VA modifies the fire alarm system post-Acceptance but during the five year Guaranty Period Service period, Contractor shall be required to verify that the system, as newly modified or added, is consistent with the manufacturer's requirements; any verification performed will be equitably adjusted under the Changes clause. The post-Acceptance modification or addition to the fire alarm system shall not void the continuing requirements under this contract set forth in the Guarantee Period Service provision for the fire alarm system as modified or added. The contract will be equitably adjusted under the Changes clause for such additional performance.

1.7 APPLICABLE PUBLICATIONS

- A. The publications listed below (including amendments, addenda, revisions, supplements and errata) form a part of this specification to the extent referenced. The publications are referenced in text by the basic designation only.
- B. National Fire Protection Association (NFPA):
 - 70-2005.....National Electrical Code (NEC).
 - 72-2002.....National Fire Alarm Code.
 - 90A-2002.....Installation of Air Conditioning and Ventilating Systems.
 - 101-2003.....Life Safety Code
- C. Underwriters Laboratories, Inc. (UL):
 - 2000-2000.....Fire Protection Equipment Directory
- D. Factory Mutual Research Corp (FM): Approval Guide, 2005 Edition
- E. American National Standards Institute (ANSI):
 - S3.41-1996.....Audible Emergency Evacuation Signal
- F. International Code Council, International Building Code (IBC) 2003 Edition

PART 2 - PRODUCTS**2.1 EQUIPMENT AND MATERIALS, GENERAL**

- A. All equipment and components shall be new and the manufacturer's current model. All equipment shall be tested and listed by Underwriters Laboratories, Inc. or Factory Mutual Research Corporation for use as part of a fire alarm system. The authorized representative of the manufacturer of the major equipment shall certify that the installation complies with all manufacturer's requirements and that satisfactory total system operation has been achieved.

2.2 CONDUIT, BOXES, AND WIRE

- A. Conduit shall be in accordance with Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS and as follows:
 - 1. All new and reused conduit shall be installed in accordance with NFPA 70.
 - 2. Conduit fill shall not exceed 40 percent of interior cross sectional area.
 - 3. All new conduit shall be 19 mm (3/4 inch) minimum.
- B. Wire:
 - 1. All existing wiring shall be removed and new wiring installed in a conduit or raceway.

2. Wiring shall be in accordance with NEC article 760, Section 26 05 21, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES (600 VOLTS AND BELOW), and as recommended by the manufacturer of the fire alarm system. All wires shall be color coded. Number and size of conductors shall be as recommended by the fire alarm system manufacturer, but not less than 18 AWG for initiating device circuits and 14 AWG for notification device circuits.
 3. Addressable circuits and wiring used for the multiplex communication loop shall be twisted and shielded unless specifically excepted by the fire alarm equipment manufacturer in writing.
 4. Any fire alarm system wiring that extends outside of a building shall have additional power surge protection to protect equipment from physical damage and false signals due to lightning, voltage and current induced transients. Protection devices shall be shown on the submittal drawings and shall be UL listed or in accordance with written manufacturer's requirements.
 5. All wire or cable used in underground conduits including those in concrete shall be listed for wet locations.
- C. Terminal Boxes, Junction Boxes, and Cabinets:
1. Shall be galvanized steel in accordance with UL requirements.
 2. All new boxes shall be sized and installed in accordance with NFPA 70.
 3. New covers shall be repainted red in accordance with Section 09 91 00, PAINTING and shall be identified with white markings as "FA" for junction boxes and as "FIRE ALARM SYSTEM" for cabinets and terminal boxes. Lettering shall be a minimum of 19 mm (3/4 inch) high.
 4. Terminal boxes and cabinets shall have a volume 50 percent greater than required by the NFPA 70. Minimum sized wire shall be considered as 14 AWG for calculation purposes.
 5. Terminal boxes and cabinets shall have identified pressure type terminal strips and shall be located at the base of each riser. Terminal strips shall be labeled as specified or as approved by the COTR.

2.3 FIRE ALARM CONTROL UNIT

A. General:

1. Each building shall be provided with a fire alarm control unit and shall operate as a supervised zoned fire alarm system.

2. Each power source shall be supervised from the other source for loss of power.
 3. All circuits shall be monitored for integrity.
 4. Visually and audibly annunciate any trouble condition including, but not limited to main power failure, grounds and system wiring derangement.
 5. Transmit digital alarm information to the main fire alarm control unit.
- B. Enclosure:
1. The control unit shall be housed in a cabinet suitable for both recessed and surface mounting. Cabinet and front shall be corrosion protected, given a rust-resistant prime coat, and manufacturer's standard finish.
 2. Cabinet shall contain all necessary relays, terminals, lamps, and legend plates to provide control for the system.
- C. Power Supply:
1. The control unit shall derive its normal power from a 120 volt, 60 Hz dedicated supply connected to the emergency power system. Standby power shall be provided by a 24 volt DC battery as hereinafter specified. The normal power shall be transformed, rectified, coordinated, and interfaced with the standby battery and charger.
 2. The door holder power shall be arranged so that momentary or sustained loss of main operating power shall not cause the release of any door.
 3. Power supply for smoke detectors shall be taken from the fire alarm control unit.
 4. Provide protectors to protect the fire alarm equipment from damage due to lightning or voltage and current transients.
 5. Provide new separate and direct ground lines to the outside to protect the equipment from unwanted grounds.
- D. Circuit Supervision: Each alarm initiating device circuit, signaling line circuit, and notification appliance circuit, shall be supervised against the occurrence of a break or ground fault condition in the field wiring. These conditions shall cause a trouble signal to sound in the control unit until manually silenced by an off switch.
- E. Supervisory Devices: All sprinkler system valves, standpipe control valves, post indicator valves (PIV), and main gate valves shall be supervised for off-normal position. Closing a valve shall sound a

supervisory signal at the control unit until silenced by an off switch. The specific location of all closed valves shall be identified at the control unit. Valve operation shall not cause an alarm signal. Low air pressure switches and duct detectors shall be monitored as supervisory signals. The power supply to the elevator shunt trip breaker shall be monitored by the fire alarm system as a supervisory signal.

F. Trouble signals:

1. Arrange the trouble signals for automatic reset (non-latching).
2. System trouble switch off and on lamps shall be visible through the control unit door.

G. Function Switches: Provide the following switches in addition to any other switches required for the system:

1. Remote Alarm Transmission By-pass Switch: Shall prevent transmission of all signals to the main fire alarm control unit when in the "off" position. A system trouble signal shall be energized when switch is in the off position.
2. Alarm Off Switch: Shall disconnect power to alarm notification circuits on the local building alarm system. A system trouble signal shall be activated when switch is in the off position.
3. Trouble Silence Switch: Shall silence the trouble signal whenever the trouble silence switch is operated. This switch shall not reset the trouble signal.
4. Reset Switch: Shall reset the system after an alarm, provided the initiating device has been reset. The system shall lock in alarm until reset.
5. Lamp Test Switch: A test switch or other approved convenient means shall be provided to test the indicator lamps.
6. Drill Switch: Shall activate all notification devices without tripping the remote alarm transmitter. This switch is required only for general evacuation systems specified herein.
7. Door Holder By-Pass Switch: Shall prevent doors from releasing during fire alarm tests. A system trouble alarm shall be energized when switch is in the abnormal position.
8. Elevator recall By-Pass Switch: Shall prevent the elevators from recalling upon operation of any of the devices installed to perform that function. A system trouble alarm shall be energized when the switch is in the abnormal position.

9. HVAC/Smoke Damper By-Pass: Provide a means to disable HVAC fans from shutting down and/or smoke dampers from closing upon operation of an initiating device designed to interconnect with these devices.
- H. Remote Transmissions:
1. Provide capability and equipment for transmission of alarm, supervisory and trouble signals to the main fire alarm control unit.
 2. Transmitters shall be compatible with the systems and equipment they are connected to such as timing, operation and other required features.
- I. Remote Control Capability: Each building fire alarm control unit shall be installed and programmed so that each must be reset locally after an alarm, before the main fire alarm control unit can be reset. After the local building fire alarm control unit has been reset, then the all system acknowledge, reset, silence or disabling functions can be operated by the main fire alarm control unit
- J. System Expansion: Design the control units and enclosures so that the system can be expanded in the future (to include the addition of eighty percent more alarm initiating, alarm notification and door holder circuits (for future two floors)) without disruption or replacement of the existing control unit and secondary power supply.

2.4 STANDBY POWER SUPPLY

- A. Batteries:
1. Battery shall be of the sealed, maintenance free type, 24-volt nominal.
 2. Battery shall have sufficient capacity to power the fire alarm system for not less than twenty-four hours plus five minutes of alarm to an end voltage of 1.14 volts per cell, upon a normal AC power failure.
 3. Battery racks shall be steel with an alkali-resistant finish. Batteries shall be secured in seismic areas 2B, 3, or 4 as defined by the Uniform Building Code.
- B. Battery Charger:
1. Shall be completely automatic, with constant potential charger maintaining the battery fully charged under all service conditions. Charger shall operate from a 120-volt, 60 hertz emergency power source.

2. Shall be rated for fully charging a completely discharged battery within 48 hours while simultaneously supplying any loads connected to the battery.
3. Shall have protection to prevent discharge through the charger.
4. Shall have protection for overloads and short circuits on both AC and DC sides.
5. A trouble condition shall actuate the fire alarm trouble signal.
6. Charger shall have automatic AC line voltage regulation, automatic current-limiting features, and adjustable voltage controls.

2.5 ANNUNCIATION

A. Annunciator, Alphanumeric Type (System):

1. Shall be a supervised, LCD display containing a minimum of two lines of 40 characters for alarm annunciation in clear English text.
2. Message shall identify building number, floor, zone, etc on the first line and device description and status (pull station, smoke detector, waterflow alarm or trouble condition) on the second line.
3. The initial alarm received shall be indicated as such.
4. A selector switch shall be provided for viewing subsequent alarm messages.
5. The display shall be UL listed for fire alarm application.
6. Local building annunciators, for general evacuation system buildings, shall be permitted when shown on the drawings and approved by the COTR.

B. Printers:

1. System printers shall be high reliability digital input devices, UL approved, for fire alarm applications. The printers shall operate at a minimum speed of 30 characters per second. The printer shall be continually supervised.
2. Printers shall be programmable to either alarm only or event logging output.
 - a. Alarm printers shall provide a permanent (printed) record of all alarm information that occurs within the fire alarm system. Alarm information shall include the date, time, building number, floor, zone, device type, device address, and condition.
 - b. Event logging printers shall provide a permanent (printed) record of every change of status that occurs within the fire alarm system. Status information shall include date, time, building

number, floor, zone, device type, device address and change of status (alarm, trouble, supervisory, reset/return to normal).

3. System printers shall provide tractor drive feed pins for conventional fan fold 213 mm x 275 mm (8-1/2 inch x 11 inch) paper.
4. The printers shall provide a printing and non-printing self test feature.
5. Power supply for printers shall be taken from and coordinated with the building emergency service.
6. Each printer shall be provided with a stand for the printer and paper.
7. Spare paper and ribbons for printers shall be stocked and maintained as part of the five (5) year guarantee period services in addition to the one installed after the approval of the final acceptance test.

2.6 VOICE COMMUNICATION SYSTEM (VCS)

A. General:

1. An emergency voice communication system shall be installed throughout the building.
2. Upon receipt of an alarm signal from the building fire alarm system, the VCS shall automatically transmit a pre-recorded fire alarm message throughout the building.
3. A digitized voice module shall be used to store each prerecorded message.
4. The VCS shall be arranged as a dual channel system capable of transmitting two different messages simultaneously.
5. The VCS shall supervise all speaker circuits, control equipment, remote audio control equipment, and amplifiers.

B. Speaker Circuit Control Unit:

1. The speaker circuit control unit shall include switches to manually activate or deactivate speaker circuits grouped by floor in the system.
2. Speaker circuit control switches shall provide on, off, and automatic positions and indications.
3. The speaker circuit control unit shall include visual indication of active or trouble status for each group of speaker circuits in the system.
4. A trouble indication shall be provided if a speaker circuit group is disabled.

5. A lamp test switch shall be provided to test all indicator lamps.
 6. A single "all call" switch shall be provided to activate all speaker circuit groups simultaneously.
 7. A push-to-talk microphone shall be provided for manual voice messages.
 8. Remote microphones shall be provided in the location designated by the COTR.
 9. A voice message disconnect switch shall be provided to disconnect automatic digitized voice messages from the system. The system shall be arranged to allow manual voice messages and indicate a system trouble condition when activated.
- C. Speaker Circuit Arrangement:
1. Speaker circuits shall be arranged such that there is one speaker circuit per smoke zone.
 2. Audio amplifiers and control equipment shall be electrically supervised for normal and abnormal conditions.
 3. Speaker circuits shall be either 25 VRMS or 70.7 VRMS with a minimum of 50% spare power available.
 4. Speaker circuits and control equipment shall be arranged such that loss of any one speaker circuit will not cause the loss of any other speaker circuit in the system.
- D. Digitized Voice Module (DVM):
1. The Digitized Voice Module shall provide prerecorded digitized evacuation and instructional messages. The messages shall be professionally recorded and approved by the COTR prior to programming.
 2. The DVM shall be configured to automatically output to the desired circuits following a 10-second slow whoop alert tone.
 3. Prerecorded magnetic taped messages and tape players are not permitted.
 4. The digitized message capacity shall be no less than 15 second in length.
 5. The digitized message shall be transmitted three times.
 6. The DVM shall be supervised for operational status.
 7. Failure of the DVM shall result in the transmission of a constant alarm tone.

8. The DVM memory shall have a minimum 50% spare capacity after those messages identified in this section are recorded. Multiple DVM's may be used to obtain the required capacity.
- E. Audio Amplifiers:
1. Audio Amplifiers shall provide a minimum of 50 Watts at either 25 or 70.7 VRMS output voltage levels.
 2. Amplifiers shall be continuously supervised for operational status.
 3. Amplifiers shall be configured for either single or dual channel application.
 4. Each audio output circuit connection shall be configurable for Style X.
 5. A minimum of 50% spare output capacity shall be available for each amplifier.
- F. Tone Generator(s):
1. Tone Generator(s) shall be capable of providing a distinctive three-pulse temporal pattern fire alarm signal as well as a slow whoop.
 2. Tone Generator(s) shall be continuously supervised for operational status.

2.7 ALARM NOTIFICATION APPLIANCES

- A. Speakers:
1. Shall operate on either 25 VRMS or 70.7 VRMS with field selectable output taps from 0.5 to 2.0W and originally installed at the one-half watt tap. Speakers shall provide a minimum sound output of 80 dBA at ten feet with the one-half watt tap.
 2. Frequency response shall be a minimum of 400 HZ to 4000 HZ.
 3. 100 mm (4 inches) or 200 mm (8 inches) cone type speakers ceiling mounted with white colored baffles in areas with suspended ceilings and wall mounted in areas without ceilings.
- C. Strobes:
1. Xenon flash tube type minimum 15 candela in toilet rooms and 75 candela in all other areas with a flash rate of 1 HZ. Strobes shall be synchronized where required by the National Fire Alarm Code (NFPA 72).
 2. Backplate shall be red with 13 mm (1/2 inch) permanent red letters. Lettering to read "Fire", be oriented on the wall or ceiling properly, and be visible from all viewing directions.
 3. Each strobe circuit shall have a minimum of twenty (20) percent spare capacity.

4. Strobes may be combined with the audible notification appliances specified herein.

2.8 ALARM INITIATING DEVICES

A. Manual Fire Alarm Stations:

1. Shall be non-breakglass, address reporting type.
2. Station front shall be constructed of a durable material such as cast or extruded metal or high impact plastic. Stations shall be semi-flush type.
3. Stations shall be of single action pull down type with suitable operating instructions provided on front in raised or depressed letters, and clearly labeled "FIRE".
4. Stations (only in the second floor Daycare areas) shall be of double action pull down type with suitable operating instructions provided on front in raised or depressed letters, and clearly labeled "FIRE".
5. Operating handles shall be constructed of a durable material. On operation, the lever shall lock in alarm position and remain so until reset. A key shall be required to gain front access for resetting, or conducting tests and drills.
6. Unless otherwise specified, all exposed parts shall be red in color and have a smooth, hard, durable finish.

B. Smoke Detectors:

1. Smoke detectors shall be UL listed for use with the fire alarm control unit being furnished.
2. Smoke detectors shall be addressable type complying with applicable UL Standards for system type detectors. Smoke detectors shall be installed in accordance with the manufacturer's recommendations and NFPA 72.
3. Detectors shall have an indication lamp to denote an alarm condition. Provide remote indicator lamps and identification plates where detectors are concealed from view. Locate the remote indicator lamps and identification plates flush mounted on walls so they can be observed from a normal standing position.
4. All spot type and duct type detectors installed shall be of the photoelectric type.
5. Photoelectric detectors shall be factory calibrated and readily field adjustable. The sensitivity of any photoelectric detector shall be factory set at 3.0 plus or minus 0.25 percent obscuration per foot.

6. Detectors shall provide a visual trouble indication if they drift out of sensitivity range or fail internal diagnostics. Detectors shall also provide visual indication of sensitivity level upon testing. Detectors, along with the fire alarm control units shall be UL listed for testing the sensitivity of the detectors.
- C. Heat Detectors:
1. Heat detectors shall be of the addressable restorable rate compensated fixed-temperature spot type.
 2. Detectors shall have a minimum smooth ceiling rating of 2500 square feet.
 3. Ordinary temperature (135 degrees F) heat detectors shall be utilized in elevator shafts and elevator mechanical rooms. Intermediate temperature rated (200 degrees F) heat detectors shall be utilized in all other areas.
 4. Provide a remote indicator lamp, key test station and identification nameplate (e.g. "Heat Detector - Elevator P-_____) for each elevator group. Locate key test station in plain view on elevator machine room wall.
- D. Water Flow and Pressure Switches:
1. Wet pipe water flow switches and dry pipe alarm pressure switches for sprinkler systems shall be connected to the fire alarm system by way of an address reporting interface device.
 2. All new water flow switches shall be of a single manufacturer and series and non-accumulative retard type.
 3. All new switches shall have an alarm transmission delay time that is conveniently adjustable from 0 to 60 seconds. Initial settings shall be 30-45 seconds. Timing shall be recorded and documented during testing.
- E. Extinguishing System Connections:
1. Kitchen Range Hood and Duct Suppression Systems:
 - a. Each suppression system shall be equipped with a micro-switch connected to the building fire alarm control unit. Discharge of a suppression system shall automatically send a alarm signal to the building fire detection and alarm system for annunciation.
 - b. Operation of this suppression system shall also automatically shut off all sources of fuel and heat to all equipment requiring protection under the same hood.

2. Each gaseous suppression system shall be monitored for system alarm and system trouble conditions via addressable interface devices.

2.9 SUPERVISORY DEVICES

A. Duct Smoke Detectors:

1. Duct smoke detectors shall be provided and connected by way of an address reporting interface device. Detectors shall be provided with an approved duct housing mounted exterior to the duct, and shall have perforated sampling tubes extending across the full width of the duct (wall to wall). Detector placement shall be such that there is uniform airflow in the cross section of the duct.
2. Interlocking with fans shall be provided in accordance with NFPA 90A and as specified hereinafter under Part 3.2, "TYPICAL OPERATION".
3. Provide remote indicator lamps, key test stations and identification nameplates (e.g. "DUCT SMOKE DETECTOR AHU-X") for all duct detectors. Locate key test stations in plain view on walls or ceilings so that they can be observed and operated from a normal standing position.

B. Sprinkler and Standpipe System Supervisory Switches:

1. Each sprinkler system water supply control valve, riser valve or zone control valve, and each standpipe system riser control valve shall be equipped with a supervisory switch. Standpipe hose valves, and test and drain valves shall not be equipped with supervisory switches.
2. PIV (post indicator valve) or main gate valve shall be equipped with a supervisory switch.
3. Valve supervisory switches shall be connected to the fire alarm system by way of address reporting interface device.
4. The mechanism shall be contained in a weatherproof die-cast aluminum housing that shall provide a 19 mm (3/4 inch) tapped conduit entrance and incorporate the necessary facilities for attachment to the valves.
5. The entire installed assembly shall be tamper-proof and arranged to cause a switch operation if the housing cover is removed or if the unit is removed from its mounting.
6. Where dry-pipe sprinkler systems are installed, high and low air pressure switches shall be provided and monitored by way of an address reporting interface devices.

2.10 ADDRESS REPORTING INTERFACE DEVICE

- A. Shall have unique addresses that reports directly to the building fire alarm panel.
- B. Shall be configurable to monitor normally open or normally closed devices for both alarm and trouble conditions.
- C. Shall have terminal designations clearly differentiating between the circuit to which they are reporting from and the device that they are monitoring.
- D. Shall be UL listed for fire alarm use and compatibility with the panel to which they are connected.
- E. Shall be mounted in weatherproof housings if mounted exterior to a building.

2.11 SMOKE BARRIER DOOR CONTROL

- A. Electromagnetic Door Holders:
 - 1. New Door Holders shall be standard wall mounted electromagnetic type. In locations where doors do not come in contact with the wall when in the full open position, an extension post shall be added to the door bracket.
 - 2. Operation shall be by 24 volt DC supplied from a battery located at the fire alarm control unit. Door holders shall be coordinated as to voltage, ampere drain, and voltage drop with the battery, battery charger, wiring and fire alarm system for operation as specified.
- B. A maximum of twelve door holders shall be provided for each circuit. Door holders shall be wired to allow releasing doors by smoke zone.
- C. Door holder control circuits shall be electrically supervised.
- D. Smoke detectors shall not be incorporated as an integral part of door holders.
- E. Where combination holder-closer units are required to match existing, these devices are furnished and installed as per Section 08 71 00, DOOR HARDWARE. Connection and wiring shall be as herein specified.

2.12 UTILITY LOCKS AND KEYS:

- A. All key operated test switches, control units, annunciator panels and lockable cabinets shall be provided with a single standardized utility lock and key.
- B. Key-operated manual fire alarm stations shall have a single standardized lock and key separate from the control equipment.
- C. All keys shall be delivered to the COTR.

2.13 SPARE AND REPLACEMENT PARTS

- A. Provide spare and replacement parts as follows:
1. Manual pull stations - 3
 2. Heat detectors - 2 of each type
 3. Fire alarm strobes - 3
 4. Fire alarm speakers - 3
 5. Smoke detectors - 10
 6. Duct smoke detectors with all appurtenances - 1
 7. Sprinkler system water flow switch - 1 of each size
 8. Sprinkler system water pressure switch - 1 of each type
 9. Sprinkler valve tamper switch - 1 of each type
 10. Control equipment utility locksets - 3
 11. Control equipment keys - 10
 12. 2.5 oz containers aerosol smoke - 7
 13. Printer paper - 2 boxes
 14. Printer replacement ribbons - 2
 15. Monitor modules - 2
 16. Control modules - 2
 17. Fire alarm SLC cable (same as installed) - 152 m (500 feet)
- B. Spare and replacement parts shall be in original packaging and submitted to the COTR.
- C. Furnish and install a storage cabinet of sufficient size and suitable for storing spare equipment. Doors shall include a pad locking device. Padlock to be provided by the VA. Location of cabinet to be determined by the COTR.
- D. Provide to the VA, all hardware, software, programming tools, license and documentation necessary to permanently modify the fire alarm system on site. The minimum level of modification includes addition and deletion of devices, circuits, zones and changes to system description, system operation, and digitized evacuation and instructional messages.

2.14 INSTRUCTION CHART:

Provide a typeset printed or typewritten instruction card mounted behind a Lexan plastic or glass cover in a stainless steel or aluminum frame with a backplate. Install the frame in a conspicuous location observable from each control unit where operations are performed. The card shall show those steps to be taken by an operator when a signal is received under all conditions, normal, alarm, supervisory, and trouble. Provide an additional copy with the binder for the input output matrix

for the sequence of operation. The instructions shall be approved by the COTR before being posted.

PART 3 - EXECUTION

3.1 INSTALLATION:

- A. Installation shall be in accordance with NFPA 70, 72, 90A, and 101 as shown on the drawings, and as recommended by the major equipment manufacturer. Fire alarm wiring shall be installed in conduit. All conduit and wire shall be installed in accordance with Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS , Section 26 05 21, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES (600 VOLTS AND BELOW), and all penetrations of smoke and fire barriers shall be protected as required by Section 07 84 00, FIRESTOPPING.
- B. All new conduits, junction boxes, conduit supports and hangers shall be concealed in finished areas and may be exposed in unfinished areas. All existing accessible fire alarm conduit not reused shall be removed.
- C. All new or reused exposed conduit shall be painted in accordance with Section 09 91 00, PAINTING to match surrounding finished areas and red in unfinished areas.
- D. Existing devices that are reused shall be properly mounted and installed. Where devices are installed on existing shallow backboxes, extension rings of the same material, color and texture of the new fire alarm devices shall be used. Mounting surfaces shall be cut and patched in accordance with Section 01 00 00, GENERAL REQUIREMENTS, Restoration, and be re-painted in accordance with Section 09 91 00, PAINTING as necessary to match existing.
- E. All fire detection and alarm system devices, control units and remote annunciators shall be flush mounted when located in finished areas and may be surface mounted when located in unfinished areas. Exact locations to be approved by the COTR.
- F. Speakers shall be ceiling mounted and fully recessed in areas with suspended ceilings. Speakers shall be wall mounted and recessed in finished areas without suspended ceilings. Speakers may be surface mounted in unfinished areas.
- G. Strobes shall be flush wall mounted 2,000 mm (80 inches) above the floor or 150 mm (6 inches) below ceiling, whichever is lower. Locate and mount to maintain a minimum 900 mm (36 inches) clearance from side obstructions.

- H. Manual pull stations shall be installed not less than 1050 mm (42 inches) or more than 1200 mm (48 inches) from finished floor to bottom of device and within 1500 mm (60 inches) of a stairway or an exit door.
- I. Where possible, locate water flow and pressure switches a minimum of 300 mm (12 inches) from a fitting that changes the direction of the flow and a minimum of 900 mm (36 inches) from a valve.
- J. Mount valve tamper switches so as not to interfere with the normal operation of the valve and adjust to operate within two revolutions toward the closed position of the valve control, or when the stem has moved no more than one-fifth of the distance from its normal position.
- K. Connect combination closer-holders installed under Section 08 71 00, DOOR HARDWARE.

3.2 TYPICAL OPERATION

- A. Activation of any manual pull station, water flow or pressure switch, heat detector, kitchen hood suppression system, gaseous suppression system, or smoke detector shall cause the following operations to occur:
 - 1. Operate the emergency voice communication system in the Building.
For sprinkler protected buildings, flash strobes continuously only in the zone of alarm. For buildings without sprinkler protection throughout, flash strobes continuously only on the floor of alarm.
 - 2. Continuously sound a temporal pattern general alarm and flash all strobes in the building in alarm until reset at the local fire alarm control unit in the Building.
 - 3. Release only the magnetic door holders on the floor from which alarm was initiated after the alert signal.
 - 4. Transmit a separate alarm signal, via the main fire alarm control unit to the fire department.
 - 5. Unlock the electrically locked exit doors within the zone of alarm.
- B. Heat detectors in elevator machine rooms shall, in addition to the above functions, disconnect all power to all elevators served by that machine room after a time delay. The time delay shall be programmed within the fire alarm system programming and be equal to the time it takes for the car to travel from the highest to the lowest level, plus 10 seconds.
- C. Smoke detectors in the primary elevator lobbies of the Building shall, in addition to the above functions, return all elevators in the bank to the secondary floor.

- D. Smoke detectors in the remaining elevator lobbies, elevator machine room, or top of hoistway shall, in addition to the above functions, return all elevators in the bank to the primary floor.
- E. Operation of a smoke detector at a corridor door used for automatic closing shall also release only the magnetic door holders on that floor.
- F. Operation of duct smoke detectors shall cause a system supervisory condition and shut down the ventilation system and close the associated smoke dampers as appropriate.
- G. Operation of any sprinkler or standpipe system valve supervisory switch, high/low air pressure switch, or fire pump alarm switch shall cause a system supervisory condition.

3.3 TESTS

- A. Provide the service of a NICET level III, competent, factory-trained engineer or technician authorized by the manufacturer of the fire alarm equipment to technically supervise and participate during all of the adjustments and tests for the system. Make all adjustments and tests in the presence of the COTR.
- B. When the systems have been completed and prior to the scheduling of the final inspection, furnish testing equipment and perform the following tests in the presence of the COTR. When any defects are detected, make repairs or install replacement components, and repeat the tests until such time that the complete fire alarm systems meets all contract requirements. After the system has passed the initial test and been approved by the COTR, the contractor may request a final inspection.
 - 1. Before energizing the cables and wires, check for correct connections and test for short circuits, ground faults, continuity, and insulation.
 - 2. Test the insulation on all installed cable and wiring by standard methods as recommended by the equipment manufacturer.
 - 3. Run water through all flow switches. Check time delay on water flow switches. Submit a report listing all water flow switch operations and their retard time in seconds.
 - 4. Open each alarm initiating and notification circuit to see if trouble signal actuates.
 - 5. Ground each alarm initiation and notification circuit and verify response of trouble signals.

3.4 FINAL INSPECTION AND ACCEPTANCE

- A. Prior to final acceptance a minimum 30 calendar day "burn-in" period shall be provided. The purpose shall be to allow equipment to stabilize and potential installation and software problems and equipment malfunctions to be identified and corrected. During this diagnostic period, all system operations and malfunctions shall be recorded. Final acceptance will be made upon successful completion of the "burn-in" period and where the last 14 calendar days is without a system or equipment malfunction.
- B. At the final inspection a factory trained representative of the manufacturer of the major equipment shall repeat the tests in Article 3.3 TESTS and those required by NFPA 72. In addition the representative shall demonstrate that the systems function properly in every respect. The demonstration shall be made in the presence of a VA representative.

3.5 INSTRUCTION

- A. The manufacturer's authorized representative shall provide instruction and training to the VA as follows:
 - 1. Six one-hour sessions to engineering staff, security police and central attendant personnel for simple operation of the system. Two sessions at the start of installation, two sessions at the completion of installation and two sessions 3 months after the completion of installation.
 - 2. Four two-hour sessions to engineering staff for detailed operation of the system. Two sessions at the completion of installation and two sessions 3 months after the completion of installation.
 - 3. Three eight-hour sessions to electrical technicians for maintaining, programming, modifying, and repairing the system at the completion of installation and one eight-hour refresher session 3 months after the completion of installation.
- B. The Contractor and/or the Systems Manufacturer's representative shall provide a typewritten "Sequence of Operation" including a trouble shooting guide of the entire system for submittal to the VA. The sequence of operation will be shown for each input in the system in a matrix format and provided in a loose leaf binder. When reading the sequence of operation, the reader will be able to quickly and easily determine what output will occur upon activation of any input in the system. The INPUT/OUTPUT matrix format shall be as shown in Appendix A to NFPA 72.

- C. Furnish the services of a competent instructor for instructing personnel in the programming requirements necessary for system expansion. Such programming shall include addition or deletion of devices, zones, indicating circuits and printer/display text.

PART 4 - SCHEDULES

4.1 DIGITIZED VOICE MESSAGES:

- A. Digitized voice messages shall be provided for each smoke zone of the Building. The messages shall be arranged with a 3 second alert tone, a "Code Red" message and a description of the fire alarm area (building number, floor, level and smoke zone). A sample of such a message is as follows:

Alert Tone

Code Red

Building One, Second Floor, East Wing

Code Red

Building One, Second Floor, East Wing

Code Red

Building One, Second Floor, East Wing

4.2 LOCATION OF VOICE MESSAGES:

Upon receipt of an alarm signal from the building fire alarm system, the voice communication system shall automatically transmit a 3 second tone alert and a pre-recorded fire alarm message throughout the building.

- - - END - - -

**SECTION 31 20 00
EARTH MOVING**

PART 1 - GENERAL

1.1 DESCRIPTION OF WORK:

A. This section specifies the requirements for furnishing all equipment, materials, labor, tools, and techniques for earthwork including, but not limited to, the following:

1. Site preparation.
2. Excavation.
3. Underpinning.
4. Filling and backfilling.
5. Grading.
6. Soil Disposal.
7. Clean Up.

1.2 DEFINITIONS:

A. Unsuitable Materials:

1. Fills: Topsoil; frozen materials; construction materials and materials subject to decomposition; clods of clay and stones larger than 75 mm (3 inches); organic material, including silts, which are unstable; and inorganic materials, including silts, too wet to be stable and any material with a liquid limit and plasticity index exceeding 40 and 15 respectively. Unsatisfactory soils also include satisfactory soils not maintained within 2 percent of optimum moisture content at time of compaction, as defined by ASTM D 698.
2. Existing Subgrade (Except Footing Subgrade): Same materials as 1.2.A.1, that are not capable of direct support of slabs, pavement, and similar items with possible exception of improvement by compaction, proofrolling, or similar methods.
3. Existing Subgrade (Footings Only): Same as paragraph 1, but no fill or backfill. If materials differ from geotechnical exploration data design requirements, excavate to acceptable strata subject to COTR's approval.

B. Building Earthwork: Earthwork operations required in area enclosed by a line located 1500 mm (5 feet) outside of principal building perimeter. It also includes earthwork required for auxiliary structures and buildings.

C. Trench Earthwork: Trenchwork required for utility lines.

- D. Site Earthwork: Earthwork operations required in area outside of a line located 1500 mm (5 feet) outside of principal building perimeter and within new construction area with exceptions noted above.
- E. Degree of compaction: Degree of compaction is expressed as a percentage of maximum density obtained by laboratory test procedure. This percentage of maximum density is obtained through use of data provided from results of field test procedures presented in ASTM D1556, ASTM D2167, and ASTM D2922.
- F. Fill: Satisfactory soil materials used to raise existing grades. In the Construction Documents, the term "fill" means fill or backfill as appropriate.
- G. Backfill: Soil materials or controlled low strength material used to fill an excavation.
- H. Unauthorized excavation: Removal of materials beyond indicated sub-grade elevations or indicated lines and dimensions without written authorization by the Contracting Officer's Technical Representative (COTR). No payment will be made for unauthorized excavation or remedial work required to correct unauthorized excavation.
- I. Authorized additional excavation: Removal of additional material authorized by the COTR based on the determination by the Government's soils testing agency that unsuitable bearing materials are encountered at required sub-grade elevations. Removal of unsuitable material and its replacement as directed will be paid on basis of Conditions of the Contract relative to changes in work.
- J. Subgrade: The undisturbed earth or the compacted soil layer immediately below granular sub-base, drainage fill, or topsoil materials.
- K. Structure: Buildings, foundations, slabs, tanks, curbs, mechanical and electrical appurtenances, or other man-made stationary features constructed above or below the ground surface.
- L. Borrow: Satisfactory soil imported from off-site for use as fill or backfill.
- M. Drainage course: Layer supporting slab-on-grade used to minimize capillary flow of pore water.
- N. Bedding course: Layer placed over the excavated sub-grade in a trench before laying pipe. Bedding course shall extend up to the springline of the pipe.

- O. Sub-base Course: Layer placed between the sub-grade and base course for asphalt paving or layer placed between the sub-grade and a concrete pavement or walk.
- P. Utilities include on-site underground pipes, conduits, ducts, and cables as well as underground services within buildings.
- Q. Debris: Debris includes all materials located within the designated work area not covered in the other definitions and shall include but not be limited to items like vehicles, equipment, appliances, building materials or remains thereof, tires, any solid or liquid chemicals or products stored or found in containers or spilled on the ground.
- R. Contaminated soils: Soil that contains contaminants as defined and determined by the COTR or the Government's testing agency.

1.3 RELATED WORK:

- A. Materials testing and inspection during construction: Section 01 45 29, TESTING LABORATORY SERVICES.
- B. Safety requirements: Section 00 72 00, GENERAL CONDITIONS, Article, ACCIDENT PREVENTION.
- C. Protection of existing utilities, fire protection services, existing equipment, roads, and pavements: Section 01 00 00, GENERAL REQUIREMENTS.
- D. Subsurface Investigation: Section 01 00 00, GENERAL REQUIREMENTS, Article, PHYSICAL DATA.
- E. Erosion Control: Section 01 57 19, TEMPORARY ENVIRONMENTAL CONTROLS, and Section 32 90 00, PLANTING.
- F. Site preparation: Section 31 23 19, DEWATERING
- G. Paving sub-grade requirements: Section 32 12 16, ASPHALT PAVING.

1.4 CLASSIFICATION OF EXCAVATION:

- A. Unclassified Excavation: Removal and disposal of pavements and other man-made obstructions visible on surface; utilities, and other items including underground structures indicated to be demolished and removed; together with any type of materials regardless of character of material and obstructions encountered.

1.5 SUBMITTALS:

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Furnish to COTR:
 - 1. Contactor shall furnish resumes with all personnel involved in the project including Project Manager, Superintendent, and on-site

Engineer. Project Manager and Superintendent should have at least 3 years of experience on projects of similar size.

2. Soil samples.

- a. Classification in accordance with ASTM D2487 for each on-site or borrow soil material proposed for fill, backfill, engineered fill, or structural fill.
- b. Laboratory compaction curve in accordance with ASTM D 698 and D 1557 for each on site or borrow soil material proposed for fill, backfill, engineered fill, or structural fill.
- c. Test reports for compliance with ASTM D 2940 requirements for subbase material.
- d. Pre-excavation photographs and videotape in the vicinity of the existing structures to document existing site features, including surfaces finishes, cracks, or other structural blemishes that might be misconstrued as damage caused by earthwork operations.
- e. The Contractor shall submit a scale plan daily that defines the location, limits, and depths of the area excavated.

1.7 APPLICABLE PUBLICATIONS:

- A. Publications listed below form a part of this specification to extent referenced. Publications are referenced in text by basic designation only.
- B. American Society for Testing and Materials (ASTM):
 - D448-03a.....Standard Classification for Sizes of Aggregate for Road and Bridge Construction
 - D698-00ae1.....Standard Test Methods for Laboratory Compaction Characteristics of Soil Using Standard Effort (12,400 ft. lbf/ft³ (600 kN m/m³))
 - D1556-00.....Standard Test Method for Density and Unit Weight of Soil in Place by the Sand-Cone Method
 - D2167-94 (2001).....Standard Test Method for Density and Unit Weight of Soil in Place by the Rubber Balloon Method
 - D2487-06.....Standard Classification of Soil for Engineering Purposes (Unified Soil Classification System)
 - D2922-05.....Standard Test Methods for Density of Soil and Soil-Aggregate in Place by Nuclear Methods (Shallow Depth)

D2940-03.....Standard Specifications for Graded Aggregate
Material for Bases or Subbases for Highways or
Airports

PART 2 - PRODUCTS

2.1 MATERIALS:

- A. General: Provide borrow soil material when sufficient satisfactory soil materials are not available from excavations.
- B. Fills: Material in compliance with ASTM D2487 Soil Classification Groups GW, GP, GM, SW, SP, SM, SC, and ML, or any combination of these groups; free of rock or gravel larger than 75 mm (3 inches) in any dimension, debris, waste, frozen materials, vegetation, and other deleterious matter. Material approved from on site or off site sources having a minimum dry density of 1760 kg/m³ (110 pcf), a maximum Plasticity Index of 15, and a maximum Liquid Limit of 40.
- C. Engineered Fill: Naturally or artificially graded mixture of compliance with ASTM D2487 Soil Classification Groups GW, GP, GM, SW, SP, SM, SC, and ML, or any combination of these groups, or as approved by the Engineer or material with at least 90 percent passing a 37.5-mm (1 1/2-inch) sieve and not more than 12 percent passing a 75-µm (No. 200) sieve, per ASTM D2940;.
- D. Bedding: Naturally or artificially graded mixture of natural or crushed gravel, crushed stone, and natural or crushed sand; ASTM D2940; except with 100 percent passing a 25 mm (1 inch) sieve and not more than 8 percent passing a 75-µm (No. 200) sieve.
- E. Drainage Fill: Washed, narrowly graded mixture of crushed stone, or crushed or uncrushed gravel; ASTM D448; coarse-aggregate grading Size 57; with 100 percent passing a 37.5 mm (1 1/2-inch) sieve and 0 to 5 percent passing a 2.36 mm (No. 8) sieve.
- F. Granular Fill:
 - 1. Under concrete slab, crushed stone or gravel graded from 25 mm (1 inch) to 4.75 mm (No. 4), per ASTM D 2940.
 - 2. Bedding for sanitary and storm sewer pipe, crushed stone or gravel graded from 13 mm (1/2 inch) to 4.75 mm (No 4), per ASTM D 2940.

PART 3 - EXECUTION

3.1 SITE PREPARATION:

- A. Clearing: Clear within limits of earthwork operations as shown. Work includes removal of trees, shrubs, fences, foundations, incidental

- structures, paving, debris, trash, and other obstructions. Remove materials from property and dispose of materials legally offsite.
- B. Grubbing: Remove stumps and roots 75 mm (3 inch) and larger diameter. Undisturbed sound stumps, roots up to 75 mm (3 inch) diameter, and nonperishable solid objects a minimum of 900 mm (3 feet) below subgrade or finished embankment may be left.
- C. Trees and Shrubs: Trees and shrubs, not shown for removal, may be removed from areas within 4500 mm (15 feet) of new construction and 2250 mm (7.5 feet) of utility lines when removal is approved in advance by COTR. Remove materials from property and dispose of materials legally offsite.
- D. Stripping Topsoil: Strip topsoil from within limits of earthwork operations as specified. Topsoil shall be a fertile, friable, natural topsoil of loamy character and characteristic of locality. Topsoil shall be capable of growing healthy horticultural crops of grasses. Stockpile topsoil and protect as directed by COTR. Eliminate foreign materials, such as weeds, roots, stones, subsoil, frozen clods, and similar foreign materials larger than 0.014 m³ (1/2 cubic foot) in volume, from soil as it is stockpiled. Retain topsoil on station. Remove foreign materials larger than 50 mm (2 inches) in any dimension from topsoil used in final grading. Topsoil work, such as stripping, stockpiling, and similar topsoil work shall not, under any circumstances, be carried out when soil is wet so that the composition of the soil will be destroyed.
- E. Concrete Slabs and Paving: Score deeply or saw cut to insure a neat, straight cut, sections of existing concrete slabs and paving to be removed where excavation or trenching occurs. Extend pavement section to be removed a minimum of 300 mm (12 inches) on each side of widest part of trench excavation and insure final score lines are approximately parallel unless otherwise indicated. Remove material from property and dispose of materials legally offsite.
- F. Lines and Grades: Registered Professional Land Surveyor or Registered Civil Engineer, specified in Section 01 00 00, GENERAL REQUIREMENTS, shall establish lines and grades.
1. Grades shall conform to elevations indicated on plans within the tolerances herein specified. Generally grades shall be established to provide a smooth surface, free from irregular surface changes. Grading shall comply with compaction requirements and grade cross

sections, lines, and elevations indicated. Where spot grades are indicated the grade shall be established based on interpolation of the elevations between the spot grades while maintaining appropriate transition at structures and paving and uninterrupted drainage flow into inlets.

2. Locations of existing elevations indicated on plans are from a site survey that measured spot elevations and subsequently generated existing contours and spot elevations. Contractor is responsible to notify COTR of any differences between existing elevations shown on plans and those encountered on site by Surveyor/Engineer described above. Notify COTR of any differences between existing or constructed grades, as compared to those shown on the plans.
 3. Subsequent to establishment of lines and grades, Contractor will be responsible for any additional cut and/or fill required to ensure that site is graded to conform to elevations indicated on plans.
 4. Finish grading is specified in Section 32 90 00, PLANTING.
- G. Disposal: All materials removed from the property shall be disposed of at a legally approved site, secured by the Contractor, for the specific materials, and all removals shall be in accordance with all applicable Federal, State and local regulations. No burning of materials is permitted onsite.

3.2 EXCAVATION:

- A. Shoring, Sheet piling and Bracing: Shore, brace, or slope, its angle of repose or to an angle considered acceptable by the COTR, banks of excavations to protect workmen, banks, adjacent paving, structures, and utilities.
1. Design of the temporary support of excavation system is the responsibility of the Contractor.
 2. Construction of the support of excavation system shall not interfere with the permanent structure and may begin only after a review by the COTR.
 3. Extend shoring and bracing to a minimum of 1500 mm (5 feet) below the bottom of excavation. Shore excavations that are carried below elevations of adjacent existing foundations.
 4. If bearing material of any foundation is disturbed by excavating, improper shoring or removal of existing or temporary shoring, placing of backfill, and similar operations, the Contractor shall underpin the existing foundation, per Section 3.3, as directed by

COTR, at no additional cost to the Government. Do not remove shoring until permanent work in excavation has been inspected and approved by COTR.

- B. Excavation Drainage: Operate pumping equipment, and/or provide other materials, means and equipment as required to keep excavation free of water and subgrade dry, firm, and undisturbed until approval of permanent work has been received from COTR. Approval by the COTR is also required before placement of the permanent work on all subgrades.
- C. Subgrade Protection: Protect subgrades from softening, undermining, washout, or damage by rain or water accumulation. Reroute surface water runoff from excavated areas and not allow water to accumulate in excavations. Do not use excavated trenches as temporary drainage ditches. When subgrade for foundations has been disturbed by water, remove disturbed material to firm undisturbed material after water is brought under control. Replace disturbed subgrade in trenches with concrete or material approved by the COTR.
- D. Blasting: Blasting shall not be permitted.
- E. Proofrolling:
 - 1. After rough grade has been established in cut areas and prior to placement of fill in fill areas under building and pavements, proofroll exposed subgrade with a fully loaded dump truck to check for pockets of soft material.
 - 2. Proofrolling shall consist of at least two complete passes with one pass being in a direction perpendicular to preceding one. Remove any areas that deflect, rut, or pump excessively during proofrolling, or that fail to consolidate after successive passes to suitable soils and replaced with compacted fill. Maintain subgrade until succeeding operation has been accomplished.
- F. Building Earthwork:
 - 1. Excavation shall be accomplished as required by drawings and specifications.
 - 2. Excavate foundation excavations to solid undisturbed subgrade.
 - 3. Remove loose or soft materials to a solid bottom.
 - 4. Fill excess cut under footings or foundations with 25 MPa (3000 psi) concrete poured separately from the footings.
 - 5. Do not tamp earth for backfilling in footing bottoms, except as specified.

6. Slope grades to direct water away from excavations and to prevent ponding.
- G. Trench Earthwork:
1. Utility trenches (except sanitary and storm sewer):
 - a. Excavate to a width as necessary for sheeting and bracing and proper performance of the work.
 - b. Grade bottom of trenches with bell holes scooped out to provide a uniform bearing.
 - c. Support piping on undisturbed earth unless a mechanical support is shown.
 - d. Length of open trench in advance of piping laying shall not be greater than is authorized by COTR.
 2. Sanitary and storm sewer trenches:
 - a. Trench width below a point 150 mm (6 inches) above top of pipe shall be 600 mm (24 inches) maximum for pipe up to and including 300 mm (12 inches) diameter, and four-thirds diameter of pipe plus 200 mm (8 inches) for pipe larger than 300 mm (12 inches). Width of trench above that level shall be as necessary for sheeting and bracing and proper performance of the work.
 - b. Bed bottom quadrant of pipe on granular fill (reference plan details).
 - 1) Undisturbed: Bell holes shall be no larger than necessary for jointing. Backfill up to a point 300 mm (12 inches) above top of pipe shall be clean earth placed and tamped by hand.
 - 2) Granular Fill: Depth of fill shall be a minimum of 75 mm (3 inches) plus one sixth of pipe diameter below pipe to 300 mm (12 inches) above top of pipe. Place and tamp fill material by hand.
 - c. Place and compact as specified remainder of backfill using acceptable excavated materials. Do not use unsuitable materials.
 - d. Use granular fill for bedding where rock or rocky materials are excavated.
- H. Site Earthwork: Earth excavation includes excavating pavements and obstructions visible on surface; underground structures, utilities, and other items indicated to be removed; together with soil, boulders, and other materials not classified as rock or unauthorized excavation. Excavation shall be accomplished as required by drawings and

specifications. Excavate to indicated elevations and dimensions within a tolerance of plus or minus 25 mm (1 inch). Extend excavations a sufficient distance from structures for placing and removing concrete formwork, for installing services and other construction, complying with OSHA requirements, and for inspections. Remove subgrade materials that are determined by COTR as unsuitable, and replace with acceptable material.

1. Site Grading:

- a. Provide a smooth transition between adjacent existing grades and new grades.
- b. Cut out soft spots, fill low spots, and trim high spots to comply with required surface tolerances.
- c. Slope grades to direct water away from buildings and to prevent ponds from forming where not designed. Finish subgrades to required elevations within the following tolerances:
 - 1) Lawn or Unpaved Areas: Plus or minus 25 mm (1 inch).
 - 2) Walks: Plus or minus 25 mm (1 inch).
 - 3) Pavements: Plus or minus 13 mm (1/2 inch).
- d. Grading Inside Building Lines: Finish subgrade to a tolerance of 13 mm (1/2 inch) when tested with a 3000 mm (10 foot) straightedge.

3.3 UNDERPINNING:

- A. Design of the underpinning system is the responsibility of the Contractor and is subject to review and approval by the COTR. Underpinning of existing building foundations, as indicated on structural drawings, or where excavation undermines existing foundations, shall be accomplished in the following manner:
 - 1. Make general excavation for new construction, where new foundations are to be below existing foundations, to elevation of new foundations (or sized stone subbase), maintaining a 45 degree sloped berm.
 - 2. For underpinning pits, underpin existing wall foundations by excavating 1200 mm (4 feet) wide pits to depth shown on drawings skipping 3 sections at any one time so as to maintain support for wall at all times.
 - 3. Underpin intervening sections one at a time; no adjacent sections shall be underpinned until concrete in adjacent sections shall have

reached 20 MPa (2500 psi) strength and have been dry packed with non-shrink grout to obtain positive bearing. Sheet and brace underpinning pits if soil will not stand on a vertical cut during this operation, or as required for safety of workmen. Repack any voids behind sheeting to prevent sloughing which could cause settlement of existing foundations. Contractor performing this portion of work shall have been prequalified by COTR as having previously performed successfully this type of work or will demonstrate his capability for successfully performing this work. It shall be sole responsibility of the Contractor to guard against objectionable movement or settlement and to preserve integrity of existing structures.

4. The tip elevation of the underpinning pits shall be a minimum of 900 mm (3 feet) below the adjacent excavation elevation.
5. Subgrades at the tip of the underpinning pit shall be clean, dry, and free of debris and shall be observed by the COTR prior to concrete placement.
6. Concrete shall not be free fall greater than 3000 mm (10 feet) into the pit.

3.4 FILLING AND BACKFILLING:

- A. General: Do not fill or backfill until all debris, water, unsatisfactory soil materials, obstructions, and deleterious materials have been removed from excavation. For fill and backfill, use excavated materials and borrow meeting the criteria specified herein, as applicable. Borrow will be supplied at no additional cost to the Government. Do not use unsuitable excavated materials. Do not backfill until foundation walls have been completed above grade and adequately braced, waterproofing or dampproofing applied, foundation drainage, and pipes coming in contact with backfill have been installed and work inspected and approved by COTR.
- B. Placing: Place materials in horizontal layers not exceeding 200 mm (8 inches) in loose depth for material compacted by heavy compaction equipment, and not more than 100 mm (4 inches) in loose depth for material compacted by hand-operated tampers and then compacted. Place backfill and fill materials evenly on all sides of structures to required elevations, and uniformly along the full length of each structure. Place no material on surfaces that are muddy, frozen, or contain frost.

C. **Compaction:** Compact with approved tamping rollers, sheepsfoot rollers, pneumatic tired rollers, steel wheeled rollers, vibrator compactors, or other approved equipment (hand or mechanized) well suited to soil being compacted. Do not operate mechanized vibratory compaction equipment within 3000 mm (10 feet) of new or existing building walls without prior approval of COTR. Moisten or aerate material as necessary to provide moisture content that will readily facilitate obtaining specified compaction with equipment used. Compact soil to not less than the following percentages of maximum dry density, according to ASTM D698 or ASTM D1557 as specified below:

1. **Fills, Embankments, and Backfill**

- a. Under proposed structures, building slabs, steps, and paved areas, scarify and recompact top 300 mm (12 inches) of existing subgrade and each layer of backfill or fill material in accordance with ASTM D698, D1557 Method A, D 1556, D 2167, and D 2922 - 95 percent.
- b. Curbs, curbs and gutters, ASTM D698, D1557 Method A, D 1556, D 2167, and D 2922 - 95 percent.
- c. Under Sidewalks, scarify and recompact top 150 mm (6 inches) below subgrade and compact each layer of backfill or fill material in accordance with / ASTM D698, D1557 Method A, D 1556, D 2167, and D 2922 - 95 percent.
- d. Landscaped areas, top 400 mm (16 inches), ASTM D698, D1557 Method A, D 1556, D 2167, and D 2922 - 85 percent.
- e. Landscaped areas, below 400 mm (16 inches) of finished grade, ASTM D698, D1557 Method A, D 1556, D 2167, and D 2922 - 90 percent.

2. **Natural Ground (Cut or Existing)**

- a. Under building slabs, steps and paved areas, top 150 mm (6 inches), ASTM D698, D1557 Method A, D 1556, D 2167, and D 2922 - 95 percent.
- b. Curbs, curbs and gutters, top 150 mm (6 inches), ASTM D698, D1557 Method A, D 1556, D 2167, and D 2922 - 95 percent.
- c. Under sidewalks, top 150 mm (6 inches), ASTM D698, D1557 Method A, D 1556, D 2167, and D 2922 - 95 percent.

3.5 GRADING:

A. **General:** Uniformly grade the areas within the limits of this section, including adjacent transition areas. Smooth the finished surface within

- specified tolerance. Provide uniform levels or slopes between points where elevations are indicated, or between such points and existing finished grades. Provide a smooth transition between abrupt changes in slope.
- B. Cut rough or sloping rock to level beds for foundations. In pipe spaces or other unfinished areas, fill low spots and level off with coarse sand or fine gravel.
 - C. Slope backfill outside building away from building walls for a minimum distance of 1800 mm (6 feet).
 - D. Finish grade earth floors in pipe basements as shown to a level, uniform slope and leave clean.
 - E. Finished grade shall be at least 150 mm (6 inches) below bottom line of window or other building wall openings unless greater depth is shown.
 - F. Place crushed stone or gravel fill under concrete slabs on grade, tamped, and leveled. Thickness of fill shall be 150 mm (6 inches) unless otherwise shown.
 - G. Finish subgrade in a condition acceptable to COTR at least one day in advance of paving operations. Maintain finished subgrade in a smooth and compacted condition until succeeding operation has been accomplished. Scarify, compact, and grade subgrade prior to further construction when approved compacted subgrade is disturbed by Contractor's subsequent operations or adverse weather.
 - H. Grading for Paved Areas: Provide final grades for both subgrade and base course to +/- 6 mm (0.25 inches) of indicated grades.

3.6 DISPOSAL OF UNSUITABLE AND EXCESS EXCAVATED MATERIAL:

- A. Disposal: Remove surplus soils and waste material, including unsatisfactory soil, trash, and debris, and legally dispose of it off the Medical Center property. Offsite areas are to be secured by the Contractor.
- B. Place excess excavated materials suitable for fill and/or backfill on site where directed.
- C. Remove from site and dispose of any excess excavated materials after all fill and backfill operations have been completed.

3.7 CLEAN UP:

Upon completion of earthwork operations, clean areas within contract limits, remove tools, and equipment. Provide site clear, clean, free of debris, and suitable for subsequent construction operations. Remove all debris, rubbish, and excess material from Medical Center property.

10-06

----- E N D -----

SECTION 31 23 19
DEWATERING

PART 1 - GENERAL

1.1 DESCRIPTION:

This section specifies performance of dewatering required to lower and control ground water table levels and hydrostatic pressures to permit excavation, backfill, and construction to be performed in the dry.

Control of surface water shall be considered as part of the work under this specification.

1.2 SUMMARY:

- A. The work to be completed by the Contractor includes, but is not necessarily limited to the following:
 - 1. Implementation of the Erosion and Sedimentation Control Plan.
 - 2. Dewater excavations, including seepage and precipitation.
- B. The Contractor shall be responsible for providing all materials, equipment, labor, and services necessary for care of water and erosion control. Excavation work shall not begin before the Erosion and Sedimentation Control Plan is in place.

1.3 REQUIREMENT:

- A. Dewatering system shall be of sufficient size and capacity necessary to lower and maintain ground water table to an elevation at least 300 mm (1 foot) below lowest foundation subgrade or bottom of pipe trench and to allow material to be excavated in a reasonably dry condition. Materials to be removed shall be sufficiently dry to permit excavation to grades shown and to stabilize excavation slopes where sheeting is not required. Operate dewatering system continuously until backfill work has been completed.
- B. Reduce hydrostatic head below any excavation to the extent that water level in the construction area is a minimum of 300 mm (1 foot) below prevailing excavation surface.
- C. Prevent loss of fines, seepage, boils, quick conditions or softening of foundation strata.
- D. Maintain stability of sides and bottom of excavation.
- E. Construction operations are performed in the dry.
- F. Control of surface and subsurface water is part of dewatering requirements. Maintain adequate control so that:

1. The stability of excavated and constructed slopes are not adversely affected by saturated soil, including water entering prepared subbase and subgrades where underlying materials are not free draining or are subject to swelling or freeze-thaw action.
 2. Erosion is controlled.
 3. Flooding of excavations or damage to structures does not occur.
 4. Surface water drains away from excavations.
 5. Excavations are protected from becoming wet from surface water, or insure excavations are dry before additional work is undertaken.
- G. Permitting Requirements: The contractor shall comply with and obtain the required State and County permits where the work is performed.

1.4 RELATED WORK:

- A. Materials testing and inspection during construction: Section 01 45 29, TESTING LABORATORY SERVICES.
- B. Safety Requirements: Section 00 72 00, GENERAL CONDITIONS, Article, ACCIDENT PREVENTION.
- C. Submittal requirements as specified in Section 01 33 23 SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- D. Protection of existing utilities, fire protection services, existing equipment, roads, and pavements: Section 01 00 00, GENERAL REQUIREMENTS.
- E. Subsurface Investigation: Section 01 00 00, GENERAL REQUIREMENTS, Article 1.11, PHYSICAL DATA.
- F. Excavation, backfilling, site grade and utilities: Section 31 20 00, EARTH MOVING.

1.5 SUBMITTALS:

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Drawings and Design Data:
 1. Submit drawings and data showing the method to be employed in dewatering excavated areas 30 calendar days before commencement of excavation.
 2. Material shall include: location, depth and size of wellpoints, headers, sumps, ditches, size and location of discharge lines, capacities of pumps and standby units, and detailed description of dewatering methods to be employed to convey the water from site to adequate disposal.

3. Include a written report outlining control procedures to be adopted if dewatering problem arises.
 4. Materials submitted shall be in a format acceptable for inclusion in required permit applications to any and all regulatory agencies for which permits for discharge water from the dewatering system are required due to the discharge reaching regulated bodies of water.
- C. Inspection Reports.
- D. All required permits.

PART 2 - PRODUCTS (NOT USED)

PART 3 - EXECUTION

3.1 INSTALLATION:

- A. Install a dewatering system to lower and control ground surface water in order to permit excavation, construction of structure, and placement of backfill materials to be performed under dry conditions. Make the dewatering system adequate to pre-drain the water-bearing strata above and below the bottom of structure foundations, utilities and other excavations.
- B. In addition, reduce hydrostatic pressure head in water-bearing strata below structure foundations, utility lines, and other excavations, to extent that water levels in construction area are a minimum of // 300 mm (1 foot) below prevailing excavation surface at all times.

3.2 OPERATION:

- A. Prior to any excavation below the ground water table, place system into operation to lower water table as required and operate it continuously 24 hours a day, 7 days a week until utilities and structures have been satisfactorily constructed, which includes the placement of backfill materials and dewatering is no longer required.
- B. Place an adequate weight of backfill material to prevent buoyancy prior to discontinuing operation of the system.

3.3 WATER DISPOSAL:

- A. Dispose of water removed from the excavations in such a manner as:
 1. Will not endanger portions of work under construction or completed.
 2. Will cause no inconvenience to Government or to others working near site.
 3. Will comply with the stipulations of required permits for disposal of water.
 4. Will Control Runoff: The Contractor shall be responsible for control of runoff in all work areas including but not limited to:

excavations, access roads, parking areas, laydown, and staging areas. The Contractor shall provide, operate, and maintain all ditches, basins, sumps, culverts, site grading, and pumping facilities to divert, collect, and remove all water from the work areas. All water shall be removed from the immediate work areas and shall be disposed of in accordance with applicable permits.

B. Excavation Dewatering:

1. The Contractor shall be responsible for providing all facilities required to divert, collect, control, and remove water from all construction work areas and excavations.
2. Drainage features shall have sufficient capacity to avoid flooding of work areas.
3. Drainage features shall be so arranged and altered as required to avoid degradation of the final excavated surface(s).
4. The Contractor shall utilize all necessary erosion and sediment control measures as described herein to avoid construction related degradation of the natural water quality.

C. Dewatering equipment shall be provided to remove and dispose of all surface and ground water entering excavations, trenches, or other parts of the work during construction. Each excavation shall be kept dry during subgrade preparation and continually thereafter until the structure to be built, or the pipe to be installed therein, is completed to the extent that no damage from hydrostatic pressure, flotation, or other cause will result.

3.4 STANDBY EQUIPMENT:

Provide complete standby equipment, installed and available for immediate operation, as may be required to adequately maintain dewatering on a continuous basis and in the event that all or any part of the system may become inadequate or fail.

3.5 CORRECTIVE ACTION:

If dewatering requirements are not satisfied due to inadequacy or failure of the dewatering system (loosening of the foundation strata, or instability of slopes, or damage to foundations or structures), perform work necessary for reinstatement of foundation soil and damaged structure resulting from such inadequacy or failure by Contractor, at no additional cost to Government.

3.6 DAMAGES:

Immediately repair damages to adjacent facilities caused by dewatering operations.

3.7 REMOVAL:

Insure compliance with all conditions of regulating permits and provide such information to the Contracting Officer's Technical Representative (COTR). Obtain written approval from COTR before discontinuing operation of dewatering system.

----- E N D -----

**SECTION 32 05 23
CEMENT AND CONCRETE FOR EXTERIOR IMPROVEMENTS**

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This section shall cover site work concrete constructed upon the prepared subgrade and in conformance with the lines, grades, thickness, and cross sections shown. Construction shall include the following:
- B. Combination curb and gutter and wheel stops.
- C. Pedestrian Pavement: Walks, grade slabs, and steps.
- D. Vehicular Pavement: Service areas.

1.2 RELATED WORK

- A. Laboratory and Field Testing Requirements: Section 01 45 29, TESTING LABORATORY SERVICES.
- B. Subgrade Preparation: Section 31 20 00, EARTH MOVING.
- C. Concrete Materials, Quality, Mixing, Design and Other Requirements: Section 03 30 00, CAST-IN-PLACE-CONCRETE.
- D. Metal Components of Steps (Nosing and Railing): Section 05 50 00, METAL FABRICATIONS.

1.3 DESIGN REQUIREMENTS

Design all elements with the latest published version of applicable codes.

1.4 WEATHER LIMITATIONS

Placement of concrete shall be as specified under Article 3.8, COLD WEATHER and Article 3.7, HOT WEATHER of Section 03 30 00, CAST-IN-PLACE CONCRETE.

1.5 SUBMITTALS

- A. In accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES, furnish the following:
- B. Manufacturers' Certificates and Data certifying that the following materials conform to the requirements specified.
 - 1. Expansion joint filler
 - 2. Hot poured sealing compound
 - 3. Reinforcement
 - 4. Curing materials
- C. Data and Test Reports: Select subbase material.

1. Job-mix formula.
2. Source, gradation, liquid limit, plasticity index, percentage of wear, and other tests as specified and in referenced publications.

1.6 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only. Refer to the latest edition of all referenced Standards and codes.
- B. American Association of State Highway and Transportation Officials (AASHTO):
- M031MM031-07-UL.....Deformed and Plain Carbon-Steel Bars for Concrete Reinforcement (ASTM A615/A615M-09)
- M055MM055-09-UL.....Steel Welded Wire Reinforcement, Plain, for Concrete (ASTM A185)
- M147-65-UL.....Materials for Aggregate and Soil-Aggregate Subbase, Base and Surface Courses (R 2004)
- M148-05-UL.....Liquid Membrane-Forming Compounds for Curing Concrete (ASTM C309)
- M171-05-UL.....Sheet Materials for Curing Concrete (ASTM C171)
- M182-05-UL.....Burlap Cloth Made from Jute or Kenaf and Cotton Mats
- M213-01-UL.....Preformed Expansion Joint Fillers for Concrete Paving and Structural Construction (Non-extruding and Resilient Bituminous Type) (ASTM D1751)
- M233-86-UL.....Boiled Linseed Oil Mixer for Treatment of Portland Cement Concrete
- T099-09-UL.....Moisture-Density Relations of Soils Using a 2.5 kg. (5.5 lb) Rammer and a 305 mm (12 in.) Drop
- T180-09-UL.....Moisture-Density Relations of Soils Using a 4.54 kg (10 lb.) Rammer and a 457 mm (18 in.) Drop
- C. American Society for Testing and Materials (ASTM):
- C94/C94M-09.....Ready-Mixed Concrete
- C143/C143M-09.....Slump of Hydraulic Cement Concrete

PART 2 - PRODUCTS

2.1 GENERAL

Concrete shall be Type C, air-entrained as specified in Section 03 30 00, CAST-IN-PLACE CONCRETE, with the following exceptions:

<u>TYPE</u>	<u>MAXIMUM SLUMP*</u>
Curb & Gutter	75 mm (3 inches)
Pedestrian Pavement	75 mm (3 inches)
Vehicular Pavement	50 mm (2 inches) (Machine Finished) 100 mm (4 inches) (Hand Finished)
Equipment Pad	75 to 100 mm (3 to 4 inches)
* For concrete to be vibrated: Slump as determined by ASTM C143. Tolerances as established by ASTM C94.	

2.2 REINFORCEMENT

- A. The type, amount, and locations of steel reinforcement shall be as shown on the drawings and in the specifications.
- B. Welded wire-fabric shall conform to AASHTO M55.
- C. Dowels shall be plain steel bars conforming to AASHTO M31. Tie bars shall be deformed steel bars conforming to AASHTO M31.

2.3 SELECT SUBBASE

- A. Subbase material shall consist of aggregate material designated as Type I or Type II by the West Virginia Dept. of Transportation specifications.
- B. Subbase material shall produce a compacted, dense-graded course, meeting the density requirement specified herein.

2.4 FORMS

- A. Use metal or wood forms that are straight and suitable in cross-section, depth, and strength to resist springing during depositing and consolidating the concrete, for the work involved.
- B. Do not use forms if they vary from a straight line more than 3 mm (1/8 inch) in any 3000 mm (ten foot) long section, in either a horizontal or vertical direction.
- C. Wood forms should be at least 50 mm (2 inches) thick (nominal). Wood forms shall also be free from warp, twist, loose knots, splits, or other defects. Use approved flexible or curved forms for forming radii.

2.5 CONCRETE CURING MATERIALS

- A. Concrete curing materials shall conform to one of the following:
 - 1. Burlap conforming to AASHTO M182 having a weight of 233 grams (seven ounces) or more per square meter (yard) when dry.
 - 2. Impervious Sheeting conforming to AASHTO M171.

3. Liquid Membrane Curing Compound conforming to AASHTO M148, Type 2, and shall be free of paraffin or petroleum.

2.6 EXPANSION JOINT FILLERS

Material shall conform to AASHTO M213.

PART 3 - EXECUTION

3.1 SUBGRADE PENETRATION

- A. Prepare, construct, and finish the subgrade as specified in Section 31 20 00, EARTH MOVING.
- B. Maintain the subgrade in a smooth, compacted condition, in conformance with the required section and established grade until the succeeding operation has been accomplished.

3.2 SELECT SUBBASE

- A. Mixing: Proportion the select subbase by weight or by volume in quantities so that the final approved job-mixed formula gradation, liquid limit, and plasticity index requirements will be met after subbase course has been placed and compacted. Add water in approved quantities, measured by weight or volume, in such a manner to produce a uniform blend.
- B. Placing:
 1. Place the mixed material on the prepared subgrade in a uniform layer to the required contour and grades, and to a loose depth not to exceed 200 mm (8 inches), and that when compacted, will produce a layer of the designated thickness.
 2. When the designated compacted thickness exceeds 150 mm (6 inches), place the material in layers of equal thickness. Remove unsatisfactory areas and replace with satisfactory mixture, or mix the material in the area.
 3. In no case will the addition of thin layers of material be added to the top layer in order to meet grade.
 4. If the elevation of the top layer is 13 mm (1/2 inch) or more below the grade, excavate the top layer and replace with new material to a depth of at least 75 mm (3 inches) in compacted thickness.
- C. Compaction:
 1. Perform compaction with approved equipment (hand or mechanical) well suited to the material being compacted.
 2. Moisten or aerate the material as necessary to provide the moisture content that will readily facilitate obtaining the specified compaction with the equipment used.

3. Compact each layer to at least 95 percent or 100 percent of maximum density as determined by AASHTO T180 or AASHTO T99 respectively.
- D. Smoothness Test and Thickness Control:
- Test the completed subbase for grade and cross section with a straight edge.
1. The surface of each layer shall not show any deviations in excess of 10 mm (3/8 inch).
 2. The completed thickness shall be within 13 mm (1/2 inch) of the thickness as shown.
- E. Protection:
1. Maintain the finished subbase in a smooth and compacted condition until the concrete has been placed.
 2. When Contractor's subsequent operations or adverse weather disturbs the approved compacted subbase, excavate, and reconstruct it with new material meeting the requirements herein specified, at no additional cost to the VA.

3.3 SETTING FORMS

- A. Base Support:
1. Compact the base material under the forms true to grade so that, when set, they will be uniformly supported for their entire length at the grade as shown.
 2. Correct imperfections or variations in the base material grade by cutting or filling and compacting.
- B. Form Setting:
1. Set forms sufficiently in advance of the placing of the concrete to permit the performance and approval of all operations required with and adjacent to the form lines.
 2. Set forms to true line and grade and use stakes, clamps, spreaders, and braces to hold them rigidly in place so that the forms and joints are free from play or movement in any direction.
 3. Forms shall conform to line and grade with an allowable tolerance of 3 mm (1/8 inch) when checked with a straightedge and shall not deviate from true line by more than 6 mm (1/4 inch) at any point.
 4. Do not remove forms until removal will not result in damaged concrete or at such time to facilitate finishing.
 5. Clean and oil forms each time they are used.
- C. The Contractor's Registered Professional Land Surveyor, specified in Section 00 72 00, GENERAL CONDITIONS, shall establish and control the

alignment and the grade elevations of the forms or concrete slipforming machine operations.

1. Make necessary corrections to forms immediately before placing concrete.
2. When any form has been disturbed or any subgrade or subbase has become unstable, reset and recheck the form before placing concrete.

3.4 EQUIPMENT

- A. The Contracting Officer's Technical Representative (COTR) shall approve equipment and tools necessary for handling materials and performing all parts of the work prior to commencement of work.
- B. Maintain equipment and tools in satisfactory working condition at all times.

3.5 PLACING REINFORCEMENT

- A. Reinforcement shall be free from dirt, oil, rust, scale or other substances that prevent the bonding of the concrete to the reinforcement.
- B. Before the concrete is placed, the COTR shall approve the reinforcement, which shall be accurately and securely fastened in place with suitable supports and ties. The type, amount, and position of the reinforcement shall be as shown.

3.6 PLACING CONCRETE - GENERAL

- A. Obtain approval of the COTR before placing concrete.
- B. Remove debris and other foreign material from between the forms before placing concrete. Obtain approval of the COTR before placing concrete.
- C. Before the concrete is placed, uniformly moisten the subgrade, base, or subbase appropriately, avoiding puddles of water.
- D. Convey concrete from mixer to final place of deposit by a method which will prevent segregation or loss of ingredients. Deposit concrete so that it requires as little handling as possible.
- E. While being placed, spade or vibrate and compact the concrete with suitable tools to prevent the formation of voids or honeycomb pockets. Vibrate concrete well against forms and along joints. Over-vibration or manipulation causing segregation will not be permitted. Place concrete continuously between joints without bulkheads.
- F. Install a construction joint whenever the placing of concrete is suspended for more than 30 minutes and at the end of each day's work.

- G. Workmen or construction equipment coated with foreign material shall not be permitted to walk or operate in the concrete during placement and finishing operations.

3.7 PLACING CONCRETE FOR CURB AND GUTTER, PEDESTRIAN PAVEMENT, AND EQUIPMENT PADS

- A. Place concrete in the forms in one layer of such thickness that, when compacted and finished, it will conform to the cross section as shown.
- B. Deposit concrete as near to joints as possible without disturbing them but do not dump onto a joint assembly.
- C. After the concrete has been placed in the forms, use a strike-off guided by the side forms to bring the surface to the proper section to be compacted.
- D. Consolidate the concrete thoroughly by tamping and spading, or with approved mechanical finishing equipment.
- E. Finish the surface to grade with a wood or metal float.
- F. All Concrete pads and pavements shall be constructed with sufficient slope to drain properly.

3.8 PLACING CONCRETE FOR VEHICULAR PAVEMENT

- A. Deposit concrete into the forms as close as possible to its final position.
- B. Place concrete rapidly and continuously between construction joints.
- C. Strike off concrete and thoroughly consolidate by a finishing machine, vibrating screed, or by hand-finishing.
- D. Finish the surface to the elevation and crown as shown.
- E. Deposit concrete as near the joints as possible without disturbing them but do not dump onto a joint assembly. Do not place adjacent lanes without approval by the COTR.

3.9 CONCRETE FINISHING - GENERAL

- A. The sequence of operations, unless otherwise indicated, shall be as follows:
 - 1. Consolidating, floating, straight-edging, troweling, texturing, and edging of joints.
 - 2. Maintain finishing equipment and tools in a clean and approved condition.

3.10 CONCRETE FINISHING CURB AND GUTTER

- A. Round the edges of the gutter and top of the curb with an edging tool to a radius of 6mm (1/4 inch) or as otherwise detailed.

- B. Float the surfaces and finish with a smooth wood or metal float until true to grade and section and uniform in textures.
- C. Finish the surfaces, while still wet, with a bristle type brush with longitudinal strokes.
- D. Immediately after removing the front curb form, rub the face of the curb with a wood or concrete rubbing block and water until blemishes, form marks, and tool marks have been removed. Brush the surface, while still wet, in the same manner as the gutter and curb top.
- E. Except at grade changes or curves, finished surfaces shall not vary more than 3 mm (1/8 inch) for gutter and 6 mm (1/4 inch) for top and face of curb, when tested with a 3000 mm (10 foot) straightedge.
- F. Remove and reconstruct irregularities exceeding the above for the full length between regularly scheduled joints.
- G. Correct any depressions which will not drain.
- H. Visible surfaces and edges of finished combination curb and gutter shall be free of blemishes, form marks, and tool marks, and shall be uniform in color, shape, and appearance.

3.11 CONCRETE FINISHING PEDESTRIAN PAVEMENT

- A. Walks, Grade Slabs
 - 1. Finish the surfaces to grade and cross section with a metal float, trowled smooth and finished with a broom moistened with clear water.
 - 2. Brooming shall be transverse to the line of traffic.
 - 3. Finish all slab edges, including those at formed joints, carefully with an edger having a radius as shown on the Drawings.
 - 4. Unless otherwise indicated, edge the transverse joints before brooming. The brooming shall eliminate the flat surface left by the surface face of the edger. Execute the brooming so that the corrugation, thus produced, will be uniform in appearance and not more than 2 mm (1/16 inch) in depth.
 - 5. The completed surface shall be uniform in color and free of surface blemishes, form marks, and tool marks. The finished surface of the pavement shall not vary more than 5 mm (3/16 inch) when tested with a 3000 mm (10 foot) straightedge.
 - 6. The thickness of the pavement shall not vary more than 6 mm (1/4 inch).
 - 7. Remove and reconstruct irregularities exceeding the above for the full length between regularly scheduled joints.

- B. Steps: The method of finishing the steps and the sidewalls is similar to above except as herein noted.
1. Remove the riser forms one at a time, starting with the top riser.
 2. After removing the riser form, rub the face of the riser with a wood or concrete rubbing block and water until blemishes, form marks, and tool marks have been removed. Use an outside edger to round the corner of the tread; use an inside edger to finish the corner at the bottom of the riser.
 3. Give the risers and sidewall a final brush finish. The treads shall have a final finish with a stiff brush to provide a non-slip surface.
 4. The texture of the completed steps shall present a neat and uniform appearance and shall not deviate from a straightedge test more than 5 mm (3/16 inch).

3.12 CONCRETE FINISHING FOR VEHICULAR PAVEMENT

- A. Accomplish longitudinal floating with a longitudinal float not less than 3000 mm (10 feet) long and 150 mm (6 inches) wide, properly stiffened to prevent flexing and warping. Operate the float from foot bridges in a sawing motion parallel to the direction in which the pavement is being laid from one side of the pavement to the other, and advancing not more than half the length of the float.
- B. After the longitudinal floating is completed, but while the concrete is still plastic, eliminate minor irregularities in the pavement surfaces by means of metal floats, 1500 mm (5 feet) in length, and straightedges, 3000 mm (10 feet) in length. Make the final finish with the straightedges, which shall be used to float the entire pavement surface.
- C. Test the surface for trueness with a 3000 mm (10 foot) straightedge held in successive positions parallel and at right angles to the direction in which the pavement is being laid and the entire area covered as necessary to detect variations. Advance the straightedge along the pavement in successive stages of not more than one half the length of the straightedge. Correct all irregularities and refinish the surface.
- D. The finished surface of the pavement shall not vary more than 6 mm (1/4 inch) in both longitudinal and transverse directions when tested with a 3000 mm (10 foot) straightedge.
- E. The thickness of the pavement shall not vary more than 6 mm (1/4 inch).

- F. When most of the water glaze or sheen has disappeared and before the concrete becomes nonplastic, give the surface of the pavement a broomed finish with an approved fiber broom not less than 450 mm (18 inches) wide. Pull the broom gently over the surface of the pavement from edge to edge. Brooming shall be transverse to the line of traffic and so executed that the corrugations thus produced will be uniform in character and width, and not more than 3 mm (1/8 inch) in depth. Carefully finish the edge of the pavement along forms and at the joints with an edging tool. The brooming shall eliminate the flat surface left by the surface face of the edger.
- G. The finish surfaces of new and existing abutting pavements shall coincide at their juncture.

3.13 CONCRETE FINISHING EQUIPMENT PADS

- A. After the surface has been struck off and screeded to the proper elevation, give it a smooth dense float finish, free from depressions or irregularities.
- B. Carefully finish all slab edges with an edger having a radius as shown in the Drawings.
- C. After removing the forms, rub the faces of the pad with a wood or concrete rubbing block and water until blemishes, form marks, and tool marks have been removed. The finish surface of the pad shall not vary more than 3 mm (1/8 inch) when tested with a 3000 mm (10 foot) straightedge.
- D. Correct irregularities exceeding the above.

3.14 JOINTS - GENERAL

- A. Place joints, where shown, conforming to the details as shown, and perpendicular to the finished grade of the concrete surface.
- B. Joints shall be straight and continuous from edge to edge of the pavement.

3.15 CONTRACTION JOINTS

- A. Cut joints to depth as shown with a grooving tool or jointer of a radius as shown or by sawing with a blade producing the required width and depth.
- B. Construct joints in curbs and gutters by inserting 3 mm (1/8 inch) steel plates conforming to the cross sections of the curb and gutter.
- C. Plates shall remain in place until concrete has set sufficiently to hold its shape and shall then be removed.

D. Finish edges of all joints with an edging tool having the radius as shown.

E. Score pedestrian pavement with a standard grooving tool or jointer.

3.16 EXPANSION JOINTS

A. Use a preformed expansion joint filler material of the thickness as shown to form expansion joints.

B. Material shall extend the full depth of concrete, cut and shaped to the cross section as shown, except that top edges of joint filler shall be below the finished concrete surface where shown to allow for sealing.

C. Anchor with approved devices to prevent displacing during placing and finishing operations.

D. Round the edges of joints with an edging tool.

E. Form expansion joints as follows:

1. Without dowels, about structures and features that project through, into, or against any site work concrete construction.
2. Using joint filler of the type, thickness, and width as shown.
3. Installed in such a manner as to form a complete, uniform separation between the structure and the site work concrete item.

3.17 CONSTRUCTION JOINTS

A. Locate longitudinal and transverse construction joints between slabs of vehicular pavement as shown.

B. Place transverse construction joints of the type shown, where indicated and whenever the placing of concrete is suspended for more than 30 minutes.

C. Use a butt-type joint with dowels in curb and gutter if the joint occurs at the location of a planned joint.

D. Use keyed joints with tiebars if the joint occurs in the middle third of the normal curb and gutter joint interval.

3.18 FORM REMOVAL

A. Forms shall remain in place at least 12 hours after the concrete has been placed. Remove forms without injuring the concrete.

B. Do not use bars or heavy tools against the concrete in removing the forms. Promptly repair any concrete found defective after form removal.

3.20 CURING OF CONCRETE

A. Cure concrete by one of the following methods appropriate to the weather conditions and local construction practices, against loss of moisture, and rapid temperature changes for at least seven days from the beginning of the curing operation. Protect unhardened concrete from

rain and flowing water. All equipment needed for adequate curing and protection of the concrete shall be on hand and ready to install before actual concrete placement begins. Provide protection as necessary to prevent cracking of the pavement due to temperature changes during the curing period. If any selected method of curing does not afford the proper curing and protection against concrete cracking, remove and replace the damaged pavement and employ another method of curing as directed by the Resident Engineer.

- B. Burlap Mat: Provide a minimum of two layers kept saturated with water for the curing period. Mats shall overlap each other at least 150 mm (6 inches).
- C. Impervious Sheeting: Use waterproof paper, polyethylene-coated burlap, or polyethylene sheeting. Polyethylene shall be at least 0.1 mm (4 mils) in thickness. Wet the entire exposed concrete surface with a fine spray of water and then cover with the sheeting material. Sheets shall overlap each other at least 300 mm (12 inches). Securely anchor sheeting.
- D. Liquid Membrane Curing:
 - 1. Apply pigmented membrane-forming curing compound in two coats at right angles to each other at a rate of 5 m²/L (200 square feet per gallon) for both coats.
 - 2. Do not allow the concrete to dry before the application of the membrane.
 - 3. Cure joints designated to be sealed by inserting moistened paper or fiber rope or covering with waterproof paper prior to application of the curing compound, in a manner to prevent the curing compound entering the joint.
 - 4. Immediately re-spray any area covered with curing compound and damaged during the curing period.

3.21 CLEANING

- A. After completion of the curing period:
 - 1. Remove the curing material (other than liquid membrane).
 - 2. Sweep the concrete clean.
 - 3. After removal of all foreign matter from the joints, seal joints as herein specified.
 - 4. Clean the entire concrete of all debris and construction equipment as soon as curing and sealing of joints has been completed.

3.22 PROTECTION

The contractor shall protect the concrete against all damage prior to final acceptance by the Government. Remove concrete containing excessive cracking, fractures, spalling, or other defects and reconstruct the entire section between regularly scheduled joints, when directed by the COTR, and at no additional cost to the Government. Exclude traffic from vehicular pavement until the concrete is at least seven days old, or for a longer period of time if so directed by the COTR.

3.23 FINAL CLEAN-UP

Remove all debris, rubbish and excess material from the Station.

- - - E N D - - -

SECTION 32 12 16
ASPHALT PAVING

PART 1 - GENERAL

1.1 DESCRIPTION

This work shall cover the composition, mixing, construction upon the prepared subgrade, and the protection of hot asphalt concrete pavement. The hot asphalt concrete pavement shall consist of an aggregate or asphalt base course and asphalt surface course constructed in conformity with the lines, grades, thickness, and cross sections as shown. Each course shall be constructed to the depth, section, or elevation required by the drawings and shall be rolled, finished, and approved before the placement of the next course.

1.2 RELATED WORK

- A. Laboratory and field testing requirements: Section 01 45 29, TESTING LABORATORY SERVICES.
- B. Subgrade Preparation: Paragraph 3.3 and Section 31 20 00, EARTH MOVING.
- C. Pavement Markings: Section 32 17 23, PAVEMENT MARKINGS.

1.3 INSPECTION OF PLANT AND EQUIPMENT

The Contracting Officer's Technical Representative (COTR) shall have access at all times to all parts of the material producing plants for checking the mixing operations and materials and the adequacy of the equipment in use.

1.4 ALIGNMENT AND GRADE CONTROL

The Contractor's Registered Professional Land Surveyor shall establish and control the pavement (aggregate or asphalt base course and asphalt surface course) alignments, grades, elevations, and cross sections as shown on the Drawings.

1.5 SUBMITTALS

- A. In accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES, furnish the following:
- B. Data and Test Reports:
 - 1. Aggregate Base Course: Sources, gradation, liquid limit, plasticity index, percentage of wear, and other tests required by State Highway Department.
 - 2. Asphalt Base/Surface Course: Aggregate source, gradation, soundness loss, percentage of wear, and other tests required by State Highway Department.
 - 3. Job-mix formula.

C. Certifications:

1. Asphalt prime and tack coat material certificate of conformance to West Virginia Dept. of Transportation requirements.
 2. Asphalt cement certificate of conformance to West Virginia Dept. of Transportation.
 3. Job-mix certification - Submit plant mix certification that mix equals or exceeds the West Virginia Dept. of Transportation.
- D. One copy of the West Virginia Dept. of Transportation Specifications.
- E. Provide MSDS (Material Safety Data Sheets) for all chemicals used on ground.

PART 2 - PRODUCTS

2.1 GENERAL

- A. Aggregate base, Asphaltic base, and asphalt concrete materials shall conform to the requirements of the following and other appropriate sections of the latest version of the West Virginia Dept. of Transportation Specifications, including amendments, addenda and errata. Where the term "Engineer" or "Commission" is referenced in the State Highway Specifications, it shall mean the COTR.

2.2 AGGREGATES

- A. Provide aggregates consisting of crushed stone conforming with West Virginia Dept. of Transportation Type 1 or Type 2.
- B. Subbase aggregate (where required) maximum size: 38mm(1-1/2 inch).
- C. Base aggregate maximum size:
1. Base course over 152mm(6 inch) thick: 38mm(1-1/2 inch);
 2. Other base courses: 19mm(3/4 inch).
- D. Asphaltic base course:
1. Maximum particle size not to exceed 25.4mm(1 inch).
 2. Where conflicts arise between this specification and the requirements in the latest version of the West Virginia Dept. of Transportation Specifications, the State Specifications shall control.
- E. Aggregates for asphaltic concrete paving: Provide a mixture of sand, mineral aggregate, and liquid asphalt mixed in such proportions that the percentage by weight will be within:

<u>Sieve Sizes</u>	<u>Percentage Passing</u>
19mm (3/4 inch)	100
9.5mm (3/8 inch)	67 to 85
6.4mm (1/4 inch)	50 to 65
2.4mm (No. 8 mesh)	37 to 50
600µm (No. 30 mesh)	15 to 25
75µm (No. 200 mesh)	3 to 8

plus 50/60 penetration liquid asphalt at 5 percent to 6-1/2 percent of the combined dry aggregates.

2.3 ASPHALTS

A. Comply with provisions of Asphalt Institute Specification SS2 and the West Virginia Department of Transportation Specifications:

1. Asphalt cement: Penetration grade 50/60
2. Prime coat: Cut-back type, grade MC-250
3. Tack coat: Uniformly emulsified, grade SS-1H

2.4 SEALER

- A. Provide a sealer consisting of suitable fibrated chemical type asphalt base binders and fillers having a container consistency suitable for troweling after thorough stirring, and containing no clay or other deleterious substance.
- B. Where conflicts arise between this specification and the requirements in the latest version of the State Highway Specifications, the State Specifications shall control.

PART 3 - EXECUTION

3.1 GENERAL

The Asphalt Concrete Paving equipment, weather limitations, job-mix formula, mixing, construction methods, compaction, finishing, tolerance, and protection shall conform to the requirements of the appropriate sections of the State Highway Specifications for the type of material specified.

3.2 MIXING ASPHALTIC CONCRETE MATERIALS

- A. Provide hot plant-mixed asphaltic concrete paving materials.
1. Temperature leaving the plant: 143 degrees C (290 degrees F) minimum, 160 degrees C (320 degrees F) maximum.
 2. Temperature at time of placing: 138 degrees C (280 degrees F) minimum.

3.3 SUBGRADE

- A. Shape to line and grade and compact with self-propelled rollers.
- B. All depressions that develop under rolling shall be filled with acceptable material and the area re-rolled.
- C. Soft areas shall be removed and filled with acceptable materials and the area re-rolled.
- D. Should the subgrade become rutted or displaced prior to the placing of the subbase, it shall be reworked to bring to line and grade.
- E. Proof-roll the subgrade with maximum 45 tonne (50 ton) gross weight dump truck as directed by COTR. If pumping, pushing, or other movement is observed, rework the area to provide a stable and compacted subgrade.

3.4 BASE COURSES

- A. Subbase
 - 1. Spread and compact to the thickness shown on the drawings.
 - 2. Rolling shall begin at the sides and continue toward the center and shall continue until there is no movement ahead of the roller.
 - 3. After completion of the subbase rolling there shall be no hauling over the subbase other than the delivery of material for the top course.
- B. Base
 - 1. Spread and compact to the thickness shown on the drawings.
 - 2. Rolling shall begin at the sides and continue toward the center and shall continue until there is no movement ahead of the roller.
 - 3. After completion of the base rolling there shall be no hauling over the base other than the delivery of material for the top course.
- C. Thickness tolerance: Provide the compacted thicknesses shown on the Drawings within a tolerance of minus 0.0mm (0.0 inch) to plus 12.7mm (0.5 inch).
- D. Smoothness tolerance: Provide the lines and grades shown on the Drawings within a tolerance of 5mm in 3m (3/16 inch in ten feet).
- E. Moisture content: Use only the amount of moisture needed to achieve the specified compaction.

3.5 PLACEMENT OF ASPHALTIC CONCRETE PAVING

- A. Remove all loose materials from the compacted base.
- B. Apply the specified prime coat, and tack coat where required, and allow to dry in accordance with the manufacturer's recommendations as approved by the Architect or Engineer.

C. Receipt of asphaltic concrete materials:

1. Do not accept material unless it is covered with a tarpaulin until unloaded, and unless the material has a temperature of not less than 130 degrees C (280 degrees F).
2. Do not commence placement of asphaltic concrete materials when the atmospheric temperature is below 10 degrees C (50 degrees F), not during fog, rain, or other unsuitable conditions.

D. Spreading:

1. Spread material in a manner that requires the least handling.
2. Where thickness of finished paving will be 76mm (3 inch) or less, spread in one layer.

E. Rolling:

1. After the material has been spread to the proper depth, roll until the surface is hard, smooth, unyielding, and true to the thickness and elevations shown on the drawings.
2. Roll in at least two directions until no roller marks are visible.
3. Finished paving smoothness tolerance:
 - a. No depressions which will retain standing water.
 - b. No deviation greater than 3mm in 1.8m (1/8 inch in six feet).

3.6 APPLICATION OF SEAL COAT

- A. Prepare the surfaces, mix the seal coat material, and apply in accordance with the manufacturer's recommendations as approved by the Architect or Engineer.
- B. Apply one coat of the specified sealer.
- C. Achieve a finished surface seal which, when dry and thoroughly set, is smooth, tough, resilient, of uniform black color, and free from coarse textured areas, lap marks, ridges, and other surface irregularities.

3.7 PROTECTION

Protect the asphaltic concrete paved areas from traffic until the sealer is set and cured and does not pick up under foot or wheeled traffic.

3.8 FINAL CLEAN-UP

Remove all debris, rubbish, and excess material from the work area.

- - - E N D - - -

**SECTION 32 17 23
PAVEMENT MARKINGS**

PART 1 - GENERAL

1.1 DESCRIPTION

This work shall consist of furnishing and applying paint and reflective glass beads on pavement surfaces, in the form of traffic lanes, parking bays, areas restricted to handicapped persons, crosswalks, and other detail pavement markings, in accordance with the details as shown or as prescribed by the Contracting Officer's Technical Representative (COTR). Conform to the Manual on Uniform Traffic Control Devices for Streets and Highways, published by the U.S. Department of Transportation, Federal Highway Administration, for details not shown.

1.2 SUBMITTALS

- A. In accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES, furnish Manufacturer's Certificates and Data certifying that the following materials conform to the requirements specified.
- B. Paint.
- C. Reflective Glass Beads

1.3 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. Federal Specifications (Fed. Spec.):
 - TT-B-1325C.....Beads (Glass Spheres); Retro-Reflective
 - TT-P-1952D.....Paint, Traffic Black, and Airfield Marking,
Waterborne
- C. Master Painters Institute (MPI):
 - Approved Product List - 2010

PART 2 - PRODUCTS

2.1 PAINT

Paint for marking pavement (parking lot and zone marking) shall conform to MPI No. 97, color as shown. Paint for obliterating existing markings shall conform to Fed. Spec. TT-P-1952D. Paint shall be in containers of at least 18 L (5 gallons). A certificate shall accompany each batch of paint stating compliance with the applicable publication.

2.2 REFLECTIVE GLASS BEADS

Beads shall conform to Fed. Spec. TT-B-1325C, Type I, Gradation A. When used in regions of high humidity, coat beads with silicone or other suitable waterproofing material to assure free flow. Furnish the glass beads in containers suitable for handling and strong enough to prevent loss during shipment. A certificate shall accompany each batch of beads stating compliance with this section.

2.3 PAINT APPLICATOR

Apply all marking by approved mechanical equipment. The equipment shall provide constant agitation of paint and travel at controlled speeds. Synchronize one or more paint "guns" to automatically begin and cut off paint flow in the case of skip lines. The equipment shall have manual control to apply continuous lines of varying length and marking widths as shown. Provide pneumatic spray guns for hand application of paint in areas where a mobile paint applicator cannot be used. If the equipment does not have a glass bead dispenser, use a separate piece of equipment. Adjust and synchronize the equipment with the paint applicator so that the reflective beads are distributed uniformly on the paint lines within ten seconds without any waste. An experienced technician that is thoroughly familiar with equipment, materials, and marking layouts shall control all painting equipment and operations.

2.4 SANDBLASTING EQUIPMENT

Sandblasting equipment shall include an air compressor, hoses, and nozzles of proper size and capacity as required for cleaning surfaces to be painted. The compressor shall furnish not less than 0.08 m³/s (150 cfm) of air at a pressure of not less than 625 kPa (90 psi) at each nozzle used.

PART 3 - EXECUTION

3.1 SURFACE PREPARATION

- A. Allow new pavement surfaces to cure for a period of not less than 14 days before application of marking materials.
- B. Thoroughly clean all surfaces to be marked before application of paint. Remove dust, dirt, and other granular surface deposits by sweeping, blowing with compressed air, rinsing with water, or a combination of these methods. Completely remove rubber deposits, existing paint markings, and other coatings adhering to the pavement with scrapers, wire brushings, sandblasting, mechanical abrasion, or approved chemicals as directed by the Resident Engineer. The application of

paint conforming to Fed. Spec. TT-P-1952D is an option to removal of existing paint markings on asphalt pavement. Apply the black paint in as many coats as necessary to completely obliterate the existing markings. Where oil or grease are present on old pavements to be marked, scrub affected areas with several applications of trisodium phosphate solution or other approved detergent or degreaser, and rinse thoroughly after each application. After cleaning, seal oil-soaked areas with cut shellac to prevent bleeding through the new paint. Pavement marking shall follow as closely as practicable after the surface has been cleaned and dried, but do not begin any marking until the Resident Engineer has inspected the surface and gives permission to proceed. The Contractor shall establish control points for marking and provide templates to control paint application by type and color at necessary intervals. The Contractor is responsible to preserve and apply marking in conformance with the established control points.

3.2 APPLICATION

Apply uniformly painted and reflective pavement marking of required color(s), length, and width with true, sharp edges and ends on properly cured, prepared, and dried surfaces in conformance with the details as shown and established control points. The length and width of lines shall conform within a tolerance of plus or minus 75 mm (3 inches) and plus or minus 3 mm (1/8 inch), respectively, in the case of skip markings. The length of intervals shall not exceed the line length tolerance. Temperature of the surface to be painted and the atmosphere shall be above 10°C (50°F) and less than 35°C (95°F). Apply the paint at a wet film thickness of 0.4 mm (0.015 inch). Disperse reflective glass beads evenly on the wet paint at a rate of 720 g/L (6 pounds per gallon) of paint. Apply paint in one coat. At the direction of the Resident Engineer, markings showing light spots may receive additional coats. The maximum drying time requirements of the paint specifications will be strictly enforced, to prevent undue softening of asphalt, and pick-up, displacement, or discoloration by tires of traffic. If there is a deficiency in drying of the marking, discontinue paint operations until cause of the slow drying is determined and corrected. Remove and replace marking that is applied at less than minimum material rates; deviates from true alignment; exceeds stipulated length and width tolerances; or shows light spots, faulty distribution of beads, smears, or other deficiencies or irregularities. Use carefully controlled sand

blasting, approved grinding equipment, or other approved method to remove marking so that the surface to which the marking was applied will not be damaged.

3.3 PROTECTION

Conduct operations in such a manner that necessary traffic can move without hindrance. Protect the newly painted markings so that, insofar as possible, the tires of passing vehicles will not pick up paint. Place warning signs at the beginning of the wet line, and at points well in advance of the marking equipment for alerting approaching traffic from both directions. Place small flags or other similarly effective small objects near freshly applied markings at frequent intervals to reduce crossing by traffic. Efface and replace damaged portions of markings at no additional cost to the Government.

3.4 DETAIL PAVEMENT MARKING

Use Detail Pavement Markings, exclusive of actual traffic lane marking, at exit and entrance islands and turnouts, on curbs, at crosswalks, at parking bays, and at such other locations as shown. Show the International Handicapped Symbol at indicated parking spaces. Color shall be as shown. Apply paint for the symbol using a suitable template that will provide a pavement marking with true, sharp edges and ends. Place detail pavement markings of the color(s), width(s) and length(s), and design pattern at the locations shown.

3.5 FINAL CLEAN-UP

Remove all debris, rubbish and excess material from the Station.

- - - E N D - - -

SECTION 32 31 53
PERIMETER SECURITY FENCES AND GATES

PART 1 - GENERAL

1.1 DESCRIPTION

This work consists of all labor, materials, and equipment necessary for furnishing and installing ornamental metal anti-climb fences, gate and accessories in conformance with the lines, grades, and details as shown for the Adult Day Care Building Courtyard.

1.2 RELATED WORK

- A. Grounding of fencing for enclosures of electrical equipment and for lightning protection as shown: Section 26 05 26 GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS.
- B. Temporary Construction Fence: Section 01 00 00, GENERAL REQUIREMENTS.
- C. Finish Grading: Sections 31 20 00, EARTH MOVING and 32 90 00, PLANTING.
- D. Card readers and biometric devices: Section 28 13 11, PHYSICAL ACCESS CONTROL SYSTEMS.

1.3 MANUFACTURER'S QUALIFICATIONS

- A. Fence, gates, and accessories shall be products of manufacturers regularly engaged in manufacturing items of type specified.

1.4 SUBMITTALS

- A. In accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA AND SAMPLES, furnish the following:
 - 1. Manufacturer's Literature and Data: Fencing, gates and all accessories.

1.5 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American Society for Testing and Materials (ASTM):
 - C94/C94M-07.....Ready-Mixed Concrete
 - F626-96a(2003).....Fence Fittings
 - A653/A653M.....Standard Specification for Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy Coated (Galvannealed) by the Hot-Dip Process.
 - B117.....Practice for Operating Salt-Spray (Fog) Apparatus.
 - D523.....Test Method for Specular Gloss.

D714.....Test Method for Evaluating Degree of Blistering
in Paint.

D822.....Practice for Conducting Tests on Paint and
Related Coatings and Materials using Filtered
Open-Flame Carbon-Arc Light and Water Exposure
Apparatus.

D1654.....Test Method for Evaluation of Painted or Coated
Specimens Subjected to Corrosive Environments.

D2244.....Test Method for Calculation of Color
Differences from Instrumentally Measured Color
Coordinates.

D2794.....Test Method for Resistance of Organic Coatings
to the Effects of Rapid Deformation (Impact).

D3359.....Test Method for Measuring Adhesion by Tape
Test.

F2408.....Ornamental Fences Employing Galvanized Steel
Tubular Pickets.

PART 2 - PRODUCTS

2.1 GENERAL

A. Materials shall conform to ASTM F1083 ferrous metals; and detailed specifications forming the various parts thereto; and other requirements specified herein.

2.2 PERIMETER SECURITY FENCE

- A. The system shall include all components such as pickets, rails, posts, gates and hardware required.
 - 1. Fence configuration as shown on Architectural drawings.
- B. Steel Material for fence panels and posts shall conform to the requirements of ASTM A653/A653M, with a minimum yield strength of 45,000 psi (310 MPa) and a minimum zinc (hot-dip galvanized) coating weight of 0.90 oz/ft² (276 g/m²), Coating Designation G-90.
- C. Material for pickets shall be 1 inch square x 14 Ga. tubing. The rails shall be steel channel, 1.75 inches x 1.75 inches x .105 inches. Picket holes in the rail shall be spaced 4.715 inches o.c. Fence posts and gate posts shall meet the minimum size requirements of Table 1.
- D. Heights:
 - 1. Horizontal members that might be used as foot- or hand-holds shall be spaced at a minimum 8 feet (2400 mm) apart.
 - 2. Extend fence posts 3 feet below grade.

2.3 FABRICATION

- A. Pickets, rails and posts shall be pre-cut to specified lengths. Rails shall be pre-punched to accept pickets.
- B. Pickets shall be inserted into the pre-punched holes in the rails and shall be aligned to standard spacing using a specifically calibrated alignment fixture. The aligned pickets and rails shall be joined at each picket-to-rail intersection by fusion welding process.
- C. The manufactured panels and posts shall be subjected to an inline electrodeposition coating (E-Coat) process consisting of a multi-stage pretreatment/wash (with zinc phosphate), followed by a duplex application of an epoxy primer and an acrylic topcoat. The minimum cumulative coating thickness of epoxy and acrylic shall be 2 mils (0.058 mm). The color shall be selected by Architect. The coated panels and posts shall be capable of meeting the performance requirements of ASTM F2408.
- D. The manufactured fence system shall be capable of meeting the vertical load, horizontal load, and infill performance requirements for Industrial weight fences under ASTM F2408.
- E. Swing gates shall be fabricated using 1.75 inch x 14ga Forerunner double channel rail, 2 inch sq. x 11ga. gate ends, and 1 inch sq. x 14ga. pickets. All rail and upright intersections shall be joined by welding. All picket and rail intersections shall also be joined by welding. Gusset plates will be welded at each upright to rail intersection.

PART 3 - EXECUTION

3.1 PREPARATION

All new installation shall be laid out by the Contractor in accordance with the construction plans.

3.2 FENCE INSTALLATION

Fence post shall be spaced according to Table 3, plus or minus 1/2 inch. For installations that must be raked to follow sloping grades, the post spacing dimension must be measured along the grade. Fence panels shall be attached to posts with brackets supplied by the manufacturer. Posts shall be set in concrete footers having a minimum depth of 36 inches. Posts setting by other methods such as plated posts or grouted core-drilled footers are permissible only if shown by engineering analysis to be sufficient in strength for the intended application.

3.3 FENCE INSTALLATION MAINTENANCE

When cutting/drilling rails or posts adhere to the following steps to seal the exposed surfaces:

1. Remove all metal shavings from cut area.
2. Apply zinc-rich primer to thoroughly cover cut edge and/or drilled hole.
3. Apply 2 coats of custom finish paint matching fence color.

Failure to seal exposed surface per steps 1-3 above will negate warranty. Manufacturer's spray cans or paint pens shall be used to prime and finish exposed surfaces. Use of parts or components not provided by fence manufacturer shall not be used unless allowed by said manufacturer without affecting warranty.

3.4 GATE INSTALLATION

Gate posts shall be spaced according to the manufacturer's gate drawings, dependent on standard out-to-out gate leaf dimensions and gate hardware selected. Type and quantity of gate hinges shall be based on the application; weight, height, and number of gate cycles. The manufacturer's gate drawings shall identify the necessary gate hardware required for the application. Gate hardware shall be provided by the manufacturer of the gate and shall be installed per manufacturer's recommendations.

3.5 CLEANING

The Contractor shall clean the jobsite of excess materials; post-hole excavations shall be scattered uniformly away from posts.

- - - E N D - - -

SECTION 32 32 23
SEGMENTAL RETAINING WALLS

PART 1 - GENERAL

1.1 DESCRIPTION

- A. Work Included: Furnish and install segmental retaining wall (SRW) units to the lines and grades designated on the construction plans or as directed by the ARCHITECT/ENGINEER. Also included is furnishing and installing appurtenant materials required for construction of the retaining wall as shown on the construction plans.

1.2 RELATED WORK

- A. Related Sections: Additional Sections of the Documents which are referenced in this Section include:
1. Section 31 00 00 - Earthwork

1.3 REFERENCES

- A. General: The work shall comply with the most recent standards or tentative standards as published at the date of the contract and as listed in this specification using the abbreviation shown.
- B. American Society for Testing and Materials (ASTM):
1. C90 Standard Specification for Loadbearing Concrete Masonry Units
 2. C140 Standard Test Methods of Sampling and Testing Concrete Masonry Units and Related Units
 3. D698 Standard Test Method for Laboratory Compaction Characteristics of Soil Using Standard Effort (12,400 ft-lbf/ft³) (600kN-m/m³)
 4. D6638 Standard Test Method for Determining Connection Strength Between Geosynthetic Reinforcement and Segmental Concrete Units (Modular Concrete Blocks)
- C. National Concrete Masonry Association (NCMA):

1. Design Manual for Segmental Retaining Walls (Second Edition).

D. Where specifications and reference documents conflict, the ARCHITECT/ENGINEER shall make the final determination of applicable document.

1.4 CERTIFICATION

A. General: Submit a notarized manufacturer's certification prior to start of work stating that the SRW units meet the requirements of this specification.

1.5 DELIVERY, STORAGE AND HANDLING

A. General: Check the materials upon delivery to assure that specified type, grade, color and texture of SRW units has been received. Prevent excessive mud, wet concrete, epoxies, and like materials which may affix themselves, from coming in contact with the materials.

B. Damage: Protect the materials from damage. Damaged material shall not be incorporated into the reinforced soil wall.

PART 2 - MATERIALS

2.1 SEGMENTAL RETAINING WALL UNITS

A. Architectural Requirements: SRW units shall meet the following Architectural requirements:

1. Color of SRW units shall be determined by COTR.
2. Finish of SRW units shall be split face.
3. SRW unit faces shall be of straight geometry.
4. SRW units shall be capable of being erected with a variable bond configuration. Bond should vary between 1/4 to 3/4 bond.
5. All SRW units shall be sound and free of cracks or other defects that would interfere with the proper placing of the unit or significantly impair the strength or permanence of the construction. Cracking or excessive chipping may be grounds for rejection. Units showing cracks larger than

1/2 inch when measured along their length shall not be used within the wall. Units showing chips visible at a distance of 30 feet from the wall shall not be used within the wall.

B. Structural Requirements: SRW units shall meet the following structural requirements:

1. The SRW units shall be solid through the full depth of the unit.
2. For constructability considerations, the SRW units shall provide a minimum weight of 125 psf of wall face area.
3. Concrete used to manufacture SRW units shall have a minimum 28 days compressive strength of 3000 psi in accordance with ASTM C90 and C140. The concrete shall have adequate freeze/thaw protection with a maximum moisture absorption rate, by weight of 8 percent. Compressive strength test specimens shall conform to the saw-cut coupon provisions of Section 5.2.4 of ASTM C140 with the following exception: Coupon shall be taken from the least dimension of the unit of a size and shape representing the geometry of the unit as a whole.
4. SRW units molded dimensions shall not differ more than +/- 1/8 inch from that specified, except height which shall be +/- 1/16 inch.

C. Constructability and Geometric Requirements: SRW units shall meet the following constructability and geometric requirements:

1. Units shall be capable of attaining concave and convex curves and 90 to 140 degrees inside corners and 25 to 90 degree outside corners.
2. Units shall provide a 3/4 inch horizontal setback per 6 inch-high course (a cant of 7 degrees from vertical). The installed wall cant shall not differ more than +/- 2 degrees from that specified.

2.2 SEGMENTAL RETAINING WALL UNIT INTERLOCKING DEVICES

- A. General: Unit shall be positively engaged to the unit below with connection pins.

2.3 LEVELING PAD

- A. Material: for leveling pad shall consist of compacted sand or gravel or low strength unreinforced concrete and shall be a minimum of 6 inches in depth. The leveling pad should extend laterally at least a distance of 6 inches beyond the toe and heel of the lower most SRW unit, or as indicated on the structural design drawings provided by the manufacturer of the wall system.
- B. Mechanical Vibrations: Do not run mechanical vibrating plate compactors on top of the units. Compact fill between units by running hand-operated compaction equipment just behind unit. Compact to minimum 95 percent of maximum density as measured by ASTM D698.

2.4 DRAINAGE AGGREGATE

- A. Drainage Fill Materials: shall be the free draining gravel, size to be specified on the structural design drawings provided by the manufacturer of the wall system..
- B. Vertical Drainage: layer behind the wall face shall be placed in strict accordance with the structural design drawings provided by the manufacturer of the wall system.

2.5 REINFORCED BACKFILL

- A. Reinforced Backfill Material: The reinforced backfill material shall be free of debris and consist of either of the following inorganic soil types according to their USCS designations (GP, GW, SW, SP, SM, ML, CL). The maximum particle size shall be 4 inches. There shall be less than 20 percent by weight of particles greater than 1 1/2 inches, maximum 60 percent by weight passing the #200 sieve and PI<20.
- B. Backfill Compaction: The reinforced backfill shall be compacted in maximum 8 inch-thick compacted lifts to a minimum density of 95 percent of the maximum theoretical density as determined ASTM D698.

PART 3 - EXECUTION

3.1 EXCAVATION

- A. General: Excavate to the lines and grades shown on the project grading plans. CONTRACTOR shall take precautions to minimize over-excavation. Over-excavation shall be filled with compacted infill material, or as directed by the ENGINEER, at the CONTRACTOR's expense.
- B. Inspection: CONTRACTOR's Geotechnical Engineer will inspect the excavation and approve prior to placement of leveling pad material.
- C. Verify location of existing structures and utilities prior to excavation. Ensure all surrounding structures are protected from the effects of wall excavation.

3.2 LEVELING PAD CONSTRUCTION

- A. General: Leveling pad shall be placed as shown on the structural design plans provided by the manufacturer of the wall system.
- B. Foundation Soil: shall be proofrolled and compacted to 95 percent of maximum theoretical density as determined by ASTM D698, and inspected by the CONTRACTOR's Geotechnical Engineer prior to placement of leveling pad materials.
- C. Soil Leveling pad material: shall be compacted to provide a level hard surface on which to place the first course of units. Materials and compaction requirements shall be detailed on the structural design plans provided by the manufacturer of the wall system.
- D. Leveling Pad: shall be prepared to ensure intimate contact of SRW units with pad.

3.3 SRW UNIT INSTALLATION

- A. General: First course of SRW units shall be placed on the leveling pad. The units shall be leveled side-to-side, front-to-rear and aligned with adjacent units. The first course is the most important to ensure accurate and acceptable results. Insure that units are in full contact with base.
- B. Place the front of the units side-by-side. Do not leave gaps between the front of adjacent units. Alignment may be done by means of a string line or offset from base line to the back of the units or along the pinning grooves. Lay out of curves and corners in accordance with SRW manufacturer's installation guidelines.
- C. Placement and Compaction: Place and compact drainage fill between and behind units. Place and compact infill soil behind drainage fill.
- D. Debris: Clean all excess debris from top of units and install next course.

- E. Interlocking Pin or Clip Insert: Interlocking pin or clip devices shall be installed in accordance with the manufacturer's specifications.
- F. Procedures: Repeat procedures to the extent of the wall height, ensuring that pins are engaged in each successive course.
- G. SRW caps shall be glued to underlying units with manufacturer's recommended concrete adhesive.

- - - E N D - - -

**SECTION 32 90 00
PLANTING**

PART 1 - GENERAL

1.1 DESCRIPTION

This work consists of furnishing and installing all planting materials required for landscaping hereinafter specified in locations as shown.

1.2 EQUIPMENT

Maintain all equipment, tools and machinery while on the project in sufficient quantities and capacity for proper execution of the work.

1.3 RELATED WORK

- A. Section 31 20 00, EARTH MOVING, Stripping Topsoil and Stock Piling.
- B. Section 01 45 29, TESTING LABORATORY SERVICES, Topsoil Testing.
- C. Section 31 20 00, EARTH MOVING, Topsoil Materials.
- D. Section 01 57 19, TEMPORARY ENVIRONMENTAL CONTROLS.

1.4 SUBMITTALS

- A. Samples: Submit the following samples for approval before work is started:

Inert Mulch	2.3 kg (5 pounds) of each type to be used.
Organic Mulch	2.3 kg (5 pounds) of each type to be used.
Pre-Emergent Herbicide	2.3 kg (5 pounds) of each type to be used.

- B. Certificates of Conformance or Compliance: Before delivery, notarized certificates attesting that the following materials meet the requirements specified shall be submitted to the Contracting Officer's Technical Representative (COTR) for approval:

1. Plant Materials (Department of Agriculture certification by State Nursery Inspector declaring material to be free from insects and disease).
2. Fertilizers.
3. Lime
4. Peat
5. Seed
6. Sod

- C. Manufacturer's Literature and Data:

1. Erosion control materials

1.5 DELIVERY AND STORAGE

A. Delivery:

1. Notify the COTR of the delivery schedule in advance so the plant material may be inspected upon arrival at the job site. Remove unacceptable plant material from the job site immediately.
2. Protect plants during delivery to prevent damage to root balls or desiccation of leaves. Protect trees during transport by tying in the branches and covering all exposed branches.
3. The use of equipment such as "tree spades" is permitted provided the plant balls are sized in accordance with ANSI Z60.1 and tops are protected from damage.
4. Deliver fertilizer to the site in the original, unopened containers bearing the manufacturer's warranted chemical analysis, name, trade name or trademark, and in conformance to state and federal law. In lieu of containers, fertilizer may be furnished in bulk and a certificate indicating the above information shall accompany each delivery.
5. During delivery: Protect sod, from drying out and seed from contamination.

B. Storage:

1. Sprinkle sod with water and cover with moist burlap, straw or other approved covering, and protect from exposure to wind and direct sunlight. Covering should permit air circulation to alleviate heat development.
2. Keep seed, lime, and fertilizer in dry storage away from contaminants.
3. Store plants not installed on the day of arrival at the site as follows:
 - a. Shade and protect plants from the wind when stored outside.
 - b. Heel in bare root plants.
 - c. Protect plants stored on the project from drying out at all times by covering the balls or roots with moist sawdust, wood chips, shredded bark, peat moss, or other similar mulching material.
 - d. Keep plants, including those in containers, in a moist condition until planted, by watering with fine mist spray.

1.6 PLANTING AND TURF INSTALLATION SEASONS AND CONDITIONS

- A. No work shall be done when the ground is frozen, snow covered, too wet or in an otherwise unsuitable condition for planting. Special conditions may exist that warrants a variance in the specified planting dates or conditions. Submit a written request to the COTR stating the special conditions and proposal variance.

1.7 PLANT AND TURF ESTABLISHMENT PERIOD

- A. The Establishment Period for plants and turf shall begin immediately after installation, with the approval of the COTR, and continue until the date that the Government accepts the project or phase for beneficial use and occupancy. During the Plant and Turf Establishment Period the Contractor shall:
1. Water all plants and turf to maintain an adequate supply of moisture within the root zone. An adequate supply of moisture is the equivalent of 25 mm (1 inch) of absorbed water per week either through natural rainfall or augmented by periodic watering. Apply water at a moderate rate so as not to displace the mulch or flood the plants and turf.
 2. Prune plants and replace mulch as required.
 3. Replace and restore stakes, guy wires, and eroded plant saucers as required.
 4. In plant beds and saucers, remove grass, weeds, and other undesired vegetation, including the root growth, before they reach a height of 75 mm (3 inches).
 5. Spray with approved insecticides and fungicides to control pests and ensure plant survival in a healthy growing condition, as directed by the Resident Engineer.
 6. Provide the following turf establishment:
 - a. Eradicate all weeds. Water, fertilize, overseed, and perform any other operation necessary to promote the growth of grass.
 - b. Replant areas void of turf 0.1 m² (one square foot) and larger in area.
 - c. Mow the new lawn at least three times prior to the final inspection. Begin mowing when grass is 100 mm (4 inches) high. Mow to a 65 mm (2-1/2 inch) height.
 7. Remove plants that die during this period and replace each plant with one of the same size and species.

1.8 PLANT AND TURF WARRANTY

- A. All work shall be in accordance with the terms of the Paragraph, "Warranty" of FAR clause 52.246-21, including the following supplements:
1. A One Year Plant and Turf Warranty will begin on the date that the Government accepts the project or phase for beneficial use and occupancy. The Contractor shall have completed, located, and installed all plants and turf according to the plans and specifications. All plants and turf are expected to be living and in a healthy condition at the time of final inspection.
 2. The Contractor will replace any dead plant material and any areas void of turf immediately. A one year warranty for the plants and turf that was replaced, will begin on the day the work is completed.
 3. Replacement of relocated plants, that the Contractor did not supply, is not required unless they die from improper handling and care during transplanting. Loss through Contractor negligence requires replacement in kind and size.
 4. The Government will reinspect all plants and turf at the end of the One Year Warranty. The Contractor will replace any dead, missing, or defective plant material and turf immediately. The Warranty will end on the date of this inspection provided the Contractor has complied with the work required by this specification. The Contractor shall also comply with the following requirements:
 - a. Replace dead, missing or defective plant material prior to final inspection.
 - b. Mulch and weed plant beds and saucers. Just prior to this inspection, treat these areas to a second application of approved pre-emergent herbicide.
 - c. From plants having been installed for one year, remove stakes, guy wires and any required tree wrappings.
 - d. Complete remedial measures directed by the COTR to ensure plant and turf survival.
 - e. Repair damage caused while making plant or turf replacements.

1.9 APPLICABLE PUBLICATIONS

- A. The publications listed below, form a part of this specification to the extent referenced. The publications are referenced in the text by basic designation only.

- B. American National Standards Institute (ANSI) Publications:
 - ANSI Z60.1-04.....Nursery Stock
 - ANSI Z133.1-06.....Tree Care Operations-Pruning, Trimming,
Repairing, Maintaining, and Removing Trees and
Cutting Brush- Safety Requirements
- C. Hortus Third, A Concise Dictionary of Plants Cultivated in the U.S. and Canada.
- D. American Society for Testing and Materials (ASTM) Publications:
 - C136-06.....Sieve Analysis of Fine and Coarse Aggregates
 - C516-02.....Vermiculite Loose Fill Thermal Insulation
 - C549-06.....Perlite Loose Fill Insulation
 - D977-05.....Emulsified Asphalt (AASHTO M140)
 - D2028-97 (Rev. 2004)....Cutback Asphalt (Rapid-curing Type)
 - D2103-05.....Polyethylene Film and Sheeting
- E. Turfgrass Producers International:
 - Turfgrass Sodding.
- F. U. S. Department of Agriculture Federal Seed Act.
 - 1998.....Rules and Regulations
- G. American Wood Protection Association (AWPA):
 - C2-02.....Lumber, Timbers, Bridge Ties and Mine Ties,
Pressure Treatment

PART 2 - PRODUCTS

2.1 GENERAL

All plant and turf material will conform to the varieties specified or shown in the plant list and be true to botanical name as listed in Hortus Third.

2.2 PLANTS

- A. Plants shall be in accordance with ANSI Z60.1, except as otherwise stated in the specifications or shown on the plans. Where the drawings or specifications are in conflict with ANSI Z60.1, the drawings and specification shall prevail.
- B. Provide well-branched and formed planting stock, sound, vigorous, and free from disease, sunscald, windburn, abrasion, harmful insects or insect eggs with healthy, normal, and unbroken root systems. Provide trees, deciduous and evergreen, that are single trunked with a single leader, unless otherwise indicated, display no weak crotches. Provide symmetrically developed deciduous trees and shrubs of uniform habit of growth, with straight boles or stems and free from objectionable

- disfigurements, and evergreen trees and shrubs with well developed symmetrical tops with typical spread of branches for each particular species or variety. Provide ground cover and vine plants with the number and length of runners for the size specified, and the proper age for the grade of plants specified. Provide vines and ground cover plants well established in removable containers, integral containers, or formed homogeneous soil sections. Plants shall have been grown under climatic conditions similar to those in the locality of the project. Spray all plants budding into leaf or having soft growth with an anti-desiccant at the nursery before digging.
- C. The minimum acceptable sizes of all plants, measured before pruning with branches in normal position, shall conform to the measurements designated. Plants larger in size than specified may be used with the approval of the Resident Engineer, with no change in the contract price. When larger plants are used, increase the ball of earth or spread of roots in accordance with ANSI Z60.1.
 - D. Provide nursery grown plant material conforming to the requirements and recommendations of ANSI Z60.1. Dig and prepare plants for shipment in a manner that will not cause damage to branches, shape, and future development after planting.
 - E. Balled and burlapped (B&B) plant ball sizes and ratios will conform to ANSI Z60.1, consisting of firm, natural balls of soil wrapped firmly with burlap or strong cloth and tied.
 - F. Bare-root (BR) plants shall have the root system substantially intact, but with the earth carefully removed. Cover roots with a thick coating of mud by "puddling" after the plants are dug.
 - G. Container grown plants shall have sufficient root growth to hold the earth intact when removed from containers, but shall not be root bound.
 - H. Make substitutions only when a plant (or its alternates as specified) is not obtainable and the COTR authorizes a change order providing for use of the nearest equivalent obtainable size or variety of plant having the same essential characteristics with an equitable adjustment of the contract price.
 - I. When existing plants are to be relocated, ball sizes shall conform to requirements for collected plants in ANSI Z60.1, and plants shall be dug, handled, and replanted in accordance with applicable sections of these specifications.

2.3 LABELS

Each plant, or group and bundles or containers of the same species, variety, and size of plant, shall be legibly tagged with a durable, waterproof and weather-resistant label indicating the correct plant name and size specified in the plant list. Labels shall be securely attached and not be removed.

2.4 TOPSOIL

- A. Topsoil shall be a well-graded soil of good uniform quality. It shall be a natural, friable soil representative of productive soils in the vicinity. Topsoil shall be free of admixture of subsoil, foreign matter, objects larger than 25 mm (one inch) in any dimension, toxic substances, weeds and any material or substances that may be harmful to plant growth and shall have a pH value of not less than 5.0 nor more than 7.5.
- B. Obtain material from stockpiles established under Section 31 20 00, EARTH MOVING, subparagraph, Stripping Topsoil, that meet the general requirements as stated above. Amend topsoil not meeting the pH range specified by the addition of pH Adjusters.
- C. If sufficient topsoil is not available on the site to meet the depth as specified herein, the Contractor shall furnish additional topsoil. At least 10 days prior to topsoil delivery, notify the COTR of the source(s) from which topsoil is to be furnished. Obtain topsoil from well drained areas. Additional topsoil shall meet the general requirements as stated above and comply with the requirements specified in Section 01 45 29, TESTING LABORATORY SERVICES. Amend topsoil not meeting the pH range specified by the addition of pH adjusters.

2.5 LIME

Lime shall be agricultural limestone containing not less than 90 percent calcium and magnesium carbonates. Lime must be ground to such a fineness that not less than 90% must pass No. 8 mesh and not less than 25% must pass No. 100 mesh. Moisture is not to exceed 10%.

2.6 SOIL CONDITIONERS

- A. Peat shall be a natural product of sphagnum moss peat derived from a fresh-water site conforming to Fed. Spec. Q-P-166, except as otherwise specified.

- B. Organic Matter shall be commercially prepared compost, composted sufficiently to be free of all woody fibers, seeds, and leaf structures, and free of toxic and nonorganic matter.
- C. Fertilizer: Agricultural fertilizer of a formula indicated by the soil test. Fertilizers shall be organic, slow-release compositions whenever applicable

2.7 PLANT FERTILIZER

- A. Provide plant fertilizer that is commercial grade and uniform in composition and conforms to applicable state and federal regulations.
- B. For new plant material, provide packet, table, or pellet forms of slow release fertilizers, bearing the manufacturer's warranted statement of analysis. Slow release fertilizers shall contain a minimum percentage by weight of 10% nitrogen, 6% available phosphoric acid, and 4% potash.

2.10 TURF FERTILIZER

Provide turf fertilizer that is commercial grade, free flowing, uniform in composition, and conforms to applicable state and federal regulations. Granular fertilizer shall bear the manufacturer's warranted statement of analysis. Granular fertilizer shall contain a minimum percentage by weight of 10% nitrogen, 20% available phosphoric acid, and 10% potash. Liquid starter fertilizer for use in the hydro seed slurry will be commercial type with 50 percent of the nitrogen in slow release form.

2.11 MULCH

- A. Mulch shall be free from deleterious materials and shall be stored as to prevent inclusion of foreign material.
- B. Organic mulch materials shall be shredded hardwood.
 - 1. Straw for lawn seed bed mulch shall be stalks from oats, wheat, rye, barley, or rice that are free from noxious weeds, mold or other objectionable material. Straw shall be in an air-dry condition and suitable for placing with blower equipment.
 - 2. Wood cellulose fiber for use with hydraulic application of grass seed and fertilizer shall consist of specially prepared wood cellulose fiber, processed to contain no growth or germination-inhibiting factors, and dyed an appropriate color to facilitate visual metering of the application of materials. On an air-dry weight basis, the wood cellulose fiber shall contain a maximum of 12 percent moisture, plus or minus three percent at the

time of manufacture. The pH range shall be from 3.5 to 5.0. The wood cellulose fiber shall be manufactured so that:

- a. After addition and agitation in slurry tanks with fertilizers, grass seeds, water, and other approved additives, the fibers in the material will become uniformly suspended to form a homogeneous slurry.
- b. When hydraulically sprayed on the ground, the material will form a blotter like cover impregnated uniformly with grass seed.
- c. The cover will allow the absorption of moisture and allow rainfall or applied water to percolate to the underlaying soil.

2.12 ASPHALT ADHESIVE

Asphalt adhesive for application with straw mulch shall be liquid asphalt conforming to ASTM D2028, designation RC-70, or emulsified asphalt conforming to ASTM D977, Grade RS-1.

2.13 TREE WRAP

- A. Tree wrap shall be secured to the trunk using bio-degradable tape suitable for nursery use and which is expected to degrade in sunlight in less than two years after installation

2.14 STAKES AND GUYING WIRES

- A. Provide stakes for tree support of rough sawn wood, free from knots, rot, cross grain, or other defects that would impair the strength. Stakes shall be a minimum of 50 mm by 50 mm (2 inches by 2 inches), or 65 mm (2-1/2 inches) in diameter, by 2400 mm (8 feet) long and pointed at one end//Galvanized steel pipe 32 mm (1 1/4 in.) x 3000 mm (10') with cap, primed with 2 coats flat black exterior enamel.
- B. Guying wire shall be 2.7 mm (12 gage) annealed galvanized steel.
- C. Hose chafing guards shall be new or used 2-ply reinforced rubber or plastic hose of all the same color on the project.

2.15 WATER

Water shall not contain elements toxic to plant life.

2.16 SEED

Seed shall be state-certified seed of the latest season's crop and shall be delivered in original sealed packages bearing the producer's warranted analysis for percentages of mixtures, purity, germination, weed seed content, and inert material. Seed shall be labeled in conformance with U. S. Department of Agriculture rules and regulations under the Federal Seed Act and applicable state seed laws. Seed that

has become wet, moldy, or otherwise damaged will not be acceptable. Onsite seed mixing shall be done only in the presence of the Resident Engineer. Seed mixtures shall be proportioned by weight as follows:

NAME OF GRASS	
<u>(Botanical and Common)</u>	<u>Percent by Weight</u>
Kentucky Bluegrass (Poapratense)	70%
Tall Fescue (Festuca Hybrids)	20%
Rye (Secale cereale)	10%
<hr/>	
<u>Percent Germination</u>	<u>Maximum Percent Weed Seed</u>
<hr/>	0.5%
<hr/>	<hr/>
<hr/>	<hr/>
<hr/>	<hr/>

PART 3 - EXECUTION

3.1 LAYOUT

Stake plant material locations and bed outlines on project site for approval by the COTR before any plant pits or beds are dug. The COTR may approve adjustments to plant material locations to meet field conditions.

3.2 EXCAVATION FOR PLANTING

- A. Prior to excavating for plant pits and bed, verify the location of any underground utilities. Damage to utility lines will be repaired at the Contractor's expense. Where lawns have been established prior to planting operation, cover the surrounding turf before excavations are made in a manner that will protect turf areas. Barricade existing trees, shrubbery, and beds that are to be preserved in a manner that will effectively protect them during the project construction.
- B. Remove rocks and other underground obstructions to a depth necessary to permit proper planting according to plans and specifications. Where underground utilities, construction, or solid rock ledges are encountered, the COTR may select other locations for plant material.
- C. Dig plant pits by any approved method so that they have vertical sides and flat bottoms. When pits are dug with an auger and the sides of the pits become glazed, scarify the glazed surface. Size the plant pits as

shown, otherwise, the minimum allowable dimensions of plant pits shall be regardless of width, 150 mm (6 inches) deeper for shrubs and 225 mm (9 inches) deeper for trees than the depth of ball or root spread; for ball or root spread up to 600 mm (2 feet), pit diameters shall be twice the ball or root spread; for ball or root spread from 600 to 1200 mm (2 to 4 feet), pit diameters shall be 600 mm (2 feet) greater; for ball or root spread over 1200 mm (4 feet), pit diameters shall be 1-1/2 times the ball or root spread.

- D. Where ground cover and planting beds occur in existing turf areas, remove turf to a depth that will ensure the removal of the entire root system, with additional bed preparation as specified in the next paragraph.
- E. In areas of new grading where existing soil is being replaced for the construction of new ground cover and plant beds, remove 100 mm (4 inches) of existing soil and replace with topsoil. Plant beds shall be brought to a smooth and even surface conforming to established grades. Till 50 mm (2 inches) of peat into the topsoil as specified.
- F. Using topsoil, form earth saucers or water basins for watering around plants. Basins to be 2 inches high for shrubs and 4 inches high for trees.
- G. Treat plant saucers, shrub, and ground cover bed areas, prior to mulching, with an approved pre-emergent herbicide. Plant ground cover in areas to receive erosion control material through the material after material is in place.

3.3 SETTING PLANTS

- A. Handle balled and burlapped and container-grown plants only by the ball or container. Remove container-grown plants in such a way to prevent damage to plants or root system. Set plants plumb and hold in position until sufficient soil has been firmly placed around the roots or ball. Set plants so that the root crown is 1 inch higher than the surrounding grade. Plant ground cover plants after the mulch is in place. Avoid contaminating the mulch with the planting soil. Add slow release packet, tablet or pellet fertilizer as each plant is installed as per manufacturer's recommendation for method of installation and quantity.
- B. Backfill balled and burlapped and container-grown plants with planting soil mixture as specified to approximately half the depth of the ball and then tamp and water. For balled and burlapped plants, carefully remove excess burlap and tying materials and fold back. Where plastic

wrap or treated burlap is used in lieu of burlap, completely remove these materials before backfilling. Tamp and water remainder of backfill Planting Soil Mixture; then form earth saucers or water basins around isolated plants with topsoil.

- C. Plant bare-root stock arranging the roots in a natural position. Remove damaged roots with a clean cut. Carefully work Planting Soil Mixture in among the roots. Tamp and water the remainder of Planting Soil Mixture; then form earth saucers or water basins around isolated plants with topsoil.

3.4 TRUNK WRAPPING

Wrap the trunks of deciduous trees immediately after planting. Wrap the trunks of deciduous trees, 40 mm (1-1/2 inches) or greater in caliber with the specified material beginning at the base and extending to the first branches. Remove wrapping after one year. When using Crinkled Paper Wrap, securely tie wrapping at the top and bottom and at 450 mm (18 inch) maximum intervals with twine.

3.5 STAKING AND GUYING

- A. Stake and guy plants as shown on the drawings and as specified.
- B. Drive stakes vertically into the ground to a depth of 800 to 900 mm (2-1/2 to 3 feet) in such a manner as not to injure the ball or roots, unless otherwise shown on the drawings.
- C. Place deadmen not less than 450 mm (18 inches) below the surface of the ground, unless otherwise shown on the drawings.
- D. Install iron anchors according to manufacturer's recommendations.
- E. Remove stakes and guy wires after one year.

3.6 MULCHING PLANTS

- A. Mulch within 48 hours after planting and applying a pre-emergent herbicide. Do not mulch in ground cover areas that shall have organic material placed before planting.
- B. Placing Inert Material: Place Landscape fabric with edges lapped 150 mm to 300 mm (6 inches to 12 inches) to receive inert mulch material. Punch a grid of 6 mm (1/4 inch) holes for drainage in the landscape fabric 300 mm (one foot) on centers over the entire area. Spread inert mulch to a uniform thickness over the membrane as shown.
- C. Placing Organic Material: Spread mulch to a uniform minimum thickness of 50 mm (2 inches).
- D. Keep mulch out of the crowns of shrubs and off buildings, sidewalks, light standards, and other structures.

3.7 PRUNING

- A. Prune new plant material in the following manner: Remove dead, broken and crossing branches. Prune deciduous trees and shrubs to reduce total amount of anticipated foliage by 1/4 to 1/3 while retaining typical growth habit of individual plants with as much height and spread as is practicable. Make cuts with sharp instruments as close as possible to the branch collar. Do not make flush cuts. Do not make "Headback" cuts at right angles to line of growth. Do not pole trees or remove the leader. Remove trimmings from the site. Paint cuts 13 mm (1/2 inch) in diameter and larger with the specified tree wound dressing.

3.8 FERTILIZATION OF EXISTING TREES

Apply fertilizer to existing trees shown on the drawings at the rate of 36 g/mm (2 pounds per inch) caliper. Apply in 300 mm to 450 mm (12 inch to 18 inch) deep holes 40 to 50 mm (1-1/2 to 2 inches) in diameter, made by an earth auger, distributed evenly at not more than 600 mm (2 feet) on center throughout the outer half of the branch spread zone of each tree. Fertilize to within 100 mm (4 inches) of the surrounding grade. Use topsoil to bring the surface up to the surrounding grade. When using fertilizer in packet, tablet, or wedge form, apply in accordance with manufacturer's recommendations.

3.9 TILLAGE FOR TURF AREAS

Thoroughly till the soil to a depth of at least 100 mm (4 inches) by scarifying, disking, harrowing, or other approved methods. This is particularly important in areas where heavy equipment has been used, and especially under wet soil conditions. Remove all debris and stones larger than 25 mm (one inch) remaining on the surface after tillage in preparation for finish grading. To minimize erosion, do not till areas of 3:1 slope ratio or greater. Scarify these areas to a 50 mm (one inch) depth and remove debris and stones.

3.10 FINISH GRADING

After tilling the soil for bonding of topsoil with the subsoil, spread the topsoil evenly to a minimum depth of 4 inches. Incorporate topsoil at least 50 to 75 mm (2 to 3 inches) into the subsoil to avoid soil layering. Do not spread topsoil when frozen or excessively wet or dry. Correct irregularities in finished surfaces to eliminate depressions. Protect finished topsoil areas from damage by vehicular or pedestrian traffic. Complete lawn work only after areas are brought to finished grade.

3.11 APPLICATION OF FERTILIZER AND LIME FOR TURF AREAS

- A. Apply turf fertilizer at the rate of 1000 pounds per acre. In addition, adjust soil acidity and add soil conditioners as required herein for suitable topsoil under PART 2, Paragraph, TOPSOIL.
- B. Spread lime at the rate of 2 tons per acre.
- C. Incorporate fertilizers and lime into the soil to a depth of at least 100 mm (4 inches) as part of the finish grading operation. Immediately restore the soil to an even condition before any turf work.

3.12 MECHANICAL SEEDING

- A. Broadcast seed by approved sowing equipment at the rate of 670 pounds per acre. Sow one half of the seed in one direction, and the remainder sown at right angles to the first sowing. Cover seed to an average depth of 6 mm (1/4 inch) by means of spike-tooth harrow, cultipacker, or other approved device.
- B. Immediately after seeding, firm up the entire area with a roller not exceeding 225 kg/m (150 pounds per foot) of roller width. Where seeding is performed with a cultipacker-type seeder or where seed is applied in combination with hydro-mulching, no rolling is required.
- C. Immediately after preparing the seeded area, evenly spread an organic mulch of straw by hand or by approved mechanical blowers at the rate of 0.5 kg/m² (2 tons per acre). Application shall allow some sunlight to penetrate and air to circulate but also reduce soil and seed erosion and conserve soil moisture. Anchor mulch by either a mulch tiller, asphalt emulsion, twine, or netting. When asphalt emulsion is used, apply either simultaneously or in a separate application. Take precautionary measures to prevent asphalt materials from marking or defacing structures, pavements, utilities, or plantings.

3.13 WATERING

Apply water to the turf areas immediately following installation at a rate sufficient to ensure thorough wetting of the soil to a depth of at least 100 mm (4 inches). Supervise watering operation to prevent run-off. Supply all pumps, hoses, pipelines, and sprinkling equipment. Repair all areas damaged by water operations.

3.14 PROTECTION OF TURF AREAS

Immediately after installation of the turf areas, protect against traffic or other use by erecting barricades, as required, and placing approved signs at appropriate intervals until final acceptance.

3.15 EROSION CONTROL MATERIAL

- A. Install and maintain erosion control material meeting the requirements of this specification on the designated areas as shown and specified. Prepare, fertilize and vegetate the area(s) to be covered, as specified, before the erosion material is placed. Immediately following the planting operations, lay the material evenly and smoothly and in contact with the soil throughout. Omit the straw mulch from all seeded areas receiving the erosion control material.

3.16 RESTORATION AND CLEAN-UP

Where existing or new turf areas have been damaged or scarred during planting and construction operations, restore disturbed area to their original condition. Keep at least one paved pedestrian access route and one paved vehicular access route to each building clean at all times. In areas where planting and turf work have been completed, clear the area of all debris, spoil piles, and containers. Clear all other paved areas when work in adjacent areas is completed. Remove all debris, rubbish and excess material from the station.

3.17 ENVIRONMENTAL PROTECTION

All work and Contractor operations shall comply with the requirements of Section 01 57 19, TEMPORARY ENVIRONMENTAL CONTROLS.

- - - E N D - - -

**SECTION 33 10 00
WATER UTILITIES**

PART 1 - GENERAL

1.1 DESCRIPTION:

Underground water distribution system complete, ready for operation, including all appurtenant structures, and connections to both new building service lines and to existing water supply.

1.2 RELATED WORK:

- A. Maintenance of Existing Utilities: Section 01 00 00, GENERAL REQUIREMENTS.
- B. Excavation, trench widths, pipe bedding, backfill, shoring, sheeting, bracing: Section 31 20 00, EARTH MOVING.
- C. Concrete: Section 03 30 00, CAST-IN-PLACE CONCRETE.
- D. Protection of materials and equipment: Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.
- E. Fire protection system connection and supervisory switch for post indicator valve: Section 21 12 00, FIRE-SUPPRESSION STANDPIPES.
- F. Fire protection system connection, Section 21 10 00, WATER-BASED FIRE-SUPPRESSION SYSTEMS.

1.3 DEFINITIONS:

- A. Water Distribution: Pipelines and appurtenances which are part of the distribution system. The distribution system comprises the network of piping located throughout building areas and other areas of water use, including hydrants, valves, and other appurtenances used to supply water for domestic and fire-fighting/fire protection purposes.
- B. Water Service Line: Pipe line connecting building piping to water distribution lines.

1.4 QUALITY ASSURANCE:

- A. Products Criteria:
 - 1. Multiple Units: When two or more units of the same type or class of materials or equipment are required, these units shall be product of one manufacturer.
 - 2. Nameplate: Nameplate bearing manufacturer's name or identifiable trademark securely affixed in a conspicuous place on equipment or name or trademark cast integrally with equipment, stamped, or otherwise permanently marked on each item of equipment.

- B. Comply with the rules and regulations of the Public Utility having jurisdiction over the connection to Public Water lines and the extension, and/or modifications to Public Utility systems.
- C. Comply with all rules and regulations of Federal, State, and Local authorities having jurisdiction over the design, construction, and operation of potable water systems.
- D. All material surfaces in contact with potable water shall comply with NSF 61.

1.5 SUBMITTALS:

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturers' Literature and Data (Submit all items as one package):
(Ductile Iron Pipe and Polyvinyl Chloride (PVC) shall be in accordance with AWWA C600 and C605 respectively; and shall be provided to Resident Engineer for approval.)
 - 1. Piping.
 - 2. Gaskets.
 - 3. Valves.
 - 4. Fire hydrants.
 - 5. Post indicator.
 - 6. Valve boxes.
 - 7. Corporation and curb stops.
 - 8. Joint restraint.
 - 9. Disinfection products.
- C. Testing Certifications:
 - 1. Certification of Backflow Devices.
 - 2. Hydrostatic Testing.
 - 3. Certification of Disinfection, including free chlorine residuals, and bacteriological examinations.

1.6 APPLICABLE PUBLICATIONS:

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American National Standards Institute (ANSI/ASME):
 - B16.1-98.....Cast Iron Pipe Flanges and Flanged Fittings
 - B16.18.....Cast Bronze Solder Joint Pressure Fittings
 - B16.26-88.....Cast Copper Alloy Fittings for Flared Copper
Tubes

- B40.100-98.....Pressure Gauges and Gauge Attachments
- C. American Society for Testing and Materials (ASTM):
- A123-97.....Zinc (Hot-Dip Galvanized) Coatings on Iron and
Steel Products
- A148M-03.....Standard Specifications for Steel Castings
- A242-00.....Standard Specifications for High Strength Low
Alloy Structural Steel AASHTO No. M161
- A307-02.....Standard Specifications for Carbon Steel Bolts
and Studs, 60,000 psi Tensile Strength
- A536-04.....Standard Specifications for Ductile Iron
Castings
- B88-02.....Seamless Copper Water Tube
- B828.....Standard Practice: Soldering and Brazing Copper
Tube and fittings
- D1784-03.....Standard Specifications for Rigid PVC Compounds
and CPVC Compounds
- D1869-00.....Standard Specifications for Rubber Rings for
Asbestos Cement Pipe
- D2467-02.....Standard Specifications for Poly (Vinyl
Chloride) (PVC) Plastic Pipe Fittings, Schedule
80
- D3139-98.....Joints for Plastic Pressure Pipes Using
Flexible Elastomeric Seals
- F477-02e1.....Elastomeric Seals (Gaskets) for Joining Plastic
Pipe
- C32-04.....Standard Specifications for Sewer Manhole Brick
- D. American Water Works Association (AWWA):
- B300-04.....Hypochlorites
- B301-04.....Liquid Chlorine
- C104-04.....Cement Mortar Lining for Ductile Iron Pipe and
Fittings for Water
- C105-99.....Polyethylene Encasement for Gray and Ductile
C.I. Piping for Water and Other Liquids
- C110-03.....Ductile-Iron and Gray-Iron Fittings, 80 mm (3
Inches) Through 1200 mm (48 Inches) for Water
and Other Liquids
- C111-01.....Rubber-Gasket Joints for Ductile-Iron and
Gray-Iron Pressure Pipe and Fittings

- C115-99.....Flanged Ductile-Iron and Gray-Iron Pipe with
Threaded Flanges
- C150-02.....American National Standard for Thickness Design
of Ductile Iron Pipe
- C151-96.....Ductile-Iron Pipe, Centrifugally Cast in Metal
Molds or Sand-Lined Molds, for Water or Other
Liquids
- C153-00.....Ductile-Iron Compact Fittings, 80 mm (3 inches)
Through 300 mm (12 Inches) for Water and Other
Liquids
- C500-02.....Gate Valves for Water and Sewerage Systems
- C503-97.....Wet-Barrel Fire Hydrants
- C509-01.....Resilient Seated Gate Valve for Water and
Sewage System
- C510-97.....Double Check Valve Back-Flow Prevention
Assembly
- C511-97.....Reduced Pressure Principle Back-Flow Prevention
Assembly
- C550-01.....Protective Epoxy Interior Coatings for Valves
and Hydrants
- C600-01.....Installation for Ductile-Iron Water Mains and
Their Appurtenances
- C605-94.....Underground Installation of Polyvinyl Chloride
(PVC) Pressure Pipe and Fittings for Water
- C651-92.....Disinfecting Water Mains
- C800-01.....Underground Service Line Valves and Fittings
- C900-97.....Polyvinyl Chloride (PVC) Pressure Pipe, 4
Inches Thru 12 Inches, for Water
- E. National Fire Protection Association (NFPA):
- 24-95.....Installation of Private Fire Service Mains and
Their Appurtenances
- 291-01.....Fire Flow Testing and Marking of Hydrants
- 1141-98.....Fire Protection in Planned Building Groups
- F. NSF International:
- 14-03.....Plastics Piping Components and Related
Materials
- 61-02.....Drinking Water System Components-Health Effects
(Sections 1-9)

G. Foundation for Cross-Connection Control and Hydraulic Research-2005

H. Copper Development Association's Copper Tube Handbook-2005

PART 2 - PRODUCTS

2.1 DUCTILE IRON PIPE AND FITTINGS:

A. Ductile iron pipe, direct buried:

1. Provide ductile iron pipe conforming to the requirements of AWWA C151, Pressure Class 350 for Pipe 100 mm through 300 mm (4 inches through 12 inches) in diameter, with standard thickness cement mortar lining interior, and interior asphaltic seal coat and exterior asphaltic coating, in accordance with AWWA and ANSI Standards.
2. Below Grade: Supply pipe in lengths not in excess of a nominal 6 m (20 feet) with rubber ring type push-on joints, mechanical joint or approved restrained joint. Provide flange joint pipe where shown on the drawings. Provide mechanical and restrained joint pipe with sufficient quantities of accessories as required for each joint.

B. Ductile Iron Pipe Above Grade or in Below Ground Concrete Pits:

1. Flanged ductile iron pipe, AWWA C115, with factory applied screwed long hub flanges except as otherwise specified hereinafter. Face and drill flanges after being screwed on the pipe, with flanges true to 90 degrees with the pipe axis and flush with end of pipe, ANSI B16.1, 850 kPa (125 psi) or 1725 kPa (250 psi) standard, for the purpose intended.
2. Wall Sleeve Castings: Size and types shown on the drawings and be hot dipped galvanized. Seal strips, where required shall be Link Seal as manufactured by Thunderline Corp., Wayne, Michigan or equal.
3. Pipe Thickness Class: Minimum of Class 53 as defined in AWWA C150 for all sizes of flanged pipe.
4. Rubber Ring Gaskets: Full face type, AWWA C111, 2 mm (1/16 inch) rubber ring gaskets and of approved composition suitable for the required service.
5. Pipe and fittings exposed to view in the finished work are to be painted in accordance with Section 09 91 00, PAINTING. Pipe shall not receive the standard tar or asphalt coat on the outside surfaces but shall be shop primed on the outside with one coat of Kop-Coat No. 621 Rust Inhibitive Primer or equal. Paint color shall match the wall color.

- 6. Bolts and Nuts on Flanged Fittings: Grade B, ASTM A307. Low alloy, high strength steel in accordance with AWWA C111. Assemble stainless steel bolts and nuts using anti-seize compound to prevent galling.
- C. All Pipe Fittings: Ductile iron with a minimum pressure rating of 2400 kPa (350 psi). Fittings shall meet the requirements of ANSI and AWWA specifications as applicable. Rubber gasket joints shall conform to AWWA C111 for mechanical and push-on type joints. Ball joints shall conform to AWWA C151 with a separately cast ductile iron bell conforming to ASTM A148. Flanged fittings shall conform to AWWA C115 and be furnished flat faced and drilled to 850 kPa (125 psi) or 1725 kPa (250 psi) template in accordance with ANSI B16.1 with full faced gaskets.
- D. Provide cement mortar lining and bituminous seal coat on the inside of the pipe and fittings in accordance with AWWA C104. Provide standard asphaltic coating on the exterior.
- E. Provide a factory hydrostatic test of not less than 3.5 MPa (500 psi) for all pipe in accordance with AWWA C151.
- F. Provide non-detectable adhesive backed identification tape on top and sides of all buried ductile iron pipe, extended from joint to joint along the length of the pipe and have black lettering identifying the pipe service at no more than 300 mm (12 inch) intervals. According to service, the tape background color shall be blue for potable water.

2.2 POLYVINYL CHLORIDE PIPE AND FITTINGS:

- A. Class-Rated Polyvinyl Chloride (PVC) Pipe:
 - 1. PVC pipe and accessories 100 mm to 356 mm (4 inches-14 inches) in diameter, AWWA C900 "Polyvinyl Chloride (PVC) Pressure Pipe", Class 200, DR 14, cast iron outside diameters, unless otherwise shown or specified.
- B. Joints:
 - 1. Pipe 75 mm (3 inches) and Greater in Diameter: Push-on type with factory installed solid cross section elastomeric ring meeting the requirements of ASTM F-477.
 - 2. Pipe Less Than 75 mm (3 inches) in Diameter: Threaded (ASTM D-2464) or solvent welded (ASTM 2467). Use Teflon tape or liquid Teflon thread lubricant approved for use on plastic on all threaded joints.
- C. Fittings:

1. Class-Rated Pipe 75 mm (3 inches) in Diameter and Greater: Ductile iron with mechanical joints conforming to the requirements of AWWA C153.

2.3 COPPER PIPE AND TUBING:

Copper Piping: ASTM B88, Type K, or Type L with flared fittings in accordance with AWWA C800, with sweat cast brass fittings per ANSI B16.18. Use brazing alloy, AWS A5.8, Classification BCuP.

2.4 VALVES:

A. Asbestos packing is not allowed.

B. Gate:

1. 75 mm (3 inches) and Larger: Resilient seated, ductile iron body, bronze mounted, inclined seats, non-rising stem type turning counter-clockwise to open, 1375 kPa (200 pound) WOG. AWWA C509. The resilient seat shall be fastened to the gate with stainless steel fasteners or vulcanizing methods. The interior and exterior shall be coated with thermo-setting or fusion epoxy coating in accordance with AWWA C550.

2. Operator:

- a. Underground: Except for use with post indicators, furnish valves with 50 mm (2 inch) nut for socket wrench operation. Post indicator shall comply with the requirements of NFPA 24 and shall be fully compatible with the valve provided.

b. Above Ground and in Pits: Hand wheels.

3. Joints: Ends of valves shall accommodate, or be adapted to, pipe installed.

2.5 VALVE BOX:

Cast iron extension box with screw or slide-type adjustment and flared base. Minimum thickness of metal shall be 5 mm (3/16 inch). Box shall be adapted, without full extension, to depth of cover required over pipe at valve location. Cast the word "WATER" in cover. Provide 2 "T" handle socket wrenches of 16 mm (5/8 inch) round stock long enough to extend 600 mm (2 feet) above top of deepest valve box.

2.6 POST INDICATOR VALVE:

- A. Valve: Valve shall conform to the specifications listed in Section 2.4 for gate valves. The Post Indicator shall conform to NFPA 24, and shall be fully compatible with the valve and all the supervisory switches. Valve shall be UL listed and FM approved, and shall be furnished with a valve tamper switch suitable for connection to an electrically

supervised valve module connected to the Fire Alarm System. Valves shall be supervised as indicated. Valve module and electrical connections shall be supplied and made by the Contractor.

2.7 FIRE HYDRANTS:

- A. Size of main valve opening of each hydrant shall be 125 mm (5 inches), minimum. Hose thread, size of fire apparatus connection, and shape, size and direction of rotation of operating head of hydrant shall be identical with present local fire department and/or water department standards.
- B. Hydrant shall be type AWWA C502, heavy construction, of proper length to connect pipe without extra fittings, and shall be the traffic type with safety flange on barrel and safety couplings on the valve stem with the following features:
 - 1. Interior removable without digging up hydrant; can be packed under pressure; 150 mm (6 inch) bell connection; one steamer nozzle and two hose nozzles with nozzle caps securely chained to barrel; suitable drainage device; single rubber or leather-faced valve in base; nozzles, stuffing boxes, wedge nuts, seat rings, clamp plates, etc. Threaded joints or spindles shall be bronze. Upper and lower barrels shall be of equal diameters. Upper barrel shall be of sufficient length to permit setting hydrant with barrel flange not more than 50 mm (2 inches) above finished grade. All fire hydrants shall have 150 mm (6 inch) bottom connection.
 - 2. Provide fire hydrants with a finish paint identical to the existing fire hydrants.
- C. Provide 2 wrenches with handles not less than 350 mm (14 inches) long.

2.8 PIPE SLEEVES:

Ductile iron or zinc coated steel.

2.9 BACKFLOW PREVENTER:

- A. Potable Water and Irrigation Water Service: Reduced Pressure Principle Type AWWA C511, except pressure drop at rated flow shall not exceed 100 kPa (15 psi). Gate valves installed on the assembly shall be resilient seated valve conforming to AWWA C509.
- B. Fire Service: Double detector check valve. AWWA C510 and NFPA 14.
- C. In cold climate areas, backflow assemblies and devices shall be protected from freezing by a method acceptable to local jurisdiction.

- D. Backflow preventers shall be approved by the Foundation for Cross-Connection Control and Hydraulic Research per current edition of the Manual of Cross-Connection Control.
- E. Backflow preventer shall not be located in any area containing fumes that are toxic, poisonous or corrosive.
- F. Direct connections between potable water piping and sewer connected wastes shall not exist under any condition with or without backflow protection.
- G. Backflow preventer shall be accessed and have clearance for the required testing, maintenance and repair. Access and clearance shall require a minimum of one (1) foot (305 mm) between the lowest portion of the assembly and grade, floor or platform. Installations elevated more than five (5) feet (1524 mm) above the floor or grade shall be provided with a permanent platform capable of supporting a tester or maintenance person.

2.10 POTABLE WATER:

Water used for filling, flushing, and disinfection of water mains and appurtenances shall conform to Safe Drinking Water Act.

2.11 DISINFECTION CHLORINE:

- A. Liquid chlorine shall conform to AWWA B301 and AWWA C651.
- B. Sodium hypochlorite shall conform to AWWA B300 with 5 percent to 15 percent available chlorine.
- C. Calcium hypochlorite shall conform to AWWA B300 supplied in granular form or 5.g tablets, and shall contain 65 percent chlorine by weight.

2.12 WARNING TAPE

Standard, 4-Mil polyethylene 76 mm (3 inch) wide tape, detectable type, blue with black letters, and imprinted with "CAUTION BURIED WATER LINE BELOW".

PART 3 - EXECUTION**3.1 BUILDING SERVICE LINES:**

Install water service lines to point of connection within approximately 1500 mm (5 feet) outside of buildings to which such service is to be connected and make connections thereto. If building services have not been installed provide temporary caps.

3.2 REGRADING:

Raise or lower existing valve and curb stop boxes and fire hydrants to finish grade in areas being graded.

3.3 PIPE LAYING, GENERAL:

- A. Care shall be taken in loading, transporting, and unloading to prevent injury to the pipe or coatings. Pipe or fittings shall not be dropped. All pipe or fittings shall be examined before laying, and no piece shall be installed which is found to be defective. Any damage to the pipe coatings shall be repaired as directed by the Contracting Officer's Technical Representative (COTR).
- B. All pipe and fittings shall be subjected to a careful inspection just prior to being laid or installed. If any defective piping is discovered after it has been laid, it shall be removed and replaced with a sound pipe in a satisfactory manner at no additional expense to the Government. All pipe and fittings shall be thoroughly cleaned before laying, shall be kept clean until they are used in the work, and when installed or laid, shall conform to the lines and grades required.
- C. All buried piping shall be installed to the lines and grades as shown on the drawings. All underground piping shall slope uniformly between joints where elevations are shown.
- D. Contractor shall exercise extreme care when installing piping to shore up and protect from damage all existing underground water line and power lines, and all existing structures.
- E. Do not lay pipe on unstable material, in wet trench, or when trench or weather conditions are unsuitable.
- F. Do not lay pipe in same trench with other pipes or utilities unless shown otherwise on drawings.
- G. Hold pipe securely in place while joint is being made.
- H. Do not walk on pipes in trenches until covered by layers of earth well tamped in place to a depth of 300 mm (12 inches) over pipe.

- I. Full length of each section of pipe shall rest solidly upon pipe bed with recesses excavated to accommodate bells or joints. Do not lay pipes on wood blocking.
- J. Tees, plugs, caps, bends and hydrants on pipe installed underground shall be anchored. See section 3.7 "PIPE SUPPORTS".
- K. Close pipe openings with caps or plugs during installation. Tightly cover and protect equipment against dirt, water and chemical, or mechanical injury. At completion of all work, thoroughly clean exposed materials and equipment.
- L. Good alignment shall be preserved in laying. The deflection at joints shall not exceed that recommended by the manufacturer.
- M. Warning tape shall be continuously placed 300 mm (12 inches) above buried water pipes.

3.4 DUCTILE IRON PIPE:

- A. Installing Pipe: Lay pipe in accordance with AWWA C600 with polyethylene encasement if required in accordance with AWWA C105. Provide a firm even bearing throughout the length of the pipe by tamping selected material at the sides of the pipe up to the spring line.
- B. All pipe shall be sound and clean before laying. When laying is not in progress, the open ends of the pipe shall be closed by watertight plug or other approved means.
- C. When cutting pipe is required, the cutting shall be done by machine, leaving a smooth cut at right angles to the axis of the pipe. Bevel cut ends of pipe to be used with push-on bell to conform to the manufactured spigot end. Cement lining shall be undamaged.
- D. Jointing Ductile-Iron Pipe:
 - 1. Push-on joints shall be made in strict accordance with the manufacturer's instruction. Pipe shall be laid with bell ends looking ahead. A rubber gasket shall be inserted in the groove of the bell end of the pipe, and the joint surfaces cleaned and lubricated. The plain end of the pipe is to be aligned with the bell of the pipe to which it is joined, and pushed home with approved means.
 - 2. Mechanical Joints at Valves, Fittings: Install in strict accordance with AWWA C111. To assemble the joints in the field, thoroughly clean the joint surfaces and rubber gaskets with soapy water before

tightening the bolts. Bolts shall be tightened to the specified torque.

3. Ball Joints: Install in strict accordance with the manufacturer's instructions. Where ball joint assemblies occur at the face of structures, the socket end shall be at the structure and ball end assembled to the socket.
4. Flanged joints shall be in accordance with AWWA C115. Flanged joints shall be fitted so that the contact faces bear uniformly on the gasket and then are made up with relatively uniform bolt stress.

3.5 PVC PIPE:

- A. PVC piping shall be installed in strict accordance with the manufacturer's instructions and AWWA 605. Place selected material and thoroughly compacted to one foot above the top of the pipe and thereafter back filled as specified in Section 31 20 00, EARTH MOVING.
- B. Copper Tracer Wire: Copper tracer wire consisting of No. 14 AWG solid, single conductor, insulated copper wire shall be installed in the trench with all piping to permit location of the pipe with electronic detectors. The wire shall not be spiraled around the pipe nor taped to the pipe. Wire connections are to be made by stripping the insulation from the wire and soldering with rosin core solder. Solder joints shall be wrapped with rubber tape and electrical tape. At least every 300 m (1000 feet), provide a 2.3 kg (5 pound) magnesium anode attached to the main tracer wire by solder. The solder joint shall be wrapped with rubber tape and with electrical tape. An anode shall be attached at the end of each line.
- C. Magnetic markers may be used in lieu of copper tracer wire to aid in future pipe locating. Generally, install markers on 6 m (20 foot) centers. If pipe is in a congested piping area, install on 3 m (10 foot) centers. Prepare as-built drawing indicating exact location of magnetic markers.

3.6 COPPER PIPE:

Copper piping shall be installed in accordance with the Copper Development Association's Copper Tube Handbook and manufacturer's recommendations. Copper piping shall be bedded in 150 mm (6 inches) of sand and then back filled as specified in Section 31 20 00, EARTH MOVING.

3.7 PIPE SUPPORTS:

- A. Supports:

1. All piping shall be properly and adequately supported. Hangers, supports, base elbows and tees, and concrete piers and pads shall be provided as indicated on the drawings. If the method of support is not indicated on the drawings, exposed piping shall be supported by hangers wherever the structure is suitable and adequate to carry the superimposed load. Supports shall be placed approximately 2.4 m (8 feet) on centers and at each fitting.
2. Hangers shall be heavy malleable iron of the adjustable swivel type, split ring type, or the adjustable-swivel, pipe-roll type for horizontal piping and adjustable, wrought iron, clamp type for vertical piping. Flat steel strap or chain hangers are not acceptable unless indicated on the drawings.
3. Hangers shall be attached to the structure, where possible, by beam clamps and approved concrete inserts set in the forms before concrete is poured. Where this method is impractical, anchor bolts with expanding lead shields, rawl drives, or malleable iron expansion shields will be permitted.
4. Where hangers cannot be used, the Contractor shall provide pipe saddle supports with pipe column and floor flange.

3.8 RESTRAINED JOINTS:

- A. Sections of piping requiring restrained joints shall be constructed using pipe and fittings with restrained "locked-type" joints and the joints shall be capable of holding against withdrawal for line pressures 50 percent above the normal working pressure but not less than 1375 kPa (200 psi). The pipe and fittings shall be restrained push-on joints or restrained mechanical joints.
- B. The minimum number of restrained joints required for resisting force at fittings and changes in direction of pipe shall be determined from the length of retained pipe on each side of fittings and changes in direction necessary to develop adequate resisting friction with the soil. Restrained pipe length shall be as shown on the drawings.
- C. Restrained joint assemblies with ductile iron mechanical joint pipe shall be "Flex-Ring", "Lok-Ring", or mechanical joint coupled as manufactured by American Cast Iron Pipe Company, "Mega-Lug" or approved equal.
- D. Ductile iron pipe bell and spigot joints shall be restrained with EBBA Iron Sales, Inc. Series 800 Coverall or approved equal.

- E. Ductile iron mechanical joint fittings shall be restrained with EBBA Iron Sales, Inc. Series 1200 Restrainer. The restraining device shall be designed to fit standard mechanical joint bells with standard T head bolts conforming to AWWA C111 and AWWA C153. Glands shall be manufactured of ductile iron conforming to ASTM A536. Set screws shall be hardened ductile iron and require the same torque in all sizes. Steel set screws not permitted. These devices shall have the stated pressure rating with a minimum safety factor of 2:1. Glands shall be listed with Underwriters Laboratories and/or approved by Factory Mutual.
- F. Thrust blocks shall not be permitted.
- G. Where ductile iron pipe manufactured with restrained joints is utilized, all restrained joints shall be fully extended and engaged prior to back filling the trench and pressurizing the pipe.
- H. PVC pipe bell and spigot joints shall be restrained with the Uni-Flange Corp. Series 1350 Restrainer or approved equal. The restraining device and Tee head bolts shall be manufactured of high strength ductile iron meeting ASTM A536. Clamping bolts and nuts shall be manufactured of corrosion resistant high strength, low alloy steel meeting the requirements of ASTM A242.
- I. Ductile iron mechanical joint fittings used with PVC pipe shall be restrained with UNI-Flange Corp. Series 1300 Restrainer, EBBA Iron, Inc, Series 2000PV Mechanical Joint Restrainer Gland, or approved equal. The restraining device and Tee head bolts shall be manufactured of high strength ductile iron meeting ASTM A-536. Clamping bolts and nuts shall be manufactured of corrosion resistant high strength, low alloy steel meeting the requirements of ASTM A242.

3.9 PIPE SEPARATION:

- A. Horizontal Separation-Water Mains and Sewers:
 - 1. Water mains shall be located at least 3 m (10 feet) horizontally from any proposed drain, storm sewer, sanitary or sewer service connection.
 - 2. Water mains may be located closer than 3 m (10 feet) to a sewer line when:
 - a. Local conditions prevent a lateral separation of 3 m (10 feet); and
 - b. The water main invert is at least 450 mm (18 inches) above the crown of the sewer; and

c. The water main is either in a separate trench or in the same trench on an undisturbed earth shelf located one side of the sewer.

3. When it is impossible to meet (1) or (2) above, both the water main and drain or sewer shall be constructed of mechanical joint ductile iron pipe. Ductile iron pipe shall comply with the requirements listed in this specification section. The drain or sewer shall be pressure tested to the maximum expected surcharge head before back filling.

B. Vertical Separation-Water Mains and Sewers:

1. A water main shall be separated from a sewer so that its invert is a minimum of 450 mm (18 inches) above the crown of the drain or sewer whenever water mains cross storm sewers, sanitary sewers or sewer service connections. The vertical separation shall be maintained for that portion of the water main located within 10 feet horizontally of any sewer or drain crossed. A length of water main pipe shall be centered over the sewer to be crossed with joints equidistant from the sewer or drain.
2. Both the water main and sewer shall be constructed of slip-on or mechanical joint ductile iron pipe or PVC pipe equivalent to water main standards of construction when:
 - a. It is impossible to obtain the proper vertical separations described in (1) above; or
 - b. The water main passes under a sewer or drain.
3. A vertical separation of 450 mm (18 inches) between the invert of the sewer or drain and the crown of the water main shall be maintained where a water main crosses under a sewer. Support the sewer or drain lines to prevent settling and breaking the water main.
4. Construction shall extend on each side of the crossing until the perpendicular distance from the water main to the sewer or drain line is at least 3 m (10 feet).

3.10 SETTING OF VALVES AND BOXES:

- A. Provide a surface concrete pad 450 by 450 by 150 mm (18 by 18 by 6 inches) to protect valve box when valve is not located below pavement.
- B. Clean valve and curb stops interior before installation.
- C. Set valve and curb stop box cover flush with finished grade.

- D. Valves shall be installed plumb and level and in accordance with manufacturer's recommendations.

3.11 SETTING OF FIRE HYDRANTS:

- A. Set center of each hydrant not less than 600 mm (2 feet) nor more than 1800 mm (6 feet) back of edge of road or face of curb. Fire apparatus connection shall face road with center of nozzle 450 mm (18 inches) above finished grade. Set barrel flange not more than 50 mm (2 inches) above finished grade.
- B. Set each hydrant on a slab of stone or concrete not less than 100 mm (4 inches) thick and 375 mm (15 inches) square. The service line to the hydrant, between the tee and the shoe of the hydrant, shall be fully restrained.
- C. Set bases in not less than 0.4 cubic meter (1/2 cubic yard) of crushed rock or gravel placed entirely below hydrant drainage device.
- D. Clean interiors of hydrants of all foreign matter before installation.

3.12 PIPE SLEEVES:

Install where water lines pass through retaining walls, building foundations and floors. Seal with modular mechanical type link seal. Install piping so that no joint occurs within a sleeve. Split sleeves may be installed where existing lines pass through new construction.

3.13 FLUSHING AND DISINFECTING:

- A. Flush and disinfect new water lines in accordance with AWWA C651.
- B. Initial flushing shall obtain a minimum velocity in the main of 0.75 m/sec (2.5 feet per second) at 40 PSI residual pressure in water main. The duration of the flushing shall be adequate to remove all particles from the line.

Pipe Diameter		Flow Required to Produce 2.5 ft/sec (approx.) Velocity in Main		Number of Hydrant Outlets			
				Size of Tap. in. (mm)			
				1 (25)	1 1/2 (38)	2 (51)	2 1/2-in (64 mm)
In	(mm)	gpm	(L/sec)	Number of taps on pipe			
4	(100)	100	(6.3)	1	--	--	1
6	(150)	200	(12.6)	--	1	--	1
8	(200)	400	(25.2)	--	2	1	1
10	(250)	600	(37.9)	--	3	2	1
12	(300)	900	(56.8)	--	--	3	2

16	(400)	1,600	(100.9)	--	--	4	2
----	-------	-------	---------	----	----	---	---

The backflow preventers shall not be in place during the flushing.

- C. The Contractor shall be responsible to provide the water source for filling, flushing, and disinfecting the lines. Only potable water shall be used, and the Contractor shall provide all required temporary pumps, storage facilities required to complete the specified flushing, and disinfection operations.
- D. The Contractor shall be responsible for the disposal of all water used to flush and disinfect the system in accordance with all governing rules and regulations. The discharge water shall not be allowed to create a nuisance for activities occurring on or adjacent to the site.
- E. The bacteriological test specified in AWWA C651 shall be performed by a laboratory approved by the Health Department Department of the State. The cost of sampling, transportation, and testing shall be the responsibility of the Contractor.
- F. Re-disinfection and bacteriological testing of failed sections of the system shall be the sole responsibility of the Contractor.
- G. Before backflow preventers are installed, all upstream piping shall be thoroughly flushed.

3.14 HYDROSTATIC TESTING:

- A. Hydrostatic testing of the system shall occur prior to disinfecting the system.
- B. After new system is installed, except for connections to existing system and building, backfill at least 300 mm (12 inches) above pipe barrel, leaving joints exposed. The depth of the backfill shall be adequate to prevent the horizontal and vertical movement of the pipe during testing.
- C. Prior to pressurizing the line, all joint restraints shall be completely installed and inspected.
- D. If the system is tested in sections, and at the temporary caps at connections to the existing system and buildings, the Contractor shall provide and install all required temporary thrust restraints required to safely conduct the test.
- E. The Contractor shall install corporation stops in the line as required to purge the air out of the system. At the completion of the test, all corporation stops shall be capped.

F. The Contractor shall perform pressure and leakage tests for the new system for 2 hours to 1375 kPa (200 psi). Leakage shall not exceed the following requirements.

1. Copper Tubing: No leaks.
2. Ductile Iron Pipe: AWWA C600. Provide to Resident Engineer office.
3. Polyvinyl Chloride (PVC) AWWA C605. Provide to Resident Engineer office.

3.15 BACKFLOW PREVENTOR TESTING:

- A. All backflow preventers shall be tested and certified for proper operation prior to being placed in operation.
- B. Original copies of the certification shall be submitted to the COTR.

- - - E N D - - -

**SECTION 33 30 00
SANITARY SEWERAGE UTILITIES**

PART 1 - GENERAL

1.1 DESCRIPTION:

Outside, underground sanitary sewer system, complete, ready for operation, including all gravity flow lines, manholes, cleanouts, frames, covers, structures, appurtenances, and connections to new building and structure, service lines, existing sanitary sewer lines, and existing sanitary structures, and all other incidentals.

1.2 RELATED WORK:

- A. Maintenance of Existing Utilities: Section 01 00 00, GENERAL REQUIREMENTS.
- B. Excavation, Trench Widths, Pipe Bedding, Backfill, Shoring, Sheet piling, Bracing: Section 31 20 00, EARTH MOVING. Dewatering: Section 31 23 19, DEWATERING.
- C. Concrete Work Reinforcing, Placement and Finishing; Section 03 30 00, CAST-IN-PLACE CONCRETE

1.3 QUALITY ASSURANCE:

- A. Products Criteria:
 - 1. Multiple Units: When two or more units of the same type or class of materials or equipment are required, these units shall be products of one manufacturer.
 - 2. Nameplates: Nameplate bearing manufacturer's name, or identifiable trademark, including model number, securely affixed in a conspicuous place on equipment, or name or trademark, including model number cast integrally with equipment, stamped, or otherwise permanently marked on each item of equipment.
- B. Comply with the rules and regulations of the Public Utility having jurisdiction over the connection to Public Sanitary Sewer lines and the extension, and/or modifications to Public Utility Systems.

1.4 SUBMITTALS:

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturers' Literature and Data: Submit the following as one package:
 - 1. Pipe, Fittings, and, Appurtenances.
 - 2. Jointing Material.

- 3. Manhole and Structure Material.
- 4. Frames and Covers.
- 5. Steps and Ladders.

1.5 APPLICABLE PUBLICATIONS:

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American Society for Testing and Materials (ASTM):
 - A48/A48M-03.....Gray Iron Castings
 - A536-84(2004).....Ductile Iron Castings
 - A615/A615M-06.....Deformed and Plain Carbon-Steel Bars for
Concrete Reinforcement
 - A746-03.....Ductile Iron Gravity Sewer Pipe
 - C76-05b/C76M-05b.....Reinforced Concrete Culvert, Storm Drain and
Sewer Pipe
 - C150-05.....Portland Cement
 - C478-06a/C478M-06a.....Precast Reinforced Concrete Manhole Sections
 - C857-95(2001).....Minimum Structural Design Loading for
Underground Precast Concrete Utility Structures
 - D698-00ae1.....Laboratory Compaction Characteristics of Soil
Using Standard Effort (12,400 ft-lbf/ft³ (600
kN-m/m³))
 - D2321-05.....Underground Installation of Thermoplastic Pipes
for Sewers and Other Gravity-Flow Applications
 - D2412-02.....Determination of External Loading
Characteristics of Plastic Pipe by Parallel-
Plate Loading
 - D2992-01.....Practice for Obtaining Hydrostatic or Pressure
Design Basis for Fiberglass (Glass-Fiber-
Reinforced Thermosetting-Resin) Pipe and
Fittings
 - D3034-04a.....Type PSM Poly (Vinyl Chloride) (PVC) Sewer Pipe
and Fittings
 - D3212-96a (2003) e1.....Joints for Drain and Sewer Plastic Pipes Using
Flexible Elastomeric Seals
 - D3350-05.....Polyethylene Plastics Pipe and Fittings
Materials
 - D4101-05a.....Polypropylene Injection and Extrusion Materials

- F477-02e1.....Elastomeric Seals (Gaskets) for Joining Plastic
Pipe
- F679-06.....Poly (vinyl chloride) (PVC) Large-Diameter
Plastic Gravity Sewer Pipe and Fittings
- F714-05.....Polyethylene (PE) Plastic Pipe (SDR-PR) Based
on Outside Diameter
- F794-03.....Poly (Vinyl Chloride) (PVC) Ribbed Gravity Sewer
Pipe and Fittings Based on Controlled Inside
Diameter
- F894-05.....Polyethylene (PE) Large Diameter Profile Wall
Sewer and Drain Pipe
- F949-03.....Poly (Vinyl Chloride) (PVC) Corrugated Sewer
Pipe with Smooth Interior and Fittings
- C. American Water Works Association (AWWA):
- C105/A21.5-05.....Polyethylene Encasement for Ductile Iron Pipe
Systems
- C110/A21.10-03.....Ductile-Iron and Gray-Iron Fittings for Water
- C111/A21.11-00.....Rubber Gasket Joints for Ductile Iron Pressure
Pipe and Fittings
- C115-99.....Flanged Ductile-Iron Pipe with Threaded Flanges
- C116-03.....Protective Fusion-Bonded Epoxy Coatings for the
Interior and Exterior Surfaces of Ductile Iron
Pipe and Gray Iron Fittings for Water Supply
Service
- C151-/A21.51-02 Ductile-Iron Pipe, Centrifugally Cast for Water
- C153-00 Ductile-Iron Compact Fittings for Water
Services
- C509-01.....Resilient Seated Gate Valves for Water-Supply
Service
- C550-05.....Protective Epoxy Interior Coatings for Valves
and Hydrants
- C600-05.....Installation for Ductile-Iron Water Mains and
Their Appurtenances
- C605-94.....Underground Installation of Polyvinyl (PVC)
Pressure Pipe and Fittings for Water
- C900-97Polyvinyl Chloride (PVC) Pressure Pipe, 100 mm
(4 inches) Through 300 mm (12 inches) for Water
Distribution

- C905-97.....Polyvinyl Chloride (PVC) Pressure Pipe and
Fabricated Fittings, 350 mm through 1,200 mm
(14 Inches through 48 Inches), for Water
Transmission and Distribution
- C906-99.....Polyethylene (PE) Pressure Pipes and Fittings,
100 mm through 1575 mm (4 Inches through 63
Inches), for Water Distribution
- D. American Association of State Highway and Transportation Officials
(AASHTO):
- M198-05.....Joints for Concrete Pipe, Manholes, and Precast
Box Sections using Preformed Flexible Joint
Sealants
- E. Uni-Bell PVC Pipe Association:
- Uni-B-6-98.....Recommended Practice Low Pressure Air Testing
of Installed Sewer Pipe

PART 2 - PRODUCTS

2.1 PIPING:

- A. Gravity Flow Lines (Pipe and Fittings):
1. Polyvinyl Chloride (PVC):
 - a. Pipe and Fittings, 100 to 375 mm (4 to 15 inches) in diameter,
shall conform to ASTM D3034, SDR 35. Pipe and fittings shall have
elastomeric gasket joints providing a watertight seal when tested
in accordance with ASTM D3212. Gaskets shall conform to ASTM
F477. Solvent welded joints shall not be permitted.
 2. Ductile Iron Pipe (DIP) for Sanitary Sewer: Shall conform to ASTM
A746, thickness Class 51 unless otherwise shown or specified. Joints
on pipe and fittings shall be push-on style and conform to AWWA C110
and AWWA C111, rated for 1.03 MPa (150 psi). Exterior coating shall
be approximately 0.025 mm (1 mil) asphaltic coating as specified in
ASTM A746. Interior lining shall be a catalyzed coal tar epoxy,
having a minimum thickness of 0.60 mm (24 mils), a permeability
rating of 0.13 perms, direct impact rating of 11.3 Nm (100 in-lbs),
an abrasion resistance of 20 liters of sand per mil, and dielectric
strength of 250 volts per mil. Pipe and fittings shall be
polyethylene encased with 0.20 mm (8 mil) polyethylene sheeting per
AWWA C105. Color of polyethylene encasement shall be green.

2.2 JOINTING MATERIAL:

A. Gravity Flow Lines:

1. Ductile Iron Pipe: Push-on or mechanical joints, AWWA C111, AWWA C110.
2. Polyvinyl Chloride (PVC) Pipe (Gravity Use): Joints, ASTM D3212. Elastomeric gasket, ASTM F477.

2.3 MANHOLES:

A. Manholes shall be precast concrete construction.

1. Precast Reinforced Concrete Rings: Rings or sections shall have an inside diameter as indicated on the drawings, and shall be not less than 1200 mm (48 inches) in diameter. Wall thickness shall conform to requirements of ASTM C76, except that lengths of the sections may be shorter as conditions require. Tops shall conform to ASTM C478. Top section shall be eccentric cone type. Steps on inside wall shall be in the same plane from bottom of structure to manhole cover.
2. Precast Reinforced Concrete Manhole Risers and Tops: Design, material and installation shall conform to requirements of ASTM C478. Top sections shall be eccentric. Steps on inside wall shall be in the same plane from bottom of structure to manhole cover.
3. Flat top manhole tops shall be reinforced concrete as detailed on the drawings.
4. Mortar:
 - a. Precast Concrete Segmental Block Structures: By volume, 1 part of Portland cement, 1/4 part lime hydrate, and 3 parts sand.
 - b. Precast Reinforced Concrete Ring and Riser Structures: By volume, 1 part of Portland cement and 2 parts sand. Water in mixture shall produce a stiff, workable mortar, but shall not exceed 21 L (5-1/2 gallons) per sack of cement.
5. Flexible sealing compound shall be packaged in extruded preformed shape, sized to completely fill the joint between precast sections, and form permanently flexible watertight seal. The sealing compound shall be non-shrink and meet AASHTO M198.
6. Frames and covers shall be gray cast iron conforming to ASTM A48. The frame and cover shall be rated for HS20-44 loading, have a studded pattern on the cover, and the words "sanitary sewer". The studs and the lettering shall be raised 8 mm (5/16 inch). The cover shall be a minimum of 600 mm (24 inches) in diameter and shall have four 19 mm (3/4 inch) vent holes and two lifting slots. The bearing surface of the frame and cover shall be machine finished. The cover

shall fit firmly on the frame without movement when subject to traffic.

7. Manhole steps shall be polypropylene plastic coated on a No. 4 deformed rebar conforming to ASTM C478, Polypropylene shall conform to ASTM D4101. Steps shall be a minimum of 406 mm (16 inches) wide and project a minimum of 178 mm (7 inches) away from the wall. The top surface of the step shall have a studded non-slip surface. Steps shall be placed at 300 mm (12 inch) centers.

2.4 CONCRETE:

Concrete shall have a minimum compressive strength of 20 MPa (3000 psi) at 28 calendar days. The cement shall be Type III conforming to ASTM C150. Concrete shall conform with the provisions of Division 03 of these specifications.

2.5 REINFORCING STEEL:

Reinforcing steel shall be deformed bars, ASTM A615, Grade 40 unless otherwise noted.

2.6 CLEANOUT FRAMES AND COVERS:

Frames and covers shall be gray iron casting conforming to ASTM C48. The frame and cover shall be rated for HS20-44 wheel loading, have a studded pattern on its cover, vent holes, and lifting slots. The cover shall fit firmly on the frame without movement when subject to vehicular traffic. The word "SEWER" shall be cast on the cover.

2.16 WARNING TAPE:

Standard, .1mm (4Mil) polyethylene 76 mm (3 inch) wide tape detectable type, green with black letters and imprinted with "CAUTION BURIED SEWER LINE BELOW".

PART 3 - EXECUTION

3.1 BUILDING SERVICE LINES:

- A. Install sanitary sewer service lines to point of connection within approximately 1500 mm (5 feet) outside of buildings where service is required and make connections. Coordinate the invert and location of the service line with the Contractor installing the building lines.
- B. Connections of service line to building piping shall be made after the new sanitary sewer system has been constructed, tested, and accepted for operation by the Contracting Officer's Technical Representative (COTR). The Contractor shall install all temporary caps or plugs required for testing.

- C. When building services have not been installed at the time when the sanitary sewer system is complete, provide temporary plugs or caps at the ends of all service lines. Mark the location and depth of the service lines with continuous warning tape placed 300 mm (12 inches) above service lines.

3.2 REGRADING:

- A. Raise or lower existing manholes and structures frames and covers, cleanout frames and covers and valve boxes in regraded areas to finish grade. Carefully remove, clean and salvage cast iron frames and covers. Adjust the elevation of the top of the manhole or structure as detailed on the drawings. Adjust the elevation of the cleanout pipe riser, and reinstall the cap or plug. Reset cast iron frame and cover, grouting below and around the frame. Install concrete collar around reset frame and cover as specified for new construction.
- B. During periods when work is progressing on adjusting manholes or structures cover elevations, the Contractor shall install a temporary cover above the bench of the structure or manhole. The temporary cover shall be installed above the high flow elevation within the structure, and shall prevent debris from entering the wastewater stream.
- C. The Contractor shall comply with all OSHA confined space requirements when working within existing structures.

3.3 CONNECTIONS TO EXISTING VA OWNED MANHOLES:

- A. During construction of new connections to existing manholes, it shall be the sole responsibility of the Contractor to maintain continued sanitary sewer service to all buildings and users upstream. The contractor shall provide, install, and maintain all pumping, conveyance system, dams, weirs, etc. required to maintain the continuous flow of sewage. All temporary measures required to meet this requirement shall be subject to the review of the COTR.
- B. Core existing structure, install pipe at the design invert. Install an elastomeric gasket around the pipe, and grout the interstitial space between the pipe and the core.
- C. The bench of the manhole shall be cleaned and reshaped to provide a smooth flowline for all pipes connected to the manhole.
- D. Connections and alterations to existing manholes shall be constructed so that finished work conforms as nearly as practicable to the applicable requirements specified for new manholes, including concrete and masonry work, cutting and shaping.

3.4 PIPE SEPARATION:**A. Horizontal Separation - Water Mains and Sewers:**

1. Existing and proposed water mains shall be at least 3 meters (10 feet) horizontally from any proposed gravity flow and pressure (force main) sanitary sewer or sewer service connection.
2. Gravity flow mains and pressure (force) mains may be located closer than 3 meters (10 feet) but not closer than 1.8 m (6 feet) to a water main when:
 - a. Local conditions prevent a lateral separation of ten feet; and
 - b. The water main invert is at least 450 mm (18 inches) above the crown of the gravity sewer or 600 mm (24 inches) above the crown of the pressure (force) main; and
 - c. The water main is in a separate trench separated by undisturbed earth.
3. When it is impossible to meet (1) or (2) above, both the water main and sanitary sewer main shall be constructed of push-on or mechanical joint ductile iron pipe. The pipe for the sanitary sewer main shall comply with the specifications for pressure (force) mains, and the water main material shall comply with Section 33 10 00, WATER UTILITIES. The sewer shall be pressure tested as specified for pressure (force) mains before backfilling.

B. Vertical Separation - Water Mains and Sewers at Crossings:

1. Water mains shall be separated from sewer mains so that the invert of the water main is a minimum of 600 mm (24 inches) above the crown of gravity flow sewer or 1200 mm (48 inches) above the crown of pressure (force) mains. The vertical separation shall be maintained within 3 meters (10 feet) horizontally of the sewer and water crossing. When these vertical separations are met, no additional protection is required.
2. In no case shall pressure (force) sanitary main cross above, or within 600 mm (24 inches) of water lines.
3. When it is impossible to meet (1) above, the gravity flow sewer may be installed 450 mm (18 inches) above or 300 mm (12 inches) below the water main, provided that both the water main and sewer shall be constructed of push-on or mechanical ductile pipe. Pressure (Force) sewers may be installed 600 mm (24 inches) below the water line provided both the water line and sewer line are constructed of ductile iron pipe. The pipe for the sewer shall conform to the

requirements for pressure sewers specified herein. Piping for the water main shall conform to Section 33 10 00, WATER UTILITIES.

4. The required vertical separation between the sewer and the water main shall extend on each side of the crossing until the perpendicular distance from the water main to the sewer line is at least 3 meters (10 feet).

3.5 GENERAL PIPING INSTALLATION:

- A. Lay pipes true to line and grade. Gravity flow sewer shall be laid with bells facing upgrade. Pressure (force) mains shall have the bells facing the direction of flow.
- B. Do not lay pipe on unstable material, in wet trench or when trench and weather conditions are unsuitable for the work.
- C. Support pipe on compacted bedding material. Excavate bell holes only large enough to properly make the joint.
- D. Inspect pipes and fittings, for defects before installation. Defective materials shall be plainly marked and removed from the site. Cut pipe shall have smooth regular ends at right angles to axis of pipe.
- E. Clean interior of all pipe thoroughly before installation. When work is not in progress, open ends of pipe shall be closed securely to prevent entrance of storm water, dirt or other substances.
- F. Lower pipe into trench carefully and bring to proper line, grade, and joint. After jointing, interior of each pipe shall be thoroughly wiped or swabbed to remove any dirt, trash or excess jointing materials.
- G. Do not lay sewer pipe in same trench with another pipe or other utility. Sanitary sewers shall cross at least 600 mm (2 feet) below water lines.
- H. Do not walk on pipe in trenches until covered by layers of bedding or backfill material to a depth of 300 mm (12 inches) over the crown of the pipe.
- I. Warning tape shall be continuously placed 300 mm (12 inches) above sewer pipe
- J. Install gravity sewer line in accordance with the provisions of these specifications and the following standards:
 1. Ductile Iron Piping: AWWA C111 and C600.
 2. Polyvinyl Chloride (PVC) Piping: ASTM D2321.

3.6 MANHOLES AND VAULTS:

- A. General:
 1. Circular Structures:

- a. Precast reinforced concrete rings shall be installed true and plumb. The joints between rings and between rings and the base and top, shall be sealed with a preform flexible gasket material specifically manufactured for this type of application. Adjust the length of the rings so that the eccentric conical top section will be at the required elevation. Cutting the conical top section is not acceptable.
 - b. Precast reinforced concrete manhole risers and tops. Install as specified for precast reinforced concrete rings.
- 2. Invert channels shall be smooth and semicircular in shape conforming to inside of adjacent sewer section. Make changes in direction of flow with a smooth curve of as large a radius as size of structure will permit. Make changes in size and grade of channels gradually and evenly. Construct invert channels by one of the listed methods:
 - a. Forming directly in concrete base of structure.
 - b. Building up with brick and mortar.
- 3. Floor of structure outside the channels shall be smooth and slope toward channels not less than 1:12 (1-inch per foot) nor more than 1:6 (2 inches per foot). Bottom slab and benches shall be concrete.
- 4. Install steps and ladders per the manufacturer's recommendations. Steps and ladders shall not move or flex when used. All loose steps and ladders shall be replaced by the Contractor.
- 5. Install manhole frames and covers on a mortar bed, and flush with the finish pavement. Frames and covers shall not move when subject to vehicular traffic. Install a concrete collar around the frame to protect the frame from moving until the adjacent pavement is placed. In unpaved areas, the rim elevation shall be 50 mm (2 inches) above the adjacent finish grade. Install a 200 mm (8 inches) thick, by 300 mm (12 inches) concrete collar around the perimeter of the frame. Slope the top of the collar away from the frame.

3.7 CLEANOUTS:

- A. 150 millimeters (6 inches) in diameter and consisting of a ductile iron 45 degree fitting on end of run, or combination Y fitting and 1/8 bend in the run with ductile iron pipe extension, water tight plug or cap and cast frame and cover flush with finished grade. Center-set cleanouts, located in unpaved areas, in a 300 by 300 by 150 mm (12 by 12 by 6 inches) thick concrete slab set flush with adjacent finished grade. Where cleanout is in force main, provide a blind flange top

connection. The center of the flange shall be equipped with a 50 mm (2 inches) base valve to allow the pressure in the line to be relieved prior to removal of the blind flange. Frames and covers for pressure (force) mains shall be 600 mm (24 inches) in diameter.

- B. The top of the cleanout assembly shall be 50 mm (2 inches) below the bottom of the cover to prevent loads being transferred from the frame and cover to the piping.

3.8 INSPECTION OF SEWERS:

Inspect and obtain the COTR's approval. Thoroughly flush out before inspection. Lamp test between structures and show full bore indicating sewer is true to line and grade. Lip at joints on the inside of gravity sewer lines are not acceptable.

3.9 TESTING OF SANITARY SEWERS:

- A. Gravity Sewers and Manholes (Select one of the following):
 - 1. Air Test: PVC Pipe, Uni-Bell Uni-B-6. Clean and isolate the section of sewer line to be tested. Plug or cap the ends of all branches, laterals, tees, wyes, and stubs to be included in the test to prevent air leakage. The line shall be pressurized to 28 kPa (4 psi) and allowed to stabilize. After pressure stabilization, the pressure shall be dropped to 24 kPa (3.5 psi) greater than the average back-pressure of any groundwater above the sewer. The minimum test time shall be as specified in Uni-Bell Uni-B-6.

- - - E N D - - -

**SECTION 33 40 00
STORM DRAINAGE UTILITIES**

PART 1 - GENERAL

1.1 DESCRIPTION:

This section specifies construction of outside, underground storm sewer systems. The storm sewer systems shall be complete and ready for operation, including all drainage structures, frames, grate and covers, connections to new buildings, structure service lines, existing storm sewer lines and existing drainage structures and all required incidentals.

1.2 RELATED WORK:

- A. Maintenance of Existing Utilities: Section 01 00 00, GENERAL REQUIREMENTS.
- B. Excavation, Trench Widths, Pipe Bedding, Backfill, Shoring, Sheeting, Bracing: Section 31 20 00, EARTH MOVING.
- C. Concrete Work, Reinforcing, Placement and Finishing: Section 03 30 00, CAST-IN-PLACE CONCRETE.
- D. Protection of Materials and Equipment: Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.

1.3 QUALITY ASSURANCE:

- A. Products Criteria:
 - 1. Multiple Units: When two or more units of the same type or class of materials or equipment are required, these units shall be products of one manufacturer.
 - 2. Nameplates: Nameplate bearing manufacturer's name, or identifiable trademark, securely affixed in a conspicuous place on equipment, or name or trademark cast integrally with equipment, stamped, or otherwise permanently marked on each item of equipment.
- B. Comply with the rules and regulations of the Public Utility having jurisdiction over the connection to public storm sewer lines and the extension, and/or modifications to Public Utility systems.

1.4 SUBMITTALS:

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturers' Literature and Data: Submit the following as one package:
 - 1. Piping.

2. Jointing material.
 3. Manhole, inlet and catch basin material.
 4. Frames and covers.
 5. Steps.
 6. Resilient connectors and downspout boots.
- C. One copy of the West Virginia Department of Transportation standard details of MANHOLES, INLETS and catch basins.
- D. One copy of the West Virginia Department of Transportation specification.

1.5 APPLICABLE PUBLICATIONS:

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American Society for Testing and Materials (ASTM):
- A48-03/A48M-03.....Gray Iron Castings
 - A536-84(2004).....Ductile Iron Castings
 - A615-05/A615M-05.....Deformed and Plain-Billet Steel Bars for
Concrete Reinforcement
 - A655-04e1/A655M-04e1... Reinforced Concrete D-Load Culvert, Storm Drain
and Sewer Pipe
 - C76-05a/C76M-05a.....Reinforced Concrete Culvert, Storm Drain and
Sewer Pipe
 - C150-04ae1.....Portland Cement
 - C443-05/C443M-05.....Joints for Concrete Pipe and Manholes, Using
Rubber Gaskets
 - C478-03a/C478M-03a.....Precast Reinforced Concrete Manhole Sections
 - C506-05/C506M-05.....Reinforced Concrete Arch Culvert, Storm Drain
and Sewer Pipe
 - C655-04e1/C655M-04e1...Reinforced Concrete D-Load Culvert, Storm Drain
and Sewer Pipe
 - C1433-04e1/C1433M-04e1..Precast Reinforced Concrete Box Sections for
Culverts, Storm Drains and Sewers
 - C857-95(2001).....Minimum Structural Design Loading for
Underground Precast Concrete Utility Structures
 - C923-02/C923M-02.....Resilient Connectors between Reinforced
Concrete Manhole Structures, Pipes and
Materials

C1103-03/C1103M-03.....Joint Acceptance Testing of Installed Precast
Concrete Pipe Sewer Lines

D698-00ae1.....Laboratory Compaction Characteristics of Soil
Using Standard Effort (12,400 ft-lbf/ft³ (600
kN-m/m³))

D1056-00.....Flexible Cellular Materials-Sponge or Expanded
Rubber

D2412-02.....Determination of External Loading
Characteristics of Plastic Pipe by Parallel
Plate Loading

D2321-04e1.....Underground Installation of Thermoplastic Pipe
for Sewers and Other Gravity Flow Applications
.

D3212-96a(2003)e1.....Joints for Drain and Sewer Plastic Pipes Using
Flexible Elastomeric Seals

D3350-04.....Polyethylene Plastics Pipe and Fittings
Materials

D4101-05a.....Polypropylene Injection and Extrusion Materials

F477-02e1.....Elastomeric Seals (Gaskets) for Joining Plastic
Pipe

F679-03.....Poly (Vinyl Chloride) (PVC) Large-Diameter
Plastic Gravity Sewer Pipe and Fittings

F714-05.....Polyethylene (PE) Plastic Pipe (SDR-PR) Based
on Outside Diameter

F794-03.....Poly (Vinyl Chloride) (PVC) Profile Gravity
Sewer Pipe and Fittings Based on Controlled
Inside Diameter

F894-98a.....Polyethylene (PE) Large Diameter Profile Wall
Sewer and Drain Pipe

F949-03.....Poly (Vinyl Chloride) (PVC) Corrugated Sewer
Pipe with Smooth Interior

F1417-92(2005).....Installation Acceptance of Plastic Gravity
Sewer Lines Using Low-Pressure Air

NOTE: ASTM test methods shall be the current version as of the date of
advertisement of the project.

C. American Association of State Highway and Transportation Officials
(AASHTO):

HB17.....Standard Specifications for Highway Bridges

M198-05.....Joints for Circular Concrete Sewer and Culvert
 Pipe Using Flexible Watertight Gaskets
 M 252.....Corrugated Polyethylene Drainage Tubing
 M294-04.....Corrugated Polyethylene Pipe, 300-1500 mm (12
 to 60 inches) Diameter

PART 2 - PRODUCTS

2.1 PIPING:

A. Gravity Lines (Pipe and Appurtenances):

1. Concrete:

- a. Reinforced pipe, ASTM C76. Class IV. Joints shall be watertight flexible joints made with rubber-type gaskets conforming to ASTM C443.

2. High Density Polyethylene (HDPE):

- a. Corrugated Exterior, Smooth Bore Pipe: Shall comply with ASTM 294.
- b. Corrugated PE Pipe (Smooth Bore): Shall comply with AASHTO M294, Type S for pipes 300 to 1500 mm (12 to 60 inches). Pipe walls shall have following minimum properties:

<u>Nominal Size</u>	<u>Minimum Wall Area</u>	<u>Min. Moment of Inertia mm⁴/mm (in⁴/in)</u>
300 mm (12 in)	3200 mm ² /m (1.50 in ² /ft)	390 (.024)
375 mm (15 in)	4000 mm ² /m (1.91 in ² /ft)	870 (.053)
450 mm (18 in)	4900 mm ² /m (2.34 in ² /ft)	1020 (.062)
600 mm (24 in)	6600 mm ² /m (3.14 in ² /ft)	1900 (.116)
750 mm (30 in)	8300 mm ² /m (3.92 in ² /ft)	2670 (.163)
900 mm (36 in)	9500 mm ² /m (4.50 in ² /ft)	3640 (.222)
1050 mm (42 in)	9900 mm ² /m (4.69 in ² /ft)	8900 (.543)
1200 mm (48 in)	10900 mm ² /m (5.15 in ² /ft)	8900 (.543)
1350 mm (54 in)	12000 mm ² /m (5.67 in ² /ft)	13110 (.800)
1500 mm (60 in)	13650 mm ² /m (6.45 in ² /ft)	13110 (.800)

2.2 JOINTING MATERIAL:

A. Concrete Pipe: Rubber gasket ASTM C443.

B. Polyvinyl Chloride (PVC) Pipe:

1. PVC Plastic Pipe: Joints shall comply with ASTM D3212, Elastomeric Gaskets shall comply with ASTM F477 and as recommended by the manufacturer.

C. PE Plastic Pipe:

1. Corrugated PE Plastic Pipe: Soil tight joints shall conform to requirements in AASHTO HB-17, Division II, for soil tightness and shall be as recommended by the manufacturer.

2.3 MANHOLES, INLETS AND CATCH BASINS:

A. Manholes, inlets and catch basins shall be constructed of precast concrete, precast reinforced concrete rings, precast reinforced sections, or cast-in-place concrete. Manholes, inlets and catch basins shall be in accordance with the West Virginia Department of Transportation standard details, and the following VA requirements, in case of variance, VA requirements supersede:

1. Precast Reinforced Concrete Rings: Rings or sections shall have an inside diameter as indicated on the drawings, and shall be not less than 1200 mm (48 inches) in diameter. Wall thickness shall conform to requirements of ASTM C76, except that lengths of the sections may be shorter as conditions require. Tops shall conform to ASTM C478. Top section shall be eccentric cone type. Steps on inside wall shall be in the same plane from bottom of structure to manhole cover.
2. Precast Reinforced Concrete Manhole Risers and Tops: Design, material and installation shall conform to requirements of ASTM C478. Top sections shall be eccentric. Steps on inside wall shall be in the same plane from bottom of structure to manhole cover.
3. Flat top manhole tops shall be reinforced concrete as detailed on the drawings.
4. Precast Catch Basins: Concrete for precast sections shall have a minimum compressive strength of 35 MPa (5,000 psi) at 28 days, ASTM A615, Grade 60 reinforcing steel, rated for AASHTO HS20-44 loading with 30 percent impact, and conform to ASTM C-857.
5. Mortar:
 - a. Precast Concrete Segmental Block Structures: By volume, 1 part of Portland cement, 1/4 part lime hydrate, and 3 parts sand.
 - b. Precast Reinforced Concrete Ring and Riser Structures: By volume, 1 part of Portland cement and 2 parts sand. Water in mixture shall produce a stiff, workable mortar, but shall not exceed 21L (5-1/2 gallons) per sack of cement.
6. Flexible sealing compound shall be packaged in extruded preformed shape, sized to completely fill the joint between precast sections,

and form permanently flexible watertight seal. The sealing compound shall be non-shrink and meet AASHTO M-198B.

7. Frames and covers shall be gray cast iron conforming to ASTM A48. The frame and cover shall be rated for HS20-44 loading, have a studded pattern on the cover, and the words "storm sewer". The studs and the lettering shall be raised 8 mm (5/16 inch). The cover shall be a minimum of 600 mm (24 inches) in diameter and shall have four 19 mm (3/4 inch) vent holes and two lifting slots. The bearing surface of the frame and cover shall be machine finished. The cover shall fit firmly on the frame without movement when subject to traffic.
8. Manhole steps shall be polypropylene plastic coated on a No. 4 deformed rebar conforming to ASTM C478, Polypropylene shall conform to ASTM D4101. Steps shall be a minimum of 250 mm (10 inches) wide and project a minimum of 125 mm (5 inches) away from the wall. The top surface of the step shall have a studded non-slip surface. Steps shall be placed at 300 mm (12 inch) centers.
9. Ladders, brackets and hardware shall be constructed of welded aluminum, rails shall be 9 mm (3/8 inch) by 63 mm (2-1/2 inches) spaced a minimum of 400 mm (16 inches) apart. Rungs shall be 35 mm (1-3/8 inches) in diameter and have a non-slip surface. Standoffs shall offset the ladder 180 mm (7 inches) from the wall. The ladder assembly shall be rated for a minimum of 2200 N (500 pounds).
- B. Frame and Cover for Gratings: Frame and cover for gratings shall be cast gray iron conforming to ASTM A48; cast ductile iron conforming to ASTM A536 in accordance with West Virginia Dept. of Transportation standard details. Weight, shape, size, and waterway openings for grates and curb inlets shall be as indicated on the drawings.

2.4 HEADWALLS:

- A. Headwalls shall be cast-in-place concrete and in accordance with West Virginia Department of Transportation standard details. Concrete shall have a minimum compressive strength of 20 MPa (3000 psi) at 28 days. The cement shall be Type III conforming to ASTM C150. Concrete shall conform with the provisions of Division 03 of these specifications.

2.5 CONCRETE:

Concrete shall be in accordance with West Virginia Department of Transportation Specifications. For concrete not specified in above standards, concrete shall have a minimum compressive strength of 20 MPa

(3000 psi) at 28 calendar days. The cement shall be Type III conforming to ASTM C150. Concrete shall conform to the provisions of Division 03 of these specifications.

2.6 REINFORCING STEEL:

Reinforcing steel shall be deformed bars, ASTM A615, Grade 40 unless otherwise noted.

2.7 WARNING TAPE:

Standard, 4-Mil polyethylene 76 mm (3 inch) wide tape, detectable type, purple with black letters, and imprinted with "CAUTION BURIED STORM SEWER BELOW".

PART 3 - EXECUTION

3.1 EXCAVATION FOR STORM DRAINS AND DRAINAGE STRUCTURES:

Excavation of trenches and for appurtenances and backfilling for storm drains, shall be in accordance with the applicable portions of Section 31 20 00, EARTH MOVING.

3.2 PIPE BEDDING:

The bedding surface of the pipe shall provide a firm foundation of uniform density throughout the entire length of pipe. Concrete pipe requirements are such that when no bedding class is specified, concrete pipe shall be bedded in a soil foundation accurately shaped and rounded to conform with the lowest one-fourth of the outside portion of circular pipe. When necessary, the bedding shall be tamped. Bell holes and depressions for joints shall not be more than the length, depth, and width required for properly making the particular type of joint. Plastic pipe bedding requirements shall meet the requirements of ASTM D2321. Bedding, haunching and initial backfill shall be either Class IB or Class II material. Corrugated metal pipe bedding requirements shall conform to ASTM A798.

3.3 GENERAL PIPING INSTALLATION:

- A. Lay pipes true to line and grade. Gravity flow sewer shall be laid with bells facing upgrade.
- B. Do not lay pipe on unstable material, in wet trench or when trench and weather conditions are unsuitable for the work.
- C. Support pipe on compacted bedding material. Excavate bell holes only large enough to properly make the joint.
- D. Inspect pipes and fittings, for defects before installation. Defective materials shall be plainly marked and removed from the site. Cut pipe shall have smooth regular ends at right angles to axis of pipe.

- E. Clean interior of all pipe thoroughly before installation. When work is not in progress, open ends of pipe shall be closed securely to prevent entrance of storm water, dirt or other substances.
- F. Lower pipe into trench carefully and bring to proper line, grade, and joint. After jointing, interior of each pipe shall be thoroughly wiped or swabbed to remove any dirt, trash or excess jointing materials.
- G. Do not lay sewer pipe in same trench with another pipe or other utility.
- H. Do not walk on pipe in trenches until covered by layers of shading to a depth of 300 mm (12 inches) over the crown of the pipe.
- I. Install gravity sewer line in accordance with the provisions of these specifications and the following standards:
 - 1. Reinforced Concrete Pipe: Comply with manufacturer's recommendations with gasketed joints.
 - 2. Polyvinyl Chloride (PVC) Piping: ASTM D2321.
 - 3. High Density Polyethylene (HDPE) Piping: Comply with manufacturer's recommendations with gasketed joints
- J. Warning tape shall be continuously placed 300 mm (12 inches) above storm sewer piping.

3.4 REGRADING:

- A. Raise or lower existing manholes and structures frames and covers in regraded areas to finish grade. Carefully remove, clean and salvage cast iron frames and covers. Adjust the elevation of the top of the manhole or structure as detailed on the drawings. Reset cast iron frame and cover, grouting below and around the frame. Install concrete collar around reset frame and cover as specified for new construction.
- B. During periods when work is progressing on adjusting manholes or structures cover elevations, the Contractor shall install a temporary cover above the bench of the structure or manhole. The temporary cover shall be installed above the high flow elevation within the structure, and shall prevent debris from entering the wastewater stream.
- C. The Contractor shall comply with all OSHA confined space requirements when working within existing structures.

3.5 MANHOLES, INLETS AND CATCH BASINS:

- A. General:
 - 1. Circular Structures:
 - a. Precast reinforced concrete rings shall be installed true and plumb. The joints between rings and between rings and the base

and top shall be sealed with a preform flexible gasket material specifically manufactured for this type of application. Adjust the length of the rings so that the eccentric conical top section will be at the required elevation. Cutting the conical top section is not acceptable.

- b. Precast reinforced concrete manhole risers and tops. Install as specified for precast reinforced concrete rings.
- 2. Invert channels shall be smooth and semicircular in shape conforming to inside of adjacent sewer section. Make changes in direction of flow with a smooth curve of as large a radius as size of structure will permit. Make changes in size and grade of channels gradually and evenly. Construct invert channels by one of the listed methods:
 - a. Forming directly in concrete base of structure.
 - b. Building up with brick and mortar.
- 3. Floor of structure outside the channels shall be smooth and slope toward channels not less than 1:12 (25mm per 300mm, 1-inch per foot) nor more than 1:6 (50mm per 300mm, 2 inches per foot). Bottom slab and benches shall be concrete.
- 4. The wall that supports access rungs or ladder shall be 90 degrees vertical from the floor of structure to manhole cover.
- 5. Install steps and ladders per the manufacturer's recommendations. Steps and ladders shall not move or flex when used. All loose steps and ladders shall be replaced by the Contractor.
- 6. Install manhole frames and covers on a mortar bed, and flush with the finish pavement. Frames and covers shall not move when subject to vehicular traffic. Install a concrete collar around the frame to protect the frame from moving until the adjacent pavement is placed. In unpaved areas, the rim elevation shall be 50 mm (2 inches) above the adjacent finish grade. Install a 200 mm (8 inches) thick, by 300 mm (12 inches) concrete collar around the perimeter of the frame. Slope the top of the collar away from the frame.

3.6 CURB INLETS, CATCH BASINS, AND AREA DRAINS:

Reinforced concrete as shown or precast concrete.

3.7 INSPECTION OF SEWERS:

Inspect and obtain the Contracting Officer's Technical Representatives (COTR's) approval. Thoroughly flush out before inspection. Lamp between structures and show full bore indicating sewer is true to line and grade. Lip at joints on inside of sewer is prohibited.

- - - E N D - - -