


AC-2 SIMILAR

SPLIT-SYSTEM

AIR CONDITIONING UNITS

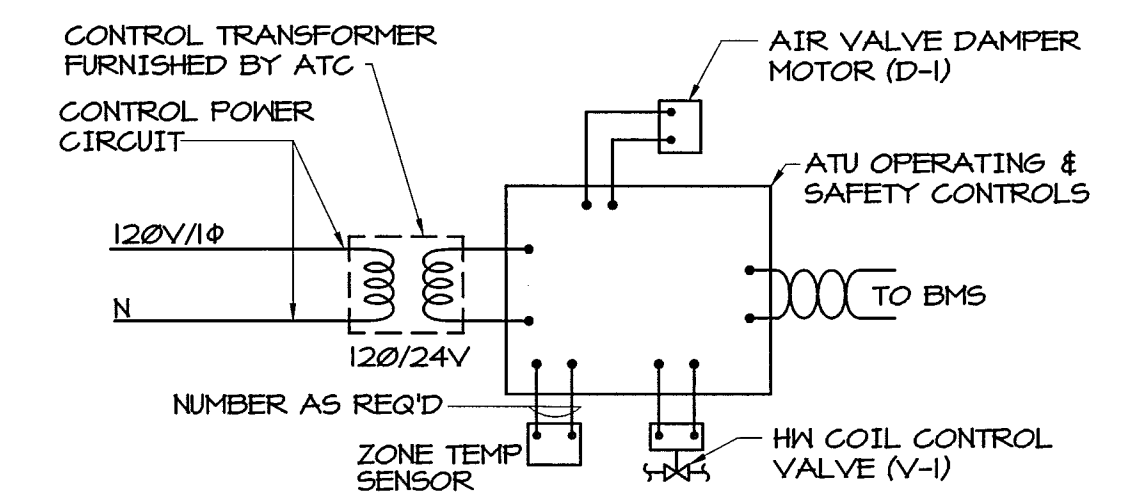

480V/3Ø

S

SUPPLY FAN INTERLOCK

AUTOMATIC BYPASS UNIT

AFD UNIT

TO BMS

AHU-1 RETURN FAN RE-1

402V/3Φ

5

CIRCUIT BREAKER OR
FUSED DISCONNECT
FURNISHED WITH UNIT

CHILLER (ACCU-1)

TO BMS

FLOW SWITCH

120V/10A


DISC. DAMPER

BMS AHU-1


F1

N

E-2 E-3 SIMILAR

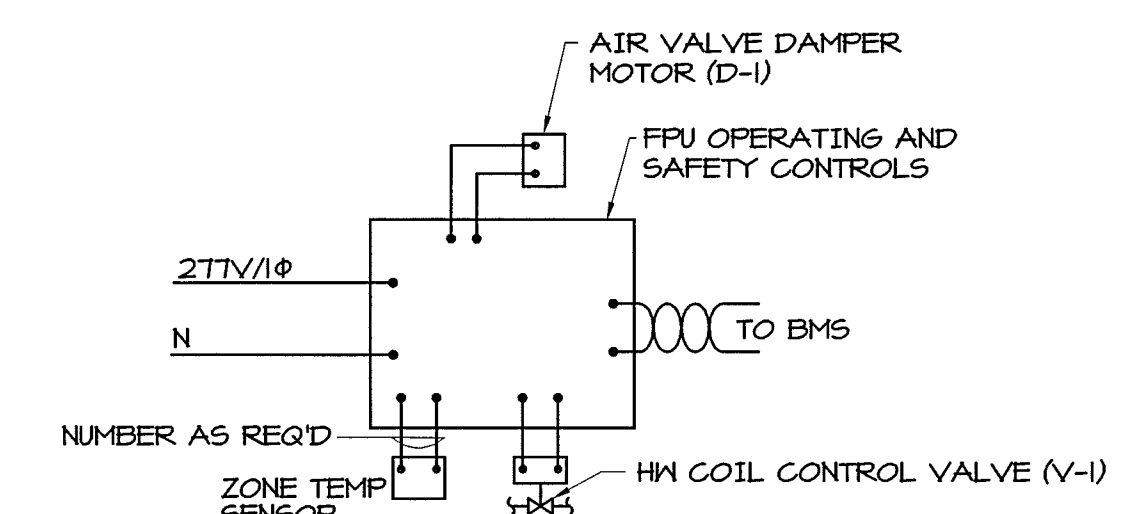

HOLDING COILS- COMBINATION FUSIBLE MOTOR STARTER	
HOLDING COILS - RELAY	
MOTOR	
MANUAL MOTOR STARTER WITH THERMAL OVERLOAD	
NON-FUSED DISCONNECT SWITCH	
FUSED DISCONNECT SWITCH	
INLINE DISCONNECT DEVICE AT MOTOR	
PILOT LIGHT	
THERMOSTAT OR RELAY - NORMALLY OPEN	
THERMOSTAT OR RELAY - NORMALLY CLOSED	
SETPOINT - CLOSE BELOW 65°F	
SETPOINT - CLOSE ABOVE 65°F	
INLINE FUSE	

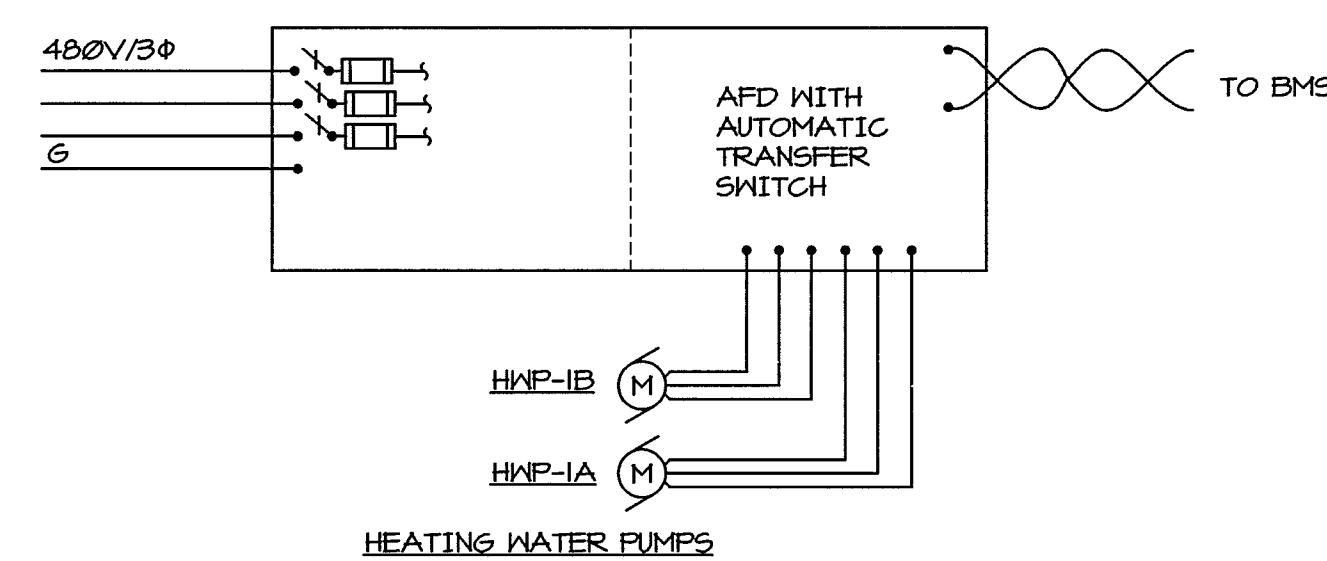

SCHEMATIC

CHEMATIC	
----------	--

VA FORM 08-6231