


## KEYED NOTES

- 1 EXISTING PANEL TO FEED NEW SURVEILLANCE EQUIPMENT
- 2 FIELD VERIFY SPARES WITHIN EXISTING PANEL

## RISER DIAGRAM

NOT TO SCALE

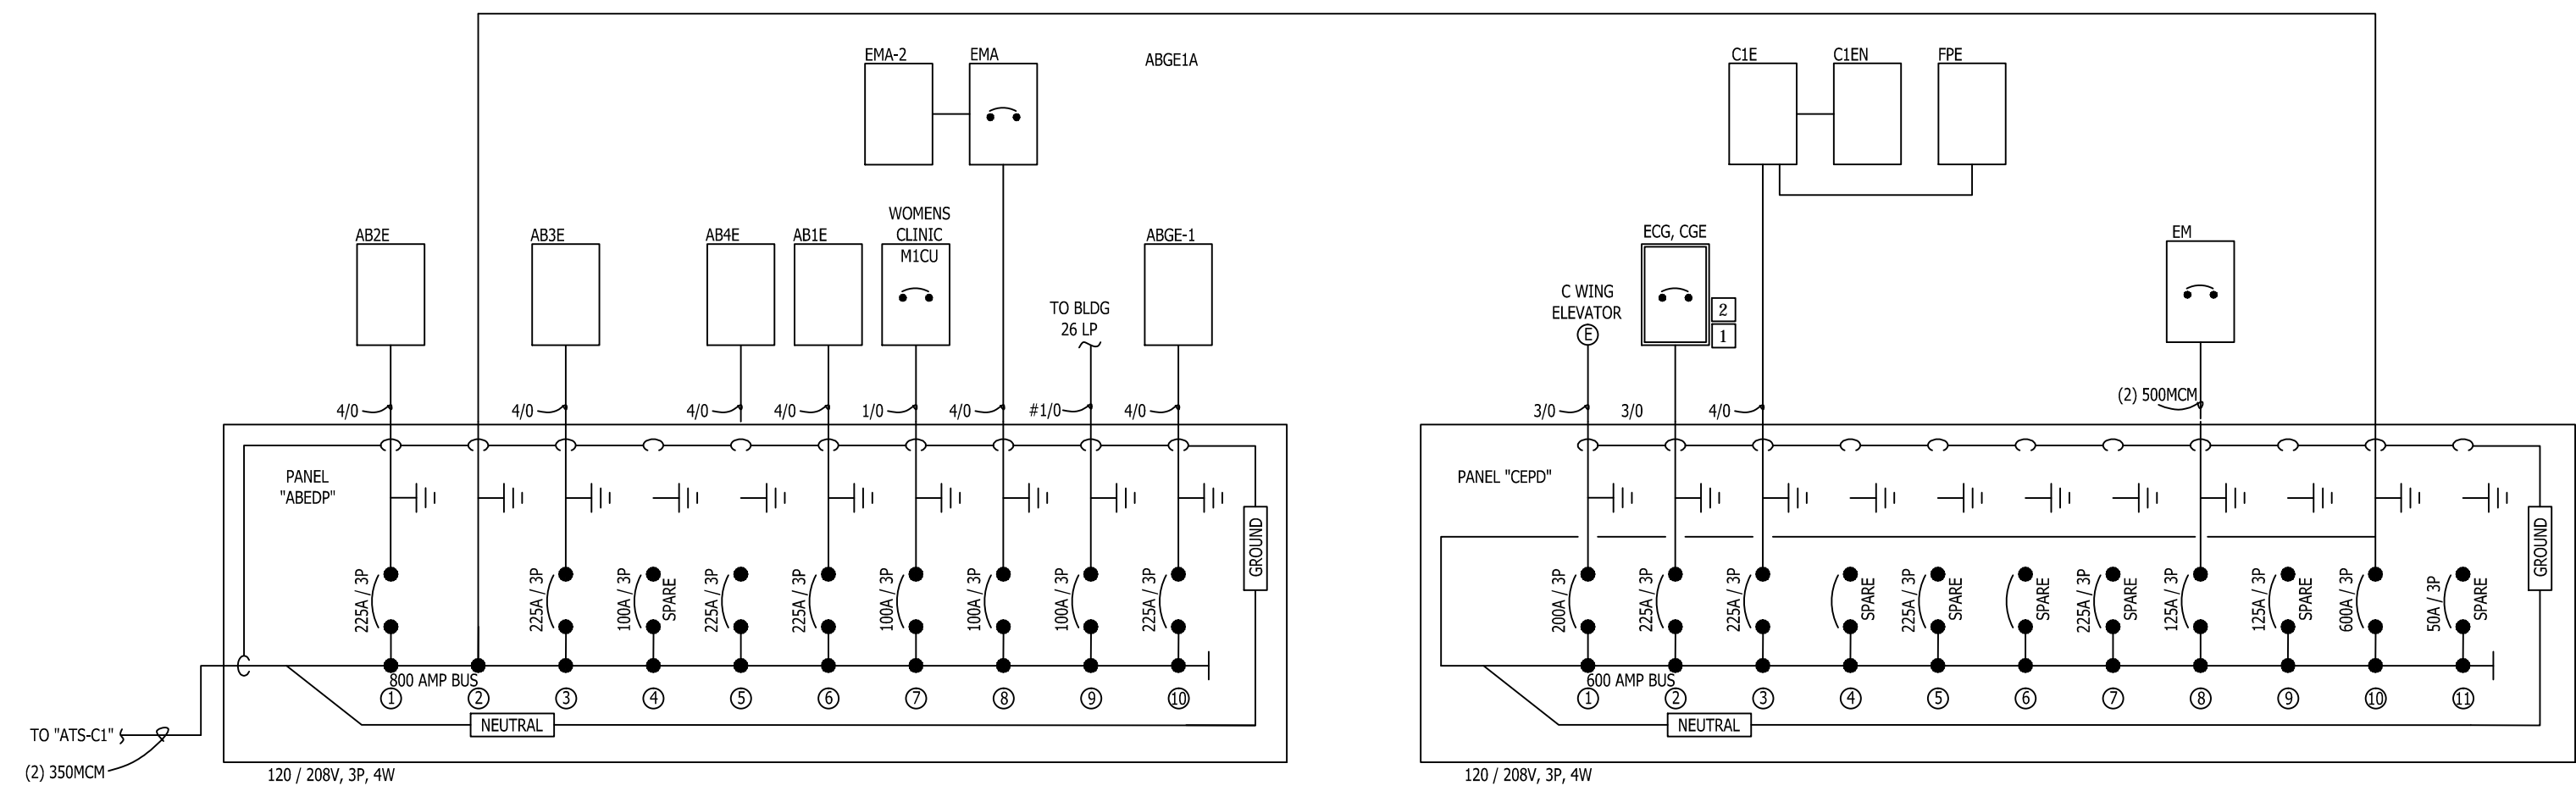

**NOTE:**  
ALL DEVICES ARE NOT SHOWN ON THIS RISER DRAWING. THIS DRAWING IS INTENDED TO INDICATE POWER CONNECTIONS TO THE SECURITY SYSTEM ONLY.

[illegible]

VA FORM 08-6231

PRINTED ON

ORIGINAL SIZE OF SHEET IS 30" X 42"



Dept. of Veterans Affairs  
Jack C. Montgomery  
Medical Center  
1011 Honor Height Drive  
Muskogee, Oklahoma 74401

APPROVED: CHIEF VA POLICE	APPROVED: President A.F.G.E. 2250	APPROVED: Energy Engineer	APPROVED: Medical Center Director
APPROVED:	APPROVED:	APPROVED: Safety Manager	APPROVED: Associate Director
APPROVED:	APPROVED:	APPROVED: Infection Control Nurse	APPROVED: Chief of Staff
APPROVED:	APPROVED:	APPROVED: Industrial Hygienist	APPROVED: Chief of Engineering Service

Drawing Title:

**ELECTRICAL POWER  
RISER DIAGRAMS**

Scale: **AS SHOWN**

Building Number:

Project Title: **REPLACE  
SURVEILLANCE  
SYSTEM**

Approved: <b>TWC - JCMVAMC</b>	Checked By: <b>CKF</b>	Drawn By: <b>WMW</b>
Location: <b>Jack C. Montgomery VA Medical Center - Muskogee, OK</b>		

Date: MM - DD - YY  
08 - 23 - 13

Project No.  
623,12,105

Drawing No.

Dwg. 03 of 25

