


1 TECHNOLOGY ROOM LAYOUT HC-1, ROOM BA100-53

SCALE: 1/4"=1'-0"




NOTES:

1. REFER TO ELECTRICAL DRAWINGS FOR GROUNDING RISER DIAGRAM.
2. REFER TO 2/00 TY401 FOR CONNECTIVITY RISER DIAGRAM.
3. REFER TO 00 TY600 FOR TECHNOLOGY GENERAL EQUIPMENT SCHEDULE.
4. FIBER CONNECTIVITY SHALL BE FROM 201A1-52

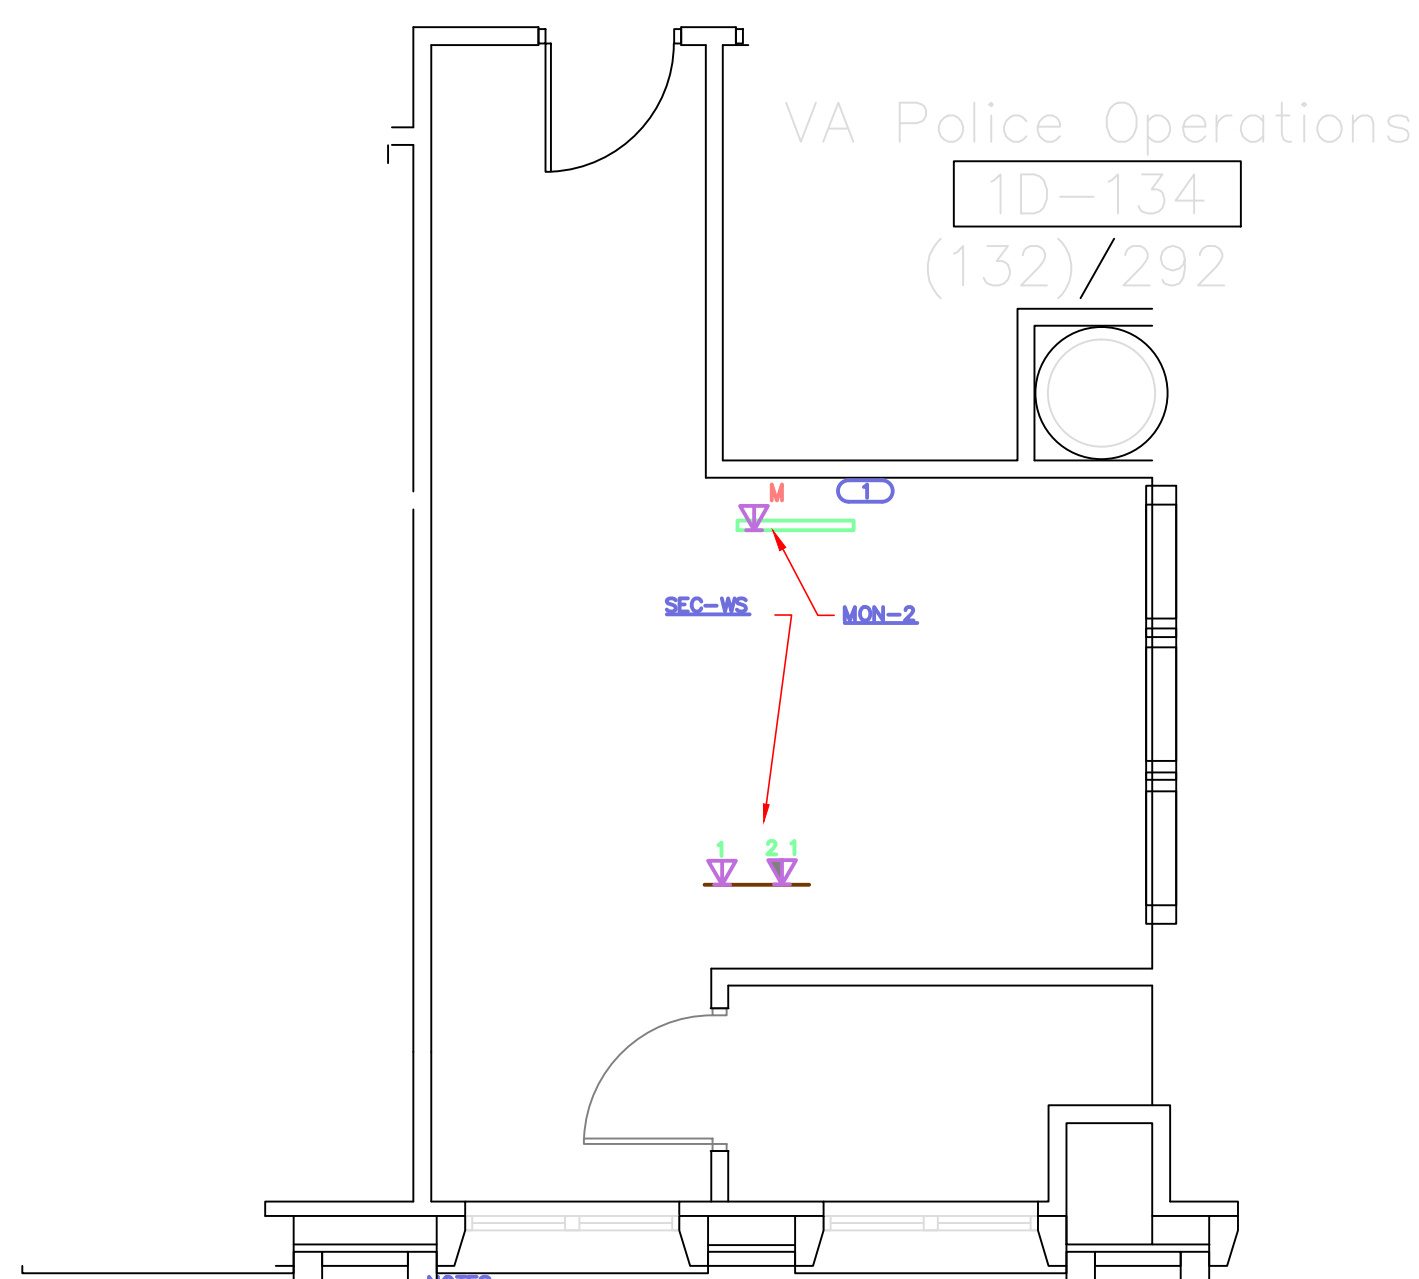

2 ROOM ENLARGEMENT OFFICE 1D-134

NOTES:  
1. DEVICES IN THIS ROOM SHALL BE ROUTED TO HC12. COORDINATE WITH VA ON WORKSTATION PLACEMENT IN EXISTING DISPATCH CENTER.  
KEYNOTES:  
1. ONE LARGE MONITOR SHALL BE CONNECTED TO ONE WORKSTATION. MONITOR SHALL CONNECT TO WALL PLATE, WITH WALL PLATE CONNECTED TO WORKSTATION, EITHER DM OR HDMI, DEPENDING ON OUTPUTS AVAILABLE ON CONTRACTOR. SELECTED MONITOR, DESKTOP MONITORS SHALL CONNECT TO WORKSTATION BY DM OR VGA.

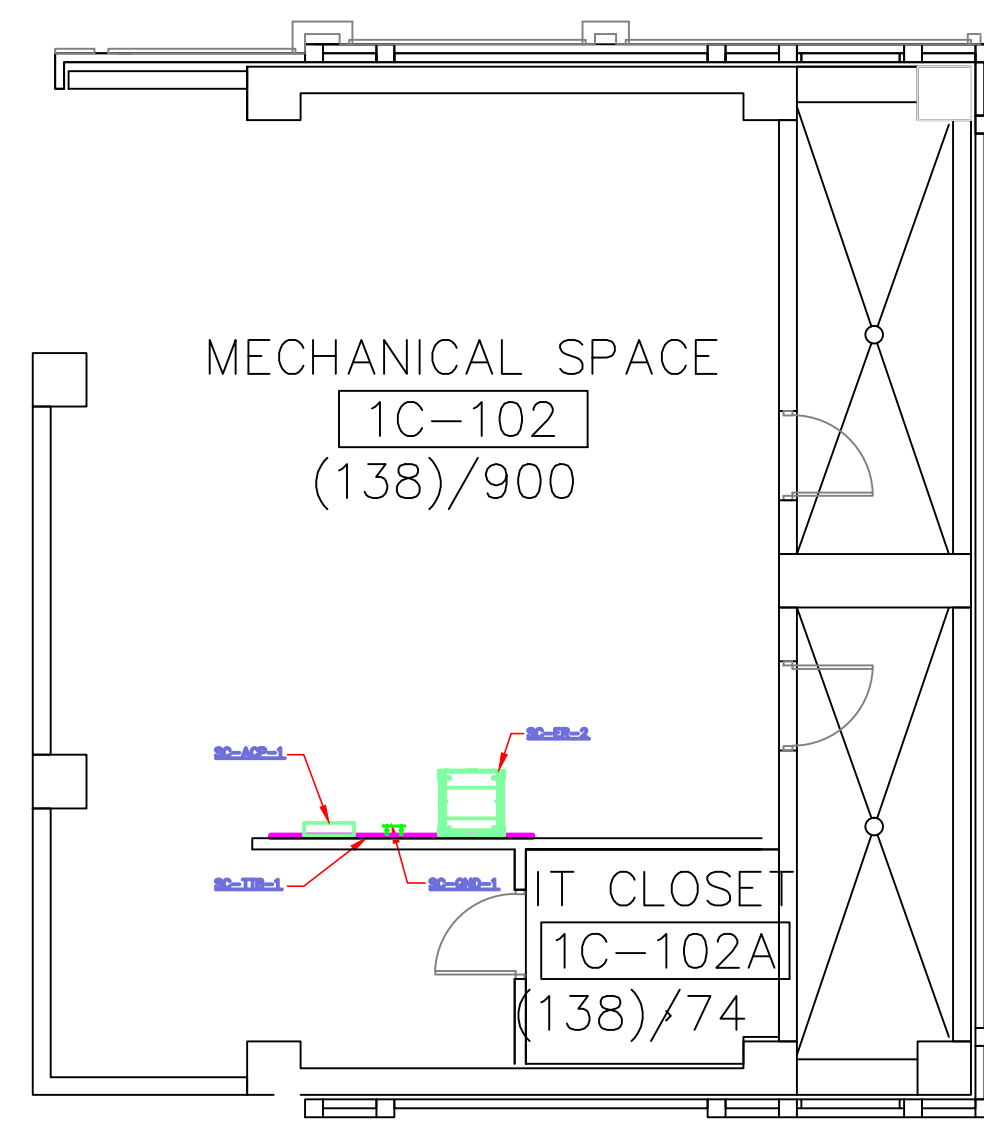

3 - TECHNOLOGY ROOM LAYOUT HC-12, ROOM 1C-102

NOTES:  
1. REFER TO ELECTRICAL DRAWINGS FOR GROUNDING RISER DIAGRAM.  
2. REFER TO 00 TY600 FOR CONNECTIVITY RISER DIAGRAM.  
3. REFER TO 00 TY600 FOR TECHNOLOGY GENERAL EQUIPMENT SCHEDULE.

No.	Description	Date
Revisions		



Dept. of Veterans Affairs  
Jack C. Montgomery  
Medical Center  
1011 Honor Height Drive  
Muskogee, Oklahoma 74401

APPROVED:	APPROVED:President R.F. LE. 2250	APPROVED:Energy Engineer	APPROVED:Medical Center Director
APPROVED:	APPROVED:	APPROVED:Safety Manager	APPROVED:Associate Director
APPROVED:	APPROVED:	APPROVED:Infection Control Nurse	APPROVED:Chief of Staff
APPROVED:	APPROVED:	APPROVED:Industrial Hygienist	APPROVED:Chief of Engineering Service

Drawing Title:	Room Enlargements
Scale:	NTS
Building Number:	53

Project Title:			<b>REPLACE SURVEILLANCE SYSTEM</b>		
Approved: <b>TWC - JCMVAMC</b>		Checked By: <b>DAVLAR</b>		Drawn By: <b>KEIEVE</b>	
Location: <b>Jack C. Montgomery VA Medical Center - Muskogee, OK</b>					

Date:	08.23.13
Project No.	623.12.105
Drawing No.	53 TY 200
Dwg.	25 of 25



ISSUED FOR CONSTRUCTION