


REMOVE EXISTING MAKE-UP-AIR-UNIT

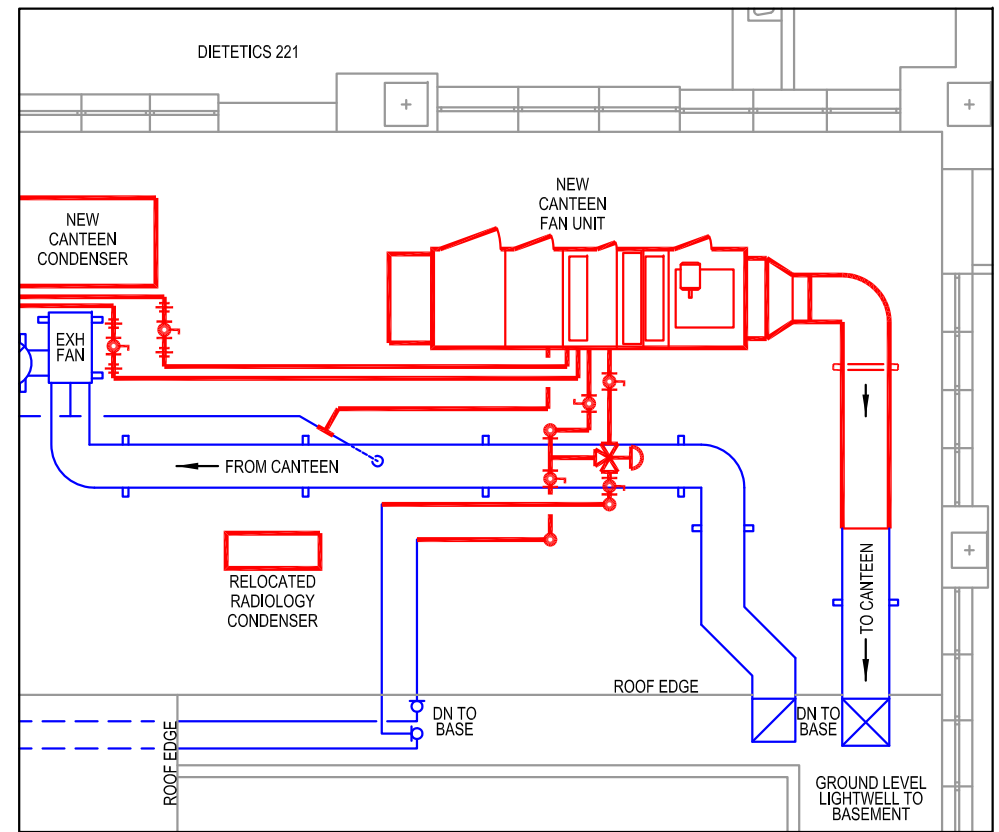

INSTALL NEW SPLIT SYSTEM FAN & CONDENSER

DWG NO.	DRAWING	TITLE	DESCRIPTION
SOW	0 of 0	SCOPE-OF-WORK	REPLACE CANTEEN ROOFTOP MAKE-UP-AIR-UNIT WITH SPLIT SYSTEM FAN AND CONDENSER A/C UNIT:
H-1	1 of 8	HVAC - DEMOLITION	1. Remove existing Rooftop Make-Up Air Unit, Duct & Piping. Re-locate Radiology Condenser to make room for new HVAC.
H-2	2 of 8	HVAC - NEW WORK	2. Install new Rooftop Split System and Ductwork . Tie into existing TRANE DDC. Modify Canteen Ductwork.
H-3	3 of 8	HVAC PIPE - NEW WORK	3. Install Piping and Controls for new Condenser and Fan.
H-4	4 of 8	NEW KITCHEN CONTROL SEQ	4. Change Kitchen Control Sequence to reflect replacement of Make-Up-Air-Unit with new Split System.
H-5	5 of 8	EQUIPMENT SCHEDULES	5. New Rooftop Split System Fan and Condenser shall have both Heating and Cooling capacities as shown.
E-1	6 of 8	ELECTRICAL	6. Modify Electrical as required for above HVAC work.
A-1	7 of 8	ARCHITECTURAL	7. Modify Walls & Ceil Tile. Core Drill Concrete Deck & Re-certify Membrane Roof with Warranty Holder. Patch & Refinish.
S-1	8 of 8	STRUCTURAL	8. Verify that new Fan Unit sits on structural members shown.

ALL WORK IN CANTEEN SHALL BE DONE AFTER 4:30PM OR ON WEEKENDS

ALL WORK IN CANTEEN SHALL BE DONE AFTER 4:30 PM OR ON WEEKENDS



James E. Van Zandt
Department Of Veterans
Affairs Medical Center

Drawing Title SCOPE-OF-WORK		Project Title INSTALL A/C CANTEEN KITCHEN		Date
Approved: Division Chief 		Building Number 	Checked 	Drawn
Approved: Service Director 		Location VAMC Altoona, Pennsylvania		DRAWING NO. SOW Dwg. 0 of 0

VAMC