

**REQUEST FOR INFORMATION (RFI)**  
**36C250-18-B-0081**

PROJECT NUMBER:	610-15-100	<b>Please ensure that before submitting questions or requests for clarification that you thoroughly read the solicitation, specifications, drawings and other pertinent documents. When submitting questions on this project the Government requires contractors to specifically identify the specification and/or solicitation section(s) or drawing number(s) in reference to the question or request for clarification submitted. No question or request for clarification will be answered by the Government unless the above requirements are met. Failure to comply may prevent the Government from responding in a timely manner.</b>
PROJECT TITLE:	Demolish Bldgs. 7,10,11,18,24,60 and Connecting Corridors	
PROJECT LOCATION:	Department of Veterans Affairs VA Northern Indiana HCS 1700 E. 38 <sup>th</sup> Street Marion, IN 46953	

SUBMITTED BY:	Shambaugh & Son, L.P.	CITY/STATE:	Marion, IN
PHONE:	260-224-5007		

**TO:**

Felecia Beamen, Contracting Officer  
Department of Veterans Affairs  
Network 10 Contracting Office  
8888 Keystone Crossing, Suite 1100  
Indianapolis, IN 46240  
[Felecia.Beamen@va.gov](mailto:Felecia.Beamen@va.gov)

RFI NO.: #E5	DATE:	SPEC/DWG. REFERENCE(s):  ED-101 – Coded Note #25
REPLY NEEDED BY: 1-2-2018		

**INFORMATION NEEDED:**


Can VA provide information as to which building the tamper switches are wired to?

**REPLY:**

**RFI's will be answered by amendment(s) posted to fbo.gov.**

See attached.

REPLY FROM: VA Marion Station	DATE: 12-21-17
ATTACHMENTS: 1	COPY TO:

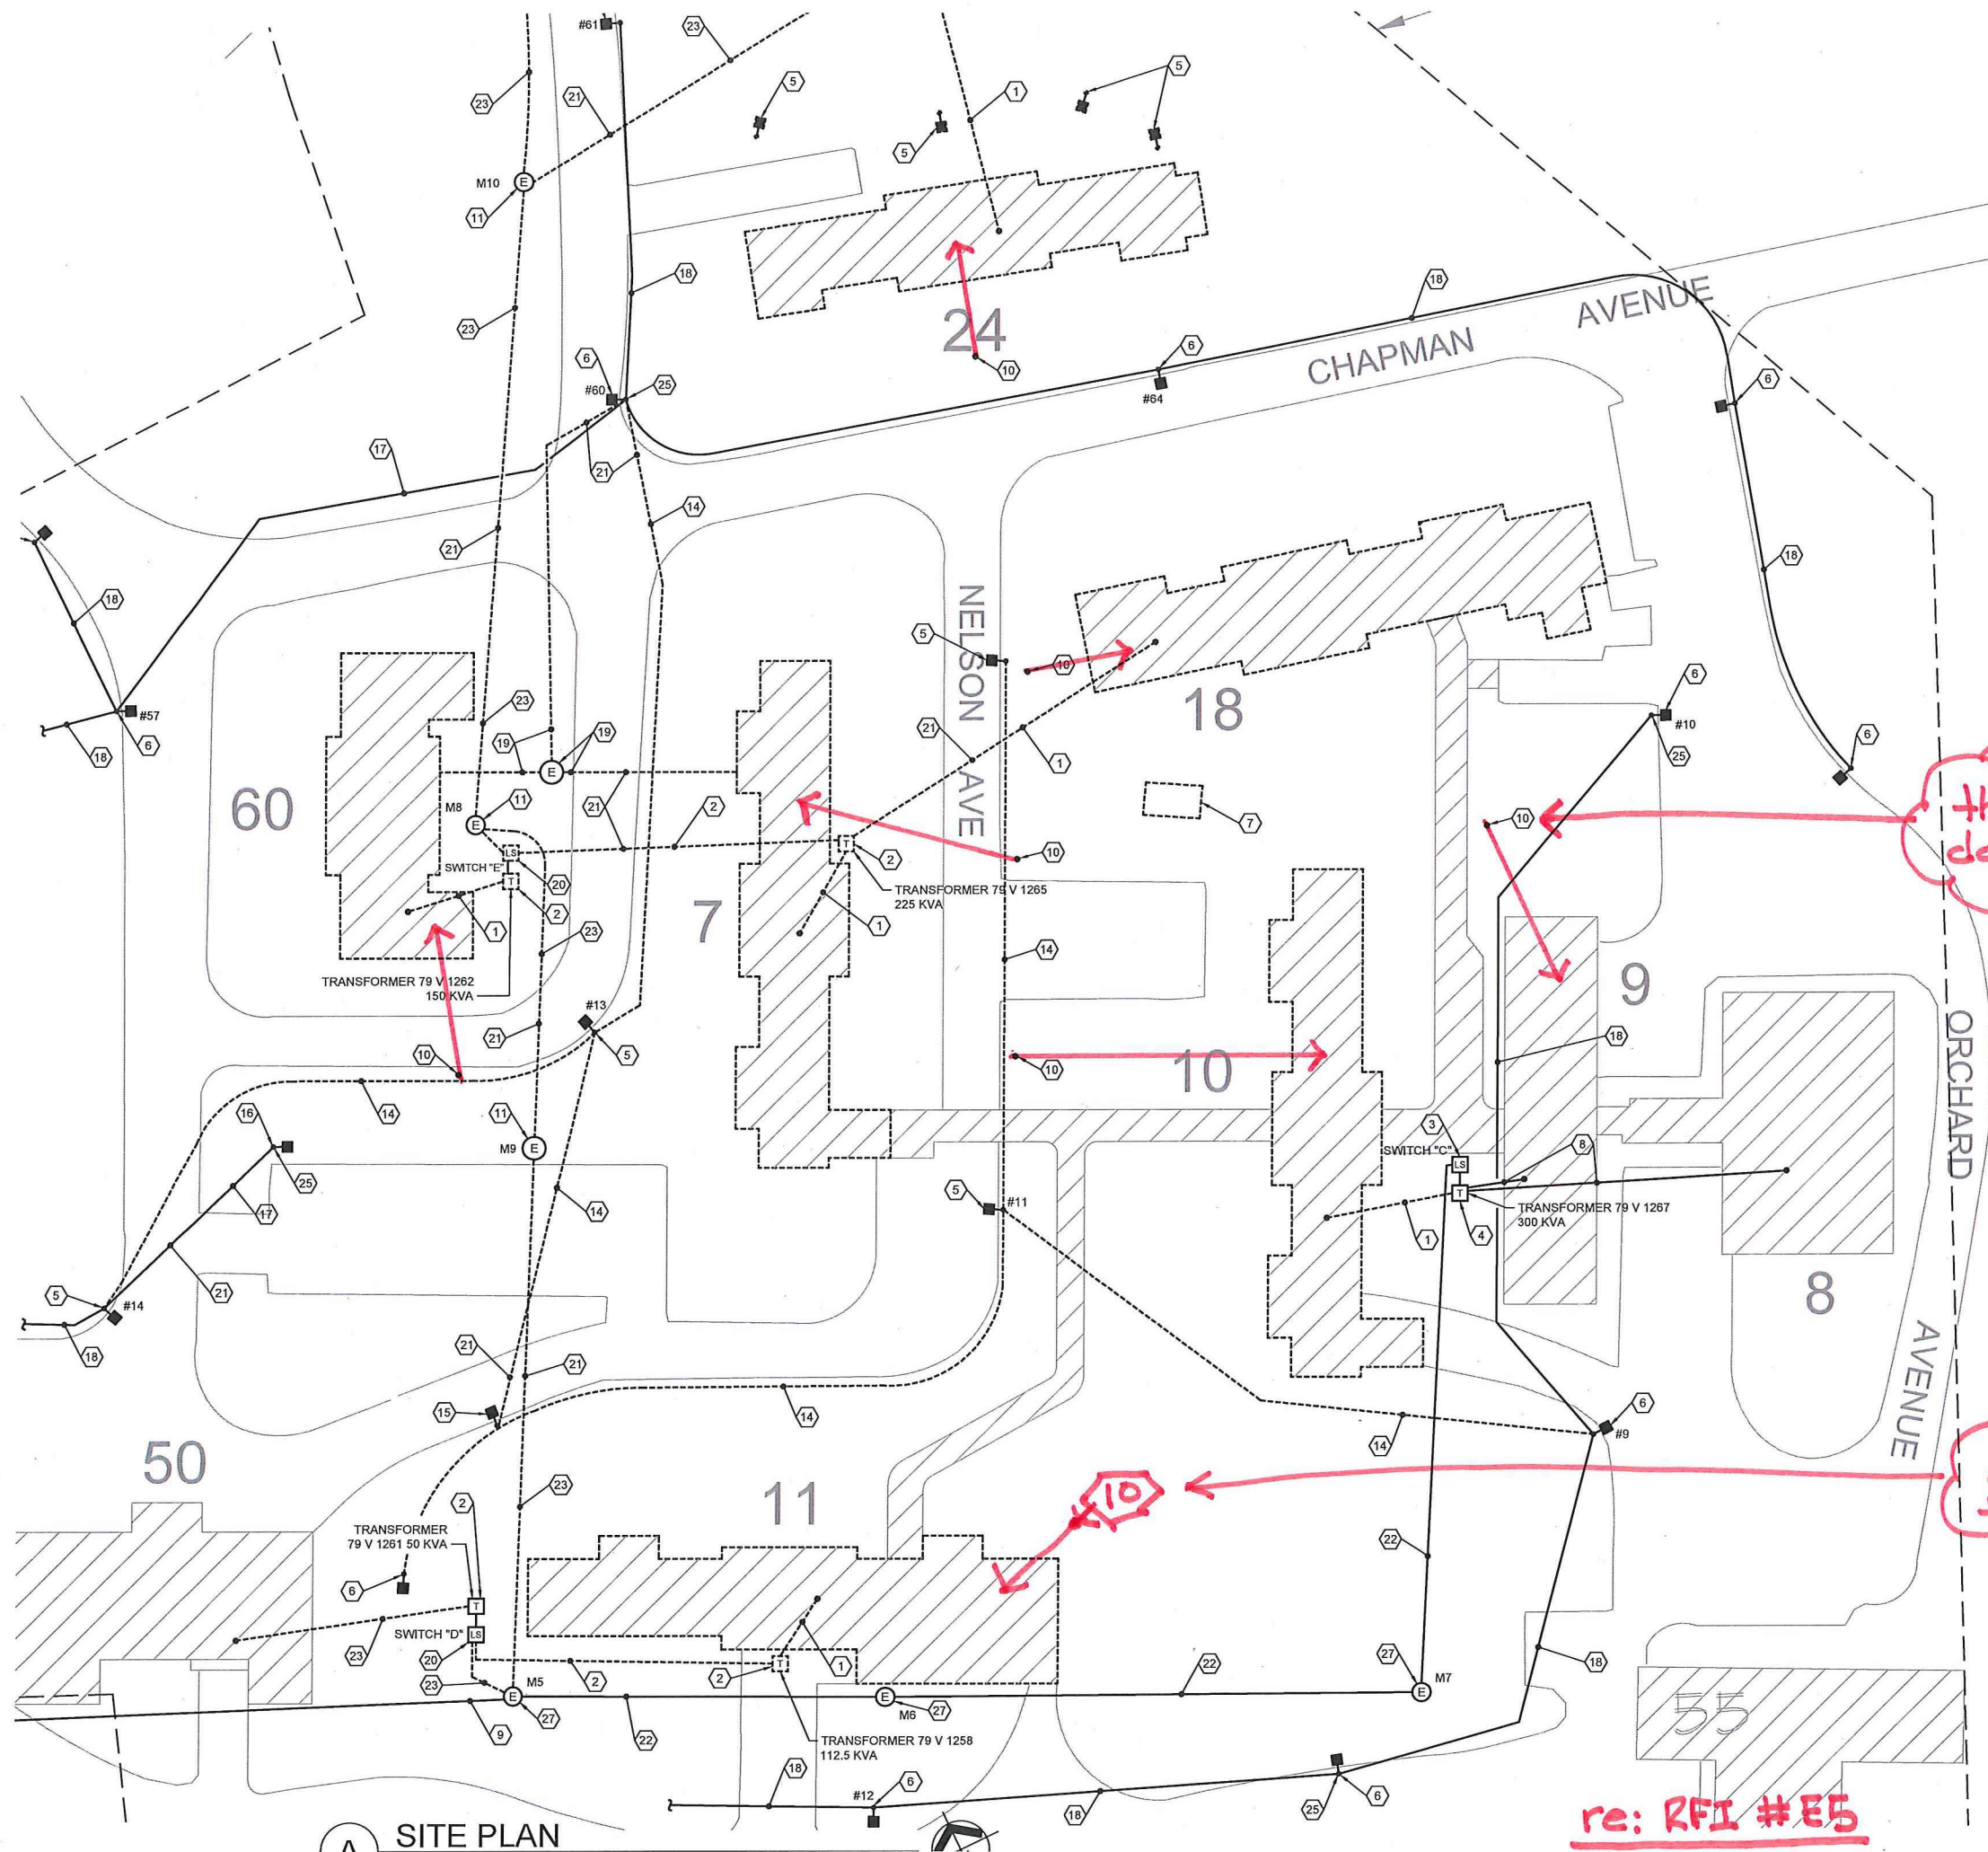

this PIV to remain.  
do not remove

add removal of  
this PIV

re: RFI #E5

610-15-100  
ED-101  
12-21-17 Elkins