




A three inches = one foot
 B one and one half inches = one foot
 C one inch = one foot
 D three quarters inch = one foot
 E one half inch = one foot
 F three eighths inch = one foot
 G one quarter inch = one foot
 H one eighth inch = one foot

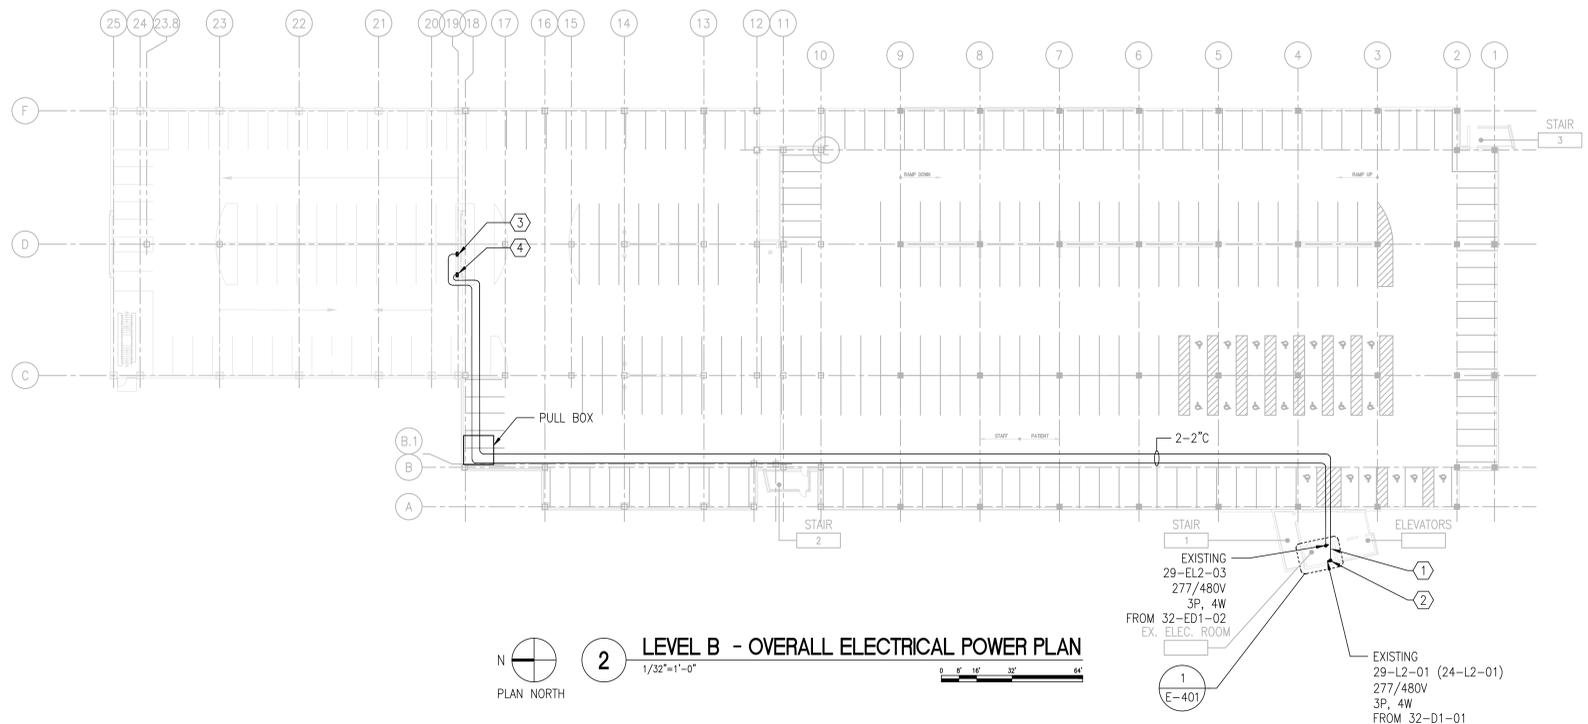

2 LEVEL B - OVERALL ELECTRICAL POWER PLAN
 1/32"=1'-0"
 PLAN NORTH

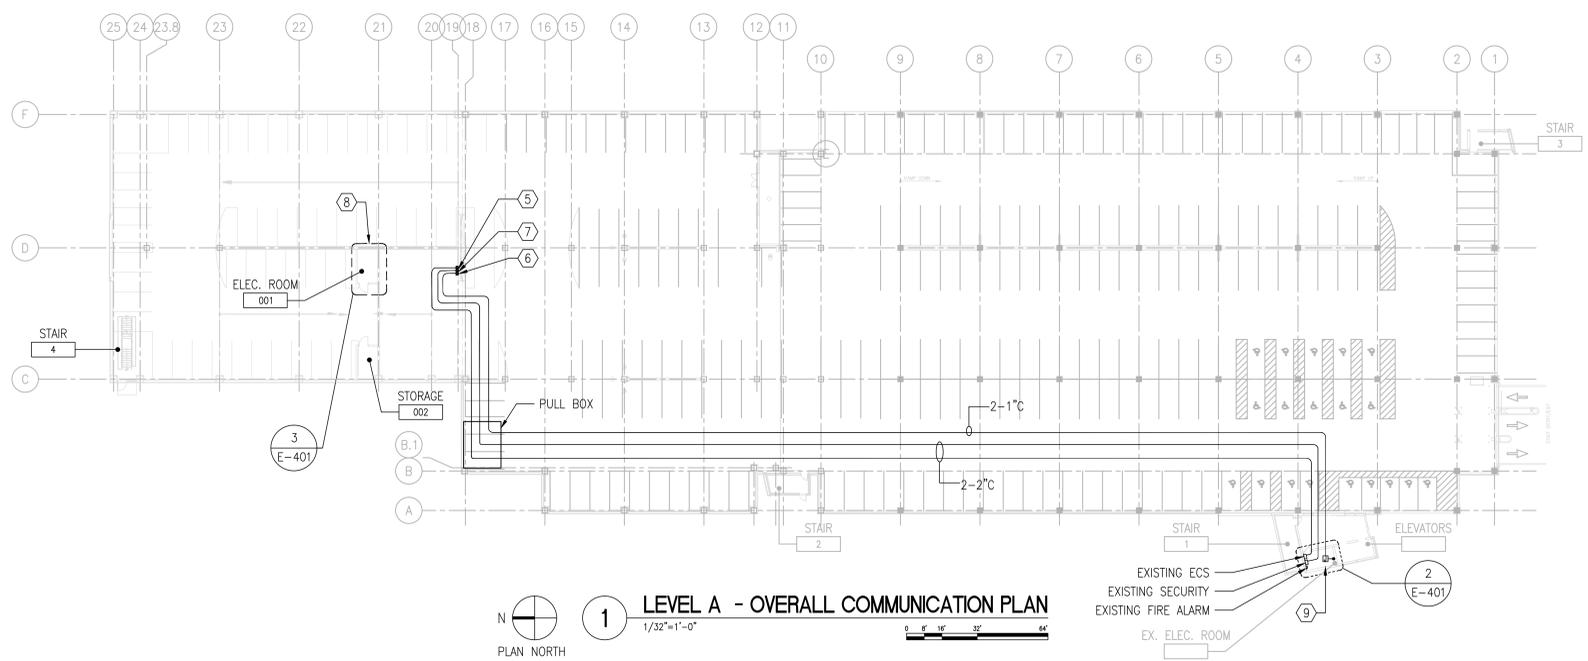

1 LEVEL A - OVERALL COMMUNICATION PLAN
 1/32"=1'-0"
 PLAN NORTH

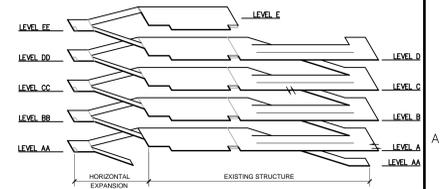

BUILDING ISOMETRIC

GENERAL NOTES

- REFER TO SPECIFICATIONS DIVISION 01 GENERAL REQUIREMENTS.
- REFER TO SPECIFICATIONS DIVISION 26 ELECTRICAL, DIVISION 27 COMMUNICATIONS AND DIVISION 28 ELECTRONIC SAFETY AND SECURITY FOR PROJECT SPECIFICATIONS AND REQUIREMENTS.
- REFER TO DRAWING G-004 FOR PROJECT CONSTRUCTION PHASING NOTES.
- REFER TO DRAWING E-001 FOR GENERAL ELECTRICAL NOTES, ELECTRICAL SYMBOLS LIST AND ABBREVIATIONS.
- REFER TO DRAWINGS ED-101 FOR ELECTRICAL DEMOLITION PLANS.
- REFER TO DRAWINGS EC-101 THROUGH EC-105 FOR FIRE ALARM SYSTEM AND SECURITY SYSTEM PLANS.

ELECTRICAL PLAN NOTES

- EXISTING PARKING GARAGE LEVEL B ELECTRIC ROOM. REFER TO DRAWING E-401 FOR EXISTING ELECTRICAL EQUIPMENT LOCATION AND RESPECTIVE SYSTEM COMPONENTS.
- CONDUITS AND FEEDER CABLES FROM EXISTING ELECTRIC PANELBOARD 29-L2-01. SUSPEND CONDUIT BELOW EXISTING CONCRETE STEMS OF DOUBLE TEE MEMBERS. REFER TO SPECIFICATIONS VOLUME TWO (II) PHOTO INDEX FOR EXISTING CONDUIT RACKING SYSTEM.
- NORMAL FEEDER, 1-2" DIAMETER RGS
- EMERGENCY FEEDER, 1-2" DIAMETER RGS
- CONDUIT FOR ECS TO BE CONNECTED TO EXISTING.
- CONDUIT FOR SECURITY SYSTEM TO BE CONNECTED TO EXISTING.
- 2" CONDUIT FOR FIRE ALARM SYSTEM.
- PROVIDE FIRE ALARM TRANSPONDER PANEL AT EQUIPMENT RACK IN ELECTRIC ROOM 001. REFER TO DRAWING EC-101.
- REFER TO DRAWING EC-106 FOR FLOOR PLAN CONTINUATION.

100% FINAL BID DOCUMENTS	08-18-2017
100% BID DOCUMENTS-NOT FOR CONSTRUCTION	07-24-2017
95% CONSTRUCTION DOCUMENTS SUBMISSION	06-15-2017
65% DESIGN DEVELOPMENT SUBMISSION	04-19-2017
35% SCHEMATIC DESIGN SUBMISSION	03-06-2017
Revisions	Date

CONSULTANTS:

3815 Plaza Drive Ann Arbor, Michigan 48108
 (734) 995-0200 • www.midwesternconsulting.com
 Land Development • Land Survey • Institutional • Municipal
 Wireless Communications • Transportation • Landfill Services

KEYPLAN

ARCHITECT + ENGINEERS:

700 Nicholas Blvd., Suite 300
 Ek Grove Village, IL 60007
 Telephone : 847.952.9342
 www.bancroft-ae.com
 Bancroft-AE Project No. 14-121

Drawing Title
LEVEL A AND B - OVERALL ELECTRICAL POWER PLAN

Approved Project Director

Project Title
CONSTRUCT NORTH PARKING STRUCTURE

Project Number
506-331

Building Number
29

Drawing Number
E-201

Location
ANN ARBOR, MICHIGAN

Date
08-18-2017

Checked
LF

Drawn
YY AG

Office of Construction and Facilities Management