


GENERAL NOTES

- REFER TO SPECIFICATIONS DIVISION 01 GENERAL REQUIREMENTS.
- REFER TO SPECIFICATIONS DIVISION 26 ELECTRICAL, DIVISION 27 COMMUNICATIONS AND DIVISION 28 ELECTRONIC SAFETY AND SECURITY FOR PROJECT SPECIFICATIONS AND REQUIREMENTS.
- REFER TO DRAWING G-004 FOR PROJECT CONSTRUCTION PHASING NOTES.
- REFER TO DRAWING E-001 FOR GENERAL ELECTRICAL NOTES, ELECTRICAL SYMBOLS LIST AND ABBREVIATIONS.
- REFER TO DRAWINGS ED-101 FOR ELECTRICAL DEMOLITION PLANS.
- REFER TO DRAWINGS E-101 THROUGH E-105 FOR ELECTRICAL LIGHTING AND POWER SYSTEM PLANS.
- CONDUIT ROUTING IS SHOWN DIAGRAMMATICALLY ON FLOOR PLANS. CONTRACTOR WILL PROVIDE SHOP DRAWING INDICATING ROUTING OF ALL CONDUIT SYSTEMS PRIOR TO INSTALLATION. REFER TO DETAIL 1 ON S-515 FOR THE LOCATION AND QUANTITIES OF BLOCKOUTS AT THE PRECAST CONCRETE DOUBLE TEE MEMBERS.

FIRE ALARM PLAN NOTES

- FURNISH AND INSTALL 1-1/2" CONDUIT AND CONTROL CABLING FROM PARKING GARAGE LEVEL A UP THROUGH PIPE CHASE SPACE. PROVIDE SUPPORT SYSTEM AND JUNCTION BOXES AS REQUIRED BY FIELD CONDITIONS. FIRE ALARM CONTROL CABLING WILL BE (2) 2 C/#14 TSP CIRCUITS. ALL FIRE ALARM CONDUIT WILL BE RED.
- FURNISH AND INSTALL 1-1/2" CONDUIT AND CONTROL CABLING ABOVE SUSPENDED CEILING SYSTEM. CONDUIT ROUTING IS SHOWN DIAGRAMMATICALLY. CONTRACTOR WILL VERIFY FINAL CONDUIT ROUTE AFTER HIS ABOVE CEILING FIELD INSPECTION OF EXISTING CONDITIONS. PROVIDE SUPPORT SYSTEM AND JUNCTION BOXES AS REQUIRED BY FIELD CONDITIONS. PROVIDE FIRE STOP SYSTEM AT THROUGH WALL PIPE PENETRATION ALONG COLUMN LINE X. CONTRACTOR WILL REMOVE AND REPLACE EXISTING SUSPENDED CEILING SYSTEMS AS REQUIRED TO INSTALL WORK ITEMS SPECIFIED.
- EXTEND CONDUIT AND CONTROL CABLING TO EXISTING FIRE ALARM SYSTEM "NODE-2" LOCATED IN EXISTING VESTIBULE L 126.
- EXISTING FIRE ALARM CONTROL PANEL AT EXISTING VESTIBULE L 126.
- PROVIDE 2 HOUR U.L. RATED FIRE STOP SYSTEM AT CONDUIT PENETRATIONS AT EXISTING FLOOR DECKS AT EXISTING ELEVATOR LOBBY LEVEL B LEVEL C.
- REFER TO DRAWING EC-105 FOR CONTINUATION OF FLOOR PLANS AND ADDITIONAL NOTES.

1 AREA A - COMMUNICATION, SURVEILLANCE AND FIRE ALARM PLAN
1/8"=1'-0"
PLAN NORTH

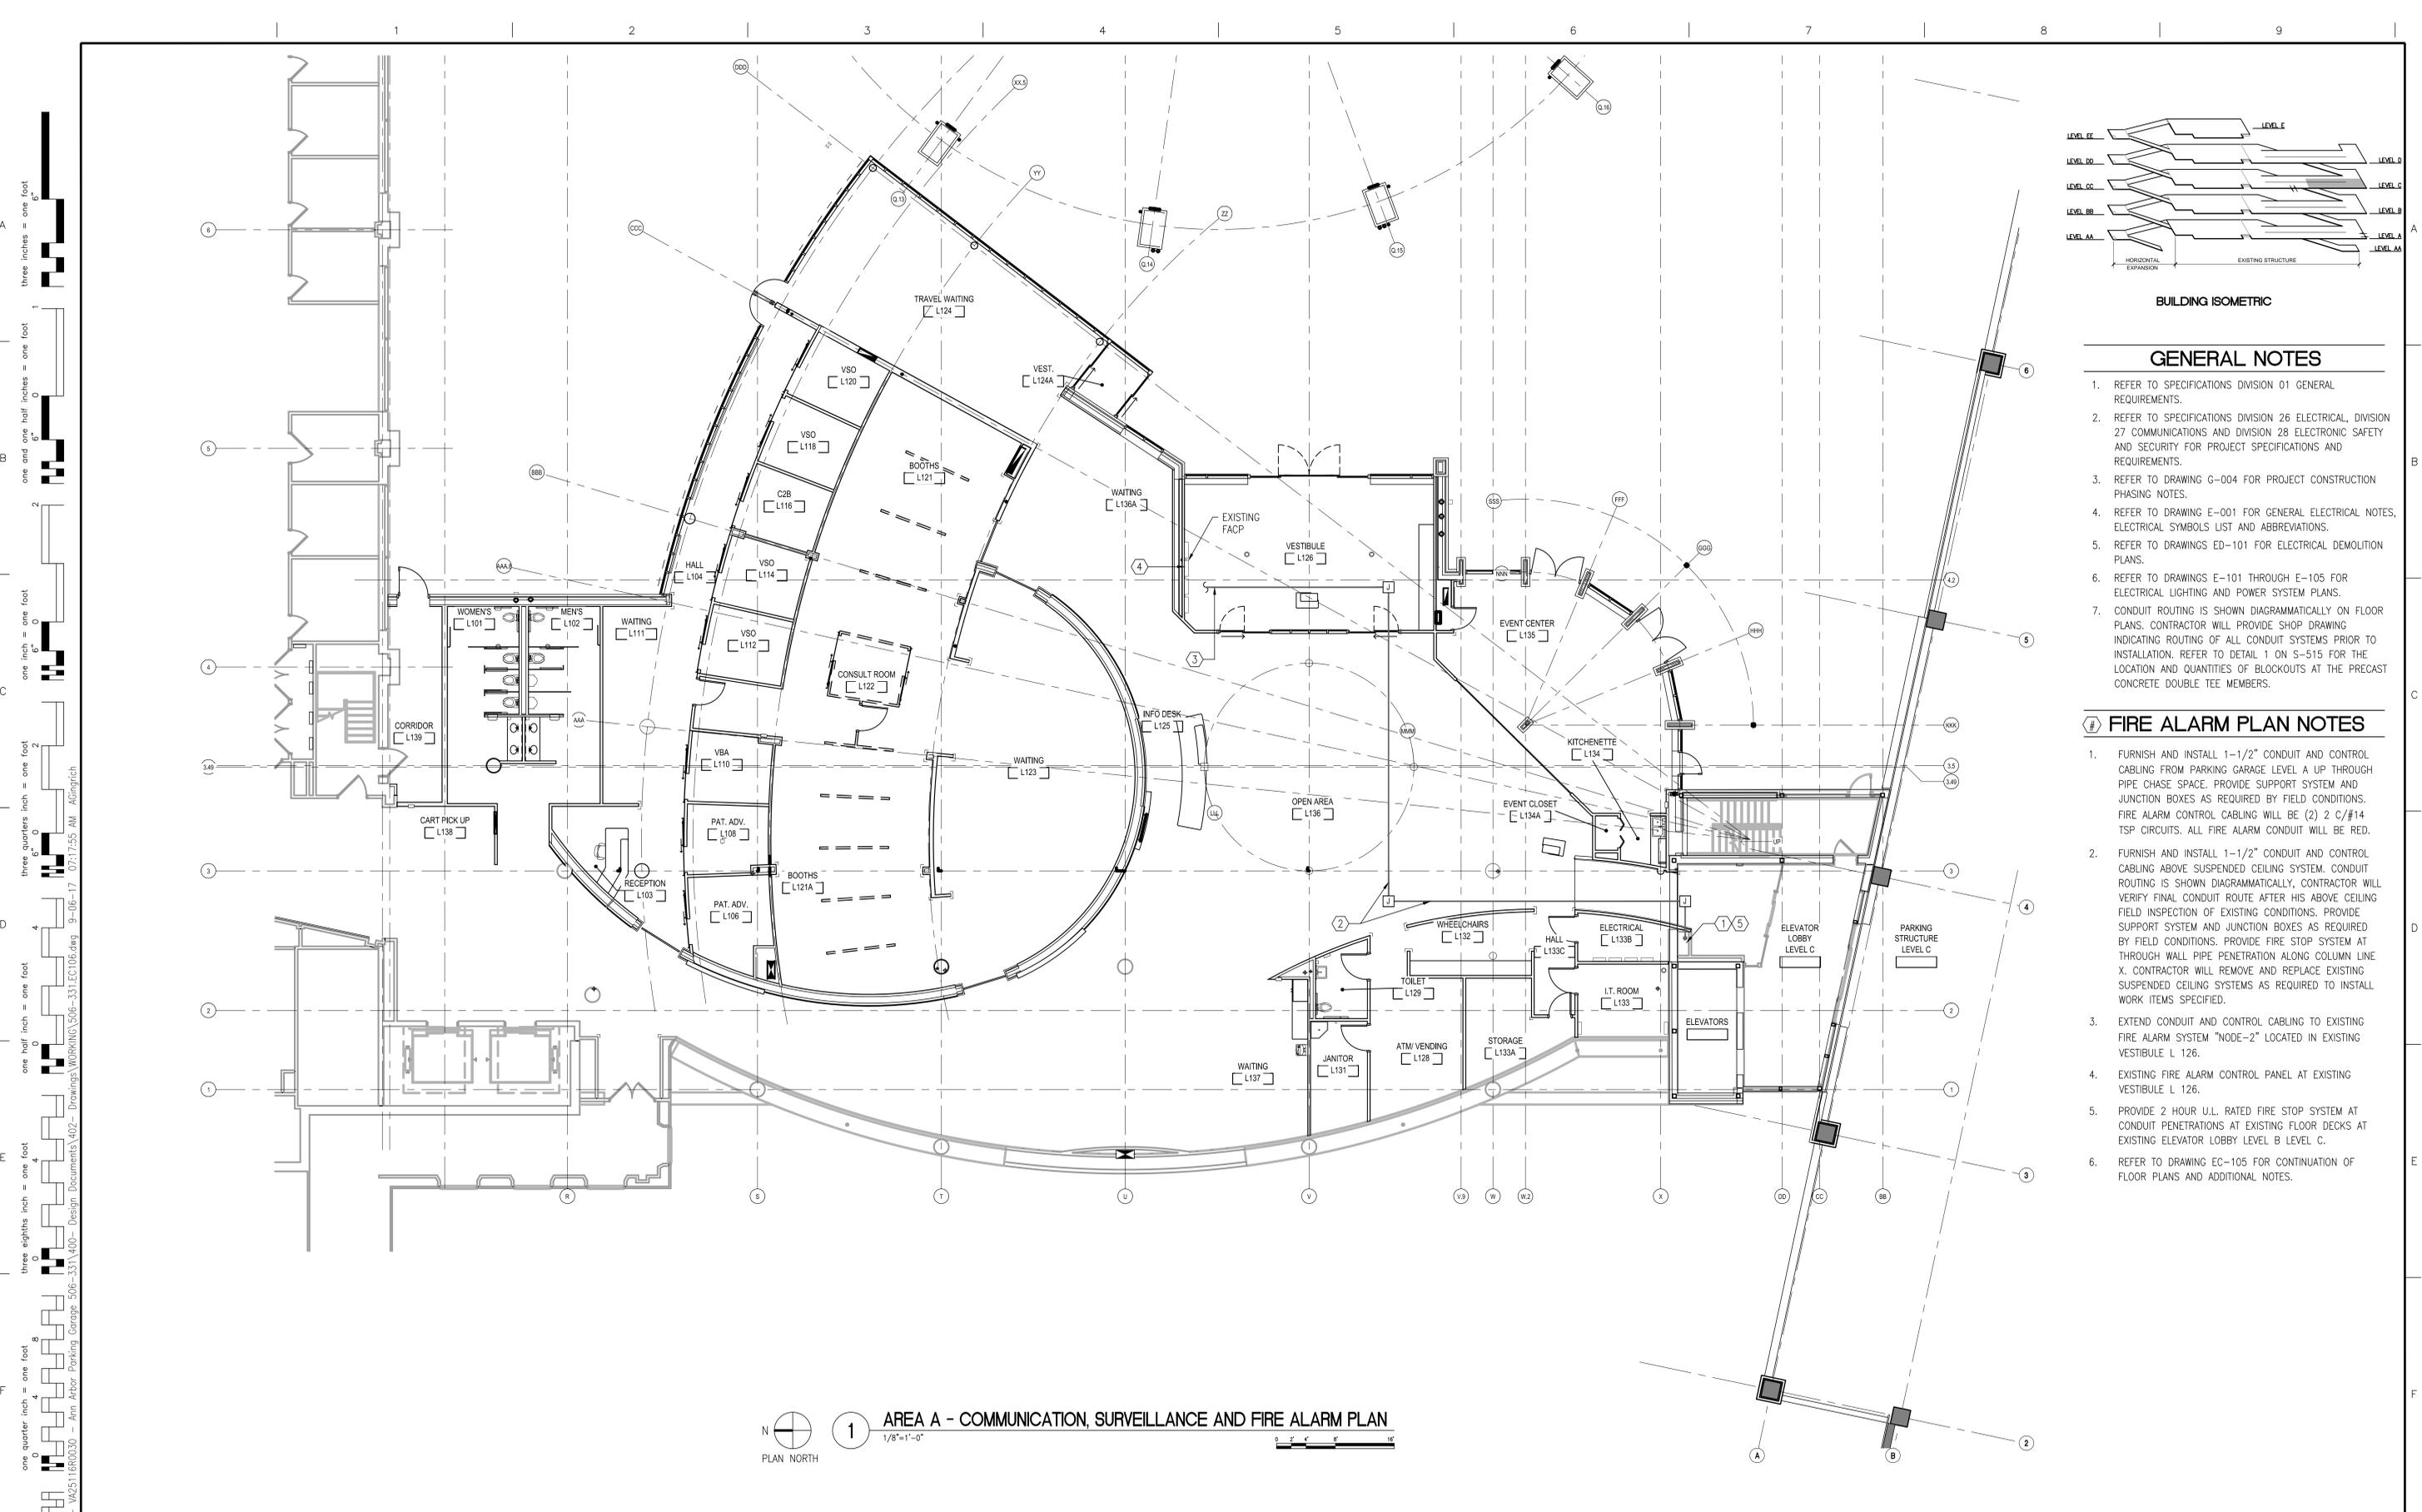

Scale: three eighths inch = one foot
 Scale: one quarter inch = one foot
 Scale: one eighth inch = one foot
 Scale: one half inch = one foot
 Scale: three quarters inch = one foot
 Scale: one and one half inches = one foot
 Scale: three inches = one foot

100% FINAL BID DOCUMENTS	08-18-2017
100% BID DOCUMENTS-NOT FOR CONSTRUCTION	07-24-2017
95% CONSTRUCTION DOCUMENTS SUBMISSION	06-15-2017
65% DESIGN DEVELOPMENT SUBMISSION	04-19-2017
35% SCHEMATIC DESIGN SUBMISSION	03-06-2017
Revisions:	Date

CONSULTANTS:

WALKER PARKING CONSULTANTS
325 Park Drive, Suite 1
Ann Arbor, MI 48108

MIDWESTERN CONSULTING
3815 Plaza Drive Ann Arbor, Michigan 48108
(734) 995-0200 • www.midwesternconsulting.com
Land Development • Land Survey • Institutional • Municipal
Wireless Communications • Transportation • Landfill Services

KEYPLAN

ARCHITECT + ENGINEERS:

Bancroft Architects + Engineers
700 Nicholas Blvd., Suite 300
Ely Grove Village, IL 60007
Telephone: 847.952.9342
www.bancroft-ae.com
Bancroft-AE Project No. 16-121
VA CONTRACT NO. VA250-17-C-0008

Drawing Title
AREA A - COMMUNICATION, SURVEILLANCE AND FIRE ALARM PLAN

Approved Project Director

Project Title
CONSTRUCT NORTH PARKING STRUCTURE

Location
ANN ARBOR, MICHIGAN

Date
08-18-2017

Checked
LF

Drawn
YY AG

Project Number
506-331

Building Number
29

Drawing Number
EC-106

Office of Construction and Facilities Management

Department of Veterans Affairs