


LEGEND

FIRE ALARM

- F** FIRE ALARM PULL STATION. MOUNTED 48" AFF TO CENTERLINE OF STATION.
- 15** **F** AUDIO/VISUAL ALARM. COMBINATION SPEAKER WITH ADJUSTABLE CANDELA STROBE LIGHT. WALL MOUNTED 90" AFF TO TOP. CEILING MOUNT WHERE INDICATED. NUMBER INDICATES CANDELA RATING OF STROBE. 'WP' INDICATES WEATHERPROOF UNIT.
- 15** **F** VISUAL ALARM. ADJUSTABLE CANDELA STROBE LIGHT. WALL MOUNTED 90" AFF TO TOP. CEILING MOUNT WHERE INDICATED. NUMBER INDICATES CANDELA RATING OF STROBE. REFER TO SPECIAL REQUIREMENTS IN SLEEPING AREAS. NS INDICATES NON-SUPERVISED 120 VOLT REMOTE VISUAL SIGNAL, 177 CANDELA, CONNECTED TO NON-SUPERVISED SMOKE DETECTOR.
- SFS** SPRINKLER FLOW SWITCH
- STS** SPRINKLER TAMPER SWITCH
- MM** MONITOR MODULE
- S** SMOKE DETECTOR
- DH** DOOR HOLDER
- H_S** DUCT SMOKE DETECTOR
'S' INDICATES LOCATED IN SUPPLY PLENUM
'R' INDICATES LOCATED IN RETURN PLENUM
- T** TEST STATION FOR DUCT SMOKE DETECTOR

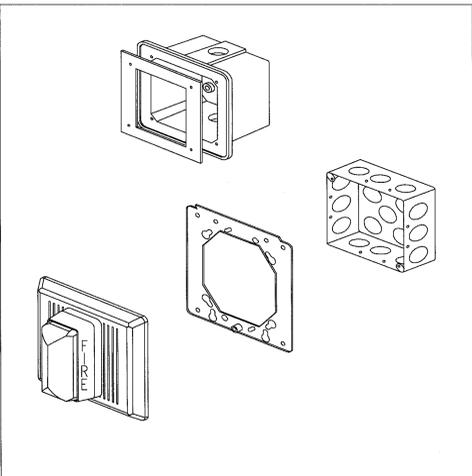


D1 HORN / STROBE MOUNTING DETAIL
NOT TO SCALE

MANUAL PULL STATIONS SHALL BE MOUNTED AT 48" A.F.F. PER ADA.

PROVIDE JUNCTION BOX (SIZE AS NEEDED FOR DEVICE) AND EMT CONDUIT (3/4" MINIMUM) BETWEEN DEVICES AND BACK TO FIRE ALARM CONTROL PANEL.

WALL MOUNTED NOTIFICATION APPLIANCES SHALL BE MOUNTED BETWEEN 80" AND 96" A.F.F. PER NFPA 72

CEILING MOUNTED SMOKE AND HEAT DETECTORS SHALL BE INSTALLED IN A CEILING MOUNTED JUNCTION BOX (SIZE AS NEEDED FOR DEVICE) AND SHALL BE LOCATED NO CLOSER THAN 4" TO ANY WALL.

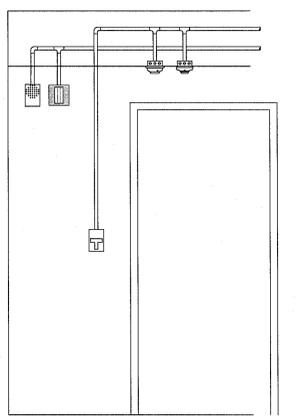

F1 FIRE ALARM DEVICE MOUNTING DETAIL
NOT TO SCALE

ABBREVIATIONS

A	AMP	MIC	MICROWAVE OR MICROPHONE
AC	ALTERNATING CURRENT	NC	NORMALLY CLOSED OR NURSE CALL
ADA	AMERICANS WITH DISABILITIES ACT	NEC	NATIONAL ELECTRICAL CODE
AFF	ABOVE FINISHED FLOOR	NFPA	NATIONAL FIRE PROTECTION ASSOCIATION
AFG	ABOVE FINISHED GRADE	NO	NORMALLY OPEN
AWG	AMERICAN WIRE GAUGE	NO.	NUMBER
BLDG	BUILDING	PA	PUBLIC ADDRESS
C	CONDUIT	PB	PUSH BUTTON
CLG	CEILING	PNL	PANEL
CH	CHANNEL	PVC	POLYVINYL CHLORIDE
CKT	CIRCUIT	REF	REFRIGERATOR
CL	CENTERLINE	RSC	RIGID STEEL CONDUIT
CMU	CONCRETE MASONRY UNIT	RTU	ROOF TOP UNIT
CONC	CONCRETE	SF	SUPPLY FAN
CONT'D	CONTINUED	SS	SOLID STATE
COR	CONTRACTING OFFICER'S REPRESENTATIVE	SWBD1	SWITCHBOARD, NUMBER AS INDICATED
CU	COPPER	TYP	TYPICAL
CUH	CABINET UNIT HEATER	TV	TELEVISION
DC	DIRECT CURRENT	UG	UNDERGROUND
DW	DISH WASHER	UL	UNDERWRITERS LABORATORIES
EC	ELECTRICAL CONTRACTOR	UPS	UNINTERRUPTIBLE POWER SUPPLY
EF	EXHAUST FAN	V	VOLT
EGC	EQUIPMENT GROUNDING CONDUCTOR	VA	DEPARTMENT OF VETERAN AFFAIRS
EOL	END OF LINE	VA	VOLT-AMPERE
EUH	ELECTRIC UNIT HEATER	VAMC	VA MEDICAL CENTER
EWC	ELECTRIC WATER COOLER	VOIP	VOICE OVER INTERNET PROTOCOL
FACP	FIRE ALARM CONTROL PANEL	W	WATT
GD	GARBAGE DISPOSAL	W/	WITH
GEC	GROUNDING ELECTRODE CONDUCTOR	WP	WEATHERPROOF
GFI	GROUND FAULT INTERRUPTER	WRG	WIRING
GND	GROUND	XFMR	TRANSFORMER
HP	HORSEPOWER	XP	EXPLOSION-PROOF
HZ	HERTZ	(R)	LOCATION OF RELOCATED DEVICE OR EQUIPMENT
JB	JUNCTION BOX	(RR)	REMOVE AND RELOCATE EXISTING DEVICE OR EQUIPMENT
KCMIL	THOUSAND CIRCULAR MIL	(RX)	REMOVE EXISTING DEVICE OR EQUIPMENT
KV	THOUSAND VOLTS (KILOVOLT)	(X)	EXISTING DEVICE OR EQUIPMENT TO REMAIN
KVA	THOUSAND VOLT-AMPS	(XR)	EXISTING DEVICE OR EQUIPMENT TO BE REMOVED AND REPLACED AT SAME LOCATION
KW	THOUSAND WATTS (KILOWATT)		
LED	LIGHT EMITTING DIODE		
LTG	LIGHTING		
MCC	MOTOR CONTROL CENTER		
MCCB	MOLDED CASE CIRCUIT BREAKER		
MCB	MAIN CIRCUIT BREAKER		
MH	MANHOLE		


GENERAL NOTES

- A. NOT ALL SYMBOLS INDICATED IN THE LEGEND, OR LISTED ABBREVIATIONS, APPEAR ON THE DRAWINGS. COORDINATE WORK ACCORDINGLY. COMPLY WITH SPECIFICATIONS AND NOTES BELOW AS APPLICABLE.
- B. ALL PENETRATIONS THROUGH FLOORS, RATED WALLS AND PARTITIONS SHALL BE SEALED WITH UL APPROVED FIRE SEALANT MATERIAL TO MAINTAIN FIRE AND/OR SMOKE RATING FOR THE SEPARATION. REFER TO SPECIFICATIONS.
- C. ALL CONDUITS, ENCLOSURES, CONDUIT BODIES AND THEIR COVERS CONTAINING FIRE ALARM SYSTEM CONDUCTORS SHALL BE PAINTED RED.
- D. PROVIDE WIRE MARKERS TO IDENTIFY CABLES FOR ALL SYSTEMS AT THE ORIGIN, PULL BOXES, AND TERMINATION POINTS. LABELS SHALL BE SELF ADHESIVE OR HEAT SHRINK TYPE. REFER TO SPECIFICATIONS.
- E. SOME WORK UNDER THIS CONTRACT WILL REQUIRE WORK DUTIES TO BE PERFORMED AFTER NORMAL WORKING HOURS. DETERMINATION OF SPECIFIC WORK DUTIES TO BE PERFORMED AFTER HOURS MUST BE MADE BY VA STAFF AT THEIR CONVENIENCE. POSSIBLE WORK REQUIRING AFTER HOURS APPROVAL INCLUDES: POWER OUTAGES AND DISRUPTION OF SERVICES, EXTREME NOISE AND/OR VIBRATION, CUTTING AND PATCHING OF CONCRETE, AND DELIVERIES OF EQUIPMENT.
- F. CARE SHOULD BE TAKEN BY ALL CONTRACTORS TO AVOID DAMAGING OR DISTURBING EXISTING CONSTRUCTION AND FINISHES. CONTRACTORS SHALL BE RESPONSIBLE FOR MAKING ANY REPAIRS NECESSARY TO RECTIFY DAMAGE AND RESTORE EXISTING CONSTRUCTION AND FINISHES TO UNDAMAGED STATE UPON COMPLETION OF WORK AT NO EXPENSE TO THE VA. REPAIR OR REPLACE AND REFINISH, TO THE SATISFACTION OF THE VA, ANY CEILING, FLOOR, OR WALL SURFACES OR STRUCTURES THAT MAY BE DAMAGED IN THE PROCESS OF WORK.
- G. REFER TO SHEET FA001 FOR LEGEND, ABBREVIATIONS, AND GENERAL NOTES.
- H. PROVIDE NEW FIRE ALARM SYSTEM AS INDICATED, REFER TO FLOOR PLAN FOR LOCATIONS OF DEVICES, REFER TO FIRE ALARM MATRIX SUMMARY FOR ADDITIONAL INFORMATION.
- I. PROVIDE SUFFICIENT COMMUNICATION LOOP CIRCUITS TO SERVE MAXIMUM NUMBER OF ADDRESSES RECOMMENDED BY FIRE ALARM SYSTEM MANUFACTURER PLAN AN ADDITIONAL 50%.
- J. REFER TO FIRE ALARM PLANS FOR LOCATIONS.
- K. NOT ALL SYMBOLS INDICATED IN THE LEGEND, OR LISTED ABBREVIATIONS, APPEAR ON THE DRAWINGS. COORDINATE WORK ACCORDINGLY. COMPLY WITH SPECIFICATIONS AND NOTES BELOW AS APPLICABLE.
- L. DASHED SYMBOLS INDICATE ITEMS THAT ARE BEING COMPLETELY REMOVED.
- M. ALL DEMOLITION WORK SHALL COMPLY WITH MEDICAL CENTER REQUIREMENTS AND PROCEDURES.
- N. UNLESS NOTED, OR OTHERWISE SHOWN OR SPECIFIED, ALL MATERIALS AND EQUIPMENT REMOVED OR DEMOLISHED (EXCEPT THAT WHICH IS TO BE SALVAGED OR RELOCATED) AS DIRECTED BY DRAWINGS AND SPECIFICATIONS SHALL BECOME THE PROPERTY OF THE CONTRACTOR AND SHALL BE DISPOSED OF LEGALLY.

LIFE SAFETY LINE TYPES

- ◆— FIRE RESISTIVE RATED LINE, 1 HOUR
- ◆◆— FIRE RESISTIVE RATED LINE, 2 HOUR
- ◆—S— FIRE-RATED, SMOKE BARRIER LINE, 1 HOUR
- ◆—S— FIRE-RATED, SMOKE BARRIER LINE, 2 HOUR
- ◆—30— FIRE-RATED, SMOKE BARRIER LINE, 30 MIN
- ◆—SR— NON-RATED, SUITE LINE, (SMOKE RESISTIVE)
- ◆—SR— NON-RATED SMOKE RESISTIVE


NOTE: ALL SYMBOLS MAY NOT BE USED

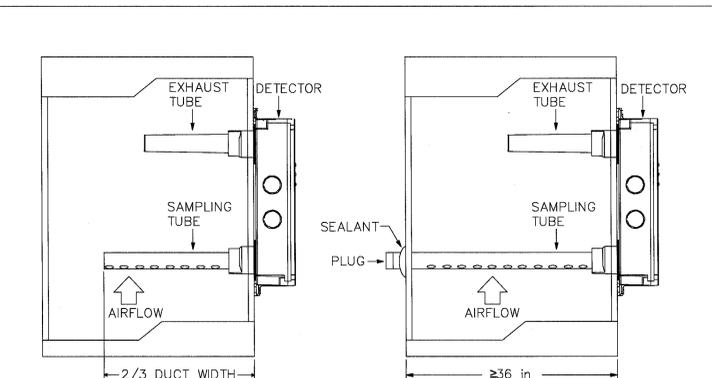

DUCT SMOKE DETECTORS SHALL BE MOUNTED SO THAT THE SAMPLE TUBE IS POSITIONED 6 TO 10 DUCT-WIDTHS FROM ANY BEND OR OBSTRUCTION.

SAMPLING TUBE SHALL EXTEND NO LESS THAN TWO-THIRDS OF THE WAY INTO THE DUCT, AND SHALL BE SUPPORTED ON BOTH ENDS IN DUCTS WITH A WIDTH GREATER THAN 36 INCHES.

PROVIDE EMT CONDUIT (3/4" MINIMUM) BACK TO FIRE ALARM CONTROL PANEL.

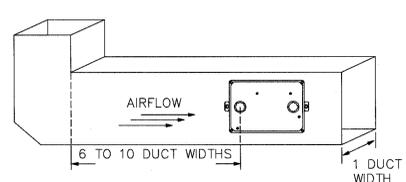

F4 DUCT SMOKE DETECTOR INSTALLATION DETAIL
NOT TO SCALE

CONSULTANTS:

ARCHITECT/ENGINEERS:



Drawing Title FIRE ALARM LEGEND, GENERAL NOTES, AND ABBREVIATIONS	
Approved Project Director	Control Number VA256-13-C-0277
PO Number 635-C35336	Checked WLM
	Drawn MMF

Project Title REMODEL CARDIAC CATH LAB SUITE	Project Number 635-CS1-102
Location OKLAHOMA CITY VAMC 921 N.E. 57TH STREET, OKLAHOMA CITY, OK 73104	Building Number F
Date 05-21-2015	Drawn Number FA001


**FULLY SPRINKLERED
BID DOCUMENTS
FOR CONSTRUCTION**

**Office of
Construction
and Facilities
Management**



REFERENCE NOTES

REFER TO SHEER ED101 FOR DEMOLITION WORK ON FIRST FLOOR.
 REFER TO SHEET EL101 FOR LIGHTING WORK ON FIRST FLOOR.
 REFER TO SHEETS EP101-A, EP101-B, AND EP102 FOR POWER WORK ON FIRST FLOOR.
 REFER TO SHEET EP103 FOR POWER WORK AT BASEMENT LEVEL.
 REFER TO SHEET EM101 FOR MECHANICAL EQUIPMENT POWER WORK ON FIRST FLOOR.
 REFER TO SHEET EM102 FOR MECHANICAL EQUIPMENT POWER WORK ON THIRD FLOOR.
 REFER TO SHEETS ET101 AND ET102 FOR TELECOMMUNICATIONS WORK ON FIRST FLOOR.
 REFER TO SHEET EY101 FOR SYSTEMS WORK ON FIRST FLOOR.

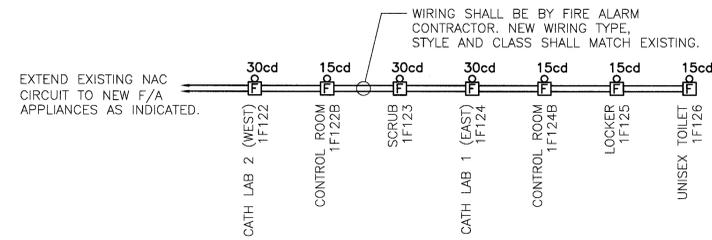

A5 FIRE ALARM WIRING DIAGRAM
NO SCALE

GENERAL FIRE ALARM PLAN NOTES

- A. REFER TO SHEET 58.E-001 FOR LEGEND, ABBREVIATIONS, SCHEDULES AND GENERAL NOTES.
- B. THE ELECTRICAL CONTRACTOR SHALL PROVIDE JUNCTION BOX AT EACH FIRE ALARM DEVICE AND ROUTE 3/4 INCH EMPTY CONDUIT TO FIRE ALARM DEVICES AS INDICATED ON FIRE ALARM WIRING DIAGRAM THIS DRAWING.
- B. THE FIRE ALARM CONTRACTOR SHALL EXTEND EXISTING FIRE ALARM LOOP TO INCLUDE FIRE ALARM APPLIANCE DEVICES INDICATED, SEE FIRE ALARM WIRING DIAGRAM THIS DRAWING FOR ADDITIONAL INFORMATION.
- C. THE FIRE ALARM CONTRACTOR SHALL PROVIDE FINISH COVER PLATE AT EACH FIRE ALARM DEVICE.
- D. THE FIRE ALARM CONTRACTOR SHALL INCLUDE IN BID PROGRAMMING OF THE EXISTING FACP TO ACCOMMODATE NEW FA DEVICES.
- E. THE FIRE ALARM CONTRACTOR SHALL PROVIDE NEW FIRE ALARM CABLING AS INDICATED, NEW FIRE ALARM CABLE SHALL MATCH INSULATION, TYPE AND CLASS OF THE EXISTING FIRE ALARM SYSTEM.
- F. THE FIRE ALARM CONTRACTOR SHALL ROUTE FIRE ALARM WIRING IN CONDUIT ONLY, NOTHING ELSE SHALL BE INSIDE OF CONDUIT SYSTEM.
- G. THE FIRE ALARM CONTRACTOR SHALL FURNISH FULLY ENGINEERED SHOP DRAWINGS OF THE FIRE ALARM SYSTEM PRIOR TO BEGINNING CONSTRUCTION. THE SHOP DRAWING SUBMITTALS SHALL BE SIGNED BY SFPE (SAFETY FIRE PROTECTION ENGINEER).


FIRE ALARM PLAN LEGEND

- F** FIRE ALARM PULL STATION. MOUNTED 48" AFF TO CENTERLINE OF STATION.
- 15cd** AUDIO/VISUAL ALARM. NUMBER INDICATES CANDELA RATING OF STROBE. COMBINATION SPEAKER WITH ADJUSTABLE CANDELA STROBE LIGHT. WALL MOUNTED 90" AFF TO TOP. CEILING MOUNT WHERE INDICATED. 'WP' INDICATES WEATHERPROOF UNIT.
- 15cd** VISUAL ALARM. NUMBER INDICATES CANDELA RATING OF STROBE. ADJUSTABLE CANDELA STROBE LIGHT. WALL MOUNTED 90" AFF TO TOP. CEILING MOUNT WHERE INDICATED. REFER TO SPECIAL REQUIREMENTS IN SLEEPING AREAS. 'NS' INDICATES NON-SUPERVISED 120 VOLT REMOTE VISUAL SIGNAL, 177 CANDELA, CONNECTED TO NON-SUPERVISED SMOKE DETECTOR.
- SFS** SPRINKLER FLOW SWITCH
- SIS** SPRINKLER TAMPER SWITCH
- MM** MONITOR MODULE
- S** SMOKE DETECTOR
- DH** DOOR HOLDER
- D_S** DUCT SMOKE DETECTOR
'S' INDICATES LOCATED IN SUPPLY PLENUM
'R' INDICATES LOCATED IN RETURN PLENUM
- T** TEST STATION FOR DUCT SMOKE DETECTOR


LIFE SAFETY LINE LEGEND

- ◆— FIRE RESISTIVE RATED LINE, 1 HOUR
- ◆◆— FIRE RESISTIVE RATED LINE, 2 HOUR
- ◆—S— FIRE-RATED, SMOKE BARRIER LINE, 1 HOUR
- ◆◆—S— FIRE-RATED, SMOKE BARRIER LINE, 2 HOUR
- ◆—30— FIRE-RATED, SMOKE BARRIER LINE, 30 MIN
- ◆—NS— NON-RATED, SUITE LINE, (SMOKE RESISTIVE)
- ◆—SR— NON-RATED SMOKE RESISTIVE

NOTE: ALL SYMBOLS MAY NOT BE USED

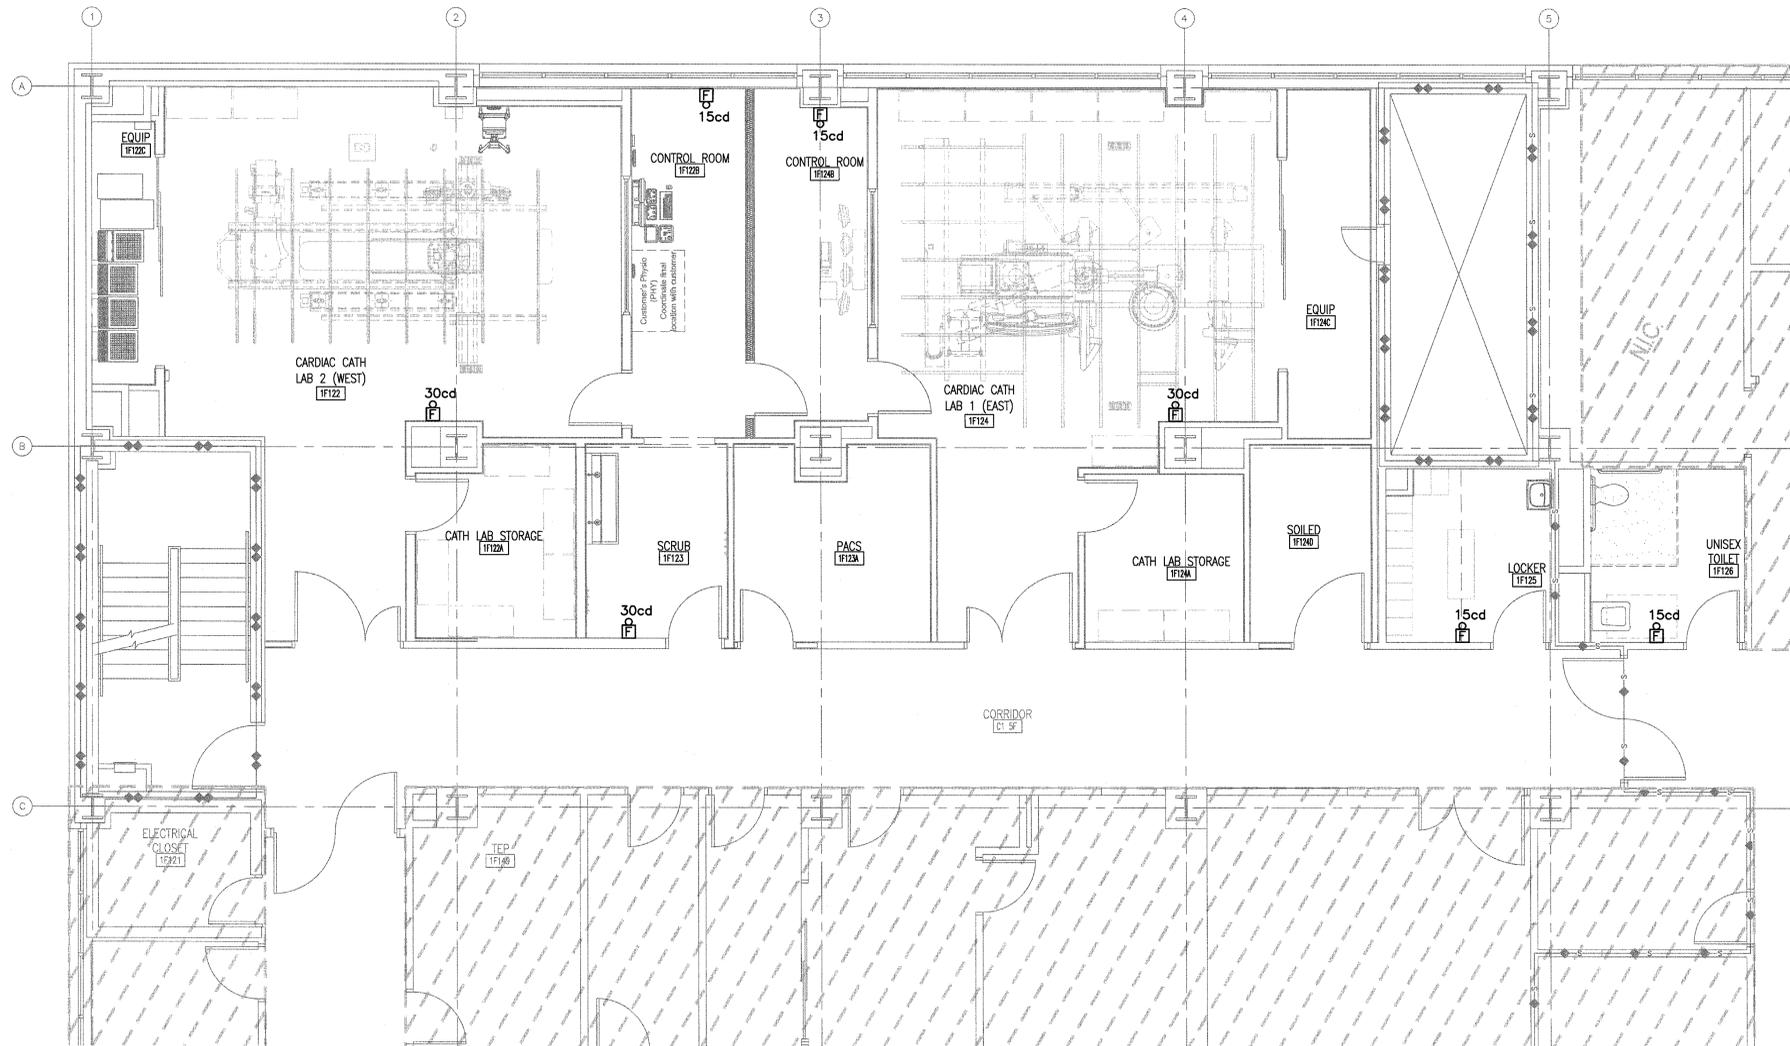

F1 PARTIAL FIRST FLOOR PLAN
SCALE 1/4" = 1'-0"

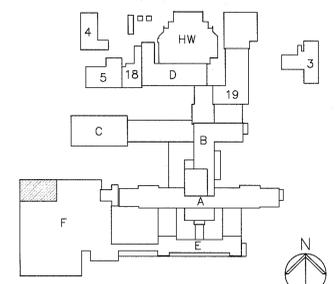

KEY PLAN - FIRST FLOOR
NTS

FULLY SPRINKLERED
BID DOCUMENTS
FOR CONSTRUCTION

Office of
Construction
and Facilities
Management



Revisions: _____ Date: _____	CONSULTANTS: _____	ARCHITECT/ENGINEERS: PARADIGM ENGINEERS AND CONSTRUCTORS 200 Envoy Circle #201, Louisville KY 40299 - PH: 502.339.8511 - www.paradigmusa.com		Drawing Title FIRE ALARM PLAN FIRST FLOOR	Project Title REMODEL CARDIAC CATH LAB SUITE	Project Number 635-CS1-102	Office of Construction and Facilities Management	
				Approved Project Director Control Number VA256-13-C-0277	Location OKLAHOMA CITY VAMC 821 N.E. 67TH STREET, OKLAHOMA CITY, OK 73104	Building Number F		Drawing Number FA101
				PO Number 635-C35336	Date 05-21-2015	Checked WLM	Drawn MMF	

FIRE PROTECTION PLAN TAG NOTES (1)


1. ADD/RELOCATE EXISTING SPRINKLERS AND PIPING AS NECESSARY FOR REMODEL.

GENERAL FIRE PROTECTION NOTES


- A. REFER TO DRAWING M001 FOR LEGEND, ABBREVIATIONS, AND GENERAL NOTES RELATED TO THIS SHEET.
- B. ALL EXISTING PIPING, DUCTWORK, SPRINKLERS, CONDUIT, LIGHTING OR OTHER CONSTRUCTION SHALL BE RELOCATED AS NECESSARY FOR ALL DEMOLITION AND INSTALLATION WORK.
- C. DESIGN DRAWINGS ARE DIAGRAMMATIC AND APPROXIMATE, ONLY FOR PIPE SIZING, GENERAL ROUTING, LAYOUT AND BASIC SYSTEM CONFIGURATION.
- D. THE CONTRACTOR SHALL PROVIDE A COMPLETE SHOP DRAWING SUBMITTAL INCLUDING ALL INFORMATION REQUIRED BY NFPA 13, SECTION 22.1.3 (2013 EDITION).
- E. THE CONTRACTOR SHALL FIELD VERIFY ALL PIPE ROUTING PRIOR TO SUBMITTAL OF SHOP DRAWINGS OR COMMENCING SYSTEM FABRICATION.
- F. THE CONTRACTOR IS TO PROVIDE A COMPLETE AS-BUILT DRAWING SUBMITTAL, INCLUDING ALL PIPE LENGTHS, ELEVATIONS, HANGER LOCATIONS, HANGER DETAILS, AND OFFSETS AS COORDINATED WITH THE BUILDING STRUCTURE AND OTHER BUILDING TRADES. THE AS-BUILT DRAWINGS SHALL BE ±0'-6".
- G. ANY MATERIALS AND ACCESSORIES NECESSARY SHALL BE INSTALLED IN ACCORDANCE WITH NFPA 13 (2013 EDITION).
- H. PIPING SHALL BE RUN ON A LEVEL HORIZONTAL PLANE. IF TRAPPED PIPING OVER 5 GALLONS OCCURS, A MINIMUM OF A 3/4" BALL VALVE SHALL BE PROVIDED.
- I. ALL SYSTEMS SHALL BE DESIGNED AND INSTALLED IN ACCORDANCE WITH THE PROVISIONS PUT FORTH BY NFPA 13 (2013 EDITION), THE VA DESIGN STANDARDS, THE PROJECT TECHNICAL SPECIFICATIONS, AND ALL APPLICABLE LOCAL AND STATE LAWS AND REGULATIONS.
- J. ALL ABOVE GROUND PIPING 2-1/2" AND LARGER SHALL BE SCHEDULE 10 BLACK STEEL WITH ROLL GROOVED ENDS AND GROOVED FITTINGS UNLESS NOTED OTHERWISE.
- K. ALL ABOVE GROUND PIPING 2" AND SMALLER SHALL BE SCHEDULE 40 WITH THREADED CAST IRON FITTINGS.
- L. ALL SPRINKLERS SHALL BE NEW UL LISTED, FM APPROVED, QUICK RESPONSE, SEMI-RECESSED, CHROME FINISH, UNLESS NOTED OTHERWISE. REFERENCE SPECIFICATIONS FOR SPECIFIC SPRINKLER APPLICATIONS AND TEMPERATURES.
- M. ALL CONTROL VALVES SHALL BE SUPERVISED BY THE BUILDING FIRE ALARM SYSTEM.
- N. ALL VALVES (DRAINS, INSPECTOR'S TEST, CONTROL) SHALL BE IDENTIFIED AS REQUIRED BY NFPA 13 (2013 EDITION).
- O. ALL VALVES AND WATER FLOW SWITCHES SHALL BE LOCATED IN ACCESSIBLE LOCATIONS.
- P. SPRINKLER PROTECTION SHALL BE PROVIDED BENEATH ALL CONTINUOUS OBSTRUCTIONS 4'-0" AND GREATER IN WIDTH AS REQUIRED BY NFPA 13 (2013 EDITION).
- Q. SOME WORK UNDER THIS CONTRACT WILL REQUIRE WORK DUTIES TO BE PERFORMED AFTER NORMAL WORKING HOURS. DETERMINATION OF SPECIFIC WORK DUTIES TO BE PERFORMED AFTER HOURS SHALL BE MADE BY VA STAFF AT THEIR CONVENIENCE. POSSIBLE WORK REQUIRING AFTER HOURS APPROVAL INCLUDES, BUT IS NOT LIMITED TO: POWER OUTAGES AND DISRUPTION OF SERVICES, EXTREME NOISE AND/OR VIBRATION, CUTTING AND PATCHING OF CONCRETE, AND DELIVERIES OF EQUIPMENT.
- R. FIRE ALARM SYSTEM SHALL REMAIN IN OPERATION THROUGHOUT PERIOD OF WORK. THE FIRE PROTECTION CONTRACTOR SHALL ENSURE THAT NO DAMAGE IS DONE TO THE EXISTING SPRINKLER SYSTEM - I.E. PROTECTIVE CAGES SHALL BE INSTALLED OVER SPRINKLER HEADS DURING RENOVATION, ETC.

LEGEND

-  ORDINARY HAZARD GROUP 1
-  ORDINARY HAZARD GROUP 2
-  ALL AREAS NOT HATCHED ARE LIGHT HAZARD

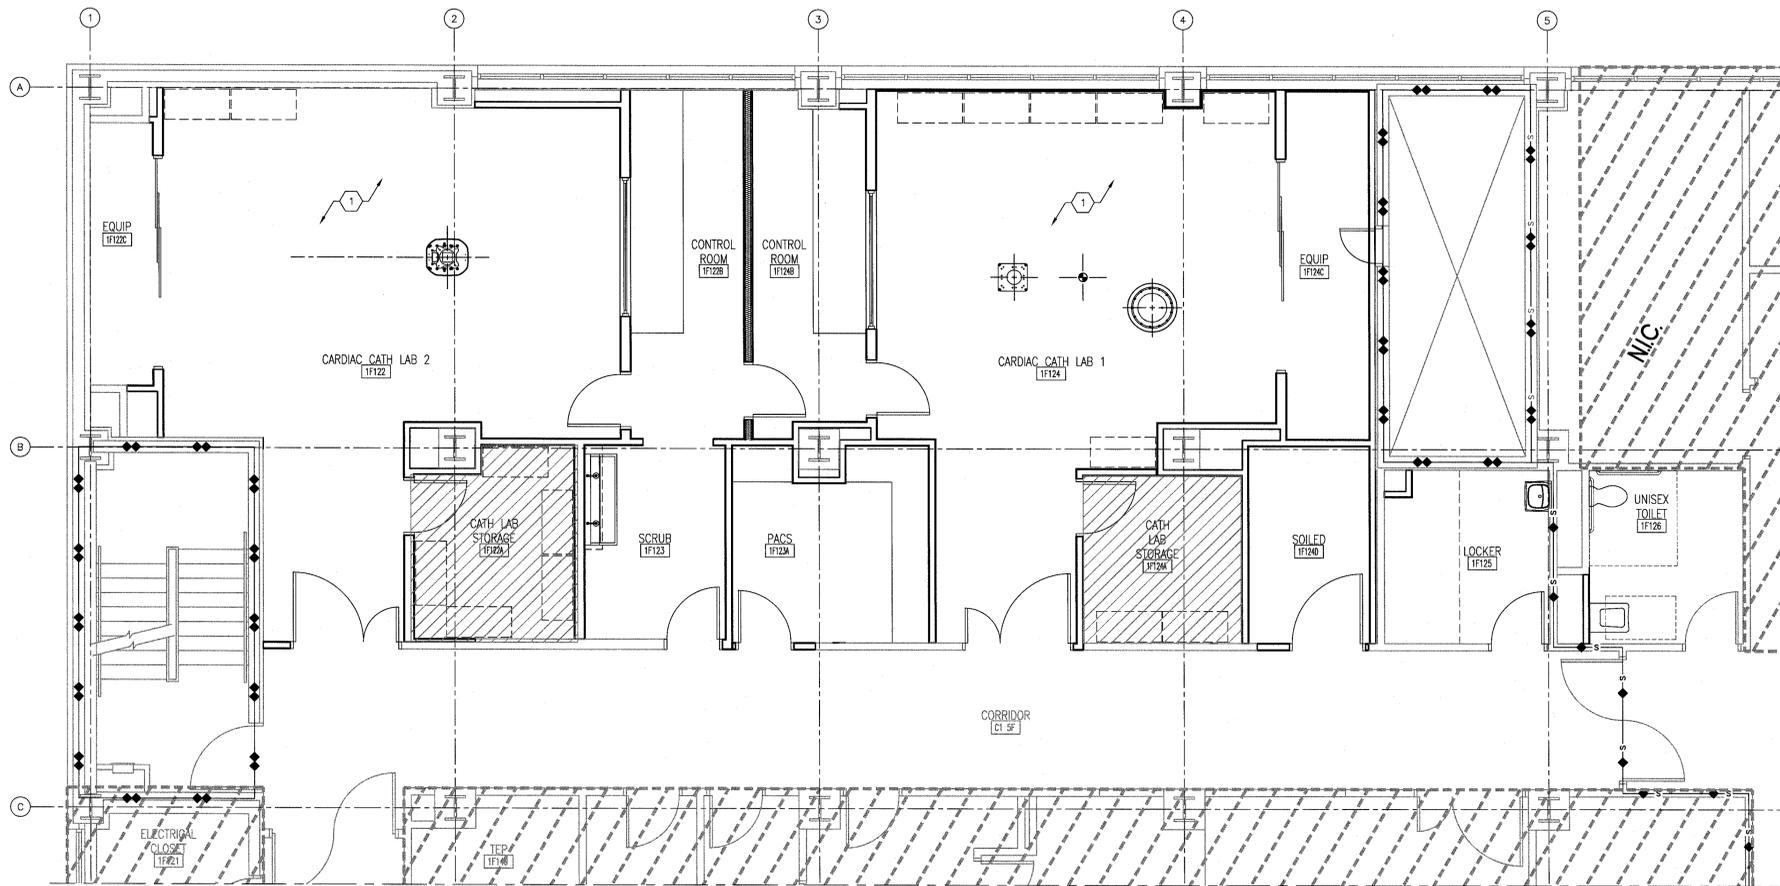


1 FIRST FLOOR FIRE PROTECTION PLAN
1/4" = 1'-0"

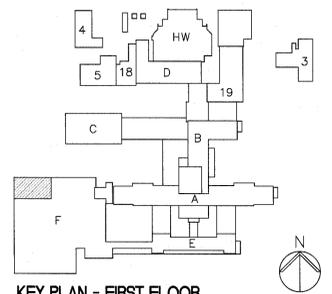

KEY PLAN - FIRST FLOOR
N.T.S.

**FULLY SPRINKLED
BID DOCUMENTS
FOR CONSTRUCTION**

**Office of
Construction
and Facilities
Management**



CONSULTANTS: 		ARCHITECT/ENGINEERS:  200 Envoy Circle #201, Louisville KY 40299 - PH: 502.339.8511 - www.paradigmusa.com		Drawing Title FIRST FLOOR FIRE PROTECTION PLAN		Project Title REMODEL CARDIAC CATH LAB SUITE		Project Number 635-CS1-102		Building Number 1	
Approved Project Director		Control Number VA256-13-C-0277		Location OKLAHOMA CITY VAMC 921 N.E. 10TH STREET, OKLAHOMA CITY, OK 73104		Date 05-21-2015		Checked WRW		Drawn BLM	
PO Number 635-C35336		Drawing Number FX101		Department of Veterans Affairs							