

Room No.	Mixing Valve/Room Schedule	
	Sinks	Stops
3A-118	1	2
3A-133	1	2
3B-103	1	2
3B-107	1	2
3B-133	1	2
3B-136	1	2
3B-141	1	2
3B-142	1	2

\* - See Drawing PL-108 for Installation Diagram



### THIRD FLOOR PLAN Building 1

#### General Notes :

- All water outages must be scheduled in advance with COR.
- It is the contractor's responsibility to repair or replace any property damaged by the contractor during construction.
- Contractor shall supply VA with a schedule.
- It is the Contractor's responsibility to verify all Faucet types to determined which type of mixing valve is required.
- Contractor is to verify and supply under this contract type of adapter needed to connect stop to existing supply pipe.
- A two week notice is required for any water shut down.
- All plumbing installation is to be done by licensed certified plumbers.
- If any Asbestos is found, the contractor is to stop work and notify the COR immediately.

#### Demolition Notes :


- Any piping, valves, etc. removed shall be recycled in a VA provided container. See COR for location of recycling container.

#### New Work Notes :

- Contractor to repair any damage to finishes after valves have been installed. Finishes to match existing.
- Contractor to clean room and advise COR before proceeding to next Room.
- Contractor to install 1 mixing valve and 2 stops to all sinks indicated in mixing valve/room schedule on this sheet.

#### Legend:

- ⊖ Sink with new mixing valve and 2 - stops.

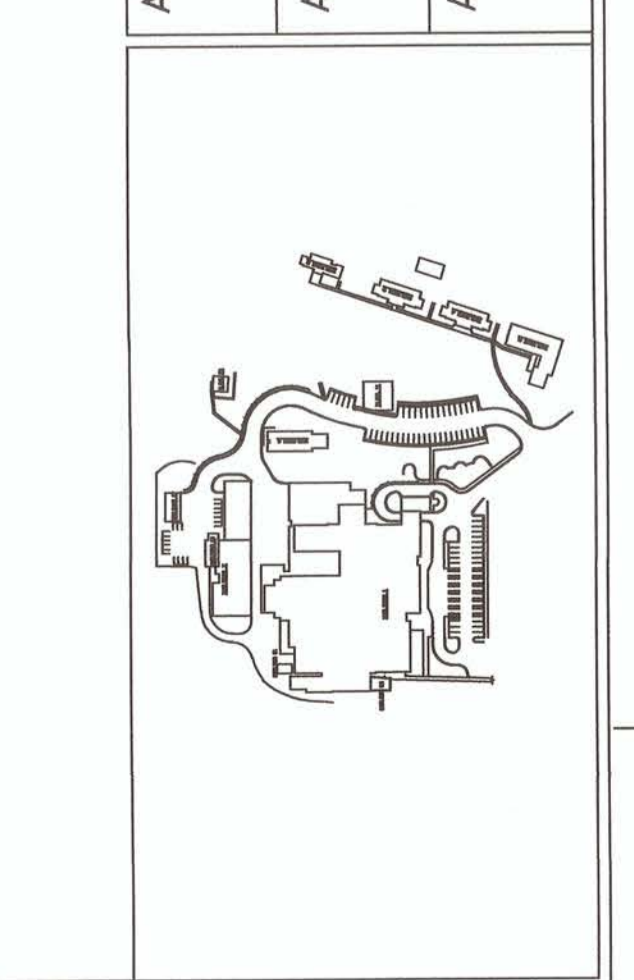

APPROVED:

APPROVED:

APPROVED:

APPROVED:

APPROVED:

APPROVED:

APPROVED:

DRAWING No.  
PL-104  
 PROJECT No.  
517-17-101  
 DRAWN BY:  
JPP  
 CHECKED BY:  
KB, JH

NOT TO SCALE

Medical Center  
 200 Veterans Av  
 Beckley, WV. 25801

DRAWING TITLE:  
Third Floor - Mixing Valve  
Installation Locations  
 PROJECT TITLE:  
Correct Water System for  
Legionella Phase 2  
 DATE  
8/16/2017  
 REV.  
SCALE  
NTS

APPROVED: MEDICAL CENTER DIRECTOR  
 STACY J. VASQUEZ  
 APPROVED: ASSOCIATE DIRECTOR  
 JOHN D. STOUT  
 APPROVED: CHIEF OF STAFF  
 JOHN D. BERRYMAN, M. D.

APPROVED: CHIEF, FACILITIES MANAGEMENT SERVICE LINE  
 JOHN MONTGOMERY  
 APPROVED: ASSOCIATE DIRECTOR FOR PATIENT CARE  
 SERVICES/EXECUTIVE NURSE  
 DEBRA LEGG, RN, MSN  
 APPROVED: SERVICE LINE CHIEF

APPROVED: SAFETY MANAGER  
 JUSTIN GREENE  
 APPROVED: INFECTION CONTROL

APPROVED:

APPROVED:

APPROVED:

APPROVED:

APPROVED: