


Mixing Valve/Room Schedule		
Room No.	Sinks	Mixing Valves
6AB-104	1	1
6B-112	1	2

* - See Drawing PL-108 for Installation Diagram

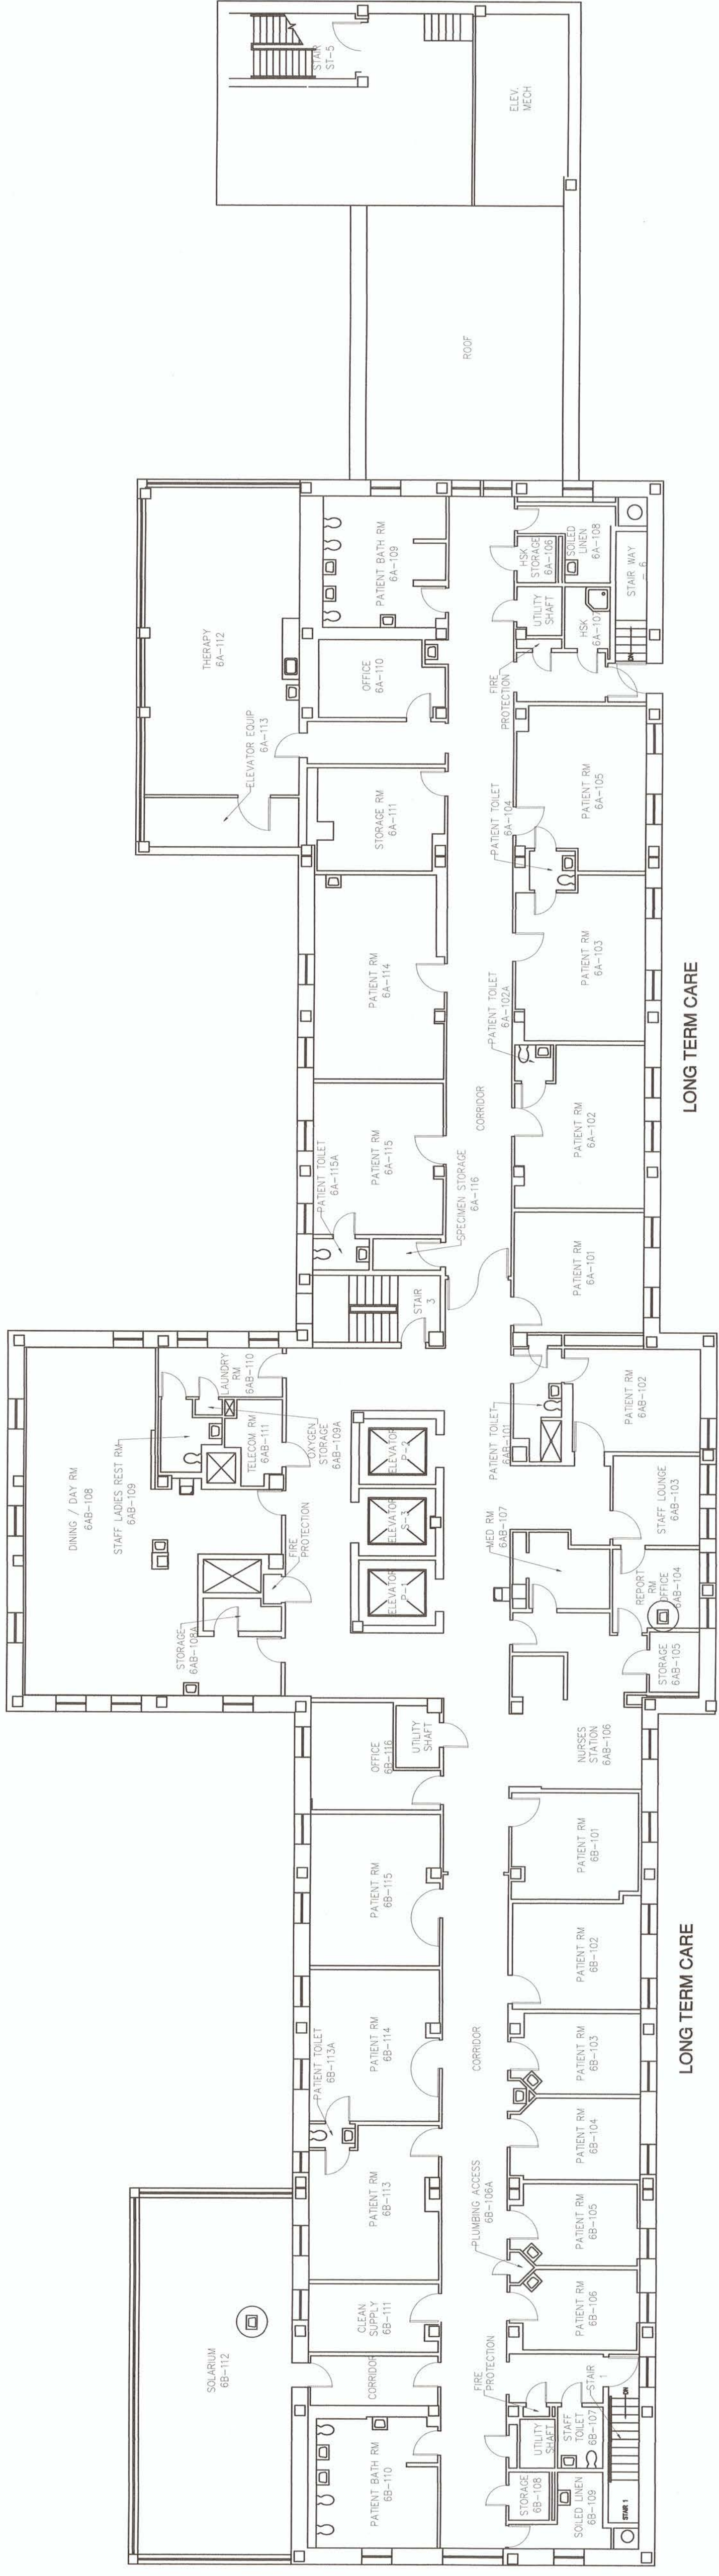

Sixth Floor Building 1

General Notes :

- All water outages must be scheduled in advance with COR.
- It is the contractor's responsibility to repair or replace any property damaged by the contractor during construction.
- Contractor shall supply VA with a schedule.
- It is the Contractor's responsibility to verify all Faucet types to be determined which type of mixing valve is required.
- Contractor is to verify and supply under this contract type of adapter needed to connect stop to existing supply pipe.
- A two week notice is required for any water shut down.
- All plumbing installation is to be done by licensed certified plumbers.
- If any Asbestos is found, the contractor is to stop work and notify the COR immediately.

Demolition Notes :


- Any piping, valves, etc. removed shall be recycled in a VA provided container. See COR for location of recycling container.

New Work Notes :

- Contractor to repair any damage to finishes after valves have been installed. Finishes to match existing.
- Contractor to clean room and advise COR before proceeding to next Room.
- Contractor to install 1 mixing valve and 2 stops to all sinks indicated in mixing valve/room schedule on this sheet.

Legend:

- Ⓢ Sink with new mixing valve and 2 - stops.

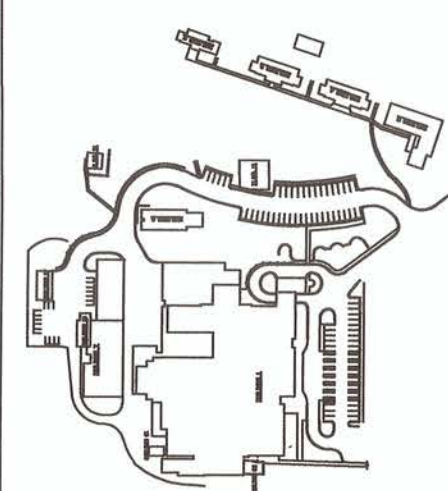

APPROVED:

JUSTIN GREENE
APPROVED: INFECTION CONTROL

APPROVED:

APPROVED:

APPROVED:

APPROVED:

APPROVED:

APPROVED:

APPROVED: MEDICAL CENTER DIRECTOR

STACY J. VASQUEZ
APPROVED: ASSOCIATE DIRECTOR

APPROVED:

APPROVED:

DRAWING TITLE:

Sixth Floor - Mixing Valve

INSTALLATION LOCATIONS

PROJECT TITLE:

Correct Water System for

Legionella Phase 2

DATE

8/16/2017

REV.

SCALE

NTS

DRAWING No.

PL-107

PROJECT No.

517-17-101

DRAWN BY:

JPP

CHECKED BY:

KB, JH

NOT TO SCALE

PULITING VETERANS FIRST
Medical Center Av
200 Veterans Av
Beckley, WV. 25801