

**General Notes :**

1. All water outages must be scheduled in advance with COR.
2. It is the contractors responsibility to repair or replace any property damaged by the contractor during construction.
3. Contractor shall supply VA with a schedule.
4. A two week notice is required for any water shut down.
5. All plumbing installation is to be done by licensed certified plumbers.
6. Contractor required to give VA 1 week notice before doing any work in room 1B-112B. to allow VA time to move office equipment.
7. If any Asbestos is found, the contractor is to stop work and notify the COR immediately.

**Demolition Notes :**

- ① Any piping, valves, etc. demoed shall be recycled in a VA provided container. See COR for location of recycling container.

**New Work Notes :**


- Ⓐ Contractor to repair any damage to finishes after valves and piping have been installed. Finishes to match existing.
- Ⓑ Contractor to clean room and advise COR before proceeding to next Room.
- Ⓒ All new piping and valves to be installed per specs.
- Ⓓ New ball valves installed in room BB-103 (Building 1) and room B-111 (building 35) are to be locked in the closed position to prevent accidental opening and to prevent stagnant water in lines.
- Ⓔ All connections on 2" copper lines are to be prepressed or soldered. There are to be no threaded connections.

**Legend:**


- COLD WATER (NO NUMBER INDICATES 120°F TEMP SYSTEM) -----CWS-----
- HOT WATER (NUMBER DENOTES TEMPERATURE) -----HWS 120°-----
- HOT WATER RETURN (NUMBER DENOTES TEMPERATURE) -----HWR 120°-----

● POINT OF CONNECTION


**FIRST FLOOR  
Building 35**

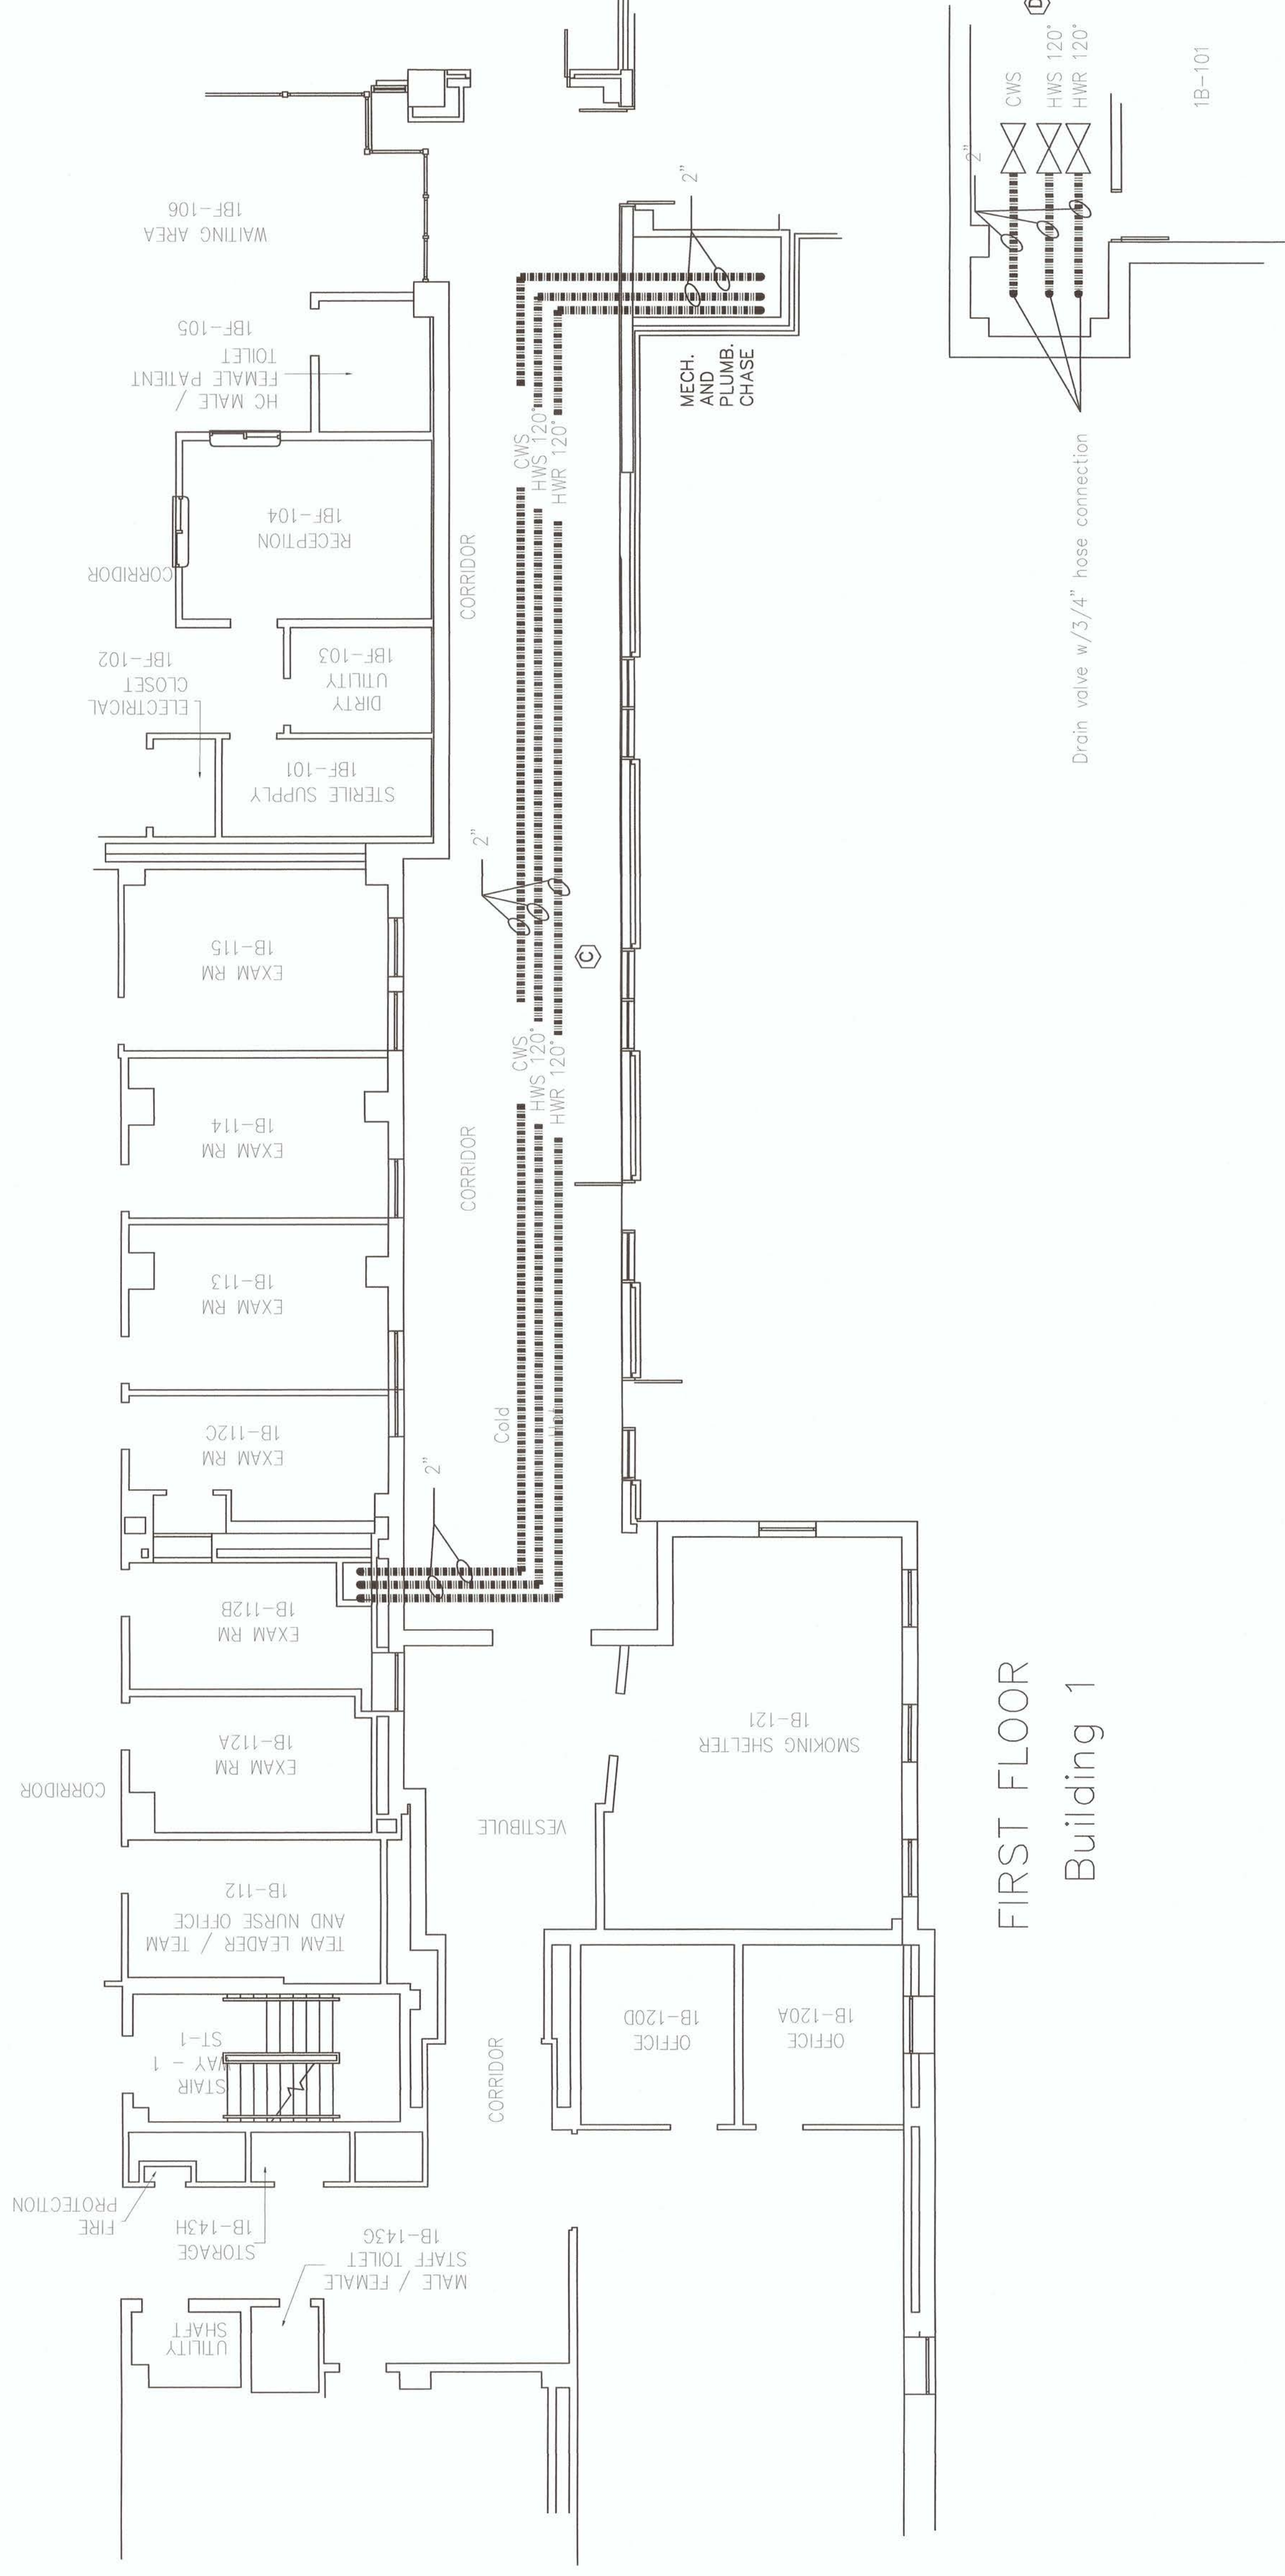

**FIRST FLOOR  
Building 1**

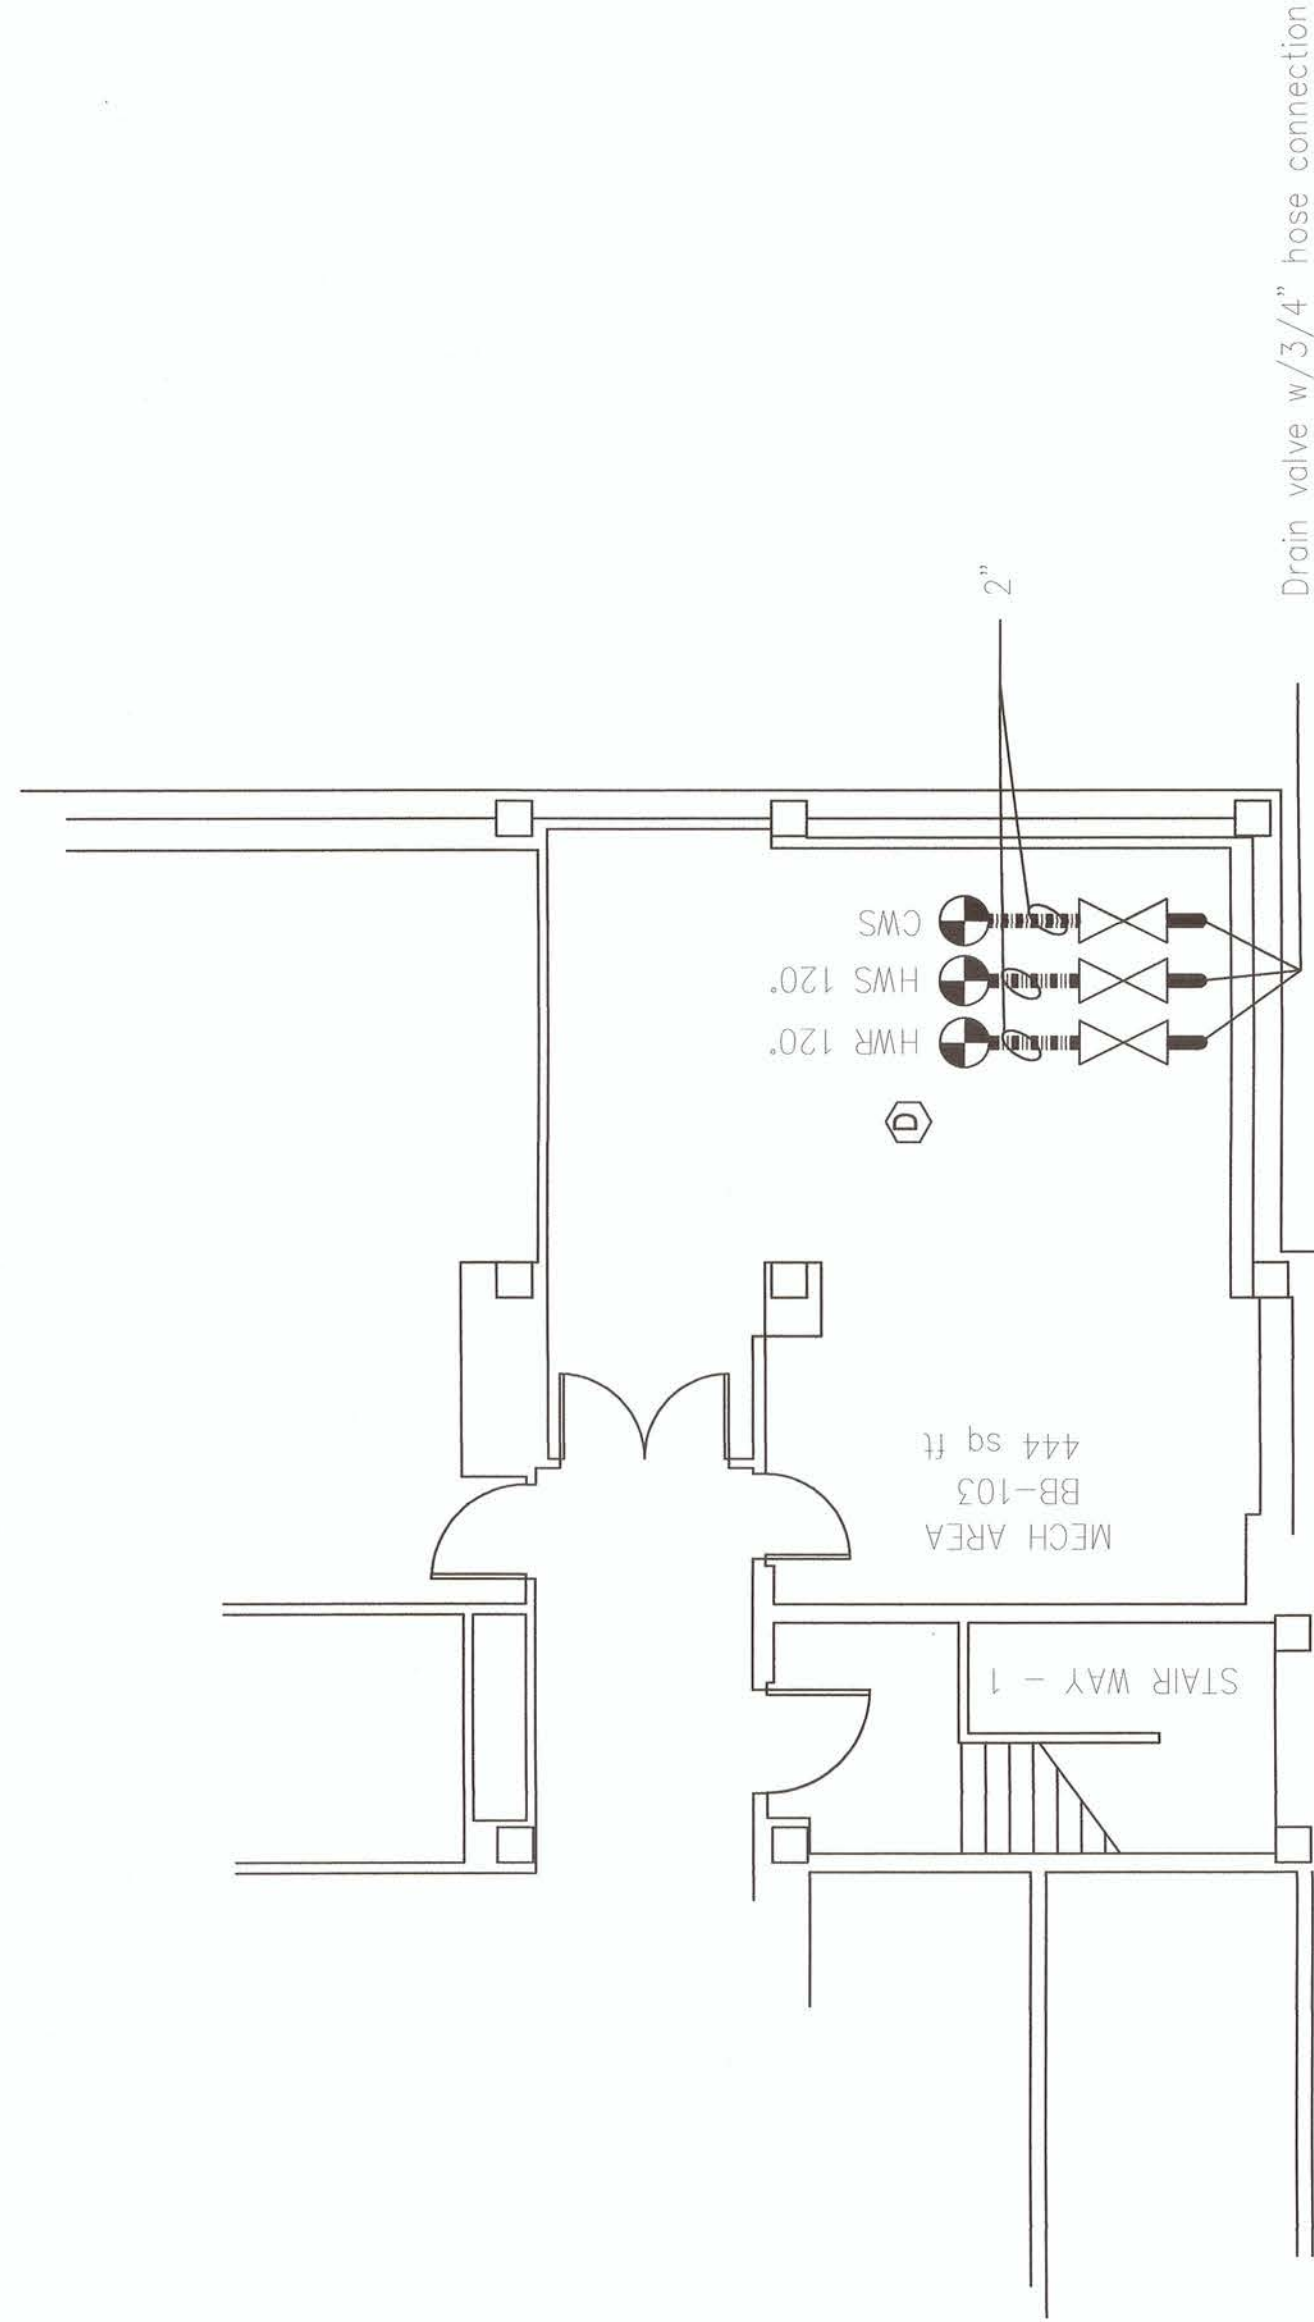

**BASEMENT  
Building 1**

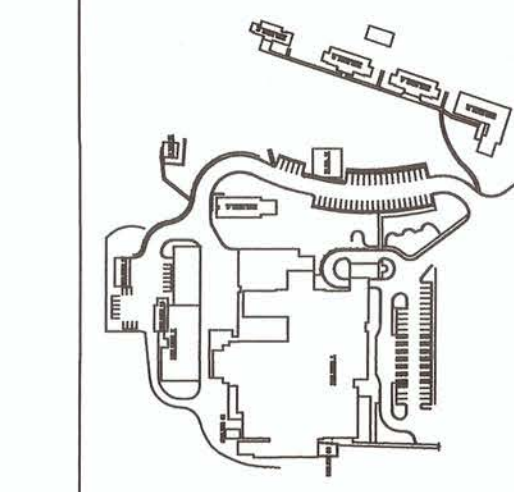

NOT TO SCALE



Medical Center  
200 Veterans Av  
Beckley, WV. 25801

DRAWING No. PL-110	DRAWING TITLE: New hot & cold water supply to building 35 basement
PROJECT No. 517-17-101	PROJECT TITLE: Correct Water System for Legionella Phase 2
DRAWN BY: JPP	DATE 9/20/17
CHECKED BY: KB, JH	SCALE N/A

APPROVED: MEDICAL CENTER DIRECTOR STACY J. VASQUEZ	APPROVED: CHIEF, FACILITIES MANAGEMENT SERVICE LINE JOHN MONTGOMERY
APPROVED: ASSOCIATE DIRECTOR JOHN D. STOUT	APPROVED: ASSOCIATE DIRECTOR for PATIENT CARE SERVICES/EXECUTIVE NURSE DEBRA LEGG, RN, MSN
APPROVED: CHIEF OF STAFF	APPROVED: SERVICE LINE CHIEF

APPROVED: SAFETY MANAGER JUSTIN GREENE	APPROVED: INFECTION CONTROL
APPROVED: INFECTION CONTROL	APPROVED:

APPROVED:	APPROVED:
APPROVED:	APPROVED:

APPROVED:	APPROVED:
APPROVED:	APPROVED:

APPROVED:	APPROVED:
APPROVED:	APPROVED: