

---

**SPECIFICATIONS (VOL.2)**  
**100% BID DOCUMENTS**

---

**CORRECT LIFE SAFETY DEFICIENCIES**

IOWA CITY VA HEALTH CARE SYSTEM  
IOWA CITY, IOWA

PROJECT NO: 636A8-16-006



19 SEPTEMBER 2017






**Correct Life Safety Deficiencies  
Project No. 636A8-16-006  
100% Bid Documents**

19 September 2017

**Prepared By:**  
Neal Suntken  
Kenneth Hahn Architects 1343 South 75<sup>th</sup> Street  
Omaha, NE 68124



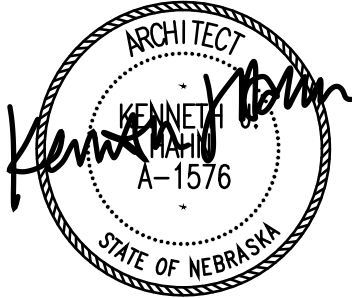


9/19/17

I hereby certify that this specification was prepared by me or under my direct personal supervision and that I am a duly licensed Architect under the laws of the State of Nebraska.

Specification Divisions/Sections covered by this seal:

02 41 00, 4, 6, 7, 8, 9, 10, 12 AND 33 46 13

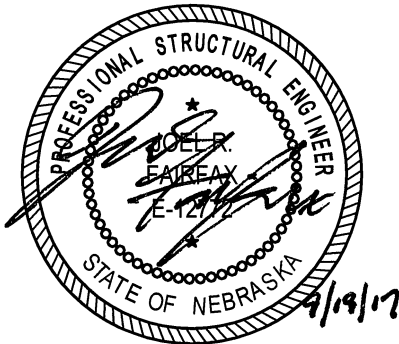

9/19/17

I hereby certify that this specification was prepared by me or under my direct personal supervision and that I am a duly licensed Professional Engineer under the laws of the State of Nebraska.

Specification Divisions/Sections covered by this seal:

3, 5 AND 31 63 26



9/19/17

I hereby certify that this specification was prepared by me or under my direct personal supervision and that I am a duly licensed Professional Engineer under the laws of the State of Nebraska.

Specification Divisions/Sections covered by this seal:

21



9/19/17

I hereby certify that this specification was prepared by me or under my direct personal supervision and that I am a duly licensed Professional Engineer under the laws of the State of Nebraska.

Specification Divisions/Sections covered by this seal:

22 AND 23



9/19/17

I hereby certify that this specification was prepared by me or under my direct personal supervision and that I am a duly licensed Professional Engineer under the laws of the State of Nebraska.

Specification Divisions/Sections covered by this seal:

26, 27, AND 28



9/19/17

I hereby certify that this specification was prepared by me or under my direct personal supervision and that I am a duly licensed Professional Engineer under the laws of the State of Nebraska.

Specification Divisions/Sections covered by this seal:

31 20 11, 32 05 23 AND 33 40 00

**DEPARTMENT OF VETERANS AFFAIRS  
VHA MASTER SPECIFICATIONS**

**TABLE OF CONTENTS  
Section 00 01 10**

	<b>DIVISION 00 - SPECIAL SECTIONS</b>	<b>DATE</b>
00 01 15	List of Drawing Sheets	07-15
	<b>DIVISION 01 - GENERAL REQUIREMENTS</b>	
01 00 00	General Requirements	11-15
01 32 16.15	Project Schedules (Small Projects - Design/Bid/Build	02-15
01 33 23	Shop Drawings, Product Data, and Samples	09-16
01 35 26	Safety Requirements	02-17
01 42 19	Reference Standards	05-16
01 45 29	Testing Laboratory Services	06-16
01 57 19	Temporary Environmental Controls	01-11
01 58 16	Temporary Interior Signage	07-15
01 74 19	Construction Waste Management	09-13
01 81 13	Sustainable Construction Requirements	09-15
	<b>DIVISION 02 - EXISTING CONDITIONS</b>	
02 41 00	Demolition	02-15
02 82 13.13	Glovebag Asbestos Abatement	09-15
02 82 13.19	Asbestos Floor Tile and Mastic Abatement	09-15
	<b>DIVISION 03 - CONCRETE</b>	
03 30 00	Cast-in-Place Concrete	12-15
	<b>DIVISION 04 - MASONRY</b>	
04 05 13	Masonry Mortaring	02-16
04 05 16	Masonry Grouting	02-16
04 20 00	Unit Masonry	02-16
04 72 00	Cast Stone Masonry	02-15
	<b>DIVISION 05 - METALS</b>	
05 12 00	Structural Steel Framing	02-16
05 31 00	Steel Decking	02-16
05 40 00	Cold-Formed Metal Framing	05-16
05 50 00	Metal Fabrications	07-14

	<b>DIVISION 06 - WOOD,PLASTICS AND COMPOSITES</b>	
06 10 00	Rough Carpentry	10-15
06 20 00	Finish Carpentry	08-16
	<b>DIVISION 07 - THERMAL AND MOISTURE PROTECTION</b>	
07 13 00	Sheet Waterproofing	04-13
07 13 52	Modified Bituminous Sheet Waterproofing	09-11
07 21 13	Thermal Insulation	02-16
07 22 00	Roof and Deck Insulation	02-16
07 27 27	Fluid-Applied Membrane Air Barrier, Vapor Retarding	02-16
07 40 00	Roofing and Siding Panels	10-15
07 54 23	Thermoplastic Polyolefin (TPO) Roofing	10-15
07 60 00	Flashing and Sheet Metal	07-14
07 72 00	Roof Accessories	10-15
07 81 00	Applied Fireproofing	10-15
07 84 00	Firestopping	02-16
07 92 00	Joint Sealants	10-15
	<b>DIVISION 08 - OPENINGS</b>	
08 11 13	Hollow Metal Doors and Frames	08-16
08 14 00	Interior Wood Doors	02-16
08 31 13	Access Doors and Frames	02-16
08 34 53	Security Doors and Frames	05-15
08 41 13	Aluminum-Framed Entrances and Storefronts	08-16
08 44 13	Glazed Aluminum Curtain Walls	03-17
08 56 59	Service and Teller Window Units	02-16
08 71 00	Door Hardware	01-16
08 71 13	Automatic Door Operators	02-16
08 80 00	Glazing	10-15
	<b>DIVISION 09 - FINISHES</b>	
09 05 16	Subsurface Preparation for Floor Finishes	02-15
09 22 16	Non-Structural Metal Framing	05-16
09 29 00	Gypsum Board	11-14
09 30 13	Ceramic/Porcelain Tiling	10-15
09 51 00	Acoustical Ceilings	12-15
09 65 13	Resilient Base and Accessories	02-16
09 65 16	Resilient Sheet Flooring	02-16
09 65 19	Resilient Tile Flooring	12-15
09 66 16	Terrazzo Floor Tile	10-15
09 68 00	Carpeting	10-15
09 72 16	Vinyl-Coated Fabric Wall Covering	10-15
09 91 00	Painting	01-16



00 01 10-3

	<b>DIVISION 23 - HEATING, VENTILATING, AND AIR CONDITIONING (HVAC)</b>	
23 05 11	Common Work Results for HVAC	02-15
23 05 12	General Motor Requirements for HVAC and Steam Generation Equipment	11-10
23 05 41	Noise and Vibration Control for HVAC Piping and Equipment	02-15
23 05 93	Testing, Adjusting, and Balancing for HVAC	02-15
23 07 11	HVAC and Boiler Plant Insulation	02-15
23 09 23	Direct-Digital Control System for HVAC	09-11
23 21 13	Hydronic Piping	09-12
23 22 13	Steam and Condensate Heating Piping	02-15
23 23 00	Refrigerant Piping	02-15
23 31 00	HVAC Ducts and Casings	03-13
23 34 00	HVAC Fans	02-15
23 36 00	Air Terminal Units	02-15
23 72 00	Air-to-Air Energy Recovery Equipment	05-11
23 74 13	Packaged, Outdoor, Central-Station Air-Handling Units	04-11
23 81 43	Air-Source Unitary Heat Pumps	04-11
23 82 00	Convection Heating and Cooling Units	04-11
	<b>DIVISION 25 - INTEGRATED AUTOMATION</b>	
	Not used	
	<b>DIVISION 26 - ELECTRICAL</b>	
26 05 11	Requirements for Electrical Installations	01-16
26 05 19	Low-Voltage Electrical Power Conductors and Cables	01-17
26 05 26	Grounding and Bonding for Electrical Systems	01-17
26 05 33	Raceway and Boxes for Electrical Systems	05-14
26 09 23	Lighting Controls	05-14
26 24 16	Panelboards	05-14
26 27 26	Wiring Devices	01-16
26 29 21	Enclosed Switches and Circuit Breakers	01-17
26 41 00	Facility Lightning Protection	01-17
26 43 13	Surge Protective Devices	01-17
26 51 00	Interior Lighting	08-14
26 56 00	Exterior Lighting	05-14
	<b>DIVISION 27 - COMMUNICATIONS</b>	
27 05 11	Requirements for Communications Installations	06-15
27 05 26	Grounding and Bonding for Communications Systems	06-15
27 05 33	Raceways and Boxes for Communications Systems	06-15
27 11 00	Telecommunications Room Fittings	06-15
27 15 00	Communications Structured Cabling	01-16

	<b>DIVISION 28 - ELECTRONIC SAFETY AND SECURITY</b>	
28 05 00	Common Work Results for Electronic Safety and Security	09-11
28 05 13	Conductors and Cables for Electronic Safety and Security	09-11
28 05 26	Grounding and Bonding for Electronic Safety and Security	09-11
28 05 28.33	Conduits and Backboxes for Electronic Safety and Security	09-11
28 13 00	Physical Access Control System	10-11
28 16 11	Code Green Notification System	
28 23 00	Video Surveillance	09-11
28 31 00	Fire Detection and Alarm	10-11
	<b>DIVISION 31 - EARTHWORK</b>	
31 20 11	Earthwork (Short Form)	10-12
31 63 26	Drilled Caissons	10-12
	<b>DIVISION 32 - EXTERIOR IMPROVEMENTS</b>	
32 05 23	Cement and Concrete for Exterior Improvements	08-16
	<b>DIVISION 33 - UTILITIES</b>	
33 40 00	Storm Sewer Utilities	10-11
33 46 13	Foundation Drainage	10-11
	<b>DIVISION 34 - TRANSPORTATION</b>	
	Not used	
	<b>DIVISION 48 - Electrical Power Generation</b>	
	Not used	
	<b>APPENDIX</b>	
Appendix A	Limited Asbestos Survey Report	12-16
Appendix B	Geotechnical Engineering Report	10-16
Appendix C	Safety Requirements - Risk Assessments	--



**SECTION 21 12 00**  
**MANUAL DRY STANDPIPE SYSTEMS**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. Design, materials, equipment and installation, inspection and testing of a manual dry standpipe system as required by NFPA 14.
- B. Modification of the existing manual dry standpipe system as indicated on the drawings and as further required by these specifications.

**1.2 RELATED WORK**

- A. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Section 07 84 00, FIRESTOPPING.
- C. Section 09 91 00, PAINTING.
- D. Section 28 31 00, FIRE DETECTION AND ALARM.

**1.3 DESIGN CRITERIA**

- A. Design Basis Information: Provide design, materials, equipment, installation, and testing of the manual dry standpipe system in accordance with NFPA 14.
  - 1. For hydraulic calculations, calculated demand shall not fall less than 10 percent below the water supply curve.
  - 2. Water Supply: Base water supply buildings fire pump system.
  - 3. Size standpipes to provide 100 psi at the most remote connections.
  - 4. NOT USED

**1.4 SUBMITTALS**

- A. Submit as one package in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES. Prepare detailed working drawings that are signed by a NICET Level III or Level IV Sprinkler Technician or stamped by a Registered Professional Engineer licensed in the field of Fire Protection Engineering. As the Government review is for technical adequacy only, the installer remains responsible for correcting any conflicts with other trades and building construction that arise during installation. Partial submittals will not be accepted. Material submittals shall be approved prior to the purchase or delivery to the job site. Suitably bind submittals in notebooks or binders and provide index referencing the appropriate specification section. In addition to the hard copies, provide submittal items in Paragraphs 1.3(C)1 through 1.3(C)5 electronically in pdf format on a compact disc or as directed by the COR. Submittals shall include, but not be limited to, the following:

1. Qualifications:
  - a. Provide a copy of the installing contractors fire sprinkler and state contractor's license.
  - b. Provide a copy of the NICET certification for the NICET Level III or Level IV Sprinkler Technician who prepared and signed the detailed working drawings unless the drawings are stamped by a Registered Professional Engineer licensed in the field of Fire Protection Engineering.
  - c. Provide documentation showing that the installer has been actively and successfully engaged in the installation of commercial automatic sprinkler systems for the past ten years.
2. Drawings: Submit detailed 1:100 (1/8 inch) scale (minimum) working drawings conforming to the Plans and Calculations chapter of NFPA 14. Drawings shall include graphical scales that allow the user to determine lengths when the drawings are reduced in size. Include a plan showing the piping to the water supply test location.
3. Manufacturer's Data Sheets: Provide data sheets for all materials and equipment proposed for use on the system. Include listing information and installation instructions in data sheets. Where data sheets describe items in addition to those proposed to be used for the system, clearly identify the proposed items on the sheet.
4. Calculation Sheets:
  - a. Submit hydraulic calculation sheets in tabular form conforming to the requirements and recommendations of the Plans and Calculations chapter of NFPA 14.
5. Valve Charts: Provide a valve chart that identifies the location of each control valve. Coordinate nomenclature and identification of control valves with COR. Where existing nomenclature does not exist, the chart shall include no less than the following: Tag ID No., Valve Size, Service (control valve, main drain, aux. drain, inspectors test valve, etc.), and Location.
6. Final Document Submittals: Provide as-built drawings, testing and maintenance instructions in accordance with the requirements in Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES. In addition, submittals shall include, but not be limited to, the following:
  - a. A complete set of as-built drawings showing the installed system with the specific interconnections between the system switches

and the fire alarm equipment. Provide a complete set in the formats as follows. Submit items 2 and 3 below on a compact disc or as directed by the COR.

- 1) One full size (or size as directed by the COR) printed copy.
  - 2) One complete set in electronic pdf format.
  - 3) One complete set in AutoCAD format or a format as directed by the COR.
- b. Material and Testing Certificate: Upon completion of the standpipe system installation or any partial section of the system, including testing and flushing, provide a copy of a completed Material and Testing Certificate as indicated in NFPA 14. Certificates shall be provided to document all parts of the installation.
  - c. Operations and Maintenance Manuals that include step-by-step procedures required for system startup, operation, shutdown, and routine maintenance and testing. The manuals shall include the manufacturer's name, model number, parts list, and tools that should be kept in stock by the owner for routine maintenance, including the name of a local supplier, simplified wiring and controls diagrams, troubleshooting guide, and recommended service organization, including address and telephone number, for each item of equipment.
  - d. One paper copy of the Material and Testing Certificates and the Operations and Maintenance Manuals above shall be provided in a binder. In addition, these materials shall be provided in pdf format on a compact disc or as directed by the COR.
  - e. Provide one additional copy of the Operations and Maintenance Manual covering the system in a flexible protective cover and mount in an accessible location adjacent to the riser or as directed by the COR.

#### **1.5 QUALITY ASSURANCE**

- A. Installer Reliability: The installer shall possess a valid State of Iowa fire sprinkler contractor's license. The installer shall have been actively and successfully engaged in the installation of commercial automatic sprinkler systems for the past ten years.
- B. Materials and Equipment: All equipment and devices shall be of a make and type listed by UL or approved by FM, or other nationally recognized

testing laboratory for the specific purpose for which it is used. All materials, devices, and equipment shall be approved by the VA. All materials and equipment shall be free from defect. All materials and equipment shall be new unless specifically indicated otherwise on the contract drawings.

#### **1.6 APPLICABLE PUBLICATIONS:**

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. National Fire Protection Association (NFPA):
  - NFPA 14-13.....Installation of Standpipe and Hose Systems
  - NFPA 101-15.....Life Safety Code
  - NFPA 170-15.....Fire Safety Symbols
- C. Underwriters Laboratories, Inc. (UL):
  - Fire Protection Equipment Directory (2011)
- D. Factory Mutual Engineering Corporation (FM):
  - Approval Guide

### **PART 2 - PRODUCTS**

#### **2.1 PIPING & FITTINGS:**

- A. Piping and fitting shall be in accordance with NFPA 14. Do not use plain end pipe and fittings with locking lugs or shear bolts.

#### **2.2 VALVES**

- A. Valves shall be in accordance with NFPA 14.
- B. Do not use quarter turn ball valves for 50 mm (2 inches) or larger drain valves.
- C. Standpipe Hose Valves: 65 mm (2-1/2 inches) screwed, brass hose angle valve, male hose threads same as local fire protection service, 65 mm (2-1/2 inches) by 40 mm (1-1/2 inches) reducer, with permanently attached polished brass cap and chain.
- D. Automatic Ball Drips: Cast brass 20 mm (3/4-inch) in-line automatic ball drip with both ends threaded with iron pipe threads.

#### **2.3 FIRE DEPARTMENT SUPPLY CONNECTION: (NOT USED)**

#### **2.4 IDENTIFICATION SIGNS:**

- A. Rigid plastic, steel or aluminum signs with white lettering on a red background with holes for easy attachment. Standpipe system signage shall be attached to the valve or piping with chain.



**2.5 STANDPIPE HOSE VALVE CABINETS: (NOT USED)****2.6 VALVE SUPERVISORY SWITCHES:**

- A. Contain in a die cast red baked enamel, oil resistant, aluminum housing with tamper resistant screws, which shall provide a 13 mm (1/2 inch) conduit entrance and necessary facilities for attachment to the valves. Provide two SPDT switches rated at 2.5 amps at 24 VDC. Valve supervisory switches for ball and butterfly valves may be integral with the valve.

**2.7 PIPE SUPPORTS:**

- A. Pipe hangers, supports, and restraint of system piping shall be in accordance with NFPA 14.

**2.8 WALL, FLOOR AND CEILING PLATES:**

- A. Provide chrome plated steel escutcheon plates.

**2.9 VALVE TAGS**

Engraved black filled numbers and letters not less than 15 mm (1/2 inch) high for number designation, and not less than 8 mm (1/4 inch) for service designation on 19 gauge, 40 mm (1-1/2 inches) round brass disc, attached with brass "S" hook, brass chain, or nylon twist tie.

**PART 3 - EXECUTION****3.1 INSTALLATION:**

- A. Installation shall be accomplished by the licensed contractor. Provide a qualified technician, experienced in the installation and operation of the type of system being installed, to supervise the installation and testing of the system.
- B. Installation of Piping: Accurately cut pipe to measurements established by the installer and work into place without springing or forcing. In any situations where bending of the pipe is required, use a standard pipe-bending template. Conceal piping in all spaces which have finished ceilings. In stairways, locate piping as near to the ceiling as possible to prevent tampering by unauthorized personnel and to provide a minimum headroom clearance of 2250 mm (seven feet six inches). Piping shall not obstruct the minimum means of egress clearances required by NFPA 101. Pipe hangers, supports, and restraint of system piping, and shall be installed accordance with NFPA 13.
- C. NOT USED
- D. Drains: Pipe drains to discharge at safe points outside of the building or to sight cones attached to drains of adequate size to readily carry the full flow from each drain under maximum pressure. Do not provide a

direct drain connection to sewer system or discharge into sinks.

Install drips and drains where necessary and as required by NFPA 14.

- E. Valve Supervisory Switches: Provide supervisory switches that are connected to the fire alarm system. Do not provide valve supervisory switches on standpipe hose valves, test or drain valves. See Section 28 31 00 for connections.
- F. Provide escutcheon plates for exposed piping passing through walls, floors or ceilings.
- G. Clearances: For systems requiring seismic protection, piping that passes through floors or walls shall have penetrations sized 50 mm (2 inches) nominally larger than the penetrating pipe for pipe sizes 25 mm (1 inch) to 90 mm (3 ½ inches) and 100 mm (4 inches) nominally larger for penetrating pipe sizes 100 mm (4 inches) and larger.
- H. Sleeves: Provide for pipes passing through masonry or concrete. Provide space between the pipe and the sleeve in accordance with NFPA 13. Seal this space with a UL Listed through penetration fire stop material in accordance with Section 07 84 00, FIRESTOPPING. Where core drilling is used in lieu of sleeves, also seal space around penetrations. Seal penetrations of walls, floors and ceilings of other types of construction, in accordance with Section 07 84 00, FIRESTOPPING.
- I. Paint all piping Fire Safety Red in accordance with Section 09 91 00 or a color designated by the Contracting Officers Technical Representative (COR).
- J. NOT USED
- K. Securely attach identification signs to control valves, drain valves, and test valves.
- L. Interruption of Service: There shall be no interruption of the existing sprinkler protection, water, electric, or fire alarm services without prior permission of the Contracting Officers Technical Representative (COR). Permission shall be requested in writing at least one (1) week prior to the planned interruption. Any interruption shall be limited to 4 hours for final connections or repairs.
- M. Welding: All welding shall conform to the requirements and recommendations of NFPA 14.

### **3.2 INSPECTION AND TEST:**

- A. Hydrostatic Testing: Hydrostatically test the system including the fire department connections, as specified in NFPA 14, in the presence of the

Contracting Officers Technical Representative (COR) or his designated representative.

- B. Final Inspection and Testing: Test the system in accordance with NFPA 14 when all necessary corrections have been accomplished. Advise the Contracting Officers Technical Representative (COR) who will then schedule the final inspection and test. Furnish all instruments, labor and materials required for the tests and provide the services of the installation foreman or other competent representative of the installer to perform the tests. Correct any deficiencies found and retest the system. Include the operation of all features of the systems under normal conditions in the test.

- - - E N D - - -



**SECTION 21 13 13**  
**WET-PIPE SPRINKLER SYSTEMS**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. Design, installation and testing shall be in accordance with NFPA 13.
- B. NOT USED
- C. Modification of the existing sprinkler system as indicated on the drawings and as further required by these specifications.

**1.2 RELATED WORK**

- A. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Section 33 10 00, WATER UTILITIES.
- C. Section 07 84 00, FIRESTOPPING.
- D. Section 09 91 00, PAINTING.
- E. NOT USED.
- F. Section 28 31 00, FIRE DETECTION AND ALARM.
- G. NOT USED.
- H. NOT USED.

**1.3 DESIGN CRITERIA**

- A. Design Basis Information: Provide design, materials, equipment, installation, inspection, and testing of the automatic sprinkler system in accordance with the requirements of NFPA 13.
  - 1. Perform hydraulic calculations in accordance with NFPA 13 utilizing the Area/Density method. Do not restrict design area reductions permitted for using quick response sprinklers throughout by the required use of standard response sprinklers in the areas identified in this section.
  - 2. Sprinkler Protection: Sprinkler hazard classifications shall be in accordance with NFPA 13. The hazard classification examples of uses and conditions identified in the Annex of NFPA 13 shall be mandatory for areas not listed below. Request clarification from the Government for any hazard classification not identified. To determining spacing and sizing, apply the following coverage classifications:
    - a. Light Hazard Occupancies: Patient care, treatment, and customary access areas.
    - b. NOT USED

- c. Ordinary Hazard Group 2 Occupancies: Storage rooms, storage areas, building management storage.
- 3. Hydraulic Calculations: Calculated demand including hose stream requirements shall fall no less than 10 percent below the available water supply curve.
- 4. NOT USED
- 5. Zoning:
  - a. Maintain existing zones.
  - b. Sprinkler zones shall conform to the smoke barrier zones shown on the drawings.
- 6. NOT USED

#### **1.4 SUBMITTALS**

- A. Submit as one package in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES. Prepare detailed working drawings that are signed by a NICET Level III or Level IV Sprinkler Technician or stamped by a Registered Professional Engineer licensed in the field of Fire Protection Engineering. As the Government review is for technical adequacy only, the installer remains responsible for correcting any conflicts with other trades and building construction that arise during installation. Partial submittals will not be accepted. Material submittals shall be approved prior to the purchase or delivery to the job site. Suitably bind submittals in notebooks or binders and provide an index referencing the appropriate specification section. In addition to the hard copies, provide submittal items in Paragraphs 1.4(A)1 through 1.4(A)5 electronically in pdf format on a compact disc or as directed by the COR. Submittals shall include, but not be limited to, the following:
  - 1. Qualifications:
    - a. Provide a copy of the installing contractors fire sprinkler and state contractor's license.
    - b. Provide a copy of the NICET certification for the NICET Level III or Level IV Sprinkler Technician who prepared and signed the detailed working drawings unless the drawings are stamped by a Registered Professional Engineer licensed in the field of Fire Protection Engineering.
    - c. Provide documentation showing that the installer has been actively and successfully engaged in the installation of commercial automatic sprinkler systems for the past ten years.

2. Drawings: Submit detailed 1:100 (1/8 inch) scale (minimum) working drawings conforming to the Plans and Calculations chapter of NFPA 13. Drawings shall include graphical scales that allow the user to determine lengths when the drawings are reduced in size. Include a plan showing the piping to the water supply test location.
3. Manufacturer's Data Sheets: Provide data sheets for all materials and equipment proposed for use on the system. Include listing information and installation instructions in data sheets. Where data sheets describe items in addition to those proposed to be used for the system, clearly identify the proposed items on the sheet.
4. Calculation Sheets:
  - a. Submit hydraulic calculation sheets in tabular form conforming to the requirements and recommendations of the Plans and Calculations chapter of NFPA 13.
  - b. NOT USED
5. NOT USED
6. Final Document Submittals: Provide as-built drawings, testing and maintenance instructions in accordance with the requirements in Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES. In addition, submittals shall include, but not be limited to, the following:
  - a. A complete set of as-built drawings showing the installed system with the specific interconnections between the system switches and the fire alarm equipment. Provide a complete set in the formats as follows. Submit items 2 and 3 below on a compact disc or as directed by the COR.
    - 1) One full size (or size as directed by the COR) printed copy.
    - 2) One complete set in electronic pdf format.
    - 3) One complete set in AutoCAD format or a format as directed by the COR.
  - b. Material and Testing Certificate: Upon completion of the sprinkler system installation or any partial section of the system, including testing and flushing, provide a copy of a completed Material and Testing Certificate as indicated in NFPA 13. Certificates shall be provided to document all parts of the installation.
  - c. Operations and Maintenance Manuals that include step-by-step procedures required for system startup, operation, shutdown, and

routine maintenance and testing. The manuals shall include the manufacturer's name, model number, parts list, and tools that should be kept in stock by the owner for routine maintenance, including the name of a local supplier, simplified wiring and controls diagrams, troubleshooting guide, and recommended service organization, including address and telephone number, for each item of equipment.

- d. One paper copy of the Material and Testing Certificates and the Operations and Maintenance Manuals above shall be provided in a binder. In addition, these materials shall be provided in pdf format on a compact disc or as directed by the COR.
- e. Provide one additional copy of the Operations and Maintenance Manual covering the system in a flexible protective cover and mount in an accessible location adjacent to the riser or as directed by the COR.

#### **1.5 QUALITY ASSURANCE**

- A. **Installer Reliability:** The installer shall possess a valid State of Iowa fire sprinkler contractor's license. The installer shall have been actively and successfully engaged in the installation of commercial automatic sprinkler systems for the past ten years.
- B. **Materials and Equipment:** All equipment and devices shall be of a make and type listed by UL or approved by FM, or other nationally recognized testing laboratory for the specific purpose for which it is used. All materials, devices, and equipment shall be approved by the VA. All materials and equipment shall be free from defect. All materials and equipment shall be new unless specifically indicated otherwise on the contract drawings.

#### **1.6 APPLICABLE PUBLICATIONS**

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. **National Fire Protection Association (NFPA):**
  - 13-13.....Installation of Sprinkler Systems
  - 25-14.....Inspection, Testing, and Maintenance of Water-Based Fire Protection Systems
  - 101-15.....Life Safety Code
  - 170-15.....Fire Safety Symbols



- C. Underwriters Laboratories, Inc. (UL):  
Fire Protection Equipment Directory (2011)
- D. Factory Mutual Engineering Corporation (FM):  
Approval Guide

## **PART 2 - PRODUCTS**

### **2.1 PIPING & FITTINGS**

- A. Piping and fittings for private underground water mains shall be in accordance with NFPA 13.
  - 1. Pipe and fittings from inside face of building 300 mm (12 in.) above finished floor to a distance of approximately 1500 mm (5 ft.) outside building: Ductile Iron, flanged fittings and 316 stainless steel bolting.
- B. Piping and fittings for sprinkler systems shall be in accordance with NFPA 13.
  - 1. Plain-end pipe fittings with locking lugs or shear bolts are not permitted.
  - 2. Piping sizes 50 mm (2 inches) and smaller shall be black steel Schedule 40 with threaded end connections.
  - 3. Piping sizes 65 mm (2 ½ inches) and larger shall be black steel Schedule 10 with grooved connections. Grooves in Schedule 10 piping shall be rolled grooved only.
  - 4. Use nonferrous piping in MRI Scanning Rooms.
  - 5. Plastic piping shall not be permitted except for drain piping.
  - 6. Flexible sprinkler hose shall be FM Approved and limited to hose with threaded end fittings with a minimum inside diameter or 1-inch and a maximum length of 6-feet.

### **2.2 VALVES**

- A. General:
  - 1. Valves shall be in accordance with NFPA 13.
  - 2. Do not use quarter turn ball valves for 50 mm (2 inch) or larger drain valves.
- B. NOT USED
- C. Check Valve: Shall be of the swing type with a flanged cast iron body and flanged inspection plate.
- D. Automatic Ball Drips: Cast brass 20 mm (3/4 inch) in-line automatic ball drip with both ends threaded with iron pipe threads.
- E. NOT USED

F. NOT USED

## **2.3 FIRE DEPARTMENT SIAMESE CONNECTION - NOT USED**

## **2.4 SPRINKLERS**

- A. All sprinklers shall be FM approved quick response except "institutional" type sprinklers shall be permitted to be UL Listed quick response. Provide FM approved quick response sprinklers in all areas.
- B. Temperature Ratings: In accordance with NFPA 13 except that sprinklers in elevator shafts and elevator machine rooms shall be no less than intermediate temperature rated and sprinklers in generator rooms shall be no less than high temperature rated.
- C. Provide sprinkler guards in accordance with NFPA 13 and when the elevation of the sprinkler head is less than 7 feet 6 inches above finished floor. The sprinkler guard shall be UL listed or FM approved for use with the corresponding sprinkler.

## **2.5 SPRINKLER CABINET: NOT USED**

## **2.6 SPRINKLER SYSTEM SIGNAGE**

Rigid plastic, steel or aluminum signs with white lettering on a red background with holes for easy attachment. Sprinkler system signage shall be attached to the valve or piping with chain.

## **2.7 SWITCHES: NOT USED**

## **2.8 GAUGES: NOT USED**

## **2.9 PIPE HANGERS, SUPPORTS AND RESTRAINT OF SYSTEM PIPING**

Pipe hangers, supports, and restraint of system piping shall be in accordance with NFPA 13.

## **2.10 WALL, FLOOR AND CEILING PLATES**

Provide chrome plated steel escutcheon plates.

## **2.11 ANTIFREEZE SOLUTION: NOT USED**

## **2.12 VALVE TAGS: NOT USED**

# **PART 3 - EXECUTION**

## **3.1 INSTALLATION**

- A. Installation shall be accomplished by the licensed contractor. Provide a qualified technician, experienced in the installation and operation of the type of system being installed, to supervise the installation and testing of the system.
- B. Installation of Piping: Accurately cut pipe to measurements established by the installer and work into place without springing or forcing. In

any situation where bending of the pipe is required, use a standard pipe-bending template. Concealed piping in spaces that have finished ceilings. Where ceiling mounted equipment exists, such as in operating and radiology rooms, install sprinklers so as not to obstruct the movement or operation of the equipment. Sidewall heads may need to be utilized. In stairways, locate piping as near to the ceiling as possible to prevent tampering by unauthorized personnel and to provide a minimum headroom clearance of 2250 mm (seven feet six inches). Piping shall not obstruct the minimum means of egress clearances required by NFPA 101. Pipe hangers, supports and restraint of system piping shall be installed accordance with NFPA 13.

C. Welding: Conform to the requirements and recommendations of NFPA 13.

D. Drains: Provide drips and drains, including low point drains, in accordance with NFPA 13. Pipe drains to discharge at safe points outside of the building or to sight cones attached to drains of adequate size to readily carry the full flow from each drain under maximum pressure. Do not provide a direct drain connection to sewer system or discharge into sinks. Install drips and drains where necessary and required by NFPA 13. The drain piping shall not be restricted or reduced and shall be of the same diameter as the drain collector.

E. NOT USED

F. NOT USED

G. NOT USED

H. Affix cutout disks, which are created by cutting holes in the walls of pipe for flow switches and non-threaded pipe connections to the respective waterflow switch or pipe connection near to the pipe from where they were cut.

I. Provide escutcheon plates for exposed piping passing through walls, floors or ceilings.

J. NOT USED

K. Sleeves: Provide for pipes passing through masonry or concrete. Provide space between the pipe and the sleeve in accordance with NFPA 13. Seal this space with a UL Listed through penetration fire stop material in accordance with Section 07 84 00, FIRESTOPPING. Where core drilling is used in lieu of sleeves, also seal space. Seal penetrations of walls, floors and ceilings of other types of construction, in accordance with Section 07 84 00, FIRESTOPPING.

- L. NOT USED
- M. NOT USED
- N. NOT USED
- O. Firestopping shall be provided for all penetrations of fire resistance rated construction. Firestopping shall comply with Section 07 84 00, FIRESTOPPING.
- P. NOT USED
- Q. Painting of Pipe: In finished areas where walls and ceilings have been painted, paint primed surfaces with two coats of paint to match adjacent surfaces, except paint valves and operating accessories with two coats of gloss red enamel. Exercise care to avoid painting sprinklers. Painting of sprinkler systems above suspended ceilings and in crawl spaces is not required. Painting shall comply with Section 09 91 00, PAINTING. Any painted sprinkler shall be replaced with a new sprinkler.
- R. Sprinkler System Signage: Provide rigid sprinkler system signage in accordance with NFPA 13 and NFPA 25. Sprinkler system signage shall include, but not limited to, the following:
  - 1. Identification Signs:
    - a. Provide signage for each drain valve.
    - b. Provide valve tags for each operable valve. Coordinate nomenclature and identification of operable valves with COR. Where existing nomenclature does not exist, the Tag Identification shall include no less than the following: (FP-B-F/SZ-#) Fire Protection, Building Number, Floor Number/Smoke Zone (if applicable), and Valve Number. (E.g., FP-500-1E-001) Fire Protection, Building 500, First Floor East, Number 001.)
  - 2. NOT USED
  - 3. Hydraulic Placards:
    - a. Provide signage indicating hydraulic design information. The placard shall include location of the design area, discharge densities, required flow and residual pressure at the base of riser, occupancy classification, hose stream allowance, flow test information, and installing contractor. Locate hydraulic placard information signs at each alarm check valve.
- S. Repairs: Repair damage to the building or equipment resulting from the installation of the sprinkler system by the installer at no additional expense to the Government.

- T. Interruption of Service: There shall be no interruption of the existing sprinkler protection, water, electric, or fire alarm services without prior permission of the Contracting Officer. Contractor shall develop an interim fire protection program where interruptions involve occupied spaces. Request in writing at least one week prior to the planned interruption.

### **3.2 INSPECTION AND TEST**

- A. Preliminary Testing: Flush newly installed systems prior to performing hydrostatic tests in order to remove any debris which may have been left as well as ensuring piping is unobstructed. Hydrostatically test system, including the fire department connections, as specified in NFPA 13, in the presence of the Contracting Officers Representative (COR) or his designated representative. Test and flush underground water line prior to performing these hydrostatic tests.
- B. Final Inspection and Testing: Subject system to tests in accordance with NFPA 13, and when all necessary corrections have been accomplished, advise COR to schedule a final inspection and test. Connection to the fire alarm system shall have been in service for at least ten days prior to the final inspection, with adjustments made to prevent false alarms. Furnish all instruments, labor and materials required for the tests and provide the services of the installation foreman or other competent representative of the installer to perform the tests. Correct deficiencies and retest system as necessary, prior to the final acceptance. Include the operation of all features of the systems under normal operations in test

### **3.3 INSTRUCTIONS**

Furnish the services of a competent instructor for not less than two hours for instructing personnel in the operation and maintenance of the system, on the dates requested by the COR.

- - - E N D - - -



**SECTION 22 05 11**  
**COMMON WORK RESULTS FOR PLUMBING**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. The requirements of this Section shall apply to all sections of Division 22.
- B. Definitions:
  - 1. Exposed: Piping and equipment exposed to view in finished rooms.
- C. Abbreviations/Acronyms:
  - 1. ABS: Acrylonitrile Butadiene Styrene
  - 2. AC: Alternating Current
  - 3. ACR: Air Conditioning and Refrigeration
  - 4. AI: Analog Input
  - 5. AISI: American Iron and Steel Institute
  - 6. AO: Analog Output
  - 7. AWG: American Wire Gauge
  - 8. BACnet: Building Automation and Control Network
  - 9. BAg: Silver-Copper-Zinc Brazing Alloy
  - 10. BAS: Building Automation System
  - 11. BCuP: Silver-Copper-Phosphorus Brazing Alloy
  - 12. BSG: Borosilicate Glass Pipe
  - 13. CDA: Copper Development Association
  - 14. C: Celsius
  - 15. CLR: Color
  - 16. CO: Carbon Monoxide
  - 17. COR: Contracting Officer's Representative
  - 18. CPVC: Chlorinated Polyvinyl Chloride
  - 19. CR: Chloroprene
  - 20. CRS: Corrosion Resistant Steel
  - 21. CWP: Cold Working Pressure
  - 22. CxA: Commissioning Agent
  - 23. db(A): Decibels (A weighted)
  - 24. DDC: Direct Digital Control
  - 25. DI: Digital Input
  - 26. DISS: Diameter Index Safety System
  - 27. DO: Digital Output
  - 28. DVD: Digital Video Disc
  - 29. DN: Diameter Nominal

- 30. DWV: Drainage, Waste and Vent
- 31. ECC: Engineering Control Center
- 32. EPDM: Ethylene Propylene Diene Monomer
- 33. EPT: Ethylene Propylene Terpolymer
- 34. ETO: Ethylene Oxide
- 35. F: Fahrenheit
- 36. FAR: Federal Acquisition Regulations
- 37. FD: Floor Drain
- 38. FED: Federal
- 39. FG: Fiberglass
- 40. FNPT: Female National Pipe Thread
- 41. FPM: Fluoroelastomer Polymer
- 42. GPM: Gallons Per Minute
- 43. HDPE: High Density Polyethylene
- 44. Hg: Mercury
- 45. HOA: Hands-Off-Automatic
- 46. HP: Horsepower
- 47. HVE: High Volume Evacuation
- 48. ID: Inside Diameter
- 49. IPS: Iron Pipe Size
- 50. Kg: Kilogram
- 51. kPa: Kilopascal
- 52. lb: Pound
- 53. L/s: Liters Per Second
- 54. L/min: Liters Per Minute
- 55. MAWP: Maximum Allowable Working Pressure
- 56. MAX: Maximum
- 57. MED: Medical
- 58. m: Meter
- 59. MFG: Manufacturer
- 60. mg: Milligram
- 61. mg/L: Milligrams per Liter
- 62. ml: Milliliter
- 63. mm: Millimeter
- 64. MIN: Minimum
- 65. NF: Oil Free Dry (Nitrogen)
- 66. NPTF: National Pipe Thread Female
- 67. NPS: Nominal Pipe Size



- 68. NPT: Nominal Pipe Thread
- 69. OD: Outside Diameter
- 70. OSD: Open Sight Drain
- 71. OS&Y: Outside Stem and Yoke
- 72. OXY: Oxygen
- 73. PBPU: Prefabricated Bedside Patient Units
- 74. PH: Power of Hydrogen
- 75. PLC: Programmable Logic Controllers
- 76. PP: Polypropylene
- 77. PPM: Parts per Million
- 78. PSIG: Pounds per Square Inch
- 79. PTFE: Polytetrafluoroethylene
- 80. PVC: Polyvinyl Chloride
- 81. PVDF: Polyvinylidene Fluoride
- 82. RAD: Radians
- 83. RO: Reverse Osmosis
- 84. RPM: Revolutions Per Minute
- 85. RTRP: Reinforced Thermosetting Resin Pipe
- 86. SCFM: Standard Cubic Feet Per Minute
- 87. SDI: Silt Density Index
- 88. SPEC: Specification
- 89. SPS: Sterile Processing Services
- 90. STD: Standard
- 91. SUS: Saybolt Universal Second
- 92. SWP: Steam Working Pressure
- 93. TEFC: Totally Enclosed Fan-Cooled
- 94. TFE: Tetrafluoroethylene
- 95. THHN: Thermoplastic High-Heat Resistant Nylon Coated Wire
- 96. THWN: Thermoplastic Heat & Water Resistant Nylon Coated Wire
- 97. T/P: Temperature and Pressure
- 98. USDA: U.S. Department of Agriculture
- 99. V: Volt
- 100. VAC: Vacuum
- 101. VA: Veterans Administration
- 102. VAMC: Veterans Administration Medical Center
- 103. VAC: Voltage in Alternating Current
- 104. WAGD: Waste Anesthesia Gas Disposal
- 105. WOG: Water, Oil, Gas

**1.2 RELATED WORK**

- A. Section 01 00 00, GENERAL REQUIREMENTS.
- B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- C. Section 01 74 19, CONSTRUCTION WASTE MANAGEMENT.
- D. Section 01 81 13, SUSTAINABLE CONSTRUCTION REQUIREMENTS.
- E. Section 01 91 00, GENERAL COMMISSIONING REQUIREMENTS.
- F. Section 02 82 11, TRADITIONAL ASBESTOS ABATEMENT.
- G. Section 03 30 00, CAST-IN-PLACE CONCRETE: Concrete and Grout.
- H. Section 05 31 00, STEEL DECKING: Building Components for Attachment of Hangers.
- I. Not Used.
- J. Section 05 50 00, METAL FABRICATIONS.
- K. Section 07 60 00, FLASHING AND SHEET METAL: Flashing for Wall and Roof Penetrations.
- L. Section 07 84 00, FIRESTOPPING.
- M. Section 07 92 00, JOINT SEALANTS.
- N. Section 09 91 00, PAINTING.
- O. Not Used.
- P. Section 22 05 12, GENERAL MOTOR REQUIREMENTS FOR PLUMBING EQUIPMENT.
- Q. Section 22 07 11, PLUMBING INSULATION.
- R. Section 22 08 00, COMMISSIONING OF PLUMBING SYSTEMS.
- S. Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC.
- T. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
- U. Section 26 05 19, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES.
- V. Section 26 29 11, MOTOR CONTROLLERS.

**1.3 APPLICABLE PUBLICATIONS**

- A. The publications listed below shall form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American Society of Mechanical Engineers (ASME):  
ASME Boiler and Pressure Vessel Code -  
BPVC Section IX-2013....Welding, Brazing, and Fusing Qualifications  
B31.1-2012.....Power Piping
- C. American Society for Testing and Materials (ASTM):  
A36/A36M-2012.....Standard Specification for Carbon Structural Steel

- A575-96(R2013)e1.....Standard Specification for Steel Bars, Carbon,  
Merchant Quality, M-Grades
- E84-2013a.....Standard Test Method for Surface Burning  
Characteristics of Building Materials
- E119-2012a.....Standard Test Methods for Fire Tests of  
Building Construction and Materials
- D. International Code Council, (ICC):
- IBC-2012.....International Building Code
- IPC-2012.....International Plumbing Code
- E. Manufacturers Standardization Society (MSS) of the Valve and Fittings  
Industry, Inc:
- SP-58-2009.....Pipe Hangers and Supports - Materials, Design,  
Manufacture, Selection, Application and  
Installation
- SP-69-2003.....Pipe Hangers and Supports - Selection and  
Application
- F. Military Specifications (MIL):
- P-21035B.....Paint High Zinc Dust Content, Galvanizing  
Repair (Metric)
- G. National Electrical Manufacturers Association (NEMA):
- MG 1-2011.....Motors and Generators
- H. National Fire Protection Association (NFPA):
- 51B-2014.....Standard for Fire Prevention During Welding,  
Cutting and Other Hot Work
- 54-2012.....National Fuel Gas Code
- 70-2014.....National Electrical Code (NEC)
- I. NSF International (NSF):
- 61-2012.....Drinking Water System Components - Health  
Effects
- 372-2011.....Drinking Water System Components - Lead Content
- J. Department of Veterans Affairs (VA):
- PG-18-10.....Plumbing Design Manual
- PG-18-13-2011.....Barrier Free Design Guide

#### **1.4 SUBMITTALS**

- A. Submittals, including number of required copies, shall be submitted in  
accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and  
SAMPLES.

- B. Information and material submitted under this section shall be marked "SUBMITTED UNDER SECTION 22 05 11, COMMON WORK RESULTS FOR PLUMBING", with applicable paragraph identification.
- C. Contractor shall make all necessary field measurements and investigations to assure that the equipment and assemblies will meet contract requirements and will fit the space available.
- D. If equipment is submitted which differs in arrangement from that shown, provide drawings that show the rearrangement of all associated systems. Approval will be given only if all features of the equipment and associated systems, including accessibility, are equivalent to that required by the contract.
- E. Prior to submitting shop drawings for approval, contractor shall certify in writing that manufacturers of all major items of equipment have each reviewed drawings and specifications, and have jointly coordinated and properly integrated their equipment and controls to provide a complete and efficient installation.
- F. Installing Contractor shall provide lists of previous installations for selected items of equipment. Contact persons who will serve as references, with telephone numbers and e-mail addresses shall be submitted with the references.
- G. Manufacturer's Literature and Data: Manufacturer's literature shall be submitted under the pertinent section rather than under this section.
  - 1. Electric motor data and variable speed drive data shall be submitted with the driven equipment.
  - 2. Equipment and materials identification.
  - 3. Firestopping materials.
  - 4. Hangers, inserts, supports and bracing. Provide load calculations for variable spring and constant support hangers.
  - 5. Wall, floor, and ceiling plates.
- H. Submittals and shop drawings for interdependent items, containing applicable descriptive information, shall be furnished together and complete in a group. Coordinate and properly integrate materials and equipment in each group to provide a completely compatible and efficient installation. Final review and approvals will be made only by groups.
- I. Coordination Drawings: Complete consolidated and coordinated layout drawings shall be submitted for all new systems, and for existing systems that are in the same areas. The drawings shall include plan

views, elevations and sections of all systems and shall be on a scale of not less than 1:32 (3/8 inch equal to one foot). Clearly identify and dimension the proposed locations of the principal items of equipment. The drawings shall clearly show the proposed location and adequate clearance for all equipment, controls, piping, pumps, valves and other items. All valves, trap primer valves, water hammer arrestors, strainers, and equipment requiring service shall be provided with an access door sized for the complete removal of plumbing device, component, or equipment. Equipment foundations shall not be installed until equipment or piping layout drawings have been approved. Detailed layout drawings shall be provided for all piping systems. In addition, details of the following shall be provided.

1. Mechanical equipment rooms.
2. Interstitial space.
3. Hangers, inserts, supports, and bracing.
4. Pipe sleeves.
5. Equipment penetrations of floors, walls, ceilings, or roofs.

J. Maintenance Data and Operating Instructions:

1. Maintenance and operating manuals in accordance with Section 01 00 00, GENERAL REQUIREMENTS, Article, INSTRUCTIONS, for systems and equipment. Include complete list indicating all components of the systems with diagrams of the internal wiring for each item of equipment.
2. Include listing of recommended replacement parts for keeping in stock supply, including sources of supply, for equipment shall be provided. The listing shall include belts for equipment: Belt manufacturer, model number, size and style, and distinguished whether of multiple belt sets.

K. Completed System Readiness Checklist provided by the Commissioning Agent and completed by the contractor, signed by a qualified technician and dated on the date of completion, in accordance with the requirements of Section 22 08 00 COMMISSIONING OF PLUMBING SYSTEMS.

L. Submit training plans, trainer qualifications and instructor qualifications in accordance with the requirements of Section 22 08 00 COMMISSIONING OF PLUMBING SYSTEMS.

## 1.5 QUALITY ASSURANCE

### A. Products Criteria:

1. Standard Products: Material and equipment shall be the standard products of a manufacturer regularly engaged in the manufacture, supply and servicing of the specified products for at least 5 years. However, digital electronics devices, software and systems such as controls, instruments, computer work station, shall be the current generation of technology and basic design that has a proven satisfactory service record of at least 5 years.
2. Equipment Service: There shall be permanent service organizations, authorized and trained by manufacturers of the equipment supplied, located within 160 km (100 miles) of the project. These organizations shall come to the site and provide acceptable service to restore operations within four hours of receipt of notification by phone, e-mail or fax in event of an emergency, such as the shut-down of equipment; or within 24 hours in a non-emergency. Names, mail and e-mail addresses and phone numbers of service organizations providing service under these conditions for (as applicable to the project): pumps, compressors, water heaters, critical instrumentation, computer workstation and programming shall be submitted for project record and inserted into the operations and maintenance manual.
3. All items furnished shall be free from defects that would adversely affect the performance, maintainability and appearance of individual components and overall assembly.
4. The products and execution of work specified in Division 22 shall conform to the referenced codes and standards as required by the specifications. Local codes and amendments enforced by the local code official shall be enforced, if required by local authorities such as the natural gas supplier. If the local codes are more stringent, then the local code shall apply. Any conflicts shall be brought to the attention of the Contracting Officers Representative (COR).
5. Multiple Units: When two or more units of materials or equipment of the same type or class are required, these units shall be products of one manufacturer.

6. Assembled Units: Manufacturers of equipment assemblies, which use components made by others, assume complete responsibility for the final assembled product.
  7. Nameplates: Nameplate bearing manufacturer's name or identifiable trademark shall be securely affixed in a conspicuous place on equipment, or name or trademark cast integrally with equipment, stamped or otherwise permanently marked on each item of equipment.
  8. Asbestos products or equipment or materials containing asbestos shall not be used.
  9. Bio-Based Materials: For products designated by the USDA's Bio-Preferred Program, provide products that meet or exceed USDA recommendations for bio-based content, so long as products meet all performance requirements in this specifications section. For more information regarding the product categories covered by the Bio-Preferred Program, visit <http://www.biopreferred.gov>.
- B. Welding: Before any welding is performed, contractor shall submit a certificate certifying that welders comply with the following requirements:
1. Qualify welding processes and operators for piping according to ASME "Boiler and Pressure Vessel Code", Section IX, "Welding and Brazing Qualifications".
  2. Comply with provisions of ASME B31 series "Code for Pressure Piping".
  3. Certify that each welder and welding operator has passed American Welding Society (AWS) qualification tests for the welding processes involved, and that certification is current.
  4. All welds shall be stamped according to the provisions of the American Welding Society.
- C. Manufacturer's Recommendations: Where installation procedures or any part thereof are required to be in accordance with the recommendations of the manufacturer of the material being installed, printed copies of these recommendations shall be furnished to the COR prior to installation. Installation of the item will not be allowed to proceed until the recommendations are received. Failure to furnish these recommendations can be cause for rejection of the material.
- D. Execution (Installation, Construction) Quality:
1. All items shall be applied and installed in accordance with manufacturer's written instructions. Conflicts between the

manufacturer's instructions and the contract documents shall be referred to the COR for resolution. Printed copies or electronic files of manufacturer's installation instructions shall be provided to the COR at least 10 working days prior to commencing installation of any item.

2. All items that require access, such as for operating, cleaning, servicing, maintenance, and calibration, shall be easily and safely accessible by persons standing at floor level, or standing on permanent platforms, without the use of portable ladders. Examples of these items include, but are not limited to: all types of valves, filters and strainers, transmitters, and control devices. Prior to commencing installation work, refer conflicts between this requirement and contract documents to COR for resolution.
3. Not Used.
4. Installer Qualifications: Installer shall be licensed and shall provide evidence of the successful completion of at least five projects of equal or greater size and complexity. Provide tradesmen skilled in the appropriate trade.
5. If an installation is unsatisfactory to the COR, the Contractor shall correct the installation at no additional cost or additional time to the Government.

E. Guaranty: Warranty of Construction, FAR clause 52.246-21.

F. Plumbing Systems: IPC, International Plumbing Code. Unless otherwise required herein, perform plumbing work in accordance with the latest version of the IPC. For IPC codes referenced in the contract documents, advisory provisions shall be considered mandatory, the word "should" shall be interpreted as "shall". Reference to the "code official" or "owner" shall be interpreted to mean the COR.

G. Cleanliness of Piping and Equipment Systems:

1. Care shall be exercised in the storage and handling of equipment and piping material to be incorporated in the work. Debris arising from cutting, threading and welding of piping shall be removed.
2. Piping systems shall be flushed, blown or pigged as necessary to deliver clean systems.
3. The interior of all tanks shall be cleaned prior to delivery and beneficial use by the Government. All piping shall be tested in accordance with the specifications and the International Plumbing



Code (IPC). All filters, strainers, fixture faucets shall be flushed of debris prior to final acceptance.

4. Contractor shall be fully responsible for all costs, damage, and delay arising from failure to provide clean systems.

#### **1.6 DELIVERY, STORAGE AND HANDLING**

##### **A. Protection of Equipment:**

1. Equipment and material placed on the job site shall remain in the custody of the Contractor until phased acceptance, whether or not the Government has reimbursed the Contractor for the equipment and material. The Contractor is solely responsible for the protection of such equipment and material against any damage.
2. Damaged equipment shall be replaced with an identical unit as determined and directed by the COR. Such replacement shall be at no additional cost or additional time to the Government.
3. Interiors of new equipment and piping systems shall be protected against entry of foreign matter. Both inside and outside shall be cleaned before painting or placing equipment in operation.
4. Existing equipment and piping being worked on by the Contractor shall be under the custody and responsibility of the Contractor and shall be protected as required for new work.

#### **1.7 AS-BUILT DOCUMENTATION**

- A. Submit manufacturer's literature and data updated to include submittal review comments and any equipment substitutions.
- B. Submit operation and maintenance data updated to include submittal review comments, substitutions and construction revisions shall be inserted into a three ring binder. All aspects of system operation and maintenance procedures, including piping isometrics, wiring diagrams of all circuits, a written description of system design, control logic, and sequence of operation shall be included in the operation and maintenance manual. The operations and maintenance manual shall include troubleshooting techniques and procedures for emergency situations. Notes on all special systems or devices such as damper and door closure interlocks shall be included. A List of recommended spare parts (manufacturer, model number, and quantity) shall be furnished. Information explaining any special knowledge or tools the owner will be required to employ shall be inserted into the As-Built documentation.

- C. The installing contractor shall maintain as-built drawings of each completed phase for verification; and, shall provide the complete set at the time of final systems certification testing. As-built drawings are to be provided, and a copy of them on Auto-Cad version 2014 provided on compact disk or DVD. Should the installing contractor engage the testing company to provide as-built or any portion thereof, it shall not be deemed a conflict of interest or breach of the 'third party testing company' requirement.
- D. Certification documentation shall be provided prior to submitting the request for final inspection. The documentation shall include all test results, the names of individuals performing work for the testing agency on this project, detailed procedures followed for all tests, and a certification that all results of tests were within limits specified.

## **PART 2 - PRODUCTS**

### **2.1 MATERIALS FOR VARIOUS SERVICES**

- A. Not Used.
- B. Solder or flux containing lead shall not be used with copper pipe.
- C. Material or equipment containing a weighted average of greater than 0.25 percent lead shall not be used in any potable water system intended for human consumption, and shall be certified in accordance with NSF 61 or NSF 372.
- D. In-line devices such as water meters, building valves, check valves, stops, valves, fittings, tanks and backflow preventers shall comply with NSF 61 and NSF 372.
- E. End point devices such as drinking fountains, lavatory faucets, kitchen and bar faucets, ice makers supply stops, and end-point control valves used to dispense drinking water must meet requirements of NSF 61 and NSF 372.

### **2.2 FACTORY-ASSEMBLED PRODUCTS**

- A. Standardization of components shall be maximized to reduce spare part requirements.
- B. Manufacturers of equipment assemblies that include components made by others shall assume complete responsibility for final assembled unit.
  - 1. All components of an assembled unit need not be products of same manufacturer.
  - 2. Constituent parts that are alike shall be products of a single manufacturer.

3. Components shall be compatible with each other and with the total assembly for intended service.
  4. Contractor shall guarantee performance of assemblies of components, and shall repair or replace elements of the assemblies as required to deliver specified performance of the complete assembly at no additional cost or time to the Government.
- C. Components of equipment shall bear manufacturer's name and trademark, model number, serial number and performance data on a name plate securely affixed in a conspicuous place, or cast integral with, stamped or otherwise permanently marked upon the components of the equipment.
- D. Major items of equipment, which serve the same function, shall be the same make and model.

### **2.3 COMPATIBILITY OF RELATED EQUIPMENT**

- A. Equipment and materials installed shall be compatible in all respects with other items being furnished and with existing items so that the result will be a complete and fully operational system that conforms to contract requirements.

### **2.4 SAFETY GUARDS**

- A. Pump shafts and couplings shall be fully guarded by a sheet steel guard, covering coupling and shaft but not bearings. Material shall be minimum 16-gage sheet steel; ends shall be braked and drilled and attached to pump base with minimum of four 8 mm (1/4 inch) bolts. Reinforce guard as necessary to prevent side play forcing guard onto couplings.
- B. All Equipment shall have moving parts protected from personal injury.

### **2.5 LIFTING ATTACHMENTS**

- A. Equipment shall be provided with suitable lifting attachments to enable equipment to be lifted in its normal position. Lifting attachments shall withstand any handling conditions that might be encountered, without bending or distortion of shape, such as rapid lowering and braking of load.

### **2.6 ELECTRIC MOTORS, MOTOR CONTROL, CONTROL WIRING**

- A. All material and equipment furnished and installation methods used shall conform to the requirements of Section 22 05 12, GENERAL MOTOR REQUIREMENTS FOR PLUMBING EQUIPMENT; Section 26 29 11, MOTOR CONTROLLERS; and, Section 26 05 19, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES. All electrical wiring, conduit, and devices necessary for the proper connection, protection and operation of the

systems shall be provided. Premium efficient motors shall be provided. Unless otherwise specified for a particular application, electric motors shall have the following requirements.

B. Special Requirements:

1. Where motor power requirements of equipment furnished deviate from power shown on plans, provide electrical service designed under the requirements of NFPA 70 without additional cost or time to the Government.
2. Assemblies of motors, starters, and controls and interlocks on factory assembled and wired devices shall be in accordance with the requirements of this specification.
3. Wire and cable materials specified in the electrical division of the specifications shall be modified as follows:
  - a. Wiring material located where temperatures can exceed 71° C (160° F) shall be stranded copper with Teflon FEP insulation with jacket. This includes wiring on the boilers and water heaters.
  - b. Other wiring at boilers and water heaters, and to control panels, shall be NFPA 70 designation THWN.
  - c. Shielded conductors or wiring in separate conduits for all instrumentation and control systems shall be provided where recommended by manufacturer of equipment.
4. Motor sizes shall be selected so that the motors do not operate into the service factor at maximum required loads on the driven equipment. Motors on pumps shall be sized for non-overloading at all points on the pump performance curves.
5. Motors utilized with variable frequency drives shall be rated "inverter-ready" per NEMA Standard, MG1.

- C. Motor Efficiency and Power Factor: All motors, when specified as "high efficiency or Premium Efficiency" by the project specifications on driven equipment, shall conform to efficiency and power factor requirements in Section 22 05 12, GENERAL MOTOR REQUIREMENTS FOR PLUMBING EQUIPMENT, with no consideration of annual service hours. Motor manufacturers generally define these efficiency requirements as "NEMA premium efficient" and the requirements generally exceed those of the Energy Policy Act (EPACT), revised 2005. Motors not specified as "high efficiency or premium efficient" shall comply with EPACT.

- D. Single-phase Motors: Capacitor-start type for hard starting applications. Motors for centrifugal pumps may be split phase or permanent split capacitor (PSC).
- E. Poly-phase Motors: NEMA Design B, Squirrel cage, induction type. Each two-speed motor shall have two separate windings. A time delay (20 seconds minimum) relay shall be provided for switching from high to low speed.
- F. Rating: Rating shall be continuous duty at 100 percent capacity in an ambient temperature of 40° C (104° F); minimum horsepower as shown on drawings; maximum horsepower in normal operation shall not exceed nameplate rating without service factor.
- G. Insulation Resistance: Not less than one-half meg-ohm between stator conductors and frame shall be measured at the time of final inspection.

## **2.7 VARIABLE SPEED MOTOR CONTROLLERS**

- A. Refer to Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS and Section 26 29 11, MOTOR CONTROLLERS for specifications.
- B. The combination of controller and motor shall be provided by the respective pump manufacturer, and shall be rated for 100 percent output performance. Multiple units of the same class of equipment, i.e. pumps, shall be product of a single manufacturer.
- C. Motors shall be premium efficient type, "invertor duty", and be approved by the motor controller manufacturer. The controller-motor combination shall be guaranteed to provide full motor nameplate horsepower in variable frequency operation. Both driving and driven motor sheaves shall be fixed pitch.
- D. Controller shall not add any current or voltage transients to the input AC power distribution system, DDC controls, sensitive medical equipment, etc., nor shall be affected from other devices on the AC power system.

## **2.8 EQUIPMENT AND MATERIALS IDENTIFICATION**

- A. Use symbols, nomenclature and equipment numbers specified, shown on the drawings, or shown in the maintenance manuals. Coordinate equipment and valve identification with local VAMC shops. In addition, provide bar code identification nameplate for all equipment which will allow the equipment identification code to be scanned into the system for maintenance and inventory tracking. Identification for piping is specified in Section 09 91 00, PAINTING.

- B. Interior (Indoor) Equipment: Engraved nameplates, with letters not less than 7 mm (3/16 inch) high of brass with black-filled letters, or rigid black plastic with white letters specified in Section 09 91 00, PAINTING shall be permanently fastened to the equipment. Unit components such as water heaters, tanks, coils, filters, etc. shall be identified.
- C. Exterior (Outdoor) Equipment: Brass nameplates, with engraved black filled letters, not less than 7 mm (3/16 inch) high riveted or bolted to the equipment.
- D. Control Items: All temperature, pressure, and controllers shall be labeled and the component's function identified. Identify and label each item as they appear on the control diagrams.
- E. Valve Tags and Lists:
  - 1. Plumbing: All valves shall be provided with valve tags and listed on a valve list (Fixture stops not included).
  - 2. Valve tags: Engraved black filled numbers and letters not less than 15 mm (1/2 inch) high for number designation, and not less than 8 mm (1/4 inch) for service designation on 19 gage, 40 mm (1-1/2 inches) round brass disc, attached with brass "S" hook or brass chain.
  - 3. Valve lists: Valve lists shall be created using a word processing program and printed on plastic coated cards. The plastic coated valve list card(s), sized 215 mm (8-1/2 inches) by 275 mm (11 inches) shall show valve tag number, valve function and area of control for each service or system. The valve list shall be in a punched 3-ring binder notebook. An additional copy of the valve list shall be mounted in picture frames for mounting to a wall. COR shall instruct contractor where frames shall be mounted.
  - 4. A detailed plan for each floor of the building indicating the location and valve number for each valve shall be provided in the 3-ring binder notebook. Each valve location shall be identified with a color coded sticker or thumb tack in ceiling or access door.

## **2.9 FIRESTOPPING**

- A. Section 07 84 00, FIRESTOPPING specifies an effective barrier against the spread of fire, smoke and gases where penetrations occur for piping. Refer to Section 22 07 11, PLUMBING INSULATION, for pipe insulation.

## **2.10 GALVANIZED REPAIR COMPOUND**

- A. Mil. Spec. DOD-P-21035B, paint.

## 2.11 PIPE AND EQUIPMENT SUPPORTS AND RESTRAINTS

- A. In lieu of the paragraph which follows, suspended equipment support and restraints may be designed and installed in accordance with the International Building Code (IBC) Submittals based on the International Building Code (IBC) requirements, or the following paragraphs of this Section shall be stamped and signed by a professional engineer registered in the state where the project is located. The Support system of suspended equipment over 227 kg (500 pounds) shall be submitted for approval of the COR in all cases. See the above specifications for lateral force design requirements.
- B. Type Numbers Specified: For materials, design, manufacture, selection, application, and installation refer to MSS SP-58. For selection and application refer to MSS SP-69. Refer to Section 05 50 00, METAL FABRICATIONS, for miscellaneous metal support materials and prime coat painting.
- C. For Attachment to Concrete Construction:
  - 1. Concrete insert: Type 18, MSS SP-58.
  - 2. Self-drilling expansion shields and machine bolt expansion anchors: Permitted in concrete not less than 100 mm (4 inches) thick when approved by the COR for each job condition.
  - 3. Power-driven fasteners: Permitted in existing concrete or masonry not less than 100 mm (4 inches) thick when approved by the COR for each job condition.
- D. For Attachment to Steel Construction: MSS SP-58.
  - 1. Welded attachment: Type 22.
  - 2. Beam clamps: Types 20, 21, 28 or 29. Type 23 C-clamp may be used for individual copper tubing up to 23 mm (7/8 inch) outside diameter.
- E. Attachment to Metal Pan or Deck: As required for materials specified in Section 05 31 00, STEEL DECKING. Section 05 36 00, COMPOSITE METAL DECKING.
- F. For Attachment to Wood Construction: Wood screws or lag bolts.
- G. Hanger Rods: Hot-rolled steel, ASTM A36/A36M or ASTM A575 for allowable load listed in MSS SP-58. For piping, provide adjustment means for controlling level or slope. Types 13 or 15 turn-buckles shall provide 40 mm (1-1/2 inches) minimum of adjustment and incorporate locknuts. All-thread rods are acceptable.
- H. Multiple (Trapeze) Hangers: Galvanized, cold formed, lipped steel channel horizontal member, not less than 43 mm by 43 mm (1-5/8 inches

by 1-5/8 inches), 2.7 mm (No. 12 gage), designed to accept special spring held, hardened steel nuts.

1. Allowable hanger load: Manufacturers rating less 91kg (200 pounds).
2. Guide individual pipes on the horizontal member of every other trapeze hanger with 8 mm (1/4 inch) U-bolt fabricated from steel rod. Provide Type 40 insulation shield, secured by two 15 mm (1/2 inch) galvanized steel bands, or insulated calcium silicate shield for insulated piping at each hanger.

I. Pipe Hangers and Supports: (MSS SP-58), use hangers sized to encircle insulation on insulated piping. Refer to Section 22 07 11, PLUMBING INSULATION for insulation thickness. To protect insulation, provide Type 39 saddles for roller type supports or insulated calcium silicate shields. Provide Type 40 insulation shield or insulated calcium silicate shield at all other types of supports and hangers including those for insulated piping.

1. General Types (MSS SP-58):

- a. Standard clevis hanger: Type 1; provide locknut.
- b. Riser clamps: Type 8.
- c. Wall brackets: Types 31, 32 or 33.
- d. Roller supports: Type 41, 43, 44 and 46.
- e. Saddle support: Type 36, 37 or 38.
- f. Turnbuckle: Types 13 or 15.
- g. U-bolt clamp: Type 24.
- h. Copper Tube:

- 1) Hangers, clamps and other support material in contact with tubing shall be painted with copper colored epoxy paint, copper-coated, plastic coated or taped with isolation tape to prevent electrolysis.
- 2) For vertical runs use epoxy painted, copper-coated or plastic coated riser clamps.
- 3) For supporting tube to strut: Provide epoxy painted pipe straps for copper tube or plastic inserted vibration isolation clamps.
- 4) Insulated Lines: Provide pre-insulated calcium silicate shields sized for copper tube.

i. Not Used.

j. Spring hangers are required on all plumbing system pumps one horsepower and greater.



2. Plumbing Piping (Other Than General Types):

- a. Horizontal piping: Type 1, 5, 7, 9, and 10.
- b. Chrome plated piping: Chrome plated supports.
- c. Hangers and supports in pipe chase: Prefabricated system ABS self-extinguishing material, not subject to electrolytic action, to hold piping, prevent vibration and compensate for all static and operational conditions.
- d. Blocking, stays and bracing: Angle iron or preformed metal channel shapes, 1.3 mm (18 gage) minimum.

J. Pre-insulated Calcium Silicate Shields:

- 1. Provide 360 degree water resistant high density 965 kPa (140 psig) compressive strength calcium silicate shields encased in galvanized metal.
- 2. Pre-insulated calcium silicate shields to be installed at the point of support during erection.
- 3. Shield thickness shall match the pipe insulation.
- 4. The type of shield is selected by the temperature of the pipe, the load it must carry, and the type of support it will be used with.
  - a. Shields for supporting cold water shall have insulation that extends a minimum of 25 mm (1 inch) past the sheet metal.
  - b. The insulated calcium silicate shield shall support the maximum allowable water filled span as indicated in MSS SP-69. To support the load, the shields shall have one or more of the following features: structural inserts 4138 kPa (600 psig) compressive strength, an extra bottom metal shield, or formed structural steel (ASTM A36/A36M) wear plates welded to the bottom sheet metal jacket.
- 5. Shields may be used on steel clevis hanger type supports, trapeze hangers, roller supports or flat surfaces.

**2.12 PIPE PENETRATIONS**

- A. Pipe penetration sleeves shall be installed for all pipe other than rectangular blocked out floor openings for risers in mechanical bays.
- B. Pipe penetration sleeve materials shall comply with all firestopping requirements for each penetration.
- C. To prevent accidental liquid spills from passing to a lower level, provide the following:
  - 1. For sleeves: Extend sleeve 25 mm (1 inch) above finished floor and provide sealant for watertight joint.

2. For blocked out floor openings: Provide 40 mm (1-1/2 inch) angle set in silicone adhesive around opening.
  3. For drilled penetrations: Provide 40 mm (1-1/2 inch) angle ring or square set in silicone adhesive around penetration.
- D. Penetrations are not allowed through beams or ribs, but may be installed in concrete beam flanges, with structural engineer prior approval. Any deviation from these requirements must receive prior approval of COR.
- E. Sheet metal, plastic, or moisture resistant fiber sleeves shall be provided for pipe passing through floors, interior walls, and partitions, unless brass or steel pipe sleeves are specifically called for below.
- F. Cast iron or zinc coated pipe sleeves shall be provided for pipe passing through exterior walls below grade. The space between the sleeve and pipe shall be made watertight with a modular or link rubber seal. The link seal shall be applied at both ends of the sleeve.
- G. Galvanized steel or an alternate black iron pipe with asphalt coating sleeves shall be for pipe passing through concrete beam flanges, except where brass pipe sleeves are called for. A galvanized steel sleeve shall be provided for pipe passing through floor of mechanical rooms, laundry work rooms, and animal rooms above basement. Except in mechanical rooms, sleeves shall be connected with a floor plate.
- H. Brass Pipe Sleeves shall be provided for pipe passing through quarry tile, terrazzo or ceramic tile floors. The sleeve shall be connected with a floor plate.
- I. Sleeve clearance through floors, walls, partitions, and beam flanges shall be 25 mm (1 inch) greater in diameter than external diameter of pipe. Sleeve for pipe with insulation shall be large enough to accommodate the insulation plus 25 mm (1 inch) in diameter. Interior openings shall be caulked tight with firestopping material and sealant to prevent the spread of fire, smoke, water and gases.
- J. Sealant and Adhesives: Shall be as specified in Section 07 92 00, JOINT SEALANTS. Bio-based materials shall be utilized when possible.
- K. Pipe passing through roof shall be installed through a 4.9 kg per square meter copper flashing with an integral skirt or flange. Skirt or flange shall extend not less than 200 mm (8 inches) from the pipe and set in a solid coating of bituminous cement. Extend flashing a minimum of 250 mm (10 inches) up the pipe. Pipe passing through a waterproofing

membrane shall be provided with a clamping flange. The annular space between the sleeve and pipe shall be sealed watertight.

### **2.13 TOOLS AND LUBRICANTS**

- A. Furnish, and turn over to the COR, special tools not readily available commercially, that are required for disassembly or adjustment of equipment and machinery furnished.
- B. Grease Guns with Attachments for Applicable Fittings: One for each type of grease required for each motor or other equipment.
- C. Tool Containers: metal, permanently identified for intended service and mounted, or located, where directed by the COR.
- D. Lubricants: A minimum of 0.95 L (1 quart) of oil, and 0.45 kg (1 pound) of grease, of equipment manufacturer's recommended grade and type, in unopened containers and properly identified as to use for each different application. Bio-based materials shall be utilized when possible.

### **2.14 WALL, FLOOR AND CEILING PLATES**

- A. Material and Type: Chrome plated brass or chrome plated steel, one piece or split type with concealed hinge, with set screw for fastening to pipe, or sleeve. Use plates that fit tight around pipes, cover openings around pipes and cover the entire pipe sleeve projection.
- B. Thickness: Not less than 2.4 mm (3/32 inch) for floor plates. For wall and ceiling plates, not less than 0.64 mm (0.025 inch) for up to 75 mm (3 inch) pipe, 0.89 mm (0.035 inch) for larger pipe.
- C. Locations: Use where pipe penetrates floors, walls and ceilings in exposed locations, in finished areas only. Wall plates shall be used where insulation ends on exposed water supply pipe drop from overhead. A watertight joint shall be provided in spaces where brass or steel pipe sleeves are specified.

### **2.15 ASBESTOS**

- A. Materials containing asbestos are not permitted.

## **PART 3 - EXECUTION**

### **3.1 ARRANGEMENT AND INSTALLATION OF EQUIPMENT AND PIPING**

- A. Location of piping, sleeves, inserts, hangers, and equipment, access provisions shall be coordinated with the work of all trades. Piping, sleeves, inserts, hangers, and equipment shall be located clear of windows, doors, openings, light outlets, and other services and utilities. Equipment layout drawings shall be prepared to coordinate

proper location and personnel access of all facilities. The drawings shall be submitted for review.

- B. Manufacturer's published recommendations shall be followed for installation methods not otherwise specified.
- C. Operating Personnel Access and Observation Provisions: All equipment and systems shall be arranged to provide clear view and easy access, without use of portable ladders, for maintenance, testing and operation of all devices including, but not limited to: all equipment items, valves, backflow preventers, filters, strainers, transmitters, sensors, meters and control devices. All gages and indicators shall be clearly visible by personnel standing on the floor or on permanent platforms. Maintenance and operating space and access provisions that are shown on the drawings shall not be changed nor reduced.
- D. Structural systems necessary for pipe and equipment support shall be coordinated to permit proper installation.
- E. Location of pipe sleeves, trenches and chases shall be accurately coordinated with equipment and piping locations.
- F. Cutting Holes:
  - 1. Holes shall be located to avoid interference with structural members such as beams or grade beams. Holes shall be laid out in advance and drilling done only after approval by COR. If the Contractor considers it necessary to drill through structural members, this matter shall be referred to COR for approval.
  - 2. Waterproof membrane shall not be penetrated. Pipe floor penetration block outs shall be provided outside the extents of the waterproof membrane.
  - 3. Holes through concrete and masonry shall be cut by rotary core drill. Pneumatic hammer, impact electric, and hand or manual hammer type drill will not be allowed, except as permitted by COR where working area space is limited.
- G. Minor Piping: Generally, small diameter pipe runs from drips and drains, water cooling, and other services are not shown but must be provided.
- H. Protection and Cleaning:
  - 1. Equipment and materials shall be carefully handled, properly stored, and adequately protected to prevent damage before and during installation, in accordance with the manufacturer's recommendations and as approved by the COR. Damaged or defective items in the

- opinion of the COR, shall be replaced at no additional cost or time to the Government.
2. Protect all finished parts of equipment, such as shafts and bearings where accessible, from rust prior to operation by means of protective grease coating and wrapping. Close pipe openings with caps or plugs during installation. Pipe openings, equipment, and plumbing fixtures shall be tightly covered against dirt or mechanical injury. At completion of all work thoroughly clean fixtures, exposed materials and equipment.
- I. Concrete and Grout: Concrete and shrink compensating grout 25 MPa (3000 psig) minimum, specified in Section 03 30 00, CAST-IN-PLACE CONCRETE, shall be used for all pad or floor mounted equipment.
  - J. Gages, thermometers, valves and other devices shall be installed with due regard for ease in reading or operating and maintaining said devices. Thermometers and gages shall be located and positioned to be easily read by operator or staff standing on floor or walkway provided. Servicing shall not require dismantling adjacent equipment or pipe work.
  - K. Interconnection of Controls and Instruments: Electrical interconnection is generally not shown but shall be provided. This includes interconnections of sensors, transmitters, transducers, control devices, control and instrumentation panels, alarms, instruments and computer workstations. Comply with NFPA 70.
  - L. Many plumbing systems interface with the HVAC control system. See the HVAC control points list and Section 23 09 23, DIRECT DIGITAL CONTROL SYSTEM FOR HVAC.
  - M. Work in Existing Building:
    1. Perform as specified in Article, OPERATIONS AND STORAGE AREAS, Article, ALTERATIONS, and Article, RESTORATION of the Section 01 00 00, GENERAL REQUIREMENTS for relocation of existing equipment, alterations and restoration of existing building(s).
    2. As specified in Section 01 00 00, GENERAL REQUIREMENTS, Article, OPERATIONS AND STORAGE AREAS, make alterations to existing service piping at times that will cause the least interfere with normal operation of the facility.
  - N. Not Used.
  - O. Work in bathrooms, restrooms, housekeeping closets: All pipe penetrations behind escutcheons shall be sealed with plumbers putty.

P. Switchgear Drip Protection: Every effort shall be made to eliminate the installation of pipe above data equipment, and electrical and telephone switchgear. If this is not possible, encase pipe in a second pipe with a minimum of joints. Drain valve shall be provided in low point of casement pipe.

Q. Inaccessible Equipment:

1. Where the Government determines that the Contractor has installed equipment not conveniently accessible for operation and maintenance, equipment shall be removed and reinstalled or remedial action performed as directed at no additional cost or additional time to the Government.
2. The term "conveniently accessible" is defined as capable of being reached without the use of ladders, or without climbing or crawling under or over obstacles such as electrical conduit, motors, fans, pumps, belt guards, transformers, high voltage lines, piping, and ductwork.

### **3.2 TEMPORARY PIPING AND EQUIPMENT**

- A. Continuity of operation of existing facilities may require temporary installation or relocation of equipment and piping. Temporary equipment or pipe installation or relocation shall be provided to maintain continuity of operation of existing facilities.
- B. The Contractor shall provide all required facilities in accordance with the requirements of phased construction and maintenance of service. All piping and equipment shall be properly supported, sloped to drain, operate without excessive stress, and shall be insulated where injury can occur to personnel by contact with operating facilities. The requirements of paragraph 3.1 shall apply.
- C. Temporary facilities and piping shall be completely removed back to the nearest active distribution branch or main pipe line and any openings in structures sealed. Dead legs are not allowed in potable water systems. Necessary blind flanges and caps shall be provided to seal open piping remaining in service.

### **3.3 RIGGING**

- A. Openings in building structures shall be planned to accommodate design scheme.
- B. Alternative methods of equipment delivery may be offered and will be considered by Government under specified restrictions of phasing and service requirements as well as structural integrity of the building.

- C. All openings in the building shall be closed when not required for rigging operations to maintain proper environment in the facility for Government operation and maintenance of service.
- D. Contractor shall provide all facilities required to deliver specified equipment and place on foundations. Attachments to structures for rigging purposes and support of equipment on structures shall be Contractor's full responsibility.
- E. Contractor shall check all clearances, weight limitations and shall provide a rigging plan designed by a Registered Professional Engineer. All modifications to structures, including reinforcement thereof, shall be at Contractor's cost, time and responsibility.
- F. Rigging plan and methods shall be referred to COR for evaluation prior to actual work.

### **3.4 PIPE AND EQUIPMENT SUPPORTS**

- A. Where hanger spacing does not correspond with joist or rib spacing, use structural steel channels secured directly to joist and rib structure that will correspond to the required hanger spacing, and then suspend the equipment and piping from the channels. Holes shall be drilled or burned in structural steel ONLY with the prior written approval of the COR.
- B. The use of chain pipe supports, wire or strap hangers; wood for blocking, stays and bracing, or hangers suspended from piping above shall not be permitted. Rusty products shall be replaced.
- C. Hanger rods shall be used that are straight and vertical. Turnbuckles for vertical adjustments may be omitted where limited space prevents use. A minimum of 15 mm (1/2 inch) clearance between pipe or piping covering and adjacent work shall be provided.
- D. For horizontal and vertical plumbing pipe supports, refer to the International Plumbing Code (IPC) and these specifications.
- E. Overhead Supports:
  - 1. The basic structural system of the building is designed to sustain the loads imposed by equipment and piping to be supported overhead.
  - 2. Provide steel structural members, in addition to those shown, of adequate capability to support the imposed loads, located in accordance with the final approved layout of equipment and piping.
  - 3. Tubing and capillary systems shall be supported in channel troughs.

**F. Floor Supports:**

1. Provide concrete bases, concrete anchor blocks and pedestals, and structural steel systems for support of equipment and piping.  
Concrete bases and structural systems shall be anchored and doweled to resist forces under operating and seismic conditions (if applicable) without excessive displacement or structural failure.
2. Bases and supports shall not be located and installed until equipment mounted thereon has been approved. Bases shall be sized to match equipment mounted thereon plus 50 mm (2 inch) excess on all edges. Structural drawings shall be reviewed for additional requirements. Bases shall be neatly finished and smoothed, shall have chamfered edges at the top, and shall be suitable for painting.
3. All equipment shall be shimmed, leveled, firmly anchored, and grouted with epoxy grout. Anchor bolts shall be placed in sleeves, anchored to the bases. Fill the annular space between sleeves and bolts with a grout material to permit alignment and realignment.
4. Not Used.

**3.5 LUBRICATION**

- A. All equipment and devices requiring lubrication shall be lubricated prior to initial operation. All devices and equipment shall be field checked for proper lubrication.
- B. All devices and equipment shall be equipped with required lubrication fittings. A minimum of one liter (one quart) of oil and 0.45 kg (1 pound) of grease of manufacturer's recommended grade and type for each different application shall be provided. All materials shall be delivered to COR in unopened containers that are properly identified as to application.
- C. Not Used.
- D. All lubrication points shall be accessible without disassembling equipment, except to remove access plates.
- E. All lubrication points shall be extended to one side of the equipment.

**3.6 PLUMBING SYSTEMS DEMOLITION**

- A. Rigging access, other than indicated on the drawings, shall be provided after approval for structural integrity by the COR. Such access shall be provided without additional cost or time to the Government. Where work is in an operating plant, approved protection from dust and debris shall be provided at all times for the safety of plant personnel and maintenance of plant operation and environment of the plant.



- B. In an operating plant, cleanliness and safety shall be maintained. The plant shall be kept in an operating condition. Government personnel will be carrying on their normal duties of operating, cleaning and maintaining equipment and plant operation. Work shall be confined to the immediate area concerned; maintain cleanliness and wet down demolished materials to eliminate dust. Dust and debris shall not be permitted to accumulate in the area to the detriment of plant operation. All flame cutting shall be performed to maintain the fire safety integrity of this plant. Adequate fire extinguishing facilities shall be available at all times. All work shall be performed in accordance with recognized fire protection standards including NFPA 51B. Inspections will be made by personnel of the VA Medical Center, and the Contractor shall follow all directives of the COR with regard to rigging, safety, fire safety, and maintenance of operations.
- C. Unless specified otherwise, all piping, wiring, conduit, and other devices associated with the equipment not re-used in the new work shall be completely removed from Government property per Section 01 74 19, CONSTRUCTION WASTE MANAGEMENT. This includes all concrete equipment pads, pipe, valves, fittings, insulation, and all hangers including the top connection and any fastenings to building structural systems. All openings shall be sealed after removal of equipment, pipes, ducts, and other penetrations in roof, walls, floors, in an approved manner and in accordance with plans and specifications where specifically covered. Structural integrity of the building system shall be maintained. Reference shall also be made to the drawings and specifications of the other disciplines in the project for additional facilities to be demolished or handled.
- D. All valves including gate, globe, ball, butterfly and check, all pressure gages and thermometers with wells shall remain Government property and shall be removed and delivered to COR and stored as directed. The Contractor shall remove all other material and equipment, devices and demolition debris under these plans and specifications. Such material shall be removed from Government property expeditiously and shall not be allowed to accumulate. Coordinate with the COR and Infection Control.

### **3.7 CLEANING AND PAINTING**

- A. Prior to final inspection and acceptance of the plant and facilities for beneficial use by the Government, the plant facilities, equipment

and systems shall be thoroughly cleaned and painted. Refer to Section 09 91 00, PAINTING.

B. In addition, the following special conditions apply:

1. Cleaning shall be thorough. Solvents, cleaning materials and methods recommended by the manufacturers shall be used for the specific tasks. All rust shall be removed prior to painting and from surfaces to remain unpainted. Scratches, scuffs, and abrasions shall be repaired prior to applying prime and finish coats.
2. The following Material and Equipment shall NOT be painted:
  - a. Motors, controllers, control switches, and safety switches.
  - b. Control and interlock devices.
  - c. Regulators.
  - d. Pressure reducing valves.
  - e. Control valves and thermostatic elements.
  - f. Lubrication devices and grease fittings.
  - g. Copper, brass, aluminum, stainless steel and bronze surfaces.
  - h. Valve stems and rotating shafts.
  - i. Pressure gages and thermometers.
  - j. Glass.
  - k. Name plates.
3. Control and instrument panels shall be cleaned and damaged surfaces repaired. Touch-up painting shall be made with matching paint type and color obtained from manufacturer or computer matched.
4. Pumps, motors, steel and cast iron bases, and coupling guards shall be cleaned, and shall be touched-up with the same paint type and color as utilized by the pump manufacturer.
5. Temporary Facilities: Apply paint to surfaces that do not have existing finish coats per Section 09 91 00, Painting.
6. The final result shall be a smooth, even-colored, even-textured factory finish on all items. The entire piece of equipment shall be repainted, if necessary, to achieve this. Lead based paints shall not be used.

### **3.8 IDENTIFICATION SIGNS**

- A. Laminated plastic signs, with engraved lettering not less than 7 mm (3/16 inch) high, shall be provided that designates equipment function, for all equipment, switches, motor controllers, relays, meters, control devices, including automatic control valves. Nomenclature and identification symbols shall correspond to that used in maintenance

manual, and in diagrams specified elsewhere. Attach by chain, adhesive, or screws.

B. Factory Built Equipment: Metal plate, securely attached, with name and address of manufacturer, serial number, model number, size, and performance data shall be placed on factory built equipment.

C. Pipe Identification: Refer to Section 09 91 00, PAINTING.

### **3.9 STARTUP AND TEMPORARY OPERATION**

A. Startup of equipment shall be performed as described in the equipment specifications. Vibration within specified tolerance shall be verified prior to extended operation. Temporary use of equipment is specified in Section 01 00 00, GENERAL REQUIREMENTS, Article, TEMPORARY USE OF MECHANICAL AND ELECTRICAL EQUIPMENT.

B. The commissioning Agent will observe startup and contractor testing of selected equipment. Coordinate the startup and contractor testing schedules with the Contracting Officer's Representative and Commissioning Agent. Provide a minimum of 2 weeks prior notice.

### **3.10 OPERATING AND PERFORMANCE TESTS**

A. Prior to the final inspection, all required tests shall be performed as specified in Section 01 00 00, GENERAL REQUIREMENTS, Article, TESTS and submit the test reports and records to the COR.

B. Should evidence of malfunction in any tested system, or piece of equipment or component part thereof, occur during or as a result of tests, make proper corrections, repairs or replacements, and repeat tests at no additional cost to the Government.

C. When completion of certain work or systems occurs at a time when final control settings and adjustments cannot be properly made to make performance tests, then conduct such performance tests and finalize control settings during the first actual seasonal use of the respective systems following completion of work. Rescheduling of these tests shall be requested in writing to COR for approval.

D. Perform tests as required for commissioning provisions in accordance with Section 22 08 00, COMMISSIONING OF PLUMBING SYSTEMS and Section 01 91 00, GENERAL COMMISSIONING REQUIREMENTS.

### **3.11 OPERATION AND MAINTENANCE MANUALS**

A. All new and temporary equipment and all elements of each assembly shall be included.

- B. Data sheet on each device listing model, size, capacity, pressure, speed, horsepower, impeller size, and other information shall be included.
- C. Manufacturer's installation, maintenance, repair, and operation instructions for each device shall be included. Assembly drawings and parts lists shall also be included. A summary of operating precautions and reasons for precautions shall be included in the Operations and Maintenance Manual.
- D. Lubrication instructions, type and quantity of lubricant shall be included.
- E. Schematic diagrams and wiring diagrams of all control systems corrected to include all field modifications shall be included.
- F. Set points of all interlock devices shall be listed.
- G. Trouble-shooting guide for the control system troubleshooting shall be inserted into the Operations and Maintenance Manual.
- H. The control system sequence of operation corrected with submittal review comments shall be inserted into the Operations and Maintenance Manual.
- I. Emergency procedures for shutdown and startup of equipment and systems.

### **3.12 COMMISSIONING**

- A. Provide commissioning documentation in accordance with the requirements of Section 22 08 00, COMMISSIONING OF PLUMBING SYSTEMS.
- B. Components provided under this section of the specification will be tested as part of a larger system.

### **3.13 DEMONSTRATION AND TRAINING**

- A. Provide services of manufacturer's technical representative for four hours to instruct VA Personnel in operation and maintenance of the system.
- B. Submit training plans and instructor qualifications in accordance with the requirements of Section 22 08 00, COMMISSIONING OF PLUMBING SYSTEMS.

- - - E N D - - -

**SECTION 22 05 23**  
**GENERAL-DUTY VALVES FOR PLUMBING PIPING**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section describes the requirements for general-duty valves for domestic water and sewer systems.
- B. A complete listing of all acronyms and abbreviations are included in Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.

**1.2 RELATED WORK**

- A. Section 01 00 00, GENERAL REQUIREMENTS.
- B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA AND SAMPLES.
- C. Section 01 81 13, SUSTAINABLE CONSTRUCTION REQUIREMENTS.
- D. Not Used.
- E. Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.

**1.3 APPLICABLE PUBLICATIONS**

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American Society of Mechanical Engineers (ASME):  
A112.14.1-2003.....Backwater Valves
- C. American Society of Sanitary Engineering (ASSE):  
1001-2008.....Performance Requirements for Atmospheric Type  
Vacuum Breakers  
1003-2009.....Performance Requirements for Water Pressure  
Reducing Valves for Domestic Water Distribution  
Systems  
1011-2004.....Performance Requirements for Hose Connection  
Vacuum Breakers  
1013-2011.....Performance Requirements for Reduced Pressure  
Principle Backflow Preventers and Reduced  
Pressure Principle Fire Protection Backflow  
Preventers  
1015-2011.....Performance Requirements for Double Check  
Backflow Prevention Assemblies and Double Check  
Fire Protection Backflow Prevention Assemblies  
1017-2009.....Performance Requirements for Temperature  
Actuated Mixing Valves for Hot Water  
Distribution Systems

- 1020-2004.....Performance Requirements for Pressure Vacuum  
Breaker Assembly
- 1035-2008.....Performance Requirements for Laboratory Faucet  
Backflow Preventers
- 1069-2005.....Performance Requirements for Automatic  
Temperature Control Mixing Valves
- 1070-2004.....Performance Requirements for Water Temperature  
Limiting Devices
- 1071-2012.....Performance Requirements for Temperature  
Actuated Mixing Valves for Plumbed Emergency  
Equipment
- D. American Society for Testing and Materials (ASTM):
- A126-2004(R2009).....Standard Specification for Gray Iron Castings  
for Valves, Flanges, and Pipe Fittings
- A276-2013a.....Standard Specification for Stainless Steel Bars  
and Shapes
- A536-1984(R2009).....Standard Specification for Ductile Iron  
Castings
- B62-2009.....Standard Specification for Composition Bronze  
or Ounce Metal Castings
- B584-2013.....Standard Specification for Copper Alloy Sand  
Castings for General Applications
- E. International Code Council (ICC):
- IPC-2012.....International Plumbing Code
- F. Manufacturers Standardization Society of the Valve and Fittings  
Industry, Inc. (MSS):
- SP-25-2008.....Standard Marking Systems for Valves, Fittings,  
Flanges and Unions
- SP-67-2011.....Butterfly Valves
- SP-70-2011.....Gray Iron Gate Valves, Flanged and Threaded  
Ends
- SP-71-2011.....Gray Iron Swing Check Valves, Flanged and  
Threaded Ends
- SP-80-2013.....Bronze Gate, Globe, Angle, and Check Valves
- SP-85-2011.....Gray Iron Globe & Angle Valves, Flanged and  
Threaded Ends
- SP-110-2010.....Ball Valves Threaded, Socket-Welding, Solder  
Joint, Grooved and Flared Ends

## G. National Environmental Balancing Bureau (NEBB):

7th Edition 2005                      Procedural Standards for Testing, Adjusting,  
Balancing of Environmental Systems

## H. NSF International (NSF):

61-2012.....Drinking Water System Components - Health  
Effects

372-2011.....Drinking Water System Components - Lead Content

I. University of Southern California Foundation for Cross Connection  
Control and Hydraulic Research (USC FCCCHR):

9th Edition.....Manual of Cross-Connection Control

**1.4 SUBMITTALS**

- A. Submittals, including number of required copies, shall be submitted in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Information and material submitted under this section shall be marked "SUBMITTED UNDER SECTION 22 05 23, GENERAL-DUTY VALVES FOR PLUMBING PIPING", with applicable paragraph identification.
- C. Manufacturer's Literature and Data Including: Full item description and optional features and accessories. Include dimensions, weights, materials, applications, standard compliance, model numbers, size, and capacity.
  - 1. Ball Valves.
  - 2. Gate Valves.
  - 3. Butterfly Valves.
  - 4. Balancing Valves.
  - 5. Check Valves.
  - 6. Globe Valves.
  - 7. Water Pressure Reducing Valves and Connections.
  - 8. Not Used.
  - 9. Backflow Preventers.
  - 10. Chainwheels.
  - 11. Thermostatic Mixing Valves.
- D. Test and Balance reports for balancing valves.
- E. Complete operating and maintenance manuals including wiring diagrams, technical data sheets and information for ordering replaceable parts:
  - 1. Include complete list indicating all components of the systems.
  - 2. Include complete diagrams of the internal wiring for each item of equipment.

3. Diagrams shall have their terminals identified to facilitate installation, operation and maintenance.
4. Piping diagrams of thermostatic mixing valves to be installed.

#### **1.5 DELIVERY, STORAGE, AND HANDLING**

- A. Valves shall be prepared for shipping as follows:
  1. Protect internal parts against rust and corrosion.
  2. Protect threads, flange faces, grooves, and weld ends.
  3. Set angle, gate, and globe valves closed to prevent rattling.
  4. Set ball and plug valves open to minimize exposure of functional surfaces.
  5. Set butterfly valves closed or slightly open.
  6. Block check valves in either closed or open position.
- B. Valves shall be prepared for storage as follows:
  1. Maintain valve end protection.
  2. Store valves indoors and maintain at higher than ambient dew point temperature.
- C. A sling shall be used for large valves. The sling shall be rigged to avoid damage to exposed parts. Hand wheels or stems shall not be used as lifting or rigging points.

### **PART 2 - PRODUCTS**

#### **2.1 VALVES, GENERAL**

- A. Asbestos packing and gaskets are prohibited.
- B. Bronze valves shall be made with dezincification resistant materials. Bronze valves made with copper alloy (brass) containing more than 15 percent zinc shall not be permitted.
- C. Valves in insulated piping shall have 50 mm or DN50 (2 inch) stem extensions and extended handles of non-thermal conductive material that allows operating the valve without breaking the vapor seal or disturbing the insulation. Memory stops shall be fully adjustable after insulation is applied.
- D. Exposed Valves over 65 mm or DN65 (2-1/2 inches) installed at an elevation over 3.6 m (12 feet) shall have a chain-wheel attachment to valve hand-wheel, stem, or other actuator.
- E. All valves used to supply potable water shall meet the requirements of NSF 61 and NSF 372.
- F. Bio-Based Materials: For products designated by the USDA's Bio-Preferred Program, provide products that meet or exceed USDA recommendations for bio-based content, so long as products meet all



performance requirements in this specifications section. For more information regarding the product categories covered by the Bio-Preferred Program, visit <http://www.biopreferred.gov>.

## **2.2 SHUT-OFF VALVES**

### **A. Cold, Hot and Re-circulating Hot Water:**

1. 65 mm or DN65 (2.5 inches) and smaller: Ball, MSS SP-110, Ball valve shall be full port three piece or two piece with a union design with adjustable stem package. Threaded stem designs are not allowed. The ball valve shall have a SWP rating of 1035 kPa (150 psig) and a CWP rating of 4138 kPa (600 psig). The body material shall be Bronze ASTM B584, Alloy C844. The ends shall be non-lead solder.
2. 75mm and 100 mm or DN75 and DN100 (3 and 4 inches): Butterfly shall have an iron body with EPDM seal and aluminum bronze disc. The butterfly valve shall meet MSS SP-67, type I standard. The butterfly valve shall have a SWP rating of 1380 kPa (200 psig). The valve design shall be lug type suitable for bidirectional dead-end service at rated pressure. The body material shall meet ASTM A536, ductile iron.

## **2.3 BALANCING VALVES**

- ### **A. Hot Water Re-circulating, 75 mm or DN75 (3 inches) and smaller manual balancing valve shall be of bronze body, brass ball construction with glass and carbon filled TFE seat rings and designed for positive shutoff. The manual balancing valve shall have differential pressure read-out ports across the valve seat area. The read out ports shall be fitting with internal EPT inserts and check valves. The valve body shall have 8 mm or DN8 NPT (1/4 inch NPT) tapped drain and purge port. The valves shall have memory stops that allow the valve to close for service and then reopened to set point without disturbing the balance position. All valves shall have calibrated nameplates to assure specific valve settings.**

## **2.4 CHECK VALVES**

- ### **A. 75 mm or DN75 (3 inches) and smaller shall be Class 125, bronze swing check valves with non-metallic disc suitable for type of service. The check valve shall meet MSS SP-80 Type 4 standard. The check valve shall have a CWP rating of 1380 kPa (200 psig). The check valve shall have a Y pattern horizontal body design with bronze body material conforming to ASTM B62, solder joints, and PTFE or TFE disc.**

**2.5 GLOBE VALVES NOT USED.****2.6 WATER PRESSURE REDUCING VALVE AND CONNECTIONS NOT USED.****2.7 BACKWATER VALVE NOT USED.****2.8 BACKFLOW PREVENTERS**

- A. A backflow prevention assembly shall be installed at any point in the plumbing system where the potable water supply comes in contact with a potential source of contamination. The backflow prevention assembly shall be approved by the University of Southern California Foundation for Cross Connection Control and Hydraulic Research (USCFCCC).
- B. The reduced pressure principle backflow prevention assembly shall be ASSE listed 1013 with full port OS&Y positive-seal resilient gate valves and an integral relief monitor switch. The main body and access cover shall be epoxy coated ductile iron conforming to ASTM A536 grade 4. The seat ring and check valve shall be the thermoplastic type suited for water service. The stem shall be stainless steel conforming to ASTM A276. The seat disc shall be the elastomer type suited for water service. The checks and the relief valve shall be accessible for maintenance without removing the device from the line. An epoxy coated wye type strainer with flanged connections shall be installed on the inlet. Reduced pressure backflow preventers shall be installed in the following applications.
1. Not Used.
  2. Not Used.
  3. Not Used.
  4. Not Used.
  5. Water make up to heating systems, cooling tower, chilled water system, generators, and similar equipment consuming water.
  6. Not Used.
  7. Not Used.
  8. Not used.
  9. Medical equipment.
  10. Process equipment.
- C. The pipe applied or integral atmospheric vacuum breaker shall be ASSE listed 1001. The main body shall be cast bronze. The seat disc shall be the elastomer type suited for water service. The device shall be accessible for maintenance without removing the device from the service line. The installation shall not be in a concealed or inaccessible location or where the venting of water from the device during normal

operation is deemed objectionable. Atmospheric vacuum breakers shall be installed in the following applications.

1. Hose bibs and sinks with threaded outlets.
2. Not Used.
3. Showers (telephone/handheld type).
4. Not Used.
5. Not Used.
6. Not Used.
7. Not Used.
8. Not Used.
9. Not Used.
10. Not Used.
11. Service sinks (integral with faucet only).
12. Laundry tubs (integral with faucet only).
13. Not Used.

D. The hose connection vacuum breaker shall be ASSE listed 1011. The main body shall be cast brass with stainless steel working parts. The diaphragm and disc shall be the elastomer type suited for water service. The device shall permit the attachment of portable hoses to hose thread outlets. Hose connection vacuum breakers shall be installed in the following locations requiring non-continuous pressure:

1. Hose bibbs and wall hydrants.

E. The pressure vacuum breaker shall be ASSE listed 1020. The main body shall be brass. The disc and O-ring seal shall be the elastomer type. The valve seat and disc float shall be the thermoplastic type. Tee handle or lever handle shut-off ball valves. Test cocks for testing and draining where freezing conditions occur. All materials shall be suitable for water service. The device shall be accessible for maintenance without removing the device from the service line. The installation shall not be in a concealed or inaccessible location or where the venting of water from the device during normal operation is deemed objectionable. Pressure vacuum breakers shall be installed in the following locations requiring continuous pressure and no backpressure including equipment with submerged inlet connections:

1. Lawn Irrigation.

F. Not Used.

G. The double check backflow prevention assembly shall be ASSE listed 1015 and supply with full port, OS&Y, positive-seal, resilient gate valves.

The main body and access cover shall be epoxy coated ductile iron conforming to ASTM A536 grade. The seat ring and check valve shall be the thermoplastic type suited for water service. The stem shall be stainless steel conforming to ASTM A276. The seat disc shall be the elastomer type suited for water service. The first and second check valve shall be accessible for maintenance without removing the device from the line. Double check valves shall be installed in the following location requiring continuous pressure subject to backpressure and backsiphonage conditions.

1. Lawn Irrigation.

## **2.9 CHAINWHEELS**

- A. Valve chain wheel assembly with sprocket rim brackets and chain shall be constructed according to the following:
  1. Brackets: Type, number, size, and fasteners required to mount actuator on valve.
  2. Attachment: For connection to butterfly valve stem.
  3. Sprocket rim with chain guides: Ductile or cast iron of type and size required for valve with zinc coating.
  4. Chain: Hot dipped galvanized steel of size required to fit sprocket rim.

## **2.10 THERMOSTATIC MIXING VALVES**

- A. Thermostatic Mixing Valves shall comply with the following general performance requirements:
  1. Shall meet ASSE requirements for water temperature control.
  2. The body shall be cast bronze or brass with corrosion resistant internal parts preventing scale and biofilm build-up. Provide chrome-plated finish in exposed areas.
  3. No special tool shall be required for temperature adjustment, maintenance, replacing parts and disinfecting operations.
  4. Valve shall be able to be placed in various positions without making temperature adjustment or reading difficult.
  5. Valve finish shall be chrome plated in exposed areas.
  6. Valve shall allow easy temperature adjustments to allow hot water circulation. Internal parts shall be able to withstand disinfecting operations of chemical and thermal treatment of water temperatures up to 82°C (180°F) for 30 minutes or 50 mg/L (50 ppm) chlorine residual concentration for 24 hours.

7. Parts shall be easily removed or replaced without dismantling the valves, for easy scale removal and disinfecting of parts.
8. Valve shall have a manual adjustable temperature control with locking mechanism to prevent tampering by end user. Outlet temperature shall be visible to ensure outlet temperature does not exceed specified limits, particularly after thermal eradication procedures.
9. Provide mixing valves with integral check valves with screens and stop valves.

B. Not Used.

C. Not Used.

D. Not Used.

E. Water Temperature Limiting Devices:

1. Application: Single plumbing fixture point-of-use such as sinks or lavatories.
2. Standard: ASSE 1070.
3. Pressure Rating: 861 kPa (125 psig).
4. Type: Thermostatically controlled water mixing valve set at 43 degrees C (110 degrees F).
5. Connections: Threaded union, compression or soldered inlets and outlet.
6. Upon cold water supply failure the hot water flow shall automatically be reduced to 0.2 gpm maximum.

F. Temperature Activated Mixing Valves:

1. Application: Emergency eye/face/drench shower equipment.
2. Standard: ASSE 1071.
3. Pressure Rating: 861 kPa (125 psig).
4. Type: Thermostatically controlled water mixing valve set at 24-30 degrees C (75-85 degrees F).
5. Connections: Soldered or threaded union inlets and outlet.
6. Not Used.
7. Thermometers shall be provided to indicate mixed water temperature.
8. Upon cold water supply failure the hot water flow shall automatically be reduced to 0.5 gpm maximum.

**PART 3 - EXECUTION****3.1 EXAMINATION**

- A. Valve interior shall be examined for cleanliness, freedom from foreign matter, and corrosion. Special packing materials shall be removed, such as blocks, used to prevent disc movement during shipping and handling.
- B. Valves shall be operated in positions from fully open to fully closed. Guides and seats shall be examined and made accessible by such operations.
- C. Threads on valve and mating pipe shall be examined for form and cleanliness.
- D. Mating flange faces shall be examined for conditions that might cause leakage. Bolting shall be checked for proper size, length, and material. Gaskets shall be verified for proper size and that its material composition is suitable for service and free from defects and damage.
- E. Do not attempt to repair defective valves; replace with new valves.

**3.2 INSTALLATION**

- A. Install valves with unions or flanges at each piece of equipment arranged to allow service, maintenance, and equipment removal without system shutdown.
- B. Valves shall be located for easy access and shall be provide with separate support. Valves shall be accessible with access doors when installed inside partitions or above hard ceilings.
- C. Valves shall be installed in horizontal piping with stem at or above center of pipe.
- D. Valves shall be installed in a position to allow full stem movement.
- E. Install chain wheels on operators for butterflygate and globe valves NPS 100 mm or DN100 (4 inches) and larger and more than 3.6 m (12 feet) above floor. Chains shall be extended to 1524 mm (60 inches) above finished floor.
- F. Check valves shall be installed for proper direction of flow and as follows:
  - 1. Swing Check Valves: In horizontal position with hinge pin level and on top of valve.
- G. Install backflow preventers in each water supply to mechanical equipment and systems and to other equipment and water systems that may be sources of contamination. Comply with authorities having

jurisdiction. Locate backflow preventers in same room as connected equipment or system.

1. Install drain for backflow preventers with atmospheric-vent drain connection with air-gap fitting, fixed air-gap fitting, or equivalent positive pipe separation of at least two pipe diameters in drain piping and pipe to floor drain. Locate air-gap device attached to or under backflow preventer. Simple air breaks are not acceptable for this application.
- H. Install pressure gages on outlet of backflow preventers.
- I. Do not install bypass piping around backflow preventers.
- J. Install temperature-actuated water mixing valves with check stops or shutoff valves on inlets.
  1. Install thermometers if specified.
  2. Install cabinet-type units recessed in or surface mounted on wall as specified.
- K. If an installation is unsatisfactory to the COR, the Contractor shall correct the installation at no cost to the Government.

### **3.3 LABELING AND IDENTIFYING**

- A. Equipment Nameplates and Signs: Install engraved plastic-laminate equipment nameplate or sign on or near each of the following:
  1. Calibrated balancing valves.
  2. Master, thermostatic, water mixing valves.
  3. Manifold, thermostatic, water-mixing-valve assemblies.
- B. Distinguish among multiple units, inform operator of operational requirements, indicate safety and emergency precautions, and warn of hazards and improper operations, in addition to identifying unit.

### **3.4 ADJUSTING**

- A. Valve packing shall be adjusted or replaced after piping systems have been tested and put into service but before final adjusting and balancing. Valves shall be replaced if persistent leaking occurs.
- B. Set field-adjustable flow set points of balancing valves and record data. Ensure recorded data represents actual measured or observed conditions. Permanently mark settings of valves and other adjustment devices allowing settings to be restored. Set and lock memory stops. After adjustment, take measurements to verify balance has not been disrupted or that such disruption has been rectified.
- C. Set field-adjustable temperature set points of temperature-actuated water mixing valves.

- D. Testing and adjusting of balancing valves shall be performed by an independent NEBB Accredited Test and Balance Contractor. A final settings and flow report shall be submitted to the VA Contracting Officer's Representative (COR).

**3.5 COMMISSIONING NOT USED.**

**3.6 DEMONSTRATION AND TRAINING**

- A. Provide services of manufacturer's technical representative for four hours to instruct VA Personnel in operation and maintenance of the system.

- - E N D - - -



**SECTION 22 07 11  
PLUMBING INSULATION**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. Field applied insulation for thermal efficiency and condensation control for the following:
  - 1. Plumbing piping and equipment.
  - 2. Re-insulation of plumbing piping and equipment after asbestos abatement and or replacement of any part of existing insulation system (insulation, vapor retarder jacket, protective coverings/jacket) damaged during construction.
- B. Definitions:
  - 1. ASJ: All Service Jacket, Kraft paper, white finish facing or jacket.
  - 2. Air conditioned space: Space having air temperature and/or humidity controlled by mechanical equipment.
  - 3. All insulation systems installed within supply, return, exhaust, relief and ventilation air plenums shall be limited to uninhabited crawl spaces, areas above a ceiling or below the floor, attic spaces, interiors of air conditioned or heating ducts, and mechanical equipment rooms shall be noncombustible or shall be listed and labeled as having a flame spread indexes of not more than 25 and a smoke-developed index of not more than 50 when tested in accordance with ASTM E84 or UL 723. Note: ICC IMC, Section 602.2.1.
  - 4. Cold: Equipment or piping handling media at design temperature of 15 degrees C (60 degrees F) or below.
  - 5. Concealed: Piping above ceilings and in chases, and pipe spaces.
  - 6. Exposed: Piping and equipment exposed to view in finished areas including mechanical equipment rooms or exposed to outdoor weather. Shafts, chases, unfinished attics, crawl spaces and pipe basements are not considered finished areas.
  - 7. FSK: Foil-scrim-Kraft facing.
  - 8. Hot: Plumbing equipment or piping handling media above 40 degrees C (104 degrees F).
  - 9. Density: kg/m<sup>3</sup> - kilograms per cubic meter (Pcf - pounds per cubic foot).
  - 10. Thermal conductance: Heat flow rate through materials.
    - a. Flat surface: Watts per square meter (BTU per hour per square foot).

- b. Pipe or Cylinder: Watts per linear meter (BTU per hour per linear foot) for a given outside diameter.
- 11. Thermal Conductivity (k): Watts per meter, per degree K (BTU - inch thickness, per hour, per square foot, per degree F temperature difference).
- 12. Vapor Retarder (Vapor Barrier): A material which retards the transmission (migration) of water vapor. Performance of the vapor retarder is rated in terms of permeance (perms). For the purpose of this specification, vapor retarders/vapor barriers shall have a maximum published permeance of .02 perms.
- 13. HWR: Hot water recirculating.
- 14. CW: Cold water.
- 15. SW: Soft water.
- 16. HW: Hot water.
- 17. PVDC: Polyvinylidene chloride vapor retarder jacketing, white.

## 1.2 RELATED WORK

- A. Section 01 00 00, GENERAL REQUIREMENTS.
- B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- C. Section 01 81 13, SUSTAINABLE CONSTRUCTION REQUIREMENTS: Insulation material and insulation production method.
- D. Section 01 91 00, GENERAL COMMISSIONING REQUIREMENTS.
- E. Section 02 82 11, TRADITIONAL ASBESTOS ABATEMENT: Insulation containing asbestos material
- F. Not Used.
- G. Section 07 84 00, FIRESTOPPING: Mineral fiber and bond breaker behind sealant.
- H. Not Used.
- I. Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING: General mechanical requirements and items, which are common to more than one section of Division 22.
- J. Not Used.
- K. Section 22 05 23, GENERAL-DUTY VALVES FOR PLUMBING PIPING: Hot and cold water piping.
- L. Not Used.
- M. Section 22 08 00, COMMISSIONING OF PLUMBING SYSTEMS.
- N. Section 23 21 13, HYDRONIC PIPING: electrical heat tracing systems.
- O. Section 26 32 13, ENGINE GENERATORS: Exhaust stacks and muffler.

### 1.3 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by basic designation only.
- B. American Society for Testing and Materials (ASTM):
- B209-2014.....Standard Specification for Aluminum and Aluminum-Alloy Sheet and Plate
  - C411-2011.....Standard Test Method for Hot-Surface Performance of High-Temperature Thermal Insulation
  - C449-2007 (R2013).....Standard Specification for Mineral Fiber Hydraulic-Setting Thermal Insulating and Finishing Cement
  - C450-2008 (R2014).....Standard Practice for Fabrication of Thermal Insulating Fitting Covers for NPS Piping, and Vessel Lagging
  - Adjunct to C450.....Compilation of Tables that Provide Recommended Dimensions for Prefab and Field Thermal Insulating Covers, etc.
  - C533-2013.....Standard Specification for Calcium Silicate Block and Pipe Thermal Insulation
  - C534/C534M-2014.....Standard Specification for Preformed Flexible Elastomeric Cellular Thermal Insulation in Sheet and Tubular Form
  - C547-2015.....Standard Specification for Mineral Fiber Pipe Insulation
  - C553-2013.....Standard Specification for Mineral Fiber Blanket Thermal Insulation for Commercial and Industrial Applications
  - C680-2014.....Standard Practice for Estimate of the Heat Gain or Loss and the Surface Temperatures of Insulated Flat, Cylindrical, and Spherical Systems by Use of Computer Programs
  - C612-2014.....Standard Specification for Mineral Fiber Block and Board Thermal Insulation
  - C1136-2012.....Standard Specification for Flexible, Low Permeance Vapor Retarders for Thermal Insulation

- D1668/D1668M-1997a (2014)e1 Standard Specification for Glass Fabrics  
(Woven and Treated) for Roofing and  
Waterproofing
- E84-2015a.....Standard Test Method for Surface Burning  
Characteristics of Building Materials
- E2231-2015.....Standard Practice for Specimen Preparation and  
Mounting of Pipe and Duct Insulation to Assess  
Surface Burning Characteristics
- C. Federal Specifications (Fed. Spec.):
- L-P-535E-1979.....Plastic Sheet (Sheeting): Plastic Strip; Poly  
(Vinyl Chloride) and Poly (Vinyl Chloride -  
Vinyl Acetate), Rigid.
- D. International Code Council, (ICC):
- IMC-2012.....International Mechanical Code
- E. Military Specifications (Mil. Spec.):
- MIL-A-3316C (2)-1990....Adhesives, Fire-Resistant, Thermal Insulation
- MIL-A-24179A (2)-1987...Adhesive, Flexible Unicellular-Plastic Thermal  
Insulation
- MIL-PRF-19565C (1)-1988.Coating Compounds, Thermal Insulation, Fire-and  
Water-Resistant, Vapor-Barrier
- MIL-C-20079H-1987.....Cloth, Glass; Tape, Textile Glass; and Thread,  
Glass and Wire-Reinforced Glass
- F. National Fire Protection Association (NFPA):
- 90A-2015.....Standard for the Installation of Air-  
Conditioning and Ventilating Systems
- G. Underwriters Laboratories, Inc (UL):
- 723-2008 (R2013).....Standard for Test for Surface Burning  
Characteristics of Building Materials
- 1887-2004 (R2013).....Standard for Fire Test of Plastic Sprinkler  
Pipe for Visible Flame and Smoke  
Characteristics

#### 1.4 SUBMITTALS

- A. Submittals, including number of required copies, shall be submitted in  
accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND  
SAMPLES.
- B. Information and material submitted under this section shall be marked  
"SUBMITTED UNDER SECTION 22 07 11, PLUMBING INSULATION", with  
applicable paragraph identification.

- C. Manufacturer's Literature and Data including: Full item description and optional features and accessories. Include dimensions, weights, materials, applications, standard compliance, model numbers, size, and capacity.
- D. Shop Drawings:
  - 1. All information, clearly presented, shall be included to determine compliance with drawings and specifications and ASTM Designation, Federal and Military specifications.
    - a. Insulation materials: Specify each type used and state surface burning characteristics.
    - b. Insulation facings and jackets: Each type used and state surface burning characteristics.
    - c. Insulation accessory materials: Each type used.
    - d. Manufacturer's installation and fitting fabrication instructions for flexible unicellular insulation shall follow the guidelines in accordance with ASTM C1710.
    - e. Make reference to applicable specification paragraph numbers for coordination.
    - f. All insulation fittings (exception flexible unicellular insulation) shall be fabricated in accordance with ASTM C450 and the referenced Adjunct to ASTM C450.
- F. Completed System Readiness Checklist provided by the CxA and completed by the contractor, signed by a qualified technician and dated on the date of completion, in accordance with the requirements of Section 22 08 00, COMMISSIONING OF PLUMBING SYSTEMS.

### **1.5 QUALITY ASSURANCE**

- A. Refer to article QUALITY ASSURANCE, in Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.
- B. Criteria:
  - 1. Comply with NFPA 90A, particularly paragraphs 4.3.3.1 through 4.3.3.6, 4.3.11.2.6, parts of which are quoted as follows:
    - 4.3.3.1** Pipe and duct insulation and coverings, duct linings, vapor retarder facings, adhesives, fasteners, tapes, and supplementary materials added to air ducts, plenums, panels and duct silencers used in duct systems shall have, in the form in which they are used, a maximum flame spread index of 25 without evidence of continued progressive combustion and a maximum smoke developed index of 50 when tested in accordance with ASTM E84 and appropriate mounting practice, e.g. ASTM E2231.
    - 4.3.3.3** Coverings and linings for air ducts, pipes, plenums and panels including all pipe and duct insulation materials shall not

flame, glow, smolder, or smoke when tested in accordance with a similar test for pipe covering, ASTM C411, Standard Test Method for Hot-Surface Performance of High-Temperature Thermal Insulation, at the temperature to which they are exposed in service. In no case shall the test temperature be below 121 degrees C (250 degrees F).

4.3.11.2.6.3 Nonferrous fire sprinkler piping shall be listed as having a maximum peak optical density of 0.5 or less, an average optical density of 0.15 or less, and a maximum flame spread distance of 1.5 m (5 ft) or less when tested in accordance with UL 1887, Standard for Safety Fire Test of Plastic Sprinkler Pipe for Visible Flame and Smoke Characteristics.

4.3.11.2.6.8 Smoke detectors shall not be required to meet the provisions of Section 4.3.

2. Test methods: ASTM E84, UL 723, and ASTM E2231.
  3. Specified k factors are at 24 degrees C (75 degrees F) mean temperature unless stated otherwise. Where optional thermal insulation material is used, select thickness to provide thermal conductance no greater than that for the specified material. For pipe, use insulation manufacturer's published heat flow tables. For domestic hot water supply and return, run out insulation and condensation control insulation, no thickness adjustment need be made.
  4. All materials shall be compatible and suitable for service temperature, and shall not contribute to corrosion or otherwise attack surface to which applied in either the wet or dry state.
- C. Every package or standard container of insulation or accessories delivered to the job site for use shall have a manufacturer's stamp or label giving the name of the manufacturer, description of the material, and the production date or code.
- D. Bio-Based Materials: For products designated by the USDA's Bio-Preferred Program, provide products that meet or exceed USDA recommendations for bio-based content, so long as products meet all performance requirements in this specifications section. For more information regarding the product categories covered by the Bio-Preferred Program, visit <http://www.biopreferred.gov>.

## 1.6 AS-BUILT DOCUMENTATION

- A. Submit manufacturer's literature and data updated to include submittal review comments and any equipment substitutions.
- B. Submit operation and maintenance data updated to include submittal review comments, substitutions and construction revisions shall be in electronic version on compact disc or DVD inserted into a three ring

binder. All aspects of system operation and maintenance procedures, including piping isometrics, wiring diagrams of all circuits, a written description of system design, control logic, and sequence of operation shall be included in the operation and maintenance manual. The operations and maintenance manual shall include troubleshooting techniques and procedures for emergency situations. Notes on all special systems or devices such as damper and door closure interlocks shall be included. A List of recommended spare parts (manufacturer, model number, and quantity) shall be furnished. Information explaining any special knowledge or tools the owner will be required to employ shall be inserted into the As-Built documentation.

- C. The installing contractor shall maintain as-built drawings of each completed phase for verification; and, shall provide the complete set at the time of final systems certification testing. As-built drawings are to be provided, and a copy of them in Auto-CAD version 2014 provided on compact disk or DVD. Should the installing contractor engage the testing company to provide as-built or any portion thereof, it shall not be deemed a conflict of interest or breach of the 'third party testing company' requirement.
- D. Certification documentation shall be provided prior to submitting the request for final inspection. The documentation shall include all test results, the names of individuals performing work for the testing agency on this project, detailed procedures followed for all tests, and certification that all results of tests were within limits specified.

#### **1.7 STORAGE AND HANDLING OF MATERIAL**

- A. Store materials in clean and dry environment, pipe insulation jackets shall be clean and unmarred. Place adhesives in original containers. Maintain ambient temperatures and conditions as required by printed instructions of manufacturers of adhesives, mastics and finishing cements.

### **PART 2 - PRODUCTS**

#### **2.1 MINERAL FIBER OR FIBER GLASS**

- A. ASTM C612 (Board, Block), Class 1 or 2, density 48 kg/m<sup>3</sup> (nominal 3 pcf), k = 0.037 (.26) at 24 degrees C (75 degrees F), external insulation for temperatures up to 204 degrees C (400 degrees F).
- B. ASTM C553 (Blanket, Flexible) Type I, Class B-5, Density 32 kg/m<sup>3</sup> (nominal 2 pcf), k = 0.04 (0.27) at 24 degrees C (75 degrees F), for use at temperatures up to 204 degrees C (400 degrees F).

- C. ASTM C547 (Pipe Fitting Insulation and Preformed Pipe Insulation), Class 1,  $k = 0.037$  (0.26) at 24 degrees C (75 degrees F), for use at temperatures up to 230 degrees C (446 degrees F) with an all service vapor retarder jacket (ASJ) and with polyvinyl chloride (PVC) premolded fitting covering.

## 2.2 MINERAL WOOL OR REFRACTORY FIBER

- A. Comply with Standard ASTM C612, Class 3, 450 degrees C (842 degrees F).

## 2.3 RIGID CELLULAR PHENOLIC FOAM NOT USED.

## 2.4 CELLULAR GLASS CLOSED-CELL NOT USED.

## 2.5 POLYISOCYANURATE CLOSED-CELL RIGID NOT USED.

## 2.6 FLEXIBLE ELASTOMERIC CELLULAR THERMAL

- A. ASTM C534/C534M,  $k = 0.039$  (0.27) at 24 degrees C (75 degrees F), flame spread not over 25, smoke developed not over 50, for temperatures from minus 4 degrees C (40 degrees F) to 93 degrees C (199 degrees F). Under high humidity exposures for condensation control an external vapor retarder/barrier jacket is required. Consult ASTM C1710.

## 2.7 CALCIUM SILICATE

- A. Preformed pipe Insulation: ASTM C533, Type I and Type II with indicator denoting asbestos-free material.
- B. Premolded Pipe Fitting Insulation: ASTM C533, Type I and Type II with indicator denoting asbestos-free material.
- C. Equipment Insulation: ASTM C533, Type I and Type II.
- D. Characteristics:

Insulation Characteristics		
ITEMS	TYPE I	TYPE II
Surface Temperature, maximum degrees C (degrees F)	649 (1200)	927 (1700)
Density (dry), Kg/m <sup>3</sup> (lb/ ft <sup>3</sup> )	240 (15)	352 (22)
Thermal conductivity: Min W/ m K (Btu in/h ft <sup>2</sup> degrees F)@ mean temperature of 93 degrees C (199 degrees F)	0.065 (0.45)	0.078 (0.540)
Surface burning characteristics: Flame spread Index, Maximum	0	0
Smoke Density index, Maximum	0	0



## 2.8 INSULATION FACINGS AND JACKETS

- A. Vapor Retarder, higher strength with low water permeance = 0.02 or less perm rating, Beach puncture 50 units for insulation facing on pipe insulation jackets. Facings and jackets shall be ASJ or PVDC Vapor Retarder jacketing.
- B. ASJ shall be white finish (kraft paper) bonded to 0.025 mm (1 mil) thick aluminum foil, fiberglass reinforced, with pressure sensitive adhesive closure. Comply with ASTM C1136. Beach puncture is 50 units, suitable for painting without sizing. Jackets shall have minimum 40 mm (1-1/2 inch) lap on longitudinal joints and minimum 75 mm (3 inch) butt strip on end joints. Butt strip material shall be same as the jacket. Lap and butt strips shall be self-sealing type with factory-applied pressure sensitive adhesive.
- C. Vapor Retarder medium strength with low water vapor permeance of 0.02 or less perm rating), Beach puncture 25 units: FSK or PVDC type for concealed ductwork and equipment.
- D. Except for flexible elastomeric cellular thermal insulation (not for high humidity exposures), field applied vapor barrier jackets shall be provided, in addition to the specified facings and jackets, on all exterior piping as well as on interior piping exposed to outdoor air (i.e.; in ventilated attics, piping in ventilated (not air conditioned) spaces, etc.) in high humidity locations conveying fluids below ambient temperature. The vapor barrier jacket shall consist of a multi-layer laminated cladding with a maximum water vapor permeance of 0.001 perms. The minimum puncture resistance shall be 35 cm-kg (30 inch-pounds) for interior locations and 92 cm-kg (80 inch-pounds) for exterior or exposed locations or where the insulation is subject to damage.
- E. Except for cellular glass thermal insulation, when all longitudinal and circumferential joints are vapor sealed with a vapor barrier mastic or caulking, vapor barrier jackets may not be provided. For aesthetic and physical abuse applications, exterior jacketing is recommended. Otherwise field applied vapor barrier jackets shall be provided, in addition to the applicable specified facings and jackets, on all exterior piping as well as on interior piping exposed to outdoor air (i.e.; in ventilated attics, piping in ventilated (not air conditioned) spaces, etc.) in high humidity locations conveying fluids below ambient temperature the vapor barrier jacket shall consist of a multi-layer laminated cladding with a maximum water vapor permeance of 0.001 perms.

The minimum puncture resistance shall be 35 cm-kg (30 inch-pounds) for interior locations and 92 cm-kg (80 inch-pounds) for exterior or exposed locations or where the insulation is subject to damage.

- F. Glass Cloth Jackets: Presized, minimum 0.18 kg per square meter (7.8 ounces per square yard), 2070 kPa (300 psig) bursting strength with integral vapor retarder where required or specified. Weather proof if utilized for outside service.
- G. Pipe fitting insulation covering (jackets): Fitting covering shall be premolded to match shape of fitting and shall be PVC conforming to Fed Spec L-P-535E, composition A, Type II Grade GU, and Type III, minimum thickness 0.7 mm (0.03 inches). Provide color matching vapor retarder pressure sensitive tape. Staples, tacks, or any other attachment that penetrates the PVC covering is not allowed on any form of a vapor barrier system in below ambient process temperature applications.

## 2.9 PIPE COVERING PROTECTION SADDLES

- A. Cold pipe support: Premolded pipe insulation 180 degrees (half-shells) on bottom half of pipe at supports.

Nominal Pipe Size and Accessories Material (Insert Blocks)	
Nominal Pipe Size mm (inches)	Insert Blocks mm (inches)
Up through 125 (5)	150 (6) long
150 (6)	150 (6) long
200 (8), 250 (10), 300 (12)	225 (9) long
350 (14), 400 (16)	300 (12) long
450 through 600 (18 through 24)	350 (14) long

- B. Warm or hot pipe supports: Premolded pipe insulation (180 degree half-shells) on bottom half of pipe at supports. Material shall be high density calcium silicate. Insulation at supports shall have same thickness as adjacent insulation.

## 2.10 ADHESIVE, MASTIC, CEMENT

- A. Mil. Spec. MIL-A-3316, Class 1: Jacket and lap adhesive and protective finish coating for insulation.
- B. Mil. Spec. MIL-A-3316, Class 2: Adhesive for laps and for adhering insulation to metal surfaces.
- C. Mil. Spec. MIL-A-24179A, Type II Class 1: Adhesive for installing flexible unicellular insulation and for laps and general use.

- D. Mil. Spec. MIL-PRF-19565C, Type I: Protective finish for outdoor use.
- E. Mil. Spec. MIL-PRFC-19565C, Type I or Type II: Vapor barrier compound for indoor use.
- F. ASTM C449: Mineral fiber hydraulic-setting thermal insulating and finishing cement.
- G. Other: Insulation manufacturers' published recommendations.

## **2.11 MECHANICAL FASTENERS**

- A. Pins, anchors: Welded pins, or metal or nylon anchors with galvanized steel or fiber washer, or clips. Pin diameter shall be as recommended by the insulation manufacturer.
- B. Staples: Outward clinching galvanized steel. Staples are not allowed for below ambient vapor barrier applications.
- C. Wire: 1.3 mm thick (18 gage) soft annealed galvanized or 1.9 mm (14 gage) copper clad steel or nickel copper alloy or stainless steel.
- D. Bands: 13 mm (1/2 inch) nominal width, brass, galvanized steel, aluminum or stainless steel.
- E. Tacks, rivets, screws or any other attachment device capable of penetrating the vapor retarder shall NOT be used to attach/close the any type of vapor retarder jacketing. Thumb tacks sometimes used on PVC jacketing and preformed fitting covers closures are not allowed for below ambient vapor barrier applications.

## **2.12 REINFORCEMENT AND FINISHES**

- A. Glass fabric, open weave: ASTM D1668/D1668M, Type III (resin treated) and Type I (asphalt or white resin treated).
- B. Glass fiber fitting tape: Mil. Spec MIL-C-20079H, Type II, Class 1.
- C. Tape for Flexible Elastomeric Cellular Insulation: As recommended by the insulation manufacturer.
- D. Hexagonal wire netting: 25 mm (one inch) mesh, 0.85 mm thick (22 gage) galvanized steel.
- E. Corner beads: 50 mm (2 inch) by 50 mm (2 inch), 0.55 mm thick (26 gage) galvanized steel; or, 25 mm (1 inch) by 25 mm (1 inch), 0.47 mm thick (28 gage) aluminum angle adhered to 50 mm (2 inch) by 50 mm (2 inch) Kraft paper.
- F. PVC fitting cover: Fed. Spec L-P-535E, Composition A, 11-86 Type II, Grade GU, with Form B Mineral Fiber insert, for media temperature 10 to 121 degrees C (50 to 250 degrees F). Below 10 degrees C (50 degrees F) and above 121 degrees C (250 degrees F) provide mitered pipe insulation of the same type as insulating straight pipe. Provide double layer

insert. Provide vapor barrier pressure sensitive tape matching the color of the PVC jacket.

### **2.13 FIRESTOPPING MATERIAL**

A. Other than pipe insulation, refer to Section 07 84 00, FIRESTOPPING.

### **2.14 FLAME AND SMOKE**

A. Unless shown otherwise all assembled systems shall meet flame spread 25 and smoke developed 50 rating as developed under ASTM and UL standards and specifications. See paragraph "Quality Assurance".

## **PART 3 - EXECUTION**

### **3.1 GENERAL REQUIREMENTS**

- A. Required pressure tests of piping joints and connections shall be completed and the work approved by the Contracting Officer's Representative (COR) for application of insulation. Surface shall be clean and dry with all foreign materials, such as dirt, oil, loose scale and rust removed.
- B. Except for specific exceptions or as noted, insulate all specified equipment, and piping (pipe, fittings, valves, accessories). Insulate each pipe individually. Do not use scrap pieces of insulation where a full length section will fit.
- C. Where removal of insulation of piping and equipment is required to comply with Section 02 82 11, TRADITIONAL ASBESTOS ABATEMENT and Section 02 82 13.13, GLOVEBAG ASBESTOS ABATEMENT, such areas shall be reinsulated to comply with this specification.
- D. Insulation materials shall be installed with smooth and even surfaces, with jackets and facings drawn tight and smoothly cemented down and sealed at all laps. Insulation shall be continuous through all sleeves and openings, except at fire dampers and duct heaters (NFPA 90A).
- E. Vapor retarders shall be continuous and uninterrupted throughout systems with operating temperature 15 degrees C (60 degrees F) and below. Lap and seal vapor barrier over ends and exposed edges of insulation. Anchors, supports and other metal projections through insulation on cold surfaces shall be insulated and vapor sealed for a minimum length of 150 mm (6 inches).
- F. Install vapor stops with operating temperature 15 degrees C (60 degrees F) and below at all insulation terminations on either side of valves, pumps, fittings, and equipment and particularly in straight lengths every 4.6 to 6.1 meters (approx. 15 to 20 feet) of pipe insulation. The annular space between the pipe and pipe insulation of approx. 25 mm (1

inch) in length at every vapor stop shall be sealed with appropriate vapor barrier sealant. Bio-based materials shall be utilized when possible.

- G. Construct insulation on parts of equipment such as cold water pumps and heat exchangers that must be opened periodically for maintenance or repair, so insulation can be removed and replaced without damage. Install insulation with bolted 1 mm thick (20 gage) galvanized steel or aluminum covers as complete units, or in sections, with all necessary supports, and split to coincide with flange/split of the equipment. Do not insulate over equipment nameplate data.
- H. Insulation on hot piping and equipment shall be terminated square at items not to be insulated, access openings and nameplates. Cover all exposed raw insulation with white sealer coating (caution about coating's maximum temperature limit) or jacket material.
- I. Protect all insulations outside of buildings with aluminum jacket using lock joint or other approved system for a continuous weather tight system. Access doors and other items requiring maintenance or access shall be removable and sealable.
- J. Plumbing work not to be insulated unless otherwise noted:
  - 1. Piping and valves of fire protection system.
  - 2. Chromium plated brass piping.
  - 3. Water piping in contact with earth.
- K. Apply insulation materials subject to the manufacturer's recommended temperature limits. Apply adhesives, mastic and coatings at the manufacturer's recommended minimum wet or dry film thickness. Bio-based materials shall be utilized when possible.
- L. Elbows, flanges and other fittings shall be insulated with the same material as is used on the pipe straights. Use of polyurethane or polyisocyanurate spray-foam to fill a PVC elbow jacket is prohibited on cold applications.
- M. Firestop Pipe insulation:
  - 1. Provide firestopping insulation at fire and smoke barriers through penetrations. Firestopping insulation shall be UL listed as defined in Section 07 84 00, FIRESTOPPING.
  - 2. Pipe penetrations requiring fire stop insulation including, but not limited to the following:
    - a. Pipe risers through floors
    - b. Pipe chase walls and floors

- c. Smoke partitions
  - d. Fire partitions
  - e. Hourly rated walls
- N. Freeze protection of above grade outdoor piping (over heat tracing tape): 20 mm (3/4 inch) thick insulation, for all pipe sizes 75 mm (3 inches) and smaller and 25 mm (1 inch) thick insulation for larger pipes. Provide metal jackets for all pipe insulations. Provide freeze protection for cold water make-up piping and equipment where indicated on the drawings as described in Section 23 21 13, HYDRONIC PIPING (electrical heat tracing systems).
- O. Provide vapor barrier systems as follows:
- 1. All piping exposed to outdoor weather.
  - 2. All interior piping conveying fluids exposed to outdoor air (i.e. in attics, ventilated (not air conditioned) spaces, etc.) below ambient air temperature in high humidity locations.
- P. Provide metal jackets over insulation as follows:
- 1. All plumbing piping exposed to outdoor weather.
  - 2. Piping exposed in building, within 1829 mm (6 feet) of the floor, that connects to sterilizers, kitchen and laundry equipment. Jackets may be applied with pop rivets except for cold pipe or tubing applications. Provide aluminum angle ring escutcheons at wall, ceiling or floor penetrations.
  - 3. A 50 mm (2 inch) jacket overlap is required at longitudinal and circumferential joints with the overlap at the bottom.
- Q. Provide PVC jackets over insulation as follows:
- 1. Piping exposed in building, within 1829 mm (6 feet) of the floor, on piping that is not precluded in previous sections.
  - 2. A 50 mm (2 inch) jacket overlap is required at longitudinal and circumferential joints with the overlap at the bottom.

### **3.2 INSULATION INSTALLATION**

- A. Mineral Fiber Board:
- 1. Vapor retarder faced board: Apply board on pins spaced not more than 300 mm (12 inches) on center each way, and not less than 75 mm (3 inches) from each edge of board. In addition to pins, apply insulation bonding adhesive to entire underside of horizontal metal surfaces. (Bio-based materials shall be utilized when possible.) Butt insulation edges tightly and seal all joints with laps and butt

strips. After applying speed clips cut pins off flush and apply vapor seal patches over clips.

2. Plain unfaced board:

- a. Insulation shall be scored, beveled or mitered to provide tight joints and be secured to equipment with bands spaced 225 mm (9 inches) on center for irregular surfaces or with pins and clips on flat surfaces. Use corner beads to protect edges of insulation.
- b. For hot equipment: Stretch 25 mm (1 inch) mesh wire, with edges wire laced together, over insulation and finish with insulating and finishing cement applied in one coat, 6 mm (1/4 inch) thick, trowelled to a smooth finish.
- c. For cold equipment: Apply meshed glass fabric in a tack coat 1.5 to 1.7 square meter per liter (60 to 70 square feet per gallon) of vapor mastic and finish with mastic at 0.3 to 0.4 square meter per liter (12 to 15 square feet per gallon) over the entire fabric surface.

B. Molded Mineral Fiber Pipe and Tubing Covering:

1. Fit insulation to pipe, aligning all longitudinal joints. Seal longitudinal joint laps and circumferential butt strips by rubbing hard with a nylon sealing tool to assure a positive seal. Staples may be used to assist in securing insulation except for cold piping. Seal all vapor retarder penetrations on cold piping with a generous application of vapor barrier mastic. Provide cellar glass inserts and install with metal insulation shields at outside pipe supports. Install freeze protection insulation over heating cable.
2. Contractor's options for fitting, flange and valve insulation:
  - a. Insulating and finishing cement for sizes less than 100 mm (4 inches) operating at surface temperature of 15 degrees C (60 degrees F) or more.
  - b. Factory premolded, one piece PVC covers with mineral fiber, (Form B), inserts surface temperature of above 4 degrees C (40 degrees F) to 121 degrees C (250 degrees F). Provide mitered preformed insulation of the same type as the installed straight pipe insulation for pipe temperatures below 4 degrees C (40 degrees F). Secure first layer of mineral fiber insulation with twine. Seal seam edges with vapor barrier mastic and secure with fitting tape.

- c. Factory preformed, ASTM C547 or fabricated mitered sections, joined with adhesive or (hot only) wired in place. (Bio-based materials shall be utilized when possible.) For hot piping finish with a smoothing coat of finishing cement. For cold fittings, 15 degrees C (60 degrees F) or less, vapor seal with a layer of glass fitting tape imbedded between two 2 mm (1/16 inch) coats of vapor barrier mastic.
- d. Fitting tape shall extend over the adjacent pipe insulation and overlap on itself at least 50 mm (2 inches).
- 3. Nominal thickness in millimeters and inches specified in the schedule at the end of this section.
- C. Not Used.
- D. Not Used.
- E. Not used.
- F. Flexible Elastomeric Cellular Thermal Insulation:
  - 1. Apply insulation and fabricate fittings in accordance with the manufacturer's installation instructions and finish with two coats of weather resistant finish as recommended by the insulation manufacturer. External vapor barrier jacketing may be required for expected or anticipated high humidity exposures. See ASTM C1710.
  - 2. Pipe and tubing insulation:
    - a. Use proper size material. Do not stretch or strain insulation.
    - b. To avoid undue compression of insulation, use supports as recommended by the elastomeric insulation manufacturer. Insulation shields are specified under Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.
    - c. Where possible, slip insulation over the pipe or tubing prior to connection, and seal the butt joints with adhesive. Where the slip-on technique is not possible, slit the insulation and apply it to the pipe sealing the seam and joints with contact adhesive. Optional tape sealing, as recommended by the manufacturer, may be employed. Bio-based materials shall be utilized when possible.
  - 3. Apply sheet insulation to flat or large curved surfaces with 100 percent adhesive coverage. For fittings and large pipe, apply adhesive to seams only.
  - 4. Pipe insulation: nominal thickness in millimeters (inches as specified in the schedule at the end of this section).



## G. Calcium Silicate:

1. Minimum thickness in millimeter (inches) specified below for piping other than in boiler plant.

<b>Nominal Thickness Of Calcium Silicate Insulation (Non-Boiler Plant)</b>				
Nominal Pipe Size Millimeters (Inches)	Thru 25 (1)	32 to 75 (1-1/4 to 3)	100-200 (4 to 8)	Greater than 200 (8)
93-260 degrees C (199-500 degrees F)(HPS, HPR)	100(4)	125(5)	150(6)	Greater than 150(6)

**3.3 COMMISSIONING**

- A. Provide commissioning documentation in accordance with the requirements of Section 22 08 00, COMMISSIONING OF PLUMBING SYSTEMS.
- B. Components provided under this section of the specification will be tested as part of a larger system.

**3.4 PIPE INSULATION SCHEDULE**

- A. Provide insulation for piping systems as scheduled below:

<b>Insulation Thickness Millimeters (Inches)</b>					
		<b>Nominal Pipe Size Millimeters (Inches)</b>			
<b>Operating Temperature Range/Service</b>	<b>Insulation Material</b>	<b>Less than 25 (1)</b>	<b>25 - 32 (1 - 1¼)</b>	<b>38 - 75 (1½ - 3)</b>	<b>100 (4) and Greater</b>
38-60 degrees C (100-140 degrees F) (Domestic Hot Water Supply and Return)	Mineral Fiber (Above ground piping only)	38 (1.5)	38 (1.5)	50 (2.0)	50 (2.0)
38-60 degrees C (100-140 degrees F) (Domestic Hot Water Supply and Return)	Flexible Elastomeric Cellular Thermal (Above ground piping only)	38 (1.5)	38 (1.5)	50 (2.0)	50 (2.0)
(4-15 degrees C (40-60 degrees F) (//Ice water piping//)	Flexible Elastomeric Cellular Thermal (Above ground piping only)	25 (1.0)	25(1.0)	25 (1.0)	25 (1.0)

- - - E N D - - -



**SECTION 22 11 00  
FACILITY WATER DISTRIBUTION**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. Domestic water systems, including piping, equipment and all necessary accessories as designated in this section.
- B. A complete listing of all acronyms and abbreviations are included in Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.

**1.2 RELATED WORK**

- A. Section 01 00 00, GENERAL REQUIREMENTS.
- B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- C. Section 01 81 13, SUSTAINABLE CONSTRUCTION REQUIREMENTS.
- D. Not Used.
- E. Section 07 84 00, FIRESTOPPING.
- F. Section 07 92 00, JOINT SEALANTS.
- G. Section 09 91 00, PAINTING.
- H. Not Used.
- I. Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.
- J. Section 22 07 11, PLUMBING INSULATION.

**1.3 APPLICABLE PUBLICATIONS**

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American Society of Mechanical Engineers (ASME):
  - A13.1-2007 (R2013).....Scheme for Identification of Piping Systems
  - B16.3-2011.....Malleable Iron Threaded Fittings: Classes 150 and 300
  - B16.9-2012.....Factory-Made Wrought Buttwelding Fittings
  - B16.11-2011.....Forged Fittings, Socket-Welding and Threaded
  - B16.12-2009 (R2014).....Cast Iron Threaded Drainage Fittings
  - B16.15-2013 .....Cast Copper Alloy Threaded Fittings: Classes 125 and 250
  - B16.18-2012.....Cast Copper Alloy Solder Joint Pressure Fittings
  - B16.22-2013.....Wrought Copper and Copper Alloy Solder-Joint Pressure Fittings

- B16.24-2011.....Cast Copper Alloy Pipe Flanges and Flanged  
Fittings: Classes 150, 300, 600, 900, 1500, and  
2500
- BPVC Section IX-2015....Welding, Brazing, and Fusing Qualifications
- C. American Society of Sanitary Engineers (ASSE):
- 1010-2004.....Performance Requirements for Water Hammer  
Arresters
- D. American Society for Testing and Materials (ASTM):
- A47/A47M-1999 (R2014)...Standard Specification for Ferritic Malleable  
Iron Castings
- A53/A53M-2012.....Standard Specification for Pipe, Steel, Black  
and Hot-Dipped, Zinc-Coated, Welded and  
Seamless
- A183-2014.....Standard Specification for Carbon Steel Track  
Bolts and Nuts
- A536-1984 (R2014).....Standard Specification for Ductile Iron  
Castings
- A733-2013.....Standard Specification for Welded and Seamless  
Carbon Steel and Austenitic Stainless Steel  
Pipe Nipples
- B32-2008 (R2014).....Standard Specification for Solder Metal
- B43-2014.....Standard Specification for Seamless Red Brass  
Pipe, Standard Sizes
- B61-2008 (R2013).....Standard Specification for Steam or Valve  
Bronze Castings
- B62-2009.....Standard Specification for Composition Bronze  
or Ounce Metal Castings
- B75/B75M-2011.....Standard Specification for Seamless Copper Tube
- B88-2014.....Standard Specification for Seamless Copper  
Water Tube
- B584-2014.....Standard Specification for Copper Alloy Sand  
Castings for General Applications
- B687-1999 (R2011).....Standard Specification for Brass, Copper, and  
Chromium-Plated Pipe Nipples
- C919-2012.....Standard Practice for Use of Sealants in  
Acoustical Applications
- D2000-2012.....Standard Classification System for Rubber  
Products in Automotive Applications

- E1120-2008.....Standard Specification for Liquid Chlorine
- E1229-2008.....Standard Specification for Calcium Hypochlorite
- E. American Water Works Association (AWWA):
- C110-2012.....Ductile-Iron and Gray-Iron Fittings
- C151-2009.....Ductile Iron Pipe, Centrifugally Cast
- C153-2011.....Ductile-Iron Compact Fittings
- C203-2008.....Coal-Tar Protective Coatings and Linings for  
Steel Water Pipelines - Enamel and Tape - Hot  
Applied
- C213-2007.....Fusion-Bonded Epoxy Coating for the Interior  
and Exterior of Steel Water Pipelines
- C651-2014.....Disinfecting Water Mains
- F. American Welding Society (AWS):
- A5.8M/A5.8-2011-AMD1....Specification for Filler Metals for Brazing and  
Braze Welding
- G. International Code Council (ICC):
- IPC-2012.....International Plumbing Code
- H. Manufacturers Specification Society (MSS):
- SP-58-2009.....Pipe Hangers and Supports - Materials, Design,  
Manufacture, Selection, Application, and  
Installation
- SP-72-2010a.....Ball Valves with Flanged or Butt-Welding Ends  
for General Service
- SP-110-2010.....Ball Valves Threaded, Socket-Welding, Solder  
Joint, Grooved and Flared Ends
- I. NSF International (NSF):
- 14-2015.....Plastics Piping System Components and Related  
Materials
- 61-2014a.....Drinking Water System Components - Health  
Effects
- 372-2011.....Drinking Water System Components - Lead Content
- J. Plumbing and Drainage Institute (PDI):
- PDI-WH 201-2010.....Water Hammer Arrestors
- K. Department of Veterans Affairs:
- H-18-8-2013.....Seismic Design Handbook

**1.4 SUBMITTALS**

- A. Submittals, including number of required copies, shall be submitted in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Information and material submitted under this section shall be marked "SUBMITTED UNDER SECTION 22 11 00, FACILITY WATER DISTRIBUTIONS", with applicable paragraph identification.
- C. Manufacturer's Literature and Data including: Full item description and optional features and accessories. Include dimensions, weights, materials, applications, standard compliance, model numbers, size, and capacity.
  - 1. All items listed in Part 2 - Products.
- D. Complete operating and maintenance manuals including wiring diagrams, technical data sheets and information for ordering replacement parts:
  - 1. Include complete list indicating all components of the systems.
  - 2. Include complete diagrams of the internal wiring for each item of equipment.
  - 3. Diagrams shall have their terminals identified to facilitate installation, operation and maintenance.

**1.5 QUALITY ASSURANCE**

- A. A certificate shall be submitted prior to welding of steel piping showing the Welder's certification. The certificate shall be current and no more than one year old. Welder's qualifications shall be in accordance with ASME BPVC Section IX.
- B. Not Used.
- C. All pipe, couplings, fittings, and specialties shall bear the identification of the manufacturer and any markings required by the applicable referenced standards.
- D. Bio-Based Materials: For products designated by the USDA's Bio-Preferred Program, provide products that meet or exceed USDA recommendations for bio-based content, so long as products meet all performance requirements in this specifications section. For more information regarding the product categories covered by the Bio-Preferred Program, visit <http://www.biopreferred.gov>.

**1.6 SPARE PARTS**

- A. For mechanical press-connect fittings, provide tools required for each pipe size used at the facility.

## **1.7 AS-BUILT DOCUMENTATION**

- A. Submit manufacturer's literature and data updated to include submittal review comments and any equipment substitutions.
- B. Submit operation and maintenance data updated to include submittal review comments, substitutions and construction revisions shall be in electronic version on compact disc or DVD inserted into a three ring binder. All aspects of system operation and maintenance procedures, including piping isometrics, wiring diagrams of all circuits, a written description of system design, control logic, and sequence of operation shall be included in the operation and maintenance manual. The operations and maintenance manual shall include troubleshooting techniques and procedures for emergency situations. Notes on all special systems or devices shall be included. A list of recommended spare parts (manufacturer, model number, and quantity) shall be furnished. Information explaining any special knowledge or tools the owner will be required to employ shall be inserted into the As-Built documentation.
- C. The installing contractor shall maintain as-built drawings of each completed phase for verification; and, shall provide the complete set at the time of final systems certification testing. As-built drawings are to be provided, and a copy of them in Auto-CAD version 2014 provided on compact disc or DVD. Should the installing contractor engage the testing company to provide as-built or any portion thereof, it shall not be deemed a conflict of interest or breach of the 'third party testing company' requirement.
- D. Certification documentation shall be provided to COR 10 working days prior to submitting the request for final inspection. The documentation shall include all test results, the names of individuals performing work for the testing agency on this project, detailed procedures followed for all tests, and certificate if applicable that all results of tests were within limits specified. If a certificate is not available, all documentation shall be on the Certifier's letterhead.

## **PART 2 - PRODUCTS**

### **2.1 MATERIALS**

- A. Material or equipment containing a weighted average of greater than 0.25 percent lead are prohibited in any potable water system intended for human consumption, and shall be certified in accordance with NSF 61

or NSF 372. Endpoint devices used to dispense water for drinking shall meet the requirements of NSF 61, Section 9.

- B. Plastic pipe, fittings, and solvent cement shall meet NSF 14 and shall be NSF listed for the service intended.

## **2.2 UNDERGROUND WATER SERVICE CONNECTIONS TO BUILDINGS NOT USED.**

### **2.3 ABOVE GROUND (INTERIOR) WATER PIPING**

- A. Pipe: Copper tube, ASTM B88, Type K or L, drawn. For pipe 150 mm (6 inches) and larger, stainless steel, ASTM A312, schedule 10 shall be used.
- B. Fittings for Copper Tube:
  - 1. Wrought copper or bronze castings conforming to ASME B16.18 and B16.22. Unions shall be bronze, MSS SP-72, MSS SP-110, solder or braze joints. Use 95/5 tin and antimony for all soldered joints.
  - 2. Not Used.
  - 3. Not Used.
  - 4. Mechanically formed tee connection: Form mechanically extracted collars in a continuous operation by drilling pilot hole and drawing out tube surface to form collar, having a height of not less than three times the thickness of tube wall. Adjustable collaring device shall ensure proper tolerance and complete uniformity of the joint. Notch and dimple joining branch tube in a single process to provide free flow where the branch tube penetrates the fitting. Braze joints.
  - 5. Flanged fittings, bronze, class 150, solder-joint ends conforming to ASME B16.24.
- C. Fittings for Stainless Steel:
  - 1. Stainless steel butt-welded fittings, Type 316, Schedule 10, conforming to ASME B16.9.
  - 2. Grooved fittings, stainless steel, Type 316, Schedule 10 conforming to ASTM A403/A403M. Segmentally fabricated fittings are not allowed. Mechanical grooved couplings, ductile iron, 4138 kPa (600 psig), ASTM A536 Grade 448-310-12 (Grade 65-45-12), or malleable iron, ASTM A47/A47M Grade 22410 (Grade 32510) housing, with EPDM gasket, steel track head bolts, ASTM A183, coated with copper colored alkyd enamel.
- D. Adapters: Provide adapters for joining pipe or tubing with dissimilar end connections.
- E. Solder: ASTM B32 alloy type Sb5, HA or HB. Provide non-corrosive flux.



F. Brazing alloy: AWS A5.8M/A5.8, brazing filler metals shall be BCuP series for copper to copper joints and BAg series for copper to steel joints.

G. Not Used.

#### **2.4 EXPOSED WATER PIPING**

A. Finished Room: Use full iron pipe size chrome plated brass piping for exposed water piping connecting fixtures, casework, cabinets, equipment and reagent racks when not concealed by apron including those furnished by the Government or specified in other sections.

1. Pipe: ASTM B43, standard weight.
2. Fittings: ASME B16.15 cast bronze threaded fittings with chrome finish.
3. Nipples: ASTM B687, Chromium-plated.
4. Unions: MSS SP-72, MSS SP-110, brass or bronze with chrome finish. Unions 65 mm (2-1/2 inches) and larger shall be flange type with approved gaskets.

B. Unfinished Rooms, Mechanical Rooms and Kitchens: Chrome-plated brass piping is not required. Paint piping systems as specified in Section 09 91 00, PAINTING.

#### **2.5 ETHYLENE OXIDE (ETO) STERILIZER WATER SUPPLY PIPING NOT USED.**

#### **2.6 TRAP PRIMER WATER PIPING NOT USED.**

#### **2.7 STRAINERS**

- A. Provide on high pressure side of pressure reducing valves, on suction side of pumps, on inlet side of indicating and control instruments and equipment subject to sediment damage and where shown on drawings. Strainer element shall be removable without disconnection of piping.
- B. Water: Basket or "Y" type with easily removable cover and brass strainer basket.
- C. Body: Less than 75 mm (3 inches), brass or bronze; 75 mm (3 inches) and greater, cast iron or semi-steel.

#### **2.8 DIELECTRIC FITTINGS**

- A. Provide dielectric couplings or unions between pipe of dissimilar metals.

#### **2.9 STERILIZATION CHEMICALS**

- A. Hypochlorite: ASTM E1120.
- B. Liquid Chlorine: ASTM E1229.

## 2.10 WATER HAMMER ARRESTER

A. Closed copper tube chamber with permanently sealed 413 kPa (60 psig) air charge above a Double O-ring piston. Two high heat Buna-N O-rings pressure packed and lubricated with FDA approved silicone compound. All units shall be designed in accordance with ASSE 1010. Access shall be provided where devices are concealed within partitions or above ceilings. Size and install in accordance with PDI-WH 201 requirements. Provide water hammer arrestors at:

1. All solenoid valves.
2. All groups of two or more flush valves.
3. All quick opening or closing valves.
4. All medical washing equipment.

## PART 3 - EXECUTION

### 3.1 INSTALLATION

A. General: Comply with the International Plumbing Code and the following:

1. Install branch piping for water from the piping system and connect to all fixtures, valves, cocks, outlets, casework, cabinets and equipment, including those furnished by the Government or specified in other sections.
2. Pipe shall be round and straight. Cutting shall be done with proper tools. Pipe, except for plastic and glass, shall be reamed to remove burrs and a clean smooth finish restored to full pipe inside diameter.
3. All pipe runs shall be laid out to avoid interference with other work/trades.
4. Install union and shut-off valve on pressure piping at connections to equipment.
5. Pipe Hangers, Supports and Accessories:
  - a. All piping shall be supported per the IPC, H-18-8 Seismic Design Handbook, MSS SP-58, and SMACNA as required.
  - b. Shop Painting and Plating: Hangers, supports, rods, inserts and accessories used for pipe supports shall be shop coated with zinc chromate primer paint. Electroplated copper hanger rods, hangers and accessories may be used with copper tubing.
  - c. Floor, Wall and Ceiling Plates, Supports, Hangers:
    - 1) Solid or split un-plated cast iron.
    - 2) All plates shall be provided with set screws.
    - 3) Pipe Hangers: Height adjustable clevis type.

- 4) Adjustable Floor Rests and Base Flanges: Steel.
  - 5) Concrete Inserts: "Universal" or continuous slotted type.
  - 6) Hanger Rods: Mild, low carbon steel, fully threaded or Threaded at each end with two removable nuts at each end for positioning rod and hanger and locking each in place.
  - 7) Pipe Hangers and Riser Clamps: Malleable iron or carbon steel. Pipe Hangers and riser clamps shall have a copper finish when supporting bare copper pipe or tubing.
  - 8) Rollers: Cast iron.
  - 9) Self-drilling type expansion shields shall be "Phillips" type, with case hardened steel expander plugs.
  - 10) Hangers and supports utilized with insulated pipe and tubing shall have 180 degree (minimum) metal protection shield centered on and welded to the hanger and support. The shield thickness and length shall be engineered and sized for distribution of loads to preclude crushing of insulation without breaking the vapor barrier. The shield shall be sized for the insulation and have flared edges to protect vapor-retardant jacket facing. To prevent the shield from sliding out of the clevis hanger during pipe movement, center-ribbed shields shall be used.
  - 11) Miscellaneous Materials: As specified, required, directed or as noted on the drawings for proper installation of hangers, supports and accessories. If the vertical distance exceeds 6.1 m (20 feet) for cast iron pipe additional support shall be provided in the center of that span. Provide all necessary auxiliary steel to provide that support.
6. Install chrome plated cast brass escutcheon with set screw at each wall, floor and ceiling penetration in exposed finished locations and within cabinets and millwork.
7. Penetrations:
- a. Firestopping: Where pipes pass through fire partitions, fire walls, smoke partitions, or floors, install a fire stop that provides an effective barrier against the spread of fire, smoke, and gases as specified in Section 07 84 00, FIRESTOPPING. Completely fill and seal clearances between raceways and openings with the firestopping materials.

- b. Waterproofing: At floor penetrations, completely seal clearances around the pipe and make watertight with sealant as specified in Section 07 92 00, JOINT SEALANTS. Bio-based materials shall be utilized when possible.
  - c. Acoustical sealant: Where pipes pass through sound rated walls, seal around the pipe penetration with an acoustical sealant that is compliant with ASTM C919.
- B. Domestic Water piping shall conform to the following:
  - 1. Grade all lines to facilitate drainage. Provide drain valves at bottom of risers and all low points in system. Design domestic hot water circulating lines with no traps.
  - 2. Connect branch lines at bottom of main serving fixtures below and pitch down so that main may be drained through fixture. Connect branch lines to top of main serving only fixtures located on floor above.

### 3.2 TESTS

- A. General: Test system either in its entirety or in sections. Submit testing plan to COR 10 working days prior to test date.
- B. Potable Water System: Test after installation of piping and domestic water heaters, but before piping is concealed, before covering is applied, and before plumbing fixtures are connected. Fill systems with water and maintain hydrostatic pressure of 1035 kPa (150 psig) gage for two hours. No decrease in pressure is allowed. Provide a pressure gage with a shutoff and bleeder valve at the highest point of the piping being tested. Pressure gauge shall have 1 psig increments.
- C. Not Used.
- D. All Other Piping Tests: Test new installed piping under 1-1/2 times actual operating conditions and prove tight.
- E. The test pressure shall hold for the minimum time duration required by the applicable plumbing code or authority having jurisdiction.

### 3.3 STERILIZATION

- A. After tests have been successfully completed, thoroughly flush and sterilize the interior domestic water distribution system in accordance with AWWA C651.
- B. Use liquid chlorine or hypochlorite for sterilization.

**3.4 COMMISSIONING NOT USED.**

**3.5 DEMONSTRATION AND TRAINING**

- A. Provide services of manufacturer's technical representative for four hours to instruct VA Personnel in operation and maintenance of the system.

- - - E N D - - -



**SECTION 22 13 00  
FACILITY SANITARY AND VENT PIPING**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section pertains to sanitary sewer and vent systems, including piping, equipment and all necessary accessories as designated in this section.
- B. A complete listing of all acronyms and abbreviations are included in Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.

**1.2 RELATED WORK**

- A. Section 01 00 00, GENERAL REQUIREMENTS.
- B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- C. Section 01 81 13, SUSTAINABLE CONSTRUCTION REQUIREMENTS.
- D. Not Used.
- E. Section 07 84 00, FIRESTOPPING: Penetrations in rated enclosures.
- F. Section 07 92 00, JOINT SEALANTS: Sealant products.
- G. Section 09 91 00, PAINTING: Preparation and finish painting and identification of piping systems.
- H. Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING: Pipe Hangers and Supports, Materials Identification.
- I. Section 22 07 11, PLUMBING INSULATION.
- J. Not Used.
- K. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS
- L. Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS

**1.3 APPLICABLE PUBLICATIONS**

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American Society of Mechanical Engineers (ASME):
  - A13.1-2007.....Scheme for the Identification of Piping Systems
  - A112.36.2M-1991(R 2012).Cleanouts
  - A112.6.3-2001 (R2007)...Standard for Floor and Trench Drains
  - B1.20.1-2013.....Pipe Threads, General Purpose (Inch)
  - B16.1-2010.....Gray Iron Pipe Flanges and Flanged Fittings
  - B16.4-2011.....Standard for Grey Iron Threaded Fittings
    - Classes 125 and 250
  - B16.15-2013.....Cast Copper Alloy Threaded Fittings, Classes
    - 125 and 250

- B16.18-2012.....Cast Copper Alloy Solder Joint Pressure  
Fittings
- B16.21-2011.....Nonmetallic Flat Gaskets for Pipe Flanges
- B16.22-2013.....Wrought Copper and Copper Alloy Solder-Joint  
Pressure Fittings
- B16.23-2011.....Cast Copper Alloy Solder Joint Drainage  
Fittings: DWV
- B16.24-2001 (R2006).....Cast Copper Alloy Pipe Flanges and Flanged  
Fittings
- B16.29-2012.....Wrought Copper and Wrought Copper Alloy Solder-  
Joint Drainage Fittings: DWV
- B16.39-2009.....Malleable Iron Threaded Pipe Unions Classes  
150, 250, and 300
- B18.2.1-2012.....Square, Hex, Heavy Hex, and Askew Head Bolts  
and Hex, Heavy Hex, Hex Flange, Lobed Head, and  
Lag Screws (Inch Series)
- C. American Society of Sanitary Engineers (ASSE):
- 1001-2008.....Performance Requirements for Atmospheric Type  
Vacuum Breakers
- 1018-2001.....Performance Requirements for Trap Seal Primer  
Valves - Potable Water Supplied
- 1044-2001.....Performance Requirements for Trap Seal Primer  
Devices - Drainage Types and Electronic Design  
Types
- 1079-2012.....Performance Requirements for Dielectric Pipe  
Unions
- D. American Society for Testing and Materials (ASTM):
- A53/A53M-2012.....Standard Specification for Pipe, Steel, Black  
And Hot-Dipped, Zinc-coated, Welded and  
Seamless
- A74-2013a.....Standard Specification for Cast Iron Soil Pipe  
and Fittings
- A888-2013a.....Standard Specification for Hubless Cast Iron  
Soil Pipe and Fittings for Sanitary and Storm  
Drain, Waste, and Vent Piping Applications
- B32-2008.....Standard Specification for Solder Metal
- B43-2009.....Standard Specification for Seamless Red Brass  
Pipe, Standard Sizes



- B75-2011.....Standard Specification for Seamless Copper Tube
- B88-2009.....Standard Specification for Seamless Copper  
Water Tube
- B306-2013.....Standard Specification for Copper Drainage Tube  
(DWV)
- B584-2013.....Standard Specification for Copper Alloy Sand  
Castings for General Applications
- B687-1999 (R 2011).....Standard Specification for Brass, Copper, and  
Chromium-Plated Pipe Nipples
- B813-2010.....Standard Specification for Liquid and Paste  
Fluxes for Soldering of Copper and Copper Alloy  
Tube
- B828-2002 (R 2010).....Standard Practice for Making Capillary Joints  
by Soldering of Copper and Copper Alloy Tube  
and Fittings
- C564-2012.....Standard Specification for Rubber Gaskets for  
Cast Iron Soil Pipe and Fittings
- D2321-2011.....Standard Practice for Underground Installation  
of Thermoplastic Pipe for Sewers and Other  
Gravity-Flow Applications
- F477-2010.....Standard Specification for Elastomeric Seals  
(Gaskets) for Joining Plastic Pipe
- F1545-1997 (R 2009).....Standard Specification for Plastic-Lined  
Ferrous Metal Pipe, Fittings, and Flanges
- E. Cast Iron Soil Pipe Institute (CISPI):
- 2006.....Cast Iron Soil Pipe and Fittings Handbook
- 301-2012.....Standard Specification for Hubless Cast Iron  
Soil Pipe and Fittings for Sanitary and Storm  
Drain, Waste, and Vent Piping Applications
- 310-2012.....Specification for Coupling for Use in  
Connection with Hubless Cast Iron Soil Pipe and  
Fittings for Sanitary and Storm Drain, Waste,  
and Vent Piping Applications
- F. Copper Development Association, Inc. (CDA):
- A4015.....Copper Tube Handbook
- G. International Code Council (ICC):
- IPC-2012.....International Plumbing Code

- H. Manufacturers Standardization Society (MSS):  
SP-123-2013.....Non-Ferrous Threaded and Solder-Joint Unions  
for Use With Copper Water Tube
- I. National Fire Protection Association (NFPA):  
70-2014.....National Electrical Code (NEC)
- J. Plumbing and Drainage Institute (PDI):  
WH-201 (R 2010).....Water Hammer Arrestors Standard
- K. Underwriters' Laboratories, Inc. (UL):  
508-99 (R2013).....Standard For Industrial Control Equipment

## 1.4 SUBMITTALS

- A. Submittals, including number of required copies, shall be submitted in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Information and material submitted under this section shall be marked "SUBMITTED UNDER SECTION 22 13 00, FACILITY SANITARY AND VENT PIPING", with applicable paragraph identification.
- C. Manufacturer's Literature and Data including: Full item description and optional features and accessories. Include dimensions, weights, materials, applications, standard compliance, model numbers, size, and capacity.
  - 1. Piping.
  - 2. Floor Drains.
  - 3. Not Used.
  - 4. Cleanouts.
  - 5. Trap Seal Protection.
  - 6. Penetration Sleeves.
  - 7. Pipe Fittings.
  - 8. Traps.
  - 9. Exposed Piping and Fittings.
- D. Detailed shop drawing of clamping device and extensions when required in connection with the waterproofing membrane or the floor drain.

## 1.5 QUALITY ASSURANCE

- A. Bio-Based Materials: For products designated by the USDA's Bio-Preferred Program, provide products that meet or exceed USDA recommendations for bio-based content, so long as products meet all performance requirements in this specifications section. For more information regarding the product categories covered by the Bio-Preferred Program, visit <http://www.biopreferred.gov>.

## 1.6 AS-BUILT DOCUMENTATION

- A. The installing contractor shall maintain as-built drawings of each completed phase for verification; and, shall provide the complete set at the time of final systems certification testing. As-built drawings are to be provided, and a copy of them on Auto-Cad version 2014 provided on compact disk or DVD. Should the installing contractor engage the testing company to provide as-built or any portion thereof, it shall not be deemed a conflict of interest or breach of the 'third party testing company' requirement.
- B. Certification documentation shall be provided prior to submitting the request for final inspection. The documentation shall include all test results, the names of individuals performing work for the testing agency on this project, detailed procedures followed for all tests, and a certification that all results of tests were within limits specified.

## PART 2 - PRODUCTS

### 2.1 SANITARY WASTE, DRAIN, AND VENT PIPING

- A. Cast iron waste, drain, and vent pipe and fittings.
  - 1. Cast iron waste, drain, and vent pipe and fittings shall be used for the following applications:
    - a. Pipe buried in or in contact with earth.
    - b. Sanitary pipe extensions to a distance of approximately 1500 mm (5 feet) outside of the building.
    - c. Interior waste and vent piping above grade.
  - 2. Cast iron Pipe shall be bell and spigot or hubless (plain end or no-hub or hubless).
  - 3. The material for all pipe and fittings shall be cast iron soil pipe and fittings and shall conform to the requirements of CISPI 301, ASTM A888, or ASTM A74.
  - 4. Cast iron pipe and fittings shall be made from a minimum of 95 percent post-consumer recycled material.
  - 5. Joints for hubless pipe and fittings shall conform to the manufacturer's installation instructions. Couplings for hubless joints shall conform to CISPI 310. Joints for hub and spigot pipe shall be installed with compression gaskets conforming to the requirements of ASTM C564.
- B. Copper Tube, (DWV):
  - 1. Copper DWV tube sanitary waste, drain and vent pipe may be used for piping above ground, except for urinal drains.

2. The copper DWV tube shall be drainage type, drawn temper conforming to ASTM B306.
3. The copper drainage fittings shall be cast copper or wrought copper conforming to ASME B16.23 or ASME B16.29.
4. The joints shall be lead free, using a water flushable flux, and conforming to ASTM B32.

## **2.2 PUMP DISCHARGE PIPING**

### **A. Galvanized steel pump discharge pipe and fittings:**

1. Galvanized steel pipe shall be Schedule 40 weight class conforming to ASTM A53/A53M, with square cut grooved or threaded ends to match joining method.
2. Fittings shall be Class 125, gray-iron threaded fittings conforming to ASME B16.4.
3. Unions shall be Class 150 hexagonal-stock body with ball and socket, metal to metal, bronze seating surface, malleable iron conforming to ASME B16.39 with female threaded ends.
4. Flanges shall be Class 125 cast iron conforming to ASME B16.1.
  - a. Flange gaskets shall be full face, flat nonmetallic, asbestos free conforming to ASME B16.21.
  - b. Flange nuts and bolts shall be carbon steel conforming to ASME B18.2.1.

### **B. Copper pump discharge pipe and fittings:**

1. Copper tube shall be hard drawn Type L conforming to ASTM B88.
2. Fittings shall be cast copper alloy conforming to ASME B16.18 or wrought copper conforming to ASME B16.22 with solder joint ends.
3. Unions shall be copper alloy, hexagonal stock body with ball and socket, metal to metal seating surface conforming to MSS SP-123 with female solder-joint.
4. Flanges shall be Class 150, cast copper conforming to ASME B16.24 with solder-joint end.
  - a. Flange gaskets shall be full face, flat nonmetallic, asbestos free conforming to ASME B16.21.
  - b. Flange nuts and bolts shall be carbon steel conforming to ASME B18.2.1.
5. Solder shall be lead free, water flushable flux conforming to ASTM B32 and ASTM B813.

### 2.3 EXPOSED WASTE PIPING

- A. Chrome plated brass piping of full iron pipe size shall be used in finished rooms for exposed waste piping connecting fixtures, casework, cabinets, equipment and reagent racks when not concealed by apron including those furnished by the Government or specified in other sections.
  - 1. The Pipe shall meet ASTM B43, regular weight.
  - 2. The Fittings shall conform to ASME B16.15.
  - 3. Nipples shall conform to ASTM B687, Chromium-plated.
  - 4. Unions shall be brass or bronze with chrome finish. Unions 65 mm (2-1/2 inches) and larger shall be flange type with approved gaskets.
- B. In unfinished Rooms such as mechanical Rooms and Kitchens, Chrome-plated brass piping is not required. The pipe materials specified under the paragraph "Sanitary Waste, Drain, and Vent Piping" can be used. The sanitary pipe in unfinished rooms shall be painted as specified in Section 09 91 00, PAINTING.

### 2.4 SPECIALTY PIPE FITTINGS

- A. Transition pipe couplings shall join piping with small differences in outside diameters or different materials. End connections shall be of the same size and compatible with the pipes being joined. The transition coupling shall be elastomeric, sleeve type reducing or transition pattern and include shear and corrosion resistant metal, tension band and tightening mechanism on each end. The transition coupling sleeve coupling shall be of the following material:
  - 1. For cast iron soil pipes, the sleeve material shall be rubber conforming to ASTM C564.
  - 2. Not Used.
  - 3. For dissimilar pipes, the sleeve material shall be PVC conforming to ASTM D5926, or other material compatible with the pipe materials being joined.
- B. The dielectric fittings shall conform to ASSE 1079 with a pressure rating of 861 kPa (125 psig) at a minimum temperature of 82 degrees C (180 degrees F). The end connection shall be solder joint copper alloy and threaded ferrous.
- C. Dielectric flange insulating kits shall be of non-conducting materials for field assembly of companion flanges with a pressure rating of 1035 kPa (150 psig). The gasket shall be neoprene or phenolic. The bolt

sleeves shall be phenolic or polyethylene. The washers shall be phenolic with steel backing washers.

- D. The di-electric nipples shall be electroplated steel nipple complying with ASTM F1545 with a pressure rating of 2070 kPa (300 psig) at 107 degrees C (225 degrees F). The end connection shall be male threaded. The lining shall be inert and noncorrosive propylene.

## 2.5 CLEANOUTS

- A. Cleanouts shall be the same size as the pipe, up to 100 mm (4 inches); and not less than 100 mm (4 inches) for larger pipe. Cleanouts shall be easily accessible and shall be gastight and watertight. Minimum clearance of 600 mm (24 inches) shall be provided for clearing a clogged sanitary line.
- B. Floor cleanouts shall be gray iron housing with clamping device and round, secured, scoriated, gray iron cover conforming to ASME A112.36.2M. A gray iron ferrule with hubless, socket, inside calk or spigot connection and counter sunk, taper-thread, brass or bronze closure plug shall be included. The frame and cover material and finish shall be nickel-bronze copper alloy with a square shape. The cleanout shall be vertically adjustable for a minimum of 50 mm (2 inches). When a waterproof membrane is used in the floor system, clamping collars shall be provided on the cleanouts. Cleanouts shall consist of wye fittings and eighth bends with brass or bronze screw plugs. Cleanouts in the resilient tile floors, quarry tile and ceramic tile floors shall be provided with square top covers recessed for tile insertion. In the carpeted areas, carpet cleanout markers shall be provided. Two way cleanouts shall be provided where indicated on drawings and at every building exit. The loading classification for cleanouts in sidewalk areas or subject to vehicular traffic shall be heavy duty type.
- C. Cleanouts shall be provided at or near the base of the vertical stacks with the cleanout plug located approximately 600 mm (24 inches) above the floor. If there are no fixtures installed on the lowest floor, the cleanout shall be installed at the base of the stack. The cleanouts shall be extended to the wall access cover. Cleanout shall consist of sanitary tees. Nickel-bronze square frame and stainless steel cover with minimum opening of 150 by 150 mm (6 by 6 inches) shall be furnished at each wall cleanout. Where the piping is concealed, a fixture trap or a fixture with integral trap, readily removable without disturbing concealed pipe, shall be accepted as a cleanout equivalent

providing the opening to be used as a cleanout opening is the size required.

- D. In horizontal runs above grade, cleanouts shall consist of cast brass tapered screw plug in fitting or caulked/hubless cast iron ferrule. Plain end (hubless) piping in interstitial space or above ceiling may use plain end (hubless) blind plug and clamp.

## **2.6 FLOOR DRAINS**

- A. General Data: floor drain shall comply with ASME A112.6.3. A caulking flange, inside gasket, or hubless connection shall be provided for connection to cast iron pipe, screwed or no hub outlets for connection to steel pipe. The drain connection shall be bottom outlet. A membrane clamp and extensions shall be provided, if required, where installed in connection with waterproof membrane. Puncturing membrane other than for drain opening will not be permitted. Double drainage pattern floor drains shall have integral seepage pan for embedding into floor construction, and weep holes to provide adequate drainage from pan to drain pipe. For drains not installed in connection with a waterproof membrane, a 1.1 to 1.8 Kg (2.5 to 4 lbs.) flashing membrane, 600 mm (24 inches) square or another approved waterproof membrane shall be provided.
- B. Not Used.
- C. Type C (FD-C) medium duty (non-traffic) floor drain shall comply with ASME A112.6.3. The type C floor drain shall have a cast iron body, double drainage pattern, clamping device, light duty nickel bronze adjustable strainer with round or square grate of 150 mm (6 inches) width or diameter minimum for toilet rooms, showers and kitchens.
- D. Type D (FD-D) medium duty (non-traffic) floor drain shall comply with ASME A112.6.3. The type D floor drain shall have a cast iron body with flange for membrane type flooring, integral reversible clamping device, seepage openings and 175 mm (7 inch) diameter or square satin nickel bronze or satin bronze strainer with 100 mm (4 inch) flange for toilet rooms, showers and kitchens.
- E. Not Used.
- F. Type F (FD-F) medium duty (non-traffic) floor drain shall comply with ASME A112.6.3. The type F floor drain shall be have a cast iron body with flange, integral reversible clamping device, seepage openings and a 228 mm (9 inch) two-piece satin nickel-bronze or satin bronze

strainer for use with seamless vinyl floors in toilet rooms and showers.

## **2.7 TRAPS**

- A. Traps shall be provided on all sanitary branch waste connections from fixtures or equipment not provided with traps. Exposed brass shall be polished brass chromium plated with nipple and set screw escutcheons. Concealed traps may be rough cast brass or same material as the piping they are connected to. Slip joints are not permitted on sewer side of trap. Traps shall correspond to fittings on cast iron soil pipe or steel pipe respectively, and size shall be as required by connected service or fixture.

## **2.8 PRIMER VALVES AND TRAP SEAL PRIMER SYSTEMS NOT USED.**

## **2.9 PENETRATION SLEEVES NOT USED.**

# **PART 3 - EXECUTION**

## **3.1 PIPE INSTALLATION**

- A. The pipe installation shall comply with the requirements of the International Plumbing Code (IPC) and these specifications.
- B. Branch piping shall be installed for waste from the respective piping systems and connect to all fixtures, valves, cocks, outlets, casework, cabinets and equipment, including those furnished by the Government or specified in other sections.
- C. Pipe shall be round and straight. Cutting shall be done with proper tools. Pipe shall be reamed to full size after cutting.
- D. All pipe runs shall be laid out to avoid interference with other work.
- E. The piping shall be installed above accessible ceilings where possible.
- F. The piping shall be installed to permit valve servicing or operation.
- G. The piping shall be installed free of sags and bends.
- H. Seismic restraint shall be installed where required by code.
- I. Changes in direction for soil and waste drainage and vent piping shall be made using appropriate branches, bends and long sweep bends. Sanitary tees and short sweep quarter bends may be used on vertical stacks if change in direction of flow is from horizontal to vertical. Long turn double wye branch and eighth bend fittings shall be used if two fixtures are installed back to back or side by side with common drain pipe. Straight tees, elbows, and crosses may be used on vent lines. Do not change direction of flow more than 90 degrees. Proper size of standard increaser and reducers shall be used if pipes of



different sizes are connected. Reducing size of drainage piping in direction of flow is prohibited.

- J. Buried soil and waste drainage and vent piping shall be laid beginning at the low point of each system. Piping shall be installed true to grades and alignment indicated with unbroken continuity of invert. Hub ends shall be placed upstream. Required gaskets shall be installed according to manufacturer's written instruction for use of lubricants, cements, and other installation requirements.
- K. Cast iron piping shall be installed according to CISPI's "Cast Iron Soil Pipe and Fittings Handbook," Chapter IV, "Installation of Cast Iron Soil Pipe and Fittings"
- L. Aboveground copper tubing shall be installed according to Copper Development Association's (CDA) "Copper Tube Handbook".
- M. Not Used.
- N. If an installation is unsatisfactory to the COR, the Contractor shall correct the installation at no cost to the Government.

### **3.2 JOINT CONSTRUCTION**

- A. Hub and spigot, cast iron piping with gasket joints shall be joined in accordance with CISPI's "Cast Iron Soil Pipe and Fittings Handbook" for compression joints.
- B. Hub and spigot, cast iron piping with calked joints shall be joined in accordance with CISPI's "Cast Iron Soil Pipe and Fittings Handbook" for lead and oakum calked joints.
- C. Hubless or No-hub, cast iron piping shall be joined in accordance with CISPI's "Cast Iron Soil Pipe and Fittings Handbook" for hubless piping coupling joints.
- D. For threaded joints, thread pipe with tapered pipe threads according to ASME B1.20.1. The threads shall be cut full and clean using sharp disc cutters. Threaded pipe ends shall be reamed to remove burrs and restored to full pipe inside diameter. Pipe fittings and valves shall be joined as follows:
  - 1. Apply appropriate tape or thread compound to external pipe threads unless dry seal threading is required by the pipe service.
  - 2. Pipe sections with damaged threads shall be replaced with new sections of pipe.
- E. Copper tube and fittings with soldered joints shall be joined according to ASTM B828. A water flushable, lead free flux conforming to ASTM B813 and a lead free alloy solder conforming to ASTM B32 shall be used.

### 3.3 SPECIALTY PIPE FITTINGS

- A. Transition coupling shall be installed at pipe joints with small differences in pipe outside diameters.
- B. Dielectric fittings shall be installed at connections of dissimilar metal piping and tubing.

### 3.4 PIPE HANGERS, SUPPORTS AND ACCESSORIES

- A. All piping shall be supported according to the International Plumbing Code (IPC), Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING, and these specifications. Where conflicts arise between these the code and Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING the most restrictive or the requirement that specifies supports with highest loading or shortest spacing shall apply.
- B. Hangers, supports, rods, inserts and accessories used for pipe supports shall be painted according to Section 09 91 00, PAINTING. Electroplated copper hanger rods, hangers and accessories may be used with copper tubing.
- C. Horizontal piping and tubing shall be supported within 300 mm (12 inches) of each fitting or coupling.
- D. Horizontal cast iron piping shall be supported with the following maximum horizontal spacing and minimum hanger rod diameters:
  - 1. 40 mm or DN40 to 50 mm or DN50 (NPS 1-1/2 inch to NPS 2 inch): 1500 mm (60 inches) with 10 mm (3/8 inch) rod.
  - 2. 75 mm or DN75 (NPS 3 inch): 1500 mm (60 inches) with 15 mm (1/2 inch) rod.
  - 3. 100 mm or DN100 to 125 mm or DN125 (NPS 4 inch to NPS 5 inch): 1500 mm (60 inches) with 18 mm (5/8 inch) rod.
  - 4. 150 mm or DN150 to 200 mm or DN200 (NPS 6 inch to NPS 8 inch): 1500 mm (60 inches) with 20 mm (3/4 inch) rod.
  - 5. 250 mm or DN250 to 300 mm or DN300 (NPS 10 inch to NPS 12 inch): 1500 mm (60 inch) with 23 mm (7/8 inch) rod.
- E. Not Used.
- F. Vertical piping and tubing shall be supported at the base, at each floor, and at intervals no greater than 4.6 m (15 feet).
- G. In addition to the requirements in Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING, Floor, Wall and Ceiling Plates, Supports, Hangers shall have the following characteristics:
  - 1. Solid or split unplated cast iron.
  - 2. All plates shall be provided with set screws.

3. Height adjustable clevis type pipe hangers.
  4. Adjustable floor rests and base flanges shall be steel.
  5. Hanger rods shall be low carbon steel, fully threaded or threaded at each end with two removable nuts at each end for positioning rod and hanger and locking each in place.
  6. Riser clamps shall be malleable iron or steel.
  7. Rollers shall be cast iron.
  8. See Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING, for requirements on insulated pipe protective shields at hanger supports.
- H. Miscellaneous materials shall be provided as specified, required, directed or as noted on the drawings for proper installation of hangers, supports and accessories. If the vertical distance exceeds 6.1 m (20 feet) for cast iron pipe additional support shall be provided in the center of that span. All necessary auxiliary steel shall be provided to provide that support.
- I. Cast escutcheon with set screw shall be provided at each wall, floor and ceiling penetration in exposed finished locations and within cabinets and millwork.
- J. Penetrations:
1. Fire Stopping: Where pipes pass through fire partitions, fire walls, smoke partitions, or floors, a fire stop shall be installed that provides an effective barrier against the spread of fire, smoke and gases as specified in Section 07 84 00, FIRESTOPPING. Clearances between raceways and openings shall be completely filled and sealed with the fire stopping materials.
  2. Water proofing: At floor penetrations, clearances shall be completely sealed around the pipe and make watertight with sealant as specified in Section 07 92 00, JOINT SEALANTS.

### 3.5 TESTS

- A. Sanitary waste and drain systems shall be tested either in its entirety or in sections.
- B. Waste System tests shall be conducted before trenches are backfilled or fixtures are connected. A water test or air test shall be conducted, as directed.
1. If entire system is tested for a water test, tightly close all openings in pipes except highest opening, and fill system with water to point of overflow. If the waste system is tested in sections,

- tightly plug each opening except highest opening of section under test, fill each section with water and test with at least a 3 m (10 foot) head of water. In testing successive sections, test at least upper 3 m (10 feet) of next preceding section so that each joint or pipe except upper most 3 m (10 feet) of system has been submitted to a test of at least a 3 m (10 foot) head of water. Water shall be kept in the system, or in portion under test, for at least 15 minutes before inspection starts. System shall then be tight at all joints.
2. For an air test, an air pressure of 34 kPa (5 psig) gage shall be maintained for at least 15 minutes without leakage. A force pump and mercury column gage shall be used for the air test.
  3. After installing all fixtures and equipment, open water supply so that all p-traps can be observed. For 15 minutes of operation, all p-traps shall be inspected for leaks and any leaks found shall be corrected.
  4. Final Tests: Either one of the following tests may be used.
    - a. Smoke Test: After fixtures are permanently connected and traps are filled with water, fill entire drainage and vent systems with smoke under pressure of .25 kPa (1 inch of water) with a smoke machine. Chemical smoke is prohibited.
    - b. Peppermint Test: Introduce 60 ml (2 ounces) of peppermint into each line or stack.

- - - E N D - - -

**SECTION 22 14 00  
FACILITY STORM DRAINAGE**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section describes the requirements for storm drainage systems, including piping and all necessary accessories as designated in this section.
- B. A complete listing of all acronyms and abbreviations are included in Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.

**1.2 RELATED WORK**

- A. Section 01 00 00, GENERAL REQUIREMENTS.
- B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- C. Section 01 81 13, SUSTAINABLE CONSTRUCTION REQUIREMENTS.
- E. Section 07 84 00, FIRESTOPPING: Penetrations in rated enclosures.
- F. Section 07 92 00, JOINT SEALANTS.
- G. Section 09 91 00, PAINTING: Preparation and finish painting and identification of piping systems.
- H. Not Used.
- I. Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING: Pipe Hangers and Supports, Materials Identification.
- J. Section 22 05 33, HEAT TRACING FOR PLUMBING PIPING.
- K. Section 22 07 11, PLUMBING INSULATION.

**1.3 APPLICABLE PUBLICATIONS**

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American Society of Mechanical Engineers (ASME):
  - A112.6.4-2003 (R2012) ..Roof, Deck, and Balcony Drains
  - A13.1-2007 (R2013).....Scheme for Identification of Piping Systems
  - B1.20.1-2013.....Pipe Threads, General Purpose, Inch
  - B16.3-2011.....Malleable Iron Threaded Fittings: Classes 150 and 300
  - B16.9-2012.....Factory-Made Wrought Buttwelding Fittings
  - B16.11-2011.....Forged Fittings, Socket-Welding and Threaded
  - B16.12-2009 (R2014).....Cast Iron Threaded Drainage Fittings
  - B16.15-2013.....Cast Copper Alloy Threaded Fittings: Classes 125 and 250
  - B16.18-2012.....Cast Copper Alloy Solder-Joint Pressure Fittings

- B16.22-2013.....Wrought Copper and Copper Alloy Solder-Joint  
Pressure Fittings
- B16.23-2011.....Cast Copper Alloy Solder Joint Drainage  
Fittings - DWV
- B16.29-2012.....Wrought Copper and Wrought Copper Alloy Solder-  
Joint Drainage Fittings - DWV
- C. American Society of Sanitary Engineering (ASSE)
- 1079-2012.....Performance Requirements for Dielectric Pipe  
Unions
- D. American Society for Testing and Materials (ASTM):
- A47/A47M-1999 (R2014)...Standard Specification for Ferritic Malleable  
Iron Castings
- A53/A53M-2012.....Standard Specification for Pipe, Steel, Black  
And Hot-Dipped, Zinc-coated Welded and Seamless
- A74-2013a.....Standard Specification for Cast Iron Soil Pipe  
and Fittings
- A183-2014.....Standard Specification for Carbon Steel Track  
Bolts and Nuts
- A536-1984(R2014).....Standard Specification for Ductile Iron  
Castings
- A733-2013.....Standard Specification for Welded and Seamless  
Carbon Steel and Austenitic Stainless Steel  
Pipe Nipples
- A888-2013a.....Standard Specification for Hubless Cast Iron  
Soil Pipe and Fittings for Sanitary and Storm  
Drain, Waste, and Vent Piping Applications
- B32-2008 (R2014).....Standard Specification for Solder Metal
- B61-2008 (R2013).....Standard Specification for Steam or Valve  
Bronze Castings
- B62-2009.....Standard Specification for Composition Bronze  
or Ounce Metal Castings
- B75/B75M-2011.....Standard Specification for Seamless Copper Tube
- B88-2014.....Standard Specification for Seamless Copper  
Water Tube
- B306-2013.....Standard Specification for Copper Drainage Tube  
(DWV)
- B584-2014.....Standard Specification for Copper Alloy Sand  
Castings for General Applications

- B687-1999 (R2011).....Standard Specification for Brass, Copper, and Chromium-Plated Pipe Nipples
- B828-2002 (R2010).....Standard Practice for Making Capillary Joints by Soldering of Copper and Copper Alloy Tube and Fittings
- B813-2010.....Standard Specification for Liquid and Paste Fluxes for Soldering of Copper and Copper Alloy Tube
- C564-2014.....Standard Specification for Rubber Gaskets for Cast Iron Soil Pipe and Fittings
- C1173-2010 (R2014).....Standard Specification for Flexible Transition Couplings for Underground Piping Systems
- D2000-2012.....Standard Classification System for Rubber Products in Automotive Applications
- D2321-2014e1.....Standard Practice for Underground Installation of Thermoplastic Pipe for Sewers and Other Gravity-Flow Applications
- F477-2014.....Standard Specification for Elastomeric Seals (Gaskets) for Joining Plastic Pipe
- F1545-2015.....Standard Specification for Plastic-Lined Ferrous Metal Pipe, Fittings, and Flanges
- E. American Welding Society (AWS):
- A5.8M/A5.8 AMD1-2011....Specification for Filler Metals for Brazing and Braze Welding
- F. Copper Development Association (CDA):
- A4015-2011.....Copper Tube Handbook
- G. Cast Iron Soil Pipe Institute (CISPI):
- 301-2012.....Standard Specification for Hubless Cast Iron Soil Pipe and Fittings for Sanitary and Storm Drain, Waste, and Vent Piping Applications
- 310-2012.....Standard Specification for Coupling for Use in Connection with Hubless Cast Iron Soil Pipe and Fittings for Sanitary and Storm Drain, Waste, and Vent Piping Applications
- H. International Code Council (ICC):
- IPC-2012.....International Plumbing Code
- I. Manufacturers Standardization Society of the Valve and Fittings Industry, Inc. (MSS):

SP-72-2010a.....Ball Valves with Flanged or Butt-Welding Ends  
for General Service

SP-110-2010.....Ball Valves Threaded, Socket-Welding, Solder  
Joint, Grooved and Flared Ends

#### **1.4 SUBMITTALS**

- A. Submittals, including number of required copies, shall be submitted in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Information and material submitted under this section shall be marked "SUBMITTED UNDER SECTION 22 14 00, FACILITY STORM DRAINAGE", with applicable paragraph identification.
- C. Manufacturer's Literature and Data including: Full item description and optional features and accessories. Include dimensions, weights, materials, applications, standard compliance, model numbers, size, and capacity.
  - 1. Pipe and Fittings.
  - 2. Specialty Pipe Fittings.
  - 3. Cleanouts.
  - 4. Roof Drains.
  - 5. Expansion Joints.
  - 6. Downspout Nozzles.
  - 7. Sleeve Flashing Devices.
- D. Detailed shop drawing of clamping device and extensions when required in connection with the waterproofing membrane.

#### **1.5 QUALITY ASSURANCE**

- A. Bio-Based Materials: For products designated by the USDA's Bio-Preferred Program, provide products that meet or exceed USDA recommendations for bio-based content, so long as products meet all performance requirements in this specifications section. For more information regarding the product categories covered by the Bio-Preferred Program, visit <http://www.biopreferred.gov>.

#### **1.6 AS-BUILT DOCUMENTATION**

- A. Submit manufacturer's literature and data updated to include submittal review comments and any equipment substitutions.
- B. Submit operation and maintenance data updated to include submittal review comments, substitutions and construction revisions shall be in electronic version on compact disc or DVD and inserted into a three ring binder. All aspects of system operation and maintenance



procedures, including piping isometrics, wiring diagrams of all circuits, a written description of system design, control logic, and sequence of operation shall be included in the operation and maintenance manual. The operations and maintenance manual shall include troubleshooting techniques and procedures for emergency situations. Notes on all special systems or devices such as damper and door closure interlocks shall be included. A List of recommended spare parts (manufacturer, model number, and quantity) shall be furnished. Information explaining any special knowledge or tools the owner will be required to employ shall be inserted into the As-Built documentation.

- C. The installing contractor shall maintain as-built drawings of each completed phase for verification; and, shall provide the complete set at the time of final systems certification testing. As-built drawings are to be provided, and a copy of them in Auto-CAD version 2014 provided on compact disk or DVD. Should the installing contractor engage the testing company to provide as-built or any portion thereof, it shall not be deemed a conflict of interest or breach of the 'third party testing company' requirement.
- D. Certification documentation shall be provided to COR 10 working days prior to submitting the request for final inspection. The documentation shall include all test results, the names of individuals performing work for the testing agency on this project, detailed procedures followed for all tests, and certification that all results of tests were within limits specified.

## **PART 2 - PRODUCTS**

### **2.1 STORM WATER DRAIN PIPING**

- A. Cast Iron Storm Pipe and Fittings:
  - 1. Cast iron storm pipe and fittings shall be used for the following applications:
    - a. Pipe buried in or in contact with earth.
    - b. Extension of pipe to a distance of approximately 1500 mm (5 feet) outside of building walls.
    - c. Interior storm piping above grade.
    - d. All mechanical equipment rooms or other areas containing mechanical air handling equipment.
  - 2. The cast iron storm pipe shall be bell and spigot, or hubless (plain end or no-hub) as required by selected jointing method.

3. The material for all pipe and fittings shall be cast iron soil pipe and fittings and shall conform to the requirements of CISPI 301, ASTM A888, or ASTM A74.
  4. Joints for hubless pipe and fittings shall conform to the manufacturer's installation instructions. Couplings for hubless joints shall conform to CISPI 310. Joints for hub and spigot pipe shall be installed with compression gaskets conforming to the requirements of ASTM C564.
- B. Copper Tube, (DWV): May be used for piping above ground for sump pump discharge.
1. The copper DWV tube shall be drainage type, drawn temper conforming to ASTM B306.
  2. The copper drainage fittings shall be cast copper or wrought copper conforming to ASME B16.23 or ASME 16.29.
  3. The joints shall be lead free, using a water flushable flux, and conforming to ASTM B32.
- C. Not Used.
- D. Roof drain piping and body of drain in locations where the outdoor conditions are subject to freezing shall be insulated.

## **2.2 PUMPED DRAIN PIPING NOT USED.**

## **2.3 SPECIALTY PIPE FITTINGS**

- A. Transition pipe couplings shall join piping with small differences in outside diameters or be of different materials. End connections shall be of the same size and compatible with the pipes being joined. The transition coupling shall be unshielded, elastomeric, sleeve type reducing or transition pattern conforming with ASTM C1173 and include shear ring and corrosion resistant metal tension band and tightening mechanism on each end. The transition coupling sleeve coupling shall be of the following material:
1. For cast iron soil pipes, the sleeve material shall be rubber conforming to ASTM C564.
  2. Not Used.
  3. dissimilar pipes, the sleeve material shall be PVC conforming to ASTM D5926, or other material compatible with the pipe materials being joined.
- B. Dielectric fittings shall conform to ASSE 1079 with a pressure rating of 1035 kPa (150 psig) at a minimum temperature of 82 degrees C (180

degrees F). The end connection shall be solder joint copper alloy and threaded ferrous.

- C. Dielectric flanges shall conform to ASSE 1079 with a pressure rating of 1035 kPa (150 psig). The flange shall be a factory fabricated, bolted, companion flange assembly. The end connection shall be threaded or solder-joint copper alloy and threaded ferrous.
- D. Dielectric flange insulating kits shall be of non-conducting materials for field assembly of companion flanges with a pressure rating of 1035 kPa (150 psig). The gasket shall be neoprene or phenolic. The bolt sleeves shall be phenolic or polyethylene. The washers shall be phenolic with steel backing washers.
- E. Dielectric nipples shall be electroplated steel and shall conform with ASTM F1545 with a pressure ratings of 2070 kPa (300 psig) at 107 degrees C (225 degrees F). The end connection shall be male threaded. The lining shall be inert and noncorrosive propylene. Bio-based materials shall be utilized when possible.

#### **2.4 CLEANOUTS**

- A. Cleanouts shall be the same size as the pipe, up to 100 mm (4 inches); not less than 100 mm (4 inches) for larger pipe. Cleanouts shall be easily accessible and shall be gastight and watertight. A minimum clearance of 600 mm (24 inches) shall be provided for clearing a clogged storm sewer line.
- B. Floor cleanouts shall be gray iron housing with clamping device and round, secured, scoriated, gray iron cover conforming to ASME A112.36.2M. A gray iron ferrule with hubless, socket, inside caulk or spigot connection and counter sunk, taper-thread, brass or bronze closure plug shall be included. The frame and cover material and finish shall be nickel-bronze copper alloy with a square shape. The cleanout shall be vertically adjustable for a minimum of 50 mm (2 inches). When a waterproof membrane is used in the floor system, clamping collars shall be provided on the cleanouts. Cleanouts shall consist of wye fittings and eighth bends with brass or bronze screw plugs. Cleanouts in the resilient tile floors, quarry tile and ceramic tile floors shall be provided with square top covers recessed for tile insertion. In the carpeted areas, carpet cleanout markers shall be provided. Two way cleanouts shall be provided where indicated on the drawings and at each building exit. The loading classification for cleanouts in sidewalk areas or subject to vehicular traffic shall be heavy duty.

- C. Cleanouts shall be provided at or near the base of the vertical stacks with the cleanout plug located approximately 600 mm (24 inches) above the floor. The cleanouts shall be extended to the wall access cover. Cleanout shall consist of sanitary tees. Nickel bronze square frame and stainless steel cover with minimum opening of 150 mm by 150 mm (6 inch by 6 inch) shall be provided at each wall cleanout.
- D. In horizontal runs above grade, cleanouts shall consist of cast brass tapered screw plug in fitting or caulked/no hub cast iron ferrule. Plain end (no-hub) piping in interstitial space or above ceiling may use plain end (no-hub) blind plug and clamp.

## **2.5 ROOF DRAINS AND CONNECTIONS**

- A. Roof Drains: Roof Drains (RD) shall be cast iron with clamping device for making watertight connection and shall conform with ASME A112.6.4. Free openings through strainer shall be twice area of drain outlet. For roof drains not installed in connection with a waterproof membrane, a soft copper membrane shall be provided 300 mm (12 inches) in diameter greater than outside diameter of drain collar. An integral gravel stop shall be provided for drains installed on roofs having built up roofing covered with gravel or slag. Integral no-hub, soil pipe gasket or threaded outlet connection shall be provided.
  - 1. Flat Roofs: The roof drain shall have a beehive or dome shaped strainer with integral flange not less than 300 mm (12 inches) in diameter. For an insulated roof, a roof drain with an adjustable drainage collar shall be provided, which can be raised or lowered to meet required insulation heights, sump receiver and deck clamp. The bottom section shall serve as roof drain during construction before insulation is installed.
  - 2. Not Used.
  - 3. Not Used.
  - 4. Not Used.
  - 5. Protective Roof Membrane Insulation Assembly: The roof drain shall have a perforated stainless steel extension filter, non-puncturing clamp ring, large sump with extra wide roof flange and deck clamp.
    - a. Non pedestrian Roofs: The roof drain shall have large polypropylene or aluminum locking dome.
    - b. Pedestrian Roof: The roof drain shall have a bronze promenade top 356 mm (14 inches) square, set in square secured frame support collar.

6. Roof Drains, Overflow or Secondary (Emergency): Roof Drains identified as overflow or secondary (emergency) drains shall have a 50 mm (2 inch) water dam integral to the drain body.
7. Roof drains in areas subject to freezing shall have heat tape and shall be insulated.
- B. Expansion Joints: Expansions joints shall be heavy cast iron with cast brass or PVC expansion sleeve having smooth bearing surface working freely against a packing ring held in place and under pressure of a bolted gland ring, forming a water and air tight flexible joint. Asbestos packing is prohibited.
- C. Interior Downspouts: An expansion joint shall be provided, specified above, at top of run on straight, vertical runs of downspout piping 12 m (40 feet) long or greater.
- D. Downspout Nozzle: The downspout nozzle fitting shall be of brass, unfinished, with internal pipe thread for connection to downspout.

## **2.6 WATERPROOFING**

- A. A sleeve flashing device shall be provided at points where pipes pass through membrane waterproofed floors or walls. The sleeve flashing device shall be manufactured, cast iron fitting with clamping device that forms a sleeve for the pipe floor penetration of the floor membrane. A galvanized steel pipe extension shall be included in the top of the fitting that will extend 50 mm (2 inches) above finished floor and galvanized steel pipe extension in the bottom of the fitting that will extend through the floor slab. A waterproofed caulked joint shall be provided at the top hub.

## **PART 3 - EXECUTION**

### **3.1 PIPE INSTALLATION**

- A. The pipe installation shall comply with the requirements of the IPC and these specifications.
- B. Branch piping shall be installed from the piping system and connect to all drains and outlets.
- C. Pipe shall be round and straight. Cutting shall be done with proper tools. Pipe, except for glass, shall be reamed to remove burrs and a clean smooth finish restored to full pipe inside diameter.
- D. All pipe runs shall be laid out to avoid interference with other work/trades.
- E. The piping shall be installed above accessible ceilings to allow for ceiling panel removal.

- F. Unless otherwise stated on the documents, minimum horizontal slope shall be one inch for every 2.44 m (8 feet) (1 percent slope) of pipe length.
- G. The piping shall be installed free of sags and bends.
- H. Not Used.
- I. Changes in direction for storm drainage piping shall be made using appropriate branches, bends and long sweep bends. Sanitary tees and short sweep  $\frac{1}{4}$  bends may be used on vertical stacks if change in direction of flow is from horizontal to vertical. Long turn double wye branch and  $\frac{1}{8}$  bend fittings shall be used if two drains are installed back to back or side by side with common drain pipe. Do not change direction of flow more than 90 degrees. Proper size of standard increaser and reducers shall be used if pipes of different sizes are connected. Reducing size of drainage piping in direction of flow is prohibited.
- J. Buried storm drainage piping shall be laid beginning at the low point of each system. Piping shall be installed true to grades and alignment indicated with unbroken continuity of invert. Hub ends shall be placed upstream. Required gaskets shall be installed according to manufacturer's written instruction for use of lubricants, cements, and other installation requirements. Bio-based materials shall be utilized when possible.
- K. Cast iron piping shall be installed according to CISPI's "Cast Iron Soil Pipe and Fittings Handbook," Chapter IV, "Installation of Cast Iron Soil Pipe and Fittings"
- L. Aboveground copper tubing shall be installed according to CDA A4015.

### **3.2 JOINT CONSTRUCTION**

- A. Hub and spigot, cast iron piping with gasket joints shall be joined in accordance with CISPI's "Cast Iron Soil Pipe and Fittings Handbook" for compression joints.
- B. Hub and spigot, cast iron piping with calked joints shall be joined in accordance with CISPI's "Cast Iron Soil Pipe and Fittings Handbook" for lead and oakum calked joints.
- C. Hubless, cast iron piping shall be joined in accordance with CISPI's "Cast Iron Soil Pipe and Fittings Handbook" for hubless piping coupling joints.
- D. For threaded joints, thread pipe with tapered pipe threads according to ASME B1.20.1. The threads shall be cut full and clean using sharp disc

cutters. Threaded pipe ends shall be reamed to remove burrs and restored to full pipe inside diameter. Pipe fittings and valves shall be joined as follows:

1. Apply appropriate tape or thread compound to external pipe threads unless dry seal threading is required by the pipe service
2. Pipe sections with damaged threads shall be replaced with new undamaged sections of pipe at no additional time or cost to Government.

E. Copper tube and fittings with soldered joints shall be joined according to ASTM B828. A water flushable, lead free flux conforming to ASTM B813 and a lead free alloy solder conforming to ASTM B32 shall be used.

### **3.3 SPECIALTY PIPE FITTINGS**

- A. Transition coupling shall be installed at pipe joints with small differences in pipe outside diameters.
- B. Dielectric fittings shall be installed at connections of dissimilar metal piping and tubing.

### **3.4 PIPE HANGERS, SUPPORTS AND ACCESSORIES**

- A. All piping shall be supported according to the IPC, Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING, and these specifications.
- B. Hangers, supports, rods, inserts and accessories used for Pipe supports shall be shop coated with zinc Chromate primer paint. Electroplated copper hanger rods, hangers and accessories may be used with copper tubing.
- C. Horizontal piping and tubing shall be supported within 300 mm (12 inches) of each fitting or coupling.
- D. Horizontal cast iron piping shall be supported with the following maximum horizontal spacing and minimum hanger rod diameters:
  1. NPS 1-1/2 to NPS 2 (DN 40 to DN 50): 1500 mm (60 inches) with 10 mm (3/8 inch) rod.
  2. NPS 3 (DN 80): 1500 mm (60 inches) with 15 mm (1/2 inch) rod.
  3. NPS 4 to NPS 5 (DN 100 to DN 125): 1500 mm (60 inches) with 18 mm (5/8 inch) rod.
  4. NPS 6 to NPS 8 (DN 150 to DN 200): 1500 mm (60 inches) with 20 mm (3/4 inch) rod.
  5. NPS 10 to NPS 12 (DN 250 to DN 300): 1500 mm (60 inches) with 23 mm (7/8 inch) rod.
- E. The maximum support spacing for horizontal plastic shall be 1.22 m (4 feet).

- F. Vertical piping and tubing shall be supported at the base, at each floor, and at intervals no greater than 4.6 m (15 feet).
- G. In addition to the requirements in Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING, floor, wall and ceiling plates shall have the following characteristics:
  - 1. Solid or split unplated cast iron.
  - 2. All plates shall be provided with set screws.
  - 3. Height adjustable clevis type pipe hangers.
  - 4. Adjustable Floor Rests and Base Flanges shall be steel.
  - 5. Hanger Rods shall be low carbon steel, fully threaded or threaded at each end with two removable nuts at each end for positioning rod and hanger and locking each in place.
  - 6. Riser Clamps shall be malleable iron or steel.
  - 7. Roller shall be cast iron.
  - 8. Hangers and supports utilized with insulated pipe and tubing shall have 180 degree (minimum) metal protection shield centered on and welded to the hanger and support. The shield shall be 100 mm (4 inches) in length and be 1.6 mm (16 gage) steel. The shield shall be sized for the insulation.
- H. Miscellaneous materials shall be provided as specified, required, directed or as noted on the drawings for proper installation of hangers, supports and accessories. If the vertical distance exceeds 6.1 m (20 feet) for cast iron pipe additional support shall be provided in the center of that span. All necessary auxiliary steel shall be provided to provide that support.
- I. Cast escutcheon with set screw shall be installed at each wall, floor and ceiling penetration in exposed finished locations and within cabinets and millwork.
- J. Penetrations:
  - 1. Fire Stopping: Where pipes pass through fire partitions, fire walls, smoke partitions, or floors, a fire stop shall be installed that provides an effective barrier against the spread of fire, smoke and gases as specified in Section 07 84 00, FIRESTOPPING. Clearances between raceways and openings shall be completely filled and sealed with the fire stopping materials.
  - 2. Water proofing: At floor penetrations, Clearances around the pipe shall be completely sealed and made watertight with sealant as



specified in Section 07 92 00, JOINT SEALANTS. Bio-based materials shall be utilized when possible.

### 3.5 INSULATION

- A. Insulate horizontal sections and 600 mm (2 feet) past changes of direction to vertical sections for interior section of roof drains. Install insulation in accordance with the requirements of Section 22 07 11, PLUMBING INSULATION.

### 3.6 TESTS

- A. Storm sewer system shall be tested either in its entirety or in sections.
- B. Storm Water Drain tests shall be conducted before trenches are backfilled or fixtures are connected. A water test or air test shall be conducted, as directed.
  - 1. If entire system is tested with water, tightly close all openings in pipes except the highest opening, and fill system with water to point of overflow. If system is tested in sections, tightly plug each opening except highest opening of section under test, fill each section with water and test with at least a 3 m (10 foot) head of water. In testing successive sections, test at least upper 3 m (10 feet) of next preceding section so that each joint or pipe except upper most 3 m (10 feet) of system has been submitted to a test of at least a 3 m (10 foot) head of water. Water shall be kept in the system, or in portion under test, for at least 15 minutes before inspection starts. System shall then be tight at all joints.
  - 2. For an air test, an air pressure of 34 kPa (5 psig) gage shall be maintained for at least 15 minutes without leakage. A force pump and mercury column gage shall be used for the test.
  - 3. Final Tests: While either one of the following tests may be used, Contractor shall check with VA as to which test will be performed.
    - a. Smoke Test: After fixtures are permanently connected and traps are filled with water, fill entire drainage and vent systems with smoke under pressure of 0.25 kPa (1 inch of water) with a smoke machine. Chemical smoke is prohibited.
    - b. Peppermint Test: Introduce .06 liters (2 ounces) of peppermint into each line or stack.
- C. COR shall witness all tests. Contractor shall coordinate schedules with the COR and CxA. Contractor shall provide a minimum of 10 working days prior to flushing, disinfection/sterilization, startup, and testing.

**3.7 COMMISSIONING NOT USED.**

**3.8 DEMONSTRATION AND TRAINING**

- A. Provide services of manufacturer's technical representative for fourhours to instruct VA Personnel in operation and maintenance of the system.

- - - E N D - - -

**SECTION 22 40 00  
PLUMBING FIXTURES**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. Plumbing fixtures, associated trim and fittings necessary to make a complete installation from wall or floor connections to rough piping, and certain accessories.
- B. A complete listing of all acronyms and abbreviations are included in Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.

**1.2 RELATED WORK**

- A. Section 01 00 00, GENERAL REQUIREMENTS.
- B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- C. Section 01 81 13, SUSTAINABLE CONSTRUCTION REQUIREMENTS.
- D. Not Used.
- E. Section 07 92 00, JOINT SEALANTS: Sealing between fixtures and other finish surfaces.
- F. Section 08 31 13, ACCESS DOORS AND FRAMES: Flush panel access doors.
- G. Not Used.
- H. Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.
- I. Not Used.
- J. 22 13 00, FACILITY SANITARY AND VENT PIPING.

**1.3 APPLICABLE PUBLICATIONS**

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. The American Society of Mechanical Engineers (ASME):
  - A112.6.1M-1997 (R2012)..Supports for Off-the-Floor Plumbing Fixtures  
for Public Use
  - A112.19.1-2013.....Enameled Cast Iron and Enameled Steel Plumbing  
Fixtures
  - A112.19.2-2013.....Ceramic Plumbing Fixtures
  - A112.19.3-2008.....Stainless Steel Plumbing Fixtures
- C. American Society for Testing and Materials (ASTM):
  - A276-2013a.....Standard Specification for Stainless Steel Bars  
and Shapes
  - B584-2008.....Standard Specification for Copper Alloy Sand  
Castings for General Applications
- D. CSA Group:
  - B45.4-2008 (R2013).....Stainless Steel Plumbing Fixtures

- E. National Association of Architectural Metal Manufacturers (NAAMM):  
AMP 500-2006.....Metal Finishes Manual
- F. American Society of Sanitary Engineering (ASSE):  
1016-2011.....Automatic Compensating Valves for Individual  
Showers and Tub/Shower Combinations
- G. NSF International (NSF):  
14-2013.....Plastics Piping System Components and Related  
Materials  
61-2013.....Drinking Water System Components - Health  
Effects  
372-2011.....Drinking Water System Components - Lead Content
- H. American with Disabilities Act (A.D.A)
- I. International Code Council (ICC):  
IPC-2015.....International Plumbing Code

#### **1.4 SUBMITTALS**

- A. Submittals, including number of required copies, shall be submitted in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Information and material submitted under this section shall be marked "SUBMITTED UNDER SECTION 22 40 00, PLUMBING FIXTURES", with applicable paragraph identification.
- C. Manufacturer's Literature and Data including: Full item description and optional features and accessories. Include dimensions, weights, materials, applications, standard compliance, model numbers, size, connections, and capacity.
- D. Operating Instructions: Comply with requirements in Section 01 00 00, GENERAL REQUIREMENTS.

#### **1.5 QUALITY ASSURANCE**

- A. Bio-Based Materials: For products designated by the USDA's Bio-Preferred Program, provide products that meet or exceed USDA recommendations for bio-based content, so long as products meet all performance requirements in this specifications section. For more information regarding the product categories covered by the Bio-Preferred Program, visit <http://www.biopreferred.gov>.

#### **1.6 AS-BUILT DOCUMENTATION**

- A. Submit manufacturer's literature and data updated to include submittal review comments and any equipment substitutions.

- B. Submit operation and maintenance data updated to include submittal review comments, substitutions and construction revisions shall be in electronic version on compact disc or DVD and inserted into a three ring binder. All aspects of system operation and maintenance procedures, including piping isometrics, wiring diagrams of all circuits, a written description of system design, control logic, and sequence of operation shall be included in the operation and maintenance manual. The operations and maintenance manual shall include troubleshooting techniques and procedures for emergency situations. Notes on all special systems or devices such as damper and door closure interlocks shall be included. A List of recommended spare parts (manufacturer, model number, and quantity) shall be furnished. Information explaining any special knowledge or tools the owner will be required to employ shall be inserted into the As-Built documentation.
- C. The installing contractor shall maintain as-built drawings of each completed phase for verification; and, shall provide the complete set at the time of final systems certification testing. As-built drawings are to be provided, and a copy of them in AutoCAD version 2014 provided on compact disc or DVD. Should the installing contractor engage the testing company to provide as-built or any portion thereof, it shall not be deemed a conflict of interest or breach of the 'third party testing company' requirement.
- D. Certification documentation shall be provided to COR 10 working days prior to submitting the request for final inspection. The documentation shall include all test results, the names of individuals performing work for the testing agency on this project, detailed procedures followed for all tests, and certification that all results of tests were within limits specified.

## **PART 2 - PRODUCTS**

### **2.1 MATERIALS**

- A. Material or equipment containing a weighted average of greater than 0.25 percent lead is prohibited in any potable water system intended for human consumption, and shall be certified in accordance with NSF 61 or NSF 372. Endpoint devices used to dispense water for drinking shall meet the requirements of NSF 61.

## 2.2 STAINLESS STEEL

- A. Corrosion-resistant Steel (CRS):
  - 1. Plate, Sheet and Strip: CRS flat products shall conform to chemical composition requirements of any 300 series steel specified in ASTM A276.
  - 2. Finish: Exposed surfaces shall have standard polish (ground and polished) equal to NAAMM finish Number 4.
- B. Die-cast zinc alloy products are prohibited.

## 2.3 STOPS

- A. Provide lock-shield loose key or screw driver pattern angle stops, straight stops or stops integral with faucet, with each compression type faucet whether specifically called for or not, including sinks in solid-surface, wood and metal casework, laboratory furniture and pharmacy furniture. Locate stops centrally above or below fixture in accessible location.
- B. Furnish keys for lock shield stops to the COR.
- C. Supply from stops not integral with faucet shall be chrome plated copper flexible tubing or flexible stainless steel with inner core of non-toxic polymer.
- D. Supply pipe from wall to valve stop shall be rigid threaded IPS copper alloy pipe, i.e. red brass pipe nipple, chrome plated where exposed.
- E. Mental Health Area: Provide stainless steel drain guard for all lavatories not installed in casework.

## 2.4 ESCUTCHEONS

- A. Heavy type, chrome plated, with set screws. Provide for piping serving plumbing fixtures and at each wall, ceiling and floor penetrations in exposed finished locations and within cabinets and millwork.

## 2.5 LAMINAR FLOW CONTROL DEVICE

- A. Smooth, bright stainless steel or satin finish, chrome plated metal laminar flow device shall provide non-aeration, clear, coherent laminar flow that will not splash in basin. Device shall also have a flow control restrictor and have vandal resistant housing. **Aerators are prohibited.**
- B. Flow Control Restrictor:
  - 1. Capable of restricting flow from 32 ml/s to 95 ml/s (0.5 gpm to 1.5 gpm) for lavatories; 125 ml/s to 140 ml/s (2.0 gpm to 2.2 gpm) for sinks P-505 through P-520, P-524 and P-528; and 174 ml/s to 190 ml/s

- (2.75 gpm to 3.0 gpm) for dietary food preparation and rinse sinks or as specified.
2. Compensates for pressure fluctuation maintaining flow rate specified above within 10 percent between 170 kPa and 550 kPa (25 psig and 80 psig).
  3. Operates by expansion and contraction, eliminates mineral/sediment build-up with self-cleaning action, and is capable of easy manual cleaning.

## **2.6 CARRIERS**

- A. ASME A112.6.1M, with adjustable gasket faceplate chair carriers for wall hung closets with auxiliary anchor foot assembly, hanger rod support feet, and rear anchor tie down.
- B. ASME A112.6.1M, lavatory, chair carrier for thin wall construction concealed arm support. All lavatory chair carriers shall be capable of supporting the lavatory with a 250-pound vertical load applied at the front of the fixture.
- C. Where water closets, lavatories or sinks are installed back-to-back and carriers are specified, provide one carrier to serve both fixtures in lieu of individual carriers. The drainage fitting of the back to back carrier shall be so constructed that it prevents the discharge from one fixture from flowing into the opposite fixture.

## **2.7 PLUMBING FIXTURES**

- A. Refer to the plumbing drawings for the plumbing fixture schedule.

# **PART 3 - EXECUTION**

## **3.1 INSTALLATION**

- A. Fixture Setting: Opening between fixture and floor and wall finish shall be sealed as specified under Section 07 92 00, JOINT SEALANTS. Bio-based materials shall be utilized when possible.
- B. Supports and Fastening: Secure all fixtures, equipment and trimmings to partitions, walls and related finish surfaces. Exposed heads of bolts and nuts in finished rooms shall be hexagonal, polished chrome plated brass with rounded tops.
- C. Through Bolts: For free standing marble and metal stud partitions refer to Section 10 21 13, TOILET COMPARTMENTS.
- D. Toggle Bolts: For hollow masonry units, finished or unfinished.
- E. Expansion Bolts: For brick or concrete or other solid masonry. Shall be 6 mm (1/4 inch) diameter bolts, and to extend at least 76 mm (3 inches) into masonry and be fitted with loose tubing or sleeves extending into

masonry. Wood plugs, fiber plugs, lead or other soft metal shields are prohibited.

- F. Power Set Fasteners: May be used for concrete walls, shall be 6 mm (1/4 inch) threaded studs, and shall extend at least 32 mm (1 1/4 inches) into wall.
- G. Tightly cover and protect fixtures and equipment against dirt, water and chemical or mechanical injury.
- H. Where water closet waste pipe has to be offset due to beam interference, provide correct and additional piping necessary to eliminate relocation of water closet.
- I. Aerators are prohibited on lavatories and sinks.
- J. If an installation is unsatisfactory to the COR, the Contractor shall correct the installation at no cost or additional time to the Government.

### **3.2 CLEANING**

- A. At completion of all work, fixtures, exposed materials and equipment shall be thoroughly cleaned.

### **3.3 WATERLESS URINAL NOT USED.**

### **3.4 COMMISSIONING NOT USED.**

### **3.5 DEMONSTRATION AND TRAINING**

- A. Provide services of manufacturer's technical representative for fourhours to instruct VA Personnel in operation and maintenance of the system.

- - - E N D - - -



**SECTION 22 62 00**  
**VACUUM SYSTEMS FOR LABORATORY AND HEALTHCARE FACILITIES**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. Central Laboratory and Healthcare Vacuum Systems: This section describes the labor, equipment, and services necessary for and incidental to the installation of piped medical vacuum systems and medical vacuum and waste anesthesia gas disposal systems (WAGD). Medical vacuum and WAGD systems shall be installed started, tested, and ready for use. The scope of work shall include all necessary piping, fittings, valves, cabinets, station outlets and inlets, rough ins, ceiling services, gages, alarms including low voltage wiring, vacuum pumps, electric motors and starters, receivers, and all necessary parts, accessories, connections and equipment for a complete and operational system. Match existing station inlet terminal connections.
- B. The contractor shall provide all elements and accessories required for a complete system according to the most recent edition of NFPA 99, Gas and Vacuum Systems.
- C. All necessary connections to owner furnished equipment shall be made as indicated on the contract documents. A separate construction isolation valve shall be made at the point of connection to an existing vacuum system.
- D. Electrical power and control wiring for vacuum pump(s), WAGD Producer(s), ceiling columns, alarms wiring from equipment to alarm panels, and modular accessories associated with the system(s) shall be included.
- E. Pressure testing, cross connection testing and final testing per NFPA 99 shall be performed.
- F. The contractor shall retain a qualified third party medical vacuum verifier acceptable to the engineer of record and VA to perform and attest to final verification of the systems. The contractor shall make all corrections as determined by this third party verifier, including additional testing if necessary to attain full and unqualified certification at no additional time or cost to the Government.
- G. Not Used.
- H. A complete listing of all acronyms and abbreviations are included in Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.

**1.2 RELATED WORK**

- A. Section 01 00 00, GENERAL REQUIREMENTS.
- B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- C. Section 01 81 13, SUSTAINABLE CONSTRUCTION REQUIREMENTS.
- D. Not Used.
- E. Section 07 84 00, FIRESTOPPING: Sealing around pipe penetrations to maintain the integrity of time rated construction.
- F. Section 07 92 00, JOINT SEALANTS: Sealing around pipe penetrations through the floor to prevent moisture migration.
- G. Not Used.
- H. Not Used.
- I. Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING: General requirements and items common to more than one section of Division 22.
- J. Section 22 05 12, GENERAL MOTOR REQUIREMENTS FOR PLUMBING EQUIPMENT: Electric motors.
- K. Not Used.
- L. Section 22 63 00, GAS SYSTEMS FOR LABORATORY AND HEALTHCARE FACILITIES: Laboratory and healthcare gases and vacuum alarms.
- M. SECTION 22 63 00, GAS SYSTEMS FOR LABORATORY AND HEALTHCARE FACILITIES: Laboratory and healthcare gas piping and equipment.
- N. Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC: Alarm interface with BAS.
- O. Section 26 05 19, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES: Control wiring.
- P. Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS: Conduit.
- Q. Section 26 27 26, WIRING DEVICES: Electrical wiring and accessories.
- R. Section 26 29 11, MOTOR CONTROLLERS: Motor starters.

**1.3 APPLICABLE PUBLICATIONS**

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the test by the basic designation only.
- B. American Society of Mechanical Engineers (ASME):
  - A13.1-2007 (R2013).....Scheme for the Identification of Piping Systems
  - B16.15-2013.....Cast Copper Alloy Threaded Fittings: Classes 125 and 250
  - B16.22-2013.....Wrought Copper and Copper Alloy Solder-Joint Pressure Fittings

- B16.50-2013.....Wrought Copper and Copper Alloy Braze-Joint  
Pressure Fittings
- B40.100-2013..... Pressure Gauges and Gauge Attachments  
ASME Boiler and Pressure Code -
- BPVC Section IX-2015....Welding, Brazing, and Fusing Qualifications
- C. American Society of Sanitary Engineers (ASSE):
- 6000 Series-2012.....Professional Qualifications Standard for  
Medical Gas Systems Personnel
- D. American Society for Testing and Materials (ASTM):
- B43-2014.....Standard Specification for Seamless Red Brass  
Pipe, Standard Sizes
- B687-1999 (2011).....Standard Specification for Brass, Copper, and  
Chromium-Plated Pipe Nipples
- B819-2000 (R2011).....Standard Specification for Seamless Copper Tube  
for Medical Gas Systems
- E. American Welding Society (AWS):
- A5.8M/A5.8-2011-AMD1....Specification for Filler Metals for Brazing and  
Braze Welding
- B2.2/B2.2M-2010.....Specification for Brazing Procedure and  
Performance Qualification
- F. Compressed Gas Association (CGA):
- P-9-2008.....The Inert Gases: Argon, Nitrogen, and Helium
- G. Manufacturing Standardization Society (MSS):
- SP-72-2010a.....Ball Valves with Flanged or Butt-Welding Ends  
For General Service
- SP-110-2010.....Ball Valves Threaded, Socket-Welding, Solder  
Joint, Grooved and Flared Ends
- H. National Electrical Manufacturers Association (NEMA):
- ICS 6-1993 (R2001, R2006) Industrial Control and Systems Enclosures
- I. National Fire Protection Association (NFPA):
- 70-2014.....National Electrical Code
- 99-2015.....Health Care Facilities Code

#### **1.4 SUBMITTALS**

- A. Submittals, including number of required copies, shall be submitted in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.

- B. Information and material submitted under this section shall be marked "SUBMITTED UNDER SECTION 22 62 00, VACUUM SYSTEMS FOR LABORATORY AND HEALTHCARE FACILITIES", with applicable paragraph identification.
- C. Manufacturer's Literature and Data including: Full item description and optional features and accessories. Include dimensions, weights, materials, applications, standard compliance, model numbers, size, and capacity.
  - 1. Complete specifications for the product intended to be installed, dimensional drawings, and wiring schematics.
  - 2. Package drawing indicating package style, dimensions when complete, method of disassembly and sizes of subsections for rigging and installation.
  - 3. Piping.
  - 4. Valves.
  - 5. Inlet and outlet cocks
  - 7. Gages.
  - 8. Station inlets, and rough in assemblies.
  - 9. Not Used.
  - 10. Not Used.
  - 11. Not Used.
  - 12. Vacuum bottle brackets.
- D. Station Inlets: A letter from manufacturer shall be submitted stating that inlets are designed and manufactured to comply with NFPA 99. Inlet shall bear label of approval as an assembly, of Underwriters Laboratories, Inc., or Associated Factory Mutual Research Corporation.
- E. Certification: The completed systems have been installed, tested, purged and analyzed in accordance with the requirements of this specification. Certification shall be submitted to COR.
- F. A notarized affidavit from the verifier stating that the verifier undertakes to verify this project and thus agrees to disqualify themselves from supplying any equipment which shall be included in the scope of their verification. No verifier who supplies equipment shall be permitted to verify that equipment. Statement declaring that the vacuum system manufacturer has no fiduciary interest in the verifier and that the verifier is not an agent or representative of the vacuum system manufacturer. Statement declaring that the contractor has no

fiduciary interest in the third party verifier and that the third party verifier has no fiduciary interest in the contractor.

#### **1.5 QUALITY ASSURANCE**

- A. Contractor shall include with submittals an affidavit attesting to compliance with all relevant paragraphs of NFPA 99 most recent edition. Personnel assembling medical vacuum and WAGD system shall meet NFPA 99 5.1.10.11.10 "Qualification of Installers" and hold medical gas endorsements as under ASSE Standard Series 6000. The Contractor shall, on company letterhead, furnish documentation attesting that all installed piping materials were purchased cleaned and complied with the requirements of NFPA 99 5.1.10.1 and 5.1.10.2. Electrical Control systems and Medical vacuum Alarms are to be UL listed as assemblies with label affixed. Medical vacuum and WAGD controls are to be wired in accordance with NEC.
- B. Equipment Installer: The equipment installer shall provide documentation proving that the personnel installing the equipment meet the standards set by ASSE Standard Series 6000. Show technical qualifications and previous experience in installing medical gas equipment on three similar projects. Submit names, phone numbers, and addresses of referenced projects. The equipment installer shall perform the following coordination functions:
  - 1. Coordinate with other trades to ensure timely installations and avoid conflicts and interferences.
  - 2. Coordinate and field verify with the metal stud partition installer and/or mason to ensure anchors, sleeves and similar items are provided in sufficient time to avoid delays; chases and openings are properly sized and prepared.
  - 3. Coordinate with VA to ensure medical vacuum inlets, whether owner supplied or contractor supplied, in walls, ceiling and all equipment is provided by the same Medical Vacuum Equipment Manufacturer satisfactory to the owner.
  - 4. The contractor shall coordinate with the Medical Vacuum System Verifier to deliver a complete, operational, and tested medical gas installation ready for owner's use.
- C. Equipment Supplier: The Equipment supplier shall demonstrate evidence of installing equivalent product at three installations similar to this project that has been in satisfactory and efficient operation for three

years. Names, phone numbers, and addresses where the product is installed shall be submitted for verification.

- D. Medical Gas System Testing Organization: The Medical vacuum verifier shall show documentation proving that the medical gas verifier meets the standards set by ASSE Standard Series 6000. The testing shall be conducted by a party technically competent and experienced in the field of medical gas pipeline testing. Such testing shall be performed by a third party testing company independent of the installing and general contractor.
- E. Names of three projects where testing of vacuum systems has been performed by the testing agency shall be provided. The name of the project, names of such persons at that project who supervised the work for the project owner, or who accepted the report for the project owner, and a written statement that the projects listed required work of similar scope to that set forth in this specification shall be included in the documentation.
- F. The testing agency's detailed procedure shall be followed in the testing of this project and submitted to COR 10 working days prior to testing. In the testing agency's procedure documentation, include details of the testing sequence, procedures for cross connection tests, outlet function tests, alarm tests, purity tests, etc., as required by this specification. For purity test procedures, data on test methods, types of equipment to be used, calibration sources and method references shall be submitted.
- G. Installation and Startup: The manufacturer shall provide factory authorized representatives to review the installation and perform the initial startup of the system. The factory authorized representatives shall submit a report to the COR and to the Contractor. The Contractor shall make all corrections identified by the factory authorized representative at no additional cost or time to the Government.
- H. Certification: The Final inspection documentation shall include all test results, the names of individuals performing work for the testing agency on this project, detailed procedures followed for all tests, and certification that all results of tests were within limits allowed by this specification.
- I. Bio-Based Materials: For products designated by the USDA's Bio-Preferred Program, provide products that meet or exceed USDA

recommendations for bio-based content, so long as products meet all performance requirements in this specifications section. For more information regarding the product categories covered by the Bio-Preferred Program, visit <http://www.biopREFERRED.gov>.

#### **1.6 MAINTENANCE SUPPORT NOT USED.**

#### **1.7 AS-BUILT DOCUMENTATION**

- A. Submit manufacturer's literature and data updated to include submittal review comments and any equipment substitutions.
- B. Submit operation and maintenance data updated to include submittal review comments, substitutions and construction revisions shall be // in electronic version on compact disc or DVD and inserted into a three ring binder. All aspects of system operation and maintenance procedures, including piping isometrics, wiring diagrams of all circuits, a written description of system design, control logic, and sequence of operation shall be included in the operation and maintenance manual. The operations and maintenance manual shall include troubleshooting techniques and procedures for emergency situations. Notes on all special systems or devices such as damper and door closure interlocks shall be included. A List of recommended spare parts (manufacturer, model number, and quantity) shall be furnished. Information explaining any special knowledge or tools the owner shall be required to employ shall be inserted into the As-Built documentation.
- C. The installing contractor shall maintain as-built drawings of each completed phase for verification; and, shall provide the complete set at the time of final systems certification testing. As-built drawings are to be provided, and a copy of them in Auto-CAD version 2014 provided on compact disk or DVD. Should the installing contractor engage the testing company to provide as-built or any portion thereof, it shall not be deemed a conflict of interest or breach of the 'third party testing company' requirement.
- D. Certification documentation shall be provided to COR 10 working days prior to submitting the request for final inspection. The documentation shall include all test results, the names of individuals performing work for the testing agency on this project, detailed procedures followed for all tests, and certification that all results of tests were within limits specified.

## **PART 2 - PRODUCTS**

### **2.1 GENERAL PRODUCT REQUIREMENTS**

- A. A single Medical Vacuum Equipment Manufacturer shall supply the medical vacuum system(s) and equipment to include outlets, valves and gauges, valve boxes, alarm panels, manifolds, medical air, instrument air, vacuum and WAGD sources.

### **2.2 PIPING**

- A. Copper Tubing: Copper tubing shall be type "K" or "L", ASTM B819, seamless copper tube, hard drawn temper, with wrought copper fittings conforming to ASME B16.22 or brazing fittings complying with ASME B16.50. The copper tubing size designated reflects nominal inside diameter. All tubing and fittings shall be labeled "ACR/OXY", "OXY", "OXY/MED", "ACR/MED", or "MED".
- B. Brazing Alloy: The brazing alloy shall comply with AWS A5.8M/A5.8, Classification BCuP, greater than 538 degrees C (1000 degrees F) melting temperature. Flux shall be strictly prohibited for copper to copper connections.
- C. Screw Joints: Screw joints shall use polytetrafluoroethylene (Teflon) tape.
- D. Use only copper or stainless steel pipes for discharge from vacuum product (exhaust pipes).
- E. Memory metal couplings shall have temperature and pressure ratings not less than that of a brazed joint.
- F. Piping identification labels shall be applied at time of installation in accordance with NFPA 99. Supplementary color identification shall be in accordance with CGA Pamphlet C-9.

### **2.3 EXPOSED LABORATORY AND HEALTHCARE VACUUM PIPING**

- A. Finished Room: Use iron pipe size (IPS) chrome plated brass or stainless steel piping for exposed laboratory and healthcare vacuum piping connecting fixtures, casework, cabinets, equipment and reagent racks when not concealed by apron including those furnished by the Government or specified in other sections.
  - 1. Pipe: ASTM B43, standard weight.
  - 2. Fittings: Fittings shall comply with ASME B16.15 cast bronze threaded fittings with chrome finish (125 and 250 psig Classes).
  - 3. Nipples: Nipples shall comply with ASTM B687, chromium-plated.



4. Unions: Unions shall comply with MSS SP-72, MSS SP-110, brass or bronze with chrome finish. Unions 65 mm (2-1/2 inches) and greater shall be flange type with approved gaskets.
5. Valves: Valves shall comply with MSS SP-72, MSS SP-110, brass or bronze with chrome finish.

#### **2.4 VALVES**

- A. Ball: Ball valves shall be in line, other than zone valves in cabinets.
  1. 65 mm or DN65 (2-1/2 inches) and less: Ball valves shall be bronze/ brass body, MSS SP-72 and MSS SP-110, Type II, Class 150, Style 1, with tubing extensions for brazed connections, full ported, three piece or double union end connections, Teflon seat seals, full flow, 4138 kPa (600 psig) WOG minimum working pressure, with locking type handle.
  2. 75 mm or DN75 to 100 mm or DN100 (3 to 4 inches): Ball valves shall be bronze/ brass body, MSS SP-72 and MSS SP-110, Type II, Class 150, Style 1 with tubing extensions brazed to flanges, full ported, three piece, double seal, Teflon seals, full flow, 4138 kPa (600 psig) WOG minimum working pressure, with locking type handle.

#### **2.5 VALVE CABINETS NOT USED.**

#### **2.6 GAGES**

- A. Vacuum Gages:
  1. For vacuum line adjacent to source equipment the vacuum gages shall comply with ASME B40.100, vacuum gage type, size 115 mm (4-1/2 inches), gage listed for vacuum, accurate to within 2-1/2 percent, with metal case. The vacuum gage range shall be 0 to 100 kPa (0 to 29.5 inches Hg). Dial graduations and figures shall be black on a white background, or white on a black background. Label shall be for vacuum service. A gage cock shall be installed. Dual scale gages shall be installed for vacuum system.
  2. For vacuum service upstream of main shut-off valve: A 40 mm (1-1/2 inches) diameter gage shall be provided with steel case, bourdon tube and brass movement, dial range 0 to 100 kPa (0 to 29.5 inches Hg). Dual scale gages shall be provided for vacuum system.

#### **2.7 STATION INLETS**

- A. Vacuum Station inlets:
  1. Station inlets shall be for designated service, consisting of a quick coupler, quick disconnect type with inlet supply tube.

2. The outlet station shall be made, cleaned, and packaged to NFPA 99 standards and shall be UL listed and CSA certified.
3. A coupler shall be provided that is non-interchangeable with other services, and leak proof under three times normal working pressure.
4. Each station inlet shall be equipped with an automatic valve to conform with NFPA 99. Valves shall be placed in the assembly to provide easy access after installation for servicing and replacement, and to facilitate line blow-out, purging, and testing.
5. Each inlet shall be securely fastened to structure and provide each with a capped stub length of 7 mm (1/4 inches) (10 mm outside diameter) (3/8 inches outside diameter) tubing for connection to supply tubing. Stub tubing shall be labeled for appropriate service. Rough in shall be indexed and gas specified latch valve with non-interchangeable safety keying with color coded gas service identification.
6. Rough-in kits and test plugs for PBPU shall be furnished under this specification but installed by manufacturer of PBPU before initial test specified herein.
7. Completion kits (valve body and face plate) shall be installed for the remainder of required tests.

#### **2.8 STATION INLETS NOT USED.**

#### **2.9 STATION INLET ROUGH-IN**

- A. Station inlet rough in shall be flush mounted, and protected against corrosion. Rough in shall be anchored securely to unit or wall construction.
- B. The modular cover plate shall be constructed from die cast plate, two piece 0.85 mm (22 gage) stainless steel or 1.6 mm (16 gage) chromium plated metal, secured to rough in with stainless steel or chromium plated countersunk screws. The latch mechanism shall be designed for one handed, single thrust mounting and one handed fingertip release of secondary equipment.
- C. Cover Plate for PBPU shall be one piece with construction and material as indicated for modular cover plate.
- D. Permanent, metal or plastic, identification plates shall be provided securely fastened at each inlet opening, with inscription for appropriate service using color coded letters and background. Metal

plates shall have letters embossed on baked on enamel background. Color coding for identification plates is as follows:

SERVICE LABEL	IDENTIFICATION PLATE COLORS
MEDICAL VACUUM	Black letters on white background
EVACUATION (Waste Gas)	White letters on violet background

#### 2.10 CEILING SERVICES NOT USED.

#### 2.11 VACUUM SWITCHES NOT USED.

#### 2.12 VACUUM BOTTLE BRACKET

- A. Vacuum bottle bracket shall be single plate of one piece, 0.85 mm (22 gage) stainless steel or 1.6 mm (16 gage) chromium plated metal or aluminum, finish matching cover of adjoining vacuum inlet. All components shall be of same material as plate and assembly and anchored securely to structure. The bracket shall be provided and plastic vacuum bottle holder for each vacuum wall inlet.

### PART 3 - EXECUTION

#### 3.1 INSTALLATION

- A. All installation shall be performed in strict accordance with NFPA 99 5.1.10. Brazing procedures shall be as detailed in NFPA 99 5.1.10.4. Brazing shall be performed only by brazers qualified under NFPA 99 5.1.10.11.10. Where piping runs underground, the installation shall be made in accordance with NFPA 99 5.1.10.11.5.
- B. Contractor shall furnish 100 mm (4 inches) high concrete housekeeping pads. The contractor shall furnish inertia bases in lieu of housekeeping pads where the equipment installed is not factory isolated by the manufacturer. Anchor bolts shall be cast into bases
- C. Cast escutcheon shall be installed with set screw at each wall, floor and ceiling penetration in exposed finished locations and within cabinets and millwork.
- D. Open ends of tube shall be capped or plugged at all times or otherwise sealed until final assembly to prevent infiltration of any foreign matter.
- E. Piping shall be cut square and accurately with a tube cutter (sawing is prohibited) to measurements determined at place of installation. The tubing shall be reamed to remove burrs, being careful not to expand tube, and so no chips of copper remain in the tube. The tubing shall be

worked into place without springing or forcing. The tubing shall be bottomed in socket so there are no gaps between tube and fitting. Care shall be exercised in handling equipment and tools used in cutting or reaming of tube to prevent oil or grease from being introduced into the tubing. Where contamination has occurred, material shall be no longer suitable for vacuum service and new, sealed tube sections used.

- F. Piping shall be supported with pipe trays or hangers at intervals as shown on the contract drawings or as defined in NFPA 99. **Piping shall not be supported by other piping.** Isolation of copper piping from dissimilar metals shall be of a firm, positive nature. **Duct tape is prohibited as an isolation material.**
- G. Valves and other equipment shall be rigidly supported to prevent strain on tube or joints.
- H. Piping exposed to physical damage shall be protected.
- I. During any brazing operation, the interior of the pipe shall be purged continuously with oil free, dry nitrogen NF, following the procedure in NFPA 99 5.1.10.4.5. At the completion of any section, all open pipe ends shall be capped using an EXTERNAL cap. The flow of purged gas shall be maintained until joint is cool to touch. The use of flux is prohibited when making of joints between copper to copper pipes and fittings.
- J. Threaded joints in piping systems shall be avoided whenever possible. Where unavoidable, make up the male threads with polytetrafluoroethylene (such as Teflon) tape. Liquid sealants are prohibited.
- K. Tubing shall not be bent. Fittings shall be used in all change of direction or angle.
- L. After installation of the piping, but before installation of the outlet valves, blow lines clear using nitrogen NF per NFPA 99.
- M. Not Used.
- N. Not Used.
- O. Not Used.
- P. Pipe labeling shall be applied during installation process and not after installation is completed. Size of legend letters shall be in accordance with ASME A13.1.

Q. After initial leakage testing is completed, the piping shall be allowed to remain pressurized with testing gas until testing agency performs final tests.

R. Penetrations:

1. Fire Stopping: Where pipes pass through fire partitions, fire walls, smoked partitions, or floors, fire stopping shall be installed that provides an effective barrier against the spread of fire, smoke and gases as specified in Section 07 84 00, FIRESTOPPING, Clearances between raceways and openings with the fire stopping material shall be completely filled and sealed.
2. Water proofing: At floor penetrations, clearances shall be completely sealed around the pipe and made watertight with sealant as specified in Section 07 92 00, JOINT SEALANTS.

S. A vacuum gage 40 mm (1-1/2 inch) diameter shall be installed in line downstream of each valve located in a zone valve cabinet.

T. Not Used.

U. Piping shall be labeled with name of service, identification color and direction of flow. Where non-standard pressures are piped, pressure shall be labeled. Labels shall be placed at least once every 6.1 m (20 feet) of linear run or once in each story (whichever is more frequent). A label shall additionally be placed immediately on each side of all wall or floor penetrations. Pipe labels shall be self adhesive vinyl type or other water resistant material with permanent adhesive colored in accordance with NFPA 99 Table 5.1.11 and shall be visible on all sides of the pipe. Each master alarm signal shall be labeled for function after ring out. Each zone valve shall be labeled and each area alarm labeled for the area of control or surveillance after test. Labels shall be permanent and of a type approved by the VAMC.

### **3.2 INSTALLER TESTING**

A. Prior to declaring the lines ready for final verification, the installing contractor shall strictly follow the procedures for verification as described in NFPA 99 5.1.12.2 and attest in writing over the notarized signature of an officer of the installing company the following;

1. That all brazing was conducted by brazers qualified to ASSE Standard Series 6000 and holding current medical gas endorsements.

2. That all brazing was conducted with nitrogen purging. (Procedure per NFPA 99 5.1.10.4.5).
  3. That the lines have been blown clear of any construction debris using oil free dry nitrogen or air are clean and ready for use. (Procedure per NFPA 99 5.1.12.2.2).
  4. That the assembled piping, prior to the installation of any devices, maintained a test pressure 1 1/2 times the standard pressures listed in NFPA 99 Table 5.1.11 without leaks. (Procedure per NFPA 99 5.1.12.2.3).
  5. That after installation of all devices, the pipeline was proven leak free for 24 hours at a pressure 20 percent above the standard pressures listed in NFPA 99 Table 5.1.11. (Procedure per NFPA 99 5.1.12.2. 6)
  6. That the systems have been checked for cross connections and none were found. (Procedure per NFPA 99 5.1.12.2.4)
  7. That the manufacturer has started up all medical air compressors, medical vacuum pumps WAGD producers, liquid oxygen system(s) and manifolds, and that they are in operating order.
- B. Four originals of the affidavit, shall be distributed; (2) to the COR, (1) to the general contractor, and (1) to the verifier ([www.mgpho.org](http://www.mgpho.org)).

### **3.3 VERIFIER TESTING**

- A. Prior to handing over the systems to VAMC, the contractor shall retain a verifier acceptable to the engineer of record and VA who shall follow strictly the procedures for verification as described in NFPA 99 5.1.12.3 and provide a written report and certificate bearing the notarized signature of an officer of the verification company on company letterhead which contains at least the following:
1. A current ACORD insurance certificate indicating professional liability coverage in the minimum amount of \$1 Million per occurrence, and general aggregate liability in the minimum amount of \$1 Million, valid and in force when the project is to be verified. General liability insurance alone is not acceptable.
  2. An affidavit bearing the notarized signature of an officer of the verification company stating that the verification company is not the supplier of any equipment used on this project or tested in this report and that the verification contractor has no relationship to,

- or pecuniary interest in, the manufacturer, seller, or installer of any equipment used on this project or tested in this report.
3. A listing of all tests performed, listing each source, outlet, valve and alarm included in the testing.
  4. An assertion that all tests were performed by a Medical Vacuum System Certified Medical Gas or vacuum Verifier or by individuals qualified to perform the work and holding valid qualifications to ASSE 6030 and under the immediate supervision a Verifier. Include the names, credential numbers and expiration dates for all individuals working on the project.
  5. A statement that equipment used was calibrated at least within the last six months by a method traceable to a National Bureau of Standard Reference and enclosing certificates or other evidence of such calibration(s). Where outside laboratories are used in lieu of on site equipment, those laboratories shall be named and their original reports enclosed.
  6. A statement that where and when needed, equipment was re calibrated during the verification process and describing the method(s) used.
  7. A statement that the systems were tested and found to be free of debris to a procedure per NFPA 99 5.1.12.3.7.
  8. The flow from each outlet when tested to a procedure per NFPA 99 5.1.12.3.10.
  9. A statement that the systems were tested and found to have no cross-connections to a procedure per NFPA 99 5.1.12.3.3.
  10. A statement that the systems were tested and found to be free of contaminants to a procedure per NFPA 99 5.1.12.3.8 except that the purity standard shall be 2 ppm difference for halogenated hydrocarbons and 1 ppm total hydrocarbons (as methane).
  11. Not Used.
  12. Not Used.
  13. Not Used.
  15. Not Used.
  16. Not Used.
  17. The concentration of each gas at each outlet as specified in NFPA 99 5.1.12.3.11.
  18. A statement that all valves and alarms are accurately labeled as to zone of control.

- B. Perform and document all cross connection tests, labeling verification, supply system operation, and valve and alarm operation tests as required by, and in accordance with NFPA 99 and the procedures set forth in pre-qualification documentation.
- C. Verify that the systems, as installed, meet or exceed the requirements of NFPA 99, this specification, and that the systems operate as required.
- D. Piping purge test: For each positive pressure gas system, verify cleanliness of piping system. Filter a minimum of 1000 liters (35 cubic feet) of gas through a clean white 0.45 micron filter at a minimum velocity of 100 mps (3.5 fpm). Filter shall show no discoloration, and shall accrue no more than 0.1 mg of matter. Test each zone at the outlet most remote from the source. Perform test with the use of an inert gas as described in CGA P-9. Retest until all tests pass at no additional time or cost to the Government.
- E. Inlet flow test:
  - 1. Test all inlets for flow. Perform test with the use of an inert gas as described in CGA P-9.
  - 2. Needle valve vacuum inlets shall draw no less than 1.0 SCFM with adjacent inlet flowing, at a dynamic inlet pressure of 40 kPa (12 inches Hg), and a static vacuum of 10 kPa (3 inches Hg).
  - 3. Vacuum inlets shall draw no less than 85 Lpm (3.0 SCFM) with adjacent inlet flowing, at a dynamic inlet pressure of 40 kPa (12 inches Hg), and a static vacuum of 50 kPa (15 inches Hg).
  - 4. Anesthesia evacuation inlets shall draw no less than 1 L/mm (1.0 SCFM) at a dynamic inlet pressure of 40 kPa (12 inches Hg), and a static vacuum of 50 kPa (15 inches Hg).

#### **3.4 CONNECTION TO EXISTING LABORATORY VACUUM SYSTEM**

- A. Contactor shall test the existing system for hydrocarbons, dew point, etc. per NFPA 99. If problems are present, the COR would notify the facility of the results. The facility would then make the necessary repairs and/or maintenance.
- B. Double shut-off valves shall be installed at the connection of new line to existing line.
- C. Time for shutdown of the existing vacuum system shall be coordinated at least 10 work days prior to shutdown with the COR and VA Medical Center.



- D. Prior to any work being done, new pipeline shall be checked for particulate or other forms of contamination per NFPA 99.
- E. Ensure that the correct type of pipe tubing and fittings are being used.
- F. A spot check of the existing pipelines shall be made in the facility to determine the level of cleanness present.
- G. The tie-in shall be made as quickly as possible. A nitrogen purge is not required since this would require another opening in the pipe.
- H. After the tie-in is made and allowed to cool, slowly bleed the source vacuum back into the pipeline. Test the work area for leaks with soapy water and repair any leaks.
- I. After all leaks, if any, are repaired and the line is fully recharged, perform blow down and testing. Open the zone that is closest to the main to the system, access the closest outlet to the work, and blow the main through the inlet. After the inlet blows clear into a white cloth, make an additional check at a zone most distant from the work. Perform all required NFPA 99 tests after connection.

### **3.5 COMMISSIONING NOT USED.**

### **3.6 DEMONSTRATION AND TRAINING**

- A. Provide services of manufacturer's technical representative for four hours to instruct VA Personnel in operation and maintenance of the system.

- - - E N D - - -



**SECTION 22 63 00**  
**GAS SYSTEMS FOR LABORATORY AND HEALTHCARE FACILITIES**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. Central Laboratory and Healthcare Gas Systems: Consisting of oxygen, and compressed air services; complete, ready for operation, including all necessary piping, fittings, valves, cabinets, station outlets, rough-ins, ceiling services, gages, alarms including low voltage wiring, nitrogen control panels, cylinder manifolds, air compressors, electric motors and starters, air dryers, filters, pressure regulators, dew point monitor, carbon monoxide monitor and all necessary parts, accessories, connections and equipment. Match existing station outlet and inlet terminal connections.
- B. Not Used.
- C. Not Used.
- D. Not Used.
- E. Not Used.
- F. Laboratory and healthcare gas system alarm wiring from equipment to alarm panels.
- G. A complete listing of all acronyms and abbreviations are included in Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.

**1.2 RELATED WORK**

- A. Section 01 00 00, GENERAL REQUIREMENTS.
- B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- C. Section 01 81 13, SUSTAINABLE CONSTRUCTION REQUIREMENTS.
- D. Not Used.
- E. Section 07 84 00, FIRESTOPPING: Sealing around pipe penetrations to maintain the integrity of time rated construction.
- F. Section 07 92 00, JOINT SEALANTS: Sealing around pipe penetrations through the floor to prevent moisture migration.
- G. Not Used.
- H. Not Used.
- I. Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING: General requirements and items common to more than one section of Division 22.
- J. Section 22 05 12, GENERAL MOTOR REQUIREMENTS FOR PLUMBING EQUIPMENT: Electric motors.
- K. Not Used.

- L. SECTION 22 62 00, VACUUM SYSTEMS FOR LABORATORY AND HEALTHCARE FACILITIES: Vacuum Piping and Equipment.
- M. Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC: Alarm interface with BAS.
- N. Section 26 05 19, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES: Control wiring.
- O. Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS: Conduit.
- P. Section 26 27 26, WIRING DEVICES: Electrical wiring and accessories.
- Q. Section 26 29 11, MOTOR CONTROLLERS: Motor starters.

### 1.3 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American Society of Mechanical Engineers (ASME):
  - A13.1-2007 (R2013).....Scheme for the Identification of Piping Systems
  - B16.15-2013.....Cast Copper Alloy Threaded Fittings: Classes 125 and 250
  - B16.22-2013.....Wrought Copper and Copper Alloy Solder-Joint Pressure Fittings
  - B16.50-2013.....Wrought Copper and Copper Alloy Braze-Joint Pressure Fittings
  - B40.100-2013.....Pressure Gauges and Gauge Attachments
  - ASME Boiler and Pressure Vessel Code -
  - BPVC Section VIII-2015..Rules for Construction of Pressure Vessels, Division I
  - BPVC Section IX-2015....Welding, Brazing, and Fusing Qualifications
- C. American Society of Sanitary Engineers (ASSE):
  - 6000 Series-2012.....Professional Qualifications Standard for Medical Gas Systems Personnel
- D. American Society for Testing and Materials (ASTM):
  - B43-2014.....Standard Specification for Seamless Red Brass Pipe, Standard Sizes
  - B687-1999 (2011).....Standard Specification for Brass, Copper, and Chromium-Plated Pipe Nipples
  - B819-2000 (R2011).....Standard Specification for Seamless Copper Tube for Medical Gas Systems

## E. American Welding Society (AWS):

A5.8M/A5.8-2011.....Specification for Filler Metals for Brazing and  
Braze Welding

B2.2/B2.2M-2010.....Specification for Brazing Procedure and  
Performance Qualification

## F. Compressed Gas Association (CGA):

C-9-2013.....Standard Color Marking of Compressed Gas  
Containers for Medical Use

G-4.1-2009.....Cleaning Equipment for Oxygen Service

G-10.1-2008.....Commodity Specification for Nitrogen

P-9-2008.....The Inert Gases: Argon, Nitrogen, and Helium

V-1-2013.....Standard for Compressed Gas Cylinder Valve  
Outlet and Inlet Connections

## G. Manufacturing Standardization Society (MSS):

SP-72-2010a.....Ball Valves With Flanged or Butt-Welding Ends  
For General Service

SP-110-2010.....Ball Valves Threaded, Socket-Welding, Solder  
Joint, Grooved and Flared Ends

## H. National Electrical Manufacturers Association (NEMA):

ICS 6-1993 (R2001, R2006) Industrial Control and Systems Enclosures

## I. National Fire Protection Association (NFPA):

99-2015.....Health Care Facilities Code

**1.4 SUBMITTALS**

A. Submittals, including number of required copies, shall be submitted in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.

B. Information and material submitted under this section shall be marked "SUBMITTED UNDER SECTION 22 63 00, GAS SYSTEMS FOR LABORATORY AND HEALTHCARE FACILITIES", with applicable paragraph identification.

C. Manufacturer's Literature and Data including: Full item description and optional features and accessories. Include dimensions, weights, materials, applications, standard compliance, model numbers, size, and capacity.

1. Piping.

2. Valves.

3. Inlet and outlet cocks

4. Valve cabinets.

5. Gages.

- 6. Station outlets and rough-in assemblies.
- 7. Not Used.
- 8. Not Used.
- 9. Pressure Switches.
- D. Station Outlets: Submit letter from manufacturer stating that outlets are designed and manufactured to comply with NFPA 99. Outlet shall bear label of approval as an assembly, of Underwriters Laboratories, Inc., or Associated Factory Mutual Research Corporation.
- E. Certification: The completed systems have been installed, tested, purged, analyzed and verified in accordance with the requirements of this specification. Certification shall be submitted to COR.

#### **1.5 QUALITY ASSURANCE**

- A. Materials and Installation: In accordance with NFPA 99 and as specified.
- B. Equipment Installer: Show technical qualifications and previous experience in installing laboratory and healthcare equipment on three similar projects. Submit names, phone numbers, and addresses of referenced projects. Installers shall meet the qualifications of ASSE Standard Series 6000.
- C. Equipment Supplier: Provide evidence of equivalent product installed at three installations similar to this project that has been in satisfactory and efficient operation for three years. Submit names, phone numbers, and addresses where the product is installed.
- D. Laboratory and healthcare System Testing Organization: The testing shall be conducted by a party technically competent and experienced in the field of laboratory and healthcare pipeline testing. Testing and systems verification shall be performed by personnel meeting the qualifications of ASSE Standard Series 6000. Such testing shall be performed by a party other than the installing contractor.
- E. Provide the names of three projects where testing of medical or laboratory gases systems has been performed by the testing agency. Include the name of the project, names of such persons at that project who supervised the work for the project owner, or who accepted the report for the project owner, and a written statement that the projects listed required work of similar scope to that set forth in this specification.
- F. Submit the testing agency's detailed procedure which shall be followed in the testing of this project. Include details of the testing

sequence, procedures for cross connection tests, outlet function tests, alarm tests, purity tests, etc., as required by this specification. For purity test procedures, include data on test methods, types of equipment to be used, calibration sources and method references.

- G. Certification: Provide COR documentation 10 working days prior to submitting request for final inspection to include all test results, the names of individuals performing work for the testing agency on this project, detailed procedures followed for all tests, and certification that all results of tests were within limits allowed by this specification.
- H. "Hot taps" are prohibited for operating medical oxygen systems. Methods for connection and extension of active and pressurized medical gas systems without subsequent medical gas testing and verification are prohibited.
- I. Bio-Based Materials: For products designated by the USDA's Bio-Preferred Program, provide products that meet or exceed USDA recommendations for bio-based content, so long as products meet all performance requirements in this specifications section. For more information regarding the product categories covered by the Bio-Preferred Program, visit <http://www.biopreferred.gov>.

#### **1.6 AS-BUILT DOCUMENTATION**

- A. Submit manufacturer's literature and data updated to include submittal review comments and any equipment substitutions.
- B. Submit operation and maintenance data updated to include submittal review comments, substitutions and construction revisions shall be in electronic version on compact disc or DVD inserted into a three ring binder. All aspects of system operation and maintenance procedures, including piping isometrics, wiring diagrams of all circuits, a written description of system design, control logic, and sequence of operation shall be included in the operation and maintenance manual. The operations and maintenance manual shall include troubleshooting techniques and procedures for emergency situations. Notes on all special systems or devices such as damper and door closure interlocks shall be included. A List of recommended spare parts (manufacturer, model number, and quantity) shall be furnished. Information explaining any special knowledge or tools the owner will be required to employ shall be inserted into the As-Built documentation.

- C. The installing contractor shall maintain as-built drawings of each completed phase for verification; and, shall provide the complete set at the time of final systems certification testing. As-built drawings are to be provided, and a copy of them in Auto-CAD version 2014 provided on compact disk or DVD. Should the installing contractor engage the testing company to provide as-built or any portion thereof, it shall not be deemed a conflict of interest or breach of the 'third party testing company' requirement.
- D. Certification documentation shall be provided to COR 10 working days prior to submitting the request for final inspection. The documentation shall include all test results, the names of individuals performing work for the testing agency on this project, detailed procedures followed for all tests, and certification that all results of tests were within limits specified.

## **PART 2 - PRODUCTS**

### **2.1 PIPING AND FITTINGS**

- A. Copper Tubing: Type "K", ASTM B819, seamless copper tube, hard drawn temper, with wrought copper fittings conforming to ASME B16.22 or brazing fittings complying with ASME B16.50. Size designated reflecting nominal inside diameter. All tubing and fittings shall be labeled "ACR/OXY", "OXY", "OXY/MED", "ACR/MED", or "MED".
- B. Brazing Alloy: AWS A5.8M/A5.8, Classification BCuP, greater than 538 degrees C (1000 degrees F) melting temperature. Flux is strictly prohibited for copper-to-copper connections.
- C. Threaded Joints: Polytetrafluoroethylene (Teflon) tape.
- D. Underground Protective Pipe: Polyvinyl Chloride (PVC), ASTM D1785, Schedule 80.
- E. Not Used.
- F. Apply piping identification labels at the time of installation in accordance with NFPA 99. Apply supplementary color identification in accordance with CGA Pamphlet C-9.

### **2.2 EXPOSED LABORATORY AND HEALTHCARE GASES PIPING NOT USED.**

### **2.3 VALVES**

- A. Ball: In-line, other than zone valves in cabinets:
  - 1. 75 mm (3 inches) and smaller: Bronze/ brass body, MSS SP-72, MSS SP-110, Type II, Class 150, Style 1, with tubing extensions for brazed connections, full port, three-piece or double union end connections, Teflon seat seals, full flow, 4138 kPa (600 psig) WOG



- minimum working pressure, with locking type handle, cleaned for oxygen use and labeled for intended service.
2. 75 to 100 mm (3 to 4 inches): Bronze/ brass body, MSS SP-72 MSS SP-110, Type II, Class 150, Style 1 with tubing extensions brazed to flanges, full port, three piece, double seal, Teflon seals, full flow, 4138 kPa (600 psig) WOG minimum working pressure, with locking type handle, cleaned for oxygen use and labeled for intended service.

#### **2.4 VALVE CABINETS NOT USED.**

#### **2.5 GAGES**

- A. Pressure Gages: Includes gages temporarily supplied for testing purposes.
  1. For line pressure use adjacent to source equipment: ASME B40.1, pressure gage, single, size 115 mm (4-1/2 inches), for compressed air, nitrogen and oxygen, accurate to within 2 percent, with metal case. Range shall be two times operating pressure. Dial graduations and figures shall be black on a white background, or white on a black background. Gage shall be cleaned for oxygen use, labeled for appropriate service, and marked "USE NO OIL". Install with gage cock.
  2. For all services downstream of main shutoff valve: Manufactured for oxygen use, labeled for the appropriate service and marked "USE NO OIL", 40 mm (1-1/2 inch) diameter gage with dial range 1 to 690 kPa (1 to 100 psig) for air service

#### **2.6 STATION OUTLETS**

- A. For all services except ceiling hose drops and nitrogen system: For designated service, consisting of a quick coupler and inlet supply tube. Provide coupler that is non-interchangeable with other services, and leak proof under three times the normal working pressure. Equip each station outlet with an automatic valve and a secondary check valve to conform with NFPA 99. Equip each station inlet with an automatic valve to conform with NFPA 99. Place valves in the assembly to provide easy access after installation for servicing and replacement, and to facilitate line blow-out, purging, and testing. Fasten each outlet and inlet securely to rough-in to prevent floating and provide each with a capped stub length of 6 mm (1/4-inch) (10 mm outside diameter) (3/8-inch outside diameter) tubing for connection to supply. Identification of each gas service shall be permanently cast into the back plate and

shall be visible through a transparent plastic guard. Label stub tubing for appropriate service. Rough-in kits and test plugs for PBPU are furnished under this specification but installed by manufacturer of PBPU before initial test specified herein. Install completion kits (valve body and face plate) for the remainder of required tests.

## 2.7 STATION OUTLETS

- A. For all services: Brass, stainless steel or chromed metal non-interchangeable DISS connections for appropriate service to conform with CGA V-5. Equip each station outlet with an automatic valve and a secondary check valve to conform with NFPA 99. Equip each station inlet with an automatic valve to conform with NFPA 99. Place valves in the assembly to provide easy access after installation, for servicing and replacement, and to facilitate line blow-out, purging, and testing. Fasten each outlet securely to outlet rough-in to prevent floating, and provide each outlet with a capped stub length of 6 mm (1/4-inch) (10 mm (3/8-inch) outside diameter) tubing for connection to supply. Label stub tubing for appropriate service. Adjustable to compensate for variations in plaster or cover thickness. Rough-in kits and test plugs for PBPU are furnished under this specification but installed by manufacturer of PBPU before initial tests specified herein. Install outlet completion kits (valve body and face plate) for the remainder of required tests.

## 2.8 STATION OUTLET ROUGH-IN

- A. Anchor flush mounted rough-in securely to unit or wall construction.
- B. Modular Cover Plate: Die cast back plate, two-piece 0.85 mm (22 gage) stainless steel or 1.6 mm (16 gage) chromium plated metal, with mounting flanges on all four sides, secured to rough-in with stainless steel or chromium plated countersunk screws.
- C. Cover Plate for PBPU: One-piece with construction and material as indicated for modular cover plate.
- D. Provide permanent, metal or plastic, identification plates securely fastened at each outlet and inlet opening, with inscription for appropriate service using color coded letters and background. Metal plates shall have letters embossed on baked-on enamel background. Color coding for identification plates is as follows:

SERVICE LABEL	IDENTIFICATION PLATE COLORS
OXYGEN	White letters on green background and vice versa

SERVICE LABEL	IDENTIFICATION PLATE COLORS
MEDICAL AIR	Black letters on yellow

**2.9 CEILING SERVICES NOT USED.****2.10 ALARMS NOT USED.****2.11 PRESSURE SWITCHES**

- A. General purpose, contact or mercury type, allowing both high and low pressure set points, with contact type provided with a protective dust cover; adjustable range; switches activate when indicated by alarm requirements. Use one orifice nipple (or DISS demand check valve) for each sensor or pressure switch.

**PART 3 - EXECUTION****3.1 INSTALLATION**

- A. In accordance with NFPA 99. Run buried oxygen piping in PVC protective pipe for entire length including enclosure of fittings and changes of direction.
- B. Install cast escutcheon with set screw at each wall, floor and ceiling penetration in exposed finished locations and within cabinets and millwork.
- C. Open ends of tube shall be capped or plugged at all times or otherwise sealed until final assembly to prevent infiltration of any foreign matter.
- D. Cut piping square and accurately with a tube cutter (sawing is prohibited) to measurements determined at place of installation. Ream tube to remove burrs, being careful not to expand tube, and so no chips of copper remain in the tube. Work into place without springing or forcing. Bottom tube in socket so there are no gaps between tube and fitting. Exercise care in handling equipment and tools used in cutting or reaming of tube to prevent oil or grease being introduced into tubing. Where contamination has occurred, material is no longer suitable for oxygen service.
- E. Spacing of hangers: NFPA 99.
- F. Rigidly support valves and other equipment to prevent strain on tube or joints.
- G. While being brazed, joints shall be continuously purged with oil free nitrogen. The flow of purged gas shall be maintained until joint is cool to touch.
- H. Do not bend tubing. Use fittings.
- I. Not Used.

- J. Not Used.
- K. Install pressure switches, transmitter and gauges to be easily accessed, and provide access panel where installed above plaster ceiling. Install pressure switch and sensors with orifice nipple between the pipe line and switches/sensors.
- L. Apply pipe labeling during installation process and not after installation is completed. Size of legend letters shall be in accordance with ASME A13.1.
- M. Not Used.
- N. After initial leakage testing is completed, allow piping to remain pressurized with testing gas until testing agency performs final tests.
- O. Penetrations:
  - 1. Fire Stopping: Where pipes pass through fire partitions, fire walls, smoked partitions, or floors, install a fire stop that provides an effective barrier against the spread of fire, smoke and gases as specified in Section 07 84 00, FIRESTOPPING, with intumescent materials only. Completely fill and seal clearances between raceways and openings with the fire stopping material.
  - 2. Waterproofing: At floor penetrations, completely seal clearances around the pipe and make watertight with sealant as specified in Section 07 92 00, JOINT SEALANTS. Bio-based materials shall be utilized when possible.
- P. Provide 40 mm (1-1/2 inch) diameter line pressure gage downstream of zone valve in cabinets.

### **3.2 STARTUP AND TESTING**

- A. Initial Tests: Blow down and high and low pressure leakage tests as required by NFPA 99 with documentation.
- B. Laboratory and/or healthcare testing agency shall perform the following:
  - 1. Perform and document all cross connection tests, labeling verification, supply system operation, and valve and alarm operation tests as required by, and in accordance with NFPA 99 and the procedures set forth in pre-qualification documentation.
  - 2. Verify that the systems, as installed, meet or exceed the requirements of NFPA 99, this specification, and that the systems operate as required.
  - 3. Piping purge test: For each positive pressure gas system, verify cleanliness of piping system. Filter a minimum of 1000 liters (35

- cubic feet) of gas through a clean white 0.45 micron filter at a minimum velocity of 100 liters per minute (3.5 SCFM). Filter shall show no discoloration, and shall accrue no more than 0.1 mg (0.0000035 ounces) of matter. Test each zone at the outlet most remote from the source. Perform test with the use of an inert gas as described in CGA P-9.
4. Piping purity test: For each positive pressure system, verify purity of piping system. Test each zone at the most remote outlet for dew point, carbon monoxide, total hydrocarbons (as methane), and halogenated hydrocarbons, and compare with source gas. The two tests shall in no case exceed variation as specified in paragraph, "Maximum Allowable Variation". Perform test with the use of an inert gas as described in CGA P-9.
  5. Outlet and inlet flow test:
    - a. Test all outlets for flow. Perform test with the use of an inert gas as described in CGA P-9.
    - b. Oxygen, nitrous oxide and air outlets shall deliver 100 Lpm (3.5 SCFM) with a pressure drop of no more than 34 kPa (5 psig), and static pressure of 345 kPa (50 psig).
    - c. Not Used.
    - d. Needle valve air outlets shall deliver 1.5 SCFM with a pressure drop of no more than five psig, and static pressure of 345 kPa (50 psig).
  6. Source Contamination Test: Analyze each pressure gas source for concentration of contaminants, by volume. Take samples for air system test at the intake and at a point immediately downstream of the final filter outlet. The compared tests shall in no case exceed variation as specified in paragraph "Maximum Allowable Variation". Allowable concentrations are below the following:

Dew point, air	4 degrees C (40 degrees F) pressure dew point at 690 kPa (100 psig)
Carbon monoxide, air	10 mg/L (ppm)
Carbon dioxide, air	500 mg/L (ppm)
Gaseous hydrocarbons as methane, air	25 mg/L (ppm)
Halogenated hydrocarbons, air	2 mg/L (ppm)

## 7. Analysis Test:

- a. Analyze each pressure gas source and outlet for concentration of gas, by volume.
- b. Make analysis with instruments designed to measure the specific gas dispensed.
- c. Allowable concentrations are within the following:
  - 1) Laboratory air 19.5 percent to 23.5 percent oxygen.

Oxygen	>=97% plus oxygen
Medical air	19.5% to 23.5% oxygen

## 8. Maximum Allowable Variation: Between comparative test results required are as follows:

Dew point	2 degrees C (35 degrees F)
Carbon monoxide	2 mg/L (ppm)
Total hydrocarbons as methane	1 mg/L (ppm)
Halogenated hydrocarbons	2 mg/L (ppm)

- C. The CxA will observe startup and contractor testing of selected equipment. Coordinate the startup and contractor testing schedules with the COR and CxA. Contractor shall provide a minimum of 10 working days prior to startup and testing.

**3.3 CONNECTION TO EXISTING LABORATORY GAS SYSTEM:**

- A. Contactor shall test the existing system for hydrocarbons, dew point, etc. per NFPA 99. If problems are present, the COR would notify the facility of the results. The facility would then make the necessary repairs and/or maintenance prior to connecting to new system.
- B. Install shut-off valve at the connection of new line to existing line.
- C. Time for shutdown of the existing laboratory and healthcare system shall be coordinated at least 10 work days prior to shutdown with the COR and VA Medical Center.
- D. Shut off all oxygen zone valves and gas riser valves if the section to be connected cannot be totally isolated from the remainder of the system.
- E. Prior to any work being done, check the new pipeline for particulate or other forms of contamination per NFPA 99.

- F. Ensure that the correct type of pipe tubing and fittings are being used.
- G. Make a spot check of the existing pipelines in the facility to determine the level of cleanness present.
- H. Reduce the pressure to zero and make the tie-in as quickly as possible. A nitrogen purge is not required since this would require another opening in the pipe.
- I. After the tie-in is made and allowed to cool, slowly bleed the source gas back into the pipeline. Test the work area for leaks with soapy water and repair any leaks.
- J. After all leaks, if any, are repaired and the line is fully recharged, perform blow down and testing. Open the zone that is closest to the main to the system, access the closest outlet to the work, and blow the main through the outlet. After the outlet blows clear into a white cloth, make an additional check at a zone most distant from the work. Perform all required NFPA 99 tests after connection.

#### **3.4 COMMISSIONING NOT USED.**

#### **3.5 DEMONSTRATION AND TRAINING**

- A. Provide services of manufacturer's technical representative for four hours to instruct VA Personnel in operation and maintenance of units.

- - - E N D - - -





**SECTION 23 05 11  
COMMON WORK RESULTS FOR HVAC**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. The requirements of this Section apply to all sections of Division 23.
- B. Definitions:
  - 1. Exposed: Piping, ductwork, and equipment exposed to view in finished rooms.
  - 2. Option or optional: Contractor's choice of an alternate material or method.
  - 3. PM: Project Manager
  - 4. COTR: Contracting Officer's Technical Representative.

**1.2 RELATED WORK**

- A. Section 00 72 00, GENERAL CONDITIONS
- B. Section 01 00 00, GENERAL REQUIREMENTS
- C. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES
- D. Not Used.
- E. Not Used.
- F. Section 03 30 00, CAST-IN-PLACE CONCRETE.
- G. Section 05 31 00, STEEL DECKING,
- H. Not Used.
- I. Section 05 50 00, METAL FABRICATIONS
- J. Section 07 84 00, FIRESTOPPING
- K. Section 07 92 00, JOINT SEALANTS
- L. Section 09 91 00, PAINTING
- M. Not Used.
- N. Section 23 05 12, GENERAL MOTOR REQUIREMENTS FOR HVAC and STEAM GENERATION
- O. Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING and EQUIPMENT
- P. Section 23 05 93, TESTING, ADJUSTING, and BALANCING FOR HVAC
- Q. Section 23 07 11, HVAC, and BOILER PLANT INSULATION.
- R. Section 23 08 00, COMMISSIONING OF HVAC SYSTEMS.
- S. Not Used.
- T. Not Used.
- U. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS
- V. Section 26 05 19, LOW VOLTAGE ELECTRICAL POWER CONDUITS and CABLES.
- Y. Section 26 29 11, LOW-VOLTAGE MOTOR STARTERS

### 1.3 QUALITY ASSURANCE

- A. Mechanical, electrical and associated systems shall be safe, reliable, efficient, durable, easily and safely operable and maintainable, easily and safely accessible, and in compliance with applicable codes as specified. The systems shall be comprised of high quality institutional-class and industrial-class products of manufacturers that are experienced specialists in the required product lines. All construction firms and personnel shall be experienced and qualified specialists in industrial and institutional HVAC
- B. Flow Rate Tolerance for HVAC Equipment: Section 23 05 93, TESTING, ADJUSTING, AND BALANCING FOR HVAC.
- C. Equipment Vibration Tolerance:
  - 1. Refer to Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING and EQUIPMENT. Equipment shall be factory-balanced to this tolerance and re-balanced on site, as necessary.
  - 2. After HVAC air balance work is completed and permanent drive sheaves are in place, perform field mechanical balancing and adjustments required to meet the specified vibration tolerance.
- D. Products Criteria:
  - 1. Standard Products: Material and equipment shall be the standard products of a manufacturer regularly engaged in the manufacture of the products for at least 3 years (or longer as specified elsewhere). The design, model and size of each item shall have been in satisfactory and efficient operation on at least three installations for approximately three years. However, digital electronics devices, software and systems such as controls, instruments, computer work station, shall be the current generation of technology and basic design that has a proven satisfactory service record of at least three years. See other specification sections for any exceptions and/or additional requirements.
  - 2. All items furnished shall be free from defects that would adversely affect the performance, maintainability and appearance of individual components and overall assembly.
  - 3. Conform to codes and standards as required by the specifications. Conform to local codes, if required by local authorities such as the natural gas supplier, if the local codes are more stringent than those specified. Refer any conflicts to the Project Manager.

4. Multiple Units: When two or more units of materials or equipment of the same type or class are required, these units shall be products of one manufacturer.
5. Assembled Units: Manufacturers of equipment assemblies, which use components made by others, assume complete responsibility for the final assembled product.
6. Nameplates: Nameplate bearing manufacturer's name or identifiable trademark shall be securely affixed in a conspicuous place on equipment, or name or trademark cast integrally with equipment, stamped or otherwise permanently marked on each item of equipment.
7. Asbestos products or equipment or materials containing asbestos shall not be used.

E. Equipment Service Organizations:

1. HVAC: Products and systems shall be supported by service organizations that maintain a complete inventory of repair parts and are located within 50 miles to the site.

F. HVAC Mechanical Systems Welding: Before any welding is performed, contractor shall submit a certificate certifying that welders comply with the following requirements:

1. Qualify welding processes and operators for piping according to ASME "Boiler and Pressure Vessel Code", Section IX, "Welding and Brazing Qualifications".
2. Comply with provisions of ASME B31 series "Code for Pressure Piping".
3. Certify that each welder has passed American Welding Society (AWS) qualification tests for the welding processes involved, and that certification is current.

G. Execution (Installation, Construction) Quality:

1. Apply and install all items in accordance with manufacturer's written instructions. Refer conflicts between the manufacturer's instructions and the contract drawings and specifications to the Project Manager for resolution. Provide written hard copies or computer files of manufacturer's installation instructions to the Project Manager at least two weeks prior to commencing installation of any item. Installation of the item will not be allowed to proceed until the recommendations are received. Failure to furnish these recommendations is a cause for rejection of the material.

2. Provide complete layout drawings required by Paragraph, SUBMITTALS.

Do not commence construction work on any system until the layout drawings have been approved.

H. Upon request by Government, provide lists of previous installations for selected items of equipment. Include contact persons who will serve as references, with telephone numbers and e-mail addresses.

#### **1.4 SUBMITTALS**

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES, and with requirements in the individual specification sections.
- B. Contractor shall make all necessary field measurements and investigations to assure that the equipment and assemblies will meet contract requirements.
- C. If equipment is submitted which differs in arrangement from that shown, provide drawings that show the rearrangement of all associated systems. Approval will be given only if all features of the equipment and associated systems, including accessibility, are equivalent to that required by the contract.
- D. Prior to submitting shop drawings for approval, contractor shall certify in writing that manufacturers of all major items of equipment have each reviewed drawings and specifications, and have jointly coordinated and properly integrated their equipment and controls to provide a complete and efficient installation.
- E. Submittals and shop drawings for interdependent items, containing applicable descriptive information, shall be furnished together and complete in a group. Coordinate and properly integrate materials and equipment in each group to provide a completely compatible and efficient.
- F. Not Used.
- G. Not Used.
- H. Layout Drawings:
  - 1. Submit complete consolidated and coordinated layout drawings for all new systems, and for existing systems that are in the same areas. Refer to Section 00 72 00, GENERAL CONDITIONS, Article, SUBCONTRACTS AND WORK COORDINATION.
  - 2. The drawings shall include plan views, elevations and sections of all systems and shall be on a scale of not less than 1:32 (3/8-inch equal to one foot). Clearly identify and dimension the proposed

- locations of the principal items of equipment. The drawings shall clearly show locations and adequate clearance for all equipment, piping, valves, control panels and other items. Show the access means for all items requiring access for operations and maintenance. Provide detailed layout drawings of all piping and duct systems.
3. Do not install equipment foundations, equipment or piping until layout drawings have been approved.
  4. In addition, for HVAC systems, provide details of the following:
    - a. Mechanical equipment rooms.
    - c. Hangers, inserts, supports, and bracing.
    - d. Pipe sleeves.
    - e. Duct or equipment penetrations of floors, walls, ceilings, or roofs.
- I. Manufacturer's Literature and Data: Submit under the pertinent section rather than under this section.
1. Submit belt drive with the driven equipment. Submit selection data for specific drives when requested by the Project Manager.
  2. Submit electric motor data and variable speed drive data with the driven equipment.
  3. Equipment and materials identification.
  4. Fire-stopping materials.
  5. Hangers, inserts, supports and bracing. Provide load calculations for variable spring and constant support hangers.
  6. Wall, floor, and ceiling plates.
- J. HVAC Maintenance Data and Operating Instructions:
1. Maintenance and operating manuals in accordance with Section 01 00 00, GENERAL REQUIREMENTS, Article, INSTRUCTIONS, for systems and equipment.
  2. Provide a listing of recommended replacement parts for keeping in stock supply, including sources of supply, for equipment. Include in the listing belts for equipment: Belt manufacturer, model number, size and style, and distinguished whether of multiple belt sets.
- K. Provide copies of approved HVAC equipment submittals to the Testing, Adjusting and Balancing Subcontractor.

#### **1.5 APPLICABLE PUBLICATIONS**

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.

- B. Air Conditioning, Heating and Refrigeration Institute (AHRI):  
430-2009.....Central Station Air-Handling Units
- C. American National Standard Institute (ANSI):  
B31.1-2007.....Power Piping
- D. Rubber Manufacturers Association (ANSI/RMA):  
IP-20-2007.....Specifications for Drives Using Classical  
V-Belts and Sheaves  
IP-21-2009.....Specifications for Drives Using Double-V  
(Hexagonal) Belts  
IP-22-2007.....Specifications for Drives Using Narrow V-Belts  
and Sheaves
- E. Air Movement and Control Association (AMCA):  
410-96.....Recommended Safety Practices for Air Moving  
Devices
- F. American Society of Mechanical Engineers (ASME):  
Boiler and Pressure Vessel Code (BPVC):  
Section I-2007.....Power Boilers  
Section IX-2007.....Welding and Brazing Qualifications  
Code for Pressure Piping:  
B31.1-2007.....Power Piping
- G. American Society for Testing and Materials (ASTM):  
A36/A36M-08.....Standard Specification for Carbon Structural  
Steel  
A575-96(2007).....Standard Specification for Steel Bars, Carbon,  
Merchant Quality, M-Grades  
E84-10.....Standard Test Method for Surface Burning  
Characteristics of Building Materials  
E119-09c.....Standard Test Methods for Fire Tests of  
Building Construction and Materials
- H. Manufacturers Standardization Society (MSS) of the Valve and Fittings  
Industry, Inc:  
SP-58-2009.....Pipe Hangers and Supports-Materials, Design and  
Manufacture, Selection, Application, and  
Installation  
SP 69-2003.....Pipe Hangers and Supports-Selection and  
Application  
SP 127-2001.....Bracing for Piping Systems, Seismic - Wind -  
Dynamic, Design, Selection, Application

## I. National Electrical Manufacturers Association (NEMA):

MG-1-2009.....Motors and Generators

## J. National Fire Protection Association (NFPA):

31-06.....Standard for Installation of Oil-Burning  
Equipment

54-09.....National Fuel Gas Code

70-08.....National Electrical Code

85-07.....Boiler and Combustion Systems Hazards Code

90A-09.....Standard for the Installation of Air  
Conditioning and Ventilating Systems

101-09.....Life Safety Code

**1.6 DELIVERY, STORAGE AND HANDLING**

## A. Protection of Equipment:

1. Equipment and material placed on the job site shall remain in the custody of the Contractor until phased acceptance, whether or not the Government has reimbursed the Contractor for the equipment and material. The Contractor is solely responsible for the protection of such equipment and material against any damage.
2. Place damaged equipment in first class, new operating condition; or, replace same as determined and directed by the Project Manager. Such repair or replacement shall be at no additional cost to the Government.
3. Protect interiors of new equipment and piping systems against entry of foreign matter. Clean both inside and outside before painting or placing equipment in operation.
4. Existing equipment and piping being worked on by the Contractor shall be under the custody and responsibility of the Contractor and shall be protected as required for new work.

## B. Cleanliness of Piping and Equipment Systems:

1. Exercise care in storage and handling of equipment and piping material to be incorporated in the work. Remove debris arising from cutting, threading and welding of piping.
2. Piping systems shall be flushed, blown or pigged as necessary to deliver clean systems.
3. Not Used.4. Not Used.
5. Contractor shall be fully responsible for all costs, damage, and delay arising from failure to provide clean systems.

## 1.7 JOB CONDITIONS - WORK IN EXISTING BUILDING

- A. Building Operation: Government employees will be continuously operating and managing all facilities, including temporary facilities, that serve the medical center.
- B. Maintenance of Service: Schedule all work to permit continuous service as required by the medical center.
- C. Steam and Condensate Service Interruptions: Limited steam and condensate service interruptions, as required for interconnections of new and existing systems, will be permitted by the Project Manager during periods when the demands are not critical to the operation of the medical center. These non-critical periods are limited to between 8 pm and 5 am in the appropriate off-season (if applicable). Provide at least one week advance notice to the Project Manager.
- D. Phasing of Work: Comply with all requirements shown on drawings or specified.
- E. Building Working Environment: Maintain the architectural and structural integrity of the building and the working environment at all times. Maintain the interior of building at 18 degrees C (65 degrees F) minimum. Limit the opening of doors, windows or other access openings to brief periods as necessary for rigging purposes. No storm water or ground water leakage permitted. Provide daily clean-up of construction and demolition debris on all floor surfaces and on all equipment being operated by VA.
- F. Acceptance of Work for Government Operation: As new facilities are made available for operation and these facilities are of beneficial use to the Government, inspections will be made and tests will be performed. Based on the inspections, a list of contract deficiencies will be issued to the Contractor. After correction of deficiencies as necessary for beneficial use, the Contracting Officer will process necessary acceptance and the equipment will then be under the control and operation of Government personnel.

## PART 2 - PRODUCTS

### 2.1 FACTORY-ASSEMBLED PRODUCTS

- A. Provide maximum standardization of components to reduce spare part requirements.
- B. Manufacturers of equipment assemblies that include components made by others shall assume complete responsibility for final assembled unit.



1. All components of an assembled unit need not be products of same manufacturer.
  2. Constituent parts that are alike shall be products of a single manufacturer.
  3. Components shall be compatible with each other and with the total assembly for intended service.
  4. Contractor shall guarantee performance of assemblies of components, and shall repair or replace elements of the assemblies as required to deliver specified performance of the complete assembly.
- C. Components of equipment shall bear manufacturer's name and trademark, model number, serial number and performance data on a name plate securely affixed in a conspicuous place, or cast integral with, stamped or otherwise permanently marked upon the components of the equipment.
- D. Major items of equipment, which serve the same function, must be the same make and model. Exceptions will be permitted if performance requirements cannot be met.

## **2.2 COMPATIBILITY OF RELATED EQUIPMENT**

Equipment and materials installed shall be compatible in all respects with other items being furnished and with existing items so that the result will be a complete and fully operational plant that conforms to contract requirements.

## **2.3 BELT DRIVES**

- A. Type: ANSI/RMA standard V-belts with proper motor pulley and driven sheave. Belts shall be constructed of reinforced cord and rubber.
- B. Dimensions, rating and selection standards: ANSI/RMA IP-20 and IP-21.
- C. Minimum Horsepower Rating: Motor horsepower plus recommended ANSI/RMA service factor (not less than 20 percent) in addition to the ANSI/RMA allowances for pitch diameter, center distance, and arc of contact.
- D. Maximum Speed: 25 m/s (5000 feet per minute).
- E. Adjustment Provisions: For alignment and ANSI/RMA standard allowances for installation and take-up.
- F. Drives may utilize a single V-Belt (any cross section) when it is the manufacturer's standard.
- G. Multiple Belts: Matched to ANSI/RMA specified limits by measurement on a belt measuring fixture. Seal matched sets together to prevent mixing or partial loss of sets. Replacement, when necessary, shall be an entire set of new matched belts.
- H. Sheaves and Pulleys:

1. Material: Pressed steel, or close grained cast iron.
2. Bore: Fixed or bushing type for securing to shaft with keys.
3. Balanced: Statically and dynamically.
4. Groove spacing for driving and driven pulleys shall be the same.

I. Drive Types, Based on ARI 435:

1. Provide adjustable-pitch or fixed-pitch drive as follows:
  - a. Fan speeds up to 1800 RPM: 7.5 kW (10 horsepower) and smaller.
  - b. Fan speeds over 1800 RPM: 2.2 kW (3 horsepower) and smaller.
2. Provide fixed-pitch drives for drives larger than those listed above.
3. The final fan speeds required to just meet the system CFM and pressure requirements, without throttling, shall be determined by adjustment of a temporary adjustable-pitch motor sheave or by fan law calculation if a fixed-pitch drive is used initially.

#### 2.4 DRIVE GUARDS

- A. For machinery and equipment, provide guards as shown in AMCA 410 for belts, chains, couplings, pulleys, sheaves, shafts, gears and other moving parts regardless of height above the floor to prevent damage to equipment and injury to personnel. Drive guards may be excluded where motors and drives are inside factory fabricated air handling unit casings.
- B. Pump shafts and couplings shall be fully guarded by a sheet steel guard, covering coupling and shaft but not bearings. Material shall be minimum 16-gage sheet steel; ends shall be braked and drilled and attached to pump base with minimum of four 6 mm (1/4-inch) bolts. Reinforce guard as necessary to prevent side play forcing guard onto couplings.
- C. V-belt and sheave assemblies shall be totally enclosed, firmly mounted, non-resonant. Guard shall be an assembly of minimum 22-gage sheet steel and expanded or perforated metal to permit observation of belts. 25 mm (one-inch) diameter hole shall be provided at each shaft centerline to permit speed measurement.
- D. Materials: Sheet steel, cast iron, expanded metal or wire mesh rigidly secured so as to be removable without disassembling pipe, duct, or electrical connections to equipment.
- E. Access for Speed Measurement: 25 mm (One inch) diameter hole at each shaft center.

## 2.5 LIFTING ATTACHMENTS

- A. Provide equipment with suitable lifting attachments to enable equipment to be lifted in its normal position. Lifting attachments shall withstand any handling conditions that might be encountered, without bending or distortion of shape, such as rapid lowering and braking of load.

## 2.6 ELECTRIC MOTORS

- A. All material and equipment furnished and installation methods shall conform to the requirements of Section 23 05 12, GENERAL MOTOR REQUIREMENTS FOR HVAC AND STEAM GENERATION EQUIPMENT; Section 26 29 11, LOW-VOLTAGE MOTOR STARTERS; and, Section 26 05 19, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES (600 VOLTS AND BELOW). Provide all electrical wiring, conduit, and devices necessary for the proper connection, protection and operation of the systems. Provide special energy efficient premium efficiency type motors as scheduled.

## 2.7 VARIABLE SPEED MOTOR CONTROLLERS

- A. Refer to Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS and Section 26 29 11, LOW-VOLTAGE MOTOR STARTERS for specifications.
- B. The combination of controller and motor shall be provided by the manufacturer of the driven equipment, such as pumps and fans, and shall be rated for 100 percent output performance. Multiple units of the same class of equipment, i.e. air handlers, fans, pumps, shall be product of a single manufacturer.
- C. Motors shall be premium efficiency type and be approved by the motor controller manufacturer. The controller-motor combination shall be guaranteed to provide full motor nameplate horsepower in variable frequency operation. Both driving and driven motor/fan sheaves shall be fixed pitch.
- D. Controller shall not add any current or voltage transients to the input AC power distribution system, DDC controls, sensitive medical equipment, etc., nor shall be affected from other devices on the AC power system.
- E. Controller shall be provided with the following operating features and accessories:
  - 1. Suitable for variable torque load.
  - 2. Provide thermal magnetic circuit breaker or fused switch with external operator and incoming line fuses. Unit shall be rated for minimum 25,000AIC. Provide AC input line reactors (3% impedance)

filters on incoming power line. Provide output line reactors on line between drive and motor for motors over 50 HP or where the distance between the breaker and motor exceeds 50 feet.

## **2.8 EQUIPMENT AND MATERIALS IDENTIFICATION**

- A. Use symbols, nomenclature and equipment numbers specified, shown on the drawings and shown in the maintenance manuals. In addition, provide bar code identification nameplate for all equipment which will allow the equipment identification code to be scanned into the system for maintenance and inventory tracking. Identification for piping is specified in Section 09 91 00, PAINTING.
- B. Interior (Indoor) Equipment: Engraved nameplates, with letters not less than 48 mm (3/16-inch) high of brass with black-filled letters, or rigid black plastic with white letters specified in Section 09 91 00, PAINTING permanently fastened to the equipment. Identify unit components such as coils, filters, fans, etc.
- C. Exterior (Outdoor) Equipment: Brass nameplates, with engraved black filled letters, not less than 48 mm (3/16-inch) high riveted or bolted to the equipment.
- D. Control Items: Label all temperature and humidity sensors, controllers and control dampers. Identify and label each item as they appear on the control diagrams.
- E. Valve Tags and Lists:
  - 1. HVAC and Boiler Plant: Provide for all valves other than for equipment in Section 23 82 00, CONVECTION HEATING AND COOLING UNITS.
  - 2. Valve tags: Engraved black filled numbers and letters not less than 13 mm (1/2-inch) high for number designation, and not less than 6.4 mm(1/4-inch) for service designation on 19 gage 38 mm (1-1/2 inches) round brass disc, attached with brass "S" hook or brass chain.
  - 3. Valve lists: Typed or printed plastic coated card(s), sized 216 mm(8-1/2 inches) by 280 mm (11 inches) showing tag number, valve function and area of control, for each service or system. Punch sheets for a 3-ring notebook.
  - 4. Provide detailed plan for each floor of the building indicating the location and valve number for each valve. Identify location of each valve with a color coded thumb tack in ceiling.

## **2.9 FIRESTOPPING**

Section 07 84 00, FIRESTOPPING specifies an effective barrier against the spread of fire, smoke and gases where penetrations occur for piping

and ductwork. Refer to Section 23 07 11, HVAC, PLUMBING, AND BOILER PLANT INSULATION, for firestop pipe and duct insulation.

## **2.10 GALVANIZED REPAIR COMPOUND**

A. Mil. Spec. DOD-P-21035B, paint form.

## **2.11 HVAC PIPE AND EQUIPMENT SUPPORTS AND RESTRAINTS**

A. Vibration Isolators: Refer to Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT.

B. Supports for Roof Mounted Items:

1. Equipment: Equipment rails shall be galvanized steel, minimum 1.3 mm (18 gauge), with integral baseplate, continuous welded corner seams, factory installed 50 mm by 100 mm (2 by 4) treated wood nailer, 1.3 mm (18 gauge) galvanized steel counter flashing cap with screws, built-in cant strip, (except for gypsum or tectum deck), minimum height 280 mm (11 inches). For surface insulated roof deck, provide raised cant strip to start at the upper surface of the insulation.
2. Pipe/duct pedestals: Provide a galvanized Unistrut channel welded to U-shaped mounting brackets which are secured to side of rail with galvanized lag bolts.

C. Pipe Supports: Comply with MSS SP-58. Type Numbers specified refer to this standard. For selection and application comply with MSS SP-69. Refer to Section 05 50 00, METAL FABRICATIONS, for miscellaneous metal support materials and prime coat painting requirements.

D. Attachment to Concrete Building Construction:

1. Concrete insert: MSS SP-58, Type 18.
2. Self-drilling expansion shields and machine bolt expansion anchors: Permitted in concrete not less than 102 mm (four inches) thick when approved by the Project Manager for each job condition.
3. Power-driven fasteners: Permitted in existing concrete or masonry not less than 102 mm (four inches) thick when approved by the Project Manager for each job condition.

E. Attachment to Steel Building Construction:

1. Welded attachment: MSS SP-58, Type 22.
2. Beam clamps: MSS SP-58, Types 20, 21, 28 or 29. Type 23 C-clamp may be used for individual copper tubing up to 23mm (7/8-inch) outside diameter.

F. Attachment to Metal Pan or Deck: As required for materials specified in Section 05 31 00, STEEL DECKING

- G. Attachment to existing structure: Support from existing floor/roof frame.
- H. Attachment to Wood Construction: Wood screws or lag bolts.
- I. Hanger Rods: Hot-rolled steel, ASTM A36 or A575 for allowable load listed in MSS SP-58. For piping, provide adjustment means for controlling level or slope. Types 13 or 15 turn-buckles shall provide 38 mm (1-1/2 inches) minimum of adjustment and incorporate locknuts. All-thread rods are acceptable.
- J. Hangers Supporting Multiple Pipes (Trapeze Hangers): Galvanized, cold formed, lipped steel channel horizontal member, not less than 41 mm by 41 mm (1-5/8 inches by 1-5/8 inches), 2.7 mm (No. 12 gage), designed to accept special spring held, hardened steel nuts. Not permitted for steam supply and condensate piping.
  - 1. Allowable hanger load: Manufacturers rating less 91kg (200 pounds).
  - 2. Guide individual pipes on the horizontal member of every other trapeze hanger with 6 mm (1/4-inch) U-bolt fabricated from steel rod. Provide Type 40 insulation shield, secured by two 13mm (1/2-inch) galvanized steel bands, or preinsulated calcium silicate shield for insulated piping at each hanger.
- K. Supports for Piping Systems:
  - 1. Select hangers sized to encircle insulation on insulated piping. Refer to Section 23 07 11, HVAC, PLUMBING, AND BOILER PLANT INSULATION for insulation thickness. To protect insulation, provide Type 39 saddles for roller type supports or preinsulated calcium silicate shields. Provide Type 40 insulation shield or preinsulated calcium silicate shield at all other types of supports and hangers including those for preinsulated piping.
  - 2. Piping Systems except High and Medium Pressure Steam (MSS SP-58):
    - a. Standard clevis hanger: Type 1; provide locknut.
    - b. Riser clamps: Type 8.
    - c. Wall brackets: Types 31, 32 or 33.
    - d. Roller supports: Type 41, 43, 44 and 46.
    - e. Saddle support: Type 36, 37 or 38.
    - f. Turnbuckle: Types 13 or 15. Preinsulate.
    - g. U-bolt clamp: Type 24.
    - h. Copper Tube:
      - 1) Hangers, clamps and other support material in contact with tubing shall be painted with copper colored epoxy paint,

plastic coated or taped with non adhesive isolation tape to prevent electrolysis.

- 2) For vertical runs use epoxy painted or plastic coated riser clamps.
  - 3) For supporting tube to strut: Provide epoxy painted pipe straps for copper tube or plastic inserted vibration isolation clamps.
  - 4) Insulated Lines: Provide pre-insulated calcium silicate shields sized for copper tube.
    - i. Supports for plastic or glass piping: As recommended by the pipe manufacturer with black rubber tape extending one inch beyond steel support or clamp.
3. High and Medium Pressure Steam (MSS SP-58):
- a. Provide eye rod or Type 17 eye nut near the upper attachment.
  - b. Piping 50 mm (2 inches) and larger: Type 43 roller hanger. For roller hangers requiring seismic bracing provide a Type 1 clevis hanger with Type 41 roller attached by flat side bars.
  - c. Piping with Vertical Expansion and Contraction:
    - 1) Movement up to 20 mm (3/4-inch): Type 51 or 52 variable spring unit with integral turn buckle and load indicator.
    - 2) Movement more than 20 mm (3/4-inch): Type 54 or 55 constant support unit with integral adjusting nut, turn buckle and travel position indicator.
4. Converter and Expansion Tank Hangers: May be Type 1 sized for the shell diameter. Insulation where required will cover the hangers.
- L. Pre-insulated Calcium Silicate Shields:
1. Provide 360 degree water resistant high density 965 kPa (140 psi) compressive strength calcium silicate shields encased in galvanized metal.
  2. Pre-insulated calcium silicate shields to be installed at the point of support during erection.
  3. Shield thickness shall match the pipe insulation.
  4. The type of shield is selected by the temperature of the pipe, the load it must carry, and the type of support it will be used with.
    - a. Shields for supporting chilled or cold water shall have insulation that extends a minimum of 1 inch past the sheet metal. Provide for an adequate vapor barrier in chilled lines.

- b. The pre-insulated calcium silicate shield shall support the maximum allowable water filled span as indicated in MSS-SP 69. To support the load, the shields may have one or more of the following features: structural inserts 4138 kPa (600 psi) compressive strength, an extra bottom metal shield, or formed structural steel (ASTM A36) wear plates welded to the bottom sheet metal jacket.
- 5. Shields may be used on steel clevis hanger type supports, roller supports or flat surfaces.

## **2.12 PIPE PENETRATIONS**

- A. Install sleeves during construction for other than blocked out floor openings for risers in mechanical bays.
- B. To prevent accidental liquid spills from passing to a lower level, provide the following:
  - 1. For sleeves: Extend sleeve 25 mm (one inch) above finished floor and provide sealant for watertight joint.
  - 2. For blocked out floor openings: Provide 40 mm (1-1/2 inch) angle set in silicone adhesive around opening.
  - 3. For drilled penetrations: Provide 40 mm (1-1/2 inch) angle ring or square set in silicone adhesive around penetration.
- C. Penetrations are not allowed through beams or ribs, but may be installed in concrete beam flanges. Any deviation from these requirements must receive prior approval of Project Manager.
- D. Sheet Metal, Plastic, or Moisture-resistant Fiber Sleeves: Provide for pipe passing through floors, interior walls, and partitions, unless brass or steel pipe sleeves are specifically called for below.
- E. Cast Iron or Zinc Coated Pipe Sleeves: Provide for pipe passing through exterior walls below grade. Make space between sleeve and pipe watertight with a modular or link rubber seal. Seal shall be applied at both ends of sleeve.
- F. Galvanized Steel or an alternate Black Iron Pipe with asphalt coating Sleeves: Provide for pipe passing through concrete beam flanges, except where brass pipe sleeves are called for. Provide sleeve for pipe passing through floor of mechanical rooms, laundry work rooms, and animal rooms above basement. Except in mechanical rooms, connect sleeve with floor plate.
- G. Brass Pipe Sleeves: Provide for pipe passing through quarry tile, terrazzo or ceramic tile floors. Connect sleeve with floor plate.



- H. Sleeves are not required for wall hydrants for fire department connections or in drywall construction.
- I. Sleeve Clearance: Sleeve through floors, walls, partitions, and beam flanges shall be one inch greater in diameter than external diameter of pipe. Sleeve for pipe with insulation shall be large enough to accommodate the insulation. Interior openings shall be caulked tight with fire stopping material and sealant to prevent the spread of fire, smoke, and gases.
- J. Sealant and Adhesives: Shall be as specified in Section 07 92 00, JOINT SEALANTS.

### **2.13 DUCT PENETRATIONS**

- A. Provide curbs for roof mounted piping, ductwork and equipment. Curbs shall be 18 inches high with continuously welded seams, built-in cant strip, interior baffle with acoustic insulation, curb bottom, hinged curb adapter.
- B. Provide firestopping for openings through fire and smoke barriers, maintaining minimum required rating of floor, ceiling or wall assembly. See section 07 84 00, FIRESTOPPING.

### **2.14 SPECIAL TOOLS AND LUBRICANTS**

- A. Furnish, and turn over to the Project Manager, tools not readily available commercially, that are required for disassembly or adjustment of equipment and machinery furnished.
- B. Not Used.
- C. Refrigerant Tools: Provide system charging/Evacuation equipment, gauges, fittings, and tools required for maintenance of furnished equipment.
- D. Tool Containers: Hardwood or metal, permanently identified for intended service and mounted, or located, where directed by the Project Manager.
- E. Lubricants: A minimum of 0.95 L (one quart) of oil, and 0.45 kg (one pound) of grease, of equipment manufacturer's recommended grade and type, in unopened containers and properly identified as to use for each different application.

### **2.15 WALL, FLOOR AND CEILING PLATES**

- A. Material and Type: Chrome plated brass or chrome plated steel, one piece or split type with concealed hinge, with set screw for fastening to pipe, or sleeve. Use plates that fit tight around pipes, cover openings around pipes and cover the entire pipe sleeve projection.

- B. Thickness: Not less than 2.4 mm (3/32-inch) for floor plates. For wall and ceiling plates, not less than 0.64 mm (0.025-inch) for up to 80 mm (3-inch pipe), 0.89 mm (0.035-inch) for larger pipe.
- C. Locations: Use where pipe penetrates floors, walls and ceilings in exposed locations, in finished areas only. Provide a watertight joint in spaces where brass or steel pipe sleeves are specified.

## **2.16 ASBESTOS**

- A. Materials containing asbestos are not permitted.

## **PART 3 - EXECUTION**

### **3.1 ARRANGEMENT AND INSTALLATION OF EQUIPMENT AND PIPING**

- A. Coordinate location of piping, sleeves, inserts, hangers, ductwork and equipment. Locate piping, sleeves, inserts, hangers, ductwork and equipment clear of windows, doors, openings, light outlets, and other services and utilities. Prepare equipment layout drawings to coordinate proper location and personnel access of all facilities. Submit the drawings for review as required by Part 1. Follow manufacturer's published recommendations for installation methods not otherwise specified.
- B. Operating Personnel Access and Observation Provisions: Select and arrange all equipment and systems to provide clear view and easy access, without use of portable ladders, for maintenance and operation of all devices including, but not limited to: all equipment items, valves, filters, strainers, transmitters, sensors, control devices. All gages and indicators shall be clearly visible by personnel standing on the floor or on permanent platforms. Do not reduce or change maintenance and operating space and access provisions that are shown on the drawings.
- C. Equipment and Piping Support: Coordinate structural systems necessary for pipe and equipment support with pipe and equipment locations to permit proper installation.
- D. Location of pipe sleeves, trenches and chases shall be accurately coordinated with equipment and piping locations.
- E. Cutting Holes:
  - 1. Cut holes through concrete and masonry by rotary core drill. Pneumatic hammer, impact electric, and hand or manual hammer type drill will not be allowed, except as permitted by Project Manager where working area space is limited.

2. Locate holes to avoid interference with structural members such as beams or grade beams. Holes shall be laid out in advance and drilling done only after approval by Project Manager. If the Contractor considers it necessary to drill through structural members, this matter shall be referred to Project Manager for approval.
  3. Do not penetrate membrane waterproofing.
- F. Interconnection of Instrumentation or Control Devices: Generally, electrical and pneumatic interconnections are not shown but must be provided.
- G. Minor Piping: Generally, small diameter pipe runs from drips and drains, water cooling, and other service are not shown but must be provided.
- H. Electrical and Pneumatic Interconnection of Controls and Instruments: This generally not shown but must be provided. This includes interconnections of sensors, transmitters, transducers, control devices, control and instrumentation panels, instruments and computer workstations. Comply with NFPA-70.
- I. Protection and Cleaning:
1. Equipment and materials shall be carefully handled, properly stored, and adequately protected to prevent damage before and during installation, in accordance with the manufacturer's recommendations and as approved by the Project Manager. Damaged or defective items in the opinion of the Project Manager, shall be replaced.
  2. Protect all finished parts of equipment, such as shafts and bearings where accessible, from rust prior to operation by means of protective grease coating and wrapping. Close pipe openings with caps or plugs during installation. Tightly cover and protect fixtures and equipment against dirt, water chemical, or mechanical injury. At completion of all work thoroughly clean fixtures, exposed materials and equipment.
- J. Concrete and Grout: Use concrete and shrink compensating grout 25 MPa (3000 psi) minimum, specified in Section 03 30 00, CAST-IN-PLACE CONCRETE.
- K. Install gages, thermometers, valves and other devices with due regard for ease in reading or operating and maintaining said devices. Locate and position thermometers and gages to be easily read by operator or

staff standing on floor or walkway provided. Servicing shall not require dismantling adjacent equipment or pipe work.

L. Install steam piping expansion joints as per manufacturer's recommendations.

M. Work in Existing Building:

1. Perform as specified in Article, OPERATIONS AND STORAGE AREAS, Article, ALTERATIONS, and Article, RESTORATION of the Section 01 00 00, GENERAL REQUIREMENTS for relocation of existing equipment, alterations and restoration of existing building(s).
2. As specified in Section 01 00 00, GENERAL REQUIREMENTS, Article, OPERATIONS AND STORAGE AREAS, make alterations to existing service piping at times that will least interfere with normal operation of the facility.
3. Cut required openings through existing masonry and reinforced concrete using diamond core drills. Use of pneumatic hammer type drills, impact type electric drills, and hand or manual hammer type drills, will be permitted only with approval of the Project Manager. Locate openings that will least effect structural slabs, columns, ribs or beams. Refer to the Project Manager for determination of proper design for openings through structural sections and opening layouts approval, prior to cutting or drilling into structure. After Project Manager's approval, carefully cut opening through construction no larger than absolutely necessary for the required installation.

N. Not Used.

O. Switchgear/Electrical Equipment Drip Protection: Every effort shall be made to eliminate the installation of pipe above electrical and telephone switchgear. If this is not possible, encase pipe in a second pipe with a minimum of joints. Installation of piping, ductwork, leak protection apparatus or other installations foreign to the electrical installation shall be located in the space equal to the width and depth of the equipment and extending from to a height of 1.8 m (6 ft.) above the equipment of to ceiling structure, whichever is lower (NFPA 70).

P. Inaccessible Equipment:

1. Where the Government determines that the Contractor has installed equipment not conveniently accessible for operation and maintenance, equipment shall be removed and reinstalled or remedial action performed as directed at no additional cost to the Government.

2. The term "conveniently accessible" is defined as capable of being reached without the use of ladders, or without climbing or crawling under or over obstacles such as motors, fans, pumps, belt guards, transformers, high voltage lines, piping, and ductwork.

### **3.2 TEMPORARY PIPING AND EQUIPMENT**

- A. Continuity of operation of existing facilities will generally require temporary installation or relocation of equipment and piping.
- B. The Contractor shall provide all required facilities in accordance with the requirements of phased construction and maintenance of service. All piping and equipment shall be properly supported, sloped to drain, operate without excessive stress, and shall be insulated where injury can occur to personnel by contact with operating facilities. The requirements of Paragraph 3.1 apply.
- C. Temporary facilities and piping shall be completely removed and any openings in structures sealed. Provide necessary blind flanges and caps to seal open piping remaining in service.

### **3.3 RIGGING**

- A. Design is based on application of available equipment. Openings in building structures are planned to accommodate design scheme.
- B. Alternative methods of equipment delivery may be offered by Contractor and will be considered by Government under specified restrictions of phasing and maintenance of service as well as structural integrity of the building.
- C. Close all openings in the building when not required for rigging operations to maintain proper environment in the facility for Government operation and maintenance of service.
- D. Contractor shall provide all facilities required to deliver specified equipment and place on foundations. Attachments to structures for rigging purposes and support of equipment on structures shall be Contractor's full responsibility. Upon request, the Government will check structure adequacy and advise Contractor of recommended restrictions.
- E. Contractor shall check all clearances, weight limitations and shall offer a rigging plan designed by a Registered Professional Engineer. All modifications to structures, including reinforcement thereof, shall be at Contractor's cost, time and responsibility.
- F. Rigging plan and methods shall be referred to Project Manager for evaluation prior to actual work.

G. Restore building to original condition upon completion of rigging work.

### **3.4 PIPE AND EQUIPMENT SUPPORTS**

- A. Where hanger spacing does not correspond with joist or rib spacing, use structural steel channels secured directly to joist and rib structure that will correspond to the required hanger spacing, and then suspend the equipment and piping from the channels. Drill or burn holes in structural steel only with the prior approval of the Project Manager.
- B. Use of chain, wire or strap hangers; wood for blocking, stays and bracing; or, hangers suspended from piping above will not be permitted. Replace or thoroughly clean rusty products and paint with zinc primer.
- C. Use hanger rods that are straight and vertical. Turnbuckles for vertical adjustments may be omitted where limited space prevents use. Provide a minimum of 15 mm (1/2-inch) clearance between pipe or piping covering and adjacent work.
- D. HVAC Horizontal Pipe Support Spacing: Refer to MSS SP-69. Provide additional supports at valves, strainers, in-line pumps and other heavy components. Provide a support within one foot of each elbow.
- E. HVAC Vertical Pipe Supports:
  - 1. Up to 150 mm (6-inch pipe), 9 m (30 feet) long, bolt riser clamps to the pipe below couplings, or welded to the pipe and rests supports securely on the building structure.
  - 2. Vertical pipe larger than the foregoing, support on base elbows or tees, or substantial pipe legs extending to the building structure.
- F. Overhead Supports:
  - 1. The basic structural system of the building is designed to sustain the loads imposed by equipment and piping to be supported overhead.
  - 2. Provide steel structural members, in addition to those shown, of adequate capability to support the imposed loads, located in accordance with the final approved layout of equipment and piping.
  - 3. Tubing and capillary systems shall be supported in channel troughs.
- G. Floor Supports:
  - 1. Provide concrete bases, concrete anchor blocks and pedestals, and structural steel systems for support of equipment and piping. Anchor and dowel concrete bases and structural systems to resist forces under operating and seismic conditions (if applicable) without excessive displacement or structural failure.
  - 2. Do not locate or install bases and supports until equipment mounted thereon has been approved. Size bases to match equipment mounted

thereon plus 50 mm (2 inch) excess on all edges. Boiler foundations shall have horizontal dimensions that exceed boiler base frame dimensions by at least 150 mm (6 inches) on all sides. Refer to structural drawings. Bases shall be neatly finished and smoothed, shall have chamfered edges at the top, and shall be suitable for painting.

3. All equipment shall be shimmed, leveled, firmly anchored, and grouted with epoxy grout. Anchor bolts shall be placed in sleeves, anchored to the bases. Fill the annular space between sleeves and bolts with a granular material to permit alignment and realignment.

### **3.5 MECHANICAL DEMOLITION**

- A. Rigging access, other than indicated on the drawings, shall be provided by the Contractor after approval for structural integrity by the Project Manager. Such access shall be provided without additional cost or time to the Government. Where work is in an operating plant, provide approved protection from dust and debris at all times for the safety of plant personnel and maintenance of plant operation and environment of the plant.
- B. In an operating facility, maintain the operation, cleanliness and safety. Government personnel will be carrying on their normal duties of operating, cleaning and maintaining equipment and plant operation. Confine the work to the immediate area concerned; maintain cleanliness and wet down demolished materials to eliminate dust. Do not permit debris to accumulate in the area to the detriment of plant operation. Perform all flame cutting to maintain the fire safety integrity of this plant. Adequate fire extinguishing facilities shall be available at all times. Perform all work in accordance with recognized fire protection standards. Inspection will be made by personnel of the VA Medical Center, and Contractor shall follow all directives of the RE or COTR with regard to rigging, safety, fire safety, and maintenance of operations.
- C. Completely remove all piping, wiring, conduit, and other devices associated with the equipment not to be re-used in the new work. This includes all pipe, valves, fittings, insulation, and all hangers including the top connection and any fastenings to building structural systems. Seal all openings, after removal of equipment, pipes, ducts, and other penetrations in roof, walls, floors, in an approved manner and in accordance with plans and specifications where specifically

covered. Structural integrity of the building system shall be maintained. Reference shall also be made to the drawings and specifications of the other disciplines in the project for additional facilities to be demolished or handled.

- D. All valves including gate, globe, ball, butterfly and check, all pressure gages and thermometers with wells shall remain Government property and shall be removed and delivered to Project Manager and stored as directed. The Contractor shall remove all other material and equipment, devices and demolition debris under these plans and specifications. Such material shall be removed from Government property expeditiously and shall not be allowed to accumulate.
- E. Asbestos Insulation Removal: Conform to Section 02 82 11, TRADITIONAL ASBESTOS ABATEMENT.

### **3.6 CLEANING AND PAINTING**

- A. Prior to final inspection and acceptance of the plant and facilities for beneficial use by the Government, the plant facilities, equipment and systems shall be thoroughly cleaned and painted. Refer to Section 09 91 00, PAINTING.
- B. In addition, the following special conditions apply:
  - 1. Cleaning shall be thorough. Use solvents, cleaning materials and methods recommended by the manufacturers for the specific tasks. Remove all rust prior to painting and from surfaces to remain unpainted. Repair scratches, scuffs, and abrasions prior to applying prime and finish coats.
  - 2. Material And Equipment Not To Be Painted Includes:
    - a. Motors, controllers, control switches, and safety switches.
    - b. Control and interlock devices.
    - c. Regulators.
    - d. Pressure reducing valves.
    - e. Control valves and thermostatic elements.
    - f. Lubrication devices and grease fittings.
    - g. Copper, brass, aluminum, stainless steel and bronze surfaces.
    - h. Valve stems and rotating shafts.
    - i. Pressure gauges and thermometers.
    - j. Glass.
    - k. Name plates.



3. Control and instrument panels shall be cleaned, damaged surfaces repaired, and shall be touched-up with matching paint obtained from panel manufacturer.
4. Pumps, motors, steel and cast iron bases, and coupling guards shall be cleaned, and shall be touched-up with the same color as utilized by the pump manufacturer
5. Temporary Facilities: Apply paint to surfaces that do not have existing finish coats.
6. Paint shall withstand the following temperatures without peeling or discoloration:
  - a. Condensate and feedwater -- 38 degrees C (100 degrees F) on insulation jacket surface and 120 degrees C (250 degrees F) on metal pipe surface.
  - b. Steam -- 52 degrees C (125 degrees F) on insulation jacket surface and 190 degrees C (375 degrees F) on metal pipe surface.
7. Final result shall be smooth, even-colored, even-textured factory finish on all items. Completely repaint the entire piece of equipment if necessary to achieve this.

### **3.7 IDENTIFICATION SIGNS**

- A. Provide laminated plastic signs, with engraved lettering not less than 5 mm (3/16-inch) high, designating functions, for all equipment, switches, motor controllers, relays, meters, control devices, including automatic control valves. Nomenclature and identification symbols shall correspond to that used in maintenance manual, and in diagrams specified elsewhere. Attach by chain, adhesive, or screws.
- B. Factory Built Equipment: Metal plate, securely attached, with name and address of manufacturer, serial number, model number, size, performance.
- C. Pipe Identification: Refer to Section 09 91 00, PAINTING.

### **3.8 MOTOR AND DRIVE ALIGNMENT**

- A. Belt Drive: Set driving and driven shafts parallel and align so that the corresponding grooves are in the same plane.
- B. Direct-connect Drive: Securely mount motor in accurate alignment so that shafts are free from both angular and parallel misalignment when both motor and driven machine are operating at normal temperatures.

### **3.9 LUBRICATION**

- A. Lubricate all devices requiring lubrication prior to initial operation. Field-check all devices for proper lubrication.

- B. Equip all devices with required lubrication fittings or devices. Provide a minimum of one liter (one quart) of oil and 0.5 kg (one pound) of grease of manufacturer's recommended grade and type for each different application; also provide 12 grease sticks for lubricated plug valves. Deliver all materials to Project Manager in unopened containers that are properly identified as to application.
- C. Provide a separate grease gun with attachments for applicable fittings for each type of grease applied.
- D. All lubrication points shall be accessible without disassembling equipment, except to remove access plates.

### **3.10 COMMISSIONING**

- A. Provide commissioning documentation in accordance with the requirements of Section 23 08 00 - COMMISSIONING OF HVAC SYSTEMS for all inspection, start up, and contractor testing required above and required by the System Readiness Checklist provided by the Commissioning Agent.
- B. Components provided under this section of the specifications will be tested as part of a larger system. Refer to Section 23 08 00 - COMMISSIONING OF HVAC SYSTEMS and related sections for contractor responsibilities for system commissioning.

### **3.11 STARTUP AND TEMPORARY OPERATION**

Start up equipment as described in equipment specifications. Verify that vibration is within specified tolerance prior to extended operation. Temporary use of equipment is specified in Section 01 00 00, GENERAL REQUIREMENTS, Article, TEMPORARY USE OF MECHANICAL AND ELECTRICAL EQUIPMENT.

### **3.12 OPERATING AND PERFORMANCE TESTS**

- A. Prior to the final inspection, perform required tests as specified in Section 01 00 00, GENERAL REQUIREMENTS and submit the test reports and records to the Project Manager.
- B. Should evidence of malfunction in any tested system, or piece of equipment or component part thereof, occur during or as a result of tests, make proper corrections, repairs or replacements, and repeat tests at no additional cost to the Government.
- C. When completion of certain work or system occurs at a time when final control settings and adjustments cannot be properly made to make performance tests, then make performance tests for heating systems and for cooling systems respectively during first actual seasonal use of respective systems following completion of work.

**3.13 INSTRUCTIONS TO VA PERSONNEL**

- A. Provide in accordance with Article, INSTRUCTIONS, of Section 01 00 00,  
GENERAL REQUIREMENTS.

- - - E N D - - -



**SECTION 23 05 12**  
**GENERAL MOTOR REQUIREMENTS FOR HVAC AND STEAM GENERATION EQUIPMENT**

**PART 1 - GENERAL**

**1.1 DESCRIPTION:**

This section specifies the furnishing, installation and connection of motors for HVAC and steam generation equipment.

**1.2 RELATED WORK:**

- A. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA and SAMPLES.
- B. Not Used.
- C. Section 23 05 11, COMMON WORK RESULTS FOR HVAC.
- D. Not Used.
- E. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
- G. Section 26 24 19, MOTOR-CONTROL CENTERS.
- F. Section 26 29 11, LOW-VOLTAGE MOTOR STARTERS.

**1.3 SUBMITTALS:**

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA and SAMPLES, and Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
- B. Shop Drawings:
  - 1. Provide documentation to demonstrate compliance with drawings and specifications.
  - 2. Include electrical ratings, efficiency, bearing data, power factor, frame size, dimensions, mounting details, materials, horsepower, voltage, phase, speed (RPM), enclosure, starting characteristics, torque characteristics, code letter, full load and locked rotor current, service factor, and lubrication method.
- C. Manuals:
  - 1. Submit simultaneously with the shop drawings, companion copies of complete installation, maintenance and operating manuals, including technical data sheets and application data.
- D. Certification: Two weeks prior to final inspection, unless otherwise noted, submit four copies of the following certification to the Project Manager:
  - 1. Certification that the motors have been applied, installed, adjusted, lubricated, and tested according to manufacturer published recommendations.

**1.4 APPLICABLE PUBLICATIONS:**

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. National Electrical Manufacturers Association (NEMA):
  - MG 1-2006 Rev. 1 2009 ..Motors and Generators
  - MG 2-2001 Rev. 1 2007...Safety Standard for Construction and Guide for Selection, Installation and Use of Electric Motors and Generators
- C. National Fire Protection Association (NFPA):
  - 70-2008.....National Electrical Code (NEC)
- D. Institute of Electrical and Electronics Engineers (IEEE):
  - 112-04.....Standard Test Procedure for Polyphase Induction Motors and Generators
- E. American Society of Heating, Refrigerating and Air-Conditioning Engineers (ASHRAE):
  - 90.1-2007.....Energy Standard for Buildings Except Low-Rise Residential Buildings

**PART 2 - PRODUCTS****2.1 MOTORS:**

- A. For alternating current, fractional and integral horsepower motors, NEMA Publications MG 1 and MG 2 shall apply.
- B. All material and equipment furnished and installation methods shall conform to the requirements of Section 26 29 11, LOW-VOLTAGE MOTOR STARTERS; and Section 26 05 21, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES (600 VOLTS AND BELOW). Provide all electrical wiring, conduit, and devices necessary for the proper connection, protection and operation of the systems. Provide premium efficiency type motors as scheduled. Unless otherwise specified for a particular application, use electric motors with the following requirements.
- C. Single-phase Motors: Motors for centrifugal fans and pumps may be split phase or permanent split capacitor (PSC) type. Provide capacitor-start type for hard starting applications.
- D. Poly-phase Motors: NEMA Design B, Squirrel cage, induction type.
  - 1. Two Speed Motors: Each two-speed motor shall have two separate windings. Provide a time- delay (20 seconds minimum) relay for switching from high to low speed.
- E. Voltage ratings shall be as follows:

1. Single phase:
    - a. Motors connected to 120-volt systems: 115 volts.
    - b. Motors connected to 208-volt systems: 200 volts.
    - c. Motors connected to 240 volt or 480 volt systems: 230/460 volts, dual connection.
  2. Three phase:
    - a. Motors connected to 208-volt systems: 200 volts.
    - b. Motors, less than 74.6 kW (100 HP), connected to 240 volt or 480 volt systems: 208-230/460 volts, dual connection.
    - c. Motors, 74.6 kW (100 HP) or larger, connected to 240-volt systems: 230 volts.
    - d. Motors, 74.6 kW (100 HP) or larger, connected to 480-volt systems: 460 volts.
    - e. Motors connected to high voltage systems (Over 600V): Shall conform to NEMA Standards for connection to the nominal system voltage shown on the drawings.
- F. Number of phases shall be as follows:
1. Motors, less than 373 W (1/2 HP): Single phase.
  2. Motors, 373 W (1/2 HP) and larger: 3 phase.
  3. Exceptions:
    - a. Hermetically sealed motors.
    - b. Motors for equipment assemblies, less than 746 W (one HP), may be single phase provided the manufacturer of the proposed assemblies cannot supply the assemblies with three phase motors.
- G. Motors shall be designed for operating the connected loads continuously in a 40°C (104°F) environment, where the motors are installed, without exceeding the NEMA standard temperature rises for the motor insulation. If the motors exceed 40°C (104°F), the motors shall be rated for the actual ambient temperatures.
- H. Motor designs, as indicated by the NEMA code letters, shall be coordinated with the connected loads to assure adequate starting and running torque.
- I. Motor Enclosures:
1. Shall be the NEMA types as specified and/or shown on the drawings.
  2. Where the types of motor enclosures are not shown on the drawings, they shall be the NEMA types, which are most suitable for the environmental conditions where the motors are being installed.
- Enclosure requirements for certain conditions are as follows:

- a. Motors located outdoors, indoors in wet or high humidity locations, or in unfiltered airstreams shall be totally enclosed type.
- b. Where motors are located in an NEC 511 classified area, provide TEFC explosion proof motor enclosures.
- c. Where motors are located in a corrosive environment, provide TEFC enclosures with corrosion resistant finish.
- 3. Enclosures shall be primed and finish coated at the factory with manufacturer's prime coat and standard finish.

J. Special Requirements:

- 1. Where motor power requirements of equipment furnished deviate from power shown on plans, provide electrical service designed under the requirements of NFPA 70 without additional time or cost to the Government.
- 2. Assemblies of motors, starters, controls and interlocks on factory assembled and wired devices shall be in accordance with the requirements of this specification.
- 3. Wire and cable materials specified in the electrical division of the specifications shall be modified as follows:
  - a. Wiring material located where temperatures can exceed 71 degrees C (160 degrees F) shall be stranded copper with Teflon FEP insulation with jacket. This includes wiring on the boilers.
  - b. Other wiring at boilers and to control panels shall be NFPA 70 designation THWN.
  - c. Provide shielded conductors or wiring in separate conduits for all instrumentation and control systems where recommended by manufacturer of equipment.
- 4. Select motor sizes so that the motors do not operate into the service factor at maximum required loads on the driven equipment. Motors on pumps shall be sized for non-overloading at all points on the pump performance curves.
- 5. Motors utilized with variable frequency drives shall be rated "inverter-duty" per NEMA Standard, MG1, Part 31.4.4.2. Provide motor shaft grounding apparatus that will protect bearings from damage from stray currents.

- K. Additional requirements for specific motors, as indicated in the other sections listed in Article 1.2, shall also apply.



L. Energy-Efficient Motors (Motor Efficiencies): All permanently wired polyphase motors of 746 Watts (1 HP) or more shall meet the minimum full-load efficiencies as indicated in the following table. Motors of 746 Watts or more with open, drip-proof or totally enclosed fan-cooled enclosures shall be NEMA premium efficiency type, unless otherwise indicated. Motors provided as an integral part of motor driven equipment are excluded from this requirement if a minimum seasonal or overall efficiency requirement is indicated for that equipment by the provisions of another section. Motors not specified as "premium efficiency" shall comply with the Energy Policy Act of 2005 (EPACT).

Minimum Premium Efficiencies Open Drip-Proof				Minimum Premium Efficiencies Totally Enclosed Fan-Cooled			
Rating kW (HP)	1200 RPM	1800 RPM	3600 RPM	Rating kW (HP)	1200 RPM	1800 RPM	3600 RPM
0.746 (1)	82.5%	85.5%	77.0%	0.746 (1)	82.5%	85.5%	77.0%
1.12 (1.5)	86.5%	86.5%	84.0%	1.12 (1.5)	87.5%	86.5%	84.0%
1.49 (2)	87.5%	86.5%	85.5%	1.49 (2)	88.5%	86.5%	85.5%
2.24 (3)	88.5%	89.5%	85.5%	2.24 (3)	89.5%	89.5%	86.5%
3.73 (5)	89.5%	89.5%	86.5%	3.73 (5)	89.5%	89.5%	88.5%
5.60 (7.5)	90.2%	91.0%	88.5%	5.60 (7.5)	91.0%	91.7%	89.5%
7.46 (10)	91.7%	91.7%	89.5%	7.46 (10)	91.0%	91.7%	90.2%
11.2 (15)	91.7%	93.0%	90.2%	11.2 (15)	91.7%	92.4%	91.0%
14.9 (20)	92.4%	93.0%	91.0%	14.9 (20)	91.7%	93.0%	91.0%
18.7 (25)	93.0%	93.6%	91.7%	18.7 (25)	93.0%	93.6%	91.7%
22.4 (30)	93.6%	94.1%	91.7%	22.4 (30)	93.0%	93.6%	91.7%
29.8 (40)	94.1%	94.1%	92.4%	29.8 (40)	94.1%	94.1%	92.4%
37.3 (50)	94.1%	94.5%	93.0%	37.3 (50)	94.1%	94.5%	93.0%
44.8 (60)	94.5%	95.0%	93.6%	44.8 (60)	94.5%	95.0%	93.6%
56.9 (75)	94.5%	95.0%	93.6%	56.9 (75)	94.5%	95.4%	93.6%
74.6 (100)	95.0%	95.4%	93.6%	74.6 (100)	95.0%	95.4%	94.1%
93.3 (125)	95.0%	95.4%	94.1%	93.3 (125)	95.0%	95.4%	95.0%
112 (150)	95.4%	95.8%	94.1%	112 (150)	95.8%	95.8%	95.0%
149.2 (200)	95.4%	95.8%	95.0%	149.2 (200)	95.8%	96.2%	95.4%

M. Minimum Power Factor at Full Load and Rated Voltage: 90 percent at 1200 RPM, 1800 RPM and 3600 RPM.

**PART 3 - EXECUTION****3.1 INSTALLATION:**

Install motors in accordance with manufacturer's recommendations, the NEC, NEMA, as shown on the drawings and/or as required by other sections of these specifications.

**3.2 FIELD TESTS**

- A. Perform an electric insulation resistance Test using a megohmmeter on all motors after installation, before start-up. All shall test free from grounds.
- B. Perform Load test in accordance with ANSI/IEEE 112, Test Method B, to determine freedom from electrical or mechanical defects and compliance with performance data.
- C. Insulation Resistance: Not less than one-half meg-ohm between stator conductors and frame, to be determined at the time of final inspection.
- D. All test data shall be compiled into a report form for each motor and provided to the contracting officer or their representative.

**3.3 STARTUP AND TESTING NOT USED.****3.4 COMMISSIONING NOT USED.****3.5 DEMONSTRATION AND TRAINING**

- A. Provide services of manufacturer's technical representative for four hours to instruct VA personnel in operation and maintenance of units.

- - - E N D - - -

**SECTION 23 05 41**  
**NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

Noise criteria, vibration tolerance and vibration isolation for HVAC and plumbing work.

**1.2 RELATED WORK**

- A. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA and SAMPLES.
- B. Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.
- C. Section 23 31 00, HVAC DUCTS and CASINGS.

**1.3 QUALITY ASSURANCE**

- A. Refer to article, QUALITY ASSURANCE in specification Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.
- B. Noise Criteria:
  - 1. Noise levels in all 8 octave bands due to equipment and duct systems shall not exceed following NC levels:

TYPE OF ROOM	NC LEVEL
Bathrooms and Toilet Rooms	40
Chapels	35
Conference Rooms	35
Corridors (Nurse Stations)	40
Corridors(Public)	40
Examination Rooms	35
Lobbies, Waiting Areas	40
Locker Rooms	45
Offices, Large Open	40
Offices, Small Private	35
Patient Rooms	35

- 2. For equipment which has no sound power ratings scheduled on the plans, the contractor shall select equipment such that the foregoing noise criteria, local ordinance noise levels, and OSHA requirements are not exceeded. Selection procedure shall be in accordance with ASHRAE Fundamentals Handbook, Chapter 7, Sound and Vibration.
- 3. An allowance, not to exceed 5db, may be added to the measured value to compensate for the variation of the room attenuating effect

between room test condition prior to occupancy and design condition after occupancy which may include the addition of sound absorbing material, such as, furniture. This allowance may not be taken after occupancy. The room attenuating effect is defined as the difference between sound power level emitted to room and sound pressure level in room.

4. In absence of specified measurement requirements, measure equipment noise levels three feet from equipment and at an elevation of maximum noise generation.

C. Not Used.

- D. Allowable Vibration Tolerances for Rotating, Non-reciprocating Equipment: Not to exceed a self-excited vibration maximum velocity of 5 mm per second (0.20 inch per second) RMS, filter in, when measured with a vibration meter on bearing caps of machine in vertical, horizontal and axial directions or measured at equipment mounting feet if bearings are concealed. Measurements for internally isolated fans and motors may be made at the mounting feet.

#### **1.4 SUBMITTALS**

- A. Submit in accordance with specification Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.

B. Manufacturer's Literature and Data:

1. Vibration isolators:

- a. Floor mountings
- b. Hangers
- c. Snubbers
- d. Thrust restraints

2. Bases.

3. Not Used.

4. Acoustical enclosures.

- C. Isolator manufacturer shall furnish with submittal load calculations for selection of isolators, including supplemental bases, based on lowest operating speed of equipment supported.

#### **1.5 APPLICABLE PUBLICATIONS**

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.

- B. American Society of Heating, Refrigerating and Air-Conditioning Engineers, Inc. (ASHRAE):

- 2009 .....Fundamentals Handbook, Chapter 7, Sound and Vibration
- C. American Society for Testing and Materials (ASTM):
- A123/A123M-09.....Standard Specification for Zinc (Hot-Dip Galvanized) Coatings on Iron and Steel Products
- A307-07b.....Standard Specification for Carbon Steel Bolts and Studs, 60,000 PSI Tensile Strength
- D2240-05(2010).....Standard Test Method for Rubber Property - Durometer Hardness
- D. Manufacturers Standardization (MSS):
- SP-58-2009.....Pipe Hangers and Supports-Materials, Design and Manufacture
- E. Occupational Safety and Health Administration (OSHA):
- 29 CFR 1910.95.....Occupational Noise Exposure
- F. American Society of Civil Engineers (ASCE):
- ASCE 7-10 .....Minimum Design Loads for Buildings and Other Structures.
- G. American National Standards Institute / Sheet Metal and Air Conditioning Contractor's National Association (ANSI/SMACNA):
- 001-2008.....Seismic Restraint Manual: Guidelines for Mechanical Systems, 3rd Edition.
- H. International Code Council (ICC):
- 2009 IBC.....International Building Code.
- I. Department of Veterans Affairs (VA):
- H-18-8 2010.....Seismic Design Requirements.

## **PART 2 - PRODUCTS**

### **2.1 GENERAL REQUIREMENTS**

- A. Type of isolator, base, and minimum static deflection shall be as required for each specific equipment application as recommended by isolator or equipment manufacturer but subject to minimum requirements indicated herein and in the schedule on the drawings.
- B. Elastometric Isolators shall comply with ASTM D2240 and be oil resistant neoprene with a maximum stiffness of 60 durometer and have a straight-line deflection curve.
- C. Exposure to weather: Isolator housings to be either hot dipped galvanized or powder coated to ASTM B117 salt spray testing standards. Springs to be powder coated or electro galvanized. All hardware to be electro galvanized. In addition provide limit stops to resist wind

velocity. Velocity pressure established by wind shall be calculated in accordance with section 1609 of the International Building Code. A minimum wind velocity of 75 mph shall be employed.

- D. Uniform Loading: Select and locate isolators to produce uniform loading and deflection even when equipment weight is not evenly distributed.
- E. Color code isolators by type and size for easy identification of capacity.

## **2.2 SEISMIC RESTRAINT REQUIREMENTS FOR EQUIPMENTS NOT USED.**

### **2.3 VIBRATION ISOLATORS**

#### **A. Floor Mountings:**

1. Double Deflection Neoprene (Type N): Shall include neoprene covered steel support plated (top and bottom), friction pads, and necessary bolt holes.
2. Spring Isolators (Type S): Shall be free-standing, laterally stable and include acoustical friction pads and leveling bolts. Isolators shall have a minimum ratio of spring diameter-to-operating spring height of 1.0 and an additional travel to solid equal to 50 percent of rated deflection.
3. Not Used.
4. Spring Isolators with Vertical Limit Stops (Type SP): Similar to spring isolators noted above, except include a vertical limit stop to limit upward travel if weight is removed and also to reduce movement and spring extension due to wind loads. Provide clearance around restraining bolts to prevent mechanical short circuiting.

5. Pads (Type D), Washers (Type W), and Bushings (Type L): Pads shall be natural rubber or neoprene waffle, neoprene and steel waffle, or reinforced duck and neoprene. Washers and bushings shall be reinforced duck and neoprene. Washers and bushings shall be reinforced duck and neoprene. Size pads for a maximum load of 345 kPa (50 pounds per square inch).

#### **B. Hangers: Shall be combination neoprene and springs unless otherwise noted and shall allow for expansion of pipe.**

1. Combination Neoprene and Spring (Type H): Vibration hanger shall contain a spring and double deflection neoprene element in series. Spring shall have a diameter not less than 0.8 of compressed operating spring height. Spring shall have a minimum additional travel of 50 percent between design height and solid height. Spring shall

- permit a 15 degree angular misalignment without rubbing on hanger box.
2. Spring Position Hanger (Type HP): Similar to combination neoprene and spring hanger except hanger shall hold piping at a fixed elevation during installation and include a secondary adjustment feature to transfer load to spring while maintaining same position.
  3. Neoprene (Type HN): Vibration hanger shall contain a double deflection type neoprene isolation element. Hanger rod shall be separated from contact with hanger bracket by a neoprene grommet.
  4. Spring (Type HS): Vibration hanger shall contain a coiled steel spring in series with a neoprene grommet. Spring shall have a diameter not less than 0.8 of compressed operating spring height. Spring shall have a minimum additional travel of 50 percent between design height and solid height. Spring shall permit a 15 degree angular misalignment without rubbing on hanger box.
  5. Hanger supports for piping 50 mm (2 inches) and larger shall have a pointer and scale deflection indicator.
  6. Hangers used in seismic applications shall be provided with a neoprene and steel rebound washer installed  $\frac{1}{4}$ ' clear of bottom of hanger housing in operation to prevent spring from excessive upward travel
- C. Snubbers: Each spring mounted base shall have a minimum of four all-directional or eight two directional (two per side) seismic snubbers that are double acting. Elastomeric materials shall be shock absorbent neoprene bridge quality bearing pads, maximum 60 durometer, replaceable and have a minimum thickness of 6 mm (1/4 inch). Air gap between hard and resilient material shall be not less than 3 mm (1/8 inch) nor more than 6 mm (1/4 inch). Restraints shall be capable of withstanding design load without permanent deformation.
- D. Thrust Restraints (Type THR): Restraints shall provide a spring element contained in a steel frame with neoprene pads at each end attachment. Restraints shall have factory preset thrust and be field adjustable to allow a maximum movement of 6 mm (1/4 inch) when the fan starts and stops. Restraint assemblies shall include rods, angle brackets and other hardware for field installation.

#### **2.4 BASES**

- A. Rails (Type R): Design rails with isolator brackets to reduce mounting height of equipment and cradle machines having legs or bases that do

not require a complete supplementary base. To assure adequate stiffness, height of members shall be a minimum of 1/12 of longest base dimension but not less than 100 mm (4 inches). Where rails are used with neoprene mounts for small fans or close coupled pumps, extend rails to compensate overhang of housing.

- B. Integral Structural Steel Base (Type B): Design base with isolator brackets to reduce mounting height of equipment which require a complete supplementary rigid base. To assure adequate stiffness, height of members shall be a minimum of 1/12 of longest base dimension, but not less than 100 mm (four inches).
- C. Inertia Base (Type I): Base shall be a reinforced concrete inertia base. Pour concrete into a welded steel channel frame, incorporating prelocated equipment anchor bolts and pipe sleeves. Level the concrete to provide a smooth uniform bearing surface for equipment mounting. Provide grout under uneven supports. Channel depth shall be a minimum of 1/12 of longest dimension of base but not less than 150 mm (six inches). Form shall include 13-mm (1/2-inch) reinforcing bars welded in place on minimum of 203 mm (eight inch) centers running both ways in a layer 40 mm (1-1/2 inches) above bottom. Use height saving brackets in all mounting locations. Weight of inertia base shall be equal to or greater than weight of equipment supported to provide a maximum peak-to-peak displacement of 2 mm (1/16 inch).
- D. Curb Mounted Isolation Base (Type CB): Fabricate from aluminum to fit on top of standard curb with overlap to allow water run-off and have wind and water seals which shall not interfere with spring action. Provide resilient snubbers with 6 mm (1/4 inch) clearance for wind resistance. Top and bottom bearing surfaces shall have sponge type weather seals. Integralspring isolators shall comply with Spring Isolator (Type S) requirements.

## **2.5 SOUND ATTENUATING UNITS**

Refer to specification Section 23 31 00, HVAC DUCTS and CASINGS.

## **PART 3 - EXECUTION**

### **3.1 INSTALLATION**

#### **A. Vibration Isolation:**

- 1. No metal-to-metal contact will be permitted between fixed and floating parts.
- 2. Connections to Equipment: Allow for deflections equal to or greater than equipment deflections. Electrical, drain, piping connections,



- and other items made to rotating or reciprocating equipment (pumps, compressors, etc.) which rests on vibration isolators, shall be isolated from building structure for first three hangers or supports with a deflection equal to that used on the corresponding equipment.
3. Common Foundation: Mount each electric motor on same foundation as driven machine. Hold driving motor and driven machine in positive rigid alignment with provision for adjusting motor alignment and belt tension. Bases shall be level throughout length and width. Provide shims to facilitate pipe connections, leveling, and bolting.
  4. Provide heat shields where elastomers are subject to temperatures over 38 degrees C (100 degrees F).
  5. Extend bases for pipe elbow supports at discharge and suction connections at pumps. Pipe elbow supports shall not short circuit pump vibration to structure.
  6. Non-rotating equipment such as heat exchangers and convertors shall be mounted on isolation units having the same static deflection as the isolation hangers or support of the pipe connected to the equipment.
- B. Inspection and Adjustments: Check for vibration and noise transmission through connections, piping, ductwork, foundations, and walls. Adjust, repair, or replace isolators as required to reduce vibration and noise transmissions to specified levels.

### 3.2 ADJUSTING

- A. Adjust vibration isolators after piping systems are filled and equipment is at operating weight.
- B. Adjust limit stops on restrained spring isolators to mount equipment at normal operating height. After equipment installation is complete, adjust limit stops so they are out of contact during normal operation.
- C. Attach thrust limits at centerline of thrust and adjust to a maximum of 1/4inch (6-mm) movement during start and stop.
- D. Adjust active height of spring isolators.
- E. Adjust snubbers according to manufacturer's recommendations.

- - - E N D - - -

**SELECTION GUIDE FOR VIBRATION ISOLATORS**

EQUIPMENT	ON GRADE			20FT FLOOR SPAN			30FT FLOOR SPAN			40FT FLOOR SPAN			50FT FLOOR SPAN		
	BASE TYPE	ISOL TYPE	MIN DEFL	BASE TYPE	ISOL TYPE	MIN DEFL	BASE TYPE	ISOL TYPE	MIN DEFL	BASE TYPE	ISOL TYPE	MIN DEFL	BASE TYPE	ISOL TYPE	MIN DEFL
<b>REFRIGERATION MACHINES</b>															
ABSORPTION	---	D	0.3	---	SP	0.8	---	SP	1.5	---	SP	1.5	---	SP	2.0
PACKAGED HERMETIC	---	D	0.3	---	SP	0.8	---	SP	1.5	---	SP	1.5	R	SP	2.5
OPEN CENTRIFUGAL	B	D	0.3	B	SP	0.8	---	SP	1.5	B	SP	1.5	B	SP	3.5
RECIPROCATING:															
ALL	---	D	0.3	---	SP	0.8	R	SP	2.0	R	SP	2.5	R	SP	3.5
<b>COMPRESSORS AND VACUUM PUMPS</b>															
UP THROUGH 1-1/2 HP	---	D,L, W	0.8	----	D,L, W	0.8	---	D,L, W	1.5	---	D,L, W	1.5	---	D,L, W	---
2 HP AND OVER:															
500 - 750 RPM	---	D	0.8	---	S	0.8	---	S	1.5	---	S	1.5	---	S	2.5
750 RPM & OVER	---	D	0.8	---	S	0.8	---	S	1.5	---	S	1.5	---	S	2.5
<b>PUMPS</b>															
CLOSE COUPLED	UP TO 1-1/2 HP	---	---	---	---	D,L, W	---	---	D,L, W	---	---	D,L, W	---	---	D,L, W
	2 HP & OVER	---	---	---	I	S	0.8	I	S	1.5	I	S	1.5	I	S

EQUIPMENT		ON GRADE			20FT FLOOR SPAN			30FT FLOOR SPAN			40FT FLOOR SPAN			50FT FLOOR SPAN		
		BASE TYPE	ISOL TYPE	MIN DEFL	BASE TYPE	ISOL TYPE	MIN DEFL	BASE TYPE	ISOL TYPE	MIN DEFL	BASE TYPE	ISOL TYPE	MIN DEFL	BASE TYPE	ISOL TYPE	MIN DEFL
LARGE INLINE	Up to 25 HP	---	---	---	---	S	0.75	---	S	1.50	---	S	1.50	---	---	NA
	26 HP THRU 30 HP	---	---	---	---	S	1.0	---	S	1.50	---	S	2.50	---	---	NA
BASE MOUNTED	UP TO 10 HP	---	---	---	---	D,L, W	---	---	D,L, W	---	---	D,L, W	---	---	D,L, W	---
	15 HP THRU 40 HP	I	S	1.0	I	S	1.0	I	S	2.0	I	S	2.0	I	S	2.0
	50 HP & OVER	I	S	1.0	I	S	1.0	I	S	2.0	I	S	2.5	I	S	2.5
<b>ROOF FANS</b>																
ABOVE OCCUPIED AREAS:																
5 HP & OVER		---	---	---	CB	S	1.0	CB	S	1.0	CB	S	1.0	CB	S	1.0
<b>CENTRIFUGAL FANS</b>																
UP TO 50 HP:																
UP TO 200 RPM		B	N	0.3	B	S	2.5	B	S	2.5	B	S	3.5	B	S	3.5
201 - 300 RPM		B	N	0.3	B	S	2.0	B	S	2.5	B	S	2.5	B	S	3.5
301 - 500 RPM		B	N	0.3	B	S	2.0	B	S	2.0	B	S	2.5	B	S	3.5
501 RPM & OVER		B	N	0.3	B	S	2.0	B	S	2.0	B	S	2.0	B	S	2.5

EQUIPMENT	ON GRADE			20FT FLOOR SPAN			30FT FLOOR SPAN			40FT FLOOR SPAN			50FT FLOOR SPAN		
	BASE TYPE	ISOL TYPE	MIN DEFL	BASE TYPE	ISOL TYPE	MIN DEFL	BASE TYPE	ISOL TYPE	MIN DEFL	BASE TYPE	ISOL TYPE	MIN DEFL	BASE TYPE	ISOL TYPE	MIN DEFL
60 HP & OVER:															
UP TO 300 RPM	B	S	2.0	I	S	2.5	I	S	3.5	I	S	3.5	I	S	3.5
301 - 500 RPM	B	S	2.0	I	S	2.0	I	S	2.5	I	S	3.5	I	S	3.5
501 RPM & OVER	B	S	1.0	I	S	2.0	I	S	2.0	I	S	2.5	I	S	2.5
COOLING TOWERS															
UP TO 500 RPM	---	---	---	---	SP	2.5	---	SP	2.5	---	SP	2.5	---	SP	3.5
501 RPM & OVER	---	---	---	---	SP	0.75	---	SP	0.75	---	SP	1.5	---	SP	2.5
INTERNAL COMBUSTION ENGINES															
UP TO 25 HP	I	N	0.75	I	N	1.5	I	S	2.5	I	S	3.5	I	S	4.5
30 THRU 100 HP	I	N	0.75	I	N	1.5	I	S	2.5	I	S	3.5	I	S	4.5
125 HP & OVER	I	N	0.75	I	N	1.5	I	S	2.5	I	S	3.5	I	S	4.5
AIR HANDLING UNIT PACKAGES															
SUSPENDED:															
UP THRU 5 HP	---	---	---	---	H	1.0	---	H	1.0	---	H	1.0	---	H	1.0
7-1/2 HP & OVER:															
UP TO 500 RPM	---	---	---	---	H, THR	1.5	---	H, THR	2.5	---	H, THR	2.5	---	H, THR	2.5
501 RPM & OVER	---	---	---	---	H, THR	0.8	---	H, THR	0.8	---	H,TH R	0.8	---	H,TH R	2.0

EQUIPMENT	ON GRADE			20FT FLOOR SPAN			30FT FLOOR SPAN			40FT FLOOR SPAN			50FT FLOOR SPAN		
	BASE TYPE	ISOL TYPE	MIN DEFL	BASE TYPE	ISOL TYPE	MIN DEFL	BASE TYPE	ISOL TYPE	MIN DEFL	BASE TYPE	ISOL TYPE	MIN DEFL	BASE TYPE	ISOL TYPE	MIN DEFL
FLOOR MOUNTED:															
UP THRU 5 HP	---	D	---	---	S	1.0	---	S	1.0	---	S	1.0	---	S	1.0
7-1/2 HP & OVER:															
UP TO 500 RPM	---	D	---	R	S, THR	1.5	R	S, THR	2.5	R	S, THR	2.5	R	S, THR	2.5
501 RPM & OVER	---	D	---	---	S, THR	0.8	---	S, THR	0.8	R	S, THR	1.5	R	S, THR	2.0
HEAT PUMPS															
ALL	---	S	0.75	---	S	0.75	---	S	0.75	CB	S	1.5	---	---	NA
CONDENSING UNITS															
ALL	---	SS	0.25	---	SS	0.75	---	SS	1.5	CB	SS	1.5	---	---	NA
IN-LINE CENTRIFUGAL AND VANE AXIAL FANS, FLOOR MOUNTED: (APR 9)															
UP THRU 50 HP:															
UP TO 300 RPM	---	D	---	R	S	2.5	R	S	2.5	R	S	2.5	R	S	3.5
301 - 500 RPM	---	D	---	R	S	2.0	R	S	2.0	R	S	2.5	R	S	2.5
501 - & OVER	---	D	---	---	S	1.0	---	S	1.0	R	S	2.0	R	S	2.5
60 HP AND OVER:															
301 - 500 RPM	R	S	1.0	R	S	2.0	R	S	2.0	R	S	2.5	R	S	3.5
501 RPM & OVER	R	S	1.0	R	S	2.0	R	S	2.0	R	S	2.0	R	S	2.5

**NOTES:**

1. Edit the Table above to suit where isolator, other than those shown, are used, such as for seismic restraints and position limit stops.
2. For suspended floors lighter than 100 mm (4 inch) thick concrete, select deflection requirements from next higher span.
3. For separate chiller building on grade, pump isolators may be omitted.
4. Direct bolt fire pumps to concrete base. Provide pads (D) for domestic water booster pump package.
5. For projects in seismic areas, use only SS & DS type isolators and snubbers.
6. For floor mounted in-line centrifugal blowers (ARR 1): use "B" type in lieu of "R" type base.
7. Suspended: Use "H" isolators of same deflection as floor mounted.

**SECTION 23 05 93**  
**TESTING, ADJUSTING, AND BALANCING FOR HVAC**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

A. Testing, adjusting, and balancing (TAB) of heating, ventilating and air conditioning (HVAC) systems. TAB includes the following:

1. Planning systematic TAB procedures.
2. Design Review Report.
3. Systems Inspection report.
4. Duct Air Leakage test report.
5. Systems Readiness Report.
6. Balancing air and water distribution systems; adjustment of total system to provide design performance; and testing performance of equipment and automatic controls.
7. Vibration and sound measurements.
8. Recording and reporting results.

B. Definitions:

1. Basic TAB used in this Section: Chapter 38, "Testing, Adjusting and Balancing" of 2011 ASHRAE Handbook, "HVAC Applications".
2. TAB: Testing, Adjusting and Balancing; the process of checking and adjusting HVAC systems to meet design objectives.
3. AABC: Associated Air Balance Council.
4. NEBB: National Environmental Balancing Bureau.
5. Hydronic Systems: Includes chilled water, heating hot water
6. Air Systems: Includes all outside air, supply air, return air, exhaust air and relief air systems.
7. Flow rate tolerance: The allowable percentage variation, minus to plus, of actual flowrate from values (design) in the contract documents.

**1.2 RELATED WORK**

- A. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Not Used.
- C. Section 23 05 11, COMMON WORK RESULTS FOR HVAC.
- D. Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT.
- E. Section 23 07 11, HVAC, AND BOILER PLANT INSULATION:
- F. Not Used.
- G. Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC

H. Section 23 31 00, HVAC DUCTS AND CASINGS

I. Section 23 36 00, AIR TERMINAL UNITS:

### 1.3 QUALITY ASSURANCE

A. Refer to Articles, Quality Assurance and Submittals, in Section 23 05 11, COMMON WORK RESULTS FOR HVAC, Section 23 05 10, COMMON WORK RESULTS FOR BOILER PLANTS and STEAM GENERATION, and Section 23 08 00, COMMISSIONING OF HVAC SYSTEMS.

B. Qualifications:

1. TAB Agency: The TAB agency shall be a subcontractor of the General Contractor and shall report to and be paid by the General Contractor.
2. The TAB agency shall be either a certified member of AABC or certified by the NEBB to perform TAB service for HVAC, water balancing and vibrations and sound testing of equipment. The certification shall be maintained for the entire duration of duties specified herein. If, for any reason, the agency loses subject certification during this period, the General Contractor shall immediately notify the Project Manager and submit another TAB firm for approval. Any agency that has been the subject of disciplinary action by either the AABC or the NEBB within the five years preceding Contract Award shall not be eligible to perform any work related to the TAB. All work performed in this Section and in other related Sections by the TAB agency shall be considered invalid if the TAB agency loses its certification prior to Contract completion, and the successor agency's review shows unsatisfactory work performed by the predecessor agency.
3. TAB Specialist: The TAB specialist shall be either a member of AABC or an experienced technician of the Agency certified by NEBB. The certification shall be maintained for the entire duration of duties specified herein. If, for any reason, the Specialist loses subject certification during this period, the General Contractor shall immediately notify the Project Manager and submit another TAB Specialist for approval. Any individual that has been the subject of disciplinary action by either the AABC or the NEBB within the five years preceding Contract Award shall not be eligible to perform any duties related to the HVAC systems, including TAB. All work specified in this Section and in other related Sections performed by the TAB specialist shall be considered invalid if the TAB Specialist



- loses its certification prior to Contract completion and must be performed by an approved successor.
4. TAB Specialist shall be identified by the General Contractor within 60 days after the notice to proceed. The TAB specialist will be coordinating, scheduling and reporting all TAB work and related activities and will provide necessary information as required by the Project Manager. The responsibilities would specifically include:
    - a. Shall directly supervise all TAB work.
    - b. Shall sign the TAB reports that bear the seal of the TAB standard. The reports shall be accompanied by report forms and schematic drawings required by the TAB standard, AABC or NEBB.
    - c. Would follow all TAB work through its satisfactory completion.
    - d. Shall provide final markings of settings of all HVAC adjustment devices.
    - e. Permanently mark location of duct test ports.
  5. All TAB technicians performing actual TAB work shall be experienced and must have done satisfactory work on a minimum of 3 projects comparable in size and complexity to this project. Qualifications must be certified by the TAB agency in writing. The lead technician shall be certified by AABC or NEBB
- C. Test Equipment Criteria: The instrumentation shall meet the accuracy/calibration requirements established by AABC National Standards or by NEBB Procedural Standards for Testing, Adjusting and Balancing of Environmental Systems and instrument manufacturer. Provide calibration history of the instruments to be used for test and balance purpose.
- D. Tab Criteria:
1. One or more of the applicable AABC, NEBB or SMACNA publications, supplemented by ASHRAE Handbook "HVAC Applications" Chapter 38, and requirements stated herein shall be the basis for planning, procedures, and reports.
  2. Flow rate tolerance: Following tolerances are allowed. For tolerances not mentioned herein follow 2011 ASHRAE Handbook "HVAC Applications", Chapter 38, as a guideline. Air Filter resistance during tests, artificially imposed if necessary, shall be at least 100 percent of manufacturer recommended change over pressure drop values for pre-filters and after-filters.

- a. Air handling unit and all other fans, cubic meters/min (cubic feet per minute): Minus 0 percent to plus 10 percent.
- b. Air terminal units (maximum values): Minus 2 percent to plus 10 percent.
- d. Minimum outside air: 0 percent to plus 10 percent.
- e. Individual room air outlets and inlets, and air flow rates not mentioned above: Minus 5 percent to plus 10 percent except if the air to a space is 100 CFM or less the tolerance would be minus 5 to plus 5 percent.
- f. Heating hot water pumps and hot water coils: Minus 5 percent to plus 5 percent.
- g. Chilled water and condenser water pumps: Minus 0 percent to plus 5 percent.
- h. Chilled water coils: Minus 0 percent to plus 5 percent.
- 3. Systems shall be adjusted for energy efficient operation as described in PART 3.
- 4. Typical TAB procedures and results shall be demonstrated to the Project Manager for one air distribution system (including all fans, three terminal units, three rooms randomly selected by the Project Manager) and one hydronic system (pumps and three coils) as follows:
  - a. When field TAB work begins.
  - b. During each partial final inspection and the final inspection for the project if requested by VA.

#### **1.4 SUBMITTALS**

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Submit names and qualifications of TAB agency and TAB specialists within 60 days after the notice to proceed. Submit information on three recently completed projects and a list of proposed test equipment.
- C. For use by the Project Manager staff, submit one complete set of applicable AABC or NEBB publications that will be the basis of TAB work.
- D. Submit Following for Review and Approval:
  - 1. Design Review Report within 90 days for conventional design projects after the system layout on air and water side is completed by the Contractor.
  - 2. Systems inspection report on equipment and installation for conformance with design.

3. Duct Air Leakage Test Report.
  4. Systems Readiness Report.
  5. Intermediate and Final TAB reports covering flow balance and adjustments, performance tests, vibration tests and sound tests.
  6. Include in final reports uncorrected installation deficiencies noted during TAB and applicable explanatory comments on test results that differ from design requirements.
- E. Prior to request for Final or Partial Final inspection, submit completed Test and Balance report for the area.

#### **1.5 APPLICABLE PUBLICATIONS**

- A. The following publications form a part of this specification to the extent indicated by the reference thereto. In text the publications are referenced to by the acronym of the organization.
- B. American Society of Heating, Refrigerating and Air Conditioning Engineers, Inc. (ASHRAE):  
2011 .....HVAC Applications ASHRAE Handbook, Chapter 38,  
Testing, Adjusting, and Balancing and Chapter  
48, Sound and Vibration Control
- C. Associated Air Balance Council (AABC):  
2002.....AABC National Standards for Total System  
Balance
- D. National Environmental Balancing Bureau (NEBB):  
7<sup>th</sup> Edition 2005 .....Procedural Standards for Testing, Adjusting,  
Balancing of Environmental Systems  
2nd Edition 2006 .....Procedural Standards for the Measurement of  
Sound and Vibration  
3<sup>rd</sup> Edition 2009 .....Procedural Standards for Whole Building Systems  
Commissioning of New Construction
- E. Sheet Metal and Air Conditioning Contractors National Association (SMACNA):  
3<sup>rd</sup> Edition 2002 .....HVAC SYSTEMS Testing, Adjusting and Balancing

### **PART 2 - PRODUCTS**

#### **2.1 PLUGS**

Provide plastic plugs to seal holes drilled in ductwork for test purposes.

#### **2.2 INSULATION REPAIR MATERIAL**

See Section 23 07 11, HVAC and BOILER PLANT INSULATION Provide for repair of insulation removed or damaged for TAB work.

**PART 3 - EXECUTION****3.1 GENERAL**

- A. Refer to TAB Criteria in Article, Quality Assurance.
- B. Obtain applicable contract documents and copies of approved submittals for HVAC equipment and automatic control systems.

**3.2 DESIGN REVIEW REPORT**

The TAB Specialist shall review the Contract Plans and specifications and advise the Project Manager of any design deficiencies that would prevent the HVAC systems from effectively operating in accordance with the sequence of operation specified or prevent the effective and accurate TAB of the system. The TAB Specialist shall provide a report individually listing each deficiency and the corresponding proposed corrective action necessary for proper system operation.

**3.3 SYSTEMS INSPECTION REPORT**

- A. Inspect equipment and installation for conformance with design.
- B. The inspection and report is to be done after air distribution equipment is on site and duct installation has begun, but well in advance of performance testing and balancing work. The purpose of the inspection is to identify and report deviations from design and ensure that systems will be ready for TAB at the appropriate time.
- C. Reports: Follow check list format developed by AABC, NEBB or SMACNA, supplemented by narrative comments, with emphasis on air handling units and fans. Check for conformance with submittals. Verify that diffuser and register sizes are correct. Check air terminal unit installation including their duct sizes and routing.

**3.4 DUCT AIR LEAKAGE TEST REPORT**

TAB Agency shall perform the leakage test as outlined in "Duct leakage Tests and Repairs" in Section 23 31 00, HVAC DUCTS and CASINGS for TAB agency's role and responsibilities in witnessing, recording and reporting of deficiencies.

**3.5 SYSTEM READINESS REPORT**

- A. The TAB Contractor shall measure existing air and water flow rates associated with existing systems utilized to serve renovated areas as indicated on drawings. Submit report of findings to Project Manager.
- B. Inspect each System to ensure that it is complete including installation and operation of controls. Submit report to RE in standard format and forms prepared and or approved by the Commissioning Agent.

- C. Verify that all items such as ductwork piping, ports, terminals, connectors, etc., that is required for TAB are installed. Provide a report to the Project Manager.

### **3.6 TAB REPORTS**

- A. Submit an intermediate report for 50 percent of systems and equipment tested and balanced to establish satisfactory test results.
- B. The TAB contractor shall provide raw data immediately in writing to the Project Manager if there is a problem in achieving intended results before submitting a formal report.
- C. If over 20 percent of readings in the intermediate report fall outside the acceptable range, the TAB report shall be considered invalid and all contract TAB work shall be repeated and re-submitted for approval at no additional cost to the owner.
- D. Do not proceed with the remaining systems until intermediate report is approved by the Project Manager.

### **3.7 TAB PROCEDURES**

- A. Tab shall be performed in accordance with the requirement of the Standard under which TAB agency is certified by either AABC or NEBB.
- B. General: During TAB all related system components shall be in full operation. Fan and pump rotation, motor loads and equipment vibration shall be checked and corrected as necessary before proceeding with TAB. Set controls and/or block off parts of distribution systems to simulate design operation of variable volume air or water systems for test and balance work.
- C. Coordinate TAB procedures with existing systems and any phased construction completion requirements for the project. Provide TAB reports for pre-construction air and water flow rate and for each phase of the project prior to partial final inspections of each phase of the project. Return existing areas outside the work area to pre constructed conditions.
- D. Allow 30 days time in construction schedule for TAB and submission of all reports for an organized and timely correction of deficiencies.
- E. Air Balance and Equipment Test: Include air handling units, fans, terminal units, fan coil units, room diffusers/outlets/inlets, computer room AC units, and laboratory fume hoods and biological safety cabinets.
  - 1. Artificially load air filters by partial blanking to produce air pressure drop of manufacturer's recommended pressure drop.

2. Adjust fan speeds to provide design air flow. V-belt drives, including fixed pitch pulley requirements, are specified in Section 23 05 11, COMMON WORK RESULTS FOR HVAC
  3. Test and balance systems in all specified modes of operation, including variable volume, economizer, and fire emergency modes. Verify that dampers and other controls function properly.
  4. Variable air volume (VAV) systems:
    - a. Coordinate TAB, including system volumetric controls, with Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC.
    - b. Section 23 36 00, AIR TERMINAL UNITS, specifies that maximum and minimum flow rates for air terminal units (ATU) be factory set. Check and readjust ATU flow rates if necessary. Balance air distribution from ATU on full cooling maximum scheduled cubic meters per minute (cubic feet per minute). Reset room thermostats and check ATU operation from maximum to minimum cooling, to the heating mode, and back to cooling. Record and report the heating coil leaving air temperature when the ATU is in the maximum heating mode. Record and report outdoor air flow rates under all operating conditions (The test shall demonstrate that the minimum outdoor air ventilation rate shall remain constant under all operating conditions).
    - c. Adjust operating pressure control setpoint to maintain the design flow to each space with the lowest setpoint.
  5. Record final measurements for air handling equipment performance data sheets.
- F. Water Balance and Equipment Test: Include circulating pumps, convertors, coils, coolers and condensers:
1. Not Used.2. Adjust flow rates for equipment. Set coils and evaporator to values on equipment submittals, if different from values on contract drawings.
  3. Primary-secondary (variable volume) systems: Coordinate TAB with Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC. Balance systems at design water flow and then verify that variable flow controls function as designed.
  4. Record final measurements for hydronic equipment on performance data sheets. Include entering and leaving water temperatures for heating and cooling coils, and for convertors. Include entering and leaving air temperatures (DB/WB for cooling coils) for air handling units

and reheat coils. Make air and water temperature measurements at the same time.

### 3.8 VIBRATION TESTING

- A. Furnish instruments and perform vibration measurements as specified in Section 23 05 41, NOISE and VIBRATION CONTROL FOR HVAC PIPING and EQUIPMENT. Field vibration balancing is specified in Section 23 05 11, COMMON WORK RESULTS FOR HVAC Provide measurements for all rotating HVAC equipment of 373 watts (1/2 horsepower) and larger, including centrifugal/screw compressors, cooling towers, pumps, fans and motors.
- B. Record initial measurements for each unit of equipment on test forms and submit a report to the Project Manager. Where vibration readings exceed the allowable tolerance Contractor shall be directed to correct the problem. The TAB agency shall verify that the corrections are done and submit a final report to the Project Manager.

### 3.9 SOUND TESTING

- A. Perform and record required sound measurements in accordance with Paragraph, QUALITY ASSURANCE in Section 23 05 41, NOISE and VIBRATION CONTROL FOR HVAC PIPING and EQUIPMENT.
  - 1. Take readings in rooms, approximately ten percent of all rooms. The Project Manager may designate the specific rooms to be tested.
  - 2. Not Used.
- B. Take measurements with a calibrated sound level meter and octave band analyzer of the accuracy required by AABC or NEBB.
- C. Sound reference levels, formulas and coefficients shall be according to 2011 ASHRAE Handbook, "HVAC Applications", Chapter 48, SOUND AND VIBRATION CONTROL.
- D. Determine compliance with specifications as follows:
  - 1. When sound pressure levels are specified, including the NC Criteria in Section 23 05 41, NOISE and VIBRATION CONTROL FOR HVAC PIPING and EQUIPMENT:
    - a. Reduce the background noise as much as possible by shutting off unrelated audible equipment.
    - b. Measure octave band sound pressure levels with specified equipment "off."
    - c. Measure octave band sound pressure levels with specified equipment "on."
    - d. Use the DIFFERENCE in corresponding readings to determine the sound pressure due to equipment.

DIFFERENCE:	0	1	2	3	4	5 to 9	10 or More
FACTOR:	10	7	4	3	2	1	0

Sound pressure level due to equipment equals sound pressure level with equipment "on" minus FACTOR.

- e. Plot octave bands of sound pressure level due to equipment for typical rooms on a graph which also shows noise criteria (NC) curves.
2. When sound power levels are specified:
  - a. Perform steps 1.a. thru 1.d., as above.
  - b. For indoor equipment: Determine room attenuating effect, i.e., difference between sound power level and sound pressure level. Determined sound power level will be the sum of sound pressure level due to equipment plus the room attenuating effect.
  - c. For outdoor equipment: Use directivity factor and distance from noise source to determine distance factor, i.e., difference between sound power level and sound pressure level. Measured sound power level will be the sum of sound pressure level due to equipment plus the distance factor. Use 10 meters (30 feet for sound level location).
- E. Where measured sound levels exceed specified level, the installing contractor or equipment manufacturer shall take remedial action approved by the Project Manager and the necessary sound tests shall be repeated.
- F. Test readings for sound testing could go higher than 15 percent if determination is made by the Project Manager based on the recorded sound data.

### 3.10 MARKING OF SETTINGS

Following approval of Tab final Report, the setting of all HVAC adjustment devices including valves, splitters and dampers shall be permanently marked by the TAB Specialist so that adjustment can be restored if disturbed at any time. Style and colors used for markings shall be coordinated with the Project Manager.

### 3.11 IDENTIFICATION OF TEST PORTS

The TAB Specialist shall permanently and legibly identify the location points of duct test ports. If the ductwork has exterior insulation, the identification shall be made on the exterior side of the insulation.



All penetrations through ductwork and ductwork insulation shall be sealed to prevent air leaks and maintain integrity of vapor barrier.

### **3.12 PHASING**

- A. Phased Projects: Testing and Balancing Work to follow project with areas shall be completed per the project phasing. Upon completion of the project all areas shall have been tested and balanced per the contract documents.
- B. Existing Areas: Systems that serve areas outside of the project scope shall not be adversely affected. Measure existing parameters where shown to document system capacity.

### **3.13 COMMISSIONING**

- A. Provide commissioning documentation in accordance with the requirements of Section 23 08 00 - COMMISSIONING OF HVAC SYSTEMS for all inspection, start up, and contractor testing required above and required by the System Readiness Checklist provided by the Commissioning Agent.
- B. Components provided under this section of the specification will be tested as part of a larger system. Refer to Section 23 08 00 - COMMISSIONING OF HVAC SYSTEMS and related sections for contractor responsibilities for system commissioning.

- - E N D - - -



**SECTION 23 07 11**  
**HVAC AND BOILER PLANT INSULATION**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. Field applied insulation for thermal efficiency and condensation control for
  - 1. HVAC piping, ductwork and equipment.
  - 2. Not Used.
  - 3. Re-insulation of HVAC piping, ductwork and equipment, plumbing piping and equipment and boiler plant piping, breeching and stacks and equipment after asbestos abatement.
- B. Definitions
  - 1. ASJ: All service jacket, white finish facing or jacket.
  - 2. Air conditioned space: Space having air temperature and/or humidity controlled by mechanical equipment.
  - 3. Cold: Equipment, ductwork or piping handling media at design temperature of 16 degrees C (60 degrees F) or below.
  - 4. Concealed: Ductwork and piping above ceilings and in chases, and pipe spaces.
  - 5. Exposed: Piping, ductwork, and equipment exposed to view in finished areas including mechanical and electrical equipment rooms or exposed to outdoor weather. Attics and crawl spaces where air handling units are located are considered to be mechanical rooms. Shafts, chases, unfinished attics, crawl spaces and pipe basements are not considered finished areas.
  - 6. FSK: Foil-scrim-kraft facing.
  - 7. Hot: HVAC Ductwork handling air at design temperature above 16 degrees C (60 degrees F); HVAC equipment or piping handling media above 41 degrees C (105 degrees F).
  - 8. Density: kg/m<sup>3</sup> - kilograms per cubic meter (Pcf - pounds per cubic foot).
  - 9. Runouts: Branch pipe connections up to 25-mm (one-inch) nominal size to fan coil units or reheat coils for terminal units.
  - 10. Thermal conductance: Heat flow rate through materials.
    - a. Flat surface: Watt per square meter (BTU per hour per square foot).
    - b. Pipe or Cylinder: Watt per square meter (BTU per hour per linear foot).

11. Thermal Conductivity (k): Watt per meter, per degree C (BTU per inch thickness, per hour, per square foot, per degree F temperature difference).
12. Vapor Retarder (Vapor Barrier): A material which retards the transmission (migration) of water vapor. Performance of the vapor retarder is rated in terms of permeance (perms). For the purpose of this specification, vapor retarders shall have a maximum published permeance of 0.1 perms and vapor barriers shall have a maximum published permeance of 0.001 perms.
13. HPS: High pressure steam (415 kPa [60 psig] and above).
14. HPR: High pressure steam condensate return.
15. MPS: Medium pressure steam (110 kPa [16 psig] thru 414 kPa [59 psig]).
16. MPR: Medium pressure steam condensate return.
17. LPS: Low pressure steam (103 kPa [15 psig] and below).
18. LPR: Low pressure steam condensate gravity return.
19. PC: Pumped condensate.
20. HWH: Hot water heating supply.
21. HWHR: Hot water heating return.
22. Not Used.
23. Not Used.
24. Not Used.
25. Not Used.
26. Not Used.
27. Not Used.
28. Not Used.
29. Not Used.
30. R: Pump recirculation.
31. Not Used.
32. Not Used.
33. CW: Cold water.
34. SW: Soft water.
35. HW: Hot water.
36. CH: Chilled water supply.
37. CHR: Chilled water return.
38. Not Used.
39. Not Used.
40. RS: Refrigerant suction.

41. PVDC: Polyvinylidene chloride vapor retarder jacketing, white.

## 1.2 RELATED WORK

- A. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Section 02 82 11, TRADITIONAL ASBESTOS ABATEMENT.
- C. Not Used.
- D. Section 07 84 00, FIRESTOPPING.
- E. Section 23 05 11, COMMON WORK RESULTS FOR HVAC.
- F. Not Used.
- G. Section 23 08 00, COMMISSIONING OF HVAC SYSTEMS.
- H. Section 23 21 13, HYDRONIC PIPING.
- I. Section 23 22 13, STEAM and CONDENSATE HEATING PIPING

## 1.3 QUALITY ASSURANCE

- A. Refer to article QUALITY ASSURANCE, in Section 23 05 11, COMMON WORK RESULTS FOR HVAC.
- B. Criteria:
  - 1. Comply with NFPA 90A, particularly paragraphs 4.3.3.1 through 4.3.3.6, 4.3.10.2.6, and 5.4.6.4, parts of which are quoted as follows:

**4.3.3.1** Pipe insulation and coverings, duct coverings, duct linings, vapor retarder facings, adhesives, fasteners, tapes, and supplementary materials added to air ducts, plenums, panels, and duct silencers used in duct systems, unless otherwise provided for in 4.3.3.1.1 or 4.3.3.1.2., shall have, in the form in which they are used, a maximum flame spread index of 25 without evidence of continued progressive combustion and a maximum smoke developed index of 50 when tested in accordance with NFPA 255, Standard Method of Test of Surface Burning Characteristics of Building Materials.

**4.3.3.1.1** Where these products are to be applied with adhesives, they shall be tested with such adhesives applied, or the adhesives used shall have a maximum flame spread index of 25 and a maximum smoke developed index of 50 when in the final dry state. (See 4.2.4.2.)

**4.3.3.1.2** The flame spread and smoke developed index requirements of 4.3.3.1.1 shall not apply to air duct weatherproof coverings where they are located entirely outside of a building, do not penetrate a wall or roof, and do not create an exposure hazard.

**4.3.3.2** Closure systems for use with rigid and flexible air ducts tested in accordance with UL 181, Standard for Safety Factory-Made Air Ducts and Air Connectors, shall have been tested, listed, and used in accordance with the conditions of their listings, in accordance with one of the following:

- (1) UL 181A, Standard for Safety Closure Systems for Use with Rigid Air Ducts and Air Connectors

(2) UL 181B, Standard for Safety Closure Systems for Use with Flexible Air Ducts and Air Connectors

4.3.3.3 Air duct, panel, and plenum coverings and linings, and pipe insulation and coverings shall not flame, glow, smolder, or smoke when tested in accordance with a similar test for pipe covering, ASTM C 411, Standard Test Method for Hot-Surface Performance of High-Temperature Thermal Insulation, at the temperature to which they are exposed in service.

4.3.3.3.1 In no case shall the test temperature be below 121°C (250°F).

4.3.3.4 Air duct coverings shall not extend through walls or floors that are required to be fire stopped or required to have a fire resistance rating, unless such coverings meet the requirements of 5.4.6.4.

4.3.3.5\* Air duct linings shall be interrupted at fire dampers to prevent interference with the operation of devices.

4.3.3.6 Air duct coverings shall not be installed so as to conceal or prevent the use of any service opening.

4.3.10.2.6 Materials exposed to the airflow shall be noncombustible or limited combustible and have a maximum smoke developed index of 50 or comply with the following.

4.3.10.2.6.1 Electrical wires and cables and optical fiber cables shall be listed as noncombustible or limited combustible and have a maximum smoke developed index of 50 or shall be listed as having a maximum peak optical density of 0.5 or less, an average optical density of 0.15 or less, and a maximum flame spread distance of 1.5 m (5 ft) or less when tested in accordance with NFPA 262, Standard Method of Test for Flame Travel and Smoke of Wires and Cables for Use in Air-Handling Spaces.

4.3.10.2.6.4 Optical-fiber and communication raceways shall be listed as having a maximum peak optical density of 0.5 or less, an average optical density of 0.15 or less, and a maximum flame spread distance of 1.5 m (5 ft) or less when tested in accordance with UL 2024, Standard for Safety Optical-Fiber Cable Raceway.

4.3.10.2.6.6 Supplementary materials for air distribution systems shall be permitted when complying with the provisions of 4.3.3.

5.4.6.4 Where air ducts pass through walls, floors, or partitions that are required to have a fire resistance rating and where fire dampers are not required, the opening in the construction around the air duct shall be as follows:

(1) Not exceeding a 25.4 mm (1 in.) average clearance on all sides

(2) Filled solid with an approved material capable of preventing the passage of flame and hot gases sufficient to ignite cotton waste when subjected to the time-temperature fire conditions required for fire barrier penetration as specified in NFPA 251, Standard Methods of Tests of Fire Endurance of Building Construction and Materials

2. Test methods: ASTM E84, UL 723, or NFPA 255.

3. Specified k factors are at 24 degrees C (75 degrees F) mean temperature unless stated otherwise. Where optional thermal insulation material is used, select thickness to provide thermal conductance no greater than that for the specified material. For pipe, use insulation manufacturer's published heat flow tables. For domestic hot water supply and return, run out insulation and condensation control insulation, no thickness adjustment need be made.
  4. All materials shall be compatible and suitable for service temperature, and shall not contribute to corrosion or otherwise attack surface to which applied in either the wet or dry state.
- C. Every package or standard container of insulation or accessories delivered to the job site for use must have a manufacturer's stamp or label giving the name of the manufacturer and description of the material.

#### **1.4 SUBMITTALS**

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Shop Drawings:
  1. All information, clearly presented, shall be included to determine compliance with drawings and specifications and ASTM, federal and military specifications.
    - a. Insulation materials: Specify each type used and state surface burning characteristics.
    - b. Insulation facings and jackets: Each type used. Make it clear that white finish will be furnished for exposed ductwork, casings and equipment.
    - c. Insulation accessory materials: Each type used.
    - d. Manufacturer's installation and fitting fabrication instructions for flexible unicellular insulation.
    - e. Make reference to applicable specification paragraph numbers for coordination.
- C. Samples:
  1. Each type of insulation: Minimum size 100 mm (4 inches) square for board/block/ blanket; 150 mm (6 inches) long, full diameter for round types.
  2. Each type of facing and jacket: Minimum size 100 mm (4 inches square).

3. Each accessory material: Minimum 120 ML (4 ounce) liquid container or 120 gram (4 ounce) dry weight for adhesives / cement / mastic.

#### 1.5 STORAGE AND HANDLING OF MATERIAL

Store materials in clean and dry environment, pipe covering jackets shall be clean and unmarred. Place adhesives in original containers. Maintain ambient temperatures and conditions as required by printed instructions of manufacturers of adhesives, mastics and finishing cements.

#### 1.6 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by basic designation only.
- B. Federal Specifications (Fed. Spec.):
- L-P-535E (2)- 99.....Plastic Sheet (Sheeting): Plastic Strip; Poly (Vinyl Chloride) and Poly (Vinyl Chloride - Vinyl Acetate), Rigid.
- C. Military Specifications (Mil. Spec.):
- MIL-A-3316C (2)-90.....Adhesives, Fire-Resistant, Thermal Insulation
- MIL-A-24179A (1)-87.....Adhesive, Flexible Unicellular-Plastic Thermal Insulation
- MIL-C-19565C (1)-88.....Coating Compounds, Thermal Insulation, Fire-and Water-Resistant, Vapor-Barrier
- MIL-C-20079H-87.....Cloth, Glass; Tape, Textile Glass; and Thread, Glass and Wire-Reinforced Glass
- D. American Society for Testing and Materials (ASTM):
- A167-99(2004).....Standard Specification for Stainless and Heat-Resisting Chromium-Nickel Steel Plate, Sheet, and Strip
- B209-07.....Standard Specification for Aluminum and Aluminum-Alloy Sheet and Plate
- C411-05.....Standard test method for Hot-Surface Performance of High-Temperature Thermal Insulation
- C449-07.....Standard Specification for Mineral Fiber Hydraulic-Setting Thermal Insulating and Finishing Cement
- C533-09.....Standard Specification for Calcium Silicate Block and Pipe Thermal Insulation



- C534-08.....Standard Specification for Preformed Flexible Elastomeric Cellular Thermal Insulation in Sheet and Tubular Form
- C547-07.....Standard Specification for Mineral Fiber pipe Insulation
- C553-08.....Standard Specification for Mineral Fiber Blanket Thermal Insulation for Commercial and Industrial Applications
- C585-09.....Standard Practice for Inner and Outer Diameters of Rigid Thermal Insulation for Nominal Sizes of Pipe and Tubing (NPS System) R (1998)
- C612-10.....Standard Specification for Mineral Fiber Block and Board Thermal Insulation
- C1136-10.....Standard Specification for Flexible, Low Permeance Vapor Retarders for Thermal Insulation
- D1668-97a (2006).....Standard Specification for Glass Fabrics (Woven and Treated) for Roofing and Waterproofing
- E84-10.....Standard Test Method for Surface Burning Characteristics of Building Materials
- E119-09c.....Standard Test Method for Fire Tests of Building Construction and Materials
- E136-09b.....Standard Test Methods for Behavior of Materials in a Vertical Tube Furnace at 750 degrees C (1380 F)
- E. National Fire Protection Association (NFPA):
- 90A-09.....Standard for the Installation of Air Conditioning and Ventilating Systems
- 101-09.....Life Safety Code
- 251-06.....Standard methods of Tests of Fire Endurance of Building Construction Materials
- 255-06.....Standard Method of tests of Surface Burning Characteristics of Building Materials
- F. Underwriters Laboratories, Inc (UL):
- 723.....UL Standard for Safety Test for Surface Burning Characteristics of Building Materials with Revision of 09/08

- G. Manufacturer's Standardization Society of the Valve and Fitting Industry (MSS):  
 SP58-2009.....Pipe Hangers and Supports Materials, Design,  
 and Manufacture

## **PART 2 - PRODUCTS**

### **2.1 MINERAL FIBER OR FIBER GLASS**

- A. ASTM C612 (Board, Block), Class 1 or 2, density 48 kg/m<sup>3</sup> (3 pcf), k = 0.037 (0.26) at 24 degrees C (75 degrees F), external insulation for temperatures up to 204 degrees C (400 degrees F) with foil scrim (FSK) facing.
- B. ASTM C553 (Blanket, Flexible) Type I, Class B-5, Density 32 kg/m<sup>3</sup> (2 pcf), k = 0.04 (0.27) at 24 degrees C (75 degrees F), for use at temperatures up to 204 degrees C (400 degrees F) with foil scrim (FSK) facing.
- C. ASTM C547 (Pipe Fitting Insulation and Preformed Pipe Insulation), Class 1, k = 0.037 (0.26) at 24 degrees C (75 degrees F), for use at temperatures up to 230 degrees C (450 degrees F) with an all service vapor retarder jacket with polyvinyl chloride premolded fitting covering.

### **2.2 MINERAL WOOL OR REFRACTORY FIBER**

- A. Comply with Standard ASTM C612, Class 3, 450 degrees C (850 degrees F).

### **2.3 RIGID CELLULAR PHENOLIC FOAM NOT USED.**

### **2.4 CELLULAR GLASS CLOSED-CELL NOT USED.**

### **2.5 POLYISOCYANURATE CLOSED-CELL RIGID NOT USED.**

### **2.6 FLEXIBLE ELASTOMERIC CELLULAR THERMAL**

ASTM C177, C518, k = 0.039 (0.27) at 24 degrees C (75 degrees F), flame spread not over 25, smoke developed not over 50, for temperatures from minus 4 degrees C (40 degrees F) to 93 degrees C (200 degrees F). No jacket required.

### **2.7 DUCT WRAP FOR KITCHEN HOOD GREASE DUCTS NOT USED.**

### **2.8 CALCIUM SILICATE**

- A. Preformed pipe Insulation: ASTM C533, Type I and Type II with indicator denoting asbestos-free material.
- B. Premolded Pipe Fitting Insulation: ASTM C533, Type I and Type II with indicator denoting asbestos-free material.
- C. Equipment Insulation: ASTM C533, Type I and Type II
- D. Characteristics:

Insulation Characteristics		
ITEMS	TYPE I	TYPE II
Temperature, maximum degrees C (degrees F)	649 (1200)	927 (1700)
Density (dry), Kg/m <sup>3</sup> (lb/ ft <sup>3</sup> )	232 (14.5)	288 (18)
Thermal conductivity: Min W/ m K (Btu in/h ft <sup>2</sup> degrees F)@ mean temperature of 93 degrees C (200 degrees F)	0.059 (0.41)	0.078 (0.540)
Surface burning characteristics: Flame spread Index, Maximum	0	0
Smoke Density index, Maximum	0	0

## 2.9 INSULATION FACINGS AND JACKETS

- A. Vapor Retarder, higher strength with low water permeance  $\leq 0.02$  or less perm rating, Beach puncture 50 units for insulation facing on exposed ductwork, casings and equipment, and for pipe insulation jackets. Facings and jackets shall be all service type (ASJ) or PVDC Vapor Retarder jacketing.
- B. ASJ jacket shall be white kraft bonded to 0.025 mm (1 mil) thick aluminum foil, fiberglass reinforced, with pressure sensitive adhesive closure. Comply with ASTM C1136. Beach puncture 50 units, Suitable for painting without sizing. Jackets shall have minimum 40 mm (1-1/2 inch) lap on longitudinal joints and minimum 75 mm (3 inch) butt strip on end joints. Butt strip material shall be same as the jacket. Lap and butt strips shall be self-sealing type with factory-applied pressure sensitive adhesive.
- C. Vapor Retarder medium strength with low water vapor permeance of 0.02 or less perm rating), Beach puncture 25 units: Foil-Scrim-Kraft (FSK) or PVDC vapor retarder jacketing type for concealed ductwork and equipment.
- D. Field applied vapor barrier jackets shall be provided, in addition to the specified facings and jackets, on all exterior piping and ductwork as well as on interior piping and ductwork exposed to outdoor air (i.e.; in ventilated attics, piping in ventilated (not air conditioned) spaces, etc.) in high humidity areas conveying fluids below ambient

temperature. The vapor barrier jacket shall consist of a multi-layer laminated cladding with a maximum water vapor permeance of 0.001 perms. The minimum puncture resistance shall be 35 cm-kg (30 inch-pounds) for interior locations and 92 cm-kg (80 inch-pounds) for exterior or exposed locations or where the insulation is subject to damage.

- E. Glass Cloth Jackets: Presized, minimum 0.18 kg per square meter (7.8 ounces per square yard), 2000 kPa (300 psig) bursting strength with integral vapor retarder where required or specified. Weather proof if utilized for outside service.
- F. Factory composite materials may be used provided that they have been tested and certified by the manufacturer.
- G. Pipe fitting insulation covering (jackets): Fitting covering shall be premolded to match shape of fitting and shall be polyvinyl chloride (PVC) conforming to Fed Spec L-P-335, composition A, Type II Grade GU, and Type III, minimum thickness 0.7 mm (0.03 inches). Provide color matching vapor retarder pressure sensitive tape.
- H. Aluminum Jacket-Piping systems ASTM B209, 3003 alloy, H-14 temper, 0.6 mm (0.023 inch) minimum thickness with locking longitudinal joints. Jackets for elbows, tees and other fittings shall be factory-fabricated to match shape of fitting and of 0.6 mm (0.024) inch minimum thickness aluminum. Fittings shall be of same construction as straight run jackets but need not be of the same alloy. Factory-fabricated stainless steel bands shall be installed on all circumferential joints. Bands shall be 13 mm (0.5 inch) wide on 450 mm (18 inch) centers. System shall be weatherproof if utilized for outside service.

## **2.10 REMOVABLE INSULATION JACKETS**

- A. Insulation and Jacket:
  - 1. Non-Asbestos Glass mat, type E needled fiber.
  - 2. Temperature maximum of 450°F, Maximum water vapor transmission of 0.00 perm, and maximum moisture absorption of 0.2 percent by volume.
  - 3. Jacket Material: Silicon/fiberglass and LFP 2109 pure PTFE.
  - 4. Construction: One piece jacket body with three-ply braided pure Teflon or Kevlar thread and insulation sewn as part of jacket. Belt fastened.

## **2.11 PIPE COVERING PROTECTION SADDLES**

- A. Cold pipe support: Premolded pipe insulation 180 degrees (half-shells) on bottom half of pipe at supports. Material shall be cellular glass or high density Polyisocyanurate insulation of the same thickness as

adjacent insulation. Density of Polyisocyanurate insulation shall be a minimum of 48 kg/m<sup>3</sup> (3.0 pcf).

<b>Nominal Pipe Size and Accessories Material (Insert Blocks)</b>	
Nominal Pipe Size mm (inches)	Insert Blocks mm (inches)
Up through 125 (5)	150 (6) long
150 (6)	150 (6) long
200 (8), 250 (10), 300 (12)	225 (9) long
350 (14), 400 (16)	300 (12) long
450 through 600 (18 through 24)	350 (14) long

B. Warm or hot pipe supports: Premolded pipe insulation (180 degree half-shells) on bottom half of pipe at supports. Material shall be high density (for temperatures up to 149 degrees C [300 degrees F]), calcium silicate. Insulation at supports shall have same thickness as adjacent insulation. Density of Polyisocyanurate insulation shall be a minimum of 48 kg/m<sup>3</sup> (3.0 pcf).

#### **2.12 ADHESIVE, MASTIC, CEMENT**

- A. Mil. Spec. MIL-A-3316, Class 1: Jacket and lap adhesive and protective finish coating for insulation.
- B. Mil. Spec. MIL-A-3316, Class 2: Adhesive for laps and for adhering insulation to metal surfaces.
- C. Mil. Spec. MIL-A-24179, Type II Class 1: Adhesive for installing flexible unicellular insulation and for laps and general use.
- D. Mil. Spec. MIL-C-19565, Type I: Protective finish for outdoor use.
- E. Mil. Spec. MIL-C-19565, Type I or Type II: Vapor barrier compound for indoor use.
- F. ASTM C449: Mineral fiber hydraulic-setting thermal insulating and finishing cement.
- G. Other: Insulation manufacturers' published recommendations.

#### **2.13 MECHANICAL FASTENERS**

- A. Pins, anchors: Welded pins, or metal or nylon anchors with galvanized steel-coated or fiber washer, or clips. Pin diameter shall be as recommended by the insulation manufacturer.
- B. Staples: Outward clinching galvanized steel.
- C. Wire: 1.3 mm thick (18 gage) soft annealed galvanized or 1.9 mm (14 gage) copper clad steel or nickel copper alloy.

- D. Bands: 13 mm (0.5 inch) nominal width, brass, galvanized steel, aluminum or stainless steel.

#### **2.14 REINFORCEMENT AND FINISHES**

- A. Glass fabric, open weave: ASTM D1668, Type III (resin treated) and Type I (asphalt treated).
- B. Glass fiber fitting tape: Mil. Spec MIL-C-20079, Type II, Class 1.
- C. Tape for Flexible Elastomeric Cellular Insulation: As recommended by the insulation manufacturer.
- D. Hexagonal wire netting: 25 mm (one inch) mesh, 0.85 mm thick (22 gage) galvanized steel.
- E. Corner beads: 50 mm (2 inch) by 50 mm (2 inch), 0.55 mm thick (26 gage) galvanized steel; or, 25 mm (1 inch) by 25 mm (1 inch), 0.47 mm thick (28 gage) aluminum angle adhered to 50 mm (2 inch) by 50 mm (2 inch) Kraft paper.
- F. PVC fitting cover: Fed. Spec L-P-535, Composition A, 11-86 Type II, Grade GU, with Form B Mineral Fiber insert, for media temperature 4 degrees C (40 degrees F) to 121 degrees C (250 degrees F). Below 4 degrees C (40 degrees F) and above 121 degrees C (250 degrees F). Provide double layer insert. Provide color matching vapor barrier pressure sensitive tape.

#### **2.15 FIRESTOPPING MATERIAL**

Other than pipe and duct insulation, refer to Section 07 84 00 FIRESTOPPING.

#### **2.16 FLAME AND SMOKE**

Unless shown otherwise all assembled systems shall meet flame spread 25 and smoke developed 50 rating as developed under ASTM, NFPA and UL standards and specifications. See paragraph 1.3 "Quality Assurance".

### **PART 3 - EXECUTION**

#### **3.1 GENERAL REQUIREMENTS**

- A. Required pressure tests of duct and piping joints and connections shall be completed and the work approved by the Project Manager for application of insulation. Surface shall be clean and dry with all foreign materials, such as dirt, oil, loose scale and rust removed.
- B. Except for specific exceptions, insulate entire specified equipment, piping (pipe, fittings, valves, accessories), and duct systems. Insulate each pipe and duct individually. Do not use scrap pieces of insulation where a full length section will fit.

- C. Where removal of insulation of piping, ductwork and equipment is required to comply with Section 02 82 11, TRADITIONAL ASBESTOS ABATEMENT and Section 02 82 13.13, GLOVEBAG ASBESTOS ABATEMENT, such areas shall be reinsulated to comply with this specification.
- D. Insulation materials shall be installed in a first class manner with smooth and even surfaces, with jackets and facings drawn tight and smoothly cemented down at all laps. Insulation shall be continuous through all sleeves and openings, except at fire dampers and duct heaters (NFPA 90A). Vapor retarders shall be continuous and uninterrupted throughout systems with operating temperature 16 degrees C (60 degrees F) and below. Lap and seal vapor retarder over ends and exposed edges of insulation. Anchors, supports and other metal projections through insulation on cold surfaces shall be insulated and vapor sealed for a minimum length of 150 mm (6 inches).
- E. Install vapor stops at all insulation terminations on either side of valves, pumps and equipment and particularly in straight lengths of pipe insulation.
- F. Construct insulation on parts of equipment such as chilled water pumps and heads of chillers, convertors and heat exchangers that must be opened periodically for maintenance or repair, so insulation can be removed and replaced without damage. Install insulation with bolted 1 mm thick (20 gage) galvanized steel or aluminum covers as complete units, or in sections, with all necessary supports, and split to coincide with flange/split of the equipment.
- G. Insulation on hot piping and equipment shall be terminated square at items not to be insulated, access openings and nameplates. Cover all exposed raw insulation with white sealer or jacket material.
- H. Protect all insulations outside of buildings with aluminum jacket using lock joint or other approved system for a continuous weather tight system. Access doors and other items requiring maintenance or access shall be removable and sealable.
- I. HVAC work not to be insulated:
  - 1. Internally insulated ductwork and air handling units.
  - 2. Relief air ducts (Economizer cycle exhaust air).
  - 3. Exhaust air ducts and plenums, and ventilation exhaust air shafts.
  - 4. Equipment: Expansion tanks, flash tanks, hot water pumps, 5. In hot piping: Unions, flexible connectors, control valves, safety valves and discharge vent piping, vacuum breakers, thermostatic vent

- valves, steam traps 20 mm (3/4 inch) and smaller, exposed piping through floor for convectors and radiators. Insulate piping to within approximately 75 mm (3 inches) of uninsulated items.
- J. Not Used.
  - K. Apply insulation materials subject to the manufacturer's recommended temperature limits. Apply adhesives, mastic and coatings at the manufacturer's recommended minimum coverage.
  - L. Elbows, flanges and other fittings shall be insulated with the same material as is used on the pipe straights. The elbow/ fitting insulation shall be field-fabricated, mitered or factory prefabricated to the necessary size and shape to fit on the elbow/ fitting. Use of polyurethane spray-foam to fill a PVC elbow jacket is prohibited on cold applications.
  - M. Firestop Pipe and Duct insulation:
    - 1. Provide firestopping insulation at fire and smoke barriers through penetrations. Fire stopping insulation shall be UL listed as defines in Section 07 84 00, FIRESTOPPING.
    - 2. Pipe and duct penetrations requiring fire stop insulation including, but not limited to the following:
      - a. Pipe risers through floors
      - b. Pipe or duct chase walls and floors
      - c. Smoke partitions
      - d. Fire partitions
  - N. Freeze protection of above grade outdoor piping (over heat tracing tape): 26 mm (10 inch) thick insulation, for all pipe sizes 75 mm(3 inches) and smaller and 25 mm(1inch) thick insulation for larger pipes. Provide metal jackets for all pipes. Provide for cold water make-up to cooling towers and condenser water piping and chilled water piping as described in Section 23 21 13, HYDRONIC PIPING (electrical heat tracing systems).
  - O. Provide vapor barrier jackets over insulation as follows:
    - 1. All piping and ductwork exposed to outdoor weather.
    - 2. All interior piping and ducts conveying fluids exposed to outdoor air (i.e. in attics, ventilated (not air conditioned) spaces, etc.) below ambient air temperature in high humidity areas.
  - P. Provide metal jackets over insulation as follows:
    - 1. All piping and ducts exposed to outdoor weather.



2. Piping exposed in building, within 1800 mm (6 feet) of the floor, that connects to sterilizers, kitchen and laundry equipment. Jackets may be applied with pop rivets. Provide aluminum angle ring escutcheons at wall, ceiling or floor penetrations.
3. A 50 mm (2 inch) overlap is required at longitudinal and circumferential joints.

### 3.2 INSULATION INSTALLATION

#### A. Mineral Fiber Board:

1. Faced board: Apply board on pins spaced not more than 300 mm (12 inches) on center each way, and not less than 75 mm (3 inches) from each edge of board. In addition to pins, apply insulation bonding adhesive to entire underside of horizontal metal surfaces. Butt insulation edges tightly and seal all joints with laps and butt strips. After applying speed clips cut pins off flush and apply vapor seal patches over clips.
2. Plain board:
  - a. Insulation shall be scored, beveled or mitered to provide tight joints and be secured to equipment with bands spaced 225 mm (9 inches) on center for irregular surfaces or with pins and clips on flat surfaces. Use corner beads to protect edges of insulation.
  - b. For hot equipment: Stretch 25 mm (1 inch) mesh wire, with edges wire laced together, over insulation and finish with insulating and finishing cement applied in one coat, 6 mm (1/4 inch) thick, trowel led to a smooth finish.
  - c. For cold equipment: Apply meshed glass fabric in a tack coat 1.5 to 1.7 square meter per liter (60 to 70 square feet per gallon) of vapor mastic and finish with mastic at 0.3 to 0.4 square meter per liter (12 to 15 square feet per gallon) over the entire fabric surface.
3. Exposed, unlined ductwork and equipment in unfinished areas, mechanical and electrical equipment rooms and attics, and duct work exposed to outdoor weather:
  - a. 50 mm (2 inch) thick insulation faced with ASJ (white all service jacket): Supply air duct unlined air handling units and afterfilter housing.
  - b. 40 mm (1-1/2 inch) thick insulation faced with ASJ: Return air duct, mixed air plenums and prefilter housing.

- c. Outside air intake ducts: 25 mm (one inch) thick insulation faced with ASJ.
- d. Exposed, unlined supply and return ductwork exposed to outdoor weather: 50 mm (2 inch) thick insulation faced with a reinforcing membrane and two coats of vapor barrier mastic or multi-layer vapor barrier with a maximum water vapor permeability of 0.001 perms.
- 4. Not Used.
- 5. Cold equipment: 40 mm (1-1/2 inch) thick insulation faced with ASJ.
  - a. Chilled water pumps, water filter, chemical feeder pot or tank.
  - b. Pneumatic, cold storage water and surge tanks.
- 6. Hot equipment: 40 mm (1-1/2 inch) thick insulation faced with ASJ.
  - a. Convertors, air separators, steam condensate pump receivers.
  - b. Reheat coil casing and separation chambers on steam humidifiers located above ceilings.
  - c. Domestic water heaters and hot water storage tanks (not factory insulated).
- B. Flexible Mineral Fiber Blanket:
  - 1. Adhere insulation to metal with 75 mm (3 inch) wide strips of insulation bonding adhesive at 200 mm (8 inches) on center all around duct. Additionally secure insulation to bottom of ducts exceeding 600 mm (24 inches) in width with pins welded or adhered on 450 mm (18 inch) centers. Secure washers on pins. Butt insulation edges and seal joints with laps and butt strips. Staples may be used to assist in securing insulation. Seal all vapor retarder penetrations with mastic. Sagging duct insulation will not be acceptable. Install firestop duct insulation where required.
  - 2. Supply air ductwork to be insulated includes main and branch ducts from AHU discharge to room supply outlets, and the bodies of ceiling outlets to prevent condensation. Insulate sound attenuator units, coil casings and damper frames. To prevent condensation insulate trapeze type supports and angle iron hangers for flat oval ducts that are in direct contact with metal duct.
  - 3. Concealed supply air ductwork.
    - a. Above ceilings at a roof level, in attics, and duct work exposed to outdoor weather: 50 mm (2 inch) thick insulation faced with FSK.

- b. Above ceilings for other than roof level: 40 mm (1 ½ inch) thick insulation faced with FSK.
- 4. Concealed return air duct:
  - a. In attics (where not subject to damage) and where exposed to outdoor weather: 50mm (2 inch) thick insulation faced with FSK,
  - b. Above ceilings at a roof level, unconditioned areas, and in chases with external wall or containing steam piping; 40 mm (1-1/2 inch) thick, insulation faced with FSK.
  - c. Not Used.
  - d. Concealed return air ductwork in other locations need not be insulated.
- 5. Concealed outside air duct: 40 mm (1-1/2 inch) thick insulation faced with FSK.
- 6. Exhaust air branch duct from autopsy refrigerator to main duct: 40 mm (1-1/2 inch) thick insulation faced with FSK.
- C. Molded Mineral Fiber Pipe and Tubing Covering:
  - 1. Fit insulation to pipe or duct, aligning longitudinal joints. Seal longitudinal joint laps and circumferential butt strips by rubbing hard with a nylon sealing tool to assure a positive seal. Staples may be used to assist in securing insulation. Seal all vapor retarder penetrations on cold piping with a generous application of vapor barrier mastic. Provide inserts and install with metal insulation shields at outside pipe supports. Install freeze protection insulation over heating cable.
  - 2. Contractor's options for fitting, flange and valve insulation:
    - a. Insulating and finishing cement for sizes less than 100 mm (4 inches) operating at surface temperature of 16 degrees C (61 degrees F) or more.
    - b. Factory premolded, one piece PVC covers with mineral fiber, (Form B), inserts. Provide two insert layers for pipe temperatures below 4 degrees C (40 degrees F), or above 121 degrees C (250 degrees F). Secure first layer of insulation with twine. Seal seam edges with vapor barrier mastic and secure with fitting tape.
    - c. Factory molded, ASTM C547 or field mitered sections, joined with adhesive or wired in place. For hot piping finish with a smoothing coat of finishing cement. For cold fittings, 16 degrees C (60 degrees F) or less, vapor seal with a layer of glass

fitting tape imbedded between two 2 mm (1/16 inch) coats of vapor barrier mastic.

- d. Fitting tape shall extend over the adjacent pipe insulation and overlap on itself at least 50 mm (2 inches).
- 3. Nominal thickness in millimeters and inches specified in the schedule at the end of this section.
- D. Not Used.
- E. Not Used.
- F. Not Used.
- G. Flexible Elastomeric Cellular Thermal Insulation:
  - 1. Apply insulation and fabricate fittings in accordance with the manufacturer's installation instructions and finish with two coats of weather resistant finish as recommended by the insulation manufacturer.
  - 2. Pipe and tubing insulation:
    - a. Use proper size material. Do not stretch or strain insulation.
    - b. To avoid undue compression of insulation, provide cork stoppers or wood inserts at supports as recommended by the insulation manufacturer. Insulation shields are specified under Section 23 05 11, COMMON WORK RESULTS FOR HVAC
    - c. Where possible, slip insulation over the pipe or tubing prior to connection, and seal the butt joints with adhesive. Where the slip-on technique is not possible, slit the insulation and apply it to the pipe sealing the seam and joints with contact adhesive. Optional tape sealing, as recommended by the manufacturer, may be employed. Make changes from mineral fiber insulation in a straight run of pipe, not at a fitting. Seal joint with tape.
  - 3. Apply sheet insulation to flat or large curved surfaces with 100 percent adhesive coverage. For fittings and large pipe, apply adhesive to seams only.
  - 4. Pipe insulation: nominal thickness in millimeters (inches as specified in the schedule at the end of this section.
  - 5. Minimum 20 mm (0.75 inch) thick insulation for pneumatic control lines for a minimum distance of 6 m (20 feet) from discharge side of the refrigerated dryer.
  - 6. Use Class S (Sheet), 20 mm (3/4 inch) thick for the following:
    - a. Chilled water pumps

- b. Bottom and sides of metal basins for winterized cooling towers (where basin water is heated).
  - c. Chillers, insulate any cold chiller surfaces subject to condensation which has not been factory insulated.
  - d. Piping inside refrigerators and freezers: Provide heat tape under insulation.
7. Exposed, unlined supply and return ductwork exposed to outdoor weather: 50 mm (2 inch) thick insulation faced with a multi-layer vapor barrier with a water vapor permeance of 0.00 perms.
- H. Not Used.
- I. Calcium Silicate:
- 1. Minimum thickness in millimeter (inches) specified in the schedule at the end of this section for piping other than in boiler plant.
- See paragraphs 3.3 through 3.7 for Boiler Plant Applications.

**3.3 APPLICATION -BOILER PLANT, PIPE, VALVES, STRAINERS AND FITTINGS: NOT USED.**

**3.4 APPLICATION-BOILER FLUE GAS SYSTEMS NOT USED.**

**3.5 APPLICATION-BOILER DEAERATING FEEDWATER HEATER, TANKS NOT USED.**

**3.6 APPLICATION ON HEATED OR TRACED OIL FACILITIES OUTSIDE OF BUILDING NOT USED.**

**3.7 COMMISSIONING**

- A. Provide commissioning documentation in accordance with the requirements of section 23 08 00 - COMMISSIONING OF HVAC SYSTEMS for all inspection, start up, and contractor testing required above and required by the System Readiness Checklist provided by the Commissioning Agent.
- B. Components provided under this section of the specification will be tested as part of a larger system. Refer to section 23 08 00 - COMMISSIONING OF HVAC SYSTEMS and related sections for contractor responsibilities for system commissioning.

**3.8 PIPE INSULATION SCHEDULE**

Provide insulation for piping systems as scheduled below:

Insulation Thickness Millimeters (Inches)					
		Nominal Pipe Size Millimeters (Inches)			
Operating Temperature Range/Service	Insulation Material	Less than 25 (1)	25 - 32 (1 - 1¼)	38 - 75 (1½ - 3)	100 (4) and Above
122-177 degrees C (251-350 degrees F) (HPS, MPS)	Mineral Fiber (Above ground piping only)	75 (3)	100 (4)	113 (4.5)	113 (4.5)

93-260 degrees C (200-500 degrees F) (HPS, HPR)	Calcium Silicate	100 (4)	125 (5)	150 (6)	150 (6)
100-121 degrees C (212-250 degrees F) (HPR, MPR, LPS, vent piping from PRV Safety Valves, Condensate receivers and flash tanks)	Mineral Fiber (Above ground piping only)	62 (2.5)	62 (2.5)	75 (3.0)	75 (3.0)
38-94 degrees C (100-200 degrees F) (LPR, PC, HWH, HWHR, GH and GHR)	Mineral Fiber (Above ground piping only)	38 (1.5)	38 (1.5)	50 (2.0)	50 (2.0)
38-94 degrees C (100-200 degrees F) (LPR, PC, HWH, HWHR, GH and GHR)	Flexible Elastomeric Cellular Thermal (Above ground piping only)	38 (1.5)	38 (1.5)	----	----
(40-60 degrees F) (CH, CHR, GC, GCR and RS for DX refrigeration)	Flexible Elastomeric Cellular Thermal (Above ground piping only)	38 (1.5)	38 (1.5)	38 (1.5)	38 (1.5)

- - - E N D - - -

**SECTION 23 09 23**  
**DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. Provide (a) direct-digital control system(s) as indicated on the project documents, point list, interoperability tables, drawings and as described in these specifications. Include a complete and working direct-digital control system. Include all engineering, programming, controls and installation materials, installation labor, commissioning and start-up, training and final project documentation.
1. The direct-digital control system(s) shall consist of high-speed, peer-to-peer network of DDC controllers, and a control system server. Provide a remote user using a standard web browser to access the control system graphics and change adjustable setpoints with the proper password.
  2. The work administered by this Section of the technical specifications shall include all labor, materials, special tools, equipment, enclosures, power supplies, software, software licenses, Project specific software configurations and database entries, interfaces, wiring, tubing, installation, labeling, engineering, calibration, documentation, submittals, testing, verification, training services, permits and licenses, transportation, shipping, handling, administration, supervision, management, insurance, specified services and items required for complete and fully functional Controls Systems.
- B. Some products are not provided by, but are nevertheless integrated with the work executed by, the contractor administered by this Section of the technical specifications. The contractor administered by this Section of the technical specifications shall formally coordinate in writing and receive from other contractors formal acknowledgements in writing prior to submission the particulars of the products. These products include the following:
1. Fire alarm systems. If zoned fire alarm is required by the project-specific requirements, this interface shall require multiple relays, which are provided and installed by the fire alarm system contractor, to be monitored.
  2. Terminal units' velocity sensors
  3. Unitary HVAC equipment split systems, controls. These include:
    - a. Discharge temperature control.

- b. Economizer Control.
  - c. Flowrate control.
  - d. Setpoint reset.
  - e. Time of Day indexing.
  - f. Status alarm.
4. Variable speed motor controller (VSMC) controls by drive manufacturer. These controls, if not native Metasys, shall require a Metasys Gateway and interface card. The division 23 contractor shall furnish the VSMC's to the Division 26 contractor for installation and connection to line voltage wiring. The division 23 contractor shall make all low voltage and control connections as well as all testing, start up, and programming. The division 23 contractor shall be responsible for a fully operational VSMC system.
5. The following systems have limited control (as individually noted below) from the ECC:
- a. Constant temperature or volume rooms: temperature out of acceptable range and status alarms.
  - b. Medical gas systems (if not bottled at point of use): low pressure and status alarms.
  - c. Medical and dental vacuum systems: high pressure and status alarms.
  - d. Medical and dental compressed air systems: low pressure and status alarms.
  - e. Domestic water heating systems: low temperature, high temperature and status alarms.
  - f. Elevators: status alarms.
  - g. Building lighting systems: on/off and scene control.
  - h. Storm water removal pumps: status alarm.
  - i. Decontamination and Sterilization rooms: pressure outside of acceptable limit alarms.

C. Responsibility Table:

Work/Item/System	Furnish	Install	Low Voltage Wiring	Line Power
Control system low voltage and communication wiring	23 09 23	23 09 23	23 09 23	N/A
Terminal units	23	23	N/A	26
Controllers for terminal units	23 09 23	23 09 23	23 09 23	26



<b>Work/Item/System</b>	<b>Furnish</b>	<b>Install</b>	<b>Low Voltage Wiring</b>	<b>Line Power</b>
LAN conduits and raceway	23 09 23	23 09 23	N/A	N/A
Automatic dampers (not furnished with equipment)	23 09 23	23	N/A	N/A
Automatic damper actuators	23 09 23	23 09 23	23 09 23	23 09 23
Manual valves	23	23	N/A	N/A
Automatic valves	23 09 23	23	23 09 23	23 09 23
Pipe insertion devices and taps, flow and pressure stations.	23	23	N/A	N/A
Thermowells	23 09 23	23	N/A	N/A
Current Switches	23 09 23	23 09 23	23 09 23	N/A
Control Relays	23 09 23	23 09 23	23 09 23	N/A
Flow measuring and sensing devices, and transmitters (Air, Steam, water)	23 09 23	23 09 23	23 09 23	N/A
Power distribution system monitoring interfaces	23 09 23	23 09 23	23 09 23	26
All control system nodes, equipment, housings, enclosures and panels.	23 09 23	23 09 23	23 09 23	26
Smoke detectors	28 31 00	28 31 00	28 31 00	28 31 00
Fire/Smoke Dampers	23	23	28 31 00	28 31 00
Smoke Dampers	23	23	28 31 00	28 31 00
Fire Dampers	23	23	N/A	N/A
VSMC's	23 09 23	26	23 09 23	26
Medical gas panels	23	23	26	26
Fire Alarm shutdown relay interlock wiring	28	28	28	26
Control system monitoring of fire alarm smoke control relay	28	28	23 09 23	28
Fan Coil Unit controls (not furnished with equipment)	23 09 23	23 09 23	23 09 23	26
Unit Heater controls (not furnished with equipment)	23 09 23	23 09 23	23 09 23	26
Packaged RTU space-mounted controls (not furnished with equipment)	23 09 23	23 09 23	23 09 23	26

Work/Item/System	Furnish	Install	Low Voltage Wiring	Line Power
Package RTU unit-mounted controls (not furnished with equipment)	23 09 23	23 09 23	23 09 23	26
Digital to pneumatic transducers	23 09 23	23 09 23	23 09 23	23 09 23
Starters, HOA switches	23	23	N/A	26

- D. **Basis of Design: Metasys provided by Johnson Controls - [BUILDING STANDARD - NO SUBSTITUTE]**. This facility's existing direct-digital control system is manufactured by Johnson Controls. The local Johnson Controls contact is C.J. Goddard at (319)350-4583. The existing system's top-end communications is via Metasys. The contractor administered by this Section of the technical specifications shall observe the capabilities, communication network, services, spare capacity of the existing control system and its ECC prior to beginning work.
1. This project is to connect to the existing direct-digital control system. Coordinate with VA personnel to determine all requirements for proper integration and miscellaneous items not specified.
  2. Leave existing direct digital system intact and in place. Upgrade the existing direct digital control system's only as required to add/connect this project to the existing direct digital control system. Where required, connect to existing pneumatic systems with digital to pneumatic transducers for connection of new direct digital controlled equipment.
- E. This campus has standardized on an existing standard Metasys System supported by a pre-selected controls service company. This entity is referred to as the "Control System Integrator" in this Section of the technical specifications. The Control system integrator is responsible for ECC system graphics and expansion. It also prescribes control system-specific commissioning/ verification procedures to the contractor administered by this Section of the technical specification. It lastly provides limited assistance to the contractor administered by this Section of the technical specification in its commissioning/verification work.

1. The General Contractor of this project shall directly hire the Control System Integrator in a contract separate from the contract procuring the controls contractor administered by this Section of the technical specifications.
2. The contractor administered by this Section of the technical specifications shall coordinate all work with the Control System Integrator. The contractor administered by this Section of the technical specifications shall integrate the Metasys IP control network(s) with the Control System Integrator's area control through an Ethernet connection provided by the Control System Integrator.
3. The contractor administered by this Section of the technical specifications shall provide a peer-to-peer networked, stand-alone, distributed control system. This direct digital control (DDC) system shall include microprocessor-based controllers, instrumentation, end control devices, wiring, piping, software, and related systems. This contractor is responsible for all device mounting and wiring.
4. Responsibility Table:

Item/Task	Section 23 09 23 contractor	Control system integrator	VA
ECC Expansion		X	
ECC programming		X	
Devices, controllers, control panels and equipment	X		
Point addressing: all hardware and software points including setpoint, calculated point, data point (analog/binary), and reset schedule point	X		
Point mapping		X	
Network Programming	X		
ECC Graphics		X	
Controller programming and sequences	X		
Integrity of LAN communications	X		
Electrical wiring	X		
Operator system training		X	
LAN connections to devices	X		
LAN connections to ECC		X	
IP addresses			X
Overall system verification		X	
Controller and LAN system verification	X		

- F. Unitary standalone systems including Unit Heaters, Cabinet Unit Heaters, Fan Coil Units, Base Board Heaters, thermal comfort ventilation fans, and similar units for control of room environment conditions may be equipped with integral controls furnished and installed by the equipment manufacturer or field mounted. Refer to equipment specifications and as indicated in project documents. Application of standalone unitary controls is limited to at least those systems wherein remote monitoring, alarm and start-up are not necessary. Examples of such systems include:
1. Light-switch-operated toilet exhaust
  2. Vestibule heater
  3. Exterior stair heater
  4. Attic heating and ventilation
  5. Mechanical or electrical room heating and ventilation.
- I. The direct-digital control system shall start and stop equipment, move (position) damper actuators and valve actuators, and vary speed of equipment to execute the mission of the control system. Use electricity as the motive force for all damper and valve actuators, unless use of pneumatics as motive force is specifically granted by the VA.

## **1.2 RELATED WORK**

- A. Section 21 05 11, Common Work Results for Fire Suppression.
- B. Not Used.
- C. Not Used.
- D. Section 21 10 00, Water-Based Fire-Suppression Systems.
- E. Not Used.
- F. Not Used.
- G. Not Used.
- H. Section 22 62 00, Vacuum Systems for Laboratory and Healthcare Facilities.
- I. Section 22 63 00, Gas Systems for Laboratory and Healthcare Facilities.
- J. Not Used.
- K. Section 23 21 13, Hydronic Piping.
- L. Section 23 22 13, Steam and Condensate Heating Piping.
- M. Section 23 31 00, HVAC Ducts and Casings.
- N. Section 23 36 00, Air Terminal Units.
- O. Section 23 74 13, Packaged, Outdoor, Central Station Air-Handling Units
- P. Section 23 81 43, Air-Source Unitary Heat Pumps.
- Q. Section 26 05 11, Requirements for Electrical Installations.

- R. Section 26 05 19, Low-Voltage Electrical Power Conductors and Cables (600 Volts and Below).
- S. Section 26 05 26, Grounding and Bonding for Electrical Systems.
- T. Section 26 05 33, Raceway and Boxes for Electrical Systems.
- U. Section 26 09 23, Lighting Controls.
- V. Section 26 24 16, Panelboards
- W. Section 26 27 26, Wiring Devices.
- X. Section 26 29 11, Motor Starters.
- Y. Section 27 15 00, Communications Horizontal Cabling
- Z. Section 28 31 00, Fire Detection and Alarm.

## 1.2 DEFINITION

- A. Algorithm: A logical procedure for solving a recurrent mathematical problem; A prescribed set of well-defined rules or processes for the solution of a problem in a finite number of steps.
- B. ARCNET: ANSI/ATA 878.1 - Attached Resource Computer Network. ARCNET is a deterministic LAN technology; meaning it's possible to determine the maximum delay before a device is able to transmit a message.
- C. Analog: A continuously varying signal value (e.g., temperature, current, velocity etc.
- D. Not Used.
- E. Not Used.
- F. Not Used.
- G. Not Used.
- H. Not Used.
- I. Not Used.
- J. Not Used.
- K. Not Used.
- L. Baud: It is a signal change in a communication link. One signal change can represent one or more bits of information depending on type of transmission scheme. Simple peripheral communication is normally one bit per Baud. (e.g., Baud rate = 78,000 Baud/sec is 78,000 bits/sec, if one signal change = 1 bit).
- M. Binary: A two-state system where a high signal level represents an "ON" condition and an "OFF" condition is represented by a low signal level.
- N. BMP or bmp: Suffix, computerized image file, used after the period in a DOS-based computer file to show that the file is an image stored as a series of pixels.

- O. Bus Topology: A network topology that physically interconnects workstations and network devices in parallel on a network segment.
- P. Control Unit (CU): Generic term for any controlling unit, stand-alone, microprocessor based, digital controller residing on secondary LAN or Primary LAN, used for local controls or global controls
- Q. Deadband: A temperature range over which no heating or cooling is supplied, i.e., 22-25 degrees C (72-78 degrees F), as opposed to a single point change over or overlap).
- R. Device: a control system component that contains a BACnet Device Object and uses BACnet to communicate with other devices.
- S. Device Object: Every Metasys device requires one Device Object, whose properties represent the network visible properties of that device. Every Device Object requires a unique Object Identifier number on the Metasys internetwork. This number is often referred to as the device instance.
- T. Diagnostic Program: A software test program, which is used to detect and report system or peripheral malfunctions and failures. Generally, this system is performed at the initial startup of the system.
- U. Not Used.
- V. Direct Digital Control (DDC): Microprocessor based control including Analog/Digital conversion and program logic. A control loop or subsystem in which digital and analog information is received and processed by a microprocessor, and digital control signals are generated based on control algorithms and transmitted to field devices in order to achieve a set of predefined conditions.
- W. Distributed Control System: A system in which the processing of system data is decentralized and control decisions can and are made at the subsystem level. System operational programs and information are provided to the remote subsystems and status is reported back to the Engineering Control Center. Upon the loss of communication with the Engineering Control center, the subsystems shall be capable of operating in a stand-alone mode using the last best available data.
- X. Download: The electronic transfer of programs and data files from a central computer or operation workstation with secondary memory devices to remote computers in a network (distributed) system.
- Y. DXF: An AutoCAD 2-D graphics file format. Many CAD systems import and export the DXF format for graphics interchange.

- Z. Electrical Control: A control circuit that operates on line or low voltage and uses a mechanical means, such as a temperature sensitive bimetal or bellows, to perform control functions, such as actuating a switch or positioning a potentiometer.
- AA. Electronic Control: A control circuit that operates on low voltage and uses a solid-state components to amplify input signals and perform control functions, such as operating a relay or providing an output signal to position an actuator.
- BB. Engineering Control Center (ECC): The centralized control point for the intelligent control network. The ECC comprises of personal computer and connected devices to form a single workstation.
- CC. Ethernet: A trademark for a system for exchanging messages between computers on a local area network using coaxial, fiber optic, or twisted-pair cables.
- DD. Firmware: Firmware is software programmed into read only memory (ROM) chips. Software may not be changed without physically altering the chip.
- EE. Gateway: Communication hardware connecting two or more different protocols. It translates one protocol into equivalent concepts for the other protocol. In Metasys applications, a gateway has Metasys on one side and non-Metasys (usually proprietary) protocols on the other side.
- FF. GIF: Abbreviation of Graphic interchange format.
- GG. Graphic Program (GP): Program used to produce images of air handler systems, fans, chillers, pumps, and building spaces. These images can be animated and/or color-coded to indicate operation of the equipment.
- HH. Graphic Sequence of Operation: It is a graphical representation of the sequence of operation, showing all inputs and output logical blocks.
- II. I/O Unit: The section of a digital control system through which information is received and transmitted. I/O refers to analog input (AI, digital input (DI), analog output (AO) and digital output (DO). Analog signals are continuous and represent temperature, pressure, flow rate etc, whereas digital signals convert electronic signals to digital pulses (values), represent motor status, filter status, on-off equipment etc.
- JJ. I/P: a method for conveying and routing packets of information over LAN paths. User Datagram Protocol (UDP) conveys information to "sockets" without confirmation of receipt. Transmission Control Protocol (TCP) establishes "sessions", which have end-to-end confirmation and guaranteed sequence of delivery.

- KK. JPEG: A standardized image compression mechanism stands for Joint Photographic Experts Group, the original name of the committee that wrote the standard.
- LL. Local Area Network (LAN): A communication bus that interconnects operator workstation and digital controllers for peer-to-peer communications, sharing resources and exchanging information.
- MM. Network Repeater: A device that receives data packet from one network and rebroadcasts to another network. No routing information is added to the protocol.
- NN. MS/TP: Master-slave/token-passing (ISO/IEC 8802, Part 3). It is not an acceptable LAN option for VA health-care facilities. It uses twisted pair wiring for relatively low speed and low cost communication.
- OO. Network Number: A site-specific number assigned to each network segment to identify for routing. This network number must be unique throughout the BACnet internetwork.
- PP. Not Used.
- QQ. Object Identifier: An object property used to identify the object, including object type and instance. Object Identifiers must be unique within a device.
- RR. Object Properties: Attributes of an object. Examples include present value and high limit properties of an analog input object. Properties are defined in ASHRAE 135; some are optional and some are required. Objects are controlled by reading from and writing to object properties.
- SS. Operating system (OS): Software, which controls the execution of computer application programs.
- TT. PCX: File type for an image file. When photographs are scanned onto a personal computer they can be saved as PCX files and viewed or changed by a special application program as Photo Shop.
- UU. Peripheral: Different components that make the control system function as one unit. Peripherals include monitor, printer, and I/O unit.
- VV. Peer-to-Peer: A networking architecture that treats all network stations as equal partners- any device can initiate and respond to communication with other devices.
- WW. PICS: Protocol Implementation Conformance Statement, describing the BACnet capabilities of a device. All BACnet devices have published PICS.
- XX. PID: Proportional, integral, and derivative control, used to control modulating equipment to maintain a setpoint.



YY. Repeater: A network component that connects two or more physical segments at the physical layer.

ZZ. Router: a component that joins together two or more networks using different LAN technologies. Examples include joining a BACnet Ethernet LAN to a BACnet MS/TP LAN.

AAA. Sensors: devices measuring state points or flows, which are then transmitted back to the DDC system.

BBB. Thermostats: devices measuring temperatures, which are used in control of standalone or unitary systems and equipment not attached to the DDC system.

#### **1.4 QUALITY ASSURANCE**

##### **A. Criteria:**

1. Single Source Responsibility of subcontractor: The Contractor shall obtain hardware and software supplied under this Section and delegate the responsibility to a single source controls installation subcontractor. The controls subcontractor shall be responsible for the complete design, installation, and commissioning of the system. The controls subcontractor shall be in the business of design, installation and service of such building automation control systems similar in size and complexity.
2. Equipment and Materials: Equipment and materials shall be cataloged products of manufacturers regularly engaged in production and installation of HVAC control systems. Products shall be manufacturer's latest standard design and have been tested and proven in actual use.
3. The controls subcontractor shall provide a list of no less than five similar projects which have building control systems as specified in this Section. These projects must be on-line and functional such that the Department of Veterans Affairs (VA) representative would observe the control systems in full operation.
4. The controls subcontractor shall have in-place facility within 50 miles with technical staff, spare parts inventory for the next five (5) years, and necessary test and diagnostic equipment to support the control systems.

5. The controls subcontractor shall have minimum of three years experience in design and installation of building automation systems similar in performance to those specified in this Section. Provide evidence of experience by submitting resumes of the project manager, the local branch manager, project engineer, the application engineering staff, and the electronic technicians who would be involved with the supervision, the engineering, and the installation of the control systems. Training and experience of these personnel shall not be less than three years. Failure to disclose this information will be a ground for disqualification of the supplier.
6. Provide a competent and experienced Project Manager employed by the Controls Contractor. The Project Manager shall be supported as necessary by other Contractor employees in order to provide professional engineering, technical and management service for the work. The Project Manager shall attend scheduled Project Meetings as required and shall be empowered to make technical, scheduling and related decisions on behalf of the Controls Contractor.

B. Codes and Standards:

1. All work shall conform to the applicable Codes and Standards.
2. Electronic equipment shall conform to the requirements of FCC Regulation, Part 15, Governing Radio Frequency Electromagnetic Interference, and be so labeled.
3. Refer to specifications section 26 29 11, 1.5 for additional applicable publications.

### **1.5 PERFORMANCE**

A. The system shall conform to the following:

1. Graphic Display: The system shall display up to four (4) graphics on a single screen with a minimum of twenty (20) dynamic points per graphic. All current data shall be displayed within ten (10) seconds of the request.
2. Graphic Refresh: The system shall update all dynamic points with current data within eight (8) seconds. Data refresh shall be automatic, without operator intervention.
3. Object Command: The maximum time between the command of a binary object by the operator and the reaction by the device shall be two (2) seconds. Analog objects shall start to adjust within two (2) seconds.

4. Object Scan: All changes of state and change of analog values shall be transmitted over the high-speed network such that any data used or displayed at a controller or work-station will be current, within the prior six (6) seconds.
5. Alarm Response Time: The maximum time from when an object goes into alarm to when it is annunciated at the workstation shall not exceed (10) seconds.
6. Program Execution Frequency: Custom and standard applications shall be capable of running as often as once every (5) seconds. The Contractor shall be responsible for selecting execution times consistent with the mechanical process under control.
7. Multiple Alarm Annunciations: All workstations on the network shall receive alarms within five (5) seconds of each other.
8. Performance: Programmable Controllers shall be able to execute DDC PID control loops at a selectable frequency from at least once every one (1) second. The controller shall scan and update the process value and output generated by this calculation at this same frequency.
9. Reporting Accuracy: Listed below are minimum acceptable reporting end-to-end accuracies for all values reported by the specified system:

Measured Variable	Reported Accuracy
Space temperature	$\pm 0.5^{\circ}\text{C}$ ( $\pm 1^{\circ}\text{F}$ )
Ducted air temperature	$\pm 0.5^{\circ}\text{C}$ [ $\pm 1^{\circ}\text{F}$ ]
Outdoor air temperature	$\pm 1.0^{\circ}\text{C}$ [ $\pm 2^{\circ}\text{F}$ ]
Dew Point	$\pm 1.5^{\circ}\text{C}$ [ $\pm 3^{\circ}\text{F}$ ]
Water temperature	$\pm 0.5^{\circ}\text{C}$ [ $\pm 1^{\circ}\text{F}$ ]
Relative humidity	$\pm 2\%$ RH
Water flow	$\pm 1\%$ of reading
Air flow (terminal)	$\pm 10\%$ of reading
Air flow (measuring stations)	$\pm 5\%$ of reading
Carbon Monoxide (CO)	$\pm 5\%$ of reading
Carbon Dioxide (CO <sub>2</sub> )	$\pm 50$ ppm
Air pressure (ducts)	$\pm 25$ Pa [ $\pm 0.1$ "w.c.]
Air pressure (space)	$\pm 0.3$ Pa [ $\pm 0.001$ "w.c.]
Water pressure	$\pm 2\%$ of full scale *Note 1
Electrical Power	$\pm 0.5\%$ of reading

Note 1: for both absolute and differential pressure

10. Control stability and accuracy: Control sequences shall maintain measured variable at setpoint within the following tolerances:

Controlled Variable	Control Accuracy	Range of Medium
Air Pressure	$\pm 50$ Pa ( $\pm 0.2$ in. w.g.)	0-1.5 kPa (0-6 in. w.g.)
Air Pressure	$\pm 3$ Pa ( $\pm 0.01$ in. w.g.)	-25 to 25 Pa (-0.1 to 0.1 in. w.g.)
Airflow	$\pm 10\%$ of full scale	
Space Temperature	$\pm 1.0^{\circ}\text{C}$ ( $\pm 2.0^{\circ}\text{F}$ )	
Duct Temperature	$\pm 1.5^{\circ}\text{C}$ ( $\pm 3^{\circ}\text{F}$ )	
Humidity	$\pm 5\%$ RH	
Fluid Pressure	$\pm 10$ kPa ( $\pm 1.5$ psi)	0-1 MPa (1-150 psi)
Fluid Pressure	$\pm 250$ Pa ( $\pm 1.0$ in. w.g.)	0-12.5 kPa (0-50 in. w.g.) differential

11. Extent of direct digital control: control design shall allow for at least the points indicated on the points lists on the drawings.

#### 1.6 WARRANTY

- A. Labor and materials for control systems shall be warranted for a period as specified under Warranty.
- B. Control system failures during the warranty period shall be adjusted, repaired, or replaced at no cost or reduction in service to the Owner. The system includes all computer equipment, transmission equipment, and all sensors and control devices.
- C. Controls and Instrumentation subcontractor shall be responsible for temporary operations and maintenance of the control systems during the construction period until final commissioning, training of facility operators and acceptance of the project by VA.

#### 1.7 SUBMITTALS

- A. Submit shop drawings in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturer's literature and data for all components including the following:

1. A wiring diagram for each type of input device and output device including DDC controllers, modems, repeaters, etc. Diagram shall show how the device is wired and powered, showing typical connections at the digital controllers and each power supply, as well as the device itself. Show for all field connected devices, including but not limited to, control relays, motor starters, electric or electronic actuators, and temperature pressure, flow and humidity sensors and transmitters.
2. A diagram of each terminal strip, including digital controller terminal strips, terminal strip location, termination numbers and the associated point names.
3. Control dampers and control valves schedule, including the size and pressure drop.
4. Control air-supply components, and computations for sizing compressors, receivers and main air-piping, if pneumatic controls are furnished.
5. Catalog cut sheets of all equipment used. This includes, but is not limited to software (by manufacturer and by third parties), DDC controllers, panels, peripherals, airflow measuring stations and associated components, and auxiliary control devices such as sensors, actuators, and control dampers. When manufacturer's cut sheets apply to a product series rather than a specific product, the data specifically applicable to the project shall be highlighted. Each submitted piece of literature and drawings should clearly reference the specification and/or drawings that it supposed to represent.
6. Sequence of operations for each HVAC system and the associated control diagrams. Equipment and control labels shall correspond to those shown on the drawings.
7. Color prints of proposed graphics with a list of points for display.
8. Schematic wiring diagrams for all control, communication and power wiring. Provide a schematic drawing of the central system installation. Label all cables and ports with computer manufacturers' model numbers and functions. Show all interface wiring to the control system.
9. Not Used.

10. An instrumentation list for each controlled system. Each element of the controlled system shall be listed in table format. The table shall show element name, type of device, manufacturer, model number, and product data sheet number.
  11. Riser diagrams of wiring between central control unit and all control panels.
  12. Scaled plan drawings showing routing of LAN and locations of control panels, controllers, routers, gateways, ECC, and larger controlled devices.
  13. Construction details for all installed conduit, cabling, raceway, cabinets, and similar. Construction details of all penetrations and their protection.
  14. Quantities of submitted items may be reviewed but are the responsibility of the contractor administered by this Section of the technical specifications.
- C. Product Certificates: Compliance with Article, QUALITY ASSURANCE.
- D. Licenses: Provide licenses for all software residing on and used by the Controls Systems and transfer these licenses to the Owner prior to completion.
- E. As Built Control Drawings:
1. Furnish three (3) copies of as-built drawings for each control system. The documents shall be submitted for approval prior to final completion.
  2. Furnish one (1) stick set of applicable control system prints for each mechanical system for wall mounting. The documents shall be submitted for approval prior to final completion.
  3. Furnish one (1) CD-ROM in CAD DWG and/or .DXF format for the drawings noted in subparagraphs above.
- F. Operation and Maintenance (O/M) Manuals):
1. Submit in accordance with Article, INSTRUCTIONS, in Specification Section 01 00 00, GENERAL REQUIREMENTS.
  2. Include the following documentation:
    - a. General description and specifications for all components, including logging on/off, alarm handling, producing trend reports, overriding computer control, and changing set points and other variables.

- b. Detailed illustrations of all the control systems specified for ease of maintenance and repair/replacement procedures, and complete calibration procedures.
  - c. One copy of the final version of all software provided including operating systems, programming language, operator workstation software, and graphics software.
  - d. Complete troubleshooting procedures and guidelines for all systems.
  - e. Complete operating instructions for all systems.
  - f. Recommended preventive maintenance procedures for all system components including a schedule of tasks for inspection, cleaning and calibration. Provide a list of recommended spare parts needed to minimize downtime.
  - g. Training Manuals: Submit the course outline and training material to the Owner for approval three (3) weeks prior to the training to VA facility personnel. These persons will be responsible for maintaining and the operation of the control systems, including programming. The Owner reserves the right to modify any or all of the course outline and training material.
  - h. Licenses, guaranty, and other pertaining documents for all equipment and systems.
- G. Submit Performance Report to Project Manager prior to final inspection.

#### **1.8 INSTRUCTIONS**

- A. Instructions to VA operations personnel: Perform in accordance with Article, INSTRUCTIONS, in Specification Section 01 00 00, GENERAL REQUIREMENTS, and as noted below. Contractor shall also video tape instruction sessions noted below.
1. First Phase: Formal instructions to the VA facilities personnel for a total of 16 hours, given in multiple training sessions (each no longer than four hours in length), conducted sometime between the completed installation and prior to the performance test period of the control system, at a time mutually agreeable to the Contractor and the VA.

2. Second Phase: This phase of training shall comprise of on the job training during start-up, checkout period, and performance test period. VA facilities personnel will work with the Contractor's installation and test personnel on a daily basis during start-up and checkout period. During the performance test period, controls subcontractor will provide 32 hours of instructions, given in multiple training sessions (each no longer than four hours in length), to the VA facilities personnel.
3. The O/M Manuals shall contain approved submittals as outlined in Article 1.7, SUBMITTALS. The Controls subcontractor will review the manual contents with VA facilities personnel during second phase of training.
4. Training shall be given by direct employees of the controls system subcontractor.

#### **1.9 PROJECT CONDITIONS (ENVIRONMENTAL CONDITIONS OF OPERATION)**

- A. The peripheral devices and system support equipment shall be designed to operate in ambient condition of 20 to 35°C (65 to 90°F) at a relative humidity of 20 to 80% non-condensing.
- B. The CUs used outdoors shall be mounted in NEMA 4 waterproof enclosures, and shall be rated for operation at -40 to 65°C (-40 to 150°F).
- C. All electronic equipment shall operate properly with power fluctuations of plus 10 percent to minus 15 percent of nominal supply voltage.
- D. Sensors and controlling devices shall be designed to operate in the environment, which they are sensing or controlling.

#### **1.10 APPLICABLE PUBLICATIONS**

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American Society of Heating, Refrigerating, and Air-Conditioning Engineers (ASHRAE):
- C. American Society of Mechanical Engineers (ASME):
  - B16.18-01 .....Cast Copper Alloy Solder Joint Pressure Fittings.
  - B16.22-01 .....Wrought Copper and Copper Alloy Solder Joint Pressure Fittings.
- D. American Society of Testing Materials (ASTM):
  - B32-08 .....Standard Specification for Solder Metal
  - B88-09 .....Standard Specifications for Seamless Copper Water Tube
  - B88M-09 .....Standard Specification for Seamless Copper Water Tube (Metric)



- B280-08 .....Standard Specification for Seamless Copper Tube  
for Air-Conditioning and Refrigeration Field  
Service
- D2737-03 .....Standard Specification for Polyethylene (PE)  
Plastic Tubing
- E. Federal Communication Commission (FCC):
- Rules and Regulations Title 47 Chapter 1-2001 Part 15: Radio Frequency  
Devices.
- F. Institute of Electrical and Electronic Engineers (IEEE):
- 802.3-11 .....Information Technology-Telecommunications and  
Information Exchange between Systems-Local and  
Metropolitan Area Networks- Specific  
Requirements-Part 3: Carrier Sense Multiple  
Access with Collision Detection (CSMA/CD) Access  
method and Physical Layer Specifications
- G. National Fire Protection Association (NFPA):
- 70-11 .....National Electric Code
- 90A-09 .....Standard for Installation of Air-Conditioning and  
Ventilation Systems
- H. Underwriter Laboratories Inc (UL):
- 94-10 .....Tests for Flammability of Plastic Materials for  
Parts and Devices and Appliances
- 294-10 .....Access Control System Units
- 486A/486B-10 .....Wire Connectors
- 555S-11 .....Standard for Smoke Dampers
- 916-10 .....Energy Management Equipment
- 1076-10 .....Proprietary Burglar Alarm Units and Systems

## **PART 2 - PRODUCTS**

### **2.1 MATERIALS**

- A. Use new products that the manufacturer is currently manufacturing and  
that have been installed in a minimum of 25 installations. Spare parts  
shall be available for at least five years after completion of this  
contract.

### **2.2 CONTROLS SYSTEM ARCHITECTURE**

#### **A. General**

1. The Controls Systems shall consist of multiple Nodes and associated  
equipment connected by industry standard digital and communication  
network arrangements.
2. The building controllers and principal communications network  
equipment shall be standard products of recognized major manufacturers  
available through normal PC and computer vendor channels - not  
"Clones" assembled by a third-party subcontractor.
3. The networks shall, at minimum, comprise, as necessary, the following:

- a. Not Used.
  - b. Network computer processing, data storage and BACnet-compliant communication equipment including Servers and digital data processors.
  - c. Metasys-compliant routers, bridges, switches, hubs, modems, gateways, interfaces and similar communication equipment.
  - d. Active processing Metasys-compliant building controllers connected to other Metasys-compliant controllers together with their power supplies and associated equipment.
  - e. Addressable elements, sensors, transducers and end devices.
  - f. Third-party equipment interfaces and gateways as described and required by the Contract Documents.
  - g. Other components required for a complete and working Control Systems as specified.
- B. The Specifications for the individual elements and component subsystems shall be minimum requirements and shall be augmented as necessary by the Contractor to achieve both compliance with all applicable codes, standards and to meet all requirements of the Contract Documents.
- C. Network Architecture
- 1. The Controls communication network shall utilize Metasys communications protocol operating over a standard Ethernet LAN and operate at a minimum speed of 100 Mb/sec.
  - 2. The networks shall utilize only copper and optical fiber communication media as appropriate and shall comply with applicable codes, ordinances and regulations.
  - 3. All necessary telephone lines, ISDN lines and internet Service Provider services and connections will be provided by the VA.
- D. Third Party Interfaces:
- 1. The contractor administered by this Section of the technical specifications shall include necessary hardware, equipment, software and programming to allow data communications between the controls systems and building systems supplied by other trades.
  - 2. Other manufacturers and contractors supplying other associated systems and equipment shall provide their necessary hardware, software and start-up at their cost and shall cooperate fully with the contractor administered by this Section of the technical specifications in a timely manner and at their cost to ensure complete functional integration.

### 2.3 COMMUNICATION

- A. Control products, communication media, connectors, repeaters, hubs, and routers shall comprise a Metasys internetwork.
- B. Each controller shall have a communication port for connection to an operator interface.
- C. Internetwork operator interface and value passing shall be transparent to internetwork architecture.
  - 1. An operator interface connected to a controller shall allow the operator to interface with each internetwork controller as if directly connected. Controller information such as data, status, reports, system software, and custom programs shall be viewable and editable from each internetwork controller.
  - 2. Inputs, outputs, and control variables used to integrate control strategies across multiple controllers shall be readable by each controller on the internetwork. Program and test all cross-controller links required to execute specified control system operation. An authorized operator shall be able to edit cross-controller links by typing a standard object address.
- E. System shall be expandable to at least twice the required input and output objects with additional controllers, associated devices, and wiring. Expansion shall not require operator interface hardware additions or software revisions.
- F. Controllers with real-time clocks shall use the BACnet Time Synchronization service. The system shall automatically synchronize system clocks daily from an operator-designated device via the internetwork. The system shall automatically adjust for daylight savings and standard time as applicable.

### 2.7 NETWORK AND DEVICE NAMING CONVENTION

- A. Network Numbers
  - 1. Metasys network numbers shall be based on a "facility code, network" concept. The "facility code" is the VAMC's or VA campus' assigned numeric value assigned to a specific facility or building. The "network" typically corresponds to a "floor" or other logical configuration within the building. Verify existing standards.
- B. Not Used.
- C. Device Names

1. Name the control devices based on facility name, location within a facility, the system or systems that the device monitors and/or controls, or the area served. The intent of the device naming is to be easily recognized. Names can be up to 254 characters in length, without embedded spaces. Provide the shortest descriptive, but unambiguous, name. For example, in building #123 prefix the number with a "B" followed by the building number, if there is only one chilled water pump "CHWP-1", a valid name would be "B123.CHWP.1.STARTSTOP". If there are two pumps designated "CHWP-1", one in a basement mechanical room (Room 0001) and one in a penthouse mechanical room (Room PH01), the names could be "B123.R0001.CHWP.1. STARTSTOP" or "B123.RPH01.CHWP.1.STARTSTOP". In the case of unitary controllers, for example a VAV box controller, a name might be "B123.R101.VAV".

## **2.8 VARIABLE SPEED MOTOR CONTROLLER (VSMC)**

- A. VSMC shall be in accordance with applicable portions of this specification. The VSMC package as specified herein shall be enclosed in a UL NEMA Type 1 enclosure (enclosures with only NEMA ratings are not acceptable), completely assembled and tested by the manufacturer in an ISO9001 facility.
- B. Maximum physical size of each unit:
  1. 1-15 HP: 12 inches deep, 16 inches wide, 30 inches high.
  2. 20-50 HP: 13 inches deep, 16 inches wide, 46 inches high.

An integrated enclosure extender box shall be provided to contain the Motor Circuit Protector, the bypass and the reactor for each VSMC.
- C. VSMC shall be electronic, with adjustable frequency and voltage, three phase output, capable of driving standard NEMA B three-phase induction motors at full rated speed. The control technique shall be pulse width modulation (PWM), where the VSMC utilizes a full wave bridge design incorporating diode rectifier circuitry. Silicon controlled rectifiers or other control techniques are not acceptable.
- D. VSMC shall be suitable for variable torque loads, and shall be capable of providing sufficient torque to allow the motor to break away from rest upon first application of power. VSMCs and options shall be UL508 listed as a complete assembly. The base VSMC shall be UL listed for 100 kA SCCR without the need for external input fuses

- E. VSMC shall be capable of operating within voltage parameters of plus 10 to minus 10 percent of line voltage, and be suitably rated for the full load amps of the maximum watts (HP) within its class. The VSMC shall continue to operate without faulting from a line of +30% to -35% of nominal voltage.
- F. Minimum efficiency shall be 95 percent at 100 percent speed and 85 percent at 50 percent speed.
- G. The displacement power factor of the VSMC shall not be less than 95 percent under any speed or load condition.
- H. VSMC current and voltage harmonic distortion shall not exceed the values allowed by IEEE 519. Have internal swinging (non-linear) chokes providing impedance equivalent to 5% to reduce the harmonics to the power line. Swinging choke shall be required resulting in superior partial load harmonic reduction. Linear chokes are not acceptable. 5% impedance may be from dual (positive and negative DC bus) chokes, or 5% swinging AC line chokes. VSMC's with only one DC choke shall add an AC line choke.
- I. Operating and Design Conditions:
  - 1. -15 to 40° C (5 to 104° F) ambient temperature. Operation to 50° C shall be allowed with a 10% reduction from VSMC full load current.
  - 2. Altitude 0 to 3300 feet above sea level. Operation to 6600 shall be allowed with a 10% reduction from VSMC full load current.
  - 3. Humidity less than 95%, non-condensing.
  - 4. Input frequency tolerance shall be +/- 2 Hz.
  - 5. Efficiency shall be a minimum of 95% at full load at full speed. Displacement power factor shall be greater than .95 lagging over the entire speed range.
  - 6. The drive overload current shall be 100% continuous and 110% for 1 minute.
- J. VSMC shall have the following features:

1. Isolated power for control circuits.
2. All circuit boards shall be coated to protect against corrosion.
3. Manually resettable overload protection for each phase.
4. Adjustable current limiting circuitry to provide soft motor starting. Maximum starting current shall not exceed 200 percent of motor full load current.
5. Independent acceleration and deceleration time adjustment, manually adjustable from 2 to 2000 seconds. Set timers to the equipment manufacturer's recommended time in the above range.
6. Control input circuitry that will accept 4 to 20 mA current or 0-10 VDC voltage control signals from an external source.
7. Automatic frequency adjustment from 1 Hz to 300 Hz.
8. Circuitry to initiate an orderly shutdown when any of the conditions listed below occurs. The VSMC shall not be damaged by any of these electrical disturbances and shall automatically restart when the conditions are corrected. The VSMC shall be able to restart into a rotating motor operating in either the forward or reverse direction and matching that frequency.
  - a. Incorrect phase sequence.
  - b. Single phasing.
  - c. Over-voltage in excess of 10 percent.
  - d. Under-voltage in excess of 15 percent.
  - e. Running overcurrent above 110 percent (VSMC shall not automatically reset for this condition.)
  - f. Instantaneous overcurrent above 150 percent (VSMC shall not automatically reset for this condition).
  - g. Short duration power outages of 12 cycles or less (i.e., distribution line switching, generator testing, and automatic transfer switch operations.)
9. Provide automatic shutdown upon receiving a power transfer warning signal from an automatic transfer switch. VSMC shall automatically restart motor after the power transfer.
10. Automatic Reset/Restart: Attempt three restarts after VSMC fault or on return of power after an interruption and before shutting down for manual reset or fault correction, with adjustable delay time between restart attempts.

11. Bidirectional Autospeed Search: Capable of starting VSMC into rotating loads spinning in either direction and returning motor to set speed in proper direction, without causing damage to VSMC, motor, or load.
12. The Maximum Short Circuit Current Rating of the entire VSMC assembly shall be 100,000 RMS symmetrical for all ratings.
13. Input fuses shall be provided for all integrated enclosures.
- K. VSMC shall include an input circuit breaker which will disconnect all input power, interlocked with the door so that the door cannot be opened with the circuit breaker in the closed position.
- L. VSMC shall include a 5% line reactor and a built-in RFI/EMI filter. All VSMC's shall include EMI/RFI filters. The onboard filters shall allow the VSMC assembly to be CE Marked and the VSMC shall meet product standard EN 61800-3 for the First Environment restricted level (Category C2) with up to 100 feet of motor cable.
- M. VSMC shall include three-phase protection against damage from supply voltage surges in accordance with UL 1449. The VSMC shall include a coordinated AC transient surge protection system consisting of 4 MOVs (phase to phase and phase to ground), a capacitor clamp, 1600 PIV Diode Bridge and internal chokes. The MOV's shall have a minimum 125 joule rating per phase across the diode bridge. VSMCs that do not include coordinated AC transient surge protection shall include an external TVSS (Transient Voltage Surge Suppressor).
- N. VSMC shall include front-accessible operator station, with sealed backlit removable keypad and digital LCD display, which allows complete programming, operating, monitoring, and diagnostic capabilities. Capable of remote mounting and allow for uploading and downloading of parameter settings as an aid for start-up of multiple VSMCs. Access to the operator control station shall be available without opening the door of the VSMC. The keypad shall include a Local/Remote key to toggle the system to and from the Local and Remote modes.
  1. Typical control functions shall include but not be limited to:
    - a. HAND-OFF-AUTOMATIC-RESET, with manual speed control in HAND mode. The drive shall incorporate "bumpless transfer" of speed reference when switching between "Hand" and "Auto" modes. There shall be fault reset and "Help" buttons on the keypad. The Help

- button shall include "on-line" assistance for programming and troubleshooting.
- b. NORMAL-BYPASS.
- c. NORMAL-TEST, which allows testing and adjusting of the VSMC while in bypass mode.
- d. There shall be a built-in time clock in the VSMC keypad. The clock shall have a battery backup with 10 years minimum life span. The clock shall be used to date and time stamp faults and record operating parameters at the time of fault. VSMC programming shall be held in non-volatile memory and is not dependent on battery power.
- e. The keypad shall include a minimum of 14 assistants including:
  - 1) Start-up assistant
  - 2) Parameter assistants
    - a) PID assistant
    - b) Reference assistant
    - c) I/O assistant
    - d) Serial communications assistant
    - e) Option module assistant
    - f) Panel display assistant
    - g) Low noise set-up assistant
  - 3) Maintenance assistant
  - 4) Troubleshooting assistant
  - 5) Drive optimizer assistants
- 2. Typical monitoring functions shall include but not be limited to:
  - a. Output frequency (Hz).
  - b. Motor speed and status (run, stop, fault).
  - c. Output voltage and current.
  - d. Motor Torque
  - e. Motor Power (kW)
  - f. DC Bus Voltage
- 3. Typical fault and alarm functions shall include but not be limited to:
  - a. Loss of input signal, under- and over-voltage, inverter overcurrent, motor overload, critical frequency rejection with selectable and adjustable deadbands, instantaneous line-to-line



and line-to-ground overcurrent, loss-of-phase, reverse-phase, and short circuit.

- b. System protection indicators indicating that the system has shutdown and will not automatically restart.
- O. VSMC shall include two N.O. and two N.C. dry contacts rated 120 Volts, 10 amperes, 60 Hz.
- P. VSMC shall include pre-programmed application macros specifically designed for start-up. The Application Macros shall provide one command to reprogram all parameters and customer interfaces for a particular application to reduce programming time. The VSMC shall have two user macros to allow the end-user to create and save custom settings.
- Q. VSMC shall include The VSMC shall provide a programmable loss-of-load (broken belt / broken coupling) Form-C relay output. The drive shall be programmable to signal the loss-of-load condition via a keypad warning, Form-C relay output, and / or over the serial communications bus. The loss-of-load condition sensing algorithm shall include a programmable time delay that will allow for motor acceleration from zero speed without signaling a false loss-of-load condition.
- R. The VSMC shall include multiple "two zone" PID algorithms that allow the VSMC to maintain PID control from two separate feedback signals (4-20mA, 0-10V, and / or serial communications). The two zone control PID algorithm will control motor speed based on a minimum, maximum, or average of the two feedback signals. All of the VSMC PID controllers shall include the ability for "two zone" control.
- S. If the input reference is lost, the VSMC shall give the user the option of either (1) stopping and displaying a fault, (2) running at a programmable preset speed, (3) hold the VSMC speed based on the last good reference received, or (4) cause a warning to be issued, as selected by the user. The drive shall be programmable to signal this condition via a keypad warning, Form-C relay output and / or over the serial communication bus.
- T. VSMC shall include a serial communications EIA-485 port as standard. The standard protocols shall be Johnson Controls Metasys.
- U. The VSMC shall include a fireman's override input.
- V. Hardware, software, network interfaces, gateways, and programming to control and monitor the VSMC by control systems specified in other

specification sections, including but not limited to Divisions 22 and 23.

- W. Network communications ports: As required for connectivity to control systems specified in other specification sections, including but not limited to Divisions 22 and 23.
- X. Communications protocols: As required for communications with control systems specified in other specification sections, including but not limited to Divisions 22 and 23.
  - 1. The VSMC shall have cooling fans that are designed for easy replacement. The fans shall be designed for replacement without requiring removing the VSMC from the wall or removal of circuit boards. The VSMC cooling fans shall operate only when required, based on the temperature of and run command to the drive. VSMC protection shall be based on thermal sensing and not cooling fan operation.
- Y. Bypass controller: Provide contactor-style bypass, arranged to bypass the inverter.
  - 1. Inverter Output Contactor and Bypass Contactor: Load-break NEMA-rated contactor.
  - 2. Motor overload relays.
  - 3. HAND-OFF-AUTOMATIC bypass control.
- Z. Bypass operation: Transfers motor between inverter output and bypass circuit, manually, automatically, or both. VSMC shall be capable of stable operation (starting, stopping, and running), and control by fire alarm and detection systems, with motor completely disconnected from the inverter output. Transfer between inverter and bypass contactor and retransfer shall only be allowed with the motor at zero speed.
- AA. Inverter Isolating Switch: Provide non-load-break switch arranged to isolate inverter and permit safe troubleshooting and testing of the inverter, both energized and de-energized, while motor is operating in bypass mode. Include padlockable, door-mounted handle mechanism.
- BB. VSMC Bypass shall include a complete factory wired and tested bypass system consisting of a door interlocked, padlockable circuit breaker, output contactor, bypass contactor, serial communications, smoke control override, firemans override, LCD display, fast acting VSMC input fuses, and other standard options of the listed acceptable model. UL Listed motor overload protection shall be provided in both drive and bypass modes.

CC. Acceptable Manufacturer:

1. Toshiba Q9 Adjustable Speed Drive.
2. Provide with: factory authorized start up and owner training.
3. The VSMC product warranty shall be 36 months from the date of factory shipment.
4. The manufacturer shall manufacture both VSMC's and motors.
5. The VSMC shall be manufactured in the United States.

DD. Factory start-up shall be provided for each drive by a factory authorized service center. A start-up form shall be filled out for each drive with a copy provided to the owner, and a copy kept on file at the manufacturer.

1. Factory trained application engineering and service personnel that are thoroughly familiar with the VSMC products offered shall be locally available at both the specifying and installation locations. A toll free 24/365 technical support line connected to factory support personnel located in the US shall be available. Technical support offered only through the local sales office is not acceptable.
2. Training shall include installation, programming and operation of the VSMC, bypass and serial communication. Factory authorized start up and owner training to be provided locally upon request.

## 2.9 CONTROLLERS

A. General. Provide an adequate number of BTL-Listed B-BC building controllers and an adequate number of BTL-Listed B-AAC advanced application controllers to achieve the performance specified in the Part 1 Article on "System Performance." Each of these controllers shall meet the following requirements.

1. The controller shall have sufficient memory to support its operating system, database, and programming requirements.
2. The building controller shall share data with the ECC and the other networked building controllers. The advanced application controller shall share data with its building controller and the other networked advanced application controllers.
3. The operating system of the controller shall manage the input and output communication signals to allow distributed controllers to share real and virtual object information and allow for central monitoring and alarms.

4. Controllers that perform scheduling shall have a real-time clock.
  5. The controller shall continually check the status of its processor and memory circuits. If an abnormal operation is detected, the controller shall:
    - a. assume a predetermined failure mode, and
    - b. generate an alarm notification.
  7. Communication.
    - a. Each controller shall reside on a Metasys network using the ISO 8802-3 (Ethernet) Data Link/Physical layer protocol for its communications. Each building controller also shall perform Metasys routing if connected to a network of custom application and application specific controllers.
    - b. The controller shall provide a service communication port using Metasys Data Link/Physical layer protocol for connection to a portable operator's terminal.
  8. Keypad. A local keypad and display shall be provided for each controller. The keypad shall be provided for interrogating and editing data. Provide a system security password shall be available to prevent unauthorized use of the keypad and display.
  9. Serviceability. Provide diagnostic LEDs for power, communication, and processor. All wiring connections shall be made to field-removable, modular terminal strips or to a termination card connected by a ribbon cable.
  10. Memory. The controller shall maintain all BIOS and programming information in the event of a power loss for at least 72 hours.
  11. The controller shall be able to operate at 90% to 110% of nominal voltage rating and shall perform an orderly shutdown below 80% nominal voltage. Controller operation shall be protected against electrical noise of 5 to 120 Hz and from keyed radios up to 5 W at 1 m (3 ft).
- B. Provide BTL-Listed B-ASC application specific controllers for each piece of equipment for which they are constructed. Application specific controllers shall communicate with other Metasys devices on the internetwork.
1. Each B-ASC shall be capable of stand-alone operation and shall continue to provide control functions without being connected to the network.

2. Each B-ASC will contain sufficient I/O capacity to control the target system.
  3. Communication.
    - a. Each controller shall reside on a Metasys network using the ISO 8802-3 (Ethernet) Data Link/Physical layer protocol for its communications. Each building controller also shall perform Metasys routing if connected to a network of custom application and application specific controllers.
  4. Serviceability. Provide diagnostic LEDs for power, communication, and processor. All wiring connections shall be made to field-removable, modular terminal strips or to a termination card connected by a ribbon cable.
  5. Memory. The application specific controller shall use nonvolatile memory and maintain all BIOS and programming information in the event of a power loss.
  6. Immunity to power and noise. Controllers shall be able to operate at 90% to 110% of nominal voltage rating and shall perform an orderly shutdown below 80%. Operation shall be protected against electrical noise of 5-120 Hz and from keyed radios up to 5 W at 1 m (3 ft).
  7. Transformer. Power supply for the ASC must be rated at a minimum of 125% of ASC power consumption and shall be of the fused or current limiting type.
- C. Direct Digital Controller Software
1. The software programs specified in this section shall be commercially available, concurrent, multi-tasking operating system and support the use of software application that operates under DOS or Microsoft Windows.
  2. All points shall be identified by up to 30-character point name and 16-character point descriptor. The same names shall be used at the ECC.
  3. All control functions shall execute within the stand-alone control units via DDC algorithms. The VA shall be able to customize control strategies and sequences of operations defining the appropriate control loop algorithms and choosing the optimum loop parameters.

4. All controllers shall be capable of being programmed to utilize stored default values for assured fail-safe operation of critical processes. Default values shall be invoked upon sensor failure or, if the primary value is normally provided by the central or another CU, or by loss of bus communication. Individual application software packages shall be structured to assume a fail-safe condition upon loss of input sensors. Loss of an input sensor shall result in output of a sensor-failed message at the ECC. Each ACU and RCU shall have capability for local readouts of all functions. The UCUs shall be read remotely.
5. All DDC control loops shall be able to utilize any of the following control modes:
  - a. Two position (on-off, slow-fast) control.
  - b. Proportional control.
  - c. Proportional plus integral (PI) control.
  - d. Proportional plus integral plus derivative (PID) control. All PID programs shall automatically invoke integral wind up prevention routines whenever the controlled unit is off, under manual control of an automation system or time initiated program.
  - e. Automatic tuning of control loops.
6. System Security: Operator access shall be secured using individual password and operator's name. Passwords shall restrict the operator to the level of object, applications, and system functions assigned to him. A minimum of six (6) levels of security for operator access shall be provided.
7. Application Software: The controllers shall provide the following programs as a minimum for the purpose of optimizing energy consumption while maintaining comfortable environment for occupants. All application software shall reside and run in the system digital controllers. Editing of the application shall occur at the ECC or via a portable operator's terminal, when it is necessary, to access directly the programmable unit.

- a. Economizer: An economizer program shall be provided for VAV systems. This program shall control the position of air handler relief, return, and outdoors dampers. If the outdoor air dry bulb temperature and humidity fall below changeover set point the energy control center will modulate the dampers to provide 100 percent outdoor air. The operator shall be able to override the economizer cycle and return to minimum outdoor air operation at any time.
- b. Night Setback/Morning Warm up Control: The system shall provide the ability to automatically adjust set points for this mode of operation.
- c. Optimum Start/Stop (OSS): Optimum start/stop program shall automatically be coordinated with event scheduling. The OSS program shall start HVAC equipment at the latest possible time that will allow the equipment to achieve the desired zone condition by the time of occupancy, and it shall also shut down HVAC equipment at the earliest possible time before the end of the occupancy period and still maintain desired comfort conditions. The OSS program shall consider both outside weather conditions and inside zone conditions. The program shall automatically assign longer lead times for weekend and holiday shutdowns. The program shall poll all zones served by the associated AHU and shall select the warmest and coolest zones. These shall be used in the start time calculation. It shall be possible to assign occupancy start times on a per air handler unit basis. The program shall meet the local code requirements for minimum outdoor air while the building is occupied. Modification of assigned occupancy start/stop times shall be possible via the ECC.

- d. Event Scheduling: Provide a comprehensive menu driven program to automatically start and stop designated points or a group of points according to a stored time. This program shall provide the capability to individually command a point or group of points. When points are assigned to one common load group it shall be possible to assign variable time advances/delays between each successive start or stop within that group. Scheduling shall be calendar based and advance schedules may be defined up to one year in advance. Advance schedule shall override the day-to-day schedule. The operator shall be able to define the following information:
- 1) Time, day.
  - 2) Commands such as on, off, auto.
  - 3) Time delays between successive commands.
  - 4) Manual overriding of each schedule.
  - 5) Allow operator intervention.
- e. Alarm Reporting: The operator shall be able to determine the action to be taken in the event of an alarm. Alarms shall be routed to the ECC based on time and events. An alarm shall be able to start programs, login the event, print and display the messages. The system shall allow the operator to prioritize the alarms to minimize nuisance reporting and to speed operator's response to critical alarms. A minimum of six (6) priority levels of alarms shall be provided for each point.
- f. Remote Communications: The system shall have the ability to dial out in the event of an alarm to the ECC and alpha-numeric pagers. The alarm message shall include the name of the calling location, the device that generated the alarm, and the alarm message itself. The operator shall be able to remotely access and operate the system using dial up communications. Remote access shall allow the operator to function the same as local access.



- g. Maintenance Management (PM): The program shall monitor equipment status and generate maintenance messages based upon the operators defined equipment run time, starts, and/or calendar date limits. A preventative maintenance alarm shall be printed indicating maintenance requirements based on pre-defined run time. Each preventive message shall include point description, limit criteria and preventative maintenance instruction assigned to that limit. A minimum of 480-character PM shall be provided for each component of units such as air handling units.

## **2.10 SPECIAL CONTROLLERS**

- A. Room Differential Pressure Controller: The differential pressure in isolation rooms, and ante-rooms, shall be maintained by controlling the quantity of air exhausted from or supplied to the room. A sensor-controller shall measure and control the velocity of air flowing into or out of the room through a sampling tube installed in the wall separating the room from the adjacent space, and display the value on its monitor. The preferred room pressure monitor is a TSI RPM20. The sensor-controller shall meet the following as a minimum:
1. Operating range: -0.25 to +0.25 inches of water column
  2. Resolution: 5 percent of reading
  3. Accuracy: +/- 10 percent of reading +/- 0.005 inches of water column
  4. Analog output: 0-10 VDC or 4-20 ma
  5. Operating temperature range: 32°F-120°F
  6. LCD display. Display to show temperature and air flow setting, and instantaneous values.

## **2.11 SENSORS (AIR, WATER AND STEAM)**

- A. Sensors' measurements shall be read back to the DDC system, and shall be visible by the ECC.
- B. Temperature and Humidity Sensors shall be electronic, vibration and corrosion resistant for wall, immersion, and/or duct mounting. Provide all remote sensors as required for the systems.
1. Temperature Sensors: thermistor type for terminal units and Resistance Temperature Device (RTD) with an integral transmitter type for all other sensors.
    - a. Duct sensors shall be rigid or averaging type as shown on drawings. Averaging sensor shall be a minimum of 1 linear ft of sensing element for each sq ft of cooling coil face area.

- b. Immersion sensors shall be provided with a separable well made of stainless steel, bronze or monel material. Pressure rating of well is to be consistent with the system pressure in which it is to be installed.
- c. Space sensors shall be equipped with in-space User set-point adjustment, override switch, numerical temperature display on sensor cover, and communication port. Match room thermostats. Provide a tooled-access cover.
  - 1) Public space sensor: setpoint adjustment shall be only through the ECC or through the DDC system's diagnostic device/laptop. Do not provide in-space User set-point adjustment. Provide an opaque keyed-entry cover if needed to restrict in-space User set-point adjustment.
  - 2) Psychiatric patient room sensor: Sensor shall be flush with the wall, shall not include an override switch, numerical temperature display on sensor cover, shall not include a communication port, and shall not allow in-space User set-point adjustment. Set-point adjustment shall be only through the ECC or through the DDC system's diagnostic device/laptop. Provide a stainless steel cover plate with an insulated back and security screws.
- d. Outdoor air temperature sensors shall have watertight inlet fittings and be shielded from direct sunlight.
- e. Room security sensors shall have stainless steel cover plate with insulated back and security screws.
- f. Wire: Twisted, shielded-pair cable.
- g. Output Signal: 4-20 ma.
- 2. Humidity Sensors: Bulk polymer sensing element type.
  - a. Duct and room sensors shall have a sensing range of 20 to 80 percent with accuracy of  $\pm 2$  to  $\pm 5$  percent RH, including hysteresis, linearity, and repeatability.
  - b. Outdoor humidity sensors shall be furnished with element guard and mounting plate and have a sensing range of 0 to 100 percent RH.
  - c. 4-20 ma continuous output signal.
- C. Static Pressure Sensors: Non-directional, temperature compensated.
  - 1. 4-20 ma output signal.
  - 2. 0 to 5 inches wg for duct static pressure range.

3. 0 to 0.25 inch wg for Building static pressure range.

D. Water flow sensors:

1. Type: Insertion vortex type with retractable probe assembly and 2 inch full port gate valve.
  - a. Pipe size: 3 to 24 inches.
  - b. Retractor: ASME threaded, non-rising stem type with hand wheel.
  - c. Mounting connection: 2 inch 150 PSI flange.
  - d. Sensor assembly: Design for expected water flow and pipe size.
  - e. Seal: Teflon (PTFE).
2. Controller:
  - a. Integral to unit.
  - b. Locally display flow rate and total.
  - c. Output flow signal to BMCS: Digital pulse type.
3. Performance:
  - a. Turndown: 20:1
  - b. Response time: Adjustable from 1 to 100 seconds.
  - c. Power: 24 volt DC
4. Install flow meters according to manufacturer's recommendations.  
Where recommended by manufacturer because of mounting conditions, provide flow rectifier.

E. Water Flow sensors: shall be insertion turbine type with turbine element, retractor and preamplifier/transmitter mounted on a two-inch full port isolation valve; assembly easily removed or installed as a single unit under line pressure through the isolation valve without interference with process flow; calibrated scale shall allow precise positioning of the flow element to the required insertion depth within plus or minute 1 mm (0.05 inch); wetted parts shall be constructed of stainless steel. Operating power shall be nominal 24 VDC. Local instantaneous flow indicator shall be LED type in NEMA 4 enclosure with 3-1/2 digit display, for wall or panel mounting. Manufacturer "Onicon".

1. Performance characteristics:

- a. Ambient conditions: -40°C to 60°C (-40°F to 140°F), 5 to 100% humidity.
- b. Operating conditions: 850 kPa (125 psig), 0°C to 120°C (30°F to 250°F), 0.15 to 12 m per second (0.5 to 40 feet per second) velocity.

- c. Nominal range (turn down ratio): 10 to 1.
- d. Preamplifier mounted on meter shall provide 4-20 ma divided pulse output or switch closure signal for units of volume or mass per a time base. Signal transmission distance shall be a minimum of 1,800 meters (6,000 feet). Preamplifier for bi-directional flow measurement shall provide a directional contact closure from a relay mounted in the preamplifier.
- e. Pressure Loss: Maximum 1 percent of the line pressure in line sizes above 100 mm (4 inches).
- f. Ambient temperature effects, less than 0.005 percent calibrated span per °C (°F) temperature change.
- g. RFI effect - flow meter shall not be affected by RFI.
- h. Power supply effect less than 0.02 percent of span for a variation of plus or minus 10 percent power supply.

F. Steam Flow Sensor/Transmitter:

- 1. Sensor: Vortex shedder incorporating wing type sensor and amplification technology for high signal-to-noise ratio, carbon steel body with 316 stainless steel working parts, 24 VDC power, NEMA 4 enclosure, NIST traceable, wet calibrated flow-measuring element, transmitter, visual display, integral temperature sensor, and calibration certificate. Manufacturer "Onicon model F-2000 series multi-variable inline vortex shredding flow meter".
  - a. Ambient conditions, -40°C to 80°C (-40°F to 175°F), maximum temperature rating 500 deg F.
  - b. Process conditions, 900 kPa (125 psig) saturated steam, maximum pressure rating 1400 psig.
  - c. Turn down ratio, 20 to 1.
  - d. Output signal, 4-20 ma DC.
  - e. Processor/Transmitter, NEMA 4 enclosure with keypad program selector and six digit LCD output display of instantaneous flow rate information, totalized flow, solid state switch closure signal shall be provided to the nearest DDC panel for totalization, diagnostics. Transmitter shall be factory configured for this specific application.
    - 1) Ambient conditions, -20°C to 50°C (0°F-120°F), 0 95 percent non- condensing RH.

- 2) Power supply, 120 VAC, 60 hertz or 24 VDC.
- 3) Internal battery, provided for 24-month retention of RAM contents when all other power sources are removed.
- 4) Factory calibrated and scaled for intended application.
- f. If device does not have integral temperature sensor, then device on all steam lines shall be protected by pigtail siphons installed between the sensor and the line, and shall have an isolation valve installed between the sensor and pressure source.
- g. Vortex-shedding sensing element shall be welded 316L shedder bar, two piezoelectric crystals for sensing vortices and 1000 ohm platinum RTD for measuring saturated steam temperature.
- h. 300 series stainless steel body and ANSI class 300 flanges.
- i. Individual calibration tag shall be attached indicating calibration and programming information.
- j. Flow meter shall provide calibrated outputs directly from the transmitter, throughout the operating range with the accuracy stated as follows: Plus or minus 0.75% of volumetric flow rate from 10 to 250 ft/sec velocity. Plus or minus 1.5% of mass steam flow rate from 10 to 250 ft/sec velocity.
- k. Each flow meter shall receive a wet calibration at five points within the expected operating range, against a primary volumetric standard.
- l. Installation and operating instructions shall be provided for each flow meter.
- m. Each flow meter shall be covered by the manufacturer's two year warranty.
- G. Steam Condensate Meters: provide a magnetic flowmeter in new installations; provide an ultrasonic or vortex-shedding flowmeter in existing installations which service interruption is not allowed. Provide temperature and pressure transducers to develop the energy flow.
- H. Magnetic flowmeters.
  - 1. Meter shall have an all-welded flanged 316 stainless steel engineered flow tube with no seals. No sensor parts shall be exposed to the flow stream. Design meter for mating with Schedule 40 piping.

- a. Meter shall be suitable for 25% warmer than the fluid operating temperature and for 25% higher than either the fluid's operating pressure or 25% higher than the piping system's safety valve set pressure, whichever is higher.
  - b. Meter flanges shall be Class 150 or higher, if required by the piping system's temperature and pressure Class.
  - c. Meter shall be suitable for installation in ambient conditions ranging from -29 to 60 degrees C (-20 to 140 degrees F).
- 2. Provide meter data head.
  - a. Meters shall have digital readout of pressure-compensated flow rate and totalization located at transmitter and transmit flow rate and totalization digital signals to the Site Data Aggregation Device. As an option, pressure compensation and the compensated flow rate may be performed and displayed by the Site Data Aggregation Device receiving signals from the flow meter and from a pressure transmitter.
  - b. Provide programmable microprocessor electronics with on-board programming. Output signals shall be immune to ambient temperature swings. Processor shall include continuous self-diagnostic routines that identify electronics problems and provide a warning. Electronics shall be replaceable in the field without affecting metering accuracy. Provide power supply as recommended by meter manufacturer. Mount electronics in a NEMA 4 enclosure separate from meter body in position accessible from platform or floor without the use of a portable ladder.
    - 1) Power supply to meter and transmitter shall be 120V/60hz. Provide a Class 2 control voltage transformer for 24VDC power to meter as needed.
- 3. Performance:
  - a. Transmitted signal from flowmeter and its transmitter shall have a total (rms) accuracy plus or minus 1.5% of flow rate.

- b. Flowmeter accuracy shall be no more than plus or minus 1.5% of actual flow rate for gasses and plus or minus 1% of actual flow rate for liquids. Flowmeter repeatability shall be no more than 0.2% of actual flow rate. Meter shall be designed to minimize vibration effect and to provide elimination of this effect.
  - c. Minimum turndown ratio shall be 20:1 for gasses and liquids. Maximum fluid pressure drop shall be as scheduled.
- I. Flow switches:
  - 1. Shall be either paddle or differential pressure type.
    - a. Paddle-type switches (liquid service only) shall be UL Listed, SPDT snap-acting, adjustable sensitivity with NEMA 4 enclosure.
    - b. Differential pressure type switches (air or water service) shall be UL listed, SPDT snap acting, NEMA 4 enclosure, with scale range and differential suitable for specified application.
- J. Current Switches: Current operated switches shall be self powered, solid state with adjustable trip current as well as status, power, and relay command status LED indication. The switches shall be selected to match the current of the application and output requirements of the DDC systems.

## **2.12 CONTROL CABLES**

- A. General:
  - 1. Ground cable shields, drain conductors, and equipment to eliminate shock hazard and to minimize ground loops, common-mode returns, noise pickup, cross talk, and other impairments. Comply with Sections 27 05 26 and 26 05 26.
  - 2. Cable conductors to provide protection against induction in circuits. Crosstalk attenuation within the System shall be in excess of -80 dB throughout the frequency ranges specified.
  - 3. Minimize the radiation of RF noise generated by the System equipment so as not to interfere with any audio, video, data, computer main distribution frame (MDF), telephone customer service unit (CSU), and electronic private branch exchange (EPBX) equipment the System may service.

4. The as-installed drawings shall identify each cable as labeled, used cable, and bad cable pairs.
  5. Label system's cables on each end. Test and certify cables in writing to the VA before conducting proof-of-performance testing. Minimum cable test requirements are for impedance compliance, inductance, capacitance, signal level compliance, opens, shorts, cross talk, noise, and distortion, and split pairs on all cables in the frequency ranges used. Make available all cable installation and test records at demonstration to the VA. All changes (used pair, failed pair, etc.) shall be posted in these records as the change occurs.
  6. Power wiring shall not be run in conduit with communications trunk wiring or signal or control wiring operating at 100 volts or less.
  7. Power and controls wiring shall be run in conduits within all mechanical and electrical rooms.
- B. Analogue control cabling shall be not less than No. 18 AWG solid, with thermoplastic insulated conductors as specified in Section 26 05 21.
- C. Copper digital communication cable between the ECC and the B-BC and B-AAC controllers shall be 100BASE-TX Ethernet, Category 5e or 6, not less than minimum 24 American Wire Gauge (AWG) solid, Shielded Twisted Pair (STP) or Unshielded Twisted Pair (UTP), with thermoplastic insulated conductors, enclosed in a thermoplastic outer jacket, as specified in Section 27 15 00.
1. Other types of media commonly used within IEEE Std 802.3 LANs (e.g., 10Base-T and 10Base-2) shall be used only in cases to interconnect with existing media.
- D. Optical digital communication fiber, if used, shall be Multimode or Singlemode fiber, 62.5/125 micron for multimode or 10/125 micron for singlemode micron with SC or ST connectors as specified in TIA-568-C.1. Terminations, patch panels, and other hardware shall be compatible with the specified fiber and shall be as specified in Section 27 15 00. Fiber-optic cable shall be suitable for use with the 100Base-FX or the 100Base-SX standard (as applicable) as defined in IEEE Std 802.3.



### **2.13 THERMOSTATS AND HUMIDISTATS**

- A. Room thermostats controlling unitary standalone heating and cooling devices not connected to the DDC system shall have three modes of operation (heating - null or dead band - cooling). Thermostats for patient bedrooms shall have capability of being adjusted to eliminate null or dead band. Wall mounted thermostats shall have manufacturer's recommendation finish, setpoint range and temperature display and external adjustment:
  - 1. Electronic Thermostats: Solid-state, microprocessor based, programmable to daily, weekend, and holiday schedules.
    - a. Public Space Thermostat: Public space thermostat shall have a thermistor sensor and shall not have a visible means of set point adjustment. Adjustment shall be via the digital controller to which it is connected.
    - b. Patient Room Thermostats: thermistor with in-space User set point adjustment and an on-casing room temperature numerical temperature display.
    - c. Psychiatric Patient Room Sensors: Electronic duct sensor as noted under article 2.4.
    - c. Battery replacement without program loss.
- B. Strap-on thermostats shall be enclosed in a dirt-and-moisture proof housing with fixed temperature switching point and single pole, double throw switch.
- C. Freezestats shall have a minimum of 300 mm (one linear foot) of sensing element for each 0.093 square meter (one square foot) of coil area. A freezing condition at any increment of 300 mm (one foot) anywhere along the sensing element shall be sufficient to operate the thermostatic element. Freezestats shall be manually-reset.
- D. Room Humidistats: Provide fully proportioning humidistat with adjustable throttling range for accuracy of settings and conservation. The humidistat shall have set point scales shown in percent of relative humidity located on the instrument. Systems showing moist/dry or high/low are not acceptable.

### **2.14 FINAL CONTROL ELEMENTS AND OPERATORS**

- A. Fail Safe Operation: Control valves and dampers shall provide "fail safe" operation in either the normally open or normally closed position as required for freeze, moisture, and smoke or fire protection.

- B. Spring Ranges: Range as required for system sequencing and to provide tight shut-off.
- C. Power Operated Control Dampers (other than VAV Boxes): Factory fabricated, balanced type dampers. All modulating dampers shall be opposed blade type and gasketed. Blades for two-position, duct-mounted dampers shall be parallel, airfoil (streamlined) type for minimum noise generation and pressure drop.
  - 1. Leakage: maximum leakage in closed position shall not exceed 7 L/S (15 CFMs) differential pressure for outside air and exhaust dampers and 200 L/S/ square meter (40 CFM/sq. ft.) at 50 mm (2 inches) differential pressure for other dampers.
  - 2. Frame shall be galvanized steel channel with seals as required to meet leakage criteria.
  - 3. Blades shall be galvanized steel or aluminum, 200 mm (8 inch) maximum width, with edges sealed as required.
  - 4. Bearing shall be nylon, bronze sleeve or ball type.
  - 5. Hardware shall be zinc-plated steel. Connected rods and linkage shall be non-slip. Working parts of joints shall be brass, bronze, nylon or stainless steel.
  - 6. Maximum air velocity and pressure drop through free area the dampers:
    - a. Smoke damper in air handling unit: 305 meter per minute (1000 fpm).
    - b. Duct mounted damper: 600 meter per minute (2000 fpm).
    - c. Maximum static pressure loss: 50 Pascal (0.20 inches water gage).
- D. Smoke Dampers and Combination Fire/Smoke Dampers: Dampers and operators are specified in Section 23 31 00, HVAC DUCTS AND CASINGS. Control of these dampers is specified under this Section.
- E. Pressure Independent Control Valves for Reheat Coils:
  - 1. Valves shall be rated for a minimum of 150 percent of system operating pressure at the valve location but not less than 900 kPa (125 psig).
  - 2. Valves 50 mm (2 inches) and smaller shall be bronze body with threaded or flare connections.
  - 3. Valves 60 mm (2 1/2 inches) and larger shall be bronze or iron body with flanged connections.
  - 4. Brass or bronze seats except for valves controlling media above 100 degrees C (210 degrees F), which shall have stainless steel seats.

5. Flow characteristics:

- a. Three way modulating valves shall be globe pattern. Position versus flow relation shall be linear relation for steam or equal percentage for water flow control.
- b. Two-way modulating valves shall be globe pattern. Position versus flow relation shall be linear for steam and equal percentage for water flow control.
- c. Two-way 2-position valves shall be ball, gate or butterfly type.

6. Maximum pressure drop:

- a. Two position steam control: 20 percent of inlet gauge pressure.
- b. Modulating Steam Control: 80 percent of inlet gauge pressure (acoustic velocity limitation).
- c. Modulating water flow control, greater of 3 meters (10 feet) of water or the pressure drop through the apparatus.

7. Two position water valves shall be line size.

8. Valve construction shall meet specifications per 23 21 13-2.8.L, Hydronic Piping.

F. Damper and Valve Operators and Relays:

- 1. Electric operator shall provide full modulating control of dampers and valves. A linkage and pushrod shall be furnished for mounting the actuator on the damper frame internally in the duct or externally in the duct or externally on the duct wall, or shall be furnished with a direct-coupled design. Metal parts shall be aluminum, mill finish galvanized steel, or zinc plated steel or stainless steel. Provide actuator heads which allow for electrical conduit attachment. The motors shall have sufficient closure torque to allow for complete closure of valve or damper under pressure. Provide multiple motors as required to achieve sufficient close-off torque.
  - a. Minimum valve close-off pressure shall be equal to the system pump's dead-head pressure, minimum 50 psig for valves smaller than 4 inches.
- 2. Electronic damper operators: Metal parts shall be aluminum, mill finish galvanized steel, or zinc plated steel or stainless steel. Provide actuator heads which allow for electrical conduit attachment. The motors shall have sufficient closure torque to allow for complete closure of valve or damper under pressure. Provide multiple motors as required to achieve sufficient close-off torque.

- a. VAV Box actuator shall be mounted on the damper axle or shall be of the air valve design, and shall provide complete modulating control of the damper. The motor shall have a closure torque of 35-inch pounds minimum with full torque applied at close off to attain minimum leakage.
- 3. See drawings for required control operation.
- G. Digital-to-Pneumatic Transducers: Convert plus or minus 12-V dc pulse-width-modulation outputs, or continuous proportional current or voltage to 0 to 20 psig (0 to 140 kPa).

## **2.15 AIR FLOW CONTROL**

- A. Airflow and static pressure shall be controlled via digital controllers with inputs from airflow control measuring stations and static pressure inputs as specified. Controller outputs shall be analog or pulse width modulating output signals. The controllers shall include the capability to control via simple proportional (P) control, proportional plus integral (PI), proportional plus integral plus derivative (PID), and on-off. The airflow control programs shall be factory-tested programs that are documented in the literature of the control manufacturer.
- B. Air Flow Measuring Station -- Electronic Thermal Type:
  - 1. Air Flow Sensor Probe:
    - a. Each air flow sensor shall contain two individual thermal sensing elements. One element shall determine the velocity of the air stream while the other element shall compensate for changes in temperature. Each thermal flow sensor and its associated control circuit and signal conditioning circuit shall be factory calibrated and be interchangeable to allow replacement of a sensor without recalibration of the entire flow station. The sensor in the array shall be located at the center of equal area segment of the duct and the number of sensors shall be adequate to accommodate the expected velocity profile and variation in flow and temperature. The airflow station shall be of the insertion type in which sensor support structures are inserted from the outside of the ducts to make up the complete electronic velocity array.

- b. Thermal flow sensor shall be constructed of hermetically sealed thermistors or nickel chromium or reference grade platinum wire, wound over an epoxy, stainless steel or ceramic mandrel and coated with a material suitable for the conditions to be encountered. Each dual sensor shall be mounted in an extruded aluminum alloy strut.
  - c. Basis of Design: Ebtron Advantage Gold Series II Probes and Transmitters, and Ebtron ELF-D Series.
2. Air Flow Sensor Fan Inlet Type:
- a. Each air flow sensor shall contain two individual thermal sensing elements at each inlet. One element shall determine the velocity of the air stream while the other element shall compensate for changes in temperature. Each thermal flow sensor and its associated control circuit and signal conditioning circuit shall be factory calibrated to the exact fan installed and be interchangeable to allow replacement of a sensor without recalibration of the entire flow station. The sensor in the array shall be located at the center of equal area segment of the inlet, face mounted, and the number of sensors shall be adequate to accommodate the expected velocity profile and variation in flow and temperature (minimum two sensors). The airflow station shall be of the fan inlet type in which sensor support structures are inserted onto the fan inlet to make up the complete electronic velocity array. Install onto air handler supply and return fan inlets, with 304 stainless steel housing and mounting feet, field adjustable zinc coated steel mounting rods, plenum rated wiring.
  - b. Basis of Design: Ebtron Advantage Gold Series II Probes and Transmitters.
3. Electronics Panel:
- a. Electronics Panel shall consist of a surface mounted enclosure complete with solid-state microprocessor and software.
  - b. Electronics Panel shall be A/C powered 24 VAC and shall have the capability to transmit signals of 0-5 VDC, 0-10 VCD or 4-20 ma for use in control of the HVAC Systems. The electronic panel shall have the capability to accept user defined scaling parameters for all output signals.

- c. Electronics Panel shall have the capability to digitally display airflow in CFM and temperature in degrees F . The displays shall be provided as an integral part of the electronics panel. The electronic panel shall have the capability to totalize the output flow in CFM for two or more systems, as required. A single output signal may be provided which will equal the sum of the systems totalized. Output signals shall be provided for temperature and airflow. Provide remote mounted air flow or temperature displays where indicated on the plans.
- d. Electronics Panel shall have the following:
- 1) Minimum of 12-bit A/D conversion.
  - 2) Field adjustable digital primary output offset and gain.
  - 3) Airflow analog output scaling of 100 to 10,000 FPM.
  - 4) Temperature analog output scaling from -45°C to 70°C (-50°F to 160°F).
  - 5) Analog output resolution (full scale output) of 0.025%.
- e. All readings shall be in I.P. units.
- f. All air flow measuring devices, sensors, transducers, and accessories to be made and provided by the same manufacturer.
4. Thermal flow sensors and its electronics shall be installed as per manufacturer's instructions. The probe sensor density shall be as follows:

Probe Sensor Density	
Area (sq.ft.)	Qty. Sensors
<=1	2
>1 to <4	4
4 to <8	6
8 to <12	8
12 to <16	12
>=16	16

- a. Complete installation shall not exhibit more than  $\pm 2.0\%$  error in airflow measurement output for variations in the angle of flow of up to 10 percent in any direction from its calibrated orientation. Repeatability of readings shall be within  $\pm 0.25\%$ .

- C. Static Pressure Measuring Station: shall consist of one or more static pressure sensors and transmitters along with relays or auxiliary devices as required for a complete functional system. The span of the transmitter shall not exceed two times the design static pressure at the point of measurement. The output of the transmitter shall be true representation of the input pressure with plus or minus 25 Pascal (0.1 inch) W.G. of the true input pressure:
1. Static pressure sensors shall have the same requirements as Airflow Measuring Devices except that total pressure sensors are optional, and only multiple static pressure sensors positioned on an equal area basis connected to a network of headers are required.
  2. For systems with multiple major trunk supply ducts, furnish a static pressure transmitter for each trunk duct. The transmitter signal representing the lowest static pressure shall be selected and this shall be the input signal to the controller.
  3. The controller shall receive the static pressure transmitter signal and CU shall provide a control output signal to the supply fan capacity control device. The control mode shall be proportional plus integral (PI) (automatic reset) and where required shall also include derivative mode.
  4. In systems with multiple static pressure transmitters, provide a switch located near the fan discharge to prevent excessive pressure during abnormal operating conditions. High-limit switches shall be manually-reset.
- D. Magnehelic Differential Pressure Filter Gages: Nominal 100 mm (four inch) diameter, zero to 500 Pa (zero to two inches water gage), three inch for HEPA range, except for MERV 17 HEPA Final Filters, where the range shall be zero to 750 Pa (zero to three inches water gage). Gages shall be flush mounted in aluminum panel board, complete with static tips, copper or aluminum tubing, and accessory items to provide zero adjustment.
- E. DDC Static (differential) air pressure measuring station.
1. Provide one DDC sensor across each extended surface filter. Provide petcocks for each gauge or sensor.
  2. Provide one common filter gauge for two stage filter banks with isolation valves to allow differential pressure measurement across each separate filter.

F. Constant Volume Control Systems shall consist of an air flow measuring station along with such relays and auxiliary devices as required to produce a complete functional system. The transmitter shall receive its air flow signal and static pressure signal from the flow measuring station and shall have a span not exceeding three times the design flow rate. The CU shall receive the transmitter signal and shall provide an output to the fan volume control device to maintain a constant flow rate. The CU shall provide proportional plus integral (PI) (automatic reset) control mode and where required also inverse derivative mode. Overall system accuracy shall be plus or minus the equivalent of 2 Pa (0.008 inch) velocity pressure as measured by the flow station.

G. Airflow Synchronization:

1. Systems shall consist of an air flow measuring station for each supply and return duct, the CU and such relays, as required to provide a complete functional system that will maintain a constant flow rate difference between supply and return air to an accuracy of  $\pm 10\%$ . In systems where there is no suitable location for a flow measuring station that will sense total supply or return flow, provide multiple flow stations with a differential pressure transmitter for each station. Signals from the multiple transmitters shall be added through the CU such that the resultant signal is a true representation of total flow.
2. The total flow signals from supply and return air shall be the input signals to the CU. This CU shall track the return air fan capacity in proportion to the supply air flow under all conditions.

### **PART 3 - EXECUTION**

#### **3.1 INSTALLATION**

A. General:

1. Examine project plans for control devices and equipment locations; and report any discrepancies, conflicts, or omissions to Project Manager for resolution before proceeding for installation.
2. Install equipment, piping, wiring /conduit parallel to or at right angles to building lines.
3. Install all equipment and piping in readily accessible locations. Do not run tubing and conduit concealed under insulation or inside ducts.



4. Mount control devices, tubing and conduit located on ducts and apparatus with external insulation on standoff support to avoid interference with insulation.
5. Provide sufficient slack and flexible connections to allow for vibration of piping and equipment.
6. Run wire connecting devices on or in control cabinets parallel with the sides of the cabinet neatly racked to permit tracing.
7. Install equipment level and plum.

B. Electrical Wiring Installation:

1. All wiring cabling shall be installed in conduits. Install conduits and wiring in accordance with Specification Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS. Conduits carrying control wiring and cabling shall be dedicated to the control wiring and cabling: these conduits shall not carry power wiring. Provide plastic end sleeves at all conduit terminations to protect wiring from burrs. Power and controls wiring shall be run in conduits within all mechanical and electrical rooms. Controls wiring may route without conduits throughout the building, outside of the mechanical and electrical rooms.
2. Install analog signal and communication cables in conduit and in accordance with Specification Section 26 05 21. Install digital communication cables in conduit and in accordance with Specification Section 27 15 00, Communications Horizontal Cabling.
3. Install conduit and wiring between operator workstation(s), digital controllers, electrical panels, indicating devices, instrumentation, miscellaneous alarm points, thermostats, and relays as shown on the drawings or as required under this section.
4. Install all electrical work required for a fully functional system and not shown on electrical plans or required by electrical specifications. Where low voltage (less than 50 volt) power is required, provide suitable Class B transformers.
5. Install all system components in accordance with local Building Code and National Electric Code.
  - a. Splices: Splices in shielded and coaxial cables shall consist of terminations and the use of shielded cable couplers. Terminations shall be in accessible locations. Cables shall be harnessed with cable ties.

- b. Equipment: Fit all equipment contained in cabinets or panels with service loops, each loop being at least 300 mm (12 inches) long. Equipment for fiber optics system shall be rack mounted, as applicable, in ventilated, self-supporting, code gauge steel enclosure. Cables shall be supported for minimum sag.
- c. Cable Runs: Keep cable runs as short as possible. Allow extra length for connecting to the terminal board. Do not bend flexible coaxial cables in a radius less than ten times the cable outside diameter.
- d. Use vinyl tape, sleeves, or grommets to protect cables from vibration at points where they pass around sharp corners, through walls, panel cabinets, etc.
- 6. Conceal cables, except in mechanical rooms and areas where other conduits and piping are exposed.
- 7. Permanently label or code each point of all field terminal strips to show the instrument or item served. Color-coded cable with cable diagrams may be used to accomplish cable identification.
- 8. Grounding: ground electrical systems per manufacturer's written requirements for proper and safe operation.
- C. Install Sensors and Controls:
  - 1. Temperature Sensors:
    - a. Install all sensors and instrumentation according to manufacturer's written instructions. Temperature sensor locations shall be readily accessible, permitting quick replacement and servicing of them without special skills and tools.
    - b. Calibrate sensors to accuracy specified, if not factory calibrated.
    - c. Use of sensors shall be limited to its duty, e.g., duct sensor shall not be used in lieu of room sensor.
    - d. Install room sensors permanently supported on wall frame. They shall be mounted at 1.5 meter (5.0 feet) above the finished floor.
    - e. Mount sensors rigidly and adequately for the environment within which the sensor operates. Separate extended-bulb sensors form contact with metal casings and coils using insulated standoffs.

- f. Sensors used in mixing plenum, and hot and cold decks shall be of the averaging of type. Averaging sensors shall be installed in a serpentine manner horizontally across duct. Each bend shall be supported with a capillary clip.
  - g. All pipe mounted temperature sensors shall be installed in wells.
  - h. All wires attached to sensors shall be air sealed in their conduits or in the wall to stop air transmitted from other areas affecting sensor reading.
  - i. Permanently mark terminal blocks for identification. Protect all circuits to avoid interruption of service due to short-circuiting or other conditions. Line-protect all wiring that comes from external sources to the site from lightning and static electricity.
2. Pressure Sensors:
- a. Install duct static pressure sensor tips facing directly downstream of airflow.
  - b. Install high-pressure side of the differential switch between the pump discharge and the check valve.
  - c. Install snubbers and isolation valves on steam pressure sensing devices.
3. Actuators:
- a. Mount and link damper and valve actuators according to manufacturer's written instructions.
  - b. Check operation of damper/actuator combination to confirm that actuator modulates damper smoothly throughout stroke to both open and closed position.
  - c. Check operation of valve/actuator combination to confirm that actuator modulates valve smoothly in both open and closed position.
4. Flow Switches:
- a. Install flow switch according to manufacturer's written instructions.
  - b. Mount flow switch a minimum of 5 pipe diameters up stream and 5 pipe diameters downstream or 600 mm (2 feet) whichever is greater, from fittings and other obstructions.
  - c. Assure correct flow direction and alignment.
  - d. Mount in horizontal piping-flow switch on top of the pipe.
- D. Installation of network:

1. Ethernet:

- a. The network shall employ Ethernet LAN architecture, as defined by IEEE 802.3. The Network Interface shall be fully Internet Protocol (IP) compliant allowing connection to currently installed IEEE 802.3, Compliant Ethernet Networks.

2. Third party interfaces: Contractor shall integrate real-time data from building systems by other trades and databases originating from other manufacturers as specified and required to make the system work as one system.

- E. Installation of digital controllers and programming:

1. Provide a separate digital control panel for each major piece of equipment, such as air handling unit, chiller, pumping unit etc. Points used for control loop reset such as outdoor air, outdoor humidity, or space temperature could be located on any of the remote control units.
2. Provide sufficient internal memory for the specified control sequences and trend logging. There shall be a minimum of 25 percent of available memory free for future use.
3. System point names shall be modular in design, permitting easy operator interface without the use of a written point index.
4. Provide software programming for the applications intended for the systems specified, and adhere to the strategy algorithms provided.
5. Provide graphics for each piece of equipment and floor plan in the building. This includes each chiller, cooling tower, air handling unit, fan, terminal unit, boiler, pumping unit etc. These graphics shall show all points dynamically as specified in the point list.

### **3.2 SYSTEM VALIDATION AND DEMONSTRATION**

- A. As part of final system acceptance, a system demonstration is required (see below). Prior to start of this demonstration, the contractor is to perform a complete validation of all aspects of the controls and instrumentation system.

- B. Validation

1. Prepare and submit for approval a validation test plan including test procedures for the performance verification tests. Test Plan shall address all specified functions of the ECC and all specified sequences of operation. Explain in detail actions and expected results used to demonstrate compliance with the requirements of this specification. Explain the method for simulating the necessary conditions of operation used to demonstrate performance of the system. Test plan shall include a test check list to be used by the Installer's agent to check and initial that each test has been successfully completed. Deliver test plan documentation for the performance verification tests to the owner's representative 30 days prior to start of performance verification tests. Provide draft copy of operation and maintenance manual with performance verification test.
2. After approval of the validation test plan, installer shall carry out all tests and procedures therein. Installer shall completely check out, calibrate, and test all connected hardware and software to insure that system performs in accordance with approved specifications and sequences of operation submitted. Installer shall complete and submit Test Check List.

#### C. Demonstration

1. System operation and calibration to be demonstrated by the installer in the presence of the Architect or VA's representative on random samples of equipment as dictated by the Architect or VA's representative. Should random sampling indicate improper commissioning, the owner reserves the right to subsequently witness complete calibration of the system at no addition cost to the VA.
2. Demonstrate to authorities that all required safeties and life safety functions are fully functional and complete.
3. Make accessible, personnel to provide necessary adjustments and corrections to systems as directed by balancing agency.
4. The following witnessed demonstrations of field control equipment shall be included:
  - a. Observe HVAC systems in shut down condition. Check dampers and valves for normal position.
  - b. Test application software for its ability to communicate with digital controllers, operator workstation, and uploading and downloading of control programs.

- c. Demonstrate the software ability to edit the control program off-line.
- d. Demonstrate reporting of alarm conditions for each alarm and ensure that these alarms are received at the assigned location, including operator workstations.
- e. Demonstrate ability of software program to function for the intended applications-trend reports, change in status etc.
- f. Demonstrate via graphed trends to show the sequence of operation is executed in correct manner, and that the HVAC systems operate properly through the complete sequence of operation, e.g., seasonal change, occupied/unoccupied mode, and warm-up condition.
- g. Demonstrate hardware interlocks and safeties functions, and that the control systems perform the correct sequence of operation after power loss and resumption of power loss.
- h. Prepare and deliver to the VA graphed trends of all control loops to demonstrate that each control loop is stable and the set points are maintained.
- i. Demonstrate that each control loop responds to set point adjustment and stabilizes within one (1) minute. Control loop trend data shall be instantaneous and the time between data points shall not be greater than one (1) minute.

----- END -----

**SECTION 23 21 13  
HYDRONIC PIPING**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. Water piping to connect HVAC equipment, including the following:
  - 1. Chilled water, heating hot water and drain piping.
  - 2. Extension of domestic water make-up piping.
  - 3. Not Used.

**1.2 RELATED WORK**

- A. Section 01 00 00, GENERAL REQUIREMENTS.
- B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- C. Not Used.
- D. Not Used.
- E. Not Used.
- F. Not Used.
- G. Not Used.
- H. Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION:  
General mechanical requirements and items, which are common to more than one section of Division 23.
- I. Not Used.
- J. Section 23 07 11, HVAC, PLUMBING, and BOILER PLANT INSULATION: Piping insulation.
- K. Not Used.
- L. Section 23 23 00, REFRIGERANT PIPING: Refrigerant piping and refrigerants.
- M. Not Used.
- N. Section 23 82 00, CONVECTION HEATING AND COOLING UNITS: VAV and CV units, fan coil units, and radiant ceiling panels.
- O. Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC: Temperature and pressure sensors and valve operators.

**1.3 QUALITY ASSURANCE**

- A. Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION, which includes welding qualifications.
- B. Submit prior to welding of steel piping a certificate of Welder's certification. The certificate shall be current and not more than one year old.

C. All grooved joint couplings, fittings, valves, and specialties shall be the products of a single manufacturer. Grooving tools shall be the same manufacturer as the grooved components.

1. All castings used for coupling housings, fittings, valve bodies, etc., shall be date stamped for quality assurance and traceability.

#### **1.4 SUBMITTALS**

A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.

B. Manufacturer's Literature and Data:

1. Pipe and equipment supports.
2. Pipe and tubing, with specification, class or type, and schedule.
3. Pipe fittings, including miscellaneous adapters and special fittings.
4. Flanges, gaskets and bolting.
5. Grooved joint couplings and fittings.
6. Valves of all types.
7. Strainers.
8. Flexible connectors for water service.
9. Not Used.
10. Not Used.
11. Not Used.
12. All specified hydronic system components.
13. Not Used.
14. Gages.
15. Thermometers and test wells.

C. Not Used.

D. Submit the welder's qualifications in the form of a current (less than one year old) and formal certificate.

E. Coordination Drawings: Refer to Article, SUBMITTALS of Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.

F. As-Built Piping Diagrams: Provide drawing as follows for chilled water, condenser water, and heating hot water system and other piping systems and equipment.

1. One wall-mounted stick file with complete set of prints. Mount stick file in the chiller plant or control room along with control diagram stick file.
2. One complete set of reproducible drawings.
3. One complete set of drawings in electronic Autocad and pdf format.



### 1.5 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only. American National Standards Institute, Inc.
- B. American Society of Mechanical Engineers/American National Standards Institute, Inc. (ASME/ANSI):
- B1.20.1-83(R2006).....Pipe Threads, General Purpose (Inch)
- B16.4-06.....Gray Iron Threaded Fittings B16.18-01      Cast  
Copper Alloy Solder joint Pressure fittings
- B16.23-02.....Cast Copper Alloy Solder joint Drainage  
fittings
- B40.100-05.....Pressure Gauges and Gauge Attachments
- C. American National Standards Institute, Inc./Fluid Controls Institute (ANSI/FCI):
- 70-2-2006.....Control Valve Seat Leakage
- D. American Society of Mechanical Engineers (ASME):
- B16.1-98.....Cast Iron Pipe Flanges and Flanged Fittings
- B16.3-2006.....Malleable Iron Threaded Fittings: Class 150 and  
300
- B16.4-2006.....Gray Iron Threaded Fittings: (Class 125 and  
250)
- B16.5-2003.....Pipe Flanges and Flanged Fittings: NPS ½  
through NPS 24 Metric/Inch Standard
- B16.9-07.....Factory Made Wrought Butt Welding Fittings
- B16.11-05.....Forged Fittings, Socket Welding and Threaded
- B16.18-01.....Cast Copper Alloy Solder Joint Pressure  
Fittings
- B16.22-01.....Wrought Copper and Bronze Solder Joint Pressure  
Fittings.
- B16.24-06.....Cast Copper Alloy Pipe Flanges and Flanged  
Fittings
- B16.39-06.....Malleable Iron Threaded Pipe Unions
- B16.42-06.....Ductile Iron Pipe Flanges and Flanged Fittings
- B31.1-08.....Power Piping
- E. American Society for Testing and Materials (ASTM):
- A47/A47M-99 (2004).....Ferritic Malleable Iron Castings

A53/A53M-07.....Standard Specification for Pipe, Steel, Black  
 and Hot-Dipped, Zinc-Coated, Welded and  
 Seamless  
 A106/A106M-08.....Standard Specification for Seamless Carbon  
 Steel Pipe for High-Temperature Service  
 A126-04.....Standard Specification for Gray Iron Castings  
 for Valves, Flanges, and Pipe Fittings  
 A183-03 ..... Standard Specification for Carbon Steel Track  
 Bolts and Nuts  
 A216/A216M-08 ..... Standard Specification for Steel Castings,  
 Carbon, Suitable for Fusion Welding, for High  
 Temperature Service  
 A234/A234M-07 ..... Piping Fittings of Wrought Carbon Steel and  
 Alloy Steel for Moderate and High Temperature  
 Service  
 A307-07 ..... Standard Specification for Carbon Steel Bolts  
 and Studs, 60,000 PSI Tensile Strength  
 A536-84 (2004) ..... Standard Specification for Ductile Iron Castings  
 A615/A615M-08 ..... Deformed and Plain Carbon Steel Bars for  
 Concrete Reinforcement  
 A653/A 653M-08 ..... Steel Sheet, Zinc-Coated (Galvanized) or Zinc-  
 Iron Alloy Coated (Galvannealed) By the Hot-Dip  
 Process  
 B32-08 ..... Standard Specification for Solder Metal  
 B62-02 ..... Standard Specification for Composition Bronze or  
 Ounce Metal Castings  
 B88-03 ..... Standard Specification for Seamless Copper Water  
 Tube  
 B209-07 ..... Aluminum and Aluminum Alloy Sheet and Plate  
 C177-04 ..... Standard Test Method for Steady State Heat Flux  
 Measurements and Thermal Transmission Properties  
 by Means of the Guarded Hot Plate Apparatus  
 C533-07 ..... Calcium Silicate Block and Pipe Thermal  
 Insulation  
 C552-07 ..... Cellular Glass Thermal Insulation  
 F. American Water Works Association (AWWA):  
 C110-08.....Ductile Iron and Grey Iron Fittings for Water

C203-02.....Coal Tar Protective Coatings and Linings for  
Steel Water Pipe Lines Enamel and Tape Hot  
Applied

G. American Welding Society (AWS):

B2.1-02.....Standard Welding Procedure Specification

H. Copper Development Association, Inc. (CDA):

CDA A4015-06.....Copper Tube Handbook

I. Not Used.

J. Manufacturers Standardization Society (MSS) of the Valve and Fitting  
Industry, Inc.:

SP-67-02a.....Butterfly Valves

SP-70-06.....Gray Iron Gate Valves, Flanged and Threaded  
Ends

SP-71-05.....Gray Iron Swing Check Valves, Flanged and  
Threaded Ends

SP-80-08.....Bronze Gate, Globe, Angle and Check Valves

SP-85-02.....Cast Iron Globe and Angle Valves, Flanged and  
Threaded Ends

SP-110-96.....Ball Valves Threaded, Socket-Welding, Solder  
Joint, Grooved and Flared Ends

SP-125-00.....Gray Iron and Ductile Iron In-line, Spring  
Loaded, Center-Guided Check Valves

K. National Sanitation Foundation/American National Standards Institute,  
Inc. (NSF/ANSI):

14-06.....Plastic Piping System Components and Related  
Materials

50-2009a.....Equipment for Swimming Pools, Spas, Hot Tubs  
and other Recreational Water Facilities -  
Evaluation criteria for materials, components,  
products, equipment and systems for use at  
recreational water facilities

61-2008.....Drinking Water System Components - Health  
Effects

**1.6 SPARE PARTS NOT USED.**

**PART 2 - PRODUCTS**

**2.1 PIPE AND EQUIPMENT SUPPORTS, PIPE SLEEVES, AND WALL AND CEILING PLATES**

A. Provide in accordance with Section 23 05 11, COMMON WORK RESULTS FOR  
HVAC and STEAM GENERATION.

## 2.2 PIPE AND TUBING

- A. Chilled Water, Heating Hot Water, and Vent Piping:
  - 1. Steel: ASTM A53 Grade B, seamless or ERW, Schedule 40.
  - 2. Copper water tube option: ASTM B88, Type K or L, hard drawn.
- B. Extension of Domestic Water Make-up Piping: ASTM B88, Type K or L, hard drawn copper tubing.
- C. Cooling Coil Condensate Drain Piping:
  - 1. From air handling units: Copper water tube, ASTM B88, Type M, .
  - 2. From fan coil or other terminal units: Copper water tube, ASTM B88, Type L for runouts and Type M for mains.
- D. Not Used.
- E. Pipe supports, including insulation shields, for above ground piping: Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.

## 2.3 FITTINGS FOR STEEL PIPE

- A. 50 mm (2 inches) and Smaller: Screwed or welded joints.
  - 1. Butt welding: ASME B16.9 with same wall thickness as connecting piping.
  - 2. Forged steel, socket welding or threaded: ASME B16.11.
  - 3. Screwed: 150 pound malleable iron, ASME B16.3. 125 pound cast iron, ASME B16.4, may be used in lieu of malleable iron. Bushing reduction of a single pipe size, or use of close nipples, is not acceptable.
  - 4. Unions: ASME B16.39.
  - 5. Water hose connection adapter: Brass, pipe thread to 20 mm (3/4 inch) garden hose thread, with hose cap nut.
- B. 65 mm (2-1/2 inches) and Larger: Welded or flanged joints. Contractor's option:
  - 1. Butt welding fittings: ASME B16.9 with same wall thickness as connecting piping. Elbows shall be long radius type, unless otherwise noted.
  - 2. Welding flanges and bolting: ASME B16.5:
    - a. Water service: Weld neck or slip-on, plain face, with 6 mm (1/8 inch) thick full face neoprene gasket suitable for 104 degrees C (220 degrees F).
    - 1) Contractor's option: Convolute, cold formed 150 pound steel flanges, with teflon gaskets, may be used for water service.
    - b. Flange bolting: Carbon steel machine bolts or studs and nuts, ASTM A307, Grade B.

- C. Welded Branch and Tap Connections: Forged steel weldolets, or branchlets and threadolets may be used for branch connections up to one pipe size smaller than the main. Forged steel half-couplings, ASME B16.11 may be used for drain, vent and gage connections.

#### **2.4 FITTINGS FOR COPPER TUBING**

##### **A. Joints:**

1. Solder Joints: Joints shall be made up in accordance with recommended practices of the materials applied. Apply 95/5 tin and antimony on all copper piping.
2. Mechanically formed tee connection in water and drain piping: Form mechanically extracted collars in a continuous operation by drilling pilot hole and drawing out tube surface to form collar, having a height of not less than three times the thickness of tube wall. Adjustable collaring device shall insure proper tolerance and complete uniformity of the joint. Notch and dimple joining branch tube in a single process to provide free flow where the branch tube penetrates the fitting.

##### **B. Bronze Flanges and Flanged Fittings: ASME B16.24.**

##### **C. Fittings: ANSI/ASME B16.18 cast copper or ANSI/ASME B16.22 solder wrought copper.**

#### **2.5 FITTINGS FOR PLASTIC PIPING NOT USED.**

#### **2.6 DIELECTRIC FITTINGS**

- A. Provide where copper tubing and ferrous metal pipe are joined.
- B. 50 mm (2 inches) and Smaller: Threaded dielectric union, ASME B16.39.
- C. 65 mm (2 1/2 inches) and Larger: Flange union with dielectric gasket and bolt sleeves, ASME B16.42.
- D. Temperature Rating, 99 degrees C (210 degrees F).
- E. Contractor's option: On pipe sizes 2" and smaller, screwed end brass ball valves or dielectric nipples may be used in lieu of dielectric unions.

#### **2.7 SCREWED JOINTS**

- A. Pipe Thread: ANSI B1.20.
- B. Lubricant or Sealant: Oil and graphite or other compound approved for the intended service.

#### **2.8 VALVES**

- A. Asbestos packing is not acceptable.
- B. All valves of the same type shall be products of a single manufacturer.

C. Provide chain operators for valves 150 mm (6 inches) and larger when the centerline is located 2400 mm (8 feet) or more above the floor or operating platform.

D. Shut-Off Valves

1. Ball Valves (Pipe sizes 2" and smaller): MSS-SP 110, screwed or solder connections, brass or bronze body with chrome-plated ball with full port and Teflon seat at 2760 kPa (400 psig) working pressure rating. Provide stem extension to allow operation without interfering with pipe insulation.
2. Butterfly Valves (Pipe Sizes 2-1/2" and larger): Provide stem extension to allow 50 mm (2 inches) of pipe insulation without interfering with valve operation. MSS-SP 67, flange lug type or grooved end rated 1205 kPa (175 psig) working pressure at 93 degrees C (200 degrees F). Valves shall be ANSI Leakage Class VI and rated for bubble tight shut-off to full valve pressure rating. Valve shall be rated for dead end service and bi-directional flow capability to full rated pressure. Not permitted for direct buried pipe applications.
  - a. Body: Cast iron, ASTM A126, Class B. Malleable iron, ASTM A47 electro-plated, or ductile iron, ASTM A536, Grade 65-45-12 electro-plated.
  - b. Trim: Bronze, aluminum bronze, or 300 series stainless steel disc, bronze bearings, 316 stainless steel shaft and manufacturer's recommended resilient seat. Resilient seat shall be field replaceable, and fully line the body to completely isolate the body from the product. A phosphate coated steel shaft or stem is acceptable, if the stem is completely isolated from the product.
  - c. Actuators: Field interchangeable. Valves for balancing service shall have adjustable memory stop to limit open position.
    - 1) Valves 150 mm (6 inches) and smaller: Lever actuator with minimum of seven locking positions, except where chain wheel is required.
    - 2) Valves 200 mm (8 inches) and larger: Enclosed worm gear with handwheel, and where required, chain-wheel operator.
    - 3) 3. Gate Valves (Contractor's Option in lieu of Ball or Butterfly Valves):

- a) 50 mm (2 inches) and smaller: MSS-SP 80, Bronze, 1034 kPa (150 psig), wedge disc, rising stem, union bonnet.
- b) 65 mm (2 1/2 inches) and larger: Flanged, outside screw and yoke. MSS-SP 70, iron body, bronze mounted, 861 kPa (125 psig) wedge disc.

#### E. Globe and Angle Valves

##### 1. Globe Valves

- a. 50 mm (2 inches) and smaller: MSS-SP 80, bronze, 1034 kPa (150 lb.) Globe valves shall be union bonnet with metal plug type disc.
- b. 65 mm (2 1/2 inches) and larger: 861 kPa (125 psig), flanged, iron body, bronze trim, MSS-SP-85 for globe valves.

##### 2. Angle Valves:

- a. 50 mm (2 inches) and smaller: MSS-SP 80, bronze, 1034 kPa (150 lb.) Angle valves shall be union bonnet with metal plug type disc.
- b. 65 mm (2 1/2 inches) and larger: 861 kPa (125 psig), flanged, iron body, bronze trim, MSS-SP-85 for angle.

#### F. Check Valves

##### 1. Swing Check Valves:

- a. 50 mm (2 inches) and smaller: MSS-SP 80, bronze, 1034 kPa (150 lb.), 45 degree swing disc.
- b. 65 mm (2 1/2 inches) and larger: 861 kPa (125 psig), flanged, iron body, bronze trim, MSS-SP-71 for check valves.

##### 2. Non-Slam or Silent Check Valve: Spring loaded double disc swing check or internally guided flat disc lift type check for bubble tight shut-off. Provide where check valves are shown in chilled water and hot water piping. Check valves incorporating a balancing feature may be used.

- a. Body: MSS-SP 125 cast iron, ASTM A126, Class B, or steel, ASTM A216, Class WCB, or ductile iron, ASTM 536, flanged, grooved, or wafer type.
- b. Seat, disc and spring: 18-8 stainless steel, or bronze, ASTM B62. Seats may be elastomer material.

#### G. Water Flow Balancing Valves: For flow regulation and shut-off. Valves shall be line size rather than reduced to control valve size.

##### 1. Ball style valve.

2. A dual purpose flow balancing valve and adjustable flow meter, with bronze or cast iron body, calibrated position pointer, valved pressure taps or quick disconnects with integral check valves and preformed polyurethane insulating enclosure.
  3. Provide a readout kit including flow meter, readout probes, hoses, flow charts or calculator, and carrying case.
- H. Automatic Balancing Control Valves: Factory calibrated to maintain constant flow (plus or minus five percent) over system pressure fluctuations of at least 10 times the minimum required for control. Provide standard pressure taps and four sets of capacity charts. Valves shall be line size and be one of the following designs:
1. Gray iron (ASTM A126) or brass body rated 1205 kPa (175 psig) at 93 degrees C (200 degrees F), with stainless steel piston and spring.
  2. Brass or ferrous body designed for 2067 kPa (300 psig) service at 121 degrees C (250 degrees F), with corrosion resistant, tamper proof, self-cleaning piston/spring assembly that is easily removable for inspection or replacement.
  3. Combination assemblies containing ball type shut-off valves, unions, flow regulators, strainers with blowdown valves and pressure temperature ports shall be acceptable.
- I. Manual Radiator/Convactor Valves: Brass, packless, with position indicator.

## **2.9 WATER FLOW MEASURING DEVICES NOT USED.**

### **2.10 STRAINERS**

- A. Y Type.
1. Screens: Bronze, monel metal or 18-8 stainless steel, free area not less than 2-1/2 times pipe area, with perforations as follows: 1.1 mm (0.045 inch) diameter perforations for 100 mm (4 inches) and larger: 3.2 mm (0.125 inch) diameter perforations.

### **2.11 FLEXIBLE CONNECTORS FOR WATER SERVICE**

- A. Flanged Spool Connector:
1. Single arch or multiple arch type. Tube and cover shall be constructed of chlorobutyl elastomer with full faced integral flanges to provide a tight seal without gaskets. Connectors shall be internally reinforced with high strength synthetic fibers impregnated with rubber or synthetic compounds as recommended by connector manufacturer, and steel reinforcing rings.



2. Working pressures and temperatures shall be as follows:

- a. Connector sizes 50 mm to 100 mm (2 inches to 4 inches), 1137 kPa (165psig) at 121 degrees C (250 degrees F).
- b. Connector sizes 125 mm to 300 mm (5 inches to 12 inches), 965 kPa (140 psig) at 121 degrees C (250 degrees F).

3. Provide ductile iron retaining rings and control units.

B. Mechanical Pipe Couplings:

See other fittings specified under Part 2, PRODUCTS.

## **2.12 EXPANSION JOINTS NOT USED.**

## **2.13 HYDRONIC SYSTEM COMPONENTS**

- A. Not Used.
- B. Not Used.
- C. Not Used.
- D. Not Used.
- E. Not Used.
- F. Not Used.
- G. Not Used.
- H. Not Used.
- I. Not Used.
- J. Automatic Air Vent Valves (where shown): Cast iron or semi-steel body, 1034 kPa (150 psig) working pressure, stainless steel float, valve, valve seat and mechanism, minimum 15 mm (1/2 inch) water connection and 6 mm (1/4 inch) air outlet. Air outlet shall be piped to the nearest floor drain.

## **2.14 WATER FILTERS AND POT CHEMICAL FEEDERS NOT USED.**

## **2.15 GAGES, PRESSURE AND COMPOUND**

- A. ASME B40.100, Accuracy Grade 1A, (pressure, vacuum, or compound for air, oil or water), initial mid-scale accuracy 1 percent of scale (Qualify grade), metal or phenolic case, 115 mm (4-1/2 inches) in diameter, 6 mm (1/4 inch) NPT bottom connection, white dial with black graduations and pointer, clear glass or acrylic plastic window, suitable for board mounting. Provide red "set hand" to indicate normal working pressure.
- B. Provide brass lever handle union cock. Provide brass/bronze pressure snubber for gages in water service.
- C. Range of Gages: Provide range equal to at least 130 percent of normal operating range.

1. For condenser water suction (compound): Minus 100 kPa (30 inches Hg) to plus 700 kPa (100 psig).

#### **2.16 PRESSURE/TEMPERATURE TEST PROVISIONS**

- A. Pete's Plug: 6 mm (1/4 inch) MPT by 75 mm (3 inches) long, brass body and cap, with retained safety cap, nordel self-closing valve cores, permanently installed in piping where shown, or in lieu of pressure gage test connections shown on the drawings.
- B. Provide one each of the following test items to the Project Manager:
  1. 6 mm (1/4 inch) FPT by 3 mm (1/8 inch) diameter stainless steel pressure gage adapter probe for extra long test plug. PETE'S 500 XL is an example.
  2. 90 mm (3-1/2 inch) diameter, one percent accuracy, compound gage, -- 100 kPa (30 inches) Hg to 700 kPa (100 psig) range.
  3. 0 - 104 degrees C (220 degrees F) pocket thermometer one-half degree accuracy, 25 mm (one inch) dial, 125 mm (5 inch) long stainless steel stem, plastic case.

#### **2.17 THERMOMETERS**

- A. Mercury or organic liquid filled type, red or blue column, clear plastic window, with 150 mm (6 inch) brass stem, straight, fixed or adjustable angle as required for each in reading.
- B. Case: Chrome plated brass or aluminum with enamel finish.
- C. Scale: Not less than 225 mm (9 inches), range as described below, two degree graduations.
- D. Separable Socket (Well): Brass, extension neck type to clear pipe insulation.
- E. Scale ranges:
  1. Chilled Water and Glycol-Water: 0-38 degrees C (32-100 degrees F).
  2. Hot Water and Glycol-Water: -1 - 116 degrees C (30-240 degrees F).

#### **2.18 FIRESTOPPING MATERIAL**

Refer to Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.

#### **2.19 ELECTRICAL HEAT TRACING SYSTEMS**

- A. Systems shall meet requirements of the National Electrical Code (NEC), Section 427.
- B. Provide tracing for outdoor piping subject to freezing temperatures (Below 38 degrees F) as follows:
  1. Not Used.
  2. Not Used.

3. Chilled water piping at units RTU-1 and all other areas exposed to the weather.
- C. Heat tracing shall be provided to the extent shown on the drawings (Floor plans and Elevations). Heat tracing shall extend below grade to below the defined frost line.
- D. Heating Cable: Flexible, parallel circuit construction consisting of a continuous self-limiting resistance, conductive inner core material between two parallel copper bus wires, designed for cut-to-length at the job site and for wrapping around valves and complex fittings. Self-regulation shall prevent overheating and burnouts even where the cable overlaps itself.
  1. Provide end seals at ends of circuits. Wire at the ends of the circuits is not to be tied together.
  2. Provide sufficient cable, as recommended by the manufacturer, to keep the pipe surface at 2.2 degrees C (36 degrees F) minimum during winter outdoor design temperature, but not less than the following:
    - a. 75 mm (3 inch) pipe and smaller with 25 mm (1 inch) thick insulation: 4 watts per foot of pipe.
    - b. 100 mm (4 inch) pipe and larger 38 mm (1-1/2 inch) thick insulation: 8 watts per foot of pipe.
- E. Electrical Heating Tracing Accessories:
  1. Power supply connection fitting and stainless steel mounting brackets. Provide stainless steel worm gear clamp to fasten bracket to pipe.
  2. 13 mm (1/2 inch) wide fiberglass reinforced pressure sensitive cloth tape to fasten cable to pipe at 300 mm (12 inch) intervals.
  3. Pipe surface temperature control thermostat: Cast aluminum, NEMA 4 (watertight) enclosure, 13 mm (1/2 inch) NPT conduit hub, SPST switch rated 20 amps at 480 volts AC, with capillary and copper bulb sensor. Set thermostat to maintain pipe surface temperature at not less than 1.1 degrees C (34 degrees F).
  4. Signs: Manufacturer's standard (NEC Code), stamped "ELECTRIC TRACED" located on the insulation jacket at 3000 mm (10 feet) intervals along the pipe on alternating sides.

### **PART 3 - EXECUTION**

#### **3.1 GENERAL**

- A. The drawings show the general arrangement of pipe and equipment but do not show all required fittings and offsets that may be necessary to

connect pipes to equipment, fan-coils, coils, radiators, etc., and to coordinate with other trades. Provide all necessary fittings, offsets and pipe runs based on field measurements and at no additional cost to the government. Coordinate with other trades for space available and relative location of HVAC equipment and accessories to be connected on ceiling grid. Pipe location on the drawings shall be altered by contractor where necessary to avoid interferences and clearance difficulties.

- B. Store materials to avoid excessive exposure to weather or foreign materials. Keep inside of piping relatively clean during installation and protect open ends when work is not in progress.
- C. Support piping securely. Refer to PART 3, Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION. Install heat exchangers at height sufficient to provide gravity flow of condensate to the flash tank and condensate pump.
- D. Install piping generally parallel to walls and column center lines, unless shown otherwise on the drawings. Space piping, including insulation, to provide 25 mm (one inch) minimum clearance between adjacent piping or other surface. Unless shown otherwise, slope drain piping down in the direction of flow not less than 25 mm (one inch) in 12 m (40 feet). Provide eccentric reducers to keep bottom of sloped piping flat.
- E. Locate and orient valves to permit proper operation and access for maintenance of packing, seat and disc. Generally locate valve stems in overhead piping in horizontal position. Provide a union adjacent to one end of all threaded end valves. Control valves usually require reducers to connect to pipe sizes shown on the drawing. Install butterfly valves with the valve open as recommended by the manufacturer to prevent binding of the disc in the seat.
- F. Offset equipment connections to allow valving off for maintenance and repair with minimal removal of piping. Provide flexibility in equipment connections and branch line take-offs with 3-elbow swing joints where noted on the drawings.
- G. Tee water piping runouts or branches into the side of mains or other branches. Avoid bull-head tees, which are two return lines entering opposite ends of a tee and exiting out the common side.

- H. Provide manual or automatic air vent at all piping system high points and drain valves at all low points. Install piping to floor drains from all automatic air vents.
- I. Connect piping to equipment as shown on the drawings. Install components furnished by others such as:
  - 1. Not Used.
  - 2. Flow elements (orifice unions), control valve bodies, flow switches, pressure taps with valve, and wells for sensors.
- J. Thermometer Wells: In pipes 65 mm (2-1/2 inches) and smaller increase the pipe size to provide free area equal to the upstream pipe area.
- K. Firestopping: Fill openings around uninsulated piping penetrating floors or fire walls, with firestop material. For firestopping insulated piping refer to Section 23 07 11, HVAC, PLUMBING, and BOILER PLANT INSULATION.
- L. Where copper piping is connected to steel piping, provide dielectric connections.

### **3.2 PIPE JOINTS**

- A. Welded: Beveling, spacing and other details shall conform to ASME B31.1 and AWS B2.1. See Welder's qualification requirements under "Quality Assurance" in Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.
- B. Screwed: Threads shall conform to ASME B1.20; joint compound shall be applied to male threads only and joints made up so no more than three threads show. Coat exposed threads on steel pipe with joint compound, or red lead paint for corrosion protection.
- C. Not Used.
- D. 125 Pound Cast Iron Flange (Plain Face): Mating flange shall have raised face, if any, removed to avoid overstressing the cast iron flange.

### **3.3 EXPANSION JOINTS (BELLOWS AND SLIP TYPE) NOT USED.**

### **3.4 SEISMIC BRACING ABOVEGROUND PIPING NOT USED.**

### **3.5 LEAK TESTING ABOVEGROUND PIPING**

- A. Inspect all joints and connections for leaks and workmanship and make corrections as necessary, to the satisfaction of the Project Manager. Tests may be either of those below, or a combination, as approved by the Project Manager.
- B. An operating test at design pressure, and for hot systems, design maximum temperature.

- C. A hydrostatic test at 1.5 times design pressure. For water systems the design maximum pressure would usually be the static head, or expansion tank maximum pressure, plus pump head. Factory tested equipment (convertors, exchangers, coils, etc.) need not be field tested. Isolate equipment where necessary to avoid excessive pressure on mechanical seals and safety devices.

### **3.6 FLUSHING AND CLEANING PIPING SYSTEMS**

- A. Water Piping: Clean systems as recommended by the suppliers of chemicals specified in Section 23 25 00, HVAC WATER TREATMENT.
1. Initial flushing: Remove loose dirt, mill scale, metal chips, weld beads, rust, and like deleterious substances without damage to any system component. Provide temporary piping or hose to bypass coils, control valves, exchangers and other factory cleaned equipment unless acceptable means of protection are provided and subsequent inspection of hide-out areas takes place. Isolate or protect clean system components, including pumps and pressure vessels, and remove any component which may be damaged. Open all valves, drains, vents and strainers at all system levels. Remove plugs, caps, spool pieces, and components to facilitate early debris discharge from system. Sectionalize system to obtain debris carrying velocity of 1.8 m/S (6 feet per second), if possible. Connect dead-end supply and return headers as necessary. Flush bottoms of risers. Install temporary strainers where necessary to protect down-stream equipment. Supply and remove flushing water and drainage by various type hose, temporary and permanent piping and Contractor's booster pumps. Flush until clean as approved by the Project Manager.
  2. Cleaning: Using products supplied in Section 23 25 00, HVAC WATER TREATMENT, circulatesystems at normal temperature to remove adherent organic soil, hydrocarbons, flux, pipe mill varnish, pipe joint compounds, iron oxide, and like deleterious substances not removed by flushing, without chemical or mechanical damage to any system component. Removal of tightly adherent mill scale is not required. Keep isolated equipment which is "clean" and where dead-end debris accumulation cannot occur. Sectionalize system if possible, to circulate at velocities not less than 1.8 m/S (6 feet per second). Circulate each section for not less than four hours. Blow-down all strainers, or remove and clean as frequently as necessary. Drain and prepare for final flushing.

3. Final Flushing: Return systems to conditions required by initial flushing after all cleaning solution has been displaced by clean make-up. Flush all dead ends and isolated clean equipment. Gently operate all valves to dislodge any debris in valve body by throttling velocity. Flush for not less than one hour.

**3.7 WATER TREATMENT NOT USED.**

**3.8 ELECTRIC HEAT TRACING**

- A. Install tracing as recommended by the manufacturer.
- B. Coordinate electrical connections.

**3.9 OPERATING AND PERFORMANCE TEST AND INSTRUCTION**

- A. Refer to PART 3, Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.
- B. Adjust red set hand on pressure gages to normal working pressure.

- - - E N D - - -





**SECTION 23 22 13**  
**STEAM AND CONDENSATE HEATING PIPING**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. Steam, condensate and vent piping inside buildings.

**1.2 RELATED WORK**

- A. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Not Used.
- C. Not Used.
- D. Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.
- E. Not Used.
- F. Section 23 07 11, HVAC, - AND BOILER PLANT INSULATION.
- G. Not Used.
- H. Not Used.
- I. Not Used.
- J. Not Used.
- K. Not Used.
- L. Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC.

**1.3 QUALITY ASSURANCE**

- A. Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION, which includes welding qualifications.

**1.4 SUBMITTALS**

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Manufacturer's Literature and Data:
  - 1. Pipe and equipment supports.
  - 2. Pipe and tubing, with specification, class or type, and schedule.
  - 3. Pipe fittings, including miscellaneous adapters and special fittings.
  - 4. Flanges, gaskets and bolting.
  - 5. Valves of all types.
  - 6. Strainers.
  - 7. Not Used.
  - 8. Not Used.
  - 9. Not Used.
  - 10. Not Used.
  - 11. All specified steam system components.
  - 12. Gages.

- 13. Thermometers and test wells.
- 14. Electric heat tracing systems.
- C. Manufacturer's certified data report, Form No. U-1, for ASME pressure vessels:
  - 1. Heat Exchangers (Steam-to-Hot Water).
  - 2. Flash tanks.
- D. Coordination Drawings: Refer to Article, SUBMITTALS of Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION.
- E. As-Built Piping Diagrams: Provide drawing as follows for steam and steam condensate piping and other central plant equipment.
  - 1. One wall-mounted stick file for prints. Mount stick file in the chiller plant or adjacent control room along with control diagram stick file.
  - 2. One set of reproducible drawings.

#### 1.5 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American Society of Mechanical Engineers/American National Standards Institute (ASME/ANSI):
  - B1.20.1-83(R2006).....Pipe Threads, General Purpose (Inch)
  - B16.4-2006.....Gray Iron Threaded Fittings
- C. American Society of Mechanical Engineers (ASME):
  - B16.1-2005.....Gray Iron Pipe Flanges and Flanged Fittings
  - B16.3-2006.....Malleable Iron Threaded Fittings
  - B16.9-2007.....Factory-Made Wrought Buttwelding Fittings
  - B16.11-2005.....Forged Fittings, Socket-Welding and Threaded
  - B16.14-91.....Ferrous Pipe Plugs, Bushings, and Locknuts with  
Pipe Threads
  - B16.39-98.....Malleable Iron Threaded Pipe Unions, Classes  
150, 250, and 300
  - B31.1-2007.....Power Piping
  - B31.9-2008.....Building Services Piping
  - B40.100-2005.....Pressure Gauges and Gauge Attachments
  - Boiler and Pressure Vessel Code: SEC VIII D1-2001, Pressure Vessels,  
Division 1
- D. American Society for Testing and Materials (ASTM):
  - A47-99.....Ferritic Malleable Iron Castings

- A53-2007.....Pipe, Steel, Black and Hot-Dipped, Zinc-Coated,  
Welded and Seamless
- A106-2008.....Seamless Carbon Steel Pipe for High-Temperature  
Service
- A126-2004.....Standard Specification for Gray Iron Castings  
for Valves, Flanges, and Pipe Fittings
- A181-2006.....Carbon Steel Forgings, for General-Purpose  
Piping
- A183-2003 ..... Carbon Steel Track Bolts and Nuts
- A216-2008 ..... Standard Specification for Steel Castings,  
Carbon, Suitable for Fusion Welding, for High  
Temperature Service
- A285-01 ..... Pressure Vessel Plates, Carbon Steel, Low-and-  
Intermediate-Tensile Strength
- A307-2007 ..... Carbon Steel Bolts and Studs, 60,000 PSI Tensile  
Strength
- A516-2006 ..... Pressure Vessel Plates, Carbon Steel, for  
Moderate-and- Lower Temperature Service
- A536-84(2004)e1 ..... Standard Specification for Ductile Iron Castings
- B32-2008 ..... Solder Metal
- B61-2008 ..... Steam or Valve Bronze Castings
- B62-2009 ..... Composition Bronze or Ounce Metal Castings
- E. American Welding Society (AWS):
- A5.8-2004.....Filler Metals for Brazing and Braze Welding
- B2.1-00.....Welding Procedure and Performance  
Qualifications
- F. Manufacturers Standardization Society (MSS) of the Valve and Fitting  
Industry, Inc.:
- SP-67-95.....Butterfly Valves
- SP-70-98.....Cast Iron Gate Valves, Flanged and Threaded  
Ends
- SP-71-97.....Gray Iron Swing Check Valves, Flanged and  
Threaded Ends
- SP-72-99.....Ball Valves with Flanged or Butt-Welding Ends  
for General Service
- SP-78-98.....Cast Iron Plug Valves, Flanged and Threaded  
Ends
- SP-80-97.....Bronze Gate, Globe, Angle and Check Valves

SP-85-94.....Cast Iron Globe and Angle Valves, Flanged and  
Threaded Ends

G. Military Specifications (Mil. Spec.):

MIL-S-901D-1989.....Shock Tests, H.I. (High Impact) Shipboard  
Machinery, Equipment, and Systems

H. National Board of Boiler and Pressure Vessel Inspectors (NB): Relieving  
Capacities of Safety Valves and Relief Valves

**PART 2 - PRODUCTS**

**2.1 PIPE AND EQUIPMENT SUPPORTS, PIPE SLEEVES, AND WALL AND CEILING PLATES**

A. Provide in accordance with Section 23 05 11, COMMON WORK RESULTS FOR  
HVAC AND STEAM GENERATION.

**2.2 PIPE AND TUBING**

A. Steam Piping: Steel, ASTM A53, Grade B, seamless or ERW; A106 Grade B,  
Seamless; Schedule 40.

B. Steam Condensate and Pumped Condensate Piping:

1. Not Used.

2. All other locations: steel, ASTM A53, Grade B, Seamless or ERW, or  
A106 Grade B Seamless, Schedule 80.

C. Vent Piping: Steel, ASTM A53, Grade B, seamless or ERW; A106 Grade B,  
Seamless; Schedule 40, galvanized.

**2.3 FITTINGS FOR STEEL PIPE**

A. 50 mm (2 inches) and Smaller: Screwed or welded.

1. Butt welding: ASME B16.9 with same wall thickness as connecting  
piping.

2. Forged steel, socket welding or threaded: ASME B16.11.

3. Screwed: 150 pound malleable iron, ASME B16.3. 125 pound cast iron,  
ASME B16.4, may be used in lieu of malleable iron, except for steam  
and steam condensate piping. Provide 300 pound malleable iron, ASME  
B16.3 for steam and steam condensate piping. Cast iron fittings or  
piping is not acceptable for steam and steam condensate piping.  
Bushing reduction of a single pipe size, or use of close nipples, is  
not acceptable.

4. Unions: ASME B16.39.

5. Steam line drip station and strainer quick-couple blowdown hose  
connection: Straight through, plug and socket, screw or cam locking  
type for 15 mm (1/2 inch) ID hose. No integral shut-off is required.

B. 65 mm (2-1/2 inches) and Larger: Welded or flanged joints.

1. Butt welding fittings: ASME B16.9 with same wall thickness as connecting piping. Elbows shall be long radius type, unless otherwise noted.
2. Welding flanges and bolting: ASME B16.5:
  - a. Steam service: Weld neck or slip-on, raised face, with non-asbestos gasket. Non-asbestos gasket shall either be stainless steel spiral wound strip with flexible graphite filler or compressed inorganic fiber with nitrile binder rated for saturated and superheated steam service 750 degrees F and 1500 psi.
  - b. Flange bolting: Carbon steel machine bolts or studs and nuts, ASTM A307, Grade B.
- C. Welded Branch and Tap Connections: Forged steel weldolets, or branchlets and threadolets may be used for branch connections up to one pipe size smaller than the main. Forged steel half-couplings, ASME B16.11 may be used for drain, vent and gage connections.

#### **2.4 FITTINGS FOR COPPER TUBING NOT USED.**

#### **2.5 DIELECTRIC FITTINGS**

- A. Provide where copper tubing and ferrous metal pipe are joined.
- B. 50 mm (2 inches) and Smaller: Threaded dielectric union, ASME B16.39.
- C. 65 mm (2 1/2 inches) and Larger: Flange union with dielectric gasket and bolt sleeves, ASME B16.42.
- D. Temperature Rating, 121 degrees C (250 degrees F) for steam condensate and as required for steam service.
- E. Contractor's option: On pipe sizes 2" and smaller, screwed end brass gate valves or dielectric nipples may be used in lieu of dielectric unions.

#### **2.6 SCREWED JOINTS**

- A. Pipe Thread: ANSI B1.20.
- B. Lubricant or Sealant: Oil and graphite or other compound approved for the intended service.

#### **2.7 VALVES**

- A. Asbestos packing is not acceptable.
- B. All valves of the same type shall be products of a single manufacturer.
- C. Provide chain operators for valves 150 mm (6 inches) and larger when the centerline is located 2100 mm (7 feet) or more above the floor or operating platform.
- D. Shut-Off Valves

## 1. Gate Valves:

- a. 50 mm (2 inches) and smaller: MSS-SP80, Bronze, 1034 kPa (150 lb.), wedge disc, rising stem, union bonnet.
- b. 65 mm (2 1/2 inches) and larger: Flanged, outside screw and yoke.
  - 1) High pressure steam 413 kPa (60 psig) and above nominal MPS system): Cast steel body, ASTM A216 grade WCB, 1034 kPa (150 psig) at 260 degrees C (500 degrees F), 11-1/2 to 13 percent chrome stainless steel solid disc and seats. Provide 25 mm (1 inch) factory installed bypass with globe valve on valves 100 mm (4 inches) and larger.
  - 2) All other services: MSS-SP 70, iron body, bronze mounted, 861 kPa (125 psig) wedge disc.

## E. Globe and Angle Valves:

## 1. Globe Valves:

- a. 50 mm (2 inches) and smaller: MSS-SP 80, bronze, 1034 kPa (150 lb.) Globe valves shall be union bonnet with metal plug type disc.
- b. 65 mm (2 1/2 inches) and larger:
  - 1) Globe valves for high pressure steam 413 kPa (60 psig) and above nominal MPS system): Cast steel body, ASTM A216 grade WCB, flanged, OS&Y, 1034 kPa (150 psig) at 260 degrees C (500 degrees F), 11-1/2 to 13 percent chrome stainless steel disc and renewable seat rings.
  - 2) All other services: 861 kPa (125 psig), flanged, iron body, bronze trim, MSS-SP-85 for globe valves.

## 2. Angle Valves

- a. 50 mm (2 inches) and smaller: MSS-SP 80, bronze, 1034 kPa (150 lb.) Angle valves shall be union bonnet with metal plug type disc.
- b. 65 mm (2 1/2 inches) and larger:
  - 1) Angle valves for high pressure steam 413 kPa (60 psig) and above nominal MPS system): Cast steel body, ASTM A216 grade WCB, flanged, OS&Y, 1034 kPa (150 psig) at 260 degrees C (500 degrees F), 11-1/2 to 13 percent chrome stainless steel disc and renewable seat rings.
  - 2) All other services: 861 kPa (125 psig), flanged, iron body, bronze trim, MSS-SP-85 for angle valves.

## F. Swing Check Valves

1. 50 mm (2 inches) and smaller: MSS-SP 80, bronze, 1034 kPa (150 psig), 45 degree swing disc.
2. 65 mm (2-1/2 inches) and Larger:
  - a Check valves for high pressure steam 413 kPa (60 psig) and above nominal MPS system: Cast steel body, ASTM A216 grade WCB, flanged, OS&Y, 1034 kPa (150 psig) at 260 degrees C (500 degrees F), 11-1/2 to 13 percent chrome stainless steel disc and renewable seat rings.
  - b. All other services: 861 kPa (125 psig), flanged, iron body, bronze trim, MSS-SP-71 for check valves.
- G. Manual Radiator/Convactor Valves: Brass, packless, with position indicator.

## **2.8 STRAINERS**

- A. Y Type. Tee type is acceptable for gravity flow and pumped steam condensate service.
- B. High Pressure Steam: Rated 1034 kPa (150 psig) saturated steam.
  1. 50 mm (2 inches) and smaller: Iron, ASTM A116 Grade B, or bronze, ASTM B-62 body with screwed connections (250 psig).
  2. 65 mm (2-1/2 inches) and larger: Flanged cast steel or 1723 kPa (250 psig) cast iron.
- C. All Other Services: Rated 861 kPa (125 psig) saturated steam.
  1. 50 mm (2 inches) and smaller: Cast iron or bronze.
  2. 65 mm (2-1/2 inches) and larger: Flanged, iron body.
- D. Screens: Bronze, monel metal or 18-8 stainless steel, free area not less than 2-1/2 times pipe area, with perforations as follows:
  1. 75 mm (3 inches) and smaller: 20 mesh for steam and 1.1 mm (0.045 inch) diameter perforations for liquids.
  2. 100 mm (4 inches) and larger: 1.1 mm (0.045) inch diameter perforations for steam and 3.2 mm (0.125 inch) diameter perforations for liquids.

## **2.9 PIPE ALIGNMENT NOT USED.**

## **2.10 EXPANSION JOINTS NOT USED.**

## **2.11 FLEXIBLE BALL JOINTS NOT USED.**

## **2.12 STEAM SYSTEM COMPONENTS**

- A. Not Used.
- B. Not Used.
- C. Not Used.

- D. Not Used.
- E. Not Used.
- F. Not Used.
- G. Steam Trap: Each type of trap shall be the product of a single manufacturer. Provide trap sets at all low points and at 61 m (200 feet) intervals on the horizontal main lines.
  - 1. Floats and linkages shall provide sufficient force to open trap valve over full operating pressure range available to the system. Unless otherwise indicated on the drawings, traps shall be sized for capacities indicated at minimum pressure drop as follows:
    - a. For equipment with modulating control valve: 1.7 kPa (1/4 psig), based on a condensate leg of 300 mm (12 inches) at the trap inlet and gravity flow to the receiver.
    - b. For main line drip trap sets and other trap sets at steam pressure: Up to 70 percent of design differential pressure. Condensate may be lifted to the return line.
  - 2. Trap bodies: Bronze, cast iron, or semi-steel, constructed to permit ease of removal and servicing working parts without disturbing connecting piping, (4 bolt raised face flange). For systems without relief valve traps shall be 5. Mechanism: Brass, stainless steel or corrosion resistant alloy rated for the pressure upstream of the PRV supplying the system.
  - 3. Balanced pressure thermostatic elements: Phosphor bronze, stainless steel or monel metal.
  - 4. Valves and seats: Suitable hardened corrosion resistant alloy.
  - 6. Floats: Stainless steel.
  - 7. Inverted bucket traps: Provide bi-metallic thermostatic element for rapid release of non-condensables.
- H. Thermostatic Air Vent (Steam): Brass or iron body, balanced pressure bellows, stainless steel (renewable) valve and seat, rated 861 kPa (125 psig) working pressure, 20 mm (3/4 inch) screwed connections. Air vents shall be balanced pressure type that responds to steam pressure-temperature curve and vents air at any pressure.

### **2.13 GAGES, PRESSURE AND COMPOUND**

- A. ASME B40.1, Accuracy Grade 1A, (pressure, vacuum, or compound), initial mid-scale accuracy 1 percent of scale (Qualify grade), metal or phenolic case, 115 mm (4-1/2 inches) in diameter, 6 mm (1/4 inch) NPT



bottom connection, white dial with black graduations and pointer, clear glass or acrylic plastic window, suitable for board mounting. Provide red "set hand" to indicate normal working pressure.

- B. Provide brass, lever handle union cock. Provide brass/bronze pressure snubber for gages in water service. Provide brass pigtail syphon for steam gages.
- C. Range of Gages: For services not listed provide range equal to at least 130 percent of normal operating range:

Low pressure steam and steam condensate to 103 kPa(15 psig)	0 to 207 kPa (30 psig).
Medium pressure steam and steam condensate nominal 413 kPa (60 psig)	0 to 689 kPa (100 psig).
High pressure steam and steam condensate nominal 620 kPa to 861 kPa (90 to 125 psig)	0 to 1378 kPa (200 psig).
Pumped condensate, steam condensate, gravity or vacuum (30" HG to 30 psig)	0 to 415 kPa (60 psig)

#### 2.14 PRESSURE/TEMPERATURE TEST PROVISIONS

- A. Provide one each of the following test items to the Project Manager:
  1. 6 mm (1/4 inch) FPT by 3 mm (1/8 inch) diameter stainless steel pressure gage adapter probe for extra long test plug. PETE'S 500 XL is an example.
  2. 90 mm (3-1/2 inch) diameter, one percent accuracy, compound gage, 762 mm (30 inches) Hg to 689 kPa (100 psig) range.
  3. 0 - 104 degrees C (32-220 degrees F) pocket thermometer one-half degree accuracy, 25 mm (one inch) dial, 125 mm (5 inch) long stainless steel stem, plastic case.

#### 2.15 FIRESTOPPING MATERIAL

- A. Refer to Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION.

#### 2.16 ELECTRICAL HEAT TRACING SYSTEMS

- A. Systems shall meet requirements of the National Electrical Code (NEC), Section 427.
- B. Provide tracing for outdoor piping subject to freezing temperatures (Below 38 degrees F) as follows:
  1. Steam piping exposed to weather.
  2. Steam condensate exposed to weather.

- C. Heat tracing shall be provided to the extent shown on the drawings (Floor Plans and Elevations). Heat tracing shall extend below grade to below the defined frost line.
- D. Heating Cable: Flexible, parallel circuit construction consisting of a continuous self-limiting resistance, conductive inner core material between two parallel copper bus wires, designed for cut-to-length at the job site and for wrapping around valves and complex fittings. Self-regulation shall prevent overheating and burnouts even where the cable overlaps itself.
  - 1. Provide end seals at ends of circuits. Wires at the ends of the circuits are not to be tied together.
  - 2. Provide sufficient cable, as recommended by the manufacturer, to keep the pipe surface at 2.2 degrees C (36 degrees F) minimum during winter outdoor design temperature, but not less than the following:
    - a. 75 mm (3 inch) pipe and smaller with 25 mm (1 inch) thick insulation: 4 watts per foot of pipe.
    - b. 100 mm (4 inch) pipe and larger 38 mm (1-1/2 inch) thick insulation: 8 watts per foot of pipe.
- E. Electrical Heating Tracing Accessories:
  - 1. Power supply connection fitting and stainless steel mounting brackets. Provide stainless steel worm gear clamp to fasten bracket to pipe.
  - 2. 13 mm (1/2 inch) wide fiberglass reinforced pressure sensitive cloth tape to fasten cable to pipe at 300 mm (12 inch) intervals.
  - 3. Pipe surface temperature control thermostat: Cast aluminum, NEMA 4 (watertight) enclosure, 13 mm (1/2 inch) NPT conduit hub, SPST switch rated 20 amps at 480 volts AC, with capillary and copper bulb sensor. Set thermostat to maintain pipe surface temperature at not less than 1.1 degrees C (34 degrees F).
  - 4. Signs: Manufacturer's standard (NEC Code), stamped "ELECTRIC TRACED" located on the insulation jacket at 3000 mm (10 feet) intervals along the pipe on alternating sides.

### **PART 3 - EXECUTION**

#### **3.1 GENERAL**

- A. The drawings show the general arrangement of pipe and equipment but do not show all required fittings and offsets that may be necessary to connect pipes to equipment, fan-coils, coils, radiators, etc., and to coordinate with other trades. Provide all necessary fittings, offsets

and pipe runs based on field measurements and at no additional cost to the government. Coordinate with other trades for space available and relative location of HVAC equipment and accessories to be connected on ceiling grid. Pipe location on the drawings shall be altered by contractor where necessary to avoid interferences and clearance difficulties.

- B. Store materials to avoid excessive exposure to weather or foreign materials. Keep inside of piping relatively clean during installation and protect open ends when work is not in progress.
- C. Support piping securely. Refer to PART 3, Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION. Install convertors and other heat exchangers at height sufficient to provide gravity flow of condensate to the flash tank and condensate pump.
- D. Install piping generally parallel to walls and column center lines, unless shown otherwise on the drawings. Space piping, including insulation, to provide 25 mm (one inch) minimum clearance between adjacent piping or other surface. Unless shown otherwise, slope steam, condensate and drain piping down in the direction of flow not less than 25 mm (one inch) in 12 m (40 feet). Provide eccentric reducers to keep bottom of sloped piping flat.
- E. Locate and orient valves to permit proper operation and access for maintenance of packing, seat and disc. Generally locate valve stems in overhead piping in horizontal position. Provide a union adjacent to one end of all threaded end valves. Control valves usually require reducers to connect to pipe sizes shown on the drawing. Install butterfly valves with the valve open as recommended by the manufacturer to prevent binding of the disc in the seat.
- F. Offset equipment connections to allow valving off for maintenance and repair with minimal removal of piping. Provide flexibility in equipment connections and branch line take-offs with 3-elbow swing joints where noted on the drawings.
- G. Tee water piping runouts or branches into the side of mains or other branches. Avoid bull-head tees, which are two return lines entering opposite ends of a tee and exiting out the common side.
- H. Connect piping to equipment as shown on the drawings. Install components furnished by others such as:
  - 1. Flow elements (orifice unions), control valve bodies, flow switches, pressure taps with valve, and wells for sensors.

- I. Firestopping: Fill openings around uninsulated piping penetrating floors or fire walls, with firestop material. For firestopping insulated piping refer to Section 23 07 11, HVAC, and BOILER PLANT INSULATION.
- J. Where copper piping is connected to steel piping, provide dielectric connections.

### **3.2 PIPE JOINTS**

- A. Welded: Beveling, spacing and other details shall conform to ASME B31.1 and AWS B2.1. See Welder's qualification requirements under "Quality Assurance" in Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.
- B. Screwed: Threads shall conform to ASME B1.20; joint compound shall be applied to male threads only and joints made up so no more than three threads show. Coat exposed threads on steel pipe with joint compound, or red lead paint for corrosion protection.
- C. 125 Pound Cast Iron Flange (Plain Face): Mating flange shall have raised face, if any, removed to avoid overstressing the cast iron flange.

### **3.3 EXPANSION JOINTS (BELLOWS AND SLIP TYPE) NOT USED.**

### **3.4 STEAM TRAP PIPING**

- A. Install to permit gravity flow to the trap. Provide gravity flow (avoid lifting condensate) from the trap where modulating control valves are used. Support traps weighing over 11 kg (25 pounds) independently of connecting piping.

### **3.5 SEISMIC BRACING NOT USED.**

### **3.6 LEAK TESTING**

- A. Inspect all joints and connections for leaks and workmanship and make corrections as necessary, to the satisfaction of the Project Manager in accordance with the specified requirements. Testing shall be performed in accordance with the specification requirements.
- B. An operating test at design pressure, and for hot systems, design maximum temperature.
- C. A hydrostatic test at 1.5 times design pressure. For water systems the design maximum pressure would usually be the static head, or expansion tank maximum pressure, plus pump head. Factory tested equipment (convertors, exchangers, coils, etc.) need not be field tested. Avoid excessive pressure on mechanical seals and safety devices.

**3.7 FLUSHING AND CLEANING PIPING SYSTEMS**

- A. Steam, Condensate and Vent Piping: No flushing or chemical cleaning required. Accomplish cleaning by pulling all strainer screens and cleaning all scale/dirt legs during start-up operation.

**3.8 OPERATING AND PERFORMANCE TEST AND INSTRUCTION**

- A. Refer to PART 3, Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.
- B. Adjust red set hand on pressure gages to normal working pressure.

- - - E N D - - -



**SECTION 23 23 00**  
**REFRIGERANT PIPING**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. Field refrigerant piping for direct expansion HVAC systems.
- B. Refrigerant piping shall be sized, selected, and designed either by the equipment manufacturer or in strict accordance with the manufacturer's published instructions. The schematic piping diagram shall show all accessories such as, stop valves, level indicators, liquid receivers, oil separator, gauges, thermostatic expansion valves, solenoid valves, moisture separators and driers to make a complete installation.
- C. Definitions:
  - 1. Refrigerating system: Combination of interconnected refrigerant-containing parts constituting one closed refrigeration circuit in which a refrigerant is circulated for the purpose of extracting heat.
    - a. Low side means the parts of a refrigerating system subjected to evaporator pressure.
    - b. High side means the parts of a refrigerating system subjected to condenser pressure.
  - 2. Brazed joint: A gas-tight joint obtained by the joining of metal parts with alloys which melt at temperatures higher than 449 degrees C (840 degrees F) but less than the melting temperatures of the joined parts.

**1.2 RELATED WORK**

- A. Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION: General mechanical requirements and items, which are common to more than one section of Division 23.
- B. Section 23 07 11, HVAC, PLUMBING, and BOILER PLANT INSULATION: Requirements for piping insulation.
- C. Section 23 21 13, HYDRONIC PIPING: Requirements for water and drain piping and valves.

**1.3 QUALITY ASSURANCE**

- A. Refer to specification Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.
- B. Comply with ASHRAE Standard 15, Safety Code for Mechanical Refrigeration. The application of this Code is intended to assure the safe design, construction, installation, operation, and inspection of every refrigerating system employing a fluid which normally is vaporized and liquefied in its refrigerating cycle.

- C. Comply with ASME B31.5: Refrigerant Piping and Heat Transfer Components.
- D. Products shall comply with UL 207 "Refrigerant-Containing Components and Accessories, "Nonelectrical"; or UL 429 "Electrical Operated Valves."

#### **1.4 SUBMITTALS**

- A. Submit in accordance with specification Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Shop Drawings:
  - 1. Complete information for components noted, including valves and refrigerant piping accessories, clearly presented, shall be included to determine compliance with drawings and specifications for components noted below:
    - a. Tubing and fittings
    - b. Valves
    - c. Strainers
    - d. Moisture-liquid indicators
    - e. Filter-driers
    - f. Flexible metal hose
    - g. Liquid-suction interchanges
    - h. Oil separators (when specified)
    - i. Gages
    - j. Pipe and equipment supports
    - k. Refrigerant and oil
    - l. Pipe/conduit roof penetration cover
    - m. Soldering and brazing materials
  - 2. Layout of refrigerant piping and accessories, including flow capacities, valves locations, and oil traps slopes of horizontal runs, floor/wall penetrations, and equipment connection details.
- C. Certification: Copies of certificates for welding procedure, performance qualification record and list of welders' names and symbols.
- D. Design Manual: Furnish two copies of design manual of refrigerant valves and accessories.

#### **1.5 APPLICABLE PUBLICATIONS**

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. Air Conditioning, Heating, and Refrigeration Institute (ARI/AHRI):
  - 495-1999 (R2002).....Standard for Refrigerant Liquid Receivers
  - 730-2005.....Flow Capacity Rating of Suction-Line Filters and Suction-Line Filter-Driers
  - 750-2007.....Thermostatic Refrigerant Expansion Valves



- 760-2007.....Performance Rating of Solenoid Valves for Use  
with Volatile Refrigerants
- C. American Society of Heating Refrigerating and Air Conditioning Engineers  
(ASHRAE):
- ANSI/ASHRAE 15-2007.....Safety Standard for Refrigeration Systems (ANSI)
- ANSI/ASHRAE 17-2008.....Method of Testing Capacity of Thermostatic  
Refrigerant Expansion Valves (ANSI)
- 63.1-95 (RA 01).....Method of Testing Liquid Line Refrigerant Driers  
(ANSI)
- D. American National Standards Institute (ANSI):
- ASME (ANSI)A13.1-2007...Scheme for Identification of Piping Systems
- Z535.1-2006.....Safety Color Code
- E. American Society of Mechanical Engineers (ASME):
- ANSI/ASME B16.22-2001 (R2005)
- Wrought Copper and Copper Alloy Solder-Joint Pressure Fittings (ANSI)
- ANSI/ASME B16.24-2006 Cast Copper Alloy Pipe Flanges and Flanged  
Fittings, Class 150, 300, 400, 600, 900, 1500 and 2500 (ANSI)
- ANSI/ASME B31.5-2006....Refrigeration Piping and Heat Transfer  
Components (ANSI)
- ANSI/ASME B40.100-2005..Pressure Gauges and Gauge Attachments
- ANSI/ASME B40.200-2008..Thermometers, Direct Reading and Remote Reading
- F. American Society for Testing and Materials (ASTM)
- A126-04.....Standard Specification for Gray Iron Castings  
for Valves, Flanges, and Pipe FittingsB32-08  
Standard Specification for Solder Metal
- B88-03.....Standard Specification for Seamless Copper Water  
Tube
- B88M-05.....Standard Specification for Seamless Copper Water  
Tube (Metric)
- B280-08.....Standard Specification for Seamless Copper Tube  
for Air Conditioning and Refrigeration Field  
Service
- G. American Welding Society, Inc. (AWS):
- Brazing Handbook
- A5.8/A5.8M-04.....Standard Specification for Filler Metals for  
Brazing and Braze Welding
- H. Federal Specifications (Fed. Spec.)
- Fed. Spec. GG
- I. Underwriters Laboratories (U.L.):
- U.L.207-2009.....Standard for Refrigerant-Containing Components  
and Accessories, Nonelectrical

U.L.429-99 (Rev.2006)...Standard for Electrically Operated Valves

## **PART 2 - PRODUCTS**

### **2.1 PIPING AND FITTINGS**

- A. Refrigerant Piping: For piping up to 100 mm (4 inch) use Copper refrigerant tube, ASTM B280, cleaned, dehydrated and sealed, marked ACR on hard temper straight lengths. Coils shall be tagged ASTM B280 by the manufacturer.
- B. Water and Drain Piping: Copper water tube, ASTM B88M, Type B or C (ASTM B88, Type M or L).
- C. Fittings, Valves and Accessories:
  - 1. Copper fittings: Wrought copper fittings, ASME B16.22.
    - a. Braze Joints, refrigerant tubing: Cadmium free, AWS A5.8/A5.8M, 45 percent silver brazing alloy, Class BAg-5.
    - b. Solder Joints, water and drain: 95-5 tin-antimony, ASTM B32 (95TA).
  - 2. Steel fittings: ASTM wrought steel fittings.
    - a. Refrigerant piping - Welded Joints.
  - 3. Flanges and flanged fittings: ASME B16.24.
  - 4. Refrigeration Valves:
    - a. Stop Valves: Brass or bronze alloy, packless, or packed type with gas tight cap, frost proof, back seating.
    - b. Pressure Relief Valves: Comply with ASME Boiler and Pressure Vessel Code; UL listed. Forged brass with nonferrous, corrosion resistant internal working parts of high strength, cast iron bodies conforming to ASTM A126, Grade B. Set valves in accordance with ASHRAE Standard 15.
    - c. Solenoid Valves: Comply with ARI 760 and UL 429, UL-listed, two-position, direct acting or pilot-operated, moisture and vapor-proof type of corrosion resisting materials, designed for intended service, and solder-end connections. Fitted with suitable NEMA 250 enclosure of type required by location and normally closed holding coil.
    - d. Thermostatic Expansion Valves: Comply with ARI 750. Brass body with stainless-steel or non-corrosive non ferrous internal parts, diaphragm and spring-loaded (direct-operated) type with sensing bulb and distributor having side connection for hot-gas bypass and external equalizer. Size and operating characteristics as recommended by manufacturer of evaporator and factory set for superheat requirements. Solder-end connections. Testing and rating in accordance with ASHRAE Standard 17.

- e. Check Valves: Brass or bronze alloy with swing or lift type, with tight closing resilient seals for silent operation; designed for low pressure drop, and with solder-end connections. Direction of flow shall be legibly and permanently indicated on the valve body.
- 5. Strainers: Designed to permit removing screen without removing strainer from piping system, and provided with screens 80 to 100 mesh in liquid lines DN 25 (NPS 1) and smaller, 60 mesh in liquid lines larger than DN 25 (NPS 1), and 40 mesh in suction lines. Provide strainers in liquid line serving each thermostatic expansion valve, and in suction line serving each refrigerant compressor not equipped with integral strainer.
- 6. Refrigerant Moisture/Liquid Indicators: Double-ported type having heavy sight glasses sealed into forged bronze body and incorporating means of indicating refrigerant charge and moisture indication. Provide screwed brass seal caps.
- 7. Refrigerant Filter-Dryers: UL listed, angle or in-line type, as shown on drawings. Conform to ARI Standard 730 and ASHRAE Standard 63.1. Heavy gage steel shell protected with corrosion-resistant paint; perforated baffle plates to prevent desiccant bypass. Size as recommended by manufacturer for service and capacity of system with connection not less than the line size in which installed. Filter driers with replaceable filters shall be furnished with one spare element of each type and size.
- 8. Flexible Metal Hose: Seamless bronze corrugated hose, covered with bronze wire braid, with standard copper tube ends. Provide in suction and discharge piping of each compressor.

## 2.2 GAGES

- A. Temperature Gages: Comply with ASME B40.200. Industrial-duty type and in required temperature range for service in which installed. Gages shall have Celsius scale in 1-degree (Fahrenheit scale in 2-degree) graduations and with black number on a white face. The pointer shall be adjustable. Rigid stem type temperature gages shall be provided in thermal wells located within 1525 mm (5 feet) of the finished floor. Universal adjustable angle type or remote element type temperature gages shall be provided in thermal wells located 1525 to 2135 mm (5 to 7 feet) above the finished floor. Remote element type temperature gages shall be provided in thermal wells located 2135 mm (7 feet) above the finished floor.
- B. Vacuum and Pressure Gages: Comply with ASME B40.100 and provide with throttling type needle valve or a pulsation dampener and shut-off valve. Gage shall be a minimum of 90 mm (3-1/2 inches) in diameter with a range

from 0 kPa (0 psig) to approximately 1.5 times the maximum system working pressure. Each gage range shall be selected so that at normal operating pressure, the needle is within the middle-third of the range.

1. Suction: 101 kPa (30 inches Hg) vacuum to 1723 kPa (gage) (250 psig).
2. Discharge: 0 to 3445 kPa (gage) (0 to 500 psig).

### **2.3 THERMOMETERS AND WELLS**

- A. Refer to specification Section 23 21 13, HYDRONIC PIPING.

### **2.4 PIPE SUPPORTS**

- A. Refer to specification Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.

### **2.5 ELECTRICAL HEAT TRACING SYSTEM**

- A. Refer to specification Section 23 21 13, HYDRONIC PIPING. Provide for freezer unit cooler drain piping.

### **2.6 REFRIGERANTS AND OIL**

- A. Provide EPA approved refrigerant and oil for proper system operation.

### **2.7 PIPE/CONDUIT ROOF PENETRATION COVER**

- A. Prefabricated Roof Curb: Galvanized steel or extruded aluminum 300 mm (12 inches) overall height, continuous welded corner seams, treated wood nailer, 38 mm (1-1/2 inch) thick, 48 kg/cu.m (3 lb/cu.ft.) density rigid mineral fiberboard insulation with metal liner, built-in cant strip (except for gypsum or tectum decks). For surface insulated roof deck, provide raised cant strip (recessed mounting flange) to start at the upper surface of the insulation. Curbs shall be constructed for pitched roof or ridge mounting as required to keep top of curb level.
- B. Penetration Cover: Galvanized sheet metal with flanged removable top. Provide 38 mm (1-1/2 inch) thick mineral fiber board insulation.
- C. Flashing Sleeves: Provide sheet metal sleeves for conduit and pipe penetrations of the penetration cover. Seal watertight penetrations.

### **2.8 PIPE INSULATION FOR DX HVAC SYSTEMS**

Refer to specification Section 23 07 11, HVAC, PLUMBING, and BOILER PLANT INSULATION.

## **PART 3 - EXECUTION**

### **3.1 INSTALLATION**

- A. Install refrigerant piping and refrigerant containing parts in accordance with ASHRAE Standard 15 and ASME B31.5
  1. Install piping as short as possible, with a minimum number of joints, elbow and fittings.
  2. Install piping with adequate clearance between pipe and adjacent walls and hangers to allow for service and inspection. Space piping, including insulation, to provide 25 mm (1 inch) minimum clearance

between adjacent piping or other surface. Use pipe sleeves through walls, floors, and ceilings, sized to permit installation of pipes with full thickness insulation.

3. Locate and orient valves to permit proper operation and access for maintenance of packing, seat and disc. Generally locate valve stems in overhead piping in horizontal position. Provide a union adjacent to one end of all threaded end valves. Control valves usually require reducers to connect to pipe sizes shown on the drawing.
4. Use copper tubing in protective conduit when installed below ground.
5. Install hangers and supports per ASME B31.5 and the refrigerant piping manufacturer's recommendations.

**B. Joint Construction:**

1. Brazed Joints: Comply with AWS "Brazing Handbook" and with filler materials complying with AWS A5.8/A5.8M.
  - a. Use Type BcuP, copper-phosphorus alloy for joining copper socket fittings with copper tubing.
  - b. Use Type BAg, cadmium-free silver alloy for joining copper with bronze or steel.
  - c. Swab fittings and valves with manufacturer's recommended cleaning fluid to remove oil and other compounds prior to installation.
  - d. Pass nitrogen gas through the pipe or tubing to prevent oxidation as each joint is brazed. Cap the system with a reusable plug after each brazing operation to retain the nitrogen and prevent entrance of air and moisture.

- C. Protect refrigerant system during construction against entrance of foreign matter, dirt and moisture; have open ends of piping and connections to compressors, condensers, evaporators and other equipment tightly capped until assembly.
- D. Pipe relief valve discharge to outdoors for systems containing more than 45 kg (100 lbs) of refrigerant.
- E. Firestopping: Fill openings around uninsulated piping penetrating floors or fire walls, with firestop material. For firestopping insulated piping refer to Section 23 07 11, HVAC, PLUMBING, and BOILER PLANT INSULATION.

### **3.2 PIPE AND TUBING INSULATION**

- A. Refer to specification Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.
- B. Apply two coats of weather-resistant finish as recommended by the manufacturer to insulation exposed to outdoor weather.

### **3.3 SIGNS AND IDENTIFICATION**

- A. Each refrigerating system erected on the premises shall be provided with an easily legible permanent sign securely attached and easily

accessible, indicating thereon the name and address of the installer, the kind and total number of pounds of refrigerant required in the system for normal operations, and the field test pressure applied.

- B. Systems containing more than 50 kg (110 lb) of refrigerant shall be provided with durable signs, in accordance with ANSI A13.1 and ANSI Z535.1, having letters not less than 13 mm (1/2 inch) in height designating:
  - 1. Valves and switches for controlling refrigerant flow, the ventilation and the refrigerant compressor(s).
  - 2. Signs on all exposed high pressure and low pressure piping installed outside the machinery room, with name of the refrigerant and the letters "HP" or "LP."

### **3.4 FIELD QUALITY CONTROL**

- A. Prior to initial operation examine and inspect piping system for conformance to plans and specifications and ASME B31.5. Correct equipment, material, or work rejected because of defects or nonconformance with plans and specifications, and ANSI codes for pressure piping.
- B. After completion of piping installation and prior to initial operation, conduct test on piping system according to ASME B31.5. Furnish materials and equipment required for tests. Perform tests in the presence of Project Manager. If the test fails, correct defects and perform the test again until it is satisfactorily done and all joints are proved tight.
  - 1. Every refrigerant-containing parts of the system that is erected on the premises, except compressors, condensers, evaporators, safety devices, pressure gages, control mechanisms and systems that are factory tested, shall be tested and proved tight after complete installation, and before operation.
  - 2. The high and low side of each system shall be tested and proved tight at not less than the lower of the design pressure or the setting of the pressure-relief device protecting the high or low side of the system, respectively, except systems erected on the premises using non-toxic and non-flammable Group A1 refrigerants with copper tubing not exceeding DN 18 (NPS 5/8). This may be tested by means of the refrigerant charged into the system at the saturated vapor pressure of the refrigerant at 20 degrees C (68 degrees F) minimum.
- C. Test Medium: A suitable dry gas such as nitrogen or shall be used for pressure testing. The means used to build up test pressure shall have either a pressure-limiting device or pressure-reducing device with a pressure-relief device and a gage on the outlet side. The pressure

relief device shall be set above the test pressure but low enough to prevent permanent deformation of the system components.

### 3.5 SYSTEM TEST AND CHARGING

A. System Test and Charging: As recommended by the equipment manufacturer or as follows:

1. Connect a drum of refrigerant to charging connection and introduce enough refrigerant into system to raise the pressure to 70 kPa (10 psi) gage. Close valves and disconnect refrigerant drum. Test system for leaks with halide test torch or other approved method suitable for the test gas used. Repair all leaking joints and retest.
2. Connect a drum of dry nitrogen to charging valve and bring test pressure to design pressure for low side and for high side. Test entire system again for leaks.
3. Evacuate the entire refrigerant system by the triplicate evacuation method with a vacuum pump equipped with an electronic gage reading in mPa (microns). Pull the system down to 665 mPa (500 microns) 665 mPa (2245.6 inches of mercury at 60 degrees F) and hold for four hours then break the vacuum with dry nitrogen (or refrigerant). Repeat the evacuation two more times breaking the third vacuum with the refrigeration to be charged and charge with the proper volume of refrigerant.

- - - E N D - - -





**SECTION 23 31 00  
HVAC DUCTS AND CASINGS**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. Ductwork and accessories for HVAC including the following:
  - 1. Supply air, return air, outside air, exhaust, make-up air, and relief systems.
  - 2. Exhaust duct with HEPA filters for Negative Pressure Isolation Room.
  - 3. Not Used.
- B. Definitions:
  - 1. SMACNA Standards as used in this specification means the HVAC Duct Construction Standards, Metal and Flexible.
  - 2. Seal or Sealing: Use of liquid or mastic sealant, with or without compatible tape overlay, or gasketing of flanged joints, to keep air leakage at duct joints, seams and connections to an acceptable minimum.
  - 3. Duct Pressure Classification: SMACNA HVAC Duct Construction Standards, Metal and Flexible.
  - 4. Exposed Duct: Exposed to view in a finished room, exposed to weather.

**1.2 RELATED WORK**

- A. Fire Stopping Material: Section 07 84 00, FIRESTOPPING.
- B. Not Used.
- C. Not Used.
- D. Not Used.
- E. Not Used.
- F. General Mechanical Requirements: Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.
- G. Not Used.
- H. Duct Insulation: Section 23 07 11, HVAC, PLUMBING, and BOILER PLANT INSULATION
- I. Plumbing Connections: Section 22 11 00, FACILITY WATER DISTRIBUTION
- J. Air Flow Control Valves and Terminal Units: Section 23 36 00, AIR TERMINAL UNITS.
- K. Not Used.
- L. Supply Air Fans: Section 23 74 13 Packaged, Outdoor, Central Station Air-Handling Units.
- M. Return Air and Exhaust Air Fans: Section 23 34 00, HVAC FANS.
- N. Not Used.
- O. Duct Mounted Instrumentation: Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC.

P. Testing and Balancing of Air Flows: Section 23 05 93, TESTING, ADJUSTING, and BALANCING FOR HVAC.

Q. Smoke Detectors: Section 28 31 00, FIRE DETECTION and ALARM.

### **1.3 QUALITY ASSURANCE**

- A. Refer to article, QUALITY ASSURANCE, in Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.
- B. Fire Safety Code: Comply with NFPA 90A.
- C. Duct System Construction and Installation: Referenced SMACNA Standards are the minimum acceptable quality.
- D. Duct Sealing, Air Leakage Criteria, and Air Leakage Tests: Ducts shall be sealed as per duct sealing requirements of SMACNA HVAC Air Duct Leakage Test Manual for duct pressure classes shown on the drawings.
- E. Duct accessories exposed to the air stream, such as dampers of all types (except smoke dampers) and access openings, shall be of the same material as the duct or provide at least the same level of corrosion resistance.

### **1.4 SUBMITTALS**

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Manufacturer's Literature and Data:
  - 1. Rectangular ducts:
    - a. Schedules of duct systems, materials and selected SMACNA construction alternatives for joints, sealing, gage and reinforcement.
    - b. Not Used.
    - c. Sealants and gaskets.
    - d. Access doors.
  - 2. Round and flat oval duct construction details:
    - a. Manufacturer's details for duct fittings.
    - b. Not Used.
    - c. Sealants and gaskets.
    - d. Access sections.
    - e. Installation instructions.
  - 3. Volume dampers, back draft dampers.
  - 4. Upper hanger attachments.
  - 5. Fire dampers, fire doors, and smoke dampers with installation instructions.
  - 6. Not Used.
  - 7. Flexible ducts and clamps, with manufacturer's installation instructions.
  - 8. Flexible connections.

- 9. Instrument test fittings.
- 10 Details and design analysis of alternate or optional duct systems.
- 11 COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.
- C. Coordination Drawings: Refer to article, SUBMITTALS, in Section 23 05 11  
- Common Work Results for HVAC and Steam Generation.

#### 1.5 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American Society of Civil Engineers (ASCE):  
ASCE7-05.....Minimum Design Loads for Buildings and Other Structures
- C. American Society for Testing and Materials (ASTM):  
A167-99(2009).....Standard Specification for Stainless and Heat-Resisting Chromium-Nickel Steel Plate, Sheet, and Strip  
A653-09.....Standard Specification for Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy coated (Galvannealed) by the Hot-Dip process  
A1011-09a.....Standard Specification for Steel, Sheet and Strip, Hot rolled, Carbon, structural, High-Strength Low-Alloy, High Strength Low-Alloy with Improved Formability, and Ultra-High Strength  
B209-07.....Standard Specification for Aluminum and Aluminum-Alloy Sheet and Plate  
C1071-05e1.....Standard Specification for Fibrous Glass Duct Lining Insulation (Thermal and Sound Absorbing Material)  
E84-09a.....Standard Test Method for Surface Burning Characteristics of Building Materials
- D. National Fire Protection Association (NFPA):  
90A-09.....Standard for the Installation of Air Conditioning and Ventilating Systems
- E. Sheet Metal and Air Conditioning Contractors National Association (SMACNA):  
2nd Edition - 2005.....HVAC Duct Construction Standards, Metal and Flexible  
1st Edition - 1985.....HVAC Air Duct Leakage Test Manual
- F. Underwriters Laboratories, Inc. (UL):  
181-08.....Factory-Made Air Ducts and Air Connectors  
555-06 .....Standard for Fire Dampers

555S-06 .....Standard for Smoke Dampers

## **PART 2 - PRODUCTS**

### **2.1 DUCT MATERIALS AND SEALANTS**

- A. General: Except for systems specified otherwise, construct ducts, casings, and accessories of galvanized sheet steel, ASTM A653, coating G90; or, aluminum sheet, ASTM B209, alloy 1100, 3003 or 5052.
- B. Specified Corrosion Resistant Systems: Stainless steel sheet, ASTM A167, Class 302 or 304, Condition A (annealed) Finish No. 4 for exposed ducts and Finish No. 2B for concealed duct or ducts located in mechanical rooms.
- C. Not Used.
- D. Joint Sealing: Refer to SMACNA HVAC Duct Construction Standards, paragraph S1.9.
  - 1. Sealant: Elastomeric compound, gun or brush grade, maximum 25 flame spread and 50 smoke developed (dry state) compounded specifically for sealing ductwork as recommended by the manufacturer. Generally provide liquid sealant, with or without compatible tape, for low clearance slip joints and heavy, permanently elastic, mastic type where clearances are larger. Oil base caulking and glazing compounds are not acceptable because they do not retain elasticity and bond.
  - 2. Tape: Use only tape specifically designated by the sealant manufacturer and apply only over wet sealant. Pressure sensitive tape shall not be used on bare metal or on dry sealant.
  - 3. Gaskets in Flanged Joints: Soft neoprene.
- E. Approved factory made joints may be used.

### **2.2 DUCT CONSTRUCTION AND INSTALLATION**

- A. Regardless of the pressure classifications outlined in the SMACNA Standards, fabricate and seal the ductwork in accordance with the following pressure classifications:
- B. Duct Pressure Classification:
  - 0 to 50 mm (2 inch)
  - > 50 mm to 75 mm (2 inch to 3 inch)
  - > 75 mm to 100 mm (3 inch to 4 inch)
 Show pressure classifications on the floor plans.
- C. Seal Class: All ductwork shall receive Class A Seal
- D. Not Used.
- E. Not Used.
- F. Not Used.
- G. Not Used.
- H. Not Used.
- I. Not Used.

J. Not Used.

K. Not Used.

L. Not Used.

M. Round and Flat Oval Ducts: Furnish duct and fittings made by the same manufacturer to insure good fit of slip joints. When submitted and approved in advance, round and flat oval duct, with size converted on the basis of equal pressure drop, may be furnished in lieu of rectangular duct design shown on the drawings.

1. Elbows: Diameters 80 through 200 mm (3 through 8 inches) shall be two sections die stamped, all others shall be gored construction, maximum 18 degree angle, with all seams continuously welded or standing seam. Coat galvanized areas of fittings damaged by welding with corrosion resistant aluminum paint or galvanized repair compound.
2. Provide bell mouth, conical tees or taps, laterals, reducers, and other low loss fittings as shown in SMACNA HVAC Duct Construction Standards.
3. Ribbed Duct Option: Lighter gage round/oval duct and fittings may be furnished provided certified tests indicating that the rigidity and performance is equivalent to SMACNA standard gage ducts are submitted.
  - a. Ducts: Manufacturer's published standard gage, G90 coating, spiral lock seam construction with an intermediate standing rib.
  - b. Fittings: May be manufacturer's standard as shown in published catalogs, fabricated by spot welding and bonding with neoprene base cement or machine formed seam in lieu of continuous welded seams.
4. Provide flat side reinforcement of oval ducts as recommended by the manufacturer and SMACNA HVAC Duct Construction Standard S3.13. Because of high pressure loss, do not use internal tie-rod reinforcement unless approved by the Project Manager.

N. Not Used.

O. Casings and Plenums: Construct in accordance with SMACNA HVAC Duct Construction Standards Section 6, including curbs, access doors, pipe penetrations, eliminators and drain pans. Access doors shall be hollow metal, insulated, with latches and door pulls, 500 mm (20 inches) wide by 1200 - 1350 mm (48 - 54 inches) high. Provide view port in the doors where shown. Provide drain for outside air louver plenum. Outside air plenum shall have exterior insulation. Drain piping shall be routed to the nearest floor drain.

- P. Volume Dampers: Single blade or opposed blade, multi-louver type as detailed in SMACNA Standards. Refer to SMACNA Detail Figure 2-12 for Single Blade and Figure 2.13 for Multi-blade Volume Dampers.
- Q. Duct Hangers and Supports: Refer to SMACNA Standards Section IV. Avoid use of trapeze hangers for round duct.
- R. Ductwork in excess of 620 cm<sup>2</sup> (96 square inches) shall be protected unless the duct has one dimension less than 150 mm (6 inches) if it passes through the areas listed below. Refer to the Mission Critical Physical Design Manual for VA Facilities. This applies to the following:
  - 1. Agent cashier spaces
  - 2. Perimeter partitions of caches
  - 3. Perimeter partitions of computer rooms
  - 4. Perimeter of a COOP sites
  - 5. Perimeter partitions of Entrances
  - 6. Security control centers (SCC)

### **2.3 DUCT LINER (WHERE INDICATED ON DRAWINGS) NOT USED.**

### **2.4 DUCT ACCESS DOORS, PANELS AND SECTIONS**

- A. Provide access doors, sized and located for maintenance work, upstream, in the following locations:
  - 1. Each duct mounted coil and humidifier.
  - 2. Each fire damper (for link service), smoke damper and automatic control damper.
  - 3. Each duct mounted smoke detector.
  - 4. Not Used.
- B. Openings shall be as large as feasible in small ducts, 300 mm by 300 mm (12 inch by 12 inch) minimum where possible. Access sections in insulated ducts shall be double-wall, insulated. Transparent shatterproof covers are preferred for uninsulated ducts.
  - 1. For rectangular ducts: Refer to SMACNA HVAC Duct Construction Standards (Figure 2-12).
  - 2. For round and flat oval duct: Refer to SMACNA HVAC duct Construction Standards (Figure 2-11).

### **2.5 FIRE DAMPERS**

- A. Galvanized steel, interlocking blade type, UL listing and label, 1-1/2 hour rating, 70 degrees C (160 degrees F) fusible line, 100 percent free opening with no part of the blade stack or damper frame in the air stream.
- B. Fire dampers in wet air exhaust shall be of stainless steel construction, all others may be galvanized steel.
- C. Minimum requirements for fire dampers:

1. The damper frame may be of design and length as to function as the mounting sleeve, thus eliminating the need for a separate sleeve, as allowed by UL 555. Otherwise provide sleeves and mounting angles, minimum 1.9 mm (14 gage), required to provide installation equivalent to the damper manufacturer's UL test installation.
2. Submit manufacturer's installation instructions conforming to UL rating test.

## **2.6 SMOKE DAMPERS**

- A. Maximum air velocity, through free area of open damper, and pressure loss: Low pressure and medium pressure duct (supply, return, exhaust, outside air): 450 m/min (1500 fpm). Maximum static pressure loss: 32 Pa (0.13 inch W.G.).
- B. Maximum air leakage, closed damper: 0.32 cubic meters /min/square meter (4.0 CFM per square foot) at 750 Pa (3 inch W.G.) differential pressure.
- C. Minimum requirements for dampers:
  1. Shall comply with requirements of Table 6-1 of UL 555S, except for the Fire Endurance and Hose Stream Test.
  2. Frame: Galvanized steel channel with side, top and bottom stops or seals.
  3. Blades: Galvanized steel, parallel type preferably, 300 mm (12 inch) maximum width, edges sealed with neoprene, rubber or felt, if required to meet minimum leakage. Airfoil (streamlined) type for minimum noise generation and pressure drop are preferred for duct mounted dampers.
  4. Shafts: Galvanized steel.
  5. Bearings: Nylon, bronze sleeve or ball type.
  6. Hardware: Zinc plated.
  7. Operation: Automatic open/close. No smoke damper that requires manual reset or link replacement after actuation is acceptable. See drawings for required control operation.
- D. Motor operator (actuator): Provide pneumatic or electric as required by the automatic control system, externally mounted on stand-offs to allow complete insulation coverage.

## **2.7 COMBINATION FIRE AND SMOKE DAMPERS**

Combination fire and smoke dampers: Multi-blade type units meeting all requirements of both fire dampers and smoke dampers shall be used where shown and may be used at the Contractor's option where applicable.

**2.8 FIRE DOORS NOT USED.****2.9 FLEXIBLE AIR DUCT**

- A. General: Factory fabricated, complying with NFPA 90A for connectors not passing through floors of buildings. Flexible ducts shall not penetrate any fire or smoke barrier which is required to have a fire resistance rating of one hour or more. Flexible duct length shall not exceed 1.5 m (5 feet). Provide insulated acoustical air duct connectors in supply air duct systems and elsewhere as shown.
- B. Flexible ducts shall be listed by Underwriters Laboratories, Inc., complying with UL 181. Ducts larger than 200 mm (8 inches) in diameter shall be Class 1. Ducts 200 mm (8 inches) in diameter and smaller may be Class 1 or Class 2.
- C. Insulated Flexible Air Duct: Factory made including mineral fiber insulation with maximum C factor of 0.25 at 24 degrees C (75 degrees F) mean temperature, encased with a low permeability moisture barrier outer jacket, having a puncture resistance of not less than 50 Beach Units. Acoustic insertion loss shall not be less than 3 dB per 300 mm (foot) of straight duct, at 500 Hz, based on 150 mm (6 inch) duct, of 750 m/min (2500 fpm).
- D. Application Criteria:
  - 1. Temperature range: -18 to 93 degrees C (0 to 200 degrees F) internal.
  - 2. Maximum working velocity: 1200 m/min (4000 feet per minute).
  - 3. Minimum working pressure, inches of water gage: 2500 Pa (10 inches) positive, 500 Pa (2 inches) negative.
- E. Duct Clamps: 100 percent nylon strap, 80 kg (175 pounds) minimum loop tensile strength manufactured for this purpose or stainless steel strap with cadmium plated worm gear tightening device. Apply clamps with sealant and as approved for UL 181, Class 1 installation.

**2.10 FLEXIBLE DUCT CONNECTIONS**

Where duct connections are made to fans, air terminal units, and air handling units, install a non-combustible flexible connection of 822 g (29 ounce) neoprene coated fiberglass fabric approximately 150 mm (6 inches) wide. For connections exposed to sun and weather provide hypalon coating in lieu of neoprene. Burning characteristics shall conform to NFPA 90A. Securely fasten flexible connections to round ducts with stainless steel or zinc-coated iron draw bands with worm gear fastener. For rectangular connections, crimp fabric to sheet metal and fasten sheet metal to ducts by screws 50 mm (2 inches) on center. Fabric shall not be stressed other than by air pressure. Allow at least 25 mm (one inch) slack to insure that no vibration is transmitted.



**2.11 SOUND ATTENUATING UNITS NOT USED.****2.12 PREFABRICATED ROOF CURBS**

Galvanized steel or extruded aluminum 300 mm (12 inches) above finish roof service, continuous welded corner seams, treated wood nailer, 40 mm (1-1/2 inch) thick, 48 kg/cubic meter (3 pound/cubic feet) density rigid mineral fiberboard insulation with metal liner, built-in cant strip (except for gypsum or tectum decks). For surface insulated roof deck, provide raised cant strip (recessed mounting flange) to start at the upper surface of the insulation. Curbs shall be constructed for pitched roof or ridge mounting as required to keep top of curb level.

**2.13 FIRESTOPPING MATERIAL**

Refer to Section 07 84 00, FIRESTOPPING.

**2.14 SEISMIC RESTRAINT FOR DUCTWORK NOT USED.****2.15 DUCT MOUNTED THERMOMETER (AIR)**

- A. Stem Type Thermometers: ASTM E1, 7 inch scale, red appearing mercury, lens front tube, cast aluminum case with enamel finish and clear glass or polycarbonate window, brass stem, 2 percent of scale accuracy to ASTM E77 scale calibrated in degrees Fahrenheit.
- B. Thermometer Supports:
  - 1. Socket: Brass separable sockets for thermometer stems with or without extensions as required, and with cap and chain.
  - 2. Flange: 3 inch outside diameter reversible flange, designed to fasten to sheet metal air ducts, with brass perforated stem.

**2.16 DUCT MOUNTED TEMPERATURE SENSOR (AIR)**

Refer to Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC.

**2.17 INSTRUMENT TEST FITTINGS**

- A. Manufactured type with a minimum 50 mm (two inch) length for insulated duct, and a minimum 25 mm (one inch) length for duct not insulated. Test hole shall have a flat gasket for rectangular ducts and a concave gasket for round ducts at the base, and a screw cap to prevent air leakage.
- B. Provide instrument test holes at each duct or casing mounted temperature sensor or transmitter, and at entering and leaving side of each heating coil, cooling coil, and heat recovery unit.

**2.18 AIR FLOW CONTROL VALVES (AFCV)**

Refer to Section 23 36 00 / 23 82 00, AIR TERMINAL UNITS / CONVECTION HEATING and COOLING UNITS.

**PART 3 - EXECUTION****3.1 INSTALLATION**

- A. Comply with provisions of Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION, particularly regarding coordination with other trades and work in existing buildings.
- B. Fabricate and install ductwork and accessories in accordance with referenced SMACNA Standards:
  - 1. Drawings show the general layout of ductwork and accessories but do not show all required fittings and offsets that may be necessary to connect ducts to equipment, boxes, diffusers, grilles, etc., and to coordinate with other trades. Fabricate ductwork based on field measurements. Provide all necessary fittings and offsets at no additional cost to the government. Coordinate with other trades for space available and relative location of HVAC equipment and accessories on ceiling grid. Duct sizes on the drawings are inside dimensions which shall be altered by Contractor to other dimensions with the same air handling characteristics where necessary to avoid interferences and clearance difficulties.
  - 2. Provide duct transitions, offsets and connections to dampers, coils, and other equipment in accordance with SMACNA Standards, Section II. Provide streamliner, when an obstruction cannot be avoided and must be taken in by a duct. Repair galvanized areas with galvanizing repair compound.
  - 3. Provide bolted construction and tie-rod reinforcement in accordance with SMACNA Standards.
  - 4. Construct casings, eliminators, and pipe penetrations in accordance with SMACNA Standards, Chapter 6. Design casing access doors to swing against air pressure so that pressure helps to maintain a tight seal.
- C. Install duct hangers and supports in accordance with SMACNA Standards, Chapter 4.
- D. Install fire dampers, smoke dampers and combination fire/smoke dampers in accordance with the manufacturer's instructions to conform to the installation used for the rating test. Install fire dampers, smoke dampers and combination fire/smoke dampers at locations indicated and where ducts penetrate fire rated and/or smoke rated walls, shafts and where required by the Project Manager. Install with required perimeter mounting angles, sleeves, breakaway duct connections, corrosion resistant springs, bearings, bushings and hinges per UL and NFPA. Demonstrate re-setting of fire dampers and operation of smoke dampers to the Project Manager.

- E. Seal openings around duct penetrations of floors and fire rated partitions with fire stop material as required by NFPA 90A.
- F. Flexible duct installation: Refer to SMACNA Standards, Chapter 3. Ducts shall be continuous, single pieces not over 1.5 m (5 feet) long (NFPA 90A), as straight and short as feasible, adequately supported. Centerline radius of bends shall be not less than two duct diameters. Make connections with clamps as recommended by SMACNA. Clamp per SMACNA with one clamp on the core duct and one on the insulation jacket. Flexible ducts shall not penetrate floors, or any chase or partition designated as a fire or smoke barrier, including corridor partitions fire rated one hour or two hour. Support ducts SMACNA Standards.
- G. Where diffusers, registers and grilles cannot be installed to avoid seeing inside the duct, paint the inside of the duct with flat black paint to reduce visibility.
- H. Control Damper Installation:
  - 1. Provide necessary blank-off plates required to install dampers that are smaller than duct size. Provide necessary transitions required to install dampers larger than duct size.
  - 2. Assemble multiple sections dampers with required interconnecting linkage and extend required number of shafts through duct for external mounting of damper motors.
  - 3. Provide necessary sheet metal baffle plates to eliminate stratification and provide air volumes specified. Locate baffles by experimentation, and affix and seal permanently in place, only after stratification problem has been eliminated.
  - 4. Install all damper control/adjustment devices on stand-offs to allow complete coverage of insulation.
- I. Air Flow Measuring Devices (AFMD): Install units with minimum straight run distances, upstream and downstream as recommended by the manufacturer.
- J. Not Used.
- K. Protection and Cleaning: Adequately protect equipment and materials against physical damage. Place equipment in first class operating condition, or return to source of supply for repair or replacement, as determined by Project Manager. Protect equipment and ducts during construction against entry of foreign matter to the inside and clean both inside and outside before operation and painting. When new ducts are connected to existing ductwork, clean both new and existing ductwork by mopping and vacuum cleaning inside and outside before operation.

### 3.2 DUCT LEAKAGE TESTS AND REPAIR

- A. Ductwork leakage testing shall be performed by the Testing and Balancing Contractor directly contracted by the General Contractor and independent of the Sheet Metal Contractor.
- B. Ductwork leakage testing shall be performed for the entire air distribution system (including all supply, return, exhaust and relief ductwork), section by section, including fans, coils and filter sections. Based upon satisfactory initial duct leakage test results, the scope of the testing may be reduced by the Project Manager on ductwork constructed to the 500 Pa (2" WG) duct pressure classification. In no case shall the leakage testing of ductwork constructed above the 500 Pa (2" WG) duct pressure classification or ductwork located in shafts or other inaccessible areas be eliminated. C. Test procedure, apparatus and report shall conform to SMACNA Leakage Test manual. The maximum leakage rate allowed is 4 percent of the design air flow rate.
- D. All ductwork shall be leak tested first before enclosed in a shaft or covered in other inaccessible areas.
- E. All tests shall be performed in the presence of the Project Manager and the Test and Balance agency. The Test and Balance agency shall measure and record duct leakage and report to the Project Manager and identify leakage source with excessive leakage.
- F. If any portion of the duct system tested fails to meet the permissible leakage level, the Contractor shall rectify sealing of ductwork to bring it into compliance and shall retest it until acceptable leakage is demonstrated to the Project Manager.
- G. All tests and necessary repairs shall be completed prior to insulation or concealment of ductwork.
- H. Make sure all openings used for testing flow and temperatures by TAB Contractor are sealed properly.

### 3.3 DUCTWORK EXPOSED TO WIND VELOCITY

Provide additional support and bracing to all exposed ductwork installed on the roof or outside the building to withstand wind velocity of \_\_145\_\_km/h (\_\_90\_mph).

### 3.4 TESTING, ADJUSTING AND BALANCING (TAB)

Refer to Section 23 05 93, TESTING, ADJUSTING, and BALANCING FOR HVAC.

### 3.5 OPERATING AND PERFORMANCE TESTS

Refer to Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION

- - - E N D - - -

**SECTION 23 34 00**  
**HVAC FANS**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. Fans for heating, ventilating and air conditioning.
- B. Product Definitions: AMCA Publication 99, Standard 1-66.

**1.2 RELATED WORK**

- A. Section 01 00 00, GENERAL REQUIREMENTS.
- B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- C. Not Used.
- D. Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.
- E. Section 23 05 12, GENERAL MOTOR REQUIREMENTS FOR HVAC and STEAM GENERATION EQUIPMENT.
- F. Not Used.
- G. Section 23 05 93, TESTING, ADJUSTING, and BALANCING FOR HVAC.
- H. Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC.
- I. Section 23 74 13 Packaged, Outdoor, Central Station Air-Handling Units.
- J. Not Used.
- K. Section 26 29 11, LOW-VOLTAGE MOTOR STARTERS.

**1.3 QUALITY ASSURANCE**

- A. Refer to paragraph, QUALITY ASSURANCE, in Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.
- B. Fans and power ventilators shall be listed in the current edition of AMCA 261, and shall bear the AMCA performance seal.
- C. Operating Limits for Centrifugal Fans: AMCA 99 (Class I, II, and III).
- D. Fans and power ventilators shall comply with the following standards:
  - 1. Testing and Rating: AMCA 210.
  - 2. Sound Rating: AMCA 300.
- E. Not Used.
- F. Performance Criteria:
  - 1. The fan schedule shall show the design air volume and static pressure. Select the fan motor HP by increasing the fan BHP by 10 percent to account for the drive losses and field conditions.
  - 2. Select the fan operating point as follows:
    - a. Forward Curve and Axial Flow Fans: Right hand side of peak pressure point
    - b. Air Foil, Backward Inclined, or Tubular: At or near the peak static efficiency

G. Safety Criteria: Provide manufacturer's standard screen on fan inlet and discharge where exposed to operating and maintenance personnel.

H. Corrosion Protection:

1. Except for fans in fume hood exhaust service, all steel shall be mill-galvanized, or phosphatized and coated with minimum two coats, corrosion resistant enamel paint. Manufacturers paint and paint system shall meet the minimum specifications of: ASTM D1735 water fog; ASTM B117 salt spray; ASTM D3359 adhesion; and ASTM G152 and G153 for carbon arc light apparatus for exposure of non-metallic material.

I. Spark resistant construction: If flammable gas, vapor or combustible dust is present in concentrations above 20% of the Lower Explosive Limit (LEL), the fan construction shall be as recommended by AMCA's Classification for Spark Resistant Construction. Drive set shall be comprised of non-static belts for use in an explosive.

#### **1.4 SUBMITTALS**

A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.

B. Manufacturers Literature and Data:

1. Fan sections, motors and drives.
2. Centrifugal fans, motors, drives, accessories and coatings.
  - a. Not Used.
  - b. Not Used.
  - c. Not Used.
  - d. Industrial fans.
  - e. Utility fans and vent sets.
3. Prefabricated roof curbs.
4. Power roof and wall ventilators.
5. Centrifugal ceiling fans.
6. Not Used.
7. Packaged hood make-up air units.
8. Not Used.
9. Not Used.
10. Air curtain units.

C. Certified Sound power levels for each fan.

D. Motor ratings types, electrical characteristics and accessories.

E. Roof curbs.

F. Belt guards.

- G. Maintenance and Operating manuals in accordance with Section 01 00 00, GENERAL REQUIREMENTS.
- H. Certified fan performance curves for each fan showing cubic feet per minute (CFM) versus static pressure, efficiency, and horsepower for design point of operation.

#### 1.5 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. Air Movement and Control Association International, Inc. (AMCA):
  - 99-86.....Standards Handbook
  - 210-06.....Laboratory Methods of Testing Fans for  
Aerodynamic Performance Rating
  - 261-09.....Directory of Products Licensed to bear the AMCA  
Certified Ratings Seal - Published Annually
  - 300-08.....Reverberant Room Method for Sound Testing of  
Fans
- C. American Society for Testing and Materials (ASTM):
  - B117-07a.....Standard Practice for Operating Salt Spray  
(Fog) Apparatus
  - D1735-08.....Standard Practice for Testing Water Resistance  
of Coatings Using Water Fog Apparatus
  - D3359-08.....Standard Test Methods for Measuring Adhesion by  
Tape Test
  - G152-06.....Standard Practice for Operating Open Flame  
Carbon Arc Light Apparatus for Exposure of Non-  
Metallic Materials
  - G153-04.....Standard Practice for Operating Enclosed Carbon  
Arc Light Apparatus for Exposure of Non-  
Metallic Materials
- D. Not Used.
- E. National Sanitation Foundation (NSF):
  - 37-07.....Air Curtains for Entrance Ways in Food and Food  
Service Establishments
- F. Underwriters Laboratories, Inc. (UL):
  - 181-2005.....Factory Made Air Ducts and Air Connectors

#### 1.6 EXTRA MATERIALS

- A. Provide one additional set of belts for all belt-driven fans.

**PART 2 - PRODUCTS****2.1 FAN SECTION (CABINET FAN)**

Refer to specification Section 23 73 00, INDOOR CENTRAL-STATION AIR-HANDLING UNITS.

**2.2 CENTRIFUGAL FANS**

- A. Standards and Performance Criteria: Refer to Paragraph, QUALITY ASSURANCE. Record factory vibration test results on the fan or furnish to the Contractor.
- B. Fan arrangement, unless noted or approved otherwise:
  - 1. DWD1 fans: Arrangement 3.
  - 2. SWS1 fans: Arrangement 1, 3, 9 or 10.
- C. Construction: Wheel diameters and outlet areas shall be in accordance with AMCA standards.
  - 1. Housing: Low carbon steel, arc welded throughout, braced and supported by structural channel or angle iron to prevent vibration or pulsation, flanged outlet, inlet fully streamlined. Provide lifting clips, and casing drain. Provide manufacturer's standard access door. Provide 12.5 mm (1/2 inches) wire mesh screens for fan inlets without duct connections.
  - 2. Wheel: Steel plate with die formed blades welded or riveted in place, factory balanced statically and dynamically.
  - 3. Shaft: Designed to operate at no more than 70 percent of the first critical speed at the top of the speed range of the fans class.
  - 4. Bearings: Heavy duty ball or roller type sized to produce a B10 life of not less than 50,000 hours, and an average fatigue life of 200,000 hours. Extend filled lubrication tubes for interior bearings or ducted units to outside of housing.
  - 5. Belts: Oil resistant, non-sparking and non-static.
  - 6. Belt Drives: Factory installed with final alignment belt adjustment made after installation.
  - 7. Motors and Fan Wheel Pulleys: Adjustable pitch for use with motors through 15HP, fixed pitch for use with motors larger than 15HP. Select pulleys so that pitch adjustment is at the middle of the adjustment range at fan design conditions.
  - 8. Motor, adjustable motor base, drive and guard: Furnish from factory with fan. Refer to Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION for specifications. Provide protective sheet metal enclosure for fans located outdoors.



9. Furnish variable speed fan motor controllers where shown on the drawings. Refer to Section, MOTOR STARTERS. Refer to Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION for controller/motor combination requirements.

D. Not Used.

E. Not Used.

F. Industrial Fans: Use where scheduled or in lieu of centrifugal fans for low volume high static service. Construction specifications paragraphs A and C for centrifugal fans shall apply. Provide material handling flat blade type fan wheel.

### **2.3 POWER ROOF VENTILATOR**

A. Standards and Performance Criteria: Refer to Paragraph, QUALITY ASSURANCE.

B. Type: Centrifugal fan, backward inclined blades. Provide down-blast or up-blast type as indicated.

C. Construction: Steel or aluminum, completely weatherproof, for curb mounting, exhaust cowl or entire drive assembly readily removable for servicing, aluminum bird screen on discharge, UL approved safety disconnect switch, conduit for wiring, vibration isolators for wheel, motor and drive assembly. Provide electric motor operated damper where indicated.

D. Motor and Drive: Refer to Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION. Bearings shall be pillow block ball type with a minimum L-50 life of 200,000 hours. Motor shall be located out of air stream.

E. Prefabricated Roof Curb: As specified in paragraph 2.3 of this section.

F. Up-blast Type: Top discharge exhaust, motor out of air stream. For kitchen hood exhaust applications, provide grease trough on base and threaded drain. The mounting height of the kitchen up-blast exhaust fan shall be in compliance with NFPA 96. (Provide vented curb extension if required to maintain required clearances.)

### **2.4 POWER WALL VENTILATOR NOT USED.**

### **2.5 PACKAGED HOOD MAKE-UP AIR UNITS NOT USED.**

### **2.6 CENTRIFUGAL CEILING FANS (SMALL CABINET FAN)**

A. Standards and Performance Criteria: Refer to Paragraph, QUALITY ASSURANCE.

B. Steel housing, baked enamel finish, direct connected fan assembly, attached grille. Provide gravity back draft assembly, aluminum wall cap

and bird or insect screen. Provide electric motor operated damper where indicated.

- C. Acoustical Lining: 12.5 mm (1/2 inch) thick mineral fiber, dark finish. Comply with UL 181 for erosion.
- D. Motor: Shaded pole or permanent split capacitor, sleeve bearings, supported by steel brackets in combination with rubber isolators.
- E. Ceiling Grille, (Where indicated): White plastic egg crate design, 80 percent free area.
- F. Control: Provide solid state speed control (located at unit) for final air balancing.

#### **2.7 PROPELLER FANS NOT USED.**

#### **2.8 VANE AXIAL FANS NOT USED.**

#### **2.9 AIR CURTAIN UNITS**

- A. Manufacturer's standard, high velocity, non-recirculating type with demonstrated performance in effectively preventing entry of dust and insects and effectively stopping inflow of air due to winds of 24 km/h (15 mph) velocity. AMCA seal is waived. Units for kitchens or food storage shall comply with NSF 37.
- B. Casing: Sheet metal or polycarbonate plastic. Provide internal or external vibration isolation to effectively prevent transmission of vibration and noise from units to building structure. Units shall completely house all parts and have manufacturer's standard finish coating.
- C. Fans: Ruggedly constructed, statically and dynamically balanced. Noise level shall not exceed 77 dBA measured at 1.5 m (5 feet) distance.
- D. Air Discharge Outlet Nozzle: Cover full width of door opening. Fan discharge ducts, plenum, flow control vanes and nozzles shall provide a uniform distribution of air over entire length of door. Provide adjustable volume and directional control.
- E. Heating Coil: Provide electric heating coil. Maximum discharge air temperature shall be 49 degrees C (120 degrees F).
- F. Controls: Provide on-off door operated switch. The "on-off" switch circuit shall close to start fan motors when door starts to open and open when the door reaches closed position. A local disconnect switch for each fan motor shall be provided and shall be mounted to be accessible without use of ladder.

- G. Motors: Fan motors shall be of type suitable for service conditions, sealed ball bearings, resilient mounting and automatic thermal overload switch.

### **PART 3 - EXECUTION**

#### **3.1 INSTALLATION**

- A. Install fan, motor and drive in accordance with manufacturer's instructions.
- B. Align fan and motor sheaves to allow belts to run true and straight.
- C. Bolt equipment to curbs with galvanized lag bolts.
- D. Not Used.

#### **3.2 PRE-OPERATION MAINTENANCE**

- A. Lubricate bearings, pulleys, belts and other moving parts with manufacturer recommended lubricants.
- B. Rotate impeller by hand and check for shifting during shipment and check all bolts, collars, and other parts for tightness.
- C. Clean fan interiors to remove foreign material and construction dirt and dust.

#### **3.3 START-UP AND INSTRUCTIONS**

- A. Verify operation of motor, drive system and fan wheel according to the drawings and specifications.
- B. Check vibration and correct as necessary for air balance work.
- C. After air balancing is complete and permanent sheaves are in place perform necessary field mechanical balancing to meet vibration tolerance in Section 23 05 41, NOISE and VIBRATION CONTROL FOR HVAC PIPING and EQUIPMENT.

- - - E N D - - -



**SECTION 23 36 00**  
**AIR TERMINAL UNITS**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

Air terminal units, air flow control valves.

**1.2 RELATED WORK**

- A. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.
- C. Not Used.
- D. Not Used.
- E. Not Used.
- F. Section 23 05 93, TESTING, ADJUSTING, and BALANCING FOR HVAC.
- G. Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC.
- H. Section 23 31 00, HVAC DUCTS and CASINGS.

**1.3 QUALITY ASSURANCE**

Refer to Paragraph, QUALITY ASSURANCE, in Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION.

**1.4 SUBMITTALS**

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Manufacturer's Literature and Data:
  - 1. Air Terminal Units: Submit test data.
  - 2. Air flow control valves.
- C. Samples: Provide one typical air terminal unit for approval by the Project Manager. This unit will be returned to the Contractor after all similar units have been shipped and deemed acceptable at the job site.
- D. Certificates:
  - 1. Compliance with paragraph, QUALITY ASSURANCE.
  - 2. Compliance with specified standards.
- E. Operation and Maintenance Manuals: Submit in accordance with paragraph, INSTRUCTIONS, in Section 01 00 00, GENERAL REQUIREMENTS.

**1.5 APPLICABLE PUBLICATIONS**

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.

- B. Air Conditioning and Refrigeration Institute (AHRI)/(ARI):  
 880-08.....Air Terminals Addendum to ARI 888-98  
 incorporated into standard posted 15<sup>th</sup> December  
 2002
- C. National Fire Protection Association (NFPA):  
 90A-09.....Standard for the Installation of Air  
 Conditioning and Ventilating Systems
- D. Underwriters Laboratories, Inc. (UL):  
 181-08.....Standard for Factory-Made Air Ducts and Air  
 Connectors
- E. American Society for Testing and Materials (ASTM):  
 C 665-06.....Standard Specification for Mineral-Fiber  
 Blanket Thermal Insulation for Light Frame  
 Construction and Manufactured Housing

## 1.6 GUARANTY

In accordance with the GENERAL CONDITIONS

## PART 2 - PRODUCTS

### 2.1 GENERAL

- A. Coils:
1. Not Used.
  2. All Air-Handling Units: Provide aluminum fins and copper coils for all hot water reheat coils.
  3. Water Heating Coils:
    - a. ARI certified, continuous plate or spiral fin type, leak tested at 2070 kPa (300 PSI).
    - b. Capacity: As indicated, based on scheduled entering water temperature.
    - c. Headers: Copper or Brass.
    - d. Fins: Aluminum, maximum 315 fins per meter (8 fins per inch).
    - e. Tubes: Copper, arrange for counter-flow of heating water.
    - f. Water Flow Rate: Minimum 0.032 Liters/second (0.5 GPM).
    - g. Provide vent and drain connection at high and low point, respectively of each coil.
    - h. Coils shall be guaranteed to drain.
  4. Electric Heating Coils:
    - a. ARI certified, spiral fin type.
    - b. Capacity: As indicated, based on scheduled data.

- c. Coil: Enclosed copper tube, aluminum finned element of coiled nickel-chrome resistance wire centered in tubes and embedded in refractory material. Exposed helical coil of nickel-chrome resistance wire with refractory ceramic support bushings will not be allowed.
- B. Labeling: Control box shall be clearly marked with an identification label that lists such information as nominal CFM, maximum and minimum factory-set airflow limits, coil type and coil connection orientation, where applicable.
- C. Factory calibrate air terminal units to air flow rate indicated. All settings including maximum and minimum air flow shall be field adjustable.
- D. Dampers with internal air volume control: See section 23 31 00 HVAC DUCTS and CASINGS.

## 2.2 AIR TERMINAL UNITS (BOXES)

- A. General: Factory built, pressure independent units, factory set-field adjustable air flow rate, suitable for single duct applications. Use of dual-duct air terminal units is not permitted. Clearly show on each unit the unit number and factory set air volumes corresponding to the contract drawings. Section 23 05 93, TESTING, ADJUSTING, and BALANCING FOR HVAC work assumes factory set air volumes. Coordinate flow controller sequence and damper operation details with the drawings and Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC. All air terminal units shall be brand new products of the same manufacturer.
- B. Capacity and Performance: The Maximum Capacity of a single terminal unit shall not exceed 566 Liters/second (1,200 CFM) with the exception of operating rooms and Cystoscopy rooms, which shall be served by a single air terminal unit at a maximum of 1,250 Liters/second (3,000 CFM).
- C. Sound Power Levels:  
Acoustic performance of the air terminal units shall be based on the design noise levels for the spaces stipulated in Section 23 05 41 (Noise and Vibration Control for HVAC Piping and Equipment).
- D. Casing: Unit casing shall be constructed of galvanized steel no lighter than 0.85 mm (22 Gauge). Air terminal units serving the operating rooms and Cystoscopy rooms shall be fabricated without lining. Provide hanger brackets for attachment of supports.

1. Lining material: Suitable to provide required acoustic performance, thermal insulation and prevent sweating. Meet the requirements of NFPA 90A and comply with UL 181 for erosion as well as ASTM C 665 antimicrobial requirements. Insulation shall consist of 13 mm (1/2 IN) thick non-porous foil faced rigid fiberglass insulation of 4-lb/cu.ft, secured by full length galvanized steel z-strips which enclose and seal all edges. Tape and adhesives shall not be used. Materials shall be non-friable and with surfaces, including all edges, fully encapsulated and faced with perforated metal or coated so that the air stream will not detach material. No lining material is permitted in the boxes serving operating rooms and Cystoscopy rooms.
  2. Access panels (or doors): Provide panels large enough for inspection, adjustment and maintenance without disconnecting ducts, and for cleaning heating coils attached to unit, even if there are no moving parts. Panels shall be insulated to same standards as the rest of the casing and shall be secured and gasketed airtight. It shall require no tool other than a screwdriver to remove.
  3. Total leakage from casing: Not to exceed 2 percent of the nominal capacity of the unit when subjected to a static pressure of 750 Pa (3 inch WG), with all outlets sealed shut and inlets fully open.
  4. Octopus connector: Factory installed, lined air distribution terminal. Provide where flexible duct connections are shown on the drawings connected directly to terminals. Provide butterfly-balancing damper, with locking means in connectors with more than one outlet. Octopus connectors and flexible connectors are not permitted in the Surgical Suite.
- E. Construct dampers and other internal devices of corrosion resisting materials which do not require lubrication or other periodic maintenance.
1. Damper Leakage: Not greater than 2 percent of maximum rated capacity, when closed against inlet static pressure of 1 kPa (4 inch WG).
- F. Provide multi-point velocity pressure sensors with external pressure taps.
1. Provide direct reading air flow rate table pasted to box.
- G. Provide static pressure tubes.



- H. Externally powered DDC variable air volume controller and damper actuator to be furnished under Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC for factory mounting on air terminal units. The DDC controller shall be electrically actuated.

### **PART 3 - EXECUTION**

#### **3.1 INSTALLATION**

- A. Work shall be installed as shown and according to the manufacturer's diagrams and recommendations.
- B. Handle and install units in accordance with manufacturer's written instructions.
- C. Support units rigidly so they remain stationary at all times. Cross-bracing or other means of stiffening shall be provided as necessary. Method of support shall be such that distortion and malfunction of units cannot occur.
- D. Locate air terminal units to provide a straight section of inlet duct for proper functioning of volume controls. See VA Standard Detail.

#### **3.2 OPERATIONAL TEST**

Refer to Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.

- - - E N D - - -



**SECTION 23 72 00**  
**AIR-TO-AIR ENERGY RECOVERY EQUIPMENT**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

This Section specifies air-to-air plate heat exchangers

**1.2 RELATED WORK**

- A. Section 01 00 00, GENERAL REQUIREMENTS: Requirements for pre-test of equipment.
- B. Not Used.
- C. Section 23 05 11, COMMON WORK RESULTS FOR HVAC: General mechanical requirements and items, which are common to more than one section of Division 23.
- D. Not Used.
- E. Section 23 07 11, HVAC and BOILER PLANT INSULATION: Requirements for piping insulation.
- F. Section 23 21 13, HYDRONIC PIPING: Requirements for piping for expansion tanks.
- G. Not Used.
- H. Section 23 31 00, HVAC DUCTS and CASINGS: Requirements for sheet metal ducts and fittings.
- I. Not Used.
- J. Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC: Requirements for controls and instrumentation.
- K. Section 23 05 93, TESTING, ADJUSTING and BALANCING FOR HVAC: Requirements for testing, adjusting and balancing of HVAC system.

**1.3 QUALITY ASSURANCE**

- A. Refer to paragraph, GUARANTEE in specification Section 00 72 00, GENERAL CONDITIONS.
- B. Refer to specification Section 01 00 00, GENERAL REQUIREMENTS for performance tests and instructions to VA personnel.
- C. Refer to paragraph QUALITY ASSURANCE in specification Section 23 05 11, COMMON WORK RESULTS FOR HVAC.
- D. Performance Criteria: Heat recovery equipment shall be provided by a manufacturer who has been manufacturing such equipment and the equipment has a good track record for at least 3 years.
- E. Performance Test: In accordance with PART 3.

**1.4 SUBMITTALS**

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.

B. Manufacturer's Literature and Data:

1. Not Used.
2. Not Used.
3. Plate Heat Exchanger

C. Certificate: Submit, simultaneously with shop drawings, an evidence of satisfactory service of the equipment on three similar installations.

D. Submit type, size, arrangement and performance details. Present application ratings in the form of tables, charts or curves.

E. Provide installation, operating and maintenance instructions, in accordance with Article, INSTRUCTIONS, in Section 01 00 00, GENERAL REQUIREMENTS.

### 1.5 APPLICABLE PUBLICATIONS

A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.

B. Air Conditioning, Heating, and Refrigeration Institute (AHRI)  
AHRI 1060-2005.....Performance Rating of Air-to-Air Heat Exchangers  
for Energy Recovery Ventilation Equipment

C. American Society of Heating, Refrigeration and Air Conditioning  
Engineers (ASHRAE):  
15-10.....Safety Standard for Refrigeration Systems (ANSI)  
52.1-92.....Gravimetric and Dust-Spot Procedures for Testing  
Air-Cleaning Devices Used in General Ventilation  
for Removing Particulate Matter  
52.2-07.....Method of Testing General Ventilation Air-  
Cleaning Devices for Removal Efficiency by  
Particle Size  
84-08.....Method of Testing Air-to-Air Heat/Energy  
Exchangers

D. American Society for Testing and materials (ASTM)  
D635-10.....Standard Test Method for Rate of Burning and/or  
Extent and Time of Burning of Plastics in a  
Horizontal Position  
E84-10.....Standard Test Method for Surface Burning  
Characteristics of Building Materials

E. American Society of Civil Engineers (ASCE)  
ASCE 7-10.....Minimum Design Loads for Buildings and Other  
Structures

F. Underwriters Laboratories, Inc (UL)  
1812-2009.....Standard for Ducted Heat Recovery Ventilators  
1815-2009.....Standard for Nonducted Heat Recovery Ventilators

**PART 2 - PRODUCTS****2.1 AIR-TO-AIR HEAT PIPE HEAT EXCHANGERS NOT USED.****2.2 ROTARY AIR-TO-AIR HEAT EXCHANGER: NOT USED.****2.3 AIR-TO-AIR PLATE HEAT EXCHANGER**

- A. Comply with UL Standard~~s~~ 1812.
- B. Plates: Corrugated 0.53 mm (0.021 inch) diamond embossed aluminum spacing as recommended by the manufacturer.
- C. Bedding: Thermosetting reinforced resin. Provide plate seal-off and passage separation at top, bottom and center divider. The resins shall be self-extinguishing type in accordance with ASTM D635.
- D. Casing and End Strips: Casing of 1.6 mm (16 gage) galvanized steel, except casings for corrosive air streams shall be stainless steel. End strips of the same material as exchanger plates. Ends of unit exchanger plates shall be sealed with high temperature silicon sealant prior to installation of end strip for corrosive air streams provide welded end strips to avoid cross contaminations.
- E. Casings shall have integral flanges for flanged duct connections and shall have lifting holes or lugs.
- F. Drain Pan: Same material as unit casing. Drain-pan surface shall be covered with molded ABS, and shall have drain connections on exhaust and supply side. Comply with requirements in ASHRAE 62.1-2004.
- G. Accessories: Furnish where indicated on the drawings.
  - 1. Face and Bypass Dampers: Manufacturer's standard, complete with operators, with factory-installed controls to operate face-and-bypass dampers during summer and winter.
  - 2. Defrost System. Factory installed and capable of maintaining at least 85 percent of the non-frosted performance at -29 degrees C (-20 degrees F).
- H. Not Used.
- I. Extended-Surface, Disposable Panel Filters: MERV 7, 2-inch throw-away type. Refer to Section 23 40 00 HVAC Air Cleaning Devices.

**2.4 RUN-AROUND ENERGY RECOVERY SYSTEM NOT USED.****2.5 AIR FILTERS**

Air Filters: Disposable air filters, with a MERV rating of 7, shall be provided standard on all air entering sides of air-to-air heat exchangers and as indicated on the drawings. Comply with requirements in specification Section 23 40 00, HVAC AIR CLEANING DEVICES.

**PART 3 - EXECUTION****3.1 INSTALLATION**

- A. Follow the equipment manufacturer's instructions for handling and installation, and setting up of ductwork for makeup and exhaust air steamers for maximum efficiency.
- B. Not Used.
- C. Seal ductwork tightly to avoid air leakage.
- D. Install units with adequate spacing and access for cleaning and maintenance of heat recovery coils as well as filters.
- E. Not Used.
- F. Secure outdoor heat recovery equipment to withstand a wind velocity of (90mph).

**3.2 FIELD QUALITY CONTROL**

- A. Operational Test: Perform tests as per manufacturer's written instructions for proper and safe operation of the heat recovery system.
  - 1. After electrical circuitry has been energized, start units to confirm proper motor rotation and unit operation.
  - 2. Adjust seals and purge.
  - 3. Test and adjust controls and safeties.
- B. Replace damaged and malfunctioning controls and equipment.
- C. Set initial temperature and humidity set points. Set field-adjustable switches and circuit-breaker trip ranges as indicated.
- D. Prepare test and inspection reports to the Senior Project Manager in accordance with specification Section 01 00 00, GENERAL REQUIREMENTS.

**3.3 INSTRUCTIONS**

Provide services of manufacturer's technical representative for four hours to instruct VA personnel in operation and maintenance of heat recovery equipment.

**3.4 STARTUP AND TESTING NOT USED.****3.5 COMMISSIONING NOT USED.****3.6 DEMONSTRATION AND TRAINING**

- A. Provide services of manufacturer's technical representative for four hours to instruct VA personnel in operation and maintenance of units.

- - - E N D - - -

**SECTION 23 74 13**  
**PACKAGED, OUTDOOR, CENTRAL-STATION AIR-HANDLING UNITS**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. Roof top air handling units including integral components specified herein.
- B. Definitions: Roof Top Air Handling Unit(Roof Top Units, RTU): A factory fabricated assembly consisting of fan, coils, filters, and other necessary equipment to perform one or more of the following functions of circulating, cleaning, heating, cooling, humidifying, dehumidifying, and mixing of air. Design capacities of units shall be as scheduled on the drawings.

**1.2 RELATED WORK**

- A. Not Used.
- B. Section 23 05 11, COMMON WORK RESULTS FOR HVAC: General mechanical requirements and items, which are common to more than one section of Division 23.
- C. Section 23 05 41, NOISE and VIBRATION CONTROL FOR HVAC PIPING and EQUIPMENT: Sound and vibration requirements.
- D. Section 23 07 11, HVAC and BOILER PLANT INSULATION: Piping and duct insulation.
- E. Section 23 21 13, HYDRONIC PIPING and Section 23 22 13, STEAM and CONDENSATE HEATING PIPING: Piping and valves.
- F. Not Used.
- G. Section 23 34 00, HVAC FANS: Return and exhaust fans.
- H. Section 23 31 00, HVAC DUCTS and CASINGS: Requirements for flexible duct connectors, sound attenuators and sound absorbing duct lining.
- I. Not Used.
- J. Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC: HVAC controls.
- K. Section 23 05 93, TESTING, ADJUSTING, and BALANCING FOR HVAC: Testing, adjusting and balancing of air and water flows.
- L. Section 23 05 12, GENERAL MOTOR REQUIREMENTS FOR HVAC and STEAM GENERATION EQUIPMENT: Types of motors.
- M. Section 26 29 11, LOW-VOLTAGE MOTOR STARTERS: Types of motor starters.

**1.3 QUALITY ASSURANCE**

- A. Refer to Article, Quality Assurance, in Section 23 05 11, COMMON WORK RESULTS FOR HVAC.
- B. Air Handling Units Certification

1. Air Handling Units with Housed Centrifugal Fans: The air handling units shall be certified in accordance with AHRI 430 and tested/rated in accordance with AHRI 260.
2. Air Handling Units with Plenum Fans:
  - a. Air Handling Units with a single Plenum Fan shall be certified in accordance with AHRI 430 and tested/rated in accordance with AHRI 260.
  - b. Air handling Units with Multiple Fans in an Array shall be tested and rated in accordance with AHRI 430 and AHRI 260.
- C. Heating, Cooling, and Air Handling Capacity and Performance Standards: AHRI 430, AHRI 410, ASHRAE 51, and AMCA 210.
- D. Performance Criteria:
  1. The fan BHP shall include all system effects for all fans and v-belt drive losses for housed centrifugal fans.
  2. The fan motor shall be selected within the rated nameplate capacity, without relying upon NEMA Standard Service Factor.
  3. Select the fan operating point as follows:
    - a. Forward Curve and Axial Flow Fans: Right hand side of peak pressure point.
    - b. Air Foil, Backward Inclined, or Tubular Fans Including Plenum Fans: At or near the peak static efficiency but at an appropriate distance from the stall line.
  4. Operating Limits: AMCA 99 and Manufacturer's Recommendations.
- E. Units shall be factory-fabricated, assembled, and tested by a manufacturer, in business of manufacturing similar air-handling units for at least five (5) years.

#### **1.4 SUBMITTALS:**

- A. The contractor shall, in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES, furnish a complete submission for all roof top units covered in the project. The submission shall include all information listed below. Partial and incomplete submissions shall be rejected without reviews.
- B. Manufacturer's Literature and Data:
  1. Submittals for RTUs shall include fans, drives, motors, coils, filter housings, and all other related accessories. The contractor shall provide custom drawings showing total air handling unit assembly including dimensions, operating weight, access sections, diffusion plates, flexible connections, door swings, controls penetrations, electrical disconnect, lights, duplex receptacles, switches, wiring, utility connection points, unit support system, vibration isolators,



- drain pan, pressure drops through each component (filter, coil etc) and rigging points.
2. Submittal drawings of section or component only, will not be acceptable. Contractor shall also submit performance data including performance test results, charts, curves or certified computer selection data; data sheets; fabrication and insulation details; if the unit cannot be shipped in one piece, the contractor shall indicate the number of pieces that each unit will have to be broken into to meet shipping and job site rigging requirements. This data shall be submitted in hard copies and in electronic version compatible to AutoCAD version used by the VA at the time of submission.
  3. Submit sound power levels in each octave band for fan and at entrance and discharge of RTUs at scheduled conditions. Include sound attenuator capacities and itemized internal component attenuation. Internal lining of supply air ductwork with sound absorbing material is not permitted.
  4. Provide fan curves showing Liters/Second (cubic feet per minute), static pressure, efficiency, and horsepower for design point of operation and at maximum design Liters/Second (cubic feet per minute) and 110 percent of design static pressure.
  5. Submit total fan static pressure, external static pressure, for RTU including total, inlet and discharge pressures, and itemized specified internal losses and unspecified internal losses. Refer to air handling unit schedule on drawings.
- C. Maintenance and operating manuals in accordance with Section 01 00 00, GENERAL REQUIREMENTS. Include instructions for lubrication, filter replacement, motor and drive replacement, spare part lists, and wiring diagrams.
- D. Submit written test procedures two weeks prior to factory testing. Submit written results of factory tests for approval prior to shipping.
- E. Not Used.
- F. Submit shipping information that clearly indicates how the units will be shipped in compliance with the descriptions below.
1. Units shall be shipped in one (1) piece where possible and in shrink wrapping to protect the unit from dirt, moisture and/or road salt.
  2. If not shipped in one (1) piece, provide manufacturer approved shipping splits where required for installation or to meet shipping and/or job site rigging requirements in modular sections. Indicate clearly that the shipping splits shown in the submittals have been verified to accommodate the construction constraints for rigging as required to complete installation and removal of any section for

replacement through available access without adversely affecting other sections.

3. If shipping splits are provided, each component shall be individually shrink wrapped to protect the unit and all necessary hardware (e.g. bolts, gaskets etc.) will be included to assemble unit on site (see section 2.1.A4).
4. Lifting lugs will be provided to facilitate rigging on shipping splits and joining of segments. If the unit cannot be shipped in one piece, the contractor shall indicate the number of pieces that each unit will have to be broken into to meet shipping and job site rigging requirements.

#### 1.5 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. Air-Conditioning, Heating, and Refrigeration Institute (AHRI):
  - 260-01.....Sound Rating of Ducted Air Moving and  
Conditioning Equipment
  - 410-01.....Standard for Forced-Circulation Air-Heating and  
Air-Cooling Coils
  - 430-09.....Standard for Central Station Air Handling Units
  - AHRI-DCAACP.....Directory of Certified Applied Air Conditioning  
Products
- C. Air Moving and Conditioning Association (AMCA):
  - 210-07.....Laboratory Methods of Testing Fans for Rating
- D. Anti-Friction Bearing Manufacturer's Association, Inc. (AFBMA):
  - 9-90 (R2008).....Load Ratings and Fatigue life for Ball Bearings
- E. American Society of Heating, Refrigerating and Air Conditioning  
Engineers (ASHRAE):
  - 51-2007.....Laboratory Methods of Testing Fans for Rating
- F. American Society for Testing and Materials (ASTM):
  - A653/653M-02.....Steel Sheet, Zinc-Coated (Galvanized) or Zinc-  
Iron Alloy-Coated (Galvannealed) by the Hot-Dip  
Process
  - B117-07a.....Salt Spray (Fog) Testing
  - C1071-05e1.....Standard Specification for Fibrous Glass Duct  
Lining Insulation (Thermal and Sound Absorbing  
Material)
  - D1654-08.....Standard Method for Evaluation of Painted or  
Coated Specimens Subjected to Corrosive  
Environments

- D1735-08.....Water Resistance of Coatings Using Water Fog Apparatus
- D3359-08.....Standard Test Methods for Measuring Adhesion by Tape Test
- E84-10.....Standard Test Method for Surface Burning Characteristics of Building Materials
- G. Anti-Friction Bearing Manufacturer's Association, Inc. (AFBMA):
- 9-90.....Load Ratings and Fatigue life for Ball Bearings
- H. Military Specifications (Mil. Spec.):
- DOD-P-21035A-2003.....Paint, High Zinc Dust Content, Galvanizing Repair
- I. National Fire Protection Association (NFPA):
- NFPA 90A.....Standard for Installation of Air Conditioning and Ventilating Systems, 2009
- J. Energy Policy Act of 2005 (P.L.109-58)

## **PART 2 - PRODUCTS**

### **2.1 ROOF TOP AIR HANDLING UNITS**

#### **A. General:**

1. Roof top units (RTU) shall be fabricated from insulated, solid double-wall galvanized steel without any perforations in draw-through configuration. Casing is specified in paragraph 2.1.C. Galvanizing shall be hot dipped conforming to ASTM A525 and shall provide a minimum of 0.275 kg of zinc per square meter (0.90 oz. of zinc per square foot) (G90)
2. The contractor and the RTU manufacturer shall be responsible for insuring that the unit will not exceed the allocated space shown on the drawings, including required clearances for service and future overhaul or removal of unit components. All structural, piping, wiring, and ductwork alterations of units, which are dimensionally different than those specified, shall be the responsibility of the contractor at no additional cost to the government.
3. RTUs shall be fully assembled by the manufacturer in the factory in accordance with the arrangement shown on the drawings. The unit shall be assembled into the largest sections possible subject to shipping and rigging restrictions. The correct fit of all components and casing sections shall be verified in the factory for all units prior to shipment. All units shall be fully assembled, tested and then split to accommodate shipment and job site rigging. On units not shipped fully assembled, the manufacturer shall tag each section and include air flow direction to facilitate assembly at the job site.

Lifting lugs or shipping skids shall be provided for each section to allow for field rigging and final placement of unit.

4. The RTU manufacturer shall provide the necessary gasketing, caulking, and all screws, nuts, and bolts required for assembly. The manufacturer shall provide a local representative at the job site to supervise the assembly and to assure the units are assembled to meet manufacturer's recommendations and requirements noted on the drawings. Provide documentation that this representative has provided this service on similar jobs to the Contracting Officer. If a local representative cannot be provided, the manufacturer shall provide a factory representative.
5. Gaskets: All door and casing and panel gaskets and gaskets between air handling unit components, if joined in the field, shall be high quality which seal air tight and retain their structural integrity and sealing capability after repeated assembly and disassembly of bolted panels and opening and closing of hinged components. Bolted sections may use a more permanent gasketing method provided they are not disassembled.
6. Structural Rigidity: Provide structural reinforcement when required by span or loading so that the deflection of the assembled structure shall not exceed 1/200 of the span based on a differential static pressure of 1991 Pa (8 inches water gage) or higher.

B. Base:

1. Provide a heavy duty steel base for supporting all major RTU components. Bases shall be constructed of wide-flange steel I-beams, channels, or minimum 125 mm (5 inch) high 3.5 mm (10 Gauge) steel base rails. Welded or bolted cross members shall be provided as required for lateral stability. Contractor shall provide supplemental steel supports as required to obtain proper operation heights for cooling coil condensate drain trap and steam coil condensate return trap as shown on drawings.
2. RTUs shall be completely self supporting for installation on roof curb or steel support pedestals.
3. The RTU bases not constructed of galvanized material shall be cleaned, primed with a rust inhibiting primer, and finished with rust inhibiting exterior enamel.

C. Casing (including wall, floor and roof):

1. General: RTU casing shall be entirely double wall insulated panels, integral of or attached to a structural frame. Construction shall be such that removal of any panel shall not affect the structural integrity of the unit. Casing finished shall meet salt-spray test as

- specified in paragraph 2.1.C.10. All casing and panel sections shall be tightly butted and gasketed. No gaps of double wall construction will be allowed where panels bolt to air handling unit structural member. Structural members, not covered by the double wall panels, shall have equivalent insulated double wall construction.
2. Double wall galvanized steel panels, minimum 51 mm (2 inches) thick, constructed of minimum 1.3 mm (18 gauge) outer skin and 1.0 mm (20 gauge) solid inner skin. To limit wall, roof and floor deflection to not exceed an L/240 ratio when the unit casing is pressurized to ( $\pm 1245$  Pa ( $\pm 5$  in. w.g.)). Deflection shall be measured at the midpoint of the panel height. Total housing leakage shall not exceed 1% of rated cfm when the unit casing is pressurized to  $\pm 5$  in. w.g. ( $\pm 1245$  Pa). The outer (skin) and inner panels shall be solid.
  3. Blank-Off: Provide blank-offs as required to prevent air bypass between the AHU sections, around coils, and filters.
  4. Insulation: Insulation shall be injected CFC free polyurethane foam encased in double-wall casing between exterior and interior panels such that no insulation can erode to the air stream. Insulation shall be 50 mm (2 inch) thick, and  $48 \text{ kg/m}^3$  ( $3.0 \text{ lb/ft}^3$ ) density with a total thermal resistance (R-value) of approximately  $2.3 \text{ m}^2\text{K/W}$  ( $13.0 \text{ hr-ft}^2 \text{ }^\circ\text{F/BTU}$ ). Units with less than 50 mm (2 inch) of insulation in any part of the walls, floor, roof or drain pan shall not be acceptable. The insulation shall comply with NFPA 90-A for the flame and smoke generation requirements. Also, refer to specification Section 23 07 11, HVAC and BOILER PLANT INSULATION.

Table 2.1.C.4

Outer Panel	0.8 mm (22 Gage) Minimum
Inner Panel	0.8 mm (22 Gage) Minimum
Insulation	Foam
Thickness	50 mm (2 inch) Minimum
Density	$48 \text{ kg/m}^3$ ( $3.0 \text{ lb/ft}^3$ ) Minimum
Total R Value	$2.3 \text{ m}^2\text{K/W}$ ( $13.0 \text{ ft}^2\text{ }^\circ\text{F.hr/Btu}$ ) Minimum

5. The thickness of insulation, mode of application, and thermal breaks shall be such that there is no visible condensation on the exterior panels of the AHU.
6. Casing panels shall be secured to the support structure with stainless steel or zinc-chromate plated screws and gaskets installed around the panel perimeter. Panels shall be completely removable to

- allow removal of fan, coils, and other internal components for future maintenance, repair, or modifications. Welded exterior panels are not acceptable.
7. Access Doors: Provide in each access section and where shown on drawings. Show single-sided and double-sided access doors with door swings on the floor plans. Doors shall be a minimum of 50 mm (2 inches) thick with same double wall construction as the unit casing. Doors shall be a minimum of 600 mm (24 inches) wide, unless shown of different size on drawings, and shall be the full casing height up to a maximum of 1850 mm (6 feet). Doors shall be gasketed, hinged, and latched to provide an airtight seal. The access doors for fan section, mixing box, coil section shall include a minimum 150 mm x 150 mm (6 inch x 6 inch) double thickness, with air space between glass panes tightly sealed, reinforced glass or Plexiglas window in a gasketed frame.
    - a. Hinges: Manufacturers standard, designed for door size, weight and pressure classifications. Hinges shall hold door completely rigid with minimum 45 kg (100 pound) weight hung on latch side of door.
    - b. Latches: Non-corrosive alloy construction, with operating levers for positive cam action, operable from either inside or outside. Doors that do not open against unit operating pressure shall allow the door to ajar and then require approximately 0.785 radian (45 degrees) further movement of the handle for complete opening. Latch shall be capable of restraining explosive opening of door with a force not less than 1991 Pa (8 inches water gage).
    - c. Gaskets: Neoprene, continuous around door, positioned for direct compression with no sliding action between the door and gasket. Secure with high quality mastic to eliminate possibility of gasket slipping or coming loose.
  8. Provide sealed sleeves, metal or plastic escutcheons or grommets for penetrations through casing for power and temperature control wiring and pneumatic tubing. Coordinate with electrical and temperature control subcontractors for number and location of penetrations. Coordinate lights, switches, and duplex receptacles and disconnect switch location and mounting. All penetrations and equipment mounting may be provided in the factory or in the field. All field penetrations shall be performed neatly by drilling or saw cutting. No cutting by torches will be allowed. Neatly seal all openings airtight.
  9. Roof of the unit shall be sloped to have a minimum pitch of 1/4 inch per foot. The roof shall overhang the side panels by a minimum of

three inches to prevent precipitation drainage from streaming down the unit side panels.

10. Casing finished shall meet ASTM B117, 500-hour salt spray test, using 20 percent sodium chloride solution. Immediately after completion of the test, the coating shall show no sign of blistering, wrinkling, or cracking, no loss of adhesion, and the specimen shall show no sign of rust creepage beyond 1/8-inch on either side of scratch mark.
- D. Unit floor shall be level without offset space or gap and designed to support a minimum of 488 kg/square meter (100 pounds per square foot) distributed load without permanent deformation or crushing of internal insulation. Provide adequate structural base members beneath floor in service access sections to support typical service foot traffic and to prevent damage to unit floor or internal insulation. Unit floors in casing sections, which may contain water or condensate, shall be watertight with drain pan.
- E. Condensate Drain Pan: Drain pan shall be designed to extend entire length of cooling coils including headers and return bends. Depth of drain pan shall be at least 43 mm (1.7 inches) and shall handle all condensate without overflowing. Drain pan shall be double wall construction, Type 304 stainless steel and have a minimum of 50 mm (2 inch) insulation, and shall be sloped to drain. Drain pan shall be continuous metal or welded watertight. No mastic sealing of joints exposed to water will be permitted. Drain pan shall be placed on top of casing floor or integrated into casing floor assembly. Drain pan shall be pitched in all directions to drain line.
  1. An intermediate condensate drip pan shall be provided on stacked cooling coils and shall be constructed of type 304 stainless steel with copper downspouts factory piped to main condensate pan. Use of intermediate condensate drain channel on upper casing of lower coil is permissible provided it is readily cleanable. Design of intermediate condensate drain shall prevent upper coil condensate from flowing across face of lower coil.
  2. Drain pan shall be piped to the exterior of the unit. Drain pan shall be readily cleanable.
  3. Installation, including frame, shall be designed and sealed to prevent blow-by.
- F. Not Used.
- G. Fan Motor, Drive, and Mounting Assembly (Housed Centrifugal Fans):
  1. Fan Motor and Drive: Motors shall be premium energy efficient type, as mandated by the Energy Policy Act of 2005, with efficiencies as shown in the Specifications Section 23 05 12 (General Motor

Requirements For HVAC and Steam Equipment), on drawings and suitable for use in variable frequency drive applications on AHUs where this type of drive is indicated. Refer to Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION, for additional motor and drive specifications. Refer to Specification Section 26 29 11, LOW-VOLTAGE MOTOR STARTERS.

2. Fan drive and belts shall be factory mounted with final alignment and belt adjustment to be made by the Contractor after installation. Drive and belts shall be as specified in Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION. Provide additional drive(s) if required during balancing, to achieve desired airflow.

#### H. Plenum Fans - Single and/or Multiple Fans in an Array

1. General: Fans shall be Class II (minimum) construction with single inlet, aluminum wheel and stamped air-foil aluminum bladed. The fan wheel shall be mounted on the directly-driven motor shaft in AMCA Arrangement 4. Fans shall be dynamically balanced and internally isolated to minimize the vibrations. Provide a steel inlet cone for each wheel to match with the fan inlet. Locate fan in the air stream to assure proper flow. The fan performance shall be rated in accordance with AMCA 210 or ASHRAE 51.
2. Allowable vibration tolerances for fan shall not exceed a self-excited vibration maximum velocity of 0.005 m/s (0.20 inch per second) RMS, filter in, when measured with a vibration meter on bearing caps of machine in vertical, horizontal and axial directions. After field installation, compliance to this requirement shall be demonstrated with field test in accordance with Section 23 05 93, TESTING, ADJUSTING, and BALANCING FOR HVAC. The fan wheel shall meet or exceed guidelines in AMCA 801-92 for dynamic balancing requirements. The complete fan assembly balance shall be tested using an electronic balance analyzer with a tunable filter and stroboscope. Vibration measurements shall be taken on each motor bearing housing in the vertical, horizontal, and axial planes (5 total measurements, 2 each motor bearing and 1 axial).
3. The plenum fans shall be driven by variable speed drives with at least one back-up drive as shown in the design documents. Use of a drive with bypass is not permitted.
4. Multiple fans shall be installed in a pre-engineered structural frame to facilitate fan stacking. All fans shall modulate in unison, above or below the synchronous speed within the limits specified by the manufacturer, by a common control sequence. Staging of the fans is



not permitted. Redundancy requirement shall be met by all operating fans in an array and without the provision of an idle standby fan.

5. Fan Accessories

a. Fan Isolation: Provide an actuator-controlled damper to isolate the fan not in operation due to failure.

b. Fan Airflow Measurement: Provide an airflow measuring device integral to the fan to measure air volume within +/- 5 percent accuracy. The probing device shall not be placed in the airflow path to stay clear of turbulence and avoid loss of performance.

6. Fan Motor, Drive and Mounting Assembly: Fan Motors shall be premium energy efficient type, as mandated by the Energy Policy Act of 2005, with efficiencies as shown in the Specifications Section 23 05 12 (General Motor Requirements For HVAC and Steam Equipment), on drawings and suitable for use in variable frequency drive applications. Refer to Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION, for additional motor and drive specifications. Refer to Specification Section 26 29 11, LOW-VOLTAGE MOTOR STARTERS

I. Not Used.

J. Not Used.

K. Not Used.

L. Filter Section: Refer to Section 23 40 00, HVAC AIR CLEANING DEVICES, for filter requirements.

1. Filters including one complete set for temporary use at site shall be provided independent of the RTU. The RTU manufacturer shall install filter housings and racks in filter section compatible with filters furnished. The RTU manufacturer shall be responsible for furnishing temporary filters (pre-filters and after-filters, as shown on drawings) required for RTU testing.

2. Factory-fabricated filter section shall be of the same construction and finish as the RTU casing including filter racks and hinged double wall access doors. Filter housings shall be constructed in accordance with side service or holding frame housing requirements in Section 23 40 00, HVAC AIR CLEANING DEVICES.

M. Diffuser Section: Furnish a diffuser segment with perforated diffuser plate immediately downstream of supply fan to assure uniform distribution of leaving air across the face of the downstream after-filters to create uniform velocity profiles across the entire opening. Bolt or weld diffuser plate to a sturdy steel support frame so that it remains rigid. Manufacturer shall include any diffuser section pressure

loss in excess of diffuser plate and this value shall be included in unspecified internal losses when selecting fan.

- N. Coils: Coils shall be mounted on hot dipped galvanized steel supports to assure proper anchoring of coil and future maintenance. Coils shall be face or side removable for future replacement thru the access doors or removable panels. Each coil shall be removable without disturbing adjacent coil. Cooling coils shall be designed and installed to insure no condensate carry over. Provide factory installed extended supply, return, drain, and vent piping connections.

- 1. Water Coils.

- 2. Integral Face and Bypass Steam Coils: Provide integral vertical face and bypass dampers. Electric damper operators shall be furnished and mounted by the RTU manufacturer at the factory. Damper operators shall be of same manufacturer as controls furnished under Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC.

- 3. Steam Distributing Tube Coils

- O. Not Used.

- P. Not Used.

- Q. Discharge Section: Provide aerodynamically designed framed discharge openings or spun bellmouth fittings to minimize pressure loss.

- R. Electrical and Lighting: Wiring and equipment specifications shall conform to Division 26, ELECTRICAL.

- 1. Vapor-proof lights using cast aluminum base style with glass globe and cast aluminum guard shall be installed in access sections for fan, mixing box, and any section over 300mm (12 inch) wide. A switch shall control the lights in each compartment with pilot light mounted outside the respective compartment access door. Wiring between switches and lights shall be factory installed. All wiring shall run in neatly installed electrical conduits and terminate in a junction box for field connection to the building system. Provide single point 115 volt - one phase connection at junction box.

- 2. Install compatible 100 watt bulb in each light fixture.

- 3. Provide a convenience duplex weatherproof receptacle next to the light switch.

- 4. Disconnect switch and power wiring: Provide factory or field mounted disconnect switch. Coordinate with Division 26, ELECTRICAL.

### **PART 3 - EXECUTION**

#### **3.1 INSTALLATION**

- A. Install roof top unit in conformance with ARI 435.

- B. Assemble roof top unit components following manufacturer's instructions for handling, testing and operation. Repair damaged galvanized areas

with paint in accordance with Military Spec. DOD-P-21035A. Repair painted units by touch up of all scratches with finish paint material. Vacuum the interior of air-handling units clean prior to operation.

- C. Not Used.
- D. Leakage and test requirements for roof top units shall be the same as specified for ductwork in Specification Section 23 31 00, HVAC DUCTS AND CASINGS except leakage shall not exceed Leakage Class ( $C_L$ ) 12 listed in SMACNA HVAC Air Duct Leakage Test Manual when tested at 1.5 times the design static pressure. Repair casing air leaks that can be heard or felt during normal operation and to meet test requirements.
- E. Perform field mechanical (vibration) balancing in accordance with Section 23 05 41, NOISE and VIBRATION CONTROL FOR HVAC PIPING and EQUIPMENT.
- F. Seal and/or fill all openings between the casing and RTU components and utility connections to prevent air leakage or bypass.

### 3.2 STARTUP SERVICES

- A. The air handling unit shall not be operated for any purpose, temporary or permanent, until ductwork is clean, filters are in place, bearings are lubricated and fan has been test run under observation.
- B. After the air handling unit is installed and tested, provide startup and operating instructions to VA personnel.
- C. An authorized factory representative should start up, test and certify the final installation and application specific calibration of control components. Items to be verified include fan performance over entire operating range, noise and vibration testing, verification of proper alignment, overall inspection of the installation, Owner/Operator training, etc.

- - - E N D - - -



**SECTION 23 81 43**  
**AIR-SOURCE UNITARY HEAT PUMPS**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This Section specifies electrically operated air-source unitary heat pumps.
- B. Definitions:
  - 1. Coefficient of Performance (COP) - Cooling: The ratio of the rate of heat removed to the rate of energy input in consistent units, for a complete refrigerating system or some specific portion of that system under designated operating conditions.
  - 2. Coefficient of Performance (COP) - Heating: The ratio of the rate of heat delivered to the rate of energy input in consistent units for a complete heat pump system, including the compressor and, if applicable, auxiliary heat under designated operating conditions.
  - 3. Energy Efficiency Ratio (EER): The ratio of net cooling capacity in Btu/h to total rate of electricity input in watts under designated operating conditions.
  - 4. Heating Seasonal Performance Factor (HSPF) - Total heating output of heat pump during its normal annual usage period for heating in Btu/h divided by total electric energy input in watts during the same period.
  - 5. Seasonal Energy Efficiency Ratio (SEER) - Total cooling output of an air conditioner during its normal annual usage period for cooling in Btu/h divided by total electric energy input in watts during the same period.
  - 6. Air-Source Unitary Heat Pump: One or more factory made assemblies that normally include an indoor conditioning coil, compressor(s) and an outdoor refrigerant-to-air coil. These units provide both heating and cooling functions.

**1.2 RELATED WORK**

- A. Section 01 00 00, GENERAL REQUIREMENTS: For pre-test requirements.
- B. Section 23 05 11, COMMON WORK RESULTS FOR HVAC: General mechanical requirements and items, which are common to more than one section of Division 23.
- C. Section 23 23 00, REFRIGERANT PIPING: Requirements for field refrigerant piping.
- D. Section 23 31 00, HVAC DUCTS AND CASINGS: Requirements for sheet metal ductwork.

E. Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC: Requirements for controls and instrumentation.

F. Section 23 05 93, TESTING, ADJUSTING, AND BALANCING FOR HVAC: Requirements for testing, adjusting and balancing of HVAC system.

### **1.3 QUALITY ASSURANCE:**

- A. Refer to specification Section 23 05 11, COMMON WORK RESULTS FOR HVAC
- B. Comply with ASHRAE Standard 15, Safety Code for Mechanical Refrigeration.
- C. Comply with ASHRAE Standard 90.1-2010, Energy Standard for Buildings except Low-Rise Residential Buildings for cooling and heating performance requirements when tested in accordance with AHRI 210/240 and UL 1995.
- D. Heating Performance shall conform to ASHRAE requirements when tested in accordance with AHRI 210/240 and UL 1995.

### **1.4 SUBMITTALS**

- A. Submit in accordance with specification Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Manufacturer's Literature and Data.
  - 1. Air-Source Unitary Heat pump:
    - a. Split system
- C. Certification: Submit, simultaneously with shop drawings, a proof of certification that this product has been certified by AHRI.
- D. Performance Rating: Submit catalog selection data showing equipment ratings and compliance with required cooling and heating capacities EER and COP values as applicable.

### **1.5 APPLICABLE PUBLICATIONS:**

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. Federal Specification (Fed. Spec.):
  - A-A-50502-90.....Air-conditioner (UNITARY HEAT PUMP), AIR TO AIR (3000 TO 300,000 BTUH)
- C. Air-Conditioning Heating and Refrigeration Institute (AHRI) Standards:
  - AHRI-DCPP.....Directory of Certified Product Performance - Applied Directory of Certified Products
  - 210/240-08.....Performance Rating of Unitary Air-Conditioning and Air-Source Heat Pump Equipment
  - 270-08.....Sound Rating of Outdoor Unitary Equipment
  - 310/380-04.....Standard for Packaged Terminal Air-Conditioners and Heat Pumps (CSA-C744-04)

- 340/360-07.....Commercial and Industrial Unitary Air-  
Conditioning and Heat Pump Equipment
- D. Air Movement and Control Association (AMCA):
- 210-07.....Laboratory Methods of Testing Fans for  
Aerodynamic Performance Rating (ANSI)
- 410-96.....Recommended Safety Practices for Users and  
Installers of Industrial and Commercial Fans
- E. American National Standards Institute (ANSI):
- S12.51-02 (R2007).....Acoustics - Determination of Sound Power Levels  
of Noise Sources Using Sound Pressure -  
Precision Method for Reverberation Rooms (same  
as ISO 3741:1999)
- F. American Society of Heating, Refrigerating and Air-Conditioning  
Engineers Inc (ASHRAE):
- 15-10.....Safety Standard for Refrigeration Systems (ANSI)
- 62.1-10.....Ventilation for Acceptable Indoor Air Quality  
(ANSI)
- 90.1-07.....Energy Standard for Buildings except Low-Rise  
Residential Buildings
- 2008 Handbook.....HVAC Systems and Equipment
- G. American Society of Testing and Materials (ASTM):
- B117-09.....Standard Practice for Operating Salt Spray (Fog)  
Apparatus
- H. National Electrical Manufacturer's Association (NEMA):
- MG 1-09 (R2010).....Motors and Generators (ANSI)
- ICS 1-00 (R2005).....Industrial Controls and Systems: General  
Requirements
- I. National Fire Protection Association (NFPA):
- 90A-09.....Standard for the Installation of Air-  
Conditioning and Ventilating Systems
- J. Underwriters Laboratory (UL):
- 1995-05.....Heating and Cooling Equipment

## **PART 2- PRODUCTS**

### **2.1 UNITARY HEAT PUMPS, AIR TO AIR**

- A. Units shall comply with Fed Spec A-A-50502 Type II, (Split System)  
having remote outdoor section separate from indoor Section, Class 1,  
"Department of Energy" (DOE) covered products (units with cooling  
capacity up to 65000 Btu/hr.
1. Unitary heat pumps shall bear the United States Environmental  
Protection Agency, Energy Star label and shall have a minimum Heating  
Season Performance Factor (HSPF) of 8.2 (Type II - Split System), and

- a minimum Seasonal Energy Efficiency Ratio (SEER) of 14.5 (Type II - Split System).
- B. Applicable AHRI Standards: Units shall be listed in the corresponding ARI Directory of Certified products shown in paragraph, APPLICABLE PUBLICATIONS:
1. Air Source Unitary heat pumps with capacity less than 19 KW (65,000 Btu/hr), Comply with AHRI 210/240.
  2. Air Source heat pump with capacity above 19KW (above 65,000 Btu/hr, Comply with AHRI 340/360.
- C. Casing: Unit shall be constructed of zinc coated, heavy-gage galvanized steel. Exterior surfaces shall be cleaned, phosphatized, and finished with a weather-resistant baked enamel finish. Unit surfaces shall be tested 500 hours in a salt spray test in compliance with ASTM B117. Cabinet panels shall have lifting handles and shall be water- and air-tight seal. All exposed vertical, top covers and base pan shall be insulated with 13-mm (1/2-inch) matt-faced, fire-resistant, odorless, glass fiber material. Surfaces in contact with the airstream shall comply with requirements in ASHRAE 62.1-2010. The base of the unit shall have provisions for forklift and crane lifting.
- D. Filters: One inch, MERV 7, throwaway filter shall be standard on all units below 19kW (6 Tons). Filter rack can be converted to two inch capability. Two inch, MERV 8, throwaway filters shall be factory supplied on all units above 19 kW (6 Tons).
- E. Compressors: Compressors shall be direct-drive, hermetic scroll type with centrifugal type oil pumps. Motor shall be suction gas-cooled. Internal overloads and crankcase heaters shall be utilized with all compressors.
- F. Refrigerant Circuit: A minimum of two circuits is required. Each refrigerant circuit shall have independent fixed orifice or thermostatic expansion devices, service pressure ports, and refrigerant line filter driers factory installed as standard. An area shall be provided for replacement suction line driers.
- G. Evaporator and Condenser Coils: Internally finned, DN 10 (NPS 3/8) copper tubes mechanically bonded to a configured aluminum plate fin shall be standard. The evaporated coil and condenser coil shall be leak tested at the factory to 1378 kPa (200 psig) and pressure tested to 2756 kPa (400 psig). All dual compressor units shall have intermingled evaporator coils. Sloped condensate drain pans shall be provided.
- H. Outdoor fans: Direct driven, statically and dynamically balanced, draw-through in the vertical discharge position. The fan motors shall be



permanently lubricated and shall have built-in thermal overload protection.

I. Indoor Fan:

1. Forward-Curved, Centrifugal Fan: Provide V-belt driven with adjustable motor sheaves Motors shall be thermally protected. Provide oversized motors for high static application. Motors shall meet the U.S. Energy Policy Act of 2005 (EPACT).

J. Defrost Controls: A time initiated, temperature terminated defrost system shall ship with a setting of 70-minute cycle, with a choice of 50- or 90-minute cycle. Timed override limits defrost cycle to 10 minutes shall be available on units from 35- to 70-kW (10 to 20 tons). Adaptive demand defrost shall be provided on units below 35 kW (10 Tons).

K. Unit Electrical

1. Provide single point unit power connection.
2. Unit control box shall be located within the unit and shall contain controls for compressor, reversing valve and fan motor operation and shall have a 50 VA 24-volt control circuit transformer and a terminal block for low voltage field wiring connections.
3. Safety Controls - High pressure, low temperature, and low pressure safety switches shall be wired through a latching lockout circuit to hold the conditioner off until it is reset electrically by interrupting the power supply to the conditioner. All safety switches shall be normally closed, opening upon fault detection.

L. Operating Controls

1. Provide unit with factory supplied DDC control system.
2. Low voltage, adjustable room thermostat to control heating and cooling in sequence with delay between stages, compressor and supply fan to maintain temperature setting. Include system selector switch (off-heat-auto-cool) and fan control switch (auto-on).
3. Unit DDC Controller:
  - a. Unit controller shall include input, output and self-contained programming as needed for complete control of unit.
  - b. Not Used.
  - c. Not Used.
  - d. All program sequences shall be stored on board in EEPROM. No batteries shall be needed to retain logic program. All program sequences shall be executed by controller 10 times per second and shall be capable of multiple PID loops for control of multiple devices. Programming of logic controller shall be completely modifiable in the field over installed BACnet LANs.

- e. Temperature Control System Interface: Points shall be available from the unit controller for service access and display and/or control.
- f. Space Temperature Sensor: The wall mounted sensor shall include occupied and unoccupied setpoint control, pushbutton unoccupied override, space temperature offset and space temperature indication. Refer to Section 23 09 23, DIRECT DIGITAL CONTROL SYSTEM FOR HVAC for additional requirements.

M. Accessories:

- 1. Electric Heater: Constructed of heavy-duty nickel chromium elements. Staging shall be achieved through the unit control processor. Each heater shall have automatically reset high limit control. Heaters shall be individually fused from the factory and shall comply with NEC and CEC requirements. Power assemblies shall provide single point connection. Electric heat modules shall be listed and labeled by a national recognized testing laboratory acceptable to authorities having jurisdiction. Electric heater controls shall confirm the supply fan is operating before electric elements are energized. Operate electric heater in 2stages when outdoor ambient is too low to maintain space thermostat setting with compressor operation.
- 2. Oversized Motors: Factory installed over sized motor shall be available for high-static application.

## 2.2 CORROSION PROTECTION

A. Remote Outdoor Condenser Coils:

- 1. Epoxy Immersion Coating - Electrically Deposited: The multi-stage corrosion-resistant coating application comprises of cleaning (heated alkaline immersion bath) and reverse-osmosis immersion rinse prior to the start of the coating process. The coating thickness shall be maintained between 0.6-mil and 1.2-mil. Before the coils are subjected to high-temperature oven cure, they are treated to permeate immersion rinse and spray. Where the coils are subject to UV exposure, UV protection spray treatment comprising of UV-resistant urethane mastic topcoat shall be applied. The coating process shall be such that uniform coating thickness is maintained at the fin edges. The quality control shall be maintained by ensuring compliance to the applicable ASTM Standards for the following:
  - a. Salt Spray Resistance (Minimum 6,000 Hours)
  - b. Humidity Resistance (Minimum 1,000 Hours)
  - c. Water Immersion (Minimum 260 Hours)
  - d. Cross-Hatch Adhesion (Minimum 4B-5B Rating)
  - e. Impact Resistance (Up to 160 Inch/Pound)

B. Exposed Outdoor Cabinet:

1. Casing Surfaces (Exterior and Interior): All exposed and accessible metal surfaces shall be protected with a water-reducible acrylic with stainless steel pigment spray-applied over the manufacturer's standard finish. The spray coating thickness shall be 2-4 mils and provide minimum salt-spray resistance of 1,000 hours (ASTM B117) AND 500 hours UV resistance (ASTM D4587).

**PART 3- EXECUTION**

**3.1 INSTALLATION**

- A. Install heat pumps according to manufacturers printed instructions.
- B. Install electrical and control devices furnished by the manufacturer but not specified to be factory mounted. All electrical work shall comply with Division 26 Sections.
- C. Ductwork: Comply with requirements in Section 23 31 00, HVAC DUCTS AND CASINGS.
- D. Piping: Comply with requirements in Section 23 23 00, REFRIGERANT PIPING.

**3.2 STARTUP AND TESTING:**

- A. Perform startup checks according to manufacturer's written instructions.
- B. Test controls and demonstrate its compliance with project requirements. Replace damaged or malfunctioning controls and equipment and retest the equipment to the satisfaction of the Project Manager.
- C. Furnish test reports to the Senior Project Manager in accordance with specification Section 01 00 00, GENERAL REQUIREMENTS.

**3.3 INSTRUCTIONS**

Provide services of manufacturer's technical representative for four hours to instruct VA personnel in operation and maintenance of heat pumps.

**3.4 STARTUP AND TESTING NOT USED.**

**3.5 COMMISSIONING NOT USED.**

**3.6 DEMONSTRATION AND TRAINING**

- A. Provide services of manufacturer's technical representative for four hours to instruct VA personnel in operation and maintenance of units.

- - - E N D - - -



**SECTION 23 82 00**  
**CONVECTION HEATING AND COOLING UNITS**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

Fan-coil units, unit heaters, cabinet unit heaters, convectors and finned-tube radiation

**1.2 RELATED WORK**

- A. Section 23 05 11, COMMON WORK RESULTS FOR HVAC: General mechanical requirements and items, which are common to more than one section of Division 23.
- B. Not Used.
- C. Section 23 21 13, HYDRONIC PIPING: Heating hot water and chilled water piping.
- D. Section 23 31 00, HVAC DUCTS and CASINGS: Ducts and flexible connectors.
- E. Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC: Valve operators.
- F. Section 23 05 93, TESTING, ADJUSTING, and BALANCING FOR HVAC: Flow rates adjusting and balancing.
- G. Not Used.

**1.3 QUALITY ASSURANCE**

Refer to Paragraph, QUALITY ASSURANCE, in Section 23 05 11, COMMON WORK RESULTS FOR HVAC.

**1.4 SUBMITTALS**

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Manufacturer's Literature and Data:
  - 1. Not Used.
  - 2. Fan-Coil units.
  - 3. Unit heaters.
  - 4. Cabinet unit heaters.
- C. Certificates:
  - 1. Compliance with paragraph, QUALITY ASSURANCE.
  - 2. Compliance with specified standards.
- D. Operation and Maintenance Manuals: Submit in accordance with paragraph, INSTRUCTIONS, in Section 01 00 00, GENERAL REQUIREMENTS.

## 1.5 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American National Standards Institute / Air Conditioning, Heating and Refrigeration Institute (ANSI/AHRI):
  - 440-08.....Performance Rating of Room Fan Coils
  - National Fire Protection Association (NFPA):
  - 90A-09.....Standard for the Installation of Air Conditioning and Ventilating Systems
  - 70-11.....National Electrical Code
- C. Underwriters Laboratories, Inc. (UL):
  - 181-08.....Standard for Factory-Made Air Ducts and Air Connectors
  - 1995-05.....Heating and Cooling Equipment

## PART 2 - PRODUCTS

### 2.1 ROOM FAN-COIL UNITS

- A. Capacity Certification: AHRI 440.
- B. Safety Compliance: NEC compliant and UL listed.
- C. Noise Levels: Operating at full cooling capacity, sound power level shall not exceed by more than 5 dB the numerical value of sound pressure levels associated with noise criteria specified in Section 23 05 51, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT. Select units at intermediate speed, for compliance with the noise criteria.
- D. Chassis: Galvanized steel, acoustically and thermally insulated to attenuate noise and prevent condensation.
- E. Cabinet: Minimum 1.3 mm (18 gage) steel reinforced and braced. Arrange components and provide adequate space for installation of piping package and control valves. Finish shall be factory-baked enamel in manufacturer's standard color on all exposed surfaces.
  - 1. Vertical Exposed Cabinet Unit: Provide 1.6 mm (16 gage) steel front panel with 13 mm (1/2-inch) thick fiberglass insulation and provide screw-type levelers.
    - a. Air outlet grilles: Adjustable four-way air deflection located in the top panel.

- b. Provide two hinged access doors (one each side) equipped with key operated cam-lock fasteners in the unit top panel located to provide access to the unit controls.
- 2. Horizontal Unit: Provide concealed type as shown. Provide supports and vibration isolators for horizontal units as recommended by the manufacturer.
- F. Fans: Centrifugal, forward curved, double width type wheels, galvanized steel or polyester resin construction, statically and dynamically balanced, direct driven.
  - 1. Motors: Premium efficiency, 3-speed permanent split capacitor type with integral thermal overload protection, for operation at not more than 1200 RPM.
  - 2. Provide a fan speed selector switch, with off, low, medium, and high positions. Switch shall have a set of auxiliary contacts which are open when the switch is in the "off" position and closed when the switch in any of the other positions. On vertical units, mount switch in a junction box in the cabinet of each unit. On ceiling-suspended horizontal and concealed units, switch shall be wall mounted.
- G. Cooling and Heating Coils:
  - 1. Hydronic (two separate coils for cooling and heating): Copper tubes, 10 mm (three-eighths inch) minimum inside diameter, not less than 4.3 mm (0.017 inch) thick with copper or aluminum fins. Coils shall be pressure tested for bursting and strength in accordance with Underwriters Laboratories, Inc., requirements for pressure tested coils, and shall be designed to provide adequate heat transfer capacity. Provide manual air vent at high point of each coil and drain at each low point.
- H. Piping Package: Factory furnished with unit by the manufacturer or field-installed by the contractor to fit control valves provided by the controls supplier. Submit manufacturer's detailed drawings of the piping in the end compartments for approval prior to fabrication of the piping packages. Provide ball stop valves on the supply and return pipes and balancing fittings on the return pipes.
- I. Drain pans: Furnish galvanized steel with solderless drain connections and molded polystyrene foam insulating liner:
  - 1. Auxiliary drain pan: Located under control valve and piping within the unit enclosure to prevent dripping.

2. Secondary Drain Pan: Where the unit is located such that drain pan overflow will damage the building, provide a secondary drain pan located underneath the unit, constructed to extend a minimum of 50 mm (2 inches) beyond the edges of the unit and be a minimum of 38 mm (1-1/2 inches deep) provided with a separate drain line discharging to conspicuous point or water detection device to deactivate the cooling in the unit.
- J. Air Filter: Manufacturer's standard throwaway type, not less than 25 mm (1 inch) thick, MERV 7, supported to be concealed from sight and be tight fitting to prevent air by-pass. Filters shall have slide out frames and be easily replaced without removing enclosure or any part thereof.
- K. Control valves and remote wall mounted space thermostats are to be field installed. Provide two-way modulating control valves unless shown or specified otherwise.

## **2.2 UNIT HEATERS NOT USED.**

## **2.3 CABINET UNIT HEATERS**

- A. General: Vertical or horizontal type for steam, hot water or electric heating medium, as indicated.
- B. Cabinet: Not less than 1.3 mm (18 gage) steel with front panel for vertical units and hinged front panel for horizontal units. Finish on exposed cabinet shall be factory-baked enamel in manufacturer's standard color as selected by the Architect. Provide 76 mm (3-inch) high sub-base for vertical floor mounted units.
- C. Fan: Centrifugal blower, direct driven by a single phase, two-speed, electric motor with inherent overload protection. Provide resilient motor/fan mount.
- D. Filter: Manufacturer's standard, one inch thick, throwaway type MERV 7 filters.
- E. Hot Water Coil: Aluminum fins bonded to seamless copper tubing by mechanical expansion of the tubing, designed for 517 kPa (75 psi) steam working pressure.
  1. Provide corrosion control for coils in high-humidity locations by using a multi-stage, epoxy immersion coating (electrically deposited) process fully described in Section 23 82 16 - Air Coils.//
- F. Factory Mounted Controls: Manual fan starter and three-position (low, high and off) fan speed switch. Provide field installed remote wall mounted line voltage electric space thermostats or unit mounted return



air thermostats, where shown or specified to control the unit fan.  
Provide an aquastat on hot water units to prevent fan operation when  
the heating system is off.

### **PART 3 - EXECUTION**

#### **3.1 INSTALLATION**

- A. Work shall be installed as shown and according to the manufacturer's diagrams and recommendations.
- B. Handle and install units in accordance with manufacturer's written instructions.
- C. Support units rigidly so they remain stationary at all times.  
Cross-bracing or other means of stiffening shall be provided as necessary. Method of support shall be such that distortion and malfunction of units cannot occur.

#### **3.2 OPERATIONAL TEST**

Refer to Section 23 05 11, COMMON WORK RESULTS FOR HVAC.

#### **3.3 STARTUP AND TESTING NOT USED.**

#### **3.4 COMMISSIONING NOT USED.**

#### **3.5 DEMONSTRATION AND TRAINING**

- A. Provide services of manufacturer's technical representative for four hours to instruct VA personnel in operation and maintenance of units.

- - - E N D - - -



**SECTION 26 05 11**  
**REQUIREMENTS FOR ELECTRICAL INSTALLATIONS**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section applies to all sections of Division 26.
- B. Furnish and install electrical systems, materials, equipment, and accessories in accordance with the specifications and drawings. Capacities and ratings of motors, transformers, conductors and cable, switchboards, switchgear, panelboards, motor control centers, generators, automatic transfer switches, and other items and arrangements for the specified items are shown on the drawings.
- C. Electrical service entrance equipment and arrangements for temporary and permanent connections to the electric utility company's system shall conform to the electric utility company's requirements. Coordinate fuses, circuit breakers and relays with the electric utility company's system, and obtain electric utility company approval for sizes and settings of these devices.
- D. Conductor ampacities specified or shown on the drawings are based on copper conductors, with the conduit and raceways sized per NEC. Aluminum conductors are prohibited.

**1.2 MINIMUM REQUIREMENTS**

- A. The latest International Building Code (IBC), Underwriters Laboratories, Inc. (UL), Institute of Electrical and Electronics Engineers (IEEE), and National Fire Protection Association (NFPA) codes and standards are the minimum requirements for materials and installation.
- B. The drawings and specifications shall govern in those instances where requirements are greater than those stated in the above codes and standards.

**1.3 TEST STANDARDS**

- A. All materials and equipment shall be listed, labeled, or certified by a Nationally Recognized Testing Laboratory (NRTL) to meet Underwriters Laboratories, Inc. (UL), standards where test standards have been established. Materials and equipment which are not covered by UL standards will be accepted, providing that materials and equipment are listed, labeled, certified or otherwise determined to meet the safety requirements of a NRTL. Materials and equipment which no NRTL accepts, certifies, lists, labels, or determines to be safe, will be considered

if inspected or tested in accordance with national industrial standards, such as ANSI, NEMA, and NETA. Evidence of compliance shall include certified test reports and definitive shop drawings.

**B. Definitions:**

1. Listed: Materials and equipment included in a list published by an organization that is acceptable to the Authority Having Jurisdiction and concerned with evaluation of products or services, that maintains periodic inspection of production or listed materials and equipment or periodic evaluation of services, and whose listing states that the materials and equipment either meets appropriate designated standards or has been tested and found suitable for a specified purpose.
2. Labeled: Materials and equipment to which has been attached a label, symbol, or other identifying mark of an organization that is acceptable to the Authority Having Jurisdiction and concerned with product evaluation, that maintains periodic inspection of production of labeled materials and equipment, and by whose labeling the manufacturer indicates compliance with appropriate standards or performance in a specified manner.
3. Certified: Materials and equipment which:
  - a. Have been tested and found by a NRTL to meet nationally recognized standards or to be safe for use in a specified manner.
  - b. Are periodically inspected by a NRTL.
  - c. Bear a label, tag, or other record of certification.
4. Nationally Recognized Testing Laboratory: Testing laboratory which is recognized and approved by the Secretary of Labor in accordance with OSHA regulations.

**1.4 QUALIFICATIONS (PRODUCTS AND SERVICES)**

A. Manufacturer's Qualifications: The manufacturer shall regularly and currently produce, as one of the manufacturer's principal products, the materials and equipment specified for this project, and shall have manufactured the materials and equipment for at least three years.

**B. Product Qualification:**

1. Manufacturer's materials and equipment shall have been in satisfactory operation, on three installations of similar size and type as this project, for at least three years.

2. The Government reserves the right to require the Contractor to submit a list of installations where the materials and equipment have been in operation before approval.

C. Service Qualifications: There shall be a permanent service organization maintained or trained by the manufacturer which will render satisfactory service to this installation within four hours of receipt of notification that service is needed. Submit name and address of service organizations.

#### **1.5 APPLICABLE PUBLICATIONS**

- A. Applicable publications listed in all Sections of Division 26 shall be the latest issue, unless otherwise noted.
- B. Products specified in all sections of Division 26 shall comply with the applicable publications listed in each section.

#### **1.6 MANUFACTURED PRODUCTS**

- A. Materials and equipment furnished shall be of current production by manufacturers regularly engaged in the manufacture of such items, and for which replacement parts shall be available. Materials and equipment furnished shall be new, and shall have superior quality and freshness.
- B. When more than one unit of the same class or type of materials and equipment is required, such units shall be the product of a single manufacturer.
- C. Equipment Assemblies and Components:
  - 1. Components of an assembled unit need not be products of the same manufacturer.
  - 2. Manufacturers of equipment assemblies, which include components made by others, shall assume complete responsibility for the final assembled unit.
  - 3. Components shall be compatible with each other and with the total assembly for the intended service.
  - 4. Constituent parts which are similar shall be the product of a single manufacturer.
- D. Factory wiring and terminals shall be identified on the equipment being furnished and on all wiring diagrams.
- E. When Factory Tests are specified, Factory Tests shall be performed in the factory by the equipment manufacturer, and witnessed by the contractor. In addition, the following requirements shall be complied with:

1. The Government shall have the option of witnessing factory tests.  
The Contractor shall notify the Government through the COR a minimum of thirty (30) days prior to the manufacturer's performing of the factory tests.
2. When factory tests are successful, contractor shall furnish four (4) copies of the equipment manufacturer's certified test reports to the COR fourteen (14) days prior to shipment of the equipment, and not more than ninety (90) days after completion of the factory tests.
3. When factory tests are not successful, factory tests shall be repeated in the factory by the equipment manufacturer, and witnessed by the Contractor. The Contractor shall be liable for all additional expenses for the Government to witness factory re-testing.

#### **1.7 VARIATIONS FROM CONTRACT REQUIREMENTS**

- A. Where the Government or the Contractor requests variations from the contract requirements, the connecting work and related components shall include, but not be limited to additions or changes to branch circuits, circuit protective devices, conduits, wire, feeders, controls, panels and installation methods.

#### **1.8 MATERIALS AND EQUIPMENT PROTECTION**

- A. Materials and equipment shall be protected during shipment and storage against physical damage, vermin, dirt, corrosive substances, fumes, moisture, cold and rain.
  1. Store materials and equipment indoors in clean dry space with uniform temperature to prevent condensation.
  2. During installation, equipment shall be protected against entry of foreign matter, and be vacuum-cleaned both inside and outside before testing and operating. Compressed air shall not be used to clean equipment. Remove loose packing and flammable materials from inside equipment.
  3. Damaged equipment shall be repaired or replaced, as determined by the COR.
  4. Painted surfaces shall be protected with factory installed removable heavy kraft paper, sheet vinyl or equal.
  5. Damaged paint on equipment shall be refinished with the same quality of paint and workmanship as used by the manufacturer so repaired areas are not obvious.

## 1.9 WORK PERFORMANCE

- A. All electrical work shall comply with requirements of the latest NFPA 70 (NEC), NFPA 70B, NFPA 70E, NFPA 99, NFPA 110, OSHA Part 1910 subpart J - General Environmental Controls, OSHA Part 1910 subpart K - Medical and First Aid, and OSHA Part 1910 subpart S - Electrical, in addition to other references required by contract.
- B. Job site safety and worker safety is the responsibility of the Contractor.
- C. Electrical work shall be accomplished with all affected circuits or equipment de-energized. However, energized electrical work may be performed only for the non-destructive and non-invasive diagnostic testing(s), or when scheduled outage poses an imminent hazard to patient care, safety, or physical security. In such case, all aspects of energized electrical work, such as the availability of appropriate/correct personal protective equipment (PPE) and the use of PPE, shall comply with the latest NFPA 70E, as well as the following requirements:
  - 1. Only Qualified Person(s) shall perform energized electrical work. Supervisor of Qualified Person(s) shall witness the work of its entirety to ensure compliance with safety requirements and approved work plan.
  - 2. At least two weeks before initiating any energized electrical work, the Contractor and the Qualified Person(s) who is designated to perform the work shall visually inspect, verify and confirm that the work area and electrical equipment can safely accommodate the work involved.
  - 3. At least two weeks before initiating any energized electrical work, the Contractor shall develop and submit a job specific work plan, and energized electrical work request to the COR, and Medical Center's Chief Engineer or his/her designee. At the minimum, the work plan must include relevant information such as proposed work schedule, area of work, description of work, name(s) of Supervisor and Qualified Person(s) performing the work, equipment to be used, procedures to be used on and near the live electrical equipment, barriers to be installed, safety equipment to be used, and exit pathways.
  - 4. Energized electrical work shall begin only after the Contractor has obtained written approval of the work plan, and the energized

electrical work request from the COR, and Medical Center's Chief Engineer or his/her designee. The Contractor shall make these approved documents present and available at the time and place of energized electrical work.

5. Energized electrical work shall begin only after the Contractor has invited and received acknowledgment from the COR, and Medical Center's Chief Engineer or his/her designee to witness the work.
- D. For work that affects existing electrical systems, arrange, phase and perform work to assure minimal interference with normal functioning of the facility. Refer to Article OPERATIONS AND STORAGE AREAS under Section 01 00 00, GENERAL REQUIREMENTS.
- E. New work shall be installed and connected to existing work neatly, safely and professionally. Disturbed or damaged work shall be replaced or repaired to its prior conditions, as required by Section 01 00 00, GENERAL REQUIREMENTS.
- F. Coordinate location of equipment and conduit with other trades to minimize interference.

#### **1.10 EQUIPMENT INSTALLATION AND REQUIREMENTS**

- A. Equipment location shall be as close as practical to locations shown on the drawings.
- B. Working clearances shall not be less than specified in the NEC.
- C. Inaccessible Equipment:
  1. Where the Government determines that the Contractor has installed equipment not readily accessible for operation and maintenance, the equipment shall be removed and reinstalled as directed at no additional cost to the Government.
  2. "Readily accessible" is defined as being capable of being reached quickly for operation, maintenance, or inspections without the use of ladders, or without climbing or crawling under or over obstacles such as, but not limited to, motors, pumps, belt guards, transformers, piping, ductwork, conduit and raceways.
- D. Not Used.

#### **1.11 EQUIPMENT IDENTIFICATION**

- A. In addition to the requirements of the NEC, install an identification sign which clearly indicates information required for use and maintenance of items such as switchboards and switchgear, panelboards, cabinets, motor controllers, fused and non-fused safety switches, generators, automatic transfer switches, separately enclosed circuit



breakers, individual breakers and controllers in switchboards, switchgear and motor control assemblies, control devices and other significant equipment.

- B. Identification signs for Normal Power System equipment shall be laminated black phenolic resin with a white core with engraved lettering. Identification signs for Essential Electrical System (EES) equipment, as defined in the NEC, shall be laminated red phenolic resin with a white core with engraved lettering. Lettering shall be a minimum of 12 mm (1/2 inch) high. Identification signs shall indicate equipment designation, rated bus amperage, voltage, number of phases, number of wires, and type of EES power branch as applicable. Secure nameplates with screws.
- C. Install adhesive arc flash warning labels on all equipment as required by the latest NFPA 70E. Label shall show specific and correct information for specific equipment based on its arc flash calculations. Label shall show the followings:
  - 1. Nominal system voltage.
  - 2. Equipment/bus name, date prepared, and manufacturer name and address.
  - 3. Arc flash boundary.
  - 4. Available arc flash incident energy and the corresponding working distance.
  - 5. Minimum arc rating of clothing.
  - 6. Site-specific level of PPE.

#### **1.12 SUBMITTALS**

- A. Submit to the COR in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. The Government's approval shall be obtained for all materials and equipment before delivery to the job site. Delivery, storage or installation of materials and equipment which has not had prior approval will not be permitted.
- C. All submittals shall include six copies of adequate descriptive literature, catalog cuts, shop drawings, test reports, certifications, samples, and other data necessary for the Government to ascertain that the proposed materials and equipment comply with drawing and specification requirements. Catalog cuts submitted for approval shall be legible and clearly identify specific materials and equipment being submitted.

- D. Submittals for individual systems and equipment assemblies which consist of more than one item or component shall be made for the system or assembly as a whole. Partial submittals will not be considered for approval.
1. Mark the submittals, "SUBMITTED UNDER SECTION\_\_\_\_\_".
  2. Submittals shall be marked to show specification reference including the section and paragraph numbers.
  3. Submit each section separately.
- E. The submittals shall include the following:
1. Information that confirms compliance with contract requirements. Include the manufacturer's name, model or catalog numbers, catalog information, technical data sheets, shop drawings, manuals, pictures, nameplate data, and test reports as required.
  2. Not Used.
  3. Elementary and interconnection wiring diagrams for communication and signal systems, control systems, and equipment assemblies. All terminal points and wiring shall be identified on wiring diagrams.
  4. Parts list which shall include information for replacement parts and ordering instructions, as recommended by the equipment manufacturer.
- F. Maintenance and Operation Manuals:
1. Submit as required for systems and equipment specified in the technical sections. Furnish in hardcover binders or an approved equivalent.
  2. Inscribe the following identification on the cover: the words "MAINTENANCE AND OPERATION MANUAL," the name and location of the system, material, equipment, building, name of Contractor, and contract name and number. Include in the manual the names, addresses, and telephone numbers of each subcontractor installing the system or equipment and the local representatives for the material or equipment.
  3. Provide a table of contents and assemble the manual to conform to the table of contents, with tab sheets placed before instructions covering the subject. The instructions shall be legible and easily read, with large sheets of drawings folded in.
  4. The manuals shall include:
    - a. Internal and interconnecting wiring and control diagrams with data to explain detailed operation and control of the equipment.
    - b. A control sequence describing start-up, operation, and shutdown.

- c. Description of the function of each principal item of equipment.
  - d. Installation instructions.
  - e. Safety precautions for operation and maintenance.
  - f. Diagrams and illustrations.
  - g. Periodic maintenance and testing procedures and frequencies, including replacement parts numbers.
  - h. Performance data.
  - i. Pictorial "exploded" parts list with part numbers. Emphasis shall be placed on the use of special tools and instruments. The list shall indicate sources of supply, recommended spare and replacement parts, and name of servicing organization.
  - j. List of factory approved or qualified permanent servicing organizations for equipment repair and periodic testing and maintenance, including addresses and factory certification qualifications.
- G. Approvals will be based on complete submission of shop drawings, manuals, test reports, certifications, and samples as applicable.
- H. After approval and prior to installation, furnish the COR with one sample of each of the following:
- 1. A minimum 300 mm (12 inches) length of each type and size of wire and cable along with the tag from the coils or reels from which the sample was taken. The length of the sample shall be sufficient to show all markings provided by the manufacturer.
  - 2. Each type of conduit coupling, bushing, and termination fitting.
  - 3. Conduit hangers, clamps, and supports.
  - 4. Duct sealing compound.
  - 5. Each type of receptacle, toggle switch, lighting control sensor, outlet box, manual motor starter, device wall plate, engraved nameplate, wire and cable splicing and terminating material, and branch circuit single pole molded case circuit breaker.

#### **1.13 SINGULAR NUMBER**

- A. Where any device or part of equipment is referred to in these specifications in the singular number (e.g., "the switch"), this reference shall be deemed to apply to as many such devices as are required to complete the installation as shown on the drawings.

**1.14 POLYCHLORINATED BIPHENYL (PCB) EQUIPMENT**

- A. This project requires the removal, transport, and disposal of electrical equipment containing Polychlorinated Biphenyls (PCB) in accordance with the Federal Toxic Substances Control Act (TSCA).
- B. The equipment to be removed is shown on the drawings.
- C. The selective demolition shall be in accordance with Section 02 41 00, DEMOLITION.

**1.15 ACCEPTANCE CHECKS AND TESTS**

- A. The Contractor shall furnish the instruments, materials, and labor for tests.
- B. Where systems are comprised of components specified in more than one section of Division 26, the Contractor shall coordinate the installation, testing, and adjustment of all components between various manufacturer's representatives and technicians so that a complete, functional, and operational system is delivered to the Government.
- C. When test results indicate any defects, the Contractor shall repair or replace the defective materials or equipment, and repeat the tests for the equipment. Repair, replacement, and re-testing shall be accomplished at no additional cost to the Government.

**1.16 WARRANTY**

- A. All work performed and all equipment and material furnished under this Division shall be free from defects and shall remain so for a period of one year from the date of acceptance of the entire installation by the Contracting Officer for the Government.

**1.17 INSTRUCTION**

- A. Instruction to designated Government personnel shall be provided for the particular equipment or system as required in each associated technical specification section.
- B. Furnish the services of competent and factory-trained instructors to give full instruction in the adjustment, operation, and maintenance of the specified equipment and system, including pertinent safety requirements. Instructors shall be thoroughly familiar with all aspects of the installation, and shall be factory-trained in operating theory as well as practical operation and maintenance procedures.
- C. A training schedule shall be developed and submitted by the Contractor and approved by the COR at least 30 days prior to the planned training.

PART 2 - PRODUCTS (NOT USED)

PART 3 - EXECUTION (NOT USED)

---END---



**SECTION 26 05 19**  
**LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section specifies the furnishing, installation, connection, and testing of the electrical conductors and cables for use in electrical systems rated 600 V and below, indicated as cable(s), conductor(s), wire, or wiring in this section.

**1.2 RELATED WORK**

- A. Section 07 84 00, FIRESTOPPING: Sealing around penetrations to maintain the integrity of fire-resistant rated construction.
- B. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: Requirements that apply to all sections of Division 26.
- C. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS: Requirements for personnel safety and to provide a low impedance path for possible ground fault currents.
- D. Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS: Conduits for conductors and cables.
- E. Not Used.

**1.3 QUALITY ASSURANCE**

- A. Quality Assurance shall be in accordance with Paragraph, QUALIFICATIONS (PRODUCTS AND SERVICES) in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

**1.4 SUBMITTALS**

- A. Submit in accordance with Paragraph, SUBMITTALS in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS, and the following requirements:
  - 1. Shop Drawings:
    - a. Submit sufficient information to demonstrate compliance with drawings and specifications.
    - b. Submit the following data for approval:
      - 1) Electrical ratings and insulation type for each conductor and cable.
      - 2) Splicing materials and pulling lubricant.
  - 2. Certifications: Two weeks prior to final inspection, submit the following.
    - a. Certification by the manufacturer that the conductors and cables conform to the requirements of the drawings and specifications.

- b. Certification by the Contractor that the conductors and cables have been properly installed, adjusted, and tested.

### 1.5 APPLICABLE PUBLICATIONS

- A. Publications listed below (including amendments, addenda, revisions, supplements and errata) form a part of this specification to the extent referenced. Publications are reference in the text by designation only.
- B. American Society of Testing Material (ASTM):
- D2301-10.....Standard Specification for Vinyl Chloride  
Plastic Pressure-Sensitive Electrical  
Insulating Tape
- D2304-10.....Test Method for Thermal Endurance of Rigid  
Electrical Insulating Materials
- D3005-10.....Low-Temperature Resistant Vinyl Chloride  
Plastic Pressure-Sensitive Electrical  
Insulating Tape
- C. National Electrical Manufacturers Association (NEMA):
- WC 70-09.....Power Cables Rated 2000 Volts or Less for the  
Distribution of Electrical Energy
- D. National Fire Protection Association (NFPA):
- 70-17.....National Electrical Code (NEC)
- E. Underwriters Laboratories, Inc. (UL):
- 44-14.....Thermoset-Insulated Wires and Cables
- 83-14.....Thermoplastic-Insulated Wires and Cables
- 467-13.....Grounding and Bonding Equipment
- 486A-486B-13.....Wire Connectors
- 486C-13.....Splicing Wire Connectors
- 486D-15.....Sealed Wire Connector Systems
- 486E-15.....Equipment Wiring Terminals for Use with  
Aluminum and/or Copper Conductors
- 493-07.....Thermoplastic-Insulated Underground Feeder and  
Branch Circuit Cables
- 514B-12.....Conduit, Tubing, and Cable Fittings

## PART 2 - PRODUCTS

### 2.1 CONDUCTORS AND CABLES

- A. Conductors and cables shall be in accordance with NEMA, UL, as specified herein, and as shown on the drawings.
- B. All conductors shall be copper.
- C. Single Conductor and Cable:



1. No. 12 AWG: Minimum size, except where smaller sizes are specified herein or shown on the drawings.
2. No. 8 AWG and larger: Stranded.
3. No. 10 AWG and smaller: Solid; except shall be stranded for final connection to motors, transformers, and vibrating equipment.
4. Insulation: THHN-THWN and XHHW-2. XHHW-2 shall be used for isolated power systems.

D. Not Used.

E. Color Code:

1. No. 10 AWG and smaller: Solid color insulation or solid color coating.
2. No. 8 AWG and larger: Color-coded using one of the following methods:
  - a. Solid color insulation or solid color coating.
  - b. Stripes, bands, or hash marks of color specified.
  - c. Color using 19 mm (0.75 inches) wide tape.
4. For modifications and additions to existing wiring systems, color coding shall conform to the existing wiring system.
5. Conductors shall be color-coded as follows:

208/120 V	Phase	480/277 V
Black	A	Brown
Red	B	Orange
Blue	C	Yellow
White	Neutral	Gray *
* or white with colored (other than green) tracer.		

6. Lighting circuit "switch legs", and 3-way and 4-way switch "traveling wires," shall have color coding that is unique and distinct (e.g., pink and purple) from the color coding indicated above. The unique color codes shall be solid and in accordance with the NEC. Coordinate color coding in the field with the COTR.
7. Color code for isolated power system wiring shall be in accordance with the NEC.

## 2.2 SPLICES

- A. Splices shall be in accordance with NEC and UL.
- B. Above Ground Splices for No. 10 AWG and Smaller:
  1. Solderless, screw-on, reusable pressure cable type, with integral insulation, approved for copper and aluminum conductors.

2. The integral insulator shall have a skirt to completely cover the stripped conductors.
  3. The number, size, and combination of conductors used with the connector, as listed on the manufacturer's packaging, shall be strictly followed.
- C. Above Ground Splices for No. 8 AWG to No. 4/0 AWG:
1. Compression, hex screw, or bolt clamp-type of high conductivity and corrosion-resistant material, listed for use with copper and aluminum conductors.
  2. Insulate with materials approved for the particular use, location, voltage, and temperature. Insulation level shall be not less than the insulation level of the conductors being joined.
  3. Splice and insulation shall be product of the same manufacturer.
  4. All bolts, nuts, and washers used with splices shall be zinc-plated steel.
- D. Above Ground Splices for 250 kcmil and Larger:
1. Long barrel "butt-splice" or "sleeve" type compression connectors, with minimum of two compression indents per wire, listed for use with copper and aluminum conductors.
  2. Insulate with materials approved for the particular use, location, voltage, and temperature. Insulation level shall be not less than the insulation level of the conductors being joined.
  3. Splice and insulation shall be product of the same manufacturer.
- E. Underground Splices for No. 10 AWG and Smaller:
1. Solderless, screw-on, reusable pressure cable type, with integral insulation. Listed for wet locations, and approved for copper and aluminum conductors.
  2. The integral insulator shall have a skirt to completely cover the stripped conductors.
  3. The number, size, and combination of conductors used with the connector, as listed on the manufacturer's packaging, shall be strictly followed.
- F. Underground Splices for No. 8 AWG and Larger:
1. Mechanical type, of high conductivity and corrosion-resistant material. Listed for wet locations, and approved for copper and aluminum conductors.

- 2. Insulate with materials approved for the particular use, location, voltage, and temperature. Insulation level shall be not less than the insulation level of the conductors being joined.
- 3. Splice and insulation shall be product of the same manufacturer.
- G. Plastic electrical insulating tape: Per ASTM D2304, flame-retardant, cold and weather resistant.

### **2.3 CONNECTORS AND TERMINATIONS**

- A. Mechanical type of high conductivity and corrosion-resistant material, listed for use with copper and aluminum conductors.
- B. Long barrel compression type of high conductivity and corrosion-resistant material, with minimum of two compression indents per wire, listed for use with copper and aluminum conductors.
- C. All bolts, nuts, and washers used to connect connections and terminations to bus bars or other termination points shall be zinc-plated steel.

### **2.4 CONTROL WIRING**

- A. Unless otherwise specified elsewhere in these specifications, control wiring shall be as specified herein, except that the minimum size shall be not less than No. 14 AWG.
- B. Control wiring shall be sized such that the voltage drop under in-rush conditions does not adversely affect operation of the controls.

### **2.5 WIRE LUBRICATING COMPOUND**

- A. Lubricating compound shall be suitable for the wire insulation and conduit, and shall not harden or become adhesive.
- B. Shall not be used on conductors for isolated power systems.

## **PART 3 - EXECUTION**

### **3.1 GENERAL**

- A. Installation shall be in accordance with the NEC, as shown on the drawings, and manufacturer's instructions.
- B. Install all conductors in raceway systems.
- C. Splice conductors only in outlet boxes, junction boxes, pullboxes, manholes, or handholes.
- D. Conductors of different systems (e.g., 120 V and 277 V) shall not be installed in the same raceway.
- E. Install cable supports for all vertical feeders in accordance with the NEC. Provide split wedge type which firmly clamps each individual cable and tightens due to cable weight.

- F. In panelboards, cabinets, wireways, switches, enclosures, and equipment assemblies, neatly form, train, and tie the conductors with non-metallic ties.
- G. For connections to motors, transformers, and vibrating equipment, stranded conductors shall be used only from the last fixed point of connection to the motors, transformers, or vibrating equipment.
- H. Use expanding foam or non-hardening duct-seal to seal conduits entering a building, after installation of conductors.
- I. Conductor and Cable Pulling:
  - 1. Provide installation equipment that will prevent the cutting or abrasion of insulation during pulling. Use lubricants approved for the cable.
  - 2. Use nonmetallic pull ropes.
  - 3. Attach pull ropes by means of either woven basket grips or pulling eyes attached directly to the conductors.
  - 4. All conductors in a single conduit shall be pulled simultaneously.
  - 5. Do not exceed manufacturer's recommended maximum pulling tensions and sidewall pressure values.
- J. No more than three branch circuits shall be installed in any one conduit.
- K. When stripping stranded conductors, use a tool that does not damage the conductor or remove conductor strands.

### 3.2 INSTALLATION IN MANHOLES Not Used.

### 3.3 SPLICE and termination INSTALLATION

- A. Splices and terminations shall be mechanically and electrically secure, and tightened to manufacturer's published torque values using a torque screwdriver or wrench.
- B. Where the Government determines that unsatisfactory splices or terminations have been installed, replace the splices or terminations at no additional cost to the Government.

### 3.4 CONDUCTOR IDENTIFICATION

- A. When using colored tape to identify phase, neutral, and ground conductors larger than No. 8 AWG, apply tape in half-overlapping turns for a minimum of 75 mm (3 inches) from terminal points, and in junction boxes, pullboxes, and manholes. Apply the last two laps of tape with no tension to prevent possible unwinding. Where cable markings are covered by tape, apply tags to cable, stating size and insulation type.

**3.5 FEEDER CONDUCTOR IDENTIFICATION**

- A. In each interior pullbox and each underground manhole and handhole, install brass tags on all feeder conductors to clearly designate their circuit identification and voltage. The tags shall be the embossed type, 40 mm (1-1/2 inches) in diameter and 40 mils thick. Attach tags with plastic ties.

**3.6 EXISTING CONDUCTORS**

- A. Unless specifically indicated on the plans, existing conductors shall not be reused.

**3.7 CONTROL WIRING INSTALLATION**

- A. Unless otherwise specified in other sections, install control wiring and connect to equipment to perform the required functions as specified or as shown on the drawings.
- B. Install a separate power supply circuit for each system, except where otherwise shown on the drawings.

**3.8 CONTROL WIRING IDENTIFICATION**

- A. Install a permanent wire marker on each wire at each termination.
- B. Identifying numbers and letters on the wire markers shall correspond to those on the wiring diagrams used for installing the systems.
- C. Wire markers shall retain their markings after cleaning.
- D. In each manhole and handhole, install embossed brass tags to identify the system served and function.

**3.9 DIRECT BURIAL CABLE INSTALLATION**

- A. Tops of the cables:
  - 1. Below the finished grade: Minimum 600 mm (24 inches) unless greater depth is shown.
  - 2. Below road and other pavement surfaces: In conduit as specified, minimum 760 mm (30 inches) unless greater depth is shown.
  - 3. Not Used.
- B. Under road and paved surfaces: Install cables in concrete-encased galvanized steel rigid conduits. Size as shown on plans, but not less than 50 mm (2 inches) trade size with bushings at each end of each conduit run. Provide size/quantity of conduits required to accommodate cables plus one spare.
- C. Work with extreme care near existing ducts, conduits, cables, and other utilities to prevent any damage.
- D. Excavation and backfill is specified in Section 31 20 00, EARTH MOVING. In addition:

1. Place 75 mm (3 inches) bedding sand in the trenches before installing the cables.
  2. Place 75 mm (3 inches) shading sand over the installed cables.
  3. Install continuous horizontal 25 mm by 200 mm (1 inch x 8 inches) preservative-impregnated wood planking 75 mm (3 inches) above the cables before backfilling.
- E. Provide horizontal slack in the cables for contraction during cold weather.
- F. Install the cables in continuous lengths. Splices within cable runs shall not be accepted.
- G. Connections and terminations shall be listed submersible-type designed for the cables being installed.
- H. Warning tape shall be continuously placed 300 mm (12 inches) above the buried cables.

### 3.10 ACCEPTANCE CHECKS AND TESTS

- A. Perform in accordance with the manufacturer's recommendations. In addition, include the following:
1. Visual Inspection and Tests: Inspect physical condition.
  2. Electrical tests:
    - a. After installation but before connection to utilization devices, such as fixtures, motors, or appliances, test conductors phase-to-phase and phase-to-ground resistance with an insulation resistance tester. Existing conductors to be reused shall also be tested.
    - b. Applied voltage shall be 500 V DC for 300 V rated cable, and 1000 V DC for 600 V rated cable. Apply test for one minute or until reading is constant for 15 seconds, whichever is longer. Minimum insulation resistance values shall not be less than 25 megohms for 300 V rated cable and 100 megohms for 600 V rated cable.
    - c. Perform phase rotation test on all three-phase circuits.

---END---

**SECTION 26 05 26**  
**GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section specifies the furnishing, installation, connection, and testing of grounding and bonding equipment, indicated as grounding equipment in this section.
- B. "Grounding electrode system" refers to grounding electrode conductors and all electrodes required or allowed by NEC, as well as made, supplementary, and lightning protection system grounding electrodes.
- C. The terms "connect" and "bond" are used interchangeably in this section and have the same meaning.

**1.2 RELATED WORK**

- A. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: Requirements that apply to all sections of Division 26.
- B. Section 26 05 19, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES: Low-voltage conductors.
- C. Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS: Conduit and boxes.
- D. Not Used.
- E. Not Used.
- F. Not Used.
- G. Not Used.
- H. Section 26 22 00, LOW-VOLTAGE TRANSFORMERS: Low-voltage transformers.
- I. Not Used.
- J. Not Used.
- K. Section 26 24 16, PANELBOARDS: Low-voltage panelboards.
- L. Not Used.
- M. Not Used.
- N. Not Used.
- O. Section 26 41 00, FACILITY LIGHTNING PROTECTION: Lightning protection.

**1.3 QUALITY ASSURANCE**

- A. Quality Assurance shall be in accordance with Paragraph, QUALIFICATIONS (PRODUCTS AND SERVICES) in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

**1.4 SUBMITTALS**

- A. Submit in accordance with Paragraph, SUBMITTALS in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS, and the following requirements:
1. Shop Drawings:
    - a. Submit sufficient information to demonstrate compliance with drawings and specifications.
    - b. Submit plans showing the location of system grounding electrodes and connections, and the routing of aboveground and underground grounding electrode conductors.
  2. Test Reports:
    - a. Two weeks prior to the final inspection, submit ground resistance field test reports to the COTR.
  3. Certifications:
    - a. Certification by the Contractor that the grounding equipment has been properly installed and tested.

**1.5 APPLICABLE PUBLICATIONS**

- A. Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by designation only.
- B. American Society for Testing and Materials (ASTM):
- B1-13.....Standard Specification for Hard-Drawn Copper Wire
- B3-13.....Standard Specification for Soft or Annealed Copper Wire
- B8-11.....Standard Specification for Concentric-Lay-Stranded Copper Conductors, Hard, Medium-Hard, or Soft
- C. Institute of Electrical and Electronics Engineers, Inc. (IEEE):
- 81-12.....IEEE Guide for Measuring Earth Resistivity, Ground Impedance, and Earth Surface Potentials of a Ground System Part 1: Normal Measurements
- D. National Fire Protection Association (NFPA):
- 70-17.....National Electrical Code (NEC)
- 70E-15.....National Electrical Safety Code
- 99-15.....Health Care Facilities
- E. Underwriters Laboratories, Inc. (UL):



44-14 .....	Thermoset-Insulated Wires and Cables
83-14 .....	Thermoplastic-Insulated Wires and Cables
467-13 .....	Grounding and Bonding Equipment

## **PART 2 - PRODUCTS**

### **2.1 GROUNDING AND BONDING CONDUCTORS**

- A. Equipment grounding conductors shall be insulated stranded copper, except that sizes No. 10 AWG and smaller shall be solid copper. Insulation color shall be continuous green for all equipment grounding conductors, except that wire sizes No. 4 AWG and larger shall be identified per NEC.
- B. Bonding conductors shall be bare stranded copper, except that sizes No. 10 AWG and smaller shall be bare solid copper. Bonding conductors shall be stranded for final connection to motors, transformers, and vibrating equipment.
- C. **Conductor sizes shall not be less than shown on the drawings, or not less than required by the NEC, whichever is greater.**
- D. Insulation: THHN-THWN and XHHW-2. XHHW-2 shall be used for isolated power systems.

### **2.2 GROUND RODS**

- A. Steel or copper clad steel, 19 mm (0.75 inch) diameter by 3 M (10 feet) long.
- B. Quantity of rods shall be as shown on the drawings, and as required to obtain the specified ground resistance.

### **2.3 CONCRETE ENCASED ELECTRODE NOT USED.**

### **2.4 GROUND CONNECTIONS**

- A. Below Grade and Inaccessible Locations: Exothermic-welded type connectors.
- B. Above Grade:
  - 1. Bonding Jumpers: Listed for use with aluminum and copper conductors. For wire sizes No. 8 AWG and larger, use compression-type connectors. For wire sizes smaller than No. 8 AWG, use mechanical type lugs. Connectors or lugs shall use zinc-plated steel bolts, nuts, and washers. Bolts shall be torqued to the values recommended by the manufacturer.
  - 2. Connection to Building Steel: Exothermic-welded type connectors.
  - 3. Connection to Grounding Bus Bars: Listed for use with aluminum and copper conductors. Use mechanical type lugs, with zinc-plated steel

- bolts, nuts, and washers. Bolts shall be torqued to the values recommended by the manufacturer.
4. Connection to Equipment Rack and Cabinet Ground Bars: Listed for use with aluminum and copper conductors. Use mechanical type lugs, with zinc-plated steel bolts, nuts, and washers. Bolts shall be torqued to the values recommended by the manufacturer.

## **2.5 EQUIPMENT RACK AND CABINET GROUND BARS**

- A. Provide solid copper ground bars designed for mounting on the framework of open or cabinet-enclosed equipment racks. Ground bars shall have minimum dimensions of 6.3 mm (0.25 inch) thick x 19 mm (0.75 inch) wide, with length as required or as shown on the drawings. Provide insulators and mounting brackets.

## **2.6 GROUND TERMINAL BLOCKS**

- A. At any equipment mounting location (e.g., backboards and hinged cover enclosures) where rack-type ground bars cannot be mounted, provide mechanical type lugs, with zinc-plated steel bolts, nuts, and washers. Bolts shall be torqued to the values recommended by the manufacturer.

## **2.7 GROUNDING BUS BAR**

- A. Pre-drilled rectangular copper bar with stand-off insulators, minimum 6.3 mm (0.25 inch) thick x 100 mm (4 inches) high in cross-section, length as shown on the drawings, with hole size, quantity, and spacing per detail shown on the drawings. Provide insulators and mounting brackets.

# **PART 3 - EXECUTION**

## **3.1 GENERAL**

- A. Installation shall be in accordance with the NEC, as shown on the drawings, and manufacturer's instructions.
- B. System Grounding:
1. Secondary service neutrals: Ground at the supply side of the secondary disconnecting means and at the related transformer.
  2. Separately derived systems (transformers downstream from the service entrance): Ground the secondary neutral.
  3. Not Used.
- C. Equipment Grounding: Metallic piping, building structural steel, electrical enclosures, raceways, junction boxes, outlet boxes, cabinets, machine frames, and other conductive items in close proximity with electrical circuits, shall be bonded and grounded.

- D. For patient care area electrical power system grounding, conform to NFPA 99 and NEC.

### **3.2 INACCESSIBLE GROUNDING CONNECTIONS**

- A. Make grounding connections, which are normally buried or otherwise inaccessible, by exothermic weld.

### **3.3 MEDIUM-VOLTAGE EQUIPMENT AND CIRCUITS NOT USED.**

### **3.4 SECONDARY VOLTAGE EQUIPMENT AND CIRCUITS**

- A. Main Bonding Jumper: Bond the secondary service neutral to the ground bus in the service equipment.
- B. Metallic Piping, Building Structural Steel, and Supplemental Electrode(s):
  - 1. Provide a grounding electrode conductor sized per NEC between the service equipment ground bus and all metallic water pipe systems, building structural steel, and supplemental or made electrodes. Provide jumpers across insulating joints in the metallic piping.
  - 2. Provide a supplemental ground electrode as shown on the drawings and bond to the grounding electrode system.
- C. Switchgear, Switchboards, Unit Substations, Panelboards, Motor Control Centers, Engine-Generators, Automatic Transfer Switches, and other electrical equipment:
  - 1. Connect the equipment grounding conductors to the ground bus.
  - 2. Connect metallic conduits by grounding bushings and equipment grounding conductor to the equipment ground bus.
- D. Transformers:
  - 1. Exterior: Exterior transformers supplying interior service equipment shall have the neutral grounded at the transformer secondary. Provide a grounding electrode at the transformer.
  - 2. Separately derived systems (transformers downstream from service equipment): Ground the secondary neutral at the transformer. Provide a grounding electrode conductor from the transformer to the nearest component of the grounding electrode system .

### **3.5 RACEWAY**

- A. Conduit Systems:
  - 1. Ground all metallic conduit systems. All metallic conduit systems shall contain an equipment grounding conductor.
  - 2. Non-metallic conduit systems, except non-metallic feeder conduits that carry a grounded conductor from exterior transformers to

interior or building-mounted service entrance equipment, shall contain an equipment grounding conductor.

3. Metallic conduit that only contains a grounding conductor, and is provided for its mechanical protection, shall be bonded to that conductor at the entrance and exit from the conduit.
4. Metallic conduits which terminate without mechanical connection to an electrical equipment housing by means of locknut and bushings or adapters, shall be provided with grounding bushings. Connect bushings with an equipment grounding conductor to the equipment ground bus.

B. Feeders and Branch Circuits: Install equipment grounding conductors with all feeders, and power and lighting branch circuits.

C. Boxes, Cabinets, Enclosures, and Panelboards:

1. Bond the equipment grounding conductor to each pullbox, junction box, outlet box, device box, cabinets, and other enclosures through which the conductor passes (except for special grounding systems for intensive care units and other critical units shown).
2. Provide lugs in each box and enclosure for equipment grounding conductor termination.

D. Wireway Systems:

1. Bond the metallic structures of wireway to provide electrical continuity throughout the wireway system, by connecting a No. 6 AWG bonding jumper at all intermediate metallic enclosures and across all section junctions.
2. Install insulated No. 6 AWG bonding jumpers between the wireway system, bonded as required above, and the closest building ground at each end and approximately every 16 M (50 feet).
3. Use insulated No. 6 AWG bonding jumpers to ground or bond metallic wireway at each end for all intermediate metallic enclosures and across all section junctions.
4. Use insulated No. 6 AWG bonding jumpers to ground cable tray to column-mounted building ground plates (pads) at each end and approximately every 15 M (49 feet).

E. Receptacles shall not be grounded through their mounting screws. Ground receptacles with a jumper from the receptacle green ground terminal to the device box ground screw and a jumper to the branch circuit equipment grounding conductor.

- F. Ground lighting fixtures to the equipment grounding conductor of the wiring system. Fixtures connected with flexible conduit shall have a green ground wire included with the power wires from the fixture through the flexible conduit to the first outlet box.
- G. Fixed electrical appliances and equipment shall be provided with a ground lug for termination of the equipment grounding conductor.
- H. Not Used.
- I. Panelboard Bonding in Patient Care Areas: The equipment grounding terminal buses of the normal and essential branch circuit panel boards serving the same individual patient vicinity shall be bonded together with an insulated continuous copper conductor not less than No. 10 AWG, installed in rigid metal conduit.

### **3.6 OUTDOOR METALLIC FENCES AROUND ELECTRICAL EQUIPMENT NOT USED.**

### **3.7 CORROSION INHIBITORS**

- A. When making grounding and bonding connections, apply a corrosion inhibitor to all contact surfaces. Use corrosion inhibitor appropriate for protecting a connection between the metals used.

### **3.8 CONDUCTIVE PIPING**

- A. Bond all conductive piping systems, interior and exterior, to the grounding electrode system. Bonding connections shall be made as close as practical to the equipment ground bus.
- B. In operating rooms and at intensive care and coronary care type beds, bond the medical gas piping and medical vacuum piping at the outlets directly to the patient ground bus.

### **3.9 LIGHTNING PROTECTION SYSTEM**

- A. Bond the lightning protection system to the electrical grounding electrode system.

### **3.10 MAIN ELECTRICAL ROOM GROUNDING NOT USED.**

### **3.11 EXTERIOR LIGHT POLES**

- A. Provide 6.1 M (20 feet) of No. 4 AWG bare copper coiled at bottom of pole base excavation prior to pour, plus additional unsplined length in and above foundation as required to reach pole ground stud.

### **3.12 GROUND RESISTANCE**

- A. Grounding system resistance to ground shall not exceed 5 ohms. Make any modifications or additions to the grounding electrode system necessary for compliance without additional cost to the Government. Final tests shall ensure that this requirement is met.

- B. Grounding system resistance shall comply with the electric utility company ground resistance requirements.

### **3.13 GROUND ROD INSTALLATION**

- A. For outdoor installations, drive each rod vertically in the earth, until top of rod is 610 mm (24 inches) below final grade.
- B. For indoor installations, leave 100 mm (4 inches) of each rod exposed.
- C. Where buried or permanently concealed ground connections are required, make the connections by the exothermic process, to form solid metal joints. Make accessible ground connections with mechanical pressure-type ground connectors.
- D. Where rock or impenetrable soil prevents the driving of vertical ground rods, install angled ground rods or grounding electrodes in horizontal trenches to achieve the specified ground resistance.

### **3.14 ACCEPTANCE CHECKS AND TESTS**

- A. Resistance of the grounding electrode system shall be measured using a four-terminal fall-of-potential method as defined in IEEE 81. Ground resistance measurements shall be made before the electrical distribution system is energized or connected to the electric utility company ground system, and shall be made in normally dry conditions not fewer than 48 hours after the last rainfall.
- B. Resistance measurements of separate grounding electrode systems shall be made before the systems are bonded together. The combined resistance of separate systems may be used to meet the required resistance, but the specified number of electrodes must still be provided.
- C. Below-grade connections shall be visually inspected by the Project Manager prior to backfilling. The Contractor shall notify the Project Manager 24 hours before the connections are ready for inspection.

---END---

**SECTION 26 05 33**  
**RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section specifies the furnishing, installation, and connection of conduit, fittings, and boxes, to form complete, coordinated, grounded raceway systems. Raceways are required for all wiring unless shown or specified otherwise.
- B. Definitions: The term conduit, as used in this specification, shall mean any or all of the raceway types specified.

**1.2 RELATED WORK**

- A. Section 06 10 00, ROUGH CARPENTRY: Mounting board for telephone closets.
- B. Section 07 60 00, FLASHING AND SHEET METAL: Fabrications for the deflection of water away from the building envelope at penetrations.
- C. Section 07 84 00, FIRESTOPPING: Sealing around penetrations to maintain the integrity of fire rated construction.
- D. Section 07 92 00, JOINT SEALANTS: Sealing around conduit penetrations through the building envelope to prevent moisture migration into the building.
- E. Section 09 91 00, PAINTING: Identification and painting of conduit and other devices.
- F. Not Used.
- G. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: General electrical requirements and items that are common to more than one section of Division 26.
- H. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS: Requirements for personnel safety and to provide a low impedance path for possible ground fault currents.
- I. Not Used.
- J. Not Used.

**1.3 QUALITY ASSURANCE**

Refer to Paragraph, QUALIFICATIONS, in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

**1.4 SUBMITTALS**

- A. Submit six copies of the following in accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
  - 1. Shop Drawings:

- a. Size and location of main feeders.
  - b. Size and location of panels and pull-boxes.
  - c. Layout of required conduit penetrations through structural elements.
  - d. Submit the following data for approval:
    - 1) Raceway types and sizes.
    - 2) Conduit bodies, connectors and fittings.
    - 3) Junction and pull boxes, types and sizes.
2. Certifications: Two weeks prior to final inspection, submit the following:
- a. Certification by the manufacturer that raceways, conduits, conduit bodies, connectors, fittings, junction and pull boxes, and all related equipment conform to the requirements of the drawings and specifications.
  - b. Certification by the Contractor that raceways, conduits, conduit bodies, connectors, fittings, junction and pull boxes, and all related equipment have been properly installed.

#### **1.5 APPLICABLE PUBLICATIONS**

- A. Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by designation only.
- B. American National Standards Institute (ANSI):
  - C80.1-05.....Electrical Rigid Steel Conduit
  - C80.3-05.....Steel Electrical Metal Tubing
  - C80.6-05.....Electrical Intermediate Metal Conduit
- C. National Fire Protection Association (NFPA):
  - 70-11.....National Electrical Code (NEC)
- D. Underwriters Laboratories, Inc. (UL):
  - 1-05.....Flexible Metal Conduit
  - 5-11.....Surface Metal Raceway and Fittings
  - 6-07.....Electrical Rigid Metal Conduit - Steel
  - 50-95.....Enclosures for Electrical Equipment
  - 360-13.....Liquid-Tight Flexible Steel Conduit
  - 467-13.....Grounding and Bonding Equipment
  - 514A-13.....Metallic Outlet Boxes
  - 514B-12.....Conduit, Tubing, and Cable Fittings



- 514C-07.....Nonmetallic Outlet Boxes, Flush-Device Boxes  
and Covers
- 651-11.....Schedule 40 and 80 Rigid PVC Conduit and  
Fittings
- 651A-11.....Type EB and A Rigid PVC Conduit and HDPE  
Conduit
- 797-07.....Electrical Metallic Tubing
- 1242-06.....Electrical Intermediate Metal Conduit - Steel
- E. National Electrical Manufacturers Association (NEMA):
- TC-2-13.....Electrical Polyvinyl Chloride (PVC) Tubing and  
Conduit
- TC-3-13.....PVC Fittings for Use with Rigid PVC Conduit and  
Tubing
- FB1-12.....Fittings, Cast Metal Boxes and Conduit Bodies  
for Conduit, Electrical Metallic Tubing and  
Cable
- FB2.10-13.....Selection and Installation Guidelines for  
Fittings for use with Non-Flexible Conduit or  
Tubing (Rigid Metal Conduit, Intermediate  
Metallic Conduit, and Electrical Metallic  
Tubing)
- FB2.20-12.....Selection and Installation Guidelines for  
Fittings for use with Flexible Electrical  
Conduit and Cable
- F. American Iron and Steel Institute (AISI):
- S100-2007.....North American Specification for the Design of  
Cold-Formed Steel Structural Members

## **PART 2 - PRODUCTS**

### **2.1 MATERIAL**

- A. Conduit Size: In accordance with the NEC, but not less than 19 mm (0.75-inch) unless otherwise shown. Where permitted by the NEC, 19 mm (0.75-inch) flexible conduit may be used for tap connections to recessed lighting fixtures.
- B. Conduit:
1. Size: In accordance with the NEC, but not less than 19 mm (0.75-inch).
  2. Rigid Steel Conduit (RMC): Shall conform to UL 6 and ANSI C80.1.
  3. Not Used.

4. Rigid Intermediate Steel Conduit (IMC): Shall conform to UL 1242 and ANSI C80.6.
5. Electrical Metallic Tubing (EMT): Shall conform to UL 797 and ANSI C80.3. Maximum size not to exceed 105 mm (4 inches) and shall be permitted only with cable rated 600 V or less.
6. Flexible Metal Conduit: Shall conform to UL 1.
7. Liquid-tight Flexible Metal Conduit: Shall conform to UL 360.
8. Direct Burial Plastic Conduit: Shall conform to UL 651 and UL 651A, heavy wall PVC or high density polyethylene (PE).
9. Surface Metal Raceway: Shall conform to UL 5.

C. Conduit Fittings:

1. Rigid Steel and Intermediate Metallic Conduit Fittings:
  - a. Fittings shall meet the requirements of UL 514B and NEMA FB1.
  - b. Standard threaded couplings, locknuts, bushings, conduit bodies, and elbows: Only steel or malleable iron materials are acceptable. Integral retractable type IMC couplings are also acceptable.
  - c. Locknuts: Bonding type with sharp edges for digging into the metal wall of an enclosure.
  - d. Bushings: Metallic insulating type, consisting of an insulating insert, molded or locked into the metallic body of the fitting. Bushings made entirely of metal or nonmetallic material are not permitted.
  - e. Erickson (Union-Type) and Set Screw Type Couplings: Approved for use in concrete are permitted for use to complete a conduit run where conduit is installed in concrete. Use set screws of case-hardened steel with hex head and cup point to firmly seat in conduit wall for positive ground. Tightening of set screws with pliers is prohibited.
  - f. Sealing Fittings: Threaded cast iron type. Use continuous drain-type sealing fittings to prevent passage of water vapor. In concealed work, install fittings in flush steel boxes with blank cover plates having the same finishes as that of other electrical plates in the room.
2. Not Used.
3. Electrical Metallic Tubing Fittings:
  - a. Fittings and conduit bodies shall meet the requirements of UL 514B, ANSI C80.3, and NEMA FB1.

- b. Only steel or malleable iron materials are acceptable.
  - c. Compression Couplings and Connectors: Concrete-tight and rain-tight, with connectors having insulated throats.
  - d. Indent-type connectors or couplings are prohibited.
  - e. Die-cast or pressure-cast zinc-alloy fittings or fittings made of "pot metal" are prohibited.
4. Flexible Metal Conduit Fittings:
- a. Conform to UL 514B. Only steel or malleable iron materials are acceptable.
  - b. Clamp-type, with insulated throat.
5. Liquid-tight Flexible Metal Conduit Fittings:
- a. Fittings shall meet the requirements of UL 514B and NEMA FB1.
  - b. Only steel or malleable iron materials are acceptable.
  - c. Fittings must incorporate a threaded grounding cone, a steel or plastic compression ring, and a gland for tightening. Connectors shall have insulated throats.
6. Direct Burial Plastic Conduit Fittings: Fittings shall meet the requirements of UL 514C and NEMA TC3.
7. Surface Metal Raceway Fittings: As recommended by the raceway manufacturer. Include couplings, offsets, elbows, expansion joints, adapters, hold-down straps, end caps, conduit entry fittings, accessories, and other fittings as required for complete system.
8. Expansion and Deflection Couplings:
- a. Conform to UL 467 and UL 514B.
  - b. Accommodate a 19 mm (0.75-inch) deflection, expansion, or contraction in any direction, and allow 30 degree angular deflections.
  - c. Include internal flexible metal braid, sized to guarantee conduit ground continuity and a low-impedance path for fault currents, in accordance with UL 467 and the NEC tables for equipment grounding conductors.
  - d. Jacket: Flexible, corrosion-resistant, watertight, moisture and heat-resistant molded rubber material with stainless steel jacket clamps.
- D. Conduit Supports:
- 1. Parts and Hardware: Zinc-coat or provide equivalent corrosion protection.

2. Individual Conduit Hangers: Designed for the purpose, having a pre-assembled closure bolt and nut, and provisions for receiving a hanger rod.
  3. Multiple Conduit (Trapeze) Hangers: Not less than 38 mm x 38 mm (1.5 x 1.5 inches), 12-gauge steel, cold-formed, lipped channels; with not less than 9 mm (0.375-inch) diameter steel hanger rods.
  4. Solid Masonry and Concrete Anchors: Self-drilling expansion shields, or machine bolt expansion.
- E. Outlet, Junction, and Pull Boxes:
1. UL-50 and UL-514A.
  2. Rustproof cast metal where required by the NEC or shown on drawings.
  3. Sheet Metal Boxes: Galvanized steel, except where shown on drawings.
- F. Metal Wireways: Equip with hinged covers, except as shown on drawings. Include couplings, offsets, elbows, expansion joints, adapters, hold-down straps, end caps, and other fittings to match and mate with wireways as required for a complete system.

### **PART 3 - EXECUTION**

#### **3.1 PENETRATIONS**

- A. Cutting or Holes:
1. Cut holes in advance where they should be placed in the structural elements, such as ribs or beams. Obtain the approval of the COR prior to drilling through structural elements.
  2. Cut holes through concrete and masonry in new and existing structures with a diamond core drill or concrete saw. Pneumatic hammers, impact electric, hand, or manual hammer-type drills are not allowed, except when permitted by the COR where working space is limited.
- B. Firestop: Where conduits, wireways, and other electrical raceways pass through fire partitions, fire walls, smoke partitions, or floors, install a fire stop that provides an effective barrier against the spread of fire, smoke and gases as specified in Section 07 84 00, FIRESTOPPING.
- C. Waterproofing: At floor, exterior wall, and roof conduit penetrations, completely seal the gap around conduit to render it watertight, as specified in Section 07 92 00, JOINT SEALANTS.

### 3.2 INSTALLATION, GENERAL

- A. In accordance with UL, NEC, NEMA, as shown on drawings, and as specified herein.
- B. Raceway systems used for Essential Electrical Systems (EES) shall be entirely independent of other raceway systems.
- C. Install conduit as follows:
  - 1. In complete mechanically and electrically continuous runs before pulling in cables or wires.
  - 2. Unless otherwise indicated on the drawings or specified herein, installation of all conduits shall be concealed within finished walls, floors, and ceilings.
  - 3. Flattened, dented, or deformed conduit is not permitted. Remove and replace the damaged conduits with new conduits.
  - 4. Assure conduit installation does not encroach into the ceiling height head room, walkways, or doorways.
  - 5. Cut conduits square, ream, remove burrs, and draw up tight.
  - 6. Independently support conduit at 2.4 M (8 feet) on centers with specified materials and as shown on drawings.
  - 7. Do not use suspended ceilings, suspended ceiling supporting members, lighting fixtures, other conduits, cable tray, boxes, piping, or ducts to support conduits and conduit runs.
  - 8. Support within 300 mm (12 inches) of changes of direction, and within 300 mm (12 inches) of each enclosure to which connected.
  - 9. Close ends of empty conduits with plugs or caps at the rough-in stage until wires are pulled in, to prevent entry of debris.
  - 10. Conduit installations under fume and vent hoods are prohibited.
  - 11. Secure conduits to cabinets, junction boxes, pull-boxes, and outlet boxes with bonding type locknuts. For rigid steel and IMC conduit installations, provide a locknut on the inside of the enclosure, made up wrench tight. Do not make conduit connections to junction box covers.
  - 12. Flashing of penetrations of the roof membrane is specified in Section 07 60 00, FLASHING AND SHEET METAL.
  - 13. Conduit bodies shall only be used for changes in direction, and shall not contain splices.
  - 14. Not Used.
- D. Conduit Bends:
  - 1. Make bends with standard conduit bending machines.

2. Conduit hickey may be used for slight offsets and for straightening stubbed out conduits.
3. Bending of conduits with a pipe tee or vise is prohibited.

E. Layout and Homeruns:

1. Install conduit with wiring, including homeruns, as shown on drawings.
2. Deviations: Make only where necessary to avoid interferences and only after drawings showing the proposed deviations have been submitted and approved by the COR.

### 3.3 CONCEALED WORK INSTALLATION

A. In Concrete:

1. Conduit: Rigid steel, IMC, or EMT. Do not install EMT in concrete slabs that are in contact with soil, gravel, or vapor barriers.
2. Align and run conduit in direct lines.
3. Install conduit through concrete beams only:
  - a. Where shown on the structural drawings.
  - b. As approved by the COR prior to construction, and after submittal of drawing showing location, size, and position of each penetration.
4. Installation of conduit in concrete that is less than 75 mm (3 inches) thick is prohibited.
  - a. Conduit outside diameter larger than one-third of the slab thickness is prohibited.
  - b. Space between conduits in slabs: Approximately six conduit diameters apart, and one conduit diameter at conduit crossings.
  - c. Install conduits approximately in the center of the slab so that there will be a minimum of 19 mm (0.75-inch) of concrete around the conduits.
5. Make couplings and connections watertight. Use thread compounds that are UL approved conductive type to ensure low resistance ground continuity through the conduits. Tightening setscrews with pliers is prohibited.

B. Above Furred or Suspended Ceilings and in Walls:

1. Conduit for Conductors Above 600 V: Rigid steel. Mixing different types of conduits in the same system is prohibited.
2. Conduit for Conductors 600 V and Below: Rigid steel, IMC, /or EMT. Mixing different types of conduits in the same system is prohibited.

3. Align and run conduit parallel or perpendicular to the building lines.
4. Connect recessed lighting fixtures to conduit runs with maximum 1.8 M (6 feet) of flexible metal conduit extending from a junction box to the fixture.
5. Tightening set screws with pliers is prohibited.
6. For conduits running through metal studs, limit field cut holes to no more than 70% of web depth. Spacing between holes shall be at least 457 mm (18 inches). Cuts or notches in flanges or return lips shall not be permitted.

#### **3.4 EXPOSED WORK INSTALLATION**

- A. Unless otherwise indicated on drawings, exposed conduit is only permitted in mechanical and electrical rooms.
- B. Conduit for Conductors Above 600 V: Rigid steel. Mixing different types of conduits in the system is prohibited.
- C. Conduit for Conductors 600 V and Below: Rigid steel, IMC, or EMT. Mixing different types of conduits in the system is prohibited.
- D. Align and run conduit parallel or perpendicular to the building lines.
- E. Install horizontal runs close to the ceiling or beams and secure with conduit straps.
- F. Support horizontal or vertical runs at not over 2.4 M (8 feet) intervals.
- G. Surface Metal Raceways: Use only where shown on drawings.
- H. Painting:
  1. Paint exposed conduit as specified in Section 09 91 00, PAINTING.
  2. Paint all conduits containing cables rated over 600 V safety orange. Refer to Section 09 91 00, PAINTING for preparation, paint type, and exact color. In addition, paint legends, using 50 mm (2 inch) high black numerals and letters, showing the cable voltage rating. Provide legends where conduits pass through walls and floors and at maximum 6 M (20 feet) intervals in between.

#### **3.5 DIRECT BURIAL INSTALLATION NOT USED.**

#### **3.6 HAZARDOUS LOCATIONS**

- A. Use rigid steel conduit only.
- B. Install UL approved sealing fittings that prevent passage of explosive vapors in hazardous areas equipped with explosion-proof lighting fixtures, switches, and receptacles, as required by the NEC.

**3.7 WET OR DAMP LOCATIONS**

- A. Use rigid steel or IMC conduits unless as shown on drawings.
- B. Provide sealing fittings to prevent passage of water vapor where conduits pass from warm to cold locations, i.e., refrigerated spaces, constant-temperature rooms, air-conditioned spaces, building exterior walls, roofs, or similar spaces.
- C. Use rigid steel or IMC conduit within 1.5 M (5 feet) of the exterior and below concrete building slabs in contact with soil, gravel, or vapor barriers, unless as shown on drawings. Conduit shall be half-lapped with 10 mil PVC tape before installation. After installation, completely recoat or retape any damaged areas of coating.
- D. Conduits run on roof shall be supported with integral galvanized lipped steel channel, attached to UV-inhibited polycarbonate or polypropylene blocks every 2.4 M (8 feet) with 9 mm (3/8-inch) galvanized threaded rods, square washer and locknut. Conduits shall be attached to steel channel with conduit clamps.

**3.8 MOTORS AND VIBRATING EQUIPMENT**

- A. Use flexible metal conduit for connections to motors and other electrical equipment subject to movement, vibration, misalignment, cramped quarters, or noise transmission.
- B. Use liquid-tight flexible metal conduit for installation in exterior locations, moisture or humidity laden atmosphere, corrosive atmosphere, water or spray wash-down operations, inside airstream of HVAC units, and locations subject to seepage or dripping of oil, grease, or water.
- C. Provide a green equipment grounding conductor with flexible and liquid-tight flexible metal conduit.

**3.9 EXPANSION JOINTS**

- A. Conduits 75 mm (3 inch) and larger that are secured to the building structure on opposite sides of a building expansion joint require expansion and deflection couplings. Install the couplings in accordance with the manufacturer's recommendations.
- B. Provide conduits smaller than 75 mm (3 inch) with junction boxes on both sides of the expansion joint. Connect flexible metal conduits to junction boxes with sufficient slack to produce a 125 mm (5 inch) vertical drop midway between the ends of the flexible metal conduit. Flexible metal conduit shall have a green insulated copper bonding jumper installed. In lieu of this flexible metal conduit, expansion and deflection couplings as specified above are acceptable.



- C. Install expansion and deflection couplings where shown.
- D. Not Used.

### 3.10 CONDUIT SUPPORTS

- A. Safe working load shall not exceed one-quarter of proof test load of fastening devices.
- B. Use pipe straps or individual conduit hangers for supporting individual conduits.
- C. Support multiple conduit runs with trapeze hangers. Use trapeze hangers that are designed to support a load equal to or greater than the sum of the weights of the conduits, wires, hanger itself, and an additional 90 kg (200 lbs). Attach each conduit with U-bolts or other approved fasteners.
- D. Support conduit independently of junction boxes, pull-boxes, fixtures, suspended ceiling T-bars, angle supports, and similar items.
- E. Fasteners and Supports in Solid Masonry and Concrete:
  - 1. New Construction: Use steel or malleable iron concrete inserts set in place prior to placing the concrete.
  - 2. Existing Construction:
    - a. Steel expansion anchors not less than 6 mm (0.25-inch) bolt size and not less than 28 mm (1.125 inch) in embedment.
    - b. Power set fasteners not less than 6 mm (0.25-inch) diameter with depth of penetration not less than 75 mm (3 inch).
    - c. Use vibration and shock-resistant anchors and fasteners for attaching to concrete ceilings.
- F. Hollow Masonry: Toggle bolts.
- G. Bolts supported only by plaster or gypsum wallboard are not acceptable.
- H. Metal Structures: Use machine screw fasteners or other devices specifically designed and approved for the application.
- I. Attachment by wood plugs, rawl plug, plastic, lead or soft metal anchors, or wood blocking and bolts supported only by plaster is prohibited.
- J. Chain, wire, or perforated strap shall not be used to support or fasten conduit.
- K. Spring steel type supports or fasteners are prohibited for all uses except horizontal and vertical supports/fasteners within walls.
- L. Vertical Supports: Vertical conduit runs shall have riser clamps and supports in accordance with the NEC and as shown. Provide supports for

cable and wire with fittings that include internal wedges and retaining collars.

### 3.11 BOX INSTALLATION

- A. Boxes for Concealed Conduits:
  - 1. Flush-mounted.
  - 2. Provide raised covers for boxes to suit the wall or ceiling, construction, and finish.
- B. In addition to boxes shown, install additional boxes where needed to prevent damage to cables and wires during pulling-in operations or where more than the equivalent of 4-90 degree bends are necessary.
- C. Locate pullboxes so that covers are accessible and easily removed. Coordinate locations with piping and ductwork where installed above ceilings.
- D. Remove only knockouts as required. Plug unused openings. Use threaded plugs for cast metal boxes and snap-in metal covers for sheet metal boxes.
- E. Outlet boxes mounted back-to-back in the same wall are prohibited. A minimum 600 mm (24 inch) center-to-center lateral spacing shall be maintained between boxes.
- F. Flush-mounted wall or ceiling boxes shall be installed with raised covers so that the front face of raised cover is flush with the wall. Surface-mounted wall or ceiling boxes shall be installed with surface-style flat or raised covers.
- G. Minimum size of outlet boxes for ground fault circuit interrupter (GFCI) receptacles is 100 mm (4 inches) square x 55 mm (2.125 inches) deep, with device covers for the wall material and thickness involved.
- H. Stencil or install phenolic nameplates on covers of the boxes identified on riser diagrams; for example "SIG-FA JB No. 1."
- I. On all branch circuit junction box covers, identify the circuits with black marker.

- - - E N D - - -

**SECTION 26 09 23  
LIGHTING CONTROLS**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

This section specifies the furnishing, installation and connection of the lighting controls.

**1.2 RELATED WORK**

- A. Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC: Interface of lighting controls with HVAC control systems.
- B. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: General requirements that are common to more than one section of Division 26.
- C. Section 26 05 19, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES (600 VOLTS AND BELOW): Cables and wiring.
- D. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS: Requirements for personnel safety and to provide a low impedance path to ground for possible ground fault currents.
- E. Section 26 24 16, PANELBOARDS: Panelboard enclosure and interior bussing used for lighting control panels.
- F. Section 26 27 26, WIRING DEVICES: Wiring devices used for control of the lighting systems.
- G. Section 26 51 00, INTERIOR LIGHTING: Luminaire ballast and drivers used in control of lighting systems.

**1.3 QUALITY ASSURANCE**

- A. Refer to Paragraph, QUALIFICATIONS (PRODUCTS AND SERVICES), in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

**1.4 SUBMITTALS**

- A. Submit six copies of the following in accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

1. Shop Drawings:

- a. Submit the following information for each type of lighting controls.
- b. Material and construction details.
- c. Physical dimensions and description.
- d. Wiring schematic and connection diagram.
- e. Installation details.

2. Manuals:

- a. Submit, simultaneously with the shop drawings, complete maintenance and operating manuals, including technical data

sheets, wiring diagrams, and information for ordering replacement parts.

- b. If changes have been made to the maintenance and operating manuals originally submitted, submit updated maintenance and operating manuals two weeks prior to the final inspection.
- 3. Certifications: Two weeks prior to final inspection, submit the following.
  - a. Certification by the Contractor that the lighting control systems have been properly installed and tested.

#### **1.5 APPLICABLE PUBLICATIONS**

- A. Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by designation only.
- B. Green Seal (GS):
  - GC-12-03.....Occupancy Sensors
- C. National Electrical Manufacturer's Association (NEMA):
  - C136.10-10.....American National Standard for Roadway and Area Lighting Equipment—Locking-Type Photocontrol Devices and Mating Receptacles—Physical and Electrical Interchangeability and Testing
  - ICS-1-08.....Standard for Industrial Control and Systems General Requirements
  - ICS-2-05.....Standard for Industrial Control and Systems: Controllers, Contractors, and Overload Relays Rated Not More than 2000 Volts AC or 750 Volts DC: Part 8 - Disconnect Devices for Use in Industrial Control Equipment
  - ICS-6-11.....Standard for Industrial Controls and Systems Enclosures
- D. National Fire Protection Association (NFPA):
  - 70-14.....National Electrical Code (NEC)
- E. Underwriters Laboratories, Inc. (UL):
  - 20.....Standard for General-Use Snap Switches
  - 773-95.....Standard for Plug-In Locking Type Photocontrols for Use with Area Lighting
  - 773A-06.....Nonindustrial Photoelectric Switches for Lighting Control

- 98-04.....Enclosed and Dead-Front Switches
- 916-07.....Standard for Energy Management Equipment  
Systems
- 917-06.....Clock Operated Switches
- 924-06.....Emergency Lighting and Power Equipment (for use  
when controlling emergency circuits).

## **PART 2 - PRODUCTS**

### **2.1 ELECTRONIC TIME SWITCHES**

- A. Electronic, solid-state programmable units with alphanumeric display; complying with UL 916 and or 917.
  - 1. Contact Configuration: SPST.
  - 2. Contact Rating: 20-A ballast load, 120-277 volt.
  - 3. Astronomical Clock: Capable of switching a load on at sunset and off at sunrise, and automatically changing the settings each day in accordance with seasonal changes of sunset and sunrise. Additionally, it shall be programmable to a fixed on/off weekly schedule.
  - 4. Power Backup: Battery or capacitor for schedules and time clock.

### **2.2 ELECTROMECHANICAL-DIAL TIME SWITCHES NOT USED.**

### **2.3 OUTDOOR PHOTOELECTRIC SWITCHES**

- A. Solid state, with SPST dry contacts rated for 1800 VA tungsten or 1000 VA inductive, complying with UL 773A.
  - 1. Light-Level Monitoring Range: 16.14 to 108 lx (1.5 to 10 fc), with adjustable turn-on and turn-off levels.
  - 2. Time Delay: 15-second minimum.
  - 3. Surge Protection: Metal-oxide varistor.
  - 4. Mounting: Twist lock, with base-and-stem mounting or stem-and-swivel mounting accessories as required.

### **2.4 TIMER SWITCHES**

- A. Digital switches with backlit LCD display, 120/277 volt rated, fitting as a replacement for standard wall switches.
  - 1. Compatibility: Compatible with all ballasts.
  - 2. Warning: Audible warning to sound during the last minute of "on" operation.
  - 3. Time-out: Adjustable from 5 minutes to 12 hours.
  - 4. Faceplate: Refer to wall plate material and color requirements for toggle switches, as specified in Section 26 27 26, WIRING DEVICES.

## 2.5 CEILING-MOUNTED PHOTOELECTRIC SWITCHES

- A. Solid-state, light-level sensor unit, with separate relay unit.
  - 1. Sensor Output: Contacts rated to operate the associated relay.  
Sensor shall be powered from the relay unit.
  - 2. Relay Unit: Dry contacts rated for 20A ballast load at 120 volt and 277 volt, for 13A tungsten at 120 volt, and for 1 hp at 120 volt.
  - 3. Monitoring Range: 108 to 2152 lx (10 to 200 fc), with an adjustment for turn-on and turn-off levels.
  - 4. Time Delay: Adjustable from 5 to 300 seconds, with deadband adjustment.
  - 5. Indicator: Two LEDs to indicate the beginning of on-off cycles.

## 2.6 SKYLIGHT PHOTOELECTRIC SENSORS NOT USED.

## 2.7 INDOOR OCCUPANCY SENSORS

- A. Wall- or ceiling-mounting, solid-state units with a power supply and relay unit, suitable for the environmental conditions in which installed.
  - 1. Operation: Unless otherwise indicated, turn lights on when covered area is occupied and off when unoccupied; with a 1 to 15 minute adjustable time delay for turning lights off.
  - 2. Sensor Output: Contacts rated to operate the connected relay.  
Sensor shall be powered from the relay unit.
  - 3. Relay Unit: Dry contacts rated for 20A ballast load at 120 volt and 277 volt, for 13A tungsten at 120 volt, and for 1 hp at 120 volt.
  - 4. Mounting:
    - a. Sensor: Suitable for mounting in any position on a standard outlet box.
    - b. Time-Delay and Sensitivity Adjustments: Recessed and concealed behind hinged door.
  - 5. Indicator: LED, to show when motion is being detected during testing and normal operation of the sensor.
  - 6. Bypass Switch: Override the on function in case of sensor failure.
  - 7. Manual/automatic selector switch.
  - 8. Automatic Light-Level Sensor: Adjustable from 21.5 to 2152 lx (2 to 200 fc); keep lighting off when selected lighting level is present.
  - 9. Faceplate for Wall-Switch Replacement Type: Refer to wall plate material and color requirements for toggle switches, as specified in Section 26 27 26, WIRING DEVICES.

B. Dual-technology Type: Ceiling mounting; combination PIR and ultrasonic detection methods, field-selectable.

1. Sensitivity Adjustment: Separate for each sensing technology.

2. Detector Sensitivity: Detect occurrences of 150 mm (6-inch) minimum movement of any portion of a human body that presents a target of not less than 232 sq. cm (36 sq. in), and detect a person of average size and weight moving not less than 305 mm (12 inches) in either a horizontal or a vertical manner at an approximate speed of 305 mm/s (12 inches/s).

C. Detection Coverage: Shall be sufficient to provide coverage as required by sensor locations shown on drawing.

## **2.8 INDOOR VACANCY SENSOR SWITCH**

A. Wall mounting, solid-state units with integral sensor and switch.

1. Operation: Manually turn lights on with switch and sensor detects vacancy to turn lights off.

2. Switch Rating: 120/277 volt, 1200 watts at 277 volt, 800 watts at 120 volt unit.

3. Mounting:

a. Sensor: Suitable for mounting in a standard switch box.

b. Time-Delay and Sensitivity Adjustments: Integral with switch and accessible for reprogramming without removing switch.

4. Indicator: LED, to show when motion is being detected during testing and normal operation of the sensor.

5. Switch: Manual operation to turn lights on and override lights off.

6. Faceplate: Refer to wall plate material and color requirements for toggle switches, as specified in Section 26 27 26, WIRING DEVICES.

## **2.9 OUTDOOR MOTION SENSOR (PIR) NOT USED.**

## **2.10 LIGHTING CONTROL SYSTEM - RELAY PANEL TYPE (NETWORK) NOT USED.**

## **2.11 LIGHTING CONTROL SYSTEM - RELAY PANEL TYPE (STAND ALONE) NOT USED.**

## **2.12 LIGHTING CONTROL SYSTEM - DISTRIBUTIVE RELAY TYPE NOT USED.**

## **2.13 LIGHTING CONTROL SYSTEM - CIRCUIT BREAKER PANEL TYPE NOT USED.**

## **2.14 LIGHTING CONTROL SYSTEM - DIGITAL ADDRESSABLE LIGHTING INTERFACE (DALI) NOT USED.**

# **PART 3 - EXECUTION**

## **3.1 INSTALLATION**

A. Installation shall be in accordance with the NEC, manufacturer's instructions and as shown on the drawings or specified.

- B. Aim outdoor photoelectric sensor according to manufacturer's recommendations. Set adjustable window slide for 1 footcandle turn-on.
- C. Aiming for wall-mounted and ceiling-mounted motion sensor switches shall be per manufacturer's recommendations.
- D. Set occupancy sensor "on" duration to 5 minutes.
- E. Locate photoelectric sensors as indicated and in accordance with the manufacturer's recommendations. Adjust sensor for the available light level at the typical work plane for that area.
- F. Label time switches and contactors with a unique designation.
- G. Program lighting control panels per schedule on drawings.

### **3.2 ACCEPTANCE CHECKS AND TESTS**

- A. Perform in accordance with the manufacturer's recommendations.
- B. Upon completion of installation, conduct an operating test to show that equipment operates in accordance with requirements of this section.
- C. Test for full range of dimming ballast and dimming controls capability. Observe for visually detectable flicker over full dimming range.
- D. Test occupancy sensors for proper operation. Observe for light control over entire area being covered.

### **3.3 FOLLOW-UP VERIFICATION**

Upon completion of acceptance checks and tests, the Contractor shall show by demonstration in service that the lighting control devices are in good operating condition and properly performing the intended function in the presence of or COR.

- - - E N D - - -



**SECTION 26 24 16**  
**PANELBOARDS**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section specifies the furnishing, installation, and connection of panelboards.

**1.2 RELATED WORK**

- A. Section 09 91 00, PAINTING: Painting of panelboards.
- B. Not Used.
- C. Not Used.
- D. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS:  
Requirements that apply to all sections of Division 26.
- E. Section 26 05 19, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES:  
Low-voltage conductors.
- F. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS:  
Requirements for personnel safety and to provide a low impedance path for possible ground fault currents.
- G. Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS: Conduits.
- H. Not Used.
- I. Section 26 09 23, LIGHTING CONTROLS: Lighting controls integral to panelboards.
- J. Section 26 43 13, SURGE PROTECTIVE DEVICES: Surge protective devices integral to panelboards.

**1.3 QUALITY ASSURANCE**

- A. Refer to Paragraph, QUALIFICATIONS (PRODUCTS AND SERVICES), in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

**1.4 SUBMITTALS**

- A. Submit six copies of the following in accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
1. Shop Drawings:
    - a. Submit sufficient information to demonstrate compliance with drawings and specifications.
    - b. Include electrical ratings, dimensions, mounting details, materials, required clearances, terminations, weight, circuit breakers, wiring and connection diagrams, accessories, and nameplate data.
  2. Manuals:

- a. Submit, simultaneously with the shop drawings, complete maintenance and operating manuals including technical data sheets, wiring diagrams, and information for ordering circuit breakers and replacement parts.
  - 1) Include schematic diagrams, with all terminals identified, matching terminal identification in the panelboards.
  - 2) Include information for testing, repair, troubleshooting, assembly, and disassembly.
- b. If changes have been made to the maintenance and operating manuals originally submitted, submit updated maintenance and operating manuals two weeks prior to the final inspection.
- 3. Certifications: Two weeks prior to final inspection, submit the following.
  - a. Certification by the manufacturer that the panelboards conform to the requirements of the drawings and specifications.
  - b. Certification by the Contractor that the panelboards have been properly installed, adjusted, and tested.

#### **1.5 APPLICABLE PUBLICATIONS**

- A. Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by designation only.
- B. International Code Council (ICC):
  - IBC-12.....International Building Code
- C. National Electrical Manufacturers Association (NEMA):
  - PB 1-11.....Panelboards
  - 250-08.....Enclosures for Electrical Equipment (1,000V Maximum)
- D. National Fire Protection Association (NFPA):
  - 70-11.....National Electrical Code (NEC)
  - 70E-12.....Standard for Electrical Safety in the Workplace
- E. Underwriters Laboratories, Inc. (UL):
  - 50-95.....Enclosures for Electrical Equipment
  - 67-09.....Panelboards
  - 489-09.....Molded Case Circuit Breakers and Circuit Breaker Enclosures

**PART 2 - PRODUCTS****2.1 GENERAL REQUIREMENTS**

- A. Panelboards shall be in accordance with NEC, NEMA, UL, as specified, and as shown on the drawings.
- B. Panelboards shall have main breaker or main lugs, bus size, voltage, phases, number of circuit breaker mounting spaces, top or bottom feed, flush or surface mounting, branch circuit breakers, and accessories as shown on the drawings.
- C. Panelboards shall be completely factory-assembled with molded case circuit breakers and integral accessories as shown on the drawings or specified herein.
- D. Non-reduced size copper bus bars, rigidly supported on molded insulators, and fabricated for bolt-on type circuit breakers.
- E. Bus bar connections to the branch circuit breakers shall be the "distributed phase" or "phase sequence" type.
- F. Mechanical lugs furnished with panelboards shall be cast, stamped, or machined metal alloys listed for use with the conductors to which they will be connected.
- G. Neutral bus shall be 100% rated, mounted on insulated supports.
- H. Grounding bus bar shall be equipped with screws or lugs for the connection of equipment grounding conductors.
- I. Bus bars shall be braced for the available short-circuit current as shown on the drawings, but not be less than 10,000 A symmetrical for 120/208 V panelboards, and 14,000 A symmetrical for 277/480 V panelboards.
- J. In two-section panelboards, the main bus in each section shall be full size. The first section shall be furnished with subfeed lugs on the line side of main lugs only, or through-feed lugs for main breaker type panelboards, and have field-installed cable connections to the second section as shown on the drawings. Panelboard sections with tapped bus or crossover bus are not acceptable.
- K. Series-rated panelboards are not permitted.

**2.2 ENCLOSURES AND TRIMS**

- A. Enclosures:
  - 1. Provide galvanized steel enclosures, with NEMA rating as shown on the drawings or as required for the environmental conditions in which installed.
  - 2. Enclosures shall not have ventilating openings.

3. Enclosures may be of one-piece formed steel or of formed sheet steel with end and side panels welded, riveted, or bolted as required.
4. Provide manufacturer's standard option for prepunched knockouts on top and bottom endwalls.
5. Include removable inner dead front cover, independent of the panelboard cover.

B. Trims:

1. Hinged "door-in-door" type.
2. Interior hinged door with hand-operated latch or latches, as required to provide access only to circuit breaker operating handles, not to energized parts.
3. Outer hinged door shall be securely mounted to the panelboard enclosure with factory bolts, screws, clips, or other fasteners, requiring a key or tool for entry. Hand-operated latches are not acceptable.
4. Inner and outer doors shall open left to right.
5. Trims shall be flush or surface type as shown on the drawings.

### **2.3 MOLDED CASE CIRCUIT BREAKERS**

- A. Circuit breakers shall be per UL, NEC, as shown on the drawings, and as specified.
- B. Circuit breakers shall be bolt-on type and flag trip window style.
- C. Circuit breakers shall have minimum interrupting rating as required to withstand the available fault current, but not less than:
  1. 120/208 V Panelboard: 10,000 A symmetrical.
  2. 277/480 V Panelboard: 14,000 A symmetrical.
- D. Circuit breakers shall have automatic, trip free, non-adjustable, inverse time, and instantaneous magnetic trips for less than 400 A frame. Circuit breakers with 400 A frames and above shall have magnetic trip, adjustable from 5x to 10x. Breaker magnetic trip setting shall be set to maximum, unless otherwise noted.
- E. Circuit breaker features shall be as follows:
  1. A rugged, integral housing of molded insulating material.
  2. Silver alloy contacts.
  3. Arc quenchers and phase barriers for each pole.
  4. Quick-make, quick-break, operating mechanisms.
  5. A trip element for each pole, thermal magnetic type with long time delay and instantaneous characteristics, a common trip bar for all poles and a single operator.

6. Electrically and mechanically trip free.
7. An operating handle which indicates closed, tripped, and open positions. The handle shall be provided with a trip indicator window displaying a red tab to indicate a tripped condition "Flag trip window style".
8. An overload on one pole of a multi-pole breaker shall automatically cause all the poles of the breaker to open.
9. Ground fault current interrupting breakers, shunt trip breakers, lighting control breakers (including accessories to switch line currents), or other accessory devices or functions shall be provided where shown on the drawings.
10. For circuit breakers being added to existing panelboards, coordinate the breaker type with existing panelboards. Modify the panel directory accordingly.

#### **2.4 SURGE PROTECTIVE DEVICES**

- A. Where shown on the drawings, furnish panelboards with integral surge protective devices. Refer to Section 26 43 13, SURGE PROTECTIVE DEVICES.

### **PART 3 - EXECUTION**

#### **3.1 INSTALLATION**

- A. Installation shall be in accordance with the manufacturer's instructions, the NEC, as shown on the drawings, and as specified.
- B. Locate panelboards so that the present and future conduits can be conveniently connected.
- C. Not Used.
- D. Install a printed schedule of circuits in each panelboard after approval by the COR. Schedules shall reflect final load descriptions, room numbers, and room names connected to each circuit breaker. Schedules shall be printed on the panelboard directory cards and be installed in the appropriate panelboards
- E. Mount panelboards such that the maximum height of the top circuit breaker above the finished floor shall not exceed 1980 mm (78 inches).
- F. Provide blank cover for each unused circuit breaker mounting space.
- G. Not Used.
- H. Rust and scale shall be removed from the inside of existing enclosures where new interior components are to be installed. Paint inside of enclosures with rust-preventive paint before the new interior

components are installed. Provide new trim. Trim shall fit tight to the enclosure.

- I. Panelboard enclosures shall not be used for conductors feeding through, spliced, or tapping off to other enclosures or devices.

### **3.2 ACCEPTANCE CHECKS AND TESTS**

- A. Perform in accordance with the manufacturer's recommendations. In addition, include the following:

1. Visual Inspection and Tests:

- a. Compare equipment nameplate data with specifications and approved shop drawings.
- b. Inspect physical, electrical, and mechanical condition.
- c. Verify appropriate anchorage and required area clearances.
- d. Verify that circuit breaker sizes and types correspond to approved shop drawings.
- e. To verify tightness of accessible bolted electrical connections, use the calibrated torque-wrench method or perform thermographic survey after energization.
- f. Vacuum-clean enclosure interior. Clean enclosure exterior.

### **3.3 FOLLOW-UP VERIFICATION**

- A. Upon completion of acceptance checks, settings, and tests, the Contractor shall demonstrate that the panelboards are in good operating condition and properly performing the intended function.

---END---

**SECTION 26 27 26**  
**WIRING DEVICES**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section specifies the furnishing, installation, connection, and testing of wiring devices.

**1.2 RELATED WORK**

- A. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: General electrical requirements that are common to more than one section of Division 26.
- B. Section 26 05 19, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES: Cables and wiring.
- C. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS: Requirements for personnel safety and to provide a low impedance path to ground for possible ground fault currents.
- D. Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS: Conduit and boxes.
- E. Section 26 51 00, INTERIOR LIGHTING: Fluorescent ballasts and LED drivers for use with manual dimming controls.

**1.3 QUALITY ASSURANCE**

- A. Refer to Paragraph, QUALIFICATIONS (PRODUCTS AND SERVICES), in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

**1.4 SUBMITTALS**

- A. Submit six copies of the following in accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

- 1. Shop Drawings:

- a. Submit sufficient information to demonstrate compliance with drawings and specifications.
  - b. Include electrical ratings, dimensions, mounting details, construction materials, grade, and termination information.

- 2. Manuals:

- a. Submit, simultaneously with the shop drawings, companion copies of complete maintenance and operating manuals, including technical data sheets and information for ordering replacement parts.
  - b. If changes have been made to the maintenance and operating manuals originally submitted, submit updated maintenance and operating manuals two weeks prior to the final inspection.

3. Certifications: Two weeks prior to final inspection, submit the following.
  - a. Certification by the manufacturer that the wiring devices conform to the requirements of the drawings and specifications.
  - b. Certification by the Contractor that the wiring devices have been properly installed and adjusted.

## **1.5 APPLICABLE PUBLICATIONS**

- A. Publications listed below (including amendments, addenda, revisions, supplements and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by basic designation only.
- B. National Fire Protection Association (NFPA):
  - 70-14.....National Electrical Code (NEC)
  - 99-15.....Health Care Facilities
- C. National Electrical Manufacturers Association (NEMA):
  - WD 1-10.....General Color Requirements for Wiring Devices
  - WD 6-12 .....Wiring Devices - Dimensional Specifications
- D. Underwriter's Laboratories, Inc. (UL):
  - 5-11.....Surface Metal Raceways and Fittings
  - 20-10.....General-Use Snap Switches
  - 231-08.....Power Outlets
  - 467-13.....Grounding and Bonding Equipment
  - 498-12.....Attachment Plugs and Receptacles
  - 943-15.....Ground-Fault Circuit-Interrupters
  - 1449-14.....Surge Protective Devices
  - 1472-15.....Solid State Dimming Controls

## **PART 2 - PRODUCTS**

### **2.1 RECEPTACLES**

- A. General: All receptacles shall comply with NEMA, NFPA, UL, and as shown on the drawings.
  1. Mounting straps shall be nickel plated brass, brass, nickel plated steel or galvanize steel with break-off plaster ears, and shall include a self-grounding feature. Terminal screws shall be brass, brass plated or a copper alloy metal.
  2. Receptacles shall have provisions for back wiring with separate metal clamp type terminals (four minimum) and side wiring from four captively held binding screws.



- B. Duplex Receptacles - Hospital-grade: shall be listed for hospital grade, single phase, 20 ampere, 120 volts, 2-pole, 3-wire, NEMA 5-20R, with break-off feature for two-circuit operation.
1. Bodies shall be ivory in color for normal branch power. Bodies shall be RED in color for essential/emergency branch power (critical branch).
  2. Switched duplex receptacles shall be wired so that only the top receptacle is switched. The lower receptacle shall be unswitched.
  3. Duplex Receptacles on Emergency Circuit:
    - a. In rooms without emergency powered general lighting, the emergency receptacles shall be of the self-illuminated type.
  4. Ground Fault Current Interrupter (GFCI) Duplex Receptacles: Shall be an integral unit, hospital-grade, suitable for mounting in a standard outlet box, with end-of-life indication and provisions to isolate the face due to improper wiring. GFCI receptacles shall be self-test receptacles in accordance with UL 943.
    - a. Ground fault interrupter shall consist of a differential current transformer, self-test, solid state sensing circuitry and a circuit interrupter switch. Device shall have nominal sensitivity to ground leakage current of 4-6 milliamperes and shall function to interrupt the current supply for any value of ground leakage current above five milliamperes (+ or - 1 milliampere) on the load side of the device. Device shall have a minimum nominal tripping time of 0.025 second.
    - b. Self-test function shall be automatically initiated within 5 seconds after power is activated to the receptacles. Self-test function shall be periodically and automatically performed every 3 hours or less.
    - c. End-of-life indicator light shall be a persistent flashing or blinking light to indicate that the GFCI receptacle is no longer in service.
  5. Tamper-Resistant Duplex Receptacles:
    - a. Bodies shall be gray in color.
      - 1) Shall permit current to flow only while a standard plug is in the proper position in the receptacle.
      - 2) Screws exposed while the wall plates are in place shall be the tamperproof type.

- C. Duplex Receptacles - Non-hospital Grade: shall be the same as duplex receptacles - hospital grade in accordance with sections 2.1A and 2.1B of this specification, except for the hospital grade listing.
  - 1. Bodies shall be gray nylon.
- D. Receptacles - 20, 30, and 50 ampere, 250 Volts: Shall be complete with appropriate cord grip plug.
- E. Weatherproof Receptacles: Shall consist of a duplex receptacle, mounted in box with a gasketed, weatherproof, cast metal cover plate and cap over each receptacle opening. The cap shall be permanently attached to the cover plate by a spring-hinged flap. The weatherproof integrity shall not be affected when heavy duty specification or hospital grade attachment plug caps are inserted. Cover plates on outlet boxes mounted flush in the wall shall be gasketed to the wall in a watertight manner.
- F. Surge Protective (TVSS) Receptacles shall have integral surge suppression in line to ground, line to neutral, and neutral to ground modes.
  - 1. TVSS Components: Multiple metal-oxide varistors; with a nominal clamp-level rating of 400 Volts, and minimum single transient pulse energy dissipation of 210 Joules.
  - 2. Active TVSS Indication: LED, visible in face of device to indicate device is active or no longer in service.

## **2.2 TOGGLE SWITCHES**

- A. Toggle switches shall be totally enclosed tumbler type with nylon bodies. Handles shall be ivory in color unless otherwise specified or shown on the drawings.
  - 1. Switches installed in hazardous areas shall be explosion-proof type in accordance with the NEC and as shown on the drawings.
  - 2. Shall be single unit toggle, butt contact, quiet AC type, heavy-duty general-purpose use with an integral self grounding mounting strap with break-off plaster ears and provisions for back wiring with separate metal wiring clamps and side wiring with captively held binding screws.
  - 3. Switches shall be rated 20 amperes at 120-277 Volts AC.

## **2.3 MANUAL DIMMING CONTROL**

- A. Electronic full-wave manual slide dimmer with on/off switch and audible frequency and EMI/RFI suppression filters.
- B. Manual dimming controls shall be fully compatible with LED dimming driver and be approved by the driver manufacturer, shall operate over

full specified dimming range, and shall not degrade the performance or rated life of the electronic dimming ballast and lamp.

- C. Provide single-pole, three-way or four-way, as shown on the drawings.
- D. Manual dimming control and faceplates shall be ivory in color unless otherwise specified.

#### **2.4 WALL PLATES**

- A. Wall plates for switches and receptacles shall be type 302 stainless steel. Oversize plates are not acceptable.
- B. Not Used.
- C. For receptacles or switches mounted adjacent to each other, wall plates shall be common for each group of receptacles or switches.
- D. In areas requiring tamperproof wiring devices, wall plates shall be type 302 stainless steel, and shall have tamperproof screws and beveled edges.
- E. Duplex Receptacles on Emergency Circuit: Wall plates shall be red nylon with the word "EMERGENCY" engraved in 6 mm (1/4 inch) white letters.

#### **2.5 SURFACE MULTIPLE-OUTLET ASSEMBLIES**

- A. Shall have the following features:
  - 1. Enclosures:
    - a. Thickness of steel shall be not less than 1 mm (0.040 inch) for base and cover. Nominal dimensions shall be 40 mm x 70 mm (1-1/2 inches by 2-3/4 inches) with inside cross sectional area not less than 2250 square mm (3-1/2 square inches). The enclosures shall be thoroughly cleaned, phosphatized, and painted at the factory with primer and the manufacturer's standard baked enamel finish.
  - 2. Receptacles shall be duplex, hospital grade. See paragraph 'RECEPTACLES' in this Section. Device cover plates shall be the manufacturer's standard corrosion resistant finish and shall not exceed the dimensions of the enclosure.
  - 3. Unless otherwise shown on drawings, receptacle spacing shall be 600 mm (24 inches) on centers.
  - 4. Conductors shall be as specified in Section 26 05 19, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLE.
  - 5. Installation fittings shall be the manufacturer's standard bends, offsets, device brackets, inside couplings, wire clips, elbows, and other components as required for a complete system.
  - 6. Bond the assemblies to the branch circuit conduit system.

**PART 3 - EXECUTION****3.1 INSTALLATION**

- A. Installation shall be in accordance with the NEC and as shown as on the drawings.
- B. Install wiring devices after wall construction and painting is complete.
- C. The ground terminal of each wiring device shall be bonded to the outlet box with an approved green bonding jumper, and also connected to the branch circuit equipment grounding conductor.
- D. Outlet boxes for toggle switches and manual dimming controls shall be mounted on the strike side of doors.
- E. Provide barriers in multi-gang outlet boxes to comply with the NEC.
- F. Coordinate the electrical work with the work of other trades to ensure that wiring device flush outlets are positioned with box openings aligned with the face of the surrounding finish material. Pay special attention to installations in cabinet work, and in connection with laboratory equipment.
- G. Exact field locations of floors, walls, partitions, doors, windows, and equipment may vary from locations shown on the drawings. Prior to locating sleeves, boxes and chases for roughing-in of conduit and equipment, the Contractor shall coordinate exact field location of the above items with other trades.
- H. Install wall switches 1.2 M (48 inches) above floor, with the toggle OFF position down.
- I. Install wall dimmers 1.2 M (48 inches) above floor.
- J. Install receptacles 450 mm (18 inches) above floor, and 152 mm (6 inches) above counter backsplash or workbenches. Install specific-use receptacles at heights shown on the drawings.
- K. Install horizontally mounted receptacles with the ground pin to the right.
- L. When required or recommended by the manufacturer, use a torque screwdriver. Tighten unused terminal screws.
- M. Label device plates with a permanent adhesive label listing panel and circuit feeding the wiring device.

### 3.2 ACCEPTANCE CHECKS AND TESTS

- A. Perform manufacturer's required field checks in accordance with the manufacturer's recommendations, and the latest NFPA 99. In addition, include the following:
1. Visual Inspection and Tests:
    - a. Inspect physical and electrical conditions.
    - b. Vacuum-clean surface metal raceway interior. Clean metal raceway exterior.
    - c. Test wiring devices for damaged conductors, high circuit resistance, poor connections, inadequate fault current path, defective devices, or similar problems using a portable receptacle tester. Correct circuit conditions, remove malfunctioning units and replace with new, and retest as specified above.
    - d. Test GFCI receptacles.
  2. Receptacle testing in the Patient Care Spaces, such as retention force of the grounding blade of each receptacle, shall comply with the latest NFPA 99.

---END---



**SECTION 26 29 21**  
**ENCLOSED SWITCHES AND CIRCUIT BREAKERS**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section specifies the furnishing, installation, and connection of fused and unfused disconnect switches (indicated as switches in this section), and separately-enclosed circuit breakers for use in electrical systems rated 600 V and below.

**1.2 RELATED WORK**

- A. Not Used.
- B. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS:  
Requirements that apply to all sections of Division 26.
- C. Section 26 05 19, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES:  
Low-voltage conductors.
- D. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS:  
Requirements for personnel safety and to provide a low impedance path for possible ground faults.
- E. Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS: Conduits.
- F. Section 26 24 16, PANELBOARDS: Molded-case circuit breakers.

**1.3 QUALITY ASSURANCE**

- A. Refer to Paragraph, QUALIFICATIONS (PRODUCTS AND SERVICES), in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

**1.4 SUBMITTALS**

- A. Submit six copies of the following in accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
1. Shop Drawings:
    - a. Submit sufficient information to demonstrate compliance with drawings and specifications.
    - b. Submit the following data for approval:
      - 1) Electrical ratings, dimensions, mounting details, materials, required clearances, terminations, weight, fuses, circuit breakers, wiring and connection diagrams, accessories, and device nameplate data.
  2. Manuals:
    - a. Submit complete maintenance and operating manuals including technical data sheets, wiring diagrams, and information for ordering fuses, circuit breakers, and replacement parts.

- 1) Include schematic diagrams, with all terminals identified, matching terminal identification in the enclosed switches and circuit breakers.
- 2) Include information for testing, repair, troubleshooting, assembly, and disassembly.
- b. If changes have been made to the maintenance and operating manuals originally submitted, submit updated maintenance and operating manuals two weeks prior to the final inspection.
3. Certifications: Two weeks prior to final inspection, submit the following.
  - a. Certification by the manufacturer that the enclosed switches and circuit breakers conform to the requirements of the drawings and specifications.
  - b. Certification by the Contractor that the enclosed switches and circuit breakers have been properly installed, adjusted, and tested.

#### **1.5 APPLICABLE PUBLICATIONS**

- A. Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by designation only.
- B. International Code Council (ICC):
  - IBC-12.....International Building Code
- C. National Electrical Manufacturers Association (NEMA):
  - FU 1-07.....Low Voltage Cartridge Fuses
  - KS 1-06.....Enclosed and Miscellaneous Distribution Equipment Switches (600 Volts Maximum)
- D. National Fire Protection Association (NFPA):
  - 70-11.....National Electrical Code (NEC)
- E. Underwriters Laboratories, Inc. (UL):
  - 98-07.....Enclosed and Dead-Front Switches
  - 248-00.....Low Voltage Fuses
  - 489-09.....Molded Case Circuit Breakers and Circuit Breaker Enclosures



## **PART 2 - PRODUCTS**

### **2.1 FUSED SWITCHES RATED 600 AMPERES AND LESS**

- A. Switches shall be in accordance with NEMA, NEC, UL, as specified, and as shown on the drawings.
- B. Shall be NEMA classified General Duty (GD) for 240 V switches, and NEMA classified Heavy Duty (HD) for 480 V switches.
- C. Shall be horsepower (HP) rated.
- D. Shall have the following features:
  - 1. Switch mechanism shall be the quick-make, quick-break type.
  - 2. Copper blades, visible in the open position.
  - 3. An arc chute for each pole.
  - 4. External operating handle shall indicate open and closed positions, and have lock-open padlocking provisions.
  - 5. Mechanical interlock shall permit opening of the door only when the switch is in the open position, defeatable to permit inspection.
  - 6. Fuse holders for the sizes and types of fuses specified.
  - 7. Solid neutral for each switch being installed in a circuit which includes a neutral conductor.
  - 8. Ground lugs for each ground conductor.
  - 9. Enclosures:
    - a. Shall be the NEMA types shown on the drawings.
    - b. Where the types of switch enclosures are not shown, they shall be the NEMA types most suitable for the ambient environmental conditions.
    - c. Shall be finished with manufacturer's standard gray baked enamel paint over pretreated steel.

### **2.2 UNFUSED SWITCHES RATED 600 AMPERES AND LESS**

- A. Shall be the same as fused switches, but without provisions for fuses.

### **2.3 FUSED SWITCHES RATED OVER 600 AMPERES TO 1200 AMPERES NOT USED.**

### **2.4 MOTOR RATED TOGGLE SWITCHES**

- A. Type 1, general purpose for single-phase motors rated up to 1 horsepower.
- B. Quick-make, quick-break toggle switch with external reset button and thermal overload protection matched to nameplate full-load current of actual protected motor.

### **2.5 CARTRIDGE FUSES**

- A. Shall be in accordance with NEMA FU 1.
- B. Not Used.

- C. Feeders: Class RK1, time delay.
- D. Motor Branch Circuits: Class RK1, time delay.
- E. Other Branch Circuits: Class RK5, time delay
- F. Control Circuits: Class CC, /time delay.

## **2.6 SEPARATELY-ENCLOSED CIRCUIT BREAKERS**

- A. Provide circuit breakers in accordance with the applicable requirements in Section 26 24 16, PANELBOARDS.
- B. Enclosures shall be the NEMA types shown on the drawings. Where the types are not shown, they shall be the NEMA type most suitable for the ambient environmental conditions.

## **PART 3 - EXECUTION**

### **3.1 INSTALLATION**

- A. Installation shall be in accordance with the manufacturer's instructions, the NEC, as shown on the drawings, and as specified.
- B. Not Used.
- C. Fused switches shall be furnished complete with fuses. Arrange fuses such that rating information is readable without removing the fuses.

### **3.2 ACCEPTANCE CHECKS AND TESTS**

- A. Perform in accordance with the manufacturer's recommendations. In addition, include the following:
  - 1. Visual Inspection and Tests:
    - a. Compare equipment nameplate data with specifications and approved shop drawings.
    - b. Inspect physical, electrical, and mechanical condition.
    - c. Verify tightness of accessible bolted electrical connections by calibrated torque-wrench method.
    - d. Vacuum-clean enclosure interior. Clean enclosure exterior.

### **3.3 SPARE PARTS**

- A. Two weeks prior to the final inspection, furnish one complete set of spare fuses for each fused disconnect switch installed on the project. Deliver the spare fuses to the COTR.

---END---

**SECTION 26 41 00  
FACILITY LIGHTNING PROTECTION**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section specifies the furnishing and installation of a complete UL master labeled lightning protection system.

**1.2 RELATED WORK**

- A. Section 07 60 00, FLASHING AND SHEET METAL: Penetrations through the roof.
- B. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: Requirements that apply to all sections of Division 26.
- C. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS: Requirements for personnel safety and to provide a low impedance path to ground for possible ground faults.
- D. Not Used.
- E. Not Used.

**1.3 QUALITY ASSURANCE**

- A. Quality Assurance shall be in accordance with Paragraph, QUALIFICATIONS (PRODUCTS AND SERVICES) in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

**1.4 SUBMITTALS**

- A. Submit in accordance with Paragraph, SUBMITTALS in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS, and the following requirements:
1. Shop Drawings:

A. Submit in accordance with Paragraph, SUBMITTALS in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS, and the following requirements:

    - b. Show locations of air terminals, connections to required metal surfaces, down conductors, and grounding means.
    - c. Show the mounting hardware and materials used to attach air terminals and conductors to the structure.
  2. Certifications: Two weeks prior to final inspection, submit the following.
    - a. Certification by the manufacturer that the lightning protection system conforms to the requirements of the drawings and specifications.

- b. Certification by the Contractor that the lightning protection system has been properly installed and inspected.
- c. Certification that the lightning protection system has been inspected by a UL representative and has been approved by UL without variation.

### **1.5 APPLICABLE PUBLICATIONS**

- A. Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by designation only.
- B. National Fire Protection Association (NFPA):
  - 70-17.....National Electrical Code (NEC)
  - 780-17.....Standard for the Installation of Lightning Protection Systems
- C. Underwriters Laboratories, Inc. (UL):
  - 96-16.....Lightning Protection Components
  - 96A-16.....Installation Requirements for Lightning Protection Systems
  - 467-13.....Standard for Grounding and Bonding Equipment

## **PART 2 - PRODUCTS**

### **2.1 GENERAL REQUIREMENTS**

- A. Lightning protection components shall conform to NFPA 780 and UL 96, for use on Class II structures. Aluminum materials are not allowed.
  - 1. Class II conductors: Copper.
  - 2. Not Used.
  - 3. Class II air terminals: Solid copper, 460 mm (18 inches) long, not less than 12.7 mm (1/2 inch) diameter, with sharp nickel-plated points.
  - 4. Ground rods: Copper-clad steel, 0.75 in (19 mm) diameter by 3 m (10 feet) long.
  - 5. Ground plates: Solid copper, not less than 20 gauge.
  - 6. Bonding plates: Bronze, 50 square cm (8 square inches).
  - 7. Through roof connectors: Solid copper riser bar, length and type as required to accommodate roof structure and flashing requirements.
  - 8. Down conductor guards: Stiff copper or brass.
  - 9. Anchors and fasteners: Bronze bolt and clamp type shall be used for all applications except for membrane roof. Adhesive type are

allowed only for attachment to membrane roof materials, using adhesive that is compatible with the membrane material.

10. Connectors: Bronze clamp-type connectors shall be used for roof conductor splices, and the connection of the roof conductor to air terminals and bonding plates. Crimp-type connectors are not allowed.
11. Exothermic welds: Exothermic welds shall be used for splicing the roof conductor to the down conductors, splices of the down conductors, and for connection of the down conductors to ground rods, ground plates, and the ground ring.

### **PART 3 - EXECUTION**

#### **3.1 INSTALLATION**

- A. Installation shall be in accordance with the NEC, as shown on the drawings, and manufacturer's instructions.
- B. Coordinate installation with the roofing manufacturer and roofing installer.
- C. Install the conductors as inconspicuously as practical.
- D. Install the down conductors within the concealed cavity of exterior walls where practical. Run the down conductors to the exterior at elevations below the finished grade.
- E. Where down conductors are subject to damage or are accessible near grade, protect with down conductor guards to 2.4 m (8 feet) above grade. Bond down conductor guards to down conductor at both ends.
- F. Make connections of dissimilar metal with bimetallic type fittings to prevent electrolytic action.
- G. Install ground rods and ground plates not less than 600 mm (2 feet) deep and a distance not less than 900 mm (3 feet) nor more than 2.5 m (8 feet) from the nearest point of the structure. Exothermically weld the down conductors to ground rods and ground plates in the presence of the COR.
- H. Bond down conductors to metal main water piping where applicable.
- I. Bond down conductors to building structural steel.
- J. Connect roof conductors to all metallic projections and equipment above the roof as indicated on the drawings.
- K. Connect exterior metal surfaces, located within 900 mm (3 feet) of the conductors, to the conductors to prevent flashovers.

- L. Maintain horizontal or downward coursing of main conductor and insure that all bends have at least a 200 mm (8 inches) radius and do not exceed 90 degrees.
- M. Conductors shall be rigidly fastened every 900 mm (3 feet) along the roof and down to the building to ground.
- N. Air terminals shall be secured against overturning either by attachment to the object to be protected or by means of a substantial tripod or other braces permanently and rigidly attached to the building or structure.
- O. Install air terminal bases, cable holders and other roof-system supporting means without piercing membrane or metal roofs.
- P. Use through-roof connectors for penetration of the roof system. Flashing shall be provided by roofing contractor in accordance with Section 07 60 00, FLASHING AND SHEET METAL.
- Q. Down conductors coursed on or in reinforced concrete columns or on structural steel columns shall be connected to the reinforcing steel or the structural steel member at its upper and lower extremities. In the case of long vertical members an additional connection shall be made at intervals not exceeding 30 M (100 feet).
- R. A counterpoise or ground ring, where shown, shall be of No. 1/0 copper cable having suitable resistance to corrosion and shall be laid around the perimeter of the structure in a trench not less than 600 mm (2 feet) deep at a distance not less than 900 mm (3 feet) nor more than 2.5 M (8 feet) from the nearest point of the structure.
- S. On construction utilizing post tensioning systems to secure precast concrete sections, the post tension rods shall not be used as a path for lightning to ground.
- T. Where shown, use the structural steel framework or reinforcing steel as the down conductor.
  - 1. Weld or bond the non-electrically-continuous sections together and make them electrically continuous.
  - 2. Verify the electrical continuity by measuring the ground resistances to earth at the ground level, at the top of the building or stack, and at intermediate points with a sensitive ohmmeter. Compare the resistance readings.
  - 3. Connect the air terminals together with an exterior conductor connected to the structural steel framework at not more than 18 M (60 feet) intervals.

4. Install ground connections to earth at not more than 18 M (60 feet) intervals around the perimeter of the building.
5. Weld or braze bonding plates to cleaned sections of the steel and connect the conductors to the plates.
6. Do not pierce the structural steel in any manner. Connections to the structural steel shall conform to UL 96A.

U. Not Used.

V. Where the drawings show the new lightning protection system connected to an existing lightning protection system with or without a UL master label, the new portion of the lightning protection system requires UL inspection and a Letter of Findings.

### **3.2 ACCEPTANCE CHECKS AND TESTS**

- A. Test the ground resistance to earth by standard methods, and conform to the ground resistance requirements specified in Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS.
- B. A UL representative shall inspect the lightning protection system. Obtain and install a UL numbered master label for each of the lightning protection systems at the location directed by the UL representative and the COR.

---END---





**SECTION 26 43 13  
SURGE PROTECTIVE DEVICES**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section specifies the furnishing, installation, and connection of Type 2 Surge Protective Devices, as defined in NFPA 70, and indicated as transient voltage surge suppression or TVSS in this section.

**1.2 RELATED WORK**

- A. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: Requirements that apply to all sections of Division 26.
- B. Not Used.
- C. Not Used.
- D. Section 26 24 16, PANELBOARDS: For factory-installed or external TVSS.
- E. Not Used.

**1.3 QUALITY ASSURANCE**

- A. Quality Assurance shall be in accordance with Paragraph, QUALIFICATIONS (PRODUCTS AND SERVICES) in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

**1.4 SUBMITTALS**

- A. Submit in accordance with Paragraph, SUBMITTALS in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS, and the following requirements:
  - 1. Shop Drawings:
    - a. Submit sufficient information to demonstrate compliance with drawings and specifications.
    - b. Include electrical ratings and device nameplate data.
  - 2. Manuals:
    - a. Submit, simultaneously with the shop drawings, companion copies of complete maintenance and operating manuals including technical data sheets, wiring diagrams, and information for ordering replacement parts.
    - b. If changes have been made to the maintenance and operating manuals originally submitted, submit updated maintenance and operating manuals two weeks prior to the final inspection.
  - 3. Certifications: Two weeks prior to final inspection, submit the following.
    - a. Certification by the manufacturer that the SPD conforms to the requirements of the drawings and specifications.

- b. Certification by the Contractor that the SPD has been properly installed.

### **1.5 APPLICABLE PUBLICATIONS**

- A. Publications listed below (including amendments, addenda, revisions, supplement and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by the basic designation only.
- B. Institute of Engineering and Electronic Engineers (IEEE):
  - IEEE C62.41.2-02.....Characterization of Surges in Low-Voltage (1000 V and Less) AC Power Circuits
  - IEEE C62.45-08.....Surge Testing for Equipment Connected to Low-Voltage (1000 V and Less) AC Power Circuits
- C. National Fire Protection Association (NFPA):
  - 70-17.....National Electrical Code (NEC)
- D. Underwriters Laboratories, Inc. (UL):
  - UL 1283-15.....Electromagnetic Interference Filters
  - UL 1449-14.....Surge Protective Devices

## **PART 2 - PRODUCTS**

### **2.1 SWITCHGEAR/SWITCHBOARD TVSS NOT USED.**

### **2.2 PANELBOARD TVSS**

- A. General Requirements:
  - 1. Comply with UL 1449 and IEEE C62.41.2.
  - 2. Modular design with field-replaceable modules, or non-modular design.
  - 3. Fuses, rated at 200 kA interrupting capacity.
  - 4. Bolted compression lugs for internal wiring.
  - 5. Integral disconnect switch.
  - 6. Redundant suppression circuits.
  - 7. LED indicator lights for power and protection status.
  - 8. Audible alarm, with silencing switch, to indicate when protection has failed.
  - 9. Form-C contacts rated at 5 A and 250-V ac, one normally open and one normally closed, for remote monitoring of protection status.  
Contacts shall reverse on failure of any surge diversion module or on opening of any current-limiting device.
  - 10. Four-digit transient-event counter.
- B. Surge Current per Phase: Minimum 120kA per phase.

## **2.3 ENCLOSURES**

- A. Enclosures: NEMA 1.

## **PART 3 - EXECUTION**

### **3.1 INSTALLATION**

- A. Installation shall be in accordance with the NEC, as shown on the drawings, and manufacturer's instructions.
- B. Field-installed TVSS: Contractor shall install TVSS with conductors or buses between TVSS and points of attachment as short and straight as possible. Do not exceed manufacturer's recommended lead length. Do not bond neutral and ground.
  - 1. Provide a circuit breaker as a dedicated disconnecting means for TVSS as shown on drawings.
- C. Do not perform insulation resistance tests on switchgear, switchboards, panelboards, or feeders with the TVSS connected. Disconnect TVSS before conducting insulation resistance tests, and reconnect TVSS immediately after insulation resistance tests are complete.

### **3.2 ACCEPTANCE CHECKS AND TESTS**

- A. Perform in accordance with the manufacturer's recommendations. In addition, include the following:
  - 1. Visual Inspection and Tests:
    - a. Compare equipment nameplate data with specifications and approved shop drawings.
    - b. Inspect physical, electrical, and mechanical condition.
    - c. Verify that disconnecting means and feeder size and maximum length to TVSS corresponds to approved shop drawings.
    - d. Verifying tightness of accessible bolted electrical connections by calibrated torque-wrench method.
    - e. Vacuum-clean enclosure interior. Clean enclosure exterior.
    - f. Verify the correct operation of all sensing devices, alarms, and indicating devices.

### **3.3 FOLLOW-UP VERIFICATION**

- A. After completion of acceptance checks and tests, the Contractor shall show by demonstration in service that TVSS are in good operating condition and properly performing the intended function.

### **3.4 INSTRUCTION**

- A. Provide the services of a factory-trained technician for one 2-hour training period for instructing personnel in the maintenance and operation of the SPD, on the date requested by the COTR.

---END---

**SECTION 26 51 00**  
**INTERIOR LIGHTING**

**PART 1 - GENERAL**

**1.1 DESCRIPTION:**

- A. This section specifies the furnishing, installation, and connection of the interior lighting systems. The terms "lighting fixture," "fixture," and "luminaire" are used interchangeably.

**1.2 RELATED WORK**

- A. Section 01 74 19, CONSTRUCTION WASTE MANAGEMENT: Disposal of lamps.
- B. Section 02 41 00, DEMOLITION: Removal and disposal of lamps and ballasts.
- C. Not Used.
- D. Not Used.
- E. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: Requirements that apply to all sections of Division 26.
- F. Section 26 05 19, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES: Low-voltage conductors.
- G. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS: Requirements for personnel safety and to provide a low impedance path to ground for possible ground fault currents.
- H. Section 26 27 26, WIRING DEVICES: Wiring devices used for control of the lighting systems.

**1.3 QUALITY ASSURANCE**

- A. Refer to Paragraph, QUALIFICATIONS (PRODUCTS AND SERVICES), in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

**1.4 SUBMITTALS**

- A. Submit six copies of the following in accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

1. Shop Drawings:

- a. Submit the following information for each type of lighting fixture designated on the LIGHTING FIXTURE SCHEDULE, arranged in order of lighting fixture designation.
- b. Material and construction details, include information on housing and optics system.
- c. Physical dimensions and description.
- d. Wiring schematic and connection diagram.
- e. Installation details.
- f. Energy efficiency data.

- g. Photometric data based on laboratory tests complying with IES Lighting Measurements testing and calculation guides.
  - h. Lamp data including lumen output (initial and mean), color rendition index (CRI), rated life (hours), and color temperature (degrees Kelvin).
  - i. Ballast data including ballast type, starting method, ambient temperature, ballast factor, sound rating, system watts, and total harmonic distortion (THD).
  - j. For LED lighting fixtures, submit US DOE LED Lighting Facts label, and IES L70 rated life.
2. Manuals:
- a. Submit, simultaneously with the shop drawings, complete maintenance and operating manuals, including technical data sheets, wiring diagrams, and information for ordering replacement parts.
  - b. If changes have been made to the maintenance and operating manuals originally submitted, submit updated maintenance and operating manuals two weeks prior to the final inspection.
3. Certifications: Two weeks prior to final inspection, submit the following.
- a. Certification by the Contractor that the interior lighting systems have been properly installed and tested.

#### **1.5 APPLICABLE PUBLICATIONS**

- A. Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by designation only.
- B. American National Standards Institute (ANSI):
  - C78.1-91.....Fluorescent Lamps - Rapid-Start Types -  
Dimensional and Electrical Characteristics
  - C78.376-01.....Chromaticity of Fluorescent Lamps
- C. American Society for Testing and Materials (ASTM):
  - C635-07.....Manufacture, Performance, and Testing of Metal  
Suspension Systems for Acoustical Tile and Lay-  
in Panel Ceilings
- D. Environmental Protection Agency (EPA):
  - 40 CFR 261.....Identification and Listing of Hazardous Waste
- E. Federal Communications Commission (FCC):

- CFR Title 47, Part 15...Radio Frequency Devices
- CFR Title 47, Part 18...Industrial, Scientific, and Medical Equipment
- F. Illuminating Engineering Society (IES):
- LM-79-08.....Electrical and Photometric Measurements of  
Solid-State Lighting Products
- LM-80-08.....Measuring Lumen Maintenance of LED Light  
Sources
- LM-82-12.....Characterization of LED Light Engines and LED  
Lamps for Electrical and Photometric Properties  
as a Function of Temperature
- G. Institute of Electrical and Electronic Engineers (IEEE):
- C62.41-91.....Surge Voltages in Low Voltage AC Power Circuits
- H. International Code Council (ICC):
- IBC-12.....International Building Code
- I. National Fire Protection Association (NFPA):
- 70-11.....National Electrical Code (NEC)
- 101-12.....Life Safety Code
- J. National Electrical Manufacturer's Association (NEMA):
- SSL-1-10.....Electronic Drivers for LED Devices, Arrays, or  
Systems
- K. Underwriters Laboratories, Inc. (UL):
- 496-08.....Lampholders
- 844-12.....Luminaires for Use in Hazardous (Classified)  
Locations
- 924-12.....Emergency Lighting and Power Equipment
- 1598-08.....Luminaires
- 2108-04.....Low-Voltage Lighting Systems
- 8750-09.....Light Emitting Diode (LED) Light Sources for  
Use in Lighting Products

## **PART 2 - PRODUCTS**

### **2.1 LIGHTING FIXTURES**

- A. Shall be in accordance with NFPA, UL, as shown on drawings, and as specified.
- B. Sheet Metal:
1. Shall be formed to prevent warping and sagging. Housing, trim and lens frame shall be true, straight (unless intentionally curved), and parallel to each other as designed.

- 2. Wireways and fittings shall be free of burrs and sharp edges, and shall accommodate internal and branch circuit wiring without damage to the wiring.
- 3. When installed, any exposed fixture housing surface, trim frame, door frame, and lens frame shall be free of light leaks.
- 4. Hinged door frames shall operate smoothly without binding. Latches shall function easily by finger action without the use of tools.
- C. Ballasts and lamps shall be serviceable while the fixture is in its normally installed position. Ballasts shall not be mounted to removable reflectors or wireway covers unless so specified.
- D. Not Used.
- E. Recessed fixtures mounted in an insulated ceiling shall be listed for use in insulated ceilings.
- F. Mechanical Safety: Lighting fixture closures (lens doors, trim frame, hinged housings, etc.) shall be retained in a secure manner by captive screws, chains, aircraft cable, captive hinges, or fasteners such that they cannot be accidentally dislodged during normal operation or routine maintenance.
- G. Metal Finishes:
  - 1. The manufacturer shall apply standard finish (unless otherwise specified) over a corrosion-resistant primer, after cleaning to free the metal surfaces of rust, grease, dirt and other deposits. Edges of pre-finished sheet metal exposed during forming, stamping or shearing processes shall be finished in a similar corrosion resistant manner to match the adjacent surface(s). Fixture finish shall be free of stains or evidence of rusting, blistering, or flaking, and shall be applied after fabrication.
  - 2. Interior light reflecting finishes shall be white with not less than 85 percent reflectances, except where otherwise shown on the drawing.
  - 3. Exterior finishes shall be as shown on the drawings.
- H. Lighting fixtures shall have a specific means for grounding metallic wireways and housings to an equipment grounding conductor.

**2.2 BALLASTS NOT USED.**

**2.3 FLUORESCENT EMERGENCY BALLAST NOT USED.**

**2.4 EMERGENCY LIGHTING UNIT NOT USED.**

**2.5 LAMPS NOT USED.**

**2.6 RADIO-INTERFERENCE-FREE FLUORESCENT FIXTURES Not Used.**



**2.7 WALL MOUNTED FLUORESCNET BEDLIGHT FIXTURES NOT USED.****2.8 X-RAY FILM ILLUMINATORS NOT USED.****2.9 LED EXIT LIGHT FIXTURES**

- A. Exit light fixtures shall meet applicable requirements of NFPA and UL.
- B. Housing and door shall be die-cast aluminum.
- C. For general purpose exit light fixtures, door frame shall be hinged, with latch. For vandal-resistant exit light fixtures, door frame shall be secured with tamper-resistant screws.
- D. Finish shall be satin or fine-grain brushed aluminum.
- E. There shall be no radioactive material used in the fixtures.
- F. Fixtures:
  - 1. Inscription panels shall be cast or stamped aluminum a minimum of 2.25 mm (0.090 inch) thick, stenciled with 150 mm (6 inch) high letters, baked with red color stable plastic or fiberglass. Lamps shall be luminous Light Emitting Diodes (LED) mounted in center of letters on red color stable plastic or fiberglass.
  - 2. Double-Faced Fixtures: Provide double-faced fixtures where required or as shown on drawings.
  - 3. Directional Arrows: Provide directional arrows as part of the inscription panel where required or as shown on drawings. Directional arrows shall be the "chevron-type" of similar size and width as the letters and meet the requirements of NFPA 101.
- G. Voltage: Multi-voltage (120 - 277V).

**2.10 LED LIGHT FIXTURES**

- A. General:
  - 1. LED light fixtures shall be in accordance with IES, NFPA, UL, as shown on the drawings, and as specified.
  - 2. LED light fixtures shall be Reduction of Hazardous Substances (RoHS)-compliant.
  - 3. LED drivers shall include the following features unless otherwise indicated:
    - a. Minimum efficiency: 85% at full load.
    - b. Minimum Operating Ambient Temperature: -20° C. (-4° F.)
    - c. Input Voltage: 120 - 277V (±10%) at 60 Hz.
    - d. Integral short circuit, open circuit, and overload protection.
    - e. Power Factor: ≥ 0.95.
    - f. Total Harmonic Distortion: ≤ 20%.
    - g. Comply with FCC 47 CFR Part 15.

4. LED modules shall include the following features unless otherwise indicated:

- a. Comply with IES LM-79 and LM-80 requirements.
- b. Minimum CRI 80 and color temperature 3000° K unless otherwise specified in LIGHTING FIXTURE SCHEDULE.
- c. Minimum Rated Life: 50,000 hours per IES L70.
- d. Light output lumens as indicated in the LIGHTING FIXTURE SCHEDULE.

B. LED Downlights:

- 1. Housing, LED driver, and LED module shall be products of the same manufacturer.

C. LED Troffers:

- 1. LED drivers, modules, and reflector shall be accessible, serviceable, and replaceable from below the ceiling.
- 2. Housing, LED driver, and LED module shall be products of the same manufacturer.

### **PART 3 - EXECUTION**

#### **3.1 INSTALLATION**

- A. Installation shall be in accordance with the NEC, manufacturer's instructions, and as shown on the drawings or specified.
- B. Align, mount, and level the lighting fixtures uniformly.
- C. Wall-mounted fixtures shall be attached to the studs in the walls, or to a 20 gauge metal backing plate that is attached to the studs in the walls. Lighting fixtures shall not be attached directly to gypsum board.
- D. Lighting Fixture Supports:
  - 1. Shall provide support for all of the fixtures. Supports may be anchored to channels of the ceiling construction, to the structural slab or to structural members within a partition, or above a suspended ceiling.
  - 2. Shall maintain the fixture positions after cleaning and relamping.
  - 3. Shall support the lighting fixtures without causing the ceiling or partition to deflect.
  - 4. Not Used.
  - 5. Not Used.
  - 6. Not Used.
  - 7. Surface mounted lighting fixtures:

- a. Fixtures shall be bolted against the ceiling independent of the outlet box at four points spaced near the corners of each unit. The bolts (or stud-clips) shall be minimum 6 mm (1/4 inch) bolt, secured to main ceiling runners and/or secured to cross runners. Non-turning studs may be attached to the main ceiling runners and cross runners with special non-friction clip devices designed for the purpose, provided they bolt through the runner, or are also secured to the building structure by 12 gauge safety hangers. Studs or bolts securing fixtures weighing in excess of 25 kg (56 pounds) shall be supported directly from the building structure.
  - b. Where ceiling cross runners are installed for support of lighting fixtures, they must have a carrying capacity equal to that of the main ceiling runners and be rigidly secured to the main runners.
  - c. Fixtures less than 6.8 kg (15 pounds) in weight and occupying less than 3715 sq cm (two square feet) of ceiling area may, when designed for the purpose, be supported directly from the outlet box when all the following conditions are met.
    - 1) Screws attaching the fixture to the outlet box pass through round holes (not key-hole slots) in the fixture body.
    - 2) The outlet box is attached to a main ceiling runner (or cross runner) with approved hardware.
    - 3) The outlet box is supported vertically from the building structure.
  - d. Fixtures mounted in open construction shall be secured directly to the building structure with approved bolting and clamping devices.
8. Single or double pendant-mounted lighting fixtures:
- a. Each stem shall be supported by an approved outlet box mounted swivel joint and canopy which holds the stem captive and provides spring load (or approved equivalent) dampening of fixture oscillations. Outlet box shall be supported vertically from the building structure.
9. Outlet boxes for support of lighting fixtures (where permitted) shall be secured directly to the building structure with approved devices or supported vertically in a hung ceiling from the building structure with a nine gauge wire hanger, and be secured by an approved device to a main ceiling runner or cross runner to prevent any horizontal movement relative to the ceiling.//

- E. Furnish and install the new lamps as specified for all lighting fixtures installed under this project, and for all existing lighting fixtures reused under this project.
- F. The electrical and ceiling trades shall coordinate to ascertain that approved lighting fixtures are furnished in the proper sizes and installed with the proper devices (hangers, clips, trim frames, flanges, etc.), to match the ceiling system being installed.
- G. Bond lighting fixtures to the grounding system as specified in Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS.
- H. At completion of project, replace all defective components of the lighting fixtures at no cost to the Government.
- I. Dispose of lamps per requirements of Section 01 74 19, CONSTRUCTION WASTE MANAGEMENT.

### **3.2 ACCEPTANCE CHECKS AND TESTS**

- A. Perform the following:
  - 1. Visual Inspection:
    - a. Verify proper operation by operating the lighting controls.
    - b. Visually inspect for damage to fixtures, lenses, reflectors, diffusers, and louvers. Clean fixtures, lenses, reflectors, diffusers, and louvers that have accumulated dust, dirt, or fingerprints during construction.
  - 2. Electrical tests:
    - a. Exercise dimming components of the lighting fixtures over full range of dimming capability by operating the control devices(s) in the presence of the COTR. Observe for visually detectable flicker over full dimming range, and replace defective components at no cost to the Government.
    - b. Burn-in all lamps that require specific aging period to operate properly, prior to occupancy by Government. Burn-in period to be 40 hours minimum, unless specifically recommended otherwise by the lamp manufacturer. Burn-in dimmed fluorescent and compact fluorescent lamps for at least 100 hours at full voltage, unless specifically recommended otherwise by the lamp manufacturer. Replace any lamps and ballasts which fail during burn-in.

### **3.3 FOLLOW-UP VERIFICATION**

- A. Upon completion of acceptance checks and tests, the Contractor shall show by demonstration in service that the lighting systems are in good operating condition and properly performing the intended function.

---END---



**SECTION 26 56 00  
EXTERIOR LIGHTING**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

This section specifies the furnishing, installation, and connection of exterior fixtures, poles, and supports. The terms "lighting fixtures", "fixture" and "luminaire" are used interchangeably.

**1.2 RELATED WORK**

- A. Section 03 30 00, CAST-IN-PLACE CONCRETE.
- B. Not Used.
- C. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: General electrical requirements and items that are common to more than one section of Division 26.
- D. Section 26 05 19, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES (600 VOLTS AND BELOW): Low voltage power and lighting wiring.
- E. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS: Requirements for personnel safety and to provide a low impedance path for possible ground fault currents.
- F. Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS: Conduits, fittings, and boxes for raceway systems.
- G. Not Used.
- H. Section 26 09 23, LIGHTING CONTROLS: Controls for exterior lighting.

**1.3 QUALITY ASSURANCE**

- A. Refer to Paragraph, QUALIFICATIONS (PRODUCTS AND SERVICES), in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

**1.4 SUBMITTALS**

- A. Submit six copies of the following in accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
  - 1. Shop Drawings:
    - a. Submit the following information for each type of lighting fixture designated on the LIGHTING FIXTURE SCHEDULE, arranged in order of lighting fixture designation.
    - b. Material and construction details, include information on housing and optics system.
    - c. Physical dimensions and description.
    - d. Wiring schematic and connection diagram.
    - e. Installation details.
    - f. Energy efficiency data.

- g. Photometric data based on laboratory tests complying with IES Lighting Measurements testing and calculation guides.
  - h. Lamp data including lumen output (initial and mean), color rendition index (CRI), rated life (hours), and color temperature (degrees Kelvin).
  - i. Ballast data including ballast type, starting method, ambient temperature, ballast factor, sound rating, system watts, and total harmonic distortion (THD).
  - j. For LED lighting fixtures, submit US DOE LED Lighting Facts label, and IES L70 rated life.
  - k. Submit site plan showing all exterior lighting fixtures with fixture tags consistent with Lighting Fixture Schedule as shown on drawings. Site plan shall show computer generated point-by-point illumination calculations. Include lamp lumen and light loss factors used in calculations.
2. Manuals:
- a. Submit, simultaneously with the shop drawings, complete maintenance and operating manuals, including technical data sheets, wiring diagrams, and information for ordering replacement parts.
  - b. If changes have been made to the maintenance and operating manuals originally submitted, submit updated maintenance and operating manuals two weeks prior to the final inspection.
3. Certifications: Two weeks prior to final inspection, submit the following.
- a. Certification by the Contractor that the exterior lighting systems have been properly installed and tested.

#### **1.5 APPLICABLE PUBLICATIONS**

- A. Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by designation only.
- B. Aluminum Association Inc. (AA):  
AAH35.1-06.....Alloy and Temper Designation Systems for  
Aluminum
- C. American Association of State Highway and Transportation Officials (AASHTO):



- 32-LTS-6.....Structural Supports for Highway Signs,  
Luminaires and Traffic Signals
- D. American Concrete Institute (ACI):
- 318-05 .....Building Code Requirements for Structural  
Concrete
- E. American National Standards Institute (ANSI):
- C81.61-09 .....Electrical Lamp Bases - Specifications for  
Bases (Caps) for Electric Lamps
- F. American Society for Testing and Materials (ASTM):
- A123/A123M-12 .....Zinc (Hot-Dip Galvanized) Coatings on Iron and  
Steel Products
- A153/A153M-09.....Zinc Coating (Hot-Dip) on Iron and Steel  
Hardware
- B108-03a-08 .....Aluminum-Alloy Permanent Mold Castings
- C1089-13 .....Spun Cast Prestressed Concrete Poles
- G. Federal Aviation Administration (FAA):
- AC 70/7460-IK-07.....Obstruction Lighting and Marking
- AC 150/5345-43F-06.....Obstruction Lighting Equipment
- H. Illuminating Engineering Society of North America (IESNA):
- HB-9-00.....Lighting Handbook
- RP-8-05.....Roadway Lighting
- LM-52-03.....Photometric Measurements of Roadway Sign  
Installations
- LM-72-10.....Directional Positioning of Photometric Data
- LM-79-08.....Approved Method for the Electrical and  
Photometric Measurements of Solid-State Lighting  
Products
- LM-80-08.....Approved Method for Measuring Lumen Maintenance  
of LED Light Sources
- TM-15-07.....Backlight, Uplight and Glare (BUG) Ratings
- I. National Electrical Manufacturers Association (NEMA):
- C136.3-05 .....For Roadway and Area Lighting Equipment -  
Luminaire Attachments
- ICS 2-00 (R2005) .....Controllers, Contactors and Overload Relays  
Rated 600 Volts
- ICS 6-93 (R2006) .....Enclosures
- J. National Fire Protection Association (NFPA):
- 70-11 .....National Electrical Code (NEC)

## K. Underwriters Laboratories, Inc. (UL):

496-08 .....Lampholders

773-95.....Plug-In, Locking Type Photocontrols for Use  
with Area Lighting773A-06 .....Nonindustrial Photoelectric Switches for  
Lighting Control

1598-08 .....Luminaires

8750-09.....Light Emitting Diode (LED) Equipment for Use in  
Lighting Products**1.6 DELIVERY, STORAGE, AND HANDLING**

Provide manufacturer's standard provisions for protecting pole finishes during transport, storage, and installation. Do not store poles on ground. Store poles so they are at least 305 mm (12 inches) above ground level and growing vegetation. Do not remove factory-applied pole wrappings until just before installing pole.

**PART 2 - PRODUCTS****2.1 GENERAL REQUIREMENTS**

Luminaires, materials and equipment shall be in accordance with NEC, UL, ANSI, and as shown on the drawings and specified.

**2.2 POLES NOT USED.****2.3 FOUNDATIONS FOR BOLLARDS**

- A. Foundations shall be cast-in-place concrete, having 3000 psi minimum 28-day compressive strength.
- B. Foundations shall support the effective projected area of the specified pole, arm(s), luminaire(s), and accessories, such as shields, banner arms, and banners, under wind conditions previously specified in this section.
- C. Place concrete in spirally-wrapped treated paper forms for round foundations, and construct forms for square foundations.
- D. Rub-finish and round all above-grade concrete edges to approximately 6 mm (0.25-inch) radius.
- E. Anchor bolt assemblies and reinforcing of concrete foundations shall be as shown on the drawings. Anchor bolts shall be in a welded cage or properly positioned by the tie wire to stirrups.
- F. Prior to concrete pour, install electrode per Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS.

## 2.4 LUMINAIRES

- A. Luminaires shall be weatherproof, heavy duty, outdoor types designed for efficient light utilization, adequate dissipation of lamp and ballast heat, and safe cleaning and relamping.
- B. Illumination distribution patterns, BUG ratings and cutoff types as defined by the IESNA shall be as shown on the drawings.
- C. Incorporate ballasts in the luminaire housing, except where otherwise shown on the drawings.
- D. Lenses shall be frame-mounted, heat-resistant, borosilicate glass, with prismatic refractors, unless otherwise shown on the drawings. Attach the frame to the luminaire housing by hinges or chain. Use heat and aging-resistant, resilient gaskets to seal and cushion lenses and refractors in luminaire doors.
- E. Lamp sockets for high intensity discharge (H.I.D) fixture shall have locking-type porcelain enclosures in conformance to the applicable requirements of ANSI C81.61-09 and UL 496-08.
- F. Pre-wire internal components to terminal strips at the factory.
- G. Bracket-mounted luminaires shall have leveling provisions and clamp-type adjustable slip-fitters with locking screws.
- H. Materials shall be rustproof. Latches and fittings shall be non-ferrous metal.
- I. Provide manufacturer's standard finish, as scheduled on the drawings. Where indicated on drawings, match finish process and color of pole or support materials. Where indicated on drawings, provide finishes as indicated in Section 09 06 00, SCHEDULE FOR FINISHES.
- J. Luminaires shall carry factory labels, showing complete, specific lamp and ballast information.

## 2.5 LAMPS

- A. Install the proper lamps in every luminaire installed and every existing luminaire relocated or reinstalled as shown on the drawings.
- B. Not Used.
- C. Not Used.
- D. Not Used.
- E. Not Used.
- F. LED sources shall meet the following requirements:
  - 1. Operating temperature rating shall be between -40 degrees C (-40 degrees F) and 50 degrees C (120 degrees F).
  - 2. Correlated Color Temperature (CCT): 4000K.

3. Color Rendering Index (CRI):  $\geq 85$ .
4. The manufacturer shall have performed reliability tests on the LEDs luminaires complying with Illuminating Engineering Society (IES) LM79 for photometric performance and LM80 for lumen maintenance and L70 life.

G. Mercury vapor lamps shall not be used.

## **2.6 HIGH INTENSITY DISCHARGE BALLASTS NOT USED.**

## **2.7 METAL HALIDE CORE AND COIL BALLASTS NOT USED.**

## **2.8 METAL HALIDE ELECTRONIC BALLASTS NOT USED.**

## **2.9 LED DRIVERS**

- A. LED drivers shall meet the following requirements:
1. Drivers shall have a minimum efficiency of 85%.
  2. Starting Temperature:  $-40$  degrees C ( $-40$  degrees F).
  3. Input Voltage: 120 to 480 ( $\pm 10\%$ ) volt.
  4. Power Supplies: Class I or II output.
  5. Surge Protection: The system must survive 250 repetitive strikes of "C Low" (C Low: 6kV/1.2 x 50  $\mu$ s, 10kA/8 x 20  $\mu$ s) waveforms at 1-minute intervals with less than 10% degradation in clamping voltage. "C Low" waveforms are as defined in IEEE/ASNI C62.41.2-2002, Scenario 1 Location Category C.
  6. Power Factor (PF):  $\geq 0.90$ .
  7. Total Harmonic Distortion (THD):  $\leq 20\%$ .
  8. Comply with FCC Title 47 CFR Part 18 Non-consumer RFI/EMI Standards.
  9. Drivers shall be reduction of hazardous substances (ROHS)-compliant.

## **2.10 EXISTING LIGHTING SYSTEMS**

- A. For modifications or additions to existing lighting systems, the new components shall be compatible with the existing systems.
- B. New poles and luminaires shall have approximately the same configurations, dimensions, lamping and reflector type as the existing poles and luminaires, except where otherwise shown on the drawings.

## **2.11 OBSTRUCTION LIGHTING NOT USED.**

# **PART 3 - EXECUTION**

## **3.1 INSTALLATION**

- A. Install lighting in accordance with the NEC, as shown on the drawings, and in accordance with manufacturer's recommendations.
- B. Pole Foundations:
1. Excavate only as necessary to provide sufficient working clearance for installation of forms and proper use of tamper to the full depth

- of the excavation. Prevent surface water from flowing into the excavation. Thoroughly compact backfill with compacting arranged to prevent pressure between conductor, jacket, or sheath, and the end of conduit.
2. Set anchor bolts according to anchor-bolt templates furnished by the pole manufacturer.
  3. Install poles as necessary to provide a permanent vertical position with the bracket arm in proper position for luminaire location.
  4. After the poles have been installed, shimmed, and plumbed, grout the spaces between the pole bases and the concrete base with non-shrink concrete grout material. Provide a plastic or copper tube, of not less than 9 mm (0.375-inch) inside diameter through the grout, tight to the top of the concrete base to prevent moisture weeping from the interior of the pole.
- C. Install lamps in each luminaire.
- D. Adjust luminaires that require field adjustment or aiming.

### **3.2 GROUNDING**

Ground noncurrent-carrying parts of equipment, including metal poles, luminaires, mounting arms, brackets, and metallic enclosures, as specified in Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS. Where copper grounding conductor is connected to a metal other than copper, provide specially-treated or lined connectors suitable and listed for this purpose.

### **3.3 ACCEPTANCE CHECKS AND TESTS**

Verify operation after installing luminaires and energizing circuits.

- - - E N D - - -



**SECTION 27 05 11**  
**REQUIREMENTS FOR COMMUNICATIONS INSTALLATIONS**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section includes common requirements to communications installations and applies to all sections of Division 27 and Division 28.
- B. Provide completely functioning communications systems.
- C. Comply with VAAR 852.236.91 and FAR clause 52.236-21 in circumstance of a need for additional detail or conflict between drawings, specifications, reference standards or code.

**1.2 REFERENCES**

- A. Abbreviations and Acronyms
  - 1. Refer to <http://www.cfm.va.gov/til/sdetail.asp> for Division 00, ARCHITECTURAL ABBREVIATIONS.
  - 2. Additional Abbreviations and Acronyms:

A	Ampere
AC	Alternating Current
AE	Architect and Engineer
AFF	Above Finished Floor
AHJ	Authority Having Jurisdiction
ANSI	American National Standards Institute
AWG	American Wire Gauge (refer to STP and UTP)
AWS	Advanced Wireless Services
BCT	Bonding Conductor for Telecommunications (also Telecommunications Bonding Conductor (TBC))
BDA	Bi-Directional Amplifier
BICSI	Building Industry Consulting Service International
BIM	Building Information Modeling
BOM	Bill of Materials
BTU	British Thermal Units
BUCR	Back-up Computer Room
BTS	Base Transceiver Station
CAD	AutoCAD
CBOPC	Community Based Out Patient Clinic

CBC	Coupled Bonding Conductor
CBOC	Community Based Out Patient Clinic (refer to CBOPC, OPC, VAMC)
CCS	TIP's Cross Connection System (refer to VCCS and HCCS)
CFE	Contractor Furnished Equipment
CFM	US Department of Veterans Affairs Office of Construction and Facilities Management
CFR	Consolidated Federal Regulations
CIO	Communication Information Officer (Facility, VISN or Region)
cm	Centimeters
CO	Central Office
COR	Contracting Officer Representative
CPU	Central Processing Unit
CSU	Customer Service Unit
CUP	Conditional Use Permit(s) - Federal/GSA for VA
dB	Decibel
dBm	Decibel Measured
dBmV	Decibel per milli-Volt
DC	Direct Current
DEA	United States Drug Enforcement Administration
DSU	Data Service Unit
EBC	Equipment Bonding Conductor
ECC	Engineering Control Center (refer to DCR, EMCR)
EDGE	Enhanced Data (Rates) for GSM Evolution
EDM	Electrical Design Manual
EMCR	Emergency Management Control Room (refer to DCR, ECC)
EMI	Electromagnetic Interference (refer to RFI)
EMS	Emergency Medical Service
EMT	Electrical Metallic Tubing or thin wall conduit
ENTR	Utilities Entrance Location (refer to DEMARC, POTS, LEC)



EPBX	Electronic Digital Private Branch Exchange
ESR	Vendor's Engineering Service Report
FA	Fire Alarm
FAR	Federal Acquisition Regulations in Chapter 1 of Title 48 of Code of Federal Regulations
FMS	VA's Headquarters or Medical Center Facility's Management Service
FR	Frequency (refer to RF)
FTS	Federal Telephone Service
GFE	Government Furnished Equipment
GPS	Global Positioning System
GRC	Galvanized Rigid Metal Conduit
GSM	Global System (Station) for Mobile
HCCS	TIP's Horizontal Cross Connection System (refer to CCS & VCCS)
HDPE	High Density Polyethylene Conduit
HDTV	Advanced Television Standards Committee High-Definition Digital Television
HEC	Head End Cabinets(refer to HEIC, PA)
HEIC	Head End Interface Cabinets(refer to HEC, PA)
HF	High Frequency (Radio Band; Re FR, RF, VHF & UHF)
HSPA	High Speed Packet Access
HZ	Hertz
IBT	Intersystem Bonding Termination (NEC 250.94)
IC	Intercom
ICRA	Infectious Control Risk Assessment
IDEN	Integrated Digital Enhanced Network
IDC	Insulation Displacement Contact
IDF	Intermediate Distribution Frame
ILSM	Interim Life Safety Measures
IMC	Rigid Intermediate Steel Conduit
IRM	Department of Veterans Affairs Office of Information Resources Management

ISDN	Integrated Services Digital Network
ISM	Industrial, Scientific, Medical
IWS	Intra-Building Wireless System
LAN	Local Area Network
LBS	Location Based Services, Leased Based Systems
LEC	Local Exchange Carrier (refer to DEMARC, PBX & POTS)
LED	Light Emitting Diode
LMR	Land Mobile Radio
LTE	Long Term Evolution, or 4G Standard for Wireless Data Communications Technology
M	Meter
MAS	Medical Administration Service
MATV	Master Antenna Television
MCR	Main Computer Room
MCOR	Main Computer Operators Room
MDF	Main Distribution Frame
MH	Manholes or Maintenance Holes
MHz	Megahertz ( $10^6$ Hz)
mm	Millimeter
MOU	Memorandum of Understanding
MW	Microwave (RF Band, Equipment or Services)
NID	Network Interface Device (refer to DEMARC)
NEC	National Electric Code
NOR	Network Operations Room
NRTL	OSHA Nationally Recognized Testing Laboratory
NS	Nurse Stations
NTIA	U.S. Department of Commerce National Telecommunications and Information Administration
OEM	Original Equipment Manufacturer
OI&T	Office of Information and Technology
OPC	VA's Outpatient Clinic (refer to CBOC, VAMC)
OSH	Department of Veterans Affairs Office of Occupational Safety and Health

OSHA	United States Department of Labor Occupational Safety and Health Administration
OTDR	Optical Time-Domain Reflectometer
PA	Public Address System (refer to HE, HEIC, RPEC)
PBX	Private Branch Exchange (refer to DEMARC, LEC, POTS)
PCR	Police Control Room (refer to SPCC, could be designated SCC)
PCS	Personal Communications Service (refer to UPCS)
PE	Professional Engineer
PM	Project Manager
PoE	Power over Ethernet
POTS	Plain Old Telephone Service (refer to DEMARC, LEC, PBX)
PSTN	Public Switched Telephone Network
PSRAS	Public Safety Radio Amplification Systems
PTS	Pay Telephone Station
PVC	Poly-Vinyl Chloride
PWR	Power (in Watts)
RAN	Radio Access Network
RBB	Rack Bonding Busbar
RE	Project Manager or Senior Project Manager
RF	Radio Frequency (refer to FR)
RFI	Radio Frequency Interference (refer to EMI)
RFID	RF Identification (Equipment, System or Personnel)
RMC	Rigid Metal Conduit
RMU	Rack Mounting Unit
RPEC	Radio Paging Equipment Cabinets(refer to HEC, HEIC, PA)
RTLS	Real Time Location Service or System
RUS	Rural Utilities Service
SCC	Security Control Console (refer to PCR, SPCC)
SMCS	Spectrum Management and Communications Security (COMSEC)

SFO	Solicitation for Offers
SME	Subject Matter Experts (refer to AHJ)
SMR	Specialized Mobile Radio
SMS	Security Management System
SNMP	Simple Network Management Protocol
SPCC	Security Police Control Center (refer to PCR, SMS)
STP	Shielded Balanced Twisted Pair (refer to UTP)
STR	Stacked Telecommunications Room
TAC	VA's Technology Acquisition Center, Austin, Texas
TCO	Telecommunications Outlet
TER	Telephone Equipment Room
TGB	Telecommunications Grounding Busbar (also Secondary Bonding Busbar (SBB))
TIP	Telecommunications Infrastructure Plant
TMGB	Telecommunications Main Grounding Busbar (also Primary Bonding Busbar (PBB))
TMS	Traffic Management System
TOR	Telephone Operators Room
TP	Balanced Twisted Pair (refer to STP and UTP)
TR	Telecommunications Room (refer to STR)
TWP	Twisted Pair
UHF	Ultra High Frequency (Radio)
UMTS	Universal Mobile Telecommunications System
UPCS	Unlicensed Personal Communications Service (refer to PCS)
UPS	Uninterruptible Power Supply
USC	United States Code
UTP	Unshielded Balanced Twisted Pair (refer to TP and STP)
UV	Ultraviolet
V	Volts
VAAR	Veterans Affairs Acquisition Regulation
VACO	Veterans Affairs Central Office

VAMC	VA Medical Center (refer to CBOC, OPC, VACO)
VCCS	TIP's Vertical Cross Connection System (refer to CCS and HCCS)
VHF	Very High Frequency (Radio)
VISN	Veterans Integrated Services Network (refers to geographical region)
VSWR	Voltage Standing Wave Ratio
W	Watts
WEB	World Electronic Broadcast
WiMAX	Worldwide Interoperability (for MW Access)
WI-FI	Wireless Fidelity
WMTS	Wireless Medical Telemetry Service
WSP	Wireless Service Providers

B. Definitions:

1. Access Floor: Pathway system of removable floor panels supported on adjustable pedestals to allow cable placement in area below.
2. BNC Connector (BNC): United States Military Standard MIL-C-39012/21 bayonet-type coaxial connector with quick twist mating/unmating, and two lugs preventing accidental disconnection from pulling forces on cable.
3. Bond: Permanent joining of metallic parts to form an electrically conductive path to ensure electrical continuity and capacity to safely conduct any currents likely to be imposed to earth ground.
4. Bundled Microducts: All forms of jacketed microducts.
5. Conduit: Includes all raceway types specified.
6. Conveniently Accessible: Capable of being reached without use of ladders, or without climbing or crawling under or over obstacles such as, motors, pumps, belt guards, transformers, piping, ductwork, conduit and raceways.
7. Distributed (in house) Antenna System (DAS): An Emergency Radio Communications System installed for Emergency Responder (or first responders and Government personnel) use while inside facility to maintain contact with each respective control point; refer to Section 27 53 19, DISTRIBUTED RADIO ANTENNA (WITHIN BUILDING) EQUIPMENT AND SYSTEMS.

8. DEMARC, Extended DMARC or ENTR: Service provider's main point of demarcation owned by LEC or service provider and establishes a physical point where service provider's responsibilities for service and maintenance end. This point is called NID, in data networks.
9. Effectively Grounded: Intentionally bonded to earth through connections of low impedance having current carrying capacity to prevent buildup of currents and voltages resulting in hazard to equipment or persons.
10. Electrical Supervision: Analyzing a system's function and components (i.e. cable breaks / shorts, inoperative stations, lights, LEDs and states of change, from primary to backup) on a 24/7/365 basis; provide aural and visual emergency notification signals to minimum two remote designated or accepted monitoring stations.
11. Electrostatic Interference (ESI) or Electrostatic Discharge Interference: Refer to EMI and RFI.
12. Emergency Call Systems: Wall units (in parking garages and stairwells) and pedestal mounts (in parking lots) typically provided with a strobe, camera and two-way audio communication functions.
13. Project 25 (2014) (P25 (TIA-102 Series)): Set of standards for local, state and Federal public safety organizations and agencies digital LMR services. P25 is applicable to LMR equipment authorized or licensed under the US Department of Commerce National Telecommunications and Information Administration or FCC rules and regulations, and is a required standard capability for all LMR equipment and systems.
14. Grounding Electrode Conductor: (GEC) Conductor connected to earth grounding electrode.
15. Grounding Electrode System: Electrodes through which an effective connection to earth is established, including supplementary, communications system grounding electrodes and GEC.
16. Grounding Equalizer or Backbone Bonding Conductor (BBC): Conductor that interconnects elements of telecommunications grounding infrastructure.
17. Head End (HE): Equipment, hardware and software, or a master facility at originating point in a communications system designed for centralized communications control, signal processing, and distribution that acts as a common point of connection between equipment and devices connected to a network of interconnected

- equipment, possessing greatest authority for allowing information to be exchanged, with whom other equipment is subordinate.
18. Microducts: All forms of air blown fiber pathways.
  19. Ohm: A unit of restive measurement.
  20. Received Signal Strength Indication (RSSI): A measurement of power present in a received RF signal.
  21. Service Provider Demarcation Point (SPDP): Not owned by LEC or service provider, but designated by Government as point within facility considered the DEMARC.
  22. Sound (SND): Changing air pressure to audible signals over given time span.
  23. System: Specific hardware, firmware, and software, functioning together as a unit, performing task for which it was designed.
  24. Telecommunications Bonding Backbone (TBB): Conductors of appropriate size (minimum 53.49 mm<sup>2</sup> [1/0 AWG]) stranded copper wire, that connect to Grounding Electrode System and route to telecommunications main grounding busbar (TMGB) and circulate to interconnect various TGBs and other locations shown on drawings.
  25. Voice over Internet Protocol (VoIP): A telephone system in which voice signals are converted to packets and transmitted over LAN network using Transmission Control Protocol (TCP)/Internet Protocol (IP). VA'S VoIP is not listed or coded for life and public safety, critical, emergency or other protection functions. When VoIP system or equipment is provided instead of PBX system or equipment, each TR (STR) and DEMARC requires increased AC power provided to compensate for loss of PBX's telephone instrument line power; and, to compensate for absence of PBX's UPS capability.
  26. Wide Area Network (WAN): A digital network that transcends localized LANs within a given geographic location. VA'S WAN/LAN is not nationally listed or coded for life and public safety, critical, emergency or other safety functions.

### 1.3 APPLICABLE PUBLICATIONS

- A. Applicability of Standards: Unless documents include more stringent requirements, applicable construction industry standards have same force and effect as if bound or copied directly into the documents to extent referenced. Such standards are made a part of these documents by reference.

1. Each entity engaged in construction must be familiar with industry standards applicable to its construction activity.
2. Obtain standards directly from publication source, where copies of standards are needed to perform a required construction activity.

B. Government Codes, Standards and Executive Orders: Refer to

<http://www.cfm.va.gov/TIL/cPro.asp>:

1. Federal Communications Commission, (FCC) CFR, Title 47:
 

Part 15	Restrictions of use for Part 15 listed RF Equipment in Safety of Life Emergency Functions and Equipment Locations
Part 47	Chapter A, Paragraphs 6.1-6.23, Access to Telecommunications Service, Telecommunications Equipment and Customer Premises Equipment
Part 58	Television Broadcast Service
Part 73	Radio and Television Broadcast Rules
Part 90	Rules and Regulations, Appendix C
Form 854	Antenna Structure Registration
Chapter XXIII	National Telecommunications and Information Administration (NTIA, P/O Commerce, Chapter XXIII) the 'Red Book'- Chapters 7, 8 & 9 compliments CFR, Title 47, FCC Part 15, RF Restriction of Use and Compliance in "Safety of Life" Functions & Locations
2. US Department of Agriculture, (Title 7, USC, Chapter 55, Sections 2201, 2202 & 2203:RUS 1755 Telecommunications Standards and Specifications for Materials, Equipment and Construction:
 

RUS Bull 1751F-640	Design of Buried Cable Plant, Physical Considerations
RUS Bull 1751F-643	Underground Plant Design
RUS Bull 1751F-815	Electrical Protection of Outside Plants,
RUS Bull 1753F-201	Acceptance Tests of Telecommunications Plants (PC-4)
RUS Bull 1753F-401	Splicing Copper and Fiber Optic Cables (PC-2)
RUS Bull 345-50	Trunk Carrier Systems (PE-60)
RUS Bull 345-65	Shield Bonding Connectors (PE-65)
RUS Bull 345-72	Filled Splice Closures (PE-74)
RUS Bull 345-83	Gas Tube Surge Arrestors (PE-80)



## 3. US Department of Commerce/National Institute of Standards

Technology, (NIST):

FIPS PUB 1-1	Telecommunications Information Exchange
FIPS PUB 100/1	Interface between Data Terminal Equipment (DTE) Circuit Terminating Equipment for operation with Packet Switched Networks, or Between Two DTEs, by Dedicated Circuit
FIPS PUB 140/2	Telecommunications Information Security Algorithms
FIPS PUB 143	General Purpose 37 Position Interface between DTE and Data Circuit Terminating Equipment
FIPS 160/2	Electronic Data Interchange (EDI),
FIPS 175	Federal Building Standard for Telecommunications Pathway and Spaces
FIPS 191	Guideline for the Analysis of Local Area Network Security
FIPS 197	Advanced Encryption Standard (AES)
FIPS 199	Standards for Security Categorization of Federal Information and Information Systems

## 4. US Department of Defense, (DoD):

MIL-STD-188-110	Interoperability and Performance Standards for Data Modems
MIL-STD-188-114	Electrical Characteristics of Digital Interface Circuits
MIL-STD-188-115	Communications Timing and Synchronizations Subsystems
MIL-C-28883	Advanced Narrowband Digital Voice Terminals
MIL-C-39012/21	Connectors, Receptacle, Electrical, Coaxial, Radio Frequency, (Series BNC (Uncabled), Socket Contact, Jam Nut Mounted, Class 2)

## 5. US Department of Health and Human Services:

The Health Insurance Portability and Accountability Act of 1996  
(HIPAA) Privacy, Security and Breach Notification Rules

## 6. US Department of Justice:

2010 Americans with Disabilities Act Standards for Accessible Design  
(ADAAD).

7. US Department of Labor, (DoL) - Public Law 426-62 - CFR, Title 29, Part 1910, Chapter XVII - Occupational Safety and Health Administration (OSHA), Occupational Safety and Health Standards):
  - Subpart 7                      Approved NRTLs; obtain a copy at  
[http://www.osha.gov/dts/otpca/nrtl/faq\\_nrtl.htm](http://www.osha.gov/dts/otpca/nrtl/faq_nrtl.htm)  
1)
  - Subpart 35                      Compliance with NFPA 101, Life Safety Code
  - Subpart 36                      Design and Construction Requirements for Exit Routes
  - Subpart 268                      Telecommunications
  - Subpart 305                      Wiring Methods, Components, and Equipment for General Use
  - Subpart 508                      Americans with Disabilities Act Accessibility Guidelines; technical requirement for accessibility to buildings and facilities by individuals with disabilities
8. US Department of Transportation, (DoT):
  - a. Public Law 85-625, CFR, Title 49, Part 1, Subpart C - Federal Aviation Administration (FAA):AC 110/460-ID & AC 707 / 460-2E - Advisory Circulars Standards for Construction of Antenna Towers, and 7450 and 7460-2 - Antenna Construction Registration Forms.
9. US Department of Veterans Affairs (VA): Office of Telecommunications (OI&T), MP-6, PART VIII, TELECOMMUNICATIONS, CHAPTER 5, AUDIO, RADIO AND TELEVISION (and COMSEC) COMMUNICATIONS SYSTEMS: Spectrum Management and COMSEC Service (SMCS), AHJ for:
  - a. CoG, "Continuance of Government" communications guidelines and compliance.
  - b. COMSEC, "VA wide coordination and control of security classified communication assets."
  - c. COOP, "Continuance of Operations" emergency communications guidelines and compliance.
  - d. FAA, FCC, and US Department of Commerce National Telecommunications and Information Administration, "VA wide RF Co-ordination, Compliance and Licensing."
  - e. Handbook 6100 - Telecommunications: Cyber and Information Security Office of Cyber and Information Security, and Handbook 6500 - Information Security Program.

- f. Low Voltage Special Communications Systems "Design, Engineering, Construction Contract Specifications and Drawings Conformity, Proof of Performance Testing, VA Compliance and Life Safety Certifications for CFM and VA Facility Low Voltage Special Communications Projects (except Fire Alarm, Telephone and Data Systems)."
  - g. SATCOM, "Satellite Communications" guidelines and compliance, and Security and Law Enforcement Systems - "Coordinates the Design, Engineering, Construction Contract Specifications and Drawings Conformity, Proof of Performance Testing, VA Compliance, DEA and Public Safety Certification(s) for CFM and VA Facility Security Low Voltage Special Communications and Physical Security Projects.
  - h. VHA's National Center for Patient Safety - Veterans Health Administration (VHA) Warning System, Failure of Medical Alarm Systems using Paging Technology to Notify Clinical Staff, July 2004.
  - i. VA's CEOSH, concurrence with warning identified in VA Directive 7700.
  - j. Wireless and Handheld Devices, "Guidelines and Compliance,"
  - k. Office of Security and Law Enforcement: VA Directive 0730 and Health Special Presidential Directive (HSPD)-12.
- C. NRTL Standards: Refer to <https://www.osha.gov/dts/otpc/nrtl/index.html>
- 1. Canadian Standards Association (CSA); same tests as presented by UL
  - 2. Communications Certifications Laboratory (CEL); same tests as presented by UL.
  - 3. Intertek Testing Services NA, Inc., (ITSNA), formerly Edison Testing Laboratory (ETL) same tests as presented by UL).
  - 4. Underwriters Laboratory (UL):
 

1-2005	Flexible Metal Conduit
5-2011	Surface Metal Raceway and Fittings
6-2007	Rigid Metal Conduit
44-010	Thermoset-Insulated Wires and Cables
50-1995	Enclosures for Electrical Equipment
65-2010	Wired Cabinets
83-2008	Thermoplastic-Insulated Wires and Cables
96-2005	Lightning Protection Components

96A-2007	Installation Requirements for Lightning Protection Systems
360-2013	Liquid-Tight Flexible Steel Conduit
444-2008	Communications Cables
467-2013	Grounding and Bonding Equipment
486A-486B-2013	Wire Connectors
486C-2013	Splicing Wire Connectors
486D-2005	Sealed Wire Connector Systems
486E-2009	Standard for Equipment Wiring Terminals for Use with Aluminum and/or Copper Conductors
493-2007	Thermoplastic-Insulated Underground Feeder and Branch Circuit Cable
497/497A/497B/497C	Protectors for Paired Conductors/Communications Circuits/Data Communications and Fire Alarm Circuits/coaxial circuits/voltage protections/Antenna Lead In
497D/497E	
510-2005	Polyvinyl Chloride, Polyethylene and Rubber Insulating Tape
514A-2013	Metallic Outlet Boxes
514B-2012	Fittings for Cable and Conduit
514C-1996	Nonmetallic Outlet Boxes, Flush-Device Boxes and Covers
651-2011	Schedule 40 and 80 Rigid PVC Conduit
651A-2011	Type EB and A Rigid PVC Conduit and HDPE Conduit
797-2007	Electrical Metallic Tubing
884-2011	Underfloor Raceways and Fittings
1069-2007	Hospital Signaling and Nurse Call Equipment
1242-2006	Intermediate Metal Conduit
1449-2006	Standard for Transient Voltage Surge Suppressors
1479-2003	Fire Tests of Through-Penetration Fire Stops
1480-2003	Speaker Standards for Fire Alarm, Emergency, Commercial and Professional use
1666-2007	Standard for Wire/Cable Vertical (Riser) Tray Flame Tests

1685-2007	Vertical Tray Fire Protection and Smoke Release Test for Electrical and Fiber Optic Cables
1861-2012	Communication Circuit Accessories
1863-2013	Standard for Safety, communications Circuits Accessories
1865-2007	Standard for Safety for Vertical-Tray Fire Protection and Smoke-Release Test for Electrical and Optical-Fiber Cables
2024-2011	Standard for Optical Fiber Raceways
2024-2014	Standard for Cable Routing Assemblies and Communications Raceways
2196-2001	Standard for Test of Fire Resistive Cable
60950-1 ed. 2-2014	Information Technology Equipment Safety

#### D. Industry Standards:

##### 1. Advanced Television Systems Committee (ATSC):

A/53 Part 1: 2013	ATSC Digital Television Standard, Part 1, Digital Television System
A/53 Part 2: 2011	ATSC Digital Television Standard, Part 2, RF/Transmission System Characteristics
A/53 Part 3: 2013	ATSC Digital Television Standard, Part 3, Service Multiplex and Transport System Characteristics
A/53 Part 4: 2009	ATSC Digital Television Standard, Part 4, MPEG-2 Video System Characteristics
A/53 Part 5: 2014	ATSC Digital Television Standard, Part 5, AC-3 Audio System Characteristics
A/53 Part 6: 2014	ATSC digital Television Standard, Part 6, Enhanced AC-3 Audio System Characteristics

##### 2. American Institute of Architects (AIA): 2006 Guidelines for Design & Construction of Health Care Facilities.

##### 3. American Society of Mechanical Engineers (ASME):

A17.1 (2013)	Safety Code for Elevators and Escalators Includes Requirements for Elevators, Escalators, Dumbwaiters, Moving Walks, Material Lifts, and Dumbwaiters with Automatic Transfer Devices
17.3 (2011)	Safety Code for Existing Elevators and Escalators

- 17.4 (2009) Guide for Emergency Personnel
- 17.5 (2011) Elevator and Escalator Electrical Equipment
- 4. American Society for Testing and Materials (ASTM):
  - B1 (2001) Standard Specification for Hard-Drawn Copper Wire
  - B8 (2004) Standard Specification for Concentric-Lay-Stranded Copper Conductors, Hard, Medium-Hard, or Soft
  - D1557 (2012) Standard Test Methods for Laboratory Compaction Characteristics of Soil Using Modified Effort 56,000 ft-lbf/ft<sup>3</sup> (2,700 kN-m/m<sup>3</sup>)
  - D2301 (2004) Standard Specification for Vinyl Chloride Plastic Pressure Sensitive Electrical Insulating Tape
  - B258-02 (2008) Standard Specification for Standard Nominal Diameters and Cross-Sectional Areas of AWG Sizes of Solid Round Wires Used as Electrical Conductors
  - D709-01(2007) Standard Specification for Laminated Thermosetting Materials
  - D4566 (2008) Standard Test Methods for Electrical Performance Properties of Insulations and Jackets for Telecommunications Wire and Cable
- 5. American Telephone and Telegraph Corporation (AT&T) - Obtain following AT&T Publications at <https://ebiznet.sbc.com/SBCNEBS/>):
  - ATT-TP-76200 (2013) Network Equipment and Power Grounding, Environmental, and Physical Design Requirements
  - ATT-TP-76300(2012) Merged AT&T Affiliate Companies Installation Requirements
  - ATT-TP-76305 (2013) Common Systems Cable and Wire Installation and Removal Requirements - Cable Racks and Raceways
  - ATT-TP-76306 (2009) Electrostatic Discharge Control
  - ATT-TP-76400 (2012) Detail Engineering Requirements
  - ATT-TP-76402 (2013) AT&T Raised Access Floor Engineering and Installation Requirements
  - ATT-TP-76405 (2011) Technical Requirements for Supplemental Cooling Systems in Network Equipment Environments

- ATT-TP-76416 (2011) Grounding and Bonding Requirements for Network Facilities
- ATT-TP-76440 (2005) Ethernet Specification
- ATT-TP-76450 (2013) Common Systems Equipment Interconnection Standards for AT&T Network Equipment Spaces
- ATT-TP-76461 (2008) Fiber Optic Cleaning
- ATT-TP-76900 (2010) AT&T Installation Testing Requirement
- ATT-TP-76911 (1999) AT&T LEC Technical Publication Notice
6. British Standards Institution (BSI):
- BS EN 50109-2 Hand Crimping Tools - Tools for The Crimp Termination of Electric Cables and Wires for Low Frequency and Radio Frequency Applications - All Parts & Sections. October 1997
7. Building Industry Consulting Service International(BICSI):
- ANSI/BICSI 002-2011 Data Center Design and Implementation Best Practices
- ANSI/BICSI 004-2012 Information Technology Systems Design and Implementation Best Practices for Healthcare Institutions and Facilities
- ANSI/NECA/BICSI 568-2006 Standard for Installing Commercial Building Telecommunications Cabling
- NECA/BICSI 607-2011 Standard for Telecommunications Bonding and Grounding Planning and Installation Methods for Commercial Buildings
- ANSI/BICSI 005-2013 Electronic Safety and Security (ESS) System Design and Implementation Best Practices
8. Electronic Components Assemblies and Materials Association, (ECA).
- ECA EIA/RS-270 (1973) Tools, Crimping, Solderless Wiring Devices - Recommended Procedures for User Certification
- EIA/ECA 310-E (2005) Cabinets, and Associated Equipment
9. Facility Guidelines Institute: 2010 Guidelines for Design and Construction of Health Care Facilities.
10. Insulated Cable Engineers Association (ICEA):
- ANSI/ICEA S-80-576-2002 Category 1 & 2 Individually Unshielded Twisted-Pair Indoor Cables for Use in Communications Wiring Systems

- ANSI/ICEA  
S-84-608-2010 Telecommunications Cable, Filled Polyolefin Insulated Copper Conductor, S-87-640(2011) Optical Fiber Outside Plant Communications Cable
- ANSI/ICEA  
S-90-661-2012 Category 3, 5, & 5e Individually Unshielded Twisted-Pair Indoor Cable for Use in General Purpose and LAN Communication Wiring Systems
- S-98-688 (2012) Broadband Twisted Pair Cable Aircore, Polyolefin Insulated, Copper Conductors
- S-99-689 (2012) Broadband Twisted Pair Cable Filled, Polyolefin Insulated, Copper Conductors
- ICEA S-102-700 (2004) Category 6 Individually Unshielded Twisted Pair Indoor Cables (With or Without an Overall Shield) for use in Communications Wiring Systems Technical Requirements
11. Institute of Electrical and Electronics Engineers (IEEE):
- ISSN 0739-5175 March-April 2008 Engineering in Medicine and Biology Magazine, IEEE (Volume: 27, Issue:2) Medical Grade-Mission Critical-Wireless Networks
- IEEE C2-2012 National Electrical Safety Code (NESC)
- C62.41.2-2002/  
Cor 1-2012 IEEE Recommended Practice on Characterization of Surges in Low-Voltage (1000 V and Less) AC Power Circuits 4)
- C62.45-2002 IEEE Recommended Practice on Surge Testing for Equipment Connected to Low-Voltage (1000 V and Less) AC Power Circuits
- 81-2012 IEEE Guide for Measuring Earth Resistivity, Ground Impedance, and Earth Surface Potentials of a Grounding System
- 100-1992 IEEE the New IEEE Standards Dictionary of Electrical and Electronics Terms
- 602-2007 IEEE Recommended Practice for Electric Systems in Health Care Facilities



- 1100-2005 IEEE Recommended Practice for Powering and Grounding Electronic Equipment
12. International Code Council:  
AC193 (2014) Mechanical Anchors in Concrete Elements
13. International Organization for Standardization (ISO):  
ISO/TR 21730 (2007) Use of Mobile Wireless Communication and Computing Technology in Healthcare Facilities - Recommendations for Electromagnetic Compatibility (Management of Unintentional Electromagnetic Interference) with Medical Devices
14. National Electrical Manufacturers Association (NEMA):  
NEMA 250 (2008) Enclosures for Electrical Equipment (1,000V Maximum)  
ANSI C62.61 (1993) American National Standard for Gas Tube Surge Arresters on Wire Line Telephone Circuits  
ANSI/NEMA FB 1 (2012) Fittings, Cast Metal Boxes and Conduit Bodies for Conduit, Electrical Metallic Tubing EMT) and Cable  
ANSI/NEMA OS 1 (2009) Sheet-Steel Outlet Boxes, Device Boxes, Covers, and Box Supports  
NEMA SB 19 (R2007) NEMA Installation Guide for Nurse Call Systems  
TC 3 (2004) Polyvinyl Chloride (PVC) Fittings for Use with Rigid PVC Conduit and Tubing  
NEMA VE 2 (2006) Cable Tray Installation Guidelines
15. National Fire Protection Association (NFPA):  
70E-2015 Standard for Electrical Safety in the Workplace  
70-2014 National Electrical Code (NEC)  
72-2013 National Fire Alarm Code  
75-2013 Standard for the Fire Protection of Information Technological Equipment  
76-2012 Recommended Practice for the Fire Protection of Telecommunications Facilities  
77-2014 Recommended Practice on Static Electricity  
90A-2015 Standard for the Installation of Air Conditioning and Ventilating Systems  
99-2015 Health Care Facilities Code  
101-2015 Life Safety Code

- 241 Safeguarding construction, alternation and Demolition Operations
- 255-2006 Standard Method of Test of Surface Burning Characteristics of Building Materials
- 262 - 2011 Standard Method of Test for Flame Travel and Smoke of Wires and Cables for Use in Air-Handling Spaces
- 780-2014 Standard for the Installation of Lightning Protection Systems
- 1221-2013 Standard for the Installation, Maintenance, and Use of Emergency Services Communications Systems
- 5000-2015 Building Construction and Safety Code
- 16. Society for Protective Coatings (SSPC):
  - SSPC SP 6/NACE No.3 (2007) Commercial Blast Cleaning
- 17. Society of Cable Telecommunications Engineers (SCTE):
  - ANSI/SCTE 15 2006 Specification for Trunk, Feeder and Distribution Coaxial Cable
- 18. Telecommunications Industry Association (TIA):
  - TIA-120 Series Telecommunications Land Mobile communications (APCO/Project 25) (January 2014)
  - TIA TSB-140 Additional Guidelines for Field-Testing Length, Loss and Polarity of Optical Fiber Cabling Systems (2004)
  - TIA-155 Guidelines for the Assessment and Mitigation of Installed Category 6 Cabling to Support 10GBASE-T (2010)
  - TIA TSB-162-A Telecommunications Cabling Guidelines for Wireless Access Points (2013)
  - TIA-222-G Structural Standard for Antenna Supporting Structures and Antennas (2014)
  - TIA/EIA-423-B Electrical Characteristics of Unbalanced Voltage Digital Interface Circuits (2012)
  - TIA-455-C General Requirements for Standard Test Procedures for Optical Fibers, Cables, Transducers, Sensors, Connecting and Terminating Devices, and other Fiber Optic Components (August 2014)

TIA-455-53-A	FOTP-53 Attenuation by Substitution Measurements for Multimode Graded-Index Optical Fibers in Fiber Assemblies (Long Length) (September 2001)
TIA-455-61-A	FOTP-61 Measurement of Fiber of Cable Attenuation Using an OTDR (July 2003)
TIA-472D000-B	Fiber Optic Communications Cable for Outside Plant Use (July 2007)
ANSI/TIA-492-B	62.5- $\mu$ Core Diameter/125- $\mu$ m Cladding Diameter Class 1a Graded-Index Multimode Optical Fibers (November 2009)
ANSI/TIA-492AAAB-A	50- $\mu$ m Core Diameter/125- $\mu$ m Cladding Diameter Class IA Graded-Index Multimode Optically Optimized American Standard Fibers (November 2009)
TIA-492CAAA	Detail Specification for Class IVa Dispersion- Unshifted Single-Mode Optical Fibers (September 2002)
TIA-492E000	Sectional Specification for Class IVd Nonzero- Dispersion Single-Mode Optical Fibers for the 1,550 nm Window (September 2002)
TIA-526-7-B	Measurement of Optical Power Loss of Installed Single-Mode Fiber Cable Plant - OFSTP-7 (December 2008)
TIA-526.14-A	Optical Power Loss Measurements of Installed Multimode Fiber Cable Plant - SFSTP-14 (August 1998)
TIA-568	Revision/Edition: C Commercial Building Telecommunications Cabling Standard Set: (TIA- 568-C.0-2 Generic Telecommunications Cabling for Customer Premises (2012), TIA-568-C.1-1 Commercial Building Telecommunications Cabling Standard Part 1: General Requirements (2012), TIA-568-C.2 Commercial Building Telecommunications Cabling Standard-Part 2: Balanced Twisted Pair Cabling Components (2009), TIA-568-C.3-1 Optical Fiber Cabling Components Standard, (2011) AND TIA-568-C.4

	Broadband Coaxial Cabling and Components Standard (2011) with addendums and erratas
TIA-569	Revision/Edition C Telecommunications Pathways and Spaces (March 2013)
TIA-574	Position Non-Synchronous Interface between Data Terminal equipment and Data Circuit Terminating Equipment Employing Serial Binary Interchange (May 2003)
TIA/EIA-590-A	Standard for Physical Location and Protection of Below Ground Fiber Optic Cable Plant (July 2001)
TIA-598-D	Optical Fiber Cable Color Coding (January 2005)
TIA-604-10-B	Fiber Optic Connector Intermateability Standard (August 2008)
ANSI/TIA-606-B	Administration Standard for Telecommunications Infrastructure (2012)
TIA-607-B	Generic Telecommunications Bonding and Grounding (Earthing) For Customer Premises (January 2013)
TIA-613	High Speed Serial Interface for Data Terminal Equipment and Data Circuit Terminal Equipment (September 2005)
ANSI/TIA-758-B	Customer-owned Outside Plant Telecommunications Infrastructure Standard (April 2012)
ANSI/TIA-854	A Full Duplex Ethernet Specification for 1000 Mb/s (1000BASE-TX) Operating over Category 6 Balanced Twisted-Pair Cabling (2001)
ANSI/TIA-862-A	Building Automation Systems Cabling Standard (April 2011)
TIA-942-A	Telecommunications Infrastructure Standard for Data Centers (March 2014)
TIA-1152	Requirements for Field Testing Instruments and Measurements for Balanced Twisted Pair Cabling (September 2009)
TIA-1179	Healthcare Facility Telecommunications Infrastructure Standard (July 2010)

#### 1.4 SINGULAR NUMBER

- A. Where any device or part of equipment is referred in singular number (such as " rack"), reference applies to as many such devices as are required to complete installation.

#### 1.5 RELATED WORK

- A. Specification Order of Precedence: FAR Clause 52.236-21, VAAR Clause 852.236-71.
1. Field Cutting and Patching: Section 09 91 00, PAINTING.
  2. Additional submittal requirements: Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA AND SAMPLES.
  3. Availability and source of references and standards specified in applicable publications: Section 01 42 19, REFERENCE STANDARDS.
  4. Control of environmental pollution and damage for air, water, and land resources: Section 01 57 19, TEMPORARY ENVIRONMENTAL CONTROLS.
  5. Requirements for non-hazardous building construction and demolition waste: Section 01 74 19, CONSTRUCTION WASTE MANAGEMENT.
  6. Not Used.
  7. Closures of openings in walls, floors, and roof decks against penetration of flame, heat, and smoke or gases in fire resistant rated construction: Section 07 84 00, FIRESTOPPING.
  8. Sealant and caulking materials and their application: Section 07 92 00, JOINT SEALANTS.
  9. General electrical requirements that are common to more than one section of Division 26: Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
  10. Electrical conductors and cables in electrical systems rated 600 V and below: Section 26 05 21, LOW VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES (600 VOLTS AND BELOW).
  11. Requirements for personnel safety and to provide a low impedance path to ground for possible ground fault currents: Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS.
  12. Conduit and boxes: Section 26 05 33, RACEWAYS AND BOXES FOR ELECTRICAL SYSTEMS.
  13. Wiring devices: Section 26 27 26, WIRING DEVICES.
  14. Not Used.
  15. Lightning protection: Section 26 41 00, FACILITY LIGHTNING PROTECTION.

16. General requirements common to more than one section in Division 28:  
Section 28 05 00, COMMON WORK RESULTS FOR ELECTRONIC SAFETY AND SECURITY.
17. Conductors and cables for electronic safety and security systems:  
Section 28 05 13, CONDUCTORS AND CABLES FOR ELECTRONIC SAFETY AND SECURITY.
18. Low impedance path to ground for electronic safety and security system ground fault currents: Section 28 05 26, GROUNDING AND BONDING FOR SECURITY SYSTEMS.
19. Conduits and partitioned telecommunications raceways for Electronic Safety and Security systems: Section 28 05 28.33, CONDUITS AND BACK BOXES FOR ELECTRONIC SAFETY AND SECURITY.
20. Physical Access Control System field-installed controllers connected by data transmission network: Section 28 13 00, PHYSICAL ACCESS DETECTION.
21. Not Used.
22. Not Used.
23. Not Used.
24. Not Used.
25. Alarm initiating devices, alarm notification appliances, control units, fire safety control devices, annunciators, power supplies, and wiring: Section 28 31 00, FIRE DETECTION AND ALARM.

#### **1.6 ADMINISTRATIVE REQUIREMENTS**

- A. Assign a single communications project manager to serve as point of contact for Government, contractor, and design professional.
- B. Be proactive in scheduling work.
  1. Use of premises is restricted at times directed by COR.
  2. Movement of materials: Unload materials and equipment delivered to site.
  3. Coordinate installation of required supporting devices and sleeves to be set in poured-in-place concrete and other structural components, as they are constructed.
  4. Sequence, coordinate, and integrate installations of materials and equipment for efficient flow of Work.
  5. Coordinate connection of materials, equipment, and systems with exterior underground and overhead utilities and services. Comply with requirements of governing regulations, franchised service

- companies, and controlling agencies; provide required connection for each service.
6. Initiate and maintain discussion regarding schedule for ceiling construction and install cables to meet that schedule.
- C. Contact the Office of Telecommunications, Special Communications Team (0050P2H3) (202)461-5310 to have a Government-accepted Telecommunications COR assigned to project for telecommunications review, equipment and system approval and coordination with other VA personnel.
- D. Communications Project Manager Responsibilities:
1. Assume responsibility for overall telecommunications system integration and coordination of work among trades, subcontractors, and authorized system installers.
  2. Coordinate with related work indicated on drawings or specified.
  3. Manage work related to telecommunications system installation in a manner approved by manufacturer.

#### **1.7 SUBMITTALS**

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Provide parts list including quantity of spare parts.
- C. Provide manufacturer product information. Government reserves the right to require a list of installations where products have been in operation.
- D. Provide Source Quality Control Submittal:
1. Submit written certification from OEM indicating that proposed supervisor of installation and proposed provider of warranty maintenance are authorized representatives of OEM. Include individual's legal name, contact information and OEM credentials in certification.
  2. Submit written certification from OEM that wiring and connection diagrams meet Government Life Safety Guidelines, NFPA, NEC, NRTL, these specifications, and Joint Commission requirements and instructions, requirements, recommendations, and guidance set forth by OEM for the proper performance of system.
  3. Pre-acceptance Certification: Certification in accordance with procedure outlined in Section 01 00 00, GENERAL REQUIREMENTS and specific Division 27 qualification documentation.

- E. Installer Qualifications: Submit three installations of similar size and complexity furnished and installed by installer; include:
  - 1. Installation location and name.
  - 2. Owner's name and contact information including, address, telephone and email.
  - 3. Date of project start and date of final acceptance.
  - 4. System project number.
  - 5. Three paragraph description of each system related to this project; include function, operation, and installation.
- F. Provide delegated design submittals (e.g. seismic support design).
- G. Submittals are required for all equipment anchors and supports. Include weights, dimensions, center of gravity, standard connections, manufacturer's recommendations and behavior problems (e.g., vibration, thermal expansion,) associated with equipment or conduit. Anchors and supports to resist seismic load based on seismic design categories per section 4.0 of VA seismic design requirements H-18-8 dated August, 2013.

#### **1.8 CLOSEOUT SUBMITTALS**

- A. Provide following closeout submittals prior to project closeout date:
  - 1. Warranty certificate.
  - 2. Evidence of compliance with requirements such as low voltage certificate of inspection.
  - 3. Project record documents.
  - 4. Instruction manuals and software that are a part of system.
- B. Maintenance and Operation Manuals: Submit in accordance with Section 01 00 00, GENERAL REQUIREMENTS.
  - 1. Prepare a manual for each system and equipment specified.
  - 2. Furnish on portable storage drive in PDF format or equivalent accepted by COR.
  - 3. Furnish complete manual as specified in specification section, fifteen days prior to performance of systems or equipment test.
  - 4. Furnish remaining manuals prior to final completion.
  - 5. Identify storage drive "MAINTENANCE AND OPERATION MANUAL" and system name.
  - 6. Include name, contact information and emergency service numbers of each subcontractor installing system or equipment and local representatives for system or equipment.



7. Provide a Table of Contents and assemble files to conform to Table of Contents.
8. Operation and Maintenance Data includes:
  - a. Approved shop drawing for each item of equipment.
  - b. Internal and interconnecting wiring and control diagrams with data to explain detailed operation and control of equipment.
  - c. A control sequence describing start-up, operation, and shutdown.
  - d. Description of function of each principal item of equipment.
  - e. Installation and maintenance instructions.
  - f. Safety precautions.
  - g. Diagrams and illustrations.
  - h. Test Results and testing methods.
  - i. Performance data.
  - j. Pictorial "exploded" parts list with part numbers. Emphasis to be placed on use of special tools and instruments. Indicate sources of supply, recommended spare parts, and name of servicing organization.
  - k. Warranty documentation indicating end date and equipment protected under warranty.
  - l. Appendix; list qualified permanent servicing organizations for support of equipment, including addresses and certified personnel qualifications.

C. Record Wiring Diagrams:

1. Red Line Drawings: Keep one E size 91.44 cm x 121.92 cm (36 inches x 48 inches) set of floor plans, on site during work hours, showing installation progress marked and backbone cable labels noted. Make these drawings available for examination during construction meetings or field inspections.
2. General Drawing Specifications: Detail and elevation drawings to be D size 61 cm x 91.44 cm (24 inches x 36 inches) with a minimum scale of 0.635 cm = 30.48 cm (1/4 inch = 12 inches). ER, TR and other enlarged detail floor plan drawings to be D size 61 cm x 91.44 cm (24" x 36") with a minimum scale of 0.635 cm = 30.48 cm (1/4 inch = 12 inches). Building composite floor plan drawings to be D size 61 cm x 91.44 cm (24 inches x 36 inches) with a minimum scale of 3.175 mm = 30.48 cm (1/8 inch = 1' 0 inch).

3. Building Composite Floor Plans: Provide building floor plans showing work area outlet locations and configuration, types of jacks, distance for each cable, and cable routing locations.
4. Floor plans to include:
  - a. Final room numbers and actual backbone cabling and pathway locations and labeling.
  - b. Inputs and outputs of equipment identified according to labels installed on cables and equipment
  - c. Device locations with labels.
  - d. Conduit.
  - e. Head-end equipment.
  - f. Wiring diagram.
  - g. Labeling and administration documentation.
5. Submit Record Wiring Diagrams within five business days after final cable testing.
6. Deliver Record Wiring Diagrams as CAD files in .dwg formats as determined by COR.
7. Deliver four complete sets of electronic record wiring diagrams to COR on portable storage drive.
- D. Service Qualifications: Submit name and contact information of service organizations providing service to this installation within four hours of receipt of notification service is needed.

#### **1.9 MAINTENANCE MATERIAL SUBMITTALS**

- A. After approval and prior to installation, furnish COR with the following:
  1. A 300 mm (12 inch) length of each type and size of wire and cable along with tag from coils of reels from which samples were taken.
  2. One coupling, bushing and termination fitting for each type of conduit.
  3. Samples of each hanger, clamp and supports for conduit and pathways.
  4. Duct sealing compound.

#### **1.10 QUALITY ASSURANCE**

- A. Manufacturer's Qualifications: Manufacturer must produce, as a principal product, the equipment and material specified for this project, and have manufactured item for at least three years.
- B. Product and System Qualification:

1. OEM must have three installations of equipment submitted presently in operation of similar size and type as this project, that have continuously operated for a minimum of three years.
  2. Government reserves the right to require a list of installations where products have been in operation before approval.
  3. Authorized representative of OEM must be responsible for design, satisfactory operation of installed system, and certification.
- C. Trade Contractor Qualifications: Trade contractor must have completed three or more installations of similar systems of comparable size and complexity with regards to coordinating, engineering, testing, certifying, supervising, training, and documentation. Identify these installations as a part of submittal.
- D. System Supplier Qualifications: System supplier must be authorized by OEM to warranty installed equipment.
- E. Telecommunications technicians assigned to system must be trained, and certified by OEM on installation and testing of system; provide written evidence of current OEM certifications for installers.
- F. Manufactured Products:
1. Comply with FAR clause 52.236-5 for material and workmanship.
  2. When more than one unit of same class of equipment is required, units must be product of a single manufacturer.
  3. Equipment Assemblies and Components:
    - a. Components of an assembled unit need not be products of same manufacturer.
    - b. Manufacturers of equipment assemblies, which include components made by others, to assume complete responsibility for final assembled unit.
    - c. Provide compatible components for assembly and intended service.
    - d. Constituent parts which are similar must be product of a single manufacturer.
  4. Identify factory wiring on equipment being furnished and on wiring diagrams.
- G. Testing Agencies: Government reserves the option of witnessing factory tests. Notify COR minimum 15 working days prior to manufacturer performing the factory tests.
1. When equipment fails to meet factory test and re-inspection is required, contractor is liable for additional expenses, including expenses of Government.

**1.11 DELIVERY, STORAGE, AND HANDLING****A. Delivery and Acceptance Requirements:**

1. Government's approval of submittals must be obtained for equipment and material before delivery to job site.
2. Deliver and store materials to job site in OEM's original unopened containers, clearly labeled with OEM's name and equipment catalog numbers, model and serial identification numbers for COR to inventory cable, patch panels, and related equipment.

**B. Storage and Handling Requirements:**

1. Equipment and materials must be protected during shipment and storage against physical damage, dirt, moisture, cold and rain:
  - a. Store and protect equipment in a manner that precludes damage or loss, including theft.
  - b. Protect painted surfaces with factory installed removable heavy kraft paper, sheet vinyl or equivalent.
  - c. Protect enclosures, equipment, controls, controllers, circuit protective devices, and other like items, against entry of foreign matter during installation; vacuum clean both inside and outside before testing and operating.

**C. Coordinate storage.****1.12 FIELD CONDITIONS**

- A. Where variations from documents are requested in accordance with GENERAL CONDITIONS and Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES, connecting work and related components must include additions or changes to branch circuits, circuit protective devices, conduits, wire, feeders, controls, panels and installation methods.
- B. A contract adjustment or additional time will not be granted because of field conditions pursuant to FAR 52.236-2 and FAR 52.236-3; a contract adjustment or additional time will not be granted for additional work required for complete and usable construction and systems pursuant to FAR 52.246-12.

**1.13 WARRANTY****A. Comply with FAR clause 52.246-21., except as follows:**

1. Warranty material and equipment to be free from defects, workmanship, and remain so for a period of one year for Emergency Systems from date of final acceptance of system by Government; provide OEM's equipment warranty document to COR.

2. Government maintenance personnel must have ability to contact OEM for emergency maintenance and logistic assistance, remote diagnostic testing, and assistance in resolving technical problems at any time; contractor and OEM must provide this capability.

## **PART 2 - PRODUCTS**

### **2.1 PERFORMANCE AND DESIGN CRITERIA**

- A. Provide communications spaces and pathways conforming to TIA 569, at a minimum.

### **2.2 EQUIPMENT IDENTIFICATION**

- A. Provide laminated black phenolic resin with a white core nameplates with minimum 6 mm (1/4 inch) high engraved lettering.
- B. Nameplates furnished by manufacturer as standard catalog items, unless other method of identification is indicated.

### **2.3 UNDERGROUND WARNING TAPE NOT USED.**

### **2.4 WIRE LUBRICATING COMPOUND**

- A. Provide non-hardening or forming adhesive coating cable lubricants suitable for cable jacket material and raceway.

### **2.5 FIREPROOFING TAPE**

- A. Provide flexible, conformable fabric tape of organic composition and coated one side with flame-retardant elastomer.
- B. Tape must be self-extinguishing and cannot support combustion; arc-proof and fireproof.
- C. Tape cannot deteriorate when subjected to water, gases, salt water, sewage, or fungus; and tape must be resistant to sunlight and ultraviolet light.
- D. Application must withstand a 200-ampere arc for minimum 30 seconds.
- E. Securing Tape: Glass cloth electrical tape minimum 0.18 mm (7 mils) thick and 19 mm (3/4 inch) wide.

### **2.6 UNDERGROUND CABLES NOT USED.**

### **2.7 AERIAL (ABOVEGROUND) ENCLOSURES NOT USED.**

### **2.8 TEMPORARY TIP PATHS (OVERHEAD TRACKS, ROAD/PATH BRIDGES, ETC.) NOT USED.**

### **2.9 ACCESS PANELS**

- A. Panels: 304 mm x 304 mm (12 inches by 12 inches, or size allowed by location to provide optimum access to equipment for maintenance and service.
- B. Provide access panels and doors as required to allow service of materials and equipment that require inspection, replacement, repair or service.

- C. Provide access panels where items installed require access and are concealed in floor, wall, furred space or above ceiling; ceilings consisting of lay-in or removable splined tiles do not require access panels.
- D. Provide access panels with same fire rating classification as surface penetrated.

### **PART 3 - EXECUTION**

#### **3.1 PREPARATION**

##### **A. Penetrations and Sleeves:**

1. Lay out penetration and sleeve openings in advance, to permit provision in work.
2. Set sleeves in forms before concrete is poured.
3. Set sleeves prior to installation of structure for passage of pipes, conduit, ducts, etc.
4. Provide sleeves and packing materials at penetrations of foundations, walls, slabs, partitions, and floors.
5. Make sleeves that penetrate outside walls, basement slabs, footings, and beams waterproof.
6. Fill slots, sleeves and other openings in floors or walls if not used.
  - a. Fill spaces in openings after installation of conduit or cable.
  - b. Provide fill for floor penetrations to prevent passage of water, smoke, fire, and fumes.
  - c. Provide fire resistant fill in rated floors and walls, to prevent passage of air, smoke and fumes.
7. Install sleeves through floors watertight and extend minimum 50.8 mm (2 inches) above floor surface.
8. Match and set sleeves flush with adjoining floor, ceiling, and wall finishes where raceways passing through openings are exposed in finished rooms.
9. Annular space between conduit and sleeve must be minimum 6 mm (1/4 inch).
10. Do not provide sleeves for slabs-on-grade, unless specified or indicated otherwise.
11. Comply with requirements for firestopping, for sleeves through rated fire walls and smoke partitions.
12. Do not support piping risers or conduit on sleeves.
13. Identify unused sleeves and slots for future installation.

14. Provide core drilling if walls are poured or otherwise constructed without sleeves and wall penetration is required; do not penetrate structural members.
- B. Core Drilling:
1. Avoid core drilling whenever possible.
  2. Coordinate openings with other trades and utilities, and prevent damage to structural reinforcement.
  3. Investigate existing conditions in vicinity of required opening prior to coring, including an x-ray of floor if determined necessary by competent person or COR.
  4. Protect areas from damage.
- C. Verification of In-Place Conditions:
1. Verify location, use and status of all material, equipment, and utilities that are specified, indicated, or determined necessary for removal.
    - a. Verify materials, equipment, and utilities to be removed are inactive, not required, or in use after completion of project.
    - b. Replace with equivalent any material, equipment and utilities that were removed by contractor that are required to be left in place.
  2. Existing Utilities: Do not interrupt utilities serving facilities occupied by Government or others unless permitted under following conditions and then only after arranging to provide temporary utility services, according to requirements indicated:
    - a. Notify COR in writing at least 14 days in advance of proposed utility interruptions.
    - b. Do not proceed with utility interruptions without Government's written permission.
- D. Provide suspended platforms, strap hangers, brackets, shelves, stands or legs for floor, wall and ceiling mounting of equipment as required.
- E. Provide steel supports and hardware for installation of hangers, anchors, guides, and other support hardware.
- F. Obtain and analyze catalog data, weights, and other pertinent data required for coordination of equipment support provisions and installation.
- G. Verify site conditions and dimensions of equipment to ensure access for proper installation of equipment without disassembly that would void warranty.

**3.2 INSTALLATION - GENERAL**

- A. Coordinate systems, equipment, and materials installation with other building components.
- B. Install systems, materials, and equipment to conform with approved submittal data, including coordination drawings.
- C. Conform to VAAR 852.236.91 arrangements indicated, recognizing that work may be shown in diagrammatic form or have been impracticable to detail all items because of variances in manufacturers' methods of achieving specified results.
- D. Install systems, materials, and equipment level and plumb, parallel and perpendicular to other building systems and components, where installed in both exposed and un-exposed spaces.
- E. Install equipment according to manufacturers' written instructions.
- F. Install wiring and cabling between equipment and related devices.
- G. Install cabling, wiring, and equipment to facilitate servicing, maintenance, and repair or replacement of equipment components. Connect equipment for ease of disconnecting, with minimum interference of adjacent other installations.
- H. Provide access panel or doors where units are concealed behind finished surfaces.
- I. Arrange for chases, slots, and openings in other building components during progress of construction, to allow for wiring, cabling, and equipment installations.
- J. Where mounting heights are not detailed or dimensioned, install systems, materials, and equipment to provide maximum headroom and access for service and maintenance as possible.
- K. Install systems, materials, and equipment giving priority to systems required to be installed at a specified slope.
- L. Avoid interference with structure and with work or other trades, preserving adequate headroom and clearing doors and passageways to satisfaction of COR and code requirements.
- M. Install equipment and cabling to distribute equipment loads on building structural members provided for equipment support under other sections; install and support roof-mounted equipment on structural steel or roof curbs as appropriate.
- N. Provide supplementary or miscellaneous items, appurtenances, devices and materials for a complete installation.



### 3.3 EQUIPMENT INSTALLATION

- A. Locate equipment as close as practical to locations shown on drawings.
- B. Note locations of equipment requiring access on record drawings.
- C. Access and Access Panels: Verify access panel locations and construction with COR.
- D. Inaccessible Equipment:
  - 1. Where Government determines that contractor has installed equipment not conveniently accessible for operation and maintenance, equipment must be removed and reinstalled as directed and without additional cost to Government.
  - 2. Refer to Section 27 11 00, TELECOMMUNICATIONS ROOM FITTINGS for communication equipment cabinet assembly.
  - 3. Refer to Section 27 11 00, TELECOMMUNICATIONS ROOM FITTINGS for equipment labeling.

### 3.4 EQUIPMENT IDENTIFICATION

- A. Install an identification sign which clearly indicates information required for use and maintenance of equipment.
- B. Secure identification signs with screws.

### 3.5 CUTTING AND PATCHING

- A. Perform cutting and patching according to contract general requirements and as follows:
  - 1. Remove samples of installed work as specified for testing.
  - 2. Perform cutting, fitting, and patching of equipment and materials required to uncover existing infrastructure in order to provide access for correction of improperly installed existing or new work.
  - 3. Remove and replace defective work.
  - 4. Remove and replace non-conforming work.
- B. Cut, remove, and legally dispose of selected equipment, components, and materials, including removal of material, equipment, devices, and other items indicated to be removed and items made obsolete by new work.
- C. Provide and maintain temporary partitions or dust barriers adequate to prevent spread of dust and dirt to adjacent areas.
- D. Protect adjacent installations during cutting and patching operations.
- E. Protect structure, furnishings, finishes, and adjacent materials not indicated or scheduled to be removed.
- F. Patch finished surfaces and building components using new materials specified for original installation and experienced installers.

### 3.6 FIELD QUALITY CONTROL

- A. Provide work according to VAAR 852.236.91 and FAR clause 52.236-5.
- B. Provide minimum clearances and work required for compliance with NFPA 70, National Electrical Code (NEC), and manufacturers' instructions; comply with additional requirements indicated for access and clearances.
- C. Verify all field conditions and dimensions that affect selection and provision of materials and equipment, and provide any disassembly, reassembly, relocation, demolition, cutting and patching required to provide work specified or indicated, including relocation and reinstallation of existing wiring and equipment.
  - 1. Protect facility, equipment, and wiring from damage.
- D. Submit written notice that:
  - 1. Project has been inspected for compliance with documents.
  - 2. Work has been completed in accordance with documents.
- E. Non-Conforming Work: Conduct project acceptance inspections, final completion inspections, substantial completion inspections, and acceptance testing and demonstrations after verification of system operation and completeness by Contractor.
- F. For project acceptance inspections, final completion inspections, substantial completion inspections, and testing/demonstrations that require more than one site visit by COR or design professional to verify project compliance for same material or equipment, Government reserves right to obtain compensation from contractor to defray cost of additional site visits that result from project construction or testing deficiencies and incompleteness, incorrect information, or non-compliance with project provisions.
  - 1. COR will notify contractor, of hourly rates and travel expenses for additional site visits, and will issue an invoice to Contractor for additional site visits.
  - 2. Contractor is not be eligible for extensions of project schedule or additional charges resulting from additional site visits that result from project construction or testing deficiencies/incompleteness, incorrect information, or non-compliance with Project provisions.
- G. Tests:
  - 1. Interim inspection is required at approximately 50 percent of installation.

2. Request inspection ten working days prior to interim inspection start date by notifying COR in writing; this inspection must verify equipment and system being provided adheres to installation, mechanical and technical requirements of construction documents.
3. Inspection to be conducted by OEM and factory-certified contractor representative, and witnessed by COR, facility and SMCS 0050P2H3 representatives.
4. Check each item of installed equipment to ensure appropriate NRTL listing labels and markings are fixed in place.
5. Verify cabling terminations in DEMARC, MCR, TER, SCC, ECC, TRs and head end rooms, workstation locations and TCO adhere to color code for T568B pin assignments and cabling connections are in compliance with TIA standards.
6. Visually confirm minimum Category 6 cable marking at TCOs, CCSs locations, patch cords and origination locations.
7. Review entire communications circulating ground system, each TGB and grounding connection, grounding electrode and outside lightning protection system.
8. Review cable tray, conduit and path/wire way installation practice.
9. OEM and contractor to perform:
  - a. Fiber optical cable field inspection tests via attenuation measurements on factory reels; provide results along with OEM certification for factory reel tests.
  - b. Coaxial cable field inspection tests via attenuation measurements on factory reels; provide results along with OEM certification for factory reel tests.
  - c. Baseband cable field inspection tests via attenuation measurements on factory reels and provide results along with OEM certification for factory reel tests.
10. Relocate failed cable reels to a secured location for inventory, as directed by COR, and then remove from project site within two working days; provide COR with written confirmation of defective cable reels removal from project site.
11. Provide results of interim inspections to COR.
12. If major or multiple deficiencies are discovered, additional interim inspections could be required until deficiencies are corrected, before permitting further system installation.
  - a. Additional inspections are scheduled at direction of COR.

- b. Re-inspection of deficiencies noted during interim inspections, must be part of system's Final Acceptance Proof of Performance Test.
  - c. The interim inspection cannot affect the system's completion date unless directed by COR.
- 13. Facility COR will ensure test documents become a part of system's official documentation package.
- H. Pretesting: Re-align, re-balance, sweep, re-adjust and clean entire system and leave system working for a "break-in" period, upon completing installation of system and prior to Final Acceptance Proof of Performance Test. System RF transmitting equipment must not be connected to keying or control lines during "break-in" period.
  - 1. Pretesting Procedure:
    - a. Verify systems are fully operational and meet performance requirements, utilizing accepted test equipment and spectrum analyzer.
    - b. Pretest and verify system functions and performance requirements conform to construction documents and, that no unwanted physical, aural and electronic effects, such as signal distortion, noise pulses, glitches, audio hum, poling noise are present.
  - 2. Measure and record signal, aural and control carrier levels of each DAS RF, voice and data channel, at each of the following minimum points in system:
    - a. Not Used.
    - b. Not Used.
    - c. Not Used.
    - d. Not Used.
    - e. PBX interconnections.
    - f. MCR interconnections.
    - g. MCOR interconnections.
    - h. TER interconnections.
    - i. TOR interconnections.
    - j. Control room interconnections.
    - k. TR interconnections.
    - l. System interfaces in locations listed herein.
    - m. HE interconnections.
    - n. Not Used.
    - o. System and lightning ground interconnections.

- p. Communications circulating ground system.
- q. Not Used.
- r. Not Used.
- s. Each general floor areas.
- t. Others as required by AHJ (SMCS 0050P2H3).
- 3. Provide recorded system pretest measurements and certification that the system is ready for formal acceptance test to COR.
- I. Acceptance Test:
  - 1. Schedule an acceptance test date after system has been pretested, and pretest results and certification submitted to COR.
  - 2. Give COR fifteen working days written notice prior to date test is expected to begin; include expected duration of time for test in notification.
  - 3. Test in the presence of the following:
    - a. COR.
    - b. OEM representatives.
    - c. VACO:
      - 1) CFM representative.
      - 2) AHJ-SMCS 0050P2H3, (202)461-5310.
    - d. VISN-CIO, Network Officer and VISN representatives.
    - e. Facility:
      - 1) FMS Service Chief, Bio-Medical Engineering and facility representatives.
      - 2) OI&T Service Chief and OI&T representatives.
      - 3) Safety Officer, Police Chief and facility safety representatives.
    - f. Local Community Safety Personnel:
      - 1) Fire Marshal representative.
      - 2) Disaster Coordinator representative.
      - 3) EMS Representatives: Police, Sherriff, City, County or State representatives.
  - 4. Test system utilizing accepted test equipment to certify proof of performance and Life and Public Safety compliance, FCC, NRTL, NFPA and OSHA compliance.
    - a. Rate system as acceptable or unacceptable at conclusion of test; make only minor adjustments and connections required to show proof of performance.

- 1) Demonstrate and verify that system complies with performance requirements under operating conditions.
- 2) Failure of any part of system that precludes completion of system testing, and which cannot be repaired within four hours, terminates acceptance test of that portion of system.
- 3) Repeated failures that result in a cumulative time of eight hours to affect repairs is cause for entire system to be declared unacceptable.
- 4) If system is declared unacceptable, retesting must be rescheduled at convenience of Government and costs borne by the contractor.

J. Acceptance Test Procedure:

1. Physical and Mechanical Inspection: The test team representatives must tour major areas to determine system and sub-systems are completely and properly installed and are ready for acceptance testing.
2. A system inventory including available spare parts must be taken at this time.
3. Each item of installed equipment must be re-checked to ensure appropriate NRTL (i.e. UL) certification listing labels are affixed.
4. Confirm that deficiencies reported during Interim Inspections and Pretesting are corrected prior to start of Acceptance Test.
5. Inventory system diagrams, record drawings, equipment manuals, pretest results.
6. Failure of system to meet installation requirements of specifications is grounds for terminating testing and to schedule re-testing.

K. Operational Test:

1. Individual Item Test: VACO AHJ representative (SMCS 0050P2H3) may select individual items of DAS equipment for detailed proof of performance testing until 100 percent of system has been tested and found to meet requirements of the construction documents.
2. Government's Condition of Acceptance of System Language:
  - a. Without Acceptance: Until system fully meets conditions of construction documents, system's ownership, use, operation and warranty commences at Government's final acceptance date.
  - b. With Conditional Acceptance: Stating conditions that need to be addressed by contractor or OEM and stating system's use and

operation to commence immediately while its warranty commences only at Government's agreed final extended acceptance date.

- c. With Full Acceptance: Stating system's ownership, use, operation and warranty to immediately commence at Government's agreed to date of final acceptance.
- L. Acceptance Test Conclusion: Reschedule testing on deficiencies and shortages with COR, after COR and SMCS AHJ jointly agree to results of the test, using the generated punch list or discrepancy list. Perform retesting to comply with these specifications at contractor's expense.
- M. Proof of Performance Certification:
  - 1. If system is declared acceptable, AHJ (SMCS 0050P2H3) provides COR notice stating system processes to required operating standards and functions and is Government accepted for use by facility.
  - 2. Validate items with COR needing to be provided to complete project contract (i.e. charts & diagrams, manuals, spare parts, system warranty documents executed, etc.). Once items have been provided, COR contacts FMS service chief to turn over system from CFM oversight for beneficial use by facility.
  - 3. If system is declared unacceptable without conditions, rescheduled testing expenses are to be borne by contractor.

### 3.7 CLEANING

- A. Remove debris, rubbish, waste material, tools, construction equipment, machinery and surplus materials from project site and clean work area, prior to final inspection and acceptance of work.
- B. Put building and premises in neat and clean condition.
- C. Remove debris on a daily basis.
- D. Remove unused material, during progress of work.
- E. Perform cleaning and washing required to provide acceptable appearance and operation of equipment to satisfaction of COR.
- F. Clean exterior surface of all equipment, including concrete residue, dirt, and paint residue, after completion of project.
- G. Perform final cleaning prior to project acceptance by COR.
- H. Remove paint splatters and other spots, dirt, and debris; touch up scratches and mars of finish to match original finish.
- I. Clean devices internally using methods and materials recommended by manufacturer.
- J. Tighten wiring connectors, terminals, bus joints, and mountings, to include lugs, screws and bolts according to equipment manufacturer's

published torque tightening values for equipment connectors. In absence of published connection or terminal torque values, comply with torque values specified in UL 486A-486B.

### **3.8 TRAINING**

- A. Provide training in accordance with subsection, INSTRUCTIONS, of Section 01 00 00, GENERAL REQUIREMENTS.
- B. Provide training for equipment or system as required in each associated specification.
- C. Develop and submit training schedule for approval by COR, at least 30 days prior to planned training.

### **3.9 PROTECTION**

- A. Protection of Fireproofing:
  - 1. Install clips, hangers, clamps, supports and other attachments to surfaces to be fireproofed, if possible, prior to start of spray fireproofing work.
  - 2. Install conduits and other items that would interfere with proper application of fireproofing after completion of spray fire proofing work.
  - 3. Patch and repair fireproofing damaged due to cutting or course of work must be performed by installer of fireproofing and paid for by trade responsible for damage.
- B. Maintain equipment and systems until final acceptance.
- C. Ensure adequate protection of equipment and material during installation and shutdown and during delays pending final test of systems and equipment because of seasonal conditions.

- - - E N D - - -



**SECTION 27 05 26**  
**GROUNDING AND BONDING FOR COMMUNICATIONS SYSTEMS**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section identifies common and general grounding and bonding requirements of communication installations and applies to all sections of Divisions 27 and 28 .

**1.2 RELATED WORK**

- A. Requirements for a lightning protection system: Section 26 41 00, FACILITY LIGHTNING PROTECTION.
- B. Low voltage wiring: Section 27 15 00, COMMUNICATIONS STRUCTURED CABLING.

**1.3 SUBMITTALS**

- A. Submit in accordance with Section 27 05 11, REQUIREMENTS FOR COMMUNICATIONS INSTALLATIONS.
- B. Provide plan indicating location of system grounding electrode connections and routing of aboveground and underground grounding electrode conductors.
- C. Closeout Submittals: In addition to Section 27 05 11, REQUIREMENTS FOR COMMUNICATIONS INSTALLATIONS provide the following:
1. Certified test reports of ground resistance.
  2. Certifications: Two weeks prior to final inspection, submit following to COR:
    - a. Certification materials and installation is in accordance with construction documents.
    - b. Certification complete installation has been installed and tested.

**PART 2 - PRODUCTS**

**2.1 COMPONENTS**

- A. Grounding and Bonding Conductors:
1. Provide UL 83 insulated stranded copper equipment grounding conductors, with the exception of solid copper conductors for sizes 6 mm<sup>2</sup> (10 AWG) and smaller. Identify all grounding conductors with continuous green insulation color, except identify wire sizes 25 mm<sup>2</sup> (4 AWG) and larger per NEC.
  2. Provide ASTM B8 bare stranded copper bonding conductors, with the exception of ASTM B1 solid bare copper for wire sizes 6 mm<sup>2</sup> (10 AWG) and smaller.

- B. Splices and Termination Components: Provide components meeting or exceeding UL 467 and clearly marked with manufacturer's name, catalog number, and permitted conductor sizes.
  - 1. Not Used.
  - 2. Telecommunications Grounding Busbar (TGB):
    - a. 6.4 mm (1/4 inch) thick solid copper bar.
    - b. Minimum 50 mm (2 inches) high and length sized in accordance application requirements and future growth of minimum 300 mm long (12 inches) long.
    - c. Minimum nine predrilled attachment points (one row) for attaching standard sized two-hole grounding lugs.
      - 1) 6 lugs with 15.8 mm (5/8 inch) hole centers.
      - 2) 3 lugs with 25.4 mm (1 inch) hole centers.
    - d. Wall-mount stand-off brackets, assembly screws and insulators for 100 mm (4 inches) standoff from wall.
    - e. Listed as grounding and bonding equipment.
- C. Ground Terminal Blocks: Provide screw lug-type terminal blocks at equipment mounting location (e.g. backboards and hinged cover enclosures) where rack-type ground bars cannot be mounted.
  - 1. Electroplated tin aluminum extrusion.
  - 2. Accept conductors ranging from #14 AWG through 2/0.
  - 3. Hold conductors in place by two stainless steel set screws.
  - 4. Two 6 mm (1/4 inch) holes spaced on 15.8 mm (5/8 inch) centers to allow secure two-bolt attachment.
  - 5. Listed as a wire connector.
- D. Splice Case Ground Accessories: Provide splice case grounding and bonding accessories manufactured by splice case manufacturer when available. Otherwise, use 16 mm<sup>2</sup> (6 AWG) insulated ground wire with shield bonding connectors.
- E. Irreversible Compression Lugs:
  - 1. Electroplated tinned copper.
  - 2. Two holes spaced on 15.8 mm (5/8 inch) or 25.4 mm (1 inch) centers.
  - 3. Sized to fit the specific size conductor.
  - 4. Listed as wire connectors.
- F. Antioxidant Joint Compound: Oxide inhibiting joint compound for copper-to-copper, aluminum-to-aluminum or aluminum-to-copper connections.

**PART 3 - EXECUTION****3.1 EQUIPMENT INSTALLATION AND REQUIREMENTS**

- A. Exterior Equipment Grounding: Bond exterior metallic components (including masts and cabinets), antennas, satellite dishes, towers, raceways, primary telecommunications protector/arresters, secondary surge protection, waveguides, cable shields, down conductors and other conductive items to directly to Intersystem Bonding Termination.
- B. Install telecommunications bonding backbone conductor throughout building via telecommunications backbone pathways effectively bonding all interior telecommunications grounding busbars in telecommunications rooms, to telecommunications main grounding busbar in Demarc room after testing bond to verify bonding conductor for telecommunications from grounding electrode conductor is installed per NEC. Size telecommunications bonding backbone conductor as specified in TIA-607-B.
- C. Inaccessible Grounding Connections: Utilize exothermic welding for bonding of buried or otherwise inaccessible connections with the exception of connections requiring periodic testing.
- D. Conduit Systems:
  - 1. Bond ferrous metallic conduit to ground.
  - 2. Bond grounding conductors installed in ferrous metallic conduit at both ends of conduit using grounding bushing with #6 AWG conductor.
- E. Boxes, Cabinets, and Enclosures:
  - 1. Bond each pull box, splice box, equipment cabinet, and other enclosures through which conductors pass (except for special grounding systems for intensive care units and other critical units shown) to ground.
  - 2. Not Used.
- F. Corrosion Inhibitors: Apply corrosion inhibitor for protecting connection between metals used to contact surfaces, when making ground and ground bonding connections.
- G. Telecommunications Grounding System:
  - 1. Bond telecommunications grounding systems and equipment to facility's electrical grounding electrode at Intersystem Bonding Termination.
  - 2. Provide hardware as required to effectively bond metallic cable shields communications pathways, cable runway, and equipment chassis to ground.

3. Install bonding conductors without splices using shortest length of conductor possible to maintain clearances required by NEC.
  4. Provide paths to ground that are permanent and continuous with a resistance of 1 ohm or less from each raceway, cable tray, and equipment connection to telecommunications grounding busbar.
  5. Not Used.
  6. Above-Grade Bolted or Screwed Grounding Connections:
    - a. Remove paint to expose entire contact surface by grinding.
    - b. Clean all connector, plate and contact surfaces.
    - c. Apply corrosion inhibitor to surfaces before joining.
  7. Bonding Jumpers:
    - a. Assemble bonding jumpers using insulated ground wire of size and type shown on drawings or use a minimum of 16 mm<sup>2</sup> (6 AWG) insulated copper wire terminated with compression connectors of proper size for conductors.
    - b. Use connector manufacturer's compression tool.
  8. Bonding Jumper Fasteners:
    - a. Conduit: Connect bonding jumpers using lugs on grounding bushings or clamp pads on push-type conduit fasteners. Where appropriate, use zinc-plated external tooth lockwashers or Belleville Washers.
    - b. Wireway and Cable Tray: Fasten bonding jumpers using zinc-plated bolts, external tooth lockwashers or Belleville washers and nuts. Install protective cover, e.g., zinc-plated acorn nuts, on bolts extending into wireway or cable tray to prevent cable damage.
    - c. Grounding Busbars: Fasten bonding conductors using two-hole compression lugs. Use 300 series stainless steel bolts, Belleville Washers, and nuts.
    - d. Slotted Channel Framing and Raised Floor Stringers: Fasten bonding jumpers using zinc-plated, self-drill screws and Belleville washers or external tooth lock washers.
- H. Telecommunications Room Bonding:
1. Telecommunications Grounding Busbars:
    - a. Install busbar hardware no less than 950 mm (18 inches) A.F.F.
    - b. Where other grounding busbars are located in same room, e.g. electrical panelboard for telecommunications equipment, bond busbars together as indicated on grounding riser diagrams.
    - c. Make conductor connections with two-hole compression lugs sized to fit busbar and conductors.

- d. Attach lugs with stainless steel hardware after preparing bond according to manufacturer recommendations and treating bonding surface on busbar with anti-oxidant to help prevent corrosion.
- 2. Telephone-Type Cable Rack Systems:
  - a. Aluminum pan installed on telephone-type cable rack serves as primary ground conductor within communications room.
  - b. Make ground connections by installing bonding jumpers:
    - 1) Install minimum 16 mm<sup>2</sup> (6 AWG) bonding between telecommunications ground busbars and the aluminum pan installed on cable rack.
    - 2) Install 16 mm<sup>2</sup> (6 AWG) bonding jumpers across aluminum pan junctions.
- I. Self-Supporting and Cabinet-Mounted Equipment Rack Ground Bars:
  - 1. Install rack-mount horizontal busbar or vertical busbar to provide multiple bonding points,
  - 2. At each rack or cabinet containing active equipment or shielded cable terminations:
    - a. Bond busbar to ground as part of overall telecommunications bonding and grounding system.
    - b. Bond copper ground bars together using solid copper splice plates manufactured by same ground bar manufacturer, when ground bars are provided at rear of lineup of bolted together equipment racks.
    - c. Bond non-adjacent ground bars on equipment racks and cabinets with 16 mm<sup>2</sup> (6 AWG) insulated copper wire bonding jumpers attached at each end with compression-type connectors and mounting bolts.
    - d. Provide 16 mm<sup>2</sup> (6 AWG) bonding jumpers between rack and cabinet ground busbars and overhead cable runway or raised floor stringers, as appropriate.
- J. Backboards: Provide a screw lug-type terminal block or drilled and tapped copper strip near top of backboards used for communications cross-connect systems. Connect backboard ground terminals to cable runway using an insulated 16 mm<sup>2</sup> (6 AWG) bonding jumper.
- K. Other Communication Room Ground Systems: Ground metallic conduit, wireways, and other metallic equipment located away from equipment racks or cabinets to cable tray or telecommunications ground busbar,

whichever is closer, using insulated 16 mm<sup>2</sup> (6 AWG) ground wire bonding jumpers.

L. Communications Cable Grounding:

1. Bond all metallic cable sheaths in multi-pair communications cables together at each splicing or terminating location to provide 100 percent metallic sheath continuity throughout communications distribution system.
2. Install a cable shield bonding connector with a screw stud connection for ground wire, at terminal points. Bond cable shield connector to ground.
3. Bond all metallic cable shields together within splice closures using cable shield bonding connectors or splice case manufacturer's splice case grounding and bonding accessories. When an external ground connection is provided as part of splice closure, connect to an effective ground source and bond all other metallic components and equipment at that location.

M. Communications Cable Tray Systems:

1. Bond metallic structures of cable tray to provide 100 percent electrical continuity throughout cable tray systems.
2. Where metallic cable tray systems are mechanically discontinuous:
  - a. Install splice plates provided by cable tray manufacturer between cable tray sections so resistance across a bolted connection is 0.010 ohms or less, as verified by measuring across splice plate connection.
  - b. Install 16 mm<sup>2</sup> (6 AWG) bonding jumpers across each cable tray splice or junction where splice plates cannot be used.
3. Bond cable tray installed in same room as telecommunications grounding busbar to busbar.

N. Communications Raceway Grounding:

1. Conduit: Use insulated 16 mm<sup>2</sup> (6 AWG) bonding jumpers to bond metallic conduit at both ends and intermediate metallic enclosures to ground.
2. Cable Tray Systems: Use insulated 16 mm<sup>2</sup> (6 AWG) grounding jumpers to bond cable tray to column-mounted building ground plates (pads) at both ends and approximately 16 meters (50 feet) on centers.

O. Ground Resistance:

1. Install telecommunications grounding system so resistance to grounding electrode system measures 5 ohms or less.

2. Measure grounding electrode system resistance using an earth test meter, clamp-on ground tester, or computer-based ground meter as defined in IEEE 81. Record ground resistance measurements before electrical distribution system is energized.
3. Backfill only after below-grade connection have been visually inspected by COR. Notify COR twenty-four hours before below-grade connections are ready for inspection.

### **3.2 FIELD QUALITY CONTROL**

- A. Perform tests per BICSI's Information Technology Systems Installation Methods Manual (ITSIMM), Recommended Testing Procedures and Criteria.
- B. Perform two-point bond test using trained installers qualified to use test equipment.
- C. Conduct continuity test to verify that metallic pathways in telecommunications spaces are bonded to TGB or TMGB.
- D. Conduct electrical continuity test to verify that TMGB is effectively bonded to grounding electrode conductor.
- E. Visually inspect to verify that screened and shielded cables are bonded to TGB or TMGB.
- F. Perform a resistance test to ensure patch panel, rack and cabinet bonding connection resistance measures less than 5 Ohms to TGB or TMGB.

- - - E N D - - -





**SECTION 27 05 33**  
**RACEWAYS AND BOXES FOR COMMUNICATIONS SYSTEMS**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section specifies conduit, fittings, and boxes to form complete, coordinated, raceway systems. Raceways are required for communications cabling unless shown or specified otherwise.

**1.2 RELATED WORK**

- A. Bedding of conduits: Section 31 20 00, EARTH MOVING.
- B. Mounting board for Telecommunication Rooms: Section 06 10 00, ROUGH CARPENTRY.
- C. Sealing around penetrations to maintain integrity of fire rated construction: Section 07 84 00, FIRESTOPPING.
- D. Fabrications for deflection of water away from building envelope at penetrations: Section 07 60 00, FLASHING AND SHEET METAL.
- E. Sealing around conduit penetrations through building envelope to prevent moisture migration into building: Section 07 92 00, JOINT SEALANTS.
- F. Identification and painting of conduit and other devices: Section 09 91 00, PAINTING.
- G. Requirements for personnel safety and to provide a low impedance path for possible ground fault currents: Section 27 05 26, GROUNDING AND BONDING FOR COMMUNICATIONS SYSTEMS.

**1.3 SUBMITTALS**

- A. In accordance with Section 27 50 11, REQUIREMENTS FOR COMMUNICATIONS INSTALLATIONS, submit the following:
1. Size and location of cabinets, splice boxes and pull boxes.
  2. Layout of required conduit penetrations through structural elements.
  3. Catalog cuts marked with specific item proposed and area of application identified.
- B. Certification: Provide letter prior to final inspection, certifying material is in accordance with construction documents and properly installed.

**PART 2 - PRODUCTS**

**2.1 MATERIAL**

- A. Minimum Conduit Size: 19 mm (3/4 inch).
- B. Conduit:
1. Rigid Galvanized Steel: Conform to UL 6, ANSI C80.1.

2. Rigid Aluminum: Conform to UL 6A, ANSI C80.5.
3. Rigid Intermediate Steel Conduit (IMC): Conform to UL 1242, ANSI C80.6.
4. Electrical Metallic Tubing (EMT):
  - a. Maximum Size: 105 mm (4 inches).
  - b. Install only for cable rated 600 volts or less.
  - c. Conform to UL 797, ANSI C80.3.
5. Flexible Galvanized Steel Conduit: Conform to UL 1.
6. Liquid-tight Flexible Metal Conduit: Conform to UL 360.
7. Direct Burial Plastic Conduit: Conform to UL 651 and UL 651A, heavy wall PVC, or high density polyethylene (HDPE).
8. Surface Metal Raceway: Conform to UL 5.
9. Wireway, Approved "Basket": Provide "Telecommunications Service" rated with approved length way partitions and cable straps to prevent wires and cables from changing from one partitioned pathway to another.

C. Conduit Fittings:

1. Rigid Galvanized Steel and Rigid Intermediate Steel Conduit Fittings:
  - a. Provide fittings meeting requirements of UL 514B and ANSI/ NEMA FB 1.
  - b. Sealing: Provide threaded cast iron type. Use continuous drain type sealing fittings to prevent passage of water and vapor. In concealed work, install sealing fittings in flush steel boxes with blank cover plates having same finishes as other electrical plates in room.
  - c. Standard Threaded Couplings, Locknuts, Bushings, and Elbows: Only steel or malleable iron materials are acceptable. Integral retractable type IMC couplings are also acceptable.
  - d. Locknuts: Bonding type with sharp edges for digging into metal wall of an enclosure.
  - e. Bushings: Metallic insulating type, consisting of an insulating insert molded or locked into metallic body of fitting. Bushings made entirely of metal or nonmetallic material are not permitted.
  - f. Erickson (union-type) and Set Screw Type Couplings:
    - 1) Couplings listed for use in concrete are permitted for use to complete a conduit run where conduit is installed in concrete.

- 2) Use set screws of case hardened steel with hex head and cup point to seat in conduit wall for positive ground. Tightening of set screws with pliers is prohibited.
- g. Provide OEM approved fittings.
- 2. Not Used.
- 3. Electrical Metallic Tubing Fittings:
  - a. Conform to UL 514B and ANSI/ NEMA FB1; only steel or malleable iron materials are acceptable.
  - b. Couplings and Connectors: Concrete tight and rain tight, with connectors having insulated throats.
    - 1) Use gland and ring compression type couplings and connectors for conduit sizes 50 mm (2 inches) and smaller.
    - 2) Use set screw type couplings with four set screws each for conduit sizes over 50 mm (2 inches).
    - 3) Use set screws of case-hardened steel with hex head and cup point to seat in wall of conduit for positive grounding.
  - c. Indent type connectors or couplings are not permitted.
  - d. Die-cast or pressure-cast zinc-alloy fittings or fittings made of "pot metal" are not permitted.
  - e. Provide OEM approved fittings.
- 4. Flexible Steel Conduit Fittings:
  - a. Conform to UL 514B; only steel or malleable iron materials are acceptable.
  - b. Provide clamp type, with insulated throat.
  - c. Provide OEM approved fittings.
- 5. Liquid-tight Flexible Metal Conduit Fittings:
  - a. Conform to UL 514B and ANSI/ NEMA FB1; only steel or malleable iron materials are acceptable.
  - b. Fittings must incorporate a threaded grounding cone, a steel or plastic compression ring, and a gland for tightening.
  - c. Provide connectors with insulated throats to prevent damage to cable jacket.
  - d. Provide OEM approved fittings.
- 6. Not Used.
- 7. Surface Metal Raceway: Conform to UL 5 and "telecommunications service" rated with approved length-way partitions and cable straps to prevent wires and cables from changing from one partitioned pathway to another.

8. Surface Metal Raceway Fittings: As recommended by raceway manufacturer.
  9. Expansion and Deflection Couplings:
    - a. Conform to UL 467 and UL 514B.
    - b. Accommodate 19 mm (3/4 inch) deflection, expansion, or contraction in any direction, and allow 30 degree angular deflections.
    - c. Include internal flexible metal braid sized to ensure conduit ground continuity and fault currents in accordance with UL 467, and NEC code tables for ground conductors.
    - d. Jacket: Flexible, corrosion-resistant, watertight, moisture and heat resistant molded rubber material with stainless steel jacket clamps.
  10. Not Used.
  11. Wireway Fittings: As recommended by wireway OEM.
- D. Conduit Supports:
1. Parts and Hardware: Provide zinc-coat or equivalent corrosion protection.
  2. Individual Conduit Hangers: Designed for the purpose, having a pre-assembled closure bolt and nut, and provisions for receiving a hanger rod.
  3. Multiple Conduit (Trapeze) Hangers: Minimum 38 mm by 38 mm (1-1/2 by 1-1/2 inch), 2.78 mm (12 gage) steel, cold formed, lipped channels; with minimum 9 mm (3/8 inch) diameter steel hanger rods.
  4. Solid Masonry and Concrete Anchors: Self-drilling expansion shields, or machine bolt expansion.
- E. Outlet, Splice, and Pull Boxes:
1. Conform to UL-50 and UL-514A.
  2. Cast metal where required by NEC or shown, and equipped with rustproof boxes.
  3. Sheet Metal Boxes: Galvanized steel, except where otherwise shown.
  4. Install flush mounted wall or ceiling boxes with raised covers so that front face of raised cover is flush with wall.
  5. Install surface mounted wall or ceiling boxes with surface style flat or raised covers.
- F. Wireways: Equip with hinged covers, except where removable covers are shown.

- G. Warning Tape: Standard, 4-Mil polyethylene 76 mm (3 inch) wide tape detectable type, red with black letters, and imprinted with "CAUTION BURIED COMMUNICATIONS CABLE BELOW".
- H. Flexible Nonmetallic Communications Raceway (Innerduct) and Fittings:
1. General: Provide UL 910 listed plenum, riser, and general purpose corrugated pliable communications raceway for optical fiber cables and communications cable applications; select in accordance with provisions of NEC Articles 770 and 800.
  2. Provide Communications Raceway with a factory installed 567 kg (1250 lb.) tensile pre-lubricated pull tape.
  3. Use only metallic straps, hangers and fittings to support raceway from building structure. Cable ties are not permitted for securing raceway to building structure.
  4. Provide fittings to be installed in spaces used for environmental air made of materials that do not exceed flammability, smoke generation, ignitibility, and toxicity requirements of environmental air space.
  5. Size: Metric Designator 53 (trade size 2) or smaller.
  6. Outside Plant: Plenum-rated where each interduct is 75 mm (3 inches) and larger.
  7. Inside Plant: Listed and marked for installation in plenum airspaces and minimum 25 mm (1 inch) inside diameter.
  8. Plenum: Non-metallic communications raceway.
    - a. Constructed of low smoke emission, flame retardant PVC with corrugated construction.
    - b. UL 94 V-0 rating for flame spreading limitation.
  9. Provide innerduct reel lengths as necessary to ensure ducts are continuous; one piece runs from ENTR to MH; MH to MH; DEMARC to MCR/TER; TR to TR. Innerduct connectors are not permitted between rooms.
  10. Provide pulling accessories used for innerduct including but not limited to, inner duct lubricants, spreaders, applicators, grips, swivels, harnesses, and line missiles (blown air) compatible with materials being pulled.
- I. Outlet Boxes:
1. Flush wall mounted minimum 11.9 cm (4-11/16 inches) square, 9.2 cm (3-5/8 inches) deep pressed galvanized steel.

2. //Flush wall mounted 12.7 cm (5 inches) square x 7.3 cm (2-7/8 inches); deep pressed galvanized steel.//
3. 2-Gang Tile Box:
  - a. Flush backbox type for installation in block walls.
  - b. Minimum 92 mm (3-5/8 inches) deep.
- J. Weatherproof Outlet Boxes: Surface mount two gang, 67 mm (2-5/8 inches) deep weatherproof cast aluminum with powder coated finish internal threads on hubs 19 mm (3/4 inch) minimum.
- K. Cable Tray:
  1. Provide wire basket type of sizes indicated; with all required splicing and mounting hardware.
  2. Materials and Finishes:
    - a. Electro-plated zinc galvanized (post plated) made from carbon steel and plated to ASTM B 633, Type III, SC-1.
    - b. Remove soot, manufacturing residue/oils, or metallic particles after fabrication.
    - c. Rounded edges and smooth surfaces.
  3. Provide continuous welded top side wire to protect cable insulation and installers.
  4. High strength steel wires formed into a 50 x 100 mm (2 inches by 4 inches) wire mesh pattern with intersecting wires welded together.
  5. Wire Basket Sizes:
    - a. Wire Diameter: 5 mm (0.195 inch) minimum on all mesh sections.
    - b. Usable Loading Depth: 105 mm (4 inch) .
    - c. Width: 300 mm (12 inches) .
  6. Fittings: Field-formed, from straight sections, in accordance with manufacturer's instructions.
  7. Provide accessories to protect, support and install wire basket tray system.
- L. Cable Duct: Equip with hinged covers, except where removable covers are accepted by COR.
- M. Cable Duct Fittings: As recommended by cable duct OEM.

### **PART 3 - EXECUTION**

#### **3.1 EQUIPMENT INSTALLATION AND REQUIREMENTS**

- A. Raceways typically required for cabling systems unless otherwise indicated:

System	Specification Section	Installed Method
--------	-----------------------	------------------

System	Specification Section	Installed Method
Grounding	27 05 26	Conduit Not Required
Control, Communication and Signal Wiring	27 10 00	Complete Conduit Allowed in Non-Partitioned Cable Tray or Cable Ladders
Communications Structured Cabling	27 15 00	Conduit to Cable Tray Partitioned Cable Tray
Master Antenna Television Equipment and Systems	27 41 31	J-Hooks, Bridle Rings, conduit to Cable Tray, Partitioned Cable Tray
Public Address and Mass Notification Systems	27 51 16	Complete conduit
Intercommunications and Program systems	27 51 23	Conduit to Cable Tray, Partitioned Cable Tray
Nurse Call	27 52 23	Complete Conduit
Security Emergency Call, Duress Alarm, and Telecommunications	27 52 31	Conduit to Cable Tray, Partitioned Cable Tray
Miscellaneous Medical Systems	27 52 41	Complete Conduit
Distributed Radio Antenna Equipment and System	27 53 19	Conduit to Cable Tray, Partitioned Cable Tray
Grounding and Bonding for Electronic Safety and Security	28 05 26	Conduit Not Required Unless Required by Code
Physical Access Control System	28 13 00	Conduit to Cable Tray Partitioned Cable Tray
Physical Access Control System and Database Management	28 13 16	Conduit to Cable Tray Partitioned Cable Tray
Security Access Detection	28 13 53	Complete Conduit
Intrusion Detection System	28 16 00	Conduit to Cable Tray, Partitioned Cable Tray
Video Surveillance	28 23 00	Complete Conduit
Electronic Personal Protection System	28 26 00	Conduit to Cable Tray, Partitioned Cable Tray
Fire Detection and Alarm	28 31 00	Complete Conduit

B. Penetrations:

1. Cutting or Holes:

- a. Locate holes in advance of installation. Where they are proposed in structural sections, obtain approval of structural engineer and COR prior to drilling through structural sections.

- b. Make holes through concrete and masonry in new // and existing // structures with a diamond core drill or concrete saw. Pneumatic hammer, impact electric, hand or manual hammer type drills are not permitted; COR may grant limited permission by request, in condition of limited working space.
  - c. Fire Stop: Where conduits, wireways, and other communications raceways pass through fire partitions, fire walls, smoke partitions, or floors, install a fire stop that provides an effective barrier against spread of fire, smoke and gases as specified in Section 07 84 00, FIRESTOPPING.
    - 1) Fill and seal clearances between raceways and openings with fire stop material.
    - 2) Install only retrofittable, non-hardening, and reusable firestop material that can be removed and reinstalled to seal around cables inside conduits.
  - d. Waterproofing at Floor, Exterior Wall, and Roof Conduit Penetrations:
    - 1) Seal clearances around conduit and make watertight as specified in Section 07 92 00, JOINT SEALANTS or directed by waterproofing manufacturer.
    - 2) Not Used.
- C. Conduit Installation:
- 1. Minimum conduit size of 19 mm (3/4 inch), but not less than size required for 40 percent fill.
  - 2. Install insulated bushings on all conduit ends.
  - 3. Install pull boxes after every 180 degrees of bends (two 90 degree bends). Size boxes per TIA 569.
  - 4. Extend vertical conduits/sleeves through floors minimum 75 mm (3 inches) above floor and minimum 75 mm (3 inches) below ceiling of floor below.
  - 5. Terminate conduit runs to and from a backboard in a closet or interstitial space at top or bottom of backboard. Install conduits to enter telecommunication rooms next to wall and flush with backboard.
  - 6. Where drilling is necessary for vertical conduits, locate holes so as not to affect structural sections.
  - 7. Seal empty conduits located in telecommunications rooms or on backboards with a standard non-hardening putty compound to prevent



entrance of moisture and gases and to meet fire resistance requirements.

8. Minimum radius of communication conduit bends:

Sizes of Conduit Trade Size	Radius of Conduit Bends mm, Inches
3/4	150 (6)
1	230 (9)
1-1/4	350 (14)
1-1/2	430 (17)
2	525 (21)
2-1/2	635 (25)
3	775 (31)
3-1/2	900 (36)
4	1125 (45)

9. Provide 19 mm (3/4 inch) thick fire retardant plywood specified in Section 06 10 00, ROUGH CARPENTRY on wall of communication closets where shown on drawings. Mount plywood with bottom edge 300 mm (12 inches) above finished floor and top edge 2.74 m (9 feet) A.F.F.
10. Provide pull wire in all empty conduits; sleeves through floor are exceptions.
11. Complete each entire conduit run installation before pulling in cables.
12. Flattened, dented, or deformed conduit is not permitted.
13. Ensure conduit installation does not encroach into ceiling height head room, walkways, or doorways.
14. Cut conduit square with a hacksaw, ream, remove burrs, and draw tight.
15. Install conduit mechanically continuous.
16. Independently support conduit at 2.44 m (8 feet) on center; do not use other supports (i.e., suspended ceilings, suspended ceiling supporting members, luminaires, conduits, mechanical piping, or mechanical ducts).
17. Support conduit within 300 mm (1 foot) of changes of direction, and within 300 mm (1 foot) of each enclosure to which connected.
18. Close ends of empty conduit with plugs or caps to prevent entry of debris, until cables are pulled in.
19. Not Used.

20. Attach conduits to cabinets, splice cases, pull boxes and outlet boxes with bonding type locknuts. For rigid and IMC conduit installations, provide a locknut on inside of enclosure, made up wrench tight. Do not make conduit connections to box covers.
  21. Not Used.
  22. Unless otherwise indicated on drawings or specified herein, conceal conduits within finished walls, floors and ceilings.
  23. Conduit Bends:
    - a. Make bends with standard conduit bending machines; observe minimum bend radius for cable type and outside diameter.
    - b. Conduit hickey is permitted only for slight offsets, and for straightening stubbed conduits.
    - c. Bending of conduits with a pipe tee or vise is not permitted.
  24. Layout and Homeruns - Deviations: Make only where necessary to avoid interferences and only after drawings showing proposed deviations have been submitted and approved by COR.
- D. Concealed Work Installation:
1. In Concrete:
    - a. Conduit: Rigid steel or IMC.
    - b. Align and run conduit in direct lines.
    - c. Install conduit through concrete beams only when the following occurs:
      - 1) Where shown on structural drawings.
      - 2) As accepted by COR prior to construction, and after submittal of drawing showing location, size, and position of each penetration.
    - d. Installation of conduit in concrete that is less than 75 mm (3 inches) thick is prohibited.
      - 1) Conduit outside diameter larger than 1/3 of slab thickness is prohibited.
      - 2) Space between Conduits in Slabs: Approximately six conduit diameters apart, except one conduit diameter at conduit crossings.
      - 3) Install conduits approximately in center of slab to ensure a minimum of 19 mm (3/4 inch) of concrete around conduits.
    - e. Make couplings and connections watertight. Use thread compounds that are NRTL listed conductive type to ensure low resistance

ground continuity through conduits. Tightening set screws with pliers is not permitted.

E. Furred or Suspended Ceilings and in Walls:

1. Rigid steel. Different type conduits mixed indiscriminately in same system is not permitted.
2. Align and run conduit parallel or perpendicular to building lines.
3. Tightening set screws with pliers is not permitted.

F. Exposed Work Installation:

1. Unless otherwise indicated on drawings, exposed conduit is only permitted in telecommunications rooms.
  - a. Provide rigid steel, IMC or rigid aluminum.
  - b. Different type of conduits mixed indiscriminately in system is not permitted.
2. Align and run conduit parallel or perpendicular to building lines.
3. Install horizontal runs close to ceiling or beams and secure with conduit straps.
4. Support horizontal or vertical runs at not over 2400 mm (96 inches) intervals.
5. Surface Metal Raceways: Use only where shown on drawings.
6. Painting:
  - a. Paint exposed conduit as specified in Section 09 91 00, PAINTING.
  - b. Refer to Section 09 91 00, PAINTING for preparation, paint type, and exact color.
  - c. Provide labels where conduits pass through walls and floors and at maximum 6000 mm (20 foot) intervals in between.

G. Expansion Joints:

1. Conduits 75 mm (3 inches) and larger, that are secured to building structure on opposite sides of a building expansion joint, require expansion and deflection couplings. Install couplings in accordance with manufacturer's recommendations.
2. Provide conduits smaller than 75 mm (3 inches) with pull boxes on both sides of expansion joint. Connect conduits to expansion and deflection couplings as specified.
3. Install expansion and deflection couplings where shown.

H. Not Used.

I. Conduit Supports, Installation:

1. Select AC193 code listed mechanical anchors or fastening devices with safe working load not to exceed 1/4 of proof test load.

2. Use pipe straps or individual conduit hangers for supporting individual conduits. Maximum distance between supports is 2.5 m (8 foot) on center.
3. Support multiple conduit runs with trapeze hangers. Use trapeze hangers designed to support a load equal or greater than sum of the weights of the conduits, wires, hanger itself, and 90 kg (200 pounds). Attach each conduit with U-bolts or other accepted fasteners.
4. Support conduit independent of pull boxes, luminaires, suspended ceiling components, angle supports, duct work, and similar items.
5. Fastenings and Supports in Solid Masonry and Concrete:
  - a. New Construction: Use steel or malleable iron concrete inserts set in place prior to placing concrete.
  - b. Existing Construction:
    - 1) Code AC193 listed wedge type steel expansion anchors minimum 6 mm (1/4 inch) bolt size and minimum 28 mm (1-1/8 inch) embedment.
    - 2) Power set fasteners minimum 6 mm (1/4 inch) diameter with depth of penetration minimum 75 mm (3 inches).
    - 3) Use vibration and shock resistant anchors and fasteners for attaching to concrete ceilings.
6. Fastening to Hollow Masonry: Toggle bolts are permitted.
7. Fastening to Metal Structures: Use machine screw fasteners or other devices designed and accepted for application.
8. Bolts supported only by plaster or gypsum wallboard are not acceptable.
9. Attachment by wood plugs, rawl plug, plastic, lead or soft metal anchors, or wood blocking and bolts supported only by plaster is prohibited.
10. Do not support conduit from chain, wire, or perforated strap.
11. Spring steel type supports or fasteners are not permitted except horizontal and vertical supports/fasteners within walls.
12. Vertical Supports:
  - a. Install riser clamps and supports for vertical conduit runs in accordance with NEC.
  - b. Provide supports for cable and wire with fittings that include internal wedges and retaining collars.

J. Box Installation:

1. Boxes for Concealed Conduits:

- a. Flush mounted.
  - b. Provide raised covers for boxes to suit wall or ceiling, construction and finish.
2. In addition to boxes shown, install additional boxes where needed to prevent damage to cables during pulling.
  3. Remove only knockouts as required and plug unused openings. Use threaded plugs for cast metal boxes and snap-in metal covers for sheet metal boxes.
  4. Stencil or install phenolic nameplates on covers of boxes identified on riser diagrams; for example "SIG-FA JB No. 1".
  5. Outlet boxes mounted back-to-back in same wall are not permitted. A minimum 600 mm (24 inches) center-to-center lateral spacing must be maintained between boxes.

K. Flexible Nonmetallic Communications Raceway (Innerduct), Installation:

1. Install supports from building structure for horizontal runs at intervals not to exceed 900 mm (3 feet) and at each end.
2. Install supports from building structure for vertical runs at intervals not to exceed 1.2 m (4 feet) and at each side of joints.
3. Install only in accessible spaces not subject to physical damage or corrosive influences.
4. Make bends manually to assure internal diameter of tubing is not effectively reduced.
5. Extend each segment of innerduct minimum 300 mm (12 inches) beyond end of service conduit tie or cable tray. Restrain innerduct ends with wall mount clamps and seal when cable is installed.

**3.2 TESTING**

- A. Examine fittings and locknuts for secureness.
- B. Test RMC, IMC and EMT systems for electrical continuity.
- C. Perform simple continuity test after cable installation.

- - - E N D - - -



**SECTION 27 11 00  
TELECOMMUNICATIONS ROOM FITTINGS**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section specifies equipment cabinets, interface enclosures, relay racks, and associated hardware in service provider DEMARC, computer and telecommunications rooms.
- B. Telephone system is defined as an Emergency Critical Care Communication System by the National Fire Protection Association (NFPA). Adhere to Seismic reference standards for systems connecting to or extending telephone system and cabling.

**1.2 RELATED WORK**

- A. Wiring devices: Section 26 27 26, WIRING DEVICES.
- B. General electrical requirements that are common to more than one section in Division 27: Section 27 05 11, REQUIREMENTS FOR COMMUNICATIONS INSTALLATIONS.
- C. Requirements for personnel safety and to provide a low impedance path for possible ground fault currents: Section 27 05 26, GROUNDING AND BONDING FOR COMMUNICATIONS SYSTEMS.
- D. Lightning protection system: Section 26 41 00, FACILITY LIGHTNING PROTECTION.
- E. Conduits for cables and wiring: Section 27 05 33, RACEWAYS AND BOXES FOR COMMUNICATIONS SYSTEMS.
- F. Low voltage cabling system infrastructure: Section 27 10 00, CONTROL, COMMUNICATION AND SIGNAL WIRING.

**1.3 SUBMITTALS**

- A. Submit in accordance with Section 27 05 11, REQUIREMENTS FOR COMMUNICATIONS INSTALLATION.
- B. Separate submittal into sections for each subsystem containing the following:
  - 1. Pictorial layouts of each Telecommunications Room and Cross Connection Space (VCCS, and HCCS termination cabinets), each distribution cabinet layout, and TCO as each is expected to be installed and configured.
  - 2. Equipment technical literature detailing electrical and technical characteristics of each item of equipment to be furnished.
- C. Environmental Requirements: Identify environmental specifications for housing system as initial and expanded system configurations.

1. Floor loading for batteries and cabinets.
2. Minimum floor space and ceiling height.
3. Minimum door size for equipment passage.

## **PART 2 - PRODUCTS**

### **2.1 EQUIPMENT AND MATERIALS**

- A. Provide components of cabinet system (cabinet, thermal, cable and power management accessories) from a single manufacturer.
- B. Equipment Standards and Testing:
  1. Equipment must be listed by a NRTL where a UL standard is in existence; active and passive equipment must conform with each UL standard in effect for equipment, on the submittal date.
  2. Each item of electronic equipment must be labeled by a NRTL that warrants equipment has been tested in accordance with, and conforms to specified standards.
- C. Equipment Cabinets (Enclosures):
  1. Fully enclose and physically secure internally mounted and connected, active and passive equipment.
  2. Types of Equipment Enclosures accepted for specific VA Spectrum Management, FMS and OI&T applications in CFM and Facility Projects:

CABINET	FUNCTION
Communications	FMS Special Communications Equipment
Server / Router	OI&T Data/LAN/WAN Equipment
Not Used.	Not Used.
Environmental	Either FMS or OI&T use, specify need

3. Each cabinet to be:
  - a. Each TR and at a minimum.
  - b. Fabricated with minimum 1.59 mm (16 gauge) steel.
  - c. Provided with manufacturer's standard painted finish in a color accepted by COR with concurrence from FMS Service Chief.
  - d. Mounted on floor.
  - e. Lockable; tubular locks keyed alike. Provide six keys to COR for each cabinet.
  - f. Compliant with facility's SMS card access system.
4. Provide equipment mounting shelves; attach to front and rear mounting rails and allowing equipment to be secured to respective mounting rails.
5. Each enclosure to include:
  - a. Floor mounting.



- b. Knock out holes for conduit connections or cable entrance.
- c. Front and rear locking doors; wall mounted cabinets require only front locking door.
- d. Power outlet strips.
- 6. Provide quiet ventilation fan with non-disposable locally cleanable air filter.
- 7. Size each cabinet in order to contain and maintain internal mounted equipment items.
- 8. Provide OEM's fully assembled unit.
- 9. Provide OEM assembled side-by-side enclosures in a single unit, at locations requiring more than two enclosures.
- 10. Provide minimum one cabinet with blank rack space, for additional system expansion equipment.
- 11. Bond to communications circulating grounding system.
- 12. Technical Characteristics:
  - a. External:
    - 1) Overall Height:
      - a) Communications/Server: Maximum 2,184 mm (86 inches).
    - 2) Overall Depth:
      - a) Communications/Server: Maximum 914 mm (36 inches).
    - 3) Overall Width - All: Maximum 864 mm (34 inches).
  - b. Front Panel Openings:
    - 1) Width:
      - a) Communications: 482.6 mm (19 inches), per EIA.
      - b) Server: 483 mm (19 inches), per EIA/ECA 310
    - 2) Height:
      - a) Communications/Server: Maximum 2,000 mm (78-3/4 inches or 45 Rack Units [RU]), per EIA/ECA 310.
  - c. Heavy Duty Cycle: Maximum 544 kilograms (1,200 pounds) capacity.
  - d. Certification:
    - 1) NRTL (i.e. UL): For communications and server cabinets.
    - 2) Telcordia Technologies: #63-GR-CORE, (2012) for seismic cabinets.
- 13. Cabinet Internal Components:
  - a. AC Power:
    - 1) Standard "Quad AC Box":
      - a) Power capacity: 20 Ampere, single phase, 120 VAC continuous duty.

- b) Wire gauge: #12 AWG, solid copper, connected to room's internal AC Power Panel, or as directed by COR.
  - c) Number of AC power outlets: Minimum 4 receptacles.
  - d) Enclosure: Fully self-contained, metal 102 mm (4 inch) x 102 mm (4 inches) x 64 mm (2-1/2 inches) with cover
  - e) Connection: Minimum 25.4 mm (1 inch) conduit connected to room's AC Power Panel, or as directed by COR
  - f) Number of boxes: One.
  - g) Compliance: NRTL (i.e. UL); NPFA - 70 (NEC).
- b. AC Outlet Strips:
- 1) Power Capacity: 15 Ampere, single phase, 120 VAC continuous duty.
  - 2) Wire Gauge: Minimum #12 AWG, solid copper.
  - 3) Number of AC Power Outlets: Minimum 10 "U" grounded.
  - 4) Enclosure: Fully self-contained; typically metal.
  - 5) Connecting Wire: Minimum 2 m (6 feet) long, with three prong self-grounding AC plug connected to cabinet's internal AC "Quad" box.
  - 6) Number of Strips: 2.
  - 7) Certification: NRTL (i.e. UL).
- c. AC Power Line Surge Protector and Filter Construction:
- 1) Input Voltage Range: 120 VAC + 15 percent at 50/60 Hz, single phase.
  - 2) Power Service Capacity: 20 AMP, 120 VAC.
  - 3) Voltage Output Regulation: +5.0 percent, instantaneous of input.
  - 4) Circuit Breaker: 15 AMP; may be self-contained.
  - 5) AC Outlets: Minimum four duplex grounded NEMA 5-20R.
  - 6) Response Time: 5.0 nanosecond.
  - 7) Suppression: Isolate and filter any noise, surge spikes
    - a) Surge: Minimum 20,000 AMP.
    - b) Noise:
      - 1) Common: -40 dB.
      - 2) Differential: -45 dB.
  - 8) Clamping Voltage: Minimum 300 V.
  - 9) Enclosure: One; self-contained.
  - 10) Mounting: Internal to cabinet floor or on internal mounting rail shelf, allowing two plugs from two plug strips.

- 11) AC Power Cord: Required; minimum 1,628 mm (6 feet), three wire (green ground); minimum #14 AWG stranded.
  - 12) Compliance: NRTL (i.e. UL60950-1).
- d. Uninterruptible Power Supply (UPS): Provide each cabinet with an internal UPS which may be combined with surge protector and filter if system's 50 percent expansion requirement is met. Provide at least one hour continuous full load , two hours if working with a , safety ,police systems uninterruptible system primary AC Power, with a 50 percent 30 min reserve capacity, in the event of facility primary or emergency AC power failure.
- 1) UPS to include:
    - a) On-Off Switch: This function is required to be a part of system's electronic supervision requirements.
    - b) First/Fast Charge Unit: Must provide clean predicable charge voltage/current. Function is required to be a part of system's electronic supervision requirements.
    - c) Over Voltage/Current Protect: Cannot short circuit AC power line at any time. This function is required to be a part of system's electronic supervision requirements.
    - d) Trickle Charge Unit: Must be capable of maintaining a suitable internal battery charge without damaging batteries.
    - e) Mounting: Provide per OEM's direction.
    - f) Proper Ventilation: Do not override cabinets' ventilation system.
    - g) Power Change from AC Input: Accomplish change without interruption to communications link or subsystem being protected. Generate visual and aural alarms in electrical supervision system, local and remote, to annunciating panels via direct connection for trouble indication.
  - 2) Specific requirements for current and surge protection to include:
    - a) Voltage Protection: Threshold, line to neutral, starts at maximum 200 Volts peak. Transient voltage cannot exceed 330 Volts peak. Furnish documentation on peak clamping Voltage as a function of transient waveform.
    - b) Peak Power Dissipation: Minimum 35 Joules per phase, as measured for 1.0 millisecond at sub branch panels, 100

Joules per phase at branch panels and 300 Joules per phase at service entrance panels. Typically, power dissipation is 12,000 Watts (W) for 1.0 mS (or 12 Joules). Provide explanation of how ratings were measured or empirically derived.

- c) Surge Protector (may be combined with On-Off switch of UPS): Must not short circuit AC power line at any time.
  - 1) Components must be minimum silicon semi-conductors.
  - 2) Secondary stages, if used, may include other types of rugged devices.
  - 3) Indicators: Provide visual device indicating surge suppression component is functioning.
  - 4) Electrical Supervision: Required; must be audible and visual, local and remote to annunciating panels via direct connection for trouble indication.
- d) Provide current and surge protection on ancillary equipment.
- e) Equip each cabinet with the following:
  - 1) Equipment Mounting Rails (Front & Rear): Fully adjustable internal equipment mounting rails allowing front or rear equipment mounting with pre-drilled EIA/ECA 310-E Standard tapped holes. Support entire equipment by supplementary support in addition to face mounting screws on rails.
  - 2) Cabinet Ground: Stainless steel adjustable, lug connected to cabinet's main structure providing an internal cabinet ground for all installed equipment properly bolted to rail and with ground wire connected.
  - 3) Grounding Terminals: A separate mounting hole on equipment mounting rail, with stainless steel connecting bolt bonded by minimum #10 AWG copper wire to cabinet's internal grounding lug.
- 14. Ground Interconnection: Bond cabinet's common grounding lug to room's communications circulating ground busbar with a minimum #4 AWG stranded copper wire.
- 15. Blank Panels: Provide at every unused rack space.
  - a. Match cabinet color.

- b. Provide panels of 3 mm (1/8 inch) thick aluminum with vertical dimensions in increments of one rack unit (RMU) or 45 mm (1-3/4 inch) with mounting holes spaced to correspond to EIA/ECA 310-E Standard 483 mm (19 inch) rack dimensions.
  - c. Fill large unused openings with single standard large panel instead of numerous types.
  - d. Leave one blank rack space (RMU), covered with a blank panel, between each item of equipment, for minimum internal air flow.
  - e. Leave 356 mm (14 inches)(8.0 RMU) open space, covered with blank cover panel, for additional expansion equipment.
  - f. Wire Management: System that connects each item of installed equipment to room wire management system.
  - g. Knock-out Holes: Provide for cable entrance/exits via conduits, cable duct/trays.
- D. NOT USED.
- E. NOT USED.
- F. Stand Alone Open Equipment Rack:
- 1. Construct of minimum 1.59 mm (16 gauge) cold rolled steel with manufacturer's standard paint finish, in a color to be selected by COR with concurrence from facility's FMS Service Chief.
  - 2. Floor-mount as directed by COR with concurrence from facility's FMS Service Chief.
  - 3. Equip rack same as equipment cabinet, except mount UPS with additional support for weight and AC power connection in conduit to AC service panel.
  - 4. Provide an OEM fully assembled unit.
  - 5. Technical Characteristics:
    - a. Overall Height: Maximum 2,180 mm (85-7/8 inches).
    - b. Overall Depth: Maximum 650 mm (25-1/2 inches).
    - c. Overall Width: Maximum 535 mm (21-1/16 inches).
    - d. Front Panel Opening: 483 mm (19 inches), EIA/ECA 310 horizontal width.
    - e. Hole Spacing: Per EIA/ECA 310.
    - f. Load Capacity: Maximum 680.4 kg (1,500 lbs).
    - g. Certifications:
      - 1) EIA/ECA: 310-E.
      - 2) NRTL (i.e. UL): OEM specific.
- G. Wire Management Equipment:

1. Provide an orderly horizontal and vertical interface between outside and inside wires and cables, distribution and interface wires and cables, interconnection wires and cables and associated equipment, jumper cables, and provide an uniform connection media for system fire-retardant wires and cables and other subsystems.
2. Interface to each cable tray, duct, wireway, or conduit used in the system.
3. Interconnection or distribution wires and cables must enter system at top (or from a wireway in the floor) via overhead protection system and be uniformly routed down // either or // both sides at same time, of the frames side protection system, then laterally for termination on rear of each respective terminating assembly.
4. Custom configure to meet 30 percent fill system design and user needs.

H. Vertical Cable Managers:

1. Use same make, style and size of vertical cable manager on rack/frame or in between racks/frames when more than one cable manager is used on a rack/frame or group of racks/frames.
2. Match color and cover style of racks/frames and cable managers.

I. Horizontal Cable Managers:

1. Use same make and style of cable manager on rack/frame or racks/frames, when more than one horizontal cable manager is used on a rack/frame or group of racks/frames.
2. Match color of racks/frames and cable managers.

J. Not Used.

K. Not Used.

L. Provide installation hardware when enclosures or racks are attached to structural floor.

M. Provide noise filters and surge protectors for each equipment interface cabinet, switch equipment cabinet, control console, and local and remote active equipment locations to ensure protection from input primary AC power surges so as a consequence noise glitches are not induced into low voltage data circuits.

### **PART 3 - EXECUTION**

#### **3.1 PREPARATION**

A. Coordinate cabinet installation such that doors fully close and lock, with active and passive equipment installed and connected.

- B. Verify equipment dimensions and brackets allow mounting with cabinet doors closed. Front door or rear door of any cabinet that does not close and lock may result in immediate cancellation of inspections or tests.

### **3.2 INSTALLATION**

#### **A. Equipment Cabinets:**

1. Install cabinets in a manner that complies with OEM instructions, requirements of this specification, and in a manner which does not constitute a safety hazard.
2. Not Used.
3. Install equipment indoors in NEMA 4 rated metal cabinets with hinged doors and locks with two keys.

#### **B. Grounding:**

1. Bond equipment, including identified Government furnished equipment, to ground so total ground resistance measures maximum 0.1 Ohm.
  - a. Install lightning arrestors and grounding in accordance with NFPA.
  - b. Install gas protection devices at nearest point of entrance in buildings where protection is required and on same circuits as MDF in telephone switch room.
  - c. Do not use AC neutral, including in power panel or receptacle outlet, for system control, subcarrier or audio reference ground.
  - d. Use of conduit, signal duct or cable trays as system or electrical ground is not permitted.
2. Connect each equipment grounding terminal to a separate mounting hole on equipment mounting rail, to right as one looks at it from rear, with a minimum #12 AWG stranded copper wire with protective green jacket.
3. Extend common ground bus of minimum #10 AWG solid copper wire throughout each equipment cabinet and bond to TGB. Provide a separate isolated ground connection from each equipment cabinet ground bus to system ground. Do not tie equipment ground buses together.
4. Bond equipment to cabinet bus with copper braid equivalent to #12 AWG. Self-grounding equipment enclosures, racks or cabinets, that provide OEM certified functional ground connections through physical contact with installed equipment, are acceptable alternatives.

5. Bond cable shields to cabinet ground bus with minimum #12 AWG stranded copper wire at only one end of cable run. Insulate cable shields from each other, faceplates, equipment racks, consoles, enclosures or cabinets, except at system common ground point. Bond coaxial and audio cables only at source; in all cases, keep cable shield ground connections to a minimum.

C. Equipment Assembly:

1. Cabinets:

- a. Install and adjust cabinet/frame accessories to position, including thermal management accessories, vertical cable managers, vertical power managers and equipment-mounting rails, using manufacturer's installation instructions prior to baying or placing cabinet for attachment to building and before installing any rack-mount equipment into cabinet. Shelves, horizontal cable managers and filler panels (rack-mount accessories), if used, may be installed after cabinet is placed.
- b. When used in a multi-cabinet bay, attach cabinets side-by-side using baying kits according to manufacturer's instructions.
- c. Attach overhead ladder rack or cable tray to ceiling or top of cabinet. Maintain minimum 75 mm (3 inches) clearance between top of cabinet and bottom of ladder rack/cable tray. Position ladder rack/cable tray so that it does not interfere with hot air exhaust through cabinet's top panel. Use radius drops where cable enters or exits ladder rack/cable tray.
- d. Not Used.
- e. Install ladder rack with side stringers facing rack or cabinet so that ladder forms an inverted U-shape and so that welds between stringers (sides) and cross members (middle) face away from cables.
- f. Secure ladder rack to tops of equipment racks or cabinets using manufacturer's recommended supports and appropriate hardware.
- g. Attach bonding conductor sized per TIA-607-B between telecommunications grounding busbar and cabinet. Attach bonding conductor to cabinet using a ground terminal block according to manufacturer's installation instructions.
- h. Provide bonding conductor and other hardware required to make connections between cabinet and telecommunications grounding busbar.



- i. Install rack mounted equipment normally requiring adjustment or observation so operational adjustments can be conveniently made.
  - j. Mount heavy equipment with rack slides or rails to allow servicing from front of enclosure. Provide support in addition to front panel mounting screws for heavy equipment.
  - k. Provide with cable slack to permit servicing by removal of installed equipment from front of enclosure.
  - l. Install color-matched blank panel spacer 44 mm (1.75 inches) high between each piece of active and passive equipment to ensure adequate air circulation for efficient equipment cooling and air ventilation.
  - m. Provide quiet fans and non-disposable air filters at each console or cabinet.
  - n. Install enclosures and racks plumb and square, permanently attached to building structure and held in place.
  - o. Provide 381 mm (15 inches) of front vertical space opening for additional equipment.
  - p. Install equipment located indoors in metal racks or enclosures with hinged doors to allow access for maintenance without causing interference to other nearby equipment.
  - q. Cables must enter equipment racks or enclosures in such a manner to allow doors or access panels to open and close without disturbing or damaging cables.
  - r. Mount distribution hardware in a manner that allows access to connections for testing and provides room for doors or access panels to open and close without disturbing the cables.
2. Racks:
- a. Assemble racks according to manufacturer's instructions.
  - b. Verify that equipment mounting rails are sized properly for rack-mount equipment before attaching rack to floor.
  - c. Attach assembled racks to floor in four places using appropriate floor mounting anchors. When placed over a raised floor, threaded rods should pass through raised floor tile and be secured in structural floor below.
  - d. Bond racks to telecommunications grounding busbar using appropriate hardware provided by contractor.
  - e. Not Used.

- f. Ladder rack may be attached to top of rack to deliver cables to rack. Do not drill rack to attach; use appropriate hardware from rack manufacturer.
  - g. Provide radius drops to guide cable where cable exits or enters side of overhead ladder rack to access a rack, frame, cabinet or wall-mounted rack, cabinet or termination field.
  - h. Evenly distribute equipment load on rack. Place large and heavy equipment towards bottom of rack. Secure equipment to rack with equipment mounting screws.
3. Vertical Cable Managers:
- a. Provide vertical managers so number of cables in each manager does not exceed OEM fill capacity.
  - b. Attach vertical cable managers to side of rack/frame using manufacturer's installation instructions and hardware.
  - c. Attach vertical cable manager to both racks/frames when a single vertical cable manager is used between two racks/frames.
  - d. Dress cables through openings in between T-shaped guides on manager so that cables make gradual bends as they exit or enter cable manager into rack-mount space (RMU). Do not twist, coil or make sharp bends in cables.
  - e. Attach doors to cable manager in closed position after cabling is complete.
4. Horizontal Cable Managers:
- a. Attach horizontal cable managers to rack/frame with minimum four screws according to manufacturer's installation instructions. Center each cable manager within allocated rack-mount space (RMU).
  - b. Provide horizontal managers located so number of cables each manager supports is less than cable manager's cable fill capacity.
  - c. Dress cables through openings in between T-shaped guides on cable manager so that cables make gradual bends as they exit or enter cable manager into rack-mount space (RMU). Do not twist, coil or make sharp bends in cables.
  - d. Attach covers to cable manager in closed position after cabling is complete.
- D. Labeling: Permanently label each enclosure in accordance with TIA-606-B using laser printers ; handwritten labels are not acceptable.

1. Equipment: Label system equipment with contrasting plastic laminate or bakelite material on face of unit corresponding to its source.
2. Conduit, Cable Duct, and/or Cable Tray: Label conduit, duct and tray, including utilized GFE, with permanent marking devices or spray painted stenciling a minimum of 3 m (10 feet), identifying system.

- - - E N D - - -



**SECTION 27 15 00  
COMMUNICATIONS STRUCTURED CABLING**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section specifies a complete and operating voice and digital structured cabling distribution system and associated equipment and hardware to be installed in VA Medical Center, here-in-after referred to as the "facility".

**1.2 RELATED WORK**

- A. Wiring devices: Section 26 27 26, WIRING DEVICES.
- B. Lightning protection system: Section 26 41 00, FACILITY LIGHTNING PROTECTION.
- C. General electrical requirements that are common to more than one section in Division 27: Section 27 05 11, REQUIREMENTS FOR COMMUNICATIONS INSTALLATIONS.
- D. Requirements for personnel safety and to provide a low impedance path for possible ground fault currents: Section 27 05 26, GROUNDING AND BONDING FOR COMMUNICATIONS SYSTEMS.
- E. Conduits for cables and wiring: Section 27 05 33, RACEWAYS AND BOXES FOR COMMUNICATIONS SYSTEMS.
- F. Low voltage cabling system infrastructure: Section 27 10 00, CONTROL, COMMUNICATION AND SIGNAL WIRING.
- G. Not Used.
- H. Not Used.
- I. Not Used.
- J. High Definition (HDTV) Master Antenna Television (MATV) system and associated equipment: Section 27 41 31, MASTER ANTENNA TELEVISION EQUIPMENT AND SYSTEMS.
- K. Emergency Service Public Address System (PAS) and associated equipment: Section 27 51 16, PUBLIC ADDRESS AND MASS NOTIFICATION SYSTEMS.

**1.3 SUBMITTALS**

- A. In addition to requirements of Section 27 05 11, REQUIREMENTS FOR COMMUNICATIONS INSTALLATIONS provide:
1. Pictorial layout drawing of each telecommunications room, showing termination cabinets, each distribution cabinet and rack, as each is expected to be installed and configured.
  2. List of test equipment as per 27 05 11, REQUIREMENTS FOR COMMUNICATIONS INSTALLATIONS.

B. Certifications:

1. Submit written certification from OEM indicating that proposed supervisor of installation and proposed provider of contract maintenance are authorized representatives of OEM. Include individual's legal name and address and OEM warranty credentials in the certification.
2. Pre-acceptance Certification: Submit in accordance with test procedures.
3. Test system cables and certify to Project Manager before proof of performance testing can be conducted. Identify each cable as labeled on as-installed drawings.
4. Provide current and qualified test equipment OEM training certificates and product OEM installation certification for contractor installation, maintenance, and supervisory personnel.

C. Closeout Submittal: Provide document from OEM certifying that each item of equipment installed conforms to OEM published specifications.

**1.4 WARRANTY**

A. Work subject to terms of Article "Warranty of Construction," FAR clause 52.246-21.

**PART 2 - PRODUCTS**

**2.1 PERFORMANCE AND DESIGN CRITERIA**

A. Provide complete system including "punch down" and cross-connector blocks voice and data distribution sub-systems, and associated hardware including telecommunications outlets (TCO); copper and fiber optic distribution cables, connectors, "patch" cables, "break out" devices and equipment cabinets, interface cabinets, and radio relay equipment rack.

B. Industry Standards:

1. Cable distribution systems provided under this section are connected to systems identified as critical care performing life support functions.
2. Conform to National and Local Life Safety Codes (whichever are more stringent), NFPA, NEC, this section, Joint Commission Life Safety Accreditation requirements, and OEM recommendations, instructions, and guidelines.
3. Provide supplies and materials listed by a nationally recognized testing laboratory where such standards are established for supplies, materials or equipment.

4. Refer to industry standards and minimum requirements of Section 27 05 11, REQUIREMENTS FOR COMMUNICATIONS INSTALLATIONS and guidelines listed.
  5. Active and passive equipment required by system design and approved technical submittal; must conform to each UL standard in effect for equipment, when technical submittal was reviewed and approved by Government or date when Project Manager accepted system equipment to be replaced. Where a UL standard is in existence for equipment to be used in completion of this contract, equipment must bear approved NRTL label.
- C. System Performance: Provide complete system to meet or exceed TIA Category 6 requirements.
- D. Provide continuous inter- and/or intra-facility voice, data, and analog service.
1. Provide voice and data cable distribution system based on a physical "Star" topology.
  2. Provide separate cable distribution system for emergency, safety and protection systems (i.e. emergency bypass phones; police emergency voice communications from parking lots and stairwells personal protection, duress alarms and annunciation systems; etc.)
  3. Contact SMCS 0050P2H3 (202-462-5310) for specific technical assistance and approvals.
- E. Specific Subsystem Requirements: Provide products necessary for a complete and functional voice, data, analog and videotele communications cabling system, including backbone cabling system, patch panels and cross-connections, horizontal cabling systems, jacks, faceplates, and patch cords.
- F. Coordinate size and type of conduit, pathways and firestopping for maximum 40 percent cable fill with subcontractors.
- G. Terminate all interconnecting twisted pair, fiber-optic or coaxial cables on patch panels or punch blocks. Terminate unused or spare conductors and fiber strands. Do not leave unused or spare twisted pair wire, fiber-optic or coaxial cable unterminated, unconnected, loose or unsecured.
- H. Color code distribution wiring to conform to ANSI/TIA 606-B and construction documents, whichever is more stringent. Label all equipment, conduit, enclosures, jacks, and cables on record drawings, to facilitate installation and maintenance.

- I. In addition to requirements in Section 27 05 11, REQUIREMENTS FOR COMMUNICATION INSTALLATIONS, provide stainless steel faceplates with plastic covers over labels.

## 2.2 EQUIPMENT AND MATERIALS

A. Not Used.

B. Cable Systems - Twisted Pair, Fiber optic, Coaxial and Analog:

### 1. General:

- a. Provide cable (i.e. backbone, outside plant, and horizontal cabling) conforming to accepted industry standards with regards to size, color code, and insulation.
- b. Some areas can be considered "plenum". Comply with all codes pertaining to plenum environments. It is contractor's responsibility to review the VA's cable requirements with Project Manager and OI&T Service prior to installation to confirm type of environment present at each location.
- c. Provide proper test equipment to confirm that cable pairs meet each OEM's standard transmission requirements, and ensure cable carries data transmissions at required speeds, frequencies, and fully loaded bandwidth.

### 2. Telecommunications Rooms (TR):

- a. In TR's served with UTP fiber optic, coaxial and analog backbone cables, terminate UTP cable on RJ-45, 8-pin connectors of separate 48-port modular patch panels, .
- b. Provide 24 port fiber optic modular patch panels with "LC" or OEM specified couplers dedicated for voice, data and FMS applications.
- c. Provide connecting cables required to extend backbone cables (i.e. patch cords, twenty-five pair, etc.), to ensure complete and operational distribution systems.
- d. In TR's, which are only served by a UTP backbone cable, terminate cable on separate modular connecting devices, Type 110A punch down blocks (or equivalent), dedicated to data applications.

### 3. Backbone Copper Cables:

#### a. Riser Cable:

- 1) Provide communication riser cables listed in NEC Table 800, 154(a) for the purpose and suited for electrical connection to a communication network.



- 2) Provide Unshielded Twisted Pair (UTP), minimum 24 American Wire Gauge (AWG) solid, thermoplastic insulated conductors for communication (analog RF coaxial cable is not to be provided in riser systems) riser cables with a thermoplastic outer jacket.
- 3) Label and test complete riser cabling system.
4. Horizontal Cable: Installed from TCO jack to the TR patch panel.
  - a. Tested to ANSI/TIA-568-C.2 Category 6 requirements including NEXT, ELFEXT (Pair-to-Pair and Power Sum), Insertion Loss (attenuation), Return Loss, and Delay Skew.
  - b. Minimum Transmission Parameters: 500 MHz.
  - c. Provide four pair 0.205 mm<sup>2</sup> (24 AWG) cable
  - d. Terminate all four pairs on same port at patch panel in TR.
  - e. Terminate all four pairs on same jack, at work area

Telecommunication Outlets (TCO):

  - 1) Jacks: Minimum four eight-pin RJ-45 ANSI/TIA-568-C.2 Category 6 Type jacks at TCO.
    - a) Top Port: RJ-45 jack compatible with RJ-11 plug for voice.
    - b) Bottom Two Ports: Unkeyed RJ-45 jacks for data.
5. Not Used.
6. Fiber Optics Backbone Cable:
  - a. Provide 50/125 micron OM4 multi-mode cable, containing at minimum 18 strands of fiber, unless otherwise specified.
  - b. Provide loose tube cable, which separates individual fibers from the environment, or indoor/outdoor cables, for outdoor runs or any area that includes an outdoor run.
  - c. Provide tight buffered fiber cable or indoor/outdoor cables for indoor runs.
  - d. Terminate multimode fibers at both ends with LC OR as directed by VA Project Manager, type female connectors installed in an appropriate patch or breakout panel and secured with a cable management system. Provide minimum 610 mm (2 ft.) cable loop at each end.
  - e. Not Used.
  - f. Install fiber optic cables in TR's, Voice (Telephone) Switch Room, and Main Computer Room, in rack mounted fiber optic patch panels. Provide female LC OR as directed by VA Project Manager, couplers in appropriate panel for termination of each strand.

- g. Test all fiber optic strands' cable transmission performance in accordance with TIA standards. Measure attenuation in accordance with fiber optic test procedures TIA-455-C ('-61', or -53). Provide written results to Project Manager for review and approval.
- C. Cross-Connect Systems (CCS):
  - 1. Copper Cables: Provide copper CCS sized to connect cables at TR and allow for a minimum of 50 percent anticipated growth.
  - 2. Maximum DC Resistance per Cable Pair: 28.6 Ohms per 305 m (1,000 feet).
  - 3. Fiber Optic Cables:
    - a. Provide fiber CCS sized to connect cables at TR and allow for a minimum of 50 percent anticipated growth.
    - b. Install fiber optic cable slack in protective enclosures.
- D. Telecommunication Room (TR):
  - 1. Terminate backbone and horizontal, copper, fiber optic, coaxial and analog cables on appropriate cross-connection systems (CCS) containing patch panels, punch blocks, and breakout devices provided in enclosures and tested, regardless of installation method, mounting, termination, or cross-connecting used. Provide cable management system as a part of each CCS.
  - 2. Coordinate location in TR with FMS equipment (i.e. fire alarm, nurse call, code blue, video, public address, radio entertainment, intercom, and radio paging equipment).
- E. Coaxial and Analog Cables: Bond equipment to ground per TIA standards, such that all grounding systems comply with all applicable National, Regional, and Local Building and Electrical codes.
  - 1. Provide current arrester for each copper or coaxial cable that enters from outside of a building regardless if cable is installed underground or aerial.
  - 2. Provide a gas surge protector/module and bond to earth ground.
- F. Main Cross-connection Subsystem (MCCS): MCCS is common point of distribution for inter- and intra-building copper and fiber optic backbone system cables, and connections to the voice (telephone) and data cable systems.
- G. Voice (or Telephone) Cable Cross-Connection Subsystem:
  - 1. Provide Insulation Displacement Connection (IDC) hardware.

2. Provide the following for each Category 5E (or on a case by case basis Category 66 for specialized powered systems technically accepted by SMCS 0050P2H3, (202) 461-5310, OI&T and FMS Services and Project Manager) Cabling System termination; cross-connection wires, RJ-45 patch cord connector to RJ-45 patch cord connector .
    - a. Provide terminations to be accessible without need for disassembly of IDC wafer. Provide IDC wafers removable from their mounts to facilitate testing on either side of connector.
    - b. Provide removable designation strips or labels to allow for inspection of terminations.
    - c. Provide cable management system as a part of IDC.
  3. Provide IDC connectors capable of re-terminations, without damage, a minimum of 200 IDC insertions or withdrawals on either side of connector panel.
  4. Install using only non-impact terminating tool having both a tactile and an audible feedback to indicate proper termination.
  5. Provide inputs from PBX, FTS, Local Voice (Telephone) System, or diverse routed voice distribution systems on left side of IDC (110A blocks with RJ45 connections are acceptable alternates to IDC) of MCCA.
  6. Provide system outputs from MCCA to voice backbone cable distribution system on the right side of same IDC (or 110A blocks) of MCCA.
  7. Do not split pairs within cables between different jacks or connections.
  8. Provide UTP cross connect wire to connect each pair of terminals plus an additional 50 percent spare.
- H. Data Cross-Connection Subsystems:
1. Provide patch panels with modular RJ45 female to 110 connectors for cross-connection of copper data cable terminations and system ground with cable management system.
  2. Provide patch panels conforming to EIA/ECA 310-E dimensions and suitable for mounting in standard equipment racks, with 48 RJ45 jacks aligned in two horizontal rows per panel. Provide RJ45 jacks of modular design and capable of accepting and functioning with other modular (i.e. RJ11) plugs without damaging jack.

- a. Provide system inputs from servers, data LAN, bridge, or interface distribution systems on top row of jacks of appropriate patch panel.
  - b. Provide backbone cable connections on bottom row of jacks of same patch panel.
  - c. Provide patch cords for each system pair of connection jacks with modular RJ45 connectors provided on each end to match panel's modular RJ45 female jack's being provided.
- I. Fiber-Optic Cross-Connection Subsystems: Provide rack mounted patch or distribution panels installed inside a lockable cabinet or "breakout enclosure" that accommodate minimum 12 strands multimode fiber and 12 strand single mode fiber - these counts do not include 50 percent spare requirement. Provide cable management system for each panel.
- 1. Provide panels for minimum 24 female LC OR as directed by VA Project Manager, connectors, able to accommodate splices and field mountable connectors and have capacity for additional connectors to be added up to OEM's maximum standard panel size for this type of use. Protect patch panel sides, including front and back, by a cabinet or enclosure.
  - 2. Provide panels that conform to EIA/ECA 310-E dimensions suitable for installation in standard racks, cabinets, and enclosures.
  - 3. Provide patch panels with highest OEM approved density of fiber LC OR as directed by VA Project Manager, termination's (maximum of 72 each), while maintaining a high level of manageability. Provide proper LC or as directed by VA Project Manager, couplers installed for each pair of fiber optic cable LC or as directed by VA Project Manager, connectors.
    - a. Provide system inputs from interface equipment or distribution systems on top row of connectors of appropriate patch panel.
    - b. Provide backbone cable connections on bottom row of connectors of same patch panel.
    - c. Provide patch cords for each pair of fiber optic strands with connector to match couplers.
  - 4. Provide field installable connectors that are pre-polished.
    - a. Terminate every fiber cable with appropriate connector, and test to ensure compliance to specifications and industry standards for fiber optic LC or as directed by VA Project Manager, female connector terminated with a fiber optic cable.

- b. Install a terminating cap for each unused LC or as directed by VA Project Manager, connector.
- J. Not Used.
- K. Horizontal Cabling (HC):
  - 1. Horizontal cable length to farthest system outlet to be maximum of 90 m (295 ft).
  - 2. Splitting of pairs within a cable between different jacks is not permitted.
- L. Air Blown Fiber: Alternative fiber optic cable installation method.
  - 1. Air blown fiber installation process (also referred to as air blown cable, air assisted cable, high pressure air blowing, cable jetting, and referred to as air blown fiber herein) typically uses separate optical fiber cables along with separate flexible protective microducts installed where optical fiber cables can be blown in using specific equipment, trained installation personnel and practices.
  - 2. Indoor Microducts:
    - a. Provide empty bundled microducts comprising an inner layer of microducts optimized for air blown fiber system and an outer jacket layer of plenum riser rated material with product identification and sequential length marking on outer layer at minimum one-meter (three feet) intervals.
    - b. Provide microduct allowing multiple fibers to be installed simultaneously into each microduct using air blown fiber installation technique and fibers to also be removed from microduct using same technique.
    - c. Size each microduct for 50 percent unoccupied microducts after initial fiber bundle installation.
    - d. Furnish microducts that maintain minimum bend radius of 20 times cable diameter.
    - e. Provide quantity of plugs or end-caps so all unoccupied microducts are plugged on both ends per manufacturer's specifications. Provide plugs or end-caps that can be easily installed or removed from duct connectors as needed over the lifetime of the installation.
  - 3. Not Used.
  - 4. Microduct Couplers: Provide plastic-bodied pneumatic connector to join microducts of same size.

- a. Provide straight connectors constructed of a transparent plastic material permitting a visual verification of fiber population.
  - b. Provide tee connectors with additional port allowing for gas-blocking in internal/external situations, or provide gas-blocking couplers as needed to protect and isolate classified areas from non-classified areas or provide close-down connectors if needed for midspan assisted blows in long runs
5. Microduct Distribution Units: Provide NEMA-rated enclosure, suited for site environmental conditions provided for microduct distribution, routing, and termination.
- a. Provide unit capable of wall mounting to provide proper geometry for distribution wherever several microducts enter same location or where microduct type transitions take place.
  - b. Size based on number of microducts to enter unit.
6. Not Used.
7. Fiber Termination Units: Provide at locations where fiber is to be terminated.
- a. Provide for strain relief of incoming microducts.
  - b. Provide connector panels and connector couplings adequate to accommodate the number of fibers to be terminated.
  - c. Incorporate radius control mechanisms to limit bending of fibers to manufacturer's recommended minimum or 76 mm (3 inches), whichever is larger.
  - d. Where rack-mount fiber termination hardware is required, provide wall-mount microduct distribution unit near rack and provide individual microducts to route and connect fiber bundle passing through microduct distribution units to fiber termination hardware.
  - e. Provide LC or as directed by VA Project Manager, connectors mounted on a coupler panel that snaps into patch panel housing assembly.
8. Fiber Bundles or Cables:
- a. Provide fiber bundles or cables designed and manufactured to facilitate:
    - 1) Rapid installation of fiber using air blown fiber installation process without risk or damage to fibers.
    - 2) Re-installation without degradation of the optical specifications and performance of fiber.

- 3) Transition points from indoor to outdoor environments without splices.
- b. Provide jacketed optical fibers manufactured so that the jacketed fiber strands meet GR409 and meet either UL 1666 for riser rated cables or UL 910 for plenum rated cables and are specific to the purpose of being blown throughout the bundled microduct system.
- c. Provide fiber designed to be stripped and terminated with standard tools.
- d. Provide fiber designed to be terminated with standard fiber optic connectors.
- e. Provide maximum 72 strands of fiber to be blown within each microduct; if fiber counts higher than 72 strands are required, provide microcore fiber with counts to 432 strands in larger size microducts.

### **2.3 DISTRIBUTION EQUIPMENT AND SYSTEMS**

#### **A. Telecommunication Outlet:**

- 1. TCO consists of minimum one voice (telephone) RJ45 jack and two data RJ45 jacks mounted in a separate steel outlet box 100 mm (4 inches) x 100 mm (4 inches) x 63 mm (2-1/2 inches) minimum with a labeled stainless steel faceplate. Where shown on drawings, provide a second steel outlet box minimum 100 mm (4 inches) x 100 mm (4 inches) x 63 mm (2-1/2 inches), with a labeled faceplate, adjacent to first box to ensure system connections and expandability requirements are met.
- 2. Provide RJ-45/11 compatible female type voice (telephone) multi-pin connections. Provide RJ-45 female type data multi-pin connections.
- 3. Provide wall outlet with a stainless steel face plate and sufficient ports to fit voice (telephone) multi-pin jack, data multi-pin jacks and plastic covers for labels when mounted on outlet box provided (minimum 100mm (4 inches) x 100mm (4 inches) for single and 100mm (4 inches) x 200mm (8 inches) for dual outlet box applications. Install stainless steel face plate, for prefabricated bedside patient unit installations.

#### **B. Backbone Distribution Cables:**

- 1. Meet TIA transmission performance requirements of Voice Grade Category 6.
- 2. Provide cable listed for environments where it is installed.
- 3. Technical Characteristics:
  - a. Length: As required, in minimum 1 kilometer (3,000 ft.) reels.

## b. Size:

1) Not Used.

2) Minimum 0.205 mm<sup>2</sup> (24 AWG) interior installations.

c. Color Coding: American Telephone and Telegraph Company Standard;  
Bell System Practices Outside Plant Construction and Maintenance  
Section G50.607.3, Issue 2 February, 1959.

d. Minimum Bend Radius: 10X cable outside diameter.

e. Impedance: 120 Ohms + 15 percent.

f. DC Resistance: Maximum 8.00 ohms/100 m

g. Shield Coverage: As required by drawing notes single shield tape  
design.

h. Maximum attenuation for 100m at 20° C:

Frequency (MHz)		Category 5e (dB) /	Category 6 (dB)	
.772		-	-	
1		2.0	2.0	
4		4.1	3.8	
8		5.8	5.3	
10		6.5	6.0	
16		8.2	7.6	
20		9.3	8.5	
25		10.4	9.5	
31.25		11.7	10.7	
62.5		17.0	15.4	
100		22.0	19.8	
200			29.0	
250			32.8	
300				
400				
500				

## 4. Data Multi-Conductor:

a. Unshielded cable with solid conductors.



- b. Able to handle the power and voltage used over the distance required.
- c. Meets TIA transmission performance requirements of Category 6 .
- d. Technical Characteristics:
  - 1) 0.205 mm<sup>2</sup> (24 AWG) - 0.326 mm<sup>2</sup> (22 AWG) cable
  - 2)
  - 3) Bend Radius: 10 times cable outside diameter.
  - 4) Impedance: 100 Ohms + 15%, BAL.
  - 5) Bandwidth: 500 MHz .
  - 6) DC Resistance: Maximum 9.38 Ohms/100m (328 ft.) at 20 degrees C.
  - 7) Maximum Mutual Capacitance: 5.6 nF per 100 m (328 ft.).
  - 8) Shield Coverage:
    - a) Overall Outside (if OEM specified): 100 percent.
    - b) Individual Pairs (if OEM specified): 100 percent.
  - 9) Maximum attenuation for 100m (328 ft.) at 20° C:

Frequency (MHz)		Category 6 (dB)	
1		2.0	
4		3.8	
8		5.3	
10		6.0	
16		7.6	
20		8.5	
25		9.5	
31.25		10.7	
62.5		15.4	
100	22.0	19.8	
200		29.0	
250		32.8	
300			
400			

Frequency (MHz)		Category 6 (dB)	
500			

5. Fiber Optic:

a. Multimode Fiber:

- 1) Provide OM4 Type general purpose multimode fiber optic cable installed in conduit for system locations with load-bearing support braid surrounding inner tube for strength during cable installation.
- 2) Technical Characteristics:
  - a) Bend Radius: Minimum 152 mm (6 inches); outer jacket as required.
  - b) Fiber Diameter: 50 microns.
  - c) Cladding: 125 microns.
  - d) Attenuation:
    - 1) 850 nanometer: Maximum 4.0 dB per kilometer.
    - 2) 1,300 nanometer: Maximum 2.0 dB per kilometer.
  - e) Bandwidth:
    - 1) 850 nanometer: Minimum 160 MHz.
    - 2) 1,300 nanometer: Minimum 500 MHz.
  - f) Connectors: Stainless steel.

b. Not Used.

C. Outlet Connection Cables:

1. Voice (Telephone):

- a. Provide a connection cable for each TCO voice (telephone) jack in system with 10 percent spares able to connect voice (telephone) connection cable from voice (telephone) instrument to TCO voice (telephone) jack. Do not provide voice (telephone) instruments or equipment.
- b. Technical Characteristics:
  - 1) Length: Minimum 1.8 m (6 feet).
  - 2) Cable: Voice Grade.
  - 3) Connector: RJ-11/45 compatible male on each end.
  - 4) Size: Minimum 24 AWG.
  - 5) Color Coding: Required, telephone industry standard.

2. Data:

- a. Provide a connection cable for each TCO data jack in system with 10 percent spares to connect a data instrument to TCO data jack. Do not provide data terminals/equipment.
- b. Technical Characteristics:
  - 1) Length: Minimum 1.8 m (6 feet).
  - 2) Cable: Data grade Category 5E or on a case-by-case basis Category 6 for specialized powered systems accepted by SMCS 0050P2H3 (202) 461-5310, IT and FMS Services and Project Manager.
  - 3) Connector: RJ-45 male on each end.
  - 4) Color Coding: Required, data industry standard.
  - 5) Size: Minimum 24 AWG.
- 3. Fiber Optic:
  - a. Provide a connection cable for each TCO fiber optic connector in system with 10 percent spares. Provide data connection cable to connect a fiber optic instrument to TCO fiber optic jack. Do not provide fiber optic instruments/equipment.
  - b. Technical Characteristics:
    - 1) Length: Minimum 1.8 m (6 feet).
    - 2) Cable: Flexible single conductor with jacket.
    - 3) Connector: LC or as directed by VA Project Manager, male on each end.
    - 4) Size: To fit OM1 single mode cable.
- D. System Connectors:
  - 1. Modular (RJ-45/11 and RJ-45): Provide voice and high speed data transmission applications type modular plugs compatible with voice (telephone) instruments, computer terminals, and other type devices requiring linking through modular telecommunications outlet to the system compatible with UTP cables.
    - a. Technical Characteristics:
      - 1) Number of Pins:
        - a) RJ-45: Eight.
        - b) RJ-11/45: Compatible with RJ-45.
      - 2) Dielectric: Surge.
      - 3) Voltage: Minimum 1,000V RMS, 60 Hz at one minute.
      - 4) Current: 2.2A RMS at 30 minutes or 7.0A RMS at 5.0 seconds.
      - 5) Leakage: Maximum 100  $\mu$ A.
      - 6) Connections:

- a) Initial contact resistance: Maximum 20 milli-Ohms.
- b) Insulation displacement: Maximum 10 milli-Ohms.
- c) Interface: Must interface with modular jacks from a variety of OEMs. RJ-11/45 plugs provide connection when used in RJ-45 jacks.
- d) Durability: Minimum 200 insertions/withdrawals.

E. Fiber Optic Terminators:

- 1. Pre-polished crimp on type that has proper ferrule to terminate fiber optic cable.
- 2. Technical Characteristics:
  - a. Frequency: Light wave.
  - b. Power Blocking: As required.
  - c. Return Loss: 25 dB.
  - d. Connectors: LC or as directed by VA Project Manager, .
  - e. Construction: Ceramic.

F. Conduit and Signal Ducts:

- 1. Conduit:
  - a. Provide conduit or sleeves for cables penetrating walls, ceilings, floors, interstitial space, fire barriers, etc.
  - b. Minimum Conduit Size: 19 mm (3/4 inch).
  - c. Provide separate conduit and signal ducts for each cable type installation.
  - d. When metal (plastic covered, flexible cable protective armor, etc.) systems are authorized to be provided for use in system, follow installation guidelines and standard specified in Section 27 05 33, RACEWAYS AND BOXES FOR COMMUNICATIONS SYSTEMS and NEC.
  - e. Maximum 40 percent conduit fill for cable installation.
- 2. Signal Duct, Cable Duct, or Cable Tray: Use existing signal duct, cable duct, and cable tray, when identified and accepted by Project Manager.

### **PART 3 - EXECUTION**

#### **3.1 INSTALLATION**

- A. Install for ease of operation, maintenance, and testing.
- B. Install system to comply with NFPA 70 National Electrical Code, NFPA 99 Health Care Facilities, NFPA 101 Life Safety Code, Joint Commission Manual for Health Care Facilities, and original equipment manufacturers' (OEM) installation instructions.
- C. Cable Systems Installation:

1. Install system cables in cable duct, cable tray, cable runway, conduit or when specifically approved, flexible NEC Article 800 communications raceway. Confirm drawings show sufficient quantity and size of cable pathways. If flexible communications raceway is used, install in same manner as conduit.
2. Coordinate outside plant and backbone cables to furnish number of cable pairs for system requirements and obtain approval of Project Manager and IT Service prior to installation.
3. Bond to ground metallic cable sheaths, etc. (i.e. risers, underground, horizontal, etc.).
4. Install temporary cable to not present a pedestrian safety hazard and be responsible for all work associated with removal. Temporary cable installations are not required to meet Industry Standards; but, must be reviewed and accepted by Project Manager, IT Service, FMS and SMCS 0050P2H3 (202-461-5310) prior to installation.

D. Patient Bedside Prefabricated Units (PBPB) Installation:

1. Under no circumstances, proceed with installing PBPB without written approval of PBPB OEM and specific instructions regarding attachment to or modifying of PBPB.
2. Maintain UL integrity of each PBPB. If installation violates UL integrity, obtain on site UL re-certification of violated PBPB at the direction of Project Manager.

E. Labeling:

1. Industry Standard: Provide labeling in accordance with ANSI/TIA-606-B.
2. Print lettering of labels with laser printers ; handwritten labels are not acceptable.
3. Label both ends of all cables in accordance with industry standard. Provide permanent Labels in contrasting colors and identify according to system "Record Wiring Diagrams".
4. Termination Hardware: Label workstation outlets and patch panel connections using color coded labels with identifiers in accordance with industry standard and record on "Record Wiring Diagrams".

### 3.2 FIELD QUALITY CONTROL

A. Interim Inspection:

1. Verify that equipment provided adheres to installation requirements of this section. Interim inspection must be conducted by a factory-certified representative and witnessed by Project Manager.

2. Check each item of installed equipment to ensure appropriate NRTL label.
3. Verify cabling terminations in telecommunications rooms and at workstations adhere to color code for T568B pin assignments and cabling connections comply with TIA standards.
4. Visually confirm marking of cables, faceplates, patch panel connectors and patch cords.
5. Perform fiber optical field inspection tests via attenuation measurements on factory reels and provide results along with manufacturer certification for factory reel tests. Remove failed cable reels from project site upon attenuation test failure.
6. Notify Project Manager of the estimated date the contractor expects to be ready for interim inspection, at least 20 working days before requested inspection date, so interim inspection does not affect systems' completion date.
7. Provide results of interim inspection to Project Manager. If major or multiple deficiencies are discovered, Project Manager can require a second interim inspection before permitting contractor to continue with system installation.
8. Do not proceed with installation until Project Manager determines if an additional inspection is required. In either case, re-inspection of deficiencies noted during interim inspections must be part of the proof of performance test.

B. Pretesting:

1. Pretest entire system upon completion of system installation.
2. Verify during system pretest, utilizing the accepted equipment, that system is fully operational and meets system performance requirements of this section.
3. Provide Project Manager four copies of recorded system pretest measurements and the written certification that system is ready for formal acceptance test.

C. Microduct Tests:

1. Furnish Project Manager, obstruction and pressure test data for each microduct installed. Complete pressure and obstruction tests per manufacturer's recommended procedures prior to installing fiber, and ensure 100 percent of all microducts are compliant with manufacturer.

2. Complete microduct pressure testing before proceeding with end-to-end microduct obstruction testing.
3. Notify Project Manager at least one week in advance of test date so that Government and design professional may be present to witness testing.
4. Maintain close contact with chosen and technically-approved OEM and SMCS 0050P2H3 throughout installation, testing and certification process.

D. Acceptance Test:

1. After system has been pretested and the contractor has submitted pretest results and certification to Project Manager, then schedule an acceptance test date and give Project Manager 30 days' written notice prior to date acceptance test is expected to begin.
2. Test only in presence of a Project Manager.
3. Test utilizing approved test equipment to certify proof of performance.
4. Verify that total system meets the requirements of this section.
5. Include expected duration of test time, with notification of the acceptance test.

E. Verification Tests:

1. Test UTP copper cabling for DC loop resistance, shorts, opens, intermittent faults, and polarity between conductors, and between conductors and shield, if cable has an overall shield. Test cables after termination and prior to cross-connection.
2. Multi-mode Fiber Optic Cable: Perform end-to-end attenuation tests in accordance with TIA-568-B.3 and TIA-526-14A using Method A, Optical Power Meter and Light Source and Method B, OTDR . Perform verification acceptance test.
3. Not Used.

F. Performance Testing:

1. Perform Category 5E (or on a case by case basis Category 6 for specialized powered systems accepted by SMCS 0050P2H3, (202) 461-5310, IT and FMS Services and Project Manager) tests in accordance with TIA-568-B.1 and TIA-568-B.2. Include the following tests - wire map, length, insertion loss, return loss, NEXT, PSNEXT, ELFEXT, PSELFEXT, propagation delay and delay skew.
2. Fiber Optic Links: Perform end-to-end fiber optic cable link tests in accordance with TIA-568-B.3.

- G. Total System Acceptance Test: Perform verification tests for UTP copper cabling systems and multi-mode fiber optic cabling systems after complete telecommunication distribution system and workstation outlet are installed.

### 3.3 MAINTENANCE

- A. Accomplish the following minimum requirements during one year warranty period:
1. Respond and correct on-site trouble calls, during standard work week:
    - a. A routine trouble call within one working day of its report. A routine trouble is considered a trouble which causes a system outlet, station, or patch cord to be inoperable.
    - b. Standard work week is considered 8:00 A.M. to 5:00 P.M., Monday through Friday exclusive of Federal holidays.
  2. Respond to an emergency trouble call within six hours of its report. An emergency trouble is considered a trouble which causes a subsystem or distribution point to be inoperable at any time.
  3. Respond on-site to a catastrophic trouble call within four hours of its report. A catastrophic trouble call is considered total system failure.
    - a. If a system failure cannot be corrected within four hours (exclusive of standard work time limits), provide alternate equipment, or cables within four hours after four hour trouble shooting time.
    - b. Routine or emergency trouble calls in critical emergency health care facilities (i.e., cardiac arrest, intensive care units, etc.) are also be deemed as a catastrophic trouble.
  4. Provide Project Manager written report itemizing each deficiency found and the corrective action performed during each official reported trouble call. Provide Project Manager with sample copies of reports for review and approval at beginning of total system acceptance test.

- - - E N D - - -



**SECTION 28 05 00**  
**COMMON WORK RESULTS FOR ELECTRONIC SAFETY AND SECURITY**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This Section, Common Work Results for Electronic Safety and Security (ESS), applies to all sections of Division 28.
- B. Furnish and install fully functional electronic safety and security cabling system(s), equipment and approved accessories in accordance with the specification section(s), drawing(s), and referenced publications. Capacities and ratings of cable and other items and arrangements for the specified items are shown on each system's required Bill of Materials (BOM) and verified on the approved system drawing(s). If there is a conflict between contract's specification(s) and drawings(s), the contract's specification requirements shall prevail.
- C. Not Used.
- D. The Contractor shall provide an ESS, installed, programmed, configured, documented, and tested. The security system shall include but not limited to: physical access control, , duress alarms, , video assessment and surveillance, video recording and storage, delayed egress, personal protection system, intercommunication system, fire alarm interface, equipment cabinetry, dedicated photo badging system and associated live camera, , photo badge printer, and uninterruptible power supplies (UPS) interface. Operator training shall not be required as part of the Security Contractors scope and shall be provided by the Owner. The Security Contractor shall still be required to provide necessary maintenance and troubleshooting manuals as well as submittals as identified herein. The work shall include the procurement and installation of electrical wire and cables, the installation and testing of all system components. Inspection, testing, demonstration, and acceptance of equipment, software, materials, installation, documentation, and workmanship, shall be as specified herein. The Contractor shall provide all associated installation support, including the provision of primary electrical input power circuits.
- E. Repair Service Replacement Parts On-site service during the warranty period shall be provided as specified under "Emergency Service". The Contractor shall guarantee all parts and labor for a term of one (1) year, unless dictated otherwise in this specification from the acceptance date of the system as described in Part 5 of this Specification. The Contractor shall be responsible for all equipment, software, shipping, transportation charges, and expenses associated with

the service of the system for one (1) year. The Contractor shall provide 24-hour telephone support for the software program at no additional charge to the owner. Software support shall include all software updates that occur during the warranty period.

F. Section Includes:

1. Description of Work for Electronic Security Systems,
2. Electronic security equipment coordination with relating Divisions,
3. Submittal Requirements for Electronic Security,
4. Miscellaneous Supporting equipment and materials for Electronic Security,
5. Electronic security installation requirements.

**1.2 RELATED WORK**

- A. Section 01 00 00 - GENERAL REQUIREMENTS. For General Requirements.
- B. Section 07 84 00 - FIRESTOPPING. Requirements for firestopping application and use.
- C. Not Used.
- D. Not Used.
- E. Not Used.
- F. Section 08 51 13 - ALUMINUM WINDOWS. Requirements for window installation.
- G. Section 08 71 00 - DOOR HARDWARE. Requirements for door installation.
- H. Section 10 14 00 - SIGNAGE. Requirements for labeling and signs.
- I. Not Used.
- J. Not Used.
- K. Section 26 05 11 - REQUIREMENTS FOR ELECTRICAL INSTALLATIONS. Requirements for connection of high voltage.
- L. Section 26 05 21 - LOW VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES (600 VOLTS AND BELOW). Requirements for power cables.
- M. Section 26 05 33 - RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS. Requirements for infrastructure.
- N. Section 26 05 41 - UNDERGROUND ELECTRICAL CONSTRUCTION. Requirements for underground installation of wiring.
- O. Section 26 56 00 - EXTERIOR LIGHTING. Requirements for perimeter lighting.
- P. Section 28 05 13 - CONDUCTORS AND CABLES FOR ELECTRONIC SAFETY AND SECURITY. Requirements for conductors and cables.
- Q. Section 28 05 26 - GROUNDING AND BONDING FOR ELECTRONIC SAFETY AND SECURITY. Requirements for grounding of equipment.
- R. Section 28 05 28.33 - CONDUITS AND BOXES FOR ELECTRONIC SAFETY AND SECURITY. Requirements for infrastructure.
- S. Not Used.

T. Section 28 13 00 - PHYSICAL ACCESS CONTROL SYSTEMS (PACS). For physical access control integration.

### 1.3 DEFINITIONS

- A. AGC: Automatic Gain Control.
- B. Basket Cable Tray: A fabricated structure consisting of wire mesh bottom and side rails.
- C. BICSI: Building Industry Consulting Service International.
- D. CCD: Charge-coupled device.
- E. Central Station: A PC with software designated as the main controlling PC of the security access system. Where this term is presented with initial capital letters, this definition applies.
- F. Channel Cable Tray: A fabricated structure consisting of a one-piece, ventilated-bottom or solid-bottom channel section.
- G. Controller: An intelligent peripheral control unit that uses a computer for controlling its operation. Where this term is presented with an initial capital letter, this definition applies.
- H. CPU: Central processing unit.
- I. Credential: Data assigned to an entity and used to identify that entity.
- J. DGP: Data Gathering Panel - component of the Physical Access Control System capable to communicate, store and process information received from readers, reader modules, input modules, output modules, and Security Management System.
- K. DTS: Digital Termination Service: A microwave-based, line-of-sight communications provided directly to the end user.
- L. EMI: Electromagnetic interference.
- M. EMT: Electric Metallic Tubing.
- N. ESS: Electronic Security System.
- O. File Server: A PC in a network that stores the programs and data files shared by users.
- P. GFI: Ground fault interrupter.
- Q. IDC: Insulation displacement connector.
- R. Identifier: A credential card, keypad personal identification number or code, biometric characteristic, or other unique identification entered as data into the entry-control database for the purpose of identifying an individual. Where this term is presented with an initial capital letter, this definition applies.
- S. I/O: Input/Output.
- T. Intrusion Zone: A space or area for which an intrusion must be detected and uniquely identified, the sensor or group of sensors assigned to

- perform the detection, and any interface equipment between sensors and communication link to central-station control unit.
- U. Ladder Cable Tray: A fabricated structure consisting of two longitudinal side rails connected by individual transverse members (rungs).
  - V. LAN: Local area network.
  - W. LCD: Liquid-crystal display.
  - X. LED: Light-emitting diode.
  - Y. Location: A Location on the network having a PC-to-Controller communications link, with additional Controllers at the Location connected to the PC-to-Controller link with RS-485 communications loop. Where this term is presented with an initial capital letter, this definition applies.
  - Z. Low Voltage: As defined in NFPA 70 for circuits and equipment operating at less than 50 V or for remote-control and signaling power-limited circuits.
  - AA. M-JPEG: Motion - Joint Photographic Experts Group.
  - BB. MPEG: Moving picture experts group.
  - CC. NEC: National Electric Code
  - DD. NEMA: National Electrical Manufacturers Association
  - EE. NFPA: National Fire Protection Association
  - FF. NTSC: National Television System Committee.
  - GG. NRTL: Nationally Recognized Testing Laboratory.
  - HH. Open Cabling: Passing telecommunications cabling through open space (e.g., between the studs of a wall cavity).
  - II. PACS: Physical Access Control System; A system comprised of cards, readers, door controllers, servers and software to control the physical ingress and egress of people within a given space
  - JJ. PC: Personal computer. This acronym applies to the Central Station, workstations, and file servers.
  - KK. PCI Bus: Peripheral component interconnect; a peripheral bus providing a high-speed data path between the CPU and peripheral devices (such as monitor, disk drive, or network).
  - LL. PDF: (Portable Document Format.) The file format used by the Acrobat document exchange system software from Adobe.
  - MM. RCDD: Registered Communications Distribution Designer.
  - NN. RFI: Radio-frequency interference.
  - OO. RIGID: Rigid conduit is galvanized steel tubing, with a tubing wall that is thick enough to allow it to be threaded.

- PP. RS-232: An TIA/EIA standard for asynchronous serial data communications between terminal devices. This standard defines a 25-pin connector and certain signal characteristics for interfacing computer equipment.
- QQ. RS-485: An TIA/EIA standard for multipoint communications.
- RR. Solid-Bottom or Non-ventilated Cable Tray: A fabricated structure consisting of integral or separate longitudinal side rails, and a bottom without ventilation openings.
- SS. SMS: Security Management System - A SMS is software that incorporates multiple security subsystems (e.g., physical access control, closed circuit television, intercom) into a single platform and graphical user interface.
- TT. TCP/IP: Transport control protocol/Internet protocol incorporated into Microsoft Windows.
- UU. Trough or Ventilated Cable Tray: A fabricated structure consisting of integral or separate longitudinal rails and a bottom having openings sufficient for the passage of air and using 75 percent or less of the plan area of the surface to support cables.
- VV. UPS: Uninterruptible Power Supply
- XX. UTP: Unshielded Twisted Pair
- YY. Workstation: A PC with software that is configured for specific limited security system functions.

#### **1.4 QUALITY ASSURANCE**

- A. Manufacturers Qualifications: The manufacturer shall regularly and presently produce, as one of the manufacturer's principal products, the equipment and material specified for this project, and shall have manufactured the item for at least three years.
- B. Product Qualification:
1. Manufacturer's product shall have been in satisfactory operation, on three installations of similar size and type as this project, for approximately three years.
  2. The Government reserves the right to require the Contractor to submit a list of installations where the products have been in operation before approval.
- C. Contractor Qualification:
1. The Contractor or security sub-contractor shall be a licensed security Contractor with a minimum of five (5) years experience installing and servicing systems of similar scope and complexity. The Contractor shall be an authorized regional representative of the Security Management System's (PACS) manufacturer. The Contractor shall provide four (4) current references from clients with systems of similar scope and complexity which became operational in the past

- three (3) years. At least three (3) of the references shall be utilizing the same system components, in a similar configuration as the proposed system. The references must include a current point of contact, company or agency name, address, telephone number, complete system description, date of completion, and approximate cost of the project. The owner reserves the option to visit the reference sites, with the site owner's permission and representative, to verify the quality of installation and the references' level of satisfaction with the system. The Contractor shall provide copies of system manufacturer certification for all technicians. The Contractor shall only utilize factory-trained technicians to install, program, and service the PACS. The Contractor shall only utilize factory-trained technicians to install, terminate and service controller/field panels and reader modules. The technicians shall have a minimum of five (5) continuous years of technical experience in electronic security systems. The Contractor shall have a local service facility. The facility shall be located within [60] <insert number> miles of the project site. The local facility shall include sufficient spare parts inventory to support the service requirements associated with this contract. The facility shall also include appropriate diagnostic equipment to perform diagnostic procedures. The Project Manager reserves the option of surveying the company's facility to verify the service inventory and presence of a local service organization.
2. The Contractor shall provide proof project superintendent with BICSI Certified Commercial Installer Level 1, Level 2, or Technician to provide oversight of the project.
  3. Cable installer must have on staff a Registered Communication Distribution Designer (RCDD) certified by Building Industry Consulting Service International. The staff member shall provide consistent oversight of the project cabling throughout design, layout, installation, termination and testing.
- D. Service Qualifications: There shall be a permanent service organization maintained or trained by the manufacturer which will render satisfactory service to this installation within four hours of receipt of notification that service is needed. Submit name and address of service organizations.

#### **1.5 GENERAL ARRANGEMENT OF CONTRACT DOCUMENTS**

- A. The Contract Documents supplement to this specification indicates approximate locations of equipment. The installation and/or locations of the equipment and devices shall be governed by the intent of the

design; specification and Contract Documents, with due regard to actual site conditions, recommendations, ambient factors affecting the equipment and operations in the vicinity. The Contract Documents are diagrammatic and do not reveal all offsets, bends, elbows, components, materials, and other specific elements that may be required for proper installation. If any departure from the contract documents is deemed necessary, or in the event of conflicts, the Contractor shall submit details of such departures or conflicts in writing to the owner or owner's representative for his or her comment and/or approval before initiating work.

- B. Anything called for by one of the Contract Documents and not called for by the others shall be of like effect as if required or called by all, except if a provision clearly designed to negate or alter a provision contained in one or more of the other Contract Documents shall have the intended effect. In the event of conflicts among the Contract Documents, the Contract Documents shall take precedence in the following order: the Form of Agreement; the Supplemental General Conditions; the Special Conditions; the Specifications with attachments; and the drawings.

#### **1.6 SUBMITTALS**

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. The Government's approval shall be obtained for all equipment and material before delivery to the job site. Delivery, storage or installation of equipment or material which has not had prior approval will not be permitted at the job site.
- C. Submittals for individual systems and equipment assemblies which consist of more than one item or component shall be made for the system or assembly as a whole. Partial submittals will not be considered for approval.
  - 1. Mark the submittals, "SUBMITTED UNDER SECTION\_\_\_\_\_".
  - 2. Submittals shall be marked to show specification reference including the section and paragraph numbers.
  - 3. Submit each section separately.
- D. The submittals shall include the following:
  - 1. Information that confirms compliance with contract requirements. Include the manufacturer's name, model or catalog numbers, catalog information, technical data sheets, shop drawings, pictures, nameplate data and test reports as required.
  - 2. Not Used.

3. Parts list which shall include those replacement parts recommended by the equipment manufacturer, quantity of parts, current price and availability of each part.

E. Submittals shall be in full compliance of the Contract Documents. All submittals shall be provided in accordance with this section.

Submittals lacking the breath or depth these requirements will be considered incomplete and rejected. Submissions are considered multidisciplinary and shall require coordination with applicable divisions to provide a complete and comprehensive submission package. All submittals shall include adequate descriptive literature, catalog cuts, shop drawings and other data necessary for the Government to ascertain that the proposed equipment and materials comply with specification requirements. Catalog cuts submitted for approval shall be legible and clearly identify equipment being submitted. Additional general provisions are as follows:

1. The Contractor shall schedule submittals in order to maintain the project schedule. For coordination drawings refer to Specification Section 01 33 10 - Design Submittal Procedures, which outline basic submittal requirements and coordination. Section 01 33 10 shall be used in conjunction with this section.
2. The Contractor shall identify variations from requirements of Contract Documents and state product and system limitations, which may be detrimental to successful performance of the completed work or system.
3. Each package shall be submitted at one (1) time for each review and include components from applicable disciplines (e.g., electrical work, architectural finishes, door hardware, etc.) which are required to produce an accurate and detailed depiction of the project.
4. Manufacturer's information used for submittal shall have pages with items for approval tagged, items on pages shall be identified, and capacities and performance parameters for review shall be clearly marked through use of an arrow or highlighting. Provide space for Project Manager and Contractor review stamps.
5. Technical Data Drawings shall be in the latest version of AutoCAD®, drawn accurately, and in accordance with VA CAD Standards CAD Standard Application Guide, and VA BIM Guide. FREEHAND SKETCHES OR COPIED VERSIONS OF THE CONSTRUCTION DOCUMENTS WILL NOT BE ACCEPTED. The Contractor shall not reproduce Contract Documents or copy standard information as the basis of the Technical Data Drawings. If departures from the technical data drawings are subsequently deemed necessary by the Contractor, details of such departures and the



reasons thereof shall be submitted in writing to the Project Manager for approval before the initiation of work.

6. Packaging: The Contractor shall organize the submissions according to the following packaging requirements.
  - a. Binders: For each manual, provide heavy duty, commercial quality, durable three (3) ring vinyl covered loose leaf binders, sized to receive 8.5 x 11 in paper, and appropriate capacity to accommodate the contents. Provide a clear plastic sleeve on the spine to hold labels describing the contents. Provide pockets in the covers to receive folded sheets.
    - 1) Where two (2) or more binders are necessary to accommodate data; correlate data in each binder into related groupings according to the Project Manual table of contents. Cross-referencing other binders where necessary to provide essential information for communication of proper operation and/or maintenance of the component or system.
    - 2) Identify each binder on the front and spine with printed binder title, Project title or name, and subject matter covered. Indicate the volume number if applicable.
  - b. Dividers: Provide heavy paper dividers with celluloid tabs for each Section. Mark each tab to indicate contents.
  - c. Protective Plastic Jackets: Provide protective transparent plastic jackets designed to enclose diagnostic software for computerized electronic equipment.
  - d. Text Material: Where written material is required as part of the manual use the manufacturer's standard printed material, or if not available, specially prepared data, neatly typewritten on 8.5 inches by 11 inches 20 pound white bond paper.
  - e. Drawings: Where drawings and/or diagrams are required as part of the manual, provide reinforced punched binder tabs on the drawings and bind them with the text.
    - 1) Where oversized drawings are necessary, fold the drawings to the same size as the text pages and use as a foldout.
    - 2) If drawings are too large to be used practically as a foldout, place the drawing, neatly folded, in the front or rear pocket of the binder. Insert a type written page indicating the drawing title, description of contents and drawing location at the appropriate location of the manual.
    - 3) Drawings shall be sized to ensure details and text is of legible size. Text shall be no less than 1/16" tall.

f. Manual Content: Submit in accordance with Section 01 00 00, GENERAL REQUIREMENTS.

- 1) Maintenance and Operation Manuals: Submit as required for systems and equipment specified in the technical sections. Furnish four copies, bound in hardback binders, (manufacturer's standard binders) or an approved equivalent. Furnish one complete manual as specified in the technical section but in no case later than prior to performance of systems or equipment test, and furnish the remaining manuals prior to contract completion.
- 2) Inscribe the following identification on the cover: the words "MAINTENANCE AND OPERATION MANUAL," the name and location of the system, equipment, building, name of Contractor, and contract number. Include in the manual the names, addresses, and telephone numbers of each subcontractor installing the system or equipment and the local representatives for the system or equipment.
- 3) The manuals shall include:
  - a) Internal and interconnecting wiring and control diagrams with data to explain detailed operation and control of the equipment.
  - b) A control sequence describing start-up, operation, and shutdown.
  - c) Description of the function of each principal item of equipment.
  - d) Installation and maintenance instructions.
  - e) Safety precautions.
  - f) Diagrams and illustrations.
  - g) Testing methods.
  - h) Performance data.
  - i) Pictorial "exploded" parts list with part numbers. Emphasis shall be placed on the use of special tools and instruments. The list shall indicate sources of supply, recommended spare parts, and name of servicing organization.
  - j) Appendix; list qualified permanent servicing organizations for support of the equipment, including addresses and certified qualifications.

g. Binder Organization: Organize each manual into separate sections for each piece of related equipment. At a minimum, each manual shall contain a title page, table of contents, copies of Product Data supplemented by drawings and written text, and copies of each

warranty, bond, certifications, and service Contract issued. Refer to Group I through V Technical Data Package Submittal requirements for required section content.

- h. Title Page: Provide a title page as the first sheet of each manual to include the following information; project name and address, subject matter covered by the manual, name and address of the Project, date of the submittal, name, address, and telephone number of the Contractor, and cross references to related systems in other operating and/or maintenance manuals.
- i. Table of Contents: After the title page, include a type written table of contents for each volume, arranged systematically according to the Project Manual format. Provide a list of each product included, identified by product name or other appropriate identifying symbols and indexed to the content of the volume. Where more than one (1) volume is required to hold data for a particular system, provide a comprehensive table of contents for all volumes in each volume of the set.
- j. General Information Section: Provide a general information section immediately following the table of contents, listing each product included in the manual, identified by product name. Under each product, list the name, address, and telephone number of the installer and maintenance Contractor. In addition, list a local source for replacement parts and equipment.
- k. Drawings: Provide specially prepared drawings where necessary to supplement the manufacturers printed data to illustrate the relationship between components of equipment or systems, or provide control or flow diagrams. Coordinate these drawings with information contained in Project Record Drawings to assure correct illustration of the completed installation.
- l. Manufacturer's Data: Where manufacturer's standard printed data is included in the manuals, include only those sheets that are pertinent to the part or product installed. Mark each sheet to identify each part or product included in the installation. Where more than one (1) item in tabular format is included, identify each item, using appropriate references from the Contract Documents. Identify data that is applicable to the installation and delete references to information which is not applicable.
- m. Where manufacturer's standard printed data is not available and the information is necessary for proper operation and maintenance of equipment or systems, or it is necessary to provide additional information to supplement the data included in the manual, prepare

written text to provide the necessary information. Organize the text in a consistent format under a separate heading for different procedures. Where necessary, provide a logical sequence of instruction for each operating or maintenance procedure. Where similar or more than one product is listed on the submittal the Contractor shall differentiate by highlighting the specific product to be utilized.

- n. Calculations: Provide a section for circuit and panel calculations.
  - o. Loading Sheets: Provide a section for DGP Loading Sheets.
  - p. Certifications: Provide section for Contractor's manufacturer certifications.
7. Contractor Review: Review submittals prior to transmittal. Determine and verify field measurements and field construction criteria. Verify manufacturer's catalog numbers and conformance of submittal with requirements of contract documents. Return non-conforming or incomplete submittals with requirements of the work and contract documents. Apply Contractor's stamp with signature certifying the review and verification of products occurred, and the field dimensions, adjacent construction, and coordination of information is in accordance with the requirements of the contract documents.
8. Resubmission: Revise and resubmit submittals as required within 15 calendar days of return of submittal. Make resubmissions under procedures specified for initial submittals. Identify all changes made since previous submittal.
9. Product Data: Within 15 calendar days after execution of the contract, the Contractor shall submit for approval a complete list of all of major products proposed for use. The data shall include name of manufacturer, trade name, model number, the associated contract document section number, paragraph number, and the referenced standards for each listed product.
- F. Group 1 Technical Data Package: Group I Technical Data Package shall be one submittal consisting of the following content and organization. Refer to VA Special Conditions Document for drawing format and content requirements. The data package shall include the following:
- 1. Section I - Drawings:
    - a. General - Drawings shall conform to VA CAD Standards Guide. All text associated with security details shall be 1/8" tall and meet VA text standard for AutoCAD™ drawings.

- b. Cover Sheet - Cover sheet shall consist of Project Title and Address, Project Number, Area and Vicinity Maps.
- c. General Information Sheets - General Information Sheets shall consist of General Notes, Abbreviations, Symbols, Wire and Cable Schedule, Project Phasing, and Sheet Index.
- d. Floor Plans - Floor plans shall be produced from the Architectural backgrounds issued in the Construction Documents. The contractor shall receive floor plans from the prime A/E to develop these drawing sets. Security devices shall be placed on drawings in scale. All text associated with security details shall be 1/8" tall and meet VA text standard for AutoCAD™ drawings. Floor plans shall identify the following:
  - 1) Security devices by symbol,
  - 2) The associated device point number (derived from the loading sheets),
  - 3) Wire & cable types and counts
  - 4) Conduit sizing and routing
  - 5) Conduit riser systems
  - 6) Device and area detail call outs
- e. Architectural details - Architectural details shall be produced for each device mounting type (door details for EECS f. Riser Diagrams - Contractor shall provide a riser diagram indicating riser architecture and distribution of the SMS throughout the facility (or area in scope).
- g. Block Diagrams - Contractor shall provide a block diagram for the entire system architecture and interconnections with SMS subsystems. Block diagram shall identify SMS subsystem (e.g., electronic entry control, closed circuit television, intercom, and other associated subsystems) integration; and data transmission and media conversion methodologies.
- h. Interconnection Diagrams - Contractor shall provide interconnection diagram for each sensor, and device component. Interconnection diagram shall identify termination locations, standard wire detail to include termination schedule. Diagram shall also identify interfaces to other systems such as elevator control, fire alarm systems, and security management systems.
- i. Security Details:
  - 1) Panel Assembly Detail - For each panel assembly, a panel assembly details shall be provided identifying individual panel component size and content.

- 2) Panel Details - Provide security panel details identify general arrangement of the security system components, backboard size, wire through size and location, and power circuit requirements.
- 3) Device Mounting Details - Provide mounting detailed drawing for each security device (physical access control system, video surveillance and assessment, and intercom systems) for each type of wall and ceiling configuration in project. Device details shall include device, mounting detail, wiring and conduit routing.
- 4) Details of connections to power supplies and grounding
- 5) Details of surge protection device installation
- 6) Sensor detection patterns - Each system sensor shall have associated detection patterns.
- 7) Equipment Rack Detail - For each equipment rack, provide a scaled detail of the equipment rack location and rack space utilization. Use of BISC wire management standards shall be employed to identify wire management methodology. Transitions between equipment racks shall be shown to include use vertical and horizontal latter rack system.
- 8) Not Used.
- 9) Not Used.
- 10) Equipment Room - Equipment room details shall provide architectural, electrical, mechanical, plumbing, IT/Data and associated equipment and device placements both vertical and horizontally.
- j. Electrical Panel Schedule - Electrical Panel Details shall be provided for all SMS systems electrical power circuits. Panel details shall be provided identifying panel type (Standard, Emergency Power, Emergency/Uninterrupted Power Source, and Uninterrupted Power Source Only), panel location, circuit number, and circuit amperage rating.
- k. Door Schedule - A door schedule shall be developed for each door equipped with electronic security components. At a minimum, the door schedule shall be coordinated with Division 08 work and include the following information:
  - 1) Item Number
  - 2) Door Number (Derived from A/E Drawings)
  - 3) Floor Plan Sheet Number
  - 4) Standard Detail Number
  - 5) Door Description (Derived from Loading Sheets)
  - 6) Data Gathering Panel Input Number

- 7) Door Position or Monitoring Device Type & Model Number
  - 8) Lock Type, Model Number & Power Input/Draw (standby/active)
  - 9) Card Reader Type & Model Number
  - 10) Shunting Device Type & Model Number
  - 11) Sounder Type & Model Number
  - 12) Manufacturer
  - 13) Misc. devices as required
    - a) Delayed Egress Type & Model Number
    - b) Intercom
    - c) Camera
    - d) Electric Transfer Hinge
    - e) Electric Pass-through device
  - 14) Remarks column indicating special notes or door configurations
2. Camera Schedule - A camera schedule shall be developed for each camera. Contractors shall coordinate with the Project Manager to determine camera starting numbers and naming conventions. All drawings shall identify wire and cable standardization methodology. Color coding of all wiring conductors and jackets is required and shall be communicated consistently throughout the drawings package submittal. At a minimum, the camera schedule shall include the following information:
- a. Item Number
  - b. Camera Number
  - c. Naming Conventions
  - d. Description of Camera Coverage
  - e. Camera Location
  - f. Floor Plan Sheet Number
  - g. Camera Type
  - h. Mounting Type
  - i. Standard Detail Reference
  - j. Power Input & Draw
  - k. Power Panel Location
  - l. Remarks Column for Camera
3. Section II - Data Gathering Panel Documentation Package
- a. Contractor shall provide Data Gathering Panel (DGP) input and output documentation packages for review at the Shop Drawing submittal stage and also with the as-built documentation package. The documentation packages shall be provided in both printed and magnetic form at both review stages.
  - b. The Contractor shall provide loading sheet documentation package for the associated DGP, including input and output boards for all

field panels associated with the project. Documentation shall be provided in current version Microsoft Excel spreadsheets following the format currently utilized by VA. A separate spreadsheet file shall be generated for each DGP and associated field panels.

- c. The spreadsheet names shall follow a sequence that shall display the spreadsheets in numerical order according to the DGP system number. The spreadsheet shall include the prefix in the file name that uniquely identifies the project site. The spreadsheet shall detail all connected items such as card readers, alarm inputs, and relay output connections. The spreadsheet shall include an individual section (row) for each panel input, output and card reader. The spreadsheet shall automatically calculate the system numbers for card readers, inputs, and outputs based upon data entered in initialization fields.
- d. All entries must be verified against the field devices. Copies of the floor plans shall be forwarded under separate cover.
- e. The DGP spreadsheet shall include an entry section for the following information:
  - 1) DGP number
  - 2) First Reader Number
  - 3) First Monitor Point Number
  - 4) First Relay Number
  - 5) DGP, input or output Location
  - 6) DGP Chain Number
  - 7) DGP Cabinet Tamper Input Number
  - 8) DGP Power Fail Input Number
  - 9) Number of Monitor Points Reserved For Expansion Boards
  - 10) Number of Control Points (Relays) Reserved For Expansion Boards
- f. The DGP, input module and output module spreadsheets shall automatically calculate the following information based upon the associated entries in the above fields:
  - 1) System Numbers for Card Readers
  - 2) System Numbers for Monitor Point Inputs
  - 3) System Numbers for Control Points (Relays)
  - 4) Next DGP or input module First Monitor Point Number
  - 5) Next DGP or output module First Control Point Number
- g. The DGP spreadsheet shall provide the following information for each card reader:
  - 1) DGP Reader Number
  - 2) System Reader Number
  - 3) Cable ID Number



- 4) Description Field (Room Number)
- 5) Description Field (Device Type i.e.: In Reader, Out Reader, etc.)
- 6) Description Field
- 7) DGP Input Location
- 8) Date Test
- 9) Date Passed
- 10) Cable Type
- 11) Camera Numbers (of cameras viewing the reader location)
- h. The DGP and input module spreadsheet shall provide the following information for each monitor point (alarm input).
  - 1) DGP Monitor Point Input Number
  - 2) System Monitor Point Number
  - 3) Cable ID Number
  - 4) Description Field (Room Number)
  - 5) Description Field (Device Type i.e.: Door Contact, Motion Detector, etc.)
  - 7) DGP or input module Input Location
  - 8) Date Test
  - 9) Date Passed
  - 10) Cable Type
  - 11) Camera Numbers (of associated alarm event preset call-ups)
- i. The DGP and output module spreadsheet shall provide the following information for each control point (output relay).
  - 1) DGP Control Point (Relay) Number
  - 2) System (Control Point) Number
  - 3) Cable ID Number
  - 4) Description Field (Room Number)
  - 5) Description Field (Device: Lock Control, Local Sounder, etc.)
  - 6) Description Field
  - 7) DGP or OUTPUT MODULE Output Location
  - 8) Date Test
  - 9) Date Passed Cable Type
  - 10) Camera Number (of associated alarm event preset call-ups)
- j. The DGP, input module and output module spreadsheet shall include the following information or directions in the header and footer:
  - 1) Header
    - a) DGP Input and Output Worksheet
    - b) Enter Beginning Reader, Input, and Output Starting Numbers and Sheet Will Automatically Calculate the Remaining System Numbers.

## 2) Footer

- a) File Name
- b) Date Printed
- c) Page Number

4. Section III - Construction Mock-up: In areas with exposed EMT/Conduit Raceways, contractor shall conceal raceway as much as practical and unobtrusively. In addition, historic significance must be considered to determine installation means and methods for approval by the owner.
5. Section IV - Manufacturers' Data: The data package shall include manufacturers' data for all materials and equipment, including sensors, local processors and console equipment provided under this specification.
6. Section V - System Description and Analysis: The data package shall include system descriptions, analysis, and calculations used in sizing equipment required by these specifications. Descriptions and calculations shall show how the equipment will operate as a system to meet the performance requirements of this specification. The data package shall include the following:
  - a. Central processor memory size; communication speed and protocol description; rigid disk system size and configuration; flexible disk system size and configuration; back-up media size and configuration; alarm response time calculations; command response time calculations; start-up operations; expansion capability and method of implementation; sample copy of each report specified; and color photographs representative of typical graphics.
  - b. Software Data: The data package shall consist of descriptions of the operation and capability of the system, and application software as specified.
  - c. Overall System Reliability Calculations: The data package shall include all manufacturers' reliability data and calculations required to show compliance with the specified reliability.
7. Section VI - Certifications & References: All specified manufacturer's certifications shall be included with the data package. Contractor shall provide Project references as outlined in Paragraph 1.4 "Quality Assurance".

## G. Group II Technical Data Package

1. The Contractor shall prepare a report of "Current Site Conditions" and submit a report to the Project Manager documenting changes to the site, particularly those conditions that affect performance of the system to be installed. The Contractor shall provide specification

- sheets, or written functional requirements to support the findings, and a cost estimate to correct those site changes or conditions which affect the installation of the system or its performance. The Contractor shall not correct any deficiency without written permission from the COTR.
2. System Configuration and Functionality: The contractor shall provide the results of the meeting with VA to develop system requirements and functionality including but not limited to:
    - a. Baseline configuration
    - b. Access levels
    - c. Schedules (intrusion detection, physical access control, holidays, etc.)
    - d. Badge database
    - e. System monitoring and reporting (unit level and central control)
    - f. Naming conventions and descriptors
- H. Group III Technical Data Package
1. Development of Test Procedures: The Contractor will prepare performance test procedures for the system testing. The test procedures shall follow the format of the VA Testing procedures and be customized to the contract requirements. The Contractor will deliver the test procedures to the Project Manager for approval at least 60 calendar days prior to the requested test date.
- I. Group IV Technical Data Package
1. Performance Verification Test
    - a. Based on the successful completion of the pre-delivery test, the Contractor shall finalize the test procedures and report forms for the performance verification test (PVT) and the endurance test. The PVT shall follow the format, layout and content of the pre-delivery test. The Contractor shall deliver the PVT and endurance test procedures to the Project Manager for approval. The Contractor may schedule the PVT after receiving written approval of the test procedures. The Contractor shall deliver the final PVT and endurance test reports within 14 calendar days from completion of the tests. Refer to Part 3 of this section for System Testing and Acceptance requirements.
  2. Training Documentation
    - a. New Facilities and Major Renovations: Familiarization training shall be provided for new equipment or systems. Training can include site familiarization training for VA technicians and administrative personnel. Training shall include general information on new system layout including closet locations,

turnover of the completed system including all documentation, including manuals, software, key systems, and full system administration rights. Lesson plans and training manuals training shall be oriented to type of training to be provided.

b. New Unit Control Room:

- 1) Not Used.
- 2) Not Used.
- 3) Not Used.
- 4) The service manual shall be written in laymen's language and printed so as to become a permanent reference document for maintenance personnel, describing how to run internal self diagnostic software programs, troubleshoot head end hardware and field devices with a complete scenario simulation of all possible system malfunctions and the appropriate corrective measures.
- 5) Provide a professional color DVD instructional recording of all the operational procedures described in the operator's manual. All charts used in the training session shall be clearly presented on the video. Any DVD found to be inferior in recording or material content shall be reproduced at no cost until an acceptable DVD is submitted. Provide four copies of the training DVD, one to the architect/engineer and three to the owner.

3. System Configuration and Data Entry:

- a. The contractor is responsible for providing all system configuration and data entry for the SMS and subsystems (e.g., video matrix switch, intercom, digital video recorders, network video recorders). All data entry shall be performed per VA standards & guidelines. The Contractor is responsible for participating in all meetings with the client to compile the information needed for data entry. These meetings shall be established at the beginning of the project and incorporated in to the project schedule as a milestone task. The contractor shall be responsible for all data collection, data entry, and system configuration. The contractor shall collect, enter, & program and/or configure the following components:
  - 1) Physical Access control system components,
  - 2) Not Used.
  - 3) Video surveillance, control and recording systems,
  - 4) Intercom systems components,
  - 5) All other security subsystems shown in the contract documents.

- b. The Contractor is responsible for compiling the card access database for the VA employees, including programming reader configurations, access shifts, schedules, exceptions, card classes and card enrollment databases.
  - c. Refer to Part 3 for system programming requirements and planning guidelines.
4. Graphics: Based on CAD as-built drawings developed for the construction project, create all map sets showing locations of all alarms and field devices. Graphical maps of all alarm points installed under this contract including perimeter and exterior alarm points shall be delivered with the system. The Contractor shall create and install all graphics needed to make the system operational. The Contractor shall utilize data from the contract documents, Contractor's field surveys, and all other pertinent information in the Contractor's possession to complete the graphics. The Contractor shall identify and request from the COTR, any additional data needed to provide a complete graphics package. Graphics shall have sufficient level of detail for the system operator to assess the alarm. The Contractor shall supply hard copy, color examples at least 203.2 x 254 mm (8 x 10 in) of each type of graphic to be used for the completed Security system. The graphics examples shall be delivered to the Project Manager for review and approval at least 90 calendar days prior to the scheduled date the Contractor requires them.
- J. Group V Technical Data Package: Final copies of the manuals shall be delivered to the Project Manager as part of the acceptance test. The draft copy used during site testing shall be updated with any changes required prior to final delivery of the manuals. Each manual's contents shall be identified on the cover. The manual shall include names, addresses, and telephone numbers of each sub-contractor installing equipment or systems, as well as the nearest service representatives for each item of equipment for each system. The manuals shall include a table of contents and tab sheets. Tab sheets shall be placed at the beginning of each chapter or section and at the beginning of each appendix. The final copies delivered after completion of the endurance test shall include all modifications made during installation, checkout, and acceptance. of each item listed below shall be delivered as a part of final systems acceptance.
- 1. Functional Design Manual: The functional design manual shall identify the operational requirements for the entire system and explain the theory of operation, design philosophy, and specific

- functions. A description of hardware and software functions, interfaces, and requirements shall be included for all system operating modes. Manufacturer developed literature may be used; however, shall be produced to match the project requirements.
2. Equipment Manual: A manual describing all equipment furnished including:
    - a. General description and specifications; installation and checkout procedures; equipment electrical schematics and layout drawings; system schematics and layout drawings; alignment and calibration procedures; manufacturer's repair list indicating sources of supply; and interface definition.
  3. Software Manual: The software manual shall describe the functions of all software and include all other information necessary to enable proper loading, testing, and operation. The manual shall include:
    - a. Definition of terms and functions; use of system and applications software; procedures for system initialization, start-up, and shutdown; alarm reports; reports generation, database format and data entry requirements; directory of all disk files; and description of all communications protocols including data formats, command characters, and a sample of each type of data transfer.
  4. Operator's Manual: The operator's manual shall fully explain all procedures and instructions for the operation of the system, including:
    - a. Computers and peripherals; system start-up and shutdown procedures; use of system, command, and applications software; recovery and restart procedures; graphic alarm presentation; use of report generator and generation of reports; data entry; operator commands' alarm messages, and printing formats; and system access requirements.
  5. Maintenance Manual: The maintenance manual shall include descriptions of maintenance for all equipment including inspection, recommend schedules, periodic preventive maintenance, fault diagnosis, and repair or replacement of defective components.
  6. Spare Parts & Components Data: At the conclusion of the Contractor's work, the Contractor shall submit to the Project Manager a complete list of the manufacturer's recommended spare parts and components required to satisfactorily maintain and service the systems, as well as unit pricing for those parts and components.
  7. Operation, Maintenance & Service Manuals: The Contractor shall provide two (2) complete sets of operating and maintenance manuals in

- the form of an instructional manual for use by the VA Security Guard Force personnel. The manuals shall be organized into suitable sets of manageable size. Where possible, assemble instructions for similar equipment into a single binder. If multiple volumes are required, each volume shall be fully indexed and coordinated.
8. Equipment and Systems Maintenance Manual: The Contractor shall provide the following descriptive information for each piece of equipment, operating system, and electronic system:
    - a. Equipment and/or system function.
    - b. Operating characteristics.
    - c. Limiting conditions.
    - d. Performance curves.
    - e. Engineering data and test.
    - f. Complete nomenclature and number of replacement parts.
    - g. Provide operating and maintenance instructions including assembly drawings and diagrams required for maintenance and a list of items recommended to stock as spare parts.
    - h. Provide information detailing essential maintenance procedures including the following: routine operations, trouble shooting guide, disassembly, repair and re-assembly, alignment, adjusting, and checking.
    - i. Provide information on equipment and system operating procedures, including the following; start-up procedures, routine and normal operating instructions, regulation and control procedures, instructions on stopping, shut-down and emergency instructions, required sequences for electric and electronic systems, and special operating instructions.
    - j. Manufacturer equipment and systems maintenance manuals are permissible.
  9. Project Redlines: During construction, the Contractor shall maintain an up-to-date set of construction redlines detailing current location and configuration of the project components. The redline documents shall be marked with the words 'Master Redlines' on the cover sheet and be maintained by the Contractor in the project office. The Contractor will provide access to redline documents anytime during the project for review and inspection by the Project Manager or authorized Office of Protection Services representative. Master redlines shall be neatly maintained throughout the project and secured under lock and key in the contractor's onsite project office. Any project component or assembly that is not installed in strict accordance with the drawings shall be so noted on the drawings.

- Prior to producing Record Construction Documents, the contractor will submit the Master Redline document to the Project Manager for review and approval of all changes or modifications to the documents. Each sheet shall have Project Manager initials indicating authorization to produce "As Built" documents. Field drawings shall be used for data gathering & field changes. These changes shall be made to the master redline documents daily. Field drawings shall not be considered "master redlines".
10. Record Specifications: The Contractor shall maintain one (1) copy of the Project Specifications, including addenda and modifications issued, for Project Record Documents. The Contractor shall mark the Specifications to indicate the actual installation where the installation varies substantially from that indicated in the Contract Specifications and modifications issued. (Note related Project Record Drawing information where applicable). The Contractor shall pay particular attention to substitutions, selection of product options, and information on concealed installations that would be difficult to identify or measure and record later. Upon completion of the mark ups, the Contractor shall submit record Specifications to the COTR. As with master relines, Contractor shall maintain record specifications for Project Manager review and inspection at anytime.
  11. Record Product Data: The Contractor shall maintain one (1) copy of each Product Data submittal for Project Record Document purposes. The Data shall be marked to indicate the actual product installed where the installation varies substantially from that indicated in the Product Data submitted. Significant changes in the product delivered to the site and changes in manufacturer's instructions and recommendations for installation shall be included. Particular attention will be given to information on concealed products and installations that cannot be readily identified or recorded later. Note related Change Orders and mark up of Record Construction Documents, where applicable. Upon completion of mark up, submit a complete set of Record Product Data to the COTR.
  12. Miscellaneous Records: The Contractor shall maintain one (1) copy of miscellaneous records for Project Record Document purposes. Refer to other Specifications for miscellaneous record-keeping requirements and submittals concerning various construction activities. Before substantial completion, complete miscellaneous records and place in good order, properly identified and bound or filed, ready for use and reference. Categories of requirements resulting in miscellaneous records include a minimum of the following:



- a. Certificates received instead of labels on bulk products.
  - b. Testing and qualification of tradesmen. ("Contractor's Qualifications")
  - c. Documented qualification of installation firms.
  - d. Load and performance testing.
  - e. Inspections and certifications.
  - f. Final inspection and correction procedures.
  - g. Project schedule
13. Record Construction Documents (Record As-Built)
- a. Upon project completion, the contractor shall submit the project master redlines to the Project Manager prior to development of Record construction documents. The Project Manager shall be given a minimum of a thirty (30) day review period to determine the adequacy of the master redlines. If the master redlines are found suitable by the Project Manager, the Project Manager will initial and date each sheet and turn redlines over to the contractor for as built development.
  - b. The Contractor shall provide the Project Manager a complete set of "as-built" drawings and original master redlined marked "as-built" blue-line in the latest version of AutoCAD drawings unlocked on CD or DVD. The as-built drawing shall include security device number, security closet connection location, data gathering panel number, and input or output number as applicable. All corrective notations made by the Contractor shall be legible when submitted to the COTR. If, in the opinion of the COTR, any redlined notation is not legible, it shall be returned to the Contractor for re-submission at no extra cost to the Owner. The Contractor shall organize the Record Drawing sheets into manageable sets bound with durable paper cover sheets with suitable titles, dates, and other identifications printed on the cover. The submitted as built shall be in editable formats and the ownership of the drawings shall be fully relinquished to the owner.
  - c. Where feasible, the individual or entity that obtained record data, whether the individual or entity is the installer, sub-contractor, or similar entity, is required to prepare the mark up on Record Drawings. Accurately record the information in a comprehensive drawing technique. Record the data when possible after it has been obtained. For concealed installations, record and check the mark up before concealment. At the time of substantial completion, submit the Record Construction Documents to the COTR. The Contractor shall organize into bound and labeled

sets for the COTR's continued usage. Provide device, conduit, and cable lengths on the conduit drawings. Exact in-field conduit placement/routings shall be shown. All conduits shall be illustrated in their entire length from termination in security closets; no arrowed conduit runs shall be shown. Pull box and junction box sizes are to be shown if larger than 100mm (4 inch).

K. FIPS 201 Compliance Certificates

1. Provide Certificates for all software components and device types utilizing credential verification. Provide certificates for:
  - a. Fingerprint Capture Station
  - b. Card Readers
  - c. Not Used.
  - d. PIV Middleware
  - e. Template Matcher
  - f. Electromagnetically Opaque Sleeve
  - g. Certificate Management
    - 1) CAK Authentication System
    - 2) PIV Authentication System
    - 3) Certificate Validator
    - 4) Not Used.

L. Approvals will be based on complete submission of manuals together with shop drawings.

M. After approval and prior to installation, furnish the Project Manager with one sample of each of the following:

1. A 300 mm (12 inch) length of each type and size of wire and cable along with the tag from the coils of reels from which the samples were taken.
2. Each type of conduit and pathway coupling, bushing and termination fitting.
3. Conduit hangers, clamps and supports.
4. Duct sealing compound.

N. Not Used.

O. In addition to the requirement of SUBMITTALS, the VA reserves the right to request the manufacturer to arrange for a VA representative to see typical active systems in operation, when there has been no prior experience with the manufacturer or the type of equipment being submitted.

## 1.7 APPLICABLE PUBLICATIONS

A. The publications listed below (including amendments, addenda, revisions, supplement, and errata) form a part of this specification to the extent

referenced. The publications are referenced in the text by the basic designation only.

B. American National Standards Institute (ANSI)/ International Code Council (ICC):

A117.1.....Standard on Accessible and Usable Buildings and Facilities

C. American National Standards Institute (ANSI)/ Security Industry Association (SIA):

AC-03.....Access Control: Access Control Guideline Dye Sublimation Printing Practices for PVC Access Control Cards

CP-01-00.....Control Panel Standard-Features for False Alarm Reduction

PIR-01-00.....Passive Infrared Motion Detector Standard - Features for Enhancing False Alarm Immunity

TVAC-01.....CCTV to Access Control Standard - Message Set for System Integration

D. American National Standards Institute (ANSI)/Electronic Industries Alliance (EIA):

330-09.....Electrical Performance Standards for CCTV Cameras

375A-76.....Electrical Performance Standards for CCTV Monitors

E. American National Standards Institute (ANSI):

ANSI S3.2-99.....Method for measuring the Intelligibility of Speech over Communications Systems

F. American Society for Testing and Materials (ASTM)

B1-07.....Standard Specification for Hard-Drawn Copper Wire

B3-07.....Standard Specification for Soft or Annealed Copper Wire

B8-04.....Standard Specification for Concentric-Lay-Stranded Copper Conductors, Hard, Medium-Hard, or Soft

C1238-97 (R03).....Standard Guide for Installation of Walk-Through Metal Detectors

D2301-04.....Standard Specification for Vinyl Chloride Plastic Pressure Sensitive Electrical Insulating Tape

G. Architectural Barriers Act (ABA), 1968

H. Department of Justice: American Disability Act (ADA)

## 28 CFR Part 36-2010 ADA Standards for Accessible Design

## I. Department of Veterans Affairs:

VHA National CAD Standard Application Guide, 2006

VA BIM Guide, V1.0 10

## J. Federal Communications Commission (FCC):

(47 CFR 15) Part 15      Limitations on the Use of Wireless  
Equipment/Systems

## K. Federal Information Processing Standards (FIPS):

FIPS-201-1.....Personal Identity Verification (PIV) of Federal  
Employees and Contractors

## L. Federal Specifications (Fed. Spec.):

A-A-59544-08.....Cable and Wire, Electrical (Power, Fixed  
Installation)

## M. Government Accountability Office (GAO):

GAO-03-8-02.....Security Responsibilities for Federally Owned  
and Leased Facilities

## N. Homeland Security Presidential Directive (HSPD):

HSPD-12.....Policy for a Common Identification Standard for  
Federal Employees and Contractors

## O. Institute of Electrical and Electronics Engineers (IEEE):

81-1983.....IEEE Guide for Measuring Earth Resistivity,  
Ground Impedance, and Earth Surface Potentials  
of a Ground System

802.3af-08.....Power over Ethernet Standard

802.3at-09 .....Power over Ethernet (PoE) Plus Standard

C2-07.....National Electrical Safety Code

C62.41-02.....IEEE Recommended Practice on Surge Voltages in  
Low-Voltage AC Power CircuitsC95.1-05.....Standards for Safety Levels with Respect to  
Human Exposure in Radio Frequency  
Electromagnetic Fields

## P. International Organization for Standardization (ISO):

7810.....Identification cards - Physical characteristics

7811.....Physical Characteristics for Magnetic Stripe  
Cards7816-1.....Identification cards - Integrated circuit(s)  
cards with contacts - Part 1: Physical  
characteristics7816-2.....Identification cards - Integrated circuit cards  
- Part 2: Cards with contacts -Dimensions and  
location of the contacts

- 7816-3.....Identification cards - Integrated circuit cards
  - Part 3: Cards with contacts - Electrical interface and transmission protocols
- 7816-4.....Identification cards - Integrated circuit cards
  - Part 11: Personal verification through biometric methods
- 7816-10.....Identification cards - Integrated circuit cards
  - Part 4: Organization, security and commands for interchange
- 14443.....Identification cards - Contactless integrated circuit cards; Contactless Proximity Cards Operating at 13.56 MHz in up to 5 inches distance
- 15693.....Identification cards -- Contactless integrated circuit cards - Vicinity cards; Contactless Vicinity Cards Operating at 13.56 MHz in up to 50 inches distance
- 19794.....Information technology - Biometric data interchange formats
- Q. National Electrical Contractors Association
  - 303-2005.....Installing Closed Circuit Television (CCTV) Systems
- R. National Electrical Manufacturers Association (NEMA):
  - 250-08.....Enclosures for Electrical Equipment (1000 Volts Maximum)
  - TC-3-04.....PVC Fittings for Use with Rigid PVC Conduit and Tubing
  - FB1-07.....Fittings, Cast Metal Boxes and Conduit Bodies for Conduit, Electrical Metallic Tubing and Cable
- S. National Fire Protection Association (NFPA):
  - 70-11..... National Electrical Code (NEC)
  - 731-08.....Standards for the Installation of Electric Premises Security Systems
  - 99-2005.....Health Care Facilities
- T. National Institute of Justice (NIJ)
  - 0601.02-03.....Standards for Walk-Through Metal Detectors for use in Weapons Detection
  - 0602.02-03.....Hand-Held Metal Detectors for Use in Concealed Weapon and Contraband Detection
- U. National Institute of Standards and Technology (NIST):

- IR 6887 V2.1.....Government Smart Card Interoperability  
Specification (GSC-IS)
- Special Pub 800-37.....Guide for Applying the Risk Management Framework  
to Federal Information Systems
- Special Pub 800-63.....Electronic Authentication Guideline
- Special Pub 800-73-3....Interfaces for Personal Identity Verification (4  
Parts)  
.....Pt. 1- End Point PIV Card Application Namespace,  
Data Model & Representation  
.....Pt. 2- PIV Card Application Card Command  
Interface  
.....Pt. 3- PIV Client Application Programming  
Interface  
.....Pt. 4- The PIV Transitional Interfaces & Data  
Model Specification
- Special Pub 800-76-1....Biometric Data Specification for Personal  
Identity Verification
- Special Pub 800-78-2....Cryptographic Algorithms and Key Sizes for  
Personal Identity Verification
- Special Pub 800-79-1....Guidelines for the Accreditation of Personal  
Identity Verification Card Issuers
- Special Pub 800-85B-1...DRAFTPIV Data Model Test Guidelines
- Special Pub 800-85A-2...PIV Card Application and Middleware Interface  
Test Guidelines (SP 800-73-3 compliance)
- Special Pub 800-96.....PIV Card Reader Interoperability Guidelines
- Special Pub 800-104A....Scheme for PIV Visual Card Topography
- V. Occupational and Safety Health Administration (OSHA):  
29 CFR 1910.97.....Nonionizing radiation
- W. Section 508 of the Rehabilitation Act of 1973
- X. Security Industry Association (SIA):  
AG-01 .....Security CAD Symbols Standards
- Y. Underwriters Laboratories, Inc. (UL):  
1-05.....Flexible Metal Conduit  
5-04.....Surface Metal Raceway and Fittings  
6-07.....Rigid Metal Conduit  
44-05.....Thermoset-Insulated Wires and Cables  
50-07.....Enclosures for Electrical Equipment  
83-08.....Thermoplastic-Insulated Wires and Cables  
294-99.....The Standard of Safety for Access Control System  
Units  
305-08.....Standard for Panic Hardware

- 360-09.....Liquid-Tight Flexible Steel Conduit
- 444-08.....Safety Communications Cables
- 464-09.....Audible Signal Appliances
- 467-07.....Electrical Grounding and Bonding Equipment
- 486A-03.....Wire Connectors and Soldering Lugs for Use with  
Copper Conductors
- 486C-04.....Splicing Wire Connectors
- 486D-05.....Insulated Wire Connector Systems for Underground  
Use or in Damp or Wet Locations
- 486E-00.....Equipment Wiring Terminals for Use with Aluminum  
and/or Copper Conductors
- 493-07.....Thermoplastic-Insulated Underground Feeder and  
Branch Circuit Cable
- 514A-04.....Metallic Outlet Boxes
- 514B-04.....Fittings for Cable and Conduit
- 51-05.....Schedule 40 and 80 Rigid PVC Conduit
- 609-96.....Local Burglar Alarm Units and Systems
- 634-07.....Standards for Connectors with Burglar-Alarm  
Systems
- 636-01.....Standard for Holdup Alarm Units and Systems
- 639-97.....Standard for Intrusion-Detection Units
- 651-05.....Schedule 40 and 80 Rigid PVC Conduit
- 651A-07.....Type EB and A Rigid PVC Conduit and HDPE Conduit
- 752-05.....Standard for Bullet-Resisting Equipment
- 797-07.....Electrical Metallic Tubing
- 827-08.....Central Station Alarm Services
- 1037-09.....Standard for Anti-theft Alarms and Devices
- 1635-10.....Digital Alarm Communicator System Units
- 1076-95.....Standards for Proprietary Burglar Alarm Units  
and Systems
- 1242-06.....Intermediate Metal Conduit
- 1479-03.....Fire Tests of Through-Penetration Fire Stops
- 1981-03.....Central Station Automation System
- 2058-05.....High Security Electronic Locks
- 60950.....Safety of Information Technology Equipment
- 60950-1.....Information Technology Equipment - Safety - Part  
1: General Requirements
- Z. Uniform Federal Accessibility Standards (UFAS) 1984
- AA. United States Department of Commerce:
  - Special Pub 500-101 ....Care and Handling of Computer Magnetic Storage  
Media

## 1.8 COORDINATION

- A. Coordinate arrangement, mounting, and support of electronic safety and security equipment:
  - 1. To allow maximum possible headroom unless specific mounting heights that reduce headroom are indicated.
  - 2. To provide for ease of disconnecting the equipment with minimum interference to other installations.
  - 3. To allow right of way for piping and conduit installed at required slope.
  - 4. So connecting raceways, cables, wireways, cable trays, and busways will be clear of obstructions and of the working and access space of other equipment.
- B. Coordinate installation of required supporting devices and set sleeves in cast-in-place concrete, masonry walls, and other structural components as they are constructed.
- C. Coordinate location of access panels and doors for electronic safety and security items that are behind finished surfaces or otherwise concealed.

## 1.9 MAINTENANCE & SERVICE

- A. General Requirements
  - 1. The Contractor shall provide all services required and equipment necessary to maintain the entire integrated electronic security system in an operational state as specified for a period of one (1) year after formal written acceptance of the system. The Contractor shall provide all necessary material required for performing scheduled adjustments or other non-scheduled work. Impacts on facility operations shall be minimized when performing scheduled adjustments or other non-scheduled work. See also General Project Requirements.
- B. Description of Work
  - 1. The adjustment and repair of the security system includes all software updates, panel firmware, and the following new items computers equipment, communications transmission equipment and data transmission media (DTM), local processors, security system sensors, physical access control equipment, facility interface, signal transmission equipment, and video equipment.
- C. Personnel
  - 1. Service personnel shall be certified in the maintenance and repair of the selected type of equipment and qualified to accomplish all work promptly and satisfactorily. The Project Manager shall be advised in writing of the name of the designated service representative, and of any change in personnel. The Project Manager shall be provided



copies of system manufacturer certification for the designated service representative.

D. Schedule of Work

1. The work shall be performed during regular working hours, Monday through Friday, excluding federal holidays.

E. System Inspections

1. These inspections shall include:
  - a. The Contractor shall perform two (2) minor inspections at six (6) month intervals or more if required by the manufacturer, and two (2) major inspections offset equally between the minor inspections to effect quarterly inspection of alternating magnitude.
    - 1) Minor Inspections shall include visual checks and operational tests of all console equipment, peripheral equipment, local processors, sensors, electrical and mechanical controls, and adjustments on printers.
    - 2) Major Inspections shall include all work described for Minor Inspections and the following: clean all system equipment and local processors including interior and exterior surfaces; perform diagnostics on all equipment; operational tests of the CPU, switcher, peripheral equipment, recording devices, monitors, picture quality from each camera; check, walk test, and calibrate each sensor; run all system software diagnostics and correct all problems; and resolve any previous outstanding problems.

F. Emergency Service

1. The owner shall initiate service calls whenever the system is not functioning properly. The Contractor shall provide the Owner with an emergency service center telephone number. The emergency service center shall be staffed 24 hours a day 365 days a year. The Owner shall have sole authority for determining catastrophic and non-catastrophic system failures within parameters stated in General Project Requirements.
  - a. For catastrophic system failures, the Contractor shall provide same day four (4) hour service response with a defect correction time not to exceed eight (8) hours from [notification] [arrival on site]. Catastrophic system failures are defined as any system failure that the Owner determines will place the facility(s) at increased risk.
  - b. For non-catastrophic failures, the Contractor within eight (8) hours with a defect correction time not to exceed 24 hours from notification.

#### G. Operation

1. Performance of scheduled adjustments and repair shall verify operation of the system as demonstrated by the applicable portions of the performance verification test.

#### H. Records & Logs

1. The Contractor shall maintain records and logs of each task and organize cumulative records for each component and for the complete system chronologically. A continuous log shall be submitted for all devices. The log shall contain all initial settings, calibration, repair, and programming data. Complete logs shall be maintained and available for inspection on site, demonstrating planned and systematic adjustments and repairs have been accomplished for the system.

#### I. Work Request

1. The Contractor shall separately record each service call request, as received. The record shall include the serial number identifying the component involved, its location, date and time the call was received, specific nature of trouble, names of service personnel assigned to the task, instructions describing the action taken, the amount and nature of the materials used, and the date and time of commencement and completion. The Contractor shall deliver a record of the work performed within five (5) working days after the work was completed.

#### J. System Modifications

1. The Contractor shall make any recommendations for system modification in writing to the Project Manager. No system modifications, including operating parameters and control settings, shall be made without prior written approval from the Project Manager. Any modifications made to the system shall be incorporated into the operation and maintenance manuals and other documentation affected.

#### K. Software

1. The Contractor shall provide all software updates when approved by the Owner from the manufacturer during the installation and 12-month warranty period and verify operation of the system. These updates shall be accomplished in a timely manner, fully coordinated with the system operators, and incorporated into the operations and maintenance manuals and software documentation. There shall be at least one (1) scheduled update near the end of the first year's warranty period, at which time the Contractor shall install and validate the latest released version of the Manufacturer's software. All software changes shall be recorded in a log maintained in the

unit control room. An electronic copy of the software update shall be maintained within the log. At a minimum, the contractor shall provide a description of the modification, when the modification occurred, and name and contact information of the individual performing the modification. The log shall be maintained in a white 3 ring binder and the cover marked "SOFTWARE CHANGE LOG".

#### **1.10 MINIMUM REQUIREMENTS**

- A. References to industry and trade association standards and codes are minimum installation requirement standards.
- B. Drawings and other specification sections shall govern in those instances where requirements are greater than those specified in the above standards.

#### **1.11 DELIVERY, STORAGE, & HANDLING**

- A. Equipment and materials shall be protected during shipment and storage against physical damage, dirt, moisture, cold and rain:
  - 1. During installation, enclosures, equipment, controls, controllers, circuit protective devices, and other like items, shall be protected against entry of foreign matter; and be vacuum cleaned both inside and outside before testing and operating and repainting if required.
  - 2. Damaged equipment shall be, as determined by the Project Manager, placed in first class operating condition or be returned to the source of supply for repair or replacement.
  - 3. Painted surfaces shall be protected with factory installed removable heavy craft paper, sheet vinyl or equal.
  - 4. Damaged paint on equipment and materials shall be refinished with the same quality of paint and workmanship as used by the manufacturer so repaired areas are not obvious.
- B. Central Station, Workstations, and Controllers:
  - 1. Store in temperature and humidity controlled environment in original manufacturer's sealed containers. Maintain ambient temperature between 10 to 30 deg C (50 to 85 deg F), and not more than 80 percent relative humidity, non-condensing.
  - 2. Open each container; verify contents against packing list, and file copy of packing list, complete with container identification for inclusion in operation and maintenance data.
  - 3. Mark packing list with designations which have been assigned to materials and equipment for recording in the system labeling schedules generated by cable and asset management system.
  - 4. Save original manufacturer's containers and packing materials and deliver as directed under provisions covering extra materials.

### 1.12 PROJECT CONDITIONS

- A. Environmental Conditions: System shall be capable of withstanding the following environmental conditions without mechanical or electrical damage or degradation of operating capability:
1. Interior, Controlled Environment: System components, except central-station control unit, installed in temperature-controlled interior environments shall be rated for continuous operation in ambient conditions of 2 to 50 deg C (36 to 122 deg F) dry bulb and 20 to 90 percent relative humidity, non-condensing. NEMA 250, Type 1 enclosure.
  2. Interior, Uncontrolled Environment: System components installed in non-temperature-controlled interior environments shall be rated for continuous operation in ambient conditions of -18 to 50 deg C (0 to 122 deg F) dry bulb and 20 to 90 percent relative humidity, non-condensing. NEMA 250, Type 4X enclosures.
  3. Exterior Environment: System components installed in locations exposed to weather shall be rated for continuous operation in ambient conditions of -34 to 50 deg C (-30 to 122 deg F) dry bulb and 20 to 90 percent relative humidity, condensing. Rate for continuous operation where exposed to rain as specified in NEMA 250, winds up to 137 km/h (85 mph) and snow cover up to 610 mm (24 in) thick. NEMA 250, Type 4X enclosures.
  4. Hazardous Environment: System components located in areas where fire or explosion hazards may exist because of flammable gases or vapors, flammable liquids, combustible dust, or ignitable fibers shall be rated, listed, and installed according to NFPA 70.
  5. Corrosive Environment: For system components subjected to corrosive fumes, vapors, and wind-driven salt spray in coastal zones, provide NEMA 250, Type 4X enclosures.
- B. Security Environment: Use vandal resistant enclosures in high-risk areas where equipment may be subject to damage.
- C. Console: All console equipment shall, unless noted otherwise, be rated for continuous operation under ambient environmental conditions of 15.6 to 29.4 deg C (60 to 85 deg F) and a relative humidity of 20 to 80 percent.

### 1.13 EQUIPMENT AND MATERIALS

- A. Materials and equipment furnished shall be of current production by manufacturers regularly engaged in the manufacture of such items, for which replacement parts shall be available.
- B. When more than one unit of the same class of equipment is required, such units shall be the product of a single manufacturer.

C. Equipment Assemblies and Components:

1. Components of an assembled unit need not be products of the same manufacturer.
2. Manufacturers of equipment assemblies, which include components made by others, shall assume complete responsibility for the final assembled unit.
3. Components shall be compatible with each other and with the total assembly for the intended service.
4. Constituent parts which are similar shall be the product of a single manufacturer.

D. Factory wiring shall be identified on the equipment being furnished and on all wiring diagrams.

E. When Factory Testing Is Specified:

1. The Government shall have the option of witnessing factory tests. The contractor shall notify the VA through the Project Manager a minimum of 15 working days prior to the manufacturers making the factory tests.
2. Four copies of certified test reports containing all test data shall be furnished to the Project Manager prior to final inspection and not more than 90 days after completion of the tests.
3. When equipment fails to meet factory test and re-inspection is required, the contractor shall be liable for all additional expenses, including expenses of the Government.

#### **1.14 ELECTRICAL POWER**

- A. Electrical power of 120 Volts Alternating Current (VAC) shall be indicated on the Division 26 drawings. Additional locations requiring primary power required by the security system shall be shown as part of these contract documents. Primary power for the security system shall be configured to switch to emergency backup sources automatically if interrupted without degradation of any critical system function. Alarms shall not be generated as a result of power switching, however, an indication of power switching on (on-line source) shall be provided to the alarm monitor. The Security Contractor shall provide an interface (dry contact closure) between the PACS and the Uninterruptible Power Supply (UPS) system so the UPS trouble signals and main power fail appear on the PACS operator terminal as alarms.
- B. Failure of any on-line battery shall be detected and reported as a fault condition. Battery backed-up power supplies shall be provided sized for 2 hours of operation at actual connected load. Requirements for additional power or locations shall be included with the contract to

support equipment and systems offered. The following minimum requirements shall be provided for power sources and equipment.

1. Emergency Generator

- a. Report Printers: Unit Control Room
- b. Video Monitors: Unit Control Room
- c. Intercom Stations
- d. Radio System
- e. Lights: Unit Control Room, Equipment Rooms, & Security Offices
- f. Outlets: Security Outlets dedicated to security equipment racks or security enclosure assemblies.
- g. Security Device Power Supplies (DGP, VASS, Card Access, Lock Power, etc.) powered from the security closets or remotely: various locations
- h. Telephone/Radio Recording Equipment: Unit Control Room.
- i. VASS Camera Power Supplies: Security Closets
- j. VASS Pan/Tilt Units: Various Locations
- k. VASS Outdoor Housing Heaters and Blowers: Various Sites
- l. Intercom Master Control System
- m. Fiber Optic Receivers/Transmitters
- n. Security office Weapons Storage
- o. Outlets that charge handheld radios

2. Uninterruptible Power Supply (UPS) on Emergency Power

- a. The following 120VAC circuits shall be provided by others. The Security Contractor shall coordinate exact locations with the Electrical Contractor:
  - 1) Security System Monitors and Keyboards: Control Room
  - 2) CPU: Control Equipment Room
  - 3) Communications equipment: Control Equipment Room and various sites.
  - 4) VASS Matrix Switcher: Control Equipment Room
  - 5) VASS: Control Equipment Room
  - 6) Digital Video Recorders, encoders & decoders: Control Room
  - 7) All equipment Room racked equipment.
  - 8) Network switches

**1.15 TRANSIENT VOLTAGE SUPPRESSION, POWER SURGE SUPPLESION, & GROUNDING**

- A. Transient Voltage Surge Suppression: All cables and conductors extending beyond building façade, except fiber optic cables, which serve as communication, control, or signal lines shall be protected against Transient Voltage surges and have Transient Voltage Surge Suppression (TVSS) protection. The TVSS device shall be UL listed in accordance with Standard TIA 497B installed at each end. Lighting and surge

suppression shall be a multi-strike variety and include a fault indicator. Protection shall be furnished at the equipment and additional triple solid state surge protectors rated for the application on each wire line circuit shall be installed within 914.4 mm (3 ft) of the building cable entrance. Fuses shall not be used for surge protection. The inputs and outputs shall be tested in both normal mode and common mode to verify there is no interference.

1. A 10-microsecond rise time by 1000 microsecond pulse width waveform with a peak voltage of 1500 volts and a peak current of 60 amperes.
2. An 8-microsecond rise time by 20-microsecond pulse width waveform with a peak voltage of 1000 volts and a peak current of 500 amperes.
3. Maximum series current: 2 AMPS. Provide units manufactured by Advanced Protection Technologies, model # TE/FA 10B or TE/FA 20B.
4. Operating Temperature and Humidity: -40 to 85 deg C (-40 to 185 deg F), 0 to 95 percent relative humidity.

#### B. Grounding and Surge Suppression

1. The Security Contractor shall provide grounding and surge suppression to stabilize the voltage under normal operating conditions. To ensure the operation of over current devices, such as fuses, circuit breakers, and relays, under ground-fault conditions.
2. Security Contractor shall engineer and provide proper grounding and surge suppression as required by local jurisdiction and prevailing codes and standards referenced in this document.
3. Principal grounding components and features. Include main grounding buses and grounding and bonding connections to service equipment.
4. Details of interconnection with other grounding systems. The lightning protection system shall be provided by the Security Contractor.
5. Locations and sizes of grounding conductors and grounding buses in electrical, data, and communication equipment rooms and closets.
6. AC power receptacles are not to be used as a ground reference point.
7. Any cable that is shielded shall require a ground in accordance with the best practices of the trade and manufactures installation instructions.
8. Protection should be provided at both ends of cabling.

### 1.16 COMPONENT ENCLOSURES

#### A. Construction of Enclosures

1. Consoles, power supply enclosures, detector control and terminal cabinets, control units, wiring gutters, and other component housings, collectively referred to as enclosures, shall be so formed and assembled as to be sturdy and rigid.

2. Thickness of metal in-cast and sheet metal enclosures of all types shall not be less than those in Tables I and II, UL 611. Sheet steel used in fabrication of enclosures shall be not less than 14 gauge. Consoles shall be 16-gauge.
  3. Doors and covers shall be flanged. Enclosures shall not have pre-punched knockouts. Where doors are mounted on hinges with exposed pins, the hinges shall be of the tight pin type or the ends of hinge pins shall be tack welded to prevent removal. Doors having a latch edge length of less than 609.6 mm (24 in) shall be provided with a single construction core. Where the latch edge of a hinged door is more than 609.6 mm (24 in) or more in length, the door shall be provided with a three-point latching device with construction core; or alternatively with two, one located near each end.
  4. Any ventilator openings in enclosures and cabinets shall conform to the requirements of UL 611. Unless otherwise indicated, sheet metal enclosures shall be designed for wall mounting with tip holes slotted. Mounting holes shall be in positions that remain accessible when all major operating components are in place and the door is open, but shall be in accessible when the door is closed.
  5. Covers of pull and junction boxes provided to facilitate initial installation of the system shall be held in place by tamper proof Torx Center post security screws. Stenciled or painted labels shall be affixed to such boxes indicating they contain no connections. These labels shall not indicate the box is part of the Electronic Security System (ESS).
- B. Consoles & Equipment Racks: All consoles and vertical equipment racks shall include a forced air-cooling system to be provided by others.
1. Vertical Equipment Racks:
    - a. The forced air blowers shall be installed in the vented top of each cabinet and shall not reduce usable rack space.
    - b. The forced air fan shall consist of one fan rated at 105 CFM per rack bay and noise level shall not exceed 55 decibels.
    - c. d. Vertical equipment racks are to be provided with full sized clear plastic locking doors and vented top panels as shown on contract drawings.
  2. Console racks:
    - a. Forced air fans shall be installed in the top rear of each console bay. The forced air fan shall consist of one fan rated at 105 CFM mounted to a 133mm vented blank panel the noise level of each fan shall not exceed 55 decibels. The fans shall be installed so air



is pulled from the bottom of the rack or cabinet and exhausted out the top.

- b. Console racks are to be provided with flush mounted hinged rear doors with recessed locking latch on the bottom and middle sections of the consoles. Provide code access to support wiring for devices located on the work surfaces.

C. Tamper Provisions and Tamper Switches:

1. Enclosures, cabinets, housings, boxes and fittings or every product description having hinged doors or removable covers and which contain circuits, or the integrated security system and its power supplies shall be provided with cover operated, corrosion-resistant tamper switches.
2. Tamper switches shall be arranged to initiate an alarm signal that will report to the monitoring station when the door or cover is moved. Tamper switches shall be mechanically mounted to maximize the defeat time when enclosure covers are opened or removed. It shall take longer than 1 second to depress or defeat the tamper switch after opening or removing the cover. The enclosure and tamper switch shall function together in such a manner as to prohibit direct line of sight to any internal component before the switch activates.
3. Tamper switches shall be inaccessible until the switch is activated. Have mounting hardware concealed so the location of the switch cannot be observed from the exterior of the enclosure. Be connected to circuits which are under electrical supervision at all times, irrespective of the protection mode in which the circuit is operating. Be spring-loaded and held in the closed position by the door or cover and be wired so they break the circuit when the door cover is disturbed. Tamper circuits shall be adjustable type screw sets and shall be adjusted by the contractor to eliminate nuisance alarms associated with incorrectly mounted tamper device shall annunciate prior to the enclosure door opening (within 1/4 " tolerance. The tamper device or its components shall not be visible or accessible with common tools to bypass when the enclosure is in the secured mode.
4. The single gang junction boxes for the portrait alarming and pull boxes with less than 102 square mm will not require tamper switches.
5. All enclosures over 305 square mm shall be hinged with an enclosure lock.
6. Control Enclosures: Maintenance/Safety switches on control enclosures, which must be opened to make routing maintenance

- adjustments to the system and to service the power supplies, shall be push/pull-set automatic reset type.
7. Provide one (1) enclosure tamper switch for each 609 linear mm of enclosure lock side opening evenly spaced.
  8. All security screws shall be Torx-Post Security Screws.
  9. The contractor shall provide the owner with two (2) torx-post screwdrivers.

#### **1.17 ELECTRONIC COMPONENTS**

- A. All electronic components of the system shall be of the solid-state type, mounted on printed circuit boards conforming to UL 796. Boards shall be plug-in, quick-disconnect type. Circuitry shall not be so densely placed as to impede maintenance. All power-dissipating components shall incorporate safety margins of not less than 25 percent with respect to dissipation ratings, maximum voltages, and current-carrying capacity.

#### **1.18 SUBSTITUTE MATERIALS & EQUIPMENT**

- A. Where variations from the contract requirements are requested in accordance with the GENERAL CONDITIONS and Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES, the connecting work and related components shall include, but not be limited to additions or changes to branch circuits, circuit protective devices, conduits, wire, feeders, controls, panels and installation methods.
- B. In addition to this Section the Security Contractor shall also reference Section II, Products and associated divisions. The Project Manager shall have final authority on the authorization or refusal of substitutions. If there are no proposed substitutions, a statement in writing from the Contractor shall be submitted to the Project Manager stating same. In the preparation of a list of substitutions, the following information shall be included, as a minimum:
  1. Identity of the material or devices specified for which there is a proposed substitution.
  2. Description of the segment of the specification where the material or devices are referenced.
  3. Identity of the proposed substitute by manufacturer, brand name, catalog or model number and the manufacturer's product name.
  4. A technical statement of all operational characteristic expressing equivalence to items to be substituted and comparison, feature-by-feature, between specification requirements and the material or devices called for in the specification; and Price differential.
- C. Materials Not Listed: Furnish all necessary hardware, software, programming materials, and supporting equipment required to place the

specified major subsystems in full operation. Note that some supporting equipment, materials, and hardware may not be described herein. Depending on the manufacturers selected by the COTR, some equipment, materials and hardware may not be contained in either the Contract Documents or these written specifications, but are required by the manufacturer for complete operation according to the intent of the design and these specifications. In such cases, the Project Manager shall be given the opportunity to approve the additional equipment, hardware and materials that shall be fully identified in the bid and in the equipment list submittal. The Project Manager shall be consulted in the event there is any question about which supporting equipment, materials, or hardware is intended to be included.

- D. Response to Specification: The Contractor shall submit a point-by-point statement of compliance with each paragraph of the security specification. The statement of compliance shall list each paragraph by number and indicate "COMPLY" opposite the number for each paragraph where the Contractor fully complies with the specification. Where the proposed system cannot meet the requirements of the paragraph, and does not offer an equivalent solution, the offers shall indicate "DOES NOT COMPLY" opposite the paragraph number. Where the proposed system does not comply with the paragraph as written, but the bidder feels it will accomplish the intent of the paragraph in a manner different from that described, the offers shall indicate "COMPARABLE". The offers shall include a statement fully describing the "comparable" method of satisfying the requirement. Where a full and concise description is not provided, the offered system shall be considered as not complying with the specification. Any submission that does not include a point-by-point statement of compliance, as described above, shall be disqualified. Submittals for products shall be in precise order with the product section of the specification. Submittals not in proper sequence will be rejected.

#### **1.19 LIKE ITEMS**

- A. Where two or more items of equipment performing the same function are required, they shall be exact duplicates produced by one manufacturer. All equipment provided shall be complete, new, and free of any defects.

#### **1.20 WARRANTY**

- A. The Contractor shall, as a condition precedent to the final payment, execute a written guarantee (warranty) to the COTR certifying all contract requirements have been completed according to the final specifications. Contract drawings and the warranty of all materials and equipment furnished under this contract are to remain in satisfactory

operating condition (ordinary wear and tear, abuse and causes beyond his control for this work accepted) for one (1) year from the date the Contactor received written notification of final acceptance from the COTR. Demonstration and training shall be performed prior to system acceptance. All defects or damages due to faulty materials or workmanship shall be repaired or replaced without delay, to the COTR's satisfaction, and at the Contractor's expense. The Contractor shall provide quarterly inspections during the warranty period. The contractor shall provide written documentation to the COTR on conditions and findings of the system and device(s). In addition, the contractor shall provide written documentation of test results and stating what was done to correct any deficiencies. The first inspection shall occur 90 calendar days after the acceptance date. The last inspection shall occur 30 calendar days prior to the end of the warranty. The warranty period shall be extended until the last inspection and associated corrective actions are complete. When equipment and labor covered by the Contractor's warranty, or by a manufacturer's warranty, have been replaced or restored because of its failure during the warranty period, the warranty period for the replaced or repaired equipment or restored work shall be reinstated for a period equal to the original warranty period, and commencing with the date of completion of the replacement or restoration work. In the event any manufacturer customarily provides a warranty period greater than one (1) year, the Contractor's warranty shall be for the same duration for that component.

#### **1.22 SINGULAR NUMBER**

Where any device or part of equipment is referred to in these specifications in the singular number (e.g., "the switch"), this reference shall be deemed to apply to as many such devices as are required to complete the installation as shown on the drawings.

### **PART 2 - PRODUCTS**

#### **2.1 EQUIPMENT AND MATERIALS**

- A. All equipment associated within the Security Control Room, Security Console and Security Equipment Room shall be UL 827, UL 1981, and UL 60950 compliant and rated for continuous operation. Environmental conditions (i.e. temperature, humidity, wind, and seismic activity) shall be taken under consideration at each facility and site location prior to installation of the equipment.
- B. All equipment shall operate on a 120 or 240 volts alternating current (VAC); 50 Hz or 60 Hz AC power system unless documented otherwise in subsequent sections listed within this specification. All equipment shall have a back-up source of power that will provide a minimum of 8

hours of run time in the event of a loss of primary power to the facility.

- C. The system shall be designed, installed, and programmed in a manner that will allow for ease of operation, programming, servicing, maintenance, testing, and upgrading of the system.
- D. All equipment and materials for the system will be compatible to ensure correct operation.

## **2.2 EQUIPMENT ITEMS**

- A. The Security Management System shall provide full interface with all components of the security subsystem as follows:
  - 1. Shall allow for communication between the Physical Access Control System and Database Management and all subordinate work and monitoring stations, enrollment centers for badging and biometric devices as part of the PACS, local annunciation centers, the electronic Security Management System (SMS), and all other VA redundant or backup command center or other workstations locations.
  - 2. Shall provide automatic continuous communication with all systems that are monitored by the SMS, and shall automatically annunciate any communication failures or system alarms to the SMS operator providing identification of the system, nature of the alarm, and location of the alarm.
  - 3. Controlling devices shall be utilized to interface the SMS with all field devices.
  - 4. The Security control room and security console will be supported by an uninterrupted power supply (UPS) or dedicated backup generator power circuit.
  - 5. The Security Equipment room, Security Control Room, and Security Operator Console shall house the following equipment i.e. refer to individual master specifications for each security subsystem's specific requirements:
    - a. Security Console Bays and Equipment Racks
    - b. Security Network Server and Workstation
    - c. CCTV Monitoring, Controlling, and Recording Equipment
    - d. PACS Monitoring and Controlling Equipment
    - e. IDS Monitoring and Controlling Equipment
    - f. Security Access Detection Monitoring Equipment
    - g. EPPS Monitoring and Controlling Equipment
    - h. Main Panels for all Security Systems
    - i. Power Supply Units (PSU) for all field devices
    - j. Life safety and power monitoring equipment

- k. All other building systems deemed necessary by the VA to include, but not limited to, heating, ventilation and air conditioning (HVAC), elevator control, portable radio, fire alarm monitoring, and other potential systems.
  - l. Police two-way radio control consoles/units.
- B. Security Console Bays - shall be EIA 310D compliant and:
- 1. Utilize stand-up, sit-down, and vertical equipment racks in any combination to monitor and control the security subsystems.
  - 2. Shall be wide enough for equipment that requires a minimum 19 inch (47.5 cm) mounting area.
  - 3. Shall be made of metal, furnished with wire ways, a power strip, a thermostatic controlled bottom or top mounted fan units, a hinge mounted rear door, a hinge mounted front door made of Plexiglas, and a louvered top. When possible, pre-fabricated (standard off-the-shelf) security console equipment shall be used in place of customized designed consoles.
  - 4. A wire management system shall be designed and installed so that all cables are mounted in a manner that they do not interfere with day-to-day operations, are labeled for quick identification, and so that high voltage power cables do not cause signal interference with low voltage and data carrying cables.
  - 5. Shall be mounted on lockable casters.
  - 6. Shall be ergonomically designed so that all devices requiring repetitive interaction with by the operator can be easily accessed, observed, and accomplished.
  - 7. Controls and displays shall be located so that they are not obscured during normal operation. Control and display units installed with a work bench shall be a minimum of 3 in. (7.5 cm) from all edges of the work bench area.
  - 8. All security subsystem controls shall be installed within the same operating console bay of their associated equipment.
  - 9. Video monitors shall be mounted above all controls within a console bay and positioned in a manner that minimum strain is placed on the operator viewing them at the console.
  - 10. At least one workbench for every three (3) console bays shall be provided free of control equipment to allow for appropriate operator workspace.
  - 11. All console devices shall be labeled and marked with a minimum of quarter inch bold print.

12. All non-security related equipment that is required to be monitored shall be installed in a console bay separate from the security subsystem equipment and clearing be identified as such.
13. Console bays and related equipment shall be arranged in priority order and sequenced based upon their pre-defined security subsystem operations criticality established by the Contracting Officer.
14. The following minimum console technical characteristics shall be taken into consideration when designing for and installing the security console and equipment racks:

	Stand-Up	Sit-Down	Vertical Equipment Rack
Workstation Height	No Greater than 84 in. (210 cm)	No greater than 72 in. (150 cm)	No greater than 96 in. (240 cm)
Bench board Slope	21 in. (52.5 cm)	25 in. (62.5 cm)	N/A
Bench board Angle	15 degrees	15 degrees	N/A
Depth of Console	24 in. (60 cm)	24 in. (60 cm)	N/A
Leg and Feet Clearance	6 sq. ft. from center of Console Slope front	6 sq. ft. from center of Console Slope front	6 sq. ft. from center of Console Slope front
Distance Between Console Rows	96 in. (240 cm)	96 in. (240 cm)	96 in. (240 cm)
Distance Between Console and Wall	36 in. (90 cm) from the rear and/or side of console or rack	36 in. (90 cm) from the rear and/or side of console or rack	36 in. (90 cm) from the rear and/or side of console or rack

C. Security Console Configuration:

1. The size shall be defined by the number of console bays required to house and operate the security subsystems, as well as any other factors that may influence the overall design of the space. A small Access Control System and Database Management shall contain no more than four (4) security console bays. A large Access Control System and Database Management shall contain no less than five (5) and no more than eight (8) security console bays.
2. Shall meet the following minimum spacing requirements to ensure that a Access Control System and Database Management is provided to house existing and future security subsystems and other equipment listed in paragraph 2.3.C:

- a. 500 square feet for a large Access Control System and Database Management.
  - b. 300 square feet for a small Access Control System and Database Management.
  - c. If office, training room and conference space, is a processing area as well as holding cell space is to be located adjacent to the Access Control System and Database Management, these space requirements also need to be considered.
3. Shall be located in an area within, at a minimum, the first level/line of security defense defined by the VA. If the Access Control System and Database Management is to be located outside the first level of security, then the area shall be constructed or retrofit to meet or exceed those requirements outlined in associated VA Master Specifications.
4. Shall not be located within or near an area with little to no blast mitigation standoff space protection, adjacent to an outside wall exposed to vehicle parking and traffic, within a basement or potential flood zone area, in close approximately to major utility areas, or near an exposed air intake(s).
5. Access shall meet UFAS and ADA accessibility requirements.
6. Construction shall be slab to slab and free of windows, with the exception of a service window. All penetrations into the room shall be sealed with fire stopping materials. This material shall apply in accordance with Section 07 84 00, FIRESTOPPING.
7. A service window shall be installed in the wall next to the main entrance of the Access Control System and Database Management or where it best can be monitored and accessed by the security console operator. The window shall meet all requirements set forth in UL 752, to include at a minimum, Class III ballistic level protection. The windows shall be set in a minimum of four (4) inches (100 mm) solid concrete units to ceiling height with either masonry or gypsum wall board to the underside of the slab above. It shall also contain a service tray constructed in a manner that only objects no larger than 3 inches (7.5 cm) in width may pass through it.
8. The walls making up or surrounding the Access Control System and Database Management shall be made of materials that at a minimum offer Class III ballistic level protection for the security console operator(s).
9. There will be a main power cut-off button/switch located inside the Access Control System and Database Management in the event of an electrical fire or related event occurs.



10. Shall have a fire alarm detection unit that is tied into the main building fire alarm system and have at least two fire extinguishers located within it.
  11. Shall utilize a fire suppression system similar to that used by the VA's computer and telecommunications room operating areas.
  12. The floor shall be raised a minimum of 4 inches (10 cm) from the concrete floor base. Wire ways shall be utilized under the raised floor for separation of signal and power wires and cables.
  13. Access shall be monitored and controlled by the PACS via card reader and fixed camera that utilizes a wide angle lens. A 1 in. (2.5 cm) deadbolt shall be utilized as a mechanical override for the door in the event of electrical failure of the PACS, card reader, or locking mechanism.
  14. There shall only be one point of ingress and egress to and from the Security Control Room. The door shall be made of solid core wood or better. If a window is required for the door, then the window shall be ballistic resistant with a Millar covering.
  15. A two-way intercom shall be placed at the point of entry into the Security Control Room for access-communication control purposes.
  16. A remote push-button door unlocking device shall not be installed for the electronic PACS locking mechanism providing access control into the Security Control Room.
  17. All controlling equipment and power supplies that must be wall mounted shall be mounted in a manner that maximizes usability of the Security Control Room wall space. All equipment shall be mounted to three quarter inch fire retardant plywood. The plywood shall be fastened to the wall from slab to slab and fixed to the existing walls supports.
- D. Not Used.
- E. Not Used.
- F. Not Used.
- G. Wires and Cables:
1. Shall meet or exceed the manufactures recommendation for power and signals.
  2. Shall be carried in an enclosed conduit system, utilizing electromagnetic tubing (EMT) to include the equivalent in flexible metal, rigid galvanized steel (RGS) to include the equivalent of liquid tight, polyvinylchloride (PVC) schedule 40 or 80.
  3. All conduits will be sized and installed per the NEC. All security system signal and power cables that traverse or originate in a high security office space will contained in either EMT or RGS conduit.

4. All conduit, pull boxes, and junction boxes shall be marked with colored permanent tape or paint that will allow it to be distinguished from all other infrastructure conduit.
5. Conduit fills shall not exceed 50 percent unless otherwise documented.
6. A pull string shall be pulled along and provided with signal and power cables to assist in future installations.
7. At all locations where there is a wall penetration or core drilling is conducted to allow for conduit to be installed, fire stopping materials shall be applied to that area.
8. High voltage and signal cables shall not share the same conduit and shall be kept separate up to the point of connection. High voltage for the security subsystems shall be any cable or sets of cables carrying 30 VDC/VAC or higher.
9. For all equipment that is carrying digital data between the Security Control Room, Security Equipment Room, Security Console, or at a remote monitoring station, it shall not be less than 20 AWG and stranded copper wire for each conductor. The cable or each individual conductor within the cable shall have a shield that provides 100% coverage. Cables with a single overall shield shall have a tinned copper shield drain wire.

### **2.3 FIBER OPTIC EQUIPMENT**

#### **A. 8 Channel Fiber Optic Transceivers (Video & PTZ Control)**

1. The field-located and central-located fiber optic transceivers shall utilize wave division multiplexing to transmit and receive video and data pan-tilt-zoom control signals over two standard 62.5/125 multimode fibers.
2. The units shall be capable of operating over a range of 2 km.
3. The units shall be NTSC color compatible.
4. The units shall support data rates up to 64 Kbps.
5. The units shall be surface or rack mountable.
6. The units shall be UL listed.
7. The units shall meet or exceed the following specifications:
  - a. Video
    - 1) Input/Output: 1 volt pk-pk (75 ohms)
    - 2) Input/Output Channels: 8
    - 3) Bandwidth: 10 Hz - 6.5 MHz per channel
    - 4) Differential Gain: <2%
    - 5) Differential Phase: <0.7°
    - 6) Tilt: <1%
    - 7) Signal to Noise Ratio: 60 dB

## b. Data (Control)

- 1) Data Channels: 2
- 2) Data Format: RS-232, RS-422, 2 wire or 4 wire RS-485 with Tri-State Manchester Bi-Phase and Sensornet
- 3) Data Rate: DC - 100 kbps (NRZ)
- 4) Bit Error Rate: < 1 in 10<sup>-9</sup> @ Maximum Optical Loss Budget
- 5) Operating Mode: Simplex or Full-Duplex
- 6) Wavelength: 1310/1550 nm, Multimode or Singlemode
- 7) Optical Emitter: Laser Diode
- 8) Number of Fibers: 1

## c. Connectors

- 1) Optical: ST or as directed by VA.
- 2) Power and Data: Terminal Block with Screw Clamps
- 3) Video: BNC (Gold Plated Center-Pin)

## d. Electrical and Mechanical

- 1) Power: 12 VDC @ 500 mA (stand-alone)
- 3) Current Protection: Automatic Resettable Solid-State Current Limiters

## e. Environmental

- 1) MTBF: > 100,000 hours
- 2) Operating Temp: -40 to 74 deg C (-40 to 165 deg F)
- 3) Storage Temp: -40 to 85 deg C (-40 to 185 deg F)
- 4) Relative Humidity: 0% to 95% (non-condensing)

B. Fiber Optic Transmitters: The central-located fiber optic transmitters shall utilize wave division multiplexing to transmit video and signals over standard 62.5/125 multimode fibers.

1. The units shall be capable of operating over a range of 4.8 km.
2. The units shall be NTSC color compatible.
3. The units shall support data rates up to 64 Kbps.
4. The units shall be surface or rack mountable.
5. The units shall be UL listed.
6. The units shall meet or exceed the following specifications:

## a. Video

- 1) Input: 1 volt pk-pk (75 ohms)
- 2) Bandwidth: 5H2 - 10 MHZ
- 3) Differential Gain: <5%
- 4) Tilt: <1%
- 5) Signal-Noise: 60db
- 6) Wavelength: 850nm
- 7) Number of Fibers: 1
- 8) Operating Temp: -20 to 70 deg C (-4 to 158 deg F)

## 9) Connectors:

- a) Power: Female plug with screw clamps
- b) Video: BNC
- c) Optical: ST

## 10) Power: 12 VDC

C. Fiber Optic Receivers: The field-located fiber optic receivers shall utilize wave division multiplexing to receive video signals over standard 62.5/125 multimode fiber.

1. The units shall be capable of operating over a range of 4.8 km.
2. The units shall be NTSC color compatible.
3. The units shall support data rates up to 64 Kbps.
4. The units shall be surface or rack mountable.
5. The units shall be UL listed.
6. The units shall meet or exceed the following specifications:

## a. Video

- 1) Output: 1 volt pk-pk (75 ohms)
- 2) Bandwidth: 5Hz - 10 MHz
- 3) Differential Gain: <5%
- 4) Tilt: <1%
- 5) Signal-Noise: 60dB
- 6) Wavelength: 850nm
- 7) Number of Fibers: 1
- 8) Surface Mount: 106.7 x 88.9 x 25.4 mm (4.2 x 3.5 x 1 in)
- 9) Operating Temp: -20 to 70 deg C (-4 to 158 deg F)
- 10) Connectors:
- 11) Power: Female plug block with screw clamps
- 12) Video: BNC
- 13) Optical: ST
- 14) Power: 12 VAC 8 Channel Fiber Optic Transceivers (Video&PTZ Control)

## D. Fiber Optic Sub Rack with Power Supply

1. The Card Cage Rack shall provide high-density racking for fiber-optic modules. The unit shall be designed to mount in standard 483 mm (19 in) instrument racks and to accommodate the equivalent of 15 1-inch modules.

## a. Specifications

- 1) Card Orientation: Vertical
- 2) Construction: Aluminum
- 3) Current Consumption: 0.99 A
- 4) Humidity: 95.0 % RH
- 5) Input Power: 100-240 VAC, 60/50 Hz

- 6) Mounting: Mounts in standard 483 mm (19 in) rack using four (4) screws (optional wall brackets purchased separately)
- 7) Number of Outputs: 1.0
- 8) Number of Slots 15.0
- 9) Operating Temperature: -40 to +75 deg C (-40.0 to 167.0 deg F)
- 10) Output Voltage: 13.5 V
- 11) Output Current 6.0 A
- 12) Power Dissipation: 28.0 W
- 13) Power Factor: 48.0
- 14) Power Supply: (built-in)
- 15) Rack Units: 3RU
- 16) Redundant Capability: Yes
- 17) Weight: 2.43 kg (5.35 lb)
- 18) Width: 483 mm (19.0 in)

#### **2.4 TRANSIENT VOLTAGE SURGE SUPPRESSION DEVICES (TVSS) AND SURGE SUPPRESSION**

##### **A. Transient Voltage Surge Suppression**

1. All cables and conductors extending beyond building perimeter, except fiber optic cables, which serve as communication, control, or signal lines shall be protected against Transient Voltage surges and have Transient Voltage surge suppression protection (TVSS) UL listed in accordance with Standard 497B installed at each end. Lighting and surge suppression shall be a multi-strike variety and include a fault indicator. Protection shall be furnished at the equipment and additional triple solid state surge protectors rated for the application on each wire line circuit shall be installed within 915 mm (36 in) of the building cable entrance. Fuses shall not be used for surge protection. The inputs and outputs shall be tested in both normal mode and common mode using the following waveforms:
  - a. A 10-microsecond rise time by 1000 microsecond pulse width waveform with a peak voltage of 1500 volts and a peak current of 60 amperes.
  - b. An 8-microsecond rise time by 20-microsecond pulse width waveform with a peak voltage of 1000 volts and a peak current of 500 amperes.
  - c. Maximum series current: 2 AMPS. Provide units manufactured by Advanced Protection Technologies, model # TE/FA 10B or TE/FA 20B or approved equivalent.
  - d. Operating Temperature and Humidity: -40 to + 85 deg C (-40 to 185 deg F), and 0 to 95 percent relative humidity, non-condensing.

##### **B. Physical Access Control Systems**

1. Suppressors shall be installed on AC power at the point of service and shall meet the following criteria:
    - a. UL1449 2nd Edition, 2007, listed
    - b. UL1449 S.V.R. of 400 Volts or lower
    - c. Status Indicator Light(s)
    - d. Minimum Surge Current Capacity: 40,000 Amps (8 x 20  $\mu$ sec)
    - e. Maximum Continuous Current: 15 Amps
    - f. MCOV: 125 VAC
    - g. Service Voltage: 110-120 VAC
  2. Suppressors shall be installed on the Low Voltage circuit at both the point of entrance and exit of the building. Suppressors shall meet the following criteria:
    - a. UL 497B
    - b. Minimum Surge Current Capacity: 2,000 Amps per pair
    - c. Maximum Continuous Current: 5 Amps
    - d. MCOV: 33 Volts
    - e. Service Voltage: 24Volts
  3. Suppressors shall be installed on the communication circuit between the access controller and card reader at both the entrance and exit of the building. Suppressors shall meet the following criteria:
    - a. Conforms with UL497B standards (where applicable)
    - b. Clamp level for 12 and 24V power: 18VDC / 38VDC
    - c. Clamp level for Data/LED: 6.8VDC
    - d. Service Voltage for Power: 12VDC/24VDC
    - e. Service Voltage for Data/LED: <5VDC
    - f. Clamp level - PoE Access Power: 72V
    - g. Clamp level - PoE Access Data: 7.9V
    - h. Service Voltage - PoE Access: 48VAC - 54VAC
    - i. Service Voltage - PoE Data: <5VDC
- C. Not Used.
- D. Not Used.
- E. Video Surveillance System
1. Protectors shall be installed on coaxial cable systems on points of entry and exit from separate buildings. Suppressors shall be installed at each exterior camera location and include protection for 12 and/or 24 volt power, data signal and motor controls (for Pan, Tilt and Zoom systems). SPDs shall protect all modes herein mentioned and contain all modes in a single unit system. Protection for all systems mentioned above shall be incorporated at the head end equipment. Additionally a minimum 450VA battery back up shall be

used to protect the DVR or VCR and monitor. Protectors shall meet the following criteria:

a. Head-End Power

- 1) UL 1778, cUL (Battery Back Up)
- 2) Minimum Surge Current Capacity: 65,000 Amps (8x20µsec)
- 3) Minimum of two (2) NEMA 5-15R Receptacles (one (1) AC power only, one (1) with UPS)
- 4) All modes protected (L-N, L-G, N-G)
- 5) EMI/RFI Filtering
- 6) Maximum Continuous Current: 12 Amps

b. Camera Power

- 1) Minimum Surge Current Capacity: 1,000 Amps (8x20µsec); 240 Amps for IP Video/PoE cameras
- 2) Screw Terminal Connection
- 3) All protection modes L-G (all Lines)
- 4) MCOV <40VAC

c. Video And Data

- 1) Surge Current Capacity 1,000 Amps per conductor
- 2) "BNC" Connection (Coax)
- 3) Protection modes: L-G (Data), Center Pin-G, Shield-G (Coax)
- 4) Band Pass 0-2GHz
- 5) Insertion Loss <0.3dB

F. Grounding and Surge Suppression

1. The Security Contractor shall provide grounding and surge suppression to stabilize the voltage under normal operating conditions. This is to ensure the operation of over current devices, such as fuses, circuit breakers, and relays, underground-fault conditions.
2. The Contractor shall engineer, provide, and install proper grounding and surge suppression as required by local jurisdiction and prevailing codes and standards, referenced in this document.
3. Principal grounding components and features shall include: main grounding buses, grounding, and bonding connections to service equipment.
4. The Contractor shall provide detail drawings of interconnection with other grounding systems including lightning protection systems.
5. The Contractor shall provide details of locations and sizes of grounding conductors and grounding buses in electrical, data, and communication equipment rooms and closets.
6. AC power receptacles are not to be used as a ground reference point.

7. Any cable that is shielded shall require a ground in accordance with applicable codes, the best practices of the trade, and all manufactures' installation instructions.

G. 120 VAC Surge Suppression

1. Continuous Current: Unlimited (parallel connection)
2. Max Surge Current: 13,500 Amps
3. Protection Modes: L - N, L - G, N - G
4. Warranty: Ten Year Limited Warranty
5. Dimension: 73.7 x 41.1 x 52.1 mm (2.90 x 1.62 x 2.05 in)
6. Weight: 2.88 g (0.18 lbs)
7. Housing: ABS

## 2.5 INSTALLATION KIT

A. General:

1. The kit shall be provided that, at a minimum, includes all connectors and terminals, labeling systems, audio spade lugs, barrier strips, punch blocks or wire wrap terminals, heat shrink tubing, cable ties, solder, hangers, clamps, bolts, conduit, cable duct, and/or cable tray, etc., required to accomplish a neat and secure installation. All wires shall terminate in a spade lug and barrier strip, wire wrap terminal or punch block. Unfinished or unlabeled wire connections shall not be allowed. All unused and partially opened installation kit boxes, coaxial, fiber-optic, and twisted pair cable reels, conduit, cable tray, and/or cable duct bundles, wire rolls, physical installation hardware shall be turned over to the Contracting Officer. The following sections outline the minimum required installation sub-kits to be used:
2. System Grounding:
  - a. The grounding kit shall include all cable and installation hardware required. All head end equipment and power supplies shall be connected to earth ground via internal building wiring, according to the NEC.
  - b. This includes, but is not limited to:
    - 1) Coaxial Cable Shields
    - 2) Control Cable Shields
    - 3) Data Cable Shields
    - 4) Equipment Racks
    - 5) Equipment Cabinets
    - 6) Conduits
    - 7) Cable Duct blocks
    - 8) Cable Trays
    - 9) Power Panels



10) Grounding

11) Connector Panels

3. Coaxial Cable: The coaxial cable kit shall include all coaxial connectors, cable tying straps, heat shrink tabbing, hangers, clamps, etc., required to accomplish a neat and secure installation.
4. Wire and Cable: The wire and cable kit shall include all connectors and terminals, audio spade lugs, barrier straps, punch blocks, wire wrap strips, heat shrink tubing, tie wraps, solder, hangers, clamps, labels etc., required to accomplish a neat and orderly installation.
5. Conduit, Cable Duct, and Cable Tray: The kit shall include all conduit, duct, trays, junction boxes, back boxes, cover plates, feed through nipples, hangers, clamps, other hardware required to accomplish a neat and secure conduit, cable duct, and/or cable tray installation in accordance with the NEC and this document.
6. Equipment Interface: The equipment kit shall include any item or quantity of equipment, cable, mounting hardware and materials needed to interface the systems with the identified sub-system(s) according to the OEM requirements and this document.
7. Labels: The labeling kit shall include any item or quantity of labels, tools, stencils, and materials needed to label each subsystem according to the OEM requirements, as-installed drawings, and this document.
8. Documentation: The documentation kit shall include any item or quantity of items, computer discs, as installed drawings, equipment, maintenance, and operation manuals, and OEM materials needed to provide the system documentation as required by this document and explained herein.

### **PART 3 - EXECUTION**

#### **3.1 COMMON REQUIREMENTS FOR ELECTRONIC SAFETY AND SECURITY INSTALLATION**

- A. Comply with NECA 1.
- B. Measure indicated mounting heights to bottom of unit for suspended items and to center of unit for wall-mounting items.
- C. Headroom Maintenance: If mounting heights or other location criteria are not indicated, arrange and install components and equipment to provide maximum possible headroom consistent with these requirements.
- D. Equipment: Install to facilitate service, maintenance, and repair or replacement of components of both electronic safety and security equipment and other nearby installations. Connect in such a way as to facilitate future disconnecting with minimum interference with other items in the vicinity.
- E. Right of Way: Give to piping systems installed at a required slope.

F. Equipment location shall be as close as practical to locations shown on the drawings.

G. Inaccessible Equipment:

1. Where the Government determines that the Contractor has installed equipment not conveniently accessible for operation and maintenance, the equipment shall be removed and reinstalled as directed at no additional cost to the Government.
2. "Conveniently accessible" is defined as being capable of being reached without the use of ladders, or without climbing or crawling under or over obstacles such as, but not limited to, motors, pumps, belt guards, transformers, piping, ductwork, conduit and raceways.

### **3.2 FIRESTOPPING**

- A. Apply firestopping to penetrations of fire-rated floor and wall assemblies for electronic safety and security installations to restore original fire-resistance rating of assembly. Firestopping materials and installation requirements are specified in Division 07 Section 07 84 00 "Firestopping."

### **3.3 COMMISSIONING NOT USED.**

### **3.4 DEMONSTRATION AND TRAINING**

- A. Training shall be provided in accordance with Article, INSTRUCTIONS, of Section 01 00 00, GENERAL REQUIREMENTS.
- B. Training shall be provided for the particular equipment or system as required in each associated specification.
- C. A training schedule shall be developed and submitted by the contractor and approved by the Project Manager at least 30 days prior to the planned training.
- D. Provide services of manufacturer's technical representative for <insert hours> hours to instruct VA personnel in operation and maintenance of units.
- E. Submit training plans and instructor qualifications in accordance with the requirements of Section 28 08 00 - COMMISSIONING OF ELECTRONIC SAFETY AND SECURITY SYSTEMS.

### **3.5 WORK PERFORMANCE**

- A. Job site safety and worker safety is the responsibility of the contractor.
- B. For work on existing stations, arrange, phase and perform work to assure electronic safety and security service for other buildings at all times. Refer to Article OPERATIONS AND STORAGE AREAS under Section 01 00 00, GENERAL REQUIREMENTS.

- C. New work shall be installed and connected to existing work neatly and carefully. Disturbed or damaged work shall be replaced or repaired to its prior conditions, as required by Section 01 00 00, GENERAL REQUIREMENTS.
- D. Coordinate location of equipment and conduit with other trades to minimize interferences. See the GENERAL CONDITIONS.

### **3.6 SYSTEM PROGRAMMING**

#### **A. General Programming Requirements**

- 1. This following section shall be used by the contractor to identify the anticipated level of effort (LOE) required setup, program, and configure the Electronic Security System (ESS). The contractor shall be responsible for providing all setup, configuration, and programming to include data entry for the Security Management System (SMS) and subsystems [(e.g., video matrix switch, intercoms, digital video recorders, including integration of subsystems to the SMS (e.g., camera call up, time synchronization, intercoms)]. System programming for existing or new SMS servers shall not be conducted at the project site.

#### **B. Level of Effort for Programming**

- 1. The Contractor shall perform and complete system programming (including all data entry) at an offsite location using the Contractor's own copy of the SMS software. The Contractor's copy of the SMS software shall be of the Owners current version. Once system programming has been completed, the Contractor shall deliver the data to the Project Manager on data entry forms and an approved electronic medium, utilizing data from the contract documents. The completed forms shall be delivered to the Project Manager for review and approval at least 90 calendar days prior to the scheduled date the Contractor requires it. The Contractor shall not upload system programming until the Project Manager has provided written approval. The Contractor is responsible for backing up the system prior to uploading new programming data. Additional programming requirements are provided as follows:
  - a. Programming for New SMS Server: The contractor shall provide all other system related programming. The contractor will be responsible for uploading personnel information (e.g., ID Cards backgrounds, names, access privileges, personnel photos, access schedules, personnel groupings) along with coordinating with Project Manager for device configurations, standards, and groupings. VA shall provide database to support Contractor's data entry tasks. The contractor shall anticipate a weekly

coordination meeting and working with Project Manager to ensure data uploading is performed without incident of loss of function or data loss.

- b. Programming for Existing SMS Servers: The contractor shall perform all related system programming except for personnel data as noted. The contractor will not be responsible for uploading personnel information (e.g., ID Cards backgrounds, names, access privileges, access schedules, personnel groupings). The contractor shall anticipate a weekly coordination meeting and working alongside of Project Manager to ensure data uploading is performed without incident of loss of function or data loss. System programming for SMS servers shall be performed by using the Contractor's own server and software. These servers shall not be connected to existing devices or systems at any time.
2. The Contractor shall identify and request from the Project Manager, any additional data needed to provide a complete and operational system as described in the contract documents.
3. Contractor and Project Manager coordination on programming requires a high level of coordination to ensure programming is performed in accordance with VA requirements and programming uploads do not disrupt existing systems functionality. The contractor shall anticipate a minimum a weekly coordination meeting. Contractor shall ensure data uploading is performed without incident of loss of function or data loss. The following Level of Effort Chart is provided to communicate the expected level of effort required by contractors on VA ESS projects. Calculations to determine actual levels of effort shall be confirmed by the contractor before project award.

Description of Systems	Description of Tasks						
	Develop System Loading Sheets	Coordination	Initial Set-up Configuration	Graphic Maps	System Programming	Final Checks	Level of Effort (Typical Tasks)

SMS Setup & Configuration	e.g., program monitoring stations, programming networks, interconnections between CCTV, intercoms, time synchronization	e.g., retrieve IP addresses, naming conventions, standard event descriptions, programming templates, coordinate special system needs	e.g., Load system Operating System and Application software, general system configurations	e.g., develop naming conventions, develop file folders, confirm accuracy of AutoCAD Floor Plans, convert file into jpeg file	e.g., program monitoring stations, programming networks, interconnections between CCTV, intercoms, time synchronization	e.g., check all system diagnostics (e.g., client s, panels )	Load and set-up 4-6 CDs and configure servers (to configure Loading and Configuring software  Administrative account, audit log,  Keystrokes, mouse clicks, multi-screen configuration
---------------------------	---	--	--	--	---	--	--

Electronic Entry Control Systems	e.g., setup of device, door groups & schedules, REX, Locks, link graphics	e.g., confirming device configurations, naming conventions, event description and narratives	e.g., enter data from loading sheets; configure components, link events, cameras, and graphics		e.g., setup of device, door groups & schedules, REX, Locks, link graphics	e.g., performing testing to confirm correct setup and configuration	e.g., creating a door, door configuration, adding request to exit, door monitors and relays, door timers, door related events (e.g., access, access denied, forced open, held open), linkages, controlled areas, advanced door monitoring, time zones, sequence of operations
CCTV Systems	e.g., programming call-ups recording	e.g., confirming device configurations, naming conventions	e.g., enter data from loading sheets; camera naming convention, sequence, configure components)		e.g., programming call-ups recording and recording rates	e.g., confirm area of coverage, call-up per event generated and recording rates	e.g., setting up cameras points, recording ratios (e.g., normal, alarm event) timed recording, linkages, maps placements, call-ups

Inter coms Systems	e.g., programm ing events & call-ups	e.g., confir m ing device configur ations, naming conventi ons, event descript ion and narrativ es	e.g., enter data from loading sheets; configur e componen ts, link events, cameras, and graphics		e.g., progr amm ing even ts & call -ups	e.g., confir m operat ion, SMS event genera tion and camera call- up	e.g., setup linkages, events for activations, device troubles, land devices on graphic maps
Conso le Monit oring Compo nents	N/A	per monitor	per monitor	per graphic map	N/A	per monito r	N/A
Note: Programming tasks are supported through the contractor's development of the Technical Data Package Submittals.							

**Table 1 Contractor Level of Effort**

### 3.7 TESTING AND ACCEPTANCE

#### A. Performance Requirements

##### 1. General:

- a. The Contractor shall perform contract field, performance verification, and endurance testing and make adjustments of the completed security system when permitted. The Contractor shall provide all personnel, equipment, instrumentation, and supplies necessary to perform all testing. Written notification of planned testing shall be given to the Project Manager at least 60 calendar days prior to the test and after the Contractor has received written approval of the specific test procedures.
  - b. The COTR shall witness all testing and system adjustments during testing. Written permission shall be obtained from the Project Manager before proceeding with the next phase of testing. Original copies of all data produced during performance verification and endurance testing shall be turned over to the Project Manager at the conclusion of each phase of testing and prior to Project Manager approval of the test.
2. Test Procedures and Reports: The test procedures, compliant w/ VA standard test procedures, shall explain in detail, step-by-step actions and expected results demonstrating compliance with the requirements of the specification. The test reports shall be used to document results of the tests. The reports shall be delivered to the Project Manager within seven (7) calendar days after completion of each test.

#### B. Pre-Delivery Testing

1. The purpose of the pre-delivery test is to establish that a system is suitable for installation. As such, pre-delivery test shall be a mock-up of the system as planned in the contract documents. The Contractor shall assemble the Security Test System at the Contractors local project within 50-miles of the project site, and perform tests to demonstrate the performance of the system complies with the contract requirements in accordance with the approved pre-delivery test procedures. The tests shall take place during regular daytime working hours on weekdays. Model numbers of equipment tested shall be identical to those to be delivered to the site. Original copies of all data produced during pre-delivery testing, including results of each test procedure, shall be documented and delivered to the Project Manager at the conclusion of pre-delivery testing and prior to Project Manager's approval of the test. The test report shall be



arranged so all commands, stimuli, and responses are correlated to allow logical interpretation. For Existing System modifications, the contractor shall provide their own server with loaded applicable software to support PDT.

2. Test Setup: The pre-delivery test setup shall include the following:
  - a. All console equipment.
    - 1) At least one of each type of data transmission media (DTM) and associated equipment to provide a fully integrated PACS.
    - 2) The number of local processors shall equal the amount required by the site design.
    - 3) Enough sensor simulators to provide alarm signal inputs to the system equal to the number of sensors required by the design. The alarm signals shall be manually or software generated.
    - 4) Contractor to prove to owner all systems are appropriately sized and configured as sized.
    - 5) Integration of VASS, intercom systems, other subsystems.
3. During the bidding process the contractor shall submit a request for information to the Owner to determine if a pre-delivery test will be required. If a pre-delivery test is not required, the contractor shall provide a written notification that the Pre-delivery Test is not required in their shop drawings submission.

C. Not Used.

- D. The inspection and test will be conducted by a factory-certified contractor representative and witnessed by a Government Representative. The results of the inspection will be officially recorded by a designated Government Representative and maintained on file by the Project Manager (RE), until completion of the entire project. The results will be compared to the Acceptance Test results.

E. Contractor's Field Testing (CFT)

1. The Contractor shall calibrate and test all equipment, verify DTM operation, place the integrated system in service, and test the integrated system. Ground rods installed by this Contractor within the base of camera poles shall be tested as specified in IEEE STD 142. The Contractor shall test all security systems and equipment, and provide written proof of a 100% operational system before a date is established for the system acceptance test. Documentation package for CFT shall include completed (fully annotated details of test details) for each device and system tested, and annotated loading sheets documenting complete testing to Project Manager approval. CFT test documentation package shall conform to submittal requirements outlined in this Section. The Contractor's field testing procedures

shall be identical to the Project Manager's acceptance testing procedures. The Contractor shall provide the Project Manager with a written listing of all equipment and software indicating all equipment and components have been tested and passed. The Contractor shall deliver a written report to the Project Manager stating the installed complete system has been calibrated, tested, and is ready to begin performance verification testing; describing the results of the functional tests, diagnostics, and calibrations; and the report shall also include a copy of the approved acceptance test procedure.

Performance verification testing shall not take place until written notice by contractor is received certifying that a contractors field test was successful.

#### F. Performance Verification Test (PVT)

##### 1. Test team:

a. After the system has been pretested and the Contractor has submitted the pretest results and certification to the Project Manager, then the Contractor shall schedule an acceptance test to date and give the Project Manager written, notice as described herein, prior to the date the acceptance test is expected to begin. The system shall be tested in the presence of a Government Representative, an OEM certified representative, representative of the Contractor and other approved by the Project Manager. The system shall be tested utilizing the approved test equipment to certify proof of performance, FCC, UL and Emergency Service compliance. The test shall verify that the total system meets all the requirements of this specification. The notification of the acceptance test shall include the expected length (in time) of the test.

2. The Contractor shall demonstrate the completed Physical Access Control System PACS complies with the contract requirements. In addition, the Contractor shall provide written certification that the system is 100% operational prior to establishing a date for starting PVT. Using approved test procedures, all physical and functional requirements of the project shall be demonstrated and shown. The PVT will be stopped and aborted as soon as 10 technical deficiencies are found requiring correction. The Contractor shall be responsible for all travel and lodging expenses incurred for out-of-town personnel required to be present for resumption of the PVT. If the acceptance test is aborted, the re-test will commence from the beginning with a retest of components previously tested and accepted.

3. The PVT, as specified, shall not begin until receipt of written certification that the Contractors Field Testing was successful. This shall include certification of successful completion of testing as specified in paragraph "Contractor's Field Testing", and upon successful completion of testing at any time when the system fails to perform as specified. Upon termination of testing by the Project Manager or Contractor, the Contractor shall commence an assessment period as described for Endurance Testing Phase II.
4. Upon successful completion of the acceptance test, the Contractor shall deliver test reports and other documentation, as specified, to the Project Manager prior to commencing the endurance test.
5. Additional Components of the PVT shall include:
  - a. System Inventory
    - 1) All Device equipment
    - 2) All Software
    - 3) All Logon and Passwords
    - 4) All Cabling System Matrices
    - 5) All Cable Testing Documents
    - 6) All System and Cabinet Keys
  - b. Inspection
    - 1) Contractor shall record an inspection punch list noting all system deficiencies. The contractor shall prepare an inspection punch list format for Project Manager's approval.
    - 2) As a minimum the punch list shall include a listing of punch list items, punch list item location, description of item problem, date noted, date corrected, and details of how item was corrected.
6. Partial PVT - At the discretion of Project Manager, the Performance Verification Test may be performed in part should a 100% compliant CFT be performed. In the event that a partial PVT will be performed instead of a complete PVT; the partial PVT shall be performed by testing 10% of the system. The contractor shall perform a test of each procedure on select devices or equipment.

#### G. Endurance Test

1. The Contractor shall demonstrate the specified probability of detection and false alarm rate requirements of the completed system. The endurance test shall be conducted in phases as specified below. The endurance test shall not be started until the Project Manager notifies the Contractor, in writing, that the performance verification test is satisfactorily completed, training as specified has been completed, and correction of all outstanding deficiencies

- has been satisfactorily completed. VA shall operate the system 24 hours per day, including weekends and holidays, during Phase I and Phase III endurance testing. VA will maintain a log of all system deficiencies. The Project Manager may terminate testing at any time the system fails to perform as specified. Upon termination of testing, the Contractor shall commence an assessment period as described for Phase II. During the last day of the test, the Contractor shall verify the appropriate operation of the system. Upon successful completion of the endurance test, the Contractor shall deliver test reports and other documentation as specified to the Project Manager prior to acceptance of the system.
2. Phase I (Testing): The test shall be conducted 24 hours per day for 15 consecutive calendar days, including holidays, and the system shall operate as specified. The Contractor shall make no repairs during this phase of testing unless authorized in writing by the Project Manager. If the system experiences no failures, the Contractor may proceed directly to Phase III testing after receiving written permission from the Project Manager.
  3. Phase II (Assessment):
    - a. After the conclusion of Phase I, the Contractor shall identify all failures, determine causes of all failures, repair all failures, and deliver a written report to the Project Manager. The report shall explain in detail the nature of each failure, corrective action taken, results of tests performed, and recommend the point at which testing should be resumed.
    - b. After delivering the written report, the Contractor shall convene a test review meeting at the job site to present the results and recommendations to the Project Manager. The meeting shall not be scheduled earlier than five (5) business days after the Project Manager receives the report. As part of this test review meeting, the Contractor shall demonstrate all failures have been corrected by performing appropriate portions of the performance verification test. Based on the Contractor's report and the test review meeting, the Project Manager will provide a written determine of either the restart date or require Phase I be repeated.
  4. Phase III (Testing): The test shall be conducted 24 hours per day for 15 consecutive calendar days, including holidays, and the system shall operate as specified. The Contractor shall make no repairs during this phase of testing unless authorized in writing by the COTR.
  5. Phase IV (Assessment):

1. After the conclusion of Phase III, the Contractor shall identify all failures, determine causes of all failures, repair all failures, and deliver a written report to the COTR. The report shall explain in detail the nature of each failure, corrective action taken, results of tests performed, and recommend the point at which testing should be resumed.
2. After delivering the written report, the Contractor shall convene a test review meeting at the job site to present the results and recommendations to the COTR. The meeting shall not be scheduled earlier than five (5) business days after receipt of the report by the COTR. As a part of this test review meeting, the Contractor shall demonstrate that all failures have been corrected by repeating appropriate portions for the performance verification test. Based on the review meeting the test should not be scheduled earlier than five (5) business days after the Project Manager receives the report. As a part of this test review meeting, the Contractor shall demonstrate all failures have been corrected by repeating appropriate portions of the performance verification test. Based on the Contractor's report and the test review meeting, the Project Manager will provide a written determine of either the restart date or require Phase III be repeated. After the conclusion of any re-testing which the Project Manager may require, the Phase IV assessment shall be repeated as if Phase III had just been completed.

#### H. Exclusions

1. The Contractor will not be held responsible for failures in system performance resulting from the following:
  - a. An outage of the main power in excess of the capability of any backup power source provided the automatic initiation of all backup sources was accomplished and that automatic shutdown and restart of the PACS performed as specified.
  - b. Failure of an Owner furnished equipment or communications link, provided the failure was not due to Contractor furnished equipment, installation, or software.
  - c. Failure of existing Owner owned equipment, provided the failure was not due to Contractor furnished equipment, installation, or software.

- - - E N D - - -



**SECTION 28 05 13**  
**CONDUCTORS AND CABLES FOR ELECTRONIC SAFETY AND SECURITY**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section specifies the finishing, installation, connection, testing and certification the conductors and cables required for a fully functional for electronic safety and security (ESS) system.

**1.2 RELATED WORK**

- A. Section 01 00 00 - GENERAL REQUIREMENTS. For General Requirements.
- B. Section 07 84 00 - FIRESTOPPING. Requirements for firestopping application and use.
- C. Section 28 05 00 - COMMON WORK RESULTS FOR ELECTRONIC SAFETY AND SECURITY. Requirements for general requirements that are common to more than one section in Division 28.
- D. Section 28 05 26 - GROUNDING AND BONDING FOR ELECTRONIC SAFETY AND SECURITY. Requirements for personnel safety and to provide a low impedance path for possible ground fault currents.
- E. Section 28 05 28.33 - CONDUITS AND BOXES FOR ELECTRONIC SECURITY AND SAFETY. Requirements for infrastructure.

**1.3 DEFINITIONS**

- A. BICSI: Building Industry Consulting Service International.
- B. EMI: Electromagnetic interference.
- C. IDC: Insulation displacement connector.
- D. Ladder Cable Tray: A fabricated structure consisting of two longitudinal side rails connected by individual transverse members (rungs).
- E. Low Voltage: As defined in NFPA 70 for circuits and equipment operating at less than 50 V or for remote-control and signaling power-limited circuits.
- F. Open Cabling: Passing telecommunications cabling through open space (e.g., between the studs of a wall cavity).
- G. RCDD: Registered Communications Distribution Designer.
- H. Solid-Bottom or Nonventilated Cable Tray: A fabricated structure consisting of integral or separate longitudinal side rails, and a bottom without ventilation openings.
- I. Trough or Ventilated Cable Tray: A fabricated structure consisting of integral or separate longitudinal rails and a bottom having openings sufficient for the passage of air and using 75 percent or less of the plan area of the surface to support cables.
- J. UTP: Unshielded twisted pair.

#### **1.4 QUALITY ASSURANCE**

A. See section 28 05 00, Paragraph 1.4.

#### **1.5 SUBMITTALS**

A. In accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES, furnish the following:

1. Manufacturer's Literature and Data: Showing each cable type and rating.
2. Certificates: Two weeks prior to final inspection, deliver to the Project Manager/COTR four copies of the certification that the material is in accordance with the drawings and specifications and diagrams for cable management system.
3. Shop Drawings: Cable tray layout, showing cable tray route to scale, with relationship between the tray and adjacent structural, electrical, and mechanical elements. Include the following:
  - a. Vertical and horizontal offsets and transitions.
  - b. Clearances for access above and to side of cable trays.
  - c. Vertical elevation of cable trays above the floor or bottom of ceiling structure.
  - d. Load calculations to show dead and live loads as not exceeding manufacturer's rating for tray and its support elements.
  - e. System labeling schedules, including electronic copy of labeling schedules that are part of the cable and asset identification system of the software specified in Parts 2 and 3.
4. Wiring Diagrams. Show typical wiring schematics including the following:
  - a. Workstation outlets, jacks, and jack assemblies.
  - b. Patch cords.
  - c. Patch panels.
5. Cable Administration Drawings: As specified in Part 3 "Identification" Article.
6. Project planning documents as specified in Part 3.
7. Maintenance Data: For wire and cable to include in maintenance manuals.

#### **1.6 APPLICABLE PUBLICATIONS**

A. Publications listed below (including amendments, addenda, revisions, supplements and errata) form a part of this specification to the extent referenced. Publications are reference in the text by the basic designation only.



- B. American Society of Testing Material (ASTM):
  - D2301-04.....Standard Specification for Vinyl Chloride  
Plastic Pressure Sensitive Electrical Insulating  
Tape
- C. Federal Specifications (Fed. Spec.):
  - A-A-59544-08.....Cable and Wire, Electrical (Power, Fixed  
Installation)
- D. National Fire Protection Association (NFPA):
  - 70-11.....National Electrical Code (NEC)
- E. Underwriters Laboratories, Inc. (UL):
  - 44-05.....Thermoset-Insulated Wires and Cables
  - 83-08.....Thermoplastic-Insulated Wires and Cables
  - 467-07.....Electrical Grounding and Bonding Equipment
  - 486A-03.....Wire Connectors and Soldering Lugs for Use with  
Copper Conductors
  - 486C-04.....Splicing Wire Connectors
  - 486D-05.....Insulated Wire Connector Systems for Underground  
Use or in Damp or Wet Locations
  - 486E-00.....Equipment Wiring Terminals for Use with Aluminum  
and/or Copper Conductors
  - 493-07.....Thermoplastic-Insulated Underground Feeder and  
Branch Circuit Cable
  - 514B-04.....Fittings for Cable and Conduit
  - 1479-03.....Fire Tests of Through-Penetration Fire Stops//

#### **1.7 DELIVERY, STORAGE, AND HANDLING**

- A. Test cables upon receipt at Project site.
  - 1. Test optical fiber cable to determine the continuity of the strand  
end to end. Use optical-fiber flashlight or optical loss test set.
  - 2. Test optical fiber cable on reels. Use an optical time domain  
reflectometer to verify the cable length and locate cable defects,  
splices, and connector; include the loss value of each. Retain test  
data and include the record in maintenance data.
  - 3. Test each pair of UTP cable for open and short circuits.

#### **1.8 PROJECT CONDITIONS**

- A. Environmental Limitations: Do not deliver or install UTP, optical  
fiber, and coaxial cables and connecting materials until wet work in  
spaces is complete and dry, and temporary HVAC system is operating and  
maintaining ambient temperature and humidity conditions at occupancy  
levels during the remainder of the construction period.

## **PART 2 - PRODUCTS**

### **2.1 GENERAL**

- A. General: All cabling locations shall be in conduit systems as outlined in Division 28 unless a waiver is granted in writing or an exception is noted on the construction drawings.
- A. Support of Open Cabling: NRTL labeled for support of Category 6 cabling, designed to prevent degradation of cable performance and pinch points that could damage cable.
  - 1. Support brackets with cable tie slots for fastening cable ties to brackets.
  - 2. Lacing bars, spools, J-hooks, and D-rings.
  - 3. Straps and other devices.
- B. Cable Trays:
  - 1. Cable Tray Materials: Metal, suitable for indoors, and protected against corrosion by electroplated zinc galvanizing, complying with ASTM B 633, Type 1, not less than 0.000472 inch (0.012 mm) thick.
  - 2. Basket Cable Trays: 6 inches (150 mm) wide and 2 inches (50 mm) deep. Wire mesh spacing shall not exceed 2 by 4 inches (50 by 100 mm).
  - 3. Trough Cable Trays: Nominally 6 inches (150 mm) wide.
  - 4. Ladder Cable Trays: Nominally 18 inches (455 mm) wide, and a rung spacing of 12 inches (305 mm).
  - 5. Not Used.
  - 6. Not Used.
- C. Conduit and Boxes: Comply with requirements in Division 28 Section "Conduits and Backboxes for Electrical Systems." Flexible metal conduit shall not be used.
  - 1. Outlet boxes shall be no smaller than 2 inches (50 mm) wide, 3 inches (75 mm) high, and 2-1/2 inches (64 mm) deep.

### **2.2 BACKBOARDS**

- A. Backboards: Plywood, fire-retardant treated, 3/4 by 48 by 96 inches (19 by 1220 by 2440 mm). Comply with requirements for plywood backing panels in Division 06 Section "Rough Carpentry".

### **2.3 UTP CABLE**

- A. Description: 100-ohm, 4-pair UTP, formed into 25-pair binder groups covered with a blue thermoplastic jacket.
  - 1. Comply with ICEA S-90-661 for mechanical properties.
  - 2. Comply with TIA/EIA-568-B.1 for performance specifications.
  - 3. Comply with TIA/EIA-568-B.2, Category 6.

4. Listed and labeled by an NRTL acceptable to authorities having jurisdiction as complying with UL 444 and NFPA 70 for the following types:
  - a. Communications, General Purpose: Type CM or CMG.
  - b. Communications, Plenum Rated: Type CMP , complying with NFPA 262.
  - c. Communications, Riser Rated: Type CMR , complying with UL 1666.
  - d. Communications, Limited Purpose: Type CMX.
  - e. Multipurpose: Type MP or MPG .
  - f. Multipurpose, Plenum Rated: Type MPP, complying with NFPA 262.
  - g. Multipurpose, Riser Rated: Type MPR , complying with UL 1666.

#### **2.4 UTP CABLE HARDWARE**

- A. UTP Cable Connecting Hardware: IDC type, using modules designed for punch-down caps or tools. Cables shall be terminated with connecting hardware of the same category or higher.
- B. Connecting Blocks: 110-style for Category 6. Provide blocks for the number of cables terminated on the block, plus 25 percent spare. Integral with connector bodies, including plugs and jacks where indicated.

#### **2.5 OPTICAL FIBER CABLE**

- A. Description: Multimode, 50/125-micrometer, 24-fiber, nonconductive, tight buffer, optical fiber cable.
  1. Comply with ICEA S-83-596 for mechanical properties.
  2. Comply with TIA/EIA-568-B.3 for performance specifications.
  3. Comply with TIA/EIA-492AAAA-B for detailed specifications.
  4. Listed and labeled by an NRTL acceptable to authorities having jurisdiction as complying with UL 444, UL 1651, and NFPA 70 for the following types:
    - a. General Purpose, Nonconductive: Type OFN or OFNG.
    - b. Plenum Rated, Nonconductive: Type OFNP, complying with NFPA 262.
    - c. Riser Rated, Nonconductive: Type OFNR , complying with UL 1666.
    - d. General Purpose, Conductive: Type OFC or OFCG .
    - e. Plenum Rated, Conductive: Type OFCP , complying with NFPA 262.
    - f. Riser Rated, Conductive: Type OFCR , complying with UL 1666.
  5. Conductive cable shall be steel armored type.
  6. Maximum Attenuation: .50 dB/km at 850 nm; 1.5 dB/km at 1300 nm.
  7. Minimum Modal Bandwidth: 160 MHz-km at 850 nm; 500 MHz-km at 1300 nm.
- B. Jacket:
  1. Jacket Color: Aqua for 50/125-micrometer cable.
  2. Cable cordage jacket, fiber, unit, and group color shall be according to TIA/EIA-598-B.

3. Imprinted with fiber count, fiber type, and aggregate length at regular intervals not to exceed 40 inches (1000 mm).

## 2.6 OPTICAL FIBER CABLE HARDWARE

- A. Cable Connecting Hardware: Meet the Optical Fiber Connector Intermateability Standards (FOCIS) specifications of TIA/EIA-604-2, TIA/EIA-604-3-A, and TIA/EIA-604-12. Comply with TIA/EIA-568-B.3.
  1. Quick-connect, simplex and duplex, Type SC or as directed by VA COTR connectors. Insertion loss shall be not more than 0.75 dB.
  2. Type SFF connectors may be used in termination racks, panels, and equipment packages.

## 2.7 COAXIAL CABLE

- A. General Coaxial Cable Requirements: Broadband type, recommended by cable manufacturer specifically for broadband data transmission applications. Coaxial cable and accessories shall have 75-ohm nominal impedance with a return loss of 20 dB maximum from 7 to 806 MHz.
- B. RG-11/U: NFPA 70, Type CATV.
  1. No. 14 AWG, solid, copper-covered steel conductor.
  2. Gas-injected, foam-PE insulation.
  3. Double shielded with 100 percent aluminum polyester tape and 60 percent aluminum braid.
  4. Jacketed with sunlight-resistant, black PVC or PE.
  5. Suitable for outdoor installations in ambient temperatures ranging from minus 40 to plus 85 deg C.
- C. RG59/U: NFPA 70, Type CATVR.
  1. No. 20 AWG, solid, silver-plated, copper-covered steel conductor.
  2. Gas-injected, foam-PE insulation.
  3. Triple shielded with 100 percent aluminum polyester tape and 95 percent aluminum braid; covered by aluminum foil with grounding strip.
  4. Color-coded PVC jacket.
- D. RG-6/U: NFPA 70, Type CATV or CM.
  1. No. 16 AWG, solid, copper-covered steel conductor; gas-injected, foam-PE insulation.
  2. Double shielded with 100 percent aluminum-foil shield and 60 percent aluminum braid.
  3. Jacketed with black PVC or PE.
  4. Suitable for indoor installations.
- E. RG59/U: NFPA 70, Type CATV.
  1. No. 20 AWG, solid, copper-covered steel conductor; gas-injected, foam-PE insulation.

2. Double shielded with 100 percent aluminum polyester tape and 40 percent aluminum braid.
  3. PVC jacket.
- F. RG59/U (Plenum Rated): NFPA 70, Type CMP.
1. No. 20 AWG, solid, copper-covered steel conductor; foam fluorinated ethylene propylene insulation.
  2. Double shielded with 100 percent aluminum-foil shield and 65 percent aluminum braid.
  3. Copolymer jacket.
- G. NFPA and UL compliance, listed and labeled by an NRTL acceptable to authorities having jurisdiction as complying with UL 1655, and with NFPA 70 "Radio and Television Equipment" and "Community Antenna Television and Radio Distribution" Articles. Types are as follows:
1. CATV Cable: Type CATV.
  2. CATV Plenum Rated: Type CATVP, complying with NFPA 262.
  3. CATV Riser Rated: Type CATVR, complying with UL 1666.
  4. CATV Limited Rating: Type CATVX.

## **2.8 COAXIAL CABLE HARDWARE**

- A. Coaxial-Cable Connectors: Type BNC, 75 ohms.

## **2.9 RS-232 CABLE**

- A. Standard Cable: NFPA 70, Type CM.
1. Paired, 2 pairs, No. 22 AWG, stranded (7x30) tinned copper conductors.
  2. Polypropylene insulation.
  3. Individual aluminum foil-polyester tape shielded pairs with 100 percent shield coverage.
  4. PVC jacket.
  5. Pairs are cabled on common axis with No. 24 AWG, stranded (7x32) tinned copper drain wire.
  6. Flame Resistance: Comply with UL 1581.
- B. Plenum-Rated Cable: NFPA 70, Type CMP.
1. Paired, 2 pairs, No. 22 AWG, stranded (7x30) tinned copper conductors.
  2. Plastic insulation.
  3. Individual aluminum foil-polyester tape shielded pairs with 100 percent shield coverage.
  4. Plastic jacket.
  5. Pairs are cabled on common axis with No. 24 AWG, stranded (7x32) tinned copper drain wire.
  6. Flame Resistance: Comply with NFPA 262.

**2.10 RS-485 CABLE**

- A. Standard Cable: NFPA 70, Type CM.
  - 1. Paired, 2 pairs, twisted, No. 22 AWG, stranded (7x30) tinned copper conductors.
  - 2. PVC insulation.
  - 3. Unshielded.
  - 4. PVC jacket.
  - 5. Flame Resistance: Comply with UL 1581.
- B. Plenum-Rated Cable: NFPA 70, Type CMP.
  - 1. Paired, 2 pairs, No. 22 AWG, stranded (7x30) tinned copper conductors.
  - 2. Fluorinated ethylene propylene insulation.
  - 3. Unshielded.
  - 4. Fluorinated ethylene propylene jacket.
  - 5. Flame Resistance: NFPA 262, Flame Test.

**2.11 LOW-VOLTAGE CONTROL CABLE**

- A. Paired Lock Cable: NFPA 70, Type CMG.
  - 1. 1 pair, twisted, No. 16 AWG, stranded (19x29) tinned copper conductors.
  - 2. PVC insulation.
  - 3. Unshielded.
  - 4. PVC jacket.
  - 5. Flame Resistance: Comply with UL 1581.
- B. Plenum-Rated, Paired Lock Cable: NFPA 70, Type CMP.
  - 1. 1 pair, twisted, No. 16 AWG, stranded (19x29) tinned copper conductors.
  - 2. PVC insulation.
  - 3. Unshielded.
  - 4. PVC jacket.
  - 5. Flame Resistance: Comply with NFPA 262.
- C. Paired Lock Cable: NFPA 70, Type CMG.
  - 1. 1 pair, twisted, No. 18 AWG, stranded (19x30) tinned copper conductors.
  - 2. PVC insulation.
  - 3. Unshielded.
  - 4. PVC jacket.
  - 5. Flame Resistance: Comply with UL 1581.
- D. Plenum-Rated, Paired Lock Cable: NFPA 70, Type CMP.
  - 1. 1 pair, twisted, No. 18 AWG, stranded (19x30) tinned copper conductors.
  - 2. Fluorinated ethylene propylene insulation.

- 3. Unshielded.
- 4. Plastic jacket.
- 5. Flame Resistance: NFPA 262, Flame Test.

## **2.12 CONTROL-CIRCUIT CONDUCTORS**

- A. Class 1 Control Circuits: Stranded copper, Type THHN-THWN, in raceway complying with UL 83.
- B. Class 2 Control Circuits: Stranded copper, Type THHN-THWN, in raceway complying with UL 83.
- C. Class 3 Remote-Control and Signal Circuits: Stranded copper, Type TW or TF, complying with UL 83.

## **2.13 FIRE ALARM WIRE AND CABLE**

- A. General Wire and Cable Requirements: NRTL listed and labeled as complying with NFPA 70, Article 760.
- B. Signaling Line Circuits: Twisted, shielded pair, size as recommended by system manufacturer.
  - 1. Circuit Integrity Cable: Twisted shielded pair, NFPA 70, Article 760, Classification CI, for power-limited fire alarm signal service Type FPL. NRTL listed and labeled as complying with UL 1424 and UL 2196 for a 2-hour rating.
- C. Non-Power-Limited Circuits: Solid-copper conductors with 600-V rated, 75 deg C, color-coded insulation.
  - 1. Low-Voltage Circuits: No. 16 AWG, minimum.
  - 2. Line-Voltage Circuits: No. 12 AWG, minimum.
  - 3. Multiconductor Armored Cable: NFPA 70, Type MC, copper conductors, Type TFN/THHN conductor insulation, copper drain wire, copper armor with red identifier stripe, NRTL listed for fire alarm and cable tray installation, plenum rated, and complying with requirements in UL 2196 for a 2-hour rating.

## **2.14 IDENTIFICATION PRODUCTS**

- A. Comply with UL 969 for a system of labeling materials, including label stocks, laminating adhesives, and inks used by label printers.

## **2.15 SOURCE QUALITY CONTROL**

- A. Testing Agency: Engage a qualified testing agency to evaluate cables.
- B. Factory test UTP and optical fiber cables on reels according to TIA/EIA-568-B.1.
- C. Factory test UTP cables according to TIA/EIA-568-B.2.
- D. Factory test multimode optical fiber cables according to TIA/EIA-526-14-A and TIA/EIA-568-B.3.
- E. Factory sweep test coaxial cables at frequencies from 5 MHz to 1 GHz. Sweep test shall test the frequency response, or attenuation over

frequency, of a cable by generating a voltage whose frequency is varied through the specified frequency range and graphing the results.

F. Cable will be considered defective if it does not pass tests and inspections.

G. Prepare test and inspection reports.

## **2.16 WIRE LUBRICATING COMPOUND**

A. Suitable for the wire insulation and conduit it is used with, and shall not harden or become adhesive.

B. Shall not be used on wire for isolated type electrical power systems.

## **2.17 FIREPROOFING TAPE**

A. The tape shall consist of a flexible, conformable fabric of organic composition coated one side with flame-retardant elastomer.

B. The tape shall be self-extinguishing and shall not support combustion. It shall be arc-proof and fireproof.

C. The tape shall not deteriorate when subjected to water, gases, salt water, sewage, or fungus and be resistant to sunlight and ultraviolet light.

D. The finished application shall withstand a 200-ampere arc for not less than 30 seconds.

E. Securing tape: Glass cloth electrical tape not less than 0.18 mm (7 mils) thick, and 19 mm (3/4 inch) wide.

## **PART 3 - EXECUTION**

### **3.1 INSTALLATION OF CONDUCTORS AND CABLES**

A. Comply with NECA 1.

B. General Requirements for Cabling:

1. Comply with TIA/EIA-568-B.1.

2. Comply with BICSI ITSIM, Ch. 6, "Cable Termination Practices."

3. Install 110-style IDC termination hardware unless otherwise indicated.

4. Terminate all conductors; no cable shall contain un-terminated elements. Make terminations only at indicated outlets, terminals, and cross-connect and patch panels.

5. Cables may not be spliced. Secure and support cables at intervals not exceeding 30 inches (760 mm) and not more than 6 inches (150 mm) from cabinets, boxes, fittings, outlets, racks, frames, and terminals.

6. Bundle, lace, and train conductors to terminal points without exceeding manufacturer's limitations on bending radii, but not less than radii specified in BICSI ITSIM, "Cabling Termination Practices" Chapter. Install lacing bars and distribution spools.



7. Do not install bruised, kinked, scored, deformed, or abraded cable. Do not splice cable between termination, tap, or junction points. Remove and discard cable if damaged during installation and replace it with new cable.
8. Cold-Weather Installation: Bring cable to room temperature before dereeling. Heat lamps shall not be used for heating.
9. Pulling Cable:
  - a. Comply with BICSI ITSIM, Ch. 4, "Pulling Cable." Monitor cable pull tensions.
  - b. Provide installation equipment that will prevent the cutting or abrasion of insulation during pulling of cables.
  - c. Use ropes made of nonmetallic material for pulling feeders.
  - d. Attach pulling lines for feeders by means of either woven basket grips or pulling eyes attached directly to the conductors, as approved by the Project Manager/COTR.
  - e. Pull in multiple cables together in a single conduit.
- C. Splice cables and wires where necessary only in outlet boxes, junction boxes, or pull boxes.
  1. Splices and terminations shall be mechanically and electrically secure.
  2. Where the Government determines that unsatisfactory splices or terminations have been installed, remove the devices and install approved devices at no additional cost to the Government.
- D. Seal cable and wire entering a building from underground, between the wire and conduit where the cable exits the conduit, with a non-hardening approved compound.
- E. Unless otherwise specified in other sections install wiring and connect to equipment/devices to perform the required functions as shown and specified.
- F. Except where otherwise required, install a separate power supply circuit for each system so that malfunctions in any system will not affect other systems.
- G. Where separate power supply circuits are not shown, connect the systems to the nearest panel boards of suitable voltages, which are intended to supply such systems and have suitable spare circuit breakers or space for installation.
- H. Install a red warning indicator on the handle of the branch circuit breaker for the power supply circuit for each system to prevent accidental de-energizing of the systems.
- I. System voltages shall be 120 volts or lower where shown on the drawings or as required by the NEC.

## J. UTP Cable Installation:

1. Comply with TIA/EIA-568-B.2.
2. Do not untwist UTP cables more than 1/2 inch (12 mm) from the point of termination to maintain cable geometry.

## K. Optical Fiber Cable Installation:

1. Comply with TIA/EIA-568-B.3.
2. Cable shall be terminated on connecting hardware that is rack or cabinet mounted.

## L. Open-Cable Installation:

1. Install cabling with horizontal and vertical cable guides in telecommunications spaces with terminating hardware and interconnection equipment.
2. Suspend copper cable not in a wireway or pathway a minimum of 8 inches (200 mm) above ceilings by cable supports not more than 60 inches (1525 mm) apart.
3. Cable shall not be run through structural members or in contact with pipes, ducts, or other potentially damaging items.

## M. Not Used.

## N. Outdoor Coaxial Cable Installation:

1. Install outdoor connections in enclosures complying with NEMA 250, Type 4X. Install corrosion-resistant connectors with properly designed O-rings to keep out moisture.
2. Attach antenna lead-in cable to support structure at intervals not exceeding 36 inches (915 mm).

## O. Separation from EMI Sources:

1. Comply with BICSI TDMM and TIA/EIA-569-A recommendations for separating unshielded copper voice and data communication cable from potential EMI sources, including electrical power lines and equipment.
2. Separation between open communications cables or cables in nonmetallic raceways and unshielded power conductors and electrical equipment shall be as follows:
  - a. Electrical Equipment Rating Less Than 2 kVA: A minimum of 5 inches (127 mm).
  - b. Electrical Equipment Rating between 2 and 5 kVA: A minimum of 12 inches (300 mm).
  - c. Electrical Equipment Rating More Than 5 kVA: A minimum of 24 inches (600 mm).
3. Separation between communications cables in grounded metallic raceways and unshielded power lines or electrical equipment shall be as follows:

- a. Electrical Equipment Rating Less Than 2 kVA: A minimum of 2-1/2 inches (64 mm).
  - b. Electrical Equipment Rating between 2 and 5 kVA: A minimum of 6 inches (150 mm).
  - c. Electrical Equipment Rating More Than 5 kVA: A minimum of 12 inches (300 mm).
4. Separation between communications cables in grounded metallic raceways and power lines and electrical equipment located in grounded metallic conduits or enclosures shall be as follows:
- a. Electrical Equipment Rating Less Than 2 kVA: No requirement.
  - b. Electrical Equipment Rating between 2 and 5 kVA: A minimum of 3 inches (75 mm).
  - c. Electrical Equipment Rating More Than 5 kVA: A minimum of 6 inches (150 mm).
5. Separation between Cables and Electrical Motors and Transformers, 5 kVA or HP and Larger: A minimum of 48 inches (1200 mm).
6. Separation between Cables and Fluorescent Fixtures: A minimum of 5 inches (127 mm).

### **3.2 FIRE ALARM WIRING INSTALLATION**

- A. Comply with NECA 1 and NFPA 72.
- B. Wiring Method: Install wiring in metal raceway according to Division 28 Section CONDUITS AND BACKBOXES FOR ELECTRICAL SYSTEMS."
  - 1. Install plenum cable in environmental air spaces, including plenum ceilings.
  - 2. Fire alarm circuits and equipment control wiring associated with the fire alarm system shall be installed in a dedicated raceway system. This system shall not be used for any other wire or cable.
- C. Wiring Method:
  - 1. Cables and raceways used for fire alarm circuits, and equipment control wiring associated with the fire alarm system, may not contain any other wire or cable.
  - 2. Fire-Rated Cables: Use of 2-hour, fire-rated fire alarm cables, NFPA 70, Types MI and CI, is permitted.
  - 3. Signaling Line Circuits: Power-limited fire alarm cables may be installed in the same cable or raceway as signaling line circuits.
- D. Wiring within Enclosures: Separate power-limited and non-power-limited conductors as recommended by manufacturer. Install conductors parallel with or at right angles to sides and back of the enclosure. Bundle, lace, and train conductors to terminal points with no excess. Connect conductors that are terminated, spliced, or interrupted in any enclosure associated with the fire alarm system to terminal blocks. Mark each

terminal according to the system's wiring diagrams. Make all connections with approved crimp-on terminal spade lugs, pressure-type terminal blocks, or plug connectors.

- E. Cable Taps: Use numbered terminal strips in junction, pull, and outlet boxes, cabinets, or equipment enclosures where circuit connections are made.
- F. Color-Coding: Color-code fire alarm conductors differently from the normal building power wiring. Use one color-code for alarm circuit wiring and another for supervisory circuits. Color-code audible alarm-indicating circuits differently from alarm-initiating circuits. Use different colors for visible alarm-indicating devices. Paint fire alarm system junction boxes and covers red.
- G. Risers: Install at least two vertical cable risers to serve the fire alarm system. Separate risers in close proximity to each other with a minimum one-hour-rated wall, so the loss of one riser does not prevent the receipt or transmission of signals from other floors or zones.
- H. Wiring to Remote Alarm Transmitting Device: 1-inch (25-mm) conduit between the fire alarm control panel and the transmitter. Install number of conductors and electrical supervision for connecting wiring as needed to suit monitoring function.

### **3.3 CONTROL CIRCUIT CONDUCTORS**

- A. Minimum Conductor Sizes:
  - 1. Class 1 remote-control and signal circuits, No. 14 AWG.
  - 2. Class 2 low-energy, remote-control and signal circuits, No. 16 AWG.
  - 3. Class 3 low-energy, remote-control, alarm and signal circuits, No. 12 AWG.

### **3.4 CONNECTIONS**

- A. Comply with requirements in Division 28 Section, PHYSICAL ACCESS CONTROL for connecting, terminating, and identifying wires and cables.
- B. Not Used.
- C. Not Used.
- D. Not Used.
- E. Comply with requirements in Division 28 Section "FIRE DETECTION AND ALARM" for connecting, terminating, and identifying wires and cables.

### **3.5 FIRESTOPPING**

- A. Comply with requirements in Division 07 Section "PENETRATION FIRESTOPPING."
- B. Comply with TIA/EIA-569-A, "Firestopping" Annex A.
- C. Comply with BICSI TDMM, "Firestopping Systems" Article.

### 3.6 GROUNDING

- A. For communications wiring, comply with ANSI-J-STD-607-A and with BICSI TDMM, "Grounding, Bonding, and Electrical Protection" Chapter.
- B. For low-voltage wiring and cabling, comply with requirements in Division 28 Section "GROUNDING AND BONDING FOR ELECTRONIC SAFETY AND SECURITY."

### 3.7 IDENTIFICATION

- A. Identify system components, wiring, and cabling complying with TIA/EIA-606-A.
- B. Install a permanent wire marker on each wire at each termination.
- C. Identifying numbers and letters on the wire markers shall correspond to those on the wiring diagrams used for installing the systems.
- D. Wire markers shall retain their markings after cleaning.
- E. In each handhole, install embossed brass tags to identify the system served and function.

### 3.8 FIELD QUALITY CONTROL

- A. Testing Agency: Engage a qualified testing agency to perform tests and inspections.
- B. Perform tests and inspections.
- C. Tests and Inspections:
  - 1. Visually inspect UTP and optical fiber cable jacket materials for UL or third-party certification markings. Inspect cabling terminations to confirm color-coding for pin assignments, and inspect cabling connections to confirm compliance with TIA/EIA-568-B.1.
  - 2. Visually inspect cable placement, cable termination, grounding and bonding, equipment and patch cords, and labeling of all components.
  - 3. Test UTP cabling for DC loop resistance, shorts, opens, intermittent faults, and polarity between conductors. Test operation of shorting bars in connection blocks. Test cables after termination but not cross connection.
    - a. Test instruments shall meet or exceed applicable requirements in TIA/EIA-568-B.2. Perform tests with a tester that complies with performance requirements in "Test Instruments (Normative)" Annex, complying with measurement accuracy specified in "Measurement Accuracy (Informative)" Annex. Use only test cords and adapters that are qualified by test equipment manufacturer for channel or link test configuration.
  - 4. Optical Fiber Cable Tests:
    - a. Test instruments shall meet or exceed applicable requirements in TIA/EIA-568-B.1. Use only test cords and adapters that are qualified by test equipment manufacturer for channel or link test configuration.

b. Link End-to-End Attenuation Tests:

- 1) Multimode Link Measurements: Test at 850 or 1300 nm in 1 direction according to TIA/EIA-526-14-A, Method B, One Reference Jumper.
- 2) Attenuation test results for links shall be less than 2.0 dB. Attenuation test results shall be less than that calculated according to equation in TIA/EIA-568-B.1.

5. Coaxial Cable Tests: Comply with requirements in Division 27 Section "Master Antenna Television System."

- D. Document data for each measurement. Print data for submittals in a summary report that is formatted using Table 10.1 in BICSI TDMM as a guide, or transfer the data from the instrument to the computer, save as text files, print, and submit.
- E. End-to-end cabling will be considered defective if it does not pass tests and inspections.
- F. Prepare test and inspection reports.

### 3.9 EXISTING WIRING

- A. Unless specifically indicated on the plans, existing wiring shall not be reused for the new installation. Only wiring that conforms to the specifications and applicable codes may be reused. If existing wiring does not meet these requirements, existing wiring may not be reused and new wires shall be installed.

- - - E N D - - -

**SECTION 28 05 26**  
**GROUNDING AND BONDING FOR ELECTRONIC SAFETY AND SECURITY**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section specifies the finishing, installation, connection, testing and certification of the grounding and bonding required for a fully functional Electronic Safety and Security (ESS) system.
- B. "Grounding electrode system" refers to all electrodes required by NEC, as well as including made, supplementary, grounding electrodes.
- C. The terms "connect" and "bond" are used interchangeably in this specification and have the same meaning

**1.2 RELATED WORK**

- A. Section 01 00 00 - GENERAL REQUIREMENTS. For General Requirements.
- B. Section 26 41 00 - FACILITY LIGHTNING PROTECTION. Requirements for a lightning protection system.
- C. Section 28 05 00 - REQUIREMENTS FOR ELECTRONIC SAFETY AND SECURITY INSTALLATIONS. For general electrical requirements, quality assurance, coordination, and project conditions that are common to more than one section in Division 28.
- D. Section 28 05 13 - CONDUCTORS AND CABLES FOR ELECTRONIC SAFETY AND SECURITY. Requirements for low voltage power and lighting wiring.

**1.3 SUBMITTALS**

- A. Submit in accordance with Section 28 05 00, COMMON WORK RESULTS FOR ELECTRONIC SAFETY AND SECURITY.
- B. Shop Drawings:
  - 1. Clearly present enough information to determine compliance with drawings and specifications.
  - 2. Include the location of system grounding electrode connections and the routing of aboveground and underground grounding electrode conductors.
- C. Test Reports: Provide certified test reports of ground resistance.
- D. Certifications: Two weeks prior to final inspection, submit four copies of the following to the COTR:
  - 1. Certification that the materials and installation are in accordance with the drawings and specifications.
  - 2. Certification by the contractor that the complete installation has been properly installed and tested.

#### 1.4 APPLICABLE PUBLICATIONS

- A. Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by designation only.
- B. American Society for Testing and Materials (ASTM):
  - B1-07.....Standard Specification for Hard-Drawn Copper Wire
  - B3-07.....Standard Specification for Soft or Annealed Copper Wire
  - B8-04.....Standard Specification for Concentric-Lay-Stranded Copper Conductors, Hard, Medium-Hard, or Soft
- C. Institute of Electrical and Electronics Engineers, Inc. (IEEE):
  - 81-1983.....IEEE Guide for Measuring Earth Resistivity, Ground Impedance, and Earth Surface Potentials of a Ground System
  - C2-07.....National Electrical Safety Code
- D. National Fire Protection Association (NFPA):
  - 70-11.....National Electrical Code (NEC)
  - 99-2005.....Health Care Facilities
- E. Underwriters Laboratories, Inc. (UL):
  - 44-05 .....Thermoset-Insulated Wires and Cables
  - 83-08 .....Thermoplastic-Insulated Wires and Cables
  - 467-07 .....Grounding and Bonding Equipment
  - 486A-486B-03 .....Wire Connectors

#### PART 2 - PRODUCTS

##### 2.1 GROUNDING AND BONDING CONDUCTORS

- A. Equipment grounding conductors shall be UL 83 insulated stranded copper, except that sizes 6 mm<sup>2</sup> (10 AWG) and smaller shall be solid copper. Insulation color shall be continuous green for all equipment grounding conductors, except that wire sizes 25 mm<sup>2</sup> (4 AWG) and larger shall be permitted to be identified per NEC.
- B. Bonding conductors shall be ASTM B8 bare stranded copper, except that sizes 6 mm<sup>2</sup> (10 AWG) and smaller shall be ASTM B1 solid bare copper wire.



## 2.2 GROUND RODS

- A. Copper clad steel, 19 mm (3/4-inch) diameter by 3000 mm (10 feet) long, conforming to UL 467.
- B. Quantity of rods shall be as required to obtain the specified ground resistance.

## 2.3 SPLICES AND TERMINATION COMPONENTS

- A. Components shall meet or exceed UL 467 and be clearly marked with the manufacturer, catalog number, and permitted conductor size(s).2.4 ground connections
- B. Listed and labeled by an NRTL acceptable to authorities having jurisdiction for applications in which used and for specific types, sizes, and combinations of conductors and other items connected.
- C. Below Grade: Exothermic-welded type connectors.
- D. Above Grade:
  - 1. Bonding Jumpers: Compression-type connectors, using zinc-plated fasteners and external tooth lockwashers.
  - 2. Connection to Building Steel: Exothermic-welded type connectors.
  - 3. Ground Busbars: Two-hole compression type lugs, using tin-plated copper or copper alloy bolts and nuts.
  - 4. Rack and Cabinet Ground Bars: One-hole compression-type lugs, using zinc-plated or copper alloy fasteners.
  - 5. Bolted Connectors for Conductors and Pipes: Copper or copper alloy, pressure type with at least two bolts.
    - a) Pipe Connectors: Clamp type, sized for pipe.
  - 6. Welded Connectors: Exothermic-welding kits of types recommended by kit manufacturer for materials being joined and installation conditions.

## 2.4 EQUIPMENT RACK AND CABINET GROUND BARS

- A. Provide solid copper ground bars designed for mounting on the framework of open or cabinet-enclosed equipment racks with minimum dimensions of 4 mm thick by 19 mm wide (3/8 inch x ¾ inch).

## 2.5 GROUND TERMINAL BLOCKS

- A. At any equipment mounting location (e.g., backboards and hinged cover enclosures) where rack-type ground bars cannot be mounted, provide screw lug-type terminal blocks.

**2.6 SPLICE CASE GROUND ACCESSORIES**

- A. Splice case grounding and bonding accessories shall be supplied by the splice case manufacturer when available. Otherwise, use 16 mm<sup>2</sup> (6 AWG) insulated ground wire with shield bonding connectors.

**2.7 COMPUTER ROOM GROUND NOT USED.****2.8 SECURITY CONTROL ROOM GROUND NOT USED.****PART 3 - EXECUTION****3.1 GENERAL**

- A. Ground in accordance with the NEC, as shown on drawings, and as specified herein.
- B. System Grounding:
  - 1. Secondary service neutrals: Ground at the supply side of the secondary disconnecting means and at the related transformers.
  - 2. Separately derived systems (transformers downstream from the service entrance): Ground the secondary neutral.
- C. Equipment Grounding: Metallic structures, including ductwork and building steel, enclosures, raceways, junction boxes, outlet boxes, cabinets, machine frames, and other conductive items in close proximity with electrical circuits, shall be bonded and grounded.

**3.2 INACCESSIBLE GROUNDING CONNECTIONS**

- A. Make grounding connections, which are buried or otherwise normally inaccessible (except connections for which periodic testing access is required) by exothermic weld.

**3.3 CORROSION INHIBITORS**

- A. When making ground and ground bonding connections, apply a corrosion inhibitor to all contact surfaces. Use corrosion inhibitor appropriate for protecting a connection between the metals used.

**3.4 CONDUCTIVE PIPING**

- A. Bond all conductive piping systems, interior and exterior, to the building to the grounding electrode system. Bonding connections shall be made as close as practical to the equipment ground bus.

**3.5 COMPUTER ROOM/SECURITY EQUIPMENT ROOM GROUNDING**

- A. Conduit: Ground and bond metallic conduit systems as follows:
  - 1. Ground metallic service conduit and any pipes entering or being routed within the computer room at each end using 16 mm<sup>2</sup> (6AWG) bonding jumpers.
  - 2. Bond at all intermediate metallic enclosures and across all joints using 16 mm<sup>2</sup> (6 AWG) bonding jumpers.

### 3.6 WIREWAY GROUNDING

A. Ground and Bond Metallic Wireway Systems as follows:

1. Bond the metallic structures of wireway to provide 100 percent electrical continuity throughout the wireway system by connecting a 16 mm<sup>2</sup> (6 AWG) bonding jumper at all intermediate metallic enclosures and across all section junctions.
2. Install insulated 16 mm<sup>2</sup> (6 AWG) bonding jumpers between the wireway system bonded as required in paragraph 1 above, and the closest building ground at each end and approximately every 16 meters (50 feet).
3. Use insulated 16 mm<sup>2</sup> (6 AWG) bonding jumpers to ground or bond metallic wireway at each end at all intermediate metallic enclosures and cross all section junctions.
4. Use insulated 16 mm<sup>2</sup> (6 AWG) bonding jumpers to ground cable tray to column-mounted building ground plates (pads) at each end and approximately every 15 meters.

### 3.7 LIGHTNING PROTECTION SYSTEM

A. Bond the lightning protection system to earth ground externally to the building. Under no condition shall the electrical system's third of fourth ground electrode system, or the telecommunications system circulating ground system be connected to the lightning protection system. The Facility's structural steel may be used to connected the lightning protection system at the direction of the Project Manager certified by an independent certified grounding contractor.

### 3.8 EXTERIOR LIGHT/CAMERA POLES NOT USED.

### 3.9 GROUND RESISTANCE

- A. Grounding system resistance to ground shall not exceed 5 ohms. Make any modifications or additions to the grounding electrode system necessary for compliance without additional cost to the Government. Final tests shall ensure that this requirement is met.
- B. Resistance of the grounding electrode system shall be measured using a four-terminal fall-of-potential method as defined in IEEE 81. Ground resistance measurements shall be made before the electrical distribution system is energized and shall be made in normally dry conditions not fewer than 48 hours after the last rainfall. Resistance measurements of separate grounding electrode systems shall be made before the systems are bonded together below grade. The combined resistance of separate systems may be used to meet the required

resistance, but the specified number of electrodes must still be provided.

- C. Services at power company interface points shall comply with the power company ground resistance requirements.
- D. Below-grade connections shall be visually inspected by the COTR prior to backfilling. The contractor shall notify the COTR 24 hours before the connections are ready for inspection.

### **3.10 GROUND ROD INSTALLATION**

- A. Drive each rod vertically in the earth, not less than 3000 mm (10 feet) in depth.
- B. Where permanently concealed ground connections are required, make the connections by the exothermic process to form solid metal joints. Make accessible ground connections with mechanical pressure type ground connectors.
- C. Where rock prevents the driving of vertical ground rods, install angled ground rods or grounding electrodes in horizontal trenches to achieve the specified resistance.

### **3.11 GROUNDING FOR RF/EMI CONTROL NOT USED.**

### **3.12 LABELING**

- A. Comply with requirements in Division 26 Section "ELECTRICAL IDENTIFICATION" Article for instruction signs. The label or its text shall be green.
- B. Install labels at the telecommunications bonding conductor and grounding equalizer and at the grounding electrode conductor where exposed.
  - 1. Label Text: "If this connector or cable is loose or if it must be removed for any reason, notify the facility manager."

### **3.13 FIELD QUALITY CONTROL**

- A. Perform tests and inspections.
- B. Tests and Inspections:
  - 1. After installing grounding system but before permanent electrical circuits have been energized, test for compliance with requirements.
  - 2. Inspect physical and mechanical condition. Verify tightness of accessible, bolted, electrical connections with a calibrated torque wrench according to manufacturer's written instructions.
  - 3. Test completed grounding system at each location where a maximum ground-resistance level is specified, at service disconnect

- enclosure grounding terminal at individual ground rods. Make tests at ground rods before any conductors are connected.
- a. Measure ground resistance no fewer than two full days after last trace of precipitation and without soil being moistened by any means other than natural drainage or seepage and without chemical treatment or other artificial means of reducing natural ground resistance.
  - b. Perform tests by fall-of-potential method according to IEEE 81.
- C. Grounding system will be considered defective if it does not pass tests and inspections.
- D. Prepare test and inspection reports.
- E. Report measured ground resistances that exceed the following values:
- 1. Power Distribution Units or Panel boards Serving Electronic Equipment: 3 ohm(s).
  - 2. Manhole Grounds: 10 ohms.
- F. Excessive Ground Resistance: If resistance to ground exceeds specified values, notify Architect promptly and include recommendations to reduce ground resistance.

- - - E N D - - -



**SECTION 28 05 28.33**  
**CONDUITS AND BACKBOXES FOR ELECTRONIC SAFETY AND SECURITY**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section specifies the finishing, installation, connection, testing certification of the conduit, fittings, and boxes to form a complete, coordinated, raceway system(s). Conduits and when approved separate UL Certified and Listed partitioned telecommunications raceways are required for a fully functional Electronic Safety and Security (ESS) system. Raceways are required for all electronic safety and security cabling unless shown or specified otherwise.
- B. Definitions: The term conduit, as used in this specification, shall mean any or all of the raceway types specified.

**1.2 RELATED WORK**

- A. Section 01 00 00 - GENERAL REQUIREMENTS. For General Requirements.
- B. Section 06 10 00 - ROUGH CARPENTRY. Requirements for mounting board for communication closets.
- C. Section 07 84 00 - FIRESTOPPING. Requirements for sealing around penetrations to maintain the integrity of fire rated construction.
- D. Section 07 60 00 - FLASHING AND SHEET METAL. Requirements for fabrications for the deflection of water away from the building envelope at penetrations.
- E. Section 07 92 00 - JOINT SEALANTS. Requirements for sealing around conduit penetrations through the building envelope to prevent moisture migration into the building.
- F. Section 09 91 00 - PAINTING. Requirements for identification and painting of conduit and other devices.
- G. Section 28 05 00 - COMMON WORK RESULTS FOR ELECTRONIC SAFETY AND SECURITY. For general electrical requirements, general arrangement of the contract documents, coordination, quality assurance, project conditions, equipment and materials, and items that is common to more than one section of Division 28.
- H. Section 28 05 26 - GROUNDING AND BONDING FOR ELECTRONIC SAFETY AND SECURITY. Requirements for personnel safety and to provide a low impedance path for possible ground fault currents.

**1.3 DEFINITIONS**

- A. EMT: Electrical metallic tubing.
- B. ENT: Electrical nonmetallic tubing.
- C. EPDM: Ethylene-propylene-diene terpolymer rubber.
- D. FMC: Flexible metal conduit.

- E. IMC: Intermediate metal conduit.
- F. LFMC: Liquidtight flexible metal conduit.
- G. LFNC: Liquidtight flexible nonmetallic conduit.
- H. NBR: Acrylonitrile-butadiene rubber.
- I. RNC: Rigid nonmetallic conduit.

#### **1.4 QUALITY ASSURANCE**

- A. Refer to Paragraph 1.4 Quality Assurance, in Section 28 05 00, COMMON WORK RESULTS FOR ELECTRONIC SAFETY AND SECURITY.

#### **1.5 SUBMITTALS**

- A. Submit in accordance with Section 28 05 00, COMMON WORK RESULTS FOR ELECTRONIC SAFETY AND SECURITY and Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES. Furnish the following:
- B. Shop Drawings:
  - 1. Size and location of main feeders;
  - 2. Size and location of panels and pull boxes
  - 3. Layout of required conduit penetrations through structural elements.
  - 4. The specific item proposed and its area of application shall be identified on the catalog cuts.
- C. Certification: Prior to final inspection, deliver to the Project Manager/COTR four copies of the certification that the material is in accordance with the drawings and specifications and has been properly installed.
- D. Not Used.
- E. Product Data: For surface raceways, wireways and fittings, floor boxes, hinged-cover enclosures, and cabinets.
- F. Shop Drawings: For the following raceway components. Include plans, elevations, sections, details, and attachments to other work.
  - 1. Not Used.
  - 2. Not Used.
- G. Coordination Drawings: Conduit routing plans, drawn to scale, on which the following items are shown and coordinated with each other, based on input from installers of the items involved:
  - 1. Structural members in the paths of conduit groups with common supports.
  - 2. HVAC and plumbing items and architectural features in the paths of conduit groups with common supports.

#### **1.6 APPLICABLE PUBLICATIONS**

- A. Publications listed below (including amendments, addenda, revisions, supplements and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by the basic designation only.



B. National Electrical Manufacturers Association (NEMA):

TC-3-04.....PVC Fittings for Use with Rigid PVC Conduit and  
Tubing

FB1-07.....Fittings, Cast Metal Boxes and Conduit Bodies  
for Conduit, Electrical Metallic Tubing and  
Cable

C. National Fire Protection Association (NFPA):

70-11.....National Electrical Code (NEC)

D. Underwriters Laboratories, Inc. (UL):

1-05.....Flexible Metal Conduit

5-04.....Surface Metal Raceway and Fittings

6-07.....Rigid Metal Conduit

50-07.....Enclosures for Electrical Equipment

360-09.....Liquid-Tight Flexible Steel Conduit

467-07.....Grounding and Bonding Equipment

514A-04.....Metallic Outlet Boxes

514B-04.....Fittings for Cable and Conduit

514C-02.....Nonmetallic Outlet Boxes, Flush-Device Boxes and  
Covers

651-05.....Schedule 40 and 80 Rigid PVC Conduit

651A-07.....Type EB and A Rigid PVC Conduit and HDPE Conduit

797-07.....Electrical Metallic Tubing

1242-06.....Intermediate Metal Conduit

## **PART 2 - PRODUCTS**

### **2.1 GENERAL**

A. Conduit Size: In accordance with the NEC, but not less than 20 mm (3/4 inch) unless otherwise shown.

### **2.2 CONDUIT**

A. Rigid galvanized steel: Shall Conform to UL 6, ANSI C80.1.

B. Not Used.

C. Rigid intermediate steel conduit (IMC): Shall Conform to UL 1242, ANSI C80.6.

D. Electrical metallic tubing (EMT): Shall Conform to UL 797, ANSI C80.3.  
Maximum size not to exceed 105 mm (4 inches) and shall be permitted only  
with cable rated 600 volts or less.

E. Flexible galvanized steel conduit: Shall Conform to UL 1.

F. Liquid-tight flexible metal conduit: Shall Conform to UL 360.

G. Not Used.

### **2.3 WIREWAYS AND RACEWAYS**

A. Surface metal raceway: Shall Conform to UL 5.

## 2.4 CONDUIT FITTINGS

### A. Rigid steel and IMC conduit fittings:

1. Fittings shall meet the requirements of UL 514B and ANSI/ NEMA FB1.
2. Standard threaded couplings, locknuts, bushings, and elbows: Only steel or malleable iron materials are acceptable. Integral retractable type IMC couplings are also acceptable.
3. Locknuts: Bonding type with sharp edges for digging into the metal wall of an enclosure.
4. Bushings: Metallic insulating type, consisting of an insulating insert molded or locked into the metallic body of the fitting. Bushings made entirely of metal or nonmetallic material are not permitted.
5. Erickson (union-type) and set screw type couplings: Approved for use in concrete are permitted for use to complete a conduit run where conduit is installed in concrete. Use set screws of case hardened steel with hex head and cup point to firmly seat in conduit wall for positive ground. Tightening of set screws with pliers is prohibited.
6. Sealing fittings: Threaded cast iron type. Use continuous drain type sealing fittings to prevent passage of water vapor. In concealed work, install fittings in flush steel boxes with blank cover plates having the same finishes as that of other electrical plates in the room.

### B. Not Used.

3. Set screw fittings: Not permitted for use with aluminum conduit.

### C. Electrical metallic tubing fittings:

1. Fittings shall meet the requirements of UL 514B and ANSI/ NEMA FB1.
2. Only steel or malleable iron materials are acceptable.
3. Couplings and connectors: Concrete tight and rain tight, with connectors having insulated throats. Use gland and ring compression type couplings and connectors for conduit sizes 50 mm (2 inches) and smaller. Use set screw type couplings with four set screws each for conduit sizes over 50 mm (2 inches). Use set screws of case-hardened steel with hex head and cup point to firmly seat in wall of conduit for positive grounding.
4. Indent type connectors or couplings are prohibited.
5. Die-cast or pressure-cast zinc-alloy fittings or fittings made of "pot metal" are prohibited.

### D. Flexible steel conduit fittings:

1. Conform to UL 514B. Only steel or malleable iron materials are acceptable.
2. Clamp type, with insulated throat.

- E. Liquid-tight flexible metal conduit fittings:
  - 1. Fittings shall meet the requirements of UL 514B and ANSI/ NEMA FB1.
  - 2. Only steel or malleable iron materials are acceptable.
  - 3. Fittings must incorporate a threaded grounding cone, a steel or plastic compression ring, and a gland for tightening. Connectors shall have insulated throats.
- F. Not Used.
- G. Surface metal raceway fittings: As recommended by the raceway manufacturer.
- H. Expansion and deflection couplings:
  - 1. Conform to UL 467 and UL 514B.
  - 2. Accommodate, 19 mm (0.75 inch) deflection, expansion, or contraction in any direction, and allow 30 degree angular deflections.
  - 3. Include internal flexible metal braid sized to guarantee conduit ground continuity and fault currents in accordance with UL 467, and the NEC code tables for ground conductors.
  - 4. Jacket: Flexible, corrosion-resistant, watertight, moisture and heat resistant molded rubber material with stainless steel jacket clamps.

## 2.5 CONDUIT SUPPORTS

- A. Parts and hardware: Zinc-coat or provide equivalent corrosion protection.
- B. Individual Conduit Hangers: Designed for the purpose, having a pre-assembled closure bolt and nut, and provisions for receiving a hanger rod.
- C. Multiple conduit (trapeze) hangers: Not less than 38 mm by 38 mm (1-1/2 by 1-1/2 inch), 12 gage steel, cold formed, lipped channels; with not less than 9 mm (3/8 inch) diameter steel hanger rods.
- D. Solid Masonry and Concrete Anchors: Self-drilling expansion shields, or machine bolt expansion.

## 2.6 OUTLET, JUNCTION, AND PULL BOXES

- A. UL-50 and UL-514A.
- B. Cast metal where required by the NEC or shown, and equipped with rustproof boxes.
- C. Nonmetallic Outlet and Device Boxes: NEMA OS 2.
- D. Metal Floor Boxes: Cast or sheet metal, semi-adjustable, rectangular.
- E. Sheet metal boxes: Galvanized steel, except where otherwise shown.
- F. Flush mounted wall or ceiling boxes shall be installed with raised covers so that front face of raised cover is flush with the wall. Surface mounted wall or ceiling boxes shall be installed with surface style flat or raised covers.

**2.7 CABINETS**

- A. NEMA 250, Type 1, galvanized-steel box with removable interior panel and removable front, finished inside and out with manufacturer's standard enamel.
- B. Hinged door in front cover with flush latch and concealed hinge.
- C. Key latch to match panelboards.
- D. Metal barriers to separate wiring of different systems and voltage.
- E. Accessory feet where required for freestanding equipment.

**2.8 WIREWAYS**

- A. Equip with hinged covers, except where removable covers are shown.

**2.9 WARNING TAPE NOT USED.****2.10 HANDHOLES AND BOXES FOR EXTERIOR UNDERGROUND WIRING NOT USED.****2.11 SLEEVES FOR RACEWAYS**

- A. Steel Pipe Sleeves: ASTM A 53/A 53M, Type E, Grade B, Schedule 40, galvanized steel, plain ends.
- B. Cast-Iron Pipe Sleeves: Cast or fabricated "wall pipe," equivalent to ductile-iron pressure pipe, with plain ends and integral waterstop, unless otherwise indicated.
- C. Sleeves for Rectangular Openings: Galvanized sheet steel with minimum 0.052- or 0.138-inch (1.3- or 3.5-mm) thickness as indicated and of length to suit application.
- D. Coordinate sleeve selection and application with selection and application of firestopping specified in Division 07 84 00 "FIRESTOPPING."

**2.12 SLEEVE SEALS**

- A. Description: Modular sealing device, designed for field assembly, to fill annular space between sleeve and cable.
  - 1. Sealing Elements: EPDM interlocking links shaped to fit surface of cable or conduit. Include type and number required for material and size of raceway or cable.
  - 2. Pressure Plates: Plastic. Include two for each sealing element.
  - 3. Connecting Bolts and Nuts: Carbon steel with corrosion-resistant coating of length required to secure pressure plates to sealing elements. Include one for each sealing element.

**2.13 GROUT**

- A. Nonmetallic, Shrinkage-Resistant Grout: ASTM C 1107, factory-packaged, nonmetallic aggregate grout, noncorrosive, nonstaining, mixed with water to consistency suitable for application and a 30-minute working time.

WIRELINE DATA TRANSMISSION MEDIA FOR SECURITY SYSTEMS

## **PART 3 - EXECUTION**

### **3.1 PENETRATIONS**

#### **A. Cutting or Holes:**

1. Locate holes in advance where they are proposed in the structural sections such as ribs or beams. Obtain the approval of the Project Manager prior to drilling through structural sections.
2. Cut holes through concrete and masonry in new and existing structures with a diamond core drill or concrete saw. Pneumatic hammer, impact electric, hand or manual hammer type drills are not allowed, except where permitted by the Project Manager as required by limited working space.

#### **B. Fire Stop: Where conduits, wireways, and other electronic safety and security raceways pass through fire partitions, fire walls, smoke partitions, or floors, install a fire stop that provides an effective barrier against the spread of fire, smoke and gases as specified in Section 07 84 00, FIRESTOPPING, with rock wool fiber or silicone foam sealant only. Completely fill and seal clearances between raceways and openings with the fire stop material.**

#### **C. Waterproofing: At floor, exterior wall, and roof conduit penetrations, completely seal clearances around the conduit and make watertight as specified in Section 07 92 00, "JOINT SEALANTS".**

### **3.2 INSTALLATION, GENERAL**

#### **A. Install conduit as follows:**

1. In complete runs before pulling in cables or wires.
2. Flattened, dented, or deformed conduit is not permitted. Remove and replace the damaged conduits with new undamaged material.
3. Assure conduit installation does not encroach into the ceiling height head room, walkways, or doorways.
4. Cut square with a hacksaw, ream, remove burrs, and draw up tight.
5. Mechanically continuous.
6. Independently support conduit at 2.4 m (8 foot) on center. Do not use other supports i.e., (suspended ceilings, suspended ceiling supporting members, lighting fixtures, conduits, mechanical piping, or mechanical ducts).
7. Support within 300 mm (12 inches) of changes of direction, and within 300 mm (12 inches) of each enclosure to which connected.
8. Close ends of empty conduit with plugs or caps at the rough-in stage to prevent entry of debris, until wires are pulled in.
9. Conduit installations under fume and vent hoods are prohibited.
10. Secure conduits to cabinets, junction boxes, pull boxes and outlet boxes with bonding type locknuts. For rigid and IMC conduit

installations, provide a locknut on the inside of the enclosure, made up wrench tight. Do not make conduit connections to junction box covers.

11. Flashing of penetrations of the roof membrane is specified in Section 07 60 00, "FLASHING AND SHEET METAL".
12. Do not use aluminum conduits in wet locations.
13. Unless otherwise indicated on the drawings or specified herein, all conduits shall be installed concealed within finished walls, floors and ceilings.

B. Conduit Bends:

1. Make bends with standard conduit bending machines.
2. Conduit hickey may be used for slight offsets, and for straightening stubbed out conduits.
3. Bending of conduits with a pipe tee or vise is prohibited.

C. Layout and Homeruns:

1. Install conduit with wiring, including homeruns, as shown.
2. Deviations: Make only where necessary to avoid interferences and only after drawings showing the proposed deviations have been submitted approved by the Project Manager/COTR.

D. Fire Alarm:

1. Fire alarm conduit shall be painted red (a red "top-coated" conduit from the conduit manufacturer may be used in lieu of painted conduit) in accordance with the requirements of Section 28 31 00, "FIRE DETECTION AND ALARM".

### **3.3 CONCEALED WORK INSTALLATION**

A. In Concrete:

1. Conduit: Rigid steel, IMC or EMT. Do not install EMT in concrete slabs that are in contact with soil, gravel or vapor barriers.
2. Align and run conduit in direct lines.
3. Install conduit through concrete beams only when the following occurs:
  - a. Where shown on the structural drawings.
  - b. As approved by the Project Manager prior to construction, and after submittal of drawing showing location, size, and position of each penetration.
4. Installation of conduit in concrete that is less than 75 mm (3 inch) thick is prohibited.
  - a. Conduit outside diameter larger than 1/3 of the slab thickness is prohibited.
  - b. Space between conduits in slabs: Approximately six conduit diameters apart, except one conduit diameter at conduit crossings.

- c. Install conduits approximately in the center of the slab so that there will be a minimum of 19 mm (3/4 inch) of concrete around the conduits.
- 5. Make couplings and connections watertight. Use thread compounds that are UL approved conductive type to insure low resistance ground continuity through the conduits. Tightening set screws with pliers is prohibited.
- B. Furred or Suspended Ceilings and in Walls:
  - 1. Conduit for conductors above 600 volts:
    - a. Rigid steel or rigid aluminum.
    - b. Aluminum conduit mixed indiscriminately with other types in the same system is prohibited.
  - 2. Conduit for conductors 600 volts and below:
    - a. Rigid steel, IMC, rigid aluminum, or EMT. Different type conduits mixed indiscriminately in the same system is prohibited.
  - 3. Align and run conduit parallel or perpendicular to the building lines.
  - 4. Connect recessed lighting fixtures to conduit runs with maximum 1800 mm (6 feet) of flexible metal conduit extending from a junction box to the fixture.
  - 5. Tightening set screws with pliers is prohibited.

### **3.4 EXPOSED WORK INSTALLATION**

- A. Unless otherwise indicated on the drawings, exposed conduit is only permitted in mechanical and electrical rooms.
- B. Conduit for Conductors 600 volts and below:
  - 1. Rigid steel, IMC, rigid aluminum, or EMT. Different type of conduits mixed indiscriminately in the system is prohibited.
- C. Align and run conduit parallel or perpendicular to the building lines.
- D. Install horizontal runs close to the ceiling or beams and secure with conduit straps.
- E. Support horizontal or vertical runs at not over 2400 mm (eight foot) intervals.
- F. Surface metal raceways: Use only where shown.
- G. Painting:
  - 1. Paint exposed conduit as specified in Section 09 91 00, "PAINTING".
  - 2. Paint all conduits containing cables rated over 600 volts safety orange. Refer to Section 09 91 00, "PAINTING" for preparation, paint type, and exact color. In addition, paint legends, using 50 mm (two inch) high black numerals and letters, showing the cable voltage rating. Provide legends where conduits pass through walls and floors and at maximum 6000 mm (20 foot) intervals in between.

### 3.5 EXPANSION JOINTS

- A. Conduits 75 mm (3 inches) and larger, that are secured to the building structure on opposite sides of a building expansion joint, require expansion and deflection couplings. Install the couplings in accordance with the manufacturer's recommendations.
- B. Provide conduits smaller than 75 mm (3 inches) with junction boxes on both sides of the expansion joint. Connect conduits to junction boxes with sufficient slack of flexible conduit to produce 125 mm (5 inch) vertical drop midway between the ends. Flexible conduit shall have a copper green ground bonding jumper installed. In lieu of this flexible conduit, expansion and deflection couplings as specified above for 375 mm (15 inches) and larger conduits are acceptable.
- C. Install expansion and deflection couplings where shown.
- D. Not Used.

### 3.6 CONDUIT SUPPORTS, INSTALLATION

- A. Safe working load shall not exceed 1/4 of proof test load of fastening devices.
- B. Use pipe straps or individual conduit hangers for supporting individual conduits. Maximum distance between supports is 2.5 m (8 foot) on center.
- C. Support multiple conduit runs with trapeze hangers. Use trapeze hangers that are designed to support a load equal to or greater than the sum of the weights of the conduits, wires, hanger itself, and 90 kg (200 pounds). Attach each conduit with U-bolts or other approved fasteners.
- D. Support conduit independently of junction boxes, pull boxes, fixtures, suspended ceiling T-bars, angle supports, and similar items.
- E. Fasteners and Supports in Solid Masonry and Concrete:
  - 1. New Construction: Use steel or malleable iron concrete inserts set in place prior to placing the concrete.
  - 2. Existing Construction:
    - a. Steel expansion anchors not less than 6 mm (1/4 inch) bolt size and not less than 28 mm (1-1/8 inch) embedment.
    - b. Power set fasteners not less than 6 mm (1/4 inch) diameter with depth of penetration not less than 75 mm (3 inches).
    - c. Use vibration and shock resistant anchors and fasteners for attaching to concrete ceilings.
- F. Hollow Masonry: Toggle bolts are permitted.
- G. Bolts supported only by plaster or gypsum wallboard are not acceptable.
- H. Metal Structures: Use machine screw fasteners or other devices specifically designed and approved for the application.



- I. Attachment by wood plugs, rawl plug, plastic, lead or soft metal anchors, or wood blocking and bolts supported only by plaster is prohibited.
- J. Chain, wire, or perforated strap shall not be used to support or fasten conduit.
- K. Spring steel type supports or fasteners are prohibited for all uses except: Horizontal and vertical supports/fasteners within walls.
- L. Vertical Supports: Vertical conduit runs shall have riser clamps and supports in accordance with the NEC and as shown. Provide supports for cable and wire with fittings that include internal wedges and retaining collars.

### **3.7 BOX INSTALLATION**

- A. Boxes for Concealed Conduits:
  - 1. Flush mounted.
  - 2. Provide raised covers for boxes to suit the wall or ceiling, construction and finish.
- B. In addition to boxes shown, install additional boxes where needed to prevent damage to cables and wires during pulling in operations.
- C. Remove only knockouts as required and plug unused openings. Use threaded plugs for cast metal boxes and snap-in metal covers for sheet metal boxes.
- D. Outlet boxes in the same wall mounted back-to-back are prohibited. A minimum 600 mm (24 inch), center-to-center lateral spacing shall be maintained between boxes).
- E. Minimum size of outlet boxes for ground fault interrupter (GFI) receptacles is 100 mm (4 inches) square by 55 mm (2-1/8 inches) deep, with device covers for the wall material and thickness involved.
- F. Stencil or install phenolic nameplates on covers of the boxes identified on riser diagrams; for example "SIG-FA JB No. 1".
- G. On all Branch Circuit junction box covers, identify the circuits with black marker.

### **3.8 ELECTRONIC SAFETY AND SECURITY CONDUIT**

- A. Install the electronic safety and security raceway system as shown on drawings.
- B. Minimum conduit size of 19 mm (3/4 inch), but not less than the size shown on the drawings.
- C. All conduit ends shall be equipped with insulated bushings.
- D. All 100 mm (four inch) conduits within buildings shall include pull boxes after every two 90 degree bends. Size boxes per the NEC.

- E. Vertical conduits/sleeves through closets floors shall terminate not less than 75 mm (3 inches) below the floor and not less than 75 mm (3 inches) below the ceiling of the floor below.
- F. Terminate conduit runs to/from a backboard in a closet or interstitial space at the top or bottom of the backboard. Conduits shall enter communication closets next to the wall and be flush with the backboard.
- G. Where drilling is necessary for vertical conduits, locate holes so as not to affect structural sections such as ribs or beams.
- H. All empty conduits located in communications closets or on backboards shall be sealed with a standard non-hardening duct seal compound to prevent the entrance of moisture and gases and to meet fire resistance requirements.
- I. Conduit runs shall contain no more than four quarter turns (90 degree bends) between pull boxes/backboards. Minimum radius of communication conduit bends shall be as follows (special long radius):

Sizes of Conduit Trade Size	Radius of Conduit Bends mm, Inches
$\frac{3}{4}$	150 (6)
1	230 (9)
1-1/4	350 (14)
1-1/2	430 (17)
2	525 (21)
2-1/2	635 (25)
3	775 (31)
3-1/2	900 (36)
4	1125 (45)

- J. Furnish and install 19 mm (3/4 inch) thick fire retardant plywood specified in on the wall of communication closets where shown on drawings . Mount the plywood with the bottom edge 300 mm (one foot) above the finished floor.
- K. Furnish and pull wire in all empty conduits. (Sleeves through floor are exceptions).

- - - E N D - - -

**SECTION 28 13 00**  
**PHYSICAL ACCESS CONTROL SYSTEM**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section specifies the upgrading, finishing, installation, connection, testing and certification of an addition and expansion of the existing Lenel access control system. At the conclusion of this project, the contractor shall provide a complete and fully operating Physical Access Control System, hereinafter referred to as the PACS.
- B. This Section includes a Physical Access Control System consisting of Lenel system server operating system and application software upgrades, modification of existing, and addition of new, field-installed Lenel Controllers connected by a high-speed electronic data transmission network. The scope of this section shall also provide the following:
1. Physical Access Control:
    - a. Replacement of existing proximity card readers with combination card reader/key pad devices, where indicated on the documents.
    - b. New Lenel control panels where required to support modified and added card readers and door controls.
    - c. Modification of existing Lenel control panel were required to serve the modified and expanded access control system.
    - d. Power supplies as required
    - e. Control board upgrades to existing Lenel access control panels
    - f. New cabling where new devices are being installed. Existing card reader cabling is to be reused where applicable.
    - g. Removal of existing Lenel DVR's, monitor PC's, cabling, interconnections, etc. from the Police Office.
    - h. Programming of all Lenel equipment to reflect the removal of existing access control equipment and the provision of new access control equipment. This scope includes access control devices and door contacts with request to exit sensors.
    - i. Removal of the existing Bosch and Radionics burglar alarm systems and equipment and transfer of the alarmed points and control to the Lenel access control panels.
    - j. Replacement of existing ceiling mounted burglar alarm motion detectors with new motion detectors. Replacement includes new cabling, controls and all support equipment.

- k. Relocation of the existing Lenel access control server from the Police Department Armory to the Level 6 IRM Computer Room network rack.
- l. Software based communications interface system to allow communication between the existing VA Police radio system and the facility overhead paging system, Burglar alarm system, Lenel Code Green System and Fire Alarm system. Approved manufacturers are Amika Mobile, Inc and Status Solutions, Inc.

## **1.2 RELATED WORK**

- A. Section 01 00 00 - GENERAL REQUIREMENTS. For General Requirements.
- B. Section 07 84 00 - FIRESTOPPING. Requirements for firestopping application and use.
- C. Section 08 71 00 - DOOR HARDWARE. Requirements for door installation.
- D. Section 26 05 11 - REQUIREMENTS FOR ELECTRICAL INSTALLATIONS. Requirements for connection of high voltage.
- E. Section 26 05 19 - LOW VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES. Requirements for power cables.
- F. Section 26 05 33 - RACEWAYS AND BOXES FOR ELECTRICAL SYSTEMS. Requirements for infrastructure.
- G. Section 28 05 00 - COMMON WORK RESULTS FOR ELECTRONIC SAFETY AND SECURITY. For general requirements that are common to more than one section in Division 28.
- I. Section 28 05 13 - CONDUCTORS AND CABLES FOR ELECTRONIC SAFETY AND SECURITY. Requirements for conductors and cables.
- J. Section 28 05 26 - GROUNDING AND BONDING FOR ELECTRONIC SAFETY AND SECURITY. Requirements for grounding of equipment.
- K. Section 28 05 28.33 - CONDUITS AND BOXES FOR ELECTRONIC SAFETY AND SECURITY. Requirements for infrastructure.

## **1.3 QUALITY ASSURANCE**

- A. Refer to 28 05 00 COMMON WORK RESULTS FOR ELECTRONIC SAFETY AND SECURITY, Part 1
- B. The Contractor shall be responsible for providing, installing, and the operation of the PACS as shown. The Contractor shall also provide certification as required.
- C. The security system will be installed and tested to ensure all components are fully compatible as a system and can be integrated with all associated security subsystems, whether the security system is

stand-alone or a part of a complete Information Technology (IT) computer network.

D. Manufacturers Qualifications: The manufacturer shall regularly and presently produce, as one of the manufacturer's principal products, the equipment and material specified for this project, and shall have manufactured the item for at least three years.

E. Product Qualifications:

1. Manufacturer's product shall have been in satisfactory operation, on three installations of similar size and type as this project, for approximately three years.
2. The Government reserves the right to require the Contractor to submit a list of installations where the products have been in operation before approval.

F. Contractor Qualifications:

1. The Contractor or security sub-contractor shall be a licensed security Contractor with a minimum of five (5) years experience installing and servicing systems of similar scope and complexity. The Contractor shall be an authorized regional representative of the Security Management System's (PACS) manufacturer. The Contractor shall provide four (4) current references from clients with systems of similar scope and complexity which became operational in the past three (3) years. At least three (3) of the references shall be utilizing the same system components, in a similar configuration as the proposed system. The references must include a current point of contact, company or agency name, address, telephone number, complete system description, date of completion, and approximate cost of the project. The owner reserves the option to visit the reference sites, with the siteowner's permission and representative, to verify the quality of installation and the references' level of satisfaction with the system. The Contractor shall provide copies of system manufacturer certification for all technicians. The Contractor shall only utilize factory-trained technicians to install, program, and service the PACS. The Contractor shall only utilize factory-trained technicians to install, terminate and service controller/field panels and reader modules. The technicians shall have a minimum of five (5) continuous years of technical experience in electronic security systems. The Contractor shall have a local service facility. The facility shall be located within

60 miles of the project site. The local facility shall include sufficient spare parts inventory to support the service requirements associated with this contract. The facility shall also include appropriate diagnostic equipment to perform diagnostic procedures. The Project Manager reserves the option of surveying the company's facility to verify the service inventory and presence of a local service organization.

- a. The Contractor shall provide proof project superintendent with BICSI Certified Commercial Installer Level 1, Level 2, or Technician to provide oversight of the project.
- b. Cable installer must have on staff a Registered Communication Distribution Designer (RCDD) certified by Building Industry Consulting Service International. The staff member shall provide consistent oversight of the project cabling throughout design, layout, installation, termination and testing.

G. Service Qualifications: There shall be a permanent service organization maintained or trained by the manufacturer which will render satisfactory service to this installation within four hours of receipt of notification that service is needed. Submit name and address of service organizations.

#### **1.4 SUBMITTALS**

- A. Refer to 28 05 00 COMMON WORK RESULTS FOR ELECTRONIC SAFETY AND SECURITY, Part 1
- B. Submit below items in conjunction with Master Specification Sections 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES, Section 02 41 00, DEMOLITION, and Section 28 05 00 COMMON WORK RESULTS FOR ELECTRONIC SAFETY AND SECURITY.
- C. Provide certificates of compliance with Section 1.3, Quality Assurance.
- D. Provide a complete and thorough pre-installation and as-built design package in both electronic format and on paper, minimum size 48 x 48 inches (1220 x 1220 millimeters); drawing submittals shall be per the established project schedule.
- E. Shop drawing and as-built packages shall include, but not be limited to:
  - 1. Index Sheet that shall:
    - a. Define each page of the design package to include facility name, building name, floor, and sheet number.

- b. Provide a complete list of all security abbreviations and symbols.
  - c. Reference all general notes that are utilized within the design package.
  - d. Specification and scope of work pages for all individual security systems that are applicable to the design package that will:
    - 1) Outline all general and job specific work required within the design package.
    - 2) Provide a detailed device identification table outlining device Identification (ID) and use for all security systems equipment utilized in the design package.
2. Drawing sheets that will be plotted on the individual floor plans or site plans shall:
- a. Include a title block as defined above.
  - b. Clearly define the drawings scale in both standard and metric measurements.
  - c. Provide device identification and location.
  - d. Address all signal and power conduit runs and sizes that are associated with the design of the electronic security system and other security elements (e.g., barriers, etc.).
  - e. Identify all pull box and conduit locations, sizes, and fill capacities.
  - f. Address all general and drawing specific notes for a drawing sheet.
3. A detailed riser drawing for each applicable security subsystem shall:
- a. Indicate the sequence of operation.
  - b. Relationship of integrated components on one diagram.
  - c. Include the number, size, identification, and maximum lengths of interconnecting wires.
  - d. Wire/cable types shall be defined by a wire and cable schedule. The schedule shall utilize a lettering system that will correspond to the wire/cable it represents (example: A = 18 AWG/1 Pair Twisted, Unshielded). This schedule shall also provide the manufacturer's name and part number for the wire/cable being installed.
4. A detailed system drawing for each applicable security system shall:

- a. Clearly identify how all equipment within the system, from main panel to device, shall be laid out and connected.
  - b. Provide full detail of all system components wiring from point-to-point.
  - c. Identify wire types utilized for connection, interconnection with associate security subsystems.
  - d. Show device locations that correspond to the floor plans.
  - e. All general and drawing specific notes shall be included with the system drawings.
5. A detailed schedule for all applicable security subsystems shall be included. All schedules shall provide the following information:
- a. Device ID.
  - b. Device Location (e.g. site, building, floor, room number, location, and description).
  - c. Mounting type (e.g. flush, wall, surface, etc.).
  - d. Power supply or circuit breaker and power panel number.
  - e. In addition, for the PACS, provide the door ID, door type (e.g. wood or metal), locking mechanism (e.g. strike or electromagnetic lock) and control device (e.g. card reader or biometrics).
6. Detail and elevation drawings for all devices that define how they were installed and mounted.
- F. Provide manufacturer security system product cut-sheets. Submit for approval at least 30 days prior to commencement of formal testing, a Security System Operational Test Plan. Include procedures for operational testing of each component and security subsystem, to include performance of an integrated system test.
- G. Submit manufacture's certification of Underwriters Laboratories, Inc. (UL) listing as specified. Provide all maintenance and operating manuals per Section 01 00 00, GENERAL REQUIREMENTS, and Section 28 05 00 COMMON WORK RESULTS FOR ELECTRONIC SAFETY AND SECURITY.
- H. General: Submittals shall be in full compliance of the Contract Documents. All submittals shall be provided in accordance with this section. Submittals lacking the breath or depth these requirements will be considered incomplete and rejected. Submissions are considered multidisciplinary and shall require coordination with applicable divisions to provide a complete and comprehensive submission package. Additional general provisions are as follows:



1. The Contractor shall schedule submittals to maintain the project schedule. For coordination drawings refer to Specification Section 01 33 10 - DESIGN SUBMITTAL PROCEDURES, which outline basic submittal requirements and coordination. Section 01 33 10 shall be used in conjunction with this section.
2. The Contractor shall identify variations from requirements of Contract Documents and state product and system limitations, which may be detrimental to successful performance of the completed work or system.
3. Each package shall be submitted at one (1) time for each review and include components from applicable disciplines (e.g., electrical work, architectural finishes, door hardware, etc.) which are required to produce an accurate and detailed depiction of the project.
4. Manufacturer's information used for submittal shall have pages with items for approval tagged, items on pages shall be identified, and capacities and performance parameters for review shall be clearly marked through use of an arrow or highlighting. Provide space for Project Manager and Contractor review stamps.
5. Technical Data Drawings shall be in the latest version of AutoCAD®, drawn accurately, and in accordance with VA CAD Standards. FREEHAND SKETCHES OR COPIED VERSIONS OF THE CONSTRUCTION DOCUMENTS WILL NOT BE ACCEPTED. The Contractor shall not reproduce Contract Documents or copy standard information as the basis of the Technical Data Drawings. If departures from the technical data drawings are subsequently deemed necessary by the Contractor, details of such departures and the reasons thereof shall be submitted in writing to the VA Project Manager for approval before the initiation of work.
6. Packaging: The Contractor shall organize the submissions according to the following packaging requirements.
  - a. Binders: For each manual, provide heavy duty, commercial quality, durable three (3) ring vinyl covered loose leaf binders, sized to receive 8.5 x 11 in paper, and appropriate capacity to accommodate the contents. Provide a clear plastic sleeve on the spine to hold labels describing the contents. Provide pockets in the covers to receive folded sheets.
    - 1) Where two (2) or more binders are necessary to accommodate data, correlate data in each binder into related groupings

- according to the Project Manual table of contents. Cross-referencing other binders where necessary to provide essential information for communication of proper operation and or maintenance of the component or system.
- 2) Identify each binder on the front and spine with printed binder title, Project title or name, and subject matter covered. Indicate the volume number if applicable.
- b. Dividers: Provide heavy paper dividers with celluloid tabs for each Section. Mark each tab to indicate contents.
  - c. Protective Plastic Jackets: Provide protective transparent plastic jackets designed to enclose diagnostic software for computerized electronic equipment.
  - d. Text Material: Where written material is required as part of the manual use the manufacturer's standard printed material, or if not available, specially prepared data, neatly typewritten on 8.5 inches by 11 inches 20-pound white bond paper.
  - e. Drawings: Where drawings and/or diagrams are required as part of the manual, provide reinforced punched binder tabs on the drawings and bind them with the text.
    - 1) Where oversized drawings are necessary, fold the drawings to the same size as the text pages and use as a foldout.
    - 2) If drawings are too large to be used practically as a foldout, place the drawing, neatly folded, in the front or rear pocket of the binder. Insert a type written page indicating the drawing title, description of contents and drawing location at the appropriate location of the manual.
    - 3) Drawings shall be sized to ensure details and text is of legible size. Text shall be no less than 1/16" tall.
  - f. Manual Content: In each manual include information specified in the individual Specification section, and the following information for each major component of building equipment and controls:
    - 1) General system or equipment description.
    - 2) Design factors and assumptions.
    - 3) Copies of applicable Shop Drawings and Product Data.
    - 4) System or equipment identification including: manufacturer, model and serial numbers of each component, operating instructions, emergency instructions, wiring diagrams,

- inspection and test procedures, maintenance procedures and schedules, precautions against improper use and maintenance, repair instructions, sources of required maintenance materials and related services, and a manual index.
- g. Binder Organization: Organize each manual into separate sections for each piece of related equipment. At a minimum, each manual shall contain a title page, table of contents, copies of Product Data supplemented by drawings and written text, and copies of each warranty, bond, certifications, and service Contract issued. Refer to Group I through V Technical Data Package Submittal requirements for required section content.
  - h. Title Page: Provide a title page as the first sheet of each manual to include the following information; project name and address, subject matter covered by the manual, name and address of the Project, date of the submittal, name, address, and telephone number of the Contractor, and cross references to related systems in other operating and/or maintenance manuals.
  - i. Table of Contents: After the title page, include a type written table of contents for each volume, arranged systematically according to the Project Manual format. Provide a list of each product included, identified by product name or other appropriate identifying symbols and indexed to the content of the volume. Where more than one (1) volume is required to hold data for a particular system, provide a comprehensive table of contents for all volumes in each volume of the set.
  - j. General Information Section: Provide a general information section immediately following the table of contents, listing each product included in the manual, identified by product name. Under each product, list the name, address, and telephone number of the installer and maintenance Contractor. In addition, list a local source for replacement parts and equipment.
  - k. Drawings: Provide specially prepared drawings where necessary to supplement the manufacturers printed data to illustrate the relationship between components of equipment or systems, or provide control or flow diagrams. Coordinate these drawings with information contained in Project Record Drawings to assure correct illustration of the completed installation.

1. Manufacturer's Data: Where manufacturer's standard printed data is included in the manuals, include only those sheets that are pertinent to the part or product installed. Mark each sheet to identify each part or product included in the installation. Where more than one (1) item in tabular format is included, identify each item, using appropriate references from the Contract Documents. Identify data that is applicable to the installation and delete references to information which is not applicable.
- m. Where manufacturer's standard printed data is not available and the information is necessary for proper operation and maintenance of equipment or systems, or it is necessary to provide additional information to supplement the data included in the manual, prepare written text to provide the necessary information. Organize the text in a consistent format under a separate heading for different procedures. Where necessary, provide a logical sequence of instruction for each operating or maintenance procedure. Where similar or more than one product is listed on the submittal the Contractor shall differentiate by highlighting the specific product to be utilized.
- n. Calculations: Provide a section for circuit and panel calculations.
- o. Loading Sheets: Provide a section for DGP Loading Sheets.
- p. Certifications: Provide section for Contractor's manufacturer certifications.
7. Contractor Review: Review submittals prior to transmittal. Determine and verify field measurements and field construction criteria. Verify manufacturer's catalog numbers and conformance of submittal with requirements of contract documents. Return non-conforming or incomplete submittals with requirements of the work and contract documents. Apply Contractor's stamp with signature certifying the review and verification of products occurred, and the field dimensions, adjacent construction, and coordination of information is in accordance with the requirements of the contract documents.
8. Resubmission: Revise and resubmit submittals as required within 15 calendar days of return of submittal. Make resubmissions under

- procedures specified for initial submittals. Identify all changes made since previous submittal.
9. Product Data: Within 15 calendar days after execution of the contract, the Contractor shall submit for approval a complete list of all major products proposed for use. The data shall include name of manufacturer, trade name, model number, the associated contract document section number, paragraph number, and the referenced standards for each listed product.
  - I. Group 1 Technical Data Package: Group I Technical Data Package shall be one submittal consisting of the following content and organization. Refer to VA Special Conditions Document for drawing format and content requirements. The data package shall include the following:
    1. Section I - Drawings:
      - a. General - Drawings shall conform to VA Special Conditions and CAD Standards Documents. All text associated with security details shall be 1/8" tall and meet VA text standard for AutoCAD™ drawings.
      - b. Cover Sheet - Cover sheet shall consist of Project Title and Address, Project Number, Area and Vicinity Maps.
      - c. General Information Sheets - General Information Sheets shall consist of General Notes, Abbreviations, Symbols, Wire and Cable Schedule, Project Phasing, and Sheet Index.
      - d. Floor Plans - Floor plans shall be produced from the Architectural backgrounds issued in the Construction Documents. The contractor shall receive floor plans from the prime A/E to develop these drawing sets. Security devices shall be placed on drawings in scale. All text associated with security details shall be 1/8" tall and meet VA text standard for AutoCAD™ drawings. Floor plans shall identify the following:
        - 1) security devices by symbol,
        - 2) the associated device point number (derived from the loading sheets),
        - 3) wire & cable types and counts
        - 4) conduit sizing and routing
        - 5) conduit riser systems
        - 6) device and area detail call outs
      - e. Architectural details - Architectural details shall be produced for each device mounting type (door details for doors with

physical access control, reader pedestals and mounts, security panel and power supply details).

- f. Riser Diagrams - Contractor shall provide a riser diagram indicating riser architecture and distribution of the physical access control system throughout the facility (or area in scope).
- g. Block Diagrams - Contractor shall provide a block diagram for the entire system architecture and interconnections with SMS subsystems. Block diagram shall identify SMS subsystem (e.g., physical access control, intrusion detection, closed circuit television, intercom, and other associated subsystems) integration; and data transmission and media conversion methodologies.
- h. Interconnection Diagrams - Contractor shall provide interconnection diagram for each sensor, and device component. Interconnection diagram shall identify termination locations, standard wire detail to include termination schedule. Diagram shall also identify interfaces to other systems such as elevator control, fire alarm systems, and security management systems.
- i. Security Details:
  - 1) Panel Assembly Detail - For each panel assembly, a panel assembly details shall be provided identifying individual panel component size and content.
  - 2) Panel Details - Provide security panel details identify general arrangement of the security system components, backboard size, wire through size and location, and power circuit requirements.
  - 3) Device Mounting Details - Provide mounting detailed drawing for each security device (physical access control system, intrusion detection, video surveillance and assessment, and intercom systems) for each type of wall and ceiling configuration in project. Device details shall include device, mounting detail, wiring and conduit routing.
  - 4) Details of connections to power supplies and grounding
  - 5) Details of surge protection device installation
  - 6) Sensor detection patterns - Each system sensor shall have associated detection patterns.
  - 7) Equipment Rack Detail - For each equipment rack, provide a scaled detail of the equipment rack location and rack space

utilization. Use of BISCII wire management standards shall be employed to identify wire management methodology. Transitions between equipment racks shall be shown to include use vertical and horizontal latter rack system.

- j. Door Schedule - A door schedule shall be developed for each door equipped with electronic security components. At a minimum, the door schedule shall be coordinated with Division 08 work and include the following information:

- 1) Item Number
- 2) Door Number (Derived from A/E Drawings)
- 3) Floor Plan Sheet Number
- 4) Standard Detail Number
- 5) Door Description (Derived from Loading Sheets)
- 6) Data Gathering Panel Input Number
- 7) Door Position or Monitoring Device Type & Model Number
- 8) Lock Type, Model Number & Power Input/Draw (standby/active)
- 9) Card Reader Type & Model Number
- 10) Shunting Device Type & Model Number
- 11) Sounder Type & Model Number
- 12) Manufacturer
- 13) Misc. devices as required
  - a) Delayed Egress Type & Model Number
  - b) Camera
  - c) Electric Transfer Hinge
- 14) Remarks column indicating special notes or door configurations

## 2. Section II - Data Gathering Panel (Lenel Control Panel)

### Documentation Package

- a. Contractor shall provide Data Gathering Panel (DGP) input and output documentation packages for review at the Shop Drawing submittal stage and with the as-built documentation package. The documentation packages shall be provided in both printed and magnetic form at both review stages.
- b. The Contractor shall provide loading sheet documentation package for the associated DGP, including input and output boards for all field panels associated with the project. Documentation shall be provided in current version Microsoft Excel spreadsheets following the format currently utilized by VA. A separate

- spreadsheet file shall be generated for each DGP and associated field panels.
- c. The spreadsheet names shall follow a sequence that shall display the spreadsheets in numerical order according to the DGP system number. The spreadsheet shall include the prefix in the file name that uniquely identifies the project site. The spreadsheet shall detail all connected items such as card readers, alarm inputs, and relay output connections. The spreadsheet shall include an individual section (row) for each panel input, output and card reader. The spreadsheet shall automatically calculate the system numbers for card readers, inputs, and outputs based upon data entered in initialization fields.
  - d. All entries must be verified against the field devices. Copies of the floor plans shall be forwarded under separate cover.
  - e. The DGP spreadsheet shall include an entry section for the following information:
    - 1) DGP number
    - 2) First Reader Number
    - 3) First Monitor Point Number
    - 4) First Relay Number
    - 5) DGP, input or output Location
    - 6) DGP Chain Number
    - 7) DGP Cabinet Tamper Input Number
    - 8) DGP Power Fail Input Number
    - 9) Number of Monitor Points Reserved for Expansion Boards
    - 10) Number of Control Points (Relays) Reserved for Expansion Boards
  - f. The DGP, input module and output module spreadsheets shall automatically calculate the following information based upon the associated entries in the above fields:
    - 1) System Numbers for Card Readers
    - 2) System Numbers for Monitor Point Inputs
    - 3) System Numbers for Control Points (Relays)
    - 4) Next DGP or input module First Monitor Point Number
    - 5) Next DGP or output module First Control Point Number
  - g. The DGP spreadsheet shall provide the following information for each card reader:
    - 1) DGP Reader Number



- 2) System Reader Number
  - 3) Cable ID Number
  - 4) Description Field (Room Number)
  - 5) Description Field (Device Type i.e.: In Reader, Out Reader, etc.)
  - 6) Description Field
  - 7) DGP Input Location
  - 8) Date Test
  - 9) Date Passed
  - 10) Cable Type
  - 11) Camera Numbers (of cameras viewing the reader location)
- h. The DGP and input module spreadsheet shall provide the following information for each monitor point (alarm input).
- 1) DGP Monitor Point Input Number
  - 2) System Monitor Point Number
  - 3) Cable ID Number
  - 4) Description Field (Room Number)
  - 5) Description Field (Device Type i.e.: Door Contact, Motion Detector, etc.)
  - 6) DGP or input module Input Location
  - 7) Date Test
  - 8) Date Passed
  - 9) Cable Type
- i. The DGP and output module spreadsheet shall provide the following information for each control point (output relay).
- 1) DGP Control Point (Relay) Number
  - 2) System (Control Point) Number
  - 3) Cable ID Number
  - 4) Description Field (Room Number)
  - 5) Description Field (Device: Lock Control, Local Sounder, etc.)
  - 6) Description Field
  - 7) DGP or OUTPUT MODULE Output Location
  - 8) Date Test
  - 9) Date Passed Cable Type
  - 10) Camera Number (of associated alarm event preset call-ups)
- j. The DGP, input module and output module spreadsheet shall include the following information or directions in the header and footer:
- 1) Header

- a) DGP Input and Output Worksheet
- b) Enter Beginning Reader, Input, and Output Starting Numbers and Sheet Will Automatically Calculate the Remaining System Numbers.
- 2) Footer
  - a) File Name
  - b) Date Printed
  - c) Page Number
- 4. Section IV - Manufacturers' Data: The data package shall include manufacturers' data for all materials and equipment, including sensors, reader, control panels, etc.
- 5. Section V- Complete product description, operation, interface and documentation for the software based communications interface system provided allow communication between the existing VA Police radio system and the various VA Special Systems described in Section 1.1.

#### 1.5 APPLICABLE PUBLICATIONS

- A. Refer to 28 05 00 COMMON WORK RESULTS FOR ELECTRONIC SAFETY AND SECURITY, Part 1
- B. The publications listed below (including amendments, addenda, revisions, supplement, and errata) form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- C. American National Standards Institute (ANSI)/ Security Industry Association (SIA):
  - AC-03.....Access Control: Access Control Guideline Dye Sublimation Printing Practices for PVC Access Control Cards
  - TVAC-01.....CCTV to Access Control Standard - Message Set for System Integration
- D. American National Standards Institute (ANSI)/ International Code Council (ICC):
  - A117.1.....Standard on Accessible and Usable Buildings and Facilities
- E. Department of Justice American Disability Act (ADA)
  - 28 CFR Part 36.....ADA Standards for Accessible Design 2010
- F. Department of Veterans Affairs (VA):
  - PACS-R: Physical Access Control System (PACS) Requirements
  - VA Handbook 0730 Security and Law Enforcement

- G. Government Accountability Office (GAO):
  - GAO-03-8-02 Security Responsibilities for Federally Owned and Leased Facilities
- H. National Electrical Contractors Association
  - 303-2005.....Installing Closed Circuit Television (CCTV) Systems
- I. National Electrical Manufacturers Association (NEMA):
  - 250-08.....Enclosures for Electrical Equipment (1000 Volts Maximum)
- J. National Fire Protection Association (NFPA):
  - 70-11..... National Electrical Code
- K. Underwriters Laboratories, Inc. (UL):
  - 294-99.....The Standard of Safety for Access Control System Units
  - 305-08.....Standard for Panic Hardware
  - 639-97.....Standard for Intrusion-Detection Units
  - 752-05.....Standard for Bullet-Resisting Equipment
  - 827-08.....Central Station Alarm Services
  - 1076-95.....Standards for Proprietary Burglar Alarm Units and Systems
  - 1981-03.....Central Station Automation System
  - 2058-05.....High Security Electronic Locks
- L. Homeland Security Presidential Directive (HSPD):
  - HSPD-12.....Policy for a Common Identification Standard for Federal Employees and Contractors
- M. Federal Communications Commission (FCC):
  - (47 CFR 15) Part 15 Limitations on the Use of Wireless Equipment/Systems
- N. Federal Information Processing Standards (FIPS):
  - FIPS-201-1.....Personal Identity Verification (PIV) of Federal Employees and Contractors
- O. National Institute of Standards and Technology (NIST):
  - IR 6887 V2.1.....Government Smart Card Interoperability Specification (GSC-IS)
  - Special Pub 800-63.....Electronic Authentication Guideline
  - Special Pub 800-96.....PIV Card Reader Interoperability Guidelines
  - Special Pub 800-73-3....Interfaces for Personal Identity Verification (4 Parts)

- .....Pt. 1- End Point PIV Card Application  
Namespace, Data Model & Representation
- .....Pt. 2- PIV Card Application Card Command  
Interface
- .....Pt. 3- PIV Client Application Programming  
Interface
- .....Pt. 4- The PIV Transitional Interfaces & Data  
Model Specification
- Special Pub 800-76-1....Biometric Data Specification for Personal  
Identity Verification
- Special Pub 800-78-2....Cryptographic Algorithms and Key Sizes for  
Personal Identity Verification
- Special Pub 800-79-1....Guidelines for the Accreditation of Personal  
Identity Verification Card Issuers
- Special Pub 800-85B-1...DRAFTPIV Data Model Test Guidelines
- Special Pub 800-85A-2...PIV Card Application and Middleware Interface  
Test Guidelines (SP 800-73-3 compliance)
- Special Pub 800-96.....PIV Card Reader Interoperability Guidelines
- Special Pub 800-37.....Guide for Applying the Risk Management  
Framework to Federal Information Systems
- Special Pub 800-96.....PIV Card Reader Interoperability Guidelines
- Special Pub 800-96.....PIV Card Reader Interoperability Guidelines
- Special Pub 800-104A....Scheme for PIV Visual Card Topography
- Special Pub 800-116.....Recommendation for the Use of PIV Credentials  
in Physical Access Control Systems (PACS)
- P. Institute of Electrical and Electronics Engineers (IEEE):  
C62.41.....IEEE Recommended Practice on Surge Voltages in  
Low-Voltage AC Power Circuits
- Q. International Organization for Standardization (ISO):  
7810.....Identification cards - Physical characteristics
- 7811.....Physical Characteristics for Magnetic Stripe  
Cards
- 7816-1.....Identification cards - Integrated circuit(s)  
cards with contacts - Part 1: Physical  
characteristics
- 7816-2.....Identification cards - Integrated circuit cards  
- Part 2: Cards with contacts -Dimensions and  
location of the contacts



- F. Assurance Level (or E-Authentication Assurance Level): A measure of trust or confidence in an authentication mechanism defined in OMB Memorandum M-04-04 and NIST Special Publication (SP) 800-63, in terms of four levels:
1. Level 1: LITTLE OR NO confidence
  2. Level 2: SOME confidence
  3. Level 3: HIGH confidence
  4. Level 4: VERY HIGH confidence
- G. Authentication: A process that establishes the origin of information, or determines an entity's identity. In this publication, authentication often means the performance of a PIV authentication mechanism.
- H. Authenticator: A memory, possession, or quality of a person that can serve as proof of identity, when presented to a verifier of the appropriate kind. For example, passwords, cryptographic keys, and fingerprints are authenticators.
- I. Authorization: A process that associates permission to access a resource or asset with a person and the person's identifier(s).
- J. BIO or BIO-A: A FIPS 201 authentication mechanism that is implemented by using a Fingerprint data object sent from the PIV Card to the PACS. Note that the short-hand "BIO (-A)" is used throughout the document to represent both BIO and BIO-A authentication mechanisms.
- K. Biometric: An authenticator produced from measurable qualities of a living person.
- L. CAC EP - CAC End Point with end point PIV applet
- M. CAC NG - CAC Next Generation with transitional PIV applet
- N. Card Authentication Key (CAK): A PIV authentication mechanism (or the PIV Card key of the same name) that is implemented by an asymmetric or symmetric key challenge/response protocol. The CAK is an optional mechanism defined in NIST SP 800-73. NIST strongly recommends that every PIV Card contain an asymmetric CAK and corresponding certificate, and that agencies use the asymmetric CAK protocol, rather than a symmetric CAK protocol, whenever the CAK authentication mechanism is used with PACS.
- O. CCTV: Closed-circuit television.
- P. Central Station: A PC with software designated as the main controlling PC of the PACS. Where this term is presented with initial capital letters, this definition applies.

- Q. Controller: An intelligent peripheral control unit that uses a computer for controlling its operation. Where this term is presented with an initial capital letter, this definition applies.
- R. CPU: Central processing unit.
- S. Credential: Data assigned to an entity and used to identify that entity.
- T. File Server: A PC in a network that stores the programs and data files shared by users.
- U. FIPS Federal Information Processing Standards
- V. FRAC - First Responder Authentication Credential
- W. HSPD Homeland Security Presidential Directive
- X. I/O: Input/Output.
- Y. Identifier: A credential card, keypad personal identification number or code, biometric characteristic, or other unique identification entered as data into the entry-control database for the purpose of identifying an individual. Where this term is presented with an initial capital letter, this definition applies.
- Z. IEC International Electrotechnical Commission
- AA. ISO International Organization for Standardization
- BB. KB Kilobyte
- CC. kbit/s Kilobits / second
- DD. LAN: Local area network.
- EE. LED: Light-emitting diode.
- FF. Legacy CAC - Contact only Common Access Card with v1 and v2 applets
- GG. Location: A Location on the network having a PC-to-Controller communications link, with additional Controllers at the Location connected to the PC-to-Controller link with RS-485 communications loop. Where this term is presented with an initial capital letter, this definition applies.
- HH. NIST: National Institute of Standards and Technology
- II. PACS: Physical Access Control System
- JJ. PC/SC: Personal Computer / Smart Card
- KK. PC: Personal computer. This acronym applies to the Central Station, workstations, and file servers.
- LL. PCI Bus: Peripheral component interconnect; a peripheral bus providing a high-speed data path between the CPU and peripheral devices (such as monitor, disk drive, or network).

MM. PDF: (Portable Document Format.) The file format used by the Acrobat document exchange system software from Adobe.

NN. PIV: Personal Identification Verification

OO. PIV-I - PIV Interoperable credential

PP. PPS: Protocol and Parameters Selection

QQ. RF: Radio frequency.

RR. ROM: Read-only memory. ROM data are maintained through losses of power.

SS. RS-232: An TIA/EIA standard for asynchronous serial data communications between terminal devices. This standard defines a 25-pin connector and certain signal characteristics for interfacing computer equipment.

TT. RS-485: An TIA/EIA standard for multipoint communications.

UU. TCP/IP: Transport control protocol/Internet protocol incorporated into Microsoft Windows.

VV. TPDU: Transport Protocol Data Unit

WW. TWIC - Transportation Worker Identification Credential

XX. UPS: Uninterruptible power supply.

YY. Vcc: Voltage at the Common Collector

ZZ. WAN: Wide area network.

AAA. WAV: The digital audio format used in Microsoft Windows.

BBB. Wiegand: Patented magnetic principle that uses specially treated wires embedded in the credential card.

CCC. Windows: Operating system by Microsoft Corporation.

DDD. Workstation: A PC with software that is configured for specific limited security system functions.

## 1.7 COORDINATION

- A. Refer to 28 05 00 COMMON WORK RESULTS FOR ELECTRONIC SAFETY AND SECURITY, Part 1
- B. Coordinate arrangement, mounting, and support of electronic safety and security equipment:
  1. To allow maximum possible headroom unless specific mounting heights that reduce headroom are indicated.
  2. To provide for ease of disconnecting the equipment with minimum interference to other installations.
  3. To allow right of way for piping and conduit installed at required slope.



4. All connecting raceways, cables, wireways, cable trays, and busways shall be clear of obstructions and clear of the working and access space of other equipment.
- C. Coordinate installation of required supporting devices and set sleeves in cast-in-place concrete, masonry walls, and other structural components as they are constructed.
- D. Coordinate location of access panels and doors for electronic safety and security items that are behind finished surfaces or otherwise concealed.

#### **1.8 MAINTENANCE & SERVICE**

- A. Refer to 28 05 00 COMMON WORK RESULTS FOR ELECTRONIC SAFETY AND SECURITY, Part 1
- B. General Requirements
  1. The Contractor shall provide all services required and equipment necessary to maintain the entire integrated electronic security system in an operational state as specified for a period of one (1) year after formal written acceptance of the system. The Contractor shall provide all necessary material required for performing scheduled adjustments or other non-scheduled work. Impacts on facility operations shall be minimized when performing scheduled adjustments or other non-scheduled work. See also General Project Requirements.
- C. Description of Work
  1. Expansion, modification, programming of the existing Lenel access control system and Bosch burglar alarm system to provide a fully integrated and operational access control and burglar alarm system. The existing Bosch burglar alarm system, keypads, etc. shall be removed and the intrusion detection functions of these areas shall be transferred to the Lenel Access Control System. In addition, a software based communications interface system shall be provided to allow communication between the existing VA Police radio system and the various VA Special Systems described in Section 1.1.
- D. Personnel
  1. Service personnel shall be certified in the maintenance and repair of the selected type of equipment and qualified to accomplish all work promptly and satisfactorily. The Project Manager shall be advised in writing of the name of the designated service representative, and of any change in personnel. The Project Manager

shall be provided copies of system manufacturer certification for the designated service representative.

#### E. Schedule of Work

1. The work shall be performed during regular working ours, Monday through Friday, excluding federal holidays. These inspections shall include:
  - a) The Contractor shall perform two (2) minor inspections at six (6) month intervals or more if required by the manufacturer, and two (2) major inspections offset equally between the minor inspections to effect quarterly inspection of alternating magnitude.
    - 1) Minor Inspections shall include visual checks and operational tests of all console equipment, peripheral equipment, local processors, sensors, electrical and mechanical controls, and adjustments on printers.
    - 2) Major Inspections shall include all work described for Minor Inspections and the following: clean all system equipment and local processors including interior and exterior surfaces; perform diagnostics on all equipment; operational tests of the CPU, switcher, peripheral equipment, recording devices, monitors, picture quality from each camera; check, walk test, and calibrate each sensor; run all system software diagnostics and correct all problems; and resolve any previous outstanding problems.

#### F. Emergency Service

1. The owner shall initiate service calls whenever the system is not functioning properly. The Contractor shall provide the Owner with an emergency servicecenter telephone number. The emergency service center shall be staffed 24 hours a day 365 days a year. The Owner shall have sole authority for determining catastrophic and non-catastrophic system failures within parameters stated in General Project Requirements.
  - a. For catastrophic system failures, the Contractor shall provide same day four (4) hour service response with a defect correction time not to exceed eight (8) hours from notification. Catastrophic system failures are defined as any system failure that the Owner determines will place the facility(s) at increased risk.

- b. For non-catastrophic failures, the Contractor within eight (8) hours with a defect correction time not to exceed 24 hours from notification.

#### G. Operation

1. Performance of scheduled adjustments and repair shall verify operation of the system as demonstrated by the applicable portions of the performance verification test.

#### H. Records & Logs

1. The Contractor shall maintain records and logs of each task and organize cumulative records for each component and for the complete system chronologically. A continuous log shall be submitted for all devices. The log shall contain all initial settings, calibration, repair, and programming data. Complete logs shall be maintained and available for inspection on site, demonstrating planned and systematic adjustments and repairs have been accomplished for the system.

#### I. Work Request

1. The Contractor shall separately record each service call request, as received. The record shall include the serial number identifying the component involved, its location, date and time the call was received, specific nature of trouble, names of service personnel assigned to the task, instructions describing the action taken, the amount and nature of the materials used, and the date and time of commencement and completion. The Contractor shall deliver a record of the work performed within five (5) working days after the work was completed.

#### J. System Modifications

1. The Contractor shall make any recommendations for system modification in writing to the COTR. No system modifications, including operating parameters and control settings, shall be made without prior written approval from the COTR. Any modifications made to the system shall be incorporated into the operation and maintenance manuals and other documentation affected.

#### K. Software

1. The Contractor shall provide all software updates to the Lenel access control system to bring the system up to currency. In addition, the contractor shall also provide software updates, when approved by the Owner, during the 12-month warranty period and

verify operation of the system. These updates shall be accomplished in a timely manner, fully coordinated with the system operators, and incorporated into the operations and maintenance manuals and software documentation. There shall be at least one (1) scheduled update near the end of the first year's warranty period, at which time the Contractor shall install and validate the latest released version of the Manufacturer's software. All software changes shall be recorded in a log maintained in the facility access control service office. An electronic copy of the software update shall be maintained within the log. At a minimum, the contractor shall provide a description of the modification, when the modification occurred, and name and contact information of the individual performing the modification. The log shall be maintained in a white 3 ring binder and the cover marked "SOFTWARE CHANGE LOG".

#### **1.9 PERFORMANCE REQUIREMENTS**

- A. PACS shall provide support for multiple authentication modes and bidirectional communication with the reader. PACS shall provide implementation capability for enterprise security policy and incident response.
- B. All processing of authentication information must occur on the "safe side" of a door
- C. Physical Access Control System shall provide access to following Security Areas:
  - 1. Controlled
  - 2. Limited
  - 3. Exclusion

#### **1.10 EQUIPMENT AND MATERIALS**

- A. Refer to 28 05 00 COMMON WORK RESULTS FOR ELECTRONIC SAFETY AND SECURITY, Part 1
- B. Materials and equipment furnished shall be of current production by manufacturers regularly engaged in the manufacture of such items, for which replacement parts shall be available.
- C. When more than one unit of the same class of equipment is required, such units shall be the product of a single manufacturer.
- D. Equipment Assemblies and Components:
  - 1. Components of an assembled unit need not be products of the same manufacturer.

2. Manufacturers of equipment assemblies, which include components made by others, shall assume complete responsibility for the final assembled unit.
  3. Components shall be compatible with each other and with the total assembly for the intended service.
  4. Constituent parts which are similar shall be the product of a single manufacturer.
- E. Factory wiring shall be identified on the equipment being furnished and on all wiring diagrams.
- F. When Factory Testing Is Specified:
1. The Government shall have the option of witnessing factory tests. The contractor shall notify the VA through the Project Manager a minimum of 15 working days prior to the manufacturers making the factory tests.
  2. Four copies of certified test reports containing all test data shall be furnished to the Project Manager prior to final inspection and not more than 90 days after completion of the tests.
  3. When equipment fails to meet factory test and re-inspection is required, the contractor shall be liable for all additional expenses, including expenses of the Government.

#### **1.11 WARRANTY OF CONSTRUCTION.**

- A. Warrant PACS work subject to the Article "Warranty of Construction" of FAR clause 52.246-21.
- B. Demonstration and training shall be performed prior to system acceptance.

#### **1.12 GENERAL REQUIREMENTS**

- A. For general requirements that are common to more than one section in Division 28 refer to Section 28 05 00, REQUIREMENTS FOR ELECTRONIC SAFETY AND SECURITY INSTALLATIONS.
- B. General requirements applicable to this section include:
  1. General Arrangement Of Contract Documents,
  2. Delivery, Handling and Storage,
  3. Project Conditions,
  4. Electrical Power,
  5. Lightning, Power Surge Suppression, and Grounding,
  6. Electronic Components,
  7. Substitute Materials and Equipment, and
  8. Like Items.

**PART 2 - PRODUCTS****2.1 GENERAL**

- A. **Basis of Design: TYCO/SIMPLEX BRAND - [BUILDING STANDARD - NO SUBSTITUTE]. Building access controls to be Tyco/Simplex brand. This includes all card readers, switches, panels and other gear and all required programming and system updates**
- B. All equipment and materials for the system will be compatible to ensure correct operation as outlined in FIPS 201, March 2006 and HSPD-12.
- C. The security system characteristics listed in this section will serve as a guide in selection of equipment and materials for the PACS. If updated or more suitable versions are available then the VA Project Manager will approve the acceptance of prior to an installation.
- D. PACS equipment shall meet or exceed all requirements listed below.
- E. Access Control Equipment shall be comprised of, but not limited to, the following components:
  - 1. Lenel Power Supply/Charger: Lenel Model LNL-AL600ULX-4CB
  - 2. Lenel Dual Card Reader Controller: Lenel Model LNL-2220
  - 3. Lenel Dual Reader Interface Module: Lenel Model LNL-1320
  - 4. Lenel Combination card reader/key pad device: Lenel Model LNL-MTK15
  - 5. Burglar Alarm Replacement Power Supply: Altronix AL600 ULPD8 with integral battery back-up
  - 6. Electric Strikes (furnished and installed by Division 8)
  - 7. Door frame monitoring position contacts (furnished and installed by Division 8)
  - 8. Application Software update to reflect latest version of the access control software
  - 9. Cabling shall be plenum rated, with conductor configuration as recommended by the manufacturer, equal to West Penn Series 25244B.
  - 10. All auxiliary equipment required for a fully operational system.
  - 11. Furnish and install the following spare parts:
    - a. One (1) Lenel 1100 Control Board
    - b. One (1) Lenel 1200 Control Board
  - 12. All demolished devices shall be returned to the Owner. All demolished cabling shall be removed by the contractor.
- F. Secondary Alarm Annunciation Device: Furnish and install a Sonalert low voltage audible annunciation device, connected to the Lenel access control system and annunciating local burglar alarm intrusion, where indicated on the drawings.

## 2.2 SOFTWARE BASED SPECIAL SYSTEM INTEGRATION SYSTEM SOFTWARE

- A. A software-based communications interface system provided allow communication between the existing VA Police radio system and the various VA existing Special Systems noted below:
  - 1. Simplex Model 4100U Fire voice evacuation fire alarm system
  - 2. Lenel Access Control Code Green Duress System
  - 3. Edwards overhead duress paging system
- B. The integration system software shall be installed on a new server furnished and installed in the Level 6 IRM Computer Room 6W09 as part of A SEPARATE project
- C. This system shall integrate each of the system noted above into one platform for broadcast to the exiting VA Police handheld radio units.
- D. This system shall also provide the feature to allow a "hot key" function at facility computer work stations to interface with the Lenel Access Control System and initiate a location specific Code Green (duress) alarm. This package shall allow provisions for an initial 1000 workstation to be configured with this feature. All relevant licensing shall be included for this feature.

## 2.3 WIRES AND CABLES

- A. Plenum-Type, RS-232 Cable: Paired, 2 pairs, No. 22 AWG, stranded (7x30) tinned copper conductors, plastic insulation, and individual aluminum foil-polyester tape shielded pairs with 100 percent shield coverage; plastic jacket. Pairs are cabled on common axis with No. 24 AWG, stranded (7x32) tinned copper drain wire.
  - 1. NFPA 70, Type CMP.
  - 2. Flame Resistance: NFPA 262 Flame Test.
- B. Plenum-Type, RS-485 Cable: Paired, 2 pairs, No. 22 AWG, stranded (7x30) tinned copper conductors, fluorinated-ethylene-propylene insulation, unshielded, and fluorinated-ethylene-propylene jacket.
  - 1. NFPA 70, Type CMP.
  - 2. Flame Resistance: NFPA 262 Flame Test.
- C. Plenum-Type, Paired, Readers and Wiegand Keypads Cable: Paired, 3 pairs, No. 22 AWG, stranded (7x30) tinned copper conductors, plastic insulation, individual aluminum foil-polypropylene tape shielded pairs each with No. 22 AWG, stranded tinned copper drain wire, 100 percent shield coverage, and fluorinated-ethylene-propylene jacket.
  - 1. NFPA 70, Type CMP.
  - 2. Flame Resistance: NFPA 262 Flame Test.

- D. Plenum-Type, Multiconductor, Readers and Keypads Cable: 6 conductors, No. 20 AWG, stranded (7x28) tinned copper conductors, fluorinated-ethylene-propylene insulation, overall aluminum foil-polyester tape shield with 100 percent shield coverage plus tinned copper braid shield with 85 percent shield coverage, and fluorinated-ethylene-propylene jacket.
  - 1. NFPA 70, Type CMP.
  - 2. Flame Resistance: NFPA 262 Flame Test.

### **PART 3 - EXECUTION**

#### **3.1 GENERAL**

- A. The Contractor shall install all system components and appurtenances in accordance with the manufacturers' instructions, ANSI C2, and shall furnish all necessary interconnections, services, and adjustments required for a complete and operable system as specified. Control signals, communications, and data transmission lines grounding shall be installed as necessary to preclude ground loops, noise, and surges from affecting system operation. Equipment, materials, installation, workmanship, inspection, and testing shall be in accordance with manufacturers' recommendations and as modified herein.
- B. Consult the manufacturers' installation manuals for all wiring diagrams, schematics, physical equipment sizes, etc., before beginning system installation. Refer to the Riser/Connection diagram for all schematic system installation/termination/wiring data.
- C. All equipment shall be attached to walls and ceiling/floor assemblies and shall be held firmly in place (e.g., sensors shall not be supported solely by suspended ceilings). Fasteners and supports shall be adequate to support the required load.

#### **3.2 CURRENT SITE CONDITIONS**

- A. The Contractor shall visit the site and verify that site conditions agree with the design package. The Contractor shall report all changes to the site or conditions which will affect performance of the system to the Owner in a report as defined in paragraph Group II Technical Data Package. The Contractor shall not take any corrective action without written permission from the Owner.

#### **3.3 EXAMINATION**

- A. Examine pathway elements intended for cables. Check raceways, cable trays, and other elements for compliance with space allocations,



installation tolerances, hazards to cable installation, and other conditions affecting installation.

- B. Examine roughing-in for LAN and control cable conduit systems to PCs, Controllers, card readers, and other cable-connected devices to verify actual locations of conduit and back boxes before device installation.
- C. Proceed with installation only after unsatisfactory conditions have been corrected.

### **3.4 CABLING**

- A. Comply with NECA 1, "Good Workmanship in Electrical Contracting."
- B. Install cables and wiring according to requirements in Division 28 Section "Conductors and Cables for Electronic Safety and Security."
- C. Wiring Method: Install wiring in walls, areas subject to abuse (such as mechanical rooms, electrical rooms, etc.) as well inaccessible areas (such as sheetrock ceilings) in a metal raceway system. Cable installed above accessible ceilings shall be installed in existing cable tray or a new J-hook system. Conceal all raceways and wiring except in unfinished spaces.
- D. Install LAN cables using techniques, practices, and methods that are consistent with Category 6 rating of components and that ensure Category 6 performance of completed and linked signal paths, end to end.
- E. Install cables without damaging conductors, shield, or jacket.
- F. Boxes and enclosures containing security system components or cabling, and which are easily accessible to employees or to the public, shall be provided with a lock. Boxes above ceiling level in occupied areas of the building shall not be considered to be accessible. Junction boxes and small device enclosures below ceiling level and easily accessible to employees or the public shall be covered with a suitable cover plate and secured with tamperproof screws.
- G. Install end-of-line resistors at the field device location and not at the Controller or panel location.

### **3.5 CABLE APPLICATION**

- A. Comply with EIA/TIA-569, "Commercial Building Standard for Telecommunications Pathways and Spaces."
- B. Cable application requirements are minimum requirements and shall be exceeded if recommended or required by manufacturer of system hardware.
- C. RS-232 Cabling: Install at a maximum distance of 50 feet (15 m).
- D. RS-485 Cabling: Install at a maximum distance of 4000 feet (1220 m).

E. Card Readers and Keypads:

1. Install number of conductor pairs recommended by manufacturer for the functions specified.
2. Unless manufacturer recommends larger conductors, install No. 22 AWG wire if maximum distance from Controller to the reader is 250 feet (75 m), and install No. 20 AWG wire if maximum distance is 500 feet (150 m).
3. For greater distances, install "extender" or "repeater" modules recommended by manufacturer of the Controller.
4. Install minimum No. 18 AWG shielded cable to readers and keypads that draw 50 mA or more.
5. Do not exceed manufacturer recommended distances.

F. Install minimum No. 16 AWG cable from Controller to electrically powered locks. Do not exceed manufacturer recommended distances.

### 3.6 GROUNDING

- A. Comply with Division 26 Section "Grounding and Bonding for Electrical Systems."
- B. Comply with IEEE 1100, "Power and Grounding Sensitive Electronic Equipment."
- C. Ground cable shields, drain conductors, and equipment to eliminate shock hazard and to minimize ground loops, common-mode returns, noise pickup, cross talk, and other impairments.
- D. Signal Ground:
  1. Terminal: Locate in each equipment room and wiring closet; isolate from power system and equipment grounding.
  2. Bus: Mount on wall of main equipment room with standoff insulators.
  3. Backbone Cable: Extend from signal ground bus to signal ground terminal in each equipment room and wiring closet.

### 3.7 INSTALLATION

- A. System installation shall be in accordance with UL 294, manufacturer and related documents and references, for each type of security subsystem designed, engineered and installed.
- B. Components shall be configured with appropriate "service points" to pinpoint system trouble in less than 30 minutes.
- C. The Contractor shall install all system components including Government furnished equipment, and appurtenances in accordance with the manufacturer's instructions, documentation listed in Sections 1.4 and 1.5 of this document, and shall furnish all necessary connectors,

terminators, interconnections, services, and adjustments required for an operable system.

- D. The PACS will be designed, engineered, installed, and tested to ensure all components are fully compatible as a system and can be integrated with all associated security subsystems, whether the system is a standalone or a network.
- E. The contractor shall furnish and install additional 120 V Critical Branch circuits (in addition to those circuits shown on the drawings) as required to serve new equipment furnished to provide a fully operational system. The branch circuits shall be derived from the closed available Critical Branch panel with spare circuit(s).

### **3.8 SYSTEM SOFTWARE/SERVER HARDWARE**

- A. Install, configure, and test software and databases for the complete and proper operation of systems involved. Assign software license to Owner.
- B. Furnish and install a new Cisco server Model XXXYYY to accommodate the software based communications interface system provided allow communication between the existing VA Police radio system and the various VA Special Systems.

### **3.9 FIELD QUALITY CONTROL**

- A. Manufacturer's Field Service: Engage a factory-authorized service representative to inspect, test, and adjust field-assembled components and equipment installation, including connections, and to assist in field testing. Report results in writing.

### **3.10 PROTECTION**

- A. Maintain strict security during the installation of equipment and software. Rooms housing the control station, and workstations that have been powered up shall be locked and secured, with an activated burglar alarm and access-control system reporting to a Central Station complying with UL 1610, "Central-Station Burglar-Alarm Units," during periods when a qualified operator in the employ of Contractor is not present.

### **3.11 COMMISSIONING NOT USED.**

### **3.12 DEMONSTRATION AND TRAINING**

- A. Provide services of manufacturer's technical representative for four hours to instruct VA personnel in operation and maintenance of units.
- B. Submit training plans and instructor qualifications.
- C. Develop separate training modules for the following:

1. Computer system administration personnel to manage and repair the LAN and databases and to update and maintain software.
  2. Operators who prepare and input credentials to man the control station and workstations and to enroll personnel.
  3. Security personnel.
  4. Hardware maintenance personnel.
  5. Corporate management.
- D. All testing and training shall be compliant with the VA General Requirements, Section 01 00 00, GENERAL REQUIREMENTS.

- - - E N D - - -

**SECTION 28 16 11**  
**CODE GREEN NOTIFICATION SYSTEM**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. Provide and install Code Green pushbuttons as indicated on the drawings and connect to the existing Lenel control panel located as shown on the drawings.

**1.2 RELATED WORK**

- A. For fire stopping application and use, Section 07 84 00, FIRESTOPPING.
- B. For electrical installation, Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
- C. For power cables, Section 26 05 19, LOW VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES (600 VOLTS AND BELOW).
- D. For grounding of equipment, Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS.
- E. For infrastructure, Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS.
- F. For coordination with Access Controls, Section 28 05 00 COMMON WORK RESULTS FOR ELECTRONIC SAFETY AND SECURITY.
- G. For General Requirements, Section 01 00 00, GENERAL REQUIREMENTS.

**1.3 QUALITY ASSURANCE**

- A. The Contractor shall be responsible for providing, installing, and maintaining the operation of the Code Green system as shown. The Contractor shall also provide certification as required.
- B. The Code Green system shall be installed and tested to ensure all components are fully compatible as a system.

**1.4 SUBMITTALS**

- A. Submit below items in conjunction with Master Specification Sections 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
  - 1. Drawing sheets that will be plotted on the individual floor plans or site plans shall:
    - a. Include a title block as defined above.
    - b. Define the drawings scale in both standard and metric measurements.
    - c. Provide device identification and location.
    - d. Address all signal and power conduit runs and sizes that are associated with the design.

2. A riser drawing, showing the new portion of the Code Green system, shall include shall:
  - a. Indicate the sequence of operation.
  - b. Relationship of the existing Lenel control panel and the new Code Green buttons.
  - c. Include the number, size, identification, and maximum lengths of interconnecting wires.
  - d. Wire/cable types shall be defined by a wire and cable schedule. The schedule shall utilize a lettering system that will correspond to the wire/cable it represents (example: A = 18 AWG/1 Pair Twisted, Unshielded). This schedule shall also provide the manufacturer's name and part number for the wire/cable being installed.

## **PART 2 - PRODUCTS**

### **2.1 EQUIPMENT AND MATERIALS**

#### **A. General**

1. Code Green buttons shall be wall mounted as noted on the drawings. Each button shall be Potter Electric Signal, Model HUB-M, with the recessed initiating button directed down. All wiring shall be concealed. Conduit shall be provided from each backbox to the adjacent low voltage cable tray system.
2. Furnish and install all cabling, connections, terminations, electronics, programming, etc. as required for a fully operational system.
3. The system shall be designed, installed, and programmed in a manner that will allow for ease of operation, programming, servicing, maintenance, testing, and upgrading of the system.
4. All equipment and materials for the system will be compatible to ensure functional operation in accordance with requirements.
5. Multiple Code Green buttons at a common desk shall be combined to annunciate as a single point.
6. All cabling not installed in conduit shall be provided with a plenum-rated jacket.

## **PART 3 - EXECUTION**

### **3.1 INSTALLATION**

- A. Code Green System installation shall be in accordance with Underwriters Laboratories (UL) Standards.

### 3.2 TESTS AND TRAINING

- A. All testing and training shall be compliant with the VA General Requirements, Section 01 00 00, GENERAL REQUIREMENTS.

- - - E N D - - -





**SECTION 28 23 00  
VIDEO SURVEILLANCE**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. Expand and install a complete Video Surveillance System, which is identified as the Video Assessment and Surveillance System hereinafter referred to as the VASS System as specified in this section.
- B. This Section includes video surveillance system consisting of video system demolition, IP cameras, camera supports/mounting hardware data transmission wiring/terminations, video switches,
- C. Interface with and expansion of, the existing GlobalView Video Management System and software system. All required video storage hardware, programming, software upgrades, licensing, etc. shall be furnished and installed.
- D. Removal of all the existing analog video cameras and related supports, cabling, and associated equipment.
- E. Cabling/jacks for all existing IP cameras shall be transferred from the existing VA IRM data network switches to the respective new dedicated CCTV network switches. Existing CAT 6 CCTV cabling serving an existing camera can be reused, when the existing camera is relocated and the cabling is of sufficient length to be shortened and extended to the relocated camera location. Spicing or coupling of existing cabling is not acceptable. Existing IP cameras, with cabling of insufficient length to terminate at the respective new patch panel/CCTV video switch shall be provided with new CAT 6 cable.

**1.2 RELATED WORK**

- A. Section 01 00 00 - GENERAL REQUIREMENTS. For General Requirements.
- B. Section 07 84 00 - FIRESTOPPING. Requirements for firestopping application and use.
- C. Section 26 05 11 - REQUIREMENTS FOR ELECTRICAL INSTALLATIONS. Requirements for connection of high voltage.
- D. Section 26 05 19 - LOW VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES. Requirements for power cables.
- E. Section 28 05 00 - COMMON WORK RESULTS FOR ELECTRONIC SAFETY AND SECURITY. Requirements for general requirements that are common to more than one section in Division 28.
- F. Section 28 05 13 - CONDUCTORS AND CABLES FOR ELECTRONIC SAFETY AND SECURITY. Requirements for conductors and cables.

- G. Section 28 05 26 - GROUNDING AND BONDING FOR ELECTRONIC SAFETY AND SECURITY. Requirements for grounding of equipment.
- H. Section 28 05 28.33 - CONDUITS AND BACKBOXES FOR ELECTRONIC SAFETY AND SECURITY. Requirements for infrastructure.

### 1.3 DEFINITIONS

- A. AGC: Automatic gain control.
- B. B/W: Black and white.
- C. CCD: Charge-coupled device.
- D. CIF: Common Intermediate Format CIF images are 352 pixels wide and 88/240 (PAL/NTSC) pixels tall (352 x 288/240).
- E. 4CIF: resolution is 704 pixels wide and 576/480 (PAL/NTSC) pixels tall (704 x 576/480).
- F. H.264 (also known as MPEG4 Part 10): an encoding format that compresses video much more effectively than older (MPEG4) standards.
- G. ips: Images per second.
- H. MPEG: Moving picture experts group.
- I. MPEG4: a video encoding and compression standard that uses inter-frame encoding to significantly reduce the size of the video stream being transmitted.
- J. NTSC: National Television System Committee.
- K. UPS: Uninterruptible power supply.

### 1.4 QUALITY ASSURANCE

- A. The Contractor shall be responsible for providing, installing, and the operation of the VASS System as shown. The Contractor shall also provide certification as required.
- B. The security system shall be installed and tested to ensure all components are fully compatible as a system and can be integrated with all associated security subsystems, whether the security system is stand-alone or a part of a complete Information Technology (IT) computer network.
- C. The Contractor or security sub-contractor shall be a licensed security Contractor as required within the state or jurisdiction of where the installation work is being conducted.
- D. Manufacturers Qualifications: The manufacturer shall regularly and presently produce, as one of the manufacturer's principal products, the equipment and material specified for this project, and shall have manufactured the item for at least three years.
- E. Product Qualification:

1. Manufacturer's product shall have been in satisfactory operation, on three installations of comparable size and type as this project, for approximately three years.
2. The Government reserves the right to require the Contractor to submit a list of installations where the products have been in operation before approval.

F. Contractor Qualification:

1. The Contractor or security sub-contractor shall be a licensed security Contractor with a minimum of five (5) years experience installing and servicing video systems of similar scope and complexity. The Contractor shall be an authorized regional representative of the Video Assessment and Surveillance System's (VASS) manufacturer. The Contractor shall provide four (4) current references from clients with systems of similar scope and complexity which became operational in the past three (3) years. At least three (3) of the references shall be utilizing the same system components, in a similar configuration as the proposed system. The references must include a current point of contact, company or agency name, address, telephone number, complete system description, date of completion, and approximate cost of the project. The owner reserves the option to visit the reference sites, with the site owner's permission and representative, to verify the quality of installation and the references' level of satisfaction with the system. The Contractor shall provide copies of system manufacturer certification for all technicians. The Contractor shall only utilize factory-trained technicians to install, program, and service the VASS. The Contractor shall only utilize factory-trained technicians to install, terminate and service cameras, control, and recording equipment. The technicians shall have a minimum of five (5) continuous years of technical experience in electronic security systems. The Contractor shall have a local service facility. The facility shall be located within 60 miles of the project site. The local facility shall include sufficient spare parts inventory to support the service requirements associated with this contract. The facility shall also include appropriate diagnostic equipment to perform diagnostic procedures. The COTR reserves the option of surveying the company's facility to verify the service inventory and presence of a local service organization.

2. The Contractor shall provide proof project superintendent with BICSI Certified Commercial Installer Level 1, Level 2, or Technician to provide oversight of the project.
  3. Cable installer must have on staff a Registered Communication Distribution Designer (RCDD) certified by Building Industry Consulting Service International. The staff member shall provide consistent oversight of the project cabling throughout design, layout, installation, termination and testing.
- G. Service Qualifications: There shall be a permanent service organization maintained or trained by the manufacturer which will render satisfactory service to this installation within four hours of receipt of notification that service is needed. Submit name and address of service organizations.

#### **1.5 SUBMITTALS**

- A. Submit below items in conjunction with Master Specification Sections 01 33 23, Shop Drawings, Product Data, and Samples, and Section 02 41 00, Demolition Drawings.
- B. Provide certificates of compliance with Section 1.4, Quality Assurance.
- C. Provide a pre-installation and as-built design package in both electronic format and on paper, minimum size 1220 x 1220 millimeters (48 x 48 inches); drawing submittals shall be per the established project schedule.
- D. Pre-installation design and as-built packages shall include, but not be limited to:
  1. Index Sheet that shall:
    - a. Define each page of the design package to include facility name, building name, floor, and sheet number.
    - b. Provide a list of all security abbreviations and symbols.
    - c. Reference all general notes that are utilized within the design package.
    - d. Specification and scope of work pages for all video system(s) that are applicable to the design package that will:
      - 1) Outline all general and job specific work required within the design package.
      - 2) Provide a device identification table outlining device Identification (ID) and use for all security systems equipment utilized in the design package.
  2. Floor plans, site plans, and enlarged plans shall:

- a. Include a title block as defined above.
  - b. Define the drawings scale in both standard and metric measurements.
  - c. Provide device identification and location.
  - d. Address all signal and power conduit runs and sizes that are associated with the design of the electronic security system and other security elements (e.g., barriers, etc.).
  - e. Identify all pull box and conduit locations, sizes, and fill capacities.
  - f. Address all general and drawing specific notes for a drawing sheet.
3. A riser drawing for each applicable video system shall:
- a. Indicate the sequence of operation.
  - b. Relationship of integrated components on one diagram.
  - c. Include the number, size, identification, and maximum lengths of interconnecting wires.
  - d. Wire/cable types shall be defined by a wire and cable schedule. The schedule shall utilize a lettering system that will correspond to the wire/cable it represents (example: A = 18 AWG/1 Pair Twisted, Unshielded). This schedule shall also provide the manufacturer's name and part number for the wire/cable being installed.
4. A system drawing for each applicable video system shall:
- a. Identify how all equipment within the system, from main panel to device, shall be laid out and connected.
  - b. Provide full detail of all system components wiring from point-to-point.
  - c. Identify wire types utilized for connection, interconnection with associate security subsystems.
  - d. Show device locations that correspond to the floor plans.
  - e. All general and drawing specific notes shall be included with the system drawings.
5. A schedule for all the applicable video systems shall be included. All schedules shall provide the following information:
- a. Device ID.
  - b. Device Location (e.g. site, building, floor, room number, location, and description).
  - c. Mounting type (e.g. flush, wall, surface, etc.).

- d. Power supply or circuit breaker and power panel number.
- e. In addition, for the VASS Systems, provide the camera ID, camera type (e.g. fixed lens, lens type, field of view) and housing model number.
- 6. Detail and elevation drawings for all devices that define how they were installed and mounted.
- E. Provide manufacturer security system product cut-sheets. Submit for approval at least 30 days prior to commencement of formal testing, a Security System Operational Test Plan. Include procedures for operational testing of each component and security subsystem, to include performance of an integrated system test.
- F. Submit manufacture's certification of Underwriters Laboratories, Inc. (UL) listing as specified. Provide all maintenance and operating manuals per the VA General Requirements, Section 01 00 00, GENERAL REQUIREMENTS.

#### 1.6 APPLICABLE PUBLICATIONS

- A. The publications listed below (including amendments, addenda, revisions, supplement, and errata) form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American National Standards Institute (ANSI)/Electronic Industries Alliance (EIA):
  - 330-09.....Electrical Performance Standards for CCTV Cameras
  - 375A-76.....Electrical Performance Standards for CCTV Monitors
- C. Institute of Electrical and Electronics Engineers (IEEE):
  - C62.41-02.....IEEE Recommended Practice on Surge Voltages in Low-Voltage AC Power Circuits
  - 802.3af-08.....Power over Ethernet Standard
- D. Federal Communications Commission (FCC):
  - (47 CFR 15) Part 15 Limitations on the Use of Wireless Equipment/Systems
- E. National Electrical Contractors Association (NECA):
  - 303-2005.....Installing Closed Circuit Television (CCTV) Systems
- F. National Fire Protection Association (NFPA):
  - 70-08.....Article 780-National Electrical Code
- G. Federal Information Processing Standard (FIPS):

140-2-02.....Security Requirements for Cryptographic Modules

H. Underwriters Laboratories, Inc. (UL):

983-06.....Standard for Surveillance Camera Units

3044-01.....Standard for Surveillance Closed Circuit

Television Equipment

## 1.7 COORDINATION

A. Coordinate arrangement, mounting, and support of video surveillance equipment:

1. To allow maximum possible headroom unless specific mounting heights that reduce headroom are indicated.
2. To provide for ease of disconnecting the equipment with minimum interference to other installations.
3. To allow right of way for piping and conduit installed at required slope.
4. All connecting raceways, cables, wireways, cable trays, and busways shall be clear of obstructions and clear of the working and access space of other equipment.

B. Coordinate installation of required supporting devices and set sleeves in cast-in-place concrete, masonry walls, and other structural components as they are constructed.

C. Coordinate location of access panels and doors for video surveillance items that are behind finished surfaces or otherwise concealed.

## 1.8 WARRANTY OF CONSTRUCTION

A. Warrant VASS System work subject to the Article "Warranty of Construction" of FAR clause 52.246-21.

B. Demonstration and training shall be performed prior to system acceptance.

## PART 2 - PRODUCTS

### 2.1 GENERAL

A. The basis-of-design for the cameras is by Arecont Vision, Inc. Manufacturers listed below that meet or exceed the performance and quality of the specified cameras will be evaluated for acceptance.

B. Basis-of-Design Camera Equipment:

1. Refer to CCTV Camera Schedule on the drawings for the basis-of-design cameras for each application.

C. Surge Protection: Protect components from voltage surges originating external to equipment housing and entering through power, communication, signal, control, or sensing leads. Include surge

protection for external wiring of each conductor entry connection to components.

- D. Power Connections: Comply with requirements in Section 28 05 00 COMMON WORK REQUIREMENTS FOR ELECTRONIC SAFETY AND SECURITY, Part 2, as recommended by manufacturer for type of line being protected.
- E. Tamper Protection: Tamper switches on enclosures, control units, pull boxes, junction boxes, cabinets, and other system components shall initiate a tamper-alarm signal when unit is opened or partially disassembled. Control-station, control-unit alarm display shall identify tamper alarms and indicate locations.

## **2.2 CAMERAS**

- A. Minimum Protection for Communication, Signal, Control, and Low-Voltage 983 compliant as well as:
  - 1. All cameras to be fixed single or multi-sensor, IP color cameras to serve the viewing parameters shown on the drawings.
  - 2. Shall be powered over Ethernet where such outboard power is required.
  - 3. New network switches supporting new and existing IP cameras shall be provided at locations as shown on the drawings.
  - 4. Each CCTV network switch shall be provided with a rack mounted UPS back-up unit as specified and connected to emergency power to ensure cameras are fully operational in the event of loss of primary power to the VASS System.
  - 5. Shall be rated for continuous operation under the environmental conditions listed in Part 1, Project Conditions.
  - 4. Will be connected to existing digital video recorders via new CCTV network switches/cabling for monitoring and recording. Video storage shall provide to assure a minimum storage time of 30 days at video parameters matching the existing GlobalView system.
  - 5. Each function and activity shall be addressed within the system by a unique user defined name, with minimum of twenty (20) characters. The use of codes or mnemonics identifying the VASS action shall not be accepted.
  - 6. Acceptable manufacturers shall be Axis, Inc and Arecont, Inc.

## **2.3 VIDEO MANAGEMENT SYSTEM (Digital)**

- A. The existing GlobalView Video Management System (VMS) shall be expanded to accommodate all new cameras. Provide all programming, additional hardware, software to accommodate all new video equipment, etc. for a



fully operation CCTV system. Contact Hawkeye Vision, Inc. at 1-800-959-9148, representative Jon Helgason(jhelgason@hawkeyevision.net), for all details related to expanding the Global View VMS. Expansion of the Global View shall provide the same video parameters, e.g., frame rate, compression, resolution, etc. as currently in use on the existing IP cameras.

B. Operating System

1. The Video Management System's operating system and application shall be upgraded to the latest software version.

C. Recording

1. The Digital Video Management System shall use the existing digital recorders. At the conclusion of this project, the available recording time on the DVR's shall be a minimum of 30 days based on the existing, the new and 20% expansion future cameras. Additional 2 TB video recorders shall be provided if required to satisfy this recording time parameter. Record mode settings as continuous or event activated.

## 2.4 VIDEO DISPLAY EQUIPMENT

A. Video Display Equipment

1. Will consist of color monitors and shall be EIA 375A compliant.
2. Shall be able to display analog, digital, and other images in either NTSC or MPEG format associated with the operation of the Security Management System (SMS).
3. Furnish one (1) new display in the Police Department CCTV viewing area.
4. Shall:
  - a. Have front panel controls that provide for power on/off, horizontal and vertical hold, brightness, and contrast.
  - b. Accept multiple inputs, either directly or indirectly.
  - c. Have the capabilities to observe and program the VASS System.
  - d. Be installed in a manner that they cannot be witnessed by the public.

B. Color Video Monitors Technical Characteristics:

Sync Format	PAL/NTSC
Display Tube	90° deflection angle
Horizontal Resolution	250 TVL minimum, 300 TVL typical
Video Input	1.0 Vp-p, 75 Ohm

Front Panel Controls	Volume, Contrast, Brightness, Color
Connectors	BNC

- C. Liquid Crystal Display (LCD) Flat Panel Display Monitor
- D. The 21 -inch color LCD monitor shall have a flat screen and 21-inch diagonal viewing area and consists of an LCD panel, bezel, and stand.
- E. The monitor shall meet or exceed the following specifications:
  - 1. The monitor shall incorporate a 21 -inch active matrix TFT LCD panel.
    - a. The pixel pitch of the monitor's LCD panel shall be 0.264 mm horizontal and 0.264 mm vertical.
    - b. The monitor shall have a maximum resolution of 500 television lines.
    - c. The contrast ratio shall be 500:1.
    - d. The typical brightness shall be 250 cd/m<sup>2</sup>
    - e. The monitor shall display at least 16.7 million colors.
    - f. The light source for the LCD panel shall have a lifetime of 50,000 hours.
    - g. The scan frequency horizontal shall be 30 to 80 KHz and the scan frequency vertical shall be 56 to 75 Hz.
    - h. The viewing angle for the monitor shall be 170 degrees horizontal and 170 degrees vertical.
  - 2. The monitor shall have automatic NTSC or PAL recognition.
  - 3. The monitor shall have a picture-in-picture function.
  - 4. The monitor shall have the following front control panel buttons:
    - a. Power on/off
    - b. LED indicator
    - c. Mode
    - d. Increase (volume)
    - e. Decrease (volume)
    - f. Up (contrast adjustment)
    - g. Down (brightness adjustment)
    - h. Menu
    - i. Auto
  - 5. The monitor shall have the following options for adjustment in an onscreen display menu:
    - a. Color

- b. Tint
  - 1) NTSC mode only
    - a) Brightness
    - b) Contrast
    - c) Sharpness
    - d) Volume
    - e) Language
    - f) Scan
    - g) Color Temp
    - h) H-Position
    - i) Recall
- F. The electrical specifications for the monitor shall be as follows:
  - 1. Input voltage shall be 12 VDC/3 A.
  - 2. Power consumption shall be 50 W maximum.
- G. The environmental specifications for the monitor shall be as follows:
  - 1. Operating temperature shall be 32 to 104 degrees Fahrenheit or 0 to 40 degrees Celsius.
  - 2. Operating humidity shall be 10 to 85 percent.
- H. The physical specifications for the monitor shall be as follows:
- I. The monitor shall conform to these compliance standards:
  - 1. FCC
  - 2. CE (EMC/LVD)3. UL
- J. Furnish and install six (10) HDMI cable between the relocated video client PC's and the new (10) video monitors in the Police Department CCTV viewing area. Client PC relocated to new police department by others.
- K. Each existing data cabling/jack currently serving pc's viewing the Global View system shall be migrated to the appropriate new CCTV video switch on the respective floor or the respective building.

## **2.5 CCTV NETWORK SWITCHES**

- A. A new fiber optic connected CCTV cameras video network shall be provided as shown on the drawings. Each new network switch shall be furnished, installed and programmed for a fully operational system.
- B. Acceptable CCTV Network switches shall be by Cisco, Inc, Model 3850 with POE and Gigabyte features and provided with twin power supplies.
- C. Each CCTV Network switch shall be provided with adjacent cable features including cable managers, modular patch patches and 20% future expansion capability.

D. Each video switch shall be provided with an APC 2000 VA UPS unit.

### **PART 3 - EXECUTION**

#### **3.1. GENERAL**

- A. Installation: The Contractor shall install all system components including Owner furnished equipment, and appurtenances in accordance with the manufacturer's instructions, ANSI C2 and as shown, and shall furnish all necessary connectors, terminators, interconnections, services, and adjustments required for a complete and operable data transmission system.
- B. Identification and Labeling: The Contractor shall supply permanent identification labels for each cable at each end that will appear on the as-built drawings. The labeling format shall be identified and a complete record shall be provided to the Owner with the final documentation. Each cable shall be identified by type or signal being carried and termination points. The labels shall be printed on letter size label sheets that are self laminated vinyl that can be printed from a computer data base or spread sheet. The labels shall be E-Z code WES12112 or equivalent.
  - 1. The Contractor shall provide all personnel, equipment, instrumentation, and supplies necessary to perform all testing.
- C. Transient Voltage Surge Suppressors (TVSS): The Contractor shall mount TVSS within 3 m (118 in) of equipment to be protected inside terminal cabinets or suitable NEMA 1 enclosures. Terminate off-premise conductors on input side of device. Connect the output side of the device to the equipment to be protected. Connect ground lug to a low impedance earth ground (less than 10 ohms) via Number 12 AWG insulated, stranded copper conductor.
- D. Contractor's Field Test: The Contractor shall verify the complete operation of the data transmission system during the Contractor's Field Testing. Field test shall include a bit error rate test. The Contractor shall perform the test by sending a minimum of 1,000,000 bits of data on each DTM circuit and measuring the bit error rate. The bit error rate shall not be greater than one (1) bit out of each 100,000 bits sent for each dial-up DTM circuit, and one (1) bit out of 1,000,000 bits sent for each leased or private DTM circuit. The Contractor shall submit a report containing results of the field test.

- E. Acceptance Test and Endurance Test: The wire line data transmission system shall be tested as a part of the completed IDS and EECS during the Acceptance test and Endurance Test as specified.
- F. Identification and Labeling: The Contractor shall supply identification tags or labels for each cable. Cable shall be labeled at both end points and at intermediate hand holes, manholes, and junction boxes. The labeling format shall be identified and a complete record shall be provided to the Owner with the final documentation. Each cable shall be identified with type of signal being carried and termination points.

### **3.2 INSTALLATION**

- A. System installation shall be in accordance with NECA 303, manufacturer and related documents and references, for each type of security subsystem designed, engineered and installed.
- B. Components shall be configured with appropriate "service points" to pinpoint system trouble in less than 30 minutes.
- C. The Contractor shall install all system components including Government furnished equipment, and appurtenances in accordance with the manufacturer's instructions, documentation listed in Sections 1.5 of this document, and shall furnish all necessary connectors, terminators, interconnections, services, and adjustments required for a complete and operable system.
- D. The VASS System will be designed, engineered, installed, and tested to ensure all components are fully compatible as a system and can be integrated with all associated security subsystems, whether the system is a stand alone or a complete network.
- E. For programming purposes refer to the manufacturers requirements for correct system operations. Ensure computers being utilized for system integration meet or exceed the minimum system requirements outlined on the systems software packages.
- F. A complete VASS System shall be comprised of, but not limited to, the following components:
  - 1. Cameras
  - 2. Lenses
  - 3. Video Display Equipment
  - 4. Camera Housings and Mounts
  - 5. Controlling Equipment
  - 6. Recording Devices

## 7. Wiring and Cables

G. The Contractor shall visit the site and verify that site conditions are in agreement/compliance with the design package. The Contractor shall report all changes to the site or conditions that will affect performance of the system to the VA Project Manager in the form of a report. The Contractor shall not take any corrective action without written permission received from the VA Project Manager.

## H. Existing Equipment

1. The Contractor shall connect to and utilize existing video equipment and devices as outlined in the design package. Video equipment and signal lines that are usable in their original configuration without modification may be reused with VA Project Manager approval.
2. The Contractor shall perform a field survey, including testing and inspection of all existing video equipment and signal lines intended to be incorporated into the VASS System, and furnish a report to the VA Project Manager as part of the site survey report. For those items considered nonfunctioning, provide (with the report) specification sheets, or written functional requirements to support the findings and the estimated cost to correct the deficiency. As part of the report, the Contractor shall include a schedule for connection to all existing equipment.
3. The Contractor shall make written requests and obtain approval prior to disconnecting any signal lines and equipment, and creating equipment downtime. Such work shall proceed only after receiving VA Project Manager approval of these requests. If any device fails after the Contractor has commenced work on that device, signal or control line, the Contractor shall diagnose the failure and perform any necessary corrections to the equipment.
4. The Contractor shall be held responsible for repair costs due to Contractor negligence, abuse, or incorrect installation of equipment.
5. The VA Project Manager shall be provided a full list of all equipment that is to be removed or replaced by the Contractor, to include description and serial/manufacturer numbers where possible. The Contractor shall dispose of all equipment that has been removed or replaced based upon approval of the VA Project Manager after reviewing the equipment removal list. In all areas where equipment

is removed or replaced the Contractor shall repair those areas to match the current existing conditions.

- I. Enclosure Penetrations: All enclosure penetrations shall be from the bottom of the enclosure unless the system design requires penetrations from other directions. Penetrations of interior enclosures involving transitions of conduit from interior to exterior, and all penetrations on exterior enclosures shall be sealed with rubber silicone sealant to preclude the entry of water and will comply with VA Master Specification 07 84 00, Firestopping. The conduit riser shall terminate in a hot-dipped galvanized metal cable terminator. The terminator shall be filled with an approved sealant as recommended by the cable manufacturer and in such a manner that the cable is not damaged.
- J. Cold Galvanizing: All field welds and brazing on factory galvanized boxes, enclosures, and conduits shall be coated with a cold galvanized paint containing at least 95 percent zinc by weight.
- K. Interconnection of Console Video Equipment: The Contractor shall connect signal paths between video equipment as specified by the OEM. Cables shall be as short as practicable for each signal path without causing strain at the connectors. Rack mounted equipment on slide mounts shall have cables of sufficient length to allow full extension of the slide rails from the rack.
- L. Cameras:
  - 1. Install the cameras with the focal length lens as indicated for each zone.
  - 2. Connect power and signal lines to the camera.
  - 3. Aim camera to give field of view as needed to cover the alarm zone.
  - 4. Aim fixed mounted cameras installed outdoors facing the rising or setting sun sufficiently below the horizon to preclude the camera looking directly at the sun.
  - 5. Focus the lens to give a sharp picture (to include checking for day and night focus and image quality) over the entire field of view
  - 6. Synchronize all cameras so the picture does not roll on the monitor when cameras are selected.
  - 7. PTZ cameras shall have all preset positions and privacy areas defined and programmed.
- M. Monitors:
  - 1. Install the monitors as shown and specified in design and construction documents.

2. Connect all signal inputs and outputs as shown and specified.
3. Terminate video input signals as required.
4. Connect the monitor to AC power.

N. Video Workstation:

1. Install the video workstation per design and construction documents, and as specified by the OEM.
2. Connect video workstation to AC power (UPS).
3. Connect to VASS network.
4. Install operating system and application software.
5. Provide application software programming per VA guidance and the requirements provided by the Owner. Programming shall include:
  - a. Screen views
  - b. Graphical User Interface (GUI) maps, views, icons and actions
  - c. Alarm outputs
  - d. Reports

O. CCTV Network Switches:

1. Install the network switches per design and construction documents, and as specified by the OEM.
2. Connect network switch to AC power (UPS).
3. Connect network cameras to network switch.
4. Configure the network switch per manufacturer's recommendation and project requirements.

P. Camera Housings, Mounts, etc.

1. Install the camera housings and mounts as specified by the manufacturer and as shown, provide mounting hardware sized appropriately to secure each camera, housing and mount with maximum wind and ice loading encountered at the site.
2. Provide a foundation for each camera pole as specified and shown.
3. Provide a ground rod for each camera pole and connect the camera pole to the ground rod as specified in Division 26 of the VA Master Specification and the VA Electrical Manual 730.
4. Provide electrical and signal transmission cabling to the mount location via a hardened carrier system from the Physical Access Control System and Database Management to the device.
5. Connect signal lines and AC power to the housing interfaces.
6. Connect pole wiring harness to camera.



**3.3 SYSTEM START-UP**

- A. The Contractor shall not apply power to the VASS System until the following items have been completed:
  - 1. VASS System equipment items and have been set up in accordance with manufacturer's instructions.
  - 2. A visual inspection of the VASS System has been conducted to ensure that defective equipment items have not been installed and that there are no loose connections.
  - 3. System wiring has been tested and verified as correctly connected as indicated.
  - 4. All system grounding and transient protection systems have been verified as installed and connected as indicated.
  - 5. Power supplies to be connected to the VASS System have been verified as the correct voltage, phasing, and frequency as indicated.
- B. Coordinate the startup and contractor testing schedules with the VA Project Manager. Provide a minimum of 7 days prior notice.
- C. Satisfaction of the above requirements shall not relieve the Contractor of responsibility for incorrect installation, defective equipment items, or collateral damage as a result of Contractor work efforts.

**3.4 SUPPLEMENTAL CONTRACTOR QUALITY CONTROL**

- A. The Contractor shall provide the services of technical representatives who are familiar with all components and installation procedures of the installed VASS System; and are approved by the VA Project Manager.
- B. The Contractor will be present on the job site during the preparatory and initial phases of quality control to provide technical assistance.
- C. The Contractor shall also be available on an as needed basis to provide assistance with follow-up phases of quality control.
- D. The Contractor shall participate in the testing and validation of the system and shall provide certification that the system installed is fully operational as all construction document requirements have been fulfilled.

**3.5 COMMISSIONING NOT USED.****3.6 DEMONSTRATION AND TRAINING**

- A. All testing and training shall be compliant with the VA General Requirements, Section 01 00 00, "GENERAL REQUIREMENTS".
- B. Provide services of manufacturer's technical representative for four hours to instruct VA personnel in operation and maintenance of units.

- - - E N D - - -



**SECTION 28 31 00  
FIRE DETECTION AND ALARM**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. **Basis of Design: TYCO/SIMPLEX BRAND - [BUILDING STANDARD - NO SUBSTITUTE]. Fire alarm devices, wiring, programming, etc. shall be provided by Tyco/Simplex.**
- B. This section of the specifications includes the furnishing, installation, and connection of the fire alarm equipment to form a complete coordinated system ready for operation. It shall include, but not be limited to, alarm initiating devices, alarm notification appliances, control units, fire safety control devices, annunciators, power supplies, and wiring as shown on the drawings and specified. The fire alarm system shall not be combined with other systems such as building automation, energy management, security, etc.
- C. Fire alarm systems shall comply with requirements of the most recent VA FIRE PROTECTION DESIGN MANUAL and NFPA 72 unless variations to NFPA 72 are specifically identified within these contract documents by the following notation: "variation". The design, system layout, document submittal preparation, and supervision of installation and testing shall be provided by a technician that is certified NICET level III or a registered fire protection engineer. The NICET certified technician shall be on site for the supervision and testing of the system. Factory engineers from the equipment manufacturer, thoroughly familiar and knowledgeable with all equipment utilized, shall provide additional technical support at the site as required by the Project Manager/COTR or his authorized representative. Installers shall have a minimum of 2 years experience installing fire alarm systems.
- D. Fire alarm signals:
1. Building shall have an automatic digitized voice fire alarm signal with emergency manual voice override to notify occupants to evacuate. The digitized voice message shall identify the area of the building (smoke zone) from which the alarm was initiated.
  2. Not Used.
- E. Alarm signals (by device), supervisory signals (by device) and system trouble signals (by device not reporting) shall be distinctly transmitted to the main fire alarm system control unit located in the basement BN02.

- F. The main fire alarm control unit shall automatically transmit alarm signals to a listed central station using a digital alarm communicator transmitter in accordance with NFPA 72.

## 1.2 SCOPE

- A. A fully addressable fire alarm system as an extension of an existing addressable fire alarm system shall be designed and installed in accordance with the specifications and drawings. Device location and wiring runs shown on the drawings are for reference only unless specifically dimensioned. Actual locations shall be in accordance with NFPA 72 and this specification.
- B. All existing fire alarm equipment, wiring, devices and sub-systems that are not shown to be reused shall be removed. All existing fire alarm conduit not reused shall be removed.
- C. Existing fire alarm bells, chimes, door holders, 120VAC duct smoke detectors, valve tamper switches and waterflow/pressure switches may be reused only as specifically indicated on the drawings and provided the equipment:
  - 1. Meets this specification section
  - 2. Is UL listed or FM approved
  - 3. Is compatible with new equipment being installed
  - 4. Is verified as operable through contractor testing and inspection
  - 5. Is warranted as new by the contractor.
- D. Existing 120 VAC duct smoke detectors, waterflow/pressure switches, and valve tamper switches reused by the Contractor shall be equipped with an addressable interface device compatible with the new equipment being installed.
- E. Existing reused equipment shall be covered as new equipment under the Warranty specified herein.
- F. Basic Performance:
  - 1. Alarm and trouble signals from each building fire alarm control panel shall be digitally encoded by UL listed electronic devices onto a multiplexed communication system.
  - 2. Response time between alarm initiation (contact closure) and recording at the main fire alarm control unit (appearance on alphanumeric read out) shall not exceed 5 seconds.
  - 3. The signaling line circuits (SLC) between building fire alarm control units shall be wired Style 7 in accordance with NFPA 72.

Isolation shall be provided so that no more than one building can be lost due to a short circuit fault.

4. Initiating device circuits (IDC) shall be wired Style C in accordance with NFPA 72.
5. Signaling line circuits (SLC) within buildings shall be wired Style 4 in accordance with NFPA 72. Individual signaling line circuits shall be limited to covering 22,500 square feet (2,090 square meters) of floor space or 3 floors whichever is less.
6. Notification appliance circuits (NAC) shall be wired Style Y in accordance with NFPA 72.

### **1.3 RELATED WORK**

- A. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES. Requirements for procedures for submittals.
- B. Section 07 84 00 - FIRESTOPPING. Requirements for fire proofing wall penetrations.
- C. Section 08 71 00 - DOOR HARDWARE. For combination Closer-Holders.
- D. Section 21 13 13 - WET-PIPE SPRINKLER SYSTEMS. Requirements for sprinkler systems.
- E. Section 28 05 00 - COMMON WORK RESULTS FOR ELECTRONIC SAFETY AND SECURITY. Requirements for general requirements that are common to more than one section in Division 28.
- F. Section 28 05 13 - CONDUCTORS AND CABLES FOR ELECTRONIC SAFETY AND SECURITY. Requirements for conductors and cables.
- G. Section 28 05 26 - GROUNDING AND BONDING FOR ELECTRONIC SAFETY AND SECURITY. Requirements for grounding of equipment.
- H. Section 28 05 28.33 - CONDUITS AND BACKBOXES FOR ELECTRONIC SAFETY AND SECURITY. Requirements for infrastructure.

### **1.4 SUBMITTALS**

- A. General: Submit 5 copies in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES, and Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
- B. Drawings:
  1. Prepare drawings using AutoCAD Release 14 software and include all contractors information. Layering shall be by VA criteria as provided by the Contracting Officer's Technical Representative (COTR). Bid drawing files on AutoCAD will be provided to the Contractor at the pre-construction meeting. The contractor shall be

responsible for verifying all critical dimensions shown on the drawings provided by VA.

2. Floor plans: Provide locations of all devices (with device number at each addressable device corresponding to control unit programming), appliances, panels, equipment, junction/terminal cabinets/boxes, risers, electrical power connections, individual circuits and raceway routing, system zoning; number, size, and type of raceways and conductors in each raceway; conduit fill calculations with cross section area percent fill for each type and size of conductor and raceway. Only those devices connected and incorporated into the final system shall be on these floor plans. Do not show any removed devices on the floor plans. Show all interfaces for all fire safety functions.
3. Riser diagrams: Provide, for the entire system, the number, size and type of riser raceways and conductors in each riser raceway and number of each type device per floor and zone. Show door holder interface, elevator control interface, HVAC shutdown interface, fire extinguishing system interface, and all other fire safety interfaces. Show wiring Schedules on the riser diagram for all circuits. Provide diagrams both on a per building and campus wide basis.
4. Detailed wiring diagrams: Provide for control panels, modules, power supplies, electrical power connections, auxiliary relays and annunciators showing termination identifications, size and type conductors, circuit boards, LED lamps, indicators, adjustable controls, switches, ribbon connectors, wiring harnesses, terminal strips and connectors, spare zones/circuits. Diagrams shall be drawn to a scale sufficient to show spatial relationships between components, enclosures and equipment configuration.
5. Two weeks prior to final inspection, the Contractor shall deliver to the COTR 3 sets of as-built drawings and one set of the as-built drawing computer files (using AutoCAD 2007 or later). As-built drawings (floor plans) shall show all new and/or existing conduit used for the fire alarm system.

C. Manuals:

1. Submit simultaneously with the shop drawings, companion copies of complete maintenance and operating manuals including technical data sheets for all items used in the system, power requirements, device

wiring diagrams, dimensions, and information for ordering replacement parts.

- a. Wiring diagrams shall have their terminals identified to facilitate installation, operation, expansion and maintenance.
  - b. Wiring diagrams shall indicate internal wiring for each item of equipment and the interconnections between the items of equipment.
  - c. Include complete listing of all software used and installation and operation instructions including the input/output matrix chart.
  - d. Provide a clear and concise description of operation that gives, in detail, the information required to properly operate, inspect, test and maintain the equipment and system. Provide all manufacturer's installation limitations including but not limited to circuit length limitations.
  - e. Complete listing of all digitized voice messages.
  - f. Provide standby battery calculations under normal operating and alarm modes. Battery calculations shall include the magnets for holding the doors open for one minute.
  - g. Include information indicating who will provide emergency service and perform post contract maintenance.
  - h. Provide a replacement parts list with current prices. Include a list of recommended spare parts, tools, and instruments for testing and maintenance purposes.
  - i. A computerized preventive maintenance schedule for all equipment. The schedule shall be provided on disk in a computer format acceptable to the VAMC and shall describe the protocol for preventive maintenance of all equipment. The schedule shall include the required times for systematic examination, adjustment and cleaning of all equipment. A print out of the schedule shall also be provided in the manual. Provide the disk in a pocket within the manual.
  - j. Furnish manuals in 3 ring loose-leaf binder or manufacturer's standard binder.
  - k. A print out for all devices proposed on each signaling line circuit with spare capacity indicated.
2. Two weeks prior to final inspection, deliver 4 copies of the final updated maintenance and operating manual to the COTR.

- a. The manual shall be updated to include any information necessitated by the maintenance and operating manual approval.
- b. Complete "As installed" wiring and schematic diagrams shall be included that shows all items of equipment and their interconnecting wiring. Show all final terminal identifications.
- c. Complete listing of all programming information, including all control events per device including an updated input/output matrix.
- d. Certificate of Installation as required by NFPA 72 for each building. The certificate shall identify any variations from the National Fire Alarm Code.
- e. Certificate from equipment manufacturer assuring compliance with all manufacturers installation requirements and satisfactory system operation.

D. Certifications:

- 1. Together with the shop drawing submittal, submit the technician's NICET level III fire alarm certification as well as certification from the control unit manufacturer that the proposed performer of contract maintenance is an authorized representative of the major equipment manufacturer. Include in the certification the names and addresses of the proposed supervisor of installation and the proposed performer of contract maintenance. Also include the name and title of the manufacturer's representative who makes the certification.
- 2. Together with the shop drawing submittal, submit a certification from either the control unit manufacturer or the manufacturer of each component (e.g., smoke detector) that the components being furnished are compatible with the control unit.
- 3. Together with the shop drawing submittal, submit a certification from the major equipment manufacturer that the wiring and connection diagrams meet this specification, UL and NFPA 72 requirements.

### **1.5 WARRANTY**

All work performed and all material and equipment furnished under this contract shall be free from defects and shall remain so for a period of one year from the date of acceptance of the entire installation by the Contracting Officer.



## 1.6 APPLICABLE PUBLICATIONS

- A. The publications listed below (including amendments, addenda, revisions, supplements and errata) form a part of this specification to the extent referenced. The publications are referenced in text by the basic designation only and the latest editions of these publications shall be applicable.
- B. National Fire Protection Association (NFPA):
  - NFPA 13 .....Standard for the Installation of Sprinkler Systems, 2010 edition
  - NFPA 14 .....Standard for the Installation of Standpipes and Hose Systems, 2010 edition
  - NFPA 20 .....Standard for the Installation of Stationary Pumps for Fire Protection, 2010 edition
  - NFPA 70.....National Electrical Code (NEC), 2010 edition
  - NFPA 72.....National Fire Alarm Code, 2010 edition
  - NFPA 90A.....Standard for the Installation of Air Conditioning and Ventilating Systems, 2009 edition
  - NFPA 101.....Life Safety Code, 2009 edition
- C. Underwriters Laboratories, Inc. (UL): Fire Protection Equipment Directory
- D. Factory Mutual Research Corp (FM): Approval Guide, 2007-2011
- E. American National Standards Institute (ANSI):
  - S3.41.....Audible Emergency Evacuation Signal, 1990 edition, reaffirmed 2008
- F. International Code Council, International Building Code (IBC), 2009 edition

## PART 2 - PRODUCTS

### 2.1 EQUIPMENT AND MATERIALS, GENERAL

- A. Fire alarm devices, wiring, programming, etc. shall be provided by Tyco/Simplex.
- B. Existing non-addressable equipment may be reused only where indicated on the drawings. All addressable equipment and components shall be new and the manufacturer's current model. All equipment shall be tested and listed by Underwriters Laboratories, Inc. or Factory Mutual Research Corporation for use as part of a fire alarm system. The authorized representative of the manufacturer of the major equipment shall certify that the installation complies with all manufacturer's

requirements and that satisfactory total system operation has been achieved.

## **2.2 CONDUIT, BOXES, AND WIRE**

A. Conduit shall be in accordance with Section 28 05 28.33, CONDUIT AND BACKBOXES FOR ELECTRONIC SAFETY AND SECURITY and as follows:

1. All new conduit shall be installed in accordance with NFPA 70.
2. Conduit fill shall not exceed 40 percent of interior cross sectional area.
3. All new conduit shall be 3/4 inch (19 mm) minimum.

B. Wire:

1. Wiring shall be in accordance with NEC article 760, Section 28 05 13 CONDUCTORS AND CABLES FOR ELECTRONIC SAFETY AND SECURITY, and as recommended by the manufacturer of the addressable fire alarm system to extend an existing non-addressable system. All wires shall be color coded. Number and size of conductors shall be as recommended by the fire alarm system manufacturer, but not less than 18 AWG for initiating device circuits and 14 AWG for notification device circuits.
2. Addressable circuits and wiring used for the multiplex communication loop shall be twisted and shielded unless specifically accepted by the fire alarm equipment manufacturer in writing.
3. Any fire alarm system wiring that extends outside of a building shall have additional power surge protection to protect equipment from physical damage and false signals due to lightning, voltage and current induced transients. Protection devices shall be shown on the submittal drawings and shall be UL listed or in accordance with written manufacturer's requirements.
4. All wire or cable used in underground conduits including those in concrete shall be listed for wet locations.

C. Terminal Boxes, Junction Boxes, and Cabinets:

1. Shall be galvanized steel in accordance with UL requirements.
2. All boxes shall be sized and installed in accordance with NFPA 70.
3. covers shall be repainted red in accordance with Section 09 91 00, PAINTING and shall be identified with white markings as "FA" for junction boxes and as "FIRE ALARM SYSTEM" for cabinets and terminal boxes. Lettering shall be a minimum of 3/4 inch (19 mm) high.

4. Terminal boxes and cabinets shall have a volume 50 percent greater than required by the NFPA 70. Minimum sized wire shall be considered as 14 AWG for calculation purposes.
5. Terminal boxes and cabinets shall have identified pressure type terminal strips and shall be located at the base of each riser. Terminal strips shall be labeled as specified or as approved by the COTR.

**2.3 FIRE ALARM CONTROL UNIT NOT USED.**

**2.4 STANDBY POWER SUPPLY NOT USED.**

**2.5 ANNUNCIATION NOT USED.**

**2.6 ALARM NOTIFICATION APPLIANCES**

**A. Bells:**

1. Shall be electric, single-stroke or vibrating, heavy-duty, under-dome, solenoid type.
2. Unless otherwise shown on the drawings, shall be 6 inches (150 mm) diameter and have a minimum nominal rating of 80 dBA at 10 feet (3,000 mm).
3. Mount on removable adapter plates on outlet boxes.
4. Bells located outdoors shall be weatherproof type with metal housing and protective grille.
5. Each bell circuit shall have a minimum of 20 percent spare capacity.

**B. Strobes:**

1. Xenon flash tube type minimum 15 candela in toilet rooms and 75 candela in all other areas with a flash rate of 1 HZ. Strobes shall be synchronized where required by the National Fire Alarm Code (NFPA 72).
2. Backplate shall be red with 1/2 inch (13 mm) permanent red letters. Lettering to read "Fire", be oriented on the wall or ceiling properly, and be visible from all viewing directions.
3. Each strobe circuit shall have a minimum of 20 percent spare capacity.
4. Strobes may be combined with the audible notification appliances specified herein.

**C. Horns:**

1. Shall be electric, utilizing solid state electronic technology operating on a nominal 24 VDC.
2. Shall be a minimum nominal rating of 80 dBA at 10 feet (3,000 mm).
3. Mount on removable adapter plates on conduit boxes.

4. Horns located outdoors shall be of weatherproof type with metal housing and protective grille.
5. Each horn circuit shall have a minimum of 20 percent spare capacity.

## **2.7 ALARM INITIATING DEVICES**

### **A. Manual Fire Alarm Stations:**

1. Shall be non-breakglass, address reporting type.
2. Station front shall be constructed of a durable material such as cast or extruded metal or high impact plastic. Stations shall be semi-flush type.
3. Stations shall be of single action pull down type with suitable operating instructions provided on front in raised or depressed letters, and clearly labeled "FIRE".
4. Operating handles shall be constructed of a durable material. On operation, the lever shall lock in alarm position and remain so until reset. A key shall be required to gain front access for resetting, or conducting tests and drills.
5. Unless otherwise specified, all exposed parts shall be red in color and have a smooth, hard, durable finish.
6. Stations identified as key operated only shall have a single standardized lock and key separate from the control equipment.//

### **B. Smoke Detectors:**

1. Smoke detectors shall be photoelectric type and UL listed for use with the fire alarm control unit being furnished.
2. Smoke detectors shall be addressable type complying with applicable UL Standards for system type detectors. Smoke detectors shall be installed in accordance with the manufacturer's recommendations and NFPA 72.
3. Detectors shall have an indication lamp to denote an alarm condition. Provide remote indicator lamps and identification plates where detectors are concealed from view. Locate the remote indicator lamps and identification plates flush mounted on walls so they can be observed from a normal standing position.
4. All spot type and duct type detectors installed shall be of the photoelectric type.
5. Photoelectric detectors shall be factory calibrated and readily field adjustable. The sensitivity of any photoelectric detector shall be factory set at 3.0 plus or minus 0.25 percent obscuration per foot.

6. Detectors shall provide a visual trouble indication if they drift out of sensitivity range or fail internal diagnostics. Detectors shall also provide visual indication of sensitivity level upon testing. Detectors, along with the fire alarm control units shall be UL listed for testing the sensitivity of the detectors.

C. Heat Detectors:

1. Heat detectors shall be of the addressable restorable rate compensated fixed-temperature spot type.
2. Detectors shall have a minimum smooth ceiling rating of 2,500 square feet (230 square meters).
3. Intermediate temperature rated (200 degrees F (93 degrees C)) heat detectors shall be utilized in all other areas.
4. Not Used.

D. Water Flow and Pressure Switches:

1. Wet pipe water flow switches and dry pipe alarm pressure switches for sprinkler systems shall be connected to the fire alarm system by way of an address reporting interface device.
2. All new water flow switches shall be of a single manufacturer and series and non-accumulative retard type. See Section 21 12 00, FIRE-SUPPRESSION STANDPIPES and Section 21 13 13, WET-PIPE SPRINKLER SYSTEMS for new switches added. Connect all switches shown on the approved shop drawings.
3. All new switches shall have an alarm transmission delay time that is conveniently adjustable from 0 to 60 seconds. Initial settings shall be 30-45 seconds. Timing shall be recorded and documented during testing.

E. Not Used.

## 2.8 SUPERVISORY DEVICES

A. Duct Smoke Detectors:

1. Duct smoke detectors shall be provided and connected by way of an address reporting interface device. Detectors shall be provided with an approved duct housing mounted exterior to the duct, and shall have perforated sampling tubes extending across the full width of the duct (wall to wall). Detector placement shall be such that there is uniform airflow in the cross section of the duct.
2. Interlocking with fans shall be provided in accordance with NFPA 90A and as specified hereinafter under Part 3.2, "TYPICAL OPERATION".

3. Provide remote indicator lamps, key test stations and identification nameplates (e.g. "DUCT SMOKE DETECTOR AHU-X") for all duct detectors. Locate key test stations in plain view on walls or ceilings so that they can be observed and operated from a normal standing position.

**B. Sprinkler and Standpipe System Supervisory Switches:**

1. Each sprinkler system water supply control valve, riser valve or zone control valve, and each standpipe system riser control valve shall be equipped with a supervisory switch. Standpipe hose valves, and test and drain valves shall not be equipped with supervisory switches.
2. PIV (post indicator valve) or main gate valve shall be equipped with a supervisory switch.
3. Valve supervisory switches shall be connected to the fire alarm system by way of address reporting interface device. See Section 21 13 13, WET-PIPE SPRINKLER SYSTEMS for new switches to be added. Connect tamper switches for all control valves shown on the approved shop drawings.
4. The mechanism shall be contained in a weatherproof die-cast aluminum housing that shall provide a 3/4 inch (19 mm) tapped conduit entrance and incorporate the necessary facilities for attachment to the valves.
5. The entire installed assembly shall be tamper-proof and arranged to cause a switch operation if the housing cover is removed or if the unit is removed from its mounting.
6. Where dry-pipe sprinkler systems are installed, high and low air pressure switches shall be provided and monitored by way of an address reporting interface devices.
7. Fire supervisory signals required by NFPA 20 and monitored by the pump controller shall be provided and monitored by way of address reporting interface devices for the fire pump located// indicate location.

**2.9 ADDRESS REPORTING INTERFACE DEVICE**

- A. Shall have unique addresses that reports directly to the addressable fire alarm panel.
- B. Shall be configurable to monitor normally open or normally closed devices for both alarm and trouble conditions.

- C. Shall have terminal designations clearly differentiating between the circuit to which they are reporting from and the device that they are monitoring.
- D. Shall be UL listed for fire alarm use and compatibility with the panel to which they are connected.
- E. Shall be mounted in weatherproof housings if mounted exterior to a building.

#### **2.10 SMOKE BARRIER DOOR CONTROL**

- A. Electromagnetic Door Holders:
  - 1. New Door Holders shall be standard wall mounted electromagnetic type. In locations where doors do not come in contact with the wall when in the full open position, an extension post shall be added to the door bracket.
  - 2. Operation shall be by 24 volt DC supplied from a battery located at the fire alarm control unit. Door holders shall be coordinated as to voltage, ampere drain, and voltage drop with the battery, battery charger, wiring and fire alarm system for operation as specified.
- B. A maximum of twelve door holders shall be provided for each circuit. Door holders shall be wired to allow releasing doors by smoke zone.
- C. Door holder control circuits shall be electrically supervised.
- D. Smoke detectors shall not be incorporated as an integral part of door holders.

#### **2.11 UTILITY LOCKS AND KEYS:**

- A. All key operated test switches, control units, annunciator panels and lockable cabinets shall be provided with a single standardized utility lock and key.
- B. Key-operated manual fire alarm stations shall have a single standardized lock and key separate from the control equipment.
- C. All keys shall be delivered to the COTR.

#### **2.12 SPARE AND REPLACEMENT PARTS NOT USED.**

messages.

#### **2.13 INSTRUCTION CHART:**

Provide a typewritten instruction card mounted behind a Lexan plastic or glass cover in a stainless steel or aluminum frame with a backplate. Install the frame in a conspicuous location observable from each control unit where operations are performed. The card shall show those steps to be taken by an operator when a signal is received under all conditions, normal, alarm, supervisory, and trouble. Provide an

additional copy with the binder for the input output matrix for the sequence of operation. The instructions shall be approved by the COTR before being posted.

### **PART 3 - EXECUTION**

#### **3.1 INSTALLATION:**

- A. Installation shall be in accordance with NFPA 70, 72, 90A, and 101 as shown on the drawings, and as recommended by the major equipment manufacturer. Fire alarm wiring shall be installed in conduit. All conduit and wire shall be installed in accordance with, Section 28 05 13 CONDUCTORS AND CABLES FOR ELECTRONIC SAFETY AND SECURITY, Section 28 05 26 GROUNDING AND BONDING FOR ELECTRONIC SAFETY AND SECURITY, Section 28 05 28.33 CONDUIT AND BACKBOXES FOR ELECTRONIC SAFETY AND SECURITY, and all penetrations of smoke and fire barriers shall be protected as required by Section 07 84 00, FIRESTOPPING.
- B. All conduits, junction boxes, conduit supports and hangers shall be concealed in finished areas and may be exposed in unfinished areas.
- C. All new and reused exposed conduits shall be painted in accordance with Section 09 91 00, PAINTING to match surrounding finished areas and red in unfinished areas.
- D. All existing accessible fire alarm conduit not reused shall be removed.
- E. Existing devices that are reused shall be properly mounted and installed. Where devices are installed on existing shallow backboxes, extension rings of the same material, color and texture of the new fire alarm devices shall be used. Mounting surfaces shall be cut and patched in accordance with Section 01 00 00, GENERAL REQUIREMENTS, Restoration, and be re-painted in accordance with Section 09 91 00, PAINTING as necessary to match existing.
- F. All fire detection and alarm system devices, control units and remote annunciators shall be flush mounted when located in finished areas and may be surface mounted when located in unfinished areas. Exact locations are to be approved by the COTR.
- G. Speakers shall be ceiling mounted and fully recessed in areas with suspended ceilings. Speakers shall be wall mounted and recessed in finished areas without suspended ceilings. Speakers may be surface mounted in unfinished areas.
- H. Strobes shall be flush wall mounted with the bottom of the unit located 80 inches (2,000 mm) above the floor or 6 inches (150 mm) below



ceiling, whichever is lower. Locate and mount to maintain a minimum 36 inches (900 mm) clearance from side obstructions.

- I. Manual pull stations shall be installed not less than 42 inches (1,050 mm) or more than 48 inches (1,200 mm) from finished floor to bottom of device and within 60 inches (1,500 mm) of a stairway or an exit door.
- J. Where possible, locate water flow and pressure switches a minimum of 12 inches (300 mm) from a fitting that changes the direction of the flow and a minimum of 36 inches (900 mm) from a valve.
- K. Mount valve tamper switches so as not to interfere with the normal operation of the valve and adjust to operate within 2 revolutions toward the closed position of the valve control, or when the stem has moved no more than 1/5 of the distance from its normal position.
- L. Connect flow and tamper switches installed under Section 21 13 13, WET-PIPE SPRINKLER SYSTEMS.
- M. Connect combination closer-holders installed under Section 08 71 00, DOOR HARDWARE.

### **3.2 TYPICAL OPERATION**

- A. Activation of any manual pull station, water flow or pressure switch, heat detector, gaseous suppression system, or smoke detector shall cause the following operations to occur:
  - 1. Operate the emergency voice communication system in Building. For sprinkler protected buildings, flash strobes continuously only in the zone of alarm. For buildings without sprinkler protection throughout, flash strobes continuously only on the floor of alarm.
  - 2. Continuously sound a temporal pattern general alarm and flash all strobes in the building in alarm until reset at the local fire alarm control unit in Building.
  - 3. Release only the magnetic door holders in the smoke zone on the floor from which alarm was initiated after the alert signal.
  - 4. Transmit a separate alarm signal, via the main fire alarm control unit to the fire department.
  - 5. Unlock the electrically locked exit doors within the zone of alarm.
- B. Heat detectors in elevator machine rooms shall, in addition to the above functions, disconnect all power to all elevators served by that machine room after a time delay. The time delay shall be programmed within the fire alarm system programming and be equal to the time it takes for the car to travel from the highest to the lowest level, plus 10 seconds.

- C. Not Used.
- D. Not Used.
- E. Operation of a smoke detector at a corridor door used for automatic closing shall also release only the magnetic door holders on that floor in that smoke zone. Operation of a smoke detector at a shutter used for automatic closing shall also release only the shutters on that floor in that smoke zone.
- F. Operation of duct smoke detectors shall cause a system supervisory condition and shut down the ventilation system and close the associated smoke dampers as appropriate.
- G. Operation of any sprinkler or standpipe system valve supervisory switch, high/low air pressure switch, or fire pump alarm switch shall cause a system supervisory condition.
- H. Alarm verification shall not be used for smoke detectors installed for the purpose of early warning.

### 3.3 TESTS

- A. Provide the service of a NICET level III, competent, factory-trained engineer or technician authorized by the manufacturer of the fire alarm equipment to technically supervise and participate during all of the adjustments and tests for the system. Make all adjustments and tests in the presence of the COTR.
- B. When the systems have been completed and prior to the scheduling of the final inspection, furnish testing equipment and perform the following tests in the presence of the COTR. When any defects are detected, make repairs or install replacement components, and repeat the tests until such time that the complete fire alarm systems meets all contract requirements. After the system has passed the initial test and been approved by the COTR, the contractor may request a final inspection.
  - 1. Before energizing the cables and wires, check for correct connections and test for short circuits, ground faults, continuity, and insulation.
  - 2. Test the insulation on all installed cable and wiring by standard methods as recommended by the equipment manufacturer.
  - 3. Run water through all flow switches. Check time delay on water flow switches. Submit a report listing all water flow switch operations and their retard time in seconds.
  - 4. Open each alarm initiating and notification circuit to see if trouble signal actuates.

5. Ground each alarm initiation and notification circuit and verify response of trouble signals.

### **3.4 FINAL INSPECTION AND ACCEPTANCE**

- A. Prior to final acceptance a minimum 30 day "burn-in" period shall be provided. The purpose shall be to allow equipment to stabilize and potential installation and software problems and equipment malfunctions to be identified and corrected. During this diagnostic period, all system operations and malfunctions shall be recorded. Final acceptance will be made upon successful completion of the "burn-in" period and where the last 14 days is without a system or equipment malfunction.
- B. At the final inspection a factory trained representative of the manufacturer of the major equipment shall repeat the tests in Article 3.3 TESTS and those required by NFPA 72. In addition the representative shall demonstrate that the systems function properly in every respect. The demonstration shall be made in the presence of a VA representative.

### **3.5 INSTRUCTION**

- A. The manufacturer's authorized representative shall provide instruction and training to the VA as follows:
  1. Six 1-hour sessions to engineering staff, security police and central attendant personnel for simple operation of the system. Two sessions at the start of installation, 2 sessions at the completion of installation and 2 sessions 3 months after the completion of installation.
  2. Four 2-hour sessions to engineering staff for detailed operation of the system. Two sessions at the completion of installation and 2 sessions 3 months after the completion of installation.
  3. Three 8-hour sessions to electrical technicians for maintaining, programming, modifying, and repairing the system at the completion of installation and one 8-hour refresher session 3 months after the completion of installation.
- B. The Contractor and/or the Systems Manufacturer's representative shall provide a typewritten "Sequence of Operation" including a trouble shooting guide of the entire system for submittal to the VA. The sequence of operation will be shown for each input in the system in a matrix format and provided in a loose leaf binder. When reading the sequence of operation, the reader will be able to quickly and easily determine what output will occur upon activation of any input in the

system. The INPUT/OUTPUT matrix format shall be as shown in Appendix A to NFPA 72.

- C. Furnish the services of a competent instructor for instructing personnel in the programming requirements necessary for system expansion. Such programming shall include addition or deletion of devices, zones, indicating circuits and printer/display text.

#### **PART 4 - SCHEDULES**

##### **4.1 SMOKE ZONE DESCRIPTIONS:**

##### **4.2 DIGITIZED VOICE MESSAGES:**

- A. Digitized voice messages shall be provided for each smoke zone of Building. The messages shall be arranged with a 3 second alert tone, a "Code Red" message and a description of the fire alarm area (building number, floor, level and smoke zone). A sample of such a message is as follows:

Alert Tone

Code Red

Building One, Second Floor, East Wing

Code Red

Building One, Second Floor, East Wing

Code Red

Building One, Second Floor, East Wing

##### **4.3 LOCATION OF VOICE MESSAGES:**

Upon receipt of an alarm signal from the building fire alarm system, the voice communication system shall automatically transmit a 3 second tone alert and a pre-recorded fire alarm message throughout the building .

- - END - -

### 3.4 FINAL INSPECTION AND ACCEPTANCE

- A. Prior to final acceptance a minimum 30 day "burn-in" period shall be provided. The purpose shall be to allow equipment to stabilize and potential installation and software problems and equipment malfunctions to be identified and corrected. During this diagnostic period, all system operations and malfunctions shall be recorded. Final acceptance will be made upon successful completion of the "burn-in" period and where the last 14 days is without a system or equipment malfunction.
- B. At the final inspection a factory trained representative of the manufacturer of the major equipment shall repeat the tests in Article 3.3 TESTS and those required by NFPA 72. In addition the representative shall demonstrate that the systems function properly in every respect. The demonstration shall be made in the presence of a VA representative.

### 3.5 INSTRUCTION

- A. The manufacturer's authorized representative shall provide instruction and training to the VA as follows:
  - 1. Six 1-hour sessions to engineering staff, security police and central attendant personnel for simple operation of the system. Two sessions at the start of installation, 2 sessions at the completion of installation and 2 sessions 3 months after the completion of installation.
  - 2. Four 2-hour sessions to engineering staff for detailed operation of the system. Two sessions at the completion of installation and 2 sessions 3 months after the completion of installation.
  - 3. Three 8-hour sessions to electrical technicians for maintaining, programming, modifying, and repairing the system at the completion of installation and one 8-hour refresher session 3 months after the completion of installation.
- B. The Contractor and/or the Systems Manufacturer's representative shall provide a typewritten "Sequence of Operation" including a trouble shooting guide of the entire system for submittal to the VA. The sequence of operation will be shown for each input in the system in a matrix format and provided in a loose leaf binder. When reading the sequence of operation, the reader will be able to quickly and easily determine what output will occur upon activation of any input in the system. The INPUT/OUTPUT matrix format shall be as shown in Appendix A to NFPA 72.

- C. Furnish the services of a competent instructor for instructing personnel in the programming requirements necessary for system expansion. Such programming shall include addition or deletion of devices, zones, indicating circuits and printer/display text.

#### **PART 4 - SCHEDULES**

##### **4.1 SMOKE ZONE DESCRIPTIONS:**

##### **4.2 DIGITIZED VOICE MESSAGES:**

- A. Digitized voice messages shall be provided for each smoke zone of Building. The messages shall be arranged with a 3 second alert tone, a "Code Red" message and a description of the fire alarm area (building number, floor, level and smoke zone). A sample of such a message is as follows:

Alert Tone

Code Red

Building One, Second Floor, East Wing

Code Red

Building One, Second Floor, East Wing

Code Red

Building One, Second Floor, East Wing

##### **4.3 LOCATION OF VOICE MESSAGES:**

Upon receipt of an alarm signal from the building fire alarm system, the voice communication system shall automatically transmit a 3 second tone alert and a pre-recorded fire alarm message throughout the building .

- - END - -

**SECTION 31 20 11**  
**EARTHWORK (SHORT FORM)**

**PART 1 - GENERAL**

**1.1:DESCRIPTION:**

This section specifies the requirements for furnishing all equipment, materials, labor and techniques for earthwork including excavation, fill, backfill and site restoration utilizing fertilizer, and sod.

**1.2 DEFINITIONS:**

A. Unsuitable Materials:

1. Fills: Topsoil, frozen materials; construction materials and materials subject to decomposition; clods of clay and stones larger than 75 mm (3 inches); organic materials, including silts, which are unstable; and inorganic materials, including silts, too wet to be stable.
2. Existing Subgrade (except footings): Same materials as above paragraph, that are not capable of direct support of slabs, pavement, and similar items, with the possible exception of improvement by compaction, proofrolling, or similar methods of improvement.
3. Existing Subgrade (footings only): Same as Paragraph 1, but no fill or backfill. If materials differ from // reference borings and // design requirements, excavate to acceptable strata subject to Resident Engineer's approval.

B. Earthwork: Earthwork operations required within the new construction area. It also includes earthwork required for auxiliary structures and buildings and sewer and other trenchwork throughout the job site.

C. Degree of Compaction: Degree of compaction is expressed as a percentage of maximum density obtained by the test procedure presented in ASTM D698 or D1557.

D. The term fill means fill or backfill as appropriate.

**1.3 RELATED WORK:**

- A. Materials testing and inspection during construction: Section 01 45 29, TESTING LABORATORY SERVICES.
- B. Safety Requirements: Section 00 72 00, GENERAL CONDITIONS, Article, ACCIDENT PREVENTION.
- C. Protection of existing utilities, fire protection services, existing equipment, roads, and pavements: Section 01 00 00, GENERAL REQUIREMENTS.

**D. SUBSURFACE INVESTIGATION: SECTION 01 00 00, GENERAL REQUIREMENTS, ARTICLE, PHYSICAL DATA.1.4 CLASSIFICATION OF EXCAVATION:**

- A. Unclassified Excavation: Removal and disposal of pavements and other man-made obstructions visible on the surface; utilities, and other items including underground structures indicated to be demolished and removed; together with any type of materials regardless of character of material and obstructions encountered.
- B. Classified Excavation: Removal and disposal of all material not defined as rock.
- C. Rock Excavation:
  - 1. Solid ledge rock (igneous, metamorphic, and sedimentary rock).
  - 2. Bedded or conglomerate deposits so cemented as to present characteristics of solid rock which cannot be excavated without blasting; or the use of a modern power excavator (shovel, backhoe, or similar power excavators) of no less than 0.75 m<sup>3</sup> (1 cubic yard) capacity, properly used, having adequate power and in good running condition.
  - 3. Boulders or other detached stones each having a volume of 0.4 m<sup>3</sup> (1/2 cubic yard) or more.

**1.5 MEASUREMENT AND PAYMENT FOR EXCAVATION:**

Measurement: The unit of measurement for excavation and borrow will be the cubic yard, computed by the average end area method from cross sections taken before and after the excavation and borrow operations, including the excavation for ditches, gutters, and channel changes, when the material is acceptably utilized or disposed of as herein specified. Quantities should be computed by a Registered Professional Land Surveyor or Registered Civil Engineer, specified in Section 01 00 00, GENERAL REQUIREMENTS. The measurement will include authorized excavation for rock and authorized excavation of satisfactory subgrade soil. The measurement will not include the volume of subgrade material or other material used for purposes other than directed. The volume of overburden stripped from borrow pits and the volume of excavation for ditches to drain borrow pits, unless used as borrow material, will not be measured for payment. The measurement will not include the volume of any excavation performed prior to taking of elevations and measurements of the undisturbed grade.

**1.6 MEASUREMENT AND PAYMENT FOR ROCK EXCAVATION:**

- A. Measurement: Cross section and measure the uncovered and separated materials, and compute quantities by the Registered Professional Land Surveyor or Registered Civil Engineer, specified in Section 01 00 00,



GENERAL REQUIREMENTS. Do not measure quantities beyond the following limits:

1. 300 mm (12 inches) outside of the perimeter of formed footings.
  2. 600 mm (24 inches) outside the face of concrete work for which forms are required, except for footings.
  3. 150 mm (6 inches) below the bottom of pipe and not more than the pipe diameter plus 600 mm (24 inches) in width for pipe trenches.
  4. The outside dimensions of concrete work for which no forms are required (trenches, conduits, and similar items not requiring forms).
- B. Payment for Differing Site Conditions: When rock excavation, as classified, is encountered, the contract price and time will be adjusted in accordance with Articles, DIFFERING SITE CONDITIONS, CHANGES and CHANGES-SUPPLEMENT of the GENERAL CONDITIONS as applicable.

**1.7 SUBMITTALS:**

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Rock Excavation Report:
  1. Certification of rock quantities excavated.
  2. Excavation method.
  3. Labor.
  4. Equipment.
  5. Land Surveyor's or Civil Engineer's name and official registration stamp.
  6. Plot plan showing elevations.
- C. Contractor shall submit procedure and location for disposal of unused satisfactory material. Proposed source of borrow material. Notification of encountering rock in the project. Advance notice on the opening of excavation or borrow areas. Advance notice on shoulder construction for rigid pavements.
- E. Qualifications of the commercial testing laboratory or Contractor's Testing facility shall be submitted.

**1.8 APPLICABLE PUBLICATIONS:**

- A. Publications listed below form a part of this specification to the extent referenced. Publications are referenced in the text by the basic designation only.
- B. American Nursery and Landscape Association (ANLA):  
2004.....American Standard for Nursery Stock
- C. American Association of State Highway and Transportation Officials (AASHTO):

- T99-10.....Moisture-Density Relations of Soils Using a 2.5  
kg (5.5 lb) Rammer and a 305 mm (12 inch) Drop
- T180-10.....Standard Method of Test for Moisture-Density  
Relations of Soils Using a 4.54-kg [10 lb]  
Rammer and a 457 mm (18 inch) Drop
- D. American Society for Testing and Materials (ASTM):
- C33-03.....Concrete Aggregate
- D698-e1.....Laboratory Compaction Characteristics of Soil  
Using Standard Effort
- D1140-00.....Amount of Material in Soils Finer than the No.  
200 (75-micrometer) Sieve
- D1556-00.....Standard Test Method for Density and Unit Weight  
of Soil in Place by the Sand-Cone Method
- D1557-09.....Laboratory Compaction Characteristics of Soil  
Using Modified Effort
- D2167-94 (2001).....Standard Test Method for Density and Unit Weight  
of Soil in Place by the Rubber Balloon Method
- D2487-06.....Standard Classification of Soil for Engineering  
Purposes (Unified Soil Classification System)
- D6938-10.....Standard Test Methods for Density of Soil and  
Soil-Aggregate in Place by Nuclear Methods  
(Shallow Depth)
- E. Standard Specifications of Statewide Urban Design and Specification,  
latest revision.

## **PART 2 - PRODUCTS**

### **2.1 MATERIALS:**

- A. Fills: Materials approved from on site and off site sources having a minimum dry density of 1760 kg/m<sup>3</sup> (110 pcf), a maximum Plasticity Index of 6, and a maximum Liquid Limit of 30.
- B. Granular Fill:
1. Under concrete slab, granular fill shall consist of clean, poorly graded crushed rock, crushed gravel, or uncrushed gravel placed beneath a building slab with or without a vapor barrier to cut off the capillary flow of pore water to the area immediately below. Fine aggregate grading shall conform to ASTM C33 with a maximum of 3 percent by weight passing ASTM D1140, 75 micrometers (No. 200) sieve.
  2. Bedding for sanitary and storm sewer pipe, crushed stone or gravel graded from 13 mm (1/2 inch) to 4.75 mm (No. 4).

- C. Fertilizer: (5-10-5) delivered to site in unopened containers that clearly display the manufacturer's label, indicating the analysis of the contents.
- D. Sod: Comparable species with existing turf. Use State Certified or State Approved sod when available. Deliver sod to site immediately after cutting and in a moist condition. Thickness of cut must be 19 mm to 32 mm (3/4 inch to 1 1/4 inches) excluding top growth. There shall be no broken pads and torn or uneven ends.
- E. Requirements For Offsite Soils: Offsite soils brought in for use as backfill shall be tested for TPH, BTEX and full TCLP including ignitability, corrosivity and reactivity. Backfill shall contain less than 100 parts per million (ppm) of total hydrocarbons (TPH) and less than 10 ppm of the sum of Benzene, Toluene, Ethyl Benzene, and Xylene (BTEX) and shall not fail the TCLP test. TPH concentrations shall be determined by using EPA 600/4-79/020 Method 418.1. BTEX concentrations shall be determined by using EPA SW-846.3-3a Method 5030/8020. TCLP shall be performed in accordance with EPA SW-846.3-3a Method 1311. Provide Borrow Site Testing for TPH, BTEX and TCLP from a composite sample of material from the borrow site, with at least one test from each borrow site. Material shall not be brought on site until tests have been approved by the Resident Engineer.

### **PART 3 - EXECUTION**

#### **3.1 SITE PREPARATION:**

- A. Clearing: Clearing within the limits of earthwork operations as described or designated by the Resident Engineer. Work includes removal of trees, shrubs, fences, foundations, incidental structures, paving, debris, trash and any other obstructions. Remove materials from the Medical Center.
- B. Grubbing: Remove stumps and roots 75 mm (3 inches) and larger diameter. Undisturbed sound stumps, roots up to 75 mm (3 inches) diameter, and nonperishable solid objects which will be a minimum of 900 mm (3 feet) below subgrade or finished embankment may be left.
- C. Trees and Shrubs: Trees and shrubs, not shown for removal, may be removed from the areas within 4500 mm (15 feet) of new construction and 2250 mm (7'-6") of utility lines if such removal is approved in advance by the Resident Engineer. Remove materials from the Medical Center. Box, and otherwise protect from damage, existing trees and shrubs which are not shown to be removed in the construction area. Repair immediately

damage to existing trees and shrubs by trimming, cleaning and painting damaged areas, including the roots, in accordance with standard industry horticultural practice for the geographic area and plant species.

Building materials shall not be stored closer to trees and shrubs that are to remain, than the farthest extension of their limbs.

- D. Stripping Topsoil: Unless otherwise indicated on the drawings, the limits of earthwork operations shall extend anywhere the existing grade is filled or cut or where construction operations have compacted or otherwise disturbed the existing grade or turf. Strip topsoil as defined herein, or as indicated in the geotechnical report, from within the limits of earthwork operations as specified above unless specifically indicated or specified elsewhere in the specifications or shown on the drawings. Topsoil shall be fertile, friable, natural topsoil of loamy character and characteristic of the locality. Topsoil shall be capable of growing healthy horticultural crops of grasses. Stockpile topsoil and protect as directed by the Resident Engineer. Eliminate foreign material, such as weeds, roots, stones, subsoil, frozen clods, and similar foreign materials, larger than 0.014 m<sup>3</sup> (1/2 cubic foot) in volume, from soil as it is stockpiled. Retain topsoil on the station. Remove foreign materials larger than 50 mm (2 inches) in any dimension from topsoil used in final grading. Topsoil work, such as stripping, stockpiling, and similar topsoil work, shall not, under any circumstances, be carried out when the soil is wet so that the tilth of the soil will be destroyed.

1. Concrete Slabs and Paving: Score deeply or saw cut to insure a neat, straight cut, sections of existing concrete slabs and paving to be removed where excavation or trenching occurs. Extend pavement section to be removed a minimum of 300 mm (12 inches) on each side of widest part of trench excavation and insure final score lines are approximately parallel unless otherwise indicated. Remove material from the Medical Center.

- E. Disposal: All materials removed from the property shall be disposed of at a legally approved site, for the specific materials, and all removals shall be in accordance with all applicable Federal, State and local regulations. No burning of materials is permitted onsite.

### **3.2 EXCAVATION:**

- A. Shoring, Sheet piling and Bracing: Shore, brace, or slope to its angle of repose banks of excavations to protect workmen, banks, adjacent paving, structures, and utilities, in compliance with OSHA requirements.

1. Extend shoring and bracing to the bottom of the excavation. Shore excavations that are carried below the elevations of adjacent existing foundations.
  2. If the bearing of any foundation is disturbed by excavating, improper shoring or removal of shoring, placing of backfill, and similar operations, provide a concrete fill support // in compliance with Specification Section 31 23 23.33, FLOWABLE FILL, // under disturbed foundations, as directed by Resident Engineer, at no additional cost to the Government. Do not remove shoring until permanent work in excavation has been inspected and approved by Resident Engineer.
- B. Excavation Drainage: Operate pumping equipment, and/or provide other materials, means and equipment as required, to keep excavations free of water and subgrades dry, firm, and undisturbed until approval of permanent work has been received from Resident Engineer. Approval by the Resident Engineer is also required before placement of the permanent work on all subgrades. When subgrade for foundations has been disturbed by water, remove the disturbed material to firm undisturbed material after the water is brought under control. Replace disturbed subgrade in trenches by mechanically tamped sand or gravel. Groundwater flowing toward or into excavations shall be controlled to prevent sloughing of excavation slopes and walls, boils, uplift and heave in the excavation and to eliminate interference with orderly progress of construction. French drains, sumps, ditches or trenches will not be permitted within 0.9 m (3 feet) of the foundation of any structure, except with specific written approval, and after specific contractual provisions for restoration of the foundation area have been made. Control measures shall be taken by the time the excavation reaches the water level in order to maintain the integrity of the in situ material. While the excavation is open, the water level shall be maintained continuously, at least 2 feet below the working level.
- C. Blasting: Blasting shall not be permitted.
- D. Building Earthwork:
1. Excavation shall be accomplished as required by drawings and specifications.
  2. Excavate foundation excavations to solid undisturbed subgrade.
  3. Remove loose or soft material to solid bottom.
  4. Fill excess cut under footings or foundations with 25 MPa (3000 psi) concrete, poured separately from the footings.
  3. Do not tamp earth for backfilling in footing bottoms, except as specified.

E. Trench Earthwork:1. Sanitary and storm sewer trenches:

- a. Trench width below a point 150 mm (6 inches) above top of the pipe shall be 600 mm (24 inches) for up to and including 300 mm (12 inches) diameter. Width of trench above that level shall be as necessary for sheeting and bracing and proper performance of the work.
- b. The bottom quadrant of the pipe shall be bedded on suitable undisturbed soil or granular fill. Unstable material removed from the bottom of the trench or excavation shall be replaced with select granular material placed in layers not exceeding 150 mm (6 inches) loose thickness.
  - 1) Undisturbed: Bell holes shall be no larger than necessary for jointing. Backfill up to a point 300 mm (12 inches) above top of pipe shall be clean earth placed and tamped by hand.
  - 2) Granular Fill: Depth of fill shall be a minimum of 75 mm (3 inches) plus one-sixth of pipe diameter below the pipe of 300 mm (12 inches) above top of pipe. Place and tamp fill material by hand.
- c. Place and compact as specified the remainder of backfill using acceptable excavated materials. Do not use unsuitable materials.
- d. Use granular fill for bedding where rock or rocky materials are excavated.
- e. Provide buried utility lines with utility identification tape. Bury tape 300 mm (12 inches) below finished grade; under pavements and slabs, bury tape 150 mm (6 inches) below top of subgrade
- g. Bedding shall be of the type and thickness shown. Initial backfill material shall be placed and compacted with approved tampers to a height of at least one foot above the utility pipe or conduit. The backfill shall be brought up evenly on both sides of the pipe for the full length of the pipe. Care shall be taken to ensure thorough compaction of the fill under the haunches of the pipe. Except as specified otherwise in the individual piping section, provide bedding for buried piping in accordance with AWWA C600, Type 4, except as specified herein. Backfill to top of pipe shall be compacted to 95 percent of ASTM D698 maximum density. Plastic piping shall have bedding to spring line of pipe. Provide materials as follows:
  - 1) Class I: Angular, 6 to 40 mm (0.25 to 1.5 inches), graded stone, including a number of fill materials that have regional

significance such as coral, slag, cinders, crushed stone, and crushed shells.

- 2) Class II: Coarse sands and gravels with maximum particle size of 40 mm (1.5 inches), including various graded sands and gravels containing small percentages of fines, generally granular and noncohesive, either wet or dry. Soil Types GW, GP, SW, and SP are included in this class as specified in ASTM D2487.

F. Site Earthwork: Excavation shall be accomplished as required by drawings and specifications. Remove subgrade materials that are determined by the Resident Engineer as unsuitable, and replace with acceptable material. If there is a question as to whether material is unsuitable or not, the Contractor shall obtain samples of the material, under the direction of the Resident Engineer, and the materials shall be examined by an independent testing laboratory for soil classification to determine whether it is unsuitable or not. When unsuitable material is encountered and removed, the contract price and time will be adjusted in accordance with Articles, DIFFERING SITE CONDITIONS, CHANGES and CHANGES-SUPPLEMENT of the GENERAL CONDITIONS as applicable. Adjustments to be based on meters (yardage) in cut section only.

G. Finished elevation of subgrade shall be as follows:

1. Pavement Areas - bottom of the pavement or base course as applicable.
2. Planting and Lawn Areas - 100 mm (4 inches) below the finished grade, unless otherwise specified or indicated on the drawings.

### **3.3 FILLING AND BACKFILLING:**

- A. General: Do not fill or backfill until all debris, unsatisfactory soil materials, obstructions, and deleterious materials have been removed from the excavation. Proof-roll exposed subgrades with a fully loaded dump truck. Use excavated materials or borrow for fill and backfill, as applicable. Do not use unsuitable excavated materials. Do not backfill until foundation walls have been completed above grade and adequately braced, waterproofing or dampproofing applied, and pipes coming in contact with backfill have been installed, and inspected and approved by Resident Engineer.
- C. Placing: Place material in horizontal layers not exceeding 200 mm (8 inches) in loose depth and then compacted. Do not place material on surfaces that are muddy, frozen, or contain frost.

- D. Compaction: Use approved equipment (hand or mechanical) well suited to the type of material being compacted. Do not operate mechanized vibratory compaction equipment within 3000 mm (10 feet) of new or existing building walls without the prior approval of the Resident Engineer. Moisten or aerate material as necessary to provide the moisture content that will readily facilitate obtaining the specified compaction with the equipment used. Compact each layer to not less than 95 percent of the maximum density determined in accordance with the following test method ASTM D698. Backfill adjacent to any and all types of structures shall be placed and compacted to at least 90 percent laboratory maximum density for cohesive materials or 95 percent laboratory maximum density for cohesionless materials to prevent wedging action or eccentric loading upon or against the structure.
- E. Borrow Material: Borrow material shall be selected to meet the requirements and conditions of the particular fill or embankment for which it is to be used. Borrow material shall be obtained from the borrow areas from approved private sources. Unless otherwise provided in the contract, the Contractor shall obtain from the owners the right to procure material, pay royalties and other charges involved, and bear the expense of developing the sources, including rights-of-way for hauling. Borrow material from approved sources on Government-controlled land may be obtained without payment of royalties. Unless specifically provided, no borrow shall be obtained within the limits of the project site without prior written approval. Necessary clearing, grubbing, and satisfactory drainage of borrow pits and the disposal of debris thereon shall be considered related operations to the borrow excavation.
- F. Opening and Drainage of Excavation and Borrow Pits: The Contractor shall notify the Resident Engineer sufficiently in advance of the opening of any excavation or borrow pit to permit elevations and measurements of the undisturbed ground surface to be taken. Except as otherwise permitted, borrow pits and other excavation areas shall be excavated providing adequate drainage. Overburden and other spoil material shall be transported to designated spoil areas or otherwise disposed of as directed. Borrow pits shall be neatly trimmed and drained after the excavation is completed. The Contractor shall ensure that excavation of any area, operation of borrow pits, or dumping of spoil material results in minimum detrimental effects on natural environmental conditions.

#### **3.4 GRADING:**

- A. General: Uniformly grade the areas within the limits of this section, including adjacent transition areas. Smooth the finished surface within



specified tolerance. Provide uniform levels or slopes between points where elevations are indicated, or between such points and existing finished grades. Provide a smooth transition between abrupt changes in slope.

- B. Cut rough or sloping rock to level beds for foundations. In unfinished areas fill low spots and level off with coarse sand or fine gravel.
- C. Slope backfill outside the building away from the building walls for a minimum distance of 3048 mm (10 feet) at a minimum five percent (5%) slope.
- D. The finished grade shall be 150 mm (6 inches) below bottom line of windows or other building wall openings unless greater depth is shown.
- E. Place crushed stone or gravel fill under concrete slabs on grade tamped and leveled. The thickness of the fill shall be 150 mm (6 inches), unless otherwise indicated.
- F. Finish subgrade in a condition acceptable to the Resident Engineer at least one day in advance of the paving operations. Maintain finished subgrade in a smooth and compacted condition until the succeeding operation has been accomplished. Scarify, compact, and grade the subgrade prior to further construction when approved compacted subgrade is disturbed by contractor's subsequent operations or adverse weather.
- G. Grading for Paved Areas: Provide final grades for both subgrade and base course to +/- 6 mm (0.25 inches) of indicated grades.

### **3.5 LAWN AREAS:**

- A. General: Harrow and till to a depth of 100 mm (4 inches), new or existing lawn areas to remain, which are disturbed during construction. Establish existing or design grades by dragging or similar operations. Do not carry out lawn areas earthwork out when the soil is wet so that the tilth of the soil will be destroyed. Plant bed must be approved by Resident Engineer before seeding or sodding operation begins.
- B. Finished Grading: Begin finish grading after rough grading has had sufficient time for settlement. Scarify subgrade surface in lawn areas to a depth of 100 mm (4 inches). Apply topsoil so that after normal compaction, dragging and raking operations (to bring surface to indicated finish grades) there will be a minimum of 100 mm (4 inches) of topsoil over all lawn areas; make smooth, even surface and true grades, which will not allow water to stand at any point. Shape top and bottom of banks to form reverse curves in section; make junctions with undisturbed areas to conform to existing topography. Solid lines within grading limits indicate finished contours. Existing contours, indicated

by broken lines are believed approximately correct but are not guaranteed.

- C. Fertilizing: Incorporate fertilizer into the soil to a depth of 100 mm (4 inches) at a rate of 12 kg/100 m<sup>2</sup> (25 pounds per 1000 square feet).
- D. Sodding: Topsoil shall be firmed by rolling and during periods of high temperature the topsoil shall be watered lightly immediately prior to laying sod. Sod strips shall be tightly butted at the ends and staggered in a running bond fashion. Placement on slopes shall be from the bottom to top of slope with sod strips running across slope. Secure sodded slopes by pegging or other approved methods. Roll sodded area with a roller not to exceed 225 kg/m (150 pounds per foot) of the roller width to improve contact of sod with the soil.
- E. Watering: The Resident Engineer is responsible for having adequate water available at the site. As sodding is completed in any one section, the entire sodded area shall be thoroughly irrigated by the contractor, to a sufficient depth, that the underside of the new sod pad and soil, immediately below sod, is thoroughly wet. Resident Engineer will be responsible for sod after installation and acceptance.

**3.6 DISPOSAL OF UNSUITABLE AND EXCESS EXCAVATED MATERIAL:**

- A. Disposal: Remove surplus satisfactory soil and waste material, including unsatisfactory soil, trash, and debris, and legally dispose of it off Medical Center property.
  - 1. Remove waste material, including unsatisfactory soil, trash, and debris, and legally dispose of it off Medical Center property.
- B. Place excess excavated materials suitable for fill and/or backfill on site where directed.
- C. Remove from site and dispose of any excess excavated materials after all fill and backfill operations have been completed.
- D. Segregate all excavated contaminated soil designated by the Resident Engineer from all other excavated soils, and stockpile on site on two 0.15 mm (6 mil) polyethylene sheets with a polyethylene cover. A designated area shall be selected for this purpose. Dispose of excavated contaminated material in accordance with State and Local requirements.

**3.7 CLEAN-UP:**

Upon completion of earthwork operations, clean areas within contract limits, remove tools, and equipment. Provide site clear, clean, free of debris, and suitable for subsequent construction operations. Remove debris, rubbish, and excess material from the Medical Center.

- - - E N D - - -

**SECTION 31 63 26  
DRILLED CAISSONS**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

This section specifies excavation and concrete required for construction of foundation caissons.

**1.2 DEFINITIONS**

Satisfactory Bearing Material: Limestone bedrock and is assumed to occur at bottom of caisson elevations shown.

**1.3 RELATED WORK**

- A. Materials testing and inspection during construction: Section 01 45 29, TESTING LABORATORY SERVICES.
- B. Safety requirements and blasting operations: Section 00 72 00, GENERAL CONDITIONS, Article, ACCIDENT PREVENTION.
- C. Subsurface Investigation: Section 01 00 00, GENERAL REQUIREMENTS, Article, PHYSICAL DATA
- D. Concrete, including materials and mixes: Section 03 30 00, CAST-IN-PLACE CONCRETE.

**1.4 CONTRACT BASIS**

- A. Contract price for caissons will be based upon total length for each type of caisson shown and number of caisson load tests indicated in the Contract Documents. Length of caissons will be measured from bottom elevation to top elevation of the caisson. The diameter of the caisson is defined as the minimum diameter of the shaft.
  - 1. Adjustment of contract price shall be based upon total length of each type of caisson placed and not on the length of individual caissons. When the total length of each type of completed caisson is greater or less than the length shown due to unsuitable soils or design modifications by the Project Manager, contract price adjustment will be made in accordance with Articles, DIFFERING SITE CONDITIONS, CHANGES and CHANGES-SUPPLEMENT of the GENERAL CONDITIONS as applicable.
  - 2. Contract price and time will be adjusted in accordance with Articles, DIFFERING SITE CONDITIONS, CHANGES and CHANGES-SUPPLEMENT

of the GENERAL CONDITIONS as applicable, when artificial materials that are not shown are encountered.

#### **1.5 CLASSIFICATION OF EXCAVATION**

**A. Soil/Weathered Rock Excavation:**

Soil or weathered rock that can be reasonably excavated with the rock auger, i.e. rock auger advancement greater than 150 mm (6 inches) per 15 minutes (see rock auger refusal, 1.5.C-2, below)

**B. Sloping Weathered Rock Excavation:**

Excavation of soil/weathered rock that can typically be excavated with the rock auger, except when the steeply sloping orientation of the stratum causes the rock auger to run askew.

**C. Rock Excavation:**

1. Excavation of material that meets the rock auger refusal criteria and requires the rock core barrel or other hard rock excavation techniques for removal.
2. Rock auger refusal is defined as a penetration rate of less than 150 mm (6 inches) in 15 minutes, while operating a caisson drilling rig, rated with a torque capacity of at least 110 kN-meters (1,000,000 inch-pounds), applying a continuous down pressure of at least 220 kN (50,000 pounds), equipped with a rock auger that contains conical carbide-tipped ("Kennemetal") teeth.

**D. Nominal Soil or Weathered Rock Seams:**

Nominal soil or weathered rock seams below rock auger refusal will be excavated and considered as rock for rock excavation quantities. A nominal soil or weathered rock seam is one which is less than 600 mm (2 feet) thick. Where soil or weathered rock seams or voids of 600 mm (2 feet) or greater are excavated within a mixed rock/soil or rock/weathered rock profile, excavation is classified as soil/weathered rock excavation until rock auger refusal is again established.

#### **1.6 MEASUREMENT AND PAYMENT FOR ROCK EXCAVATION**

- A. Measurement:** Excavation type in units of length shall be considered to change at the upper contact with a different excavation type as defined by section 1.5.
- B. Payment:** Contract unit rates per length of each type of caisson shall be provided for each excavation condition type noted above in Section 1.5. Contract price and time will be adjusted for overruns or

underruns in accordance with Articles, DIFFERING SITE CONDITIONS, CHANGES and CHANGES-SUPPLEMENT of the GENERAL CONDITIONS as applicable.

- C. Payment for Differing Site Conditions: No payment will be made for any rock excavation beyond caisson limits unless additional excavation is directed by the Project Manager. When rock excavation, as classified, is encountered, contract price and time will be adjusted in accordance with Articles, DIFFERING SITE CONDITIONS, CHANGES and CHANGES-SUPPLEMENT of the GENERAL CONDITIONS as applicable.

#### **1.7 TOLERANCES**

Install caissons with not more than the lesser of 1/24th of caisson shaft diameter or 75 mm (3 inches) from design center location.

Caissons shall not be out of plumb more than 25 mm (1 inch) in 3000 mm (10 feet) for the full depth. Cross sections of shafts and bells shall not be less than design dimensions. Batter caissons shall be installed a maximum of 2 percent of length from specified inclination.

#### **1.8 SUBMITTALS**

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Before beginning work, submit a detailed location plan and description of the proposed method of caisson installation, all of which shall be subject to the review and approval of the Project Manager.
- C. Shop Drawings shall comply with ACI 315 "Manual of Standard Practice for Detailing Reinforced Concrete Structures". Furnish shop drawings prepared by a Professional Engineer licensed in the State of the project for the detailing, fabricating, bending, and placing of concrete reinforcement.
- D. Submit a detailed plan showing load test arrangement, location, and Contractor's qualifications and results for review and approval by the Project Manager.
- E. Reports:
1. Caisson record: Data as specified.
  2. Rock excavation: Data as specified.
  3. Soil Testing Agency Reports shall be issued showing material type and allowable bearing capacity at bottom of shaft within 24 hours after testing//observing each caisson.

4. Certified, "Caisson Field Record" for each caisson recording actual elevation of bottom, elevation of rock (if applicable), final centerline location of top, variation of shaft from plumb, bell dimension (if applicable), result of all tests and observations performed, material type and actual allowable bearing capacity of bottom, depth of socket into rock, levelness of bottom, seepage of water, still water level (if allowed to flood), elevation (top and bottom) of lining left in place, variation of shaft diameter (from those shown), and evidence of seams, voids or channels below bottom.
- F. Certificates: Contractor's qualifications as specified: Experienced specialty piling subcontractor having a minimum of 5 years successful experience installing Work of the same type required for this project. Employ only skilled tradesmen who are thoroughly experienced with the materials and equipment to be used in the Work.
- G. Pile Load Testing:
1. A schedule and sequencing plan for pile testing and installation.
  2. Pile Load Test Work Plan:
    - a. At least two weeks before commencing pile load testing work, the Contractor shall submit a pile load test work plan describing the equipment, apparatus, procedures, and schedule for testing ACP's in accordance with ASTM D1143 and ASTM D3966 and as specified herein, to verify the design pile capacity. The work plan shall also include the proposed instrumentation of the test pile indicating depth, location, and details of the pile.
    - b. As part of the Pile Load Test Work Plan, submit shop drawings and other information describing the loading and test monitoring arrangement for pile load tests, including the following:
      - 1) Structural design of the test load support/reaction frame.
      - 2) Details of equipment and apparatus to be used for the monitoring load and pile movements.
      - 3) Data on testing and measuring equipment including required jack, load cell and/or gauge calibrations.
      - 4) Sample field data recording sheets or examples of automated data acquisition records proposed for recording load test data.
- H. Independent Testing and Inspection Agency: The Contractor shall retain an Independent Testing and Inspection Agency (Agency) to document,

monitor, and observe load test, probe pile, test pile, and production pile work. This Agency shall submit field reports and test results required for pile load tests, pile installations, and grout testing and inspection. They shall submit a pile installation report for each pile no later than three days after the installation is complete.

- I. Qualification Data: For Installer, Land Surveyor, and Testing and Inspection Agency.
- J. Upon completion of caisson installations, the Contractor shall submit five copies of drawings indicating actual in-place pile locations. The Contractor shall pay for all surveying costs. Drawings must be submitted prior to beginning any pile cap or mat installation. One electronic copy of the drawings shall be submitted in AutoCAD DWG format on CD-ROM.
- K. Record drawings at Project closeout according to Division 01 Section "Closeout Procedures."

#### **1.9 QUALITY CONTROL**

- A. Contractor's Quality Control Responsibilities: Contractor is solely responsible for quality control of the Work.
- B. A Quality Control Program shall be submitted by the Contractor at least two weeks prior to the commencement of work. The implementation of a Contractor Quality Control Program does not relieve the Contractor from the responsibility to provide work in accordance with the Contract Documents, applicable codes, regulations, and Governing Authorities.
- C. Contractor's Independent Testing and Inspection Agency (Agency): The Contractor shall retain at his own expense, the services of a qualified Independent Testing and Inspection Agency, licensed in the state of the project, to provide testing and inspection services during the installation of all foundation piling involved in this Work. This firm shall also provide consultation services to the Contractor if problems are encountered during the execution of the Work. The Agency shall be primarily concerned with the testing and construction methods which will result in finished foundation piling of the required quality and strength. The Agency shall also be concerned with preventing settlement and/or damage to surrounding structures, roads, utilities, embankments, etc., both within the property lines and on adjoining properties during the construction.

- D. The Agency shall be experienced in the testing and installation of caisson foundations. It shall have been involved in at least 8 different caisson projects in the last 5 years, and shall have experience in recommending, testing, and specifying caissons for similar subsurface conditions.
- E. Survey Work: The Contractor shall engage a qualified land surveyor or professional engineer to perform surveys, layouts, and measurements for caissons. The surveyor shall record actual measurements of each caisson's location, shaft diameter, bottom and top elevations, deviations from specified tolerances, and other specified data.
- F. Contractor's Grout Mix Designer: The Contractor shall employ, at his own expense, a testing laboratory to design grout mixes, conduct tests and submit reports for the design mixes. The Grout Mix Designer shall be qualified according to ASTM C1077 and ASTM E329 to perform material evaluation tests and to design concrete mixes, as documented according to ASTM E548.
- G. Welding Standards: Qualify procedures and personnel according to the following:
  - 1. AWS D1.1
  - 2. AWS D1.4
- H. Regulatory Requirements: Comply with applicable requirements of the laws, codes, ordinances and regulations of Federal, State and Municipal authorities having jurisdiction. Obtain necessary approvals from all such authorities.

#### **1.10 QUALITY ASSURANCE**

- A. The Owner shall retain the services of a Geotechnical Consultant (Consultant) to provide general observation of all pile operations and to provide technical advice to the Owner with regard to pile operations and performance.
- B. The Consultant shall have been involved in at least 8 different caisson installation projects in the last 5 years, and shall have experience in recommending, testing, and specifying caissons for similar subsurface conditions.

#### **1.11 APPLICABLE PUBLICATIONS**

- A. Publications listed below form a part of this specification to extent referenced. Publications are referenced in text by basic designation only.



B. American Society for Testing and Materials (ASTM):

A36/A36M-08.....Standard Specification for Carbon Structural  
Steel

A283/A283M-03(2007).....Standard Specification for Low and Intermediate  
Tensile Strength Carbon Steel Plates

A615/A615M-09b.....Standard Specification for Deformed and Plain  
Carbon Steel Bars for Concrete Reinforcement

A929/A929M-01(2007).....Standard Specification for Steel Sheet,  
Metallic Coated by the Hot Dip Process for  
Corrugated Steel Pipe

A996/A996M-09b.....Standard Specification for Rail Steel and Axle  
Steel Deformed and Bars for Concrete  
Reinforcement

C33-11a.....Standard Specification for Concrete Aggregates

C94/C94M-12.....Standard Specification for Ready Mixed Concrete

C150-C50M-11.....Standard Specification for Portland Cement

C494/C494M-11.....Standard Specification for Chemical Admixtures  
for Concrete

C618-12.....Standard Specification for Coal Fly Ash and Raw  
or Calcined Natural Pozzolan for Use in  
Concrete

C989-C989M-11.....Standard Specification for Slag Cement for Use  
in Concrete and Mortars

C1017/C1017M-07.....Standard Specification for Chemical Admixtures  
for Use in Producing Flowing Concrete

D1143-81(1994)e1.....Standard Test Method for Piles Under Static  
Axial Compressive Load

D3689-90(1995).....Standard Test Method for Individual Piles Under  
Static Axial Tensile Load

D3966-90(1995).....Standard Test Method for Piles Under Lateral  
Loads

C. American Concrete Institute (ACI):

211.1-91 (2009).....Standard Practice for Selecting Proportions for  
Normal, Heavyweight and Mass Concrete

301-10.....Specifications for Structural Concrete

315-99.....Details and Detailing of Concrete Reinforcement

D. American Welding Society (AWS):

D1.1/D1.DM (2010).....Structural Welding Code - Steel

D1.4 (1998).....Structural Welding Code - Reinforcing Steel

## **PART 2 - PRODUCTS**

### **2.1 MATERIALS**

- A. Steel Reinforcement: ASTM A615/A615M, or 996, Grade 60, deformed.
- B. Portland Cement: ASTM C150, Type I or II.
- C. Fly Ash/Slag:
  - 1. Fly Ash Admixture: ASTM C618, Class C or F.
  - 2. Ground Granulated Blast-Furnace Slag: ASTM C989, Grade 100 or 120.
- D. Normal-Weight Aggregate: ASTM C33, uniformly graded, 19 mm (3/4-inch) maximum aggregate size.
- E. Water: Potable, complying with ASTM C94/C94M requirements.
- F. Admixtures: Certified by manufacturer to contain not more than 0.1 percent water-soluble chloride ions by mass of cementitious material and to be compatible with other admixtures and cementitious materials. Do not use admixtures containing calcium chloride.
  - 1. Water-Reducing Admixture: ASTM C494, Type A.
  - 2. Water-Reducing and Retarding Admixture: ASTM C494, Type D.
  - 3. High-Range, Water-Reducing Admixture: ASTM C494, Type G.
  - 4. Plasticizing and Retarding Admixture: ASTM C1017, Type II.
- G. Steel Casings: All casing shall meet ASTM A283, Grade C; or ASTM A36, carbon-steel plate, with joints full-penetration welded according to AWS D1.1, or ASTM A929/A929M, steel sheet, zinc coated corrugated steel. The Contractor shall design shells to withstand drilling forces and earth pressures and reinforce the bottom cutting edge as required for proper drilling and sealing of the shells into the rock. The cutting edge shall be capable of coring through at least 3000 mm (10 ft) of broken or solid rock. A minimum of 2% out of roundness of the diameter shall be considered in the design of the shell. All seams shall be welded and watertight.
- H. Concrete Mix: Prepare design mixes according to ACI 211.1 and ACI 301 for each type and strength of concrete determined by either laboratory trial mix or field test data bases. Use a qualified testing agency for preparing and reporting proposed mix designs for laboratory trial mix

basis. Proportion mixes according to ACI 211.1 and ACI 301 to provide normal-weight concrete with the following properties:

1. Compressive Strength (28 Days): 34.5 MPa (5000 psi).
2. Minimum Slump: Capable of maintaining a slump of 125 mm (5 inches) plus or minus 25 mm (1 inch).
3. Do not air entrain concrete for caissons
4. Limit water-soluble, chloride-ion content in hardened concrete to 0.15//0.3 percent by weight of cement.
5. Concrete-mix design adjustments may be considered if characteristics of materials, project conditions, weather, test results, or other circumstances warrant. Resubmission and approval of proposed changes to concrete-mix proportions is the responsibility of the Contractor.

- I. Concrete Mixing: Measure, batch, mix, and deliver concrete according to ASTM C 94/C 94M, and furnish batch ticket information. Do not add water to concrete mix after mixing, unless a procedure per ACI 301 is submitted to and approved by the Project Manager. Maintain concrete temperature less than 32 degree Celsius (90 degree Fahrenheit).

### **PART 3 - EXECUTION**

#### **3.1 GENERAL**

- A. Size: Minimum sizes and types of caissons are shown. Proposal to use caissons of sizes and types different from those shown may be accepted if submitted in writing to Project Manager for approval and provided the following conditions are met:
  1. Least dimension of caisson is equal to or greater than least dimension shown.
  2. Enlargement at base of caisson is in bell-form with dimensions equal to or greater than minimum shown.
  3. If volume of caisson as constructed is greater than that shown, bearing area at base is increased so that additional weight is distributed to bearing material at no more than 3830 kPa ( 80 ksf).
  4. Entire caisson receives full lateral support from surrounding material.
- B. Changes: Requests for change in size or type of caisson from those shown shall be accompanied by calculations and other documentation necessary to show that proposed changes will meet load requirements. Do

not proceed with changes before receiving written approval from Project Manager.

- C. Temporary Steel Casings: Install casings for protection of workers and inspection personnel, for prevention of cave-ins or displacement of earth walls, and for retention of ground water.
- D. Defective Casings: Do not install buckled, distorted or otherwise damaged casings. Replace casings damaged or disturbed during construction, casings that are not mud-tight or otherwise not in accordance with drawings or specifications, at no additional cost to the Government.
- E. Survey: Registered Professional Land Surveyor or Registered Civil Engineer, specified in Section 01 00 00, GENERAL REQUIREMENTS, shall establish lines and levels and stake caisson locations.

### **3.2 EXCAVATION**

- A. Excavation and construction methods shall result in minimum disturbance of surrounding material and full lateral support of caissons by surrounding material.
- B. Remove boulders and rock in caissons such as rock seams underlain with soil seams, sloping rock or rock otherwise unsatisfactory for bearing.
- C. If materials with satisfactory bearing strength occur at elevations higher or lower than those shown, place bottom of caissons at higher or lower elevations, subject to approval of Project Manager.
- D. Test Drilling: Percussion drill one test hole, 50 mm (2 inches) in diameter to depth equal to twice caisson diameter, but not less than 1800 mm (6 feet) deep, in bottom of each caisson which has been excavated to rock to determine if rock seams are underlain by soil seams or voids.
- E. Excavate caissons to dimensions and required bearing strata or elevations shown on contract drawings. Maintain sidewall stability during drilling. Excavate holes for closely spaced caissons, and those occurring in fragile strata, only after adjacent holes are filled with concrete and allowed to set. The excavation shall be accomplished by hand or machine excavation as required. Caisson drilling equipment shall have the minimum torque capacity and downward force capacity for the contract site conditions. Bottoms of caissons shall be cleaned of loose or soft materials and leveled. If bottoms are sloping rock,

excavate to a level plane or step with maximum step height less than 1/4 the width or diameter of the bearing area. All material removed from the caisson holes shall be removed from the ground around the casing before concrete placement is started and shall be disposed of by the Contractor off site in areas submitted to and approved by the Engineer.

- F. Excavations for utilities, support of excavations, or other purposes shall be kept a minimum distance of two shaft diameters away from the outer edge of the caisson.

### **3.3 PLACING CONCRETE**

- A. Before placing concrete, the tip of the caisson shall be observed and approved by a qualified testing agency registered and licensed in the state. The testing agency shall be retained by the Contractor and approved by the Project Manager. The shaft shall be inspected, cleared of mud, water, loose material and debris.
- B. Place concrete using a down pipe to direct flow of concrete. Except in presence of water, concrete may fall freely up to a maximum height of 9.14 meters (30 feet) provided the concrete does not hit the sides of the caisson. Use tremie pipe or pump if distance is greater than 9.14 meters (30 feet).
- C. Withdraw casings, as concrete is deposited, maintaining top surface of concrete constantly at least 1800 mm (6 feet) above lower end of casings. Place concrete to form a monolithic cylindrical shaft having full lateral support from surrounding undisturbed materials. Strike finished top surface of concrete to true plane at required elevation.
- D. Concrete placement in each caisson shall be one continuous operation. If placing operation has to be stopped, leave surface approximately level. If concrete has hardened, clean surface and slush with a 1 to 1 cement-sand grout before placing operation is resumed. Concrete pours shall not begin within one hour of darkness. In the event that this type of continuous sequential operation cannot be performed, the Contractor shall submit for approval by the Project Manager a method of securing the open excavation. The Contractor shall not leave excavations open overnight without receiving prior written approval from the Project Manager.
- E. When water is present, control water level to within 50 mm (2 inches) of bottom of the caisson by pumping. If impossible or impractical to

control water, secure written permission from Project Manager to place concrete through water by means of a watertight tremie.

1. When placing concrete under water, discharge end of tremie shall be submerged in fresh concrete and shaft of tremie maintained full of concrete to point above water level.
2. Increase cement content of concrete required to be placed in water by one sack per cubic yard of concrete.

#### **3.4 CAISSON RECORD**

- A. For each caisson placed and before superstructure framing is placed, submit to Project Manager for approval a certified report recording following information prepared by Registered Professional Land Surveyor or Registered Civil Engineer.
- B. Caisson number, length, and bearing material.
- C. Location.
- D. Concrete and steel reinforcement properties.
- E. Plumbness.
- F. Dates:
  1. Excavation completed.
  2. Concrete placed.
- G. Diameters:
  1. Top of shaft.
  2. Bottom of shaft.
  3. Bell.
- H. Elevations:
  1. Top of ground.
  2. Top of concrete.
  3. Top of rock.
  4. Bottom of caisson.

#### **3.5 CLEAN UP:**

- A. All debris from excavation of objectionable material, removal of obstructions, and any material not to remain as part of the construction are to be removed and disposed of by the Contractor in a legal manner at no additional cost to the Owner.
- B. The site shall be cleaned at frequent intervals and no material shall be stored on the site in a manner, which would obstruct the easy access of equipment and personnel.

- - - E N D - - -

**SECTION 32 05 23**  
**CEMENT AND CONCRETE FOR EXTERIOR IMPROVEMENTS**

**PART 1 - GENERAL**

**1.1 SUMMARY**

A. Section Includes:

1. Subbase for concrete pavements.
2. Integral curbs and gutters.
3. Pedestrian Pavement: Walks and wheelchair curb ramps.
4. Vehicular Pavement: Driveways.

**1.2 RELATED REQUIREMENTS.**

- A. Field Testing: Section 01 45 29, TESTING LABORATORY SERVICES.
- B. Joint Sealants: Section 07 92 00, JOINT SEALANTS
- C. Subgrade Preparation and Subbase Compaction: Section 31 20 11, EARTHWORK.

**1.3 APPLICABLE PUBLICATIONS**

- A. Comply with references to extent specified in this section.
- B. American Association of State Highway and Transportation Officials (AASHTO):
  1. M147-65-UL-04 - Materials for Aggregate and Soil-Aggregate Subbase, Base and Surface Courses.
- C. American Concrete Institute (ACI):
  1. 305R-10 - Guide to Hot Weather Concreting.
  2. 306R-10 - Guide to Cold Weather Concreting.
- D. American National Standards Institute (ANSI):
  1. B101.3 - Wet DOCF of Common Hard Surface Floor Materials (Including Action and Limit Thresholds for the Suitable Assessment of the Measured Values).
- E. ASTM International (ASTM):
  1. A615/A615M-16 - Deformed and Plain Carbon Steel Bars for Concrete Reinforcement.
  2. A996/A996M-15 - Rail-Steel and Axle-Steel Deformed Bars for Concrete Reinforcement.
  3. A1064/A1064M-16 - Carbon-Steel Wire and Welded Wire Reinforcement, Plain and Deformed, for Concrete.
  4. C33/C33M-16 - Concrete Aggregates.
  5. C94/C94M-16 - Ready Mixed Concrete.

6. C143/C143M-15a - Slump of Hydraulic Cement Concrete.
7. C150/C150M-16 - Portland Cement.
8. C171-16 - Sheet Materials for Curing Concrete.
9. C260/C260M-10a - Air Entraining Admixtures for Concrete.
10. C309-11 - Liquid Membrane Forming Compounds for Curing Concrete.
11. C494/C494M-15a - Chemical Admixtures for Concrete.
12. C618-15 - Coal Fly Ash and Raw or Calcined Natural Pozzolan for Use in Concrete.
13. C989/C989M-14 - Slag Cement for Use in Concrete and Mortars.
14. C1240-15 - Silica Fume Used in Cementitious Mixtures.
15. D5893/D5893M-10 - Cold Applied, Single Component, Chemically Curing Silicone Joint Sealant for Portland Cement Concrete Pavements.
16. D6690-15 - Joint and Crack Sealants, Hot Applied, for Concrete and Asphalt Pavements.

#### **1.4 SUBMITTALS**

- A. Submittal Procedures: Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Submittal Drawings:
  1. Show size, configuration, and fabrication and installation details.
  2. Show reinforcing.
  3. Include jointing plan for concrete pavements, curbs and gutters.
- C. Manufacturer's Literature and Data:
  1. Description of each product.
  2. Installation instructions.
- D. Test reports: Certify products comply with specifications.
  1. Concrete materials.
  2. Select subbase materials.
  3. Field test reports.
- E. Certificates: Certify products comply with specifications.
  1. Expansion joint filler.
  2. Reinforcement.
  3. Curing materials.
  4. Concrete protective coating.
- F. Concrete mix design.
- G. Select subbase job-mix design.
- H. Proposed hot and cold weather concreting methods.



- I. Land surveyor's construction staking notes, before placing concrete.
  - 1. Identify discrepancies between field conditions and Drawings.

#### **1.5 QUALITY ASSURANCE**

- A. Preconstruction Testing:
  - 1. Engage independent testing laboratory to perform tests and submit reports.
    - a. Deliver samples to laboratory in number and quantity required for testing.
  - 2. Concrete mix design.
  - 3. Select subbase job-mix design. Report the following:
    - a. Material sources.
    - b. Gradation.
    - c. Plasticity index.
    - d. Liquid limit.
    - e. Laboratory compaction curves indicating maximum density at optimum moisture content.

#### **1.6 DELIVERY**

- A. Deliver steel reinforcement to prevent damage.
- B. Before installation, return or dispose of distorted or damaged steel reinforcement.
- C. Bulk Products: Deliver bulk products away from buildings, utilities, pavement, and existing turf and planted areas. Maintain dry bulk product storage away from contaminants.

#### **1.7 STORAGE AND HANDLING**

- A. Store products indoors in dry, weathertight facility.
- B. Protect products from damage during handling and construction operations.

#### **1.8 FIELD CONDITIONS**

- A. Hot Weather Concreting Procedures: ACI 305R.
- B. Cold Weather Concreting Procedures: ACI 306R.
  - 1. Use non-corrosive, non-chloride accelerator admixture.
  - 2. Do not use calcium chloride, thiocyanates or admixtures containing more than 0.05 percent chloride ions.

## 1.9 WARRANTY

- A. Construction Warranty: FAR clause 52.246-21, "Warranty of Construction."

## PART 2 - PRODUCTS

### 2.1 CONCRETE MATERIALS

- A. Portland Cement: ASTM C150/C150M, Type I or II.
- B. Pozzolans:
1. Fly Ash: ASTM C618, Class C or F including supplementary optional physical requirements.
  2. Slag: ASTM C989/C989M; Grade 80.
  3. Silica Fume: ASTM C1240.
- C. Coarse Aggregate: ASTM C33/C33M.
- D. Fine Aggregate: ASTM C33/C33M.
- E. Mixing Water: Fresh, clean, and potable.
- F. Air-Entraining Admixture: ASTM C260/C260M.
- G. Chemical Admixtures: ASTM C494/C494M.
- H. Reinforcing Steel: ASTM A615/A615M or ASTM A996/A996M, Grade 280 (40); deformed.
- I. Expansion Joint Filler: ASTM D1751.
- J. Sheet Materials for Curing Concrete: ASTM C171.

### 2.2 SELECT SUBBASE

- A. Subbase: AASHTO M147; Grade B.
1. Select granular material composed of sand, sand-gravel, crushed stone, crushed or granulated slag, with or without soil binder, or combinations of these materials.

SUBBASE GRADING REQUIREMENTS							
Sieve Size		Percentage Passing by Mass					
		Grades					
(mm)	(in)	A	B	C	D	E	F
50	2	100	100				
25	1		75-95	100	100	100	100
9.5	3/8	30-65	40-75	50-85	60-100		
4.47	No. 4	25-55	30-60	35-65	50-85	55-100	70-100
2.00	No. 10	15-40	20-45	25-50	40-70	40-100	55-100

SUBBASE GRADING REQUIREMENTS							
Sieve Size		Percentage Passing by Mass					
		Grades					
0.425	No. 40	8-20	15-30	15-30	25-45	20-50	30-70
0.075	No. 200	2-8	5-20	5-15	5-20	6-20	8-25

- B. Other Acceptable Gradations: Materials within three to five percent, plus or minus, of specified gradation, or as recommended by the geotechnical engineer and approved by the Contracting Officer's Representative.

### 2.3 FORMS

- A. Forms: Wood, plywood, metal, or other materials, approved by Contracting Officer's Representative, of grade or type suitable to obtain type of finish specified.
1. Plywood: Exterior grade, free of defects and patches on contact surface.
  2. Lumber: Sound, grade-marked, S4S stress graded softwood, minimum 50 mm (2 inches) thick, free from warp, twist, loose knots, splits, or other defects.
  3. Form Coating: As recommended by Architect/Engineer.
- B. Provide forms suitable in cross-section, depth, and strength to resist springing during depositing and consolidating concrete.
1. Do not use forms varying from straight line more than 3 mm in 3000 mm (1/8 inch in 10 feet), horizontally and vertically.
- C. Provide flexible or curved forms for forming radii.

### 2.4 CONCRETE CURING MATERIALS

- A. Concrete curing materials, conform to one of the following:
1. Burlap: Minimum 233 g/sq. m (7 ounces/sq. yd.) dry.
  2. Sheet Materials for Curing Concrete: ASTM C171.
  3. Curing Compound: ASTM C309, Type 2; liquid membrane forming type, without paraffin or petroleum.

### 2.5 CONCRETE MIXES

- A. Design concrete mixes according to ASTM C94/C94M, Option C.
- B. Concrete Type: Air-entrained. See Table I.

TABLE I - CONCRETE TYPES

Concrete Type	Minimum 28 Day Compressive Strength f'c MPa (psi)	Non-Air-Entrained		Air-Entrained	
		Min. Cement kg/cu. m (lbs./cu. yd.)	Max. Water Cement Ratio	Min. Cement kg/cu. m (lbs./cu. yd.)	Max. Water Cement Ratio
A	35 (5000)1,3	375 (630)	0.45	385 (650)	0.40
B	30 (4000)1,3	325 (550)	0.55	340 (570)	0.50
C	25 (3000)1,3	280 (470)	0.65	290 (490)	0.55
D	25 (3000)1,2	300 (500)	*	310 (520)	*
Footnotes:					
1. If trial mixes are used, achieve compressive strength 8.3 MPa (1,200 psi) in excess of f'c. For concrete strengths greater than 35 MPa (5,000 psi), achieve compressive strength 9.7 MPa (1,400 psi) in excess of f'c.					
2. For Concrete Exposed to High Sulfate Content Soils: Maximum water cement ratio is 0.44.					
3. Laboratory Determined according to ACI 211.1 for normal weight concrete.					

C. Maximum Slump: ASTM C143/C143M. See Table II.

TABLE II - MAXIMUM SLUMP	
APPLICATION	MAXIMUM SLUMP
Curb & Gutter	75 mm (3 inches)
Pedestrian Pavement	75 mm (3 inches)
Vehicular Pavement	50 mm (2 inches) Machine Finished
	100 mm (4 inches) Hand Finished
Equipment Pad	75 to 100 mm (3 to 4 inches)

## 2.6 ACCESSORIES

- A. Equipment and Tools: Obtain Contracting Officer's Representative's, approval of equipment and tools needed for handling materials and performing work before work begins.
- B. Maintain equipment and tools in satisfactory working condition.
- C. Sealants:
  1. Concrete Paving Expansion Joints: ASTM D5893/D5893M, Type SL, single component, self-leveling, silicone joint sealant.
  2. Concrete Paving Joints: ASTM D6690, Type IV, hot-applied, single component joint sealant.

- D. Concrete Protective Coating: AASHTO M233 linseed oil mixture.

### **PART 3 - EXECUTION**

#### **3.1 PREPARATION**

- A. Examine and verify substrate suitability for product installation.
- B. Protect existing construction and completed work from damage.
- C. Prepare, construct, and finish subgrade. See Section 31 20 00, EARTHWORK.
- D. Maintain subgrade in smooth, compacted condition, in conformance with the required section and established grade until the succeeding operation has been accomplished.

#### **3.2 SELECT SUBBASE**

- A. Placing:
  - 1. Place subbase material on prepared subgrade in uniform layer to required contour and grades, and to maximum 200 mm (8 inches) loose depth.
  - 2. When required compacted thickness exceeds 150 mm (6 inches), place subbase material in equal thickness layers.
  - 3. When subbase elevation is 13 mm (1/2 inch) or more below required grade, excavate subbase minimum 75 mm (3 inches) deep. Place and compact subbase to required grade.
- B. Compaction:
  - 1. Perform compaction with approved hand or mechanical equipment well suited to the material being compacted.
  - 2. Maintain subbase at optimum moisture content for compaction.
  - 3. Compact each subbase layer to minimum 95 percent or 100 percent of maximum density as specified in Section 31 20 11, EARTHWORK.
- C. Subbase Tolerances:
  - 1. Variation from Indicated Grade: Maximum 9 mm (3/8 inch).
  - 2. Variation from Indicated Thickness: Maximum 13 mm (1/2 inch).
- D. Protection:
  - 1. Protect subbase from damage until concrete is placed.
  - 2. Reconstruct damaged subbase before placing concrete.

#### **3.3 SETTING FORMS**

- A. Form Substrate:

1. Compact form substrate to uniformly support forms along entire length.
2. Correct substrate imperfections and variations by cutting, filling, and compacting.

B. Form Setting:

1. Set forms to indicated line and grade with tight joints. Rigidly brace forms preventing movement.
2. Remove forms when removal will not damage concrete and when required for finishing.
3. Clean and oil forms before each use.
4. Correct forms, when required, immediately before placing concrete.

C. Form Tolerances:

1. Variation from Indicated Line: Maximum 6 mm (1/4 inch).
2. Variation from Indicated Grade: Maximum 3 mm in 3000 mm (1/8 inch in 10 feet).

**3.4 PLACING REINFORCEMENT**

- A. Keep reinforcement clean from contamination preventing concrete bond.
- B. Install reinforcement shown on drawings.
- C. Support and securely tie reinforcing steel to prevent displacement during concrete placement.
- D. Obtain Contracting Officer's Representative's reinforcement placement approval before placing concrete.

**3.5 JOINTS - GENERAL**

- A. Place joints, where shown on approved submittal Drawings.
  1. Conform to details shown.
  2. Install joints perpendicular to finished concrete surface.
- B. Make joints straight and continuous from edge to edge of pavement.

**3.6 CONSTRUCTION JOINTS**

- A. Locate longitudinal and transverse construction joints between slabs of vehicular pavement as shown on approved submittal Drawings.
- B. Place transverse construction joints of type shown, where indicated, and whenever concrete placement is suspended for more than 30 minutes.

**3.7 CONTRACTION JOINTS**

- A. Tool or cut joints to width, depth, and radius edge required using grooving tool, jointer, or saw.

- B. Construct joints in curbs and gutters by inserting 3 mm (1/8 inch) steel plates conforming to curb and gutter cross sections.
  - 1. Keep plates in place until concrete can hold its shape.
- C. Finish joint edges with edging tool.
- D. Score pedestrian pavement with grooving tool or jointer.

### **3.8 EXPANSION JOINTS**

- A. Form expansion joints with expansion joint filler of thickness required.
  - 1. Locate joints around perimeter of structures and features abutting site work concrete.
  - 2. Create complete, uniform separation between structure and site work concrete.
- B. Extend expansion joint material full depth of concrete with top edge of joint filler below finished concrete surface where sealant is required.
- C. Cut and shape material matching cross section.
- D. Anchor with approved devices to prevent displacing during placing and finishing operations.
- E. Round joint edges with edging tool.

### **3.9 PLACING CONCRETE - GENERAL**

- A. Preparation before Placing Concrete:
  - 1. Obtain Contracting Officer's Representative approval.
  - 2. Remove debris and other foreign material.
  - 3. Uniformly moisten substrate, without standing water.
- B. Convey concrete from mixer to final location without segregation or loss of ingredients. Deposit concrete to minimize handling.
- C. During placement, consolidate concrete by spading or vibrating to minimize voids, honeycomb, and rock pockets.
  - 1. Vibrate concrete against forms and along joints.
  - 2. Avoid excess vibration and handling causing segregation.
- D. Place concrete continuously between joints without bulkheads.
- E. Install construction joint in concrete placement suspended for more than 30 minutes.
- F. Replace concrete with cracks, chips, bird baths, and other defects to nearest joints, approved by Contracting Officer's Representative.

**3.10 PLACING CONCRETE FOR PEDESTRIAN PAVEMENT**

- A. Place concrete in one layer conforming to cross section shown on Drawings after consolidating and finishing.
- B. Deposit concrete near joints without disturbing joints. Do not place concrete directly onto joint assemblies.
- C. Strike concrete surface to proper section ready for consolidation.
- D. Consolidate concrete with approved mechanical finishing equipment.
- E. Finish concrete surface with wood or metal float.
- F. Construct concrete pads and pavements with sufficient slope to drain, preventing standing water.

**3.11 PLACING CONCRETE FOR VEHICULAR PAVEMENT**

- A. Deposit concrete as close as possible to its final position.
- B. Place concrete continuously between construction joints without cold joints.
- C. Strike and consolidate concrete with finishing machine, vibrating screed, or by hand-finishing.
- D. Finish concrete surface to elevation and crown shown on drawings.
- E. Deposit concrete near joints without disturbing joints. Do not place concrete directly onto joint assemblies.

**3.12 Obtain Contracting Officer's Representative's approval before placing adjacent lanes.FORM REMOVAL**

- A. Keep forms in place minimum 12 hours after concrete placement. Remove forms without damaging concrete.
- B. Do not use bars or heavy tools against concrete to remove forms. Repair damage concrete found after form removal.

**3.13 CONCRETE FINISHING - GENERAL**

- A. Follow operation sequence below, unless otherwise indicated on Drawings:
  - 1. Consolidating, floating, striking, troweling, texturing, and joint edging.
- B. Use edging tool with 6 mm (1/4 inch) radius.
- C. Keep finishing equipment and tools clean and suitable for use.

**3.14 CONCRETE FINISHING - PEDESTRIAN PAVEMENT**

- A. Walks, Wheelchair Curb Ramps



1. Finish concrete surfaces with metal float, troweled smooth, and finished with a broom moistened with clear water.
2. Finish slab edges and formed transverse joints with edger.
3. Broom surfaces transverse to traffic direction.
  - a. Use brooming to eliminate flat surface produced by edger.
  - b. Produce uniform corrugations, maximum 1.5 mm (1/16 inch) deep profile.
4. Provide surface uniform in color and free of surface blemishes, form marks, and tool marks.
5. Paving Tolerances:
  - a. Variation from Indicated Plane: Maximum 5 mm in 3000 mm (3/16 inch in 10 feet).
  - b. Variation from Indicated Thickness: Maximum 6 mm (1/4 inch).
6. Replace paving within joint boundary when paving exceeds specified tolerances.

### **3.15 CONCRETE FINISHING - VEHICULAR PAVEMENT**

- A. Align finish surfaces where new and existing pavements abut.
- B. Longitudinally float pavement surface to profile and grade indicated on drawings.
- C. Straighten surface removing irregularities and maintaining specified tolerances while concrete is plastic.
- D. Finish pavement edges and joints with edging tool.
- E. Broom finish concrete surface after bleed water dissipates and before concrete hardens.
  1. Broom surface transverse to traffic direction.
    - a. Use brooming to eliminate flat surface produced by edger.
    - b. Produce uniform corrugations, maximum 3 mm (1/8 inch) deep profile.
- F. Pavement Tolerances:
  1. Variation from Indicated Plane: Maximum 6 mm in 3000 mm (1/4 inch in 10 feet) tested parallel and perpendicular to traffic direction at maximum 1500 mm (5 feet) intervals.
  2. Variation from Indicated Thickness: Maximum 6 mm (1/4 inch).
- G. Replace paving within joint boundary when paving exceeds specified tolerances.

### **3.16 CONCRETE FINISHING - CURBS AND GUTTERS**

- A. Round edges of gutter and top of curb with edging tool.
  - B. Gutter and Curb Top:
    - 1. Float surfaces and finish with smooth wood or metal float until true to grade and section and uniform color.
    - 2. Finish surfaces, while still plastic, longitudinally with bristle brush.
  - C. Curb Face:
    - 1. Remove curb form and immediately rub curb face with wood or concrete rubbing block removing blemishes, form marks, and tool marks and providing uniform color.
    - 2. Brush curb face, while still plastic, matching gutter and curb top.
  - D. Curb and Gutter Tolerances:
    - 1. Variation from Indicated Plane and Grade:
      - a. Gutter: Maximum 3 mm in 3000 mm (1/8 inch in 10 feet).
      - b. Curb Top and Face: Maximum 6 mm in 3000 mm (1/4 inch in 10 feet).
  - E. Replace curbs and gutters within joint boundary when curbs and gutters exceed specified tolerances.
- Correct depressions causing standing water.

### **3.17 CONCRETE CURING**

- A. Concrete Protection:
  - 1. Protect unhardened concrete from rain and flowing water.
  - 2. Provide sufficient curing and protection materials available and ready for use before concrete placement begins.
  - 3. Protect concrete to prevent pavement cracking from ambient temperature changes during curing period.
    - a. Replace pavement damaged by curing method allowing concrete cracking.
    - b. Employ another curing method as directed by Contracting Officer's Representative.
- B. Cure concrete for minimum 7 days by one of the following methods appropriate to weather conditions preventing moisture loss and rapid temperature change:
  - 1. Burlap Mat: Provide minimum two layers kept saturated with water during curing period. Overlap Mats at least 150 mm (6 inches).

2. Sheet Materials:

- a. Wet exposed concrete surface with fine water spray and cover with sheet materials.
- b. Overlap sheets minimum 300 mm (12 inches).
- c. Securely anchor sheet materials preventing displacement.

3. Curing Compound:

- a. Protect joints indicated to receive sealants preventing contamination from curing compound.
- b. Insert moistened paper or fiber rope into joint or cover joint with waterproof paper.
- c. Apply curing compound before concrete dries.
- d. Apply curing compound in two coats at right angles to each other.
- e. Application Rate: Maximum 5 sq. m/L (200 sq. ft./gallon), both coats.
- f. Immediately reapply curing compound to surfaces damaged during curing period.

**3.18 CONCRETE PROTECTIVE COATING**

- A. Apply protective coating of linseed oil mixture to exposed-to-view concrete surfaces, drainage structures, and features that project through, into, or against concrete exterior improvements to protect the concrete against deicing materials.
- B. Complete backfilling and curing operation before applying protective coating.
- C. Dry and thoroughly clean concrete before each application.
- D. Apply two coats, with maximum coverage of 11 sq. m/L (50 sq. yds./gal.); first coat, and maximum 16 sq. m/L (70 sq. yds./gal.); second coat, except apply commercially prepared mixture according to manufacturer's instructions.
- E. Protect coated surfaces from vehicular and pedestrian traffic until dry.
- F. Do not heat protective coating, and do not expose protective coating to open flame, sparks, or fire adjacent to open containers or applicators. Do not apply material at temperatures lower than 10 degrees C (50 degrees F).

**3.19 FIELD QUALITY CONTROL**

- A. Field Tests: Performed by testing laboratory specified in Section 01 45 29, TESTING LABORATORY SERVICES.
  - 1. Compaction.
    - a. Pavement subgrade.
    - b. Curb, gutter, and sidewalk.
  - 2. Concrete:
    - a. Delivery samples.
    - b. Field samples.
  - 3. Slip Resistance: Steps and pedestrian paving.

**3.20 CLEANING**

- A. After completing curing:
  - 1. Remove burlap and sheet curing materials.
  - 2. Sweep concrete clean, removing foreign matter from the joints.
  - 3. Seal joints as specified.

**3.21 PROTECTION**

- A. Protect exterior improvements from traffic and construction operations.
  - 1. Prohibit traffic on paving for minimum seven days after placement, or longer as directed by Contracting Officer's Representative.
- B. Remove protective materials immediately before acceptance.
- C. Repair damage.
  - 1. Replace concrete containing excessive cracking, fractures, spalling, and other defects within joint boundary, when directed by Contracting Officer's Representative, and at no additional cost to the Government.

- - - E N D - - -

**SECTION 33 40 00**

**STORM SEWER UTILITIES**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

This section specifies materials and procedures for construction of outside, underground storm sewer systems that are complete and ready for operation. This includes piping, structures and all other incidentals.

**1.2 RELATED WORK**

- A. Excavation, Trench Widths, Pipe Bedding, Backfill, Shoring, Sheeting, Bracing: Section 31 20 11, EARTHWORK.
- B. Concrete Work, Reinforcing, Placement and Finishing: Section 03 30 00, CAST-IN-PLACE CONCRETE.
- C. Materials and Testing Report Submittals: Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA AND SAMPLES.

**1.3 ABBREVIATIONS**

- A. HDPE: High-density polyethylene
- B. PE: Polyethylene

**1.4 DELIVERY, STORAGE, AND HANDLING**

- A. Do not store plastic manholes, pipe, and fittings in direct sunlight.

**1.5 COORDINATION**

- A. Coordinate exterior utility lines and connections to building services up to the actual extent of building wall.

**1.6 QUALITY ASSURANCE:**

- A. Products Criteria:
  - 1. When two or more units of the same type or class of materials or equipment are required, these units shall be products of one manufacturer.

**1.7 SUBMITTALS**

- A. Manufacturers' Literature and Data shall be submitted, as one package, for pipes, fittings and appurtenances, including jointing materials, hydrants, valves and other miscellaneous items.

### 1.8 APPLICABLE PUBLICATIONS

A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.

B. American Society for Testing and Materials (ASTM):

- C33/C33M-08.....Concrete Aggregates
- C150/C150M-11.....Portland Cement
- C1173-08.....Flexible Transition Couplings for Underground  
Piping Systems
- D448-08.....Sizes of Aggregate for Road and Bridge  
Construction
- D698-07e1.....Laboratory Compaction Characteristics of Soil  
Using Standard Effort (12 400 ft-lbf/ft<sup>3</sup> (600  
kN-m/m<sup>3</sup>))
- D1056-07.....Flexible Cellular Materials—Sponge or Expanded  
Rubber
- D1785-06.....Poly(Vinyl Chloride) (PVC) Plastic Pipe,  
Schedules 40, 80, and 120
- D2321-11.....Underground Installation of Thermoplastic Pipe  
for Sewers and Other Gravity-Flow Applications
- D3034-08.....Type PSM Poly(Vinyl Chloride) (PVC) Sewer Pipe  
and Fittings
- D3350-10.....Polyethylene Plastics Pipe and Fittings  
Materials
- D5926-09.....Poly (Vinyl Chloride) (PVC) Gaskets for Drain,  
Waste, and Vent (DWV), Sewer, Sanitary, and  
Storm Plumbing Systems
- F477-10.....Elastomeric Seals (Gaskets) for Joining Plastic  
Pipe
- F714-10.....Polyethylene (PE) Plastic Pipe (SDR-PR) Based  
on Outside Diameter

F794-03(2009).....Poly(Vinyl Chloride) (PVC) Profile Gravity  
Sewer Pipe and Fittings Based on Controlled  
Inside Diameter

F891-10.....Coextruded Poly(Vinyl Chloride) (PVC) Plastic  
Pipe With a Cellular Core

F949-10.....Poly(Vinyl Chloride) (PVC) Corrugated Sewer  
Pipe With a Smooth Interior and Fittings

F1417-11.....Installation Acceptance of Plastic Gravity  
Sewer Lines Using Low-Pressure Air

F1668-08.....Construction Procedures for Buried Plastic Pipe

C. American Water Works Association(AWWA):

M23-2nd ed.....PVC Pipe "Design And Installation"

D. American Concrete Institute (ACI):

318-05.....Structural Commentary and Commentary

350/350M-06.....Environmental Engineering Concrete Structures  
and Commentary

E. National Stone, Sand and Gravel Association (NSSGA): Quarried Stone for  
Erosion and Sediment Control

**1.9 WARRANTY**

The Contractor shall remedy any defect due to faulty material or workmanship and pay for any damage to other work resulting therefrom within a period of one year from final acceptance. Further, the Contractor will furnish all manufacturers' and suppliers' written guarantees and warranties covering materials and equipment furnished under this Contract.

**PART 2 - PRODUCTS**

**2.1 FACTORY-ASSEMBLED PRODUCTS**

A. Standardization of components shall be maximized to reduce spare part requirements. The Contractor shall guarantee performance of assemblies of components, and shall repair or replace elements of the assemblies as required to deliver specified performance of the complete assembly.

## 2.2 PE PIPE AND FITTINGS

- A. Corrugated PE drainage pipe and fittings, NPS 3 to NPS 10 (DN 80 to DN 250); ASTM F714, SDR 21 with smooth waterway for coupling joints.
  - 1. Soil-tight Couplings: AASHTO M252, corrugated, matching tube and fittings.
- B. Corrugated PE pipe and fittings, NPS 12 to NPS 60 (DN 300 to DN 1500); ASTM F714, SDR 21 for pipes 3 to 24 inches (300 to 600 mm) with smooth waterway for coupling joints. Pipe shall be produced from PE certified by the resin producer as meeting the requirements of ASTM D3350, minimum cell class 335434C.
  - 1. Soil-tight Couplings: AASHTO M252, corrugated, matching tube and fittings.
  - 2. Water tight joints shall be made using a PVC or PE coupling and rubber gaskets as recommended by the pipe manufacturer. Rubber gaskets shall conform to ASTM F477. Soil tight joints shall conform to requirements in AASHTO HB-17, Division II, for soil tightness and shall be as recommended by the manufacturer.
- C. Profile Wall PE Pipe: Pipe shall comply with ASTM F894, Class 160.
  - 1. Profile Wall PE Plastic Pipe Joints: Joints shall be as per ASTM F894, // gasket // or // thermal // weld type with integral bell.
- D. PVC Pipe and Fittings
  - 1. PVC Cellular-Core Pipe and Fittings: ASTM F891, Sewer and Drain Series, PS 50 minimum stiffness, PVC cellular-core pipe with plain ends for solvent-cemented joints.
  - 2. Fittings: ASTM D3034, SDR 35 PVC socket-type fittings.
- E. PVC Profile Sewer Piping
  - 1. Pipe: ASTM F794, PVC profile, gravity sewer pipe with bell-and-spigot ends.
  - 2. Fittings: ASTM D3034, PVC with bell ends.
  - 3. Gaskets: ASTM F477, elastomeric seals.
- F. PVC Gravity Sewer Piping
  - 1. Pipe and fittings shall be ASTM F679, T-1 wall thickness, PVC gravity sewer pipe with bell-and-spigot ends.
  - 2. Gaskets: ASTM F477, elastomeric seals for gasketed joints.



## 2.3 CLEANOUTS

- A. Cast-Iron Cleanouts: ASME A112.36.2M, round, gray-iron housing with clamping device and round, secured, scoriated, gray-iron cover. Include gray-iron ferrule with inside calk or spigot connection and countersunk, tapered-thread, brass closure plug.
1. Top-Loading Classification(s): // Light Duty // Medium Duty // Heavy Duty // and // Extra-Heavy Duty //
  2. Pipe fitting and riser to cleanout shall be same material as main pipe line.
- B. Plastic Cleanouts shall have PVC body with PVC threaded plug. Pipe fitting and riser to cleanout shall be of same material as main line pipe.

## 2.4 MANHOLES AND CATCH BASINS

- A. Standard Precast Concrete Manholes:
1. Description: ASTM C478 (ASTM C478M), precast, reinforced concrete, of depth indicated, with provision for sealant joints.
  2. Diameter: 48 inches (1200 mm) minimum unless otherwise indicated.
  3. Ballast: Increase thickness of precast concrete sections or add concrete to base section as required to prevent flotation.
  4. Base Section: 6 inch (150 mm) minimum thickness for floor slab and 4-inch (102 mm) minimum thickness for walls and base riser section, and separate base slab or base section with integral floor.
  5. Riser Sections: 4 inch (102 mm) minimum thickness, and lengths to provide depth indicated.
  6. Top Section: Eccentric-cone type unless concentric-cone or flat-slab-top type is indicated, and top of cone of size that matches grade rings.
  7. Joint Sealant: ASTM C990 (ASTM C990M), bitumen or butyl rubber.
  8. Resilient Pipe Connectors: ASTM C923 (ASTM C923M), cast or fitted into manhole walls, for each pipe connection.
  9. Steps: If total depth from floor of manhole to finished grade is greater than 60 inches (1500 mm). Individual FRP steps or FRP ladder, width of 16 inches (400 mm) minimum, spaced at 12 to 16 inch (300 to 400 mm) intervals.
  10. Adjusting Rings: Reinforced-concrete rings, 6 to 9 inch (150 to 225 mm) total thickness, to match diameter of manhole frame and cover,

and height as required to adjust manhole frame and cover to indicated elevation and slope.

**B. Manhole Frames and Covers:**

1. Description: Ferrous; 24-inch (610 mm) ID by 7 to 9 inch (175 to 225 mm) riser with 4 inch (102 mm) minimum width flange and 26-inch (600 mm) diameter cover. Include indented top design with lettering cast into cover, using wording equivalent to "STORM SEWER."
2. Material: ASTM A536, Grade 60-40-18 ductile iron unless otherwise indicated.

**2.5 CONCRETE FOR MANHOLES AND CATCH BASINS**

A. General: Cast-in-place concrete according to ACI 318, ACI 350/350R, and the following:

1. Cement: ASTM C150, Type II.
2. Fine Aggregate: ASTM C33, sand.
3. Coarse Aggregate: ASTM C33, crushed gravel.
4. Water: Potable.

B. Concrete Design Mix: 4000 psi (27.6 MPa) minimum, compressive strength in 28 days.

1. Reinforcing Fabric: ASTM A185, steel, welded wire fabric, plain.
2. Reinforcing Bars: ASTM A615, Grade 60 (420 MPa) deformed steel.

**PART 3 - EXECUTION**

**3.1 PIPE BEDDING**

A. The bedding surface of the pipe shall provide a firm foundation of uniform density throughout the entire length of pipe. Concrete pipe requirements are such that when no bedding class is specified, concrete pipe shall be bedded in a soil foundation accurately shaped and rounded to conform with the lowest one-fourth of the outside portion of circular pipe. When necessary, the bedding shall be tamped. Bell holes and depressions for joints shall not be more than the length, depth, and width required for properly making the particular type of joint. Plastic pipe bedding requirements shall meet the requirements of ASTM D2321. Bedding, haunching and initial backfill shall be either Class IB or Class II material. Corrugated metal pipe bedding requirements shall conform to ASTM A798.

### 3.2 PIPING INSTALLATION

- A. Drawing plans and details indicate general location and arrangement of underground storm drainage piping. Install piping as indicated, to extent practical. Where specific installation is not indicated, follow piping manufacturer's written instructions.
- B. Install piping as shown on the Drawings.
- C. Install piping beginning at low point, true to grades and alignment indicated with unbroken continuity of invert. Place bell ends of piping facing upstream. Install gaskets, seals, sleeves, and couplings according to manufacturer's written instructions for use of lubricants, cements, and other installation requirements.
  - 1. Do not lay pipe on unstable material, in wet trench or when trench and weather conditions are unsuitable for the work.
  - 2. Support pipe on compacted bedding material. Excavate bell holes only large enough to properly make the joint.
  - 3. Inspect pipes and fittings, for defects before installation. Defective materials shall be plainly marked and removed from the site. Cut pipe shall have smooth regular ends at right angles to axis of pipe.
  - 4. Clean interior of all pipe thoroughly before installation. When work is not in progress, open ends of pipe shall be closed securely to prevent entrance of storm water, dirt or other substances.
  - 5. Lower pipe into trench carefully and bring to proper line, grade, and joint. After jointing, interior of each pipe shall be thoroughly wiped or swabbed to remove any dirt, trash or excess jointing materials.
  - 6. Do not walk on pipe in trenches until covered by layers of shading to a depth of 12 inches (300 mm) over the crown of the pipe.
  - 7. Warning tape shall be continuously placed 12 inches (300 mm) above storm sewer piping.
- D. Install proper size increasers, reducers, and couplings where different sizes or materials of pipes and fittings are connected. Reducing size of piping in direction of flow is prohibited.
- E. Install gravity-flow, nonpressure drainage piping according to the following:
  - 1. Install piping pitched down in direction of flow.

2. Install PE corrugated sewer piping according to ASTM D2321 with gasketed joints.
3. Install PVC cellular-core piping, PVC sewer piping, and PVC profile gravity sewer piping, according to ASTM D2321 and ASTM F1668.

### **3.3 CONNECTIONS TO EXISTING VA-OWNED MANHOLES**

- A. Make pipe connections and alterations to existing manholes so that finished work will conform as nearly as practicable to the applicable requirements specified for new manholes, including concrete and masonry work, cutting, and shaping.

### **3.4 CONNECTIONS**

- A. Encase entire connection fitting, plus 6 inch (150 mm) overlap, with not less than 6 inches (150 mm) of concrete with 28-day compressive strength of 3000 psi (20.7 MPa).
- B. Make connections to existing piping and underground manholes.
  1. Use commercially manufactured wye fittings for piping branch connections. Remove section of existing pipe; install wye fitting into existing piping.
  2. Protect existing piping, manholes, and structures to prevent concrete or debris from entering while making tap connections. Remove debris or other extraneous material that may accumulate.

### **3.5 CLOSING ABANDONED STORM DRAINAGE SYSTEMS**

- A. Abandoned Piping: Close open ends of abandoned underground piping indicated to remain in place. Include closures strong enough to withstand hydrostatic and earth pressures that may result after ends of abandoned piping have been closed. Use either procedure below:
  1. Close open ends of piping with at least // 8 inch (203 mm) // Insert dimension // thick, brick masonry bulkheads.
  2. Close open ends of piping with threaded metal caps, plastic plugs, or other acceptable methods suitable for size and type of material being closed. Do not use wood plugs.
- B. Abandoned Manholes and Structures: Excavate around manholes and structures as required and use one procedure below:
  1. Remove manhole or structure and close open ends of remaining piping.
- C. Backfill to grade according to Division 31 Section EARTHWORK.

### **3.6 IDENTIFICATION**

- A. Install green warning tape directly over piping and at outside edge of underground structures.

### **3.7 FIELD QUALITY CONTROL**

- A. Inspect interior of piping to determine whether line displacement or other damage has occurred. Prior to final acceptance, provide a video record of all piping from the building to the municipal connection to show the lines are free from obstructions, properly sloped and joined.
  - 1. Submit separate reports for each system inspection.
  - 2. Defects requiring correction include the following:
    - a. Alignment: Less than full diameter of inside of pipe is visible between structures.
    - b. Deflection: Flexible piping with deflection that prevents passage of ball or cylinder of size not less than 92.5 percent of piping diameter.
    - c. Damage: Crushed, broken, cracked, or otherwise damaged piping.
    - d. Infiltration: Water leakage into piping.
    - e. Exfiltration: Water leakage from or around piping.
  - 3. Replace defective piping using new materials, and repeat inspections until defects are within allowances specified.
  - 4. Reinspect and repeat procedure until results are satisfactory.

### **3.8 TESTING OF STORM SEWERS:**

- A. Submit separate report for each test.
- B. Test new piping systems, and parts of existing systems that have been altered, extended, or repaired, for leaks and defects.
  - 1. Do not enclose, cover, or put into service before inspection and approval.
  - 2. Test completed piping systems according to requirements of authorities having jurisdiction.
  - 3. Schedule tests and inspections by authorities having jurisdiction with at least 24 hours advance notice.
  - 4. Submit separate report for each test.
  - 5. Air test gravity sewers. Concrete Pipes conform to ASTM C924, Plastic Pipes conform to ASTM F1417, all other pipe material conform to ASTM C828 or C924, after consulting with pipe manufacturer. Testing of individual joints shall conform to ASTM C1103.

C. Leaks and loss in test pressure constitute defects that must be repaired. Replace leaking piping using new materials, and repeat testing until leakage is within allowances specified.

### **3.9 CLEANING**

A. Clean interior of piping of dirt and superfluous materials. Flush with water.

--- E N D ---

**SECTION 33 46 13**

**FOUNDATION DRAINAGE**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

This section specifies materials and procedures for construction of foundation drainage systems, including installation, backfill, and cleanout extensions, to a point of connection to storm sewer.

**1.2 RELATED WORK**

- A. Excavation, Trench Widths, Pipe Bedding, Backfill, Shoring, Sheeting, Bracing: Section 31 20 11, EARTHWORK SHORTFORM
- B. Materials testing and inspection during construction: Section 01 45 29, TESTING LABORATORY SERVICES.
- C. Foundation wall waterproofing: Section 07 13 52 MODIFIED BITUMINOUS SHEET WATERPROOFING.
- D. Perimeter insulation: Section 07 21 13 BUILDING INSULATION
- E. General plumbing, protection of Materials and Equipment, and quality assurance: Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.
- F. Submittals: Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA AND SAMPLES.

**1.3 DEFINITIONS**

Subdrainage: Foundation drainage system that collects and removes subsurface or seepage water from building foundation from building to discharge.

**1.4 ABBREVIATIONS**

- A. ABS: Acrylonitrile-butadiene-styrene plastic.
- B. HDPE: High-density polyethylene plastic.
- C. PE: Polyethylene plastic.
- D. PVC: Polyvinyl chloride plastic.

**1.5 DELIVERY, STORAGE, AND HANDLING**

- A. Do not store plastic manholes, pipe, and fittings in direct sunlight.
- B. Protect pipe, pipe fittings, and seals from dirt and damage.

**1.6 COORDINATION**

- A. Coordinate connection to storm sewer main, if approved, with the Public Agency responsible for the storm sewer system.

B. Coordinate exterior utility lines and connections to foundation building drain.

C. Coordinate with Foundation Waterproofing: Section 07 13 52, MODIFIED BITUMINOUS SHEET WATERPROOFING.

#### **1.7 QUALITY ASSURANCE:**

A. Products Criteria:

1. When two or more units of the same type or class of materials or equipment are required, these units shall be products of one manufacturer.
2. A nameplate bearing manufacturer's name or trademark, including model number, shall be securely affixed in a conspicuous place on equipment. In addition, the model number shall be either cast integrally with equipment, stamped, or otherwise permanently marked on each item of equipment.

B. Comply with the rules and regulations of the Public Agency having jurisdiction over the connection to public storm sewer lines or the requirements for discharge of subsurface drainage.

#### **1.8 APPLICABLE PUBLICATIONS**

A. The publications listed below form a part of this specification to the extent referenced. The publications are referred in the text by basic designation only.

B. American Society for Testing and Materials (ASTM):

A48-03.....Gray Iron Castings

C14-07.....Nonreinforced Concrete Sewer, Storm Drain, and  
Culvert Pipe

C33/C33M-11.....Concrete Aggregates

C443-10.....Joints for Concrete Pipe and Manholes, Using  
Rubber Gaskets

C444-03(2009).....Perforated Concrete Pipe

C578-10a.....Rigid, Cellular Polystyrene Thermal Insulation

C1173-08.....Flexible Transition Couplings for Underground  
Piping Systems

D448-08.....Sizes of Aggregate for Road and Bridge  
Construction



D1621-10.....Standard Test Method for Compressive Properties  
of Rigid Cellular Plastics

D2235-04(2011).....Solvent Cement for Acrylonitrile-Butadiene-  
Styrene (ABS) Plastic Pipe and Fittings

D2321-11.....Underground Installation of Thermoplastic Pipe  
for Sewers and Other Gravity-Flow Applications

D2751-05.....Acrylonitrile-Butadiene-Styrene (ABS) Sewer  
Pipe and Fittings

D3034-08.....Type PSM Poly (Vinyl Chloride) (PVC) Sewer Pipe  
and Fittings

D3350-10a.....Polyethylene Plastic Pipe and Fittings Material

D4491-99a(2009).....Test Methods for Water Permeability of  
Geotextiles by Permittivity

D4716-08.....Test Method for Determining the (In-plane) Flow  
Rate per Unit Width and Hydraulic  
Transmissivity of a Geosynthetic Using a  
Constant Head

D5926-09.....Poly (Vinyl Chloride) (PVC) Gaskets for Drain,  
Waste, and Vent (DWV), Sewer, Sanitary, and  
Storm Plumbing Systems

D6707-06 (2011).....Circular-Knit Geotextile for Use in Subsurface  
Drainage Applications

F405-05.....Corrugated Polyethylene (PE) Pipe and Fittings

F477-10.....Elastomeric Seals (Gaskets) for Joining Plastic  
Pipe

F667-06.....Larger Diameter Corrugated Polyethylene Pipe  
and Fittings

F2648-10.....2 to 60 Inch Annular Corrugated Profile Wall  
Polyethylene (PE) Pipe and Fittings for Land  
Drainage Applications

## **1.9 WARRANTY**

The Contractor shall remedy any defect due to faulty material or workmanship and pay for any damage to other work resulting therefrom within a period of one year from final acceptance. Further, the Contractor will furnish all manufacturer's and supplier's written guarantees and warranties covering materials and equipment furnished under this Contract.

## **PART 2 - PRODUCTS**

### **2.1 FACTORY-ASSEMBLED PRODUCTS**

- A. Standardization of components shall be maximized to reduce spare part requirements.
- B. Contractor shall guarantee performance of assemblies of components, and shall repair or replace elements of the assemblies as required to deliver specified performance of the complete assembly.

### **2.2 COMPATIBILITY OF RELATED EQUIPMENT**

- A. Equipment and materials installed shall be compatible in all respects with other items being furnished and with existing items so that the result will be a complete and fully operational system that conforms to contract requirements.

### **2.3 UNDERSLAB HEADER**

- A. PE pipe and fittings per ASTM F405.

### **2.4 DRAINAGE PANELS**

- A. Molded-Sheet Drainage Panels shall be Prefabricated geocomposite, 36 to 60 inches (915 to 1525 mm) wide with drainage core faced with geotextile filter fabric.
  - 1. Drainage Core shall be Three-dimensional, nonbiodegradable, molded plastic.
    - a. Minimum Compressive Strength shall be 10,000 lbf/sq. ft (479 kPa) when tested according to ASTM D1621.
    - b. Minimum In-Plane Flow Rate shall be 2.8 gpm/ft (35 L/min. per m) when tested according to ASTM D4716.
  - 2. Filter Fabric shall be Woven geotextile fabric, manufactured for subsurface drainage, made from polyolefins or polyesters; with elongation less than 50 percent; complying with the following properties determined according to ASTM D6707.

- a. Survivability shall be Class 2 .
  - b. Apparent Opening Size shall be No. 40 (0.425 mm) sieve, maximum.
  - c. Permittivity shall be 0.5 per second, minimum.
3. Film Backing shall be Polymeric film bonded to drainage core surface.

## **2.5 DRAINAGE MAT**

- A. Drainage mat shall be formed three dimensional polyethylene or high-impact polymeric core or compression-resistant nylon matting of open three-dimensional construction.

## **2.6 SOIL MATERIALS**

### **A. Drainage Material**

- 1. Bedding shall be crushed stone, 3/4 inch (20 mm) to No. 4 per ASTM D448, at a minimum or as per geotechnical recommendations.
- 2. Fill to 1 foot (300 mm) above pipe shall be Crushed stone, 3/4 inch (20 mm) to No. 4 per ASTM D448, at a minimum or as per geotechnical recommendations.

### **B. Concrete Sand shall be ASTM C33.**

## **2.7 GEOTEXTILE FILTER FABRICS**

- A. Geotextile fabric shall conform to ASTM 6707. Elongation will be greater than 50 percent and the flow rate shall range from 110 to 330 gpm/sq. ft. (4480 to 13440 L/min. per sq. m).
- 1. Structure Type shall be woven, monofilament or multifilament.
  - 2. Style(s) shall be Flat and sock.

## **PART 3 - EXECUTION**

### **3.1 EXAMINATION**

- A. Examine surfaces and areas for suitable conditions where subdrainage systems are to be installed.
- B. Proceed with installation only after unsatisfactory conditions have been corrected.

### **3.2 PIPING APPLICATIONS**

- A. Underground Subdrainage Piping shall be:
- 1. Perforated PE pipe and fittings, couplings, and coupled joints.
- B. Underslab Subdrainage Piping shall be:
- 1. Perforated PE pipe and fittings, couplings, and coupled joints.
- C. Header Piping shall be:
- 1. PE drainage tubing and fittings, couplings, and coupled joints.

### **3.3 CLEANOUT APPLICATIONS**

- A. In Underground Subdrainage Piping:
  - 1. At Grade in Earth shall be Cast-iron cleanouts.
  - 2. At Grade in Paved Areas shall be Cast-iron cleanouts.
- B. In Underslab Subdrainage Piping:
  - 1. In Equipment Yards and Unfinished Areas shall be Cast-iron cleanouts.

### **3.4 FOUNDATION DRAINAGE INSTALLATION**

- A. Place impervious fill material on subgrade adjacent to bottom of footing after concrete footing forms have been removed. Place and compact impervious fill to dimensions indicated, but not less than 6 inches (150 mm) deep and 12 inches (300 mm) wide.
- B. Lay flat-style geotextile filter fabric in trench and overlap trench sides.
- C. Place supporting layer of drainage course over compacted subgrade and geotextile filter fabric, to compacted depth of not less than 4 inches (100 mm).
- D. Encase pipe with sock-style geotextile filter fabric before installing pipe. Connect sock sections with adhesive and install drainage piping.
- E. Add drainage course to width of at least 6 inches (150 mm) on side away from wall and to top of pipe to perform tests.
- F. After satisfactory testing, cover drainage piping to width of at least 6 inches (150 mm) on side away from footing and above top of pipe to within 12 inches (300 mm) of finish grade.
- G. Install drainage course and wrap top of drainage course with flat-style geotextile filter fabric.
- H. Place layer of flat-style geotextile filter fabric over top of drainage course, overlapping edges at least 4 inches (100 mm).
- I. Install vertical drainage panels as follows:
  - 1. Coordinate placement with other drainage materials.
  - 2. Lay perforated drainage pipe at base of footing. Do not install aggregate.
  - 3. Separate 4 inches (100 mm) of fabric at beginning of roll and cut away 4 inches (100 mm) of core. Wrap fabric around end of remaining core.
  - 4. Wrap bottom of panel around drainage pipe.

5. Attach panel to wall at horizontal mark and at beginning of pipe.  
Place core side of panel against wall. Use concrete nails with washers through product cylinders to attach panel to wall. Place nails from 2 to 6 inches (50 to 150 mm) below top of panel, approximately 48 inches (1200 mm) apart. Construction adhesives, metal stick pins, or double double-sided tape may be used instead of nails. Do not penetrate waterproofing. Before using adhesives, discuss with waterproofing manufacturer.
6. If additional panels are required on same row, cut away 4 inches (100 mm) of installed panel core, install new panel against installed panel, and overlap new panel with installed panel fabric.
7. If additional rows of panels are required, overlap lower panel with 4 inches (100 mm) of fabric.
8. Cut panel as necessary to keep top 12 inches (300 mm) below finish grade.
9. For inside corners, bend panel. For outside corners, cut core to provide 3 inches (75 mm) for overlap.
- J. Coordinate installation of perimeter insulation used as protection boards specified in Section 07 21 13 and with installation of drainage panel. Do not use drainage panels as protection for waterproof membrane unless approved by factory-authorized service representative of waterproofing membrane manufacturer. Submit approval if so used.
- K. Place initial backfill material over compacted drainage course. Place material in loose-depth layers not exceeding 6 inches (150 mm). Thoroughly compact each layer. Final backfill to finish elevations and slope away from building.

### **3.5 UNDERSLAB DRAINAGE INSTALLATION**

- A. Excavate for underslab drainage system after subgrade material has been compacted but before drainage course has been placed. Include horizontal distance of at least 6 inches (150 mm) between drainage pipe and trench walls. Grade bottom of trench excavations to required slope, and compact to firm, solid bed for drainage system.
- B. Lay flat-style geotextile filter fabric in trench and overlap trench sides.

- C. Place supporting layer of drainage course over compacted subgrade and geotextile filter fabric, to compacted depth of not less than 4 inches (100 mm).
- D. Encase pipe with sock-style geotextile filter fabric before installing pipe. Connect sock sections with adhesive or tape. Install drainage piping.
- E. Add drainage course to width of at least 6 inches (150 mm) on side away from wall and to top of pipe to perform tests.
- F. After satisfactory testing, cover drainage piping with drainage course to elevation of bottom of slab, and compact and wrap top of drainage course with flat-style geotextile filter fabric.
- G. Install horizontal drainage panels as follows:
  - 1. Coordinate placement with other drainage materials.
  - 2. Lay perforated drainage pipe at inside edge of footings.
  - 3. Place drainage panel over drainage pipe with core side up. Peel back fabric and wrap fabric around pipe. Locate top of core at bottom elevation of floor slab.
  - 4. Butt additional panels against other installed panels. If panels have plastic flanges, overlap installed panel with flange.

### **3.6 CLEANOUT INSTALLATION**

- A. Cleanouts for Foundation:
  - 1. Install cleanouts from piping to grade. Locate cleanouts at beginning of piping run and at changes in direction. Install fittings so cleanouts open in direction of flow in piping.
  - 2. In nonvehicular-traffic areas, use NPS 4 (DN 100) cast-iron pipe and fittings for piping branch fittings and riser extensions to cleanout. Set cleanout frames and covers in a cast-in-place concrete anchor, 12 by 12 by 4 inches (300 by 300 by 100 mm) in depth. Set top of cleanout plug 1 inch (25 mm) above grade.
- B. Cleanouts for Underslab Subdrainage:
  - 1. Install cleanouts and riser extensions from piping to top of slab. Locate cleanouts at beginning of piping run and at changes in direction. Install fittings so cleanouts open in direction of flow in piping.
  - 2. Use NPS 4 (DN 100) cast-iron soil pipe and fittings for piping branch fittings and riser extensions to cleanout flush with top of slab.

### **3.7 CONNECTIONS**

- A. Connect low elevations of subdrainage system to building's solid-wall-piping storm drainage system.
- B. Where required, connect low elevations of foundation AND underslab subdrainage to stormwater sump pumps.

### **3.8 IDENTIFICATION**

- A. Install PE warning tape or detectable warning tape over ferrous piping.
- B. Install detectable warning tape over nonferrous piping and over edges of underground structures.

### **3.9 FIELD QUALITY CONTROL**

Testing: After installing drainage course to top of piping, test drain piping with water to ensure free flow before backfilling. Remove obstructions, replace damaged components, and repeat test until results are satisfactory.

### **3.10 CLEANING**

Clear interior of installed piping and structures of dirt and other superfluous material as work progresses. Maintain swab or drag in piping and pull past each joint as it is completed. Place plugs in ends of uncompleted pipe at end of each day or when work stops.

--- E N D ---

