

DEMO NOTES

- 1 REMOVE & DISCARD EXISTING CONCRETE AND MASONRY STAIR STRUCTURE IN ITS ENTIRETY, INCLUDING BUT NOT LIMITED TO: ROOF, WALLS, STAIRS, LANDINGS, RAILINGS, AND FOUNDATIONS (INCLUDING FOOTINGS)
- 2 REMOVE & DISCARD EXISTING STEEL DOOR AND FRAME.
- 3 REMOVE & DISCARD PORTION OF EXISTING MASONRY WALL AS INDICATED, COORDINATE EXTENT WITH FLOOR PLANS. SUPPORT EXISTING ROOF STRUCTURE AS REQUIRED TO STABILIZE DURING CONSTRUCTION.
- 4 REMOVE & DISCARD PORTION OF ROOF STRUCTURE.
- 5 REMOVE & DISCARD EXISTING WINDOW SASH (EXISTING FRAMES TO REMAIN). WINDOWS CONTAIN LEAD PAINT. SEE ASBESTOS & LEAD ENVIRONMENTAL NOTES.
- 6 REMOVE EXISTING WINDOW FRAME & SASH IN ITS ENTIRETY (TO RECEIVE NEW MASONRY INFILL). WINDOWS CONTAIN LEAD PAINT. SEE ASBESTOS & LEAD ENVIRONMENTAL NOTES.
- 7 REMOVE & DISCARD EXISTING METAL ROOF PANELS.
- 8 REMOVE EXISTING WINDOW FRAME & SASH IN ITS ENTIRETY. WINDOWS CONTAIN LEAD PAINT. SEE ASBESTOS & LEAD ENVIRONMENTAL NOTES.
- 9 PREPARE CRACKED MORTAR JOINTS FOR NEW REPOINTING.





GENERAL NOTE:

- 1. SEE PLUMBING DRAWINGS FOR ADDITIONAL DEMOLITION SCOPE.
- 2. GENERAL CONTRACTOR IS RESPONSIBLE FOR SHORING AND BRACING OF THE BUILDING INCLUDING ALL STRUCTURAL SYSTEMS THROUGHOUT DEMOLITION TO MAINTAIN THE EXISTING BUILDING FOR NEW WORK.
- 3. GENERAL CONTRACTOR IS RESPONSIBLE FOR COORDINATING ARCHITECTURAL DEMOLITION DOCUMENTS WITH DEMOLITION DOCUMENTS FROM OTHER DISCIPLINES AND ALL NEW WORK DOCUMENTS CONTAINED WITHIN THE DOCUMENT SET.

ASBESTOS & LEAD ENVIRONMENTAL NOTES:

- PREPARE THE AREA ACCORDING TO SPECIFICATION SECTION 02 82 33.13 PART 3
- A. THE WINDOWS AND OTHER PAINTED SURFACES CONTAIN LEAD PAINT. THE RESULTS OF A LEAD SURVEY ARE INCLUDED IN SECTION 02 83 33.13 PART 1.
- B. THE WINDOW CAULKING ON ALL WINDOWS ENCASED IN ALUMINUM TRIM IS PRESUMED ASBESTOS CONTAINING MATERIAL (PACM). THESE WINDOWS SHALL BE REMOVED INTACT IN ACCORDANCE WITH OSHA 29CFR 1926.1101 (G) (8) (VI) - CLASS II ASBESTOS WORK.
- C. CONTRACTOR MUST COMPLY WITH OSHA REGULATION 29 CFR 1926.62; LEAD AND 1926.1101 ASBESTOS.
- D. ALL WINDOWS MUST BE WETTED PRIOR TO REMOVAL. REMOVE WINDOWS AS A UNIT AND MINIMIZE THE GENERATION OF DUST.
- E. ALL WASTE MUST BE WRAPPED IN TWO LAYERS OF 6 MIL POLY AND LOWERED CAREFULLY TO THE GROUND.
- F. THE VA MUST BE NOTIFIED AT LEAST 24 HOURS IN ADVANCE OF ANY WASTE REMOVED FROM THE CONTROLLED AREA.
- G. MATERIALS MAY NOT BE DROPPED FROM ANY HEIGHT, UNLESS THE MATERIAL IS CARRIED OR PASSED TO THE GROUND BY HAND. IT SHALL BE LOWERED TO THE GROUND VIA COVERED, DUST-TIGHT CHUTE, CRANE OR HOIST.
- H. DISPOSAL OF THE WINDOWS AND DEBRIS IN ACCORDANCE WITH THESE SPECIFICATIONS, WEST VIRGINIA, OSHA, THE LANDFILL REQUIREMENTS OR PACKAGING MUST ALSO BE MET. TRANSPORT WILL BE IN COMPLIANCE WITH 49 CFR 100-185 REGULATIONS.
- I. DISPOSAL SHALL BE DONE AT AN APPROVED LANDFILL. DISPOSAL OF NON-FRAGILE ACM AND LEAD PAINTED DEMOLITION WASTE SHALL BE DONE IN ACCORDANCE WITH APPLICABLE REGULATIONS.

three inches = one foot
 one and one half inches = one foot
 one inch = one foot
 three quarters inch = one foot
 one half inch = one foot
 three eighths inch = one foot
 one quarter inch = one foot
 one eighth inch = one foot
 one sixteenth inch = one foot

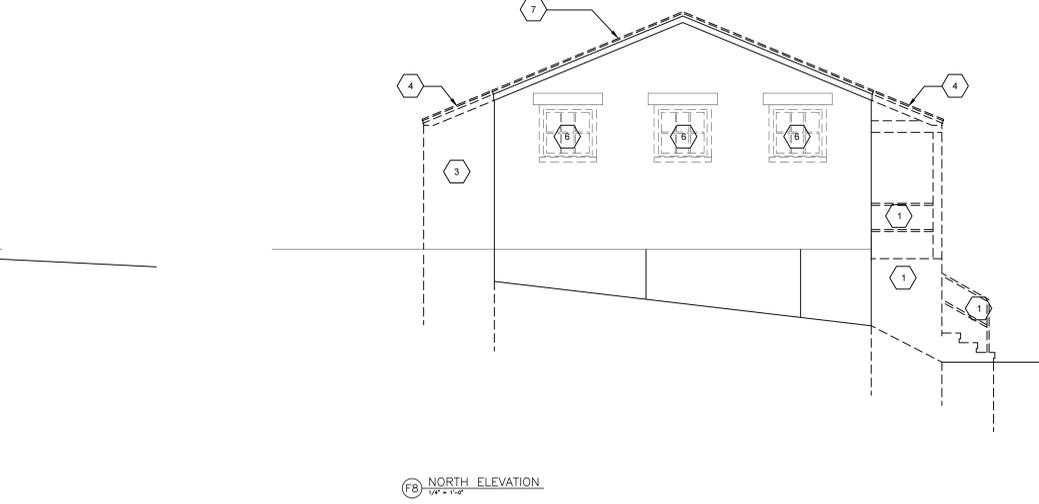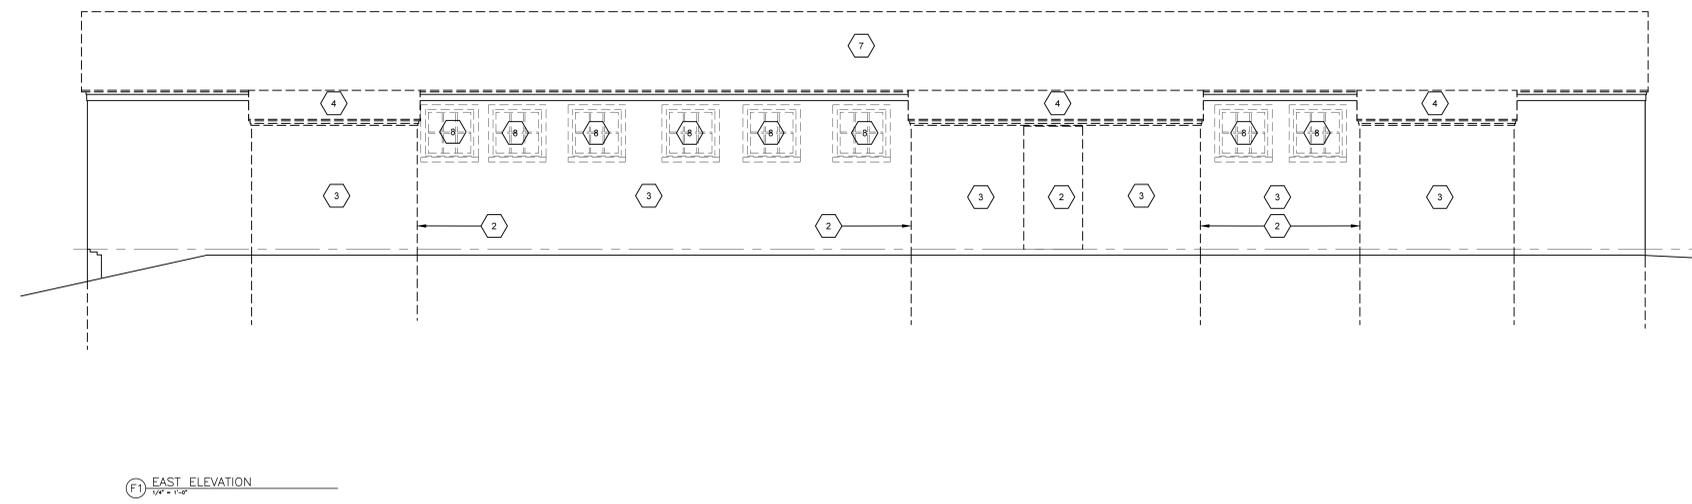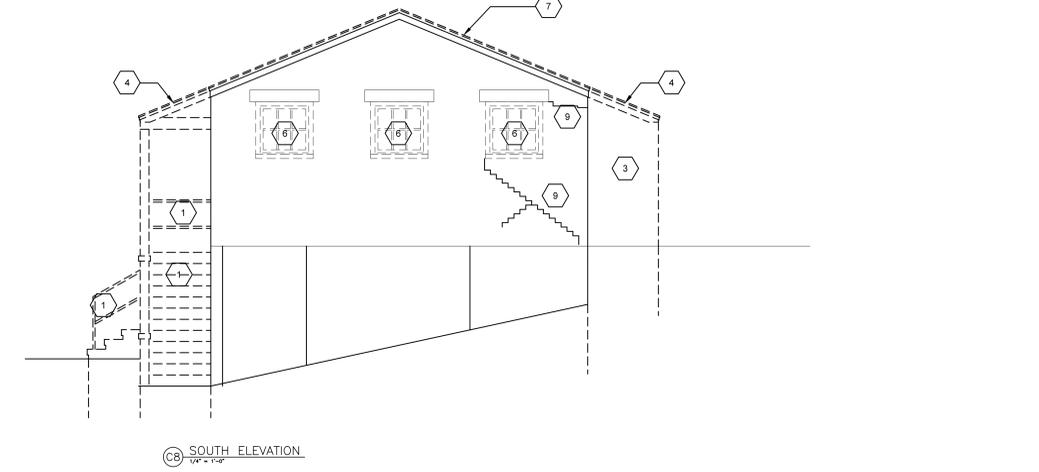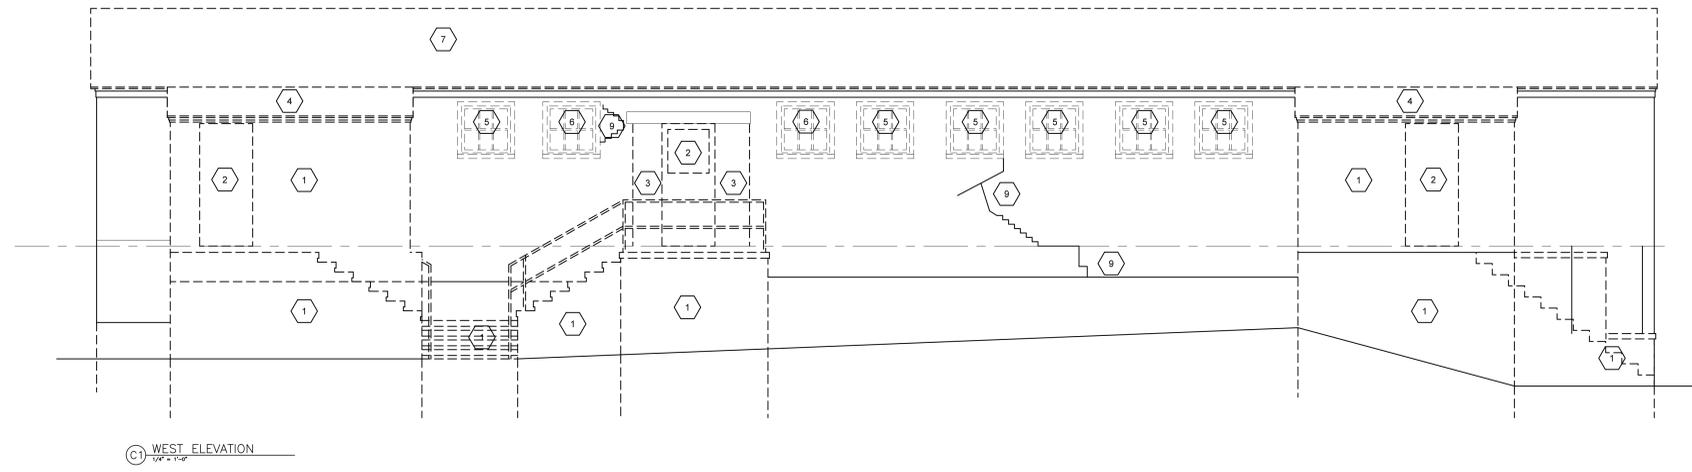

100% CONSTRUCTION DOCUMENTS

CONSULTANTS: 		ARCHITECT/ENGINEERS:  600 North Hartley Street, Suite 150 York, PA 17404 T 717.843.3200 F 717.699.0205 www.saoarchitects.com		Drawing Title DEMOLITION ELEVATIONS		Project Title RECREATIONAL POOL FACILITY RENOVATIONS BATH HOUSE		Project Number 613-11-140		Office of Construction and Facilities Management	
Revisions: _____ Date				Approved: Project Director		Location YAMC, MARTINSBURG, WV		Building Number 417		Drawing Number 417-AD-201	
						Date 05-14-12		Checked DRSD		Drawn CAP	
								Dwg. 4 of 24			