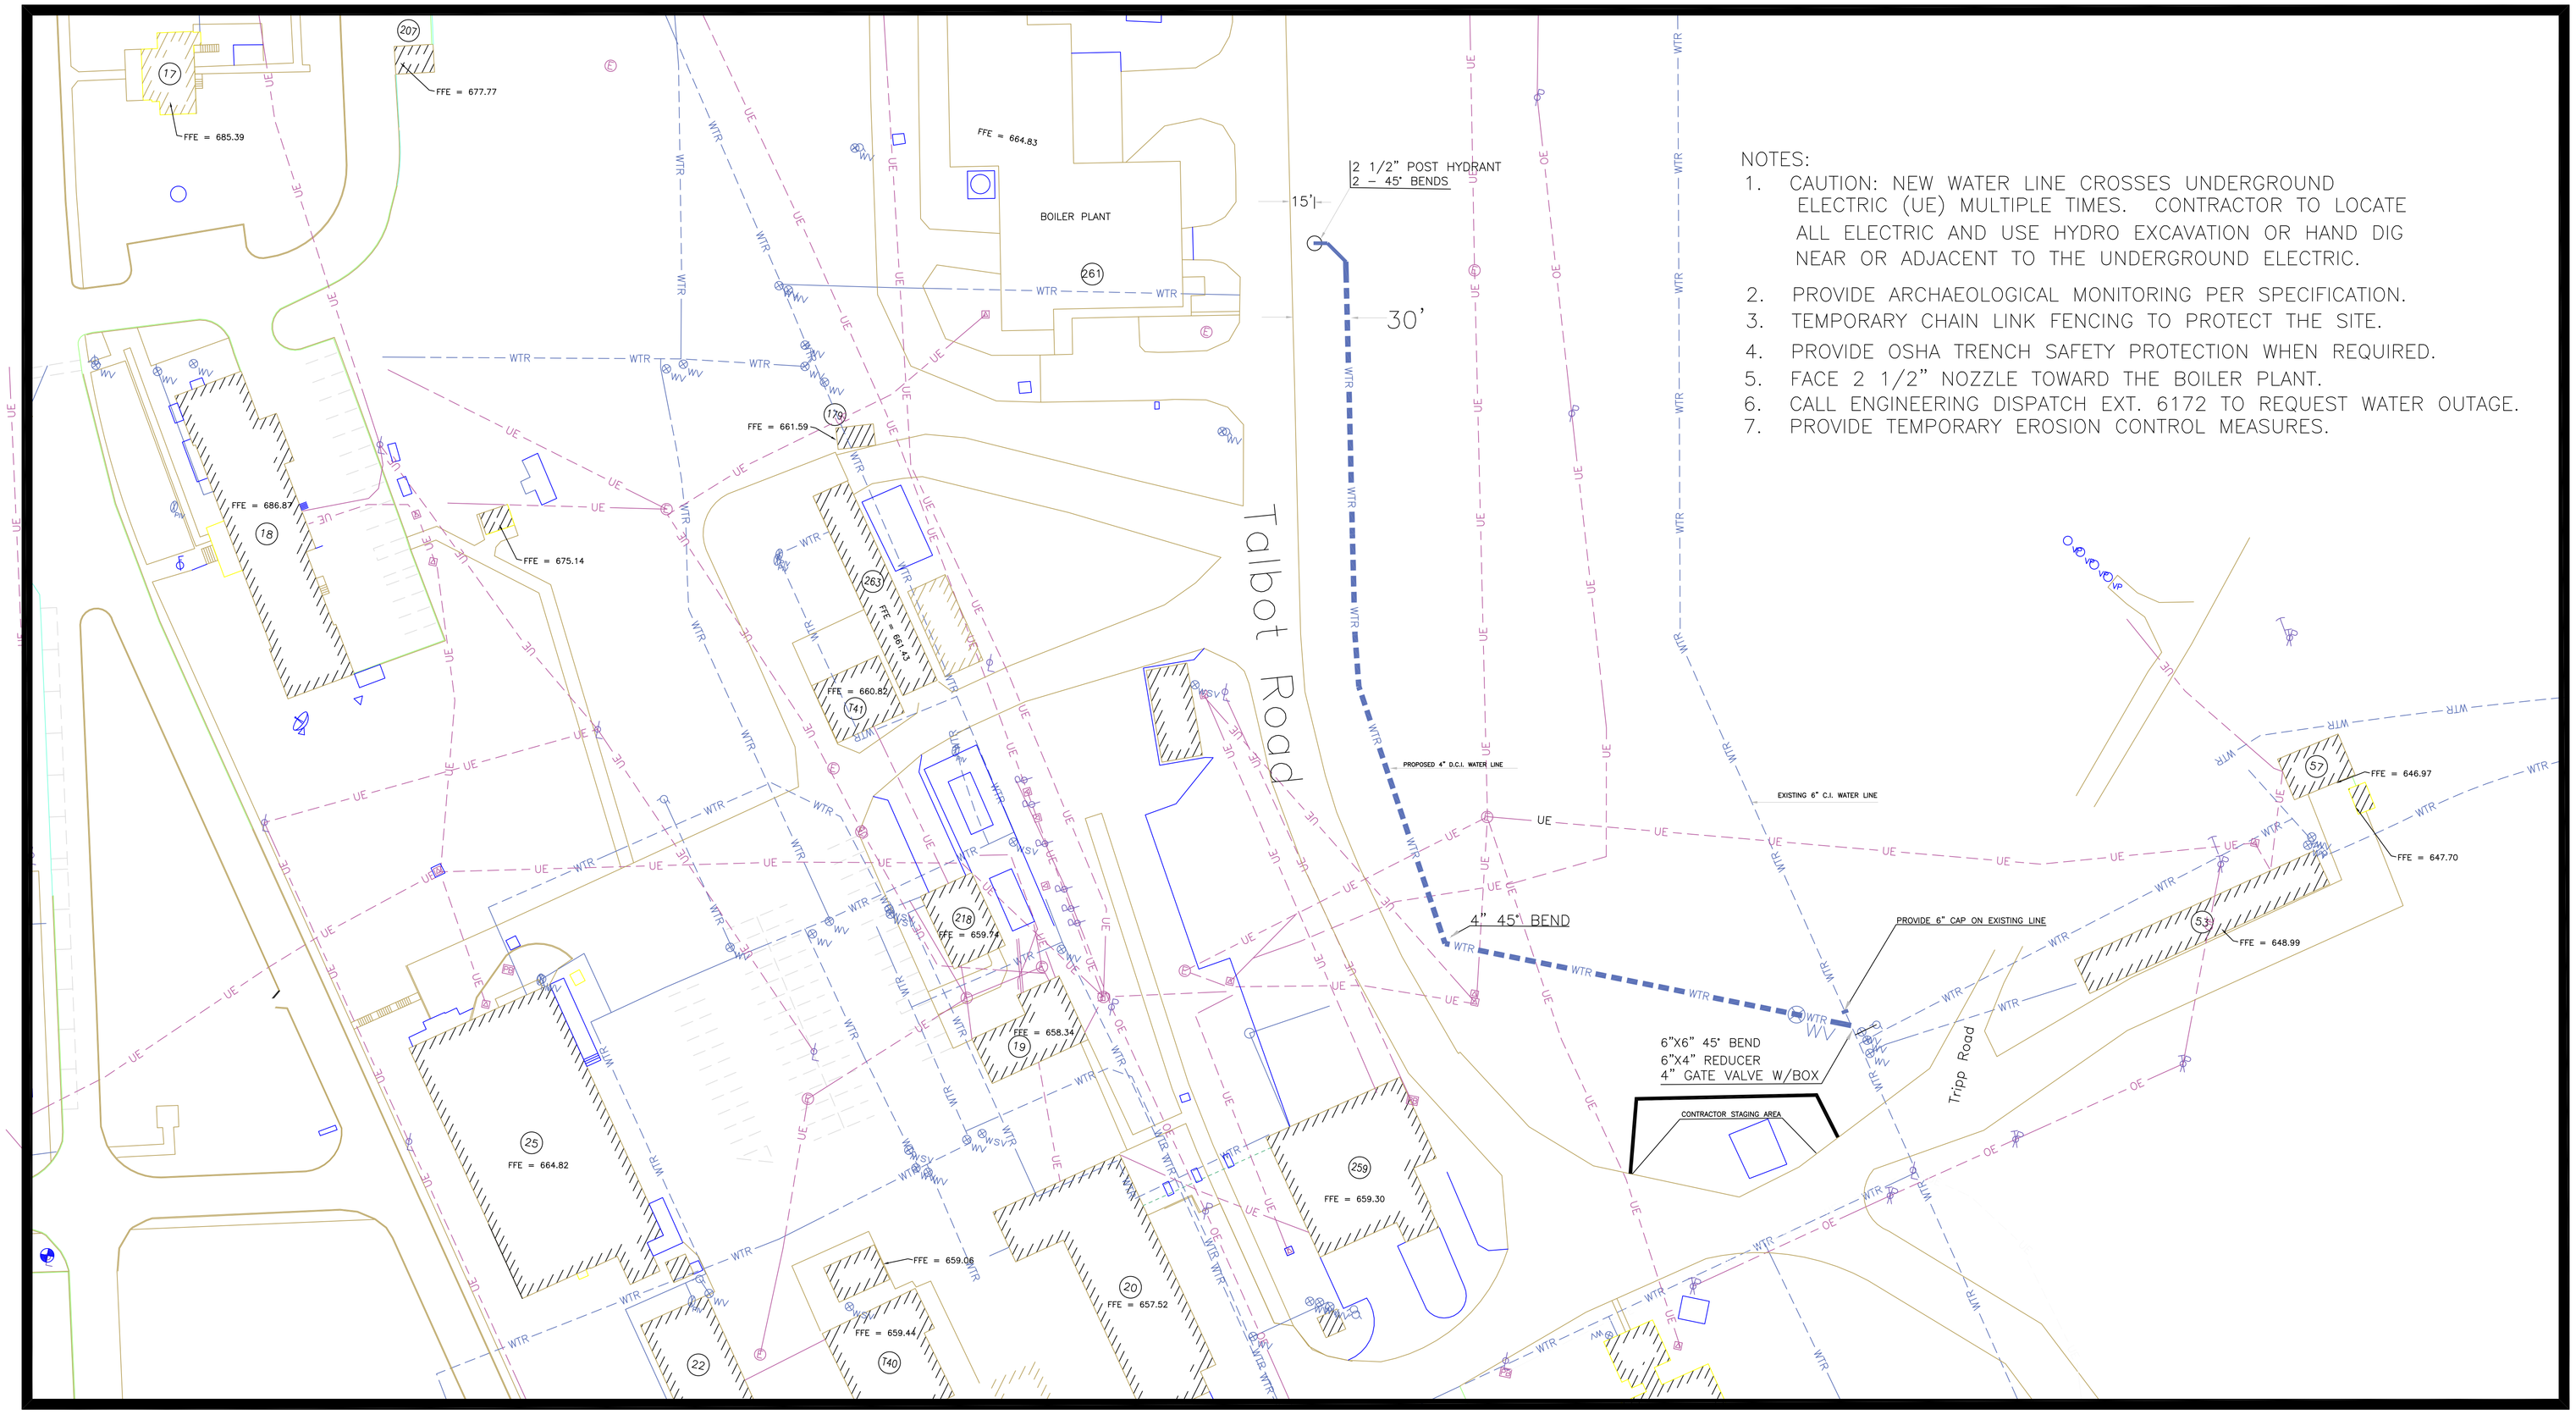

NOTES:

1. CAUTION: NEW WATER LINE CROSSES UNDERGROUND ELECTRIC (UE) MULTIPLE TIMES. CONTRACTOR TO LOCATE ALL ELECTRIC AND USE HYDRO EXCAVATION OR HAND DIG NEAR OR ADJACENT TO THE UNDERGROUND ELECTRIC.
2. PROVIDE ARCHAEOLOGICAL MONITORING PER SPECIFICATION.
3. TEMPORARY CHAIN LINK FENCING TO PROTECT THE SITE.
4. PROVIDE OSHA TRENCH SAFETY PROTECTION WHEN REQUIRED.
5. FACE 2 1/2" NOZZLE TOWARD THE BOILER PLANT.
6. CALL ENGINEERING DISPATCH EXT. 6172 TO REQUEST WATER OUTAGE.
7. PROVIDE TEMPORARY EROSION CONTROL MEASURES.

Revisions	Date
Updated	5-05
Updated	5-05

Drawing Title: 4" DCI WATERLINE	Project Title: SECONDARY WATER SUPPLY TO BP		Date: APRIL 2018
			Project No.: 538-18-203
Approved: Chief, Engineering Service	Building Number STATION	Checked	Drawn
Approved: Director, Medical Center	Location: Chillicothe, Ohio		DRAWING NO. 1 OF 1 Dwg. Of

Planning & Design
Department of Veterans Affairs