


SHEET NOTES

SHEET KEYNOTES

- FURNISH AND INSTALL ISOLATION VALVES ON SUPPLY AND RETURN PIPING UNDER THE BASE BID.
- FURNISH AND INSTALL ENDCAPS ON SUPPLY AND RETURN VALVES UNDER DEDUCTIVE ALTERNATE #1.
- NO NEW HVAC-RELATED WORK IN THIS AREA UNDER DEDUCTIVE ALTERNATE #1, INCLUDING AIR TERMINAL UNITS AND PIPING.

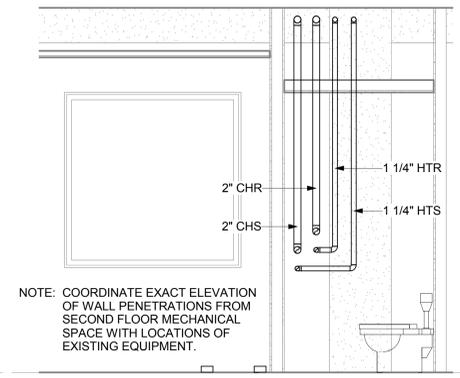


NOTE: COORDINATE EXACT ELEVATION OF WALL PENETRATIONS FROM SECOND FLOOR MECHANICAL SPACE WITH LOCATIONS OF EXISTING EQUIPMENT.

2nd Floor  
117' - 10"


NEW PIPING FROM SECOND FLOOR MECHANICAL SPACE

1/2" = 1'-0"

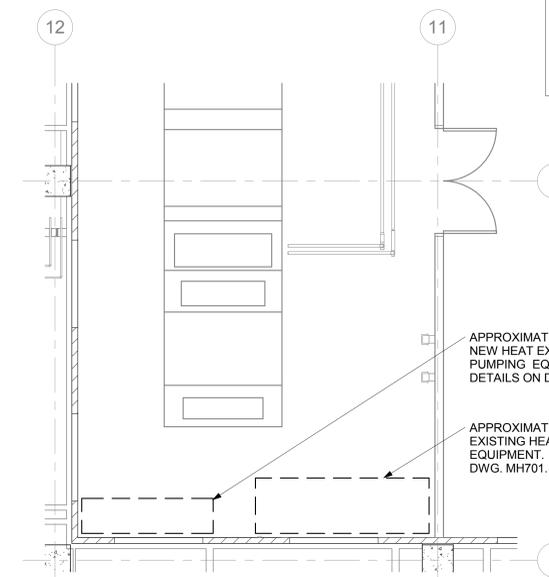



2ND FLOOR - PART PLAN - MECH ROOM - NEW PIPING

1/4" = 1'-0"



3RD FLOOR - NEW MECHANICAL PIPING

1/4" = 1'-0"

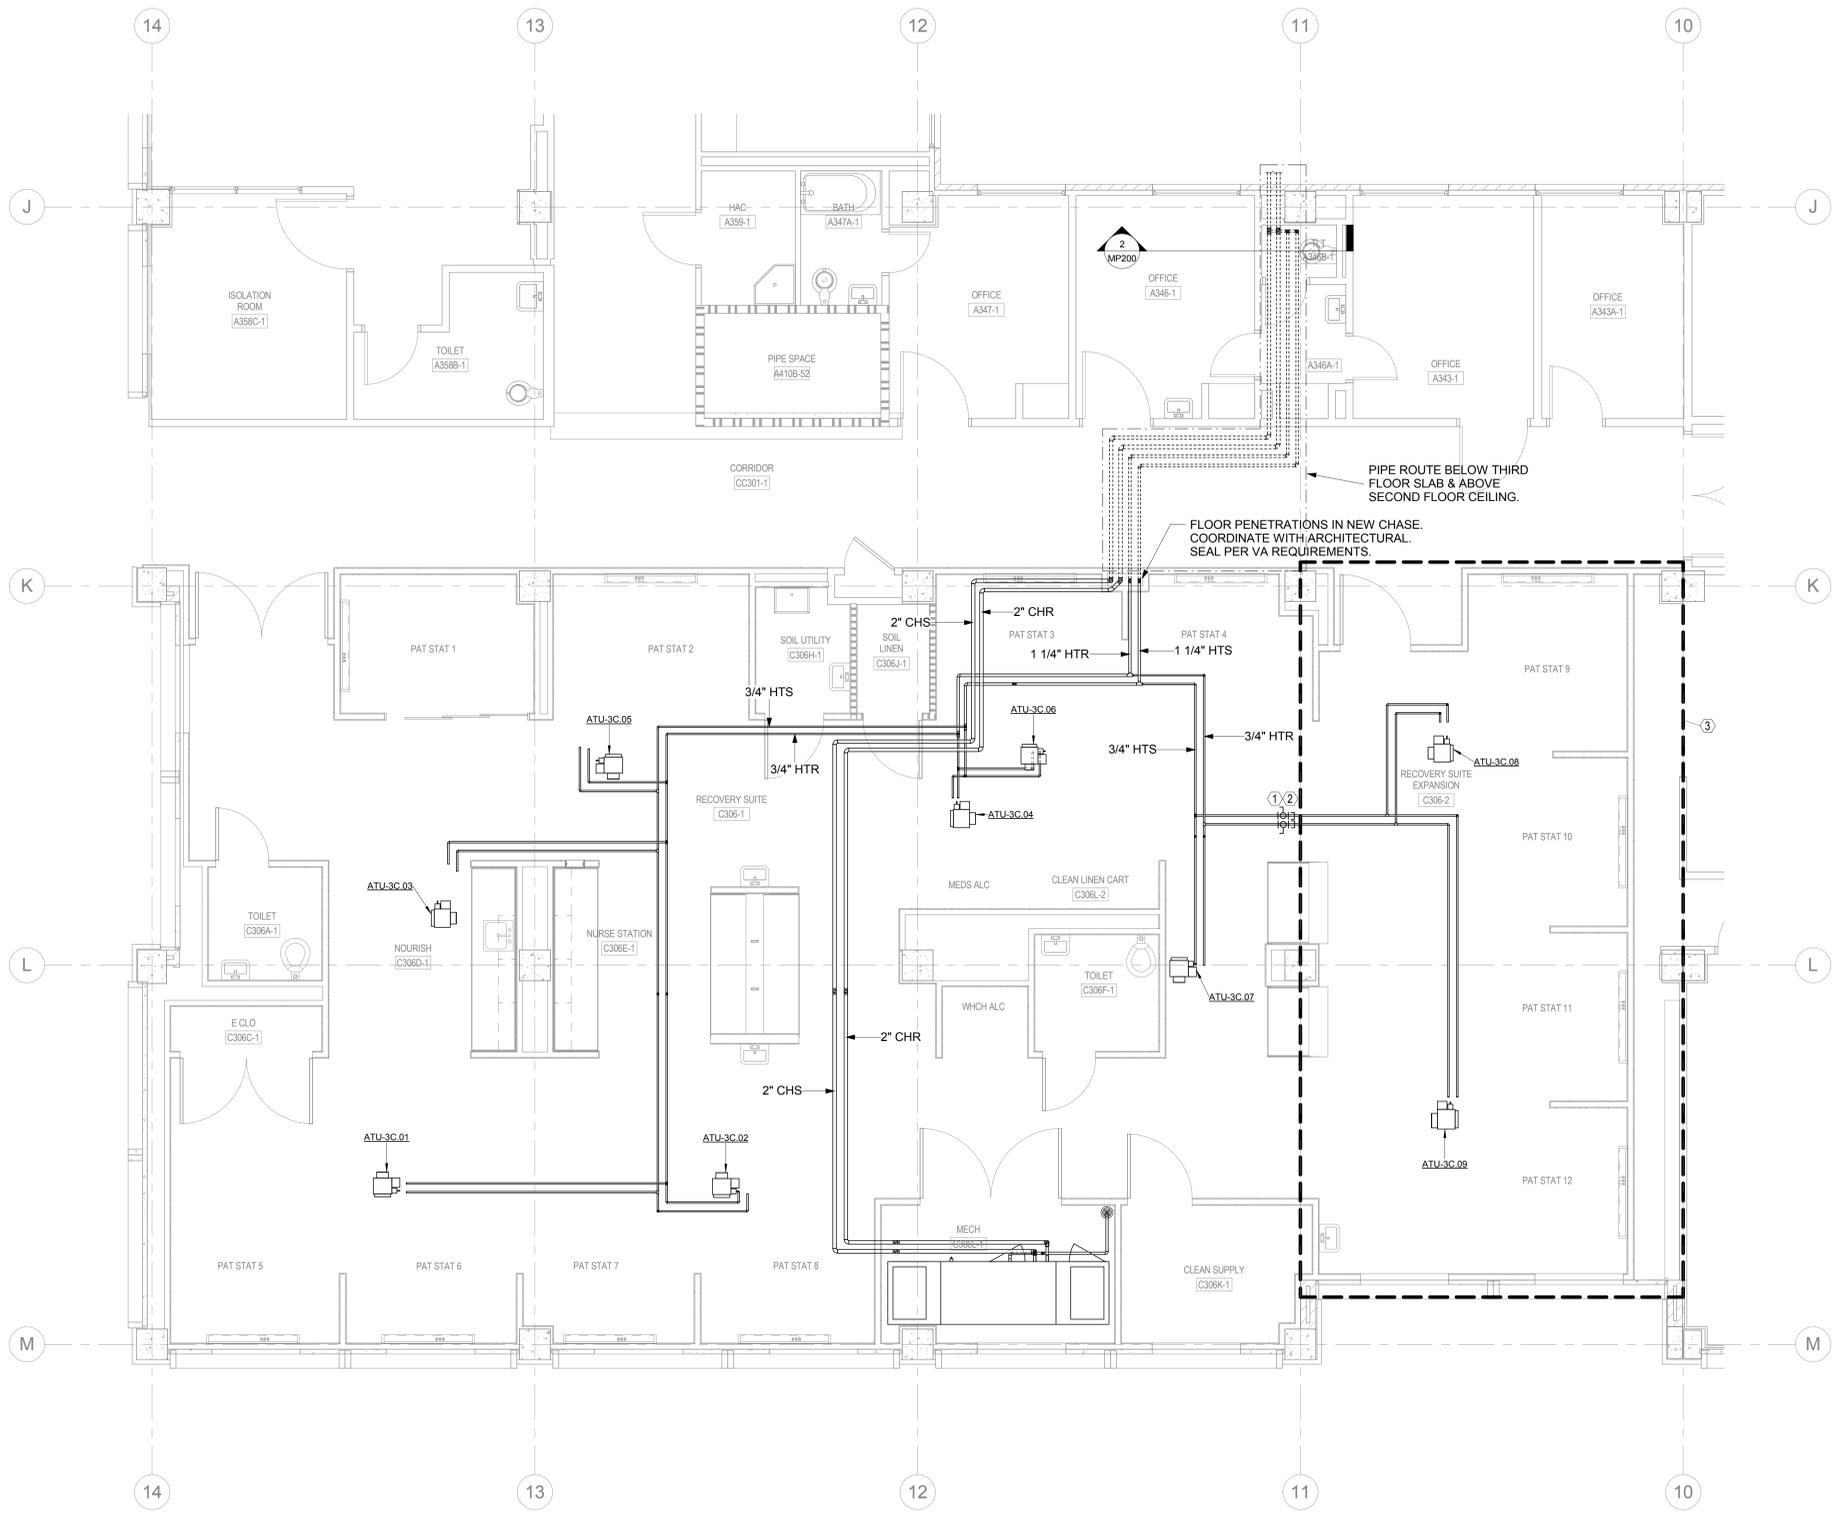

CONSULTANTS:

ENGINEER - OF - RECORD FL. P.E. NO. 53279  
MARK G. HERTZ

ARCHITECT/ENGINEERS:  
**AKEA** INC.  
3603 NW 98th Street, Suite B  
Gainesville, FL 32606  
Phone: (352) 474-6124  
Fax: (352) 474-6324  
COA: FL #26693  
AKEA Project No. 094-14

Drawing Title  
**THIRD FLOOR PLAN - NEW MECHANICAL PIPING**

Approved: Project Director

Project Title  
**RENOVATE WARD 3C FOR CARDIOLOGY EQUIPMENT INSTALLATION**

Location  
**GAINESVILLE, FLORIDA**

Date  
MARCH 9, 2018

Checked  
MGH

Drawn  
TJM

Project Number  
573-CSI-102

Building Number  
1

Drawing Number  
**MP200**  
29 OF 62

Office of Construction and Facilities Management

Department of Veterans Affairs

FINAL DESIGN  
APPROVED FOR CONSTRUCTION