


SHEET NOTES

- EXISTING CONDITIONS, AS DEPICTED, HAVE BEEN GATHERED FROM AS-BUILT DOCUMENTS AND LIMITED SURVEYS AND ARE, IN PART, UNVERIFIED. THE CONTRACTOR SHALL VERIFY EXISTING CONDITIONS PRIOR TO BEGINNING CONSTRUCTION DEMOLITION AND NEW WORK.
- NOT ALL EXISTING DUCT SIZES ARE SHOWN. EXISTING DUCT SIZES AND DUCT LOCATIONS ARE APPROXIMATE.

SHEET KEYNOTES

- REMOVE EXHAUST BRANCH DUCT AND AIR DEVICE IN THIS AREA. CAP AND SEAL CONNECTION TO EXISTING MAIN DUCT.
- REMOVE EXHAUST BRANCH DUCT(S) AND AIR DEVICE(S) IN THIS AREA.
- REMOVE SUPPLY BRANCH DUCT AND AIR DEVICE IN THIS AREA. CAP AND SEAL CONNECTION TO EXISTING MAIN DUCT.
- REMOVE SUPPLY BRANCH DUCT(S) AND AIR DEVICE(S) IN THIS AREA.
- REMOVE EXHAUST MAIN DUCT. CAP AND SEAL EXISTING DUCT TO REMAIN IN LINE WITH CORRIDOR WALL.
- REMOVE SUPPLY MAIN DUCT. CAP AND SEAL EXISTING DUCT TO REMAIN IN LINE WITH CORRIDOR WALL.
- REMOVE SUPPLY DUCT BACK TO CORRIDOR WALL. CAP AND SEAL DUCT AT CORRIDOR WALL WITHIN THE WORK AREA.

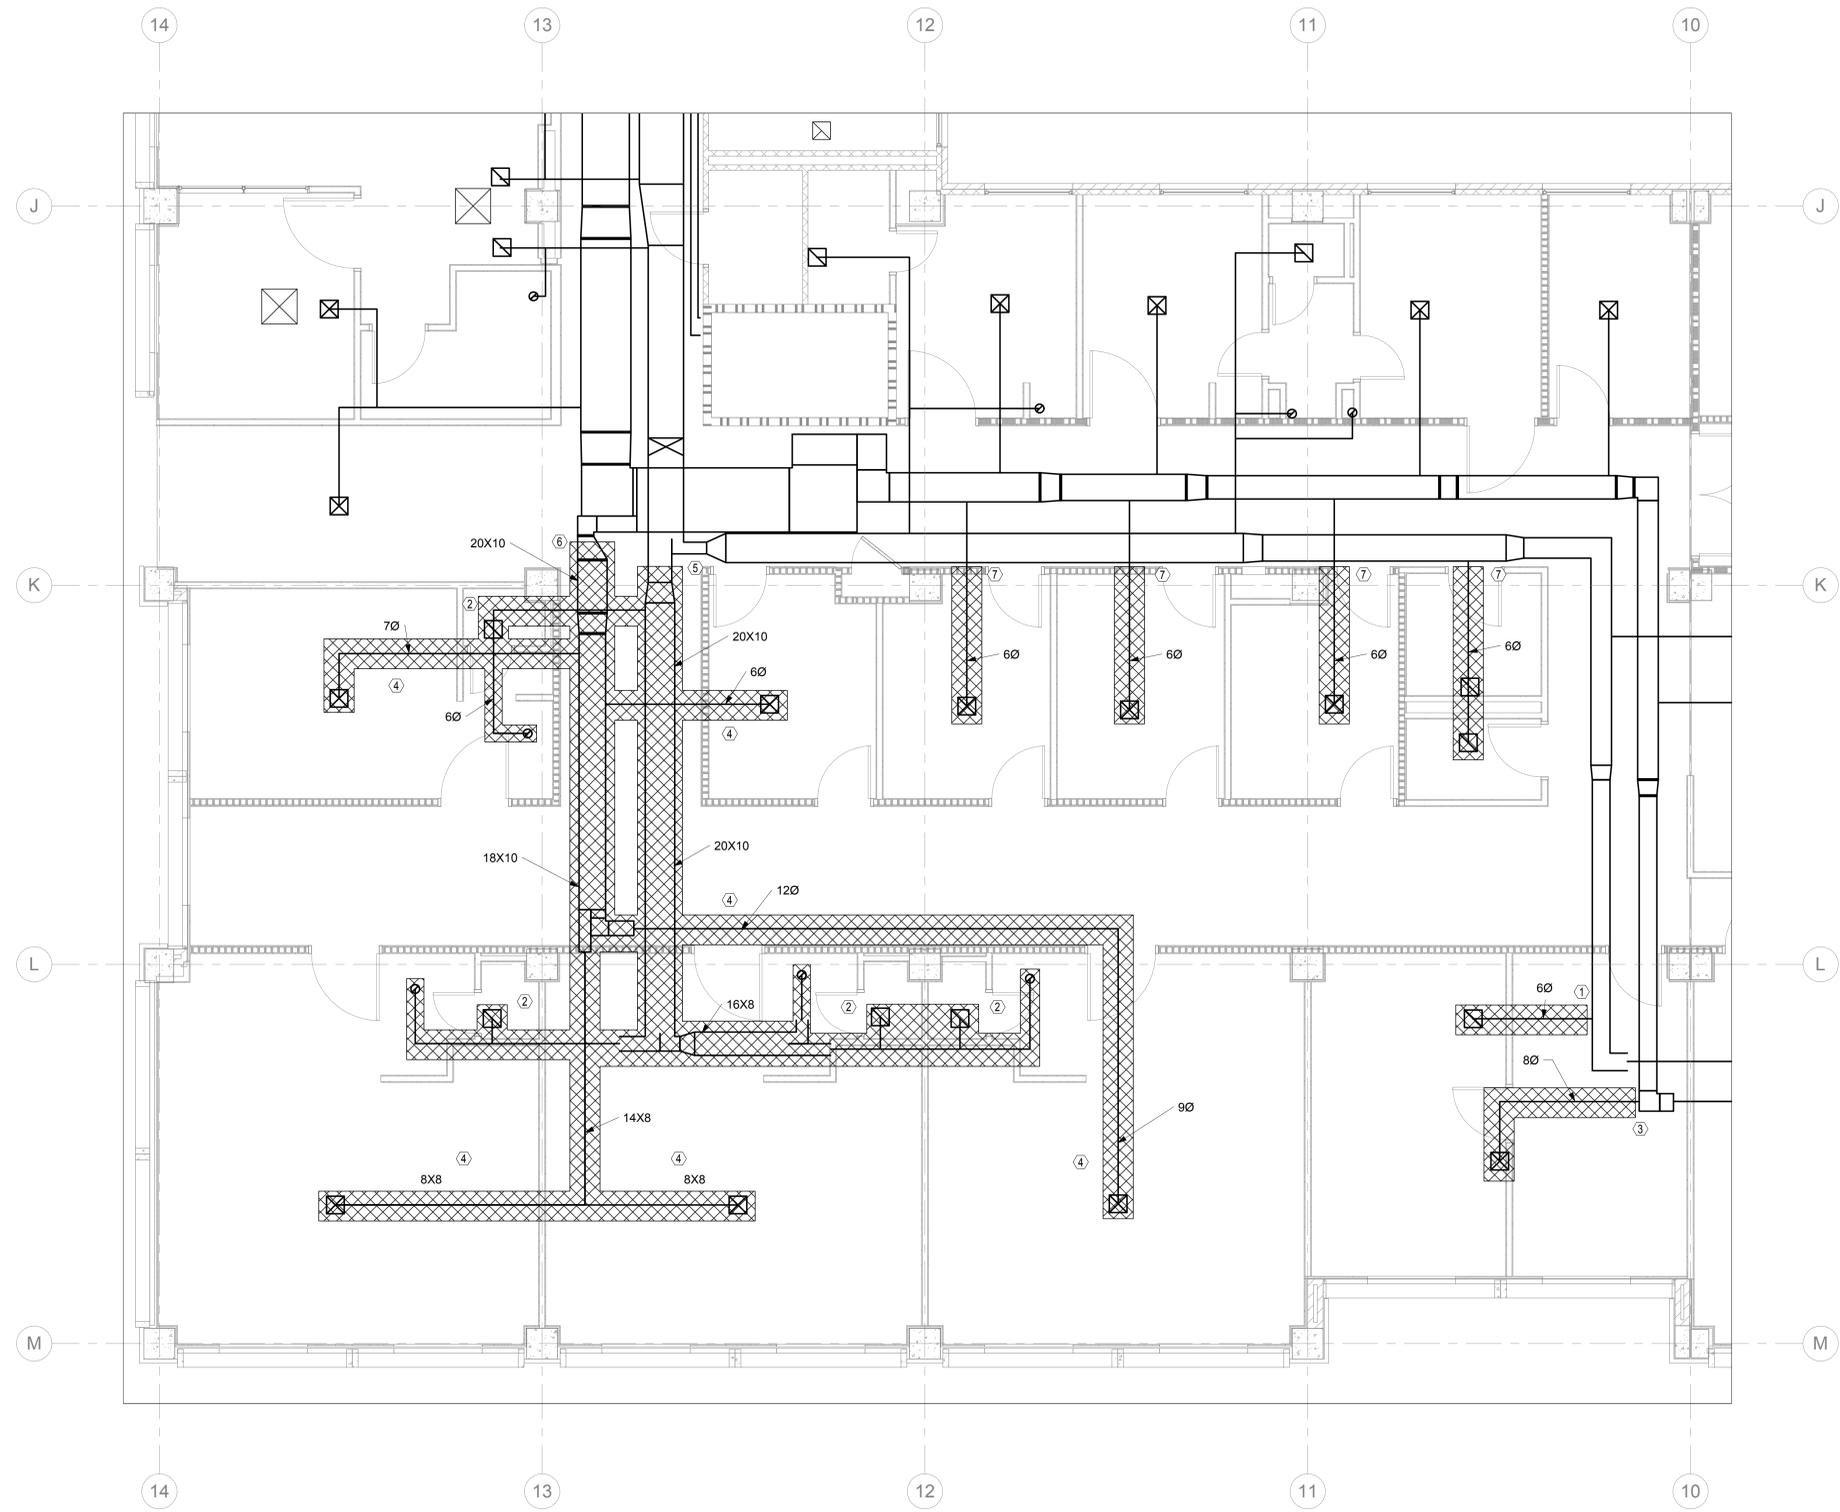

1 THIRD FLOOR HVAC PLAN - DEMOLITION
1/4" = 1'-0"



FINAL DESIGN
APPROVED FOR CONSTRUCTION

three inches = one foot
one and one half inches = one foot
one inch = one foot
three quarters inch = one foot
one half inch = one foot
three eighths inch = one foot
one quarter inch = one foot
one eighth inch = one foot

Revisions:	Date

CONSULTANTS:

ENGINEER - OF - RECORD FL. P.E. NO. 53279
MARK G. HERTZ

ARCHITECT/ENGINEERS:

AKEA INC.
3603 NW 98th Street, Suite B
Gainesville, FL 32606
Phone: (352) 474-6124
Fax: (352) 474-6324
COA: FL #26693
AKEA Project No. 094-14

Drawing Title
THIRD FLOOR HVAC PLAN - DEMOLITION

Approved: Project Director

Project Title
RENOVATE WARD 3C FOR CARDIOLOGY EQUIPMENT INSTALLATION

Location
GAINESVILLE, FLORIDA

Date
MARCH 9, 2018

Checked
MGH

Drawn
TJM

Project Number
573-CSI-102

Building Number
1

Drawing Number
MD100
16 OF 62

Office of Construction and Facilities Management

Department of Veterans Affairs