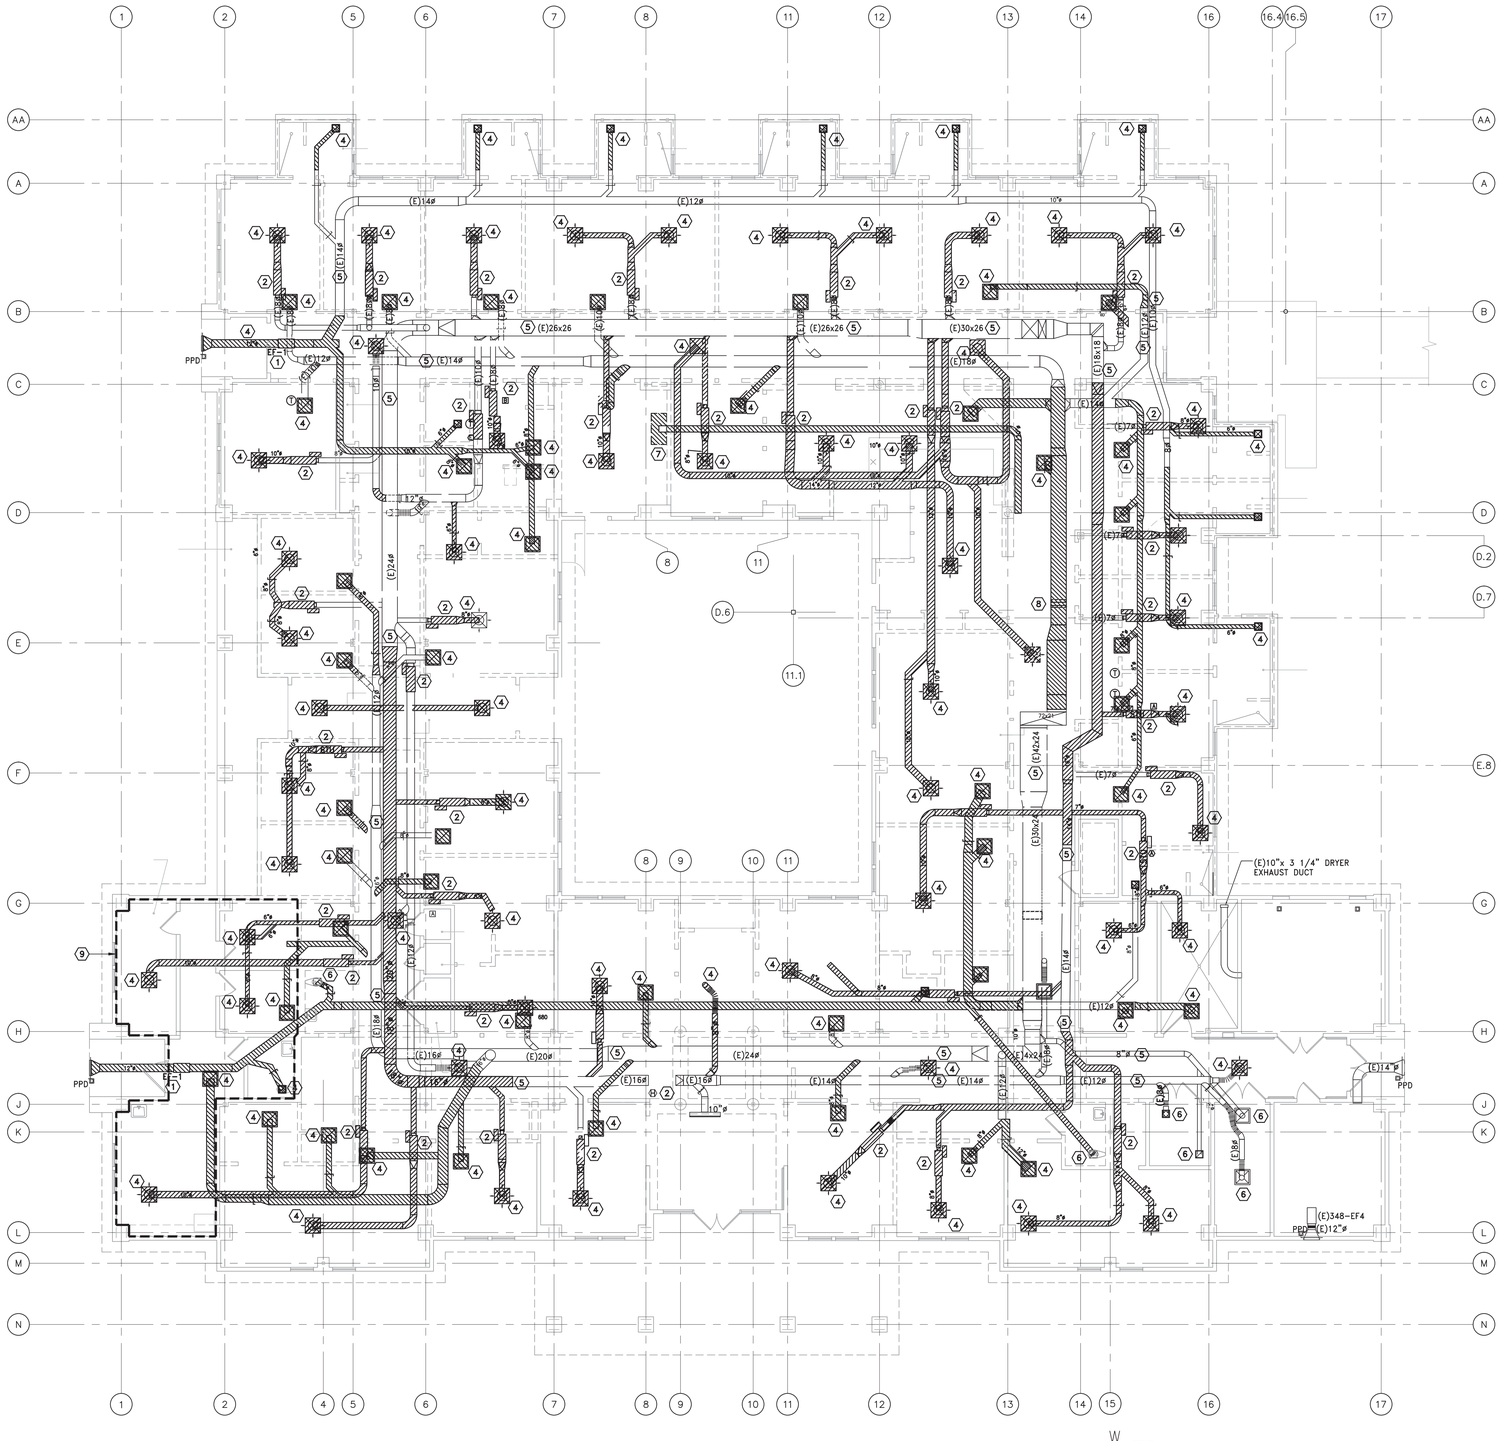

1 FLOOR PLAN
1/8"=1'-0"

0 4' 8' 16' 24'

TRUE NORTH

GENERAL NOTES

1. CONTRACTOR SHALL REMOVE AND STORE HVAC DIFFUSERS AND GRILLES. WRAP EACH ITEM UPON REMOVAL TO PREVENT SCRATCHING AND DENTS. COORDINATE STORAGE LOCATION WITH OWNER'S REPRESENTATIVE. CONTRACTOR TO ENCAPSULATE ALL EXPOSED (OPEN) ENDS OF MECHANICAL DUCTWORK IN AREA OF WORK WITH PROTECTIVE COVERINGS TO PREVENT MIGRATION OF DUST, DIRT, AND DEBRIS INTO THE MECHANICAL SYSTEM.
2. NOT USED.
3. SEE MD-102 FOR VAV TERMINAL UNITS PIPING DEMOLITION.
4. REFER TO DUCTWORK SHOP DRAWINGS PREPARED BY THE INSTALLING CONTRACTOR IN 1994 FOR VERIFICATION OF SIZE AND ARRANGEMENT OF BUILDING EXISTING DUCT SYSTEMS. THESE DRAWINGS ARE AVAILABLE BY REQUEST FROM THE COR.

KEYED NOTES

1. REMOVE EXISTING EXHAUST FANS EF-1 AN EF-2 WITH DUCTWORK AS INDICATED
2. REMOVE VAV TERMINAL UNIT.
3. NOT USED
4. REMOVE DUCTWORK AS INDICATED, DUCT DEVICES, DIFFUSERS AND GRILLES. STORE OR DISPOSE AS DIRECTED BY COR.
5. EXISTING DUCTWORK TO REMAIN. VACUUM CLEAN INTERIOR AND PROVIDE TEMPORARY END CAPS FOR ALL EXPOSED OPENINGS TO PREVENT INTRUSION OF DIRT AND DEBRIS DURING CONSTRUCTION. SEE M-101 FOR POINTS OF CONNECTION TO NEW WORK.
6. EXISTING DIFFUSER, RETURN GRILLE OR EXHAUST GRILLE TO REMAIN IN AREA WHERE NO CEILING WORK IS INDICATED.
7. REMOVE EXISTING KITCHEN EXHAUST HOOD AND DUCTWORK TO POINT OF TERMINATION AT MECHANICAL EQUIPMENT WELL ON ROOF. REPAIR OPENINGS AS DIRECTED IN SPECIFICATIONS.
8. REMOVE EXISTING AIRFLOW MEASURING STATION AND STORE FOR REINSTALLATION. SEE 1/MH101.
9. POLICE ANNEX WILL REMAIN OCCUPIED THROUGHOUT CONSTRUCTION. SCHEDULE ALL DEMOLITION TO MINIMIZE DISRUPTION OF OCCUPANCY. CONTRACTOR TO PROVIDE, AT NO ADDITIONAL COST TO THE GOVERNMENT, TEMPORARY HVAC PORTABLE COOLING SYSTEM OF NOT LESS THAN 24 MBTUH SENSIBLE CAPACITY WITH TEMPORARY DISTRIBUTION DUCTWORK WITHIN THE POLICE ANNEX TO SERVE ALL OCCUPIED AREAS AS WELL AS ELECTRIC SPACE HEATERS DURING ENTIRE PERIOD THAT EXISTING OR NEW SYSTEMS ARE NOT FULLY FUNCTIONAL.

FULLY PRINKLERED

-	-
-	-
-	-
-	-
-	-
-	-
-	-
REVISION 1	05/16/2018
BID SET	04/03/2018
Revisions:	Date

CONSULTANTS:

ARSENIO ORTEGA, P.E.
CONSULTING ENGINEER
5 Third Street, Suite 716
San Francisco, CA 94103
(415) 546-0490 tel -0491 fax

BRYAN BENNO BRAUER,P.E.
CONSULTING ENGINEER
PO BOX 2586, TRUCKEE, CA 96160 (530)582-8683
BRYAN@BBBRAUER.COM

Stamp and Signature

REGISTERED PROFESSIONAL ENGINEER — BRYAN B BRAUER — No. M 24690 — Exp. 9-30-2018 — MECHANICAL — STATE OF CALIFORNIA

ARCHITECT/ENGINEERS:

KPA — THE KPA GROUP
ENGINEERS ARCHITECTS
6700 KOLL CENTER PARKWAY SUITE 125
PLEASANTON, CALIFORNIA 94566
TEL 925.223.8217 www.thekpagroup.com

©THE KPA GROUP 2018
KPA Project No. 576.00

Drawing Title: HVAC DEMO PLAN

Approved Project Director: - / - / VAPAHCS PLANNING AND ENGINEERING

Project Title: 348 HOMELESS RESOURCE CENTER

Location: 795 WILLOW ROAD, MENLO PARK, CA 94025

Date: 04/03/2018 | Checked: PWP | Drawn: KPA TEAM

Project Number: 640-14-124

Building Number: 348

Drawing Number: MD101

Dwg. of

Office of Construction and Facilities Management

VA PAHCS — Veterans Affairs — Palo Alto Health Care System

VA FORM 08-6231

D:\Documents\e_jobs2015\20513 VA Renovate Building 348 for Hospice\drawings\$2015\MPF_2017 mods1.dwg 5-14-18 11:17:35 AM Bryan

one inch = one foot | three quarters inch = one foot | one half inch = one foot | three eighths inch = one foot | one quarter inch = one foot | one eighth inch = one foot | three inches = one foot | one and one half inches = one foot