


three inches = one foot  
one and one-half inches = one foot  
one inch = one foot  
three-quarters inch = one foot  
one-half inch = one foot  
three-eighths inch = one foot  
one-quarter inch = one foot  
one-eighth inch = one foot

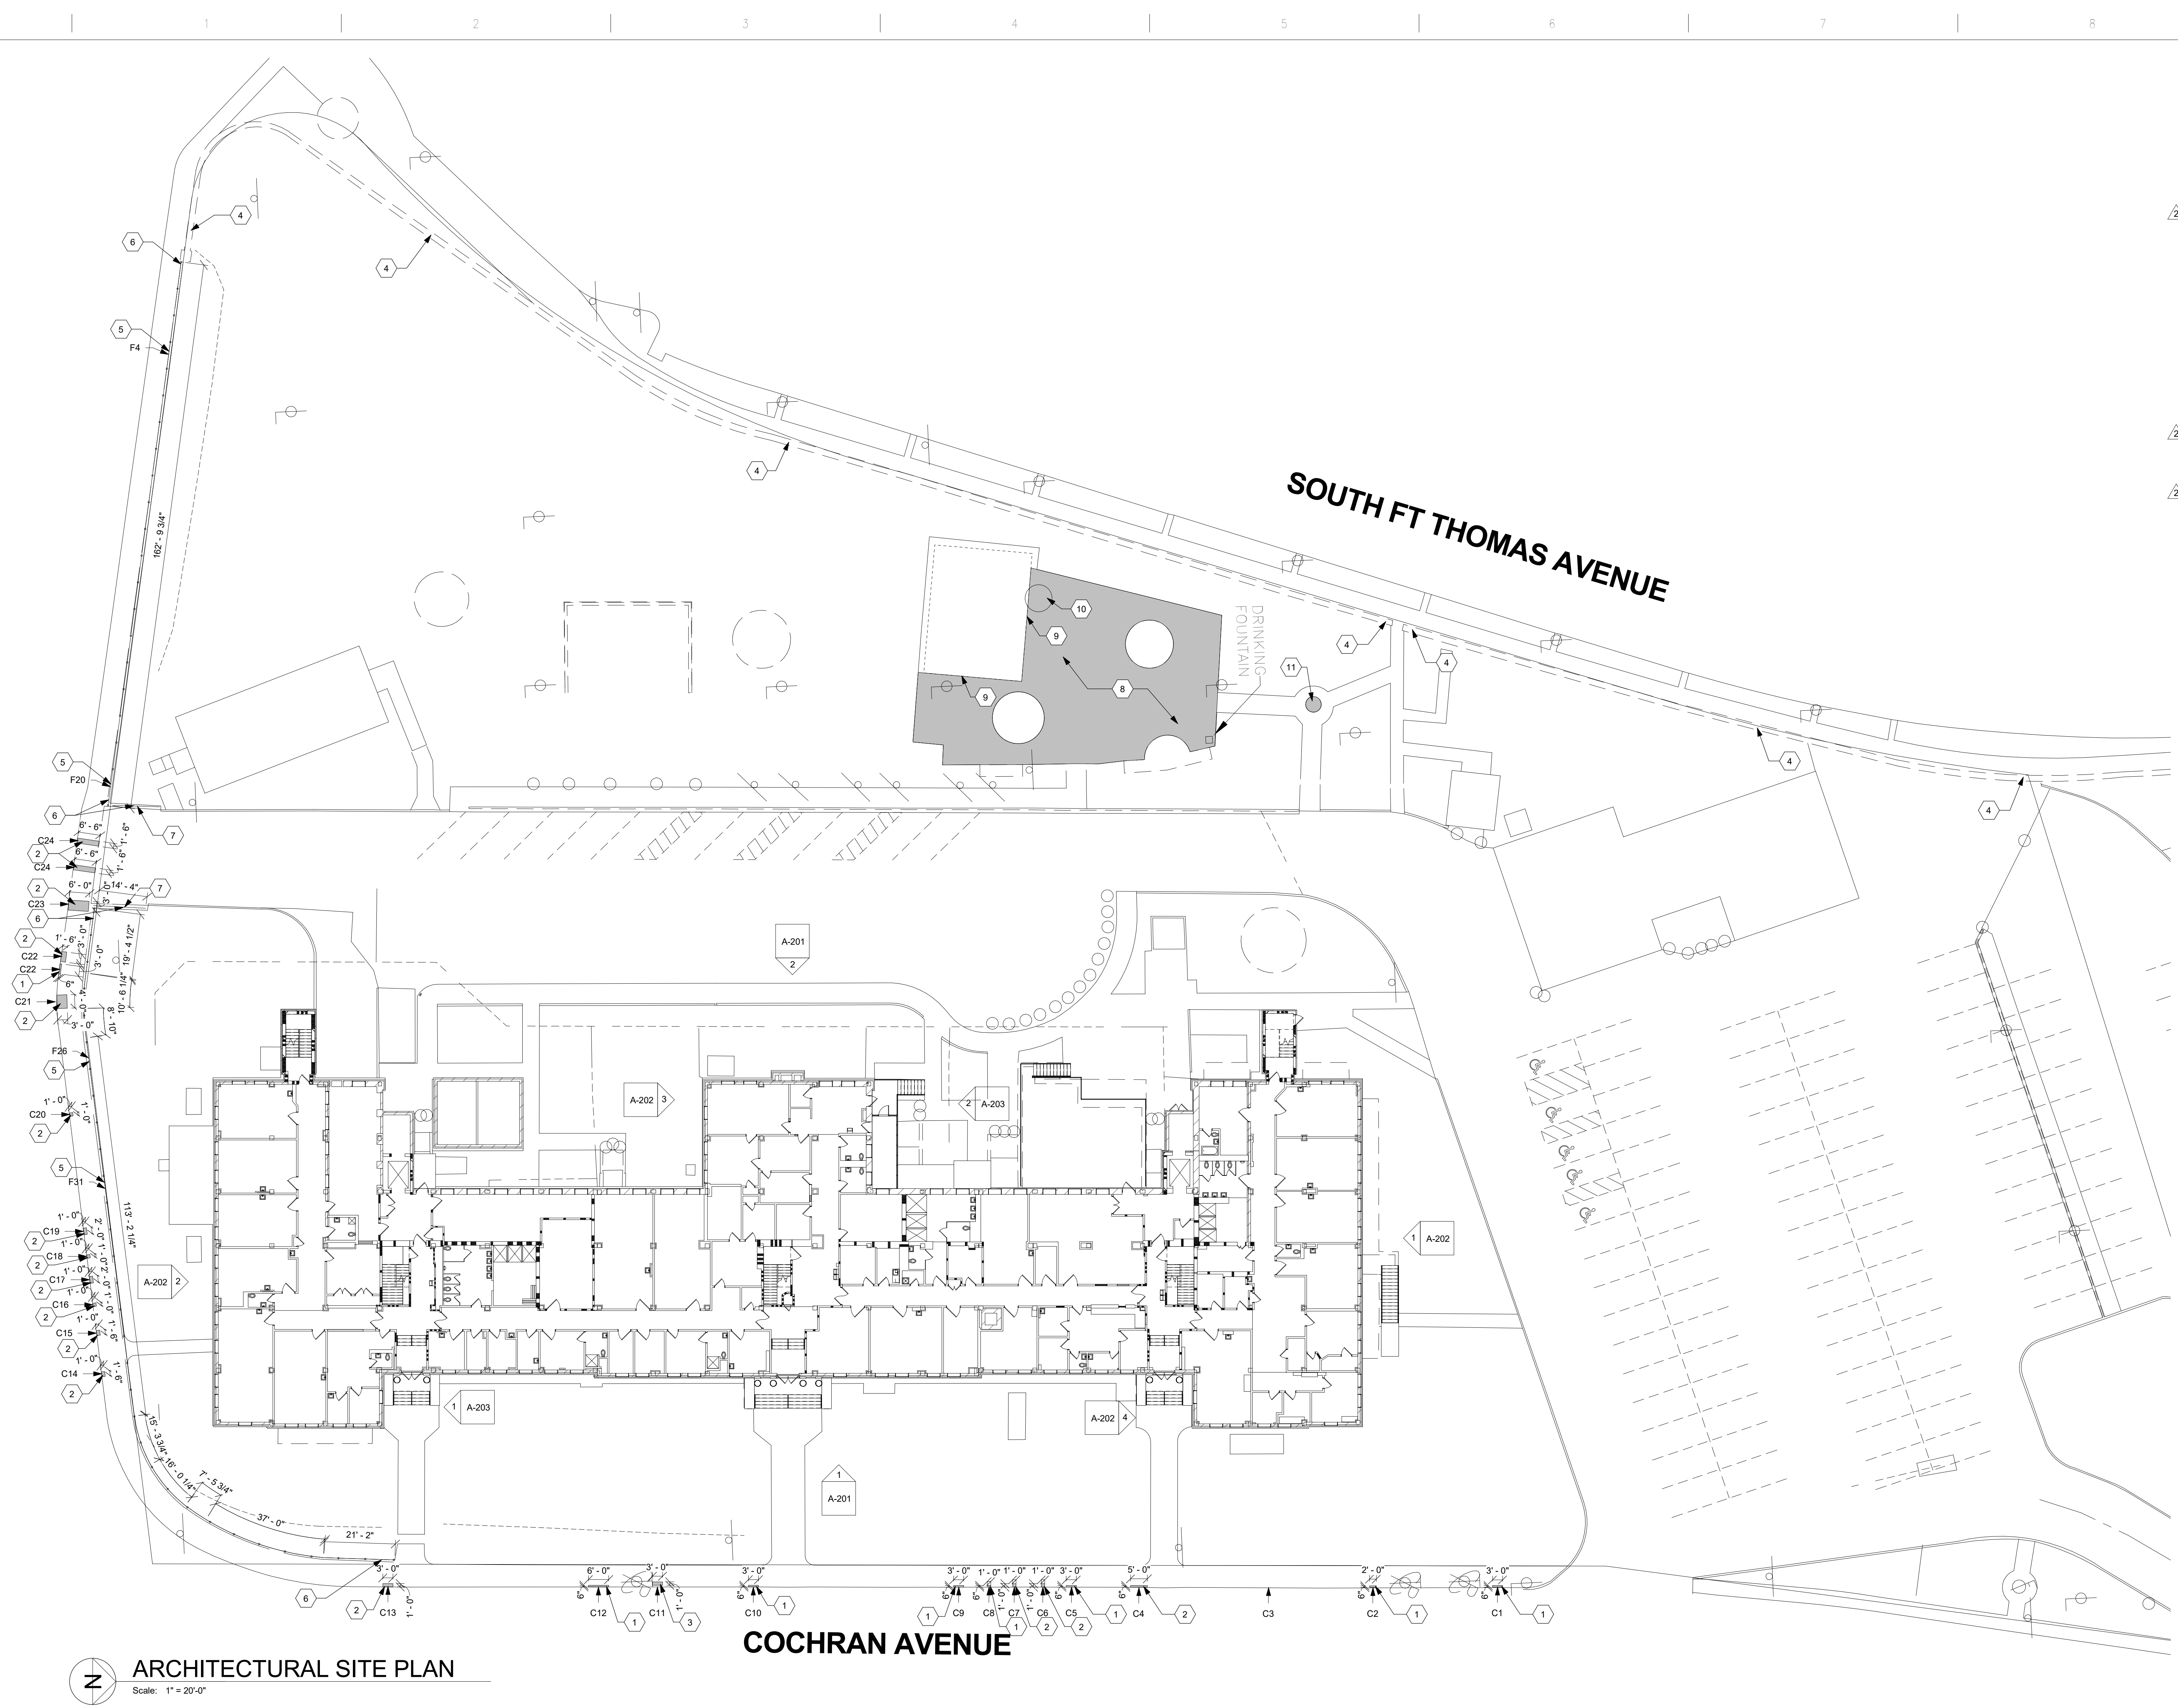

- Site Plan Key Notes:**  
(All may not apply to this sheet)
- SAWCUT AND REMOVE EXISTING DAMAGED SIDEWALK CURB. POUR NEW CONCRETE SIDEWALK CURB. SEE CURB DETAIL 3/A-501 FOR MORE INFORMATION.
  - SAWCUT AND REMOVE EXISTING DAMAGED SIDEWALK AND CURB. POUR NEW CONCRETE SIDEWALK AND CURB. SEE SIDEWALK AND CURB DETAIL 4/A-501 FOR MORE INFORMATION.
  - SAWCUT AND REMOVE EXISTING DAMAGED SIDEWALK. POUR NEW CONCRETE SIDEWALK. SEE DETAIL 5/A-501 FOR MORE INFORMATION.
  - CLEAN ALL FACES OF EXISTING KENTUCKY FIELD STONE WALL USING A CONCENTRATED ACIDIC CLEANER AND PRESSURE WASHER. RAKE OUT JOINTS MINIMUM 1". BRUSH CLEAN, AND INSTALL NEW TYPE S MASONRY CEMENT WITH FINE SAND AT PORTIONS OF WALL AS NEEDED, NOT TO EXCEED 900 SF TOTAL. PROVIDE KENTUCKY FIELD STONE WHERE NEEDED TO FILL EXISTING GAPS. USE WEATHERED STONE IF AVAILABLE OR NEW IF NECESSARY TO PROVIDE BEST MATCH TO EXISTING POSSIBLE. SEAL ALL FACES OF WALL WITH CLEAR PENETRATING SEALER.
  - REPLACE DAMAGED 8' SECTION OF ORNAMENTAL STEEL FENCE TO MATCH EXISTING.
  - REPAINT ENTIRE ORNAMENTAL STEEL FENCE. REMOVE RUST, CLEAN, AND PATCH AS NEEDED PRIOR TO PAINTING.
  - REMOVE EXISTING STEEL GATE.
  - REMOVE INDICATED PORTION OF CONCRETE PATIO. REPLACE WITH NEW 4" CONCRETE CONSTRUCTION PER DETAIL 6/A-501. PROVIDE EXPANSION JOINTS AT CONNECTIONS TO EXISTING WALKS AND SLABS PER DETAIL 7/A-501.
  - SAWCUT EXISTING SLAB IN LINE WITH EDGE OF ROOF ABOVE.
  - PROVIDE NEW 4" CONCRETE CONSTRUCTION PER DETAIL 6/A-501 IN AREA OF PREVIOUS LANDSCAPE AREA.
  - REMOVE EXISTING CONCRETE AND BRICK VETERANS MONUMENT. SALVAGE EXISTING EAGLE AND TWO PLAQUES FOR REINSTALLATION ON NEW MONUMENT. NEW MONUMENT TO BE PROVIDED AND INSTALLED BY CONTRACTOR TO MATCH DIMENSIONS AND GENERAL APPEARANCE OF EXISTING MONUMENT TO BE REMOVED. EXISTING MONUMENT CONSISTS OF 12" CONCRETE BASE WITH 4'-4" TALL, 4'-0" DIAMETER BRICK BODY, AND 2" TALL 4'-4" DIAMETER CONCRETE CAP. PROVIDE REINFORCED CONCRETE CORE WITH 1-1/2" AIRSPACE BEHIND FACE BRICK AND PROVIDE WEEPS AT BASE OF BRICK. TOP OF CAP TO SLOPE AWAY FROM CENTER TO ENSURE DRAINAGE. PROVIDE SHOP DRAWING SUBMITTALS FOR REVIEW AND APPROVAL.

**ARCHITECTURAL SITE PLAN**  
Scale: 1" = 20'-0"

CONSULTANTS:		ARCHITECT/ENGINEERS:		Drawing Title		Project Title		Project No.		Office of Construction and Facilities Management	
				ARCHITECTURAL SITE PLAN		CORRECT FCA DEFICIENCIES - FTD EXTERIOR DEFICIENCIES		VA Project No. #538-19-203 PFB Project No. 3714		Department of Veterans Affairs	
				Approved: Project Director		Location		Building Number			
						Fort Thomas, KY		64			
						Date		Drawing Number			
						10/27/2017		AS-101			
						Checked		Dwg. of			
						PFB					
						PFB					