



2 ATTIC ELECTRICAL PLAN
1/8" = 1'-0"

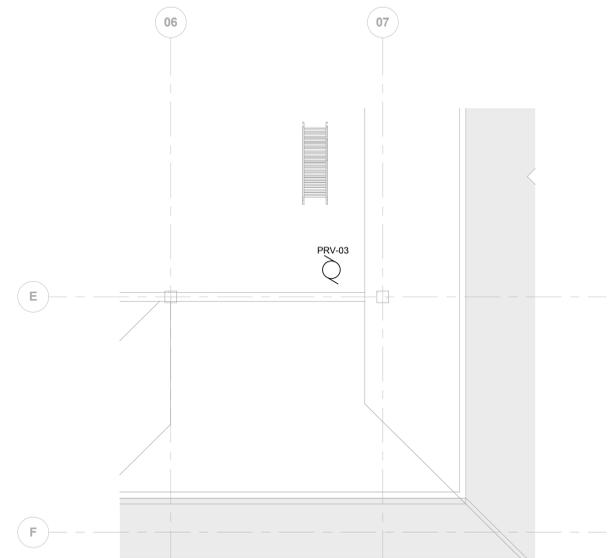

3 ROOF PLAN ELECTRICAL
1/8" = 1'-0"

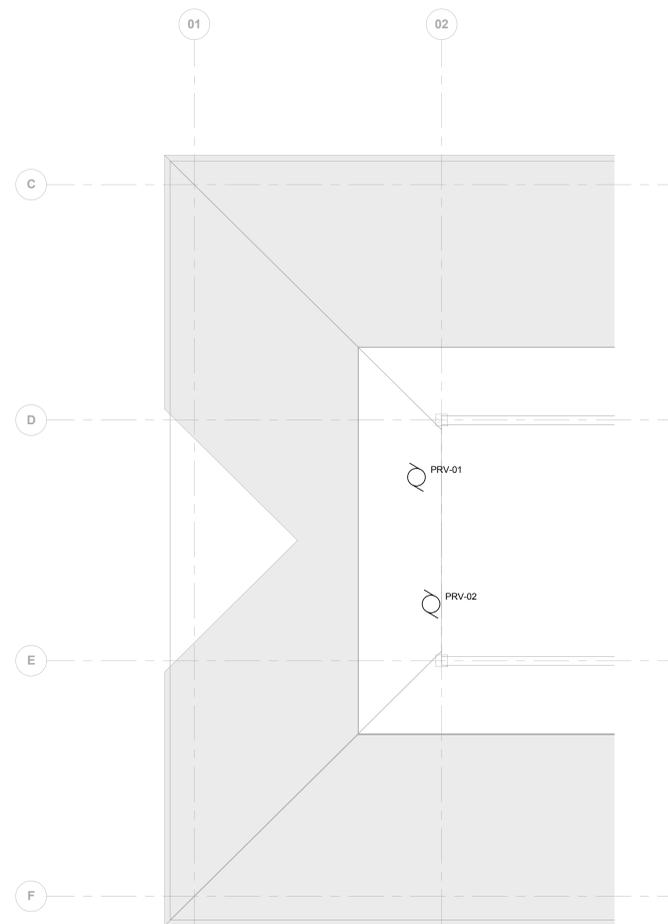

1 ROOF PLAN - ELECTRICAL
1/8" = 1'-0"

GENERAL NOTES:

A. EACH 20A CIRCUIT SHALL HAVE A DEDICATED NEUTRAL.

ATTIC KEY NOTES:

1 MOUNT OCCUPANCY SENSOR SUCH THAT IT TURNS ON THE LIGHTS WHEN THE SPACE IS ENTERED VIA THE LADDER, DOOR, OR STAIR.

ROOF KEY NOTES:

1 DIV. 26 TO ROUTE (2) 2" CONDUITS FROM TELEDATA ROOM #107 AND STUB UP THROUGH ROOF LOCATION. SEAL CONDUIT PENETRATIONS AND CAP FOR FUTURE ANTENNA CABLES.

100% OWNER REVIEW
NOT FOR CONSTRUCTION
12/16/2011



RSP Architects
1220 Marshall Street NE
Minneapolis
Minnesota 55413-1036
612.677.7100
612.677.7499 fax
www.rsparch.com



CONSULTANTS:

Structural
Van Sickle, Allen & Assoc.
2955 Xenium Lane N
Suite 10
Plymouth, MN 55441

Civil
EVS
10250 Valley View Road
Suite 113
Eden Prairie, MN 55344

Landscape
Damon Farber Assoc.
923 Nicollet Mall
Minneapolis, MN 55402

Fire Protection
Gary Trivinski Associates
Engineering
54 Boston Hill
Larkville, PA 18651-3298



MEP
Dunham Associates, Inc.
50 South Sixth Street, Suite 1100
Minneapolis, Minnesota 55402-1000
612.445.7900
612.445.7901
www.dunhaminc.com
mechanical + electrical
contracting engineering
LOWVOLTAGE

I hereby certify that this plan, specification or report was prepared by me or under my direct supervision and that I am a duly licensed Engineer under the laws of the State of Minnesota.

Signature _____
Registration No. _____
Date 11/17/2011

APPROVED: SENIOR LINE DIRECTOR	DATE	APPROVED: INFECTION CONTROL NURSE	DATE
APPROVED: SEHS COORDINATOR	DATE	APPROVED: PATIENT SAFETY	DATE
APPROVED: PROJECTS SECTION MANAGER	DATE	APPROVED: CHIEF OF POLICE	DATE
APPROVED: DIRECTOR ENG.	DATE	APPROVED: SAFETY MANAGER	DATE

PROJECT TITLE ELECTRICAL ATTIC AND ROOF PLAN	PROJECT TITLE LONG TERM INTERMEDIATE PSYCHIATRIC UNIT
DATE 12/16/2011	DATE AS NOTED
PROJECT NO. 2012.01.00	PROJECT NO. E007
DESIGNED BY MLA	CHECKED BY JAT
APPROVED: CHIEF OF STAFF	APPROVED: MEDICAL CENTER DIRECTOR

