

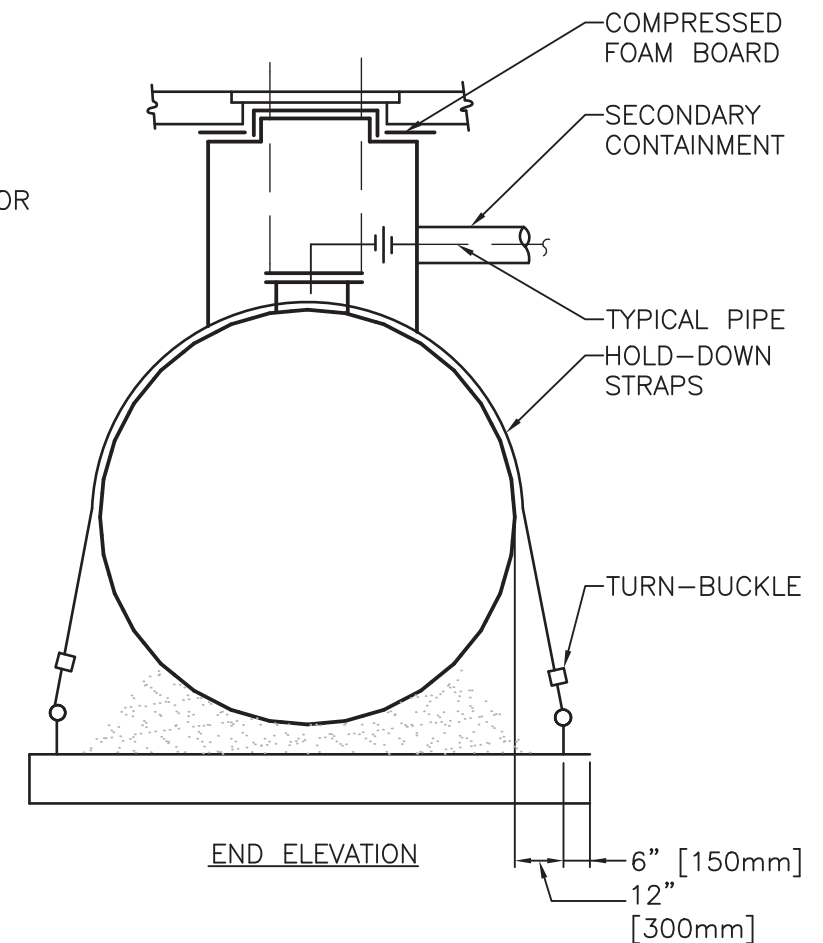


NOTE: THIS DETAIL SHOWS BASIC REQUIREMENTS ONLY AND IS NOT INTENDED FOR USE ON PROJECT DRAWINGS. THE PROJECT ENGINEER MUST PROVIDE A COMPLETE DESIGN WHICH CONFORMS TO PROJECT REQUIREMENTS.

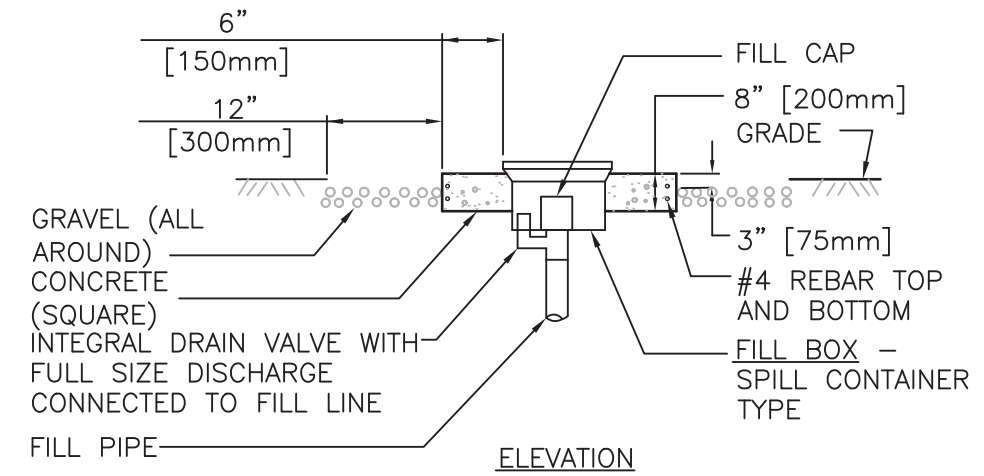

LADDER
STEEL OR ALUMINUM 2 1/2" [64mm] WIDE STRINGERS
3/4" [19mm] DIA. RUNGS
ANCHOR AT BOTTOM GUIDE AT TOP

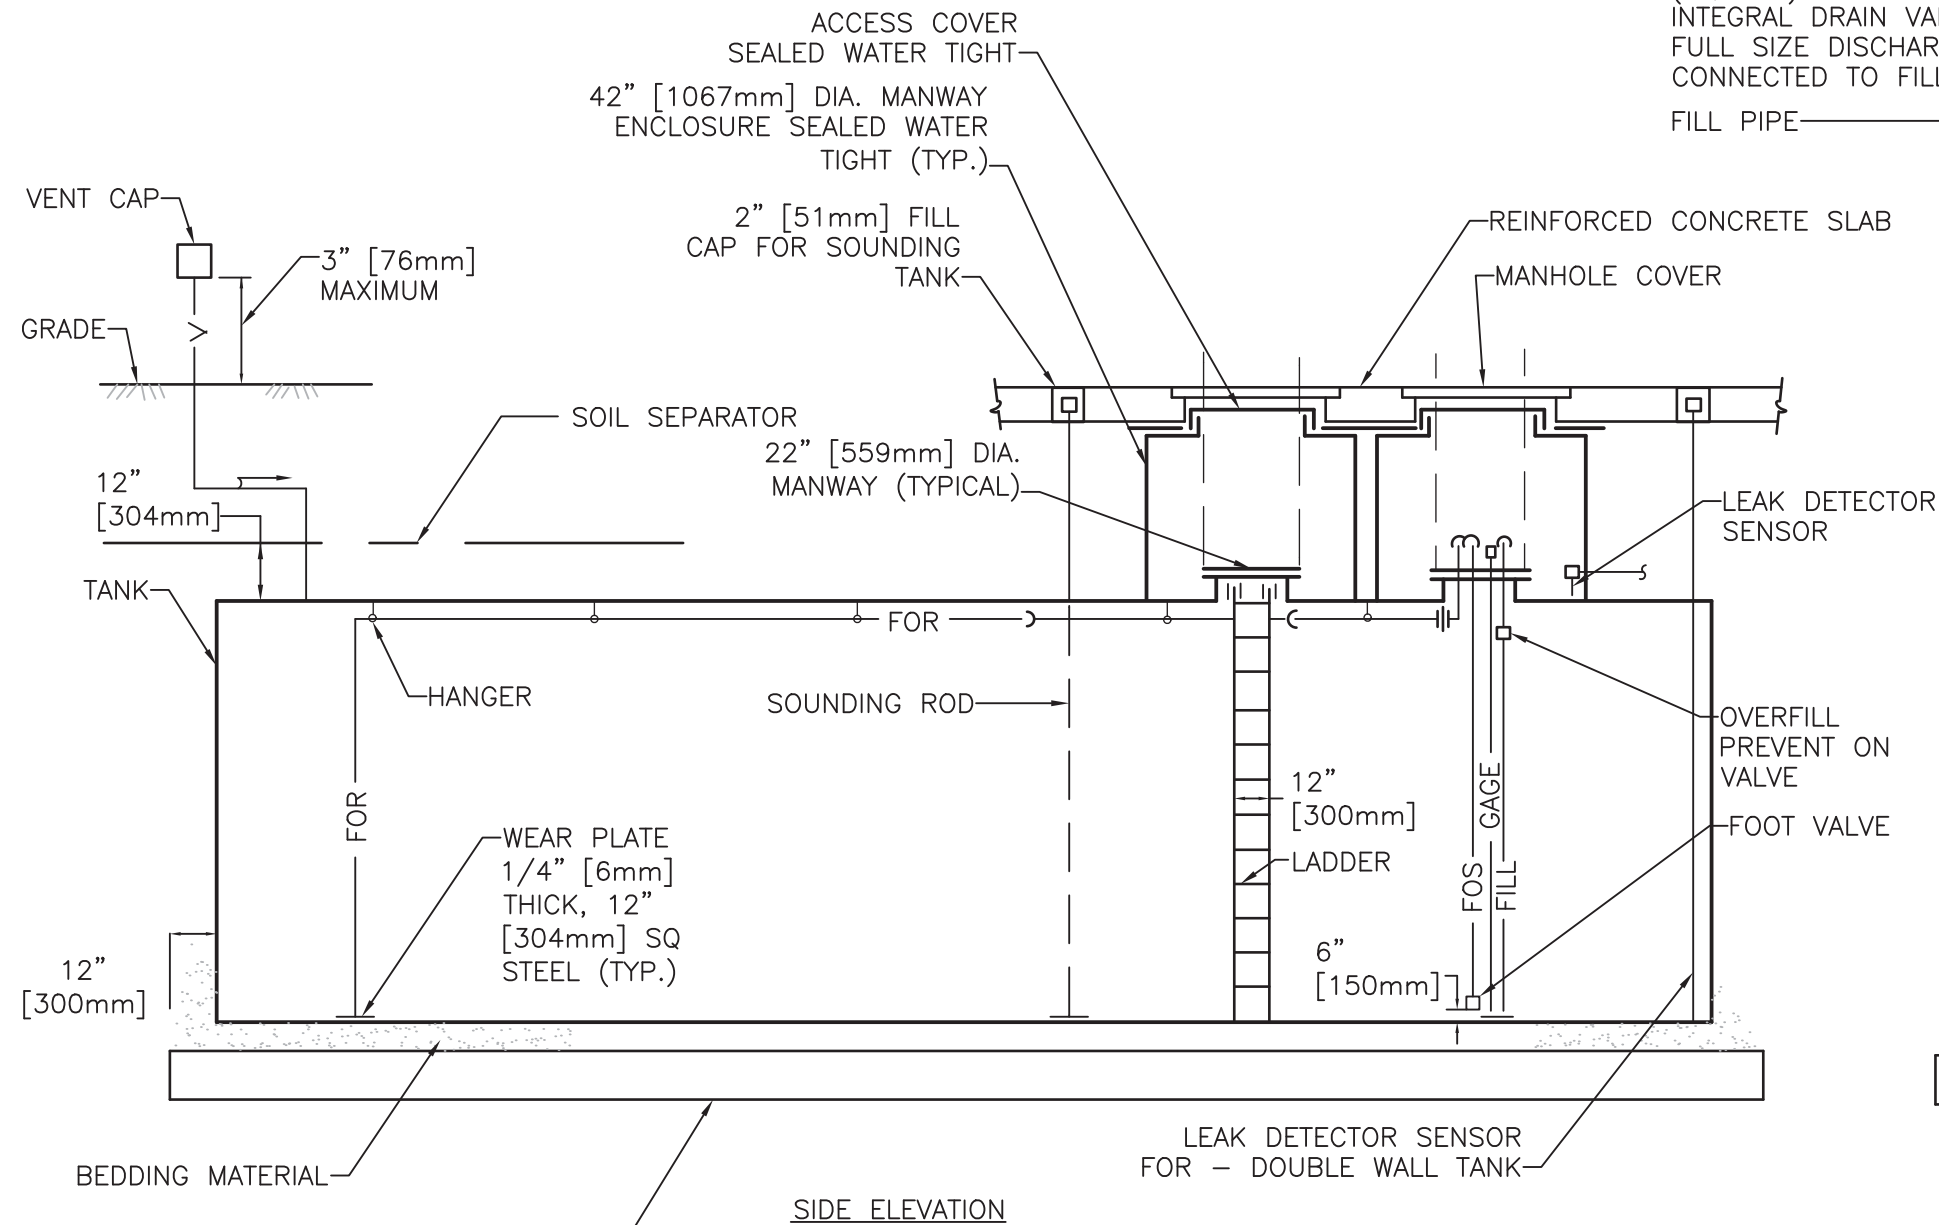

UNDERGROUND FUEL OIL STORAGE TANK

NTS

DETAIL TITLE / UNDERGROUND FUEL OIL STORAGE TANK

Department of
Veterans Affairs



SCALE : NONE

DATE ISSUED :DECEMBER 2008

CADD DETAIL NO. SD231000-01.DWG