
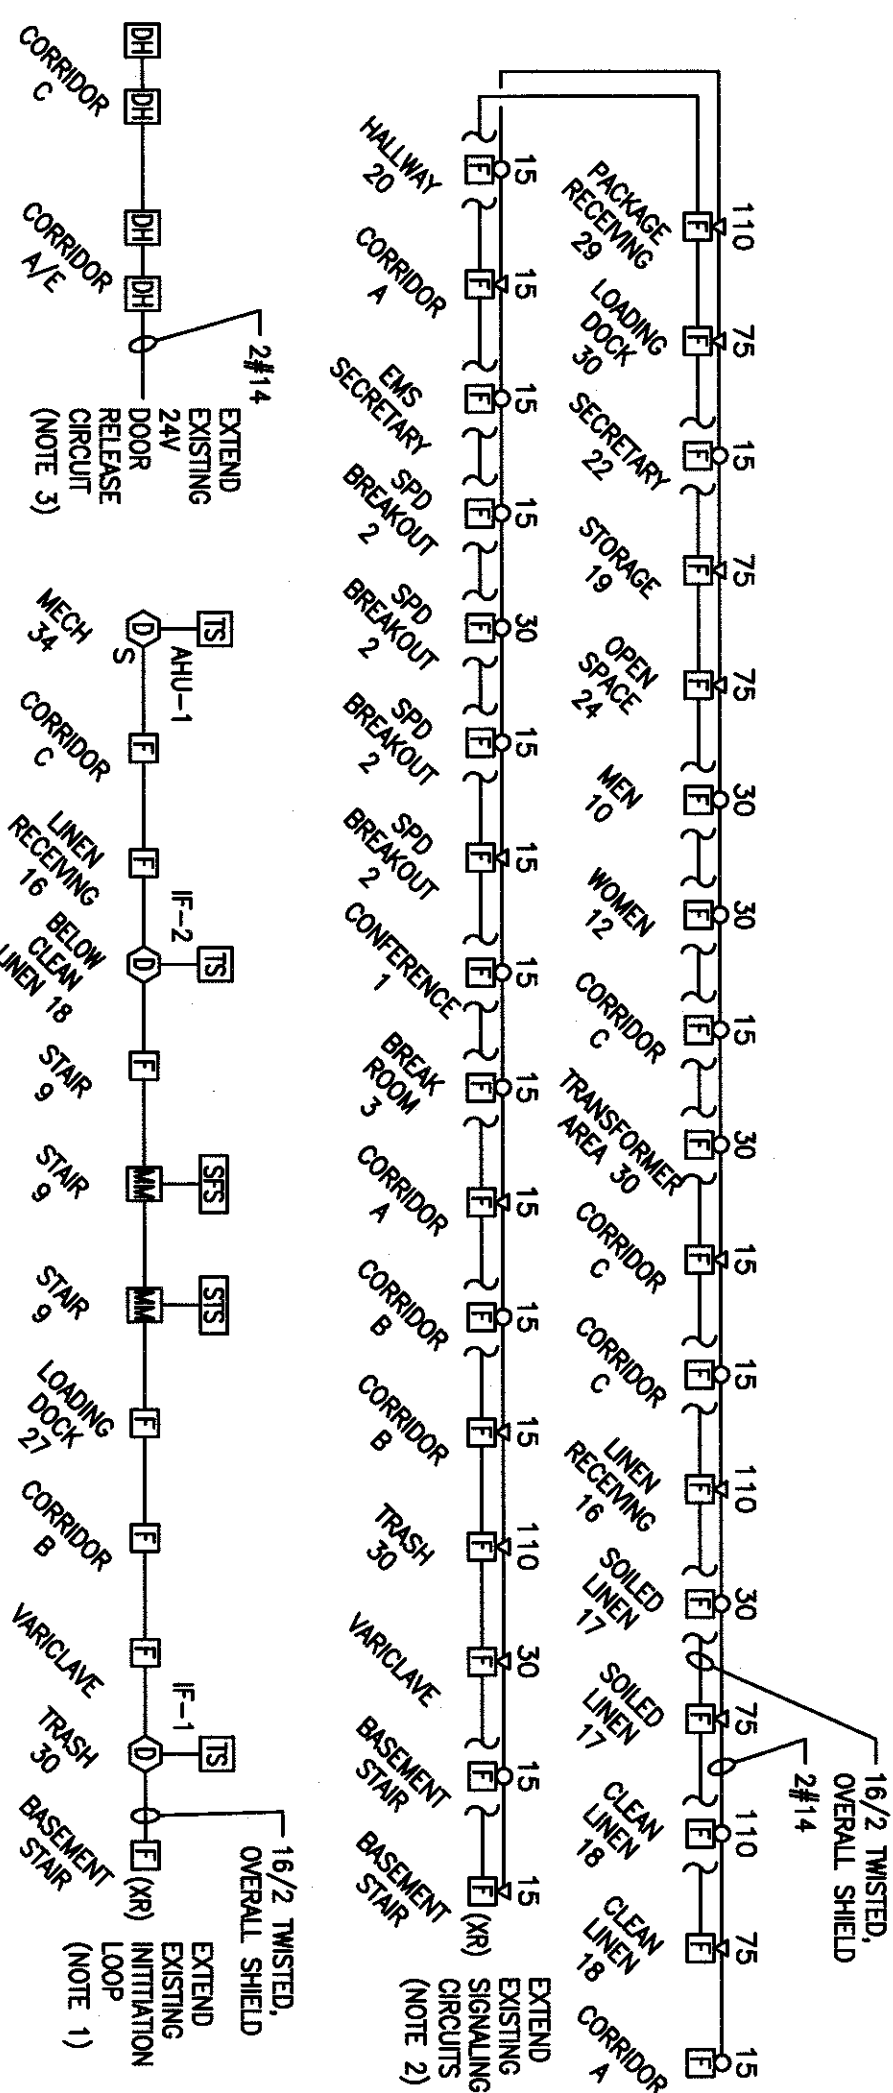


[illegible]

## SCALE: NONE

2	FA1.0	FA1.0
---	-------	-------

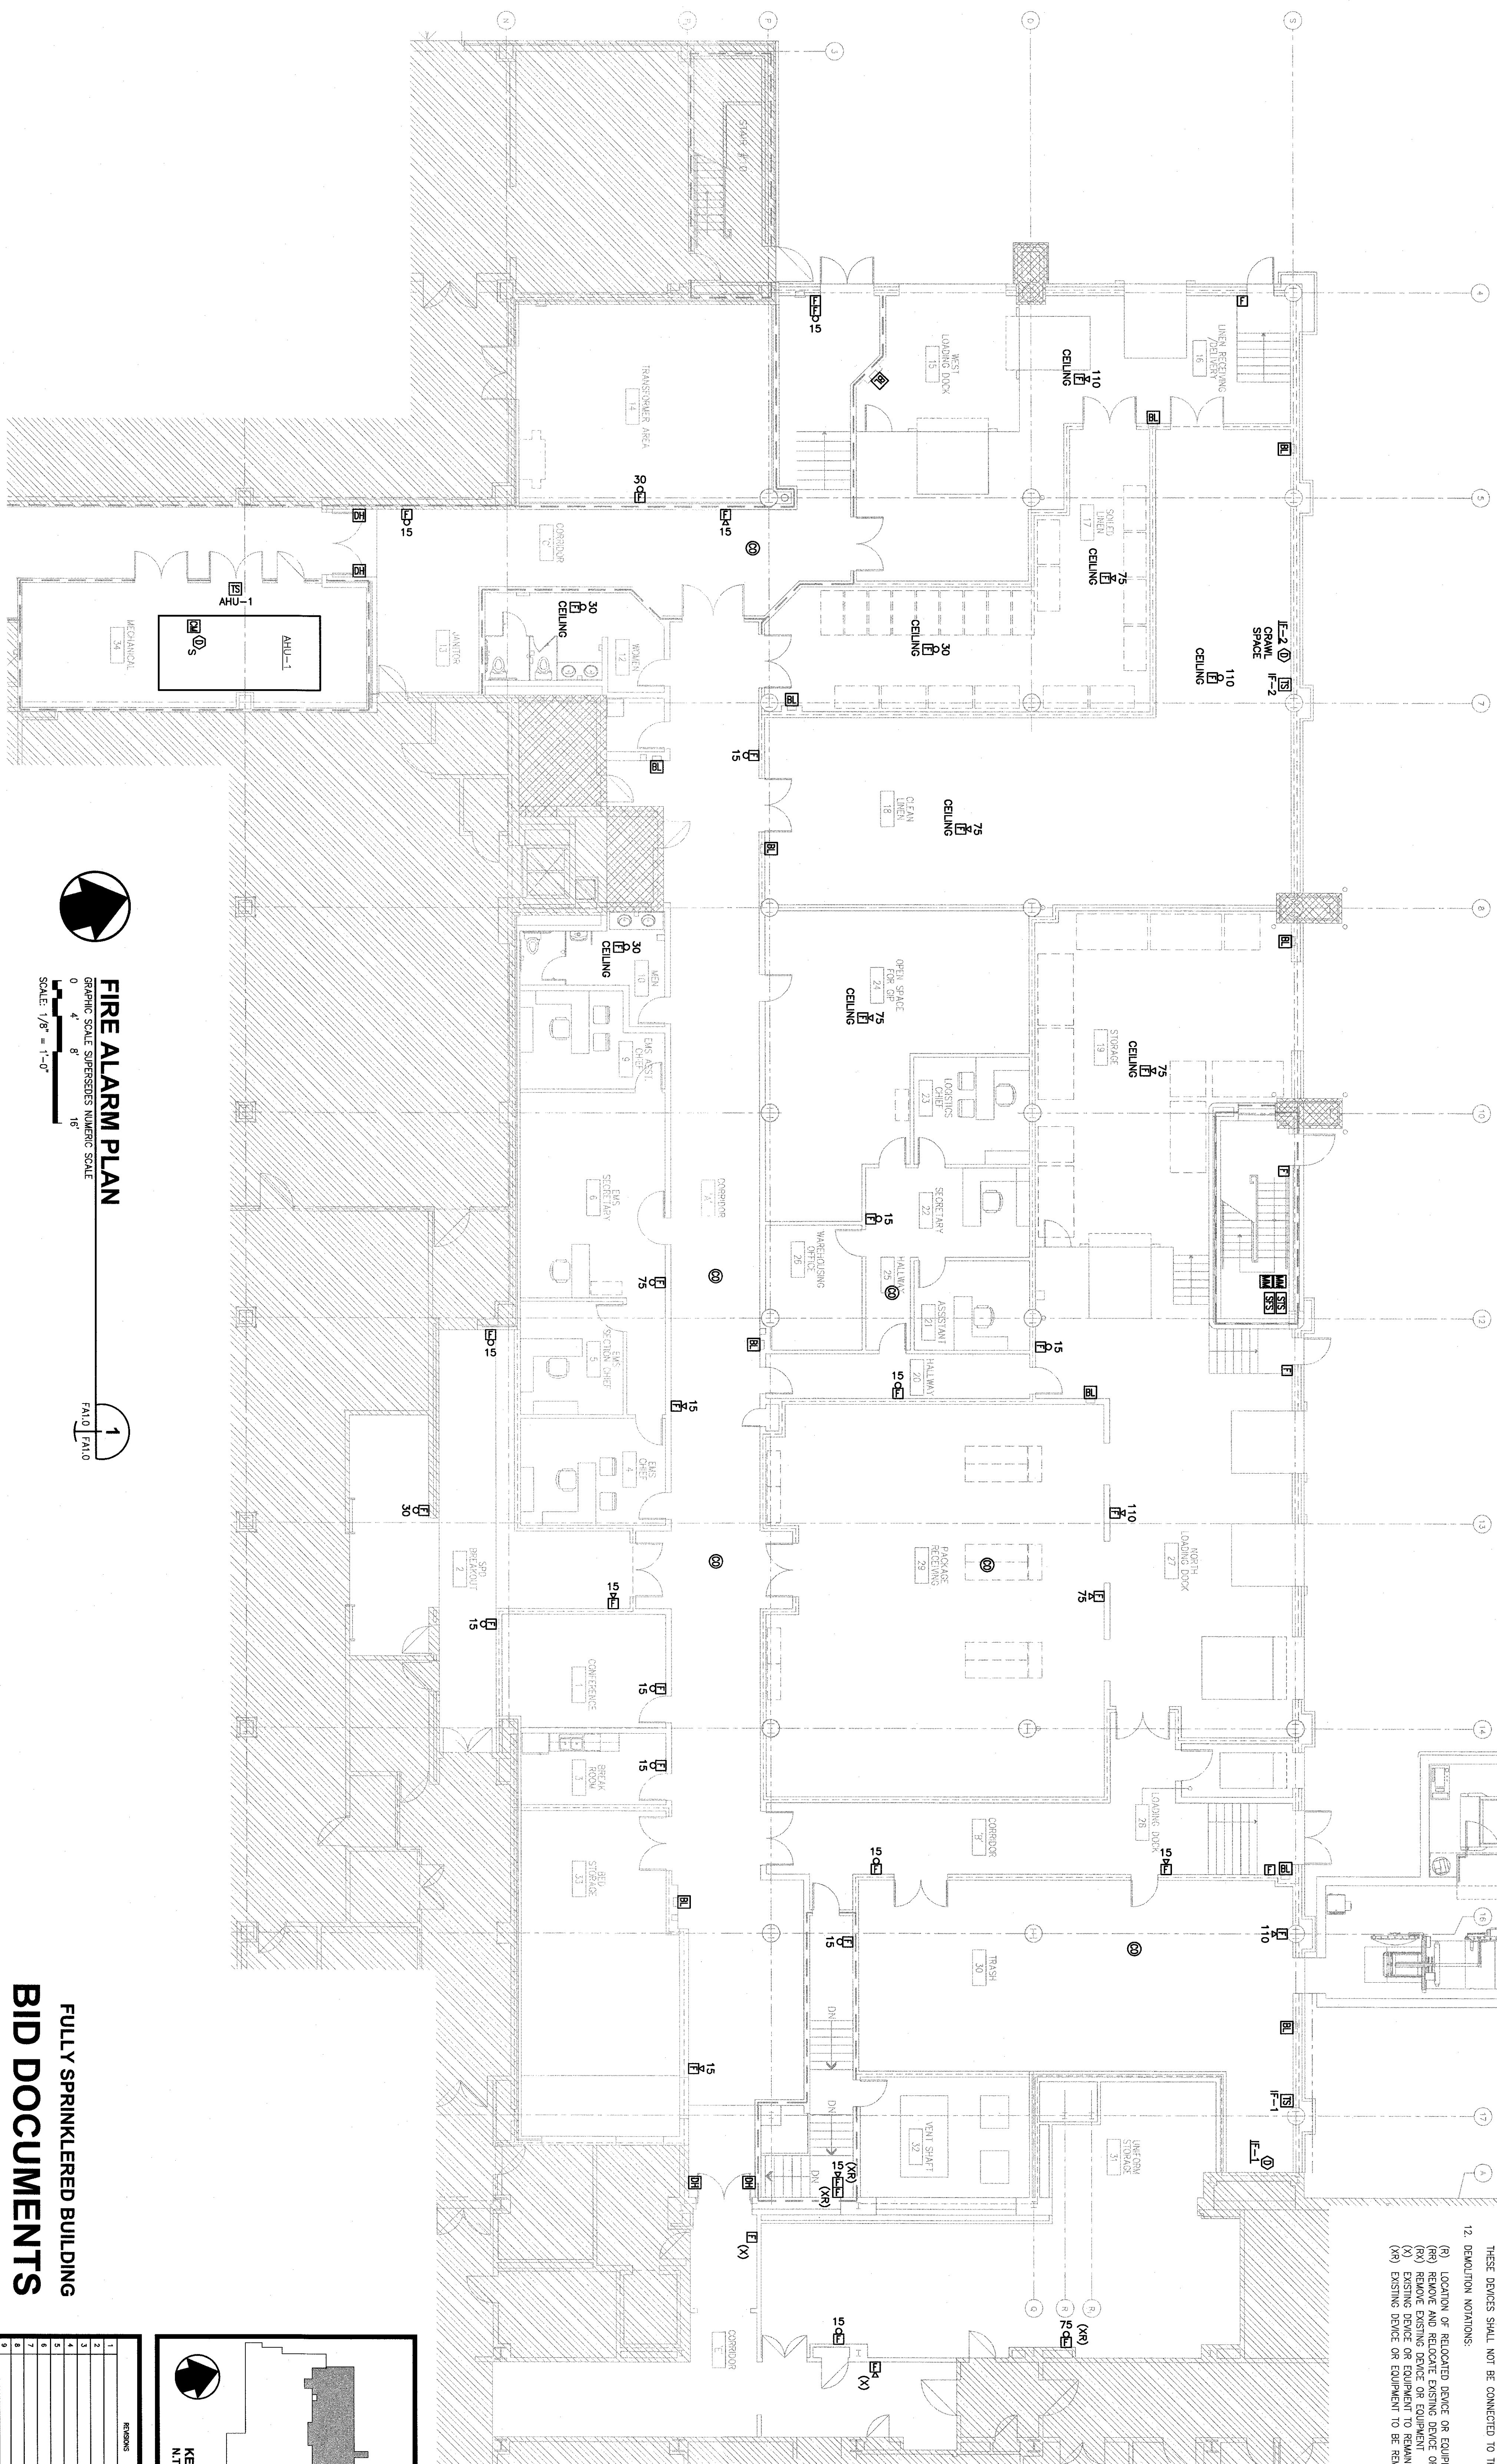

### GRAPHIC SCALE SUPERSEDES NUMERIC SCALE


SCALE: 1/8" = 1'-0"

## SCALE: NON

INPUT DEVICE		OUTPUT:	
DUCT SMOKE DETECTION		SOUND GENERAL BUILDING ALARM	
MANUAL PULL STATION	X	NOTIFY FIRE DEPARTMENT	X
SPRINKLER FLOW/PRESSURE	X	INITIATE SUPERVISORY SIGNAL	X
WATER CONTROL VALVE	X	CLOSE DAMPERS	
		SHUT DOWN AIR HANDLER OR FAN	X
	X	CLOSE SMOKE BARRIER DOORS ON THE FLOOR	X
	X	OPEN LOCKED EGRESS DOORS ON THE FLOOR	X

[illegible]

**FULLY SPRINKLERED BUILDING**

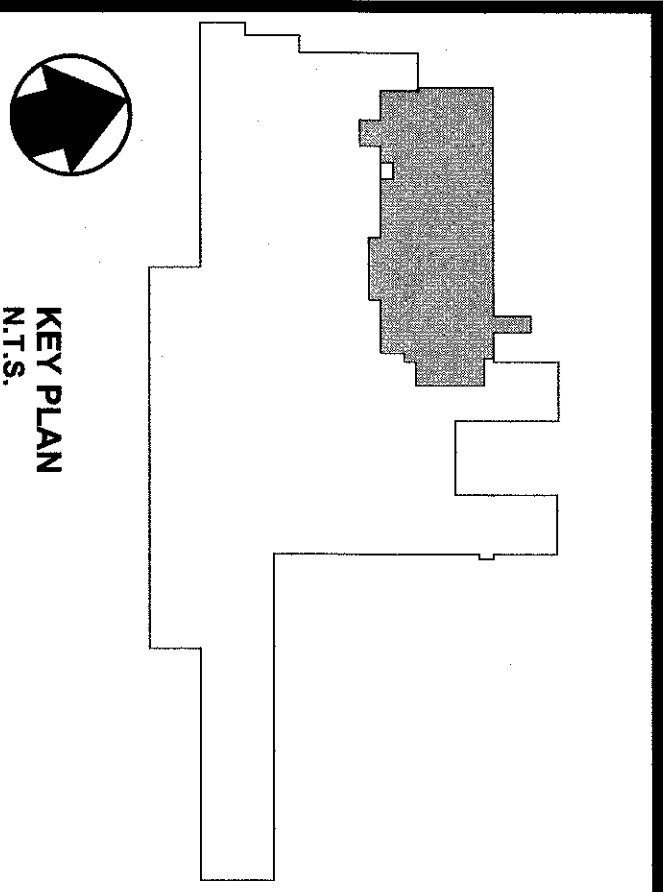

REVISIONS		DATE
1		
2		
3		
4		
5		
6		
7		
8		
9		

Department of  
Veterans Affairs

**UPGRADE SPD AND SECURITY DOCK**  
**PROJECT: 646-367**  
**VA PITTSBURGH**  
**HEALTHCARE SYSTEM**  
**UNIVERSITY DRIVE C**  
**PITTSBURGH, PENNSYLVANIA 15240**

**PARADIGM**  
ENGINEERS AND CONSTRUCTORS  
PO BOX 436223  
Louisville, Kentucky 40253  
502-339-8511 [www.paradigmusa.com](http://www.paradigmusa.com)

