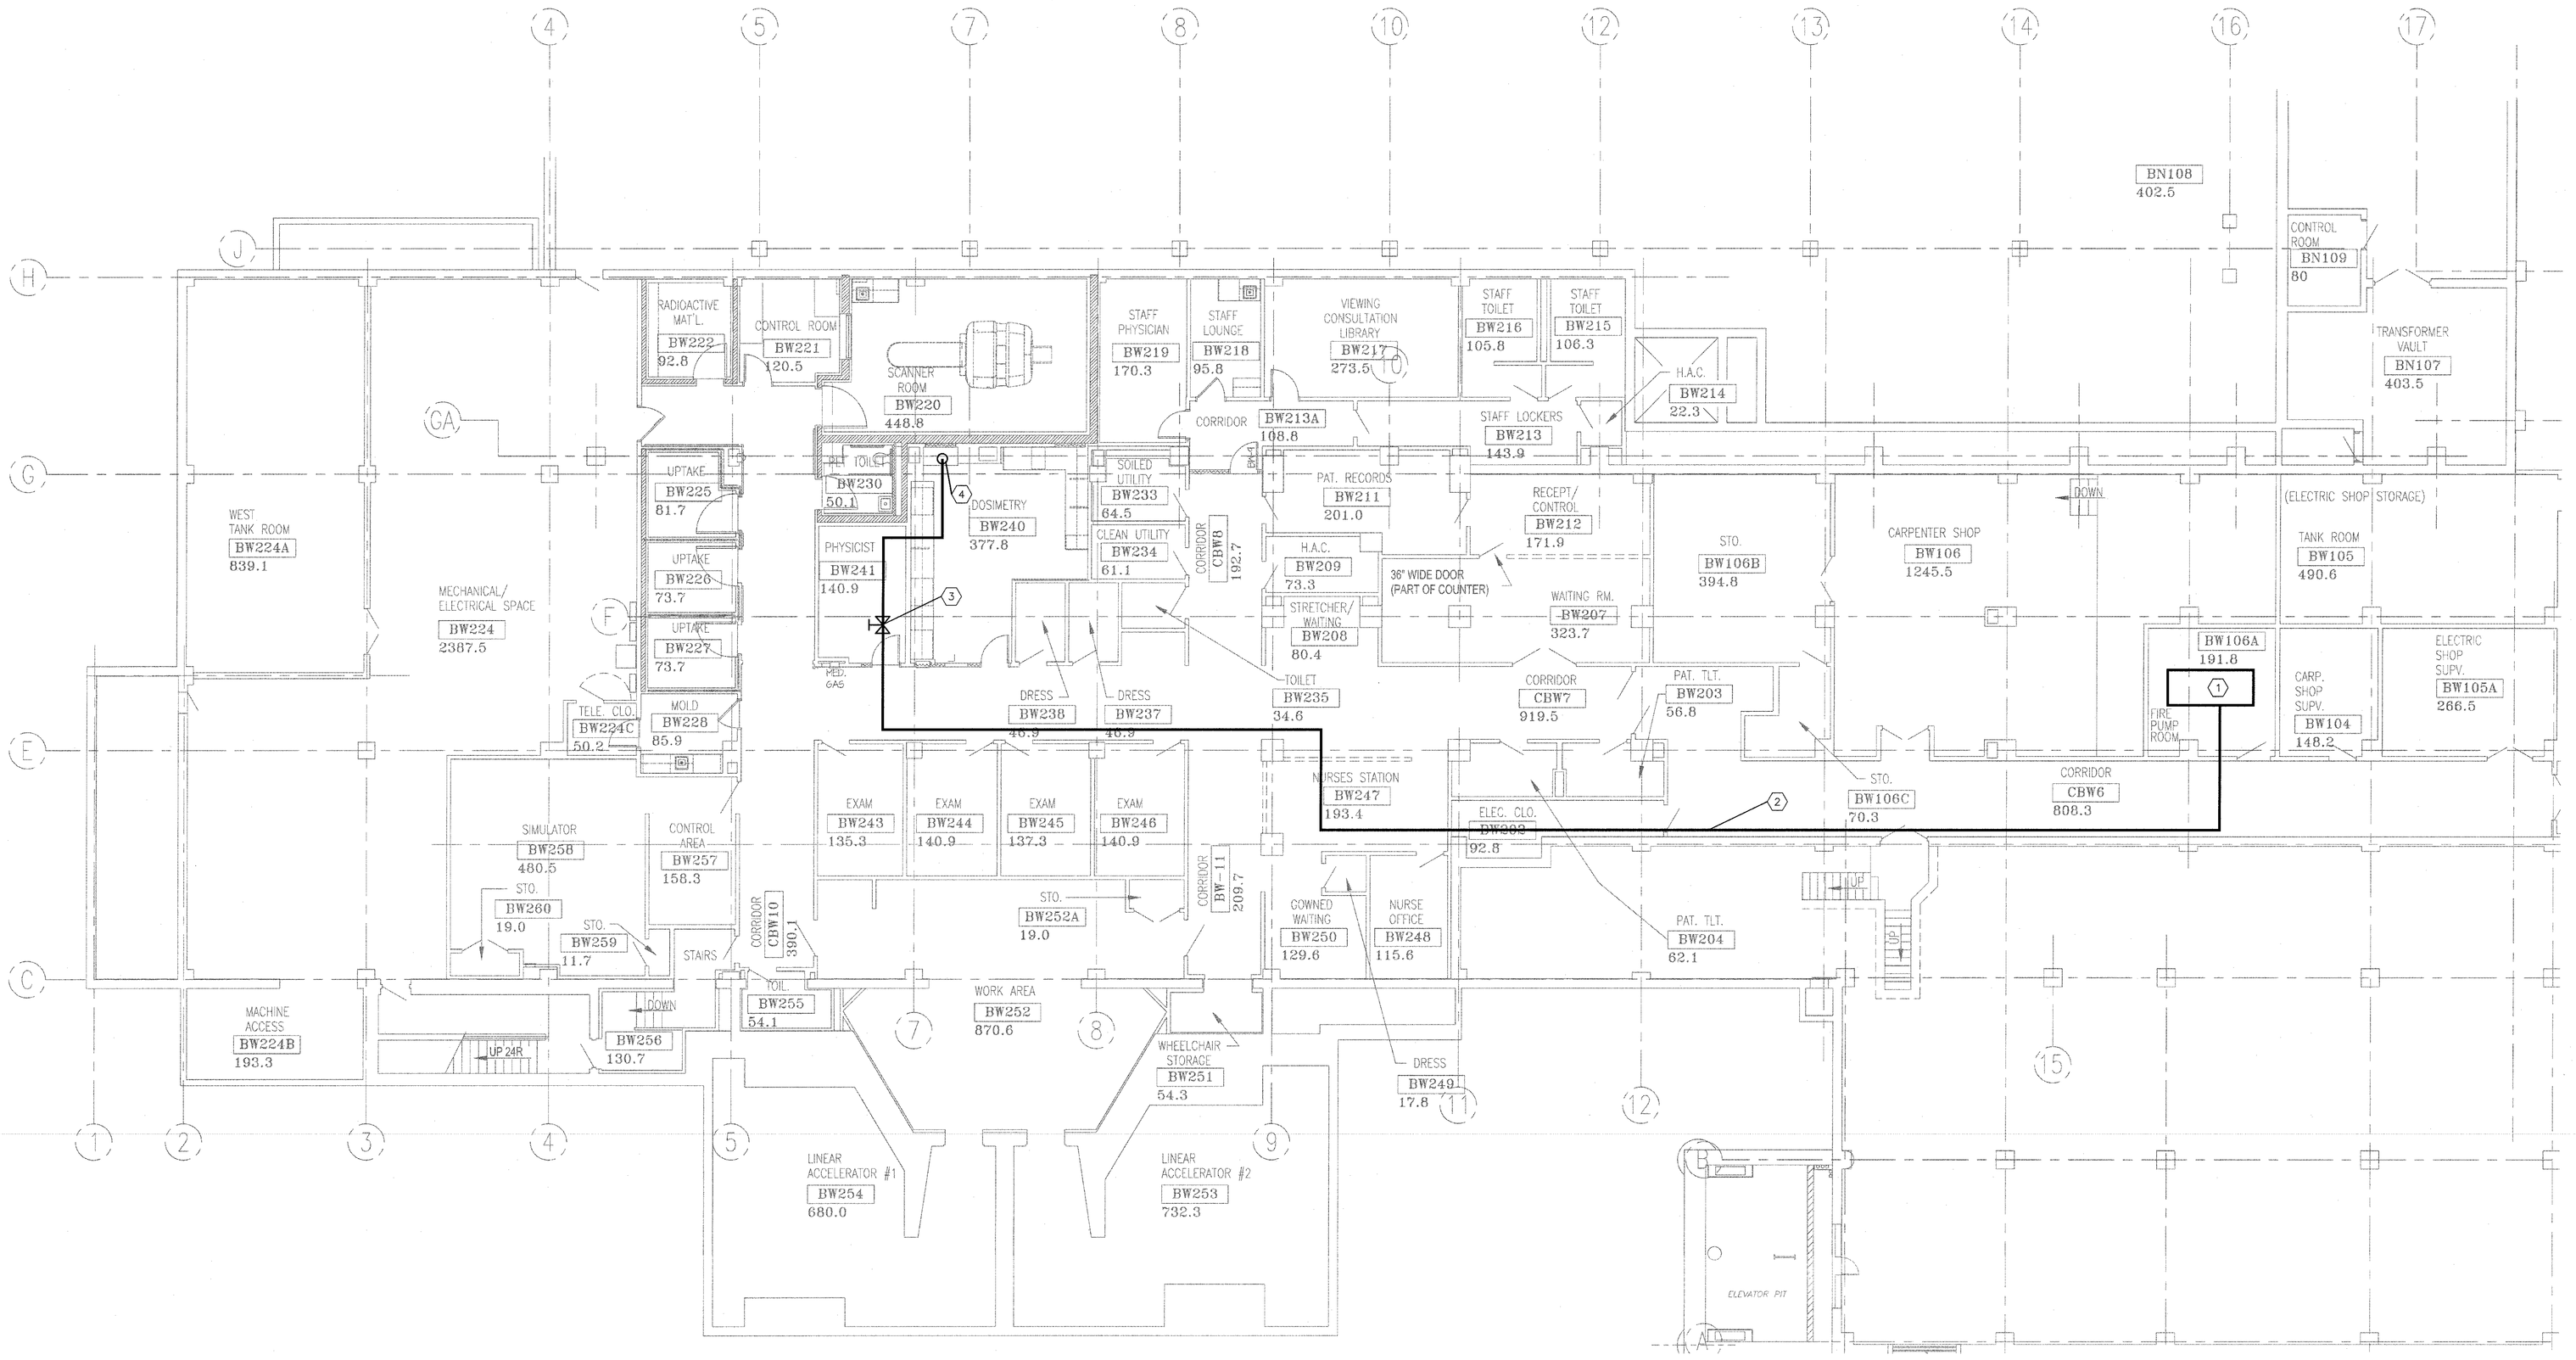

BASEMENT

FIRE PROTECTION PLAN

GRAPHIC SCALE SUPERSEDES NUMERIC SCALE

0 4' 8' 16'

SCALE: 1/8" = 1'-0"

1 | FP1.1 | FP1.1

GENERAL NOTES

1. DESIGN DRAWINGS ARE DIAGRAMMATIC AND APPROXIMATE, ONLY FOR PIPE SIZING, GENERAL ROUTING, LAYOUT AND BASIC SYSTEM CONFIGURATION.
2. PIPING AND COMPONENTS ON THIS SHEET ARE EXISTING AND ARE SHOWN FOR REFERENCE ONLY.

KEYNOTES

1. EXISTING FIRE PUMP. BASE HYDRAULIC DESIGN ON 150PSIG STATIC, 95PSIG RESIDUAL, FLOWING 752GPM.
2. EXISTING 6" FEED MAIN.
3. EXISTING SECTIONAL VALVE WITH TAMPER.
4. EXISTING 6" FEED MAIN UP TO GROUND FLOOR. SEE SHEET FP1.0 FOR CONTINUATION.

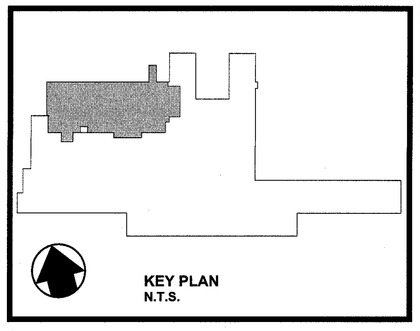

KEY PLAN
N.T.S.

REVISIONS	DATE
1	
2	
3	
4	
5	
6	
7	
8	
9	

FULLY SPRINKLERED BUILDING

BID DOCUMENTS

PARADIGM
ENGINEERS AND CONSTRUCTORS
PO BOX 498223
Louisville, Kentucky 40253
502-339-8511 www.paradigmusa.com

UPGRADE SPD AND SECURITY DOCK
PROJECT: 646-367
VA PITTSBURGH HEALTHCARE SYSTEM
UNIVERSITY DRIVE C
PITTSBURGH, PENNSYLVANIA 15240

Department of Veterans Affairs

MADE BY: EP | CHECKED:
DATE: 7-28-11

BASEMENT FLOOR FIRE PROTECTION PLAN

DRAWING NO. FP1.1 | BID PKG.