
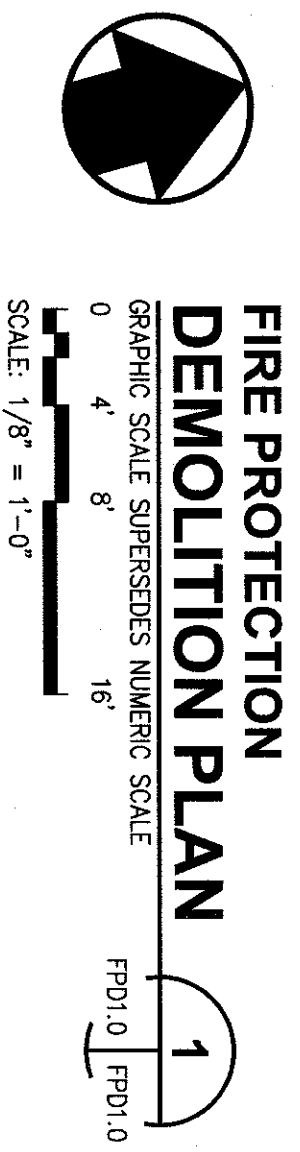


- KEYNOTES**
1. DEMOLISH EXISTING DRY SYSTEM BRASS HANGERS, SPRINKLES, ISOLATION VALVE AND ISOLATION FEED MAIN SERVING DRY SYSTEM BACK TO SOURCE. SALVAGE AIR COMPRESSOR AND TURN OVER TO OWNER.
 2. DEMOLISH EXISTING HYDRANT AND ISOLATION VALVE. RELOCATE TO CORNER OF BUILDING 6. REFERENCE SHEET FPD1.0.
 3. EXISTING FEED MAIN TO REMAIN.

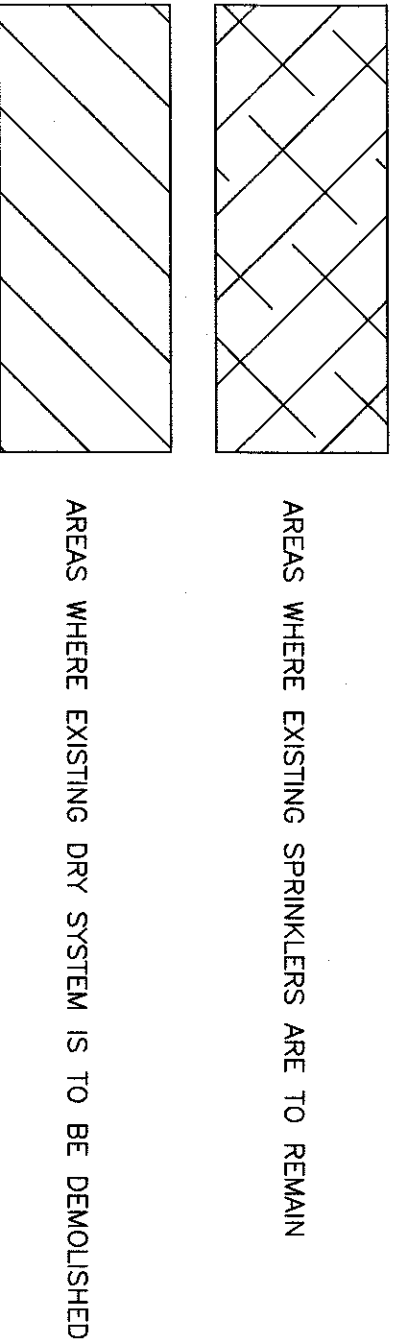

HATCH INDICATES AREA OF EXISTING DRY SYSTEM TO BE DEMOLISHED.

CORNER OF BUILDING 6

EXISTING P.V. SERVING BUILDING 6 TO REMAIN


EXISTING FIRE HYDRANT

ISOLATION VALVE

EXISTING F.P. LINE

FULLY SPRINKLERED BUILDING
BID DOCUMENTS

REVISIONS		DATE
1		
2		
3		
4		
5		
6		
7		
8		
9		

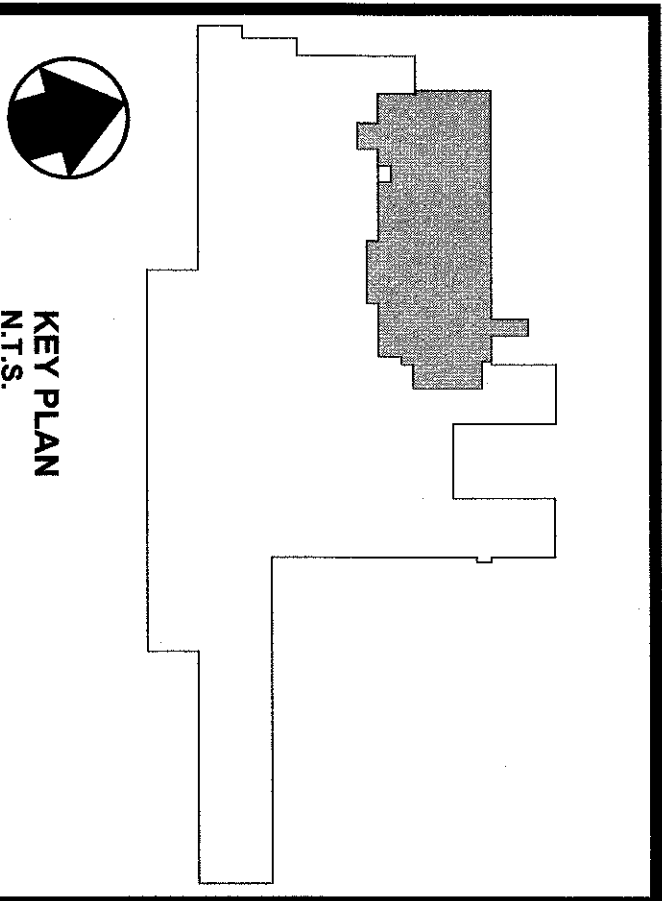

UPGRADE SPD AND SECURITY DOCK
PROJECT: 646-367
VA PITTSBURGH
HEALTHCARE SYSTEM
UNIVERSITY DRIVE C
PITTSBURGH, PENNSYLVANIA 15240

PARADIGM
ENGINEERS AND CONSTRUCTORS
PO BOX 498223
Louisville, Kentucky 40253
502-339-8511 www.paradigmusa.com

