

**EMERGENCY DEPARTMENT
RENOVATION AND EXPANSION
BUILDING NUMBER ONE
VA PROJECT NUMBER: 636A6-09-343**

**VOLUME TWO
Divisions 21-33 and Appendix**

**VETERANS AFFAIRS
CENTRAL IOWA HEALTH CARE SYSTEM
DES MOINES DIVISION
3600 30TH STREET
DES MOINES, IOWA**

TECHNICAL SPECIFICATIONS

BBSAE Project Number: 01004

Bidding Set: June 5, 2012



BROOKS BORG SKILES
ARCHITECTURE ENGINEERING LLP

317 - 6th Avenue, Suite 400
Des Moines, Iowa 50309-4136
phone: (515) 244-7167 • fax:(515) 244-3813

**EMERGENCY DEPARTMENT EXPANSION AND RENOVATION
BUILDING NUMBER ONE
VA PROJECT NUMBER: 636-343
VETERANS AFFAIRS CENTRAL IOWA HEALTH CARE SYSTEM
DES MOINES DIVISION
3600 30TH STREET
DES MOINES, IOWA**

TABLE OF CONTENTS

Section 00 01 10

Section	Title	Page No
---------	-------	---------

-----VOLUME ONE-----

DIVISION 00 - SPECIAL SECTIONS

00 01 10	Table of Contents.....	00 01 10-1 to 5
00 01 15	List of Drawing Sheets.....	00 01 15-1 to 3

DIVISION 1 - GENERAL REQUIREMENTS

01 00 00	General Requirements.....	01 00 00-1 to 28
01 00 11	Medical Center Requirements.....	01 00 11-1 to 7
01 23 00	Alternates	01 23 00-1 to 2
01 33 23	Shop Drawings, Product Data, and Samples.....	01 33 23-1 to 4
01 33 24	Electronic Submittal Procedures	01 33 24-1 to 3
01 45 29	Testing Laboratory Services	01 45 29-1 to 14
01 57 19	Temporary Environmental Controls	01 57 19-1 to 7
01 60 00	Product Requirements	01 60 00-1 to 5
01 73 29	Cutting and Patching	01 73 29-1 to 5
01 74 19	Construction Waste Management	01 74 19-1 to 2

DIVISION 2 – EXISTING CONDITIONS

02 31 00	Geotechnical Investigations	02 31 00-1 only
02 41 13	Selective Building and Site Demolition	02 41 13-1 to 3
02 41 19	Selective Demolition for Remodeling.....	02 41 19-1 to 5
02 82 11	Asbestos Abatement.....	02 82 11-1 only

DIVISION 3 – CONCRETE

03 30 00	Cast-In-Place Concrete	03 30 53-1 to 29
03 41 13	Precast Concrete Hollow Core Planks	03 41 13-1 to 11
03 45 00	Precast Architectural Concrete.....	03 45 00-1 to 22

DIVISION 4 – MASONRY

04 05 11	Masonry Mortaring and Grouting.....	04 05 11-1 to 4
04 20 00	Unit Masonry	04 20 00-1 to 13

DIVISION 5 – METALS

05 12 00	Structural Steel Framing	05 12 00-1 to 5
05 31 00	Steel Decking	05 31 00-1 to 6
05 40 00	Cold-Formed Metal Framing	05 40 00-1 to 6
05 50 00	Metal Fabrications	05 50 00-1 to 8

05 51 00	Metal Stairs	05 51 00-1 to 4
05 53 10	Grating	05 51 00-1 to 3

DIVISION 6 - WOOD AND PLASTIC

06 10 00	Rough Carpentry	06 10 00-1 to 5
06 20 00	Finish Carpentry.....	06 20 00-1 to 8
06 61 13	Solid Surfacing Fabrications	06 61 13-1 to 4
06 64 19	Decorative Translucent Plastic Panels	06 64 19-1 to 4

DIVISION 7 - THERMAL AND MOISTURE PROTECTION

07 14 16	Cold Fluid-Applied Waterproofing.....	07 14 16-1 to 3
07 21 13	Thermal Insulation	07 21 13-1 to 5
07 25 13	Interior Vapor Barrier	07 25 13-1 to 2
07 26 16	Below Grade Vapor Barrier	07 26 16-1 to 2
07 27 13	Air Barriers	07 27 13-1 to 4
07 42 64	Metal Composite Material Panels	07 42 64-1 to 9
07 54 23	Thermoplastic Polyolefin (TPO) Roofing.....	07 54 23-1 to 13
07 60 00	Flashings and Sheet Metal	07 60 00-1 to 9
07 71 00	Roof Specialties	07 71 00-1 to 3
07 71 29	Roof Movement Joint Covers	07 71 29-1 to 4
07 81 00	Applied Fireproofing	07 81 00-1 to 6
07 84 00	Firestopping	07 84 00-1 to 5
07 92 00	Joint Sealants	07 92 00-1 to 10
07 95 13	Expansion Joints	07 95 13-1 to 6

DIVISION 8 - OPENINGS

08 11 13	Hollow Metal Doors and Frames	08 11 13-1 to 6
08 14 00	Wood Doors	08 14 00-1 to 5
08 16 13	Fiberglass Reinforced Plastic Doors	08 16 13-1 to 6
08 31 13	Access Doors	08 31 13-1 to 3
08 36 13	Sectional Overhead Doors (Power Operated)	08 36 13-1 to 8
08 41 13	Aluminum-Framed Entrances And Storefronts	08 41 13-1 to 5
08 42 29	Automatic Bifold Entrance Doors.....	08 42 29-1 to 15
08 71 00	Door Hardware.....	08 71 00-1 to 21
08 71 13	Automatic Door Operator	08 71 13-1 to 5
08 71 16	Low Energy Power Assist Door Operators.....	08 71 16-1 to 6
08 80 00	Glazing	08 80 00-1 to 6
08 90 00	Louvers and Vents	08 90 00-1 to 4

DIVISION 9 – FINISHES

09 06 00	Schedule for Finishes	09 06 00-1 to 7
09 22 16	Non-Structural Metal Framing	09 22 16-1 to 7
09 24 00	Portland Cement Plastering.....	09 24 00-1 to 6
09 29 00	Gypsum Board	09 29 00-1 to 6
09 30 13	Ceramic Tiling	09 30 13-1 to 10
09 51 00	Acoustical Ceiling.....	09 51 00-1 to 7
09 65 13	Resilient Base and Accessories	09 65 13-1 to 3

09 65 16	Resilient Sheet Flooring.....	09 65 16-1 to 7
09 67 25	Resinous Flooring	09 67 25-1 to 11
09 68 00	Carpeting.....	09 68 00-1 to 5
09 68 19	Walk-Off Carpeting	09 68 19-1 to 5
09 91 00	Painting	09 91 00-1 to 16
09 96 59	High-Build Glazed Coatings.....	09 96 59-1 to 3

DIVISION 10 – SPECIALTIES

10 11 00	Visual Display Boards	10 11 00-1 to 3
10 14 00	Signage.....	10 14 00-1 to 5
10 21 23	Cubicle Curtain Tracks	10 21 23-1 to 3
10 25 13	Patient Bed Service Walls (Installation Only)	10 25 13-1 to 2
10 26 00	Wall and Door Protection	10 26 00-1 to 3
10 28 00	Toilet, Bath, And Laundry Accessories	10 28 00-1 to 8
10 44 00	Fire Extinguishers and Cabinets	10 44 00-1 to 2
10 51 13	Lockers (Installation Only)	10 51 13-1 to 2

DIVISION 11 – EQUIPMENT (NOT USED)

DIVISION 12 – FURNISHINGS

12 24 13	Window Shades	12 24 13-1 only
12 32 00	Manufactured Casework (Installation Only)	12 32 00-1 only
12 41 50	Specialty Furnishings.....	12 41 50-1 to 2

DIVISION 13 - SPECIAL CONSTRUCTION (NOT USED)

DIVISION 14 - CONVEYING SYSTEMS

-----VOLUME TWO-----

DIVISION 21 – FIRE SUPPRESSION

21 05 11	Common Work Results for Fire Suppression	21 05 11-1 to 7
21 13 13	Wet-Pipe Sprinkler Systems	21 13 13-1 to 8

DIVISION 22 – PLUMBING

22 05 11	Common Work Results For Plumbing.....	22 05 11-1 to 23
22 05 12	General Motor Requirements For Plumbing Equipment	22 05 12-1 to 6
22 05 23	General-Duty Valves For Plumbing Piping	22 05 23-1 to 7
22 11 00	Facility Water Distribution	22 11 00-1 to 8
22 13 00	Facility Sanitary and Vent Piping	22 13 00-1 to 11
22 14 00	Facility Storm Drainage	22 14 00-1 to 12
22 35 00	Domestic Water Heat Exchangers	22 35 00-1 to 5
22 40 00	Plumbing Fixtures.....	22 40 00-1 to 8
22 62 00	Vacuum Systems For Laboratory And Healthcare Facilities.....	22 62 00-1 to 18
22 63 00	Gas Systems For Laboratory And Healthcare Facilities	22 63 00-1 to 16
22 66 00	Chemical-Waste Systems For Laboratory And Healthcare Facilities.....	22 66 0-1 to 7

DIVISION 23 – HEATING VENTILATING AND AIR CONDITIONING

23 05 11	Common Work Results for HVAC and Steam Generation.....	23 05 11 to 1-24
23 05 12	General Motor Requirements for HVAC and Steam Generation Equipment.....	23 05 12-1 to 6
	Selection Guide for Vibration Isolators	T-1 to T-6
23 05 41	Noise And Vibration Control For HVA Piping And Equipment.....	23 05 41-1 to 8
23 05 93	Testing, Adjusting, And Balancing For HVAC	23 05 93-1 to 9
23 07 11	HVAC, Plumbing, And Boiler Plant Insulation.....	23 07 11-1 to 22
23 09 23	Direct-Digital Control System For HVAC	23 09 23-1 to 43
23 21 13	Hydronic Piping.....	23 21 13-1 to 19
23 21 23	Hydronic Pumps.....	23 21 23-1 to 5
23 22 13	Steam And Condensate Heating Piping	23 22 13-1 to 14
23 22 23	Steam Condensate Pumps	23 22 23-1 to 5
23 23 00	Refrigerant Piping.....	23 23 00-1 to 9
23 25 00	HVAC Water Treatment	23 25 00-1 to 4
23 31 00	HVAC Ducts and Casings.....	23 31 00-1 to 13
23 34 00	HVAC Fans.....	23 34 00-1 to 10
23 36 00	Air Terminal Units	23 36 00-1 to 6
23 37 00	Air Outlets and Inlets	23 37 00-1 to 6
23 40 00	HVAC Air Cleaning Devices.....	23 40 00-1 to 7
23 73 00	Indoor Central-Station Air-Handling Units	23 73 00-1 to 13
23 81 00	Decentralized Unitary HVAC Equipment	23 81 00-1 to 6
23 82 00	Convection Heating And Cooling Units	23 82 00-1 to 3
23 82 16	Air Coils.....	23 82 16-1 to 4

DIVISION 26 – ELECTRICAL

26 05 01	Selective Electrical Demolition	26 05 01-1 to 2
26 05 11	Requirements for Electrical Installations	26 05 11-1 to 7
26 05 21	Low-Voltage Electrical Power Conductors and Cables (600 Volts and Below)	26 05 21-1 to 6
26 05 26	Grounding and Bonding for Electrical Systems	26 05 26-1 to 7
26 05 33	Raceways and Boxes for Electrical Systems	26 05 33-1 to 11
26 05 41	Underground Electrical Construction	26 05 41-1 to 8
26 09 14	Electrical Power Monitoring.....	26 09 14-1 to 2
26 09 23	Lighting Controls	26 09 23-1 to 5
26 22 00	Low-Voltage Transformers.....	26 22 00-1 to 4
26 24 16	Panelboards	26 24 16-1 to 5
26 27 26	Wiring Devices	26 27 26-1 to 6
26 29 11	Low-Voltage Motor Starter.....	26 29 11-1 to 9
26 29 21	Disconnect Switches	26 29 21-1 to 3
26 51 00	Interior Lighting.....	26 51 00-1 to 14
26 56 00	Exterior Lighting.....	26 56 00-1 to 5

DIVISION 27 – COMMUNICATIONS

27 05 11	Requirements for Communications Installations	27 05 11-1 to 5
27 05 26	Grounding And Bonding For Communications Systems.....	27 05 26-1 to 6
27 05 33	Raceways And Boxes For Communications Systems.....	27 05 33-1 to 11

27 10 00	Structured Cabling	27 10 00-1 to 4
27 15 00	Communications Horizontal Cabling.....	27 15 00-1 to 18
27 41 31	Master Antenna Television Equipment And Systems	27 41 31-1 to 26
27 52 23	Nurse Call And Code Blue Systems	27 52 23-1 to 46

DIVISION 28 – ELECTRONIC SAFETY AND SECURITY

28 05 11	Requirements For Electronic Safety And Security Installations.....	28 05 11-1 to 6
28 05 13	Conductors And Cables For Electronic Safety And Security	28 05 13-1 to 4
28 13 11	Physical Access Control System (PACS)	28 13 11-1 to 15
28 31 00	Fire Detection and Alarm.....	28 31 00-1 to 9

DIVISION 31 – EARTHWORK

31 20 00	Earth Moving	31 20 00-1 to 13
31 23 19	Dewatering	31 23 19-1 to 4
31 23 23.33	Flowable Fill	31 23 23.33-1 to 6
31 63 16	Auger Cast Grout Piles	31 63 16-1 to 14

DIVISION 32 – EXTERIOR IMPROVEMENTS

32 05 23	Cement And Concrete For Exterior Improvements	32 05 23-1 to 12
32 12 16	Asphalt Paving.....	32 12 16-1 to 5
32 17 17	Manufactured Bollards.....	32 17 17-1 to 2
32 17 19	Pipe Bollards.....	32 17 19-1 to 3
32 17 23	Pavement Markings	32 17 23-1 to 4
32 31 19	Decorative Metal Fences.....	32 31 19-1 to 5
32 90 00	Planting	32 90 00-1 to 7

DIVISION 33 – UTILITIES

33 30 00	Sanitary Sewerage Utilities	333000-1 to 8
33 40 00	Storm Drainage Utilities	33 40 00-1 to 11
33 46 13	Foundation Drainage.....	33 46 13-1 to 6

APPENDIX

Appendix 1: Geotechnical Report	50
Appendix 2: Asbestos Abatement Technical Specifications	70
Appendix 3: Master Interior Signage Design and Detail Document	1 to 42

--- E N D ---

SECTION 21 05 11
COMMON WORK RESULTS FOR FIRE SUPPRESSION

PART 1 - GENERAL

1.1 DESCRIPTION

- A. The requirements of this Section apply to all sections of Division 21.
- B. Definitions:
 - 1. Exposed: Piping and equipment exposed to view in finished rooms.
 - 2. Option or optional: Contractor's choice of an alternate material or method.

1.2 RELATED WORK

- A. Section 01 00 00, GENERAL REQUIREMENTS.
- B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- C. Section 07 84 00, FIRESTOPPING.
- D. Section 07 92 00, JOINT SEALANTS.
- E. Section 09 91 00, PAINTING.
- F. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS

1.3 QUALITY ASSURANCE

- A. Products Criteria:
 - 1. Standard Products: Material and equipment shall be the standard products of a manufacturer regularly engaged in the manufacture of the products for at least 3 years. See other specification sections for any exceptions.
 - 2. Equipment Service: Products shall be supported by a service organization which maintains a complete inventory of repair parts and is located reasonably close to the site.
 - 3. Multiple Units: When two or more units of materials or equipment of the same type or class are required, these units shall be products of one manufacturer.
 - 4. Assembled Units: Manufacturers of equipment assemblies, which use components made by others, assume complete responsibility for the final assembled product.
 - 5. Nameplates: Nameplate bearing manufacturer's name or identifiable trademark shall be securely affixed in a conspicuous place on equipment, or name or trademark cast integrally with equipment, stamped or otherwise permanently marked on each item of equipment.
 - 6. Asbestos products or equipment or materials containing asbestos shall not be used.

- B. Manufacturer's Recommendations: Where installation procedures or any part thereof are required to be in accordance with the recommendations of the manufacturer of the material being installed, printed copies of these recommendations shall be furnished to the Resident Engineer prior to installation. Installation of the item will not be allowed to proceed until the recommendations are received. Failure to furnish these recommendations can be cause for rejection of the material.
- C. Guaranty: In GENERAL CONDITIONS.
- D. Supports for sprinkler piping shall be in conformance with NFPA 13.

1.4 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturer's Literature and Data: Submit under the pertinent section rather than under this section.
 - 1. Equipment and materials identification.
 - 2. Fire-stopping materials.
 - 3. Hangers, inserts, supports and bracing. Provide load calculations for variable spring and constant support hangers.
 - 4. Wall, floor, and ceiling plates.
- C. Coordination Drawings: Provide details of the following.
 - 1. Mechanical equipment rooms.
 - 2. Interstitial space.
 - 3. Hangers, inserts, supports, and bracing.
 - 4. Pipe sleeves.
 - 5. Equipment penetrations of floors, walls, ceilings, or roofs.
- D. Maintenance Data and Operating Instructions:
 - 1. Maintenance and operating manuals in accordance with Section 01 00 00, GENERAL REQUIREMENTS, Article, INSTRUCTIONS, for systems and equipment.
 - 2. Provide a listing of recommended replacement parts for keeping in stock supply, including sources of supply, for equipment. Include in the listing belts for equipment.

1.5 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American Society for Testing and Materials (ASTM):

A36/A36M-2001.....Carbon Structural Steel

A575-96Steel Bars, Carbon, Merchant Quality, M-Grades R (2002)

E84-2003.....Standard Test Method for Burning Characteristics of Building
Materials

E119-2000.....Standard Test Method for Fire Tests of Building Construction
and Materials

C. National Fire Protection Association (NFPA):

90A-2009Installation of Air Conditioning and Ventilating Systems

101-2009Life Safety Code

PART 2 - PRODUCTS

2.1 EQUIPMENT AND MATERIALS IDENTIFICATION

- A. Use symbols, nomenclature and equipment numbers specified, shown on the drawings and shown in the maintenance manuals. Identification for piping is specified in Section 09 91 00, PAINTING.
- B. Interior (Indoor) Equipment: Engraved nameplates, with letters not less than 48 mm (3/16-inch) high of brass with black-filled letters, or rigid black plastic with white letters specified in Section 09 91 00, PAINTING permanently fastened to the equipment. Identify unit components such as coils, filters, fans, etc.
- C. Valve Tags and Lists:
 - 1. Valve tags: Engraved black filled numbers and letters not less than 13 mm (1/2-inch) high for number designation, and not less than 6.4 mm(1/4-inch) for service designation on 19 gage 38 mm (1-1/2 inches) round brass disc, attached with brass "S" hook or brass chain.
 - 2. Valve lists: Typed or printed plastic coated card(s), sized 216 mm (8-1/2 inches) by 280 mm (11 inches) showing tag number, valve function and area of control, for each service or system. Punch sheets for a 3-ring notebook.
 - 3. Provide detailed plan for each floor of the building indicating the location and valve number for each valve. Identify location of each valve with a color coded thumb tack in ceiling.

2.2 FIRESTOPPING

- A. Section 07 84 00, FIRESTOPPING specifies an effective barrier against the spread of fire, smoke and gases where penetrations occur for piping.

2.3 PIPE PENETRATIONS

- A. Install sleeves during construction for other than blocked out floor openings for risers in mechanical bays.
- B. To prevent accidental liquid spills from passing to a lower level, provide the following:
 - 1. For sleeves: Extend sleeve 25 mm (one inch) above finished floor and provide sealant for watertight joint.
 - 2. For blocked out floor openings: Provide 40 mm (1-1/2 inch) angle set in silicone adhesive around opening.
 - 3. For drilled penetrations: Provide 40 mm (1-1/2 inch) angle ring or square set in silicone adhesive around penetration.
- C. Penetrations are not allowed through beams or ribs, but may be installed in concrete beam flanges. Any deviation from this requirement must receive prior approval of Resident Engineer.
- D. Sheet Metal, Plastic, or Moisture-resistant Fiber Sleeves: Provide for pipe passing through floors, interior walls, and partitions, unless brass or steel pipe sleeves are specifically called for below.
- E. Cast Iron or Zinc Coated Pipe Sleeves: Provide for pipe passing through exterior walls below grade. Make space between sleeve and pipe watertight with a modular or link rubber seal. Seal shall be applied at both ends of sleeve.
- F. Galvanized Steel or an alternate Black Iron Pipe with asphalt coating Sleeves: Provide for pipe passing through concrete beam flanges, except where brass pipe sleeves are called for. Provide sleeve for pipe passing through floor of mechanical rooms, laundry work rooms, and animal rooms above basement. Except in mechanical rooms, connect sleeve with floor plate.
- G. Brass Pipe Sleeves: Provide for pipe passing through quarry tile, terrazzo or ceramic tile floors. Connect sleeve with floor plate.
- H. Sleeves are not required for wall hydrants for fire department connections or in drywall construction.
- I. Sleeve Clearance: Sleeve through floors, walls, partitions, and beam flanges shall be one inch greater in diameter than external diameter of pipe. Sleeve for pipe with insulation shall be large enough to accommodate the insulation. Interior openings shall be caulked tight with fire stopping material and sealant to prevent the spread of fire, smoke, and gases.
- J. Sealant and Adhesives: Shall be as specified in Section 07 92 00, JOINT SEALANTS.

2.4 TOOLS AND LUBRICANTS

- A. Furnish, and turn over to the Resident Engineer, special tools not readily available commercially, that are required for disassembly or adjustment of equipment and machinery furnished.
- B. Grease Guns with Attachments for Applicable Fittings: One for each type of grease required for each motor or other equipment.
- C. Tool Containers: Hardwood or metal, permanently identified for intended service and mounted, or located, where directed by the Resident Engineer.
- D. Lubricants: A minimum of 0.95 L (one quart) of oil, and 0.45 kg (one pound) of grease, of equipment manufacturer's recommended grade and type, in unopened containers and properly identified as to use for each different application.

2.5 WALL, FLOOR AND CEILING PLATES

- A. Material and Type: Chrome plated brass or chrome plated steel, one piece or split type with concealed hinge, with set screw for fastening to pipe, or sleeve. Use plates that fit tight around pipes, cover openings around pipes and cover the entire pipe sleeve projection.
- B. Thickness: Not less than 2.4 mm (3/32-inch) for floor plates. For wall and ceiling plates, not less than 0.64 mm (0.025-inch) for up to 80 mm (3-inch pipe), 0.89 mm (0.035-inch) for larger pipe.
- C. Locations: Use where pipe penetrates floors, walls and ceilings in exposed locations, in finished areas only. Use also where insulation ends on exposed water supply pipe drop from overhead. Provide a watertight joint in spaces where brass or steel pipe sleeves are specified.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Coordinate location of piping, sleeves, inserts, hangers, and equipment. Locate piping, sleeves, inserts, hangers, and equipment clear of windows, doors, openings, light outlets, and other services and utilities. Follow manufacturer's published recommendations for installation methods not otherwise specified.
- B. Protection and Cleaning:
 - 1. Equipment and materials shall be carefully handled, properly stored, and adequately protected to prevent damage before and during installation, in accordance with the manufacturer's recommendations and as approved by the Resident Engineer.

Damaged or defective items in the opinion of the Resident Engineer, shall be replaced.

2. Protect all finished parts of equipment, such as shafts and bearings where accessible, from rust prior to operation by means of protective grease coating and wrapping. Close pipe openings with caps or plugs during installation. Tightly cover and protect equipment against dirt, water chemical, or mechanical injury. At completion of all work thoroughly exposed materials and equipment.
- C. Install gages, valves, and other devices with due regard for ease in reading or operating and maintaining said devices. Locate and position gages to be easily read by operator or staff standing on floor or walkway provided. Servicing shall not require dismantling adjacent equipment or pipe work.
- D. Work in Existing Building:
1. Coordinate demolition work in existing areas or connections to existing systems with Contracting Officers Technical Representative (COTR) or his designated representative, for possible fire watch.
 2. Perform as specified in Article, OPERATIONS AND STORAGE AREAS, Article, ALTERATIONS, and Article, RESTORATION of the Section 01 00 00, GENERAL REQUIREMENTS for relocation of existing equipment, alterations and restoration of existing building(s).
 3. As specified in Section 01 00 00, GENERAL REQUIREMENTS, Article, OPERATIONS AND STORAGE AREAS, make alterations to existing service piping at times that will least interfere with normal operation of the facility.
 4. Cut required openings through existing masonry and reinforced concrete using diamond core drills. Use of pneumatic hammer type drills, impact type electric drills, and hand or manual hammer type drills, will be permitted only with approval of the Resident Engineer. Locate openings that will least effect structural slabs, columns, ribs or beams. Refer to the Resident Engineer for determination of proper design for openings through structural sections and opening layouts approval, prior to cutting or drilling into structure. After Resident Engineer's approval, carefully cut opening through construction no larger than absolutely necessary for the required installation.
- E. Sitchgear Drip Protection: Every effort shall be made to eliminate the installation of pipe above electrical and telephone switchgear. If this is not possible, encase pipe in a second pipe with a minimum of joints.

F. Inaccessible Equipment:

1. Where the Government determines that the Contractor has installed equipment not conveniently accessible for operation and maintenance, equipment shall be removed and reinstalled or remedial action performed as directed at no additional cost to the Government.
2. The term "conveniently accessible" is defined as capable of being reached without the use of ladders, or without climbing or crawling under or over obstacles such as motors, fans, pumps, belt guards, transformers, high voltage lines, piping, and ductwork.

3.2 MOTOR AND DRIVE ALIGNMENT

- A. Belt Drive: Set driving and driven shafts parallel and align so that the corresponding grooves are in the same plane.
- B. Direct-connect Drive: Securely mount motor in accurate alignment so that shafts are free from both angular and parallel misalignment when both motor and driven machine are operating at normal temperatures.

3.3 OPERATING AND PERFORMANCE TESTS

- A. Prior to the final inspection, perform required tests as specified in Section 01 00 00, GENERAL REQUIREMENTS, Article, TESTS and submit the test reports and records to the Resident Engineer.
- B. Should evidence of malfunction in any tested system, or piece of equipment or component part thereof, occur during or as a result of tests, make proper corrections, repairs or replacements, and repeat tests at no additional cost to the Government.
- C. When completion of certain work or system occurs at a time when final control settings and adjustments cannot be properly made to make performance tests, then make performance tests for heating systems and for cooling systems respectively during first actual seasonal use of respective systems following completion of work.

3.4 INSTRUCTIONS TO VA PERSONNEL

- A. Provide in accordance with Article, INSTRUCTIONS, of Section 01 00 00, GENERAL REQUIREMENTS.

--- E N D ---

SECTION 21 13 13
WET-PIPE SPRINKLER SYSTEMS

PART 1 - GENERAL

1.1 DESCRIPTION

- A. The design and installation of a hydraulically calculated automatic wet system complete and ready for operation, for all portions of Building 1 including the Emergency Department addition and Emergency Garage.
- B. Modification of the existing sprinkler system as indicated on the drawings and as further required by these specifications.
- C. Design, installation and testing shall be in accordance with NFPA 13 except for specified exceptions.

1.2 RELATED WORK

- A. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Section 07 84 00, FIRESTOPPING, Treatment of penetrations through rated enclosures.
- C. Section 09 91 00, PAINTING.
- D. Section 28 31 00, FIRE DETECTION AND ALARM, Connection to fire alarm of flow switches, pressure switches and valve supervisory switches.
- E. Section 21 05 11 COMMON WORK RESULTS FOR FIRE SUPPRESSION

1.3 QUALITY ASSURANCE

- A. Installer Reliability: The installer shall possess a valid State of Iowa fire sprinkler contractor's license. The installer shall have been actively and successfully engaged in the installation of commercial automatic sprinkler systems for the past ten years.
- B. Materials and Equipment: All equipment and devices shall be of a make and type listed by UL and approved by FM, or other nationally recognized testing laboratory for the specific purpose for which it is used. All materials, devices, and equipment shall be approved by the VA.
- C. Submittals: Submit as one package in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES. Prepare detailed working drawings that are signed by a NICET Level III or Level IV Sprinkler Technician or stamped by a Registered Professional Engineer practicing in the field of Fire Protection Engineering. As Government review is for technical adequacy only, the installer remains responsible for correcting any conflicts with other trades and building construction that arise during installation. // Partial submittals will not be accepted. // Material submittals shall be

approved prior to the purchase or delivery to the job site. Suitably bind submittals in notebooks or binders and provide index referencing the appropriate specification section. Submittals shall include, but not be limited to, the following:

1. Qualifications:
 - a. Provide a copy of the installing contractors fire sprinkler and state contractors license.
 - b. Provide a copy of the NICET certification for the NICET Level III or Level IV Sprinkler Technician who prepared and signed the detailed working drawings unless the drawings are stamped by a Registered Professional Engineer practicing in the field of Fire Protection Engineering.
2. Drawings: Submit detailed 1:100 (1/8 inch) scale (minimum) working drawings conforming to NFPA 13. Include a site plan showing the piping to the water supply test location.
3. Manufacturers Data Sheets:
 - a. For backflow preventers, provide flow test curves from UL, FM, or the Foundation for Hydraulic Research and Cross-Connection Control to verify pressure loss calculations.
 - b. Provide for materials and equipment proposed for use on the system. Include listing information and installation instructions in data sheets. Where data sheet describes items in addition to that item being submitted, clearly identify proposed item on the sheet.
4. Calculation Sheets: Submit hydraulic calculation sheets in tabular form conforming to the requirements and recommendations of NFPA 13.
5. Final Document Submittals: Provide as-built drawings, testing and maintenance instructions in accordance with the requirements in Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES. Submittals shall include, but not be limited to, the following:
 - a. One complete set of reproducible as-built drawings showing the installed system with the specific interconnections between the waterflow switch or pressure switch and the fire alarm equipment.
 - b. Complete, simple, understandable, step-by-step, testing instructions giving recommended and required testing frequency of all equipment, methods for testing all equipment, and a complete trouble shooting manual. Provide

- maintenance instructions on replacing any components of the system including internal parts, periodic cleaning and adjustment of the equipment and components with information as to the address and telephone number of both the manufacturer and the local supplier of each item.
- c. **Material and Testing Certificate:** Upon completion of the sprinkler system installation or any partial section of the system, including testing and flushing, provide a copy of a completed Material and Testing Certificate as indicated in NFPA 13.
 - d. **Certificates** shall document all parts of the installation.
 - e. **Instruction Manual:** Provide one copy of the instruction manual covering the system in a flexible protective cover and mount in an accessible location adjacent to the riser.
- D. **Design Basis Information:** Provide design, materials, equipment, installation, inspection, and testing of the automatic sprinkler system in accordance with the requirements of NFPA 13. Recommendations in appendices shall be treated as requirements.
- 1. Perform hydraulic calculations in accordance with NFPA 13 utilizing the Area/Density method. Do not restrict design area reductions permitted for using quick response sprinklers throughout by the required use of standard response sprinklers in the areas identified in this section.
 - 2. **Sprinkler Protection:** To determining spacing and sizing, apply the following coverage classifications:
 - a. **Light Hazard Occupancies:** Patient care, treatment, and customary access areas.
 - b. **Ordinary Hazard Group 1 Occupancies:** Laboratories, Mechanical Equipment Rooms, Transformer Rooms, Electrical Switchgear Rooms, Electric Closets.
 - c. **Ordinary Hazard Group 2 Occupancies:** Storage rooms, trash rooms, clean and soiled linen rooms, pharmacy and associated storage, laundry, kitchens, kitchen storage areas, retail stores, retail store storage rooms, storage areas, building management storage, boiler plants, energy centers, warehouse spaces, file storage areas for the entire area of the space up to 140 square meters (1500 square feet) and Supply Processing and Distribution (SPD).
 - d. Request clarification from the Government for any hazard classification not identified.

3. Hydraulic Calculations: Calculated demand including hose stream requirements shall fall no less than 10 percent below the available water supply curve.
4. Water Supply: Base water supply on a flow test of:
 - a. Location Hydrant at 30th and Euclid
 - b. Static pressure: 441.28 kPa (64 psi)
 - c. Residual pressure: 413.7 kPa (60 psi)
 - d. Flow: 80.1 L/s /292.03 L/s (1268 gpm calc. flow / 4628 gpm flow at 20 psi)
 - e. Date: October 14 2009.
5. Zoning:
 - a. For each sprinkler zone provide a control valve, flow switch and a test and drain assembly with pressure gauge.

1.4 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. National Fire Protection Association (NFPA):
 - 13-2010Installation of Sprinkler Systems
 - 101-2009Safety to Life from Fire in Buildings and Structures (Life Safety Code)
 - 170-1999Fire Safety Symbols
- C. Underwriters Laboratories, Inc. (UL):
 - Fire Protection Equipment Directory – 2009
- D. Factory Mutual Engineering Corporation (FM):
 - Approval Guide – 2009
- E. International Building Code – 2010
- F. Foundation for Cross-Connection Control and Hydraulic Research-2005

PART 2 - PRODUCTS

2.1 PIPING & FITTINGS

- A. Sprinkler systems in accordance with NFPA 13. Use nonferrous piping in MRI Scanning Rooms.

2.2 VALVES

- A. Valves in accordance with NFPA 13.
- B. Do not use quarter turn ball valves for 50 mm (2 inch) or larger drain valves.

- C. The wet system control valve shall be a listed indicating type valve. Control valve shall be UL Listed and FM Approved for fire protection installations. System control valve shall be rated for normal system pressure but in no case less than 175 PSI. (No Substitutions Allowed).

2.3 SPRINKLERS

- A. All sprinklers except “institutional” type sprinklers shall be FM approved. Maximum break away strength shall be certified by the manufacturer to be no more than 39 kPa (85 pounds). Provide quick response sprinklers in all areas, except where specifically prohibited by their listing or approval.

2.4 SPRINKLER CABINET

- A. Provide sprinkler cabinet with the required number of sprinkler heads of all ratings and types installed, and a sprinkler wrench for each system. Locate adjacent to the riser. Sprinkler heads shall be installed in center of tile or center to center.

2.5 IDENTIFICATION SIGNS/HYDRAULIC PLACARDS

- A. Plastic, steel or aluminum signs with white lettering on a red background with holes for easy attachment. Enter pertinent data for each system on the hydraulic placard.

2.6 SWITCHES:

- A. Contain in a weatherproof die cast/red baked enamel, oil resistant, aluminum housing with tamper resistant screws, 13 mm (1/2 inch) conduit entrance and necessary facilities for attachment to the valves. Provide two SPDT switches rated at 2.5 amps at 24 VDC.
- B. Water flow Alarm Switches: Mechanical, non-coded, non-accumulative retard and adjustable from 0 to 60 seconds minimum. Set flow switches at an initial setting between 20 and 30 seconds.
- C. Valve Supervisory Switches for Ball and Butterfly Valves: May be integral with the valve.

2.7 GAUGES

- A. Provide gauges as required by NFPA 13.

2.8 PIPE HANGERS AND SUPPORTS

- A. Supports, hangers, etc., of an approved pattern placement to conform to NFPA 13. System piping shall be substantially supported to the building structure. The installation of hangers and supports shall adhere to the requirements set forth in NFPA 13, Standard for Installation of Sprinkler Systems. Materials used in the installation or construction of hangers and supports shall be listed and approved for such application. Hangers or supports not specifically listed for service shall be designed and bear the seal of a professional engineer.

2.9 WALL, FLOOR AND CEILING PLATES

- A. Provide chrome plated steel escutcheon plates for exposed piping passing through walls, floors or ceilings.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Installation shall be accomplished by the licensed contractor. Provide a qualified technician, experienced in the installation and operation of the type of system being installed, to supervise the installation and testing of the system.
- B. Installation of Piping: Accurately cut pipe to measurements established by the installer and work into place without springing or forcing. In any situation where bending of the pipe is required, use a standard pipe-bending template. Install concealed piping in spaces that have finished ceilings. Where ceiling mounted equipment exists, such as in operating and radiology rooms, install sprinklers so as not to obstruct the movement or operation of the equipment. Sidewall heads may need to be utilized. Locate piping in stairways as near to the ceiling as possible to prevent tampering by unauthorized personnel, and to provide a minimum headroom clearance of 2250 mm (seven feet six inches). To prevent an obstruction to egress, provide piping clearances in accordance with NFPA 101.
- C. Welding: Conform to the requirements and recommendations of NFPA 13.
- D. Drains: Pipe drains to discharge at safe points outside of the building or to sight cones attached to drains of adequate size to readily carry the full flow from each drain under maximum pressure. Do not provide a direct drain connection to sewer system or discharge into sinks. Install drips and drains where necessary and required by NFPA 13.
- E. Supervisory Switches: Provide supervisory switches for sprinkler control valves.
- F. Waterflow Alarm Switches: Install waterflow switch and adjacent valves in easily accessible locations.
- G. Inspector's Test Connection: Install and supply in conformance with NFPA 13, locate in a secured area, and discharge to the exterior of the building.
- H. Affix cutout disks, which are created by cutting holes in the walls of pipe for flow switches and non-threaded pipe connections to the respective waterflow switch or pipe connection near to the pipe from where they were cut.
- I. Sleeves: Provide for pipes passing through masonry or concrete. Provide space between the pipe and the sleeve in accordance with NFPA 13. Seal this space with a UL Listed through penetration fire stop material in accordance with Section 07 84 00, FIRESTOPPING. Where

core drilling is used in lieu of sleeves, also seal space. Seal penetrations of walls, floors and ceilings of other types of construction, in accordance with Section 07 84 00,

FIRESTOPPING.

- J. Provide pressure gauge at each water flow alarm switch location and at each main drain connection.
- K. Firestopping shall comply with Section 07 84 00, FIRESTOPPING.
- L. Securely attach identification signs to control valves, drain valves, and test valves. Locate hydraulic placard information signs at each sectional control valve where there is a zone water flow switch.
- M. Repairs: Repair damage to the building or equipment resulting from the installation of the sprinkler system by the installer at no additional expense to the Government.
- N. Interruption of Service: There shall be no interruption of the existing sprinkler protection, water, electric, or fire alarm services without prior permission of the Contracting Officer. Contractor shall develop an interim fire protection program where interruptions involve in occupied spaces. Request in writing at least one week prior to the planned interruption.

3.2 INSPECTION AND TEST

- A. Preliminary Testing: Flush newly installed systems prior to performing hydrostatic tests in order to remove any debris which may have been left as well as ensuring piping is unobstructed. Hydrostatically test system, including the fire department connections, as specified in NFPA 13, in the presence of the Contracting Officers Technical Representative (COTR) or his designated representative. Test and flush underground water line prior to performing these hydrostatic tests.
- B. Final Inspection and Testing: Subject system to tests in accordance with NFPA 13, and when all necessary corrections have been accomplished, advise COTR/Resident Engineer to schedule a final inspection and test. Connection to the fire alarm system shall have been in service for at least ten days prior to the final inspection, with adjustments made to prevent false alarms. Furnish all instruments, labor and materials required for the tests and provide the services of the installation foreman or other competent representative of the installer to perform the tests. Correct deficiencies and retest system as necessary, prior to the final acceptance. Include the operation of all features of the systems under normal operations in test.

3.3 INSTRUCTIONS

- A. Furnish the services of a competent instructor for not less than two hours for instructing personnel in the operation and maintenance of the system, on the dates requested by the COTR/Resident Engineer.

--- E N D ---

**SECTION 22 05 11
COMMON WORK RESULTS FOR PLUMBING**

PART 1 - GENERAL

1.1 DESCRIPTION

- A. The requirements of this Section shall apply to all sections of Division 22.
- B. Definitions:
 - 1. Exposed: Piping and equipment exposed to view in finished rooms.
 - 2. Option or optional: Contractor's choice of an alternate material or method.

1.2 RELATED WORK

- A. Section 01 00 00, GENERAL REQUIREMENTS.
- B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- C. Section 31 20 00, EARTH MOVING: Excavation and Backfill.
- D. Section 03 30 00, CAST-IN-PLACE CONCRETE: Concrete and Grout.
- E. Section 05 31 00, STEEL DECKING, Section 05 36 00, COMPOSITE METAL DECKING.
- F. Section 05 50 00, METAL FABRICATIONS.
- G. Section 07 84 00, FIRESTOPPING.
- H. Section 07 60 00, FLASHING AND SHEET METAL: Flashing for Wall and Roof Penetrations.
- I. Section 07 92 00, JOINT SEALANTS.
- J. Section 09 91 00, PAINTING.
- K. Section 23 07 11, HVAC, PLUMBING, AND BOILER PLANT INSULATION.
- L. Section 23 09 23, DIRECT DIGITAL CONTROLS FOR HVAC.
- M. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS
- N. Section 22 05 12, GENERAL MOTOR REQUIREMENTS FOR PLUMBING EQUIPMENT
- O. Section 26 29 11, LOW-VOLTAGE MOTOR STARTERS.

1.3 QUALITY ASSURANCE

- A. Products Criteria:
 - 1. Standard Products: Material and equipment shall be the standard products of a manufacturer regularly engaged in the manufacture of the products for at least 3 years. However, digital electronics devices, software and systems such as controls, instruments, computer work station, shall be the current generation of technology and basic design that has a proven satisfactory service record of at least three years.

2. **Equipment Service:** There shall be permanent service organizations, authorized and trained by manufacturers of the equipment supplied, located within 160 km (100 miles) of the project. These organizations shall come to the site and provide acceptable service to restore operations within four hours of receipt of notification by phone, e-mail or fax in event of an emergency, such as the shut-down of equipment; or within 24 hours in a non-emergency. Names, mail and e-mail addresses and phone numbers of service organizations providing service under these conditions for (as applicable to the project): pumps, critical instrumentation, computer workstation and programming shall be submitted for project record and inserted into the operations and maintenance manual.
 3. All items furnished shall be free from defects that would adversely affect the performance, maintainability and appearance of individual components and overall assembly.
 4. The products and execution of work specified in Division 22 shall conform to the referenced codes and standards as required by the specifications. Local codes and amendments enforced by the local code official shall be enforced, if required by local authorities such as the natural gas supplier. If the local codes are more stringent, then the local code shall apply. Any conflicts shall be brought to the attention of the Resident Engineer (RE)/Contracting Officers Technical Representative (COTR).
 5. **Multiple Units:** When two or more units of materials or equipment of the same type or class are required, these units shall be products of one manufacturer.
 6. **Assembled Units:** Manufacturers of equipment assemblies, which use components made by others, assume complete responsibility for the final assembled product.
 7. **Nameplates:** Nameplate bearing manufacturer's name or identifiable trademark shall be securely affixed in a conspicuous place on equipment, or name or trademark cast integrally with equipment, stamped or otherwise permanently marked on each item of equipment.
 8. Asbestos products or equipment or materials containing asbestos shall not be used.
- B. **Manufacturer's Recommendations:** Where installation procedures or any part thereof are required to be in accordance with the recommendations of the manufacturer of the material being installed, printed copies of these recommendations shall be furnished to the Resident Engineer prior to installation. Installation of the item will not be allowed to proceed until the

recommendations are received. Failure to furnish these recommendations can be cause for rejection of the material.

C. Execution (Installation, Construction) Quality:

1. All items shall be applied and installed in accordance with manufacturer's written instructions. Conflicts between the manufacturer's instructions and the contract drawings and specifications shall be referred to the RE/COTR for resolution. Written hard copies or computer files of manufacturer's installation instructions shall be provided to the RE/COTR at least two weeks prior to commencing installation of any item.
2. Complete layout drawings shall be required by Paragraph, SUBMITTALS. Construction work shall not start on any system until the layout drawings have been approved.

D. Guaranty: Warranty of Construction, FAR clause 52.246-21 .

E. Plumbing Systems: IPC, International Plumbing Code.

1.4 SUBMITTALS

- A. Submittals shall be submitted in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Information and material submitted under this section shall be marked "SUBMITTED UNDER SECTION 22 05 11, COMMON WORK RESULTS FOR PLUMBING", with applicable paragraph identification.
- C. Contractor shall make all necessary field measurements and investigations to assure that the equipment and assemblies will meet contract requirements.
- D. If equipment is submitted which differs in arrangement from that shown, provide drawings that show the rearrangement of all associated systems. Approval will be given only if all features of the equipment and associated systems, including accessibility, are equivalent to that required by the contract.
- E. Prior to submitting shop drawings for approval, contractor shall certify in writing that manufacturers of all major items of equipment have each reviewed drawings and specifications, and have jointly coordinated and properly integrated their equipment and controls to provide a complete and efficient installation.
- F. Upon request by Government, lists of previous installations for selected items of equipment shall be provided. Contact persons who will serve as references, with telephone numbers and e-mail addresses shall be submitted with the references.

- G. Manufacturer's Literature and Data: Manufacturer's literature shall be submitted under the pertinent section rather than under this section.
1. Electric motor data and variable speed drive data shall be submitted with the driven equipment.
 2. Equipment and materials identification.
 3. Fire stopping materials.
 4. Hangers, inserts, supports and bracing. Provide load calculations for variable spring and constant support hangers.
 5. Wall, floor, and ceiling plates.
- H. Coordination Drawings: In accordance with GENERAL CONDITIONS, Article, SUBCONTRACTS AND WORK COORDINATION. Complete consolidated and coordinated layout drawings shall be submitted for all new systems, and for existing systems that are in the same areas. The drawings shall include plan views, elevations and sections of all systems and shall be on a scale of not less than 1:32 (3/8-inch equal to one foot). Clearly identify and dimension the proposed locations of the principal items of equipment. The drawings shall clearly show the proposed location and adequate clearance for all equipment, piping, pumps, valves and other items. All valves, trap primer valves, water hammer arrestors, strainers, and equipment requiring service shall be provided with an access door sized for the complete removal of plumbing device, component, or equipment. Equipment foundations shall not be installed until equipment or piping until layout drawings have been approved. Detailed layout drawings shall be provided for all stormwater and sanitary piping systems and domestic water above 2" line size.
- I. Details of the following shall be provided.
1. Hangers, inserts, supports, and bracing.
 2. Pipe sleeves.
 3. Equipment penetrations of floors, walls, ceilings, or roofs.
- J. Maintenance Data and Operating Instructions:
1. Maintenance and operating manuals in accordance with Section 01 00 00, GENERAL REQUIREMENTS, Article, INSTRUCTIONS, for systems and equipment.
 2. Listing of recommended replacement parts for keeping in stock supply, including sources of supply, for equipment shall be provided.
 3. The listing shall include belts for equipment: Belt manufacturer, model number, size and style, and distinguished whether of multiple belt sets.

1.5 DELIVERY, STORAGE AND HANDLING

A. Protection of Equipment:

1. Equipment and material placed on the job site shall remain in the custody of the Contractor until phased acceptance, whether or not the Government has reimbursed the Contractor for the equipment and material. The Contractor is solely responsible for the protection of such equipment and material against any damage.
2. Damaged equipment shall be replaced with an identical unit as determined and directed by the RE/COTR. Such replacement shall be at no additional cost to the Government.
3. Interiors of new equipment and piping systems shall be protected against entry of foreign matter. Both inside and outside shall be cleaned before painting or placing equipment in operation.
4. Existing equipment and piping being worked on by the Contractor shall be under the custody and responsibility of the Contractor and shall be protected as required for new work.

B. Cleanliness of Piping and Equipment Systems:

1. Care shall be exercised in the storage and handling of equipment and piping material to be incorporated in the work. Debris arising from cutting, threading and welding of piping shall be removed.
2. Piping systems shall be flushed, blown or pigged as necessary to deliver clean systems.
3. The interior of all tanks shall be cleaned prior to delivery and beneficial use by the Government. All piping shall be tested in accordance with the specifications and the International Plumbing Code (IPC), latest edition. All filters, strainers, fixture faucets shall be flushed of debris prior to final acceptance.
4. Contractor shall be fully responsible for all costs, damage, and delay arising from failure to provide clean systems.

1.6 APPLICABLE PUBLICATIONS

- A. The publications listed below shall form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.

B. American Society of Mechanical Engineers (ASME):

Boiler and Pressure Vessel Code (BPVC):

SEC IX-2007.....Boiler and Pressure Vessel Code; Section IX, Welding and
Brazing Qualifications.

C. American Society for Testing and Materials (ASTM):

- A36/A36M-2008.....Standard Specification for Carbon Structural Steel
- A575-96 (R 2007).....Standard Specification for Steel Bars, Carbon, Merchant
Quality, M-Grades R (2002)
- E84-2005.....Standard Test Method for Surface Burning Characteristics of
Building Materials
- E119-2008a.....Standard Test Methods for Fire Tests of Building Construction
and Materials
- D. Manufacturers Standardization Society (MSS) of the Valve and Fittings Industry, Inc:
SP-58-02Pipe Hangers and Supports-Materials, Design and Manufacture
SP 69-2003 (R 2004)Pipe Hangers and Supports-Selection and Application
- E. National Electrical Manufacturers Association (NEMA):
MG1-2003, Rev. 1-2007 Motors and Generators
- F. International Code Council, (ICC):
IBC-2009.....International Building Code
IPC-2009International Plumbing Code

PART 2 - PRODUCTS

2.1 FACTORY-ASSEMBLED PRODUCTS

- A. Standardization of components shall be maximized to reduce spare part requirements.
- B. Manufacturers of equipment assemblies that include components made by others shall assume complete responsibility for final assembled unit.
 - 1. All components of an assembled unit need not be products of same manufacturer.
 - 2. Constituent parts that are alike shall be products of a single manufacturer.
 - 3. Components shall be compatible with each other and with the total assembly for intended service.
 - 4. Contractor shall guarantee performance of assemblies of components, and shall repair or replace elements of the assemblies as required to deliver specified performance of the complete assembly.
- C. Components of equipment shall bear manufacturer's name and trademark, model number, serial number and performance data on a name plate securely affixed in a conspicuous place, or cast integral with, stamped or otherwise permanently marked upon the components of the equipment.
- D. Major items of equipment, which serve the same function, shall be the same make and model

2.2 COMPATIBILITY OF RELATED EQUIPMENT

- A. Equipment and materials installed shall be compatible in all respects with other items being furnished and with existing items so that the result will be a complete and fully operational system that conforms to contract requirements.

2.3 SAFETY GUARDS

- A. Pump shafts and couplings shall be fully guarded by a sheet steel guard, covering coupling and shaft but not bearings. Material shall be minimum 16-gage sheet steel; ends shall be braked and drilled and attached to pump base with minimum of four 6 mm (1/4-inch) bolts. Reinforce guard as necessary to prevent side play forcing guard onto couplings.
- B. All Equipment shall have moving parts protected from personal injury.

2.4 LIFTING ATTACHMENTS

- A. Equipment shall be provided with suitable lifting attachments to enable equipment to be lifted in its normal position. Lifting attachments shall withstand any handling conditions that might be encountered, without bending or distortion of shape, such as rapid lowering and braking of load.

2.5 ELECTRIC MOTORS, MOTOR CONTROL, CONTROL WIRING

- B. A. All material and equipment furnished and installation methods shall conform to the requirements of Section 22 05 12, GENERAL MOTOR REQUIREMENTS FOR PLUMBING EQUIPMENT; Section 26 29 11, LOW-VOLTAGE MOTOR STARTERS; and, Section 26 05 21, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES (600 VOLTS AND BELOW). All electrical wiring, conduit, and devices necessary for the proper connection, protection and operation of the systems shall be provided. Premium efficient motors shall be provided. Unless otherwise specified for a particular application, electric motors shall have the following requirements.
- C. B. Special Requirements:
 1. 1. Where motor power requirements of equipment furnished deviate from power shown on plans, provide electrical service designed under the requirements of NFPA 70 without additional time or cost to the Government.
 2. 2. Assemblies of motors, starters, and controls and interlocks on factory assembled and wired devices shall be in accordance with the requirements of this specification.
 3. 3. Wire and cable materials specified in the electrical division of the specifications shall be modified as follows:

- a. a. Wiring material located where temperatures can exceed 71° C (160° F) shall be stranded copper with Teflon FEP insulation with jacket. This includes wiring on the boilers.
 - b. b. Other wiring at boilers and to control panels shall be NFPA 70 designation THWN.
 - c. c. Shielded conductors or wiring in separate conduits for all instrumentation and control systems shall be provided where recommended by manufacturer of equipment.
- 4. 4. Motor sizes shall be selected so that the motors do not operate into the service factor at maximum required loads on the driven equipment. Motors on pumps shall be sized for non-overloading at all points on the pump performance curves.
- 5. 5. Motors utilized with variable frequency drives shall be rated “inverter-ready” per NEMA Standard, MG1, Part 31.4.4.2.
- D. C. Motor Efficiency and Power Factor: All motors, when specified as “high efficiency or Premium Efficiency” by the project specifications on driven equipment, shall conform to efficiency and power factor requirements in Section 22 05 12, GENERAL MOTOR REQUIREMENTS FOR PLUMBING EQUIPMENT, with no consideration of annual service hours. Motor manufacturers generally define these efficiency requirements as “NEMA premium efficient” and the requirements generally exceed those of the Energy Policy Act of 1992 (EPACT). Motors not specified as “high efficiency or premium efficient” shall comply with EPACT.
- E. D. Single-phase Motors: Capacitor-start type for hard starting applications. Motors for centrifugal fans and pumps may be split phase or permanent split capacitor (PSC).
- F. E. Poly-phase Motors: NEMA Design B, Squirrel cage, induction type. Each two-speed motor shall have two separate windings. A time delay (20 seconds minimum) relay shall be provided for switching from high to low speed.
- G. F. Rating: Rating shall be continuous duty at 100 percent capacity in an ambient temperature of 40° C (104° F); minimum horsepower as shown on drawings; maximum horsepower in normal operation shall not exceed nameplate rating without service factor.
- H. G. Insulation Resistance: Not less than one-half meg-ohm between stator conductors and frame shall be measured at the time of final inspection.

2.6 EQUIPMENT AND MATERIALS IDENTIFICATION

- A. Use symbols, nomenclature and equipment numbers specified, shown on the drawings, or shown in the maintenance manuals. In addition, provide bar coded identification nameplate for all equipment which will allow the equipment identification code to be scanned into the system for maintenance and inventory tracking. Coordinate bar coding with Veterans Administration staff. Identification for piping is specified in Section 09 91 00, PAINTING.
- B. Interior (Indoor) Equipment: Engraved nameplates, with letters not less than 48 mm (3/16-inch) high of brass with black-filled letters, or rigid black plastic with white letters specified in Section 09 91 00, PAINTING shall be permanently fastened to the equipment. Unit components such as water heaters, tanks, coils, filters, fans, etc. shall be identified.
- C. Exterior (Outdoor) Equipment: Brass nameplates, with engraved black filled letters, not less than 48 mm (3/16-inch) high riveted or bolted to the equipment.
- D. Control Items: All temperature, pressure, and controllers shall be labeled and the component's function identified. Identify and label each item as they appear on the control diagrams.
- E. Valve Tags and Lists:
 - 1. Plumbing: All valves shall be provided with valve tags and listed on a valve list (Fixture stops not included).
 - 2. Valve tags: Engraved black filled numbers and letters not less than 13 mm (1/2-inch) high for number designation, and not less than 6.4 mm(1/4-inch) for service designation on 19 gage, 38 mm (1-1/2 inches) round brass disc, attached with brass "S" hook or brass chain.
 - 3. Valve lists: Valve lists shall be created using a word processing program and printed on plastic coated cards. The plastic coated valve list card(s), sized 216 mm (8-1/2 inches) by 280 mm (11 inches) shall show valve tag number, valve function and area of control for each service or system. The valve list shall be in a punched 3-ring binder notebook.

A copy of the valve list shall be mounted in picture frames for mounting to a wall.

2.7 FIRE STOPPING

- A. Section 07 84 00, FIRESTOPPING specifies an effective barrier against the spread of fire, smoke and gases where penetrations occur for piping. Refer to Section 23 07 11, HVAC, PLUMBING, AND BOILER PLANT INSULATION, for pipe insulation.

2.8 GALVANIZED REPAIR COMPOUND

- A. Mil. Spec. DOD-P-21035B, paint.

2.9 PIPE AND EQUIPMENT SUPPORTS AND RESTRAINTS

- A. In lieu of the paragraph which follows, suspended equipment support and restraints may be designed and installed in accordance with the International Building Code (IBC), latest edition. Submittals based on the International Building Code (IBC), latest edition, or the following paragraphs of this Section shall be stamped and signed by a professional engineer registered in a state where the project is located. The Support system of suspended equipment over 227 kg (500 pounds) shall be submitted for approval of the Resident Engineer in all cases. See these specifications for lateral force design requirements.
- B. Type Numbers Specified: MSS SP-58. For selection and application refer to MSS SP-69. Refer to Section 05 50 00, METAL FABRICATIONS, for miscellaneous metal support materials and prime coat painting.
- C. For Attachment to Concrete Construction:
 - 1. Concrete insert: Type 18, MSS SP-58.
 - 2. Self-drilling expansion shields and machine bolt expansion anchors: Permitted in concrete not less than 102 mm (4 inches) thick when approved by the Resident Engineer for each job condition.
 - 3. Power-driven fasteners: Permitted in existing concrete or masonry not less than 102 mm (4 inches) thick when approved by the Resident Engineer for each job condition.
- D. For Attachment to Steel Construction: MSS SP-58.
 - 1. Welded attachment: Type 22.
 - 2. Beam clamps: Types 20, 21, 28 or 29. Type 23 C-clamp may be used for individual copper tubing up to 23 mm (7/8-inch) outside diameter.
- E. Attachment to Metal Pan or Deck: As required for materials specified in Section 05 36 00, COMPOSITE METAL DECKING.
- F. For Attachment to Wood Construction: Wood screws or lag bolts.
- G. Hanger Rods: Hot-rolled steel, ASTM A36 or A575 for allowable load listed in MSS SP-58. For piping, provide adjustment means for controlling level or slope. Types 13 or 15 turn-buckles shall provide 38 mm (1-1/2 inches) minimum of adjustment and incorporate locknuts. All-thread rods are acceptable.
- H. Multiple (Trapeze) Hangers: Galvanized, cold formed, lipped steel channel horizontal member, not less than 41 mm by 41 mm (1-5/8 inches by 1-5/8 inches), 2.7 mm (No. 12 gage), designed to accept special spring held, hardened steel nuts. Trapeze hangers are not permitted for steam supply and condensate piping.

1. Allowable hanger load: Manufacturers rating less 91kg (200 pounds).
 2. Guide individual pipes on the horizontal member of every other trapeze hanger with 6 mm (1/4-inch) U-bolt fabricated from steel rod. Provide Type 40 insulation shield, secured by two 13 mm (1/2-inch) galvanized steel bands, or insulated calcium silicate shield for insulated piping at each hanger.
- I. Pipe Hangers and Supports: (MSS SP-58), use hangers sized to encircle insulation on insulated piping. Refer to Section 23 07 11, HVAC, PLUMBING, and BOILER PLANT INSULATION for insulation thickness. To protect insulation, provide Type 39 saddles for roller type supports or insulated calcium silicate shields. Provide Type 40 insulation shield or insulated calcium silicate shield at all other types of supports and hangers including those for insulated piping.
1. General Types (MSS SP-58):
 - a. Standard clevis hanger: Type 1; provide locknut.
 - b. Riser clamps: Type 8.
 - c. Wall brackets: Types 31, 32 or 33.
 - d. Roller supports: Type 41, 43, 44 and 46.
 - e. Saddle support: Type 36, 37 or 38.
 - f. Turnbuckle: Types 13 or 15.
 - g. U-bolt clamp: Type 24.
 - h. Copper Tube:
 - 1) Hangers, clamps and other support material in contact with tubing shall be painted with copper colored epoxy paint, plastic coated or taped with isolation tape to prevent electrolysis.
 - 2) For vertical runs use epoxy painted or plastic coated riser clamps.
 - 3) For supporting tube to strut: Provide epoxy painted pipe straps for copper tube or plastic inserted vibration isolation clamps.
 - 4) Insulated Lines: Provide pre-insulated calcium silicate shields sized for copper tube.
 - i. Supports for plastic or glass piping: As recommended by the pipe manufacturer with black rubber tape extending one inch beyond steel support or clamp. //Spring Supports (Expansion and contraction of vertical piping):
 - 1) Movement up to 20 mm (3/4-inch): Type 51 or 52 variable spring unit with integral turn buckle and load indicator.

- 2) Movement more than 20 mm (3/4-inch): Type 54 or 55 constant support unit with integral adjusting nut, turn buckle and travel position indicator.
 - j. Spring hangers are required on all plumbing system pumps one horsepower and greater.
- 2. Plumbing Piping (Other Than General Types):
 - a. Horizontal piping: Type 1, 5, 7, 9, and 10.
 - b. Chrome plated piping: Chrome plated supports.
 - c. Hangers and supports in pipe chase: Prefabricated system ABS self-extinguishing material, not subject to electrolytic action, to hold piping, prevent vibration and compensate for all static and operational conditions.
 - d. Blocking, stays and bracing: Angle iron or preformed metal channel shapes, 1.3 mm (18 gage) minimum.
- J. Pre-insulated Calcium Silicate Shields:
 - 1. Provide 360 degree water resistant high density 965 kPa (140 psi) compressive strength calcium silicate shields encased in galvanized metal.
 - 2. Pre-insulated calcium silicate shields to be installed at the point of support during erection.
 - 3. Shield thickness shall match the pipe insulation.
 - 4. The type of shield is selected by the temperature of the pipe, the load it must carry, and the type of support it will be used with.
 - a. Shields for supporting cold water shall have insulation that extends a minimum of one inch past the sheet metal.
 - b. The insulated calcium silicate shield shall support the maximum allowable water filled span as indicated in MSS-SP 69. To support the load, the shields shall have one or more of the following features: structural inserts 4138 kPa (600 psi) compressive strength, an extra bottom metal shield, or formed structural steel (ASTM A36) wear plates welded to the bottom sheet metal jacket.
 - 5. Shields may be used on steel clevis hanger type supports, roller supports or flat surfaces.

2.10 PIPE PENETRATIONS

- A. Pipe penetration sleeves shall be installed for all pipe other than rectangular blocked out floor openings for risers in mechanical bays.

- B. Pipe penetration sleeve materials shall comply with all fire stopping requirements for each penetration.
- C. To prevent accidental liquid spills from passing to a lower level, provide the following:
 - 1. For sleeves: Extend sleeve 25 mm (1 inch) above finished floor and provide sealant for watertight joint.
 - 2. For blocked out floor openings: Provide 40 mm (1-1/2 inch) angle set in silicone adhesive around opening.
 - 3. For drilled penetrations: Provide 40 mm (1-1/2 inch) angle ring or square set in silicone adhesive around penetration.
- D. Penetrations are not allowed through beams or ribs, but may be installed in concrete beam flanges. Any deviation from these requirements must receive prior approval of Resident Engineer.
- E. Sheet metal, plastic, or moisture resistant fiber sleeves shall be provided for pipe passing through floors, interior walls, and partitions, unless brass or steel pipe sleeves are specifically called for below.
- F. Cast iron or zinc coated pipe sleeves shall be provided for pipe passing through exterior walls below grade. The space between the sleeve and pipe shall be made watertight with a modular or link rubber seal. The link seal shall be applied at both ends of the sleeve.
- G. Galvanized steel or an alternate black iron pipe with asphalt coating sleeves shall be for pipe passing through concrete beam flanges, except where brass pipe sleeves are called for. A galvanized steel Sleeve shall be provided for pipe passing through floor of mechanical rooms, laundry work rooms, and animal rooms above basement. Except in mechanical rooms, sleeves shall be connected with a floor plate.
- H. Brass Pipe Sleeves shall be provided for pipe passing through quarry tile, terrazzo or ceramic tile floors. The sleeve shall be connected with a floor plate.
- I. Sleeve clearance through floors, walls, partitions, and beam flanges shall be 25 mm (1 inch) greater in diameter than external diameter of pipe. Sleeve for pipe with insulation shall be large enough to accommodate the insulation plus 25 mm (1 inch) in diameter. Interior openings shall be caulked tight with fire stopping material and sealant to prevent the spread of fire, smoke, and gases.
- J. Sealant and Adhesives: Shall be as specified in Section 07 92 00, JOINT SEALANTS.

2.11 TOOLS AND LUBRICANTS

- A. Furnish, and turn over to the Resident Engineer, special tools not readily available commercially, that are required for disassembly or adjustment of equipment and machinery furnished.
- B. Grease Guns with Attachments for Applicable Fittings: One for each type of grease required for each motor or other equipment.
- C. Tool Containers: metal, permanently identified for intended service and mounted, or located, where directed by the Resident Engineer.
- D. Lubricants: A minimum of 0.95 L (1 quart) of oil, and 0.45 kg (1 pound) of grease, of equipment manufacturer's recommended grade and type, in unopened containers and properly identified as to use for each different application.

2.12 WALL, FLOOR AND CEILING PLATES

- A. Material and Type: Chrome plated brass or chrome plated steel, one piece or split type with concealed hinge, with set screw for fastening to pipe, or sleeve. Use plates that fit tight around pipes, cover openings around pipes and cover the entire pipe sleeve projection.
- B. Thickness: Not less than 2.4 mm (3/32-inch) for floor plates. For wall and ceiling plates, not less than 0.64 mm (0.025-inch) for up to 80 mm (3 inch) pipe, 0.89 mm (0.035-inch) for larger pipe.
- C. Locations: Use where pipe penetrates floors, walls and ceilings in exposed locations, in finished areas only. Wall plates shall be used where insulation ends on exposed water supply pipe drop from overhead. A watertight joint shall be provided in spaces where brass or steel pipe sleeves are specified.

2.13 PRESSURE GAGES FOR WATER AND SEWAGE USAGE

- A. ANSI B40.1 all metal case 114 mm (4-1/2 inches) diameter, bottom connected throughout, graduated as required for service, and identity labeled. Range shall be 0 to 1375 kPa (0 to 200 psi) gauge.
- B. The pressure element assembly shall be bourdon tube. The mechanical movement shall be lined to pressure element and connected to pointer.
- C. The dial shall be non-reflective aluminum with permanently etched scale markings graduated in kPa and psi.
- D. The pointer shall be dark colored metal.
- E. The window shall be glass.
- F. The ring shall be brass or stainless steel.

- G. The accuracy shall be grade A, plus or minus 1 percent of middle half of scale range.

2.14 ASBESTOS

- A. Materials containing asbestos are not permitted.

PART 3 - EXECUTION

3.1 ARRANGEMENT AND INSTALLATION OF EQUIPMENT AND PIPING

- A. Location of piping, sleeves, inserts, hangers, and equipment, access provisions shall be coordinated with the work of all trades. Piping, sleeves, inserts, hangers, and equipment shall be located clear of windows, doors, openings, light outlets, and other services and utilities. Equipment layout drawings shall be prepared to coordinate proper location and personnel access of all facilities. The drawings shall be submitted for review.
 - 1. Manufacturer's published recommendations shall be followed for installation methods not otherwise specified.
- B. Operating Personnel Access and Observation Provisions: All equipment and systems shall be arranged to provide clear view and easy access, without use of portable ladders, for maintenance and operation of all devices including, but not limited to: all equipment items, valves, filters, strainers, transmitters, sensors, control devices. All gages and indicators shall be clearly visible by personnel standing on the floor or on permanent platforms. Maintenance and operating space and access provisions that are shown on the drawings shall not be changed nor reduced.
- C. Structural systems necessary for pipe and equipment support shall be coordinated to permit proper installation.
- D. Location of pipe sleeves, trenches and chases shall be accurately coordinated with equipment and piping locations.
- E. Cutting Holes:
 - 1. Holes through concrete and masonry shall be cut by rotary core drill. Pneumatic hammer, impact electric, and hand or manual hammer type drill will not be allowed, except as permitted by RE/COTR where working area space is limited.
 - 2. Holes shall be located to avoid interference with structural members such as beams or grade beams. Holes shall be laid out in advance and drilling done only after approval by RE/COTR. If the Contractor considers it necessary to drill through structural members, this matter shall be referred to RE/COTR for approval.
 - 3. Waterproof membrane shall not be penetrated. Pipe floor penetration block outs shall be provided outside the extents of the waterproof membrane.

- F. Interconnection of Instrumentation or Control Devices: Generally, electrical and pneumatic interconnections are not shown but must be provided.
- G. Minor Piping: Generally, small diameter pipe runs from drips and drains, water cooling, and other service are not shown but must be provided.
- H. Protection and Cleaning:
 - 1. Equipment and materials shall be carefully handled, properly stored, and adequately protected to prevent damage before and during installation, in accordance with the manufacturer's recommendations and as approved by the Resident Engineer. Damaged or defective items in the opinion of the Resident Engineer, shall be replaced.
 - 2. Protect all finished parts of equipment, such as shafts and bearings where accessible, from rust prior to operation by means of protective grease coating and wrapping. Close pipe openings with caps or plugs during installation. Pipe openings, equipment, and plumbing fixtures shall be tightly covered against dirt or mechanical injury. At completion of all work thoroughly clean fixtures, exposed materials and equipment.
- I. Concrete and Grout: Concrete and shrink compensating grout 25 MPa (3000 psi) minimum, specified in Section 03 30 00, CAST-IN-PLACE CONCRETE. shall be used for all pad or floor mounted equipment. Gages, thermometers, valves and other devices shall be installed with due regard for ease in reading or operating and maintaining said devices. Thermometers and gages shall be located and positioned to be easily read by operator or staff standing on floor or walkway provided. Servicing shall not require dismantling adjacent equipment or pipe work.
- J. Interconnection of Controls and Instruments: Electrical interconnection is generally not shown but shall be provided. This includes interconnections of sensors, transmitters, transducers, control devices, control and instrumentation panels, instruments and computer workstations. Comply with NFPA-70.
- K. Many plumbing systems interface with the HVAC control system. See the HVAC control points list and section 23 09 23 DIRECT DIGITAL CONTROLS FOR HVAC
- L. Work in Existing Building:
 - 1. Perform as specified in Article, OPERATIONS AND STORAGE AREAS, Article, ALTERATIONS, and Article, RESTORATION of the Section 01 00 00, GENERAL REQUIREMENTS for relocation of existing equipment, alterations and restoration of existing building(s).

2. As specified in Section 01 00 00, GENERAL REQUIREMENTS, Article, OPERATIONS AND STORAGE AREAS, make alterations to existing service piping at times that will cause the least interfere with normal operation of the facility.
- M. Work in bathrooms, restrooms, housekeeping closets: All pipe penetrations behind escutcheons shall be sealed with plumbers putty.
- N. Switchgear Drip Protection: Every effort shall be made to eliminate the installation of pipe above electrical and telephone switchgear. If this is not possible, encase pipe in a second pipe with a minimum of joints.
- O. Inaccessible Equipment:
 1. Where the Government determines that the Contractor has installed equipment not conveniently accessible for operation and maintenance, equipment shall be removed and reinstalled or remedial action performed as directed at no additional cost to the Government.
 2. The term "conveniently accessible" is defined as capable of being reached without the use of ladders, or without climbing or crawling under or over obstacles such as electrical conduit, motors, fans, pumps, belt guards, transformers, high voltage lines, piping, and ductwork.

3.2 TEMPORARY PIPING AND EQUIPMENT

- A. Continuity of operation of existing facilities may require temporary installation or relocation of equipment and piping. Temporary equipment or pipe installation or relocation shall be provided to maintain continuity of operation of existing facilities.
- B. The Contractor shall provide all required facilities in accordance with the requirements of phased construction and maintenance of service. All piping and equipment shall be properly supported, sloped to drain, operate without excessive stress, and shall be insulated where injury can occur to personnel by contact with operating facilities. The requirements of Para. 3.1 shall apply.
- C. Temporary facilities and piping shall be completely removed and any openings in structures sealed. Necessary blind flanges and caps shall be provided to seal open piping remaining in service.

3.3 RIGGING

- A. Openings in building structures shall be planned to accommodate design scheme.

- B. Alternative methods of equipment delivery may be offered and will be considered by Government under specified restrictions of phasing and service requirements as well as structural integrity of the building.
- C. All openings in the building shall be closed when not required for rigging operations to maintain proper environment in the facility for Government operation and maintenance of service.
- D. Contractor shall provide all facilities required to deliver specified equipment and place on foundations. Attachments to structures for rigging purposes and support of equipment on structures shall be Contractor's full responsibility.
- E. Contractor shall check all clearances, weight limitations and shall provide a rigging plan designed by a Registered Professional Engineer. All modifications to structures, including reinforcement thereof, shall be at Contractor's cost, time and responsibility.
- F. Rigging plan and methods shall be referred to RE/COTR for evaluation prior to actual work.

3.4 PIPE AND EQUIPMENT SUPPORTS

- A. Where hanger spacing does not correspond with joist or rib spacing, use structural steel channels secured directly to joist and rib structure that will correspond to the required hanger spacing, and then suspend the equipment and piping from the channels. Holes shall be drilled or burned in structural steel ONLY with the prior written approval of the Resident Engineer.
- B. The use of chain pipe supports, wire or strap hangers; wood for blocking, stays and bracing, or hangers suspended from piping above shall not be permitted. Rusty products shall be replaced.
- C. Hanger rods shall be used that are straight and vertical. Turnbuckles for vertical adjustments may be omitted where limited space prevents use. A minimum of 15 mm (1/2-inch) clearance between pipe or piping covering and adjacent work shall be provided.
- D. For horizontal and vertical plumbing pipe supports, refer to the International Plumbing Code (IPC), latest edition, and these specifications.
- E. Overhead Supports:
 - 1. The basic structural system of the building is designed to sustain the loads imposed by equipment and piping to be supported overhead.
 - 2. Provide steel structural members, in addition to those shown, of adequate capability to support the imposed loads, located in accordance with the final approved layout of equipment and piping.

3. Tubing and capillary systems shall be supported in channel troughs.
- F. Floor Supports:
1. Provide concrete bases, concrete anchor blocks and pedestals, and structural steel systems for support of equipment and piping. Concrete bases and structural systems shall be anchored and doweled to resist forces under operating and seismic conditions (if applicable) without excessive displacement or structural failure.
 2. Bases and supports shall not be located and installed until equipment mounted thereon has been approved. Bases shall be sized to match equipment mounted thereon plus 50 mm (2 inch) excess on all edges. Structural drawings shall be reviewed for additional requirements. Bases shall be neatly finished and smoothed, shall have chamfered edges at the top, and shall be suitable for painting.
 3. All equipment shall be shimmed, leveled, firmly anchored, and grouted with epoxy grout. Anchor bolts shall be placed in sleeves, anchored to the bases. Fill the annular space between sleeves and bolts with a grout material to permit alignment and realignment.

3.5 LUBRICATION

- A. All equipment and devices requiring lubrication shall be lubricated prior to initial operation. All devices and equipment shall be field checked for proper lubrication.
- B. All devices and equipment shall be equipped with required lubrication fittings. A minimum of one liter (one quart) of oil and 0.5 kg (one pound) of grease of manufacturer's recommended grade and type for each different application shall be provided. All materials shall be delivered to RE/COTR in unopened containers that are properly identified as to application.
- C. A separate grease gun with attachments for applicable fittings shall be provided for each type of grease applied.
- D. All lubrication points shall be accessible without disassembling equipment, except to remove access plates.
- E. All lubrication points shall be extended to one side of the equipment.

3.6 PLUMBING SYSTEMS DEMOLITION

- A. Rigging access, other than indicated on the drawings, shall be provided after approval for structural integrity by the RE/COTR. Such access shall be provided without additional cost or time to the Government. Where work is in an operating plant, approved protection from

- dust and debris shall be provided at all times for the safety of plant personnel and maintenance of plant operation and environment of the plant.
- B. In an operating plant, cleanliness and safety shall be maintained. The plant shall be kept in an operating condition. Government personnel will be carrying on their normal duties of operating, cleaning and maintaining equipment and plant operation. Work shall be confined to the immediate area concerned; maintain cleanliness and wet down demolished materials to eliminate dust. Dust and debris shall not be permitted to accumulate in the area to the detriment of plant operation. All flame cutting shall be performed to maintain the fire safety integrity of this plant. Adequate fire extinguishing facilities shall be available at all times. All work shall be performed in accordance with recognized fire protection standards. Inspections will be made by personnel of the VA Medical Center, and the Contractor shall follow all directives of the RE or COTR with regard to rigging, safety, fire safety, and maintenance of operations.
 - C. Unless specified otherwise, all piping, wiring, conduit, and other devices associated with the equipment not re-used in the new work shall be completely removed from Government property. This includes all concrete equipment pads, pipe, valves, fittings, insulation, and all hangers including the top connection and any fastenings to building structural systems. All openings shall be sealed after removal of equipment, pipes, ducts, and other penetrations in roof, walls, floors, in an approved manner and in accordance with plans and specifications where specifically covered. Structural integrity of the building system shall be maintained. Reference shall also be made to the drawings and specifications of the other disciplines in the project for additional facilities to be demolished or handled.
 - D. All valves including gate, globe, ball, butterfly and check, all pressure gages and thermometers with wells shall remain Government property and shall be removed and delivered to RE/COTR and stored as directed. The Contractor shall remove all other material and equipment, devices and demolition debris under these plans and specifications. Such material shall be removed from Government property expeditiously and shall not be allowed to accumulate.

3.7 CLEANING AND PAINTING

- A. Prior to final inspection and acceptance of the plant and facilities for beneficial use by the Government, the plant facilities, equipment and systems shall be thoroughly cleaned and painted. Refer to Section 09 91 00, PAINTING.
- B. In addition, the following special conditions apply:

1. Cleaning shall be thorough. Solvents, cleaning materials and methods recommended by the manufacturers shall be used for the specific tasks. All rust shall be removed prior to painting and from surfaces to remain unpainted. Scratches, scuffs, and abrasions shall be repaired prior to applying prime and finish coats.
2. The following Material And Equipment shall NOT be painted::
 - a. Motors, controllers, control switches, and safety switches.
 - b. Control and interlock devices.
 - c. Regulators.
 - d. Pressure reducing valves.
 - e. Control valves and thermostatic elements.
 - f. Lubrication devices and grease fittings.
 - g. Copper, brass, aluminum, stainless steel and bronze surfaces.
 - h. Valve stems and rotating shafts.
 - i. Pressure gages and thermometers.
 - j. Glass.
 - k. Name plates.
3. Control and instrument panels shall be cleaned and damaged surfaces repaired. Touch-up painting shall be made with matching paint obtained from manufacturer or computer matched.
4. Pumps, motors, steel and cast iron bases, and coupling guards shall be cleaned, and shall be touched-up with the same color as utilized by the pump manufacturer
5. Temporary Facilities: Apply paint to surfaces that do not have existing finish coats.
6. The final result shall be a smooth, even-colored, even-textured factory finish on all items. The entire piece of equipment shall be repainted, if necessary, to achieve this.

3.8 IDENTIFICATION SIGNS

- A. Laminated plastic signs, with engraved lettering not less than 5 mm (3/16-inch) high, shall be provided that designates equipment function, for all equipment, switches, motor controllers, relays, meters, control devices, including automatic control valves. Nomenclature and identification symbols shall correspond to that used in maintenance manual, and in diagrams specified elsewhere. Attach by chain, adhesive, or screws.
- B. Factory Built Equipment: Metal plate, securely attached, with name and address of manufacturer, serial number, model number, size, performance shall be placed on factory built equipment.

- C. Pipe Identification: Refer to Section 09 91 00, PAINTING.

3.9 STARTUP AND TEMPORARY OPERATION

- A. Start up of equipment shall be performed as described in the equipment specifications.
Vibration within specified tolerance shall be verified prior to extended operation. Temporary use of equipment is specified in Section 01 00 00, GENERAL REQUIREMENTS, Article, TEMPORARY USE OF MECHANICAL AND ELECTRICAL EQUIPMENT.

3.10 OPERATING AND PERFORMANCE TESTS

- A. Prior to the final inspection, all required tests shall be performed as specified in Section 01 00 00, GENERAL REQUIREMENTS, Article, TESTS and submit the test reports and records to the Resident Engineer.
- B. Should evidence of malfunction in any tested system, or piece of equipment or component part thereof, occur during or as a result of tests, make proper corrections, repairs or replacements, and repeat tests at no additional cost to the Government.
- C. When completion of certain work or system occurs at a time when final control settings and adjustments cannot be properly made to make performance tests, then make performance tests such systems respectively during first actual seasonal use of respective systems following completion of work.

3.11 OPERATION AND MAINTENANCE MANUALS

- A. Provide four bound copies. The Operations and maintenance manuals shall be delivered to RE/COTR not less than 30 days prior to completion of a phase or final inspection.
- B. All new and temporary equipment and all elements of each assembly shall be included.
- C. Data sheet on each device listing model, size, capacity, pressure, speed, horsepower, impeller size, and other information shall be included.
- D. Manufacturer's installation, maintenance, repair, and operation instructions for each device shall be included. Assembly drawings and parts lists shall also be included. A summary of operating precautions and reasons for precautions shall be included in the Operations and Maintenance Manual.
- E. Lubrication instructions, type and quantity of lubricant shall be included.
- F. Schematic diagrams and wiring diagrams of all control systems corrected to include all field modifications shall be included.
- G. Set points of all interlock devices shall be listed.
- H. Trouble-shooting guide for the control system troubleshooting guide shall be inserted into the Operations and Maintenance Manual.

- I. The combustion control system sequence of operation corrected with submittal review comments shall be inserted into the Operations and Maintenance Manual.
- J. Emergency procedures.

3.12 INSTRUCTIONS TO VA PERSONNEL

- A. Instructions shall be provided in accordance with Article, INSTRUCTIONS, of Section 01 00 00, GENERAL REQUIREMENTS.

--- E N D ---

SECTION 22 05 12
GENERAL MOTOR REQUIREMENTS FOR PLUMBING EQUIPMENT

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This section describes the general motor requirements for plumbing equipment.

1.2 RELATED WORK:

- A. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: General electrical requirements common to more than one section of Division 26.
- B. 26 29 11, LOW-VOLTAGE MOTOR STARTERS: Starters, control and protection of motors: Section

1.3 SUBMITTALS:

- A. In accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS, submit the following:
- B. Shop Drawings:
1. Sufficient information, clearly presented, shall be included to determine compliance with drawings and specifications.
 2. Motor nameplate information shall be submitted including electrical ratings, dimensions, mounting details, materials, horsepower, power factor, current as a function of speed, current efficiency, speed as a function of load, RPM, enclosure, starting characteristics, torque characteristics, code letter, full load and locked rotor current, service factor, and lubrication method.
 3. Motor parameters required for the determination of the Reed Critical Frequency of vertical hollow shaft motors shall be submitted.
- C. Manuals:
1. Companion copies of complete maintenance and operating manuals, including technical data sheets and application data shall be submitted simultaneously with the shop drawings.
- D. Certification: Two weeks prior to final inspection, unless otherwise noted, four copies of the following certification shall be submitted to the Resident Engineer:
1. Certification shall be submitted stating that the motors have been properly applied, installed, adjusted, lubricated, and tested.

1.4 APPLICABLE PUBLICATIONS:

- A. The publications listed below (including amendments, addenda, revisions, supplements and errata) shall form a part of this specification to the extent referenced. Publications are referenced in the text by designation only.
- B. National Electrical Manufacturers Association (NEMA):
 - MG 1-07.....Motors and Generators
 - MG 2-01.....Safety Standard and Guide for Selection, Installation and Use of
Electric Motors and Generators
- C. National Fire Protection Association (NFPA):
 - 70-2009National Electrical Code (NEC)

PART 2 - PRODUCTS**2.1 MOTORS:**

- A. For alternating current, fractional and integral horsepower motors, NEMA Publications MG 1 and MG 2 shall apply.
- B. Voltage ratings shall be as follows:
 - 1. Single phase:
 - a. Motors connected to 120-volt systems: 115 volts.
 - b. Motors connected to 208-volt systems: 200 volts.
 - c. Motors connected to 240 volt or 480 volt systems: 230/460 volts, dual connection.
 - 2. Three phase:
 - a. Motors connected to 208-volt systems: 200 volts.
 - b. Motors, less than 74.6 kW (100 HP), connected to 240 volt or 480 volt systems: 230/460 volts, dual connection.
 - c. Motors, 74.6 kW (100 HP) or larger, connected to 240-volt systems: 230 volts.
 - d. Motors, 74.6 kW (100 HP) or larger, connected to 480-volt systems: 460 volts.
 - e. Motors connected to high voltage systems: Shall conform to NEMA Standards for connection to the nominal system voltage shown on the drawings.
- C. Number of phases shall be as follows:
 - 1. Motors, less than 373 W (1/2 HP): Single phase.
 - 2. Motors, 373 W (1/2 HP) and larger: 3 phase.
 - 3. Exceptions:
 - a. Hermetically sealed motors.

- b. Motors for equipment assemblies, less than 746 W (1 HP), may be single phase provided the manufacturer of the proposed assemblies cannot supply the assemblies with three phase motors.
- D. Horsepower ratings shall be adequate for operating the connected loads continuously in the prevailing ambient temperatures in areas where the motors are installed, without exceeding the NEMA standard temperature rises for the motor insulation.
- E. Motor designs, as indicated by the NEMA code letters, shall be coordinated with the connected loads to assure adequate starting and running torque.
- F. Motor Enclosures:
 - 1. Shall be the NEMA types shown on the drawings for the motors.
 - 2. Where the types of motor enclosures are not shown on the drawings, they shall be the NEMA types, which are most suitable for the environmental conditions where the motors are being installed.
 - 3. Enclosures shall be primed and finish coated at the factory with manufacturer's prime coat and standard finish.
 - 4. All motors in hazardous locations shall be approved for the application and meet the Class and Group as required by the area classification.
- G. Electrical Design Requirements
 - 1. Motors shall be continuous duty.
 - 2. The insulation system shall be rated minimum of class B, 130° C (266° F).
 - 3. The maximum temperature rise by resistance at rated power shall not exceed Class B limits, 80° C (176° F).
 - 4. The speed/torque and speed/current characteristics shall comply with NEMA Design A or B, as specified.
 - 5. Motors shall be suitable for full voltage starting, unless otherwise noted.
 - 6. Motors for variable frequency drive applications shall adhere to NEMA standards publication MG 1, Part 30, Application considerations for Constant Speed Motors Used on a Sinusoidal Bus with Harmonic Content and General Purpose Motors Used with Adjustable voltage or Adjustable frequency controls, or both, or Part 31, Definite Purpose Inverter Fed Polyphase Motors.
- H. Mechanical Design Requirements
 - 1. Bearings shall be rated for a minimum of 26,280 hours L-10 life at full load direct coupled, except vertical high thrust motors.

2. Vertical motors shall be capable of withstanding a momentary up thrust of at least 30% of normal down thrust.
3. Grease lubricated bearings shall be designed for electric motor use. Grease shall be capable of the temperatures associated with electric motors and shall be compatible with Polyurea based greases.
4. Grease fittings, if provided, shall be Alemite type or equivalent.
5. Oil lubricated bearings, when specified, shall have an externally visible sight glass to view oil level.
6. Vibration shall not exceed 0.15 inch per second, unfiltered peak.
7. Noise level shall meet the requirements of the application.
8. Motors on 180 frames and larger shall have provisions for lifting eyes or lugs capable of a safety factor of 5.
9. All external fasteners shall be corrosion resistant.
10. Condensation heaters, when specified, shall keep motor windings at least 5° C (41° F) above ambient temperature.
11. Winding thermostats, when specified shall be normally closed, connected in series.
12. Grounding provisions shall be in the main terminal box.
- I. Additional requirements for specific motors, as indicated in other sections, shall also apply.
- J. NEMA Premium Efficiency Electric Motors, Motor Efficiencies: All permanently wired polyphase motors of 746 Watts (1 Horsepower) or more shall meet the minimum full-load efficiencies as indicated in the following table, and as specified in this specification. Motors of 746 Watts (one horsepower) or more with open, drip-proof or totally enclosed fan-cooled enclosures shall be NEMA premium efficiency type, unless otherwise indicated. Motors provided as an integral part of motor driven equipment are excluded from this requirement if a minimum seasonal or overall efficiency requirement is indicated for that equipment by the provisions of another section.

Minimum Efficiencies Open Drip-Proof				Minimum Efficiencies Totally Enclosed Fan-Cooled			
Rating kW (HP)	1200 RPM	1800 RPM	3600 RPM	Rating kW (HP)	1200 RPM	1800 RPM	3600 RPM
0.746 (1)	82.5%	85.5%	77.0%	0.746 (1)	82.5%	85.5%	77.0%
1.12 (1.5)	86.5%	86.5%	84.0%	1.12 (1.5)	87.5%	86.5%	84.0%
1.49 (2)	87.5%	86.5%	85.5%	1.49 (2)	88.5%	86.5%	85.5%
2.24 (3)	88.5%	89.5%	85.5%	2.24 (3)	89.5%	89.5%	86.5%
3.73 (5)	89.5%	89.5%	86.5%	3.73 (5)	89.5%	89.5%	88.5%
5.60 (7.5)	90.2%	91.0%	88.5%	5.60 (7.5)	91.0%	91.7%	89.5%
7.46 (10)	91.7%	91.7%	89.5%	7.46 (10)	91.0%	91.7%	90.2%
11.2 (15)	91.7%	93.0%	90.2%	11.2 (15)	91.7%	92.4%	91.0%
14.9 (20)	92.4%	93.0%	91.0%	14.9 (20)	91.7%	93.0%	91.0%
18.7 (25)	93.0%	93.6%	91.7%	18.7 (25)	93.0%	93.6%	91.7%
22.4 (30)	93.6%	94.1%	91.7%	22.4 (30)	93.0%	93.6%	91.7%
29.8 (40)	94.1%	94.1%	92.4%	29.8 (40)	94.1%	94.1%	92.4%
37.3 (50)	94.1%	94.5%	93.0%	37.3 (50)	94.1%	94.5%	93.0%
44.8 (60)	94.5%	95.0%	93.6%	44.8 (60)	94.5%	95.0%	93.6%
56.9 (75)	94.5%	95.0%	93.6%	56.9 (75)	94.5%	95.4%	93.6%
74.6 (100)	95.0%	95.4%	93.6%	74.6 (100)	95.0%	95.4%	94.1%
93.3 (125)	95.0%	95.4%	94.1%	93.3 (125)	95.0%	95.4%	95.0%
112 (150)	95.4%	95.8%	94.1%	112 (150)	95.8%	95.8%	95.0%
149.2 (200)	95.4%	95.8%	95.0%	149.2 (200)	95.8%	96.2%	95.4%

- K. Minimum Power Factor at Full Load and Rated Voltage: 90 percent at 1200 RPM, 1800 RPM and 3600 RPM. Power factor correction capacitors shall be installed unless the motor is controlled by a variable frequency drive. The power factor correction capacitors shall be able to withstand high voltage transients and power line variations without breakdown.

PART 3 - EXECUTION

3.1 INSTALLATION:

- A. Install motors in accordance with manufacturer's recommendations, the NEC, NEMA, as shown on the drawings and/or as required by other sections of these specifications.

3.2 FIELD TESTS

- A. Megger all motors after installation, before start-up. All shall test free from grounds.

---END---

SECTION 22 05 23
GENERAL-DUTY VALVES FOR PLUMBING PIPING

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This section describes the requirements for general-duty valves for domestic water and sewer systems.

1.2 RELATED WORK

- A. Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.

1.3 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Manufacturer's Literature and Data:
 - 1. Valves.
 - 2. Backflow Preventers.
 - 3. Pressure Reducing Valves.
 - 4. All items listed in Part 2 - Products.

1.4 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American Society for Testing and Materials (ASTM): A536-84(R 2004) Standard Specification for Ductile Iron Castings
- C. American Society of Sanitary Engineering (ASSE)
 - ASSE 1003-01 (R 2003) Performance Requirements for Water Pressure Reducing Valves
 - ASSE 1012-02 Backflow Preventer with Intermediate Atmospheric Vent
 - ASSE 1013-05 Reduced Pressure Principle Backflow Preventers and Reduced Pressure Fire Protection Principle Backflow Preventers
- D. International Code Council (ICC)
 - IPC-2009 International Plumbing Code
- E. Manufacturers Standardization Society of the Valve and Fittings Industry, Inc. (MSS):
 - SP-25-98 Standard Marking System for Valves, Fittings, Flanges and Unions
 - SP-67-02a (R 2004) Butterfly Valve of the Single flange Type (Lug Wafer)

SP-70-06	Cast Iron Gate Valves, Flanged and Threaded Ends.
SP-72-99	Ball Valves With Flanged or Butt Welding For General Purpose
SP-80-03	Bronze Gate, Globe, Angle and Check Valves.
SP-110-96	Ball Valve Threaded, Socket Welding, Solder Joint, Grooved and Flared Ends

1.5 DELIVERY, STORAGE, AND HANDLING

- A. Valves shall be prepared for shipping as follows:
 - 1. Protect internal parts against rust and corrosion.
 - 2. Protect threads, flange faces, grooves, and weld ends.
 - 3. Set angle, gate, and globe valves closed to prevent rattling.
 - 4. Set ball and plug valves open to minimize exposure of functional surfaces
 - 5. Set butterfly valves closed or slightly open.
 - 6. Block check valves in either closed or open position.
- B. Valves shall be prepared for storage as follows:
 - 1. Maintain valve end protection.
 - 2. Store valves indoors and maintain at higher than ambient dew point temperature.
- C. A sling shall be used for large valves. The sling shall be rigged to avoid damage to exposed parts. Hand wheels or stems shall not be used as lifting or rigging points.

PART 2 - PRODUCTS

2.1 VALVES

- A. Asbestos packing and gaskets are prohibited.
- B. Bronze valves shall be made with dezincification resistant materials. Bronze valves made with copper alloy (brass) containing more than 15 percent zinc shall not be permitted.
- C. Valves in insulated piping shall have 50 mm or DN50 (2 inch) stem extensions and extended handles of non-thermal conductive material that allows operating the valve without breaking the vapor seal or disturbing the insulation. Memory stops shall be fully adjustable after insulation is applied.
- D. Exposed Valves over 65 mm or DN65 (2-1/2 inches) installed at an elevation over 3.6 meters (12 feet) shall have a chain-wheel attachment to valve hand-wheel, stem, or other actuator.
- E. Ball valves, pressure regulating valves, gate valves, globe valves, and plug valves used to supply potable water shall meet the requirements of NSF 61.
- F. Shut-off:
 - 1. Cold, Hot and Re-circulating Hot Water:

- a. 50 mm or DN50 (2 inches) and smaller: Ball, MSS SP-72, SP-110, Ball valve shall be full port three piece or two piece with a union design with adjustable stem package. Threaded stem designs are not allowed. The ball valve shall have a SWP rating of 1035 kPa (150 psig) and a CWP rating of 4140 kPa (600 psig). The body material shall be Bronze ASTM B584, Alloy C844. The ends shall be solder,
- b. Less than 100 mm DN100 (4 inches): Butterfly shall have an iron body with EPDM seal and aluminum bronze disc. The butterfly valve shall meet MSS SP-67, type I standard. The butterfly valve shall have a SWP rating of 1380 kPa (200 psig). The valve design shall be lug type suitable for bidirectional dead-end service at rated pressure. The body material shall meet ASTM A 536, ductile iron.
- c. 100 mm (DN100) (4 inches) and larger:
 - 1) Class 125, OS&Y, Cast Iron Gate Valve. The gate valve shall meet MSS-SP-70 type I standard. The gate valve shall have a CWP rating of 1380 kPa (200 psig). The valve materials shall meet ASTM A 126, grey iron with bolted bonnet, flanged ends, bronze trim, and solid wedge disc. The gate valve shall be gear operated for sizes under 200 mms or DN200 (8 inches) and crank operated for sizes 200 mms or DN200 (8 inches) and above
 - 2) Single flange, ductile iron butterfly valves: The single flanged butterfly valve shall meet the MSS SP-67 standard. The butterfly valve shall have a CWP rating of 1380 kPa (200 psig). The butterfly valve shall be lug type, suitable for bidirectional dead-end service at rated pressure without use of downstream flange. The body material shall comply with ASTM A536 ductile iron. The seat shall be EPDM with stainless steel disc and stem.
 - 3) Grooved end, ductile iron butterfly valves. The grooved butterfly valve shall meet the MSS SP-67 standard. The grooved butterfly valve shall have a CWP rating of 1380 kPa (200 psig). The valve materials shall be polyamide coated ductile iron conforming to ASTM A536 with two piece stainless steel stem, EPDM encapsulated ductile iron disc, and EPDM seal. The butterfly valve shall be gear operated

2. Reagent Grade Water: Valves for reagent grade, reverse osmosis, or deionized water service shall be ball type of same material as used for pipe.

G. Balancing:

1. Hot Water Re-circulating, 80 mm or DN80 (3 inches) and smaller manual balancing valve shall be of bronze body, brass ball construction with glass and carbon filled TFE seat rings and designed for positive shutoff. The manual balancing valve shall have differential pressure read-out ports across the valve seat area. The read out ports shall be fitting with internal EPT inserts and check valves. The valve body shall have 8 mm or DN8 NPT (1/4" NPT) tapped drain and purge port. The valves shall have memory stops that allow the valve to close for service and then reopened to set point without disturbing the balance position. All valves shall have calibrated nameplates to assure specific valve settings.
2. Larger than 80 mm or DN80 (3 inches): Manual balancing valves shall be of heavy duty cast iron flanged construction with 862 kPa (125 psi) flange connections. The flanged manual balancing valves shall have either a brass ball with glass and carbon filled TFE seal rings or fitted with a bronze seat, replaceable bronze disc with EPDM seal insert and stainless steel stem. The design pressure shall be 1207 kPa (175) at 121 deg C (250 deg F).

H. Check:

1. Check valves less than 80 mm or DN80 (3 inches) and smaller) shall be class 125, bronze swing check valves with non metallic Buna-N disc. The check valve shall meet MSS SP-80 Type 4 standard. The check valve shall have a CWP rating of 1380 kPa (200 psig). The check valve shall have a Y pattern horizontal body design with bronze body material conforming to ASTM B 62, solder joints, and PTFE or TFE disc.
2. Larger than 100 mm or DN100 (4 inches and larger):
 - a. Check valves shall be class 125, iron swing check valve with lever and weight closure control. The check valve shall meet MSS SP-71 Type I standard. The check valve shall have a CWP rating of 1380 kPa (200 psig). The check valve shall have a clear or full waterway body design with gray iron body material conforming to ASTM A 126, bolted bonnet, flanged ends, bronze trim.
 - b. All check valves on the discharge side of submersible sump pumps shall have factory installed exterior level and weight with sufficient weight to prevent the check valve from hammering against the seat when the sump pump stops.

I. Globe:

1. 80 mm or DN80 (3 inches) or smaller: Class 150, bronze globe valve with non metallic disc. The globe valve shall meet MSS SP-80, Type 2 standard. The globe valve shall have a CWP rating of 2070 kPa (300 psig). The valve material shall be bronze with integral seal and union ring bonnet conforming to ASTM B 62 with solder ends, copper-silicon bronze stem, TPFE or TFE disc, malleable iron hand wheel.
2. Larger than 80 mm or DN80 (3 inches): Similar to above, except with cast iron body and bronze trim, class 125, iron globe valve. The globe valve shall meet MSS SP-85, Type 1 standard. The globe valve shall have a CWP rating of 1380 kPa (200 psig). The valve material shall be gray iron with bolted bonnet conforming to ASTM A 126 with flanged ends, bronze trim, malleable iron handwheel.

2.2 WATER PRESSURE REDUCING VALVE AND CONNECTIONS

- A. 80 mm or DN80 (3 inches) or smaller: The pressure reducing valve shall consist of a bronze body and bell housing, a separate access cover for the plunger, and a bolt to adjust the downstream pressure. The bronze bell housing and access cap shall be threaded to the body and shall not require the use of ferrous screws. The assembly shall be of the balanced piston design and shall reduce pressure in both flow and no flow conditions. The assembly shall be accessible for maintenance without having to remove the body from the line.
- B. 100 mm or DN100 (4 inches) and larger: The pressure reducing valve shall consist of a flanged cast iron body and rated to 1378-kPa (200-psig). The valve shall have a large Hycar diaphragm for sensitive response.
- C. The regulator shall have a tap for pressure gauge.
- D. The regulator shall have a temperature rating of 100° C (210° F) for hot water or hot water return service. Pressure regulators shall have accurate pressure regulation to 6.9-kPa (+/- 1 psig).
- E. Setting: Entering water pressure, discharge pressure, capacity, size, and related measurements shall be as shown on the drawings.
- F. Connections Valves and Strainers: shut off valves shall be installed on each side of reducing valve and a bypass line equal in size to the regulator inlet pipe shall be installed with a normally closed globe valve. A strainer shall be installed on inlet side of, and same size as pressure reducing valve. A pressure gage shall be installed on the low pressure side of the line.

2.3 BACKFLOW PREVENTERS

- A. A backflow prevention assembly shall be installed at any point in the plumbing system where the potable water supply comes in contact with a potential source of contamination. The backflow prevention assembly shall be ASSE 1013 listed and certified.
- B. Reduced pressure backflow preventers shall be installed in the following applications.
 - 1. Water make up to heating systems, cooling tower, chilled water system, and similar equipment consuming water.
 - 2. Atmospheric Vacuum Breaker: ASSE 1001
 - a. Hose bibs and sinks w/threaded outlets.
 - b. Disposers.
 - c. Showers (telephone type).
 - d. Detergent system
- C. The reduced pressure principle backflow prevention assembly shall be ASSE listed 1013 with full port OS&Y gate valves and an integral relief monitor switch. The main body and access cover shall be epoxy coated ductile iron conforming to ASTM A536 grade 4. The seat ring and check valve shall be Noryl (NSF listed). The stem shall be stainless steel conforming to ASTM A276. The seat disc elastomer shall be EPDM. The checks and the relief valve shall be accessible for maintenance without removing the device from the line. An epoxy coated wye type strainer with flanged connections shall be installed on the inlet.
- D. The atmospheric vacuum breaker shall be ASSE listed 1001. The main body shall be either cast bronze. All internal polymers shall be NSF listed. The seat disc elastomer shall be silicone. The device shall be accessible for maintenance without removing the device from the service line. The installation shall not be in a concealed or inaccessible location or where the venting of water from the device during normal operation is deemed objectionable.
- E. The double check detector backflow prevention assembly shall be ASSE listed 1048 and supply with full port OS&Y gate valves. The main body and access cover shall be epoxy coated ductile iron conforming to ASTM A536 grade. The seat ring and check valve shall be Noryl (NSF listed). The stem shall be stainless steel conforming to ASTM A 276. The seat disc elastomers shall be EPDM. The first and second check valve shall be accessible for maintenance without removing the device from the line.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Valve interior shall be examined for cleanliness, freedom from foreign matter, and corrosion. Special packing materials shall be removed, such as blocks, used to prevent disc movement during shipping and handling.
- B. Valves shall be operated in positions from fully open to fully closed. Guides and seats shall be examined and made accessible by such operations.
- C. Threads on valve and mating pipe shall be examined for form and cleanliness.
- D. Mating flange faces shall be examined for conditions that might cause leakage. Bolting shall be checked for proper size, length, and material. Gaskets shall be verified for proper size and that its material composition is suitable for service and free from defects and damage.
- E. Do not attempt to repair defective valves; replace with new valves.

3.2 VALVE INSTALLATION

- A. Install valves with unions or flanges at each piece of equipment arranged to allow service, maintenance, and equipment removal without system shutdown.
- B. Valves shall be located for easy access and shall be provide with separate support. Valves shall be accessible with access doors when installed inside partitions or above hard ceilings.
- C. Valves shall be installed in horizontal piping with stem at or above center of pipe
- D. Valves shall be installed in a position to allow full stem movement.
- E. Install chain wheels on operators for [ball] [butterfly] [gate] and [globe] valves NPS 100 mm or DN100 (4 inches) and larger and more than [2400 mm (12 feet) above floor. Chains shall be extended to 1500 mm (60 inches) above finished floor.
- F. Check valves shall be installed for proper direction of flow and as follows:
 - 1. Swing Check Valves: In horizontal position with hinge pin level.

3.3 ADJUSTING

- A. Valve packing shall be adjusted or replaced after piping systems have been tested and put into service but before final adjusting and balancing. Replace valves shall be replaced if persistent leaking occurs.

--- E N D ---

SECTION 22 11 00 FACILITY WATER DISTRIBUTION

PART 1 - GENERAL

1.1 DESCRIPTION

- A. Domestic water systems, including piping, equipment and all necessary accessories as designated in this section.

1.2 RELATED WORK

- A. Penetrations in rated enclosures: Section 07 84 00, FIRESTOPPING.
- B. Preparation and finish painting and identification of piping systems: Section 09 91 00, PAINTING.
- C. Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.
- D. Pipe Insulation: Section 23 07 11, HVAC, PLUMBING, AND BOILER PLANT INSULATION.

1.3 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturer's Literature and Data:
 - 1. Piping.
 - 2. Strainers.
 - 3. All items listed in Part 2 - Products.

1.4 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. Federal Specifications (Fed. Spec.):
 - A-A-1427CSodium Hypochlorite Solution
 - A-A-59617Unions, Brass or Bronze Threaded, Pipe Connections and Solder-Joint Tube Connections
- C. American National Standards Institute (ANSI):
- D. American Society of Mechanical Engineers (ASME): (Copyrighted Society)
 - A13.1-96Scheme for Identification of Piping Systems
 - B16.3-98Malleable Iron Threaded Fittings ANSI/ASME
 - B16.4-98Cast Iron Threaded Fittings Classes 125 and 250 ANSI/ASME
 - B16.9-01Factory-Made Wrought Steel Buttwelding Fittings ANSI/ASME

- B16.11-01Forged Steel Fittings, Socket-Welding and Threaded
ANSI/ASME
- B16.12-98Cast Iron Threaded Drainage Fittings ANSI/ASME
- B16.15-85(R 1994)Cast Bronze Threaded Fittings ANSI/ASME
- B16.18-01Cast Copper Alloy Solder-Joint Pressure Fittings ANSI/ASME
- B16.22-01Wrought Copper and Copper Alloy Solder Joint Pressure
Fittings ANSI/ASME
Element ANSI/ASME

E. American Society for Testing and Materials (ASTM):

- A47-99Ferritic Malleable Iron Castings Revision 1989
- A53-02Pipe, Steel, Black And Hot-Dipped, Zinc-coated Welded and
Seamless
- A74-03Cast Iron Soil Pipe and Fittings
- A183-83(R1998).....Carbon Steel Track Bolts and Nuts
- A312-03Seamless and Welded Austenitic Stainless Steel Pipe
- A536-84(R1999) E1Ductile Iron Castings
- A733-03Welded and Seamless Carbon Steel and Austenitic Stainless
Steel Pipe Nipples
- B32-03Solder Metal
- B61-02Steam or Bronze Castings
- B62-02Composition Bronze or Ounce Metal Castings
- B75-99(Rev A)Seamless Copper Tube
- B88-03Seamless Copper Water Tube
- B584-00Copper Alloy Sand Castings for General Applications Revision
A
- B687-99Brass, Copper, and Chromium-Plated Pipe Nipples
- C564-03Rubber Gaskets for Cast Iron Soil Pipe and Fittings
- D2000-01Rubber Products in Automotive Applications
- D4101-03b Propylene Plastic Injection and Extrusion Materials
- D2447-93Polyethylene (PE) Plastic Pipe, Schedule 40 and 80, Based on
Outside Diameter
- D2564-94Solvent Cements for Poly (Vinyl Chloride) (PVC) Plastic Pipe
and Fittings

- D2665-94 Revision A...Poly (Vinyl Chloride) (PVC) Plastic Drain, Waste, and Vent
Pipe and Fittings
- D4101-03bPropylene Plastic Injection and Extrusion Materials
- E1120Standard Specification For Liquid Chlorine
- E1229Standard Specification For Calcium Hypochlorite
- F. American Water Works Association (AWWA):
- C110-03/ A21.10-03Ductile Iron and Gray Iron Fittings - 75 mm thru 1200 mm (3
inch thru 48 inches) for Water and other liquids AWWA/ ANSI
- C151-00/ A21.51-02Ductile-Iron Pipe, Centrifugally Cast in Metal Molds or Sand-
Lined Molds, for Water or Other Liquids AWWA/ ANSI
- C203-02Coal-Tar Protective Coatings and Linings for Steel Water
Pipelines - Enamel and Tape - Hot Applied AWWA/ ANSI
- C651-99Disinfecting Water Mains
- G. American Welding Society (AWS):
- A5.8-92Filler Metals for Brazing
- H. National Association of Plumbing - Heating - Cooling Contractors (PHCC):
- National Standard Plumbing Code - 1996
- I. International Association of Plumbing and Mechanical Officials (IAPMO):
- International Plumbing Code - 2009
- IS6-93.....Installation Standard
- J. Manufacturers Standardization Society of the Valve and Fittings Industry, Inc. (MSS):
- SP-72-99Ball Valves With Flanged or Butt Welding For General Purpose
- SP-110-96Ball Valve Threaded, Socket Welding, Solder Joint, Grooved
and Flared Ends
- K. American Society of Sanitary Engineers (ASSE):
- 1001-02Pipe Applied Atmospheric Type Vacuum Breakers
- 1018-01Performance for trap seal primer valve-water supply fed
- 1020-04Vacuum Breakers, Anti-Siphon, Pressure Type
- L. Plumbing and Drainage Institute (PDI):
- PDI WH-201Water Hammer Arrestor

PART 2 - PRODUCTS

2.1 INTERIOR DOMESTIC WATER PIPING

- A. Pipe: Copper tube, ASTM B88, Type K or L, drawn. For pipe 150 mm (6 inches) and larger, stainless, steel ASTM A312, schedule 10 may be used.
- B. Fittings for Copper Tube:
 - 1. Wrought copper or bronze castings conforming to ANSI B16.18 and B16.22. Unions shall be bronze, MSS SP72 & SP 110, Solder or braze joints.
 - 2. Grooved fittings, 50 to 150 mm (2 to 6 inch) wrought copper ASTM B75 C12200, 125 to 150 mm (5 to 6 inch) bronze casting ASTM B584, CDA 844. Mechanical grooved couplings, ductile iron, ASTM A536 (Grade 65-45-12), or malleable iron, ASTM A47 (Grade 32510) housing, with EPDM gasket, steel track head bolts, ASTM A183, coated with copper colored alkyd enamel.
 - 3. Mechanically formed tee connection: Form mechanically extracted collars in a continuous operation by drilling pilot hole and drawing out tube surface to form collar, having a height of not less than three times the thickness of tube wall. Adjustable collaring device shall insure proper tolerance and complete uniformity of the joint. Notch and dimple joining branch tube in a single process to provide free flow where the branch tube penetrates the fitting. Braze joints.
- C. Fittings for Stainless Steel:
 - 1. Stainless steel butt-welded fittings, Type 316, Schedule 10, conforming to ANSI B16.9.
 - 2. Grooved fittings, stainless steel, Type 316, Schedule 10, conforming to ASTM A403. Segmentally fabricated fittings are not allowed. Mechanical grooved couplings, ductile iron, ASTM A536 (Grade 65-45-12), or Malleable iron, ASTM A47 (Grade 32510) housing, with EPDM gasket, steel track head bolts, ASTM A183, coated with copper colored alkyd enamel.
- D. Adapters: Provide adapters for joining screwed pipe to copper tubing.
- E. Solder: ASTM B32 Composition Sb5 HA or HB. Provide non-corrosive flux.
- F. Brazing alloy: AWS A5.8, Classification BCuP.

2.2 EXPOSED WATER PIPING

- A. Finished Room: Use full iron pipe size chrome plated brass piping for exposed water piping connecting fixtures, casework, cabinets, equipment and reagent racks when not concealed by apron including those furnished by the Government or specified in other sections.
 - 1. Pipe: Fed. Spec. WW-P-351, standard weight.

2. Fittings: ANSI B16.15 cast bronze threaded fittings with chrome finish, (125 and 250).
 3. Nipples: ASTM B 687, Chromium-plated.
 4. Unions: Mss SP-72, SP-110, Brass or Bronze with chrome finish. Unions 65 mm (2-1/2 inches) and larger shall be flange type with approved gaskets.
- B. Unfinished Rooms, Mechanical Rooms and Kitchens: Chrome-plated brass piping is not required. Paint piping systems as specified in Section 09 91 00, PAINTING.

2.3 WATERPROOFING

- A. Provide at points where pipes pass through membrane waterproofed floors or walls in contact with earth.
- B. Floors: Provide cast iron stack sleeve with flashing device and a underdeck clamp. After stack is passed through sleeve, provide a waterproofed caulked joint at top hub.
- C. Walls: See detail shown on drawings.

2.4 STRAINERS

- A. Provide on high pressure side of pressure reducing valves, on suction side of pumps, on inlet side of indicating and control instruments and equipment subject to sediment damage and where shown on drawings. Strainer element shall be removable without disconnection of piping.
- B. Water: Basket or "Y" type with easily removable cover and brass strainer basket.
- C. Body: Smaller than 80 mm (3 inches), brass or bronze; 80 mm (3 inches) and larger, cast iron or semi-steel.

2.5 DIELECTRIC FITTINGS

- A. Provide dielectric couplings or unions between ferrous and non-ferrous pipe.

2.6 WATER HAMMER ARRESTER:

- A. Closed copper tube chamber with permanently sealed 410 kPa (60 psig) air charge above a Double O-ring piston. Two high heat Buna-N O-rings pressure packed and lubricated with FDA approved Dow Corning No. 11 silicone compound. All units shall be designed in accordance with ASSE 1010 for sealed wall installations without an access panel. Size and install in accordance with Plumbing and Drainage Institute requirements (PDI WH 201). Unit shall be as manufactured by Precision Plumbing Products Inc., Watts or Sioux Chief. Provide water hammer arrestors at all solenoid valves, at all groups of two or more flush valves, at all quick opening or closing valves, and at all medical washing equipment.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. General: Comply with the PHCC National Standard Plumbing Code and the following:
 - 1. Install branch piping for water from the piping system and connect to all fixtures, valves, cocks, outlets, casework, cabinets and equipment, including those furnished by the Government or specified in other sections.
 - 2. Pipe shall be round and straight. Cutting shall be done with proper tools. Pipe, except for plastic and glass, shall be reamed to full size after cutting.
 - 3. All pipe runs shall be laid out to avoid interference with other work.
 - 4. Install union and shut-off valve on pressure piping at connections to equipment.
 - 5. Pipe Hangers, Supports and Accessories:
 - a. All piping shall be supported per of the National Standard Plumbing Code, Chapter No. 8.
 - b. Shop Painting and Plating: Hangers, supports, rods, inserts and accessories used for Pipe supports shall be shop coated with red lead or zinc Chromate primer paint. Electroplated copper hanger rods, hangers and accessories may be used with copper tubing.
 - c. Floor, Wall and Ceiling Plates, Supports, Hangers:
 - 1) Solid or split unplated cast iron.
 - 2) All plates shall be provided with set screws.
 - 3) Pipe Hangers: Height adjustable clevis type.
 - 4) Adjustable Floor Rests and Base Flanges: Steel.
 - 5) Concrete Inserts: "Universal" or continuous slotted type.
 - 6) Hanger Rods: Mild, low carbon steel, fully threaded or Threaded at each end with two removable nuts at each end for positioning rod and hanger and locking each in place.
 - 7) Riser Clamps: Malleable iron or steel.
 - 8) Rollers: Cast iron.
 - 9) Self-drilling type expansion shields shall be "Phillips" type, with case hardened steel expander plugs.
 - 10) Hangers and supports utilized with insulated pipe and tubing shall have 180 degree (min.) metal protection shield Centered on and welded to the hanger and support. The shield shall be 4 inches in length and be 16 gauge steel. The shield shall be sized for the insulation.

- 11) Miscellaneous Materials: As specified, required, directed or as noted on the drawings for proper installation of hangers, supports and accessories. If the vertical distance exceeds 6 m (20 feet) for cast iron pipe additional support shall be provided in the center of that span. Provide all necessary auxiliary steel to provide that support.
- 6. Install cast escutcheon with set screw at each wall, floor and ceiling penetration in exposed finished locations and within cabinets and millwork.
- 7. Penetrations:
 - a. Fire Stopping: Where pipes pass through fire partitions, fire walls, smoke partitions, or floors, install a fire stop that provides an effective barrier against the spread of fire, smoke and gases as specified in Section 07 84 00, FIRESTOPPING. Completely fill and seal clearances between raceways and openings with the fire stopping materials.
 - b. Waterproofing: At floor penetrations, completely seal clearances around the pipe and make watertight with sealant as specified in Section 07 92 00, JOINT SEALANTS.
- B. Piping shall conform to the following:
 - 1. Domestic Water:
 - a. Where possible, grade all lines to facilitate drainage. Provide drain valves at bottom of risers. All unnecessary traps in circulating lines shall be avoided.
 - b. Connect branch lines at bottom of main serving fixtures below and pitch down so that main may be drained through fixture. Connect branch lines to top of main serving only fixtures located on floor above.

3.2 TESTS

- A. General: Test system either in its entirety or in sections.
- B. Potable Water System: Test after installation of piping and domestic water heaters, but before piping is concealed, before covering is applied, and before plumbing fixtures are connected. Fill systems with water and maintain hydrostatic pressure of 690 kPa (100 psi) gage for two hours. No decrease in pressure is allowed. Provide a pressure gage with a shutoff and bleeder valve at the highest point of the piping being tested.
- C. All Other Piping Tests: Test new installed piping under 1 1/2 times actual operating conditions and prove tight.

3.3 STERILIZATION

- A. After tests have been successfully completed, thoroughly flush the interior domestic water distribution system.

--- E N D ---

SECTION 22 13 00
FACILITY SANITARY AND VENT PIPING

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This section pertains to sanitary sewer and vent systems, including piping, equipment and all necessary accessories as designated in this section.

1.2 RELATED WORK

- A. Section 07 84 00, FIRESTOPPING: Penetrations in rated enclosures.
- B. Section 09 91 00, PAINTING: Preparation and finish painting and identification of piping systems.
- C. Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING: Pipe Hangers and Supports, Materials Identification.
- D. Section 23 07 11, HVAC, PLUMBING, AND BOILER PLANT INSULATION: Pipe Insulation.
- E. Section 07 92 00 JOINT SEALANTS: Sealant products.

1.3 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Manufacturer's Literature and Data:
 - 1. Piping.
 - 2. Floor Drains.
 - 3. Sand Trap.
 - 4. Cleanouts.
 - 5. All items listed in Part 2 - Products.
- C. Detailed shop drawing of clamping device and extensions when required in connection with the waterproofing membrane or the floor drain.

1.4 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American Society of Mechanical Engineers (ASME): (Copyrighted Society)
 - A112.6.3-01 (R 2007)...Standard for Floor and Trench Drains
 - A13.1-07Scheme for Identification of Piping Systems
 - B16.3-06Malleable Iron Threaded Fittings, Classes 150 and 300.

- B16.4-06Standard for Grey Iron Threaded Fittings Classes 125 and 250
- B16.12-98 (R 2006)Cast Iron Threaded Drainage Fittings
- B16.15-06Cast Bronze Threaded Fittings, Classes 125 and 250
- C. American Society for Testing and Materials (ASTM):
- A47/A47M-99 (R 2004)Standard Specification for Steel Sheet, Aluminum Coated, by
the Hot Dip Process
- A53/A53M-07.....Standard Specification for Pipe, Steel, Black And Hot-Dipped,
Zinc-coated, Welded and Seamless
- A74-06Standard Specification for Cast Iron Soil Pipe and Fittings
- A183-03Standard Specification for Carbon Steel Track Bolts and Nuts
- A536-84(R 2004).....Standard Specification for Ductile Iron Castings
- B32-08Standard Specification for Solder Metal
- B75-02Standard Specification for Seamless Copper Tube
- B306-02*Standard Specification for Copper Drainage Tube (DWV)*
- B584-06a.....Standard Specification for Copper Alloy Sand Castings for
General Applications
- C564-03a.....Standard Specification for Rubber Gaskets for Cast Iron Soil
Pipe and Fittings
- D2000-08Standard Classification System for Rubber Products in
Automotive Applications
- D2564-04E1Standard Specification for Solvent Cements for Poly (Vinyl
Chloride) (PVC) Plastic Pipe and Fittings
- D2665-08*Standard Specification for Poly (Vinyl Chloride) (PVC) Plastic
Drain, Waste, and Vent Pipe and Fittings*
- D. International Code Council:
- IPC-2009International Plumbing Code
- E. Cast Iron Soil Pipe Institute (CISPI):
- 301-05Hubless Cast Iron Soil Pipe and Fittings for Sanitary and Storm
Drain, Waste, and Vent Piping Applications
- 310-04Coupling for Use in Connection with Hubless Cast Iron Soil
Pipe and Fittings for Sanitary and Storm Drain, Waste, and Vent
Piping Applications
- F. American Society of Sanitary Engineers (ASSE):

1018-01 Trap Seal Primer Valves – Potable, Water Supplied

G. Plumbing and Drainage Institute (PDI):

PDI WH-201 Water Hammer Arrestor

PART 2 - PRODUCTS

2.1 SANITARY WASTE, DRAIN, AND VENT PIPING

A. Cast iron waste, drain, and vent pipe and fittings

1. Cast iron waste, drain, and vent pipe and fittings shall be used for the following applications:
 - a. pipe buried in or in contact with earth
 - b. sanitary pipe extensions to a distance of approximately 1500 mm (5 feet) outside of the building.
 - c. interior waste and vent piping above grade.
2. Cast iron Pipe shall be bell and spigot or hubless (plain end or no-hub or hubless).
3. The material for all pipe and fittings shall be cast iron soil pipe and fittings and shall conform to the requirements of CISPI Standard 301, ASTM A-888, or ASTM A-74.
4. Joints for hubless pipe and fittings shall conform to the manufacturer's installation instructions. Couplings for hubless joints shall conform to CISPI 310. Joints for hub and spigot pipe shall be installed with compression gaskets conforming to the requirements of ASTM Standard C-564 or be installed with lead and oakum.

B. Copper Tube, (DWV):

1. Copper DWV tube sanitary waste, drain and vent pipe may be used for piping above ground, except for urinal drains.
2. The copper DWV tube shall be drainage type, drawn temper conforming to ASTM B306.
3. The copper drainage fittings shall be cast copper or wrought copper conforming to ASME B16.23 or ASME 16.29.
4. The joints shall be lead free, using a water flushable flux, and conforming to ASTM B32.

C. Polyvinyl Chloride (PVC)

1. Polyvinyl chloride (PVC) pipe and fittings are permitted where the waste temperature is below 60°C (140°F).
2. PVC piping and fittings shall NOT be used for the following applications:
 - a. Waste collected from steam condensate drains

- b. spaces such as mechanical equipment rooms, kitchens, SPD, and sterilizer areas.
 - c. Vertical waste and soil stacks serving more than two floors
 - d. Exposed in mechanical equipment rooms.
 - e. Exposed inside of ceiling return plenums
3. Polyvinyl chloride sanitary waste, drain, and vent pipe and fittings shall be schedule 40 solid core sewer piping conforming to ASTM D 1785 and ASTM D2665, sewer and drain series with ends for solvent cemented joints.
 4. Fittings:
 - a. PVC fittings shall be solvent welded socket type using solvent cement conforming to ASTM D2564.

2.2 EXPOSED WASTE PIPING

- A. Full iron pipe size chrome plated brass piping shall be used in finished rooms for exposed waste piping connecting fixtures, casework, cabinets, equipment and reagent racks when not concealed by apron including those furnished by the Government or specified in other sections.
 1. The Pipe shall meet Fed. Spec. WW-P-351, standard weight.
 2. The Fittings shall conform to ANSI B16.15, cast bronze threaded fittings with chrome finish, (125 and 250).
 3. Nipples shall conform to ASTM B 687, Chromium-plated.
 4. Unions shall be brass or bronze with chrome finish. Unions 65 mm (2-1/2 inches) and larger shall be flange type with approved gaskets.
- B. In unfinished Rooms such as mechanical Rooms and Kitchens, Chrome-plated brass piping is not required. The pipe materials specified under the paragraph "Sanitary Waste, Drain, and Vent Piping" can be used. The sanitary pipe in unfinished rooms shall be painted as specified in Section 09 91 00, PAINTING.

2.3 SPECIALTY PIPE FITTINGS

- A. Transition pipe couplings shall join piping with small differences in outside diameters or different materials. End connections shall be of the same size and compatible with the pipes being joined. The transition coupling shall be elastomeric, sleeve type reducing or transition pattern and include shear and corrosion resistant metal, tension band and tightening mechanism on each end. The transition coupling sleeve coupling shall be of the following material:
 1. For cast iron soil pipes, the sleeve material shall be rubber conforming to ASTM C564.

2. For PVC soil pipes, the sleeve material shall be elastomeric seal or PVC, conforming to ASTM F 477 or ASTM D5926.
 3. For dissimilar pipes, the sleeve material shall be PVC conforming to ASTM D5926, or other material compatible with the pipe materials being joined.
- B. The dielectric fittings shall conform to ASSE 1079 with a pressure rating of 860 kPa (125 psig) at a minimum temperature of 82°C (180°F). The end connection shall be solder joint copper alloy and threaded ferrous.
 - C. Dielectric flange insulating kits shall be of non conducting materials for field assembly of companion flanges with a pressure rating of 1035 kPa (150 psig). The gasket shall be neoprene or phenolic. The bolt sleeves shall be phenolic or polyethylene. The washers shall be phenolic with steel backing washers.
 - D. The di-electric nipples shall be electroplated steel nipple complying with ASTM F 1545 with a pressure ratings of 2070 kPa (300 psig) at 107°C (225°F). The end connection shall be male threaded. The lining shall be inert and noncorrosive propylene.

2.4 CLEANOUTS

- A. Cleanouts shall be the same size as the pipe, up to 100 mm (4 inches); and not less than 100 mm (4 inches) for larger pipe. Cleanouts shall be easily accessible and shall be gastight and watertight. Minimum clearance of 600 mm (24 inches) shall be provided for clearing a clogged sanitary line.
- B. Floor cleanouts shall be gray iron housing with clamping device and round, secured, scoriated, gray iron cover conforming to ASME A112.36.2M. A gray iron ferrule with hubless, socket, inside calk or spigot connection and counter sunk, taper-thread, brass or bronze closure plug shall be included. The frame and cover material and finish shall be nickel-bronze copper alloy with a square shape. The cleanout shall be vertically adjustable for a minimum of 50 mm (2 inches). When a waterproof membrane is used in the floor system, clamping collars shall be provided on the cleanouts. Cleanouts shall consist of wye fittings and eighth bends with brass or bronze screw plugs. Cleanouts in the resilient tile floors, quarry tile and ceramic tile floors shall be provided with square top covers recessed for tile insertion. In the carpeted areas, carpet cleanout markers shall be provided. Two way cleanouts shall be provided where indicated on drawings and at every building exit. The loading classification for cleanouts in sidewalk areas or subject to vehicular traffic shall be heavy duty type.

- C. Cleanouts shall be provided at or near the base of the vertical stacks with the cleanout plug located approximately 600 mm (24 inches) above the floor. If there are no fixtures installed on the lowest floor, the cleanout shall be installed at the base of the stack. The cleanouts shall be extended to the wall access cover. Cleanout shall consist of sanitary tees. Nickel-bronze square frame and stainless steel cover with minimum opening of 150 by 150 mm (6 by 6 inches) shall be furnished at each wall cleanout. Where the piping is concealed, a fixture trap or a fixture with integral trap, readily removable without disturbing concealed pipe, shall be accepted as a cleanout equivalent providing the opening to be used as a cleanout opening is the size required.
- D. In horizontal runs above grade, cleanouts shall consist of cast brass tapered screw plug in fitting or caulked/hubless cast iron ferrule. Plain end (hubless) piping in interstitial space or above ceiling may use plain end (hubless) blind plug and clamp.

2.5 FLOOR DRAINS

- A. See Drain Schedule on Drawings.
- B. Acid resistant floor drain shall comply with ANSI A112.6.3. The type I floor drain shall have a cast iron body, wide flange for seamless floor, double drainage pattern, with all interior surfaces and exposed exterior surfaces provided with acid resistant enamel finish. Floor drain shall have a clamping device, secured nickel bronze rim, aluminum enameled finish sediment basket with, perforations with not less than 19 300 square mm (30 square inches) of free area. The sediment basket shall be approximately 100 mm (4 inches) deep, and be provided with grips for easy handling. The floor drain shall be provided with a loose-set, nickel bronze grate approximately 300 mm (12 inches) square and of sufficient strength to support pedestrian traffic. Ample space between body of drain and sediment basket shall be provided for free flow of waste liquids.

2.6 TRAPS

- A. Traps shall be provided on all sanitary branch waste connections from fixtures or equipment not provided with traps. Exposed brass shall be polished brass chromium plated with nipple and set screw escutcheons. Concealed traps may be rough cast brass or same material as pipe connected to. Slip joints are not permitted on sewer side of trap. Traps shall correspond to fittings on cast iron soil pipe or steel pipe respectively, and size shall be as required by connected service or fixture.

2.7 WATERPROOFING

- B. A sleeve flashing device shall be provided at points where pipes pass through membrane waterproofed floors or walls. The sleeve flashing device shall be manufactured, cast iron fitting with clamping device that forms a sleeve for the pipe floor penetration of the floor membrane. A galvanized steel pipe extension shall be included in the top of the fitting that will extend 50 mm (2 inches) above finished floor and galvanized steel pipe extension in the bottom of the fitting that will extend through the floor slab. A waterproof caulked joint shall be provided at the top hub.
- C. Walls: See detail shown on drawings.

PART 3 - EXECUTION

3.1 PIPE INSTALLATION

- A. The pipe installation shall comply with the requirements of the International Plumbing Code (IPC) and these specifications.
- B. Branch piping shall be installed for waste from the respective piping systems and connect to all fixtures, valves, cocks, outlets, casework, cabinets and equipment, including those furnished by the Government or specified in other sections.
- C. Pipe shall be round and straight. Cutting shall be done with proper tools. Pipe shall be reamed to full size after cutting.
- D. All pipe runs shall be laid out to avoid interference with other work.
- E. The piping shall be installed above accessible ceilings where possible.
- F. The piping shall be installed to permit valve servicing or operation.
- G. Unless specifically indicated on the drawings, the minimum slope shall be 2% slope.
- H. The piping shall be installed free of sags and bends.
- I. Changes in direction for soil and waste drainage and vent piping shall be made using appropriate branches, bends and long sweep bends. Sanitary tees and short sweep quarter bends may be used on vertical stacks if change in direction of flow is from horizontal to vertical. Long turn double wye branch and eighth bend fittings shall be used if two fixtures are installed back to back or side by side with common drain pipe. Straight tees, elbows, and crosses may be used on vent lines. Do not change direction of flow more than 90 degrees. Proper size of standard increaser and reducers shall be used if pipes of different sizes are connected. Reducing size of drainage piping in direction of flow is prohibited.

- J. Buried soil and waste drainage and vent piping shall be laid beginning at the low point of each system. Piping shall be installed true to grades and alignment indicated with unbroken continuity of invert. Hub ends shall be placed upstream. Required gaskets shall be installed according to manufacturer's written instruction for use of lubricants, cements, and other installation requirements.
- K. Cast iron piping shall be installed according to CISPI's "Cast Iron Soil Pipe and Fittings Handbook," Chapter IV, "Installation of Cast Iron Soil Pipe and Fittings"
- L. Aboveground copper tubing shall be installed according to CDA's "Copper Tube Handbook".
- M. Aboveground PVC piping shall be installed according to ASTM D2665. Underground PVC piping shall be installed according to ASTM D2321.

3.2 JOINT CONSTRUCTION

- A. Hub and spigot, cast iron piping with gasket joints shall be joined in accordance with CISPI's "Cast Iron Soil Pipe and Fittings Handbook" for compression joints.
- B. Hub and spigot, cast iron piping with calked joints shall be joined in accordance with CISPI's "Cast Iron Soil Pipe and Fittings Handbook" for lead and oakum calked joints.
- C. Hubless or No-hub, cast iron piping shall be joined in accordance with CISPI's "Cast Iron Soil Pipe and Fittings Handbook" for hubless piping coupling joints.
- D. For threaded joints, thread pipe with tapered pipe threads according to ASME B1.20.1. The threads shall be cut full and clean using sharp disc cutters. Threaded pipe ends shall be reamed to remove burrs and restored to full pipe inside diameter. Pipe fittings and valves shall be joined as follows:
 - 1. Apply appropriate tape or thread compound to external pipe threads unless dry seal threading is required by the pipe service
 - 2. Pipe sections with damaged threads shall be replaced with new sections of pipe.
- E. Copper tube and fittings with soldered joints shall be joined according to ASTM B828. A water flushable, lead free flux conforming to ASTM B813 and a lead free alloy solder conforming to ASTM B32 shall be used.
- F. For PVC piping, solvent cement joints shall be used for joints. All surfaces shall be cleaned and dry prior to applying the primer and solvent cement. Installation practices shall comply with ASTM F402. The joint shall conform to ASTM D2855 and ASTM D2665 appendixes.

3.3 SPECIALTY PIPE FITTINGS

- A. Transition coupling shall be installed at pipe joints with small differences in pipe outside diameters.
- B. Dielectric fittings shall be installed at connections of dissimilar metal piping and tubing.

3.4 PIPE HANGERS, SUPPORTS AND ACCESSORIES:

- A. All piping shall be supported according to the International Plumbing Code (IPC), Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING, and these specifications. Where conflicts arise between these the code and Section 22 05 11, the most restrictive or the requirement that specifies supports with highest loading or shortest spacing shall apply.
- B. Hangers, supports, rods, inserts and accessories used for pipe supports shall be shop coated with zinc chromate primer paint. Electroplated copper hanger rods, hangers and accessories may be used with copper tubing.
- C. Horizontal piping and tubing shall be supported within 300 mm (12 inches) of each fitting or coupling.
- D. Horizontal cast iron piping shall be supported with the following maximum horizontal spacing and minimum hanger rod diameters:
 - 1. 40 mm or DN40 to 50 mm or DN50 (NPS 1-1/2 inch to NPS 2 inch): 1500 mm (60 inches) with 10 mm (3/8 inch) rod.
 - 2. 80 mm or DN 80 (NPS 3 inch): 1500 mm (60 inches) with 13 mm (1/2 inch) rod.
 - 3. 100 mm or DN100 to 125 mm or DN125 (NPS 4 to NPS 5): 1500 mm (60 inches) with 16 mm (5/8 inch) rod.
 - 4. 150 mm or DN150 to 200 mm or DN200 (NPS 6 inch to NPS 8 inch): 1500 mm (60 inches) with 19 mm (3/4 inch) rod.
 - 5. 250 mm or DN250 to 300 mm or DN 300 (NPS 10 inch to NPS 12 inch): 1500 mm (60 inch) with 22 mm (7/8 inch) rod.
- E. The maximum spacing for plastic pipe shall be 1.22 m (4 feet).
- F. Vertical piping and tubing shall be supported at the base, at each floor, and at intervals no greater than 4.57 m (15 feet).
- G. In addition to the requirements in Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING, floor, Wall and Ceiling Plates, Supports, Hangers shall have the following characteristics:
 - 1. Solid or split unplated cast iron.
 - 2. All plates shall be provided with set screws.

3. Height adjustable clevis type pipe hangers.
 4. Adjustable floor rests and base flanges shall be steel.
 5. Hanger rods shall be low carbon steel, fully threaded or threaded at each end with two removable nuts at each end for positioning rod and hanger and locking each in place.
 6. Riser clamps shall be malleable iron or steel.
 7. Rollers shall be cast iron.
 8. See Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING, for requirements on insulated pipe protective shields at hanger supports.
- H. Miscellaneous materials shall be provided as specified, required, directed or as noted on the drawings for proper installation of hangers, supports and accessories. If the vertical distance exceeds 6 m (20 feet) for cast iron pipe additional support shall be provided in the center of that span. All necessary auxiliary steel shall be provided to provide that support.
- I. Cast escutcheon with set screw shall be provided at each wall, floor and ceiling penetration in exposed finished locations and within cabinets and millwork.
- J. Penetrations:
1. Fire Stopping: Where pipes pass through fire partitions, fire walls, smoke partitions, or floors, a fire stop shall be installed that provides an effective barrier against the spread of fire, smoke and gases as specified in Section 07 84 00, FIRESTOPPING. Clearances between raceways and openings shall be completely filled and sealed with the fire stopping materials.
 2. Water proofing: At floor penetrations, clearances shall be completely sealed around the pipe and make watertight with sealant as specified in Section 07 92 00, JOINT SEALANTS.
- K. Piping shall conform to the following:
1. Waste and Vent Drain to main stacks:
- | Pipe Size | Minimum Pitch |
|--|---------------|
| 80 mm or DN 80 (3 inches) and smaller | 2% |
| 100 mm or DN 100 (4 inches) and larger | 1% |
2. Exhaust vents shall be extended separately through roof. Sanitary vents shall not connect to exhaust vents.

3.5 TESTS

- A. Sanitary waste and drain systems shall be tested either in its entirety or in sections.
- B. Waste System tests shall be conducted before trenches are backfilled or fixtures are connected. A water test or air test shall be conducted, as directed.
 - 1. If entire system is tested for a water test, tightly close all openings in pipes except highest opening, and fill system with water to point of overflow. If the waste system is tested in sections, tightly plug each opening except highest opening of section under test, fill each section with water and test with at least a 3 m (10 foot) head of water. In testing successive sections, test at least upper 3 m (10 feet) of next preceding section so that each joint or pipe except upper most 3 m (10 feet) of system has been submitted to a test of at least a 3 m (10 foot) head of water. Water shall be kept in the system, or in portion under test, for at least 15 minutes before inspection starts. System shall then be tight at all joints.
 - 2. For an air test, an air pressure of 35 kPa (5 psig) gage shall be maintained for at least 15 minutes without leakage. A force pump and mercury column gage shall be used for the air test.
 - 3. After installing all fixtures and equipment, open water supply so that all p-traps can be observed. For 15 minutes of operation, all p-traps shall be inspected for leaks and any leaks found shall be corrected.
 - 4. Final Tests: Either one of the following tests may be used.
 - a. Smoke Test: After fixtures are permanently connected and traps are filled with water, fill entire drainage and vent systems with smoke under pressure of 1.3 kPa (1 inch of water) with a smoke machine. Chemical smoke is prohibited.
 - b. Peppermint Test: Introduce (2 ounces) of peppermint into each line or stack.

--- E N D ---

**SECTION 22 14 00
FACILITY STORM DRAINAGE**

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This section describes the requirements for storm drainage systems, including piping and all necessary accessories as designated in this section.

1.2 RELATED WORK

- A. Section 07 84 00, FIRESTOPPING: Penetrations in rated enclosures.
- B. Section 09 91 00, PAINTING: Preparation and finish painting and identification of piping systems.
- C. Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING: Pipe Hangers and Supports, Materials Identification.
- D. Section 23 07 11, HVAC, PLUMBING, AND BOILER PLANT INSULATION: Pipe Insulation.

1.3 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturer's Literature and Data:
 - 1. Piping.
 - 2. Roof Drains.
 - 3. Cleanouts.
 - 4. All items listed in Part 2 - Products.
- C. Detailed shop drawing of clamping device and extensions when required in connection with the waterproofing membrane.

1.4 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American National Standards Institute (ANSI).
- C. American Society of Mechanical Engineers (ASME): (Copyrighted Society)
 - A112.21.2m-83Roof Drains
 - A13.1-07Scheme for Identification of Piping Systems

B16.3-06	Malleable Iron Threaded Fittings, Classes 150 and 300.
B16.9-07	Factory-Made Wrought Steel Butt welding Fittings
B16.11-05	Forged Steel Fittings, Socket-Welding and Threaded B16.12-98
(R 2006)	Cast Iron Threaded Drainage Fittings
B16.15-06)	Cast Bronze Threaded Fittings, Class 125 and 250
B16.18-01 (R 2005)	Cast Copper Alloy Solder-Joint Pressure Fittings
B16.22-01 (R 2005)	Wrought Copper and Copper Alloy Solder Joint Pressure Fittings

D. American Society for Testing and Materials (ASTM):

A47-99 (R 2004)	Standard Specification for Steel Sheet, Aluminum Coated, by the Hot-Dip Process
A53-07	Standard Specification for Pipe, Steel, Black And Hot-Dipped, Zinc-coated Welded and Seamless
A74-06	Standard Specification for Cast Iron Soil Pipe and Fittings
A183-03)	Standard Specification for Carbon Steel Track Bolts and Nuts
A312-03	Standard Specification for Seamless and Welded Austenitic Stainless Steel Pipe
A536-84(R 2004)	Standard Specification for Ductile Iron Castings
A733-03	Standard Specification for Welded and Seamless Carbon Steel and Austenitic Stainless Steel Pipe Nipples
B32-04	Standard Specification for Solder Metal
B61-08	Standard Specification for Steam or Bronze Castings
B62-02	Standard Specification for Composition Bronze or Ounce Metal Castings
B75-02	Standard Specification for Seamless Copper Tube
B88-03	Standard Specification for Seamless Copper Water Tube
B306-02	Standard Specification for Copper Drainage Tube (DWV)
B584-08	Standard Specification for Copper Alloy Sand Castings for General Applications
B687-99	Standard Specification for Brass, Copper, and Chromium-Plated Pipe Nipples

- C564-06a.....Standard Specification for Rubber Gaskets for Cast Iron Soil
Pipe and Fittings
- D2000-08Standard Classification System for Rubber Products in
Automotive Applications
- D4101-07Standard Specification for Propylene Plastic Injection and
Extrusion Materials
- D2447-03Standard Specification for Polyethylene (PE) Plastic Pipe,
Schedule 40 and 80, Based on Outside Diameter
- D2564-04e1Standard Specification for Solvent Cements for Poly (Vinyl
Chloride) (PVC) Plastic Pipe and Fittings
- D2665-07Standard Specification for Poly (Vinyl Chloride) (PVC) Plastic
Drain, Waste, and Vent Pipe and Fittings
- E. American Welding Society (AWS):
 - A5.8-04Specification for Filler Metals for Brazing and Braze Welding
- F. International Code Council (ICC):
 - IPC-2009International Plumbing Code
- G. Cast Iron Soil Pipe Institute (CISPI):
 - 301-05Hubless Cast Iron Soil and Fittings for Sanitary and Storm
Drain, Waste, and Vent Piping Applications
 - 310-04Couplings for Use in Connection with Hubless Cast Iron Soil
and Fittings for Sanitary and Storm Drain, Waste, and Vent
Piping Applications
- H. Manufacturers Standardization Society of the Valve and Fittings Industry, Inc. (MSS):
 - SP-72-99Standard for Ball Valves with Flanged or Butt Welding For
General Purpose
 - SP-110-96Ball Valve Threaded, Socket Welding, Solder Joint, Grooved
and Flared Ends

PART 2 - PRODUCTS

2.1 STORM WATER DRAIN PIPING

- A. Cast Iron Storm Pipe and Fittings:
 - 1. Cast iron storm pipe and fittings shall be used for the following applications:
 - a. Pipe buried in or in contact with earth.

- b. Extension of pipe to a distance of approximately 1500 mm (5 feet) outside of building walls.
 - c. Interior storm piping above grade.
 - d. All mechanical equipment rooms or other areas containing mechanical air handling equipment.
- 2. The cast iron storm Pipe shall be bell and spigot, or hubless (plain end or no-hub) as required by selected jointing method.
- 3. The material for all pipe and fittings shall be cast iron soil pipe and fittings and shall conform to the requirements of CISPI Standard 301, ASTM A-888, or ASTM A-74.
- 4. Joints for hubless pipe and fittings shall conform to the manufacturer's installation instructions. Couplings for hubless joints shall conform to CISPI 310. Joints for hub and spigot pipe shall be installed with compression gaskets conforming to the requirements of ASTM Standard C-564 or be installed with lead and oakum.
- B. Copper Tube, (DWV): May be used for piping above ground.
 - 1. The copper DWV tube shall be drainage type, drawn temper conforming to ASTM B306.
 - 2. The Copper drainage fittings shall be cast copper or wrought copper conforming to ASME B16.23 or ASME 16.29.
 - 3. The joints shall be lead free, using a water flushable flux, and conforming to ASTM B32.
- C. Polyvinyl Chloride (PVC)
 - 1. Polyvinyl chloride storm sewer pipe and fittings are permitted for single story structures except for mechanical equipment rooms and other areas containing air handling equipment or hot water generation equipment.
 - 2. Polyvinyl chloride storm sewer pipe and fittings shall be schedule 40 solid core sewer piping conforming to ASTM D1785 and D 2665, Sewer and Drain Series, with ends for solvent cemented joints.
 - 3. Polyvinyl chloride joints shall be solvent welded socket type using solvent cement conforming to ASTM D2564.
- D. Roof drain piping in locations where the outdoor conditions are subject to freezing shall be insulated.

2.2 PUMPED DRAIN PIPING:

- A. Pumped drain piping under 100 mm (4 inches) shall be copper tube conforming to ASTM B88, type K or L. For pumped drain piping 100 mm (4 inches) and above, galvanized steel conforming to A 53, seamless, schedule 40 may be used.
- B. Pumped drain pipe fittings shall comply with the following:
 - 1. Wrought copper or bronze castings conforming to ANSI B16.18 and B16.22.
 - 2. Unions shall be bronze, Mss SP-72, SP-110. Solder or braze joints.
 - 3. Grooved fittings, 65 mm to 100 mm (2-1/2 to 4 inch) wrought copper ASTM A75 C12200, 125 to 150 mm (5 to 6 inch) bronze castings ASTM B584, CDA 844.
Mechanical grooved couplings, ductile iron, ASTM A536 (Grade 65-45-12), malleable iron, ASTM A47 (Grade 32510) housing, with EPDM gasket, steel track head bolts, ASTM A183, coated with colored alkyd enamel.
- C. Adapters shall be provided for joining screwed pipe to copper tubing.
- D. The solder shall use a non-corrosive flux conforming to ASTM B32.

2.3 SPECIALTY PIPE FITTINGS

- A. Transition pipe couplings shall join piping with small differences in outside diameters or be of different materials. End connections shall be of the same size and compatible with the pipes being joined. The transition coupling shall be elastomeric, sleeve type reducing or transition pattern and include shear erring and corrosion resistant metal tension band and tightening mechanism on each end. The transition coupling sleeve coupling shall be of the following material:
 - 1. For cast iron soil pipes, the sleeve material shall be rubber conforming to ASTM C564.
 - 2. For PVC soil pipes, the sleeve material shall be elastomeric seal or PVC, conforming to ASTM F 477 or ASTM D5926.
 - 3. For dissimilar pipes, the sleeve material shall be PVC conforming to ASTM D5926, or other material compatible with the pipe materials being joined.
- B. The dielectric fittings shall conform to ASSE 1079 with a pressure rating of 860 kPa (125 psig) at a minimum temperature of 82°C (180°F). The end connection shall be solder joint copper alloy and threaded ferrous.
- C. Dielectric flange insulating kits shall be of non conducting materials for field assembly of companion flanges with a pressure rating of 1035 kPa (150 psig). The gasket shall be neoprene or phenolic. The bolt sleeves shall be phenolic or polyethylene. The washers shall be phenolic with steel backing washers.

- D. The dielectric nipples shall be electroplated steel nipple comply with ASTM F 1545 with a pressure ratings of 2070 kPa (300 psig) at 107°C (225°F). The end connection shall be male threaded. The lining shall be inert and noncorrosive propylene.

2.4 CLEANOUTS

- A. Cleanouts shall be the same size as the pipe, up to 100 mm (4 inches); not less than 100 mm (4 inches) for larger pipe. Cleanouts shall be easily accessible and shall be gastight and watertight. A minimum clearance of 600 mm (24 inches) shall be provided for clearing a clogged storm sewer line.
- B. Floor cleanouts shall be gray iron housing with clamping device and round, secured, scoriated, gray iron cover conforming to ASME A112.36.2M. A gray iron ferrule with hubless, socket, inside calk or spigot connection and counter sunk, taper-thread, brass or bronze closure plug shall be included. The frame and cover material and finish shall be nickel-bronze copper alloy with a square shape. The cleanout shall be vertically adjustable for a minimum of 50 mm (2 inches). When a waterproof membrane is used in the floor system, clamping collars shall be provided on the cleanouts. Cleanouts shall consist of wye fittings and eighth bends with brass or bronze screw plugs. Cleanouts in the resilient tile floors, quarry tile and ceramic tile floors shall be provided with square top covers recessed for tile insertion. In the carpeted areas, carpet cleanout markers shall be provided. Two way cleanouts where shall be provided where indicated on the drawings and at each building exit. The loading classification for cleanouts in sidewalk areas or subject to vehicular traffic shall be heavy duty.
- C. Cleanouts shall be provided at or near the base of the vertical stacks with the cleanout plug located approximately 600 mm (24 inches) above the floor. The cleanouts shall be extended to the wall access cover. Cleanout shall consist of sanitary tees. Nickel bronze square frame and stainless steel cover with minimum opening of 150 mm by 150 mm (6 inch by 6 inch) shall be provided at each wall cleanout.
- D. In horizontal runs above grade, cleanouts shall consist of cast brass tapered screw plug in fitting or caulked/no hub cast iron ferrule. Plain end (no-hub) piping in interstitial space or above ceiling may use plain end (no-hub) blind plug and clamp.

2.5 ROOF DRAINS AND CONNECTIONS

- A. See Drain Schedule on Drawings.
- B. Roof Drains: Roof Drains (RD) shall be cast iron with clamping device for making watertight connection. Free openings through strainer shall be twice area of drain outlet. For

roof drains not installed in connection with a waterproof membrane, a soft copper membrane shall be provided 300 mm (12 inches) in diameter greater than outside diameter of drain collar. An integral gravel stop shall be provided for drains installed on roofs having built up roofing covered with gravel or slag. Integral no-hub, soil pipe gasket or threaded outlet connection shall be provided.

1. Flat Roofs: The roof drain shall have a beehive or dome shaped strainer with integral flange not less than 300 mm (12 inches) in diameter. For an insulated roof, a roof drain with an adjustable drainage collar shall be provided, which can be raised or lowered to meet required insulation heights, sump receiver and deck clamp. The Bottom section shall serve as roof drain during construction before insulation is installed.
2. Protective Roof Membrane Insulation Assembly: The roof drain shall have a perforated stainless steel extension filter, non puncturing clamp ring, large sump with extra wide roof flange and deck clamp.
 - a. Non pedestrian Roofs: The roof drain shall have large polypropylene or aluminum locking dome.
 - b. Pedestrian Roof: The roof drain shall have a bronze promenade top 350 mm (14 inches) square, set in square secured frame support collar.
3. Roof Drains, Overflow: Roof Drains identified as overflow drains shall have a 50 mm (2 inch) water dam integral to the drain body.
4. Roof drains in areas subject to freezing shall have heat tape and shall be insulated.
- C. Expansion Joints: Expansions joints shall be heavy cast iron with cast brass or copper expansion sleeve having smooth bearing surface working freely against a packing ring held in place and under pressure of a bolted gland ring, forming a water and air tight flexible joint. Asbestos packing is prohibited.
- D. Interior Downspouts: An expansion joint shall be provided, specified above, at top of run on straight, vertical runs of downspout piping 12 m (40 feet) long or more.
- E. Downspout Nozzle: The downspout nozzle fitting shall be of brass, unfinished, with internal pipe thread for connection to downspout.

2.6 WATERPROOFING

- A. A sleeve flashing device shall be provided at points where pipes pass through membrane waterproofed floors or walls. The sleeve flashing device shall be manufactured, cast iron fitting with clamping device that forms a sleeve for the pipe floor penetration of the floor membrane. A galvanized steel pipe extension shall be included in the top of the fitting that

will extend 50 mm (2 inches) above finished floor and galvanized steel pipe extension in the bottom of the fitting that will extend through the floor slab. A waterproofed caulked joint shall be provided at the top hub.

- B. Walls: See detail shown on drawings.

PART 3 - EXECUTION

3.1 PIPE INSTALLATION

- A. The pipe installation shall comply with the requirements of the International code and these specifications.
- B. Branch piping shall be installed from the piping system and connect to all drains and outlets.
- C. Pipe shall be round and straight. Cutting shall be done with proper tools. Pipe shall be reamed to full size after cutting.
- D. All pipe runs shall be laid out to avoid interference with other work.
- E. The piping shall be installed above accessible ceilings to allow for ceiling panel removal.
- F. Unless otherwise stated on the documents, minimum horizontal slope shall be one inch for every 1.22 m (4 feet) of pipe length.
- G. The piping shall be installed free of sags and bends.
- H. Seismic restraint shall be installed where required by code.
- I. Changes in direction for storm drainage piping shall be made using appropriate branches, bends and long sweep bends. Sanitary tees and short sweep 1/4 bends may be used on vertical stacks if change in direction of flow is from horizontal to vertical. Long turn double wye branch and 1/8 bend fittings shall be used if two fixtures are installed back to back or side by side with common drain pipe. Do not change direction of flow more than 90 degrees. Proper size of standard increaser and reducers shall be used if pipes of different sizes are connected. Reducing size of drainage piping in direction of flow is prohibited.
- J. Buried storm drainage piping shall be laid beginning at the low point of each system. Piping shall be installed true to grades and alignment indicated with unbroken continuity of invert. Hub ends shall be placed upstream. Required gaskets shall be installed according to manufacturer's written instruction for use of lubricants, cements, and other installation requirements.
- K. Cast iron piping shall be installed according to CISPI's "Cast Iron Soil Pipe and Fittings Handbook," Chapter IV, "Installation of Cast Iron Soil Pipe and Fittings"
- L. Aboveground copper tubing shall be installed according to CDA's "Copper Tube Handbook".

- M. Aboveground PVC piping shall be installed according to ASTM D2665. Underground PVC piping shall be installed according to ASTM D2321.

3.2 JOINT CONSTRUCTION

- A. Hub and spigot, cast iron piping with gasket joints shall be joined in accordance with CISPI's "Cast Iron Soil Pipe and Fittings Handbook" for compression joints.
- B. Hub and spigot, cast iron piping with calked joints shall be joined in accordance with CISPI's "Cast Iron Soil Pipe and Fittings Handbook" for lead and oakum calked joints.
- C. Hubless, cast iron piping shall be joined in accordance with CISPI's "Cast Iron Soil Pipe and Fittings Handbook" for hubless piping coupling joints.
- D. For threaded joints, thread pipe with tapered pipe threads according to ASME B1.20.1. The threads shall be cut full and clean using sharp disc cutters. Threaded pipe ends shall be reamed to remove burrs and restored to full pipe inside diameter. Pipe fittings and valves shall be joined as follows:
 - 1. Apply appropriate tape or thread compound to external pipe threads unless dry seal threading is required by the pipe service
 - 2. Pipe sections with damaged threads shall be replaced with new sections of pipe.
- E. Copper tube and fittings with soldered joints shall be joined according to ASTM B828. A water flushable, lead free flux conforming to ASTM B813 and a lead free alloy solder conforming to ASTM B32 shall be used.
- F. for PVC piping, solvent cement joints shall be used for joints. All surfaces shall be cleaned and dry prior to applying the primer and solvent cement. Installation practices shall comply with ASTM F402. The joint shall conform to ASTM D2855 and ASTM D2665 appendices.

3.3 SPECIALTY PIPE FITTINGS

- A. Transition coupling shall be installed at pipe joints with small differences in pipe outside diameters.
- B. Dielectric fittings shall be installed at connections of dissimilar metal piping and tubing.

3.4 PIPE HANGERS, SUPPORTS AND ACCESSORIES:

- A. All piping shall be supported according to the International plumbing code, Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING, and these specifications.
- B. Hangers, supports, rods, inserts and accessories used for Pipe supports shall be shop coated with zinc Chromate primer paint. Electroplated copper hanger rods, hangers and accessories may be used with copper tubing.

- C. Horizontal piping and tubing shall be supported within 300 mm (12 inches) of each fitting or coupling.
- D. Horizontal cast iron piping shall be supported with the following maximum horizontal spacing and minimum hanger rod diameters:
 - 1. NPS 1-1/2 to NPS 2 (DN 40 to DN 50): 1500 mm (60 inches) with 10 mm (3/8 inch) rod.
 - 2. NPS 3 (DN 80): 1500 mm (60 inches) with 13 mm (1/2 inch) rod.
 - 3. NPS 4 to NPS 5 (DN 100 to DN 125): 1500 mm (60 inches) with 16 mm (5/8 inch) rod.
 - 4. NPS 6 to NPS 8 (DN 150 to DN 200): 1500 mm (60 inches) with 19 mm (3/4 inch) rod.
 - 5. NPS 10 to NPS 12 (DN 250 to DN 300): 1500 mm (60 inches) with 22 mm (7/8 inch) rod.
- E. The maximum support spacing for horizontal plastic shall be 1.22 m (4 feet).
- F. Vertical piping and tubing shall be supported at the base, at each floor, and at intervals no greater than 4.57 m (15 feet).
- G. In addition to the requirements in Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING, floor, Wall and Ceiling Plates shall have the following characteristics:
 - 1. Solid or split unplated cast iron.
 - 2. All plates shall be provided with set screws.
 - 3. Height adjustable clevis type pipe hangers.
 - 4. Adjustable Floor Rests and Base Flanges shall be steel.
 - 5. Hanger Rods shall be low carbon steel, fully threaded or Threaded at each end with two removable nuts at each end for positioning rod and hanger and locking each in place.
 - 6. Riser Clamps shall be malleable iron or steel.
 - 7. Roller shall be cast iron.
 - 8. Hangers and supports utilized with insulated pipe and tubing shall have 180 degree (min.) metal protection shield Centered on and welded to the hanger and support. The shield shall be 4 inches in length and be 16 gage steel. The shield shall be sized for the insulation.
- H. Miscellaneous Materials shall be provided as specified, required, directed or as noted on the drawings for proper installation of hangers, supports and accessories. If the vertical distance

- exceeds 6 m (20 feet) for cast iron pipe additional support shall be provided in the center of that span. All necessary auxiliary steel shall be provided to provide that support.
- I. Cast escutcheon with set screw shall be installed at each wall, floor and ceiling penetration in exposed finished locations and within cabinets and millwork.
 - J. Penetrations:
 - 1. Fire Stopping: Where pipes pass through fire partitions, fire walls, smoke partitions, or floors, a fire stop shall be installed that provides an effective barrier against the spread of fire, smoke and gases as specified in Section 07 84 00, FIRESTOPPING.
Clearances between raceways and openings shall be completely filled and sealed with the fire stopping materials.
 - 2. Water proofing: At floor penetrations, Clearances around the pipe shall be completely sealed and made watertight with sealant as specified in Section 07 92 00, JOINT SEALANTS.
 - K. Piping shall conform to the following:
 - 1. Storm Water Drain and Vent Drain to main stacks:

Pipe Size	Minimum Pitch
80 mm (3 inches) and smaller	2%
100 mm (4 inches) (4 inches) and larger	1%

3.5 TESTS

- A. Storm sewer system shall be tested either in its entirety or in sections.
- B. Storm Water Drain tests shall be conducted before trenches are backfilled or fixtures are connected. A water test or air test shall be conducted, as directed.
 - 1. If entire system is tested with water, tightly close all openings in pipes except the highest opening, and fill system with water to point of overflow. If system is tested in sections, tightly plug each opening except highest opening of section under test, fill each section with water and test with at least a 3 m (10 foot) head of water. In testing successive sections, test at least upper 3 m (10 feet) of next preceding section so that each joint or pipe except upper most 3 m (10 feet) of system has been submitted to a test of at least a 3 m (10 foot) head of water. Water shall be kept in the system, or in portion under test, for at least 15 minutes before inspection starts. System shall then be tight at all joints.

2. For an air test, an air pressure of 35 kPa (5 psi) gage shall be maintained for at least 15 minutes without leakage. A force pump and mercury column gage shall be used for the test.
3. Final Tests: Either one of the following tests may be used.
 - a. Smoke Test: After fixtures are permanently connected and traps are filled with water, fill entire drainage and vent systems with smoke under pressure of 1.3 kPa (1 inch of water) with a smoke machine. Chemical smoke is prohibited.
 - b. Peppermint Test: Introduce .06 liters (2 ounces) of peppermint into each line or stack.

--- E N D ---

SECTION 22 35 00
DOMESTIC WATER HEAT EXCHANGERS

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This section describes the requirements for domestic hot water heat exchangers including thermometers and all necessary accessories, connections and equipment.

1.2 RELATED WORK:

- A. Section 09 91 00, PAINTING: Preparation and finish painting.
- B. Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.
- C. Section 23 07 11, HVAC, PLUMBING, AND BOILER PLANT INSULATION: Heater Insulation.
- D. GENERAL-DUTY VALVES FOR PLUMBING PIPING and 22 11 00, FACILITY WATER DISTRIBUTION: Piping, Fittings, Valves and Gages.

1.3 SUBMITTALS:

- A. Submit manufacturer's literature and data pertaining to the water heater in properly bound package, in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES. Include the following as a minimum:
 - 1. Heat Exchangers.
 - 2. Pressure and Temperature Relief Valves.
 - 3. Steam Control Valves.
 - 4. Thermometers.
 - 5. Pressure Gages.
 - 6. Vacuum Breakers.
- B. Equipment components in contact with potable water shall meet NSF compliance requirements in document NSF 61, "Drinking Water System Components – Health Effects.
- C. A form U-1 or other documentation stating compliance with the ASME Boiler and Pressure Vessel code.

1.4 APPLICABLE PUBLICATIONS:

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American National Standard Institute (ANSI):
 - Z21.22-00/4.4A-00Relief Valves for Hot Water Supply systems

- C. American Society of Mechanical Engineers (ASME):
- B1.20.1-01Pipe Threads, General Purpose
 - B16.5-03Pipe Flanges and Flanged Fittings, NPS ½ through NPS 24
 - B16.24-06Cast Copper Alloy Pipe Flanges, Class 150, 300,600, 900, 1500,
2500
 - PTC 25.3-02.....Pressure Relief Devices
 - Section IV-07Heating Boilers
 - Section VIII-07Pressure Vessels Division 1

1.5 AS-BUILT DOCUMENTATION

- A. The electronic documentation and copies of the Operations and Maintenance Manual, approved submittals, shop drawings, and other closeout documentation shall be prepared by a computer software program complying with Section 508 of the Rehabilitation Act of 1973, as amended (29 U.S.C 794d). The manufacturer or vendor of the software used to prepare the electronic documentation shall have a Voluntary Product Accessibility Template made available for review and included as part of the Operations and Maintenance Manual or closeout documentation. All available accessibility functions listed in the Voluntary Accessibility Template shall be enabled in the prepared electronic files. As Adobe Acrobat is a common industry format for such documentation, following the document, "Creating Accessible Adobe PDF files, A Guide for Document Authors" that is maintained and made available by Adobe free of charge is recommended.”
- B. Four sets of manufacturer’s literature and data updated to include submittal review comments and any equipment substitutions.
- C. Four sets of operation and maintenance data updated to include submittal review comments shall be inserted into a three ring binder. All aspects of system operation and maintenance procedures, including piping isometrics, wiring diagrams of all circuits, a written description of system design, control logic, and sequence of operation shall be included in the operation and maintenance manual. The operations and maintenance manual shall include troubleshooting techniques and procedures for emergency situations. Notes on all special systems or devices such as damper and door closure interlocks shall be included. A List of recommended spare parts (manufacturer, model number, and quantity) shall be furnished. Information explaining any special knowledge or tools the owner will be required to employ shall be inserted into the As-Built documentation.

PART 2 - PRODUCTS

2.1 CIRCULATING DOMESTIC WATER HEAT EXCHANGERS

- A. See Domestic Hot Water Heat Exchange Schedule on drawings.
- B. A storage type hot water generator system shall be provided with circulator, heat exchanger coil, controls, and specialties. The domestic water heat exchanger with circulator shall be based upon a standard flow arrangement with water from bottom of storage tank circulated across the heat exchanger coil and returned to tank.
- C. A hot water outlet shall be included at the top of the tank.
- D. A temperature sensor shall be located inside the storage tank.
- E. A circulating pump complying with UL 778, all bronze construction, overhung impeller, and separately coupled inline pump shall be included. The pump shall have mechanical seals. The working pressure shall be rated at 860 kPa (125 psig).
- F. The stand shall be factory fabricated for floor mounting.
- G. The tappings shall be factory fabricated of materials compatible with heat exchanger shell. For sizes 50 millimeters or DN50 (NPS 2) and smaller, the tappings shall be threaded ends fabricated in accordance to ASME B1.20.1. For sizes 65 millimeters or DN65 (NPS 2-1/2) and larger, the tappings shall be flanged according to ASME B16.5 for steel and stainless steel flanges and ASME 16.24 for copper and copper alloy flanges.
- H. Shell insulation shall comply with ASHRAE 890.1 and suitable for operating temperature. The entire shell and nozzles shall be completely surrounded except connections and controls.
- I. The heat exchanger coils shall be constructed from copper and fabricated in a helix wound for steam heating medium. The pressure rating shall be equal to or greater than the steam supply pressure plus 50%.
- J. The temperature controls shall be based upon an adjustable temperature transmitter that operates a control valve and is capable of maintaining outlet water temperature within 2°C (4°F) of setting.
- K. Safety control shall be automatic, high temperature limit shutoff device.
- L. The relief valves shall be ASME rated and stamped for combination temperature and pressure relief valves. One or more relief valves with total relieving capacity at least as great as heat input shall be included. The pressure setting shall be less than the working pressure rating of the heat exchanger minus 10 percent.

2.2 THERMOMETERS:

- A. Thermometers shall be rigid stem or remote sensing, dial type with an aluminum, black metal, stainless steel, or chromium plated brass case. The thermometer shall be back

connected, mercury, vapor, BI-metal or gas actuated, with circular dial 90 mm (3 1/2 inches) in diameter graduated from 4 to 100°C (40 to 210°F), with two-degree graduations guaranteed accurate within one scale division. The socket shall be separable, double-seat, micrometer-fittings, with extension neck not less than 65 mm (2 1/2 inches) to clear tank or pipe covering. The thermometer shall be suitable for 20 mm (3/4 inch) pipe threads.

Thermometers may be consoles mounted with sensor installed in separate thermometer well.

2.3 SAFETY VALVES FOR SHELL AND STEAM HEATERS:

- A. Separate temperature relief valve and pressure relief valve or combination pressure/temperature relief valves shall be provided on each water heater. The safety valve discharge shall be routed to nearest floor drain.
- B. Temperature Relief Valves shall be constructed from all brass or bronze material. The temperature relief valves shall be automatic, self-closing reseating type valve, equipped with a noncorrosive metal thermostat with bulb extending into tank that can be manually displaced from its seat for test purposes. The temperature relief valve shall be tested and approved as to its BTU capacity by ASME or an independent laboratory satisfactory to the Contracting Officer. In no case shall total rated BTU relieving capacity of temperature relief valve, or valves, be less than BTU input into water heater. Temperature relief valve shall be completely open before temperature reaches 98°C (210°F) and shall close when temperature goes below 93°C (200°F).
- C. Pressure relief valves shall conform to requirements of ASME, Section IV. BTU relieving capacity of pressure relief valve, or valves, shall be not less than BTU input of the water heater. The pressure relief shall be set at 690 kPa (100 psig) pressure.
- D. A double solenoid safety system shall be provided for each shell and steam coil heater to function as a safety over temperature prevention system. System shall consist of aquastat, pilot light, solenoid steam safety valve and solenoid water safety valve located in the control circuit. The aquastat shall be set at 60°C (140°F).

2.4 DOMESTIC HOT WATER COMPRESSION TANKS

- A. A steel pressure rated tank constructed with welded joints and factory installed butyl rubber diaphragm shall be installed as scheduled. The air pre-charge shall be set to minimum system operating pressure at tank.
- B. The tappings shall be factory fabricated steel, welded to the tank and include ASME B1.20.1 pipe thread.

- C. The interior finish shall comply with NSF 61 barrier materials for potable water tank linings and the liner shall extend into and through the tank fittings and outlets.
- D. The air charging valve shall be factory installed.

2.5 HEAT TRAPS

- A. Heat traps shall be installed in accordance with ASHRAE 90.1, latest edition.

2.6 COMBINATION TEMPERATURE AND PRESSURE RELIEF VALVES

- A. The combination temperature and pressure relief valves shall be ASME rated and stamped and include a relieving capacity at least as great as the heat input and include a pressure setting less than the water heater's working pressure rating.

PART 3 - EXECUTION

3.1 INSTALLATION:

- A. The water heaters shall be installed on concrete bases. Refer to Specification Section 03 30 00, CAST-IN-PLACE CONCRETE and Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING
- B. The water heaters shall be installed level and plumb.
- C. Water heaters shall be installed and connected in accordance with manufacturer's written instructions.
- D. All pressure and temperature relief valves discharge shall be pipe to nearby floor drains.
- E. Thermometers shall be installed on water heater inlet and outlet piping.
- F. The control thermostats shall be set for a maximum setting of 54°C (130°F).

3.2 LEAKAGE TEST:

- A. Before piping connections are made, the water heaters shall be tested at a hydrostatic pressure of 1375 kPa (200 psi) for water heaters rated at less than 1103 kPa (160 psig) and 1654 kPa (240 psig) for units with an maximum working pressure of 1103 kPa (160 psig) or over. Any failed test shall be corrected and the water heater shall be retested at no additional cost to the VA.

3.3 PERFORMANCE TEST:

- A. Ensure that all of the remote water outlets will have a minimum of 49°C (120°F) and a maximum of 54°C (130°F) water flow at all times. If necessary, make all correction to balance the return water system or reset the thermostat to make the system comply with design requirements.

--- E N D ---

SECTION 22 40 00 PLUMBING FIXTURES

PART 1 - GENERAL

1.1 DESCRIPTION

- A. Plumbing fixtures, associated trim and fittings necessary to make a complete installation from wall or floor connections to rough piping, and certain accessories.

1.2 RELATED WORK

- A. Sealing between fixtures and other finish surfaces: Section 07 92 00, JOINT SEALANTS.
- B. Flush panel access doors: Section 08 31 13, ACCESS DOORS AND FRAMES.
- C. Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.

1.3 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Submit plumbing fixture information in an assembled brochure, showing cuts and full detailed description of each fixture.

1.4 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American National Standard Institute (ANSI):
- C. The American Society of Mechanical Engineers (ASME):
 - A112.6.1M-02(R2008) .Floor Affixed Supports for Off-the-Floor Plumbing Fixtures for Public Use
 - A112.19.1M-04.....Enameled Cast Iron Plumbing fixtures
 - A112.19.2M-03(R2008)Vitreous China Plumbing Fixtures
 - A112.19.3-2001(R2008) Stainless Steel Plumbing fixtures (Designed for Residential Use)
- D. American Society for Testing and Materials (ASTM):
 - A276-2003Stainless and Heat-Resisting Steel Bars and Shapes
- E. National Association of Architectural Metal Manufacturers (NAAMM): NAAMM AMP 500-505
 - Metal Finishes Manual (1988)
- F. American Society of Sanitary Engineers (ASSE):

1016-05Performance Requirements for Individual Thermostatic,
 Pressure Balancing and Combination Pressure Balancing and
 Thermostatic Control Valves for Individual Fixture Fittings

- G. National Sanitation Foundation (NSF)/American National Standards Institute (ANSI):
 61-03Drinking Water System Components-Health Effects
- H. American with Disabilities Act(A.D.A) Section 4-19.4 Exposed Pipes and Surfaces

PART 2 - PRODUCTS

2.1 STAINLESS STEEL

- A. Corrosion-resistant Steel (CRS):
 - 1. Plate, Sheet and Strip: CRS flat products shall conform to chemical composition requirements of any 300 series steel specified in ASTM A276.
 - 2. Finish: Exposed surfaces shall have standard polish (ground and polished) equal to NAAMM finish Number 4.
- B. Die-cast zinc alloy products are prohibited.

2.2 STOPS

- A. Provide lock-shield loose key or screw driver pattern angle stops, straight stops or stops integral with faucet, with each compression type faucet whether specifically called for or not, including sinks in wood and metal casework, laboratory furniture and pharmacy furniture. Locate stops centrally above or below fixture in accessible location.
- B. Furnish keys for lock shield stops to Resident Engineer.
- C. Supply from stops not integral with faucet shall be chrome plated copper flexible tubing or flexible stainless steel with inner core of non-toxic polymer.
- D. Supply pipe from wall to valve stop shall be rigid threaded IPS copper alloy pipe, i.e. red brass pipe nipple.
- E. Psychiatric Area: Provide stainless steel drain guard for all lavatories not installed in casework.

2.3 ESCUTCHEONS

- A. Heavy type, chrome plated, with set screws. Provide for piping serving plumbing fixtures and at each wall, ceiling and floor penetrations in exposed finished locations and within cabinets and millwork.

2.4 LAMINAR FLOW CONTROL DEVICE

- A. Smooth, bright stainless steel or satin finish, chrome plated metal laminar flow device shall provide non-aeration, clear, coherent laminar flow that will not splash in basin. Device shall also have a flow control restrictor and have vandal resistant housing.
- B. Flow Control Restrictor:
 - 1. Capable of restricting flow from 95 to 110 mL/s (1.5 to 1.7 gpm) for lavatories; 125 to 140 mL/s (2.0 to 2.2 gpm) for sinks P-505 through P-520, P-524 and P-528; and 170 to 190 mL/s (2.75 to 3.0 gpm) for dietary food preparation and rinse sinks.
 - 2. Compensates for pressure fluctuation maintaining flow rate specified above within 10 percent between 170 and 550 kPa (25 and 80 psi).
 - 3. Operates by expansion and contraction, eliminates mineral/sediment build-up with self-clearing action, and is capable of easy manual cleaning.
- C. Device manufactured by OMNI Products, Inc. or equal.

2.5 CARRIERS

- A. ASME/ANSI A112.6.1M, with adjustable gasket faceplate chair carriers for wall hung closets with auxiliary anchor foot assembly, hanger rod support feet, and rear anchor tie down, 500 pound closet loading capacity.
- B. ASME/ANSI A112.6.1M, lavatory, chair carrier for thin wall construction. All lavatory chair carriers shall be capable of supporting the lavatory with a 250-pound vertical load applied at the front of the fixture.
- C. Where water closets, lavatories or sinks are installed back-to-back and carriers are specified, provide one carrier to serve both fixtures in lieu of individual carriers. The drainage fitting of the back to back carrier shall be so constructed that it prevents the discharge from one fixture from flowing into the opposite fixture.

2.6 WATER CLOSETS

- A. See Plumbing Fixture Schedule on Drawings.
- B. Water Closet (Wall Hung, ASME/ANSI A112.19.2M, Figure 9) office and industrial, elongated bowl, siphon jet 6 L (1.6 gallons) per flush, wall outlet. Handicapped water closet shall have rim set 460 mm (18 inches) above finished floor.
 - 1. Seat: Institutional/Industrial, extra heavy duty, chemical resistant, solid plastic, open front less cover for elongated bowls, integrally molded bumpers, concealed check hinge with stainless steel post. Seat shall be posture contoured body design. Color shall be white.

2. Fittings and Accessories: Gaskets - neoprene; bolts with chromium plated caps nuts and washers.
3. Flush valve: Large chloramines resistant diaphragm, semi-red brass valve body, exposed chrome plated, non-hold open ADA approved side oscillating handle, water saver design 6 L (1.6 gallons) per flush with maximum 10 percent variance 25mm (one-inch) screwdriver back check angle stop with vandal resistant cap, adjustable tailpiece, a high back pressure vacuum breaker, spud coupling for 40 mm (1-1/2 inch) top spud, wall and spud flanges, and sweat solder adapter with cover tube and set screw wall flange. Valve body, cover, tailpiece and control stop shall be in conformance with ASTM alloy classification for semi-red brass. Seat bumpers shall be integral part of flush valve. Set centerline of inlet 292 mm (11-1/2 inches) above rim.

2.7 LAVATORIES

- A. See Plumbing Fixture Schedule on Drawings.
- B. Brass components in contact with water shall contain no more than 3 percent lead content by dry weight.
- C. Lavatory (ASME/ANSI A112.19.2M, Figure 16) straight back, , first quality vitreous china. Punching for faucet on 102 mm (4-inch) centers or as noted. Support lavatory to wall with steel wall plate. Set with rim 864 mm (34 inches) above finished floor:
 1. Faucet: Solid cast brass construction with washerless ceramic disc mixing cartridge type and centrally exposed rigid gooseneck spout Outlet 125-150 mm (5-6 inches) above rim. Provide laminar flow control device. One hundred two millimeters (4-inch) wrist blade type handles on faucets shall be cast, formed or drop forged copper alloy. Faucet, wall and floor escutcheons shall be either copper alloy or CRS. Exposed metal parts, including exposed part under valve handle when in open position, shall be chrome plated with a smooth bright finish. Drain: Cast or wrought brass with flat grid strainer and offset tailpiece, chrome plated finish.
 2. Stops: Angle type. See paragraph 2.2. Stops
 3. Trap: Cast copper alloy, 40 by 32 mm (1-1/2 by 1-1/4 inch) P-trap. Adjustable with connected elbow and 1.4 mm thick (17 gauge) tubing extension to wall. Exposed metal trap surface, and connection hardware shall be chrome plated with a smooth bright finish. Set trap parallel to wall.
 4. Provide cover for drain, stops and trap per A.D.A 4-19.4.

- D. Lavatory (Sensor Control, Hi-Arc Spout, ASME/ANSI A112.19.2M) straight back, approximately 500 by 450 mm (20 by 18 inches) and a 102mm (4-inch) maximum apron, first quality vitreous china with punching for gooseneck spout. Set rim 864 mm (34 inches) above finished floor.
1. Faucet: Solid cast brass construction, chrome plated, gooseneck spout with outlet 102 to 127 mm (4 to 5 inches) above rim. Electronic sensor operated, 102 mm (4 inch) center set mounting, wiring box, plug in transformer, solid brass hot-cold water mixer adjusted from top deck with barrier free design control handle. Provide laminar flow control device. Breaking the light beam shall activate the water flow. Flow shall stop when user moves away from light beam. All connecting wiring between transformer, solenoid valve and sensor shall be cut to length with no excess hanging or wrapped up wiring allowed.
 2. Drain: Cast or wrought brass with flat grid strainer with offset tailpiece, brass, chrome plated.
 3. Stops: Angle type. See paragraph 2.2.Stops
 4. Trap: Cast copper alloy, 40 by 32 mm (1-1/2 by 1-1/4 inch) P-trap. Adjustable with connected elbow and 17 gage tubing extension to wall. Exposed metal trap surface and connection hardware shall be chrome plated with a smooth bright finish. Set trap parallel to wall.
 5. Provide cover for drain, stops and trap per A.D.A 4-19.4.

2.8 SINKS

- A. See Plumbing Fixture Schedule on Drawings.
- B. Dimensions for sinks and laundry tubs are specified, length by width (distance from wall) and depth.
- C. Clinic Service Sink (Flushing Rim, Wall Hung) approximately 500 by 635 mm (20 by 25 inches) by 203 mm (8 inches) deep. Support with ASME/ANSI A112.61M chair carrier and secure with 10 mm (3/8-inch) bracket studs and nuts. Set sink with rim 762 mm (30 inches) above finished floor. Provide 762 mm (30-inch) CRS drainboard where required, without corrugations and with heavy duty CRS brackets.
 1. Faucet: Solid brass connection, horizontal swing spout with escutcheon mounted on wall above sink. Mechanical pedal mixing valve with self-closing pedal valve with stops, renewable monel seats, removable replacement unit containing all parts subject to wear, and supply from valve to spout, indexed lift up pedals having clearance of not

more than 13 mm (1/2-inch) above the floor and not less than 356 mm (14 inches) from wall when in operation. Supply pipe from wall to valve stop shall be rigid threaded IPS copper alloy pipe. Supply pipe from valve to faucet shall be copper alloy pipe. Supply pipe from valve to faucet shall be manufacturer's option. Exposed brass parts shall be chromium plated with a smooth bright finish.

2. Flush valve: Large diaphragm, semi-red brass body, Foot pedal operated, exposed chromium plated flush valve with screwdriver back check straight stop with cap, union outlet, street ells, elevated high pressure vacuum breaker, casing cover, 32 mm (1-1/4 inch) elbow flush connection from finished wall to 40 mm (1-1/2 inch) top spud. Spud coupling, wall and spud flanges.
- D. Sink (CRS, Single Compartment, Counter Top ASME/ANSI A112.19.2M, Kitchen Sinks, Figure 5) self rimming, back faucet ledge, approximately 533 by 558 mm (21 by 22 inches) with single compartment inside dimensions approximately 406 by 483 by 190 mm (16 by 19 by 7 1/2 inches) deep. Shall be minimum of 1.3 mm thick (18 gauge) CRS. Corners and edges shall be well rounded:
1. Faucet: Solid brass construction, deck mounted combination faucet with monel or ceramic seats, removable replacement unit containing all parts subject to wear, swivel gooseneck spout with approximately 200 mm (8-inch) reach with spout outlet 150 mm (6-inches) above deck and // 102 mm (4 inch) wrist blades // single lever // with hose spray. Faucet shall be polished chrome plated.
 2. Drain: Drain plug with cup strainer, stainless steel.
 3. Trap: Cast copper alloy 40 mm (1-1/2 inch) P-trap with cleanout plug. Provide wall connection and escutcheon.

Provide cover for drain, stops and trap per A.D.A 4-19.4.

2.9 EMERGENCY FIXTURES

- A. See Plumbing Fixture Schedule on Drawings.
- B. Emergency Shower:
 1. Shower Head: Safety yellow plastic shower head..
 2. Installation: Head shall be 2100 mm (84 inches) above floor.
 3. Valves: Stay-open ball type, chrome plated, operated by a 600 mm (24-inch) stainless steel pull-rod with triangle handle. Pull-down opens valve push-up closes valve.
- C. Emergency Eye and Face Wash (Wall Bracket Mounted): hand operated self-closing valve control, flip top dust cover.

2.10 HYDRANT, HOSE BIBB AND MISCELLANEOUS DEVICES

- A. See Plumbing Fixture Schedule on Drawings.
- B. (P-801) Wall Hydrant: Box and locking door (loose key), freeze-proof, double check backflow preventer with detachable T-handle. Brass operating rod within casing of bronze pipe of sufficient length to extend through wall and place valve inside building. Brass valve with coupling and union elbow having metal-to-metal seat. Valve rod and seat washer removable through face of hydrant; 20 mm (3/4-inch) hose thread on spout; 20 mm (3/4-inch) pipe thread on inlet. Finish may be rough; exposed surfaces shall be chrome plated. Set not less than 460 mm (1-1/2 feet) nor more than 920 mm (3-feet) above grade. On porches and platforms, set approximately 760 mm (2-1/2 feet) above finished floor. Provide integral vacuum breaker which automatically drains when shut off.
- C. (P-802) Hose bibb, wall mounted faucet with atmospheric vacuum breaker spout. polished chrome finish, solid brass body, 3/4" hose threaded outlet, 3/4" npt female inlet, tee handle. Cast or wrought copper alloy, combination faucet with replaceable monel seat, removable replacement unit containing all parts subject to wear, mounted on wall 914 mm (36 inches) above floor to concealed supply pipes. Provide faucet without top or bottom brace and with 20 mm (3/4-inch) hose coupling threads on spout, integral stops and vacuum breaker. Design valves with valve disc arranged to eliminate rotation on seat. Four-arm handles on faucets shall be cast, formed or drop forged copper alloy. Escutcheons shall be either forged copper alloy or CRS. Exposed metal parts, including exposed part under valve handle when in open position, shall have a bright finish.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Fixture Setting: Opening between fixture and floor and wall finish shall be sealed as specified under Section 07 92 00, JOINT SEALANTS.
- B. Supports and Fastening: Secure all fixtures, equipment and trimmings to partitions, walls and related finish surfaces. Exposed heads of bolts and nuts in finished rooms shall be hexagonal, polished chrome plated brass with rounded tops.
- C. Toggle Bolts: For hollow masonry units, finished or unfinished.
- D. Expansion Bolts: For brick or concrete or other solid masonry. Shall be 6 mm (1/4-inch) diameter bolts, and to extend at least 75 mm (3-inches) into masonry and be fitted with loose tubing or sleeves extending into masonry. Wood plugs, fiber plugs, lead or other soft metal shields are prohibited.

- E. Power Set Fasteners: May be used for concrete walls, shall be 6 mm (1/4-inch) threaded studs, and shall extend at least 35 mm (1-1/4 inches) into wall.
- F. Tightly cover and protect fixtures and equipment against dirt, water and chemical or mechanical injury.
- G. Where water closet waste pipe has to be offset due to beam interference, provide correct and additional piping necessary to eliminate relocation of water closet.
- H. Do not use aerators on lavatories and sinks.

3.2 CLEANING

- A. At completion of all work, fixtures, exposed materials and equipment shall be thoroughly cleaned.

--- E N D ---

SECTION 22 62 00
VACUUM SYSTEMS FOR LABORATORY AND HEALTHCARE FACILITIES

PART 1 - GENERAL

1.1 DESCRIPTION

- A. Central Laboratory and Healthcare Vacuum Systems: This section describes the labor, equipment, and services necessary for and incidental to the installation of piped medical vacuum systems and medical vacuum and waste anesthesia gas disposal systems (WAGD). Medical vacuum and WAGD systems shall be installed started, tested, and ready for use. The scope of work shall include all necessary piping, fittings, valves, cabinets, station outlets and inlets, rough ins, ceiling services, gages, alarms including low voltage wiring, vacuum pumps, electric motors and starters, receivers, and all necessary parts, accessories, connections and equipment. Match existing station inlet terminal connections.
- B. The contractor shall provide all elements and accessories required for a complete system according to the most recent edition of NFPA 99C, Gas and Vacuum Systems.
- C. All necessary connections to owner furnished equipment shall be made as indicated on the documents. A separate construction isolation valve shall be made at the point of connection to an existing vacuum system.
- D. Electrical power and control wiring for vacuum pump(s), WAGD Producer(s), ceiling columns, alarms wiring from equipment to alarm panels, and modular accessories associated with the system(s) shall be included.
- E. Pressure testing, cross connection testing and final testing per NFPA 99 most recent edition and using procedures shall be performed.
- F. The contractor shall retain a qualified third party medical vacuum verifier acceptable to the engineer and VA to perform and attest to final verification of the systems. The contractor shall make all corrections as determined by this third party verifier, including additional testing if necessary to attain full and unqualified certification.
- G. Coordinate with owner retained verifier for final verification of the systems. Make corrections as required, including additional testing if necessary to attain full and unqualified certification.

1.2 RELATED WORK

- A. Section 07 84 00, FIRESTOPPING: Sealing around pipe penetrations to maintain the integrity of time rated construction.

- B. Section 07 92 00, JOINT SEALANTS: Sealing around pipe penetrations through the floor to prevent moisture migration.
- C. Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING: General requirements and items common to more than one section of Division 22.
- D. Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC: Alarm interface with ECC.
- E. Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS: Conduit.
- F. Section 26 05 21, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES (600 VOLTS AND BELOW): Control wiring.
- G. Section 26 27 26, WIRING DEVICES: Electrical wiring and accessories.
- H. Section 22 05 12, GENERAL MOTOR REQUIREMENTS FOR PLUMBING EQUIPMENT: Electric motors.
- I. Section 26 29 11, LOW-VOLTAGE MOTOR STARTERS: Motor starters.
- J. Section 10 25 13, PATIENT BED SERVICE WALLS: Prefabricated bedside patient units.
- K. Section 22 63 00, GAS SYSTEMS FOR LABORATORY AND HEALTHCARE FACILITIES: Laboratory and Healthcare Gases and Vacuum Alarms.
- L. SECTION 22 63 00, GAS SYSTEMS FOR LABORATORY AND HEALTHCARE FACILITIES: Laboratory and Healthcare Gas Piping and Equipment:

1.3 QUALITY ASSURANCE

- A. Installation and Start-up: The manufacturer will provide factory authorized representatives to review installation and perform initial start up of system.
- B. Contractor shall include with submittals an affidavit attesting to compliance with all relevant paragraphs of NFPA 99 most recent edition. Personnel assembling medical vacuum and WAGD system shall meet NFPA 99 5.1.10.10.11 "Qualification of Installers" and hold medical gas endorsements as under ASSE 6010. The Contractor shall furnish documentation attesting that all installed piping materials were purchased cleaned and complied with the requirements of NFPA 99 5.1.10.1 and 5.1.10.2. Electrical Control systems and Medical vacuum Alarms are to be UL listed as assemblies with label affixed. Medical vacuum and WAGD controls are to be wired in accordance with NEC.
- C. Equipment Installer: The equipment installer shall show documentation proving that the personnel installing the equipment meet the standards set by the American Society of Sanitary Engineers (ASSE) 6010 Professional Qualification Standards for Medical Gas System Installers. Show technical qualifications and previous experience in installing

- medical gas equipment on three similar projects. Submit names and addresses of referenced projects. The equipment install shall perform the following coordination functions:
1. Coordinate with other trades to ensure timely installations and avoid conflicts and interferences.
 2. Work with the metal stud partition installer and/or mason to ensure anchors, sleeves and similar items are provided in sufficient time to avoid delays; chases and openings are properly sized and prepared.
 3. Coordinate with VA to ensure medical vacuum inlets, whether owner supplied or contractor supplied, in walls, ceiling and all equipment is provided by the same Medical Vacuum Equipment Manufacturer satisfactory to the owner.
 4. The contractor shall coordinate with the Medical Vacuum System
 5. Verifier to deliver a complete, tested medical gas installation ready for owner's use.
- D. Equipment Supplier: The Equipment supplier shall demonstrate evidence of installing equivalent product at three installations similar to this project that has been in satisfactory and efficient operation for three years. Names and addresses where the product is installed shall be submitted for verification.
- E. Medical Gas System Testing Organization: The Medical vacuum verifier shall show documentation proving that the medical gas verifier meet the standards set by the American Society of Sanitary Engineers (ASSE) 6010 Professional Qualification Standards for Medical Gas System Verifiers. The testing shall be conducted by a party technically competent and experienced in the field of medical gas pipeline testing. Such testing shall be performed by a party other than the installing contractor.
- F. Names of three projects where testing of vacuum systems has been performed by the testing agency shall be provided. The name of the project, names of such persons at that project who supervised the work for the project owner, or who accepted the report for the project owner, and a written statement that the projects listed required work of similar scope to that set forth in this specification shall be included in the documentation.
- G. The testing agency's detailed procedure which will be followed in the testing of this project shall be submitted. In the testing agency's procedure documentation, include details of the testing sequence, procedures for cross connection tests, outlet function tests, alarm tests, purity tests, etc., as required by this specification. For purity test procedures, data on test methods, types of equipment to be used, calibration sources and method references shall be submitted.

- H. Installation and Start-up: The manufacturer shall provide factory authorized representatives to review the installation and perform the initial startup of the system. The factory authorized representatives shall submit a report to the construction administrator and to the Contractor. The Contractor shall make all corrections identified by the factory authorized representative.
- I. Certification: The Final inspection documentation shall include all test results, the names of individuals performing work for the testing agency on this project, detailed procedures followed for all tests, and a certification that all results of tests were within limits allowed by this specification.
- J. The installing contractor shall maintain as-built drawings of each completed phases for verification; and, shall provide the complete set at the time of final systems certification testing, for certification by the Third Party Testing Company. As-built drawings shall be provided, and a copy of them on Auto-Cad version (R-14 or later) provided on compact disk.

1.4 SUBMITTALS

- A. Submit as one package in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturer's Literature and Data:
 - 1. Complete specifications for the product intended to be installed, dimensional drawings, and wiring schematics.
 - 2. Package drawing indicating package style, dimensions when complete, method of disassembly and sizes of subsections for rigging and installation.
 - 3. Piping.
 - 4. Valves.
 - 5. Inlet and outlet cocks
 - 6. Valve cabinets.
 - 7. Gages.
 - 8. Station inlets, and rough in assemblies.
 - 9. Ceiling services.
 - 10. Alarm controls and panels.
 - 11. Vacuum switches.
 - 12. Vacuum bottle brackets.
- C. Station Inlets: A letter from manufacturer shall be submitted stating that inlets are designed and manufactured to comply with NFPA 99. Inlet shall bear label of approval as an

assembly, of Underwriters Laboratories, Inc., or Associated Factory Mutual Research Corporation. In lieu of above labels, certificate may be submitted by a nationally recognized independent testing laboratory, satisfactory to the Contracting Officer, certifying that materials, appliances and assemblies conform to published standards, including methods of tests, of above organizations.

- D. Certification: The completed systems have been installed, tested, purged and analyzed in accordance with the requirements of this specification.
- E. A notarized affidavit from the verifier stating that the verifier undertakes to verify this project and thus agrees to disqualify themselves from supplying any equipment which will be included in the scope of their verification. No verifier who supplies equipment shall be permitted to verify that equipment. Statement declaring that the vacuum system manufacturer has no fiduciary interest in the verifier and that the verifier is not an agent or representative of the vacuum system manufacturer. Statement declaring that the contractor has no fiduciary interest in the third party verifier and that the third party verifier has no fiduciary interest in the contractor.

1.5 TRAINING

- A. The services of a competent instructor shall be provided for not less than two four-hour periods for instructing personnel in the operation and maintenance of the vacuum systems, on the dates requested by COTR.
- B. The other training requirements specified in Section 01 00 00, GENERAL REQUIREMENTS shall be coordinated with the above paragraph

1.6 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the test by the basic designation only.
- B. American National Standards Institute (ANSI):
 - A13.1-2007Scheme for Identification of Piping Systems
 - B16.22-01 (R2005)Wrought Copper and Bronze Solder-Joint Pressure Fittings
 - B40.1-(2006)..... Pressure Gauges and Gauge Attachments
- C. American Society for Testing and Materials (ASTM):
 - B819-00Standard Specification for Seamless Copper Tube for Medical Gas Systems
- D. American Society of Mechanical Engineers (ASME):
 - Section IX-04.....Welding and Brazing Qualifications

- E. American Welding Society (AWS):
 - AWS A5.8/A5.8M-2004 Brazing Filler Metal
 - AWS B2.2-91.....Standard for Brazing Procedure and Performance Qualification
(Modified per NFPA 99)
- F. Compressed Gas Association (CGA):
 - P-9-92.....Inert Gases Argon, Nitrogen and Helium
- G. National Electrical Manufacturers Association (NEMA):
 - ICS-6-(1993, R 2006) ...Industrial Controls and Systems Enclosures
- H. National Fire Protection Association (NFPA):
 - 70(2009).....National Electric Code
 - 99-2009Health Care Facilities with 2005 errata
- I. United States Pharmacopoeia XXI/National Formulary XVI (USP/NF)
- J. Manufacturing Standardization Society (MSS):
 - MSS-SP-72-99Ball Valves With Flanged or Butt Welding For General Purpose
 - MSS-SP-110-96Ball Valve Threaded, Socket Welding, Solder Joint, Grooved
and Flared Ends
 - MSS-SP-73-03Brazing Joints for Copper and Copper Alloy Solder Pressure
Fittings

1.7 WARRANTY

- A. Warranty will be expressly complete, include all components of the system and be the responsibility of the vacuum system manufacturer of record only. Warranties limiting the responsibility of the vacuum system for any system component or which pass through to another manufacturer are not acceptable.
- B. Warranties shall include on site repairs including travel, labor and parts. Warranties requiring return of equipment for adjustment are not acceptable.

1.8 MAINTENANCE SUPPORT

- A. The medical vacuum equipment manufacturer shall demonstrate a national factory direct service capability able to perform major overhauls. The medical vacuum equipment manufacturer shall offer factory direct preventative maintenance contract for the owner's consideration. The medical vacuum equipment manufacturer shall offer formal maintenance training courses.

PART 2 - PRODUCTS

2.1 GENERAL PRODUCT REQUIREMENTS

- A. One Medical Vacuum Equipment Manufacturer shall supply the medical vacuum system(s) and equipment to include outlets, valves and gauges, valve boxes, alarm panels, manifolds, medical air, instrument air, vacuum and WAGD sources.

2.2 PIPING

- A. Copper Tubing: Copper tubing shall be type "K" or "L", ASTM B819, seamless copper tube, hard drawn temper, with wrought copper fittings conforming to ANSI B16.22 or brazing fittings complying with MSS SP-73. The copper tubing size designated reflects nominal inside diameter. All tubing and fittings shall be labeled "ACR/OXY", "OXY", "OXY/MED", "ACR/MED", or "MED".
- B. Brazing Alloy: The brazing alloy shall comply with AWS A5.8, Classification BCuP, greater than 537 °C (1000 °F) melting temperature. Flux shall be strictly prohibited for copper to copper connections.
- C. Screw Joints: Screw joints shall use polytetrafluoroethylene (teflon) tape.
- D. Galvanized Steel: Galvanized steel shall only be used for the discharge from the vacuum producer. The galvanized steel vacuum discharge pipe and fittings shall comply with the following:
 - 1. Pipe: The galvanized steel pipe shall comply with ASTM A53, standard weight.
 - 2. Fittings: The fittings shall comply with the following
 - a. Flexible groove, malleable iron, ASTM A47, or ductile iron, ASTM A536.
 - b. Malleable iron screwed, ANSI B16.3.
- E. Memory metal couplings shall have temperature and pressure ratings not less than that of a brazed joint.
- F. Piping identification labels shall be applied at time of installation in accordance with current NFPA. Supplementary color identification shall be in accordance with CGA Pamphlet C-9.
- G. Special Fittings: The following special fittings shall be permitted to be used in lieu of brazed joints:
 - 1. Memory-metal couplings having temperature and pressure ratings not less than that of a brazed joint.
 - 2. Listed or approved metallic gas tube fittings that, when made up, provide a permanent joint having the mechanical, thermal, and sealing integrity of a brazed joint.
 - 3. Dielectric fittings where required by the manufacturer of special medical equipment to electrically isolate the equipment from the piping distribution system.

4. Axially swaged, elastic strain preload fittings providing metal to metal seal having pressure and temperature ratings not less than that of a brazed joint and when complete are permanent and non-separable.

2.3 EXPOSED LABORATORY AND HEALTHCARE VACUUM PIPING

- A. Finished Room: Use full iron pipe size chrome plated brass piping shall be used for exposed laboratory and healthcare vacuum piping connecting fixtures, casework, cabinets, equipment and reagent racks when not concealed by apron including those furnished by the Government or specified in other sections.
 1. Pipe: Fed. Spec. WW-P-351, standard weight.
 2. Fittings: Fittings shall comply with ANSI B16.15 cast bronze threaded fittings with chrome finish, (125 and 250).
 3. Nipples: Nipples shall comply with ASTM B 687, Chromium-plated.
 4. Unions: Unions shall comply with Mss SP-72, SP-110, Brass or Bronze with chrome finish. Unions 65 mm (2-1/2 inches) and larger shall be flange type with approved gaskets.
 5. Valves: Valves shall comply with Mss SP-72, SP-110, Brass or bronze with chrome finish.

2.4 VALVES

- A. Ball: Ball valves shall be in line, other than zone valves in cabinets.
 1. Sixty five millimeter or DN65 (2 1/2 inches) and smaller: Ball valves shall be bronze/ brass body, Fed. Spec. MSS SP72 & SP 110 , Type II, Class 150, Style 1, with tubing extensions for brazed connections, full ported, three piece or double union end connections, teflon seat seals, full flow, 4125 kPa (600 psi) WOG minimum working pressure, with locking type handle.
 2. Eighty millimeter or DN80 to 100 millimeter or DN100 (3" to 4" inches): Ball valves shall be bronze/ brass body, Fed. Spec. MSS SP72 & SP 110, Type II, Class 150, Style 1 with tubing extensions brazed to flanges, full ported, three piece, double seal, teflon seals, full flow, 4125 kPa (600 psi) WOG minimum working pressure, with locking type handle.
- B. Check:
 1. Check valves eighty millimeters (DN80) (3 inches) and smaller: brass and Bronze body, straight through design for minimum pressure drop, spring loaded, self aligning with teflon cone seat, vibration free, silent operation, supplied NPT female threads at

each end with flow direction arrow permanently cast into, 2750 kPa (400 psi) WOG minimum working pressure.

2. One hundred millimeter or DN100 (4 inches) and larger check valves shall be iron body, bronze trim, swing type, vertical or horizontal installation, flange connection, 1025 kPa (150 psi) WSP.
- C. Zone valve in cabinet shall be ball valve with bronze/ brass body, double seal, three piece or double union end connections, replaceable teflon seat seals, teflon stem seal, 4125 kPa (600 psi) WOG, cold, non shock gas working pressure or vacuum service to 29 inch Hg, blowout proof stem, one quarter turn of handle to completely open or close. Tubing extensions, factory brazed, pressure tested, cleaned for oxygen service shall be provided. A 3 mm (1/8 inch) NPT gauge port shall be provided for a 50mm (2 inch) diameter monitoring gauge downstream of the shut off valve. Zone valves shall be securely attached to the cabinet and provided with type-K copper tube extensions for making connection to system piping outside the cabinet. Zone valves shall be products of one manufacturer, and uniform throughout in pattern, overall size and appearance. Trim with color coded plastic inserts or color coded stick on labels. Valves shall be in cabinets such that cover window cannot be in place when any valve is in the closed position. Color coding for identification plates and labels is as follows:

SERVICE LABEL	IDENTIFICATION COLORS	MFG. STD. CLR.
MEDICAL VACUUM	Black letters on white background	WHITE
Evacuation (Waste Gas)	White letters on purple background	PURPLE

2.5 VALVE CABINETS

- A. Valve cabinets shall be flush mounted, commercially available item for use with medical gas services, constructed from steel not lighter than 1.3 mm (18 gage) steel or extruded aluminum not lighter than 1.9 mm (14 gage). The valve cabinets shall be rigidly assembled, of adequate size to accommodate all valve(s) and fittings indicated. Holes shall be predrilled to receive pipe connections. These pipe connections shall be made outside of the valve box. Anchors shall be provided to secure cabinet to wall construction. Openings in cabinet shall

- be sealed to be dust tight. Bottom of cabinet shall be located 1375 mm (4 foot 6 inches) above finished floor.
- B. Engraved rigid plastic identification plate shall be mounted on the wall above or adjacent to the cabinet. Color code identification plate to match gas identification colors as indicated above. Identification plate shall be clearly visible at all times. Inscriptions shall be provided on plate to read in substance: "VALVE CONTROL SUPPLY TO ROOMS." The final wording must be approved by the VA project manager.
 - C. Cover plate: The cover plate shall be fabricated from 1.3 mm (18 gage) sheet metal with satin chromed finish, extruded anodized aluminum, or .85 mm (22 gage) stainless steel. A cover window shall be provided of replaceable plastic, with a corrosion resistant device or lever secured to window for emergency window removal. The following shall be permanently painted or stenciled on window: "FOR EMERGENCY SHUT-OFF VALVES ONLY, SHUT OFF VALVES FOR PIPED GASES", or equivalent wording. The valve cabinet shall be configured such that it is not possible to install window with any valve in the closed position. Each valve shall have a pressure gauge upstream of valve and this pressure gauge shall be inside valve box.
 - D. Cabinets and isolation valves shall be located and piped as shown, and at a minimum, so as to allow the isolation of each smoke compartment separately. Each cabinet shall serve no more than one smoke compartment.

2.6 GAGES

- A. Vacuum Gages:
 - 1. For vacuum line adjacent to source equipment the vacuum gages shall comply with ANSI B40.1, vacuum gage type, size 115 mm (4-1/2 inches), gage listed for vacuum, accurate to within 2-1/2 percent, with metal case. The vacuum gage range shall be 0 to -100 kPa (0-30 inches Hg). Dial graduations and figures shall be black on a white background, or white on a black background. Label shall be for vacuum service. A gage cock shall be installed. Compound gages shall be installed for Vacuum system.
 - 2. For vacuum service upstream of main shutoff valve: A 40 mm (1-1/2 inch) diameter gage shall be provided with steel case, bourdon tube and brass movement, dial range 0 to -100 kPa (0-30 inches Hg). Compound gages shall be provided for Vacuum system.

2.7 STATION INLETS

- A. Vacuum Station inlets:

1. Station inlets shall be for designated service, consisting of a quick coupler, quick disconnect type with inlet supply tube.
2. The outlet station shall be made, cleaned, and packaged to NFPA 99 standards and shall be UL listed and CSA certified.
3. A coupler shall be provided that is non-interchangeable with other services, and leak proof under three times normal working pressure.
4. Each station inlet shall be equipped with an automatic valve to conform with NFPA 99. Valves shall be placed in the assembly to provide easy access after installation for servicing and replacement, and to facilitate line blow-out, purging, and testing.
5. Each inlet shall be securely fastened to rough-in to prevent floating and provide each with a capped stub length of 6 mm (1/4-inch) (10 mm outside diameter) (3/8-inch outside diameter) tubing for connection to supply tubing. Stub tubing shall be labeled for appropriate service. Rough in shall be indexed and gas specified latch valve with non-interchangeable safety keying with color coded gas service identification.
6. Rough-in kits and test plugs for Prefabricated Bedside Patient Units (PBPU) shall be furnished under this specification but installed by manufacturer of PBPU's before initial test specified herein.
7. Completion kits (valve body and face plate) shall be installed for the remainder of required tests.

2.8 STATION INLET ROUGH-IN

- A. Station inlet rough in shall be Flush mounted, and protected against corrosion. Rough in shall be anchored securely to unit or wall construction.
- B. The modular cover plate shall be constructed from die cast plate, two piece .85 mm (22 gage) stainless steel or 1.6 mm (16 gage) chromium plated metal, secured to rough in with stainless steel or chromium plated countersunk screws. The latch mechanism shall be designed for one handed, single thrust mounting and one handed fingertip release of secondary equipment.
- C. Cover Plate for Prefabricated Bedside Patient Units (PBPU) shall be One piece with construction and material as indicated for modular cover plate.
- D. Permanent, metal or plastic, identification plates shall be provided securely fastened at each inlet opening, with inscription for appropriate service using color coded letters and background. Metal plates shall have letters embossed on baked on enamel background. Color coding for identification plates is as follows:

SERVICE LABEL	IDENTIFICATION PLATE COLORS
---------------	-----------------------------

SERVICE LABEL	IDENTIFICATION PLATE COLORS
MEDICAL VACUUM	Black letters on white background
EVACUATION (Waste Gas)	White letters on purple background

2.9 VACUUM SWITCHES

- A. Vacuum switches shall be general purpose, contact or mercury type, allowing both high and low set points, with contact type provided with a protective dust cover. The vacuum switch shall have an adjustable range set by inside or outside adjustment. Vacuum switches shall activate when indicated by alarm requirements. One orifice nipple (or DISS demand check valve) shall be used for each sensor switch.

2.10 VACUUM BOTTLE BRACKET

- A. Vacuum bottle bracket shall be single plate of one piece, .85 mm (22 gage) stainless steel or 1.6 mm (16 gage) chromium plated metal or aluminum, finish matching cover of adjoining vacuum inlet. All components shall be of same material as plate and assembly anchored securely. The bracket shall be provided and plastic vacuum bottle holder for each vacuum wall inlet.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. All installation shall be performed in strict accordance with NFPA 99 5.1.10. Brazing procedures shall be as detailed in NFPA 99 5.1.10.5. Brazing shall be performed only by brazers qualified under NFPA 99 5.1.10.11. Where piping runs underground, the installation shall be made in accordance with NFPA 99 5.1.10.10.5.
- B. Contractor shall furnish 4 inch high concrete housekeeping pads. The contractor shall furnish inertia bases in lieu of housekeeping pads where the equipment installed is not factory isolated by the manufacturer. Anchor bolts shall be cast into bases
- C. Cast escutcheon shall be installed with set screw at each wall, floor and ceiling penetration in exposed finished locations and within cabinets and millwork.
- D. Open ends of tube shall be capped or plugged at all times or otherwise sealed until final assembly.
- E. Piping shall be cut square and accurately with a tube cutter (sawing not permitted) to measurements determined at place of installation. the tubing shall be reamed to remove burrs, being careful not to expand tube, and so no chips of copper remain in the tube. The tubing shall be worked into place without springing or forcing. The tubing shall be bottomed

- in socket so there are no gaps between tube and fitting. Care shall be exercised in handling equipment and tools used in cutting or reaming of tube to prevent oil or grease from being introduced into the tubing. Where contamination has occurred, material shall be no longer suitable for vacuum service and new, sealed tube sections used..
- F. Piping shall be supported with pipe trays or hangers at intervals as shown on the drawings or as defined in NFPA 99 Table 5.1.10.10.4.5. Piping shall not be supported by other piping. Isolation of copper piping from dissimilar metals shall be of a firm, positive nature. Duct tape is not acceptable as an isolation material..
 - G. Valves and other equipment shall be rigidly supported to prevent strain on tube or joints.
 - H. Piping exposed to physical damage shall be protected.
 - I. During any brazing operation, the interior of the pipe shall be purged continuously with oil free, dry nitrogen NF, following the procedure in NFPA 99 5.1.10.5.5. At the completion of any section, all open pipe ends shall be capped using an EXTERNAL cap. The flow of purged gas shall be maintained until joint is cool to touch. The use of flux is prohibited when making of joints between copper to copper pipes and fittings.
 - J. Threaded joints in piping systems shall be avoided whenever possible. Where unavoidable, make up the male threads with polytetrafluoroethylene (such as Teflon) tape. Liquid sealants shall not be used.
 - K. Tubing shall not be bent. Fittings shall be used in all change of direction or angle.
 - L. After installation of the piping, but before installation of the outlet valves, blow lines clear using nitrogen NF.
 - M. Ceiling column assembly shall be supported from heavy sub-mounting castings and furnished with the unit as part of rough in. Ceiling columns shall be anchored with 15 mm (1/2-inch) diameter bolts attached to angle iron frame supported from structural ceiling.
 - N. Two 25 mm (1 inch) minimum conduits shall be provided from ceiling column assembly to the adjacent corridor, one for mass spectrometer tubing and wiring and one for monitor wiring, and for connection to signal cabling network.
 - O. Pressure and vacuum switches, transmitter and gauges shall be installed to be easily accessed, and provide access panel where installed above plaster ceiling. Pressure switch and sensors shall be installed with orifice nipple between the pipe line and switches/sensors.
 - P. Pipe labeling shall be applied during installation process and not after installation is completed. Size of legend letters shall be in accordance with ANSI A13.1.

- Q. After initial leakage testing is completed, the piping shall be allowed to remain pressurized with testing gas until testing agency performs final tests.
- R. Penetrations:
 - 1. Fire Stopping: Where pipes pass through fire partitions, fire walls, smoked partitions, or floors, fire stopping shall be installed that provides an effective barrier against the spread of fire, smoke and gases as specified in Section 07 84 00, FIRESTOPPING, Clearances between raceways and openings with the fire stopping material shall be completely filled and sealed..
 - 2. Water proofing: At floor penetrations, clearances shall be completely sealed around the pipe and made watertight with sealant as specified in Section 07 92 00, JOINT SEALANTS.
- S. A vacuum gage 40mm (1 1/2 inch) diameter line shall be installed downstream of each zone valve in cabinets.
- T. Zone valves shall be provided in cabinets where indicated and outside each Operating Room and a minimum one zone valve assembly for each 18 outlets.
- U. Piping shall be labeled with name of service, identification color and direction of flow. Where non-standard pressures are piped, pressure shall be labeled. Labels shall be placed at least once every 20 feet of linear run or once in each story (whichever is more frequent). A label shall additionally be placed immediately on each side of all wall or floor penetrations. Pipe labels shall be self adhesive vinyl type or other water resistant material with permanent adhesive colored in accordance with NFPA 99 Table 5.1.11 and shall be visible on all sides of the pipe. Each master alarm signal shall be labeled for function after ring out. Each zone valve shall be labeled and each area alarm labeled for the area of control or surveillance after test. Labels shall be permanent and of a type approved by the VAMC
- V. Alarms and valves shall be labeled for service and areas monitored or controlled. Coordinate with the VAMC for final room or area designations. Valves shall be labeled with name and identification color of the gas and direction of flow

3.2 INSTALLER TESTING

- A. Prior to declaring the lines ready for final verification, the installing contractor shall strictly follow the procedures for verification as described in NFPA 99 5.1.12.2 and attest in writing over the notarized signature of an officer of the installing company the following:
 - 1. That all brazing was conducted by brazers qualified to ASSE 6010 and holding current medical gas endorsements.

2. That all brazing was conducted with nitrogen purging. (Procedure per NFPA 99 5.1.10.5.5).
 3. That the lines have been blown clear of any construction debris using oil free dry nitrogen or air are clean and ready for use. (Procedure per NFPA 99 5.1.12.2.2).
 4. That the assembled piping, prior to the installation of any devices, maintained a test pressure 1 1/2 times the standard pressures listed in NFPA 99 Table 5.1.11 without leaks. (Procedure per NFPA 99 5.1.12.2.3).
 5. That after installation of all devices, the pipeline was proven leak free for 24hours at a pressure 20% above the standard pressures listed in NFPA 99 Table 5.1.11. (Procedure per NFPA 99 5.1.12.2.2.6)
 6. That the systems have been checked for cross connections and none were found. (Procedure per NFPA 99 5.1.12.2.4)
 7. That the manufacturer has started up all medical air compressors, medical vacuum pumps WAGD producers, liquid oxygen system(s) and manifolds, and that they are in operating order.
- B. Four originals of the affidavit, shall be distributed; (1) to the engineer, (1) to the owners representative, (1) to the general contractor and (1) to the verifier.

3.3 VERIFIER TESTING

- A. Prior to handing over the systems to VAMC, the contractor shall retain a Verifier acceptable to the engineer and owner who shall follow strictly the procedures for verification as described in NFPA 99 5.1.12.3 and provide a written report and certificate bearing the notarized signature of an officer of the verification company which contains at least the following:
1. A current ACORD insurance certificate indicating professional liability coverage in the minimum amount of \$1 Million per occurrence, and general aggregate liability in the minimum amount of \$1 Million, valid and in force when the project is to be verified. General liability insurance is not alone acceptable.
 2. An affidavit bearing the notarized signature of an officer of the verification company stating that the verification company is not the supplier of any equipment used on this project or tested in this report and that the verification contractor has no relationship to, or pecuniary interest in, the manufacturer, seller, or installer of any equipment used on this project or tested in this report

3. A listing of all tests performed, listing each source, outlet, valve and alarm included in the testing.
4. An assertion that all tests were performed by a Medical Vacuum System Certified Medical Gas or vacuum Verifier or by individuals qualified to perform the work and holding valid qualifications to ASSE 6030 and under the immediate supervision a Verifier. Include the names, credential numbers and expiration dates for all individuals working on the project.
5. A statement that equipment used was calibrated at least within the last six months by a method traceable to a National Bureau of Standard Reference and enclosing certificates or other evidence of such calibration(s). Where outside laboratories are used in lieu of on site equipment, those laboratories shall be named and their original reports enclosed.
6. A statement that where and when needed, equipment was re calibrated during the verification process and describing the method(s) used.
7. A statement that the systems were tested and found to be free of debris to a procedure per NFPA 99 5.1.12.3.7.
8. The flow from each outlet when tested to a procedure per NFPA 99-5.1.12.3.10.
9. A statement that the systems were tested and found to have no cross-connections to a procedure per NFPA 99 5.1.12.3.3.
10. A statement that the systems were tested and found to be free of contaminants to a procedure per NFPA 99 5.1.12.3.8 except that the purity standard shall be 2 ppm difference for halogenated hydrocarbons and 1 ppm total hydrocarbons (as methane).
11. Statement that all local signals function as required under NFPA 99 5.1.3.4.7 and as per the relevant NFPA 99 sections relating to the sources.
12. A listing of local alarms, their function and activation per NFPA 99 5.1.12.3.14.
13. A listing of master alarms, their function and activation, including pressures for high and low alarms per NFPA 99 5.1.12.3.5.2.
14. A listing of area alarms, their function and activation pressures per NFPA 99 5.1.12.3.5.3.
15. A statement that the sources include all alarms required by NFPA 99 Table A.5.1.9.5.
16. The concentration of each component of NFPA 99 Table 5.1.12.3.12 in the medical air after 24hours of operation of the medical air source.
17. The concentration of each gas at each outlet as specified in NFPA 99 5.1.12.3.11.
18. A statement that all valves and alarms are accurately labeled as to zone of control.

19. Provide four originals of this affidavit, and report, distributed; (1) to the engineer, (1) to the owner's representative, (1) to the general contractor and (1) to the installing contractor.
- B. Perform and document all cross connection tests, labeling verification, supply system operation, and valve and alarm operation tests as required by, and in accordance with, current NFPA and the procedures set forth in pre-qualification documentation.
- C. Verify that the systems, as installed, meet or exceed the requirements of current NFPA, this specification, and that the systems operate as required.
- D. Piping purge test: For each positive pressure gas system, verify cleanliness of piping system. Filter a minimum of 35 cubic feet (1000 liters) of gas through a clean white 0.45 micron filter at a minimum velocity of 3.5 scfm (100 Lpm). Filter shall show no discoloration, and shall accrue no more than 0.1 mg of matter. Test each zone at the outlet most remote from the source. Perform test with the use of an inert gas as described in CGA P-9.
- E. Inlet flow test:
 1. Test all inlets for flow. Perform test with the use of an inert gas as described in CGA P-9.
 2. Needle valve vacuum inlets must draw no less than 1.0 scfm with adjacent inlet flowing, at a dynamic inlet pressure of 12-inches Hg, and a static vacuum of 15-inches Hg.
 3. Vacuum inlets must draw no less than 85 Lpm (3.0 scfm) with adjacent inlet flowing, at a dynamic inlet pressure of 40 kPa (12-inches Hg), and a static vacuum of 50 kPa (15-inches Hg).
 4. Anesthesia evacuation inlets must draw no less than 1 L/mm (1.0 scfm) at a dynamic inlet pressure of 40 kPa (12-inches Hg), and a static vacuum of 50 kPa (15-inches Hg).

3.4 CONNECTION TO EXISTING LABORATORY VACUUM SYSTEM:

- A. Contactor shall test the existing system for hydrocarbons, dew point, etc. If problems are present, the resident engineer (RE) would notify the facility of the results. The facility would then make the necessary repairs and/ or maintenance.
- B. Double Shut-off valves shall be installed at the connection of new line to existing line.
- C. Time for shut-down of the existing vacuum system shall be coordinated with the VA medical center.
- D. Prior to any work being done, new pipeline shall be checked for particulate or other forms of contamination.

- E. Insure that the correct type of pipe tubing and fittings are being used.
- F. A spot check of the existing pipelines shall be made in the facility to determine the level of cleanness present.
- G. The tie-in shall be made as quickly as possible. A nitrogen purge is not required since this would require another opening in the pipe.
- H. After the tie-in is made and allowed to cool, slowly bleed the source Vacuum back into the pipeline. Test the work area for leaks with soapy water and repair any leaks.
- I. After all leaks, if any, are repaired and the line is fully recharged, perform blow down and testing. Open the zone that is closest to the main to the system, access the closest outlet to the work, and blow the main through the inlet. After the inlet blows clear into a white cloth, make an additional check at a zone most distant from the work. Perform all required current NFPA tests after connection.

--- E N D ---

SECTION 22 63 00
GAS SYSTEMS FOR LABORATORY AND HEALTHCARE FACILITIES

PART 1 - GENERAL

1.1 DESCRIPTION

- A. Central Laboratory and Healthcare Gas Systems: Consisting of oxygen, , and compressed air services; complete, ready for operation, including all necessary piping, fittings, valves, cabinets, station outlets, rough-ins, gages, alarms including low voltage wiring, accessories, connections and equipment. Match existing station outlet and inlet terminal connections.
- B. Laboratory and healthcare gas system alarm wiring from equipment to alarm panels.

1.2 RELATED WORK

- A. Sealing around pipe penetrations to maintain the integrity of time rated construction: Section 07 84 00, FIRESTOPPING.
- B. Sealing around pipe penetrations through the floor to prevent moisture migration: Section 07 92 00, JOINT SEALANTS.
- C. General requirements and items common to more than one section of Division 22. Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.
- D. Alarm interface with ECC. Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC.
- E. Conduit: Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS.
- F. Control wiring: Section 26 05 21, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES (600 VOLTS AND BELOW).
- G. Electrical wiring and accessories: Section 26 27 26, WIRING DEVICES.
- H. Electric motors: Section 22 05 12, GENERAL MOTOR REQUIREMENTS FOR PLUMBING EQUIPMENT.
- I. Motor starters: Section 26 29 11, LOW-VOLTAGE MOTOR STARTERS.
- J. Prefabricated bedside patient units: Section 10 25 13, PATIENT BED SERVICE WALLS.
- K. Vacuum Piping and Equipment: SECTION 22 62 00, VACUUM SYSTEMS FOR LABORATORY AND HEALTHCARE FACILITIES

1.3 QUALITY ASSURANCE

- A. Materials and Installation: In accordance with NFPA 99, (2009) and as specified.
- B. Equipment Installer: Show technical qualifications and previous experience in installing laboratory and healthcare equipment on three similar projects. Submit names and addresses

- of referenced projects. Installers shall meet the qualifications of ANSI/ASSE Standard 6010.
- C. Equipment Supplier: Show evidence of equivalent product installed at three installations similar to this project that has been in satisfactory and efficient operation for three years. Submit names and addresses where the product is installed.
 - D. Laboratory and healthcare System Testing Organization: The testing shall be conducted by a party technically competent and experienced in the field of laboratory and healthcare pipeline testing. Testing and systems verification shall be performed by personnel meeting the qualifications of ANSI/ASSE Standard 6030. Such testing shall be performed by a party other than the installing contractor.
 - E. Provide names of three projects where testing of medical or laboratory gases systems has been performed by the testing agency. Include the name of the project, names of such persons at that project who supervised the work for the project owner, or who accepted the report for the project owner, and a written statement that the projects listed required work of similar scope to that set forth in this specification.
 - F. Submit the testing agency's detailed procedure which will be followed in the testing of this project. Include details of the testing sequence, procedures for cross connection tests, outlet function tests, alarm tests, purity tests, etc., as required by this specification. For purity test procedures, include data on test methods, types of equipment to be used, calibration sources and method references.
 - G. Certification: Provide documentation prior to submitting request for final inspection to include all test results, the names of individuals performing work for the testing agency on this project, detailed procedures followed for all tests, and a certification that all results of tests were within limits allowed by this specification.
 - H. Installing contractor shall maintain as-built drawings of each completed phases for verification; and, shall provide the complete set at the time of final systems certification testing, for certification by the Third Party Testing Company. As-built drawings shall be provided on prints and in digital format. The digital format shall be in the native CAD system required for the project design. Should the installing contractor engage the testing company to provide as-built or any portion thereof, it shall not be deemed a conflict of interest or breach of the 'third party testing company' requirement.

- I. “Hot taps” are not permitted for operating medical oxygen systems. Methods for connection and extension of active and pressurized medical gas systems without subsequent medical gas testing and verification are not allowed.

1.4 SUBMITTALS

- A. Submit as one package in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturer's Literature and Data:
 - 1. Piping.
 - 2. Valves.
 - 3. Inlet and outlet cocks
 - 4. Valve cabinets.
 - 5. Gages.
 - 6. Station outlets and rough-in assemblies.
 - 7. Alarm controls and panels.
 - 8. Pressure Switches.
- C. Station Outlets: Submit letter from manufacturer stating that outlets are designed and manufactured to comply with NFPA 99. Outlet shall bear label of approval as an assembly, of Underwriters Laboratories, Inc., or Associated Factory Mutual Research Corporation. In lieu of above labels, certificate may be submitted by a nationally recognized independent testing laboratory, satisfactory to the Contracting Officer, certifying that materials, appliances and assemblies conform to published standards, including methods of tests, of above organizations.
- D. Certification: The completed systems have been installed, tested, purged, analyzed and verified in accordance with the requirements of this specification.

1.5 TRAINING

- A. Furnish the services of a competent instructor for not less than two four-hour periods for instructing personnel in the operation and maintenance of the laboratory and healthcare gas systems, on the dates requested by COTR.
- B. Coordinate with other requirements specified in Section 01 00 00, GENERAL REQUIREMENTS.

1.6 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the test by the basic designation only.

- B. American Society for Testing and Materials (ASTM):
 - B819-(R2006)Seamless Copper Tube for Medical Gas Systems
- C. American Society of Mechanical Engineers (ASME):
 - A13.1-07Scheme for Identification of Piping Systems
 - B16.22-01(R2005) Wrought Copper and Bronze Solder-Joint Pressure Fittings
 - B40.100 (2005)Pressure Gauges and Gauge Attachments Boiler and Pressure Vessel Code -
 - Section VIII-07Pressure Vessels, Division I
 - Section IX-07Welding and Brazing Qualifications
- D. American Welding Society (AWS):
 - AWS A5.8-04Brazing Filler Metal
 - AWS B2.2-91.....Standard for Brazing Procedure and Performance Qualification (Modified per NFPA 99)
- E. Compressed Gas Association (CGA):
 - C-9-04Standard Color Marking of Compressed Gas Cylinders
 - G-4.1 (2009).....Cleaning Equipment for Oxygen Service
 - G-10.1(2008)Nitrogen, Commodity
 - P-9-01.....Inert Gases Argon, Nitrogen and Helium
 - V-1-05Standard for Compressed Gas Cylinder Valve Outlet and Inlet Connections
- F. National Electrical Manufacturers Association (NEMA):
 - ICS-6-93(R2006)Industrial Controls and Systems Enclosures
- G. National Fire Protection Association (NFPA):
 - 99-2009Health Care Facilities
- H. United States Pharmacopoeia XXI/National Formulary XVI (USP/NF)
- I. Manufacturing Standardization Society (MSS):
 - MSS-SP-72-99Ball Valves With Flanged or Butt Welding For General Purpose
 - MSS-SP-110-96Ball Valve Threaded, Socket Welding, Solder Joint, Grooved and Flared Ends
 - MSS-SP-73-03Brazing Joints for Copper and Copper Alloy Solder Pressure Fittings

PART 2 - PRODUCTS

2.1 PIPING AND FITTINGS

- A. Copper Tubing: Type "K", ASTM B819, seamless copper tube, hard drawn temper, with wrought copper fittings conforming to ASME B16.22 or brazing fittings complying with MSS SP-73. Size designated reflecting nominal inside diameter. All tubing and fittings shall be labeled "ACR/OXY", "OXY", "OXY/MED", "ACR/MED", or "MED".
- B. Brazing Alloy: AWS A5.8, Classification BCuP, greater than 537 °C (1000 °F) melting temperature. Flux is strictly prohibited for copper-to-copper connections.
- C. Screw Joints: Polytetrafluoroethylene (teflon) tape.
- D. Memory metal couplings: Temperature and pressure rating shall not be less than that of a brazed joint.
- E. Apply piping identification labels at the time of installation in accordance with current NFPA. Apply supplementary color identification in accordance with CGA Pamphlet C-9.
- F. Special Fittings: The following special fittings shall be permitted to be used in lieu of brazed joints:
 - 1. Memory-metal couplings having temperature and pressure ratings joints not less than that of a brazed joint.
 - 2. Listed or approved metallic gas tube fittings that, when made up, provide a permanent joint having the mechanical, thermal, and sealing integrity of a brazed joint.
 - 3. Dielectric fittings where required by the manufacturer of special medical equipment to electrically isolate the equipment from the piping distribution system.
 - 4. Axially swaged, elastic strain preload fittings providing metal to metal seal having pressure and temperature ratings not less than that of a brazed joint and when complete are permanent and non-separable.

2.2 EXPOSED LABORATORY AND HEALTHCARE GASES PIPING

- A. Finished Room: Use full iron pipe size chrome plated brass piping for exposed laboratory and healthcare gas piping connecting fixtures, casework, cabinets, equipment and reagent racks when not concealed by apron including those furnished by the Government or specified in other sections.
 - 1. Pipe: Fed. Spec. WW-P-351, standard weight.
 - 2. Fittings: ASME B16.15 cast bronze threaded fittings with chrome finish, (125 and 250 PS1 Classes).
 - 3. Nipples: ASTM B 687, Chromium-plated.

4. Unions: Mss SP-72, SP-110, Brass or Bronze with chrome finish. Unions 65 mm (2-1/2 inches) and larger shall be flange type with approved gaskets.
5. Valves: Mss SP-72, SP-110, Brass or bronze with chrome finish.

2.3 VALVES

- A. Ball: In-line, other than zone valves in cabinets:
 1. Seventy five millimeter (2 1/2 inches) and smaller: Bronze/ brass body, Fed. Spec. MSS SP72 & SP 110 , Type II, Class 150, Style 1, with tubing extensions for brazed connections, full port, three-piece or double union end connections, teflon seat seals, full flow, 4125 kPa (600 psi) WOG minimum working pressure, with locking type handle, cleaned for oxygen use and labeled for intended service
 2. Eighty to one hundred millimeter (3-4 inches): Bronze/ brass body, Fed. Spec. MSS SP72 & SP 110, Type II, Class 150, Style 1 with tubing extensions brazed to flanges, full ported, three piece, double seal, teflon seals, full flow, 4125 kPa (600 psi) WOG minimum working pressure, with locking type handle, cleaned for oxygen use and labeled for intended service.
- B. Check:
 1. Eighty millimeter (3 inches) and smaller: Bronze/brass body, straight through design for minimum pressure drop, spring loaded, self aligning with teflon cone seat, vibration free, silent operation, supplied NPT female threads at each end with flow direction arrow permanently cast into, cleaned for oxygen use and labeled for intended service, 2750 kPa (400 psi) WOG minimum working pressure.
 2. One hundred millimeter (4 inches) and larger: Iron body, bronze trim, swing type, vertical or horizontal installation, flange connection, with flow direction arrow permanently cast into, cleaned for oxygen use and labeled for intended service, 1025 kPa (150 psi) WSP.
- C. Zone Valve in Cabinet: Ball valve, bronze/ brass body, double seal, three piece or double union end connections, replaceable teflon seat seals, teflon stem seal, 4125 kPa (600 psi) WOG, cold, non-shock gas working pressure service to 100 kPa (29 inch Hg), cleaned for oxygen use and labeled for intended service, blowout proof stem, one quarter turn of handle to completely open or close. Provide tubing extensions factory brazed, and pressure tested. Provide 3 mm (1/8 inch) NPT gauge port for a 50mm (2 inch) diameter monitoring gauge downstream of the shut off valve. Zone valves shall be securely attached to the cabinet and provided with type-K copper tube extensions for making connection to system piping outside

the cabinet. Zone valves shall be products of one manufacturer, and uniform throughout in pattern, overall size and appearance. Trim with color coded plastic inserts or color coded stick-on labels. Install valves in cabinets such that cover window cannot be in place when any valve is in the closed position. Color coding for identification plates and labels is as follows:

SERVICE LABEL	IDENTIFICATION COLORS	MFG. STD. CLR.
OXYGEN	White letters on green background	GREEN
NITROUS OXIDE	White letters on blue background	BLUE
NITROGEN	White letters on black background	BLACK
MEDICAL AIR	Black or white letters on yellow background	YELLOW
CARBON DIOXIDE	Black or white letters on gray background	GRAY

2.4 VALVE CABINETS

- A. Flush mounted commercially available item for use with laboratory and healthcare services, not lighter than 1.3 mm (18 gage) steel or 1.9 mm (14 gage) extruded aluminum, rigidly assembled, of adequate size to accommodate valve(s) and fittings. Punch or drill sides to receive tubing. Provide anchors to secure cabinet to wall construction. Seal openings in cabinet to be dust tight. Locate to of cabinet 1676 mm (5 foot 6 inches) above floor.
- B. Mount engraved rigid plastic identification plate on wall above or adjacent to cabinet. Color code identification plate to match gas identification colors as indicated above. Identification plate must be clearly visible at all times. Provide inscriptions on plate to read in substance: "VALVE CONTROL SUPPLY TO ROOMS."
- C. Cover plate: Fabricate from 1.3 mm (18 gage) sheet metal with satin chromed finish, extruded anodized aluminum, or .85 mm (22 gage) stainless steel. Provide cover window of replaceable plastic, with a corrosion resistant device or lever secured to window for emergency window removal. Permanently paint or stencil on window: CAUTION-CLOSE ONLY IN EMERGENCY, SHUT-OFF VALVES FOR PIPED GASES", or equivalent wording. Configure such that it is not possible to install window with any valve in the closed position. Each valve shall have gauge upstream of valve inside valve box.

- D. Cabinets and isolation valves shall be located and piped as shown, and at a minimum, so as to allow the isolation of each smoke compartment separately. No cabinet shall serve more than one smoke compartment.

2.5 GAGES

- A. Pressure Gages: Includes gages temporarily supplied for testing purposes.
 - 1. For line pressure use adjacent to source equipment: ASME B40.1, pressure gage, single, size 115 mm (4-1/2 inches), for compressed air,, vacuum and oxygen, accurate to within two percent, with metal case. Range shall be two times operating pressure. Dial graduations and figures shall be black on a white background, or white on a black background. Gage shall be cleaned for oxygen use, labeled for appropriate service, and marked "USE NO OIL". Install with gage cock.
 - 2. For all services downstream of main shutoff valve: Manufactured for oxygen use, labeled for the appropriate service and marked "USE NO OIL", 51 mm (2 inch) diameter gage with dial range 0-690 kPa (0-100 psi) for air and oxygen service , and 0-1.04 kg/ sq cm (0-30" HG) for vacuum service.

2.6 STATION OUTLETS

- A. For designated service, consisting of a quick coupler and inlet supply tube. Provide coupler that is non-interchangeable with other services, and leak proof under three times the normal working pressure. Equip each station outlet with an automatic valve and a secondary check valve to conform with NFPA 99. Equip each station inlet with an automatic valve to conform with NFPA 99. Place valves in the assembly to provide easy access after installation for servicing and replacement, and to facilitate line blow-out, purging, and testing. Fasten each outlet and inlet securely to rough-in to prevent floating and provide each with a capped stub length of 6 mm (1/4-inch) (10 mm outside diameter) (3/8-inch outside diameter) tubing for connection to supply. Identification of each gas service shall be permanently cast into the back plate and shall be visible through a transparent plastic guard. Label stub tubing for appropriate service. Rough-in kits and test plugs for Prefabricated Bedside Patient Units (PBPU) are furnished under this specification but installed by manufacturer of PBPU before initial test specified herein. Install completion kits (valve body and face plate) for the remainder of required tests.

2.7 STATION OUTLET ROUGH-IN

- A. Flush mounted, protected against corrosion. Anchor rough-in securely to unit or wall construction.

- B. Modular Cover Plate: Die cast back plate, two-piece .85 mm (22 gage) stainless steel or 1.6 mm (16 gage) chromium plated metal, with mounting flanges on all four sides, secured to rough-in with stainless steel or chromium plated countersunk screws.
- C. Cover Plate for Prefabricated Bedside Patient Units (PBPU): One-piece with construction and material as indicated for modular cover plate.
- D. Provide permanent, metal or plastic, identification plates securely fastened at each outlet and inlet opening, with inscription for appropriate service using color coded letters and background. Metal plates shall have letters embossed on baked-on enamel background. Color coding for identification plates is as follows:

SERVICE LABEL	IDENTIFICATION PLATE COLORS
OXYGEN	White letters on green background
NITROUS OXIDE	White letters on blue background
NITROGEN	White letters on black background
MEDICAL AIR	Black or white letters on yellow
CARBON DIOXIDE	White letters on gray background

2.8 ALARMS

- A. Provide all low voltage control wiring, except for wiring from alarm relay interface control cabinet to ECC, required for complete, proper functioning system, in conformance with Section 26 05 21, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES (600 VOLTS AND BELOW). Run wiring in conduit, in conformance with Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS.
 - 1. Vacuum Pump Malfunction Alarm: Pump system receives the following individual signals and sends a single consolidated pump malfunction alarm signal to master alarm.
 - a. High Temperature Shut down Alarm: Functions when exhaust air temperature exceeds 104 °C (220 °F), shutting down affected pump.
 - b. Lead Pump Fails to Start Alarm: Functions when lead pump fails to start when actuated causing lag pump to start.
 - c. Lag Pump In Use Alarm: Functions when the primary or lead vacuum pump is incapable of satisfying the demand. When three or more vacuum pumps are part

of the system, the lag pump in use alarm shall energize when the last vacuum pump has been signaled to start.

2. Instrument Air Dew Point High: Functions when the line pressure dew point is greater than -30 °C (-22 °F).
- B. Master Alarm Functions: Provide the following individual alarms at the master alarm panel.
1. Oxygen Alarms:
 - a. Liquid oxygen low level alarm: Functions when stored liquid oxygen reaches a predetermined minimum level.
 - b. Reserve switchover alarm: Functions when, or just before, reserve oxygen supply goes in operation.
 - c. Reserve low supply alarm: Functions when contents of cylinder reserve oxygen supply are reduced to one day's average supply; switch and contacts at the bulk tank control panel.
 - d. Reserve low pressure alarm: Functions when the gas pressure available in the liquid reserve oxygen supply is reduced below the pressure required to function properly.
 - e. Low pressure alarm: Functions when system pressure downstream of the main shutoff valve drops below 275 kPa (40 psi), plus/minus 14 kPa (2 psi); operated by pressure switch or transmitters.
 - f. High pressure alarm: functions when system pressure downstream of main shutoff valve increases above 415 kPa (60 psi), plus/minus 14 kPa (2 psi) set points; operated by pressure switches or transmitters.
 - g. Cylinder reserve pressure low: Functions when the content of a cylinder reserve header is reduced below one day's average supply.
- C. Alarm Functions:
1. Oxygen and compressed air alarms: Pressure alarms: Functions when pressure in branch drops below 275 kPa (40 psi), plus/minus 14 kPa (2 psi) or increases above 414 kPa (60 psi), plus/minus 14 kPa (2 psi) set points; operated by pressure switches or transmitters.
 2. Vacuum alarms:
 - a. Low vacuum alarm: Function when system vacuum upstream of main shutoff valve drops below 40 kPa (12 inches Hg); operated by vacuum switch.

- b. Filter differential pressure/back pressure alarm: Functions when discharge oil filter differential rises to set level, or when back pressure is sensed; receives signal from pump control panel.
- c. Laboratory vacuum pump malfunction.

2.9 PRESSURE SWITCHES

- A. General purpose, contact or mercury type, allowing both high and low pressure set points, with contact type provided with a protective dust cover; adjustable range set by inside or outside adjustment; switches activate when indicated by alarm requirements. Use one orifice nipple (or DISS demand check valve) for each sensor or pressure switch.

2.10 PRESSURE REGULATORS:

- A. For 690 kPa (100 psi) regulator, provide duplex in parallel, valve for maintenance shut-down without service interruption. For additional pressures, locate regulators remote from compressor near point of use, and provide with isolation valves and valve bypass.
 - 1. For systems 5 L/s (10 scfm) and below: Brass or bronze body and trim, reduced pressure range 170 – 850 kPa (25 – 125 psi) adjustable, spring type, diaphragm operated diaphragm operated, relieving. Delivered pressure shall vary not more than one kPa (0.15psi) for each 10 kPa (1.5psi) variation in inlet pressure.

2.11 EMERGENCY LOW PRESSURE OXYGEN INLET

- A. The Low Pressure Emergency Oxygen Inlet provides an inlet for connecting a temporary auxiliary source of oxygen to the oxygen pipeline system for emergency or maintenance situations per NFPA 99.
- B. The inlet consist of a 1" (25 mm) ball valve, pressure gauge and a 1/2"/1" NPTF connection housed in a weather tight enclosure. The enclosure is labeled "Emergency Low Pressure Gaseous Oxygen Inlet", and includes a padlock staple to prevent tampering or unauthorized access. The enclosure is suitable for recess mounting on the exterior of the building being served. The enclosure is 14 gauge, cold rolled steel with a primer coat of paint. The Emergency Oxygen Inlet is connected at a point downstream of the main supply line shutoff valve.
- C. Check valves are provided for installation in the emergency supply line and in the main supply line between the main line shutoff valve and the emergency supply line connection per NFPA 99. Check valves have a cast bronze body and straight through design for minimum pressure drop.

- D. The check valves for sizes under 3" (76 mm) are soft seated, bubble tight, self aligning, and spring loaded, and ball type check valves. Three inch (76 mm) check valves are hard seated, spring loaded, self aligning ball type checks with cone seats (3" valves may not be "bubble tight"). Check valves are fast acting.
- E. A relief valve is provided for installation in the emergency supply line per NFPA 99. The relief valve has a brass body, single seat design, and is cleaned for oxygen use. It automatically reseats to provide a "bubble tight" seal after discharging excess gas. Pre-set at 75 psi.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Install cast escutcheon with set screw at each wall, floor and ceiling penetration in exposed finished locations and within cabinets and millwork.
- B. Keep open ends of tube capped or plugged at all times or otherwise sealed until final assembly.
- C. Cut piping square and accurately with a tube cutter (sawing not permitted) to measurements determined at place of installation. Ream tube to remove burrs, being careful not to expand tube, and so no chips of copper remain in the tube. Work into place without springing or forcing. Bottom tube in socket so there are no gaps between tube and fitting. Exercise care in handling equipment and tools used in cutting or reaming of tube to prevent oil or grease being introduced into tubing. Where contamination has occurred, material is no longer suitable for oxygen service.
- D. Spacing of hangers: Current NFPA.
- E. Rigidly support valves and other equipment to prevent strain on tube or joints.
- F. While being brazed, joints shall be continuously purged with *oil* free nitrogen. The flow of purged gas shall be maintained until joint is cool to touch.
- G. Do not bend tubing. Use fittings.
- H. Support ceiling column assembly from heavy sub-mounting castings furnished with the unit as part of roughing-in. Anchor with 15 mm (1/2-inch) diameter bolts attached to angle iron frame supported from structural ceiling, unless otherwise indicated.
- I. Provide two 25 mm (1 inch) minimum conduits from ceiling column assembly to adjacent corridor, one for mass spectrometer tubing and wiring and one for monitor wiring, for connection to signal cabling network.

- J. Install pressure switches, transmitter and gauges to be easily accessed, and provide access panel where installed above plaster ceiling. Install pressure switch and sensors with orifice nipple between the pipe line and switches/sensors.
- K. Apply pipe labeling during installation process and not after installation is completed. Size of legend letters shall be in accordance with ANSI A13.1.
- L. Pipe compressor intake to a source of clean ambient air as indicated in current NFPA.
- M. After initial leakage testing is completed, allow piping to remain pressurized with testing gas until testing agency performs final tests.
- N. Penetrations:
 - 1. Fire Stopping: Where pipes pass through fire partitions, fire walls, smoked partitions, or floors, install a fire stop that provides an effective barrier against the spread of fire, smoke and gases as specified in Section 07 84 00, FIRESTOPPING, with intumescent materials only. Completely fill and seal clearances between raceways and openings with the fire stopping material.
 - 2. Waterproofing: At floor penetrations, completely seal clearances around the pipe and make watertight with sealant as specified in Section 07 92 00, JOINT SEALANTS.
- O. Provide 40mm (1 1/2 inch) diameter line pressure gage downstream of zone valve in cabinets.
- P. Provide zone valves in cabinets where indicated and outside each Operating Room and a minimum one zone valve assembly for each 18 outlet set.

3.2 TESTS

- A. Initial Tests: Blow down, and high and low pressure leakage tests as required by current NFPA with documentation.
- B. Laboratory and healthcare testing agency shall perform the following:
 - 1. Perform and document all cross connection tests, labeling verification, supply system operation, and valve and alarm operation tests as required by, and in accordance with, current NFPA and the procedures set forth in pre-qualification documentation.
 - 2. Verify that the systems, as installed, meet or exceed the requirements of current NFPA, this specification, and that the systems operate as required.
 - 3. Piping purge test: For each positive pressure gas system, verify cleanliness of piping system. Filter a minimum of 35 cubic feet (1000 liters) of gas through a clean white 0.45 micron filter at a minimum velocity of 3.5 scfm (100 Lpm). Filter shall show no discoloration, and shall accrue no more than 0.1 mg of matter. Test each zone at the

outlet most remote from the source. Perform test with the use of an inert gas as described in CGA P-9.

4. Piping purity test: For each positive pressure system, verify purity of piping system. Test each zone at the most remote outlet for dew point, carbon monoxide, total hydrocarbons (as methane), and halogenated hydrocarbons, and compare with source gas. The two tests must in no case exceed variation as specified in Paragraph, Maximum Allowable Variation. Perform test with the use of an inert gas as described in CGA P-9.
5. Outlet and inlet flow test:
 - a. Test all outlets for flow. Perform test with the use of an inert gas as described in CGA P-9.
 - b. Oxygen, nitrous oxide and air outlets must deliver 100 Lpm (3.5 scfm) with a pressure drop of no more than 35 kPa (5 psi), and static pressure of 350 kPa (50 psi).
 - c. Nitrogen outlets must deliver 565 Lpm (20 scfm) with a pressure drop of no more than 35 kPa (5 psi), and static pressure of 1445 kPa (210 psi).
 - d. Needle valve air outlets must deliver 1.5 scfm with a pressure drop of no more than five psi, and static pressure of 350 kPa (50 psi).
6. Source Contamination Test: Analyze each pressure gas source for concentration of contaminants, by volume. Take samples for air system test at the intake and at a point immediately downstream of the final filter outlet. The compared tests must in no case exceed variation as specified in Paragraph, Maximum Allowable Variation. Allowable concentrations are below the following:

Dew point, air	4 degrees C (39 degrees F) pressure dew point at 690 kPa (100 psi)
Carbon monoxide, air	10 mg/L (ppm)
Carbon dioxide, air	500 mg/L (ppm)

7. Analysis Test:
 - a. Analyze each pressure gas source and outlet for concentration of gas, by volume.
 - b. Make analysis with instruments designed to measure the specific gas dispensed.
 - c. Allowable concentrations are within the following:

- 1) Laboratory air 19.5 percent to 23.5 percent oxygen.

Oxygen	>=97 plus percent oxygen
Medical air	19.5 percent to 23.5 percent oxygen
Carbon Dioxide	99 plus percent carbon dioxide

8. Maximum Allowable Variation: Between comparative test results required are as follows:

Dew point	2 degrees C (36 degrees F)
Carbon monoxide	2 mg/L (ppm)

3.3 CONNECTION TO EXISTING LABORATORY GAS SYSTEM:

- A. Contactor shall test the existing system for hydrocarbons, dew point, etc. If problems are present, the resident engineer (RE) would notify the facility of the results. The facility would then make the necessary repairs and/ or maintenance.
- B. Install shut-off valve at the connection of new line to existing line.
- C. Coordinate time for shut-down of the existing laboratory and healthcare system with the VA medical center.
- D. Shut off all oxygen zone valves and gas riser valves if the section to be connected to cannot be totally isolated from the remainder of the system.
- E. Prior to any work being done, check the new pipeline for particulate or other forms of contamination.
- F. Insure that the correct type of pipe tubing and fittings are being used.
- G. Make a spot check of the existing pipelines in the facility to determine the level of cleanness present.
- H. Reduce the pressure to zero and make the tie-in as quickly as possible. A nitrogen purge is not required since this would require another opening in the pipe.
- I. After the tie-in is made and allowed to cool, slowly bleed the source gas back into the pipeline. Test the work area for leaks with soapy water and repair any leaks.
- J. After all leaks, if any, are repaired and the line is fully recharged, perform blow down and testing. Open the zone that is closest to the main to the system, access the closest outlet to the work, and blow the main through the outlet. After the outlet blows clear into a white cloth,

make an additional check at a zone most distant from the work. Perform all required current NFPA tests after connection.

3.4 DEMONSTRATION AND TRAINING

- A. Provide services of manufacturer's technical representative for four hours to instruct VA Personnel in operation and maintenance of units.

--- E N D ---

SECTION 22 66 00
CHEMICAL-WASTE SYSTEMS FOR LABORATORY AND HEALTHCARE FACILITIES

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This section describes the requirements for chemical waste systems, including piping, equipment and all necessary accessories as designated in this section.

1.2 RELATED WORK

- A. Section 07 84 00, FIRESTOPPING: Penetrations in rated enclosures:
- B. Section 09 91 00, PAINTING: Preparation and finish painting and identification of piping systems.
- C. Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.
- D. Section 23 07 11, HVAC, PLUMBING, AND BOILER PLANT INSULATION: Pipe Insulation.

1.3 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturer's Literature and Data:
 - 1. Piping.
 - 2. Floor Drains.
 - 3. All items listed in Part 2 - Products.
- C. Detailed shop drawing of clamping device and extensions when required in connection with the waterproofing membrane or the floor drain.

1.4 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American National Standards Institute (ANSI):
- C. American Society of Mechanical Engineers (ASME): (Copyrighted Society)
 - A13.1-07Scheme for Identification of Piping Systems
 - B16.11-01Forged Steel Fittings, Socket-Welding and Threaded
 - B16.12-98 (R 2006)Cast Iron Threaded Drainage Fittings ANSI/ASME
 - B16.15-06(R 2006)Cast Bronze Threaded Fittings ANSI/ASME

- D. American Society for Testing and Materials (ASTM):
- A74-06Standard Specification for Cast Iron Soil Pipe and Fittings
 - A183-03)Standard Specification for Carbon Steel Track Bolts and Nuts
 - A312-08Standard Specification for Seamless and Welded Austenitic
Stainless Steel Pipe
 - A733-03Standard Specification for Welded and Seamless Carbon Steel
and Austenitic Stainless Steel Pipe Nipples
 - C564-03a.....Standard Specification for Rubber Gaskets for Cast Iron Soil
Pipe and Fittings
 - D401-07Standard Specification for Propylene Plastic Injection and
Extrusion Materials
 - D2447-03Standard Specification for Polyethylene (PE) Plastic Pipe,
Schedule 40 and 80, Based on Outside Diameter
 - D2564-04e1Standard Specification for Solvent Cements for Poly (Vinyl
Chloride) (PVC) Plastic Pipe and Fittings
 - D2665-07Standard Specification for Poly (Vinyl Chloride) (PVC) Plastic
Drain, Waste, and Vent Pipe and Fittings
 - D4101-07Standard Specification for Propylene Plastic Injection and
Extrusion Materials
- E. International Code Council:
- IPC-09International Plumbing Code
- F. Cast Iron Soil Pipe Institute (CISPI):
- 301-05Hubless Cast Iron Soil Pipe and Fittings for Sanitary and Storm
Drain, Waste, and Vent Piping Applications
 - 310-04Coupling for Use in Connection with Hubless Cast Iron Soil
Piping Applications

PART 2 - PRODUCTS

2.1 CHEMICAL RESISTANT WASTE AND VENT PIPING

- A. The material shall include connecting fittings in stacks or mains.
- B. The chemical resistant waste and vent piping shall be fiberglass reinforced plastic pipe and drainage pattern fittings for chemical handling applications conforming to ASTM D2997, ASTM D5685, and ASTM D4024.

1. The fittings shall be manufactured with the same chemical/temperature capabilities as the pipe.
2. The joints shall be socket type using thermosetting Epoxy adhesive. Cured joints shall provide the same chemical/temperature resistance settings as the pipe and fittings.

2.2 CLEANOUTS

- A. Cleanouts shall be the same size as the pipe, up to 100 mm or DN100 (4 inches); not less than 100 mm or DN100 (4 inches) for larger pipe. Cleanouts for chemical waste drain pipe shall be of same material as the pipe. Cleanouts shall be easily accessible and shall be gastight and watertight. A minimum clearance of 600 mm (24 inches) shall be provided for clearing a clogged chemical waste drain.
- B. Floor cleanouts shall have cast iron body and frame with square adjustable scoriated secured nickel bronze top. The cleanout shall be vertically adjustable for a minimum of 50 mm or DN50 (2 inches). When a waterproof membrane is used in the floor system, a clamping collar shall be provided on the cleanouts. Cleanouts shall consist of wye fittings and eighth bends with brass or bronze screw plugs. Cleanouts in the resilient tile floors, quarry tile and ceramic tile floors shall be provided with square top covers recessed for tile insertion. In the carpeted areas, carpet cleanout markers shall be provided. Two way cleanouts shall be provided where indicated on drawings.
- C. Cleanouts shall be provided at or near the base of the vertical stacks with the cleanout plug located approximately 600 mm (24 inches) above the floor. If there are no fixtures installed on the lowest floor, the cleanout shall be installed at the base of the stack. The cleanouts shall be extended to the wall access cover. The vertical cleanout shall consist of sanitary tees. Nickel bronze square frame and stainless steel cover shall be furnished with a minimum opening of 150 by 150 mm (6 by 6 inches) at each wall cleanout. Where the piping is concealed, a fixture trap or a fixture with integral trap, readily removable without disturbing concealed roughing work, shall be accepted as a cleanout equivalent providing the opening to be used as a cleanout opening is the size required. D. In horizontal runs above grade, cleanouts shall consist of cast brass tapered screw plug in fitting or caulked/no hub cast iron ferrule. Plain end (no-hub) piping in interstitial space or above ceiling may use plain end (no-hub) blind plug and clamp.

2.3 FLOOR DRAINS

- A. Chemical resistant floor drain. Double drainage pattern with integral membrane clamp for embedding in floor and weep holes to provide adequate drainage from pan to drain pipe.

Floor drain shall be all acid resistant epoxy coated cast iron. Provide outlet of floor drain suitable for properly joining to acid resistant fiberglass reinforced plastic pipe.

2.4 WATERPROOFING

- A. A sleeve flashing device shall be provide at points where pipes pass through membrane waterproofed floors or walls. The sleeve flashing device shall be manufactured, cast iron fitting with clamping device that forms a sleeve for the pipe floor penetration of the floor membrane. A galvanized steel pipe extension shall be included in the top of the fitting that will extend 50 mm (2 inches) above finished floor and galvanized steel pipe extension in the bottom of the fitting that will extend through the floor slab. A waterproofed caulked joint shall be provided at the top hub.
- B. Walls: See detail shown on drawings.

PART 3 - EXECUTION

3.1 PIPE INSTALLATION

- A. The pipe installation shall comply with the requirements of the International plumbing code and these specifications.
- B. Branch piping for chemical waste piping system shall be installed and connected to all fixtures, valves, cocks, outlets, casework, cabinets and equipment, including those furnished by the Government or specified in other sections.
- C. Pipe shall be round and straight. Cutting shall be done with proper tools. Pipe, except for plastic and glass, shall be reamed to full size after cutting.
- D. All pipe runs shall be laid out to avoid interference with other work.
- E. The piping shall be installed to permit valve servicing or operation.
- F. The piping shall be installed at the indicated slopes or according to the International plumbing code.
- G. The piping shall be installed free of sags and bends.
- H. Seismic restraint shall be installed where required by code.
- I. Changes in direction for chemical waste drainage and vent piping shall be made using appropriate branches, bends and long sweep bends. Sanitary tees and short sweep quarter bends may be used on vertical stacks if change in direction of flow is from horizontal to vertical. Long turn double wye branch and eighth bend fittings shall be used if two fixtures are installed back to back or side by side with common drain pipe. Straight tees, elbows, and crosses may be used on vent lines. Do not change direction of flow more than 90 degrees.

Proper size of standard increaser and reducers shall be used if pipes of different sizes are connected. Reducing size of drainage piping in direction of flow is prohibited.

- J. Cast iron piping shall be installed according to CISPI's "Cast Iron Soil Pipe and Fittings Handbook," Chapter IV, "Installation of Cast Iron Soil Pipe and Fittings"
- K. Aboveground PVC piping shall be installed according to ASTM D2665. Underground PVC piping shall be installed according to ASTM D2321.

3.2 JOINT CONSTRUCTION

- 1. The joints shall be socket type using thermosetting Epoxy adhesive. Cured joints shall provide the same chemical/temperature resistance settings as the pipe and fittings.
- 2. All surfaces shall be cleaned and dry prior to applying the primer and solvent cement. Installation practices shall comply with ASTM F402. The joint shall conform to ASTM D5685.

3.3 SPECIALTY PIPE FITTINGS

- A. Transition coupling shall be installed at pipe joints with small differences in pipe outside diameters.
- B. Dielectric fittings shall be installed at connections of dissimilar metal piping and tubing.

3.4 PIPE HANGERS, SUPPORTS, AND ACCESSORIES

- A. All piping shall be supported according to the International plumbing code, Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING, and these specifications.
- B. Hangers, supports, rods, inserts and accessories used for Pipe supports shall be shop coated with zinc Chromate primer paint.
- C. Horizontal piping and tubing shall be supported within 300 mm (12 inches) of each fitting or coupling.
- D. Horizontal cast iron piping shall be supported with the following maximum horizontal spacing and minimum hanger rod diameters:
 - 1. 40 mm or DN40 to 50 mm or DN50 (NPS 1-1/2 to NPS 2): 4876 mm (16 feet) with 10 mm (3/8 inch) rod.
 - 2. 80 mm or DN 80 (NPS 3): 5486 mm (18 feet) with 13 mm (1/2 inch) rod.
 - 3. 100 mm or DN 100 to 125 mm or DN125 (NPS 4 to NPS 5): 6096 mm (20 feet) with 16 mm (5/8 inch) rod.
- E. Vertical piping and tubing shall be supported at the base, at each floor, and at intervals no greater than 4.57 meters (15 feet). In addition to the requirements in Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING,

- F. In addition to the requirements in Section 22 05 11, COMMON WORK RESULTS FOR PUMBINING, floor, Wall and Ceiling Plates, Supports, and Hangers shall have the following characteristics:
1. Solid or split unplated cast iron.
 2. All plates shall be provided with set screws.
 3. Height adjustable clevis type pipe hangers.
 4. Adjustable Floor Rests and Base Flanges shall be steel.
 5. Hanger Rods shall be carbon steel, fully threaded or Threaded at each end with two removable nuts at each end for positioning rod and hanger and locking each in place.
 6. Riser Clamps shall be malleable iron or steel.
 7. Rollers shall be Cast iron.
 8. Hangers and supports utilized with insulated pipe and tubing shall have 180 degree (min.) metal protection shield Centered on and welded to the hanger and support. The shield shall be 100 mm (4 inches) in length and be 16 gauge steel. The shield shall be sized for the insulation.
- G. Miscellaneous Materials: As specified, required, directed or as noted on the drawings for proper installation of hangers, supports and accessories. If the vertical distance exceeds 6 m (20 feet) for cast iron pipe additional support shall be provided in the center of that span. Provide all necessary auxiliary steel to provide that support.
- H. Cast escutcheon with set screw shall be installed at each wall, floor and ceiling penetration in exposed finished locations and within cabinets and millwork.
- I. Penetrations:
1. Where pipes pass through fire partitions, fire walls, smoke partitions, or floors, install a fire stop system that provides an effective barrier against the spread of fire, smoke and gases as specified in Section 07 84 00, FIRESTOPPING. Clearances between raceways and openings shall be completely filled and sealed with the fire stopping materials.
 2. At floor penetrations, Clearances around the pipe shall be completely sealed and made watertight with sealant as specified in Section 07 92 00, JOINT SEALANTS.
- J. Chemical waste and vent piping shall conform to the following:
1. Where waste lines from fixtures are shown on plans to be chemical resistant, vents from those fixtures shall also be chemical resistant.

2. Storage and installation for fiberglass reinforced plastic chemical resistant pipe shall comply with manufacturer's recommendations.

3.5 TESTS

- A. The chemical resistant pipe system shall be tested either in its entirety or in sections.
- B. Tests for Chemical Resistant Waste, and Vent, Systems shall be conducted before trenches are backfilled or fixtures are connected. A water test or air test shall be conducted as directed using a steady pressure of 1-1/2 times the maximum operating pressure.
 1. If entire system is tested using a water test, tightly close all openings in pipes except highest opening, and fill system with water to point of overflow. If system is tested in sections, tightly plug each opening except highest opening of section under test, fill each section with water and test with at least a 3 m (10 foot) head of water. In testing successive sections, test at least upper 3 m (10 feet) of next preceding section so that each joint or pipe except upper most 3 m (10 feet) of system has been submitted to a test of at least a 3 m (10 foot) head of water. Water shall be kept in system, or in portion under test, for at least 15 minutes before inspection starts. System shall then be tight at all joints.
 2. Air pressure test of 35 kPa (5 psi) gage shall be maintained for at least 15 minutes without leakage. A force pump and mercury column gage shall be used for the test.
 3. Final Tests: Either one of the following tests may be used.
 - a. Smoke Test: After fixtures are permanently connected and traps are filled with water, fill entire drainage and vent systems with smoke under pressure of 1.3 kPa (1 inch of water) with a smoke machine. Chemical smoke is prohibited.
 - b. Peppermint Test: Introduce (two ounces) of peppermint into each line or stack.
 4. All testing shall be documented and certified prior to placing the piping system into operation.

--- E N D ---

SECTION 23 05 11 COMMON WORK RESULTS FOR HVAC

PART 1 - GENERAL

1.1 DESCRIPTION

- A. The requirements of this Section apply to all sections of Division 23.
- B. Definitions:
 - 1. Exposed: Piping, ductwork, and equipment exposed to view in finished rooms.
 - 2. Option or optional: Contractor's choice of an alternate material or method.
 - 3. RE: Resident Engineer
 - 4. COR: Contracting Officer's Representative.

1.2 RELATED WORK

- A. Section 01 00 00, GENERAL REQUIREMENTS
- B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES
- C. Section 31 20 00, EARTH MOVING: Excavation and Backfill
- D. Section 03 30 00, CAST-IN-PLACE CONCRETE: Concrete and Grout
- E. Section 05 31 00, STEEL DECKING
- F. Section 05 50 00, METAL FABRICATIONS
- H. Section 07 84 00, FIRESTOPPING
- I. Section 07 60 00, FLASHING AND SHEET METAL: Flashing for Wall and Roof Penetrations
- J. Section 07 92 00, JOINT SEALANTS
- K. Section 09 91 00, PAINTING
- L. Section 23 05 12, GENERAL MOTOR REQUIREMENTS FOR HVAC and STEAM GENERATION
- M. Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING and EQUIPMENT
- N. Section 23 05 93, TESTING, ADJUSTING, and BALANCING FOR HVAC
- O. Section 23 07 11, HVAC, PLUMBING, and Boiler Plant Insulation
- P. Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC
- Q. Section 23 21 13, HYDRONIC PIPING
- R. Section 23 21 23, HYDRONIC PUMPS
- S. Section 23 22 13, STEAM and CONDENSATE HEATING PIPING
- T. Section 23 22 23, STEAM CONDENSATE PUMPS
- U. Section 23 23 00, REFRIGERANT PIPING

- V. Section 23 25 00, HVAC WATER TREATMENT
- W. Section 23 31 00, HVAC DUCTS and CASINGS
- X. Section 23 34 00, HVAC FANS
- Y. Section 23 36 00, AIR TERMINAL UNITS
- Z. Section 23 37 00, AIR OUTLETS and INLETS
- AA. Section 23 40 00, HVAC AIR CLEANING DEVICES
- BB. Section 23 73 00, INDOOR CENTRAL-STATION AIR-HANDLING UNITS
- CC. Section 23 81 00, DECENTRALIZED UNITARY HVAC EQUIPMENT
- DD. Section 23 82 16, AIR COILS
- EE. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS
- FF. Section 26 29 11, LOW-VOLTAGE MOTOR STARTERS

1.3 QUALITY ASSURANCE

- A. Mechanical, electrical and associated systems shall be safe, reliable, efficient, durable, easily and safely operable and maintainable, easily and safely accessible, and in compliance with applicable codes as specified. The systems shall be comprised of high quality institutional-class and industrial-class products of manufacturers that are experienced specialists in the required product lines. All construction firms and personnel shall be experienced and qualified specialists in industrial and institutional HVAC
- B. Flow Rate Tolerance for HVAC Equipment: Section 23 05 93, TESTING, ADJUSTING, AND BALANCING FOR HVAC.
- C. Equipment Vibration Tolerance:
 - 1. Refer to Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING and EQUIPMENT. Equipment shall be factory-balanced to this tolerance and re-balanced on site, as necessary.
 - 2. After HVAC air balance work is completed and permanent drive sheaves are in place, perform field mechanical balancing and adjustments required to meet the specified vibration tolerance.
- D. Products Criteria:
 - 1. Standard Products: Material and equipment shall be the standard products of a manufacturer regularly engaged in the manufacture of the products for at least 3 years (or longer as specified elsewhere). The design, model and size of each item shall have been in satisfactory and efficient operation on at least three installations for approximately three years. However, digital electronics devices, software and systems such as controls, instruments, computer

work station, shall be the current generation of technology and basic design that has a proven satisfactory service record of at least three years. See other specification sections for any exceptions and/or additional requirements.

2. All items furnished shall be free from defects that would adversely affect the performance, maintainability and appearance of individual components and overall assembly.
3. Conform to codes and standards as required by the specifications. Conform to local codes, if required by local authorities such as the natural gas supplier, if the local codes are more stringent than those specified. Refer any conflicts to the Resident Engineer.
4. Multiple Units: When two or more units of materials or equipment of the same type or class are required, these units shall be products of one manufacturer.
5. Assembled Units: Manufacturers of equipment assemblies, which use components made by others, assume complete responsibility for the final assembled product.
6. Nameplates: Nameplate bearing manufacturer's name or identifiable trademark shall be securely affixed in a conspicuous place on equipment, or name or trademark cast integrally with equipment, stamped or otherwise permanently marked on each item of equipment.
7. Asbestos products or equipment or materials containing asbestos shall not be used.

E. Equipment Service Organizations:

1. HVAC: Products and systems shall be supported by service organizations that maintain a complete inventory of repair parts and are located within 50 miles to the site.

F. HVAC Mechanical Systems Welding: Before any welding is performed, contractor shall submit a certificate certifying that welders comply with the following requirements:

1. Qualify welding processes and operators for piping according to ASME "Boiler and Pressure Vessel Code", Section IX, "Welding and Brazing Qualifications".
2. Comply with provisions of ASME B31 series "Code for Pressure Piping".
3. Certify that each welder has passed American Welding Society (AWS) qualification tests for the welding processes involved, and that certification is current.

G. Execution (Installation, Construction) Quality:

1. Apply and install all items in accordance with manufacturer's written instructions. Refer conflicts between the manufacturer's instructions and the contract drawings and specifications to the Resident Engineer for resolution. Provide written hard copies or computer files of manufacturer's installation instructions to the Resident Engineer at least two weeks prior to commencing installation of any item. Installation of the item will not be

allowed to proceed until the recommendations are received. Failure to furnish these recommendations is a cause for rejection of the material.

2. Provide complete layout drawings required by Paragraph, SUBMITTALS. Do not commence construction work on any system until the layout drawings have been approved.
- H. Upon request by Government, provide lists of previous installations for selected items of equipment. Include contact persons who will serve as references, with telephone numbers and e-mail addresses.

1.4 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES, and with requirements in the individual specification sections.
- B. Contractor shall make all necessary field measurements and investigations to assure that the equipment and assemblies will meet contract requirements.
- C. If equipment is submitted which differs in arrangement from that shown, provide drawings that show the rearrangement of all associated systems. Approval will be given only if all features of the equipment and associated systems, including accessibility, are equivalent to that required by the contract.
- D. Prior to submitting shop drawings for approval, contractor shall certify in writing that manufacturers of all major items of equipment have each reviewed drawings and specifications, and have jointly coordinated and properly integrated their equipment and controls to provide a complete and efficient installation.
- E. Submittals and shop drawings for interdependent items, containing applicable descriptive information, shall be furnished together and complete in a group. Coordinate and properly integrate materials and equipment in each group to provide a completely compatible and efficient.
- H. Layout Drawings:
 1. Submit complete consolidated and coordinated layout drawings for all new systems, and for existing systems that are in the same areas.
 2. The drawings shall include plan views, elevations and sections of all systems and shall be on a scale of not less than 1:32 (3/8-inch equal to one foot). Clearly identify and dimension the proposed locations of the principal items of equipment. The drawings shall clearly show locations and adequate clearance for all equipment, piping, valves, control panels and other items. Show the access means for all items requiring access for operations and maintenance. Provide detailed layout drawings of all piping and duct systems.

3. Do not install equipment foundations, equipment or piping until layout drawings have been approved.
4. In addition, for HVAC systems, provide details of the following:
 - a. Mechanical equipment rooms.
 - c. Hangers, inserts, supports, and bracing.
 - d. Pipe sleeves.
 - e. Duct or equipment penetrations of floors, walls, ceilings, or roofs.
- I. Manufacturer's Literature and Data: Submit under the pertinent section rather than under this section.
 1. Submit belt drive with the driven equipment. Submit selection data for specific drives when requested by the Resident Engineer.
 2. Submit electric motor data and variable speed drive data with the driven equipment.
 3. Equipment and materials identification.
 4. Fire-stopping materials.
 5. Hangers, inserts, supports and bracing. Provide load calculations for variable spring and constant support hangers.
 6. Wall, floor, and ceiling plates.
- J. HVAC Maintenance Data and Operating Instructions:
 1. Maintenance and operating manuals in accordance with Section 01 00 00, GENERAL REQUIREMENTS, Article, INSTRUCTIONS, for systems and equipment.
 2. Provide a listing of recommended replacement parts for keeping in stock supply, including sources of supply, for equipment. Include in the listing belts for equipment: Belt manufacturer, model number, size and style, and distinguished whether of multiple belt sets.
- K. Provide copies of approved HVAC equipment submittals to the Testing, Adjusting and Balancing Subcontractor.

1.5 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. Air Conditioning, Heating and Refrigeration Institute (AHRI):
430-2009 Central Station Air-Handling Units
- C. American National Standard Institute (ANSI):
B31.1-2007 Power Piping

- D. Rubber Manufacturers Association (ANSI/RMA):
- IP-20-2007Specifications for Drives Using Classical V-Belts and Sheaves
 - IP-21-2009Specifications for Drives Using Double-V (Hexagonal) Belts
 - IP-22-2007Specifications for Drives Using Narrow V-Belts and Sheaves
- E. Air Movement and Control Association (AMCA):
- 410-96Recommended Safety Practices for Air Moving Devices
- F. American Society of Mechanical Engineers (ASME):
- Boiler and Pressure Vessel Code (BPVC):
 - Section I-2007Power Boilers
 - Section IX-2007Welding and Brazing Qualifications
 - Code for Pressure Piping:
 - B31.1-2007Power Piping
- G. American Society for Testing and Materials (ASTM):
- A36/A36M-08.....Standard Specification for Carbon Structural Steel
 - A575-96(2007).....Standard Specification for Steel Bars, Carbon, Merchant
Quality, M-Grades
 - E84-10.....Standard Test Method for Surface Burning Characteristics of
Building Materials
 - E119-09cStandard Test Methods for Fire Tests of Building Construction
and Materials
- H. Manufacturers Standardization Society (MSS) of the Valve and Fittings Industry, Inc:
- SP-58-2009Pipe Hangers and Supports-Materials, Design and Manufacture,
Selection, Application, and Installation
 - SP 69-2003.....Pipe Hangers and Supports-Selection and Application
 - SP 127-2001.....Bracing for Piping Systems, Seismic – Wind – Dynamic,
Design, Selection, Application
- I. National Electrical Manufacturers Association (NEMA):
- MG-1-2009Motors and Generators
- J. National Fire Protection Association (NFPA):
- 31-06Standard for Installation of Oil-Burning Equipment
 - 54-09National Fuel Gas Code
 - 70-08National Electrical Code
 - 85-07Boiler and Combustion Systems Hazards Code

90A-09	Standard for the Installation of Air Conditioning and Ventilating Systems
101-09	Life Safety Code

1.6 DELIVERY, STORAGE AND HANDLING

A. Protection of Equipment:

1. Equipment and material placed on the job site shall remain in the custody of the Contractor until phased acceptance, whether or not the Government has reimbursed the Contractor for the equipment and material. The Contractor is solely responsible for the protection of such equipment and material against any damage.
2. Place damaged equipment in first class, new operating condition; or, replace same as determined and directed by the Resident Engineer. Such repair or replacement shall be at no additional cost to the Government.
3. Protect interiors of new equipment and piping systems against entry of foreign matter. Clean both inside and outside before painting or placing equipment in operation.
4. Existing equipment and piping being worked on by the Contractor shall be under the custody and responsibility of the Contractor and shall be protected as required for new work.

B. Cleanliness of Piping and Equipment Systems:

1. Exercise care in storage and handling of equipment and piping material to be incorporated in the work. Remove debris arising from cutting, threading and welding of piping.
2. Piping systems shall be flushed, blown or pigged as necessary to deliver clean systems.
3. Clean interior of all tanks prior to delivery for beneficial use by the Government.
4. Boilers shall be left clean following final internal inspection by Government insurance representative or inspector.
5. Contractor shall be fully responsible for all costs, damage, and delay arising from failure to provide clean systems.

1.7 JOB CONDITIONS – WORK IN EXISTING BUILDING

- A. Building Operation: Government employees will be continuously operating and managing all facilities, including temporary facilities, that serve the medical center.
- B. Maintenance of Service: Schedule all work to permit continuous service as required by the medical center.
- C. Steam and Condensate Service Interruptions: Limited steam and condensate service interruptions, as required for interconnections of new and existing systems, will be permitted by the Resident Engineer during periods when the demands are not critical to the operation of the

medical center. These non-critical periods are limited to between 8 pm and 5 am in the appropriate off-season (if applicable). Provide at least one week advance notice to the Resident Engineer.

- D. Phasing of Work: Comply with all requirements shown on drawings or specified.
- E. Building Working Environment: Maintain the architectural and structural integrity of the building and the working environment at all times. Maintain the interior of building at 18 degrees C (65 degrees F) minimum. Limit the opening of doors, windows or other access openings to brief periods as necessary for rigging purposes. No storm water or ground water leakage permitted. Provide daily clean-up of construction and demolition debris on all floor surfaces and on all equipment being operated by VA.
- F. Acceptance of Work for Government Operation: As new facilities are made available for operation and these facilities are of beneficial use to the Government, inspections will be made and tests will be performed. Based on the inspections, a list of contract deficiencies will be issued to the Contractor. After correction of deficiencies as necessary for beneficial use, the Contracting Officer will process necessary acceptance and the equipment will then be under the control and operation of Government personnel.
- G. Temporary Facilities: Refer to Article, TEMPORARY PIPING AND EQUIPMENT in this section.

PART 2 - PRODUCTS

2.1 FACTORY-ASSEMBLED PRODUCTS

- A. Provide maximum standardization of components to reduce spare part requirements.
- B. Manufacturers of equipment assemblies that include components made by others shall assume complete responsibility for final assembled unit.
 - 1. All components of an assembled unit need not be products of same manufacturer.
 - 2. Constituent parts that are alike shall be products of a single manufacturer.
 - 3. Components shall be compatible with each other and with the total assembly for intended service.
 - 4. Contractor shall guarantee performance of assemblies of components, and shall repair or replace elements of the assemblies as required to deliver specified performance of the complete assembly.
- C. Components of equipment shall bear manufacturer's name and trademark, model number, serial number and performance data on a name plate securely affixed in a conspicuous place, or cast integral with, stamped or otherwise permanently marked upon the components of the equipment.

- D. Major items of equipment, which serve the same function, must be the same make and model.
Exceptions will be permitted if performance requirements cannot be met.

2.2 COMPATIBILITY OF RELATED EQUIPMENT

Equipment and materials installed shall be compatible in all respects with other items being furnished and with existing items so that the result will be a complete and fully operational plant that conforms to contract requirements.

2.3 BELT DRIVES

- A. Type: ANSI/RMA standard V-belts with proper motor pulley and driven sheave. Belts shall be constructed of reinforced cord and rubber.
- B. Dimensions, rating and selection standards: ANSI/RMA IP-20 and IP-21.
- C. Minimum Horsepower Rating: Motor horsepower plus recommended ANSI/RMA service factor (not less than 20 percent) in addition to the ANSI/RMA allowances for pitch diameter, center distance, and arc of contact.
- D. Maximum Speed: 25 m/s (5000 feet per minute).
- E. Adjustment Provisions: For alignment and ANSI/RMA standard allowances for installation and take-up.
- F. Drives may utilize a single V-Belt (any cross section) when it is the manufacturer's standard.
- G. Multiple Belts: Matched to ANSI/RMA specified limits by measurement on a belt measuring fixture. Seal matched sets together to prevent mixing or partial loss of sets. Replacement, when necessary, shall be an entire set of new matched belts.
- H. Sheaves and Pulleys:
 - 1. Material: Pressed steel, or close grained cast iron.
 - 2. Bore: Fixed or bushing type for securing to shaft with keys.
 - 3. Balanced: Statically and dynamically.
 - 4. Groove spacing for driving and driven pulleys shall be the same.
- I. Drive Types, Based on ARI 435:
 - 1. Provide adjustable-pitch or fixed-pitch drive as follows:
 - a. Fan speeds up to 1800 RPM: 7.5 kW (10 horsepower) and smaller.
 - b. Fan speeds over 1800 RPM: 2.2 kW (3 horsepower) and smaller.
 - 2. Provide fixed-pitch drives for drives larger than those listed above.
 - 3. The final fan speeds required to just meet the system CFM and pressure requirements, without throttling, shall be determined by adjustment of a temporary adjustable-pitch motor sheave or by fan law calculation if a fixed-pitch drive is used initially.

2.4 DRIVE GUARDS

- A. For machinery and equipment, provide guards as shown in AMCA 410 for belts, chains, couplings, pulleys, sheaves, shafts, gears and other moving parts regardless of height above the floor to prevent damage to equipment and injury to personnel. Drive guards may be excluded where motors and drives are inside factory fabricated air handling unit casings.
- B. Pump shafts and couplings shall be fully guarded by a sheet steel guard, covering coupling and shaft but not bearings. Material shall be minimum 16-gage sheet steel; ends shall be braked and drilled and attached to pump base with minimum of four 6 mm (1/4-inch) bolts. Reinforce guard as necessary to prevent side play forcing guard onto couplings.
- C. V-belt and sheave assemblies shall be totally enclosed, firmly mounted, non-resonant. Guard shall be an assembly of minimum 22-gage sheet steel and expanded or perforated metal to permit observation of belts. 25 mm (one-inch) diameter hole shall be provided at each shaft centerline to permit speed measurement.
- D. Materials: Sheet steel, cast iron, expanded metal or wire mesh rigidly secured so as to be removable without disassembling pipe, duct, or electrical connections to equipment.
- E. Access for Speed Measurement: 25 mm (One inch) diameter hole at each shaft center.

2.5 LIFTING ATTACHMENTS

Provide equipment with suitable lifting attachments to enable equipment to be lifted in its normal position. Lifting attachments shall withstand any handling conditions that might be encountered, without bending or distortion of shape, such as rapid lowering and braking of load.

2.6 ELECTRIC MOTORS

- A. All material and equipment furnished and installation methods shall conform to the requirements of Section 23 05 12, GENERAL MOTOR REQUIREMENTS FOR HVAC AND STEAM GENERATION EQUIPMENT; Section 26 29 11, LOW-VOLTAGE MOTOR STARTERS; and, Section 26 05 21, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES (600 VOLTS AND BELOW). Provide all electrical wiring, conduit, and devices necessary for the proper connection, protection and operation of the systems. Provide special energy efficient premium efficiency type motors as scheduled.

2.7 VARIABLE SPEED MOTOR CONTROLLERS

- A. Refer to Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS and Section 26 29 11, LOW-VOLTAGE MOTOR STARTERS for specifications.
- B. The combination of controller and motor shall be provided by the manufacturer of the driven equipment, such as pumps and fans, and shall be rated for 100 percent output performance.

Multiple units of the same class of equipment, i.e. air handlers, fans, pumps, shall be product of a single manufacturer.

- C. Motors shall be premium efficiency type and be approved by the motor controller manufacturer. The controller-motor combination shall be guaranteed to provide full motor nameplate horsepower in variable frequency operation. Both driving and driven motor/fan sheaves shall be fixed pitch.
- D. Controller shall not add any current or voltage transients to the input AC power distribution system, DDC controls, sensitive medical equipment, etc., nor shall be affected from other devices on the AC power system.
- E. Controller shall be provided with the following operating features and accessories:
 - 1. Suitable for variable torque load.
 - 2. Provide thermal magnetic circuit breaker or fused switch with external operator and incoming line fuses.

2.8 EQUIPMENT AND MATERIALS IDENTIFICATION

- A. Use symbols, nomenclature and equipment numbers specified, shown on the drawings and shown in the maintenance manuals. Identification for piping is specified in Section 09 91 00, PAINTING.
- B. Interior (Indoor) Equipment: Engraved nameplates, with letters not less than 48 mm (3/16-inch) high of brass with black-filled letters, or rigid black plastic with white letters specified in Section 09 91 00, PAINTING permanently fastened to the equipment. Identify unit components such as coils, filters, fans, etc.
- C. Exterior (Outdoor) Equipment: Brass nameplates, with engraved black filled letters, not less than 48 mm (3/16-inch) high riveted or bolted to the equipment.
- D. Control Items: Label all temperature and humidity sensors, controllers and control dampers. Identify and label each item as they appear on the control diagrams.
- E. Valve Tags and Lists:
 - 1. HVAC and Boiler Plant: Provide for all valves other than for equipment in Section 23 82 00, CONVECTION HEATING AND COOLING UNITS.
 - 2. Valve tags: Engraved black filled numbers and letters not less than 13 mm (1/2-inch) high for number designation, and not less than 6.4 mm (1/4-inch) for service designation on 19 gage 38 mm (1-1/2 inches) round brass disc, attached with brass "S" hook or brass chain.

3. Valve lists: Typed or printed plastic coated card(s), sized 216 mm(8-1/2 inches) by 280 mm (11 inches) showing tag number, valve function and area of control, for each service or system. Punch sheets for a 3-ring notebook.
4. Provide detailed plan for each floor of the building indicating the location and valve number for each valve. Identify location of each valve with a color coded thumb tack in ceiling.

2.9 FIRESTOPPING

Section 07 84 00, FIRESTOPPING specifies an effective barrier against the spread of fire, smoke and gases where penetrations occur for piping and ductwork. Refer to Section 23 07 11, HVAC, PLUMBING, AND BOILER PLANT INSULATION, for firestop pipe and duct insulation.

2.10 GALVANIZED REPAIR COMPOUND

Mil. Spec. DOD-P-21035B, paint form.

2.11 HVAC PIPE AND EQUIPMENT SUPPORTS AND RESTRAINTS

- A. Vibration Isolators: Refer to Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT.
- B. Supports for Roof Mounted Items:
 1. Equipment: Equipment rails shall be galvanized steel, minimum 1.3 mm (18 gauge), with integral baseplate, continuous welded corner seams, factory installed 50 mm by 100 mm (2 by 4) treated wood nailer, 1.3 mm (18 gauge) galvanized steel counter flashing cap with screws, built-in cant strip, (except for gypsum or tectum deck), minimum height 280 mm (11 inches). For surface insulated roof deck, provide raised cant strip to start at the upper surface of the insulation.
 2. Pipe/duct pedestals: Provide a galvanized Unistrut channel welded to U-shaped mounting brackets which are secured to side of rail with galvanized lag bolts.
- C. Pipe Supports: Comply with MSS SP-58. Type Numbers specified refer to this standard. For selection and application comply with MSS SP-69. Refer to Section 05 50 00, METAL FABRICATIONS, for miscellaneous metal support materials and prime coat painting requirements.
- D. Attachment to Concrete Building Construction:
 1. Concrete insert: MSS SP-58, Type 18.
 2. Self-drilling expansion shields and machine bolt expansion anchors: Permitted in concrete not less than 102 mm (four inches) thick when approved by the Resident Engineer for each job condition.

3. Power-driven fasteners: Permitted in existing concrete or masonry not less than 102 mm (four inches) thick when approved by the Resident Engineer for each job condition.
- E. Attachment to Steel Building Construction:
1. Welded attachment: MSS SP-58, Type 22.
 2. Beam clamps: MSS SP-58, Types 20, 21, 28 or 29. Type 23 C-clamp may be used for individual copper tubing up to 23mm (7/8-inch) outside diameter.
- F. Attachment to Metal Pan or Deck: As required for materials specified in Section 05 31 00, STEEL DECKING
- G. Attachment to existing structure: Support from existing floor/roof frame.
- H. Attachment to Wood Construction: Wood screws or lag bolts.
- I. Hanger Rods: Hot-rolled steel, ASTM A36 or A575 for allowable load listed in MSS SP-58. For piping, provide adjustment means for controlling level or slope. Types 13 or 15 turn-buckles shall provide 38 mm (1-1/2 inches) minimum of adjustment and incorporate locknuts. All-thread rods are acceptable.
- J. Hangers Supporting Multiple Pipes (Trapeze Hangers): Galvanized, cold formed, lipped steel channel horizontal member, not less than 41 mm by 41 mm (1-5/8 inches by 1-5/8 inches), 2.7 mm (No. 12 gage), designed to accept special spring held, hardened steel nuts. Not permitted for steam supply and condensate piping.
1. Allowable hanger load: Manufacturers rating less 91kg (200 pounds).
 2. Guide individual pipes on the horizontal member of every other trapeze hanger with 6 mm (1/4-inch) U-bolt fabricated from steel rod. Provide Type 40 insulation shield, secured by two 13mm (1/2-inch) galvanized steel bands, or preinsulated calcium silicate shield for insulated piping at each hanger.
- K. Supports for Piping Systems:
1. Select hangers sized to encircle insulation on insulated piping. Refer to Section 23 07 11, HVAC, PLUMBING, AND BOILER PLANT INSULATION for insulation thickness. To protect insulation, provide Type 39 saddles for roller type supports or preinsulated calcium silicate shields. Provide Type 40 insulation shield or preinsulated calcium silicate shield at all other types of supports and hangers including those for preinsulated piping.
 2. Piping Systems except High and Medium Pressure Steam (MSS SP-58):
 - a. Standard clevis hanger: Type 1; provide locknut.
 - b. Riser clamps: Type 8.
 - c. Wall brackets: Types 31, 32 or 33.

- d. Roller supports: Type 41, 43, 44 and 46.
 - e. Saddle support: Type 36, 37 or 38.
 - f. Turnbuckle: Types 13 or 15. Preinsulate.
 - g. U-bolt clamp: Type 24.
 - h. Copper Tube:
 - 1) Hangers, clamps and other support material in contact with tubing shall be painted with copper colored epoxy paint, plastic coated or taped with non adhesive isolation tape to prevent electrolysis.
 - 2) For vertical runs use epoxy painted or plastic coated riser clamps.
 - 3) For supporting tube to strut: Provide epoxy painted pipe straps for copper tube or plastic inserted vibration isolation clamps.
 - 4) Insulated Lines: Provide pre-insulated calcium silicate shields sized for copper tube.
 - i. Supports for plastic or glass piping: As recommended by the pipe manufacturer with black rubber tape extending one inch beyond steel support or clamp.
3. High and Medium Pressure Steam (MSS SP-58):
- a. Provide eye rod or Type 17 eye nut near the upper attachment.
 - b. Piping 50 mm (2 inches) and larger: Type 43 roller hanger. For roller hangers requiring seismic bracing provide a Type 1 clevis hanger with Type 41 roller attached by flat side bars.
4. Convertor and Expansion Tank Hangers: May be Type 1 sized for the shell diameter.
Insulation where required will cover the hangers.
- L. Pre-insulated Calcium Silicate Shields:
- 1. Provide 360 degree water resistant high density 965 kPa (140 psi) compressive strength calcium silicate shields encased in galvanized metal.
 - 2. Pre-insulated calcium silicate shields to be installed at the point of support during erection.
 - 3. Shield thickness shall match the pipe insulation.
 - 4. The type of shield is selected by the temperature of the pipe, the load it must carry, and the type of support it will be used with.
 - a. Shields for supporting chilled or cold water shall have insulation that extends a minimum of 1 inch past the sheet metal. Provide for an adequate vapor barrier in chilled lines.
 - b. The pre-insulated calcium silicate shield shall support the maximum allowable water filled span as indicated in MSS-SP 69. To support the load, the shields may have one or more of the following features: structural inserts 4138 kPa (600 psi) compressive

strength, an extra bottom metal shield, or formed structural steel (ASTM A36) wear plates welded to the bottom sheet metal jacket.

5. Shields may be used on steel clevis hanger type supports, roller supports or flat surfaces.

2.12 PIPE PENETRATIONS

- A. Install sleeves during construction for other than blocked out floor openings for risers in mechanical bays.
- B. To prevent accidental liquid spills from passing to a lower level, provide the following:
 1. For sleeves: Extend sleeve 25 mm (one inch) above finished floor and provide sealant for watertight joint.
 2. For blocked out floor openings: Provide 40 mm (1-1/2 inch) angle set in silicone adhesive around opening.
 3. For drilled penetrations: Provide 40 mm (1-1/2 inch) angle ring or square set in silicone adhesive around penetration.
- C. Penetrations are not allowed through beams or ribs, but may be installed in concrete beam flanges. Any deviation from these requirements must receive prior approval of Resident Engineer.
- D. Sheet Metal, Plastic, or Moisture-resistant Fiber Sleeves: Provide for pipe passing through floors, interior walls, and partitions, unless brass or steel pipe sleeves are specifically called for below.
- E. Cast Iron or Zinc Coated Pipe Sleeves: Provide for pipe passing through exterior walls below grade. Make space between sleeve and pipe watertight with a modular or link rubber seal. Seal shall be applied at both ends of sleeve.
- F. Galvanized Steel or an alternate Black Iron Pipe with asphalt coating Sleeves: Provide for pipe passing through concrete beam flanges, except where brass pipe sleeves are called for. Provide sleeve for pipe passing through floor of mechanical rooms, laundry work rooms, and animal rooms above basement. Except in mechanical rooms, connect sleeve with floor plate.
- G. Brass Pipe Sleeves: Provide for pipe passing through quarry tile, terrazzo or ceramic tile floors. Connect sleeve with floor plate.
- H. Sleeves are not required for wall hydrants for fire department connections or in drywall construction.
- I. Sleeve Clearance: Sleeve through floors, walls, partitions, and beam flanges shall be one inch greater in diameter than external diameter of pipe. Sleeve for pipe with insulation shall be large enough to accommodate the insulation. Interior openings shall be caulked tight with fire stopping material and sealant to prevent the spread of fire, smoke, and gases.

- J. Sealant and Adhesives: Shall be as specified in Section 07 92 00, JOINT SEALANTS.

2.13 DUCT PENETRATIONS

- A. Provide curbs for roof mounted piping, ductwork and equipment. Curbs shall be 18 inches high with continuously welded seams, built-in cant strip, interior baffle with acoustic insulation, curb bottom, hinged curb adapter.
- B. Provide firestopping for openings through fire and smoke barriers, maintaining minimum required rating of floor, ceiling or wall assembly. See section 07 84 00, FIRESTOPPING.

2.14 SPECIAL TOOLS AND LUBRICANTS

- A. Furnish, and turn over to the Resident Engineer, tools not readily available commercially, that are required for disassembly or adjustment of equipment and machinery furnished.
- B. Grease Guns with Attachments for Applicable Fittings: One for each type of grease required for each motor or other equipment.
- C. Refrigerant Tools: Provide system charging/Evacuation equipment, gauges, fittings, and tools required for maintenance of furnished equipment.
- D. Tool Containers: Hardwood or metal, permanently identified for intended service and mounted, or located, where directed by the Resident Engineer.
- E. Lubricants: A minimum of 0.95 L (one quart) of oil, and 0.45 kg (one pound) of grease, of equipment manufacturer's recommended grade and type, in unopened containers and properly identified as to use for each different application.

2.15 WALL, FLOOR AND CEILING PLATES

- A. Material and Type: Chrome plated brass or chrome plated steel, one piece or split type with concealed hinge, with set screw for fastening to pipe, or sleeve. Use plates that fit tight around pipes, cover openings around pipes and cover the entire pipe sleeve projection.
- B. Thickness: Not less than 2.4 mm (3/32-inch) for floor plates. For wall and ceiling plates, not less than 0.64 mm (0.025-inch) for up to 80 mm (3-inch pipe), 0.89 mm (0.035-inch) for larger pipe.
- C. Locations: Use where pipe penetrates floors, walls and ceilings in exposed locations, in finished areas only. Provide a watertight joint in spaces where brass or steel pipe sleeves are specified.

2.16 ASBESTOS

Materials containing asbestos are not permitted.

PART 3 - EXECUTION

3.1 ARRANGEMENT AND INSTALLATION OF EQUIPMENT AND PIPING

- A. Coordinate location of piping, sleeves, inserts, hangers, ductwork and equipment. Locate piping, sleeves, inserts, hangers, ductwork and equipment clear of windows, doors, openings, light

outlets, and other services and utilities. Prepare equipment layout drawings to coordinate proper location and personnel access of all facilities. Submit the drawings for review as required by Part 1. Follow manufacturer's published recommendations for installation methods not otherwise specified.

- B. Operating Personnel Access and Observation Provisions: Select and arrange all equipment and systems to provide clear view and easy access, without use of portable ladders, for maintenance and operation of all devices including, but not limited to: all equipment items, valves, filters, strainers, transmitters, sensors, control devices. All gages and indicators shall be clearly visible by personnel standing on the floor or on permanent platforms. Do not reduce or change maintenance and operating space and access provisions that are shown on the drawings.
- C. Equipment and Piping Support: Coordinate structural systems necessary for pipe and equipment support with pipe and equipment locations to permit proper installation.
- D. Location of pipe sleeves, trenches and chases shall be accurately coordinated with equipment and piping locations.
- E. Cutting Holes:
 - 1. Cut holes through concrete and masonry by rotary core drill. Pneumatic hammer, impact electric, and hand or manual hammer type drill will not be allowed, except as permitted by Resident Engineer where working area space is limited.
 - 2. Locate holes to avoid interference with structural members such as beams or grade beams. Holes shall be laid out in advance and drilling done only after approval by Resident Engineer. If the Contractor considers it necessary to drill through structural members, this matter shall be referred to Resident Engineer for approval.
 - 3. Do not penetrate membrane waterproofing.
- F. Interconnection of Instrumentation or Control Devices: Generally, electrical and pneumatic interconnections are not shown but must be provided.
- G. Minor Piping: Generally, small diameter pipe runs from drips and drains, water cooling, and other service are not shown but must be provided.
- H. Electrical and Pneumatic Interconnection of Controls and Instruments: This generally not shown but must be provided. This includes interconnections of sensors, transmitters, transducers, control devices, control and instrumentation panels, instruments and computer workstations. Comply with NFPA-70.
- I. Protection and Cleaning:

1. Equipment and materials shall be carefully handled, properly stored, and adequately protected to prevent damage before and during installation, in accordance with the manufacturer's recommendations and as approved by the Resident Engineer. Damaged or defective items in the opinion of the Resident Engineer, shall be replaced.
 2. Protect all finished parts of equipment, such as shafts and bearings where accessible, from rust prior to operation by means of protective grease coating and wrapping. Close pipe openings with caps or plugs during installation. Tightly cover and protect fixtures and equipment against dirt, water chemical, or mechanical injury. At completion of all work thoroughly clean fixtures, exposed materials and equipment.
- J. Concrete and Grout: Use concrete and shrink compensating grout 25 MPa (3000 psi) minimum, specified in Section 03 30 00, CAST-IN-PLACE CONCRETE.
- K. Install gages, thermometers, valves and other devices with due regard for ease in reading or operating and maintaining said devices. Locate and position thermometers and gages to be easily read by operator or staff standing on floor or walkway provided. Servicing shall not require dismantling adjacent equipment or pipe work.
- L. Install steam piping expansion joints as per manufacturer's recommendations.
- M. Work in Existing Building:
1. Perform as specified in Article, OPERATIONS AND STORAGE AREAS, Article, ALTERATIONS, and Article, RESTORATION of the Section 01 00 00, GENERAL REQUIREMENTS for relocation of existing equipment, alterations and restoration of existing building(s).
 2. As specified in Section 01 00 00, GENERAL REQUIREMENTS, Article, OPERATIONS AND STORAGE AREAS, make alterations to existing service piping at times that will least interfere with normal operation of the facility.
 3. Cut required openings through existing masonry and reinforced concrete using diamond core drills. Use of pneumatic hammer type drills, impact type electric drills, and hand or manual hammer type drills, will be permitted only with approval of the Resident Engineer. Locate openings that will least effect structural slabs, columns, ribs or beams. Refer to the Resident Engineer for determination of proper design for openings through structural sections and opening layouts approval, prior to cutting or drilling into structure. After Resident Engineer's approval, carefully cut opening through construction no larger than absolutely necessary for the required installation.

- N. Switchgear/Electrical Equipment Drip Protection: Every effort shall be made to eliminate the installation of pipe above electrical and telephone switchgear. If this is not possible, encase pipe in a second pipe with a minimum of joints. Installation of piping, ductwork, leak protection apparatus or other installations foreign to the electrical installation shall be located in the space equal to the width and depth of the equipment and extending from to a height of 1.8 m (6 ft.) above the equipment of to ceiling structure, whichever is lower (NFPA 70).
- O. Inaccessible Equipment:
1. Where the Government determines that the Contractor has installed equipment not conveniently accessible for operation and maintenance, equipment shall be removed and reinstalled or remedial action performed as directed at no additional cost to the Government.
 2. The term "conveniently accessible" is defined as capable of being reached without the use of ladders, or without climbing or crawling under or over obstacles such as motors, fans, pumps, belt guards, transformers, high voltage lines, piping, and ductwork.

3.2 TEMPORARY PIPING AND EQUIPMENT

- A. Continuity of operation of existing facilities will generally require temporary installation or relocation of equipment and piping.
- B. The Contractor shall provide all required facilities in accordance with the requirements of phased construction and maintenance of service. All piping and equipment shall be properly supported, sloped to drain, operate without excessive stress, and shall be insulated where injury can occur to personnel by contact with operating facilities. The requirements of Paragraph 3.1 apply.
- C. Temporary facilities and piping shall be completely removed and any openings in structures sealed. Provide necessary blind flanges and caps to seal open piping remaining in service.

3.3 RIGGING

- A. Design is based on application of available equipment. Openings in building structures are planned to accommodate design scheme.
- B. Alternative methods of equipment delivery may be offered by Contractor and will be considered by Government under specified restrictions of phasing and maintenance of service as well as structural integrity of the building.
- C. Close all openings in the building when not required for rigging operations to maintain proper environment in the facility for Government operation and maintenance of service.
- D. Contractor shall provide all facilities required to deliver specified equipment and place on foundations. Attachments to structures for rigging purposes and support of equipment on

structures shall be Contractor's full responsibility. Upon request, the Government will check structure adequacy and advise Contractor of recommended restrictions.

- E. Contractor shall check all clearances, weight limitations and shall offer a rigging plan designed by a Registered Professional Engineer. All modifications to structures, including reinforcement thereof, shall be at Contractor's cost, time and responsibility.
- F. Rigging plan and methods shall be referred to Resident Engineer for evaluation prior to actual work.
- G. Restore building to original condition upon completion of rigging work.

3.4 PIPE AND EQUIPMENT SUPPORTS

- A. Where hanger spacing does not correspond with joist or rib spacing, use structural steel channels secured directly to joist and rib structure that will correspond to the required hanger spacing, and then suspend the equipment and piping from the channels. Drill or burn holes in structural steel only with the prior approval of the Resident Engineer.
- B. Use of chain, wire or strap hangers; wood for blocking, stays and bracing; or, hangers suspended from piping above will not be permitted. Replace or thoroughly clean rusty products and paint with zinc primer.
- C. Use hanger rods that are straight and vertical. Turnbuckles for vertical adjustments may be omitted where limited space prevents use. Provide a minimum of 15 mm (1/2-inch) clearance between pipe or piping covering and adjacent work.
- D. HVAC Horizontal Pipe Support Spacing: Refer to MSS SP-69. Provide additional supports at valves, strainers, in-line pumps and other heavy components. Provide a support within one foot of each elbow.
- E. HVAC Vertical Pipe Supports:
 - 1. Up to 150 mm (6-inch pipe), 9 m (30 feet) long, bolt riser clamps to the pipe below couplings, or welded to the pipe and rests supports securely on the building structure.
 - 2. Vertical pipe larger than the foregoing, support on base elbows or tees, or substantial pipe legs extending to the building structure.
- F. Overhead Supports:
 - 1. The basic structural system of the building is designed to sustain the loads imposed by equipment and piping to be supported overhead.
 - 2. Provide steel structural members, in addition to those shown, of adequate capability to support the imposed loads, located in accordance with the final approved layout of equipment and piping.

3. Tubing and capillary systems shall be supported in channel troughs.

G. Floor Supports:

1. Provide concrete bases, concrete anchor blocks and pedestals, and structural steel systems for support of equipment and piping. Anchor and dowel concrete bases and structural systems to resist forces under operating and seismic conditions (if applicable) without excessive displacement or structural failure.
2. Do not locate or install bases and supports until equipment mounted thereon has been approved. Size bases to match equipment mounted thereon plus 50 mm (2 inch) excess on all edges. Boiler foundations shall have horizontal dimensions that exceed boiler base frame dimensions by at least 150 mm (6 inches) on all sides. Refer to structural drawings. Bases shall be neatly finished and smoothed, shall have chamfered edges at the top, and shall be suitable for painting.
3. All equipment shall be shimmed, leveled, firmly anchored, and grouted with epoxy grout. Anchor bolts shall be placed in sleeves, anchored to the bases. Fill the annular space between sleeves and bolts with a granular material to permit alignment and realignment.

3.5 MECHANICAL DEMOLITION

- A. Rigging access, other than indicated on the drawings, shall be provided by the Contractor after approval for structural integrity by the Resident Engineer. Such access shall be provided without additional cost or time to the Government. Where work is in an operating plant, provide approved protection from dust and debris at all times for the safety of plant personnel and maintenance of plant operation and environment of the plant.
- B. In an operating facility, maintain the operation, cleanliness and safety. Government personnel will be carrying on their normal duties of operating, cleaning and maintaining equipment and plant operation. Confine the work to the immediate area concerned; maintain cleanliness and wet down demolished materials to eliminate dust. Do not permit debris to accumulate in the area to the detriment of plant operation. Perform all flame cutting to maintain the fire safety integrity of this plant. Adequate fire extinguishing facilities shall be available at all times. Perform all work in accordance with recognized fire protection standards. Inspection will be made by personnel of the VA Medical Center, and Contractor shall follow all directives of the RE or COTR with regard to rigging, safety, fire safety, and maintenance of operations.
- C. Completely remove all piping, wiring, conduit, and other devices associated with the equipment not to be re-used in the new work. This includes all pipe, valves, fittings, insulation, and all hangers including the top connection and any fastenings to building structural systems. Seal all

openings, after removal of equipment, pipes, ducts, and other penetrations in roof, walls, floors, in an approved manner and in accordance with plans and specifications where specifically covered. Structural integrity of the building system shall be maintained. Reference shall also be made to the drawings and specifications of the other disciplines in the project for additional facilities to be demolished or handled.

- D. All valves including gate, globe, ball, butterfly and check, all pressure gages and thermometers with wells shall remain Government property and shall be removed and delivered to Resident Engineer and stored as directed. The Contractor shall remove all other material and equipment, devices and demolition debris under these plans and specifications. Such material shall be removed from Government property expeditiously and shall not be allowed to accumulate.

3.6 CLEANING AND PAINTING

- A. Prior to final inspection and acceptance of the plant and facilities for beneficial use by the Government, the plant facilities, equipment and systems shall be thoroughly cleaned and painted. Refer to Section 09 91 00, PAINTING.
- B. In addition, the following special conditions apply:
 - 1. Cleaning shall be thorough. Use solvents, cleaning materials and methods recommended by the manufacturers for the specific tasks. Remove all rust prior to painting and from surfaces to remain unpainted. Repair scratches, scuffs, and abrasions prior to applying prime and finish coats.
 - 2. Material And Equipment Not To Be Painted Includes:
 - a. Motors, controllers, control switches, and safety switches.
 - b. Control and interlock devices.
 - c. Regulators.
 - d. Pressure reducing valves.
 - e. Control valves and thermostatic elements.
 - f. Lubrication devices and grease fittings.
 - g. Copper, brass, aluminum, stainless steel and bronze surfaces.
 - h. Valve stems and rotating shafts.
 - i. Pressure gauges and thermometers.
 - j. Glass.
 - k. Name plates.
 - 3. Control and instrument panels shall be cleaned, damaged surfaces repaired, and shall be touched-up with matching paint obtained from panel manufacturer.

4. Pumps, motors, steel and cast iron bases, and coupling guards shall be cleaned, and shall be touched-up with the same color as utilized by the pump manufacturer
5. Temporary Facilities: Apply paint to surfaces that do not have existing finish coats.
6. Paint shall withstand the following temperatures without peeling or discoloration:
 - a. Condensate and feedwater -- 38 degrees C (100 degrees F) on insulation jacket surface and 120 degrees C (250 degrees F) on metal pipe surface.
 - b. Steam -- 52 degrees C (125 degrees F) on insulation jacket surface and 190 degrees C (375 degrees F) on metal pipe surface.
7. Final result shall be smooth, even-colored, even-textured factory finish on all items.
Completely repaint the entire piece of equipment if necessary to achieve this.

3.7 IDENTIFICATION SIGNS

- A. Provide laminated plastic signs, with engraved lettering not less than 5 mm (3/16-inch) high, designating functions, for all equipment, switches, motor controllers, relays, meters, control devices, including automatic control valves. Nomenclature and identification symbols shall correspond to that used in maintenance manual, and in diagrams specified elsewhere. Attach by chain, adhesive, or screws.
- B. Factory Built Equipment: Metal plate, securely attached, with name and address of manufacturer, serial number, model number, size, performance.
- C. Pipe Identification: Refer to Section 09 91 00, PAINTING.

3.8 MOTOR AND DRIVE ALIGNMENT

- A. Belt Drive: Set driving and driven shafts parallel and align so that the corresponding grooves are in the same plane.
- B. Direct-connect Drive: Securely mount motor in accurate alignment so that shafts are free from both angular and parallel misalignment when both motor and driven machine are operating at normal temperatures.

3.9 LUBRICATION

- A. Lubricate all devices requiring lubrication prior to initial operation. Field-check all devices for proper lubrication.
- B. Equip all devices with required lubrication fittings or devices. Provide a minimum of one liter (one quart) of oil and 0.5 kg (one pound) of grease of manufacturer's recommended grade and type for each different application; also provide 12 grease sticks for lubricated plug valves. Deliver all materials to Resident Engineer in unopened containers that are properly identified as to application.

- C. Provide a separate grease gun with attachments for applicable fittings for each type of grease applied.
- D. All lubrication points shall be accessible without disassembling equipment, except to remove access plates.

3.11 STARTUP AND TEMPORARY OPERATION

Start up equipment as described in equipment specifications. Verify that vibration is within specified tolerance prior to extended operation. Temporary use of equipment is specified in Section 01 00 00, GENERAL REQUIREMENTS, Article, TEMPORARY USE OF MECHANICAL AND ELECTRICAL EQUIPMENT.

3.12 OPERATING AND PERFORMANCE TESTS

- A. Prior to the final inspection, perform required tests as specified in Section 01 00 00, GENERAL REQUIREMENTS and submit the test reports and records to the Resident Engineer.
- B. Should evidence of malfunction in any tested system, or piece of equipment or component part thereof, occur during or as a result of tests, make proper corrections, repairs or replacements, and repeat tests at no additional cost to the Government.
- C. When completion of certain work or system occurs at a time when final control settings and adjustments cannot be properly made to make performance tests, then make performance tests for heating systems and for cooling systems respectively during first actual seasonal use of respective systems following completion of work.

3.13 INSTRUCTIONS TO VA PERSONNEL

Provide in accordance with Article, INSTRUCTIONS, of Section 01 00 00, GENERAL REQUIREMENTS.

--- E N D ---

SECTION 23 05 12
GENERAL MOTOR REQUIREMENTS FOR HVAC AND STEAM GENERATION
EQUIPMENT

PART 1 - GENERAL

1.1 DESCRIPTION:

This section specifies the furnishing, installation and connection of motors for HVAC and steam generation equipment.

1.2 RELATED WORK:

- A. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: General electrical requirements common to more than one Section of Division 26.
- B. Section 26 29 11, LOW-VOLTAGE MOTOR STARTERS: Starters, control and protection for motors.
- C. Section 23 05 11, COMMON WORK RESULTS FOR HVAC.
- D. Section 23 21 23, HYDRONIC PUMPS.
- E. Section 23 22 23, STEAM CONDENSATE PUMPS.
- F. Section 23 34 00, HVAC FANS.
- H. Section 23 36 00, AIR TERMINAL UNITS.
- I. Section 23 73 00, INDOOR CENTRAL-STATION AIR-HANDLING UNITS.
- J. Section 23 81 00, DECENTRALIZED UNITARY HVAC EQUIPMENT.
- K. Section 23 23 00, REFRIGERANT PIPING.
- L. Section 23 82 00, CONVECTION HEATING and COOLING UNITS.

1.3 SUBMITTALS:

- A. In accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS, submit the following:
- B. Shop Drawings:
 - 1. Provide documentation to demonstrate compliance with drawings and specifications.
 - 2. Include electrical ratings, efficiency, bearing data, power factor, frame size, dimensions, mounting details, materials, horsepower, voltage, phase, speed (RPM), enclosure, starting characteristics, torque characteristics, code letter, full load and locked rotor current, service factor, and lubrication method.
- C. Manuals:
 - 1. Submit simultaneously with the shop drawings, companion copies of complete installation, maintenance and operating manuals, including technical data sheets and application data.

- D. Certification: Two weeks prior to final inspection, unless otherwise noted, submit four copies of the following certification to the Resident Engineer:
 - 1. Certification that the motors have been applied, installed, adjusted, lubricated, and tested according to manufacturer published recommendations.
- E. Completed System Readiness Checklists provided by the Commissioning Agent and completed by the contractor, signed by a qualified technician and dated on the date of completion, in accordance with the requirements of Section 23 08 00 COMMISSIONING OF HVAC SYSTEMS.

1.4 APPLICABLE PUBLICATIONS:

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. National Electrical Manufacturers Association (NEMA):
 - MG 1-2006 Rev. 1 2009Motors and Generators
 - MG 2-2001 Rev. 1 2007.....Safety Standard for Construction and Guide for Selection, Installation and Use of Electric Motors and Generators
- C. National Fire Protection Association (NFPA):
 - 70-2009National Electrical Code (NEC)
- D. Institute of Electrical and Electronics Engineers (IEEE):
 - 112-04Standard Test Procedure for Polyphase Induction Motors and Generators
- E. American Society of Heating, Refrigerating and Air-Conditioning Engineers (ASHRAE):
 - 90.1-2007Energy Standard for Buildings Except Low-Rise Residential Buildings

PART 2 - PRODUCTS

2.1 MOTORS:

- A. For alternating current, fractional and integral horsepower motors, NEMA Publications MG 1 and MG 2 shall apply.
- B. All material and equipment furnished and installation methods shall conform to the requirements of Section 26 29 11, LOW-VOLTAGE MOTOR STARTERS; and Section 26 05 21, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES (600 VOLTS AND BELOW). Provide all electrical wiring, conduit, and devices necessary for the proper connection, protection and operation of the systems. Provide premium efficiency type motors as scheduled.

Unless otherwise specified for a particular application, use electric motors with the following requirements.

- C. Single-phase Motors: Motors for centrifugal fans and pumps may be split phase or permanent split capacitor (PSC) type. Provide capacitor-start type for hard starting applications.
 - 1. Contractor's Option - Electrically Commutated motor (EC Type): Motor shall be brushless DC type specifically designed for applications with heavy duty ball bearings and electronic commutation. The motor shall be speed controllable down to 20% of full speed and 85% efficient at all speeds.
- D. Poly-phase Motors: NEMA Design B, Squirrel cage, induction type.
 - 1. Two Speed Motors: Each two-speed motor shall have two separate windings. Provide a time-delay (20 seconds minimum) relay for switching from high to low speed.
- E. Voltage ratings shall be as follows:
 - 1. Single phase:
 - a. Motors connected to 120-volt systems: 115 volts.
 - b. Motors connected to 208-volt systems: 200 volts.
 - c. Motors connected to 240 volt or 480 volt systems: 230/460 volts, dual connection.
 - 2. Three phase:
 - a. Motors connected to 208-volt systems: 200 volts.
 - b. Motors, less than 74.6 kW (100 HP), connected to 240 volt or 480 volt systems: 208-230/460 volts, dual connection.
 - c. Motors, 74.6 kW (100 HP) or larger, connected to 240-volt systems: 230 volts.
 - d. Motors, 74.6 kW (100 HP) or larger, connected to 480-volt systems: 460 volts.
 - e. Motors connected to high voltage systems (Over 600V): Shall conform to NEMA Standards for connection to the nominal system voltage shown on the drawings.
- F. Number of phases shall be as follows:
 - 1. Motors, less than 373 W (1/2 HP): Single phase.
 - 2. Motors, 373 W (1/2 HP) and larger: 3 phase.
 - 3. Exceptions:
 - a. Hermetically sealed motors.
 - b. Motors for equipment assemblies, less than 746 W (one HP), may be single phase provided the manufacturer of the proposed assemblies cannot supply the assemblies with three phase motors.

- G. Motors shall be designed for operating the connected loads continuously in a 40°C (104°F) environment, where the motors are installed, without exceeding the NEMA standard temperature rises for the motor insulation. If the motors exceed 40°C (104°F), the motors shall be rated for the actual ambient temperatures.
- H. Motor designs, as indicated by the NEMA code letters, shall be coordinated with the connected loads to assure adequate starting and running torque.
- I. Motor Enclosures:
1. Shall be the NEMA types as specified and/or shown on the drawings.
 2. Where the types of motor enclosures are not shown on the drawings, they shall be the NEMA types, which are most suitable for the environmental conditions where the motors are being installed. Enclosure requirements for certain conditions are as follows:
 - a. Motors located outdoors, indoors in wet or high humidity locations, or in unfiltered airstreams shall be totally enclosed type.
 - b. Where motors are located in an NEC 511 classified area, provide TEFC explosion proof motor enclosures.
 - c. Where motors are located in a corrosive environment, provide TEFC enclosures with corrosion resistant finish.
 3. Enclosures shall be primed and finish coated at the factory with manufacturer's prime coat and standard finish.
- J. Special Requirements:
1. Where motor power requirements of equipment furnished deviate from power shown on plans, provide electrical service designed under the requirements of NFPA 70 without additional time or cost to the Government.
 2. Assemblies of motors, starters, controls and interlocks on factory assembled and wired devices shall be in accordance with the requirements of this specification.
 3. Wire and cable materials specified in the electrical division of the specifications shall be modified as follows:
 - a. Wiring material located where temperatures can exceed 71 degrees C (160 degrees F) shall be stranded copper with Teflon FEP insulation with jacket. This includes wiring on the boilers.
 - b. Other wiring at boilers and to control panels shall be NFPA 70 designation THWN.
 - c. Provide shielded conductors or wiring in separate conduits for all instrumentation and control systems where recommended by manufacturer of equipment.

4. Select motor sizes so that the motors do not operate into the service factor at maximum required loads on the driven equipment. Motors on pumps shall be sized for non-overloading at all points on the pump performance curves.
 5. Motors utilized with variable frequency drives shall be rated “inverter-duty” per NEMA Standard, MG1, Part 31.4.4.2. Provide motor shaft grounding apparatus that will protect bearings from damage from stray currents.
- K. Additional requirements for specific motors, as indicated in the other sections listed in Article 1.2, shall also apply.
- L. Energy-Efficient Motors (Motor Efficiencies): All permanently wired polyphase motors of 746 Watts (1 HP) or more shall meet the minimum full-load efficiencies as indicated in the following table. Motors of 746 Watts or more with open, drip-proof or totally enclosed fan-cooled enclosures shall be NEMA premium efficiency type, unless otherwise indicated. Motors provided as an integral part of motor driven equipment are excluded from this requirement if a minimum seasonal or overall efficiency requirement is indicated for that equipment by the provisions of another section. Motors not specified as “premium efficiency” shall comply with the Energy Policy Act of 2005 (EPACT).

Minimum Premium Efficiencies Open Drip-Proof				Minimum Premium Efficiencies Totally Enclosed Fan-Cooled			
Rating kW (HP)	1200 RPM	1800 RPM	3600 RPM	Rating kW (HP)	1200 RPM	1800 RPM	3600 RPM
0.746 (1)	82.5%	85.5%	77.0%	0.746 (1)	82.5%	85.5%	77.0%
1.12 (1.5)	86.5%	86.5%	84.0%	1.12 (1.5)	87.5%	86.5%	84.0%
1.49 (2)	87.5%	86.5%	85.5%	1.49 (2)	88.5%	86.5%	85.5%
2.24 (3)	88.5%	89.5%	85.5%	2.24 (3)	89.5%	89.5%	86.5%
3.73 (5)	89.5%	89.5%	86.5%	3.73 (5)	89.5%	89.5%	88.5%
5.60 (7.5)	90.2%	91.0%	88.5%	5.60 (7.5)	91.0%	91.7%	89.5%
7.46 (10)	91.7%	91.7%	89.5%	7.46 (10)	91.0%	91.7%	90.2%
11.2 (15)	91.7%	93.0%	90.2%	11.2 (15)	91.7%	92.4%	91.0%
14.9 (20)	92.4%	93.0%	91.0%	14.9 (20)	91.7%	93.0%	91.0%
18.7 (25)	93.0%	93.6%	91.7%	18.7 (25)	93.0%	93.6%	91.7%
22.4 (30)	93.6%	94.1%	91.7%	22.4 (30)	93.0%	93.6%	91.7%

29.8 (40)	94.1%	94.1%	92.4%	29.8 (40)	94.1%	94.1%	92.4%
37.3 (50)	94.1%	94.5%	93.0%	37.3 (50)	94.1%	94.5%	93.0%
44.8 (60)	94.5%	95.0%	93.6%	44.8 (60)	94.5%	95.0%	93.6%
56.9 (75)	94.5%	95.0%	93.6%	56.9 (75)	94.5%	95.4%	93.6%
74.6 (100)	95.0%	95.4%	93.6%	74.6 (100)	95.0%	95.4%	94.1%
93.3 (125)	95.0%	95.4%	94.1%	93.3 (125)	95.0%	95.4%	95.0%
112 (150)	95.4%	95.8%	94.1%	112 (150)	95.8%	95.8%	95.0%
149.2 (200)	95.4%	95.8%	95.0%	149.2 (200)	95.8%	96.2%	95.4%

M. Minimum Power Factor at Full Load and Rated Voltage: 90 percent at 1200 RPM, 1800 RPM and 3600 RPM.

PART 3 - EXECUTION

3.1 INSTALLATION:

Install motors in accordance with manufacturer's recommendations, the NEC, NEMA, as shown on the drawings and/or as required by other sections of these specifications.

3.2 FIELD TESTS

- A. Perform an electric insulation resistance Test using a megohmmeter on all motors after installation, before start-up. All shall test free from grounds.
- B. Perform Load test in accordance with ANSI/IEEE 112, Test Method B, to determine freedom from electrical or mechanical defects and compliance with performance data.
- C. Insulation Resistance: Not less than one-half meg-ohm between stator conductors and frame, to be determined at the time of final inspection.

3.3 STARTUP AND TESTING

- A. The Commissioning Agent will observe startup and contractor testing of selected equipment. Coordinate the startup and contractor testing schedules with Resident Engineer and Commissioning Agent. Provide a minimum of 7 days prior notice.

3.5 DEMONSTRATION AND TRAINING

- A. Provide services of manufacturer's technical representative for four hours to instruct VA personnel in operation and maintenance of units.
- B. Submit training plans and instructor qualifications in accordance with the requirements of Section 23 08 00 – COMMISSIONING OF HVAC SYSTEMS.

--- E N D ---

SECTION 23 05 41
NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT

PART 1 - GENERAL

1.1 DESCRIPTION

Noise criteria , vibration tolerance and vibration isolation for HVAC and plumbing work.

1.2 RELATED WORK

- A. Section 03 30 00, CAST-IN-PLACE CONCRETE: Requirements for concrete inertia bases.
- C. Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION: General mechanical requirements and items, which are common to more than one section of Division 23.
- D. Section 23 22 13, STEAM and CONDENSATE HEATING PIPING: Requirements for flexible pipe connectors to reciprocating and rotating mechanical equipment.
- E. Section 23 73 00, INDOOR CENTRAL-STATION AIR-HANDLING UNITS: Requirements for optional Air Handling Unit internal vibration isolation.
- F. Section 23 31 00, HVAC DUCTS and CASINGS: requirements for flexible duct connectors, sound attenuators and sound absorbing duct lining.
- G. SECTION 23 05 93, TESTING, ADJUSTING, and BALANCING FOR HVAC: requirements for sound and vibration tests.
- H. SECTION 23 37 00, AIR OUTLETS and INLETS: noise requirements for G-grilles.
- I. SECTION 23 21 23, HYDRONIC PUMPS: vibration isolation requirements for pumps.
- J. SECTION 23 34 00, HVAC FANS: sound and vibration isolation requirements for fans.

1.3 QUALITY ASSURANCE

- A. Refer to article, QUALITY ASSURANCE in specification Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.
- B. Noise Criteria:
 - 1. Noise levels in all 8 octave bands due to equipment and duct systems shall not exceed following NC levels:

TYPE OF ROOM	NC LEVEL
Bathrooms and Toilet Rooms	40
Corridors (Nurse Stations)	40
Corridors(Public)	40
Examination Rooms	35
Lobbies, Waiting Areas	40
Offices, Large Open	40

Offices, Small Private	35
Patient Rooms	35
Shops	50
SPD (Decontamination and Clean Preparation)	45
Treatment Rooms	35
X-Ray and General Work Rooms	40

2. For equipment which has no sound power ratings scheduled on the plans, the contractor shall select equipment such that the fore-going noise criteria, local ordinance noise levels, and OSHA requirements are not exceeded. Selection procedure shall be in accordance with ASHRAE Fundamentals Handbook, Chapter 7, Sound and Vibration.
 3. An allowance, not to exceed 5db, may be added to the measured value to compensate for the variation of the room attenuating effect between room test condition prior to occupancy and design condition after occupancy which may include the addition of sound absorbing material, such as, furniture. This allowance may not be taken after occupancy. The room attenuating effect is defined as the difference between sound power level emitted to room and sound pressure level in room.
 4. In absence of specified measurement requirements, measure equipment noise levels three feet from equipment and at an elevation of maximum noise generation.
1. Equipment:
 - a. All mechanical equipment not supported with isolators external to the unit shall be securely anchored to the structure. Such mechanical equipment shall be properly supported to resist a horizontal force of 20 percent of the weight of the equipment furnished.
 2. Piping: Refer to specification Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.
 3. Ductwork: Refer to specification Section 23 31 00, HVAC DUCTS AND CASINGS.
- D. Allowable Vibration Tolerances for Rotating, Non-reciprocating Equipment: Not to exceed a self-excited vibration maximum velocity of 5 mm per second (0.20 inch per second) RMS, filter in, when measured with a vibration meter on bearing caps of machine in vertical, horizontal and axial directions or measured at equipment mounting feet if bearings are concealed. Measurements for internally isolated fans and motors may be made at the mounting feet.

1.4 SUBMITTALS

- A. Submit in accordance with specification Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Manufacturer's Literature and Data:
 - 1. Vibration isolators:
 - a. Floor mountings
 - b. Hangers
 - c. Snubbers
 - d. Thrust restraints
 - 2. Bases.
 - 4. Acoustical enclosures.
- C. Isolator manufacturer shall furnish with submittal load calculations for selection of isolators, including supplemental bases, based on lowest operating speed of equipment supported.

1.5 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American Society of Heating, Refrigerating and Air-Conditioning Engineers, Inc. (ASHRAE):
2009Fundamentals Handbook, Chapter 7, Sound and Vibration
- C. American Society for Testing and Materials (ASTM):
A123/A123M-09.....Standard Specification for Zinc (Hot-Dip Galvanized) Coatings
on Iron and Steel Products
A307-07bStandard Specification for Carbon Steel Bolts and Studs, 60,000
PSI Tensile Strength
D2240-05(2010).....Standard Test Method for Rubber Property - Durometer
Hardness
- D. Manufacturers Standardization (MSS):
SP-58-2009Pipe Hangers and Supports-Materials, Design and Manufacture
- E. Occupational Safety and Health Administration (OSHA):
29 CFR 1910.95Occupational Noise Exposure
- F. American Society of Civil Engineers (ASCE):
ASCE 7-10Minimum Design Loads for Buildings and Other Structures.
- G. American National Standards Institute / Sheet Metal and Air Conditioning Contractor's National Association (ANSI/SMACNA):

001-2008Seismic Restraint Manual: Guidelines for Mechanical Systems,
3rd Edition.

H. International Code Council (ICC):

2009 IBC.....International Building Code.

I. Department of Veterans Affairs (VA):

H-18-8 2010.....Seismic Design Requirements.

PART 2 - PRODUCTS

2.1 GENERAL REQUIREMENTS

- A. Type of isolator, base, and minimum static deflection shall be as required for each specific equipment application as recommended by isolator or equipment manufacturer but subject to minimum requirements indicated herein and in the schedule on the drawings.
- B. Elastometric Isolators shall comply with ASTM D2240 and be oil resistant neoprene with a maximum stiffness of 60 durometer and have a straight-line deflection curve.
- C. Exposure to weather: Isolator housings to be either hot dipped galvanized or powder coated to ASTM B117 salt spray testing standards. Springs to be powder coated or electro galvanized. All hardware to be electro galvanized. In addition provide limit stops to resist wind velocity. Velocity pressure established by wind shall be calculated in accordance with section 1609 of the International Building Code. A minimum wind velocity of 75 mph shall be employed.
- D. Uniform Loading: Select and locate isolators to produce uniform loading and deflection even when equipment weight is not evenly distributed.
- E. Color code isolators by type and size for easy identification of capacity.

2.2 SEISMIC RESTRAINT REQUIREMENTS FOR EQUIPMENTS

- A. Bolt pad mounted equipment, without vibration isolators, to the floor or other support using ASTM A307 standard bolting material.
- B. Floor mounted equipment, with vibration Isolators: Type SS. Where Type N isolators are used provide channel frame base horizontal restraints bolted to the floor, or other support, on all sides of the equipment Size and material required for the base shall be as recommended by the isolator manufacturer.
- C. On all sides of suspended equipment, provide bracing for rigid supports and provide restraints for resiliently supported equipment.

2.3 VIBRATION ISOLATORS

- A. Floor Mountings:
 - 1. Double Deflection Neoprene (Type N): Shall include neoprene covered steel support plated (top and bottom), friction pads, and necessary bolt holes.

2. Spring Isolators (Type S): Shall be free-standing, laterally stable and include acoustical friction pads and leveling bolts. Isolators shall have a minimum ratio of spring diameter-to--operating spring height of 1.0 and an additional travel to solid equal to 50 percent of rated deflection.
 3. Captive Spring Mount for Seismic Restraint (Type SS):
 - a. Design mounts to resiliently resist seismic forces in all directions. Snubbing shall take place in all modes with adjustment to limit upward, downward, and horizontal travel to a maximum of 6 mm (1/4-inch) before contacting snubbers. Mountings shall have a minimum rating of one G coefficient of gravity as calculated and certified by a registered structural engineer.
 - b. All mountings shall have leveling bolts that must be rigidly bolted to the equipment. Spring diameters shall be no less than 0.8 of the compressed height of the spring at rated load. Springs shall have a minimum additional travel to solid equal to 50 percent of the rated deflection. Mountings shall have ports for spring inspection. Provide an all directional neoprene cushion collar around the equipment bolt.
 4. Spring Isolators with Vertical Limit Stops (Type SP): Similar to spring isolators noted above, except include a vertical limit stop to limit upward travel if weight is removed and also to reduce movement and spring extension due to wind loads. Provide clearance around restraining bolts to prevent mechanical short circuiting.
 5. Pads (Type D), Washers (Type W), and Bushings (Type L): Pads shall be natural rubber or neoprene waffle, neoprene and steel waffle, or reinforced duck and neoprene. Washers and bushings shall be reinforced duck and neoprene. Washers and bushings shall be reinforced duck and neoprene. Size pads for a maximum load of 345 kPa (50 pounds per square inch).
 6. Seismic Pad (Type DS): Pads shall be natural rubber / neoprene waffle with steel top plate and drilled for an anchor bolt. Washers and bushings shall be reinforced duck and neoprene. Size pads for a maximum load of 345 kPa (50 pounds per square inch).
- B. Hangers: Shall be combination neoprene and springs unless otherwise noted and shall allow for expansion of pipe.
1. Combination Neoprene and Spring (Type H): Vibration hanger shall contain a spring and double deflection neoprene element in series. Spring shall have a diameter not less than 0.8 of compressed operating spring height. Spring shall have a minimum additional travel of 50 percent between design height and solid height. Spring shall permit a 15 degree angular misalignment without rubbing on hanger box.

2. Spring Position Hanger (Type HP): Similar to combination neoprene and spring hanger except hanger shall hold piping at a fixed elevation during installation and include a secondary adjustment feature to transfer load to spring while maintaining same position.
 3. Neoprene (Type HN): Vibration hanger shall contain a double deflection type neoprene isolation element. Hanger rod shall be separated from contact with hanger bracket by a neoprene grommet.
 4. Spring (Type HS): Vibration hanger shall contain a coiled steel spring in series with a neoprene grommet. Spring shall have a diameter not less than 0.8 of compressed operating spring height. Spring shall have a minimum additional travel of 50 percent between design height and solid height. Spring shall permit a 15 degree angular misalignment without rubbing on hanger box.
 5. Hanger supports for piping 50 mm (2 inches) and larger shall have a pointer and scale deflection indicator.
 6. Hangers used in seismic applications shall be provided with a neoprene and steel rebound washer installed ¼' clear of bottom of hanger housing in operation to prevent spring from excessive upward travel
- C. Snubbers: Each spring mounted base shall have a minimum of four all-directional or eight two directional (two per side) seismic snubbers that are double acting. Elastomeric materials shall be shock absorbent neoprene bridge quality bearing pads, maximum 60 durometer, replaceable and have a minimum thickness of 6 mm (1/4 inch). Air gap between hard and resilient material shall be not less than 3 mm (1/8 inch) nor more than 6 mm (1/4 inch). Restraints shall be capable of withstanding design load without permanent deformation.
- D. Thrust Restraints (Type THR): Restraints shall provide a spring element contained in a steel frame with neoprene pads at each end attachment. Restraints shall have factory preset thrust and be field adjustable to allow a maximum movement of 6 mm (1/4 inch) when the fan starts and stops. Restraint assemblies shall include rods, angle brackets and other hardware for field installation.

2.4 BASES

- A. Rails (Type R): Design rails with isolator brackets to reduce mounting height of equipment and cradle machines having legs or bases that do not require a complete supplementary base. To assure adequate stiffness, height of members shall be a minimum of 1/12 of longest base dimension but not less than 100 mm (4 inches). Where rails are used with neoprene mounts for small fans or close coupled pumps, extend rails to compensate overhang of housing.

- B. Integral Structural Steel Base (Type B): Design base with isolator brackets to reduce mounting height of equipment which require a complete supplementary rigid base. To assure adequate stiffness, height of members shall be a minimum of 1/12 of longest base dimension, but not less than 100 mm (four inches).
- C. Inertia Base (Type I): Base shall be a reinforced concrete inertia base. Pour concrete into a welded steel channel frame, incorporating prelocated equipment anchor bolts and pipe sleeves. Level the concrete to provide a smooth uniform bearing surface for equipment mounting. Provide grout under uneven supports. Channel depth shall be a minimum of 1/12 of longest dimension of base but not less than 150 mm (six inches). Form shall include 13-mm (1/2-inch) reinforcing bars welded in place on minimum of 203 mm (eight inch) centers running both ways in a layer 40 mm (1-1/2 inches) above bottom. Use height saving brackets in all mounting locations. Weight of inertia base shall be equal to or greater than weight of equipment supported to provide a maximum peak-to-peak displacement of 2 mm (1/16 inch).
- D. Curb Mounted Isolation Base (Type CB): Fabricate from aluminum to fit on top of standard curb with overlap to allow water run-off and have wind and water seals which shall not interfere with spring action. Provide resilient snubbers with 6 mm (1/4 inch) clearance for wind resistance. Top and bottom bearing surfaces shall have sponge type weather seals. Integral spring isolators shall comply with Spring Isolator (Type S) requirements.

2.5 SOUND ATTENUATING UNITS

Refer to specification Section 23 31 00, HVAC DUCTS and CASINGS.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Vibration Isolation:
 - 1. No metal-to-metal contact will be permitted between fixed and floating parts.
 - 2. Connections to Equipment: Allow for deflections equal to or greater than equipment deflections. Electrical, drain, piping connections, and other items made to rotating or reciprocating equipment (pumps, compressors, etc.) which rests on vibration isolators, shall be isolated from building structure for first three hangers or supports with a deflection equal to that used on the corresponding equipment.
 - 3. Common Foundation: Mount each electric motor on same foundation as driven machine. Hold driving motor and driven machine in positive rigid alignment with provision for adjusting motor alignment and belt tension. Bases shall be level throughout length and width. Provide shims to facilitate pipe connections, leveling, and bolting.

4. Provide heat shields where elastomers are subject to temperatures over 38 degrees C (100 degrees F).
 5. Extend bases for pipe elbow supports at discharge and suction connections at pumps. Pipe elbow supports shall not short circuit pump vibration to structure.
 6. Non-rotating equipment such as heat exchangers and convertors shall be mounted on isolation units having the same static deflection as the isolation hangers or support of the pipe connected to the equipment.
- B. Inspection and Adjustments: Check for vibration and noise transmission through connections, piping, ductwork, foundations, and walls. Adjust, repair, or replace isolators as required to reduce vibration and noise transmissions to specified levels.

3.2 ADJUSTING

- A. Adjust vibration isolators after piping systems are filled and equipment is at operating weight.
- B. Adjust limit stops on restrained spring isolators to mount equipment at normal operating height. After equipment installation is complete, adjust limit stops so they are out of contact during normal operation.
- C. Attach thrust limits at centerline of thrust and adjust to a maximum of 1/4inch (6-mm) movement during start and stop.
- D. Adjust active height of spring isolators.
- E. Adjust snubbers according to manufacturer's recommendations.
- F. Adjust seismic restraints to permit free movement of equipment within normal mode of operation.
- G. Torque anchor bolts according to equipment manufacturer's recommendations to resist seismic forces.

--- E N D ---

SELECTION GUIDE FOR VIBRATION ISOLATORS

EQUIPMENT	ON GRADE			20FT FLOOR SPAN			30FT FLOOR SPAN			40FT FLOOR SPAN			50FT FLOOR SPAN		
	BAS E TYP E	ISOL TYP E	MIN DEF L	BAS E TYP E	ISOL TYP E	MIN DEF L	BAS E TYP E	ISOL TYP E	MIN DEF L	BAS E TYP E	ISOL TYP E	MIN DEF L	BAS E TYP E	ISOL TYP E	MIN DEF L
REFRIGERATION MACHINES															
ABSORPTION	---	D	0.3	---	SP	0.8	---	SP	1.5	---	SP	1.5	---	SP	2.0
PACKAGED HERMETIC	---	D	0.3	---	SP	0.8	---	SP	1.5	---	SP	1.5	R	SP	2.5
OPEN CENTRIFUGAL	B	D	0.3	B	SP	0.8	---	SP	1.5	B	SP	1.5	B	SP	3.5
RECIPROCATING:															
ALL	---	D	0.3	---	SP	0.8	R	SP	2.0	R	SP	2.5	R	SP	3.5
COMPRESSORS AND VACUUM PUMPS															
UP THROUGH 1-1/2 HP	---	D,L, W	0.8	----	D,L, W	0.8	---	D,L, W	1.5	---	D,L, W	1.5	---	D,L, W	---
2 HP AND OVER:															
500 - 750 RPM	---	D	0.8	---	S	0.8	---	S	1.5	---	S	1.5	---	S	2.5
750 RPM & OVER	---	D	0.8	---	S	0.8	---	S	1.5	---	S	1.5	---	S	2.5
PUMPS															

EQUIPMENT		ON GRADE			20FT FLOOR SPAN			30FT FLOOR SPAN			40FT FLOOR SPAN			50FT FLOOR SPAN		
		BAS E TYP E	ISOL TYP E	MIN DEF L	BAS E TYP E	ISOL TYP E	MIN DEF L	BAS E TYP E	ISOL TYP E	MIN DEF L	BAS E TYP E	ISOL TYP E	MIN DEF L	BAS E TYP E	ISOL TYP E	MIN DEF L
CLOSE COUPLE D	UP TO 1-1/2 HP	---	---	---	---	D,L, W	---	---	D,L, W	---	---	D,L, W	---	---	D,L, W	---
	2 HP & OVER	---	---	0.8	I	S	1.5	I	S	1.5	I	S	1.5	I	S	2.0
LARGE INLINE	Up to 25 HP	---	---	0.75	---	S	1.50	---	S	1.50	---	S	1.50	---	---	NA
	26 HP THRU 30 HP	---	---	1.0	---	S	1.50	---	S	2.50	---	S	2.50	---	---	NA
BASE MOUNTED	UP TO 10 HP	---	---	---	---	D,L, W	---	---	D,L, W	---	---	D,L, W	---	---	D,L, W	---
	15 HP THRU 40 HP	I	S	1.0	I	S	2.0	I	S	2.0	I	S	2.0	I	S	2.0
	50 HP & OVER	I	S	1.0	I	S	2.0	I	S	2.5	I	S	2.5	I	S	2.5
ROOF FANS																
ABOVE OCCUPIED AREAS:																
5 HP & OVER		---	---	---	CB	S	1.0	CB	S	1.0	CB	S	1.0	CB	S	1.0

EQUIPMENT	ON GRADE			20FT FLOOR SPAN			30FT FLOOR SPAN			40FT FLOOR SPAN			50FT FLOOR SPAN		
	BAS E TYP E	ISOL TYP E	MIN DEF L	BAS E TYP E	ISOL TYP E	MIN DEF L	BAS E TYP E	ISOL TYP E	MIN DEF L	BAS E TYP E	ISOL TYP E	MIN DEF L	BAS E TYP E	ISOL TYP E	MIN DEF L
CENTRIFUGAL FANS															
UP TO 50 HP:															
UP TO 200 RPM	B	N	0.3	B	S	2.5	B	S	2.5	B	S	3.5	B	S	3.5
201 - 300 RPM	B	N	0.3	B	S	2.0	B	S	2.5	B	S	2.5	B	S	3.5
301 - 500 RPM	B	N	0.3	B	S	2.0	B	S	2.0	B	S	2.5	B	S	3.5
501 RPM & OVER	B	N	0.3	B	S	2.0	B	S	2.0	B	S	2.0	B	S	2.5
60 HP & OVER:															
UP TO 300 RPM	B	S	2.0	I	S	2.5	I	S	3.5	I	S	3.5	I	S	3.5
301 - 500 RPM	B	S	2.0	I	S	2.0	I	S	2.5	I	S	3.5	I	S	3.5
501 RPM & OVER	B	S	1.0	I	S	2.0	I	S	2.0	I	S	2.5	I	S	2.5
COOLING TOWERS															
UP TO 500 RPM	---	---	---	---	SP	2.5	---	SP	2.5	---	SP	2.5	---	SP	3.5
501 RPM & OVER	---	---	---	---	SP	0.75	---	SP	0.75	---	SP	1.5	---	SP	2.5
INTERNAL COMBUSTION ENGINES															
UP TO 25 HP	I	N	0.75	I	N	1.5	I	S	2.5	I	S	3.5	I	S	4.5

EQUIPMENT	ON GRADE			20FT FLOOR SPAN			30FT FLOOR SPAN			40FT FLOOR SPAN			50FT FLOOR SPAN		
	BAS E TYP E	ISOL TYP E	MIN DEF L	BAS E TYP E	ISOL TYP E	MIN DEF L	BAS E TYP E	ISOL TYP E	MIN DEF L	BAS E TYP E	ISOL TYP E	MIN DEF L	BAS E TYP E	ISOL TYP E	MIN DEF L
30 THRU 100 HP	I	N	0.75	I	N	1.5	I	S	2.5	I	S	3.5	I	S	4.5
125 HP & OVER	I	N	0.75	I	N	1.5	I	S	2.5	I	S	3.5	I	S	4.5
AIR HANDLING UNIT PACKAGES															
SUSPENDED:															
UP THRU 5 HP	---	---	---	---	H	1.0	---	H	1.0	---	H	1.0	---	H	1.0
7-1/2 HP & OVER:															
UP TO 500 RPM	---	---	---	---	H, THR	1.5	---	H, THR	2.5	---	H, THR	2.5	---	H, THR	2.5
501 RPM & OVER	---	---	---	---	H, THR	0.8	---	H, THR	0.8	---	H, THR	0.8	---	H, THR	2.0
FLOOR MOUNTED:															
UP THRU 5 HP	---	D	---	---	S	1.0	---	S	1.0	---	S	1.0	---	S	1.0
7-1/2 HP & OVER:															
UP TO 500 RPM	---	D	---	R	S, THR	1.5	R	S, THR	2.5	R	S, THR	2.5	R	S, THR	2.5
501 RPM & OVER	---	D	---	---	S, THR	0.8	---	S, THR	0.8	R	S, THR	1.5	R	S, THR	2.0
HEAT PUMPS															
ALL	---	S	0.75	---	S	0.75	---	S	0.75	CB	S	1.5	---	---	NA

EQUIPMENT	ON GRADE			20FT FLOOR SPAN			30FT FLOOR SPAN			40FT FLOOR SPAN			50FT FLOOR SPAN		
	BAS E TYP E	ISOL TYP E	MIN DEF L	BAS E TYP E	ISOL TYP E	MIN DEF L	BAS E TYP E	ISOL TYP E	MIN DEF L	BAS E TYP E	ISOL TYP E	MIN DEF L	BAS E TYP E	ISOL TYP E	MIN DEF L
CONDENSING UNITS															
ALL	---	SS	0.25	---	SS	0.75	---	SS	1.5	CB	SS	1.5	---	---	NA
IN-LINE CENTRIFUGAL AND VANE AXIAL FANS, FLOOR MOUNTED: (APR 9)															
UP THRU 50 HP:															
UP TO 300 RPM	---	D	---	R	S	2.5	R	S	2.5	R	S	2.5	R	S	3.5
301 - 500 RPM	---	D	---	R	S	2.0	R	S	2.0	R	S	2.5	R	S	2.5
501 - & OVER	---	D	---	---	S	1.0	---	S	1.0	R	S	2.0	R	S	2.5
60 HP AND OVER:															
301 - 500 RPM	R	S	1.0	R	S	2.0	R	S	2.0	R	S	2.5	R	S	3.5
501 RPM & OVER	R	S	1.0	R	S	2.0	R	S	2.0	R	S	2.0	R	S	2.5

NOTES:

1. Edit the Table above to suit where isolator, other than those shown, are used, such as for seismic restraints and position limit stops.
2. For suspended floors lighter than 100 mm (4 inch) thick concrete, select deflection requirements from next higher span.
3. For separate chiller building on grade, pump isolators may be omitted.
4. Direct bolt fire pumps to concrete base. Provide pads (D) for domestic water booster pump package.
5. For projects in seismic areas, use only SS & DS type isolators and snubbers.
6. For floor mounted in-line centrifugal blowers (ARR 1): use "B" type in lieu of "R" type base.
7. Suspended: Use "H" isolators of same deflection as floor mounted.

SECTION 23 05 93
TESTING, ADJUSTING, AND BALANCING FOR HVAC

PART 1 - GENERAL

1.1 DESCRIPTION

- A. Testing, adjusting, and balancing (TAB) of heating, ventilating and air conditioning (HVAC) systems. TAB includes the following:
 - 1. Planning systematic TAB procedures.
 - 2. Design Review Report.
 - 3. Systems Inspection report.
 - 4. Duct Air Leakage test report.
 - 5. Systems Readiness Report.
 - 6. Balancing air and water distribution systems; adjustment of total system to provide design performance; and testing performance of equipment and automatic controls.
 - 7. Vibration and sound measurements.
 - 8. Recording and reporting results.
- B. Definitions:
 - 1. Basic TAB used in this Section: Chapter 37, "Testing, Adjusting and Balancing" of ASHRAE Handbook, "HVAC Applications".
 - 2. TAB: Testing, Adjusting and Balancing; the process of checking and adjusting HVAC systems to meet design objectives.
 - 3. AABC: Associated Air Balance Council.
 - 4. NEBB: National Environmental Balancing Bureau.
 - 5. Hydronic Systems: Includes // chilled water, // condenser water, // heating hot water // and glycol-water systems. //
 - 6. Air Systems: Includes all outside air, supply air, return air, exhaust air and relief air systems.
 - 7. Flow rate tolerance: The allowable percentage variation, minus to plus, of actual flow rate from values (design) in the contract documents.

1.2 RELATED WORK

- A. Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION: General Mechanical Requirements.
- B. Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT: Noise and Vibration Requirements.

- C. Section 23 07 11, HVAC, PLUMBING, AND BOILER PLANT INSULATION: Piping and Equipment Insulation.
- F. Section 23 36 00, AIR TERMINAL UNITS: Terminal Units Performance.
- G. Section 23 31 00, HVAC DUCTS AND CASINGS: Duct Leakage.
- H. Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC: Controls and Instrumentation Settings.

1.3 QUALITY ASSURANCE

- A. Refer to Articles, Quality Assurance and Submittals, in Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION.
- B. Qualifications:
 1. TAB Agency: The TAB agency shall be a subcontractor of the General Contractor and shall report to and be paid by the General Contractor.
 2. The TAB agency shall be either a certified member of AABC or certified by the NEBB to perform TAB service for HVAC, water balancing and vibrations and sound testing of equipment. The certification shall be maintained for the entire duration of duties specified herein. If, for any reason, the agency loses subject certification during this period, the General Contractor shall immediately notify the Resident Engineer and submit another TAB firm for approval. Any agency that has been the subject of disciplinary action by either the AABC or the NEBB within the five years preceding Contract Award shall not be eligible to perform any work related to the TAB. All work performed in this Section and in other related Sections by the TAB agency shall be considered invalid if the TAB agency loses its certification prior to Contract completion, and the successor agency's review shows unsatisfactory work performed by the predecessor agency.
 3. TAB Specialist: The TAB specialist shall be either a member of AABC or an experienced technician of the Agency certified by NEBB. The certification shall be maintained for the entire duration of duties specified herein. If, for any reason, the Specialist loses subject certification during this period, the General Contractor shall immediately notify the Resident Engineer and submit another TAB Specialist for approval. Any individual that has been the subject of disciplinary action by either the AABC or the NEBB within the five years preceding Contract Award shall not be eligible to perform any duties related to the HVAC systems, including TAB. All work specified in this Section and in other related Sections performed by the TAB specialist shall be considered invalid if the TAB Specialist loses its certification prior to Contract completion and must be performed by an approved successor.

4. TAB Specialist shall be identified by the General Contractor within 60 days after the notice to proceed. The TAB specialist will be coordinating, scheduling and reporting all TAB work and related activities and will provide necessary information as required by the Resident Engineer. The responsibilities would specifically include:
 - a. Shall directly supervise all TAB work.
 - b. Shall sign the TAB reports that bear the seal of the TAB standard. The reports shall be accompanied by report forms and schematic drawings required by the TAB standard, AABC or NEBB.
 - c. Would follow all TAB work through its satisfactory completion.
 - d. Shall provide final markings of settings of all HVAC adjustment devices.
 - e. Permanently mark location of duct test ports.
 5. All TAB technicians performing actual TAB work shall be experienced and must have done satisfactory work on a minimum of 3 projects comparable in size and complexity to this project. Qualifications must be certified by the TAB agency in writing.
- C. Test Equipment Criteria: The instrumentation shall meet the accuracy/calibration requirements established by AABC National Standards or by NEBB Procedural Standards for Testing, Adjusting and Balancing of Environmental Systems and instrument manufacturer. Provide calibration history of the instruments to be used for test and balance purpose.
- D. Tab Criteria:
1. One or more of the applicable AABC, NEBB or SMACNA publications, supplemented by ASHRAE Handbook "HVAC Applications" Chapter 36, and requirements stated herein shall be the basis for planning, procedures, and reports.
 2. Flow rate tolerance: Following tolerances are allowed. For tolerances not mentioned herein follow ASHRAE Handbook "HVAC Applications", Chapter 36, as a guideline. Air Filter resistance during tests, artificially imposed if necessary, shall be at least 90 percent of final values for pre-filters and after-filters.
 - a. Air handling unit and all other fans, cubic meters/min (cubic feet per minute): Minus 0 percent to plus 10 percent.
 - b. Air terminal units (maximum values): Minus 2 percent to plus 10 percent.
 - c. Exhaust hoods/cabinets: 0 percent to plus 10 percent.
 - d. Minimum outside air: 0 percent to plus 10 percent.
 - e. Individual room air outlets and inlets, and air flow rates not mentioned above: Minus 2 percent to plus 10 percent except if the air to a space is 100 CFM or less the tolerance would be 0 to plus 5 percent.

- f. Heating hot water pumps and hot water coils: Minus 5 percent to plus 5 percent.
 - g. Chilled water and condenser water pumps: 0 percent to plus 5 percent.
 - h. Chilled water coils: 0 percent to plus 5 percent.
- 3. Systems shall be adjusted for energy efficient operation as described in PART 3.
- 4. Typical TAB procedures and results shall be demonstrated to the Resident Engineer for one air distribution system (including all fans, three terminal units, three rooms) and one hydronic system (pumps and three coils) as follows:
 - a. When field TAB work begins.
 - b. During each partial final inspection and the final inspection for the project if requested by VA.

1.4 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Submit names and qualifications of TAB agency and TAB specialists within 60 days after the notice to proceed. Submit information on three recently completed projects and a list of proposed test equipment.
- C. For use by the Resident Engineer staff, submit one complete set of applicable AABC or NEBB publications that will be the basis of TAB work.
- D. Submit Following for Review and Approval:
 - 1. Design Review Report within 90 days after the system layout on air and water side is completed by the Contractor.
 - 2. Systems inspection report on equipment and installation for conformance with design.
 - 3. Duct Air Leakage Test Report.
 - 4. Systems Readiness Report.
 - 5. Intermediate and Final TAB reports covering flow balance and adjustments, performance tests, vibration tests and sound tests.
 - 6. Include in final reports uncorrected installation deficiencies noted during TAB and applicable explanatory comments on test results that differ from design requirements.
- E. Prior to request for Final or Partial Final inspection, submit completed Test and Balance report for the area.

1.5 APPLICABLE PUBLICATIONS

- A. The following publications form a part of this specification to the extent indicated by the reference thereto. In text the publications are referenced to by the acronym of the organization.

- B. American Society of Heating, Refrigerating and Air Conditioning Engineers, Inc. (ASHRAE):
2003HVAC Applications ASHRAE Handbook, Chapter 37, Testing, Adjusting, and Balancing and Chapter 47, Sound and Vibration Control
- C. Associated Air Balance Council (AABC):
2002AABC National Standards for Total System Balance
- D. National Environmental Balancing Bureau (NEBB):
7th Edition 2005.....Procedural Standards for Testing, Adjusting, Balancing of Environmental Systems
1st Edition 1994.....Procedural Standards for the Measurement and Assessment of Sound and Vibration
2nd Edition 1999Procedural Standards for Building Systems Commissioning
- E. Sheet Metal and Air Conditioning Contractors National Association (SMACNA):
3rd Edition 2002.....HVAC SYSTEMS-Testing, Adjusting and Balancing

PART 2 - PRODUCTS

2.1 PLUGS

Provide plastic plugs to seal holes drilled in ductwork for test purposes.

2.2 INSULATION REPAIR MATERIAL

See Section 23 07 11, HVAC, PLUMBING, AND BOILER PLANT INSULATION. Provide for repair of insulation removed or damaged for TAB work.

PART 3 - EXECUTION

3.1 GENERAL

- A. Refer to TAB Criteria in Article, Quality Assurance.
- B. Obtain applicable contract documents and copies of approved submittals for HVAC equipment and automatic control systems.

3.2 DESIGN REVIEW REPORT

The TAB Specialist shall review the Contract Plans and specifications and advise the Resident Engineer of any design deficiencies that would prevent the HVAC systems from effectively operating in accordance with the sequence of operation specified or prevent the effective and accurate TAB of the system. The TAB Specialist shall provide a report individually listing each deficiency and the corresponding proposed corrective action necessary for proper system operation.

3.3 SYSTEMS INSPECTION REPORT

- A. Inspect equipment and installation for conformance with design.

- B. The inspection and report is to be done after air distribution equipment is on site and duct installation has begun, but well in advance of performance testing and balancing work. The purpose of the inspection is to identify and report deviations from design and ensure that systems will be ready for TAB at the appropriate time.
- C. Reports: Follow check list format developed by AABC, NEBB or SMACNA, supplemented by narrative comments, with emphasis on air handling units and fans. Check for conformance with submittals. Verify that diffuser and register sizes are correct. Check air terminal unit installation including their duct sizes and routing.

3.4 DUCT AIR LEAKAGE TEST REPORT

See paragraphs "Duct leakage Tests and Repairs" in Section 23 31 00, HVAC DUCTS AND CASINGS for TAB agency's role and responsibilities in witnessing, recording and reporting of deficiencies.

3.5 SYSTEM READINESS REPORT

- A. Inspect each System to ensure that it is complete including installation and operation of controls.
- B. Verify that all items such as ductwork piping, ports, terminals, connectors, etc., that is required for TAB are installed. Provide a report to the Resident Engineer.

3.6 TAB REPORTS

- A. Submit an intermediate report for 25 percent of systems and equipment tested and balanced to establish satisfactory test results.
- B. The TAB contractor shall provide raw data immediately in writing to the Resident Engineer if there is a problem in achieving intended results before submitting a formal report.
- C. If over 20 percent of readings in the intermediate report fall outside the acceptable range, the TAB report shall be considered invalid and all contract TAB work shall be repeated and re-submitted for approval.
- D. Do not proceed with the remaining systems until intermediate report is approved by the Resident Engineer.

3.7 TAB PROCEDURES

- A. Tab shall be performed in accordance with the requirement of the Standard under which TAB agency is certified by either AABC or NEBB.
- B. General: During TAB all related system components shall be in full operation. Fan and pump rotation, motor loads and equipment vibration shall be checked and corrected as necessary before proceeding with TAB. Set controls and/or block off parts of distribution systems to simulate design operation of variable volume air or water systems for test and balance work.

- C. Coordinate TAB procedures with any phased construction completion requirements for the project. Provide TAB reports for each phase of the project prior to partial final inspections of each phase of the project.
- D. Allow sufficient time in construction schedule for TAB and submission of all reports for an organized and timely correction of deficiencies.
- E. Air Balance and Equipment Test: Include air handling units, fans, terminal units, fan coil units, room diffusers/outlets/inlets, computer room AC units, and laboratory fume hoods and cabinets.
 - 1. Artificially load air filters by partial blanking to produce air pressure drop of at least 90 percent of the design final pressure drop.
 - 2. Adjust fan speeds to provide design air flow. V-belt drives, including fixed pitch pulley requirements, are specified in Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION.
 - 3. Test and balance systems in all specified modes of operation, including variable volume, economizer, and fire emergency modes. Verify that dampers and other controls function properly.
 - 4. Variable air volume (VAV) systems:
 - a. Coordinate TAB, including system volumetric controls, with Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC.
 - b. Section 23 36 00, AIR TERMINAL UNITS, specifies that maximum and minimum flow rates for air terminal units (ATU) be factory set. Check and readjust ATU flow rates if necessary. Balance air distribution from ATU on full cooling maximum scheduled cubic meters per minute (cubic feet per minute). Reset room thermostats and check ATU operation from maximum to minimum cooling, to the heating mode, and back to cooling. Record and report the heating coil leaving air temperature when the ATU is in the maximum heating mode.
 - 5. Record final measurements for air handling equipment performance data sheets.
- F. Water Balance and Equipment Test: Include circulating pumps, convertors, coils, coolers and condensers:
 - 2. Adjust flow rates for equipment. Set coils and evaporator to values on equipment submittals, if different from values on contract drawings.
 - 3. Primary-secondary (variable volume) systems: Coordinate TAB with Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC. Balance systems at design water flow and then verify that variable flow controls function properly.

4. Record final measurements for hydronic equipment on performance data sheets. Include entering and leaving water temperatures for heating and cooling coils, and for convertors. Include entering and leaving air temperatures (DB/WB for cooling coils) for air handling units and reheat coils. Make air and water temperature measurements at the same time.

3.8 VIBRATION TESTING

- A. Furnish instruments and perform vibration measurements as specified in Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT. Field vibration balancing is specified in Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION. Provide measurements for all rotating HVAC equipment of 373 watts (1/2 horsepower) and larger, including centrifugal/screw compressors, cooling towers, pumps, fans and motors.
- B. Record initial measurements for each unit of equipment on test forms and submit a report to the Resident Engineer. Where vibration readings exceed the allowable tolerance Contractor shall be directed to correct the problem. The TAB agency shall verify that the corrections are done and submit a final report to the Resident Engineer.

3.9 SOUND TESTING

- A. Perform and record required sound measurements in accordance with Paragraph, QUALITY ASSURANCE in Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT.
 1. Take readings in one Cart room, one Exam room and one office room. The Resident Engineer may designate the specific rooms to be tested.
- B. Take measurements with a calibrated sound level meter and octave band analyzer of the accuracy required by AABC or NEBB.
- C. Sound reference levels, formulas and coefficients shall be according to ASHRAE Handbook, "HVAC Applications", Chapter 46, SOUND AND VIBRATION CONTROL.
- D. Determine compliance with specifications as follows:
 1. When sound pressure levels are specified, including the NC Criteria in Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT:
 - a. Reduce the background noise as much as possible by shutting off unrelated audible equipment.
 - b. Measure octave band sound pressure levels with specified equipment "off."
 - c. Measure octave band sound pressure levels with specified equipment "on."
 - d. Use the DIFFERENCE in corresponding readings to determine the sound pressure due to equipment.

DIFFERENCE:	0	1	2	3	4	5 to 9	10 or More
FACTOR:	10	7	4	3	2	1	0

Sound pressure level due to equipment equals sound pressure level with equipment "on" minus FACTOR.

- e. Plot octave bands of sound pressure level due to equipment for typical rooms on a graph which also shows noise criteria (NC) curves.
2. When sound power levels are specified:
 - a. Perform steps 1.a. thru 1.d., as above.
 - b. For indoor equipment: Determine room attenuating effect, i.e., difference between sound power level and sound pressure level. Determined sound power level will be the sum of sound pressure level due to equipment plus the room attenuating effect.
 - c. For outdoor equipment: Use directivity factor and distance from noise source to determine distance factor, i.e., difference between sound power level and sound pressure level. Measured sound power level will be the sum of sound pressure level due to equipment plus the distance factor. Use 10 meters (30 feet) for sound level location.
- E. Where measured sound levels exceed specified level, the installing contractor or equipment manufacturer shall take remedial action approved by the Resident Engineer and the necessary sound tests shall be repeated.

3.10 MARKING OF SETTINGS

Following approval of Tab final Report, the setting of all HVAC adjustment devices including valves, splitters and dampers shall be permanently marked by the TAB Specialist so that adjustment can be restored if disturbed at any time. Style and colors used for markings shall be coordinated with the Resident Engineer.

3.11 IDENTIFICATION OF TEST PORTS

The TAB Specialist shall permanently and legibly identify the location points of duct test ports. If the ductwork has exterior insulation, the identification shall be made on the exterior side of the insulation. All penetrations through ductwork and ductwork insulation shall be sealed to prevent air leaks and maintain integrity of vapor barrier.

- - - E N D - - -

SECTION 23 07 11 HVAC, PLUMBING, AND BOILER PLANT INSULATION

PART 1 - GENERAL

1.1 DESCRIPTION

- A. Field applied insulation for thermal efficiency and condensation control for
 - 1. HVAC piping, ductwork and equipment.
 - 2. Plumbing piping and equipment.
 - 4. Re-insulation of HVAC piping, ductwork and equipment, plumbing piping and equipment and boiler plant piping, breeching and stacks and equipment after asbestos abatement.
- B. Definitions
 - 1. ASJ: All service jacket, white finish facing or jacket.
 - 2. Air conditioned space: Space having air temperature and/or humidity controlled by mechanical equipment.
 - 3. Cold: Equipment, ductwork or piping handling media at design temperature of 16 degrees C (60 degrees F) or below.
 - 4. Concealed: Ductwork and piping above ceilings and in chases, interstitial space, and pipe spaces.
 - 5. Exposed: Piping, ductwork, and equipment exposed to view in finished areas including mechanical, Boiler Plant and electrical equipment rooms or exposed to outdoor weather. Attics and crawl spaces where air handling units are located are considered to be mechanical rooms. Shafts, chases, interstitial spaces, unfinished attics, crawl spaces and pipe basements are not considered finished areas.
 - 6. FSK: Foil-scrim-kraft facing.
 - 7. Hot: HVAC Ductwork handling air at design temperature above 16 degrees C (60 degrees F); HVAC and plumbing equipment or piping handling media above 41 degrees C (105 degrees F); Boiler Plant breechings and stack temperature range 150-370 degrees C (300-700 degrees F) and piping media and equipment 32 to 230 degrees C (90 to 450 degrees F)
 - 8. Density: kg/m^3 - kilograms per cubic meter (Pcf - pounds per cubic foot).
 - 9. Runouts: Branch pipe connections up to 25-mm (one-inch) nominal size to fan coil units or reheat coils for terminal units.
 - 10. Thermal conductance: Heat flow rate through materials.
 - a. Flat surface: Watt per square meter (BTU per hour per square foot).
 - b. Pipe or Cylinder: Watt per square meter (BTU per hour per linear foot).

- 11. Thermal Conductivity (k): Watt per meter, per degree C (BTU per inch thickness, per hour, per square foot, per degree F temperature difference).
- 14. MPS: Medium pressure steam (110 kPa [16 psig] thru 414 kPa [59 psig]).
- 15. MPR: Medium pressure steam condensate return.
- 16. LPS: Low pressure steam (103 kPa [15 psig] and below).
- 17. LPR: Low pressure steam condensate gravity return.
- 18. PC: Pumped condensate.
- 19. HWS: Hot water heating supply.
- 20. HWR: Hot water heating return.
- 28. CPD: Condensate pump discharge.
- 32. CW: Cold water.
- 33. SW: Soft water.
- 34. HW: Hot water.
- 35. CHS: Chilled water supply, and heat recovery run-around coil (deduct Alt 3) piping.
- 36. CHR: Chilled water return, and heat recovery run-around coil (deduct Alt 3) piping.
- 39. RS: Refrigerant suction.
- 40. PVDC: Polyvinylidene chloride vapor retarder jacketing, white.

1.2 RELATED WORK

- C. Section 07 84 00, FIRESTOPPING: Mineral fiber and bond breaker behind sealant.
- E. Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION:
General mechanical requirements and items, which are common to more than one section of Division 23.
- F. Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION:
General requirements pertaining to mechanical Boiler Plant work.
- H. Section 22 05 23, GENERAL-DUTY VALVES FOR PLUMBING PIPING: Hot and cold water piping.
- J. Section 23 23 00, REFRIGERANT PIPING: Requirements for refrigerant piping and fittings.
- K. Section 23 21 13, HYDRONIC PIPING and Section 23 22 13, STEAM AND CONDENSATE HEATING PIPING: Piping and equipment.
- L. Section 23 21 13, HYDRONIC PIPING: Chilled water piping.
- M. Section 23 31 00, HVAC DUCTS AND CASINGS: Ductwork, plenum and fittings.

1.3 QUALITY ASSURANCE

- A. Refer to article QUALITY ASSURANCE, in Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION.

B. Criteria:

1. Comply with NFPA 90A, particularly paragraphs 4.3.3.1 through 4.3.3.6, 4.3.10.2.6, and 5.4.6.4, parts of which are quoted as follows:

4.3.3.1 Pipe insulation and coverings, duct coverings, duct linings, vapor retarder facings, adhesives, fasteners, tapes, and supplementary materials added to air ducts, plenums, panels, and duct silencers used in duct systems, unless otherwise provided for in 4.3.3.1.2 or 4.3.3.1.3, shall have, in the form in which they are used, a maximum flame spread index of 25 without evidence of continued progressive combustion and a maximum smoke developed index of 50 when tested in accordance with NFPA 255, *Standard Method of Test of Surface Burning Characteristics of Building Materials*.

4.3.3.1.1 Where these products are to be applied with adhesives, they shall be tested with such adhesives applied, or the adhesives used shall have a maximum flame spread index of 25 and a maximum smoke developed index of 50 when in the final dry state. (See 4.2.4.2.)

4.3.3.1.2 The flame spread and smoke developed index requirements of 4.3.3.1.1 shall not apply to air duct weatherproof coverings where they are located entirely outside of a building, do not penetrate a wall or roof, and do not create an exposure hazard.

4.3.3.1.3 Smoke detectors required by 6.4.4 shall not be required to meet flame spread index or smoke developed index requirements.

4.3.3.2 Closure systems for use with rigid and flexible air ducts tested in accordance with UL 181, Standard for Safety Factory-Made Air Ducts and Air Connectors, shall have been tested, listed, and used in accordance with the conditions of their listings, in accordance with one of the following:

(1) UL 181A, Standard for Safety Closure Systems for Use with Rigid Air Ducts and Air Connectors

(2) UL 181B, Standard for Safety Closure Systems for Use with Flexible Air Ducts and Air Connectors

4.3.3.3 Air duct, panel, and plenum coverings and linings, and pipe insulation and coverings shall not flame, glow, smolder, or smoke when tested in accordance with a similar test for pipe covering, ASTM C 411, Standard Test Method for Hot-Surface Performance of High-Temperature Thermal Insulation, at the temperature to which they are exposed in service.

4.3.3.3.1 In no case shall the test temperature be below 121°C (250°F).

4.3.3.4 Air duct coverings shall not extend through walls or floors that are required to be fire stopped or required to have a fire resistance rating, unless such coverings meet the requirements of 5.4.6.4.

4.3.3.5* Air duct linings shall be interrupted at fire dampers to prevent interference with the operation of devices.

4.3.3.6 Air duct coverings shall not be installed so as to conceal or prevent the use of any service opening.

4.3.10.2.6 Materials exposed to the airflow shall be noncombustible or limited combustibles and have a maximum smoke developed index of 50 or comply with the following.

4.3.10.2.6.1 Electrical wires and cables and optical fiber cables shall be listed as noncombustible or limited combustible and have a maximum smoke developed index of 50 or shall be listed as having a maximum peak optical density of 0.5 or less, an average optical density of 0.15 or less, and a maximum flame spread distance of 1.5 m (5 ft) or less when tested in accordance with NFPA 262, Standard Method of Test for Flame Travel and Smoke of Wires and Cables for Use in Air-Handling Spaces.

4.3.10.2.6.2 Pneumatic tubing for control systems shall be listed as having a maximum peak optical density of 0.5 or less, an average optical density of 0.15 or less, and a maximum flame spread distance of 1.5 m (5 ft) or less when tested in accordance with UL 1820, Standard for Safety Fire Test of Pneumatic Tubing for Flame and Smoke Characteristics.

4.3.10.2.6.3 Nonferrous fire sprinkler piping shall be listed as having a maximum peak optical density of 0.5 or less, an average optical density of 0.15 or less, and a maximum flame spread distance of 1.5 m (5 ft) or less when tested in accordance with UL 1887, Standard for Safety Fire Test of Plastic Sprinkler Pipe for Visible Flame and Smoke Characteristics.

4.3.10.2.6.4 Optical-fiber and communication raceways shall be listed as having a maximum peak optical density of 0.5 or less, an average optical density of 0.15 or less, and a maximum flame spread distance of 1.5 m (5 ft) or less when tested in accordance with UL 2024, Standard for Safety Optical-Fiber Cable Raceway.

4.3.10.2.6.5 Loudspeakers and recessed lighting fixtures, including their assemblies and accessories, shall be permitted in the ceiling cavity plenum where listed as having a maximum peak optical density of 0.5 or less, an average optical density of 0.15 or less, and a peak heat release rate of 100 kW or less when tested in accordance with UL 2043, Standard for Safety Fire Test for Heat and Visible Smoke Release for Discrete Products and Their Accessories Installed in Air-Handling Spaces.

4.3.10.2.6.6 Supplementary materials for air distribution systems shall be permitted when complying with the provisions of 4.3.3.

4.3.10.2.6.7 Smoke detectors shall not be required to meet the provisions of this section.

5.4.6.4 Where air ducts pass through walls, floors, or partitions that are required to have a fire resistance rating and where fire dampers are not required, the opening in the construction around the air duct shall be as follows:

- (1) Not exceeding a 25.4 mm (1 in.) average clearance on all sides
- (2) Filled solid with an approved material capable of preventing the passage of flame and hot gases sufficient to ignite cotton waste when subjected to the time-temperature fire conditions required for fire barrier penetration as specified in NFPA 251, *Standard Methods of Tests of Fire Endurance of Building Construction and Materials*

2. Test methods: ASTM E84, UL 723, or NFPA 255.
3. Specified k factors are at 24 degrees C (75 degrees F) mean temperature unless stated otherwise. Where optional thermal insulation material is used, select thickness to provide thermal conductance no greater than that for the specified material. For pipe, use insulation manufacturer's published heat flow tables. For domestic hot water supply and return, run out insulation and condensation control insulation, no thickness adjustment need be made.

4. All materials shall be compatible and suitable for service temperature, and shall not contribute to corrosion or otherwise attack surface to which applied in either the wet or dry state.
- C. Every package or standard container of insulation or accessories delivered to the job site for use must have a manufacturer's stamp or label giving the name of the manufacturer and description of the material.

1.4 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Shop Drawings:
 1. All information, clearly presented, shall be included to determine compliance with drawings and specifications and ASTM, federal and military specifications.
 - a. Insulation materials: Specify each type used and state surface burning characteristics.
 - b. Insulation facings and jackets: Each type used. Make it clear that white finish will be furnished for exposed ductwork, casings and equipment.
 - c. Insulation accessory materials: Each type used.
 - d. Manufacturer's installation and fitting fabrication instructions for flexible unicellular insulation.
 - e. Make reference to applicable specification paragraph numbers for coordination.
- C. Samples:
 1. Each type of insulation: Minimum size 100 mm (4 inches) square for board/block/ blanket; 150 mm (6 inches) long, full diameter for round types.
 2. Each type of facing and jacket: Minimum size 100 mm (4 inches square).
 3. Each accessory material: Minimum 120 ML (4 ounce) liquid container or 120 gram (4 ounce) dry weight for adhesives / cement / mastic.

1.5 STORAGE AND HANDLING OF MATERIAL

Store materials in clean and dry environment, pipe covering jackets shall be clean and unmarred. Place adhesives in original containers. Maintain ambient temperatures and conditions as required by printed instructions of manufacturers of adhesives, mastics and finishing cements.

1.6 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by basic designation only.

B. Federal Specifications (Fed. Spec.):

L-P-535E (2)-91Plastic Sheet (Sheeting): Plastic Strip; Poly (Vinyl Chloride) and
Poly (Vinyl Chloride - Vinyl Acetate), Rigid.

C. Military Specifications (Mil. Spec.):

MIL-A-3316C (2)-90Adhesives, Fire-Resistant, Thermal Insulation

MIL-A-24179A (1)-87Adhesive, Flexible Unicellular-Plastic
Thermal Insulation

MIL-C-19565C (1)-88Coating Compounds, Thermal Insulation, Fire-and Water-
Resistant, Vapor-Barrier

MIL-C-20079H-87Cloth, Glass; Tape, Textile Glass; and Thread, Glass and Wire-
Reinforced Glass

D. American Society for Testing and Materials (ASTM):

A167-99Standard Specification for Stainless and Heat-Resisting
Chromium-Nickel Steel Plate, Sheet, and Strip

B209-04Standard Specification for Aluminum and Aluminum-Alloy
Sheet and Plate

C411-97Standard test method for Hot-Surface Performance of
High-Temperature Thermal Insulation

C449-00Standard Specification for Mineral Fiber Hydraulic-Setting
Thermal Insulating and Finishing Cement

C533-04Standard Specification for Calcium Silicate Block and Pipe
Thermal Insulation

C534-05Standard Specification for Preformed Flexible Elastomeric
Cellular Thermal Insulation in Sheet and Tubular Form

C547-06Standard Specification for Mineral Fiber pipe Insulation

C552-03Standard Specification for Cellular Glass Thermal Insulation

C553-02Standard Specification for Mineral Fiber Blanket Thermal
Insulation for Commercial and Industrial Applications

C585-90Standard Practice for Inner and Outer Diameters of Rigid
Thermal Insulation for Nominal Sizes of Pipe and Tubing (NPS
System) R (1998)

C612-04Standard Specification for Mineral Fiber Block and Board
Thermal Insulation

- C1126-04Standard Specification for Faced or Unfaced Rigid Cellular Phenolic Thermal Insulation
- C1136-06Standard Specification for Flexible, Low Permeance Vapor Retarders for Thermal Insulation
- D1668-97a (2006).....Standard Specification for Glass Fabrics (Woven and Treated) for Roofing and Waterproofing
- E84-06.....Standard Test Method for Surface Burning Characteristics of Building Materials
- E119-05a.....Standard Test Method for Fire Tests of Building Construction and Materials
- E136-04.....Standard Test Methods for Behavior of Materials in a Vertical Tube Furnace at 750 degrees C (1380 F)
- E. National Fire Protection Association (NFPA):
- 90A-09Installation of Air Conditioning and Ventilating Systems
- 96-09Standards for Ventilation Control and Fire Protection of Commercial Cooking Operations
- 101-09Life Safety Code
- 251-09Standard methods of Tests of Fire Endurance of Building Construction Materials
- 255-09Standard Method of tests of Surface Burning Characteristics of Building Materials
- F. Underwriters Laboratories, Inc (UL):
- 723UL Standard for Safety Test for Surface Burning Characteristics of Building Materials with Revision of 08/03
- G. Manufacturer's Standardization Society of the Valve and Fitting Industry (MSS):
- SP58-2002.....Pipe Hangers and Supports Materials, Design, and Manufacture

PART 2 - PRODUCTS

2.1 MINERAL FIBER

- A. ASTM C612 (Board, Block), Class 1 or 2, $k = 0.037$ Watt per meter, per degree C (0.26), external insulation for temperatures up to 204 degrees C (400 degrees F).
- B. ASTM C553 (Blanket, Flexible) Type I, Class B-3, Density 16 kg/m^3 (1 pcf), $k = 0.045$ (0.31), for use at temperatures up to 204 degrees C (400 degrees F)

- C. ASTM C547 (Pipe Fitting Insulation and Preformed Pipe Insulation), Class 1, $k = 0.037$ (0.26) for use at temperatures 230 degrees C (450 degrees F).

2.2 MINERAL WOOL OR REFRACTORY FIBER

- A. Comply with Standard ASTM C612, Class 3, 450 degrees C (850 degrees F).

2.3 RIGID CELLULAR PHENOLIC FOAM

- A. Preformed (molded) pipe insulation, ASTM C1126, type III, grade 1, $k = 0.021$ (0.15), for temperatures up to 121 degrees C (250 degrees F) with vapor retarder and all service jacket with polyvinyl chloride premolded fitting covering.
- B. Equipment and Duct Insulation, ASTM C 1126, type II, grade 1, $k = 0.021$ (0.15), for temperatures up to 121 degrees C (250 degrees F) with rigid cellular phenolic insulation and covering, vapor retarder and all service jacket.

2.4 CELLULAR GLASS CLOSED-CELL

- A. Comply with Standard ASTM C177, C518, density 120 kg/m³ (7.5 pcf) nominal, $k = 0.033$ (0.29) at 0 degrees C (75 degrees F).
- B. Pipe insulation for temperatures up to 200 degrees C (400 degrees F).

2.5 POLYISOCYANURATE CLOSED-CELL RIGID

- A. Preformed (fabricated) pipe insulation, ASTM C591, type IV, $K=0.027$ (0.19), for use at temperatures up to 149 degree C (300 degree F) with factory applied PVDC or all service jacket vapor retarder with polyvinyl chloride premolded fitting covers.
- B. Equipment and duct insulation, ASTM C 591, type IV, $K=0.027$ (0.19), for use at temperatures up to 149 degrees C (300 degrees F) with PVDC or all service jacket vapor retarder jacket.

2.6 FLEXIBLE ELASTOMERIC CELLULAR THERMAL

- A. ASTM C177, C518, $k = 0.039$ Watt per meter, per degree C (0.27), at 24 degrees C (75 degrees F), flame spread not over 25, smoke developed not over 50, for temperatures from minus 4 degrees C (40 degrees F) to 93 degrees C (200 degrees F). No jacket required.

2.8 CALCIUM SILICATE

- A. Preformed pipe Insulation: ASTM C533, Type I and Type II with indicator denoting asbestos-free material.
- B. Premolded Pipe Fitting Insulation: ASTM C533, Type I and Type II with indicator denoting asbestos-free material.
- C. Equipment Insulation: ASTM C533, Type I and Type II
- D. Characteristics:

Insulation Characteristics

ITEMS	TYPE I	TYPE II
Temperature, maximum degrees C (degrees F)	649 (1200)	927 (1700)
Density (dry), Kg/m ³ (lb/ ft ³)	232 (14.5)	288 (18)
Thermal conductivity: Min W/ m K (Btu in/h ft ² degrees F)@ mean temperature of 93 degrees C (200 degrees F)	0.059 (0.41)	0.078 (0.540)
Surface burning characteristics: Flame spread Index, Maximum	0	0
Smoke Density index, Maximum	0	0

2.9 INSULATION FACINGS AND JACKETS

- A. Vapor Retarder, higher strength with low water permeance ≤ 0.02 or less perm rating, Beach puncture 50 units for insulation facing on exposed ductwork, casings and equipment, and for pipe insulation jackets. Facings and jackets shall be all service type (ASJ) or PVDC Vapor Retarder jacketing.
- B. ASJ jacket shall be white kraft bonded to 0.025 mm (1 mil) thick aluminum foil, fiberglass reinforced, with pressure sensitive adhesive closure. Comply with ASTM C1136. Beach puncture 5 units, Suitable for painting without sizing. Jackets shall have minimum 40 mm (1-1/2 inch) lap on longitudinal joints and minimum 100 mm (4 inch) butt strip on end joints. Butt strip material shall be same as the jacket. Lap and butt strips shall be self-sealing type with factory-applied pressure sensitive adhesive.
- C. Vapor Retarder medium strength with low water vapor permeance of 0.02 or less perm rating), Beach puncture 25 units: Foil-Scrim-Kraft (FSK) or PVDC vapor retarder jacketing type for concealed ductwork and equipment.
- D. Glass Cloth Jackets: Presized, minimum 0.18 kg per square meter (7.8 ounces per square yard), 2000 kPa (300 psig) bursting strength with integral vapor retarder where required or specified. Weather proof if utilized for outside service.
- E. Factory composite materials may be used provided that they have been tested and certified by the manufacturer.
- F. Pipe fitting insulation covering (jackets): Fitting covering shall be premolded to match shape of fitting and shall be polyvinyl chloride (PVC) conforming to Fed Spec L-P-335, composition A, Type II Grade GU, and Type III, minimum thickness 0.7 mm (0.03 inches). Provide color matching vapor retarder pressure sensitive tape.

- G. Aluminum Jacket-Piping systems and circular breeching and stacks: ASTM B209, 3003 alloy, H-14 temper, 0.6 mm (0.023 inch) minimum thickness with locking longitudinal joints. Jackets for elbows, tees and other fittings shall be factory-fabricated to match shape of fitting and of 0.6 mm (0.024) inch minimum thickness aluminum. Fittings shall be of same construction as straight run jackets but need not be of the same alloy. Factory-fabricated stainless steel bands shall be installed on all circumferential joints. Bands shall be 20 mm (0.75 inch) wide on 450 mm (18 inch) centers. System shall be weatherproof if utilized for outside service.
- H. Aluminum jacket-Rectangular breeching: ASTM B209, 3003 alloy, H-14 temper, 0.5 mm (0.020 inches) thick with 32 mm (1-1/4 inch) corrugations or 0.8 mm (0.032 inches) thick with no corrugations. System shall be weatherproof if used for outside service.

2.10 PIPE COVERING PROTECTION SADDLES

- A. Cold pipe support: Premolded pipe insulation 180 degrees (half-shells) on bottom half of pipe at supports. Material shall be cellular glass or high density Polyisocyanurate insulation of the same thickness as adjacent insulation. Density of Polyisocyanurate insulation shall be a minimum of 48 kg/m³ (3.0 pcf).

Nominal Pipe Size and Accessories Material (Insert Blocks)	
Nominal Pipe Size mm (inches)	Insert Blocks mm (inches)
Up through 125 (5)	150 (6) long
150 (6)	150 (6) long
200 (8), 250 (10), 300 (12)	225 (9) long
350 (14), 400 (16)	300 (12) long
450 through 600 (18 through 24)	350 (14) long

- B. Warm or hot pipe supports: Premolded pipe insulation (180 degree half-shells) on bottom half of pipe at supports. Material shall be high density Polyisocyanurate (for temperatures up to 149 degrees C [300 degrees F]), cellular glass or calcium silicate. Insulation at supports shall have same thickness as adjacent insulation. Density of Polyisocyanurate insulation shall be a minimum of 48 kg/m³ (3.0 pcf).
- C. Boiler Plant Pipe supports: MSS SP58, Type 39. Apply at all pipe support points, except where MSS SP58, Type 3 pipe clamps provided as part of the support system.

2.11 ADHESIVE, MASTIC, CEMENT

- A. Mil. Spec. MIL-A-3316, Class 1: Jacket and lap adhesive and protective finish coating for insulation.

- B. Mil. Spec. MIL-A-3316, Class 2: Adhesive for laps and for adhering insulation to metal surfaces.
- C. Mil. Spec. MIL-A-24179, Type II Class 1: Adhesive for installing flexible unicellular insulation and for laps and general use.
- D. Mil. Spec. MIL-C-19565, Type I: Protective finish for outdoor use.
- E. Mil. Spec. MIL-C-19565, Type I or Type II: Vapor barrier compound for indoor use.
- F. ASTM C449: Mineral fiber hydraulic-setting thermal insulating and finishing cement.
- G. Other: Insulation manufacturers' published recommendations.

2.12 MECHANICAL FASTENERS

- A. Pins, anchors: Welded pins, or metal or nylon anchors with tin-coated or fiber washer, or clips.
Pin diameter shall be as recommended by the insulation manufacturer.
- B. Staples: Outward clinching monel or stainless steel.
- C. Wire: 1.3 mm thick (18 gage) soft annealed galvanized or 1.9 mm (14 gage) copper clad steel or nickel copper alloy.
- D. Bands: 20 mm (3/4 inch) nominal width, brass, galvanized steel, aluminum or stainless steel.

2.13 REINFORCEMENT AND FINISHES

- A. Glass fabric, open weave: ASTM D1668, Type III (resin treated) and Type I (asphalt treated).
- B. Glass fiber fitting tape: Mil. Spec MIL-C-20079, Type II, Class 1.
- C. Tape for Flexible Elastomeric Cellular Insulation: As recommended by the insulation manufacturer.
- D. Hexagonal wire netting: 25 mm (one inch) mesh, 0.85 mm thick (22 gage) galvanized steel.
- E. Corner beads: 50 mm (2 inch) by 50 mm (2 inch), 0.55 mm thick (26 gage) galvanized steel; or, 25 mm (1 inch) by 25 mm (1 inch), 0.47 mm thick (28 gage) aluminum angle adhered to 50 mm (2 inch) by 50 mm (2 inch) Kraft paper.
- F. PVC fitting cover: Fed. Spec L-P-535, Composition A, 11-86 Type II, Grade GU, with Form B Mineral Fiber insert, for media temperature 4 degrees C (40 degrees F) to 121 degrees C (250 degrees F). Below 4 degrees C (40 degrees F) and above 121 degrees C (250 degrees F). Provide double layer insert. Provide color matching vapor barrier pressure sensitive tape.

2.14 FIRESTOPPING MATERIAL

Other than pipe and duct insulation, refer to Section 07 84 00 FIRESTOPPING.

2.15 FLAME AND SMOKE

Unless shown otherwise all assembled systems shall meet flame spread 25 and smoke developed 50 rating as developed under ASTM, NFPA and UL standards and specifications. See paragraph 1.3 "Quality Assurance".

PART 3 - EXECUTION

3.1 GENERAL REQUIREMENTS

- A. Required pressure tests of duct and piping joints and connections shall be completed and the work approved by the Resident Engineer for application of insulation. Surface shall be clean and dry with all foreign materials, such as dirt, oil, loose scale and rust removed.
- B. Except for specific exceptions, insulate entire specified equipment, piping (pipe, fittings, valves, accessories), and duct systems. Insulate each pipe and duct individually. Do not use scrap pieces of insulation where a full length section will fit.
- D. Insulation materials shall be installed in a first class manner with smooth and even surfaces, with jackets and facings drawn tight and smoothly cemented down at all laps. Insulation shall be continuous through all sleeves and openings, except at fire dampers and duct heaters (NFPA 90A). Vapor retarders shall be continuous and uninterrupted throughout systems with operating temperature 16 degrees C (60 degrees F) and below. Lap and seal vapor barrier over ends and exposed edges of insulation. Anchors, supports and other metal projections through insulation on cold surfaces shall be insulated and vapor sealed for a minimum length of 150 mm (6 inches).
- E. Install vapor stops at all insulation terminations on either side of valves, pumps and equipment and particularly in straight lengths of pipe insulation.
- F. Construct insulation on parts of equipment such as chilled water pumps and heads of chillers, convertors and heat exchangers that must be opened periodically for maintenance or repair, so insulation can be removed and replaced without damage. Install insulation with bolted 1 mm thick (20 gage) galvanized steel or aluminum covers as complete units, or in sections, with all necessary supports, and split to coincide with flange/split of the equipment.
- G. Insulation on hot piping and equipment shall be terminated square at items not to be insulated, access openings and nameplates. Cover all exposed raw insulation with white sealer or jacket material.
- H. Protect all insulations outside of buildings with aluminum jacket using lock joint or other approved system for a continuous weather tight system. Access doors and other items requiring maintenance or access shall be removable and sealable.
- I. HVAC work not to be insulated:
 - 1. Internally insulated ductwork and air handling units.
 - 2. Relief air ducts (Economizer cycle exhaust air).
 - 3. Exhaust air ducts and plenums, and ventilation exhaust air shafts.
 - 4. Equipment: Expansion tanks, flash tanks, hot water pumps, steam condensate pumps.

5. In hot piping: Unions, flexible connectors, control valves, PRVs, safety valves and discharge vent piping, vacuum breakers, thermostatic vent valves, steam traps 20 mm (3/4 inch) and smaller, exposed piping through floor for convectors and radiators. Insulate piping to within approximately 75 mm (3 inches) of uninsulated items.

J. Plumbing work not to be insulated:

1. Piping and valves of fire protection system.
2. Chromium plated brass piping.
3. Water piping in contact with earth.
4. Piping in pipe basement serving wall hydrants.
5. Small horizontal cold water branch runs in partitions to individual fixtures may be without insulation for maximum distance of 900 mm (3 feet).
6. Distilled water piping.
3. Equipment:
 - a. Condensate return pumps
 - b. Vacuum return pump units
 - c. Pumps-inlet to outlet
 - d. Flash tanks
 - e. Safety valves
 - f. Water meters
 - g. Oil meters
 - h. Air compressors and tanks
 - i. Refrigerated or desiccant air drier
 - j. Chemical feeders
 - k. Boiler and feedwater sampler
 - l. All nameplates
4. Specialties:
 - a. Pressure reducing valves
 - b. Control valves-water and steam
 - c. Level sensors-piping, valves and blowdown
 - d. Back pressure regulators-oil and steam
 - e. Strainers under 65 mm (2-1/2 inch) pipe size
 - f. Expansion bellows
 - g. Flexible connectors
 - h. Ball joints except piping between joints

- L. Apply insulation materials subject to the manufacturer's recommended temperature limits. Apply adhesives, mastic and coatings at the manufacturer's recommended minimum coverage.
- M. Elbows, flanges and other fittings shall be insulated with the same material as is used on the pipe straights. The elbow/ fitting insulation shall be field-fabricated, mitered or factory prefabricated to the necessary size and shape to fit on the elbow/ fitting. Use of polyurethane spray-foam to fill a PVC elbow jacket is prohibited on cold applications.
- N. Firestop Pipe and Duct insulation:
 - 1. Provide firestopping insulation at fire and smoke barriers through penetrations. Fire stopping insulation shall be UL listed as defines in Section 07 84 00, FIRESTOPPING.
 - 2. Pipe and duct penetrations requiring fire stop insulation including, but not limited to the following:
 - a. Pipe risers through floors
 - b. Pipe or duct chase walls and floors
 - c. Smoke partitions
 - d. Fire partitions
- O. Freeze protection of above grade outdoor piping (over heat tracing tape): 20 mm (0.75) thick insulation, for all pipe sizes 75 mm(3 inches) and smaller and 25 mm(1inch) thick insulation for larger pipes. Provide metal jackets for all pipes. Provide for cold water make-up to cooling towers and condenser water piping and chilled water piping as described in Section 23 21 13, HYDRONIC PIPING (electrical heat tracing systems).
- P. Provide metal jackets over insulation as follows:
 - a. All piping and ducts exposed to outdoor weather.
 - b. Piping exposed in building, within 1800 mm (6 feet) of the floor, that connects to sterilizers, kitchen and laundry equipment. Jackets may be applied with pop rivets. Provide aluminum angle ring escutcheons at wall, ceiling or floor penetrations.
 - c. A 50 mm (2 inch) overlap is required at longitudinal and circumferential joints.

3.2 INSULATION INSTALLATION

- A. Mineral Fiber Board:
 - 1. Faced board: Apply board on pins spaced not more than 300 mm (12 inches) on center each way, and not less than 75 mm (3 inches) from each edge of board. In addition to pins, apply insulation bonding adhesive to entire underside of horizontal metal surfaces. Butt insulation edges tightly and seal all joints with laps and butt strips. After applying speed clips cut pins off flush and apply vapor seal patches over clips.
 - 2. Plain board:

- a. Insulation shall be scored, beveled or mitered to provide tight joints and be secured to equipment with bands spaced 225 mm (9 inches) on center for irregular surfaces or with pins and clips on flat surfaces. Use corner beads to protect edges of insulation.
 - b. For hot equipment: Stretch 25 mm (1 inch) mesh wire, with edges wire laced together, over insulation and finish with insulating and finishing cement applied in one coat, 6 mm (1/4 inch) thick, trowel led to a smooth finish.
 - c. For cold equipment: Apply meshed glass fabric in a tack coat 1.5 to 1.7 square meter per liter (60 to 70 square feet per gallon) of vapor mastic and finish with mastic at 0.3 to 0.4 square meter per liter (12 to 15 square feet per gallon) over the entire fabric surface.
 - d. Chilled water pumps: Insulate with removable and replaceable 1 mm thick (20 gage) aluminum or galvanized steel covers lined with insulation. Seal closure joints/flanges of covers with gasket material. Fill void space in enclosure with flexible mineral fiber insulation.
3. Exposed, unlined ductwork and equipment in unfinished areas, crawlspaces, mechanical and electrical equipment rooms and attics, and duct work exposed to outdoor weather:
 - a. 40 mm (1-1/2 inch) thick insulation faced with ASJ (white all service jacket): Supply air duct and afterfilter housing.
 - b. 25 mm (1 inch) thick insulation faced with ASJ: Return air duct, mixed air plenums and prefilter housing.
 - c. Outside air intake ducts: 50 mm (two inch) thick insulation faced with ASJ.
 5. Cold equipment: 40 mm (1-1/2 inch) thick insulation faced with ASJ.
 - a. Chilled water pumps, water filter, chemical feeder pot or tank.
 - b. Pneumatic, cold storage water and surge tanks.
 6. Hot equipment: 40 mm (1-1/2 inch) thick insulation faced with ASJ.
 - a. Convertors, air separators, steam condensate pump receivers.
 - b. Reheat coil casing and separation chambers on steam humidifiers located above ceilings.
 - c. Domestic water heaters and hot water storage tanks (not factory insulated).
 - d. Booster water heaters for dietetics dish and pot washers and for washdown grease-extracting hoods.

B. Flexible Mineral Fiber Blanket:

1. Adhere insulation to metal with 100 mm (4 inch) wide strips of insulation bonding adhesive at 200 mm (8 inches) on center all around duct. Additionally secure insulation to bottom of ducts exceeding 600 mm (24 inches) in width with pins welded or adhered on 450 mm (18

- inch) centers. Secure washers on pins. Butt insulation edges and seal joints with laps and butt strips. Staples may be used to assist in securing insulation. Seal all vapor retarder penetrations with mastic. Sagging duct insulation will not be acceptable. Install firestop duct insulation where required.
2. Supply air ductwork to be insulated includes main and branch ducts from AHU discharge to room supply outlets, and the bodies of ceiling outlets to prevent condensation. Insulate sound attenuator units, coil casings and damper frames. To prevent condensation insulate trapeze type supports and angle iron hangers for flat oval ducts that are in direct contact with metal duct.
 3. Concealed supply air ductwork.
 - a. Above ceilings at a roof level: 50 mm (2 inch) thick insulation faced with FSK.
 - b. Above ceilings for other than roof level: 40 mm (1 ½ inch) thick insulation faced with FSK.
 4. Concealed return air duct above ceilings at a roof level, unconditioned areas, and in chases with external wall or containing steam piping; 40 mm (1-1/2 inch) thick, insulation faced with FSK. Concealed return air ductwork in other locations need not be insulated.
 5. Return air duct in interstitial spaces: 40 mm (1-1/2 inch thick insulation faced with FSK. //
 6. Concealed outside air duct: 40 mm (1-1/2 inch) thick insulation faced with FSK. //
 7. Exhaust air branch duct from autopsy refrigerator to main duct: 40 mm (1-1/2 inch) thick insulation faced with FSK.
- C. Molded Mineral Fiber Pipe and Tubing Covering:
1. Fit insulation to pipe or duct, aligning longitudinal joints. Seal longitudinal joint laps and circumferential butt strips by rubbing hard with a nylon sealing tool to assure a positive seal. Staples may be used to assist in securing insulation. Seal all vapor retarder penetrations on cold piping with a generous application of vapor barrier mastic. Provide inserts and install with metal insulation shields at outside pipe supports. Install freeze protection insulation over heating cable.
 2. Contractor's options for fitting, flange and valve insulation:
 - a. Insulating and finishing cement for sizes less than 100 mm (4 inches) operating at surface temperature of 16 degrees C (61 degrees F) or more.
 - b. Factory premolded, one piece PVC covers with mineral fiber, (Form B), inserts. Provide two insert layers for pipe temperatures below 4 degrees C (40 degrees F), or above 121 degrees C (250 degrees F). Secure first layer of insulation with twine. Seal seam edges with vapor barrier mastic and secure with fitting tape.

- c. Factory molded, ASTM C547 or field mitered sections, joined with adhesive or wired in place. For hot piping finish with a smoothing coat of finishing cement. For cold fittings, 16 degrees C (60 degrees F) or less, vapor seal with a layer of glass fitting tape imbedded between two 2 mm (1/16 inch) coats of vapor barrier mastic.
 - d. Fitting tape shall extend over the adjacent pipe insulation and overlap on itself at least 50 mm (2 inches).
3. Nominal thickness in millimeters and inches specified in table below, for piping above ground:

Nominal Thickness of Molded Mineral Fiber Insulation				
Nominal Pipe Size, millimeters (inches):	25 (1) & below	32- 75 (1- 1/4- 3)	100-150 (4-6)	200 (8) and above
a. 122-177 degrees C (251-350 F) (MPS,)	50 (2.0)	65 (2.5)	90 (3.5)	90 (3.5)
b. 100-121 degrees C MPR (212-250 degrees F) (Vent piping from PRV safety valves, condensate receivers, and flash tanks)	25 (1.0)	50 (2.0)	50 (2.0)	50 (2.0)
c. 38-99 degrees C (100-211 degrees F) (LPR, PC, HWH, HWHR,)	25 (1.0)	40 (1.5)	50 (2.0)	50 (2.0)
2. Runouts air terminal unit reheat coils	15 (0.5)	-	-	-
d. Domestic hot water supply and return	15 (0.5)	20(0.75)	25 (1.0)	40 (1.5)

D. Rigid Cellular Phenolic Foam:

1. Rigid closed cell phenolic insulation may be provided for piping, ductwork and equipment for temperatures up to 121 degrees C (250 degrees F).
2. Note the NFPA 90A burning characteristics requirements of 25/50 in paragraph 1.3.B
3. Provide secure attachment facilities such as welding pins.
4. Apply insulation with joints tightly drawn together
5. Apply adhesives, coverings, neatly finished at fittings, and valves.

6. Final installation shall be smooth, tight, neatly finished at all edges.
7. Minimum thickness in millimeters (inches) specified in table below, for piping above ground:

Nominal Thickness of Rigid Closed-Cell Phenolic Foam Insulation					
Nominal Pipe Size millimeters (inches):	25 (1) & below	32-75 (1 1/4-3)	100-150 (4-6)	200-300 (8-12)	350 (14) & above
1. 100-121 degrees C (212-250 degrees F), LPS, Vent piping from receivers and flash tanks.	15 (0.5)	25 (1)	25 (1)	--	--
2. 38-99 degrees C (100-211 degrees F), LPR, PC, HWS, HWR, .	15 (0.5)	20 (0.75)	25 (1)	--	--
a. Run outs to reheat coils .	15 (0.5)	--	--	--	--
3. 4-16 degrees C (40-60 degrees F), CHS, CHR.	20 (0.75)	20 (0.75)	25 (1)	40 (1.5)	50 (2.0)
4. 10 degrees C (50 degrees F) and less, RS for DX refrigerants.	15 (0.5)	20 (0.75)	--	--	--
5. Domestic hot water supply and return.	15 (0.5)	15 (0.5)	20 (0.75)	20 (0.75)	--

8. Condensation control insulation: Minimum 20 mm (0.75 inch) thick for all pipe sizes.
 - a. HVAC: Cooling coil condensation piping to waste piping fixture or drain inlet. Omit insulation on plastic piping in mechanical rooms.
 - b. Plumbing piping as follows:
 - 1) Body of roof and overflow drains horizontal runs and offsets (including elbows) of interior downspout piping in all areas above pipe basement.
 - 2) Waste piping from electric water coolers and icemakers to drainage system.
 - 3) Waste piping located above basement floor from ice making and film developing equipment and air handling units, from fixture (including trap) to main vertical waste pipe.
 - 4) MRI quench vent piping.
 - 5) Bedpan sanitizer atmospheric vent
 - 6) Reagent grade water piping.
 - 7) Cold water piping.

E. Cellular Glass Insulation:

1. Pipe and tubing, covering nominal thickness in millimeters and inches as tabulated below for chilled water and refrigerant piping.

Nominal Thickness of Cellular Glass Insulation				
Millimeters (inches)	Thru 38 (1 1/2)	50- 150 (2-6)	200-300 (8-12)	over 350 (14)
1. 4-16 degrees C (40-60 degrees F) (CHS and CHR within chiller room and pipe chase and underground)	50 (2.0)	80 (3.0)	80 (3.0)	100 (4.0)
2. 4-16 degrees C (40-60 degrees F) (CHS and CHR outside chiller room)	40 (1.5)	50 (2.0)	50 (2.0)	65 (2.5)

3. Cold equipment: 50 mm (2 inch) thick insulation faced with ASJ for chilled water pumps, water filters, chemical feeder pots or tanks, expansion tanks, air separators and air purgers.

F. Polyisocyanurate Closed-Cell Rigid Insulation:

1. Polyisocyanurate closed-cell rigid insulation (PIR) may be provided for piping, equipment and ductwork for temperature up to 149 degree C (300 degree F) provided insulation thickness requirement does not exceed 38 mm (1.5 inches).
2. Install insulation, vapor retarder and jacketing per manufacturer's recommendations. Particular attention should be paid to recommendations for joint staggering, adhesive application, external hanger design, expansion/contraction joint design and spacing and vapor retarder integrity.
3. Install insulation with all joints tightly butted (except expansion) joints in hot applications).
4. If insulation thickness exceeds 63 mm (2.5 inches), install as a double layer system with longitudinal (lap) and butt joint staggering as recommended by manufacturer.
5. For cold applications, vapor retarder shall be installed in a continuous manner. No staples, rivets, screws or any other attachment device capable of penetrating the vapor retarder shall be used to attach the vapor retarder or jacketing. No wire ties capable of penetrating the vapor retarder shall be used to hold the insulation in place. Banding shall be used to attach PVC or metal jacketing.
6. Elbows, flanges and other fittings shall be insulated with the same material as is used on the pipe straights. The elbow/ fitting insulation shall be field-fabricated, mitered or factory prefabricated to the necessary size and shape to fit on the elbow/ fitting. Use of polyurethane spray-foam to fill PVC elbow jacket is prohibited on cold applications.

7. For cold applications, the vapor retarder on elbows/fittings shall be either mastic-fabric-mastic or 2 mil thick PVDC vapor retarder adhesive tape.
8. All PVC and metal jacketing shall be installed so as to naturally shed water. Joints shall point down and shall be sealed with either adhesive or caulking (except for periodic slip joints).
10. Note the NFPA 90A burning characteristic requirements of 25/50 in paragraph 1.3B. Refer to paragraph 3.1 for items not to be insulated.
11. Minimum thickness in millimeter (inches) specified in table below, for piping:

Nominal Thickness of Polyisocyanurate Rigid Insulation				
Nominal Pipe Size millimeters(inches):	25(1) & below	32-75 (1 1/4-3)	100-150 (4-6)	200-300 (8-12)
1. 122-149 degree C(251-300 degree F) (MPS)	40 (1.5)	--	--	--
2. 100-121 degrees C (211-250 degrees F), MPR, LPS, Vent piping from receivers and flash tanks	20 (0.75)	40(1.5)	40(1.5)	40(1.50)
3. 38-99 degrees C (100- 211 degrees F), LPR, PC, HWS, HWR, a. Run outs to reheat coils	20 (0.75) 20 (0.75)	25(1.0) --	40(1.5) --	40(1.50) --
4. 4-16 degrees C (40-60 degrees F), CHS, CHR for relative humidity up to 80 percent or underground location	25 (1.00)	25 (1.0)	40 (1.50)	40(1.5)
5. 4-16 degrees C(40-60 degrees F) CHS, CHR, for relative humidity 80 to 90 percent or higher	40 (1.50)	40 (1.5)	40 (1.5)	40 (1.5)
6. 10 degrees C (50 degrees F) and less, RS for DX refrigerants	20 (0.75)	25 (1.0)	--	--
7. Domestic hot water supply and return	15 (0.5)	20 (0.74)	25 (1.0)	25(1.0)

12. Condensation control insulation: Minimum 20 mm (0.75 inch) thick for all pipe sizes.

- a. HVAC: Cooling coil condensation piping to waste piping fixture or drain inlet. Omit insulation on plastic piping in mechanical rooms.
- b. Plumbing piping as follows:
 - 1) Body of roof and overflow drains and horizontal runs and offsets (including elbows) of interior downspout piping in all areas above pipe basement.
 - 2) Waste piping from electric water coolers to drainage system.
 - 3) Waste piping located above basement floor from ice making and film developing equipment and air handling units, from fixture (including trap) to main vertical waste pipe.
 - 7) Cold Water Piping.

G. Flexible Elastomeric Cellular Thermal Insulation:

- 1. Apply insulation and fabricate fittings in accordance with the manufacturer's installation instructions and finish with two coats of weather resistant finish as recommended by the insulation manufacturer.
- 2. Pipe and tubing insulation:
 - a. Use proper size material. Do not stretch or strain insulation.
 - b. To avoid undue compression of insulation, provide cork stoppers or wood inserts at supports as recommended by the insulation manufacturer. Insulation shields are specified under Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION.
 - c. Where possible, slip insulation over the pipe or tubing prior to connection, and seal the butt joints with adhesive. Where the slip-on technique is not possible, slit the insulation and apply it to the pipe sealing the seam and joints with contact adhesive. Optional tape sealing, as recommended by the manufacturer, may be employed. Make changes from mineral fiber insulation in a straight run of pipe, not at a fitting. Seal joint with tape.
- 3. Apply sheet insulation to flat or large curved surfaces with 100 percent adhesive coverage. For fittings and large pipe, apply adhesive to seams only.
- 4. Pipe insulation: nominal thickness in millimeters (inches as specified in table below for piping above ground:

Nominal Thickness of Flexible Elastomeric Cellular Insulation				
Nominal Pipe Size millimeters (inches)	25 (1) & below	32-75 (1 1/4-3)	100-150 (4-6)	200 (8)
1. 38-93 degrees C (100-200 degrees F) (HWS, HWR,)	25 (1.0)	40 (1.5)	-	-
a. Runouts to air terminal unit reheat coils	20 (0.75)	40 (1.5)	-	-
2. 4-16 degrees C (40-60 degrees F) (CHS, CHR,)	25 (1.0)	40 (1.5)	-	-
a. Runouts cooling coil condensate piping	20 (0.75)	40 (1.5)	-	-
b. RS for DX refrigeration	25 (1.0)	40 (1.5)	-	-
3. Domestic hot water supply and return	15 (0.50)	20 (0.75)	25 (1.0)	40 (1.50)

5. Minimum 20 mm (0.75 inch) thick insulation for pneumatic control lines for a minimum distance of 6 m (20 feet) from discharge side of the refrigerated dryer.
6. Use Class S (Sheet), 20 mm (3/4 inch) thick for the following:
 - a. Chilled water pumps
 - b. Bottom and sides of metal basins for winterized cooling towers (where basin water is heated).
 - c. Chillers, insulate any cold chiller surfaces subject to condensation which has not been factory insulated.
 - d. Piping inside refrigerators and freezers: Provide heat tape under insulation.

--- E N D ---

SECTION 23 09 23
DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC

PART 1 - GENERAL

1.1 DESCRIPTION

- A. Provide (a) direct-digital control system(s) as indicated on the project documents, point list, interoperability tables, drawings and as described in these specifications. Include a complete and working direct-digital control system. Include all engineering, programming, controls and installation materials, installation labor, commissioning and start-up, training, final project documentation and warranty.
1. The direct-digital control system(s) shall consist of high-speed, peer-to-peer network of DDC controllers, a control system server, and an Engineering Control Center. Provide a remote user using a standard web browser to access the control system graphics and change adjustable setpoints with the proper password.
 2. The direct-digital control system(s) shall be native BACnet. All new workstations, controllers, devices and components shall be listed by BACnet Testing Laboratories. All new workstations, controller, devices and components shall be accessible using a Web browser interface and shall communicate exclusively using the ASHRAE Standard 135 BACnet communications protocol without the use of gateways, unless otherwise allowed by this Section of the technical specifications, specifically shown on the design drawings and specifically requested otherwise by the VA.
 - a. If used, gateways shall support the ASHRAE Standard 135 BACnet communications protocol.
 - b. If used, gateways shall provide all object properties and read/write services shown on VA-approved interoperability schedules.
 3. The work administered by this Section of the technical specifications shall include all labor, materials, special tools, equipment, enclosures, power supplies, software, software licenses, Project specific software configurations and database entries, interfaces, wiring, tubing, installation, labeling, engineering, calibration, documentation, submittals, testing, verification, training services, permits and licenses, transportation, shipping, handling, administration, supervision, management, insurance, Warranty, specified services and items required for complete and fully functional Controls Systems.
 4. The control systems shall be designed such that each mechanical system shall operate under stand-alone mode. The contractor administered by this Section of the technical specifications

shall provide controllers for each mechanical system. In the event of a network communication failure, or the loss of any other controller, the control system shall continue to operate independently. Failure of the ECC shall have no effect on the field controllers, including those involved with global strategies.

- B. Some products are furnished but not installed by the contractor administered by this Section of the technical specifications. The contractor administered by this Section of the technical specifications shall formally coordinate in writing and receive from other contractors formal acknowledgements in writing prior to submission the installation of the products. These products include the following:
 - 1. Control valves.
 - 2. Flow switches.
 - 3. Flow meters.
 - 4. Sensor wells and sockets in piping.
 - 5. Terminal unit controllers.
- C. Some products are installed but not furnished by the contractor administered by this Section of the technical specifications. The contractor administered by this Section of the technical specifications shall formally coordinate in writing and receive from other contractors formal acknowledgements in writing prior to submission the procurement of the products. These products include the following:
 - 1. Factory-furnished accessory thermostats and sensors furnished with unitary equipment.
- D. Some products are not provided by, but are nevertheless integrated with the work executed by, the contractor administered by this Section of the technical specifications. The contractor administered by this Section of the technical specifications shall formally coordinate in writing and receive from other contractors formal acknowledgements in writing prior to submission the particulars of the products. These products include the following:
 - 1. Fire alarm systems. If zoned fire alarm is required by the project-specific requirements, this interface shall require multiple relays, which are provided and installed by the fire alarm system contractor, to be monitored.
 - 2. Terminal units' velocity sensors
 - 3. Unitary HVAC equipment (split systems) controls. These include:
 - a. Discharge temperature control.
 - b. Setpoint reset.
 - c. Time of day indexing.
 - d. Status alarm.

4. Variable frequency drives. These controls, if not native BACnet, will require a BACnet Gateway.
5. The following systems have limited control (as individually noted below) from the ECC:
 - a. Medical gas systems (if not bottled at point of use): low pressure and status alarms.
 - b. Medical and dental vacuum systems: high pressure and status alarms.
 - c. Medical and dental compressed air systems: low pressure and status alarms.
 - d. Pneumatic tube systems: status alarms.
 - e. Building lighting systems: on/off and scene control.
 - f. Isolation rooms: pressure outside of acceptable limit alarms.

E. Responsibility Table:

Work/Item/System	Furnish	Install	Low Voltage Wiring	Line Power
Control system low voltage and communication wiring	23 09 23	23 09 23	23 09 23	N/A
Terminal units	23	23	N/A	26
Controllers for terminal units	23 09 23	23	23 09 23	26
LAN conduits and raceway	23 09 23	23 09 23	N/A	N/A
Automatic dampers (not furnished with equipment)	23 09 23	23	N/A	N/A
Automatic damper actuators	23 09 23	23 09 23	23 09 23	23 09 23
Manual valves	23	23	N/A	N/A
Automatic valves	23 09 23	23	23 09 23	23 09 23
Pipe insertion devices and taps, flow and pressure stations.	23	23	N/A	N/A
Thermowells	23 09 23	23	N/A	N/A
Current Switches	23 09 23	23 09 23	23 09 23	N/A
Control Relays	23 09 23	23 09 23	23 09 23	N/A
Power distribution system monitoring interfaces	23 09 23	23 09 23	23 09 23	26
All control system nodes, equipment, housings, enclosures and panels.	23 09 23	23 09 23	23 09 23	26
Smoke detectors	28 31 00	28 31 00	28 31 00	28 31 00
Fire/Smoke Dampers	23	23	28 31 00	28 31 00
Smoke Dampers	23	23	28 31 00	28 31 00

Work/Item/System	Furnish	Install	Low Voltage Wiring	Line Power
Fire Dampers	23	23	N/A	N/A
Water treatment system	23	23	23	26
VFDs	26 29 11	26	23 09 23	26
Refrigerant monitors	23	23 09 23	23 09 23	26
Isolation room Controls	23 09 23	23 09 23	23 09 23	26
Medical gas panels	23	23	26	26
Isolation Room Air Valves	23	23	23 09 23	N/A
Computer Room A/C Unit field-mounted controls	23	23	16	26
Control system interface with CRU A/C controls	23 09 23	23 09 23	23 09 23	26
CRU A/C unit controls interface with control system	23	23 09 23	23 09 23	26
Fire Alarm shutdown relay interlock wiring	28	28	28	26
Control system monitoring of fire alarm smoke control relay	28	28	23 09 23	28
Fire-fighter's smoke control station (FSCS)	28	28	28	28
Fan Coil Unit controls (not furnished with equipment)	23 09 23	23 09 23	23 09 23	26
Unit Heater controls (not furnished with equipment)	23 09 23	23 09 23	23 09 23	26
Starters, HOA switches	23	23	N/A	26

- F. This facility's existing direct-digital control system is manufactured by JCI, and its ECC is located at AC room. The contractor administered by this Section of the technical specifications shall observe the capabilities, communication network, services, spare capacity of the existing control system and its ECC prior to beginning work.
- G. This campus has standardized on an existing standard ASHRAE Standard 135, BACnet/IP Control System supported by a preselected controls service company. This entity is referred to as the "Control System Integrator" in this Section of the technical specifications. The Control system integrator is responsible for ECC system graphics and expansion. It also prescribes control system-specific commissioning/ verification procedures to the contractor administered by

this Section of the technical specification. It lastly provides limited assistance to the contractor administered by this Section of the technical specification in its commissioning/verification work.

1. The General Contractor of this project shall directly hire the Control System Integrator in a contract separate from the contract procuring the controls contractor administered by this Section of the technical specifications.
2. The contractor administered by this Section of the technical specifications shall coordinate all work with the Control System Integrator. The contractor administered by this Section of the technical specifications shall integrate the ASHRAE Standard 135, BACnet/IP control network(s) with the Control System Integrator's area control through an Ethernet connection provided by the Control System Integrator.
3. The contractor administered by this Section of the technical specifications shall provide a peer-to-peer networked, stand-alone, distributed control system. This direct digital control (DDC) system shall include one portable operator terminal - laptop, one digital display unit, microprocessor-based controllers, instrumentation, end control devices, wiring, piping, software, and related systems. This contractor is responsible for all device mounting and wiring.

4. Responsibility Table:

Item/Task	Section 23 09 23 contractor	Control system integrator	VA
ECC expansion		X	
ECC programming		X	
Devices, controllers, control panels and equipment	X		
Point addressing: all hardware and software points including setpoint, calculated point, data point(analog/ binary), and reset schedule point	X		
Point mapping		X	
Network Programming	X		
ECC Graphics		X	
Controller programming and sequences	X		
Integrity of LAN communications	X		
Electrical wiring	X		
Operator system training		X	
LAN connections to devices	X		
LAN connections to ECC		X	
IP addresses			X
Overall system verification		X	
Controller and LAN system verification	X		

- H. Unitary standalone systems including Unit Heaters, Cabinet Unit Heaters, Fan Coil Units, Base Board Heaters, thermal comfort ventilation fans, and similar units for control of room

environment conditions may be equipped with integral controls furnished and installed by the equipment manufacturer or field mounted. Refer to equipment specifications and as indicated in project documents. Application of standalone unitary controls is limited to at least those systems wherein remote monitoring, alarm and start-up are not necessary. Examples of such systems include:

1. Light-switch-operated toilet exhaust
2. Vestibule heater
3. Exterior stair heater
4. Attic heating and ventilation
5. Mechanical or electrical room heating and ventilation.

- I The direct-digital control system shall start and stop equipment, move (position) damper actuators and valve actuators, and vary speed of equipment to execute the mission of the control system.

Use electricity as the motive force for all damper and valve actuators.

1.2 RELATED WORK

- A. Section 21 05 11, Common Work Results for Fire Suppression.
- B. Section 22 62 00, Vacuum Systems for Laboratory and Healthcare Facilities.
- C. Section 22 63 00, Gas Systems for Laboratory and Healthcare Facilities.
- D. Section 23 21 13, Hydronic Piping.
- E. Section 23 22 13, Steam and Condensate Heating Piping.
- F. Section 23 31 00, HVAC Ducts and Casings.
- G. Section 23 36 00, Air Terminal Units.
- H. Section 23 73 00, Indoor Central-Station Air-Handling Units.
- I. Section 23 81 00, Decentralized Unitary HVAC Equipment.
- J. Section 26 05 11, Requirements for Electrical Installations.
- K. Section 26 05 21, Low-Voltage Electrical Power Conductors and Cables (600 Volts and Below).
- L. L.Section 26 05 26, Grounding and Bonding for Electrical Systems.
- M. Section 26 05 33, Raceway and Boxes for Electrical Systems.
- N. Section 26 09 23, Lighting Controls.
- O. Section 26 27 26, Wiring Devices.
- P. Section 26 29 11, Motor Starters.
- Q. Section 26 32 13, Engine Generators.
- R. Section 27 15 00, Communications Horizontal Cabling
- S. Section 28 31 00, Fire Detection and Alarm.

1.2 DEFINITION

- A. Algorithm: A logical procedure for solving a recurrent mathematical problem; A prescribed set of well-defined rules or processes for the solution of a problem in a finite number of steps.
- B. ARCNET: ANSI/ATA 878.1 - Attached Resource Computer Network. ARCNET is a deterministic LAN technology; meaning it's possible to determine the maximum delay before a device is able to transmit a message.
- C. Analog: A continuously varying signal value (e.g., temperature, current, velocity etc.
- D. BACnet: A Data Communication Protocol for Building Automation and Control Networks , ANSI/ASHRAE Standard 135. This communications protocol allows diverse building automation devices to communicate data over and services over a network.
- E. BACnet/IP: Annex J of Standard 135. It defines and allows for using a reserved UDP socket to transmit BACnet messages over IP networks. A BACnet/IP network is a collection of one or more IP sub-networks that share the same BACnet network number.
- F. BACnet Internetwork: Two or more BACnet networks connected with routers. The two networks may sue different LAN technologies.
- G. BACnet Network: One or more BACnet segments that have the same network address and are interconnected by bridges at the physical and data link layers.
- H. BACnet Segment: One or more physical segments of BACnet devices on a BACnet network, connected at the physical layer by repeaters.
- I. BACnet Broadcast Management Device (BBMD): A communications device which broadcasts BACnet messages to all BACnet/IP devices and other BBMDs connected to the same BACnet/IP network.
- J. BACnet Interoperability Building Blocks (BIBBs): BACnet Interoperability Building Blocks (BIBBs) are collections of one or more BACnet services. These are prescribed in terms of an "A" and a "B" device. Both of these devices are nodes on a BACnet internetwork.
- K. BACnet Testing Laboratories (BTL). The organization responsible for testing products for compliance with the BACnet standard, operated under the direction of BACnet International.
- L. Baud: It is a signal change in a communication link. One signal change can represent one or more bits of information depending on type of transmission scheme. Simple peripheral communication is normally one bit per Baud. (e.g., Baud rate = 78,000 Baud/sec is 78,000 bits/sec, if one signal change = 1 bit).
- M. Binary: A two-state system where a high signal level represents an "ON" condition and an "OFF" condition is represented by a low signal level.

- N. BMP or bmp: Suffix, computerized image file, used after the period in a DOS-based computer file to show that the file is an image stored as a series of pixels.
- O. Bus Topology: A network topology that physically interconnects workstations and network devices in parallel on a network segment.
- P. Control Unit (CU): Generic term for any controlling unit, stand-alone, microprocessor based, digital controller residing on secondary LAN or Primary LAN, used for local controls or global controls
- Q. Deadband: A temperature range over which no heating or cooling is supplied, i.e., 22-25 degrees C (72-78 degrees F), as opposed to a single point change over or overlap).
- R. Device: a control system component that contains a BACnet Device Object and uses BACnet to communicate with other devices.
- S. Device Object: Every BACnet device requires one Device Object, whose properties represent the network visible properties of that device. Every Device Object requires a unique Object Identifier number on the BACnet internetwork. This number is often referred to as the device instance.
- T. Device Profile: A specific group of services describing BACnet capabilities of a device, as defined in ASHRAE Standard 135-2008, Annex L. Standard device profiles include BACnet Operator Workstations (B-OWS), BACnet Building Controllers (B-BC), BACnet Advanced Application Controllers (B-AAC), BACnet Application Specific Controllers (B-ASC), BACnet Smart Actuator (B-SA), and BACnet Smart Sensor (B-SS). Each device used in new construction is required to have a PICS statement listing which service and BIBBs are supported by the device.
- U. Diagnostic Program: A software test program, which is used to detect and report system or peripheral malfunctions and failures. Generally, this system is performed at the initial startup of the system.
- V. Direct Digital Control (DDC): Microprocessor based control including Analog/Digital conversion and program logic. A control loop or subsystem in which digital and analog information is received and processed by a microprocessor, and digital control signals are generated based on control algorithms and transmitted to field devices in order to achieve a set of predefined conditions.
- W. Distributed Control System: A system in which the processing of system data is decentralized and control decisions can and are made at the subsystem level. System operational programs and information are provided to the remote subsystems and status is reported back to the Engineering Control Center. Upon the loss of communication with the Engineering Control center, the subsystems shall be capable of operating in a stand-alone mode using the last best available data.

- X. Download: The electronic transfer of programs and data files from a central computer or operation workstation with secondary memory devices to remote computers in a network (distributed) system.
- Y. DXF: An AutoCAD 2-D graphics file format. Many CAD systems import and export the DXF format for graphics interchange.
- Z. Electrical Control: A control circuit that operates on line or low voltage and uses a mechanical means, such as a temperature sensitive bimetal or bellows, to perform control functions, such as actuating a switch or positioning a potentiometer.
- AA. Electronic Control: A control circuit that operates on low voltage and uses a solid-state components to amplify input signals and perform control functions, such as operating a relay or providing an output signal to position an actuator.
- BB. Engineering Control Center (ECC): The centralized control point for the intelligent control network. The ECC comprises of personal computer and connected devices to form a single workstation.
- CC. Ethernet: A trademark for a system for exchanging messages between computers on a local area network using coaxial, fiber optic, or twisted-pair cables.
- DD. Firmware: Firmware is software programmed into read only memory (ROM) chips. Software may not be changed without physically altering the chip.
- EE. Gateway: Communication hardware connecting two or more different protocols. It translates one protocol into equivalent concepts for the other protocol. In BACnet applications, a gateway has BACnet on one side and non-BACnet (usually proprietary) protocols on the other side.
- FF. GIF: Abbreviation of Graphic interchange format.
- GG. Graphic Program (GP): Program used to produce images of air handler systems, fans, chillers, pumps, and building spaces. These images can be animated and/or color-coded to indicate operation of the equipment.
- HH. Graphic Sequence of Operation: It is a graphical representation of the sequence of operation, showing all inputs and output logical blocks.
- II. I/O Unit: The section of a digital control system through which information is received and transmitted. I/O refers to analog input (AI), digital input (DI), analog output (AO) and digital output (DO). Analog signals are continuous and represent temperature, pressure, flow rate etc, whereas digital signals convert electronic signals to digital pulses (values), represent motor status, filter status, on-off equipment etc.
- JJ. I/P: a method for conveying and routing packets of information over LAN paths. User Datagram Protocol (UDP) conveys information to “sockets” without confirmation of receipt. Transmission

- Control Protocol (TCP) establishes "sessions", which have end-to-end confirmation and guaranteed sequence of delivery.
- KK. JPEG: A standardized image compression mechanism stands for Joint Photographic Experts Group, the original name of the committee that wrote the standard.
- LL. Local Area Network (LAN): A communication bus that interconnects operator workstation and digital controllers for peer-to-peer communications, sharing resources and exchanging information.
- MM. Network Repeater: A device that receives data packet from one network and rebroadcasts to another network. No routing information is added to the protocol.
- NN. MS/TP: Master-slave/token-passing (ISO/IEC 8802, Part 3). It is not an acceptable LAN option for VA health-care facilities. It uses twisted-pair wiring for relatively low speed and low cost communication.
- OO. Native BACnet Device: A device that uses BACnet as its primary method of communication with other BACnet devices without intermediary gateways. A system that uses native BACnet devices at all levels is a native BACnet system.
- PP. Network Number: A site-specific number assigned to each network segment to identify for routing. This network number must be unique throughout the BACnet internetwork.
- QQ. Object: The concept of organizing BACnet information into standard components with various associated properties. Examples include analog input objects and binary output objects.
- RR. Object Identifier: An object property used to identify the object, including object type and instance. Object Identifiers must be unique within a device.
- SS. Object Properties: Attributes of an object. Examples include present value and high limit properties of an analog input object. Properties are defined in ASHRAE 135; some are optional and some are required. Objects are controlled by reading from and writing to object properties.
- TT. Operating system (OS): Software, which controls the execution of computer application programs.
- UU. PCX: File type for an image file. When photographs are scanned onto a personal computer they can be saved as PCX files and viewed or changed by a special application program as Photo Shop.
- VV. Peripheral: Different components that make the control system function as one unit. Peripherals include monitor, printer, and I/O unit.
- WW. Peer-to-Peer: A networking architecture that treats all network stations as equal partners- any device can initiate and respond to communication with other devices.

XX. PICS: Protocol Implementation Conformance Statement, describing the BACnet capabilities of a device. All BACnet devices have published PICS.

YY. PID: Proportional, integral, and derivative control, used to control modulating equipment to maintain a setpoint.

ZZ. Repeater: A network component that connects two or more physical segments at the physical layer.

AAA.Router: a component that joins together two or more networks using different LAN technologies. Examples include joining a BACnet Ethernet LAN to a BACnet MS/TP LAN.

BBB. Sensors: devices measuring state points or flows, which are then transmitted back to the DDC system.

CCC. Thermostats : devices measuring temperatures, which are used in control of standalone or unitary systems and equipment not attached to the DDC system.

1.4 QUALITY ASSURANCE

A. Criteria:

1. Single Source Responsibility of subcontractor: The Contractor shall obtain hardware and software supplied under this Section and delegate the responsibility to a single source controls installation subcontractor. The controls subcontractor shall be responsible for the complete design, installation, and commissioning of the system. The controls subcontractor shall be in the business of design, installation and service of such building automation control systems similar in size and complexity.
2. Equipment and Materials: Equipment and materials shall be cataloged products of manufacturers regularly engaged in production and installation of HVAC control systems. Products shall be manufacturer's latest standard design and have been tested and proven in actual use.
3. The controls subcontractor shall provide a list of no less than five similar projects which have building control systems as specified in this Section. These projects must be on-line and functional such that the Department of Veterans Affairs (VA) representative would observe the control systems in full operation.
4. The controls subcontractor shall have in-place facility within 50 miles with technical staff, spare parts inventory for the next five (5) years, and necessary test and diagnostic equipment to support the control systems.
5. The controls subcontractor shall have minimum of three years experience in design and installation of building automation systems similar in performance to those specified in this Section. Provide evidence of experience by submitting resumes of the project manager, the

- local branch manager, project engineer, the application engineering staff, and the electronic technicians who would be involved with the supervision, the engineering, and the installation of the control systems. Training and experience of these personnel shall not be less than three years. Failure to disclose this information will be a ground for disqualification of the supplier.
6. Provide a competent and experienced Project Manager employed by the Controls Contractor. The Project Manager shall be supported as necessary by other Contractor employees in order to provide professional engineering, technical and management service for the work. The Project Manager shall attend scheduled Project Meetings as required and shall be empowered to make technical, scheduling and related decisions on behalf of the Controls Contractor.

B. Codes and Standards:

1. All work shall conform to the applicable Codes and Standards.
2. Electronic equipment shall conform to the requirements of FCC Regulation, Part 15, Governing Radio Frequency Electromagnetic Interference, and be so labeled.

1.5 PERFORMANCE

A. The system shall conform to the following:

1. **Graphic Display:** The system shall display up to four (4) graphics on a single screen with a minimum of twenty (20) dynamic points per graphic. All current data shall be displayed within ten (10) seconds of the request.
2. **Graphic Refresh:** The system shall update all dynamic points with current data within eight (8) seconds. Data refresh shall be automatic, without operator intervention.
3. **Object Command:** The maximum time between the command of a binary object by the operator and the reaction by the device shall be two(2) seconds. Analog objects shall start to adjust within two (2) seconds.
4. **Object Scan:** All changes of state and change of analog values shall be transmitted over the high-speed network such that any data used or displayed at a controller or work-station will be current, within the prior six (6) seconds.
5. **Alarm Response Time:** The maximum time from when an object goes into alarm to when it is annunciated at the workstation shall not exceed (10) seconds.
6. **Program Execution Frequency:** Custom and standard applications shall be capable of running as often as once every (5) seconds. The Contractor shall be responsible for selecting execution times consistent with the mechanical process under control.
7. **Multiple Alarm Annunciations:** All workstations on the network shall receive alarms within five (5) seconds of each other.

8. Performance: Programmable Controllers shall be able to execute DDC PID control loops at a selectable frequency from at least once every one (1) second. The controller shall scan and update the process value and output generated by this calculation at this same frequency.
9. Reporting Accuracy: Listed below are minimum acceptable reporting end-to-end accuracies for all values reported by the specified system:

Measured Variable	Reported Accuracy
Space temperature	$\pm 0.5^{\circ}\text{C}$ ($\pm 1^{\circ}\text{F}$)
Ducted air temperature	$\pm 0.5^{\circ}\text{C}$ [$\pm 1^{\circ}\text{F}$]
Outdoor air temperature	$\pm 1.0^{\circ}\text{C}$ [$\pm 2^{\circ}\text{F}$]
Dew Point	$\pm 1.5^{\circ}\text{C}$ [$\pm 3^{\circ}\text{F}$]
Water temperature	$\pm 0.5^{\circ}\text{C}$ [$\pm 1^{\circ}\text{F}$]
Relative humidity	$\pm 2\%$ RH
Water flow	$\pm 1\%$ of reading
Air flow (terminal)	$\pm 10\%$ of reading
Air flow (measuring stations)	$\pm 5\%$ of reading
Carbon Monoxide (CO)	$\pm 5\%$ of reading
Carbon Dioxide (CO ₂)	± 50 ppm
Air pressure (ducts)	± 25 Pa [± 0.1 "w.c.]
Air pressure (space)	± 0.3 Pa [± 0.001 "w.c.]
Water pressure	$\pm 2\%$ of full scale *Note 1
Electrical Power	$\pm 0.5\%$ of reading

Note 1: for both absolute and differential pressure

10. Control stability and accuracy: Control sequences shall maintain measured variable at setpoint within the following tolerances:

Controlled Variable	Control Accuracy	Range of Medium
Air Pressure	± 50 Pa (± 0.2 in. w.g.)	0–1.5 kPa (0–6 in. w.g.)
Air Pressure	± 3 Pa (± 0.01 in. w.g.)	-25 to 25 Pa (-0.1 to 0.1 in. w.g.)
Airflow	$\pm 10\%$ of full scale	
Space Temperature	$\pm 1.0^{\circ}\text{C}$ ($\pm 2.0^{\circ}\text{F}$)	
Duct Temperature	$\pm 1.5^{\circ}\text{C}$ ($\pm 3^{\circ}\text{F}$)	
Humidity	$\pm 5\%$ RH	
Fluid Pressure	± 10 kPa (± 1.5 psi)	0–1 MPa (1–150 psi)
Fluid Pressure	± 250 Pa (± 1.0 in. w.g.)	0–12.5 kPa (0–50 in. w.g.) differential

11. Extent of direct digital control: control design shall allow for at least the points indicated on the points lists on the drawings.

1.6 WARRANTY

- A. Labor and materials for control systems shall be warranted for a period as specified under Warranty in FAR clause 52.246-21.
- B. Control system failures during the warranty period shall be adjusted, repaired, or replaced at no cost or reduction in service to the owner. The system includes all computer equipment, transmission equipment, and all sensors and control devices.
- D. Controls and Instrumentation subcontractor shall be responsible for temporary operations and maintenance of the control systems during the construction period until final commissioning, training of facility operators and acceptance of the project by VA.

1.7 SUBMITTALS

- A. Submit shop drawings in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturer's literature and data for all components including the following:
 - 1. A wiring diagram for each type of input device and output device including DDC controllers, modems, repeaters, etc. Diagram shall show how the device is wired and powered, showing typical connections at the digital controllers and each power supply, as well as the device itself. Show for all field connected devices, including but not limited to, control relays, motor starters, electric or electronic actuators, and temperature pressure, flow and humidity sensors and transmitters.

2. A diagram of each terminal strip, including digital controller terminal strips, terminal strip location, termination numbers and the associated point names.
 3. Control dampers and control valves schedule, including the size and pressure drop.
 4. Control air-supply components, and computations for sizing compressors, receivers and main air-piping, if pneumatic controls are furnished.
 5. Catalog cut sheets of all equipment used. This includes, but is not limited to software (by manufacturer and by third parties), DDC controllers, panels, peripherals, airflow measuring stations and associated components, and auxiliary control devices such as sensors, actuators, and control dampers. When manufacturer's cut sheets apply to a product series rather than a specific product, the data specifically applicable to the project shall be highlighted. Each submitted piece of literature and drawings should clearly reference the specification and/or drawings that it supposed to represent.
 6. Sequence of operations for each HVAC system and the associated control diagrams. Equipment and control labels shall correspond to those shown on the drawings.
 7. Color prints of proposed graphics with a list of points for display.
 8. Furnish a BACnet Protocol Implementation Conformance Statement (PICS) for each BACnet-compliant device.
 9. Schematic wiring diagrams for all control, communication and power wiring. Provide a schematic drawing of the central system installation. Label all cables and ports with computer manufacturers' model numbers and functions. Show all interface wiring to the control system.
 10. An instrumentation list for each controlled system. Each element of the controlled system shall be listed in table format. The table shall show element name, type of device, manufacturer, model number, and product data sheet number.
 11. Riser diagrams of wiring between central control unit and all control panels.
 12. Scaled plan drawings showing routing of LAN and locations of control panels, controllers, routers, gateways, ECC, and larger controlled devices.
 13. Construction details for all installed conduit, cabling, raceway, cabinets, and similar. Construction details of all penetrations and their protection.
 14. Quantities of submitted items may be reviewed but are the responsibility of the contractor administered by this Section of the technical specifications.
- C. Product Certificates: Compliance with Article, QUALITY ASSURANCE.
- D. Licenses: Provide licenses for all software residing on and used by the Controls Systems and transfer these licenses to the Owner prior to completion.

E. As Built Control Drawings:

1. Furnish three (3) copies of as-built drawings for each control system. The documents shall be submitted for approval prior to final completion.
2. Furnish one (1) stick set of applicable control system prints for each mechanical system for wall mounting. The documents shall be submitted for approval prior to final completion.
3. Furnish one (1) CD-ROM in CAD DWG and/or .DXF format for the drawings noted in subparagraphs above.

F. Operation and Maintenance (O/M) Manuals:

1. Submit in accordance with Article, INSTRUCTIONS, in Specification Section 01 00 00, GENERAL REQUIREMENTS.
2. Include the following documentation:
 - a. General description and specifications for all components, including logging on/off, alarm handling, producing trend reports, overriding computer control, and changing set points and other variables.
 - b. Detailed illustrations of all the control systems specified for ease of maintenance and repair/replacement procedures, and complete calibration procedures.
 - c. One copy of the final version of all software provided including operating systems, programming language, operator workstation software, and graphics software.
 - d. Complete troubleshooting procedures and guidelines for all systems.
 - e. Complete operating instructions for all systems.
 - f. Recommended preventive maintenance procedures for all system components including a schedule of tasks for inspection, cleaning and calibration. Provide a list of recommended spare parts needed to minimize downtime.
 - g. Training Manuals: Submit the course outline and training material to the Owner for approval three (3) weeks prior to the training to VA facility personnel. These persons will be responsible for maintaining and the operation of the control systems, including programming. The Owner reserves the right to modify any or all of the course outline and training material.
 - h. Licenses, guaranty, and other pertaining documents for all equipment and systems.

G. Submit Performance Report to Resident Engineer prior to final inspection.

1.8 INSTRUCTIONS

- A. Instructions to VA operations personnel: Perform in accordance with Article, INSTRUCTIONS, in Specification Section 01 00 00, GENERAL REQUIREMENTS, and as noted below.
- Contractor shall also video tape instruction sessions noted below.

1. First Phase: Formal instructions to the VA facilities personnel for a total of 16 hours, given in multiple training sessions (each no longer than four hours in length), conducted sometime between the completed installation and prior to the performance test period of the control system, at a time mutually agreeable to the Contractor and the VA.
2. Second Phase: This phase of training shall comprise of on the job training during start-up, checkout period, and performance test period. VA facilities personnel will work with the Contractor's installation and test personnel on a daily basis during start-up and checkout period. During the performance test period, controls subcontractor will provide 16 hours of instructions, given in multiple training sessions (each no longer than four hours in length), to the VA facilities personnel.
3. The O/M Manuals shall contain approved submittals as outlined in Article 1.7, SUBMITTALS. The Controls subcontractor will review the manual contents with VA facilities personnel during second phase of training.
4. Training shall be given by direct employees of the controls system subcontractor.

1.9 PROJECT CONDITIONS (ENVIRONMENTAL CONDITIONS OF OPERATION)

- A. The ECC and peripheral devices and system support equipment shall be designed to operate in ambient condition of 20 to 35°C (65 to 90°F) at a relative humidity of 20 to 80% non-condensing.
- B. The CUs used outdoors shall be mounted in NEMA 4 waterproof enclosures, and shall be rated for operation at -40 to 65°C (-40 to 150°F).
- C. All electronic equipment shall operate properly with power fluctuations of plus 10 percent to minus 15 percent of nominal supply voltage.
- D. Sensors and controlling devices shall be designed to operate in the environment, which they are sensing or controlling.

1.10 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American Society of Heating, Refrigerating, and Air-Conditioning Engineers (ASHRAE):
Standard 135-08BACNET Building Automation and Control Networks
- C. American Society of Mechanical Engineers (ASME):
B16.18-05Cast Copper Alloy Solder Joint Pressure Fittings.
B16.22-05Wrought Copper and Copper Alloy Solder Joint Pressure Fittings.
- D. American Society of Testing Materials (ASTM):
B32-04Standard Specification for Solder Metal
B88-03Standard Specifications for Seamless Copper Water Tube

- B88M-05Standard Specification for Seamless Copper Water Tube (Metric)
- B280-03Standard Specification for Seamless Copper Tube for Air-Conditioning and Refrigeration Field Service
- D2737-03Standard Specification for Polyethylene (PE) Plastic Tubing
- E. Federal Communication Commission (FCC):
Rules and Regulations Title 47 Chapter 1-2001 Part 15: Radio Frequency Devices.
- F. Institute of Electrical and Electronic Engineers (IEEE):
802.3-05Information Technology-Telecommunications and Information Exchange between Systems-Local and Metropolitan Area Networks- Specific Requirements-Part 3: Carrier Sense Multiple Access with Collision Detection (CSMA/CD) Access method and Physical Layer Specifications
- G. National Fire Protection Association (NFPA):
70-09National Electric Code
90A-09Standard for Installation of Air-Conditioning and Ventilation Systems
- H. Underwriter Laboratories Inc (UL):
94-06Tests for Flammability of Plastic Materials for Parts and Devices and Appliances
294-05Access Control System Units
486A/486B-04-Wire Connectors
555S-06Standard for Smoke Dampers
916-07Energy Management Equipment
1076-05Proprietary Burglar Alarm Units and Systems

PART 2 - PRODUCTS

2.1 MATERIALS

- A. Use new products that the manufacturer is currently manufacturing and that have been installed in a minimum of 25 installations. Spare parts shall be available for at least five years after completion of this contract.

2.2 CONTROLS SYSTEM ARCHITECTURE

- A. General
1. The Controls Systems shall consist of multiple Nodes and associated equipment connected by industry standard digital and communication network arrangements.
 2. The ECC, building controllers and principal communications network equipment shall be standard products of recognized major manufacturers available through normal PC and computer vendor channels – not "Clones" assembled by a third-party subcontractor.
 3. The networks shall, at minimum, comprise, as necessary, the following:

- a. A fixed ECC and a portable operator's terminal.
 - b. Network computer processing, data storage and BACnet-compliant communication equipment including Servers and digital data processors.
 - c. BACnet-compliant routers, bridges, switches, hubs, modems, gateways, interfaces and similar communication equipment.
 - d. Active processing BACnet-compliant building controllers connected to other BACNet-compliant controllers together with their power supplies and associated equipment.
 - e. Addressable elements, sensors, transducers and end devices.
 - f. Third-party equipment interfaces and gateways as described and required by the Contract Documents.
 - g. Other components required for a complete and working Control Systems as specified.
- B. The Specifications for the individual elements and component subsystems shall be minimum requirements and shall be augmented as necessary by the Contractor to achieve both compliance with all applicable codes, standards and to meet all requirements of the Contract Documents.
- C. Network Architecture
- 1. The Controls communication network shall utilize BACnet communications protocol operating over a standard Ethernet LAN and operate at a minimum speed of 100 Mb/sec.
 - 2. The networks shall utilize only copper and optical fiber communication media as appropriate and shall comply with applicable codes, ordinances and regulations. They may also utilize digital wireless technologies as appropriate to the application and if approved by the VA.
 - 3. All necessary telephone lines, ISDN lines and internet Service Provider services and connections will be provided by the VA.
- D. Third Party Interfaces:
- 1. The contractor administered by this Section of the technical specifications shall include necessary hardware, equipment, software and programming to allow data communications between the controls systems and building systems supplied by other trades.
 - 2. Other manufacturers and contractors supplying other associated systems and equipment shall provide their necessary hardware, software and start-up at their cost and shall cooperate fully with the contractor administered by this Section of the technical specifications in a timely manner and at their cost to ensure complete functional integration.
- E. Servers:
- 1. Provide data storage server(s) to archive historical data including trends, alarm and event histories and transaction logs.

2. Equip these server(s) with the same software tool set that is located in the BACnet building controllers for system configuration and custom logic definition and color graphic configuration.
3. Access to all information on the data storage server(s) shall be through the same browser functionality used to access individual nodes. When logged onto a server the operator will be able to also interact with any other controller on the control system as required for the functional operation of the controls systems. The contractor administered by this Section of the technical specifications shall provide all necessary digital processor programmable data storage server(s).
4. These server(s) shall be utilized for controls systems application configuration, for archiving, reporting and trending of data, for operator transaction archiving and reporting, for network information management, for alarm annunciation, for operator interface tasks, for controls application management and similar. These server(s) shall utilize IT industry standard data base platforms such as Microsoft SQL Server and Microsoft Data Engine (MSDE) or approved equal.

2.3 COMMUNICATION

- A. Control products, communication media, connectors, repeaters, hubs, and routers shall comprise a BACnet internetwork. Controller and operator interface communication shall conform to ANSI/ASHRAE Standard 135-2008, BACnet.
 1. The Data link / physical layer protocol (for communication) acceptable to the VA throughout its facilities is Ethernet (ISO 8802-3) and BACnet/IP.
- B. Each controller shall have a communication port for connection to an operator interface.
- D. Internetwork operator interface and value passing shall be transparent to internetwork architecture.
 1. An operator interface connected to a controller shall allow the operator to interface with each internetwork controller as if directly connected. Controller information such as data, status, reports, system software, and custom programs shall be viewable and editable from each internetwork controller.
 2. Inputs, outputs, and control variables used to integrate control strategies across multiple controllers shall be readable by each controller on the internetwork. Program and test all cross-controller links required to execute specified control system operation. An authorized operator shall be able to edit cross-controller links by typing a standard object address.

- E. System shall be expandable to at least twice the required input and output objects with additional controllers, associated devices, and wiring. Expansion shall not require operator interface hardware additions or software revisions.
- F. ECCs and Controllers with real-time clocks shall use the BACnet Time Synchronization service. The system shall automatically synchronize system clocks daily from an operator-designated device via the internetwork. The system shall automatically adjust for daylight savings and standard time as applicable.

2.6 BACNET PROTOCOL ANALYZER

- A. For ease of troubleshooting and maintenance, provide a BACnet protocol analyzer. Provide its associated fittings, cables and appurtenances, for connection to the communications network. The BACnet protocol analyzer shall be able to, at a minimum: capture and store to a file all data traffic on all network levels; measure bandwidth usage; filter out (ignore) selected traffic.

2.7 NETWORK AND DEVICE NAMING CONVENTION

A. Network Numbers

- 1. BACnet network numbers shall be based on a "facility code, network" concept. The "facility code" is the VAMC's or VA campus' assigned numeric value assigned to a specific facility or building. The "network" typically corresponds to a "floor" or other logical configuration within the building. BACnet allows 65535 network numbers per BACnet internet work.
- 2. The network numbers are thus formed as follows: "Net #" = "FFFNN" where:
 - a. FFF = Facility code (see below)
 - b. NN = 00-99 This allows up to 100 networks per facility or building

B. Device Instances

- 1. BACnet allows 4194305 unique devices instances per BACnet internet work. Using Agency's unique device instances are formed as follows: "Dev #" = "FFFNNDD" where
 - a. FFF and N are as above and
 - b. DD = 00-99, this allows up to 100 devices per network.
- 2. Note Special cases, where the network architecture of limiting device numbering to DD causes excessive subnet works. The device number can be expanded to DDD and the network number N can become a single digit. In NO case shall the network number N and the device number D exceed 4 digits.
- 3. Facility code assignments:
- 4. 000-400 Building/facility number

5. Note that some facilities have a facility code with an alphabetic suffix to denote wings, related structures, etc. The suffix will be ignored. Network numbers for facility codes above 400 will be assigned in the range 000-399.

C. Device Names

1. Name the control devices based on facility name, location within a facility, the system or systems that the device monitors and/or controls, or the area served. The intent of the device naming is to be easily recognized. Names can be up to 254 characters in length, without embedded spaces. Provide the shortest descriptive, but unambiguous, name. For example, in building #123 prefix the number with a "B" followed by the building number, if there is only one chilled water pump "CHWP-1", a valid name would be "B123.CHWP. 1.STARTSTOP". If there are two pumps designated "CHWP-1", one in a basement mechanical room (Room 0001) and one in a penthouse mechanical room (Room PH01), the names could be "B123.R0001.CHWP.1. STARTSTOP " or " B123.RPH01.CHWP.1.STARTSTOP". In the case of unitary controllers, for example a VAV box controller, a name might be "B123.R101.VAV". These names should be used for the value of the "Object_Name" property of the BACnet Device objects of the controllers involved so that the BACnet name and the EMCS name are the same.

2.8 BACNET DEVICES

- A. All BACnet Devices – controllers, gateways, routers, actuators and sensors shall conform to BACnet Device Profiles and shall be BACnet Testing Laboratories (BTL) -Listed as conforming to those Device Profiles. Protocol Implementation Conformance Statements (PICSs), describing the BACnet capabilities of the Devices shall be published and available of the Devices through links in the BTL website.
 1. BACnet Building Controllers, historically referred to as NACs, shall conform to the BACnet B-BC Device Profile, and shall be BTL-Listed as conforming to the B-BC Device Profile. The Device's PICS shall be submitted.
 2. BACnet Advanced Application Controllers shall conform to the BACnet B-AAC Device Profile, and shall be BTL-Listed as conforming to the B-AAC Device Profile. The Device's PICS shall be submitted.
 3. BACnet Application Specific Controllers shall conform to the BACnet B-ASC Device Profile, and shall be BTL-Listed as conforming to the B-ASC Device Profile. The Device's PICS shall be submitted.

4. BACnet Smart Actuators shall conform to the BACnet B-SA Device Profile, and shall be BTL-Listed as conforming to the B-SA Device Profile. The Device's PICS shall be submitted.
5. BACnet Smart Sensors shall conform to the BACnet B-SS Device Profile, and shall be BTL-Listed as conforming to the B-SS Device Profile. The Device's PICS shall be submitted.
6. BACnet routers and gateways shall conform to the BACnet B-OTH Device Profile, and shall be BTL-Listed as conforming to the B-OTH Device Profile. The Device's PICS shall be submitted.

2.9 CONTROLLERS

- A. General. Provide an adequate number of BTL-Listed B-BC building controllers and an adequate number of BTL-Listed B-AAC advanced application controllers to achieve the performance specified in the Part 1 Article on "System Performance." Each of these controllers shall meet the following requirements.
 1. The controller shall have sufficient memory to support its operating system, database, and programming requirements.
 2. The building controller shall share data with the ECC and the other networked building controllers. The advanced application controller shall share data with its building controller and the other networked advanced application controllers.
 3. The operating system of the controller shall manage the input and output communication signals to allow distributed controllers to share real and virtual object information and allow for central monitoring and alarms.
 4. Controllers that perform scheduling shall have a real-time clock.
 5. The controller shall continually check the status of its processor and memory circuits. If an abnormal operation is detected, the controller shall:
 - a. assume a predetermined failure mode, and
 - b. generate an alarm notification.
 6. The controller shall communicate with other BACnet devices on the internetwork using the BACnet Read (Execute and Initiate) and Write (Execute and Initiate) Property services.
 7. Communication.
 - a. Each controller shall reside on a BACnet network using the ISO 8802-3 (Ethernet) Data Link/Physical layer protocol for its communications. Each building controller also shall perform BACnet routing if connected to a network of custom application and application specific controllers.

- b. The controller shall provide a service communication port using BACnet Data Link/Physical layer protocol for connection to a portable operator's terminal.
- 8. Keypad. A local keypad and display shall be provided for each controller. The keypad shall be provided for interrogating and editing data. Provide a system security password shall be available to prevent unauthorized use of the keypad and display.
- 9. Serviceability. Provide diagnostic LEDs for power, communication, and processor. All wiring connections shall be made to field-removable, modular terminal strips or to a termination card connected by a ribbon cable.
- 10. Memory. The controller shall maintain all BIOS and programming information in the event of a power loss for at least 72 hours.
- 11. The controller shall be able to operate at 90% to 110% of nominal voltage rating and shall perform an orderly shutdown below 80% nominal voltage. Controller operation shall be protected against electrical noise of 5 to 120 Hz and from keyed radios up to 5 W at 1 m (3 ft).
- B. Provide BTL-Listed B-ASC application specific controllers for each piece of equipment for which they are constructed. Application specific controllers shall communicate with other BACnet devices on the internetwork using the BACnet Read (Execute) Property service.
 - 1. Each B-ASC shall be capable of stand-alone operation and shall continue to provide control functions without being connected to the network.
 - 2. Each B-ASC will contain sufficient I/O capacity to control the target system.
 - 3. Communication.
 - a. Each controller shall reside on a BACnet network using the ISO 8802-3 (Ethernet) Data Link/Physical layer protocol for its communications. Each building controller also shall perform BACnet routing if connected to a network of custom application and application specific controllers.
 - b. Each controller shall have a BACnet Data Link/Physical layer compatible connection for a laptop computer or a portable operator's tool. This connection shall be extended to a space temperature sensor port where shown.
 - 4. Serviceability. Provide diagnostic LEDs for power, communication, and processor. All wiring connections shall be made to field-removable, modular terminal strips or to a termination card connected by a ribbon cable.
 - 5. Memory. The application specific controller shall use nonvolatile memory and maintain all BIOS and programming information in the event of a power loss.

6. Immunity to power and noise. Controllers shall be able to operate at 90% to 110% of nominal voltage rating and shall perform an orderly shutdown below 80%. Operation shall be protected against electrical noise of 5-120 Hz and from keyed radios up to 5 W at 1 m (3 ft).
7. Transformer. Power supply for the ASC must be rated at a minimum of 125% of ASC power consumption and shall be of the fused or current limiting type.

C. Direct Digital Controller Software

1. The software programs specified in this section shall be commercially available, concurrent, multi-tasking operating system and support the use of software application that operates under DOS or Microsoft Windows.
2. All points shall be identified by up to 30-character point name and 16-character point descriptor. The same names shall be used at the ECC.
3. All control functions shall execute within the stand-alone control units via DDC algorithms. The VA shall be able to customize control strategies and sequences of operations defining the appropriate control loop algorithms and choosing the optimum loop parameters.
4. All controllers shall be capable of being programmed to utilize stored default values for assured fail-safe operation of critical processes. Default values shall be invoked upon sensor failure or, if the primary value is normally provided by the central or another CU, or by loss of bus communication. Individual application software packages shall be structured to assume a fail-safe condition upon loss of input sensors. Loss of an input sensor shall result in output of a sensor-failed message at the ECC. Each ACU and RCU shall have capability for local readouts of all functions. The UCUs shall be read remotely.
5. All DDC control loops shall be able to utilize any of the following control modes:
 - a. Two position (on-off, slow-fast) control.
 - b. Proportional control.
 - c. Proportional plus integral (PI) control.
 - d. Proportional plus integral plus derivative (PID) control. All PID programs shall automatically invoke integral wind up prevention routines whenever the controlled unit is off, under manual control of an automation system or time initiated program.
 - e. Automatic tuning of control loops.
6. System Security: Operator access shall be secured using individual password and operator's name. Passwords shall restrict the operator to the level of object, applications, and system functions assigned to him. A minimum of six (6) levels of security for operator access shall be provided.

7. Application Software: The controllers shall provide the following programs as a minimum for the purpose of optimizing energy consumption while maintaining comfortable environment for occupants. All application software shall reside and run in the system digital controllers. Editing of the application shall occur at the ECC or via a portable operator's terminal, when it is necessary, to access directly the programmable unit.
 - a. Economizer: An economizer program shall be provided for VAV systems. This program shall control the position of air handler relief, return, and outdoors dampers. If the outdoor air dry bulb temperature falls below changeover set point the energy control center will modulate the dampers to provide 100 percent outdoor air. The operator shall be able to override the economizer cycle and return to minimum outdoor air operation at any time.
 - b. Night Setback/Morning Warm up Control: The system shall provide the ability to automatically adjust set points for this mode of operation.
 - c. Optimum Start/Stop (OSS): Optimum start/stop program shall automatically be coordinated with event scheduling. The OSS program shall start HVAC equipment at the latest possible time that will allow the equipment to achieve the desired zone condition by the time of occupancy, and it shall also shut down HVAC equipment at the earliest possible time before the end of the occupancy period and still maintain desired comfort conditions. The OSS program shall consider both outside weather conditions and inside zone conditions. The program shall automatically assign longer lead times for weekend and holiday shutdowns. The program shall poll all zones served by the associated AHU and shall select the warmest and coolest zones. These shall be used in the start time calculation. It shall be possible to assign occupancy start times on a per air handler unit basis. The program shall meet the local code requirements for minimum outdoor air while the building is occupied. Modification of assigned occupancy start/stop times shall be possible via the ECC.
 - d. Event Scheduling: Provide a comprehensive menu driven program to automatically start and stop designated points or a group of points according to a stored time. This program shall provide the capability to individually command a point or group of points. When points are assigned to one common load group it shall be possible to assign variable time advances/delays between each successive start or stop within that group. Scheduling shall be calendar based and advance schedules may be defined up to one year in advance. Advance schedule shall override the day-to-day schedule. The operator shall be able to define the following information:

- 1) Time, day.
 - 2) Commands such as on, off, auto.
 - 3) Time delays between successive commands.
 - 4) Manual overriding of each schedule.
 - 5) Allow operator intervention.
- f. Alarm Reporting: The operator shall be able to determine the action to be taken in the event of an alarm. Alarms shall be routed to the ECC based on time and events. An alarm shall be able to start programs, login the event, print and display the messages. The system shall allow the operator to prioritize the alarms to minimize nuisance reporting and to speed operator's response to critical alarms. A minimum of six (6) priority levels of alarms shall be provided for each point.
 - g. Remote Communications: The system shall have the ability to dial out in the event of an alarm to the ECC and alpha-numeric pagers. The alarm message shall include the name of the calling location, the device that generated the alarm, and the alarm message itself. The operator shall be able to remotely access and operate the system using dial up communications. Remote access shall allow the operator to function the same as local access.
 - h. Maintenance Management (PM): The program shall monitor equipment status and generate maintenance messages based upon the operators defined equipment run time, starts, and/or calendar date limits. A preventative maintenance alarm shall be printed indicating maintenance requirements based on pre-defined run time. Each preventive message shall include point description, limit criteria and preventative maintenance instruction assigned to that limit. A minimum of 480-character PM shall be provided for each component of units such as air handling units.

2.10 SPECIAL CONTROLLERS

- A. Isolation rooms shall be controlled to allow for a variable flow of conditioned air into the room and general exhaust from the room while maintaining proper space pressurization.
- B. Isolation Room Pressure Controller: the differential pressure in isolation rooms shall be maintained by controlling the quantity of air exhausted from and supplied to the room. A sensor-controller shall measure and control the velocity of air flowing out of the room through a sampling tube installed in the wall separating the room from the adjacent space, and display the value on its monitor. The sensor-controller shall meet the following as a minimum:
 1. Operating range: -0.25 to +0.25 inches of water column
 2. Resolution: 5 percent of reading

3. Accuracy: +/- 10 percent of reading +/- 0.005 inches of water column
 4. Analog output: 0-10 VDC or 4-20 ma
 5. Operating temperature range: 32°F-120°F
- C. Controller shall be equal to TSI 8631-HC, allowing BACnet communication with the building automation system. VA staff shall be able to set non-isolation mode at the display unit. Decon anteroom/shower shall have remote sensor tied into controller.

2.11 SENSORS (AIR, WATER AND STEAM)

- A. Sensors' measurements shall be read back to the DDC system, and shall be visible by the ECC.
- B. Temperature and Humidity Sensors shall be electronic, vibration and corrosion resistant for wall, immersion, and/or duct mounting. Provide all remote sensors as required for the systems.
 1. Temperature Sensors: thermistor type for terminal units and Resistance Temperature Device (RTD) with an integral transmitter type for all other sensors.
 - a. Duct sensors shall be rigid or averaging type as shown on drawings. Averaging sensor shall be a minimum of 1 linear ft of sensing element for each sq ft of cooling coil face area.
 - b. Immersion sensors shall be provided with a separable well made of stainless steel, bronze or monel material. Pressure rating of well is to be consistent with the system pressure in which it is to be installed.
 - c. Space sensors shall be equipped with in-space User set-point adjustment, override switch, numerical temperature display on sensor cover, and communication port. Match room thermostats. Provide a tooled-access cover.
 - 1) Public space sensor: setpoint adjustment shall be only through the ECC or through the DDC system's diagnostic device/laptop. Do not provide in-space User set-point adjustment. Provide an opaque keyed-entry cover if needed to restrict in-space User set-point adjustment.
 - 2) Psychiatric patient room sensor: sensor shall be flush with wall, shall not include an override switch, numerical temperature display on sensor cover, shall not include a communication port and shall not allow in-space User set-point adjustment. Setpoint adjustment shall be only through the ECC or through the DDC system's diagnostic device/laptop. Provide a stainless steel coverplate with an insulated back and security screws.
 - d. Outdoor air temperature sensors shall have watertight inlet fittings and be shielded from direct sunlight.

- e. Room security sensors shall have stainless steel cover plate with insulated back and security screws.
 - f. Wire: Twisted, shielded-pair cable.
 - g. Output Signal: 4-20 ma.
- 2. Humidity Sensors: Bulk polymer sensing element type.
 - a. Duct and room sensors shall have a sensing range of 20 to 80 percent with accuracy of ± 2 to ± 5 percent RH, including hysteresis, linearity, and repeatability.
 - b. Outdoor humidity sensors shall be furnished with element guard and mounting plate and have a sensing range of 0 to 100 percent RH.
 - c. 4-20 ma continuous output signal.
- C. Static Pressure Sensors: Non-directional, temperature compensated.
 - 1. 4-20 ma output signal.
 - 2. 0 to 5 inches wg for duct static pressure range.
 - 3. 0 to 0.25 inch wg for Building static pressure range.
- G. Flow switches:
 - 1. Shall be either paddle or differential pressure type.
 - a. Paddle-type switches (liquid service only) shall be UL Listed, SPDT snap-acting, adjustable sensitivity with NEMA 4 enclosure.
 - b. Differential pressure type switches (air or water service) shall be UL listed, SPDT snap acting, NEMA 4 enclosure, with scale range and differential suitable for specified application.
- H. Current Switches: Current operated switches shall be self powered, solid state with adjustable trip current as well as status, power, and relay command status LED indication. The switches shall be selected to match the current of the application and output requirements of the DDC systems.

2.12 CONTROL CABLES

- A. General:
 - 1. Ground cable shields, drain conductors, and equipment to eliminate shock hazard and to minimize ground loops, common-mode returns, noise pickup, cross talk, and other impairments. Comply with Sections 27 05 26 and 26 05 26.
 - 2. Cable conductors to provide protection against induction in circuits. Crosstalk attenuation within the System shall be in excess of -80 dB throughout the frequency ranges specified.
 - 3. Minimize the radiation of RF noise generated by the System equipment so as not to interfere with any audio, video, data, computer main distribution frame (MDF), telephone customer

- service unit (CSU), and electronic private branch exchange (EPBX) equipment the System may service.
4. The as-installed drawings shall identify each cable as labeled, used cable, and bad cable pairs.
 5. Label system's cables on each end. Test and certify cables in writing to the VA before conducting proof-of-performance testing. Minimum cable test requirements are for impedance compliance, inductance, capacitance, signal level compliance, opens, shorts, cross talk, noise, and distortion, and split pairs on all cables in the frequency ranges used. Make available all cable installation and test records at demonstration to the VA. All changes (used pair, failed pair, etc.) shall be posted in these records as the change occurs.
 6. Power wiring shall not be run in conduit with communications trunk wiring or signal or control wiring operating at 100 volts or less.
- B. Analogue control cabling shall be not less than No. 18 AWG solid, with thermoplastic insulated conductors as specified in Section 26 05 21.
- C. Copper digital communication cable between the ECC and the B-BC and B-AAC controllers shall be 100BASE-TX Ethernet, Category 5e or 6, not less than minimum 24 American Wire Gauge (AWG) solid, Shielded Twisted Pair (STP) or Unshielded Twisted Pair (UTP), with thermoplastic insulated conductors, enclosed in a thermoplastic outer jacket, as specified in Section 27 15 00.
1. Other types of media commonly used within IEEE Std 802.3 LANs (e.g., 10Base-T and 10Base-2) shall be used only in cases to interconnect with existing media.
- D. Optical digital communication fiber, if used, shall be Multimode or Singlemode fiber, 62.5/125 micron for multimode or 10/125 micron for singlemode micron with SC or ST connectors as specified in TIA-568-C.1. Terminations, patch panels, and other hardware shall be compatible with the specified fiber and shall be as specified in Section 27 15 00. Fiber-optic cable shall be suitable for use with the 100Base-FX or the 100Base-SX standard (as applicable) as defined in IEEE Std 802.3.

2.13 THERMOSTATS AND HUMIDISTATS

- A. Room thermostats controlling unitary standalone heating and cooling devices not connected to the DDC system shall have three modes of operation (heating - null or dead band - cooling). Thermostats for patient bedrooms shall have capability of being adjusted to eliminate null or dead band. Wall mounted thermostats shall have polished or brushed aluminum or satin chrome finish, setpoint range and temperature display and external adjustment:
1. Electronic Thermostats: Solid-state, microprocessor based, programmable to daily, weekend, and holiday schedules.

- a. Public Space Thermostat: Public space thermostat shall have a thermistor sensor and shall not have a visible means of set point adjustment. Adjustment shall be via the digital controller to which it is connected.
 - b. Patient Room Thermostats: thermistor with in-space User set point adjustment and an on-casing room temperature numerical temperature display.
 - c. Psychiatric Patient Room Sensors: Electronic duct sensor as noted under Article 2.4.
 - d. Battery replacement without program loss.
- B. Strap-on thermostats shall be enclosed in a dirt-and-moisture proof housing with fixed temperature switching point and single pole, double throw switch.
- C. Freezestats shall have a minimum of 300 mm (one linear foot) of sensing element for each 0.093 square meter (one square foot) of coil area. A freezing condition at any increment of 300 mm (one foot) anywhere along the sensing element shall be sufficient to operate the thermostatic element. Freezestats shall be manually-reset.
- D. Room Humidistats: Provide fully proportioning humidistat with adjustable throttling range for accuracy of settings and conservation. The humidistat shall have set point scales shown in percent of relative humidity located on the instrument. Systems showing moist/dry or high/low are not acceptable.

2.14 FINAL CONTROL ELEMENTS AND OPERATORS

- A. Fail Safe Operation: Control valves and dampers shall provide "fail safe" operation in either the normally open or normally closed position as required for freeze, moisture, and smoke or fire protection.
- B. Spring Ranges: Range as required for system sequencing and to provide tight shut-off.
- C. Power Operated Control Dampers (other than VAV Boxes): Factory fabricated, balanced type dampers. All modulating dampers shall be opposed blade type and gasketed. Blades for two-position, duct-mounted dampers shall be parallel, airfoil (streamlined) type for minimum noise generation and pressure drop.
 - 1. Leakage: maximum leakage in closed position shall not exceed 7 L/S (15 CFMs) differential pressure for outside air and exhaust dampers and 200 L/S/ square meter (40 CFM/sq. ft.) at 50 mm (2 inches) differential pressure for other dampers.
 - 2. Frame shall be galvanized steel channel with seals as required to meet leakage criteria.
 - 3. Blades shall be galvanized steel or aluminum, 200 mm (8 inch) maximum width, with edges sealed as required.
 - 4. Bearing shall be nylon, bronze sleeve or ball type.

5. Hardware shall be zinc-plated steel. Connected rods and linkage shall be non-slip. Working parts of joints shall be brass, bronze, nylon or stainless steel.
6. Maximum air velocity and pressure drop through free area the dampers:
 - a. Smoke damper in air handling unit: 305 meter per minute (1000 fpm).
 - b. Duct mounted damper: 600 meter per minute (2000 fpm).
 - c. Maximum static pressure loss: 50 Pascal (0.20 inches water gage).
- D. Smoke Dampers and Combination Fire/Smoke Dampers: Dampers and operators are specified in Section 23 31 00, HVAC DUCTS AND CASINGS. Control of these dampers is specified under this Section.
- E. Control Valves:
 1. Valves shall be rated for a minimum of 150 percent of system operating pressure at the valve location but not less than 900 kPa (125 psig).
 2. Valves 50 mm (2 inches) and smaller shall be bronze body with threaded or flare connections.
 3. Valves 60 mm (2 1/2 inches) and larger shall be bronze or iron body with flanged connections.
 4. Brass or bronze seats except for valves controlling media above 100 degrees C (210 degrees F), which shall have stainless steel seats.
 5. Flow characteristics:
 - a. Three way modulating valves shall be globe pattern. Position versus flow relation shall be linear relation for steam or equal percentage for water flow control.
 - b. Two-way modulating valves shall be globe pattern. Position versus flow relation shall be linear for steam and equal percentage for water flow control.
 - c. Two-way 2-position valves shall be ball, gate or butterfly type.
 6. Maximum pressure drop:
 - a. Two position steam control: 20 percent of inlet gauge pressure.
 - b. Modulating Steam Control: 80 percent of inlet gauge pressure (acoustic velocity limitation).
 - c. Modulating water flow control, greater of 3 meters (10 feet) of water or the pressure drop through the apparatus.
 7. Two position water valves shall be line size.
- F. Damper and Valve Operators and Relays:
 1. Electric operator shall provide full modulating control of dampers and valves. A linkage and pushrod shall be furnished for mounting the actuator on the damper frame internally in the

- duct or externally in the duct or externally on the duct wall, or shall be furnished with a direct-coupled design. Metal parts shall be aluminum, mill finish galvanized steel, or zinc plated steel or stainless steel. Provide actuator heads which allow for electrical conduit attachment. The motors shall have sufficient closure torque to allow for complete closure of valve or damper under pressure. Provide multiple motors as required to achieve sufficient closeoff torque.
- a. Minimum valve closeoff pressure shall be equal to the system pump's dead-head pressure, minimum 50 psig for valves smaller than 4 inches.
3. Electronic damper operators: Metal parts shall be aluminum, mill finish galvanized steel, or zinc plated steel or stainless steel. Provide actuator heads which allow for electrical conduit attachment. The motors shall have sufficient closure torque to allow for complete closure of valve or damper under pressure. Provide multiple motors as required to achieve sufficient closeoff torque.
 - a. VAV Box actuator shall be mounted on the damper axle or shall be of the air valve design, and shall provide complete modulating control of the damper. The motor shall have a closure torque of 35-inch pounds minimum with full torque applied at close off to attain minimum leakage.
 4. See drawings for required control operation.
- F. Isolation Room Damper and Operator:
1. Electric operator shall provide full modulating control of damper. . Operator shall be 0-10V input 24V powered capable of operating damper at differential pressure required by exhaust system. See 23 36 00 for control element.

2.15 AIR FLOW CONTROL

- A. Airflow and static pressure shall be controlled via digital controllers with inputs from airflow control measuring stations and static pressure inputs as specified. Controller outputs shall be analog or pulse width modulating output signals. The controllers shall include the capability to control via simple proportional (P) control, proportional plus integral (PI), proportional plus integral plus derivative (PID), and on-off. The airflow control programs shall be factory-tested programs that are documented in the literature of the control manufacturer.
- B. Air Flow Measuring Station -- Pneumatic Type:
 1. Airflow measuring stations shall measure airflow by the pitot tube traverse method. Each unit shall consist of a network of static and total pressure sensors, factory positioned and connected in parallel, to produce an equalized velocity pressure. The measured velocity

- pressure converted to airflow (cfm) shall have accuracy within 2 percent of the full scale throughout the velocity range from 200 to 1,200 meter per minute (700 to 4,000 fpm).
2. Airflow measuring stations shall consist of 16-gauge sheet metal casing, an aluminum air velocity treatment and air straightening section with an open face area not less than 97 percent and a total and static pressure sensing manifold made of copper. Each station shall contain noncombustible sensors which shall be incapable of producing toxic gases or fumes in the event of elevated duct temperatures. All interconnecting tubing shall be internal to the unit with the exception of one total pressure and one static pressure meter connection.
 3. Each air flow measuring station shall be installed to meet at least the manufacturer's minimum installation conditions and shall not amplify the sound level within the duct. The maximum resistance to airflow shall not exceed 0.3 times the velocity head for the duct stations and 0.6 times the velocity head for the fan stations. The unit shall be suitable for continuous operation up to a temperature of 120°C (250°F).
 4. Differential pressure transducers shall measure and transmit pressure signals to the direct digital controller.
- D. Static Pressure Measuring Station: shall consist of one or more static pressure sensors and transmitters along with relays or auxiliary devices as required for a complete functional system. The span of the transmitter shall not exceed two times the design static pressure at the point of measurement. The output of the transmitter shall be true representation of the input pressure with plus or minus 25 Pascal (0.1 inch) W.G. of the true input pressure:
1. Static pressure sensors shall have the same requirements as Airflow Measuring Devices except that total pressure sensors are optional, and only multiple static pressure sensors positioned on an equal area basis connected to a network of headers are required.
 2. For systems with multiple major trunk supply ducts, furnish a static pressure transmitter for each trunk duct. The transmitter signal representing the lowest static pressure shall be selected and this shall be the input signal to the controller.
 3. The controller shall receive the static pressure transmitter signal and CU shall provide a control output signal to the supply fan capacity control device. The control mode shall be proportional plus integral (PI) (automatic reset) and where required shall also include derivative mode.
 4. In systems with multiple static pressure transmitters, provide a switch located near the fan discharge to prevent excessive pressure during abnormal operating conditions. High-limit switches shall be manually-reset.

- E. Constant Volume Control Systems shall consist of an air flow measuring station along with such relays and auxiliary devices as required to produce a complete functional system. The transmitter shall receive its air flow signal and static pressure signal from the flow measuring station and shall have a span not exceeding three times the design flow rate. The CU shall receive the transmitter signal and shall provide an output to the fan volume control device to maintain a constant flow rate. The CU shall provide proportional plus integral (PI) (automatic reset) control mode and where required also inverse derivative mode. Overall system accuracy shall be plus or minus the equivalent of 2 Pascal (0.008 inch) velocity pressure as measured by the flow station.
- F. Airflow Synchronization:
 - 1. Systems shall consist of an air flow measuring station for each supply and return duct, the CU and such relays, as required to provide a complete functional system that will maintain a constant flow rate difference between supply and return air to an accuracy of $\pm 10\%$. In systems where there is no suitable location for a flow measuring station that will sense total supply or return flow, provide multiple flow stations with a differential pressure transmitter for each station. Signals from the multiple transmitters shall be added through the CU such that the resultant signal is a true representation of total flow.
 - 2. The total flow signals from supply and return air shall be the input signals to the CU. This CU shall track the return air fan capacity in proportion to the supply air flow under all conditions.

2.16 NITROGEN DIOXIDE (NO₂) AND CARBON MONOXIDE (CO) TOXIC GAS SENSORS

- A. CSA certified wall mounted electrochemical sensor with alarm relay output to BMS.
- B. LED display of concentration reading and audible alarm.
- C. Mount sampling tube inlet at height in accordance with user manual.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. General:
 - 1. Examine project plans for control devices and equipment locations; and report any discrepancies, conflicts, or omissions to Resident Engineer for resolution before proceeding for installation.
 - 2. Work Coordination: GENERAL CONDITIONS.
 - 3. Install equipment, piping, wiring /conduit parallel to or at right angles to building lines.
 - 4. Install all equipment and piping in readily accessible locations. Do not run tubing and conduit concealed under insulation or inside ducts.
 - 5. Mount control devices, tubing and conduit located on ducts and apparatus with external insulation on standoff support to avoid interference with insulation.

6. Provide sufficient slack and flexible connections to allow for vibration of piping and equipment.
7. Run tubing and wire connecting devices on or in control cabinets parallel with the sides of the cabinet neatly racked to permit tracing.
8. Install equipment level and plum.

A. Electrical Wiring Installation:

1. All wiring cabling shall be installed in conduits. Install conduits and wiring in accordance with Specification Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS. Conduits carrying control wiring and cabling shall be dedicated to the control wiring and cabling; these conduits shall not carry power wiring. Provide plastic end sleeves at all conduit terminations to protect wiring from burrs.
2. Install analog signal and communication cables in conduit and in accordance with Specification Section 26 05 21. Install digital communication cables in conduit and in accordance with Specification Section 27 15 00, Communications Horizontal Cabling.
3. Install conduit and wiring between operator workstation(s), digital controllers, electrical panels, indicating devices, instrumentation, miscellaneous alarm points, thermostats, and relays as shown on the drawings or as required under this section.
1. Install all electrical work required for a fully functional system and not shown on electrical plans or required by electrical specifications. Where low voltage (less than 50 volt) power is required, provide suitable Class B transformers.
5. Install all system components in accordance with local Building Code and National Electric Code.
 - a. Splices: Splices in shielded and coaxial cables shall consist of terminations and the use of shielded cable couplers. Terminations shall be in accessible locations. Cables shall be harnessed with cable ties.
 - b. Equipment: Fit all equipment contained in cabinets or panels with service loops, each loop being at least 300 mm (12 inches) long. Equipment for fiber optics system shall be rack mounted, as applicable, in ventilated, self-supporting, code gauge steel enclosure. Cables shall be supported for minimum sag.
 - c. Cable Runs: Keep cable runs as short as possible. Allow extra length for connecting to the terminal board. Do not bend flexible coaxial cables in a radius less than ten times the cable outside diameter.
 - d. Use vinyl tape, sleeves, or grommets to protect cables from vibration at points where they pass around sharp corners, through walls, panel cabinets, etc.

6. Conceal cables, except in mechanical rooms and areas where other conduits and piping are exposed.
7. Permanently label or code each point of all field terminal strips to show the instrument or item served. Color-coded cable with cable diagrams may be used to accomplish cable identification.
8. Grounding: ground electrical systems per manufacturer's written requirements for proper and safe operation.

C. Install Sensors and Controls:

1. Temperature Sensors:

- a. Install all sensors and instrumentation according to manufacturer's written instructions. Temperature sensor locations shall be readily accessible, permitting quick replacement and servicing of them without special skills and tools.
- b. Calibrate sensors to accuracy specified, if not factory calibrated.
- c. Use of sensors shall be limited to its duty, e.g., duct sensor shall not be used in lieu of room sensor.
- d. Install room sensors permanently supported on wall frame. They shall be mounted at 1.5 meter (5.0 feet) above the finished floor.
- e. Mount sensors rigidly and adequately for the environment within which the sensor operates. Separate extended-bulb sensors from contact with metal casings and coils using insulated standoffs.
- f. Sensors used in mixing plenum, and hot and cold decks shall be of the averaging of type. Averaging sensors shall be installed in a serpentine manner horizontally across duct. Each bend shall be supported with a capillary clip.
- g. All pipe mounted temperature sensors shall be installed in wells.
- h. All wires attached to sensors shall be air sealed in their conduits or in the wall to stop air transmitted from other areas affecting sensor reading.
- i. Permanently mark terminal blocks for identification. Protect all circuits to avoid interruption of service due to short-circuiting or other conditions. Line-protect all wiring that comes from external sources to the site from lightning and static electricity.

2. Pressure Sensors:

- a. Install duct static pressure sensor tips facing directly downstream of airflow.
- b. Install high-pressure side of the differential switch between the pump discharge and the check valve.
- c. Install snubbers and isolation valves on steam pressure sensing devices.

3. Actuators:
 - a. Mount and link damper and valve actuators according to manufacturer's written instructions.
 - b. Check operation of damper/actuator combination to confirm that actuator modulates damper smoothly throughout stroke to both open and closed position.
 - c. Check operation of valve/actuator combination to confirm that actuator modulates valve smoothly in both open and closed position.
 4. Flow Switches:
 - a. Install flow switch according to manufacturer's written instructions.
 - b. Mount flow switch a minimum of 5 pipe diameters up stream and 5 pipe diameters downstream or 600 mm (2 feet) whichever is greater, from fittings and other obstructions.
 - c. Assure correct flow direction and alignment.
 - d. Mount in horizontal piping-flow switch on top of the pipe.
- D. Installation of network:
1. Ethernet:
 - a. The network shall employ Ethernet LAN architecture, as defined by IEEE 802.3. The Network Interface shall be fully Internet Protocol (IP) compliant allowing connection to currently installed IEEE 802.3, Compliant Ethernet Networks.
 - b. The network shall directly support connectivity to a variety of cabling types. As a minimum provide the following connectivity: 100 Base TX (Category 5e cabling) for the communications between the ECC and the B-BC and the B-AAC controllers.
 2. Third party interfaces: Contractor shall integrate real-time data from building systems by other trades and databases originating from other manufacturers as specified and required to make the system work as one system.
- E. Installation of digital controllers and programming:
1. Provide a separate digital control panel for each major piece of equipment, such as air handling unit, chiller, pumping unit etc. Points used for control loop reset such as outdoor air, outdoor humidity, or space temperature could be located on any of the remote control units.
 2. Provide sufficient internal memory for the specified control sequences and trend logging. There shall be a minimum of 25 percent of available memory free for future use.
 3. System point names shall be modular in design, permitting easy operator interface without the use of a written point index.
 4. Provide software programming for the applications intended for the systems specified, and adhere to the strategy algorithms provided.

5. Provide graphics for each piece of equipment and floor plan in the building. This includes each chiller, cooling tower, air handling unit, fan, terminal unit, boiler, pumping unit etc. These graphics shall show all points dynamically as specified in the point list.

3.2 SYSTEM VALIDATION AND DEMONSTRATION

- A. As part of final system acceptance, a system demonstration is required (see below). Prior to start of this demonstration, the contractor is to perform a complete validation of all aspects of the controls and instrumentation system.
- B. Validation
 1. Prepare and submit for approval a validation test plan including test procedures for the performance verification tests. Test Plan shall address all specified functions of the ECC and all specified sequences of operation. Explain in detail actions and expected results used to demonstrate compliance with the requirements of this specification. Explain the method for simulating the necessary conditions of operation used to demonstrate performance of the system. Test plan shall include a test check list to be used by the Installer's agent to check and initial that each test has been successfully completed. Deliver test plan documentation for the performance verification tests to the owner's representative 30 days prior to start of performance verification tests. Provide draft copy of operation and maintenance manual with performance verification test.
 2. After approval of the validation test plan, installer shall carry out all tests and procedures therein. Installer shall completely check out, calibrate, and test all connected hardware and software to insure that system performs in accordance with approved specifications and sequences of operation submitted. Installer shall complete and submit Test Check List.
- C. Demonstration
 1. System operation and calibration to be demonstrated by the installer in the presence of the Architect or VA's representative on random samples of equipment as dictated by the Architect or VA's representative. Should random sampling indicate improper commissioning, the owner reserves the right to subsequently witness complete calibration of the system at no addition cost to the VA.
 2. Demonstrate to authorities that all required safeties and life safety functions are fully functional and complete.
 3. Make accessible, personnel to provide necessary adjustments and corrections to systems as directed by balancing agency.
 4. The following witnessed demonstrations of field control equipment shall be included:

- a. Observe HVAC systems in shut down condition. Check dampers and valves for normal position.
 - b. Test application software for its ability to communicate with digital controllers, operator workstation, and uploading and downloading of control programs.
 - c. Demonstrate the software ability to edit the control program off-line.
 - d. Demonstrate reporting of alarm conditions for each alarm and ensure that these alarms are received at the assigned location, including operator workstations.
 - e. Demonstrate ability of software program to function for the intended applications-trend reports, change in status etc.
 - f. Demonstrate via graphed trends to show the sequence of operation is executed in correct manner, and that the HVAC systems operate properly through the complete sequence of operation, e.g., seasonal change, occupied/unoccupied mode, and warm-up condition.
 - g. Demonstrate hardware interlocks and safeties functions, and that the control systems perform the correct sequence of operation after power loss and resumption of power loss.
 - h. Prepare and deliver to the VA graphed trends of all control loops to demonstrate that each control loop is stable and the set points are maintained.
 - i. Demonstrate that each control loop responds to set point adjustment and stabilizes within one (1) minute. Control loop trend data shall be instantaneous and the time between data points shall not be greater than one (1) minute.
5. Witnessed demonstration of ECC functions shall consist of:
- a. Running each specified report.
 - b. Display and demonstrate each data entry to show site specific customizing capability. Demonstrate parameter changes.
 - c. Step through penetration tree, display all graphics, demonstrate dynamic update, and direct access to graphics.
 - d. Execute digital and analog commands in graphic mode.
 - e. Demonstrate DDC loop precision and stability via trend logs of inputs and outputs (6 loops minimum).
 - f. Demonstrate EMS performance via trend logs and command trace.
 - g. Demonstrate scan, update, and alarm responsiveness.
 - h. Demonstrate spreadsheet/curve plot software, and its integration with database.
 - i. Demonstrate on-line user guide, and help function and mail facility.
 - j. Demonstrate digital system configuration graphics with interactive upline and downline load, and demonstrate specified diagnostics.

- k. Demonstrate multitasking by showing dynamic curve plot, and graphic construction operating simultaneously via split screen.
- l. Demonstrate class programming with point options of beep duration, beep rate, alarm archiving, and color banding.

3.3 SEQUENCE

AHU-1 and RF-1

- A. This is a variable volume system with steam humidification, steam preheat and chilled water cooling coils, and variable volume terminal units with hydronic reheat coils. Maximum supply airflow is 12,500 cfm, with minimum outside airflow of 5,000 cfm. Space is occupied 24 hours per day and unit will remain on.
- B. Fan Speed Control:
 - a. Supply air fan shall modulate through its variable frequency drive to maintain duct static pressure setpoint, adjustable, in the supply distribution ductwork.
 - b. Return air fan shall modulate through its variable frequency drive to maintain duct static pressure setpoint, adjustable, in the return distribution ductwork.
 - c. The supply air static pressure sensor shall be located approximately 2/3 of the distance from the supply fan to the end of the supply ductwork system.
 - d. The return air static pressure sensor shall be located approximately 2/3 of the distance from the return fan to the end of the return ductwork system.
 - e. Static pressure reset: poll VAV boxes and adjust SA static pressure setpoint down until the most demanding VAV box is open. Adjust setpoint up if any VAV is open and not making CFM setpoint.
- C. SA discharge air setpoint of 55F maintained by modulating CHW valve open if SA is above setpoint and modulate steam preheat valve 100% open and modulate bypass dampers if SA is below setpoint.
 - a. When outside air temperature is above 60F (adj.) position outside, return and exhaust dampers as required to satisfy minimum outside air quantities (per Ventilation Control below), and modulate cooling coil valve to maintain discharge air setpoint.
 - b. When outside air temperature is below 60F (adj.) and the outside air enthalpy is less than return air enthalpy, modulate the exhaust, outside and return air dampers to maintain required discharge air temperature. Ventilation Control shall set minimum quantity of outside air utilized during economizer.
 - c. When outside air temperature is such that, at minimum ventilation air quantity, discharge air temperature to be colder than 52F (adj.), open preheat coil valve and modulate preheat coil bypass to maintain discharge air setpoint.
- D. Ventilation Control: Modulate economizer dampers to maintain minimum outside air of 5,000 cfm as determined by OA flow station.
- E. Heat Reclaim
 - a. Heat reclaim system is only active if chilled water coil is active. Pump P-5 shall be off if chilled water coil valve is closed.
 - b. Chilled water coil leaving air temperature (LAT) setpoint is 55F. AHU mounted reheat coil LAT is a floating setpoint. Reset AHU reheat LAT up from 55F by 2 degrees F for every five minutes (adj.) that all reheat coils (both variable and constant volume boxes) remain over 10% (adj.) open. AHU reheat LAT maximum setpoint is 63F. Reset setpoint down by 2 degrees F for every five minutes that any VAV box (VAV-02, VAV-07, VAV-07, VAV-08 and VAV-12) air control valve is open greater than 60% (adj.).

- c. Modulate P-5 VFD from 20%-100% to achieve AHU reheat LAT setpoint. Shut P-5 off if pump modulation below 20% is required.
- F. AHU humidifier
 - 1. On call for humidification, prove airflow and open isolation valve, wait five minutes (adj) and modulate steam valve to meet humidity setpoint at return duct mounted humidistat. Setpoint to be 35% r.h. (adj.). Alarm at relative humidity above 90% (adj.) at humidistat upstream of AHU mounted final filter.
- G. Variable Volume Spaces: Terminal Unit Control:
 - 1. VAV unit control:
 - a. Cooling: Modulate the volume control damper to maintain zone temperature setpoint (adj.). If damper at minimum position and space temperature more than 2F below setpoint for more than 5 minutes, begin heating sequence.
 - b. Heating: VAV damper shall go to heating cfm position and heating valve shall modulate to maintain zone temperature setpoint. If hydronic valve is completely energized and space is not satisfied, begin modulating damper until space is satisfied. If discharge air temperature exceeds 120F, open damper in increments of 10% of maximum flow until discharge air temperature is less than 120F. If valve is closed for 5 minutes, resume cooling mode.
- H. Constant Volume Spaces: Terminal Unit Control:
 - 1. VAV unit control:
 - a. Heating and Cooling: Modulate the volume control damper to maintain CFM setpoint as indicated on VAV schedule (adj.). Heating valve shall modulate to maintain zone temperature setpoint.
- I. Cart 3 and Decontamination Rooms: Terminal Unit Control:
 - 1. Supply VAV unit control - JCI:
 - a. Occupied Heating and Cooling: Modulate the volume control damper to maintain constant volume CFM setpoint as indicated on VAV schedule (adj.). Heating valve shall modulate to maintain zone temperature setpoint. Occupied mode shall be activated by keyswitch on Isolation Room Pressure Controller.
 - b. Unoccupied Heating and Cooling: Modulate the volume control damper to maintain constant volume 50% CFM of setpoint indicated on VAV schedule (adj.). Heating valve shall modulate to maintain zone temperature setpoint. Unoccupied mode shall be activated by keyswitch or code at room pressure controller.
 - 2. Exhaust damper control – room pressure controller with fast acting motor actuated valve:
 - a. (2) Decon rooms: Room differential monitor and controller shall modulate exhaust damper to attain differential pressure setpoint of 0.08" (adjustable) as determined by auxiliary differential pressure sensor between Decon Shower and Anteroom. Controller shall alarm if differential pressure between Nursing and Cart 3 (as determined by onboard differential sensor) or Anteroom/Shower is not maintained.
 - b. Cart 3: Room differential monitor and controller shall modulate exhaust damper to attain differential pressure setpoint of 0.08" (adjustable) as determined by onboard differential sensor between Nursing and Cart 3. Controller shall alarm if differential pressure between Nursing and Cart 3 is not maintained.
 - 3. HEPA filter differential alarm
 - a. Alarm upon 2.35" w.c. differential final filter resistance at HEPA filters for the Decontamination showers and Cart 3 exhaust inlets.
- J. Safeties:
 - 1. Low limit thermostat to shut down fans if discharge air temperature falls below 38F (adj.).
 - 2. Shut down supply fan if adjustable supply air duct high pressure limit is reached.
 - 3. Shut down return fan if adjustable return air duct low pressure limit is reached.
 - 4. All fans in this system to shut down upon signal of general alarm from Fire Alarm System.

- K. Report the following alarms to the BAS:
1. Tripping of the low limit thermostat.
 2. Supply duct high pressure limit reached.
 3. Supply duct high humidity
 4. Return duct low pressure limit reached.
 5. VFD loss of reference condition for each VFD in system.
 6. Supply air temperature below 45F (adj.).
 7. Supply air temperature above 120F (adj.).
 8. AHU-1 fan failure to start.
 9. AHU-1 fan failure to stop.
 10. RF-1 failure to start.
 11. RF-1 failure to stop.
 12. Filter pressure drop above adjustable limit (pre and final filters)
 13. Any zone temperature below 55F or above 90F.
 14. Mixed air temperature above 90F (adj.).
 15. Humidity of less than 25 grains/lb (adj.) or saturated conditions at AHU humidifier discharge
 16. Regen Fan failure to start.
 17. Regen Fan failure to stop.

Exhaust Fan EF-1

- A. This lab style exhaust fan shall operate continuously during all hours. Fan draws air from Cart 3 and (2) Decon areas through AFCVs, and from restrooms through VAV-13, and is equipped with an inlet and damper to draw additional air from the rooftop for dilution of Cart 3 and Decon exhaust.
1. The rooftop damper shall be closed if Decon and Cart 3 areas are unoccupied (as determined by the space mounted room pressure controllers)
 2. The rooftop damper shall be full open if any one of the areas are occupied.
 3. The vfd shall modulate the lab fan to satisfy the static pressure setpoint upstream of the restroom CAV box VAV-13 and upstream of all AFCVs serving Decon and Cart 3.
- B. BAS to monitor the status of the fan and alarm upon fan failure.
- C. Safeties: All fans to shut down upon signal of general alarm from fire alarm system

Exhaust Fan EF-2 and Makeup Air Unit MUA-1

- A. MUA-1 shall operate in 100% OA mode (OA damper open, RA damper closed) when CO (125 ppm) or NO₂ (5 ppm) is detected at the ambulance bay mounted sensors. Open steam coil valve and modulate coil bypass dampers to maintain ambulance bay heating temperature setpoint. EF-2 shall start concurrently when MUA-1 starts in 100% OA mode. Open EF damper and start fan when MUA-1 starts.
- B. MUA-1 shall operate in 100% RA (OA damper closed, RA damper open) mode when when CO or NO₂ is NOT present and when the ambulance bay is below heating temperature setpoint. EF-2 shall NOT operate when MUA-1 is in 100% RA mode.
- C. BAS to monitor the status of the fans and ambulance bay temperature and alarm upon fan failure.
- D. Safeties: All fans to shut down upon signal of general alarm from fire alarm system

Air Curtain

- A. Monitor temperature in vestibule with auxiliary stat. Air door is controlled locally by integral controller.

----- END -----

SECTION 23 21 13 HYDRONIC PIPING

PART 1 - GENERAL

1.1 DESCRIPTION

- A. Water piping to connect HVAC equipment, including the following:
 - 1. Chilled water, condenser water, heating hot water and drain piping.
 - 2. Extension of domestic water make-up piping.

1.2 RELATED WORK

- A. Section 01 00 00, GENERAL REQUIREMENTS.
- B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- C. Section 31 20 00, EARTH MOVING: Excavation and backfill.
- D. Section 03 30 00, CAST-IN-PLACE CONCRETE.
- H. Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION:
General mechanical requirements and items, which are common to more than one section of Division 23.
- I. Section 23 21 23, HYDRONIC PUMPS: Pumps.
- J. Section 23 07 11, HVAC, PLUMBING, and BOILER PLANT INSULATION: Piping insulation.
- L. Section 23 23 00, REFRIGERANT PIPING: Refrigerant piping and refrigerants.
- M. Section 23 25 00, HVAC WATER TREATMENT: Water treatment for open and closed systems.
- N. Section 23 82 00, CONVECTION HEATING AND COOLING UNITS: VAV and CV units, fan coil units, and radiant ceiling panels.
- O. Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC: Temperature and pressure sensors and valve operators.

1.3 QUALITY ASSURANCE

- A. Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION, which includes welding qualifications.
- B. Submit prior to welding of steel piping a certificate of Welder's certification. The certificate shall be current and not more than one year old.
- C. For mechanical pressed sealed fittings, only tools of fitting manufacturer shall be used.
- D. Mechanical pressed fittings shall be installed by factory trained workers.
- E. All grooved joint couplings, fittings, valves, and specialties shall be the products of a single manufacturer. Grooving tools shall be the same manufacturer as the grooved components.
 - 1. All castings used for coupling housings, fittings, valve bodies, etc., shall be date stamped for quality assurance and traceability.

1.4 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Manufacturer's Literature and Data:
 - 1. Pipe and equipment supports.
 - 2. Pipe and tubing, with specification, class or type, and schedule.
 - 3. Pipe fittings, including miscellaneous adapters and special fittings.
 - 4. Flanges, gaskets and bolting.
 - 5. Grooved joint couplings and fittings.
 - 6. Valves of all types.
 - 7. Strainers.
 - 8. Flexible connectors for water service.
 - 9. Pipe alignment guides.
 - 10. Expansion joints.
 - 11. Expansion compensators.
 - 12. All specified hydronic system components.
 - 13. Water flow measuring devices.
 - 14. Gages.
 - 15. Thermometers and test wells.
 - 16. Electric heat tracing systems.
- C. Manufacturer's certified data report, Form No. U-1, for ASME pressure vessels:
 - 1. Heat Exchangers (Steam to Water)
 - 2. Air separators.
 - 3. Expansion tanks.
- D. Submit the welder's qualifications in the form of a current (less than one year old) and formal certificate.
- E. Coordination Drawings: Refer to Article, SUBMITTALS of Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.
- F. As-Built Piping Diagrams: Provide drawing as follows for chilled water, condenser water, and heating hot water system and other piping systems and equipment.
 - 1. One wall-mounted stick file with complete set of prints. Mount stick file in the chiller plant or control room along with control diagram stick file.
 - 2. One complete set of reproducible drawings.
 - 3. One complete set of drawings in electronic Autocad and pdf format.

1.5 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only. American National Standards Institute, Inc.
- B. American Society of Mechanical Engineers/American National Standards Institute, Inc. (ASME/ANSI):
- B1.20.1-83(R2006) Pipe Threads, General Purpose (Inch)
- B16.4-06 Gray Iron Threaded Fittings B16.18-01 Cast Copper Alloy
Solder joint Pressure fittings
- B16.23-02 Cast Copper Alloy Solder joint Drainage fittings
- B40.100-05 Pressure Gauges and Gauge Attachments
- C. American National Standards Institute, Inc./Fluid Controls Institute (ANSI/FCI):
- 70-2-2006 Control Valve Seat Leakage
- D. American Society of Mechanical Engineers (ASME):
- B16.1-98 Cast Iron Pipe Flanges and Flanged Fittings
- B16.3-2006 Malleable Iron Threaded Fittings: Class 150 and 300
- B16.4-2006 Gray Iron Threaded Fittings: (Class 125 and 250)
- B16.5-2003 Pipe Flanges and Flanged Fittings: NPS ½ through NPS 24
Metric/Inch Standard
- B16.9-07 Factory Made Wrought Butt Welding Fittings
- B16.11-05 Forged Fittings, Socket Welding and Threaded
- B16.18-01 Cast Copper Alloy Solder Joint Pressure Fittings
- B16.22-01 Wrought Copper and Bronze Solder Joint Pressure Fittings.
- B16.24-06 Cast Copper Alloy Pipe Flanges and Flanged Fittings
- B16.39-06 Malleable Iron Threaded Pipe Unions
- B16.42-06 Ductile Iron Pipe Flanges and Flanged Fittings
- B31.1-08 Power Piping
- E. American Society for Testing and Materials (ASTM):
- A47/A47M-99 (2004) Ferritic Malleable Iron Castings
- A53/A53M-07 Standard Specification for Pipe, Steel, Black and Hot-Dipped,
Zinc-Coated, Welded and Seamless
- A106/A106M-08 Standard Specification for Seamless Carbon Steel Pipe for
High-Temperature Service

A126-04	Standard Specification for Gray Iron Castings for Valves, Flanges, and Pipe Fittings
A183-03	Standard Specification for Carbon Steel Track Bolts and Nuts
A216/A216M-08	Standard Specification for Steel Castings, Carbon, Suitable for Fusion Welding, for High Temperature Service
A234/A234M-07	Piping Fittings of Wrought Carbon Steel and Alloy Steel for Moderate and High Temperature Service
A307-07	Standard Specification for Carbon Steel Bolts and Studs, 60,000 PSI Tensile Strength
A536-84 (2004)	Standard Specification for Ductile Iron Castings
A615/A615M-08	Deformed and Plain Carbon Steel Bars for Concrete Reinforcement
A653/A 653M-08	Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy Coated (Galvannealed) By the Hot-Dip Process
B32-08	Standard Specification for Solder Metal
B62-02	Standard Specification for Composition Bronze or Ounce Metal Castings
B88-03	Standard Specification for Seamless Copper Water Tube
B209-07	Aluminum and Aluminum Alloy Sheet and Plate
C177-04	Standard Test Method for Steady State Heat Flux Measurements and Thermal Transmission Properties by Means of the Guarded Hot Plate Apparatus
C478-09	Precast Reinforced Concrete Manhole Sections
C533-07	Calcium Silicate Block and Pipe Thermal Insulation
C552-07	Cellular Glass Thermal Insulation
D3350-08	Polyethylene Plastics Pipe and Fittings Materials
C591-08	Unfaced Preformed Rigid Cellular Polyisocyanurate Thermal Insulation
D1784-08	Rigid Poly (Vinyl Chloride) (PVC) Compounds and Chlorinated Poly (Vinyl Chloride) (CPVC) Compound
D1785-06	Poly (Vinyl Chloride) (PVC) Plastic Pipe, Schedules 40, 80 and 120
D2241-05	Poly (Vinyl Chloride) (PVC) Pressure Rated Pipe (SDR Series)

- F439-06.....Standard Specification for Chlorinated Poly (Vinyl Chloride)
(CPVC) Plastic Pipe Fittings, Schedule 80
- F441/F441M-02.....Standard Specification for Chlorinated Poly (Vinyl Chloride)
(CPVC) Plastic Pipe, Schedules 40 and 80
- F477-08.....Elastomeric Seals Gaskets) for Joining Plastic Pipe
- F. American Water Works Association (AWWA):
- C110-08Ductile Iron and Grey Iron Fittings for Water
- C203-02Coal Tar Protective Coatings and Linings for Steel Water Pipe
Lines Enamel and Tape Hot Applied
- G. American Welding Society (AWS):
- B2.1-02Standard Welding Procedure Specification
- H. Copper Development Association, Inc. (CDA):
- CDA A4015-06.....Copper Tube Handbook
- I. Expansion Joint Manufacturer's Association, Inc. (EJMA):
- EMJA-2003.....Expansion Joint Manufacturer's Association Standards, Ninth
Edition
- J. Manufacturers Standardization Society (MSS) of the Valve and Fitting Industry, Inc.:
- SP-67-02a.....Butterfly Valves
- SP-70-06Gray Iron Gate Valves, Flanged and Threaded Ends
- SP-71-05Gray Iron Swing Check Valves, Flanged and Threaded Ends
- SP-80-08Bronze Gate, Globe, Angle and Check Valves
- SP-85-02Cast Iron Globe and Angle Valves, Flanged and Threaded Ends
- SP-110-96Ball Valves Threaded, Socket-Welding, Solder Joint, Grooved
and Flared Ends
- SP-125-00Gray Iron and Ductile Iron In-line, Spring Loaded, Center-
Guided Check Valves
- K. National Sanitation Foundation/American National Standards Institute, Inc. (NSF/ANSI):
- 14-06Plastic Piping System Components and Related Materials
- 50-2009aEquipment for Swimming Pools, Spas, Hot Tubs and other
Recreational Water Facilities – Evaluation criteria for materials,
components, products, equipment and systems for use at
recreational water facilities
- 61-2008Drinking Water System Components – Health Effects

L. Tubular Exchanger Manufacturers Association: TEMA 9th Edition, 2007

1.6 SPARE PARTS

- A. For mechanical pressed sealed fittings provide tools required for each pipe size used at the facility.

PART 2 - PRODUCTS

2.1 PIPE AND EQUIPMENT SUPPORTS, PIPE SLEEVES, AND WALL AND CEILING PLATES

- A. Provide in accordance with Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.

2.2 PIPE AND TUBING

- A. Chilled Water, Condenser Water, Heating Hot Water, and Vent Piping:
 - 1. Steel: ASTM A53 Grade B, seamless or ERW, Schedule 40.
 - 2. Copper water tube option: ASTM B88, Type K or L, hard drawn
- B. Extension of Domestic Water Make-up Piping: ASTM B88, Type K or L, hard drawn copper tubing.
- C. Cooling Coil Condensate Drain Piping:
 - 1. From air handling units: Copper water tube, ASTM B88, Type M, or schedule 40 PVC plastic piping.
 - 2. From fan coil or other terminal units: Copper water tube, ASTM B88, Type L for runouts and Type M for mains.
- D. Chemical Feed Piping for Condenser Water Treatment: Chlorinated polyvinyl chloride (CPVC), Schedule 80, ASTM F441.
- E. Pipe supports, including insulation shields, for above ground piping: Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.

2.3 FITTINGS FOR STEEL PIPE

- A. 50 mm (2 inches) and Smaller: Screwed or welded joints.
 - 1. Butt welding: ASME B16.9 with same wall thickness as connecting piping.
 - 2. Forged steel, socket welding or threaded: ASME B16.11.
 - 3. Screwed: 150 pound malleable iron, ASME B16.3. 125 pound cast iron, ASME B16.4, may be used in lieu of malleable iron. Bushing reduction of a single pipe size, or use of close nipples, is not acceptable.
 - 4. Unions: ASME B16.39.
 - 5. Water hose connection adapter: Brass, pipe thread to 20 mm (3/4 inch) garden hose thread, with hose cap nut.

- B. 65 mm (2-1/2 inches) and Larger: Welded or flanged joints. Contractor's option: Grooved mechanical couplings and fittings are optional.
 - 1. Butt welding fittings: ASME B16.9 with same wall thickness as connecting piping. Elbows shall be long radius type, unless otherwise noted.
 - 2. Welding flanges and bolting: ASME B16.5:
 - a. Water service: Weld neck or slip-on, plain face, with 6 mm (1/8 inch) thick full face neoprene gasket suitable for 104 degrees C (220 degrees F).
 - 1) Contractor's option: Convuluted, cold formed 150 pound steel flanges, with teflon gaskets, may be used for water service.
 - b. Flange bolting: Carbon steel machine bolts or studs and nuts, ASTM A307, Grade B.
- C. Welded Branch and Tap Connections: Forged steel weldolets, or branchlets and threadolets may be used for branch connections up to one pipe size smaller than the main. Forged steel half-couplings, ASME B16.11 may be used for drain, vent and gage connections.
- D. Grooved Mechanical Pipe Couplings and Fittings (Contractor's Option): Grooved Mechanical Pipe Couplings and Fittings may be used, with cut or roll grooved pipe, in water service up to 110 degrees C (230 degrees F) in lieu of welded, screwed or flanged connections. All joints must be rigid type.
 - 1. Grooved mechanical couplings: Malleable iron, ASTM A47 or ductile iron, ASTM A536, fabricated in two or more parts, securely held together by two or more track-head, square, or oval-neck bolts, ASTM A449 and A183.
 - 2. Gaskets: Rubber product recommended by the coupling manufacturer for the intended service.
 - 3. Grooved end fittings: Malleable iron, ASTM A47; ductile iron, ASTM A536; or steel, ASTM A53 or A106, designed to accept grooved mechanical couplings. Tap-in type branch connections are acceptable.

2.4 FITTINGS FOR COPPER TUBING

- A. Joints:
 - 1. Solder Joints: Joints shall be made up in accordance with recommended practices of the materials applied. Apply 95/5 tin and antimony on all copper piping.
 - 2. Contractor's Option: Mechanical press sealed fittings, double pressed type, NSF 50/61 approved, with EPDM (ethylene propylene diene monomer) non-toxic synthetic rubber sealing elements for up 65 mm (2-1/2 inch) and below are optional for above ground water piping only.

3. Mechanically formed tee connection in water and drain piping: Form mechanically extracted collars in a continuous operation by drilling pilot hole and drawing out tube surface to form collar, having a height of not less than three times the thickness of tube wall. Adjustable collaring device shall insure proper tolerance and complete uniformity of the joint. Notch and dimple joining branch tube in a single process to provide free flow where the branch tube penetrates the fitting.
- B. Bronze Flanges and Flanged Fittings: ASME B16.24.
- C. Fittings: ANSI/ASME B16.18 cast copper or ANSI/ASME B16.22 solder wrought copper.

2.5 FITTINGS FOR PLASTIC PIPING

- A. Schedule 40, socket type for solvent welding.
- B. Schedule 40 PVC drain piping: Drainage pattern.
- C. Chemical feed piping for condenser water treatment: Chlorinated polyvinyl chloride (CPVC), Schedule 80, ASTM F439.

2.6 DIELECTRIC FITTINGS

- A. Provide where copper tubing and ferrous metal pipe are joined.
- B. 50 mm (2 inches) and Smaller: Threaded dielectric union, ASME B16.39.
- C. 65 mm (2 1/2 inches) and Larger: Flange union with dielectric gasket and bolt sleeves, ASME B16.42.
- D. Temperature Rating, 99 degrees C (210 degrees F).
- E. Contractor's option: On pipe sizes 2" and smaller, screwed end brass ball valves or dielectric nipples may be used in lieu of dielectric unions.

2.7 SCREWED JOINTS

- A. Pipe Thread: ANSI B1.20.
- B. Lubricant or Sealant: Oil and graphite or other compound approved for the intended service.

2.8 VALVES

- A. Asbestos packing is not acceptable.
- B. All valves of the same type shall be products of a single manufacturer.
- C. Provide chain operators for valves 150 mm (6 inches) and larger when the centerline is located 2400 mm (8 feet) or more above the floor or operating platform.
- D. Shut-Off Valves
 1. Ball Valves (Pipe sizes 2" and smaller): MSS-SP 110, screwed or solder connections, brass or bronze body with chrome-plated ball with full port and Teflon seat at 2760 kPa (400 psig)

working pressure rating. Provide stem extension to allow operation without interfering with pipe insulation.

2. Butterfly Valves (Pipe Sizes 2-1/2" and larger): Provide stem extension to allow 50 mm (2 inches) of pipe insulation without interfering with valve operation. MSS-SP 67, flange lug type or grooved end rated 1205 kPa (175 psig) working pressure at 93 degrees C (200 degrees F). Valves shall be ANSI Leakage Class VI and rated for bubble tight shut-off to full valve pressure rating. Valve shall be rated for dead end service and bi-directional flow capability to full rated pressure. Not permitted for direct buried pipe applications.
 - a. Body: Cast iron, ASTM A126, Class B. Malleable iron, ASTM A47 electro-plated, or ductile iron, ASTM A536, Grade 65-45-12 electro-plated.
 - b. Trim: Bronze, aluminum bronze, or 300 series stainless steel disc, bronze bearings, 316 stainless steel shaft and manufacturer's recommended resilient seat. Resilient seat shall be field replaceable, and fully line the body to completely isolate the body from the product. A phosphate coated steel shaft or stem is acceptable, if the stem is completely isolated from the product.
 - c. Actuators: Field interchangeable. Valves for balancing service shall have adjustable memory stop to limit open position.
 - 1) Valves 150 mm (6 inches) and smaller: Lever actuator with minimum of seven locking positions, except where chain wheel is required.
 - 2) Valves 200 mm (8 inches) and larger: Enclosed worm gear with handwheel, and where required, chain-wheel operator.
3. Gate Valves (Contractor's Option in lieu of Ball or Butterfly Valves):
 - a) 50 mm (2 inches) and smaller: MSS-SP 80, Bronze, 1034 kPa (150 psig), wedge disc, rising stem, union bonnet.
 - b) 65 mm (2 1/2 inches) and larger: Flanged, outside screw and yoke. MSS-SP 70, iron body, bronze mounted, 861 kPa (125 psig) wedge disc.

E. Globe and Angle Valves

1. Globe Valves
 - a. 50 mm (2 inches) and smaller: MSS-SP 80, bronze, 1034 kPa (150 lb.) Globe valves shall be union bonnet with metal plug type disc.
 - b. 65 mm (2 1/2 inches) and larger: 861 kPa (125 psig), flanged, iron body, bronze trim, MSS-SP-85 for globe valves.
2. Angle Valves:

- a. 50 mm (2 inches) and smaller: MSS-SP 80, bronze, 1034 kPa (150 lb.) Angle valves shall be union bonnet with metal plug type disc.
 - b. 65 mm (2 1/2 inches) and larger: 861 kPa (125 psig), flanged, iron body, bronze trim, MSS-SP-85 for angle.
- F. Check Valves
 - 1. Swing Check Valves:
 - a. 50 mm (2 inches) and smaller: MSS-SP 80, bronze, 1034 kPa (150 lb.), 45 degree swing disc.
 - b. 65 mm (2 1/2 inches) and larger: 861 kPa (125 psig), flanged, iron body, bronze trim, MSS-SP-71 for check valves.
 - 2. Non-Slam or Silent Check Valve: Spring loaded double disc swing check or internally guided flat disc lift type check for bubble tight shut-off. Provide where check valves are shown in chilled water and hot water piping. Check valves incorporating a balancing feature may be used.
 - a. Body: MSS-SP 125 cast iron, ASTM A126, Class B, or steel, ASTM A216, Class WCB, or ductile iron, ASTM 536, flanged, grooved, or wafer type.
 - b. Seat, disc and spring: 18-8 stainless steel, or bronze, ASTM B62. Seats may be elastomer material.
- G. Water Flow Balancing Valves: For flow regulation and shut-off. Valves shall be line size rather than reduced to control valve size.
 - 1. Ball or Globe style valve.
 - 2. A dual purpose flow balancing valve and adjustable flow meter, with bronze or cast iron body, calibrated position pointer, valved pressure taps or quick disconnects with integral check valves and preformed polyurethane insulating enclosure.
 - 3. Provide a readout kit including flow meter, readout probes, hoses, flow charts or calculator, and carrying case.
- H. Automatic Balancing Control Valves and coil connection kits. FC-1: Factory calibrated to maintain constant flow (plus or minus five percent) over system pressure fluctuations of at least 10 times the minimum required for control. Provide standard pressure taps and four sets of capacity charts. Valves shall be line size and be one of the following designs:
 - 1. Gray iron (ASTM A126) or brass body rated 1205 kPa (175 psig) at 93 degrees C (200 degrees F), with stainless steel piston and spring.

2. Brass or ferrous body designed for 2067 kPa (300 psig) service at 121 degrees C (250 degrees F), with corrosion resistant, tamper proof, self-cleaning piston/spring assembly that is easily removable for inspection or replacement.
3. Combination assembly containing ball type shut-off valve, unions, flow regulator, and pressure temperature ports.

FC-2: Combination assembly containing ball type shut-off valve, unions, strainers with blowdown valves and pressure temperature ports

2.9 WATER FLOW MEASURING DEVICES

- A. Minimum overall accuracy plus or minus three percent over a range of 70 to 110 percent of design flow. Select devices for not less than 110 percent of design flow rate.
- B. Venturi Type, FC-3: Bronze, steel, or cast iron with bronze throat, with valved pressure/temperature sensing taps upstream and at the throat.. Venturi: precision formed throat, with stated catalog accuracy of 3%. Assembly includes shutoff shutoff valve and unions. Provide portable meter kit complete with diaphragm gauge with over-range protection, ten foot hoses with P/T adapters, transparent gauge faces for reading gpm. Provide gauge ranges as required.
- C. Wafer Type Circuit Sensor: Cast iron wafer-type flow meter equipped with readout valves to facilitate the connecting of a differential pressure meter. Each readout valve shall be fitted with an integral check valve designed to minimize system fluid loss during the monitoring process.
- D. Self-Averaging Annular Sensor Type: Brass or stainless steel metering tube, shutoff valves and quick-coupling pressure connections. Metering tube shall be rotatable so all sensing ports may be pointed down-stream when unit is not in use.
- E. Insertion Turbine Type Sensor: Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC.
- F. Flow Measuring Device Identification:
 1. Metal tag attached by chain to the device.
 2. Include meter or equipment number, manufacturer's name, meter model, flow rate factor and design flow rate in l/m (gpm).
- G. Portable Water Flow Indicating Meters:
 1. Minimum 150 mm (6 inch) diameter dial, forged brass body, beryllium-copper bellows, designed for 1205 kPa (175 psig) working pressure at 121 degrees C (250 degrees F).
 2. Bleed and equalizing valves.
 3. Vent and drain hose and two 3000 mm (10 feet) lengths of hose with quick disconnect connections.

4. Factory fabricated carrying case with hose compartment and a bound set of capacity curves showing flow rate versus pressure differential.
5. Provide one portable meter for each range of differential pressure required for the installed flow devices.

2.10 STRAINERS

A. Y Type.

1. Screens: Bronze, monel metal or 18-8 stainless steel, free area not less than 2-1/2 times pipe area, with perforations as follows: 1.1 mm (0.045 inch) diameter perforations for 100 mm (4 inches) and larger: 3.2 mm (0.125 inch) diameter perforations.

B. Suction Diffusers: Specified in Section 23 21 23, HYDRONIC PUMPS.

2.11 FLEXIBLE CONNECTORS FOR WATER SERVICE

A. Flanged Spool Connector:

1. Single arch or multiple arch type. Tube and cover shall be constructed of chlorobutyl elastomer with full faced integral flanges to provide a tight seal without gaskets. Connectors shall be internally reinforced with high strength synthetic fibers impregnated with rubber or synthetic compounds as recommended by connector manufacturer, and steel reinforcing rings.
2. Working pressures and temperatures shall be as follows:
 - a. Connector sizes 50 mm to 100 mm (2 inches to 4 inches), 1137 kPa (165psig) at 121 degrees C (250 degrees F).
 - b. Connector sizes 125 mm to 300 mm (5 inches to 12 inches), 965 kPa (140 psig) at 121 degrees C (250 degrees F).
3. Provide ductile iron retaining rings and control units.

B. Mechanical Pipe Couplings:

See other fittings specified under Part 2, PRODUCTS.

2.12 EXPANSION JOINTS

- A. Factory built devices, inserted in the pipe lines, designed to absorb axial cyclical pipe movement which results from thermal expansion and contraction. This includes factory-built or field-fabricated guides located along the pipe lines to restrain lateral pipe motion and direct the axial pipe movement into the expansion joints.
- B. Manufacturing Quality Assurance: Conform to Expansion Joints Manufacturers Association Standards.
- C. Bellows - Internally Pressurized Type:
 1. Multiple corrugations of Type 304 or Type A240-321 stainless steel.

2. Internal stainless steel sleeve entire length of bellows.
 3. External cast iron equalizing rings for services exceeding 340 kPa (50 psig).
 4. Welded ends.
 5. Design shall conform to standards of EJMA and ASME B31.1.
 6. External tie rods designed to withstand pressure thrust force upon anchor failure if one or both anchors for the joint are at change in direction of pipeline.
 7. Integral external cover.
- D. Bellows - Externally Pressurized Type:
1. Multiple corrugations of Type 304 stainless steel.
 2. Internal and external guide integral with joint.
 3. Design for external pressurization of bellows to eliminate squirm.
 4. Welded ends.
 5. Conform to the standards of EJMA and ASME B31.1.
 6. Threaded connection at bottom, 25 mm (one inch) minimum, for drain or drip point.
 7. Integral external cover and internal sleeve.
- E. Expansion Compensators:
1. Corrugated bellows, externally pressurized, stainless steel or bronze.
 2. Internal guides and anti-torque devices.
 3. Threaded ends.
 4. External shroud.
 5. Conform to standards of EJMA.
- F. Expansion Joint (Contractor's Option): 2415 kPa (350 psig) maximum working pressure, steel pipe fitting consisting of telescoping body and slip-pipe sections, PTFE modified polyphenylene sulfide coated slide section, with grooved ends, suitable for axial end movement to 75 mm (3 inch).
- G. Expansion Joint Identification: Provide stamped brass or stainless steel nameplate on each expansion joint listing the manufacturer, the allowable movement, flow direction, design pressure and temperature, date of manufacture, and identifying the expansion joint by the identification number on the contract drawings.
- H. Guides: Provide factory-built guides along the pipe line to permit axial movement only and to restrain lateral and angular movement. Guides must be designed to withstand a minimum of 15 percent of the axial force which will be imposed on the expansion joints and anchors. Field-built guides may be used if detailed on the contract drawings.

- I. Supports: Provide saddle supports and frame or hangers for heat exchanger. Mounting height shall be adjusted to facilitate gravity return of steam condensate. Construct supports from steel, weld joints.

2.13 HYDRONIC SYSTEM COMPONENTS

- D. Air Purger: Cast iron or fabricated steel, 861 kPa (125 psig) water working pressure, for in-line installation.
- E. Air Separator: ASME Pressure Vessel Code construction for 861 kPa (125 psig) working pressure, flanged inlet and outlet connection, with integral strainer, blow down connections, and air venting assembly. Provide access to all internal parts for inspection and replacement.
 - a. Air removal: to 18 microns...
- F. Diaphragm Type Pre-Pressurized Expansion Tank: ASME Pressure Vessel Code construction for 861 kPa (125 psig) working pressure, welded steel shell, rust-proof coated, with a flexible elastomeric diaphragm suitable for a maximum operating temperature of 116 degrees C (240 degrees F). Provide Form No. U-1. Tank shall be equipped with system connection, drain connection, standard air fill valve and be factory pre-charged to a minimum of 83 kPa (12 psig).
- H. Pressure Reducing Valve (Water): Diaphragm or bellows operated, spring loaded type, with minimum adjustable range of 28 kPa (4 psig) above and below set point. Bronze, brass or iron body and bronze, brass or stainless steel trim, rated 861 kPa (125 psig) working pressure at 107 degrees C (225 degrees F).
- I. Pressure Relief Valve: Bronze or iron body and bronze or stainless steel trim, with testing lever. Comply with ASME Code for Pressure Vessels, Section 8, and bear ASME stamp.
- J. Automatic Air Vent Valves (where shown): Cast iron or semi-steel body, 1034 kPa (150 psig) working pressure, stainless steel float, valve, valve seat and mechanism, minimum 15 mm (1/2 inch) water connection and 6 mm (1/4 inch) air outlet. Air outlet shall be piped to the nearest floor drain.

2.14 WATER FILTERS AND POT CHEMICAL FEEDERS

See section 23 25 00, HVAC WATER TREATMENT, Article 2.2, CHEMICAL TREATMENT FOR CLOSED LOOP SYSTEMS.

2.15 GAGES, PRESSURE AND COMPOUND

- A. ASME B40.100, Accuracy Grade 1A, (pressure, vacuum, or compound for air, oil or water), initial mid-scale accuracy 1 percent of scale (Qualify grade), metal or phenolic case, 115 mm (4-1/2 inches) in diameter, 6 mm (1/4 inch) NPT bottom connection, white dial with black

graduations and pointer, clear glass or acrylic plastic window, suitable for board mounting.

Provide red "set hand" to indicate normal working pressure.

- B. Provide brass lever handle union cock. Provide brass/bronze pressure snubber for gages in water service.
- C. Range of Gages: Provide range equal to at least 130 percent of normal operating range.
 - 1. For condenser water suction (compound): Minus 100 kPa (30 inches Hg) to plus 700 kPa (100 psig).

2.16 PRESSURE/TEMPERATURE TEST PROVISIONS

- A. Pete's Plug: 6 mm (1/4 inch) MPT by 75 mm (3 inches) long, brass body and cap, with retained safety cap, nodel self-closing valve cores, permanently installed in piping where shown, or in lieu of pressure gage test connections shown on the drawings.
- B. Provide one each of the following test items to the Resident Engineer:
 - 1. 6 mm (1/4 inch) FPT by 3 mm (1/8 inch) diameter stainless steel pressure gage adapter probe for extra long test plug. PETE'S 500 XL is an example.
 - 2. 90 mm (3-1/2 inch) diameter, one percent accuracy, compound gage, —100 kPa (30 inches) Hg to 700 kPa (100 psig) range.
 - 3. 0 - 104 degrees C (220 degrees F) pocket thermometer one-half degree accuracy, 25 mm (one inch) dial, 125 mm (5 inch) long stainless steel stem, plastic case.

2.17 THERMOMETERS

- A. Mercury or organic liquid filled type, red or blue column, clear plastic window, with 150 mm (6 inch) brass stem, straight, fixed or adjustable angle as required for each in reading.
- B. Case: Chrome plated brass or aluminum with enamel finish.
- C. Scale: Not less than 225 mm (9 inches), range as described below, two degree graduations.
- D. Separable Socket (Well): Brass, extension neck type to clear pipe insulation.
- E. Scale ranges:
 - 1. Chilled Water and Glycol-Water: 0-38 degrees C (32-100 degrees F).
 - 2. Hot Water and Glycol-Water: -1 – 116 degrees C (30-240 degrees F).

2.18 FIRESTOPPING MATERIAL

Refer to Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.

PART 3 - EXECUTION

3.1 GENERAL

- A. The drawings show the general arrangement of pipe and equipment but do not show all required fittings and offsets that may be necessary to connect pipes to equipment, fan-coils, coils, radiators, etc., and to coordinate with other trades. Provide all necessary fittings, offsets and pipe

runs based on field measurements and at no additional cost to the government. Coordinate with other trades for space available and relative location of HVAC equipment and accessories to be connected on ceiling grid. Pipe location on the drawings shall be altered by contractor where necessary to avoid interferences and clearance difficulties.

- B. Store materials to avoid excessive exposure to weather or foreign materials. Keep inside of piping relatively clean during installation and protect open ends when work is not in progress.
- C. Support piping securely. Refer to PART 3, Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION. Install heat exchangers at height sufficient to provide gravity flow of condensate to the flash tank and condensate pump.
- D. Install piping generally parallel to walls and column center lines, unless shown otherwise on the drawings. Space piping, including insulation, to provide 25 mm (one inch) minimum clearance between adjacent piping or other surface. Unless shown otherwise, slope drain piping down in the direction of flow not less than 25 mm (one inch) in 12 m (40 feet). Provide eccentric reducers to keep bottom of sloped piping flat.
- E. Locate and orient valves to permit proper operation and access for maintenance of packing, seat and disc. Generally locate valve stems in overhead piping in horizontal position. Provide a union adjacent to one end of all threaded end valves. Control valves usually require reducers to connect to pipe sizes shown on the drawing. Install butterfly valves with the valve open as recommended by the manufacturer to prevent binding of the disc in the seat.
- F. Offset equipment connections to allow valving off for maintenance and repair with minimal removal of piping. Provide flexibility in equipment connections and branch line take-offs with 3-elbow swing joints where noted on the drawings.
- G. Tee water piping runouts or branches into the side of mains or other branches. Avoid bull-head tees, which are two return lines entering opposite ends of a tee and exiting out the common side.
- H. Provide manual or automatic air vent at all piping system high points and drain valves at all low points. Install piping to floor drains from all automatic air vents.
- I. Connect piping to equipment as shown on the drawings. Install components furnished by others such as:
 - 1. Water treatment pot feeders and condenser water treatment systems.
 - 2. Flow elements (orifice unions), control valve bodies, flow switches, pressure taps with valve, and wells for sensors.
- J. Thermometer Wells: In pipes 65 mm (2-1/2 inches) and smaller increase the pipe size to provide free area equal to the upstream pipe area.

K. Firestopping: Fill openings around uninsulated piping penetrating floors or fire walls, with firestop material. For firestopping insulated piping refer to Section 23 07 11, HVAC, PLUMBING, and BOILER PLANT INSULATION.

L. Where copper piping is connected to steel piping, provide dielectric connections.

3.2 PIPE JOINTS

A. Welded: Beveling, spacing and other details shall conform to ASME B31.1 and AWS B2.1. See Welder's qualification requirements under "Quality Assurance" in Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.

B. Screwed: Threads shall conform to ASME B1.20; joint compound shall be applied to male threads only and joints made up so no more than three threads show. Coat exposed threads on steel pipe with joint compound, or red lead paint for corrosion protection.

C. Mechanical Joint: Pipe grooving shall be in accordance with joint manufacturer's specifications. Lubricate gasket exterior including lips, pipe ends and housing interiors to prevent pinching the gasket during installation. Lubricant shall be as recommended by coupling manufacturer.

D. 125 Pound Cast Iron Flange (Plain Face): Mating flange shall have raised face, if any, removed to avoid overstressing the cast iron flange.

E. Solvent Welded Joints: As recommended by the manufacturer.

3.3 EXPANSION JOINTS (BELLOWS AND SLIP TYPE)

A. Anchors and Guides: Provide type, quantity and spacing as recommended by manufacturer of expansion joint and as shown. A professional engineer shall verify in writing that anchors and guides are properly designed for forces and moments which will be imposed.

B. Cold Set: Provide setting of joint travel at installation as recommended by the manufacturer for the ambient temperature during the installation.

C. Preparation for Service: Remove all apparatus provided to restrain joint during shipping or installation. Representative of manufacturer shall visit the site and verify that installation is proper.

D. Access: Expansion joints must be located in readily accessible space. Locate joints to permit access without removing piping or other devices. Allow clear space to permit replacement of joints and to permit access to devices for inspection of all surfaces and for adding.

3.5 LEAK TESTING ABOVEGROUND PIPING

A. Inspect all joints and connections for leaks and workmanship and make corrections as necessary, to the satisfaction of the Resident Engineer. Tests may be either of those below, or a combination, as approved by the Resident Engineer.

B. An operating test at design pressure, and for hot systems, design maximum temperature.

- C. A hydrostatic test at 1.5 times design pressure. For water systems the design maximum pressure would usually be the static head, or expansion tank maximum pressure, plus pump head. Factory tested equipment (convertors, exchangers, coils, etc.) need not be field tested. Isolate equipment where necessary to avoid excessive pressure on mechanical seals and safety devices.

3.6 FLUSHING AND CLEANING PIPING SYSTEMS

- A. Water Piping: Clean systems as recommended by the suppliers of chemicals specified in Section 23 25 00, HVAC WATER TREATMENT.
1. Initial flushing: Remove loose dirt, mill scale, metal chips, weld beads, rust, and like deleterious substances without damage to any system component. Provide temporary piping or hose to bypass coils, control valves, exchangers and other factory cleaned equipment unless acceptable means of protection are provided and subsequent inspection of hide-out areas takes place. Isolate or protect clean system components, including pumps and pressure vessels, and remove any component which may be damaged. Open all valves, drains, vents and strainers at all system levels. Remove plugs, caps, spool pieces, and components to facilitate early debris discharge from system. Sectionalize system to obtain debris carrying velocity of 1.8 m/S (6 feet per second), if possible. Connect dead-end supply and return headers as necessary. Flush bottoms of risers. Install temporary strainers where necessary to protect down-stream equipment. Supply and remove flushing water and drainage by various type hose, temporary and permanent piping and Contractor's booster pumps. Flush until clean as approved by the Resident Engineer.
 2. Cleaning: Using products supplied in Section 23 25 00, HVAC WATER TREATMENT, circulate systems at normal temperature to remove adherent organic soil, hydrocarbons, flux, pipe mill varnish, pipe joint compounds, iron oxide, and like deleterious substances not removed by flushing, without chemical or mechanical damage to any system component. Removal of tightly adherent mill scale is not required. Keep isolated equipment which is "clean" and where dead-end debris accumulation cannot occur. Sectionalize system if possible, to circulate at velocities not less than 1.8 m/S (6 feet per second). Circulate each section for not less than four hours. Blow-down all strainers, or remove and clean as frequently as necessary. Drain and prepare for final flushing.
 3. Final Flushing: Return systems to conditions required by initial flushing after all cleaning solution has been displaced by clean make-up. Flush all dead ends and isolated clean equipment. Gently operate all valves to dislodge any debris in valve body by throttling velocity. Flush for not less than one hour.

3.7 WATER TREATMENT

- A. Install water treatment equipment and provide water treatment system piping.
- B. Close and fill system as soon as possible after final flushing to minimize corrosion.
- C. Charge systems with chemicals specified in Section 23 25 00, HVAC WATER TREATMENT.
- D. Utilize this activity, by arrangement with the Resident Engineer, for instructing VA operating personnel.

3.9 OPERATING AND PERFORMANCE TEST AND INSTRUCTION

- A. Refer to PART 3, Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.
- B. Adjust red set hand on pressure gages to normal working pressure.

--- E N D ---

SECTION 23 21 23 HYDRONIC PUMPS

PART 1 - GENERAL

1.1 DESCRIPTION

- A. Hydronic pumps for Heating, Ventilating and Air Conditioning.

1.2 RELATED WORK

- A. Section 01 00 00, GENERAL REQUIREMENTS.
- B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- D. Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.
- E. Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING and EQUIPMENT.
- F. Section 23 21 13, HYDRONIC PIPING.
- G. Section 23 05 12, GENERAL MOTOR REQUIREMENTS FOR HVAC and STEAM GENERATION EQUIPMENT.
- H. Section 26 29 11, LOW-VOLTAGE MOTOR STARTERS.

1.3 QUALITY ASSURANCE

- A. Refer to Paragraph, QUALITY ASSURANCE, in Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.
- B. Design Criteria:
 - 1. Pumps design and manufacturer shall conform to Hydraulic Institute Standards.
 - 2. Pump sizes, capacities, pressures, operating characteristics and efficiency shall be as scheduled.
 - 3. Head-capacity curves shall slope up to maximum head at shut-off. Curves shall be relatively flat for closed systems. Select pumps near the midrange of the curve, so the design capacity falls to the left of the best efficiency point, to allow a cushion for the usual drift to the right in operation, without approaching the pump curve end point and possible cavitation and unstable operation. Select pumps for open systems so that required net positive suction head (NPSHR) does not exceed the net positive head available (NPSHA).
 - 4. Pump Driver: Furnish with pump. Size shall be non-overloading at any point on the head-capacity curve, including in a parallel or series pumping installation with one pump in operation.
 - 5. Provide all pumps with motors, impellers, drive assemblies, bearings, coupling guard and other accessories specified. Statically and dynamically balance all rotating parts.

6. Furnish each pump and motor with a nameplate giving the manufacturers name, serial number of pump, capacity in GPM and head in feet at design condition, horsepower, voltage, frequency, speed and full load current and motor efficiency.
 7. Test all pumps before shipment. The manufacturer shall certify all pump ratings.
 8. After completion of balancing, provide replacement of impellers or trim impellers to provide specified flow at actual pumping head, as installed.
- C. Allowable Vibration Tolerance for Pump Units: Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING and EQUIPMENT.

1.4 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Manufacturer's Literature and Data:
 1. Pumps and accessories.
 2. Motors and drives.
 3. Variable speed motor controllers.
- C. Manufacturer's installation, maintenance and operating instructions, in accordance with Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.
- D. Characteristic Curves: Head-capacity, efficiency-capacity, brake horsepower-capacity, and NPSHR-capacity for each pump and for combined pumps in parallel or series service. Identify pump and show fluid pumped, specific gravity, pump speed and curves plotted from zero flow to maximum for the impeller being furnished and at least the maximum diameter impeller that can be used with the casing.

1.5 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only:
- B. American Iron and Steel Institute (AISI):

AISI 1045.....Cold Drawn Carbon Steel Bar, Type 1045

AISI 416.....Type 416 Stainless Steel
- C. American National Standards Institute (ANSI):

ANSI B15.1-00(R2008).....Safety Standard for Mechanical Power Transmission Apparatus

ANSI B16.1-05Cast Iron Pipe Flanges and Flanged Fittings, Class 25, 125, 250 and 800
- D. American Society for Testing and Materials (ASTM):

A48-03 (2008).....Standard Specification for Gray Iron Castings

B62-2009Standard Specification for Composition Bronze or Ounce Metal
Castings

- E. Maintenance and Operating Manuals in accordance with Section 01 00 00, General Requirements.

1.6 DEFINITIONS

- A. Capacity: Liters per second (L/s) (Gallons per minute (GPM) of the fluid pumped.
- B. Head: Total dynamic head in kPa (feet) of the fluid pumped.
- C. Flat head-capacity curve: Where the shutoff head is less than 1.16 times the head at the best efficiency point.

1.7 SPARE MATERIALS

- A. Furnish one spare seal and casing gasket for each pump to the Resident Engineer.

PART 2 - PRODUCTS

2.1 CENTRIFUGAL PUMPS, BRONZE FITTED

- A. General:
 - 1. Provide pumps that will operate continuously without overheating bearings or motors at every condition of operation on the pump curve, or produce noise audible outside the room or space in which installed.
 - 2. Provide pumps of size, type and capacity as indicated, complete with electric motor and drive assembly, unless otherwise indicated. Design pump casings for the indicated working pressure and factory test at 1½ times the designed pressure.
 - 3. Provide pumps of the same type, the product of a single manufacturer, with pump parts of the same size and type interchangeable.
 - 4. General Construction Requirements
 - a. Balance: Rotating parts, statically and dynamically.
 - b. Construction: To permit servicing without breaking piping or motor connections.
 - c. Pump Motors: Provide high efficiency motors, inverter duty for variable speed service. Refer to Section 23 05 12, GENERAL MOTOR REQUIREMENTS FOR HVAC and STEAM GENERATION EQUIPMENT. Motors shall be Open Drip Proof and operate at 1750 rpm unless noted otherwise.
 - d. Heating pumps shall be suitable for handling water to 225°F.
 - e. Provide coupling guards that meet ANSI B15.1, Section 8 and OSHA requirements.
 - f. Pump Connections: Flanged.

- g. Pump shall be factory tested.
 - h. Performance: As scheduled on the Contract Drawings.
5. Variable Speed Pumps:
- a. The pumps shall be the type shown on the drawings and specified herein flex coupled to an open drip-proof motor.
 - b. Variable Speed Motor Controllers: Refer to Section 26 29 11, LOW-VOLTAGE MOTOR STARTERS and to Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION paragraph, Variable Speed Motor Controllers. Furnish controllers with pumps and motors.
 - c. Pump operation and speed control shall be as shown on the drawings.
- B. In-Line Type, Base Mounted End Suction or Double Suction Type:
- 1. Casing and Bearing Housing: Close-grained cast iron, ASTM A48.
 - 2. Casing Wear Rings: Bronze.
 - 3. Suction and Discharge: Plain face flange, 850 kPa (125 psig), ANSI B16.1.
 - 4. Casing Vent: Manual brass cock at high point.
 - 5. Casing Drain and Gage Taps: 15 mm (1/2-inch) plugged connections minimum size.
 - 6. Impeller: Bronze, ASTM B62, enclosed type, keyed to shaft.
 - 7. Shaft: Steel, AISI Type 1045 or stainless steel.
 - 8. Shaft Seal: Manufacturer's standard mechanical type to suit pressure and temperature and fluid pumped.
 - 9. Shaft Sleeve: Bronze or stainless steel.
 - 10. Motor: Furnish with pump. Refer to Section 23 05 12, GENERAL MOTOR REQUIREMENTS FOR HVAC AND STEAM GENERATION EQUIPMENT.
 - 11. Base Mounted Pumps:
 - a. Designed for disassembling for service or repair without disturbing the piping or removing the motor.
 - b. Impeller Wear Rings: Bronze.
 - c. Shaft Coupling: Non-lubricated steel flexible type or spacer type with coupling guard, ANSI B15.1, bolted to the baseplate.
 - d. Bearings (Double-Suction pumps): Regreaseable ball or roller type. Provide lip seal and slinger outboard of each bearing.
 - e. Base: Cast iron or fabricated steel for common mounting to a concrete base.

12. Provide line sized shut-off valve and suction strainer, maintain manufacturer recommended straight pipe length on pump suction (with blow down valve). Contractor option: Provide suction diffuser as follows:
 - a. Body: Cast iron with steel inlet vanes and combination diffuser-strainer-orifice cylinder with 5 mm (3/16-inch) diameter openings for pump protection. Provide taps for strainer blowdown and gage connections.
 - b. Provide adjustable foot support for suction piping.
 - c. Strainer free area: Not less than five times the suction piping.
 - d. Provide disposable start-up strainer.

PART 3 – EXECUTION

3.1 INSTALLATION

- A. Follow manufacturer's written instructions for pump mounting and start-up. Access/Service space around pumps shall not be less than minimum space recommended by pumps manufacturer.
- B. Provide drains for bases and seals for base mounted pumps, piped to and discharging into floor drains.
- C. Coordinate location of thermometer and pressure gauges as per Section 23 21 13, HYDRONIC PIPING.

3.2 START-UP

- A. Verify that the piping system has been flushed, cleaned and filled.
- B. Lubricate pumps before start-up.
- C. Prime the pump, vent all air from the casing and verify that the rotation is correct. To avoid damage to mechanical seals, never start or run the pump in dry condition.
- D. Verify that correct size heaters-motor over-load devices are installed for each pump controller unit.
- E. Field modifications to the bearings and or impeller (including trimming) are not permitted. If the pump does not meet the specified vibration tolerance send the pump back to the manufacturer for a replacement pump. All modifications to the pump shall be performed at the factory.
- F. Ensure the disposable strainer is free of debris prior to testing and balancing of the hydronic system.
- G. After several days of operation, replace the disposable start-up strainer with a regular strainer in the suction diffuser.

--- E N D ---

SECTION 23 22 13
STEAM AND CONDENSATE HEATING PIPING

PART 1 - GENERAL

1.1 DESCRIPTION

- A. Steam, condensate and vent piping inside buildings.

1.2 RELATED WORK

- A. Excavation and backfill: Section 31 20 00, EARTH MOVING.
- D. General mechanical requirements and items, which are common to more than one section of Division 23: Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION.
- E. Pumps: Section 23 22 23, STEAM CONDENSATE PUMPS.
- F. Piping insulation: Section 23 07 11, HVAC, PLUMBING, AND BOILER PLANT INSULATION.
- H. Water treatment for open and closed systems: Section 23 25 00, HVAC WATER TREATMENT.
- I. Heating Coils and Humidifiers: Section 23 73 00, INDOOR CENTRAL-STATION AIR-HANDLING UNITS and SECTION 23 31 00, HVAC DUCTS AND CASING.
- J. Heating and cooling radiant panels: Section 23 82 00, CONVECTION HEATING AND COOLING UNITS.
- K. Heating coils: Section 23 82 16, AIR COILS.
- L. Temperature and pressure sensors and valve operators: Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC.

1.3 QUALITY ASSURANCE

- A. Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION, which includes welding qualifications.

1.4 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Manufacturer's Literature and Data:
 - 1. Pipe and equipment supports.
 - 2. Pipe and tubing, with specification, class or type, and schedule.
 - 3. Pipe fittings, including miscellaneous adapters and special fittings.
 - 4. Flanges, gaskets and bolting.
 - 5. Valves of all types.

6. Strainers.
 7. Pipe alignment guides.
 9. Expansion compensators.
 10. Flexible ball joints: Catalog sheets, performance charts, schematic drawings, specifications and installation instructions.
 11. All specified steam system components.
 12. Gages.
 13. Thermometers and test wells.
 14. Electric heat tracing systems.
- C. Manufacturer's certified data report, Form No. U-1, for ASME pressure vessels:
1. Heat Exchangers (Steam-to-Hot Water).
 2. Flash tanks.
- D. Coordination Drawings: Refer to Article, SUBMITTALS of Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION.
- E. As-Built Piping Diagrams: Provide drawing as follows for steam and steam condensate piping and other central plant equipment.
1. One wall-mounted stick file for prints. Mount stick file in the chiller plant or adjacent control room along with control diagram stick file.
 2. One set of reproducible drawings.

1.5 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American Society of Mechanical Engineers/American National Standards Institute (ASME/ANSI):
- B1.20.1-83(R2006)Pipe Threads, General Purpose (Inch)
- B16.4-2006Gray Iron Threaded Fittings
- C. American Society of Mechanical Engineers (ASME):
- B16.1-2005Gray Iron Pipe Flanges and Flanged Fittings
- B16.3-2006Malleable Iron Threaded Fittings
- B16.9-2007Factory-Made Wrought Butt welding Fittings
- B16.11-2005Forged Fittings, Socket-Welding and Threaded
- B16.14-91Ferrous Pipe Plugs, Bushings, and Locknuts with Pipe Threads

B16.22-2001	Wrought Copper and Copper Alloy Solder-Joint Pressure Fittings
B16.23-2002	Cast Copper Alloy Solder Joint Drainage Fittings
B16.24-2006	Cast Copper Alloy Pipe Flanges and Flanged Fittings, Class 150, 300, 400, 600, 900, 1500 and 2500
B16.39-98	Malleable Iron Threaded Pipe Unions, Classes 150, 250, and 300
B31.1-2007	Power Piping
B31.9-2008	Building Services Piping
B40.100-2005	Pressure Gauges and Gauge Attachments
Boiler and Pressure Vessel Code: SEC VIII D1-2001, Pressure Vessels, Division 1	
D. American Society for Testing and Materials (ASTM):	
A47-99	Ferritic Malleable Iron Castings
A53-2007	Pipe, Steel, Black and Hot-Dipped, Zinc-Coated, Welded and Seamless
A106-2008	Seamless Carbon Steel Pipe for High-Temperature Service
A126-2004	Standard Specification for Gray Iron Castings for Valves, Flanges, and Pipe Fittings
A181-2006	Carbon Steel Forgings, for General-Purpose Piping
A183-2003	Carbon Steel Track Bolts and Nuts
A216-2008	Standard Specification for Steel Castings, Carbon, Suitable for Fusion Welding, for High Temperature Service
A285-01	Pressure Vessel Plates, Carbon Steel, Low-and-Intermediate-Tensile Strength
A307-2007	Carbon Steel Bolts and Studs, 60,000 PSI Tensile Strength
A516-2006	Pressure Vessel Plates, Carbon Steel, for Moderate-and- Lower Temperature Service
A536-84(2004)e1	Standard Specification for Ductile Iron Castings
B32-2008	Solder Metal
B61-2008	Steam or Valve Bronze Castings
B62-2009	Composition Bronze or Ounce Metal Castings
B88-2003	Seamless Copper Water Tube

- F439-06.....Socket-Type Chlorinated Poly (Vinyl Chloride) (CPVC) Plastic
Pipe Fittings, Schedule 80
- F441-02(2008).....Chlorinated Poly (Vinyl Chloride) (CPVC) Plastic Pipe,
Schedules 40 and 80
- E. American Welding Society (AWS):
- A5.8-2004Filler Metals for Brazing and Braze Welding
- B2.1-00Welding Procedure and Performance Qualifications
- F. Manufacturers Standardization Society (MSS) of the Valve and Fitting Industry, Inc.:
- SP-67-95Butterfly Valves
- SP-70-98Cast Iron Gate Valves, Flanged and Threaded Ends
- SP-71-97Gray Iron Swing Check Valves, Flanged and Threaded Ends
- SP-72-99Ball Valves with Flanged or Butt-Welding Ends for General
Service
- SP-78-98Cast Iron Plug Valves, Flanged and Threaded Ends
- SP-80-97Bronze Gate, Globe, Angle and Check Valves
- SP-85-94Cast Iron Globe and Angle Valves, Flanged and Threaded Ends
- G. Military Specifications (Mil. Spec.):
- MIL-S-901D-1989Shock Tests, H.I. (High Impact) Shipboard Machinery,
Equipment, and Systems
- H. National Board of Boiler and Pressure Vessel Inspectors (NB): Relieving Capacities of Safety
Valves and Relief Valves
- I. Tubular Exchanger Manufacturers Association: TEMA 18th Edition, 2000

PART 2 - PRODUCTS

2.1 PIPE AND EQUIPMENT SUPPORTS, PIPE SLEEVES, AND WALL AND CEILING PLATES

- A. Provide in accordance with Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND
STEAM GENERATION.

2.2 PIPE AND TUBING

- A. Steam Piping: Steel, ASTM A53, Grade B, seamless or ERW; A106 Grade B, Seamless;
Schedule 40.
- B. Steam Condensate and Pumped Condensate Piping:
1. Concealed above ceiling, in wall or chase: Copper water tube ASTM B88, Type K, hard
drawn.

2. All other locations: Copper water tube ASTM B88, Type K, hard drawn; or steel, ASTM A53, Grade B, Seamless or ERW, or A106 Grade B Seamless, Schedule 80.
- C. Vent Piping: Steel, ASTM A53, Grade B, seamless or ERW; A106 Grade B, Seamless; Schedule 40, galvanized.

2.3 FITTINGS FOR STEEL PIPE

- A. 50 mm (2 inches) and Smaller: Screwed or welded.
 1. Butt welding: ASME B16.9 with same wall thickness as connecting piping.
 2. Forged steel, socket welding or threaded: ASME B16.11.
 3. Screwed: 150 pound malleable iron, ASME B16.3. 125 pound cast iron, ASME B16.4, may be used in lieu of malleable iron, except for steam and steam condensate piping. Provide 300 pound malleable iron, ASME B16.3 for steam and steam condensate piping. Cast iron fittings or piping is not acceptable for steam and steam condensate piping. Bushing reduction of a single pipe size, or use of close nipples, is not acceptable.
 4. Unions: ASME B16.39.
 5. Steam line drip station and strainer quick-couple blowdown hose connection: Straight through, plug and socket, screw or cam locking type for 15 mm (1/2 inch) ID hose. No integral shut-off is required.
- B. 65 mm (2-1/2 inches) and Larger: Welded or flanged joints.
 1. Butt welding fittings: ASME B16.9 with same wall thickness as connecting piping. Elbows shall be long radius type, unless otherwise noted.
 2. Welding flanges and bolting: ASME B16.5:
 - a. Steam service: Weld neck or slip-on, raised face, with non-asbestos gasket. Non-asbestos gasket shall either be stainless steel spiral wound strip with flexible graphite filler or compressed inorganic fiber with nitrile binder rated for saturated and superheated steam service 750 degrees F and 1500 psi.
 - b. Flange bolting: Carbon steel machine bolts or studs and nuts, ASTM A307, Grade B.
- C. Welded Branch and Tap Connections: Forged steel weldolets, or branchlets and threadolets may be used for branch connections up to one pipe size smaller than the main. Forged steel half-couplings, ASME B16.11 may be used for drain, vent and gage connections.

2.4 FITTINGS FOR COPPER TUBING

- A. Solder Joint:
 1. Joints shall be made up in accordance with recommended practices of the materials applied. Apply 95/5 tin and antimony on all copper piping.

- B. Bronze Flanges and Flanged Fittings: ASME B16.24.
- C. Fittings: ANSI/ASME B16.18 cast copper or ANSI/ASME B16.22 solder wrought copper.

2.5 DIELECTRIC FITTINGS

- A. Provide where copper tubing and ferrous metal pipe are joined.
- B. 50 mm (2 inches) and Smaller: Threaded dielectric union, ASME B16.39.
- C. 65 mm (2 1/2 inches) and Larger: Flange union with dielectric gasket and bolt sleeves, ASME B16.42.
- D. Temperature Rating, 121 degrees C (250 degrees F) for steam condensate and as required for steam service.
- E. Contractor's option: On pipe sizes 2" and smaller, screwed end brass gate valves // or dielectric nipples // may be used in lieu of dielectric unions.

2.6 SCREWED JOINTS

- A. Pipe Thread: ANSI B1.20.
- B. Lubricant or Sealant: Oil and graphite or other compound approved for the intended service.

2.7 VALVES

- A. Asbestos packing is not acceptable.
- B. All valves of the same type shall be products of a single manufacturer.
- C. Provide chain operators for valves 150 mm (6 inches) and larger when the centerline is located 2100 mm (7 feet) or more above the floor or operating platform.
- D. Shut-Off Valves
 - 1. Gate Valves:
 - a. 50 mm (2 inches) and smaller: MSS-SP80, Bronze, 1034 kPa (150 lb.), wedge disc, rising stem, union bonnet.
 - b. 65 mm (2 1/2 inches) and larger: Flanged, outside screw and yoke.
 - 1) High pressure steam 413 kPa (60 psig) and above nominal MPS system): Cast steel body, ASTM A216 grade WCB, 1034 kPa (150 psig) at 260 degrees C (500 degrees F), 11-1/2 to 13 percent chrome stainless steel solid disc and seats. Provide 25 mm (1 inch) factory installed bypass with globe valve on valves 100 mm (4 inches) and larger.
 - 2) All other services: MSS-SP 70, iron body, bronze mounted, 861 kPa (125 psig) wedge disc.
- E. Globe and Angle Valves:
 - 1. Globe Valves:

- a. 50 mm (2 inches) and smaller: MSS-SP 80, bronze, 1034 kPa (150 lb.) Globe valves shall be union bonnet with metal plug type disc.
 - b. 65 mm (2 1/2 inches) and larger:
 - 1) Globe valves for high pressure steam 413 kPa (60 psig) and above nominal MPS system): Cast steel body, ASTM A216 grade WCB, flanged, OS&Y, 1034 kPa (150 psig) at 260 degrees C (500 degrees F), 11-1/2 to 13 percent chrome stainless steel disc and renewable seat rings.
 - 2) All other services: 861 kPa (125 psig), flanged, iron body, bronze trim, MSS-SP-85 for globe valves.
2. Angle Valves
- a. 50 mm (2 inches) and smaller: MSS-SP 80, bronze, 1034 kPa (150 lb.) Angle valves shall be union bonnet with metal plug type disc.
 - b. 65 mm (2 1/2 inches) and larger:
 - 1) Angle valves for high pressure steam 413 kPa (60 psig) and above nominal MPS system): Cast steel body, ASTM A216 grade WCB, flanged, OS&Y, 1034 kPa (150 psig) at 260 degrees C (500 degrees F), 11-1/2 to 13 percent chrome stainless steel disc and renewable seat rings.
 - 2) All other services: 861 kPa (125 psig), flanged, iron body, bronze trim, MSS-SP-85 for angle valves.
- F. Swing Check Valves
- 1. 50 mm (2 inches) and smaller: MSS-SP 80, bronze, 1034 kPa (150 psig), 45 degree swing disc.
 - 2. 65 mm (2-1/2 inches) and Larger:
 - a. Check valves for high pressure steam 413 kPa (60 psig) and above nominal MPS system: Cast steel body, ASTM A216 grade WCB, flanged, OS&Y, 1034 kPa (150 psig) at 260 degrees C (500 degrees F), 11-1/2 to 13 percent chrome stainless steel disc and renewable seat rings.
 - b. All other services: 861 kPa (125 psig), flanged, iron body, bronze trim, MSS-SP-71 for check valves.
- G. Manual Radiator/Convactor Valves: Brass, packless, with position indicator.

2.8 STRAINERS

- A. Basket or Y Type. Tee type is acceptable for gravity flow and pumped steam condensate service.
- B. High Pressure Steam: Rated 1034 kPa (150 psig) saturated steam.

1. 50 mm (2 inches) and smaller: Iron, ASTM A116 Grade B, or bronze, ASTM B-62 body with screwed connections (250 psig).
 2. 65 mm (2-1/2 inches) and larger: Flanged cast steel or 1723 kPa (250 psig) cast iron.
- C. All Other Services: Rated 861 kPa (125 psig) saturated steam.
1. 50 mm (2 inches) and smaller: Cast iron or bronze.
 2. 65 mm (2-1/2 inches) and larger: Flanged, iron body.
- D. Screens: Bronze, monel metal or 18-8 stainless steel, free area not less than 2-1/2 times pipe area, with perforations as follows:
1. 75 mm (3 inches) and smaller: 20 mesh for steam and 1.1 mm (0.045 inch) diameter perforations for liquids.
 2. 100 mm (4 inches) and larger: 1.1 mm (0.045) inch diameter perforations for steam and 3.2 mm (0.125 inch) diameter perforations for liquids.

2.9 PIPE ALIGNMENT

- A. Guides: Provide factory-built guides along the pipe line to permit axial movement only and to restrain lateral and angular movement. Guides must be designed to withstand a minimum of 15 percent of the axial force which will be imposed on the expansion joints and anchors. Field-built guides may be used if detailed on the contract drawings.

2.12 STEAM SYSTEM COMPONENTS

- A. Heat Exchanger (Steam to Hot Water): Shell and tube type, U-bend removable tube bundle, steam in shell, water in tubes, equipped with support cradles.
1. Maximum tube velocity: 2.3 m/s (7.5 feet per second).
 2. Tube fouling factor: TEMA Standards, but not less than 0.00018 m²K/W (0.001 ft²hrF/Btu).
 3. Materials:
 - a. Shell: Steel.
 - b. Tube sheet and tube supports: Steel or brass.
 - c. Tubes: 20 mm (3/4 inch) OD copper.
 - d. Head or bonnet: Cast iron or steel.
 4. Construction: In accordance with ASME Pressure Vessel Code for 861 kPa (125 psig) working pressure for shell and tubes. Provide manufacturer's certified data report, Form No. U-1.
- B. Optional Heat Transfer Package: In lieu of field erected individual components, the Contractor may provide a factory or shop assembled package of heat exchangers, pumps, and other components supported on a welded steel frame.

C. Steam Pressure Reducing Valves in PRV Stations:

1. Type: Single-seated, diaphragm operated, spring-loaded, external or internal steam pilot-controlled, normally closed, adjustable set pressure. Pilot shall sense controlled pressure downstream of main valve.
2. Service: Provide controlled reduced pressure to steam piping systems.
3. Pressure control shall be smooth and continuous with maximum drop of 10 percent. Maximum flow capability of each valve shall not exceed capacity of downstream safety valve(s).
4. Main valve and pilot valve shall have replaceable valve plug and seat of stainless steel, monel, or similar durable material.
 - a. Pressure rating for high pressure steam: Not less than 1034 kPa (150 psig) saturated steam.
 - b. Connections: Flanged for valves 65 mm (2-1/2 inches) and larger; flanged or threaded ends for smaller valves.
5. Select pressure reducing valves to develop less than 85 dbA at 1500 mm (5 feet) elevation above adjacent floor, and 1500 mm (5 feet) distance in any direction. Inlet and outlet piping for steam pressure reducing valves shall be Schedule 80 minimum for required distance to achieve required levels or sound attenuators shall be applied.

D. Safety Valves and Accessories: Comply with ASME Boiler and Pressure Vessel Code, Section VIII. Capacities shall be certified by National Board of Boiler and Pressure Vessel Inspectors, maximum accumulation 10 percent. Provide lifting lever. Provide drip pan elbow where shown.

E. Steam PRV for Individual Equipment: Cast iron or bronze body, screwed or flanged ends, rated 861 kPa (125 psig) working pressure. Single-seated, diaphragm operated, spring loaded, adjustable range, all parts renewable.

F. Flash Tanks: Horizontal or vertical vortex type, constructed of copper bearing steel, ASTM A516 or ASTM A285, for a steam working pressure of 861 kPa (125 psig) to comply with ASME Code for Unfired Pressure Vessels and stamped with "U" symbol. Perforated pipe inside tank shall be ASTM A53 Grade B, Seamless or ERW, or A106 Grade B Seamless, Schedule 80. Corrosion allowance of 1.6 mm (1/16 inch) may be provided in lieu of the copper bearing requirement. Provide data Form No. U-1.

G. Steam Trap: Each type of trap shall be the product of a single manufacturer. Provide trap sets at all low points and at 61 m (200 feet) intervals on the horizontal main lines.

1. Floats and linkages shall provide sufficient force to open trap valve over full operating pressure range available to the system. Unless otherwise indicated on the drawings, traps shall be sized for capacities indicated at minimum pressure drop as follows:
 - a. For equipment with modulating control valve: 1.7 kPa (1/4 psig), based on a condensate leg of 300 mm (12 inches) at the trap inlet and gravity flow to the receiver.
 - b. For main line drip trap sets and other trap sets at steam pressure: Up to 70 percent of design differential pressure. Condensate may be lifted to the return line.
 2. Trap bodies: Bronze, cast iron, or semi-steel, constructed to permit ease of removal and servicing working parts without disturbing connecting piping. For systems without relief valve traps shall be 5. Mechanism: Brass, stainless steel or corrosion resistant alloy. rated for the pressure upstream of the PRV supplying the system.
 3. Balanced pressure thermostatic elements: Phosphor bronze, stainless steel or monel metal.
 4. Valves and seats: Suitable hardened corrosion resistant alloy.
 6. Floats: Stainless steel.
 7. Inverted bucket traps: Provide bi-metallic thermostatic element for rapid release of non-condensables.
- H. Thermostatic Air Vent (Steam): Brass or iron body, balanced pressure bellows, stainless steel (renewable) valve and seat, rated 861 kPa (125 psig) working pressure, 20 mm (3/4 inch) screwed connections. Air vents shall be balanced pressure type that responds to steam pressure-temperature curve and vents air at any pressure.
- I. Steam Humidifiers:
1. Steam separator type that discharges steam into the air stream through a steam jacketed distribution manifold or dispersion tube. Humidifiers shall be complete with Y-type steam supply strainer; modulating, normally closed steam control valve; normally closed condensate temperature switch; and manufacturer's standard steam trap.
 2. Steam separator: Stainless steel or cast iron.
 3. Distribution manifold: Stainless steel, composed of dispersion pipe and surrounding steam jacket, manifold shall span the width of duct or air handler, and shall be multiple manifold type

2.13 GAGES, PRESSURE AND COMPOUND

- A. ASME B40.1, Accuracy Grade 1A, (pressure, vacuum, or compound), initial mid-scale accuracy 1 percent of scale (Qualify grade), metal or phenolic case, 115 mm (4-1/2 inches) in diameter, 6 mm (1/4 inch) NPT bottom connection, white dial with black graduations and pointer, clear glass or acrylic plastic window, suitable for board mounting. Provide red "set hand" to indicate normal working pressure.
- B. Provide brass, lever handle union cock. Provide brass/bronze pressure snubber for gages in water service. Provide brass pigtail syphon for steam gages.
- C. Range of Gages: For services not listed provide range equal to at least 130 percent of normal operating range:

Low pressure steam and steam condensate to 103 kPa(15 psig)	0 to 207 kPa (30 psig).
Medium pressure steam and steam condensate nominal 413 kPa (60 psig)	0 to 689 kPa (100 psig).
High pressure steam and steam condensate nominal 620 kPa to 861 kPa (90 to 125 psig)	0 to 1378 kPa (200 psig).
Pumped condensate, steam condensate, gravity or vacuum (30" HG to 30 psig)	0 to 415 kPa (60 psig)

2.14 PRESSURE/TEMPERATURE TEST PROVISIONS

- A. Provide one each of the following test items to the Resident Engineer:
 - 1. 6 mm (1/4 inch) FPT by 3 mm (1/8 inch) diameter stainless steel pressure gage adapter probe for extra long test plug. PETE'S 500 XL is an example.
 - 2. 90 mm (3-1/2 inch) diameter, one percent accuracy, compound gage, 762 mm (30 inches) Hg to 689 kPa (100 psig) range.
 - 3. 0 - 104 degrees C (32-220 degrees F) pocket thermometer one-half degree accuracy, 25 mm (one inch) dial, 125 mm (5 inch) long stainless steel stem, plastic case.

2.15 FIRESTOPPING MATERIAL

- A. Refer to Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION.

PART 3 - EXECUTION

3.1 GENERAL

- A. The drawings show the general arrangement of pipe and equipment but do not show all required fittings and offsets that may be necessary to connect pipes to equipment, fan-coils, coils,

radiators, etc., and to coordinate with other trades. Provide all necessary fittings, offsets and pipe runs based on field measurements and at no additional cost to the government. Coordinate with other trades for space available and relative location of HVAC equipment and accessories to be connected on ceiling grid. Pipe location on the drawings shall be altered by contractor where necessary to avoid interferences and clearance difficulties.

- B. Store materials to avoid excessive exposure to weather or foreign materials. Keep inside of piping relatively clean during installation and protect open ends when work is not in progress.
- C. Support piping securely. Refer to PART 3, Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION. Install convertors and other heat exchangers at height sufficient to provide gravity flow of condensate to the flash tank and condensate pump.
- D. Install piping generally parallel to walls and column center lines, unless shown otherwise on the drawings. Space piping, including insulation, to provide 25 mm (one inch) minimum clearance between adjacent piping or other surface. Unless shown otherwise, slope steam, condensate and drain piping down in the direction of flow not less than 25 mm (one inch) in 12 m (40 feet). Provide eccentric reducers to keep bottom of sloped piping flat.
- E. Locate and orient valves to permit proper operation and access for maintenance of packing, seat and disc. Generally locate valve stems in overhead piping in horizontal position. Provide a union adjacent to one end of all threaded end valves. Control valves usually require reducers to connect to pipe sizes shown on the drawing. Install butterfly valves with the valve open as recommended by the manufacturer to prevent binding of the disc in the seat.
- F. Offset equipment connections to allow valving off for maintenance and repair with minimal removal of piping. Provide flexibility in equipment connections and branch line take-offs with 3-elbow swing joints where noted on the drawings.
- G. Tee water piping runouts or branches into the side of mains or other branches. Avoid bull-head tees, which are two return lines entering opposite ends of a tee and exiting out the common side.
- H. Connect piping to equipment as shown on the drawings. Install components furnished by others such as:
 - 1. Flow elements (orifice unions), control valve bodies, flow switches, pressure taps with valve, and wells for sensors.
- I. Firestopping: Fill openings around uninsulated piping penetrating floors or fire walls, with firestop material. For firestopping insulated piping refer to Section 23 07 11, HVAC, PLUMBING, and BOILER PLANT INSULATION.
- J. Where copper piping is connected to steel piping, provide dielectric connections.

- K. Pipe vents to the exterior. Where a combined vent is provided, the cross sectional area of the combined vent shall be equal to sum of individual vent areas. Slope vent piping one inch in 40 feet (0.25 percent) in direction of flow. Provide a drip trap elbow on relief valve outlets if the vent rises to prevent backpressure. Terminate vent minimum 0.3 M (12 inches) above the roof or through the wall minimum 2.5 M (8 feet) above grade with down turned elbow.

3.2 PIPE JOINTS

- A. Welded: Beveling, spacing and other details shall conform to ASME B31.1 and AWS B2.1. See Welder's qualification requirements under "Quality Assurance" in Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.
- B. Screwed: Threads shall conform to ASME B1.20; joint compound shall be applied to male threads only and joints made up so no more than three threads show. Coat exposed threads on steel pipe with joint compound, or red lead paint for corrosion protection.
- C. 125 Pound Cast Iron Flange (Plain Face): Mating flange shall have raised face, if any, removed to avoid overstressing the cast iron flange.

3.4 STEAM TRAP PIPING

- A. Install to permit gravity flow to the trap. Provide gravity flow (avoid lifting condensate) from the trap where modulating control valves are used. Support traps weighing over 11 kg (25 pounds) independently of connecting piping.

3.6 LEAK TESTING

- A. Inspect all joints and connections for leaks and workmanship and make corrections as necessary, to the satisfaction of the Resident Engineer in accordance with the specified requirements. Testing shall be performed in accordance with the specification requirements.
- B. An operating test at design pressure, and for hot systems, design maximum temperature.
- C. A hydrostatic test at 1.5 times design pressure. For water systems the design maximum pressure would usually be the static head, or expansion tank maximum pressure, plus pump head. Factory tested equipment (convertors, exchangers, coils, etc.) need not be field tested. Avoid excessive pressure on mechanical seals and safety devices.

3.7 FLUSHING AND CLEANING PIPING SYSTEMS

- A. Steam, Condensate and Vent Piping: No flushing or chemical cleaning required. Accomplish cleaning by pulling all strainer screens and cleaning all scale/dirt legs during start-up operation.

3.8 OPERATING AND PERFORMANCE TEST AND INSTRUCTION

- A. Refer to PART 3, Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.

B. Adjust red set hand on pressure gages to normal working pressure.

--- E N D ---

SECTION 23 22 23 STEAM CONDENSATE PUMPS

PART 1 - GENERAL

1.1 DESCRIPTION

- A. Steam condensate pumps for Heating, Ventilating and Air Conditioning.

1.2 RELATED WORK

- A. Section 01 00 00, GENERAL REQUIREMENTS.
- B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- D. Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.
- E. Section 23 05 41, NOISE and VIBRATION CONTROL FOR HVAC PIPING and EQUIPMENT.
- F. Section 23 22 13, STEAM AND CONDENSATE HEATING PIPING.
- G. Section 23 05 12, GENERAL MOTOR REQUIREMENTS FOR HVAC and STEAM GENERATION EQUIPMENT.

1.3 QUALITY ASSURANCE

- A. Refer to Paragraph, QUALITY ASSURANCE in Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.
- B. Design Criteria:
 1. Pumps design and manufacturer shall conform to Hydraulic Institute Standards.
 2. Pump sizes, capacities, pressures, operating characteristics and efficiency shall be as scheduled.
 3. Select pumps so that required net positive suction head (NPSHR) does not exceed the net positive head available (NPSHA).
 4. Pump Driver: Furnish with pump. Size shall be non-overloading at any point on the head-capacity curve including one pump operation in a parallel or series pumping installation.
 5. Provide all pumps with motors, impellers, drive assemblies, bearings, coupling guard and other accessories specified. Statically and dynamically balance all rotating parts.
 6. Furnish each pump and motor with a nameplate giving the manufacturers name, serial number of pump, capacity in GPM and head in feet at design condition, horsepower, voltage, frequency, speed and full load current and motor efficiency.
 7. Test all pumps before shipment. The manufacturer shall certify all pump ratings.
 8. After completion of balancing, provide replacement of impellers or trim impellers to provide specified flow at actual pumping head, as installed.
 9. Furnish one spare seal and casing gasket for each pump to the Resident Engineer.

- C. Allowable Vibration Tolerance for Pump Units: Section 23 05 41, NOISE and VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT.

1.4 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Manufacturer's Literature and Data:
 - 1. Pumps and accessories.
 - 2. Motors and drives.
- C. Manufacturer's installation, maintenance and operating instructions, in accordance with Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.
- D. Characteristic Curves: Head-capacity, efficiency-capacity, brake horsepower-capacity, and NPSHR-capacity for each pump.

1.5 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only:
- B. American Iron and Steel Institute (AISI):
 - AISI 1045.....Cold Drawn Carbon Steel Bar, Type 1045
 - AISI 416.....Type 416 Stainless Steel
- C. American National Standards Institute (ANSI):
 - ANSI B15.1-00(R2008)....Safety Standard for Mechanical Power Transmission Apparatus
 - ANSI B16.1-05Cast Iron Pipe Flanges and Flanged Fittings, Class 25, 125, 250 and 800
- D. American Society for Testing and Materials (ASTM):
 - A48-03(2008).....Standard Specification for Gray Iron Castings
 - B62-09Standard Specification for Composition Bronze or Ounce Metal Castings
- E. Maintenance and Operating Manuals in accordance with Section 01 00 00, GENERAL REQUIREMENTS.

1.6 DEFINITIONS

- A. Capacity: Liters per second (L/s) (Gallons per minute (GPM)) of the fluid pumped.
- B. Head: Total dynamic head in kPa (feet) of the fluid pumped.

PART 2 - PRODUCTS

2.1 CONDENSATE PUMP, PAD-MOUNTED

- A. General: Factory assembled unit consisting of vented receiver tank, motor-driven pumps, interconnecting piping and wiring, motor controls (including starters, if necessary) and accessories, designed to receive, store, and pump steam condensate.
- B. Receiver Tank: Cast iron with threaded openings for connection of piping and accessories and facilities for mounting float switches. Receivers for simplex pumps shall include all facilities for future mounting of additional pump and controls.
- C. Furnish seals for condensate pump with a minimum temperature rating of 121 degrees C (250 degrees F).
- D. Centrifugal Pumps: Bronze fitted with mechanical shaft seals.
 - 1. Designed to allow removal of rotating elements without disturbing connecting piping or pump casing mounting.
 - 2. Shafts: Stainless steel, AISI Type 416 or alloy steel with bronze shaft sleeves.
 - 3. Bearings: Regreaseable ball or roller type.
 - 4. Casing wearing rings: Bronze.
- E. Motors: Refer to Section 23 05 12, GENERAL MOTOR REQUIREMENTS FOR HVAC and STEAM GENERATION EQUIPMENT.
- F. Pump Operation:
 - 1. Float Switches: NEMA 1, mounted on receiver tank, to start and stop pumps in response to changes in the water level in the receiver and adjustable to permit the controlled water levels to be changed. Floats and connecting rods shall be copper, bronze or stainless steel.
 - 2. Alternator: Provide for duplex units to automatically start the second pump when the first pump fails in keeping the receiver water level from rising and to alternate the order of starting the pumps. For units 0.25 kW (1/3 horsepower) and smaller, the alternator may be the mechanical type for use in lieu of float switches.
- G. Control Cabinet for 3 Phase (0.37 kW (1/2 hp) and larger) Units: NEMA 1, UL approved, factory wired, enclosing all controls, with indicating lights, manual switches and resets mounted on the outside of the panel. Attach cabinet to the pump set with rigid steel framework, unless remote mounting is noted on the pump schedule.
 - 1. Motor starters: Magnetic contact types with circuit breakers or combination fusible disconnect switches. Provide low voltage control circuits (120 volt maximum) and "hand-off-automatic" (H-O-A) switches for each pump.

2. Indicating lights for each pump: Green to show that power is on, red to show that the pump is running.
- H. Electric Wiring: Suitable for 93 degrees C (200 degrees F) service; enclosed in liquid-tight flexible metal conduit where located outside of control cabinet with single point power connection.
- I. Receiver Accessories:
 1. Thermometer: 34-216 degrees C (100 - 420 degrees F), mounted below minimum water level.
 2. Water level gage glass: Brass with gage cocks which automatically stop the flow of water when the glass is broken. Provide drain on the lower gage cock and protection rods for the glass.

PART 3 – EXECUTION

3.1 INSTALLATION

- A. Follow manufacturer's written instructions for pump mounting and start-up. Access/Service space around pumps shall not be less than minimum space recommended by pumps manufacturer.
- B. Permanently support in-line pumps by the connecting piping only, not from the casing or the motor eye bolt.
- C. Sequence of installation for base-mounted pumps:
 1. Level and shim the unit base and grout to the concrete pad.
 2. Shim the driver and realign the pump and driver. Correct axial, angular or parallel misalignment of the shafts.
 3. Connect properly aligned and independently supported piping.
 4. Recheck alignment.
- D. Pad-mounted Condensate Pump : Level, shim, bolt, and grout the unit base onto the concrete pad.
- E. Sump Type Condensate Pump: Apply two coats of asphalt or bituminous compound on the exterior of the receiver tank, and mount level and flush in the floor with waterproofing gaskets and grouting to prevent ground water from entering the building from around the receiver.
- F. Coordinate location of thermometer and pressure gauges as per Section 23 22 13, STEAM and CONDENSATE HEATING PIPING.

3.2 START-UP

- A. Verify that the piping system has been flushed, cleaned and filled.
- B. Lubricate pumps before start-up.
- C. Prime the pump, vent all air from the casing and verify that the rotation is correct. To avoid damage to mechanical seals, never start or run the pump in dry condition.

- D. Verify that correct size heaters-motor over-load devices are installed for each pump controller unit.
- E. Field modifications to the bearings and or impeller (including trimming) are not permitted. If the pump does not meet the specified vibration tolerance send the pump back to the manufacturer for a replacement pump. All modifications to the pump shall be performed at the factory.

- - - E N D - - -

SECTION 23 23 00 REFRIGERANT PIPING

PART 1 - GENERAL

1.1 DESCRIPTION

- A. Field refrigerant piping for direct expansion HVAC systems.
- B. Refrigerant piping shall be sized, selected, and designed either by the equipment manufacturer or in strict accordance with the manufacturer's published instructions. The schematic piping diagram shall show all accessories such as, stop valves, level indicators, liquid receivers, oil separator, gauges, thermostatic expansion valves, solenoid valves, moisture separators and driers to make a complete installation.
- C. Definitions:
 - 1. Refrigerating system: Combination of interconnected refrigerant-containing parts constituting one closed refrigeration circuit in which a refrigerant is circulated for the purpose of extracting heat.
 - a. Low side means the parts of a refrigerating system subjected to evaporator pressure.
 - b. High side means the parts of a refrigerating system subjected to condenser pressure.
 - 2. Brazed joint: A gas-tight joint obtained by the joining of metal parts with alloys which melt at temperatures higher than 449 degrees C (840 degrees F) but less than the melting temperatures of the joined parts.

1.2 RELATED WORK

- F. Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION: General mechanical requirements and items, which are common to more than one section of Division 23.
- G. Section 23 07 11, HVAC, PLUMBING, and BOILER PLANT INSULATION: Requirements for piping insulation.
- I. Section 23 21 13, HYDRONIC PIPING: Requirements for water and drain piping and valves.

1.3 QUALITY ASSURANCE

- A. Refer to specification Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.
- B. Comply with ASHRAE Standard 15, Safety Code for Mechanical Refrigeration. The application of this Code is intended to assure the safe design, construction, installation, operation, and inspection of every refrigerating system employing a fluid which normally is vaporized and liquefied in its refrigerating cycle.

- C. Comply with ASME B31.5: Refrigerant Piping and Heat Transfer Components.
- D. Products shall comply with UL 207 "Refrigerant-Containing Components and Accessories, "Nonelectrical"; or UL 429 "Electrical Operated Valves."

1.4 SUBMITTALS

- A. Submit in accordance with specification Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Shop Drawings:
 - 1. Complete information for components noted, including valves and refrigerant piping accessories, clearly presented, shall be included to determine compliance with drawings and specifications for components noted below:
 - a. Tubing and fittings
 - b. Valves
 - c. Strainers
 - d. Moisture-liquid indicators
 - e. Filter-driers
 - f. Flexible metal hose
 - g. Liquid-suction interchanges
 - h. Oil separators (when specified)
 - i. Gages
 - j. Pipe and equipment supports
 - k. Refrigerant and oil
 - l. Pipe/conduit roof penetration cover
 - m. Soldering and brazing materials
 - 2. Layout of refrigerant piping and accessories, including flow capacities, valves locations, and oil traps slopes of horizontal runs, floor/wall penetrations, and equipment connection details.
- C. Certification: Copies of certificates for welding procedure, performance qualification record and list of welders' names and symbols.
- D. Design Manual: Furnish two copies of design manual of refrigerant valves and accessories.

1.5 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. Air Conditioning, Heating, and Refrigeration Institute (ARI/AHRI):
 - 495-1999 (R2002).....Standard for Refrigerant Liquid Receivers

- 730-2005Flow Capacity Rating of Suction-Line Filters and Suction-Line Filter-Driers
- 750-2007Thermostatic Refrigerant Expansion Valves
- 760-2007Performance Rating of Solenoid Valves for Use with Volatile Refrigerants
- C. American Society of Heating Refrigerating and Air Conditioning Engineers (ASHRAE):
- ANSI/ASHRAE 15-2007Safety Standard for Refrigeration Systems (ANSI)
- ANSI/ASHRAE 17-2008Method of Testing Capacity of Thermostatic Refrigerant Expansion Valves (ANSI)
- 63.1-95 (RA 01)Method of Testing Liquid Line Refrigerant Driers (ANSI)
- D. American National Standards Institute (ANSI):
- ASME (ANSI)A13.1-2007Scheme for Identification of Piping Systems
- Z535.1-2006Safety Color Code
- E. American Society of Mechanical Engineers (ASME):
- ANSI/ASME B16.22-2001 (R2005)
- Wrought Copper and Copper Alloy Solder-Joint Pressure Fittings (ANSI)
- ANSI/ASME B16.24-2006 Cast Copper Alloy Pipe Flanges and Flanged Fittings, Class 150, 300, 400, 600, 900, 1500 and 2500 (ANSI)
- ANSI/ASME B31.5-2006Refrigeration Piping and Heat Transfer Components (ANSI)
- ANSI/ASME B40.100-2005Pressure Gauges and Gauge Attachments
- ANSI/ASME B40.200-2008Thermometers, Direct Reading and Remote Reading
- F. American Society for Testing and Materials (ASTM)
- A126-04Standard Specification for Gray Iron Castings for Valves, Flanges, and Pipe Fittings
- B32-08 Standard Specification for Solder Metal
- B88-03Standard Specification for Seamless Copper Water Tube
- B88M-05Standard Specification for Seamless Copper Water Tube (Metric)
- B280-08Standard Specification for Seamless Copper Tube for Air Conditioning and Refrigeration Field Service

G. American Welding Society, Inc. (AWS):

Brazing Handbook

A5.8/A5.8M-04.....Standard Specification for Filler Metals for Brazing and Braze
Welding

H. Federal Specifications (Fed. Spec.)

Fed. Spec. GG

I. Underwriters Laboratories (U.L.):

U.L.207-2009.....Standard for Refrigerant-Containing Components and
Accessories, Nonelectrical

U.L.429-99 (Rev.2006).....Standard for Electrically Operated Valves

PART 2 - PRODUCTS

2.1 PIPING AND FITTINGS

- A. Refrigerant Piping: For piping up to 100 mm (4 inch) use Copper refrigerant tube, ASTM B280, cleaned, dehydrated and sealed, marked ACR on hard temper straight lengths. Coils shall be tagged ASTM B280 by the manufacturer. For piping over 100 mm (4 inch) use A53 Black SML steel.
- B. Water and Drain Piping: Copper water tube, ASTM B88M, Type B or C (ASTM B88, Type M or L). Optional drain piping material: Schedule 80 flame retardant Polypropylene plastic.
- C. Fittings, Valves and Accessories:
 - 1. Copper fittings: Wrought copper fittings, ASME B16.22.
 - a. Brazed Joints, refrigerant tubing: Cadmium free, AWS A5.8/A5.8M, 45 percent silver brazing alloy, Class BAg-5.
 - b. Solder Joints, water and drain: 95-5 tin-antimony, ASTM B32 (95TA).
 - 2. Steel fittings: ASTM wrought steel fittings.
 - a. Refrigerant piping – Welded Joints.
 - 3. Flanges and flanged fittings: ASME B16.24.
 - 4. Refrigeration Valves:
 - a. Stop Valves: Brass or bronze alloy, packless, or packed type with gas tight cap, frost proof, back seating.
 - b. Pressure Relief Valves: Comply with ASME Boiler and Pressure Vessel Code; UL listed. Forged brass with nonferrous, corrosion resistant internal working parts of high strength, cast iron bodies conforming to ASTM A126, Grade B. Set valves in accordance with ASHRAE Standard 15.

- c. Solenoid Valves: Comply with ARI 760 and UL 429, UL-listed, two-position, direct acting or pilot-operated, moisture and vapor-proof type of corrosion resisting materials, designed for intended service, and solder-end connections. Fitted with suitable NEMA 250 enclosure of type required by location and normally // open // closed // holding coil.
 - d. Thermostatic Expansion Valves: Comply with ARI 750. Brass body with stainless-steel or non-corrosive non ferrous internal parts, diaphragm and spring-loaded (direct-operated) type with sensing bulb and distributor having side connection for hot-gas bypass and external equalizer. Size and operating characteristics as recommended by manufacturer of evaporator and factory set for superheat requirements. Solder-end connections. Testing and rating in accordance with ASHRAE Standard 17.
 - e. Check Valves: Brass or bronze alloy with swing or lift type, with tight closing resilient seals for silent operation; designed for low pressure drop, and with solder-end connections. Direction of flow shall be legibly and permanently indicated on the valve body.
5. Strainers: Designed to permit removing screen without removing strainer from piping system, and provided with screens 80 to 100 mesh in liquid lines DN 25 (NPS 1) and smaller, 60 mesh in liquid lines larger than DN 25 (NPS 1), and 40 mesh in suction lines. Provide strainers in liquid line serving each thermostatic expansion valve, and in suction line serving each refrigerant compressor not equipped with integral strainer.
 6. Refrigerant Moisture/Liquid Indicators: Double-ported type having heavy sight glasses sealed into forged bronze body and incorporating means of indicating refrigerant charge and moisture indication. Provide screwed brass seal caps.
 7. Refrigerant Filter-Dryers: UL listed, angle or in-line type, as shown on drawings. Conform to ARI Standard 730 and ASHRAE Standard 63.1. Heavy gage steel shell protected with corrosion-resistant paint; perforated baffle plates to prevent desiccant bypass. Size as recommended by manufacturer for service and capacity of system with connection not less than the line size in which installed. Filter driers with replaceable filters shall be furnished with one spare element of each type and size.
 8. Flexible Metal Hose: Seamless bronze corrugated hose, covered with bronze wire braid, with standard copper tube ends. Provide in suction and discharge piping of each compressor.
 9. Water Piping Valves and Accessories: Refer to specification Section 23 21 13, HYDRONIC PIPING.

2.2 GAGES

- A. Temperature Gages: Comply with ASME B40.200. Industrial-duty type and in required temperature range for service in which installed. Gages shall have Celsius scale in 1-degree (Fahrenheit scale in 2-degree) graduations and with black number on a white face. The pointer shall be adjustable. Rigid stem type temperature gages shall be provided in thermal wells located within 1525 mm (5 feet) of the finished floor. Universal adjustable angle type or remote element type temperature gages shall be provided in thermal wells located 1525 to 2135 mm (5 to 7 feet) above the finished floor. Remote element type temperature gages shall be provided in thermal wells located 2135 mm (7 feet) above the finished floor.
- B. Vacuum and Pressure Gages: Comply with ASME B40.100 and provide with throttling type needle valve or a pulsation dampener and shut-off valve. Gage shall be a minimum of 90 mm (3-1/2 inches) in diameter with a range from 0 kPa (0 psig) to approximately 1.5 times the maximum system working pressure. Each gage range shall be selected so that at normal operating pressure, the needle is within the middle-third of the range.
 - 1. Suction: 101 kPa (30 inches Hg) vacuum to 1723 kPa (gage) (250 psig).
 - 2. Discharge: 0 to 3445 kPa (gage) (0 to 500 psig).

2.3 THERMOMETERS AND WELLS

- A. Refer to specification Section 23 21 13, HYDRONIC PIPING.

2.4 PIPE SUPPORTS

- A. Refer to specification Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.

2.5 REFRIGERANTS AND OIL

- A. Provide EPA approved refrigerant and oil for proper system operation.

2.6 PIPE/CONDUIT ROOF PENETRATION COVER

- A. Prefabricated Roof Curb: Galvanized steel or extruded aluminum 300 mm (12 inches) overall height, continuous welded corner seams, treated wood nailer, 38 mm (1-1/2 inch) thick, 48 kg/cu.m (3 lb/cu.ft.) density rigid mineral fiberboard insulation with metal liner, built-in cant strip (except for gypsum or tectum decks). For surface insulated roof deck, provide raised cant strip (recessed mounting flange) to start at the upper surface of the insulation. Curbs shall be constructed for pitched roof or ridge mounting as required to keep top of curb level.
- B. Penetration Cover: Galvanized sheet metal with flanged removable top. Provide 38 mm (1-1/2 inch) thick mineral fiber board insulation.

- C. Flashing Sleeves: Provide sheet metal sleeves for conduit and pipe penetrations of the penetration cover. Seal watertight penetrations.

2.7 PIPE INSULATION FOR DX HVAC SYSTEMS

Refer to specification Section 23 07 11, HVAC, PLUMBING, and BOILER PLANT INSULATION.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Install refrigerant piping and refrigerant containing parts in accordance with ASHRAE Standard 15 and ASME B31.5
 - 1. Install piping as short as possible, with a minimum number of joints, elbow and fittings.
 - 2. Install piping with adequate clearance between pipe and adjacent walls and hangers to allow for service and inspection. Space piping, including insulation, to provide 25 mm (1 inch) minimum clearance between adjacent piping or other surface. Use pipe sleeves through walls, floors, and ceilings, sized to permit installation of pipes with full thickness insulation.
 - 3. Locate and orient valves to permit proper operation and access for maintenance of packing, seat and disc. Generally locate valve stems in overhead piping in horizontal position. Provide a union adjacent to one end of all threaded end valves. Control valves usually require reducers to connect to pipe sizes shown on the drawing.
 - 4. Use copper tubing in protective conduit when installed below ground.
 - 5. Install hangers and supports per ASME B31.5 and the refrigerant piping manufacturer's recommendations.
- B. Joint Construction:
 - 1. Brazed Joints: Comply with AWS "Brazing Handbook" and with filler materials complying with AWS A5.8/A5.8M.
 - a. Use Type BcuP, copper-phosphorus alloy for joining copper socket fittings with copper tubing.
 - b. Use Type BAg, cadmium-free silver alloy for joining copper with bronze or steel.
 - c. Swab fittings and valves with manufacturer's recommended cleaning fluid to remove oil and other compounds prior to installation.
 - d. Pass nitrogen gas through the pipe or tubing to prevent oxidation as each joint is brazed. Cap the system with a reusable plug after each brazing operation to retain the nitrogen and prevent entrance of air and moisture.

- C. Protect refrigerant system during construction against entrance of foreign matter, dirt and moisture; have open ends of piping and connections to compressors, condensers, evaporators and other equipment tightly capped until assembly.
- D. Pipe relief valve discharge to outdoors for systems containing more than 45 kg (100 lbs) of refrigerant.
- E. Firestopping: Fill openings around uninsulated piping penetrating floors or fire walls, with firestop material. For firestopping insulated piping refer to Section 23 07 11, HVAC, PLUMBING, and BOILER PLANT INSULATION.

3.2 PIPE AND TUBING INSULATION

- A. Refer to specification Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.
- B. Apply two coats of weather-resistant finish as recommended by the manufacturer to insulation exposed to outdoor weather.

3.3 SIGNS AND IDENTIFICATION

- A. Each refrigerating system erected on the premises shall be provided with an easily legible permanent sign securely attached and easily accessible, indicating thereon the name and address of the installer, the kind and total number of pounds of refrigerant required in the system for normal operations, and the field test pressure applied.
- B. Systems containing more than 50 kg (110 lb) of refrigerant shall be provided with durable signs, in accordance with ANSI A13.1 and ANSI Z535.1, having letters not less than 13 mm (1/2 inch) in height designating:
 - 1. Valves and switches for controlling refrigerant flow, the ventilation and the refrigerant compressor(s).
 - 2. Signs on all exposed high pressure and low pressure piping installed outside the machinery room, with name of the refrigerant and the letters "HP" or "LP."

3.4 FIELD QUALITY CONTROL

Prior to initial operation examine and inspect piping system for conformance to plans and specifications and ASME B31.5. Correct equipment, material, or work rejected because of defects or nonconformance with plans and specifications, and ANSI codes for pressure piping.

- A. After completion of piping installation and prior to initial operation, conduct test on piping system according to ASME B31.5. Furnish materials and equipment required for tests. Perform tests in the presence of Resident Engineer. If the test fails, correct defects and perform the test again until it is satisfactorily done and all joints are proved tight.

1. Every refrigerant-containing parts of the system that is erected on the premises, except compressors, condensers, evaporators, safety devices, pressure gages, control mechanisms and systems that are factory tested, shall be tested and proved tight after complete installation, and before operation.
 2. The high and low side of each system shall be tested and proved tight at not less than the lower of the design pressure or the setting of the pressure-relief device protecting the high or low side of the system, respectively, except systems erected on the premises using non-toxic and non-flammable Group A1 refrigerants with copper tubing not exceeding DN 18 (NPS 5/8). This may be tested by means of the refrigerant charged into the system at the saturated vapor pressure of the refrigerant at 20 degrees C (68 degrees F) minimum.
- B. Test Medium: A suitable dry gas such as nitrogen or shall be used for pressure testing. The means used to build up test pressure shall have either a pressure-limiting device or pressure-reducing device with a pressure-relief device and a gage on the outlet side. The pressure relief device shall be set above the test pressure but low enough to prevent permanent deformation of the system components.

3.5 SYSTEM TEST AND CHARGING

- A. System Test and Charging: As recommended by the equipment manufacturer or as follows:
1. Connect a drum of refrigerant to charging connection and introduce enough refrigerant into system to raise the pressure to 70 kPa (10 psi) gage. Close valves and disconnect refrigerant drum. Test system for leaks with halide test torch or other approved method suitable for the test gas used. Repair all leaking joints and retest.
 2. Connect a drum of dry nitrogen to charging valve and bring test pressure to design pressure for low side and for high side. Test entire system again for leaks.
 3. Evacuate the entire refrigerant system by the triplicate evacuation method with a vacuum pump equipped with an electronic gage reading in mPa (microns). Pull the system down to 665 mPa (500 microns) 665 mPa (2245.6 inches of mercury at 60 degrees F) and hold for four hours then break the vacuum with dry nitrogen (or refrigerant). Repeat the evacuation two more times breaking the third vacuum with the refrigeration to be charged and charge with the proper volume of refrigerant.

- - - E N D - - -

SECTION 23 25 00 HVAC WATER TREATMENT

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This section specifies cleaning and treatment of circulating HVAC water systems, including the following.
 - 1. Cleaning compounds.
 - 2. Chemical treatment for closed loop heat transfer systems.
 - 3. Chemical treatment for open loop systems.
 - 4. Glycol-water heat transfer systems.

1.2 RELATED WORK

- A. Test requirements and instructions on use of equipment/system: Section 01 00 00, GENERAL REQUIREMENTS.
- B. General mechanical requirements and items, which are common to more than one section of Division 23: Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.
- C. Piping and valves: Section 23 21 13, HYDRONIC PIPING and Section 23 22 13, STEAM and CONDENSATE HEATING PIPING.

1.3 QUALITY ASSURANCE

- A. Refer to paragraph, QUALITY ASSURANCE in Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.
- B. Technical Services: Provide the services of an experienced water treatment chemical engineer or technical representative to direct flushing, cleaning, pre-treatment, training, debugging, and acceptance testing operations; direct and perform chemical limit control during construction period and monitor systems for a period of 12 months after acceptance, including not less than 6 service calls and written status reports. Emergency calls are not included Minimum service during construction/start-up shall be 6 hours.
- D. Log Forms: Provide one year supply of preprinted water treatment test log forms.
- E. Chemicals: Chemicals shall be non-toxic approved by local authorities and meeting applicable EPA requirements.

1.4 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.

- B. Manufacturer's Literature and Data including:
 - 1. Cleaning compounds and recommended procedures for their use.
 - 2. Chemical treatment for closed systems, including installation and operating instructions.
 - 3. Chemical treatment for open loop systems, including installation and operating instructions.
 - 4. Glycol-water system materials, equipment, and installation.
- C. Water analysis verification.
- D. Materials Safety Data Sheet for all proposed chemical compounds, based on U.S. Department of Labor Form No. L5B-005-4.
- E. Maintenance and operating instructions in accordance with Section 01 00 00, GENERAL REQUIREMENTS.

1.5 APPLICABLE PUBLICATIONS

- A. The publication listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. National Fire Protection Association (NFPA):
 - 70-2009National Electric Code (NEC)
- C. American Society for Testing and Materials (ASTM):
 - F441/F441M-02 (2008).....Standard Specification for Chlorinated Poly (Vinyl Chloride) (CPVC) Plastic Pipe, Schedules 40 and 80

PART 2 - PRODUCTS

2.1 CLEANING COMPOUNDS

- A. Alkaline phosphate or non-phosphate detergent/surfactant/specific to remove organic soil, hydrocarbons, flux, pipe mill varnish, pipe compounds, iron oxide, and like deleterious substances, with or without inhibitor, suitable for system wetted metals without deleterious effects.
- B. All chemicals to be acceptable for discharge to sanitary sewer.
- C. Refer to Section 23 21 13, HYDRONIC PIPING and Section 23 22 13, STEAM and CONDENSATE HEATING PIPING, PART 3, for flushing and cleaning procedures.

2.2 CHEMICAL TREATMENT FOR CLOSED LOOP SYSTEMS

- A. Inhibitor: Provide sodium nitrite/borate, molybdate-based inhibitor or other approved compound suitable for make-up quality and make-up rate and which will cause or enhance bacteria/corrosion problems or mechanical seal failure due to excessive total dissolved solids. Shot feed manually. Maintain inhibitor residual as determined by water treatment laboratory, taking into consideration residual and temperature effect on pump mechanical seals.

- B. pH Control: Inhibitor formulation shall include adequate buffer to maintain pH range of 8.0 to 10.5.
- C. Performance: Protect various wetted, coupled, materials of construction including ferrous, and red and yellow metals. Maintain system essentially free of scale, corrosion, and fouling. Corrosion rate of following metals shall not exceed specified mills per year penetration; ferrous, 0-2; brass, 0-1; copper, 0-1. Inhibitor shall be stable at equipment skin surface temperatures and bulk water temperatures of not less than 121 degrees C (250 degrees F) and 52 degrees C (125 degrees Fahrenheit) respectively. Heat exchanger fouling and capacity reduction shall not exceed that allowed by fouling factor 0.0005.
- D. Pot Feeder: By-pass type, complete with necessary shut off valves, drain and air release valves, and system connections, for introducing chemicals into system, cast iron or steel tank with funnel or large opening on top for easy chemical addition. Feeders shall be 18.9 L (five gallon) minimum capacity at 860 kPa (125 psig) minimum working pressure.

2.5 EQUIPMENT AND MATERIALS IDENTIFICATION

Refer to Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Delivery and Storage: Deliver all chemicals in manufacturer's sealed shipping containers. Store in designated space and protect from deleterious exposure and hazardous spills.
- B. Install equipment furnished by the chemical treatment supplier and charge systems according to the manufacturer's instructions and as directed by the Technical Representative.
- C. Refer to Section 23 21 13 HYDRONIC PIPING for chemical treatment piping, installed as follows:
 - 1. Provide a by-pass line around water meters and bleed off piping assembly. Provide ball valves to allow for bypassing, isolation, and servicing of components.
 - 2. Bleed off water piping with bleed off piping assembly shall be piped from pressure side of circulating water piping to a convenient drain. Bleed off connection to main circulating water piping shall be upstream of chemical injection nozzles.
 - 3. Provide piping for the flow assembly piping to the main control panel and accessories.
 - a. The inlet piping shall connect to the discharge side of the circulating water pump.
 - b. The outlet piping shall connect to the water piping serving the cooling tower downstream of the heat source.

- c. Provide inlet Y-strainer and ball valves to isolate and service main control panel and accessories.
- 7. Provide installation supervision, start-up and operating instruction by manufacturer's technical representative.
- D. Before adding cleaning chemical to the closed system, all air handling coils and fan coil units should be isolated by closing the inlet and outlet valves and opening the bypass valves. This is done to prevent dirt and solids from lodging the coils.
- E. Do not valve in or operate system pumps until after system has been cleaned.
- F. After chemical cleaning is satisfactorily completed, open the inlet and outlet valves to each coil and close the by-pass valves. Also, clean all strainers.
- G. Perform tests and report results in accordance with Section 01 00 00, GENERAL REQUIREMENTS.
- H. After cleaning is complete, and water PH is acceptable to manufacturer of water treatment chemical, add manufacturer-recommended amount of chemicals to systems.
- I. Instruct VA personnel in system maintenance and operation in accordance with Section 01 00 00, GENERAL REQUIREMENTS.

- - - E N D - - -

SECTION 23 31 00 HVAC DUCTS AND CASINGS

PART 1 - GENERAL

1.1 DESCRIPTION

- A. Ductwork and accessories for HVAC including the following:
 - 1. Supply air, return air, outside air, exhaust, make-up air, and relief systems.
 - 2. Exhaust duct with HEPA filters for Decon and Negative Pressure Isolation Room .
- B. Definitions:
 - 1. SMACNA Standards as used in this specification means the HVAC Duct Construction Standards, Metal and Flexible.
 - 2. Seal or Sealing: Use of liquid or mastic sealant, with or without compatible tape overlay, or gasketing of flanged joints, to keep air leakage at duct joints, seams and connections to an acceptable minimum.
 - 3. Duct Pressure Classification: SMACNA HVAC Duct Construction Standards, Metal and Flexible.
 - 4. Exposed Duct: Exposed to view in a finished room

1.2 RELATED WORK

- A. Fire Stopping Material: Section 07 84 00, FIRESTOPPING.
- B. Outdoor and Exhaust Louvers: Section 08 90 00, LOUVERS and VENTS.
- F. General Mechanical Requirements: Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.
- G. Noise Level Requirements: Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING and EQUIPMENT.
- H. Duct Insulation: Section 23 07 11, HVAC, PLUMBING, and BOILER PLANT INSULATION
- I. Plumbing Connections: Section 22 11 00, FACILITY WATER DISTRIBUTION
- J. Air Flow Control Valves and Terminal Units: Section 23 36 00, AIR TERMINAL UNITS.
- K. Duct Mounted Coils: Section 23 82 16, AIR COILS.
- L. Supply Air Fans: Section 23 73 00, INDOOR CENTRAL-STATION AIR-HANDLING UNITS.
- M. Return Air and Exhaust Air Fans: Section 23 34 00, HVAC FANS.
- N. Air Filters and Filters' Efficiencies: Section 23 40 00, HVAC AIR CLEANING DEVICES.
- O. Duct Mounted Instrumentation: Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC.

P. Testing and Balancing of Air Flows: Section 23 05 93, TESTING, ADJUSTING, and BALANCING FOR HVAC.

Q. Smoke Detectors: Section 28 31 00, FIRE DETECTION and ALARM.

1.3 QUALITY ASSURANCE

- A. Refer to article, QUALITY ASSURANCE, in Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.
- B. Fire Safety Code: Comply with NFPA 90A.
- C. Duct System Construction and Installation: Referenced SMACNA Standards are the minimum acceptable quality.
- D. Duct Sealing, Air Leakage Criteria, and Air Leakage Tests: Ducts shall be sealed as per duct sealing requirements of SMACNA HVAC Air Duct Leakage Test Manual for duct pressure classes shown on the drawings.
- E. Duct accessories exposed to the air stream, such as dampers of all types (except smoke dampers) and access openings, shall be of the same material as the duct or provide at least the same level of corrosion resistance.

1.4 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Manufacturer's Literature and Data:
 - 1. Rectangular ducts:
 - a. Schedules of duct systems, materials and selected SMACNA construction alternatives for joints, sealing, gage and reinforcement.
 - b. Duct liner.
 - c. Sealants and gaskets.
 - d. Access doors.
 - 2. Round and flat oval duct construction details:
 - a. Manufacturer's details for duct fittings.
 - b. Duct liner.
 - c. Sealants and gaskets.
 - d. Access sections.
 - e. Installation instructions.
 - 3. Volume dampers, back draft dampers.
 - 4. Upper hanger attachments.

5. Fire dampers, fire doors, and smoke dampers with installation instructions.
6. Sound attenuators, including pressure drop and acoustic performance.
7. Flexible ducts and clamps, with manufacturer's installation instructions.
8. Flexible connections.
9. Instrument test fittings.

10. Details and design analysis of alternate or optional duct systems.

11 COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.

C. Coordination Drawings: Refer to article, SUBMITTALS, in Section 23 05 11.

1.5 APPLICABLE PUBLICATIONS

A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.

B. American Society of Civil Engineers (ASCE):

ASCE7-05 Minimum Design Loads for Buildings and Other Structures

C. American Society for Testing and Materials (ASTM):

A167-99(2009)..... Standard Specification for Stainless and Heat-Resisting
Chromium-Nickel Steel Plate, Sheet, and Strip

A653-09 Standard Specification for Steel Sheet, Zinc-Coated
(Galvanized) or Zinc-Iron Alloy coated (Galvannealed) by the
Hot-Dip process

A1011-09a Standard Specification for Steel, Sheet and Strip, Hot rolled,
Carbon, structural, High-Strength Low-Alloy, High Strength
Low-Alloy with Improved Formability, and Ultra-High Strength

B209-07 Standard Specification for Aluminum and Aluminum-Alloy
Sheet and Plate

C1071-05e1 Standard Specification for Fibrous Glass Duct Lining Insulation
(Thermal and Sound Absorbing Material)

E84-09a Standard Test Method for Surface Burning Characteristics of
Building Materials

D. National Fire Protection Association (NFPA):

90A-09 Standard for the Installation of Air Conditioning and Ventilating
Systems

96-09 Standard for Ventilation Control and Fire Protection of
Commercial Cooking Operations

- E. Sheet Metal and Air Conditioning Contractors National Association (SMACNA):
 - 2nd Edition – 2005.....HVAC Duct Construction Standards, Metal and Flexible
 - 1st Edition - 1985.....HVAC Air Duct Leakage Test Manual
 - 6th Edition – 2003Fibrous Glass Duct Construction Standards
- F. Underwriters Laboratories, Inc. (UL):
 - 181-08Factory-Made Air Ducts and Air Connectors
 - 555-06Standard for Fire Dampers
 - 555S-06Standard for Smoke Dampers

PART 2 - PRODUCTS

2.1 DUCT MATERIALS AND SEALANTS

- A. General: Except for systems specified otherwise, construct ducts, casings, and accessories of galvanized sheet steel, ASTM A653, coating G90; or, aluminum sheet, ASTM B209, alloy 1100, 3003 or 5052.
- B. Specified Corrosion Resistant Systems: Stainless steel sheet, ASTM A167, Class 302 or 304, Condition A (annealed) Finish No. 4 for exposed ducts and Finish No. 2B for concealed duct or ducts located in mechanical rooms.
- D. Joint Sealing: Refer to SMACNA HVAC Duct Construction Standards, paragraph S1.9.
 - 1. Sealant: Elastomeric compound, gun or brush grade, maximum 25 flame spread and 50 smoke developed (dry state) compounded specifically for sealing ductwork as recommended by the manufacturer. Generally provide liquid sealant, with or without compatible tape, for low clearance slip joints and heavy, permanently elastic, mastic type where clearances are larger. Oil base caulking and glazing compounds are not acceptable because they do not retain elasticity and bond.
 - 2. Tape: Use only tape specifically designated by the sealant manufacturer and apply only over wet sealant. Pressure sensitive tape shall not be used on bare metal or on dry sealant.
 - 3. Gaskets in Flanged Joints: Soft neoprene.
- E. Approved factory made joints may be used.

2.2 DUCT CONSTRUCTION AND INSTALLATION

- A. Regardless of the pressure classifications outlined in the SMACNA Standards, fabricate and seal the ductwork in accordance with the following pressure classifications:
- B. Duct Pressure Classification:
 - 0 to 50 mm (2 inch)
 - > 50 mm to 75 mm (2 inch to 3 inch)

> 75 mm to 100 mm (3 inch to 4 inch)

C. Seal Class: All ductwork shall receive Class A Seal

L. Duct for Negative Pressure Up to 750 Pa (3 inch W.G.): Provide for exhaust duct between HEPA filters and exhaust fan inlet .

1. Round Duct: 18 ga stainless steel, welded seam construction with standard slip joints.

M. Round and Flat Oval Ducts: Furnish duct and fittings made by the same manufacturer to insure good fit of slip joints. When submitted and approved in advance, round and flat oval duct, with size converted on the basis of equal pressure drop, may be furnished in lieu of rectangular duct design shown on the drawings.

1. Elbows: Diameters 80 through 200 mm (3 through 8 inches) shall be two sections die stamped, all others shall be gored construction, maximum 18 degree angle, with all seams continuously welded or standing seam. Coat galvanized areas of fittings damaged by welding with corrosion resistant aluminum paint or galvanized repair compound.

2. Provide bell mouth, conical tees or taps, laterals, reducers, and other low loss fittings as shown in SMACNA HVAC Duct Construction Standards.

3. Ribbed Duct Option: Lighter gage round/oval duct and fittings may be furnished provided certified tests indicating that the rigidity and performance is equivalent to SMACNA standard gage ducts are submitted.

a. Ducts: Manufacturer's published standard gage, G90 coating, spiral lock seam construction with an intermediate standing rib.

b. Fittings: May be manufacturer's standard as shown in published catalogs, fabricated by spot welding and bonding with neoprene base cement or machine formed seam in lieu of continuous welded seams.

4. Provide flat side reinforcement of oval ducts as recommended by the manufacturer and SMACNA HVAC Duct Construction Standard S3.13. Because of high pressure loss, do not use internal tie-rod reinforcement unless approved by the Resident Engineer.

O. Casings and Plenums: Construct in accordance with SMACNA HVAC Duct Construction Standards Section 6, including curbs, access doors, pipe penetrations, eliminators and drain pans. Access doors shall be hollow metal, insulated, with latches and door pulls, 500 mm (20 inches) wide by 1200 - 1350 mm (48 - 54 inches) high. Provide view port in the doors where shown. Provide drain for outside air louver plenum. Outside air plenum shall have exterior insulation. Drain piping shall be routed to the nearest floor drain.

- P. Volume Dampers: Single blade or opposed blade, multi-louver type as detailed in SMACNA Standards. Refer to SMACNA Detail Figure 2-12 for Single Blade and Figure 2.13 for Multi-blade Volume Dampers.
- Q. Duct Hangers and Supports: Refer to SMACNA Standards Section IV. Avoid use of trapeze hangers for round duct.
- R. Ductwork in excess of 620 cm² (96 square inches) shall be protected unless the duct has one dimension less than 150 mm (6 inches) if it passes through the areas listed below. Refer to the Mission Critical Physical Design Manual for VA Facilities. This applies to the following:
 - 1. Agent cashier spaces
 - 2. Perimeter partitions of caches
 - 3. Perimeter partitions of computer rooms
 - 4. Perimeter of a COOP sites
 - 5. Perimeter partitions of Entrances
 - 6. Security control centers (SCC)
 - 7. Medication and Sterile Storage

2.3 DUCT LINER (WHERE INDICATED ON DRAWINGS)

- A. Duct sizes shown on drawings for lined duct are clear opening inside lining.
- B. Duct liner is only permitted to be used for return, relief and general exhaust ducts. Duct liner is not permitted for outside air ducts, supply air ducts or any other positive pressure ductwork (provide exterior insulation only).
- C. Rectangular Duct or Casing Liner: ASTM C1071, Type I (flexible), or Type II (board), 25 mm (one inch) minimum thickness, applied with mechanical fasteners and 100 percent coverage of adhesive in conformance with SMACNA, Duct Liner Application Standard.

2.4 DUCT ACCESS DOORS, PANELS AND SECTIONS

- A. Provide access doors, sized and located for maintenance work, upstream, in the following locations:
 - 1. Each duct mounted coil and humidifier.
 - 2. Each fire damper (for link service), smoke damper and automatic control damper.
 - 3. Each duct mounted smoke detector.
 - 4. For cleaning operating room supply air duct and kitchen hood exhaust duct, locate access doors at 6 m (20 feet) intervals and at each change in duct direction.

- B. Openings shall be as large as feasible in small ducts, 300 mm by 300 mm (12 inch by 12 inch) minimum where possible. Access sections in insulated ducts shall be double-wall, insulated. Transparent shatterproof covers are preferred for uninsulated ducts.
 - 1. For rectangular ducts: Refer to SMACNA HVAC Duct Construction Standards (Figure 2-12).
 - 2. For round and flat oval duct: Refer to SMACNA HVAC duct Construction Standards (Figure 2-11).

2.5 FIRE DAMPERS

- A. Galvanized steel, interlocking blade type, UL listing and label, 1-1/2 hour rating, 70 degrees C (160 degrees F) fusible line, 100 percent free opening with no part of the blade stack or damper frame in the air stream.
- B. Fire dampers in wet air exhaust shall be of stainless steel construction, all others may be galvanized steel.
- C. Minimum requirements for fire dampers:
 - 1. The damper frame may be of design and length as to function as the mounting sleeve, thus eliminating the need for a separate sleeve, as allowed by UL 555. Otherwise provide sleeves and mounting angles, minimum 1.9 mm (14 gage), required to provide installation equivalent to the damper manufacturer's UL test installation.
 - 2. Submit manufacturer's installation instructions conforming to UL rating test.

2.6 SMOKE DAMPERS

- A. Maximum air velocity, through free area of open damper, and pressure loss: Low pressure and medium pressure duct (supply, return, exhaust, outside air): 450 m/min (1500 fpm). Maximum static pressure loss: 32 Pa (0.13 inch W.G.).
- B. Maximum air leakage, closed damper: 0.32 cubic meters /min/square meter (4.0 CFM per square foot) at 750 Pa (3 inch W.G.) differential pressure.
- C. Minimum requirements for dampers:
 - 1. Shall comply with requirements of Table 6-1 of UL 555S, except for the Fire Endurance and Hose Stream Test.
 - 2. Frame: Galvanized steel channel with side, top and bottom stops or seals.
 - 3. Blades: Galvanized steel, parallel type preferably, 300 mm (12 inch) maximum width, edges sealed with neoprene, rubber or felt, if required to meet minimum leakage. Airfoil (streamlined) type for minimum noise generation and pressure drop are preferred for duct mounted dampers.

4. Shafts: Galvanized steel.
 5. Bearings: Nylon, bronze sleeve or ball type.
 6. Hardware: Zinc plated.
 7. Operation: Automatic open/close. No smoke damper that requires manual reset or link replacement after actuation is acceptable. See drawings for required control operation.
- D. Motor operator (actuator): Provide pneumatic or electric as required by the automatic control system, externally mounted on stand-offs to allow complete insulation coverage.

2.7 COMBINATION FIRE AND SMOKE DAMPERS

- A. Combination fire and smoke dampers: Multi-blade type units meeting all requirements of both fire dampers and smoke dampers shall be used where shown and may be used at the Contractor's option where applicable.

2.8 FIRE DOORS

- A. Galvanized steel, interlocking blade type, UL listing and label, 71 degrees C (160 degrees F) fusible link, 3 hour rating and approved for openings in Class A fire walls with rating up to 4 hours, 100 percent free opening with no part of the blade stack or damper frame in the air stream.

2.9 FLEXIBLE AIR DUCT

- A. General: Factory fabricated, complying with NFPA 90A for connectors not passing through floors of buildings. Flexible ducts shall not penetrate any fire or smoke barrier which is required to have a fire resistance rating of one hour or more. Flexible duct length shall not exceed 1.5 m (5 feet). Provide insulated acoustical air duct connectors in supply air duct systems and elsewhere as shown.
- B. Flexible ducts shall be listed by Underwriters Laboratories, Inc., complying with UL 181. Ducts larger than 200 mm (8 inches) in diameter shall be Class 1. Ducts 200 mm (8 inches) in diameter and smaller may be Class 1 or Class 2.
- C. Insulated Flexible Air Duct: Factory made including mineral fiber insulation with maximum C factor of 0.25 at 24 degrees C (75 degrees F) mean temperature, encased with a low permeability moisture barrier outer jacket, having a puncture resistance of not less than 50 Beach Units. Acoustic insertion loss shall not be less than 3 dB per 300 mm (foot) of straight duct, at 500 Hz, based on 150 mm (6 inch) duct, of 750 m/min (2500 fpm).
- D. Application Criteria:
1. Temperature range: -18 to 93 degrees C (0 to 200 degrees F) internal.
 2. Maximum working velocity: 1200 m/min (4000 feet per minute).

3. Minimum working pressure, inches of water gage: 2500 Pa (10 inches) positive, 500 Pa (2 inches) negative.
- E. Duct Clamps: 100 percent nylon strap, 80 kg (175 pounds) minimum loop tensile strength manufactured for this purpose or stainless steel strap with cadmium plated worm gear tightening device. Apply clamps with sealant and as approved for UL 181, Class 1 installation.

2.10 FLEXIBLE DUCT CONNECTIONS

- A. Where duct connections are made to fans and air handling units, install a non-combustible flexible connection of 822 g (29 ounce) neoprene coated fiberglass fabric approximately 150 mm (6 inches) wide. For connections exposed to sun and weather provide hypalon coating in lieu of neoprene. Burning characteristics shall conform to NFPA 90A. Securely fasten flexible connections to round ducts with stainless steel or zinc-coated iron draw bands with worm gear fastener. For rectangular connections, crimp fabric to sheet metal and fasten sheet metal to ducts by screws 50 mm (2 inches) on center. Fabric shall not be stressed other than by air pressure. Allow at least 25 mm (one inch) slack to insure that no vibration is transmitted.

2.11 SOUND ATTENUATING UNITS

- A. Casing, not less than 1.0 mm (20 gage) galvanized sheet steel, or 1.3 mm (18 gage) aluminum fitted with suitable flanges to make clean airtight connections to ductwork. Sound-absorbent material faced with glass fiber cloth and covered with not less than 0.6 mm (24 gage) or heavier galvanized perforated sheet steel, or 0.85 mm (22 gage) or heavier perforated aluminum. Perforations shall not exceed 4 mm (5/32-inch) diameter, approximately 25 percent free area. Sound absorbent material shall be long glass fiber acoustic blanket meeting requirements of NFPA 90A.
- B. Entire unit shall be completely air tight and free of vibration and buckling at internal static pressures up to 2000 Pa (8 inches W.G.) at operating velocities.
- C. Pressure drop through each unit: Not to exceed indicated value at design air quantities indicated.
- D. Submit complete independent laboratory test data showing pressure drop and acoustical performance.
- E. Cap open ends of attenuators at factory with plastic, heavy duty paper, cardboard, or other appropriate material to prevent entrance of dirt, water, or any other foreign matter to inside of attenuator. Caps shall not be removed until attenuator is installed in duct system.

2.12 PREFABRICATED ROOF CURBS

- A. Galvanized steel or extruded aluminum 300 mm (12 inches) above finish roof service, continuous welded corner seams, treated wood nailer, 40 mm (1-1/2 inch) thick, 48 kg/cubic meter (3

pound/cubic feet) density rigid mineral fiberboard insulation with metal liner, built-in cant strip (except for gypsum or tectum decks). For surface insulated roof deck, provide raised cant strip (recessed mounting flange) to start at the upper surface of the insulation. Curbs shall be constructed for pitched roof or ridge mounting as required to keep top of curb level.

2.13 FIRESTOPPING MATERIAL

- A. Refer to Section 07 84 00, FIRESTOPPING.

2.15 DUCT MOUNTED THERMOMETER (AIR)

- A. Stem Type Thermometers: ASTM E1, 7 inch scale, red appearing mercury, lens front tube, cast aluminum case with enamel finish and clear glass or polycarbonate window, brass stem, 2 percent of scale accuracy to ASTM E77 scale calibrated in degrees Fahrenheit.
- B. Thermometer Supports:
 1. Socket: Brass separable sockets for thermometer stems with or without extensions as required, and with cap and chain.
 2. Flange: 3 inch outside diameter reversible flange, designed to fasten to sheet metal air ducts, with brass perforated stem.

2.16 DUCT MOUNTED TEMPERATURE SENSOR (AIR)

- A. Refer to Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC.

2.17 INSTRUMENT TEST FITTINGS

- A. Manufactured type with a minimum 50 mm (two inch) length for insulated duct, and a minimum 25 mm (one inch) length for duct not insulated. Test hole shall have a flat gasket for rectangular ducts and a concave gasket for round ducts at the base, and a screw cap to prevent air leakage.
- B. Provide instrument test holes at each duct or casing mounted temperature sensor or transmitter, and at entering and leaving side of each heating coil, cooling coil, and heat recovery unit.

2.18 AIR FLOW CONTROL VALVES (AFCV)

- A. Refer to Section 23 36 00 / 23 82 00, AIR TERMINAL UNITS / CONVECTION HEATING and COOLING UNITS.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Comply with provisions of Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION, particularly regarding coordination with other trades and work in existing buildings.
- B. Fabricate and install ductwork and accessories in accordance with referenced SMACNA Standards:

1. Drawings show the general layout of ductwork and accessories but do not show all required fittings and offsets that may be necessary to connect ducts to equipment, boxes, diffusers, grilles, etc., and to coordinate with other trades. Fabricate ductwork based on field measurements. Provide all necessary fittings and offsets at no additional cost to the government. Coordinate with other trades for space available and relative location of HVAC equipment and accessories on ceiling grid. Duct sizes on the drawings are inside dimensions which shall be altered by Contractor to other dimensions with the same air handling characteristics where necessary to avoid interferences and clearance difficulties.
 2. Provide duct transitions, offsets and connections to dampers, coils, and other equipment in accordance with SMACNA Standards, Section II. Provide streamliner, when an obstruction cannot be avoided and must be taken in by a duct. Repair galvanized areas with galvanizing repair compound.
 3. Provide bolted construction and tie-rod reinforcement in accordance with SMACNA Standards.
 4. Construct casings, eliminators, and pipe penetrations in accordance with SMACNA Standards, Chapter 6. Design casing access doors to swing against air pressure so that pressure helps to maintain a tight seal.
- C. Install duct hangers and supports in accordance with SMACNA Standards, Chapter 4.
- D. Install fire dampers, smoke dampers and combination fire/smoke dampers in accordance with the manufacturer's instructions to conform to the installation used for the rating test. Install fire dampers, smoke dampers and combination fire/smoke dampers at locations indicated and where ducts penetrate fire rated and/or smoke rated walls, shafts and where required by the Resident Engineer. Install with required perimeter mounting angles, sleeves, breakaway duct connections, corrosion resistant springs, bearings, bushings and hinges per UL and NFPA. Demonstrate re-setting of fire dampers and operation of smoke dampers to the Resident Engineer.
- E. Seal openings around duct penetrations of floors and fire rated partitions with fire stop material as required by NFPA 90A.
- F. Flexible duct installation: Refer to SMACNA Standards, Chapter 3. Ducts shall be continuous, single pieces not over 1.5 m (5 feet) long (NFPA 90A), as straight and short as feasible, adequately supported. Centerline radius of bends shall be not less than two duct diameters. Make connections with clamps as recommended by SMACNA. Clamp per SMACNA with one clamp on the core duct and one on the insulation jacket. Flexible ducts shall not penetrate floors, or any

chase or partition designated as a fire or smoke barrier, including corridor partitions fire rated one hour or two hour. Support ducts SMACNA Standards.

- G. Where diffusers, registers and grilles cannot be installed to avoid seeing inside the duct, paint the inside of the duct with flat black paint to reduce visibility.
- H. Control Damper Installation:
 - 1. Provide necessary blank-off plates required to install dampers that are smaller than duct size. Provide necessary transitions required to install dampers larger than duct size.
 - 2. Assemble multiple sections dampers with required interconnecting linkage and extend required number of shafts through duct for external mounting of damper motors.
 - 3. Provide necessary sheet metal baffle plates to eliminate stratification and provide air volumes specified. Locate baffles by experimentation, and affix and seal permanently in place, only after stratification problem has been eliminated.
 - 4. Install all damper control/adjustment devices on stand-offs to allow complete coverage of insulation.
- I. Air Flow Measuring Devices (AFMD): Install units with minimum straight run distances, upstream and downstream as recommended by the manufacturer.
- J. Low Pressure Duct Liner: Install in accordance with SMACNA, Duct Liner Application Standard.
- K. Protection and Cleaning: Adequately protect equipment and materials against physical damage. Place equipment in first class operating condition, or return to source of supply for repair or replacement, as determined by Resident Engineer. Protect equipment and ducts during construction against entry of foreign matter to the inside and clean both inside and outside before operation and painting. When new ducts are connected to existing ductwork, clean both new and existing ductwork by mopping and vacuum cleaning inside and outside before operation.

3.2 DUCT LEAKAGE TESTS AND REPAIR

- A. Ductwork leakage testing shall be performed by the Testing and Balancing Contractor directly contracted by the General Contractor and independent of the Sheet Metal Contractor.
- B. Ductwork leakage testing shall be performed for the entire air distribution system (including all supply, return, exhaust and relief ductwork), section by section, including fans, coils and filter sections. Based upon satisfactory initial duct leakage test results, the scope of the testing may be reduced by the Resident Engineer on ductwork constructed to the 500 Pa (2" WG) duct pressure classification. In no case shall the leakage testing of ductwork constructed above the 500 Pa (2"

WG) duct pressure classification or ductwork located in shafts or other inaccessible areas be eliminated.

- C. Test procedure, apparatus and report shall conform to SMACNA Leakage Test manual. The maximum leakage rate allowed is 4 percent of the design air flow rate.
- D. All ductwork shall be leak tested first before enclosed in a shaft or covered in other inaccessible areas.
- E. All tests shall be performed in the presence of the Resident Engineer and the Test and Balance agency. The Test and Balance agency shall measure and record duct leakage and report to the Resident Engineer and identify leakage source with excessive leakage.
- F. If any portion of the duct system tested fails to meet the permissible leakage level, the Contractor shall rectify sealing of ductwork to bring it into compliance and shall retest it until acceptable leakage is demonstrated to the Resident Engineer.
- G. All tests and necessary repairs shall be completed prior to insulation or concealment of ductwork.
- H. Make sure all openings used for testing flow and temperatures by TAB Contractor are sealed properly.

3.4 TESTING, ADJUSTING AND BALANCING (TAB)

- A. Refer to Section 23 05 93, TESTING, ADJUSTING, and BALANCING FOR HVAC.

3.5 OPERATING AND PERFORMANCE TESTS

- A. Refer to Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION

--- E N D ---

SECTION 23 34 00
HVAC FANS

PART 1 - GENERAL

1.1 DESCRIPTION

- A. Fans for heating, ventilating and air conditioning.
- B. Product Definitions: AMCA Publication 99, Standard 1-66.

1.2 RELATED WORK

- A. Section 01 00 00, GENERAL REQUIREMENTS.
- B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- D. Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION.
- E. Section 23 05 12, GENERAL MOTOR REQUIREMENTS FOR HVAC AND STEAM GENERATION EQUIPMENT.
- F. Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT.
- G. Section 23 05 93, TESTING, ADJUSTING, AND BALANCING FOR HVAC.
- H. Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC.
- I. Section 23 73 00, INDOOR CENTRAL-STATION AIR-HANDLING UNITS.
- J. Section 23 82 16, AIR COILS.
- K. Section 26 29 11, LOW-VOLTAGE MOTOR STARTERS.

1.3 QUALITY ASSURANCE

- A. Refer to paragraph, QUALITY ASSURANCE, in Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION.
- B. Fans and power ventilators shall be listed in the current edition of AMCA 26l, and shall bear the AMCA performance seal.
- C. Operating Limits for Centrifugal Fans: AMCA 99 (Class I, II, and III).
- D. Fans and power ventilators shall comply with the following standards:
 - 1. Testing and Rating: AMCA 210.
 - 2. Sound Rating: AMCA 300.
- E. Vibration Tolerance for Fans and Power Ventilators: Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT.
- F. Performance Criteria:

1. The fan schedule shall show the design air volume and static pressure. Select the fan motor HP by increasing the fan BHP by 10 percent to account for the drive losses and field conditions.
2. Select the fan operating point as follows:
 - a. Forward Curve and Axial Flow Fans: Right hand side of peak pressure point
 - b. Air Foil, Backward Inclined, or Tubular: At or near the peak static efficiency
- G. Safety Criteria: Provide manufacturer's standard screen on fan inlet and discharge where exposed to operating and maintenance personnel.
- H. Corrosion Protection:
 1. Except for fans in fume hood exhaust service, all steel shall be mill-galvanized, or phosphatized and coated with minimum two coats, corrosion resistant enamel paint. Manufacturers paint and paint system shall meet the minimum specifications of: ASTM D1735 water fog; ASTM B117 salt spray; ASTM D3359 adhesion; and ASTM G152 and G153 for carbon arc light apparatus for exposure of non-metallic material.

1.4 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Manufacturers Literature and Data:
 1. Fan sections, motors and drives.
 2. Centrifugal fans, motors, drives, accessories and coatings.
 - a. In-line centrifugal fans.
 - b. Tubular Centrifugal Fans.
 - c. Up-blast kitchen hood exhaust fans.
 - d. Industrial fans.
 - e. Utility fans and vent sets.
 3. Prefabricated roof curbs.
 4. Power roof and wall ventilators.
 5. Centrifugal ceiling fans.
 6. Propeller fans.
 7. Packaged hood make-up air units.
 8. Vane axial fans.
 9. Tube-axial fans.
 10. Air curtain units.

- C. Certified Sound power levels for each fan.
- D. Motor ratings types, electrical characteristics and accessories.
- E. Roof curbs.
- F. Belt guards.
- G. Maintenance and Operating manuals in accordance with Section 01 00 00, GENERAL REQUIREMENTS.
- H. Certified fan performance curves for each fan showing cubic feet per minute (CFM) versus static pressure, efficiency, and horsepower for design point of operation.

1.5 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. Air Movement and Control Association International, Inc. (AMCA):
 - 99-86Standards Handbook
 - 210-06Laboratory Methods of Testing Fans for Aerodynamic
Performance Rating
 - 261-09Directory of Products Licensed to bear the AMCA Certified
Ratings Seal - Published Annually
 - 300-08Reverberant Room Method for Sound Testing of Fans
- C. American Society for Testing and Materials (ASTM):
 - B117-07a.....Standard Practice for Operating Salt Spray (Fog) Apparatus
 - D1735-08Standard Practice for Testing Water Resistance of Coatings
Using Water Fog Apparatus
 - D3359-08Standard Test Methods for Measuring Adhesion by Tape Test
 - G152-06Standard Practice for Operating Open Flame Carbon Arc Light
Apparatus for Exposure of Non-Metallic Materials
 - G153-04Standard Practice for Operating Enclosed Carbon Arc Light
Apparatus for Exposure of Non-Metallic Materials
- D. National Fire Protection Association (NFPA):
 - NFPA 96-09Standard for Ventilation Control and Fire Protection of
Commercial Cooking Operations
- E. National Sanitation Foundation (NSF):
 - 37-07Air Curtains for Entrance Ways in Food and Food Service
Establishments

F. Underwriters Laboratories, Inc. (UL):

181-2005Factory Made Air Ducts and Air Connectors

1.6 EXTRA MATERIALS

- A. Provide one additional set of belts for all belt-driven fans.

PART 2 - PRODUCTS

2.1 FAN SECTION (CABINET FAN)

Refer to specification Section 23 73 00, INDOOR CENTRAL-STATION AIR-HANDLING UNITS.

2.2 CENTRIFUGAL FANS

- A. Standards and Performance Criteria: Refer to Paragraph, QUALITY ASSURANCE. Record factory vibration test results on the fan or furnish to the Contractor.
- B. Fan arrangement, unless noted or approved otherwise:
1. DWDI fans: Arrangement 3.
 2. SWSI fans: Arrangement 1, 3, 9 or 10,
- C. Construction: Wheel diameters and outlet areas shall be in accordance with AMCA standards.
1. Housing: Low carbon steel, arc welded throughout, braced and supported by structural channel or angle iron to prevent vibration or pulsation, flanged outlet, inlet fully streamlined. Provide lifting clips, and casing drain. Provide manufacturer's standard access door. Provide 12.5 mm (1/2 inches) wire mesh screens for fan inlets without duct connections.
 2. Wheel: Steel plate with die formed blades welded or riveted in place, factory balanced statically and dynamically.
 3. Shaft: Designed to operate at no more than 70 percent of the first critical speed at the top of the speed range of the fans class.
 4. Bearings: Heavy duty ball or roller type sized to produce a B10 life of not less than 50,000 hours, and an average fatigue life of 200,000 hours. Extend filled lubrication tubes for interior bearings or ducted units to outside of housing.
 5. Belts: Oil resistant, non-sparking and non-static.
 6. Belt Drives: Factory installed with final alignment belt adjustment made after installation.
 7. Motors and Fan Wheel Pulleys: Adjustable pitch for use with motors through 15HP, fixed pitch for use with motors larger than 15HP. Select pulleys so that pitch adjustment is at the middle of the adjustment range at fan design conditions.
 8. Motor, adjustable motor base, drive and guard: Furnish from factory with fan. Refer to Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM

GENERATION for specifications. Provide protective sheet metal enclosure for fans located outdoors.

9. Furnish variable speed fan motor controllers where shown on the drawings. Refer to Section, MOTOR STARTERS. Refer to Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION for controller/motor combination requirements.
- D. In-line Centrifugal Fans: In addition to the requirements of paragraphs A and 2.2.C3 thru 2.2.C9, provide minimum 18 Gauge galvanized steel housing with inlet and outlet flanges, backward inclined aluminum centrifugal fan wheel, bolted access door and supports as required. Motors shall be factory pre-wired to an external junction box. Provide factory wired disconnect switch.
- E. Tubular Centrifugal Fans: In addition to the requirements of paragraphs A and 2.2.C2 thru 2.2.C9 provide;
 1. Housings: Hot rolled steel, one-piece design, incorporating integral guide vanes, motor mounts, bolted access hatch and end flanges. Provide spun inlet bell and screen for unducted inlet and screen for unducted outlet. Provide welded steel, flanged inlet and outlet cones for ducted connection. Provide mounting legs or suspension brackets as required for support. Guide vanes shall straighten the discharge air pattern to provide linear flow.
- G. Utility Fans, Vent Sets and Small Capacity Fans: Class 1 design, arc welded housing, spun intake cone. Applicable construction specification, paragraphs A and C, for centrifugal fans shall apply for wheel diameters 300 mm (12 inches) and larger. Requirement for AMCA seal is waived for wheel diameters less than 300 mm (12 inches) and housings may be cast iron.

2.3 POWER ROOF VENTILATOR

- A. Standards and Performance Criteria: Refer to Paragraph, QUALITY ASSURANCE.
- B. Type: Centrifugal fan, backward inclined blades. Provide down-blast or up-blast type as indicated.
- C. Construction: Steel or aluminum, completely weatherproof, for curb mounting, exhaust cowl or entire drive assembly readily removable for servicing, aluminum bird screen on discharge, UL approved safety disconnect switch, conduit for wiring, vibration isolators for wheel, motor and drive assembly. Provide electric motor operated dampers for all fans..
- D. Motor and Drive: Refer to Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION. Bearings shall be pillow block ball type with a minimum L-50 life of 200,000 hours. Motor shall be located out of air stream.
- E. Prefabricated Roof Curb: As specified in paragraph 2.3 of this section.

- F. Up-blast Type: Top discharge exhaust, motor out of air stream. For kitchen hood exhaust applications, provide grease trough on base and threaded drain.
- G. Provide necked down windband section as noted in schedule.

2.8 UPBLAST MIXED FLOW WITH HIGH PLUME DISCHARGE NOZZLE

- A. Standards and Performance Criteria: Refer to Paragraph, QUALITY ASSURANCE. The requirements for AMCA listing and seal are waived.
- B. Fan shall be direct driven in AMCA arrangement 2. Fans to be equipped with 316 stainless steel lifting lugs for corrosion resistance. Fasteners exposed to corrosive exhaust shall be stainless steel. Curb cap shall be 316 stainless steel for corrosion resistance. Fan assemblies that use flexible connectors that can fail and cause loss of laboratory containment shall not be acceptable. Fan assembly shall be designed for a minimum of 125-mph wind loading, without the use of guy wires.
- C. All fan and system components (fan, nozzle, wind band, plenum) shall be corrosion resistant coated with a two part electrostatically applied and baked, sustainable, corrosion resistant coating system; or Heresite P-413C. Standard finish color to be gray. All parts shall be cleaned and chemically prepared for coating using a multi-stage wash system which includes acid pickling that removes oxide, increases surface area, and improves coating bond to the substrate. The first powder coat applied over the prepared surface shall be a zinc rich epoxy primer (no less than 70% zinc) and heated to a gelatinous consistency (partial cure) at which the second powder coat of polyester resin shall be electrostatically applied and simultaneously be cured at a uniform temperature of 400°F. The coating system shall not be less than a total thickness of 6 mils, is not affected by the UV component of sunlight (does not chalk), and has superior corrosion resistance to acid, alkali, and solvents. Coating system shall exceed 4000 hour ASTM B117 Salt Spray Resistance.
- D. Fan housing to be aerodynamically designed with high-efficiency inlet, engineered to reduce incoming air turbulence. Fan housing shall be bifurcated, allowing all drive components, including the motor, to be serviced without contact of the contaminated airstream. Must be manufactured of welded steel and meet specification section 2.15 for corrosion resistant coating. No uncoated metal fan parts will be acceptable.
- E. A multi-stage air induction discharge nozzle shall be supplied by the fan manufacturer, be integral to the fan body, and be designed to efficiently handle an outlet velocity of up to 7000 FPM. The multi-stage nozzle shall induce ambient air up to 270% of fan capacity. Nozzle / Wind

band assemblies that are manufactured by third party vendors, or that are fabricated of plastic or resins, having mechanical properties less than steel shall not be acceptable.

- F. An integral fan housing drain shall be used to drain rainwater when the fan is de-energized.
- G. A bolted & gasketed access door shall be supplied for impeller inspection and service.
- H. Fan assembly shall be AMCA type C spark resistant construction minimum or as noted on the schedule.
- I. Fan impeller shall be mixed flow design with non-stall characteristics. The impeller shall be electronically balanced both statically and dynamically exceeding AMCA Standards. Fan impeller shall be manufactured of welded and coated steel. Reference specification section 2.15 for corrosion resistant coating. Fan impeller shall include a secondary fan blade located on the impeller back plate. This secondary impeller shall create a negative pressure at the shaft opening; preventing hazardous or toxic exhaust fumes from escaping through the housing shaft opening. Mechanical shaft seals that wear out and need to be replaced or seal systems that use hoses or tubes that can leak, are not acceptable.
- J. A bypass air plenum shall be provided as shown on drawings. The plenum shall be provided with bypass air damper(s) for introducing outside air at roof level upstream of the fan, complete with bypass air rain hood and bird screen. The plenum shall be constructed of welded and coated steel and meet specification section 2.15 for corrosion resistant coating. Plenums that are fabricated of plastics or resins that are combustible and have mechanical properties less than steel shall not be acceptable. The bypass air plenum shall be mounted on factory fabricated roof curb provided by the fan manufacturer, as shown on the project drawings (see section 2.5). Bypass air damper(s) shall be opposed-blade design for airflow control, airfoil design, fabricated of steel for structural rigidity, and coated with a minimum of 4 mils of chemically resistant polyester resin, electrostatically applied and baked. Bypass dampers shall have stainless steel damper rods, bearings and jamb seals and the blades shall have polymer edge seals. Dampers shall be suitable for application up to 15 inches wg. Damper blade drive linkage shall be set by manufacturer and welded to eliminate linkage slippage. All damper access and service (drive actuators) shall be performed outside of the contaminated plenum interior.
- K. An integral bypass air packed acoustic attenuator fabricated of 304 stainless steel shall be provided by the fan manufacturer. Acoustic insertion loss shall be as follows:

63	125	250	500	1K	2K	4K	8K
3	8	12	21	31	24	16	11

- L. Fan isolation damper(s), shall be parallel-blade design, airfoil design, fabricated of steel for structural rigidity, and coated with a minimum of 4 mils of chemically resistant polyester resin, electrostatically applied and baked. Bypass dampers shall have stainless steel damper rods, bearings and jamb seals and the blades shall have polymer edge seals. Dampers shall be suitable for application up to 15 inches wg. Damper blade drive linkage shall be set by manufacturer and welded to eliminate linkage slippage. All damper access and service, (including removal and replacement and drive actuators) shall be performed outside of the contaminated plenum interior.
- M. Blower / Plenum vibration isolation shall be neoprene vibration pads.
- N. Exhaust system manufacturer shall supply a structural support curb for the plenum of specified height as shown on the drawings. Curb shall be fabricated of a minimum of 12 gauge corrosion-resistant coated steel and structurally reinforced. Curbs shall be insulated. The standard curb / plenum / blower assembly shall withstand wind loads of up to 125 mph without additional structural support.
- O. Motors shall be premium efficiency, standard NEMA frame, 900, 1200, or 1800 RPM, TEFC with a 1.15 service factor, as scheduled. A factory-mounted NEMA 3R disconnect switch, mounted and wired, shall be provided for each fan. Motor maintenance shall be accomplished without fan or fan impeller removal, or requiring maintenance personnel to access the contaminated exhaust components. Motor mounting shall be "C-face" and / or foot mount. Drive arrangement shall be AMCA arrangement #2, utilizing a direct mount coupling connecting the motor shaft and fan impeller shaft. Fan shaft shall be 316 stainless steel. Refer to Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION for motor specifications.
- P. P. Fan shaft bearing shall be Air Handling Quality, ball or roller pillow block type, and sized for an L-10 life of no less than 200,000 hours. All shaft bearings and non-permanently lubricated motors shall have extended lube lines with zerk fittings. Motor, coupling, and bearing shall all be outside the contaminated exhaust, and be capable of replacement without disassembling fan and accessing hazardous and contaminated fan components.

2.9 AIR CURTAIN UNITS

- A. Manufacturer's standard, high velocity, non-recirculating type with demonstrated performance in effectively preventing entry of dust and insects and effectively stopping inflow of air due to

winds of 24 km/h (15 mph) velocity. AMCA seal is waived. Units for kitchens or food storage shall comply with NSF 37.

- B. Casing: Sheet metal or polycarbonate plastic. Provide internal or external vibration isolation to effectively prevent transmission of vibration and noise from units to building structure. Units shall completely house all parts and have manufacturer's standard finish coating. Unit shall be totally enclosed and mount above the ceiling, with an integral supply and return and trim to mount finished bottom face of unit at ceiling height.
- C. Fans: Ruggedly constructed, statically and dynamically balanced. Noise level shall not exceed 77 dBA measured at 1.5 m (5 feet) distance.
- D. Air Discharge Outlet Nozzle: Cover full width of door opening. Fan discharge ducts, plenum, flow control vanes and nozzles shall provide a uniform distribution of air over entire length of door. Provide adjustable volume and directional control.
- E. Heating Coil: Provide hot water heating coil. Maximum discharge air temperature shall be 49 degrees C (120 degrees F). Provide return air filter.
- F. Controls: Provide in-ceiling mount microprocessor controller with on/off/auto (auto = operate when door is open with delayed shutdown)/heating (operate when door is closed and space requires heating) modes.
- G. Motors: Fan motors shall be of type suitable for service conditions, sealed ball bearings, resilient mounting and automatic thermal overload switch.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Install fan, motor and drive in accordance with manufacturer's instructions.
- B. Align fan and motor sheaves to allow belts to run true and straight.
- C. Bolt equipment to curbs with galvanized lag bolts.
- D. Install vibration control devices as shown on drawings and specified in Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT.

3.2 PRE-OPERATION MAINTENANCE

- A. Lubricate bearings, pulleys, belts and other moving parts with manufacturer recommended lubricants.
- B. Rotate impeller by hand and check for shifting during shipment and check all bolts, collars, and other parts for tightness.
- C. Clean fan interiors to remove foreign material and construction dirt and dust.

3.3 START-UP AND INSTRUCTIONS

- A. Verify operation of motor, drive system and fan wheel according to the drawings and specifications.
- B. Check vibration and correct as necessary for air balance work.
- C. Air curtain vendor or trained representative shall perform controller programming on-site for installed air curtain units.
- C. After air balancing is complete and permanent sheaves are in place perform necessary field mechanical balancing to meet vibration tolerance in Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT.

--- E N D ---

SECTION 23 36 00 AIR TERMINAL UNITS

PART 1 - GENERAL

1.1 DESCRIPTION

Air terminal units, air flow control valves.

1.2 RELATED WORK

- B. Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION: General mechanical requirements and items, which are common to more than one section of Division 23.
- C. Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT: Noise requirements.
- D. Section 23 31 00, HVAC DUCTS AND CASINGS: Ducts and flexible connectors.
- E. Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC: Valve operators.
- F. Section 23 05 93, TESTING, ADJUSTING, AND BALANCING FOR HVAC: Flow rates adjusting and balancing.
- G. Section 23 82 16, AIR COILS: Heating and Cooling Coils pressure ratings.

1.3 QUALITY ASSURANCE

Refer to Paragraph, QUALITY ASSURANCE, in Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION.

1.4 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Manufacturer's Literature and Data:
 - 1. Air Terminal Units: Submit test data.
- C. Certificates: Air flow control valves.
 - 1. Compliance with paragraph, QUALITY ASSURANCE.
 - 2. Compliance with specified standards.
- D. Operation and Maintenance Manuals: Submit in accordance with paragraph, INSTRUCTIONS, in Section 01 00 00, GENERAL REQUIREMENTS.

1.5 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.

- B. Air Conditioning and Refrigeration Institute (AHRI)/(ARI):
880-08Air Terminals Addendum to ARI 888-98 incorporated into
standard posted 15th December 2002
- C. National Fire Protection Association (NFPA):
90A-09Standard for the Installation of Air Conditioning and Ventilating
Systems
- D. Underwriters Laboratories, Inc. (UL):
181-08Standard for Factory-Made Air Ducts and Air Connectors
- E. American Society for Testing and Materials (ASTM):
C 665-06Standard Specification for Mineral-Fiber Blanket Thermal
Insulation for Light Frame Construction and Manufactured
Housing

1.6 GUARANTY

In accordance with the GENERAL CONDITIONS

PART 2 - PRODUCTS

2.1 GENERAL

A. Coils:

1. All Air-Handling Units: Provide aluminum fins and copper coils for all hot water reheat coils.
2. Water Heating Coils:
 - a. ARI certified, continuous plate or spiral fin type, leak tested at 2070 kPa (300 PSI).
 - b. Capacity: As indicated, based on scheduled entering water temperature.
 - c. Headers: Copper or Brass.
 - d. Fins: Aluminum, maximum 315 fins per meter (8 fins per inch).
 - e. Tubes: Copper, arrange for counter-flow of heating water.
 - f. Water Flow Rate: Minimum 0.032 Liters/second (0.5 GPM).
 - g. Provide vent and drain connection at high and low point, respectively of each coil.
 - h. Coils shall be guaranteed to drain.

- B. Labeling: Control box shall be clearly marked with an identification label that lists such information as nominal CFM, maximum and minimum factory-set airflow limits, coil type and coil connection orientation, where applicable.

- C. Factory calibrate air terminal units to air flow rate indicated. All settings including maximum and minimum air flow shall be field adjustable.
- D. Dampers with internal air volume control: See section 23 31 00 HVAC DUCTS and CASINGS.
- E. Terminal Sound Attenuators: See Section 23 31 00 (HVAC DUCTS AND CASINGS).

2.2 AIR TERMINAL UNITS (BOXES)

- A. General: Factory built, pressure independent units, factory set-field adjustable air flow rate, suitable for single duct applications. Use of dual-duct air terminal units is not permitted. Clearly show on each unit the unit number and factory set air volumes corresponding to the contract drawings. Section 23 05 93, TESTING, ADJUSTING, AND BALANCING FOR HVAC work assumes factory set air volumes. Coordinate flow controller sequence and damper operation details with the drawings and Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC. All air terminal units shall be brand new products of the same manufacturer.
- B. Capacity and Performance: The Maximum Capacity of a single terminal unit shall not exceed 566 Liters/second (1,200 CFM) with the exception of operating rooms and Cystoscopy rooms, which shall be served by a single air terminal unit at a maximum of 1,250 Liters/second (3,000 CFM).
- C. Sound Power Levels: Acoustic performance of the air terminal units shall be based on the design noise levels for the spaces stipulated in Section 23 05 41 (Noise and Vibration Control for HVAC Piping and Equipment). Terminal sound attenuators shall be provided, as required, to meet the intent of the design.
- D. Casing: Unit casing shall be constructed of galvanized steel no lighter than 0.85 mm (22 Gauge). Air terminal units serving the operating rooms and Cystoscopy rooms shall be fabricated without lining. Provide hanger brackets for attachment of supports.
 - 1. Lining material: Suitable to provide required acoustic performance, thermal insulation and prevent sweating. Meet the requirements of NFPA 90A and comply with UL 181 for erosion as well as ASTM C 665 antimicrobial requirements. Insulation shall consist of 13 mm (1/2 IN) thick non-porous foil faced rigid fiberglass insulation of 4-lb/cu.ft, secured by full length galvanized steel z-strips which enclose and seal all edges. Tape and adhesives shall not be used. Materials shall be non-friable and with surfaces, including all edges, fully encapsulated and faced with perforated metal or coated so that the air stream will not detach material. No lining material is permitted in the boxes serving operating rooms and Cystoscopy rooms.
 - 2. Access panels (or doors): Provide panels large enough for inspection, adjustment and maintenance without disconnecting ducts, and for cleaning heating coils attached to unit, even if there are no moving parts. Panels shall be insulated to same standards as the rest of

- the casing and shall be secured and gasketed airtight. It shall require no tool other than a screwdriver to remove.
3. Total leakage from casing: Not to exceed 2 percent of the nominal capacity of the unit when subjected to a static pressure of 750 Pa (3 inch WG), with all outlets sealed shut and inlets fully open.
 4. Octopus connector: Factory installed, lined air distribution terminal. Provide where flexible duct connections are shown on the drawings connected directly to terminals. Provide butterfly-balancing damper, with locking means in connectors with more than one outlet. Octopus connectors and flexible connectors are not permitted in the Surgical Suite.
- E. Construct dampers and other internal devices of corrosion resisting materials which do not require lubrication or other periodic maintenance.
1. Damper Leakage: Not greater than 2 percent of maximum rated capacity, when closed against inlet static pressure of 1 kPa (4 inch WG).
- F. Provide multi-point velocity pressure sensors with external pressure taps.
1. Provide direct reading air flow rate table pasted to box.
- G. Provide static pressure tubes.
- H. Externally powered DDC variable air volume controller and damper actuator to be furnished under Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC for factory mounting on air terminal units. The DDC controller shall be electrically actuated.

2.3 AIR FLOW CONTROL VALVE (AFCV) FOR DECON AND CART 3

- A. Airflow control device shall be a venturi valve type air flow control valve.
- B. Pressure independent over a 150 Pa-750 Pa (0.6 inch WG – 3.0 inch WG) drop across valve.
- C. Volume control accurate to plus or minus 5% of airflow over an airflow turndown range of 16 to
 1. No minimum entrance or exit duct diameters shall be required to ensure accuracy or pressure independence.
- D. Response time to change in command signal and duct static pressure within three seconds.
- E. 16 gauge spun aluminum valve body and control device with continuous welded seam and 316 stainless steel shaft and shaft support brackets. Pressure independent springs shall be stainless steel. Shaft bearing surfaces shall be Teflon or polyester.
- H. Constant volume units:
 1. Actuator to be factory mounted to the valve.

2. Closed loop control of airflow by way of flow feedback signal with less than 1 second response time.
3. Shaft positioned using direct potentiometer measurement to produce a linear factory calibrated feedback.
4. The maximum and minimum airflows shall be as scheduled.

J. Certification:

1. Control device: factory calibrated to airflows detailed on plans using NIST traceable air stations and instrumentation having a combined accuracy of plus or minus 1% of signal over the entire range of measurement.
2. Electronic airflow control devices: further calibrated and their accuracy verified to plus or minus 5% of signal at a minimum of eight different airflows across the full operating range of the device.
3. All airflow control devices: individually marked with device specific, factory calibration data to include: tag number, serial number, model number, eight point characterization information (for electronic devices), and quality control inspection numbers.

K. Airflow measuring devices and airflow control devices that are not venturi valves (e.g., Pitot tube, flow cross, air bar, orifice ring, vortex shedder, etc.) are acceptable, provided the following conditions are met:

1. They meet the performance and construction characteristics stated throughout this section of the specification.
2. Suppliers of airflow control devices or airflow measuring devices requiring minimum duct diameters: provide revised duct layouts showing the required straight duct runs upstream and downstream of these devices.
3. Supplier of the airflow control system: submit coordination drawings reflecting these changes and include static pressure loss calculations as part of submittal.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Work shall be installed as shown and according to the manufacturer's diagrams and recommendations.
- B. Handle and install units in accordance with manufacturer's written instructions.
- C. Support units rigidly so they remain stationary at all times. Cross-bracing or other means of stiffening shall be provided as necessary. Method of support shall be such that distortion and malfunction of units cannot occur.

- D. Locate air terminal units to provide a straight section of inlet duct for proper functioning of volume controls. See VA Standard Detail.

3.2 OPERATIONAL TEST

Refer to Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION.

--- E N D ---

SECTION 23 37 00 AIR OUTLETS AND INLETS

PART 1 - GENERAL

1.1 DESCRIPTION

- A. Roof Curbs
- B. Air Outlets and Inlets: Diffusers, Registers, and Grilles.

1.2 RELATED WORK

- A. Outdoor and Exhaust Louvers: Section 08 90 00, LOUVERS AND VENTS.
- B. General Mechanical Requirements: Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION.
- C. Noise Level Requirements: Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT.
- D. Testing and Balancing of Air Flows: Section 23 05 93, TESTING, ADJUSTING, AND BALANCING FOR HVAC.

1.3 QUALITY ASSURANCE

- A. Refer to article, QUALITY ASSURANCE, in Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION.
- B. Fire Safety Code: Comply with NFPA 90A.

1.4 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Manufacturer's Literature and Data:
 - 1. Air intake/exhaust hoods.
 - 2. Diffusers, registers, grilles and accessories.
- C. Coordination Drawings: Refer to article, SUBMITTALS, in Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION.

1.5 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. Air Diffusion Council Test Code:
 - 1062 GRD-84.....Certification, Rating, and Test Manual 4th Edition
- C. American Society of Civil Engineers (ASCE):
 - ASCE7-05Minimum Design Loads for Buildings and Other Structures

D. American Society for Testing and Materials (ASTM):

A167-99 (2004).....Standard Specification for Stainless and Heat-Resisting
Chromium-Nickel Steel Plate, Sheet and Strip

B209-07Standard Specification for Aluminum and Aluminum-Alloy
Sheet and Plate

E. National Fire Protection Association (NFPA):

90A-09Standard for the Installation of Air Conditioning and Ventilating
Systems

F. Underwriters Laboratories, Inc. (UL):

181-08UL Standard for Safety Factory-Made Air Ducts and Connectors

PART 2 - PRODUCTS

2.1 GRAVITY INTAKE/EXHAUST VENTILATORS (ROOF MOUNTED)

- A. Aluminum, ASTM B209, louvered, spun, or fabricated using panel sections with roll-formed edges, 13 mm (1/2 inch) mesh aluminum welded wire bird screen, with gravity or motorized dampers where shown, accessible interior, designed for wind velocity specified in Paragraph 3.3.
1. Spun Intake/Exhaust Ventilators: Spun aluminum structural components shall be constructed of minimum 1.3 mm (16 Gauge) marine alloy aluminum, bolted to a rigid aluminum support structure. The aluminum base shall have continuously welded curb cap corners for maximum leak protection. The spun aluminum baffle shall have a rolled bead for added strength.
 2. Louvered Intake/Exhaust Hoods: Louvered hood constructed from 0.081 Gauge extruded aluminum tiers welded to a minimum 3.3 mm (8 Gauge) aluminum support structure. The aluminum hood shall be constructed of a minimum 0.064 marine alloy aluminum and provided with a layer of anti-condensate coating. The aluminum base shall have continuously welded curb cap corners for maximum leak protection.
 3. Low Silhouette Intake/Exhaust Ventilator: The unit shall be of bolted and welded construction utilizing corrosion resistant fasteners. The aluminum hood shall be constructed of minimum 1.60 mm (14 Gauge) marine alloy aluminum, bolted to a minimum 3.25 mm (8 Gauge) aluminum support structure. The aluminum base shall have continuously welded curb cap corners for maximum leak protection. Birdscreen constructed of 13 mm (1/2 inch) mesh shall be mounted across the relief opening.
- B. See ventilator schedule on the drawings. Sizes shown on the drawings designate throat size. Area of ventilator perimeter opening shall be not less than the throat area.

- C. Dampers for Gravity Ventilators without Duct Connection: Construct damper of the same material as the ventilator and of the design to completely close opening or remain wide open. Hold damper in closed position by a brass chain and catch. Extend chains 300 mm (12 inches) below and engage catch when damper is closed.
- E. Provide Roof Curb by unit manufacturer. Refer to Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION for additional requirements.

2.2 EQUIPMENT SUPPORTS

Refer to Section 21 05 11, COMMON WORK RESULTS FOR FIRE SUPPRESSION, Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING, and Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION.

2.3 AIR OUTLETS AND INLETS

- A. Materials:
 - 1. Steel or aluminum as scheduled. Provide manufacturer's standard gasket.
 - 2. Exposed Fastenings: The same material as the respective inlet or outlet. Fasteners for aluminum may be stainless steel.
 - 3. Contractor shall review all ceiling drawings and details and provide all ceiling mounted devices with appropriate dimensions and trim for the specific locations.
- B. Performance Test Data: In accordance with Air Diffusion Council Code 1062GRD. Refer to Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT for NC criteria.
- C. Air Supply Outlets:
 - 1. Ceiling Diffusers: Suitable for surface mounting, exposed T-bar or special tile ceilings, off-white finish, square or round neck connection as shown on the drawings. Provide plaster frame for units in plaster ceilings.
 - a. Square, louver, fully adjustable pattern: Round neck, surface mounting unless shown otherwise on the drawings. Provide equalizing or control grid and volume control damper.
 - b. Louver face type: Square or rectangular, removable core for 1, 2, 3, or 4 way directional pattern. Provide equalizing or control grid and opposed blade damper.
 - c. Perforated face type: Manual adjustment for one-, two-, three-, or four-way horizontal air distribution pattern without change of air volume or pressure. Provide equalizing or control grid and opposed blade over overlapping blade damper. Perforated face diffusers for VAV systems shall have the pattern controller on the inner face, rather than in the

neck and designed to discharge air horizontally at the ceiling maintaining a Coanda effect.

d. Slot diffuser/plenum:

- 1) Diffuser: Frame and support bars shall be constructed of heavy gauge extruded aluminum. Form slots or use adjustable pattern controllers, to provide stable, horizontal air flow pattern over a wide range of operating conditions.
- 2) Galvanized steel boot lined with 13 mm (1/2 inch) thick fiberglass conforming to NFPA 90A and complying with UL 181 for erosion. The internal lining shall be factory-fabricated, anti-microbial, and non-friable.
- 3) Provide inlet connection diameter equal to duct diameter shown on drawings or provide transition coupling if necessary. Inlet duct and plenum size shall be as recommended by the manufacturer.
- 4) Maximum pressure drop at design flow rate: 37 Pa (0.15 inch W.G.)

2. Linear Bar Grilles and Diffusers: Extruded aluminum, manufacturer's standard finish, and positive holding concealed fasteners.

- a. Margin Frame: Flat, 20 mm (3/4 inch) wide.
- b. Bars: Minimum 5 mm (3/16 inch) wide by 20 mm (3/4 inch) deep, zero deflection unless otherwise shown. Bar spacing shall be a minimum of 3 mm (1/8 inch) on center. Reinforce bars on 450 mm (18 inch) center for sidewall units and on 150 mm (6 inch) center for units installed in floor or sills.
- c. Provide opposed blade damper and equalizing or control grid where shown.

4. Supply Grille: Double deflection type with horizontal face bars and opposed blade damper with removable key operator.

- a. Margin: Flat, 30 mm (1-1/4 inches) wide.
- b. Bar spacing: 20 mm (3/4 inch) maximum.
- c. Finish: Off white baked enamel for ceiling mounted units. Wall units shall have a prime coat for field painting, or shall be extruded with manufacturer's standard finish.

D. Return and Exhaust Registers and Grilles: Provide opposed blade damper without removable key operator for registers.

1. Finish: Off-white baked enamel for ceiling mounted units. Wall units shall have a prime coat for field painting, or shall be extruded aluminum with manufacturer's standard aluminum finish.

2. Standard Type: Fixed horizontal face bars set at 30 to 45 degrees, approximately 30 mm (1-1/4 inch) margin.
3. Perforated Face Type: To match supply units.
4. Grid Core Type: 13 mm by 13 mm (1/2 inch by 1/2 inch) core with 30 mm (1-1/4 inch) margin.
5. Linear Type: To match supply units.
6. Door Grilles: Are furnished with the doors.
7. Egg Crate Grilles: Aluminum or Painted Steel 1/2 by 1/2 by 1/2 inch grid providing 90% free area.
 - a. Heavy extruded aluminum frame shall have countersunk screw mounting. Unless otherwise indicated, register blades and frame shall have factory applied white finish.
 - b. Grille shall be suitable for duct or surface mounting as indicated on drawings. All necessary appurtenances shall be provided to allow for mounting.

2.4 WIRE MESH GRILLE

- A. Fabricate grille with 2 x 2 mesh 13 mm (1/2 inch) galvanized steel or aluminum hardware cloth in a spot welded galvanized steel frame with approximately 40 mm (1-1/2 inch) margin.
- B. Use grilles where shown in unfinished areas such as mechanical rooms.

2.5 FILTER RETURN/EXHAUST GRILLE

- A. See 23 40 00.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Comply with provisions of Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION, particularly regarding coordination with other trades and work in existing buildings.
- B. Protection and Cleaning: Protect equipment and materials against physical damage. Place equipment in first class operating condition, or return to source of supply for repair or replacement, as determined by Resident Engineer. Protect equipment during construction against entry of foreign matter to the inside and clean both inside and outside before operation and painting.

3.3 TESTING, ADJUSTING AND BALANCING (TAB)

Refer to Section 23 05 93, TESTING, ADJUSTING, AND BALANCING FOR HVAC.

3.4 OPERATING AND PERFORMANCE TESTS

Refer to Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM
GENERATION

--- E N D ---

SECTION 23 40 00 HVAC AIR CLEANING DEVICES

PART 1 - GENERAL

1.1 DESCRIPTION

- A. Air filters for heating, ventilating and air conditioning.
- B. Definitions: Refer to ASHRAE Standard 52.1 for definitions of face velocity, net effective filtering area, media velocity, resistance pressure drop), atmospheric dust spot efficiency and dust-holding capacity. ASHRAE Standard 52.1 measures arrestance, dust spot efficiency and dust holding capacity of filters.
- C. Refer to ASHRAE Standard 52.2 for definitions of MERV (Minimum Efficiency Reporting Value), PSE (Particle Size Efficiency) and particle size ranges for each MERV number. ASHRAE Standard 52.2 measures particle size efficiency (PSE).

1.2 RELATED WORK

- A. General mechanical requirements and items, which are common to more than one section of Division 23: Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION.
- B. Filter housing and racks: Section 23 73 00, INDOOR CENTRAL-STATION AIR-HANDLING UNITS.

1.3 QUALITY ASSURANCE

- A. Air Filter Performance Report for Extended Surface Filters:
 - 1. Submit a test report for each Grade of filter being offered. The report shall not be more than three (3) years old and prepared by using test equipment, method and duct section as specified by ASHRAE Standards 52.1 and 52.2 for type filter under test and acceptable to Resident Engineer, indicating that filters comply with the requirements of this specification. Test for 150 m/min (500 fpm) will be accepted for lower velocity rated filters provided the test report of an independent testing laboratory complies with all the requirements of this specification.
 - 2. Government Option: The Government at its option may take one of the filters for each different type submitted and run an independent test to determine if the filter meets the requirements of this specification. When the filter meets the requirements, the Government will pay for the test. When the filter does not meet the specification requirements, the

manufacturer will be required to pay for the test and replace the filters with filters that will perform as required by the specifications.//

3. **Guarantee Performance:** The manufacturer shall supply ASHRAE 52.2 test reports on each filter type submitted. Any filter supplied will be required to maintain the minimum efficiency shown on the ASHRAE Standard 52.2 report throughout the time the filter is in service. Within the first 6-12 weeks of service a filter may be pulled out of service and sent to an independent laboratory for ASHRAE Standard 52.2 testing for initial efficiency only. If this filter fails to meet the minimum level of efficiency shown in the previously submitted reports, the filter manufacturer/distributor shall take back all filters and refund the owner all monies paid for the filters, cost of installation, cost of freight and cost of testing.
- B. **Filter Warranty for Extended Surface Filters:** Guarantee the filters against leakage, blow-outs, and other deficiencies during their normal useful life, up to the time that the filter reaches the final pressure drop. Defective filters shall be replaced at no cost to the Government.
- C. **Comply with UL Standard 586 for flame test.**
- D. **Nameplates:** Each filter shall bear a label or name plate indicating manufacturer's name, filter size, rated efficiency,/ UL classification.

1.4 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. **Manufacturer's Literature and Data:**
 1. Extended surface filters.
 2. Holding frames. Identify locations.
 3. Side access housings. Identify locations, verify insulated doors.
 4. HEPA filters.
 5. Magnehelic gages.
- C. Air Filter performance reports.
- D. Suppliers warranty.
- E. Field test results for HEPA filters as per paragraph 2.3.E.3.

1.5 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by basic designation only.

- B. American Society of Heating, Refrigerating and Air-conditioning Engineers, Inc. (ASHRAE):
 52.1-92RGravimetric and Dust-Spot procedures for Testing Air Cleaning
 Devices Used in General Ventilation for Removing Particulate
 Matter
 52.2-2007.....Method of Testing General Ventilation Air-Cleaning Devices for Removal
 Efficiency by Particle Size
- C. American Society of Mechanical Engineers (ASME):
 NQA-1-2008Quality Assurance Requirements for Nuclear Facilities
 Applications
- D. Underwriters Laboratories, Inc. (UL):
 586;Amendment 20 March 2000 High-Efficiency, Particulate, Air Filter Units
 900;Revision 15 July 2009Test Performance of Air Filter Units

PART 2 - PRODUCTS

2.1 REPLACEMENT FILTER ELEMENTS TO BE FURNISHED

- A. To allow temporary use of HVAC systems for testing and in accordance with Paragraph,
 TEMPORARY USE OF MECHANICAL AND ELECTRICAL SYSTEMS in Section 01 00 00,
 GENERAL REQUIREMENTS, provide one complete set of spare filters to the Resident
 Engineer.
- B. The Resident Engineer will direct whether these additional filters will either be installed as
 replacements for dirty units or turned over to VA for future use as replacements.

2.2 EXTENDED SURFACE AIR FILTERS

- A. Use factory assembled air filters of the extended surface type with supported or non-supported
 cartridges for removal of particulate matter in air conditioning, heating and ventilating systems.
 Filter units shall be of the extended surface type fabricated for disposal when the dust-load limit
 is reached as indicated by maximum (final) pressure drop.
- B. Filter Classification: UL approved Class 1 or Class 2 conforming to UL Standard 900.
- C. Filter Grades, Percent, Average ASHRAE Efficiency and Controlled Containment:

Table 2.2C

Filter Grades				
MERV Value ASHRAE 52.2	Application	Dust-Spot Efficiency ASHRAE 52.1	Particle Size	Thickness /Type

7	Pre-Filter	25 to 30%	3 to 10 Microns	50 mm (2-inch) Throwaway
8	Pre-Filter	30 to 35%	3 to 10 Microns	50 mm (2-inch) Throwaway
11	After-Filter	60 to 65%	1 to 3 Microns	150 mm (6-inch) Rigid Cartridge
13	After-Filter	80 to 90%	0.3 to 1 Micron	300 mm (12-inch) Rigid Cartridge
14	After-Filter	90 to 95%	0.3 to 1 Micron	300 mm (12-inch) Rigid Cartridge
17	Final-Filter	99.97%	0.3 Microns	HEPA – IEST A

D. Filter Media:

1. MERV 11, 13, and 14 Supported (Rigid Pleated) Type: Media shall be composed of high density glass fibers or other suitable fibers. Fastening methods used to maintain pleat shape, (metal backing or aluminum separators) shall be sealed in a proper enclosing frame to insure no air leakage for life of filter. Staples and stays are prohibited.
2. MERV 7 and 8 (Pleated) Type: Media shall be composed of synthetic/natural fibers. Media shall maintain uniform pleat shape and stability for proper air flow and maximum dust loading. The media frame shall be constructed of aluminized steel. Bond the pleated media pack on all four edges to insure no air leakage for the life of the filter. Staples and stays are prohibited.

E. Filter Efficiency and Arrestance: Efficiency and arrestance of filters shall be determined in accordance with ASHRAE Standard 52.1, and MERV value in accordance with ASHRAE Standard 52.2.

- F. Maximum initial resistance, recommended change over pressure drop, and maximum recommended final resistance, PA (inches of water), for each filter cartridge when operated at 150 m/min (500 feet per minute) face velocity shall be as specified in Table 2.2.F:

Table 2.2.F

Filter Initial and Final Resistance			
	Initial Resistance	Maximum Recommended Change Over Pressure Drop	Maximum Final Resistance
MERV 7 (2-inch deep)	78 (0.31)	156 (0.62)	250 (1.00)
MERV 8 (2-inch deep)	95 (0.38)	190 (0.76)	250 (1.00)
MERV 11 (12-inch deep)	60 (0.24)	120 (0.48)	375 (1.50)
MERV 13 (12-inch deep)	125 (0.50)	250 (1.00)	375 (1.50)
MERV 14 (12-inch deep)	170 (0.68)	340 (1.36)	375 (1.50)

G. Side Servicing Housings:

1. Minimum 1.6 mm (16 Gauge) galvanized steel, or aluminum, completely factory assembled with upstream and downstream flanges for connection into the duct system. Furnish housing length sufficient to provide for fully extended operating filter elements.
2. Access doors: Double wall insulated, located on one side of the housing; with continuous gasketing on the perimeter and positive locking devices. Design doors to withstand a minimum positive/negative 1.0 kPa (4 inch WG) static pressure. Furnish access doors that are the full size of the housing.
3. Filter slide channels: Channels shall incorporate a positive-sealing gasket material to seal the top and bottom of the filter cartridge frames to prevent bypass. Provide factory installed gasketing to prevent leakage between cartridges, and between cartridges and doors.

I. Equipment Identification: Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION.

2.3 HEPA FILTERS (MERV 17)

- A. High Efficiency Particulate Air (HEPA) filters shall be individually tested and certified to be 99.97 percent minimum efficient meeting minimum MERV value of 17 when handling 0.3 micron or smaller particles in accordance with DOP test method. Filters shall be factory scanned.

The DOP efficiency along with filter serial number and name of manufacturer shall be marked on the filter. HEPA filter shall have a maximum initial filter resistance of 250 Pa (1 inch W.G.) and a maximum recommended final resistance of 500 Pa (2 inch WG) with operate when operating at 125 m/s (250 ft/min) face velocity. The Maximum recommended change over pressure drop shall be no greater than twice the actual initial pressure drop.

- B. Filter media: Factory constructed by pleating a continuous sheet of media into closely spaced pleats with kraft or aluminum separators. Sealer shall be self-extinguishing.

- C. Roof Mounted Enclosure:

Enclosing HEPA frame shall be weatherproof 14 gauge galvanized steel. Provide side access door.

- E. Decon and Cart 3 Housing for ceiling mounted HEPA Filters:

1. Housing shall be fabricated of type 304 stainless steel.
2. Housing shall be equipped with factory installed static pressure ports.
3. Housing shall be pressure tested in factory for high quality to withstand a positive or negative pressure of 10 inch WG.
4. Housing shall incorporate a spring loaded clamping mechanism that is operated from outside and which is capable of exerting a 5340 N. (1,200 lb) sealing force across the top and bottom of each filter.
5. Provide minimum 40% open stainless steel grille. Provide guillotine damper operatble from room. Provide trim plate for drywall installation.

2.5 INSTRUMENTATION

- A. Magnehelic Differential Pressure Filter Gages: Nominal 100 mm (four inch) diameter, zero to 500 Pa (zero to two inch water gage), three inch for HEPA) range, except for MERV 17 HEPA Final Filters, where the range shall be zero to 750 Pa (zero to three inch water gage. Gauges shall be flush-mounted in aluminum panel board, complete with static tips, copper or aluminum tubing, and accessory items to provide zero adjustment.
- B. DDC static (differential) air pressure measuring station. Refer to Specification Section 23 09 23 DIRECT DIGITAL CONTROL SYSTEM FOR HVAC
- C. Provide one DDC sensor across each extended surface filter. Provide Petcocks for each gauge or sensor.
- D. Provide one common filter gauge for two-stage filter banks with isolation valves to allow differential pressure measurement.

2.6 HVAC EQUIPMENT FACTORY FILTERS

- A. Manufacturer standard filters within fabricated packaged equipment should be specified with the equipment and should adhere to industry standard.
- B. Cleanable filters are not permitted.
- C. Automatic Roll Type filters are not permitted.

2.7 FILTER RETURN GRILLES

- A. Refer to Section 23 37 00 AIR OUTLETS AND INLETS.

PART 3 – EXECUTION**3.1 INSTALLATION**

- A. Install supports, filters and gages in accordance with manufacturer's instructions.
- B. Label clearly with words "Contaminated Air" on exhaust ducts leading to the HEPA filter housing.

3.2 START-UP AND TEMPORARY USE

- A. Clean and vacuum air handling units and plenums prior to starting air handling systems.
- B. Install or deliver replacement filter units as directed by the Resident Engineer.

- - E N D - - -

SECTION 23 73 00
INDOOR CENTRAL-STATION AIR-HANDLING UNITS

PART 1 - GENERAL

1.1 DESCRIPTION

- A. Air handling units including integral components specified herein.
- B. Definitions: Air Handling Unit (AHU): A factory fabricated and tested assembly of modular sections consisting of housed-centrifugal fan with V-belt drive, coils, filters, and other necessary equipment to perform one or more of the following functions of circulating, cleaning, heating, cooling, humidifying, dehumidifying, and mixing of air. Design capacities of units shall be as scheduled on the drawings.

1.2 RELATED WORK

- B. General mechanical requirements and items, which are common to more than one section of Division 23: Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION.
- C. Sound and vibration requirements: Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT.
- D. Piping and duct insulation: Section 23 07 11, HVAC, PLUMBING, AND BOILER PLANT INSULATION.
- E. Piping and valves: Section 23 21 13 / 23 22 13, HYDRONIC PIPING / STEAM AND CONDENSATE HEATING PIPING.
- F. Heating and cooling coils and pressure requirements: Section 23 82 16, AIR COILS.
- G. Return and exhaust fans: Section 23 34 00, HVAC FANS.
- H. Requirements for flexible duct connectors, sound attenuators and sound absorbing duct lining, and air leakage: Section 23 31 00, HVAC DUCTS and CASINGS.
- I. Air filters and filters' efficiency: Section 23 40 00, HVAC AIR CLEANING DEVICES.
- J. HVAC controls: Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC.
- K. Testing, adjusting and balancing of air and water flows: Section 23 05 93, TESTING, ADJUSTING, AND BALANCING FOR HVAC.
- L. Types of motors: Section 23 05 12, GENERAL MOTOR REQUIREMENTS FOR HVAC AND STEAM GENERATION EQUIPMENT.
- M. Types of motor starters: Section 26 29 11, LOW-VOLTAGE MOTOR STARTERS.

1.3 QUALITY ASSURANCE

- A. Refer to Article, Quality Assurance, in Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION.
- B. Air Handling Units Certification
 - 1. Air Handling Units with Housed Centrifugal Fans: The air handling units shall be certified in accordance with AHRI 430 and tested/rated in accordance with AHRI 260.
 - 2. Air Handling Units with Plenum Fans:
 - a. Air Handling Units with a single Plenum Fan shall be certified in accordance with AHRI 430 and tested/rated in accordance with AHRI 260.
 - b. Air handling Units with Multiple Fans in an Array shall be tested and rated in accordance with AHRI 430 and AHRI 260.
- C. Heating, Cooling, and Air Handling Capacity and Performance Standards: AHRI 430, AHRI 410, ASHRAE 51, and AMCA 210.
- D. Performance Criteria:
 - 1. The fan BHP shall include all system effects for all fans and v-belt drive losses for housed centrifugal fans.
 - 2. The fan motor shall be selected within the rated nameplate capacity, without relying upon NEMA Standard Service Factor.
 - 3. Select the fan operating point as follows:
 - a. Forward Curve and Axial Flow Fans: Right hand side of peak pressure point.
 - b. Air Foil, Backward Inclined, or Tubular Fans Including Plenum Fans: At or near the peak static efficiency but at an appropriate distance from the stall line.
 - 3. Operating Limits: AMCA 99 and Manufacturer's Recommendations.
- E. Units shall be factory-fabricated, assembled, and tested by a manufacturer, in business of manufacturing similar air-handling units for at least five (5) years.

1.4. SUBMITTALS:

- A. The contractor shall, in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES, furnish a complete submission for all air handling units covered in the project. The submission shall include all information listed below. Partial and incomplete submissions shall be rejected without reviews.
- B. Manufacturer's Literature and Data:

1. Submittals for AHUs shall include fans, drives, motors, coils, humidifiers,, mixing box with outside/return air dampers, filter housings, air flow stations, and all other related accessories. The contractor shall provide custom drawings showing total air handling unit assembly including dimensions, operating weight, access sections, flexible connections, door swings, controls penetrations, electrical disconnect, lights, duplex receptacles, switches, wiring, utility connection points, unit support system, vibration isolators, drain pan, pressure drops through each component (filter, coil etc).
 2. Submittal drawings of section or component only will not be acceptable. Contractor shall also submit performance data including performance test results, charts, curves or certified computer selection data; data sheets; fabrication and insulation details. If the unit cannot be shipped in one piece, the contractor shall indicate the number of pieces that each unit will have to be broken into to meet shipping and job site rigging requirements. This data shall be submitted in hard copies and in electronic version compatible to AutoCAD version used by the VA at the time of submission.
 3. Submit sound power levels in each octave band for the inlet and discharge of the fan and at entrance and discharge of AHUs at scheduled conditions. In absence of sound power ratings refer to Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT.
 4. Provide fan curves showing Liters/Second (cubic feet per minute), static pressure, efficiency, and horsepower for design point of operation and at maximum design Liters/Second (cubic feet per minute).
 5. Submit total fan static pressure, external static pressure, for AHU including total, inlet and discharge pressures, and itemized specified internal losses and unspecified internal losses. Refer to air handling unit schedule on drawings.
- C. Maintenance and operating manuals in accordance with Section 01 00 00, GENERAL REQUIREMENTS. Include instructions for lubrication, filter replacement, motor and drive replacement, spare part lists, and wiring diagrams.
- D. Submit written test procedures two weeks prior to factory testing. Submit written results of factory tests for approval prior to shipping.
- E. Submit shipping information that clearly indicates how the units will be shipped in compliance with the descriptions below.
1. Units shall be shipped in one (1) piece where possible and in shrink wrapping to protect the unit from dirt, moisture and/or road salt.

2. If not shipped in one (1) piece, provide manufacturer approved shipping splits where required for installation or to meet shipping and/or job site rigging requirements in modular sections. Indicate clearly that the shipping splits shown in the submittals have been verified to accommodate the construction constraints for rigging as required to complete installation and removal of any section for replacement through available access without adversely affecting other sections.
3. If shipping splits are provided, each component shall be individually shrink wrapped to protect the unit and all necessary hardware (e.g. bolts, gaskets etc.) will be included to assemble unit on site (see section 2.1.A4).
4. Lifting lugs will be provided to facilitate rigging on shipping splits and joining of segments. If the unit cannot be shipped in one piece, the contractor shall indicate the number of pieces that each unit will have to be broken into to meet shipping and job site rigging requirements.

1.5 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. Air-Conditioning, Heating, and Refrigeration Institute (AHRI)/(ARI):
 - 410-01Standard for Forced-Circulation Air-Heating and Air-Cooling
Coils
 - 430-09Central Station Air Handling Units
- C. Air Movement and Control Association International, Inc. (AMCA):
 - 210-07Laboratory Methods of Testing Fans for Rating
- D. American Society of Heating, Refrigerating and Air-conditioning Engineers, Inc. (ASHRAE):
 - 170-2008Ventilation of Health Care Facilities
- E. American Society for Testing and Materials (ASTM):
 - ASTM B117-07a.....Standard Practice for Operating Salt Spray (Fog) Apparatus
 - ASTM D1654-08Standard Test Method for Evaluation of Painted or Coated
Specimens Subjected to Corrosive Environments
 - ASTM D1735-08Standard Practice for Testing Water Resistance of Coatings
Using Water Fog Apparatus
 - ASTM D3359-08Standard Test Methods for Measuring Adhesion by Tape Test
- F. Military Specifications (Mil. Spec.):
 - MIL-P-21035B-2003Paint, High Zinc Dust Content, Galvanizing Repair (Metric)

G. National Fire Protection Association (NFPA):

NFPA 90AStandard for Installation of Air Conditioning and Ventilating
Systems, 2009

H. Energy Policy Act of 2005 (P.L.109-58)

PART 2 - PRODUCTS

2.1 AIR HANDLING UNITS

A. General:

1. AHUs shall be fabricated from insulated, solid double-wall galvanized steel without any perforations in draw-through configuration. Casing shall be fabricated as specified in section 2.1.C.2. Galvanizing shall be hot dipped conforming to ASTM A525 and shall provide a minimum of 0.275 kg of zinc per square meter (0.90 oz. of zinc per square foot) (G90). Aluminum constructed units, subject to VA approval, may be used in place of galvanized steel. The unit manufacturer shall provide published documentation confirming that the structural rigidity of aluminum air-handling units is equal or greater than the specified galvanized steel.
2. The contractor and the AHU manufacturer shall be responsible for ensuring that the unit will not exceed the allocated space shown on the drawings, including required clearances for service and future overhaul or removal of unit components. All structural, piping, wiring, and ductwork alterations of units, which are dimensionally different than those specified, shall be the responsibility of the contractor at no additional cost to the government.
3. AHUs shall be fully assembled by the manufacturer in the factory in accordance with the arrangement shown on the drawings. The unit shall be assembled into the largest sections possible subject to shipping and rigging restrictions. The correct fit of all components and casing sections shall be verified in the factory for all units prior to shipment. All units shall be fully assembled, tested, and then split to accommodate shipment and job site rigging. On units not shipped fully assembled, the manufacturer shall tag each section and include air flow direction to facilitate assembly at the job site. Lifting lugs or shipping skids shall be provided for each section to allow for field rigging and final placement of unit.
4. The AHU manufacturer shall provide the necessary gasketing, caulking, and all screws, nuts, and bolts required for assembly. The manufacturer shall provide a factory-trained and qualified local representative at the job site to supervise the assembly and to assure that the units are assembled to meet manufacturer's recommendations and requirements noted on the drawings. Provide documentation to the Contracting Officer that the local representative has

- provided services of similar magnitude and complexity on jobs of comparable size. If a local representative cannot be provided, the manufacturer shall provide a factory representative.
5. Gaskets: All door and casing and panel gaskets and gaskets between air handling unit components, if joined in the field, shall be high quality which seal air tight and retain their structural integrity and sealing capability after repeated assembly and disassembly of bolted panels and opening and closing of hinged components. Bolted sections may use a more permanent gasketing method provided they are not disassembled.
 6. Structural Rigidity: Provide structural reinforcement when required by span or loading so that the deflection of the assembled structure shall not exceed 1/200 of the span based on a differential static pressure of 1991 PA (8 inch WG) or higher.

B. Base:

1. Provide a heavy duty steel base for supporting all major AHU components. Bases shall be constructed of wide-flange steel I-beams, channels, or minimum 125 mm (5 inch) high 3.5 mm (10 Gauge) steel base rails. Welded or bolted cross members shall be provided as required for lateral stability. Contractor shall provide supplemental steel supports as required to obtain proper operation heights for cooling coil condensate drain trap and // steam coil condensate return trap // as shown on drawings.
2. AHUs shall be completely self supporting for installation on concrete housekeeping pad, steel support pedestals, or suspended as shown on drawings.
3. The AHU bases not constructed of galvanized steel shall be cleaned, primed with a rust inhibiting primer, and finished with rust inhibiting exterior enamel.

C. Casing (including wall, floor and roof):

1. General: AHU casing shall be constructed as solid double wall, galvanized steel insulated panels without any perforations, integral of or attached to a structural frame. The thickness of insulation, mode of application and thermal breaks shall be such that there is no visible condensation on the exterior panels of the AHU located in the non-conditioned spaces.
2. Casing Construction:

Table 2.1.C.2

Outer Panel	0.8 mm (22 Gage) Minimum
Inner Panel	0.8 mm (22 Gage) Minimum
Insulation	Foam
Thickness	50 mm (2 inch) Minimum
Density	48 kg/m ³ (3.0 lb/ft ³) Minimum

Total R Value	2.3 m ² .K/W (13.0 ft ² .°F.hr/Btu) Minimum
---------------	--

3. Casing Construction (Contractor's Option):

Table 2.1.C.3

Outer Panel	1.3 mm (18 Gage) Minimum
Inner Panel	1.0 mm (20 Gage) Minimum
Insulation Thickness	Fiberglass 50 mm (2 inch) Minimum
Density	24 kg/m ³ (1.5 lb/ft ³) Minimum
Total R Value	1.4 m ² .K/W (8.0 ft ² .°F.hr/Btu) Minimum

4. Blank-Off: Provide blank-offs as required to prevent air bypass between the AHU sections, around coils, and filters.
5. Casing panels shall be secured to the support structure with stainless steel or zinc-chromate plated screws and gaskets installed around the panel perimeter. Panels shall be completely removable to allow removal of fan, coils, and other internal components for future maintenance, repair, or modifications. Welded exterior panels are not acceptable.
6. Access Doors: Provide in each access section and where shown on drawings. Show single-sided and double-sided access doors with door swings on the floor plans. Doors shall be a minimum of 50 mm (2 inch) thick with same double wall construction as the unit casing. Doors shall be a minimum of 600 mm (24 inches) wide, unless shown of different size on drawings, and shall be the full casing height up to a maximum of 1850 mm (6 feet). Doors shall be gasketed, hinged, and latched to provide an airtight seal. The access doors for fan section, mixing box, // humidifier // coil section shall include a minimum 150 mm x 150 mm (6 inch x 6 inch) double thickness, with air space between the glass panes tightly sealed, reinforced glass or Plexiglas window in a gasketed frame.
 - a. Hinges: Manufacturers standard, designed for door size, weight and pressure classifications. Hinges shall hold door completely rigid with minimum 45 kg (100 lb) weight hung on latch side of door.

- b. Latches: Non-corrosive alloy construction, with operating levers for positive cam action, operable from either inside or outside. Doors that do not open against unit operating pressure shall allow the door to ajar and then require approximately 0.785 radian (45 degrees) further movement of the handle for complete opening. Latch shall be capable of restraining explosive opening of door with a force not less than 1991 Pa (8 inch WG).
 - c. Gaskets: Neoprene, continuous around door, positioned for direct compression with no sliding action between the door and gasket. Secure with high quality mastic to eliminate possibility of gasket slipping or coming loose.
- 7. Provide sealed sleeves, metal or plastic escutcheons or grommets for penetrations through casing for power and temperature control wiring and pneumatic tubing. Coordinate with electrical and temperature control subcontractors for number and location of penetrations. Coordinate lights, switches, and duplex receptacles and disconnect switch location and mounting. All penetrations and equipment mounting may be provided in the factory or in the field. All field penetrations shall be performed neatly by drilling or saw cutting. No cutting by torches will be allowed. Neatly seal all openings airtight.
- E. Floor:
 - 1. Unit floor shall be level without offset space or gap and designed to support a minimum of 488 kg/square meter (100 lbs per square foot) distributed load without permanent deformation or crushing of internal insulation. Provide adequate structural base members beneath floor in service access sections to support typical service foot traffic and to prevent damage to unit floor or internal insulation. Unit floors in casing sections, which may contain water or condensate, shall be watertight with drain pan.
 - 2. Where indicated, furnish and install floor drains, flush with the floor, with nonferrous grate cover and stub through floor for external connection.
- F. Condensate Drain Pan: Drain pan shall be designed to extend entire length of cooling coils including headers and return bends. Depth of drain pan shall be at least 43 mm (1.7 inches) and shall handle all condensate without overflowing. Drain pan shall be double-wall, double sloping type, and fabricated from stainless (304) with at least 50 mm (2 inch) thick insulation sandwiched between the inner and outer surfaces. Drain pan shall be continuous metal or welded watertight. No mastic sealing of joints exposed to water will be permitted. Drain pan shall be placed on top of casing floor or integrated into casing floor assembly. Drain pan shall be pitched in all directions to drain line.

1. An intermediate, stainless-steel (304) condensate drip pan with copper downspouts shall be provided on stacked cooling coils.

Use of intermediate condensate drain channel on upper casing of lower coil is permissible provided it is readily cleanable. Design of intermediate condensate drain shall prevent upper coil condensate from flowing across face of lower coil.

2. Drain pan shall be piped to the exterior of the unit. Drain pan shall be readily cleanable.
3. Installation, including frame, shall be designed and sealed to prevent blow-by.

G. Housed Centrifugal Fan Sections:

1. Fans shall be minimum Class II construction, double width, double inlet centrifugal, air foil or backward type as indicated on drawings, factory balanced and rated in accordance with AMCA 210 or ASHRAE 51. Provide self-aligning, pillow block, regreasable ball-type bearings selected for a B (10) life of not less than 50,000 hours and an L (50) average fatigue life of 200,000 hours per AFBMA Standard 9. Extend bearing grease lines to motor and drive side of fan section. Fan shall be located in airstream to assure proper air flow.
2. Provide internally vibration isolated fan, motor and drive, mounted on a common integral bolted or welded structural steel base with adjustable motor slide rail with locking device. Provide vibration isolators and flexible duct connections at fan discharge to completely isolate fan assembly. Refer to Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT, for additional requirements.

Allowable vibration tolerances for fan shall not exceed a self-excited vibration maximum velocity of 0.005 m/s (0.20 inch per second) RMS, filter in, when measured with a vibration meter on bearing caps of machine in vertical, horizontal and axial directions or measured at equipment mounting feet if bearings are concealed. After field installation, compliance to this requirement shall be demonstrated with field test in accordance with Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT and Section 23 05 93, TESTING, ADJUSTING, AND BALANCING FOR HVAC. Following fan assembly, the complete fan assembly balance shall be tested using an electronic balance analyzer with a tunable filter and stroboscope. Vibration measurements shall be taken on each motor bearing housing in the vertical, horizontal, and axial planes (5 total measurements, 2 each motor bearing and 1 axial).

H. Fan Motor, Drive, and Mounting Assembly (Housed Centrifugal Fans):

1. Fan Motor and Drive: Motors shall be premium energy efficient type, as mandated by the Energy Policy Act of 2005, with efficiencies as shown in the Specifications Section 23 05 12

(General Motor Requirements For HVAC and Steam Equipment), on drawings and suitable for use in variable frequency drive applications on AHUs where this type of drive is indicated. Refer to Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION, for additional motor and drive specifications. Refer to Specification Section 26 29 11, LOW-VOLTAGE MOTOR STARTERS.

3. Fan drive and belts shall be factory mounted with final alignment and belt adjustment to be made by the Contractor after installation. Drive and belts shall be as specified in Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION. Provide additional drive(s) if required during balancing, to achieve desired airflow.
- L. Mixing Boxes: Mixing box shall consist of casing and outdoor air and return air dampers in opposed blade arrangement with damper linkage for automatic operation. Coordinate damper operator with Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC. Dampers shall be of ultra-low leak design with metal compressible bronze jamb seals and extruded vinyl edge seals on all blades. Blades shall rotate on stainless steel sleeve bearings or bronze bushings. Leakage rate shall not exceed 1.6 cubic meters/min/square meter (5 CFM per square foot) at 250 Pa (1 inch WG) and 2.8 cubic meters/min/square meter (9 CFM per square foot) at 995 Pa (4 inch WG) Electronic operators shall be furnished and mounted in an accessible and easily serviceable location by the air handling unit manufacturer at the factory. Damper operators shall be of same manufacturer as controls furnished under Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC.
- L. Filter Section: Refer to Section 23 40 00, HVAC AIR CLEANING DEVICES, for filter requirements.
1. Filters including one complete set for temporary use at site shall be provided independent of the AHU. The AHU manufacturer shall install filter housings and racks in filter section compatible with filters furnished. The AHU manufacturer shall be responsible for furnishing temporary filters (pre-filters and after-filters, as shown on drawings) required for AHU testing.
 2. Factory-fabricated filter section shall be of the same construction and finish as the AHU casing including filter racks and hinged double wall access doors. Filter housings shall be constructed in accordance with side service or holding frame housing requirements in Section 23 40 00, HVAC AIR CLEANING DEVICES.

- M. Diffuser Section: Furnish a diffuser segment with perforated diffuser plate immediately downstream of supply fan to assure uniform distribution of leaving air across the face of the downstream after-filters to create uniform velocity profiles across the entire opening. Bolt or weld diffuser plate to a sturdy steel support frame so that it remains rigid. Manufacturer shall include any diffuser section pressure loss in excess of diffuser plate and this value shall be included in unspecified internal losses when selecting fan.
- N. Coils: Coils shall be mounted on hot dipped galvanized steel supports to assure proper anchoring of coil and future maintenance. Coils shall be face or side removable for future replacement thru the access doors or removable panels. Each coil shall be removable without disturbing adjacent coil. Cooling coils and heat recovery coils shall be designed and installed to insure no condensate carry over. Provide factory installed extended supply, return, drain, and vent piping connections. Refer to Drawings and Section 23 82 16, AIR COILS for additional coil requirements.
- O. Integral Face and Bypass Steam Coils: Provide integral vertical face and bypass dampers. Electric damper operators shall be furnished and mounted by the AHU manufacturer at the factory. Damper operators shall be of same manufacturer as controls furnished under Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC.
- P. Humidifier: coordinate the humidification requirements with section 23 22 13 Steam and Condensate Heating Piping. Provide air-handling unit-mounted humidification section with stainless steel drain pan of adequate length to allow complete absorption of water vapor. Provide stainless steel dispersion panel or distributors as indicated, with stainless steel supports and hardware.
- Q. Sound Attenuators: Refer to Drawings, Specification Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT, and Section 23 31 00, HVAC DUCTS AND CASINGS, for additional unit mounted sound attenuator requirements. AHU sound attenuators shall be factory installed as an integral part of AHU.
- R. Discharge Section:
Provide aerodynamically designed framed discharge openings or spun bellmouth fittings to minimize pressure loss.
- S. Electrical and Lighting: Wiring and equipment specifications shall conform to Division 26, ELECTRICAL.
1. Vapor-proof lights using cast aluminum base style with glass globe and cast aluminum guard shall be installed in access sections for fan, mixing box, humidifier and any section over 300 mm (12 inch) wide. A switch shall control the lights in each compartment with pilot

light mounted outside the respective compartment access door. Wiring between switches and lights shall be factory installed. All wiring shall run in neatly installed electrical conduits and terminate in a junction box for field connection to the building system. Provide single point 115 volt - one phase connection at junction box.

2. Install compatible 100 watt bulb in each light fixture.
 3. Provide a convenience duplex // weatherproof // receptacle next to the light switch.
 4. Disconnect switch and power wiring: Provide factory or field mounted disconnect switch.
- Coordinate with Division 26, ELECTRICAL.

T. UVC EMITTERS

1. UVC Emitters/Lamps: Ultraviolet light (C band) emitters/ lamps shall be incorporated downstream of the cooling coils in the air-handling unit, to control airborne and surface microbial growth and transfer. Applied fixtures/lamps must be specifically manufactured for this purpose. Safety interlocks/features shall be provided to limit hazard to operating staff.
2. Emitter: High Output T5 Diameter with 4 pin type socket, Quartz sleeve, 250 microwatts per square centimeter at 1 meter away, 45 degrees Fahrenheit, 253.7 nm band. See drawings for length and quantity.
3. Mounting: Flat Plate Lamp Holder consisting of 3/4" hole and space for (4) nut and bolt steel fasteners.
4. Certification: UL 1995
5. Power Supply: 120V at 60Hz, electronic rapid-start ballast with minimum power factor of 0.95

2.2 MAKEUP AIR UNITS

- A. Coil: factory tested, AHRI 410 rated face and bypass steam coil with factory mounted actuators. Provide factory freeze stat.
- B. Galvanized steel G90 frames and panels, factory sealed and weather tight for exterior application.
- C. NFPA 90A and UL181 compliant insulation.
- D. Double width double inlet fans. Motor in accordance with 23 05 12. Permanently lubricated ball bearings selected for +100,000 hour L10 life.
- E. Single point power connection, UL listed, factory starter and disconnect.
- F. V-bank filter arrangement with Merv 7 filters.
- G. Provide return air connection, outside air weather hood, OA and RA actuators, dampers and control contacts to allow external control of 100% OA or recirculation mode.

PART 3 – EXECUTION

3.1 INSTALLATION

- A. Install air handling unit in conformance with ARI 435.
- B. Assemble air handling unit components following manufacturer's instructions for handling, testing and operation. Repair damaged galvanized areas with paint in accordance with Military Spec. DOD-P-21035. Repair painted units by touch up of all scratches with finish paint material. Vacuum the interior of air handling units clean prior to operation.
- D. Leakage and test requirements for air handling units shall be the same as specified for ductwork in Specification Section 23 31 00, HVAC DUCTS AND CASINGS except leakage shall not exceed Leakage Class (C_L) 12 listed in SMACNA HVAC Air Duct Leakage Test Manual when tested at 1.5 times the design static pressure. Repair casing air leaks that can be heard or felt during normal operation and to meet test requirements.
- E. Perform field mechanical (vibration) balancing in accordance with Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT.
- F. Seal and/or fill all openings between the casing and AHU components and utility connections to prevent air leakage or bypass.

3.2 STARTUP SERVICES

- A. The air handling unit shall not be operated for any purpose, temporary or permanent, until ductwork is clean, filters are in place, bearings are lubricated and fan has been test run under observation.
- B. After the air handling unit is installed and tested, provide startup and operating instructions to VA personnel.
- C. An authorized factory representative should start up, test and certify the final installation and application specific calibration of control components. Items to be verified include fan performance over entire operating range, noise and vibration testing, verification of proper alignment, overall inspection of the installation, Owner/Operator training, etc.

--- E N D ---

SECTION 23 81 00
DECENTRALIZED UNITARY HVAC EQUIPMENT

PART 1 - GENERAL

1.1 DESCRIPTION

A. Definitions:

1. Energy Efficiency Ratio (EER): The ratio of net cooling capacity is Btu/h to total rate of electricity input in watts under designated operating conditions (Btu hour/Watt).
2. Seasonal Energy Efficiency Ratio (EER): The ratio of the total cooling output of an air conditioner during its normal annual usage period for cooling in Btu/h divided by total electric energy input in watts during the same period (Btu hour/Watt).
3. Unitary: A Unitary Air Conditioner consists of one or more factory-made assemblies which normally include an evaporator or cooling coil, a compressor and condenser combination, and may include a heating function as well.
4. Where such equipment is provided in more than one assembly the separated assemblies are to be designed to be used together and the requirements of rating are based upon use of matched assemblies.

1.2 RELATED WORK

- A. Section 23 05 11, COMMON WORK RESULTS FOR HVAC: General mechanical requirements and items, which are common to more than one section of Division 23.
- B. Section 23 05 41, NOISE and VIBRATION CONTROL FOR HVAC PIPING and EQUIPMENT: Requirements for different types of vibration isolators and noise ratings in the occupied areas.
- C. Section 23 07 11, HVAC and BOILER PLANT INSULATION: Requirements for piping insulation.
- D. Section 23 23 00, REFRIGERANT PIPING: Requirements for refrigerant pipes and fittings.
- E. Section 23 36 00, AIR TERMINAL UNITS and Section 23 82 00, CONVECTION HEATING and COOLING UNITS: Requirements for other similar units.
- F. Section 23 73 00, INDOOR CENTRAL-STATION AIR-HANDLING UNITS: Requirements for air handling units using chilled water and hot water coils.
- G. Section 23 40 00, HVAC AIR CLEANING DEVICES: Requirements for air filtration.
- I. Section 23 05 93, TESTING, ADJUSTING, and BALANCING FOR HVAC: Requirements for testing and adjusting air balance.

1.3 QUALITY ASSURANCE

- A. Refer to specification Section 23 05 11, COMMON WORK RESULTS FOR HVAC.
- B. Safety Standards: ASHRAE Standard 15, Safety Code for Mechanical Refrigeration.

1.4 SUBMITTALS

- A. Submit in accordance with specification Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES
- B. Manufacturer's literature and data:
 - 1. Sufficient information, including capacities, pressure drops and piping connections clearly presented, shall be included to determine compliance with drawings and specifications for units noted below:
 - a. Unitary air conditioners:
 - 2) Split systems
 - 2. Unit Dimensions required clearances, operating weights accessories and start-up instructions.
 - 3. Electrical requirements, wiring diagrams, interlocking and control wiring showing factory installed and portions to be field installed.
 - 4. Mounting and flashing of the roof curb to the roofing structure with coordinating requirements for the roof membrane system.
- C. Certification: Submit proof of specified ARI Certification.
- D. Performance Rating: Submit catalog selection data showing equipment ratings and compliance with required sensible-to-heat-ratio, energy efficiency ratio (EER), and coefficient of performance (COP).
- E. Operating and Maintenance Manual: Submit three copies of Operating and Maintenance manual to Resident Engineer three weeks prior to final inspection.

1.5 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. Federal Specifications (Fed. Spec.):
 - A-A-50502-90..... Air conditioner (Unitary Heat Pump) Air to Air (3000-300,000 Btu)
- C. Military Specifications (Mil. Specs.):
 - MIL-PRF-26915D-06Primer Coating, for Steel Surfaces
- D. Air-Conditioning, Heating, and Refrigeration Institute (AHRI):

- 210/240-08.....Performance Rating of Unitary Air-Conditioning and Air-Source
Heat Pump Equipment
- 270-08Sound Rating of Outdoor Unitary Equipment
- 310/380-04.....Standard for Packaged Terminal Air-Conditioners and Heat
Pumps (CSA-C744-04)
- 340/360-07.....Performance Rating of Commercial and Industrial Unitary Air-
Conditioning and Heat Pump Equipment
- 520-04Performance Rating of Positive Displacement Condensing Units
- E. Air Movement and Control Association (AMCA):
- 210-07Laboratory Methods of Testing Fans for Aerodynamic
Performance Rating (ANSI)
- 410-96Recommended Safety Practices for Users and Installers of
Industrial and Commercial Fans
- F. American National Standards Institute (ANSI):
- S12.51-02(R2007).....Acoustics - Determination of Sound Power Levels of Noise
Sources Using Sound Pressure - Precision Method for
Reverberation Rooms (same as ISO 3741:1999)
- G. American Society of Heating, Refrigerating, and Air-Conditioning Engineers (ASHRAE):
- 2008 Handbook.....HVAC Systems and Equipment
- 15-10Safety Standard for Refrigeration Systems (ANSI)
- H. American Society of Testing and Materials (ASTM):
- B117-09Standard Practice for Operating Salt Spray (Fog) Apparatus
- I. American Society of Civil Engineers (ASCE)
- ASCE 7-10.....Minimum Design Loads for Buildings and Other Structures
- J. National Electrical Manufacturer's Association (NEMA):
- MG 1-09 (R2010)Motors and Generators (ANSI)
- ICS 1-00 (R2005, R2008).....Industrial Controls and Systems: General Requirements
- K. National Fire Protection Association (NFPA) Publications:
- 90A-09Standard for the Installation of Air-Conditioning and Ventilating
Systems

PART 2 - PRODUCTS

2.1 UNITARY AIR CONDITIONERS - GENERAL

- A. Applicable ARI Standards:

1. Cooling Capacity 39.6 kW (135,000 Btu/h) and More: AHRI 340/ 360.
 2. Cooling Capacity Less Than 39.6 kW (135,000 Btu/h): AHRI 210/240. Units shall be listed in the ARI Directory of Certified Unitary Air-Conditioners.
- B. Performance Rating: Cooling capacity of units shall meet the sensible heat and total heat requirements shown in the contract documents. In selecting unit size, make true allowance for "sensible to total heat ratio" to satisfy required sensible cooling capacity.
- C. Machinery Guards: Provide guards as shown in AMCA 410 for belts, chains, couplings, pulleys, sheaves, shafts, gears and other moving parts regardless of height above the floor. Drive guards may be excluded where motors and drives are inside factory fabricated casings.
- D. Corrosion Prevention: Unless specified otherwise, equipment fabricated from ferrous metals that do not have a zinc coating or a duplex coating of zinc and paint shall be treated for prevention of rust with a factory coating or paint system that will withstand 125 hours in a salt-spray fog test, except that equipment located outdoors shall be tested for 500 hours. The salt-spray fog test shall be in accordance with ASTM B117 using a 20 percent sodium chloride solution. Immediately after completion of the test, the coating shall show no signs of blistering, wrinkling or cracking, no loss of adhesion, and the specimen shall show no signs of rust beyond 3 mm (1/8-inch) on both sides from the scratch mark. //For units located in high humidity areas, provide factory-coated coils for protection from corrosion by using multiple stage electro-deposition coating process. Refer to Drawings and Section 23 82 16, AIR COILS, for additional coil requirements.//

2.2 SPLIT-SYSTEM HEAT PUMPS AND AIR CONDITIONERS

- A. Description: Factory assembled and tested wall-mounted unit, with an air-cooled remote condensing unit, and field-installed refrigeration piping. Heat pumps shall be capable of heating using refrigerant at -10F outside air condition without electric resistance.
- B. Wall-Mounting, Evaporator-Fan Components:
1. Cabinet: Enameled steel with removable panels on front and ends in color selected by Architect, and discharge drain pans with drain connection.
 2. Airstream Surfaces: Surfaces in contact with the airstream shall comply with requirements in ASHRAE 62.1-2007.
 3. Drain Pan and Drain Connection: Comply with ASHRAE 62.1-2007.
 4. Refrigerant Coil: Copper tube, with mechanically bonded aluminum fins, complying with AHRI 210/240, and with thermal-expansion valve.
 6. Fan: Direct drive, centrifugal fan.

7. Fan Motors: Comply with requirements in Section 23 05 12, GENERAL MOTOR REQUIREMENTS FOR HVAC and STEAM GENERATION EQUIPMENT for multi-tapped, multi-speed motors with internal thermal protection and permanent lubrication.
 8. Filters: Disposable, with MERV rating of 7 or higher according to ASHRAE 52.2.
 9. Condensate Removal Pump: ½ gallon ABS tank, pump housing, volute and cover; polypropylene impeller, stainless steel motor shaft, built-in check valve, 1/30HP, UL Listed. Circuit through split system circuit (208V 1PH).
- C. Air-Cooled, Compressor-Condenser Components:
1. Casing: Steel, finished with baked enamel in color selected by Architect, with removable panels for access to controls, weep holes for water drainage, and mounting holes in base. Service valves, fittings, and gage ports shall be brass and located outside of the casing.
 2. Compressor: Inverter driven hermetically sealed variable speed and mounted on vibration isolation. Compressor motor shall have thermal- and current-sensitive overload devices, start capacitor, relay, and contactor.
 3. Compressor motor with manual-reset, high-pressure switch and automatic-reset, low-pressure switch.
 4. Refrigerant: R-410A.
 5. Refrigerant Coil: Copper tube, with mechanically bonded aluminum fins, complying with AHRI 210/240, and with liquid subcooler.
 6. Fan: Aluminum, propeller type, directly connected to motor.
 7. Motor: Permanently lubricated, with integral thermal-overload protection.
 8. Low Ambient Kit: Permit operation down to -10 deg F for heat pumps.
 9. Mounting Base: Polyethylene.
 10. Minimum Energy Efficiency: Comply with ASHRAE/IESNA 90.1-2004, "Energy Standard for Buildings except Low-Rise Residential Buildings."

PART 3 EXECUTION

3.1 INSTALLATION

- A. Roof Curb: Install on roof structure or concrete base, level and secure
- B. Install roof-mounting compressor-condenser components on equipment supports specified in Section 07 71 00, ROOF SPECIALTIES. Anchor units to supports with removable, cadmium-plated fasteners.

- C. Install compressor-condenser components on restrained, spring isolators with a minimum static deflection of 25 mm (1 inch) unless otherwise indicated. Refer to Section 23 05 41, NOISE and VIBRATION CONTROL FOR HVAC PIPING and EQUIPMENT.
- D. Install and connect precharged refrigerant tubing to component's quick-connect fittings. Install tubing to allow access to unit.

3.2 CONNECTIONS

- A. Verify condensate drainage requirements.
- B. Install condensate drain, minimum connection size, with trap and indirect connection to nearest roof drain or area drain.
- C. Install piping adjacent to units to allow service and maintenance.
- E. Ground equipment and install power wiring, switches, and controls for self contained and split systems.
- F. Connect refrigerant piping to coils with shutoff valves on the suction and liquid lines at the coil and a union or flange at each connection at the coil and condenser.

3.3 FIELD QUALITY CONTROL

- A. Perform tests and inspections and prepare test reports.
- B. Tests and Inspections: After installing units and after electrical circuitry has been energized, test units for compliance with requirements. Inspect for and remove shipping bolts, blocks, and tie-down straps. After electrical circuitry has been energized, start units to confirm proper motor rotation and unit operation. Test and adjust controls and safeties. Replace damaged and malfunctioning controls and equipment. Remove and replace malfunctioning units and retest as specified above.

3.4 INSTRUCTIONS

Provide services of manufacturer's technical representative for four hours to instruct VA personnel in operation and maintenance of units.

3.5 STARTUP AND TESTING

Coordinate the startup and contractor testing schedules with the Resident Engineer. Provide a minimum of 7 days prior notice.

3.7 DEMONSTRATION AND TRAINING

- A. Provide services of manufacturer's technical representative for four hours to instruct VA personnel in operation and maintenance of units.

---END---

SECTION 23 82 00
CONVECTION HEATING AND COOLING UNITS

PART 1 - GENERAL

1.1 DESCRIPTION

Unit heaters.

1.2 RELATED WORK

- A. Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION: General mechanical requirements and items, which are common to more than one section of Division 23.
- B. Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT: Noise requirements.
- C. Section 23 21 13, HYDRONIC PIPING: Heating hot water and chilled water piping.
- D. Section 23 31 00, HVAC DUCTS AND CASINGS: Ducts and flexible connectors.
- E. Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC: Valve operators.
- F. Section 23 05 93, TESTING, ADJUSTING, AND BALANCING FOR HVAC: Flow rates adjusting and balancing.

1.3 QUALITY ASSURANCE

Refer to Paragraph, QUALITY ASSURANCE, in Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION.

1.4 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturer's Literature and Data:
 - 1. Unit heaters.
- C. Certificates:
 - 1. Compliance with paragraph, QUALITY ASSURANCE.
 - 2. Compliance with specified standards.
- D. Operation and Maintenance Manuals: Submit in accordance with paragraph, INSTRUCTIONS, in Section 01 00 00, GENERAL REQUIREMENTS.

1.5 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.

- B. Air Conditioning and Refrigeration Institute (ARI):
 - 440-05 Room Fan Coils
- C. National Fire Protection Association (NFPA):
 - 90A-09 Standard for the Installation of Air Conditioning and Ventilating Systems
 - 70-09 National Electrical Code
- D. Underwriters Laboratories, Inc. (UL):
 - 181-05 Standard for Factory-Made Air Ducts and Air Connectors
 - 1995-05 Heating and Cooling Equipment

1.6 GUARANTY

In accordance with FAR clause 52.246-21.

PART 2 - PRODUCTS

2.3 UNIT HEATERS

- A. General: Horizontal or vertical discharge type for steam, hot water or electric heating medium, as indicated.
- B. Casing: Steel sheet, phosphatized to resist rust and finished in baked enamel. Provide hanger supports.
- C. Fan: Propeller type, direct driven by manufacturer's standard electric motor. Provide resilient mounting. Provide fan guard for horizontal discharge units.
- D. Discharge Air Control:
 - 1. Horizontal discharge: Horizontal, adjustable louvers.
 - 2. Vertical discharge: Radial louver diffuser.
- E. Steam or Hot Water Coil: Aluminum fins bonded to seamless copper tubing by mechanical expansion of the tubing, designed for 517 kPa (75 psig) steam working pressure.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Work shall be installed as shown and according to the manufacturer's diagrams and recommendations.
- B. Handle and install units in accordance with manufacturer's written instructions.
- C. Support units rigidly so they remain stationary at all times. Cross-bracing or other means of stiffening shall be provided as necessary. Method of support shall be such that distortion and malfunction of units cannot occur.
- D. Install fiberglass blanket insulation above hydronic radiant panels.

3.2 OPERATIONAL TEST

Refer to Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION.

--- E N D ---

SECTION 23 82 16

AIR COILS

PART 1 - GENERAL

1.1 DESCRIPTION

Heating and cooling coils for air handling unit and duct applications.

1.2 RELATED WORK

- A. Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION.
- B. Section 23 73 00, INDOOR CENTRAL-STATION AIR-HANDLING UNITS.
- C. Reheat coils for VAV/CV terminals: Section 23 36 00, AIR TERMINAL UNITS.

1.3 QUALITY ASSURANCE

- A. Refer to paragraph, QUALITY ASSURANCE, Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION.
- B. Unless specifically exempted by these specifications, heating and cooling coils shall be tested, rated, and certified in accordance with ARI Standard 410 and shall bear the ARI certification label.

1.4 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturer's Literature and Data for Heating and Cooling Coils: Submit type, size, arrangements and performance details. Present application ratings in the form of tables, charts or curves.
- C. Provide installation, operating and maintenance instructions.
- D. Certification Compliance: Evidence of listing in current ARI Directory of Certified Applied Air Conditioning Products.
- E. Coils may be submitted with Section 23 73 00, INDOOR CENTRAL-STATION AIR-HANDLING UNITS.

1.5 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. Air Conditioning and Refrigeration Institute (ARI):
 Directory of Certified Applied Air Conditioning Products
 ARI 410-02Forced-Circulation Air-Cooling Air-Heating Coils.
- C. American Society for Testing and Materials (ASTM):

B75/75M-02.....Seamless Copper Tube (Metric)

D. National Fire Protection Association (NFPA):

70-09National Electric Code

E. National Electric Manufacturers Association (NEMA):

250-03Enclosures for Electrical Equipment (1,000 Volts Maximum)

F. Underwriters Laboratories, Inc. (UL):

1996-01Electric Duct Heaters

PART 2 - PRODUCTS

2.1 HEATING AND COOLING COILS

A. Conform to ASTM B75 and ARI 410.

B. Tubes: Minimum 16 mm (0.625 inch) tube diameter; Seamless copper tubing.

C. Fins: 0.1397 mm (0.0055 inch) aluminum or 0.1143 mm (0.0045 inch) copper mechanically bonded or soldered or helically wound around tubing. Provide copper fins for sprayed coil applications and reheat coils for Operating Rooms.

D. Headers: Copper, welded steel or cast iron. Provide seamless copper tubing or resistance welded steel tube for volatile refrigerant coils.

E. "U" Bends, Where Used: Machine die-formed, silver brazed to tube ends.

F. Coil Casing: 1.6 mm (16 gage) galvanized steel with tube supports at 1200 mm (48 inch) maximum spacing. Construct casing to eliminate air bypass and moisture carry-over. Provide duct connection flanges.

G. Pressures kPa (PSIG):

Pressure	Water Coil	Steam Coil	Refrigerant Coil
Test	2070 (300)	1725 (250)	2070 (300)
Working	1380 (200)	520 (75)	1725 (250)

H. Protection: Unless protected by the coil casing, provide cardboard, plywood, or plastic material at the factory to protect tube and finned surfaces during shipping and construction activities.

I. Vents and Drain: Coils that are not vented or drainable by the piping system shall have capped vent/drain connections extended through coil casing.

J. Cooling Coil Condensate Drain Pan: Section 23 73 00, INDOOR CENTRAL-STATION AIR-HANDLING UNITS.

2.2 STEAM DISTRIBUTING TUBE COILS

A. Conform to ASTM B75 and ARI 410.

- B. Minimum 9.5 mm (3/8-inch) steam distributing tubing installed concentrically in 25 mm (one-inch) OD condensing coil tubes.

2.3 INTEGRAL FACE AND BYPASS TYPE STEAM COIL

- A. Exempt from ARI Test and Certification.
- B. Conform to ASTM B75 and ARI 410.
- C. Minimum 16 mm (5/8-inch) steam tube installed in concentrically 25 mm (one-inch) OD diameter tube.
- D. Casing: 1.9 mm (14 gage) galvanized steel with corrosion resistant paint.
- E. Tubes and Bypasses: Vertical or horizontal.
- F. Dampers: Interlocking opposed blades to completely isolate coil from air flow when unit is in bypass position; 1.6 mm (16 gage) steel, coated with factory applied corrosion resistant baked enamel finish. Provide damper linkage and // pneumatic operator(s) // electric operators//.

2.4 REHEAT COILS, DUCT MOUNTED

Continuous circuit booster type for steam or hot water as shown on drawings. Material of coils same as noted in Articles 2.1 thru 2.3.

2.5 WATER COILS, INCLUDING GLYCOL-WATER

- A. Drainable Type (Self-Draining, Self-Venting); manufacturer standard:
 - 1. Cooling, all types.
 - 2. Heating or preheat.
 - 3. Runaround energy recovery. ARI certification of capacity adjustment is waived. See Section 23 72 00, AIR-TO-AIR ENERGY RECOVERY EQUIPMENT.
- B. Cleanable Tube Type; manufacturer standard:
 - 1. Well water applications.
 - 2. Waste water applications.

2.6 VOLATILE REFRIGERANT COILS

- A. Continuous circuit, straight tubes, dry expansion type equipped with multi-port distribution header, less expansion valve.
- B. Minimum 16 mm (5/8-inch) tube diameter.
- C. Designed for R22 or other EPA approved refrigerants.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Follow coil manufacturer's instructions for handling, cleaning, installation and piping connections.

B. Comb fins, if damaged. Eliminate air bypass or leakage at coil sections.

--- E N D ---

SECTION 26 05 01
SELECTIVE ELECTRICAL DEMOLITION

PART 1 – GENERAL

1.1 SECTION INCLUDES

- A. Electrical demolition.
- B. Maintaining electrical systems services.

1.2 RELATED SECTIONS

- A. Section 00 72 00 – GENERAL CONDITIONS.

PART 2 – PRODUCTS

1.1 MATERIALS AND EQUIPMENT

- A. Materials and equipment for patching work: Match existing unless otherwise specified in individual Sections.

PART 3 – EXECUTION

1.1 EXAMINATION

- A. Verify circuiting arrangements are as shown on Drawings.
- B. Verify that abandoned wiring and equipment serve only abandoned facilities.
- C. Demolition Drawings are based on existing record documents and selective field observation.
Report discrepancies to Resident Engineer before disturbing existing installation.

1.2 PREPARATION

- A. Coordinate schedule aspects with Resident Engineer. Notify Resident Engineer of modifications or changes to suggested sequence.
- B. Coordinate utility service outages with Utility Company.
- C. Report discrepancies, code violations, and other problems to Resident Engineer.
- D. When work must be performed on energized equipment or circuits, use personnel experienced in such operations.
- E. Existing Electrical Services:
 - 1. Disable system only for disconnections and to make splices.
 - 2. Outages:
 - a. Obtain permission from Resident Engineer at least two weeks before partially or completely disabling system(s).
 - b. Minimize outage durations. Provide temporary power feeds during panel replacements to minimize outage to the time it takes to disconnect permanent feed and reconnect temporary power source.

1.3 DEMOLITION EXISTING ELECTRICAL WORK

- A. Remove abandoned wiring to source of supply.
- B. Remove exposed abandoned conduit, including abandoned conduit above accessible ceiling finishes. Cut conduit flush with walls and floors, and patch surfaces.
- C. Disconnect abandoned outlets and remove devices. Remove abandoned outlets if conduit servicing them is abandoned and removed. Provide blank cover for abandoned boxes which are not removed.
- D. Disconnect and remove electrical devices and equipment serving utilization equipment that has been removed.
- E. Disconnect and remove abandoned luminaires. Remove brackets, stems, hangers, and other accessories. Turn luminaries over to Resident Engineer. If Resident Engineer refuses luminaries then properly dispose.
- F. Disconnect and remove controls and electrical components serving equipment that has been removed.
- G. Repair adjacent construction and finishes damaged during demolition and extension work.
- H. Maintain access to existing electrical installations which remain active. Modify installation or provide access panel as appropriate.
- I. Extend existing installations using materials and methods compatible with existing electrical installations, or as specified.
- J. Clean and repair existing materials and equipment which remain or are to be reused.
- K. Repair adjacent construction and finishes damaged during demolition work.

1.4 CLEANING AND REPAIR

- A. Clean and repair existing materials and equipment which remain or are to be reused.
- B. Panelboards: Clean exposed surfaces and check tightness of electrical connections. Provide typed circuit directory showing revised circuiting arrangement.

--- E N D ---

SECTION 26 05 11 REQUIREMENTS FOR ELECTRICAL INSTALLATIONS

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS, applies to all sections of Division 26.
- B. Furnish and install electrical wiring, systems, equipment and accessories in accordance with the specifications and drawings. Capacities and ratings of motors, transformers, cable, switchboards, switchgear, panelboards, motor control centers, and other items and arrangements for the specified items are shown on drawings.
- C. Wiring ampacities specified or shown on the drawings are based on copper conductors, with the conduit and raceways accordingly sized. Aluminum conductors are prohibited.

1.2 MINIMUM REQUIREMENTS

- A. References to the National Electrical Code (NEC), Underwriters Laboratories, Inc. (UL) and National Fire Protection Association (NFPA) are minimum installation requirement standards.
- B. Drawings and other specification sections shall govern in those instances where requirements are greater than those specified in the above standards.

1.3 TEST STANDARDS

- A. All materials and equipment shall be listed, labeled or certified by a nationally recognized testing laboratory to meet Underwriters Laboratories, Inc., standards where test standards have been established. Equipment and materials which are not covered by UL Standards will be accepted provided equipment and material is listed, labeled, certified or otherwise determined to meet safety requirements of a nationally recognized testing laboratory. Equipment of a class which no nationally recognized testing laboratory accepts, certifies, lists, labels, or determines to be safe, will be considered if inspected or tested in accordance with national industrial standards, such as NEMA, or ANSI. Evidence of compliance shall include certified test reports and definitive shop drawings.
- B. Definitions:
 - 1. Listed equipment or device of a kind mentioned which:
 - a. Is published by a nationally recognized laboratory which makes periodic inspection of production of such equipment.
 - b. States that such equipment meets nationally recognized standards or has been tested and found safe for use in a specified manner.
 - 2. Labeled equipment or device is when:

- a. It embodies a valid label, symbol, or other identifying mark of a nationally recognized testing laboratory such as Underwriters Laboratories, Inc.
 - b. The laboratory makes periodic inspections of the production of such equipment.
 - c. The labeling indicates compliance with nationally recognized standards or tests to determine safe use in a specified manner.
3. Certified equipment or product is which:
- a. Has been tested and found by a nationally recognized testing laboratory to meet nationally recognized standards or to be safe for use in a specified manner.
 - b. Production of equipment or product is periodically inspected by a nationally recognized testing laboratory.
 - c. Bears a label, tag, or other record of certification.
4. Nationally recognized testing laboratory; laboratory which is approved, in accordance with OSHA regulations, by the Secretary of Labor.

1.4 QUALIFICATIONS (PRODUCTS AND SERVICES)

- A. Manufacturers Qualifications: The manufacturer shall regularly and presently produce, as one of the manufacturer's principal products, the equipment and material specified for this project, and shall have manufactured the item for at least three years.
- B. Product Qualification:
 - 1. Manufacturer's product shall have been in satisfactory operation, on three installations of similar size and type as this project, for approximately three years.
 - 2. The Government reserves the right to require the Contractor to submit a list of installations where the products have been in operation before approval.
- C. Service Qualifications: There shall be a permanent service organization maintained or trained by the manufacturer which will render satisfactory service to this installation within four hours of receipt of notification that service is needed. Submit name and address of service organizations.

1.5 MANUFACTURED PRODUCTS

- A. Materials and equipment furnished shall be of current production by manufacturers regularly engaged in the manufacture of such items, for which replacement parts shall be available.
- B. When more than one unit of the same class of equipment is required, such units shall be the product of a single manufacturer.
- C. Equipment Assemblies and Components:
 - 1. Components of an assembled unit need not be products of the same manufacturer.
 - 2. Manufacturers of equipment assemblies, which include components made by others, shall assume complete responsibility for the final assembled unit.

3. Components shall be compatible with each other and with the total assembly for the intended service.
4. Constituent parts which are similar shall be the product of a single manufacturer.
- D. Factory wiring shall be identified on the equipment being furnished and on all wiring diagrams.
- E. When Factory Testing Is Specified:
 1. The Government shall have the option of witnessing factory tests. The contractor shall notify the VA through the Resident Engineer a minimum of 15 working days prior to the manufacturers making the factory tests.
 2. Four copies of certified test reports containing all test data shall be furnished to the Resident Engineer prior to final inspection and not more than 90 days after completion of the tests.
 3. When equipment fails to meet factory test and re-inspection is required, the contractor shall be liable for all additional expenses, including expenses of the Government.

1.6 EQUIPMENT REQUIREMENTS

Where variations from the contract requirements are requested in accordance with Section 00 72 00, GENERAL CONDITIONS and Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES, the connecting work and related components shall include, but not be limited to additions or changes to branch circuits, circuit protective devices, conduits, wire, feeders, controls, panels and installation methods.

1.7 EQUIPMENT PROTECTION

- A. Equipment and materials shall be protected during shipment and storage against physical damage, dirt, moisture, cold and rain:
 1. During installation, enclosures, equipment, controls, controllers, circuit protective devices, and other like items, shall be protected against entry of foreign matter; and be vacuum cleaned both inside and outside before testing and operating and repainting if required.
 2. Damaged equipment shall be, as determined by the Resident Engineer, placed in first class operating condition or be returned to the source of supply for repair or replacement.
 3. Painted surfaces shall be protected with factory installed removable heavy kraft paper, sheet vinyl or equal.
 4. Damaged paint on equipment and materials shall be refinished with the same quality of paint and workmanship as used by the manufacturer so repaired areas are not obvious.

1.8 WORK PERFORMANCE

- A. All electrical work must comply with the requirements of NFPA 70 (NEC), NFPA 70B, NFPA 70E, OSHA Part 1910 subpart J, OSHA Part 1910 subpart S and OSHA Part 1910 subpart K in addition to other references required by contract.

- B. Job site safety and worker safety is the responsibility of the contractor.
- C. Electrical work shall be accomplished with all affected circuits or equipment de-energized. When an electrical outage cannot be accomplished in this manner for the required work, the following requirements are mandatory:
 - 1. Electricians must use full protective equipment (i.e., certified and tested insulating material to cover exposed energized electrical components, certified and tested insulated tools, etc.) while working on energized systems in accordance with NFPA 70E.
 - 2. Electricians must wear personal protective equipment while working on energized systems in accordance with NFPA 70E.
 - 3. Before initiating any work, a job specific work plan must be developed by the contractor with a peer review conducted and documented by the Resident Engineer and Medical Center staff. The work plan must include procedures to be used on and near the live electrical equipment, barriers to be installed, safety equipment to be used and exit pathways.
 - 4. Work on energized circuits or equipment cannot begin until prior written approval is obtained from the Director of the Medical Center.
- D. All electrical work which involves loss of power to any Critical or Life Safety circuits in the Medical Center must be scheduled for Sunday morning hours between 2:00AM-4:00AM. All outages must be coordinated to last no longer than one-half hour. Provide temporary feeders, panelboards, breakers, conduit, and wire as required to limit outages to less than ½ hour.
- E. All electrical work with involves loss of power to Equipment, Normal, or Optional Standby circuits in the Medical Center must be schedule for Weekend hours between Friday at 9:00PM and Monday at 4:00AM.
- D. For work on existing stations, arrange, phase and perform work to assure electrical service for other buildings at all times. Refer to Article OPERATIONS AND STORAGE AREAS under Section 01 00 00, GENERAL REQUIREMENTS.
- E. New work shall be installed and connected to existing work neatly and carefully. Disturbed or damaged work shall be replaced or repaired to its prior conditions, as required by Section 01 00 00, GENERAL REQUIREMENTS.
- F. Coordinate location of equipment and conduit with other trades to minimize interferences. See Section 00 72 00, GENERAL CONDITIONS.

1.9 EQUIPMENT INSTALLATION AND REQUIREMENTS

- A. Equipment location shall be as close as practical to locations shown on the drawings.
- B. Working spaces shall not be less than specified in the NEC for all voltages specified.
- C. Inaccessible Equipment:

1. Where the Government determines that the Contractor has installed equipment not conveniently accessible for operation and maintenance, the equipment shall be removed and reinstalled as directed at no additional cost to the Government.
2. "Conveniently accessible" is defined as being capable of being reached without the use of ladders, or without climbing or crawling under or over obstacles such as, but not limited to, motors, pumps, belt guards, transformers, piping, ductwork, conduit and raceways.

1.10 EQUIPMENT IDENTIFICATION

- A. In addition to the requirements of the NEC, install an identification sign which clearly indicates information required for use and maintenance of items such as panelboards, cabinets, motor controllers (starters), safety switches, separately enclosed circuit breakers, individual breakers and controllers in switchboards, switchgear and motor control assemblies, control devices and other significant equipment. Provide identification of panelboard/switchboard/switchgear name and circuit which supplies power to each device listed above. Identify which system the panelboard is fed from: ie, Critical Branch, Life Safety, Equipment, Optional Standby, or Normal.
- B. Nameplates for Normal Power System equipment shall be laminated black phenolic resin with a white core with engraved lettering. Nameplates for Essential Electrical System (EES) equipment, as defined in the NEC, shall be laminated red phenolic resin with a white core with engraved lettering. Lettering shall be a minimum of 1/2 inch [12mm] high. Nameplates shall indicate equipment designation, rated bus amperage, voltage, number of phases, number of wires, and type of EES power branch as applicable. Secure nameplates with screws.

1.11 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. The Government's approval shall be obtained for all equipment and material before delivery to the job site. Delivery, storage or installation of equipment or material which has not had prior approval will not be permitted at the job site.
- C. All submittals shall include adequate descriptive literature, catalog cuts, shop drawings and other data necessary for the Government to ascertain that the proposed equipment and materials comply with specification requirements. Catalog cuts submitted for approval shall be legible and clearly identify equipment being submitted.
- D. Submittals for individual systems and equipment assemblies which consist of more than one item or component shall be made for the system or assembly as a whole. Partial submittals will not be considered for approval.
 1. Mark the submittals, "SUBMITTED UNDER SECTION_____".

2. Submittals shall be marked to show specification reference including the section and paragraph numbers.
 3. Submit each section separately.
- E. The submittals shall include the following:
1. Information that confirms compliance with contract requirements. Include the manufacturer's name, model or catalog numbers, catalog information, technical data sheets, shop drawings, pictures, nameplate data and test reports as required.
 2. Elementary and interconnection wiring diagrams for communication and signal systems, control system and equipment assemblies. All terminal points and wiring shall be identified on wiring diagrams.
 3. Parts list which shall include those replacement parts recommended by the equipment manufacturer, quantity of parts, current price and availability of each part.
- F. Manuals: Submit in accordance with Section 01 00 00, GENERAL REQUIREMENTS.
1. Maintenance and Operation Manuals: Submit as required for systems and equipment specified in the technical sections. Furnish four copies, bound in hardback binders, (manufacturer's standard binders) or an approved equivalent. Furnish one complete manual as specified in the technical section but in no case later than prior to performance of systems or equipment test, and furnish the remaining manuals prior to contract completion.
 2. Inscribe the following identification on the cover: the words "MAINTENANCE AND OPERATION MANUAL," the name and location of the system, equipment, building, name of Contractor, and contract number. Include in the manual the names, addresses, and telephone numbers of each subcontractor installing the system or equipment and the local representatives for the system or equipment.
 3. Provide a "Table of Contents" and assemble the manual to conform to the table of contents, with tab sheets placed before instructions covering the subject. The instructions shall be legible and easily read, with large sheets of drawings folded in.
 4. The manuals shall include:
 - a. Internal and interconnecting wiring and control diagrams with data to explain detailed operation and control of the equipment.
 - b. A control sequence describing start-up, operation, and shutdown.
 - c. Description of the function of each principal item of equipment.
 - d. Installation and maintenance instructions.
 - e. Safety precautions.
 - f. Diagrams and illustrations.

- g. Testing methods.
 - h. Performance data.
 - i. Lubrication schedule including type, grade, temperature range, and frequency.
 - j. Pictorial "exploded" parts list with part numbers. Emphasis shall be placed on the use of special tools and instruments. The list shall indicate sources of supply, recommended spare parts, and name of servicing organization.
 - k. Appendix; list qualified permanent servicing organizations for support of the equipment, including addresses and certified qualifications.
- G. Approvals will be based on complete submission of manuals together with shop drawings.
- H. After approval and prior to installation, furnish the Resident Engineer with one sample of each of the following:
- 1. A 300 mm (12 inch) length of each type and size of wire and cable along with the tag from the coils of reels from which the samples were taken.
 - 2. Each type of conduit coupling, bushing and termination fitting.
 - 3. Conduit hangers, clamps and supports.
 - 4. Duct sealing compound.
 - 5. Each type of receptacle, toggle switch, outlet box, manual motor starter, device plate, engraved nameplate, wire and cable splicing and terminating material and single pole molded case circuit breaker.

1.12 SINGULAR NUMBER

Where any device or part of equipment is referred to in these specifications in the singular number (e.g., "the switch"), this reference shall be deemed to apply to as many such devices as are required to complete the installation as shown on the drawings.

1.13 TRAINING

- A. Training shall be provided in accordance with Article, INSTRUCTIONS, of Section 01 00 00, GENERAL REQUIREMENTS.
- B. Training shall be provided for the particular equipment or system as required in each associated specification.
- C. A training schedule shall be developed and submitted by the contractor and approved by the Resident Engineer at least 30 days prior to the planned training.

--- E N D ---

SECTION 26 05 21
LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES (600 VOLTS AND BELOW)

PART 1 - GENERAL

1.1 DESCRIPTION

This section specifies the furnishing, installation, and connection of the low voltage power and lighting wiring.

1.2 RELATED WORK

- A. General electrical requirements that are common to more than one section in Division 26:
Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
- B. Conduits for cables and wiring: Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS.
- C. Requirements for personnel safety and to provide a low impedance path for possible ground fault currents: Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS.

1.3 SUBMITTALS

- A. In accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES, furnish the following:
 - 1. Manufacturer's Literature and Data: Showing each cable type and rating.
 - 2. Certificates: Two weeks prior to final inspection, deliver to the Resident Engineer four copies of the certification that the material is in accordance with the drawings and specifications and has been properly installed.

1.4 APPLICABLE PUBLICATIONS

- A. Publications listed below (including amendments, addenda, revisions, supplements and errata) form a part of this specification to the extent referenced. Publications are reference in the text by the basic designation only.
- B. American Society of Testing Material (ASTM):
 - D2301-04Standard Specification for Vinyl Chloride Plastic Pressure Sensitive Electrical Insulating Tape
- C. Federal Specifications (Fed. Spec.):
 - A-A-59544-00Cable and Wire, Electrical (Power, Fixed Installation)
- C. National Fire Protection Association (NFPA):
 - 70-11National Electrical Code (NEC)
- D. Underwriters Laboratories, Inc. (UL):
 - 44-02Thermoset-Insulated Wires and Cables

83-03	Thermoplastic-Insulated Wires and Cables
467-01	Electrical Grounding and Bonding Equipment
486A-01	Wire Connectors and Soldering Lugs for Use with Copper Conductors
486C-02	Splicing Wire Connectors
486D-02	Insulated Wire Connector Systems for Underground Use or in Damp or Wet Locations
486E-00.....	Equipment Wiring Terminals for Use with Aluminum and/or Copper Conductors
493-01	Thermoplastic-Insulated Underground Feeder and Branch Circuit Cable
514B-02	Fittings for Cable and Conduit
1479-03	Fire Tests of Through-Penetration Fire Stops

PART 2 - PRODUCTS

2.1 CABLE AND WIRE (POWER AND LIGHTING)

- A. Cable and Wire shall be in accordance with Fed. Spec. A-A-59544, except as hereinafter specified.
- B. Single Conductor:
 1. Shall be annealed copper.
 2. Shall be stranded for sizes No. 8 AWG and larger, solid for sizes No. 10 AWG and smaller.
 3. Shall be minimum size No. 12 AWG, except where smaller sizes are allowed herein.
- C. Insulation:
 1. Dual rated THHN-THWN shall be in accordance with UL 44, and 83.
 2. Direct burial: UF or USE shall be in accordance with UL 493.
 3. Isolated power system wiring: Type XHHW with a dielectric constant of 3.5 or less.
- D. Color Code:
 1. Secondary service, feeder and branch circuit conductors shall be color coded as follows:

208/120 volt	Phase	480/277 volt
Black	A	Brown
Red	B	Orange
Blue	C	Yellow
White	Neutral	Gray *
* or white with colored (other than green) tracer.		

- a. The lighting circuit “switch legs” and 3-way switch “traveling wires” shall have color coding unique and distinct (i.e. pink and purple) from the color coding indicated above. The unique color codes shall be solid and in accordance with the NEC. Field coordinate for a final color coding with the Resident Engineer.
2. Use solid color compound or solid color coating for No. 12 AWG and No. 10 AWG branch circuit conductors and neutral sizes.
3. Phase conductors No. 8 AWG and larger shall be color-coded using one of the following methods:
 - a. Solid color compound or solid color coating.
 - b. Stripes, bands, or hash marks of color specified above.
 - c. Color as specified using 19 mm (3/4 inch) wide tape. Apply tape in half overlapping turns for a minimum of 75 mm (three inches) for terminal points, and in junction boxes, pull boxes, troughs, manholes, and handholes. Apply the last two laps of tape with no tension to prevent possible unwinding. Where cable markings are covered by tape, apply tags to cable stating size and insulation type.
4. For modifications and additions to existing wiring systems, color coding shall conform to the existing wiring system.
5. Color code for isolated power system wiring shall be in accordance with the NEC.

2.2 SPLICES AND JOINTS

- A. In accordance with UL 486A, C, D, E and NEC.
- B. Branch circuits (No. 10 AWG and smaller):
 1. Connectors: Solderless, screw-on, reusable pressure cable type, 600 volt, 105 degree C with integral insulation, approved for copper and aluminum conductors.
 2. The integral insulator shall have a skirt to completely cover the stripped wires.
 3. The number, size, and combination of conductors, as listed on the manufacturers packaging shall be strictly complied with.
- C. Feeder Circuits:
 1. Connectors shall be indent, hex screw, or bolt clamp-type of high conductivity and corrosion-resistant material.
 2. Field installed compression connectors for cable sizes 250 kcmil and larger shall have not less than two clamping elements or compression indents per wire.

3. Insulate splices and joints with materials approved for the particular use, location, voltage, and temperature. Insulate with not less than that of the conductor level that is being joined.
4. Plastic electrical insulating tape: ASTM D2304 shall apply, flame retardant, cold and weather resistant.

2.3 CONTROL WIRING

- A. Unless otherwise specified in other sections of these specifications, control wiring shall be as specified for power and lighting wiring, except the minimum size shall be not less than No. 14 AWG.
- B. Control wiring shall be large enough so that the voltage drop under inrush conditions does not adversely affect operation of the controls.

2.4 WIRE LUBRICATING COMPOUND

- A. Suitable for the wire insulation and conduit it is used with, and shall not harden or become adhesive.
- B. Shall not be used on wire for isolated type electrical power systems.

2.5 FIREPROOFING TAPE

- A. The tape shall consist of a flexible, conformable fabric of organic composition coated one side with flame-retardant elastomer.
- B. The tape shall be self-extinguishing and shall not support combustion. It shall be arc-proof and fireproof.
- C. The tape shall not deteriorate when subjected to water, gases, salt water, sewage, or fungus and be resistant to sunlight and ultraviolet light.
- D. The finished application shall withstand a 200-ampere arc for not less than 30 seconds.
- E. Securing tape: Glass cloth electrical tape not less than 0.18 mm (7 mils) thick, and 19 mm (3/4 inch) wide.

PART 3 - EXECUTION

3.1 INSTALLATION, GENERAL

- A. Install in accordance with the NEC, and as specified.
- B. Install all wiring in raceway systems, except where direct burial or HCF Type AC cables are used.
- C. Splice cables and wires only in outlet boxes, junction boxes, pull boxes, manholes, or handholes.
- D. Wires of different systems (i.e. 120V, 277V) shall not be installed in the same conduit or junction box system.

- E. Install cable supports for all vertical feeders in accordance with the NEC. Provide split wedge type which firmly clamps each individual cable and tightens due to cable weight.
- F. For panelboards, cabinets, wireways, switches, and equipment assemblies, neatly form, train, and tie the cables in individual circuits.
- G. Seal cable and wire entering a building from underground, between the wire and conduit where the cable exits the conduit, with a non-hardening approved compound.
- H. Wire Pulling:
 - 1. Provide installation equipment that will prevent the cutting or abrasion of insulation during pulling of cables.
 - 2. Use ropes made of nonmetallic material for pulling feeders.
 - 3. Attach pulling lines for feeders by means of either woven basket grips or pulling eyes attached directly to the conductors, as approved by the Resident Engineer.
 - 4. Pull in multiple cables together in a single conduit.
- I. No more than (3) single-phase branch circuits shall be installed in any one conduit.
- J. The wires shall be derated in accordance with NEC Article 310. Neutral wires, under conditions defined by the NEC, shall be considered current-carrying conductors.

3.2 SPLICE INSTALLATION

- A. Splices and terminations shall be mechanically and electrically secure.
- B. Where the Government determines that unsatisfactory splices or terminations have been installed, remove the devices and install approved devices at no additional cost to the Government.

3.3 CONTROL AND SIGNAL WIRING INSTALLATION

- A. Unless otherwise specified in other sections, install wiring and connect to equipment/devices to perform the required functions as shown and specified.
- B. Except where otherwise required, install a separate power supply circuit for each system so that malfunctions in any system will not affect other systems.
- C. Where separate power supply circuits are not shown, connect the systems to the nearest panelboards of suitable voltages, which are intended to supply such systems and have suitable spare circuit breakers or space for installation.
- D. Install a red warning indicator on the handle of the branch circuit breaker for the power supply circuit for each system to prevent accidental de-energizing of the systems.
- E. System voltages shall be 120 volts or lower where shown on the drawings or as required by the NEC.

3.4 CONTROL AND SIGNAL SYSTEM IDENTIFICATION

- A. Install a permanent wire marker on each wire at each termination.
- B. Identifying numbers and letters on the wire markers shall correspond to those on the wiring diagrams used for installing the systems.
- C. Wire markers shall retain their markings after cleaning.
- D. In each manhole and handhole, install embossed brass tags to identify the system served and function.

3.5 FEEDER IDENTIFICATION

- A. In each interior pullbox and junction box, install metal tags on each circuit cables and wires to clearly designate their circuit identification and voltage.

3.6 EXISTING WIRING

- A. Unless specifically indicated on the plans, existing wiring shall not be reused for the new installation. Only wiring that conforms to the specifications and applicable codes may be reused. If existing wiring does not meet these requirements, existing wiring may not be reused and new wires shall be installed.

3.7 FIELD TESTING

- A. Feeders and branch circuits shall have their insulation tested after installation and before connection to utilization devices such as fixtures, motors, or appliances.
- B. Tests shall be performed by megger and conductors shall test free from short-circuits and grounds.
- C. Test conductor phase-to-phase and phase-to-ground.
- D. The Contractor shall furnish the instruments, materials, and labor for these tests.

- - - E N D - - -

SECTION 26 05 26
GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This section specifies general grounding and bonding requirements of electrical equipment operations and to provide a low impedance path for possible ground fault currents.
- B. "Grounding electrode system" refers to all electrodes required by NEC, as well as including made, supplementary, lightning protection system grounding electrodes.
- C. The terms "connect" and "bond" are used interchangeably in this specification and have the same meaning.

1.2 RELATED WORK

- A. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: General electrical requirements and items that are common to more than one section of Division 26.
- B. Section 26 05 21, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES (600 VOLTS AND BELOW): Low Voltage power and lighting wiring.

1.3 SUBMITTALS

- A. Submit in accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
- B. Shop Drawings:
 - 1. Sufficient information, clearly presented, shall be included to determine compliance with drawings and specifications.
 - 2. Include the location of system grounding electrode connections and the routing of aboveground and underground grounding electrode conductors.
- C. Test Reports: Provide certified test reports of ground resistance.
- D. Certifications: Two weeks prior to final inspection, submit four copies of the following to the Resident Engineer:
 - 1. Certification that the materials and installation is in accordance with the drawings and specifications.
 - 2. Certification, by the Contractor, that the complete installation has been properly installed and tested.

1.4 APPLICABLE PUBLICATIONS

Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by the basic designation only.

- A. American Society for Testing and Materials (ASTM):
 - B1-2001Standard Specification for Hard-Drawn Copper Wire
 - B8-2004Standard Specification for Concentric-Lay-Stranded Copper
Conductors, Hard, Medium-Hard, or Soft
- B. Institute of Electrical and Electronics Engineers, Inc. (IEEE):
 - 81-1983IEEE Guide for Measuring Earth Resistivity, Ground
Impedance, and Earth Surface Potentials of a Ground System
- C. National Fire Protection Association (NFPA):
 - 70-2011National Electrical Code (NEC)
 - 99-2005Health Care Facilities
- D. Underwriters Laboratories, Inc. (UL):
 - 44-2005Thermoset-Insulated Wires and Cables
 - 83-2003Thermoplastic-Insulated Wires and Cables
 - 467-2004Grounding and Bonding Equipment
 - 486A-486B-2003Wire Connectors

PART 2 - PRODUCTS

2.1 GROUNDING AND BONDING CONDUCTORS

- A. Equipment grounding conductors shall be UL 83 insulated stranded copper, except that sizes 6 mm² (10 AWG) and smaller shall be solid copper. Insulation color shall be continuous green for all equipment grounding conductors, except that wire sizes 25 mm² (4 AWG) and larger shall be permitted to be identified per NEC.
- B. Bonding conductors shall be ASTM B8 bare stranded copper, except that sizes 6 mm² (10 AWG) and smaller shall be ASTM B1 solid bare copper wire.
- C. Isolated Power System: Type XHHW-2 insulation with a dielectric constant of 3.5 or less.
- D. Electrical System Grounding: Conductor sizes shall not be less than what is shown on the drawings and not less than required by the NEC, whichever is greater.

2.2 GROUND RODS

- A. Copper clad steel, 19 mm (3/4-inch) diameter by 3000 mm (10 feet) long, conforming to UL 467.
- B. Quantity of rods shall be as required to obtain the specified ground resistance.

2.3 SPLICES AND TERMINATION COMPONENTS

- A. Components shall meet or exceed UL 467 and be clearly marked with the manufacturer, catalog number, and permitted conductor size(s).

2.4 GROUND CONNECTIONS

- A. Below Grade: Exothermic-welded type connectors.

B. Above Grade:

1. Bonding Jumpers: compression type connectors, using zinc-plated fasteners and external tooth lockwashers.
2. Ground Busbars: Two-hole compression type lugs using tin-plated copper or copper alloy bolts and nuts.
3. Rack and Cabinet Ground Bars: one-hole compression-type lugs using zinc-plated or copper alloy fasteners.

2.5 EQUIPMENT RACK AND CABINET GROUND BARS

- A. Provide solid copper ground bars designed for mounting on the framework of open or cabinet-enclosed equipment racks with minimum dimensions of 4 mm thick by 19 mm wide (3/8 inch x 3/4 inch).

2.6 GROUND TERMINAL BLOCKS

- A. At any equipment mounting location (e.g. backboards and hinged cover enclosures) where rack-type ground bars cannot be mounted, provide screw lug-type terminal blocks.

2.7 SPLICE CASE GROUND ACCESSORIES

- A. Splice case grounding and bonding accessories shall be supplied by the splice case manufacturer when available. Otherwise, use 16 mm² (6 AWG) insulated ground wire with shield bonding connectors.

PART 3 - EXECUTION

3.1 GENERAL

- A. Ground in accordance with the NEC, as shown on drawings, and as hereinafter specified.
- B. System Grounding:
1. Secondary service neutrals: Ground at the supply side of the secondary disconnecting means and at the related transformers.
 2. Separately derived systems (transformers downstream from the service entrance): Ground the secondary neutral.
 3. Isolation transformers and isolated power systems shall not be system grounded.
- C. Equipment Grounding: Metallic structures (including ductwork and building steel), enclosures, raceways, junction boxes, outlet boxes, cabinets, machine frames, and other conductive items in close proximity with electrical circuits shall be bonded and grounded.

3.2 INACCESSIBLE GROUNDING CONNECTIONS

Make grounding connections, which are buried or otherwise normally inaccessible (except connections for which periodic testing access is required) by exothermic weld.

3.3 SECONDARY EQUIPMENT AND CIRCUITS

- A. Main Bonding Jumper: Bond the secondary service neutral to the ground bus in the service equipment.
- B. Metallic Piping, Building Steel, and Supplemental Electrode(s):
 - 1. Provide a grounding electrode conductor sized per NEC between the service equipment ground bus and all metallic water and gas pipe systems, building steel, and supplemental or made electrodes. Jumper insulating joints in the metallic piping. All connections to electrodes shall be made with fittings that conform to UL 467.
 - 2. Provide a supplemental ground electrode and bond to the grounding electrode system.
- C. Service Disconnect (Separate Individual Enclosure): Provide a ground bar bolted to the enclosure with lugs for connecting the various grounding conductors.
- D. Switchgear, Switchboards, Unit Substations, and Motor Control Centers:
 - 1. Connect the various feeder equipment grounding conductors to the ground bus in the enclosure with suitable pressure connectors.
 - 2. For service entrance equipment, connect the grounding electrode conductor to the ground bus.
 - 3. Connect metallic conduits, which terminate without mechanical connection to the housing, by grounding bushings and grounding conductor to the equipment ground bus.
- E. Transformers:
 - 1. Exterior: Exterior transformers supplying interior service equipment shall have the neutral grounded at the transformer secondary. Provide a grounding electrode at the transformer.
 - 2. Separately derived systems (transformers downstream from service equipment): Ground the secondary neutral at the transformer. Provide a grounding electrode conductor from the transformer to the nearest component of the grounding electrode system. Verify existing bonding conductor is adequately sized per NEC from the point of connection to the main grounding electrode. If the existing bonding conductor is undersized then provide new grounding electrode conductor to the ground bar at the service entrance.
- F. Conduit Systems:
 - 1. Ground all metallic conduit systems. All metallic conduit systems shall contain an equipment grounding conductor.
 - 2. Non-metallic conduit systems shall contain an equipment grounding conductor, except that non-metallic feeder conduits which carry a grounded conductor from exterior transformers to interior or building-mounted service entrance equipment need not contain an equipment grounding conductor.

3. Conduit containing only a grounding conductor, and which is provided for mechanical protection of the conductor, shall be bonded to that conductor at the entrance and exit from the conduit.
- G. Feeders and Branch Circuits: Install equipment grounding conductors with all feeders and power and lighting branch circuits.
- H. Boxes, Cabinets, Enclosures, and Panelboards:
1. Bond the equipment grounding conductor to each pullbox, junction box, outlet box, device box, cabinets, and other enclosures through which the conductor passes (except for special grounding systems for intensive care units and other critical units shown).
 2. Provide lugs in each box and enclosure for equipment grounding conductor termination.
 3. Provide ground bars in panelboards, bolted to the housing, with sufficient lugs to terminate the equipment grounding conductors.
- I. Motors and Starters: Provide lugs in motor terminal box and starter housing or motor control center compartment to terminate equipment grounding conductors.
- J. Receptacles shall not be grounded through their mounting screws. Ground with a jumper from the receptacle green ground terminal to the device box ground screw and the branch circuit equipment grounding conductor.
- K. Ground lighting fixtures to the equipment grounding conductor of the wiring system when the green ground is provided; otherwise, ground the fixtures through the conduit systems. Fixtures connected with flexible conduit shall have a green ground wire included with the power wires from the fixture through the flexible conduit to the first outlet box.
- L. Fixed electrical appliances and equipment shall be provided with a ground lug for termination of the equipment grounding conductor.
- M. Panelboard Bonding: The equipment grounding terminal buses of the normal and essential branch circuit panelboards serving the same individual patient vicinity shall be bonded together with an insulated continuous copper conductor not less than 16 mm² (10 AWG). These conductors shall be installed in rigid metal conduit.

3.4 CORROSION INHIBITORS

- A. When making ground and ground bonding connections, apply a corrosion inhibitor to all contact surfaces. Use corrosion inhibitor appropriate for protecting a connection between the metals used.

3.5 CONDUCTIVE PIPING

- A. Bond all conductive piping systems, interior and exterior, to the building to the grounding electrode system. Bonding connections shall be made as close as practical to the equipment ground bus.
- B. In operating rooms and at intensive care and coronary care type beds, bond the gases and suction piping, at the outlets, directly to the room or patient ground bus.

3.6 LIGHTNING PROTECTION SYSTEM

- A. Bond the lightning protection system to the electrical grounding electrode system.

3.7 ELECTRICAL ROOM GROUNDING

- A. Building Earth Ground Busbars: Provide ground busbar hardware at each electrical room and connect to pigtail extensions of the building grounding ring.

3.8 WIREWAY GROUNDING

- A. Ground and Bond Metallic Wireway Systems as follows:
 - 1. Bond the metallic structures of wireway to provide 100 percent electrical continuity throughout the wireway system by connecting a 16 mm² (6 AWG) bonding jumper at all intermediate metallic enclosures and across all section junctions.
 - 2. Install insulated 16 mm² (6 AWG) bonding jumpers between the wireway system bonded as required in paragraph 1 above, and the closest building ground at each end and approximately every 16 meters (50 feet).
 - 3. Use insulated 16 mm² (6 AWG) bonding jumpers to ground or bond metallic wireway at each end at all intermediate metallic enclosures and cross all section junctions.
 - 4. Use insulated 16 mm² (6 AWG) bonding jumpers to ground cable tray to column-mounted building ground plates (pads) at each end and approximately every 15 meters.

3.9 GROUND RESISTANCE

- A. Grounding system resistance to ground shall not exceed 5 ohms. Make necessary modifications or additions to the grounding electrode system for compliance without additional cost to the Government. Final tests shall assure that this requirement is met.
- B. Resistance of the grounding electrode system shall be measured using a four-terminal fall-of-potential method as defined in IEEE 81. Ground resistance measurements shall be made before the electrical distribution system is energized and shall be made in normally dry conditions not less than 48 hours after the last rainfall. Resistance measurements of separate grounding electrode systems shall be made before the systems are bonded together below grade. The combined resistance of separate systems may be used to meet the required resistance, but the specified number of electrodes must still be provided.

- C. Services at power company interface points shall comply with the power company ground resistance requirements.
- D. Below-grade connections shall be visually inspected by the Resident Engineer prior to backfilling. The Contractor shall notify the Resident Engineer 24 hours before the connections are ready for inspection.

3.10 GROUND ROD INSTALLATION

- A. Drive each rod vertically in the earth, not less than 3000 mm (10 feet) in depth.
- B. Where permanently concealed ground connections are required, make the connections by the exothermic process to form solid metal joints. Make accessible ground connections with mechanical pressure type ground connectors.
- C. Where rock prevents the driving of vertical ground rods, install angled ground rods or grounding electrodes in horizontal trenches to achieve the specified resistance.

- - - E N D - - -

SECTION 26 05 33
RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This section specifies the furnishing, installation, and connection of conduit, fittings, and boxes to form complete, coordinated, grounded raceway systems. Raceways are required for all wiring unless shown or specified otherwise.
- B. Definitions: The term conduit, as used in this specification, shall mean any or all of the raceway types specified.

1.2 RELATED WORK

- A. General electrical requirements and items that is common to more than one section of Division 26: Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
- B. Requirements for personnel safety and to provide a low impedance path for possible ground fault currents: Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS.

1.3 SUBMITTALS

In accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES, furnish the following:

- A. Shop Drawings:
 - 1. Size and location of main feeders;
 - 2. Size and location of panels and pull boxes
 - 3. Layout of required conduit penetrations through structural elements.
 - 4. The specific item proposed and its area of application shall be identified on the catalog cuts.
- B. Certification: Prior to final inspection, deliver to the Resident Engineer four copies of the certification that the material is in accordance with the drawings and specifications and has been properly installed.

1.4 APPLICABLE PUBLICATIONS

- A. Publications listed below (including amendments, addenda, revisions, supplements and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by the basic designation only.
- B. National Fire Protection Association (NFPA):
 - 70-11National Electrical Code (NEC)
- C. Underwriters Laboratories, Inc. (UL):
 - 1-03Flexible Metal Conduit

- 5-01Surface Metal Raceway and Fittings
- 50-03Enclosures for Electrical Equipment
- 360-03Liquid-Tight Flexible Steel Conduit
- 467-01Grounding and Bonding Equipment
- 514A-01Metallic Outlet Boxes
- 514B-02Fittings for Cable and Conduit
- 514C-05Nonmetallic Outlet Boxes, Flush-Device Boxes and Covers
- 651-02Schedule 40 and 80 Rigid PVC Conduit
- 651A-03Type EB and A Rigid PVC Conduit and HDPE Conduit
- 797-03Electrical Metallic Tubing
- 1242-00Intermediate Metal Conduit
- D. National Electrical Manufacturers Association (NEMA):
 - TC-3-04.....PVC Fittings for Use with Rigid PVC Conduit and Tubing
 - FB1-03Fittings, Cast Metal Boxes and Conduit Bodies for Conduit,
Electrical Metallic Tubing and Cable

PART 2 - PRODUCTS

2.1 MATERIAL

- A. Conduit Size: In accordance with the NEC, but not less than 13 mm (3/4 inch) unless otherwise shown. Where permitted by the NEC, 13 mm (1/2 inch) flexible conduit may be used for tap connections to recessed lighting fixtures.
- B. Conduit:
 - 1. Rigid galvanized steel: Shall Conform to UL 6, ANSI C80.1.
 - 2. Rigid aluminum: Shall Conform to UL 6A, ANSI C80.5.
 - 3. Rigid intermediate steel conduit (IMC): Shall Conform to UL 1242, ANSI C80.6.
 - 4. Electrical metallic tubing (EMT): Shall Conform to UL 797, ANSI C80.3. Maximum size not to exceed 105 mm (4 inch) and shall be permitted only with cable rated 600 volts or less.
 - 5. Flexible galvanized steel conduit: Shall Conform to UL 1.
 - 6. Liquid-tight flexible metal conduit: Shall Conform to UL 360.
 - 7. Direct burial plastic conduit: Shall conform to UL 651 and UL 651A, heavy wall PVC or high density polyethylene (PE).
 - 8. Surface metal raceway: Shall Conform to UL 5.
- C. Conduit Fittings:
 - 1. Rigid steel and IMC conduit fittings:

- a. Fittings shall meet the requirements of UL 514B and ANSI/ NEMA FB1.
 - a. Standard threaded couplings, locknuts, bushings, and elbows: Only steel or malleable iron materials are acceptable. Integral retractable type IMC couplings are also acceptable.
 - b. Locknuts: Bonding type with sharp edges for digging into the metal wall of an enclosure.
 - c. Bushings: Metallic insulating type, consisting of an insulating insert molded or locked into the metallic body of the fitting. Bushings made entirely of metal or nonmetallic material are not permitted.
 - d. Erickson (union-type) and set screw type couplings: Approved for use in concrete are permitted for use to complete a conduit run where conduit is installed in concrete. Use set screws of case hardened steel with hex head and cup point to firmly seat in conduit wall for positive ground. Tightening of set screws with pliers is prohibited.
 - e. Sealing fittings: Threaded cast iron type. Use continuous drain type sealing fittings to prevent passage of water vapor. In concealed work, install fittings in flush steel boxes with blank cover plates having the same finishes as that of other electrical plates in the room.
2. Rigid aluminum conduit fittings:
- a. Standard threaded couplings, locknuts, bushings, and elbows: Malleable iron, steel or aluminum alloy materials; Zinc or cadmium plate iron or steel fittings. Aluminum fittings containing more than 0.4 percent copper are prohibited.
 - b. Locknuts and bushings: As specified for rigid steel and IMC conduit.
 - c. Set screw fittings: Not permitted for use with aluminum conduit.
3. Electrical metallic tubing fittings:
- a. Fittings shall meet the requirements of UL 514B and ANSI/ NEMA FB1.
 - b. Only steel or malleable iron materials are acceptable.
 - c. Couplings and connectors: Concrete tight and rain tight, with connectors having insulated throats. Use gland and ring compression type couplings and connectors for conduit sizes 50 mm (2 inches) and smaller. Use set screw type couplings with four set screws each for conduit sizes over 50 mm (2 inches). Use set screws of case-hardened steel with hex head and cup point to firmly seat in wall of conduit for positive grounding.
 - d. Indent type connectors or couplings are prohibited.
 - e. Die-cast or pressure-cast zinc-alloy fittings or fittings made of "pot metal" are prohibited.
4. Flexible steel conduit fittings:

- a. Conform to UL 514B. Only steel or malleable iron materials are acceptable.
 - b. Clamp type, with insulated throat.
- 5. Liquid-tight flexible metal conduit fittings:
 - a. Fittings shall meet the requirements of UL 514B and ANSI/ NEMA FB1.
 - b. Only steel or malleable iron materials are acceptable.
 - c. Fittings must incorporate a threaded grounding cone, a steel or plastic compression ring, and a gland for tightening. Connectors shall have insulated throats.
- 6. Direct burial plastic conduit fittings:
 - a. Fittings shall meet the requirements of UL 514C and NEMA TC3.
 - b. As recommended by the conduit manufacturer.
- 7. Surface metal raceway fittings: As recommended by the raceway manufacturer.
- 8. Expansion and deflection couplings:
 - a. Conform to UL 467 and UL 514B.
 - b. Accommodate, 19 mm (0.75 inch) deflection, expansion, or contraction in any direction, and allow 30 degree angular deflections.
 - c. Include internal flexible metal braid sized to guarantee conduit ground continuity and fault currents in accordance with UL 467, and the NEC code tables for ground conductors.
 - d. Jacket: Flexible, corrosion-resistant, watertight, moisture and heat resistant molded rubber material with stainless steel jacket clamps.
- D. Conduit Supports:
 - 1. Parts and hardware: Zinc-coat or provide equivalent corrosion protection.
 - 2. Individual Conduit Hangers: Designed for the purpose, having a pre-assembled closure bolt and nut, and provisions for receiving a hanger rod.
 - 3. Multiple conduit (trapeze) hangers: Not less than 38 mm by 38 mm (1-1/2 by 1-1/2 inch), 12 gage steel, cold formed, lipped channels; with not less than 9 mm (3/8 inch) diameter steel hanger rods.
 - 4. Solid Masonry and Concrete Anchors: Self-drilling expansion shields, or machine bolt expansion.
- E. Outlet, Junction, and Pull Boxes:
 - 1. UL-50 and UL-514A.
 - 2. Cast metal where required by the NEC or shown, and equipped with rustproof boxes.
 - 3. Sheet metal boxes: Galvanized steel, except where otherwise shown.

4. Flush mounted wall or ceiling boxes shall be installed with raised covers so that front face of raised cover is flush with the wall. Surface mounted wall or ceiling boxes shall be installed with surface style flat or raised covers.
- F. Wireways: Equip with hinged covers, except where removable covers are shown.
- G. Modular Sealing System (Exterior Underground Wall Penetrations)
1. Shall be modular, mechanical type.
 2. Inter-locking synthetic rubber links shaped to continuously fill the annular space between the pipe and the wall opening.
 3. Elastomeric element shall be sized and selected per manufacturer's recommendations and have the following properties as designated by ASTM:
 - a. Coloration shall be throughout elastomer for positive field inspection.
 - b. Each link shall have a permanent identification of the size and manufacturer's name molded into it.
- H. Roof Penetration Conduit Seal Device
1. Basis of Design: Roof Products and Systems Corporation
 2. Prefabricated roof curb.
 3. Laminated acrylic coated ABS plastic cover with pre-punched mounting holes and molded sealing ring on a collared opening.
 4. EPDM compression molded rubber cap.

PART 3 - EXECUTION

3.1 PENETRATIONS

- A. Cutting or Holes:
1. Locate holes in advance where they are proposed in the structural sections such as ribs or beams. Obtain the approval of the Resident Engineer prior to drilling through structural sections.
 2. Cut holes through concrete and masonry in new and existing structures with a diamond core drill or concrete saw. Pneumatic hammer, impact electric, hand or manual hammer type drills are not allowed, except where permitted by the Resident Engineer as required by limited working space.
- B. Fire Stop: Where conduits, wireways, and other electrical raceways pass through fire partitions, fire walls, smoke partitions, or floors, install a fire stop that provides an effective barrier against the spread of fire, smoke and gases as specified in Section 07 84 00, FIRESTOPPING, with rock wool fiber or silicone foam sealant only. Completely fill and seal clearances between raceways

and openings with the fire stop material and provide pressure sensitive self-adhesive vinyl identification Labels at all fire/smoke penetrations with the following information:

1. The words "Warning - Through Penetration Firestop System - Do not Disturb, Notify Building Maintenance of Any Damage."
 2. UL classified system number met by installation.
 3. System manufacturer's name, address, and phone number.
 4. Installer's name, address, and phone number.
 5. General contractor's name, address, and phone number.
 6. Date of installation.
- D. Waterproofing: At floor, exterior wall, and roof conduit penetrations, completely seal clearances around the conduit and make watertight using material specified in this section and in Section 07 92 00, JOINT SEALANTS.

3.2 INSTALLATION, GENERAL

- A. In accordance with UL, NEC, as shown, and as hereinafter specified.
- B. Essential (Emergency) raceway systems shall be entirely independent of other raceway systems, except where specifically "accepted" by NEC Article 517.
- C. Install conduit as follows:
 1. In complete runs before pulling in cables or wires.
 2. Flattened, dented, or deformed conduit is not permitted. Remove and replace the damaged conduits with new undamaged material.
 3. Assure conduit installation does not encroach into the ceiling height head room, walkways, or doorways.
 4. Cut square with a hacksaw, ream, remove burrs, and draw up tight.
 5. Mechanically and electrically continuous.
 6. Independently support conduit at 8'0" on center. Do not use other supports i.e., (suspended ceilings, suspended ceiling supporting members, lighting fixtures, conduits, mechanical piping, or mechanical ducts).
 7. Support within 300 mm (1 foot) of changes of direction, and within 300 mm (1 foot) of each enclosure to which connected.
 8. Close ends of empty conduit with plugs or caps at the rough-in stage to prevent entry of debris, until wires are pulled in.
 9. Conduit installations under fume and vent hoods are prohibited.

10. Secure conduits to cabinets, junction boxes, pull boxes and outlet boxes with bonding type locknuts. For rigid and IMC conduit installations, provide a locknut on the inside of the enclosure, made up wrench tight. Do not make conduit connections to junction box covers.
11. Flashing of penetrations of the roof membrane is specified in Section 07 60 00, FLASHING AND SHEET METAL.
12. Do not use aluminum conduits in wet locations.
13. Unless otherwise indicated on the drawings or specified herein, all conduits shall be installed concealed within finished walls, floors and ceilings.

D. Conduit Bends:

1. Make bends with standard conduit bending machines.
2. Conduit hickey may be used for slight offsets, and for straightening stubbed out conduits.
3. Bending of conduits with a pipe tee or vise is prohibited.

E. Layout and Homeruns:

1. Install conduit with wiring, including homeruns, as shown.
2. Deviations: Make only where necessary to avoid interferences and only after drawings showing the proposed deviations have been submitted approved by the Resident Engineer.

3.3 CONCEALED WORK INSTALLATION

A. In Concrete:

1. Conduit: Rigid steel, IMC or EMT. Do not install EMT in concrete slabs that are in contact with soil, gravel or vapor barriers.
2. Align and run conduit in direct lines.
3. Install conduit through concrete beams only when the following occurs:
 - a. Where shown on the structural drawings.
 - b. As approved by the Resident Engineer prior to construction, and after submittal of drawing showing location, size, and position of each penetration.
4. Installation of conduit in concrete that is less than 75 mm (3 inches) thick is prohibited.
 - a. Conduit outside diameter larger than 1/3 of the slab thickness is prohibited.
 - b. Space between conduits in slabs: Approximately six conduit diameters apart, except one conduit diameter at conduit crossings.
 - c. Install conduits approximately in the center of the slab so that there will be a minimum of 19 mm (3/4 inch) of concrete around the conduits.

5. Make couplings and connections watertight. Use thread compounds that are UL approved conductive type to insure low resistance ground continuity through the conduits. Tightening set screws with pliers is prohibited.

B. Furred or Suspended Ceilings and in Walls:

1. Conduit for conductors above 600 volts:
 - a. Rigid steel or rigid aluminum.
 - b. Aluminum conduit mixed indiscriminately with other types in the same system is prohibited.
2. Conduit for conductors 600 volts and below:
 - a. Rigid steel, IMC, rigid aluminum, or EMT. Different type conduits mixed indiscriminately in the same system is prohibited.
3. Align and run conduit parallel or perpendicular to the building lines.
4. Connect recessed lighting fixtures to conduit runs with maximum 1800 mm (six feet) of flexible metal conduit extending from a junction box to the fixture.
5. Tightening set screws with pliers is prohibited.

3.4 EXPOSED WORK INSTALLATION

- A. Unless otherwise indicated on the drawings, exposed conduit is only permitted in mechanical and electrical rooms.
- B. Conduit for conductors above 600 volts:
 1. Rigid steel or rigid aluminum.
 2. Aluminum conduit mixed indiscriminately with other types in the same system is prohibited.
- C. Conduit for Conductors 600 volts and below:
 1. Rigid steel, IMC, rigid aluminum, or EMT. Different type of conduits mixed indiscriminately in the system is prohibited.
- D. Align and run conduit parallel or perpendicular to the building lines.
- E. Install horizontal runs close to the ceiling or beams and secure with conduit straps.
- F. Support horizontal or vertical runs at not over 2400 mm (eight foot) intervals.
- G. Surface metal raceways: Use only where shown.
- H. Painting:
 1. Paint exposed conduit as specified in Section 09 91 00, PAINTING.
 2. Paint all conduits containing cables rated over 600 volts safety orange. Refer to Section 09 91 00, PAINTING for preparation, paint type, and exact color. In addition, paint legends, using 50 mm (two inch) high black numerals and letters, showing the cable voltage rating.

Provide legends where conduits pass through walls and floors and at maximum 6000 mm (20 foot) intervals in between.

3.5 HAZARDOUS LOCATIONS

- A. Use rigid steel conduit only, notwithstanding requirements otherwise specified in this or other sections of these specifications.
- B. Install UL approved sealing fittings, that prevent passage of explosive vapors, in hazardous areas equipped with explosive proof lighting fixtures, switches, and receptacles, as required by the NEC.

3.6 WET OR DAMP LOCATIONS

- A. Unless otherwise shown, use conduits of rigid steel or IMC.
- B. Provide sealing fittings, to prevent passage of water vapor, where conduits pass from warm to cold locations, i.e., (refrigerated spaces, constant temperature rooms, air conditioned spaces building exterior walls, roofs) or similar spaces.
- C. Unless otherwise shown, use rigid steel or IMC conduit within 1500 mm (5 feet) of the exterior and below concrete building slabs in contact with soil, gravel, or vapor barriers. Conduit shall include an outer factory coating of .5 mm (20 mil) bonded PVC or field coat with asphaltum before installation. After installation, completely coat damaged areas of coating.

3.7 MOTORS AND VIBRATING EQUIPMENT

- A. Use flexible metal conduit for connections to motors and other electrical equipment subject to movement, vibration, misalignment, cramped quarters, or noise transmission.
- B. Provide liquid-tight flexible metal conduit for installation in exterior locations, moisture or humidity laden atmosphere, corrosive atmosphere, water or spray wash-down operations, inside (air stream) of HVAC units, and locations subject to seepage or dripping of oil, grease or water. Provide a green ground wire with flexible metal conduit.

3.8 EXPANSION JOINTS

- A. Conduits 75 mm (3 inches) and larger, that are secured to the building structure on opposite sides of a building expansion joint, require expansion and deflection couplings. Install the couplings in accordance with the manufacturer's recommendations.
- B. Provide conduits smaller than 75 mm (3 inches) with junction boxes on both sides of the expansion joint. Connect conduits to junction boxes with sufficient slack of flexible conduit to produce 125 mm (5 inch) vertical drop midway between the ends. Flexible conduit shall have a copper green ground bonding jumper installed. In lieu of this flexible conduit, expansion and

deflection couplings as specified above for 375 mm (15 inches) and larger conduits are acceptable.

- C. Install expansion and deflection couplings where shown.

3.9 CONDUIT SUPPORTS, INSTALLATION

- A. Safe working load shall not exceed 1/4 of proof test load of fastening devices.
- B. Use pipe straps or individual conduit hangers for supporting individual conduits. Maximum distance between supports is 2.5 m (8 foot) on center.
- C. Support multiple conduit runs with trapeze hangers. Use trapeze hangers that are designed to support a load equal to or greater than the sum of the weights of the conduits, wires, hanger itself, and 90 kg (200 pounds). Attach each conduit with U-bolts or other approved fasteners.
- D. Support conduit independently of junction boxes, pull boxes, fixtures, suspended ceiling T-bars, angle supports, and similar items.
- E. Fasteners and Supports in Solid Masonry and Concrete:
 - 1. New Construction: Use steel or malleable iron concrete inserts set in place prior to placing the concrete.
 - 2. Existing Construction:
 - a. Steel expansion anchors not less than 6 mm (1/4 inch) bolt size and not less than 28 mm (1-1/8 inch) embedment.
 - b. Power set fasteners not less than 6 mm (1/4 inch) diameter with depth of penetration not less than 75 mm (3 inches).
 - c. Use vibration and shock resistant anchors and fasteners for attaching to concrete ceilings.
- F. Hollow Masonry: Toggle bolts are permitted.
- G. Bolts supported only by plaster or gypsum wallboard are not acceptable.
- H. Metal Structures: Use machine screw fasteners or other devices specifically designed and approved for the application.
- I. Attachment by wood plugs, rawl plug, plastic, lead or soft metal anchors, or wood blocking and bolts supported only by plaster is prohibited.
- J. Chain, wire, or perforated strap shall not be used to support or fasten conduit.
- K. Spring steel type supports or fasteners are prohibited for all uses except: Horizontal and vertical supports/fasteners within walls.
- L. Vertical Supports: Vertical conduit runs shall have riser clamps and supports in accordance with the NEC and as shown. Provide supports for cable and wire with fittings that include internal wedges and retaining collars.

3.10 BOX INSTALLATION

- A. Boxes for Concealed Conduits:
 - 1. Flush mounted.
 - 2. Provide raised covers for boxes to suit the wall or ceiling, construction and finish.
- B. In addition to boxes shown, install additional boxes where needed to prevent damage to cables and wires during pulling in operations.
- C. Remove only knockouts as required and plug unused openings. Use threaded plugs for cast metal boxes and snap-in metal covers for sheet metal boxes.
- D. Outlet boxes in the same wall mounted back-to-back are prohibited. A minimum 600 mm (24 inch), center-to-center lateral spacing shall be maintained between boxes.)
- E. Minimum size of outlet boxes for ground fault interrupter (GFI) receptacles is 100 mm (4 inches) square by 55 mm (2-1/8 inches) deep, with device covers for the wall material and thickness involved.
- F. Stencil or install phenolic nameplates on covers of the boxes identified on riser diagrams; for example "SIG-FA JB No. 1".
- G. On all Branch Circuit junction box covers, identify the circuits with black marker.

- - - E N D - - -

SECTION 26 05 41 UNDERGROUND ELECTRICAL CONSTRUCTION

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This section specifies the furnishing, installation and connection of underground ducts to form a complete underground raceway system.
- B. “Duct” and “conduit”, and “rigid metal conduit” and “rigid steel conduit are used interchangeably in this specification and have the same meaning.

1.2 RELATED WORK

- A. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: General electrical requirements and items that are common to more than one section of Division 26.
- B. Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS: Conduits, fittings and boxes for raceway systems.
- C. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS: Requirements for personnel safety and to provide a low impedance path for possible ground fault currents.

1.3 SUBMITTALS

- A. Submit in accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
- B. Shop Drawings:
 - 1. Sufficient information, clearly presented, shall be included to determine compliance with drawings and specifications.
- C. Certifications: Two weeks prior to final inspection, submit four copies of the following to the Resident Engineer:
 - 1. Certification that the materials are in accordance with the drawings and specifications.
 - 2. Certification, by the Contractor, that the complete installation has been properly installed and tested.

1.4 APPLICABLE PUBLICATIONS

Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by the basic designation only.

- A. American Concrete Institute (ACI):
Building Code Requirements for Structural Concrete

- 318/318M-2005 Building Code Requirements for Structural Concrete &
Commentary
- SP-66-04 ACI Detailing Manual
- B. American Society for Testing and Materials (ASTM):
- C478/C478M 2006(b) Standard Specification for Precast Reinforced Concrete Manhole
Sections
- C990 REV A 2003 Standard Specification for joints concrete pipe, Manholes and
Precast Box using performed flexible Joint sealants.
- C. Institute of Electrical and Electronic Engineers (IEEE):
- C2-2007 National Electrical Safety Code
- D. National Electrical Manufacturers Association (NEMA):
- RNI 2005 Polyvinyl Chloride (PVC) Externally Coated Galvanized Rigid
Steel Conduit and Intermediate Metal Conduit
- TC 2 2003 Electrical Polyvinyl Chloride (PVC) Tubing And Conduit
- TC 3-2004 PVC Fittings for Use With Rigid PVC Conduit And Tubing
- TC 6 & 8 2003 PVC Plastic Utilities Duct For Underground Installations
- TC 9-2004 Fittings For PVC Plastic Utilities Duct For Underground
Installation
- E. National Fire Protection Association (NFPA):
- 70 2011 National Electrical Code (NEC)
- F. Underwriters Laboratories, Inc. (UL):
- 6-2004 Electrical Rigid Metal Conduit-Steel
- 467-2004 Standard for Grounding and Bonding Equipment
- 651-2005 Standard for Schedule 40 and 80 Rigid PVC Conduit and
Fittings
- 651A-2003 Type EB and A Rigid PVC Conduit and HDPE Conduit,
(RTRC)
- 651B-2002 Continuous Length HDPE Conduit
- G. U.S. General Services Administration (GSA):
- SS-S-210A-1981 Sealing Compound, Preformed Plastic for Expansion joints And
Pipe Joints

PART 2 - PRODUCTS

2.1 DUCTS:

- A. Number and sizes shall be as shown on drawings.

B. Ducts (concrete encased):

1. Plastic Duct:
 - a. UL 651 and 651A Schedule 40 PVC.
 - b. Duct shall be suitable for use with 90 degree C rated conductors.
2. Conduit Spacers: Prefabricated plastic.

C. Ducts (direct burial):

1. Plastic duct:
 - a. NEMA TC2 and TC3
 - b. UL 651, 651A and 651B, Schedule 40 PVC or HDPE.
 - c. Duct shall be suitable for use with 75 degree C rated conductors.
2. Rigid metal conduit, PVC-coated: UL6 and NEMA RN1 galvanized rigid steel, threaded type, coated with PVC sheath bonded to the galvanized exterior surface, nominal 1 mm (0.040 inch) thick.

2.2 GROUNDING

- A. Rods: Per Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS and UL 467
- B. Ground Wire: Stranded bare copper 16 mm² (6 AWG) minimum.

2.3 WARNING TAPE:

Standard 4-mil polyethylene 76 mm (3 inch) wide tape, detectable type, red with black letters, imprinted with "CAUTION BURIED ELECTRIC CABLE BELOW".

2.4 PULL ROPE:

Plastic with 890N (200 pound) minimum tensile strength.

PART 3 - EXECUTION

3.1 TRENCHING

- A. Work with extreme care near existing ducts, conduits, cables, and other utilities to avoid damaging them. Verify all existing utility locations and depths by hand excavation.
- B. Cut the trenches neatly and uniformly.
- C. For Concrete Encased Ducts:
 1. After excavation of the trench, stakes shall be driven in the bottom of the trench at 1200 mm (4 foot) intervals to establish the grade and route of the duct bank.
 2. Pitch the trenches uniformly towards manholes or both ways from high points between manholes for the required duct line drainage. Avoid pitching the ducts towards buildings wherever possible.

3. The walls of the trench may be used to form the side walls of the duct bank provided that the soil is self-supporting and that concrete envelope can be poured without soil inclusions.
Forms are required where the soil is not self-supporting.
 4. After the concrete encased duct has sufficiently cured, the trench shall be backfilled to grade with earth, with appropriate warning tape attached.
- D. Conduits to be installed under existing paved areas, roads, and railroad tracks that are not to be disturbed shall be jacked into place. Conduits shall be PVC-coated rigid metal.

3.2 DUCT INSTALLATION

A. General Requirements:

1. Ducts shall be in accordance with the NEC and IEEE C2, as shown on the drawings, and as specified.
2. Slope ducts to drain towards manholes and handholes, and away from building and equipment entrances. Pitch not less than 100 mm (4 inches) in 30 M (100 feet).
3. Underground conduit stub-ups and sweeps to equipment inside of buildings shall be PVC-coated galvanized rigid steel, and shall extend a minimum of 1500 mm (5 feet) outside of building foundation.
4. Stub-ups, sweeps, and risers to equipment mounted on outdoor concrete slabs shall be PVC-coated galvanized rigid steel, and shall extend a minimum of 1500 mm (5 feet) away from edge of slab.
5. Install insulated grounding bushings on the terminations.
6. PVC-coated rigid steel conduits shall be coupled to the ducts with suitable adapters, and the whole encased with 75 mm (3 inches) of concrete.
7. PVC coated rigid steel conduit turns of direction for all duct lines shall have minimum 1200 mm (4 feet) radius in the horizontal and vertical directions. PVC conduit sweeps for all duct lines shall have a minimum 12000 mm (40 feet) radius in the horizontal and 1200 mm (4 feet) in the vertical directions. Where a 12000 mm (40 feet) radius is not possible, horizontal turns of direction shall be rigid steel.
8. All multiple conduit runs shall have conduit spacers. Spacers shall securely support and maintain uniform spacing of the duct assembly a minimum of 75 mm (3 inches) above bottom of trench during the concrete pour. Spacer spacing shall not exceed 1500 mm (5 feet).
9. Duct lines shall be installed no less than 300 mm (12 inches) from other utility systems, such as water, sewer, and chilled water.
10. Clearances between individual ducts:

- a. For like services, not less than 75 mm (3 inches).
 - b. For power and signal services, not less than 150 mm (6 inches).
 - c. Provide plastic spacers to maintain clearances.
 - d. Provide nonferrous tie wires to prevent displacement of the ducts during pouring of concrete. Tie wires shall not act as substitute for spacers.
- 11. Duct lines shall terminate at window openings in manhole walls as shown on the drawings. All ducts shall be fitted with end bells.
 - 12. Couple the ducts with proper couplings. Stagger couplings in rows and layers to insure maximum strength and rigidity of the duct bank.
 - 13. Keep ducts clean of earth, sand, or gravel during construction, and seal with tapered plugs upon completion of each portion of the work.
- B. Concrete Encased Ducts and Conduits:
- 1. Install concrete encased ducts for medium and high voltage systems, low voltage systems, and signal systems unless otherwise shown on the drawings.
 - 2. Duct lines shall consist of single or multiple duct assemblies encased in concrete. Ducts shall be uniform in size and material throughout the installation.
 - 3. Tops of concrete-encased ducts shall be:
 - a. Not less than 600 mm (24 inches) and not less than shown on the drawings, below finished grade.
 - b. Not less than 750 mm (30 inches) and not less than shown on the drawings, below roads and other paved surfaces.
 - c. Conduits crossing under grade slab construction joints shall be installed a minimum of 1200 mm (4 feet) below slab.
 - 4. Extend the concrete envelope encasing the ducts not less than 75 mm (3 inches) beyond the outside walls of the outer ducts and conduits.
 - 5. Within 3000 mm (10 feet) of building, manhole and handhole wall penetrations, install reinforcing steel bars at the top and bottom of each concrete envelope to provide protection against vertical shearing.
 - 6. Install reinforcing steel bars at the top and bottom of each concrete envelope of all ducts underneath roadways and parking areas.
 - 7. Where new ducts, conduits, and concrete envelopes are to be joined to existing manholes, handholes, ducts, conduits, and concrete envelopes, make the joints with the proper fittings and fabricate the concrete envelopes to insure smooth durable transitions.

8. Conduit joints in concrete may be placed side by side horizontally but shall be staggered at least 150 mm (6 inches) vertically.
9. For medium voltage duct bank installations, a grounding conductor shall be extend along all electrical duct banks including stubs through each electrical distribution system manhole and to each transformer and switching-station installation.
10. Duct Bank Markers:
 - a. Duct bank markers, where required, shall be located at the ends of duct banks except at manholes or handholes at approximately every 60 meter (200 feet) along the duct run and at each change in direction of the duct run. Markers shall be placed 600 mm (2 feet) to the right of the duct bank, facing the longitudinal axis of the run in the direction of the electrical load.
 - b. The letter "D" with two arrows shall be impressed or cast on top of the marker. One arrow shall be located below the letter and shall point toward the ducts. Second arrow shall be located adjacent to the letter and shall point in a direction parallel to the ducts. The letter and arrow adjacent to it shall each be approximately 75 mm (2-inches) long. The letter and arrows shall be V-shaped, and shall have a width of stroke at least 6 mm (1/4 inch) at the top and a depth of 6 mm (1/4 inch).
 - c. In paved areas, the top of the duct markers shall be flush with the finished surface of the paving.
 - d. Where the duct bank changes direction, the arrow located adjacent to the letter shall be cast or impressed with an angle in the arrow the same as the angular change of the duct bank.

C. Direct Burial Duct and Conduits:

1. Install direct burial ducts and conduits only where shown on the drawings.
2. Join and terminate ducts and conduits with fittings recommended by conduit manufacturer.
3. Direct burial ducts and conduits are prohibited under railroad tracks.
4. Tops of ducts and conduits shall be:
 - a. Not less than 600 mm (24 inches) and not less than shown on the drawings, below finished grade.
 - b. Not less than 750 mm (30 inches) and not less than shown on the drawings, below roads and other paved surfaces.
5. Do not kink the ducts or conduits.

- D. Concrete-Encased and Direct Burial Duct and Conduit Identification: Place continuous strip of warning tape approximately 300 mm (12 inches) above ducts or conduits before backfilling trenches. Warning tape shall be preprinted with proper identification.
- E. Spare Ducts and Conduits: Where spare ducts are shown, they shall have a nylon pull rope installed. They shall be capped at each end and labeled as to location of the other end.
- F. Duct and Conduit Cleaning:
1. Upon completion of the duct bank installation or installation of direct buried ducts, a standard flexible mandrel shall be pulled through each duct to loosen particles of earth, sand, or foreign material left in the line. The mandrel shall be not less than 3600 mm (12 inches) long, and shall have a diameter not less than 13 mm (1/2 inch) less than the inside diameter of the duct. A brush with stiff bristles shall then be pulled through each duct to remove the loosened particles. The diameter of the brush shall be the same as, or slightly larger than the diameter of the duct.
 2. Mandrel pulls shall be witnessed by the Resident Engineer.
- G. Duct and Conduit Sealing: Seal the ducts and conduits at building entrances, and at outdoor terminations for equipment, with a suitable non-hardening compound to prevent the entrance of moisture and gases.
- H. Connections to Manholes: Duct bank envelopes connecting to underground structures shall be flared to have enlarged cross-section at the manhole entrance to provide additional shear strength. Dimensions of the flared cross-section shall be larger than the corresponding manhole opening dimensions by no less than 300 mm (12 inches) in each direction. Perimeter of the duct bank opening in the underground structure shall be flared toward the inside or keyed to provide a positive interlock between the duct bank and the wall of the structure. Use vibrators when this portion of the encasement is poured to assure a seal between the envelope and the wall of the structure.
- I. Connections to Existing Manholes: For duct bank connections to existing structures, break the structure wall out to the dimensions required and preserve steel in the structure wall. Cut steel and extend into the duct bank envelope. Chip the perimeter surface of the duct bank opening to form a key or flared surface, providing a positive connection with the duct bank envelope.
- J. Connections to Existing Ducts: Where connections to existing duct banks are indicated, excavate around the duct banks as necessary. Cut off the duct banks and remove loose concrete from the conduits before installing new concrete-encased ducts. Provide a reinforced concrete collar, poured monolithically with the new duct bank, to take the shear at the joint of the duct banks.

- K. Partially Completed Duct Banks: During construction wherever a construction joint is necessary in a duct bank, prevent debris such as mud and dirt from entering ducts by providing suitable conduit plugs. Fit concrete envelope of a partially completed duct bank with reinforcing steel extending a minimum of 600 mm (2 feet) back into the envelope and a minimum of 600 mm (2 feet) beyond the end of the envelope. Provide one No. 4 bar in each corner, 75 mm (3 inches) from the edge of the envelope. Secure corner bars with two No. 3 ties, spaced approximately 300 mm (1 foot) apart. Restrain reinforcing assembly from moving during pouring of concrete.

- - - E N D - - -

SECTION 26 09 14
ELECTRICAL POWER MONITORING

PART 1 GENERAL

1.1 DISCRIPTION

- A. Instrument transformers.
- B. Meters and meter switches and relays.

1.2 REFERENCE STANDARDS

- A. ANSI C12.1 - American National Standard Code for Electricity Metering.
- B. IEEE C12.1 - American National Standard Code for Electricity Metering; Institute of Electrical and Electronic Engineers.
- C. NFPA 70 - National Electrical Code; National Fire Protection Association.

1.3 SUBMITTALS

- A. Product Data: Provide electrical ratings, adjustment ranges, enclosure type, outline dimensions, mounting dimensions, and terminal connection information.
- B. Manufacturer's Installation Instructions: Indicate application conditions and limitations of use stipulated by product testing agency. Include instructions for storage, handling, protection, examination, preparation, installation, and starting of product.

1.4 QUALITY ASSURANCE

- A. Conform to requirements of NFPA 70.
- B. Products: Furnish products listed and classified by Underwriters Laboratories Inc. as suitable for purpose specified and indicated.

PART 2 PRODUCTS

2.1 POWER MONITORS

- A. Electronic meter.
- B. Mounting height: 42" to 60" AFF.
- C. Three phase, 4 wire and Three phase, 3 wire as identified on Drawings.
- D. Measurements include:
 - 1. Voltage.
 - 2. Current.
 - 3. Power.
 - 4. Energy (Watt-Hours).
 - 5. Peak power demand.
 - 6. Total harmonic distortion.

7. Power factor.
8. All measurements total and per phase.
9. Measure current, voltage, power and energy simultaneously.

2.2 POWER MONITOR TRANSFORMERS

- A. Provide metering transformers compatible with monitor.

PART 3 EXECUTION

3.1 INSTALLATION

- A. Install in accordance with manufacturer's instructions.
- B. Provide NEC required fuse protection for potential transformers.
- B. Install on Panelboards as shown on Electrical One-Line Drawings.

--- E N D ---

SECTION 26 09 23 LIGHTING CONTROLS

PART 1 - GENERAL

1.1 DESCRIPTION

This section specifies the furnishing, installation and connection of the lighting controls.

1.2 RELATED WORK

- A. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: General requirements that are common to more than one section of Division 26.
- B. Section 26 05 21, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES (600 VOLTS AND BELOW): Cables and wiring.
- C. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS: Requirements for personnel safety and to provide a low impedance path to ground for possible ground fault currents.
- D. Section 26 24 16, PANELBOARDS: panelboard enclosure and interior bussing used for lighting control panels.
- E. Section 26 27 26, WIRING DEVICES: Wiring devices used for control of the lighting systems.

1.3 QUALITY ASSURANCE

Refer to Paragraph, QUALIFICATIONS, in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

1.4 SUBMITTALS

- A. In accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS, submit the following:
- B. Product Data: For each type of lighting control, submit the following information.
 - 1. Manufacturer's catalog data.
 - 2. Wiring schematic and connection diagram.
 - 3. Installation details.
- C. Manuals:
 - 1. Submit, simultaneously with the shop drawings companion copies of complete maintenance and operating manuals including technical data sheets, and information for ordering replacement parts.
 - 2. Two weeks prior to the final inspection, submit four copies of the final updated maintenance and operating manuals, including any changes, to the Resident Engineer.
- D. Certifications:

1. Two weeks prior to final inspection, submit four copies of the following certifications to the Resident Engineer:
 - a. Certification by the Contractor that the equipment has been properly installed, adjusted, and tested.

1.5 APPLICABLE PUBLICATIONS

- A. Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by designation only.
- B. Green Seal (GS):
 - GC-12.....Occupancy Sensors
- C. Illuminating Engineering Society of North America (IESNA):
 - IESNA LM-48.....Guide for Calibration of Photoelectric Control Devices
- D. National Electrical Manufacturer's Association (NEMA)
 - C136.10.....American National Standard for Roadway Lighting Equipment-
Locking-Type Photocontrol Devices and Mating Receptacles -
Physical and Electrical Interchangeability and Testing
 - ICS-1Standard for Industrial Control and Systems General Requirements
 - ICS-2.....Standard for Industrial Control and Systems: Controllers,
Contractors, and Overload Relays Rated Not More than 2000
Volts AC or 750 Volts DC: Part 8 - Disconnect Devices for Use
in Industrial Control Equipment
 - ICS-6.....Standard for Industrial Controls and Systems Enclosures
- E. Underwriters Laboratories, Inc. (UL):
 - 20Standard for General-Use Snap Switches
 - 773Standard for Plug-In Locking Type Photocontrols for Use with
Area Lighting
 - 773ANonindustrial Photoelectric Switches for Lighting Control
 - 98Enclosed and Dead-Front Switches
 - 917.....Clock Operated Switches

PART 2 - PRODUCTS

2.1 OUTDOOR PHOTOELECTRIC SWITCHES

- A. Solid state, with SPST dry contacts rated for 1800 VA tungsten or 1000 VA inductive, complying with UL 773A.

1. Light-Level Monitoring Range: 1.5 to 10 fc [16.14 to 108 lx], with adjustable turn-on and turn-off levels.
2. Time Delay: 15-second minimum.
3. Surge Protection: Metal-oxide varistor.
4. Mounting: Twist lock, with base-and-stem mounting or stem-and-swivel mounting accessories as required.

2.2 CEILING-MOUNTED PHOTOELECTRIC SWITCHES

- A. Solid-state, light-level sensor unit, with separate relay unit.
 1. Sensor Output: Contacts rated to operate the associated relay. Sensor shall be powered from the relay unit.
 2. Relay Unit: Dry contacts rated for 20A ballast load at 120V and 277V, for 13A tungsten at 120V, and for 1 hp at 120V.
 3. Monitoring Range: 10 to 200 fc [108 to 2152 lx], with an adjustment for turn-on and turn-off levels.
 4. Time Delay: Adjustable from 5 to 300 seconds, with deadband adjustment.
 5. Indicator: Two LEDs to indicate the beginning of on-off cycles.

2.3 INDOOR OCCUPANCY SENSORS

- A. Wall- or ceiling-mounting, solid-state units with a power supply and relay unit, suitable for the environmental conditions in which installed.
 1. Operation: Unless otherwise indicated, turn lights on when covered area is occupied and off when unoccupied; with a 1 to 30 minute adjustable time delay for turning lights off.
 2. Sensor Output: Contacts rated to operate the connected relay. Sensor shall be powered from the relay unit.
 3. Relay Unit: Dry contacts rated for 20A ballast load at 120V and 277V, for 13A tungsten at 120V, and for 1 hp at 120V.
 4. Mounting:
 - a. Sensor: Suitable for mounting in any position on a standard outlet box.
 - b. Time-Delay and Sensitivity Adjustments: Recessed and concealed behind hinged door.
 5. Indicator: LED, to show when motion is being detected during testing and normal operation of the sensor.
 6. Bypass Switch: Override the on function in case of sensor failure.
 7. Manual/automatic selector switch.

8. Automatic Light-Level Sensor: Adjustable from 2 to 200 fc [21.5 to 2152 lx]; keep lighting off when selected lighting level is present.
 9. Faceplate for Wall-Switch Replacement Type: Refer to wall plate material and color requirements for toggle switches, as specified in Section 26 27 26, WIRING DEVICES.
- B. Dual-technology Type: Ceiling mounting; combination PIR and ultrasonic detection methods, field-selectable.
1. Sensitivity Adjustment: Separate for each sensing technology.
 2. Detector Sensitivity: Detect occurrences of 6-inch [150mm] minimum movement of any portion of a human body that presents a target of not less than 36 sq. in. [232 sq. cm], and detect a person of average size and weight moving not less than 12 inches [305 mm] in either a horizontal or a vertical manner at an approximate speed of 12 inches/s [305 mm/s].
 3. Detection Coverage: As required for full coverage from locations identified on drawings.

PART 3 - EXECUTION

3.1 INSTALLATION:

- A. Installation shall be in accordance with the NEC, manufacturer's instructions and as shown on the drawings or specified.
- B. Aim outdoor photocell switch according to manufacturer's recommendations. Set adjustable window slide for 1 footcandle photocell turn-on.
- C. Aiming for wall-mounted and ceiling-mounted motion sensor switches shall be per manufacturer's recommendations.
- D. Set occupancy sensor "on" duration to 30 minutes.
- E. Locate light level sensors as indicated and in accordance with the manufacturer's recommendations. Adjust sensor for the scheduled light level at the typical work plane for that area.

3.2 ACCEPTANCE CHECKS AND TESTS

- A. Perform in accordance with the manufacturer's recommendations.
- B. Upon completion of installation, conduct an operating test to show that equipment operates in accordance with requirements of this section.
- C. Test for full range of dimming ballast and dimming controls capability. Observe for visually detectable flicker over full dimming range.
- D. Test occupancy sensors for proper operation. Observe for light control over entire area being covered.

- F. Upon completion of the installation, the system shall be commissioned by the manufacturer's factory-authorized technician who will verify all adjustments and sensor placements.//

3.3 FOLLOW-UP VERIFICATION

Upon completion of acceptance checks and tests, the Contractor shall show by demonstration in service that the lighting control devices are in good operating condition and properly performing the intended function.

--- E N D ---

SECTION 26 22 00
LOW-VOLTAGE TRANSFORMERS

PART 1 – GENERAL

1.1 DESCRIPTION

This section specifies the furnishing, installation and connection of the dry type general-purpose transformers.

1.2 RELATED WORK

- A. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: General electrical requirements and items that are common to more than one section of Division 26.
- B. Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS: Conduits and outlet boxes.
- C. Section 26 05 21, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES (600 VOLTS AND BELOW): Cables and wiring.
- D. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS: Requirements for personnel safety and to provide a low impedance path for possible ground fault currents.

1.3 SUBMITTALS

- A. In accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS, submit the following:
- B. Shop Drawings:
 - 1. Sufficient information, clearly presented, shall be included to determine compliance with drawings and specifications.
 - 2. Include electrical ratings, impedance, dimensions, weight, mounting details, decibel rating, terminations, temperature rise, no load and full load losses, and connection diagrams.
 - 3. Complete nameplate data including manufacturer's name and catalog number.
- C. Manuals:
 - 1. Submit, simultaneously with the shop drawings, companion copies of complete maintenance and operating manuals including technical data sheets and wiring diagrams.
 - 2. If changes have been made to the originally submitted maintenance and operating manuals, then two weeks prior to final inspection submit four copies of updated maintenance and operating manuals to the Resident Engineer.
- D. Certifications: Two weeks prior to the final inspection, submit four copies of the following to the Resident Engineer:

1. Certification by the manufacturer that the transformers conform to the requirements of the drawings and specifications.
2. Certification that the equipment has been properly installed and tested.

1.4 APPLICABLE PUBLICATIONS

- A. Publications listed below (including amendments, addenda, revisions, supplements and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by designation only.
- B. National Fire Protection Association (NFPA):
70-11National Electrical Code (NEC)
- C. National Electrical Manufacturers Association (NEMA):
ST 20-97Dry-Type Transformers for General Applications

PART 2 - PRODUCTS

2.1 GENERAL PURPOSE DRY TYPE TRANSFORMERS

- A. Unless otherwise specified, dry type transformers shall be in accordance with NEMA, NEC and as shown on the drawings. Transformers shall be UL listed or labeled.
- B. Dry type transformers shall have the following features:
 1. Self-cooled by natural convection, isolating windings, indoor, dry type. Autotransformers will not be accepted.
 2. Rating and winding connections shall be as shown on the drawings.
 3. Transformers shall have copper windings.
 4. Ratings shown on the drawings are for continuous-duty without the use of cooling fans.
 5. Insulation systems:
 - a. Transformers 30 KVA and larger: UL rated 220 degrees C system having an average maximum rise by resistance of 115 degrees C in a maximum ambient of 40 degrees C.
 - b. Transformers below 30 KVA: Same as for 30 KVA and larger or UL rated 185 degrees C system having an average maximum rise by resistance of 115 degrees C in a maximum ambient of 40 degrees C.
 6. Core and coil assemblies:
 - a. Rigidly braced to withstand the stresses caused by short circuit currents and rough handling during shipment.
 - b. Cores shall be grain oriented, non-aging, and silicon steel.
 - c. Coils shall be continuous windings without splices except for taps.
 - d. Coil loss and core loss shall be minimum for efficient operation.

- e. Primary and secondary tap connections shall be brazed or pressure type.
 - f. Coil windings shall have end fillers or tie downs for maximum strength.
7. Certified sound levels determined in accordance with NEMA, shall not exceed the following:

Transformer Rating	Sound Level Rating
0 - 9 KVA	40 dB
10 - 50 KVA	45 dB
51 - 150 KVA	50 dB
151 - 300 KVA	55 dB
301 - 500 KVA	60 dB

- 8. Nominal impedance shall be as shown on the drawings. If not shown on drawings, nominal impedance shall be as permitted by NEMA.
- 9. Single phase transformers rated 15 KVA through 25 KVA shall have two, 5 percent full capacity taps below normal rated primary voltage. All transformers rated 30 KVA and larger shall have two, 2-1/2 percent full capacity taps above, and four, 2-1/2 percent full capacity taps below normal rated primary voltage.
- 10. Core assemblies shall be grounded to their enclosures by adequate flexible ground straps.
- 11. Enclosures:
 - a. Not less than code gage steel.
 - b. Outdoor enclosures shall be NEMA 3R.
 - c. Temperature rise at hottest spot shall conform to NEMA Standards, and shall not bake and peel off the enclosure paint after the transformer has been placed in service.
 - d. Ventilation openings shall prevent accidental access to live components.
 - e. Thoroughly clean and paint enclosure at the factory with manufacturer's prime coat and standard finish.
- 12. Standard NEMA features and accessories including ground pad, lifting provisions and nameplate with the wiring diagram and sound level indicated on it.
- 13. Dimensions and configurations shall conform to the spaces designated for their installations.
- 14. Transformers shall meet the minimum energy efficiency values per NEMA TP1 as listed below:

kVA Rating	Output efficiency (%)
15	97
30	97.5
45	97.7
75	98
112.5	98.2
150	98.3
225	98.5
300	98.6
500	98.7
750	98.8

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Installation of transformers shall be in accordance with the NEC, as recommended by the equipment manufacturer and as shown on the drawings.
- B. Install the transformers with adequate clearance at a minimum of 100 mm (4 inches) from wall and adjacent equipment for air circulation to remove the heat produced by transformers.
- C. Install transformers on vibration pads designed to suppress transformer noise and vibrations.
- D. Use flexible metal conduit to enclose the conductors from the transformer to the raceway systems.

3.2 SPARE PARTS

- A. Deliver the following spare parts for the project to the Resident Engineer two weeks prior to final inspection:
 - 1. Six stand-off insulators.
 - 2. Six insulated protective caps.

--- E N D ---

SECTION 26 24 16 PANELBOARDS

PART 1 - GENERAL

1.1 DESCRIPTION

This section specifies the furnishing, installation and connection of panelboards.

1.2 RELATED WORK

- A. Section 09 91 00, PAINTING: Identification and painting of panelboards.
- B. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: General electrical requirements and items that are common to more than one Section of Division 26.
- C. Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS: Conduits and outlet boxes.
- D. Section 26 05 21, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES (600 VOLTS AND BELOW): Cables and wiring.
- E. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS: Requirements for personnel safety and to provide a low impedance path for possible ground fault currents.

1.3 SUBMITTALS

- A. Submit in accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
- B. Shop Drawings:
 - 1. Sufficient information, clearly presented, shall be included to determine compliance with drawings and specifications.
 - 2. Include electrical ratings, dimensions, mounting details, materials, wiring diagrams accessories and weights of equipment. Complete nameplate data including manufacturer's name and catalog number.
- C. Certification: Two weeks prior to final inspection, submit four copies of the following to the Resident Engineer:
 - 1. Certification that the material is in accordance with the drawings and specifications has been properly installed, and that the loads are balanced.

1.4 APPLICABLE PUBLICATIONS

Publications listed below (including amendments, addenda, revisions, supplements and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by the basic designation only.

- A. National Electrical Manufacturers Association (NEMA):

PB-1-2006.....Panelboards

AB-1-2002Molded Case Circuit Breakers, Molded Case Switches and
Circuit Breaker Enclosures

B. National Fire Protection Association (NFPA):

70-2011National Electrical Code (NEC)

70E-2009.....Standard for Electrical Life Safety in the Workplace

C. Underwriters Laboratories, Inc. (UL):

50-2003Enclosures for Electrical Equipment

67-2003Panel boards

489-2006Molded Case Circuit Breakers and Circuit Breaker Enclosures

PART 2 - PRODUCTS

2.1 PANELBOARDS

- A. Panelboards shall be in accordance with UL, NEMA, NEC, and as shown on the drawings.
- B. Panelboards shall be standard manufactured products. All components of the panelboards shall be the product and assembly of the same manufacturer. All similar units of all panelboards to be of the same manufacturer.
- C. All panelboards shall be hinged “door in door” type with:
 1. Interior hinged door with hand operated latch or latches as required to provide access to circuit breaker operating handles only, not to energized ports.
 2. Outer hinged door shall be securely mounted to the panelboard box with factory bolts, screws, clips or other fasteners requiring a tool for entry, hand operated latches are not acceptable.
 3. Push inner and outer doors shall open left to right.
- D. All panelboards shall be completely factory assembled with molded case circuit breakers. Include one-piece removable, inner dead front cover independent of the panelboard cover.
- E. Panelboards shall have main breaker or main lugs, bus size, voltage, phase, top or bottom feed, and flush or surface mounting as scheduled on the drawings.
- F. Panelboards shall conform to NEMA PB-1, NEMA AB-1 and UL 67 and have the following features:
 1. Nonreduced size copper bus bars, complete with current ratings as shown on the panel schedules connection straps bolted together and rigidly supported on molded insulators.
 2. Bus bar connections to the branch circuit breakers shall be the “distributed phase” or “phase sequence” type. Single-phase, three-wire panelboard busing shall be such that when any two adjacent single-pole breakers are connected to opposite phases, two-pole breakers can be

- installed in any location. Three-phase, four-wire busing shall be such that when any three adjacent single-pole breakers are individually connected to each of the three different phases, two-or three-pole breakers can be installed at any location. Current-carrying parts of the bus assembly shall be plated. Mains ratings shall be as shown.
3. Mechanical lugs furnished with panelboards shall be cast, stamped or machined metal alloys of sizes suitable for the conductors indicated to be connected thereto.
 4. Neutral bus shall be 100% rated, mounted on insulated supports.
 5. Grounding bus bar equipped with screws or lugs for the connection of grounding wires.
 6. Buses braced for the available short circuit current, but not less than 22,000 amperes symmetrical for 120/208 volt and 120/240 volt panelboards, and 14,000 amperes symmetrical for 277/480-volt panelboards.
 7. Branch circuit panels shall have buses fabricated for bolt-on type circuit breakers.
 8. Protective devices shall be designed so that they can be easily replaced.
 9. Where designated on panel schedule "spaces", include all necessary bussing, device support and connections. Provide blank cover for each space.
 10. In two section panelboards, the main bus in each section shall be full size. The first section shall be furnished with subfeed lugs on the line side of main lugs only, or through-feed lugs for main breaker type panels, and with cable connections to the second section. Panelboard sections with tapped bus or crossover bus are not acceptable.
 11. Series rated panelboards are not permitted.

2.2 CABINETS AND TRIMS

A. Cabinets:

1. Provide galvanized steel cabinets to house panelboards. Cabinets for outdoor panels shall be factory primed and suitably treated with a corrosion-resisting paint finish meeting UL 50 and UL 67.
2. Cabinet enclosure shall not have ventilating openings.
3. Cabinets for panelboards may be of one-piece formed steel or of formed sheet steel with end and side panels welded, riveted, or bolted as required.

2.3 MOLDED CASE CIRCUIT BREAKERS FOR PANELBOARDS

- A. Breakers shall be UL 489 listed and labeled, in accordance with the NEC, as shown on the drawings, and as specified.
- B. Circuit breakers in panelboards shall be bolt on type on phase bus bar or branch circuit bar.
 1. Molded case circuit breakers for lighting and appliance branch circuit panelboards shall have minimum interrupting rating as indicated on schedule but not less than:

- a. 120/208 Volt Panelboard: 22,000 amperes symmetrical.
 - b. 120/240 Volt Panelboard: 22,000 amperes symmetrical.
 - c. 277/480 Volt Panelboard: 14,000 amperes symmetrical.
- 2. Molded case circuit breakers shall have automatic, trip free, non-adjustable, inverse time, and instantaneous magnetic trips for 100-ampere frame or less. Magnetic trip shall be adjustable from 3X to 10X for breakers with 600 ampere frames and higher.
- C. Breaker features shall be as follows:
 - 1. A rugged, integral housing of molded insulating material.
 - 2. Silver alloy contacts.
 - 3. Arc quenchers and phase barriers for each pole.
 - 4. Quick-make, quick-break, operating mechanisms.
 - 5. A trip element for each pole, thermal magnetic type with long time delay and instantaneous characteristics, a common trip bar for all poles and a single operator.
 - 6. Electrically and mechanically trip free.
 - 7. An operating handle which indicates ON, TRIPPED, and OFF positions.
 - a. Line connections shall be bolted.
 - b. Interrupting rating shall not be less than the maximum short circuit current available at the line terminals as indicated on the drawings.
 - 8. An overload on one pole of a multipole breaker shall automatically cause all the poles of the breaker to open.
 - 9. Shunt trips shall be provided where indicated
 - 10. For circuit breakers being added to existing panelboards, coordinate the breaker type with existing panelboards. Modify the panel directory.

2.4 SEPARATELY ENCLOSED MOLDED CASE CIRCUIT BREAKERS

- A. Where separately enclosed molded case circuit breakers are shown on the drawings, provide circuit breakers in accordance with the applicable requirements of those specified for panelboards.
- B. Enclosures are to be of the NEMA types shown on the drawings. Where the types are not shown, they are to be the NEMA type most suitable for the environmental conditions where the breakers are being installed.
- C. Provide shunt trips on circuit breakers identified in Elevator Equipment rooms.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Installation shall be in accordance with the Manufacturer's instructions, the NEC, as shown on the drawings, and as specified.
- B. Locate panelboards so that the present and future conduits can be conveniently connected. Coordinate the sizes of cabinets with designated closet space.
- C. In accordance with Section 09 91 00, PAINTING, paint the panelboard system voltage, and feeder sizes as shown on the riser diagram in 1 inch block lettering on the inside cover of the cabinet door. Paint the words "LIFE SAFETY BRANCH", "CRITICAL BRANCH", "EQUIPMENT SYSTEM", or "OPTIONAL STANDBY" as applicable and the panel designation in one inch block letters on the outside of the cabinet doors.
- D. Install a typewritten schedule of circuits in each panelboard after being submitted to and approved by the Resident Engineer. Schedules, after approval, shall be typed on the panel directory cards and installed in the appropriate panelboards, incorporating all applicable contract changes pertaining to that schedule. Include the room numbers and items served on the cards.
- E. Mount the panelboard fully aligned and such that the maximum height of the top circuit breaker above finished floor shall not exceed 1980 mm (78 inches). For panelboards that are too high, mount panelboard so that the bottom of the cabinets will not be less than 150 mm (6 inches) above the finished floor.
- F. For panelboards located in areas accessible to the public, paint the exposed surfaces of the trims, doors, and boxes with finishes to match surrounding surfaces after the panelboards have been installed.
- G. Directory-card information shall be typewritten to indicate outlets, lights, devices, and equipment controlled and final room numbers served by each circuit and shall be mounted in holders behind protective covering.
- H. Where new panels are to be installed in existing backboxes, backboxes shall have rust and scale removed from inside. Paint inside of backboxes with rust preventive paint before the new panel interior is installed. Provide new trim and doors for these panels. Covers shall fit tight to the box with no gaps between the cover and the box.

--- E N D ---

SECTION 26 27 26 WIRING DEVICES

PART 1 - GENERAL

1.1 DESCRIPTION

This section specifies the furnishing, installation and connection of wiring devices.

1.2 RELATED WORK

- A. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: General electrical requirements that are common to more than one section of Division 26.
- B. Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS: Conduits and outlets boxes.
- C. Section 26 05 21, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES (600 VOLTS AND BELOW): Cables and wiring.
- D. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS: Requirements for personnel safety and to provide a low impedance path to ground for possible ground fault currents.

1.3 SUBMITTALS

- A. In accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS, submit the following:
- B. Shop Drawings:
 - 1. Sufficient information, clearly presented, shall be included to determine compliance with drawings and specifications.
 - 2. Include electrical ratings, dimensions, mounting details, construction materials, grade and termination information.
- C. Manuals: Two weeks prior to final inspection, deliver four copies of the following to the Resident Engineer: Technical data sheets and information for ordering replacement units.
- D. Certifications: Two weeks prior to final inspection, submit four copies of the following to the Resident Engineer: Certification by the Contractor that the devices comply with the drawings and specifications, and have been properly installed, aligned, and tested.

1.4 APPLICABLE PUBLICATIONS

- A. Publications listed below (including amendments, addenda, revisions, supplements and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by basic designation only.

- B. National Fire Protection Association (NFPA):
 - 70-02National Electrical Code (NEC)
- C. National Electrical Manufacturers Association (NEMA):
 - WD 1-99General Color Requirements for Wiring Devices
 - WD 6-02Wiring Devices – Dimensional Requirements
- D. Underwriter’s Laboratories, Inc. (UL):
 - 5-96Surface Metal Raceways and Fittings
 - 20-00General-Use Snap Switches
 - 231-98Power Outlets
 - 467-93Grounding and Bonding Equipment
 - 498-01Attachment Plugs and Receptacles
 - 943-03Ground-Fault Circuit-Interrupters

PART 2 - PRODUCTS

2.1 RECEPTACLES

- A. General: All receptacles shall be listed by Underwriters Laboratories, Inc., as hospital grade (green dot identification) and conform to NEMA WD 1. (EXCEPTION - Receptacle types which have no listing as hospital grade but are listed by UL in their respective categories or receptacles indicated on the drawings as “not hospital grade”).
 - 1. Mounting straps shall be plated steel, with break-off plaster ears and shall include a self-grounding feature. Terminal screws shall be brass, brass plated or a copper alloy metal.
 - 2. Receptacles shall have provisions for back wiring with separate metal clamp type terminals (four min.) and side wiring from four captively held binding screws.
- B. Duplex receptacles shall be single phase, 20 ampere, 120 volts, 2-pole, 3-wire, and conform to the NEMA 5-20R configuration in NEMA WD 6. The duplex type shall have break-off feature for two-circuit operation. The ungrounded pole of each receptacle shall be provided with a separate terminal.
 - 1. Duplex receptacles on Normal or Optional Standby Power Circuit:
 - a. Bodies shall be ivory in color.
 - 2. Duplex Receptacles on Emergency Circuit:
 - a. Bodies shall be red in color. Wall plates shall be red with the word "EMERGENCY" engraved in 6 mm, (1/4 inch) white letters.
 - b. In rooms without emergency powered general lighting, the emergency receptacles shall be of the self-illuminated type

3. Ground Fault Interrupter Duplex Receptacles: Shall be an integral unit suitable for mounting in a standard outlet box.
 - a. Ground fault interrupter shall be hospital grade and consist of a differential current transformer, solid state sensing circuitry and a circuit interrupter switch. It shall be rated for operation on a 60 Hz, 120 volt, 20-ampere branch circuit. Device shall have nominal sensitivity to ground leakage current of five milliamperes and shall function to interrupt the current supply for any value of ground leakage current above five milliamperes (+ or – 1 milliamp) on the load side of the device. Device shall have a minimum nominal tripping time of 1/30th of a second. Devices shall meet UL 943.
4. Isolated Ground Type Duplex Receptacles:
 - a. Bodies shall be orange in color.
 - b. Shall be hospital grade and UL listed as “Isolated Ground”.
5. Duplex Receptacles (not hospital grade): Shall be the same as hospital grade duplex receptacles except for the "hospital grade" listing and as follows.
 - a. Bodies shall be brown phenolic compound supported by a plated steel mounting strap having plaster ears.
 - b. Shall be NEMA WD 1 heavy duty type.
- C. Receptacles; 20, 30 and 50 ampere, 250 volts: Shall be complete with appropriate cord grip plug. Devices shall meet UL 231.
- D. Weatherproof Receptacles: Shall consist of a duplex receptacle, mounted in box with a gasketed, weatherproof, cast metal cover plate and cap over each receptacle opening. The cap shall be permanently attached to the cover plate by a spring-hinged flap. The weatherproof integrity shall not be affected when heavy duty specification or hospital grade attachment plug caps are inserted. Cover plates on outlet boxes mounted flush in the wall shall be gasketed to the wall in a watertight manner.
- E. Lamp Receptacles for Outlet Box Mounting:
 1. For use on standard 75 mm (3 inch) and 100 mm (4 inch) outlet boxes.
 2. Keyless, porcelain body and skirt supporting a medium screw shell socket, and integral 3-wire grounding receptacle shall have screw terminals and a minimum rating of 600 watts.
 3. Porcelain neck shall have shade holder groove.

2.2 TOGGLE SWITCHES AND DIMMERS

- A. Toggle switches shall be totally enclosed tumbler type with bodies of phenolic compound.

Toggle handles shall be ivory in color unless otherwise specified. The rocker type switch is not acceptable and will not be approved.

1. Switches installed in hazardous areas shall be explosion proof type in accordance with the NEC and as shown on the drawings.
2. Shall be single unit toggle, butt contact, quiet AC type, heavy-duty general-purpose use with an integral self grounding mounting strap with break-off plaster ears and provisions for back wiring with separate metal wiring clamps and side wiring with captively held binding screws.
3. Shall be color coded for current rating, listed by Underwriters Laboratories, Inc., and meet the requirements of NEMA WD 1, Heavy-Duty and UL 20.
4. Ratings:
 - a. 120 volt circuits: 20 amperes at 120-277 volts AC.
 - b. 277 volt circuits: 20 amperes at 120-277 volts AC.
5. The switches shall be mounted on the striker plate side of doors.
6. Incorporate barriers between switches with multigang outlet boxes where required by the NEC.
7. Switches connected to isolated type electrical power systems shall be double pole.
8. All toggle switches shall be of the same manufacturer.

- B. Dimmers: Incandescent modular dimming systems.

1. Incandescent dimming system shall be 2000 watt modular type, with capability for "slaving" larger loads from the "master". System shall have capability of adding additional "slaves", controlled from the original basic dimmer "master". All units shall track with "master".
Control units shall be single-phase manual control as shown on the drawings. Dimmers shall have low and intensity adjustment and built-in transient voltage protection and fused on the load side. All remote mounted units shall be completely enclosed in integral metal housing.
"Master", "Slaves" and controls shall be of the same manufacturer. All dimmers shall be listed by Underwriters Laboratories, Inc.

- C. Dimmers: Incandescent lamp loads. Wall-mounted incandescent dimmers shall be specification grade with capability of raising and lowering the lighting from completely off at extreme counter-clockwise rotation, to full intensity. Dimmers shall include an "off" position. Dimmers shall maintain full load rating even when two or more units are installed adjacent to one another. All wall-mounted dimmers shall be of the same manufacturer.

- D. Dimmers: Fluorescent lamp loads. Wall-mounted fluorescent lamp dimmers shall be specification grade with large control knob and shall be capable of raising and lowering the lighting from completely off at extreme counter-clockwise rotation, to full intensity. Dimmers shall include an "off" position. Dimmers shall have low end intensity adjustment and maintain full load rating even when two or more units are installed adjacent to one another. All wall-mounted dimmers shall be of the same manufacturer. Dimming ballast shall be provided for each F32 rapid start lamp or pair of lamps. Dimmers shall have adequate capacity for the load served and the environment in which installed.

2.3 WALL PLATES

- A. Wall plates for switches and receptacles shall be type smooth nylon. Oversize plates are not acceptable.
- B. Color shall be ivory unless otherwise specified.
- C. Standard NEMA design, so that products of different manufacturers will be interchangeable. Dimensions for openings in wall plates shall be accordance with NEMA WD1.
- D. For receptacles or switches mounted adjacent to each other, wall plates shall be common for each group of receptacles or switches.
- E. In psychiatric areas, wall plates shall have tamperproof screws and beveled edges.
- F. Wall plates for data, telephone or other communication outlets shall be as specified in the associated specification.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Installation shall be in accordance with the NEC and as shown as on the drawings.
- B. Ground terminal of each receptacle shall be bonded to the outlet box with an approved green bonding jumper, and also connected to the green equipment grounding conductor.
- C. Outlet boxes for light and dimmer switches shall be mounted on the strike side of doors.
- D. Provide barriers in multigang outlet boxes to separate systems of different voltages, Normal Power and Emergency Power systems, and in compliance with the NEC.
- E. Coordinate with other work, including painting, electrical boxes and wiring installations, as necessary to interface installation of wiring devices with other work. Coordinate the electrical work with the work of other trades to ensure that wiring device flush outlets are positioned with box openings aligned with the face of the surrounding finish material. Pay special attention to installations in cabinet work, and in connection with laboratory equipment.

- F. Exact field locations of floors, walls, partitions, doors, windows, and equipment may vary from locations shown on the drawings. Prior to locating sleeves, boxes and chases for roughing-in of conduit and equipment, the Contractor shall coordinate exact field location of the above items with other trades. In addition, check for exact direction of door swings so that local switches are properly located on the strike side.
- G. Install wall switches 48 inches [1200mm] above floor, OFF position down.
- H. Install wall dimmers 48 inches [1200mm] above floor; derate ganged dimmers as instructed by manufacturer; do not use common neutral.
- I. Install convenience receptacles 18 inches [450mm] above floor, and 6 inches [152mm] above counter backsplash or workbenches. Install specific-use receptacles at heights shown on the drawings.
- J. Label device plates with a permanent adhesive label listing panel and circuit feeding the wiring device.
- K. Test wiring devices for damaged conductors, high circuit resistance, poor connections, inadequate fault current path, defective devices, or similar problems using a portable receptacle tester. Correct circuit conditions, remove malfunctioning units and replace with new, and retest as specified above.
- L. Test GFCI devices for tripping values specified in UL 1436 and UL 943.

--- E N D ---

SECTION 26 29 11
LOW-VOLTAGE MOTOR STARTERS

PART 1 - GENERAL

1.1 DESCRIPTION

All motor starters and variable speed motor controllers (identified as VFD's on drawings) including installation and connection (whether furnished with the equipment specified in other Divisions or otherwise) shall meet these specifications.

1.2 RELATED WORK

- A. Other sections which specify motor driven equipment, except elevator motor controllers.
- B. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: General electrical requirements and items that are common to more than one Section of Division 26.
- C. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS: Requirements for personnel safety and to provide a low impedance path for possible ground fault currents.

1.3 SUBMITTALS

Submit in accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS:

- A. Shop Drawings:
 - 1. Sufficient information, clearly presented, shall be included to determine compliance with drawings and specifications.
 - 2. Include electrical ratings, dimensions, weights, mounting details, materials, running over current protection, size of enclosure, over current protection, wiring diagrams, starting characteristics, interlocking and accessories.
- B. Manuals:
 - 1. Submit, simultaneously with the shop drawings, companion copies of complete maintenance and operating manuals, including technical data sheets, wiring diagrams and information for ordering replacement parts.
 - a. Wiring diagrams shall have their terminals identified to facilitate installation, maintenance and operation.
 - b. Wiring diagrams shall indicate internal wiring for each item of equipment and interconnections between the items of equipment.
 - c. Elementary schematic diagrams shall be provided for clarity of operation.

2. Two weeks prior to the project final inspection, submit four copies of the final updated maintenance and operating manual to the Resident Engineer. (Update manual to include any information necessitated by shop drawing approval).
- C. Certification: Two weeks prior to final inspection, unless otherwise noted, submit four copies of the following certifications to the Resident Engineer:
1. Certification by the manufacturer that the controllers have passed the factory 24-hour operational test. (This certification must be furnished to the Resident Engineer prior to shipping the controller to the job site.)
 2. Certification by the manufacturer that high voltage motor controller(s) conforms to the requirements of the drawings and specifications. (This certification must be furnished to the Resident Engineer prior to shipping the controller to the job site.).
 3. Certification that the equipment has been properly installed, adjusted, and tested.

1.4 APPLICABLE PUBLICATIONS

- A. Publications listed below (including amendments, addenda, revisions, supplements and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by basic designation only.
- B. Institute of Electrical and Electronic Engineers (IEEE):
- 519-92Recommended Practices and Requirements for Harmonic
Control in Electrical Power Systems
- C37.90.1-02Standard Surge Withstand Capability (SWC) Tests for
Protective Relays and Relay Systems
- C. National Electrical Manufacturers Association (NEMA):
- ICS 1-00Industrial Control and Systems General Requirements
- ICS 1.1-03Safety Guidelines for the Application, Installation and
Maintenance of Solid State Control
- ICS 2-00Industrial Control and Systems, Controllers, Contactors and
Overload Relays Rated 600 Volts DC
- ICS 6-01Industrial Control and Systems Enclosures
- ICS 7-00Industrial Control and Systems Adjustable-Speed Drives
- ICS 7.1-00Safety Standards for Construction and Guide for Selection,
Installation and Operation of Adjustable-Speed Drive Systems
- D. National Fire Protection Association (NFPA):
- 70-11National Electrical Code (NEC)

E. Underwriters Laboratories Inc. (UL):

508-99Industrial Control Equipment

PART 2 - PRODUCTS

2.1 MOTOR STARTERS, GENERAL

- A. Motor starters shall be in accordance with the requirements of the IEEE, NEC, NEMA (ICS 1, ICS 1.1, ICS 2, ICS 6, ICS 7 and ICS 7.1) and UL.
- B. Shall have the following features:
 - 1. Separately enclosed unless part of another assembly.
 - 2. Circuit breakers and safety switches within the motor controller enclosures shall have external operating handles with lock-open padlocking provisions and shall indicate the ON and OFF positions.
 - 3. Motor control circuits:
 - a. Shall operate at not more than 120 volts. Coordinate voltage requirement with building automation contractor.
 - b. Shall be grounded except as follows:
 - 1) Where isolated control circuits are shown.
 - 2) Where manufacturers of equipment assemblies recommend that the control circuits be isolated.
 - c. Incorporate a separate, heavy duty, control transformer within each motor controller enclosure to provide the control voltage if different than line voltage.
 - d. Incorporate over current protection for both primary and secondary windings of the control power transformers in accordance with the NEC.
 - 4. Overload current protective devices:
 - a. Overload relay solid state type.
 - b. One for each pole.
 - c. Manual reset on the door of each motor controller enclosure.
 - d. Correctly sized for the associated motor's rated full load current identified on nameplate.
 - e. Check every motor controller after installation and verify that correct sizes of protective devices have been installed.
 - f. Deliver four copies of a summarized list to the Resident Engineer, which indicates and adequately identifies every motor controller installed. Include the catalog numbers for the correct sizes of protective devices for the motor controllers.

5. Hand-Off-Automatic (H-O-A) switch is required unless specifically stated on the drawings as not required for a particular starter. H-O-A switch is not required for manual motor starters or for pumps DP-1 & DP-2.
6. Incorporate into each control circuit a solid state time delay relay (ON delay), minimum adjustable range from 0.3 to 10 minutes, with transient protection. Time delay relay is not required where H-O-A switch is not required.
7. Keyed Selector Switch (Pumps DP-1 & DP-2)
 - a. Two position – maintained.
 - b. Motor On – Right hand position.
 - c. Motor Off – Center position.
 - d. Key withdrawal in center position only.
8. Auxiliary contacts, pilot lights, pushbuttons and other devices and accessories as shown on the drawings or otherwise required.
9. Enclosures:
 - a. Shall be the NEMA types shown on the drawings for the motor controllers.
 - b. Shall be the NEMA types which are the most suitable for the environmental conditions where the motor controllers are being installed.
 - c. Doors mechanically interlocked to prevent opening unless the breaker or switch within the enclosure is open. Provision for padlock must be provided.
 - d. Enclosures shall be primed and finish coated at the factory with the manufacturer's prime coat and standard finish.
- C. Motor controllers incorporated with equipment assemblies shall also be designed for the specific requirements of the assemblies.
- D. For motor controllers being installed in existing motor control centers or panelboards, coordinate with the existing centers or panelboards.
- E. Additional requirements for specific motor controllers, as indicated in other sections, shall also apply.
- F. Provide a disconnecting means or safety switch near and within sight of each motor. Provide all wiring and conduit required to facilitate a complete and code complied installation.

2.2 MANUAL MOTOR STARTERS

- A. Shall be in accordance with applicable requirements of 2.1 above.
- B. Manual motor starters.

1. Starters shall be AC, general-purpose Class A, manually operated type with full voltage controller for induction motors, rated in horsepower.
 2. Units shall include overload protection, red pilot light, NO/NC auxiliary contact, and toggle operator.
- C. Fractional horsepower manual motor starters.
1. Starters shall be AC, general-purpose Class A, manually operated with full voltage controller for fractional horsepower induction motors.
 2. Units shall include thermal overload protection, red pilot light and toggle operator.

2.3 MAGNETIC MOTOR STARTERS

- A. Shall be in accordance with applicable requirements of 2.1 above.
- B. Starters shall be AC, general-purpose, Class A magnetic controllers for induction motors rated in horsepower. Minimum size 0.
- C. Combine starter with fuses and disconnect device in a common enclosure. Supply RK5 dual element time delay fuses with each starter.
- D. Provide phase loss protection for each starter, with contacts to de-energize the starter upon loss of any phase.
- E. Each starter shall have two pilot lights behind red and green jewels and a circuit to its motor controller. Connect the lamps so they will be energized as follows:
 1. Red while the motor is running.
 2. Green while the motor is stopped.
- F. Provide N.O. and N.C. dry contacts rated 120 volts, 10 amperes, 60 HZ for remote indication of the following:
 - a. Disconnect switch operating mechanism

2.6 VARIABLE SPEED MOTOR CONTROLLERS (VFD'S)

- A. Shall be in accordance with applicable portions of 2.1 above.
- B. Shall be solid state, micro processor-based with adjustable frequency and voltage, three phase output capable of driving standard NEMA B design, three phase alternating current induction motors at full rated speed. The drives shall utilize a full wave bridge design incorporating diode rectifier circuitry with pulse width modulation (PWM). Other control techniques are not acceptable. Silicon controlled rectifiers (SCR) shall not be used in the rectifying circuitry. The drives shall be designed to be used on variable torque loads and shall be capable of providing sufficient torque to allow the motor to break away from rest upon first application of power.

C. Unit shall be capable of operating within voltage parameters of plus 10 to minus 10 percent of line voltage, and be suitably rated for the full load amps of the maximum watts (HP) within its class.

D. Operating and Design Conditions:

Elevation: 900 feet AMSL

Temperatures: Maximum +90°F Minimum -10°F

Relative Humidity: 95%

Drive Location: Air conditioned Building

E. Controllers shall have the following features:

1. Isolated power for control circuits.
2. Manually re-settable motor overload protection for each phase.
3. Adjustable current limiting circuitry to provide soft motor starting. Maximum starting current shall not exceed 200 percent of motor full load current.
4. Independent acceleration and deceleration time adjustment, manually adjustable from 2 to 30 seconds. (Set timers to the equipment manufacturer's recommended time in the above range.)
5. Provide 4 to 20 ma current follower circuitry for interface with mechanical sensor devices.
6. Automatic frequency adjustment from 20 Hz to 60 Hz.
7. Provide circuitry to initiate an orderly shutdown when any of the conditions listed below occur. The controller shall not be damaged by any of these electrical disturbances and shall automatically restart when the conditions are corrected. The drive shall be able to restart into a rotating motor operating in either the forward or reverse direction and matching that frequency.
 - a. Incorrect phase sequence.
 - b. Single phasing.
 - c. Over voltage in excess of 10 percent.
 - d. Under voltage in excess of 10 percent.
 - e. Running over current above 110 percent (shall not automatically reset for this condition.)
 - f. Instantaneous overcurrent above 150 percent (shall not automatically reset for this condition).
 - g. Surge voltage in excess of 1000 volts.
 - h. Short duration power outages of 12 cycles or less (i.e., distribution line switching, generator testing, and automatic transfer switch operations.)

8. Automatic Reset/Restart: Attempt three restarts after drive fault or on return of power after an interruption and before shutting down for manual reset or fault correction; adjustable delay time between restart attempts.
 9. Power-Interruption Protection: To prevent motor from re-energizing after a power interruption until motor has stopped, unless "Bidirectional Autospeed Search" feature is available and engaged.
 11. Bidirectional Autospeed Search: Capable of starting VFC into rotating loads spinning in either direction and returning motor to set speed in proper direction, without causing damage to drive, motor, or load.
- F. Minimum efficiency shall be 95 percent at 100 percent speed and 85percent at 50 percent speed.
- G. The displacement power factor of the controller shall not be less than 95 percent under any speed or load condition.
- H. Controllers shall include a door interlocked fused safety disconnect switch or door interlocked circuit breaker switch which will disconnect all input power.
- I. Controller shall include a 3% line reactor, and RFI/EMI filter.
- J. The following accessories are to be door mounted:
1. AC Power on light.
 2. Ammeter (RMS motor current).
 3. HAND-OFF-AUTOMATIC switch.
 4. Manual speed control in HAND mode.
 5. System protection lights indicating that the system has shutdown and will not automatically restart.
 6. System protection light indicating that the system has shutdown but will restart when conditions return to normal.
 7. Manual variable speed controller by-pass switch.
 8. Diagnostic shutdown indicator lights for each shutdown condition.
 9. Provide two N.O. and two N.C. dry contacts rated 120 volts, 10 amperes, 60 HZ for remote indication of the following:
 - a. System shutdown with auto restart.
 - b. System shutdown without auto restart.
 - c. System running.
 10. Incorporate into each control circuit a 120-volt, time delay relay (ON delay), adjustable from 0.3-10 minutes, with transient protection. Provide transformer/s for the control circuit/s.

11. Controller shall not add any current or voltage transients to the input AC power distribution system nor shall transients from other devices on the AC power distribution system affect the controller. Controllers shall be protected to comply with IEEE C37.90.1 and UL-508. Line noise and harmonic voltage distortion shall not exceed the values allowed by IEEE 519.
- K. Hardware and software to enable the BAS to monitor, control, and display controller status and alarms.
- L. Network Communications Ports: Ethernet and RS-485.
- M. Embedded BAS Protocols for Network Communications.

2.5 PROVIDE INTERNALLY INTEGRATED SURGE PROTECTIVE DEVICES FOR EACH CONTROLLER:

- A. Integral Surge Suppressor:
 1. SPD (Surge Protective Devices) shall be Component Recognized and listed in accordance with UL 1449 Second Edition to include Section 37.3 highest fault category testing on devices intended for service entrance use. SPD shall also be UL 1283 listed.
 2. SPD shall be UL 67 listed, installed by and shipped from the electrical distribution equipment manufacturer's factory.
 3. SPD shall provide surge current diversion paths for all modes of protection; L-N, L-G, N-G, in WYE systems, and L-L, L-G in DELTA systems.
 4. SPD shall be modular in design. Each mode shall be fused with a 200kAIC; UL recognized surge rated fuse and incorporate a thermal cutout device.
 5. SPD shall be integrally mounted to the bus bars of the switchboard.
 6. Audible diagnostic monitoring shall be by way of audible alarm. This alarm shall activate upon a fault condition. An alarm on/off switch shall be provided to silence the alarm. An alarm push to test switch shall be provided as well.
 7. SPD shall meet or exceed the following criteria:
 - a. Maximum surge current capability (single pulse rated) per phase shall be:
 - 1) Service Entrance Switchboard 250 kA.
 - 2) Distribution Panelboards 160 kA
 - 3) Branch Panelboards 160 kA
 - 4) Service Entrance MCC 240 kA specified.
 - 5) Distribution Class MCC 160 kA
 - b. UL 1449 Second Edition Listed and Recognized Component Suppression Voltage Ratings (SVR's) for Service Entrance and Distribution Location equipment shall not exceed the following:

c. Voltage Let-Thru values for Solidly Grounded Systems:

VOLTAGE	L-N	L-G	N-G
208Y/120	400V	400V	400V
480Y/277	800V	800V	800V

8. SPD shall have a minimum EMI/RFI filtering of –50Db at 100 kHz with an insertion ratio of 50:1 using MIL-STD-220A methodology.
9. SPD shall have the following diagnostic features: transient counter, status lights on each phase, and one set of 1 NO and 1 NC auxiliary dry contacts for alarming.
10. SPD shall have a warranty for a period of five years, incorporating unlimited replacements of suppressor parts if transients destroy them during the warranty period. Warranty shall be the responsibility of the electrical distribution equipment manufacturer and shall be supported by their respective field service division.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Install motor control equipment in accordance with manufacturer's recommendations, the NEC, NEMA and as shown on the drawings.
- B. Furnish and install heater elements and solid state overload devices in motor starters to match the installed motor characteristics.

3.2 SPARE PARTS

Two weeks prior to the final inspection, provide one complete set of spare fuses (including heater elements) for each starter/controller installed on this project.

--- E N D ---

SECTION 26 29 21
DISCONNECT SWITCHES

PART 1 - GENERAL

1.1 DESCRIPTION

This section specifies the furnishing, installation and connection of low voltage disconnect switches.

1.2 RELATED WORK

- A. General electrical requirements and items that is common to more than one section of Division 26: Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
- B. Conduits for cables and wiring: Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS.
- C. Cables and wiring: Section 26 05 21, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES (600 VOLTS AND BELOW.
- D. Motor rated toggle switches: Section 26 29 11, LOW-VOLTAGE MOTOR STARTERS.
- E. Requirements for personnel safety and to provide a low impedance path for possible ground faults: Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS.

1.3 SUBMITTALS

- A. Submit in accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
- B. Shop Drawings:
 - 1. Include sufficient information, clearly presented to determine compliance with drawings and specifications.
 - 2. Include electrical ratings, dimensions, mounting details, materials, enclosure types, fuse type and class.
 - 3. Show the specific switch and fuse proposed for each specific piece of equipment or circuit.
- C. Manuals:
 - 1. Provide complete maintenance and operating manuals for disconnect switches, including technical data sheets, wiring diagrams, and information for ordering replacement parts. Deliver four copies to the Resident Engineer two weeks prior to final inspection.
 - 2. Identify terminals on wiring diagrams to facilitate maintenance and operation.
 - 3. Wiring diagrams shall indicate internal wiring and any interlocking.
- D. Certification: Two weeks prior to final inspection, deliver to the Resident Engineer four copies of the certification that the equipment has been properly installed, adjusted, and tested.

- a. Shall be the NEMA types shown on the drawings for the switches.
- b. Where the types of switch enclosures are not shown, they shall be the NEMA types which are most suitable for the environmental conditions where the switches are being installed. Unless otherwise indicated on the plans, all outdoor switches shall be NEMA 3R.
- c. Shall be finished with manufacturer's standard gray baked enamel paint over pretreated steel (for the type of enclosure required).

2.2 LOW VOLTAGE UNFUSED SWITCHES RATED 600 AMPERES AND LESS

Shall be the same as Low Voltage Fusible Switches Rated 600 Amperes and Less, but no fuses.

2.3 LOW VOLTAGE FUSIBLE SWITCHES RATED OVER 600 AMPERES TO 1200 AMPERES

Shall be the same as Low Voltage Fusible Switches Rated 600 Amperes and Less, except for the minimum duty rating which shall be NEMA classification Heavy Duty (HD). These switches shall also be horsepower rated.

2.4 MOTOR RATED TOGGLE SWITCHES

Refer to Section 26 29 11, LOW-VOLTAGE MOTOR STARTERS for motor rated toggle switches.

2.5 IDENTIFICATION SIGNS

- A. Install nameplate identification signs on each disconnect switch to identify the equipment controlled.
- B. Nameplates shall be laminated black phenolic resin with a white core, with engraved lettering, a minimum of 6 mm (1/4-inch) high. Secure nameplates with screws.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Install disconnect switches in accordance with the NEC and as shown on the drawings.
- B. Fusible disconnect switches shall be furnished complete with fuses.

3.2 SPARE PARTS

Two weeks prior to the final inspection, furnish one complete set of spare fuses for each fusible disconnect switch installed on the project. Deliver the spare fuses to the Resident Engineer.

--- E N D ---

SECTION 26 51 00 INTERIOR LIGHTING

PART 1 - GENERAL

1.1 DESCRIPTION

This section specifies the furnishing, installation and connection of the interior lighting systems.

1.2 RELATED WORK

- A. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: General requirements that are common to more than one section of Division 26.
- B. Section 26 05 21, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES (600 VOLTS AND BELOW): Cables and wiring.
- C. Section 26 27 26, WIRING DEVICES: Wiring devices used as part of the lighting systems.
- D. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS:
Requirements for personnel safety and to provide a low impedance path to ground for possible ground fault currents.

1.3 QUALITY ASSURANCE

- A. Refer to Paragraph, QUALIFICATIONS, in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
- B. Refer to Paragraph, GUARANTY, in Section 00 72 00, GENERAL CONDITIONS.

1.4 SUBMITTALS

- A. In accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS, submit the following:
- B. Shop Drawings:
 - 1. Sufficient information, clearly presented, shall be included to determine compliance with drawings and specifications.
 - 2. Include electrical ratings, dimensions, mounting details, materials, required clearances, terminations, wiring and connection diagrams, photometric data, ballasts, lenses, louvers, lamps, and controls.
 - 3. When catalog data and/or shop drawings for fluorescent fixtures are submitted for approval, photometric data from an independent testing laboratory shall be included with the submittal, indicating average brightness and efficiency of the fixture, as specified in specification or as shown on the drawings. Coefficient of utilization data will not be considered a suitable substitute.
- C. Manuals:

1. Submit, simultaneously with the shop drawings companion copies of complete maintenance and operating manuals including technical data sheets, and information for ordering replacement parts.
2. Two weeks prior to the final inspection, submit four copies of the final updated maintenance and operating manuals, including any changes, to the Resident Engineer.

D. Certifications:

1. Two weeks prior to final inspection, submit four copies of the following certifications to the Resident Engineer:
 - a. Certification by the Contractor that the equipment has been properly installed, adjusted, and tested.
 - b. Include with shop drawings, certification from the manufacturers that all electronic high-frequency ballasts meet the transient protection required by IEEE C62.41, Cat. A.
Include with initial shop drawing submittal.

1.5 APPLICABLE PUBLICATIONS

- A. Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by designation only.
- B. American National Standards Institute (ANSI):
 - C78.1-91Fluorescent Lamps - Rapid-Start Types - Dimensional and Electrical Characteristics
 - C78.2-91Fluorescent Lamps - Preheat-Start Types - Dimensional and Electrical Characteristics
 - C78.3-91Fluorescent Lamps - Instant Start and Cold-Cathode Types - Dimensional and Electrical Characteristics
 - C78.376-91Chromaticity of Fluorescent Lamps (ANSI/NEMA C78/376-96)
- C. Certified Ballast Manufacturers Association (CBM):
 - Requirements for Ballast Certification.
- D. Institute of Electrical and Electronic Engineers (IEEE):
 - C62.41-91Recommended Practice on Surge Voltage in Low Voltage AC Power Circuits
- E. National Fire Protection Association (NFPA):
 - 70-11National Electrical Code (NEC)
 - 101-09Life Safety Code

F. National Electrical Manufacturer's Association (NEMA)

C82.1-97Ballasts for Fluorescent Lamps - Specifications

C82.2-02Method of Measurement of Fluorescent Lamp Ballasts

C82.4-02Ballasts for High-Intensity-Discharge and Low-Pressure Sodium
Lamps

C82.11-02High Frequency Fluorescent Lamp Ballasts

G. Underwriters Laboratories, Inc. (UL):

496-96Edison-Base Lampholders

542-99Lampholders, Starters, and Starter Holders for Fluorescent
Lamps844-95Electric Lighting Fixtures for Use in Hazardous (Classified)
Locations

924-95Emergency Lighting and Power Equipment

935-01Fluorescent-Lamp Ballasts

1029-94High-Intensity-Discharge Lamp Ballasts

1598-00Luminaires

H. Federal Communications Commission (FCC):

Code of Federal Regulations (CFR), Title 47, Part 18

PART 2 - PRODUCTS**2.1 LIGHTING FIXTURES (LUMINAIRES)**

A. Shall be in accordance with NFPA 70, UL 1598 and shall be as shown on drawings and as specified.

B. Sheet Metal:

1. Shall be formed to prevent warping and sagging. Housing, trim and lens frame shall be true, straight (unless intentionally curved) and parallel to each other as designed.
2. Wireways and fittings shall be free of burrs and sharp edges and shall accommodate internal and branch circuit wiring without damage to the wiring.
3. Where lighting fixtures are detailed with minimum 20 gauge housing, minimum 22 gauge housings will be acceptable provided they have strengthening embossed rib and break formations, which give the equivalent rigidity of a 20 gauge housing.
4. When installed, any exposed fixture housing surface, trim frame, door frame and lens frame shall be free of light leaks; lens doors shall close in a light tight manner.

5. Hinged door closure frames shall operate smoothly without binding when the fixture is in the installed position, and latches shall function easily by finger action without the use of tools.
- C. Ballasts shall be serviceable while the fixture is in its normally installed position, and shall not be mounted to removable reflectors or wireway covers unless so specified.
- D. Lamp Sockets:
1. Fluorescent: Lampholder contacts shall be the biting edge type or phosphorous-bronze with silver flash contact surface type and shall conform to the applicable requirements of UL 542. Contacts for recessed double contact lampholders and for slimline lampholders shall be silver plated. Lampholders for bi-pin lamps, with the exception of those for "U" type lamps, shall be of the telescoping compression type, or of the single slot entry type requiring a one-quarter turn of the lamp after insertion.
 2. Incandescent: Shall have porcelain enclosures and conform to the applicable requirements of UL 496.
 3. High Intensity Discharge (H.I.D.): Shall have porcelain enclosures.
- E. Recessed incandescent fixtures mounted in an insulated ceiling shall be listed for use in insulated ceilings.
- F. Fluorescent fixtures with louvers or light transmitting panels shall have hinges, latches and safety catches to facilitate safe, convenient cleaning and relamping. Vapor tight fixtures shall have pressure clamping devices in lieu of the latches.
- G. Mechanical Safety: Lighting fixture closures (lens doors, trim frame, hinged housings, etc.) shall be retained in a secure manner by captive screws, chains, captive hinges or fasteners such that they cannot be accidentally dislodged during normal operation or routine maintenance.
- H. Metal Finishes:
1. The manufacturer shall apply his standard finish (unless otherwise specified) over a corrosion resistant primer, after cleaning to free the metal surfaces of rust, grease, dirt and other deposits. Edges of pre-finished sheet metal exposed during forming, stamping or shearing processes shall be finished in a similar corrosion resistant manner to match the adjacent surface(s). Fixture finish shall be free of stains or evidence of rusting, blistering, or flaking.
 2. Interior light reflecting finishes shall be white with not less than 85 percent reflectances, except where otherwise shown on the drawing.
 3. Exterior finishes shall be as shown on the drawings.

- I. Provide all lighting fixtures with a specific means for grounding their metallic wireways and housings to an equipment grounding conductor.
- J. Light Transmitting Components for Fluorescent Fixtures:
 - 1. Shall be 100 percent virgin acrylic plastic or water white, annealed, crystal glass.
 - 2. Flat lens panels shall have not less than 3.2 mm (1/8 inch) of average thickness. The average thickness shall be determined by adding the maximum thickness to the minimum unpenetrated thickness and dividing the sum by 2.
 - 3. Unless otherwise specified, lenses, diffusers and louvers shall be retained firmly in a metal frame by clips or clamping ring in such a manner as to allow expansion and contraction of the lens without distortion or cracking.
- K. Lighting Fixtures in Hazardous Areas: Fixtures shall be suitable for installation in flammable atmospheres (Class and Group) as defined in NFPA 70 and shall comply with UL 844.
- L. Compact fluorescent fixtures shall be manufactured specifically for compact fluorescent lamps with ballasts integral to the fixture. Assemblies designed to retrofit incandescent fixtures are prohibited except when specifically indicated for renovation of existing fixtures. Fixtures shall be designed for lamps as specified.

2.2 FLUORESCENT LAMP BALLASTS

- A. Where applicable, fluorescent lamps and ballasts shall comply with the National Energy Policy Act of 1992.
- B. Ballasts shall comply with NEMA 82.1, 82.2 and 82.11, NFPA 70, and UL 935 unless otherwise specified.
- C. Lamp types F32T8 and F32T8/U shall be operated by electronic, high frequency ballasts. All other fluorescent lamp types shall be operated by the standard energy saving electromagnetic core-and-coil ballasts. For these applications, the lamps shall be operated by core-and-coil ballasts where specifically required on the drawings as "core-and-coil".
- D. Electronic high-frequency ballasts:
 - 1. Ballasts shall operate the lamps at a frequency between 20 and 60 KHz from an input frequency of 60Hz.
 - 2. Ballast package:
 - a. Size: The ballast case shall be sized to be physically inter-changeable with standard core-and-coil ballasts and suitable for standard mounting in new or existing lighting fixtures.

- b. Case marking: Mark the ballast to indicate the required supply voltage, frequency, RMS current, current surge during starting, input watts, and power factor at the design center voltage, open circuit voltage, crest factor and efficacy.
3. Performance:
- a. Light output:
 - 1) At the design voltage, the light output shall be at least equal to that obtained by a core-and-coil ballasted system meeting ANSI, NEMA and CBM standards. The comparison test shall be measured in the same fixture at 25 degrees C (plus or minus one degree) ambient room temperature.
 - 2) Tests shall be made in fixtures designed only for the number of lamps being tested.
 - 3) For other applications (higher ambients, etc.) the tests should be operated with equivalent lamp wall temperatures plus or minus 4 degrees C.
 - b. Efficacy: The efficacy of the high-frequency, electronically ballasted system shall be at least 15 percent greater than the equivalent CBM core-and-coil ballasted system (see "Light output" above).
 - c. Starting: The ballast shall be capable of starting and maintaining operation of lamps at an ambient temperature of 10 degrees C (50 degree F) or more for an input voltage of plus or minus 10 percent about the center design voltage unless otherwise indicated. The ballast shall never be started in the instant start mode at any temperature.
 - d. Operation:
 - 1) The ballast shall safely and reliably operate in a room ambient temperature from 10 degrees C (50 degree F) to 40 degrees C (105 degree F).
 - 2) The light output shall not vary by more than plus or minus 5 percent for a plus or minus 10 percent variation of the input voltage about the center design voltage. Light output shall remain constant for a plus or minus 5 percent variation of the input voltage.
 - 3) The ballast shall operate the lamps in a manner that will not adversely curtail the normal life of the lamp.
 - e. Transient protection: The ballast shall comply with IEEE C62.41, Cat. A.
 - f. Flicker: The flicker shall be less than 5 percent and without visible flicker.
 - g. Noise: The audible noise levels should be equivalent to or better than the Class A rating of CBM certified ballasts.

- h. Electromagnetic Interference (EMI) and Radio Frequency Interference (RFI): The EMI and RFI limits shall meet the requirements of the Federal Communications Commission Rules and Regulations (CFR 47 Part 18).
 - i. Rated life: The ballast shall have a rated life of 10 years or 30,000 hours (based on a 10 hour day).
 - j. The two-lamp ballast shall safely operate two F32T8 RS, 32- watt lamps or two F32T8/U lamps. The single lamp ballast shall safely operate one F32T8 RS, 32-watt lamp or one F32T8/U lamp.
 - k. Power factor: Not less than 95 percent.
 - l. Reliability:
 - 1) Labels: Ballasts must be labeled or listed by UL and CBM/ETL.
 - 2) Submit, simultaneously with shop drawings, a certified test report by an independent testing laboratory showing that the electronic ballasts meet or exceed all the performance requirements in this specification.
 - m. Total harmonic distortion (THD) shall be less than 10 percent.
- E. Core-and-coil ballasts (for lamps other than F32T8 and F32T8/U or where shown on drawings as "core-and-coil"):
- 1. Shall be rapid starting type.
 - 2. Shall comply with NEMA 82.1 and UL 935.
 - 3. Shall be UL Class P with automatic-resetting, internal, thermal protection.
 - 4. Shall be CBM/ETL certified.
 - 5. Power factor shall be not less than 95 percent. Capacitors in ballasts shall not contain PCB (Polychlorinated Biphenyl) fluids or other fluids recognized as hazardous when discharged into the environment.
 - 6. Sound ratings shall be Class A or better, except for ballast sizes which are not available with Class A ratings, as standard products from any manufacturer. Ballasts which are not available with Class A ratings shall have the quietest ratings available.
 - 7. Where core-and-coil ballasts are specified or detailed in lieu of the normally required electronic high-frequency types, two lamp ballasts shall be energy-saving type, UL listed to operate F40T12 rapid start lamps for both standard 40 watt lamps and the reduced wattage 35/34 watts energy-saving lamps. Lamp output shall be within 5 percent of nominal rating. When operating energy-saving lamps, the input watts to the ballast shall not exceed 78 watts

- at 120 V.A.C. or 79 watts at 277 V.A.C. Energy-saving type ballasts should not be used in ambient temperatures below manufacturer's recommendations.
- F. Ballasts for lighting fixtures controlled by dimming devices shall be the electronic, high frequency type as specified herein, equipped for dimming and conform to the recommendations of the manufacturer of the associated dimming devices to assure satisfactory operation of the lighting system.
 - G. All ballasts serving straight or "U" type lamps shall be mounted by four non-turning studs (or captive bolts) equipped with lock washers and nuts or locking type nuts, or by four thread cutting (TC) sheet metal screws which are firmly secured against the fixture body (or wireway) to maximize dissipation of heat and minimize noise. Exception: electronic high-frequency ballasts may be mounted at a minimum of two points, one at each end of unit.
 - H. Ballasts shall be serviceable while the fixture is in its normally installed position, and shall not be mounted to removable reflectors or wireway covers unless so specified.
 - I. To facilitate multi-level lamp switching, lamps within fixture shall be wired with the outermost lamp at both sides of the fixture on the same ballast, the next inward pair on another ballast and so on to the innermost lamp (or pair of lamps). Within a given room, each switch shall uniformly control the same corresponding lamp (or lamp pairs) in all fixture units that are being controlled.
 - J. Where three-lamp fixtures are indicated, unless switching arrangements dictate otherwise, utilize a common two-lamp ballast to operate the center lamp in pairs of adjacent units that are mounted in a continuous row. The ballast fixture and slave-lamp fixture shall be factory wired with leads or plug devices to facilitate this circuiting. Individually mounted fixtures and the odd fixture in a row shall utilize a single-lamp ballast for operation of the center lamp.

2.3 BALLASTS FOR HIGH INTENSITY DISCHARGE FIXTURES:

- A. Shall comply with NEMA 82.4 and UL 1029.
- B. Shall have individual overcurrent protection sized in accordance with the manufacturer's recommendations.
- C. Shall have integral thermal protection where the fixture is recessed in an interior ceiling.
- D. Shall be the constant wattage, high power factor type or the reactor high power factor type. Capacitors shall not contain PCB (Polychlorinated Biphenyl) fluids or other fluids recognized as hazardous when discharged into the environment.
- E. Shall have not less than Class B sound ratings for interior fixtures, when available. Ballasts which are not available with Class B ratings shall be of the next standard rating.

2.4 LAMPS

A. Fluorescent Lamps:

1. Rapid start fluorescent lamps shall comply with ANSI C78.1; preheat-start type shall comply with ANSI C78.2; and instant-start and cold-cathode lamps shall comply with ANSI C78.3.
2. Chromacity of fluorescent lamps shall comply with ANSI C78.376.
3. The lamps shall include the F32T8, F32T8/U 32 watt energy saving type and EPACT approved F40T12 type if specifically required by contract drawings for special applications.
4. Except as indicated below, lamps shall be energy saving type, have a color temperature of 4100°K, a Color Rendering Index (CRI) of not less than 75, and an initial lumen output not less than 2800. "U" tube lamps shall have the same color temperature and CRI limits as the above.
 - a. In utility areas (Electrical, Communication and Mechanical) Service rooms and closets), maintenance closets and non-medical storage spaces, utilize energy saving light-white lamps.
 - b. In areas with ambient temperatures below 60 degrees use the 40 watt version of the lamp above.
 - c. Over the beds in Intensive Care, Coronary Care, Recovery, Life Support, and Observation and Treatment areas; Electromyographic, Autopsy (Necropsy), Surgery, and certain dental rooms (Examination, Oral Hygiene, Oral Surgery, Recovery, Labs, Treatment, and X-Ray) use color corrected lamps having a CRI of 90 or above and a correlated color temperature between 5000 and 6000°K.
 - d. Other areas as indicated on the drawings.

B. Incandescent lamps shall be the general service, inside frosted type rated 130 volts except where otherwise shown on the drawings.

C. High Intensity Discharge Lamps:

1. Mercury vapor lamps shall be ANSI type "DX". Lamps in open or louvered fixtures mounted less than 4500 mm (15 feet) above the finished floor (or grade) shall be of the safety type in which the arc will automatically extinguish if the outer glass envelope becomes broken.
2. Multi-vapor lamps shall be as defined on the detail drawings.
3. High pressure sodium lamps shall be as defined on the detail drawings.

D. Compact Fluorescent Lamps: Shall be 4100°K, 10,000 hours average rated life, and as follows:

1. T4, twin tube, rated 5 watts, 250 initial lumens (min), 7 watts, 400 initial lumens (min), 9 watts, 600 initial lumens (min), 13 watts, 825 initial lumens (min), as indicated.

2. T4, double twin tube rated 13 watts, 900 initial lumens (min), 18 watts, 1200 initial lumens (min), 26 watts, 1800 initial lumens (min), as indicated.

2.5 OCCUPANT SENSOR LIGHTING CONTROL SYSTEMS

- A. General: An active or passive sensor shall be utilized to control the "On-Off" actuation of fluorescent or incandescent lighting loads. It shall provide control of an isolated set of contacts on exposure to a perceived change in environmental conditions indicating the presence or absence of one or more persons. It shall maintain the contacts closed in the presence of continued changes (due to human presence) at similar intensity and rate. It shall open the contacts at a nominal time after the changes cease.
- B. Passive Sensor System: Sensor(s) shall react to changes of radiated infrared energy, indicating the activity of one or more human bodies in the area covered:
 1. Range of detection: The sensor(s) shall provide effective coverage of a room, sensing the presence of one or more people in the room in order to turn the lights on. The ceiling mounted sensor's area of coverage shall be approximately a 4200 mm (14 feet) diameter circle at 1800 mm (6 feet) away. Provide sufficient units to give full coverage as measured 750 mm (30 inches) above the floor. A field-of-view adjustment feature shall be provided to allow orientation to various room operating conditions.
 2. Sensor placement: Locate the sensor(s) in accordance with the manufacturer's recommendations to maximize energy savings by avoiding nuisance activation due to sudden temperature or air flow changes. Locate the units within 1800 mm (6 feet) horizontally of work stations or major points of activity, including the center of room entrance doors.
- C. Active Sensor System: Sensor(s) shall react to reflective changes to generated ultrasonic radiation (crystal controlled, 24 to 42kHz), indicating the activity of one or more persons in the area covered.
 1. Range of detection: On ceilings below 3600 mm (twelve feet) in height, a single direction sensor shall cover approximately a 9 x 9 m (30 feet x 30 feet) area; a two directional unit a 18 x 9 m (60 feet x 30 feet) area; and a two-way corridor unit a total distance of 27 m (90 feet). The sensors shall be equipped with a concealed but accessible sensitivity control to tune the unit to specific room conditions.
 2. Sensor placement: Locate the sensor(s) in accordance with the manufacturer's recommendations to maximize energy savings by avoiding nuisance activation due to predictable non-human motion activities. Give particular attention to work station or major areas of activity and the coverage of room entrance doors.

- D. Timing/Function: Shall not be user adjustable. Lighting shall remain on with one or more persons within the covered area. The system shall be factory set to maintain lights on for a minimum of 8 minutes and not longer than 12 minutes after the area of coverage is vacated. For testing purposes, there shall be a means to change the pre-set time delay to 30 seconds or less.
- E. Control Unit: The system shall have a switching relay(s) capable of switching the fluorescent or incandescent loads as required. Contacts shall be rated at a minimum of 15 Amps at voltages to 277, with expected cycles of operation in excess of 100K. Power derived from a current limiting 24 volt transformer shall power the system and the unit must be packaged for installation on a standard 200 mm x 200 mm (4 inch x 4 inch) NEMA box enclosure. The unit shall be wired through a conventional wall switch to provide an over-ride system "Off" and active "Off-On" functioning.
- F. Field Wiring: The wiring between the control unit and sensor(s) shall be an insulated multi-conductor, #22 gauge Poly Vinyl Chloride (PVC) jacketed cable.

2.6 REMOTE CONTROL SWITCHING FOR INDOOR LIGHTING SYSTEMS

- A. Shall be rated for continuous-duty service.
- B. Electric contacts shall be precious metal surface.
- C. Magnetic contactors and relays shall be electrically-operated and mechanically-held.
- D. Characteristics of the components and the total resistances of the circuits throughout the systems shall be such that the systems will operate satisfactorily in every respect while the branch circuit power supply voltage to each system is within a 105-130 volt range at 60 Hz.
- E. Wall switches shall be the momentary contact type suitable for mounting in a single gang outlet box space and compatible with the standard design wall plates as specified.
- F. Where shown on the drawings, incorporate the components in panelboards behind separate doors and mount them on sound absorbing materials.
- G. Install circuit breaker or fuse protection for the control circuits.
- H. Low voltage remote control system shall be DC type, operating at not greater than 30 volts, and meeting the requirements for Class 2 circuits in Article 725 of the NEC.

2.7 RADIO-INTERFERENCE-FREE FLUORESCENT FIXTURES

- A. Shall be specially designed for suppressing radio-frequency energy produced within the fixtures. The Rules and Regulations of FCC (CFR 47, Part 18) shall apply.
- B. Lenses shall have a light-transparent layer of metal permanently bonded to them, and in positive contact with the steel housing or equal to prevent the radio-frequency interferences from passing

through the lenses. The effective light transmittance of the lenses shall be not less than 75 percent.

- C. Install line filters within the body of the fixtures and wired in series with the supply circuit conductors to eliminate the transmission of radio frequency energy into the supply circuit.

2.8 EXIT LIGHT FIXTURES

- A. Exit light fixtures shall meet applicable requirements of NFPA 101 and UL 924.
- B. Housing and Canopy:
 - 1. Shall be made of cast or extruded aluminum, or rolled steel.
 - 2. Optional steel housing shall be a minimum 20 gauge thick or equivalent strength aluminum.
 - 3. Steel housing shall have baked enamel over corrosion resistant, matte black or ivory white primer.
- C. Door frame shall be cast or extruded aluminum, and hinged with latch.
- D. Finish shall be satin or fine-grain brushed aluminum.
- E. There shall be no radioactive material used in the fixtures.
- F. Fixtures:
 - 1. Inscription panels shall be cast or stamped aluminum a minimum of 2.25 mm (0.090 inch) thick, stenciled with 150 mm (6 inch) high letters, baked with red color stable plastic or fiberglass. Lamps shall be luminous red Light Emitting Diodes (LED) mounted in center of letters on red color stable plastic or fiberglass. The LED shall be rated minimum 25 years life; maximum of 3.5 watts for single face and 7 watts for double-faced fixtures that do not use diffuser panels in front of the LEDs. LED exit light fixtures that use diffuser panels shall require a maximum of 1.0 watt per fixture for single or double face fixtures.
 - 2. Double-Faced Fixtures: Provide double-faced fixtures where required or as shown on drawings.
 - 3. Directional Arrows: Provide directional arrows as part of the inscription panel where required or as shown on drawings. Directional arrows shall be the "chevron-type" of similar size and width as the letters and meet the requirements of NFPA 101.
- G. Voltages: Fixtures shall be wired for voltage as shown on schedule.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Installation shall be in accordance with the NEC, manufacturer's instructions and as shown on the drawings or specified.
- B. Align, mount and level the lighting fixtures uniformly.

- C. Avoid interference with and provide clearance for equipment. Where the indicated locations for the lighting fixtures conflict with the locations for equipment, change the locations for the lighting fixtures by the minimum distances necessary as approved by the Resident Engineer.
- D. For suspended lighting fixtures, the mounting heights shall provide the clearances between the bottoms of the fixtures and the finished floors as shown on the drawings.
- E. Fluorescent bed light fixtures shall be attached to the studs in the walls. Attachment to gypsum board only is not acceptable.
- F. Lighting Fixture Supports:
 - 1. Shall provide support for all of the fixtures. Supports may be anchored to channels of the ceiling construction, to the structural slab or to structural members within a partition, or above a suspended ceiling.
 - 2. Shall maintain the fixture positions after cleaning and relamping.
 - 3. Shall support the lighting fixtures without causing the ceiling or partition to deflect.
 - 4. Hardware for recessed fluorescent fixtures:
 - a. Where the suspended ceiling system is supported at the four corners of the fixture opening, hardware devices shall clamp the fixture to the ceiling system structural members, or plaster frame at not less than four points in such a manner as to resist spreading of the support members and safely lock the fixture into the ceiling system.
 - b. Where the suspended ceiling system is not supported at the four corners of the fixture opening, hardware devices shall independently support the fixture from the building structure at four points.
 - 5. Hardware for surface mounting fluorescent fixtures to suspended ceilings:
 - a. In addition to being secured to any required outlet box, fixtures shall be bolted to a grid ceiling system at four points spaced near the corners of each fixture. The bolts shall be not less than 6 mm (1/4 inch) secured to channel members attached to and spanning the tops of the ceiling structural grid members. Non-turning studs may be attached to the ceiling structural grid members or spanning channels by special clips designed for the purpose, provided they lock into place and require simple tools for removal.
 - b. In addition to being secured to any required outlet box, fixtures shall be bolted to a plaster ceiling at four points spaced near the corners of each fixture. Pre-positioned 6 mm (1/4 inch) studs or threaded plaster inserts secured to ceiling structural members shall be used to bolt the fixtures to the ceiling. In lieu of the above, 6 mm (1/4 inch)

toggle bolts may be used on new or existing ceiling provided the plaster and lath can safely support the fixtures without sagging or cracking.

- G. Furnish and install the specified lamps for all lighting fixtures installed and all existing lighting fixtures reinstalled under this project.
- H. Coordinate between the electrical and ceiling trades to ascertain that approved lighting fixtures are furnished in the proper sizes and installed with the proper devices (hangers, clips, trim frames, flanges), to match the ceiling system being installed.
- I. Bond lighting fixtures and metal accessories to the grounding system as specified in Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS.
- J. At completion of project, relamp all fixtures which have failed/burned-out lamps. Clean all fixtures, lenses, diffusers and louvers that have accumulated dust/dirt during construction.

--- E N D ---

SECTION 26 56 00
EXTERIOR LIGHTING

PART 1 - GENERAL

1.1 DESCRIPTION

This section specifies the furnishing, installation, and connection of exterior luminaries, controls, poles and supports.

1.2 RELATED WORK

- A. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: General electrical requirements and items that are common to more than one section of Division 26.
- B. Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS: Conduits, fittings, and boxes for raceway systems.
- C. Section 26 05 21, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES (600 VOLTS AND BELOW): Low voltage power and lighting wiring.
- D. Section 26 05 41, UNDERGROUND ELECTRICAL CONSTRUCTION: Underground handholes and conduits.
- E. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS: Requirements for personnel safety and to provide a low impedance path for possible ground fault currents.

1.3 SUBMITTALS

- A. Submit in accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
- B. Shop Drawings:
 - 1. Sufficient information, clearly presented, shall be included to determine compliance with drawings and specifications.
 - 2. Include electrical ratings, dimensions, mounting, details, materials, required clearances, terminations, wiring and connection diagrams, photometric data, ballasts, poles, luminaries, lamps and controls.
- C. Manuals: Two weeks prior to final inspection, submit four copies of operating and maintenance manuals to the Resident Engineer. Include technical data sheets, wiring and connection diagrams, and information for ordering replacement parts.
- D. Certifications: Two weeks prior to final inspection, submit four copies of the following to the Resident Engineer:
 - 1. Certification that the materials are in accordance with the drawings and specifications.

2. Certification, by the Contractor, that the complete installation has been properly installed and tested.

1.4 APPLICABLE PUBLICATIONS

Publications listed below (including amendments, addenda, revisions, supplements and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by the basic designation only.

A. Aluminum Association Inc. (AA):

AAH35.1-2006Alloy and Temper Designation Systems for Aluminum

B. American Association of State Highway and Transportation Officials (AASHTO):

LTS-4-2003Structural Supports for Highway Signs, Luminaries and Traffic
Signals

C. American Concrete Institute (ACI):

318-2005Building Code Requirements for Structural Concrete

D. American National Standards Institute (ANSI):

C57.12-2000General Requirements For Liquid-Immersed Distribution,
Power, and Regulating Transformers

C81.61-2005Electrical Lamp Bases

E. American Society for Testing and Materials (ASTM):

A123/A123M-2002Zinc (Hot-Dip Galvanized) Coatings on Iron and Steel Products

A153/A153M-2001Zinc Coating (Hot-Dip) on Iron and Steel Hardware – AASHTO
No.: M232

B108-03a -2003Aluminum-Alloy Permanent Mold Castings

D3487-2000Mineral Insulating Oil Used in Electrical Apparatus

F. Illuminating Engineering Society of North America (IESNA)

HB-9-2000Lighting Handbook

RP-8-2000 (R-2005)Roadway Lighting

G. National Fire Protection Association (NFPA):

70-2011National Electrical Code (NEC)

H. Underwriters Laboratories, Inc. (UL):

496-2004Edison-Base Lamp holders

773-1995Plug-in, Locking Type Photo controls, for Use with Area
Lighting

773A-2006Non-industrial Photoelectric Switches for Lighting Control

1598-2004Luminaires

1.5 DELIVERY, STORAGE, AND HANDLING

Poles: Do not store poles on ground. Store poles so they are at least 305 mm (one foot) above ground level and growing vegetation. Do not remove factory-applied pole wrappings until just before installing pole.

PART 2 - PRODUCTS

2.1 MATERIALS AND EQUIPMENT

Materials and equipment shall be in accordance with NEC, UL, ANSI, and as shown on the drawings and specified.

2.2 POLES

A. General:

1. Poles shall be as shown on the drawings, and as specified. Finish shall be as specified on the drawings.
2. The pole and arm assembly shall be designed for wind loading of 90 miles per hour, with an additional 30 percent gust factor, supporting luminaire(s) having the effective projected areas indicated. The effective projected area of the pole shall be applied at the height of the pole base as shown on the drawings.
3. Poles shall be base mounted type designed for use with underground supply conductors. Poles shall have handhole having a minimum clear opening of 65 by 125 mm (2.5 by 5 inches). Handhole cover shall be secured by stainless steel captive screws.
4. Provide a steel-grounding stud opposite hand hole openings.
5. Hardware: All necessary hardware shall be 300 series stainless steel.

B. Types:

Steel:

1. Poles shall be designed to meet AASHTO-LTS-4, 2001 loadings for highway and sportslighting poles and to ANSI loadings for distribution poles.
2. Provide steel poles having minimum 11-gage steel with minimum yield/strength of 48,000 psi and factory finish.
3. Provide a pole grounding connection designed to prevent electrolysis when used with copper ground wire.
4. Base covers for steel poles shall be structural quality hot-rolled carbon steel plate having a minimum yield of 36,000 psi.

7. All fasteners must be stainless steel, hot dip galvanized as per ASTM A153 or zinc alloy as per AC41A. All structural steel shall be hot dip galvanized in accordance with ASTM A123 and shall conform to ASTM A3.

2.3 FOUNDATIONS FOR POLES

- A. Foundations and backfill shall support the effective projected area of the specified pole, arm(s), and luminaire(s) under wind conditions previously specified in this section.
- B. Prior to pole installation, install a copperclad steel ground rod, not less than 19 mm (3/4-inch) diameter by 3000 mm (10 feet) long, below each foundation. Drive the rod vertically under the foundation so not less than 1800 mm (6 feet) of rod is in contact with the earth. Where rock or layered rock is present, drill a hole not less than 50 mm (2 inches) in diameter and 1800 mm (6 feet) deep, backfill with tamped fine sand and drive the rod into the hole. Bond the rod to the pole with not less than number 6 AWG bare copper wires. The method of bonding shall be approved for the purpose.

2.4 LUMINAIRES

- A. UL 1598 and NEMA C136.17. Luminaries shall be weatherproof, heavy duty, outdoor types designed for efficient light utilization, adequate dissipation of lamp and ballast heat and safe cleaning and relamping.
- B. Incorporate ballasts in the luminaire housing except where otherwise shown on the drawings.
- D. Lenses shall be frame-mounted heat-resistant, polycarbonate prismatic refractors. Attach the frame to the luminaire housing by hinges or chain. Use heat and aging resistant resilient gaskets to seal and cushion lenses and refractors in luminary doors.
- F. Pre-wire internal components to terminal strips at the factory.
- G. Bracket mounted luminaries shall have leveling provisions and clamp type adjustable slip-fitters with locking screws.
- H. Materials shall be rustproof. Latches and fittings shall be non-ferrous metal.
- I. IESNA Cutoff Category: Non cutoff

2.5 LAMPS

- A. Install the proper lamps in every luminaire installed, as specified, where applicable.
- B. Lamps to be general-service, outdoor lighting types, as specified, where applicable.

2.8 CONTROLS

- A. Each Lighting System:
 1. Shall be controlled by one of the following methods as shown for each system on the drawings:

- a. A luminaire mounted 120 volt 20 ampere photocell to act as the control device and control remaining downstream lighting circuit connected pole mounted luminaires. The photocell shall be the type which fails safe to the closed position meeting UL 773 or 773A.
- 2. Photocells shall have the following features:
 - a. Quick-response, cadmium-sulfide type.
 - b. A 15 to 30 second, built-in time delay to prevent response to momentary lightning flashes, car headlights or cloud movements.
 - c. Energizes the system when the north sky light decreases to approximately 1.5 footcandles, and maintains the system energized until the north sky light increases to approximately 3 to 5 foot candles.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Install lighting in accordance with the NEC, as shown on the drawings, and in accordance with manufacturer's recommendations.
- B. Foundation Excavation: Depth shall be as indicated and as recommended by manufacturer. Dig holes large enough to permit the proper use of tampers to the full depth of the hole. Install pole plumb and true and place aggregate backfill in the hole in 150 mm (6 inch) maximum layers and thoroughly tamp. Place surplus earth around the pole in a conical shape and pack tightly to drain water away.
- D. Photocell Switch Aiming: Aim switch according to manufacturer's recommendations. Mount switch on or beside each luminaire indicated.

3.2 GROUNDING

Ground noncurrent-carrying parts of equipment including metal and concrete poles, luminaries, mounting arms, brackets, and metallic enclosures as specified in Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS. Where copper grounding conductor is connected to a metal other than copper, provide specially treated or lined connectors suitable and listed for this purpose.

- - - E N D - - -

SECTION 27 05 11
REQUIREMENTS FOR COMMUNICATIONS INSTALLATIONS

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This Section, Requirements for Communications Installations, applies to all sections of Division 27.
- B. Furnish and install communications cabling, systems, equipment, and accessories in accordance with the specifications and drawings. Capacities and ratings of transformers, cable, and other items and arrangements for the specified items are shown on drawings.

1.2 MINIMUM REQUIREMENTS

- A. References to industry and trade association standards and codes are minimum installation requirement standards.
- B. Drawings and other specification sections shall govern in those instances where requirements are greater than those specified in the above standards.

1.3 QUALIFICATIONS (PRODUCTS AND SERVICES)

- A. Manufacturers Qualifications: The manufacturer shall regularly and presently produce, as one of the manufacturer's principal products, the equipment and material specified for this project, and shall have manufactured the item for at least three years.
- B. Product Qualification:
 - 1. Manufacturer's product shall have been in satisfactory operation, on three installations of similar size and type as this project, for approximately three years.
 - 2. The Government reserves the right to require the Contractor to submit a list of installations where the products have been in operation before approval.
- C. Service Qualifications: There shall be a permanent service organization maintained or trained by the manufacturer which will render satisfactory service to this installation within four hours of receipt of notification that service is needed. Submit name and address of service organizations.

1.4 MANUFACTURED PRODUCTS

- A. Materials and equipment furnished shall be of current production by manufacturers regularly engaged in the manufacture of such items, for which replacement parts shall be available.
- B. When more than one unit of the same class of equipment is required, such units shall be the product of a single manufacturer.
- C. Equipment Assemblies and Components:
 - 1. Components of an assembled unit need not be products of the same manufacturer.

2. Manufacturers of equipment assemblies, which include components made by others, shall assume complete responsibility for the final assembled unit.
3. Components shall be compatible with each other and with the total assembly for the intended service.
4. Constituent parts which are similar shall be the product of a single manufacturer.

D. Factory wiring shall be identified on the equipment being furnished and on all wiring diagrams.

1.5 EQUIPMENT REQUIREMENTS

- A. Where variations from the contract requirements are requested in accordance with Section 00 72 00, GENERAL CONDITIONS and Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES, the connecting work and related components shall include, but not be limited to additions or changes to branch circuits, circuit protective devices, conduits, wire, feeders, controls, panels and installation methods.

1.6 EQUIPMENT PROTECTION

- A. Equipment and materials shall be protected during shipment and storage against physical damage, dirt, moisture, cold and rain:
1. During installation, enclosures, equipment, controls, controllers, circuit protective devices, and other like items, shall be protected against entry of foreign matter; and be vacuum cleaned both inside and outside before testing and operating and repainting if required.
 2. Damaged equipment shall be, as determined by the Resident Engineer, placed in first class operating condition or be returned to the source of supply for repair or replacement.
 3. Painted surfaces shall be protected with factory installed removable heavy kraft paper, sheet vinyl or equal.
 4. Damaged paint on equipment and materials shall be refinished with the same quality of paint and workmanship as used by the manufacturer so repaired areas are not obvious.

1.7 WORK PERFORMANCE

- A. Job site safety and worker safety is the responsibility of the contractor.
- B. For work on existing stations, arrange, phase and perform work to assure communications service for other buildings at all times. Refer to Article OPERATIONS AND STORAGE AREAS under Section 01 00 00, GENERAL REQUIREMENTS.
- C. New work shall be installed and connected to existing work neatly and carefully. Disturbed or damaged work shall be replaced or repaired to its prior conditions, as required by Section 01 00 00, GENERAL REQUIREMENTS.

- D. Coordinate location of equipment and pathways with other trades to minimize interferences. See Section 00 72 00, GENERAL CONDITIONS.

1.8 EQUIPMENT INSTALLATION AND REQUIREMENTS

- A. Equipment location shall be as close as practical to locations shown on the drawings.
- B. Inaccessible Equipment:
 - 1. Where the Government determines that the Contractor has installed equipment not conveniently accessible for operation and maintenance, the equipment shall be removed and reinstalled as directed at no additional cost to the Government.
 - 2. "Conveniently accessible" is defined as being capable of being reached without the use of ladders, or without climbing or crawling under or over obstacles such as, but not limited to, motors, pumps, belt guards, transformers, piping, ductwork, conduit and raceways.

1.9 EQUIPMENT IDENTIFICATION

- A. Install an identification sign which clearly indicates information required for use and maintenance of equipment.
- B. Nameplates shall be laminated black phenolic resin with a white core with engraved lettering, a minimum of 6 mm (1/4 inch) high. Secure nameplates with screws. Nameplates that are furnished by manufacturer as a standard catalog item, or where other method of identification is herein specified, are exceptions.

1.10 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. The Government's approval shall be obtained for all equipment and material before delivery to the job site. Delivery, storage, or installation of equipment or material which has not had prior approval will not be permitted at the job site.
- C. All submittals shall include adequate descriptive literature, catalog cuts, shop drawings, and other data necessary for the Government to ascertain that the proposed equipment and materials comply with specification requirements. Catalog cuts submitted for approval shall be legible and clearly identify equipment being submitted.
- D. Submittals for individual systems and equipment assemblies which consist of more than one item or component shall be made for the system or assembly as a whole. Partial submittals will not be considered for approval.
 - 1. Mark the submittals, "SUBMITTED UNDER SECTION _____".

2. Submittals shall be marked to show specification reference including the section and paragraph numbers.
 3. Submit each section separately.
- E. The submittals shall include the following:
1. Information that confirms compliance with contract requirements. Include the manufacturer's name, model or catalog numbers, catalog information, technical data sheets, shop drawings, pictures, nameplate data and test reports as required.
 3. Elementary and interconnection wiring diagrams for communication and signal systems, control system and equipment assemblies. All terminal points and wiring shall be identified on wiring diagrams.
 4. Parts list which shall include those replacement parts recommended by the equipment manufacturer, quantity of parts, current price and availability of each part.
- F. Manuals: Submit in accordance with Section 01 00 00, GENERAL REQUIREMENTS.
1. Maintenance and Operation Manuals: Submit as required for systems and equipment specified in the technical sections. Furnish four copies, bound in hardback binders, (manufacturer's standard binders) or an approved equivalent. Furnish one complete manual as specified in the technical section but in no case later than prior to performance of systems or equipment test, and furnish the remaining manuals prior to contract completion.
 2. Inscribe the following identification on the cover: the words "MAINTENANCE AND OPERATION MANUAL," the name and location of the system, equipment, building, name of Contractor, and contract number. Include in the manual the names, addresses, and telephone numbers of each subcontractor installing the system or equipment and the local representatives for the system or equipment.
 3. Provide a "Table of Contents" and assemble the manual to conform to the table of contents, with tab sheets placed before instructions covering the subject. The instructions shall be legible and easily read, with large sheets of drawings folded in.
 4. The manuals shall include:
 - a. Internal and interconnecting wiring and control diagrams with data to explain detailed operation and control of the equipment.
 - b. A control sequence describing start-up, operation, and shutdown.
 - c. Description of the function of each principal item of equipment.
 - d. Installation and maintenance instructions.
 - e. Safety precautions.

- f. Diagrams and illustrations.
 - g. Testing methods.
 - h. Performance data.
 - i. Pictorial "exploded" parts list with part numbers. Emphasis shall be placed on the use of special tools and instruments. The list shall indicate sources of supply, recommended spare parts, and name of servicing organization.
 - j. Appendix; list qualified permanent servicing organizations for support of the equipment, including addresses and certified qualifications.
- G. Approvals will be based on complete submission of manuals together with shop drawings.
- H. After approval and prior to installation, furnish the Resident Engineer with one sample of each of the following:
- 1. A 300 mm (12 inch) length of each type and size of wire and cable along with the tag from the coils of reels from which the samples were taken.
 - 2. Each type of conduit and pathway coupling, bushing and termination fitting.
 - 3. Raceway and pathway hangers, clamps and supports.
 - 4. Duct sealing compound.

1.11 SINGULAR NUMBER

Where any device or part of equipment is referred to in these specifications in the singular number (e.g., "the switch"), this reference shall be deemed to apply to as many such devices as are required to complete the installation as shown on the drawings.

1.12 TRAINING

- A. Training shall be provided in accordance with Article, INSTRUCTIONS, of Section 01 00 00, GENERAL REQUIREMENTS.
- B. Training shall be provided for the particular equipment or system as required in each associated specification.
- C. A training schedule shall be developed and submitted by the contractor and approved by the Resident Engineer at least 30 days prior to the planned training.

--- E N D ---

SECTION 27 05 26
GROUNDING AND BONDING FOR COMMUNICATIONS SYSTEMS

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This section specifies general grounding and bonding requirements of telecommunication installations for equipment operations.
- B. "Grounding electrode system" refers to all electrodes required by NEC, as well as including made, supplementary, telecommunications system grounding electrodes.
- C. The terms "connect" and "bond" are used interchangeably in this specification and have the same meaning.

1.2 RELATED WORK

- A. Section 27 05 11, REQUIREMENTS FOR COMMUNICATIONS INSTALLATIONS: General electrical requirements and items that are common to more than one section of Division 27.
- B. Section 27 10 00, STRUCTURED CABLING: Low Voltage power and lighting wiring.

1.3 SUBMITTALS

- A. Submit in accordance with Section 27 05 11, REQUIREMENTS FOR COMMUNICATIONS INSTALLATIONS.
- B. Shop Drawings:
 - 1. Sufficient information, clearly presented, shall be included to determine compliance with drawings and specifications.
 - 2. Include the location of system grounding electrode connections and the routing of aboveground and underground grounding electrode conductors.
- C. Test Reports: Provide certified test reports of ground resistance.
- D. Certifications: Two weeks prior to final inspection, submit four copies of the following to the Resident Engineer:
 - 1. Certification that the materials and installation is in accordance with the drawings and specifications.
 - 2. Certification, by the Contractor, that the complete installation has been properly installed and tested.

1.4 APPLICABLE PUBLICATIONS

Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by the basic designation only.

- A. American Society for Testing and Materials (ASTM):

- B1-2001Standard Specification for Hard-Drawn Copper Wire
- B8-2004Standard Specification for Concentric-Lay-Stranded Copper
Conductors, Hard, Medium-Hard, or Soft
- B. Institute of Electrical and Electronics Engineers, Inc. (IEEE):
 - 81-1983IEEE Guide for Measuring Earth Resistivity, Ground
Impedance, and Earth Surface Potentials of a Ground System
- C. National Fire Protection Association (NFPA):
 - 70-2011National Electrical Code (NEC)
- D. Telecommunications Industry Association, (TIA)
 - J-STO-607-A-2002Commercial Building Grounding (Earthing) and Bonding
Requirements for Telecommunications
- E. Underwriters Laboratories, Inc. (UL):
 - 44-2005Thermoset-Insulated Wires and Cables
 - 83-2003Thermoplastic-Insulated Wires and Cables
 - 467-2004Grounding and Bonding Equipment
 - 486A-486B-2003Wire Connectors

PART 2 - PRODUCTS

2.1 GROUNDING AND BONDING CONDUCTORS

- A. Equipment grounding conductors shall be UL 83 insulated stranded copper, except that sizes 6 mm² (10 AWG) and smaller shall be solid copper. Insulation color shall be continuous green for all equipment grounding conductors, except that wire sizes 25 mm² (4 AWG) and larger shall be permitted to be identified per NEC.
- B. Bonding conductors shall be ASTM B8 bare stranded copper, except that sizes 6 mm² (10 AWG) and smaller shall be ASTM B1 solid bare copper wire.
- C. Isolated Power System: Type XHHW-2 insulation with a dielectric constant of 3.5 or less.
- D. Telecom System Grounding Riser Conductor: Telecommunications Grounding Riser shall be in accordance with J STO-607A. Use a minimum 50mm² (1/0 AWG) insulated stranded copper grounding conductor unless indicated otherwise.

2.2 GROUND RODS

- A. Copper clad steel, 19 mm (3/4-inch) diameter by 3000 mm (10 feet) long, conforming to UL 467.
- B. Quantity of rods shall be as required to obtain the specified ground resistance.

2.3 SPLICES AND TERMINATION COMPONENTS

Components shall meet or exceed UL 467 and be clearly marked with the manufacturer, catalog number, and permitted conductor size(s).

2.4 TELECOMMUNICATION SYSTEM GROUND BUSBARS

- A. Provide solid copper busbar, pre-drilled from two-hole lug connections with a minimum thickness of 6 mm (1/4 inch) for wall and backboard mounting using standard insulators sized as follows:
 - 1. Telecom Room Ground: 450 mm x 100 mm (18 inches x 4 inch).
 - 2. Master Signal Ground: 600 mm x 100 mm (24 inches x 4 inch).

2.5 GROUND CONNECTIONS

- A. Below Grade: Exothermic-welded type connectors.
- B. Above Grade:
 - 1. Bonding Jumpers: compression type connectors, using zinc-plated fasteners and external tooth lockwashers.
 - 2. Ground Busbars: Two-hole compression type lugs using tin-plated copper or copper alloy bolts and nuts.
 - 3. Rack and Cabinet Ground Bars: one-hole compression-type lugs using zinc-plated or copper alloy fasteners.
- A. Cable Shields: Make ground connections to multipair communications cables with metallic shields using shield bonding connectors with screw stud connection.

2.6 EQUIPMENT RACK AND CABINET GROUND BARS

Provide solid copper ground bars designed for mounting on the framework of open or cabinet-enclosed equipment racks with minimum dimensions of 4 mm thick by 19 mm wide (3/8 inch x 3/4 inch).

2.7 GROUND TERMINAL BLOCKS

At any equipment mounting location (e.g. backboards and hinged cover enclosures) where rack-type ground bars cannot be mounted, provide screw lug-type terminal blocks.

2.8 SPLICE CASE GROUND ACCESSORIES

Splice case grounding and bonding accessories shall be supplied by the splice case manufacturer when available. Otherwise, use 16 mm² (6 AWG) insulated ground wire with shield bonding connectors.

PART 3 - EXECUTION

3.1 GENERAL

- A. Ground in accordance with the NEC, as shown on drawings, and as hereinafter specified.
- B. Equipment Grounding: Metallic structures (including ductwork and building steel), enclosures, raceways, junction boxes, outlet boxes, cabinets, machine frames, and other conductive items in close proximity with electrical circuits shall be bonded and grounded.

3.2 INACCESSIBLE GROUNDING CONNECTIONS

Make grounding connections, which are buried or otherwise normally inaccessible (except connections for which periodic testing access is required) by exothermic weld.

3.3 CORROSION INHIBITORS

- A. When making ground and ground bonding connections, apply a corrosion inhibitor to all contact surfaces. Use corrosion inhibitor appropriate for protecting a connection between the metals used.

3.4 CONDUCTIVE PIPING

- A. Bond all conductive piping systems, interior and exterior, to the building to the grounding electrode system. Bonding connections shall be made as close as practical to the equipment ground bus.
- B. In operating rooms and at intensive care and coronary care type beds, bond the gases and suction piping, at the outlets, directly to the room or patient ground bus.

3.5 TELECOMMUNICATIONS SYSTEM

- A. Bond telecommunications system grounding equipment to the electrical grounding electrode system.
- B. Furnish and install all wire and hardware required to properly ground, bond and connect communications raceway, cable tray, metallic cable shields, and equipment to a ground source.
- C. Ground bonding jumpers shall be continuous with no splices. Use the shortest length of bonding jumper possible.
- D. Provide ground paths that are permanent and continuous with a resistance of 1 ohm or less from raceway, cable tray, and equipment connections to the building grounding electrode. The resistance across individual bonding connections shall be 10 milli ohms or less.
- E. Below-Grade Grounding Connections: When making exothermic welds, wire brush or file the point of contact to a bare metal surface. Use exothermic welding cartridges and molds in accordance with the manufacturer's recommendations. After welds have been made and cooled, brush slag from the weld area and thoroughly cleaned the joint area. Notify the Resident Engineer prior to backfilling any ground connections.
- F. Above-Grade Grounding Connections: When making bolted or screwed connections to attach bonding jumpers, remove paint to expose the entire contact surface by grinding where necessary; thoroughly clean all connector, plate and other contact surfaces; and apply an appropriate corrosion inhibitor to all surfaces before joining.
- G. Bonding Jumpers:

1. Use insulated ground wire of the size and type shown on the Drawings or use a minimum of 16 mm² (6 AWG) insulated copper wire.
2. Assemble bonding jumpers using insulated ground wire terminated with compression connectors.
3. Use compression connectors of proper size for conductors specified. Use connector manufacturer's compression tool.

H. Bonding Jumper Fasteners:

1. Conduit: Fasten bonding jumpers using screw lugs on grounding bushings or conduit strut clamps, or the clamp pads on push-type conduit fasteners. When screw lug connection to a conduit strut clamp is not possible, fasten the plain end of a bonding jumper wire by slipping the plain end under the conduit strut clamp pad; tighten the clamp screw firmly. Where appropriate, use zinc-plated external tooth lockwashers.
2. Wireway and Cable Tray: Fasten bonding jumpers using zinc-plated bolts, external tooth lockwashers, and nuts. Install protective cover, e.g., zinc-plated acorn nuts on any bolts extending into wireway or cable tray to prevent cable damage.
3. Ground Plates and Busbars: Fasten bonding jumpers using two-hole compression lugs. Use tin-plated copper or copper alloy bolts, external tooth lockwashers, and nuts.
4. Unistrut and Raised Floor Stringers: Fasten bonding jumpers using zinc-plated, self-drill screws and external tooth lockwashers.

3.6 COMMUNICATION ROOM GROUNDING

A. Telecommunications Ground Busbars:

1. Provide communications room telecommunications ground busbar hardware at 950 mm (18 inches) at locations indicated on the Drawings.
2. Connect the telecommunications room ground busbars to other room grounding busbars as indicated on the Grounding Riser diagram.

B. Backboards: Provide a screw lug-type terminal block or drilled and tapped copper strip near the top of backboards used for communications cross-connect systems. Connect backboard ground terminals to the aluminum pan in the telephone-type cable tray using an insulated 16 mm² (16 AWG) bonding jumper.

C. Other Communication Room Ground Systems: Ground all metallic conduit, wireways, and other metallic equipment located away from equipment racks or cabinets to the cable tray pan or the telecommunications ground busbar, whichever is closer, using insulated 16 mm² (6 AWG) ground wire bonding jumpers.

3.7 COMMUNICATIONS CABLE GROUNDING

- A. Bond all metallic cable sheaths in multipair communications cables together at each splicing and/or terminating location to provide 100 percent metallic sheath continuity throughout the communications distribution system.
 - 1. At terminal points, install a cable shield bonding connector provide a screw stud connection for ground wire. Use a bonding jumper to connect the cable shield connector to an appropriate ground source like the rack or cabinet ground bar.
 - 2. Bond all metallic cable shields together within splice closures using cable shield bonding connectors or the splice case grounding and bonding accessories provided by the splice case manufacturer. When an external ground connection is provided as part of splice closure, connect to an approved ground source and all other metallic components and equipment at that location.

3.8 COMMUNICATIONS CABLE TRAY SYSTEMS:

- A. Bond the metallic structures of one cable tray in each tray run following the same path to provide 100 percent electrical continuity throughout this cable tray systems as follows:
 - 1. Splice plates provided by the cable tray manufacturer can be used for providing a ground bonding connection between cable tray sections when the resistance across a bolted connection is 10 milliohms or less. The Subcontractor shall verify this loss by testing across one splice plate connection in the presence of the Contractor.
 - 2. Install a 16 mm² (6 AWG) bonding jumper across each cable tray splice or junction where splice plates cannot be used.
 - 3. When cable tray terminations to cable rack, install 16 mm² (6 AWG) bonding jumper between cable tray and cable rack pan.

3.9 COMMUNICATIONS RACEWAY GROUNDING

- A. Conduit: Use insulated 16 mm² (6 AWG) bonding jumpers to ground metallic conduit at each end and to bond at all intermediate metallic enclosures.
- B. Wireway: use insulated 16 mm² (6 AWG) bonding jumpers to ground or bond metallic wireway at each end at all intermediate metallic enclosures and across all section junctions.
- C. Cable Tray Systems: Use insulated 16 mm² (6 AWG) bonding jumpers to ground cable tray to column-mounted building ground plates (pads) at each end and approximately every 16 meters (50 feet).

- - - E N D - - -

SECTION 27 05 33
RACEWAYS AND BOXES FOR COMMUNICATIONS SYSTEMS

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This section specifies the furnishing, installation, and connection of conduit, fittings, and boxes to form complete, coordinated, raceway systems. Raceways are required for all communications cabling unless shown or specified otherwise.
- B. Definitions: The term conduit, as used in this specification, shall mean any or all of the raceway types specified.

1.2 RELATED WORK

- A. Sealing around penetrations to maintain the integrity of fire rated construction: Section 07 84 00, FIRESTOPPING.
- B. Sealing around conduit penetrations through the building envelope to prevent moisture migration into the building: Section 07 92 00, JOINT SEALANTS.
- C. Identification and painting of conduit and other devices: Section 09 91 00, PAINTING.
- D. General electrical requirements and items that is common to more than one section of Division 27: Section 27 05 11, REQUIREMENTS FOR COMMUNICATIONS INSTALLATIONS.
- E. Requirements for personnel safety and to provide a low impedance path for possible ground fault currents: Section 27 05 26, GROUNDING AND BONDING FOR COMMUNICATIONS SYSTEMS.

1.3 SUBMITTALS

In accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES, furnish the following:

- A. Shop Drawings:
 - 1. Size and location of panels and pull boxes
 - 2. Layout of required conduit penetrations through structural elements.
 - 3. The specific item proposed and its area of application shall be identified on the catalog cuts.
- B. Certification: Prior to final inspection, deliver to the Resident Engineer four copies of the certification that the material is in accordance with the drawings and specifications and has been properly installed.

1.4 APPLICABLE PUBLICATIONS

- A. Publications listed below (including amendments, addenda, revisions, supplements and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by the basic designation only.
- B. National Fire Protection Association (NFPA):
 - 70-11 National Electrical Code (NEC)
- C. Underwriters Laboratories, Inc. (UL):
 - 1-03 Flexible Metal Conduit
 - 5-01 Surface Metal Raceway and Fittings
 - 6-03 Rigid Metal Conduit
 - 50-03 Enclosures for Electrical Equipment
 - 360-03 Liquid-Tight Flexible Steel Conduit
 - 467-01 Grounding and Bonding Equipment
 - 514A-01 Metallic Outlet Boxes
 - 514B-02 Fittings for Cable and Conduit
 - 514C-05 Nonmetallic Outlet Boxes, Flush-Device Boxes and Covers
 - 651-02 Schedule 40 and 80 Rigid PVC Conduit
 - 651A-03 Type EB and A Rigid PVC Conduit and HDPE Conduit
 - 797-03 Electrical Metallic Tubing
 - 1242-00 Intermediate Metal Conduit
- D. National Electrical Manufacturers Association (NEMA):
 - TC-3-04 PVC Fittings for Use with Rigid PVC Conduit and Tubing
 - FB1-03 Fittings, Cast Metal Boxes and Conduit Bodies for Conduit,
Electrical Metallic Tubing and Cable

PART 2 - PRODUCTS

2.1 MATERIAL

- A. Conduit Size: In accordance with the NEC, but not less than 13 mm (1 inch) unless otherwise shown.
- B. Conduit:
 - 1. Rigid galvanized steel: Shall Conform to UL 6, ANSI C80.1.
 - 2. Rigid aluminum: Shall Conform to UL 6A, ANSI C80.5.
 - 3. Rigid intermediate steel conduit (IMC): Shall Conform to UL 1242, ANSI C80.6.

4. Electrical metallic tubing (EMT): Shall Conform to UL 797, ANSI C80.3. Maximum size not to exceed 105 mm (4 inch) and shall be permitted only with cable rated 600 volts or less.
5. Flexible galvanized steel conduit: Shall Conform to UL 1.
6. Liquid-tight flexible metal conduit: Shall Conform to UL 360.
7. Direct burial plastic conduit: Shall conform to UL 651 and UL 651A, heavy wall PVC or high density polyethylene (PE).
8. Surface metal raceway: Shall Conform to UL 5.

C. Conduit Fittings:

1. Rigid steel and IMC conduit fittings:
 - a. Fittings shall meet the requirements of UL 514B and ANSI/ NEMA FB1.
 - a. Standard threaded couplings, locknuts, bushings, and elbows: Only steel or malleable iron materials are acceptable. Integral retractable type IMC couplings are also acceptable.
 - b. Locknuts: Bonding type with sharp edges for digging into the metal wall of an enclosure.
 - c. Bushings: Metallic insulating type, consisting of an insulating insert molded or locked into the metallic body of the fitting. Bushings made entirely of metal or nonmetallic material are not permitted.
 - d. Erickson (union-type) and set screw type couplings: Approved for use in concrete are permitted for use to complete a conduit run where conduit is installed in concrete. Use set screws of case hardened steel with hex head and cup point to firmly seat in conduit wall for positive ground. Tightening of set screws with pliers is prohibited.
 - e. Sealing fittings: Threaded cast iron type. Use continuous drain type sealing fittings to prevent passage of water vapor. In concealed work, install fittings in flush steel boxes with blank cover plates having the same finishes as that of other electrical plates in the room.
2. Rigid aluminum conduit fittings:
 - a. Standard threaded couplings, locknuts, bushings, and elbows: Malleable iron, steel or aluminum alloy materials; Zinc or cadmium plate iron or steel fittings. Aluminum fittings containing more than 0.4 percent copper are prohibited.
 - b. Locknuts and bushings: As specified for rigid steel and IMC conduit.
 - c. Set screw fittings: Not permitted for use with aluminum conduit.
3. Electrical metallic tubing fittings:
 - a. Fittings shall meet the requirements of UL 514B and ANSI/ NEMA FB1.

- b. Only steel or malleable iron materials are acceptable.
 - c. Couplings and connectors: Concrete tight and rain tight, with connectors having insulated throats. Use gland and ring compression type couplings and connectors for conduit sizes 50 mm (2 inches) and smaller. Use set screw type couplings with four set screws each for conduit sizes over 50 mm (2 inches). Use set screws of case-hardened steel with hex head and cup point to firmly seat in wall of conduit for positive grounding.
 - d. Indent type connectors or couplings are prohibited.
 - e. Die-cast or pressure-cast zinc-alloy fittings or fittings made of "pot metal" are prohibited.
4. Flexible steel conduit fittings:
- a. Conform to UL 514B. Only steel or malleable iron materials are acceptable.
 - b. Clamp type, with insulated throat.
5. Liquid-tight flexible metal conduit fittings:
- a. Fittings shall meet the requirements of UL 514B and ANSI/ NEMA FB1.
 - b. Only steel or malleable iron materials are acceptable.
 - c. Fittings must incorporate a threaded grounding cone, a steel or plastic compression ring, and a gland for tightening. Connectors shall have insulated throats.
6. Direct burial plastic conduit fittings:
- a. Fittings shall meet the requirements of UL 514C and NEMA TC3.
 - b. As recommended by the conduit manufacturer.
7. Surface metal raceway fittings: As recommended by the raceway manufacturer.
8. Expansion and deflection couplings:
- a. Conform to UL 467 and UL 514B.
 - b. Accommodate, 19 mm (0.75 inch) deflection, expansion, or contraction in any direction, and allow 30 degree angular deflections.
 - c. Include internal flexible metal braid sized to guarantee conduit ground continuity and fault currents in accordance with UL 467, and the NEC code tables for ground conductors.
 - d. Jacket: Flexible, corrosion-resistant, watertight, moisture and heat resistant molded rubber material with stainless steel jacket clamps.
- D. Conduit Supports:
- 1. Parts and hardware: Zinc-coat or provide equivalent corrosion protection.
 - 2. Individual Conduit Hangers: Designed for the purpose, having a pre-assembled closure bolt and nut, and provisions for receiving a hanger rod.

3. Multiple conduit (trapeze) hangers: Not less than 38 mm by 38 mm (1-1/2 by 1-1/2 inch), 12 gage steel, cold formed, lipped channels; with not less than 9 mm (3/8 inch) diameter steel hanger rods.
4. Solid Masonry and Concrete Anchors: Self-drilling expansion shields, or machine bolt expansion.

E. Cable Tray:

1. Mesh Type (Wire Basket)
2. Material: Regular Galvanized Wire (Min. .196" diam.)
3. Finish: Electrodeposited Zinc
4. Size: 12"x2" unless otherwise identified on Drawings.

F. J-Hooks

1. Open-top cable supports rated for use with Category 6 UTP cables.
2. Zinc plated for heavy duty use (100 lbs.)
3. With heavy duty support bar for multi-tier use.

G. D Rings and Mushrooms

1. D Ring Material: Metal
2. Mushroom Material: Plastic with center-mounted screw for attachment to plywood backboard.
3. Size: Appropriate for maximum quantity of cable.

H. Outlet, Junction, and Pull Boxes:

1. UL-50 and UL-514A.
2. Cast metal where required by the NEC or shown, and equipped with rustproof boxes.
3. Sheet metal boxes: Galvanized steel, except where otherwise shown.
4. Flush mounted wall or ceiling boxes shall be installed with raised covers so that front face of raised cover is flush with the wall. Surface mounted wall or ceiling boxes shall be installed with surface style flat or raised covers.

I. Wireways: Equip with hinged covers, except where removable covers are shown.

PART 3 - EXECUTION

3.1 PENETRATIONS

A. Cutting or Holes:

1. Locate holes in advance where they are proposed in the structural sections such as ribs or beams. Obtain the approval of the Resident Engineer prior to drilling through structural sections.

2. Cut holes through concrete and masonry in new and existing structures with a diamond core drill or concrete saw. Pneumatic hammer, impact electric, hand or manual hammer type drills are not allowed, except where permitted by the Resident Engineer as required by limited working space.
- B. Fire Stop: Where conduits, wireways, and other communications raceways pass through fire partitions, fire walls, smoke partitions, or floors, install a fire stop that provides an effective barrier against the spread of fire, smoke and gases as specified in Section 07 84 00, FIRESTOPPING, with rock wool fiber or silicone foam sealant only. Completely fill and seal clearances between raceways and openings with the fire stop material.
- C. Waterproofing: At floor, exterior wall, and roof conduit penetrations, completely seal clearances around the conduit and make watertight as specified in Section 07 92 00, JOINT SEALANTS.

3.2 INSTALLATION, GENERAL

- A. Install conduit as follows:
 1. In complete runs before pulling in cables or wires.
 2. Flattened, dented, or deformed conduit is not permitted. Remove and replace the damaged conduits with new undamaged material.
 3. Assure conduit installation does not encroach into the ceiling height head room, walkways, or doorways.
 4. Cut square with a hacksaw, ream, remove burrs, and draw up tight.
 5. Mechanically continuous.
 6. Independently support conduit at 8'0" on center. Do not use other supports i.e., (suspended ceilings, suspended ceiling supporting members, lighting fixtures, conduits, mechanical piping, or mechanical ducts).
 7. Support within 300 mm (1 foot) of changes of direction, and within 300 mm (1 foot) of each enclosure to which connected.
 8. Close ends of empty conduit with plugs or caps at the rough-in stage to prevent entry of debris, until wires are pulled in.
 9. Conduit installations under fume and vent hoods are prohibited.
 10. Secure conduits to cabinets, junction boxes, pull boxes and outlet boxes with bonding type locknuts. For rigid and IMC conduit installations, provide a locknut on the inside of the enclosure, made up wrench tight. Do not make conduit connections to junction box covers.
 11. Do not use aluminum conduits in wet locations.

12. Unless otherwise indicated on the drawings or specified herein, all conduits shall be installed concealed within finished walls, floors and ceilings.

B. Conduit Bends:

1. Make bends with standard conduit bending machines.
2. Conduit hickey may be used for slight offsets, and for straightening stubbed out conduits.
3. Bending of conduits with a pipe tee or vise is prohibited.

C. Layout and Homeruns:

2. Deviations: Make only where necessary to avoid interferences and only after drawings showing the proposed deviations have been submitted approved by the Resident Engineer.

3.3 CONCEALED WORK INSTALLATION

A. In Concrete:

1. Conduit: Rigid steel, IMC or EMT. Do not install EMT in concrete slabs that are in contact with soil, gravel or vapor barriers.
2. Align and run conduit in direct lines.
3. Install conduit through concrete beams only when the following occurs:
 - a. Where shown on the structural drawings.
 - b. As approved by the Resident Engineer prior to construction, and after submittal of drawing showing location, size, and position of each penetration.
4. Installation of conduit in concrete that is less than 75 mm (3 inches) thick is prohibited.
 - a. Conduit outside diameter larger than 1/3 of the slab thickness is prohibited.
 - b. Space between conduits in slabs: Approximately six conduit diameters apart, except one conduit diameter at conduit crossings.
 - c. Install conduits approximately in the center of the slab so that there will be a minimum of 19 mm (3/4 inch) of concrete around the conduits.
5. Make couplings and connections watertight. Use thread compounds that are UL approved conductive type to insure low resistance ground continuity through the conduits. Tightening set screws with pliers is prohibited.

B. Furred or Suspended Ceilings and in Walls:

1. Conduit for conductors above 600 volts:
 - a. Rigid steel or rigid aluminum.
 - b. Aluminum conduit mixed indiscriminately with other types in the same system is prohibited.
2. Conduit for conductors 600 volts and below:

- a. Rigid steel, IMC, rigid aluminum, or EMT. Different type conduits mixed indiscriminately in the same system is prohibited.
- 3. Align and run conduit parallel or perpendicular to the building lines.
- 4. Connect recessed lighting fixtures to conduit runs with maximum 1800 mm (six feet) of flexible metal conduit extending from a junction box to the fixture.
- 5. Tightening set screws with pliers is prohibited.

3.4 EXPOSED WORK INSTALLATION

- A. Unless otherwise indicated on the drawings, exposed conduit is only permitted in mechanical and electrical rooms.
- B. Conduit for Conductors 600 volts and below:
 - 1. Rigid steel, IMC, rigid aluminum, or EMT. Different type of conduits mixed indiscriminately in the system is prohibited.
- C. Align and run conduit parallel or perpendicular to the building lines.
- D. Install horizontal runs close to the ceiling or beams and secure with conduit straps.
- E. Support horizontal or vertical runs at not over 2400 mm (eight foot) intervals.
- F. Surface metal raceways: Use only where shown.
- G. Painting:
 - 1. Paint exposed conduit as specified in Section 09 91 00, PAINTING.
 - 2. Paint all conduits containing cables rated over 600 volts safety orange. Refer to Section 09 91 00, PAINTING for preparation, paint type, and exact color. In addition, paint legends, using 50 mm (two inch) high black numerals and letters, showing the cable voltage rating. Provide legends where conduits pass through walls and floors and at maximum 6000 mm (20 foot) intervals in between.

3.5 EXPANSION JOINTS

- A. Conduits 75 mm (3 inches) and larger, that are secured to the building structure on opposite sides of a building expansion joint, require expansion and deflection couplings. Install the couplings in accordance with the manufacturer's recommendations.
- B. Provide conduits smaller than 75 mm (3 inches) with junction boxes on both sides of the expansion joint. Connect conduits to junction boxes with sufficient slack of flexible conduit to produce 125 mm (5 inch) vertical drop midway between the ends. Flexible conduit shall have a copper green ground bonding jumper installed. In lieu of this flexible conduit, expansion and deflection couplings as specified above for 375 mm (15 inches) and larger conduits are acceptable.

- C. Install expansion and deflection couplings where shown.

3.6 CONDUIT SUPPORTS, INSTALLATION

- A. Safe working load shall not exceed 1/4 of proof test load of fastening devices.
- B. Use pipe straps or individual conduit hangers for supporting individual conduits. Maximum distance between supports is 2.5 m (8 foot) on center.
- C. Support multiple conduit runs with trapeze hangers. Use trapeze hangers that are designed to support a load equal to or greater than the sum of the weights of the conduits, wires, hanger itself, and 90 kg (200 pounds). Attach each conduit with U-bolts or other approved fasteners.
- D. Support conduit independently of junction boxes, pull boxes, fixtures, suspended ceiling T-bars, angle supports, and similar items.
- E. Fasteners and Supports in Solid Masonry and Concrete:
 - 1. New Construction: Use steel or malleable iron concrete inserts set in place prior to placing the concrete.
 - 2. Existing Construction:
 - a. Steel expansion anchors not less than 6 mm (1/4 inch) bolt size and not less than 28 mm (1-1/8 inch) embedment.
 - b. Power set fasteners not less than 6 mm (1/4 inch) diameter with depth of penetration not less than 75 mm (3 inches).
 - c. Use vibration and shock resistant anchors and fasteners for attaching to concrete ceilings.
- F. Hollow Masonry: Toggle bolts are permitted.
- G. Bolts supported only by plaster or gypsum wallboard are not acceptable.
- H. Metal Structures: Use machine screw fasteners or other devices specifically designed and approved for the application.
- I. Attachment by wood plugs, rawl plug, plastic, lead or soft metal anchors, or wood blocking and bolts supported only by plaster is prohibited.
- J. Chain, wire, or perforated strap shall not be used to support or fasten conduit.
- K. Spring steel type supports or fasteners are prohibited for all uses except: Horizontal and vertical supports/fasteners within walls.
- L. Vertical Supports: Vertical conduit runs shall have riser clamps and supports in accordance with the NEC and as shown. Provide supports for cable and wire with fittings that include internal wedges and retaining collars.

3.7 BOX INSTALLATION

- A. Boxes for Concealed Conduits:

1. Flush mounted.
 2. Provide raised covers for boxes to suit the wall or ceiling, construction and finish.
- B. In addition to boxes shown, install additional boxes where needed to prevent damage to cables and wires during pulling in operations.
- C. Remove only knockouts as required and plug unused openings. Use threaded plugs for cast metal boxes and snap-in metal covers for sheet metal boxes.
- D. Stencil or install phenolic nameplates on covers of the boxes identified on riser diagrams; for example "SIG-FA JB No. 1".

3.8 COMMUNICATION SYSTEM CONDUIT

- A. Install the communication raceway system as shown on drawings.
- B. Minimum conduit size of 19 mm (1 inch), but not less than the size shown on the drawings.
- C. All conduit ends shall be equipped with insulated bushings.
- D. All 100 mm (four inch) conduits within buildings shall include pull boxes after every two 90 degree bends. Size boxes per the NEC.
- E. Vertical conduits/sleeves through closets floors shall terminate not less than 75 mm (3 inches) below the floor and not less than 75 mm (3 inches) below the ceiling of the floor below.
- F. Terminate conduit runs to/from a backboard in a closet or interstitial space at the top or bottom of the backboard. Conduits shall enter communication closets next to the wall and be flush with the backboard.
- G. Where drilling is necessary for vertical conduits, locate holes so as not to affect structural sections such as ribs or beams.
- H. All empty conduits located in communication closets or on backboards shall be sealed with a standard non-hardening duct seal compound to prevent the entrance of moisture and gases and to meet fire resistance requirements.
- I. Conduit runs shall contain no more than four quarter turns (90 degree bends) between pull boxes/backboards. Minimum radius of communication conduit bends shall be as follows (special long radius):

Sizes of Conduit Trade Size	Radius of Conduit Bends mm, Inches
3/4	150 (6)
1	230 (9)
1-1/4	350 (14)
1-1/2	430 (17)
2	525 (21)
2-1/2	635 (25)
3	775 (31)
3-1/2	900 (36)
4	1125 (45)

J. Furnish and pull wire in all empty conduits. (Sleeves through floor are exceptions).

3.9 CABLE TRAY INSTALLATION

- A. Install the cable tray with minimum 6 inches of clear vertical space above suspended ceiling tiles and support channels to ensure accessibility.
- B. Support cable tray with minimum 3/8" all threaded-rod at 5 ft. intervals and not more than 2 ft. from ends and corners.

3.10 J-HOOK INSTALLATION

- A. Install at 4 ft. intervals at locations shown on Drawings.
- B. Install with minimum 12 inches of clear visible space above suspended ceiling tiles.

3.11 D-RING AND MUSHROOM INSTALLATION

- A. Provide D-Rings and Mushrooms at 12" maximum where required for cable management in communication rooms.
- B. All new cabling on backboards shall be supported with D-Rings and/or Mushrooms.

--- E N D ---

SECTION 27 10 00 STRUCTURED CABLING

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This section specifies the furnishing, installation, and connection of the structured cabling system to provide a comprehensive telecommunications infrastructure.

1.2 RELATED WORK

- A. Sealing around penetrations to maintain the integrity of time rated construction: Section 07 84 00, FIRESTOPPING.
- B. General electrical requirements that are common to more than one section in Division 27: Section 27 05 11, REQUIREMENTS FOR COMMUNICATIONS INSTALLATIONS.
- C. Conduits for cables and wiring: Section 27 05 33, RACEWAYS AND BOXES FOR COMMUNICATIONS SYSTEMS.
- D. Requirements for personnel safety and to provide a low impedance path for possible ground fault currents: Section 27 05 26, GROUNDING AND BONDING FOR COMMUNICATIONS SYSTEMS.

1.3 SUBMITTALS

- A. In accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES, furnish the following:
 - 1. Manufacturer's Literature and Data: Showing each cable type and rating.
 - 2. Certificates: Two weeks prior to final inspection, deliver to the Resident Engineer four copies of the certification that the material is in accordance with the drawings and specifications and has been properly installed.

1.4 APPLICABLE PUBLICATIONS

- A. Publications listed below (including amendments, addenda, revisions, supplements and errata) form a part of this specification to the extent referenced. Publications are reference in the text by the basic designation only.
- B. American Society of Testing Material (ASTM):
 - D2301-04Standard Specification for Vinyl Chloride Plastic Pressure Sensitive Electrical Insulating Tape
- C. Federal Specifications (Fed. Spec.):
 - A-A-59544-00Cable and Wire, Electrical (Power, Fixed Installation)
- D. National Fire Protection Association (NFPA):

- 70-11National Electrical Code (NEC)
- E. Underwriters Laboratories, Inc. (UL):
- 44-02Thermoset-Insulated Wires and Cables
- 83-03Thermoplastic-Insulated Wires and Cables
- 467-01Electrical Grounding and Bonding Equipment
- 486A-01Wire Connectors and Soldering Lugs for Use with Copper
Conductors
- 486C-02Splicing Wire Connectors
- 486D-02Insulated Wire Connector Systems for Underground Use or in
Damp or Wet Locations
- 486E-00.....Equipment Wiring Terminals for Use with Aluminum and/or
Copper Conductors
- 493-01Thermoplastic-Insulated Underground Feeder and Branch
Circuit Cable
- 514B-02Fittings for Cable and Conduit
- 1479-03Fire Tests of Through-Penetration Fire Stops

PART 2 - PRODUCTS

2.1 CONTROL WIRING

- A. Unless otherwise specified in other sections of these specifications, control wiring shall be as specified for power and lighting wiring, except the minimum size shall be not less than No. 14 AWG.
- B. Control wiring shall be large enough so that the voltage drop under inrush conditions does not adversely affect operation of the controls.

2.2 COMMUNICATION AND SIGNAL WIRING

- A. Shall conform to the recommendations of the manufacturers of the communication and signal systems; however, not less than what is shown.
- B. Wiring shown is for typical systems. Provide wiring as required for the systems being furnished.
- C. Multi-conductor cables shall have the conductors color coded.

2.3 WIRE LUBRICATING COMPOUND

- A. Suitable for the wire insulation and conduit it is used with, and shall not harden or become adhesive.
- B. Shall not be used on wire for isolated type electrical power systems.

PART 3 - EXECUTION**3.1 INSTALLATION, GENERAL**

- A. Install all wiring in raceway systems.
- B. Seal cable and wire entering a building from underground, between the wire and conduit where the cable exits the conduit, with a non-hardening approved compound.
- C. Wire Pulling:
 - 1. Provide installation equipment that will prevent the cutting or abrasion of insulation during pulling of cables.
 - 2. Use ropes made of nonmetallic material for pulling feeders.
 - 3. Attach pulling lines for feeders by means of either woven basket grips or pulling eyes attached directly to the conductors, as approved by the Resident Engineer.
 - 4. Pull in multiple cables together in a single conduit.

3.2 CONTROL, COMMUNICATION AND SIGNAL WIRING INSTALLATION

- A. Unless otherwise specified in other sections, install wiring and connect to equipment/devices to perform the required functions as shown and specified.
- B. Except where otherwise required, install a separate power supply circuit for each system so that malfunctions in any system will not affect other systems.
- C. Where separate power supply circuits are not shown, connect the systems to the nearest panelboards of suitable voltages, which are intended to supply such systems and have suitable spare circuit breakers or space for installation.
- D. Install a red warning indicator on the handle of the branch circuit breaker for the power supply circuit for each system to prevent accidental de-energizing of the systems.
- E. System voltages shall be 120 volts or lower where shown on the drawings or as required by the NEC.

3.3 CONTROL, COMMUNICATION AND SIGNAL SYSTEM IDENTIFICATION

- A. Install a permanent wire marker on each wire at each termination.
- B. Identifying numbers and letters on the wire markers shall correspond to those on the wiring diagrams used for installing the systems.
- C. Wire markers shall retain their markings after cleaning.
- D. In each manhole and handhole, install embossed brass tags to identify the system served and function.

3.4 EXISTING WIRING

Unless specifically indicated on the plans, existing wiring shall not be reused for the new installation. Only wiring that conforms to the specifications and applicable codes may be reused. If existing wiring does not meet these requirements, existing wiring may not be reused and new wires shall be installed.

--- E N D ---

SECTION 27 15 00
COMMUNICATIONS HORIZONTAL CABLING

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This Section specifies the furnishing, installing, certification, testing, and guaranty of a complete and operating Voice and Digital Cable Distribution System (here-in-after referred to as “*the System*”), and associated equipment and hardware to be installed in the VA Medical Center, here-in-after referred to as “the Facility”. The System shall include, but not be limited to: equipment cabinets, interface enclosures, and relay racks; necessary combiners, traps, and filters; and necessary passive devices such as: splitters, couplers, cable “patch”, “punch down”, and cross-connector blocks or devices, voice and data distribution sub-systems, and associated hardware. The System shall additionally include, but not be limited to: telecommunication closets (TC); telecommunications outlets (TCO); copper and fiber optic, distribution cables, connectors, “patch” cables, and/or “break out” devices.
- B. The System shall be delivered free of engineering, manufacturing, installation, and functional defects. It shall be designed, engineered and installed for ease of operation, maintenance, and testing.
- C. The term “provide”, as used herein, shall be defined as: designed, engineered, furnished, installed, certified, and tested, by the Contractor.
- D. The Voice and Digital Telecommunication Distribution Cable Equipment and System provides the media which voice and data information travels over and connects to the Telephone System which is defined as an Emergency Critical Care Communication System by the National Fire Protection Association (NFPA). Therefore, since the System connects to or extends the telephone system, the System’s installation and operation shall adhere to all appropriate National, Government, and/or Local Life Safety and/or Support Codes, which ever are the more stringent for this Facility. At a minimum , the System shall be installed according to NFPA, Section 70, National Electrical Code (NEC), Article 517 and Chapter 7; NFPA, Section 99, Health Care Facilities, Chapter 3-4; NFPA, Section 101, Life Safety Code, Chapters 7, 12, and/or 13; Joint Commission on Accreditation of Health Care Organization (JCAHCO), Manual for Health Care Facilities, all necessary Life Safety and/or Support guidelines; this specification; and the original equipment manufacturer's (OEM) suggested installation design, recommendations, and instructions. The OEM and Contractor shall ensure that all management, sales, engineering, and installation personnel have read and understand the requirements of this specification before the System is designed, engineered, delivered, and provided.

- E. The VA Project Manager (PM) and/or if delegated, Resident Engineer (RE) are the approving authorities for all contractual and mechanical changes to the System. The Contractor is cautioned to obtain in writing, all approvals for system changes relating to the published contract specifications and drawings, from the PM and/or the RE before proceeding with the change.
- F. System Performance:
 - 1. At a minimum, the System shall be able to support the following voice and data operations for Category 6 Certified Telecommunication Service
 - a. Telecommunications Outlet (TCO):
 - 1) Voice:
 - a) Isolation (outlet-outlet): 24 dB.
 - b) Impedance: 600 Ohms, balanced (BAL).
 - c) Signal Level: 0 deciBel per mili-Volt (dBmV) \pm 0.1 dBmV.
 - d) System speed: 100 mBps, minimum.
 - e) System data error: 10 to the -6 Bps, minimum.
 - 2) Data:
 - a) Isolation (outlet-outlet): 24 dB.
 - b) Impedance: 600 Ohms, BAL.
 - c) Signal Level: 0 dBmV \pm 0.1 dBmV.
 - d) System speed: 120 mBps, minimum.
 - e) System data error: 10 to the -8 Bps, minimum.

1.2 RELATED WORK

- A. Specification Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Specification Section 27 05 11, REQUIREMENTS FOR COMMUNICATIONS INSTALLATIONS.
- C. Specification Section 27 05 33, RACEWAYS AND BOXES FOR COMMUNICATIONS SYSTEMS.
- D. Specification Section 27 10 00, STRUCTURED CABLING.
- E. Specification Section 26 27 26, WIRING DEVICES.
- F. Specification Section 27 05 26, GROUNDING AND BONDING FOR COMMUNICATIONS SYSTEMS.
- G. H-088-C3 VA HANDBOOK DESIGN FOR TELEPHONE SYSTEMS

1.3 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in text by basic designation only. Except for a specific date given the

issue in effect (including amendments, addenda, revisions, supplements, and errata) on the date the system's submittal is technically approved by VA, shall be enforced.

B. National Fire Protection Association (NFPA):

70	NATIONAL ELECTRICAL CODE (NEC)
75	Protection of Electronic Computer/Data Processing Equipment
77	Recommended Practice on Static Electricity
	Standard for Health Care Facilities
101	Life Safety Code
1221	Emergency Services Communication Systems

C. Underwriters Laboratories, Inc. (UL):

65	Wired Cabinets
96	Lightning Protection Components
96A	INSTALLATION REQUIREMENTS FOR LIGHTNING PROTECTION SYSTEMS
467	Grounding and Bonding Equipment
497/497A/497B	PROTECTORS FOR PAIRED CONDUCTORS/ COMMUNICATIONS CIRCUITS/DATA COMMUNICATIONS AND FIRE ALARM CIRCUITS
884	Underfloor Raceways and Fittings

D. ANSI/EIA/TIA Publications:

568B	Commercial Building Telecommunications Wiring Standard
569B	Commercial Building Standard for Telecommunications Pathways and Spaces
606A	ADMINISTRATION STANDARD FOR THE TELECOMMUNICATIONS INFRASTRUCTURE OF COMMERCIAL BUILDINGS
607A	Grounding and Bonding Requirements for Telecommunications in Commercial Buildings
758	Grounding and Bonding Requirements for Telecommunications in Commercial Buildings

E. Lucent Technologies: Document 900-200-318 "Outside Plant Engineering Handbook".

F. International Telecommunication Union – Telecommunication Standardization Sector (ITU-T).

- G. Federal Information Processing Standards (FIPS) Publications.
- H. Federal Communications Commission (FCC) Publications: Standards for telephone equipment and systems.
- I. United States Air Force: Technical Order 33K-1-100 Test Measurement and Diagnostic Equipment (TMDE) Interval Reference Guide.
- J. Joint Commission on Accreditation of Health Care Organization (JCAHO): Comprehensive Accreditation Manual for Hospitals.
- K. National and/or Government Life Safety Code(s): The more stringent of each listed code.

1.4 QUALITY ASSURANCE

- A. The authorized representative of the OEM, shall be responsible for the design, satisfactory total operation of the System, and its certification.
- B. The OEM shall meet the minimum requirements identified in Paragraph 2.1.A. Additionally, the Contractor shall have had experience with three or more installations of systems of comparable size and complexity with regards to coordinating, engineering, testing, certifying, supervising, training, and documentation. Identification of these installations shall be provided as a part of the submittal as identified in Paragraph 1.5.
- C. The System Contractor shall submit certified documentation that they have been an authorized distributor and service organization for the OEM for a minimum of three (3) years. The System Contractor shall be authorized by the OEM to certify and warranty the installed equipment. In addition, the OEM and System Contractor shall accept complete responsibility for the design, installation, certification, operation, and physical support for the System. This documentation, along with the System Contractor and OEM certification must be provided in writing as part of the Contractor's Technical Submittal.
- D. All equipment, cabling, terminating hardware, TCOs, and patch cords shall be sourced from the certifying OEM or at the OEM's direction, and support the System design, the OEM's quality control and validity of the OEM's warranty.
- E. The Contractor's Telecommunications Technicians assigned to the System shall be fully trained, qualified, and certified by the OEM on the engineering, installation, and testing of the System. The Contractor shall provide formal written evidence of current OEM certification(s) for the installer(s) as a part of the submittal or to the RE before being allowed to commence work on the System.

1.5 SUBMITTALS

- A. Provide submittals in accordance with Specification Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES. The RE shall retain one copy for review and approval.

1. If the submittal is approved the RE shall retain one copy for Official Records and return three (3) copies to the Contractor.
 2. If the submittal is disapproved, three (3) copies will be returned to the Contractor with a written explanation attached that indicates the areas the submittal deviated from the System specifications. The RE shall retain one copy for Official Records.
- B. Environmental Requirements: Technical submittals shall confirm the environmental specifications for physical TC areas occupied by the System. These environmental specifications shall identify the requirements for initial and expanded system configurations for:
1. Floor loading for batteries and cabinets.
 2. Minimum floor space and ceiling heights.
 3. Minimum size of doors for equipment passage.
 4. Power requirements: The Contractor shall provide the specific voltage, amperage, phases, and quantities of circuits required.
 5. Air conditioning, heating, and humidity requirements. The Contractor shall identify the ambient temperature and relative humidity operating ranges required preventing equipment damage.
 6. Air conditioning requirements (expressed in BTU per hour, based on adequate dissipation of generated heat to maintain required room and equipment standards).
 7. Proposed floor plan, based on the expanded system configuration of the bidder's proposed EPBX for this FACILITY.
 8. Conduit size requirement (between main TC, computer, and console rooms).
 9. Main backbone, trunk line, riser, and horizontal cable pathways, cable duct, and conduit requirements between each MTC, TC, and TCO.
- C. Documents: The submittal shall be separated into sections for each subsystem and shall contain the following:
1. Title page to include:
 - a. VA Medical Center.
 - b. Contractor's name, address, and telephone (including FAX) numbers.
 - c. Date of Submittal.
 - d. VA Project No.
 2. List containing a minimum of three locations of installations of similar size and complexity as identified herein. These locations shall contain the following:
 - a. Installation Location and Name.
 - b. Owner's or User's name, address, and telephone (including FAX) numbers.

- c. Date of Project Start and Date of Final Acceptance by Owner.
 - d. System Project Number.
 - e. Brief (three paragraphs minimum) description of each system's function, operation, and installation.
3. Narrative Description of the system.
 4. A List of the equipment to be furnished. The quantity, make, and model number of each item is required. Select the required equipment items quantities that will satisfy the needs of the system.
 5. Equipment technical literature detailing the electrical and technical characteristics of each item of equipment to be furnished.
 6. List of test equipment as per paragraph 1.5.D. below.
 7. Letter certifying that the Contractor understands the requirements of the SAMPLES Paragraph 1.5.E.
 8. Letter certifying that the Contractor understands the requirements of Section 3.2 concerning acceptance tests.
- D. Test Equipment List:
1. The Contractor is responsible for furnishing all test equipment required to test the system in accordance with the parameters specified. Unless otherwise stated, the test equipment shall not be considered part of the system. The Contractor shall furnish test equipment of accuracy better than the parameters to be tested.
 2. The test equipment furnished by the Contractor shall have a calibration tag of an acceptable calibration service dated not more than 12 months prior to the test. As part of the submittal, a test equipment list shall be furnished that includes the make and model number of the following type of equipment as a minimum:
 - a. Spectrum Analyzer.
 - b. Signal Level Meter.
 - c. Volt-Ohm Meter.
 - d. Time Domain Reflectometer (TDR) with strip chart recorder (Data and Optical Measuring).
 - e. Bit Error Test Set (BERT).
 - f. Camera with a minimum of 60 pictures to that will develop immediately to include appropriate test equipment adapters. A video camera in VHS format is an acceptable alternate.

- E. Samples: A sample of each of the following items shall be furnished to the RE for approval prior to installation.
1. TCO Wall Outlet Box 4" x 4"x 2.5" with:
 - a. One each telephone (or voice) rj45 jack installed.
 - b. Two each multi pin data rj45 jacks installed.
 - c. Cover Plate installed.
 2. Data CCS patch panel, punch block or connection device with RJ45 connectors installed.
 3. Telephone CCS system with IDC and/or RJ45 connectors and cable terminal equipment installed.
 4. 610 mm (2 ft.) section of each copper cable to be used with cable sweep tags as specified and connectors installed.
- F. Certifications:
1. Submit written certification from the OEM indicating that the proposed supervisor of the installation and the proposed provider of the contract maintenance are authorized representatives of the OEM. Include the individual's exact name and address and OEM credentials in the certification.
 2. Submit written certification from the OEM that the wiring and connection diagrams meet National and/or Government Life Safety Guidelines, NFPA, NEC, UL, this specification, and JCAHCO requirements and instructions, requirements, recommendations, and guidance set forth by the OEM for the proper performance of the System as described herein. The VA will not approve any submittal without this certification.
 3. Preacceptance Certification: This certification shall be made in accordance with the test procedure outlined in paragraph 3.2.B.
- G. Equipment Manuals: Fifteen (15) working days prior to the scheduled acceptance test, the Contractor shall deliver four complete sets of commercial operation and maintenance manuals for each item of equipment furnished as part of the System to the RE. The manuals shall detail the theory of operation and shall include narrative descriptions, pictorial illustrations, block and schematic diagrams, and parts list.
- H. Record Wiring Diagrams:
1. Fifteen (15) working days prior to the acceptance test, the Contractor shall deliver four complete sets of the Record Wiring Diagrams of the System to the Resident Engineer. The diagrams shall show all inputs and outputs of electronic and passive equipment correctly identified according to the markers installed on the interconnecting cables, Equipment and room/area locations.

2. The Record Wiring Diagrams shall be in hard copy and two compact disk (CD) copies properly formatted to match the Facility's current operating version of Computer Aided Drafting (AutoCAD) system. The RE shall verify and inform the Contractor of the version of AutoCAD being used by the Facility.

PART 2 - PRODUCTS

2.1 EQUIPMENT AND MATERIALS

A. System Requirements:

1. The System shall provide the following minimum services that are designed in accordance with and supported by an Original Equipment Manufacturer (OEM), and as specified herein. The System shall provide continuous inter and/or intra-Facility voice and data service. The System shall be capacity sized so that loss of connectivity to external telephone systems shall not affect the Facilities operation in specific designated locations. The System shall be a voice and data cable distribution system that is based on a physical "Star" Topology
2. Cable Systems - Twisted Pair:
 - a. General:
 - 1) The Contractor shall be responsible for providing a new system conforming to current and accepted telephone and digital commercial cable distribution standards. The distribution cable installation shall be fully coordinated with the Facility, the PM, the RE and the Contractor prior to the start of installation.
 - 2) The Contractor is responsible for complete knowledge of the space and cable pathways (i.e. equipment rooms, TCs, conduits, wireways, etc.) of the Facility. The Contractor shall at a minimum design and install the System using the Pathway Design Handbook H-088C3, TIA/EIA Telecommunications Building Wiring Standards, and Facility Chief of Information Resource Management's (IRM) instructions, as approved in writing by the PM and/or RE.
 - 3) The System cables shall be fully protected by cable duct, trays, wireways, conduit (rigid, thin wall, or flex), and when specifically approved, flexible innerduct. It is the responsibility of the Contractor to confirm all contract drawings and the Facility's physical layout to determine the necessary cable protective devices to be provided. If flexible innerduct is used, it shall be installed in the same manner as conduit.
 - 4) Cable provided in the system (i.e. backbone, outside plant, inside plant, and station cabling) shall conform to accepted industry and OEM standards with regards to size, color code, and insulation. The pair twists of any pair shall not be exactly the same as any other pair within any unit or sub-unit of cables that are bundled in twenty-five

- (25) pairs or less. The absence of specifications regarding details shall imply that best general industry practices shall prevail and that first quality material and workmanship shall be provided. Certification Standards, (i.e., EIA, CCITT, FIPPS, and NFPA) shall prevail.
- 5) All areas of this Facility are to be considered “plenum”. All wire and cable used in support of the installation shall be in compliance with national and local codes pertaining to plenum environments. It is the responsibility of the Contractor to review the VA’s cable and wire requirements with the RE and the IRM prior to installation.
 - 6) The Contractor shall provide outside and inside plant cables that furnishes the number of cable pairs required in accordance with the System requirements described herein. The Contractor shall fully coordinate and obtain approval of the design with the OEM, RE and the IRM prior to installation.
 - 7) All metallic cable sheaths, etc. shall be grounded by the Contractor (i.e.: risers, underground, station wiring, etc.) as described herein.
 - 8) If temporary cable and wire pairs are used, they shall be installed so as to not present a pedestrian safety hazard and the Contractor shall be responsible for all work associated with the temporary installation and for their removal when no longer necessary. Temporary cable installations are not required to meet Industry Standards; but, must be reviewed and approved by the RE and the IRM prior to installation.
 - 9) Conductors shall be cabled to provide protection against induction in voice and data circuits. Crosstalk attenuation within the System shall be in excess of -80 dB throughout the frequency ranges specified.
 - 10) Measures shall be employed by the Contractor to minimize the radiation of RF noise generated by the System equipment so as not to interfere with audio, video, data, computer main distribution frame (MDF), telephone customer service unit (CSU), and electronic private branch exchange (EPBX) equipment the System may service.
 - 11) The System’s cables shall be labeled on each end and been fully tested and certified in writing by the Contractor to the Resident Engineer before proof of performance testing can be conducted. The as-installed drawings shall identify each cable as labeled, used cable, and bad cable pairs. Minimum test requirements are for impedance compliance, inductance, capacitance, signal level compliance, opens, shorts, cross talk, noise, and distortion, and split pairs on all cables in the frequency ranges specified. The tests required for data cable must be made to guarantee the operation of this cable at not less than 10 mega (m) Hertz (Hz) full bandwidth, fully

channel loaded and a Bit Error Rate of a minimum of 10^{-6} at the maximum rate of speed. All cable installation and test records shall be made available at acceptance testing by the RE or Contractor and thereafter maintained in the Facility's Telephone Switch Room. All changes (used pair, failed pair, etc.) shall be posted in these records as the change occurs.

- 12) The Contractor shall provide proper test equipment to guarantee that cable pairs meet each OEM's standard transmission requirements, and guarantee the cable will carry data transmissions at the required speeds, frequencies, and fully loaded bandwidth.

b. Horizontal and Station Cable:

- 1) A Telephone Four (4) UTP 24 AWG station wiring cable shall be installed from the top TCO jack to the TC and shall be of a type designed to support Category 6 communications (250 mega-Hertz [mHz] or above). At the jack location, terminate all four pair on the RJ-45/11 jack. At the signal closet, all four pair shall be terminated on the modular punch down 110 block dedicated to telephone applications.
- 2) A Data Four (4) UTP 24 AWG (in thermoplastic jacket unless otherwise specified by RE) station wiring cable shall be installed from each of the two (2) TCO RJ-45 jacks (shall conform to EIA/TIA 568 Standard "T568A" and NFPA) to the TC and shall be of a type designed to support Category 6 communications (250 mHz or above). At the signal closet, all four pair of both cables shall be terminated on the modular punch down 110 blocks dedicated to data applications.

- c. Telecommunication Outlets (TCO), Jacks: All TCO's shall have a minimum of three (3) RJ-45 type jacks. One jack shall be an eight pin RJ-45/11 compatible jack, labeled, and designated for telephone applications only. Two jacks shall be eight pin RJ-45 type unkeyed (sometimes called center keyed) jacks, labeled, and designated for data.

2.2 DISTRIBUTION EQUIPMENT AND SYSTEMS

A. Telecommunication Outlet (TCO):

1. The TCO shall consist of one telephone multipin jack and two data multipin jacks mounted in a steel outlet box. A separate 100mm (4in.) x 100mm (4in.) x 63mm (2.5in.) steel outlet box with a labeled stainless steel faceplate will be used.
2. All telephone multipin connections shall be RJ-45/11 compatible female types. All data multipin connections shall be RJ-45 female types.
3. Interface of the data multipin jacks to appropriate patch panels (or approved "punch down" blocks) in the associated TC, is the responsibility of the Contractor.

4. The wall outlet shall be provided with a stainless steel or approve alternate cover plate to fit the telephone multipin jack, data multi-pin jacks and the outlet box provided (100mm (4in.) x 100mm (4in.) for single and 100mm (4in.) x 200mm (8in.) for dual outlet box applications.

B. Outlet Connection Cables:

1. Telephone:

- a. The Contractor shall provide a connection cable for each TCO telephone jack in the System with 10% spares. The telephone connection cable shall connect the telephone instrument to the TCO telephone jack. The Contractor shall not provide telephone instrument(s) or equipment.
- b. Technical Characteristics:

Length	1.8M (6ft.), minimum
Cable	Voice Grade
Connector	RJ-11/45 compatible male on each end
Size	24 AWG, minimum
Color coding	Required, telephone industry standard

2. Data:

- a. The Contractor shall provide a connection cable for each TCO data jack in the system with 10% spares. The data connection cable shall connect a data instrument to the TCO data jack. The Contractor shall not provide data terminal(s)/equipment.
- b. Technical Characteristics:

Length	1.8M (6 ft.), minimum
Cable	Data grade Category Six
Connector	RJ-45 male on each end
Color coding	Required, data industry standard
Size	24 AWG, minimum

PART 3 - EXECUTION

3.1 INSTALLATION

A. Product Delivery, Storage and Handling:

1. Delivery: Deliver materials to the job site in OEM's original unopened containers, clearly labeled with the OEM's name and equipment catalog numbers, model and serial identification numbers. The RE may inventory the cable, patch panels, and related equipment.
2. Storage and Handling: Store and protect equipment in a manner, which will preclude damage as directed by the RE.

B. System Installation:

1. After the contract's been awarded, and within the time period specified in the contract, the Contractor shall deliver the total system in a manner that fully complies with the requirements of this specification. The Contractor shall make no substitutions or changes in the System without written approval from the RE and PM.
2. The Contractor shall install all equipment and systems in a manner that complies with accepted industry standards of good practice, OEM instructions, the requirements of this specification, and in a manner which does not constitute a safety hazard. The Contractor shall insure that all installation personnel understands and complies with all the requirements of this specification.
3. All passive equipment shall be connected according to the OEM's specifications to insure future correct termination, isolation, impedance match, and signal level balance at each telephone/data outlet.
4. Where TCOs are installed adjacent to each other, install one outlet for each instrument.

C. Conduit and Signal Ducts:

1. Conduit:
 - a. The Contractor shall employ the latest installation practices and materials. The Contractor shall provide conduit, junction boxes, connectors, sleeves, weatherheads, pitch pockets, and associated sealing materials not specifically identified in this document as GFE. Conduit penetrations of walls, ceilings, floors, interstitial space, fire barriers, etc., shall be sleeved and sealed. The minimum conduit size shall be 19 mm (1 in.).
 - b. All cables shall be installed in separate conduit and/or signal ducts (exception from the separate conduit requirement to allow telephone cables to be installed in partitioned cable tray with data cables may be granted in writing by the RE if requested.) Conduits shall be provided in accordance with Section 27 05 33, RACEWAYS AND BOXES FOR COMMUNICATIONS SYSTEMS, and NEC Articles 517 for Critical Care and 800 for Communications systems, at a minimum.
 - c. When metal, plastic covered, etc., flexible cable protective armor or systems are specifically authorized to be provided for use in the System, their installation guidelines

and standards shall be as specified herein, Section 27 05 33, RACEWAYS AND BOXES FOR COMMUNICATIONS SYSTEMS, and the NEC.

- d. When "innerduct" flexible cable protective systems is specifically authorized to be provided for use in the System, its installation guidelines and standards shall be as the specified herein, Section 27 05 33, RACEWAYS AND BOXES FOR COMMUNICATIONS SYSTEMS, and the NEC.
 - e. Conduit (including GFE) fill shall not exceed 40%. Each conduit end shall be equipped with a protective insulator or sleeve to cover the conduit end, connection nut or clamp, to protect the wire or cable during installation and remaining in the conduit. Electrical power conduit shall be installed in accordance with the NEC. AC power conduit shall be run separate from signal conduit.
 - f. When metal, plastic covered, etc., flexible cable protective armor or systems are specifically authorized to be provided for use in the System, their installation guidelines and standards shall be as specified herein, Section 27 05 33, RACEWAYS AND BOXES FOR COMMUNICATIONS SYSTEMS, and the NEC.
2. Signal Duct, Cable Duct, or Cable Tray:
- a. The Contractor shall use existing signal duct, cable duct, and/or cable tray, when identified and approved by the RE.
 - b. Approved signal and/or cable duct shall be a minimum size of 100 mm x 100 mm (4 in. X 4 in.) inside diameter with removable tops or sides, as appropriate. Protective sleeves, guides or barriers are required on all sharp corners, openings, anchors, bolts or screw ends, junction, interface and connection points.

D. Distribution System Signal Wires and Cables:

- 1. Wires and cables shall be provided in the same manner and use like construction practices as Fire Protective and other Emergency Systems that are identified and outlined in NFPA 101, Life Safety Code, Chapters 7, 12, and/or 13, NFPA 70, National Electrical Code, Chapter 7, Special Conditions. The wires and cables shall be able to withstand adverse environmental conditions in their respective location without deterioration. Wires and cables shall enter each equipment enclosure, console, cabinet or rack in such a manner that all doors or access panels can be opened and closed without removal or disruption of the cables.
 - a. Each wire and cable shall terminate on an item of equipment by direct connection. Spare or unused wire and cable shall be provided with appropriate connectors (female types) that are installed in appropriate punch blocks, barrier strips, patch, or bulkhead connector panels.

- b. All cable junctions and taps shall be accessible. Provide an 8" X 8" X 4" (minimum) junction box attached to the cable duct or raceway for installation of distribution system passive equipment. Ensure all equipment and tap junctions are accessible.
2. Routing and Interconnection:
- a. Wires or cables between consoles, cabinets, racks and other equipment shall be in an approved conduit, signal duct, cable duct, or cable tray that is secured to building structure.
 - b. Wires and cables shall be insulated to prevent contact with signal or current carrying conductors. Wires or cables used in assembling consoles, panels, equipment cabinets and racks shall be formed into harnesses that are bundled and tied. Harnessed wires or cables shall be combed straight, formed and dressed in either a vertical or horizontal relationship to equipment, controls, components or terminations.
 - c. Harnesses with intertwined members are not acceptable. Each wire or cable that breaks out from a harness for connection or termination shall have been tied off at that harness or bundle point, and be provided with a neatly formed service loop.
 - d. Wires and cables shall be grouped according to service (i.e.: AC, grounds, signal, DC, control, etc.). DC, control and signal cables may be included with any group. Wires and cables shall be neatly formed and shall not change position in the group throughout the conduit run. Wires and cables in approved signal duct, conduit, cable ducts, or cable trays shall be neatly formed, bundled, tied off in 600 mm to 900 mm (24 in. to 36 in.) lengths and shall not change position in the group throughout the run. Concealed splices are not allowed.
 - e. Separate, organize, bundle, and route wires or cables to restrict EMI, channel crosstalk, or feedback oscillation inside any enclosure. Looking at any enclosure from the rear (wall mounted enclosures, junction, pull or interface boxes from the front), locate AC power, DC and speaker wires or cables on the left; coaxial, control, microphone and line level audio and data wires or cables, on the right. This installation shall be accomplished with ties and/or fasteners that will not damage or distort the wires or cables. Limit spacing between tied off points to a maximum of 150 mm (6 inches).
 - f. Do not pull wire or cable through any box, fitting or enclosure where change of cable tray or signal or cable duct alignment or direction occurs. Ensure the proper bend radius is maintained for each wire or cable as specified by it's OEM.
 - g. Employ temporary guides, sheaves, rollers, and other necessary items to protect the wire or cable from excess tension or damage from bending during installation. Abrasion to

wire or cable jackets is not acceptable and will not be allowed. Replace all cables whose jacket has been abraded. The discovery of any abraded and/or damaged cables during the proof of performance test shall be grounds for declaring the entire system unacceptable and the termination of the proof of performance test. Completely cover edges of wire or cable passing through holes in chassis, cabinets or racks, enclosures, pull or junction boxes, conduit, etc., with plastic or nylon grommeting.

- h. Cable runs shall be splice free between conduit junction and interface boxes and equipment locations.
- i. Cables shall be installed and fastened without causing sharp bends or rubbing of the cables against sharp edges. Cables shall be fastened with hardware that will not damage or distort them.
- j. Cables shall be labeled with permanent markers at the terminals of the electronic and passive equipment and at each junction point in the System. The lettering on the cables shall correspond with the lettering on the record diagrams.
- k. Completely test all of the cables after installation and replace any defective cables.
- l. Wires or cables that are installed outside of buildings shall be in conduit, secured to solid building structures. If specifically approved, on a case by case basis, to be run outside of conduit, the wires or cables shall be installed, as described herein. The bundled wires or cables must: Be tied at not less than 460 mm (18 in.) intervals to a solid building structure; have ultra violet protection and be totally waterproof (including all connections). The laying of wires or cables directly on roof tops, ladders, drooping down walls, walkways, floors, etc. is not allowed and will not be approved.
- m. Wires or cables installed outside of conduit, cable trays, wireways, cable duct, etc.
 - 1) Only when specifically authorized as described herein, will wires or cables be identified and approved to be installed outside of conduit. The wire or cable runs shall be UL rated plenum and OEM certified for use in air plenums.
 - 2) Wires and cables shall be hidden, protected, fastened and tied at 600 mm (24 in.) intervals, maximum, as described herein to building structure.
 - 3) Closer wire or cable fastening intervals may be required to prevent sagging, maintain clearance above suspended ceilings, remove unsightly wiring and cabling from view and discourage tampering and vandalism. Wire or cable runs, not provided in conduit, that penetrate outside building walls, supporting walls, and two hour fire barriers shall be sleeved and sealed with an approved fire retardant sealant.

- 4) Wire or cable runs to system components installed in walls (i.e.: volume attenuators, circuit controllers, signal, or data outlets, etc.) may, when specifically authorized by the RE, be fished through hollow spaces in walls and shall be certified for use in air plenum areas.

E. Outlet Boxes, Back Boxes, and Faceplates:

1. Outlet Boxes: Signal, power, interface, connection, distribution, and junction boxes shall be provided as required by the system design, on-site inspection, and review of the contract drawings.
2. Back Boxes: Back boxes shall be provided as directed by the OEM as required by the approved system design, on-site inspection, and review of the contract drawings.
3. Face Plates (or Cover Plates): Faceplates shall be of a standard type, stainless steel, anodized aluminum or UL approved cycolac plastic construction and provided by the Contractor for each identified system outlet location. Connectors and jacks appearing on the faceplate shall be clearly and permanently marked.

F. Connectors: Circuits, transmission lines, and signal extensions shall have continuity, correct connection and polarity. A uniform polarity shall be maintained between all points in the system.

1. Wires: Wire ends shall be neatly formed and where insulation has been cut, heat shrink tubing shall be employed to secure the insulation on each wire. Tape of any type is not acceptable.
2. Cables: Each connector shall be designed for the specific size cable being used and installed with the OEM's approved installation tool. Typical system cable connectors include; but, are not limited to: Audio spade lug, punch block, wirewrap, etc.

G. AC Power: AC power wiring shall be run separately from signal cable.

H. Grounding:

1. General: The Contractor shall ground all Contractor Installed Equipment and identified Government Furnished Equipment to eliminate all shock hazards and to minimize, to the maximum extent possible, all ground loops, common mode returns, noise pickup, crosstalk, etc. The total ground resistance shall be 0.1 Ohm or less.

I. Labeling: Provide labeling in accordance with ANSI/EIA/TIA-606-A. All lettering for voice and data circuits shall be stenciled using laser printers, or thermal ink transfer process. Handwritten labels are not acceptable.

1. Cable and Wires (Hereinafter referred to as "Cable"): Cables shall be labeled at both ends in accordance with ANSI/EIA/TIA-606-A. Labels shall be permanent in contrasting colors. Cables shall be identified according to the System "Record Wiring Diagrams".

2. **Equipment:** System equipment shall be permanently labeled with contrasting plastic laminate or bakelite material. System equipment shall be labeled on the face of the unit corresponding to its source.
3. **Conduit, Cable Duct, and/or Cable Tray:** The Contractor shall label all conduit, duct and tray, including utilized GFE, with permanent marking devices or spray painted stenciling a minimum of 3 meters (10 ft.) identifying it as the System. In addition, each enclosure shall be labeled according to this standard.
4. **Termination Hardware:** The Contractor shall label workstation outlets and patch panel connections using color coded labels with identifiers in accordance with ANSI/EIA/TIA-606-A and the "Record Wiring Diagrams".

3.2 TESTS

A. Interim Inspection:

1. This inspection shall verify that the equipment provided adheres to the installation requirements of this document. The interim inspection will be conducted by a factory-certified representative and witnessed by a Government Representative. Each item of installed equipment shall be checked to insure appropriate UL certification markings. This inspection shall verify cabling terminations in telecommunications rooms and at workstations adhere to color code for T568B or T568A pin assignments (verify pin assignments with Facility IRM Personnel) and cabling connections are in compliance with ANSI/EIA/TIA standards. Visually confirm Category 6 marking of outlets, faceplates, outlet/connectors and patch cords.
2. The Contractor shall notify the RE, in writing, of the estimated date the Contractor expects to be ready for the interim inspection, at least 20 working days before the requested inspection date.
3. Results of the interim inspection shall be provided to the RE and PM. If major or multiple deficiencies are discovered, a second interim inspection may be required before permitting the Contractor to continue with the system installation.
4. The RE and/or the PM shall determine if an additional inspection is required, or if the Contractor will be allowed to proceed with the installation. In either case, re-inspection of the deficiencies noted during the interim inspection(s), will be part of the proof of performance test. The interim inspection shall not affect the Systems' completion date. The Contracting Officer shall ensure all test documents will become a part of the Systems record documentation.

B. Pretesting:

1. Upon completing the installation of the System, the Contractor shall align and balance the system. The Contractor shall pretest the entire system.
 2. Pretesting Procedure:
 - a. During the system pretest, the Contractor shall verify (utilizing the approved spectrum analyzer and test equipment) that the System is fully operational and meets all the system performance requirements of this standard.
 - b. The Contractor shall pretest and verify that all System functions and specification requirements are met and operational, no unwanted aural effects, such as signal distortion, noise pulses, glitches, audio hum, poling noise, etc. are present. The Contractor shall measure and record the aural carrier levels of each system telephone and data channel
 3. The Contractor shall provide four (4) copies of the recorded system pretest measurements and the written certification that the System is ready for the formal acceptance test shall be submitted to the RE.
- C. Acceptance Test: After the System has been pretested and the Contractor has submitted the pretest results and certification to the RE, then the Contractor shall schedule an acceptance test date and give the RE 30 days written notice prior to the date the acceptance test is expected to begin. The System shall be tested in the presence of a Government Representative and an OEM certified representative. The System shall be tested utilizing the approved test equipment to certify proof of performance and Life Safety compliance. The test shall verify that the total System meets the requirements of this specification. The notification of the acceptance test shall include the expected length (in time) of the test.
- D. Performance Testing:
1. Perform Category 6 tests in accordance with ANSI/EIA/TIA-568-B.1 and ANSI/EIA/TIA-568-B.2. Test shall include the following: wire map, length, insertion loss, return loss, NEXT, PSNEXT, ELFEXT, PSELFEXT, propagation delay and delay skew.
- E. Total System Acceptance Test: The Contractor shall perform verification tests for UTP copper cabling system(s) after the complete telecommunication distribution system and workstation outlet are installed.

- - - E N D - - -

SECTION 27 41 31
MASTER ANTENNA TELEVISION EQUIPMENT AND SYSTEMS

PART 1 - GENERAL

1.1 SECTION SUMMARY

- A. Work covered by this document includes design, engineering, labor, material, products, guarantee, training and services for, and incidental to the complete installation of new and fully operating NFPA listed Master Antenna Television (TV) equipment and systems as detailed herein. This system will be prepared for connection to existing campus TV system.
- B. Work shall be complete, complete, labeled, VA Central Office (VACO) tested and certified and ready for operation

1.2 RELATED SECTIONS

- A. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA AND SAMPLES.
- B. Section 26 05 21, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES (600 Volts and Below).
- C. Section 27 10 00, STRUCTURED COMMUNICATIONS SYSTEMS CABLING.
- D. Section 27 05 11, REQUIREMENTS FOR COMMUNICATIONS INSTALLATIONS.
- E. Section 27 05 26, GROUNDING AND BONDING FOR COMMUNICATIONS SYSTEMS.
- F. Section 27 05 33, RACEWAYS AND BOXES FOR COMMUNICATIONS SYSTEMS.
- G. Section 27 10 00, STRUCTURED CABLING.
- H. Section 27 15 00, COMMUNICATIONS HORIZONTAL CABLING.
- I. Section 27 52 23, NURSE CALL AND CODE BLUE SYSTEMS.

1.3 DEFINITIONS

- A. Provide: Design, engineer, furnish, install, connect complete, test, certify and guarantee.
- B. Work: Materials furnished and completely installed.
- C. Review of contract drawings: A service by the engineer to reduce the possibility of materials being ordered which do not comply with contract documents. The engineer's review shall not relieve the Contractor of responsibility for dimensions or compliance with the contract documents. The reviewer's failure to detect an error does not constitute permission for the Contractor to proceed in error.
- D. Headquarters Technical Review, for National/VA communications and security, codes, frequency licensing, standards, guidelines compliance:

Office of Telecommunications

Special Communications Team (005OP2B)

1335 East West Highway – 3rd Floor
 Silver Spring, Maryland 20910
 (O) 301-734-0350, (F) 301-734-0360

1.4 REFERENCES

- A. The installation shall comply fully with all governing authorities, laws and ordinances, regulations, codes and standards, including, but not limited to:
1. United States Federal Law/Codes:
 - a. Departments of:
 - 1) CFR, Title 15 – Department of Commerce, Under the Information Technology Management Reform Act (Public Law 104-106), the Secretary of Commerce approves standards and guidelines that are developed by the:
 - a) Chapter II, National Institute of Standards Technology (NIST – formerly the National Bureau of Standards). Under Section 5131 of the Information Technology Management Reform Act of 1996 and the Federal Information Security Management Act of 2002 (Public Law 107-347), NIST develops – Federal Information Processing Standards Publication (FIPS) 140-2—Security Requirements for Cryptographic Modules.
 - b) Chapter XXIII, National Telecommunications and Information Administration (NTIA – aka ‘Red Book’) Chapter 7.8/9 Federal communications Commission (FCC) Title 47 (CFR), Part 15, Radio Frequency Restriction of Use and Compliance in “Safety of Life” Functions and Locations.
 - 2) CFR, Title 29, Department of Labor, Chapter XVII - Occupational Safety and Health Administration (OSHA), Part 1910 – Occupational Safety and Health Standard:
 - a) Subpart 7 - Definition and requirements for a National Recognized Testing Laboratory (NRTL – 15 Laboratory’s, for complete list, contact http://www.osha.gov/dts/otpca/nrtl/faq_nrtl.html)
 - (1) Underwriter’s Laboratories (UL):

65	Standard for Wired Cabinets.
468	Standard for Grounding and Bonding Equipment.
1449	Standard for Transient Voltage Surge Suppressors.
1069	Hospital Signaling and Nurse Call Equipment.
60950-1/2	Information Technology Equipment – Safety.

- (2) Canadian Standards Association (CSA): same tests as for UL.
- (3) Communications Certifications Laboratory (CCL): same tests as for UL.
- (4) Intertek Testing Services NA, Inc. (ITSNA formerly Edison Testing Laboratory [ETL]): same tests as for UL.
- b) Subpart 35, Compliance with NFPA 101 – Life Safety Code.
- c) Subpart 36, Design and construction requirements for exit routes.
- d) Subpart 268, Telecommunications.
- e) Subpart 305, Wiring methods, components, and equipment for general use.
- 3) Public Law No. 100-527, Department of Veterans Affairs:
 - a) Office of Telecommunications: Handbook 6100 – Telecommunications.
 - b) Office of Cyber and Information Security (OCIS):
 - (1) Handbook 6500 - Information Security Program.
 - (2) Wireless and Handheld Device Security Guideline Version 3.2, August 15, 2005.
 - c) Spectrum Management FCC and NTIA Radio Frequency Compliance and Licensing Program.
 - d) Office of Cyber and Information Security (OCIS):
 - (1) Handbook 6500 - Information Security Program.
 - (2) Wireless and Handheld Device Security Guideline Version 3.2, August 15, 2005.
- 4) Title 42, CFC, Department of Health, Chapter IV Health and Human Services, Subpart 1395(a)(b) Joint Commission on Accreditation of Healthcare Organizations (JCAHO) “a hospital that meets JCAHO accreditation is deemed to meet the Medicare conditions of Participation by meeting Federal Directives:” All guidelines for Life, Personal and Public Safety; and, Essential and Emergency Communications.
- 5) CFR, Title 47 - Telecommunications, in addition to FCC: Part 15 – Restrictions of use for Part 15 listed Radio Equipment in Safety of Life/Emergency Functions/Equipment/Locations (also see CFR, Title 15 – Department of Commerce, Chapter XXIII – NTIA):

Part 73	Radio Broadcast Service,
Part 90	Rules and Regulations, Appendix C.
Form 854	Antenna Structure Registration.

6) Public Law 89-670, Department of Transportation, CFR-49, Part 1, Subpart C –

Federal Aviation Administration (FAA):

a) Standards AC 110/460-ID and AC 707/460-2E – Advisory Circulars for
Constructions of Antenna Towers.

b) Forms 7450 and 7460-2 – Antenna Construction Registration.

2. National Codes:

a. American Institute of Architects (AIA): Guidelines for Healthcare Facilities.

b. American National Standards Institute/Electronic Industries

Association/Telecommunications Industry Association (ANSI/EIA/TIA):

568-B	Commercial Building Telecommunications Wiring Standards:
569	Commercial Building Standard for Telecommunications Pathways and Spaces.
606	Administration Standard for the Telecommunications Infrastructure of Communications Buildings.
607	Commercial Building Grounding and Bonding Requirements for Telecommunications.
REC 127-49	Power Supplies.
RS 27	Tools, Crimping, Solderless Wiring Devices, Recommended Procedures for User Certification.

c. Institute of Electrical and Electronics Engineers (IEEE):

SO/TR 21730:2007	Use of mobile wireless communication and computing technology in healthcare facilities - Recommendations for electromagnetic compatibility (management of unintentional electromagnetic interference) with medical devices.
0739- 5175/08/\$25.00 ©2008IEEE	Medical Grade – Mission Critical – Wireless Networks.
C62.41	Surge Voltages in Low-Voltage AC Power Circuits.

d. American Society of Mechanical Engineers (ASME):

1) Standard 17.4, Guide for Emergency Personnel.

- 2) Standard 17.5, Elevator and Escalator Equipment (prohibition of installing non-elevator equipment in Elevator Equipment Room/Mechanical Penthouse).

e. NFPA:

70	National Electrical Code (current date of issue) – Articles 517, 645 and 800.
75	Standard for Protection of Electronic Computer Data- Processing Equipment.
77	Recommended Practice on Static Electricity.
99	Healthcare Facilities.
101	Life Safety Code.

3. State Hospital Code(s).

4. Local Codes.

1.5 QUALIFICATIONS

- A. The OEM shall have had experience with three or more installations of systems of comparable size and complexity about type and design as specified herein. Each of these installations shall have performed satisfactorily for at least 1 year after final acceptance by the user. Include the names, locations and point of contact for these installations as a part of the submittal.
- B. The Contractor shall submit certified documentation that they have been an authorized distributor and service organization for the OEM for a minimum of 3 years. The Contractor shall be authorized by the OEM to pass thru the OEM's warranty of the installed equipment to VA. In addition, the OEM and Contractor shall accept complete responsibility for the design, installation, certification, operation, and physical support for the system. This documentation, along with the System Contractor and OEM certifications must be provided in writing as part of the Contractor's Technical submittal.
- C. The Contractor's Communications Technicians assigned to the system shall be fully trained, qualified, and certified by the OEM on the engineering, installation, operation, and testing of the system. The Contractor shall provide formal written evidence of current OEM certification(s) for the installer(s) as a part of the submittal or to the Resident Engineer before being allowed to commence work on the system.
- D. Applicable national, state and local licenses.
- E. Certificate of successful completion of OEM's installation/training school for installing technicians of the equipment being proposed.

1.6 CODES AND PERMITS

- A. Provide all necessary permits and schedule all inspections as identified in the contract's milestone chart, so that the system is proof of performance tested and ready for operation on a date directed by the Owner.
- B. The contractor is responsible to adhere to all codes described herein and associated contractual, state and local codes.

1.7 SCHEDULING

- A. After the award of contract, the Contractor shall prepare a detailed schedule (aka milestone chart) using "Microsoft Project" software or equivalent. The Contractor Project Schedule (CPS) shall indicate detailed activities for the projected life of the project. The CPS shall consist of detailed activities and their restraining relationships. It will also detail manpower usage throughout the project.
- B. It is the responsibility of the Contractor to coordinate all work with the other trades for scheduling, rough-in, and finishing all work specified. The owner will not be liable for any additional costs due to missed dates or poor coordination of the supplying contractor with other trades.

1.8 REVIEW OF CONTRACT DRAWINGS AND EQUIPMENT DATA SUBMITTALS

- A. Submit at one time within 10 days of contract awarding, drawings and product data on all proposed equipment and system. Check for compliance with contract documents and certify compliance with Contractor's "APPROVED" stamp and signature.
- B. Support all submittals with descriptive materials, i.e., catalog sheets, product data sheets, diagrams, and charts published by the manufacturer. These materials shall show conformance to specification and drawing requirements.
- C. Where multiple products are listed on a single cut-sheet, circle or highlight the one that you propose to use. Provide a complete and thorough equipment list of equipment expected to be installed in the system, with spares, as a part of the submittal. Special Communications (TVE-005OP3B – herein after referred to as [005OP3B]) will not review any submittal that does not have this list.
- D. Provide 4 copies to the PM for technical review. The PM will provide a copy to the offices identified in Paragraph 1.3.C and D, at a minimum for compliance review as described herein where each responsible individual(s) should respond to the PM within 10 days of receipt of their acceptance or rejection of the submittal(s).
- E. Connection to existing Head End and interface distribution cabinet.

- F. Equipment technical literature detailing the electrical and technical characteristics of each item of equipment to be furnished.
- H. Engineering drawings of the system, showing calculated signal levels required at the Head End output, each input and output distribution point, and signal level at each telecommunications outlet.

1.9 PROJECT RECORD DOCUMENTS (AS BUILTS)

- A. Throughout progress of the work, maintain an accurate record of changes in Contract Documents. Upon completion of Work, transfer recorded changes to a set of Project Record Documents.
- B. The floor plans shall be marked in pen to include the following:
 - 1. All device locations with labels.
 - 2. Conduit locations.
 - 3. Existing head-end equipment and specific location.
 - 4. Wiring diagram.
 - 5. Labeling and administration documentation.
 - 6. Warranty certificate.
 - 7. System test results.

1.10 WARRANTIES AND GUARANTEE

- A. The Contractor shall warrant the installation be free from defect in material and workmanship for a period of 1 year from the date of acceptance of the project by the owner. The Contractor shall agree to remedy covered defects within eight (8) hours of notification of major failures or within twenty-four (24) hours of notification for individual station related problems.
- B. Refer to Part 4 for applicable System Guarantee requirements.

1.11 USE OF THE SITE

- A. Use of the site shall be at the GC's direction.
- B. Coordinate with the GC for lay-down areas for product storage and administration areas.
- C. Coordinate work with the GC and their sub-contractors.
- D. Access to buildings wherein the work is performed shall be directed by the GC.

1.12 DELIVERY, STORAGE, AND HANDLING

- A. Deliver, store, and handle products using means and methods that will prevent damage, deterioration, and loss, including theft.
- B. Store products in original containers.
- C. Coordinate with the GC for product storage. There may be little or no storage space available on site. Plan to potentially store materials off site.

- D. Do not install damaged products. Remove damaged products from the site and replaced with new product at no cost to the Owner.

1.13 PROJECT CLOSEOUT

- A. Prior to final inspection and acceptance of the work, remove all debris, rubbish, waste material, tools, construction equipment, machinery and surplus materials from the project site and thoroughly clean your work area.
- B. Before the project closeout date, the Contractor shall submit:
 - 1. Warranty certificate.
 - 2. Evidence of compliance with requirements of governing authorities such as the Low Voltage Certificate of Inspection.
 - 3. Project record documents.
 - 4. Instruction manuals and software that is a part of the system.
- C. Contractor shall submit written notice that:
 - 1. Contract Documents have been reviewed.
 - 2. Project has been inspected for compliance with contract.
 - 3. Work has been completed in accordance with the contract

PART 2 – PRODUCTS AND FUNCTIONAL REQUIREMENTS

2.1 GENERAL REQUIREMENTS FOR EQUIPMENT AND MATERIALS

- A. Furnish and install a complete and fully operational master antenna TV signal distribution system. Include all amplifiers, power supplies, cables, outlets, attenuators, and all other parts necessary for the distribution of the off-the-air TV signals. Connection to existing TV distribution system will be required.
- B. Coordinate features and select components to form an integrated system. Match components and interconnections for optimum performance of specified functions.
- C. Expansion Capability: Increase number of stations in the future by 25 percent above those indicated without adding any internal or external components or main trunk cable conductors.
- D. Distribute cable channels to all TV outlets to permit simple connection of EIA standard high definition television (HDTV) receivers.
- E. Deliver at all outlets all HDTV monochrome and color television signals without introducing noticeable effect on picture and color fidelity or sound. System picture fidelity shall be equal to that received from the cable company and other modulated channels.
- F. Provide reception quality at each outlet equal to or better than that received in the area with individual antennas. Deliver at all television outlets a minimum +6.0 dBmv (2,000 microvolts across 75 Ohms) and maximum of +20 dBmv (20,000 microvolts) for each channel at each outlet.

- G. Equipment: Modular type using solid-state components, fully rated for continuous duty unless otherwise indicated. Select equipment for normal operation on input power usually supplied at 110 to 130 V, 60 Hz.
- H. Meet all FCC requirements regarding low radiation and/or interference of RF signal(s). The system shall be designed to prevent direct pickup of signals from the building structure.
- I. Weather-Resistant Equipment: Listed and labeled by an OSHA certified National Recognized Testing Laboratory (NRTL – i.e. UL) for duty outdoors or in damp locations.

2.2 SYSTEM DESCRIPTION

- A. The Contractor is responsible for interfacing with the Nurse Call system pillow speakers.
- B. The Contractor shall continually employ interfacing methods that are approved by the OEM and VA. At a minimum, an acceptable interfacing method requires not only a physical and mechanical connection, but also a matching of signal, voltage, and processing levels with regard to signal quality and impedance. The interface point must adhere to all standards described herein for the full separation of Critical Care and Life Safety systems.
- C. It is not acceptable to utilize the telephone cable system for the control of MATV signals and equipment. The System Contractor shall connect the system ensuring that all NFPA and Underwriters Laboratory, Inc. (UL) Critical Care and Life Safety Circuit and system separation guidelines are satisfied. The System Contractor is not allowed to make any connections to the Telephone System. The Owner shall arrange for the interconnection between the MATV and Nurses Call Systems with the appropriate responsible parties.
- D. All passive distribution equipment shall meet or exceed -80 dB radiation shielding specifications and be provided with screw type audio connectors.
- E. All trunk, branch, and interconnecting cables and unused equipment ports or taps shall be terminated with proper terminating resistors designed for RF, audio and digital cable systems without adapters.
- F. The system shall utilize microprocessor components for all signaling and programming circuits and functions. System program memory shall be non-volatile or protected from erasure from power outages for a minimum of 30 minutes.
- G. Provide a backup battery or a UPS for the system (including each distribution cabinet/point) to allow normal operation and function (as if there was no AC power failure) in the event of an AC power failure or during input power fluctuations for a minimum of 30 minutes.
- H. Plug-in connectors shall be provided to connect all equipment, except coaxial cables and RF transmission line interface points. Coaxial cable distribution points and RF transmission lines shall use coaxial cable connections recommended by the cable OEM and approved by the system

OEM. Base band cable systems shall utilize barrier terminal screw type connectors, at a minimum. As an alternate, crimp type connectors installed with a ratchet type installation tool are acceptable provided the cable dress, pairs, shielding, grounding, connections and labeling are the same as the barrier terminal strip connectors. Tape of any type, wire nuts or solder type connections are unacceptable and will not be approved.

- I. All equipment faceplates utilized in the system shall be stainless steel, anodized aluminum or UL approved cycolac plastic for the areas where provided.
- J. Noise filters and surge protectors shall be provided for each equipment interface cabinet, control console and local and remote amplifier locations to insure protection from input primary AC power surges and to insure noise glitches are not induced into low voltage data circuits.
- K. Audio Level Processing: The use of telephone cable to distribute MATV signals, carrying system or sub-system AC or DC voltage is not acceptable and will not be approved. Additionally, each control location shall be provided with the equipment required to insure the system can produce its designed audio channel capacity at TV/speaker identified on the contract drawings.
- L. Contractor is responsible for pricing all accessories and miscellaneous equipment required to form a complete and operating system. Unless otherwise noted in this Part, equipment quantities shall be as indicated on the drawings.

2.3 MANUFACTURERS

- A. The products specified shall be new, FCC and UL Listed, and produced by OEM manufacturer of record. An OEM of record shall be defined as a company whose main occupation is the manufacture for sale of the items of equipment supplied and which:
 - 1. Maintains a stock of replacement parts for the item submitted,
 - 2. Maintains engineering drawings, specifications, and operating manuals for the items submitted, and
 - 3. Has published and distributed descriptive literature and equipment specifications on the items of equipment submitted at least 30 days prior to the Invitation for Bid.
- B. Specifications contained herein as set forth in this document detail the salient operating and performance characteristics of equipment in order for VA to distinguish acceptable items of equipment from unacceptable items of equipment. When an item of equipment is offered or furnished for which there is a specification contained herein, the item of equipment offered or furnished shall meet or exceed the specification for that item of equipment.
- C. The equipment items are the salient requirements of VA to provide an acceptable system described herein.

2.4 PRODUCTS

- A. The system distribution amplifier shall have a frequency range of 49-1,000 MHz and shall accommodate a minimum of 35 HDTV channels of programming. Gain of the preamplifier shall be 32dB, with an output level of 48dBmV for each HDTV channel processed. The preamplifier shall utilize a hybrid push-pull amplifier module. The preamplifier shall provide gain and slope control ranges of 8dB and 9dB, respectively.
- B. Provide riser rated coaxial cable with a nominal characteristic impedance of 75 Ohms throughout the entire frequency spectrum utilized in this system. Each reel of cable shall be sweep-tested and return-loss tested over the entire frequency range from 50MHz to 750MHz by the manufacturer. Provide RG-6, RG-11 or appropriate minimum .500" Hardline Coaxial cable as required to achieve the specified signal level. However, all runs over 150' in length shall be RG-11 or .500".
- C. Line Splitters:
 - 1. Provide low-radiation line splitters with a flat frequency response from 50MHz to 1,000MHz. Provide units of a hybrid design with a 75-ohm match on input and outputs and a VSWR no greater than 1.4:1.
 - 2. Two way line splitters shall have a signal loss of not more than 3.5dB at each output.
 - 3. Four way line splitters shall have a signal loss of not more than 7.2dB at each output.
 - 4. All unused splitter outputs shall be terminated with 75-Ohm terminations.
- D. HDTV Outlets:
 - 1. Provide outlets at each location shown on the plans. Mount in electrical contractor provided 4" square, 2" deep minimum flush electrical boxes as indicated on plans.
 - 2. Provisions shall be incorporated in the network to prevent 60 Hz AC or DC feedback into the distribution lines.
 - 3. Outlets shall be designed to cover a frequency range of 10MHz to 1,000MHz. Insertion loss shall not exceed 1.0 db at any frequency within the designated frequency range for a 17dB isolation network. Outlets shall be back-matched from 10 to 1,000MHz. Outlets shall have one F-type connector on the front and two F-type connectors on the rear.
 - 4. The minimum isolation value between any two outlets shall be 24 db.
- F. Television Receivers shall be provided separately by the Owner.
- G. Distribution Devices:
 - 1. Distribution Amplifier:
 - a. Description: Broadband CATV quality HDTV distribution amplifier.

b. Specifications:

Frequency Range: 49MHz to 1,000MHz.	Channel Loading: 150.
Flatness: +/- .75dB.	Gain: 32dB.
Output Level: +40dBmV.	Gain Control Range: 10dB.
Slope Control Range: 8dB.	Plug in equalizers as needed.
Attenuator options as needed.	

2. Splitters:

a. Description: RF signal splitter.

b. Specifications:

Frequency Range: 5MHz to 1,000MHz.	Outputs: 2, 3, 4 and 8.
Splitter Loss: less than 12 dB.	RFI Shielding: 120dB.

3. Taps:

a. Description: Directional Coupler Type Taps.

b. For use in Telecomm closets or accessible cable trays.

c. Specifications:

1. Frequency Range: 5MHz to 1,000MHz.
2. Outputs: 2, 4 and 8.
3. Isolation Tap Value: Varies.

4. Wallplate Bulkhead Connector and Terminators:

a. Description: Wall plates for termination of CATV signals at television sets.

1. Impedance: 75 Ohms.
2. Frequency Band: SUB/VHF/CATV/UHF.

5. "F" Connectors:

a. Coaxial cable connectors and connector inserts shall be designed to provide maximum performance with the cable to be used. Coaxial cables shall be connectorized with the Head End quality 360 degree F or BNC connectors as applicable, meeting or exceeding standard industry and the cable manufacture's specifications. All drop F-connectors shall be hex type crimp or a "Snap and Seal" type connector. Housing to housing (KS to KS) type or 90-degree type connectors shall be used where specified by the OEM.

6. Terminator:

- a. Description: 75-Ohm terminator.
- b. Specifications:

DC blocking.	Bandwidth: 50MHz-890MHz.
Return Loss: greater than 16dB.	Impedance: 75 Ohm.

7. Trunk Cable:

- a. Description: .500 inch, Semi-Rigid Coax, Riser Rated.
- b. Specifications:
 - 1. Maximum Attenuation:

2.92 dB/100ft at 700 MHz.	3.78 dB/100ft at 1000 MHz.
Impedance: 75 Ohm	

8. RG6 Cable:

- a. Description: CATV RG6 double shielded cable CM Rated
- b. Specifications:
 - 1. Attenuation:

1.48 dB/100ft at 50 MHz.	7.45 dB/100ft at 1000 MHz.
Impedance: 75 Ohm	

9. RG11 Cable:

- a. Description: CATV RG11 cable CM Rated
- b. Specifications:
 - 1. Attenuation:

0.90 dB/100ft at 50 MHz.	5.04 dB/100ft at 1000 MHz.
Impedance: 75 Ohm	

PART 3 - EXECUTION

3.1 PROJECT MANAGEMENT

- A. Assign a single project manager to this project who will serve as the point of contact for the Owner, the General Contractor, and the Engineer.

- B. The Contractor shall be proactive in scheduling work at the hospital, specifically the Contractor will initiate and maintain discussion with the general contractor regarding the schedule for ceiling cover up and install cables to meet that schedule.
- C. Contact the Office of Telecommunications, Special Communications Team (005OP3B) at (301) 734-0350 to have a VA Certified Telecommunications COTR assigned to the project for telecommunications review, equipment and system approval and co-ordination with VA's Spectrum Management and OCIS Teams.

3.2 COORDINATION WITH OTHER TRADES

- A. Coordinate with the cabling contractor the location of the faceplate and the faceplate opening for the MATV backbox.
- B. Coordinate with the cabling contractor the location of MATV equipment in the Telecommunications Closets.
- C. Before beginning work, verify the location, quantity, size and access for the following:
 - Isolated ground AC power circuits provided for systems.
 - Primary, emergency and extra auxiliary AC power generator requirements.
 - Junction boxes, wall boxes, wire troughs, conduit stubs and other related infrastructure for the systems.
 - System components installed by others.
 - Overhead supports and rigging hardware installed by others.
- D. Immediately notify the Owner, General Contractor and Consultant in writing of any discrepancies.

3.3 NEEDS ASSESSMENT

Provide a one-on-one meeting with the particular nursing manager of each unit affected by the installation of the new HDTV MATV system. Review the floor plan drawing, educate the nursing manager with the functions of the equipment that is being provided and gather details specific to the individual units; coverage and priorities of calls; staffing patterns; and other pertinent details that will affect system programming and training.

3.4 INSTALLATION

- A. General:
 - 1. Execute work in accordance with National, State and local codes, regulations and ordinances.
 - 2. Install work neatly, plumb and square and in a manner consistent with standard industry practice. Carefully protect work from dust, paint and moisture as dictated by site conditions. The Contractor will be fully responsible for protection of his work during the construction phase up until final acceptance by the Owner.

3. Install equipment according to OEM's recommendations. Provide any hardware, adaptors, brackets, rack mount kits or other accessories recommended by OEM for correct assembly and installation.
 4. Secure equipment firmly in place, including receptacles, speakers, equipment racks, system cables, etc:
 - a. All supports, mounts, fasteners, attachments and attachment points shall support their loads with a safety factor of at least 5:1.
 - b. Do not impose the weight of equipment or fixtures on supports provided for other trades or systems.
 - c. Any suspended equipment or associated hardware must be certified by the OEM for overhead suspension.
 - d. The Contractor is responsible for means and methods in the design, fabrication, installation and certification of any supports, mounts, fasteners and attachments.
 5. Locate overhead ceiling-mounted loudspeakers if shown on drawings, with minor changes not to exceed 12 inches in any direction:
 - a. Mount transformers securely to speaker brackets or enclosures using screws. Adjust torsion springs as needed to securely support speaker assembly.
 - b. Speaker back boxes shall be completely filled with fiberglass insulation.
 - c. Seal cone speakers to their enclosures to prevent air passing from one side of the speaker to the other.
 6. Finishes for any exposed work such as plates, racks, panels, speakers, etc. shall be approved by the Architect, Owner and 005OP3B.
 7. Coordinate cover plates with field conditions. Size and install cover plates as necessary to hide joints between back boxes and surrounding wall. Where cover plates are not fitted with connectors, provide grommets in size and quantity required. Do not allow cable to leave or enter boxes without cover plates installed.
- B. Equipment Racks:
1. Fill unused equipment mounting spaces with blank panels or vent panels. Match color to equipment racks.
 2. Provide security covers for all devices not requiring routine operator control.
 3. Provide vent panels and cooling fans as required for the operation of equipment within the OEM' specified temperature limits. Provide adequate ventilation space between equipment for cooling. Follow manufacturer's recommendations regarding ventilation space between amplifiers.

4. Provide insulated connections of the electrical raceway to equipment racks.
 5. Provide continuous raceway and conduit with no more than 40 percent fill between wire troughs and equipment racks for all non-plenum-rated cable. Ensure each system is mechanically separated from each other in the wireway.
- C. Wiring Practice - in addition to the mandatory infrastructure requirements outlined in VA Construction Specification, Section 27 10 00, STRUCTURED COMMUNICATIONS CABLING SYSTEM, the following additional practices shall be adhered to:
1. Comply with requirements for raceways and boxes specified in Division 26, Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS.
 2. Execute all wiring in strict adherence to the National Electrical Code, applicable local building codes and standard industry practices.
 3. Where raceway is to be EMT (conduit), wiring of differing classifications shall be run in separate conduit. Where raceway is to be an enclosure (rack, tray, wire trough, utility box) wiring of differing classifications, which share the same enclosure, shall be mechanically partitioned and separated by at least 4 inches. Where Wiring of differing classifications must cross, they shall cross perpendicular to one another.
 4. Do not splice wiring anywhere along the entire length of the run. Make sure cables are fully insulated and shielded from each other and from the raceway for the entire length of the run.
 5. Do not pull wire through any enclosure where a change of raceway alignment or direction occurs. Do not bend wires to less than radius recommended by manufacturer.
 6. Replace the entire length of the run of any wire or cable that is damaged or abraded during installation. There are no acceptable methods of repairing damaged or abraded wiring.
 7. Use wire pulling lubricants and pulling tensions as recommended by the OEM.
 8. Use grommets around cut-outs and knock-outs where conduit or chase nipples are not installed.
 9. Do not use tape-based or glue-based cable anchors.
 10. Ground shields and drain wires as indicated by the drawings.
 11. Field wiring entering equipment racks shall be terminated as follows:
 - a. Provide ample service loops at harness break-outs and at plates, panels and equipment. Loops should be sufficient to allow plates, panels and equipment to be removed for service and inspection.
 - b. Line level and speaker level wiring may be terminated inside the equipment rack using specified terminal blocks (see "Products"). Provide 15 percent spare terminals inside each rack. Microphone level wiring may only be terminated at the equipment served.

- c. If specified terminal blocks are not designed for rack mounting, utilize 3/4 inch plywood or 1/8 inch thick aluminum plates/blank panels as a mounting surface. Do not mount on the bottom of the rack.
 - d. Employ permanent strain relief for any cable with an outside diameter of 1 inch or greater.
- 12. Use only balanced audio circuits unless noted otherwise
- 13. Make all connections as follows:
 - a. Make all connections using rosin-core solder or mechanical connectors appropriate to the application.
 - b. For crimp-type connections, use only tools that are specified by the manufacturer for the application.
 - c. Use only insulated spade lugs on screw terminals. Spade lugs shall be sized to fit the wire gauge. Do not exceed two lugs per terminal.
 - d. Wire nuts, electrical tape or "Scotch Lock" connections are not acceptable for any application.
- D. Cable Installation - In addition to the mandatory infrastructure requirements outlined in VA Construction Specification, Section 27 10 00, STRUCTURED CABLING the following additional practices shall be adhered to:
 - 1. Support cable on maximum 4'-0" centers. Acceptable means of cable support are cable tray, j-hooks, and bridal rings. Velcro wrap cable bundles loosely to the means of support with plenum rated Velcro straps. Plastic tie wraps are not acceptable as a means to bundle cables.
 - 2. Run cables parallel to walls.
 - 3. Install maximum of 10 cables in a single row of J-hooks. Provide necessary rows of J-hooks as required by the number of cables.
 - 4. Do not lay cables on top of light fixtures, ceiling tiles, mechanical equipment, or ductwork. Maintain at least 2'-0" clearance from all shielded electrical apparatus.
 - 5. All cables shall be tested after the total installation is fully complete. All test results are to be documented. All cables shall pass acceptable test requirements and levels. Contractor shall remedy any cabling problems or defects in order to pass or comply with testing. This includes the re-pull of new cable as required at no additional cost to the Owner.
 - 6. Ends of cables shall be properly terminated on both ends per industry and OEM's recommendations.

7. Provide proper temporary protection of cable after pulling is complete before final dressing and terminations are complete. Do not leave cable lying on floor. Bundle and tie wrap up off of the floor until you are ready to terminate.
 8. Cover the end of the overall jacket with a 1 inch (minimum) length of transparent heat-shrink tubing. Cut unused insulated conductors 2 inches (minimum) past the heat-shrink, fold back over jacket and secure with cable-tie. Cut unused shield/drain wires 2 inches (minimum) past the Heatshrink and serve as indicated below.
 9. Cover shield/drain wires with heat-shrink tubing extending back to the overall jacket. Extend tubing 1/4 inch past the end of unused wires, fold back over jacket and secure with cable tie.
 10. For each solder-type connection, cover the bare wire and solder connection with heat-shrink tubing.
 11. Terminate conductors; no cable shall contain unterminated elements. Make terminations only at outlets and terminals.
 12. Splices, Taps, and Terminations: Arrange on numbered terminal strips in junction, pull, and outlet boxes; terminal cabinets; and equipment enclosures. Cables may not be spliced.
 13. Bundle, lace, and train conductors to terminal points without exceeding OEM's limitations on bending radii. Install lacing bars and distribution spools.
 14. Cold-Weather Installation: Bring cable to room temperature before dereeling. Heat lamps shall not be used.
 15. Cable shall not be run through structural members or be in contact with pipes, ducts, or other potentially damaging items.
- E. Labeling:
1. Clearly, consistently, logically and permanently mark switches, connectors, jacks, relays, receptacles and electronic and other equipment.
 2. Engrave and paint fill all receptacle panels using 1/8 inch (minimum) high lettering and contrasting paint.
 3. For rack-mounted equipment, use engraved Lamacoid labels with white 1/8 inch (minimum) high lettering on black background. Label the front and back of all rack-mounted equipment.
 4. Where multiple pieces of equipment reside in the same rack group, clearly and logically label each indicating to which room, channel, receptacle location, etc. they correspond.
 5. Permanently label cables at each end, including intra-rack connections. Labels shall be covered by the same, transparent heat-shrink tubing covering the end of the overall jacket. Alternatively, computer generated labels of the type which include a clear protective wrap may be used.

6. Contractor's name shall appear no more than once on each continuous set of racks. The Contractor's name shall not appear on wall plates or portable equipment.
7. Ensure each OEM supplied equipment has permanently attached/marked the appropriate UL Labels/Marks for the service the equipment is performed. Equipment installed not bearing these UL marks will not be allowed to be part of the system. The Contractor shall bear all costs required to provide replacement equipment with approved UL marks.

3.5 PROTECTION OF NETWORK DEVICES

Contractor shall protect network devices during unpacking and installation by wearing manufacturer approved electrostatic discharge (ESD) wrist straps tied to chassis ground. The wrist strap shall meet OSHA requirements for prevention of electrical shock, should technician encounter high voltage.

3.6 CUTTING AND PATCHING

- A. It shall be the responsibility of the contractor to keep their work area clear of debris and clean area daily at completion of work.
- B. It shall be the responsibility of the contractor to patch and paint any wall or surface that has been disturbed by the execution of this work.
- C. The Contractor shall be responsible for providing any additional cutting, drilling, fitting or patching required that is not indicated as provided by others to complete the Work or to make its parts fit together properly.
- D. The Contractor shall not damage or endanger a portion of the Work or fully or partially completed construction of the Owner or separate contractors by cutting, patching or otherwise altering such construction, or by excavation. The Contractor shall not cut or otherwise alter such construction by the Owner or a separate contractor except with written consent of the Owner and of such separate contractor; such consent shall not be unreasonably withheld. The Contractor shall not unreasonably withhold from the Owner or a separate Contractor, the Contractor's consent to cutting or otherwise altering the work.
- E. Where coring of existing (previously installed) concrete is specified or required, including coring indicated under unit prices, the location of such coring shall be clearly identified in the field and the location shall be approved by the Project Manager prior to commencement of coring work.

3.7 FIREPROOFING

- A. Where MATV cables penetrate fire rated walls, floors and ceilings, fireproof the opening.
- B. Provide conduit sleeves (coordinate requirements with electrical contractor) for cables that penetrate fire rated walls and floors. After the cabling installation is complete, install fire proofing

material in and around all conduit sleeves and openings. Install fire proofing material thoroughly and neatly. Seal all floor and ceiling penetrations.

- C. Use only materials and methods that preserve the integrity of the fire stopping system and its rating.

3.8 GROUNDING

- A. Ground cable shields and equipment to eliminate shock hazard and to minimize ground loops, commonmode returns, noise pickup, cross talk, and other impairments.
- B. Signal Ground Terminal: Locate at main equipment cabinet. Isolate from power system and equipment grounding.
- C. Install grounding electrodes as specified in Division 26, Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS.
- D. Do not use “3rd or 4th” wire internal electrical system conductors for ground.
- E. Do not connect system ground to the building’s external lightning protection system.
- F. Do not “mix grounds” of different systems.

PART 4 - TESTING/GUARANTEE/TRAINING

4.1 SYSTEM CLASSIFICATION

The HDTV MATV System is FCC and NFPA listed. Therefore, the following testing and guaranty provisions are the minimum to be performed and provided by the contractor and Warranted by the OEM.

4.2 PROOF OF PERFORMANCE TESTING

- A. Intermediate Testing:
 1. After completion of 25 – 30 percent of the installation of HDTV MATV outlets and interconnection to the corresponding Nurse Call (Code Blue) System Patient Head Wall Units and prior to any further work, this portion of the system must be pretested, inspected, and certified. Each item of installed equipment shall be checked to ensure appropriate FCC listing and UL certification labels are affixed, NFPA, Emergency, Safety, and JCAHCO guidelines are followed, and proper installation practices are followed. The intermediate test shall include a full operational test.
 2. The inspection and test will be conducted by a factory-certified contractor representative and witnessed by a Government Representative. The results of the inspection will be officially recorded by a local Government Representative and maintained on file by the Resident Engineer (RE), until completion of the entire project. The results will be compared to the Acceptance Test results. An identical inspection may be conducted between the 65 – 75 percent of the system construction phase, at the direction of the Resident Engineer.

B. Pretesting:

1. Upon completing installation of the system, the Contractor shall align, balance, and completely pretest the entire system under full operating conditions.
2. Pretesting Procedure:
 - a. During the system pretest the Contractor shall verify (utilizing approved test equipment) that the system is fully operational and meets all the system performance requirements of this standard.
 - b. The Contractor shall pretest and verify that all system functions and specification requirements are met and operational, no unwanted aural effects, such as signal distortion, noise pulses, glitches, audio hum, poling noise, etc. are present. At a minimum, each of the following locations shall be fully pretested:
 - 1) Antennas.
 - 2) Lightning Grounds.
 - 3) Head End.
 - 4) Local and Remote Control Units/Enunciation Panels.
 - 5) All Networked locations.
 - 6) System interface locations (i.e.PA, Auditorium Audio, etc.).
 - 7) System trouble reporting.
 - 8) UPS operation.
 - 9) Primary and Emergency AC Power Requirements
 - 10) Extra Auxiliary Generator Requirements.
3. The Contractor shall provide 4 copies of the recorded system pretest measurements and the written certification that the system is ready for the formal acceptance test shall be submitted to the Resident Engineer.

C. Acceptance Test:

1. After the system has been pre-tested and the Contractor has submitted the pretest results and certification to the Resident Engineer, then the Contractor shall schedule an acceptance test date and give the Resident Engineer 30 days written notice prior to the date the acceptance test is expected to begin. The system shall be tested in the presence of a Government Representative and an OEM certified representative. The system shall be tested utilizing the approved test equipment to certify proof of performance and FCC compliance. The test shall verify that the total system meets all the requirements of this specification. The notification of the acceptance test shall include the expected length (in time) of the test.

2. The acceptance test shall be performed on a "go-no-go" basis. Only those operator adjustments required to show proof of performance shall be allowed. The test shall demonstrate and verify that the installed system does comply with all requirements of this specification under operating conditions. The system shall be rated as either acceptable or unacceptable at the conclusion of the test. Failure of any part of the system that precludes completion of system testing, and which cannot be repaired in 4 hours, shall be cause for terminating the acceptance test of the system. Repeated failures that result in a cumulative time of 8 hours to affect repairs shall cause the entire system to be declared unacceptable. Retesting of the entire system shall be rescheduled at the convenience of the Government.

D. Acceptance Test Procedure:

1. Physical and Mechanical Inspection:
 - a. The VACO Government Representative will tour all major areas where the system is and all sub-systems are completely and properly installed to insure they are operationally ready for proof of performance testing. A system inventory including available spare parts will be taken at this time. Each item of installed equipment shall be checked to ensure appropriate UL certification labels are affixed.
 - b. The system diagrams, record drawings, equipment manuals, Telecommunications Infrastructure Plant (TIP) Auto CAD Disks, intermediate, and pretest results shall be formally inventoried and reviewed.
 - c. Failure of the system to meet the installation requirements of this specification shall be grounds for terminating all testing.
2. Operational Test:
 - a. After the Physical and Mechanical Inspection, the head end terminations and control equipment shall be checked to verify that it meets all performance requirements outlined herein. A spectrum analyzer and sound level meter shall be utilized to accomplish this requirement.
 - b. Following the Head End connection test, the local control unit be connected to the Head End equipment's output test tap to ensure there are no signal distortions such as intermodulation, data noise, popping sounds, erratic system functions, on any function.
 - c. The distribution system shall be checked at each interface, junction, and distribution point, first, middle, and last leg to verify that the HDTV MATV video, audio and control signals meets all system performance standards.
 - d. Each HDTV MATV outlet shall be functionally tested at the same time utilizing the Contractor's approved hospital grade TV receiver and Spectrum Analyzer.

- e. The red system and volume stepper switches shall be checked to insure proper operation of the pillow speaker, the volume stepper and the red system (if installed).
 - f. Once these tests have been completed, each installed sub-system function shall be tested as a unified, functioning and fully operating system.
 - g. Individual Item Test: The VACO Government Representative will select individual items of equipment for detailed proof of performance testing until 100percent of the system has been tested and found to meet the contents of this specification. Each item shall meet or exceed the minimum requirements of this document.
3. Test Conclusion:
- a. At the conclusion of the Acceptance Test, using the generated punch list (or discrepancy list) the VA and the Contractor shall jointly agree to the results of the test, and reschedule testing on deficiencies and shortages with the Resident Engineer. Any retesting to comply with these specifications will be done at the Contractor's expense.
 - b. If the system is declared unacceptable without conditions, all rescheduled testing expenses will be borne by the Contractor.
- E. Acceptable Test Equipment:
- 1. The test equipment shall furnished by the Contractor shall have a calibration tag of an acceptable calibration service dated not more than 12 months prior to the test. As part of the submittal, a test equipment list shall be furnished that includes the make and model number of the following type of equipment as a minimum:
 - a. Spectrum Analyzer.
 - b. Signal Level Meter.
 - c. Volt-Ohm Meter.
 - d. Sound Pressure Level (SPL) Meter.
 - e. Oscilloscope.
 - f. Pillow Speaker Test Set (Pillow Speaker with appropriate load and cross connections in lieu of the set is acceptable).

4.3 SYSTEM GUARANTEE

- A. Contractor's Responsibility:
- 1. The Contractor shall guarantee that all provided material and equipment will be free from defects, workmanship and will remain so for a period of one year from date of final acceptance of the system by the VA. The Contractor shall provide OEM's equipment warranty documents, to the Resident Engineer (or Facility Contracting Officer if the Facility

- has taken possession of the building), that certifies each item of equipment installed conforms to OEM published specifications.
2. The Contractor's maintenance personnel shall have the ability to contact the Contractor and OEM for emergency maintenance and logistic assistance, remote diagnostic testing, and assistance in resolving technical problems at any time. This contact capability shall be provided by the Contractor and OEM at no additional cost to the VA.
 3. All Contractor maintenance and supervisor personnel shall be fully qualified by the OEM and must provide 2 copies of current and qualified OEM training certificates and OEM certification upon request.
 4. Additionally, the Contractor shall accomplish the following minimum requirements during the One Year Guarantee Period:
 - a. Response Time during the One Year Guarantee Period:
 - 1) The Resident Engineer (or Facility Contracting Officer if the system has been turned over to the Facility) is the Contractor's only official reporting and contact official for MATV system trouble calls, during the guarantee period.
 - 2) A standard work week is considered 8:00 A.M. to 5:00 P.M. or as designated by the Resident Engineer (or Facility Contracting Officer), Monday through Friday exclusive of Federal Holidays.
 - 3) The Contractor shall respond and correct on-site trouble calls, during the standard work week to:
 - a) A routine trouble call within 1 working day of its report. A routine trouble is considered a trouble that causes a pillow speaker or cordset, 1 master IC control station, room station or emergency station to be inoperable.
 - b) Routine trouble calls in critical emergency health care facilities (i.e., cardiac arrest, intensive care units, etc.) shall also be deemed as an emergency trouble call. The Resident Engineer (or Facility Contracting Officer) shall notify the Contractor of this type of trouble call.
 - c) An emergency trouble call within 4 hours of its report. An emergency trouble is considered a trouble that causes a sub-system (ward), distribution point, terminal cabinet, or all call system to be inoperable at anytime.
 - 4) If a HDTV MATV component failure cannot be corrected within 6 hours (exclusive of the standard work time limits), the Contractor shall be responsible for providing alternate HDTV MATV equipment. The alternate equipment/system shall be operational within a maximum of 18 hours after the 6 hour trouble shooting time and

restore the effected location operation to meet the system performance standards. If any sub-system or major system trouble cannot be corrected within one working day, the Contractor shall furnish and install compatible substitute equipment returning the system or sub-system to full operational capability, as described herein, until repairs are complete.

b. Required On-Site Visits during the One Year Guarantee Period:

- 1) The Contractor shall visit, on-site, as necessary, during the guarantee period, to perform system preventive maintenance, equipment cleaning, and operational adjustments to maintain the system according the descriptions identified in this document.
- 2) The Contractor shall arrange all Facility visits with the Resident Engineer (or Facility Contracting Officer) prior to performing the required maintenance visits.
- 3) Preventive maintenance shall be performed by the Contractor in accordance with the OEM's recommended practice and service intervals during non-busy time agreed to by the Resident Engineer (or Facility Contracting Officer) and Contractor.
- 4) The preventive maintenance schedule, functions and reports shall be provided to and approved by the Resident Engineer (or Facility Contracting Officer).
- 5) The Contractor shall provide the Resident Engineer (or Facility Contracting Officer) a type written report itemizing each deficiency found and the corrective action performed during each required visit or official reported trouble call. The Contractor shall provide the Resident Engineer with sample copies of these reports for review and approval at the beginning of the Acceptance Test. The following reports are the minimum required:
 - a) The Contractor shall provide a monthly summary all equipment and sub-systems serviced during this guarantee period to Resident Engineer (or Facility Contracting Officer) by the fifth (5th) working day after the end of each month. The report shall clearly and concisely describe the services rendered, parts replaced and repairs performed. The report shall prescribe anticipated future needs of the equipment and systems for preventive and predictive maintenance.
 - b) The Contractor shall maintain a separate log entry for each item of equipment and each sub-system of the system. The log shall list dates and times of all scheduled, routine, and emergency calls. Each emergency call shall be described with details of the nature and causes of emergency steps taken to rectify the situation and specific recommendations to avoid such conditions in the future.

- 6) The Resident Engineer (or Facility Contracting Officer) shall convey to the Facility Engineering Officer, 2 copies of actual reports for evaluation.
 - a) The Resident Engineer (or Facility Contracting Officer) shall ensure a copy of these reports is entered into the system's official acquisition documents.
 - b) The Facility Chief Engineer shall ensure a copy of these reports is entered into the system's official technical record documents.
- B. Work Not Included: Maintenance and repair service shall not include the performance of any work due to improper use; accidents; other vendor, contractor, or owner tampering or negligence, for which the Contractor is not directly responsible and does not control. The Contractor shall immediately notify the Resident Engineer or Facility Contracting Officer in writing upon the discovery of these incidents. The Resident Engineer or Facility Contracting Officer will investigate all reported incidents and render

4.4 TRAINING

- A. Provide thorough training of the owner's engineering and maintenance staff.
- B. Provide the following minimum training times and durations:
 - 1. 24 hours prior to opening, 2 hour training session.

- - - E N D - - -

SECTION 27 52 23 NURSE CALL AND CODE BLUE SYSTEMS

PART 1 - GENERAL

1.1 SECTION SUMMARY

- A. Work covered by this document includes design, engineering, labor, material and products, equipment warranty and system guarantee, training and services for, and incidental to, the complete installation of new and fully operating National Fire Protection Association (NFPA) – Life Safety Code 101.3-2 (a) Labeled and (b) Listed, Emergency Service Nurse-Call and/or Life Safety listed Code Blue Communication System and associated equipment (here-in-after referred to as the System) provided in approved locations indicated on the contract drawings. These items shall be tested and certified capable of receiving, distributing, interconnecting and supporting Nurse-Call and/or Code Blue communications signals generated local and remotely as detailed herein.
- B. Work shall be complete, Occupational Safety and Health Administration (OSHA), National Recognized Testing Laboratory (NRTL – i.e. Underwriters Laboratory [UL]) Listed and Labeled; and VA Central Office (VACO), Telecommunications Voice Engineering (TVE 005OP3B) tested, certified and ready for operation.
- C. The System shall be delivered free of engineering, manufacturing, installation, and functional defects. It shall be designed, engineered and installed for ease of operation, maintenance, and testing.
- D. The term “provide”, as used herein, shall be defined as: designed, engineered, furnished, installed, certified, tested, and guaranteed by the Contractor.
- E. Specification Order of Precedence: In the event of a conflict between the text of this document and the Project’s Contract Drawings outlined and/or cited herein; **THE TEXT OF THIS DOCUMENT TAKES PRECEDENCE. HOWEVER, NOTHING IN THIS DOCUMENT WILL SUPERSEDE APPLICABLE EMERGENCY LAWS AND REGULATIONS**, SPECIFICALLY NATIONAL AND/OR LOCAL LIFE AND PUBLIC SAFETY CODES. The Local Fire Marshall and/or VA Public Safety Officer are the only authorities that may modify this document’s EMERGENCY CODE COMPLIANCE REQUIREMENTS, on a case by case basis, in writing and confirmed by VA’s Project Manager (PM), Resident Engineer (RE) and TVE-005OP3B. The VA PM is the only approving authority for other amendments to this document that may be granted, on a case by case basis, in writing with technical concurrences by VA’s PM, RE, TVE-005OP3B and identified Facility Project Personnel.

- F. The Original Equipment Manufacturer (OEM) and Contractor shall ensure that all management, sales, engineering and installation personnel have read and understand the requirements of this specification before the system is designed, engineered, delivered and provided. The Contractor shall furnish a written statement stating this requirement as a part of the technical submittal that includes each name and certification, including the OEMs. The Contractor is cautioned to obtain in writing, all approvals for system changes relating to the published contract specifications and drawings, from the PM and/or the RE before proceeding with the change.

1.2 RELATED SECTIONS

- A. 01 33 23 – Shop Drawings, Product Data and Samples.
- B. 07 84 00 – Firestopping.
- C. 26 05 21 – Low – Voltage Electrical Power Conductors and Cables (600 Volts and Below).
- D. 27 05 11 – Requirements for Communications Installations.
- E. 27 05 26 – Grounding and Bonding for Communications Systems.
- F. 27 05 33 – Raceways and Boxes for Communications Systems.
- G. 27 10 00 – Systems Cabling.
- H. 27 15 00 – Horizontal Cabling.
- I. 27 41 31 – Master Antenna Television Equipment and Systems

1.3 DEFINITION

- A. Provide: Design, engineer, furnish, install, connect complete, test, certify and guarantee.
- B. Work: Materials furnished and completely installed.
- C. Review of contract drawings: A service by the engineer to reduce the possibility of materials being ordered which do not comply with contract documents. The engineer's review shall not relieve the Contractor of responsibility for dimensions or compliance with the contract documents. The reviewer's failure to detect an error does not constitute permission for the Contractor to proceed in error.
- D. Headquarters (aka VACO) Technical Review, for National and VA Communications and Security, Codes, Frequency Licensing Standards, Guidelines and Compliance:

Office of Telecommunications

Special Communications Team (005OP3B)

1335 East West Highway – 3rd Floor

Silver Spring, Maryland 20910,

(O) 301-734-0350, (F) 301-734-0360

1.4 REFERENCES

- A. The installation shall comply fully with all governing authorities, laws and ordinances, regulations, codes and standards, including, but not limited to:
 1. United States Federal Law:
 - a. Departments of:
 - 1) Commerce, Consolidated Federal Regulations (CFR), Title 15 – Under the Information Technology Management Reform Act (Public Law 104-106), the Secretary of Commerce approves standards and guidelines that are developed by the:
 - a) Chapter II, National Institute of Standards Technology (NIST – formerly the National Bureau of Standards). Under Section 5131 of the Information Technology Management Reform Act of 1996 and the Federal Information Security Management Act of 2002 (Public Law 107-347), NIST develops – Federal Information Processing Standards Publication (FIPS) 140-2—Security Requirements for Cryptographic Modules.
 - b) Chapter XXIII, National Telecommunications and Information Administration (NTIA – aka ‘Red Book’) Chapter 7.8 / 9; CFR, Title 47 Federal communications Commission (FCC) Part 15, Radio Frequency Restriction of Use and Compliance in “Safety of Life” Functions & Locations.
 - 2) FCC - Communications Act of 1934, as amended, CFR, Title 47 – Telecommunications, in addition to Part 15 – Restrictions of use for Part 15 listed Radio Equipment in Safety of Life / Emergency Functions / Equipment/ Locations (also see CFR, Title 15 – Department of Commerce, Chapter XXIII – NTIA):
 - a) Part 15 – Restrictions of use for Part 15 listed Radio Equipment in Safety of Life / Emergency Functions / Equipment/Locations.
 - b) Part 58 – Television Broadcast Service.
 - c) Part 90 – Rules and Regulations, Appendix C.
 - 3) Health, (Public Law 96-88), CFR, Title 42, Chapter IV Health & Human Services, CFR, Title 46, Subpart 1395(a)(b) JCAHO “a hospital that meets JCAHO accreditation is deemed to meet the Medicare conditions of Participation by meeting Federal Directives:”
 - a) All guidelines for Life, Personal and Public Safety; and, Essential and Emergency Communications.
 - 4) Labor, CFR, Title 29, Part 1910, Chapter XVII - Occupational Safety and Health Administration (OSHA), Occupational Safety and Health Standard:

- a) Subpart 7 - Definition and requirements (for a NRTL – 15 Laboratory's, for complete list, contact (http://www.osha.gov/dts/otpc/nrtl/faq_nrtl.html):

1) UL:

- a) 44-02 – Standard for Thermoset-Insulated Wires and Cables.
- b) 65 – Standard for Wired Cabinets.
- c) 83-03 – Standard for Thermoplastic-Insulated Wires and Cables.
- d) 467-01 – Standard for Electrical Grounding and Bonding Equipment
- e) 468 – Standard for Grounding and Bonding Equipment.
- f) 486A-01 – Standard for Wire Connectors and Soldering Lugs for Use with Copper Conductors
- g) 486C-02 – Standard for Splicing Wire Connectors.
- h) 486D-02 – Standard for Insulated Wire Connector Systems for Underground Use or in Damp or Wet Locations.
- i) 486E-00 – Standard for Equipment Wiring Terminals for Use with Aluminum and/or Copper Conductors.
- j) 493-01 – Standard for Thermoplastic-Insulated Underground Feeder and Branch Circuit Cable.
- k) 514B-02 – Standard for Fittings for Cable and Conduit.
- l) 1069 – Hospital Signaling and Nurse Call Equipment.
- m) 1449 – Standard for Transient Voltage Surge Suppressors.
- n) 1479-03 – Standard for Fire Tests of Through-Penetration Fire Stops.
- o) 1666 – Standard for Wire/Cable Vertical (Riser) Tray Flame Tests.
- p) 1863 – Standard for Safety, Communications Circuits Accessories.
- q) 2024 – Standard for Optical Fiber Raceways.
- r) 60950-1/2 – Information Technology Equipment –

Safety.

- 2) Canadian Standards Association (CSA): same tests as for UL.
- 3) Communications Certifications Laboratory (CCL): same tests as for UL.
- 4) Intertek Testing Services NA, Inc. (ITSNA formerly Edison Testing Laboratory [ETL]): same tests as for UL.
- b) Subpart 35 – Compliance with NFPA 101 – Life Safety Code.
- c) Subpart 36 - Design and construction requirements for exit routes.
- d) Subpart 268 - Telecommunications.
- e) Subpart 305 - Wiring methods, components, and equipment for general use.
- 5) Department of Transportation, CFR, Title 49 (Public Law 89-670), Part 1, Subpart C – Federal Aviation Administration (FAA):
 - a) Standards AC 110/460-ID & AC 707 / 460-2E – Advisory Circulars for Construction of Antenna Towers.
 - b) Forms 7450 and 7460-2 – Antenna Construction Registration.
- 6) Veterans Affairs (Public Law No. 100-527), CFR, Title 38, Volumes I & II:
 - a) Office of Telecommunications:
 - 1) Handbook 6100 – Telecommunications.
 - a) Spectrum Management FCC & NTIA Radio Frequency Compliance and Licensing Program.
 - b) Special Communications Proof of Performance Testing, VACO Compliance and Life Safety Certification(s).
 - b) Office of Cyber and Information Security (OCIS):
 - 1) Handbook 6500 - Information Security Program.
 - 2) Wireless and Handheld Device Security Guideline Version 3.2, August 15, 2005.
 - c) VA's National Center for Patient Safety – Veterans Health Administration Warning System, Failure of Medical Alarm Systems using Paging Technology to Notify Clinical Staff, July 2004.
 - d) VA's Center for Engineering Occupational Safety and Health, concurrence with warning identified in VA Directive 7700.
 - e) Office of Construction and Facilities Management (CFM):
 - 1) Master Construction Specifications (PG-18-1).

- 2) Standard Detail and CAD Standards (PG-18-4).
- 3) Equipment Guide List (PG-18-5).
- 4) Electrical Design Manual for VA Facilities (PG 18-10),
Articles 7 & 8.
- 5) Minimum Requirements of A/E Submissions (PG 18-15):
 - a) Volume B, Major New Facilities, Major Additions; and
Major Renovations, Article VI, Paragraph B.
 - b) Volume C - Minor and NRM Projects, Article III,
Paragraph S.
 - c) Volume E - Request for Proposals Design/Build
Projects, Article II, Paragraph F.
- 6) Mission Critical Facilities Design Manual (Final Draft –
2007).
- 7) Life Safety Protected Design Manual (Final Draft –
2007).
- 8) Solicitation for Offerors (SFO) for Lease Based Clinics
– (05-2009).
- b. Federal Specifications (Fed. Specs.):
 - 1) A-A-59544-00 - Cable and Wire, Electrical (Power, Fixed Installation).
2. National Codes:
 - a. American Institute of Architects (AIA): Guidelines for Healthcare Facilities.
 - b. American National Standards Institute/Electronic Industries
Association/Telecommunications Industry Association (ANSI/EIA/TIA):
 - 1) 568-B - Commercial Building Telecommunications Wiring Standards:
 - a) B-1 – General Requirements.
 - b) B-2 – Balanced twisted-pair cable systems.
 - c) B-3 - Fiber optic cable systems.
 - 2) 569 - Commercial Building Standard for Telecommunications Pathways and Spaces.
 - 3) 606 – Administration Standard for the Telecommunications Infrastructure of
Communications Buildings.
 - 4) 607 – Commercial Building Grounding and Bonding Requirements for
Telecommunications.
 - 5) REC 127-49 – Power Supplies.

- 6) RS 270 – Tools, Crimping, Solderless Wiring Devices, Recommended Procedures for User Certification.
- c. American Society of Mechanical Engineers (ASME):
 - 1) Standard 17.4 – Guide for Emergency Personnel.
 - 2) Standard 17.5 – Elevator & Escalator Equipment (prohibition of installing non-elevator equipment in Elevator Equipment Room / Mechanical Penthouse).
- d. American Society of Testing Material (ASTM):
 - 1) D2301-04 - Standard Specification for Vinyl Chloride Plastic Pressure Sensitive Electrical Insulating Tape.
- e. Building Industries Communications Services Installation (BICSI):
 - 1) All standards for smart building wiring, connections and devices for commercial and medical facilities.
 - 2) Structured Building Cable Topologies.
 - 3) In consort with ANSI/EIA/TIA.
- f. Institute of Electrical and Electronics Engineers (IEEE):
 - 1) SO/TR 21730:2007 - Use of mobile wireless communication and computing technology in healthcare facilities - Recommendations for electromagnetic compatibility (management of unintentional electromagnetic interference) with medical devices.
 - 2) 0739-5175/08/©2008 IEEE – Medical Grade – Mission Critical – Wireless Networks.
 - 3) C62.41 – Surge Voltages in Low-Voltage AC Power Circuits.
- g. NFPA:
 - 1) 70 - National Electrical Code (current date of issue) – Articles 517, 645 & 800.
 - 2) 75 - Standard for Protection of Electronic Computer Data-Processing Equipment.
 - 3) 77 – Recommended Practice on Static Electricity.
 - 4) 99 - Healthcare Facilities.
 - 5) 101 - Life Safety Code.
- 3. State Hospital Code(s).
- 4. Local Town, City and/or County Codes.
- 5. Accreditation Organization(s):
 - a. Joint Commission on Accreditation of Hospitals Organization (JCAHO) – Section VI, Part 3a – Operating Features.

1.5 QUALIFICATIONS

- A. The Contractor shall have had experience with three (3) or more installations of Nurse Call systems of comparable size and interfacing complexity with regards to type and design as specified herein. Each of these installations shall have performed satisfactorily for at least one (1) year after final acceptance by the user. Include the names, locations and point of contact for these installations as a part of the submittal.
- B. The Contractor shall submit certified documentation that they have been an authorized distributor and service organization for the OEM for a minimum of three (3) years. The Contractor shall be authorized by the OEM to pass thru the OEM's warranty of the installed equipment to VA. In addition, the OEM and Contractor shall accept complete responsibility for the design, installation, certification, operation, and physical support for the System. This documentation, along with the System Contractor and OEM certifications must be provided in writing as part of the Contractor's Technical submittal.
- C. The Contractor's Communications Technicians assigned to the System shall be fully trained, qualified, and certified by the OEM on the engineering, installation, operation, and testing of the System. The Contractor shall provide formal written evidence of current OEM certification(s) for the installer(s) as a part of the submittal or to the RE before being allowed to commence work on the System.
- D. The Contractor shall display all applicable national, state and local licenses.
- E. The Contractor shall submit copy (s) of Certificate of successful completion of OEM's installation/training school for installing technicians of the System's Nurse Call and/or Code Blue equipment being proposed.

1.6 CODES AND PERMITS

- A. Provide all necessary permits and schedule all inspections as identified in the contract's milestone chart, so that the system is proof of performance tested, certified and approved by VA and ready for operation on a date directed by the Owner.
- B. The contractor is responsible to adhere to all codes described herein and associated contractual, state and local codes.

1.7 SCHEDULING

- A. After the award of contract, the Contractor shall prepare a detailed schedule (aka milestone chart) using "Microsoft Project" software or equivalent. The Contractor Project Schedule (CPS) shall indicate detailed activities for the projected life of the project. The CPS shall consist of detailed activities and their restraining relationships. It will also detail manpower usage throughout the project.

- B. It is the responsibility of the Contractor to coordinate all work with the other trades for scheduling, rough-in, and finishing all work specified. The owner will not be liable for any additional costs due to missed dates or poor coordination of the supplying contractor with other trades.

1.8 REVIEW OF CONTRACT DRAWINGS AND EQUIPMENT DATA SUBMITTALS (AKA TECHNICAL SUBMITTAL[S])

- (Note: The Contractor is encouraged, but not required, to submit separate technical submittal(s) outlining alternate technical approach(s) to the system requirements stated here-in as long as each alternate technical document(s) is complete, separate, and submitted in precisely the same manner as outlined herein. VA will review and rate each received alternate submittal, which follows this requirement, in exactly the same procedure as outlined herein. Partial, add-on, or addenda type alternates will not be accepted or reviewed.)
- A. Submit at one time within 10 days of contract awarding, drawings and product data on all proposed equipment and system. Check for compliance with contract documents and certify compliance with Contractor's "APPROVED" stamp and signature.
 - B. Support all submittals with descriptive materials, i.e., catalog sheets, product data sheets, diagrams, and charts published by the manufacturer. These materials shall show conformance to specification and drawing requirements.
 - C. Where multiple products are listed on a single cut-sheet, circle or highlight the one that you propose to use. Provide a complete and through equipment list of equipment expected to be installed in the system, with spares, as a part of the submittal. Special Communications (TVE-005OP3B) will not review any submittal that does not have this list.
 - D. Provide four (4) copies to the PM for technical review. The PM will provide a copy to the offices identified in Paragraph 1.3.C & D, at a minimum for compliance review as described herein where each responsible individual(s) shall respond to the PM within 10 days of receipt of their acceptance or rejection of the submittal(s).
 - E. Provide interconnection methods, conduit (where not already installed), junction boxes (J-Boxes), cable, interface fixtures and equipment lists for the: ENR(s) (aka DMARC), TER, TCR, MCR, MCOR, PCR, ECR, Stacked Telecommunications Rooms (STR), Nurses Stations (NS), Head End Room (HER), Head End Cabinet (HEC), Head End Interface Cabinet (HEIC) and approved TCO locations TIP interface distribution layout drawing, as they are to be installed and interconnected to teach other.
 - F. Equipment technical literature detailing the electrical and technical characteristics of each item of equipment to be furnished.

- G. Engineering drawings of the System, showing calculated of expected signal levels at the headend input and output, each input and output distribution point, and signal level at each telecommunications outlet.
- H. Surveys Required as a Part of The Technical Submittal:
 - 1. The Contractor shall provide the following System surveys that depict various system features and capacities required *in addition to* the on-site survey requirements described herein (*see Specification Paragraph 2.4.3*). Each survey shall be in writing and contain the following information (the formats are suggestions and may be used for the initial Technical Submittal Survey requirements), as a minimum:
 - a. Nurse Call Cable System Design Plan:
 - 1) An OEM and contractor designed functioning Nurse Call System cable plan. A specific functioning Nurse Call: conduit pathways, cable, interfaces, J-boxes and back boxes shall coincide with the total growth items as described herein. It is the Contractor's responsibility to provide the Systems' entire Nurse Call cable and accessory requirements and engineer a functioning Nurse Call distribution system and equipment requirement plan of the following paragraph(s), at a minimum:
 - 2) The required Nurse Call and/or Code Blue Equipment Locations are identified on the Drawings.

1.9 PROJECT RECORD DOCUMENTS (AS BUILTS)

- A. Throughout progress of the Work, maintain an accurate record of changes in Contract Documents. Upon completion of Work, transfer recorded changes to a set of Project Record Documents.
- B. The floorplans shall be marked in pen to include the following:
 - 1. Each device specific locations with UL labels affixed.
 - 2. Conduit locations. Coordinate pathway requirements with Electrical Contractor.
 - 3. Each interface and equipment specific location.
 - 4. Head-end equipment and specific location.
 - 5. Wiring diagram.
 - 6. Labeling and administration documentation.
 - 7. Warranty certificate.
 - 8. System test results.

1.10 WARRANTIES / GUARANTY

- A. The Contractor shall warrant the installation to be free from defect in material and workmanship for a period of two (2) years from the date of acceptance of the project by the owner. The

Contractor shall agree to remedy covered defects within four (4) hours of notification of major failures or within twenty-four (24) hours of notification for individual station related problems.

- B. The Contractor shall agree to grantee the system according to the guidelines outlined in Article 4 herein.

1.11 USE OF THE SITE

- A. Use of the site shall be at the GC's direction.
- B. Coordinate with the GC for lay-down areas for product storage and administration areas.
- C. Coordinate work with the GC and their sub-contractors.
- D. Access to buildings wherein the work is performed shall be directed by the GC.

1.12 DELIVERY, STORAGE, AND HANDLING

- A. Deliver, store, and handle products using means and methods that will prevent damage, deterioration, and loss, including theft.
- B. Store products in original containers.
- C. Coordinate with the GC for product storage. There may be little or no storage space available on site. Plan to potentially store materials off site.
- D. Do not install damaged products. Remove damaged products from the site and replaced with new product at no cost to the Owner.

1.13 PROJECT CLOSE-OUT

- A. Prior to final inspection and acceptance of the work, remove all debris, rubbish, waste material, tools, construction equipment, machinery and surplus materials from the project site and thoroughly clean your work area.
- B. Before the project closeout date, the Contractor shall submit:
 - 1. OEM Equipment Warranty Certificates.
 - 2. Evidence of compliance with requirements of governing authorities such as the Low Voltage Certificate of Inspection.
 - 3. Project record documents.
 - 4. Instruction manuals and software that is a part of the system.
 - 5. System Guaranty Certificate.
- C. Contractor shall submit written notice that:
 - 1. Contract Documents have been reviewed.
 - 2. Project has been inspected for compliance with contract.
 - 3. Work has been completed in accordance with the contract.

PART 2 – PRODUCTS / FUNCTIONAL REQUIREMENTS

2.0 GENERAL REQUIREMENTS FOR EQUIPMENT AND MATERIALS

- A. Furnish and install a complete and fully functional and operable Nurse Call System for each location shown on the contract drawings. Basis of Design: Rauland Responder V System.
- B. Coordinate features and select interface components to form an integrated Nurse Call system. Match components and interconnections between the systems for optimum performance of specified functions.
- C. Expansion Capability: The Nurse Call equipment interfaces and cables shall be able to increase number of enunciation points in the future by a minimum of 50 percent (%) above those indicated without adding any internal or external components or main trunk cable conductors.
- D. Equipment: Active electronic type shall use solid-state components, fully rated for continuous duty unless otherwise indicated. Select equipment for normal operation on input power usually supplied between 110 to 130 VAC, 60 Hz supplied from the Facility's Emergency Electrical Power System.
- E. Meet all FCC requirements regarding equipment listing, low radiation and/or interference of RF signal(s). The system shall be designed to prevent direct pickup of signals from within and outside the building structure.
- F. Weather/Water Proof Equipment: Listed and labeled by an OSHA certified NRTL (i.e. UL) for duty outdoors or in damp locations.

2.1 SYSTEM DESCRIPTION

- A. Furnish and install a complete and fully functional and operable Nurse Call and/or Code Blue System.
- B. The Contractor is responsible for interfacing the MATV and Patient Bed Service Walls with the System. Coordinate pillow speaker interface with MATV contractor.
- C. The Contractor shall continually employ interfacing methods that are approved by the OEM and VA. At a minimum, an acceptable interfacing method requires not only a physical and mechanical connection, but also a matching of signal, voltage, and processing levels with regard to signal quality and impedance. The interface point must adhere to all standards described herein for the full separation of Critical Care and Life Safety systems.
- D. The System Contractor shall connect the System ensuring that all NFPA and UL Critical Care and Life Safety Circuit and System separation guidelines are satisfied. The System Contractor is not allowed to make any connections to the Telephone System.
- E. System hardware shall consist of a *standalone (separate)* nurse call and Code Blue patient communications network comprised of nurse consoles, control stations, staff and duty stations,

room and corridor dome lights, pillow speakers, call cords, pull cord and/or emergency push button stations, wiring. And, other options such as, pocket page interfaces, computer interfaces, printer interfaces, and wireless/telephone network interfaces. All necessary equipment required to meet the intent of these specifications, whether or not enumerated within these specifications, shall be supplied and installed to provide a complete and operating nurse call Code Blue // patient communications network. *It is not acceptable to utilize the telephone cable system for the control and distribution of nurse call (code Blue) signals and equipment.*

- F. System firmware shall be the product of a reputable firmware OEM of record with a proven history of product reliability and sole control over all source code. Manufacturer shall provide, free of charge, product firmware/software upgrades for a period of two (2) years from date of acceptance by VA for any product feature enhancements. System configuration programming changes shall not require any exchange of parts and shall be capable of being executed remotely via a modem connection (when specifically approved first by TVE 005OP3B).
- G. The Nurse Call Head End Equipment shall be located in Telecommunications Room 0500A. The Nurse Call (code Blue) System may interface the PA system when specifically approved by VA Headquarters T VE 005OP3B during the project approval process prior to contract bidding.
- H. The System shall utilize microprocessor components for all signaling and programming circuits and functions. Self contained or on board system program memory shall be non-volatile and protected from erasure from power outages for a minimum of 12 hours.
- I. Provide a backup battery or a UPS for the System (including each distribution cabinet/point, CRT and Monitor) to allow normal operation and function (as if there was no AC power failure) in the event of an AC power failure or during input power fluctuations for a minimum of 30 minutes.
- J. The System is defined as Critical Service and the Code Blue functions is defined as Life Safety/Support by NFPA (re Part 1.1.A) and so evaluated by JCAHCO. Therefore, the system shall have a minimum of two (2) additional remote enunciation points in order to satisfy NFPA's Life Safety Code 101.
 - 1. These two (2) additional remote locations shall be fully manned:
 - a. 24/7/365 for certified Hospital.
 - b. As long as other identified VA Medical / Servicing Facilities are open for servicing patients.
 - c. At a minimum, Code Blue Functions shall be provided in all Recovery (Medical and Surgical) Rooms, Intensive Care Units (ICU), Cardiac Care Units (CCU), Step Down Room, Life Support, Monitoring Rooms, Oncology, and Radiology Procedure Rooms.
 - d. The minimum remote enunciation locations shall be:

- 1) The Telephone / PBX Operator Room.
 - 2) The Police Control / Operations Room.
 - 3) Other location(s) that is specifically approved by VA Headquarters TVE - 005OP3B
DURING THE PROJECT DEVELOPMENT STAGES AND PRIOR TO
EQUIPMENT PURCHASE.
2. In addition to the two (2) remote locations afore described, the following locations are the minimum required for additional Nurse Call /Code Blue Annunciation:
 - a. "On Call" Rooms.
 - b. Each Nurse Master Station.
 - c. Each Staff Station.
 - d. Each Duty Station.
 3. The MAXIMUM enunciation time period from placement of the Code Blue Call to enunciation at each remote locations is 10 seconds; and, 15 seconds to the subsequent enunciating media stations (i.e. PA, Radio Paging, Emergency Telephone or Radio Backup, etc.).
- K. Each Code Blue System shall be designed to provide continuous electrical supervision of the complete and entire system (i.e. dome light bulbs [each light will be considered supervised if they use any one or a combination of (UL) approved electrical supervision alternates, as identified in UL-1069, 1992 revision], wires, contact switch connections, circuit boards, data, audio, and communication busses, main and UPS power, etc.). All alarm initiating and signaling circuits shall be supervised for open circuits, short circuits, and system grounds. Main and UPS power circuits shall be supervised for a change in state (i.e. primary to backup, low battery, UPS on line, etc.). When an open, short or ground occurs in any system circuit, an audible and visual fault alarm signal shall be initiated at the nurse control station and all remote locations.
- L. When the System is approved to connect to a separate communications system (i.e. LAN, WAN, Telephone, Public Address, radio raging, wireless systems, etc) the connection point shall meet the following minimum requirements for each hard wired / wireless connection (note each wireless system connection MUST BE APPROVED PRIOR TO CONTRACT BID BY VA HEADQUARTERS TVE - 005OP3B AND SPECTRUM MANAGEMENT - 005OP2B – hereinafter referred to as SM - 005OP2B):
1. UL 60950-1/2.
 2. FIPS 142.
 3. FCC Part 15 Listed Radio Equipment restriction compliance approved by SM – 005OP2B.

- M. All passive distribution equipment shall meet or exceed -80 dB radiation shielding (aka RFI) shielding specifications and be provided with connectors specified by the OEM.
- N. All equipment face plates utilized in the system shall be stainless steel, anodized aluminum or UL approved cyclac plastic for the areas where provided.
- O. Noise filters and surge protectors shall be provided for each equipment interface cabinet, headend cabinet, control console and local and remote amplifier locations to insure protection from input primary AC power surges and to insure noise glitches are not induced into low voltage data circuits.
- P. Plug-in connectors shall be provided to connect all equipment, except coaxial cables. Coaxial cable distribution points shall use coaxial cable connections recommended by the cable OEM and approved by the system OEM. Base band cable systems shall utilize barrier terminal screw type connectors, at a minimum. As an alternate, crimp type connectors installed with a ratchet type installation tool are acceptable provided the cable dress, pairs, shielding, grounding, connections and labeling are the same as the barrier terminal strip connectors. Tape of any type, wire nuts or solder type connections are unacceptable and will not be approved.
- R. Audio Level Processing: The control equipment shall consist of audio mixer(s), volume limiter(s) and/or compressor(s), and power amplifier(s) to process, adjust, equalize, isolate, filter, and amplify each audio channel for each sub-zone in the system and distribute them into the System's RF interfacing distribution trunks and amplification circuits. It is acceptable to use identified Telephone System cable pairs designated for Two-Way Radio interface and control use or identified as spare telephone cable pairs by the Facility's Telephone System Contractor. The use of telephone cable to distribute RF signals, carrying system or sub-system AC or DC voltage is not acceptable and will not be approved. Additionally, each control location shall be provided with the equipment required to insure the system can produce its designed audio channel capacity at each speaker identified on the contract drawings. The Contractor shall provide: a spare set of telephone paging modules as recommended by the OEM (as a minimum provide one spare module for each installed module); one spare audio power amplifier, one spare audio mixer, one spare audio volume limiter and/or compressor, and one spare audio automatic gain adjusting device, and minimum RF equipment recommended by the OEM.
- S. Contractor is responsible for pricing all accessories and miscellaneous equipment required to form a complete and operating system. Unless otherwise noted in this Part, equipment quantities shall be as indicated on the drawings.
- R. System Performance:

1. At a minimum, each distribution, interconnection, interface, terminating point and TCO shall be capable of supporting the Facility's Nurse Call and/or Code Blue System voice and data service as follows:
 - a. Shall be compliant with and not degrade the operating parameters of the Public Switched Telephone Network (PSTN) and the Federal Telecommunications System (FTS) at each PSTN and FTS interface (if attachment is permitted by TVE 005OP3B), interconnection and TCO terminating locations detailed on the contract drawings.
 - b. The System shall provide the following minimum operational functions:
 - 1) Code Blue calls shall be cancelable at the calling station only. The nurse call master station (s) that a managing Code Blue functions shall not have the ability to cancel Code Blue calls.
 - 2) Each Code Blue system shall be able to receive audio calls from all bedside stations simultaneously.
 - 3) Calls placed from any Code Blue station shall generate Code Blue emergency type audible and visual signals at each associated nurse control and duty station, respective dome lights and all local and remote annunciator panels. Calls placed from a bedside station shall generate emergency type visual signals at the bedside station and associated dome light(s) in addition to the previous stated stations and panels.
 - 4) Activating the silencing device at any location, while a Code Blue call or system fault is occurring shall mute the audible signals at the alarm location.
 - a) The audible alarm shall regenerate at the end of the selected time-out period until the call or fault is corrected.
 - b) The visual signals shall continue until the call is canceled and/or a fault is corrected. When the fault is corrected, all signals generated by the fault shall automatically cease, returning the System to a standby status.
 - c) Audible signals shall be regenerated in any local or remote annunciator panel that is in the silence mode, in the event an additional Code Blue call is placed in any Code Blue system.
 - d) The additional Code Blue call shall also generate visual signals at all annunciators to identify the location of the call.
2. Each System Nurse Call location shall generate a minimum of distinct calls:
 - a. Routine: single flashing dome lights & master station color and audio tone,
 - b. Staff Assist: rapid flashing dome lights & master station color and audio tone,

- c. Emergency: Red flashing dome lights & master station color and audio tone,
- d. Code Blue (if equipped): Blue flashing dome lights and master station color and audio tone,
- e. Each generated call shall be cancelable at ONLY the originating location,
- f. Staff Locator: Green Flashing dome lights & master station color and audio tone, and

2.3 MANUFACTURERS

- A. The products specified shall be new, FCC and UL Listed, labeled and produced by OEM manufacturer of record. An OEM of record shall be defined as a company whose main occupation is the manufacture for sale of the items of equipment supplied and which:
 - 1. Maintains a stock of replacement parts for the item submitted,
 - 2. Maintains engineering drawings, specifications, and operating manuals for the items submitted, and
 - 3. Has published and distributed descriptive literature and equipment specifications on the items of equipment submitted at least 30 days prior to the Invitation for Bid.
- B. Specifications contained herein as set forth in this document detail the salient operating and performance characteristics of equipment in order for VA to distinguish acceptable items of equipment from unacceptable items of equipment. When an item of equipment is offered or furnished for which there is a specification contained herein, the item of equipment offered or furnished shall meet or exceed the specification for that item of equipment.
- C. Equipment Standards and Testing:
 - 1. The System has been defined herein as connected to systems identified as Critical Service performing various Emergency and Life Support Functions. Therefore, at a minimum, the system shall conform to all aforementioned National and/or Local Life Safety Codes (which ever are the more stringent), NFPA, NEC, this specification, JCAHCO Life Safety Accreditation requirements, and the OEM recommendations, instructions, and guidelines.
 - 2. All supplies and materials shall be listed, labeled or certified by UL or a NRTL where such standards have been established for the supplies, materials or equipment.
 - 3. The provided equipment required by the System design and approved technical submittal must conform with each UL standard in effect for the equipment, as of the date of the technical submittal (or the date when the RE approved system equipment necessary to be replaced) was technically reviewed and approved by VA. Where a UL standard is in existence for equipment to be used in completion of this contract, the equipment must bear the approved UL seal.

4. Each item of electronic equipment to be provided under this contract must bear the approved UL seal or the seal of the testing laboratory that warrants the equipment has been tested in accordance with, and conforms to the specified standards. The placement of the UL Seal shall be a permanent part of the electronic equipment that is not capable of being transportable from one equipment item to another.

2.4 PRODUCTS

- A. Rauland Responder V, or approved equal.
- B. General.
 1. Contractor is responsible for pricing all accessories and miscellaneous equipment required to form a complete and operating system. The equipment quantities provided herein shall be as indicated on the drawings with the exception indicated spare equipment.
 2. Contractor Furnished Equipment List (CFEs):
 - a. The Contractor is required to provide a list of the CFE equipment to be furnished. The quantity, make and model number of each item is required.
- C. Telecommunications Room(s) (TR):
 1. Locate the Nurse Call and/or Code Blue floor distribution equipment as required by system design and OEM direction. Provide secured and lockable cabinet/rack(s) as required.
 2. Head-End Equipment:
 - a. Provide all required power supplies, communications hubs, network switches, intelligent controllers and other devices necessary to form a complete system. Head-end components may be rack mounted or wall mounted in an enclosed metal enclosure.
 - b. Provide the head end equipment in the closest Telecommunications Room where the System is installed.
 - c. Provide the System UPS inside the cabinet or in a separate cabinet adjacent to the head end cabinet that shall maintain a minimum of 30 minute battery back-up to all system components.
 - d. Equipment Cabinet: Comply with TIA/EIA-310-D. Lockable, ventilated metal cabinet houses terminal strips, power supplies, amplifiers, system volume control, and other switching and control devices required for conversation channels and control functions. See Paragraph 2.5.E for the Cabinet's minimum internal items that are in addition to the installed System equipment.
 - e. Vertical Equipment Rack, Wall Mounted (to be included inside of the Equipment Cabinet) containing the following minimum items:

- 1) 36" (28RU) internal rack space, welded steel construction, minimum 20" usable depth, adjustable front mounting rails.
- 2) Install the following products in rack provided by same manufacturer or as specified:
 - a) Security screws w/ nylon isolation bushings.
 - b) Textured blank panels.
 - c) Custom mounts for components without rack mount kits.
 - d) Security covers.
 - e) Internal system ground copper buss (may be substituted with a bare #0 AWG copper wire or equivalent size copper mesh strip connected to ONLY THE FACILITY'S SIGNAL GROUNDING SYSTEM.
 - f) Power Sequencer- rack-mounted power conditioner and (provide as-needed) delayed sequencer(s) with (2) unswitched outlets each and contact closure control inputs. Connect the conditioner to one of the dual duplex outlets.
 - g) Two (2) each 120VAC @ 20A dual duplex outlets, connected via conduit to the nearest Electrical Service Panel that is supplied by the Facility's Essential Electrical System.
 - h) One (1) each 120VAC @ 15A Power Distribution Strip(s). Connect each strip to the unswitched outlet on the power conditioner.
3. HL7 Interface:
 - a. The system shall allow for future upgrade to support downloading and updating of patient data from the hospital admission system (or other database) via the HL7 standard. The data only has to travel one way, i.e. from the admission system to the nurse-call system.
 - b. Coordinate with the Owner the exact fields that will be populated from the admissions system in the nurse-call system.
 - c. The Facility's LAN/WAN is not allowed for Nurses Call/Code Blue main wiring / function that must be a "stand alone primary cable infrastructure" as described herein.
 - d. Connections to the VA LAN/WAN for functional or operable conditions will be allowed ONLY when the LAN/WAN system has been demonstrated and NFPA (at a minimum by TVE-005OP3B) Certified meeting Life Safety Standards.
4. Wireless:
 - a. Phone Paging Equipment / Systems
 - 1) The nurse call/code blue system shall have the ability to interface with existing VA Ascom phone system and must have the following minimum system features:

- a) Ability to pass-through location information (such as a room number) and call-type as well as other text messages simultaneously to shift supervisor identified staff members
- b) System shall allow the operator to select staff members by name and pager number and to select a message consisting of a room number and a condition code (aka priority level). Operator may also choose to type in a unique alphanumeric text message (the text message shall meet or exceed all HIPA and VA OCIS Communications Security Guidelines for the transmission of Patient or Staff Specific information [aka PII] – VA Headquarters TVE - 005OP2B is the approving authority for this function) into the system to be read by the holder of the pager unit.
- c) While a patient station is connected to the nurse's master station, the system shall allow the operator to automatically page the staff member assigned to that room. An alternate staff member may be selected for paging purposes in place of the primary staff member. The System must allow an alternate staff member to be paged when the primary staff member is unable to respond to patient's needs within a specified period of time. The System must have the ability to assign any bed to any pager or pager group, and to assign an unlimited amount of pagers to any patient bed.
- d) System shall have the ability to send all code blue calls to staff members by predetermined group (as required) automatically by simply pressing one "Code Blue" button. Pager shall indicate room number of code call, and state "Code Blue" in plain English format on pagers (*FCC Part 15 listed pagers are not allowed to be use as "Safety of Life" functions or those specific locations – VA Headquarters TVE - 005OP2B is the approving authority for this requirement*).

5. Personal Wireless Communicator

- a. The System will only be allowed to connect to the personal wireless communications system, pass text data and provide a 2-way communication between the Telephone Interface and the personal wireless communicator as long as it is not a FCC Part 15 listed device(s), meets or exceeds UL 60950-1/2, meets OCIS Guide Lines for FIPS 140-2 certification and the using staff shows an extensive training program along with recertification(s) according to the Facility Emergency Plan concerning HIPA requirements.

- b. VA Headquarters TVE - 005OP3B and SM - 005OP2B are the approving authority for this requirement.
- c. When communicators are approved, provide a minimum of ten (10) spare communicators for each 10 communicators issued.

D. Interface Equipment:

1. TCR:

a. Code Blue Annunciation Station:

- 1) The Code Blue Remote Annunciation Station shall be located in the Telephone Operators Room and Police Control Center.
- 2) The Annunciation Station shall be connected to the System via hard wire connection(s) that shall contain all the electrical supervisory tone signals, visual bulbs, read out panel to indicate the location of the Code and system troubles.
- 3) The System shall not be connected to the Telephone system unless specifically APPROVED BY VA HEADQUARTERS (005OP3B) and (005OP2B) PRIOR TO CONTRACT BID.
- 4) The Annunciation Station shall be installed in a location directly viewable and the readout is completely readable from the Public Address Microphone Control Console.

b. Electrical Supervision Trouble Annunciator Panel:

- 1) The Electrical Supervision Trouble Annunciation Panel shall be located in the Telephone Operators Room, Police Control Center, and Nurses Station.
- 2) The panel(s) shall be compatible with the generated electrical and/or electronic supervising signals to continuously monitor the operating condition for the System head-end processing equipment, master stations, staff stations, patient stations, duty stations, audio power amplifier(s), UPS, power supplies, dome lights and interconnecting trunks. The panels shall generate an audible and visual signal when the System's supervising system detects a system and equipment trouble or trunk-line is malfunctioning.

2. Hospital Bed Interface (s):

- a. Provide a multi-pin receptacle for bed connection.
- b. Connect cable from the multi-pin receptacle to the nurse-call system, so that alarms, such as bed exit, shall be monitored by the nurse-call system.
- c. Connect cable from the multi-pin receptacle to the nurse-call system, so that the bedside control buttons, such as nurse call, and television controls are functional and monitored.

- d. The hospital uses the following beds:
 - 1) Herman Miller
 - 3. Lighting Interface Module:
 - a. Provide an interface module for the pillow speakers to control up to 2 lights. Coordinate with the electrical contractor the exact voltage requirements.
 - 4. Pillow Speaker Interfaces:
 - a. See functional requirements herein.
 - b. Provide pillow speaker for each patient station.
 - c. Provide one (1) spare pillow speaker for each twenty (20) speakers installed.
 - 5. TV Remote Control Interface:
 - a. The pillow speaker shall have the following TV control capability:
 - 1) Play the TV audio through the pillow speaker.
 - 2) Change channels up and down.
 - 3) Increase and decrease the volume.
 - 4) TV audio mute.
 - 5) UL Certified for direct patient contact.
 - b. Provide one (1) spare interface for each 20 interfaces installed.
 - 6. TV Control Jack and Wiring:
 - a. Provide connection from the pillow speaker to the TV location. Terminate wire on a jack in the TV low voltage faceplate. Coordinate faceplate opening with the cabling contractor. Coordinate jack type with the TV (typically it is a ¼" jack, but verify prior to installation).
 - b. Provide patch cord from the TV control jack to the TV.
 - c. Provide one (1) spare complete assembly for each twenty (20) assemblies installed.
- E. Call Initiation, Annunciation and Response:
- 1. Light and Tones:
 - a. Calls may be initiated through:
 - 1) Patient station.
 - 2) Staff station.
 - 3) Code Blue station.
 - 4) Toilet Emergency Station pull cord / push button.
 - 5) Shower Emergency Station pull cord.
 - 6) Bed Pillow speaker.
 - 7) Bed Push-button cordset.

- 8) Hospital Bed Integrated controls.
- b Once a call is initiated, it must be annunciated at the following locations:
 - 1) The Corridor, Intersectional and Room dome light associated with the initiating device.
 - 2) A local master control station indicating the call location and priority.
 - 3) Each duty station.
 - 4) Each staff station.
 - 5) Each remote location.
 - c) All calls must be displayed until they are cleared by the nursing staff **ONLY** from the initiating device location.
2. Voice:
 - a Calls may be initiated through:
 - 1) Patient station.
 - 2) Staff station.
 - 3) Code Blue station.
 - 4) Toilet Emergency pull cord / push button station.
 - 5) Shower Emergency pull cord station.
 - 6) Pillow speaker.
 - 7) Push-button cordset.
 - 8) Integrated bed controls.
 - 9) Master Station.
 - b. All calls must be displayed until they are cleared by the nursing staff **ONLY** from the initiating device location.
3. Provide two-way voice communication between a master station and patient, staff, duty and each of the two (2) remote stations.
4. Failure of voice intercom portion of system shall not interfere with visual and audible signal systems.
5. All calls must be displayed on the master station until they are cleared by the nursing staff at **ONLY** the originating station. If multiple calls are received at the master station within a short period of time, they shall be stacked based on priority and wait time. If there are more calls than the master station screen can display at one time (four [4] minimum), the system must provide a simple scrolling feature. The nurse must be able to answer any call in any order at the master station. The nurse must also be able to forward calls to staff members. If a call is not answered within a programmable time period, then the system must forward the

call to appropriate back-up staff identified by each shift supervisor in a manner technically approved by VA Headquarters 005OP3B.

F. Patient and Staff Assignment:

1. System may provide for transfer of one or more individual or groups of stations from one master station to another without mechanical switches or additional wiring of the stations. The transfer may be initiated manually by the nurse or automatically at certain times of the day.
2. The Facility's LAN/WAN IS NOT ALLOWED for Nurses Call/Code Blue main wiring which must be a "stand alone primary cable infrastructure

G. System Functional Station:

1. Master Control:

a. Simple Tone and Light:

- 1) The Visual Display Panel shall be a digital readout touch screen to visually announce the location of incoming calls placed in the System including room and bed number and priority of the call. Identify each calling station with an individual display, including separate displays for each patient sharing a dual bedside station. If a digital readout touch screen standard is not required or approved by the Facility during the project design phase, an alpha - numeric scheme shall be provided that identifies the: ward, room and bed (i.e. Ward 2a, Room 201, Bed A (or 1) shall read 2A201A -or- 2A201-1. Equivalent readouts are acceptable as long as TVE 005OP3B and the Facility approve the readout).
- a) Calls placed at emergency stations located in toilets and baths inside bedrooms shall be displayed for the bed closest to the nurse control station. Beds in multi-bed bedrooms shall be identified in a clock-wise pattern upon entering the bedroom.
- b) It shall display a minimum of four incoming calls. Additional placed calls shall be stored in order of placement and priority.
- 2) The visual / aural (tone only) system shall be installed according to the same Procedures, guidelines and standards outlined for a regular Nurse Call System for emergency NOT CODE BLUE OPERATION.
- 3) Speakerphone and handset communication.

b. Touch Screen:

- 1) Provide a touch screen master station with 15" minimum monitor size.
- 2) Speakerphone and handset communication.

2. Staff:
 - a. Light and Tone Only.
 - b. Voice Communications Enabled.
3. Duty:
 - a. Light and Tone Only.
 - b. Voice Communications Enabled.
4. Patient:
 - a. Single & Dual:
 - 1) Provide each patient station with the following minimum Feature.
 - a) Call button.
 - b) Call answered button.
 - c) Pillow speaker jack.
 - d) Auxiliary alarm monitoring jack.
 - e) Hospital bed interface jack (when specially approved by TVE - 005OP3B).
 - f) Provide one (1) spare station for each twenty (20) stations installed.

H. Distribution System:

1. The contractor shall provide the following cables & interconnections:
 - a. Each wire and cable used in the System shall be specifically OEM certified by tags on each reel and recommended and approved for installation in the Facility.
 - b. The Contractor shall provide the RE a 610 mm (2 foot) sample of each wire and/or cable actually employed in the System and each certification tag for approval before continuing with the installation as described herein.
 - c. Line Level Audio and Microphone Cable:
 - 1) Line level audio and microphone cable for inside racks and conduit.
 - 2) Shielded, twisted pair Minimum 22AWG, stranded conductors and 24AWG drain wire with overall jacket.
 - d. Speaker Level Audio (70.7Volt RMS):
 - 1) For use with 70.7V speaker circuits.
 - 2) 18AWG stranded pair, minimum.
 - e. All cabling shall be plenum rated.
2. Raceways, Back Boxes and conduit:
 - a. Each raceway that is open top, shall be: UL certified for telecommunications systems, partitioned with metal partitions in order to comply with NEC Parts 517 & 800 to

“mechanically separate telecommunications systems of different service, protect the installed cables from falling out when vertically mounted and allow junction boxes to be attached to the side to interface “drop” type conduit cable feeds.

- b. Intercommunication System cable infrastructure: EMT or in J-hooks above accessible ceilings, 24 inches on center.
 - c. Junction boxes shall be not less than 2-1/2 inches deep and 6 inches wide by 6 inches long.
 - d. Flexible metal conduit is prohibited unless specifically approved by 005OP3B.
 - e. System Conduit:
 - 1) The PA system is NFPA listed as Emergency / Public Safety Communication System which requires the entire system to be installed in a separate conduit system.
 - 2) Conduit Sleeves:
 - a) The contractor is responsible for coordinating conduit sleeves and fire-proofing where necessary.
 - f. Device Back Boxes:
 - 1) Furnish to the electrical contractor all back boxes required for the PA system devices.
 - 2) The electrical contractor shall install the back boxes as well as the system conduit. Coordinate the delivery of the back boxes with the construction schedule.
3. UPS:
- a. Provide a backup battery or a UPS for the System to allow normal operation and function (as if there was no AC power failure) in the event of an AC power failure or during input power fluctuations for a minimum of 30 minutes.
 - b. The Nurse Call Contractor shall not make any attachments or connection to the telephone system until specifically directed to do so, in writing, by the RE.
 - c. Provide UPS for all active system components including but not limited to:
 - 1) System Amplifiers.
 - 2) Microphone Consoles.
 - 3) Telephone Interface Units.
 - 4) TER, TR & Headend Equipment Rack(s).
- I. Patient Bedside Prefabricated Units (PBPU):
- 1. Where PBPU's exist in the Facility; the Contractor shall identify the “gang box” location on the PBPU designated for installation of the telephone jack. This location shall here-in-after be identified as the unit's TCO. The Contractor shall be responsible for obtaining written approval and specific instructions from the PBPU OEM regarding the necessary disassembly

- and reassembly of each PBPU to the extent necessary to pull wire from above the TIP ceiling junction box to the PBPU's reserved gang box for the unit's TCO. A Contractor provided stainless steel cover plate approved for use by the PBPU OEM and Facility IRM Chief shall finish out the jack installation.
2. Under no circumstances shall the Contractor proceed with the PBPU installations without the written approval of the PBPU OEM and the specific instructions regarding the attachment to or modifying of the PBPU. The RE shall be available to assist the Contractor in obtaining approvals and instructions in a timely manner as related to the project's time constraints.
 3. It is the responsibility of the Contractor to maintain the UL integrity of each PBPU. If the Contractor violates that integrity, it shall be the responsibility of the Contractor to obtain on site UL re-certification of the violated PBPU at the direction of the RE and at the Contractor's expense.

J. Installation Kit:

1. General: The kit shall be provided that, at a minimum, includes all connectors and terminals, labeling systems, audio spade lugs, barrier strips, punch blocks or wire wrap terminals, heat shrink tubing, cable ties, solder, hangers, clamps, bolts, conduit, cable duct, and/or cable tray, etc., required to accomplish a neat and secure installation. All wires shall terminate in a spade lug and barrier strip, wire wrap terminal or punch block. Unfinished or unlabeled wire connections shall not be allowed. Turn over to the RE all unused and partially opened installation kit boxes, coaxial, fiberoptic, and twisted pair cable reels, conduit, cable tray, and/or cable duct bundles, wire rolls, physical installation hardware. The following are the minimum required installation sub-kits:
 2. System Grounding:
 - a. The grounding kit shall include all cable and installation hardware required. All radio equipment shall be connected to earth ground via internal building wiring, according to the NEC.
 - b. This includes, but is not limited to:
 - 1) Fiberoptic Optic Cable Armor/External Braid
 - 2) Coaxial Cable Shields.
 - 3) Control Cable Shields.
 - 4) Data Cable Shields.
 - 5) Equipment Racks.
 - 6) Equipment Cabinets.
 - 7) Conduits.

- 8) Cable Duct.
 - 9) Cable Trays.
 - 10) Interduct
 - 11) Power Panels.
 - 12) Connector Panels.
 - 15) Grounding Blocks.
3. Fiber optic Cable: The fiber optic cable kit shall include all fiber optic connectors, cable tying straps, interduct, heat shrink tubing, hangers, clamps, etc. required to accomplish a neat and secure installation.
 4. Coaxial Cable: The coaxial cable kit shall include all coaxial connectors, cable tying straps, heat shrink tubing, hangers, clamps, etc., required to accomplish a neat and secure installation.
 5. Wire and Cable: The wire and cable kit shall include all connectors and terminals, audio spade lugs, barrier straps, punch blocks, wire wrap strips, heat shrink tubing, tie wraps, solder, hangers, clamps, labels etc., required to accomplish a neat and orderly installation.
 6. Conduit, Cable Duct, and Cable Tray: The kit shall include all conduit, duct, trays, junction boxes, back boxes, cover plates, feed through nipples, hangers, clamps, other hardware required to accomplish a neat and secure conduit, cable duct, and/or cable tray installation in accordance with the NEC and this document.
 7. Equipment Interface: The equipment kit shall include any item or quantity of equipment, cable, mounting hardware and materials needed to interface the systems with the identified sub-system(s) according to the OEM requirements and this document.
 8. Labels: The labeling kit shall include any item or quantity of labels, tools, stencils, and materials needed to completely and correctly label each subsystem according to the OEM requirements, as-installed drawings, and this document.
 9. Documentation: The documentation kit shall include any item or quantity of items, computer discs, as installed drawings, equipment, maintenance, and operation manuals, and OEM materials needed to completely and correctly provide the system documentation as required by this document and explained herein.

PART 3 - EXECUTION

3.1 PROJECT MANAGEMENT

- A. Assign a single project manager to this project who will serve as the point of contact for the Owner, the General Contractor, and the Engineer.

- B. The Contractor shall be proactive in scheduling work at the hospital, specifically the Contractor will initiate and maintain discussion with the general contractor regarding the schedule for ceiling cover up and install cables to meet that schedule.
- C. Contact the Office of Telecommunications, Special Communications Team (005OP2B) at (301) 734-0350 to have a VA Certified Telecommunications COTR assigned to the project for telecommunications review, equipment and system approval and co-ordination with VA's Spectrum Management and OCIS Teams.

3.2 COORDINATION WITH OTHER TRADES

- A. Coordinate with the cabling contractor the location of the TV faceplate and the faceplate opening for the nurse call TV control jack.
- B. Before beginning work, verify the location, quantity, size and access for the following:
 - 1. Isolated ground AC power circuits provided for systems.
 - 2. Primary, emergency and extra auxiliary AC power generator requirements.
 - 3. Junction boxes, wall boxes, wire troughs, conduit stubs and other related infrastructure for the systems.
 - 4. System components installed by others.
 - 5. Overhead supports and rigging hardware installed by others.
- C. Immediately notify the Owner, GC and Consultant(s) in writing of any discrepancies.

3.3 NEEDS ASSESSMENT

Provide a one-on-one meeting with the particular nursing manager of each unit affected by the installation of the new nurse call/code blue system. Review the floor plan drawing, educate the nursing manager with the functions of the equipment that is being provided and gather details specific to the individual units; coverage and priorities of calls; staffing patterns; and other pertinent details that will affect system programming and training.

3.4 INSTALLATION

- A. General:
 - 1. Execute work in accordance with National, State and local codes, regulations and ordinances.
 - 2. Install work neatly, plumb and square and in a manner consistent with standard industry practice. Carefully protect work from dust, paint and moisture as dictated by site conditions. The Contractor will be fully responsible for protection of his work during the construction phase up until final acceptance by the Owner.
 - 3. Install equipment according to OEM's recommendations. Provide any hardware, adaptors, brackets, rack mount kits or other accessories recommended by OEM for correct assembly and installation.

4. Secure equipment firmly in place, including receptacles, speakers, equipment racks, system cables, etc.
 - a. All supports, mounts, fasteners, attachments and attachment points shall support their loads with a safety factor of at least 5:1.
 - b. Do not impose the weight of equipment or fixtures on supports provided for other trades or systems.
 - c. Any suspended equipment or associated hardware must be certified by the OEM for overhead suspension.
 - d. The Contractor is responsible for means and methods in the design, fabrication, installation and certification of any supports, mounts, fasteners and attachments.
5. Finishes for any exposed work such as plates, racks, panels, speakers, etc. shall be approved by the Architect, Owner and TVE 005OP3B.
6. Coordinate cover plates with field conditions. Size and install cover plates as necessary to hide joints between back boxes and surrounding wall. Where cover plates are not fitted with connectors, provide grommeted holes in size and quantity required. Do not allow cable to leave or enter boxes without cover plates installed.
7. Active electronic component equipment shall consist of solid state components, be rated for continuous duty service, comply with the requirements of FCC standards for telephone and data equipment, systems, and service.
8. Color code all distribution wiring to conform to the Nurse Call Industry Standard, EIA/TIA, and this document, whichever is the more stringent. At a minimum, all equipment, cable duct and/or conduit, enclosures, wiring, terminals, and cables shall be clearly and permanently labeled according to and using the provided record drawings, to facilitate installation and maintenance.
9. Connect the System's primary input AC power to the Facility's Critical Branch of the Emergency AC power distribution system as shown on the plans or if not shown on the plans consult with RE regarding a suitable circuit location prior to bidding.
10. Product Delivery, Storage and Handling:
 - a. Delivery: Deliver materials to the job site in OEM's original unopened containers, clearly labeled with the OEM's name and equipment catalog numbers, model and serial identification numbers. The RE may inventory the cable, patch panels, and related equipment.
 - b. Storage and Handling: Store and protect equipment in a manner, which will preclude damage as directed by the RE.

11. Where TCOs are installed adjacent to each other, install one outlet for each instrument.
12. Equipment installed outdoors shall be weatherproof or installed in weatherproof enclosures with hinged doors and locks with two keys.

B. Equipment Racks/Cabinets:

1. Fill unused equipment mounting spaces with blank panels or vent panels. Match color to equipment racks/cabinets.
2. Provide security covers for all devices not requiring routine operator control.
3. Provide vent panels and cooling fans as required for the operation of equipment within the OEM' specified temperature limits. Provide adequate ventilation space between equipment for cooling. Follow manufacturer's recommendations regarding ventilation space between amplifiers.
4. Provide insulated connections of the electrical raceway to equipment racks.
5. Provide continuous raceway/conduit with no more than 40% fill between wire troughs and equipment racks/cabinets for all non-plenum-rated cable. Ensure each system is mechanically separated from each other in the wireway.
6. Ensure a minimum of 36 inches around each cabinet and/or rack to comply with OSHA Safety Standards. Cabinets and/or Racks installed side by side – the 36" rule applies to around the entire assembly

C. Distribution Frames.

1. A new stand-alone (i.e., self supporting, free standing) PA rack/frame may be provided in each TR to interconnect the TCR, PCR, SCC, NS, STRs & ECRs. Rack/frames shall be wired in accordance with industry standards and shall employ "latest state-of-the-art" modular cross-connect devices. The PA riser cable shall be sized to satisfy all voice/digital requirements plus not less than 50% spare (growth) capacity in each TR which includes a fiber optic backbone.
2. The frames/racks shall be connected to the TER/MCR system ground.

D. Wiring Practice

1. Where raceway is to be EMT (conduit), wiring of differing classifications shall be run in separate conduit. Where raceway is to be an enclosure (rack, tray, wire trough, utility box) wiring of differing classifications which share the same enclosure shall be mechanically partitioned and separated by at least four (4) inches. Where Wiring of differing classifications must cross, they shall cross perpendicular to one another.
2. Do not splice wiring anywhere along the entire length of the run. Make sure cables are fully insulated and shielded from each other and from the raceway for the entire length of the run.

3. Do not pull wire through any enclosure where a change of raceway alignment or direction occurs. Do not bend wires to less than radius recommended by manufacturer.
4. Replace the entire length of the run of any wire or cable that is damaged or abraided during installation. There are no acceptable methods of repairing damaged or abraided wiring.
5. Use wire pulling lubricants and pulling tensions as recommended by the OEM.
6. Use grommets around cut-outs and knock-outs where conduit or chase nipples are not installed.
7. Do not use tape-based or glue-based cable anchors.
8. Ground shields and drain wires to the Facility's signal ground system as indicated by the drawings.
9. Field wiring entering equipment racks shall be terminated as follows:
 - a. Provide OEM directed service loops at harness break-outs and at plates, panels and equipment. Loops should be sufficient to allow plates, panels and equipment to be removed for service and inspection.
 - b. Line level and speaker level wiring may be terminated inside the equipment rack using specified terminal blocks (see "Products.") Provide 15% spare terminals inside each rack. Microphone level wiring may only be terminated at the equipment served.
 - c. If specified terminal blocks are not designed for rack mounting, utilize ¾" plywood or 1/8" thick aluminum plates/blank panels as a mounting surface. Do not mount on the bottom of the rack.
 - d. Employ permanent strain relief for any cable with an outside diameter of 1" or greater.
10. Use only balanced audio circuits unless noted otherwise directed and indicated on the drawings.
11. Make all connections as follows:
 - a. Make all connections using rosin-core solder or mechanical connectors appropriate to the application.
 - b. For crimp-type connections, use only tools that are specified by the manufacturer for the application.
 - c. Use only insulated spade lugs on screw terminals. Spade lugs shall be sized to fit the wire gauge. Do not exceed two lugs per terminal.
 - d. Wire nuts, electrical tape or "Scotch Lock" connections are not acceptable for any application.
12. Noise filters and surge protectors shall be provided for each equipment interface cabinet, switch equipment cabinet, control console, local, and remote active equipment locations to

ensure protection from input primary AC power surges and noise glitches are not induced into low Voltage data circuits.

13. Wires or cables previously approved to be installed outside of conduit, cable trays, wireways, cable duct, etc:
 - a Only when specifically authorized as described herein, will wires or cables be identified and approved to be installed outside of conduit. The wire or cable runs shall be UL rated plenum and OEM certified for use in air plenums.
 - b Wires and cables shall be hidden, protected, fastened and tied at 600 mm (24 in.) intervals, maximum, as described herein to building structure.
 - c Closer wire or cable fastening intervals may be required to prevents sagging, maintain clearance above suspended ceilings, remove unsightly wiring and cabling from view and discourage tampering and vandalism. Wire or cable runs, not provided in conduit, that penetrate outside building walls, supporting walls, and two hour fire barriers shall be sleeved and sealed with an approved fire retardant sealant.
 - d Wire or cable runs to system components installed in walls (i.e.: volume attenuators, circuit controllers, signal, or data outlets, etc.) may, when specifically authorized by the RE, be fished through hollow spaces in walls and shall be certified for use in air plenum areas.
 - e Completely test all of the cables after installation and replace any defective cables.
 - f Wires or cables that are installed outside of buildings shall be in conduit, secured to solid building structures. If specifically approved, on a case by case basis, to be run outside of conduit, the wires or cables shall be installed, as described herein. The bundled wires or cables must: Be tied at not less than 460 mm (18 in.) intervals to a solid building structure; have ultra violet protection and be totally waterproof (including all connections). The laying of wires or cables directly on roof tops, ladders, drooping down walls, walkways, floors, etc. is not allowed and will not be approved.

E. Cable Installation

1. Support cable on maximum 2'-0" centers. Acceptable means of cable support are cable tray, j-hooks, and bridal rings. Velcro wrap cable bundles loosely to the means of support with plenum rated Velcro straps. Plastic tie wraps are not acceptable as a means to bundle cables.
2. Run cables parallel to walls.
3. Install maximum of 10 cables in a single row of J-hooks. Provide necessary rows of J-hooks as required by the number of cables.

4. Do not lay cables on top of light fixtures, ceiling tiles, mechanical equipment, or ductwork. Maintain at least 2'-0" clearance from all shielded electrical apparatus.
5. All cables shall be tested after the total installation is fully complete. All test results are to be documented. All cables shall pass acceptable test requirements and levels. Contractor shall remedy any cabling problems or defects in order to pass or comply with testing. This includes the re-pull of new cable as required at no additional cost to the Owner.
6. Ends of cables shall be properly terminated on both ends per industry and OEM's recommendations.
7. Provide proper temporary protection of cable after pulling is complete before final dressing and terminations are complete. Do not leave cable lying on floor. Bundle and tie wrap up off of the floor until you are ready to terminate.
8. Terminate all conductors; no cable shall contain unterminated elements. Make terminations only at outlets and terminals.
9. Splices, Taps, and Terminations: Arrange on numbered terminal strips in junction, pull, and outlet boxes; terminal cabinets; and equipment enclosures. Cables may not be spliced.
10. Bundle, lace, and train conductors to terminal points without exceeding OEM's limitations on bending radii. Install lacing bars and distribution spools.
11. Cold-Weather Installation: Bring cable to room temperature before dereeling. Heat lamps shall not be used.
12. Cable shall not be run through structural members or be in contact with pipes, ducts, or other potentially damaging items.
13. Separation of Wires: (REFER TO RACEWAY INSTALLATION) Separate speaker-microphone, line-level, speaker-level, and power wiring runs. Install in separate raceways or, where exposed or in same enclosure, separate conductors at least 12 inches apart for speaker microphones and adjacent parallel power and telephone wiring. Separate other intercommunication equipment conductors as recommended by equipment manufacturer.
14. Serve all cables as follows:
 - a. Cover the end of the overall jacket with a 1" (minimum) length of transparent heat-shrink tubing. Cut unused insulated conductors 2" (minimum) past the heat-shrink, fold back over jacket and secure with cable-tie. Cut unused shield/drain wires 2" (minimum) past the Heatshrink and serve as indicated below.
 - b. Cover shield/drain wires with heat-shrink tubing extending back to the overall jacket. Extend tubing ¼" past the end of unused wires, fold back over jacket and secure with cable tie.

- c. For each solder-type connection, cover the bare wire and solder connection with heat-shrink tubing.
- F. Labeling: Provide labeling in accordance with ANSI/EIA/TIA-606-A. All lettering for Nurse Call and/or Code Blue circuits shall be stenciled using laser printers.
 - 1. Cable and Wires (Hereinafter referred to as “Cable”): Cables shall be labeled at both ends in accordance with ANSI/EIA/TIA-606-A. Labels shall be permanent in contrasting colors. Cables shall be identified according to the System “Record Wiring Diagrams.”
 - 2. Equipment: System equipment shall be permanently labeled with contrasting plastic laminate or Bakelite material. System equipment shall be labeled on the face of the unit corresponding to its source.
 - a. Clearly, consistently, logically and permanently mark switches, connectors, jacks, relays, receptacles and electronic and other equipment.
 - b. Engrave and paint fill all receptacle panels using 1/8” (minimum) high lettering and contrasting paint.
 - c. For rack-mounted equipment, use engraved Lamacoid labels with white 1/8” (minimum) high lettering on black background. Label the front and back of all rack-mounted equipment.
 - 3. Conduit, Cable Duct, and/or Cable Tray: The Contractor shall label all conduit, duct and tray, including utilized GFE, with permanent marking devices or spray painted stenciling a minimum of 3 meters (10 ft.) identifying it as the System. In addition, each enclosure shall be labeled according to this standard.
 - 4. Termination Hardware: The Contractor shall label TCOs and patch panel connections using color coded labels with identifiers in accordance with ANSI/EIA/TIA-606-A and the “Record Wiring Diagrams.”
 - 5. Where multiple pieces of equipment reside in the same rack group, clearly and logically label each indicating to which room, channel, receptacle location, etc. they correspond.
 - 6. Permanently label cables at each end, including intra-rack connections. Labels shall be covered by the same, transparent heat-shrink tubing covering the end of the overall jacket. Alternatively, computer generated labels of the type which include a clear protective wrap may be used.
 - 7. Contractor’s name shall appear no more than once on each continuous set of racks. The Contractor’s name shall not appear on wall plates or portable equipment.
 - 8. Ensure each OEM supplied item of equipment has appropriate UL Labels / Marks for the service the equipment is performed permanently attached / marked to a non-removal board in

the unit. EQUIPMENT INSTALLED NOT BEARING THESE UL MARKS WILL NOT BE ALLOWED TO BE A PART OF THE SYSTEM. THE CONTRACTOR SHALL BEAR ALL COSTS REQUIRED TO PROVIDE REPLACEMENT EQUIPMENT WITH APPROVED UL MARKS.

G. Conduit and Signal Ducts: When the Contractor and/or OEM determines additional system conduits and/or signal ducts are required in order to meet the system minimum performance standards outlined herein, the contractor shall provide these items as follows:

1. Conduit:

- a. The Contractor shall employ the latest installation practices and materials. The Contractor shall provide conduit, junction boxes, connectors, sleeves, weather heads, pitch pockets, and associated sealing materials not specifically identified in this document as GFE. Conduit penetrations of walls, ceilings, floors, interstitial space, fire barriers, etc., shall be sleeved and sealed.
- b. All cables shall be installed in separate conduit and/or signal ducts (exception from the separate conduit requirement to allow Nurse Call and/or Code Blue cables to be installed in partitioned cable tray with voice cables may be granted in writing by the RE if requested). Conduits shall be provided in accordance with Section 27 05 33, RACEWAYS AND BOXES FOR COMMUNICATIONS SYSTEMS, and NEC Articles 517 for Critical Care and 800 for Communications systems, at a minimum.
- c. When metal, plastic covered, etc., flexible cable protective armor or systems are specifically authorized to be provided for use in the System, their installation guidelines and standards shall be as specified herein, Section 27 05 33, RACEWAYS AND BOXES FOR COMMUNICATIONS SYSTEMS, and the NEC.
- d. When "interduct" flexible cable protective systems is specifically authorized to be provided for use in the System, it's installation guidelines and standards shall be as the specified herein, Section 27 05 33, RACEWAYS AND BOXES FOR COMMUNICATIONS SYSTEMS, and the NEC.
- e. Conduit fill (including GFE approved to be used in the system) shall not exceed 40%. Each conduit end shall be equipped with a protective insulator or sleeve to cover the conduit end, connection nut or clamp, to protect the wire or cable during installation and remaining in the conduit. Electrical power conduit shall be installed in accordance with the NEC. AC power conduit shall be run separate from signal conduit.
- f. Ensure that Critical Care Nurse Call and Code Blue Systems (as identified by NEC Section 517) are completely separated and protected from all other systems.

2. Signal Duct, Cable Duct, or Cable Tray:

- a. The Contractor shall use GFE signal duct, cable duct, and/or cable tray, when identified and approved by the RE.
- b. Approved signal and/or cable duct shall be a minimum size of 100 mm x 100 mm (4 in. X 4 in.) inside diameter with removable tops or sides, as appropriate. Protective sleeves, guides or barriers are required on all sharp corners, openings, anchors, bolts or screw ends, junction, interface and connection points.
- c. Approved cable tray shall be fully covered, mechanically and physically partitioned for multiple electronic circuit use, and be UL certified and labeled for use with telecommunication circuits and/or systems. The RE shall approve width and height dimensions.
- d. All cable junctions and taps shall be accessible. Provide an 8" X 8" X 4" (minimum) junction box attached to the cable duct or raceway for installation of distribution system passive equipment. Ensure all equipment and tap junctions are accessible

3.5 PROTECTION OF NETWORK DEVICES

- A. Contractor shall protect network devices during unpacking and installation by wearing manufacturer approved electrostatic discharge (ESD) wrist straps tied to chassis ground. The wrist strap shall meet OSHA requirements for prevention of electrical shock, should technician come in contact with high voltage.

3.6 CUTTING, CLEANING AND PATCHING

- A. It shall be the responsibility of the contractor to keep their work area clear of debris and clean area daily at completion of work.
- B. It shall be the responsibility of the contractor to patch and paint any wall or surface that has been disturbed by the execution of this work.
- C. The Contractor shall be responsible for providing any additional cutting, drilling, fitting or patching required that is not indicated as provided by others to complete the Work or to make its parts fit together properly.
- D. The Contractor shall not damage or endanger a portion of the Work or fully or partially completed construction of the Owner or separate contractors by cutting, patching or otherwise altering such construction, or by excavation. The Contractor shall not cut or otherwise alter such construction by the Owner or a separate contractor except with written consent of the Owner and of such separate contractor; such consent shall not be unreasonably withheld. The Contractor shall not unreasonably withhold from the Owner or a separate Contractor the Contractor's consent to cutting or otherwise altering the Work.

- E. Where coring of existing (previously installed) concrete is specified or required, including coring indicated under unit prices, the location of such coring shall be clearly identified in the field and the location shall be approved by the Project Manager prior to commencement of coring work.

3.7 FIREPROOFING

- A. Where Nurse Call and/or Code Blue wires, cables and conduit penetrate fire rated walls, floors and ceilings, fireproof the opening.
- B. Provide conduit sleeves (if not already provided by electrical contractor) for cables that penetrate fire rated walls and Telecommunications Rooms floors and ceilings. After the cabling installation is complete, install fire proofing material in and around all conduit sleeves and openings. Install fire proofing material thoroughly and neatly. Seal all floor and ceiling penetrations.
- C. Use only materials and methods that preserve the integrity of the fire stopping system and its rating.
- D. Install fireproofing where low voltage cables are installed in the same manholes with high voltage cables; also cover the low voltage cables with arc proof and fireproof tape.
- E. Use approved fireproofing tape of the same type as used for the high voltage cables, and apply the tape in a single layer, one-half lapped or as recommended by the manufacturer. Install the tape with the coated side towards the cable and extend it not less than 25 mm (one inch) into each duct.
- F. Secure the tape in place by a random wrap of glass cloth tape.

3.8 GROUNDING

- A. Ground Nurse Call and/or Code Blue cable shields and equipment to eliminate shock hazard and to minimize ground loops, commonmode returns, noise pickup, cross talk, and other impairments as specified in CFM Division 27, Section 27 05 26 – Grounding and Bonding for Communications Systems.
- B. Facility Signal Ground Terminal: Locate at main room or area signal ground within the room (i.e. head end and telecommunications rooms) or area(s) and indicate each signal ground location on the drawings.
- C. Extend the signal ground to inside each equipment cabinet and/or rack. Ensure each cabinet and/or rack installed item of equipment is connected to the extended signal ground. Isolate the signal ground from power and major equipment grounding systems.
- D. When required, install grounding electrodes as specified in CFM Division 26, Section 26 05 26 – Grounding and Bonding for Electrical Systems.
- E. Do not use “3rd or 4th” wire internal electrical system conductors for communications signal ground.

- F. Do not connect the signal ground to the building's external lightning protection system.
- G. Do Not "mix grounds" of different systems.
- H. Insure grounds of different systems are installed as to not violate OSHA Safety and NEC installation requirements for protection of personnel.

PART 4 – TESTING / GUARANTY / TRAINING

4.0 SYSTEM LISTING

The Nurses Call System is NFPA listed as an "Emergency" Communication system.

Where Code Blue signals are transmitted, that listing is elevated to "Life Support/Safety."

Therefore, the following testing and guaranty provisions are the minimum to be performed and provided by the contractor and Warranted by the OEM.

4.1 PROOF OF PERFORMANCE TESTING

A. Intermediate Testing:

1. After completion of 30 – 40% of the installation of a head end cabinet(s) and interconnection to the corresponding System Patient Head Wall Units and equipment, one master stations, local and remote stations, treatment rooms, and prior to any further work, this portion of the system must be pretested, inspected, and 1certified. Each item of installed equipment shall be checked to ensure appropriate UL Listing and Certification Labels are affixed as required by NFPA -Life Safety Code 101-3.2 (a) & (b), UL Nurse Call Standard 1069 and JCHCO evaluation guidelines, and proper installation practices are followed. The intermediate test shall include a full operational test.
2. All inspections and tests shall be conducted by an OEM-certified contractor representative and witnessed by TVE-005OP3B if there is no local Government Representative that processes OEM and VA approved Credentials to inspect and certify the system. The results of the inspection will be officially recorded by the Government Representative and maintained on file by the RE, until completion of the entire project. The results will be compared to the Acceptance Test results. An identical inspection may be conducted between the 65 - 75% of the system construction phase, at the direction of the RE.

B. Pretesting:

1. Upon completing installation of the Nurse Call and/or Code Blue System, the Contractor shall align, balance, and completely pretest the entire system under full operating conditions.
2. Pretesting Procedure:

- a. During the System Pretest the Contractor shall verify (utilizing approved test equipment) that the System is fully operational and meets all the System performance requirements of this standard.
 - b. The Contractor shall pretest and verify that all PSM System functions and specification requirements are met and operational, no unwanted aural effects, such as signal distortion, noise pulses, glitches, audio hum, poling noise, etc. are present. At a minimum, each of the following locations shall be fully pretested:
 - 1) Central Control Cabinets.
 - 2) Nurse Control Stations.
 - a) Master Stations
 - b) Patient Stations
 - c) Staff Stations
 - d) Emergency Stations
 - e) Code Blue Stations
 - 3) Dome Lights.
 - a) Patient Rooms
 - b) Corridors
 - c) Intersectional
 - 4) STRs
 - 5) Local and Remote Enunciation Panels (code blue).
 - 6) Electrical Supervision Panels/Functions/locations.
 - 7) All Networked locations.
 - 8) System interface locations (i.e. wireless, PA, telephone, etc.).
 - 9) System trouble reporting.
 - 10) System electrical supervision.
 - 11) UPS operation.
 - 12) Primary / Emergency AC Power Requirements
 - 13) Extra Auxiliary Generator Requirements.
 - 14) NSs.
 - 3. The Contractor shall provide four (4) copies of the recorded system pretest measurements and the written certification that the System is ready for the formal acceptance test shall be submitted to the RE.
- C. Acceptance Test:

1. After the Nurse Call and/or Code Blue System has been pretested and the Contractor has submitted the pretest results and certification to the RE, then the Contractor shall schedule an acceptance test date and give the RE 15 working days written notice prior to the date the acceptance test is expected to begin. The System shall be tested in the presence of a TVE 005OP3B and OEM certified representatives. The System shall be tested utilizing the approved test equipment to certify proof of performance and Life Safety / Critical Service compliance. The tests shall verify that the total System meets all the requirements of this specification. The notification of the acceptance test shall include the expected length (in time) of the test.
2. The acceptance test shall be performed on a "go-no-go" basis. Only those operator adjustments required to show proof of performance shall be allowed. The test shall demonstrate and verify that the installed System does comply with all requirements of this specification under operating conditions. The System shall be rated as either acceptable or unacceptable at the conclusion of the test. Failure of any part of the System that precludes completion of system testing, and which cannot be repaired in four (4) hours, shall be cause for terminating the acceptance test of the System. Repeated failures that result in a cumulative time of eight (8) hours to affect repairs shall cause the entire System to be declared unacceptable.
3. Retesting of the entire System shall be rescheduled at the convenience of the Government and costs borne by the Contractor at the direction of the SRE.

D. Acceptance Test Procedure:

1. Physical and Mechanical Inspection:
 - a. The TVE 005OP3B Representative will tour all major areas where the Nurse Call and/or Code Blue System and all sub-systems are completely and properly installed to insure they are operationally ready for proof of performance testing. A system inventory including available spare parts will be taken at this time. Each item of installed equipment shall be checked to ensure appropriate UL certification labels are affixed.
 - b. The System diagrams, record drawings, equipment manuals, TIP Auto CAD Disks, intermediate, and pretest results shall be formally inventoried and reviewed.
 - c. Failure of the System to meet the installation requirements of this specification shall be grounds for terminating all testing.
2. Operational Test:
 - a. After the Physical and Mechanical Inspection, the central terminating and nurse call master control equipment shall be checked to verify that it meets all performance

requirements outlined herein. A spectrum analyzer and sound level meter may be utilized to accomplish this requirement.

- b. Following the central equipment test, a pillow speaker (or on board speaker) shall be connected to the central terminating and nurse call master control equipment's output tap to ensure there are no signal distortions such as intermodulation, data noise, popping sounds, erratic system functions, on any function.
 - c. The distribution system shall be checked at each interface, junction, and distribution point, first, middle, and last intersectional, room, and bed dome light in each leg to verify that the nurse call distribution system meets all system performance standards.
 - d. Each MATV outlet that is controlled by a nurse call pillow speaker shall be functionally tested at the same time utilizing the Contractor's approved hospital grade HDTV receiver and TV remote control cable.
 - e. The RED system and volume stepper switches shall be checked to insure proper operation of the pillow speaker, the volume stepper and the RED system (if installed).
 - f. Additionally, each installed emergency, patient, staff, duty, panic station, intersectional, room, and bed dome light, power supply, code one, and remote annunciator panels shall be checked insuring they meet the requirements of this specification.
 - g. Once these tests have been completed, each installed sub-system function shall be tested as a unified, functioning and fully operating system. The typical functions are: nurse follower, three levels of emergency signaling (i.e. flashing red emergency, flashing white patient emergency, flashing white or combination lights for staff emergency, separate flashing code blue), minimum of 10 minutes of UPS operation, memory saving, minimum of ten station audio paging, canceling emergency calls at each originating station only, and storage and prioritizing of calls.
 - h. Individual Item Test: The TVE 005OP3B Representative will select individual items of equipment for detailed proof of performance testing until 100% of the System has been tested and found to meet the contents of this specification. Each item shall meet or exceed the minimum requirements of this document.
3. Test Conclusion:
- a. At the conclusion of the Acceptance Test, using the generated punch list (or discrepancy list) the VA and the Contractor shall jointly agree to the results of the test, and reschedule testing on deficiencies and shortages with the RE. Any retesting to comply with these specifications will be done at the Contractor's expense.

- b. If the System is declared unacceptable without conditions, all rescheduled testing expenses will be borne by the Contractor.
- E. Acceptable Test Equipment: The test equipment shall furnished by the Contractor shall have a calibration tag of an acceptable calibration service dated not more than 12 months prior to the test. As part of the submittal, a test equipment list shall be furnished that includes the make and model number of the following type of equipment as a minimum:
 - 1. Spectrum Analyzer.
 - 2. Signal Level Meter.
 - 3. Volt-Ohm Meter.
 - 4. Sound Pressure Level (SPL) Meter.
 - 5. Oscilloscope.
 - 6. Pillow Speaker Test Set (Pillow Speaker with appropriate load and cross connections in lieu of the set is acceptable).
 - 7. Patient Push Button Cord Test Set.
 - 8. Patient Bed with connecting multiple conductor cord.

4.2 SYSTEM GUARANTEE

- A. Contractor's Responsibility:
 - 1. The Contractor shall guarantee that all provided material and equipment will be free from defects, workmanship and will remain so for a period of one year from date of final acceptance of the System by the VA. The Contractor shall provide OEM's equipment warranty documents, to the RE (or Facility Contracting Officer if the Facility has taken possession of the building), that certifies each item of equipment installed conforms to OEM published specifications.
 - 2. The Contractor's maintenance personnel shall have the ability to contact the Contractor and OEM for emergency maintenance and logistic assistance, remote diagnostic testing, and assistance in resolving technical problems at any time. This contact capability shall be provided by the Contractor and OEM at no additional cost to the VA.
 - 3. All Contractor maintenance and supervisor personnel shall be fully qualified by the OEM and must provide two (2) copies of current and qualified OEM training certificates and OEM certification upon request.
 - 4. Additionally, the Contractor shall accomplish the following minimum requirements during the one year guaranty period:
 - a. Response Time during the One Year Guaranty Period:

- 1) The RE (or Facility Contracting Officer if the system has been turned over to the Facility) is the Contractor's ONLY OFFICIAL reporting and contact official for nurse call system trouble calls, during the guaranty period.
- 2) A standard work week is considered 8:00 A.M. to 5:00 P.M. or as designated by the RE (or Facility Contracting Officer), Monday through Friday exclusive of Federal Holidays.
- 3) The Contractor shall respond and correct on-site trouble calls, during the standard work week to:
 - a) A routine trouble call within one (1) working day of its report. A routine trouble is considered a trouble which causes a pillow speaker or cordset, one (1) master nurse control station, patient station, emergency station, or dome light to be inoperable.
 - b) Routine trouble calls in critical emergency health care facilities (i.e., cardiac arrest, intensive care units, etc.) shall also be deemed as an emergency trouble call. The RE (or Facility Contracting Officer) shall notify the Contractor of this type of trouble call.
 - c) An emergency trouble call within four hours of its report. An emergency trouble is considered a trouble which causes a sub-system (ward), distribution point, terminal cabinet, or code one system to be inoperable at anytime.
- 4) If a Nurse Call and/or Code Blue/ component failure cannot be corrected within four (4) hours (exclusive of the standard work time limits), the Contractor shall be responsible for providing alternate nurse call equipment. The alternate equipment/system shall be operational within a maximum of 20 hours after the four (4) hour trouble shooting time and restore the effected location operation to meet the System performance standards. If any sub-system or major system trouble cannot be corrected within one working day, the Contractor shall furnish and install compatible substitute equipment returning the System or sub-system to full operational capability, as described herein, until repairs are complete.
- b. Required On-Site Visits during the One Year Guaranty Period
 - 1) The Contractor shall visit, on-site, for a minimum of eight (8) hours, once every 12 weeks, during the guaranty period, to perform system preventive maintenance, equipment cleaning, and operational adjustments to maintain the System according the descriptions identified in this document.

- 2) The Contractor shall arrange all Facility visits with the RE (or Facility Contracting Officer) prior to performing the required maintenance visits.
 - 3) Preventive maintenance shall be performed by the Contractor in accordance with the OEM's recommended practice and service intervals during non-busy time agreed to by the RE (or Facility Contracting Officer) and Contractor.
 - 4) The preventive maintenance schedule, functions and reports shall be provided to and approved by the RE (or Facility Contracting Officer).
 - 5) The Contractor shall provide the RE (or Facility Contracting Officer) a type written report itemizing each deficiency found and the corrective action performed during each required visit or official reported trouble call. The Contractor shall provide the RE with sample copies of these reports for review and approval at the beginning of the Acceptance Test. The following reports are the minimum required:
 - a) The Contractor shall provide a monthly summary all equipment and sub-systems serviced during this guarantee period to RE (or Facility Contracting Officer) by the fifth (5th) working day after the end of each month. The report shall clearly and concisely describe the services rendered, parts replaced and repairs performed. The report shall prescribe anticipated future needs of the equipment and systems for preventive and predictive maintenance.
 - b) The Contractor shall maintain a separate log entry for each item of equipment and each sub-system of the System. The log shall list dates and times of all scheduled, routine, and emergency calls. Each emergency call shall be described with details of the nature and causes of emergency steps taken to rectify the situation and specific recommendations to avoid such conditions in the future.
 - 6) The RE (or Facility Contracting Officer) shall convey to the Facility Engineering Officer, two (2) copies of actual reports for evaluation.
 - a) The RE (or Facility Contracting Officer) shall ensure a copy of these reports is entered into the System's official acquisition documents.
 - b) The Facility Chief Engineer shall ensure a copy of these reports is entered into the System's official technical record documents.
- B. Work Not Included: Maintenance and repair service shall not include the performance of any work due to improper use; accidents; other vendor, contractor, or owner tampering or negligence, for which the Contractor is not directly responsible and does not control. The Contractor shall immediately notify the RE or Facility Contracting Officer in writing upon the discovery of these

incidents. The RE or Facility Contracting Officer will investigate all reported incidents and render

4.3 TRAINING

- A. Provide thorough training of all nursing staff assigned to those nursing units receiving new networked nurse/patient communications equipment. This training shall be developed and implemented to address two different types of staff. Floor nurses/staff shall receive training from their perspective, and likewise, unit secretaries (or any person whose specific responsibilities include answering patient calls and dispatching staff) shall receive operational training from their perspective. A separate training room will be set up that allows this type of individualized training utilizing in-service training unit, prior to cut over of the new system.
- B. Provide the following minimum training times and durations:
 - 1. Prior to opening for nursing staff (in 4-hour increments) – split evenly over 3 weeks and day and night shifts. Coordinate schedule with Owner.
 - 2. 16 hours during the opening week for nursing staff – both day and night shifts.
 - 3. 8 hours for supervisors and system administrators.

--- E N D ---

SECTION 28 05 11
REQUIREMENTS FOR ELECTRONIC SAFETY AND SECURITY INSTALLATIONS

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This Section, Requirements for Electronic Safety and Security Installations, applies to all sections of Division 28.
- B. Furnish and install electronic safety and security cabling, systems, equipment and accessories in accordance with the specifications and drawings. Capacities and ratings of, cable and other items and arrangements for the specified items are shown on drawings.

1.2 MINIMUM REQUIREMENTS

- A. References to industry and trade association standards and codes are minimum installation requirement standards.
- B. Drawings and other specification sections shall govern in those instances where requirements are greater than those specified in the above standards.

1.3 QUALIFICATIONS (PRODUCTS AND SERVICES)

- A. Manufacturers Qualifications: The manufacturer shall regularly and presently produce, as one of the manufacturer's principal products, the equipment and material specified for this project, and shall have manufactured the item for at least three years.
- B. Product Qualification:
 - 1. Manufacturer's product shall have been in satisfactory operation, on three installations of similar size and type as this project, for approximately three years.
 - 2. The Government reserves the right to require the Contractor to submit a list of installations where the products have been in operation before approval.
- C. Service Qualifications: There shall be a permanent service organization maintained or trained by the manufacturer which will render satisfactory service to this installation within four hours of receipt of notification that service is needed. Submit name and address of service organizations.

1.4 MANUFACTURED PRODUCTS

- A. Materials and equipment furnished shall be of current production by manufacturers regularly engaged in the manufacture of such items, for which replacement parts shall be available.
- B. When more than one unit of the same class of equipment is required, such units shall be the product of a single manufacturer.
- C. Equipment Assemblies and Components:
 - 1. Components of an assembled unit need not be products of the same manufacturer.

2. Manufacturers of equipment assemblies, which include components made by others, shall assume complete responsibility for the final assembled unit.
 3. Components shall be compatible with each other and with the total assembly for the intended service.
 4. Constituent parts which are similar shall be the product of a single manufacturer.
- D. Factory wiring shall be identified on the equipment being furnished and on all wiring diagrams.
- E. When Factory Testing Is Specified:
1. The Government shall have the option of witnessing factory tests. The contractor shall notify the VA through the Resident Engineer a minimum of 15 working days prior to the manufacturers making the factory tests.
 2. Four copies of certified test reports containing all test data shall be furnished to the Resident Engineer prior to final inspection and not more than 90 days after completion of the tests.
 3. When equipment fails to meet factory test and re-inspection is required, the contractor shall be liable for all additional expenses, including expenses of the Government.

1.5 EQUIPMENT REQUIREMENTS

Where variations from the contract requirements are requested in accordance with the GENERAL CONDITIONS and Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES, the connecting work and related components shall include, but not be limited to additions or changes to branch circuits, circuit protective devices, conduits, wire, feeders, controls, panels and installation methods.

1.6 EQUIPMENT PROTECTION

- A. Equipment and materials shall be protected during shipment and storage against physical damage, dirt, moisture, cold and rain:
1. During installation, enclosures, equipment, controls, controllers, circuit protective devices, and other like items, shall be protected against entry of foreign matter; and be vacuum cleaned both inside and outside before testing and operating and repainting if required.
 2. Damaged equipment shall be, as determined by the Resident Engineer, placed in first class operating condition or be returned to the source of supply for repair or replacement.
 3. Painted surfaces shall be protected with factory installed removable heavy kraft paper, sheet vinyl or equal.
 4. Damaged paint on equipment and materials shall be refinished with the same quality of paint and workmanship as used by the manufacturer so repaired areas are not obvious.

1.7 WORK PERFORMANCE

- A. Job site safety and worker safety is the responsibility of the contractor.
- B. For work on existing stations, arrange, phase and perform work to assure electronic safety and security service for other buildings at all times. Refer to Article OPERATIONS AND STORAGE AREAS under Section 01 00 00, GENERAL REQUIREMENTS.
- C. New work shall be installed and connected to existing work neatly and carefully. Disturbed or damaged work shall be replaced or repaired to its prior conditions, as required by Section 01 00 00, GENERAL REQUIREMENTS.
- D. Coordinate location of equipment and conduit with other trades to minimize interferences. See the GENERAL CONDITIONS.

1.8 EQUIPMENT INSTALLATION AND REQUIREMENTS

- A. Equipment location shall be as close as practical to locations shown on the drawings.
- B. Inaccessible Equipment:
 - 1. Where the Government determines that the Contractor has installed equipment not conveniently accessible for operation and maintenance, the equipment shall be removed and reinstalled as directed at no additional cost to the Government.
 - 2. "Conveniently accessible" is defined as being capable of being reached without the use of ladders, or without climbing or crawling under or over obstacles such as, but not limited to, motors, pumps, belt guards, transformers, piping, ductwork, conduit and raceways.

1.9 EQUIPMENT IDENTIFICATION

- A. Install an identification sign which clearly indicates information required for use and maintenance of equipment.
- B. Nameplates shall be laminated black phenolic resin with a white core with engraved lettering, a minimum of 6 mm (1/4 inch) high. Secure nameplates with screws. Nameplates that are furnished by manufacturer as a standard catalog item, or where other method of identification is herein specified, are exceptions.

1.10 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. The Government's approval shall be obtained for all equipment and material before delivery to the job site. Delivery, storage or installation of equipment or material which has not had prior approval will not be permitted at the job site.

- C. All submittals shall include adequate descriptive literature, catalog cuts, shop drawings and other data necessary for the Government to ascertain that the proposed equipment and materials comply with specification requirements. Catalog cuts submitted for approval shall be legible and clearly identify equipment being submitted.
- D. Submittals for individual systems and equipment assemblies which consist of more than one item or component shall be made for the system or assembly as a whole. Partial submittals will not be considered for approval.
 - 1. Mark the submittals, "SUBMITTED UNDER SECTION_____".
 - 2. Submittals shall be marked to show specification reference including the section and paragraph numbers.
 - 3. Submit each section separately.
- E. The submittals shall include the following:
 - 1. Information that confirms compliance with contract requirements. Include the manufacturer's name, model or catalog numbers, catalog information, technical data sheets, shop drawings, pictures, nameplate data and test reports as required.
 - 2. Elementary and interconnection wiring diagrams for communication and signal systems, control system and equipment assemblies. All terminal points and wiring shall be identified on wiring diagrams.
 - 3. Parts list which shall include those replacement parts recommended by the equipment manufacturer, quantity of parts, current price and availability of each part.
- F. Manuals: Submit in accordance with Section 01 00 00, GENERAL REQUIREMENTS.
 - 1. Maintenance and Operation Manuals: Submit as required for systems and equipment specified in the technical sections. Furnish four copies, bound in hardback binders, (manufacturer's standard binders) or an approved equivalent. Furnish one complete manual as specified in the technical section but in no case later than prior to performance of systems or equipment test, and furnish the remaining manuals prior to contract completion.
 - 2. Inscribe the following identification on the cover: the words "MAINTENANCE AND OPERATION MANUAL," the name and location of the system, equipment, building, name of Contractor, and contract number. Include in the manual the names, addresses, and telephone numbers of each subcontractor installing the system or equipment and the local representatives for the system or equipment.

3. Provide a "Table of Contents" and assemble the manual to conform to the table of contents, with tab sheets placed before instructions covering the subject. The instructions shall be legible and easily read, with large sheets of drawings folded in.
4. The manuals shall include:
 - a. Internal and interconnecting wiring and control diagrams with data to explain detailed operation and control of the equipment.
 - b. A control sequence describing start-up, operation, and shutdown.
 - c. Description of the function of each principal item of equipment.
 - d. Installation and maintenance instructions.
 - e. Safety precautions.
 - f. Diagrams and illustrations.
 - g. Testing methods.
 - h. Performance data.
 - i. Pictorial "exploded" parts list with part numbers. Emphasis shall be placed on the use of special tools and instruments. The list shall indicate sources of supply, recommended spare parts, and name of servicing organization.
 - j. Appendix; list qualified permanent servicing organizations for support of the equipment, including addresses and certified qualifications.
- G. Approvals will be based on complete submission of manuals together with shop drawings.
- H. After approval and prior to installation, furnish the Resident Engineer with one sample of each of the following:
 1. A 300 mm (12 inch) length of each type and size of wire and cable along with the tag from the coils of reels from which the samples were taken.
 2. Each type of conduit and pathway coupling, bushing and termination fitting.
 3. Conduit hangers, clamps and supports.
 4. Duct sealing compound.

1.11 SINGULAR NUMBER

Where any device or part of equipment is referred to in these specifications in the singular number (e.g., "the switch"), this reference shall be deemed to apply to as many such devices as are required to complete the installation as shown on the drawings.

1.12 TRAINING

- A. Training shall be provided in accordance with Article, INSTRUCTIONS, of Section 01 00 00, GENERAL REQUIREMENTS.

- B. Training shall be provided for the particular equipment or system as required in each associated specification.
- C. A training schedule shall be developed and submitted by the contractor and approved by the Resident Engineer at least 30 days prior to the planned training.

--- E N D ---

SECTION 28 05 13

CONDUCTORS AND CABLES FOR ELECTRONIC SAFETY AND SECURITY

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This section specifies the furnishing, installation, and connection of the conductors and cables for electronic safety and security.

1.2 RELATED WORK

- A. Sealing around penetrations to maintain the integrity of time rated construction: Section 07 84 00, FIRESTOPPING.
- B. General electrical requirements that are common to more than one section in Division 28: Section 28 05 11, REQUIREMENTS FOR ELECTRONIC SAFETY AND SECURITY INSTALLATIONS.
- C. Conduits for cables and wiring: Section 27 05 33, RACEWAYS AND BOXES FOR COMMUNICATIONS SYSTEMS.
- E. Requirements for personnel safety and to provide a low impedance path for possible ground fault currents: Section 28 05 26, GROUNDING AND BONDING FOR COMMUNICATIONS SYSTEMS.

1.3 SUBMITTALS

- A. In accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES, furnish the following:
 - 1. Manufacturer's Literature and Data: Showing each cable type and rating.
 - 2. Certificates: Two weeks prior to final inspection, deliver to the COTR four copies of the certification that the material is in accordance with the drawings and specifications and has been properly installed.

1.4 APPLICABLE PUBLICATIONS

- A. Publications listed below (including amendments, addenda, revisions, supplements and errata) form a part of this specification to the extent referenced. Publications are reference in the text by the basic designation only.
- B. American Society of Testing Material (ASTM):
 - D2301-04Standard Specification for Vinyl Chloride Plastic Pressure Sensitive Electrical Insulating Tape
- C. Federal Specifications (Fed. Spec.):
 - A-A-59544-00Cable and Wire, Electrical (Power, Fixed Installation)

D. National Fire Protection Association (NFPA):

70-11National Electrical Code (NEC)

E. Underwriters Laboratories, Inc. (UL):

44-02Thermoset-Insulated Wires and Cables

83-03Thermoplastic-Insulated Wires and Cables

467-01Electrical Grounding and Bonding Equipment

486A-01Wire Connectors and Soldering Lugs for Use with Copper
Conductors

486C-02Splicing Wire Connectors

486D-02Insulated Wire Connector Systems for Underground Use or in
Damp or Wet Locations

486E-00.....Equipment Wiring Terminals for Use with Aluminum and/or
Copper Conductors

493-01Thermoplastic-Insulated Underground Feeder and Branch
Circuit Cable

514B-02Fittings for Cable and Conduit

1479-03Fire Tests of Through-Penetration Fire Stops

PART 2 - PRODUCTS

2.1 CONTROL WIRING

- A. Unless otherwise specified in other sections of these specifications, control wiring shall be as specified for power and lighting wiring, except the minimum size shall be not less than No. 14 AWG.
- B. Control wiring shall be large enough so that the voltage drop under inrush conditions does not adversely affect operation of the controls.

2.2 COMMUNICATION AND SIGNAL WIRING

- A. Shall conform to the recommendations of the manufacturers of the communication and signal systems; however, not less than what is shown.
- B. Wiring shown is for typical systems. Provide wiring as required for the systems being furnished.
- C. Multi-conductor cables shall have the conductors color coded.

2.3 WIRE LUBRICATING COMPOUND

- A. Suitable for the wire insulation and conduit it is used with, and shall not harden or become adhesive.
- B. Shall not be used on wire for isolated type electrical power systems.

2.4 FIREPROOFING TAPE

- A. The tape shall consist of a flexible, conformable fabric of organic composition coated one side with flame-retardant elastomer.
- B. The tape shall be self-extinguishing and shall not support combustion. It shall be arc-proof and fireproof.
- C. The tape shall not deteriorate when subjected to water, gases, salt water, sewage, or fungus and be resistant to sunlight and ultraviolet light.
- D. The finished application shall withstand a 200-ampere arc for not less than 30 seconds.
- E. Securing tape: Glass cloth electrical tape not less than 0.18 mm (7 mils) thick, and 19 mm (3/4 inch) wide.

PART 3 - EXECUTION

3.1 INSTALLATION, GENERAL

- A. Splice cables and wires only in outlet boxes, junction boxes, or pull boxes.
- B. Seal cable and wire entering a building from underground, between the wire and conduit where the cable exits the conduit, with a non-hardening approved compound.
- C. Wire Pulling:
 - 1. Provide installation equipment that will prevent the cutting or abrasion of insulation during pulling of cables.
 - 2. Use ropes made of nonmetallic material for pulling feeders.
 - 3. Attach pulling lines for feeders by means of either woven basket grips or pulling eyes attached directly to the conductors, as approved by the Resident Engineer.
 - 4. Pull in multiple cables together in a single conduit.

3.2 SPLICE INSTALLATION

- A. Splices and terminations shall be mechanically and electrically secure.
- B. Where the Government determines that unsatisfactory splices or terminations have been installed, remove the devices and install approved devices at no additional cost to the Government.

3.3 CONTROL, COMMUNICATION AND SIGNAL WIRING INSTALLATION

- A. Unless otherwise specified in other sections, install wiring and connect to equipment/devices to perform the required functions as shown and specified.
- B. Except where otherwise required, install a separate power supply circuit for each system so that malfunctions in any system will not affect other systems.

- C. Where separate power supply circuits are not shown, connect the systems to the nearest panelboards of suitable voltages, which are intended to supply such systems and have suitable spare circuit breakers or space for installation.
- D. Install a red warning indicator on the handle of the branch circuit breaker for the power supply circuit for each system to prevent accidental de-energizing of the systems.
- E. System voltages shall be 120 volts or lower where shown on the drawings or as required by the NEC.

3.4 CONTROL, COMMUNICATION AND SIGNAL SYSTEM IDENTIFICATION

- A. Install a permanent wire marker on each wire at each termination.
- B. Identifying numbers and letters on the wire markers shall correspond to those on the wiring diagrams used for installing the systems.
- C. Wire markers shall retain their markings after cleaning.
- D. In each manhole and handhole, install embossed brass tags to identify the system served and function.

3.5 EXISTING WIRING

Unless specifically indicated on the plans, existing wiring shall not be reused for the new installation. Only wiring that conforms to the specifications and applicable codes may be reused. If existing wiring does not meet these requirements, existing wiring may not be reused and new wires shall be installed.

--- E N D ---

SECTION 28 13 11
PHYSICAL ACCESS CONTROL SYSTEM (PACS)

PART 1 – GENERAL

1.1 DESCRIPTION

Provide and install a complete Physical Access Control System, hereinafter referred to as the PACS.

Contractor shall contract for the services of the current sole authorized HIRSCH Electronics provider in central Iowa: Baker Group. Local contact Doug Ruschill at 515-299-4184.

1.2 RELATED WORK

- A. For firestopping application and use, Section 07 84 00, FIRESTOPPING.
- B. For connection of high voltage, Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
- C. For power cables, Section 26 05 21, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES (600 VOLTS AND BELOW).
- D. For grounding of equipment, Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS.
- E. For infrastructure, Section 26 05 33, RACEWAYS AND BOXES FOR ELECTRICAL SYSTEMS.
- F. For General Requirements, Section 01 00 00, GENERAL REQUIREMENTS.

1.3 QUALITY ASSURANCE

- A. Contractor must have minimum 5 years experience installing HIRSCH Electronics security hardware.
- B. Contractor shall be identified as certified installer by HIRSCH Electronics. Current sole certified central Iowa installer is Baker Group. Contact Doug Ruschill at 515-299-4184.
- C. The Contractor shall be responsible for providing, installing, and the operation of the PACS as shown. The Contractor shall also provide certification as required.
- D. The security system will be installed and tested to ensure all components are fully compatible as a system and can be integrated with all associated security subsystems, whether the security system is stand-alone or a part of a complete Information Technology (IT) computer network.
- E. The Contractor or security sub-contractor shall be a licensed security Contractor as required within the state or jurisdiction of where the installation work is being conducted.

1.4 SUBMITTALS

- A. Submit below items in conjunction with Master Specification Sections 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES, and Section 02 41 00, DEMOLITION.
- B. Provide certificates of compliance with Section 1.3, Quality Assurance.

- C. Provide a complete and thorough pre-installation and as-built design package in both electronic format and on paper, minimum size 48 x 48 inches (1220 x 1220 millimeters); drawing submittals shall be per the established project schedule.
- D. Pre-installation design and as-built packages shall include, but not be limited to:
1. Index Sheet that shall:
 - a. Define each page of the design package to include facility name, building name, floor, and sheet number.
 - b. Provide a complete list of all security abbreviations and symbols.
 - c. Reference all general notes that are utilized within the design package.
 - d. Specification and scope of work pages for all individual security systems that are applicable to the design package that will:
 - 1) Outline all general and job specific work required within the design package.
 - 2) Provide a detailed device identification table outlining device Identification (ID) and use for all security systems equipment utilized in the design package.
 2. Drawing sheets that will be plotted on the individual floor plans or site plans shall:
 - a. Include a title block as defined above.
 - b. Clearly define the drawings scale in both standard and metric measurements.
 - c. Provide device identification and location.
 - d. Address all signal and power conduit runs and sizes that are associated with the design of the electronic security system and other security elements (e.g., barriers, etc.).
 - e. Identify all pull box and conduit locations, sizes, and fill capacities.
 - f. Address all general and drawing specific notes for a particular drawing sheet.
 3. A detailed riser drawing for each applicable security subsystem shall:
 - a. Indicate the sequence of operation.
 - b. Relationship of integrated components on one diagram.
 - c. Include the number, size, identification, and maximum lengths of interconnecting wires.
 - d. Wire/cable types shall be defined by a wire and cable schedule. The schedule shall utilize a lettering system that will correspond to the wire/cable it represents (example: A = 18 AWG/1 Pair Twisted, Unshielded). This schedule shall also provide the manufacturer's name and part number for the wire/cable being installed.
 4. A detailed system drawing for each applicable security system shall:
 - a. Clearly identify how all equipment within the system, from main panel to device, shall be laid out and connected.
 - b. Provide full detail of all system components wiring from point-to-point.

- c. Identify wire types utilized for connection, interconnection with associate security subsystems.
 - d. Show device locations that correspond to the floor plans.
 - e. All general and drawing specific notes shall be included with the system drawings.
- 5. A detailed schedule for all of the applicable security subsystems shall be included. All schedules shall provide the following information:
 - a. Device ID.
 - b. Device Location (e.g. site, building, floor, room number, location, and description).
 - c. Mounting type (e.g. flush, wall, surface, etc.).
 - d. Power supply or circuit breaker and power panel number.
 - e. In addition, for the PACS, provide the door ID, door type (e.g. wood or metal), locking mechanism (e.g. strike or electromagnetic lock) and control device (e.g. card reader or biometrics).
- 6. Detail and elevation drawings for all devices that define how they were installed and mounted.
- E. Provide manufacturer security system product cut-sheets. Submit for approval at least 30 days prior to commencement of formal testing, a Security System Operational Test Plan. Include procedures for operational testing of each component and security subsystem, to include performance of an integrated system test.
- F. Submit manufacture's certification of Underwriters Laboratories, Inc. (UL) listing as specified. Provide all maintenance and operating manuals per Section 01 00 00, GENERAL REQUIREMENTS.

1.5 APPLICABLE PUBLICATIONS

- A. The publications listed below (including amendments, addenda, revisions, supplement, and errata) form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American National Standards Institute (ANSI)/ Security Industry Association (SIA):
 - AC-01.....Access Control: Wiegand Card Reader Interface Standard
 - AC-03.....Access Control: Badging Techniques
- C. American National Standards Institute (ANSI)/ International Code Council (ICC):
 - A117.1.....Standard on Accessible and Usable Buildings and Facilities
- D. Department of Justice American Disability Act (ADA)
 - 28 CFR Part 36-90ADA Standards for Accessible Design
- E. Government Accountability Office (GAO):

- GAO-03-8-02.....Security Responsibilities for Federally Owned and Leased
Facilities
- F. National Electrical Contractors Association
303-2005Installing Closed Circuit Television (CCTV) Systems
- G. National Electrical Manufacturers Association (NEMA):
250-03Enclosures for Electrical Equipment (1000 Volts Maximum)
- H. National Fire Protection Association (NFPA):
70-11 Article 780-National Electrical Code
- I. Underwriters Laboratories, Inc. (UL):
294-99Standard for Access Control
305-97Standard for Panic Hardware
639-97Standard for Intrusion-Detection Units
752-05Standard for Bullet-Resisting Equipment
827-96Central Station Alarm Services
1076-95Standards for Proprietary Burglar Alarm Units and Systems
1981-03Central Station Automation System
2058-05High Security Electronic Locks
- J. Homeland Security Presidential Directive (HSPD):
HSPD-12Policy for a Common Identification Standard for Federal
Employees and Contractors
- K. Federal Information Processing Standards (FIPS):
FIPS-201Personal Identity Verification (PIV) of Federal Employees and
Contractors
- L. National Institute of Standards and Technology (NIST):
IR 6887 V2.1.....Government Smart Card Interoperability Specification (GSC-IS)
Special Pub 800-96PIV Card Reader Interoperability Guidelines
- M. Institute of Electrical and Electronics Engineers (IEEE):
C62.41IEEE Recommended Practice on Surge Voltages in Low-Voltage
AC Power Circuits
- N. International Organization for Standardization (ISO):
7810Physical Characteristics of Credit Card Size Document
7811Physical Characteristics for Magnetic Stripe Cards
7816-1Physical Characteristics of the Card
7816-2Dimensions and Contact Position of the card

- 7816-3Electrical Signals and Transmission Protocols
- 7816-4Inter-Industry Command for Interchange
- 14443RFID cards; Contactless Proximity Cards Operating at 13.56
MHz in up to 5 inches distance
- 15693RFID cards; Contactless Vicinity Cards Operating at 13.56 MHz
in up to 50 inches distance
- O. Uniform Federal Accessibility Standards (UFAS) 1984
- P. ADA Standards for Accessible Design 1994

PART 2 – PRODUCTS

2.1 EQUIPMENT AND MATERIALS

- A. All equipment associated within the PACS shall be UL 294 compliant and rated for continuous operation. Environmental conditions (i.e. temperature, humidity, wind, and seismic activity) shall be taken under consideration at each facility and site location prior to installation of the equipment.
- B. All equipment shall operate on a 120 volt alternating current (VAC), 60 Hz AC power system unless documented otherwise in subsequent sections listed within this specification. All equipment shall have a back-up source of power that will provide a minimum of 96 hours of run time in the event of a loss of primary power to the facility.
- C. The system shall be designed, installed, and programmed in a manner that will allow for easy of operation, programming, servicing, maintenance, testing, and upgrading of the system.
- D. All equipment and materials for the system will be compatible to ensure correct operation as outlined in FIPS 201, March 2006 and HSPD-12.

2.2 EQUIPMENT ITEMS

- A. Control Panel: HIRSCH Model 8
- B. Card Reader: Supplied by Owner. Installed by Contractor.
 - 1. Proximity / PIN Reader.
 - 1) 1.4 to 2.0in read range.
 - 2) Built-in 12 numeric keypads.
 - 3) Illuminated keypad for high ambient light environments.
 - 4) Power: 135 mA @ 24VDC when illuminated.
 - 5) Accessory: Mounting Box
- C. Request to Exit / Sounder:
 - 1. Basis of Design: Bosch Intrusion Systems DS160 Series High Performance Request-to-exit Detector

2. Integrated sounder fully adjustable to 85 dB.
 3. Power: 12 VAC or VDC to 30 VAC or VDC, 39mA at 12VDC in alarm
- D. Motion Detector:
1. Basis of Design: Honeywell DUAL TEC Motion Sensor DT6360STC
 2. Detection Range: 50' diameter, 25' radius
 3. Power: 10-14.4VDC, 40mA @ 12VDC
 4. Accessory: Power Supply
- E. Panic Push Button System:
1. Push Buttons
 - 1) Basis of Design: Bosch wired single button transmitter.
- F. Camera - Fixed
1. Provided by Owner
- G. Intercom System
1. Basis of Design: AI Phone
 2. Master Station: LEF-3
 3. Outdoor Station: LE-DA
- H. Conduit
1. EMT.
 2. All conduit, pull boxes, and junction boxes shall be clearly marked every with colored permanent tape or paint that will allow it to be distinguished from all other conduit and infrastructure.
 3. Conduit fills shall not exceed 50 percent unless otherwise documented.
 4. A pull rope shall be pulled along with signal and power cables to assist in future work.
- I. Signal Cables:
1. Shall meet or exceed all specifications and requirements called out by the manufactures.
 2. Shall be twisted pairs.

2.3 INSTALLATION KIT

- A. General: The kit shall be provided that at, a minimum includes all connectors and terminals, labeling systems, audio spade lugs, barrier strips, punch blocks or wire wrap terminals, heat shrink tubing, cable ties, solder, hangers, clamps, bolts, conduit, cable duct, and/or cable tray, etc., required to accomplish a neat and secure installation. All wires shall terminate in a spade lug and barrier strip, wire wrap terminal or punch block. Unfinished or unlabeled wire connections shall not be allowed. All unused and partially opened installation kit boxes, coaxial, fiber-optic, and twisted pair cable reels, conduit, cable tray, and/or cable duct bundles, wire rolls, physical

installation hardware shall be turned over to the Contracting Officer. The following sections outlined are the minimum required installation sub-kits:

1. System Grounding:
 - a. The grounding kit shall include all cable and installation hardware required. All head end equipment and power supplies shall be connected to earth ground via internal building wiring, according to the NEC.
 - b. This includes, but is not limited to:
 - 1) Coaxial Cable Shields
 - 2) Control Cable Shields
 - 3) Data Cable Shields
 - 4) Equipment Racks
 - 5) Equipment Cabinets
 - 6) Conduits
 - 7) Cable Duct blocks
 - 8) Cable Trays
 - 9) Power Panels
 - 10) Grounding
 - 11) Connector Panels
2. Coaxial Cable: The coaxial cable kit shall include all coaxial connectors, cable tying straps, heat shrink tabbing, hangers, clamps, etc., required to accomplish a neat and secure installation.
3. Wire and Cable: The wire and cable kit shall include all connectors and terminals, audio spade lugs, barrier straps, punch blocks, wire wrap strips, heat shrink tubing, tie wraps, solder, hangers, clamps, labels etc., required to accomplish a neat and orderly installation.
4. Conduit, Cable Duct, and Cable Tray: The kit shall include all conduit, duct, trays, junction boxes, back boxes, cover plates, feed through nipples, hangers, clamps, other hardware required to accomplish a neat and secure conduit, cable duct, and/or cable tray installation in accordance with the NEC and this document.
5. Equipment Interface: The equipment kit shall include any item or quantity of equipment, cable, mounting hardware and materials needed to interface the systems with the identified sub-system(s) according to the OEM requirements and this document.
6. Labels: The labeling kit shall include any item or quantity of labels, tools, stencils, and materials needed to label each subsystem according to the OEM requirements, as-installed drawings, and this document.

7. Documentation: The documentation kit shall include any item or quantity of items, computer discs, as installed drawings, equipment, maintenance, and operation manuals, and OEM materials needed to provide the system documentation as required by this document and explained herein.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. System installation shall be in accordance with UL 294, manufacturer and related documents and references.
- B. The Contractor shall visit the site and verify that site conditions are in agreement with the design package. The Contractor shall report all changes to the site or conditions that will affect performance of the system. The Contractor shall not take any corrective action without written permission from the Government.
- C. Provide all control and power cables required for a complete operating system.
- D. Connect new access control devices to new HIRSCH Electronics Model 8 Control panel located in Data Rm. 0500A.
- E. Program the panel per the manufacturer's programming guidelines.
- F. The Contractor shall make written requests and obtain approval prior to disconnecting any signal lines and equipment, and creating equipment downtime. Such work shall proceed only after receiving Contracting Officer approval of these requests. If any device fails after the Contractor has commenced work on that device, signal or control line, the Contractor shall diagnose the failure and perform any necessary corrections to the equipment.
- G. The Contractor shall be held responsible for repair costs due to Contractor negligence, abuse, or improper installation of equipment.
- H. The Contracting Officer shall be provided a full list of all equipment that is to be removed or replaced by the Contractor, to include description and serial/manufacturer numbers where possible. The Contractor shall dispose of all equipment that has been removed or replaced based upon approval of the Contracting Officer after reviewing the equipment removal list. In all areas where equipment is removed or replaced the Contractor shall repair those areas to match the current existing conditions.
- L. Control Panels:
 1. Connect power and signal lines to new HIRSCH Electronics Model 8 control panel.
 2. Program the panel as outlined by the design and per the manufacturer's programming guidelines.
- N. Card Readers:

1. Connect all signal inputs and outputs as shown and specified.
2. Terminate input signals as required.
3. Program and address the reader as per the design package.
4. Readers shall be surface or flushed mounted and all appropriate hardware shall be provided to ensure the unit is installed in an enclosed conduit system.

Q. Door Status Indicators:

1. Install all signal input and output cables as well as all power cables.
2. RTE's shall be surface mounted and angled in a manner that they cannot be compromised from the non-secure side of a windowed door, or allow for easy release of the locking device from a distance no greater than 6 feet from the base of the door.
3. Door position sensors shall be surface or flush mounted and wide gap with the ability to operate at a maximum distance of up to 2" (5 cm).

R. Entry Control Devices:

1. Install all signal input and power cables.
2. Strikes and bolts shall be mounted within the door frame.
3. Mortise locks shall be mounted within the door and an electric transfer hinge shall be utilized to transfer the wire from within the door frame to the mortise lock inside the door.
4. Electromagnetic locks shall be installed with the mag-lock mounted to the door frame and the metal plate mounted to the door.

S. Camera System:

1. Provide all rough-in and conduit pathways as identified on Drawings. Owner to provide cameras.

T. System Start-Up:

1. The Contractor shall not apply power to the PACS until the following items have been completed:
 - a. PACS equipment items and have been set up in accordance with manufacturer's instructions.
 - b. A visual inspection of the PACS has been conducted to ensure that defective equipment items have not been installed and that there are no loose connections.
 - c. System wiring has been tested and verified as correctly connected as indicated.
 - d. All system grounding and transient protection systems have been verified as installed and connected as indicated.
 - e. Power supplies to be connected to the PACS have been verified as the correct voltage, phasing, and frequency as indicated.

2. Satisfaction of the above requirements shall not relieve the Contractor of responsibility for incorrect installation, defective equipment items, or collateral damage as a result of Contractor work efforts.

U. Supplemental Contractor Quality Control:

1. The Contractor shall provide the services of technical representatives who are familiar with all components and installation procedures of the installed PACS; and are approved by the Contracting Officer.
2. The Contractor will be present on the job site during the preparatory and initial phases of quality control to provide technical assistance.
3. The Contractor shall also be available on an as needed basis to provide assistance with follow-up phases of quality control.
4. The Contractor shall participate in the testing and validation of the system and shall provide certification that the system installed is fully operational as all construction document requirements have been fulfilled.

3.2 TESTING AND TRAINING

All testing and training shall be compliant with the VA General Requirements, Section 01 00 00, GENERAL REQUIREMENTS.

PART 4 – SEQUENCE OF OPERATION

A. This Part contains descriptions of sequence of Operation for Security and Power Activated Doors.

Hardware Set: HW-8E; 1549-1, 1549-2 {SEE DIAGRAMS FOLLOWING}

Hardware Set: HW 13; Doors 1574-1, 1574-2, 1574-3 {SEE DIAGRAMS FOLLOWING}

Hardware Set: HW-E3; Door 0500-2, HW E3x; Door 1580, HW –E4x; Door C1506-1, HW-E8; Door 0500-1

DPS (Door Position Switch) These are exterior doors with a switch that indicates when the door(s) is open. Whenever the door is opened, a signal is sent to control panel.

Hardware Set: HW-SH-3Cx; Door 0500A, 1534, 1536 {SEE DIAGRAMS FOLLOWING}

Hardware Set: HW-SH-11x; Door 1576-2

Door is normally held open on magnetic hold opens. In case of an emergency, the magnetic hold opens can be released by turning off a switch in the Security Office. Doors close and latch mechanically and locked from the Waiting Area side. People can still freely exit from the rest of the building into the Waiting Area. When the emergency is past, the security office can open the door with a key from the waiting room side and reactivate the magnetic hold open.

Hardware Set: HW-SH-12Hx; 1547-1, 1576-1 {SEE DIAGRAMS FOLLOWING}


Overhead Door: OH1580-1,

Door opened by signal from the Vehicle Detector Loop embedded in the driveway. On/off switch for loop detector located in Reception 1575. Door can also be opened by pressing a button on the wall next to the door. Door is closed by pushing a button on the wall next to the door.

Overhead Door: OH1580-2, OH1580-3

Doors can be opened by pressing a button (one for each door) on a 3-button controller near the north east corner of the garage. Doors are closed by pushing a button (one for each door) on the same panel.

(CONTINUED ON NEXT PAGE)

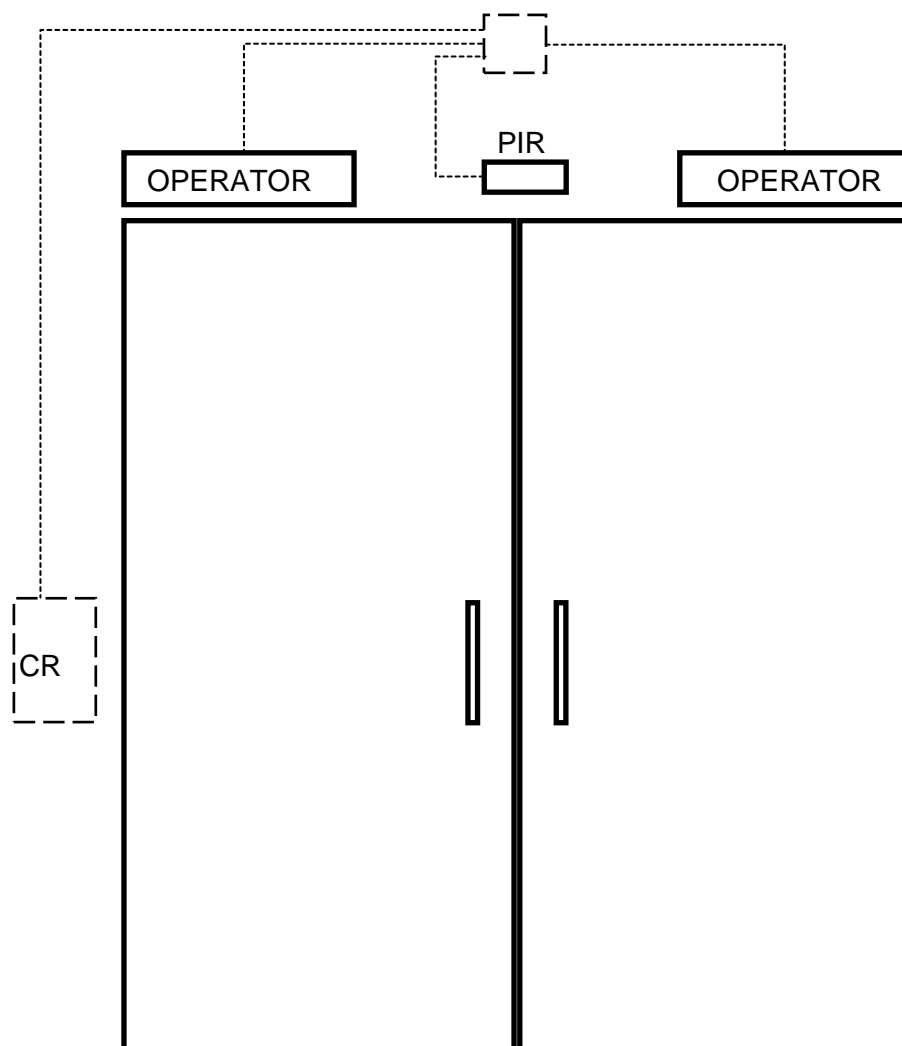

HW-SH-8E; 1549-1, 1549-2

From interior side:

PIR (Motion Detector) detects a person approaching and send signal for operators to activate

From the exterior (ambulance garage) side:

CR (Card Reader): When a key card is pass over CR a signal is sent to activate operators.


Door 1549-2 Similar except as follows:

From exterior (vestibule) side:

PIR (Motion Detector) detects a person approaching and send signal for operators to activate

From the interior (Nursing) side:

In lieu of CR shown on diagram, PB (Push Button): When pressed a signal is sent to activate operators.

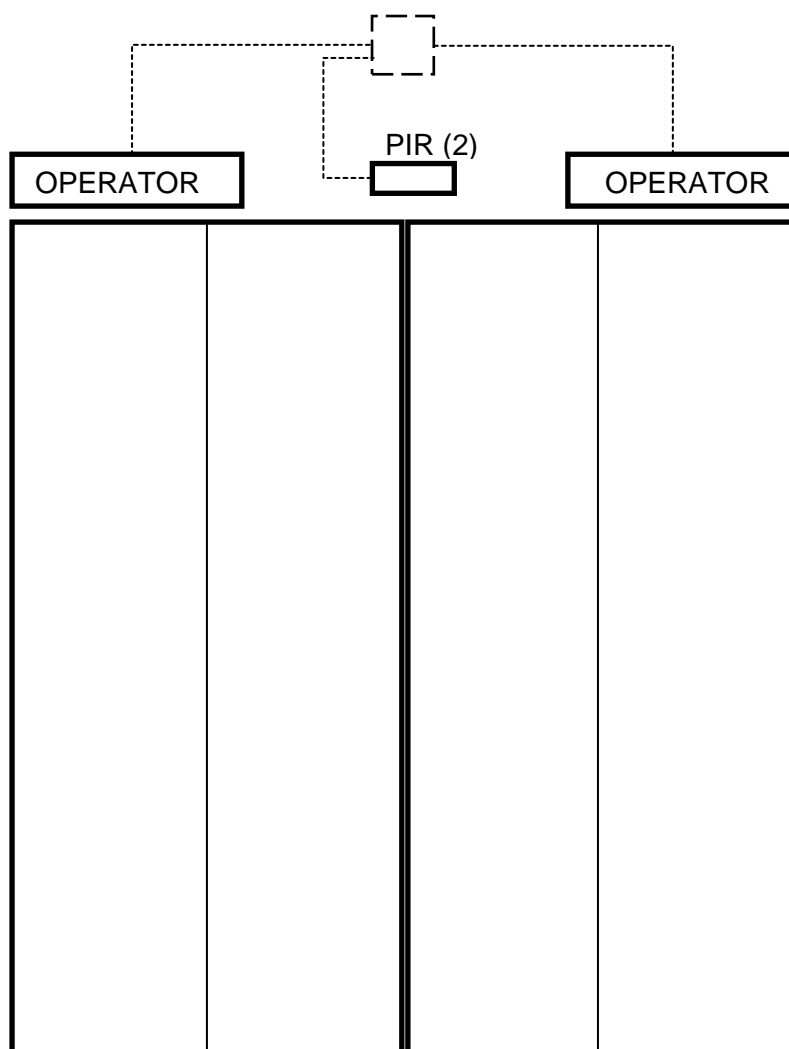

HW-13; Doors 1574-1,
1574-2, 1574-3

From exterior or interior

PIR (Motion Detector – both sides of door) detects a person approaching and send signal for operators to activate

Doors 1574-1 and 1574-2 always active in this mode.

Door 1574-3 can be made in active from the reception desk at which time the door will only open when a button at the reception desk is pressed.

HW-SH-3Cx; Doors 0500A, 1534, 1536

DPS (Door Positions Switch) monitors the door at all times. If the door is opened and signal is not shunted, a warning will be indicated at control panel.


From exterior:


CR (Card Reader) reads keycard and activated electric strike permitting door to be opened.

CR also shunts signal from the DPS (Door Position Switch) so that no warning is sent when the door is opened.

From interior:

PIR (Motion Detector) detects a person approaching from the secure side and shunts the DPS so that when the person on the secure side opens the door, no warning is sent that the door is open.

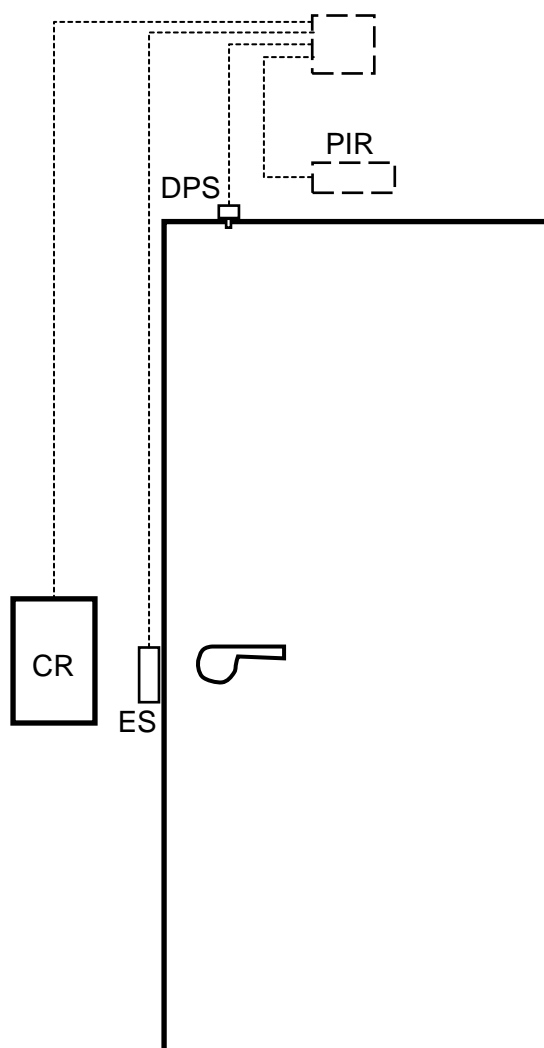

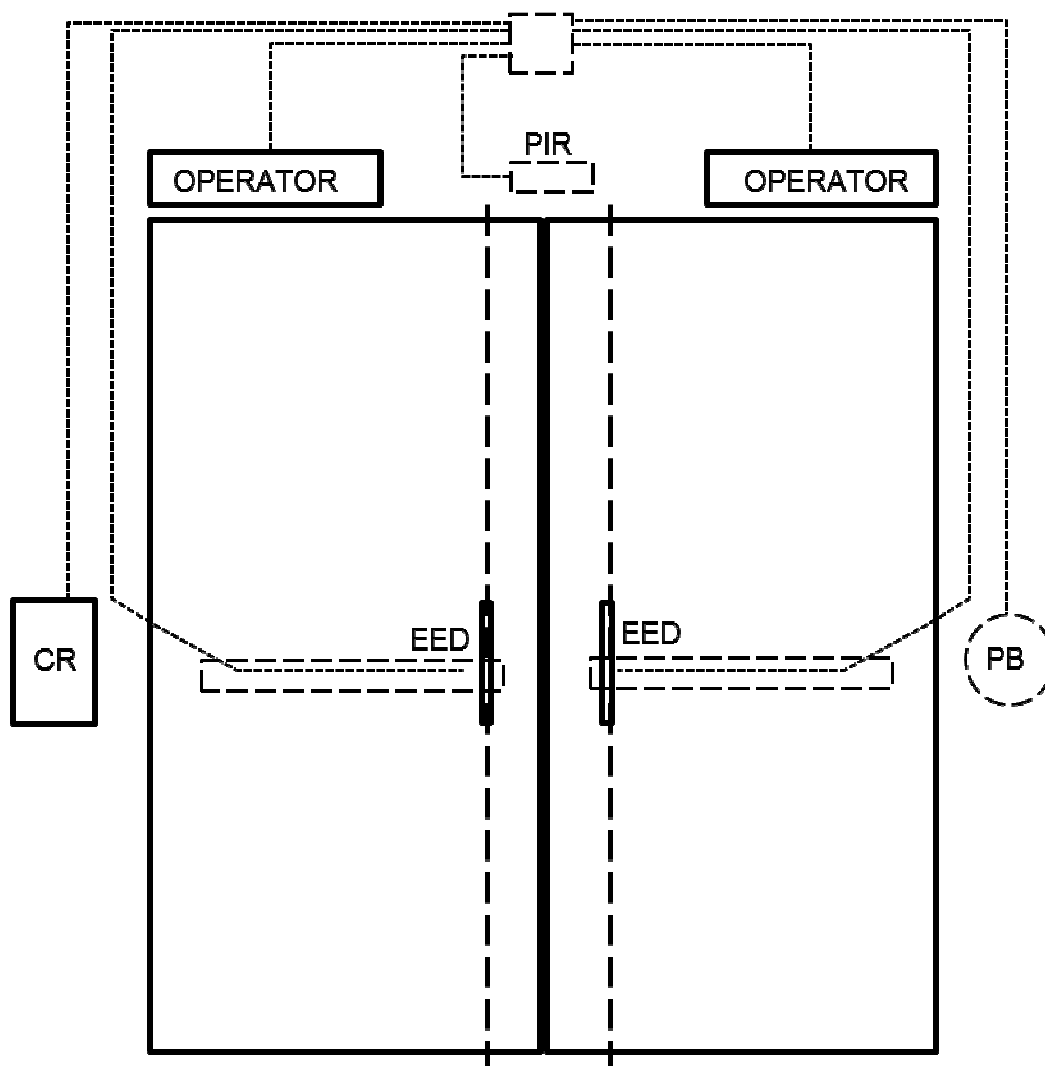

HW-SH-12Hx; 1547-1, 1576-1

Hardware is EED (electric exit device) – specifically rod retraction. Power must be provide through the frame into the each door.

From the control (exterior) side:

Swiping a keycard by the CR (Card Reader) activates the retraction of both set of EED rods. Then activates the door operators.

From the secure (in) side:

These are exit devices and can be exited by pushing on the push bar. However a PB (Push Button) will be provided on the wall which, when pushed, will retract the rods and then activate the operators.

-----END-----

SECTION 28 31 00
FIRE DETECTION AND ALARM

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This section of the specifications includes the furnishing, installation, and connection of the fire alarm equipment to form a complete coordinated system ready for operation. It shall include, but not be limited to, alarm initiating devices, alarm notification appliances, control units, fire safety control devices, annunciators, power supplies, and wiring as shown on the drawings and specified. Contractor shall contract for the services of the local Simplex Grinnell service vendor for all fire alarm related work, except for the installation of conduit, wiring and the fire alarm devices. All programming and updates of the existing fire alarm drawings, graphics control center, overall supervision, etc., shall be completed by Simplex-Grinnell.
- B. Fire alarm systems shall comply with requirements of NFPA 72 unless variations to NFPA 72 are specifically identified within these contract documents by the following notation: "variation". The design, system layout, document submittal preparation, and supervision of installation and testing shall be provided by a technician that is certified NICET level III or a registered fire protection engineer, and a representative of the Simplex Grinnell Company. The NICET certified technician shall be on site for the supervision and testing of the system. Factory engineers from the equipment manufacturer, thoroughly familiar and knowledgeable with all equipment utilized, shall provide additional technical support at the site as required by the Contracting Officer or his authorized representative. Installers shall have a minimum of two years experience installing fire alarm systems.
- C. All modifications and extensions of the fire alarm system shall be completed in a manner that matches the existing system that was installed in accordance with the following basic performance:
1. Signal initiating devices addressable throughout the system.
 2. Notification circuits wired in accordance with NFPA 72, Table 3-7.1, Style Y.
 3. Initiating device circuits wired in accordance with NFPA 72, Table 3-5.1, Class B, Style C.
 4. Signaling line circuits for initiating devices wired in accordance with NFPA 72, Table 3-6.1, Class B, Style 4.0.
 5. Voice annunciation system to alert occupants of a fire alarm.

1.2 SCOPE

- A. This project shall include the furnishing and installation of new and reinstallation of existing Simplex addressable fire alarm equipment as indicated on the drawings and specified herein.
 - 1. Contractor shall include revisions (programming as needed) to the existing graphic control panels in the maintenance boiler room office and at associated remote annunciator panels.
 - 2. Revisions to the existing graphics control center to show the devices in their new locations, and revisions to the floor plan to show the floor as-built.
- B. All existing fire alarm equipment, wiring, devices and sub-systems that are not shown to be reused, shall be removed and turned over to the VA. All existing fire alarm conduit not reused shall be removed.
- C. Existing fire alarm bells, chimes, door holders, 120VAC duct smoke detectors, valve tamper switches and waterflow/pressure switches may be reused only as specifically indicated on the drawings and provided the equipment:
 - 1. Meets this specification section
 - 2. Is UL listed or FM approved
 - 3. Is compatible with new equipment being installed
 - 4. Is verified as operable through contractor testing and inspection
- D. Basic Performance:
 - 1. Initiating device circuits (IDC) shall be wired Style C in accordance with NFPA 72.
 - 2. Signaling line circuits (SLC) within buildings shall be wired Style 4 in accordance with NFPA 72. Individual signaling line circuits shall be limited to covering 22,500 square feet of floor space or 3 floors whichever is less.
 - 3. Notification appliance circuits (NAC) shall be wired Style Y in accordance with NFPA 72.

1.3 RELATED WORK

- A. Section 01 00 00, GENERAL REQUIREMENTS: Restoration of existing surfaces.
- B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES: Procedures for submittals.
- C. Section 07 84 00, FIRESTOPPING: Fire proofing wall penetrations.
- D. Section 08 71 00, DOOR HARDWARE: Combination Closer-Holders.
- E. Section 09 91 00, PAINTING: Painting for equipment and existing surfaces.
- F. Section 21 13 13, WET-PIPE SPRINKLER SYSTEMS: Sprinkler systems.

- G. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: General electrical requirements for items which are common to other Division 26 sections.
- H. Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS: Conduits and boxes for cables/wiring.
- I. Section 26 05 21, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES (600 VOLTS AND BELOW: Cables/wiring.

1.4 SUBMITTALS

- A. General: Submit 4 copies and 1 reproducible in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES, and Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
- B. Drawings:
 - 1. Revise existing fire alarm drawings using the latest version of AutoCAD software and include all revisions to the fire alarm system completed as a result of the construction. Maintain same layering methods used in the existing drawings. The contractor shall be responsible for verifying all critical dimensions. Note: These existing drawings are available within Simplex-Grinnell and the VA Engineering Office
 - 2. Floor plans: Provide locations of all devices (with device number at each addressable device corresponding to control unit programming), appliances, panels, equipment, junction/terminal cabinets/boxes, risers, electrical power connections, individual circuits and raceway routing, system zoning; number, size, and type of raceways and conductors in each raceway; conduit fill calculations with cross section area percent fill for each type and size of conductor and raceway. Only those devices connected and incorporated into the final system shall be on these floor plans. Do not show any removed devices on the floor plans. Show all interfaces for all fire safety functions.
 - 3. Riser diagrams: N/A
 - 4. Detailed wiring diagrams: N/A
 - 5. Two weeks prior to final inspection, the Contractor shall deliver to the COTR one (1) set of reproducible, as-built drawings, two blueline copies and one (1) set of the as-built drawing computer files using the latest version of AutoCAD. As-built drawings (floor plans) shall show all new and existing conduit used for the fire alarm system.
- C. Manuals:
 - 1. Submit simultaneously with the shop drawings, required updates to Medical Center's existing Maintenance and Operations manuals.

- a. Wiring diagrams shall have their terminals identified to facilitate installation, operation, expansion and maintenance.
 - b. Wiring diagrams shall indicate internal wiring for each item of equipment and the interconnections between the items of equipment.
 - c. Include complete listing of all software used and installation and operation instructions including the input/output matrix chart.
 - d. Provide a clear and concise description of operation that gives, in detail, the information required to properly operate, inspect, test and maintain the equipment and system. Provide all manufacturer's installation limitations including but not limited to circuit length limitations.
 - e. Provide standby battery calculations under normal operating and alarm modes. Battery calculations shall include the magnets for holding the doors open for one minute.
2. Two weeks prior to final inspection, deliver four copies of the final updated maintenance and operating manual to the COTR.
- a. The manual shall be updated to include any information necessitated by the maintenance and operating manual approval.
 - b. Complete "As installed" wiring and schematic diagrams shall be included that shows all items of equipment and their interconnecting wiring. Show all final terminal identifications.
 - c. Complete listing of all programming information, including all control events per device including an updated input/output matrix.
 - d. Certificate of Installation as required by NFPA 72 for each building. The certificate shall identify any variations from the National Fire Alarm Code.
 - e. Certificate from equipment manufacturer assuring compliance with all manufacturers installation requirements and satisfactory system operation.

D. Certifications:

- 1. Together with the shop drawing submittal, submit the technician's NICET level III fire alarm certification as well as certification from the control unit manufacturer that the proposed performer of contract maintenance is an authorized representative of the major equipment manufacturer. Include in the certification the names and addresses of the proposed supervisor of installation and the proposed performer of contract maintenance. Also include the name and title of the manufacturer's representative who makes the certification.

2. Together with the shop drawing submittal, submit a certification from either the control unit manufacturer or the manufacturer of each component (e.g., smoke detector) that the components being furnished are compatible with the control unit.
3. Together with the shop drawing submittal, submit a certification from the major equipment manufacturer that the wiring and connection diagrams meet this specification, UL and NFPA 72 requirements.

1.5 WARRANTY

All work performed and all material and equipment furnished under this contract shall be free from defects and shall remain so for a period of five (5) years from the date of acceptance of the entire installation by the Contracting Officer.

1.6 APPLICABLE PUBLICATIONS

- A. The publications listed below (including amendments, addenda, revisions, supplements and errata) form a part of this specification to the extent referenced. The publications are referenced in text by the basic designation only.
- B. National Fire Protection Association (NFPA):
 - 70-2011National Electrical Code (NEC).
 - 72-2010National Fire Alarm Code.
 - 90A-2009Installation of Air Conditioning and Ventilating Systems.
 - 101-2009Life Safety Code
- C. Underwriters Laboratories, Inc. (UL):
 - 2000-2000.....Fire Protection Equipment Directory
- D. Factory Mutual Research Corp (FM): Approval Guide, 2005 Edition
- E. American National Standards Institute (ANSI):
 - S3.41-1996.....Audible Emergency Evacuation Signal
- F. International Code Council, International Building Code (IBC) 2003 Edition

PART 2 - PRODUCTS

2.1 EQUIPMENT AND MATERIALS, GENERAL

- A. Existing equipment may be reused only where indicated on the drawings.
- B. Except as indicated in paragraph A above, all equipment and components shall be new and the manufacturer's current model. All equipment shall be tested and listed by Underwriters Laboratories, Inc. or Factory Mutual Research Corporation for use as part of a fire alarm system. The authorized representative of the manufacturer of the major equipment shall certify that the

installation complies with all manufacturer's requirements and that satisfactory total system operation has been achieved.

2.2 CONDUIT, BOXES, AND WIRE

- A. Conduit shall be in accordance with Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS and as follows:
 - 1. All new and reused conduit shall be installed in accordance with NFPA 70.
 - 2. Conduit fill shall not exceed 40 percent of interior cross sectional area.
 - 3. All new conduit shall be 19 mm (3/4 inch) minimum.
- B. Wire:
 - 1. All existing wiring shall be removed and new wiring installed in a conduit or raceway.
 - 2. Wiring shall be in accordance with NEC article 760, Section 26 05 21, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES (600 VOLTS AND BELOW), and as recommended by the manufacturer of the fire alarm system. All wires shall be color coded. Number and size of conductors shall be as recommended by the fire alarm system manufacturer, but not less than 18 AWG for initiating device circuits and 14 AWG for notification device circuits.
 - 3. Addressable circuits and wiring used for the multiplex communication loop shall be twisted and shielded unless specifically excepted by the fire alarm equipment manufacturer in writing.
 - 4. Any fire alarm system wiring that extends outside of a building shall have additional power surge protection to protect equipment from physical damage and false signals due to lightning, voltage and current induced transients. Protection devices shall be shown on the submittal drawings and shall be UL listed or in accordance with written manufacturer's requirements.
 - 5. All wire or cable used in underground conduits including those in concrete shall be listed for wet locations.
- C. Terminal Boxes, Junction Boxes, and Cabinets:
 - 1. Shall be galvanized steel in accordance with UL requirements.
 - 2. All new and reused boxes shall be sized and installed in accordance with NFPA 70.
 - 3. New and existing covers shall be repainted red in accordance with Section 09 91 00, PAINTING and shall be identified with white markings as "FA" for junction boxes and as "FIRE ALARM SYSTEM" for cabinets and terminal boxes. Lettering shall be a minimum of 19 mm (3/4 inch) high.

4. Terminal boxes and cabinets shall have a volume 50 percent greater than required by the NFPA 70. Minimum sized wire shall be considered as 14 AWG for calculation purposes.
5. Terminal boxes and cabinets shall have identified pressure type terminal strips and shall be located at the base of each riser. Terminal strips shall be labeled as specified or as approved by the COTR.

2.3 ALARM NOTIFICATION APPLIANCES

- A. All notification devices shall be of the same brand and model as those installed throughout the facility.

2.4 ALARM INITIATING DEVICES

- A. All initiation devices shall be of the same brand and model as those installed throughout the facility.

2.5 SUPERVISION DEVICES

- A. All supervision devices shall be of the same brand and model as those installed throughout the facility.
- B. Circuit Supervision: Each new alarm initiating device circuit, signaling line circuit, and notification appliance circuit, shall be supervised against the occurrence of a break or ground fault condition in the field wiring. These conditions shall cause a trouble signal to sound in the control unit until manually silenced by an off switch.
- C. Supervisory Devices: Duct detectors shall be monitored as supervisory signals.

PART 3 - EXECUTION

3.1 INSTALLATION:

- A. Installation shall be in accordance with NFPA 70, 72, 90A, and 101 as shown on the drawings, and as recommended by the major equipment manufacturer. Fire alarm wiring shall be installed in conduit. All conduit and wire shall be installed in accordance with Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS , Section 26 05 21, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES (600 VOLTS AND BELOW), and all penetrations of smoke and fire barriers shall be protected as required by Section 07 84 00, FIRESTOPPING.
- B. All new conduits, junction boxes, conduit supports and hangers shall be concealed in finished areas and may be exposed in unfinished areas. All existing accessible fire alarm conduit not reused shall be removed.
- C. All new or reused exposed conduit shall be painted in accordance with Section 09 91 00, PAINTING to match surrounding finished areas and red in unfinished areas.

- D. Existing devices that are reused shall be properly mounted and installed. Where devices are installed on existing shallow backboxes, extension rings of the same material, color and texture of the new fire alarm devices shall be used. Mounting surfaces shall be cut and patched in accordance with Section 01 00 00, GENERAL REQUIREMENTS, Restoration, and be re-painted in accordance with Section 09 91 00, PAINTING as necessary to match existing.
- E. All fire detection and alarm system devices, control units and remote annunciators shall be flush mounted when located in finished areas and may be surface mounted when located in unfinished areas. Exact locations to be approved by the COTR.
- F. Speakers shall be ceiling mounted and fully recessed in areas with suspended ceilings. Speakers shall be wall mounted and recessed in finished areas without suspended ceilings. Speakers may be surface mounted in unfinished areas.
- G. Strobes shall be flush wall mounted 2,000 mm (84 inches) above the floor or 150 mm (6 inches) below ceiling, whichever is lower. Locate and mount to maintain a minimum 900 mm (36 inches) clearance from side obstructions.
- H. Manual pull stations shall be installed not less than 1050 mm (42 inches) or more than 1200 mm (48 inches) from finished floor to bottom of device and within 1500 mm (60 inches) of a stairway or an exit door.
- I. Where possible, locate water flow and pressure switches a minimum of 300 mm (12 inches) from a fitting that changes the direction of the flow and a minimum of 900 mm (36 inches) from a valve.
- J. Mount valve tamper switches so as not to interfere with the normal operation of the valve and adjust to operate within two revolutions toward the closed position of the valve control, or when the stem has moved no more than one-fifth of the distance from its normal position.
- K. Connect flow and tamper switches installed under Section 21 13 13, WET-PIPE SPRINKLER SYSTEMS.
- L. Connect combination closer-holders installed under Section 08 71 00, DOOR HARDWARE.
- M. Provide programming of all addressable devices. Submit proposed programmed descriptions to the Architect/Engineer and Resident Engineer in accordance with the submittal specifications for approval prior to placing the device in operation.
- N. Provide complete programming of the entire fire alarm system for all modifications and extensions.
- O. Revise and update the graphics command center located in Building #11 to reflect all new fire alarm devices and the revised floor plans.

3.2 TYPICAL OPERATION

- A. The modified/extended system shall operate in the same manner as the previous system

3.3 TESTS

- A. Provide the service of a NICET level III, competent, factory-trained engineer or technician authorized by the manufacturer of the fire alarm equipment to technically supervise and participate during all of the adjustments and tests for the system. Make all adjustments and tests in the presence of the COTR.
- B. When the systems have been completed and prior to the scheduling of the final inspection, furnish testing equipment and perform the following tests in the presence of the COTR. When any defects are detected, make repairs or install replacement components, and repeat the tests until such time that the complete fire alarm systems meets all contract requirements. After the system has passed the initial test and been approved by the COTR, the contractor may request a final inspection.
 1. Before energizing the cables and wires, check for correct connections and test for short circuits, ground faults, continuity, and insulation.
 2. Test the insulation on all installed cable and wiring by standard methods as recommended by the equipment manufacturer.
 3. Run water through all flow switches. Check time delay on water flow switches. Submit a report listing all water flow switch operations and their retard time in seconds.
 4. Open each alarm initiating and notification circuit to see if trouble signal actuates.
 5. Ground each alarm initiation and notification circuit and verify response of trouble signals.

3.4 FINAL INSPECTION AND ACCEPTANCE

- A. Prior to final acceptance a minimum 30 day "burn-in" period shall be provided. The purpose shall be to allow equipment to stabilize and potential installation and software problems and equipment malfunctions to be identified and corrected. During this diagnostic period, all system operations and malfunctions shall be recorded. Final acceptance will be made upon successful completion of the "burn-in" period and where the last 14 days is without a system or equipment malfunction.
- B. At the final inspection a factory trained representative of the manufacturer of the major equipment shall repeat the tests in Article 3.3 TESTS and those required by NFPA 72. In addition the representative shall demonstrate that the systems function properly in every respect. The demonstration shall be made in the presence of a VA representative.

- - - END - - -

**SECTION 31 20 00
EARTH MOVING**

PART 1 - GENERAL

1.1 DESCRIPTION OF WORK:

- A. This section specifies the requirements for furnishing all equipment, materials, labor, tools, and techniques for earthwork including, but not limited to, the following:
1. Site preparation.
 2. Excavation.
 3. Underpinning.
 4. Filling and backfilling.
 5. Grading.
 6. Soil Disposal.
 7. Clean Up.

1.2 DEFINITIONS:

- A. Unsuitable Materials:
1. Fills: Topsoil; frozen materials; construction materials and materials subject to decomposition; clods of clay and stones larger than 75 mm (3 inches); organic material, including silts, which are unstable; and inorganic materials, including silts, too wet to be stable and any material with a liquid limit and plasticity index exceeding 40 and 15 respectively. Unsatisfactory soils also include satisfactory soils not maintained within 2 percent of optimum moisture content at time of compaction, as defined by ASTM D 698 or AASHTO T 99.
 2. Existing Subgrade (Except Footing Subgrade): Same materials as 1.2.A.1, that are not capable of direct support of slabs, pavement, and similar items with possible exception of improvement by compaction, proofrolling, or similar methods.
 3. Existing Subgrade (Footings Only): Same as paragraph 1, but no fill or backfill. If materials differ from design requirements, excavate to acceptable strata subject to Resident Engineer's approval.
- B. Trench Earthwork: Trenchwork required for utility lines.
- C. Site Earthwork: Earthwork operations required in area outside of a line located 1500 mm (5 feet) outside of principal building perimeter and within new construction area with exceptions noted above.

- D. Degree of compaction: Degree of compaction is expressed as a percentage of maximum density obtained by laboratory test procedure. This percentage of maximum density is obtained through use of data provided from results of field test procedures presented in ASTM D1556, ASTM D2167, and/or ASTM D2922.
- F. Fill: Satisfactory soil materials used to raise existing grades. In the Construction Documents, the term “fill” means fill or backfill as appropriate.
- G. Backfill: Soil materials or controlled low strength material used to fill an excavation.
- H. Unauthorized excavation: Removal of materials beyond indicated sub-grade elevations or indicated lines and dimensions without written authorization by the Resident Engineer. No payment will be made for unauthorized excavation or remedial work required to correct unauthorized excavation.
- I. Authorized additional excavation: Removal of additional material authorized by the Resident Engineer based on the determination by the Government’s soils testing agency that unsuitable bearing materials are encountered at required sub-grade elevations. Removal of unsuitable material and its replacement as directed will be paid on basis of Conditions of the Contract relative to changes in work.
- J. Subgrade: The undisturbed earth or the compacted soil layer immediately below granular sub-base, drainage fill, or topsoil materials.
- K. Structure: Buildings, foundations, slabs, tanks, curbs, mechanical and electrical appurtenances, or other man-made stationary features constructed above or below the ground surface.
- L. Borrow: Satisfactory soil imported from off-site for use as fill or backfill.
- M. Drainage course: Layer supporting slab-on-grade used to minimize capillary flow of pore water.
- N. Bedding course: Layer placed over the excavated sub-grade in a trench before laying pipe. Bedding course shall extend up to the springline of the pipe.
- O. Sub-base Course: Layer placed between the sub-grade and base course for asphalt paving or layer placed between the sub-grade and a concrete pavement or walk.
- P. Utilities include on-site underground pipes, conduits, ducts, and cables as well as underground services within buildings.
- Q. Debris: Debris includes all materials located within the designated work area not covered in the other definitions and shall include but not be limited to items like vehicles, equipment, appliances, building materials or remains thereof, tires, any solid or liquid chemicals or products stored or found in containers or spilled on the ground.

- R. Contaminated soils: Soil that contains contaminants as defined and determined by the Resident Engineer or the Government's testing agency.

1.3 RELATED WORK:

- A. Materials testing and inspection during construction: Section 01 45 29, TESTING LABORATORY SERVICES.
- B. Safety requirements: Section 00 72 00, GENERAL CONDITIONS, Article, ACCIDENT PREVENTION.
- C. Protection of existing utilities, fire protection services, existing equipment, roads, and pavements: Section 01 00 00, GENERAL REQUIREMENTS.
- D. Subsurface Investigation: Section 01 00 00, GENERAL REQUIREMENTS, Article, PHYSICAL DATA.
- E. Erosion Control: Section 01 57 19, TEMPORARY ENVIRONMENTAL CONTROLS, and Section 32 90 00, PLANTING.
- F. Site preparation: Section 31 23 19, DEWATERING, and Section 02 41 00, DEMOLITION.

1.4 CLASSIFICATION OF EXCAVATION

- A. Classified Excavation: Removal and disposal of all material except that material not defined as Rock.
- B. Rock Excavation:
 1. Trenches and Pits: Removal and disposal of solid, homogenous, interlocking crystalline material with firmly cemented, laminated, or foliated masses or conglomerate deposits that cannot be excavated with a late-model, track-mounted hydraulic excavator; equipped with a 1050 mm (42 inch) wide, short-tip-radius rock bucket; rated at not less than 103 kW (138 hp) flywheel power with bucket-curling force of not less than 125 kN (28,090 lbf) and stick-crowd force of not less than 84.5 kN (19,000 lbf); measured according to SAE J-1179. Trenches in excess of 3000 mm (10 feet) wide and pits in excess of 9000 mm (30 feet) in either length or width are classified as open excavation.
 2. Open Excavation: Removal and disposal of solid, homogenous, interlocking crystalline material firmly cemented, laminated, or foliated masses or conglomerate deposits that cannot be dislodged and excavated with a late-model, track-mounted loader; rated at not less than 157 kW (210 hp) flywheel power and developing a minimum of 216 kN (48,510 lbf) breakout force; measured according to SAE J-732.
 3. Other types of materials classified as rock are unstratified masses, conglomerated deposits and boulders of rock material exceeding 0.76 m³ (1 cubic yard) for open excavation, or 0.57

- m3 (3/4 cubic yard) for footing and trench excavation that cannot be removed by rock excavating equipment equivalent to the above in size and performance ratings, without systematic drilling, ram hammering, ripping, or blasting, when permitted.
4. Blasting: Removal and disposal of solid, homogenous, interlocking crystalline material firmly cemented, laminated, or foliated masses or conglomerate deposits that cannot be removed with conventional methods may not be performed by blasting.
 5. Definitions of rock and guidelines for equipment are presented for general information purposes only. The Contractor is expected to use the information presented in the Geotechnical Engineering Report to evaluate the extent and competency of the rock and to determine both quantity estimations and removal equipment and efforts.

1.5 MEASUREMENT AND PAYMENT FOR ROCK EXCAVATION:

- A. Measurement: Cross section and measure uncovered and separated materials, and compute quantities by Registered Professional Land Surveyor or Registered Civil Engineer, specified in Section 01 00 00, GENERAL REQUIREMENTS. Do not measure quantities beyond the following limits:
 1. 600 mm (24 inches) from outside face of concrete work for which forms are required, except for footings.
 2. 300 mm (12 inches) from outside of perimeter of formed footings.
 3. 150 mm (6 inches) below bottom of pipe and not more than pipe diameter plus 600 mm (24 inches) in width for pipe trenches.
 4. From outside dimensions of concrete work for which no forms are required (trenches, conduits, and similar items not requiring forms).
- B. Payment: No separate payment shall be made for rock excavation quantities shown. Contract price and time will be adjusted for overruns or underruns in accordance with "DIFFERING SITE CONDITIONS" (FAR 52.236-2) and "CHANGES" (FAR 52.243-4 and VAAR 852.236-88).

1.6 SUBMITTALS:

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Rock Excavation Report:
 1. Certification of rock quantities excavated.
 2. Excavation method.
 3. Labor.
 4. Equipment.

5. Land Surveyor's or Civil Engineer's name and official registration stamp.

6. Plot plan showing elevation.

C. Furnish to Resident Engineer:

1. Contactor shall furnish resumes with all personnel involved in the project including Project Manager, Superintendent, and on-site Engineer. Project Manager and Superintendent should have at least 3 years of experience on projects of similar size.

2. Soil samples.

- a. Classification in accordance with ASTM D2487 for each on-site or borrow soil material proposed for fill, backfill, engineered fill, or structural fill.
- b. Laboratory compaction curve in accordance with ASTM D 698, D 1557, AASHTO T 99 and/or T 180 for each on site or borrow soil material proposed for fill, backfill, engineered fill, or structural fill.
- c. Test reports for compliance with ASTM D 2940 requirements for subbase material.
- d. Pre-excavation photographs and videotape in the vicinity of the existing structures to document existing site features, including surfaces finishes, cracks, or other structural blemishes that might be misconstrued as damage caused by earthwork operations.
- e. The Contractor shall submit a scale plan daily that defines the location, limits, and depths of the area excavated.

1.7 APPLICABLE PUBLICATIONS:

A. Publications listed below form a part of this specification to extent referenced. Publications are referenced in text by basic designation only.

B. American Association of State Highway and Transportation Officials (AASHTO):

T99-01(2004).....Moisture-Density Relations of Soils Using a 2.5 kg (5.5 lb)

Rammer and a 305 mm (12 inch) Drop

T180-01(2004).....Moisture-Density Relations of Soils using a 4.54 kg (10 lb)

Rammer and a 457 mm (18 inch) Drop

C. American Society for Testing and Materials (ASTM):

D448-03aStandard Classification for Sizes of Aggregate for Road and
Bridge Construction

D698-00ae1.....Standard Test Methods for Laboratory Compaction

Characteristics of Soil Using Standard Effort (12,400 ft. lbf/ft³
(600 kN m/m³))

- D1556-00Standard Test Method for Density and Unit Weight of Soil in Place by the Sand-Cone Method
- D1557-02e1Standard Test Methods for Laboratory Compaction Characteristics of Soil Using Modified Effort (56,000 ft-lbf/ft³ (2700 kN m/m³))
- D2167-94 (2001).....Standard Test Method for Density and Unit Weight of Soil in Place by the Rubber Balloon Method
- D2487-06Standard Classification of Soil for Engineering Purposes (Unified Soil Classification System)
- D2922-05Standard Test Methods for Density of Soil and Soil-Aggregate in Place by Nuclear Methods (Shallow Depth)
- D2940-03Standard Specifications for Graded Aggregate Material for Bases or Subbases for Highways or Airports
- D. Society of Automotive Engineers (SAE):
- J732-92.....Specification Definitions - Loaders
- J1179-02.....Hydraulic Excavator and Backhoe Digging Forces

PART 2 - PRODUCTS

2.1 MATERIALS:

- A. General: Provide borrow soil material when sufficient satisfactory soil materials are not available from excavations.
- B. Fills: Material in compliance with ASTM D2487 Soil Classification Groups GW, GP, GM, SW, SP, SM, SC, and ML, or any combination of these groups; free of rock or gravel larger than 75 mm (3 inches) in any dimension, debris, waste, frozen materials, vegetation, and other deleterious matter. Material approved from on site or off site sources having a minimum dry density of 1760 kg/m³ (110 pcf), a maximum Plasticity Index of 15, and a maximum Liquid Limit of 40.
- C. Engineered Fill: Naturally or artificially graded mixture of compliance with ASTM D2487 Soil Classification Groups GW, GP, GM, SW, SP, SM, SC, and ML, or any combination of these groups, or as approved by the Engineer or material with at least 90 percent passing a 37.5-mm (1 1/2-inch) sieve and not more than 12 percent passing a 75-μm (No. 200) sieve, per ASTM D2940;.

- D. Bedding: Naturally or artificially graded mixture of natural or crushed gravel, crushed stone, and natural or crushed sand; ASTM D2940; except with 100 percent passing a 25 mm (1 inch) sieve and not more than 8 percent passing a 75- μ m (No. 200) sieve.
- E. Drainage Fill: Washed, narrowly graded mixture of crushed stone, or crushed or uncrushed gravel; ASTM D448; coarse-aggregate grading Size 57; with 100 percent passing a 37.5 mm (1 1/2-inch) sieve and 0 to 5 percent passing a 2.36 mm (No. 8) sieve.
- F. Granular Fill:
 - 1. Under concrete slab, crushed stone or gravel graded from 25 mm (1 inch) to 4.75 mm (No. 4), per ASTM D 2940.
 - 2. Bedding for sanitary and storm sewer pipe, crushed stone or gravel graded from 13 mm (1/2 inch) to 4.75 mm (No 4), per ASTM D 2940.

PART 3 - EXECUTION

3.1 SITE PREPARATION:

- A. Clearing: Clear within limits of earthwork operations as shown. Work includes removal of trees, shrubs, fences, foundations, incidental structures, paving, debris, trash, and other obstructions. Remove materials from Medical Center.
- B. Grubbing: Remove stumps and roots 75 mm (3 inch) and larger diameter. Undisturbed sound stumps, roots up to 75 mm (3 inch) diameter, and nonperishable solid objects a minimum of 900 mm (3 feet) below subgrade or finished embankment may be left.
- C. Trees and Shrubs: Trees and shrubs, not shown for removal, may be removed from areas within 4500 mm (15 feet) of new construction and 2250 mm (7.5 feet) of utility lines when removal is approved in advance by Resident Engineer. Remove materials from Medical Center. Box, and otherwise protect from damage, existing trees and shrubs which are not shown to be removed in construction area. Immediately repair damage to existing trees and shrubs by trimming, cleaning and painting damaged areas, including roots, in accordance with standard industry horticultural practice for the geographic area and plant species. Do not store building materials closer to trees and shrubs, that are to remain, than farthest extension of their limbs.
- D. Stripping Topsoil: Strip topsoil from within limits of earthwork operations as specified. Topsoil shall be a fertile, friable, natural topsoil of loamy character and characteristic of locality. Topsoil shall be capable of growing healthy horticultural crops of grasses. Stockpile topsoil and protect as directed by Resident Engineer. Eliminate foreign materials, such as weeds, roots, stones, subsoil, frozen clods, and similar foreign materials larger than 0.014 m³ (1/2 cubic foot) in volume, from soil as it is stockpiled. Retain topsoil on station. Remove foreign materials larger

than 50 mm (2 inches) in any dimension from topsoil used in final grading. Topsoil work, such as stripping, stockpiling, and similar topsoil work shall not, under any circumstances, be carried out when soil is wet so that the composition of the soil will be destroyed.

- E. Concrete Slabs and Paving: Score deeply or saw cut to insure a neat, straight cut, sections of existing concrete slabs and paving to be removed where excavation or trenching occurs. Extend pavement section to be removed a minimum of 300 mm (12 inches) on each side of widest part of trench excavation and insure final score lines are approximately parallel unless otherwise indicated. Remove material from Medical Center.
- F. Lines and Grades: Registered Professional Land Surveyor or Registered Civil Engineer, specified in Section 01 00 00, GENERAL REQUIREMENTS, shall establish lines and grades.
 - 1. Grades shall conform to elevations indicated on plans within the tolerances herein specified. Generally grades shall be established to provide a smooth surface, free from irregular surface changes. Grading shall comply with compaction requirements and grade cross sections, lines, and elevations indicated. Where spot grades are indicated the grade shall be established based on interpolation of the elevations between the spot grades while maintaining appropriate transition at structures and paving and uninterrupted drainage flow into inlets.
 - 2. Locations of existing and proposed elevations indicated on plans, except spot elevations, are approximate from a site survey that measured spot elevations and subsequently generated existing contours and spot elevations. Proposed spot elevations and contour lines have been developed utilizing the existing conditions survey and developed contour lines and may be approximate. Contractor is responsible to notify Resident Engineer of any differences between existing elevations shown on plans and those encountered on site by Surveyor/Engineer described above. Notify Resident Engineer of any differences between existing or constructed grades, as compared to those shown on the plans.
 - 3. Subsequent to establishment of lines and grades, Contractor will be responsible for any additional cut and/or fill required to ensure that site is graded to conform to elevations indicated on plans.
 - 4. Finish grading is specified in Section 32 90 00, PLANTING.
- G. Disposal: All materials removed from the property shall be disposed of at a legally approved site, for the specific materials, and all removals shall be in accordance with all applicable Federal, State and local regulations. No burning of materials is permitted onsite.

3.2 EXCAVATION:

- A. Shoring, Sheet piling and Bracing: Shore, brace, or slope, its angle of repose or to an angle considered acceptable by the Resident Engineer, banks of excavations to protect workmen, banks, adjacent paving, structures, and utilities.
 - 1. Design of the temporary support of excavation system is the responsibility of the Contractor.
 - 2. Construction of the support of excavation system shall not interfere with the permanent structure and may begin only after a review by the Resident Engineer.
 - 3. Extend shoring and bracing to a minimum of 1500 mm (5 feet) below the bottom of excavation. Shore excavations that are carried below elevations of adjacent existing foundations.
- B. Excavation Drainage: Operate pumping equipment, and/or provide other materials, means and equipment as required to keep excavation free of water and subgrade dry, firm, and undisturbed until approval of permanent work has been received from Resident Engineer. Approval by the Resident Engineer is also required before placement of the permanent work on all subgrades.
- C. Subgrade Protection: Protect subgrades from softening, undermining, washout, or damage by rain or water accumulation. Reroute surface water runoff from excavated areas and not allow water to accumulate in excavations. Do not use excavated trenches as temporary drainage ditches. When subgrade for foundations has been disturbed by water, remove disturbed material to firm undisturbed material after water is brought under control. Replace disturbed subgrade in trenches with concrete or material approved by the Resident Engineer.
- D. Proofrolling:
 - 1. After rough grade has been established in cut areas and prior to placement of fill in fill areas under building and pavements, proofroll exposed subgrade with a fully loaded dump truck to check for pockets of soft material.
 - 2. Proofrolling shall consist of at least two complete passes with one pass being in a direction perpendicular to preceding one. Remove any areas that deflect, rut, or pump excessively during proofrolling, or that fail to consolidate after successive passes to suitable soils and replaced with compacted fill. Maintain subgrade until succeeding operation has been accomplished.
- E. Trench Earthwork:
 - 1. Utility trenches (except sanitary and storm sewer):
 - a. Excavate to a width as necessary for sheet piling and bracing and proper performance of the work.

- b. Grade bottom of trenches with bell holes scooped out to provide a uniform bearing.
 - c. Support piping on undisturbed earth unless a mechanical support is shown.
 - d. Length of open trench in advance of piping laying shall not be greater than is authorized by Resident Engineer.
2. Sanitary and storm sewer trenches:
- a. Trench width below a point 150 mm (6 inches) above top of pipe shall be 600 mm (24 inches) maximum for pipe up to and including 300 mm (12 inches) diameter, and four-thirds diameter of pipe plus 200 mm (8 inches) for pipe larger than 300 mm (12 inches). Width of trench above that level shall be as necessary for sheeting and bracing and proper performance of the work.
 - b. Bed bottom quadrant of pipe on undisturbed soil or granular fill.
 - 1) Undisturbed: Bell holes shall be no larger than necessary for jointing. Backfill up to a point 300 mm (12 inches) above top of pipe shall be clean earth placed and tamped by hand.
 - 2) Granular Fill: Depth of fill shall be a minimum of 75 mm (3 inches) plus one sixth of pipe diameter below pipe to 300 mm (12 inches) above top of pipe. Place and tamp fill material by hand.
 - c. Place and compact as specified remainder of backfill using acceptable excavated materials. Do not use unsuitable materials.
 - d. Use granular fill for bedding where rock or rocky materials are excavated.
- F. Site Earthwork: Earth excavation includes excavating pavements and obstructions visible on surface; underground structures, utilities, and other items indicated to be removed; together with soil, boulders, and other materials not classified as rock or unauthorized excavation. Excavation shall be accomplished as required by drawings and specifications. Excavate to indicated elevations and dimensions within a tolerance of plus or minus 25 mm (1 inch). Extend excavations a sufficient distance from structures for placing and removing concrete formwork, for installing services and other construction, complying with OSHA requirements, and for inspections. Remove subgrade materials that are determined by Resident Engineer as unsuitable, and replace with acceptable material. If there is a question as to whether material is unsuitable or not, the contractor shall obtain samples of the material, under the direction of the Resident Engineer, and the materials shall be examined by an independent testing laboratory for soil classification to determine whether it is unsuitable or not. When unsuitable material is encountered and removed, contract price and time will be adjusted in accordance with Articles,

DIFFERING SITE CONDITIONS, CHANGES and CHANGES-SUPPLEMENT of the GENERAL CONDITIONS as applicable. Adjustments to be based on volume in cut section only.

1. Site Grading:

- a. Provide a smooth transition between adjacent existing grades and new grades.
- b. Cut out soft spots, fill low spots, and trim high spots to comply with required surface tolerances.
- c. Slope grades to direct water away from buildings and to prevent ponds from forming where not designed. Finish subgrades to required elevations within the following tolerances:
 - 1) Lawn or Unpaved Areas: Plus or minus 25 mm (1 inch).
 - 2) Walks: Plus or minus 25 mm (1 inch).
 - 3) Pavements: Plus or minus 13 mm (1 inch).
- d. Grading Inside Building Lines: Finish subgrade to a tolerance of 13 mm (1/2 inch) when tested with a 3000 mm (10 foot) straightedge.

3.3 FILLING AND BACKFILLING:

- A. General: Do not fill or backfill until all debris, water, unsatisfactory soil materials, obstructions, and deleterious materials have been removed from excavation. For fill and backfill, use excavated materials and borrow meeting the criteria specified herein, as applicable. Borrow will be supplied at no additional cost to the Government. Do not use unsuitable excavated materials. Do not backfill until foundation walls have been completed above grade and adequately braced, waterproofing or dampproofing applied, foundation drainage, and pipes coming in contact with backfill have been installed and work inspected and approved by Resident Engineer.
- B. Placing: Place materials in horizontal layers not exceeding 200 mm (8 inches) in loose depth for material compacted by heavy compaction equipment, and not more than 100 mm (4 inches) in loose depth for material compacted by hand-operated tampers and then compacted. Place backfill and fill materials evenly on all sides of structures to required elevations, and uniformly along the full length of each structure. Place no material on surfaces that are muddy, frozen, or contain frost.
- C. Compaction: Compact with approved tamping rollers, sheepfoot rollers, pneumatic tired rollers, steel wheeled rollers, vibrator compactors, or other approved equipment (hand or mechanized) well suited to soil being compacted. Do not operate mechanized vibratory compaction equipment within 3000 mm (10 feet) of new or existing building walls without prior approval of Resident Engineer. Moisten or aerate material as necessary to provide moisture content that will readily

facilitate obtaining specified compaction with equipment used. Compact soil to not less than the following percentages of maximum dry density, according to ASTM D698 or ASTM D1557 as specified below:

1. Fills, Embankments, and Backfill

- a. Under proposed structures, steps, and paved areas, scarify and recompact top 300 mm (12 inches) of existing subgrade and each layer of backfill or fill material in accordance with AASHTO T99 and/or ASTM D698 95 percent.
- b. Curbs, curbs and gutters, AASHTO T99 and/or ASTM D698 95 percent.
- c. Under Sidewalks, scarify and recompact top 150 mm (6 inches) below subgrade and compact each layer of backfill or fill material in accordance with AASHTO T99 and/or ASTM D698 95 percent.
- d. Landscaped areas, top 400 mm (16 inches), AASHTO T99 and/or ASTM D698 85 percent.
- e. Landscaped areas, below 400 mm (16 inches) of finished grade, AASHTO T99 and/or ASTM D698 90 percent.

2. Natural Ground (Cut or Existing)

- a. Under steps and paved areas, top 150 mm (6 inches), AASHTO T99 and/or ASTM D698 95 percent.
- b. Curbs, curbs and gutters, top 150 mm (6 inches), ASHTO T99 and/or ASTM D698 95 percent.
- c. Under sidewalks, top 150 mm (6 inches), AASHTO T99 and/or ASTM D698 95 percent.

3.4 GRADING:

- A. General: Uniformly grade the areas within the limits of this section, including adjacent transition areas. Smooth the finished surface within specified tolerance. Provide uniform levels or slopes between points where elevations are indicated, or between such points and existing finished grades. Provide a smooth transition between abrupt changes in slope.
- B. Cut rough or sloping rock to level beds for foundations. In pipe spaces or other unfinished areas, fill low spots and level off with coarse sand or fine gravel.
- C. Slope backfill outside building away from building walls for a minimum distance of 1800 mm (6 feet).
- D. Finish grade earth floors in pipe basements as shown to a level, uniform slope and leave clean.
- E. Finished grade shall be at least 150 mm (6 inches) below bottom line of window or other building wall openings unless greater depth is shown.

- F. Place crushed stone or gravel fill under concrete slabs on grade, tamped, and leveled. Thickness of fill shall be 150 mm (6 inches) unless otherwise shown.
- G. Finish subgrade in a condition acceptable to Resident Engineer at least one day in advance of paving operations. Maintain finished subgrade in a smooth and compacted condition until succeeding operation has been accomplished. Scarify, compact, and grade subgrade prior to further construction when approved compacted subgrade is disturbed by Contractor's subsequent operations or adverse weather.
- H. Grading for Paved Areas: Provide final grades for both subgrade and base course to +/- 6 mm (0.25 inches) of indicated grades.

3.5 DISPOSAL OF UNSUITABLE AND EXCESS EXCAVATED MATERIAL:

- A. Disposal: Remove surplus satisfactory soil and waste material, including unsatisfactory soil, trash, and debris, and legally dispose of it off Medical Center property.
- B. Place excess excavated materials suitable for fill and/or backfill on site where directed.
- C. Remove from site and dispose of any excess excavated materials after all fill and backfill operations have been completed.
- D. Segregate all excavated contaminated soil designated by the Resident Engineer from all other excavated soils, and stockpile on site on two 0.15 mm (6 mil) polyethylene sheets with a polyethylene cover. A designated area shall be selected for this purpose. Dispose of excavated contaminated material in accordance with State and Local requirements.

3.6 CLEAN UP:

Upon completion of earthwork operations, clean areas within contract limits, remove tools, and equipment. Provide site clear, clean, free of debris, and suitable for subsequent construction operations. Remove all debris, rubbish, and excess material from Medical Center.

----- E N D -----

SECTION 31 23 19 DEWATERING

PART 1 - GENERAL

1.1 DESCRIPTION:

This section specifies performance of dewatering required to lower and control ground water table levels and hydrostatic pressures to permit excavation, backfill, and construction to be performed in the dry. Control of surface water shall be considered as part of the work under this specification.

1.2 SUMMARY:

- A. The work to be completed by the Contractor includes, but is not necessarily limited to the following:
 - 1. Implementation of the Erosion and Sedimentation Control Plan.
 - 2. Dewater excavations, including seepage and precipitation.
- B. The Contractor shall be responsible for providing all materials, equipment, labor, and services necessary for care of water and erosion control. Excavation work shall not begin before the Erosion and Sedimentation Control Plan is in place.

1.3 REQUIREMENT:

- A. Dewatering system shall be of sufficient size and capacity necessary to lower and maintain ground water table to an elevation at least 300 mm (1 foot) below lowest foundation subgrade or bottom of pipe trench and to allow material to be excavated in a reasonably dry condition. Materials to be removed shall be sufficiently dry to permit excavation to grades shown and to stabilize excavation slopes where sheeting is not required. Operate dewatering system continuously until backfill work has been completed.
- B. Reduce hydrostatic head below any excavation to the extent that water level in the construction area is a minimum of 300 mm (1 foot) below prevailing excavation surface.
- C. Prevent loss of fines, seepage, boils, quick conditions or softening of foundation strata.
- D. Maintain stability of sides and bottom of excavation.
- E. Construction operations are performed in the dry.
- F. Control of surface and subsurface water is part of dewatering requirements. Maintain adequate control so that:
 - 1. The stability of excavated and constructed slopes are not adversely affected by saturated soil, including water entering prepared subbase and subgrades where underlying materials are not free draining or are subject to swelling or freeze-thaw action.

2. Erosion is controlled.
3. Flooding of excavations or damage to structures does not occur.
4. Surface water drains away from excavations.
5. Excavations are protected from becoming wet from surface water, or insure excavations are dry before additional work is undertaken.

G. Permitting Requirements: The contractor shall comply with and obtain the required State and County permits where the work is performed.

1.4 RELATED WORK:

- A. Materials testing and inspection during construction: Section 01 45 29, TESTING LABORATORY SERVICES.
- B. Safety Requirements: Section 00 72 00, GENERAL CONDITIONS, Article, ACCIDENT PREVENTION.
- C. Submittal requirements as specified in Section 01 33 23 SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- D. Protection of existing utilities, fire protection services, existing equipment, roads, and pavements: Section 01 00 00, GENERAL REQUIREMENTS.
- E. Subsurface Investigation: Section 01 00 00, GENERAL REQUIREMENTS, Article 1.11, PHYSICAL DATA.
- F. Excavation, backfilling, site grade and utilities: Section 31 20 00, EARTH MOVING.

1.5 SUBMITTALS:

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Drawings and Design Data:
 1. Submit drawings and data showing the method to be employed in dewatering excavated areas 30 days before commencement of excavation.
 2. Material shall include: location, depth and size of wellpoints, headers, sumps, ditches, size and location of discharge lines, capacities of pumps and standby units, and detailed description of dewatering methods to be employed to convey the water from site to adequate disposal.
 3. Include a written report outlining control procedures to be adopted if dewatering problem arises.

4. Materials submitted shall be in a format acceptable for inclusion in required permit applications to any and all regulatory agencies for which permits for discharge water from the dewatering system are required due to the discharge reaching regulated bodies of water.

C. Inspection Reports.

D. All required permits.

PART 2 - PRODUCTS (NOT USED)

PART 3 - EXECUTION

3.1 INSTALLATION:

- A. Install a dewatering system to lower and control ground surface water in order to permit excavation, construction of structure, and placement of backfill materials to be performed under dry conditions. Make the dewatering system adequate to pre-drain the water-bearing strata above and below the bottom of structure foundations, utilities and other excavations.
- B. In addition, reduce hydrostatic pressure head in water-bearing strata below structure foundations, utility lines, and other excavations, to extent that water levels in construction area are a minimum of 300 mm (1 foot) below prevailing excavation surface at all times.

3.2 OPERATION:

- A. Prior to any excavation below the ground water table, place system into operation to lower water table as required and operate it continuously 24 hours a day, 7 days a week until utilities and structures have been satisfactorily constructed, which includes the placement of backfill materials and dewatering is no longer required.
- B. Place an adequate weight of backfill material to prevent buoyancy prior to discontinuing operation of the system.

3.3 WATER DISPOSAL:

- A. Dispose of water removed from the excavations in such a manner as:
 1. Will not endanger portions of work under construction or completed.
 2. Will cause no inconvenience to Government or to others working near site.
 3. Will comply with the stipulations of required permits for disposal of water.
 4. Will Control Runoff: The Contractor shall be responsible for control of runoff in all work areas including but not limited to: excavations, access roads, parking areas, laydown, and staging areas. The Contractor shall provide, operate, and maintain all ditches, basins, sumps, culverts, site grading, and pumping facilities to divert, collect, and remove all water from the work areas. All water shall be removed from the immediate work areas and shall be disposed of in accordance with applicable permits.

B. Excavation Dewatering:

1. The Contractor shall be responsible for providing all facilities required to divert, collect, control, and remove water from all construction work areas and excavations.
2. Drainage features shall have sufficient capacity to avoid flooding of work areas.
3. Drainage features shall be so arranged and altered as required to avoid degradation of the final excavated surface(s).
4. The Contractor shall utilize all necessary erosion and sediment control measures as described herein to avoid construction related degradation of the natural water quality.

C. Dewatering equipment shall be provided to remove and dispose of all surface and ground water entering excavations, trenches, or other parts of the work during construction. Each excavation shall be kept dry during subgrade preparation and continually thereafter until the structure to be built, or the pipe to be installed therein, is completed to the extent that no damage from hydrostatic pressure, flotation, or other cause will result.**3.4 STANDBY EQUIPMENT:**

Provide complete standby equipment, installed and available for immediate operation, as may be required to adequately maintain de-watering on a continuous basis and in the event that all or any part of the system may become inadequate or fail.

3.5 CORRECTIVE ACTION:

If dewatering requirements are not satisfied due to inadequacy or failure of the dewatering system (loosening of the foundation strata, or instability of slopes, or damage to foundations or structures), perform work necessary for reinstatement of foundation soil and damaged structure resulting from such inadequacy or failure by Contractor, at no additional cost to Government.

3.6 DAMAGES:

Immediately repair damages to adjacent facilities caused by dewatering operations.

3.7 REMOVAL:

Insure compliance with all conditions of regulating permits and provide such information to the Resident Engineer. Obtain written approval from Resident Engineer before discontinuing operation of dewatering system.

----- E N D -----

SECTION 31 23 23.33 FLOWABLE FILL

PART 1 - GENERAL

1.1 DESCRIPTION:

- A. Flowable fill refers to a cementitious slurry consisting of a mixture of fine aggregate or filler, water, and cementitious material(s), which is used as a fill or backfill in lieu of compacted earth. This mixture is capable of filling all voids in irregular excavations and hard to reach places (such as under undercuts of existing slabs), is self-leveling, and hardens in a matter of a few hours without the need for compaction in layers. Flowable fill is sometimes referred to as controlled density fill (CDF), controlled low strength material (CLSM), lean concrete slurry, and unshrinkable fill.
- B. Flowable fill materials will be used as only as a structural fill replacement on VA projects. // Unless otherwise noted, flowable fill installed as a substitution for structural earth fill, shall not be designed to be removed by the use of hand tools. The materials and mix design for the flowable fill should be designed // to produce a comparable compressive strength to the surrounding soil after hardening, making excavation at a later time possible .

1.2 DESCRIPTION:

- A. Furnish and place flowable fill in a fluid condition, that sets within the required time and, after curing, obtains the desired strength properties as evidenced by the laboratory testing of the specific mix design, at locations shown on the plans or as directed by the Resident Engineer, in writing. This section specifies flowable fill for use as structural fill to remain easily excavatable using a backhoe as would be utilized for adjoining earth.

1.3 RELATED WORK:

- A. Materials testing and inspection during construction: Section 01 45 29, TESTING LABORATORY SERVICES.
- B. Earthwork, excavation and backfill and compaction requirements: Section 31 20 00, EARTH MOVING.

1.4 DEFINITIONS:

- A. Flowable fill - Ready-mix Controlled Low Strength Material used as an alternative to compacted soil, and is also known as controlled density fill, and several other names, some of which are trademark names of material suppliers. Flowable fill (Controlled Low Strength Material) differs from portland cement concrete as it contains a low cementitious content to reduce strength development for possible future removal. Unless specifically approved

otherwise, by the Resident Engineer, flowable fill shall be designed as a permanent material, not designed for future removal. Design strength for this permanent type flowable fill shall be a compressive strength of 2.1 MPa (300 psi) minimum at 28 days. Chemical admixtures may also be used in flowable fill to modify performance properties of strength, flow, set and permeability.

- B. Excavatable Flowable fill – flowable fill designed with a compressive strength that will allow excavation as either machine tool excavatable at compressive strength of 1.5 MPa (200 psi) maximum at 1 year, or hand tool excavatable at compressive strength of 0.7 MPa (100 psi) maximum at 1 year.

1.5 SUBMITTALS:

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Flowable fill Mix Design: Provide flowable fill mix design containing cement and water. At the contractor's option, it may also contain fly ash, aggregate, or chemical admixtures in any proportions such that the final product meets the strength and flow consistency, and shrinkage requirements included in this specifications.
 - 1. Test and Performance - Submit the following data:
 - a. Flowable fill shall have a minimum strength of 2.1 MPa (300 psi) according to ASTM C 39 at 28 days after placement.
 - b. Flowable fill shall have minimal subsidence and bleed water shrinkage. Evaporation of bleed water shall not result in shrinkage of more than 10.4 mm per m (1/8 inch per ft.) of flowable fill depth (for mixes containing high fly ash content). Measurement of a Final Bleeding shall be as measured in Section 10 of ASTM C 940 "Standard Test Method for Expansion and Bleeding of Freshly Mixed Grouts for Preplaced-Aggregate Concrete in the Laboratory.
 - c. Flowable fill shall have a unit weight of // 1500 - 1900 kg/m³ (90 - 115 lbs/feet 3) // 1900 – 2300 kg/m³ (115 – 145 lb/feet 3) // 320 – 1300 kg/m³ (20 – 80 lb/feet 3) // measured at the point of placement after a 60 minute ready-mix truck ride.
- C. Provide documentation that the admixture supplier has experience of at least one year, with the products being provided and any equipment required to obtain desired performance of the product.

- D. Manufacturer's Certificates: Provide Resident Engineer with a certification that the materials incorporated in the flowable fill, following achievement of the required strength, do not represent a threat to groundwater quality.

1.6 QUALITY ASSURANCE:

- A. Manufacturer: Flowable fill shall be manufactured by a ready-mix concrete producer with a minimum of 1 year experience in the production of similar products.
- B. Materials: For each type of material required for the work of this Section, provide primary materials that are the products of one manufacturer. If not otherwise specified here, materials shall comply with recommendations of ACI 229, "Controlled Low Strength Materials."
- C. Pre-Approval Procedures: The use of flowable fill during any part of the project shall be restricted to those incidences where, due to field conditions, the Contractor has made the Resident Engineer aware of the conditions for which he recommends the use of the flowable, and the Resident Engineer has confirmed those conditions and approved the use of the flowable fill, in advance. During the submittal process, the contractor shall prepare and submit various flowable fill mix designs corresponding to required conditions or if the contractor desires to use flowable fill due to economics. Approval for the strength of the flowable fill shall be obtained from the Resident Engineer when the contractor desires, or is required, to use flowable fill at specific location(s) within the project. Prior to commencement of field operations the contractor shall establish procedures to maintain optimum working conditions and to coordinate this work with related and adjacent work.

1.7 DELIVERY, STORAGE, AND HANDLING:

- A. Deliver and handle all products and equipment required, in strict compliance with manufacturer's recommendations. Protect from damage due to weather, excessive temperatures, and construction operations.

1.8 PROJECT CONDITIONS:

- A. Perform installation of flowable fill only when approved by the Resident Engineer, and when existing and forecasted weather conditions are within the limits established by the manufacturer of the materials and products used.

1.9 APPLICABLE PUBLICATIONS

- A. Publications listed below form a part of this specification to extent referenced. Publications are referenced in text by basic designation only.
- B. American Society for Testing and Materials (ASTM):

- C618-03Standard Specifications for Coal Fly Ash and Raw or Calcined Natural Pozzolan for use as Mineral Admixture in Concrete.
(Use Fly Ash conforming to the chemical and physical requirements for mineral admixture, Class F listed, including Table 2 (except for Footnote A). Waive the loss on ignition requirement.)
- C403/C403M-05Standard Test Method for Time of Setting of Concrete Mixtures by Penetration Resistance.
- C150-99 Rev.A-04Standard Specification for Portland Cement
- C33-03Standard Specification for Concrete Aggregates
- C494/C494M-04Standard Specification for Chemical Admixtures for Concrete
- C940 RevA-98Standard Specification for Expansion and Bleeding of Freshly Mixed Grouts for Preplaced – Aggregate Concrete in the Laboratory
- D4832-02Standard Test Method for Preparation and Testing of Controlled Low Strength Material (CLSM) Test Cylinders.
- C. American Concrete Institute (ACI):
- SP-150-94Controlled Low-Strength Materials

PART 2 - PRODUCTS

2.1 MATERIALS

- A. Provide flowable fill containing, at a minimum, cementitious materials and water. Cementitious materials shall be portland cement, pozzolanic materials, or other self-cementing materials, or combinations thereof, at the contractor's option, and following approval by the Resident Engineer. The flowable fill mix design may also contain, fine aggregate or filler, and/or chemical admixtures in any proportions such that the final product meets the strength, flow consistency and shrinkage requirements included in this specification, as approved by the Resident Engineer.
- B. Portland Cement: ASTM C150, Type 1 and/or Type 2. Meeting Iowa State DOT standards.
- C. Mixing Water: Fresh, clean, and potable. Meeting Iowa State DOT standards for use as mix-water for cast-in-place concrete.
- D. Air-Entraining Admixture: ASTM C260.
- E. Chemical Admixtures: ASTM C494.
- F. Aggregate: ASTM C33.

2.2 FLOWABLE FILL MIXTURE:

- A. Mix design shall produce a consistency that will result in a flowable product at the time of placement which does not require manual means to move it into place.
- B. Flowable fill shall have a minimum strength of 2.1 MPa (300 psi) according to ASTM C39 at 28 days after placement.
- C. Flowable fill shall have minimal subsidence and bleed water shrinkage. Evaporation of bleed water shall not result in shrinkage of more than 10.4 mm per m (1/8 inch per foot) of flowable fill depth (for mixes containing high fly ash content). Measurement of a Final Bleeding shall be as measured in Section 10 of ASTM C 940 "Standard Test Method for Expansion and Bleeding of Freshly Mixed Grouts for Preplaced-Aggregate Concrete in the Laboratory.
- D. Flowable fill shall have a unit weight of // 1500 - 1900 kg/m³(90 - 115 lbs/feet³), 1900 – 2300 kg/m³ (115 – 145 lbs/feet³), or 320 – 1300 kg/m³ (20 – 80 lbs/feet³) depending on the location of fill, measured at the point of placement after a 60 minute ready-mix truck ride. In the absence of strength data the cementitious content shall be a maximum of 90 kg/m³ (150 lbs/cy).
- E. Flowable fill shall have an in-place yield of at least 98% of design yield for permanent type.
- F. Provide equipment as recommended by the Manufacturer and comply with manufacturer's recommendations for the addition of additives, whether at the production plant or prior to placement at the site.

PART 3 - EXECUTION**3.1 EXAMINATION:**

- A. Examine conditions of substrates and other conditions under which work is to be performed and notify Resident Engineer, in writing, of circumstances detrimental to the proper completion of the work. Do not proceed until unsatisfactory conditions are corrected.

3.2 APPLICATION OF FLOWABLE FILL:

- A. Secure tanks, pipes and other members to be encased in flowable fill. Insure that there are no exposed metallic pipes, conduits, or other items that will be in contact with the flowable fill after placement. If so, replace with non-metallic materials or apply manufacturers recommended coating to protect metallic objects before placing the flowable fill. Replacement or protection of metallic objects is subject to the approval of the Resident Engineer.

3.3 PROTECTION AND CURING:

- A. Protect exposed surfaces of flowable fill from premature drying, wash by rain or running water, wind, mechanical injury, and excessively hot or cold temperature. Curing method shall be subject to approval by Resident Engineer.

- - - E N D - - -

SECTION 31 63 16
AUGER CAST GROUT PILES

PART 1 - GENERAL

1.1 DESCRIPTION:

- A. This section specifies equipment, controls and accessories required to provide low energy power assisted automatic operation of swing doors. The door operator system shall be complete including operator, controls, door arm and operator enclosure (header and cover).
- B. This section specifies excavation and concrete required for construction of auger-placed concrete piles.

1.2 DEFINITION

- A. Auger-placed concrete pile (ACP): Pile formed by rotation of a continuous flight hollow-shaft pile augured into the ground to the indicated depth. Grout is injected through auger shaft as auger is being withdrawn in such a way as to exert removing pressure on withdrawing earth-filled auger as well as lateral pressure on soil surrounding hole.

1.3 RELATED WORK

- A. Materials testing and inspection during construction: Section 01 45 29, TESTING LABORATORY SERVICES.
- B. Concrete: Section 03 30 00, CAST-IN-PLACE CONCRETE.
- C. Subsurface investigation: Section 01 00 00, GENERAL REQUIREMENTS, Article, PHYSICAL DATA.

1.4 CONTRACT BASIS

- A. Contract price for ACP's will be based upon total length of piles shown on the Contract Documents. Length of piles will be measured as shown.
- B. Adjustment of Contract Price:
 - 1. Adjustment of contract price shall be based upon total length of piles placed, and not on length of individual piles placed.
 - 2. When total length of completed piles is greater or less than length shown, contract price and time adjustment will be made in accordance with Articles, DIFFERING SITE CONDITIONS, CHANGES and CHANGES-SUPPLEMENT of the GENERAL CONDITIONS as applicable.

1.5 TOLERANCES

- A. Install piling with a maximum variation of 75 mm (3 inches) of center of any pile from the location shown. Piles shall not be out of plumb more than 2 percent. (Checked by using a hand level prior to the start of drilling).

1.6 DESIGN MODIFICATIONS

- A. Where piles are installed exceeding specified tolerances for plumb or location, the foundation design will be analyzed by the Government and if necessary redesigned by the Government. Costs for analysis, redesign, and remediation shall be responsibility of Contractor.
- B. If modifications are necessitated as a result incorrectly placed, incorrectly drilled or in other ways deficient ACPs (as defined in this Section), such piles and pile cap modifications, the cost of redesign, and the furnishing and installation of additional pile or pile caps shall be at no additional cost to the Government.

1.7 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Certification to Examination of Site and Records: Before proceeding with the Work, submit copy of certification in acceptable form signed by the Contractor, stating that careful examination has been made of the site, existing structures, and records of utility lines, test boring records, soil samples, and subsurface exploration reports by the Owner's Geotechnical Engineer, Drawings, and Specifications.
- C. Product Data: Submit copies of manufacturers' specifications for the following products, including copies of laboratory test reports and other data as may be required to show compliance with these specifications.
 - 1. Portland cement.
 - 2. Fly Ash
 - 3. Ground Granulated Blast Furnace Slag
 - 4. Plasticizing admixture
 - 5. Aggregate sieve analysis.
 - 6. Aggregate sodium sulfate soundness tests.
 - 7. Reinforcing Steel
 - 8. Other supplementary items as necessary

D. Shop Drawings and Miscellaneous Submittals:

1. Description of pile drilling equipment.
2. Description of grout pump and pressure gage calibration reports.
3. Pile Installation Recorder (PIR) description and calibration reports.
4. Complete description of method for ACP pile installation with a pile layout plan referenced to the structural plans, including a numbering system capable of identifying each individual pile, pile sizes, including pile length and tip elevations, reinforcing steel, and waterproofing details. In addition, furnish a detailed description of construction procedures, including steel shells, if used, and auguring methods.
5. Steel Reinforcement Shop Drawings: Comply with ACI 315. Furnish shop drawings prepared by a Professional Engineer licensed in the state of installation that include placing drawings that detail fabrication, bending, and placement. Include bar sizes, lengths, material, grade, bar schedules, stirrup spacing, bent bar diagrams, bar arrangement, splices and laps, mechanical connections, tie spacing, hoop spacing, and supports for concrete reinforcement.
 - a. Indicate steel grades, sizes, bending details, protective coatings, spacing, placement and supports.
 - b. Certifications: Furnish manufacturer's certified reports of mill tests for reinforcing steel and anchorage devices, including physical and chemical analysis.

E. Reports:

1. Submit 3 copies of the laboratory testing reports to the Resident Engineer, the owner's Geotechnical Consultant, and other pertinent parties.
 - a. Submit report and certification of aggregate.
 - b. Submit for laboratory evaluation grout materials and mix designs.
 - c. Submit laboratory report on grout as sampled at the auger site.
2. Pile Installation records for all ACP's.
 - a. Installation of each pile
 - b. Pile location and plumbness
 - c. Total quantity of grout placed
 - d. Load Test
 - e. Pile Installation Recorder (PIR) reports.

F. Certifications:

1. Installing Contractor's Qualifications:
 2. Independent Testing and Inspection Agency Qualifications
 3. Welders' Qualification.
 4. Land Surveyor Qualifications.
- G. Record drawings at Project closeout according to Division 01 Section "Closeout Procedures."
1. Upon completion of ACP installations, the Contractor shall submit five copies of drawings indicating actual in-place pile locations and signed by licensed Land Surveyor.
 2. Drawings must be submitted prior to beginning any pile cap or mat installation.
 3. One electronic copy of the drawings shall be submitted in AutoCAD DWG format on CD-ROM.

1.8 QUALITY ASSURANCE

- A. Installing Contractor Qualifications:
1. Must be approved by the Contracting Officer based on experience and past performance.
 2. Contractor shall have installed ACP's on three installations similar and equivalent to this project for 5 years. Submit list of installations.
 3. Contractor shall have a satisfactory record of performance.
- B. Owner Geotechnical Consultant: The Owner shall retain the services of a Geotechnical Consultant (Consultant) to provide general observation of all pile operations and to provide technical advice to the Owner with regard to pile operations and performance.
- C. Contractor's Independent Testing and Inspection Agency (Agency): The Contractor shall retain at his own expense, the services of a qualified Independent Testing and Inspection Agency, licensed in the state of the project, to provide testing and inspection services during the installation of all foundation piling involved in this Work.
1. Agency Purpose: This firm shall also provide consultation services to the Contractor if problems are encountered during the execution of the Work. The Agency shall be primarily concerned with the testing and construction methods which will result in finished foundation piling of the required quality and strength. The Agency shall also be concerned with preventing settlement and/or damage to surrounding structures, roads, utilities, embankments, etc., both within the property lines and on adjoining properties during the construction. This Agency shall

2. Agency Qualifications: Shall have been involved in at least 8 different ACP projects in the last 5 years, and shall have experience in recommending, testing, and specifying ACP's for similar subsurface conditions.
 3. Agency shall submit field reports and test results required by Section 3.2 for pile load tests, pile installations, and grout testing and inspection.
 4. Agency shall submit a pile installation report for each pile no later than three days after the installation is complete.
- D. The Contractor and their Agency shall cooperate with the Consultant and the Resident Engineer in the performance of the Work. The presence of Consultant shall in no way relieve the Contractor of his obligation to perform the pile installation in accordance with the Contract Documents and these Specifications.
- E. Welding Standards: Qualify procedures and personnel according to the following:
1. AWS D1.1
 2. AWS D1.4

1.9 QUALITY CONTROL

- A. Contractor's Quality Control Responsibilities: Contractor is solely responsible for quality control of the Work.
- B. A Quality Control Program shall be submitted by the Contractor at least two weeks prior to the commencement of work. The implementation of a Contractor Quality Control Program does not relieve the Contractor from the responsibility to provide work in accordance with the Contract Documents, applicable codes, regulations, and Governing Authorities.
- C. Survey Work: The Contractor shall engage a qualified land surveyor or professional engineer to perform surveys, layouts, and measurements for ACP's. The surveyor shall record actual measurements of each ACP's location, shaft diameter, bottom and top elevations, deviations from specified tolerances, and other specified data.
- D. Contractor's Grout Mix Designer: The Contractor shall employ, at his own expense, a testing laboratory to design grout mixes, conduct tests and submit reports for the design mixes. The Grout Mix Designer shall be qualified according to ASTM C1077 and ASTM E329 to perform material evaluation tests and to design concrete mixes, as documented according to ASTM E548.

1.10 APPLICABLE PUBLICATIONS

- A. Publications listed below form a part of this specification to extent referenced. Publications are referenced in text by basic designation only.

- B. American Society for Testing and Materials (ASTM):
- A615/A615M-06a.....Standard Specification for Deformed and Plain Carbon-Steel Bar
for Concrete Reinforcement
 - A722/A722M-05.....Standard Specification for Uncoated High-Strength Steel Bar for
Prestressing Concrete
 - C33-03Standard Specification for Concrete Aggregates
 - C109/C109M-05Standard Test Method for Compressive Strength of Hydraulic
Cement Mortars (using 2-in. or [50 mm] Cube Specimens)
 - C150-05Standard Specification for Portland Cement
 - C404-06Standard Specification for Aggregates for Masonry Grout
 - C618-05Standard Specification for Coal Fly Ash and Raw or Calcined
Natural Pozzolan for Use in Concrete
 - C937-02Standard Specification for Grout Fluidifier for Preplaced-
Aggregate Concrete
 - C942-99 (2004).....Compressive Strength of Grouts for Preplaced-Aggregate
Concrete in the Laboratory
 - C989-05Standard Specification for Ground Granulated Blast-Furnace
Slag for Use in Concrete and Mortars
 - C1017/C1017M-03Standard Specification for Chemical Admixtures for Use in
Producing Flowing Concrete
 - C1077-06Standard Practice for Laboratories Testing Concrete and
Concrete Aggregates for Use in Construction and Criteria for
Laboratory Evaluation
 - D1143-81(1994)e1.....Standard Test Method for Piles Under Static Axial Compressive
Load
 - E329-05be1Standard Specification for Agencies Engaged in Construction
Inspections and/or Testing
 - E548-94.....Standard Guide for General Criteria Used for Evaluating
Laboratory Competence
- C. American Concrete Institute (ACI):
- 315-99Manual of Standard Practice for Detailing Reinforced Concrete
Structures
- D. American Welding Society (AWS):

D1.1 (2006).....Structural Welding Code – Steel

D1.4 (2005).....Structural Welding Code – Reinforcing Steel

PART 2 - PRODUCTS

2.1 MATERIALS

- A. Portland Cement: ASTM C150, Type I, Test piles Type III.
- B. Plasticizing admixture: ASTM C1017/C1017M, Type II
- C. Fly Ash: ASTM C618, Class C or F.
- D. Ground Granulated Blast Furnace Slag: ASTM C989, Grade 100 or 120.
- E. Water: Fresh, clean, and potable.
- F. Aggregate: ASTM C404, Size No. 1 or Size No. 2.
- G. Reinforcing Steel: ASTM A615, Grade 60.
- H. Fine Aggregate: ASTM C33.
- I. High Strength Reinforcing Steel: ASTM A722, Type II, Thread Bar Type
- J. Except for probe pile, pile load test and test pile purposes, no pile materials shall be ordered or delivered to the job site until the required load tests have been made and are acceptable to the Resident Engineer. Materials ordered or delivered to the project site prior to verification of the assumed pile length, will be at the Contractor's risk.
- K. After pile lengths are verified by the pile load test program, deliver materials to the project site in such quantities and at such times to assure the continuity of pile augering operations to the project schedule.
- L. Clearly mark pile leads in 300 mm (1 foot) increments.

2.2 MIXES

- A. Concrete: The grout used shall consist of a mixture of portland cement, sand, plasticizer and water so proportioned and mixed to be pumped into the hole through the auger. Mixture shall be proportioned to provide a minimum compressive strength as indicated by analysis of the Agency.
- B. Mix Design: Agency (testing laboratory retained by Contractor) shall design a mix to produce concrete as specified and perform tests as required. Certified test reports (duplicate) shall be submitted. Reports shall include proportions of design mix.
- C. Submit proposed mix design for review by the Consultant the Resident Engineer.
- D. Concrete-mix design adjustments may be considered if characteristics of materials, Project conditions, weather, test results, or other circumstances warrant. Resubmit and obtain approval from the Resident Engineer of proposed changes to concrete-mix design.

- E. Improper Mix: Immediately notify the Consultant and the Resident Engineer if at any time during construction the accepted mix design proves to be unsatisfactory for any reason. The Contractor's Concrete Mix Designer shall modify the design, subject to the review of the Resident Engineer and the Consultant, until a satisfactory mix is obtained.

2.3 EQUIPMENT

A. Augering Equipment:

1. Equipment shall consist of a continuous-flight, hollow-shaft auger designed drilling and delivering grout under pressure and permit placing of reinforcement.
2. The auger flighting shall be continuous from the auger head to the top of auger without gaps or other breaks. The auger flighting shall be uniform in diameter throughout its length and shall be the diameter specified for the piles less a maximum of 3 percent.
3. The hole through which the high-strength grout is pumped during the placement of the pile shall be located at the bottom of the auger head below the bar containing the cutting teeth.
4. Augers over 12000 mm (40 feet) in length shall contain a middle guide.
5. The piling leads should be prevented from rotating by a stabilizing arm or by firmly placing the bottom of the leads into the ground or by some other acceptable means. Leads shall be marked at 300 mm (1 foot) intervals to facilitate measurement of auger penetration.
6. Auger hoisting equipment shall be provided that will enable the auger to be rotated while being withdrawn smoothly and steadily.

B. Mixing and Pumping Equipment:

1. Only approved pumping and mixing equipment shall be used in the preparation and handling of the grout.
2. A screen to remove over-size particles shall be placed at the pump inlet. All oil or other rust inhibitor shall be removed from mixing drums and grout pumps. All materials shall be such as to produce a homogeneous grout of the desired consistency.
3. The grout pump shall be a positive displacement piston type pump capable of developing displacing pressures at the pump not less than 2.5 Mpa (350 psi).
4. Provide equipment with a pressure gage in clear view of the equipment operator. A second pressure gauge shall be located near auger rig where it can be observed.

5. The grout pump shall be calibrated at the beginning of the work to determine the volume of grout pumped per stroke. A positive method of counting grout pump strokes shall be provided by the Pile Contractor. Such methods may include digital or mechanical stroke counters or other acceptable methods.
- C. Pile Installation Recorder (PIR): The Contractor shall provide a PIR for ACP's for use by the Agency and the Consultant during pile installation. The PIR shall be used for each piling rig. The PIR shall record appropriate information during both the augering phase and during the grouting phase of the installation to assure minimum grout volume pumped per unit depth increment, and shall print results immediately upon completion of each pile.

PART 3 - EXECUTION

3.1 GENERAL

- A. Survey: Registered Professional Land Surveyor or Registered Civil Engineer, specified in Section 01 00 00, GENERAL REQUIREMENTS, shall establish lines and levels and stake pile locations.
- B. Before installing piles adjacent to any existing utilities, the Contractor shall notify the utility owner to ensure that protective Work will be coordinated and performed in accordance with the requirements of the utility owner. If any existing service lines, utilities and utility structures to remain in service are uncovered or encountered during these operations, protect, from damage and provide support if necessary.
- C. Should uncharted or incorrectly charted piping or other utilities be encountered during piling operations, immediately notify the Resident Engineer and the utility owner. Cooperate with the utility owner in keeping their respective services, utilities and facilities in operation.
- D. After all ACP's are in place, the Surveyor shall make a field survey of completed piles and shall submit a drawing to the Resident Engineer showing the plumbness of the piles and the actual pile locations with respect to planned pile locations.
- E. Pile Record: Submit complete and accurate record of all auger-placed piles to the Resident Engineer. Record shall indicate the pile location, diameter, length, elevation of bottom and top of pile, and the quantity of grout used in each pile. Any unusual conditions encountered during pile installation shall also be noted.
- F. Completion Certificate: The Contractor shall provide a written statement, stamped by a Professional Engineer registered in the State of the Work, verifying that the piles were installed per the Contract Documents, and that any piles not installed per the Contract

Documents were installed in such a manner that they will not have an negative impact on the proposed structure.

3.2 INSTALLATION

- A. The length and drilling criteria of production piles will be determined by the Government and the Consultant from the installation of the probe piles, reaction piles, test piles, and the pile load tests. The installation shall be performed in an orderly sequence.
- B. Augering:
 - 1. Advance the auger at a continuous rate that prevents removal of excess soil. Stop advancement after reaching the required depth or refusal criteria.
 - a. Auger refusal is defined as a rate of auger penetration of less than 300 mm (1 foot) per minute of drilling.
 - 2. The hole in the bottom of the auger shall be closed while being advanced into the ground with a suitable plug. The plug shall be removed by grout pressure or with the reinforcing bar.
- C. Reinforcing: Place continuous center reinforcing through the hollow-stemmed auger prior to placement of grout. Tie top of reinforcing in place after removal of auger. Use bar spacers to center reinforcing bars.
- D. Grouting and Withdrawal:
 - 1. Remove oil or other rust inhibitors from mixing drums and pumps.
 - 2. Materials shall be accurately measured by volume or by weight as they are fed to the mixer. Order of placing the materials in mixer shall be as follows: (1) water, (2) plasticizer, and (3) other solids in order of increasing particle size.
 - 3. At the start of pumping grout, raise the auger from 150 to 300 mm (6 to 12 inches) and after the grout pressure builds up sufficiently, redrill the auger to the previously established tip elevation.
 - 4. Cement grout shall then be injected through the auger shaft as the auger is being withdrawn, in such a way as to exert removing pressure on the withdrawing earth filled auger flights as well as lateral pressure on the soil surrounding the grout-filled pile hole.
 - a. Maintain at least 3000 mm (10 feet) of grout on the auger flighting above the injection point during raising of the auger.

5. Rate of grout injection and rate of auger withdrawal from the soil shall be coordinated as to maintain at all times the minimum grout head and a positive pressure on the gauges.
 - a. Grout pumping pressures shall be measured and shall be maintained high enough at all times to offset hydrostatic and lateral earth pressures.
 - b. Minimum volume of grout placed in hole shall be at least the nominal volume plus 15 percent of hole, except, after grout is flowing at the ground surface from the auger flighting, the rate of grout injection and auger withdrawal shall be coordinated so that there is a constant grout flow at the surface.
 - c. Volume of grout per linear meter (linear foot) of pile shall be not less than volume of grout per meter (volume of grout per foot) of the load test pile. Make volume measurements in the presence of Resident Engineer.
 6. The auger shall rotate in a positive direction and shall be withdrawn in a steady continuous motion.
- E. Rate of injection and rate of auger withdrawal from soil shall be so coordinated as to maintain at all times a positive pressure on gage which will indicate existence of a removing pressure on bottom of auger flight. Magnitude of this pressure and performance of other augering and grouting procedures, such as rate of augering, rate of grout injection, and control of grout return around the auger flight, are dependent on soil conditions, and equipment capability shall be at option of Contractor, subject to approval of Resident Engineer.
 - F. Withdraw auger smoothly and at a constant rate. If the auger jumps upward during withdrawal, it shall be reinserted, and rate of withdrawal decreased to prevent further jumping.
 - G. If pumping of grout is interrupted for any reason, the Contractor shall reinsert the auger at least 1500 mm (5 feet) into the pile and regROUT.
 - H. Where the pile cut-off is near the surface or above the bottom of the excavation, sleeves or casing of the proper diameter and at least 457 mm (18 inches) in length shall be placed around the pile tops. (Special conditions may require metal sleeves of additional length).
 - I. Cut off the tops of piles, square with pile axis and at the elevations indicated by removing fresh grout from the top of the pile or by cutting off hardened grout down to final cutoff point at any time after initial set has occurred.
 - J. No pile shall be loaded until the grout has attained full design strength.

- K. Locate piles as shown unless otherwise directed by Resident Engineer. Do not place piles closer than 1050 mm (3.5 feet) center to center until grout in adjacent piles has set for 24 hours. In locations where there are no concrete slabs or other means of distributing load of the equipment placing piles, the equipment shall be kept at least 3000 mm (10 feet) away from pile location, or upper 3000 mm (10 feet) of pile shall be cased.
- L. The spoil that accumulates around the auger during injection of the grout shall be promptly cleared away upon completion of the installation.
- M. Provide OSHA protective caps on all projecting reinforcement.

3.3 OBSTRUCTIONS:

- A. The advancement of the augers through naturally occurring materials such as cobbles, boulders and rock ledges, as outlined in the Geotechnical Report, is the responsibility of the Contractor. The Contractor is responsible for providing the necessary means and methods of advancing the augers through this material. The length of short piles terminated due to such foreseeable material will not be included in the total length of pile for payment at the unit price. Additional adjacent piles, as required by the Resident Engineer, will also not be included in the total length of piles for payment.
- B. In the event that unforeseeable non-augerable material is encountered, such as cobbles, boulders, rock ledge, metal timbers or debris which causes the rate of penetration to be reduced to less than 300 mm (1 foot) per minute above the desired tip elevation, or causes the pile to drift from its location, then the pile shall be completed to the depth of the non-augerable material in accordance with these specifications. The length of such short piles shall be included in the total length of pile for payment at the unit price. If required by the Resident Engineer, additional adjacent piles shall be placed and the length of these additional piles shall also be included in the total length of piles for payment.
- C. Inform the Resident Engineer when piles are terminate before reaching the designed depth for any reason.

3.4 QUALITY CONTROL AND ASSURANCE:

- A. Grout Mix: The grout mix shall be tested by making a minimum of six, 50 mm (2 inches) cubes for each day during which piles are placed. A set of six cubes shall consist of two cubes to be tested at seven days, and two cubes to be tested at 28 days and two cubes held in reserve. Test cubes shall be cured and tested in accordance with ASTM C109/C109M. Cube specimens may be restrained from expansion as described in ASTM C942.

- B. Pile Acceptance: The Agency shall immediately notify the Consultant and the Resident Engineer if any pile is not in conformance with these Specifications. The amount of grout placed in each 1500 mm (5 feet) increments of the pile shall be checked continuously during installation.
- C. Reports:
 - 1. The Agency shall maintain an installation record of each pile. The record shall note the project name and number, name of Contractors, pile location, design pile capacity, pile tip elevation, pile top elevation, depth of auger advancement, (total and continuous) quantity of grout placed, reinforcing steel placement, and any unusual occurrences during the pile installation. The grout quantity shall be determined by recording grout pump displacement or by other acceptable means.
 - 2. The Consultant shall also maintain a daily report, which summarizes all work performed by the Contractor.

3.5 CORRECTIONS OF DEFICIENCIES:

- A. The pile installation shall be considered to have failed if any of the following are true:
 - 1. The design pile reinforcement cannot be placed manually in the top of any pile following completion of grouting.
 - 2. The trap door at the bottom discharge outlet fails to open completely, effectively creating a side discharge condition.
 - 3. Loss of grout head occurs for any reason during pile installation.
 - 4. There is more than a twenty-minute delay during the grouting of any individual pile.
 - 5. There is a drop in grout level after completion of the pile, which exceeds the average for the remainder of the pile installations by more than 600 mm (2 feet).
- B. Completed piles shall be considered to have failed or be deficient if any of the following are true:
 - 1. Piles that are not correctly locate within the tolerance indicated in Part 1 of this Section.
 - 2. Misaligned piles.
 - 3. Damaged piles.
 - 4. Piles in which tested concrete/grout is found to be deficient.
 - 5. Pile which fail load tests.
 - 6. Piles in which the grout level after the pile is completed.

- C. The contractor shall notify the Resident Engineer in writing, of the failure of a pile to meet any requirement of the Section. Such written notification shall include all information required for the evaluation of remedial measures, including all information required for redesign.
- D. Based on this information, the Engineer of Record shall determine whether the failed piles can be remediated or must be replaced. If necessary, the Resident Engineer may order additional tests. The decision of the Engineer of Record regarding remediation or replacements shall be final.
- E. Based on the decision of the Engineer of Record, the Contractor shall, at his/her expense provide:
 - 1. Repair the pile(s)
 - 2. Replace the pile(s)
 - 3. Provide additional pile(s)
 - 4. Pay to cost of reanalysis, redesign and redetailing by the Engineer of Record.
 - 5. Pay the additional costs of the both the Agency and the Consultant.
- F. The Contractor, at his option and at any time that he determines that a pile will not satisfy the requirements of this Section for a reason other than encountering an unforeseen underground obstruction, may, subject to the provisions of this specification, abandon such pile and replace it with a new pile or piles rather than await direction or approval from the Resident Engineer. However, the Contractor, in exercising this option, assumes the risk that such replacement pile or piles will be acceptable to the Engineer.
- G. Abandoned piles shall be cut off 300 mm (1 foot) below the elevation of the bottom of the pile cap or mat as shown on the Contract Drawings and will not be paid for.

3.6 CLEAN UP:

- A. All debris from excavation of objectionable material, removal of obstructions, and any material not to remain as part of the construction are to be removed and disposed of by the subcontractor in a legal manner at no additional cost to the Owner.
- B. The site shall be cleaned at frequent intervals and no material shall be stored on the site in a manner, which would obstruct the easy access of equipment and personnel.

- - - E N D - - -

SECTION 32 05 23
CEMENT AND CONCRETE FOR EXTERIOR IMPROVEMENTS

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This section shall cover site work concrete constructed upon the prepared subgrade and in conformance with the lines, grades, thickness, and cross sections shown. Construction shall include the following:
- B. Curb, gutter, and combination curb and gutter.
- C. Pedestrian Pavement: Walks grade slabs crossings wheelchair curb ramps steps.
- D. Vehicular Pavement: Service courts driveways.

1.2 RELATED WORK

- A. Laboratory and Field Testing Requirements: Section 01 45 29, TESTING LABORATORY SERVICES.
- B. Subgrade Preparation: Section 31 20 00, EARTH MOVING.
- C. Concrete Materials, Quality, Mixing, Design and Other Requirements: Section 03 30 00, CAST-IN-PLACE-CONCRETE.
- D. Metal Components of Steps (Nosing and Railing): Section 05 50 00, METAL FABRICATIONS.

1.3 DESIGN REQUIREMENTS

Design all elements with the latest published version of applicable codes.

1.4 WEATHER LIMITATIONS

Placement of concrete shall be as specified under Article 3.8, COLD WEATHER and Article 3.7, HOT WEATHER of Section 03 30 00, CAST-IN-PLACE CONCRETE.

1.5 SELECT SUBBASE MATERIAL JOB-MIX

The Contractor shall retain and reimburse a testing laboratory to design a select subbase material mixture and submit a job-mix formula to the Resident Engineer, in writing, for approval. The formula shall include the source of materials, gradation, plasticity index, liquid limit, and laboratory compaction curves indicating maximum density at optimum moisture.

1.6 SUBMITTALS

- A. In accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES, furnish the following:
- B. Manufacturers' Certificates and Data certifying that the following materials conform to the requirements specified.
 - 1. Expansion joint filler

2. Hot poured sealing compound
 3. Reinforcement
 4. Curing materials
- C. Data and Test Reports: Select subbase material.
1. Job-mix formula.
 2. Source, gradation, liquid limit, plasticity index, percentage of wear, and other tests as specified and in referenced publications.
- D. The Contractor shall submit a joint layout plan as a shop drawing prior to beginning paving operations.

1.7 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only. Refer to the latest edition of all referenced Standards and codes.
- B. American Association of State Highway and Transportation Officials (AASHTO):
- M031MM031-07-UL.....Deformed and Plain Carbon-Steel Bars for Concrete Reinforcement (ASTM A615/A615M-09)
- M055MM055-09-UL.....Steel Welded Wire Reinforcement, Plain, for Concrete (ASTM A185)
- M147-65-UL.....Materials for Aggregate and Soil-Aggregate Subbase, Base and Surface Courses (R 2004)
- M148-05-UL.....Liquid Membrane-Forming Compounds for Curing Concrete (ASTM C309)
- M171-05-UL.....Sheet Materials for Curing Concrete (ASTM C171)
- M182-05-UL.....Burlap Cloth Made from Jute or Kenaf and Cotton Mats
- M213-01-UL.....Preformed Expansion Joint Fillers for Concrete Paving and Structural Construction (Non-extruding and Resilient Bituminous Type) (ASTM D1751)
- M233-86-UL.....Boiled Linseed Oil Mixer for Treatment of Portland Cement Concrete
- T099-09-UL.....Moisture-Density Relations of Soils Using a 2.5 kg. (5.5 lb) Rammer and a 305 mm (12 in.) Drop
- T180-09-UL.....Moisture-Density Relations of Soils Using a 4.54 kg (10 lb.) Rammer and a 457 mm (18 in.) Drop

- C. American Society for Testing and Materials (ASTM):
 C94/C94M-09Ready-Mixed Concrete
 C143/C143M-09Slump of Hydraulic Cement Concrete

PART 2 - PRODUCTS

2.1 GENERAL

Concrete shall be Type C, air-entrained as specified in Section 03 30 00, CAST-IN-PLACE CONCRETE, with the following exceptions:

<u>TYPE</u>	<u>MAXIMUM SLUMP*</u>
Curb & Gutter	75 mm (3")
Pedestrian Pavement	75 mm (3")
Vehicular Pavement	50 mm (2") (Machine Finished) 100 mm (4") (Hand Finished)
Equipment Pad	75 to 100 mm (3" to 4")
* For concrete to be vibrated: Slump as determined by ASTM C143. Tolerances as established by ASTM C94.	

2.2 REINFORCEMENT

- A. The type, amount, and locations of steel reinforcement shall be as shown on the drawings and in the specifications.
- B. Welded wire-fabric shall conform to AASHTO M55.
- C. Dowels shall be plain steel bars conforming to AASHTO M31. Tie bars shall be deformed steel bars conforming to AASHTO M31.

2.3 SELECT SUBBASE (WHERE REQUIRED)

- A. Subbase material shall consist of select granular material composed of sand, sand-gravel, crushed stone, crushed or granulated slag, with or without soil binder, or combinations of these materials conforming to AASHTO M147, Grading E or F.
- B. Materials meeting other gradations than that noted will be acceptable whenever the gradations are within a tolerance of three to five percent, plus or minus, of the single gradation established by the job-mix formula.
- C. Subbase material shall produce a compacted, dense-graded course, meeting the density requirement specified herein.

2.4 FORMS

- A. Use metal or wood forms that are straight and suitable in cross-section, depth, and strength to resist springing during depositing and consolidating the concrete, for the work involved.
- B. Do not use forms if they vary from a straight line more than 3 mm (1/8 inch) in any 3000 mm (ten foot) long section, in either a horizontal or vertical direction.
- C. Wood forms should be at least 50 mm (2 inches) thick (nominal). Wood forms shall also be free from warp, twist, loose knots, splits, or other defects. Use approved flexible or curved forms for forming radii.

2.5 CONCRETE CURING MATERIALS

- A. Concrete curing materials shall conform to one of the following:
 - 1. Burlap conforming to AASHTO M182 having a weight of 233 grams (seven ounces) or more per square meter (yard) when dry.
 - 2. Liquid Membrane Curing Compound conforming to AASHTO M148 (ASTM C309), Type 2 and shall be free of paraffin or petroleum.

2.6 EXPANSION JOINT FILLERS

Expansion Joint Filler: ASTM D 5249, Type 2 - Synthetic foam conforming, closed cell (non-water absorbent). Thickness: 1/2 inch (13 mm) unless indicated otherwise.

PART 3 - EXECUTION

3.1 SUBGRADE PENETRATION

- A. Prepare, construct, and finish the subgrade as specified in Section 31 20 00, EARTH MOVING.
- B. Maintain the subgrade in a smooth, compacted condition, in conformance with the required section and established grade until the succeeding operation has been accomplished.

3.2 SELECT SUBBASE (WHERE REQUIRED)

- A. Mixing: Proportion the select subbase by weight or by volume in quantities so that the final approved job-mixed formula gradation, liquid limit, and plasticity index requirements will be met after subbase course has been placed and compacted. Add water in approved quantities, measured by weight or volume, in such a manner to produce a uniform blend.
- B. Placing:
 - 1. Place the mixed material on the prepared subgrade in a uniform layer to the required contour and grades, and to a loose depth not to exceed 200 mm (8 inches), and that when compacted, will produce a layer of the designated thickness.

2. When the designated compacted thickness exceeds 150 mm (6 inches), place the material in layers of equal thickness. Remove unsatisfactory areas and replace with satisfactory mixture, or mix the material in the area.
3. In no case will the addition of thin layers of material be added to the top layer in order to meet grade.
4. If the elevation of the top layer is 13 mm (1/2 inch) or more below the grade, excavate the top layer and replace with new material to a depth of at least 75 mm (3 inches) in compacted thickness.

C. Compaction:

1. Perform compaction with approved equipment (hand or mechanical) well suited to the material being compacted.
2. Moisten or aerate the material as necessary to provide the moisture content that will readily facilitate obtaining the specified compaction with the equipment used.
3. Compact each layer to at least 95 percent or 100 percent of maximum density as determined by AASHTO T180 or AASHTO T99 respectively.

D. Smoothness Test and Thickness Control:

Test the completed subbase for grade and cross section with a straight edge.

1. The surface of each layer shall not show any deviations in excess of 10 mm (3/8 inch).
2. The completed thickness shall be within 13 mm (1/2 inch) of the thickness as shown.

E. Protection:

1. Maintain the finished subbase in a smooth and compacted condition until the concrete has been placed.
2. When Contractor's subsequent operations or adverse weather disturbs the approved compacted subbase, excavate, and reconstruct it with new material meeting the requirements herein specified, at no additional cost to the VA.

3.3 SETTING FORMS

A. Base Support:

1. Compact the base material under the forms true to grade so that, when set, they will be uniformly supported for their entire length at the grade as shown.
2. Correct imperfections or variations in the base material grade by cutting or filling and compacting.

B. Form Setting:

1. Set forms sufficiently in advance of the placing of the concrete to permit the performance and approval of all operations required with and adjacent to the form lines.
2. Set forms to true line and grade and use stakes, clamps, spreaders, and braces to hold them rigidly in place so that the forms and joints are free from play or movement in any direction.
3. Forms shall conform to line and grade with an allowable tolerance of 3 mm (1/8 inch) when checked with a straightedge and shall not deviate from true line by more than 6 mm (1/4 inch) at any point.
4. Do not remove forms until removal will not result in damaged concrete or at such time to facilitate finishing.
5. Clean and oil forms each time they are used.

C. The Contractor's Registered Professional Land Surveyor, specified in Section 01 00 00, GENERAL REQUIREMENTS shall establish and control the alignment and the grade elevations of the forms or concrete slipforming machine operations.

1. Make necessary corrections to forms immediately before placing concrete.
2. When any form has been disturbed or any subgrade or subbase has become unstable, reset and recheck the form before placing concrete.

3.4 EQUIPMENT

- A. The Resident Engineer shall approve equipment and tools necessary for handling materials and performing all parts of the work prior to commencement of work.
- B. Maintain equipment and tools in satisfactory working condition at all times.

3.5 PLACING REINFORCEMENT

- A. Reinforcement shall be free from dirt, oil, rust, scale or other substances that prevent the bonding of the concrete to the reinforcement.
- B. Before the concrete is placed, the Resident Engineer shall approve the reinforcement, which shall be accurately and securely fastened in place with suitable supports and ties. The type, amount, and position of the reinforcement shall be as shown.

3.6 PLACING CONCRETE - GENERAL

- A. Obtain approval of the Resident Engineer before placing concrete.
- B. Remove debris and other foreign material from between the forms before placing concrete.
Obtain approval of the Resident Engineer before placing concrete.
- C. Before the concrete is placed, uniformly moisten the subgrade, base, or subbase appropriately, avoiding puddles of water.

- D. Convey concrete from mixer to final place of deposit by a method which will prevent segregation or loss of ingredients. Deposit concrete so that it requires as little handling as possible.
- E. While being placed, spade or vibrate and compact the concrete with suitable tools to prevent the formation of voids or honeycomb pockets. Vibrate concrete well against forms and along joints. Over-vibration or manipulation causing segregation will not be permitted. Place concrete continuously between joints without bulkheads.
- F. Install a construction joint whenever the placing of concrete is suspended for more than 30 minutes and at the end of each day's work.
- G. Workmen or construction equipment coated with foreign material shall not be permitted to walk or operate in the concrete during placement and finishing operations.

3.7 PLACING CONCRETE FOR CURB AND GUTTER, PEDESTRIAN PAVEMENT, AND EQUIPMENT PADS

- A. Place concrete in the forms in one layer of such thickness that, when compacted and finished, it will conform to the cross section as shown.
- B. Deposit concrete as near to joints as possible without disturbing them but do not dump onto a joint assembly.
- C. After the concrete has been placed in the forms, use a strike-off guided by the side forms to bring the surface to the proper section to be compacted.
- D. Consolidate the concrete thoroughly by tamping and spading, or with approved mechanical finishing equipment.
- E. Finish the surface to grade with a wood or metal float.
- F. All Concrete pads and pavements shall be constructed with sufficient slope to drain properly.

3.8 PLACING CONCRETE FOR VEHICULAR PAVEMENT

- A. Deposit concrete into the forms as close as possible to its final position.
- B. Place concrete rapidly and continuously between construction joints.
- C. Strike off concrete and thoroughly consolidate by a finishing machine, vibrating screed, or by hand-finishing.
- D. Finish the surface to the elevation and crown as shown.
- E. Deposit concrete as near the joints as possible without disturbing them but do not dump onto a joint assembly. Do not place adjacent lanes without approval by the Resident Engineer.

3.9 CONCRETE FINISHING - GENERAL

- A. The sequence of operations, unless otherwise indicated, shall be as follows:
 1. Consolidating, floating, straight-edging, troweling, texturing, and edging of joints.
 2. Maintain finishing equipment and tools in a clean and approved condition.

3.10 CONCRETE FINISHING CURB AND GUTTER

- A. Round the edges of the gutter and top of the curb with an edging tool to a radius of 6mm (1/4 inch) or as otherwise detailed.
- B. Float the surfaces and finish with a smooth wood or metal float until true to grade and section and uniform in textures.
- C. Finish the surfaces, while still wet, with a bristle type brush with longitudinal strokes.
- D. Immediately after removing the front curb form, rub the face of the curb with a wood or concrete rubbing block and water until blemishes, form marks, and tool marks have been removed. Brush the surface, while still wet, in the same manner as the gutter and curb top.
- E. Except at grade changes or curves, finished surfaces shall not vary more than 3 mm (1/8 inch) for gutter and 6 mm (1/4 inch) for top and face of curb, when tested with a 3000 mm (10 foot) straightedge.
- F. Remove and reconstruct irregularities exceeding the above for the full length between regularly scheduled joints.
- G. Correct any depressions which will not drain.
- H. Visible surfaces and edges of finished curb, gutter, and combination curb and gutter shall be free of blemishes, form marks, and tool marks, and shall be uniform in color, shape, and appearance.

3.11 CONCRETE FINISHING PEDESTRIAN PAVEMENT

- A. Walks, Grade Slabs, Wheelchair Curb Ramps:
 - 1. Finish the surfaces to grade and cross section with a metal float, trowled smooth and finished with a broom moistened with clear water.
 - 2. Brooming shall be transverse to the line of traffic.
 - 3. Finish all slab edges, including those at formed joints, carefully with an edger having a radius as shown on the Drawings.
 - 4. Unless otherwise indicated, edge the transverse joints before brooming. The brooming shall eliminate the flat surface left by the surface face of the edger. Execute the brooming so that the corrugation, thus produced, will be uniform in appearance and not more than 2 mm (1/16 inch) in depth.
 - 5. The completed surface shall be uniform in color and free of surface blemishes, form marks, and tool marks. The finished surface of the pavement shall not vary more than 5 mm (3/16 inch) when tested with a 3000 mm (10 foot) straightedge.
 - 6. The thickness of the pavement shall not vary more than 6 mm (1/4 inch).

7. Remove and reconstruct irregularities exceeding the above for the full length between regularly scheduled joints.
- B. Steps: The method of finishing the steps and the sidewalls is similar to above except as herein noted.
1. Remove the riser forms one at a time, starting with the top riser.
 2. After removing the riser form, rub the face of the riser with a wood or concrete rubbing block and water until blemishes, form marks, and tool marks have been removed. Use an outside edger to round the corner of the tread; use an inside edger to finish the corner at the bottom of the riser.
 3. Give the risers and sidewall a final brush finish. The treads shall have a final finish with a stiff brush to provide a non-slip surface.
 4. The texture of the completed steps shall present a neat and uniform appearance and shall not deviate from a straightedge test more than 5 mm (3/16 inch).

3.12 CONCRETE FINISHING FOR VEHICULAR PAVEMENT

- A. Accomplish longitudinal floating with a longitudinal float not less than 3000 mm (10 feet) long and 150 mm (6 inches) wide, properly stiffened to prevent flexing and warping. Operate the float from foot bridges in a sawing motion parallel to the direction in which the pavement is being laid from one side of the pavement to the other, and advancing not more than half the length of the float.
- B. After the longitudinal floating is completed, but while the concrete is still plastic, eliminate minor irregularities in the pavement surfaces by means of metal floats, 1500 mm (5 feet) in length, and straightedges, 3000 mm (10 feet) in length. Make the final finish with the straightedges, which shall be used to float the entire pavement surface.
- C. Test the surface for trueness with a 3000 mm (10 foot) straightedge held in successive positions parallel and at right angles to the direction in which the pavement is being laid and the entire area covered as necessary to detect variations. Advance the straightedge along the pavement in successive stages of not more than one half the length of the straightedge. Correct all irregularities and refinish the surface.
- D. The finished surface of the pavement shall not vary more than 6 mm (1/4 inch) in both longitudinal and transverse directions when tested with a 3000 mm (10 foot) straightedge.
- E. The thickness of the pavement shall not vary more than 6 mm (1/4 inch).
- F. When most of the water glaze or sheen has disappeared and before the concrete becomes nonplastic, give the surface of the pavement a broomed finish with an approved fiber broom not

less than 450 mm (18 inches) wide. Pull the broom gently over the surface of the pavement from edge to edge. Brooming shall be transverse to the line of traffic and so executed that the corrugations thus produced will be uniform in character and width, and not more than 3 mm (1/8 inch) in depth. Carefully finish the edge of the pavement along forms and at the joints with an edging tool. The brooming shall eliminate the flat surface left by the surface face of the edger.

G. The finish surfaces of new and existing abutting pavements shall coincide at their juncture.

3.13 CONCRETE FINISHING EQUIPMENT PADS

- A. After the surface has been struck off and screeded to the proper elevation, give it a smooth dense float finish, free from depressions or irregularities.
- B. Carefully finish all slab edges with an edger having a radius as shown in the Drawings.
- C. After removing the forms, rub the faces of the pad with a wood or concrete rubbing block and water until blemishes, form marks, and tool marks have been removed. The finish surface of the pad shall not vary more than 3 mm (1/8 inch) when tested with a 3000 mm (10 foot) straightedge.
- D. Correct irregularities exceeding the above.

3.14 JOINTS - GENERAL

- A. Place joints, as per previously submitted and approved joint layout plan. Provide joints perpendicular to the finished grade of the concrete surface.
- B. Joints shall be straight and continuous from edge to edge of the pavement.

3.15 CONTRACTION JOINTS

- A. Cut joints to depth as shown with a grooving tool or jointer of a radius as shown or by sawing with a blade producing the required width and depth.
- B. Construct joints in curbs and gutters by inserting 3 mm (1/8 inch) steel plates conforming to the cross sections of the curb and gutter.
- C. Plates shall remain in place until concrete has set sufficiently to hold its shape and shall then be removed.
- D. Finish edges of all joints with an edging tool having the radius as shown.
- E. Score pedestrian pavement with a standard grooving tool or jointer.

3.16 EXPANSION JOINTS

- A. Use a preformed expansion joint filler material of the thickness as shown to form expansion joints.
- B. Material shall extend the full depth of concrete, cut and shaped to the cross section as shown, except that top edges of joint filler shall be below the finished concrete surface where shown to allow for sealing.

- C. Anchor with approved devices to prevent displacing during placing and finishing operations.
- D. Round the edges of joints with an edging tool.
- E. Form expansion joints as follows:
 1. Without dowels, about structures and features that project through, into, or against any site work concrete construction.
 2. Using joint filler of the type, thickness, and width as shown.
 3. Installed in such a manner as to form a complete, uniform separation between the structure and the site work concrete item.

3.17 CONSTRUCTION JOINTS

- A. Locate longitudinal and transverse construction joints between slabs of vehicular pavement as shown.
- B. Place transverse construction joints of the type shown, where indicated and whenever the placing of concrete is suspended for more than 30 minutes.
- C. Use a butt-type joint with dowels in curb and gutter if the joint occurs at the location of a planned joint.
- D. Use keyed joints with tiebars if the joint occurs in the middle third of the normal curb and gutter joint interval.

3.18 FORM REMOVAL

- A. Forms shall remain in place at least 12 hours after the concrete has been placed. Remove forms without injuring the concrete.
- B. Do not use bars or heavy tools against the concrete in removing the forms. Promptly repair any concrete found defective after form removal.

3.20 CURING OF CONCRETE

- A. Cure concrete by one of the following methods appropriate to the weather conditions and local construction practices, against loss of moisture, and rapid temperature changes for at least seven days from the beginning of the curing operation. Protect unhardened concrete from rain and flowing water. All equipment needed for adequate curing and protection of the concrete shall be on hand and ready to install before actual concrete placement begins. Provide protection as necessary to prevent cracking of the pavement due to temperature changes during the curing period. If any selected method of curing does not afford the proper curing and protection against concrete cracking, remove and replace the damaged pavement and employ another method of curing as directed by the Resident Engineer.

- B. Burlap Mat: Provide a minimum of two layers kept saturated with water for the curing period.
Mats shall overlap each other at least 150 mm (6 inches).
- C. Liquid Membrane Curing:
 - 1. Apply pigmented membrane-forming curing compound in two coats at right angles to each other at a rate of 5 m²/L (200 square feet per gallon) for both coats.
 - 2. Do not allow the concrete to dry before the application of the membrane.
 - 3. Cure joints designated to be sealed by inserting moistened paper or fiber rope or covering with waterproof paper prior to application of the curing compound, in a manner to prevent the curing compound entering the joint.
 - 4. Immediately re-spray any area covered with curing compound and damaged during the curing period.

3.21 CLEANING

- A. After completion of the curing period:
 - 1. Remove the curing material (other than liquid membrane).
 - 2. Sweep the concrete clean.
 - 3. After removal of all foreign matter from the joints, seal joints as herein specified.
 - 4. Clean the entire concrete of all debris and construction equipment as soon as curing and sealing of joints has been completed.

3.22 PROTECTION

The contractor shall protect the concrete against all damage prior to final acceptance by the Government. Remove concrete containing excessive cracking, fractures, spalling, or other defects and reconstruct the entire section between regularly scheduled joints, when directed by the Resident Engineer, and at no additional cost to the Government. Exclude traffic from vehicular pavement until the concrete is at least seven days old, or for a longer period of time if so directed by the Resident Engineer.

3.23 FINAL CLEAN-UP

Remove all debris, rubbish and excess material from the Station.

--- E N D ---

SECTION 32 12 16 ASPHALT PAVING

PART 1 - GENERAL

1.1 DESCRIPTION

This work shall cover the composition, mixing, construction upon the prepared subgrade, and the protection of hot asphalt concrete pavement. The hot asphalt concrete pavement shall consist of an aggregate or asphalt base course and asphalt surface course constructed in conformity with the lines, grades, thickness, and cross sections as shown. Each course shall be constructed to the depth, section, or elevation required by the drawings and shall be rolled, finished, and approved before the placement of the next course.

1.2 RELATED WORK

- A. Laboratory and field testing requirements: Section 01 45 29, TESTING LABORATORY SERVICES.
- B. Subgrade Preparation: Paragraph 3.3 and Section 31 20 00, EARTH MOVING.
- C. Pavement Markings: Section 32 17 23, PAVEMENT MARKINGS.

1.3 INSPECTION OF PLANT AND EQUIPMENT

The Resident Engineer shall have access at all times to all parts of the material producing plants for checking the mixing operations and materials and the adequacy of the equipment in use.

1.4 ALIGNMENT AND GRADE CONTROL

The Contractor's Registered Professional Land Surveyor shall establish and control the pavement (aggregate or asphalt base course and asphalt surface course) alignments, grades, elevations, and cross sections as shown on the Drawings.

1.5 SUBMITTALS

- A. In accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES, furnish the following:
- B. Data and Test Reports:
 - 1. Aggregate Base Course: Sources, gradation, liquid limit, plasticity index, percentage of wear, and other tests required by State Highway Department.
 - 2. Asphalt Base/Surface Course: Aggregate source, gradation, soundness loss, percentage of wear, and other tests required by State Highway Department.
 - 3. Job-mix formula.
- C. Certifications:

1. Asphalt prime and tack coat material certificate of conformance to State Highway Department requirements.
 2. Asphalt cement certificate of conformance to State Highway Department requirements.
 3. Job-mix certification - Submit plant mix certification that mix equals or exceeds the State Highway Specification.
- D. One copy of State Highway Department Specifications.
- E. Provide MSDS (Material Safety Data Sheets) for all chemicals used on ground.

PART 2 - PRODUCTS

2.1 GENERAL

- A. Aggregate base, Asphaltic base and/or asphalt concrete materials shall conform to the requirements of the following and other appropriate sections of the latest version of the State Highway Material Specifications, including amendments, addenda and errata. Where the term "Engineer" or "Commission" is referenced in the State Highway Specifications, it shall mean the VA Resident Engineer or VA Contracting Officer.

2.2 AGGREGATES

- A. Provide aggregates consisting of crushed stone, gravel, sand, or other sound, durable mineral materials processed and blended, and naturally combined.
- B. Subbase aggregate (where required) maximum size: 38mm (1-1/2").
- C. Base aggregate maximum size:
1. Base course over 152mm (6") thick: 38mm (1-1/2");
 2. Other base courses: 19mm (3/4").
- D. Asphaltic base course:
1. Maximum particle size not to exceed 25.4mm (1").
 2. Where conflicts arise between this specification and the requirements in the latest version of the State Highway Specifications, the State Specifications shall control.
- E. Aggregates for asphaltic concrete paving: Provide a mixture of sand, mineral aggregate, and liquid asphalt mixed in such proportions that the percentage by weight will be within:

<u>Sieve Sizes</u>	<u>Percentage Passing</u>
19mm(3/4")	100
9.5mm(3/8")	67 to 85
6.4mm(1/4")	50 to 65
2.4mm(No. 8 mesh)	37 to 50

600µm(No. 30 mesh)	15 to 25
75µm(No. 200 mesh)	3 to 8

plus 50/60 penetration liquid asphalt at 5 percent to 6-1/2 percent of the combined dry aggregates.

2.3 ASPHALTS

A. Comply with provisions of Asphalt Institute Specification SS2:

1. Asphalt cement: Penetration grade 50/60
2. Prime coat: Cut-back type, grade MC-250
3. Tack coat: Uniformly emulsified, grade SS-1H

2.4 SEALER

- A. Provide a sealer consisting of suitable fibrated chemical type asphalt base binders and fillers having a container consistency suitable for troweling after thorough stirring, and containing no clay or other deleterious substance.
- B. Where conflicts arise between this specification and the requirements in the latest version of the State Highway Specifications, the State Specifications shall control.

PART 3 - EXECUTION

3.1 GENERAL

The Asphalt Concrete Paving equipment, weather limitations, job-mix formula, mixing, construction methods, compaction, finishing, tolerance, and protection shall conform to the requirements of the appropriate sections of the State Highway Specifications for the type of material specified.

3.2 MIXING ASPHALTIC CONCRETE MATERIALS

- A. Provide hot plant-mixed asphaltic concrete paving materials.
 1. Temperature leaving the plant: 143 °C(290 °F) minimum, 160 °C(320 °F) maximum.
 2. Temperature at time of placing: 138 °C(280 °F) minimum.

3.3 SUBGRADE

- A. Shape to line and grade and compact with self-propelled rollers.
- B. All depressions that develop under rolling shall be filled with acceptable material and the area re-rolled.
- C. Soft areas shall be removed and filled with acceptable materials and the area re-rolled.
- D. Should the subgrade become rutted or displaced prior to the placing of the subbase, it shall be reworked to bring to line and grade.

- E. Proof-roll the subgrade with maximum 45 tonne (50 ton) gross weight dump truck as directed by VA Resident Engineer or VA Contracting Officer. If pumping, pushing, or other movement is observed, rework the area to provide a stable and compacted subgrade.

3.4 BASE COURSES

- A. Subbase (when required)
 - 1. Spread and compact to the thickness shown on the drawings.
 - 2. Rolling shall begin at the sides and continue toward the center and shall continue until there is no movement ahead of the roller.
 - 3. After completion of the subbase rolling there shall be no hauling over the subbase other than the delivery of material for the top course.
- B. Base
 - 1. Spread and compact to the thickness shown on the drawings.
 - 2. Rolling shall begin at the sides and continue toward the center and shall continue until there is no movement ahead of the roller.
 - 3. After completion of the base rolling there shall be no hauling over the base other than the delivery of material for the top course.
- C. Thickness tolerance: Provide the compacted thicknesses shown on the Drawings within a tolerance of minus 0.0mm (0.0") to plus 12.7mm (0.5").
- D. Smoothness tolerance: Provide the lines and grades shown on the Drawings within a tolerance of 5mm in 3m (3/16 inch in ten feet).
- E. Moisture content: Use only the amount of moisture needed to achieve the specified compaction.

3.5 PLACEMENT OF ASPHALTIC CONCRETE PAVING

- A. Remove all loose materials from the compacted base.
- B. Apply the specified prime coat, and tack coat where required, and allow to dry in accordance with the manufacturer's recommendations as approved by the Architect or Engineer.
- C. Receipt of asphaltic concrete materials:
 - 1. Do not accept material unless it is covered with a tarpaulin until unloaded, and unless the material has a temperature of not less than 130 °C(280 °F).
 - 2. Do not commence placement of asphaltic concrete materials when the atmospheric temperature is below 10 °C (50 °F), not during fog, rain, or other unsuitable conditions.
- D. Spreading:
 - 1. Spread material in a manner that requires the least handling.
 - 2. Where thickness of finished paving will be 76mm (3") or less, spread in one layer.

E. Rolling:

1. After the material has been spread to the proper depth, roll until the surface is hard, smooth, unyielding, and true to the thickness and elevations shown on the drawings.
2. Roll in at least two directions until no roller marks are visible.
3. Finished paving smoothness tolerance:
 - a. No depressions which will retain standing water.
 - b. No deviation greater than 3mm in 1.8m (1/8" in six feet).

3.6 APPLICATION OF SEAL COAT

- A. Prepare the surfaces, mix the seal coat material, and apply in accordance with the manufacturer's recommendations as approved by the Architect or Engineer.
- B. Apply one coat of the specified sealer.
- C. Achieve a finished surface seal which, when dry and thoroughly set, is smooth, tough, resilient, of uniform black color, and free from coarse textured areas, lap marks, ridges, and other surface irregularities.

3.7 PROTECTION

Protect the asphaltic concrete paved areas from traffic until the sealer is set and cured and does not pick up under foot or wheeled traffic.

3.8 FINAL CLEAN-UP

Remove all debris, rubbish, and excess material from the work area.

--- E N D ---

SECTION 32 17 17 MANUFACTURED BOLLARDS

PART 1 - GENERAL

1.1 DESCRIPTION:

- A. This section specifies manufactured bollards, including accessory items for installation.

1.2 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Product Data:
 - 1. Description of materials and fabrication. Description of resulting product including configuration, dimensions, weight. Description of impact resistance.
 - 2. Accessory product used for installation.
- C. Shop Drawings:
 - 1. Showing dimensioned drawings of bollard and installation.
- D. Sample warranty for review.

1.3 WARRANTY

- A. Manufacturer's written warranty for precast products for the period of two years.

1.4 APPLICABLE PUBLICATIONS

- A. Publications listed below form a part of this specification to extent referenced. Publications are referenced in text by basic designation only.
- B. American Society for Testing and Materials (ASTM):
 - A53Standard Specification for Pipe, Steel, Black and Hot-Dipped,
Zinc-Coated, Welded and Seamless
 - A123Standard Specification for Zinc (Hot-Dip Galvanized) Coatings
on Iron and Steel Products

PART 2 - PRODUCTS

2.1 MATERIALS

- A. Concrete ingredients shall generally conform to the requirements of Sections 32 05 23 and 03 30 00.
- B. Pipes: Conform to ASTM A53.
- C. All steel shall be galvanized per ASTM A123, G90.

2.2 FABRICATION

- A. Bollards to be precast concrete conforming.

- B. Concrete to 5000 psi average 28 day compressive strength.
- C. Concrete to air entrained or extreme weather exposure as required based on mix.
- D. Reinforce concrete as required to ensure strength and durability.
- E. Seal concrete with penetrating sealer.
- F. Fabricated for installation as described in the Section.

PART 3 - EXECUTION

3.1 INSTALLATION:

- A. Bollards shall be installed using one of the following methods:
 - 1. Bollard shall be embedded in the ground not less than 3 feet and securely anchored by setting in concrete or other approved means.
 - 2. Bollard shall set over and tightly fit to a galvanized steel pipe. Pipe shall be not less than 4 inches in diameter, not less than Schedule 40, and be embedded not less than 3 feet in the ground and set in concrete.
- B. Position as indicated on approved shop drawings.
- C. Set such that full weight of the bollard is fully supported on the ground.

3.2 PROTECTION AND REPAIR

- A. Protect installed bollards from damage until Substantial Completion.
- B. Repair any damage that occurs in shipping, installation or after installation to the satisfaction of the Resident Engineer. If the damage cannot be repaired satisfactorily, replace the bollard(s).

--- E N D ---

SECTION 32 17 19 PIPE BOLLARDS

PART 1 - GENERAL

1.1 DESCRIPTION:

- A. This section specifies site constructed pipe bollards.

1.2 RELATED WORK

- A. Finishes: Section 09 96 59, HIGH-BUILD GLAZED COATINGS.
- B. Retaining wall on which fence is mounted: Section 32 05 23, CEMENT AND CONCRETE FOR EXTERIOR IMPROVEMENTS.

1.3 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Shop Drawings:
 - 1. Showing dimensioned drawings of the pipe bollard to be supplied and locations where it will be installed, including showing footings.
- C. Product Data:
 - 1. Primer including documentation that the primer is acceptable to the finish paint manufacturer.
 - 2. Concrete to be used for footing and fill. If different concrete is to be used for each, provide two submittals and clearly indicate which is which.

1.4 APPLICABLE PUBLICATIONS

- A. Publications listed below form a part of this specification to extent referenced. Publications are referenced in text by basic designation only.
- B. American Society for Testing and Materials (ASTM):
 - A36Standard Specification for Carbon Structural Steel
 - A53Standard Specification for Pipe, Steel, Black and Hot-Dipped, Zinc-Coated, Welded and Seamless
 - A123Standard Specification for Zinc (Hot-Dip Galvanized) Coatings on Iron and Steel Products

PART 2 - PRODUCTS

2.1 MATERIALS

- A. Pipes: Conform to ASTM A53.
- B. All steel shall be galvanized per ASTM A123, G90.

- C. Concrete Materials: Sections 32 05 23 and 03 30 00.

2.2 FABRICATION, GENERAL

- A. Conform to Section 05 50 00.

2.3 PIPE BOLLARDS

- A. Fabricate pipe bollards from Schedule 40 galvanized steel pipe.
- B. Diameter: 203 mm (8 inches)
- C. Fill: 3000 psi concrete
- D. Ease metal edges at exposed end of pipe to avoid any sharp edges.

2.4 FINISHES

- A. Pipe bollards shall be shop primed and field painted as described in Section 09 96 59, HIGH-BUILD GLAZED COATINGS.
- B. Primer: Compatible with the finish paint and recommended by the manufacturer for use over galvanized steel. Provide documentation that the primer is acceptable.
- C. Prepare as recommended by the primer manufacturer's requirements but not less than remove all dirt, rust, oils, waxes or protective coatings from galvanized surfaces to be painted.

PART 3 - EXECUTION

3.1 PREPARATION

- A. Verify that the location of adjacent structures and footings are as shown on the approved shop Drawings. Do not proceed until any discrepancies are resolved.

3.2 INSTALLATION, GENERAL

- A. Cutting, Fitting, and Placement: Perform cutting, drilling, and fitting required for installation. Set accurately in location, alignment, and elevation; with edges and surfaces level, plumb, true, and free of rack; and measured from established lines and levels.

3.3 INSTALLATION OF BOLLARDS

- A. Pour at least 6 inches of concrete below the bottom of the pipe of the bollard.
- B. Set pipe and pack in concrete. Vibrate as required to prevent honeycombing. Support pipe in proper position until concrete is set.
- C. Fill pipe with concrete. Vibrate as required to prevent honeycombing. Do not cause the pipe to move out of position while it is being filled.
- D. Support pipe as required to assure that it remains plumb and properly located until concrete is cured.

- E. Rounded Concrete Wash Cap. Install rounded concrete wash as required to prevent water from pooling in the concrete or between the concrete and the metal edge of the pipe.

3.4 FINISH

- A. Touch up the primer on the pipe bollard.
- B. Apply filler/primer to concrete at cap.
- C. Apply two coats of finish paint to both steel and concrete as described in Section 09 96 59.

--- E N D ---

SECTION 32 17 23 PAVEMENT MARKINGS

PART 1 - GENERAL

1.1 DESCRIPTION

This work shall consist of furnishing and applying paint on pavement surfaces, in the form of traffic lanes, parking bays, areas restricted to handicapped persons, crosswalks, and other detail pavement markings, in accordance with the details as shown or as prescribed by the Resident Engineer. Conform to the Manual on Uniform Traffic Control Devices for Streets and Highways, published by the U.S. Department of Transportation, Federal Highway Administration, for details not shown.

1.2 SUBMITTALS

- A. In accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES, furnish Manufacturer's Certificates and Data certifying that the following materials conform to the requirements specified.
- B. Paint.

1.3 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. Federal Specifications (Fed. Spec.):
 - TT-B-1325C.....Beads (Glass Spheres); Retro-Reflective
 - TT-P-1952D.....Paint, Traffic Black, and Airfield Marking, Waterborne
- C. Master Painters Institute (MPI):
 - Approved Product List - 2010

PART 2 - PRODUCTS

2.1 PAINT

Paint for marking pavement (parking lot and zone marking) shall conform to MPI No. 97, color as shown. Paint for obliterating existing markings shall conform to Fed. Spec. TT-P-1952D. Paint shall be in containers of at least 18 L (5 gallons). A certificate shall accompany each batch of paint stating compliance with the applicable publication.

2.2 PAINT APPLICATOR

Apply all marking by approved mechanical equipment. The equipment shall provide constant agitation of paint and travel at controlled speeds. Synchronize one or more paint "guns" to automatically begin and cut off paint flow in the case of skip lines. The equipment shall have

manual control to apply continuous lines of varying length and marking widths as shown. Provide pneumatic spray guns for hand application of paint in areas where a mobile paint applicator cannot be used. If the equipment does not have a glass bead dispenser, use a separate piece of equipment. Adjust and synchronize the equipment with the paint applicator so that the reflective beads are distributed uniformly on the paint lines within ten seconds without any waste. An experienced technician that is thoroughly familiar with equipment, materials, and marking layouts shall control all painting equipment and operations.

2.3 SANDBLASTING EQUIPMENT

Sandblasting equipment shall include an air compressor, hoses, and nozzles of proper size and capacity as required for cleaning surfaces to be painted. The compressor shall furnish not less than $0.08 \text{ m}^3/\text{s}$ (150 cfm) of air at a pressure of not less than 625 kPa (90 psi) at each nozzle used.

PART 3 - EXECUTION

3.1 SURFACE PREPARATION

- A. Allow new pavement surfaces to cure for a period of not less than 14 days before application of marking materials.
- B. Thoroughly clean all surfaces to be marked before application of paint. Remove dust, dirt, and other granular surface deposits by sweeping, blowing with compressed air, rinsing with water, or a combination of these methods. Completely remove rubber deposits, existing paint markings, and other coatings adhering to the pavement with scrapers, wire brushings, sandblasting, mechanical abrasion, or approved chemicals as directed by the Resident Engineer. The application of paint conforming to Fed. Spec. TT-P-1952D is an option to removal of existing paint markings on asphalt pavement. Apply the black paint in as many coats as necessary to completely obliterate the existing markings. Where oil or grease are present on old pavements to be marked, scrub affected areas with several applications of trisodium phosphate solution or other approved detergent or degreaser, and rinse thoroughly after each application. After cleaning, seal oil-soaked areas with cut shellac to prevent bleeding through the new paint. Pavement marking shall follow as closely as practicable after the surface has been cleaned and dried, but do not begin any marking until the Resident Engineer has inspected the surface and gives permission to proceed. The Contractor shall establish control points for marking and provide templates to control paint application by type and color at necessary intervals. The Contractor is responsible to preserve and apply marking in conformance with the established control points.

3.2 APPLICATION

Apply uniformly painted pavement marking of required color(s), length, and width with true, sharp edges and ends on properly cured, prepared, and dried surfaces in conformance with the details as shown and established control points. The length and width of lines shall conform within a tolerance of plus or minus 75 mm (3 inches) and plus or minus 3 mm (1/8 inch), respectively, in the case of skip markings. The length of intervals shall not exceed the line length tolerance. Temperature of the surface to be painted and the atmosphere shall be above 10°C (50°F) and less than 35°C (95°F). Apply the paint at a wet film thickness of 0.4 mm (0.015 inch). Apply paint in one coat. At the direction of the Resident Engineer, markings showing light spots may receive additional coats. The maximum drying time requirements of the paint specifications will be strictly enforced, to prevent undue softening of asphalt, and pick-up, displacement, or discoloration by tires of traffic. If there is a deficiency in drying of the marking, discontinue paint operations until cause of the slow drying is determined and corrected. Remove and replace marking that is applied at less than minimum material rates; deviates from true alignment; exceeds stipulated length and width tolerances; or shows light spots, smears, or other deficiencies or irregularities. Use carefully controlled sand blasting, approved grinding equipment, or other approved method to remove marking so that the surface to which the marking was applied will not be damaged.

3.3 PROTECTION

Conduct operations in such a manner that necessary traffic can move without hindrance. Protect the newly painted markings so that, insofar as possible, the tires of passing vehicles will not pick up paint. Place warning signs at the beginning of the wet line, and at points well in advance of the marking equipment for alerting approaching traffic from both directions. Place small flags or other similarly effective small objects near freshly applied markings at frequent intervals to reduce crossing by traffic. Efface and replace damaged portions of markings at no additional cost to the Government.

3.4 DETAIL PAVEMENT MARKING

Use Detail Pavement Markings, exclusive of actual traffic lane marking, at exit and entrance islands and turnouts, on curbs, at crosswalks, at parking bays, and at such other locations as shown. Show the International Handicapped Symbol at indicated parking spaces. Color shall be as shown. Apply paint for the symbol using a suitable template that will provide a pavement marking with true, sharp edges and ends. Place detail pavement markings of the color(s), width(s) and length(s), and design pattern at the locations shown.

3.5 FINAL CLEAN-UP

Remove all debris, rubbish and excess material from the Station.

--- E N D ---

SECTION 32 31 19
DECORATIVE METAL FENCES

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This section specifies prefabricated decorative metal fences and related accessories.

1.2 RELATED WORK

- A. Retaining wall on which fence is mounted: Section 32 05 23, CEMENT AND CONCRETE FOR EXTERIOR IMPROVEMENTS.

1.3 PERFORMANCE.

- A. Design fencing to meet requirement of code-required guard rail.
- B. Where fencing acts as guard rail, design and fabricate rails and posts to resist not less than 50 lb/lineal foot applied in any direction to the top rail or a concentrated load of 200 lb at any point on top rail. No member may permanently deform. Deflection of the free end of the post not to exceed 1/180 of length. All portions of the fencing system, including base anchorage, shall be designed to resist these applied forces without failure. Post must be designed according to the loading distribution indicated in NAAMM AMP 521.

1.4 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Shop Drawings:
1. Layout of fencings with dimensions, details, and finishes of components, accessories, and post foundations.
 2. Provide templates and rough-in measurements as required.
- C. Product Data: Manufacturer's literature including material compliance and specified options.
- D. Samples: 3 x 2 foot sample show bottom channel and double top channel and rings, post, cap and pickets and showing color and gloss of finish.
- E. Design Calculations for specified live loads including dead loads.

1.5 QUALITY ASSURANCE

- A. Each manufactured product shall meet, as a minimum, the requirements specified, and shall be a standard commercial product of a manufacturer regularly presently manufacturing items of type specified.
- B. Each product type shall be the same and be made by the same manufacturer.
- C. Assembled product to the greatest extent possible before delivery to the site.

- D. Include additional features, which are not specifically prohibited by this specification, but which are a part of the manufacturer's standard commercial product.

1.6 QUALITY ASSURANCE

- A. Fence, gates, and accessories shall be products of manufacturers' regularly engaged in manufacturing items of type specified.
- B. Provide fencing system as a complete package produced by a single manufacturer, including necessary installation and erection accessories, fittings and fasteners.
- C. The contractor shall provide laborers and supervisors who are thoroughly familiar with the type of construction involved and the materials and techniques specified.
- D. Structural Engineer must be licensed by at least one of the states of the United States. A signed seal must appear on calculations.

1.7 DELIVERY, HANDLING AND STORAGE

- A. Deliver prefabricated fencing panels, posts and accessories to project site, completely assembled and prefinished. Upon receipt at the job site, all materials shall be checked to ensure that no damages occurred during shipping. Materials shall be handled and stored properly to protect against damage and theft.

1.8 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American Society for Testing and Materials (ASTM):
 - A513-Standard Specification for Electric-Resistance-Welded Carbon and Alloy Steel Mechanical Tubing.
 - A653-Standard Specifications for Steel Sheet, Zinc-Coated (Galvanized) by the Hot-Dip Process.
 - A787-Standard Specifications for Electric-Resistance-Welded Metallic-Coated Carbon Steel Mechanical Tubing.
 - B117-Standard Practice for Operating Salt Spray (Fog) Apparatus
 - D523-Standard Test Method for Specular Gloss.
 - D2794-Resistance of Organic Coatings to the Effects of Rapid Deformation (Impact).
 - D3359-Standard Test Methods for Measuring Adhesion by Tape Test
 - D3363-Test Method for Film Hardness by Pencil Test.

C. National Association of Architectural Metal Manufacturers (NAAMM)

AMP 500-505-1988Metal Finishes Manual

AMP 521-1992Metal Railing Manual

PART 2 - PRODUCTS

2.1 BASIC MATERIALS

- A. Steel Tubing: ASTM A 787 having a minimum yield strength of 45,000 psi.
- B. Galvanizing: ASTM A 653, G60 or higher. All steel to be galvanized.
- C. All sizes and anchor connections shall be as determined by a Licensed Structural Engineer based on weight, applied loads indicated in this Section and local wind loading requirements for the specific installation type indicated on the Drawings.

2.2 CONFIGURATION

- A. General Configuration: Three rail, picket fence, rackable system to accommodate slope, segmentation and curvature of retaining wall.
- B. Height: 1.22 m (4 feet)
- C. Provide a single bottom channel and double top channel. Do not extend the picket above the top channel.
- D. Post caps: Flat with slightly rounded top.

2.3 COMPONENTS

- A. Pickets:
 - 1. 3/4 inch (19 mm) square tubing with minimum 18 gage wall thickness, formed per ASTM A787.
 - 2. Spacing: Picket spacing must prevent the passage of a 4 inch diameter ball.
- B. Rails: Minimum 1½ inch (28 mm) wide channel with minimum 16 gage wall thickness, formed per ASTM A787, length as shown on Drawings.
- C. Posts: Minimum 4 inch (102 mm) square tubing with minimum 16 gage wall thickness, formed per ASTM A787.

2.4 ACCESSORIES

- A. Provide steel mounting brackets designed for the loads indicated and intended for face mounted to the concrete retaining wall.
- B. All unpainted brackets or mounting devices shall be stainless steel, type 304 or 316.
- C. All fasteners shall be stainless steel, type 304 or 316.

2.5 FABRICATION

- A. Pickets, rails and posts to be cut, pressed, and located as indicated in the shop drawings.

- B. Fencing panels and framing shall be shop assembled to the greatest extent possible. Design shall minimize field connections.
- C. Rails and pickets shall be located and Electro-MIG welded per the final approved shop drawings.
- D. Posts shall have zinc plated, press on type steel caps. Base detail shall be mounted to the face of the retaining wall with anchor brackets as indicated in the Drawings.
- E. Fabricate items with joints tightly fitted and secured.
- F. Grind exposed joints flush and smooth with adjacent finish surface. Make exposed joints butt tight, flush, and hairline. Ease exposed edges to small uniform radius.
- G. Replace damaged zinc coating at any locations where cutting, welding or other fabricating takes place after galvanizing.
- H. Supply components required for anchorage of fabrications. Fabricate anchors and related components of same material and finish as fabrication, except where specifically noted otherwise.

2.6 FINISH

- A. Preparation: Prepare fencing system member for coating according to the coating manufacturer's requirements but not less than remove surface contamination and oils and wash with solvent.
- B. Coating: Electrostatically applied and heat cured TGIC polyester powder coating meeting the following performance requirements:
 - 1. ASTM B117 Salt Spray Resistance, 5% salt spray at 95° F and 95% relative humidity, 2,000 hour test without loss of adhesion.
 - 2. ASTM D3359, Measuring Adhesion by Tape Test, Method B, coating retention of not less than 95%.
 - 3. ASTM D2794, Impact Resistance, minimum resistance to impact not less than 120 in. /lb.
 - 4. South Florida Weatherability testing, no film failure and 65% gloss retention as measured by ASTM D523, Standard Test Method for Specular Gloss, after 60 months of 45 degree South Florida Exposure Testing.
 - 5. ASTM D3363, Film Hardness by Pencil Test, minimum hardness: 2H.
- C. Color: Black.

PART 3 - EXECUTION

3.1 PREPARATION

- A. Verify areas to receive fencing are completed to final grades, elevations and materials.
- B. Coordinate fencing installation with work of other Sections listed in these specifications.

3.2 INSTALLATION

- A. Install fencing in accordance with manufacturer's instructions and approved shop drawings.
- B. Install level and plumb or at slope indicated on Drawings.
- C. Space posts at dimensions indicated in the shop drawings.
- D. Attach fencing panels to posts using corrosion resistant steel, panel hanger brackets supplied by manufacturer. Field Welding of panels to posts is not acceptable.
- E. Avoid unnecessary cutting, drilling and welding of prefinished fencing panels. If necessary to cut drill, weld or otherwise modify panels due to field conditions, repair factory finish as noted in this Section.

3.3 FINISH REPAIR

- A. Touch-up any necessary areas by lightly sanding; apply a zinc-rich cold galvanizing primer followed by recommended touch-up paint.
- B. Use only touch-up paint recommend by the original coating system manufacturer.

3.4 CLEANING

- A. Fencing contractor shall remove packing materials and any unused material.

--- E N D ---

**SECTION 32 90 00
PLANTING**

PART 1 - GENERAL

1.1 DESCRIPTION:

- A. This work consists of furnishing and installing all planting materials required for landscaping hereinafter specified in locations as shown.
 - 1. For this Project, work consists of turf restoration in areas disturbed by exterior Work that is a part of this Project.

1.2 EQUIPMENT

- A. Maintain all equipment, tools and machinery while on the project in sufficient quantities and capacity for proper execution of the work.

1.3 RELATED WORK

- A. Section 31 20 00, EARTH MOVING, Stripping Topsoil and Stock Piling.
- B. Section 01 45 29, TESTING LABORATORY SERVICES, Topsoil Testing.
- C. Section 31 20 00, EARTH MOVING, Topsoil Materials.
- D. Section 01 57 19, TEMPORARY ENVIRONMENTAL CONTROLS.

1.4 SUBMITTALS

- A. Certificates of Conformance or Compliance: Before delivery, notarized certificates attesting that the following materials meet the requirements specified shall be submitted to the Resident Engineer for approval:
 - 1. Fertilizers.
 - 2. Seed
- B. Manufacturer's Literature and Data:
 - 1. Erosion control materials
- C. Licenses: Licenses of Arborist shall be submitted (one copy), to the Resident Engineer.
- D. Soil laboratory testing results and any soil amendment recommendations from the Contractor.

1.5 DELIVERY AND STORAGE

- A. Delivery:
 - 1. Deliver fertilizer to the site in the original, unopened containers bearing the manufacturer's warranted chemical analysis, name, trade name or trademark, and in conformance to state and federal law. In lieu of containers fertilizer may be furnished in bulk and a certificate indicating the above information shall accompany each delivery.
 - 2. During delivery: Protect seed from contamination.

B. Storage:

1. Keep seed, lime, and fertilizer in dry storage away from contaminants.

1.6 PLANTING AND TURF INSTALLATION SEASONS AND CONDITIONS

- A. Perform operations within the following dates: From March 1 to May 31 for spring and from August 10 to September 30 for fall.
- B. No work shall be done when the ground is frozen, snow covered, too wet or in an otherwise unsuitable condition for planting. Special conditions may exist that warrants a variance in the specified planting dates or conditions. Submit a written request to the Resident Engineer stating the special conditions and proposal variance.

1.7 PLANT AND TURF ESTABLISHMENT PERIOD

- A. The Establishment Period for plants and turf shall begin immediately after installation, with the approval of the Resident Engineer, and continue until the date that the Government accepts the project or phase for beneficial use and occupancy. During the Plant and Turf Establishment Period the Contractor shall:
 1. Water all turf to maintain an adequate supply of moisture within the root zone. An adequate supply of moisture is the equivalent of 25 mm (1 inch) of absorbed water per week either through natural rainfall or augmented by periodic watering. Apply water at a moderate rate so as not to flood the turf.
 2. Spray with approved insecticides and fungicides to control pests and ensure turf survival in a healthy growing condition, as directed by the Resident Engineer.
 3. Provide the following turf establishment:
 - a. Eradicate all weeds. Water, fertilize, overseed, and perform any other operation necessary to promote the growth of grass.
 - b. Replant areas void of turf 0.1 m² (one square foot) and larger in area.
 - c. Mow the new lawn at least three times prior to the final inspection. Begin mowing when grass is 100 mm (4 inches) high. Mow to a 65 mm (2-1/2 inch) height.

1.8 TURF WARRANTY

- A. A One Year Turf Warranty will begin on the date that the Government accepts the project or phase for beneficial use and occupancy. The Contractor shall have completed, located, and installed all turf according to the plans and specifications. All turf is expected to be living and in a healthy condition at the time of final inspection.
- B. The Contractor will replace any areas void of turf immediately. A one year warranty for the turf that was replaced, will begin on the day the work is completed.

- C. The Government will reinspect all turf at the end of the One Year Warranty. The Contractor will replace any dead, missing, or defective turf immediately. The Warranty will end on the date of this inspection provided the Contractor has complied with the work required by this specification. The Contractor shall also comply with the following requirements:
1. Replace dead, missing or defective turf prior to final inspection.
 2. Complete remedial measures directed by the Resident Engineer to ensure turf survival.
 3. Repair damage caused while making turf replacement.

1.9 APPLICABLE PUBLICATIONS

- A. The publications listed below, form a part of this specification to the extent referenced. The publications are referenced in the text by basic designation only.
- B. Hortus Third, A Concise Dictionary of Plants Cultivated in the U.S. and Canada.
- C. American Society for Testing and Materials (ASTM) Publications:
- C136-06Sieve Analysis of Fine and Coarse Aggregates
- D. Turfgrass Producers International:
- Turfgrass Sodding.
- E. U. S. Department of Agriculture Federal Seed Act.
- 1998Rules and Regulations

PART 2 - PRODUCTS

2.1 GENERAL

- A. All turf material will conform to the varieties specified and be true to botanical name as listed in Hortus Third.

2.2 TOPSOIL

- A. Topsoil shall be a well-graded soil of good uniform quality. It shall be a natural, friable soil representative of productive soils in the vicinity. Topsoil shall be free of admixture of subsoil, foreign matter, objects larger than 25 mm (one inch) in any dimension, toxic substances, weeds and any material or substances that may be harmful to plant growth and shall have a pH value of not less than 5.0 nor more than 7.5.
- B. Obtain material from stockpiles established under Section 31 20 00, EARTH MOVING, subparagraph, Stripping Topsoil, that meet the general requirements as stated above. Amend topsoil not meeting the pH range specified by the addition of pH adjusters.
- C. If sufficient topsoil is not available on the site to meet the depth as specified herein, the Contractor shall furnish additional topsoil. At least 10 days prior to topsoil delivery, notify the Resident Engineer of the source(s) from which topsoil is to be furnished. Obtain topsoil from

well drained areas. Additional topsoil shall meet the general requirements as stated above and comply with the requirements specified in Section 01 45 29, TESTING LABORATORY SERVICES. Amend topsoil not meeting the pH range specified by the addition of pH adjusters.

2.3 SOIL CONDITIONERS

- A. Organic Matter shall be commercially prepared compost, composted sufficiently to be free of all woody fibers, seeds, and leaf structures, and free of toxic and nonorganic matter.
- B. Fertilizer: Agricultural fertilizer of a formula indicated by the soil test. Fertilizers shall be organic, slow-release compositions whenever applicable

2.4 TURF FERTILIZER

- A. Provide turf fertilizer that is commercial grade, free flowing, uniform in composition, and conforms to applicable state and federal regulations. Granular fertilizer shall bear the manufacturer's warranted statement of analysis. Granular fertilizer shall contain a minimum percentage by weight of 13% nitrogen (of which 50 percent shall be organic), 13% available phosphoric acid, and 13% potash. Liquid starter fertilizer for use in the hydro seed slurry will be commercial type with 50 percent of the nitrogen in slow release form.

2.5 EROSION CONTROL

- A. Erosion control blanket material shall be cellulose fiber blanket bonded to 6 mm (1/4 inch) square plastic net weighing 10 kg/100 m² (20 pounds per 1000 square feet) in 1250 mm (50 inch) wide rolls.

2.6 WATER

- A. Water shall not contain elements toxic to plant life. It shall be obtained as specified in Section 01 00 00, GENERAL REQUIREMENTS, paragraph, Temporary Services at no cost to the Contractor.

2.7 SEED

- A. Seed shall be state-certified seed of the latest season's crop and shall be delivered in original sealed packages bearing the producer's warranted analysis for percentages of mixtures, purity, germination, weed seed content, and inert material. Seed shall be labeled in conformance with U. S. Department of Agriculture rules and regulations under the Federal Seed Act and applicable state seed laws. Seed that has become wet, moldy, or otherwise damaged will not be acceptable. Onsite seed mixing shall be done only in the presence of the Resident Engineer. Seed mixtures shall be proportioned by weight as follows:

NAME OF GRASS

(Botanical and Common)	<u>Percent</u>
Poa pratensis cv. (Kentucky Bluegrass cultivar)	65%
Festuca rubra (Creeping Red Fescue)	8.3%
Festuca rubra var. commutata (Fine-leaved Perennial Ryegrass)	13.3%
Secale cereale (Annual Ryegrass)	13.3%
<u>Percent Germination</u>	<u>Maximum Percent Weed Seed</u>
85%	0.5%
85%	0.5%
85%	0.5%
85%	0.5%

2.8 HERBICIDES

- A. All herbicides shall be properly labeled and registered with the U.S. Department of Agriculture. Keep all herbicides in the original labeled containers indicating the analysis and method of use.

PART 3 - EXECUTION

3.1 TILLAGE FOR TURF AREAS

- A. Thoroughly till the soil to a depth of at least 100 mm (4 inches) by scarifying, disking, harrowing, or other approved methods. This is particularly important in areas where heavy equipment has been used, and especially under wet soil conditions. Remove all debris and stones larger than 25 mm (one inch) remaining on the surface after tillage in preparation for finish grading. To minimize erosion, do not till areas of 3:1 slope ratio or greater. Scarify these areas to a 50 mm (one inch) depth and remove debris and stones.

3.2 FINISH GRADING

- A. After tilling the soil for bonding of topsoil with the subsoil, spread the topsoil evenly to a minimum depth of 100 mm (4 inches). Incorporate topsoil at least 50 to 75 mm (2 to 3 inches) into the subsoil to avoid soil layering. Do not spread topsoil when frozen or excessively wet or dry. Correct irregularities in finished surfaces to eliminate depressions. Protect finished topsoil areas from damage by vehicular or pedestrian traffic. Complete lawn work only after areas are brought to finished grade.

3.3 APPLICATION OF FERTILIZER FOR TURF AREAS

- A. Incorporate fertilizers into the soil to a depth of at least 100 mm (4 inches) as part of the finish grading operation. Immediately restore the soil to an even condition before any turf work.

3.4 MECHANICAL SEEDING

- A. Broadcast seed by approved sowing equipment at the rate of 3.12 kg/100 m² (6.89 pounds per 1,000 square feet). Sow one half of the seed in one direction, and the remainder sown at right angles to the first sowing. Cover seed to an average depth of 6 mm (1/4 inch) by means of spike-tooth harrow, cultipacker, or other approved device.
- B. Immediately after seeding, firm up the entire area with a roller not exceeding 225 kg/m (150 pounds per foot) of roller width. Where seeding is performed with a cultipacker-type seeder or where seed is applied in combination with hydro-mulching, no rolling is required.
- C. Immediately after preparing the seeded area, evenly spread an organic mulch of straw by hand or by approved mechanical blowers at the rate of 0.5 kg/m² (2 tons per acre). Application shall allow some sunlight to penetrate and air to circulate but also reduce soil and seed erosion and conserve soil moisture. Anchor mulch by a mulch tiller.

3.5 HYDROSEEDING

- A. When hydroseeding, mix the seed and slow release starter fertilizer, or the seed, fertilizer, lime when required and approved wood cellulose mulch material in the required amount of water to produce a homogeneous slurry and then uniformly apply slurry under pressure at the following rate. Slurry shall consist of 3.12 kg (6.89 pounds) of seed and 4.7 kg (10.3 pounds) of turf fertilizer in 35 L/100 m² (9.2 gallons per 1,000 square feet) of water. When using wood cellulose mulch, incorporate it as an integral part of the slurry mix after the seed and fertilizer have been thoroughly mixed. Apply the slurry mix at the rate of 27.2 kg/100 m² (60 pounds per 1,000 square feet) (dry weight).

3.6 WATERING

- A. Apply water to the turf areas immediately following installation at a rate sufficient to ensure thorough wetting of the soil to a depth of at least 100 mm (4 inches). Supervise watering operation to prevent run-off. Supply all pumps, hoses, pipelines, and sprinkling equipment. Repair all areas damaged by water operations.

3.7 PROTECTION OF TURF AREAS

- A. Immediately after installation of the turf areas, protect against traffic or other use by erecting barricades, as required, and placing approved signs at appropriate intervals until final acceptance.

3.8 EROSION CONTROL MATERIAL

- A. Install and maintain erosion control material meeting the requirements of this specification on the designated areas as shown and specified. Prepare, fertilize and vegetate the area(s) to be covered, as specified, before the erosion material is placed. Immediately following the seeding operations,

lay the material evenly and smoothly and in contact with the soil throughout. Omit the straw mulch from all seeded areas receiving the erosion control material.

- B. For waterways, unroll the material in the direction of waterflow. When two or more strips are required to cover a ditch area, they shall overlap at least 100 mm (4 inches). In case a strip is to be spliced lengthwise, the ends of the strips shall overlap at least 150 mm (6 inches) with the upgrade section on top.
- C. When using erosion control material on slopes, place the material either horizontally or vertically to the slope with the edges and ends of adjacent strips butted tightly against each other.
- D. Staple each strip in three rows (each edge and center with the center row alternately spaced) with staples spaced not more than 1200 mm (4 feet) longitudinally. When using two or more strips side by side on slopes, use a common row of staples on the adjoining strips. Staple all end strips at 300 mm (one foot) intervals at the end. Firmly embed staples in the underlying soil.
- E. Maintenance shall consist of repairs made necessary by erosion, wind, or any other cause. Maintain, protect, repair, or replace the erosion control material until the Termination of the Plant and Warranty Period.

3.9 RESTORATION AND CLEAN-UP

- A. Where existing or new turf areas have been damaged or scarred during planting and construction operations, restore disturbed area to their original condition. Keep at least one paved pedestrian access route and one paved vehicular access route to each building clean at all times. In areas where planting and turf work have been completed, clear the area of all debris, spoil piles, and containers. Clear all other paved areas when work in adjacent areas is completed. Remove all debris, rubbish and excess material from the station.

3.10 ENVIRONMENTAL PROTECTION

- A. All work and Contractor operations shall comply with the requirements of Section 01 57 19, TEMPORARY ENVIRONMENTAL CONTROLS.

- - - END - - -

SECTION 33 30 00
SANITARY SEWERAGE UTILITIES

PART 1 - GENERAL

1.1 DESCRIPTION:

Outside, underground sanitary sewer system, complete, ready for operation, including all gravity flow lines, manholes, cleanouts, frames, covers, structures, appurtenances, and connections to new building and structure, service lines, existing sanitary sewer lines, and existing sanitary structures, and all other incidentals.

1.2 RELATED WORK:

- A. Maintenance of Existing Utilities: Section 01 00 00, GENERAL REQUIREMENTS.
- B. Excavation, Trench Widths, Pipe Bedding, Backfill, Shoring, Sheeting, Bracing: Section 31 20 00, EARTH MOVING. Dewatering: Section 31 23 19, DEWATERING.
- C. Concrete Work Reinforcing, Placement and Finishing: Section 03 30 00, CAST-IN-PLACE CONCRETE.

1.3 QUALITY ASSURANCE:

- A. Products Criteria:
 - 1. Multiple Units: When two or more units of the same type or class of materials or equipment are required, these units shall be products of one manufacturer.
 - 2. Nameplates: Nameplate bearing manufacturer's name, or identifiable trademark, including model number, securely affixed in a conspicuous place on equipment, or name or trademark, including model number cast integrally with equipment, stamped, or otherwise permanently marked on each item of equipment.
- B. Comply with the rules and regulations of the Public Utility having jurisdiction over the connection to Public Sanitary Sewer lines and the extension, and/or modifications to Public Utility Systems.

1.4 SUBMITTALS:

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturers' Literature and Data: Submit the following as one package:
 - 1. Pipe, Fittings, and, Appurtenances.
 - 2. Jointing Material.
 - 3. Manhole and Structure Material.
 - 4. Frames and Covers.

5. Steps and Ladders.

1.5 APPLICABLE PUBLICATIONS:

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American Society for Testing and Materials (ASTM):
 - D698-00a1Laboratory Compaction Characteristics of Soil Using Standard Effort (12,400 ft-lbf/ft³ (600 kN-m/m³))
 - D3034-04aType PSM Poly (Vinyl Chloride) (PVC) Sewer Pipe and Fittings
 - D3212-96a (2003) e1Joints for Drain and Sewer Plastic Pipes Using Flexible Elastomeric Seals
 - D3350-05Polyethylene Plastics Pipe and Fittings Materials
 - D4101-05a.Polypropylene Injection and Extrusion Materials
 - F477-02e1Elastomeric Seals (Gaskets) for Joining Plastic Pipe
 - F679-06Poly (vinyl chloride) (PVC) Large-Diameter Plastic Gravity Sewer Pipe and Fittings
 - F714-05Polyethylene (PE) Plastic Pipe (SDR-PR) Based on Outside Diameter
 - F949-03Poly (Vinyl Chloride) (PVC) Corrugated Sewer Pipe with Smooth Interior and Fittings
- C. American Water Works Association (AWWA):
 - C605-94Underground Installation of Polyvinyl (PVC) Pressure Pipe and Fittings for Water
 - C900-97Polyvinyl Chloride (PVC) Pressure Pipe, 100 mm (4 inches) Through 300 mm (12 inches) for Water Distribution
- D. American Association of State Highway and Transportation Officials (AASHTO):
 - M198-05Joints for Concrete Pipe, Manholes, and Precast Box Sections using Preformed Flexible Joint Sealants
- E. Uni-Bell PVC Pipe Association:
 - Uni-B-6-98Recommended Practice Low Pressure Air Testing of Installed Sewer Pipe

PART 2 - PRODUCTS

2.1 PIPING:

A. Gravity Flow Lines (Pipe and Fittings):

1. Polyvinyl Chloride (PVC):

- a. Pipe and Fittings, 100 to 375 mm (4 to 15 inches) in diameter, shall conform to ASTM D3034, Type PSM, SDR 35. Pipe and fittings shall have elastomeric gasket joints providing a watertight seal when tested in accordance with ASTM D3212. Gaskets shall conform to ASTM F477. Solvent welded joints shall not be permitted.
- b. Pipe and fittings, 450 to 900 mm (18 to 36 inches) in diameter, shall be solid wall or have a corrugated or ribbed exterior profile and a smooth interior. Pipe shall conform to the following:
 - 1) Pipe and fittings shall conform to ASTM F949 corrugated sewer pipe with a smooth interior. The corrugated outer wall shall be fused to the smooth interwall at the corrugation valley. Pipe and fitting shall have a smooth bell, elastomeric joints conforming to ASTM D3212, and shall have a minimum pipe stiffness of 350 kPa (50 psi) at 5 percent deflection, when tested in accordance with ASTM D2412. Corrugation shall be perpendicular to the axis of the pipe to allow gaskets to be installed on field cut sections of pipe without the requirement for special fittings.
 - 2) Ribbed wall PVC pipe and fittings shall conform to ASTM F794 ribbed sewer pipe with smooth interior pipe and fittings shall have a smooth bell, elastomeric joints conforming to ASTM D3212, and shall have a minimum pipe stiffness of 320 kPa (46 psi) when tested in accordance with ASTM D 2412, at 5 percent vertical deflection. Joints shall not leak at 7.6 m (25 feet) of head under 5 percent deflection.
 - 3) Solid wall pipe and fittings shall conform to ASTM F679, SDR 35 pipe and fittings shall gaskets conforming to ASTM F477, and shall be able to withstand a hydrostatic pressure of 345 kPa (50 psi).

2.2 JOINTING MATERIAL:

A. Gravity Flow Lines:

1. Polyvinyl Chloride (PVC) Pipe (Gravity Use): Joints, ASTM D3212. Elastomeric gasket, ASTM F477.

2.3 CONCRETE:

Concrete shall have a minimum compressive strength of 20 MPa (3000 psi) at 28 days. The cement shall be Type III conforming to ASTM C150. Concrete shall conform with the provisions of Division 03 of these specifications.

2.4 WARNING TAPE:

Standard, .1mm (4Mil) polyethylene 76 mm (3 inch) wide tape detectable type, green with black letters and imprinted with "CAUTION BURIED SEWER LINE BELOW".

PART 3 - EXECUTION

3.1 BUILDING SERVICE LINES:

- A. Install sanitary sewer service lines to point of connection within approximately 1500 mm (5 feet) outside of buildings where service is required and make connections. Coordinate the invert and location of the service line with the Contractor installing the building lines.
- B. Connections of service line to building piping shall be made after the new sanitary sewer system has been constructed, tested, and accepted for operation by the Resident Engineer. The Contractor shall install all temporary caps or plugs required for testing.
- C. When building services have not been installed at the time when the sanitary sewer system is complete, provide temporary plugs or caps at the ends of all service lines. Mark the location and depth of the service lines with continuous warning tape placed 300 mm (12 inches) above service lines.

3.2 ABANDONED MANHOLES STRUCTURES AND PIPING:

- A. Manholes and Structures Outside of Building Areas: Remove frame and cover, cut and remove the top of an elevation of 600 mm (2 feet) below finished grade. Fill the remaining portion with compacted gravel or crushed rock or concrete.
- B. Manholes and Structures with Building Areas: Remove frame and cover and remove the entire structure and the base.
- C. Piping under and within 1500 mm (5 feet) of building areas shall be // completely removed.
- D. Piping outside of building areas shall have all ends of the piping at the limit of the abandonment and within structures and manholes, plugged with concrete, and abandoned in-place.
- E. The Contractor shall comply with all OSHA confined space requirements while working within existing manholes and structures.
- F. When the limit of the abandonment terminates in an existing manhole to remain, the flow line in the bench of the manhole to the abandoned line shall be filled with concrete and shaped to maintain the flowline of the lines to remain.

3.3 REGRADING:

- A. Raise or lower existing manholes and structures frames and covers, cleanout frames and covers and valve boxes in regraded areas to finish grade. Carefully remove, clean and salvage cast iron frames and covers. Adjust the elevation of the top of the manhole or structure as detailed on the drawings. Adjust the elevation of the cleanout pipe riser, and reinstall the cap or plug. Reset cast iron frame and cover, grouting below and around the frame. Install concrete collar around reset frame and cover as specified for new construction.
- B. During periods when work is progressing on adjusting manholes or structures cover elevations, the Contractor shall install a temporary cover above the bench of the structure or manhole. The temporary cover shall be installed above the high flow elevation within the structure, and shall prevent debris from entering the wastewater stream.
- C. The Contractor shall comply with all OSHA confined space requirements when working within existing structures.

3.4 CONNECTIONS TO EXISTING VA OWNED MANHOLES:

- A. During construction of new connections to existing manholes, it shall be the sole responsibility of the Contractor to maintain continued sanitary sewer service to all buildings and users upstream. The contractor shall provide, install, and maintain all pumping, conveyance system, dams, weirs, etc. required to maintain the continuous flow of sewage. All temporary measures required to meet this requirement shall be subject to the review of the Resident Engineer.
- B. Core existing structure, install pipe at the design invert. Install an elastomeric gasket around the pipe, and grout the interstitial space between the pipe and the core.
- C. The bench of the manhole shall be cleaned and reshaped to provide a smooth flowline for all pipes connected to the manhole.
- D. Connections and alterations to existing manholes shall be constructed so that finished work conforms as nearly as practicable to the applicable requirements specified for new manholes, including concrete and masonry work, cutting and shaping.

3.5 PIPE SEPARATION:

- A. Horizontal Separation - Water Mains and Sewers:
 - 1. Existing and proposed water mains shall be at least 3 meters (10 feet) horizontally from any proposed gravity flow and pressure (force main) sanitary sewer or sewer service connection.
 - 2. Gravity flow mains and pressure (force) mains may be located closer than 3 meters (10 feet) but not closer than 1.8 m (6 feet) to a water main when:
 - a. Local conditions prevent a lateral separation of ten feet; and

- b. The water main invert is at least 450 mm (18 inches) above the crown of the gravity sewer or 600 mm (24 inches) above the crown of the pressure (force) main; and
 - c. The water main is in a separate trench separated by undisturbed earth.
- 3. When it is impossible to meet (1) or (2) above, both the water main and sanitary sewer main shall be constructed of push-on or mechanical joint ductile iron pipe. The pipe for the sanitary sewer main shall comply with the specifications for pressure (force) mains, and the water main material shall comply with Section 33 10 00, WATER UTILITIES. The sewer shall be pressure tested as specified for pressure (force) mains before backfilling.
- B. Vertical Separation - Water Mains and Sewers at Crossings:
 - 1. Water mains shall be separated from sewer mains so that the invert of the water main is a minimum of 600 mm (24 inches) above the crown of gravity flow sewer or 1200 mm (48 inches) above the crown of pressure (force) mains. The vertical separation shall be maintained within 3 meters (10 feet) horizontally of the sewer and water crossing. When these vertical separations are met, no additional protection is required.
 - 2. In no case shall pressure (force) sanitary main cross above, or within 600 mm (24 inches) of water lines.
 - 3. When it is impossible to meet (1) above, the gravity flow sewer may be installed 450 mm (18 inches) above or 300 mm (12 inches) below the water main, provided that both the water main and sewer shall be constructed of push-on or mechanical ductile pipe. Pressure (Force) sewers may be installed 600 mm (24 inches) below the water line provided both the water line and sewer line are constructed of ductile iron pipe. The pipe for the sewer shall conform to the requirements for pressure sewers specified herein. Piping for the water main shall conform to Section 33 10 00, WATER UTILITIES.
 - 4. The required vertical separation between the sewer and the water main shall extend on each side of the crossing until the perpendicular distance from the water main to the sewer line is at least 3 meters (10 feet).

3.6 GENERAL PIPING INSTALLATION:

- A. Lay pipes true to line and grade. Gravity flow sewer shall be laid with bells facing upgrade. Pressure (force) mains shall have the bells facing the direction of flow.
- B. Do not lay pipe on unstable material, in wet trench or when trench and weather conditions are unsuitable for the work.
- C. Support pipe on compacted bedding material. Excavate bell holes only large enough to properly make the joint.

- D. Inspect pipes and fittings, for defects before installation. Defective materials shall be plainly marked and removed from the site. Cut pipe shall have smooth regular ends at right angles to axis of pipe.
- E. Clean interior of all pipe thoroughly before installation. When work is not in progress, open ends of pipe shall be closed securely to prevent entrance of storm water, dirt or other substances.
- F. Lower pipe into trench carefully and bring to proper line, grade, and joint. After jointing, interior of each pipe shall be thoroughly wiped or swabbed to remove any dirt, trash or excess jointing materials.
- G. Do not lay sewer pipe in same trench with another pipe or other utility. Sanitary sewers shall cross at least 600 mm (2 feet) below water lines.
- H. Do not walk on pipe in trenches until covered by layers of bedding or backfill material to a depth of 300 mm (12 inches) over the crown of the pipe.
- I. Warning tape shall be continuously placed 300 mm (12 inches) above sewer pipe
- J. Install gravity sewer line in accordance with the provisions of these specifications and the following standards:
 - 1. Polyvinyl Chloride (PVC) Piping: ASTM D2321.

3.7 CLEANOUTS:

- A. 150 millimeters (6 inches) in diameter and consisting of a ductile iron 45 degree fitting on end of run, or combination Y fitting and 1/8 bend in the run with ductile iron pipe extension, water tight plug or cap and cast frame and cover flush with finished grade. Center-set cleanouts, located in unpaved areas, in a 300 by 300 by 150 mm (12 by 12 by 6 inches) thick concrete slab set flush with adjacent finished grade. Where cleanout is in force main, provide a blind flange top connection. The center of the flange shall be equipped with a 50 mm (2 inches) base valve to allow the pressure in the line to be relieved prior to removal of the blind flange. Frames and covers for pressure (force) mains shall be 600 mm (24 inches) in diameter.
- B. The top of the cleanout assembly shall be 50 mm (2 inches) below the bottom of the cover to prevent loads being transferred from the frame and cover to the piping.

3.8 INSPECTION OF SEWERS:

Inspect and obtain the Resident Engineer's approval. Thoroughly flush out before inspection.

Lamp test between structures and show full bore indicating sewer is true to line and grade. Lip at joints on the inside of gravity sewer lines are not acceptable.

3.9 TESTING OF SANITARY SEWERS:

- A. Gravity Sewers and Manholes (Select one of the following):

1. Air Test: Vitrified Clay Pipe ASTM C828. PVC Pipe, Uni-Bell Uni-B-6. Clean and isolate the section of sewer line to be tested. Plug or cap the ends of all branches, laterals, tees, wyes, and stubs to be included in the test to prevent air leakage. The line shall be pressurized to 28 kPa (4 psi) and allowed to stabilize. After pressure stabilization, the pressure shall be dropped to 24 kPa (3.5 psi) greater than the average back-pressure of any groundwater above the sewer. The minimum test time shall be as specified in Uni-Bell Uni-B-6.
 2. Exfiltration Test:
 - a. Subject pipe to hydrostatic pressure produced by head of water at depth of 900 mm (3 feet) above invert of sewer at upper manhole under test. In areas where ground water exists, head of water shall be 900 mm (3 feet) above existing water table. Maintain head of water for one hour for full absorption by pipe body before testing. During one hour test period, measured maximum allowable rate of exfiltration for any section of sewer shall be 11 L (3.0 gallons) per hour per 30 m (100 feet).
 - b. If measurements indicate exfiltration is greater than maximum allowable leakage, take additional measurements until leaks are located. Repair and retest.
 3. Infiltration Test: If ground water level is greater than 900 mm (3 feet) above invert of the upper manhole, infiltration tests are acceptable. Allowable leakage for this test will be the same as for the exfiltration test.
- B. Pressure (Force) Mains: Test at 690 kPa (100 psi) for two hours. Leakage shall be per the following:

$$L=J*D*\sqrt{P}/4500$$

Where:

L = Maximum Allowable Leakage in Gallons per Hour

J = Number of Joints in Test Area

D = Diameter of Pipe in Inches

P = Average Test Pressure (Psi)

- C. Testing of Fiberglass Sewage Holding Tanks: No leakage at 35 kPa (5 psi) air pressure test with 5:1 safety factor. Test by Contractor after installation.
- D. Testing of Concrete Wet Well: No leakage with the wet well completely filled with water for a duration of 4 hours.

--- E N D ---

SECTION 33 40 00
STORM DRAINAGE UTILITIES

PART 1 - GENERAL

1.1 DESCRIPTION:

This section specifies construction of outside, underground storm sewer systems. The storm sewer systems shall be complete and ready for operation, including all drainage structures, frames, grate and covers, connections to new buildings, structure service lines, existing storm sewer lines and existing drainage structures and all required incidentals.

1.2 RELATED WORK:

- A. Maintenance of Existing Utilities: Section 01 00 00, GENERAL REQUIREMENTS.
- B. Excavation, Trench Widths, Pipe Bedding, Backfill, Shoring, Sheeting, Bracing: Section 31 20 00, EARTH MOVING.
- C. Concrete Work, Reinforcing, Placement and Finishing: Section 03 30 00, CAST-IN-PLACE CONCRETE.
- D. Fabrication of Steel Ladders: Section 05 50 00, METAL FABRICATIONS.

1.3 QUALITY ASSURANCE:

- A. Products Criteria:
 - 1. Multiple Units: When two or more units of the same type or class of materials or equipment are required, these units shall be products of one manufacturer.
 - 2. Nameplates: Nameplate bearing manufacturer's name, or identifiable trademark, securely affixed in a conspicuous place on equipment, or name or trademark cast integrally with equipment, stamped, or otherwise permanently marked on each item of equipment.
- B. Comply with the rules and regulations of the Public Utility having jurisdiction over the connection to public storm sewer lines and the extension, and/or modifications to Public Utility systems.

1.4 SUBMITTALS:

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturers' Literature and Data: Submit the following as one package:
 - 1. Piping.
 - 2. Jointing material.
 - 3. Manhole, inlet and catch basin material.
 - 4. Frames and covers.

5. Steps.
 6. Resilient connectors and downspout boots.
- C. One copy of State Department of Transportation standard details of MANHOLES, INLETS and catch basins.
- D. One copy of State Department of Transportation specification.

1.5 APPLICABLE PUBLICATIONS:

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American Society for Testing and Materials (ASTM):
- A48-03/A48M-03 Gray Iron Castings
 - A536-84(2004)..... Ductile Iron Castings
 - A615-05/A615M-05 Deformed and Plain-Billet Steel Bars for Concrete Reinforcement
 - C76-05a/C76M-05a Reinforced Concrete Culvert, Storm Drain and Sewer Pipe
 - C150-04ae1 Portland Cement
 - C443-05/C443M-05 Joints for Concrete Pipe and Manholes, Using Rubber Gaskets
 - C478-03a/C478M-03a Precast Reinforced Concrete Manhole Sections
 - C857-95(2001)..... Minimum Structural Design Loading for Underground Precast Concrete Utility Structures
 - C923-02/C923M-02 Resilient Connectors between Reinforced Concrete Manhole Structures, Pipes and Materials
 - C924-02/C924M-02 Testing Concrete Pipe Sewer Lines by Low Pressure Air Test Method
 - C1103-03/C1103M-03 Joint Acceptance Testing of Installed Precast Concrete Pipe Sewer Lines
 - D698-00ae1 Laboratory Compaction Characteristics of Soil Using Standard Effort (12,400 ft-lbf/ft³ (600 kN-m/m³))
 - D1056-00 Flexible Cellular Materials-Sponge or Expanded Rubber
 - D3034-04a Type PSM Poly (Vinyl Chloride) (PVC) Sewer Pipe and Fittings
 - D3212-96a(2003)e1 Joints for Drain and Sewer Plastic Pipes Using Flexible Elastomeric Seals
 - D3350-04 Polyethylene Plastics Pipe and Fittings Materials
 - F477-02e1 Elastomeric Seals (Gaskets) for Joining Plastic Pipe

F679-03 Poly (Vinyl Chloride) (PVC) Large-Diameter Plastic Gravity
Sewer Pipe and Fittings

F949-03 Poly (Vinyl Chloride) (PVC) Corrugated Sewer Pipe with
Smooth Interior

F1417-92(2005) Installation Acceptance of Plastic Gravity Sewer Lines Using
Low-Pressure Air

NOTE: ASTM test methods shall be the current version as of the date of advertisement of the project.

C. American Association of State Highway and Transportation Officials (AASHTO):

M198-05 Joints for Circular Concrete Sewer and Culvert Pipe Using
Flexible Watertight Gaskets

PART 2 - PRODUCTS

2.1 PIPING:

A. Gravity Lines (Pipe and Appurtenances):

1. Concrete:

- a. Reinforced pipe, ASTM C76, Class III, or ASTM 19.7kN/lm (1350 lbs/lf) per 300 mm (1 foot) inside dia. Joints shall be watertight flexible joints made with rubber-type gaskets conforming to ASTM C443.

2. Polyvinyl Chloride (PVC):

- a. Pipe and Fittings, Type PSM PVC Pipe, shall conform to ASTM D3034, Type PSM, SDR 35. Pipe and fittings shall have elastomeric gasket joints providing a watertight seal when tested in accordance with ASTM D 3212. Gaskets shall conform to ASTM F 477. Solvent welded joints shall not be permitted.
- b. Pipe and fittings, smooth wall, corrugated or ribbed PVC, shall conform to the following:
 - 1) Pipe and fittings shall conform to ASTM F949 corrugated sewer pipe with a smooth interior. The corrugated outer wall shall be fused to the smooth interwall at the corrugation valley. Pipe and fitting shall have a smooth bell, elastomeric joints conforming to ASTM D 3212, and shall have a minimum pipe stiffness of 345 kPa (50 psi) at 5 percent deflection, when tested in accordance with ASTM D 2412. Corrugation shall be perpendicular to the axis of the pipe to allow gaskets to be installed on field cut sections of pipe without the requirement for special fittings.
 - 2) Ribbed wall PVC pipe and fittings shall conform to ASTM F794, Series 46. Ribbed sewer pipe with smooth interior pipe and fittings shall have a smooth bell,

elastomeric joints conforming to ASTM D 3212, and shall have a minimum pipe stiffness of 320 kPa (46 psi) when tested in accordance with ASTM D 2412, at 5 percent vertical deflection. Joints shall not leak at 7.6 m (25 feet) of head under 5 percent deflection.

- 3) Solid wall pipe and fittings shall conform to ASTM F 679, SDR 35 pipe and fittings shall gaskets conforming to ASTM F 477, and shall be able to withstand a hydrostatic pressure of 345 kPa (50 psi).

3. High Density Polyethylene (HDPE):

- a. Smooth Wall PE Pipe: Shall comply with ASTM F714, DR 21 for pipes 75 to 600 mm (3 to 24 inches), and SDR 26 for pipes 650 to 1200 mm (26 to 48 inches). Pipe shall be produced from PE certified by the resin producer as meeting the requirements of ASTM D3350, minimum cell class 335434C.
- b. Corrugated PE Pipe: Shall comply with AASHTO M294, Type S for pipes 300 to 1500 mm (12 to 60 inches). Pipe walls shall have following minimum properties:

<u>Nominal Size</u>	<u>Minimum Wall Area</u>	<u>Min. Moment of Inertia mm⁴/mm (in⁴/in)</u>
300 mm (12 in)	3200 mm ² /m (1.50 in ² /ft)	390 (.024)
375 mm (15 in)	4000 mm ² /m (1.91 in ² /ft)	870 (.053)
450 mm (18 in)	4900 mm ² /m (2.34 in ² /ft)	1020 (.062)
600 mm (24 in)	6600 mm ² /m (3.14 in ² /ft)	1900 (.116)
750 mm (30 in)	8300 mm ² /m (3.92 in ² /ft)	2670 (.163)
900 mm (36 in)	9500 mm ² /m (4.50 in ² /ft)	3640 (.222)
1050 mm (42 in)	9900 mm ² /m (4.69 in ² /ft)	8900 (.543)
1200 mm (48 in)	10900 mm ² /m (5.15 in ² /ft)	8900 (.543)
1350 mm (54 in)	12000 mm ² /m (5.67 in ² /ft)	13110 (.800)
1500 mm (60 in)	13650 mm ² /m (6.45 in ² /ft)	13110 (.800)

- c. Profile Wall PE Pipe: Shall comply with ASTM F894, Class 160, produced from PE certified by the resin producer as meeting the requirements of ASTM D3350, Minimum cell class 334433C. Pipe walls shall have following minimum properties:

<u>Nominal Size</u>	<u>Minimum Wall Area</u>	<u>Min. Moment of Inertia mm⁴/mm (in⁴/in)</u>
450 mm (18 in)	6300 mm ² /m (2.96 in ² /ft)	850 (.052)
525 mm (21 in)	8800 mm ² /m (4.15 in ² /ft)	1150 (.070)
600 mm (24 in)	9900 mm ² /m (4.66 in ² /ft)	1330 (.081)
675 mm (27 in)	12500 mm ² /m (5.91 in ² /ft)	2050 (.125)
750 mm (30 in)	12500 mm ² /m (5.91 in ² /ft)	2050 (.125)
825 mm (33 in)	14800 mm ² /m (6.99 in ² /ft)	2640 (.161)
900 mm (36 in)	17100 mm ² /m (8.08 in ² /ft)	3310 (.202)
1050 mm (42 in)	16500 mm ² /m (7.81 in ² /ft)	4540 (.277)
1200 mm (48 in)	18700 mm ² /m (8.82 in ² /ft)	5540 (.338)

2.2 JOINTING MATERIAL:

- A. Concrete Pipe: Rubber gasket ASTM C443.
- B. Polyvinyl Chloride (PVC) Pipe:
 - 1. PVC Plastic Pipe: Joints shall comply with ASTM D3212, Elastomeric Gaskets shall comply with ASTM F477 and as recommended by the manufacturer.
- C. PE Plastic Pipe:
 - 1. Smooth Wall PE Plastic Pipe: Pipe shall be joined using butt fusion as recommended by the manufacturer.
 - 2. Corrugated PE Plastic Pipe: Water tight joints shall be made using a PVC or PE coupling and rubber gaskets as recommended by the pipe manufacturer. Rubber gaskets shall conform to ASTM F477. Soil tight joints shall conform to requirements in AASHTO HB-17, Division II, for soil tightness and shall be as recommended by the manufacturer.
 - 3. Profile Wall PE Plastic Pipe: Joints shall be gasket or thermal weld type with integral bell in accordance with ASTM F894.

2.3 MANHOLES, INLETS AND CATCH BASINS:

- A. Manholes, inlets and catch basins shall be constructed of precast concrete segmental blocks, precast reinforced concrete rings, precast reinforced sections, or cast-in-place concrete. Manholes, inlets and catch basins shall be in accordance with State Department of Transportation standard details, and the following VA requirements, in case of variance, VA requirements supersede:

1. Precast Concrete Segmental Blocks: Blocks shall conform to ASTM C139 and shall not be less than 150 mm (6 inches) thick for manholes to a depth of 3.6 m (12 feet); not less than 200 mm (8 inches) thick for manholes deeper than 3.6 m (12 feet) deep. Blocks shall be not less than 200 mm (8 inches) in length. Blocks shall be shaped so that joints seal and bond effectively with cement mortar. Parge structure interior and exterior with 15 mm (1/2 inch) of cement mortar applied with a trowel and finished to an even glazed surface.
2. Precast Reinforced Concrete Rings: Rings or sections shall have an inside diameter as indicated on the drawings, and shall be not less than 1200 mm (48 inches) in diameter. Wall thickness shall conform to requirements of ASTM C76, except that lengths of the sections may be shorter as conditions require. Tops shall conform to ASTM C478. Top section shall be eccentric cone type. Steps on inside wall shall be in the same plane from bottom of structure to manhole cover.
3. Precast Reinforced Concrete Manhole Risers and Tops: Design, material and installation shall conform to requirements of ASTM C478. Top sections shall be eccentric. Steps on inside wall shall be in the same plane from bottom of structure to manhole cover.
4. Flat top manhole tops shall be reinforced concrete as detailed on the drawings.
5. Precast Catch Basins: Concrete for precast sections shall have a minimum compressive strength of 35 MPa (5,000 psi) at 28 days, ASTM A615, Grade 60 reinforcing steel, rated for AASHTO HS20-44 loading with 30 percent impact, and conform to ASTM C-857.
6. Mortar:
 - a. Precast Concrete Segmental Block Structures: By volume, 1 part of Portland cement, 1/4 part lime hydrate, and 3 parts sand.
 - b. Precast Reinforced Concrete Ring and Riser Structures: By volume, 1 part of Portland cement and 2 parts sand. Water in mixture shall produce a stiff, workable mortar, but shall not exceed 21L (5-1/2 gallons) per sack of cement.
7. Flexible sealing compound shall be packaged in extruded preformed shape, sized to completely fill the joint between precast sections, and form permanently flexible watertight seal. The sealing compound shall be non-shrink and meet AASHTO M-198B.
8. Frames and covers shall be gray cast iron conforming to ASTM A48. The frame and cover shall be rated for HS20-44 loading, have a studded pattern on the cover, and the words "storm sewer". The studs and the lettering shall be raised 8 mm (5/16 inch). The cover shall be a minimum of 600 mm (24 inches) in diameter and shall have four 19 mm (3/4 inch) vent

- holes and two lifting slots. The bearing surface of the frame and cover shall be machine finished. The cover shall fit firmly on the frame without movement when subject to traffic.
9. Manhole steps shall be polypropylene plastic coated on a No. 4 deformed rebar conforming to ASTM C478, Polypropylene shall conform to ASTM D4101. Steps shall be a minimum of 250 mm (10 inches) wide and project a minimum of 125 mm (5 inches) away from the wall. The top surface of the step shall have a studded non-slip surface. Steps shall be placed at 300 mm (12 inch) centers.
 10. Ladders, brackets and hardware shall be constructed of welded aluminum, rails shall be 9 mm (3/8 inch) by 63 mm (2-1/2 inches) spaced a minimum of 400 mm (16 inches) apart. Rungs shall be 35 mm (1-3/8 inches) in diameter and have a non-slip surface. Standoffs shall offset the ladder 180 mm (7 inches) from the wall. The ladder assembly shall be rated for a minimum of 2200 N (500 pounds).
- B. Prefabricated Corrugated Metal Manholes: Manholes shall be the type and design as indicated on the drawings and as recommended by the manufacturer.
- C. Frame and Cover for Gratings: Frame and cover for gratings shall be cast gray iron conforming to ASTM A48; cast ductile iron conforming to ASTM A536 in accordance with State Department of Transportation standard details //. Weight, shape, size, and waterway openings for grates and curb inlets shall be as indicated on the drawings.

2.4 CONCRETE:

Concrete shall be in accordance with State Department of Transportation standard. For concrete not specified in above standards, concrete shall have a minimum compressive strength of 20 MPa (3000 psi) at 28 days. The cement shall be Type III conforming to ASTM C150. Concrete shall conform to the provisions of Division 03 of these specifications.

2.5 REINFORCING STEEL:

Reinforcing steel shall be deformed bars, ASTM A615, Grade 40 unless otherwise noted.

2.6 WARNING TAPE:

Standard, 4-Mil polyethylene 76 mm (3 inch) wide tape detectable type, purple with black letters, and imprinted with "CAUTION BURIED STORM SEWER BELOW".

PART 3 – EXECUTION

3.1 Excavation For storm drains and drainage structures:

Excavation of trenches and for appurtenances and backfilling for storm drains, shall be in accordance with the applicable portions of Section 31 20 00, EARTH MOVING.

3.2 PIPE BEDDING:

The bedding surface of the pipe shall provide a firm foundation of uniform density throughout the entire length of pipe. Concrete pipe requirements are such that when no bedding class is specified, concrete pipe shall be bedded in a soil foundation accurately shaped and rounded to conform with the lowest one-fourth of the outside portion of circular pipe. When necessary, the bedding shall be tamped. Bell holes and depressions for joints shall not be more than the length, depth, and width required for properly making the particular type of joint. Plastic pipe bedding requirements shall meet the requirements of ASTM D2321. Bedding, haunching and initial backfill shall be either Class IB or Class II material. Corrugated metal pipe bedding requirements shall conform to ASTM A798.

3.3 GENERAL PIPING INSTALLATION:

- A. Lay pipes true to line and grade. Gravity flow sewer shall be laid with bells facing upgrade.
- B. Do not lay pipe on unstable material, in wet trench or when trench and weather conditions are unsuitable for the work.
- C. Support pipe on compacted bedding material. Excavate bell holes only large enough to properly make the joint.
- D. Inspect pipes and fittings, for defects before installation. Defective materials shall be plainly marked and removed from the site. Cut pipe shall have smooth regular ends at right angles to axis of pipe.
- E. Clean interior of all pipe thoroughly before installation. When work is not in progress, open ends of pipe shall be closed securely to prevent entrance of storm water, dirt or other substances.
- F. Lower pipe into trench carefully and bring to proper line, grade, and joint. After jointing, interior of each pipe shall be thoroughly wiped or swabbed to remove any dirt, trash or excess jointing materials.
- G. Do not lay sewer pipe in same trench with another pipe or other utility.
- H. Do not walk on pipe in trenches until covered by layers of shading to a depth of 300 mm (12 inches) over the crown of the pipe.
- I. Install gravity sewer line in accordance with the provisions of these specifications and the following standards:
 1. Reinforced Concrete Pipe: Comply with manufacturer's recommendations with gasketed joints.
 2. Polyvinyl Chloride (PVC) Piping: ASTM D2321.

3. High Density Polyethylene (HDPE) Piping: Comply with manufacturer's recommendations with gasketed joints.

J. Warning tape shall be continuously placed 300 mm (12 inches) above storm sewer piping.

3.4 REGRADING:

- A. Raise or lower existing manholes and structures frames and covers in regraded areas to finish grade. Carefully remove, clean and salvage cast iron frames and covers. Adjust the elevation of the top of the manhole or structure as detailed on the drawings. Reset cast iron frame and cover, grouting below and around the frame. Install concrete collar around reset frame and cover as specified for new construction.
- B. During periods when work is progressing on adjusting manholes or structures cover elevations, the Contractor shall install a temporary cover above the bench of the structure or manhole. The temporary cover shall be installed above the high flow elevation within the structure, and shall prevent debris from entering the wastewater stream.
- C. The Contractor shall comply with all OSHA confined space requirements when working within existing structures.

3.5 CONNECTIONS TO EXISTING VA-OWNED MANHOLES:

Make pipe connections and alterations to existing manholes so that finished work will conform as nearly as practicable to the applicable requirements specified for new manholes, including concrete and masonry work, cutting, and shaping.

3.6 MANHOLES, INLETS AND CATCH BASINS:

A. General:

1. Circular Structures:

- a. Precast concrete segmental blocks shall lay true and plumb. All horizontal and vertical joints shall be completely filled with mortar. Parge interior and exterior of structure with 15 mm (1/2 inch) or cement mortar applied with a trowel and finished to an even glazed surface.
- b. Precast reinforced concrete rings shall be installed true and plumb. The joints between rings and between rings and the base and top shall be sealed with a preform flexible gasket material specifically manufactured for this type of application. Adjust the length of the rings so that the eccentric conical top section will be at the required elevation. Cutting the conical top section is not acceptable.
- c. Precast reinforced concrete manhole risers and tops. Install as specified for precast reinforced concrete rings.

2. Rectangular Structures:
 - a. Reinforced concrete structures shall be installed in accordance with Division 03, CONCRETE of these specifications.
 - b. Precast concrete structures shall be placed on a 200 mm (8 inch) reinforced concrete pad, or be provided with a precast concrete base section. Structures provided with a base section shall be set on a 200 mm (8 inches) thick aggregate base course compacted to a minimum of 95 percent of the maximum density as determined by ASTM D 698. Set precast section true and plumb. Seal all joints with preform flexible gasket material.
3. Do not build structures when air temperature is 0 degrees C (32 degrees F), or below.
4. Invert channels shall be smooth and semicircular in shape conforming to inside of adjacent sewer section. Make changes in direction of flow with a smooth curve of as large a radius as size of structure will permit. Make changes in size and grade of channels gradually and evenly. Construct invert channels by one of the listed methods:
 - a. Forming directly in concrete base of structure.
 - b. Building up with brick and mortar.
5. Floor of structure outside the channels shall be smooth and slope toward channels not less than 1:12 (25mm per 300mm, 1-inch per foot) nor more than 1:6 (50mm per 300mm, 2 inches per foot). Bottom slab and benches shall be concrete.
6. The wall that supports access rungs or ladder shall be 90 degrees vertical from the floor of structure to manhole cover.
7. Install steps and ladders per the manufacturer's recommendations. Steps and ladders shall not move or flex when used. All loose steps and ladders shall be replaced by the Contractor.
8. Install manhole frames and covers on a mortar bed, and flush with the finish pavement. Frames and covers shall not move when subject to vehicular traffic. Install a concrete collar around the frame to protect the frame from moving until the adjacent pavement is placed. In unpaved areas, the rim elevation shall be 50 mm (2 inches) above the adjacent finish grade. Install a 200 mm (8 inches) thick, by 300 mm (12 inches) concrete collar around the perimeter of the frame. Slope the top of the collar away from the frame.

3.7 CURB INLETS, CATCH BASINS, AND AREA DRAINS:

Reinforced concrete as shown or precast concrete.

3.8 INSPECTION OF SEWERS:

Inspect and obtain the Resident Engineer's approval. Thoroughly flush out before inspection.

Lamp between structures and show full bore indicating sewer is true to line and grade. Lip at joints on inside of sewer is prohibited.

3.90 TESTING OF STORM SEWERS:

A. Gravity Sewers (Select one of the following):

1. Air Test: Concrete Pipes conform to ASTM C924, Plastic Pipes conform to ASTM F1417, all other pipe material conform to ASTM C828 or C924, after consulting with pipe manufacturer. Testing of individual joints shall conform to ASTM C1103.
2. Exfiltration Test:
 - a. Subject pipe to hydrostatic pressure produced by head of water at depth of 900 mm (3 feet) above invert of sewer at upper manhole under test. In areas where ground water exists, head of water shall be 900 mm (3 feet) above existing water table. Maintain head of water for one hour for full absorption by pipe body before testing. During 1 hour test period, measured maximum allowable rate of exfiltration for any section of sewer shall be 11L (3.0 gallons) per hour per 30 m (100 feet).
 - b. If measurements indicate exfiltration is greater than maximum allowable leakage, take additional measurements until leaks are located. Repair and retest.

--- E N D ---

SECTION 33 46 13 FOUNDATION DRAINAGE

PART 1 - GENERAL

1.1 DESCRIPTION:

- A. This section specifies foundation drainage system, including installation, backfill, and cleanout extensions, to place of connection to storm sewer.

1.2 RELATED WORK:

- A. Materials testing and inspection during construction: Section 01 45 29, TESTING LABORATORY SERVICES.
- B. Protection of existing utilities, fire protection services, existing equipment, roads, and pavements: Section 01 00 00, GENERAL REQUIREMENTS.
- C. Fill types and excavating and filling procedures: Section 31 20 00, EARTHMOVING.

1.3 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Product Data: Certifications from the manufacturers attesting that materials meet specification requirements.
- C. Shop Drawings: Indicate dimensions, layout of piping, high and low points of pipe inverts and gradient of slope between corners and intersections. Provide a section showing the relationship to building (footings), fill and fabric. Provide a detail of cleanouts.
- D. Samples: For each type of filter fabric, pipe, and fitting indicated
- E. Project Record Documents: Record location of pipe runs, connections, cleanouts and principal invert elevations.

1.4 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referred in the text by basic designation only.
- B. American Association of State Highway and Transportation Officials (AASHTO):
 - M288-06.....Geotextile Specification for Highway Applications
 - M252-09.....Corrugated Polyethylene Pipe, 3 inches to 10 inches.
- C. American Society for Testing and Materials (ASTM):
 - A74-05Standard Specification for Cast Iron Soil Pipe and Fittings
 - D1784-08Rigid Poly(Vinyl Chloride) (PVC) Compounds and Chlorinated Poly(Vinyl Chloride) (CPVC) Compounds.

D2321-05	Standard Practice for Underground Installation of Thermoplastic Pipe for Sewers and Other Gravity-Flow Applications
D2412-02 (08).....	Test Method for Determination of External Loading Characteristics of Plastic Pipe by Parallel-Plate Loading.
D3212-07	Joints for Drain and Sewer Plastic Pipes Using Flexible Elastomeric Seals.
D3350-10	Polyethylene Plastics Pipe and Fittings Materials.
D2729-03	Standard Specification for Poly(Vinyl Chloride) (PVC) Sewer Pipe and Fittings
D2737-03	Standard Specification for Polyethylene (PE) Plastic Tubing
D3034-06	Standard Specification for Type PSM Poly(Vinyl Chloride) (PVC) Sewer Pipe and Fittings
D4216-03	Standard Specification for Rigid Poly (Vinyl Chloride) (PVC) and Related PVC and Chlorinated Poly (Vinyl Chloride) (CPVC) Building Products Compounds
D4491-99a (09).....	Standard Test Methods for Water Permeability of Geotextiles by Permittivity.
D4355-07	Standard Test Method for Deterioration of Geotextiles by Exposure to Light, Moisture and Heat in a Xenon Arc Type Apparatus
D4533-04 (09).....	Standard Test Method for Trapezoid Tearing Strength of Geotextiles.
D4632-08	Standard Test Method for Grab Breaking Load and Elongation of Geotextiles.
D4751-04	Standard Test Method for Determining Apparent Opening Size of a Geotextile.
D4833-07	Standard Test Method for Index Puncture Resistance of Geotextiles, Geomembranes, and Related Products.
D4873-02 (09).....	Identification, Storage and Handling of Geosynthetic Rolls and Samples.
D4884-09	Strength of Sewn or Thermally Bonded Seams of Geotextiles.
F405-05	Corrugated Polyethylene (PE) Tubing and Fittings

- F477-02e1Standard Specification for Elastomeric Seals (Gaskets) for
Joining Plastic Pipe
- F794-03 (09)Poly(Vinyl Chloride) (PVC) Profile Gravity Sewer Pipe and
Fittings Based on Controlled Inside Diameter.
- F949-10Poly(Vinyl Chloride) (PVC) Corrugated Sewer Pipe With a
Smooth Interior and Fittings.

PART 2 - PRODUCTS

2.1 PIPE MATERIALS

- A. Perforated Dual Wall Corrugated Thermoplastic Pipe: Smooth interior, corrugated exterior (Type S), with integral bell and gasket connectors.
1. Provide one of the following:
 - a. Polyvinyl Chloride Pipe conforming to ASTM F 949 and F 794.
 - b. High Density Polyethylene Pipe conforming to AASHTO M 252 and ASTM F 405.
 2. Stiffness: Minimum 0.21 MPa (30 psi) measured in accordance with ASTM D2412 at 5% deflection.
 3. Provide with fittings conforming to ASTM 949, Section 4.2.3 or ASTM F 794, Section 7.2.4.
 4. Perforation: Not less than 373 sq mm/lineal m (1.90 sq in/lineal foot)
 5. Joints: Integrally-formed bell and spigot gasket connections. Elastomeric seals (gaskets) shall meet the requirements of ASTM F 477.
 6. Provide rigid pipe, not flexible coil.
- B. Provide unperforated metal or plastic pipe where drain system passes through foundation or walls.

2.2 CLEANOUTS AND CLEANOUT ACCESS COVERS:

- A. Cleanout Extension:
1. Provide solid wye section or wye saddle connection of downspout/cleanout pipe to plastic subdrain tile.
 2. Provide solid (non-perforated), plastic pipe from wye connection to just below grade to receiver / reducer.
 3. Receiver / Reducer: Provide vitreous clay pipe reducer of size required to receive cleanout fitting and to make connection to plastic pipe flange.
- B. Size: Match size of drain tile.

- C. Cleanout Fitting: Cast iron or brass.

2.3 GEOTEXTILES

- A. Separation Fabric: Non-Woven geotextile, specifically manufactured for use as a separation geotextile; made from polyolefins, polyesters, or polyamides (at least 90 percent by weight).
The geotextile shall be formed into a network such that the filaments or yarns retain dimensional stability relative to each other, and prevent edge fibers from pulling away from the geotextile. The geotextile shall have the following minimum properties determined according to ASTM D 4759 and referenced standard test methods:
 1. Grab Tensile Strength: 160 lbf; ASTM D 4632.
 2. Trapezoidal Tear Strength: 60 lbf; ASTM D 4533.
 3. Puncture Resistance: 85 lbf; ASTM D 4833.
 4. Water Flow Rate: Not less than 4 gpm per sq. ft.; ASTM D 4491.
 5. Apparent Opening Size: No. 30; ASTM D 4751.
 6. Degradation: 50 at 500 hours, ASTM D 4355.
 7. The geotextile fibers and threads used in sewing the geotextile shall be chemically resistant to commonly encountered hazardous and municipal landfill leachate, rot and mildew.
- B. Factory Prepared Seams:
 1. Treads and other materials used for seaming must have the same resistance to heat, light and ground chemicals as the fiber of the geotextile.
 2. Seam Strength: 90 percent of tensile strength when tested according to ASTM D 4884.

2.4 BEDDING AND FILL MATERIAL:

- A. See Section 31 20 00, EARTH MOVING

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Verify that trench cut is ready to receive work and excavations, dimensions, and elevations are as indicated on Drawings.
- B. Prior to installation of bedding materials or piping, examination of excavation and subgrades are to be observed by the Resident Engineer.

3.2 PREPARATION

- A. Hand trim excavations to required elevations. Correct over-excavation with as described in Section 33 20 00, EARTH MOVING.

- B. Remove large stones or other hard matter which could damage drainage piping or impede consistent backfilling or compaction.

3.3 INSTALLATION - GENERAL

- A. Install and join pipe and pipe fittings in accordance ASTM D 2321 and in accordance with pipe manufacturer's instructions.
- B. Each portion of pipe shall be thoroughly examined before being laid; defective or damaged pipe shall not be used.
- C. Provide proper means for lowering the pipe into the trench.
- D. Pipe shall not be laid in water, and the pipe shall not be laid when trench conditions or weather are unsuitable for such work.
- E. Lay pipe to slope gradients noted on Drawings; with maximum variation from true slope of 1/8 inch (3 mm) in 10 feet (3 m).
- F. Place pipe with perforations facing down.
- G. Connect pipes using integral bell and gasket connections. Follow manufacturer's written instructions.
- H. Cleanouts: Use sweep fitting and one section horizontal heavy PVC pipe at bottom. Connect to perforated drainage tile with saddle connections following the pipe manufacturer's recommendations.
 - 1. Exterior Cleanouts: Install flanged reducer / receive to flush with finish grade housing per manufacturer's recommendations including providing a concrete ring below grade to anchor the housing. Install cast iron or brass clean out fitting.
- I. Protect cleanouts during grading.

3.4 INSTALLATION - AT FOOTINGS/FOUNDATION WALLS

- A. Fill and compact to the level of the top of the footing or the bottom of the grade beam with Granular Fill, compacted to 97%.
- B. Lay filter fabric on compacted fill and footing before beginning bedding and drape to the side to permit bedding and setting of tile.
 - 1. Filter fabric shall be of sufficient width to permit to be wrapped about the pipe and the initial fill.
 - 2. Lay additional fabric back and protect during installation of bedding, pipe and initial fill.
- C. Bedding: Over footing and compacted fill, provide minimum 6 inches of Drainage Fill bedding, compacted to 95 percent.

- D. Place Subdrainage Piping as recommended by the manufacturer, maintaining a constant slope to the outlet
- E. Initial Fill (from Bedding to 12 inches (305 mm) above the Pipe): Fill over pipe with Drainage Fill. Place fill around and under the haunches of the pipe in layers as required to obtain required compaction. The backfill shall be brought up evenly on both sides of pipe and pipe system for the full length of pipe. Continue to layer and compact fill as necessary to obtain the required compaction without deforming or damaging the pipe.
- F. Wrap fabric over the top of the initial fill and lap fabric over the loose end of the fabric from under the pipe. Lap at least 6 inches.
- G. Final Fill: Cover drainage fill and geotextile with Clean Earth Fill to subgrade.
 - 1. Place fill aggregate in maximum 6 inch (150 mm) lifts, consolidating each lift.
 - 2. Increase compaction of each successive lift to obtain 95% compaction at subgrade.

Do not displace or damage pipe or tile when compacting.
- H. When drain lines are left open for connection to discharge line, the open ends shall be temporarily closed and their location marked with wooden stakes.

3.5 FIELD QUALITY CONTROL

- A. Request inspection by the Resident Engineer prior to and immediately after placing filter aggregate cover over pipe.
- B. Test for free flow of water after initial fill is complete.

3.6 PROTECTION

- A. Protect pipe, filter fabric and aggregate cover from damage or displacement until backfilling operation is complete.

- - - E N D - - -