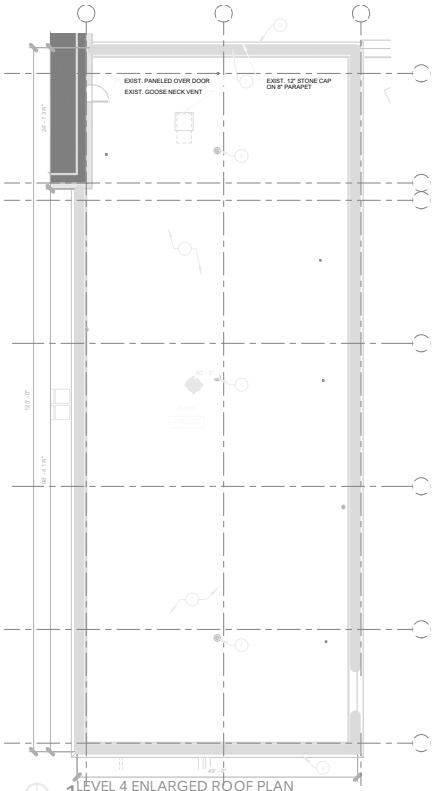

1 LEVEL 4 ENLARGED ROOF PLAN
SCALE: 1/8" = 1'-0"

ROOF DRAWING SYMBOLS

- ITEMS ON ROOF DECK
- ITEMS ABOVE ROOF DECK
- EQUIPMENT/PIPE CURB
- GOOSENECK VENT
- LIGHTNING PROTECTION
- ROOF DRAIN
- PLUMBING VENT
- SUPPLY/RETURN DUCTS
- EXHAUST VENT
- SCUPPER/OVERFLOW DRAIN
- EPDM ROOF PAVERS
- AREAS TREATED WITH FLUID APPLIED RESTORATION COATING. CLEAR DEBRIS & CLEAN PRIOR TO INSTALL.
- DRAINAGE CRICKET. SLOPE AS NEEDED. MAX. 1": 1'-0"
- NO WORK ON THIS ROOF
- ALTERNATE: SEE G100 AND SPECIFICATIONS FOR MORE INFO.
- SPRINKLER SYSTEM, DRY PIPE
- GUARDRAIL
- LADDER W/ CAGE AND CROSSOVER PLATFORM
- LADDER W/ CAGE AND CROSSOVER PLATFORM (NO CAGE)
- WINDOW CLEANING ANCHORAGE POINT LOCATION

SPECIFIC PLAN NOTES

NOTE: NOT ALL SPECIFIC PLAN NOTES APPEAR ON EVERY SHEET. THIS LIST INCLUDES ALL SPECIFIC PLAN NOTES FOR THE ENTIRE PROJECT.

1. CUT OUT & REMOVE EXISTING ROOF SYSTEM WITH WETFAILED INSULATION. PROVIDE NEW INSULATION, COVER BOARD AND EPDM MEMBRANE. MAINTAIN EXISTING ROOF SLOPE. TIE INTO EXISTING EPDM ROOF MEMBRANE PER MANUFACTURE'S RECOMMENDATIONS. PROVIDE NEW FLASHING AT WALLS, ROOF TOP UNITS, AND ROOF PENETRATIONS AS REQUIRED. PROVIDE NEW METAL COPING IN WHOLE LENGTHS.
2. CUT OUT & REMOVE EXISTING ROOF SYSTEM TO DECK. INSTALL NEW INSULATION TO ACHIEVE R-30 VALUE MIN. GREATER THICKNESS AS REQUIRED FOR 1/8" SLOPE. THICKERGREATER AS REQUIRED FOR SLOPE. INSTALL COVERBOARD AND EPDM MEMBRANE. PROVIDE NEW FLASHING AT WALLS, ROOF TOP UNITS AND ROOF PENETRATIONS AS REQUIRED.
3. REMOVE EXISTING WALKWAY PADS AS REQUIRED FOR NEW CONSTRUCTION. UPON COMPLETION OF ROOF RESTORATION, INSTALL NEW WALKWAY PADS IN SAME LOCATION. MATCH EXISTING.
4. EXISTING LADDER. MODIFY LOOSE END LENGTH TO BE NO LESS THAN 6" ABOVE EPDM.
5. REMOVE ROOF DRAIN AND PIPE. VIDEO STORM FOR CLEAR OBSTRUCTIONS UNTIL STORM DRAINS LATERAL BELOW GRADE.
6. REMOVE ROOF DRAIN AND REPLACE WITH NEW ROOF DRAIN OF EQUAL SIZE.
7. EXISTING LIGHTNING PROTECTION. REMOVE FOR WORK. REINSTALL.
8. NOT USED
9. NOT USED
10. REMOVE REFLASH AND REPLACE STONE CAP
11. PROVIDE NEW WALK PADS. TYPICAL. MATCH EXISTING
12. PROVIDE NEW ROOF SCUPPER OPENING THROUGH EXISTING MASONRY PARAPET AND PROVIDE SCUPPER PER DETAIL. ROUTE DOWNSPOUT HORIZONTALLY TO THE EXTENT POSSIBLE PER 1/100 SLOPE. MINIMUM TURN DOWN DOWNSPOUT DISCHARGE ON ROOF BELOW. PROVIDE WALL BRACKETS 5'-0" O.C. MAX.
13. GENERAL CONTRACTOR TO COORDINATE WITH COR BEFORE PERFORMING ANY AND ALL WORK IN THE VICINITY OF DESIGNATED EXIST. BIO-HAZARDOUS AND LAB EXHAUST VENTS.
14.

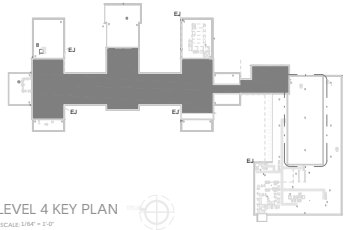

LEVEL 4 KEY PLAN
SCALE: 1/64" = 1'-0"

Revisions:	Date

VAMC CLARKSBURG
1 MED CENTER DRIVE CLARKSBURG, WV 26301

ARCHITECT/ENGINEERS:

BID DOCUMENTS

Drawing Title: LEVEL 4 ROOF PLANS	Project Title: REPLACEMENT OF OPERATING ROOMS AND OR ROOFS	Project Number	OFFICE OF FACILITIES MANAGEMENT
		Building Number: CLINICAL ADDITION	
Approved for Design Concept:	Location: LOUIS A. JOHNSON VAMC	Drawing Number: 3 of 3	VA Project Number: 540-18-025S
	Date: 05-07-2018 / Checked By: / Drawn By:		