


1. FINISHED FLOOR ELEVATION = (+12'-4") UNLESS NOTED OTHERWISE.
2. TOP OF STEEL ELEVATION = (+11'-9 3/4") U.N.O.
3. BEAMS SHALL BE EQUALLY SPACED BETWEEN COLUMN LINES, U.N.O.

- ① CONCRETE SLAB ON COMPOSITE METAL DECK PER DETAIL 150.2.
- ② NEW #1 THICK CONCRETE SHEAR WALL REINFORCED W/ #5 @ 12" O.C. EA. WA. CENTER IN WALL.
- ③ STEEL PAN STAIRS, SEE ARCH
- ④ EXISTING BUILDING, SEE ARCH
- ⑤ CHANGE IN DECK & SLAB SPAN DIRECTION AT THIS BEAM LINE.
- ⑥ SEE DETAIL 150.2 AT STEEL BEAM TO COLUMN CONNECTION THIS LOCATION.
- ⑦ SEE DETAIL 150.3 AT STEEL BEAM TO BEAM MOMENT CONNECTION THIS LOCATION.
SEE DETAIL 1050.2 AT STEEL BEAM TO COLUMN MOMENT CONNECTION THIS LOCATION.
- ⑧ 1500# MECHANICAL EQUIPMENT ON HOUSEKEEPING PAD. SEE DETAIL 705.0 AND COORDINATE WITH MECH. DOD.
- ⑨ SPACE CORNER BARS @ 5" O.C. THIS CORNER ONLY. SEE DETAIL 850.1 FOR ADDITIONAL INFORMATION.
- ⑩ MECH ACCESS PLATFORM. SEE ARCH FOR LAYOUT AND METAL GRATING SPECIFICATION.

[illegible]

SFCS Inc. ■ 305 South Jefferson Street
Roanoke, Virginia 24011.2003
540.344.6664 ■ Fax 540.343.6925
www.sfcs.com

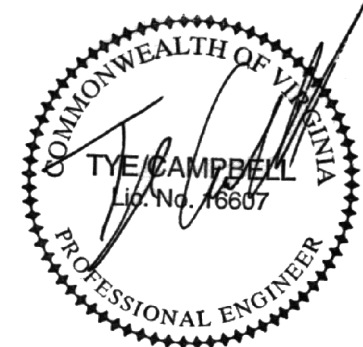

CONSTRUCTION
DOCUMENTS

Approved: GEMS Coordinator

Approved: Associate Director

Approved: Medical Center Director

Drawn:
PJW

S1.2

Dwg. 38 of 65

 Department of
Veterans Affairs