


P:\248663\DRAWINGS\248663 - PRIOR SUBMISSIONS\2010-03-23 (FINAL)\248663-E2-E3.DWG 4/19/2010 2:29 PM HO, JENNY H

Revision	Date

STAUNTON CHOW
 A DIVISION OF
HATCH MOTT MACDONALD
 545 Washington Blvd., Jersey City, NJ 07310

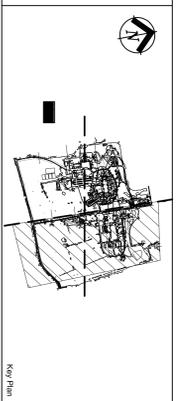

Drawing Title ELECTRICAL DEMOLITION PLAN - EAST	Approved Division Chief Approved Service Director
--	--

Project Title REPLACE SITE LIGHTING AT VA LYONS CAMPUS	Building Number FJF	Checked FJF	Design ODC
Location VA Lyons Campus, NJCS, Lyons, NJ	Date 23 MARCH, 2010	Project No. 68044-08-003	Drawing No. E3 SHEET 28 OF 29

Office of Facilities
 Department of Veterans Affairs

DEMOLITION PLAN 1
 E3 | E3

SCALE: 1" = 100'-0"



DEMOLITION PLAN 2
 E3 | E3

SCALE: 1" = 100'-0"



KEY NOTES:

1. REFER TO DRAWING C1 FOR DEFINITION OF BID ITEMS AND ALTERNATE BID ITEMS.
2. REFER TO DRAWING E1 FOR NOTES, SYMBOLS AND ABBREVIATIONS.
3. REFER TO SITE DEMOLITION DRAWINGS, SHEETS C-2 THROUGH C-10.
4. FOR ALL FIXTURES TO BE REMOVED, REMOVE WIRING FROM UNDERGROUND RACEWAY SYSTEM BACK TO SOURCE, AND MARK SOURCE CONDUCTOR / BREAKER "SPARE" UNLESS WHERE CONDUCTORS CAN NOT BE REMOVED, CUT CONDUCTORS AND CONDUIT BELOW SURFACE AT EITHER END AND REBAND IN PLACE.
5. REMOVE POLE BRASS ASSOCIATED WITH FIXTURES TO BE REMOVED AND FILL HOLE RESTORING AREA TO MATCH SURROUNDING AREA.
6. AS MUCH AS PRACTICABLE, INSTALL NEW EXPANSION JOINTS PRIOR TO REMOVAL OF EXISTING FIXTURES TO MAINTAIN LIGHTING LEVEL DURING INSTALLATION.
7. REFER TO REMOVAL AND DISCONNECTION SCHEDULE ON DRAWING E-2 FOR EXISTING CIRCUITS TO BE DEENERGIZED PRIOR TO REMOVAL OF EXISTING LIGHTING.