



1. TYPICAL SLAB-ON-GRADE SHALL CONSIST OF 4" THICK NORMAL WEIGHT CONCRETE REINFORCED WITH 6"x6"-W29X92 WELDED WIRE FABRIC (WWF), AND PLACED OVER A 10 MIL VAPOR BARRIER AND PREPARED SOIL. PER GEOTECHNICAL REPORT.
2. REFER TO PLAN & TYPICAL SLAB DETAILS FOR THICKENED SLABS, REINFORCED CONCRETE WALLS, AND MECHANICAL DRAWINGS FOR STORIES, DECKS, AND ROOFS.
3. TYPICAL SLAB-ON-GRADE ELEVATION SHALL BE 18.50' (DOWLY OF -0.00'). CONCRETE FOOTINGS ARE INDICATED ON PLAN THUS: F'-X. REFER TO FOUNDATION SCHEDULE FOR SIZE AND REINFORCING.
4. TOP OF FOOTING ELEVATION IS INDICATED ON PLAN THUS: (X'-X') & MEASURED FROM DATUM.
5. STEEL COLUMNS ARE INDICATED ON PLAN THUS C'-X. REFER TO FOUNDATION SCHEDULE FOR SIZE AND BASE.
6. COLUMN JOINTS ARE INDICATED ON PLAN THUS: C.J.

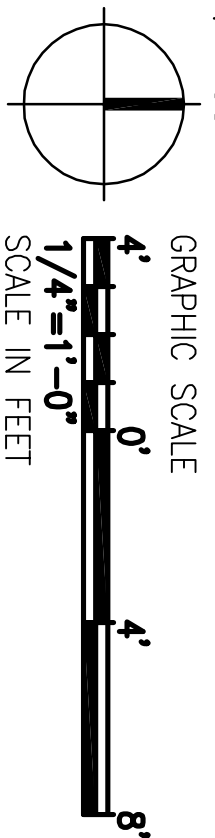

COLUMN SCHEDULE			
MARK	SIZE	BASE	ANCHORS
C-1	HSS 6x6x3/16	3/4"x12"x1"-0"	3/4"x9" LONG (GR55)
C-2	HSS 6x6x3/8	1/4"x12"x1"-0"	3/4"x9" LONG (GR55)
C-3	HSS 8x8x5/16	1/4"x14"x1"-2"	7/8"x9" LONG (GR105)
C-4	HSS 8x8x3/8	1/2"x14"x1"-2"	7/8"x9" LONG (GR105)
C-5	8" STD. PIPE	1"x16"x1"-4"	3/4"x9" LONG (GR105)

		DEPARTMENT OF THE ARMY NAVAL SUPPORT ACTIVITY PANAMA CITY, FLORIDA	
NATURAL RESOURCES & ENVIRONMENTAL AFFAIRS P.W. DWG. NO.		NAVAL FACILITIES ENGINEERING COMMAND	
700 MOORE ST. PANAMA, FL 32407 251-990-5778 ARCH. & ENGR. SEAL		PANAMA CITY JOINT OUTPATIENT CLINIC NAVAL GULF COAST HEALTH CARE FOUNDATION AND SLAB-ON-GRADE PLAN	
FLORIDA CERTIFICATE OF AUTHORIZATION DESIGN/BUILD LLC No. 29795		DRAWN BY KM CHECKED BY NB SUPERVISOR WMB APPROVED	
SAFETY DEPARTMENT TO DATE		DATE	
FIRE DEPARTMENT TO DATE		SIZE F CODE IDENT. NO.	
PUBLIC WORKS SUPERVISOR TO DATE		MAT/FCS DRAWING NO. N/A	
SANITATION TO DATE		HOOD NO.	
TO DATE		WACS TO & FROM CONTR. CONTR. NO.	
TO DATE		SHEET 2 OF 10	