


Calculation Summary									
Label	CalcType	Units	Avg	Max	Min	Avg/Min	Max/Min	FcSp/Clr	FcSp/Cb
10-TOILET_Workplane	Illuminance	Fc	19.46	24.7	14.9	1.31	1.66	2	2
11-NKLT_Workplane	Illuminance	Fc	44.53	60.5	31.6	1.41	1.91	2	2
12-EDRM-1_Workplane	Illuminance	Fc	59.07	78.2	41.3	1.43	1.89	2	2
13-PROVIDER_Workplane	Illuminance	Fc	56.93	75.2	31.7	1.80	2.37	2	2
14-EDRM-2_Workplane	Illuminance	Fc	44.66	60.9	32.1	1.39	1.90	2	2
15-VISION_Workplane	Illuminance	Fc	45.52	61.9	32.5	1.40	1.90	2	2
16-EDRM-3_Workplane	Illuminance	Fc	49.86	69.2	24.9	2.00	2.78	2	2
17-OCN NURSR_Workplane	Illuminance	Fc	44.42	60.4	31.6	1.41	1.91	2	2
18-FRFR-MED TECH_Workplane	Illuminance	Fc	44.42	60.4	31.8	1.40	1.90	2	2
19-TREATMENT_Workplane	Illuminance	Fc	105.90	145	70.3	1.51	2.06	2	2
2-LOUNGE_Workplane	Illuminance	Fc	48.50	65.8	28.1	1.73	2.34	2	2
2-STORAGE_Workplane	Illuminance	Fc	23.82	35.1	16.1	1.48	2.18	2	2
20-EDRM-SCREENING_Workplane	Illuminance	Fc	53.32	74.3	35.1	1.52	2.12	2	2
22-JANITOR_Workplane	Illuminance	Fc	15.10	19.4	10.2	1.48	1.90	2	2
LOCKER ROOM_Workplane	Illuminance	Fc	26.26	35.1	14.8	1.77	2.37	2	2
TOILET_Workplane	Illuminance	Fc	12.36	15.2	9.3	1.33	1.63	2	2
25 MENS TOILET_Workplane	Illuminance	Fc	15.51	21.9	6.7	2.31	3.27	2	2
26-WOMENS TOILET_Workplane	Illuminance	Fc	15.46	21.8	6.6	2.34	3.30	2	2
27 FILE ROOM_Workplane	Illuminance	Fc	58.68	78.2	36.9	1.59	2.12	2	2
28-COMM ROOM_Workplane	Illuminance	Fc	48.96	60.0	36.3	1.35	1.65	2	2
29-WHEEL CHAIR_Workplane	Illuminance	Fc	27.33	37.3	17.4	1.57	2.14	2	2
3-LCPO-LPO_Workplane	Illuminance	Fc	44.39	60.5	32.0	1.39	1.89	2	2
30-SOILED LINEN_Workplane	Illuminance	Fc	52.48	72.2	36.1	1.45	2.00	2	2
31-CLEAN LINEN_Workplane	Illuminance	Fc	52.61	72.0	36.2	1.45	1.99	2	2
32-HEARING TEST_Workplane	Illuminance	Fc	35.10	42.1	26.1	1.34	1.61	2	2
4-OTC_Workplane	Illuminance	Fc	57.51	75.9	41.2	1.40	1.84	2	2
5-COPY ROOM_Workplane	Illuminance	Fc	30.59	42.1	21.8	1.40	1.93	2	2
6-STORAGE_Workplane	Illuminance	Fc	38.33	46.3	32.3	1.19	1.43	2	2
7-ENTRY_Workplane	Illuminance	Fc	15.08	17.7	12.7	1.19	1.39	2	2
9-TOILET_Workplane	Illuminance	Fc	19.03	24.1	14.7	1.29	1.64	2	2
LOBBY-CORRIDOR_Workplane	Illuminance	Fc	20.17	43.4	5.8	3.48	7.48	2	2
EXTERIOR	Illuminance	Fc	4.45	9.8	0.1	44.50	98.00	4	4

FINAL SUBMISSION
APRIL 6, 2012

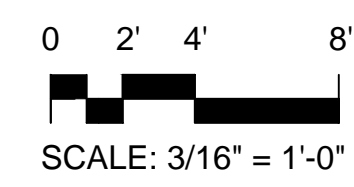

IF SHEET IS LESS THAN (30"x42") IT IS
A REDUCED PRINT; SCALE ACCORDINGLY

EL200

	NATURAL RESOURCES & ENVIRONMENTAL AFFAIRS		P.W. DWG. NO.	
	SAFETY DEPARTMENT		DRAWN BY CWS	
	FIRE DEPARTMENT		CHECKED BY R. DeLoach	
	PUBLIC WORKS SUPERVISOR		SUPERVISOR WWB	
APPROVED		DATE		
PUBLIC WORKS OFFICER		DATE		
DEPARTMENT OF THE NAVY NAVAL SUPPORT ACTIVITY PANAMA CITY, FLORIDA				
PANAMA CITY JOINT OUTPATIENT CLINIC NAVAL GULF COAST HEALTH CARE				
LIGHTING CALCULATIONS				
SIZE F		CODE IDENT. NO.		
HOMC PROJ. NO.		CONSTR. CONTR. NO.		
SCALE 3/16"=1'-0"		T.O.#		
MACC.		SHEET 5 OF 13		