




**1 EXIT SIGN MOUNTING - GYPBOARD CEILING**  
NTS

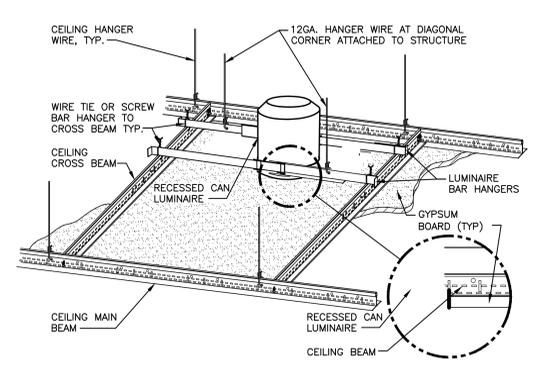


**3 DOWNLIGHT MOUNTING - GYPBOARD CEILING**  
NTS

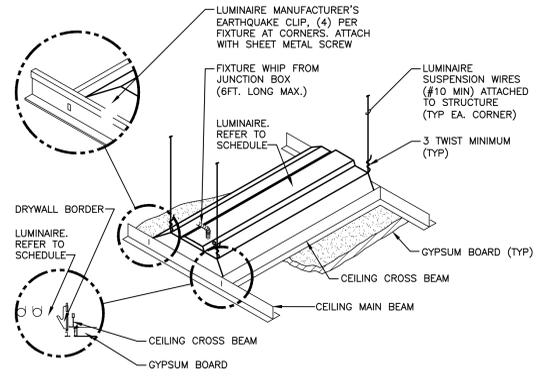


**5 LUMINAIRE MOUNTING - GYPBOARD CEILING**  
NTS

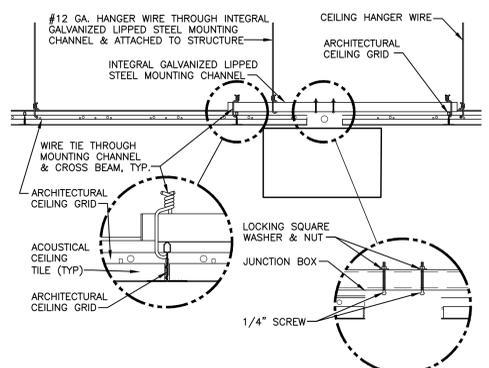


**2 EXIT SIGN MOUNTING - LAY-IN CEILING**  
NTS

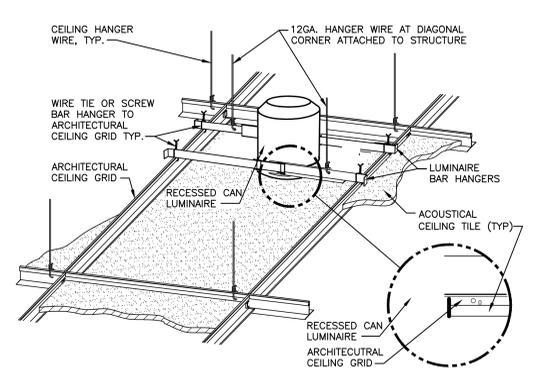


**4 DOWNLIGHT MOUNTING - LAY-IN CEILING**  
NTS

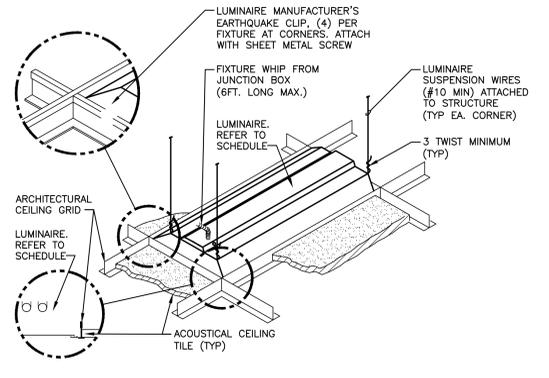


**6 LUMINAIRE MOUNTING - LAY-IN CEILING**  
NTS

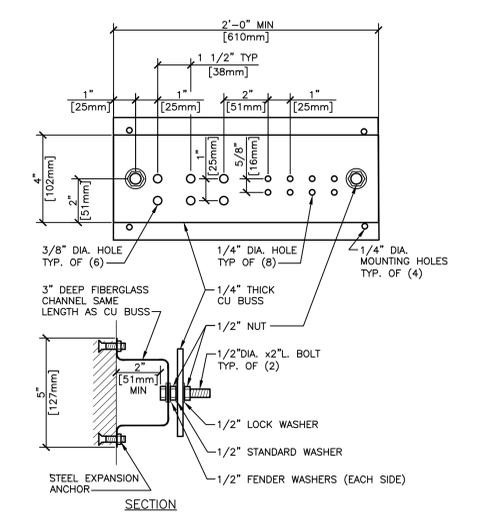

**7 GROUNDING BAR DETAIL**  
NTS

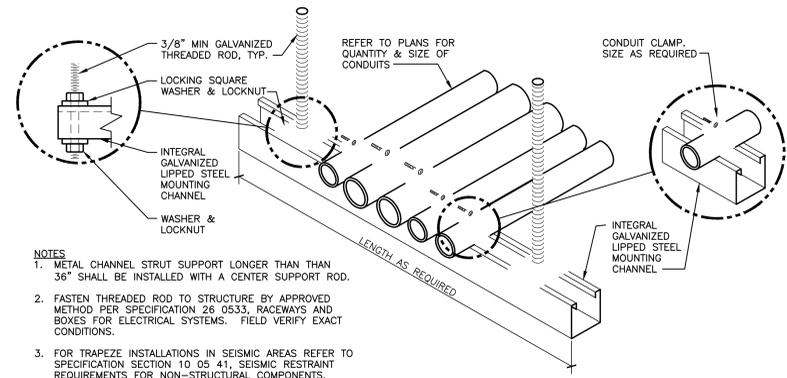

**8 CONDUIT TRAPEZE MOUNTING DETAIL**  
NTS

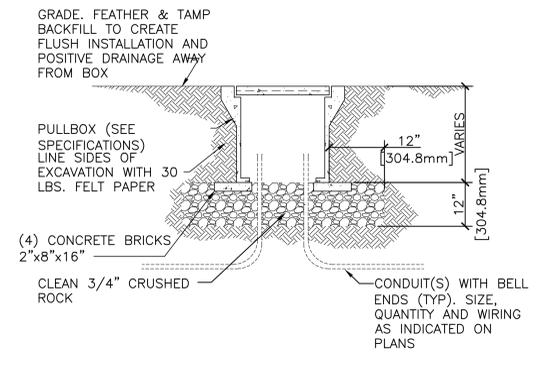

**9 UNDERGROUND CONCRETE PULLBOX**  
SCALE: NONE  
INSTALLATION IN TURF AREAS

**NOTES**  
1. METAL CHANNEL STRUT SUPPORT LONGER THAN THAN 36\"/>

FINAL SUBMISSION  
APRIL 6, 2012

IF SHEET IS LESS THAN (30"x42") IT IS A REDUCED PRINT; SCALE ACCORDINGLY

**E501**

 766 MIDDLE ST., FAIRHOPE, AL 36532 251-990-5778 ARCH. & ENGR. SEAL  	NATURAL RESOURCES & ENVIRONMENTAL AFFAIRS SATISFACTORY TO DATE	P.W. DWG. NO.	DEPARTMENT OF THE NAVY NAVAL FACILITIES ENGINEERING COMMAND PANAMA CITY, FLORIDA
	SAFETY DEPARTMENT	DRAWN BY <b>GWS</b>	<b>PANAMA CITY JOINT OUTPATIENT CLINIC</b> <b>NAVAL GULF COAST HEALTH CARE</b> <b>ELECTRICAL DETAILS</b> N/A F C DRAWING NO. N/A CONSTR. CONTR. NO.
	FIRE DEPARTMENT	CHECKED BY <b>GWS</b>	
	PUBLIC WORKS SUPERVISOR	SUPERVISOR <b>WB</b>	
APPROVED DATE	DATE		
PUBLIC WORKS OFFICER	SCALE NONE	MACC.	T.O.# SHEET 8 OF 13