
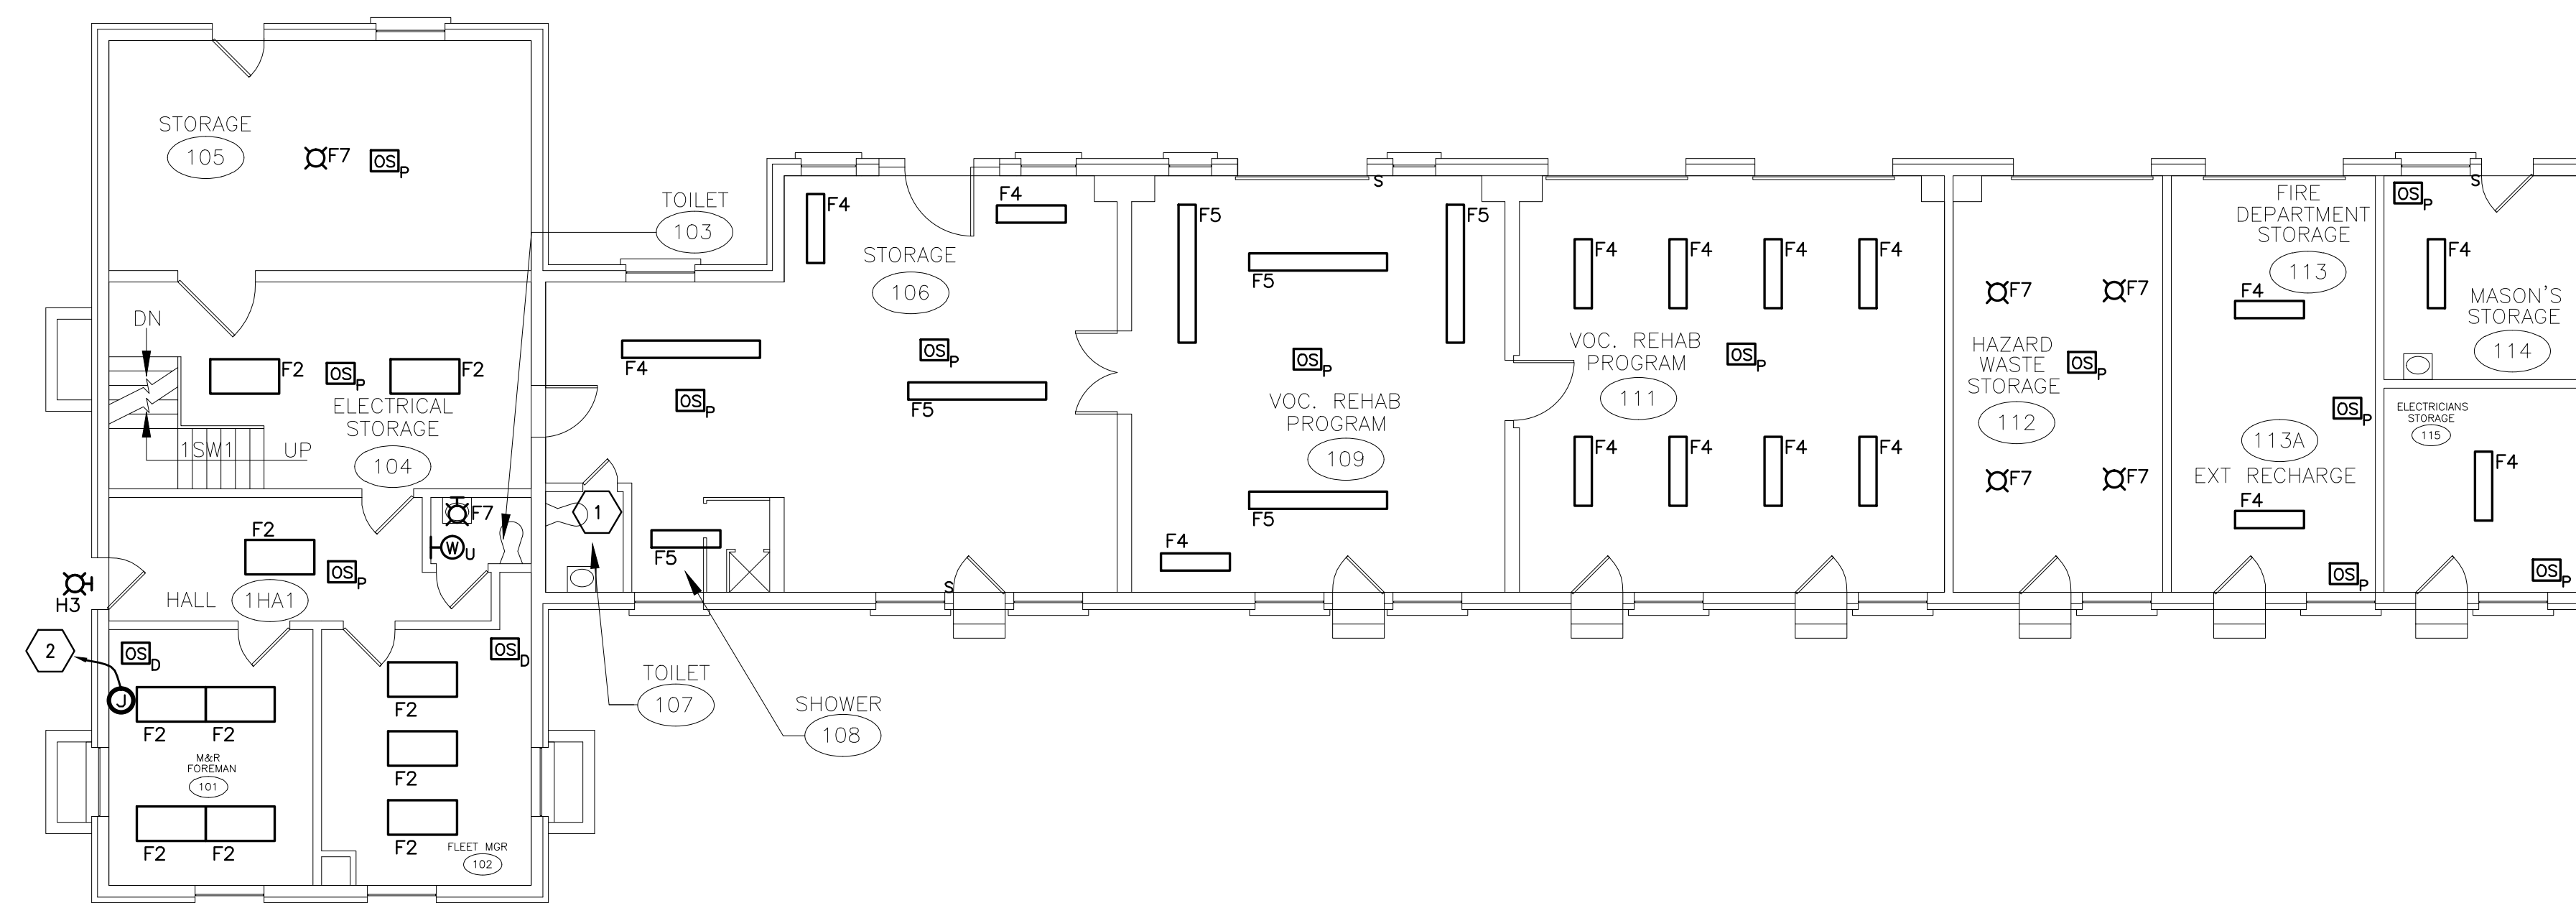




 KEYED NOTES:

1. TOILET 107 WAS LOCKED AT TIME OF LIGHTING SURVEY. PROVIDE (1) TYPE F7 FIXTURE AND (1) ULTRASONIC WALL MOUNTED OCCUPANCY SENSOR FOR BIDDING PURPOSES.
2. PROVIDE WIRED JUNCTION BOX FOR CONNECTION TO DDC CONTROL PANEL. CIRCUIT TO NEAREST 120V PANELBOARD. ASSUME DISTANCE TO PANELBOARD TO BE 150'.

1 BASEMENT ELECTRICAL PLAN
SCALE: 1/8"=1'-0"



2 FIRST FLOOR ELECTRICAL PLAN
SCALE: 1/8"=1'-0"

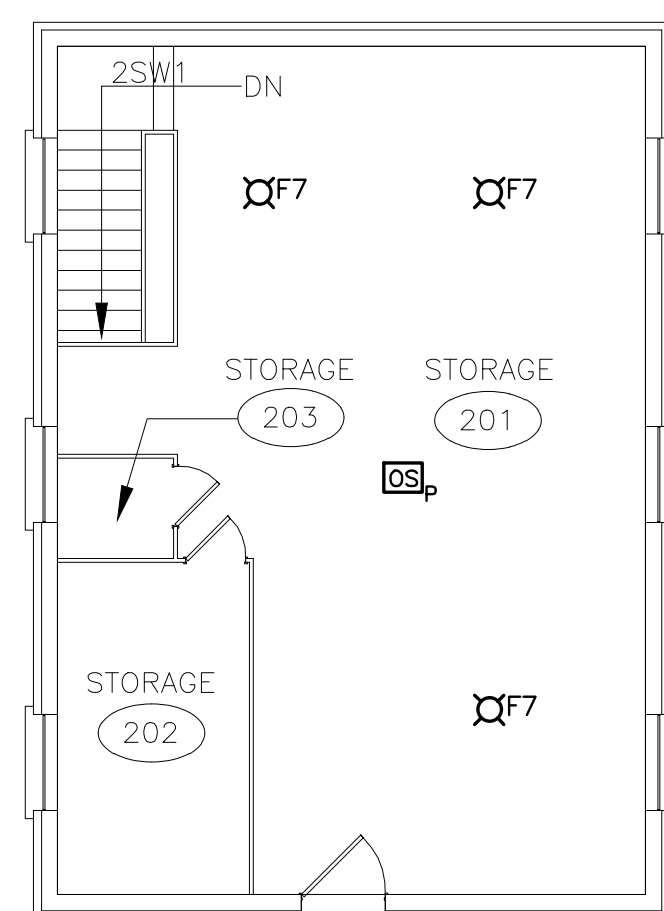

3 SECOND FLOOR ELECTRICAL PLAN
SCALE: 1/8"=1'-0"



<div><div></div><div><div><div></div><div>Bergmann</div><div>associates</div></div><div><div>www.bergmannpc.com</div><div>28 East Main Street</div><div>200 First Federal Plaza</div><div>Rochester, New York 14614</div><div>585.232.5135 / 585.232.4652 fax</div><div>Engineers / Architects / Planners/ Surveyors</div></div></div></div> <div>Revisions</div> <div>Date</div>	<div>A. WORK TO BE IN ACCORDANCE WITH N.E.P.A., NATIONAL, STATE AND CITY CODES & O.S.H.A.</div>	<div>Approved: A.J.G.E.</div> <div>Date</div>	<div>Approved: Fire Chief</div> <div>Date</div>	<div>Approved: Energy Engineer</div> <div>Date</div>	<div>Drawing Title</div> <div>BASEMENT, FIRST & SECOND FLOOR ELECTRICAL PLANS</div>	<div>Project Title</div> <div>ENERGY CONSERVATION MEASURES AT THE BATH VAMC</div>	<div>Date</div> <div>08/15/2012</div>	<div>Project No.</div> <div>528A6-12-629</div>	<div>Building No.</div> <div>15</div>	<div>Checked</div> <div>JJD</div>	<div>Drawn</div> <div>TL5</div>	<div>VAMC-528A6-12-629</div> <div>15-E-101</div> <div>BATH, NEW YORK</div>	<div>88 of 124</div>	
		<div>Approved: Logistics Manager</div> <div>Date</div>	<div>Approved: Interior Designer</div> <div>Date</div>	<div>Approved: Safety Officer</div> <div>Date</div>	<div>Approved: M&R Foreman</div> <div>Date</div>	<div>Approved: Eng. Project Supervisor</div> <div>Date</div>	<div>Location</div> <div>BATH, NEW YORK</div>							
		<div>Approved: Infection Control Mgr.</div> <div>Date</div>	<div>Approved: Info. Sys.</div> <div>Date</div>	<div>Approved: Industrial Hygienist</div> <div>Date</div>										
		<div>Approved: Chief Security</div> <div>Date</div>	<div>Approved: Women's Health Rep</div> <div>Date</div>	<div>Approved: Space Owner</div> <div>Date</div>		<div>Approved: Medical Center Director</div> <div>Date</div>								