


1 BASEMENT ELECTRICAL PLAN
SCALE: 1/8"=1'-0"

KEYED NOTES:

1. PROVIDE WIRED JUNCTION BOX FOR CONNECTION TO DDC CONTROL PANEL, CIRCUIT TO NEAREST 120V PANELBOARD. ASSUME DISTANCE TO PANELBOARD TO BE 150'.

GENERAL NOTES:


- A. EXISTING CONTROLS AND FIXTURES SHALL REMAIN AT SECOND FLOOR.

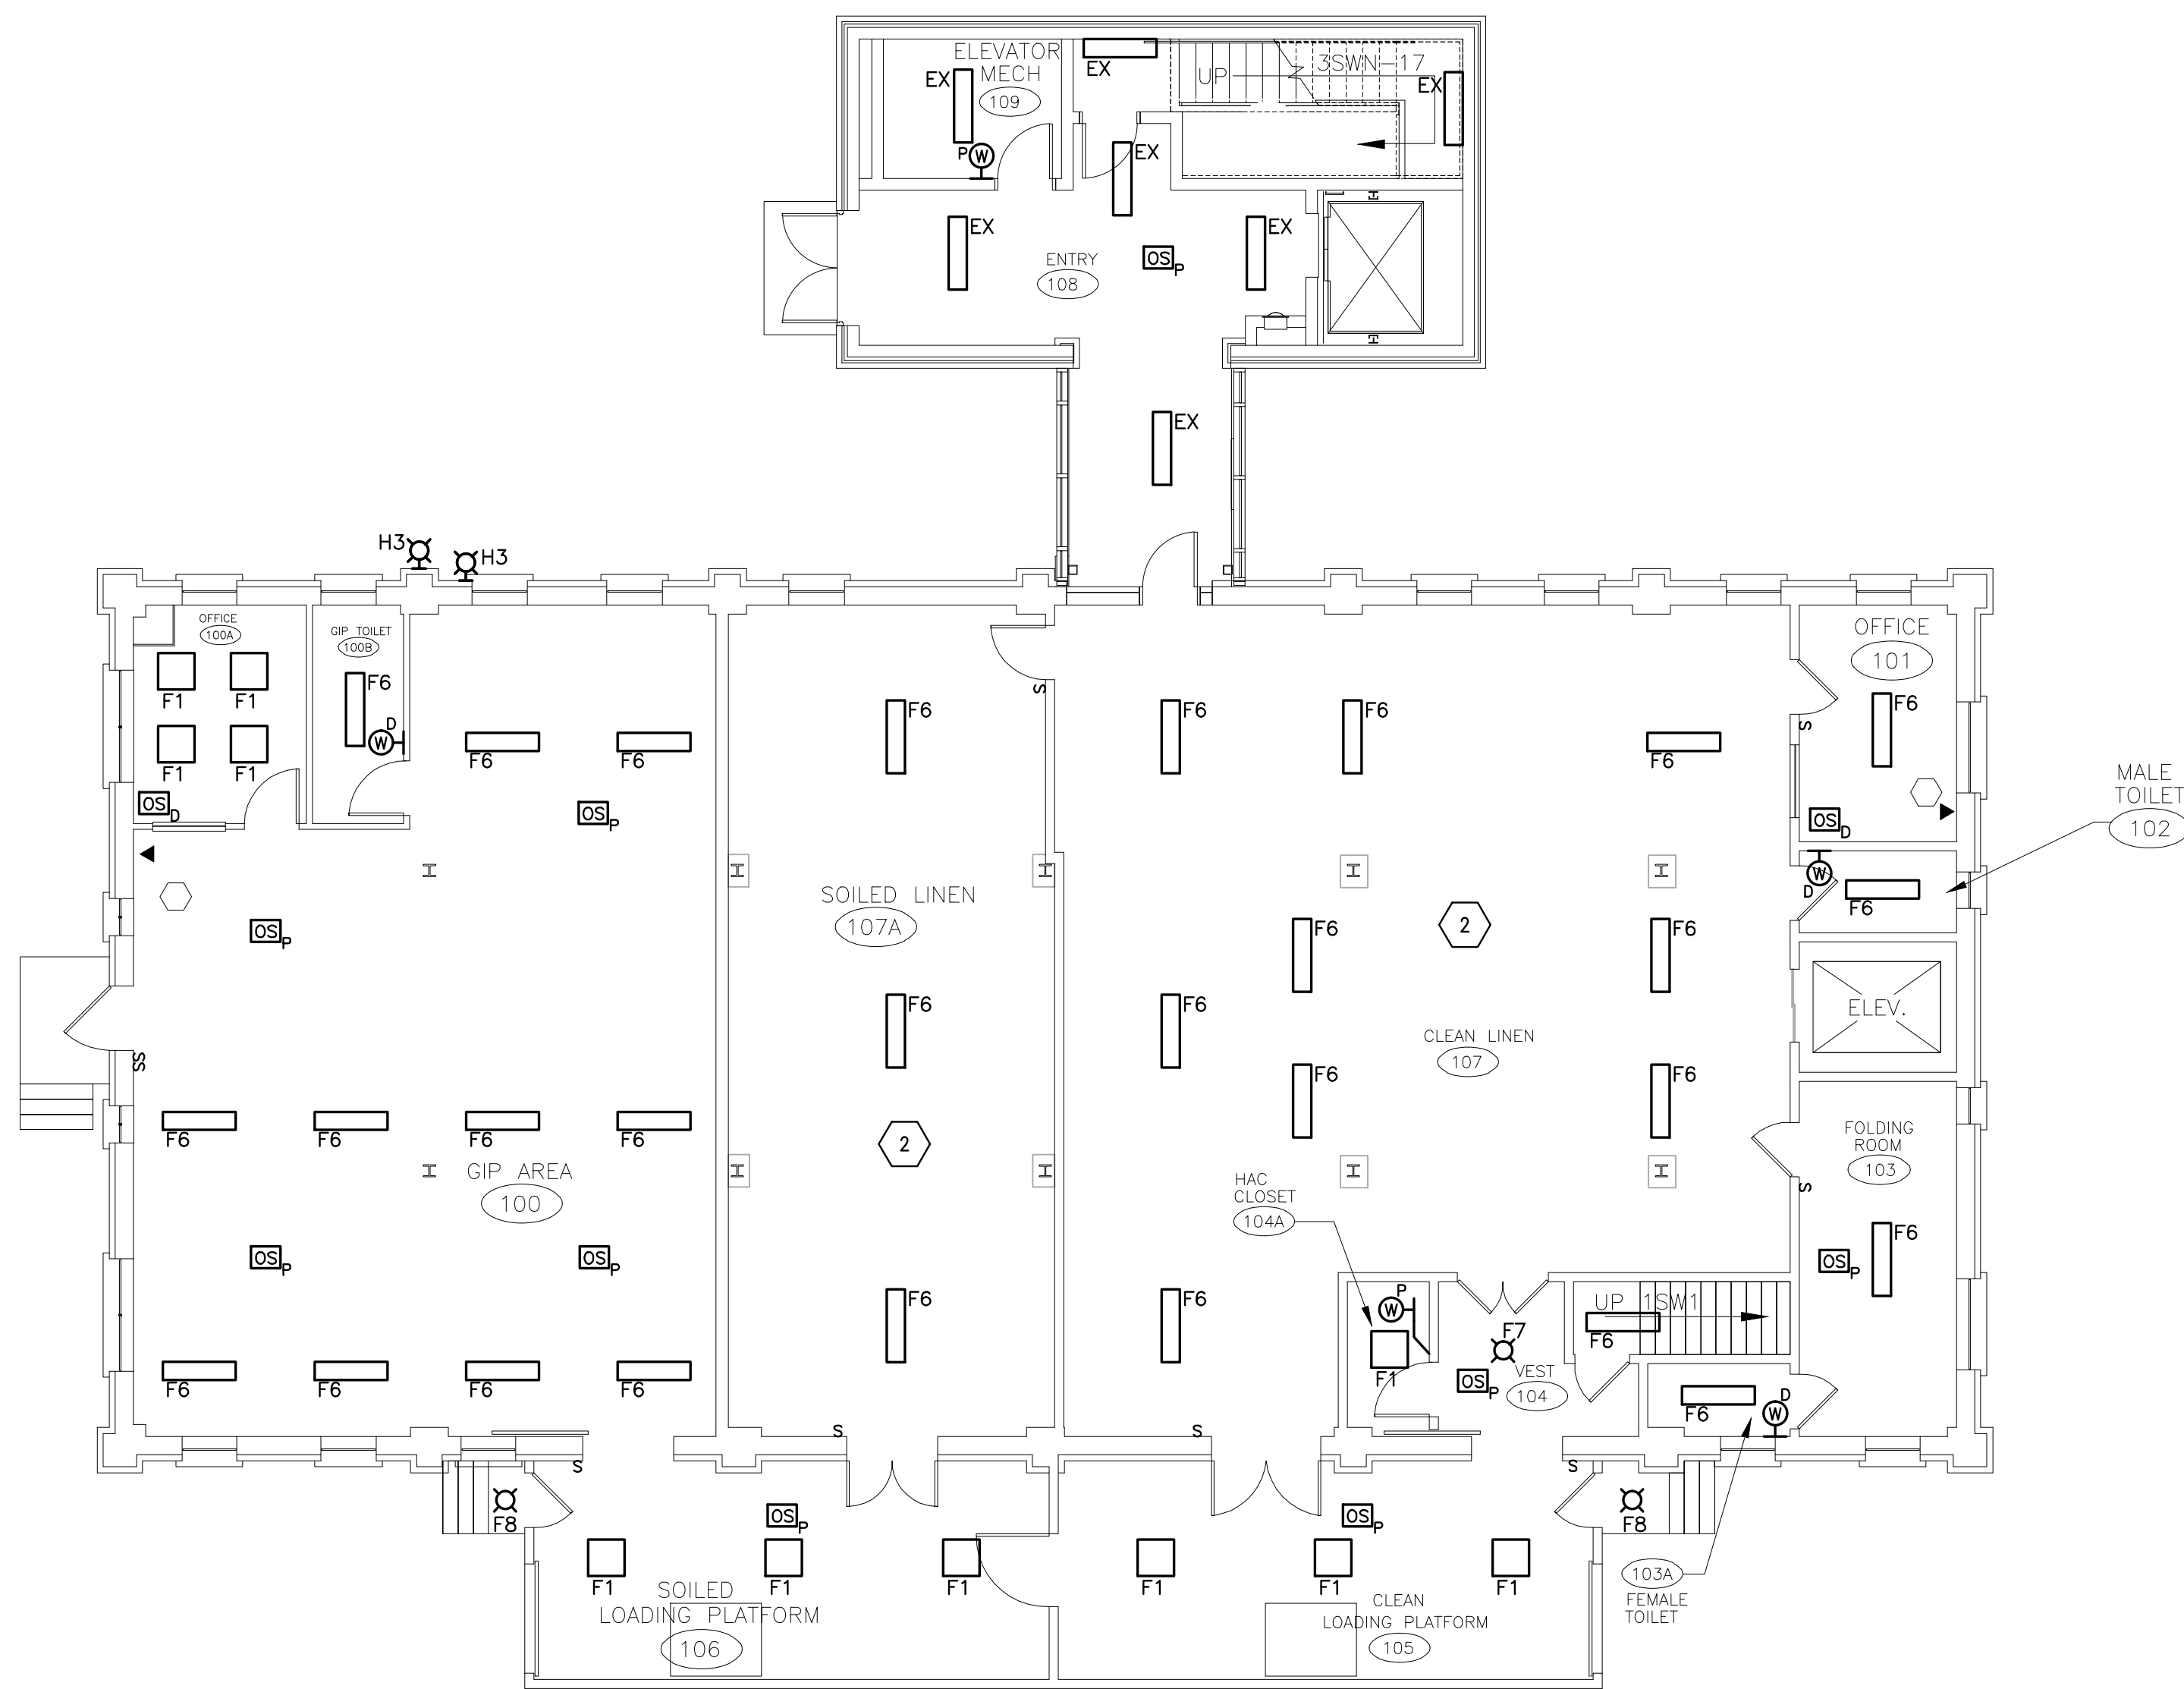


2 FIRST FLOOR ELECTRICAL PLAN
SCALE: 1/8"=1'-0"



3 SECOND FLOOR ELECTRICAL PLAN
SCALE: 1/8"=1'-0"

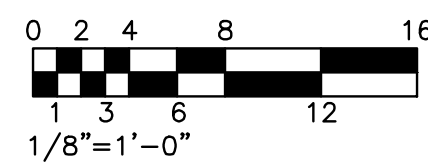

| | | | | | | | | | | | |
|--|--|--|---|---|---|--|---|---|---------------------------|-------------------------------|---|
| | | <div> www.bergmannpc.com 28 East Main Street 200 First Federal Plaza Rochester, New York 14614 585.232.5135 / 585.232.4652 fax Engineers / Architects / Planners / Surveyors</div> | ALL WORK TO BE IN ACCORDANCE WITH N.F.P.A., NATIONAL, STATE AND CITY CODES & O.S.H.A. | Approved: A.F.G.E. _____ Date _____ | Approved: Fire Chief _____ Date _____ | Approved: Energy Engineer _____ Date _____ | Drawing Title BASEMENT, FIRST & SECOND FLOOR ELECTRICAL PLANS | Project Title ENERGY CONSERVATION MEASURES AT THE BATH VAMC | Date 08/15/2012 | <div>V.A. A. C.</div> | |
| | | | Approved: Logistics Manager _____ Date _____ | Approved: Interior Designer _____ Date _____ | Approved: Safety Officer _____ Date _____ | Approved: M&R Foreman _____ Date _____ | Approved: Eng. Project Supervisor _____ Date _____ | Building No. 17 | Checked JJD | | Project No. 528A6-12-629 |
| | | | Approved: Infection Control Mgr. _____ Date _____ | Approved: Info. Sys. _____ Date _____ | Approved: Industrial Hygienist _____ Date _____ | _____ Date _____ | Approved: Medical Center Director _____ Date _____ | Location BATH, NEW YORK | Drawn TLS | | DRAWING NO. VAMC-528A6-12-629 |
| | | | Approved: Chief Security _____ Date _____ | Approved: Women's Health Rep _____ Date _____ | Approved: Space Owner _____ Date _____ | _____ Date _____ | _____ Date _____ | | | | 17-E-101 |
| | | | | | | | | | | | |