



KEYED NOTES:

1. PROVIDE WIRED JUNCTION BOX FOR CONNECTION TO DDC CONTROL PANEL. CIRCUIT TO NEAREST 120V PANELBOARD. ASSUME DISTANCE TO PANELBOARD TO BE 150'.

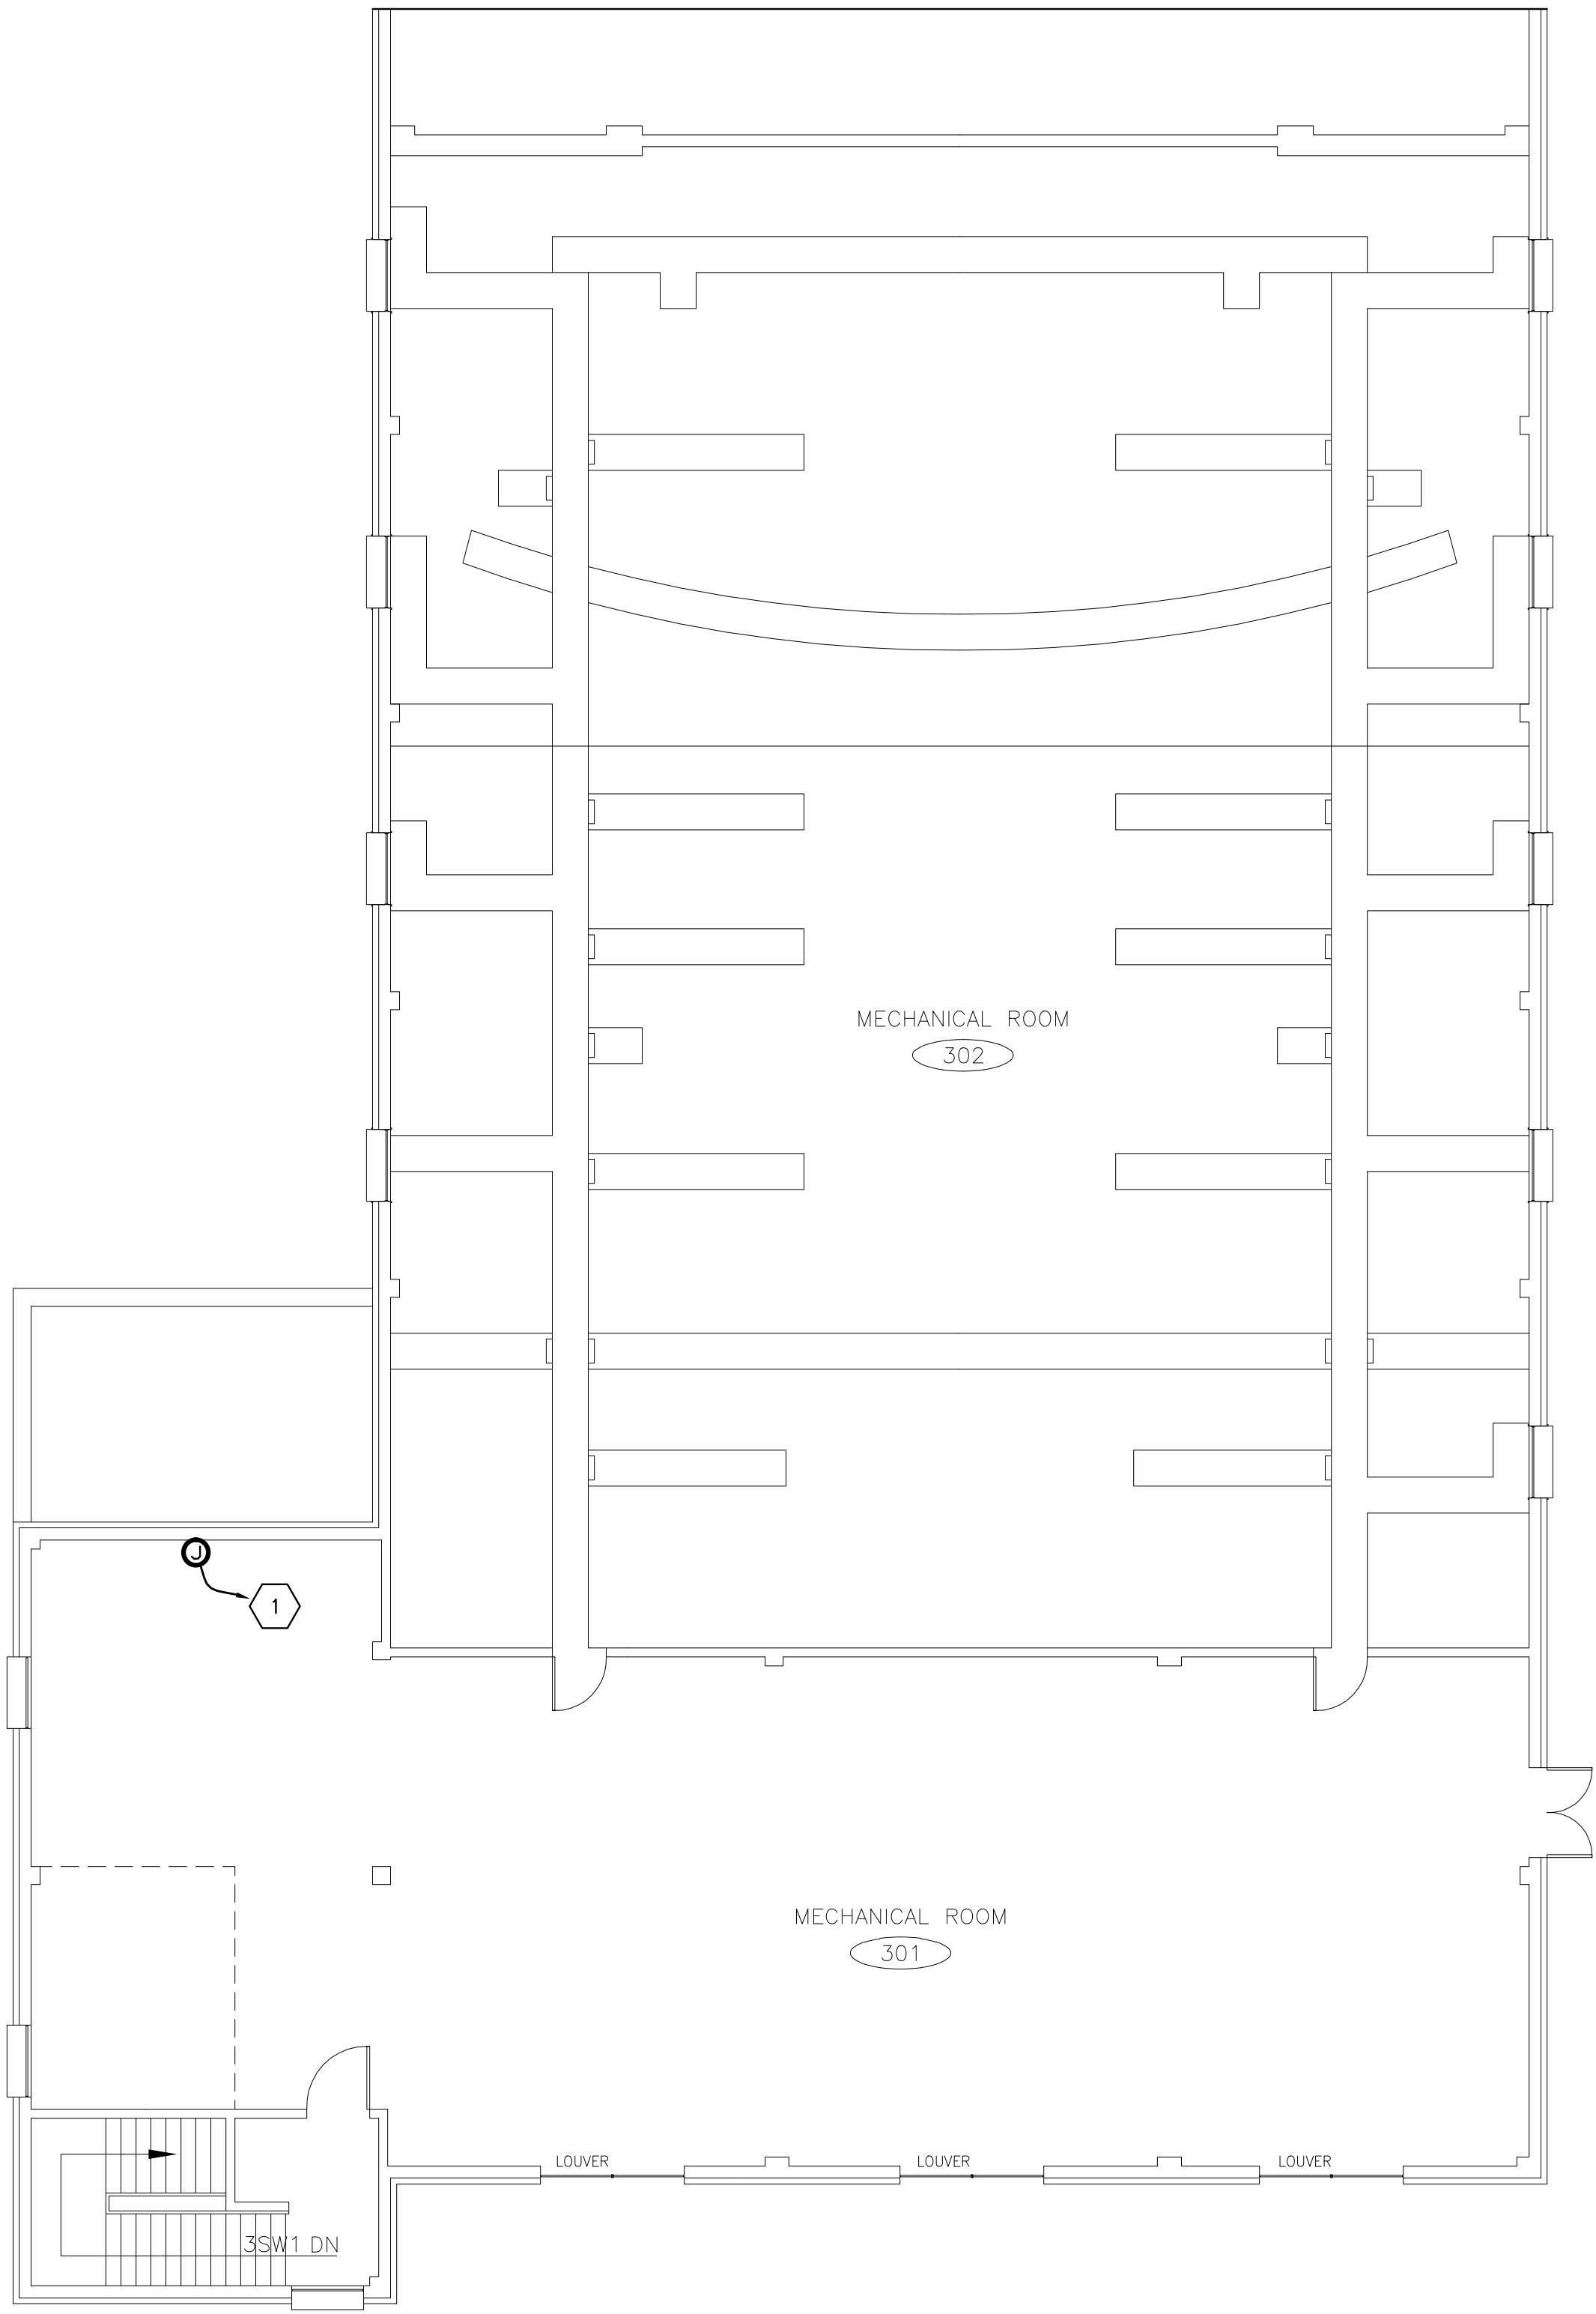

1 THIRD FLOOR ELECTRICAL PLAN
SCALE: 1/8"=1'-0"

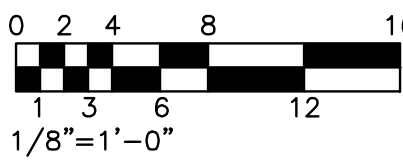

		<div><div></div><div><p>www.bergmannpc.com 28 East Main Street 200 First Federal Plaza Rochester, New York 14614 585.232.5135 / 585.232.4652 fax Engineers / Architects / Planners / Surveyors</p></div></div>	ALL WORK TO BE IN ACCORDANCE WITH N.F.P.A., NATIONAL, STATE AND CITY CODES & O.S.H.A.	Approved: A.P.G.E. _____ Date _____	Approved: Fire Chief _____ Date _____	Approved: Energy Engineer _____ Date _____	Drawing Title THIRD FLOOR ELECTRICAL PLAN	Project Title ENERGY CONSERVATION MEASURES AT THE BATH VAMC	Date 08/15/2012	<div>V.A. A.<</div>
--	--	---	---	-------------------------------------	---------------------------------------	--	---	--	--------------------	---