





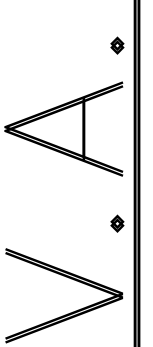
KEYED NOTES:

1. ELECTRIC BS107 WAS LOOKED AT TIME OF LIGHTING SURVEY. PROVIDE (4) TYPE F4 FIXTURES FOR BIDDING PURPOSES.
2. PROVIDE WIRED JUNCTION BOX FOR CONNECTION TO DDC CONTROL PANEL. CIRCUIT TO NEAREST 120V PANELBOARD. ASSUME DISTANCE TO PANELBOARD TO BE 150'.
3. REMOVE MOTOR ITEM INDICATED AND REPLACE USING HIGH EFFICIENCY MOTOR, HORSEPOWER RATING AS SHOWN. COORDINATE WITH MECHANICAL CONTRACTOR. EXTEND EXISTING CIRCUIT TO ALLOW FOR MOTOR REPLACEMENT. CONNECT TO CONTROLLER (EXISTING OR REPLACEMENT IF INDICATED). COORDINATE EXACT HORSEPOWER RATING AND PROVIDE MOTOR TO MATCH THIS RATING. COORDINATE EXACT LOCATION IN FIELD.

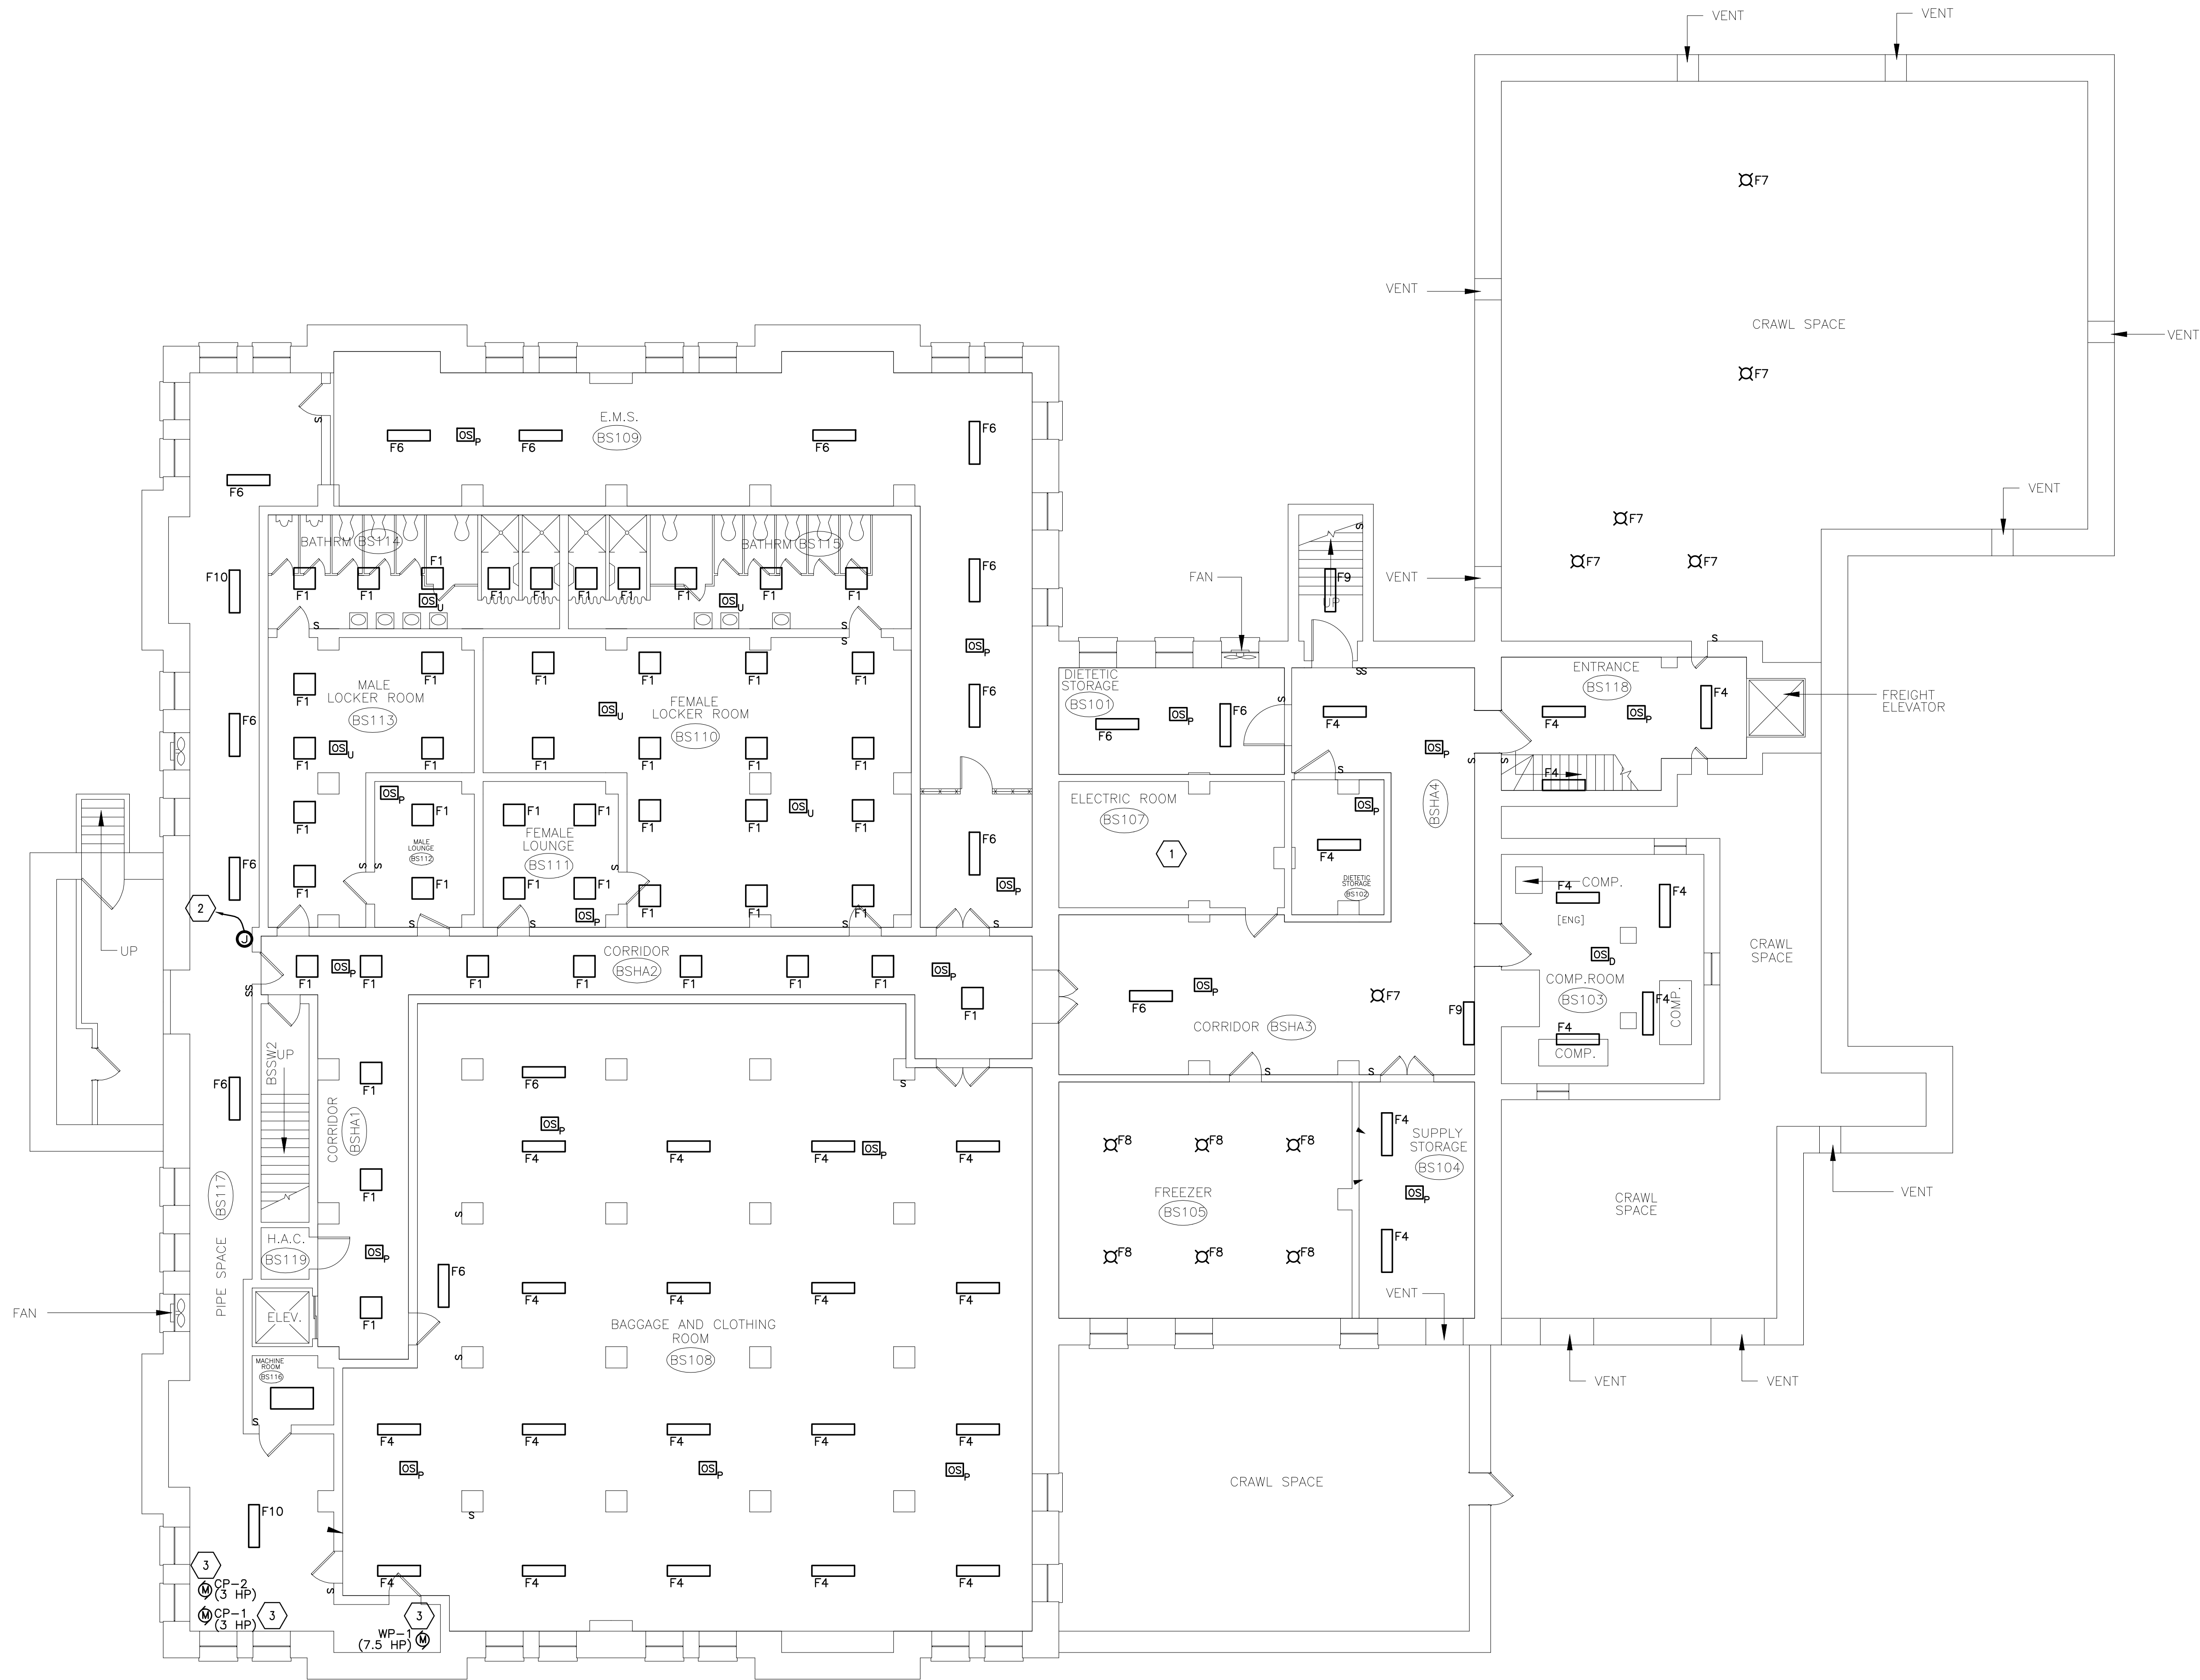

1 BASEMENT ELECTRICAL PLAN
SCALE: 1/8"=1'-0"

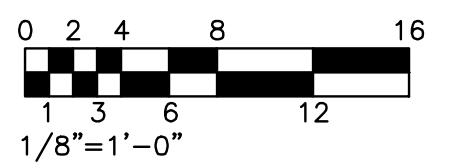

Revisions	Date	 www.bergmannpc.com 28 East Main Street 200 First Federal Plaza Rochester, New York 14614 585.232.5135 / 585.232.4652 fax Engineers / Architects / Planners / Surveyors	ALL WORK TO BE IN ACCORDANCE WITH N.F.P.A., NATIONAL, STATE AND CITY CODES & O.S.H.A.	Approved: A.P.G.E. _____ Date _____	Approved: Fire Chief _____ Date _____	Approved: Energy Engineer _____ Date _____	Drawing Title BASEMENT ELECTRICAL PLAN	Project Title ENERGY CONSERVATION MEASURES AT THE BATH VAMC	Date 08/15/2012	
			Approved: Logistics Manager _____ Date _____	Approved: Interior Designer _____ Date _____	Approved: Safety Officer _____ Date _____	Approved: M&R Foreman _____ Date _____	Approved: Eng. Project Supervisor _____ Date _____	Building No. 24	Project No. 528A6-12-629	
Revisions	Date		Approved: Infection Control Mgr. _____ Date _____	Approved: Info. Sys. _____ Date _____	Approved: Industrial Hygienist _____ Date _____	_____ Date _____	Approved: Medical Center Director _____ Date _____	Location BATH, NEW YORK	DRAWING NO. VAMC-528A6-12-629 24-E-101	
			Approved: Chief Security _____ Date _____	Approved: Women's Health Rep _____ Date _____	Approved: Space Owner _____ Date _____	_____ Date _____	Approved: _____ Date _____		Dwg. 90 of 124	