

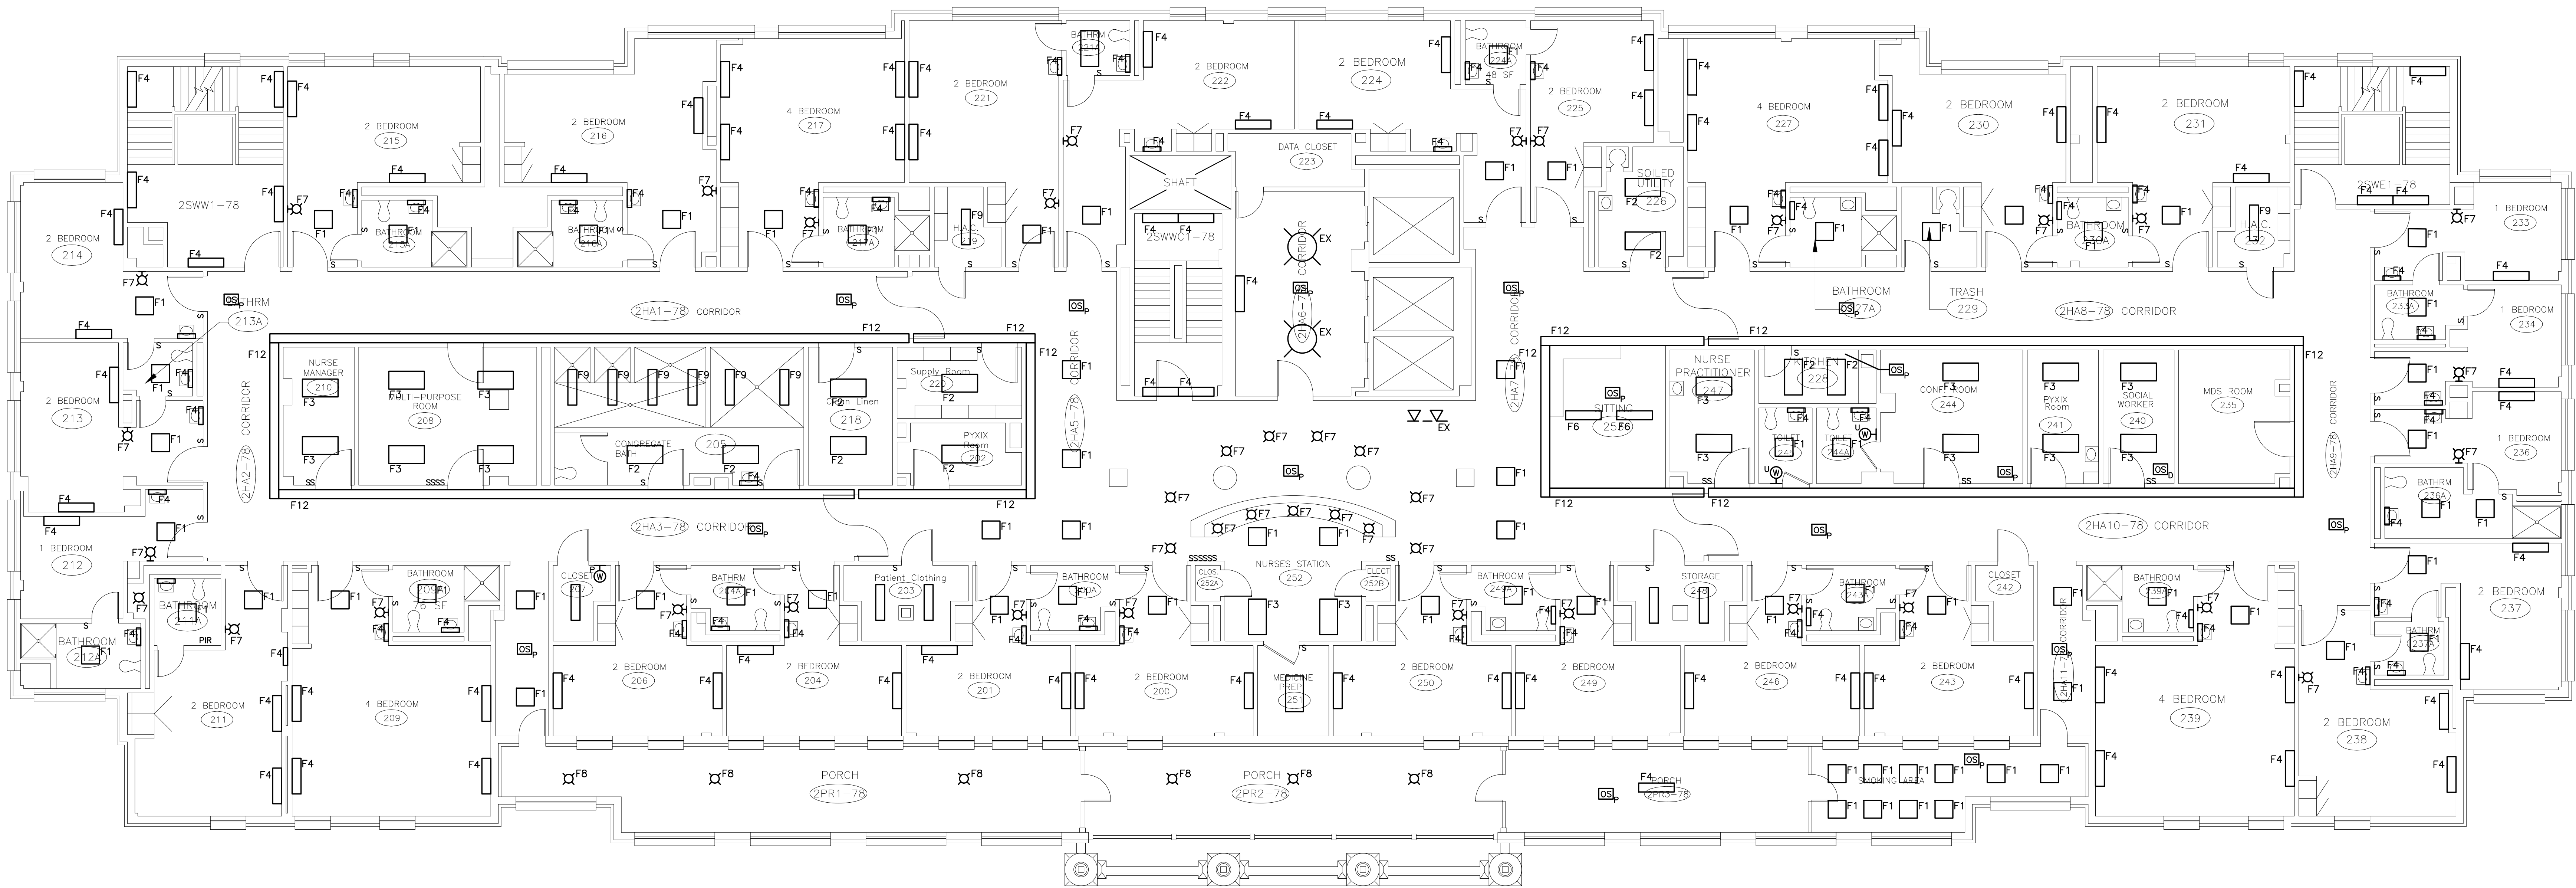


GENERAL NOTES:

1. DISCONNECT MECHANICAL EQUIPMENT AND MAKE SAFE FOR REMOVAL. PROTECT EXISTING WIRING AND CONDUIT DURING CONSTRUCTION FOR REUSE. RECONNECT TO NEW MECHANICAL EQUIPMENT IN SAME LOCATION THROUGH NEW VFD. PROVIDE VFD AND EXTEND CONDUIT AND WIRING AS REQUIRED. TOTAL OF 5 MOTORS AND 4 VFD'S BEING REPLACED/PROVIDED THROUGHOUT BUILDING, LOCATIONS TO BE VERIFIED.

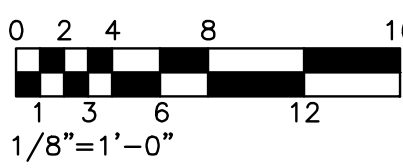

1 SECOND FLOOR ELECTRICAL PLAN  
SCALE: 1/8"=1'-0"



		<div><div></div><div><div>Bergmann</div><div>associates</div></div></div> <div><div>www.bergmannpc.com</div><div>28 East Main Street</div><div>200 First Federal Plaza</div><div>Rochester, New York 14614</div><div>585.232.5135 / 585.232.4652 fax</div><div>Engineers / Architects / Planners / Surveyors</div></div>	ALL WORK TO BE IN ACCORDANCE WITH N.F.P.A., NATIONAL, STATE AND CITY CODES & O.S.H.A.	Approved: A.P.G.E. _____ Date _____	Approved: Fire Chief _____ Date _____	Approved: Energy Engineer _____ Date _____	Drawing Title SECOND FLOOR ELECTRICAL PLAN	Project Title ENERGY CONSERVATION MEASURES AT THE BATH VAMC	Date 08/15/2012	<div>VAMC</div>		
			Approved: Logistics Manager _____ Date _____	Approved: Interior Designer _____ Date _____	Approved: Safety Officer _____ Date _____	Approved: M&R Foreman _____ Date _____	Approved: Eng. Project Supervisor _____ Date _____	Building No. 78	Checked JJD		Drawn TLS	Project No. 528A6-12-629
			Approved: Infection Control Mgr. _____ Date _____	Approved: Info. Sys. _____ Date _____	Approved: Industrial Hygienist _____ Date _____	_____ Date _____	Approved: Medical Center Director _____ Date _____	_____	_____		_____	DRAWING NO VAMC-528A6-12-629 78-E-103
			Approved: Chief Security _____ Date _____	Approved: Women's Health Rep _____ Date _____	Approved: Space Owner _____ Date _____	_____ Date _____	_____	_____	_____		_____	Location BATH, NEW YORK
Revisions	Date								Dwg. 113 of 124			