




2 MEZZANINE PLAN  
SCALE: 1/8"=1'-0"

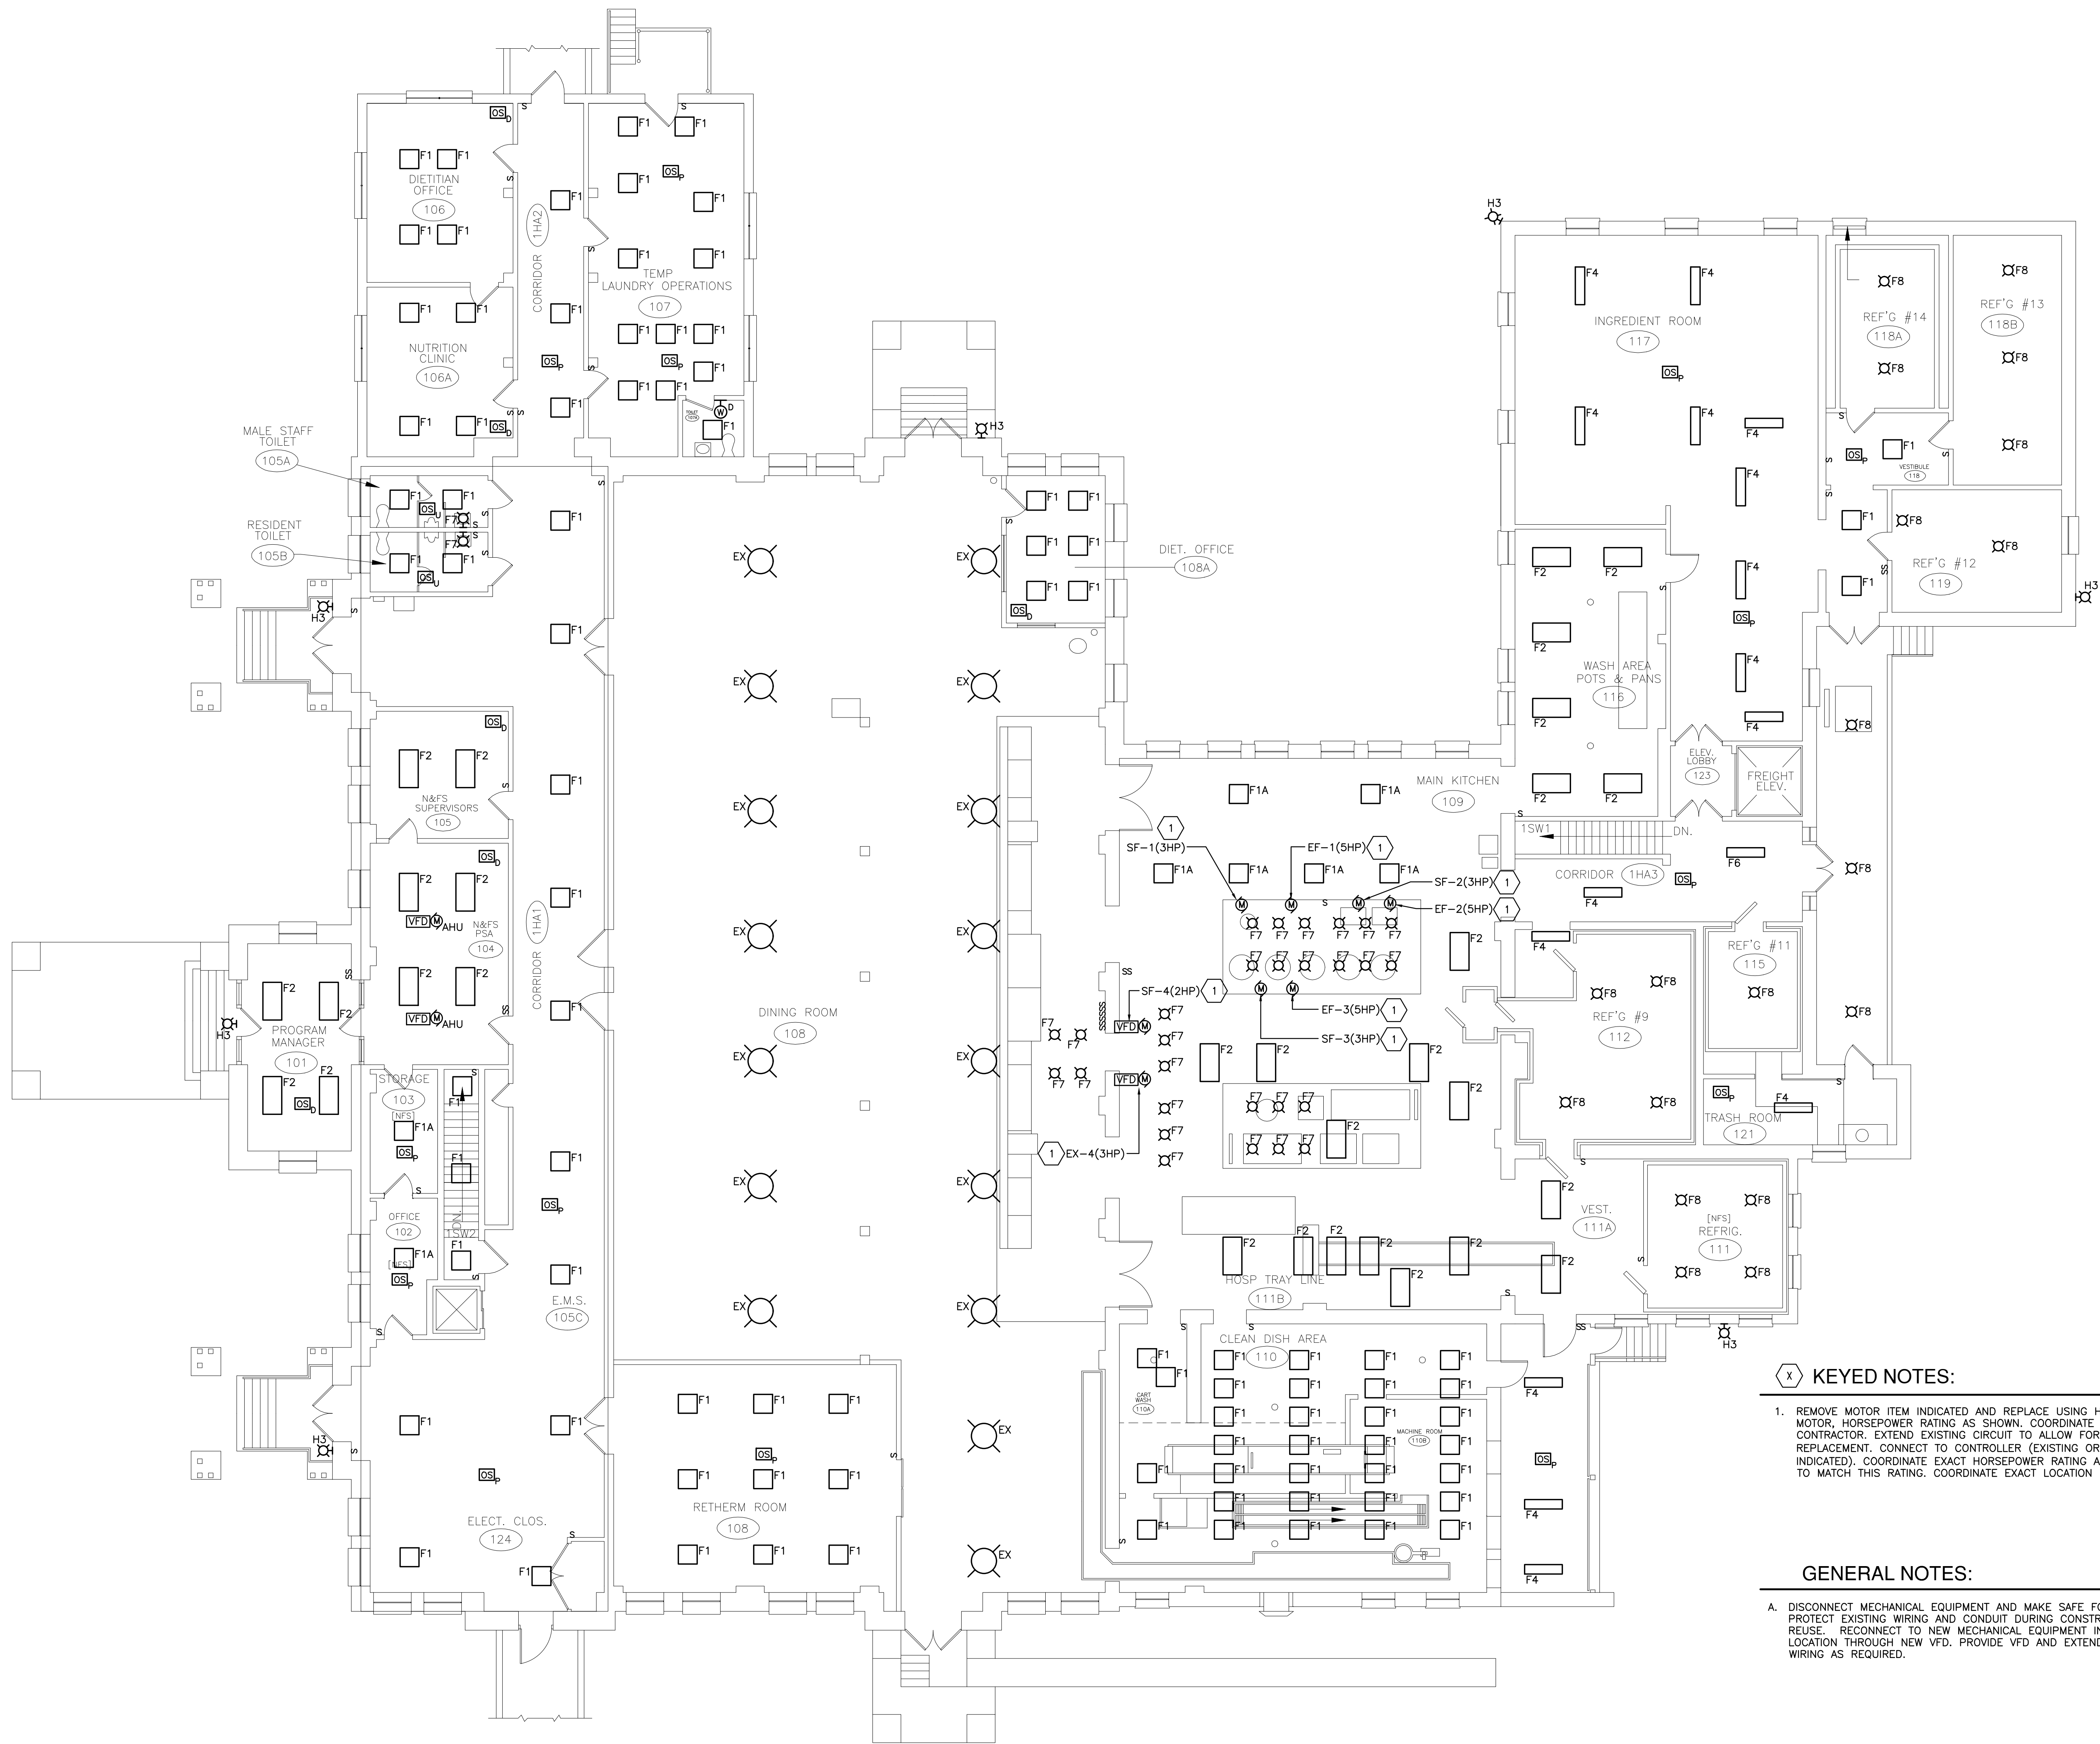

1 FIRST FLOOR ELECTRICAL PLAN  
SCALE: 1/8"=1'-0"

- KEYED NOTES:**
1. REMOVE MOTOR ITEM INDICATED AND REPLACE USING HIGH EFFICIENCY MOTOR, HORSEPOWER RATING AS SHOWN. COORDINATE WITH MECHANICAL CONTRACTOR. EXTEND EXISTING CIRCUIT TO ALLOW FOR MOTOR REPLACEMENT. CONNECT TO CONTROLLER (EXISTING OR REPLACEMENT IF INDICATED). COORDINATE EXACT HORSEPOWER RATING AND PROVIDE MOTOR TO MATCH THIS RATING. COORDINATE EXACT LOCATION IN FIELD.
- GENERAL NOTES:**
- A. DISCONNECT MECHANICAL EQUIPMENT AND MAKE SAFE FOR REMOVAL. PROTECT EXISTING WIRING AND CONDUIT DURING CONSTRUCTION FOR REUSE. RECONNECT TO NEW MECHANICAL EQUIPMENT IN SAME LOCATION THROUGH NEW VFD. PROVIDE VFD AND EXTEND CONDUIT AND WIRING AS REQUIRED.

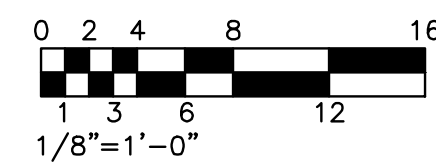

		<div><div><div>www.bergmannpc.com</div><div>28 East Main Street</div><div>200 First Federal Plaza</div><div>Rochester, New York 14614</div><div>585.232.5135 / 585.232.4652 fax</div><div>Engineers / Architects / Planners / Surveyors</div></div></div>	ALL WORK TO BE IN ACCORDANCE WITH N.F.P.A., NATIONAL, STATE AND CITY CODES & O.S.H.A.	Approved: A.F.G.E. _____ Date _____	Approved: Fire Chief _____ Date _____	Approved: Energy Engineer _____ Date _____	Drawing Title <b>FIRST FLOOR ELECTRICAL PLAN</b>	Project Title <b>ENERGY CONSERVATION MEASURES AT THE BATH VAMC</b>	Date <b>08/15/2012</b>	<div><div>A</div><div>V</div><div>A</div><div>.</div><div>.</div><div>.</div><div>A</div></div>		
			Approved: Logistics Manager _____ Date _____	Approved: Interior Designer _____ Date _____	Approved: Safety Officer _____ Date _____	Approved: M&R Foreman _____ Date _____	Approved: Eng. Project Supervisor _____ Date _____	Building No. <b>24</b>	Checked <b>JJD</b>		Drawn <b>TLS</b>	Project No. <b>528A6-12-629</b>
			Approved: Infection Control Mgr. _____ Date _____	Approved: Info. Sys. _____ Date _____	Approved: Industrial Hygienist _____ Date _____	_____ Date _____	Approved: Medical Center Director _____ Date _____	Location <b>BATH, NEW YORK</b>	DRAWING NO. <b>VAMC-528A6-12-629</b>		<b>24-E-102</b> 2wq. 91 of 124	
			Approved: Chief Security _____ Date _____	Approved: Women's Health Rep _____ Date _____	Approved: Space Owner _____ Date _____	_____ Date _____						