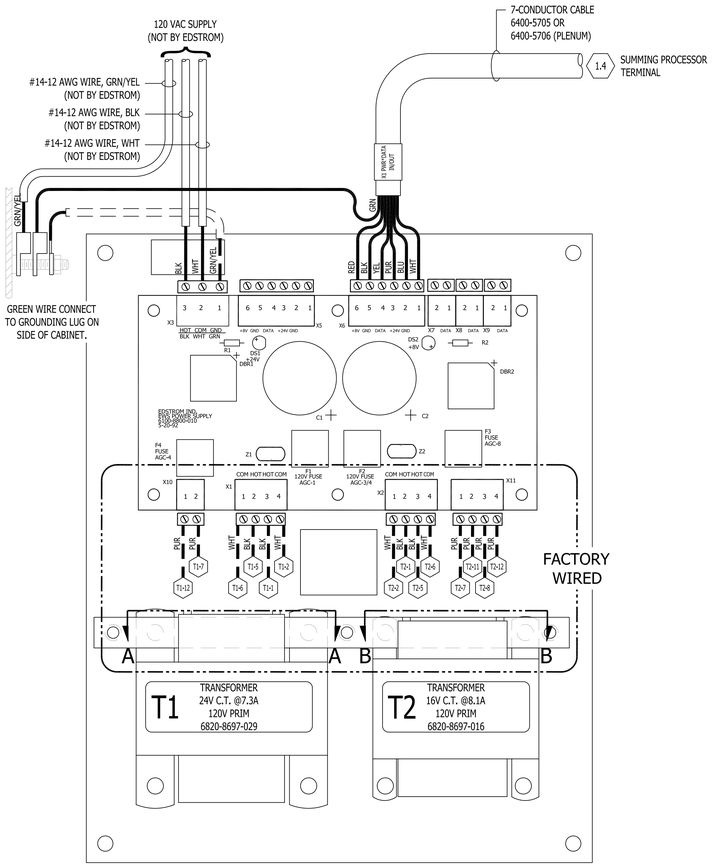

SUMMING PROCESSOR POWER SUPPLY CONNECTIONS (EXISTING)
7700-8800-500

1/1

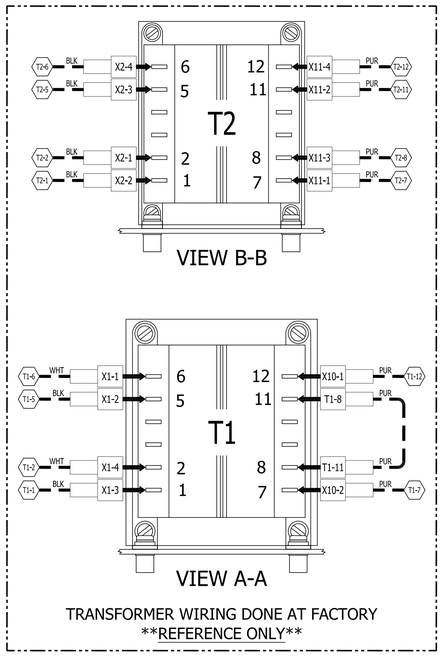

TRANSFORMER WIRING DONE AT FACTORY
REFERENCE ONLY

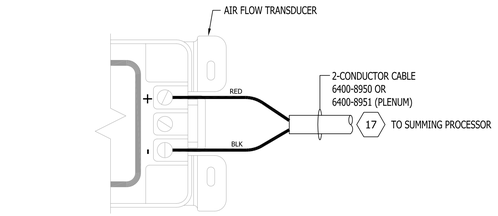

AIR FLOW TRANSDUCER WIRING (EXISTING)

1/1

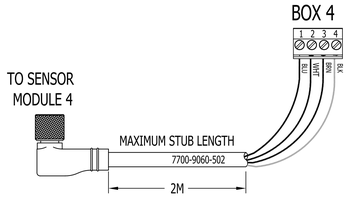

SENSOR MODULE 4 CABLE WIRING - EXISTING

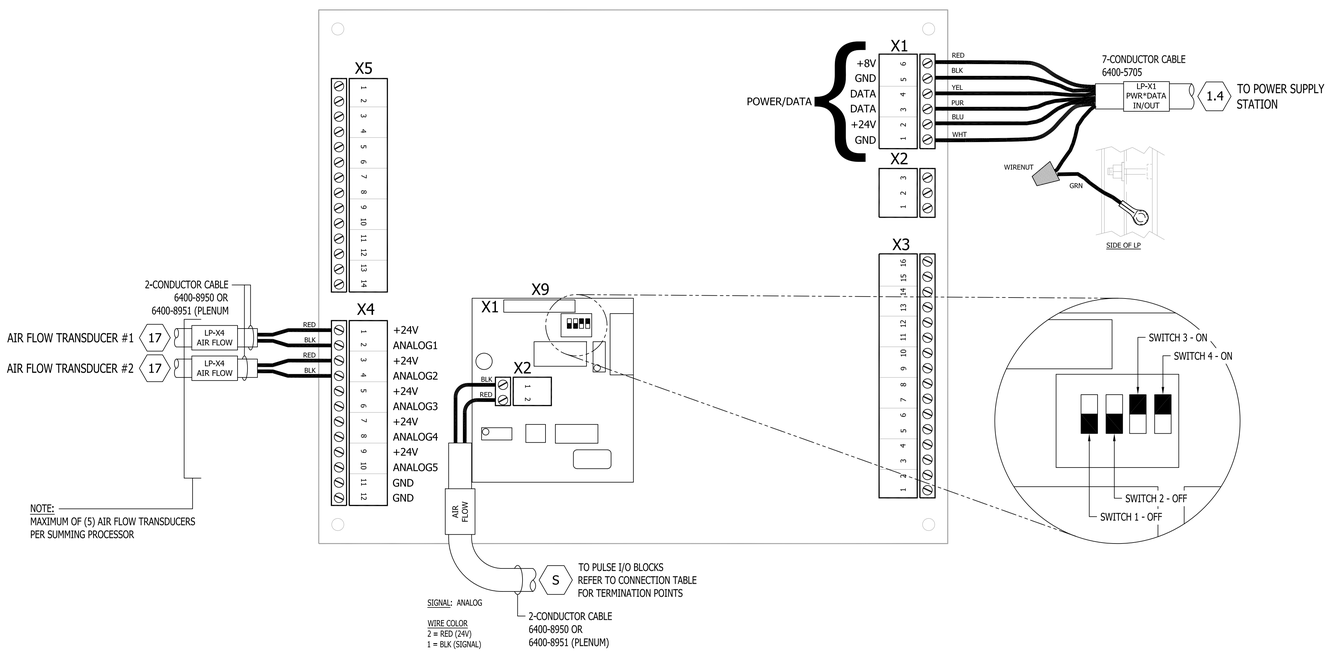

NOTE:
MAXIMUM OF (5) AIR FLOW TRANSDUCERS
PER SUMMING PROCESSOR

SIGNAL: ANALOG

WIRE COLOR
2 = RED (24V)
1 = BLK (SIGNAL)

ANALOG SUMMING PROCESSOR (EXISTING)

1/1

CONNECTION DETAILS FOR PANEL LABELED PCCX-001A

REV.	JOB NO.	REVISION	DRAWN	APPROVER 1	APPROVER 2
A	#32472	SUBMITTAL: INITIAL DRAWING RELEASE.	KGJ-04/24/17	PKS-05/02/17	PEB-05/03/17

REV.	JOB NO.	REVISION	DRAWN	APPROVER 1	APPROVER 2
0	#	*	DPT-MO/DY/YR	- / /	- / /

REV.	JOB NO.	REVISION	DRAWN	APPROVER 1	APPROVER 2
0	#	*	DPT-MO/DY/YR	- / /	- / /

REV.	JOB NO.	REVISION	DRAWN	APPROVER 1	APPROVER 2
0	#	*	DPT-MO/DY/YR	- / /	- / /

When applicable, the detail views on this drawing incorporate third angle projection.

PROPRIETARY DATA-INFORMATION:
Reproduction or disclosure of data or information contained hereon without the explicit consent of Edstrom is forbidden.

Edstrom
819 Bakke Avenue, Waterford, WI 53185
Tel: 262.534.5181 Fax: 262.534.5184

PULSE PCCX I/O BOX CONNECTIONS FOR:
JESSE BROWN V.A. MEDICAL CENTER
BUILDING 11B/78th FLOOR/MEDICAL R&D SERVICE 278
CHICAGO, IL

PLOT SCALE	1 = 1	E BORD	DRAWING NO.	REV.
DRN. BY	KGJ	DATE 04-24-17	5820-9156-001.4	A