

- ## NOTES - NEW WORK

- 1 LOCATE AND TIE INTO EXISTING SITE LIGHTING CIRCUIT.
- 2 RUN 2-1" C. SAW CUT EXISTING ASPHALT. PATCH ASPHALT TO MATCH EXISTING.
- 3 RUN 2-#6, #6 GRD.
- 4 LOCATION OF SITE LIGHTING SOURCE. TURN SITE LIGHTING ON AND VERIFY CIRCUIT LOAD TO ENSURE CAPACITY IS AVAILABLE TO ACCOMMODATE NEW LIGHTING LOAD PRIOR TO PERFORMING WORK.
- 5 PROVIDE 12"x12" POLYMER CONCRETE TIER 2 PULL BOX WITH HEAVY DUTY COVER MARKED "ELECTRIC" AND GASKET. MOUNT SO COVER IS FLUSH WITH NEW ASPHALT.

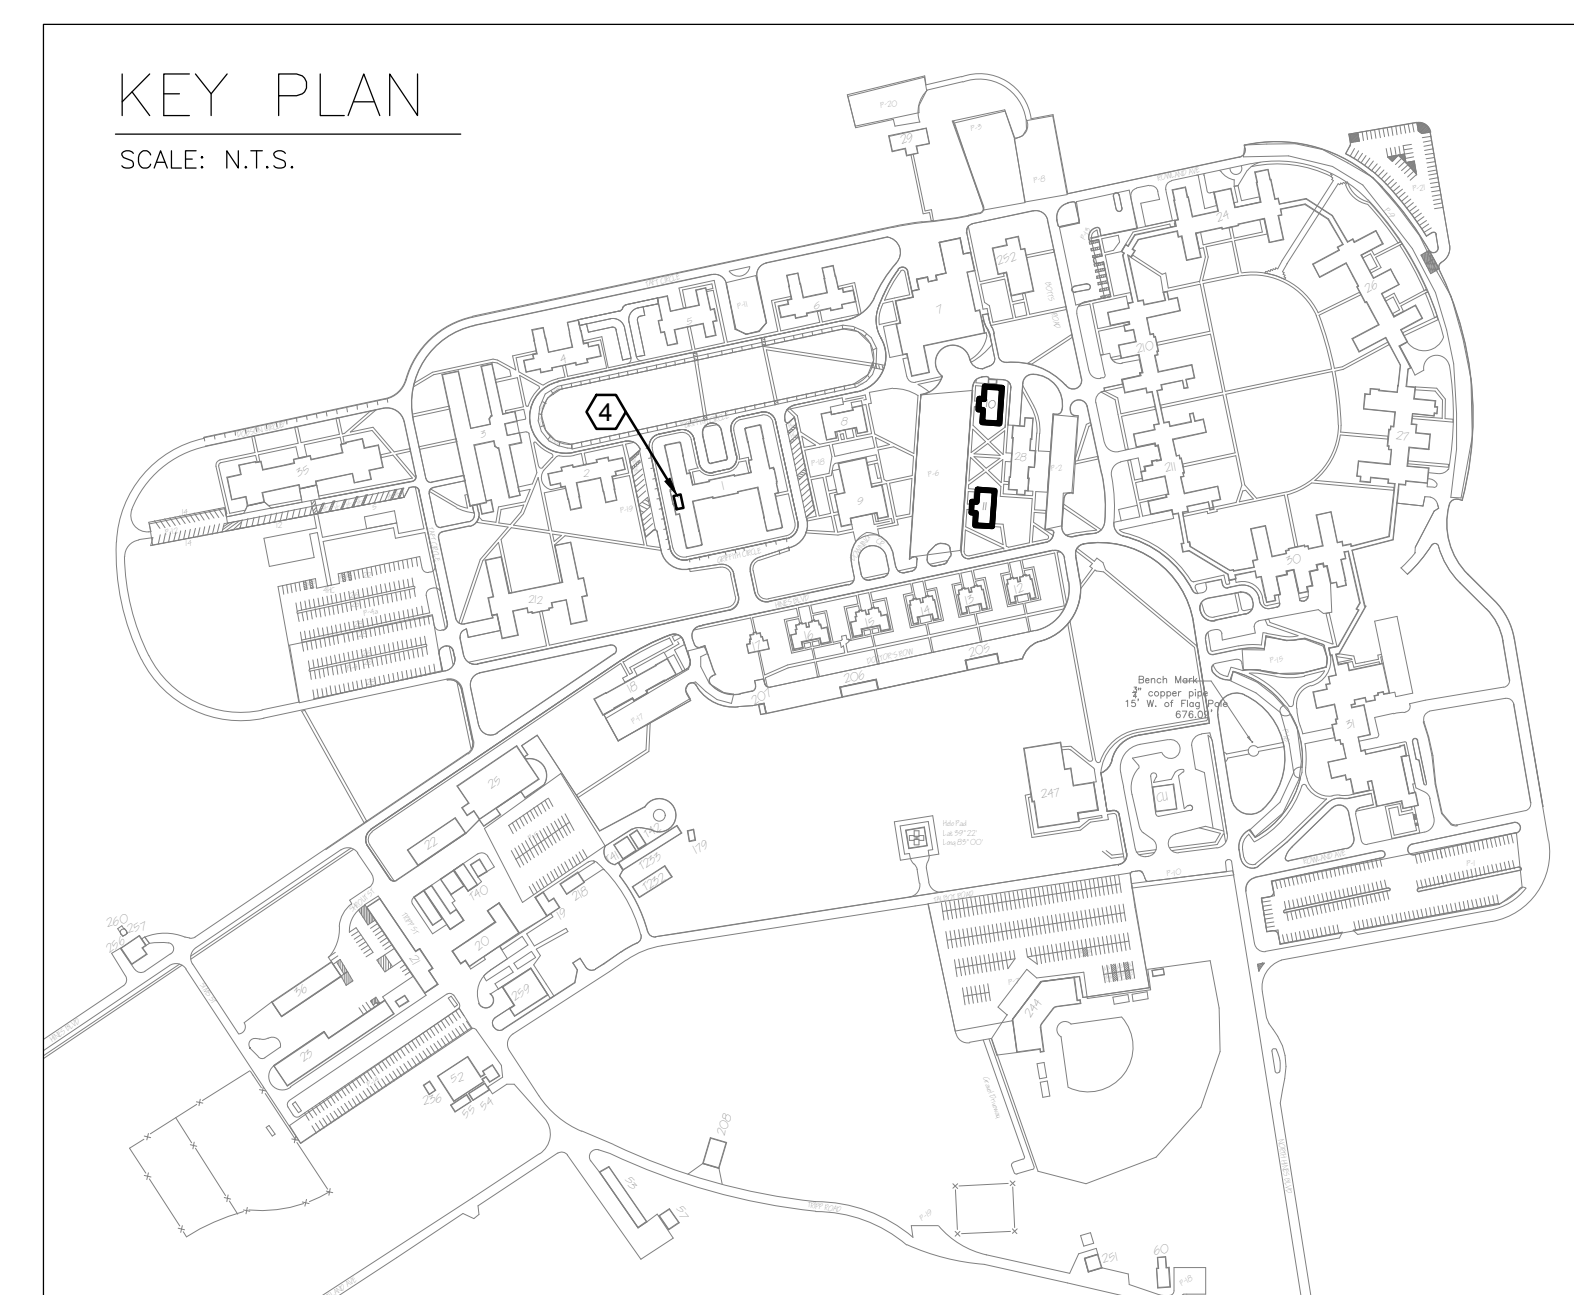
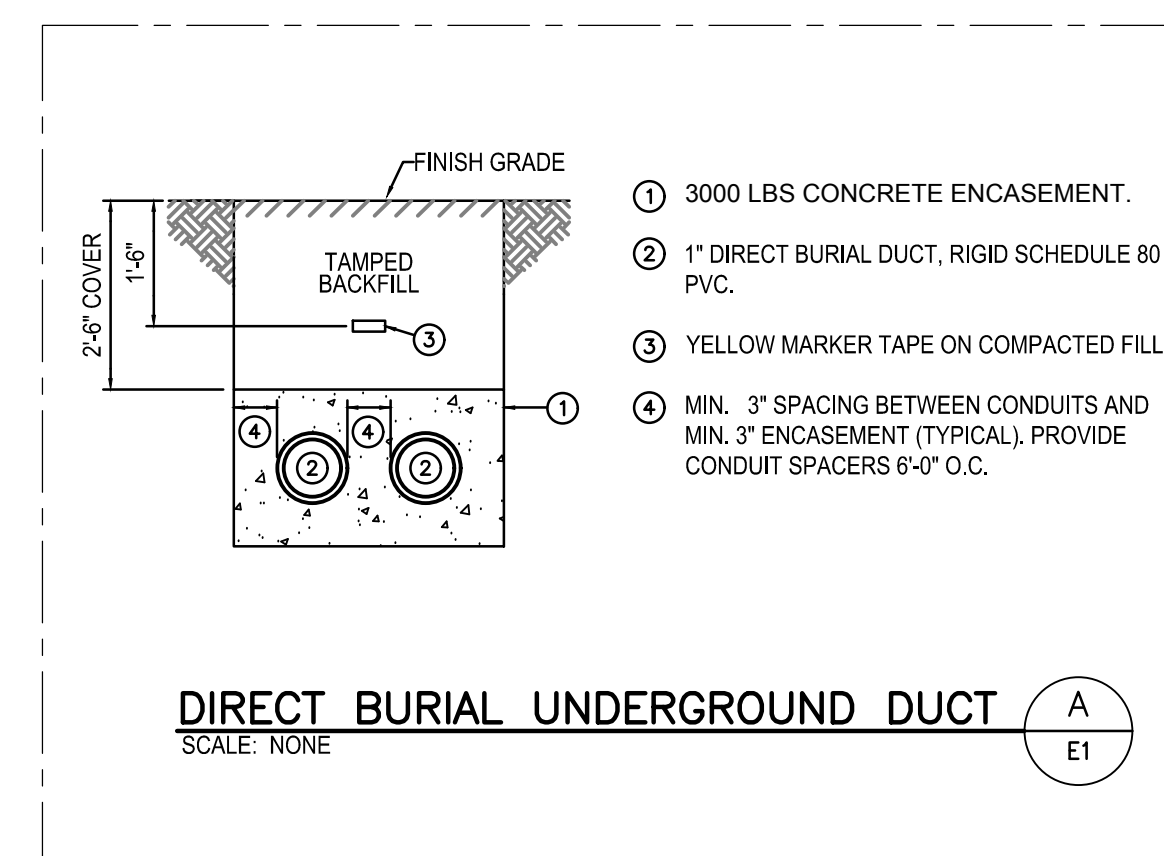
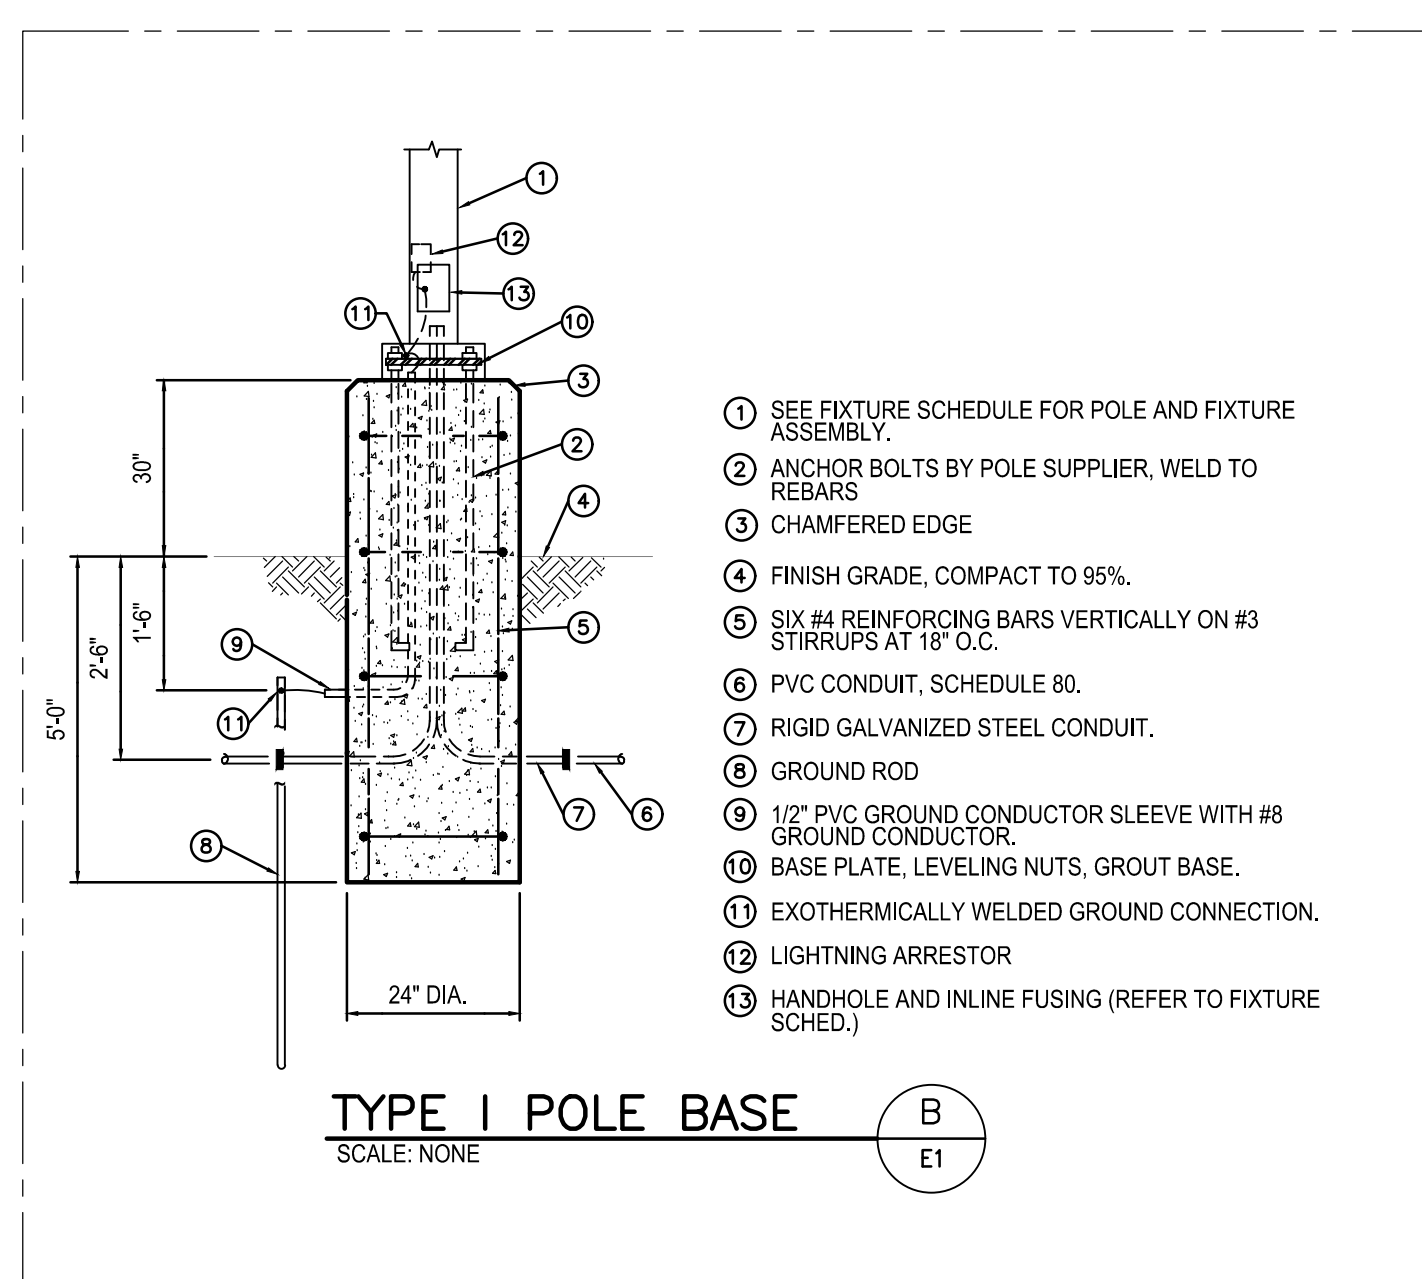


GENERAL NOTES

- A IN ADDITION TO SITE WORK INDICATED ON PLANS ASSOCIATED TO BUILDINGS, 10.11 DISCONNECT ALL SERVICES INTO BUILDINGS ASSOCIATED WITH BUILDINGS 26, 27 & 28 IN CONJUNCTION WITH DEMOLITION OF BUILDINGS(S).
- B LOCATIONS AND SIZES OF EXISTING FEEDERS HAVE BEEN DETERMINED FROM A REVIEW OF EXISTING DRAWINGS AND/OR SITE INSPECTION. THE CONTRACTOR SHALL FIELD VERIFY THE EXIST LOCATIONS, ELEVATIONS, ETC PRIOR TO BEGINNING OF WORK.
- C IDENTIFY AND CONFIRM WITH COR PRIOR TO BEGINNING ANY WORK ALL MATERIALS AND EQUIPMENT WHICH THE VA WISHES TO RETAIN. ALL REMOVED MATERIALS AND EQUIPMENT DESIGNATED BY THE VA SHALL BE TURNED OVER AND PLACED WHERE DIRECTED. ALL MATERIALS AND EQUIPMENT, WHICH THE VA DOES NOT WISH TO RETAIN, SHALL BECOME A PROPERTY OF THE CONTRACTOR RESPONSIBLE FOR THE REMOVAL AND SHALL BE REMOVED FOR PROPER DISPOSAL.
- D REFER TO ARCHITECTURAL PLANS FOR PROJECT PHASING REQUIREMENTS.
- E BEFORE DIGGING, CONTRACTOR SHALL HIRE A UTILITY LOCATE SERVICE. CONTRACTOR SHALL BE RESPONSIBLE FOR MAINTAINING MARKING. BEFORE DIGGING, THE CONTRACTOR SHALL OBTAIN AN APPROVED DIG PERMIT FROM THE MEDICAL CENTER PER STANDARD OPERATING PROCEDURE 32 DIG PERMITS. CONTRACTOR SHALL BE RESPONSIBLE FOR HAVING A COPY OF THE APPROVED PERMIT ON SITE DURING WORK OPERATIONS. REFER TO DRAWING G001 FOR ADDITIONAL INFORMATION.

NOTES - REMOVALS

- 1 CUT EXISTING UNDERGROUND CONDUIT/CONDUCTORS AT BUILDING FOOTER.
- 2 REMOVE 25KVA/4PI (120/240V) PAD MOUNT TRANSFORMER, CIRCUIT BREAKER AND CONCRETE PAD. VAND SHALL VERIFY IF THE EXISTING TRANSFORMER AND COPPER CONDUCTORS SHOULD BE TURNED OVER FOR FUTURE USE (OR RECYCLING).
- 3 DISCONNECT ASSOCIATED LOAD-BREAK ELBOWS IN MANHOLE #36 SERVING PMT #10 & #11.
- 4 REMOVE ASSOCIATED PRIMARY AND SECONDARY FEEDERS/CONDUIT TO BUILDING.
- 5 MAINTAIN EXISTING MAN HOLE.
- 6 ELECTRICAL SERVICE IS NOT SUITABLE FOR TEMPORARY CONSTRUCTION USE.
- 7 EXISTING PRIMARY FEEDER TO REMAIN.
- 8 REMOVE EXISTING 6 STRAND FIBER AND 50 PR COPPER BACK TO BASEMENT OF BUILDING 28.

[illegible]

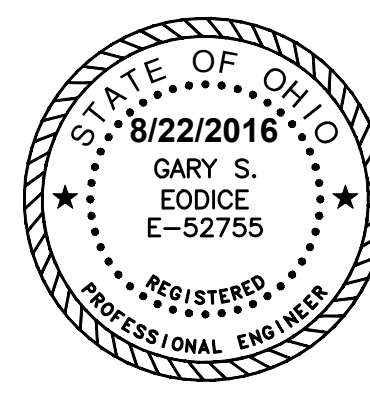
CONSULTANTS:

Heapy Engineering
MEP Design Technology Planning Commissioning Energy

Nationally Recognized Leader in Sustainability

1400 W Dorothy Lane, Dayton, OH 45409-1310
Ph 937-224-0861 Fax 937-224-5777 www.heapy.com

PROJECT NO. 2017-05043 FIRM LICENSE NO. 01528



ARCHITECT/ENGINEERS

JOHN POE ARCHITECTS

3131 NEWMARK DRIVE,
SUITE 200
MIAMISBURG, OHIO 45342

937 461 3290 PHONE
937 461 0260 FAX
ina@ichnpoe.com

	Drawing Title
--	---------------

ELECTRICAL PLANS

Approved: Project Director

Project Title

title
BUILDINGS 2, 6, 10 & 11
DEMOLITION

[illegible]

Chillicothe, Ohio

Date

☐ Checked

Project No. -
VA Project No. 538-11-125
JPA Project No. 17001.00

Building Number
2, 6, 10, & 11

Drawing Number

E1

Dwa. of

Office of
Construction
and Facilities
Management

